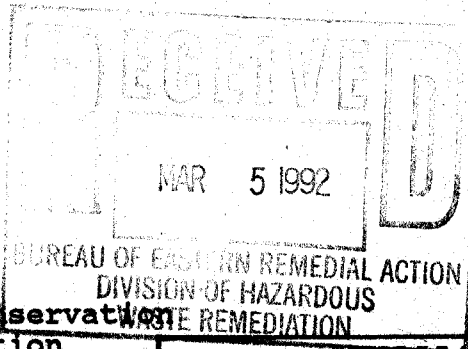


Island[®]
MADE IN U.S.A.
Hanging
Folders
Model No.
91525

6



575 Broad Hollow Road, Melville, NY 11747-5076
(516) 756-8000 • Fax: (516) 694-4122



March 4, 1992

Mr. John Barnes
NYS Dept. of Environmental Conservation
Bureau of Eastern Remedial Action
Div. of Hazardous Waste Remediation
50 Wolf Road
Albany, NY 12233

Re: Remedial Investigation/Feasibility of
Grumman Aerospace Corporation, Bethpage
Project No. NY00803

FOILABLE <input checked="" type="checkbox"/> Y <input type="checkbox"/> N	B.E.R.A.	FILE SECTION
SITE NAME <i>Grumman - off-site</i>		<input type="checkbox"/> I
SITE CODE <i>130003A</i>		<input type="checkbox"/> II
SUB SECTIONS		<input type="checkbox"/> III
PRO ELEMENT		<input type="checkbox"/> IV
OPERATIVE UNIT NO. <i>DESC.</i>		<input type="checkbox"/> V
<i>DATE OF FINAL</i>		<input type="checkbox"/> VI

Dear Mr. Barnes:

Enclosed please find copies of Lab reports covering all of the supply wells in the Bethpage Water District for 1991. As you will note, the wells are sampled on a quarterly basis for volatile organics and I have furnished copies for all four quarters. Wells 6-1 and 6-2 have treatment available on site and we have furnished you with the raw water data only.

If you require anything further or have any questions, please give me a call.

Very truly yours,

HOLZMACHER, MCLENDON & MURRELL, P.C.

John J. Molloy, P.E.
Vice President

JJM:des
enclosures

cc. Board of Commissioners, BPWD
Supt. Ronald Krumholz, BPWD
Anthony Sabino, Esq.

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 02/04/91
DATE RECEIVED.. 02/04/91
COLLECTED BY... CL99POINT NO: N8004
LOCATION: WELL #5-1

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
ACIDITY	11.4	mg/l	
SILVER	0.01	mg/l	0.05
ARSENIC	<10	ug/l	50.0
BARIUM	<0.20	mg/l	1.0
CALCIUM	0.69	mg/l	
CALCIUM HARDNESS	2	mg/l	
CADMIUM	<5	ug/l	10.0
CHLORIDE	4	mg/l	250
CO2	10	mg/l	
COLOR	<5	units	15
SPECIFIC CONDUCTIVITY	30	umhos	
CHROMIUM	<0.01	mg/l	0.05
COPPER	0.33	mg/l	1.0
FLUORIDE	<0.1	mg/l	2.2
IRON	0.29	mg/l	0.30
TOTAL HARDNESS	3	mg/l	
MERCURY	<0.2	ug/l	2.0
POTASSIUM	0.34	mg/l	
LANGLIER SATURATION INDEX	-5.08		
DETERGENTS (MBAS)	<0.04	mg/l	0.5
MAGNESIUM	0.26	mg/l	
MANGANESE	<0.02	mg/l	0.30
SODIUM	2.9	mg/l	
AMMONIA (NH3)	<0.02	mg/l	
NITRITE (AS N)	<0.1	mg/l	
NITRATE (AS N)	0.4	mg/l	10.0
ODOR	0	units	3
LEAD	<5	ug/l	50.0
PH	5.9	units	
SELENIUM	<5.0	ug/l	10.0
SULFATE	<5	mg/l	250
TOTAL ALKALINITY	5.5	mg/l	
TOTAL SOLIDS	15	mg/l	

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

FILE


LABORATORY DIRECTOR

Annals

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 02/04/91
DATE RECEIVED.. 02/04/91
COLLECTED BY... CL99

POINT NO: N8004
LOCATION: WELL #5-1

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TURBIDITY	<1 units	5.0
ZINC	<0.02 mg/l	5.0

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 02/04/91
DATE RECEIVED.. 02/04/91
COLLECTED BY... CL99

POINT NO: N8004
LOCATION: WELL #5-1

REMARKS:

VOLATILE ORGANICS (METHOD 504) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
ETHYLENE DIBROMIDE	<0.02	5			
DIBROMOCHLOROPROPANE	<0.02	5			


- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

DATE EXTRACTED. 02/07/91
DATE RUN..... 02/12/91
DATE REPORTED.. 02/13/91

FILE


LABORATORY DIRECTOR

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9103097

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 02/04/91
DATE RECEIVED.. 02/04/91
COLLECTED BY... CL99

POINT NO: N8004
LOCATION: WELL #5-1

REMARKS:

PESTICIDES - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
LINDANE	<0.05	4			
HEPTACHLOR	<0.05	50			
ALDRIN	<0.05	50			
HEPTACHLOR EPOXIDE	<0.05	50			
DIELDRIN	<0.10	50			
ENDRIN	<0.10	0.2			
P,P'DDT	<0.10	50			
METHOXYCHLOR	<0.5	50			
TOXAPHENE	<1.0	5			
CHLORDANE	<0.5	50			
O,P DDT	<0.10	50			


- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

DATE EXTRACTED. 02/07/91
DATE RUN..... 02/09/91
DATE REPORTED.. 02/12/91

FILE


LABORATORY DIRECTOR

NYSDEC 000164

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 02/04/91
DATE RECEIVED.. 02/04/91
COLLECTED BY... CL99

POINT NO: N8004
LOCATION: WELL #5-1

REMARKS:

HERBICIDES - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
2,4,-D	<0.2	50			
2,4,5-TP (SILVEX)	<0.05	10			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

DATE EXTRACTED. 02/26/91
DATE RUN..... 02/27/91
DATE REPORTED.. 03/04/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 04/03/91
DATE RECEIVED.. 04/03/91
COLLECTED BY... CL99POINT NO: N3876
LOCATION: WELL #6-1

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
ACIDITY	10 mg/l	
SILVER	<0.01 mg/l	0.05
ARSENIC	<10 ug/l	50.0
BARIUM	<0.20 mg/l	1.0
CALCIUM	1.4 mg/l	
CALCIUM HARDNESS	3 mg/l	
CADMIUM	<5.0 ug/l	10.0
CHLORIDE	10 mg/l	250
CO2	9.1 mg/l	
COLOR	<5 units	15
SPECIFIC CONDUCTIVITY	122 umhos	
CHROMIUM	<0.01 mg/l	0.05
COPPER	0.05 mg/l	1.0
IRON	0.04 mg/l	0.30
TOTAL HARDNESS	5 mg/l	
MERCURY	<0.2 ug/l	2.0
POTASSIUM	0.78 mg/l	
LANGLIER SATURATION INDEX	-5.67	
DETERGENTS (MBAS)	<0.04 mg/l	0.5
MAGNESIUM	0.47 mg/l	
MANGANESE	<0.02 mg/l	0.30
SODIUM	18.2 mg/l	
AMMONIA (NH3)	<0.02 mg/l	
NITRITE (AS N)	<0.1 mg/l	
NITRATE (AS N)	5.0 mg/l	10.0
ODOR	0 units	3
LEAD	<5 ug/l	50.0
PH	5.4 units	
SELENIUM	<5 ug/l	10.0
SULFATE	11 mg/l	250
TOTAL ALKALINITY	2.6 mg/l	
TOTAL SOLIDS	87 mg/l	
TURBIDITY	<1 units	5.0

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 04/22/91

FILE


LABORATORY DIRECTOR

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9109588

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 04/03/91
DATE RECEIVED.. 04/03/91
COLLECTED BY... CL99

POINT NO: N3876
LOCATION: WELL #6-1

REMARKS:


<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
ZINC	<0.02 mg/l	5.0

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 04/22/91

FILE


LABORATORY DIRECTOR

NYSDEC 000167

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9109588

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 04/03/91
DATE RECEIVED.. 04/03/91
COLLECTED BY... CL99

POINT NO: N3876
LOCATION: WELL #6-1

REMARKS:

VOLATILE ORGANICS (METHOD 504) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
ETHYLENE DIBROMIDE	<0.02	5			
DIBROMOCHLOROPROPANE	<0.02	5			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 04/22/91

DATE EXTRACTED. 04/05/91
DATE RUN..... 04/05/91
DATE REPORTED.. 04/08/91

FILE


LABORATORY DIRECTOR

NYSDEC 000168

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 04/03/91
DATE RECEIVED.. 04/03/91
COLLECTED BY... CL99

POINT NO: N3876
LOCATION: WELL #6-1

REMARKS:

HERBICIDES - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
2,4,-D	<0.2	50			
2,4,5-TP (SILVEX)	<0.05	10			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 04/22/91

DATE EXTRACTED. 04/17/91
DATE RUN..... 04/18/91
DATE REPORTED.. 04/19/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 04/03/91
DATE RECEIVED.. 04/03/91
COLLECTED BY... CL99

POINT NO: N3876
LOCATION: WELL #6-1

REMARKS:

PESTICIDES - (ug/l)


<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
LINDANE	<0.05	4			
HEPTACHLOR	<0.05	50			
ALDRIN	<0.05	50			
HEPTACHLOR EPOXIDE	<0.05	50			
DIELDRIN	<0.10	50			
ENDRIN	<0.10	0.2			
P,P' DDT	<0.10	50			
METHOXYCHLOR	<0.5	50			
TOXAPHENE	<1.0	5			
CHLORDANE	<0.5	50			
O,P DDT	<0.10	50			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 04/22/91

DATE EXTRACTED. 04/15/91
DATE RUN..... 04/17/91
DATE REPORTED.. 04/18/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATEDDATE COLLECTED. 04/03/91
DATE RECEIVED.. 04/03/91
COLLECTED BY... CL99POINT NO: N3876
LOCATION: WELL #6-1

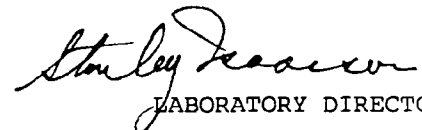
REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
ACIDITY	1	mg/l	
SILVER	<0.01	mg/l	0.05
ARSENIC	<10	ug/l	50.0
BARIUM	<0.20	mg/l	1.0
CALCIUM	1.4	mg/l	
CALCIUM HARDNESS	3	mg/l	
CADMIUM	<5.0	ug/l	10.0
CHLORIDE	10	mg/l	250
CO2	1.7	mg/l	
COLOR	<5	units	15
SPECIFIC CONDUCTIVITY	119	umhos	
CHROMIUM	<0.01	mg/l	0.05
COPPER	0.03	mg/l	1.0
IRON	<0.02	mg/l	0.30
TOTAL HARDNESS	5	mg/l	
MERCURY	<0.2	ug/l	2.0
POTASSIUM	0.86	mg/l	
LANGLIER SATURATION INDEX	-4.78		
DETERGENTS (MBAS)	<0.04	mg/l	0.5
MAGNESIUM	0.46	mg/l	
MANGANESE	<0.02	mg/l	0.30
SODIUM	18.3	mg/l	
AMMONIA (NH3)	<0.02	mg/l	
NITRITE (AS N)	<0.1	mg/l	
NITRATE (AS N)	5.0	mg/l	10.0
ODOR	0	units	3
LEAD	<5.0	ug/l	50.0
PH	6.3	units	
SELENIUM	<5	ug/l	10.0
SULFATE	14.5	mg/l	250
TOTAL ALKALINITY	2.5	mg/l	
TOTAL DISSOLVED SOLIDS	78	mg/l	
TURBIDITY	<1	units	5.0

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/03/91


LABORATORY DIRECTOR

FILE

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9109589

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATED

DATE COLLECTED. 04/03/91
DATE RECEIVED.. 04/03/91
COLLECTED BY... CL99

POINT NO: N3876
LOCATION: WELL #6-1

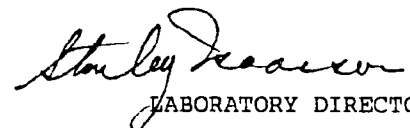
REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
ZINC	<0.02 mg/l	5.0

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/03/91


LABORATORY DIRECTOR

FILE

NYSDEC 000172

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATED

DATE COLLECTED. 04/03/91
DATE RECEIVED.. 04/03/91
COLLECTED BY... CL99

POINT NO: N3876
LOCATION: WELL #6-1

REMARKS:

HERBICIDES - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
2,4,-D	<0.2	50			
2,4,5-TP (SILVEX)	<0.05	10			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/03/91

DATE EXTRACTED. 04/17/91
DATE RUN..... 04/18/91
DATE REPORTED.. 05/30/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATED

DATE COLLECTED. 04/03/91
DATE RECEIVED.. 04/03/91
COLLECTED BY... CL99

POINT NO: N3876
LOCATION: WELL #6-1

REMARKS:

PESTICIDES - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
LINDANE	<0.05	4			
HEPTACHLOR	<0.05	50			
ALDRIN	<0.05	50			
HEPTACHLOR EPOXIDE	<0.05	50			
DIELDRIN	<0.10	50			
ENDRIN	<0.10	0.2			
P,P' DDT	<0.10	50			
METHOXYCHLOR	<0.5	50			
TOXAPHENE	<1.0	5			
CHLORDANE	<0.5	50			
O,P DDT	<0.10	50			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/03/91

DATE EXTRACTED. 04/15/91
DATE RUN..... 04/17/91
DATE REPORTED.. 05/30/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATED

DATE COLLECTED. 04/03/91
DATE RECEIVED.. 04/03/91
COLLECTED BY... CL99

POINT NO: N3876
LOCATION: WELL #6-1

REMARKS:

VOLATILE ORGANICS (METHOD 504) - (ug/l)


<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
ETHYLENE DIBROMIDE	<0.02	5			
DIBROMOCHLOROPROPANE	<0.02	5			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/03/91

DATE EXTRACTED. 04/05/91
DATE RUN..... 04/05/91
DATE REPORTED.. 05/30/91


LABORATORY DIRECTOR

FILE

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9109590

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 04/03/91
DATE RECEIVED.. 04/03/91
COLLECTED BY... CL99

POINT NO: N8941
LOCATION: WELL #6-2

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
ACIDITY	15	mg/l	
SILVER	<0.01	mg/l	0.05
ARSENIC	<10	ug/l	50.0
BARIUM	<0.2	mg/l	1.0
CALCIUM	0.58	mg/l	
CALCIUM HARDNESS	1	mg/l	
CADMIUM	<5	ug/l	10.0
CHLORIDE	6	mg/l	250
CO2	13.6	mg/l	
COLOR	<5	units	15
SPECIFIC CONDUCTIVITY	27	umhos	
CHROMIUM	<0.01	mg/l	0.05
COPPER	<0.02	mg/l	1.0
* IRON	*1.1	mg/l	0.30
TOTAL HARDNESS	3	mg/l	
MERCURY	<0.2	ug/l	2.0
POTASSIUM	0.24	mg/l	
LANGLIER SATURATION INDEX	-5.34		
DETERGENTS (MBAS)	<0.04	mg/l	0.5
MAGNESIUM	0.31	mg/l	
MANGANESE	0.06	mg/l	0.30
SODIUM	3.2	mg/l	
AMMONIA (NH3)	<0.02	mg/l	
NITRITE (AS N)	<0.1	mg/l	
NITRATE (AS N)	0.3	mg/l	10.0
ODOR	0	units	3
LEAD	<5	ug/l	50.0
PH	5.9	units	
SELENIUM	<5	ug/l	10.0
SULFATE	<5	mg/l	250
TOTAL ALKALINITY	5.2	mg/l	
TOTAL DISSOLVED SOLIDS	16	mg/l	
TURBIDITY	5.0	units	5.0

1 - Result(s) marked * exceed NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/03/91


LABORATORY DIRECTOR

FILE

NYSDEC 000176

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9109590

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 04/03/91
DATE RECEIVED.. 04/03/91
COLLECTED BY... CL99

POINT NO: N8941
LOCATION: WELL #6-2


REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
ZINC	<0.02 mg/l	5.0

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/03/91


LABORATORY DIRECTOR

FILE

NYSDEC 000177

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 04/03/91
DATE RECEIVED.. 04/03/91
COLLECTED BY... CL99

POINT NO: N8941
LOCATION: WELL #6-2

REMARKS:

PESTICIDES - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
LINDANE	<0.05	4			
HEPTACHLOR	<0.05	50			
ALDRIN	<0.05	50			
HEPTACHLOR EPOXIDE	<0.05	50			
DIELDRIN	<0.10	50			
ENDRIN	<0.10	0.2			
P,P' DDT	<0.10	50			
METHOXYCHLOR	<0.5	50			
TOXAPHENE	<1.0	5			
CHLORDANE	<0.5	50			
O,P DDT	<0.10	50			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/03/91

DATE EXTRACTED. 04/15/91
DATE RUN..... 04/17/91
DATE REPORTED.. 05/30/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 04/03/91
DATE RECEIVED.. 04/03/91
COLLECTED BY... CL99

POINT NO: N8941
LOCATION: WELL #6-2

REMARKS:

VOLATILE ORGANICS (METHOD 504) - (ug/l)

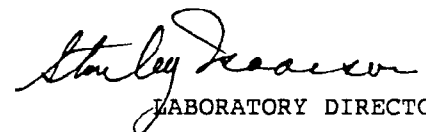
<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
ETHYLENE DIBROMIDE	<0.02	5			
DIBROMOCHLOROPROPANE	<0.02	5			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/03/91

DATE EXTRACTED. 04/08/91
DATE RUN..... 04/05/91
DATE REPORTED.. 05/30/91


LABORATORY DIRECTOR

FILE

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9109590

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 04/03/91
DATE RECEIVED.. 04/03/91
COLLECTED BY... CL99

POINT NO: N8941
LOCATION: WELL #6-2

REMARKS:

HERBICIDES - (ug/l)


<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
2,4,-D	<0.2	50			
2,4,5-TP (SILVEX)	<0.05	10			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/03/91

DATE EXTRACTED. 04/17/91
DATE RUN..... 04/18/91
DATE REPORTED.. 05/30/91


LABORATORY DIRECTOR

FILE

NYSDEC 000180

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATED

DATE COLLECTED. 04/03/91
DATE RECEIVED.. 04/03/91
COLLECTED BY... CL99

POINT NO: N8941
LOCATION: WELL #6-2

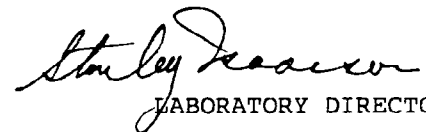
REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
ACIDITY	2	mg/l	
SILVER	<0.01	mg/l	0.05
ARSENIC	<10	ug/l	50.0
BARIUM	<0.20	mg/l	1.0
CALCIUM	0.59	mg/l	
CALCIUM HARDNESS	1	mg/l	
CADMIUM	<5.0	ug/l	10.0
CHLORIDE	5	mg/l	250
CO2	2.3	mg/l	
COLOR	<5	units	15
SPECIFIC CONDUCTIVITY	24	umhos	
CHROMIUM	<0.01	mg/l	0.05
COPPER	<0.02	mg/l	1.0
IRON	0.17	mg/l	0.30
TOTAL HARDNESS	2	mg/l	
MERCURY	<0.2	ug/l	2.0
POTASSIUM	0.56	mg/l	
LANGLIER SATURATION INDEX	-4.75		
DETERGENTS (MBAS)	<0.04	mg/l	0.5
MAGNESIUM	0.24	mg/l	
MANGANESE	<0.02	mg/l	0.30
SODIUM	3.3	mg/l	
AMMONIA (NH3)	<0.02	mg/l	
NITRITE (AS N)	<0.1	mg/l	
NITRATE (AS N)	0.3	mg/l	10.0
ODOR	0	units	3
LEAD	<5	ug/l	50.0
PH	6.5	units	
SELENIUM	<5	ug/l	10.0
SULFATE	<5	mg/l	250
TOTAL ALKALINITY	5.1	mg/l	
TOTAL DISSOLVED SOLIDS	20	mg/l	
TURBIDITY	2.0	units	5.0

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/03/91


LABORATORY DIRECTOR

FILE

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9109591

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATED

DATE COLLECTED. 04/03/91
DATE RECEIVED.. 04/03/91
COLLECTED BY... CL99

POINT NO: N8941
LOCATION: WELL #6-2

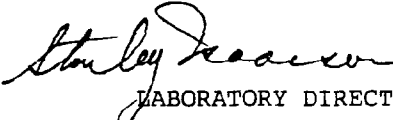
REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
ZINC	<0.02 mg/l	5.0

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/03/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATED

DATE COLLECTED. 04/03/91
DATE RECEIVED.. 04/03/91
COLLECTED BY... CL99

POINT NO: N8941
LOCATION: WELL #6-2

REMARKS:

PESTICIDES - (ug/l)

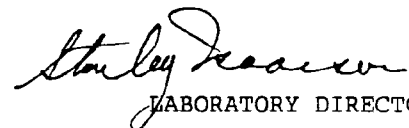
<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
LINDANE	<0.05	4			
HEPTACHLOR	<0.05	50			
ALDRIN	<0.05	50			
HEPTACHLOR EPOXIDE	<0.05	50			
DIELDRIN	<0.10	50			
ENDRIN	<0.10	0.2			
P,P' DDT	<0.10	50			
METHOXYCHLOR	<0.5	50			
TOXAPHENE	<1.0	5			
CHLORDANE	<0.5	50			
O,P DDT	<0.10	50			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/03/91

DATE EXTRACTED. 04/15/91
DATE RUN..... 04/17/91
DATE REPORTED.. 05/30/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATED

DATE COLLECTED. 04/03/91
DATE RECEIVED.. 04/03/91
COLLECTED BY... CL99

POINT NO: N8941
LOCATION: WELL #6-2

REMARKS:

HERBICIDES - (ug/l)

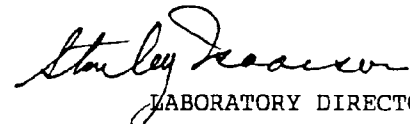
<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
2,4,-D	<0.2	50			
2,4,5-TP (SILVEX)	<0.05	10			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/03/91

DATE EXTRACTED. 04/17/91
DATE RUN..... 04/18/91
DATE REPORTED.. 05/30/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATED

DATE COLLECTED. 04/03/91
DATE RECEIVED.. 04/03/91
COLLECTED BY... CL99

POINT NO: N8941
LOCATION: WELL #6-2

REMARKS:

VOLATILE ORGANICS (METHOD 504) - (ug/l)

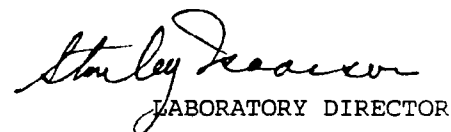
<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
ETHYLENE DIBROMIDE	<0.02	5			
DIBROMOCHLOROPROPANE	<0.02	5			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/03/91

DATE EXTRACTED. 04/08/91
DATE RUN..... 04/05/91
DATE REPORTED.. 05/30/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE.DATE COLLECTED. 01/31/91
DATE RECEIVED.. 01/31/91
COLLECTED BY... CL99POINT NO: N8767
LOCATION: WELL #7

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
ACIDITY	4.56 mg/l	
SILVER	<0.01 mg/l	0.05
ARSENIC	<10.0 ug/l	50.0
BARIUM	<0.20 mg/l	1.0
CALCIUM	2.5 mg/l	
CALCIUM HARDNESS	6 mg/l	
CADMIUM	<5 ug/l	10.0
CHLORIDE	5 mg/l	250
CO2	4 mg/l	
COLOR	<5 units	15
SPECIFIC CONDUCTIVITY	50 umhos	
CHROMIUM	<0.01 mg/l	0.05
COPPER	<0.02 mg/l	1.0
FLUORIDE	<0.1 mg/l	2.2
IRON	<0.02 mg/l	0.30
TOTAL HARDNESS	9 mg/l	
MERCURY	<0.2 ug/l	2.0
POTASSIUM	0.43 mg/l	
LANGLIER SATURATION INDEX	-5.25	
DETERGENTS (MBAS)	<0.04 mg/l	0.5
MAGNESIUM	0.79 mg/l	
MANGANESE	<0.02 mg/l	0.30
SODIUM	4.3 mg/l	
AMMONIA (NH3)	<0.02 mg/l	
NITRITE (AS N)	<0.1 mg/l	
NITRATE (AS N)	3.0 mg/l	10.0
ODOR	0 units	3
LEAD	<5.0 ug/l	50.0
PH	5.3 units	
SELENIUM	<5 ug/l	10.0
SULFATE	<5 mg/l	250
TOTAL ALKALINITY	4.1 mg/l	
TOTAL SOLIDS	36 mg/l	

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE.

DATE COLLECTED. 01/31/91
DATE RECEIVED.. 01/31/91
COLLECTED BY... CL99

POINT NO: N8767
LOCATION: WELL #7

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TURBIDITY	<1 units	5.0
ZINC	0.05 mg/l	5.0

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE.

DATE COLLECTED. 01/31/91
DATE RECEIVED.. 01/31/91
COLLECTED BY... CL99

POINT NO: N8767
LOCATION: WELL #7

REMARKS:

VOLATILE ORGANICS (METHOD 504) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
ETHYLENE DIBROMIDE	<0.02	5			
DIBROMOCHLOROPROPANE	<0.02	5			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

DATE EXTRACTED. 01/31/91
DATE RUN..... 02/06/91
DATE REPORTED.. 02/06/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE.

DATE COLLECTED. 01/31/91
DATE RECEIVED.. 01/31/91
COLLECTED BY... CL99

POINT NO: N8767
LOCATION: WELL #7

REMARKS:

PESTICIDES - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
LINDANE	<0.05	4			
HEPTACHLOR	<0.05	50			
ALDRIN	<0.05	50			
HEPTACHLOR EPOXIDE	<0.05	50			
DIELDRIN	<0.10	50			
ENDRIN	<0.10	0.2			
P,P' DDT	<0.10	50			
METHOXYCHLOR	<0.5	50			
TOXAPHENE	<1.0	5			
CHLORDANE	<0.5	50			
O,P DDT	<0.10	50			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

DATE EXTRACTED. 02/02/91
DATE RUN..... 02/05/91
DATE REPORTED.. 02/06/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE.

DATE COLLECTED. 01/31/91
DATE RECEIVED.. 01/31/91
COLLECTED BY... CL99

POINT NO: N8767
LOCATION: WELL #7

REMARKS:

HERBICIDES - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
2,4,-D	<0.2	50			
2,4,5-TP (SILVEX)	<0.05	10			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

DATE EXTRACTED. 02/26/91
DATE RUN..... 02/27/91
DATE REPORTED.. 03/04/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE.DATE COLLECTED. 01/31/91
DATE RECEIVED.. 01/31/91
COLLECTED BY... CL99POINT NO: N8768
LOCATION: WELL #8

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
ACIDITY	5.7	mg/l	
SILVER	<0.01	mg/l	0.05
ARSENIC	<10.0	ug/l	50.0
BARIUM	<0.20	mg/l	1.0
CALCIUM	1.3	mg/l	
CALCIUM HARDNESS	3	mg/l	
CADMIUM	<5	ug/l	10.0
CHLORIDE	4	mg/l	250
CO2	5	mg/l	
COLOR	<5	units	15
SPECIFIC CONDUCTIVITY	40	umhos	
CHROMIUM	<0.01	mg/l	0.05
COPPER	<0.02	mg/l	1.0
FLUORIDE	<0.1	mg/l	2.2
IRON	<0.02	mg/l	0.30
TOTAL HARDNESS	5	mg/l	
MERCURY	<0.2	ug/l	2.0
POTASSIUM	0.30	mg/l	
LANGLIER SATURATION INDEX	-5.34		
DETERGENTS (MBAS)	<0.04	mg/l	0.5
MAGNESIUM	0.41	mg/l	
MANGANESE	<0.02	mg/l	0.30
SODIUM	2.7	mg/l	
AMMONIA (NH3)	<0.02	mg/l	
NITRITE (AS N)	<0.1	mg/l	
NITRATE (AS N)	1.2	mg/l	10.0
ODOR	0	units	3
LEAD	<5.0	ug/l	50.0
PH	5.4	units	
SELENIUM	<5	ug/l	10.0
SULFATE	<5	mg/l	250
TOTAL ALKALINITY	5.1	mg/l	
TOTAL SOLIDS	21	mg/l	

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE.

DATE COLLECTED. 01/31/91
DATE RECEIVED.. 01/31/91
COLLECTED BY... CL99

POINT NO: N8768
LOCATION: WELL #8

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TURBIDITY	<1 units	5.0
ZINC	<0.02 mg/l	5.0

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE.

DATE COLLECTED. 01/31/91
DATE RECEIVED.. 01/31/91
COLLECTED BY... CL99

POINT NO: N8768
LOCATION: WELL #8

REMARKS:

VOLATILE ORGANICS (METHOD 504) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
ETHYLENE DIBROMIDE	<0.02	5			
DIBROMOCHLOROPROPANE	<0.02	5			


- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

DATE EXTRACTED. 01/31/91
DATE RUN..... 02/06/91
DATE REPORTED.. 02/06/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE.DATE COLLECTED. 01/31/91
DATE RECEIVED.. 01/31/91
COLLECTED BY... CL99POINT NO: N8768
LOCATION: WELL #8

REMARKS:

PESTICIDES - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
LINDANE	<0.05	4			
HEPTACHLOR	<0.05	50			
ALDRIN	<0.05	50			
HEPTACHLOR EPOXIDE	<0.05	50			
DIELDRIN	<0.10	50			
ENDRIN	<0.10	0.2			
P,P'DDT	<0.10	50			
METHOXYCHLOR	<0.5	50			
TOXAPHENE	<1.0	5			
CHLORDANE	<0.5	50			
O,P DDT	<0.10	50			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

DATE EXTRACTED. 02/02/91
DATE RUN..... 02/05/91
DATE REPORTED.. 02/06/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE.

DATE COLLECTED. 01/31/91
DATE RECEIVED.. 01/31/91
COLLECTED BY... CL99

POINT NO: N8768
LOCATION: WELL #8

REMARKS:

HERBICIDES - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
2,4,-D	<0.2	50			
2,4,5-TP (SILVEX)	<0.05	10			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

DATE EXTRACTED. 02/26/91
DATE RUN..... 02/27/91
DATE REPORTED.. 03/04/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE.DATE COLLECTED. 01/31/91
DATE RECEIVED.. 01/31/91
COLLECTED BY... CL99POINT NO: N6078
LOCATION: WELL #9

REMARKS:


<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
ACIDITY	25.08 mg/l	
SILVER	<0.01 mg/l	0.05
ARSENIC	<10.0 ug/l	50.0
BARIUM	<0.20 mg/l	1.0
CALCIUM	23.0 mg/l	
CALCIUM HARDNESS	58 mg/l	
CADMIUM	<5 ug/l	10.0
CHLORIDE	21 mg/l	250
CO2	22 mg/l	
COLOR	<5 units	15
SPECIFIC CONDUCTIVITY	310 umhos	
CHROMIUM	<0.01 mg/l	0.05
COPPER	0.26 mg/l	1.0
FLUORIDE	<0.1 mg/l	2.2
IRON	0.05 mg/l	0.30
TOTAL HARDNESS	89 mg/l	
MERCURY	<0.2 ug/l	2.0
POTASSIUM	1.5 mg/l	
LANGLIER SATURATION INDEX	-3.95	
DETERGENTS (MBAS)	<0.04 mg/l	0.5
MAGNESIUM	7.8 mg/l	
MANGANESE	<0.02 mg/l	0.30
SODIUM	17.7 mg/l	
AMMONIA (NH3)	<0.02 mg/l	
NITRITE (AS N)	<0.1 mg/l	
* NITRATE (AS N)	*18.5 mg/l	10.0
ODOR	0 units	3
LEAD	<5.0 ug/l	50.0
PH	5.3 units	
SELENIUM	<5 ug/l	10.0
SULFATE	28.5 mg/l	250
TOTAL ALKALINITY	9.0 mg/l	
TOTAL SOLIDS	244 mg/l	

1 - Result(s) marked * exceed NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

FILE


LABORATORY DIRECTOR

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9102878

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE.

DATE COLLECTED. 01/31/91
DATE RECEIVED.. 01/31/91
COLLECTED BY... CL99

POINT NO: N6078
LOCATION: WELL #9

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY</u> <u>LIMIT</u>
TURBIDITY	<1 units	5.0
ZINC	0.06 mg/l	5.0

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

FILE


LABORATORY DIRECTOR

NYSDEC 000197

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE.

DATE COLLECTED. 01/31/91
DATE RECEIVED.. 01/31/91
COLLECTED BY... CL99

POINT NO: N6078
LOCATION: WELL #9

REMARKS:

VOLATILE ORGANICS (METHOD 504) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
ETHYLENE DIBROMIDE	<0.02	5			
DIBROMOCHLOROPROPANE	<0.02	5			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

DATE EXTRACTED. 01/31/91
DATE RUN..... 02/06/91
DATE REPORTED.. 02/06/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE.

DATE COLLECTED. 01/31/91
DATE RECEIVED.. 01/31/91
COLLECTED BY... CL99

POINT NO: N6078
LOCATION: WELL #9

REMARKS:

PESTICIDES - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
LINDANE	<0.05	4			
HEPTACHLOR	<0.05	50			
ALDRIN	<0.05	50			
HEPTACHLOR EPOXIDE	<0.05	50			
DIELDRIIN	<0.10	50			
ENDRIIN	<0.10	0.2			
P,P'DDT	<0.10	50			
METHOXYCHLOR	<0.5	50			
TOXAPHENE	<1.0	5			
CHLORDANE	<0.5	50			
O,P DDT	<0.10	50			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

DATE EXTRACTED. 02/02/91
DATE RUN..... 02/05/91
DATE REPORTED.. 02/06/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE.

DATE COLLECTED. 01/31/91
DATE RECEIVED.. 01/31/91
COLLECTED BY... CL99

POINT NO: N6078
LOCATION: WELL #9

REMARKS:

HERBICIDES - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
2,4,-D	<0.2	50			
2,4,5-TP (SILVEX)	<0.05	10			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

DATE EXTRACTED. 02/26/91
DATE RUN..... 02/27/91
DATE REPORTED.. 03/04/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 03/28/91
DATE RECEIVED.. 03/28/91
COLLECTED BY... CL99POINT NO: N6915
LOCATION: WELL #10

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

4th quarter compliance
- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 04/17/91

DATE RUN..... 03/28/91
DATE REPORTED.. 03/29/91
LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 03/28/91
DATE RECEIVED.. 03/28/91
COLLECTED BY... CL99POINT NO: N6915
LOCATION: WELL #10

REMARKS:


<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
ACIDITY	26	mg/l	
SILVER	<0.01	mg/l	0.05
ARSENIC	<10	ug/l	50.0
BARIUM	<0.20	mg/l	1.0
TOTAL COLIFORM BACT.	negative	-----	negative
E. COLI.	absent	-----	absent
CALCIUM	1.1	mg/l	
CALCIUM HARDNESS	2	mg/l	
CADMIUM	<5.0	ug/l	10.0
CHLORIDE	4	mg/l	250
CO2	23.1	mg/l	
COLOR	<5	units	15
SPECIFIC CONDUCTIVITY	50	umhos	
CHROMIUM	<0.01	mg/l	0.05
COPPER	<0.02	mg/l	1.0
FLUORIDE	<0.1	mg/l	2.2
* IRON	*0.79	mg/l	0.30
TOTAL HARDNESS	7	mg/l	
MERCURY	<0.2	ug/l	2.0
POTASSIUM	0.51	mg/l	
LANGLIER SATURATION INDEX	-5.68		
DETERGENTS (MBAS)	<0.04	mg/l	0.5
MAGNESIUM	0.44	mg/l	
MANGANESE	<0.02	mg/l	0.30
SODIUM	4.5	mg/l	
AMMONIA (NH3)	<0.02	mg/l	
NITRITE (AS N)	<0.1	mg/l	
NITRATE (AS N)	1.3	mg/l	10.0
ODOR	0	units	3
LEAD	<5	ug/l	50.0
PH	5.1	units	
SELENIUM	<5	ug/l	10.0
SULFATE	<5	mg/l	250

1 - Result(s) marked * exceed NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 04/17/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 03/28/91
DATE RECEIVED.. 03/28/91
COLLECTED BY... CL99

POINT NO: N6915
LOCATION: WELL #10

REMARKS:


<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
TOTAL ALKALINITY	3.0	mg/l	
TOTAL SOLIDS	18	mg/l	
TURBIDITY	1.0	units	5.0
ZINC	0.03	mg/l	5.0

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 04/17/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 03/28/91
DATE RECEIVED.. 03/28/91
COLLECTED BY... CL99

POINT NO: N6915
LOCATION: WELL #10

REMARKS:

VOLATILE ORGANICS (METHOD 504) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
ETHYLENE DIBROMIDE	<0.02	5			
DIBROMOCHLOROPROPANE	<0.02	5			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 04/17/91

DATE EXTRACTED. 04/01/91
DATE RUN..... 04/02/91
DATE REPORTED.. 04/03/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 03/28/91
DATE RECEIVED.. 03/28/91
COLLECTED BY... CL99POINT NO: N6915
LOCATION: WELL #10

REMARKS:

PESTICIDES - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
LINDANE	<0.05	4			
HEPTACHLOR	<0.05	50			
ALDRIN	<0.05	50			
HEPTACHLOR EPOXIDE	<0.05	50			
DIELDRIN	<0.10	50			
ENDRIN	<0.10	0.2			
P,P'DDT	<0.10	50			
METHOXYCHLOR	<0.5	50			
TOXAPHENE	<1.0	5			
CHLORDANE	<0.5	50			
O,P DDT	<0.10	50			


- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 04/17/91

DATE EXTRACTED. 04/01/91
DATE RUN..... 04/05/91
DATE REPORTED.. 04/05/91

FILE


LABORATORY DIRECTOR

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9109032

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 03/28/91
DATE RECEIVED.. 03/28/91
COLLECTED BY... CL99

POINT NO: N6915
LOCATION: WELL #10

REMARKS:

HERBICIDES - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
2,4,-D	<0.2	50			
2,4,5-TP (SILVEX)	<0.05	10			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 04/17/91

DATE EXTRACTED. 04/04/91
DATE RUN..... 04/05/91
DATE REPORTED.. 04/12/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 03/28/91
DATE RECEIVED.. 03/28/91
COLLECTED BY... CL99POINT NO: N6916
LOCATION: WELL #11

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	1.6	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	1.6	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water. *4th quarter annual*

COPIES TO: NCHD/JJM

DATE ISSUED 04/17/91

DATE RUN..... 03/28/91
DATE REPORTED.. 03/29/91
LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 03/28/91
DATE RECEIVED.. 03/28/91
COLLECTED BY... CL99POINT NO: N6916
LOCATION: WELL #11

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
ACIDITY	19	mg/l	
SILVER	<0.01	mg/l	0.05
ARSENIC	<10	ug/l	50.0
BARIUM	<0.20	mg/l	1.0
TOTAL COLIFORM BACT.	negative	-----	negative
E. COLI.	absent	-----	absent
CALCIUM	2.4	mg/l	
CALCIUM HARDNESS	5	mg/l	
CADMIUM	<5.0	ug/l	10.0
CHLORIDE	6	mg/l	250
CO2	17.5	mg/l	
COLOR	<5	units	15
SPECIFIC CONDUCTIVITY	70	umhos	
CHROMIUM	<0.01	mg/l	0.05
COPPER	<0.02	mg/l	1.0
FLUORIDE	<0.1	mg/l	2.2
IRON	0.11	mg/l	0.30
TOTAL HARDNESS	9	mg/l	
MERCURY	<0.2	ug/l	2.0
POTASSIUM	0.70	mg/l	
LANGLIER SATURATION INDEX	-4.52		
DETERGENTS (MBAS)	<0.04	mg/l	0.5
MAGNESIUM	0.76	mg/l	
MANGANESE	<0.02	mg/l	0.30
SODIUM	7.5	mg/l	
AMMONIA (NH3)	<0.02	mg/l	
NITRITE (AS N)	<0.1	mg/l	
NITRATE (AS N)	2.7	mg/l	10.0
ODOR	0	units	3
LEAD	<5	ug/l	50.0
PH	5.8	units	
SELENIUM	<5	ug/l	10.0
SULFATE	<5	mg/l	250

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 04/17/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 03/28/91
DATE RECEIVED.. 03/28/91
COLLECTED BY... CL99

POINT NO: N6916
LOCATION: WELL #11

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
TOTAL ALKALINITY	8.8	mg/l	
TOTAL SOLIDS	33	mg/l	
TURBIDITY	2.0	units	5.0
ZINC	<0.02	mg/l	5.0

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 04/17/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 03/28/91
DATE RECEIVED.. 03/28/91
COLLECTED BY... CL99

POINT NO: N6916
LOCATION: WELL #11

REMARKS:

VOLATILE ORGANICS (METHOD 504) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
ETHYLENE DIBROMIDE	<0.02	5			
DIBROMOCHLOROPROPANE	<0.02	5			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 04/17/91

DATE EXTRACTED. 04/01/91
DATE RUN..... 04/02/91
DATE REPORTED.. 04/03/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 03/28/91
DATE RECEIVED.. 03/28/91
COLLECTED BY... CL99

POINT NO: N6916
LOCATION: WELL #11

REMARKS:

PESTICIDES - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
LINDANE	<0.05	4			
HEPTACHLOR	<0.05	50			
ALDRIN	<0.05	50			
HEPTACHLOR EPOXIDE	<0.05	50			
DIELDRIN	<0.10	50			
ENDRIN	<0.10	0.2			
P,P' DDT	<0.10	50			
METHOXYCHLOR	<0.5	50			
TOXAPHENE	<1.0	5			
CHLORDANE	<0.5	50			
O,P DDT	<0.10	50			


- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 04/17/91

DATE EXTRACTED. 04/01/91
DATE RUN..... 04/05/91
DATE REPORTED.. 04/05/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 03/28/91
DATE RECEIVED.. 03/28/91
COLLECTED BY... CL99

POINT NO: N6916
LOCATION: WELL #11

REMARKS:

HERBICIDES - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
2,4,-D	<0.2	50			
2,4,5-TP (SILVEX)	<0.05	10			


- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 04/17/91

DATE EXTRACTED. 04/04/91
DATE RUN..... 04/05/91
DATE REPORTED.. 04/05/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE.DATE COLLECTED. 01/31/91
DATE RECEIVED.. 01/31/91
COLLECTED BY... CL99POINT NO:
LOCATION: WELL #BDG-1

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
ACIDITY	6.84	mg/l	
SILVER	<0.01	mg/l	0.05
ARSENIC	<10.0	ug/l	50.0
BARIUM	<0.20	mg/l	1.0
CALCIUM	0.86	mg/l	
CALCIUM HARDNESS	2	mg/l	
CADMIUM	<5	ug/l	10.0
CHLORIDE	3	mg/l	250
CO2	6	mg/l	
COLOR	<5	units	15
SPECIFIC CONDUCTIVITY	30	umhos	
CHROMIUM	<0.01	mg/l	0.05
COPPER	0.05	mg/l	1.0
FLUORIDE	<0.1	mg/l	2.2
IRON	0.16	mg/l	0.30
TOTAL HARDNESS	3	mg/l	
MERCURY	<0.2	ug/l	2.0
POTASSIUM	0.26	mg/l	
LANGLIER SATURATION INDEX	-5.47		
DETERGENTS (MBAS)	<0.04	mg/l	0.5
MAGNESIUM	0.30	mg/l	
MANGANESE	<0.02	mg/l	0.30
SODIUM	2.3	mg/l	
AMMONIA (NH3)	<0.02	mg/l	
NITRITE (AS N)	<0.1	mg/l	
NITRATE (AS N)	0.5	mg/l	10.0
ODOR	0	units	3
LEAD	<5.0	ug/l	50.0
PH	5.5	units	
SELENIUM	<5	ug/l	10.0
SULFATE	<5	mg/l	250
TOTAL ALKALINITY	4.5	mg/l	
TOTAL SOLIDS	29	mg/l	

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE.

DATE COLLECTED. 01/31/91
DATE RECEIVED.. 01/31/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL #BDG-1

REMARKS:


<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TURBIDITY	<1 units	5.0
ZINC	<0.02 mg/l	5.0

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE.

DATE COLLECTED. 01/31/91
DATE RECEIVED.. 01/31/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL #BDG-1

REMARKS:

VOLATILE ORGANICS (METHOD 504) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
ETHYLENE DIBROMIDE	<0.02	5			
DIBROMOCHLOROPROPANE	<0.02	5			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

DATE EXTRACTED. 01/31/91
DATE RUN..... 02/06/91
DATE REPORTED.. 02/06/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE.

DATE COLLECTED. 01/31/91
DATE RECEIVED.. 01/31/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL #BDG-1

REMARKS:

PESTICIDES - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
LINDANE	<0.05	4			
HEPTACHLOR	<0.05	50			
ALDRIN	<0.05	50			
HEPTACHLOR EPOXIDE	<0.05	50			
DIELDRIN	<0.10	50			
ENDRIN	<0.10	0.2			
P,P'DDT	<0.10	50			
METHOXYCHLOR	<0.5	50			
TOXAPHENE	<1.0	5			
CHLORDANE	<0.5	50			
O,P DDT	<0.10	50			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

DATE EXTRACTED. 02/02/91
DATE RUN..... 02/05/91
DATE REPORTED.. 02/06/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE.

DATE COLLECTED. 01/31/91
DATE RECEIVED.. 01/31/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL #BDG-1

REMARKS:

HERBICIDES - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
2,4,-D	<0.2	50			
2,4,5-TP (SILVEX)	<0.05	10			


- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 03/04/91

DATE EXTRACTED. 02/26/91
DATE RUN..... 02/27/91
DATE REPORTED.. 03/04/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 01/29/91
DATE RECEIVED.. 01/29/91
COLLECTED BY... CL99POINT NO: N8004
LOCATION: WELL #5-1

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 02/05/91

DATE RUN..... 02/01/91

DATE REPORTED.. 02/04/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 01/29/91
DATE RECEIVED.. 01/29/91
COLLECTED BY... CL99

POINT NO: N8004
LOCATION: WELL #5-1

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
TOTAL COLIFORM BACT.	negative	-----	negative
E. COLI.	absent	-----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 02/05/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 05/09/91
DATE RECEIVED.. 05/09/91
COLLECTED BY... CL99POINT NO: N8004
LOCATION: WELL #5-1

REMARKS:

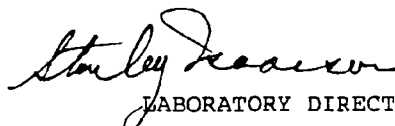
VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 05/28/91

DATE RUN..... 05/10/91
DATE REPORTED.. 05/24/91
LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 05/09/91
DATE RECEIVED.. 05/09/91
COLLECTED BY... CL99

POINT NO: N8004
LOCATION: WELL #5-1

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 05/28/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
 25 ADAMS AVENUE
 BETHPAGE, NY 11714

TYPE..... POTABLE WATER
 ROUTINE
 ORIGIN.... WELL
 WELL TYPE. RAW

DATE COLLECTED. 07/17/91
 DATE RECEIVED.. 07/17/91
 COLLECTED BY... CL99

POINT NO:
 LOCATION: WELL #5-1

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/22/91

DATE RUN..... 07/17/91
 DATE REPORTED.. 07/19/91


 LABORATORY DIRECTOR

FILE

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9121304

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 07/17/91
DATE RECEIVED.. 07/17/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL #5-1

REMARKS:


<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/22/91

FILE


LABORATORY DIRECTOR

NYSDEC 000223

BETHPAGE WATER DISTRICT
 25 ADAMS AVENUE
 BETHPAGE, NY 11714

TYPE..... POTABLE WATER
 ROUTINE
 ORIGIN.... WELL
 WELL TYPE. RAW

DATE COLLECTED. 10/08/91
 DATE RECEIVED.. 10/08/91
 COLLECTED BY... CL99

POINT NO:
 LOCATION: WELL #5-1

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 10/16/91

DATE RUN..... 10/11/91
 DATE REPORTED.. 10/14/91


 LABORATORY DIRECTOR

FILE

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9129411

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 10/08/91
DATE RECEIVED.. 10/08/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL #5-1

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 10/16/91

FILE


LABORATORY DIRECTOR

NYSDEC 000225

BETHPAGE WATER DISTRICT
 25 ADAMS AVENUE
 BETHPAGE, NY 11714

TYPE..... POTABLE WATER
 ROUTINE
 ORIGIN.... WELL
 WELL TYPE. RAW

DATE COLLECTED. 01/03/91
 DATE RECEIVED.. 01/03/91
 COLLECTED BY... CL99

POINT NO:
 LOCATION: 0-HRS.

REMARKS: AIR TOWER
 PL-6
 WELL #6-1

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	*8.6	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	*8.0	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	0.9	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	3.2	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	*120	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	*5.3	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

4 - Result(s) marked * exceed NEW YORK STATE limits for potable water.

COPIES TO: JJM

DATE ISSUED 01/08/91

DATE RUN..... 01/03/91
 DATE REPORTED.. 01/04/91


 LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 01/03/91
DATE RECEIVED.. 01/03/91
COLLECTED BY... CL99POINT NO:
LOCATION: 2-HRS.REMARKS: AIR TOWER
PL-6
WELL #6-1VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	*7.6	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	*8.0	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	0.8	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	3.0	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	*110	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	4.9	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

3 - Result(s) marked * exceed NEW YORK STATE limits for potable water.


COPIES TO: JJM

DATE ISSUED 01/08/91

DATE RUN..... 01/03/91

DATE REPORTED.. 01/04/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 01/03/91
DATE RECEIVED.. 01/03/91
COLLECTED BY... CL99POINT NO:
LOCATION: 3-HRS.REMARKS: AIR TOWER
PL-6
WELL #6-1VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	*10	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	*8.1	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	0.8	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	*5.3	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	*120	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	*5.4	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

5 - Result(s) marked * exceed NEW YORK STATE limits for potable water.

COPIES TO: JJM

DATE ISSUED 01/08/91

DATE RUN..... 01/03/91
DATE REPORTED.. 01/04/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 01/03/91
DATE RECEIVED.. 01/03/91
COLLECTED BY... CL99POINT NO:
LOCATION: RAW SAMPLEREMARKS: AIR TOWER
PL-6
WELL #6-1 @ 3-HRS.

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
ACIDITY	10.94	mg/l	
TOTAL COLIFORM BACT.	negative	-----	negative
E. COLI.	absent	-----	absent
CALCIUM	1.3	mg/l	
CALCIUM HARDNESS	3.25	mg/l	
CHLORIDE	8	mg/l	250
CO2	9.6	mg/l	
COLOR	<5	units	15
SPECIFIC CONDUCTIVITY	101	umhos	
COPPER	<0.02	mg/l	1.0
IRON	<0.02	mg/l	0.30
TOTAL HARDNESS	5.1	mg/l	
POTASSIUM	0.40	mg/l	
LANGLIER SATURATION INDEX	-5.67		
DETERGENTS (MBAS)	<0.04	mg/l	0.5
MAGNESIUM	0.44	mg/l	
MANGANESE	<0.02	mg/l	0.30
SODIUM	18.1	mg/l	
AMMONIA (NH3)	<0.02	mg/l	
NITRITE (AS N)	<0.1	mg/l	
NITRATE (AS N)	4.8	mg/l	10.0
ODOR	0	units	3
PH	5.3	units	
SULFATE	12	mg/l	250
TOTAL ALKALINITY	3	mg/l	
TOTAL SOLIDS	72	mg/l	
TURBIDITY	<1	units	5.0

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: JJM

DATE ISSUED 01/22/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 06/06/91
DATE RECEIVED.. 06/06/91
COLLECTED BY... CL99

POINT NO: N3876
LOCATION: WELL #6-1

REMARKS:


<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/11/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
 25 ADAMS AVENUE
 BETHPAGE, NY 11714

TYPE..... POTABLE WATER
 ROUTINE
 ORIGIN.... WELL
 WELL TYPE. RAW

DATE COLLECTED. 06/06/91
 DATE RECEIVED.. 06/06/91
 COLLECTED BY... CL99

POINT NO: N3876
 LOCATION: WELL #6-1

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	4.9	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	1.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	3.1	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	*200	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	*7.6	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

2 - Result(s) marked * exceed NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/11/91

DATE RUN..... 06/06/91
 DATE REPORTED.. 06/10/91


 LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 07/15/91
DATE RECEIVED.. 07/15/91
COLLECTED BY... CL99POINT NO:
LOCATION: 6-1

REMARKS: PL #6 AIR TOWER WELL

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	*12	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	4.2	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	1.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	0.7	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	2.7	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	*200	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	*8.0	5.0	TOTAL TRIHALOMETHANES	0.7	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

3 - Result(s) marked * exceed NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/18/91

DATE RUN..... 07/15/91
DATE REPORTED.. 07/16/91

FILE


LABORATORY DIRECTOR

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9121029

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 07/15/91
DATE RECEIVED.. 07/15/91
COLLECTED BY... CL99

POINT NO:
LOCATION: 6-1

REMARKS: PL #6 AIR TOWER WELL

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
TOTAL COLIFORM BACT.	negative	-----	negative
E. COLI.	absent	-----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/18/91

FILE


LABORATORY DIRECTOR

NYSDEC 000233

BETHPAGE WATER DISTRICT
 25 ADAMS AVENUE
 BETHPAGE, NY 11714

TYPE..... POTABLE WATER
 ROUTINE
 ORIGIN.... WELL
 WELL TYPE. RAW

DATE COLLECTED. 11/01/91
 DATE RECEIVED.. 11/01/91
 COLLECTED BY... CL99

POINT NO:
 LOCATION: WELL 6-1

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	3.8	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROENZENE	<0.5	5.0
1,1-DICHLOROETHENE	3.3	5.0	1,2,4-TRICHLOROENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	1.1	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	1.8	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	*120	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	*5.3	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

2 - Result(s) marked * exceed NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 11/07/91

DATE RUN..... 11/05/91

DATE REPORTED.. 11/06/91


 LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 11/01/91
DATE RECEIVED.. 11/01/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL 6-1

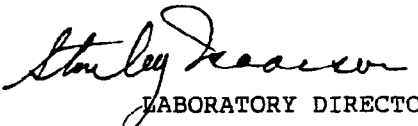
REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 11/04/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATEDDATE COLLECTED. 01/03/91
DATE RECEIVED.. 01/03/91
COLLECTED BY... CL99POINT NO:
LOCATION: 0-HRS.REMARKS: AIR TOWER
PL-6
WELL #6-1VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.


COPIES TO: JJM

DATE ISSUED 01/08/91

DATE RUN..... 01/03/91

DATE REPORTED.. 01/04/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATEDDATE COLLECTED. 01/03/91
DATE RECEIVED.. 01/03/91
COLLECTED BY... CL99POINT NO:
LOCATION: 2-HRS.REMARKS: AIR TOWER
PL-6
WELL #6-1VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.


COPIES TO: JJM

DATE ISSUED 01/08/91

DATE RUN..... 01/03/91

DATE REPORTED.. 01/04/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATEDDATE COLLECTED. 01/03/91
DATE RECEIVED.. 01/03/91
COLLECTED BY... CL99POINT NO:
LOCATION: 3-HRS.REMARKS: AIR TOWER
PL-6
WELL #6-1VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: JJM

DATE ISSUED 01/08/91

DATE RUN..... 01/03/91
DATE REPORTED.. 01/04/91
LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATEDDATE COLLECTED. 01/03/91
DATE RECEIVED.. 01/03/91
COLLECTED BY... CL99POINT NO:
LOCATION: TREATED SAMPLEREMARKS: AIR TOWER
PL-6
WELL #6-1 @ 3-HRS.

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
ACIDITY	2.62	mg/l	
TOTAL COLIFORM BACT.	negative	-----	negative
E. COLI.	absent	-----	absent
CALCIUM	1.3	mg/l	
CALCIUM HARDNESS	3.25	mg/l	
CHLORIDE	10	mg/l	250
CO2	2.3	mg/l	
COLOR	<5	units	15
SPECIFIC CONDUCTIVITY	97	umhos	
COPPER	0.02	mg/l	1.0
IRON	<0.02	mg/l	0.30
TOTAL HARDNESS	5.1	mg/l	
POTASSIUM	0.42	mg/l	
LANGLIER SATURATION INDEX	-4.17		
DETERGENTS (MBAS)	<0.04	mg/l	0.5
MAGNESIUM	0.45	mg/l	
MANGANESE	<0.02	mg/l	0.30
SODIUM	17.8	mg/l	
AMMONIA (NH3)	<0.02	mg/l	
NITRITE (AS N)	<0.1	mg/l	
NITRATE (AS N)	4.8	mg/l	10.0
ODOR	0	units	3
PH	6.8	units	
SULFATE	13.5	mg/l	250
TOTAL ALKALINITY	3	mg/l	
TOTAL SOLIDS	64	mg/l	
TURBIDITY	<1	units	5.0

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: JJM

DATE ISSUED 01/22/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATEDDATE COLLECTED. 06/06/91
DATE RECEIVED.. 06/06/91
COLLECTED BY... CL99POINT NO: N3876
LOCATION: WELL #6-1

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	0.7	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/11/91

DATE RUN..... 06/06/91
DATE REPORTED.. 06/10/91
LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATED

DATE COLLECTED. 06/06/91
DATE RECEIVED.. 06/06/91
COLLECTED BY... CL99

POINT NO: N3876
LOCATION: WELL #6-1

REMARKS:


<u>PARAMETER (S)</u>	<u>RESULTS</u> <u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/11/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
 25 ADAMS AVENUE
 BETHPAGE, NY 11714

TYPE..... POTABLE WATER
 ROUTINE
 ORIGIN.... WELL
 WELL TYPE. TREATED

DATE COLLECTED. 07/15/91
 DATE RECEIVED.. 07/15/91
 COLLECTED BY... CL99

POINT NO:
 LOCATION: 6-1

REMARKS: PL #6 AIR TOWER WELL

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	1.1	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/18/91

DATE RUN..... 07/15/91
 DATE REPORTED.. 07/16/91


 LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATED

DATE COLLECTED. 07/15/91
DATE RECEIVED.. 07/15/91
COLLECTED BY... CL99

POINT NO:
LOCATION: 6-1

REMARKS: PL #6 AIR TOWER WELL

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
TOTAL COLIFORM BACT.	negative	-----	negative
E. COLI.	absent	-----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/18/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATEDDATE COLLECTED. 11/01/91
DATE RECEIVED.. 11/01/91
COLLECTED BY... CL99POINT NO:
LOCATION: WELL 6-1

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 11/07/91

DATE RUN..... 11/05/91

DATE REPORTED.. 11/06/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATED

DATE COLLECTED. 11/01/91
DATE RECEIVED.. 11/01/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL 6-1


REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS</u> <u>UNITS</u>	NY <u>LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 11/04/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 01/08/91
DATE RECEIVED.. 01/08/91
COLLECTED BY... CL99POINT NO:
LOCATION: 0 HRS. (RAW)

REMARKS: AIR TOWER AT WELL #6-2

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 01/22/91

DATE RUN..... 01/11/91
DATE REPORTED.. 01/16/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 01/08/91
DATE RECEIVED.. 01/08/91
COLLECTED BY... CL99POINT NO:
LOCATION: 2 HRS. (RAW)

REMARKS: AIR TOWER AT WELL #6-2

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 01/22/91

DATE RUN..... 01/11/91

DATE REPORTED.. 01/16/91

FILE


LABORATORY DIRECTOR

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9100591

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 01/08/91
DATE RECEIVED.. 01/08/91
COLLECTED BY... CL99

POINT NO:
LOCATION: 3 HRS. (RAW)

REMARKS: AIR TOWER AT WELL #6-2


<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
CALCIUM	0.57 mg/l	
CALCIUM HARDNESS	1.42 mg/l	
CHLORIDE	15 mg/l	250
COLOR	<5 units	15
SPECIFIC CONDUCTIVITY	23 umhos	
COPPER	<0.02 mg/l	1.0
IRON	0.15 mg/l	0.30
TOTAL HARDNESS	2.45 mg/l	
POTASSIUM	<0.20 mg/l	
LANGLIER SATURATION INDEX	-5.42	
DETERGENTS (MBAS)	<0.04 mg/l	0.5
MAGNESIUM	0.25 mg/l	
MANGANESE	<0.02 mg/l	0.30
SODIUM	2.6 mg/l	
AMMONIA (NH3)	<0.02 mg/l	
NITRITE (AS N)	<0.1 mg/l	
NITRATE (AS N)	1.2 mg/l	10.0
ODOR	0 units	3
PH	5.7 units	
SULFATE	<5 mg/l	250
TOTAL ALKALINITY	4 mg/l	
TOTAL SOLIDS	21 mg/l	
TURBIDITY	<1 units	5.0

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 01/22/91

FILE


LABORATORY DIRECTOR

NYSDEC 000248

BETHPAGE WATER DISTRICT
 25 ADAMS AVENUE
 BETHPAGE, NY 11714

TYPE..... POTABLE WATER
 ROUTINE
 ORIGIN.... WELL
 WELL TYPE. RAW

DATE COLLECTED. 01/08/91
 DATE RECEIVED.. 01/08/91
 COLLECTED BY... CL99

POINT NO:
 LOCATION: 3 HRS. (RAW)

REMARKS: AIR TOWER AT WELL #6-2

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 01/22/91

DATE RUN..... 01/10/91
 DATE REPORTED.. 01/16/91


 LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 01/08/91
DATE RECEIVED.. 01/08/91
COLLECTED BY... CL99

POINT NO:
LOCATION: 0 HRS. (RAW)

REMARKS: AIR TOWER AT WELL #6-2

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	NY <u>LIMIT</u>
TOTAL COLIFORM BACT.	negative	-----	negative
E. COLI.	absent	-----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 01/22/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 06/06/91
DATE RECEIVED.. 06/06/91
COLLECTED BY... CL99POINT NO: N8941
LOCATION: WELL #6-2

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	0.6	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/11/91

DATE RUN..... 06/06/91

DATE REPORTED.. 06/10/91

FILE


LABORATORY DIRECTOR

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9117339

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 06/06/91
DATE RECEIVED.. 06/06/91
COLLECTED BY... CL99

POINT NO: N8941
LOCATION: WELL #6-2

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/11/91

FILE


LABORATORY DIRECTOR

NYSDEC 000252

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 10/08/91
DATE RECEIVED.. 10/08/91
COLLECTED BY... CL99POINT NO:
LOCATION: WELL BDG-1

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 10/16/91

DATE RUN..... 10/11/91
DATE REPORTED.. 10/14/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 01/29/91
DATE RECEIVED.. 01/29/91
COLLECTED BY... CL99

POINT NO:
LOCATION: BDG #1

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	NY <u>LIMIT</u>
TOTAL COLIFORM BACT.	negative	-----	negative
E. COLI.	absent	-----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 02/05/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 05/09/91
DATE RECEIVED.. 05/09/91
COLLECTED BY... CL99POINT NO:
LOCATION: BGD-1

REMARKS:


VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 05/28/91

DATE RUN..... 05/10/91
DATE REPORTED.. 05/24/91
LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 10/08/91
DATE RECEIVED.. 10/08/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL BDG-1

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 10/16/91

FILE


LABORATORY DIRECTOR

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9121303

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 07/17/91
DATE RECEIVED.. 07/17/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL BLDG. #1

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY</u> <u>LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/22/91

FILE


LABORATORY DIRECTOR

NYSDEC 000257

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 07/17/91
DATE RECEIVED.. 07/17/91
COLLECTED BY... CL99POINT NO:
LOCATION: WELL BLDG. #1

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/22/91

DATE RUN..... 07/17/91
DATE REPORTED.. 07/19/91
LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 05/09/91
DATE RECEIVED.. 05/09/91
COLLECTED BY... CL99

POINT NO:
LOCATION: BGD-1

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 05/28/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 10/08/91
DATE RECEIVED.. 10/08/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL #11

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 10/16/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 01/29/91
DATE RECEIVED.. 01/29/91
COLLECTED BY... CL99POINT NO:
LOCATION: BDG #1

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 02/05/91

DATE RUN..... 02/01/91

DATE REPORTED.. 02/04/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 05/09/91
DATE RECEIVED.. 05/09/91
COLLECTED BY... CL99

POINT NO: N6916
LOCATION: WELL #11

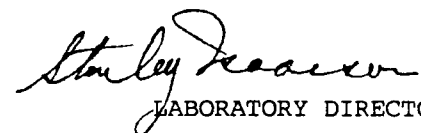
REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 05/28/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 07/17/91
DATE RECEIVED.. 07/17/91
COLLECTED BY... CL99POINT NO:
LOCATION: WELL #11

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			


- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/22/91

DATE RUN..... 07/17/91
DATE REPORTED.. 07/19/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 07/17/91
DATE RECEIVED.. 07/17/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL #11

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/22/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 10/08/91
DATE RECEIVED.. 10/08/91
COLLECTED BY... CL99POINT NO:
LOCATION: WELL #11

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 10/16/91

DATE RUN..... 10/11/91
DATE REPORTED.. 10/14/91
LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 07/17/91
DATE RECEIVED.. 07/17/91
COLLECTED BY... CL99POINT NO:
LOCATION: WELL #10

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			


- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/22/91

DATE RUN..... 07/17/91

DATE REPORTED.. 07/19/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 10/08/91
DATE RECEIVED.. 10/08/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL #10

REMARKS:


<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 10/16/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 05/09/91
DATE RECEIVED.. 05/09/91
COLLECTED BY... CL99POINT NO: N6916
LOCATION: WELL #11

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	TOLUENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,4-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,2-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	STYRENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	SEC-BUTYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	P-ISOPROPYLTOLUENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
TETRACHLOROETHENE	<0.5	5.0			
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 05/28/91

DATE RUN..... 05/10/91
DATE REPORTED.. 05/24/91
LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 10/08/91
DATE RECEIVED.. 10/08/91
COLLECTED BY... CL99POINT NO:
LOCATION: WELL #10

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 10/16/91

DATE RUN..... 10/11/91

DATE REPORTED.. 10/14/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 07/17/91
DATE RECEIVED.. 07/17/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL #10

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
TOTAL COLIFORM BACT.	negative	-----	negative
E. COLI.	absent	-----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/22/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 05/09/91
DATE RECEIVED.. 05/09/91
COLLECTED BY... CL99

POINT NO: N8768
LOCATION: WELL #8

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS</u> <u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 05/28/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 07/17/91
DATE RECEIVED.. 07/17/91
COLLECTED BY... CL99POINT NO:
LOCATION: WELL #8

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/22/91

DATE RUN..... 07/17/91
DATE REPORTED.. 07/19/91
LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 05/09/91
DATE RECEIVED.. 05/09/91
COLLECTED BY... CL99POINT NO: N8768
LOCATION: WELL #8

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 05/28/91

DATE RUN..... 05/10/91

DATE REPORTED.. 05/24/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 10/08/91
DATE RECEIVED.. 10/08/91
COLLECTED BY... CL99POINT NO:
LOCATION: WELL #7

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 10/16/91

DATE RUN..... 10/11/91

DATE REPORTED.. 10/14/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 01/29/91
DATE RECEIVED.. 01/29/91
COLLECTED BY... CL99

POINT NO: N8768
LOCATION: WELL #8

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
TOTAL COLIFORM BACT.	negative	-----	negative
E. COLI.	absent	-----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 02/05/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 01/29/91
DATE RECEIVED.. 01/29/91
COLLECTED BY... CL99POINT NO: N8768
LOCATION: WELL #8

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.


COPIES TO: NCHD/JJM/DMK

DATE ISSUED 02/05/91

DATE RUN..... 02/01/91

DATE REPORTED.. 02/04/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 10/08/91
DATE RECEIVED.. 10/08/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL #7

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 10/16/91

FILE


LABORATORY DIRECTOR

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9121306

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 07/17/91
DATE RECEIVED.. 07/17/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL #8

REMARKS:


<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/22/91

FILE


LABORATORY DIRECTOR

NYSDEC 000278

BETHPAGE WATER DISTRICT
 25 ADAMS AVENUE
 BETHPAGE, NY 11714

TYPE..... POTABLE WATER
 ROUTINE
 ORIGIN.... WELL
 WELL TYPE. RAW

DATE COLLECTED. 07/17/91
 DATE RECEIVED.. 07/17/91
 COLLECTED BY... CL99

POINT NO:
 LOCATION: WELL #7

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/22/91

DATE RUN..... 07/17/91
 DATE REPORTED.. 07/19/91


 LABORATORY DIRECTOR

FILE

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9121305

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 07/17/91
DATE RECEIVED.. 07/17/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL #7
REMARKS:


<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY</u> <u>LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/22/91

FILE


LABORATORY DIRECTOR

NYSDEC 000280

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 10/08/91
DATE RECEIVED.. 10/08/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL #8

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 10/16/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 10/08/91
DATE RECEIVED.. 10/08/91
COLLECTED BY... CL99POINT NO:
LOCATION: WELL #8

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 10/16/91

DATE RUN..... 10/11/91

DATE REPORTED.. 10/14/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 01/29/91
DATE RECEIVED.. 01/29/91
COLLECTED BY... CL99

POINT NO: N6078
LOCATION: WELL #9

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	NY <u>LIMIT</u>
TOTAL COLIFORM BACT.	negative	-----	negative
E. COLI.	absent	-----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 02/05/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 01/29/91
DATE RECEIVED.. 01/29/91
COLLECTED BY... CL99POINT NO: N6078
LOCATION: WELL #9

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	2.8	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	1.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	0.7	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 02/05/91

DATE RUN..... 02/01/91
DATE REPORTED.. 02/04/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 07/17/91
DATE RECEIVED.. 07/17/91
COLLECTED BY... CL99POINT NO:
LOCATION: WELL #9

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	3.0	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	1.6	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	1.0	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.


COPIES TO: NCHD/JJM

DATE ISSUED 07/22/91

DATE RUN..... 07/17/91

DATE REPORTED.. 07/19/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 07/17/91
DATE RECEIVED.. 07/17/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL #9

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS</u> <u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/22/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 10/08/91
DATE RECEIVED.. 10/08/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL #9

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 10/16/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE.
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 05/09/91
DATE RECEIVED.. 05/09/91
COLLECTED BY... CL99

POINT NO: N6078
LOCATION: WELL #9

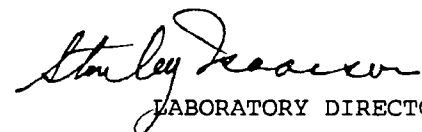
REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS</u> <u>UNITS</u>	NY <u>LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 05/28/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 05/09/91
DATE RECEIVED.. 05/09/91
COLLECTED BY... CL99POINT NO: N6078
LOCATION: WELL #9

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	2.7	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	0.9	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	0.7	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

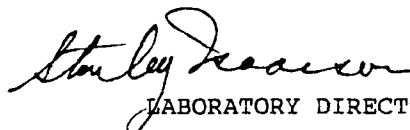
- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 05/28/91

DATE RUN..... 05/10/91

DATE REPORTED.. 05/24/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 10/08/91
DATE RECEIVED.. 10/08/91
COLLECTED BY... CL99POINT NO:
LOCATION: WELL #9

REMARKS:


VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	3.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	2.0	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	1.2	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 10/16/91

DATE RUN..... 10/11/91
DATE REPORTED.. 10/14/91
LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 07/15/91
DATE RECEIVED.. 07/15/91
COLLECTED BY... CL99POINT NO:
LOCATION: 6-2

REMARKS: PL #6 AIR TOWER WELL

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	0.8	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/18/91

DATE RUN..... 07/15/91
DATE REPORTED.. 07/16/91
LABORATORY DIRECTOR

FILE

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9121031

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 07/15/91
DATE RECEIVED.. 07/15/91
COLLECTED BY... CL99

POINT NO:
LOCATION: 6-2

REMARKS: PL #6 AIR TOWER WELL

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/18/91

FILE


LABORATORY DIRECTOR

NYSDEC 000292

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 11/01/91
DATE RECEIVED.. 11/01/91
COLLECTED BY... CL99POINT NO:
LOCATION: WELL 6-2

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 11/07/91

DATE RUN..... 11/05/91

DATE REPORTED.. 11/06/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 11/01/91
DATE RECEIVED.. 11/01/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL 6-2


REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 11/04/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATEDDATE COLLECTED. 01/08/91
DATE RECEIVED.. 01/08/91
COLLECTED BY... CL99POINT NO:
LOCATION: 0 HRS. (TREATED)

REMARKS: AIR TOWER AT WELL #6-2

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 01/22/91

DATE RUN..... 01/10/91
DATE REPORTED.. 01/16/91
LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATEDDATE COLLECTED. 01/08/91
DATE RECEIVED.. 01/08/91
COLLECTED BY... CL99POINT NO:
LOCATION: 2 HRS. (TREATED)

REMARKS: AIR TOWER AT WELL #6-2

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 01/22/91

DATE RUN..... 01/10/91

DATE REPORTED.. 01/16/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATED

DATE COLLECTED. 01/08/91
DATE RECEIVED.. 01/08/91
COLLECTED BY... CL99

POINT NO:
LOCATION: 3 HRS. (TREATED)

REMARKS: AIR TOWER AT WELL #6-2

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
CALCIUM	0.78	mg/l	
CALCIUM HARDNESS	1.95	mg/l	
CHLORIDE	6	mg/l	250
COLOR	<5	units	15
SPECIFIC CONDUCTIVITY	48	umhos	
COPPER	<0.02	mg/l	1.0
IRON	0.09	mg/l	0.30
TOTAL HARDNESS	3.18	mg/l	
POTASSIUM	<0.20	mg/l	
LANGLIER SATURATION INDEX	-4.38		
DETERGENTS (MBAS)	<0.04	mg/l	0.5
MAGNESIUM	0.30	mg/l	
MANGANESE	<0.02	mg/l	0.30
SODIUM	7.2	mg/l	
AMMONIA (NH3)	<0.02	mg/l	
NITRITE (AS N)	<0.1	mg/l	
NITRATE (AS N)	1.5	mg/l	10.0
ODOR	0	units	3
PH	6.6	units	
SULFATE	<5	mg/l	250
TOTAL ALKALINITY	4	mg/l	
TOTAL SOLIDS	46	mg/l	
TURBIDITY	<1	units	5.0

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 01/22/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
 25 ADAMS AVENUE
 BETHPAGE, NY 11714

TYPE..... POTABLE WATER
 ROUTINE
 ORIGIN.... WELL
 WELL TYPE. TREATED

DATE COLLECTED. 01/08/91
 DATE RECEIVED.. 01/08/91
 COLLECTED BY... CL99

POINT NO:
 LOCATION: 3 HRS. (TREATED)

REMARKS: AIR TOWER AT WELL #6-2

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 01/22/91

DATE RUN..... 01/10/91
 DATE REPORTED.. 01/16/91


 LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATED

DATE COLLECTED. 01/08/91
DATE RECEIVED.. 01/08/91
COLLECTED BY... CL99

POINT NO:
LOCATION: 0 HRS. (TREATED)

REMARKS: AIR TOWER AT WELL #6-2

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
TOTAL COLIFORM BACT.	negative	-----	negative
E. COLI.	absent	-----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 01/22/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATEDDATE COLLECTED. 06/06/91
DATE RECEIVED.. 06/06/91
COLLECTED BY... CL99POINT NO: N8941
LOCATION: WELL #6-2

REMARKS:


VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/11/91

DATE RUN..... 06/06/91
DATE REPORTED.. 06/10/91
LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATED

DATE COLLECTED. 06/06/91
DATE RECEIVED.. 06/06/91
COLLECTED BY... CL99

POINT NO: N8941
LOCATION: WELL #6-2

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 06/11/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
 25 ADAMS AVENUE
 BETHPAGE, NY 11714

TYPE..... POTABLE WATER
 ROUTINE
 ORIGIN.... WELL
 WELL TYPE. TREATED

DATE COLLECTED. 07/15/91
 DATE RECEIVED.. 07/15/91
 COLLECTED BY... CL99

POINT NO:
 LOCATION: 6-2

REMARKS: PL #6 AIR TOWER WELL

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/18/91

DATE RUN..... 07/15/91
 DATE REPORTED.. 07/16/91


 LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATED

DATE COLLECTED. 07/15/91
DATE RECEIVED.. 07/15/91
COLLECTED BY... CL99

POINT NO:
LOCATION: 6-2

REMARKS: PL #6 AIR TOWER WELL

<u>PARAMETER (S)</u>	<u>RESULTS</u> <u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 07/18/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATEDDATE COLLECTED. 11/01/91
DATE RECEIVED.. 11/01/91
COLLECTED BY... CL99POINT NO:
LOCATION: WELL 6-2

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 11/07/91

DATE RUN..... 11/05/91
DATE REPORTED.. 11/06/91

FILE


LABORATORY DIRECTOR

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. TREATED

DATE COLLECTED. 11/01/91
DATE RECEIVED.. 11/01/91
COLLECTED BY... CL99

POINT NO:
LOCATION: WELL 6-2


REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS</u> <u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 11/04/91


LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 01/29/91
DATE RECEIVED.. 01/29/91
COLLECTED BY... CL99POINT NO: N8767
LOCATION: WELL #7

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.


COPIES TO: NCHD/JJM/DMK

DATE ISSUED 02/05/91

DATE RUN..... 02/01/91

DATE REPORTED.. 02/04/91

FILE


LABORATORY DIRECTOR

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9102619

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 01/29/91
DATE RECEIVED.. 01/29/91
COLLECTED BY... CL99

POINT NO: N8767
LOCATION: WELL #7

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS</u>	<u>UNITS</u>	<u>NY</u> <u>LIMIT</u>
TOTAL COLIFORM BACT.	negative	-----	negative
E. COLI.	absent	-----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM/DMK

DATE ISSUED 02/05/91

FILE


LABORATORY DIRECTOR

NYSDEC 000307

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAWDATE COLLECTED. 05/09/91
DATE RECEIVED.. 05/09/91
COLLECTED BY... CL99POINT NO: N8767
LOCATION: WELL #7

REMARKS:

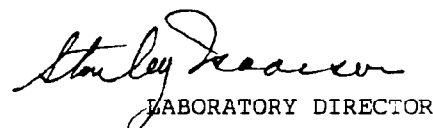
VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 05/28/91

DATE RUN..... 05/10/91
DATE REPORTED.. 05/24/91
LABORATORY DIRECTOR

FILE

H2M LABS, INC.

575 Broad Hollow Road, Melville, N.Y. 11747
(516)694-3040 FAX:(516)694-4122

LAB NO: 9114643

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 05/09/91
DATE RECEIVED.. 05/09/91
COLLECTED BY... CL99

POINT NO: N8767
LOCATION: WELL #7

REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 05/28/91


LABORATORY DIRECTOR

FILE

NYSDEC 000309

BETHPAGE WATER DISTRICT
 25 ADAMS AVENUE
 BETHPAGE, NY 11714

TYPE..... POTABLE WATER
 ROUTINE
 ORIGIN.... WELL
 WELL TYPE. RAW

DATE COLLECTED. 05/09/91
 DATE RECEIVED.. 05/09/91
 COLLECTED BY... CL99

POINT NO: N6915
 LOCATION: WELL #10

REMARKS:

VOLATILE ORGANICS (METHOD 502.2) - (ug/l)

<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>	<u>PARAMETER (S)</u>	<u>RESULT</u>	<u>LIMIT</u>
DICHLORODIFLUOROMETHANE	<0.5	5.0	1,2,3-TRICHLOROPROPANE	<0.5	5.0
CHLOROMETHANE	<0.5	5.0	O-CHLOROTOLUENE	<0.5	5.0
VINYL CHLORIDE	<0.5	2.0	P-CHLOROTOLUENE	<0.5	5.0
BROMOMETHANE	<0.5	5.0	M-DICHLOROBENZENE	<0.5	5.0
CHLOROETHANE	<0.5	5.0	P-DICHLOROBENZENE	<0.5	5.0
FLUOROTRICHLOROMETHANE	<0.5	5.0	O-DICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHENE	<0.5	5.0	1,2,4-TRICHLOROBENZENE	<0.5	5.0
METHYLENE CHLORIDE	<0.5	5.0	HEXACHLOROBUTADIENE	<0.5	5.0
TRANS-1,2-DICHLOROETHENE	<0.5	5.0	1,2,3-TRICHLOROBENZENE	<0.5	5.0
1,1-DICHLOROETHANE	<0.5	5.0	BENZENE	<0.5	5.0
CIS-1,2-DICHLOROETHENE	<0.5	5.0	TOLUENE	<0.5	5.0
2,2-DICHLOROPROPANE	<0.5	5.0	ETHYLBENZENE	<0.5	5.0
BROMOCHLOROMETHANE	<0.5	5.0	1,3-XYLENE	<0.5	5.0
CHLOROFORM	<0.5	100	1,4-XYLENE	<0.5	5.0
1,1,1-TRICHLOROETHANE	<0.5	5.0	1,2-XYLENE	<0.5	5.0
CARBON TETRACHLORIDE	<0.5	5.0	STYRENE	<0.5	5.0
1,1-DICHLOROPROPENE	<0.5	5.0	ISOPROPYLBENZENE (CUMENE)	<0.5	5.0
1,2-DICHLOROETHANE	<0.5	5.0	N-PROPYLBENZENE	<0.5	5.0
TRICHLOROETHENE	<0.5	5.0	1,3,5-TRIMETHYLBENZENE	<0.5	5.0
1,2-DICHLOROPROPANE	<0.5	5.0	TERT-BUTYLBENZENE	<0.5	5.0
DIBROMOMETHANE	<0.5	5.0	1,2,4-TRIMETHYLBENZENE	<0.5	5.0
BROMODICHLOROMETHANE	<0.5	100	SEC-BUTYLBENZENE	<0.5	5.0
TRANS-1,3-DICHLOROPROPENE	<0.5	5.0	P-ISOPROPYLTOLUENE	<0.5	5.0
CIS-1,3-DICHLOROPROPENE	<0.5	5.0	N-BUTYLBENZENE	<0.5	5.0
1,1,2-TRICHLOROETHANE	<0.5	5.0	NAPHTHALENE	<0.5	5.0
TETRACHLOROETHENE	<0.5	5.0	TOTAL TRIHALOMETHANES	<0.5	100
1,3-DICHLOROPROPANE	<0.5	5.0			
CHLORODIBROMOMETHANE	<0.5	100			
CHLOROBENZENE	<0.5	5.0			
1,1,1,2-TETRACHLOROETHANE	<0.5	5.0			
BROMOFORM	<0.5	100			
BROMOBENZENE	<0.5	5.0			
1,1,2,2-TETRACHLOROETHANE	<0.5	5.0			

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 05/28/91

DATE RUN..... 05/10/91
 DATE REPORTED.. 05/24/91

Stanley Isaacson
 LABORATORY DIRECTOR

FILE

BETHPAGE WATER DISTRICT
25 ADAMS AVENUE
BETHPAGE, NY 11714

TYPE..... POTABLE WATER
ROUTINE
ORIGIN.... WELL
WELL TYPE. RAW

DATE COLLECTED. 05/09/91
DATE RECEIVED.. 05/09/91
COLLECTED BY... CL99

POINT NO: N6915
LOCATION: WELL #10


REMARKS:

<u>PARAMETER (S)</u>	<u>RESULTS UNITS</u>	<u>NY LIMIT</u>
TOTAL COLIFORM BACT.	negative -----	negative
E. COLI.	absent -----	absent

- Result(s) Reported meet NEW YORK STATE limits for potable water.

COPIES TO: NCHD/JJM

DATE ISSUED 05/28/91


LABORATORY DIRECTOR

FILE