



Infrastructure, environment, facilities

Imagine the result

2006 Annual Groundwater Monitoring Report

Operable Unit 2


Northrop Grumman Systems Corporation

Bethpage, New York

NYSDEC Site #s 1-30-0003A & B

August 20, 2007


ARCADIS



David E. Stern
Senior Hydrogeologist



Carlo San Giovanni
Project Manager



Michael F. Wolfert
Hydrogeologist/Project Director

**2006 Annual Groundwater
Monitoring Report**

Operable Unit 2
Northrop Grumman Systems
Corporation,
Bethpage, New York
NYSDEC Site #s 1-30-0003A&B

Prepared for:
Northrop Grumman Systems Corporation

Prepared by:
ARCADIS of New York, Inc.
Two Huntington Quadrangle
Suite 1S10
Melville
New York 11747
Tel 631.249.7600
Fax 631.249.7610

Our Ref.:
NY001464.0407.00004

Date:
August 20, 2007

This document is intended only for the use of the individual or entity for which it was prepared and may contain information that is privileged, confidential and exempt from disclosure under applicable law. Any dissemination, distribution or copying of this document is strictly prohibited.

1. Introduction	1
2. Monitoring Program	1
3. Remedial System Performance Monitoring	2
3.1 Water Quality, Treatment Efficiencies, and Mass Removal	3
3.2 Remedial System Pumpage and Discharge	4
3.3 Troubleshooting/Maintenance Activities	4
4. Groundwater Flow	5
5. Groundwater Quality	5
5.1 Volatile Organic Compounds	5
5.1.1 Shallow Zone	6
5.1.2 Intermediate Zone	6
5.1.3 Deep Zone	6
5.1.4 Deep2 Zone and Remedial Wells	8
5.2 Outpost Monitoring	9
5.3 Vinyl Chloride Monomer	9
5.4 Cadmium and Chromium	9
5.5 Tentatively Identified Compounds	10
5.6 QA/QC Samples and Data Validation	10
6. Annual Groundwater Model Update Evaluation	10
6.1 Purpose of the Evaluation	11
6.2 Pumpage Update	11
6.3 Mass Update	11
6.4 Results	12
7. Summary and Conclusions	13
8. Recommendation	14

9. References

15

Tables

Table 1 Summary of Operational Data and Water Balance for the On-Site Portion of the OU2 Groundwater Remedy, Fourth Quarter 2006 and Year 2006, Northrop Grumman Systems Corporation, Bethpage, New York.

Table 2 Concentrations of Volatile Organic Compounds Detected In Intermediate Wells, Fourth Quarter 2006, Operable Unit 2, Northrop Grumman Systems Corporation, Bethpage, New York.

Table 3 Concentrations of Volatile Organic Compounds Detected In Deep Wells, Fourth Quarter 2006, Operable Unit 2, Northrop Grumman Systems Corporation, Bethpage, New York.

Table 4 Concentrations of Volatile Organic Compounds Detected In Deep2 Monitoring Wells and Groundwater Remedial Wells and Treatment Systems, Fourth Quarter 2006, Operable Unit 2, Northrop Grumman Systems Corporation, Bethpage, New York.

Table 5 Concentrations of Site-Related Volatile Organic Compounds Detected In Outpost Wells, Fourth Quarter 2006, Operable Unit 2, Northrop Grumman Systems Corporation, Bethpage, New York.

Table 6 Concentrations of Volatile Organic Compounds Detected in Blank Samples, Fourth Quarter 2006, Operable Unit 2, Northrop Grumman Systems Corporation, Bethpage, New York.

Figures

Figure 1 Locations of OU2 On-Site Groundwater Remedy and Wells, Northrop Grumman Systems Corporation, Bethpage, New York.

Figure 2 Total Volatile Organic Compound Concentrations (Southern and Southwestern Site Boundary) in OU2 Remedial Wells and Monitoring Wells GM-33D2 and GM-73D2, Northrop Grumman Systems Corporation, Bethpage, New York.

Figure 3 Total Volatile Organic Compound Concentrations (Southeastern Site Boundary) in On-Site Deep and Deep2 Monitoring Wells and OU2 Remedial Wells 18 and 19, Northrop Grumman Systems Corporation, Bethpage, New York.

Figure 4 Total Volatile Organic Compound Concentrations in On-Site Intermediate and Deep Monitoring Wells, Northrop Grumman Systems Corporation, Bethpage, New York.

Figure 5 Total Volatile Organic Compound Concentrations in Off-Site Deep Monitoring Wells (Southeast of the Site), Northrop Grumman Systems Corporation, Bethpage, New York.

Figure 6 Total Volatile Organic Compound Concentrations in Off-Site Deep2 Monitoring Wells (Southeast of the Site), Northrop Grumman Systems Corporation, Bethpage, New York.

Figure 7 Total Volatile Organic Compound Concentrations in Off-Site Deep and Deep2 Monitoring Wells (South of the Site), Northrop Grumman Systems Corporation, Bethpage, New York.

Figure 8 Total Volatile Organic Compound Concentrations in GM-38 Area Deep and Deep2 Monitoring Wells, Northrop Grumman Systems Corporation, Bethpage, New York.

Figure 9 Total Volatile Organic Compound Concentrations in Outpost Wells, Northrop Grumman Systems Corporation, Bethpage, New York.

Figure 10 Total Cadmium Concentrations in Monitoring Wells Near Former Plant 2, Northrop Grumman Systems Corporation, Bethpage, New York.

Figure 11 Total Chromium Concentrations in Monitoring Wells Near Former Plant 2, Northrop Grumman Systems Corporation, Bethpage, New York.

Figure 12 Total Chromium Concentrations in Monitoring Wells Near Former Plant 1, Northrop Grumman Systems Corporation, Bethpage, New York.

Appendix

A Groundwater Sampling Logs and Chain of Custody Records

Operable Unit 2
Northrop Grumman Systems
Corporation,
Bethpage, New York
NYSDEC Site #s 1-30-0003A
& B

1. Introduction

This groundwater monitoring report was prepared to document the operation, maintenance, and monitoring (OM&M) activities for the Operable Unit 2 (OU2) groundwater remedy at the Northrop Grumman Systems Corporation (Northrop Grumman) Bethpage, New York facility. These activities are currently being conducted by Northrop Grumman, in accordance with the New York State Department of Environmental Conservation (NYSDEC)-approved OU2 Groundwater Monitoring Plan (ARCADIS Geraghty & Miller, Inc. 2001), as modified in June 2006 (ARCADIS G&M, Inc. 2006) and the Public Water Supply Contingency Plan (PWSCP) (ARCADIS G&M Inc. 2003b) collectively to meet the remedial objectives set forth in the March 2001 OU2 Record of Decision (ROD) (NYSDEC 2001).

This report describes the performance and effectiveness monitoring of the on-site portion of the OU2 groundwater remedy for the period from October 12, 2006 through December 28, 2006, which is referred to in this report as the Fourth Quarter 2006 report period, or the current period. This report also constitutes the 2006 Annual Report, and compares the current data to Year 2005 and to longer-term data trends, as applicable.

The monitoring program, as well as the findings, conclusions, and recommendations will be re-evaluated, as additional data become available. The complete description of the on-site portion of the OU2 groundwater remedy, the monitoring program, and rationale/basis for collection and evaluation of data can be found in the NYSDEC-approved OU2 Groundwater Monitoring Plan (ARCADIS Geraghty & Miller, Inc. 2001), as modified in June 2006 (ARCADIS G&M, Inc. 2006) and the PWSCP (ARCADIS G&M Inc. 2003b).

This report also includes the status of the annual update to the NYSDEC-accepted regional groundwater model, as required by the PWSCP.

2. Monitoring Program

The results obtained from monitoring activities conducted during this reporting period are provided in Tables 1 through 6 and are described and discussed in the following report sections: Remedial System Operational Performance (Section 3), Groundwater Flow (Section 4), and Groundwater Quality (Section 5).

Operable Unit 2
Northrop Grumman Systems
Corporation,
Bethpage, New York
NYSDEC Site #s 1-30-0003A
& B

Except as described in Tables 1 through 6 and in Sections 3, 4, and 5 of this report, the procedures, methodologies, and monitoring network utilized for the subject period are consistent with procedures and methodologies used previously (ARCADIS Geraghty & Miller, Inc. 2001; ARCADIS G&M, Inc. 2003a). The complete description of the procedures to collect groundwater samples from outpost wells and evaluate and document the results is provided in the PWSCP (ARCADIS G&M, Inc. 2003b).

The locations of the Northrop Grumman site, the OU2 on-site groundwater remedy, the neighboring properties (i.e., the Naval Weapons Industrial Reserve Plant [NWIRP] and Occidental Chemical Corporation [OCC]/RUCO Polymer Corporation sites), and existing wells utilized in the monitoring programs are shown on Figure 1. Appendix A of this report contains the field documentation for monitoring activities performed by ARCADIS (i.e., groundwater sampling logs and chain-of-custody records).

3. Remedial System Performance Monitoring

This report section summarizes the routine performance monitoring conducted during the Fourth Quarter 2006 and Year 2006 for the on-site portion of the OU2 groundwater remedy, which included the following: (1) remedial well water quality monitoring, remedial treatment system effluent water quality monitoring, remedial treatment system efficiency monitoring, and determination of volatile organic compound (VOC) mass removal, and (2) monitoring of remedial well pumpage and remedial treatment system treated effluent discharge to on-site recharge basins.

Also summarized in this report section are the remedial treatment system and remedial well troubleshooting as well as non-routine maintenance activities performed by ARCADIS and Northrop Grumman during the Fourth Quarter 2006.

As stated in previous reports, the on-site remedial wells and remedial treatment systems will be referred to by names that are consistent with Northrop Grumman nomenclature, as summarized in the following table. All monitoring activities will utilize the revised nomenclature.

Operable Unit 2
Northrop Grumman Systems
Corporation,
Bethpage, New York
NYSDEC Site #s 1-30-0003A
& B

Former Nomenclature	Revised Nomenclature
Remedial Wells	
GP-1	Well 1
GP-3	Well 3
ONCT-1	Well 17
ONCT-2	Well 18
ONCT-3	Well 19
Remedial Treatment Systems	
GP-1	Tower 96
ONCT	Tower 102

3.1 Water Quality, Treatment Efficiencies, and Mass Removal

Tables 1 and 4 provide the total VOC (TVOC) concentrations detected in the remedial wells. Table 1 provides TVOC concentrations and VOC mass removed by the remedial wells for the current period and Year 2006, and treatment efficiencies for the Tower 96 and Tower 102 remedial treatment system air strippers for the current period.

TVOC concentrations from the remedial wells ranged from 158 micrograms per liter ($\mu\text{g/L}$) (Well 18) to 3,752 $\mu\text{g/L}$ (Well 3) this period. The discussion of water quality data and trends for the remedial wells is provided in Section 5.1.4 of this report.

A total of approximately 3,076 pounds of VOCs were removed from the aquifer by the remedial wells and treated during the current period. For Year 2006, approximately 14,764 lbs of VOC mass were removed from the aquifer and treated by the OU2 remedial systems. Since full-time remedial system startup in November 1998, approximately 107,041 lbs of VOCs have been removed from the aquifer and treated by the OU2 remedial system.

Northrop Grumman's State Pollutant Discharge Elimination System (SPDES) discharge monitoring results (Permit No. NY0096792) are representative of treated water quality and are used in calculating remedial system treatment efficiency and determining the quality of water returned to the aquifer. SPDES discharge monitoring data are documented on a monthly basis by Northrop Grumman to NYSDEC under separate cover in Discharge Monitoring Reports (DMRs). Northrop Grumman Outfalls

Operable Unit 2
Northrop Grumman Systems
Corporation,
Bethpage, New York
NYSDEC Site #s 1-30-0003A
& B

005 and 006 represent the termini of the Tower 102 and Tower 96 systems effluent water (i.e., inlets to the South Recharge Basins and West Recharge Basins) respectively. Based on VOC concentrations in the remedial wells and the SPDES discharge this period, the efficiencies of the Tower 96 and Tower 102 remedial treatment systems for the current period were calculated to be 99.9 percent and 99.2 percent, respectively.

3.2 Remedial System Pumpage and Discharge

Table 1 summarizes the remedial well pumpage (with comparison to design criteria) for the current period and Year 2006. For the current period, Remedial Wells 1, 3, 17, 18, and 19 collectively pumped approximately 406 million gallons (MG) of groundwater, which is equivalent to approximately 95 percent of the design remedial well pumpage volume (427 MG) for the current period. For Year 2006, the remedial system pumped approximately 1,869 MG, equivalent to approximately 93 percent of the total design remedial well pumpage volume of 2,008 MG.

Based on measurements collected by ARCADIS, the South Recharge Basins collectively received the treated effluent discharge from the Tower 102 remedial treatment system along with incidental stormwater runoff and contribution from the Tower 96 remedial system for a total average of approximately 2,588 gpm, equivalent to 251 MG, during the current period.

As discussed in previous reports, a portion of the treated water from the Tower 96 remedial treatment system is provided on demand to the Calpine Energy facility for consumptive use. The demand rate is controlled by a "Cia-Val" located within a new subsurface transmission pipeline between Tower 96 and the Calpine Energy facility. Based on Raw Water Consumption information provided by Calpine Energy to ARCADIS in June 2007, the weighted average facility demand by Calpine for this period was 295 gpm, indicating that the West Recharge Basins received an average discharge rate from the Tower 96 remedial system of approximately 758 gpm this period, equivalent to 46 MG.

3.3 Troubleshooting/Maintenance Activities

Based on water-level and pumping data presented in prior reports, OU2 remedial well specific capacities remain above the minimum required to sustain the design pumping rates, as such no additional maintenance was needed on remedial wells this period (ARCADIS of New York, Inc. 2007a; b).

Operable Unit 2
Northrop Grumman Systems
Corporation,
Bethpage, New York
NYSDEC Site #s 1-30-0003A
& B

During the Fourth Quarter 2006, the Tower 96 remedial system was shut down for 31.5 hours between October 25 and October 27 for the replacement of two sluice gates on the stormwater system which transmits treated water to the West Recharge Basins. Other, minor short-term repairs, testing of new component systems, and temporary power outages were also noted during this period.

4. Groundwater Flow

Hydraulic monitoring was performed semi-annually in the Year 2006, in March 22 and September 8. The hydraulic monitoring results are described in prior quarterly reports (ARCADIS of New York, Inc. 2007a; b).

In general, the hydraulic monitoring data collected in Year 2006 indicated that vertical hydraulic gradients in the shallow-intermediate wells pairs are oriented downward and are close to or greater than model predicted values. Mounding of the water table and potentiometric surface exists in the shallow and intermediate zones, respectively, extending beneath the South Recharge Basins and across the Northrop Grumman site southern boundary. Downward vertical gradients were also present in the intermediate-deep and deep-deep2 well pairs, supporting the conclusion that groundwater is flowing in a predominantly vertical direction in the deep zone along the Northrop Grumman site southern boundary. Data obtained in Year 2006 indicates that the combination of shallow recharge at the South Recharge Basins coupled with pumpage of the remedial wells in the D2 zone forms a hydraulic barrier to groundwater flow that is preventing the off-site migration of VOC-impacted groundwater. The capture zone formed by the combined pumpage of OU2 remedial wells extended approximately 800 feet down gradient of Well 17.

5. Groundwater Quality

This report section describes the analytical results of the various groundwater quality monitoring activities for the Fourth Quarter 2006 that are specified in the NYSDEC-approved Groundwater Monitoring Plan (ARCADIS G&M, Inc., 2001; ARCADIS G&M, Inc. 2006) and the PWSCP (ARCADIS G&M Inc., 2003b). Analytical results are summarized in Tables 2 through 6.

5.1 Volatile Organic Compounds

The evaluation of VOC concentrations is presented herein in consideration of the following factors: (1) proximity to the hydraulic barrier formed by the on-site portion of

Operable Unit 2
Northrop Grumman Systems
Corporation,
Bethpage, New York
NYSDEC Site #s 1-30-0003A
& B

the OU2 groundwater remedy (i.e., upgradient, along the Northrop Grumman site southern boundary, and downgradient of the hydraulic barrier), (2) hydrogeologic zone (i.e., shallow, intermediate, deep, and D2 zones), and (3) NYSDEC Standards, Criteria, and Guidance Values.

Tables 2 through 6 provide the complete analytical results of samples collected for VOC analysis from monitoring wells, remedial wells, outpost wells, and remedial treatment systems for this period. Time-concentration graphs depicting the long-term VOC concentration trends are shown on Figures 2 through 9.

5.1.1 Shallow Zone

The detailed results of monitoring in the shallow zone are provided in prior reports (ARCADIS of New York, Inc. 2007a; b). In summary, few detections of VOCs in shallow monitoring wells were identified in wells located upgradient of the Northrop Grumman site southern boundary and no detections were identified in wells located immediately downgradient of the Northrop Grumman site southern boundary. These data collectively support the conclusion that the hydraulic barrier formed by the on-site portion of the OU2 Groundwater Remedy remains effective in preventing the off-site migration of VOC-impacted groundwater in the shallow zone.

5.1.2 Intermediate Zone

Analytical data for intermediate monitoring wells is provided in Table 2. Intermediate wells sampled during this period (GM-20I, GM-21I, and GM-79I) are located immediately downgradient of the Northrop Grumman site southern boundary.

Laboratory results indicated no exceedences of SCGs along the Northrop Grumman site southern boundary during this period or Year 2006. These analytical results are consistent with data obtained since the start-up of the OU2 Groundwater Remedy in November 1998 (or for the period of record, for wells monitored prior to November 1998), confirming that the operation of the on-site portion of the OU2 groundwater remedy has formed an effective hydraulic barrier that prevents the off-site migration of VOC-impacted groundwater in the intermediate zone.

5.1.3 Deep Zone

Groundwater monitoring data from the deep zone is summarized in Table 3 and data trends are selectively shown in Figures 3, 4, 5, 7 and 8. Attached data trend graphs

Operable Unit 2
Northrop Grumman Systems
Corporation,
Bethpage, New York
NYSDEC Site #s 1-30-0003A
& B

include key wells with detectable concentrations of VOCs that were sampled this period.

Well GM-13D, located upgradient of the OU2 Groundwater Remedy, continued to exhibit a downward trend in TVOC concentrations, with recent results indicating a decrease in TVOC concentrations by more than 50 percent since 1999 (Figure 4).

Four deep wells (i.e., GM-18D, GM-39D_A, GM-39D_B, and GM-73D) located on-site, along the Northrop Grumman site southern boundary, and upgradient of the remedial wells (Figure 1), exhibited SCG exceedences in the Year 2006. These monitoring wells are within the capture zone of the remedial wells, therefore, groundwater in this area is hydraulically contained and over time will be extracted and treated.

Groundwater quality data from wells immediately downgradient of the Northrop Grumman site (Monitoring Wells GM-20D and GM-21D) exhibited no VOC detections or trace VOC detections during this period,

Wells located further downgradient of the hydraulic barrier exhibited TVOC concentrations consistent with the expected concentrations in the portions of the groundwater VOC plume not actively remediated. Of particular note, downgradient Well GM-34D historically exhibited several VOCs (primarily trichloroethene) exceeding SCGs at concentrations that have increased over time. This well is located south of the GM-75D2 Area (Figure 1 – see Section 5.1.4 for additional detail).

Groundwater quality data continues to support the conclusion that the expected bifurcation of the VOC plume is occurring along the Northrop Grumman site southern boundary, as shown by no detections in wells located within the capture zone and immediately downgradient of the site. SCG exceedences continue to persist in wells screened in the portion of the groundwater VOC plume not actively remediated.

In general, the water quality data from the deep wells sampled during the current period and Year 2006 continue to support the interpretation of the hydraulic data and confirm that the operation of the on-site portion of the OU2 groundwater remedy has formed an effective hydraulic barrier that prevents the off-site migration of VOC-impacted groundwater in the deep zone.

Operable Unit 2
Northrop Grumman Systems
Corporation,
Bethpage, New York
NYSDEC Site #s 1-30-0003A
& B

5.1.4 Deep2 Zone and Remedial Wells

Groundwater monitoring data from the D2 zone are summarized in Table 4 and data trends are presented on Figures 2, 3, 6, 7, and 8. Attached data trend graphs include key wells with detectable concentrations of VOCs that were sampled this period.

Monitoring Well GM-33D2, located along the southwestern boundary of the Northrop Grumman site, had several VOCs that exceeded SCGs in this period. Similar exceedances were detected in Well GM-33D2 the first three quarters of Year 2006. TVOC values in Well GM-33D2 were slightly higher in the Second and Third Quarters compared to the First and Fourth Quarters, but the overall trend in this well from November 1998 is a decreasing one. The overall decreasing trend in Well GM-33D2 is attributable to the pumping of the OU2 remedial wells. Well GM-33D2 is located within the capture zone of the remedial wells (which are screened in the D2 zone) and therefore groundwater in this area is hydraulically contained and over time will be extracted and treated by the on-site portion of the OU2 groundwater remedy.

For the GM-75D2 Area, off-site Wells GM-35D2 and GM-75D2 had several SCG exceedances during this period, with TVOC concentrations of 335 µg/L and 402 µg/L, respectively. These data are consistent with concentrations expected in the off-site portion of the VOC plume not actively remediated. TVOC concentrations in Well GM-75D2 have shown a decreasing trend since the Year 2002, while TVOC concentrations in Wells GM-34D2 and GM-35D2 increased in the Year 2002 with the latter having remained fairly constant since that time. Well GM-34D2 has exhibited an increasing trend for the period of record. Currently, the Department of the Navy is preparing a work plan for investigation of groundwater in the GM-75D2 Area.

The GM-38 Area monitoring results during Year 2006 were provided in prior reports (ARCADIS of New York, Inc. 200a; b). Well GM-38D2 continues to exhibit a stable VOC concentration trend that was first identified in Year 2002. Remediation of VOCs in the GM-38 Area will be performed by the Department of the Navy.

The other off-site D2 zone monitoring wells continue to exhibit stable to decreasing TVOC concentration trends.

For the remedial wells, TVOC concentrations ranged from 158 µg/L (Well 18) to 3,751 µg/L (Well 3). Wells 3 and 19 concentration trends continue to increase, while the remaining wells exhibit stable to decreasing trends. Well 3 continues to exhibit the highest TVOC concentrations.

Operable Unit 2
Northrop Grumman Systems
Corporation,
Bethpage, New York
NYSDEC Site #s 1-30-0003A
& B

In general, the water quality data from the D2 wells sampled during the current period and Year 2006 continue to support the interpretation of the hydraulic data and confirm that the operation of the on-site portion of the OU2 groundwater remedy has formed an effective hydraulic barrier that prevents the off-site migration of VOC-impacted groundwater in the D2 zone.

5.2 Outpost Monitoring

The results of the current outpost well monitoring round are provided in Table 5 and data trends are presented in Figure 9. The complete description of the procedures to collect groundwater samples from the outpost wells and evaluate and document the results is provided in the PWSCP (ARCADIS G&M, Inc., 2003b).

VOCs were not detected in Outpost Wells OW1-2, OW3-1, OW3-2, OW4-1, and OW4-2 during this period and the period of record. Outpost Wells OW1-1, OW1-3, OW2-1 and OW2-2 exhibited detections of site-related VOCs below their respective SCGs, but above the TVOC outpost trigger (except Well OW2-1) values this period. Well OW2-1 has shown an increase in TVOC concentrations since Year 2003 (primarily due to the detection of benzene and methyl-tertiary butyl ether [MTBE], which are not site-related VOCs); the remaining wells exhibit stable VOC concentration trends.

As no new outpost trigger values were exceeded in Year 2006, the requirements for notification/reporting of the initial trigger value exceedances, as outlined in the PWSCP (ARCADIS G&M, Inc., 2003b), have already been met.

5.3 Vinyl Chloride Monomer

Vinyl chloride monomer (VCM) was detected in Well 3 during this period and the Year 2006, but was not detected in the other remedial wells or monitoring wells sampled this period. Implementation of off-site remediation of groundwater to address VCM upgradient (northwest) of Well 3 is currently underway by Occidental Chemical Corporation (OCC) under USEPA oversight.

5.4 Cadmium and Chromium

Cadmium and chromium analysis results for Year 2006 are provided in prior reports (ARCADIS of New York, Inc. 2007a;b).

Operable Unit 2
Northrop Grumman Systems
Corporation,
Bethpage, New York
NYSDEC Site #s 1-30-0003A
& B

Based on data for the period of record, cadmium concentrations near former Northrop Grumman Plant 2 continue to persist above the SCG in Well MW-3R, however downgradient monitoring wells have remained below the SCG, with the exception of the most recent result from Well N-10631 (Figure 10).

Based on data for the period of record, chromium concentrations for the wells near former Northrop Grumman Plant 2 continued to be below the SCG (Figure 11). During Year 2006, the chromium concentration trends in the wells near former Northrop Grumman Plant 1 have been stable to decreasing over time (Figure 12).

5.5 Tentatively Identified Compounds

Tentatively Identified Compounds (TICs) were not detected during Year 2006. A review of the cumulative last five years of TIC data shows no discernable trends in concentrations or consistency in TIC detections.

5.6 QA/QC Samples and Data Validation

The results of analysis of QA/QC samples from the current period are provided in Table 6. Results for replicate samples from Wells GM-33D2 and OW1-1 are reported in Tables 4 and 5, respectively.

ARCADIS performed validation of all groundwater quality data collected (including TICs) by following the contract laboratory program national functional guidelines for organic and inorganic data review (USEPA 1999). The quality of the data is considered acceptable with the qualifications indicated on Tables 2 through 6.

6. Annual Groundwater Model Update Evaluation

In accordance with the provisions of the PWSCP, ARCADIS has conducted an evaluation of the supply well pumpage and water quality data provided by public water supply purveyors within the area of the model domain, as well as water quality data collected by ARCADIS and Northrop Grumman from the OU2 groundwater quality monitoring well network to assess the efficacy of the outpost well network in meeting the objectives set forth in the PWSCP.

The following discussions describe the mass and pumpage evaluations and updates performed in Year 2006.

Operable Unit 2
Northrop Grumman Systems
Corporation,
Bethpage, New York
NYSDEC Site #s 1-30-0003A
& B

6.1 Purpose of the Evaluation

The purpose of conducting this comparison was to determine if the assigned initial TVOC concentrations in the Year 2000 Model are representative of conditions observed through groundwater sampling conducted between Year 2001 and Year 2004. Likewise a comparison of model-assigned pumping rates to records of remedial system operation and public supply well pumpage was made to ensure the model accurately represented present-day conditions.

6.2 Pumpage Update

A comparison of model-assigned pumping rates to records of both remedial system operation and public supply well pumpage was made to ensure the model accurately represented present-day conditions.

Specifically, average supply well pumping rates for public supply wells from Year 2001 through the end of Year 2004 were computed for each public supply and remedial well located within the model domain. The computed rates were then compared to the model assigned rates. If deviations from the model-assigned rates were greater than 10 percent then the model was updated using the new computed pumping rate. Note that most of the model pumping wells did not require updating.

Following an update of the model-assigned pumping rates, the flow model was re-run, and the model-generated flow field was reviewed. Results showed that the model accurately represented regional flow field conditions and the effect of the revised pumping rates was minimal.

6.3 Mass Update

Recent groundwater quality data (from the beginning of 2001 through the end of 2004) was compared to TVOC concentration distributions in the existing Grumman Regional Groundwater Model (Year 2000 Model). The water quality data was comprised of both data collected by ARCADIS for Northrop Grumman during routine groundwater sampling rounds, and analytical water quality results supplied by municipal water suppliers.

The evaluation process consisted of the following:

Operable Unit 2
Northrop Grumman Systems
Corporation,
Bethpage, New York
NYSDEC Site #s 1-30-0003A
& B

1. Groundwater quality data from both monitoring and supply wells was compiled, based on sampling events between early Year 2001 and the end of Year 2004.
2. An updated average TVOC concentration for each monitoring well or supply well for the referenced period was calculated.
3. The 2001-2004 time-period Average TVOC Concentration (2001-2004 TVOC Average) was compared to the initial TVOC concentrations assigned in the 2000 Model at each of the monitoring well or supply well locations.

A comparison of the TVOC concentrations assigned as initial conditions in the Year 2000 Model to the 2001-2004 TVOC Average indicated that model-wide increases in assigned TVOC concentrations were not necessary. Rather, only local areas within the defined boundaries of the simulated plume required modification (based on a significant difference between the 2000 Model's initial conditions and the 2001-2004 TVOC Average).

In most cases, only moderate to significant local increases in assigned TVOC concentrations were necessary to update the model. Increases in assigned TVOC concentrations at specific model cells (model cells in which a well existed for which data was available) in turn necessitated additional changes to those model cells proximal to the cells undergoing the reassignment of initial conditions (i.e., changes in a single cell will likely require modifications to neighboring cells both within the layer initially modified, as well as layers above and below the cell initially modified to maintain a "smoothness" in the distribution of assigned TVOC concentrations). Following completion of the process, it was apparent that no significant changes were made to the extent of the model plume, nor to the concentration levels proximal to that extent.

6.4 Results

Based on the model update evaluation performed, a model re-run and an update to the outpost well monitoring program, per the provisions in the PWSCP, was determined to not be necessary at this time. The outpost well data and attendant evaluation/ update of the model will continue to be performed as additional data are generated.

Operable Unit 2
Northrop Grumman Systems
Corporation,
Bethpage, New York
NYSDEC Site #s 1-30-0003A
& B

7. Summary and Conclusions

1. The following data indicate that the OU2 groundwater remedy continues to meet remedial performance goals for Year 2006.
 - a. During the current period, the OU2 remedial wells pumped 406 MG, or approximately 95 percent of the design volume of groundwater, while the recharge basins received a collective total of 375.8 MG of treated groundwater. For the Year 2006, the OU2 remedial wells pumped 1,869 MG, or approximately 93 percent of the design volume of groundwater, while the recharge basins received approximately 1,611.1 MG of treated groundwater.
 - b. Based on data presented in prior reports, OU2 remedial well specific capacities remain above the minimum required to sustain the design pumping rates.
 - c. Approximately 3,076 lbs of VOCs were removed from the aquifer and treated by the on-site portion of the OU2 groundwater remedy during the current period. In Year 2006, approximately 14,764 lbs of VOCs were removed from the aquifer and treated, and approximately 107,041 lbs of VOCs were removed and treated since full-time system startup in November 1998.
 - d. The treatment efficiencies of both groundwater treatment systems remain above 99 percent for the current period.
2. The following data indicate that the OU2 groundwater remedy continues to meet remedial effectiveness goals for Year 2006.
 - a. The hydraulic data indicate hydraulic containment has been achieved in a manner consistent with previous years.
 - b. Wells immediately downgradient of the hydraulic barrier show no or trace VOC concentrations or decreasing VOC concentration trends. Groundwater quality data indicates that bifurcation of the VOC plume is occurring in the deep and D2 zones south of the hydraulic barrier.
3. Other significant findings and conclusions with respect to groundwater are summarized as follows:

Operable Unit 2
Northrop Grumman Systems
Corporation,
Bethpage, New York
NYSDEC Site #s 1-30-0003A
& B

- a. Based on prior reports for Year 2006, in the shallow, intermediate, and deep zones, the majority of wells located along the Northrop Grumman site perimeter showed trace or non-detectable concentrations of VOCs.
- b. The majority of D2 wells located along and immediately downgradient of the Northrop Grumman site southern boundary exhibit stable or decreasing concentrations of VOCs. Such wells are located within the capture zone of the remedial wells. Wells located in areas not actively remediated (further downgradient of the Northrop Grumman site) exhibit concentrations indicative of expected VOC plume heterogeneity. Additional investigation of groundwater in the GM-75D2 Area and remediation of deep/D2 zone groundwater in the GM-38 Area will be performed by the Department of the Navy.
- c. Site-related VOCs were detected in Outpost Wells OW1-1, OW1-3, OW2-1 and OW2-2. The remaining outpost wells exhibited no VOC detections.
- d. Based on prior reports for Year 2006, Cd/Cr SCG exceedences are limited to on-site areas, with the exception of Cr in Well N-10631 in the most recent round.
- e. VCM in groundwater remains limited to the area near and upgradient of Remedial Well 3; additional groundwater remedial action currently being implemented by OCC.

8. Recommendation

The NYSDEC granted the request from ARCADIS to reduce the monitoring frequency for selected wells, as reflected in the limited number of wells sampled during the Fourth Quarter of 2006. ARCADIS makes no other recommendations to modify the groundwater monitoring program at this time.

Operable Unit 2
Northrop Grumman Systems
Corporation,
Bethpage, New York
NYSDEC Site #s 1-30-0003A
& B

9. References

ARCADIS of New York, Inc. 2007a. First Quarter 2007 Groundwater Monitoring Report, Operable Unit 2, Northrop Grumman Corporation, Bethpage, New York.

ARCADIS of New York. 2007b. Second and Third Quarters 2007 Groundwater Monitoring Report, Operable Unit 2, Northrop Grumman Corporation, Bethpage, New York.

ARCADIS G&M, Inc. 2006. Petition for Recommended Modifications to the Operable Unit 2 Groundwater Monitoring Plan, Northrop Grumman Corporation, Bethpage, New York. June 2006.

ARCADIS G&M, Inc. 2005. Memo to J. Cofman Re: Calpine Water Supply Modeling Results for Simulation 2, 4, and 5. November 18, 2005.

ARCADIS G&M, Inc. 2003a. 2002 Annual Groundwater Monitoring Report, Northrop Grumman Corporation, Bethpage, New York. August 14, 2003.

ARCADIS G&M, Inc. 2003b. Public Water Supply Contingency Plan, Naval Facilities Engineering Command. July 22, 2003.

ARCADIS Geraghty & Miller, Inc. 2001. Operable Unit 2 Groundwater Monitoring Plan. Northrop Grumman Corporation, Bethpage, New York. May 11, 2001.

Naval Weapons Industrial Reserve Plant Site #130003B.

NYSDEC 2005. Letter to Messrs. John Cofman and James Colter Re: Northrop Grumman and Naval, Weapons Industrial Reserve Plant Site. Town of Oyster Bay, Nassau County, Site Nos. 1-30-003A and B. July 13, 2005.

New York State Department of Environmental Conservation (NYSDEC). 2001. Record of Decision Operable Unit 2 Groundwater Northrop Grumman and Naval Weapons Industrial Reserve Plant Sites, Nassau County Site Numbers 1-30-003A & B.

New York State Department of Environmental Conservation (NYSDEC). 1998. Division of Water Technical and Operation Guidance Series (TOGS 1.1.1).

ARCADIS

**2006 Annual
Groundwater Monitoring
Report**

Ambient Water Quality Standards and Guidance Values and Groundwater Effluent Limitations. Promulgated October 22, 1993. Re-issued June 1998.

Operable Unit 2
Northrop Grumman Systems
Corporation,
Bethpage, New York
NYSDEC Site #s 1-30-0003A
& B

U.S. Environmental Protection Agency (USEPA). 1999. Contract Laboratory Program National Functional Guidelines for Organic Data Review. October 1999.

Table 1. Summary of Operational Data and Water Balance for the On-Site Portion of the OU2 Groundwater Remedy, Fourth Quarter 2006 and Year 2006, Northrop Grumman Systems Corporation, Bethpage, New York.

Identification	Design Pumping/Recharge Rate ^(a) (gpm)	Current Actual Average Pumping/Recharge Rate ^(b) (gpm)	Design Total Pumpage/Recharge (MG)	Current Actual Total Pumpage/Recharge (MG)	Current Percent of Design Pumpage/Recharge	Cumulative Year-to-Date Design Total Pumpage/Recharge (MG)	Cumulative Year-to-Date Actual Total Pumpage/Recharge (MG)	Year-to-Date Percent of Design Pumpage/Recharge	Current TCE Concentration (ug/L)	Current TVOC Concentration ^(c) (ug/L)	Current Calculated VOC Mass Removed ^(d,g) (lbs)	Cumulative Year-to-Date VOC Mass Removed ^(f,g) (lbs)	Cumulative VOC Mass Removed ^(f,g) (lbs)
Remedial Wells													
Groundwater Removed from Aquifer													
Well 1 (GP-1)	800	955	89.9	105.1	117%	423	435.9	103%	540	705	617	2,814	25,718
Well 3 (GP-3)	700	536	78.6	59.0	75%	370	255.1	69%	3,200	3,752	1,843	8,869	34,396
Well 17 (ONCT-1)	1,000	961	112.3	107.9	96%	528	505.9	96%	410	451	405	2,107	41,513
Well 18 (ONCT-2)	600	532	67.4	59.7	89%	317	325.0	103%	140	158	79	426	3,603
Well 19 (ONCT-3)	700	657	78.6	73.8	94%	370	346.6	94%	180	215.2	132	548	1,811
Rounded Totals:	3,800	3,641	427	406	95%	2,008	1,869	93%	--	--	3,076	14,764	107,041
Recharge Basins ^(a)													
Treated Water Recharged to Aquifer													
West Recharge Basins	412	758	46	85.1	116%	218	225.7	115%	--	--	--	--	--
South Recharge Basins	2,231	2,588	250.6	290.7	116%	1,179	1,358.4	115%	--	--	--	--	--
Rounded Totals:	2,643	3,346	297	375.8	127%	1,397	1,611.1	115%	--	--	--	--	--
Summary of Calpine Energy Plant Demand													
Calpine Demand	600-1000	295	80-134	32.5	--	--	271.9	--	--	--	--	--	--
Groundwater Treatment Efficiencies													
Average SPDES Outfall Concentrations for Fourth Quarter 2006 (ug/L)													
Tower 96 (GP-1) System Efficiency ^(e) :		99.9%		1.9									
Tower 102 (ONCT) System Efficiency ^(e) :		99.2%		2.5									

see footnotes on last page

Table 1. Summary of Operational Data and Water Balance for the On-Site Portion of the OU2 Groundwater Remedy, Fourth Quarter 2006 and Year 2006, Northrop Grumman Systems Corporation, Bethpage, New York.

- (a) Remedial well pumping rates based on computer modeling (ARCADIS Geraghty & Miller, Inc. 2000). Acceptable minimum recharge rates based on computer modeling (ARCADIS G&M, Inc. 2004b). Design pumping and recharge rates were modified in April, 2005. Total recharge includes remedial well pumpage (minus pipe loss) and incidental runoff from precipitation.
- (b) Actual Average Pumping Rates were calculated based on Actual Total Pumpage and hours of operation from October 12 to December 28, 2006 (78 days) for the Fourth Quarter 2006, and hours of operation from December 29, 2005, to December 28, 2006 (367 days) for Year 2006. Current average recharge rates have been determined using the entire 78-day span of time for the Fourth Quarter 2006, as opposed to current average pumping rates, which account for varying amounts of downtime, as indicated below. OU2 wells were operational during the Fourth Quarter 2006, at the following percentages: Well 1 (98%), Well 3 (98%); Well 17 (100%), Well 18 (100%), and Well 19 (100%). The Actual Average Pumping Rates are for when the wells are pumping. All readings accurate to +/- 10% due to gauge limitations.
- (c) The TVOC concentration for each well was calculated based on Fourth Quarter 2006 groundwater monitoring data (Table 4).
- (d) VOC mass removed during the Fourth Quarter and Year 2006 was based on the TVOC data given on page 1 and the following formula:

$$\text{TVOC concentration in ug/L} \times (\text{gallons pumped}) \times (3.785 \text{ L/gal}) \times (1 \times 10^{-6} \text{ g/ug}) \times (2.2 \times 10^{-3} \text{ lb/g})$$

- (e) Air Stripping Efficiency calculated from values above and in Table 4 using the following formula:

$$1 - \left[\frac{\text{Average SPDES TVOC Concentration at Outfall}}{\frac{[(\text{TVOC}_{\text{Well 1}} \times \text{Q}_{\text{Well 1}}) + (\text{TVOC}_{\text{Well 2}} \times \text{Q}_{\text{Well 2}})]}{(\text{Q}_{\text{Well 1}} + \text{Q}_{\text{Well 2}})}} \right]$$

When non-detectable levels of VOCs are found in the effluent, a value of zero is used to estimate the efficiency of the air stripper.

- (f) Cumulative calculated Year-to-Date VOC Mass Removed includes the record from December 29, 2005, through December 28, 2006. Cumulative calculated VOC Mass Removed includes mass removed since start-up of the Toiwer 102 system in November 1998.
- (g) Current year to date and cumulative TVOC Mass Removed includes Wells Well 1, Well 3, Well 17, Well 18 and Well 19.

--	Not Available or Not Applicable	lb/g	pounds per gram
TVOC	Total Volatile Organic Compounds	lbs	pounds
g/ug	grams per microgram	MG	Million Gallons
gpm	gallons per minute	ug/L	micrograms per liter
L/gal	Liters per gallon	OU2	Operable Unit 2
SPDES	State Pollutant Discharge Elimination System	Q	Pumping Rate

ARCADIS

Table 2. Concentrations of Volatile Organic Compounds Detected in Intermediate Wells,
Fourth Quarter 2006, Operable Unit 2, Northrop Grumman Systems Corporation, Bethpage, New York.

CONSTITUENT (Units in ug/L)	NYSDEC Standards Criteria and Guidance Values ⁽¹⁾	WELL:	GM-20I	GM-21I	GM-79I
		SAMPLE ID:	GM-20I	GM-21I	GM-79I
		DATE:	11/21/2006	11/20/2006	11/21/2006
Chloromethane	5		<5	<5	<5
Bromomethane	5		<5	<5	<5
Vinyl chloride	2		<2	<2	<2
Chloroethane	5		<5	<5	<5
Methylene chloride	5		<5	<5	<5
Acetone	50		<10	<10	<10
Carbon disulfide	50		<5	<5	<5
1,1-Dichloroethene	5		<5	<5	<5
1,1-Dichloroethane	5		<5	<5	<5
cis-1,2-Dichloroethene	5		<5	<5	<5
trans-1,2-Dichloroethene	5		<5	<5	<5
Chloroform	7		<5	<5	<5
1,2-Dichloroethane	5		<5	<5	<5
2-Butanone	50		<10	<10	<10
1,1,1-Trichloroethane	5		<5	<5	<5
Carbon tetrachloride	5		<5	<5	<5
Bromodichloromethane	50		<5	<5	<5
1,2-Dichloropropane	5		<5	<5	<5
cis-1,3-Dichloropropene	5		<5	<5	<5
Trichloroethene	5		<5	<5	<5
Dibromochloromethane	5		<5	<5	<5
1,1,2-Trichloroethane	5		<5	<5	<5
Benzene	0.7		<0.7	<0.7	<0.7
trans-1,3-Dichloropropene	5		<5	<5	<5
Bromoform	50		<5	<5	<5
4-Methyl-2-pentanone	50		<10	<10	<10
2-Hexanone	50		<10	<10	<10
Tetrachloroethene	5		<5	<5	<5
1,1,2,2-Tetrachloroethane	5		<5	<5	<5
Toluene	5		<5	<5	<5
Chlorobenzene	5		<5	<5	<5
Ethylbenzene	5		0.62J	<5	<5
Styrene	5		<5	<5	<5
Xylene (total)	5		2.7J	1.1J	<5
Vinyl Acetate	NE		<5	<5	<5
Freon 113	5		<5	<5	<5
Chlorodifluoromethane	5		<5	<5	<5
Dichlorodifluoromethane	5		<5	<5	<5
Total VOCs			3.3	1.1	0

ug/L Micrograms per liter

J Estimated value

Bold Constituent detected

⁽¹⁾ Standards, Criteria, and Guidance (SCG) values based on documents referenced in the Groundwater Feasibility Study Report (ARCADIS Geraghty & Miller, Inc. 2000) that are based on the NYSDEC TOGs (NYSDEC 1998); most stringent value listed.

VOCs Volatile organic compounds

NYSDEC New York State Department of Environmental Conservation

* Freon 113 also known as 1,1,1-Trichloro-2,2,2-trifluoroethane.

NE No SCG established

TOGS Technical and Operational Guidance Series

ARCADIS

Table 3. Concentrations of Volatile Organic Compounds Detected in Deep Wells,
Fourth Quarter 2006, Operable Unit 2, Northrop Grumman Systems Corporation, Bethpage, New York.

CONSTITUENT (Units in ug/L)	NYSDEC Standards Criteria and Guidance Values ⁽¹⁾	WELL:	GM-20D	GM-21D	GM-34D	GM-79D
		SAMPLE ID:	GM-20D	GM-21D	GM-34D	GM-79D
		DATE:	11/21/2006	11/20/2006	11/30/2006	11/21/2006
Chloromethane	5		<5	<5	<5	<5
Bromomethane	5		<5	<5	<5	<5
Vinyl chloride	2		<2	<2	<2	<2
Chloroethane	5		<5	<5	<5	<5
Methylene chloride	5		<5	<5	<5	<5
Acetone	50		<10	<10	<10	<10
Carbon disulfide	50		<5	<5	<5	<5
1,1-Dichloroethene	5		<5	<5	19	<5
1,1-Dichloroethane	5		<5	<5	1.5J	<5
cis-1,2-Dichloroethene	5		<5	<5	12	<5
trans-1,2-Dichloroethene	5		<5	<5	<5	<5
Chloroform	7		<5	<5	0.65J	<5
1,2-Dichloroethane	5		<5	<5	<5	<5
2-Butanone	50		<10	<10	<10	<10
1,1,1-Trichloroethane	5		<5	<5	<5	<5
Carbon tetrachloride	5		<5	<5	<5	<5
Bromodichloromethane	50		<5	<5	<5	<5
1,2-Dichloropropane	5		<5	<5	<5	<5
cis-1,3-Dichloropropene	5		<5	<5	<5	<5
Trichloroethene	5		<5	2J	1100D	47
Dibromochloromethane	5		<5	<5	<5	<5
1,1,2-Trichloroethane	5		<5	<5	<5	<5
Benzene	0.7		<0.7	<0.7	<0.7	<0.7
trans-1,3-Dichloropropene	5		<5	<5	<5	<5
Bromoform	50		<5	<5	<5	<5
4-Methyl-2-pentanone	50		<10	<10	<10	<10
2-Hexanone	50		<10	<10	<10	<10
Tetrachloroethene	5		<5	<5	15B	1.4J
1,1,2,2-Tetrachloroethane	5		<5	<5	<5	<5
Toluene	5		<5	<5	<5	<5
Chlorobenzene	5		<5	<5	<5	<5
Ethylbenzene	5		<5	<5	<5	<5
Styrene	5		<5	<5	<5	<5
Xylene (total)	5		<5	<5	<5	<5
Vinyl Acetate	NE		<5	<5	<5	<5
Freon 113	5		<5	<5	22	0.68J
Chlorodifluoromethane	5		<5	<5	1.3J	<5
Dichlorodifluoromethane	5		<5	<5	0.57J	<5
Total VOCs			0	2	1,172	49.1

ug/L Micrograms per liter

B Detected in an associated blank.

D Constituent identified at a secondary dilution.

J Estimated value

Bold Constituent detected

⁽¹⁾ Standards, Criteria, and Guidance (SCG) values based on documents referenced in the Groundwater Feasibility Study Report (ARCADIS Geraghty & Miller, Inc. 2000) that are based on the NYSDEC TOGS (NYSDEC 1998); most stringent value listed.

VOCs Volatile organic compounds

NYSDE New York State Department of Environmental Conservation

* Freon 113 also known as 1,1,1-Trichloro-2,2,2-trifluoroethane.

[Box] Value exceeds associated SCG value.

NE No SCG established

TOGS Technical and Operational Guidance Series

ug/L Micrograms per liter

ARCADIS

Table 4. Concentrations of Volatile Organic Compounds Detected in Deep2 Monitoring Wells and Groundwater Remedial Wells and Treatment Systems Fourth Quarter 2006, Operable Unit 2, Northrop Grumman Systems Corporation, Bethpage, New York.

CONSTITUENT (Units in ug/L)	NYSDEC Standards Criteria and Guidance Values ⁽¹⁾	WELL:	GM-33D2	GM-33D2	GM-35D2	GM-75D2
		SAMPLE ID:	GM-33D-2	REP-11-29-06	GM-35D-2	GM-75D-2
		DATE:	11/29/2006	11/29/2006	11/29/2006	11/27/2006
Chloromethane	5		<5	<5	<5	<5
Bromomethane	5		<5	<5	<5	<5
Vinyl chloride	2		<2	<2	<2	<2
Chloroethane	5		<5	<5	<5	<5
Methylene chloride	5		<5	<5	<5	<5
Acetone	50		<10	<10	<10	<10
Carbon disulfide	50		<5	<5	<5	<5
1,1-Dichloroethene	5		1J	0.94J	1.9J	7.5
1,1-Dichloroethane	5		<5	<5	<5	<5
cis-1,2-Dichloroethene	5		1.9J	1.9J	3.5J	1.6J
trans-1,2-Dichloroethene	5		<5	<5	<5	<5
Chloroform	7		<5	<5	<5	<5
1,2-Dichloroethane	5		<5	<5	<5	<5
2-Butanone	50		<10	<10	<10	<10
1,1,1-Trichloroethane	5		<5	<5	<5	<5
Carbon tetrachloride	5		<5	<5	<5	<5
Bromodichloromethane	50		<5	<5	<5	<5
1,2-Dichloropropane	5		<5	<5	<5	<5
cis-1,3-Dichloropropene	5		<5	<5	<5	<5
Trichloroethene	5		120J	120J	310DJ	380DJ
Dibromochloromethane	5		<5	<5	<5	<5
1,1,2-Trichloroethane	5		<5	<5	<5	<5
Benzene	0.7		<0.7	<0.7	<0.7	<0.7
trans-1,3-Dichloropropene	5		<5	<5	<5	<5
Bromoform	50		<5	<5	<5	<5
4-Methyl-2-pentanone	50		<10	<10	<10	<10
2-Hexanone	50		<10	<10	<10	<10
Tetrachloroethene	5		22B	24B	12B	9.8B
1,1,2,2-Tetrachloroethane	5		<5	<5	<5	<5
Toluene	5		<5	<5	<5	<5
Chlorobenzene	5		<5	<5	<5	<5
Ethylbenzene	5		<5	<5	<5	<5
Styrene	5		<5	<5	<5	<5
Xylene (total)	5		<5	<5	<5	<5
Vinyl Acetate	NE		<5	<5	<5	<5
Freon 113	5		69	70	6.6	3.3J
Chlorodifluoromethane	5		<5	<5	1.1J	<5
Dichlorodifluoromethane	5		<5	<5	<5	<5
Total VOCs			213.9	216.8	335.1	402.2

- ug/L Micrograms per liter
- B Detected in an associated blank.
- D Constituent identified at a secondary dilution.
- J Estimated value
- Bold** Constituent detected
- ⁽¹⁾ Standards, Criteria, and Guidance (SCG) values based on documents referenced in the Groundwater Feasibility Study Report (ARCADIS Geraghty & Miller, Inc. 2000) that are based on the NYSDEC TOGs (NYSDEC 1998); most stringent value listed.
- VOCs Volatile organic compounds
- NYSDEC New York State Department of Environmental Conservation
- * Freon 113 also known as 1,1,1-Trichloro-2,2,2-trifluoroethane.
- Value exceeds associated SCG value.
- NE No SCG established
- TOGS Technical and Operational Guidance Series

Table 4. Concentrations of Volatile Organic Compounds Detected in Deep2 Monitoring Wells and Groundwater Remedial Wells and Treatment Systems Fourth Quarter 2006, Operable Unit 2, Northrop Grumman Systems Corporation, Bethpage, New York.

CONSTITUENT (Units in ug/L)	NYSDEC Standards Criteria and Guidance Values ⁽¹⁾	WELL:	WELL 1	WELL 3	T-96-INFL	T-96-EFFL
		SAMPLE ID:	WELL1	WELL3	T96INF	T96EFF
		DATE:	12/14/2006	12/14/2006	12/14/2006	12/14/2006
Chloromethane	5		<5	<5	<5	<5
Bromomethane	5		<5	<5	<5	<5
Vinyl chloride	2		<2	160	76	<2
Chloroethane	5		<5	4.3J	2J	<5
Methylene chloride	5		<5	<5	<5	<5
Acetone	50		<10	<10	<10	<10
Carbon disulfide	50		<5	<5	<5	<5
1,1-Dichloroethane	5		4.6J	21	12	<5
1,1-Dichloroethane	5		1.8J	3.9J	2.9J	<5
cis-1,2-Dichloroethane	5		8.6	17	12	<5
trans-1,2-Dichloroethane	5		<5	<5	<5	<5
Chloroform	7		<5	0.5J	<5	<5
1,2-Dichloroethane	5		<5	<5	<5	<5
2-Butanone	50		<10	<10	<10	<10
1,1,1-Trichloroethane	5		<5	<200	<5	<5
Carbon tetrachloride	5		<5	<5	<5	<5
Bromodichloromethane	50		<5	<5	<5	<5
1,2-Dichloropropane	5		1.5J	<5	<5	<5
cis-1,3-Dichloropropene	5		<5	<5	<5	<5
Trichloroethene	5		540D	3200D	2000D	1.4J
Dibromochloromethane	5		<5	<5	<5	<5
1,1,2-Trichloroethane	5		<5	210	<5	<5
Benzene	0.7		<0.7	53	10	<0.7
trans-1,3-Dichloropropene	5		<5	<5	<5	<5
Bromoform	50		<5	<5	<5	<5
4-Methyl-2-pentanone	50		<10	<10	<10	<10
2-Hexanone	50		<10	<10	<10	<10
Tetrachloroethene	5		140	60	100	<5
1,1,2,2-Tetrachloroethane	5		<5	<5	<5	<5
Toluene	5		<5	<5	<5	<5
Chlorobenzene	5		<5	<5	<5	<5
Ethylbenzene	5		<5	<5	<5	<5
Styrene	5		<5	<5	<5	<5
Xylene (total)	5		<5	<5	<5	<5
Vinyl Acetate	NE		<5	<5	<5	<5
Freon 113	5		8.2	22	14	<5
Chlorodifluoromethane	5		0.38J	<5	0.27J	<5
Dichlorodifluoromethane	5		<5	<5	<5	<5
Total VOCs			705.1	3,751.7	2,229.2	1.4

ug/L Micrograms per liter
 B Detected in an associated blank.
 D Constituent identified at a secondary dilution.
 J Estimated value
Bold Constituent detected
⁽¹⁾ Standards, Criteria, and Guidance (SCG) values based on documents referenced in the Groundwater Feasibility Study Report (ARCADIS Geraghty & Miller, Inc. 2000) that are based on the NYSDEC TOGS (NYSDEC 1998); most stringent value listed.
 VOCs Volatile organic compounds
 NYSDEC New York State Department of Environmental Conservation
 * Freon 113 also known as 1,1,1-Trichloro-2,2,2-trifluoroethane.
 Value exceeds associated SCG value.
 NE No SCG established
 TOGS Technical and Operational Guidance Series

ARCADIS

Table 4. Concentrations of Volatile Organic Compounds Detected in Deep2 Monitoring Wells and Groundwater Remedial Wells and Treatment Systems, Fourth Quarter 2006, Operable Unit 2, Northrop Grumman Systems Corporation, Bethpage, New York.

CONSTITUENT (Units in ug/L)	NYSDEC Standards Criteria and Guidance Values ⁽¹⁾	WELL:	WELL 17	WELL 18	WELL 19	T-102-INFL	T-102-EFFL
		SAMPLE ID:	WELL17	WELL18	WELL19	T102INF	T102EFF
		DATE:	12/15/2006	12/15/2006	12/15/2006	12/15/2006	12/15/2006
Chloromethane	5		<5	<5	<5	<5	<5
Bromomethane	5		<5	<5	<5	<5	<5
Vinyl chloride	2		<2	<2	<2	<2	<2
Chloroethane	5		<5	<5	<5	<5	<5
Methylene chloride	5		<5	<5	<5	<5	<5
Acetone	50		<10	<10	<10	<10	<10
Carbon disulfide	50		<5	<5	<5	<5	<5
1,1-Dichloroethane	5		2.7J	4.6J	1.5J	2.3J	<5
1,1-Dichloroethane	5		<5	<5	<5	<5	<5
cis-1,2-Dichloroethane	5		3.7J	1.7J	22	8.8	<5
trans-1,2-Dichloroethane	5		<5	<5	<5	<5	<5
Chloroform	7		<5	<5	0.94J	<5	<5
1,2-Dichloroethane	5		<5	<5	<5	<5	<5
2-Butanone	50		<10	<10	<10	<10	<10
1,1,1-Trichloroethane	5		0.53J	<5	<5	0.77J	<5
Carbon tetrachloride	5		<5	<5	<5	<5	<5
Bromodichloromethane	50		<5	<5	<5	<5	<5
1,2-Dichloropropane	5		<5	<5	<5	<5	<5
cis-1,3-Dichloropropene	5		<5	<5	<5	<5	<5
Trichloroethene	5		410D	140	180	270D	1.7J
Dibromochloromethane	5		<5	<5	<5	<5	<5
1,1,2-Trichloroethane	5		<5	<5	<5	<5	<5
Benzene	0.7		<0.7	<0.7	<0.7	<0.7	<0.7
trans-1,3-Dichloropropene	5		<5	<5	<5	<5	<5
Bromoform	50		<5	<5	<5	<5	<5
4-Methyl-2-pentanone	50		<10	<10	<10	<10	<10
2-Hexanone	50		<10	<10	<10	<10	<10
Tetrachloroethene	5		24	10	9.6	17	<5
1,1,2,2-Tetrachloroethane	5		<5	<5	<5	<5	<5
Toluene	5		<5	<5	<5	<5	<5
Chlorobenzene	5		<5	<5	<5	<5	<5
Ethylbenzene	5		<5	<5	<5	<5	<5
Styrene	5		<5	<5	<5	<5	<5
Xylene (total)	5		<5	<5	<5	<5	<5
Vinyl Acetate	NE		<5	<5	<5	<5	<5
Freon 113	5		10	1.6J	0.9J	5.6	<5
Chlorodifluoromethane	5		<5	0.37J	0.29J	0.26J	<5
Dichlorodifluoromethane	5		<5	<5	<5	<5	<5
Total VOCs			450.9	158.3	215.2	304.7	1.7

ug/L Micrograms per liter

B Detected in an associated blank.

D Constituent identified at a secondary dilution.

J Estimated value

Bold Constituent detected

⁽¹⁾ Standards, Criteria, and Guidance (SCG) values based on documents referenced in the Groundwater Feasibility Study Report (ARCADIS Geraghty & Miller, Inc. 2000) that are based on the NYSDEC TOGS (NYSDEC 1998); most stringent value listed.

VOCs Volatile organic compounds

NYSDE New York State Department of Environmental Conservation

* Freon 113 also known as 1,1,1-Trichloro-2,2,2-trifluoroethane.

[] Value exceeds associated SCG value.

NE No SCG established

TOGS Technical and Operational Guidance Series

ARCADIS

Table 5. Concentrations of Site-Related Volatile Organic Compounds Detected in Outpost Wells, Fourth Quarter 2006, Operable Unit 2.

CONSTITUENT (Units in ug/L)	NYS DEC Standards Criteria and Guidance Values	WELL:		OW1-1		OW1-2		OW1-3		OW2-2		OW3-1		OW4-1		OW4-2	
		OW1-1 BPOW1-1 12/1/2006	REP 12-6-06 12/1/2006	BPOW1-2 12/1/2006	BPOW1-3 12/1/2006	BPOW 2-1 12/1/2006	BPOW 2-2 12/1/2006	BPOW 3-1 12/8/2006	BPOW 3-2 12/8/2006	BPOW 4-1 12/1/2006	BPOW 4-2 12/1/2006						
Chlorobenzene	5	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50
1,1-Dichloroethene	5	1.8	1.8	<0.50	3.1	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50
1,1-Dichloroethane	5	1.5	1.4	<0.50	1.4	<0.50	<0.50	<0.50	<0.50	0.67	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50
trans-1,2-Dichloroethene	5	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50
cis-1,2-Dichloroethene	5	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50
Chloroform	7	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	2.2	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50
1,2-Dichloroethane	5	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	0.62J	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50
1,1,1-Trichloroethane	5	3.1J	3.1J	<0.50	4.7J	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50
Carbon tetrachloride	5	2	2	<0.50	0.93	<0.50	<0.50	<0.50	<0.50	1.4	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50
Trichloroethene	5	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	0.77	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50
1,1,2-Trichloroethane	5	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	0.93	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50
Tetrachloroethene	5	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50
Freon-113*	5	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50
1,1,2,2-Tetrachloroethane	5	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50
Total Site-Related VOCs⁽¹⁾:		8.4 ⁽¹⁾	8.3 ⁽¹⁾	0	10.73 ⁽¹⁾	0	0	0	4.97 ⁽¹⁾	1.44	0	0	0	0	0	0	0
TVOC Triager Value⁽²⁾:		0.6	0.6	0.6	0.6	0.6	0.6	0.6	NE	NE	1.5	1.5	1.5	1.5	1.5	1.5	1.5

(1) Site-related VOCs were established in the Public Water Supply Contingency Plan (PWSCP) (ARCADIS G&M, Inc. 2003).

(2) TVOC Trigger Values were established in the PWSCP (ARCADIS G&M, Inc. 2003).

(3) The TVOC Trigger Value for Cluster 1 was initially exceeded on April 23, 2004; confirmatory sampling and reporting was conducted as per the PWSCP (ARCADIS G&M, Inc. 2003).

(4) VOCs were initially detected in Cluster 2 on May 3, 2004; confirmatory sampling and reporting was conducted as per the PWSCP (ARCADIS G&M, Inc. 2003).

(5) Benzene and Methyl tert-butyl ether (MTBE), which are not site-related VOCs, were detected in Outpost Well OW 2-1 on 12/01/06 at 130 ug/L and 10 ug/L, respectively.

ug/L

Micrograms per liter

Constituent detected

TVOC Total Volatile Organic Compounds


NE Not Established

ARCADIS

Table 6. Concentrations of Volatile Organic Compounds Detected in Blank Samples, Fourth Quarter 2006, Operable Unit 2, Northrop Grumman Systems Corporation, Bethpage, New York.

CONSTITUENT (Units in ug/L)	NYSDEC Standards Criteria and Guidance Values ⁽¹⁾	WELL: TRIP BLANK					
		TRIP BLANK SAMPLE ID: TB-11-20-06 DATE: 11/20/2006	TRIP BLANK TB11-21-06 11/21/2006	TRIP BLANK TB-11-27-06 11/27/2006	TRIP BLANK TB-11-29-06 11/29/2006	TRIP BLANK TB11-30-06 11/30/2006	TRIP BLANK TB12141506 12/14/2006
Chloromethane	5	<5	<5	<5	<5	<5	<5
Bromomethane	5	<5	<5	<5	<5	<5	<5
Vinyl chloride	2	<2	<2	<2	<2	<2	<2
Chloroethane	5	<5	<5	<5	<5	<5	<5
Methylene chloride	5	3.8JB	3.9JB	4.6JB	4.2JB	4.7JB	5.2B
Acetone	50	<10	4.3J	3.3JB	3.3JB	2.4J	3.1JB
Carbon disulfide	50	<5	<5	<5	<5	<5	<5
1,1-Dichloroethene	5	<5	<5	<5	<5	<5	<5
1,1-Dichloroethane	5	<5	<5	<5	<5	<5	<5
cis-1,2-Dichloroethene	5	<5	<5	<5	<5	<5	<5
trans-1,2-Dichloroethene	5	<5	<5	<5	<5	<5	<5
Chloroform	7	<5	<5	<5	<5	<5	<5
1,2-Dichloroethane	5	<5	<5	<5	<5	<5	<5
2-Butanone	50	<10	<10	<10	<10	<10	<10
1,1,1-Trichloroethane	5	<5	<5	<5	<5	<5	<5
Carbon tetrachloride	5	<5	<5	<5	<5	<5	<5
Bromodichloromethane	50	<5	<5	<5	<5	<5	<5
1,2-Dichloropropane	5	<5	<5	<5	<5	<5	<5
cis-1,3-Dichloropropene	5	<5	<5	<5	<5	<5	<5
Trichloroethene	5	<5	<5	<5	<5	<5	<5
Dibromochloromethane	5	<5	<5	<5	<5	<5	<5
1,1,2-Trichloroethane	5	<5	<5	<5	<5	<5	<5
Benzene	0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7
trans-1,3-Dichloropropene	5	<5	<5	<5	<5	<5	<5
Bromoform	50	<5	<5	<5	<5	<5	<5
4-Methyl-2-pentanone	50	<10	<10	<10	<10	<10	<10
2-Hexanone	50	<10	<10	<10	<10	<10	<10
Tetrachloroethene	5	<5	<5	1.3JB	1.9JB	<5	<5
1,1,2,2-Tetrachloroethane	5	<5	<5	<5	<5	<5	<5
Toluene	5	<5	<5	<5	<5	<5	<5
Chlorobenzene	5	<5	<5	<5	<5	<5	<5
Ethylbenzene	5	<5	<5	<5	<5	<5	<5
Styrene	5	<5	<5	<5	<5	<5	<5
Xylene (total)	5	<5	<5	<5	<5	<5	<5
Vinyl Acetate	NE	<5	<5	<5	<5	<5	<5
Freon 113	5	<5	<5	<5	<5	<5	<5
Chlorodifluoromethane	5	<5	<5	<5	<5	<5	<5
Dichlorodifluoromethane	5	<5	<5	<5	<5	<5	<5
Total VOCs		3.8	8.2	9.2	9.4	7.1	8.3

- ug/L Micrograms per liter
- B Detected in an associated blank.
- D Constituent identified at a secondary dilution.
- J Estimated value
- Bold** Constituent detected
- ⁽¹⁾ Standards, Criteria, and Guidance (SCG) values based on documents referenced in the Groundwater Feasibility Study Report (ARCADIS Geraghty & Miller, Inc. 2000) that are based on the NYSDEC TOGs (NYSDEC 1998); most stringent value listed.
- VOCs Volatile organic compounds
- NYSDEC New York State Department of Environmental Conservation
- * Freon 113 also known as 1,1,1-Trichloro-2,2,2-trifluoroethane.
- NE No SCG established
- TOGS Technical and Operational Guidance Series

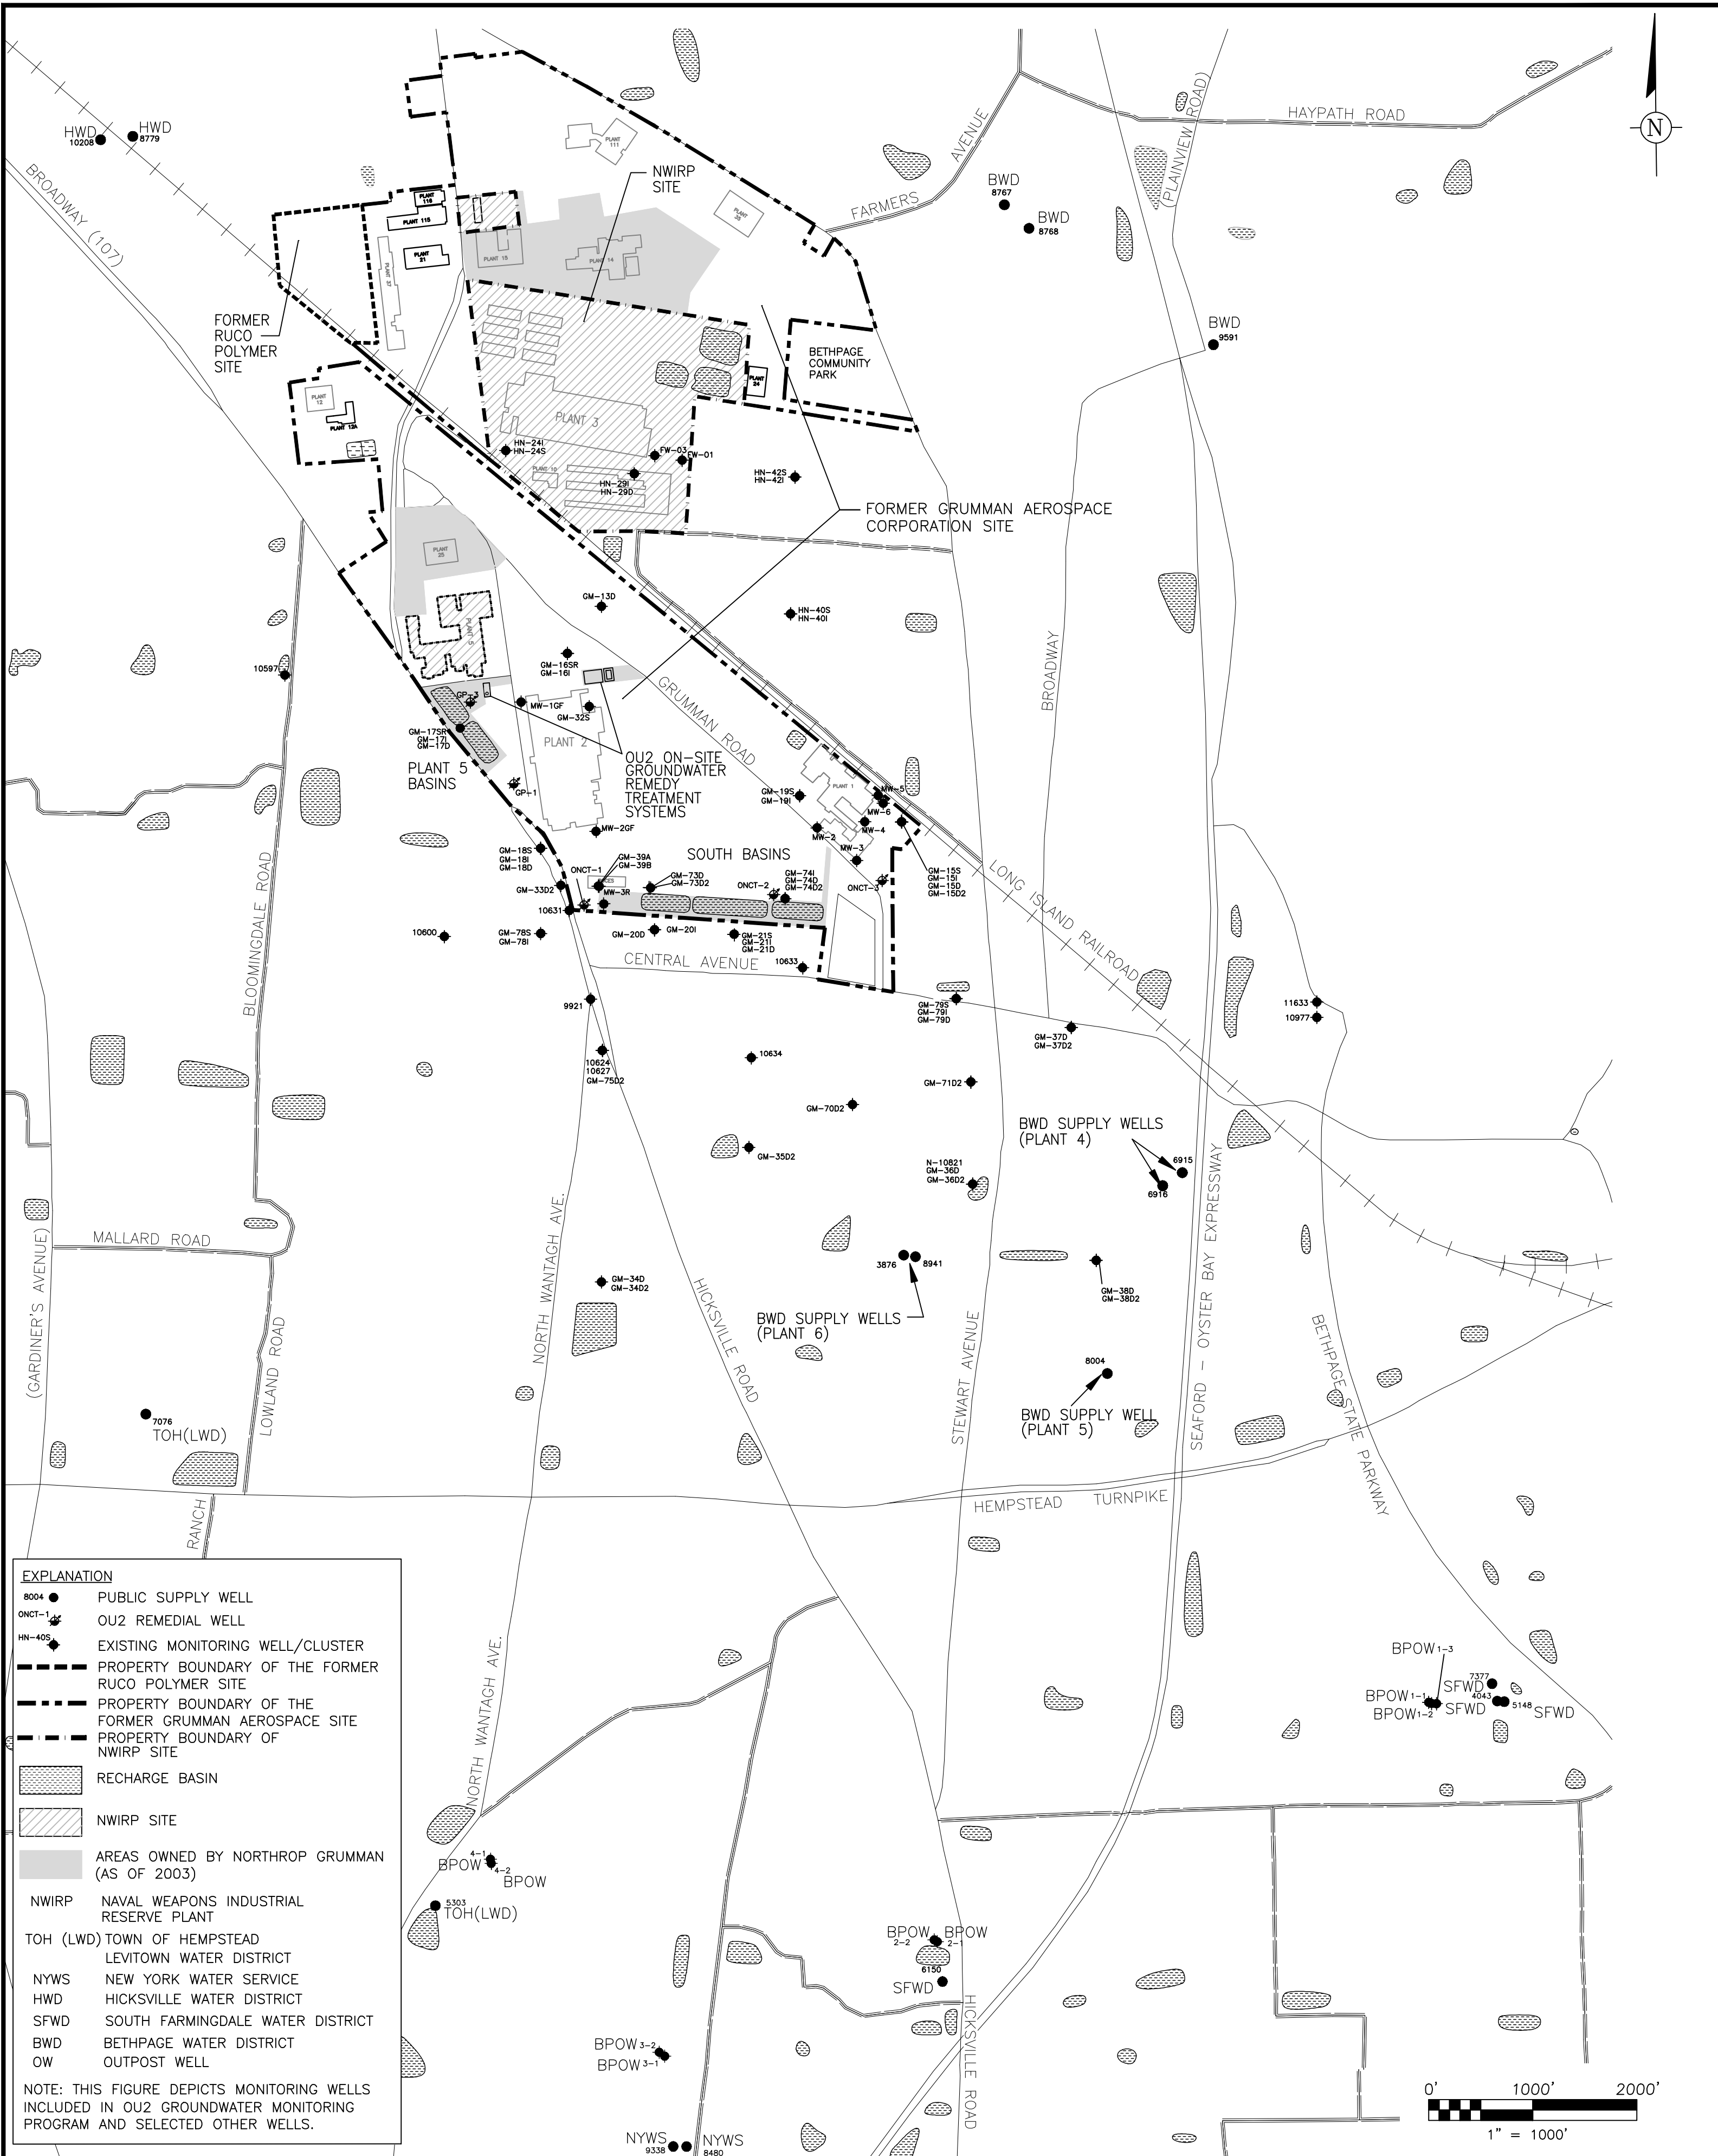

EXPLANATION	
8004 ●	PUBLIC SUPPLY WELL
ONCT-1	OU2 REMEDIAL WELL
HN-405	EXISTING MONITORING WELL/CLUSTER
---	PROPERTY BOUNDARY OF THE FORMER RUCO POLYMER SITE
---	PROPERTY BOUNDARY OF THE FORMER GRUMMAN AEROSPACE SITE
---	PROPERTY BOUNDARY OF NWIRP SITE
[Hatched Box]	RECHARGE BASIN
[Diagonal Lines Box]	NWIRP SITE
[Grey Box]	AREAS OWNED BY NORTHROP GRUMMAN (AS OF 2003)
NWIRP	NAVAL WEAPONS INDUSTRIAL RESERVE PLANT
TOH (LWD)	TOWN OF HEMPSTEAD LEVITOWN WATER DISTRICT
NYWS	NEW YORK WATER SERVICE
HWD	HICKSVILLE WATER DISTRICT
SFWD	SOUTH FARMINGDALE WATER DISTRICT
BWD	BETHPAGE WATER DISTRICT
OW	OUTPOST WELL

NOTE: THIS FIGURE DEPICTS MONITORING WELLS INCLUDED IN OU2 GROUNDWATER MONITORING PROGRAM AND SELECTED OTHER WELLS.

ARCADIS
OF NEW YORK, INC.

Two Huntington Quadrangle
Suite 1810
Melville, NY 11747
Tel: 631-249-7600 Fax: 631-249-7610
www.arcadis-us.com


PROJECT TITLE
**OPERABLE UNIT 2
NORTHROP GRUMMAN
CORPORATION
BETHPAGE, NEW YORK**

PROJECT MANAGER
C. SAN GIOVANNI

DEPARTMENT MANAGER
M. WOLFERT

LEAD DESIGNER
TASK/PHASE NUMBER
00004
PROJECT NUMBER
NY001464.0407

CHECKED BY
M. SAURBORN
DRAWN BY
A. SANCHEZ
DRAWING NUMBER
1

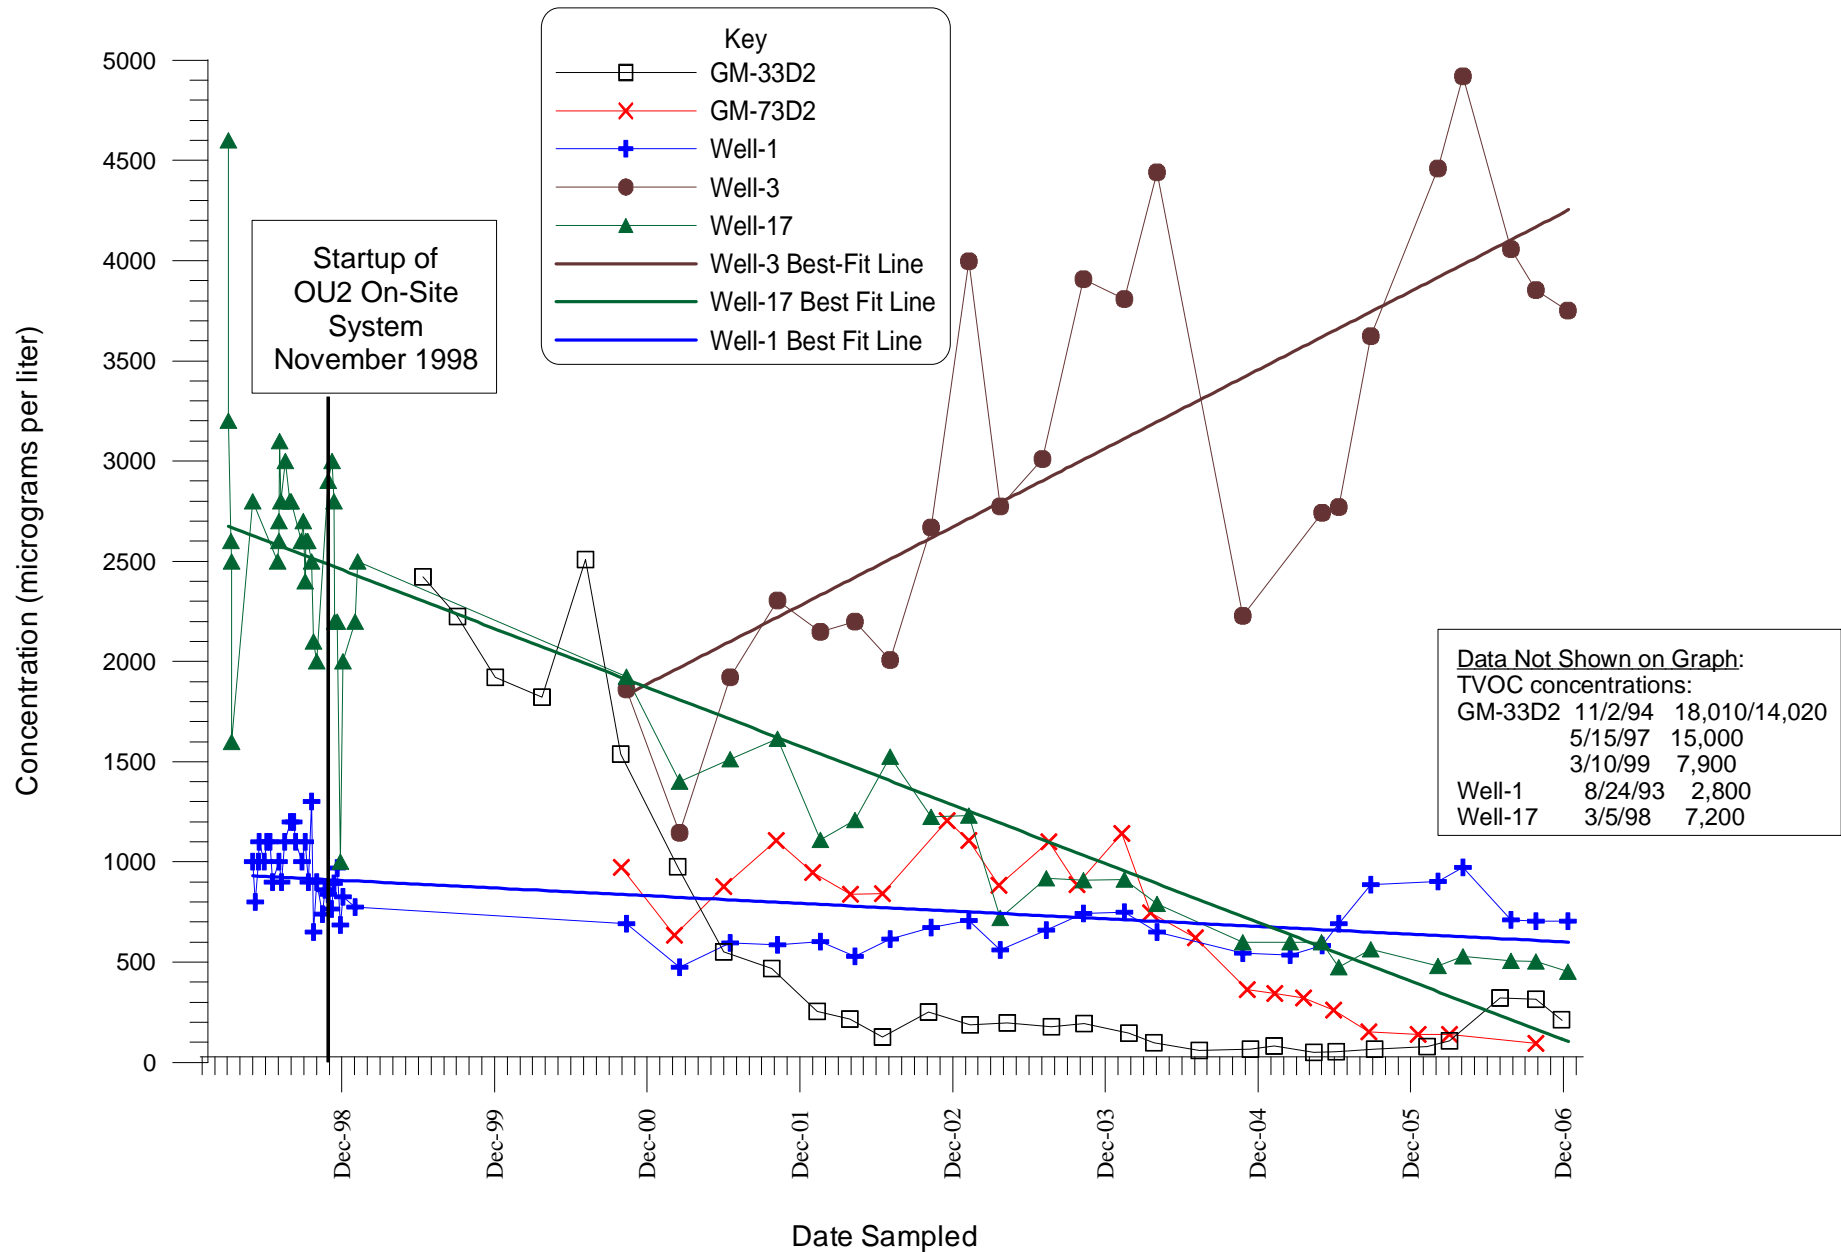


G:\APROJECT\Northrop Grumman\Superfund\2006\NY001348.0406 OM&M\Data\Graphs\33D2_73D2_GP1_GP3



Total Volatile Organic Compound Concentrations (Southern and Southwestern Site Boundary) in OU2 Remedial Wells and Monitoring Wells GM-33D2 and GM-73D2
 Northrop Grumman Systems Corporation, Bethpage, New York

FIGURE
2

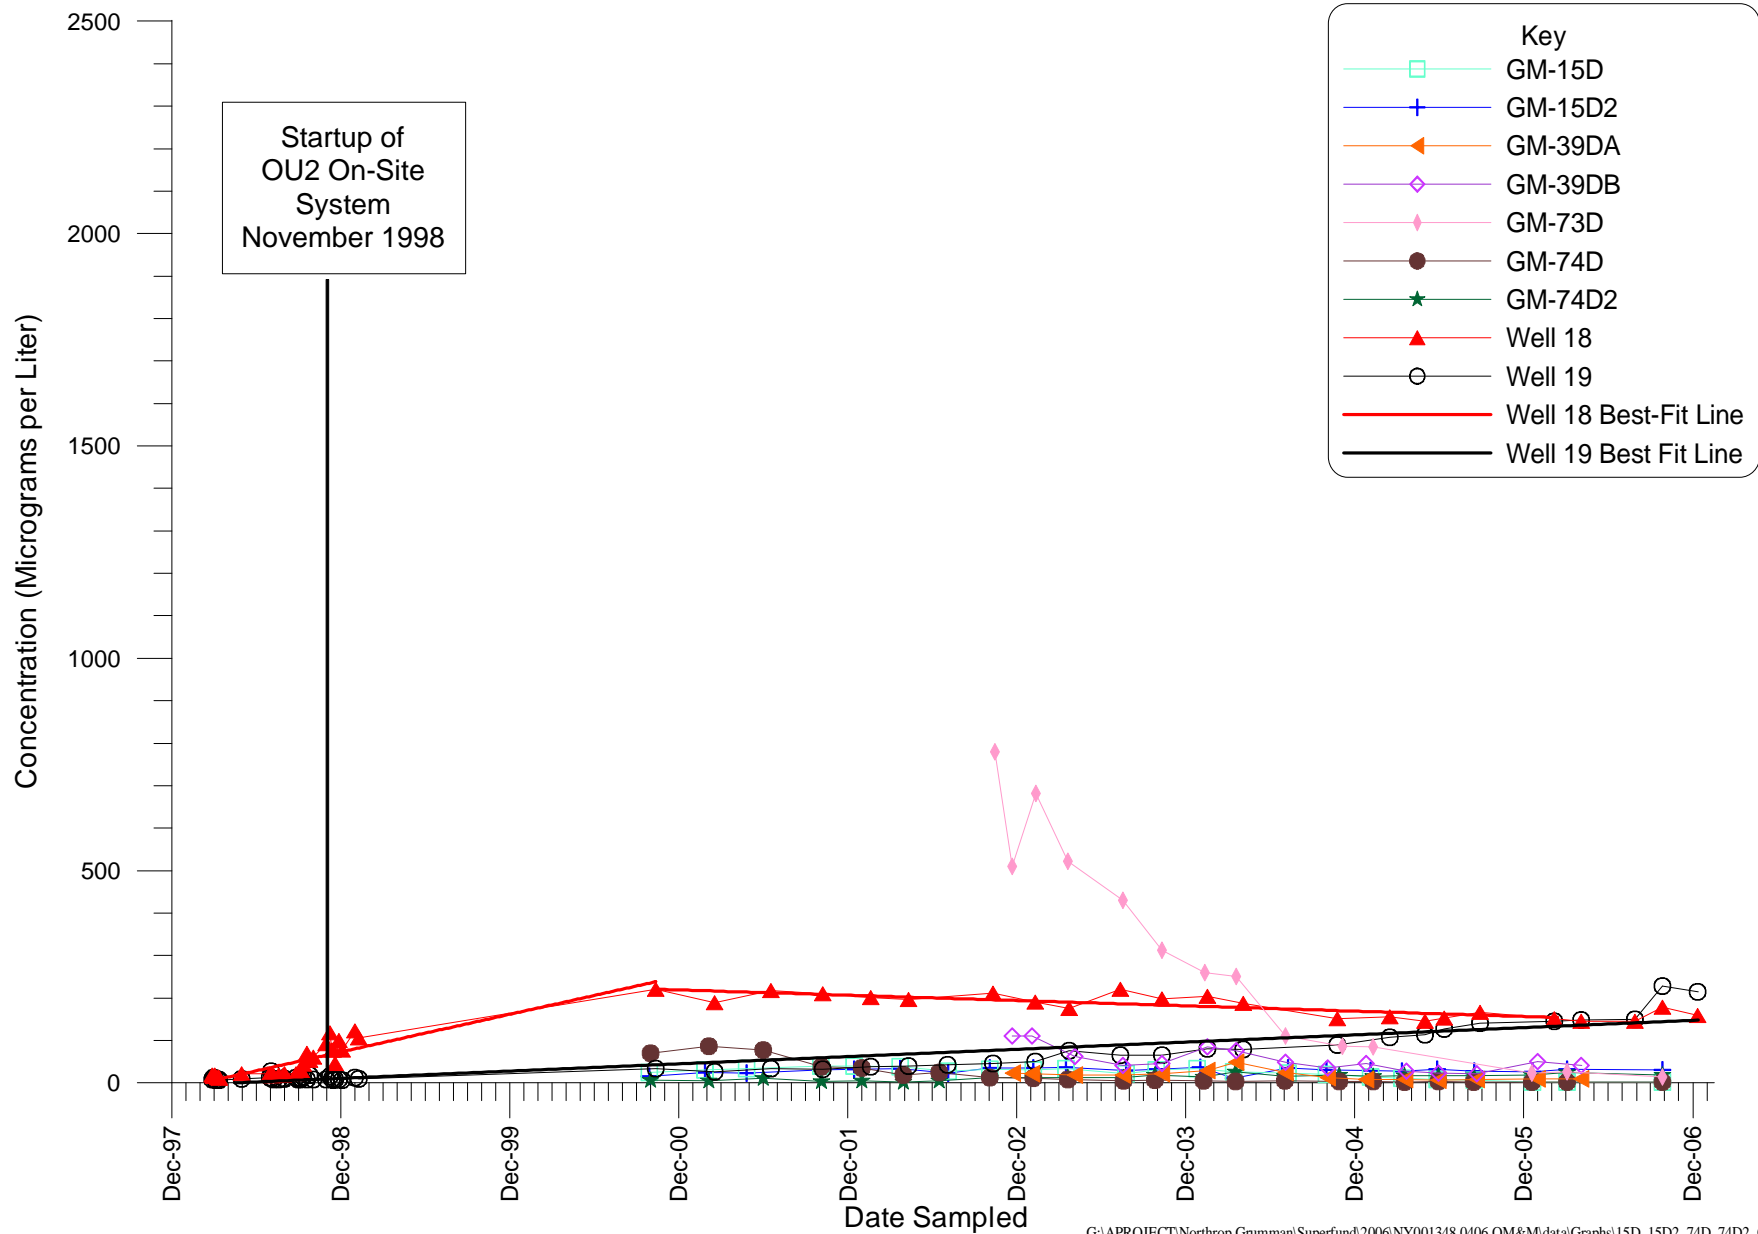


G:\PROJECT\Northrop Grumman\Superfund\2006\NY001348.0406 OM&M\data\Graphs\15D_15D2_74D_74D2_ONCT2



**Total Volatile Organic Compound Concentrations
(Southeastern Site Boundary) in On-Site Deep and Deep2
Monitoring Wells and OU2 Remedial Wells 18 and 19
Northrop Grumman Systems Corporation, Bethpage, New York**

**FIGURE
3**

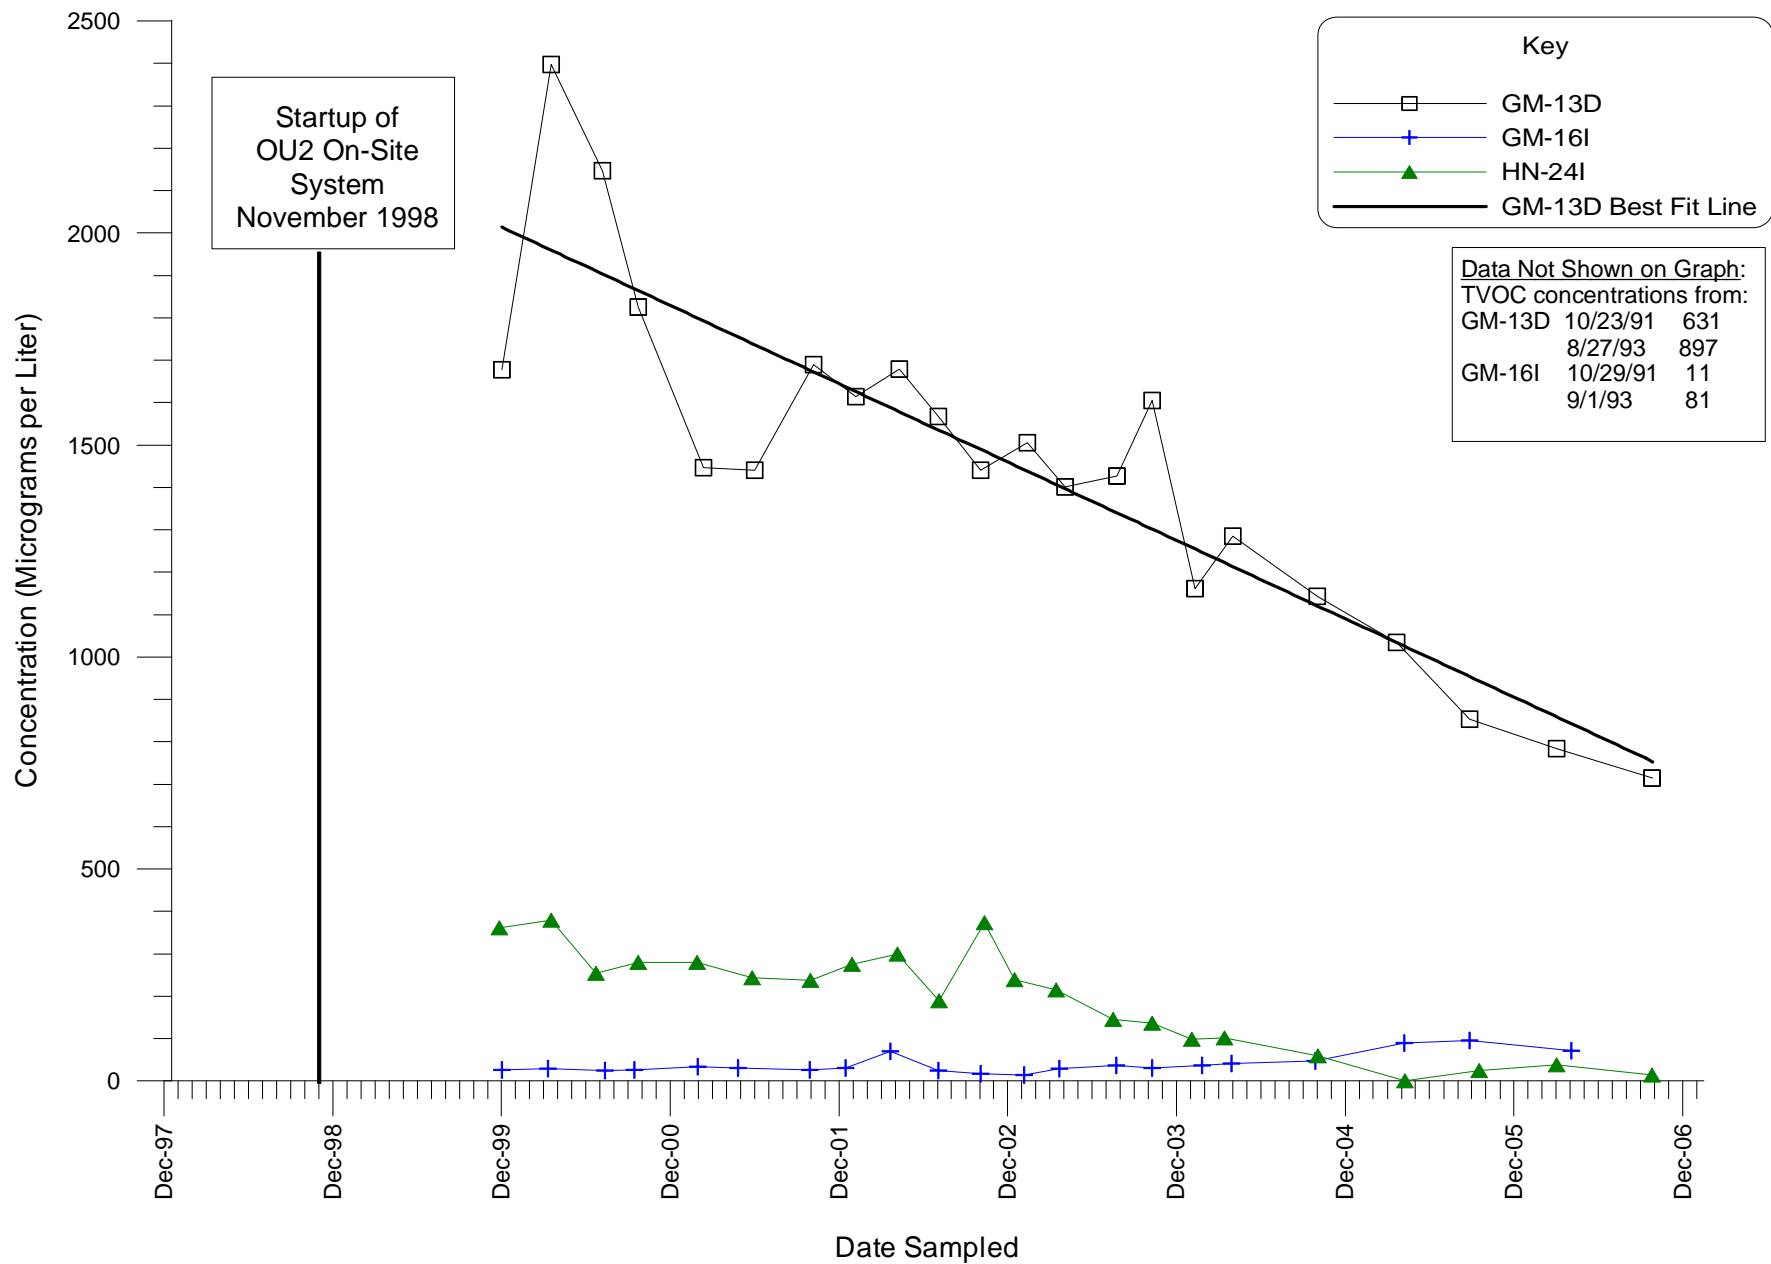


G:\APROJECT\Northrop Grumman\Superfund\2006\NY001348.0406 OM&M\data\Graphs\13D_16I_23I_HN24I_52S



Total Volatile Organic Compound Concentrations in On-Site Intermediate and Deep Monitoring Wells Northrop Grumman Systems Corporation, Bethpage, New York

FIGURE 4

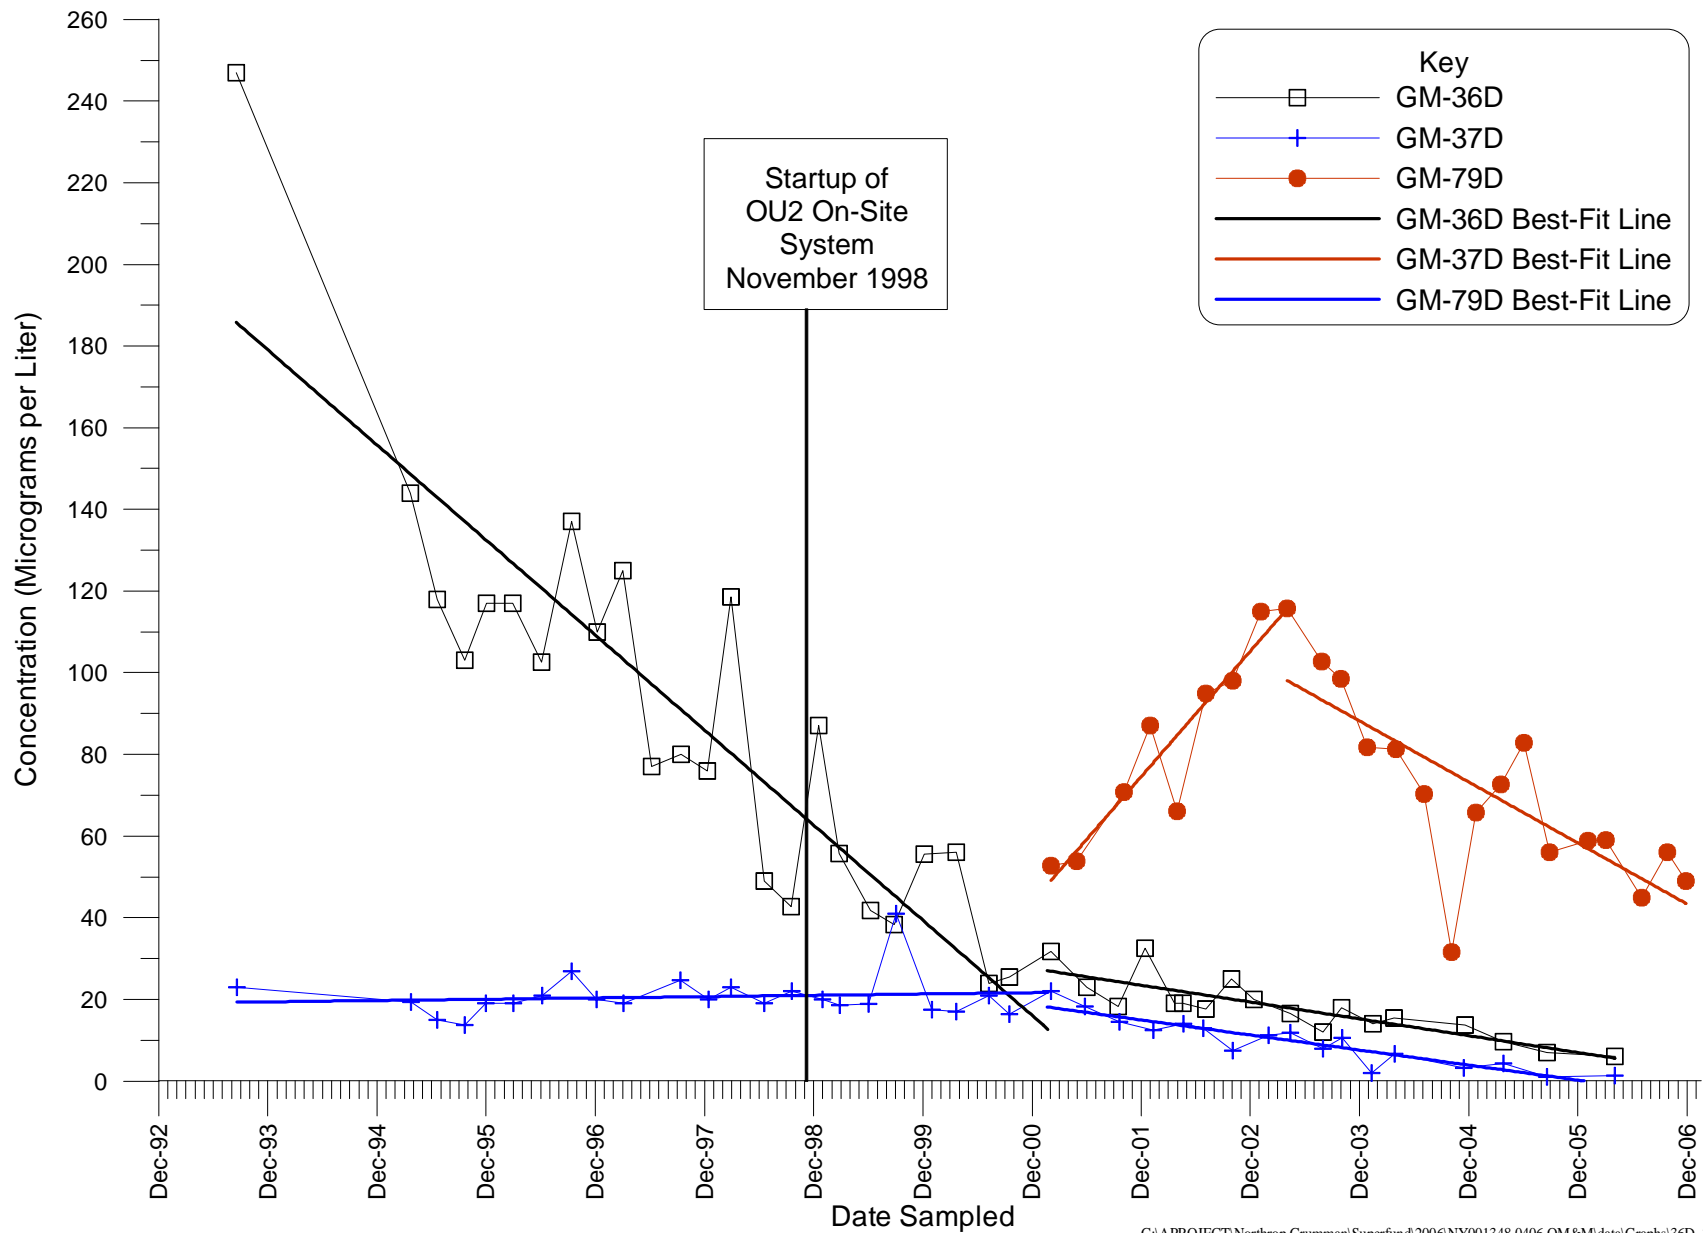


G:\APROJECT\Northrop Grumman\Superfund\2006\NY001348.0406 OM&M\data\Graphs\36D_37D_79D



Total Volatile Organic Compound Concentrations in
Off-Site Deep Monitoring Wells (Southeast of the Site)
Northrop Grumman Systems Corporation, Bethpage, New York

FIGURE
5

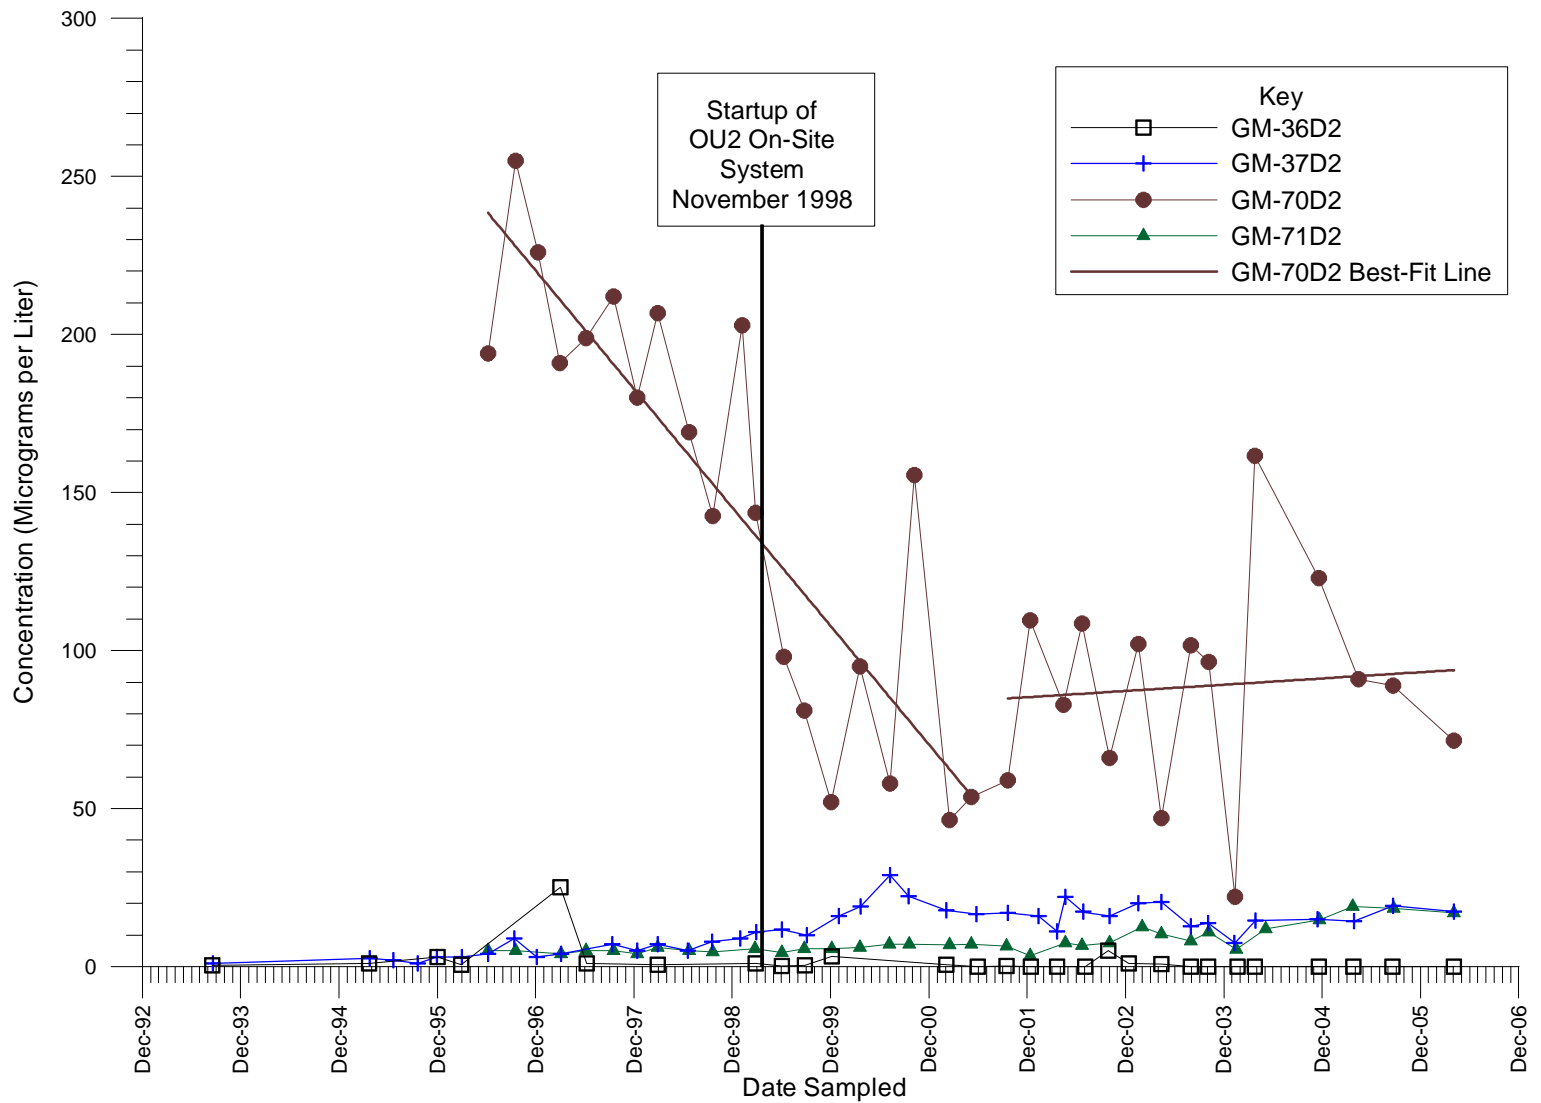


G:\PROJECT\Northrop Grumman\Superfund\2006\NY001348.0406 OM&M\data\Graphs\36D2_37D2_70D2_71D2



Total Volatile Organic Compound Concentrations in Off-Site Deep2 Monitoring Wells (Southeast of the Site) Northrop Grumman Systems Corporation, Bethpage, New York

FIGURE 6

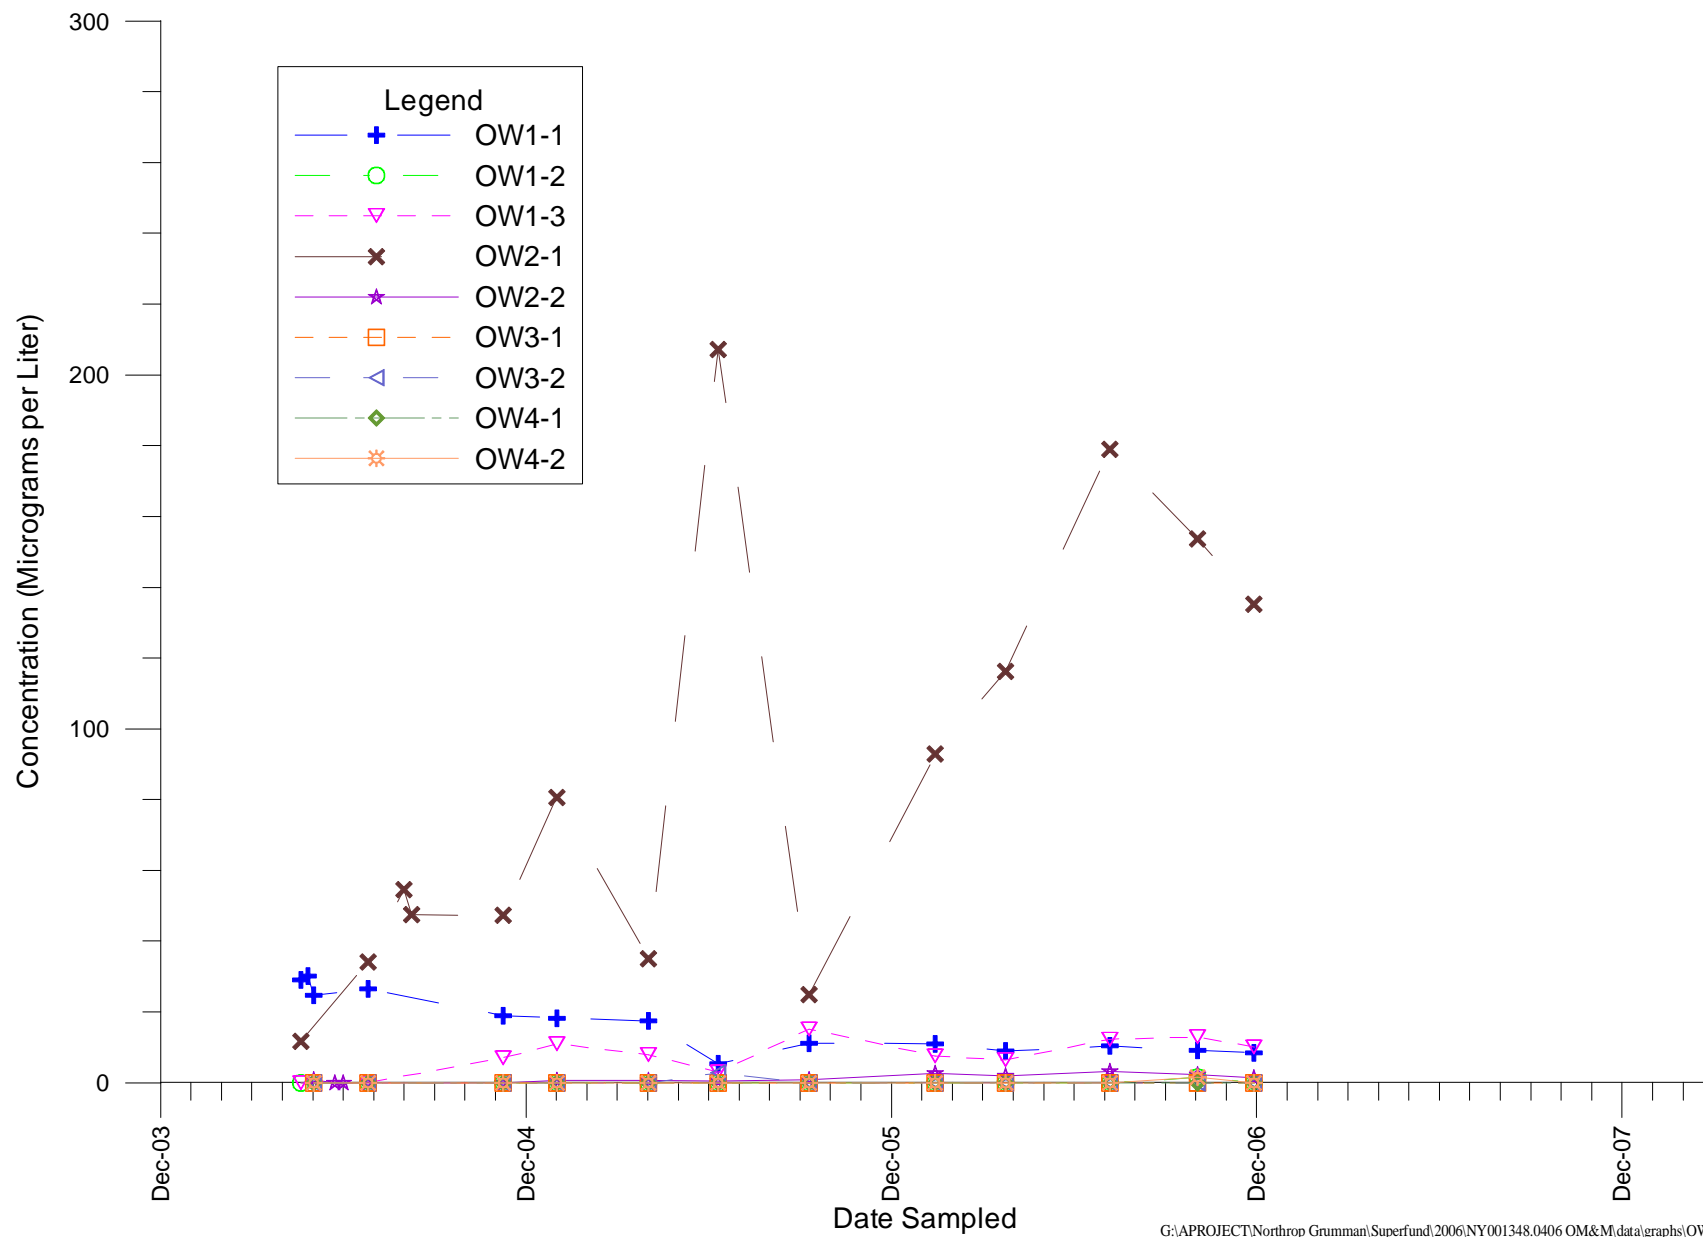


G:\PROJECT\Northrop Grumman\Superfund\2006\NY001348.0406 OM&M\data\graphs\OWWELLS




Total Volatile Organic Compound Concentrations in Outpost Wells
 Northrop Grumman Systems Corporation, Bethpage, New York

FIGURE 9

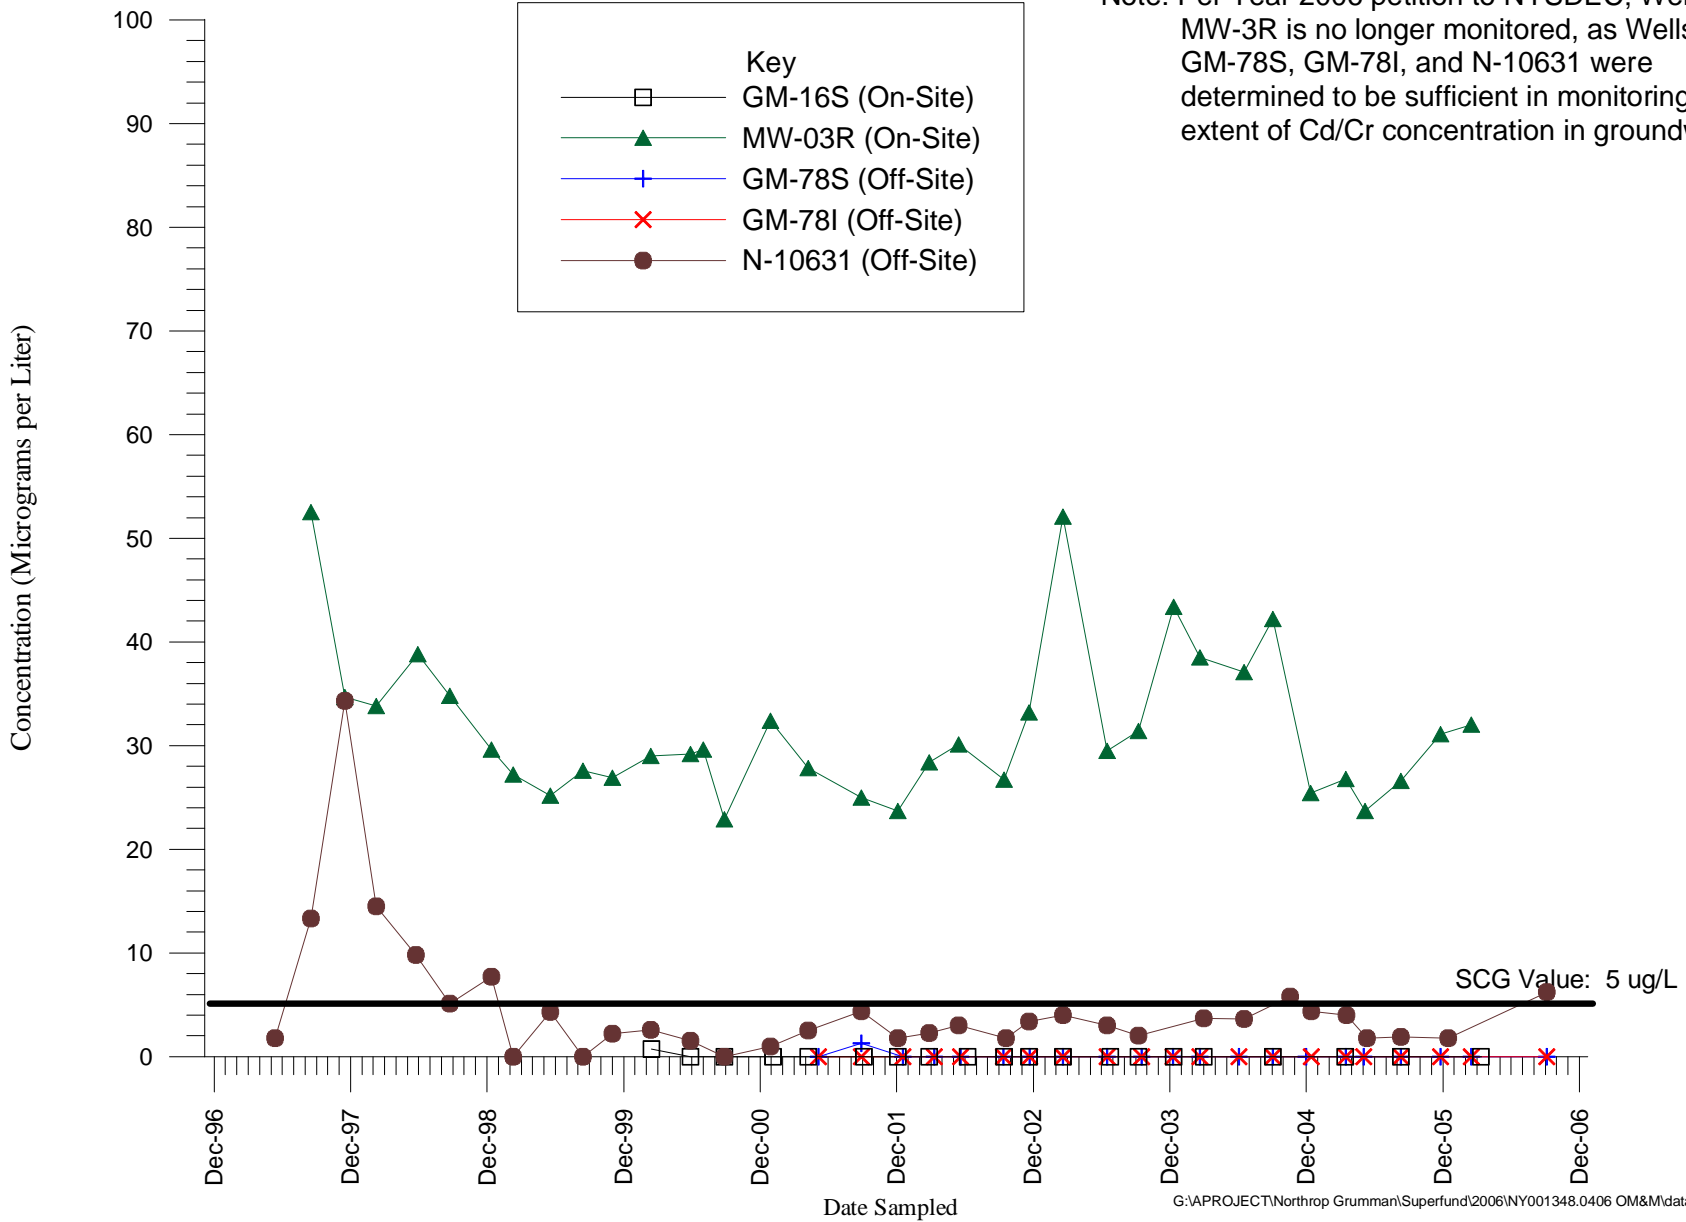


Total Cadmium Concentrations in Monitoring Wells
Near Former Plant 2
Northrop Grumman Systems Corporation, Bethpage, New York

FIGURE
10

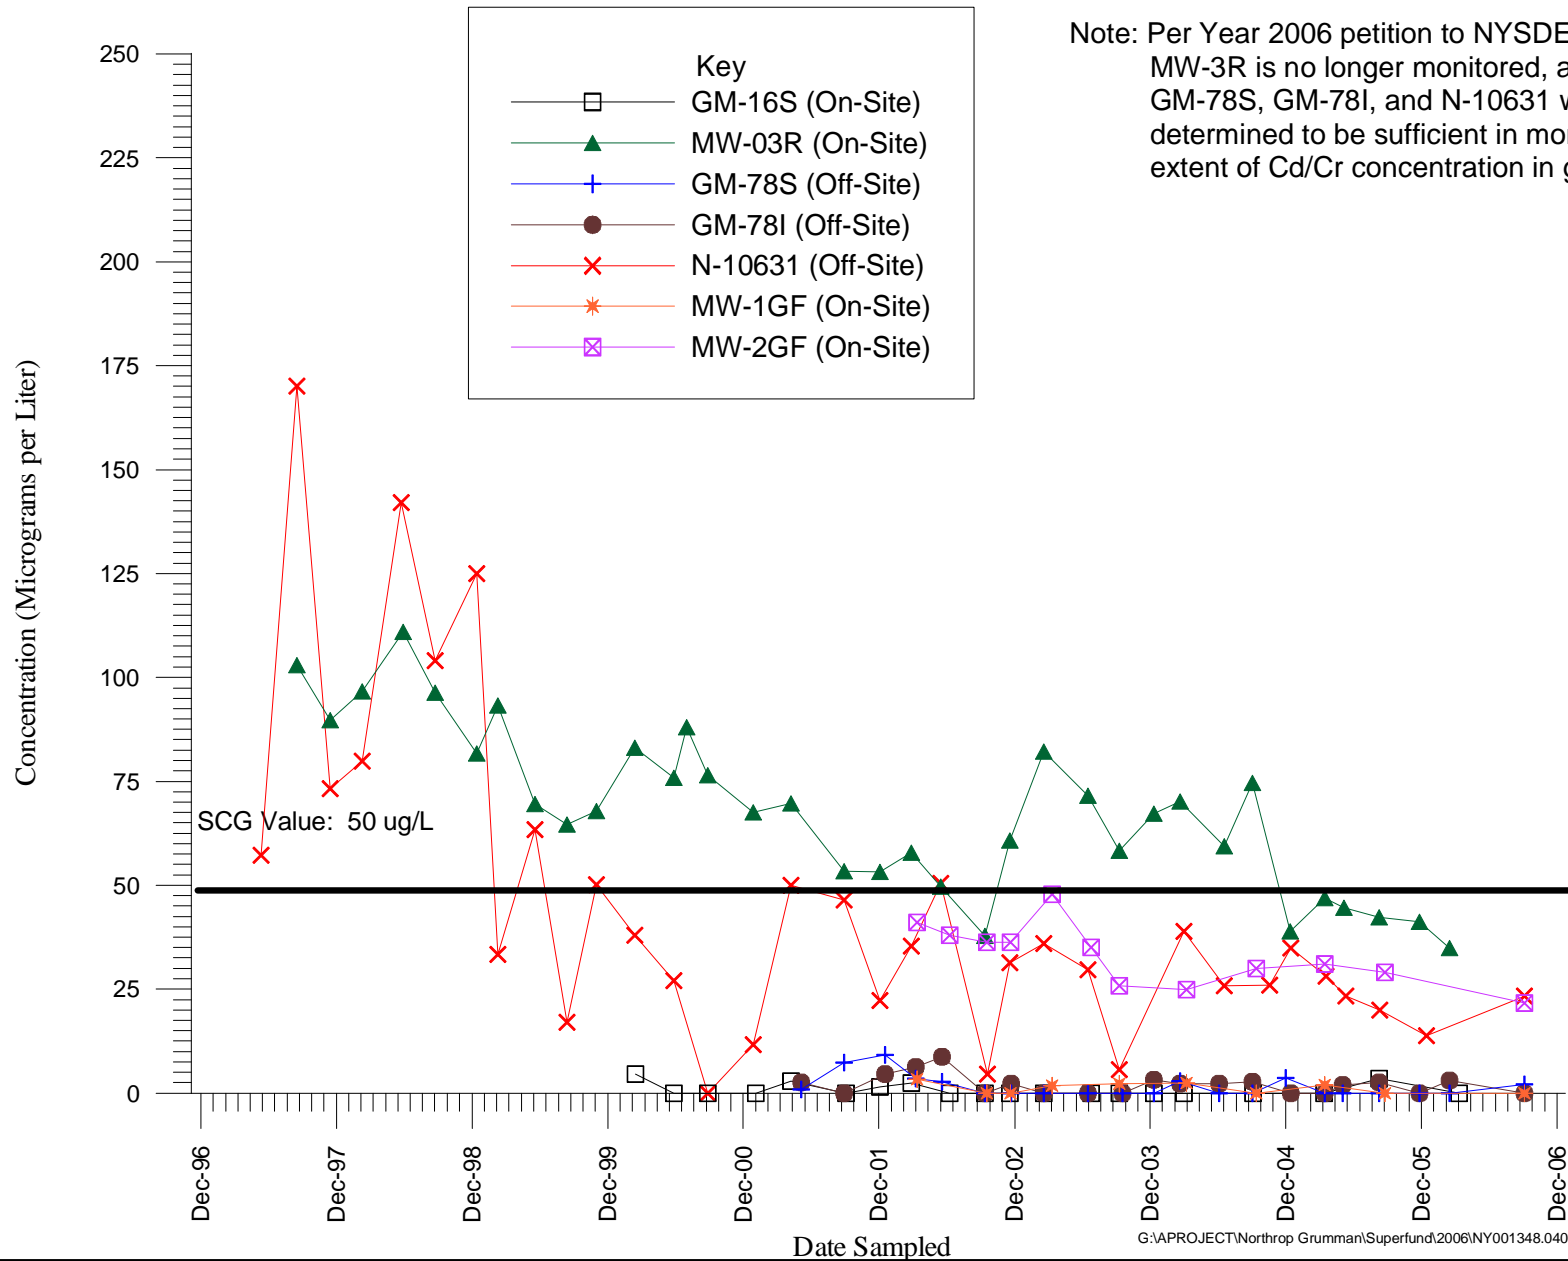

Total Chromium Concentrations in Monitoring Wells
Near Former Plant 2
Northrop Grumman Systems Corporation, Bethpage, New York

FIGURE
11

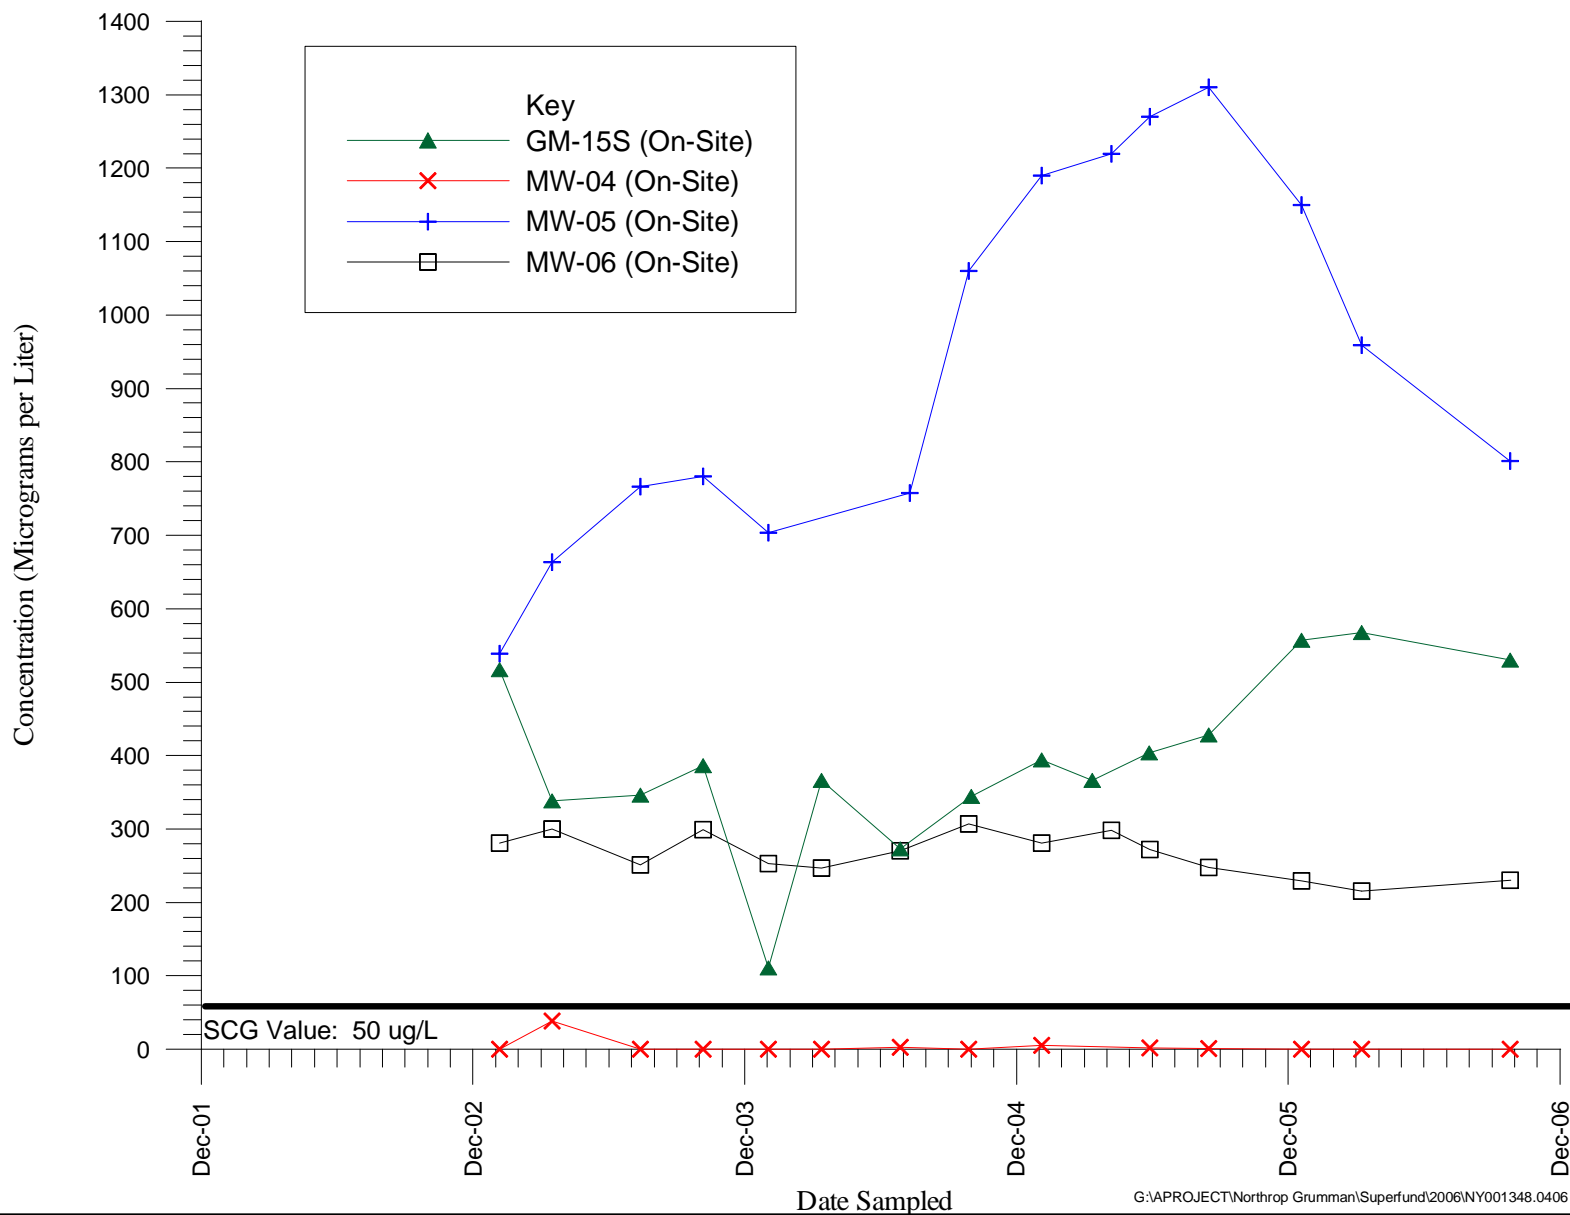

Total Chromium Concentrations in Monitoring Wells
Near Former Plant 1
Northrop Grumman Systems Corporation, Bethpage, New York

FIGURE
12

ARCADIS

Appendix A

Groundwater Sampling Logs and
Chain of Custody Records

Water Sampling Log

Project NORTHROP BRUMMAG Project No. NY001348-0406-00002 Page 1 of
 Site Location BETHPAGE NY Date 11-20-06
 Site/Well No. GM-2FI Replicate No. Code No.
 Weather CLEAR 45° Sampling Time: Begin End

Evacuation Data
 Measuring Point JOC
 MP Elevation (ft)
 Land Surface Elevation (ft)
 Sounded Well Depth (ft bmp) 140
 Depth to ~~Water~~ ^{PACKED} (ft bmp) 129
 Water-Level Elevation (ft) 0 -
 Water Column in Well (ft) 11
 Casing Diameter/Type 4" (0.65)
 Gallons in Well 7.15
 Gallons Pumped/Bailed Prior to Sampling 21.45
 Sample Pump Intake Setting (ft bmp)
 Purge Time begin 2:30 end 3:50
 Pumping Rate (gpm)
 Evacuation Method

Field Parameters	I	IV	2U	3U
Color				COLORLESS
Odor				NONE
Appearance				CLEAR
pH (s.u.)	9.54	9.56	9.75	9.70
Conductivity (mS/cm)				
(µmhos/cm)	115.7	116.8	117.8	117.8
Turbidity (NTU)				13.7
Temperature (°C)	13.8	13.9	13.7	13.6
Dissolved Oxygen (mg/L)				
Salinity (%)				

Sampling Method PACKAGED 3UV
 Remarks PTD - 0.0
DTW 35.80
129 - 35.80 x .43 + 50 = 29.0 PSI
56 ALLOW PAILS 11

Constituents Sampled	Container Description	Number	Preservative

Sampling Personnel GW

Well Casing Volumes

Gal./Ft.	1-1/4" = 0.06	2" = 0.16	3" = 0.37	4" = 0.65
	1-1/2" = 0.09	2-1/2" = 0.26	3-1/2" = 0.50	6" = 1.47

- bmp below measuring point
- ml milliliter
- NTU Nephelometric Turbidity Units
- °C Degrees Celsius
- mS/cm Milisiemens per centimeter
- PVC Polyvinyl chloride
- ft feet
- msl mean sea-level
- s.u. Standard units
- gpm Gallons per minute
- N/A Not Applicable
- µmhos/cm Micromhos per centimeter
- mg/L Miligrams per liter
- NR Not Recorded
- VOC Volatile Organic Compounds

ARCADIS

Low-Flow Groundwater Sampling Log

Project Number: NY 001348, 0406 Task: 00002 Well ID: GM-21D
 Date: 11-20-06 Sampled By: GW
 Sampling Time: _____ Recorded By: GW
 Weather: CLEAR 45° Coded Replicate No.: _____

Instrument Identification

Water Quality Meter(s): OAKTON, YSI DO, OAKTON AGRW Serial #: _____

Purging Information

Casing Material: _____ Purge Method: LOW FLOW
 Casing Diameter: _____ Screen Interval (ft bmp): Top _____ Bottom _____
 Sounded Depth (ft bmp): _____ Pump Intake Depth (ft bmp): _____
 Depth to Water (ft bmp): 41.52 Purge time Start: _____ Finish: _____

Field Parameter Measurements Taken During Purging

Time	Minutes Elapsed	Rate (mL/min)	Volume Purged	Temp (°C)	pH (SI Units)	Spec. Cond. (µS/cm)	ORP (mV)	DO (mg/L)	Turbidity (NTU)	Depth to Water (ft bmp)	Comments
1:15		450			5.05	140.6	-58	5.17		41.52	
1:20					5.04	126.5	-57	4.40			
1:25					5.04	114.5	-33	4.13			
1:30					5.02	101.5	25	4.06			
1:35					5.02	98.5	30	4.57		41.52	
1:40					5.05	96.3	47	4.57			
1:45					5.03	95.3	59	4.57			
1:50					5.01	93.2	77	4.40		41.52	
1:55					5.01	93.1	67	4.63			
2:00					5.02	92.7	61	4.73			
2:05					5.02	92.7	61	4.63			
2:10					5.02	90.9	71	4.73			
2:15					5.02	90.8	70	4.68	133	41.60	

Sample Condition Color: COLORLESS Odor: NONE Appearance: CLEAR

Sample Collection

Parameter: SEE COC Container: _____ No. _____ Preservative: _____

PID Reading 0.0
 Comments DEDICATED BLADDER PUMP

Water Sampling Log

Project NORTHROP-GRUMMAN Project No. NY001348.0406.00002 Page 1 of
 Site Location BETHPAGE NY Date 11-21-06
 Site/Well No. NO GM-20D Replicate No. Code No.
 Weather Sampling Time: Begin End

Evacuation Data	Field Parameters	I	1U	2U	3U
Measuring Point	Color				COLORLESS
MP Elevation (ft)	Odor				NONE
Land Surface Elevation (ft)	Appearance				CLEAR
Sounded Well Depth (ft bmp)	pH (s.u.)	7.21	6.65	6.62	6.32
Depth to ^{PACKER} Water (ft bmp)	Conductivity (µS/cm)				
Water-Level Elevation (ft)	(µmhos/cm)	376	113.1	106.3	105.7
Water Column in Well (ft)	Turbidity (NTU)				9.76
Casing Diameter/Type	Temperature (°C)	11.6	12.7	13.2	12.6
Gallons in Well	Dissolved Oxygen (mg/L)				
Gallons Pumped/Bailed Prior to Sampling	Salinity (%)				
Sample Pump Intake Setting (ft bmp)	Sampling Method				
Purge Time	Remarks	DTW 37.96			
Pumping Rate (gpm)		215 - 37.96 x 4.3 + 50 = 1300 PSI			
Evacuation Method		5 GALLON PAILS 11 1/2			

Constituents Sampled	Container Description	Number	Preservative

Sampling Personnel GW

Well Casing Volumes				
Gal./Ft.	1-1/4" = 0.06	2" = 0.16	3" = 0.37	4" = 0.65
	1-1/2" = 0.09	2-1/2" = 0.26	3-1/2" = 0.50	6" = 1.47

- bmp below measuring point
- ml milliliter
- NTU Nephelometric Turbidity Units
- °C Degrees Celsius
- mS/cm Milisiemens per centimeter
- PVC Polyvinyl chloride
- ft feet
- msl mean sea-level
- s.u. Standard units
- gpm Gallons per minute
- N/A Not Applicable
- umhos/cm Micromhos per centimeter
- mg/L Milligrams per liter
- NR Not Recorded
- VOC Volatile Organic Compounds

Water Sampling Log

Project NORTHERN GRUMMAN Project No. NY 001348-0406-00002 Page 1 of
 Site Location BETHPAGE NY. Date 11-21-06
 Site/Well No. GM-20I Replicate No. Code No.
 Weather Sampling Time: Begin End

Evacuation Data

Measuring Point TOC
 MP Elevation (ft)
 Land Surface Elevation (ft)
 Sounded Well Depth (ft bmp) 105
 Depth to ^{PACKER}Water (ft bmp) 94
 Water-Level Elevation (ft)
 Water Column in Well (ft) 11
 Casing Diameter/Type 4" (0.65)
 Gallons in Well 7.15
 Gallons Pumped/Bailed Prior to Sampling 21.45
 Sample Pump Intake Setting (ft bmp)
 Purge Time begin 10:55 end 12:35
 Pumping Rate (gpm)
 Evacuation Method

Field Parameters

	I	II	2U	3J
Color				<u>Colorless</u>
Odor				<u>None</u>
Appearance				<u>Clear</u>
pH (s.u.)	<u>9.59</u>	<u>10.55</u>	<u>10.65</u>	<u>9.79</u>
Conductivity (µmhos/cm)	<u>123.7</u>	<u>136.7</u>	<u>136.8</u>	<u>139.6</u>
Turbidity (NTU)				<u>10.51</u>
Temperature (°C)	<u>14.8</u>	<u>15.4</u>	<u>15.7</u>	<u>16.3</u>
Dissolved Oxygen (mg/L)				
Salinity (%)				
Sampling Method				

Remarks OTW 34.87
94 - 34.87 x .43 + 50 = 80 PSI
5 GALLON PAILS III 1/2

Constituents Sampled	Container Description	Number	Preservative
<u>SEE COC</u>			

Sampling Personnel G. W.

Well Casing Volumes				
Gal./Ft.	1-1/4" = 0.06	2" = 0.16	3" = 0.37	4" = 0.65
	1-1/2" = 0.09	2-1/2" = 0.26	3-1/2" = 0.50	6" = 1.47

- bmp below measuring point
- °C Degrees Celsius
- ft feet
- gpm Gallons per minute
- mg/L Milligrams per liter
- ml milliliter
- mS/cm Milisiemens per centimeter
- msl mean sea-level
- N/A Not Applicable
- NR Not Recorded
- NTU Nephelometric Turbidity Units
- PVC Polyvinyl chloride
- s.u. Standard units
- umhos/cm Micromhos per centimeter
- VOC Volatile Organic Compounds

ARCADIS

Low-Flow Groundwater Sampling Log

Project Number: NY 001348-0406- Task: 00002 Well ID: GM-79D
Date: 11-21-06 Sampled By: GW
Sampling Time: Recorded By: GW
Weather: CLEAR 50° Coded Replicate No.:

Instrument Identification

Water Quality Meter(s): SEE CAL LOG Serial #:

Purging Information

Casing Material: Purge Method: LOW FLOW
Casing Diameter: Screen Interval (ft bmp): Top Bottom
Sounded Depth (ft bmp): Pump Intake Depth (ft bmp):
Depth to Water (ft bmp): 40.67 Purge time Start: Finish:

Field Parameter Measurements Taken During Purging

Table with 12 columns: Time, Minutes Elapsed, Rate (ml/min), Volume Purged, Temp (°C), pH (SI Units), Spec. Cond. (mS/cm), ORP (mV), DO (mg/L), Turbidity (NTU), Depth to Water (ft bmp), Comments. Data rows show measurements from 2:15 to 3:15.

Sample Condition Color: COLORLESS Odor: NONE Appearance: CLEAR

Sample Collection Parameter: Container: No. Preservative:

PID Reading 0.0

Comments

ARCADIS

Low-Flow Groundwater Sampling Log

Project Number: NY 00 B48 0406 Task: 00002 Well ID: GM-75D-2
 Date: 11-27-06 Sampled By: GD
 Sampling Time: _____ Recorded By: GD
 Weather: _____ Coded Replicate No.: REP 6M-31

Instrument Identification

Water Quality Meter(s): _____ Serial #: _____

Purging Information

Casing Material: _____ Purge Method: LOWFLOW
 Casing Diameter: _____ Screen Interval (ft bmp): Top _____ Bottom _____
 Sounded Depth (ft bmp): _____ Pump Intake Depth (ft bmp): _____
 Depth to Water (ft bmp): 33.80 Purge time Start: _____ Finish: _____

Field Parameter Measurements Taken During Purging

Time	Minutes Elapsed	Rate (mL/min)	Volume Purged	Temp (°C)	pH (SI Units)	Spec. Cond. (mS/cm)	ORP (mV)	DO (mg/L)	Turbidity (NTU)	Depth to Water (ft bmp)	Comments
3:00		450		14.0	4.94	133.0	134	4.96		33.80	
3:05				13.9	4.94	132.4	135	4.90			
3:10				13.8	4.82	130.8	135	4.28			
3:15				13.7	4.82	129.7	136	3.95		33.80	
3:20				13.7	4.86	129.3	136	3.92			
3:25				13.6	4.87	128.9	137	3.87			
3:30				13.6	4.89	129.5	139	3.79			
3:35				13.6	4.90	129.3	139	3.75		33.80	
3:40				13.5	4.90	129.3	140	3.64			
3:45				13.5	4.91	129.2	144	3.67			
3:50				13.4	4.91	129.5	145	3.70			
3:55				13.3	4.91	129.3	146	3.62		33.80	
4:00				13.3	4.91	129.3	148	3.60	6.88		

Sample Condition Color: _____ Odor: _____ Appearance: _____

Sample Collection Parameter: _____ Container: _____ No. _____ Preservative: _____

PID Reading _____

Comments _____

Water Sampling Log

Project ND RTHROP-620 MMA Project No. NY 001348.0406.0000 Page 1 of
 Site Location BETHPAGE NY. AT Date 11-29-06
 Site/Well No. 6M-35D-2 Replicate No. Code No.
 Weather OVERCAST 55° Sampling Time: Begin End

Evacuation Data

Measuring Point TDC
 MP Elevation (ft) -
 Land Surface Elevation (ft) -
 Sounded Well Depth (ft bmp) 530
 Depth to ~~water~~ ^{Packer} (ft bmp) 507
 Water-Level Elevation (ft)
 Water Column in Well (ft) 23
 Casing Diameter/Type 4" (0.65)
 Gallons in Well 14.95
 Gallons Pumped/Bailed Prior to Sampling x 3
45
 Sample Pump Intake Setting (ft bmp)
 Purge Time begin end
 Pumping Rate (gpm)
 Evacuation Method

Field Parameters

	I	10	20	30
Color				<u>COLORLESS</u>
Odor				<u>None</u>
Appearance				<u>CLEAR</u>
pH (s.u.)	<u>6.60</u>	<u>6.60</u>	<u>6.57</u>	<u>6.52</u>
Conductivity (µmhos/cm)	<u>104.4</u>	<u>104.1</u>	<u>86.4</u>	<u>87.1</u>
Turbidity (NTU)				<u>6.29</u>
Temperature (°C)	<u>15.3</u>	<u>15.3</u>	<u>16.0</u>	<u>16.0</u>
Dissolved Oxygen (mg/L)				
Salinity (%)				
Sampling Method				

Remarks DTW - 37.41
5 GAL PAILS III
507-38.41 x .43 + 50 = 255.55

Constituents Sampled	Container Description	Number	Preservative
<u>SEE COC</u>			

Sampling Personnel G. WILLIAMS

Well Casing Volumes

Gal./Ft.	1-1/4" = 0.06	2" = 0.16	3" = 0.37	4" = 0.65
	1-1/2" = 0.09	2-1/2" = 0.26	3-1/2" = 0.50	6" = 1.47

- bmp below measuring point
- ml milliliter
- NTU Nephelometric Turbidity Units
- °C Degrees Celsius
- mS/cm Milisiemens per centimeter
- PVC Polyvinyl chloride
- ft feet
- msl mean sea-level
- s.u. Standard units
- gpm Gallons per minute
- N/A Not Applicable
- umhos/cm Micromhos per centimeter
- mg/L Milligrams per liter
- NR Not Recorded
- VOC Volatile Organic Compounds

ARCADIS

Low-Flow Groundwater Sampling Log

Project Number: NY 001348.016 Task: 00002 Well ID: CM-34D
 Date: 11-30-06 Sampled By: GW
 Sampling Time: _____ Recorded By: GW
 Weather: OVERCAST 50° Coded Replicate No.: _____

Instrument Identification

Water Quality Meter(s): _____ Serial #: _____

Purging Information

Casing Material: _____ Purge Method: LOW FLOW
 Casing Diameter: _____ Screen Interval (ft bmp): Top _____ Bottom _____
 Sounded Depth (ft bmp): _____ Pump Intake Depth (ft bmp): _____
 Depth to Water (ft bmp): 13.07 Purge time Start: _____ Finish: _____

Field Parameter Measurements Taken During Purging

Time	Minutes Elapsed	Rate (mL/min)	Volume Purged	Temp (°C)	pH (SI Units)	Spec. Cond. (mS/cm)	ORP (mV)	DO (mg/L)	Turbidity (NTU)	Depth to Water (ft bmp)	Comments
2:00		450		15.66	6.50	44	92.2	4.92		13.07	
2:05				15.64	6.68	46	87.4	4.54			
2:10				15.55	6.81	45	81.6	4.56		13.13	
2:15				15.50	6.89	45	68.6	4.67			
2:20				15.57	6.59	45	59.1	4.47			
2:25				15.91	6.49	45	50.5	4.68		13.10	
2:30				15.51	6.42	45	50.1	4.57			
2:35				15.71	6.22	45	46.1	4.58			
2:40				15.74	6.36	45	46.4	4.69		13.14	
2:45				15.72	6.22	45	45.7	4.54			
2:50				15.59	6.13	45	45.8	4.47	9.3)		
2:55				15.64	6.11	45	45.9	4.47		13.14	
3:00				15.73	6.14	45	47.5	4.50			

Sample Condition Color: COLORLESS Odor: NONE Appearance: CLEAR

Sample Collection Parameter: _____ Container: _____ No. _____ Preservative: _____

Parameter: SEE CDC Container: _____ No. _____ Preservative: _____

PID Reading 0.0

Comments _____

Water Sampling Log

Project NORTHROP-GUMM Project No. NY001348.0406-0002 Page 1 of
 Site Location BETHPALE NY Date 12-1-06
 Site/Well No. BPDW-2-2 Replicate No. Code No.
 Weather RAINY 50° Sampling Time: Begin End

Evacuation Data

Measuring Point TDC
 MP Elevation (ft)
 Land Surface Elevation (ft)
 Sounded Well Depth (ft bmp) 495
 Depth to ~~Water~~ PAVED (ft bmp) 419
 Water-Level Elevation (ft) 7
 Water Column in Well (ft) 76
 Casing Diameter/Type 4" (0.65)
 Gallons in Well 49.48
 Gallons Pumped/Bailed Prior to Sampling 3
148.20
 Sample Pump Intake Setting (ft bmp)
 Purge Time begin 230 end
 Pumping Rate (gpm)
 Evacuation Method

Field Parameters

	I	10	25	30
Color				<u>COLORLESS</u>
Odor				<u>NOOR</u>
Appearance				<u>CLEAR</u>
pH (s.u.)	<u>4.35</u>	<u>4.62</u>	<u>4.62</u>	<u>4.04</u>
Conductivity (µmhos/cm)	<u>64.8</u>	<u>65.0</u>	<u>64.1</u>	<u>79.3</u>
Turbidity (NTU)				
Temperature (°C)	<u>14.5</u>	<u>13.5</u>	<u>13.6</u>	<u>13.4</u>
Dissolved Oxygen (mg/L)				
DTW Salinity (%)	<u>13.67</u>	<u>2230</u>	<u>2225</u>	<u>20.85</u>

Sampling Method

Remarks DTW-13.67
419-13 x .43 + 50 = 225 PSI

Constituents Sampled	Container Description	Number	Preservative

Sampling Personnel

Well Casing Volumes

Gal./Ft.	1-3/4" = 0.06	2" = 0.16	3" = 0.37	4" = 0.65
	1-1/2" = 0.09	2-1/2" = 0.26	3-1/2" = 0.50	6" = 1.47

- bmp below measuring point
- ml milliliter
- NTU Nephelometric Turbidity Units
- °C Degrees Celsius
- mS/cm Milisiemens per centimeter
- PVC Polyvinyl chloride
- feet
- msl mean sea-level
- s.u. Standard units
- Gallons per minute
- N/A Not Applicable
- µmhos/cm Micromhos per centimeter
- Miligrams per liter
- NR Not Recorded
- VOC Volatile Organic Compounds

Water Sampling Log

Project NORTHROP-6P5M11A Project No. NY 001348. 04/06. 00002 Page 1 of
 Site Location BETHPAGE NY Date 12-1-06
 Site/Well No. BPOW-2-1 Replicate No. Code No.
 Weather RAINY 45° Sampling Time: Begin End

Evacuation Data		Field Parameters			
Measuring Point	<u>TDC</u>	<u>I</u>	<u>10</u>	<u>20</u>	<u>30</u>
MP Elevation (ft)	<u>-</u>	Color			<u>LOWLESS</u>
Land Surface Elevation (ft)	<u>-</u>	Odor			<u>None</u>
Sounded Well Depth (ft bmp)	<u>400</u>	Appearance			<u>Clear</u>
Depth to ^{DAWN} Water (ft bmp)	<u>310</u>	pH (s.u.)	<u>5.76</u>	<u>5.03</u>	<u>5.01</u>
Water-Level Elevation (ft)	<u> </u>	Conductivity (mS/cm)			
Water Column in Well (ft)	<u>90</u>	(umhos/cm)	<u>82.6</u>	<u>126.8</u>	<u>86.1</u>
Casing Diameter/Type	<u>4" (0.63)</u>	Turbidity (NTU)			
Gallons in Well	<u>58.5</u>	Temperature (°C)	<u>16.2</u>	<u>14.2</u>	<u>13.9</u>
Gallons Pumped/Bailed Prior to Sampling	<u>175.5</u>	Dissolved Oxygen (mg/L)			
Sample Pump Intake Setting (ft bmp)	<u> </u>	^{DTW} Salinity (%)	<u>18.59</u>	<u>19.35</u>	<u>19.35</u>
Purge Time	begin <u>1:08</u> end <u>1:37</u>	Sampling Method			<u>Z10</u>
Pumping Rate (gpm)	<u> </u>	Remarks	<u>DTW = 18.59</u>		
Evacuation Method	<u> </u>		<u>310 - 24 x .43 + 50 = 175 P545</u>		
			<u>RAIN NO P511 Round 180</u>		

Constituents Sampled	Container Description	Number	Preservative
<u>SEE CDC</u>			

Sampling Personnel GW

Well Casing Volumes				
Gal./Ft.	1-1/4" = 0.06	2" = 0.16	3" = 0.37	4" = 0.65
	1-1/2" = 0.09	2-1/2" = 0.26	3-1/2" = 0.50	6" = 1.47

- bmp below measuring point
- °C Degrees Celsius
- ft feet
- gpm Gallons per minute
- mg/L Milligrams per liter
- ml milliliter
- mS/cm Milisiemens per centimeter
- msl mean sea-level
- N/A Not Applicable
- NR Not Recorded
- NTU Nephelometric Turbidity Units
- PVC Polyvinyl chloride
- s.u. Standard units
- umhos/cm Micromhos per centimeter
- VOC Volatile Organic Compounds

Water Sampling Log

Project NORTHROP-CROMMAY Project No. NY 0813R0406.0000Z Page 1 of
 Site Location BETHPAGE NY Date 12-6-06
 Site/Well No. BPOW-1-1 Replicate No. RSP 12-6-06 Code No.
 Weather CLEAR 45° Sampling Time: Begin End

Evacuation Data

Measuring Point T8C
 MP Elevation (ft)
 Land Surface Elevation (ft)
 Sounded Well Depth (ft bmp) 241
 Depth to ^{PACUOL}Water (ft bmp) 169
 Water-Level Elevation (ft) -
 Water Column in Well (ft) 72
 Casing Diameter/Type 4 (0.65)
 Gallons in Well 46.8
 Gallons Pumped/Bailed Prior to Sampling 140
 Sample Pump Intake Setting (ft bmp)
 Purge Time begin end
 Pumping Rate (gpm)
 Evacuation Method

Field Parameters

	I	W	20	30
Color				Colorless
Odor				None
Appearance				Clear
pH (s.u.)	6.78	5.61	5.41	5.41
Conductivity (µmhos/cm)	104.5	105.5	105.6	104.7
Turbidity (NTU)				9.33
Temperature (°C)	15.3	13.6	12.9	12.8
Dissolved Oxygen (mg/L)	28.6	28.75	28.55	
Salinity (%)				
Sampling Method	3 WELL VOLUMES			

Remarks

169 - 28.69 x .43 x 50 = 110 P&S

Constituents Sampled	Container Description	Number	Preservative
<u>SEPCOR</u>			
Sampling Personnel	<u>G. WILSON</u>		

Well Casing Volumes

Gal./Ft.	1-1/4" = 0.06	2" = 0.16	3" = 0.37	4" = 0.65
	1-1/2" = 0.09	2-1/2" = 0.26	3-1/2" = 0.50	6" = 1.47

- bmp below measuring point
- °C Degrees Celsius
- ft feet
- gpm Gallons per minute
- mg/L Milligrams per liter
- ml milliliter
- mS/cm Milisiemens per centimeter
- msl mean sea-level
- N/A Not Applicable
- NR Not Recorded
- NTU Nephelometric Turbidity Units
- PVC Polyvinyl chloride
- s.u. Standard units
- µmhos/cm Micromhos per centimeter
- VOC Volatile Organic Compounds

Water Sampling Log

Project NONPOINT GROWTH Project No. NY 201347.0426.0002 Page 1 of 1
 Site Location BETHPAGE Date 12-6-06
 Site/Well No. BPOW-1-2 Replicate No. _____ Code No. _____
 Weather CLEAR 40° Sampling Time: Begin _____ End _____

<p>Evacuation Data</p> <p>Measuring Point _____</p> <p>MP Elevation (ft) _____</p> <p>Land Surface Elevation (ft) _____</p> <p>Sounded Well Depth (ft bmp) <u>335</u></p> <p>Depth to ^{PACKER}Water (ft bmp) <u>294</u></p> <p>Water-Level Elevation (ft) _____</p> <p>Water Column in Well (ft) <u>41</u></p> <p>Casing Diameter/Type <u>(0.65) 4"</u></p> <p>Gallons in Well <u>26.65</u></p> <p>Gallons Pumped/Bailed Prior to Sampling <u>x 3</u> <u>80.00</u></p> <p>Sample Pump Intake Setting (ft bmp) _____</p> <p>Purge Time begin _____ end _____</p> <p>Pumping Rate (gpm) _____</p> <p>Evacuation Method _____</p>	<p>Field Parameters</p> <table border="1"> <tr> <td></td> <td><u>I</u></td> <td><u>10</u></td> <td><u>20</u></td> <td><u>30</u></td> </tr> <tr> <td>Color</td> <td></td> <td></td> <td></td> <td><u>Colorless</u></td> </tr> <tr> <td>Odor</td> <td></td> <td></td> <td></td> <td><u>None</u></td> </tr> <tr> <td>Appearance</td> <td></td> <td></td> <td></td> <td><u>Clear</u></td> </tr> <tr> <td>pH (s.u.)</td> <td><u>5.70</u></td> <td><u>5.35</u></td> <td><u>5.10</u></td> <td><u>4.91</u></td> </tr> <tr> <td>Conductivity (µS/cm)</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>(µmhos/cm)</td> <td><u>44.9</u></td> <td><u>28.6</u></td> <td><u>32.0</u></td> <td><u>45.8</u></td> </tr> <tr> <td>Turbidity (NTU)</td> <td></td> <td></td> <td></td> <td><u>7.75</u></td> </tr> <tr> <td>Temperature (°C)</td> <td><u>14.7</u></td> <td><u>13.2</u></td> <td><u>12.4</u></td> <td><u>12.2</u></td> </tr> <tr> <td>Dissolved Oxygen (mg/L)</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>Salinity (%)</td> <td><u>28.45</u></td> <td><u>30.21</u></td> <td><u>30.41</u></td> <td><u>30.28</u></td> </tr> <tr> <td>Sampling Method</td> <td colspan="4"><u>3 WELL VOLUME</u></td> </tr> <tr> <td>Remarks</td> <td colspan="4"><u>294 - 28.45 x .43 + 50 = 165</u></td> </tr> </table>		<u>I</u>	<u>10</u>	<u>20</u>	<u>30</u>	Color				<u>Colorless</u>	Odor				<u>None</u>	Appearance				<u>Clear</u>	pH (s.u.)	<u>5.70</u>	<u>5.35</u>	<u>5.10</u>	<u>4.91</u>	Conductivity (µS/cm)					(µmhos/cm)	<u>44.9</u>	<u>28.6</u>	<u>32.0</u>	<u>45.8</u>	Turbidity (NTU)				<u>7.75</u>	Temperature (°C)	<u>14.7</u>	<u>13.2</u>	<u>12.4</u>	<u>12.2</u>	Dissolved Oxygen (mg/L)					Salinity (%)	<u>28.45</u>	<u>30.21</u>	<u>30.41</u>	<u>30.28</u>	Sampling Method	<u>3 WELL VOLUME</u>				Remarks	<u>294 - 28.45 x .43 + 50 = 165</u>			
	<u>I</u>	<u>10</u>	<u>20</u>	<u>30</u>																																																														
Color				<u>Colorless</u>																																																														
Odor				<u>None</u>																																																														
Appearance				<u>Clear</u>																																																														
pH (s.u.)	<u>5.70</u>	<u>5.35</u>	<u>5.10</u>	<u>4.91</u>																																																														
Conductivity (µS/cm)																																																																		
(µmhos/cm)	<u>44.9</u>	<u>28.6</u>	<u>32.0</u>	<u>45.8</u>																																																														
Turbidity (NTU)				<u>7.75</u>																																																														
Temperature (°C)	<u>14.7</u>	<u>13.2</u>	<u>12.4</u>	<u>12.2</u>																																																														
Dissolved Oxygen (mg/L)																																																																		
Salinity (%)	<u>28.45</u>	<u>30.21</u>	<u>30.41</u>	<u>30.28</u>																																																														
Sampling Method	<u>3 WELL VOLUME</u>																																																																	
Remarks	<u>294 - 28.45 x .43 + 50 = 165</u>																																																																	

Constituents Sampled	Container Description	Number	Preservative

Sampling Personnel _____

Well Casing Volumes

Gal./Ft.	1-1/4" = 0.06	2" = 0.16	3" = 0.37	4" = 0.65
	1-1/2" = 0.09	2-1/2" = 0.26	3-1/2" = 0.50	6" = 1.47

- | | | | | | |
|------|-----------------------|-------|----------------------------|----------|-------------------------------|
| bmp | below measuring point | ml | milliliter | NTU | Nephelometric Turbidity Units |
| °C | Degrees Celsius | mS/cm | Milisiemens per centimeter | PVC | Polyvinyl chloride |
| ft | feet | msl | mean sea-level | s.u. | Standard units |
| gpm | Gallons per minute | N/A | Not Applicable | µmhos/cm | Micromhos per centimeter |
| mg/L | Miligrams per liter | NR | Not Recorded | VOC | Volatile Organic Compounds |

Water Sampling Log

Project NEEDLEPOD - BRUMMA Project No. NY 001248 0106-0002 Page 1 of
 Site Location BATH RACK Date 12-7-06
 Site/Well No. BLOW-1-3 Replicate No. Code No.
 Weather CLEAR Sampling Time: Begin 10:40 End 11:30

Evacuation Data	Field Parameters	I	10	20	20
Measuring Point <u>TOL</u>	Color				<u>COLORLESS</u>
MP Elevation (ft) <u>-</u>	Odor				<u>NONE</u>
Land Surface Elevation (ft) <u>-</u>	Appearance				<u>CLEAR</u>
Sounded Well Depth (ft bmp) <u>419</u>	pH (s.u.)	<u>5.19</u>	<u>4.85</u>	<u>4.81</u>	<u>3.70</u>
<u>PACKER</u> Depth to Water (ft bmp) <u>344</u>	Conductivity (µS/cm)				
Water-Level Elevation (ft) <u>-</u>	(µmhos/cm)	<u>110</u>	<u>157.6</u>	<u>1162</u>	<u>148</u>
Water Column in Well (ft) <u>75</u>	Turbidity (NTU)				
Casing Diameter/Type <u>4" (0.65)</u>	Temperature (°C)	<u>15.4</u>	<u>14.4</u>	<u>12.9</u>	<u>12.9</u>
Gallons in Well <u>48.75</u>	Dissolved Oxygen (mg/L)				
Gallons Pumped/Bailed Prior to Sampling <u>146.25</u>	<u>DTW</u> Salinity (‰)	<u>30.10</u>	<u>32.45</u>	<u>32.56</u>	<u>32.59</u>
Sample Pump Intake Setting (ft bmp) <u> </u>	Sampling Method	<u> </u>			
Purge Time begin <u> </u> end <u> </u>	Remarks	<u>DTW 30.10</u>			
Pumping Rate (gpm) <u> </u>		<u>344 - 30.10 x .43 + 50 = 185 PSE</u>			
Evacuation Method <u> </u>		<u> </u>			

Constituents Sampled	Container Description	Number	Preservative
<u>SEE COC</u>	<u> </u>	<u> </u>	<u> </u>
<u> </u>	<u> </u>	<u> </u>	<u> </u>
<u> </u>	<u> </u>	<u> </u>	<u> </u>
<u> </u>	<u> </u>	<u> </u>	<u> </u>
<u> </u>	<u> </u>	<u> </u>	<u> </u>
Sampling Personnel <u>GW</u>			

Well Casing Volumes

Gal./Ft.	1-1/4" = 0.06	2" = 0.16	3" = 0.37	4" = 0.65
	1-1/2" = 0.09	2-1/2" = 0.26	3-1/2" = 0.50	6" = 1.47

- bmp below measuring point
- ml milliliter
- °C Degrees Celsius
- mS/cm Milisiemens per centimeter
- ft feet
- msl mean sea-level
- gpm Gallons per minute
- N/A Not Applicable
- mg/L Milligrams per liter
- NR Not Recorded
- NTU Nephelometric Turbidity Units
- PVC Polyvinyl chloride
- s.u. Standard units
- µmhos/cm Micromhos per centimeter
- VOC Volatile Organic Compounds

Water Sampling Log

Project NORTHROP-6 RW MAIN Project No. NY 001348-0406-0802 Page 1 of
 Site Location BETHPAGE NY Date 12-7-06
 Site/Well No. BP100-4-1 Replicate No. Code No.
 Weather CLEAR 50° Sampling Time: Begin 12:00 End

Evacuation Data		
Measuring Point	TOC	
MP Elevation (ft)	-	
Land Surface Elevation (ft)	STAKE	SCREW
Sounded Well Depth (ft bmp)	652	692
Depth to Water (ft bmp)	503	652
Water-Level Elevation (ft)	← 74	
Water Column in Well (ft)	149	40
Casing Diameter/Type	4" (0.65)	2" (0.16)
Gallons in Well	96.51	64
Gallons Pumped/Bailed Prior to Sampling	290 + v3	19.2 + v3 ≈ 310
Sample Pump Intake Setting (ft bmp)		
Purge Time	begin <u> </u>	end <u> </u>
Pumping Rate (gpm)		
Evacuation Method		

Field Parameters	I	W	20	35
Color			4000 SILM	COROL 1835
Odor				SLIGHT E
Appearance				SLIGHTLY PA
pH (s.u.)	5.85	5.87	5.97	3.59
Conductivity (mS/cm)				
(µmhos/cm)	49.6	76.3	57.9	76.6
Turbidity (NTU)				
Temperature (°C)	14.4	14.2	13.5	13.7
Dissolved Oxygen (mg/L)				
Salinity (‰)	26.88	26.65	26.58	26.68
Sampling Method				
Remarks	PST = 692 - 26 × 43 + 50 = 255			

Constituents Sampled	Container Description	Number	Preservative

Sampling Personnel

Well Casing Volumes				
Gal./Ft.	1-¼" = 0.06	2" = 0.16	3" = 0.37	4" = 0.65
	1-½" = 0.09	2-½" = 0.26	3-½" = 0.50	6" = 1.47

- bmp below measuring point
- °C Degrees Celsius
- ft feet
- gpm Gallons per minute
- mg/L Milligrams per liter
- ml milliliter
- mS/cm Milisiemens per centimeter
- msl mean sea-level
- N/A Not Applicable
- NR Not Recorded
- NTU Nephelometric Turbidity Units
- PVC Polyvinyl chloride
- s.u. Standard units
- µmhos/cm Micromhos per centimeter
- VOC Volatile Organic Compounds

Water Sampling Log

Project NICHOLS GRIMMAN Project No. NY00148.04DB.00002 Page 1 of
 Site Location BETHPAGE NY Date 12-7-06
 Site/Well No. BPDW-4-2 Replicate No. MS/MSO Code No.
 Weather CLEAR 50° Sampling Time: Begin 1:45 End

Evacuation Data	Field Parameters	1	2	3
Measuring Point <u>TDC</u>	Color			<u>COLORLESS</u>
MP Elevation (ft) <u>-</u>	Odor			<u>None</u>
Land Surface Elevation (ft) <u>-</u>	Appearance			<u>CLEAR</u>
Sounded Well Depth (ft bmp) <u>764</u>	pH (s.u.)	<u>4.40</u>	<u>5.65</u>	<u>4.43</u>
<u>PACKED</u> Depth to Water (ft bmp) <u>503</u>	Conductivity (µmhos/cm)			
Water-Level Elevation (ft) <u>-</u>	(µmhos/cm)	<u>68.3</u>	<u>121.2</u>	<u>86.6</u>
Water Column in Well (ft) <u>261</u>	Turbidity (NTU)			
Casing Diameter/Type <u>4 (D.65)</u>	Temperature (°C)	<u>14.1</u>	<u>13.4</u>	<u>13.0</u>
Gallons in Well <u>169.65</u>	Dissolved Oxygen (mg/L)			
Gallons Pumped/Bailed Prior to Sampling <u>509</u>	<u>OTW</u> Salinity (%)	<u>23.66</u>	<u>23.45</u>	<u>23.48</u>
Sample Pump Intake Setting (ft bmp) <u> </u>	Sampling Method			
Purge Time begin <u> </u> end <u> </u>	Remarks <u>3 WELLS 1 DOWNS</u>			
Pumping Rate (gpm) <u> </u>				
Evacuation Method <u> </u>				

$503 - 23.66 \times 0.43 + 50 = 233$

Constituents Sampled	Container Description	Number	Preservative
<u>SEE COC</u>			

Sampling Personnel GARY GW

Well Casing Volumes

Gal./Ft.	1-1/4" = 0.06	2" = 0.16	3" = 0.37	4" = 0.65
	1-1/2" = 0.09	2-1/2" = 0.26	3-1/2" = 0.50	6" = 1.47

- bmp below measuring point
- ml milliliter
- NTU Nephelometric Turbidity Units
- °C Degrees Celsius
- mS/cm Milisiemens per centimeter
- PVC Polyvinyl chloride
- ft feet
- msl mean sea-level
- s.u. Standard units
- gpm Gallons per minute
- N/A Not Applicable
- µmhos/cm Micromhos per centimeter
- mg/L Milligrams per liter
- NR Not Recorded
- VOC Volatile Organic Compounds

Water Sampling Log

Project NORTHROP-GRUMMAN Project No. NY00348-04060002 Page 1 of
 Site Location BETAPAGE NY Date 12-8-06
 Site/Well No. BPOW-3-1 Replicate No. Code No.
 Weather Clear 18° Sampling Time: Begin End

Evacuation Data	Field Parameters	7	10	20	30
Measuring Point <u>70C</u>	Color				
MP Elevation (ft) <u>-</u>	Odor				
Land Surface Elevation (ft) <u>-</u>	Appearance				
Sounded Well Depth (ft bmp) <u>516</u>	pH (s.u.) <u>5.24</u>	<u>4.26</u>	<u>4.26</u>		
Depth to Water (ft bmp) <u>414</u>	Conductivity (µS/cm)				
Water-Level Elevation (ft) <u>-</u>	(µmhos/cm) <u>102.2</u>	<u>107.3</u>	<u>106.1</u>		
Water Column in Well (ft) <u>102</u>	Turbidity (NTU)				
Casing Diameter/Type <u>4" (0.65)</u>	Temperature (°C) <u>12.7</u>	<u>13.0</u>	<u>12.7</u>		
Gallons in Well <u>66.3</u>	Dissolved Oxygen (mg/L)				
Gallons Pumped/Bailed Prior to Sampling <u>192.9</u>	Salinity (%) <u>24</u>	<u>30.20</u>	<u>30.20</u>		
Sample Pump Intake Setting (ft bmp) <u> </u>	Sampling Method				
Purge Time begin <u> </u> end <u> </u>	Remarks <u>48</u>				
Pumping Rate (gpm) <u> </u>					
Evacuation Method <u> </u>					

414 - 24 x .43 + 50 = 220 PSE

Constituents Sampled	Container Description	Number	Preservative
<u>SEE CDC</u>			
Sampling Personnel <u>B.W.</u>			

Well Casing Volumes				
Gal./Ft.	1-1/4" = 0.06	2" = 0.16	3" = 0.37	4" = 0.65
	1-1/2" = 0.09	2-1/2" = 0.26	3-1/2" = 0.50	6" = 1.47

- bmp below measuring point
- °C Degrees Celsius
- ft feet
- gpm Gallons per minute
- mg/L Milligrams per liter
- ml milliliter
- mS/cm Milisiemens per centimeter
- msl mean sea-level
- N/A Not Applicable
- NR Not Recorded
- NTU Nephelometric Turbidity Units
- PVC Polyvinyl chloride
- s.u. Standard units
- µmhos/cm Micromhos per centimeter
- VOC Volatile Organic Compounds

Water Sampling Log

Project NDSTAR 26 (LUMMAN) Project No. NY 00348-0106-0002 page 1 of
 Site Location BETHPAGE NY Date
 Site/Well No. BLOW 3-2 Replicate No. Code No.
 Weather CLEAR 20° Sampling Time: Begin 12:00 End

Evacuation Data	Field Parameters	I	10	25	30
Measuring Point	Color				
MP Elevation (ft)	Odor	MODERATE			
Land Surface Elevation (ft)	Appearance				
Sounded Well Depth (ft bmp)	pH (s.u.)	4.86	5.13	4.97	3.18?
Depth to Water (ft bmp)	Conductivity (µmhos/cm)	96.4	122.5	73.5	100.2
Water-Level Elevation (ft)	Turbidity (NTU)				
Water Column in Well (ft)	Temperature (°C)	13.4	13.2	11.1	
Casing Diameter/Type	Dissolved Oxygen (mg/L)				
Gallons in Well	DTW Salinity (%)	25.81	26.42	26.04	26.00
Gallons Pumped/Bailed Prior to Sampling	Sampling Method				
Sample Pump Intake Setting (ft bmp)	Remarks				
Purge Time					
Pumping Rate (gpm)					
Evacuation Method					

Constituents Sampled	Container Description	Number	Preservative
<u>SEE DOC</u>			

Sampling Personnel GLO

Well Casing Volumes				
Gal./Ft.	1-1/4" = 0.06	2" = 0.16	3" = 0.37	4" = 0.65
	1-1/2" = 0.09	2-1/2" = 0.26	3-1/2" = 0.50	6" = 1.47

- bmp below measuring point
- ml milliliter
- NTU Nephelometric Turbidity Units
- °C Degrees Celsius
- mS/cm Milisiemens per centimeter
- PVC Polyvinyl chloride
- ft feet
- msl mean sea-level
- s.u. Standard units
- gpm Gallons per minute
- N/A Not Applicable
- µmhos/cm Micromhos per centimeter
- mg/L Milligrams per liter
- NR Not Recorded
- VOC Volatile Organic Compounds



CHAIN-OF-CUSTODY RECORD

Project Number/Name NYD01318-04106100002
Project Location BETHPAGE NY
Laboratory SPURW-TRENT SUPERDOW
Project Manager MIKE WOLFE
Sampler(s)/Affiliation G.W.

ANALYSIS / METHOD / SIZE
L/DWIT (DGM) ASSE (K)
UD(2000 ASSE) (K)

Sample ID/Location	Matrix	Date/Time Sampled	Lab ID	Remarks	Total
GM-201	L	11-21-06	2		2
GM-20D	L		2		2
GM-791F	L		2		2
GM-791D	L		2		2
TB11-21-06	L		2		2

Sample Matrix: L = Liquid; S = Solid; A = Air

Relinquished by: [Signature] Date 11/21/06 Time 5:00 Seal Intact? Yes No N/A

Received by: [Signature] Organization: ARCADIS Date / / Time / / Seal Intact? Yes No N/A

Relinquished by: _____ Date _____ Time _____ Seal Intact? Yes No N/A

Received by: _____ Date _____ Time _____ Seal Intact? Yes No N/A

Special Instructions/Remarks: REPORT TO MELISSA CALDOL

Total No. of Bottles/Containers 10



OW2 - GRUMANN GUARDIAN
Laboratory Task Order No./P.O. No.

CHAIN-OF-CUSTODY RECORD

Page 1 of 1


Project Number/Name NY01348.0406.00002/MC

Project Location BETHPALL, NY

Laboratory SIL CT

Project Manager DAVE STERN

Sampler(s)/Affiliation P. RUCK / ARCADIS

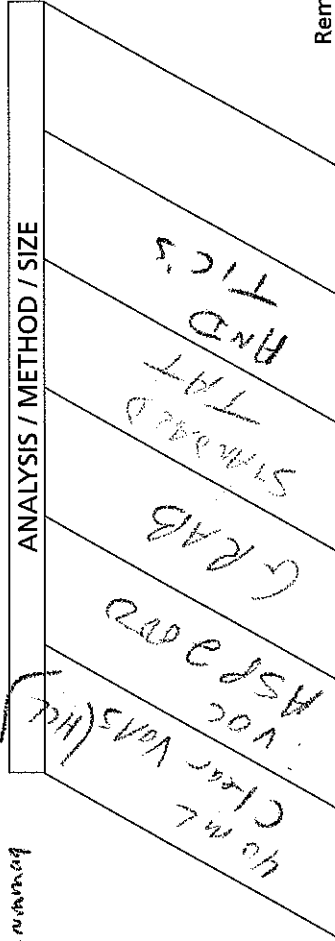

Sample ID/Location	Matrix	Date/Time Sampled	Lab ID	ANALYSIS / METHOD / SIZE	Remarks	Total
T96 EFF	W	12/14/06 3:39				2
T76 INF	L	12/16/06 3:35				2
Well 1		↓ 4:17				2
Well 3		↓ 5:40				2
T102 EFF		12/15/06 9:50				2
T102 INF		16:40				2
Well 17		10:30				2
Well 18		10:35				2
Well 19		↓ 10:55				2
TB12141506	L	12/14/06				2

Sample Matrix: Liquid; Solid; S = Solid; A = Air

Relinquished by: P. Ruck Organization: ARCADIS Date: 12/15/06 Time: 5:00 PM

Received by: _____ Organization: _____ Date: / / Time: _____ Seal Intact? Yes No N/A

Relinquished by: _____ Organization: _____ Date: / / Time: _____ Seal Intact? _____

Received by: _____ Organization: _____ Date: / / Time: _____ Seal Intact? _____

Special Instructions/Remarks: _____

Delivery Method: In Person Common Carrier FedEx Lab Courier Other

