

**Quarterly Operations Report
First Quarter 2012**

**Groundwater Treatment Plant
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant
Bethpage, New York**

**Contract No. N40085-10-D-9409
Contract Task Order No. 0002**

August 2012

Prepared for:



Naval Facilities Engineering Command Mid-Atlantic
9742 Maryland Avenue
Norfolk, VA 23511

Prepared by:



**H&S Environmental, Inc.
160 East Main Street, Suite 2F
Westborough, Massachusetts 01581
(508) 366-7442**

**Quarterly Operations Report
First Quarter 2012**

**Groundwater Treatment Plant
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant
Bethpage, New York**

**Contract No. N40085-10-D-9409
Contract Task Order No. 0002**

August 2012

Prepared for:

Naval Facilities Engineering Command Mid-Atlantic
9742 Maryland Avenue
Norfolk, VA 23511



A handwritten signature in blue ink, appearing to read 'Patrick Schauble'.

Patrick Schauble, P.E.
Program Manager

8/6/12

Date

A handwritten signature in blue ink, appearing to read 'Jennifer Good'.

Jennifer Good, P.G.
Project Manager

8/6/12

Date

TABLE OF CONTENTS

1.0	Introduction.....	1
1.1	Background.....	1
1.2	GWTP Overview	1
2.0	GWTP Operation and Maintenance	2
2.1	Routine Maintenance Activities.....	2
2.2	Non-Routine Maintenance Activities	3
3.0	GWTP Monitoring.....	3
3.1	Process Water Quality Monitoring	3
3.2	Air Quality Monitoring	4
3.3	Groundwater Quality Monitoring	4
	3.3.1 Groundwater Quality Results.....	5
	3.3.2 Quality Assurance/Quality Control Sampling	6
	3.3.3 Groundwater Concentration Trends.....	6
4.0	Conclusions and Recommendations.....	8
4.0	References.....	8

TABLES

TABLE 1	Discharge Monitoring Results – First Quarter 2012
TABLE 2	Air Sampling Results – First Quarter 2012
TABLE 3	Stack Emissions – First Quarter 2012
TABLE 4	Groundwater Level Measurements – March 2012
TABLE 5	Summary of Groundwater Chemistry Results – March 2012
TABLE 6	Summary of Groundwater Analytical Results – March 2012
TABLE 7	Summary of Historical Groundwater Analytical Results

FIGURES

FIGURE 1	Site Map
FIGURE 2	Process Flow Diagram
FIGURE 3	GM-38 Area Site Map
FIGURE 4	Groundwater Concentrations Trends of Select VOCs – RW-1
FIGURE 5	Groundwater Concentrations Trends of Select VOCs – RW-3
FIGURE 6	Groundwater Concentrations Trends of Select VOCs - RW1-MW1
FIGURE 7	Groundwater Concentrations Trends of Select VOCs - RW1-MW3
FIGURE 8	Groundwater Concentrations Trends of Select VOCs - RW2-MW1
FIGURE 9	Groundwater Concentrations Trends of Select VOCs - RW3-MW1

- FIGURE 10 Groundwater Concentrations Trends of Select VOCs - RW1-MW2
- FIGURE 11 Groundwater Concentrations Trends of Select VOCs - RW1-MW3
- FIGURE 12 Groundwater Concentrations Trends of Select VOCs - RW1-MW4
- FIGURE 13 Groundwater Concentrations Trends of Select VOCs - TP-01

APPENDICES

- APPENDIX A NYSDEC Effluent Limitations and Monitoring Requirements and January 2012 – March 2012 DMRs
- APPENDIX B NYSDEC Air Permit Equivalent Approval
- APPENDIX C Field Data Sheets and Chain of Custody Documentation – First Quarter 2012
- APPENDIX D Data Validation Reports – First Quarter 2012
- APPENDIX E Raw Analytical Data – First Quarter 2012

Acronyms and Abbreviations

ARAR	Applicable or Relevant and Appropriate Requirement
AS	air stripper
ASE	air stripper effluent
BFE	bag filter effluent
bgs	below ground surface
CERCLA	Comprehensive Environmental Response Compensation and Liability Act
DAR	Division of Air Resources
DCA	dichloroethane
DCE	dichloroethene
DMR	Discharge Monitoring Report
DO	dissolved oxygen
DoD	Department of Defense
DTW	depth to water
ECL	Environmental Conservation Law
ECOR	ECOR Federal Services, LLC.
EB	equipment rinsate blank
ELAP	Environmental Laboratory Accreditation Program
GOCO	Government Owned Contractor Operated
gpm	gallon per minute
GWTP	groundwater treatment plant
H&S	H&S Environmental, Inc.
HMI	human-machine interface
IRP	Installation Restoration Program
LGAC	liquid-phase granular activated carbon
MS/MSD	matrix spike/matrix spike duplicate
NAVFAC	Naval Facilities Engineering Command Mid-Atlantic
NELAC	National Environmental Accreditation Conference
NGC	Northrop Grumman Corporation
NWIRP	Naval Weapons Industrial Reserve Plant
NYDOH	New York Department of Health
NYSDEC	New York State Department of Environmental Conservation
O&M	Operation and Maintenance
ORP	oxidation reduction potential

OU	operable unit
PCE	tetrachloroethene
PLC	programmable logic controller
QA/QC	quality assurance / quality control
ROD	Record of Decision
RPD	relative percent difference
SC	standard conductivity
scfm	standard cubic feet per minute
SPDES	Storm Pollution Discharge Elimination System
TB	trip blank
TCE	trichloroethene
TE	treated effluent
TSS	total suspended solids
TtEC	Tetra Tech EC, Inc.
USEPA	United States Environmental Protection Agency
VC	vinyl chloride
VGAC	vapor-phase granular activated carbon
VOC	volatile organic compound

1.0 INTRODUCTION

H&S Environmental, Inc. (H&S) has prepared this Quarterly Operations Report for the GM-38 Area Groundwater Treatment Plant (GWTP) at the Naval Weapons Industrial Reserve Plant (NWIRP) in Bethpage, New York. This report has been prepared for the United States Department of the Navy (Navy), Naval Facilities Engineering Command (NAVFAC), Mid-Atlantic, under Contract No. N40085-10-D-9409, Contract Task Order No. 0002. H&S assumed operational responsibility of the GWTP from ECOR Federal Services, LLC (ECOR) on 1 June 2011. This First Quarter 2012 Operations Report details activities that occurred from January 2012 to March 2012. Data collected and operational activities were performed by H&S in accordance with the *Final Operation, Maintenance & Monitoring Plan for Groundwater Treatment Plant GM-38 Area Groundwater Remediation, Naval Weapons Industrial Reserve Plant, Bethpage, New York* prepared by Tetra Tech EC, Inc. (TtEC) in 2010, hereafter referred to as the “O&M Manual.”

1.1 Background

NWIRP Bethpage is located in east central Nassau County, Long Island, New York, approximately 30 miles east of New York City (**Figure 1**) and is currently listed by New York State Department of Environmental Conservation (NYSDEC) as an “inactive hazardous waste site” (#1-30-003B). Historically, the Navy's property totaled approximately 109.5 acres and was a Government Owned Contractor-Operated (GOCO) facility that was operated by the Northrop Grumman Corporation (NGC) until September 1998. NWIRP Bethpage is bordered on the north, west, and south by property owned, or formerly owned, by NGC that covered approximately 605 acres, and on the east by a residential neighborhood.

The GM-38 Area refers to a cluster of monitoring wells installed in the 1990s by NGC. The GM-38 Area is approximately 8,500 feet south southeast and hydraulically down-gradient of NWIRP Bethpage. The GWTP is located within a utility easement with a street address of 100 Broadway.

The “hot spot” cleanup remedy for the GM-38 Area groundwater was originally set forth in Record of Decision (ROD) documents for Operable Unit 2 (OU 2) Groundwater for the Northrop NGC and NWIRP Sites (New York State Registry Site Numbers 1-30-003A & 1-30-003B, respectively) issued by NYSDEC Division of Environmental Remediation in March 2001 and for the NWIRP Bethpage Site by NAVFAC in April 2003 (Revision 1). The selected remedy was chosen in accordance with the New York State Environmental Conservation Law (ECL) and the Navy’s Installation Restoration Program (IRP). It is also consistent with the Comprehensive Environmental Response Compensation and Liability Act (CERCLA), as amended, 42 U.S.C. §§ 9601-9675.

1.2 GWTP Overview

Groundwater is extracted from recovery wells RW-1 and RW-3 and treated in the GWTP. The treatment process consists of flow equalization, air stripping and vapor-phase carbon treatment, bag filtration, liquid-phase carbon treatment and pH adjustment (if needed). Though the GWTP was originally equipped with a pH adjustment system utilizing sodium hydroxide, it has since been determined that pH

adjustment is not necessary and the equipment has been taken off-line and sodium hydroxide sent off site for beneficial reuse. A process flow diagram is presented as **Figure 2**. The treated water is either re-injected into injection well IW-1 or discharged into the Nassau County Recharge Basin #495. Under CERCLA, the Navy is required to meet the effluent requirement in the NYSDEC's Storm Pollution Discharge Elimination System (SPDES) Permit Application as an Applicable or Relevant and Appropriate Requirements (ARAR).

The GWTP was designed to operate at an average flow rate of 1,100 gallons per minute (gpm) (800 gpm from RW-1 and 300 gpm from RW-3), as measured by the average discharge flow rate. It was determined that this flow rate would be necessary to effectively contain the higher concentration of contamination in the GM-38 Area groundwater. Volatile Organic Compounds (VOCs) in the influent groundwater consist of trichloroethene (TCE), tetrachloroethene (PCE), vinyl chloride (VC), cis-1,2-dichloroethene (cis-1,2-DCE), 1,2-dichloroethane (1,2-DCA), benzene, toluene, and total xylenes.

The air stripper (AS) is a structural aluminum tower that is packed with 3.5-inch diameter polypropylene Jaeger Tripack. Groundwater is pumped to the air stripper distribution port and sprayed over the column of Jaeger Tripack at a flow rate of approximately 1,100 gpm. Previously, 100 gpm of recirculated water was also rerouted through the AS, but as of October 2010, recirculation was no longer deemed necessary to the operation of the system. An induced draft countercurrent flow of air enters the air stripper below the base of the packing material at a rate of 8,000 standard cubic feet per minute (scfm). The large surface area of the packing material allows for a mass transfer of the VOCs from the groundwater into the air stream. The VOCs in the off-gas, except for vinyl chloride, are removed via two 20,000-lb vapor phase granular activated carbon (VGAC) units (VGAC-1 and VGAC-2). Vinyl chloride is oxidized by a 20,000-lb potassium permanganate vessel (VGAC-3) into potassium chloride and carbon dioxide. The potassium chloride remains in the pore structure of the zeolite substrate. The treated off-gas is discharged from the stack.

Water treated by the air stripper is passed through three 8,000-lb liquid phase granular activated carbon (LGAC) units in parallel prior to discharge in the recovery basin (or injection well, if necessary).

The GWTP is controlled by a programmable logic controller (PLC)-based digital and analog control system, with instrumentation that monitors pH, pressure, tank level, flow transmitters, differential pressure transmitters, water level in recovery wells, and motor operational status. The information in the PLC is made available to an operator via a human-machine interface (HMI) program. By using this program, the status of the GWTP can be displayed in real time and adjusted, if necessary, by the operator.

2.0 GWTP OPERATION AND MAINTENANCE

While designed to run completely automated, the GWTP requires regular weekly visits by an operator to record and adjust operational parameters and to perform scheduled maintenance.

2.1 Routine Maintenance Activities

Routine maintenance activities at the GWTP were performed during the operator's weekly visits. These activities include general site inspections, collection of operational data (water and vapor flowrates,

differential pressures across the AS, carbon units, bag filter units and blower discharge pressures, tank levels and totalizer readings), measurement of water levels in the recovery wells, adjustment of pump signal settings, collection of vapor and process water samples, changing out of bag filters, switching of lead/lag pump assignments, and preventive maintenance of system equipment. In addition, the following maintenance tasks were also performed during the reporting period:

- The system was shut down from 3-5 January 2012 in order to change out the carbon in VGAC 1 and VGAC 2. The LGAC units were also backwashed during this time.
- On 22 March 2012, the annual backflow preventer inspection was performed. Results were submitted to Bethpage Water District and New York Department of Health (NYDOH), as required.

2.2 Non-routine Maintenance Activities

The following non-routine activities were performed during the First Quarter 2012:

- On 20 January, a vapor leak was observed in a fitting between the air stripper and VGAC train. A temporary solution was enacted while further evaluation was conducted; design of a permanent solution is currently underway.
- On 8 February, the system went down due to a high level AS alarm. The system was restarted following response by the operator, resetting the LGAC feed pump.
- On 25 February, 13 March, 14 March, and 16 March, the system went down due to a power interruption apparently caused by high winds in the area. On each occasion, the system was restarted upon arrival by the operator.

3.0 GWTP MONITORING

The intent of the GWTP is to remove contaminant mass and reduce elevated VOC levels to levels similar to those in the surrounding aquifer. In doing so, impacts on water supply wells and currently unaffected portions of the groundwater aquifer will be minimized. The GWTP is not intended to remediate groundwater contamination in the local aquifer to non-detectable levels (TtEC 2010a). To monitor GWTP effectiveness and for compliance with Federal and State requirements, several process (water and vapor) samples are collected on a monthly basis. In addition, groundwater samples are collected quarterly to monitor water quality and determine the effectiveness of the remediation activities and monitor the hydraulic containment and capture of impacted groundwater by the recovery wells.

3.1 Process Water Quality Monitoring

Processed groundwater is analyzed to comply with calculations submitted by the Navy and approved by NYSDEC Water Division for the effluent limitations and monitoring requirements. These results are also submitted to the NYSDEC on a monthly basis in the form of a Discharge Monitoring Report (DMR). A

copy of the approved NYSDEC effluent limitation and monitoring constituents and the reporting forms are included in **Appendix A**.

Monthly aqueous samples are collected from each recovery well (RW-1 and RW-3), as well as the treated effluent (TE) discharge line. In addition, various intermediary process system samples are collected monthly, consisting of air stripper effluent (ASE), bag filter effluent (BFE), and effluent of each of the three LGAC units (LC1, LC2, and LC3). The analytical results of monthly process water samples collected during the First Quarter 2012 are presented in **Table 1**. The data demonstrates that all permitted constituents were in compliance with regulatory requirements during the First Quarter 2012. **Table 1** also summarizes the average monthly flowrates in gallons per minute along with the total volume of water processed during each month of the First Quarter 2012.

Monthly DMRs for the First Quarter 2012 (January – March 2012) are included as **Appendix A**.

3.2 Air Quality Monitoring

Treated off-gas discharged at the stack of the GWTP is subject to emissions limitations as described by the calculations submitted by the Navy and approved by the NYSDEC Division of Air Resources (DAR) in July 2009. A copy of the NYSDEC approved calculations is included as **Appendix B**.

While only sampling of the stack emissions is required for NYSDEC compliance, vapor samples are also collected using 6-L summa canisters at various locations to monitor for breakthrough of the VGAC units. The analytical results of monthly influent and effluent vapor samples as well as midfluent samples (VC12 and VC13) collected during the First Quarter 2012 are presented in **Table 2**. Air emissions calculations using the stack vapor concentrations along with discharge flowrates are presented in **Table 3**. The calculations demonstrate that all permitted constituents were in compliance regulatory requirements during the quarter based on the emission rates in pounds per hour (lb/hr).

3.3 Groundwater Quality Monitoring

The groundwater monitoring well system at the GM-38 Groundwater Remediation Area consists of 14 monitoring wells (as summarized in **Table 4**), three recovery wells (RW-1, RW-2, RW-3) and one injection well (IW-1). Well locations are depicted on **Figure 3**.

Depth to water (DTW) measurements are collected from 12 of the monitoring wells and water quality samples are collected from eight of the monitoring wells on a quarterly basis. The monitoring network includes well clusters located near the recovery and injection wells as described below and as shown on **Figure 3**. In addition, two wells, GM-38D and GM-38D2, located at the corner of Arthur Avenue and Broadway, are monitored by others.

Quarterly groundwater samples were collected from eight monitoring wells (RW1-MW1, RW1-MW3, RW2-MW1, RW3-MW1, RW3-MW2, RW3-MW3, RW3-MW4, and TP-1). Samples were collected using bladder pumps in accordance with the United States Environmental Protection Agency (USEPA) low-flow sampling methodologies. Results of the groundwater sampling for the First Quarter 2012 are presented in Section 3.3.1 below, and descriptions of monitoring well locations are as follows:

Recovery Well 1 (RW-1) Monitoring Wells

The RW-1 cluster consists of three monitoring wells screened between 395 and 435 feet below ground surface (bgs). RW-1 MW-1 is located approximately 140 feet northwest of RW-1 and RW-1 MW-2 is located approximately 50 feet north of RW-1. RW-1 MW-3 is located approximately 400 feet northeast of RW-1, on the eastern side of Seaford Oyster Bay Expressway. All three wells are hydraulically monitored while only RW-1 MW1 and RW-1 MW-3 are also monitored for water quality.

Recovery Well 2 (RW-2) Monitoring Wells

The RW-2 cluster consists of three monitoring wells screened between 470 and 510 feet bgs. RW-2 MW-1 is located approximately 60 feet northwest of RW-2, RW-2 MW-2 is located approximately 20 feet west of RW-2, and RW-2 MW-3 is located approximately 100 feet west of RW-2. All three wells are hydraulically monitored while only RW-2 MW1 is monitored for water quality.

Recovery Well 3 (RW-3) Monitoring Wells

The RW-3 cluster consists of four monitoring wells; RW-3 MW-1 and RW-3 MW-3 are screened between 320 and 340 ft bgs, RW-3 MW-2 and RW-3 MW-4 are screened between 475 and 495 feet bgs. RW-3 MW-1 and RW-3 MW-2 are located approximately 500 feet west of the GM-38 cluster, at the intersection of Arthur Avenue and Leroy Avenue. RW-3 MW-3 and RW-3 MW-4 are located approximately 400 feet north of the intersection of Arthur Avenue and Broadway. All four wells are both hydraulically monitored and monitored for water quality.

TP-1

TP-1 is screened between 450 and 470 feet bgs and is located approximately 25 feet north of the GWTP building, inside the fenced area. It is hydraulically monitored to observe the change in water levels due to the influence from the pumping rates at the neighboring public water supply well field near the hot spot area and is also monitored for water quality.

Injection Well 1 (IW-1) Monitoring Well

There is one monitoring well associated with injection well IW-1. IW-1 MW-1 is screened between 130 and 150 feet bgs, is located approximately 20 feet south of IW-1, and is only hydraulically monitored.

3.3.1 Groundwater Quality Results

H&S collected groundwater samples for the First Quarter 2012 from 7-8 March 2012. Field parameters measured during well purging, consisting of pH, specific conductance (SC), temperature, oxidation-reduction potential (ORP) and dissolved oxygen (DO), are summarized in **Table 5**. Following stabilization of field parameters, groundwater samples were collected. Copies of the field logs and chain of custody documentation are presented in **Appendix C**.

Groundwater samples were submitted to a National Environmental Laboratory Accreditation Conference (NELAC), Department of Defense (DoD) Environmental Laboratory Accreditation Program (ELAP) certified, laboratory, Analytical Laboratories Services, located in Middletown, PA. The samples are analyzed for VOCs via USEPA Method 624, mercury via USEPA Method SW846 7470A, and total suspended solids (TSS) via USEPA Method SM20 2540D. Validated analytical results of samples

collected during the March 2012 monitoring event are summarized in **Table 6**. The data validation reports are presented in **Appendix D**. Raw analytical data is presented in **Appendix E**.

3.3.2 Quality Assurance/Quality Control Sampling

Quality assurance/quality control (QA/QC) samples were collected during each quarterly groundwater monitoring event in accordance with the *Final Sampling and Analysis Plan* (TtEC 2010a). These samples consisted of blind field duplicates (collected from RW3-MW3 during the First Quarter 2012), matrix spike/matrix spike duplicate (MS/MSD) samples, equipment rinsate blanks (EB) collected at a rate of one per sampling event, and trip blanks (TB) submitted at a rate of one per sample cooler. No contaminants were detected in the equipment or trip blank samples, indicating that there was no apparent cross-contamination of samples during sample collection or transport.

For field duplicate samples, the precision between the original sample and its duplicate is evaluated by calculating the relative percent difference (RPD). RPDs for the First Quarter 2012 sampling event are presented in the data validation report in **Appendix D**. As indicated, all of the calculated RPDs were under 10%. This overall consistency between the samples and its duplicate verifies that proper sample collection methods were followed.

3.3.3 Groundwater Concentration Trends

Historical groundwater analytical results through the First Quarter 2012 are presented in **Table 7**. Concentration trends of select VOCs (cis-1,2-DCE, TCE, and PCE, as well as VC for RW-1) over time for each recovery well (RW-1 and RW-3 sampled monthly) and the eight monitoring wells sampled during the First Quarter 2012 monitoring event are presented in Figures 4 through 13 and discussed below.

Figure 4 presents concentrations detected at recovery well RW-1. Concentrations of TCE have decreased from initial concentrations in early 2010 (maximum value of 710 µg/L detected in February 2010), remaining consistently below 400 µg/L since May 2011. Concentrations of cis-1,2-DCE have followed a similar trend, decreasing from a high of 160 µg/L in February 2010 to below 40 µg/L in February and March 2012. PCE concentrations have also exhibited decreasing trends over time, with concentrations decreasing from 180 µg/L in February 2010 to a low of 78.9 µg/L in March 2012. Concentrations of VC have decreased below initial concentrations in 2010. After reaching a maximum concentration of 61 µg/L in February 2010, concentrations have decreased below 5.0 µg/L in the final quarter of 2011 and first quarter of 2012.

Figure 5 presents concentrations detected at recovery well RW-3. Concentrations of TCE have decreased from initial concentrations in February 2010 (660 µg/L), falling below 300 µg/L several months throughout 2011, with a low of 230 µg/L in June 2011. Concentrations have remained just above 300 µg/L in the first quarter of 2012. Concentrations of cis-1,2-DCE have remained consistently below 4.0 µg/L, and PCE has been detected during only one sampling event in June 2011 (0.69 µg/L).

Figure 6 presents concentrations detected at RW1-MW1. Concentrations of TCE and cis-1,2-DCE in March 2012 (115 µg/L and 179 µg/L, respectively) were higher than initial concentrations observed in May 2005 (53.6 µg/L and 78.6 µg/L, respectively). However, TCE and cis-1,2-DCE remain below the maximum concentrations observed in May 2009 (140 µg/L and 180 µg/L, respectively). Concentrations of PCE have remained consistently below 1.0 µg/L.

Figure 7 presents concentrations detected at RW1-MW3. Concentrations of cis-1,2-DCE and PCE have consistently remained below 1.0 µg/L. Concentrations of TCE have generally remained below 2.0 µg/L, though increased slightly to 2.2 µg/L in March 2012.

Figure 8 presents concentrations detected at RW2-MW1. Concentrations of TCE have decreased substantially from original concentrations observed in May and July 2005 (37.6 µg/L and 34.6 µg/L, respectively). In April 2010, TCE decreased to less than 1.0 µg/L and has remained below 2.0 µg/L. Concentrations of cis-1,2-DCE have remained consistently below 2.0 µg/L, and PCE has not been detected during any sampling event.

Figure 9 presents concentrations detected at RW3-MW1. Concentrations of TCE in March 2012 (59.0 µg/L) have increased since initial concentrations observed in January 2010 (35.0 µg/L), though remain less than maximum TCE concentrations observed in November 2010 (77.6 µg/L). Concentrations of cis-1,2-DCE and PCE have exhibited similar trends, increasing slightly from initial concentrations, but remaining consistently below 2.0 µg/L.

Figure 10 presents concentrations detected at RW3-MW2. TCE reached a maximum concentration of 211 µg/L in April 2010, having increased from initial concentrations observed in January 2010 (160 µg/L). The concentration of TCE detected in March 2012 (96.5 µg/L) has decreased from the initial collected sample, though no overall trend is discernible. Concentrations of cis-1,2-DCE at this location have consistently remained between 1.0 – 2.0 µg/L, and PCE has not been detected during any sampling event.

Figure 11 presents concentrations detected at RW3-MW3. Maximum concentrations of TCE were detected in April 2010 (397 µg/L), having increased slightly from initial concentrations in January 2010 (350 µg/L). The concentration of TCE detected in March 2012 (312 µg/L) has decreased from the initial collected sample, though no overall trend is discernible. Concentrations of cis-1,2-DCE have remained near 2.0 µg/L and PCE has remained below 1.0 µg/L.

Figure 12 presents concentrations detected at RW3-MW4. TCE concentrations have exhibited a decreasing trend since the initial sampling event in January 2010 (21 µg/L) with a detection of 4.6 µg/L in March 2012. PCE had not been detected during any sampling event, and cis-1,2-DCE has not been detected since its detection during the initial sampling event in January 2010 (0.46 µg/L).

Figure 13 presents concentrations detected at TP-01. TCE concentrations have exhibited a decreasing trend since the initial sampling event in January 2010 (65 µg/L), decreasing to 38.1 µg/L in March 2012; concentrations have remained fairly consistently at this level since June 2011. A similar trend exists for concentrations of cis-1,2-DCE; concentrations have decreased from an initial value of 190 µg/L in

January 2010 to 53.3 µg/L in March 2012, with concentrations fluctuating over time. PCE concentrations have remained consistent over time, ranging from 3.3 – 4.7 µg/L.

4.0 CONCLUSIONS AND RECOMMENDATIONS

The intent of the groundwater treatment system at GM-38 is to remove mass and reduce elevated VOC concentrations to levels similar to those in the surrounding aquifer, and in doing so minimize the impacts on water supply wells and currently unaffected portions of the aquifer. Based on the removal of VOCs by the GWTP and decreasing contaminant concentration trends observed in the recovery wells and several of the monitoring wells, progress is being made toward these goals. The GWTP should continue to be operated and monitored on a quarterly basis using the 14 monitoring wells. In addition, the plant should be assessed to optimize the system's performance and an evaluation conducted to better determine the capture zone.

5.0 REFERENCES

Tetra Tech EC, Inc. (TtEC). 2010a. *Final Operation, Maintenance & Monitoring Plan for Groundwater Treatment Plant GM-38 Area Groundwater Remediation, Naval Weapons Industrial Reserve Plant, Bethpage, New York*. April.

Tetra Tech EC, Inc. (TtEC). 2010b. *Final Sampling and Analysis Plan (Field Sampling Plan and Quality Assurance Project Plan), UFP-SAP for Operations, Maintenance, and Monitoring of the Groundwater Treatment Plant, GM-38 Area, Naval Weapons Industrial Reserve Plant, Bethpage, New York*. September.

TABLES

Table 1
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Discharge Monitoring Results
First Quarter 2012

SPDES Parameters	Daily Maximum Goal	Units	January 2012										
			RW-1	RW-3	Combined Influent ⁽¹⁾⁽²⁾ (RW-1 + RW-3)	Air Stripper Effluent (ASE)	Bag Filter Effluent (BFE)	Liquid Carbon 1 Effluent (LC1)	Liquid Carbon 2 Effluent (LC2)	Liquid Carbon 3 Effluent (LC3)	Treated Effluent (TE) ⁽²⁾	Treated Effluent Duplicate	
Process Stream													
Well Depth		ft	500	500	NA	NA	NA	NA	NA	NA	500	500	
Screened Interval		ft	470-500	470-500	NA	NA	NA	NA	NA	NA	470-500	470-500	
Sampling Date			1/8/12										
Average Flowrate	1100	GPM	739	273	1,012	NR	991	NR	NR	NR	1,020	NR	
Total Flow		gallons	32,993,460	12,164,600	45,158,060	NR	44,220,620	NR	NR	NR	45,523,120	NR	
pH	5.5 - 8.5	SU	6.02	8.18	6.60	7.99	7.90	7.79	8	7.54	7.62	7.60	7.60
Carbon Tetrachloride	NA	µg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1-Dichloroethane	5	µg/L	2.7 J	2.6 J	2.7 J	ND	ND	ND	ND	ND	ND	ND	ND
1,2-Dichloroethane	0.6	µg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1-Dichloroethene	5	µg/L	6.4	ND	4.7	ND	ND	ND	ND	ND	ND	ND	ND
cis 1,2-Dichloroethene	5	µg/L	43.4	1.5 J	32.1 J	0.78 J	0.79 J	0.95 J	0.91 J	0.92 J	1.0 J	0.94 J	
trans 1,2-Dichloroethene	5	µg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Tetrachloroethene	5	µg/L	92.7	ND	68	0.51 J	0.54 J	ND	ND	ND	ND	ND	ND
1,1,1-Trichloroethene	5	µg/L	6.7	ND	4.9	ND	ND	ND	ND	ND	ND	ND	ND
Trichloroethene	5	µg/L	364	317	351	3.8	3.8	0.40 J	0.96 J	0.46 J	0.70 J	0.71 J	
Vinyl Chloride	2	µg/L	3.4 J	ND	2.5 J	ND	ND	ND	ND	ND	ND	ND	ND
Mercury	0.25	µg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Total Suspended Solids (TSS)	NA	mg/L	5	5	5	ND	ND	6	ND	ND	ND	ND	ND

Table 1
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Discharge Monitoring Results
First Quarter 2012

SPDES Parameters	Daily Maximum Goal	Units	February 2012										
			RW-1	RW-3	Combined Influent ⁽¹⁾ (RW-1 + RW-3)	Air Stripper Effluent (ASE)	Bag Filter Effluent (BFE)	Liquid Carbon 1 Effluent (LC1)	Liquid Carbon 2 Effluent (LC2)	Liquid Carbon 3 Effluent (LC3)	Treated Effluent (TE)	Treated Effluent (TE) Duplicate	
Process Stream													
Well Depth		ft	500	500	NA	NA	NA	NA	NA	NA	NA	NA	NA
Screened Interval		ft	470-500	470-500	NA	NA	NA	NA	NA	NA	NA	NA	NA
Sampling Date			2/6/12										
Average Flowrate	1100	GPM	758	217	976	NR	991	NR	NR	NR	1007	NR	NR
Total Flow		gallons	31,668,400	9,074,540	40,742,940	NR	40,648,760	NR	NR	NR	42,066,120	NR	NR
pH	5.5 - 8.5	SU	5.98	6.06	6.00	6.07	7.01	7.61	7.53	7.64	7.35	7.35	7.35
Carbon Tetrachloride	NA	µg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1-Dichloroethane	5	µg/L	2.7 J	2.3 J	2.6 J	ND	ND	ND	ND	ND	ND	ND	ND
1,2-Dichloroethane	0.6	µg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1-Dichloroethene	5	µg/L	5.4	1.7 J	4.6 J	ND	ND	ND	ND	ND	ND	ND	ND
cis 1,2-Dichloroethene	5	µg/L	38.6	1.6 J	30.4 J	0.66 J	0.73 J	0.84 J	0.83 J	0.89 J	0.9 J	0.87 J	0.87 J
trans 1,2-Dichloroethene	5	µg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Tetrachloroethene	5	µg/L	97.6	ND	76	0.56 J	0.52 J	ND	ND	ND	ND	ND	ND
1,1,1-Trichloroethene	5	µg/L	4.7 J	ND	3.7 J	ND	ND	ND	ND	ND	ND	ND	ND
Trichloroethene	5	µg/L	338	308	331	3.2	3.1	0.34 J	0.78 J	0.34 J	0.65 J	0.46 J	0.46 J
Vinyl Chloride	2	µg/L	4.3 J	ND	3.3 J	ND	ND	ND	ND	ND	ND	ND	ND
Mercury	0.25	µg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Total Suspended Solids (TSS)	NA	mg/L	ND	ND	ND	ND	5	5	ND	ND	ND	ND	ND

Table 1
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Discharge Monitoring Results
First Quarter 2012

SPDES Parameters	Daily Maximum Goal	Units	March 2012										
			RW-1	RW-3	Combined Influent ⁽¹⁾ (RW-1 + RW-3)	Air Stripper Effluent (ASE)	Bag Filter Effluent (BFE)	Liquid Carbon 1 Effluent (LC1)	Liquid Carbon 2 Effluent (LC2)	Liquid Carbon 3 Effluent (LC3)	Treated Effluent (TE)	Treated Effluent (TE) Duplicate	
Process Stream													
Well Depth		ft	500	500	NA	NA	NA	NA	NA	NA	NA	NA	NA
Screened Interval		ft	470-500	470-500	NA	NA	NA	NA	NA	NA	NA	NA	NA
Sampling Date			3/7/12										
Average Flowrate	1100	GPM	788	201	989	NR	986	NR	NR	NR	1,010	NR	
Total Flow		gallons	35,168,800	8,966,960	44,135,760	NR	44,006,740	NR	NR	NR	45,100,947	NR	
pH	5.5 - 8.5	SU	6.00	6.15	6.03	6.84	7.31	7.60	7.65	7.68	7.53	7.53	
Carbon Tetrachloride	NA	µg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1-Dichloroethane	5	µg/L	2.6 J	2.3 J	2.5 J	ND	ND	ND	ND	ND	ND	ND	ND
1,2-Dichloroethane	0.6	µg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1-Dichloroethene	5	µg/L	5 J	1.2 J	4.2 J	ND	ND	ND	ND	ND	ND	ND	ND
cis 1,2-Dichloroethene	5	µg/L	38.4	1.8 J	31.0 J	0.8 J	0.90 J	1.0	1.0 J	1.0	1.0 J	1.0 J	1.0 J
trans 1,2-Dichloroethene	5	µg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Tetrachloroethene	5	µg/L	78.9	ND	63	0.63 J	0.60 J	ND	ND	ND	ND	ND	ND
1,1,1-Trichloroethene	5	µg/L	5.4 J	ND	4.3 J	ND	ND	ND	ND	ND	ND	ND	ND
Trichloroethene	5	µg/L	333	307	328	3.9	3.9	0.46 J	1.1	0.47 J	0.76 J	0.73 J	
Vinyl Chloride	2	µg/L	2.7 J	ND	2.2 J	ND	ND	ND	ND	ND	ND	ND	ND
Mercury	0.25	µg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Total Suspended Solids (TSS)	NA	mg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND

Notes:

J - Estimated result less than reporting limit

NA - Not Applicable

NR - Not Recorded

gpm - gallons per minute

(1) Influent concentrations presented are the weighted average concentrations of RW-1 and RW-3.

(2) System downtime occurred from 3-5 January 2012 for carbon changeout of the two VGAC units.

Table 2
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Air Sampling Results
First Quarter 2012

DAR Parameters	SGC	Units	January 2012					February 2012					
			Influent (VC11)	VC12	VC23	Effluent	Effluent Duplicate	Influent (VC11)	VC12	VC23	Effluent	Effluent Duplicate	
Process Stream													
Sampling Date			1/20/12					2/17/12					
Average Flowrate		CFM	NR	NR	NR	8,186	NR	NR	NR	NR	NR	8,562	NR
Total Flow ⁽¹⁾		ft ³	NR	NR	NR	365,408,160	NR	NR	NR	NR	NR	357,560,509	NR
Total Flow ⁽²⁾		m ³	NR	NR	NR	10,347,207	NR	NR	NR	NR	NR	10,124,986	NR
1,2-Dichloroethane	-	µg/m ³	5 J	ND	ND	ND	ND	8 J	1 J	1 J	ND	ND	ND
cis 1,2-Dichloroethene	-	µg/m ³	530	2.2 J	3.2	ND	10	390	78	2.5 J	0.86 J	ND	ND
trans 1,2-Dichloroethene	-	µg/m ³	ND	ND	ND	ND	ND	6.6 J	1.7 J	ND	ND	ND	ND
1,2-Dichloroethene (total)	-	µg/m ³	530	2 J	3	ND	ND	400	81	3 J	1 J	ND	ND
Toluene	37000	µg/m ³	9 J	ND	ND	ND	ND	25	4.9	0.83 J	0.93 J	0.5 J	0.5 J
Xylene	4300	µg/m ³	8.1 J	ND	0.91 J	ND	ND	18	3.2 J	1.4 J	1.3 J	ND	ND
1,1,2-Trichloroethane	-	µg/m ³	ND	ND	ND	ND	ND	4.8 J	0.9 J	0.52 J	ND	ND	ND
Trichloroethene	14000	µg/m ³	5,700	36	20	4.7	15	3,400	800	17	12	3.9 J	3.9 J
Vinyl Chloride	180000	µg/m ³	39	36	44	ND	ND	28	10	26	ND	ND	ND
Tetrachloroethene	1000	µg/m ³	1,500	3.5 J	3.6 J	ND	3.7 J	970	95	5 J	4.6 J	2.1 J	2.1 J

Table 2
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Air Sampling Results
First Quarter 2012

DAR Parameters	SGC	Units	March 2012				
			Influent (VC1)	VC12	VC23	Effluent	Effluent Duplicate
Process Stream							
Sampling Date			3/14/12				
Average Flowrate		CFM	NR	NR	NR	8,530	NR
Total Flow ⁽¹⁾		ft ³	NR	NR	NR	380,768,040	NR
Total Flow ⁽²⁾		m ³	NR	NR	NR	10,782,150	NR
1,2-Dichloroethane	-	µg/m ³	6 J	1.20 J	ND	ND	ND
cis 1,2-Dichloroethene	-	µg/m ³	460	68	1.2 J	0.59 J	ND
trans 1,2-Dichloroethene	-	µg/m ³	6.7 J	0.98 J	ND	ND	ND
1,2-Dichloroethene (total)	-	µg/m ³	480	68	1 J	0.59 J	ND
Toluene	37000	µg/m ³	6.4 J	7.6	0.7 J	1.2 J	1.1 J
Xylene	4300	µg/m ³	9.3 J	6.8	1.2 J	ND	0.54 J
1,1,2-Trichloroethane	-	µg/m ³	ND	ND	ND	ND	ND
Trichloroethene	14000	µg/m ³	4,200	820	13	9.7	4.4
Vinyl Chloride	180000	µg/m ³	28	7	18	ND	ND
Tetrachloroethene	1000	µg/m ³	1,100	200	4.6 J	3.7 J	2.3 J

Notes:

ND - Not detected

NR - Not recorded

SGC - Short-term Guideline Concentration

µg/m³ - micrograms per cubic meter

CFM - cubic feet per minute

DAR - Division of Air Resources

⁽¹⁾Total Flow (ft³) = average flowrate (cfm) * operational time (minutes)

⁽²⁾Total Flow (m³) = total flow (ft³) * (0.3048³)m³/ft³

Table 3
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Stack Emissions
First Quarter 2012

DAR Parameters	Discharge Goal	Units	January 2012	February 2012	March 2012
Sampling Date			1/20/12	2/17/12	3/14/12
Average Flowrate		CFM	8,186	8,562	8,530
Total Flow		ft ³	365,408,160	357,560,509	380,768,040
Total Flow		m ³	10,347,207	10,124,986	10,782,150
Trichloroethene	0.09	lb/hr	0.0001	0.0004	0.0003
Vinyl Chloride	0.01	lb/hr	0.0000	0.0000	0.0000
1,2 Dichloroethene	0.03	lb/hr	0.0000	0.0000	0.0000
1,2-Dichloroethane	BRT	lb/hr	0.0000	0.0000	0.0000
Toluene	BRT	lb/hr	0.0000	0.0000	0.0000
Xylene	BRT	lb/hr	0.0000	0.0000	0.0000
1,1,2-Trichloroethane	BRT	lb/hr	0.0000	0.0000	0.0000
Tetrachloroethene	--	lb/hr	0.0000	0.0001	0.0001

Notes:

BRT - Below reporting thresholds

lb/hr - pounds per hour

DAR - Division of Air Resources

CFM - Cubic feet per minute

Stack Emissions = average flowrate (cfm) * (0.3048^{^3})m³/ft³ * conc.(mg/m³) * 0.000001 g/mg * 0.002205 lbs/g *
60 min/hr * operational time (hours)

Table 4
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Groundwater Level Measurements
March 2012

Monitoring Well ID	Date	Time	Well Elevation (ft amsl)	Total Depth (ft)	Screen Interval (ft)	Depth to Water (ft)	Groundwater Elevation (ft amsl)
RW1-MW1	03/07/12	0952	85.86	435	395-435	34.35	51.51
RW1-MW2	03/07/12	0838	87.35	435	395-435	36.44	50.91
RW1-MW3	03/07/12	0920	80.34	435	395-435	28.45	51.89
RW2-MW1	03/07/12	0857	90.75	510	470-510	37.45	53.30
RW2-MW2	03/07/12	0941	90.15	510	470-510	36.89	53.26
RW2-MW3	03/07/12	0939	89.75	510	470-510	36.43	53.32
RW3-MW1	03/07/12	1705	92.22	350	330-350	36.26	55.96
RW3-MW2	03/07/12	1510	91.98	495	475-495	38.71	53.27
RW3-MW3	03/07/12	1345	92.98	340	320-340	37.21	55.77
RW3-MW4	03/07/12	1150	92.92	495	475-495	39.15	53.77
TP-1	03/07/12	0822	85.91	470	450-470	32.81	53.10
IW1-MW1	03/07/12	0842	89.41	150	130-150	34.58	54.83
GM38D	NA	NA	91.37	340	320-340	NA	NA
GM382D	NA	NA	91.57	495	475-495	NA	NA

Notes:

amsl - above mean sea level

ft - feet

NA - Not Available

Table 5
Summary of Final Groundwater Chemistry Data
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Summary of Groundwater Chemistry Results
March 2012

Location	Temp (°C)	pH (SU)	S.C. (uS/cm)	DO (mg/L)	ORP (mV)	Turbidity (NTU)	Color (Visual)
RW1-MW1	15.07	4.60	193	0.43	318.5	14.6	clear
RW1-MW3	13.99	5.14	182	0.22	138.8	2.81	clear
RW2-MW1	12.43	7.75	91	2.49	79.2	5.23	clear
RW3-MW1	8.47	5.02	114	3.40	232.1	115	cloudy orange
RW3-MW2	13.57	4.92	77	3.39	265.9	5.01	clear
RW3-MW3	13.61	5.66	131	0.49	106.2	1.55	clear
RW3-MW4	13.99	4.67	116	0.33	265.2	3.21	clear
TP-1	12.63	5.22	185	0.73	239.9	4.01	clear

Notes:

S.C. = Specific Conductance

mS/cm = milliSiemens per centimeter

NTU = nephelometric turbidity units

mg/L = milligrams per liter

°C = degrees celsius

mV = millivolts

SU = standard units

ORP = oxidation/reduction potential

Table 6
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Summary of Detected Groundwater Analytical Results
March 2012

Sample ID	RW1-MW1	RW1-MW3	RW2-MW1	RW3-MW1	RW3-MW2	RW3-MW3		RW3-MW4	TP-01
Sample Date	3/8/2012	3/8/2012	3/7/2012	3/7/2012	3/8/2012	3/7/2012	3/7/2012	3/7/2012	3/8/2012
Comments							Duplicate		
VOCS (EPA 624) ug/L									
Benzene	ND	ND	0.22 J	ND	ND	ND	ND	ND	ND
Chloroform	ND	0.73 J	ND	ND	ND	0.42 J	0.42 J	0.38 J	0.74 J
1,1-dichloroethane	5.2	8.4	0.50 J	0.90 J	0.41 J	3.3	3.3	1.8	3.7
1,2-dichloroethane	ND	ND	ND	0.43 J	ND	ND	ND	ND	ND
1,1-dichloroethene	2.7	1.8	ND	0.47 J	0.27 J	1.9	1.9	0.21 J	1
cis-1,2-dichloroethene	179	0.68 J	0.34 J	0.37 J	1.3	2.1	2.1	ND	53.3
trans-1,2-dichloroethene	3.0	ND	ND	ND	ND	ND	ND	ND	0.87 J
Tetrachloroethene	ND	0.65 J	ND	1.0	ND	0.72 J	0.69 J	ND	4.7
Toluene	ND	ND	0.19 J	ND	ND	ND	ND	ND	ND
1,1,1-trichloroethane	0.96 J	1.8	ND	0.58 J	ND	0.84 J	0.87 J	ND	0.57 J
1,1,2-trichloroethane	ND	0.70 J	ND	ND	0.32 J	ND	ND	ND	ND
Trichloroethene	115	2.2	0.67 J	59.0	96.5	312	325	4.6	38.1
Mercury (EPA 245.1) ug/L	ND	ND	ND	ND	ND	ND	ND	ND	ND
TSS (SM20 2540D) mg/L	16	5	6	NR	8	ND	ND	5	7

Note:

J = estimated value
 ND = not detected
 mg/L = milligrams per liter
 µg/L = micrograms per liter

Samples were analyzed for TCL VOCs by Method 624. Only those analytes detected are presented above.

Table 7
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Summary of Historical Groundwater Analytical Results

Sample ID	RW1-MW1												
	5/4/2005	7/22/2005	5/27/2009	1/21/2010	4/21/2010	7/28/2010	11/10/2010	3/25/2011	6/14/2011 ⁽¹⁾	6/14/2011	9/28/2011	11/30/2011	3/8/2012
Sample Date													
Comments										Duplicate			
Well Depth (Ft)	435												
Screened Interval (Ft)	395-435												
VOCS (EPA 624) ug/L													
Acrolein	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
Acrylonitrile	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
Acetone	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND	ND
Benzene	ND	ND	ND	ND	ND	ND	ND	ND	NR	NR	ND	ND	ND
Bromodichloromethane	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND	ND
Bromoform	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND	ND
Bromomethane	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND	ND
Carbon tetrachloride	ND	ND	0.32J	ND	ND	ND	0.17J	ND	NR	NR	ND	ND	ND
Chlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND	NR	NR	ND	ND	ND
Dibromochloromethane	NR	NR	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND	ND
Chloroethane	ND	ND	ND	ND	ND	ND	ND	ND	NR	NR	ND	ND	ND
2-chloroethylvinyl ether	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
Chloroform	ND	0.7J	1.1	ND	0.70J	0.65J	0.56J	0.55J	NR	NR	ND	ND	ND
Chloromethane	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND	ND
1,2-dichlorobenzene	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
1,3-dichlorobenzene	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
1,4-dichlorobenzene	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
1,1-dichloroethane	0.74J	0.79J	3.3	2.9J	2.8	2.8	3.0	3.6	1.6 J	4.2 J	4.0 J	4.1	5.2
1,2-dichloroethane	ND	ND	0.29J	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1-dichloroethene	1.3	2.8	3.1	1.7J	1.9	1.7	1.7	1.9	0.85 J	2.1 J	2.3 J	2.1	2.7
cis-1,2-dichloroethene	78.6	80.4	180D	130	121	118	108	121	55.8 J	145 J	164	132	179
trans-1,2-dichloroethene	2.0	1.3J	2.8	4J	2.9	2.1	1.3	4.2	0.71 J	2.0 J	2.0 J	1.7	3.0
1,2-dichloropropane	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND	ND
cis-1,3-dichloropropene	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND	ND
trans-1,3-dichloropropene	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND	ND
Ethylbenzene	ND	ND	ND	ND	ND	ND	ND	ND	NR	NR	ND	ND	ND
Methylene chloride	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND	ND
1,1,2,2-tetrachloroethane	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND	ND
Tetrachloroethene	ND	ND	0.72J	ND	0.42J	ND	ND	ND	ND	ND	0.36 J	ND	ND
Toluene	ND	0.33J	0.68	ND	ND	ND	ND	ND	NR	NR	ND	ND	ND
1,1,1-trichloroethane	ND	ND	0.71J	ND	0.52J	0.43J	0.53J	0.79J	ND	0.63 J	1.1 J	0.66 J	0.96 J
1,1,2-trichloroethane	ND	ND	0.58J	NR	ND	ND	ND	ND	NR	NR	ND	0.33 J	ND
Trichloroethene	53.6	52.7	140.0	79.0	116	95.4	84.2	97.6	26.6 J	73.8 J	129	84.5	115
Trichlorofluoromethane	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
Vinyl chloride	ND	ND	1.6	ND	ND	ND	0.17J	ND	ND	0.38 J	0.29 J	ND	ND
Mercury (EPA 245.1) ug/L	NR	NR	ND	0.20	<0.20	<0.20	<0.20	<0.20	ND	ND	ND	ND	ND
TSS (SM20 2540D) mg/L	NR	NR	2.8	2.8	6.0	4.0	4.0	4.0	ND	6	ND	11	16

Table 7
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Summary of Historical Groundwater Analytical Results

Sample ID	RW1-MW2			RW1-MW3								
	5/4/2005	7/22/2005	5/28/2009	1/20/2010	4/21/2010	7/29/2010	11/10/2010	3/25/2011	6/14/2011	9/28/2011	11/30/2011	3/8/2012
Sample Date												
Comments												
Well Depth (Ft)	435			435								
Screened Interval (Ft)	395-435			395-435								
VOCS (EPA 624) ug/L												
Acrolein	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	ND
Acrylonitrile	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	ND
Acetone	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND
Benzene	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND
Bromodichloromethane	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND
Bromoform	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND
Bromomethane	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND
Carbon tetrachloride	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND
Chlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND
Dibromochloromethane	NR	NR	ND	NR	NR	NR	NR	NR	NR	ND	ND	ND
Chloroethane	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND
2-chloroethylvinyl ether	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
Chloroform	ND	1.4	ND	0.67J	0.80J	0.47J	0.69J	0.73J	NR	0.97 J	ND	0.73 J
Chloromethane	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND
1,2-dichlorobenzene	NR	NR	ND	NR	NR	NR	NR	NR	NR	ND	ND	ND
1,3-dichlorobenzene	NR	NR	ND	NR	NR	NR	NR	NR	NR	ND	ND	ND
1,4-dichlorobenzene	NR	NR	ND	NR	NR	NR	NR	NR	NR	ND	ND	ND
1,1-dichloroethane	4.6	5.5	3.4	2.4	4.6	1.5	2.3	2.4	9.3	10.1 J	2.1	8.4
1,2-dichloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1-dichloroethene	3.2	12.3	ND	0.42J	1.10	ND	0.28J	ND	1.8	2.2 J	ND	1.8
cis-1,2-dichloroethene	181.0	47.6	160.0	0.54J	0.48J	0.36J	0.55J	0.58J	0.59 J	0.43 J	0.55 J	0.68 J
trans-1,2-dichloroethene	2.5	7.6	2.5	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2-dichloropropane	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND
cis-1,3-dichloropropene	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND
trans-1,3-dichloropropene	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND
Ethylbenzene	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND
Methylene chloride	1.0	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND
1,1,2,2-tetrachloroethane	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND
Tetrachloroethene	ND	134.0	19.0	ND	049J	ND	ND	ND	0.33 J	0.62 J	ND	0.65 J
Toluene	0.32J	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND
1,1,1-trichloroethane	1.3	1.0	ND	0.41J	0.98J	ND	0.26J	0.33J	1.6	2.7 J	ND	ND
1,1,2-trichloroethane	ND	0.65J	ND	0.62J	0.60J	0.36J	0.55J	0.41J	NR	0.57 J	0.63 J	0.70 J
Trichloroethene	158.0	198.0	200.0	1.2	1.6	0.58J	0.91J	1.0	1.4	1.8 J	1.0 J	2.2
Trichlorofluoromethane	NR	NR	ND	NR	NR	NR	NR	NR	NR	ND	ND	ND
Vinyl chloride	12.9	187.0	4.1	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mercury (EPA 245.1) ug/L	NR	NR	0.20	NR	<0.20	<0.20	<0.20	<0.20	ND	ND	ND	ND
TSS (SM20 2540D) mg/L	NR	NR	4.0	NR	8.0	<4.0	<4.0	<4.0	ND	ND	ND	5

Table 7
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Summary of Historical Groundwater Analytical Results

Sample ID	RW2-MW1											
	5/4/2005	7/20/2005	5/27/2009	1/18/2010	4/21/2010	7/28/2010	11/3/2010	3/24/2011	6/14/2011	9/27/2011	11/29/2011	3/7/2012
Sample Date												
Comments	EPA 624											
Well Depth (Ft)	510											
Screened Interval (Ft)	470-510											
VOCS (EPA 624) ug/L												
Acrolein	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	ND
Acrylonitrile	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	ND
Acetone	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND
Benzene	ND	ND	ND	ND	0.15J	0.69J	0.58J	0.30J	NR	NR	0.22 J	0.27 J
Bromodichloromethane	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND
Bromoform	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND
Bromomethane	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND
Carbon tetrachloride	ND	ND	ND	ND	ND	ND	ND	ND	NR	NR	ND	ND
Chlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND	NR	NR	ND	ND
Dibromochloromethane	NR	NR	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND
Chloroethane	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND
2-chloroethylvinyl ether	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	ND
Chloroform	ND	ND	ND	ND	ND	ND	ND	ND	NR	NR	ND	ND
Chloromethane	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND
1,2-dichlorobenzene	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	ND	ND
1,3-dichlorobenzene	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	ND	ND
1,4-dichlorobenzene	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	ND	ND
1,1-dichloroethane	0.53J	0.93J	1.2J	0.82J	0.60J	0.58J	0.42J	ND	0.61 J	0.64 J	ND	0.50 J
1,2-dichloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1-dichloroethene	ND	0.58J	0.55J	0.63J	ND	ND	ND	ND	ND	ND	ND	ND
cis-1,2-dichloroethene	ND	0.55J	1.9	1.0	0.78J	0.80J	0.55J	0.43J	0.56 J	0.32 J	0.39 J	0.34 J
trans-1,2-dichloroethene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2-dichloropropane	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND
cis-1,3-dichloropropene	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND
trans-1,3-dichloropropene	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND
Ethylbenzene	ND	ND	ND	ND	ND	ND	ND	ND	NR	NR	ND	ND
Methylene chloride	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND
1,1,2,2-tetrachloroethane	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	ND	ND
Tetrachloroethene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Toluene	ND	0.85J	1.0	ND	0.52J	0.49J	0.50J	ND	NR	NR	0.24 J	0.29 J
1,1,1-trichloroethane	ND	0.37J	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1,2-trichloroethane	ND	ND	ND	ND	ND	ND	ND	ND	NR	NR	ND	ND
Trichloroethene	37.6	34.6	12.0	15.0	0.42J	ND	ND	1.7	1.6	0.89 J	0.67 J	0.67 J
Trichlorofluoromethane	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	ND	ND
Vinyl chloride	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mercury (EPA 245.1) ug/L	NR	NR	0.05J	NR	<0.20	<0.20	<0.20	<0.20	ND	ND	ND	ND
TSS (SM20 2540D) mg/L	NR	NR	2260.0	NR	58.0	<4.0	<4.0	<4.0	181	5	36	6

Table 7
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Summary of Historical Groundwater Analytical Results

Sample ID	RW2-MW3			RW3-MW1										
	5/3/2005	7/20/2005	5/28/2009	1/19/2010	4/22/2010	7/29/2010	11/9/2010	3/25/2011	3/25/2011	6/14/2011	9/27/2011	11/30/2011	11/30/2011	3/7/2012
Comments									duplicate					duplicate
Well Depth (Ft)	510			350										
Screened Interval (Ft)	470-510			330-350										
VOCS (EPA 624) ug/L														
Acrolein	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
Acrylonitrile	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
Acetone	ND	ND	ND	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Benzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Bromodichloromethane	ND	ND	ND	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Bromoform	ND	ND	ND	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Bromomethane	ND	ND	ND	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Carbon tetrachloride	ND	ND	ND	ND	ND	ND	0.19J	ND	ND	NR	ND	ND	ND	ND
Chlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Dibromochloromethane	NR	NR	ND	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Chloroethane	ND	ND	ND	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
2-chloroethylvinyl ether	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND
Chloroform	ND	ND	ND	ND	ND	ND	0.20J	ND	ND	NR	ND	ND	ND	ND
Chloromethane	ND	ND	ND	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
1,2-dichlorobenzene	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND
1,3-dichlorobenzene	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND
1,4-dichlorobenzene	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND
1,1-dichloroethane	0.68J	0.31J	1.4	1.6	1.5	1.7	1.4	1.3	1.3	1.1	1.0 J	0.96 J	0.93 J	0.90 J
1,2-dichloroethane	ND	ND	ND	0.27J	ND	ND	ND	ND	ND	ND	0.57 J	ND	ND	0.43 J
1,1-dichloroethene	ND	ND	0.42J	1.2	1.3	1.2	1.2	1.2	1.1	0.85 J	0.65 J	0.64 J	0.66 J	0.47 J
cis-1,2-dichloroethene	0.40J	0.66J	2.3	0.37J	ND	0.32J	0.45J	0.47J	0.45J	0.48 J	0.31 J	0.36 J	0.43 J	0.37 J
trans-1,2-dichloroethene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2-dichloropropane	ND	ND	ND	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
cis-1,3-dichloropropene	ND	ND	ND	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
trans-1,3-dichloropropene	ND	ND	ND	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Ethylbenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Methylene chloride	ND	ND	ND	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
1,1,2,2-tetrachloroethane	ND	ND	ND	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Tetrachloroethene	ND	ND	ND	0.49J	0.81J	0.73J	1.5	1.4	1.6	1.2	1.3 J	1.0	1.1	1.0
Toluene	ND	0.50J	0.39J	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
1,1,1-trichloroethane	ND	ND	ND	ND	0.98J	0.84J	1.2	1.1	1.1	0.78 J	1.0 J	0.59 J	0.63 J	0.58 J
1,1,2-trichloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Trichloroethene	16.2	20.6	18.0	35.0	53.2	52.3	77.6	76.2	77.9	63.1	72.4 J	51.0	55.2	59.0
Trichlorofluoromethane	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND
Vinyl chloride	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mercury (EPA 245.1) ug/L	NR	NR	ND	NR	<0.20	<0.20	<0.20	<0.20	<0.20	ND	ND	ND	ND	ND
TSS (SM20 2540D) mg/L	NR	NR	14.8	NR	<4.0	<4.0	<4.0	<4.0	<4.0	5160	ND	ND	ND	NR

Table 7
 GM-38 Area Groundwater Remediation
 Groundwater Treatment Plant
 Naval Weapons Industrial Reserve Plant - Bethpage, NY
 Summary of Historical Groundwater Analytical Results

Sample ID	RW2-MW2		RW3-MW2										
	5/4/2005	7/21/2005	1/19/2010	1/19/2010 duplicate	4/22/2010	7/29/2010	11/9/2010 duplicate	11/9/2010	3/25/2011	6/14/2011	9/27/2011	11/30/2011	3/8/2012
Comments													
Well Depth (Ft)	510		495										
Screened Interval (Ft)	470-510		475-495										
VOCS (EPA 624) ug/L													
Acrolein	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
Acrylonitrile	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
Acetone	ND	ND	NR	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
Benzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND
Bromodichloromethane	ND	ND	NR	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
Bromoform	ND	ND	NR	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
Bromomethane	ND	ND	NR	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
Carbon tetrachloride	ND	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND
Chlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND
Dibromochloromethane	NR	NR	NR	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
Chloroethane	ND	ND	NR	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
2-chloroethylvinyl ether	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
Chloroform	ND	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND
Chloromethane	ND	ND	NR	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
1,2-dichlorobenzene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
1,3-dichlorobenzene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
1,4-dichlorobenzene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
1,1-dichloroethane	ND	0.78J	ND	ND	0.54J	ND	ND	ND	ND	0.52 J	0.37 J	ND	0.41 J
1,2-dichloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1-dichloroethene	ND	0.41J	ND	ND	1.2	ND	ND	ND	ND	0.57 J	0.45 J	0.27 J	0.27 J
cis-1,2-dichloroethene	0.33J	0.41J	1.5J	1.6J	2.4	1.1	0.92J	0.92J	1.6	1.7	1.1	1.4	1.3
trans-1,2-dichloroethene	ND	ND	ND	ND	0.43 J	ND	ND	ND	ND	ND	ND	ND	ND
1,2-dichloropropane	ND	ND	NR	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
cis-1,3-dichloropropene	ND	ND	NR	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
trans-1,3-dichloropropene	ND	ND	NR	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
Ethylbenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND
Methylene chloride	ND	ND	NR	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
1,1,2,2-tetrachloroethane	ND	ND	NR	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
Tetrachloroethene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Toluene	0.33J	0.53J	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND
1,1,1-trichloroethane	ND	ND	ND	ND	0.58J	ND	ND	ND	ND	0.39 J	0.43 J	ND	ND
1,1,2-trichloroethane	D	ND	ND	ND	ND	ND	0.25 J	0.27J	ND	NR	0.32 J	0.32 J	0.32 J
Trichloroethene	7.8	13.8	160	170	211	73	58.2	60.9	110	135	151	71.9	96.5
Trichlorofluoromethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
Vinyl chloride	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mercury (EPA 245.1) ug/L	NR	NR	NR	NR	<0.20	<0.20	<0.20	<0.20	<0.20	ND	ND	ND	ND
TSS (SM20 2540D) mg/L	NR	NR	NR	NR	5.0	6.0	ND	10.0	10.0	7	6	ND	8

Table 7
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Summary of Historical Groundwater Analytical Results

Sample ID	RW3-MW3										
	1/20/2010	4/22/2010	4/22/2010	7/28/2010	11/3/2010 ⁽¹⁾	3/25/2011	6/15/2011	9/28/2011	11/29/2011	3/7/2012	3/7/2012
Sample Date			duplicate								duplicate
Comments											
Well Depth (Ft)	340										
Screened Interval (Ft)	320-340										
VOCS (EPA 624) ug/L											
Acrolein	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND
Acrylonitrile	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND
Acetone	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Benzene	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Bromodichloromethane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Bromoform	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Bromomethane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Carbon tetrachloride	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Chlorobenzene	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Dibromochloromethane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Chloroethane	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND
2-chloroethylvinyl ether	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND
Chloroform	ND	ND	0.40J	0.46J	ND	0.33J	NR	0.48 J	ND	0.42 J	0.42 J
Chloromethane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
1,2-dichlorobenzene	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND
1,3-dichlorobenzene	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND
1,4-dichlorobenzene	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND
1,1-dichloroethane	ND	1.6	1.6	2.3	1.0	1.5	7.1	3.2 J	1.5	3.3	3.3
1,2-dichloroethane	ND	0.52J	0.54J	ND	ND	ND	0.37 J	ND	ND	ND	ND
1,1-dichloroethene	ND	1.1	1.3	1.2	ND	0.96J	2.6	1.8 J	0.96 J	1.9	1.9
cis-1,2-dichloroethene	ND	2.1	2.1	1.7	ND	2.3	1.2	1.9	2.1	2.1	2.1
trans-1,2-dichloroethene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2-dichloropropane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
cis-1,3-dichloropropene	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
trans-1,3-dichloropropene	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Ethylbenzene	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Methylene chloride	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
1,1,2,2-tetrachloroethane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Tetrachloroethene	ND	0.45J	0.49J	ND	ND	ND	0.40 J	0.50 J	ND	0.72 J	0.69 J
Toluene	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
1,1,1-trichloroethane	ND	0.95J	1.0J	0.72J	ND	0.62J	1.3	1.0 J	0.49 J	0.84 J	0.87 J
1,1,2-trichloroethane	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND
Trichloroethene	350	397	382	297	8.5	288	331	215 J	250	312	325
Trichlorofluoromethane	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND
Vinyl chloride	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mercury (EPA 245.1) ug/L	NR	<0.20	<0.20	<0.20	<0.20	ND	ND	ND	ND	ND	ND
TSS (SM20 2540D) mg/L	NR	4.0	5.0	<4.0	<4.0	<4.0	ND	ND	ND	ND	ND

Table 7
 GM-38 Area Groundwater Remediation
 Groundwater Treatment Plant
 Naval Weapons Industrial Reserve Plant - Bethpage, NY
 Summary of Historical Groundwater Analytical Results

Sample ID	RW3-MW4									
Sample Date	1/20/2010	4/22/2010	7/28/2010	7/28/2010	11/3/2010 ⁽¹⁾	3/24/2011	6/15/2011	9/28/2011	11/29/2011	3/7/2012
Comments				duplicate						
Well Depth (Ft)	495									
Screened Interval (Ft)	475-495									
VOCS (EPA 624) ug/L										
Acrolein	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
Acrylonitrile	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
Acetone	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
Benzene	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND
Bromodichloromethane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
Bromoform	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
Bromomethane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
Carbon tetrachloride	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND
Chlorobenzene	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND
Dibromochloromethane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
Chloroethane	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
2-chloroethylvinyl ether	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
Chloroform	ND	ND	ND	ND	0.32J	ND	NR	0.87 J	ND	0.38 J
Chloromethane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
1,2-dichlorobenzene	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
1,3-dichlorobenzene	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
1,4-dichlorobenzene	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
1,1-dichloroethane	2.5	0.6	0.54J	0.50J	1.8	0.81	0.78 J	5.4 J	0.84 J	1.8
1,2-dichloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1-dichloroethene	1.0	ND	ND	ND	0.86J	ND	0.20 J	0.53 J	ND	0.21 J
cis-1,2-dichloroethene	0.46J	ND	ND	ND	1.6	ND	ND	ND	ND	ND
trans-1,2-dichloroethene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2-dichloropropane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
cis-1,3-dichloropropene	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
trans-1,3-dichloropropene	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
Ethylbenzene	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND
Methylene chloride	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
1,1,2,2-tetrachloroethane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND
Tetrachloroethene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Toluene	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND
1,1,1-trichloroethane	ND	ND	ND	ND	0.67J	ND	ND	0.66 J	ND	ND
1,1,2-trichloroethane	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND
Trichloroethene	21	11	7.5	8.0	308	7.7	6.7	3.4 J	5.6	4.6
Trichlorofluoromethane	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND
Vinyl chloride	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mercury (EPA 245.1) ug/L	NR	<0.20	<0.20	<0.20	<0.20	<0.20	ND	ND	ND	ND
TSS (SM20 2540D) mg/L	NR	16.0	<4.0	<4.0	<4.0	<4.0	ND	11	6	5

Table 7
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Summary of Historical Groundwater Analytical Results

Sample ID	TP-01						IW-1 MW-1	IW-1
	1/21/2010	6/15/2011	9/27/2011	9/27/2011	11/30/2011	3/8/2012		
Sample Date				Duplicate			5/3/2005	5/27/2009
Comments								
Well Depth (Ft)	470						150	230
Screened Interval (Ft)	470-510						130-150	200-230
VOCS (EPA 624) ug/L								
Acrolein	NR	NR	ND	ND	ND	ND	NR	NR
Acrylonitrile	NR	NR	ND	ND	ND	ND	NR	NR
Acetone	NR	NR	ND	ND	ND	ND	ND	ND
Benzene	ND	NR	ND	ND	ND	ND	ND	ND
Bromodichloromethane	NR	NR	ND	ND	ND	ND	ND	ND
Bromoform	NR	NR	ND	ND	ND	ND	ND	ND
Bromomethane	NR	NR	ND	ND	ND	ND	ND	ND
Carbon tetrachloride	ND	NR	ND	ND	ND	ND	ND	ND
Chlorobenzene	ND	NR	ND	ND	ND	ND	ND	ND
Dibromochloromethane	NR	NR	ND	ND	ND	ND	NR	ND
Chloroethane	NR	NR	ND	ND	ND	ND	ND	ND
2-chloroethylvinyl ether	NR	NR	ND	ND	ND	ND	NR	NR
Chloroform	ND	NR	0.68 J	0.74 J	ND	0.74 J	0.94J	0.98J
Chloromethane	NR	NR	ND	ND	ND	ND	ND	ND
1,2-dichlorobenzene	NR	NR	ND	ND	ND	ND	NR	ND
1,3-dichlorobenzene	NR	NR	ND	ND	ND	ND	NR	ND
1,4-dichlorobenzene	NR	NR	ND	ND	ND	ND	NR	ND
1,1-dichloroethane	3.6J	5.0	3.7	3.7	2.9	3.7	0.39J	0.22J
1,2-dichloroethane	ND	ND	ND	ND	ND	ND	ND	ND
1,1-dichloroethene	ND	1.7	1.1	1.0	1.0	1.2	ND	ND
cis-1,2-dichloroethene	190	43.4	40.4	40.2	74.9	53.3	ND	ND
trans-1,2-dichloroethene	3.0J	1.1	1.0 J	0.92 J	1.1	0.87 J	ND	ND
1,2-dichloropropane	NR	NR	ND	ND	ND	ND	ND	ND
cis-1,3-dichloropropene	NR	NR	ND	ND	ND	ND	ND	ND
trans-1,3-dichloropropene	NR	NR	ND	ND	ND	ND	ND	ND
Ethylbenzene	ND	NR	ND	ND	ND	ND	ND	ND
Methylene chloride	NR	NR	ND	ND	ND	ND	ND	ND
1,1,2,2-tetrachloroethane	NR	NR	ND	ND	ND	ND	ND	ND
Tetrachloroethene	3.4J	3.3	4.4	4.4	3.6	4.7	ND	ND
Toluene	ND	NR	ND	ND	ND	ND	ND	0.19J
1,1,1-trichloroethane	ND	0.63 J	0.73 J	0.76 J	0.29 J	0.57 J	0.47	0.49J
1,1,2-trichloroethane	ND	NR	0.31 J	0.31 J	0.32 J	ND	ND	ND
Trichloroethene	65	35.3	41.0	39.6	38.0	38.1	ND	0.17J
Trichlorofluoromethane	NR	NR	ND	ND	ND	ND	NR	ND
Vinyl chloride	ND	ND	ND	ND	ND	ND	ND	ND
Mercury (EPA 245.1) ug/L	NR	ND	ND	ND	ND	ND	NR	0.20
TSS (SM20 2540D) mg/L	NR	63	18	NR	ND	7	NR	2.4

Note:

VOC analysis changed from SW846 8260B to EPA Method 624 in January 2010.

D = Dilution

J = estimated value

ND = not detected

NR = not requested

R = rejected


mg/L - milligrams per liter

µg/L - micrograms per liter


(1) Analytical results presented above for samples collected from RW3-MW3 and RW3-MW4 in November 2010 are not in line with historical trends indicating samples may have been switched. For trend analysis, concentrations for RW3-MW3 were used for RW3-MW4 for November 2010 and vice versa.

Data prior to June 2011 were collected by others.

FIGURES

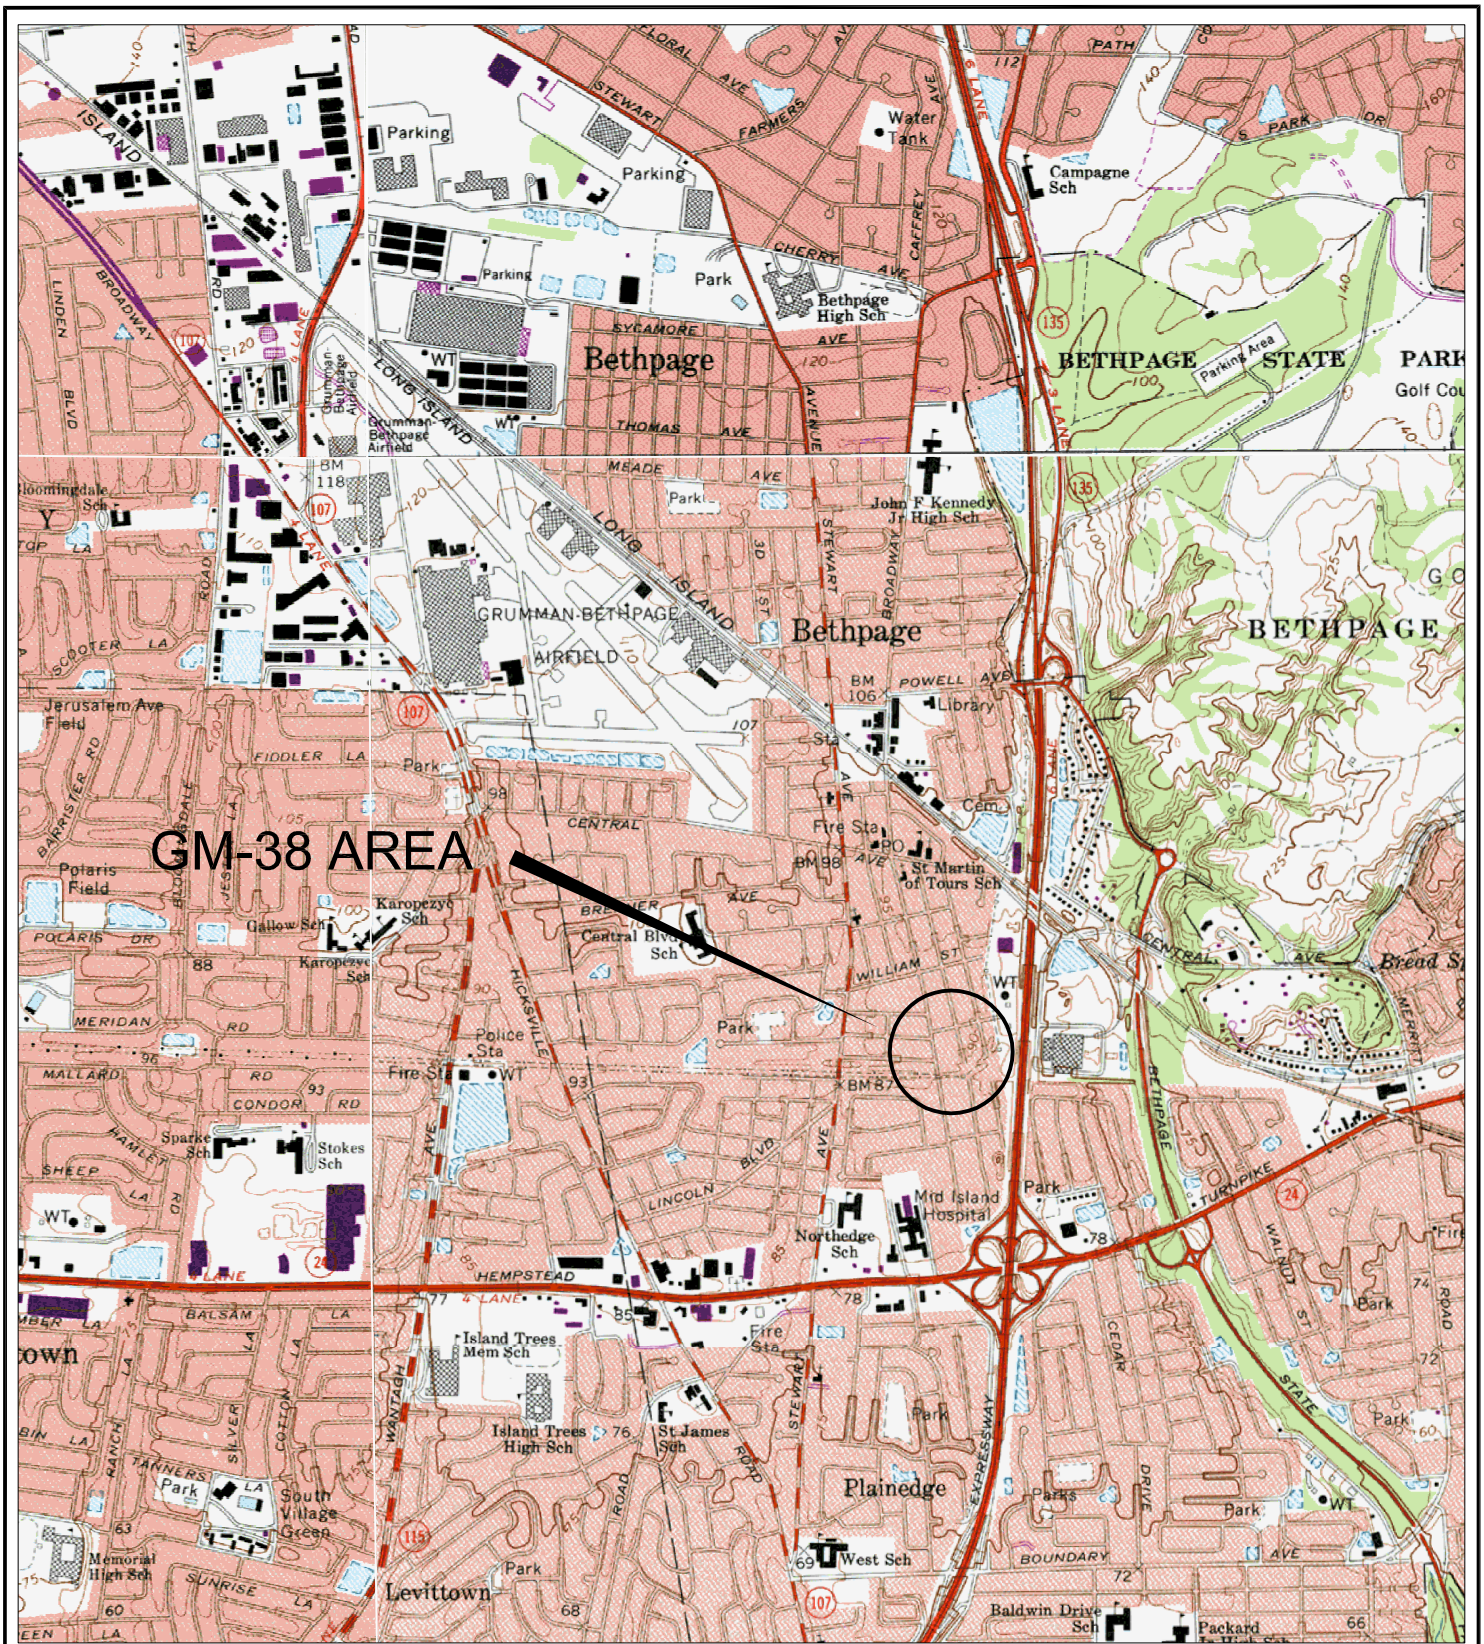

GM-38 AREA




U.S. Navy RAC
 Engineering Field Activity, Northeast
 GM-38 Area (Offsite)
 NWIRP Bethpage
 Bethpage, NY

Figure 1
 Site Location Map

Source: U.S.G.S. Topographic Maps (7.5 Minute)
 Amityville, Freeport, Hicksville, Huntington, NY Quadrangles

NOTES:
1. FOR SYMBOL AND ABBREVIATION LISTS SEE DRAWING P-2.

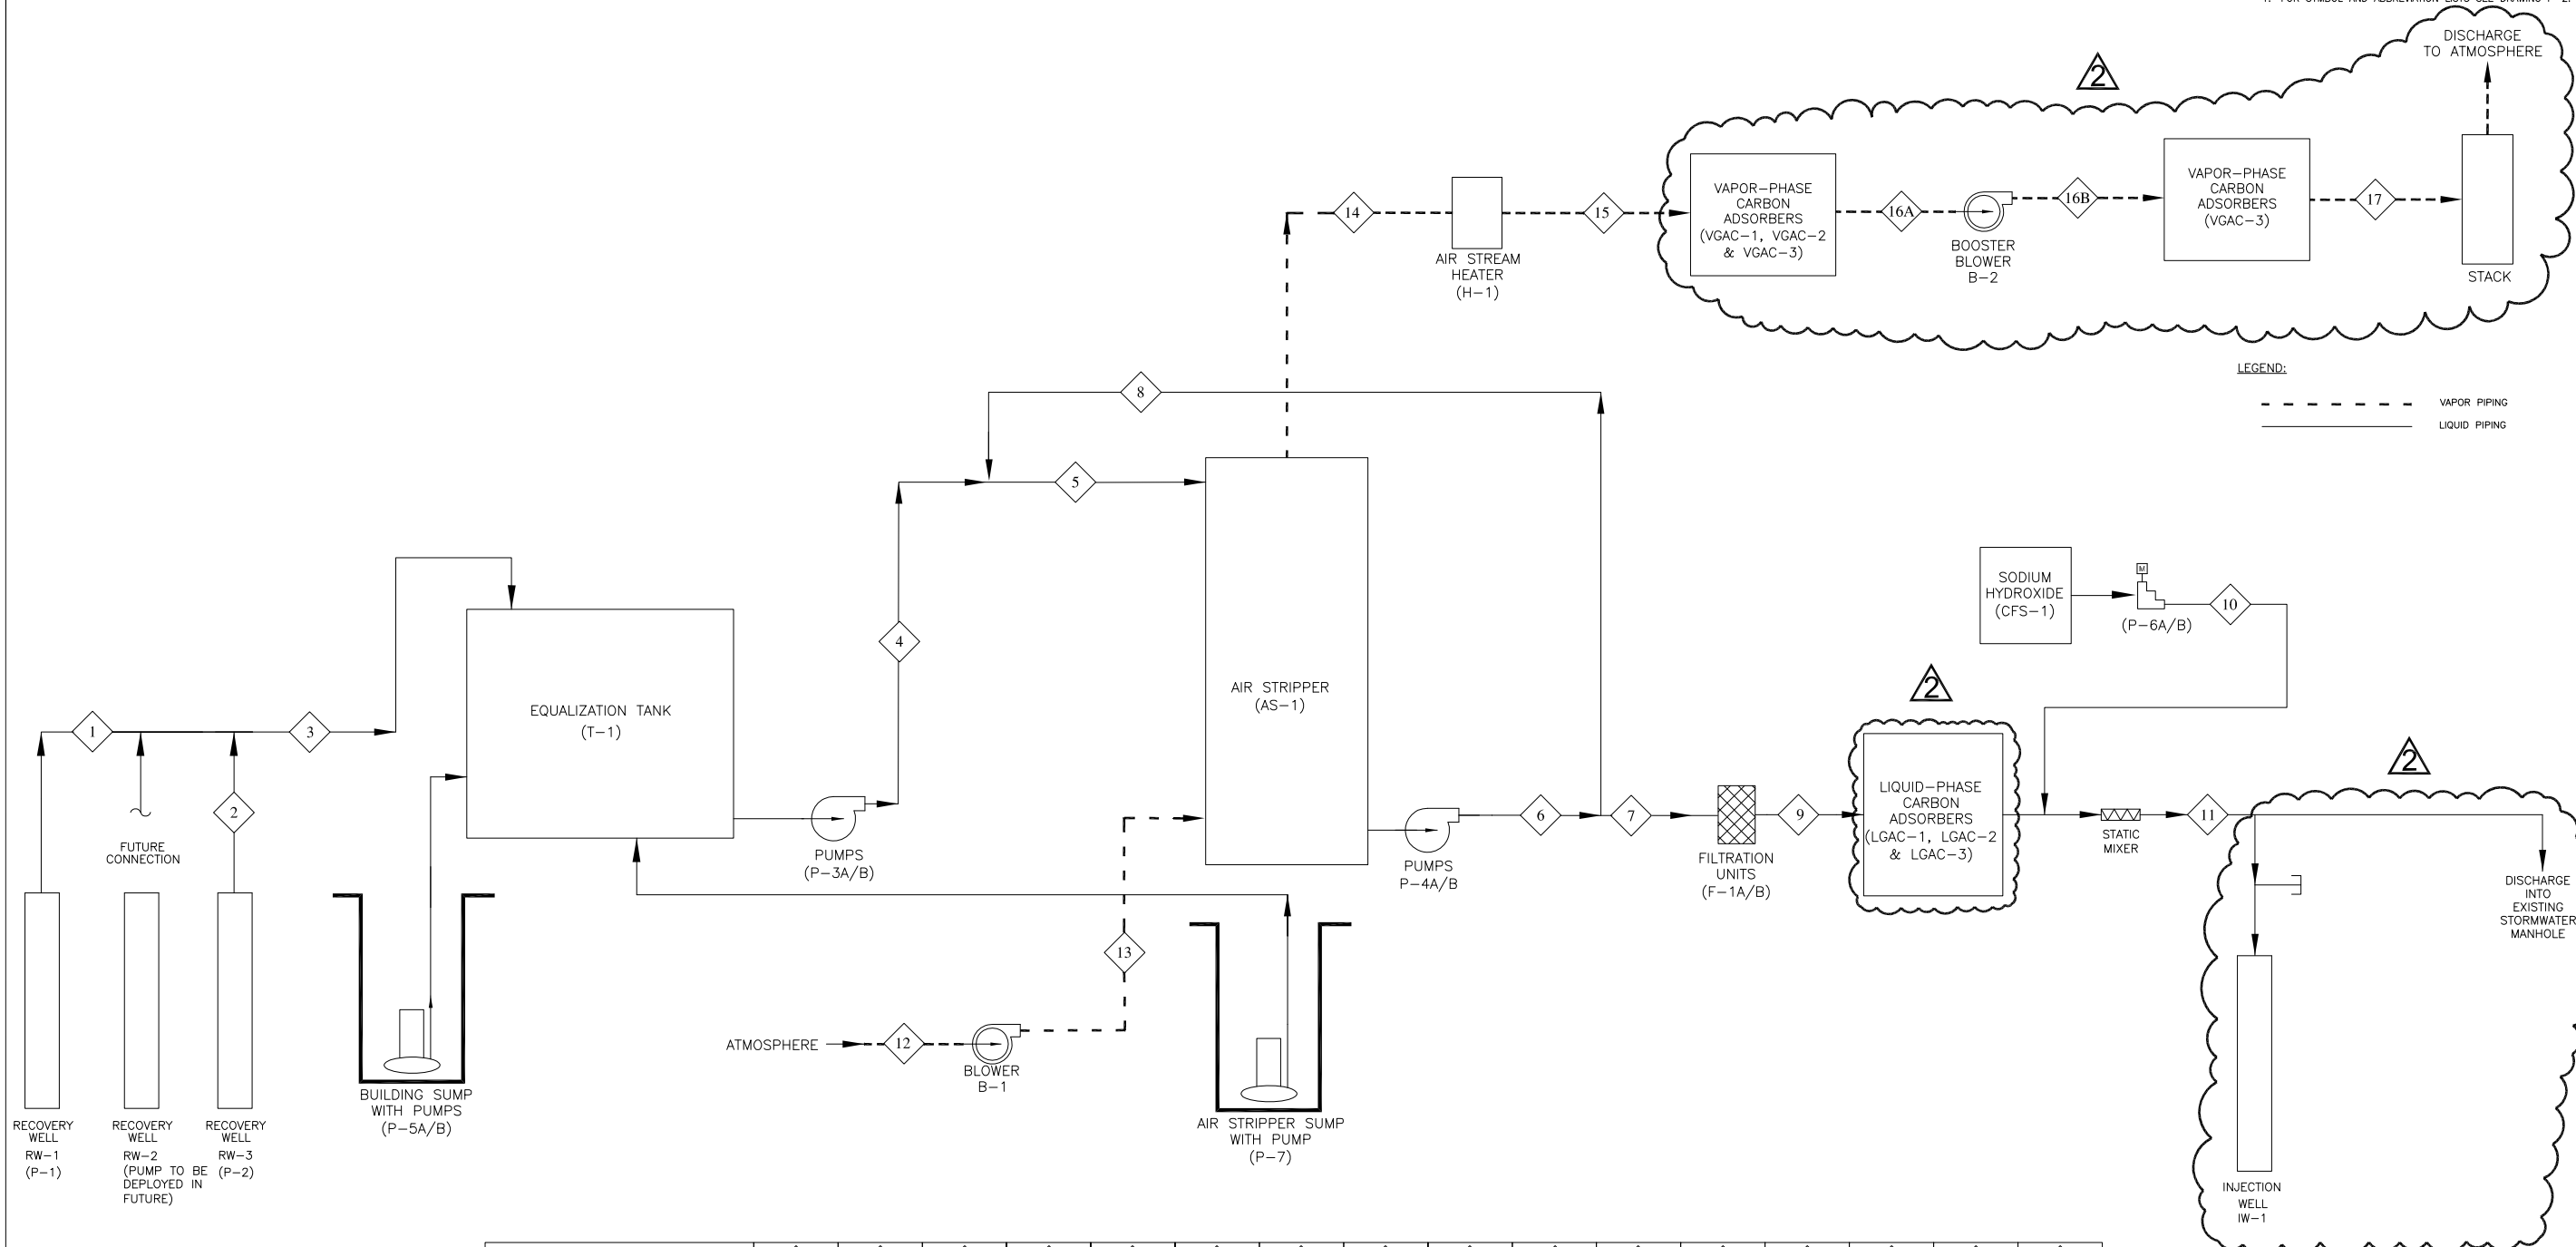

LEGEND:
- - - VAPOR PIPING
— LIQUID PIPING

STREAM NO.	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
COMPOSITION (UG/L, UNLESS OTHERWISE NOTED)																
BENZENE	4	4	4	4	3	-	-	-	-	-	-	-	-	-	-	-
TOLUENE	15	15	15	15	12	-	-	-	-	-	-	-	-	-	-	-
XYLENES, TOTAL	16	16	16	16	12	-	-	-	-	-	-	-	-	-	-	-
1,2-DICHLOROETHANE	3	3	3	3	2.8	-	-	-	-	-	2.7 E-07	-	-	-	-	-
cis 1,2-DICHLOROETHENE	1100	1100	1100	1100	1008	0.10	0.10	0.10	0.10	-	1.0 E-04	-	-	-	-	-
VINYL CHLORIDE	300	300	300	300	275	0.03	0.03	0.03	0.03	-	2.7 E-05	-	-	-	-	-
TETRACHLOROETHENE (PCE)	900	900	900	900	825	0.08	0.08	0.08	0.08	-	8.2 E-05	-	-	-	-	-
TRICHLOROETHENE (TCE)	3400	3400	3400	3400	3117	3.12	3.12	3.12	3.12	-	3.1 E-03	-	-	-	-	-
WATER FLOW RATE (GPM)	800	300	1100	1100	1200	1200	1100	100	1100	1.1 gpd	1100	-	-	-	-	-
TEMPERATURE (°F)	55	55	55	55	55	55	55	55	55	60	55	-	-	-	-	-
PRESSURE (PSIG)												-0.27	1.50	1.36	1.18	0.53
DENSITY (lb/ft ³)										95.5		0.077	0.085	0.084	0.082	0.079
MASS FLOW RATE (lb/hr)	400364	150136	550500	550500	600545	600545	550500	50,045	550500	0.59	550500	36,960	40,800	40,320	39,360	37,920
RELATIVE HUMIDITY (%)												50	50	100	50	50
STATIC PRESSURE (PSIA)												0.214	0.214	0.214	0.275	0.275
pH (S.U.)	5.5	5.5	5.5	5.5	5.5	6.0	6.0	6.0	6.0	14	7.0					
VAPOR FLOW RATE (CFM)												8000	8000	8000	8000	8000
TOTAL VAPOR VOC (PPMV)												-	-	25.5	25.5	1.2
TOTAL VAPOR VOC (LBS/HR)												-	-	3.18	3.18	0.15

THIS DRAWING PRODUCED ON AUTOCAD DO NOT REVISE MANUALLY

THIS DOCUMENT IS THE PROPERTY OF NAVAL FACILITIES ENGINEERING COMMAND, PREPARED BY TETRA TECH EC, INC., AND IS PROVIDED UPON THE CONDITION THAT IT WILL NOT BE REPRODUCED, COPIED, OR ISSUED TO A THIRD PARTY, AND WILL BE USED SOLELY FOR THE ORIGINAL INTENDED PURPOSE AND SOLELY FOR THE EXECUTION OR REVIEW OF THE ENGINEERING CONSTRUCTION OF THE PROJECT.

IT IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW, ARTICLE 145, FOR ANY PERSON UNLESS UNDER THE DIRECTION OF A NEW YORK STATE LICENSED PROFESSIONAL ENGINEER, TO ALTER AN ITEM ON THIS DOCUMENT IN ANY WAY.

DEPARTMENT OF THE NAVY
NAVAL WEAPONS INDUSTRIAL RESERVE PLANT
LESTER

ENGINEERING FIELD ACTIVITY - NORTHEAST
PENNSYLVANIA
BETHPAGE, NEW YORK
GM-38 AREA
GROUNDWATER TREATMENT PLANT
PROCESS FLOW DIAGRAM - GROUNDWATER AND OFF-GAS TREATMENT

APPROVED: [Signature]
DATE: 05/05/06

SAFETY: [Signature]
DATE: 05/05/06

CODE: 80091

CONSTR. CONTR. NO.: N62472-99-D-0032

NAVFAC DRAWING NO.: Figure 2

SHEET 1 OF 1
DIS. SH. NO. 1-4

TETRA TECH ENGINEERING CORPORATION PC


APPROVED: [Signature]
DATE: 05/05/06

PREP BY: DLB
DATE: 03/31/08


REVISED: [Signature]
DATE: 02/24/09

Legend

- Monitoring Well (Monitored by Navy)
- Monitoring Well (Monitored by Northrop Grumman)
- ◻ Recovery Well
- ◻ Injection Well

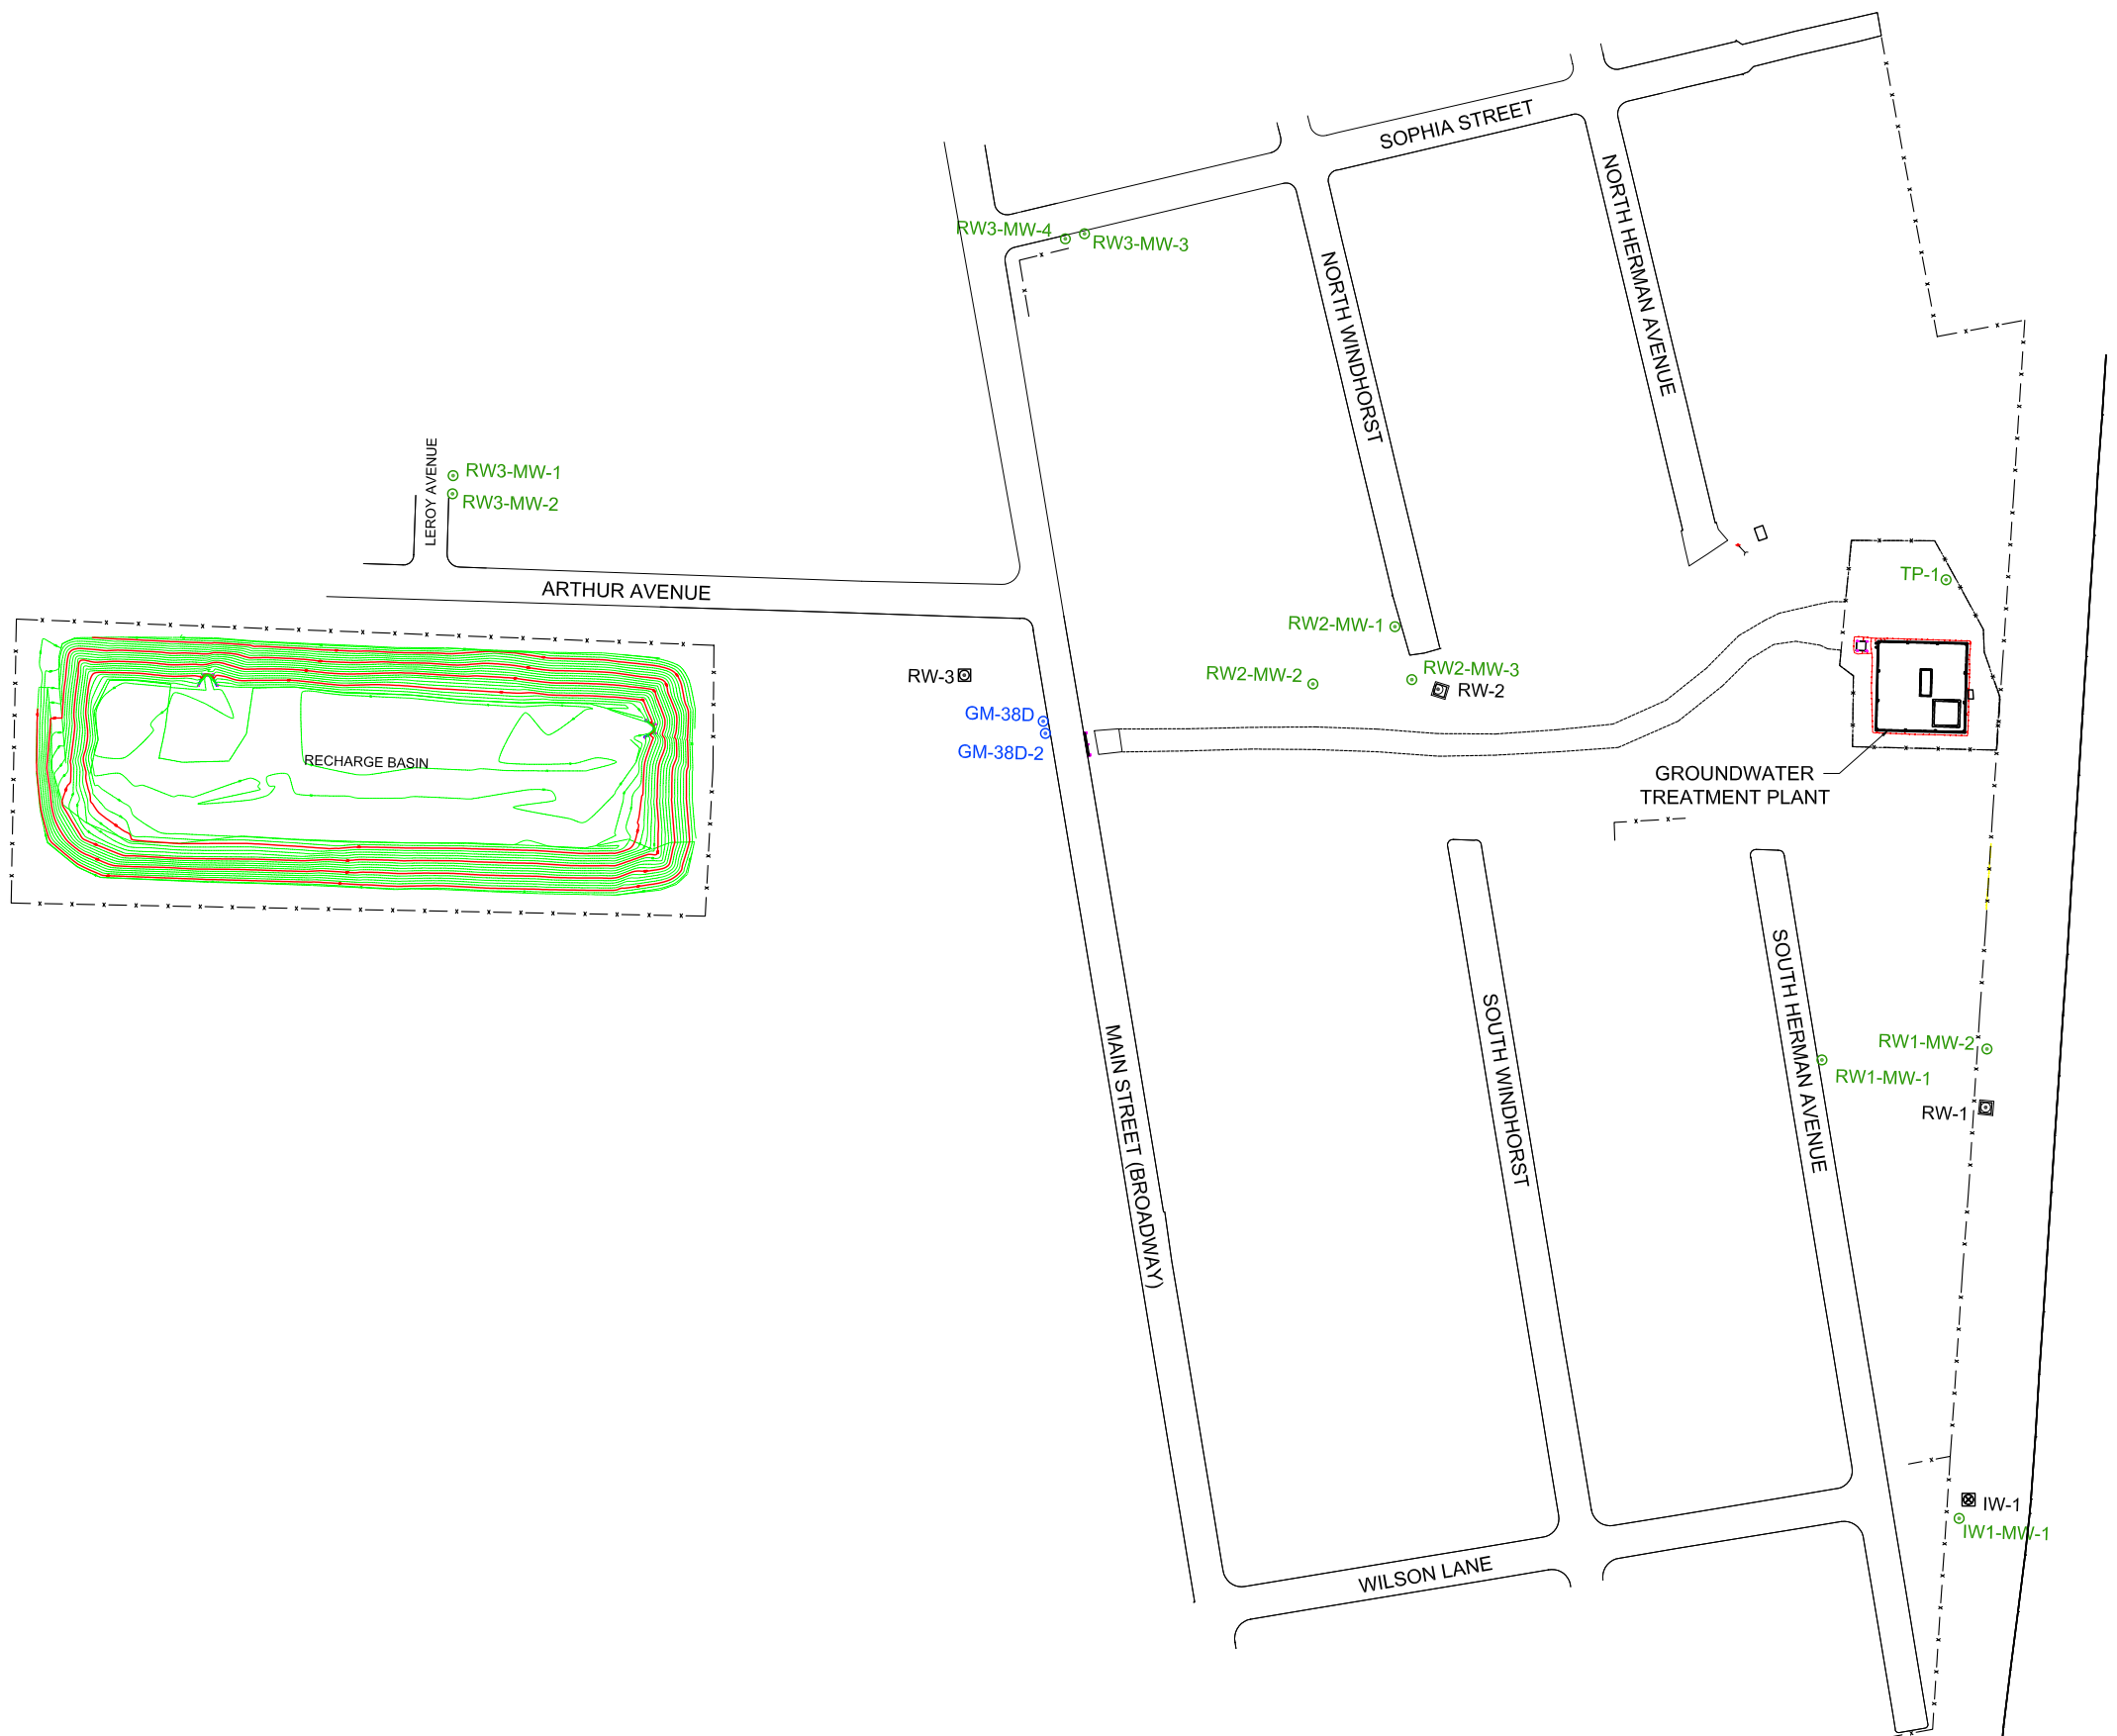

(SEAFORD-OYSTER BAY EXPRESSWAY - RTE 135)

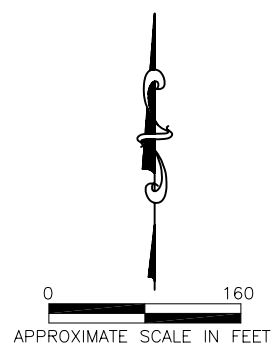

SITE MAP		
NWIRP BETHPAGE GM-38 AREA BETHPAGE, NEW YORK		
H&S Environmental, Inc. 160 East Main Street, Suite 2F, Westborough, MA 01581		
SCALE SEE BARSCALE	DATE 4/12/2012	FIGURE 3

Figure 4
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Groundwater Concentration Trends of Select VOCs
RW1

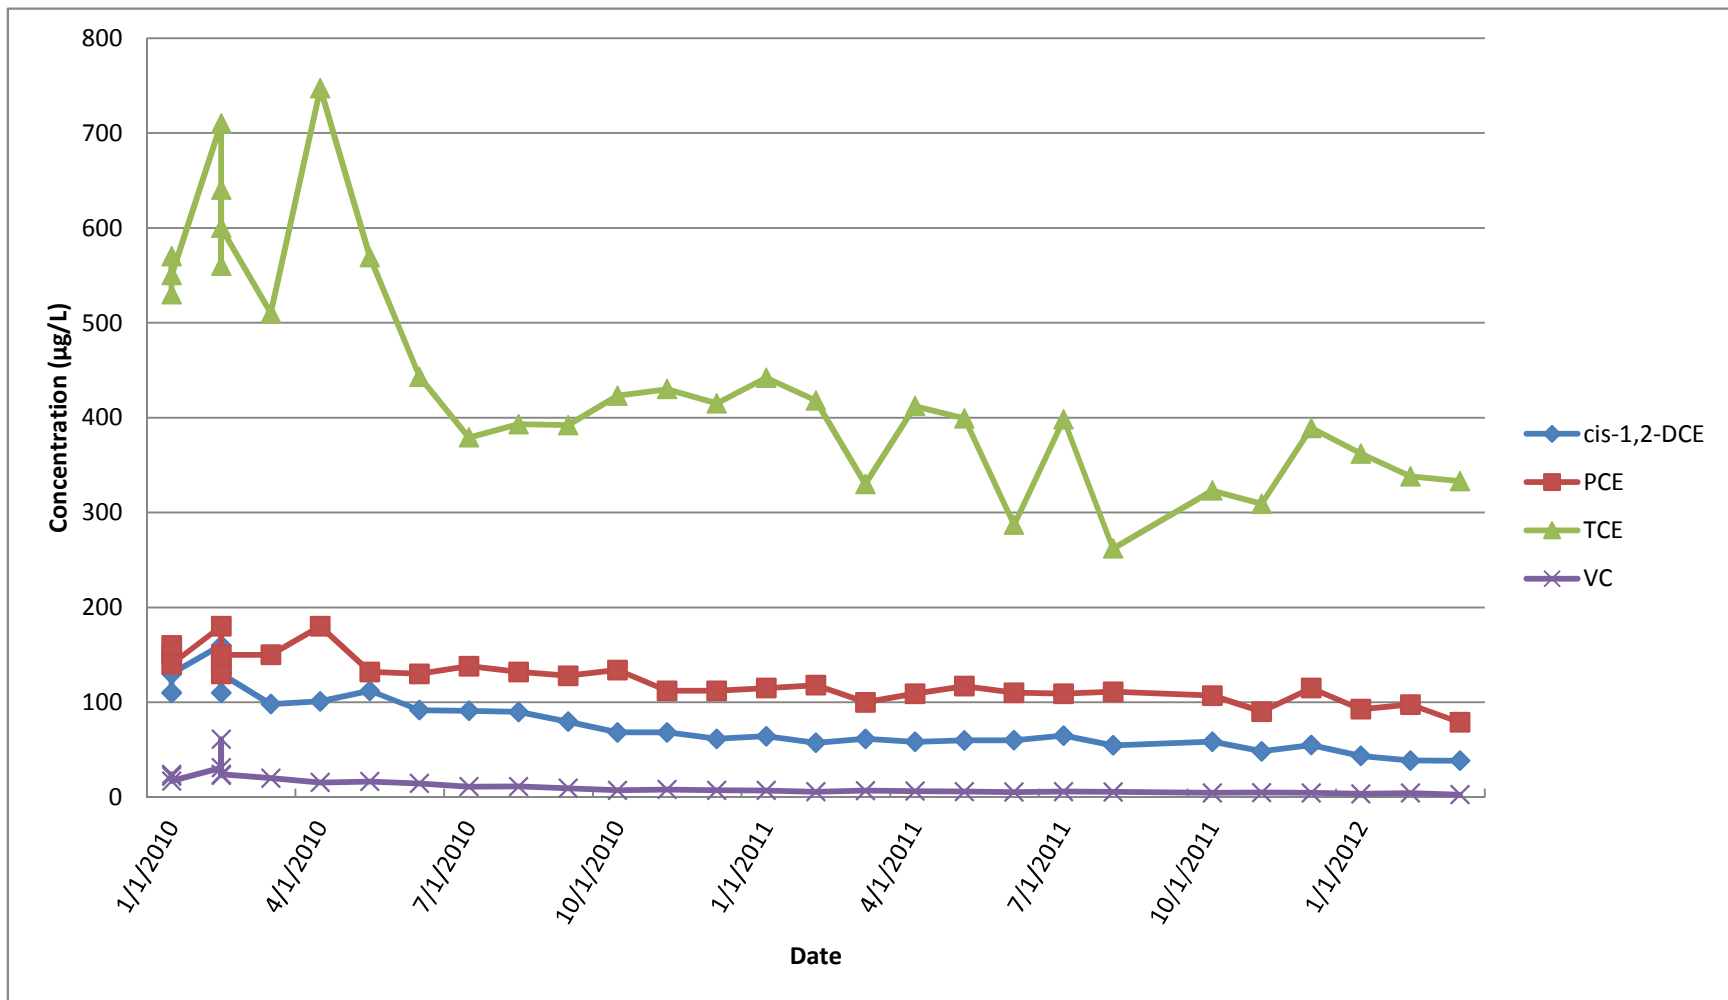


Figure 5
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Groundwater Concentration Trends of Select VOCs
RW3

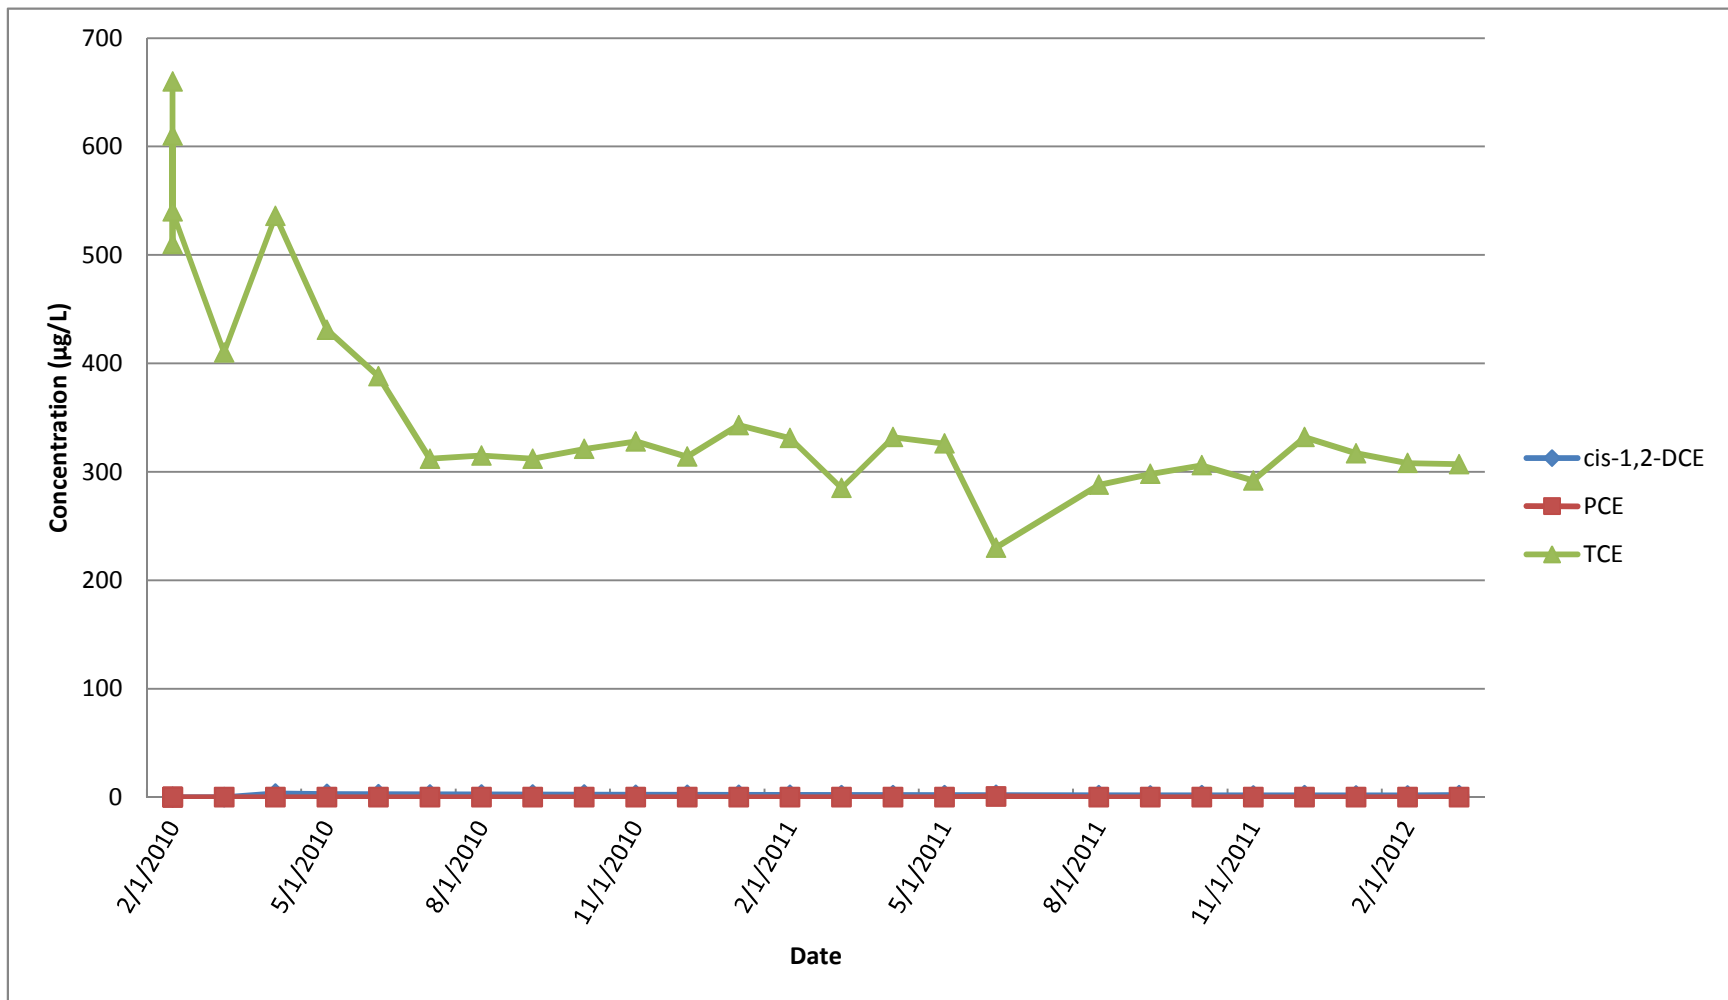


Figure 6
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Groundwater Concentration Trends of Select VOCs
RW1-MW1

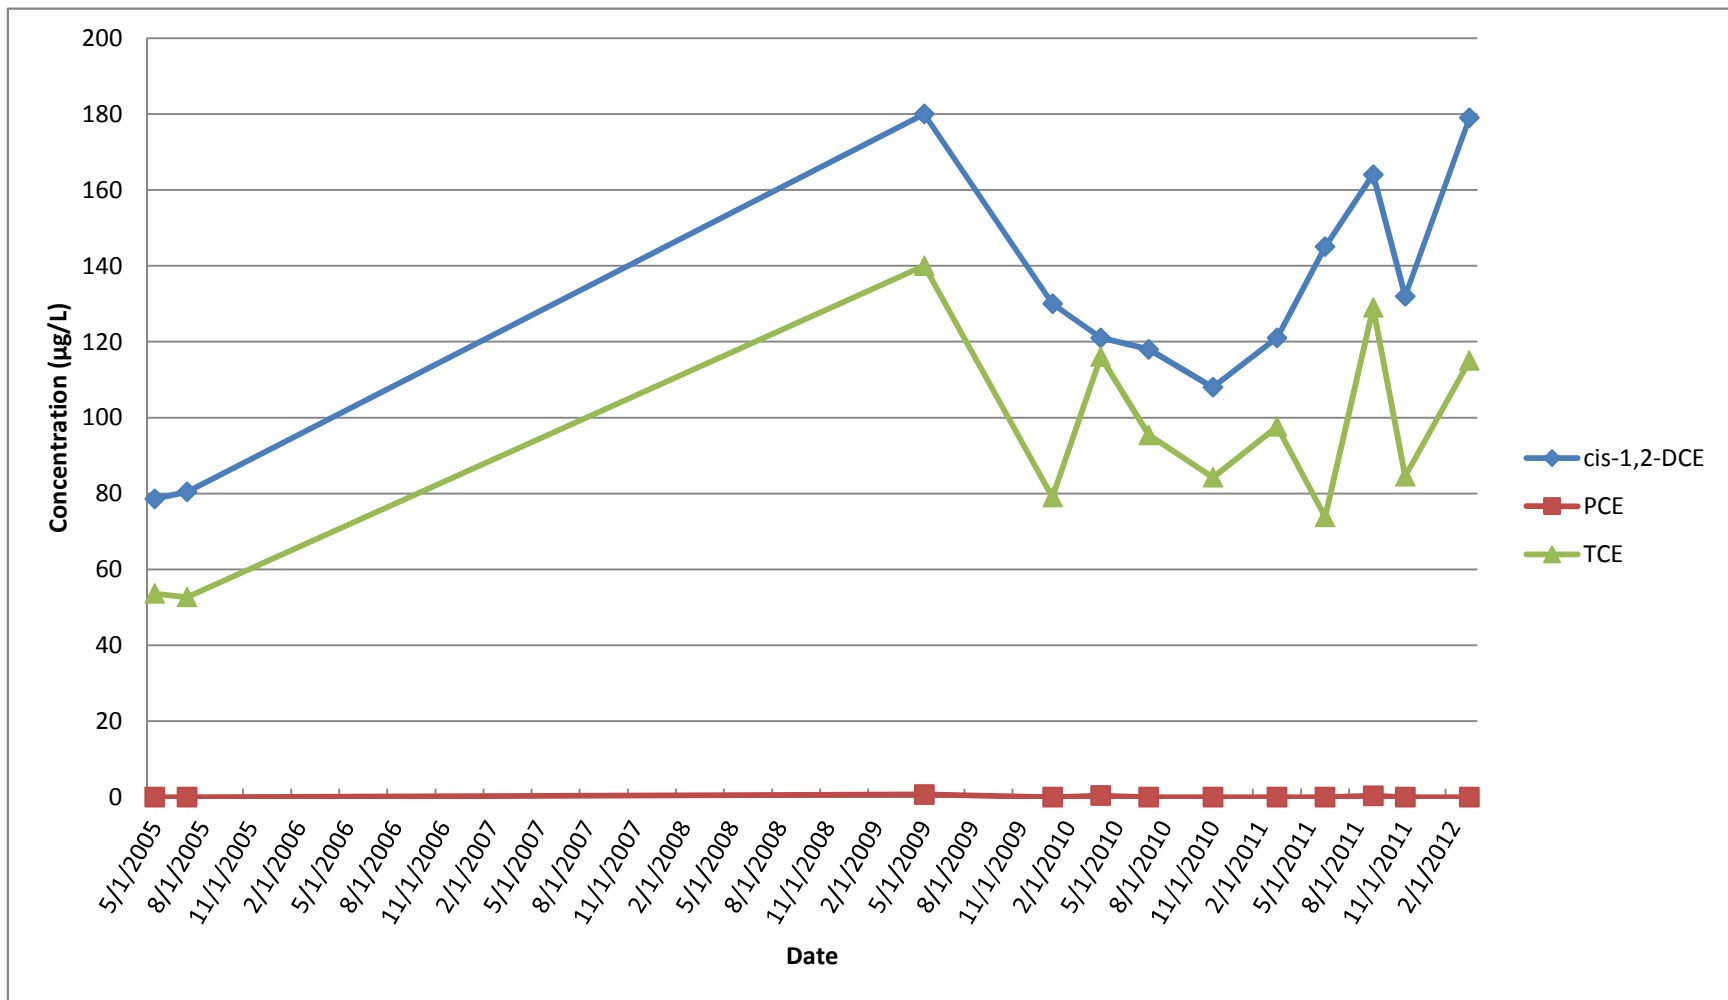


Figure 7
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Groundwater Concentration Trends of Select VOCs
RW1-MW3

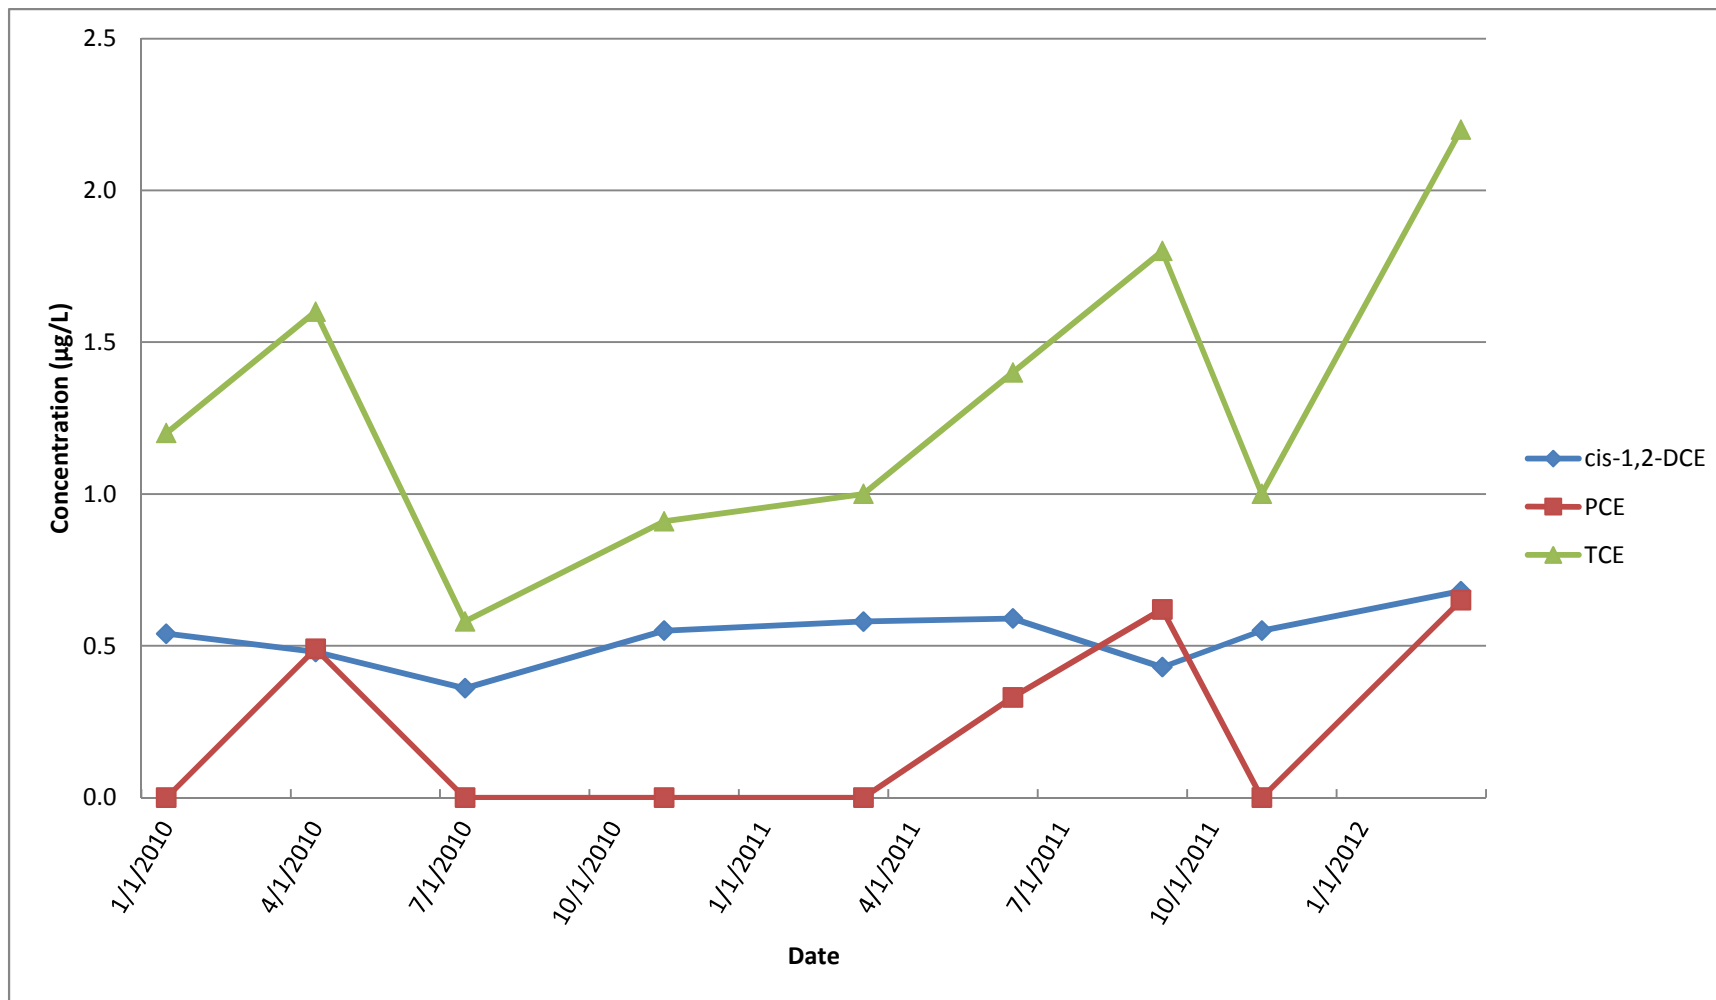


Figure 8
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Groundwater Concentration Trends of Select VOCs
RW2-MW1

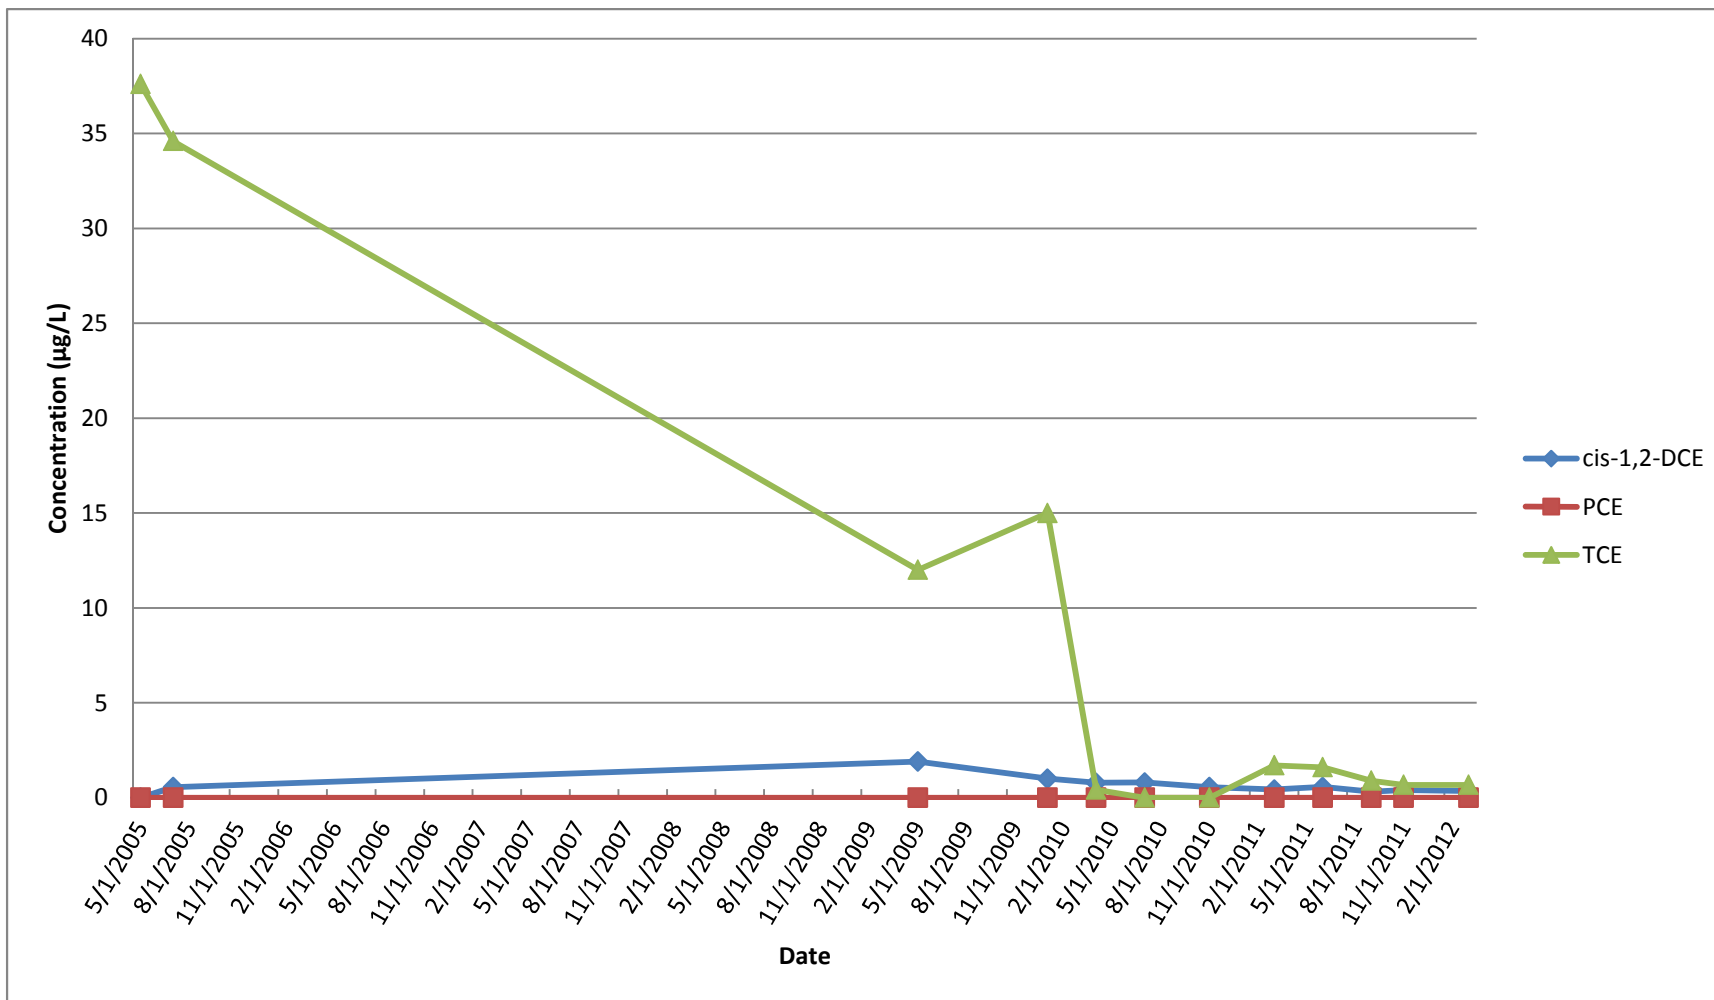


Figure 9
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Groundwater Concentration Trends of Select VOCs
RW3-MW1

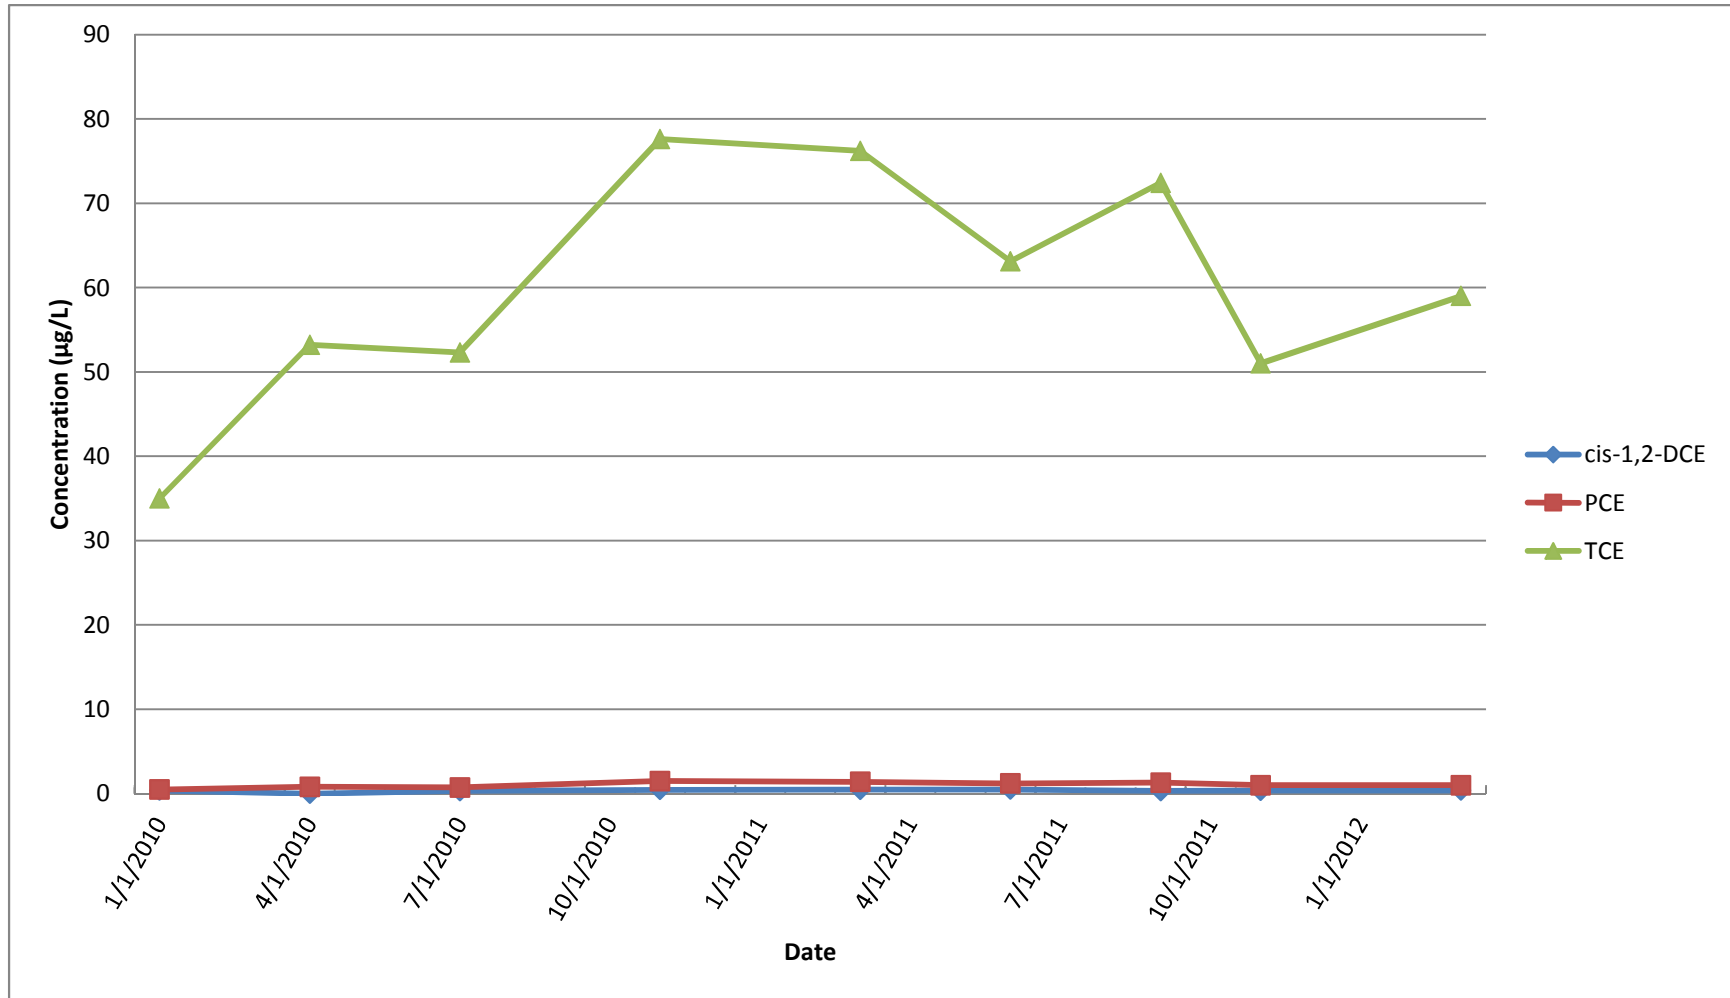


Figure 10
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Groundwater Concentration Trends of Select VOCs
RW3-MW2

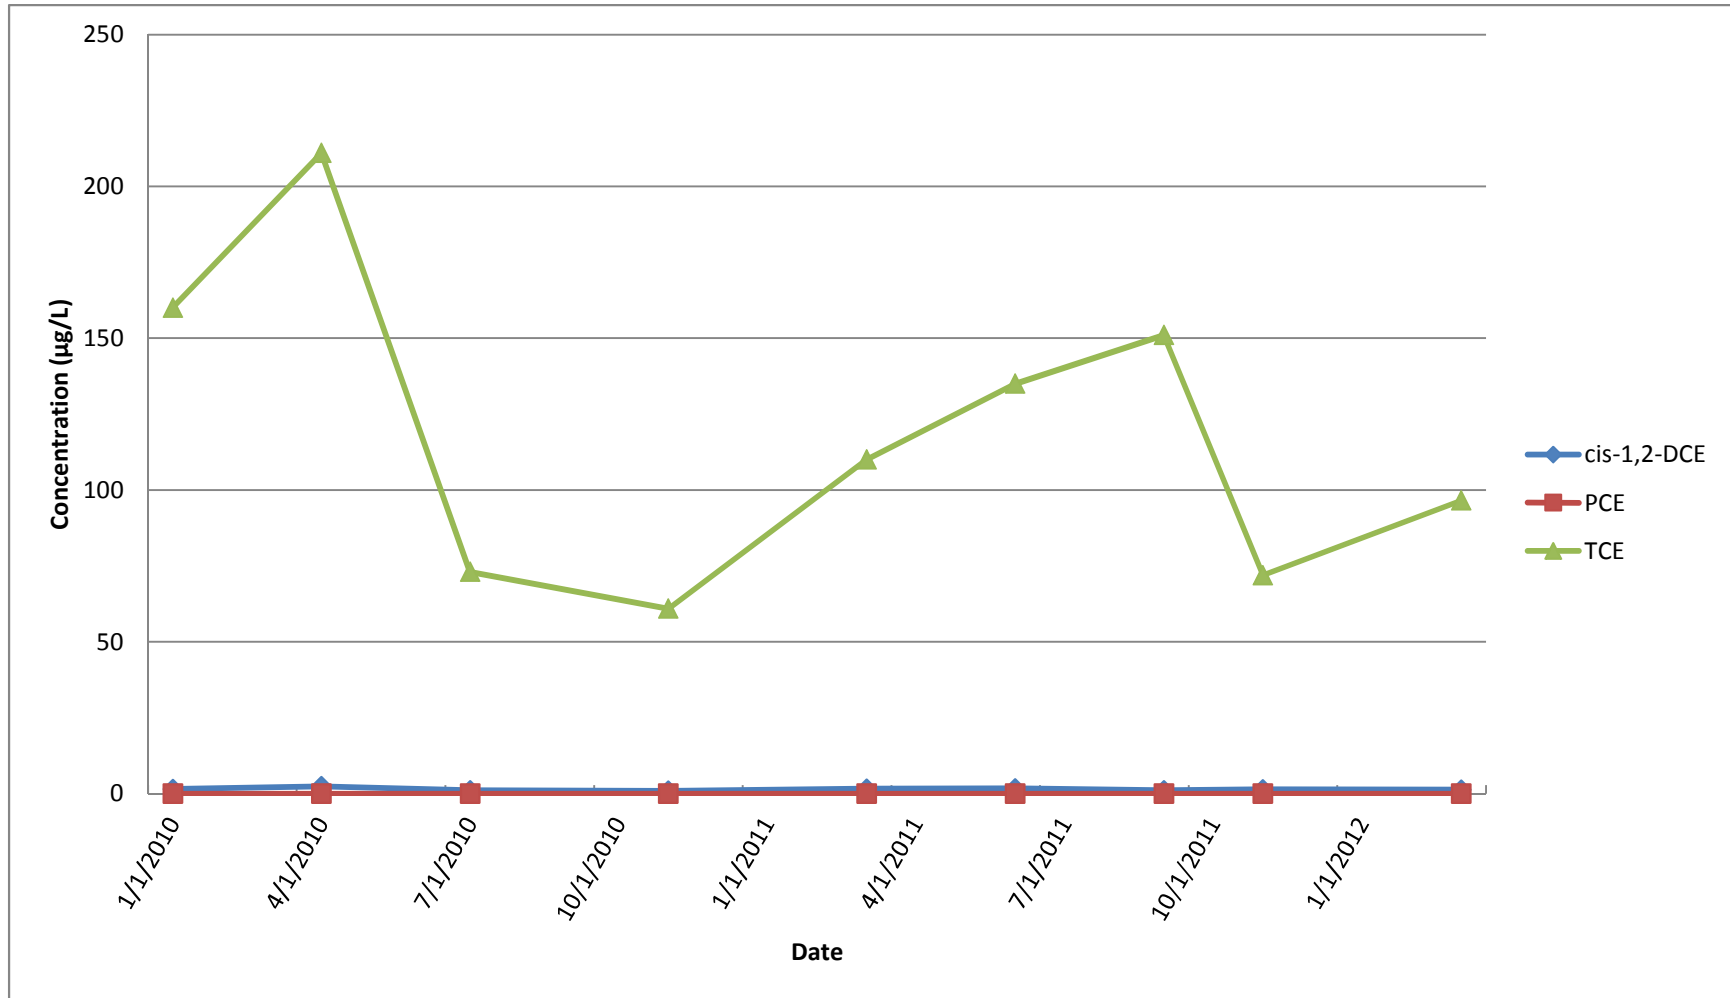


Figure 11
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Groundwater Concentration Trends of Select VOCs
RW3-MW3

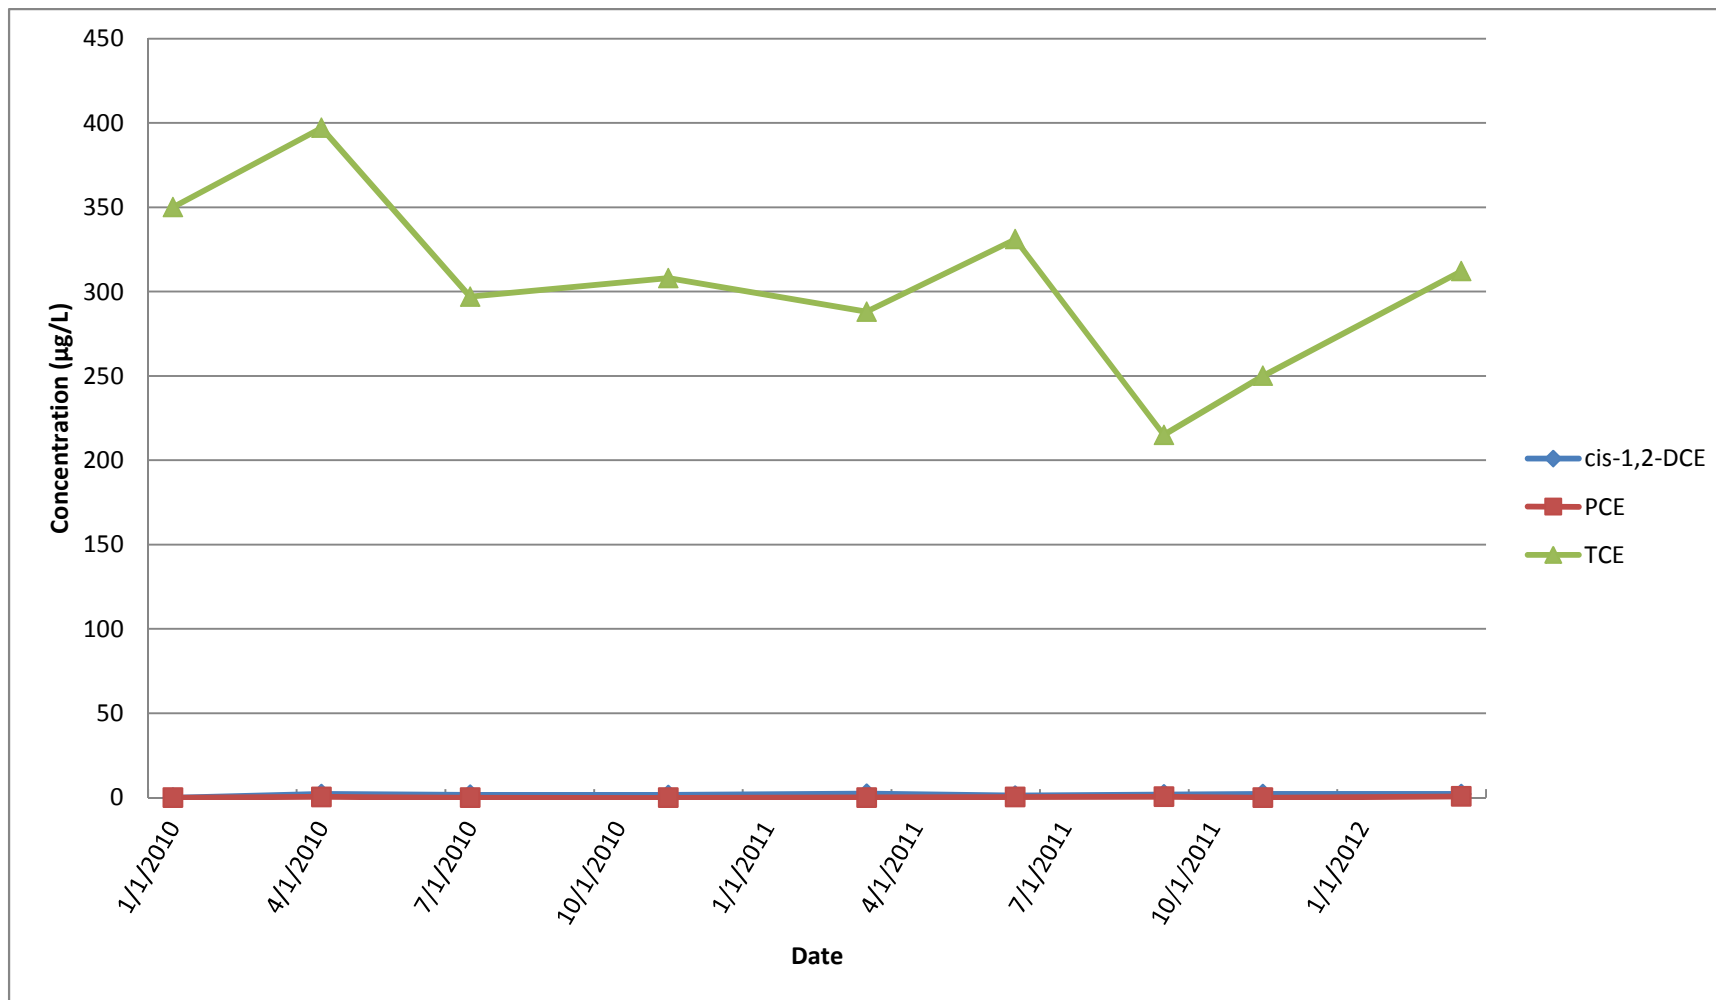


Figure 12
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Groundwater Concentration Trends of Select VOCs
RW3-MW4


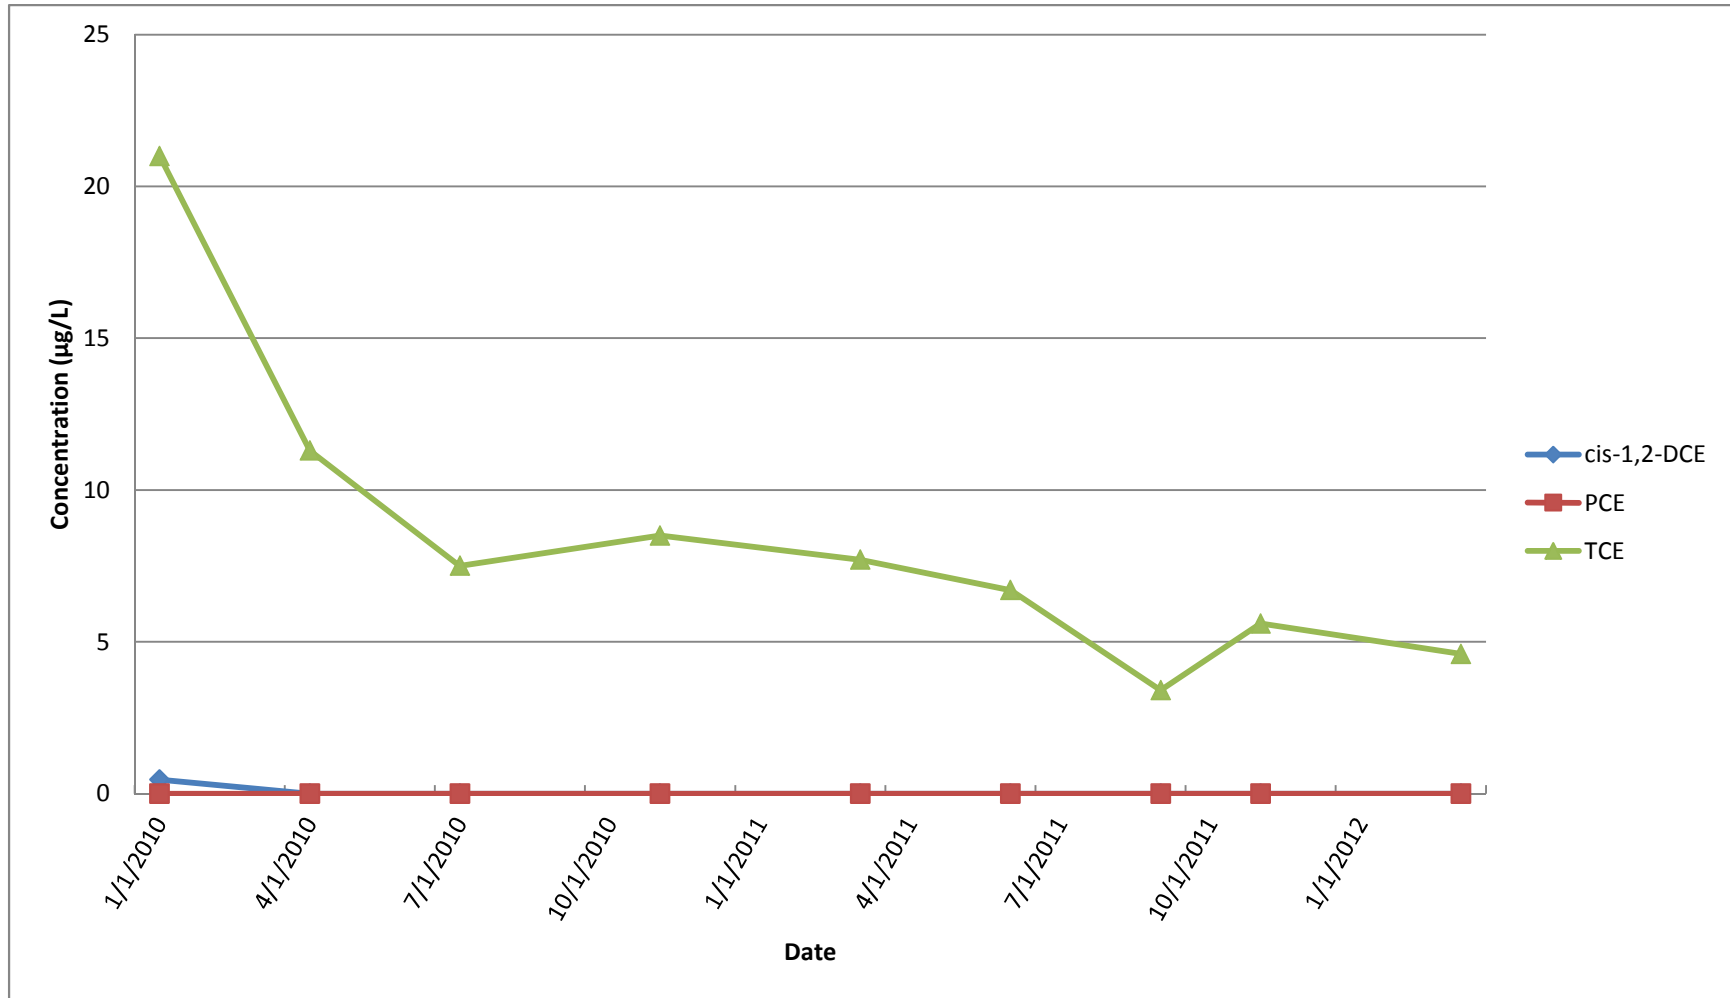



Figure 13
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Groundwater Concentration Trends of Select VOCs
TP-01

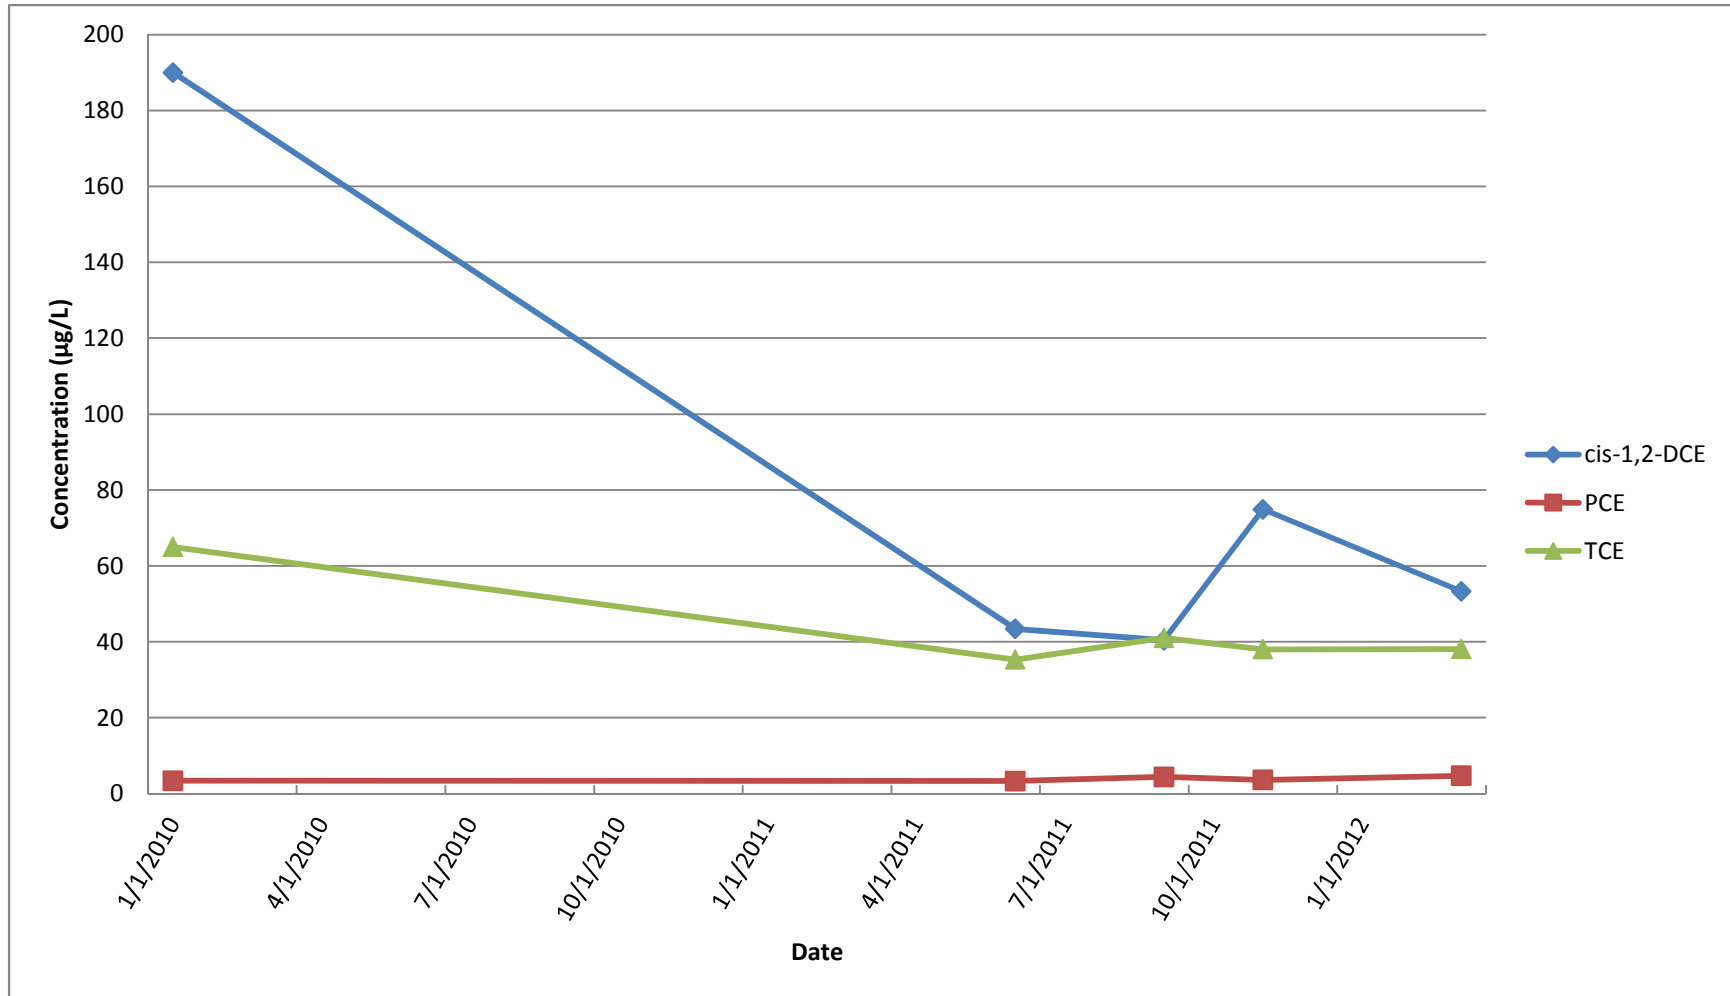


APPENDIX A
NYSDEC Effluent Limitations and Monitoring Requirements and
Monthly DMRs

**New York State Department of Environmental Conservation
Division of Water**

Bureau of Water Permits, 4th Floor
625 Broadway, Albany, New York 12233-3505
Phone: (518) 402-8111 • FAX: (518) 402-9029
Website: www.dec.state.ny.us



Alexander B. Grannis
Commissioner

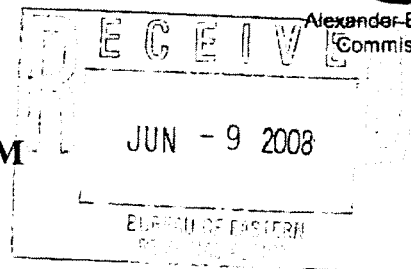MEMORANDUM

TO: Steven Scharf, DER

FROM: Jean Occidental, DOW, Bureau of Water Permits JO

SUBJECT: Naval Weapons Industrial Reserve Plant (NWIRP); DER Site # 1-01-001

DRAINAGE BASIN: na

DATE: June 6, 2008

In response to your request and the permittee's SPDES Permit Equivalent Application dated April 27, 2008, attached is the effluent criteria for the above noted groundwater remediation discharge.

The Division of Water does not have any regulatory authority over a discharge from a State, PRP, or Federal Superfund Site. The Division of Environmental Remediation will be responsible for ensuring compliance with the attached effluent criteria and approval of all engineering submissions. Additional Condition (1) identifies the contact to send all effluent results, engineering submissions, and modification requests. The Regional Water Engineer should be kept apprised of the status of these discharges and, in accordance with the attached criteria, receive a copy of the effluent results for informational purposes.

If you have any questions, please call me at (518) 402-8116.

Attachment

cc: (w/att) RWE, Region 1
C. Webber
BWP Permit Coordinator

Naval Weapons Industrial Reserve Plant

DER site # 1-01-001

Page 1 of 2

EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS

During the period beginning: April 1, 2009and lasting until: April 1, 2014

the discharges from the treatment facility to Groundwater shall be limited and monitored by the operator as specified below:

Outfall and Parameters	Limitations		Units	Minimum Monitoring Requirements	
	Daily Avg.	Daily Max.		Measurement Frequency	Sample Type
Treated Groundwater Remediation Discharge from: Recovery Wells 1, 2, and 3					
Flow	Monitor	1100	GPM	Continuous	Recorder
pH (range)	5.5 - 8.5		SU	Weekly	Grab
1,1-Dichloroethane	NA	5	µg/l	Monthly ¹	Grab
1,2-Dichloroethane	NA	0.6	µg/l	Monthly ¹	Grab
1,1-Dichloroethene	NA	5	µg/l	Monthly ¹	Grab
cis-1,2-Dichloroethene	NA	5	µg/l	Monthly ¹	Grab
trans-1,2-Dichloroethene	NA	5	µg/l	Monthly ¹	Grab
Tetrachloroethene	NA	5	µg/l	Monthly ¹	Grab
1,1,1-Trichloroethane	NA	5	µg/l	Monthly ¹	Grab
Trichloroethene	NA	5	µg/l	Monthly ¹	Grab
Vinyl chloride	NA	2	µg/l	Monthly ¹	Grab
Mercury	NA	0.25	µg/l	Monthly ¹	Grab

Footnotes:

- (1) The minimum measurement frequency shall be monthly following a period of 24 consecutive weekly sampling events showing no exceedances of the stated discharge limitations.

Naval Weapons Industrial Reserve Plant

DER site # 1-01-001

Page 1 of 2

Additional Conditions:

- (1) Discharge is not authorized until such time as an engineering submission showing the method of treatment is approved by the Department. The discharge rate may not exceed the effective or design treatment system capacity. All monitoring data, engineering submissions and modification requests must be submitted to:

Steven Scharf
Division of Environmental Remediation
NYSDEC, 625 Broadway
Albany, NY 12233-7015
Phone: (518) 402-9620

With a copy sent to:

Regional Water Engineer
NYSDEC - Region 1
Building 40, SUNY Campus
Stony Brook, New York 11790-2356
Phone: (631) 444-0354

- (2) Only site generated wastewater is authorized for treatment and discharge.
- (3) Authorization to discharge is valid only for the period noted above but may be renewed if appropriate. A request for renewal must be received 6 months prior to the expiration date to allow for a review of monitoring data and reassessment of monitoring requirements.
- (4) Any use of corrosion/scale inhibitors, biocidal-type compounds, or other water treatment chemicals used in the treatment process must be approved by the department prior to use.
- (5) This discharge and administration of this discharge must comply with the substantive requirements of 6NYCRR Part 750.

January 2012



8 February 2012

Mr. Steven Scharf
New York State Department of Environmental Conservation
Division of Environmental Remediation
Remedial Action, Bureau A
625 Broadway
Albany, NY 12233-7015

**Subject: GROUNDWATER DISCHARGE MONITORING/AIR EMISSION REPORT
GM-38 AREA, NWIRP BETHPAGE, NY; DER SITE # 1-30-003B-OU 2
JANUARY 2012 REPORTING PERIOD**

Dear Mr. Scharf:

H&S Environmental, Inc. (H&S) is submitting this monthly monitoring report of the groundwater discharge and air emission results for the Groundwater Treatment Plant (GWTP) located at the Former Naval Industrial Reserve Plant (NWIRP), Bethpage, NY, GM-38 Area. This report was prepared in accordance with GWTP operational requirements for DER Site # 1-30-003B-OU 2. H&S assumed operational responsibility of the GWTP on 1 June 2011. GWTP operational data from 1 January to 31 January 2012 are included in Attachment A. All constituents were within permit limitations during this reporting period.

Please contact Ms. Jennifer Good or myself at 508-366-7442 with any questions or concerns you may have regarding this report.

Sincerely,
H&S Environmental, Inc.

Patrick Schauble, P.E.
Senior Project Manager

Attachment A: Groundwater and Air Sampling Results from October 2011

Cc: Jean Occidental - NYSDEC Division of Water
William Spitz - NYSDEC – Region 1 Water Engineer
Gerard Ennis - Nassau County Department of Public Works
Richard Pfaender - Town of Oyster Bay
Lora Fly - NAVFAC Mid-Atlantic RPM
Al Taormina – ECOR
GM-38 Copy

ATTACHMENT A
GROUNDWATER AND AIR SAMPLING RESULTS
JANUARY 2012

**GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Discharge Monitoring Report
January 2012**

SPDES Parameters	January 2012					
	Daily Treated Effluent Maximum	Units	RW-1	RW-3	Combined Influent ^{(1) (2)} (RW-1 + RW-3)	Treated Effluent ⁽²⁾
Well Depth	N/A	ft	500	500	500	N/A
Screened Interval	N/A	ft	470-500	470-500	470-500	N/A
Sampling Date	N/A		1/18/12			
Average Flowrate	1100	GPM	739	273	1,012	1020
Total Flow	N/A	gallons	32,993,460	12,164,600	45,158,060	45,523,120
pH	5.5 - 8.5	SU	6.02	8.18	6.60	7.60
Carbon Tetrachloride	NA	µg/L	ND	ND	ND	ND
1,1-Dichloroethane	5	µg/L	2.7 J	2.6 J	2.7	ND
1,2-Dichloroethane	0.6	µg/L	ND	ND	ND	ND
1,1-Dichloroethene	5	µg/L	6.4	ND	4.7	ND
cis 1,2-Dichloroethene	5	µg/L	43.4	1.5 J	32.1 J	0.96 J
trans 1,2-Dichloroethene	5	µg/L	ND	ND	ND	ND
Tetrachloroethene	5	µg/L	92.7	ND	67.7	ND
1,1,1-Trichloroethene	5	µg/L	6.7	ND	4.9	ND
Trichloroethene	5	µg/L	364	317	351	0.70 J
Vinyl Chloride	2	µg/L	3.4 J	ND	2.5 J	ND
Mercury	0.25	µg/L	ND	ND	ND	ND
Total Suspended Solids (TSS)	N/A	mg/L	5	5	5	ND

Notes:

J - Estimated result between laboratory method detection limit and reporting limit

ND - Not detected above laboratory method detection limit

N/A - Not Applicable

(1) Influent concentrations presented are the weighted average concentrations of RW-1 and RW-3.

(2) System downtime from 3-5 January 2012 for carbon changeout of the two VGAC units resulted in lower than average flowrates during this reporting period.

**GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Air Sampling Results
January 2012**

DAR Parameters	Units	SGC	January 2012	
			Influent	Effluent
Process Stream				
Sampling Date	N/A	N/A	1/20/12	
Average Flowrate	CFM	N/A	NR	8,186
Total Flow	ft ³	N/A	NR	365,408,160
Total Flow	m ³	N/A	NR	10,347,207
1,2-Dichloroethane	µg/m ³	N/A	5.0 J	ND
cis 1,2-Dichloroethene	µg/m ³	N/A	530	ND
trans 1,2-Dichloroethene	µg/m ³	N/A	ND	ND
1,2-Dichloroethene (total)	µg/m ³	N/A	530	ND
Toluene	µg/m ³	37,000	9.0 J	ND
Total Xylene	µg/m ³	4,300	8.1 J	ND
1,1,2-Trichloroethane	µg/m ³	N/A	ND	ND
Trichloroethene	µg/m ³	14,000	5700	4.7
Vinyl Chloride	µg/m ³	180,000	39	ND
Tetrachloroethene	µg/m ³	1,300	1500	ND

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

J - Estimated result between laboratory method detection limit and reporting limit

N/A - Not Applicable

NR - Not recorded

SGC - Short-term Guideline Concentration

**GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Controlled Stack Emissions
January 2012**

DAR Parameters	Units	Discharge Goal	January 2012
Sampling Date	N/A	N/A	1/20/12
Average Flowrate	CFM	N/A	8,186
Total Flow	ft ³	N/A	365,408,160
Total Flow	m ³	N/A	10,347,207
Trichloroethene	lb/hr	0.09	0.0001
Vinyl Chloride	lb/hr	0.01	0.0000
1,2 Dichloroethene	lb/hr	0.03	0.0000
1,2-Dichloroethane	lb/hr	BRT	0.0000
Toluene	lb/hr	BRT	0.0000
Total Xylene	lb/hr	BRT	0.0000
1,1,2-Trichloroethane	lb/hr	BRT	0.0000
Tetrachloroethene	lb/hr	0.02	0.0000

Notes:

BRT - below reporting thresholds

CFM - cubic feet per minute

DAR - Division of Air Resources

N/A - Not Applicable

February 2012



14 March 2012

Mr. Steven Scharf
New York State Department of Environmental Conservation
Division of Environmental Remediation
Remedial Action, Bureau A
625 Broadway
Albany, NY 12233-7015

**Subject: GROUNDWATER DISCHARGE MONITORING/AIR EMISSION REPORT
GM-38 AREA, NWIRP BETHPAGE, NY; DER SITE # 1-30-003B-OU 2
FEBRUARY 2012 REPORTING PERIOD**

Dear Mr. Scharf:

H&S Environmental, Inc. (H&S) is submitting this monthly monitoring report of the groundwater discharge and air emission results for the Groundwater Treatment Plant (GWTP) located at the Former Naval Industrial Reserve Plant (NWIRP), Bethpage, NY, GM-38 Area. This report was prepared in accordance with GWTP operational requirements for DER Site # 1-30-003B-OU 2. H&S assumed operational responsibility of the GWTP on 1 June 2011. GWTP operational data from 1 February 2012 to 29 February 2012 are included in Attachment A. All constituents were within permit limitations during this reporting period.

Please contact Ms. Jennifer Good or myself at 508-366-7442 with any questions or concerns you may have regarding this report.

Sincerely,
H&S Environmental, Inc.

Patrick Schauble, P.E.
Senior Project Manager

Attachment A: Groundwater and Air Sampling Results from February 2012

Cc: Jean Occidental - NYSDEC Division of Water
William Spitz - NYSDEC – Region 1 Water Engineer
Gerard Ennis - Nassau County Department of Public Works
Richard Pfaender - Town of Oyster Bay
Lora Fly - NAVFAC Mid-Atlantic RPM
Al Taormina – ECOR
GM-38 Copy

ATTACHMENT A
GROUNDWATER AND AIR SAMPLING RESULTS
FEBRUARY 2012

**GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Discharge Monitoring Report
February 2012**

SPDES Parameters	February 2012					
Process Stream	Daily Treated Effluent Maximum	Units	RW-1	RW-3	Combined Influent ⁽¹⁾ (RW-1 + RW-3)	Treated Effluent
Well Depth	N/A	ft	500	500	500	N/A
Screened Interval	N/A	ft	470-500	470-500	470-500	N/A
Sampling Date	N/A		2/16/12			
Average Flowrate	1100	GPM	758	217	976	1007
Total Flow	N/A	gallons	31,668,400	9,074,540	40,742,940	42,066,120
pH	5.5 - 8.5	SU	5.98	6.06	6.00	7.35
Carbon Tetrachloride	NA	µg/L	ND	ND	ND	ND
1,1-Dichloroethane	5	µg/L	2.7 J	2.3 J	2.6 J	ND
1,2-Dichloroethane	0.6	µg/L	ND	ND	ND	ND
1,1-Dichloroethene	5	µg/L	5.4	1.7 J	4.6 J	ND
cis 1,2-Dichloroethene	5	µg/L	38.6	1.6 J	30.4 J	0.85 J
trans 1,2-Dichloroethene	5	µg/L	ND	ND	ND	ND
Tetrachloroethene	5	µg/L	97.6	ND	75.9	ND
1,1,1-Trichloroethene	5	µg/L	4.7 J	ND	3.7 J	ND
Trichloroethene	5	µg/L	338	308	331	0.65 J
Vinyl Chloride	2	µg/L	4.3 J	ND	3.3 J	ND
Mercury	0.25	µg/L	ND	ND	ND	ND
Total Suspended Solids (TSS)	N/A	mg/L	ND	ND	ND	ND

Notes:

J - Estimated result between laboratory method detection limit and reporting limit

ND - Not detected above laboratory method detection limit

N/A - Not Applicable

(1) Influent concentrations presented are the weighted average concentrations of RW-1 and RW-3.

**GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Air Sampling Results
February 2012**

DAR Parameters	Units	SGC	February 2012	
			Influent	Effluent
Process Stream				
Sampling Date	N/A	N/A	2/17/12	
Average Flowrate	CFM	N/A	NR	8,562
Total Flow	ft ³	N/A	NR	357,560,509
Total Flow	m ³	N/A	NR	10,124,986
1,2-Dichloroethane	µg/m ³	N/A	8.1 J	ND
cis 1,2-Dichloroethene	µg/m ³	N/A	390	0.86 J
trans 1,2-Dichloroethene	µg/m ³	N/A	6.6 J	ND
1,2-Dichloroethene (total)	µg/m ³	N/A	400	0.87 J
Toluene	µg/m ³	37,000	25	0.93 J
Total Xylene	µg/m ³	4,300	18	1.3 J
1,1,2-Trichloroethane	µg/m ³	N/A	4.8 J	ND
Trichloroethene	µg/m ³	14,000	3400	12
Vinyl Chloride	µg/m ³	180,000	28	ND
Tetrachloroethene	µg/m ³	1,300	970	4.6 J

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

J - Estimated result between laboratory method detection limit and reporting limit

N/A - Not Applicable

NR - Not recorded

SGC - Short-term Guideline Concentration

**GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Controlled Stack Emissions
February 2012**

DAR Parameters	Units	Discharge Goal	February 2012
Sampling Date	N/A	N/A	2/17/12
Average Flowrate	CFM	N/A	8,562
Total Flow	ft ³	N/A	357,560,509
Total Flow	m ³	N/A	10,124,986
Trichloroethene	lb/hr	0.09	0.0004
Vinyl Chloride	lb/hr	0.01	0.0000
1,2 Dichloroethene	lb/hr	0.03	0.0000
1,2-Dichloroethane	lb/hr	BRT	0.0000
Toluene	lb/hr	BRT	0.0000
Total Xylene	lb/hr	BRT	0.0000
1,1,2-Trichloroethane	lb/hr	BRT	0.0000
Tetrachloroethene	lb/hr	0.02	0.0001

Notes:

BRT - below reporting thresholds

CFM - cubic feet per minute

DAR - Division of Air Resources

N/A - Not Applicable

March 2012



13 April 2012

Mr. Steven Scharf
New York State Department of Environmental Conservation
Division of Environmental Remediation
Remedial Action, Bureau A
625 Broadway
Albany, NY 12233-7015

**Subject: GROUNDWATER DISCHARGE MONITORING/AIR EMISSION REPORT
GM-38 AREA, NWIRP BETHPAGE, NY; DER SITE # 1-30-003B-OU 2
MARCH 2012 REPORTING PERIOD**

Dear Mr. Scharf:

H&S Environmental, Inc. (H&S) is submitting this monthly monitoring report of the groundwater discharge and air emission results for the Groundwater Treatment Plant (GWTP) located at the Former Naval Industrial Reserve Plant (NWIRP), Bethpage, NY, GM-38 Area. This report was prepared in accordance with GWTP operational requirements for DER Site # 1-30-003B-OU 2. H&S assumed operational responsibility of the GWTP on 1 June 2011. GWTP operational data from 1 March 2012 to 31 March 2012 are included in Attachment A. All constituents were within permit limitations during this reporting period.

Please contact Ms. Jennifer Good or myself at 508-366-7442 with any questions or concerns you may have regarding this report.

Sincerely,
H&S Environmental, Inc.

Patrick Schauble, P.E.
Senior Project Manager

Attachment A: Groundwater and Air Sampling Results from March 2012

Cc: Jean Occidental - NYSDEC Division of Water
William Spitz - NYSDEC – Region 1 Water Engineer
Gerard Ennis - Nassau County Department of Public Works
Richard Pfaender - Town of Oyster Bay
Lora Fly - NAVFAC Mid-Atlantic RPM
Al Taormina – H&S
GM-38 Copy

ATTACHMENT A
GROUNDWATER AND AIR SAMPLING RESULTS
MARCH 2012

**GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Discharge Monitoring Report
March 2012**

SPDES Parameters	March 2012					
Process Stream	Daily Treated Effluent Maximum	Units	RW-1	RW-3	Combined Influent ⁽¹⁾ (RW-1 + RW-3)	Treated Effluent
Well Depth	N/A	ft	500	500	500	N/A
Screened Interval	N/A	ft	470-500	470-500	470-500	N/A
Sampling Date	N/A		3/7/12			
Average Flowrate	1100	GPM	788	201	989	1,010
Total Flow	N/A	gallons	35,168,800	8,966,960	44,135,760	45,100,947
pH	5.5 - 8.5	SU	6.00	6.15	6.03	7.53
Carbon Tetrachloride	NA	µg/L	ND	ND	ND	ND
1,1-Dichloroethane	5	µg/L	2.6 J	2.3 J	2.5 J	ND
1,2-Dichloroethane	0.6	µg/L	ND	ND	ND	ND
1,1-Dichloroethene	5	µg/L	5.0 J	1.2 J	4.2 J	ND
cis 1,2-Dichloroethene	5	µg/L	38.4	1.8 J	31.0 J	0.96 J
trans 1,2-Dichloroethene	5	µg/L	ND	ND	ND	ND
Tetrachloroethene	5	µg/L	78.9	ND	62.9	ND
1,1,1-Trichloroethene	5	µg/L	5.4 J	ND	4.3 J	ND
Trichloroethene	5	µg/L	333	307	328	0.76 J
Vinyl Chloride	2	µg/L	2.7 J	ND	2.2 J	ND
Mercury	0.25	µg/L	ND	ND	ND	ND
Total Suspended Solids (TSS)	N/A	mg/L	ND	ND	ND	ND

Notes:

J - Estimated result between laboratory method detection limit and reporting limit

ND - Not detected above laboratory method detection limit

N/A - Not Applicable

(1) Influent concentrations presented are the weighted average concentrations of RW-1 and RW-3.

**GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Air Sampling Results
March 2012**

DAR Parameters	Units	SGC	March 2012	
			Influent	Effluent
Process Stream				
Sampling Date	N/A	N/A	3/14/12	
Average Flowrate	CFM	N/A	NR	8,530
Total Flow	ft ³	N/A	NR	380,768,040
Total Flow	m ³	N/A	NR	10,782,150
1,2-Dichloroethane	µg/m ³	N/A	5.6 J	ND
cis 1,2-Dichloroethene	µg/m ³	N/A	460	0.59 J
trans 1,2-Dichloroethene	µg/m ³	N/A	6.7 J	ND
1,2-Dichloroethene (total)	µg/m ³	N/A	480	0.59 J
Toluene	µg/m ³	37,000	6.4 J	1.2 J
Total Xylene	µg/m ³	4,300	9.3 J	ND
1,1,2-Trichloroethane	µg/m ³	N/A	ND	ND
Trichloroethene	µg/m ³	14,000	4200	9.7
Vinyl Chloride	µg/m ³	180,000	28	ND
Tetrachloroethene	µg/m ³	1,300	1100	3.7 J

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

J - Estimated result between laboratory method detection limit and reporting limit

N/A - Not Applicable

NR - Not recorded

SGC - Short-term Guideline Concentration

**GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Controlled Stack Emissions
March 2012**

DAR Parameters	Units	Discharge Goal	March 2012
Sampling Date	N/A	N/A	3/14/12
Average Flowrate	CFM	N/A	8,530
Total Flow	ft ³	N/A	380,768,040
Total Flow	m ³	N/A	10,782,150
Trichloroethene	lb/hr	0.09	0.00031
Vinyl Chloride	lb/hr	0.01	0.00000
1,2 Dichloroethene	lb/hr	0.03	0.00002
1,2-Dichloroethane	lb/hr	BRT	0.00000
Toluene	lb/hr	BRT	0.00004
Total Xylene	lb/hr	BRT	0.00000
1,1,2-Trichloroethane	lb/hr	BRT	0.00000
Tetrachloroethene	lb/hr	0.02	0.00012

Notes:

BRT - below reporting thresholds


CFM - cubic feet per minute

DAR - Division of Air Resources

N/A - Not Applicable

APPENDIX B
NYSDEC Air Permit Equivalent Approval

New York State Department of Environmental Conservation
Division of Environmental Remediation
Bureau of Remedial Action A
625 Broadway, 11th Floor
Albany, New York 12233-7015
Phone: (518) 402-9625 • Fax: (518) 402-9022
Website: www.dec.state.ny.us



Alexander P.
Grannis
Commissioner

July 24, 2009

Lora Fly, Project Manager
Naval Facilities Engineering Command-Midlant
9742 Maryland Avenue
Norfolk, VA 23511-3095

RE: Naval Weapons Industrial Research Plant(NWIRP)
Site-Bethpage, NYSDEC No. 1-30-003B.
Grumman Aerospace Site, NYSDEC Site No. 1-30-003A

Dear Ms. Fly:

Tetra Tech FW, on behalf of the Department of the Navy (Navy), has submitted the enclosed New York State Department of Environmental Conservation (NYSDEC) Division of Air Resources (DAR) Air Permit Application as a permit equivalent. This DAR Air permit equivalent is for the air stripper discharge at the GM 38 Area groundwater remediation system, Near Broadway and North Herman Avenue in Bethpage, NY. The NYSDEC Division of Environmental Remediation (DER) has reviewed the permit equivalent and, by means of this letter approves the GM 38 Area remedy air discharge for immediate operation.

The GM 38 Area remedial system utilizes the best available control technology (BACT) with activated carbon followed by potassium permanganate impregnated zeolite resin. The air discharge will be periodically monitored at start up and will be added for routine monitoring in the operation, maintenance and monitoring (OMM) plan, to be submitted shortly for Departmental review.

If you have any questions, please contact me at your earliest convenience at (518)402-9620.

Sincerely,

Steven M. Scharf, P.E.
Project Engineer
Division of Environmental Remediation
Bureau of Remedial Action A

Enclosure
ec/w/enc:

J. Swartwout/S. Scharf/File
W. Parish, Region 1 NYSDEC
A. J. Shah, region 1 NYSDEC
S. Patselos, Tetra Tech FW
J. Cofman, Northrop Grumman]

docs: Region 1, Nassau, Oyster Bay (T): Grumman Aerospace 130003A-OU2-OMM and NWIRP Bethpage 130003B-OU2-OMM

New York State Department of Environmental Conservation Air Permit Application



DEC ID									
-									

APPLICATION ID									
-							/		

OFFICE USE ONLY									

Section I - Certification

Title V Certification	
I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons directly responsible for gathering the information [required pursuant to 6 NYCRR 201-6.3(d)] I believe the information is, true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fines and imprisonment for knowing violations.	
Responsible Official	Title
Signature	Date ____ / ____ / ____

State Facility Certification	
I certify that this facility will be operated in conformance with all provisions of existing regulations.	
Responsible Official	Title
Signature	Date ____ / ____ / ____

Section II - Identification Information

Title V Facility Permit <u>N/A</u>	<input type="checkbox"/> New	<input type="checkbox"/> Significant Modification	<input type="checkbox"/> Administrative Amendment	State Facility Permit <u>N/A</u>	<input type="checkbox"/> New	<input type="checkbox"/> Modification
<input type="checkbox"/> Renewal	<input type="checkbox"/> Minor Modification	General Permit Title: _____		General Permit Title: _____		
<input checked="" type="checkbox"/> Application involves construction of new facility			<input type="checkbox"/> Application involves construction of new emission unit(s)			

Owner/Firm			
Name <u>US Navy/NAVFAC Midlant</u>			
Street Address <u>9742 Maryland Ave, Bldg Z-144</u>			
City <u>Norfolk</u>	State <u>VA</u>	Country <u>US</u>	Zip <u>23511-3095</u>
Owner Classification <input checked="" type="checkbox"/> Federal		<input type="checkbox"/> State <input type="checkbox"/> Municipal	
<input type="checkbox"/> Corporation/Partnership		<input type="checkbox"/> Individual	
Taxpayer ID [] [] [] [] [] [] [] [] [] []			
Facility			<input type="checkbox"/> Confidential
Name <u>Naval Weapons Industrial Reserve Plant (NWIRP) GM-38 Area</u>			
Location Address <u>Bethpage</u>			
<input type="checkbox"/> City / <input checked="" type="checkbox"/> Town / <input type="checkbox"/> Village <u>Oyster Bay, New York</u>			Zip <u>11714</u>
Project Description			<input type="checkbox"/> Continuation Sheet(s)
<u>Air stripping of groundwater to remove VOCs</u>			

Owner/Firm Contact Mailing Address			
Name (Last, First, Middle Initial) <u>Fly, Lora</u>		Phone No. (757)444-0781	
Affiliation <u>Department of the Navy</u>	Title <u>Remedial PM</u>	Fax No. ()	
Street Address <u>9742 Maryland Ave. Bldg Z-144</u>			
City <u>Norfolk</u>	State <u>VA</u>	Country <u>US</u>	Zip <u>23511-3095</u>
Facility Contact Mailing Address			
Name (Last, First, Middle Initial) <u>Same</u>		Phone No. ()	
Affiliation	Title	Fax No. ()	
Street Address			
City	State	Country	Zip

New York State Department of Environmental Conservation
Air Permit Application



DEC ID									
-									

Section III - Facility Information

Classification					
<input type="checkbox"/> Hospital	<input type="checkbox"/> Residential	<input type="checkbox"/> Educational/Institutional	<input type="checkbox"/> Commercial	<input checked="" type="checkbox"/> Industrial	<input type="checkbox"/> Utility

Affected States (Title V Only) N/A					
<input type="checkbox"/> Vermont	<input type="checkbox"/> Massachusetts	<input type="checkbox"/> Rhode Island	<input type="checkbox"/> Pennsylvania	Tribal Land: _____	
<input type="checkbox"/> New Hampshire	<input type="checkbox"/> Connecticut	<input type="checkbox"/> New Jersey	<input type="checkbox"/> Ohio	Tribal Land: _____	

SIC Codes											
9999											

Facility Description		<input type="checkbox"/> Continuation Sheet(s)
Groundwater Remediation by Air Stripping followed by Vapor-Phase GAC for emission control		

Compliance Statements (Title V Only) N/A	
<p>I certify that as of the date of this application the facility is in compliance with all applicable requirements: <input type="checkbox"/> YES <input type="checkbox"/> NO</p> <p>If one or more emission units at the facility are not in compliance with all applicable requirements at the time of signing this application (the 'NO' box must be checked), the noncomplying units must be identified in the "Compliance Plan" block on page 8 of this form along with the compliance plan information required. For all emission units at this facility that are operating <u>in compliance</u> with all applicable requirements complete the following:</p> <ul style="list-style-type: none"> <input type="checkbox"/> This facility will continue to be operated and maintained in such a manner as to assure compliance for the duration of the permit, except those units referenced in the compliance plan portion of Section IV of this application. <input type="checkbox"/> For all emission units, subject to any applicable requirements that will become effective during the term of the permit, this facility will meet all such requirements on a timely basis. <input type="checkbox"/> Compliance certification reports will be submitted at least once a year. Each report will certify compliance status with respect to each requirement, and the method used to determine the status. 	

Facility Applicable Federal Requirements N/A										<input type="checkbox"/> Continuation Sheet(s)
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause	
	CERCLA	all substantive requirements								

Facility State Only Requirements										<input type="checkbox"/> Continuation Sheet(s)
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause	

New York State Department of Environmental Conservation
Air Permit Application



DEC ID									
-									

Section IV - Emission Unit Information

Emission Unit Description										<input type="checkbox"/> Continuation Sheet(s)
EMISSION UNIT	0	-	0	0	E	U	1			
Air Stripper AS-1 for groundwater remediation, provided with activated carbon for emission control.										
The emission point is stack 00ST-1. The 2-stage VGAC is followed by a 3rd vessel containing a potassium permanganate zeolite media for increased VC capacity.										

Building					<input type="checkbox"/> Continuation Sheet(s)	
Building	Building Name			Length (ft)	Width (ft)	Orientation
BLDG-1	Treatment Plant			75	75	0

Emission Point							<input type="checkbox"/> Continuation Sheet(s)
EMISSION PT.	00ST1						
Ground Elev. (ft)	Height (ft)	Height Above Structure (ft)	Inside Diameter (in)	Exit Temp. (°F)	Cross Section		
90	40	15	36	80	Length (in)	Width (in)	
Exit Velocity (FPS)	Exit Flow (ACFM)	NYTM (E) (KM)	NYTM (N) (KM)	Building	Distance to Property Line (ft)	Date of Removal	
19	8020			BLDG-1	50		
EMISSION PT.							
Ground Elev. (ft)	Height (ft)	Height Above Structure (ft)	Inside Diameter (in)	Exit Temp. (°F)	Cross Section		
					Length (in)	Width (in)	
Exit Velocity (FPS)	Exit Flow (ACFM)	NYTM (E) (KM)	NYTM (N) (KM)	Building	Distance to Property Line (ft)	Date of Removal	

Emission Source/Control								<input type="checkbox"/> Continuation Sheet(s)
Emission Source		Date of Construction	Date of Operation	Date of Removal	Control Type		Manufacturer's Name/Model No.	
ID	Type				Code	Description		
AS-1	I				048	Granular Act. Carbon	Air Stripping Column	
Design Capacity	Design Capacity Units			Waste Feed		Waste Type		
	Code	Description		Code	Description	Code	Description	
Emission Source		Date of Construction	Date of Operation	Date of Removal	Control Type		Manufacturer's Name/Model No.	
ID	Type				Code	Description		
Design Capacity	Design Capacity Units			Waste Feed		Waste Type		
	Code	Description		Code	Description	Code	Description	

New York State Department of Environmental Conservation
Air Permit Application



DEC ID									
-									

Section IV - Emission Unit Information (continued)

Process Information										<input type="checkbox"/> Continuation Sheet(s)	
EMISSION UNIT 0 - 00 E U 1								PROCESS		PR 1	
Description											
The remedial system is air stripping, using a packed column at a groundwater flow rate of 1,100 gpm (plus 100 gpm recycle, for a total of 1,200 gpm). Vapor phase treatment includes the use of 3 vessels, a 2-stage GAC unit, followed by a 3rd vessel containing a potassium permanganate impregnated zeolite for increased VC capacity. Prior to entering the vapor-phase GAC adsorption system, the humidity of the air stripper exhaust is reduced to approximately 50 percent or less to optimize the efficiency of the vapor-phase GAC.											
Air Stripper AS-1: Existing. Type: Vertical, Cylindrical Construction: Aluminum											
Packing: 25-foot Jaeger Tripack. Dimensions: 10.0 ft. Dia x 47 ft. H											
Source Classification Code (SCC)		Total Thruput		Thruput Quantity Units							
		Quantity/Hr	Quantity/Yr	Code		Description					
<input type="checkbox"/> Confidential <input checked="" type="checkbox"/> Operating at Maximum Capacity <input type="checkbox"/> Activity with Insignificant Emissions		Operating Schedule		Building		Floor/Location					
		Hrs/Day	Days/Yr								
		24	365	BLDG-1		Main					
Emission Source/Control Identifier(s)											
AS-1											
EMISSION UNIT -								PROCESS			
Description											
Source Classification Code (SCC)		Total Thruput		Thruput Quantity Units							
		Quantity/Hr	Quantity/Yr	Code		Description					
<input type="checkbox"/> Confidential <input type="checkbox"/> Operating at Maximum Capacity <input type="checkbox"/> Activity with Insignificant Emissions		Operating Schedule		Building		Floor/Location					
		Hrs/Day	Days/Yr								
Emission Source/Control Identifier(s)											

New York State Department of Environmental Conservation
Air Permit Application



DEC ID									
-									

Section IV - Emission Unit Information (continued)

Emission Unit	Emission Point	Process	Emission Source	Emission Unit Applicable Federal Requirements										<input type="checkbox"/> Continuation Sheet(s)	
				Title	Type	Part	Sub Part	Section	Sub Division	Parag.	Sub Parag.	Clause	Sub Clause		
-															
-															
-															
-															

Emission Unit	Emission Point	Process	Emission Source	Emission Unit State Only Requirements										<input type="checkbox"/> Continuation Sheet(s)	
				Title	Type	Part	Sub Part	Section	Sub Division	Parag.	Sub Parag.	Clause	Sub Clause		
-															
-															
-															
-															

Emission Unit Compliance Certification											<input type="checkbox"/> Continuation Sheet(s)
Rule Citation											
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause		
6	NYCRR	212									
<input checked="" type="checkbox"/> Applicable Federal Requirement				<input type="checkbox"/> State Only Requirement				<input type="checkbox"/> Capping			
Emission Unit	Emission Point	Process	Emission Source	CAS No.			Contaminant Name				
0-00EU1	00ST1	PR1	AS-1	00079 - 01 - 6			Trichloroethylene				
Monitoring Information											
<input type="checkbox"/> Continuous Emission Monitoring				<input type="checkbox"/> Monitoring of Process or Control Device Parameters as Surrogate							
<input checked="" type="checkbox"/> Intermittent Emission Testing				<input type="checkbox"/> Work Practice Involving Specific Operations							
<input type="checkbox"/> Ambient Air Monitoring				<input type="checkbox"/> Record Keeping/Maintenance Procedures							
Description											
Monthly grab samples analyzed for VOCs from the vapor phase treatment system influent, effluent and two intermediate locations.											
Work Practice		Process Material					Reference Test Method				
Type	Code	Description									
Parameter		Manufacturer Name/Model No.									
Code	Description										
23	Concentration										
Limit			Limit Units								
Upper	Lower	Code	Description								
3,125		255	micrograms per cubic meter								
Averaging Method			Monitoring Frequency			Reporting Requirements					
Code	Description	Code	Description	Code	Description						
01	Instantaneous	05	Monthly	10	Upon Request						

New York State Department of Environmental Conservation
Air Permit Application



DEC ID									
-									

Section IV - Emission Unit Information (continued)

Determination of Non-Applicability (Title V Only) N/A <input type="checkbox"/> Continuation Sheet(s)										
Rule Citation										
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause	
Emission Unit	Emission Point	Process	Emission Source			<input type="checkbox"/> Applicable Federal Requirement <input type="checkbox"/> State Only Requirement				
Description										
Rule Citation										
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause	
Emission Unit	Emission Point	Process	Emission Source			<input type="checkbox"/> Applicable Federal Requirement <input type="checkbox"/> State Only Requirement				
Description										
Process Emissions Summary <input type="checkbox"/> Continuation Sheet(s)										
EMISSION UNIT	0 - 0 0 E U 1					PROCESS	P	R	1	
CAS No.	Contaminant Name			% Thruput	% Capture	% Control	ERP (lbs/hr)	ERP How Determined		
0079 - 01 - 6	Trichloroethylene					95	1.87	02		
PTE			Standard Units	PTE How Determined		Actual				
(lbs/hr)	(lbs/yr)	(standard units)				(lbs/hr)	(lbs/yr)			
0.09	99			02						
EMISSION UNIT	0 - 0 0 E U 1					PROCESS	P	R	1	
CAS No.	Contaminant Name			% Thruput	% Capture	% Control	ERP (lbs/hr)	ERP How Determined		
00075 - 01 - 4	Vinyl Chloride					95	0.17	03		
PTE			Standard Units	PTE How Determined		Actual				
(lbs/hr)	(lbs/yr)	(standard units)				(lbs/hr)	(lbs/yr)			
0.01	3.7			02						
EMISSION UNIT	0 - 0 0 E U 1					PROCESS	P	R	1	
CAS No.	Contaminant Name			% Thruput	% Capture	% Control	ERP (lbs/hr)	ERP How Determined		
000540 - 59 - 0	1,2-Dichloroethylene					95	0.6	02		
PTE			Standard Units	PTE How Determined		Actual				
(lbs/hr)	(lbs/yr)	(standard units)				(lbs/hr)	(lbs/yr)			
0.03	7.3			02						

New York State Department of Environmental Conservation
Air Permit Application



DEC ID									
-									

Section IV - Emission Unit Information (continued)

EMISSION UNIT		Emission Unit Emissions Summary				<input type="checkbox"/> Continuation Sheet(s)
0	-	0	0	E	U	1
CAS No.		Contaminant Name				
00107- 06 - 2		1,2-Dichloroethane				
ERP (lbs/yr)	PTE Emissions		Actual			
	(lbs/hr)	(lbs/yr)	(lbs/hr)	(lbs/yr)		
13.4	Below Reporting Threshold BRT					
CAS No.		Contaminant Name				
00108 - 88 - 3		Toluene				
ERP (lbs/yr)	PTE Emissions		Actual			
	(lbs/hr)	(lbs/yr)	(lbs/hr)	(lbs/yr)		
72.7	BRT		BRT			
CAS No.		Contaminant Name				
01330- 20 - 7		Xylene				
ERP (lbs/yr)	PTE Emissions		Actual			
	(lbs/hr)	(lbs/yr)	(lbs/hr)	(lbs/yr)		
77.1	BRT		BRT			
CAS No.		Contaminant Name				
-		1,1,2-Trichloroethane				
ERP (lbs/yr)	PTE Emissions		Actual			
	(lbs/hr)	(lbs/yr)	(lbs/hr)	(lbs/yr)		
	BRT		BRT			

Compliance Plan													<input type="checkbox"/> Continuation Sheet(s)
For any emission units which are <u>not in compliance</u> at the time of permit application, the applicant shall complete the following													
Consent Order			Certified progress reports are to be submitted every 6 months beginning ____ / ____ / ____										
Emission Unit	Process	Emission Source	Applicable Federal Requirement										
			Title	Type	Part	Sub Part	Section	Sub Division	Parag.	Sub Parag.	Clause	Sub Clause	
Remedial Measure / Intermediate Milestones											R/I	Date Scheduled	

New York State Department of Environmental Conservation
Air Permit Application



DEC ID											
-											

Section IV - Emission Unit Information (continued)

Request for Emission Reduction Credits										<input type="checkbox"/> Continuation Sheet(s)	
EMISSION UNIT -											
Emission Reduction Description											
Contaminant Emission Reduction Data											
Baseline Period ____ / ____ / ____ to ____ / ____ / ____						Reduction					
						Date		Method			
						/ /					
CAS No.			Contaminant Name			ERC (lbs/yr)					
-			-			Netting		Offset			
-			-			-		-			
-			-			-		-			
Facility to Use Future Reduction											
Name						APPLICATION ID					
						- / -					
Location Address											
<input type="checkbox"/> City / <input type="checkbox"/> Town / <input type="checkbox"/> Village						State		Zip			

Use of Emission Reduction Credits										<input type="checkbox"/> Continuation Sheet(s)	
EMISSION UNIT -											
Proposed Project Description											
Contaminant Emissions Increase Data											
CAS No.			Contaminant Name			PEP (lbs/yr)					
-			-			-					
Statement of Compliance											
<input type="checkbox"/> All facilities under the ownership of this "ownership/firm" are operating in compliance with all applicable requirements and state regulations including any compliance certification requirements under Section 114(a)(3) of the Clean Air Act Amendments of 1990, or are meeting the schedule of a consent order.											
Source of Emission Reduction Credit - Facility											
Name						PERMIT ID					
						- / -					
Location Address											
<input type="checkbox"/> City / <input type="checkbox"/> Town / <input type="checkbox"/> Village						State		Zip			
Emission Unit		CAS No.		Contaminant Name		ERC (lbs/yr)					
-		-		-		Netting		Offset			
-		-		-		-		-			
-		-		-		-		-			



DEC ID									
-									

Supporting Documentation

- P.E. Certification (form attached)
- List of Exempt Activities (form attached)
- Plot Plan
- Methods Used to Determine Compliance (form attached)
- Calculations
- Air Quality Model (____ / ____ / ____)
- Confidentiality Justification
- Ambient Air Monitoring Plan (____ / ____ / ____)
- Stack Test Protocols/Reports (____ / ____ / ____)
- Continuous Emissions Monitoring Plans/QA/QC (____ / ____ / ____)
- MACT Demonstration (____ / ____ / ____)
- Operational Flexibility: Description of Alternative Operating Scenarios and Protocols
- Title IV: Application/Registration
- ERC Quantification (form attached)
- Use of ERC(s) (form attached)
- Baseline Period Demonstration
- Analysis of Contemporaneous Emission Increase/Decrease
- LAER Demonstration (____ / ____ / ____)
- BACT Demonstration (____ / ____ / ____)
- Other Document(s): _____ (____ / ____ / ____)
- _____ (____ / ____ / ____)
- _____ (____ / ____ / ____)
- _____ (____ / ____ / ____)
- _____ (____ / ____ / ____)
- _____ (____ / ____ / ____)
- _____ (____ / ____ / ____)
- _____ (____ / ____ / ____)
- _____ (____ / ____ / ____)
- _____ (____ / ____ / ____)
- _____ (____ / ____ / ____)
- _____ (____ / ____ / ____)
- _____ (____ / ____ / ____)

**ATTACHMENT 1
Emission Estimate**

Feed Water Flow 1,100 gpm: max or normal
250 m³/hr
Water Flow Including Recycle 1,200 gpm: max or normal
273 m³/hr
Air Flow 8,000 cfm
13,592 m³/hr
A/W vol ratio 50

EXAMPLE EMISSION CALC: Vinyl Chloride
4.8 ug/L x 1000 L/m³ x 250 m³ water/13,623 m³ air = 88 ug/m³

Name	CAS Number	Toxicity: H/M/L ²	VOC ³	HAP ⁴	GW Conc. ¹		Effluent Conc ¹		Uncontrolled Stripper Exhaust							
					Max ug/L	Avg ug/L	Max ug/L	Avg ug/L	Max lb/day	Avg lb/day	Max lb/hr	Avg lb/hr	Max gm/sec	Avg gm/sec	Max ug/m ³	Avg ug/m ³
1,1,1-Trichloroethane (Methyl Chloroform)	00071-55-6	L	No	Yes	3	3.0			0.04	0.04	0.00	0.00	2.08E-04	2.08E-04	55	55
1,1,2-Trichloroethane	00079-00-5	M	Yes	Yes	3.5	0.3			0.05	0.00	0.00	0.00	2.43E-04	2.08E-05	64	6
1,1-Dichloroethane	00075-34-3	L	Yes	Yes	4	0.7			0.05	0.01	0.00	0.00	2.77E-04	4.85E-05	74	13
1,2-Dichloroethane	00107-06-2	M	Yes	Yes	3	1.0	0.3	0.1	0.04	0.01	0.00	0.00	1.87E-04	6.24E-05	55	18
1,1-Dichloroethylene (Vinylidene Chloride)	00075-35-4	M	Yes	Yes	9	1.6			0.12	0.02	0.00	0.00	6.24E-04	1.11E-04	165	29
1,2-Dichloroethylene	00540-59-0	M	Yes	No	1,100	31.5	1.3	0.0	14.51	0.42	0.60	0.02	7.62E-02	2.18E-03	20,219	579
Benzene	00071-43-2	H	Yes	Yes	4	0.1			0.05	0.00	0.00	0.00	2.77E-04	6.94E-06	74	2
Carbon Tetrachloride	00056-23-5	H	Yes	Yes	4	0.1			0.05	0.00	0.00	0.00	2.77E-04	6.94E-06	74	2
Chlorobenzene (Monochlorobenzene)	00108-90-7	M	Yes	Yes	1	0.1			0.01	0.00	0.00	0.00	6.94E-05	6.94E-06	18	2
Chloroform	00067-66-3	M	Yes	Yes	2	0.8			0.03	0.01	0.00	0.00	1.39E-04	5.55E-05	37	15
Methyl Tert Butyl Ether	01634-04-4	M	Yes	Yes	2	0.1			0.03	0.00	0.00	0.00	1.39E-04	6.94E-06	37	2
Tetrachloroethylene	00127-18-4	M	Yes	Yes	900	33.8	0.9	0.0	11.88	0.45	0.49	0.02	6.24E-02	2.34E-03	16,543	621
Toluene	00108-88-3	L	Yes	Yes	15	0.7			0.20	0.01	0.01	0.00	1.04E-03	4.85E-05	276	13
Trichloroethylene	00079-01-6	M	Yes	Yes	3,400	411.5	4.5	0.5	44.86	5.43	1.87	0.23	2.35E-01	2.85E-02	62,494	7,564
Vinyl chloride	00075-01-4	H	Yes	Yes	300	4.8	0.0	0.0	3.96	0.06	0.17	0.00	2.08E-02	3.33E-04	5,514	88
Xylenes	01330-20-7	M	Yes	Yes	16	0.2			0.21	0.00	0.01	0.00	1.11E-03	1.39E-05	294	4
Total VOCs					5,764	487.3	7.0	0.6	76.05	6.43	3.17	0.27				
Total HAPs					4,667	458.8	5.7	0.6	61.57	6.05	2.57	0.25				
									Total Uncontrolled VOC		2,347 lb/yr					
									Total Uncontrolled HAP		2,209 lb/yr					

1. Source: "GM-38 Groundwater Remedy Analysis Report", February 2003
2. Source: DAR-1 AGC/SGC Tables, NYSDEC Division of Air Resources, Air Toxics Section, September 10, 2007.
3. Source: 6 NYCRR Part 200 1(cg)
4. Source: 6 NYCRR Part 200.1(ag)

ATTACHMENT 1 Emission Estimate

Feed Water Flow 1,100 gpm: max or normal
 250 m³/hr
 Water Flow Including Recycle 1,200 gpm: max or normal
 273 m³/hr
 Air Flow 8,000 cfm
 13,592 m³/hr
 A/W vol ratio 50

Name	CAS Number	Toxicity: H/M/L ²	VOC ³	HAP ⁴	Control by GAC	Max lb/day	Avg lb/day	Controlled Stripper Exhat	
								Max gm/sec	Avg gm/sec
1,1,1-Trichloroethane (Methyl Chloroform)	00071-55-6	L	No	Yes	95%	0.00	0.00	1.04E-05	1.04E-05
1,1,2-Trichloroethane	00079-00-5	M	Yes	Yes	95%	0.00	0.00	1.21E-05	1.04E-06
1,1-Dichloroethane	00075-34-3	L	Yes	Yes	95%	0.00	0.00	1.39E-05	2.43E-06
1,2-Dichloroethane	00107-06-2	M	Yes	Yes	95%	0.00	0.00	9.36E-06	3.12E-06
1,1-Dichloroethylene (Vinylidene Chloride)	00075-35-4	M	Yes	Yes	95%	0.01	0.00	3.12E-05	5.55E-06
1,2-Dichloroethylene	00540-59-0	M	Yes	No	95%	0.73	0.02	3.81E-03	1.09E-04
Benzene	00071-43-2	H	Yes	Yes	95%	0.00	0.00	1.39E-05	3.47E-07
Carbon Tetrachloride	00056-23-5	H	Yes	Yes	95%	0.00	0.00	1.39E-05	3.47E-07
Chlorobenzene (Monochlorobenzene)	00108-90-7	M	Yes	Yes	95%	0.00	0.00	3.47E-06	3.47E-07
Chloroform	00067-66-3	M	Yes	Yes	95%	0.00	0.00	6.94E-06	2.77E-06
Methyl Tert Butyl Ether	01634-04-4	M	Yes	Yes	95%	0.00	0.00	6.94E-06	3.47E-07
Tetrachloroethylene	00127-18-4	M	Yes	Yes	95%	0.59	0.02	3.12E-03	1.17E-04
Toluene	00108-88-3	L	Yes	Yes	95%	0.01	0.00	5.20E-05	2.43E-06
Trichloroethylene	00079-01-6	M	Yes	Yes	95%	2.24	0.27	1.18E-02	1.43E-03
Vinyl chloride	00075-01-4	H	Yes	Yes	95%	0.20	0.00	1.04E-03	1.66E-05
Xylenes	01330-20-7	M	Yes	Yes	95%	0.01	0.00	5.55E-05	6.94E-07
Total VOCs						3.80	0.32		
Total HAPs						3.08	0.30		
						Total Controlled VOC		117 lb/yr	
						Total Controlled HAP		110 lb/yr	

1. Source: "GM-38 Groundwater Remedy Analysis Report", February 2003
2. Source: DAR-1 AGC/SGC Tables, NYSDEC Division of Air Resources, Air Tox
3. Source: 6 NYCRR Part 200.1(cg)
4. Source: 6 NYCRR Part 200.1(ag)

ATTACHMENT 2
AIR SCREENING ANALYSIS:
Annual

BETHPAGE SCREENING ANALYSIS					1-Hour Impact	405.7	(ug/m ³)		
ANNUAL IMPACTS COMPARED TO ANNUAL GUIDELINE CONCENTRATIONS (AGCs)					Annual Impact	32.456	(ug/m ³)		
			NYSDEC	Estimated Emissions		Predicted Annual Impact		Maximum Percent of AGC	
			Guideline	Uncontrolled	Controlled	Uncontrolled	Controlled	Uncontrolled	Controlled
			AGC	(g/s)	(g/s)	(ug/m ³)	(ug/m ³)	Pct	Pct
Pollutant	CAS Number	(ug/m ³)							
1,1,1-Trichloroethane (Methyl Chloroform)	00071-55-6	1000.00	2.08E-04	1.04E-05	0.0068	0.0003	0.0%	0.0%	
1,1,2-Trichloroethane	00079-00-5	1.40	2.08E-05	1.04E-06	0.0007	0.0000	0.0%	0.0%	
1,1-Dichloroethane	00075-34-3	0.63	4.85E-05	2.43E-06	0.0016	0.0001	0.3%	0.0%	
1,2-Dichloroethane	00107-06-2	0.04	6.24E-05	3.12E-06	0.0020	0.0001	5.3%	0.3%	
1,1-Dichloroethylene (Vinylidene Chloride)	00075-35-4	70.00	1.11E-04	5.55E-06	0.0036	0.0002	0.0%	0.0%	
1,2-Dichloroethylene	00540-59-0	63.00	2.18E-03	1.09E-04	0.0709	0.0035	0.1%	0.0%	
Benzene	00071-43-2	0.13	6.94E-06	3.47E-07	0.0002	0.0000	0.2%	0.0%	
Carbon Tetrachloride	00056-23-5	0.07	6.94E-06	3.47E-07	0.0002	0.0000	0.3%	0.0%	
Chlorobenzene (Monochlorobenzene)	00108-90-7	110.00	6.94E-06	3.47E-07	0.0002	0.0000	0.0%	0.0%	
Chloroform	00067-66-3	0.04	5.55E-05	2.77E-06	0.0018	0.0001	4.2%	0.2%	
Methyl tert-Butyl Ether	01634-04-4	3000.00	6.94E-06	3.47E-07	0.0002	0.0000	0.0%	0.0%	
Tetrachloroethylene	00127-18-4	1.00	2.34E-03	1.17E-04	0.0761	0.0038	7.6%	0.4%	
Toluene	00108-88-3	5000.00	4.85E-05	2.43E-06	0.0016	0.0001	0.0%	0.0%	
Trichloroethylene	00079-01-6	0.50	2.85E-02	1.43E-03	0.9252	0.0463	185.0%	9.3%	
Vinyl Chloride	00075-01-4	0.11	3.33E-04	1.66E-05	0.0108	0.0005	9.8%	0.5%	
Xylenes	01330-20-7	100.00	1.39E-05	6.94E-07	0.0005	0.0000	0.0%	0.0%	

**ATTACHMENT 2
AIR SCREENING ANALYSIS:
Short term**

BETHPAGE SCREENING ANALYSIS					1-Hour Impact	405.7	(ug/m ³)	
SHORT-TERM IMPACTS COMPARED TO SHORT-TERM GUIDELINE CONCENTRATIONS (SGCs)					Annual Impact	32.456	(ug/m ³)	
Pollutant	CAS Number	NYSDEC Guideline SGC (ug/m³)	Estimated Emissions		Predicted Short-term Impact		Maximum Percent of SGC	
			Uncontrolled (g/s)	Controlled (g/s)	Uncontrolled (ug/m³)	Controlled (ug/m³)	Uncontrolled Pct	Controlled Pct
1,1,1-Trichloroethane (Methyl Chloroform)	00071-55-6	68000.00	2.08E-04	1.04E-05	0.084	0.004	0.0%	0.0%
1,1,2-Trichloroethane	00079-00-5	-	2.43E-04	1.21E-05	0.098	0.005	-	-
1,1-Dichloroethane	00075-34-3	-	2.77E-04	1.39E-05	0.113	0.006	-	-
1,2-Dichloroethane	00107-06-2	-	1.87E-04	9.36E-06	0.076	0.004	-	-
1,1-Dichloroethylene (Vinylidene Chloride)	00075-35-4	-	6.24E-04	3.12E-05	0.253	0.013	-	-
1,2-Dichloroethylene	00540-59-0	-	7.62E-02	3.81E-03	30.915	1.546	-	-
Benzene	00071-43-2	1300.00	2.77E-04	1.39E-05	0.113	0.006	0.0%	0.0%
Carbon Tetrachloride	00056-23-5	1900.00	2.77E-04	1.39E-05	0.113	0.006	0.0%	0.0%
Chlorobenzene (Monochlorobenzene)	00108-90-7	-	6.94E-05	3.47E-06	0.028	0.001	-	-
Chloroform	00067-66-3	150.00	1.39E-04	6.94E-06	0.056	0.003	0.0%	0.0%
Methyl tert-Butyl Ether	01634-04-4	-	1.39E-04	6.94E-06	0.056	0.003	-	-
Tetrachloroethylene	00127-18-4	1000.00	6.24E-02	3.12E-03	25.298	1.265	2.5%	0.1%
Toluene	00108-88-3	37000.00	1.04E-03	5.20E-05	0.422	0.021	0.0%	0.0%
Trichloroethylene	00079-01-6	14000.00	2.35E-01	1.18E-02	95.541	4.777	0.7%	0.0%
Vinyl Chloride	00075-01-4	180000.00	2.08E-02	1.04E-03	8.441	0.422	0.0%	0.0%
Xylenes	01330-20-7	4300.00	1.11E-03	5.55E-05	0.450	0.023	0.0%	0.0%

**ATTACHMENT 2
AIR SCREENING ANALYSIS:
Short term**

BETHPAGE SCREENING ANALYSIS					1-Hour Impact	405.7	(ug/m ³)	
SHORT-TERM IMPACTS COMPARED TO SHORT-TERM GUIDELINE CONCENTRATIONS (SGCs)					Annual Impact	32.456	(ug/m ³)	
Pollutant	CAS Number	NYSDEC Guideline SGC (ug/m ³)	Estimated Emissions		Predicted Short-term Impact		Maximum Percent of SGC	
			Uncontrolled (g/s)	Controlled (g/s)	Uncontrolled (ug/m ³)	Controlled (ug/m ³)	Uncontrolled Pct	Controlled Pct
1,1,1-Trichloroethane (Methyl Chloroform)	00071-55-6	68000.00	2.08E-04	1.04E-05	0.084	0.004	0.0%	0.0%
1,1,2-Trichloroethane	00079-00-5	-	2.43E-04	1.21E-05	0.098	0.005	-	-
1,1-Dichloroethane	00075-34-3	-	2.77E-04	1.39E-05	0.113	0.006	-	-
1,2-Dichloroethane	00107-06-2	-	1.87E-04	9.36E-06	0.076	0.004	-	-
1,1-Dichloroethylene (Vinylidene Chloride)	00075-35-4	-	6.24E-04	3.12E-05	0.253	0.013	-	-
1,2-Dichloroethylene	00540-59-0	-	7.62E-02	3.81E-03	30.915	1.546	-	-
Benzene	00071-43-2	1300.00	2.77E-04	1.39E-05	0.113	0.006	0.0%	0.0%
Carbon Tetrachloride	00056-23-5	1900.00	2.77E-04	1.39E-05	0.113	0.006	0.0%	0.0%
Chlorobenzene (Monochlorobenzene)	00108-90-7	-	6.94E-05	3.47E-06	0.028	0.001	-	-
Chloroform	00067-66-3	150.00	1.39E-04	6.94E-06	0.056	0.003	0.0%	0.0%
Methyl tert-Butyl Ether	01634-04-4	-	1.39E-04	6.94E-06	0.056	0.003	-	-
Tetrachloroethylene	00127-18-4	1000.00	6.24E-02	3.12E-03	25.298	1.265	2.5%	0.1%
Toluene	00108-88-3	37000.00	1.04E-03	5.20E-05	0.422	0.021	0.0%	0.0%
Trichloroethylene	00079-01-6	14000.00	2.35E-01	1.18E-02	95.541	4.777	0.7%	0.0%
Vinyl Chloride	00075-01-4	180000.00	2.08E-02	1.04E-03	8.441	0.422	0.0%	0.0%
Xylenes	01330-20-7	4300.00	1.11E-03	5.55E-05	0.450	0.023	0.0%	0.0%

03/16/09
11:26:15

*** SCREEN3 MODEL RUN ***
*** VERSION DATED 96043 ***

Bethpage GM-38 Air Stripper Uncontrolled

SIMPLE TERRAIN INPUTS:

SOURCE TYPE = POINT
EMISSION RATE (G/S) = 1.00000
STACK HEIGHT (M) = 12.2000
STK INSIDE DIAM (M) = .9100
STK EXIT VELOCITY (M/S) = 5.7700
STK GAS EXIT TEMP (K) = 294.0000
AMBIENT AIR TEMP (K) = 293.0000
RECEPTOR HEIGHT (M) = .0000
URBAN/RURAL OPTION = URBAN
BUILDING HEIGHT (M) = 7.6000
MIN HORIZ BLDG DIM (M) = 22.9000
MAX HORIZ BLDG DIM (M) = 22.9000

THE REGULATORY (DEFAULT) MIXING HEIGHT OPTION WAS SELECTED.
THE REGULATORY (DEFAULT) ANEMOMETER HEIGHT OF 10.0 METERS WAS ENTERED.

BUOY. FLUX = .040 M**4/S**3; MOM. FLUX = 6.869 M**4/S**2.

*** FULL METEOROLOGY ***

*** SCREEN AUTOMATED DISTANCES ***

*** TERRAIN HEIGHT OF 0. M ABOVE STACK BASE USED FOR FOLLOWING DISTANCES ***

DIST (M)	CONC (UG/M**3)	STAB	U10M (M/S)	USTK (M/S)	MIX HT (M)	PLUME HT (M)	SIGMA Y (M)	SIGMA Z (M)	DWASH
10.	.1323E-07	1	1.5	1.5	480.0	22.39	3.65	2.99	NO
100.	278.3	3	1.0	1.0	320.0	27.34	22.00	20.46	NO
200.	339.9	6	1.0	1.1	10000.0	20.81	21.31	14.25	NO

MAXIMUM 1-HR CONCENTRATION AT OR BEYOND 10. M:

201.	339.9	6	1.0	1.1	10000.0	20.81	21.51	14.37	NO
------	-------	---	-----	-----	---------	-------	-------	-------	----

*** SCREEN AUTOMATED DISTANCES ***

*** TERRAIN HEIGHT OF 2. M ABOVE STACK BASE USED FOR FOLLOWING DISTANCES ***

DIST (M)	CONC (UG/M**3)	STAB	U10M (M/S)	USTK (M/S)	MIX HT (M)	PLUME HT (M)	SIGMA Y (M)	SIGMA Z (M)	DWASH
210.	405.7	6	1.0	1.1	10000.0	18.81	22.32	14.86	NO
300.	307.9	6	1.0	1.1	10000.0	18.81	31.28	20.08	NO
400.	219.2	6	1.0	1.1	10000.0	18.81	40.93	25.42	NO

500.	162.3	6	1.0	1.1	10000.0	18.81	50.27	30.34	NO
600.	125.2	6	1.0	1.1	10000.0	18.81	59.32	34.91	NO

MAXIMUM 1-HR CONCENTRATION AT OR BEYOND 210. M:

210.	405.7	6	1.0	1.1	10000.0	18.81	22.32	14.86	NO
------	-------	---	-----	-----	---------	-------	-------	-------	----

 *** SCREEN AUTOMATED DISTANCES ***

*** TERRAIN HEIGHT OF 9. M ABOVE STACK BASE USED FOR FOLLOWING DISTANCES ***

DIST (M)	CONC (UG/M**3)	STAB	U10M (M/S)	USTK (M/S)	MIX HT (M)	PLUME HT (M)	SIGMA Y (M)	SIGMA Z (M)	DWASH
610.	133.2	6	1.0	1.1	10000.0	11.81	60.21	35.35	NO
700.	107.4	6	1.0	1.1	10000.0	11.81	68.10	39.19	NO
800.	87.22	6	1.0	1.1	10000.0	11.81	76.63	43.22	NO
900.	72.75	6	1.0	1.1	10000.0	11.81	84.93	47.03	NO

MAXIMUM 1-HR CONCENTRATION AT OR BEYOND 610. M:

610.	133.2	6	1.0	1.1	10000.0	11.81	60.21	35.35	NO
------	-------	---	-----	-----	---------	-------	-------	-------	----

 *** SCREEN AUTOMATED DISTANCES ***

*** TERRAIN HEIGHT OF 11. M ABOVE STACK BASE USED FOR FOLLOWING DISTANCES ***

DIST (M)	CONC (UG/M**3)	STAB	U10M (M/S)	USTK (M/S)	MIX HT (M)	PLUME HT (M)	SIGMA Y (M)	SIGMA Z (M)	DWASH
1000.	62.47	6	1.0	1.1	10000.0	9.81	93.00	50.66	NO
1100.	54.05	6	1.0	1.1	10000.0	9.81	100.86	54.11	NO
1200.	47.42	6	1.0	1.1	10000.0	9.81	108.53	57.42	NO
1300.	42.10	6	1.0	1.1	10000.0	9.81	116.01	60.60	NO

MAXIMUM 1-HR CONCENTRATION AT OR BEYOND 1000. M:

1000.	62.47	6	1.0	1.1	10000.0	9.81	93.00	50.66	NO
-------	-------	---	-----	-----	---------	------	-------	-------	----

DWASH= MEANS NO CALC MADE (CONC = 0.0)
 DWASH=NO MEANS NO BUILDING DOWNWASH USED
 DWASH=HS MEANS HUBER-SNYDER DOWNWASH USED
 DWASH=SS MEANS SCHULMAN-SCIRE DOWNWASH USED
 DWASH=NA MEANS DOWNWASH NOT APPLICABLE, X<3*LB

 * SUMMARY OF TERRAIN HEIGHTS ENTERED FOR *
 * SIMPLE ELEVATED TERRAIN PROCEDURE *

TERRAIN HT (M)	DISTANCE RANGE (M)	
	MINIMUM	MAXIMUM
0.	10.	200.
2.	210.	600.
9.	610.	920.

11. 1000. 1300.

*** REGULATORY (Default) ***
PERFORMING CAVITY CALCULATIONS
WITH ORIGINAL SCREEN CAVITY MODEL
(BRODE, 1988)

*** CAVITY CALCULATION - 1 ***

CONC (UG/M**3) = .0000
CRIT WS @10M (M/S) = 99.99
CRIT WS @ HS (M/S) = 99.99
DILUTION WS (M/S) = 99.99
CAVITY HT (M) = 7.84
CAVITY LENGTH (M) = 22.86
ALONGWIND DIM (M) = 22.90

*** CAVITY CALCULATION - 2 ***

CONC (UG/M**3) = .0000
CRIT WS @10M (M/S) = 99.99
CRIT WS @ HS (M/S) = 99.99
DILUTION WS (M/S) = 99.99
CAVITY HT (M) = 7.84
CAVITY LENGTH (M) = 22.86

APPENDIX C
Field Data Sheets and
Chain of Custody Documentation

Date: 3/7/12



Groundwater Level Measurement Sheet

Project Site: NWIRP Bethpage – GM-38
 Location: Bethpage, NY
 Field Crew: VL/SL

Water Level Meter: Solinst
 Weather: 50°F clear
 Time of Low Tide: N/A
 Time of High Tide: N/A

Well ID	Time	Depth to Water (ft.)	Total Depth of Well / Screenshot Interval (ft.)	PID (ppm)	Comments
RW1-MW1	0952 0857 (SL)	34.35 37.45 (SL)	435 / 395-435		
RW1-MW2	0838	36.44	435 / 395-435		Gauge only
RW1-MW3	0920	28.45	435 / 395-435		
RW2-MW1	0857	37.45	510 / 470-510		
RW2-MW2	0941	36.89	510 / 470-510		Gauge only MISSING 1 BOLT
RW2-MW3	0939	36.43	510 / 470-510		Gauge only MISSING 2 BOLTS
RW3-MW1	1705	36.26	350 / 330-350		
RW3-MW2	1510	38.71	495 / 475-495		
RW3-MW3	1345	37.21	340 / 320-340		missing 1 bolt
RW3-MW4	11:50	39.15	495 / 475-495		missing 2 bolts
TP1	0822	32.81	470 / 450-470		
IW1-MW1	0842	34.58	470 / 450-470		Gauge only

Signature: Stacyhee

Date: 3/7/12

H&S Environmental, Inc.

Low Flow/ Low Stress Groundwater Sampling Log



Project: NWIRP Bethpage - GM-38
 Location: Bethpage, NY
 Well ID: RW | - MW |

Date: 3/ 8 /12
 Sampler: VAL / Stacey Lee
 PID: -----

Start Time: 1015 End Time: 1105

Field Testing Equipment

Well Construction: 4"
 Depth to Water: 34.35
 Well Depth: 435
 Water Column: 400.65
 Total Volume Removed (L): ~110L
 Dedicated Pump in Well?: No

Make	Model	Serial #
YSI	556	10H100928
LaMotte	2020e	ME15044
QED	MP15	
Marschalk Bladder Pump	24"	ID# 9983

Time (hh:mm)	Volume Removed (L)	Flow Rate (ml/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm°)	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
1020	1	200	35.10	14.91	4.91	199	1.25	232.3	7.50	clear
1025	1	200	35.27	15.08	4.87	197	0.76	248.9	20.39	cloudy
1030	1	200	35.27	15.12	4.76	194	0.68	259.7	158	orange floc
1040	2	200	34.45	15.22	4.54	192	0.59	275.5	122	"
1045	1	200	34.50	15.13	4.64	195	0.51	291.3	63	cloudy
1050	1	200	34.60	14.96	4.57	194	0.47	305.5	19.4	cloudy
1055	1	200	34.59	14.95	4.61	194	0.46	311.3	15.4	cloudy
1100	1	200	34.60	15.06	4.61	193	0.45	314.3	15.9	cloudy
1105	1	200	34.62	15.07	4.66	193	0.43	318.5	14.6	cloudy

Acceptance Criteria: <0.3ft 3% ±0.1 3% 10% ± 10mv 10%

2" Screen Volume = 0.163 gal/ft or 616 ml per foot

Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
1105	NWIRP-GM-38-GW-	40 mL CG	3	HCl	TCL VOCs (624)
↓	RW -MW - 03082012	500 mL PL	1	HNO ₃	Hg (245.1)
		250 mL PL	1	---	TSS (SM2540D)

Comments

replaced drop tubing

Stacey Lee
 Signature

3/8/12
 Date

H&S Environmental, Inc.

Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38
 Location: Bethpage, NY
 Well ID: RW 1 - MW 3

Date: 3/ 8 /12
 Sampler: VAL / Stacey Lee
 PID: -----



Start Time: 1245 End Time: 1330

Well Construction: 4"

Depth to Water: 29.45

Well Depth: 435

Water Column: 405.55

Total Volume Removed (L): 29L

Dedicated Pump in Well?: No

Field Testing Equipment

Make	Model	Serial #
YSI	556	10H100928
LaMotte	2020e	ME15044
QED	MP15	
Marschalk Bladder Pump	24"	ID# 9983

Time (hh:mm)	Volume Removed (L)	Flow Rate (ml/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm°)	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
1250	1	200	28.50	14.68	5.30	182	2.34	202.6	4.63	clear
1300	2	200	28.53	13.91	5.21	182	0.35	148.3	6.57	"
1305	1	200	28.57	14.02	5.17	181	0.29	143.0	6.70	"
1315	2	200	28.59	14.07	5.10	182	0.34	141.7	5.87	"
1320	1	200	28.59	14.09	5.16	181	0.24	138.7	5.21	"
1325	1	200	28.59	14.03	5.17	182	0.23	137.6	3.05	"
1330	1	200	28.59	13.99	5.14	182	0.22	138.8	2.81	"

Acceptance Criteria: <0.3ft 3% ±0.1 3% 10% ± 10mv 10%

2" Screen Volume = 0.163 gal/ft or 616 ml per foot

Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
1330	NWIRP-GM-38-GW-	40 mL CG	3	HCl	TCL VOCs (624)
↓	RW 1 - MW 3 - 03062012	500 mL PL	1	HNO ₃	Hg (245.1)
		250 mL PL	1	---	TSS (SM2540D)

Comments

Stacey Lee
 Signature

3/8/12
 Date

H&S Environmental, Inc.

Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38
 Location: Bethpage, NY
 Well ID: RW 2 - MW 1

Date: 3/7/12
 Sampler: VAL / Stacey Lee
 PID: _____



Start Time: 10:00 End Time: 1120

Well Construction: 4"
 Depth to Water: 37.45
 Well Depth: 510
 Water Column: 472.55
 Total Volume Removed (L): 4.8 L
 Dedicated Pump in Well?: No

Field Testing Equipment

Make	Model	Serial #
YSI	556	10H100928
LaMotte	2020e	ME15044
QED	MP15	
Marschalk Bladder Pump	24"	ID# 9180

Time (hh:mm)	Volume Removed (L)	Flow Rate (ml/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm°)	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
10:05	0.3	60	37.79	10.43	8.04	210	8.79	181.6	33.3	cloudy
10:15	0.6	60	37.65	10.63	7.85	118	7.50	171.9	27.7	"
10:25	0.6	60	37.45	11.38	7.41 7.77	106	5.11	145.1	25.7	"
10:35	0.6	60	37.22	12.29	7.74	98	3.98	134.7	20.0	"
10:45	0.6	60	37.17	11.11	7.80	94	3.99	127.5	19.3	"
10:55	0.6	60	37.23	11.88	7.77	93	3.53	126.0	11.9	clear
11:00	0.3	60	37.69	12.58	7.69	92	2.88	96.2	8.69	clear
11:05	0.3	60	37.84	12.72	7.61	92	2.72	89.3	8.17	"
11:10	0.3	60	38.05	12.62	7.75	92	2.53	84.0	8.05	"
11:15	0.3	60	38.05	12.46	7.79	91	2.48	78.0	7.75	"
11:20	0.3	60	38.05	12.43	7.75	91	2.49	79.2	5.23	

Acceptance Criteria: <0.3ft 3% ±0.1 3% 10% ± 10mv 10%

2" Screen Volume = 0.163 gal/ft or 616 ml per foot

Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
1120	NWIRP-GM-38-GW- 03072012	40 mL CG	3	HCl	TCL VOCs (624)
	RW 2 -MW 1 -	500 mL PL	1	HNO ₃	Hg (245.1)
		250 mL PL	1	---	TSS (SM2540D)

Comments

Stacey Lee
 Signature

3/7/12

Date

H&S Environmental, Inc.

Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38
 Location: Bethpage, NY
 Well ID: RW3 - MW 1

Date: 3/7/12
 Sampler: VAL / Stacey Lee
 PID: -----



Start Time: 1745 End Time: 1750

Field Testing Equipment

Well Construction: 4"
 Depth to Water: 36.26
 Well Depth: 350
 Water Column: 313.74
 Total Volume Removed (L): NIL
 Dedicated Pump in Well?: No

Make	Model	Serial #
YSI	556	10H100928
LaMotte	2020e	ME15044
QED	MP15	
Marschalk Bladder Pump	24"	ID# 9186

Time (hh:mm)	Volume Removed (L)	Flow Rate (ml/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm°)	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
1710	1.5	300	36.26	11.65	5.20	119	2.35	210.0	35.3	cloudy
1715	1.5	300	"	11.21	5.18	118	1.96	216.3	107	orange #15C
1720	1.5	300	"	10.90	5.19	117	1.78	216.0	189	"
1725	1.5	300	"	10.28	5.12	118	1.69	221.9	152	"
1730	1.5	300	"	10.67	5.11	117		219.2	136	"
									124	
1745	1.5	300	"	8.56	5.03	115	3.41	230.1	230	
1750	1.5	300	"	8.47	5.02	114	3.40	232.1	115	orange

Acceptance Criteria: <0.3ft 3% ±0.1 3% 10% ± 10mv 10%

2" Screen Volume = 0.163 gal/ft or 616 ml per foot

Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
1750	NWIRP-GM-38-GW-	40 mL CG	3	HCl	TCL VOCs (624)
	RW3 -MW 1 - 03072012	500 mL PL	1	HNO ₃	Hg (245.1)
		250 mL PL	1	---	TSS (SM2540D)

Comments

tubing dropped down well sampled from depth only

Stacey Lee
 Signature

3/7/12
 Date

H&S Environmental, Inc.

Low Flow/ Low Stress Groundwater Sampling Log



Project: NWIRP Bethpage - GM-38
 Location: Bethpage, NY
 Well ID: RW 3 - MW 2

Date: 3/ 8 /12
 Sampler: VL/SL
 PID: -----

Start Time: 1150 End Time: 1215

Field Testing Equipment

Well Construction: 4"
 Depth to Water: 38.50
 Well Depth: 495
 Water Column: 456.44
 Total Volume Removed (L): ~75 L
 Dedicated Pump in Well?: No

Make	Model	Serial #
YSI	556	10H100928
LaMotte	2020e	ME15044
QED	MP15	
Marschalk Bladder Pump	24"	ID# 9983

Time (hh:mm)	Volume Removed (L)	Flow Rate (ml/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm ^o)	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
1155	1.5	300	38.56	13.14	4.97	78	4.12	246.5	5.29	clear
1200	1.5	300	38.72	13.57	4.73	77	3.58	263.7	4.80	clear
1205	1.5	300	39.90	13.23	4.98	77	3.46	260.5	6.49	clear
1210	1.5	300	39.91	13.59	4.85	77	3.40	265.3	6.36	"
1215	1.5	300	39.91	13.57	4.92	77	3.39	265.9	5.01	"

Acceptance Criteria: <0.3ft 3% ±0.1 3% 10% ± 10mv 10%

2" Screen Volume = 0.163 gal/ft or 616 ml per foot

Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
1215	NWIRP-GM-38-GW-	40 mL CG	3	HCl	TCL VOCs (624)
	RW 3 -MW 2- 03082012	500 mL PL	1	HNO ₃	Hg (245.1)
		250 mL PL	1	---	TSS (SM2540D)

Comments

collected sample from drop tubing only

[Signature]
 Signature

3/8/12
 Date

H&S Environmental, Inc.

Low Flow/ Low Stress Groundwater Sampling Log



Project: NWIRP Bethpage - GM-38
 Location: Bethpage, NY
 Well ID: RW 3 - MW 3

Date: 3/7/12
 Sampler: VAL / Stacey Lee
 PID: _____

Start Time: 1345 End Time: 1445
 Well Construction: 4"
 Depth to Water: 37.21
 Well Depth: 340
 Water Column: 302.79
 Total Volume Removed (L): ~12L
 Dedicated Pump in Well?: No

Field Testing Equipment

Make	Model	Serial #
YSI	556	10H100928
LaMotte	2020e	ME15044
QED	MP15	
Marschalk Bladder Pump	24"	ID# 9180

Time (hh:mm)	Volume Removed (L)	Flow Rate (ml/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm ^o)	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
1350	1	200	37.23	15.24	5.35	129	1.12	149.2	3.67	clear
1405	3	200	37.25	15.45	5.69	130	0.81	109.2	4.16	clear
1410	1	200	37.25	15.32	5.69	130	0.69	105.9	3.23	"
1426	3	200	37.25	14.09	5.68	130	0.57	106.7	3.14	"
1430	1	200	37.25	13.91	5.75	130	0.56	105.5	2.21	"
1435	1	200	37.25	13.62	5.67	131	0.50	106.0	1.81	"
1440	1	200	37.25	13.61	5.65	131	0.56	105.4	1.21	"
1445	1	200	37.25	13.61	5.66	131	0.49	106.2	1.55	"

Acceptance Criteria: <0.3ft 3% ±0.1 3% 10% ± 10mv 10%

2" Screen Volume = 0.163 gal/ft or 616 ml per foot

Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
1445	NWIRP-GM-38-GW-	40 mL CG	3	HCl	TCL VOCs (624)
	RW 3 - MW 3 -	500 mL PL	1	HNO ₃	Hg (245.1)
		250 mL PL	1	---	TSS (SM2540D)
	NWIRP-GM-38-GW-RW3-MW3-03072012 MS				} same as above
	NWIRP-GM-38-GW-RW3-MW3-03072012 DUP				
	NWIRP-GM-38-GW-RW3-MW3-03072012 MSD				

Comments

Stacey Lee
 Signature

3/7/12
 Date

H&S Environmental, Inc.

Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38
 Location: Bethpage, NY
 Well ID: RW 3 - MW 4

Date: 3/7/12
 Sampler: VAL / Stacey Lee
 PID: -----



Start Time: 1225 End Time: 1315

Well Construction: 4"
 Depth to Water: 39.15
 Well Depth: 495
 Water Column: 455.85
 Total Volume Removed (L): ~10 L
 Dedicated Pump in Well?: No

Field Testing Equipment

Make	Model	Serial #
YSI	556	10H100928
LaMotte	2020e	ME15044
QED	MP15	
Marschalk Bladder Pump	24"	ID# 9180

Time (hh:mm)	Volume Removed (L)	Flow Rate (ml/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm ^o)	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
1230	1	200	39.26	14.38	4.61	155	1.09	236.8	5.62	clear
1240	2	200	39.26	14.35	4.47	146	0.76	258.4	4.00	"
1245	1	200	39.26	14.18	4.62	125	0.66	254.3	4.54	"
1255	2	200	39.29	14.06	4.66	113	0.47	261.4	4.06	"
1300	1	200	39.28	14.06	4.68	113	0.40	262.8	4.32	"
1305	1	200	39.28	14.02	4.68	114	0.35	264.6	3.86	"
1310	1	200	39.28	13.99	4.67	116	0.33	267.6	3.69	"
1315	1	200	39.28	13.99	4.67	116	0.33	265.2	3.21	clear

Acceptance Criteria: <0.3ft 3% ±0.1 3% 10% ± 10mv 10%

2" Screen Volume = 0.163 gal/ft or 616 ml per foot

Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
1315	NWIRP-GM-38-GW-	40 mL CG	3	HCl	TCL VOCs (624)
	RW 3 - MW 4 - 03072012	500 mL PL	1	HNO ₃	Hg (245.1)
		250 mL PL	1	---	TSS (SM2540D)

Comments

Stacey Lee
 Signature

3/7/12

Date

H&S Environmental, Inc.

Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38
 Location: Bethpage, NY
 Well ID: TP1

Date: 3/8/12
 Sampler: VAL / Stacey Lee
 PID: -----



Start Time: 08:30 End Time: 09:00

Field Testing Equipment

Well Construction: 4"
 Depth to Water: 33.89
 Well Depth: 470
 Water Column: 436.11
 Total Volume Removed (L): 3L
 Dedicated Pump in Well?: No

Make	Model	Serial #
YSI	556	10H100928
LaMotte	2020e	ME15044
QED	MP15	
Marschalk Bladder Pump	24"	ID# 9983

Time (hh:mm)	Volume Removed (L)	Flow Rate (ml/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm ^o)	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
08:35	0.5	100	33.89	12.55	5.29	178	1.72	229.8	6.84	clear
08:40		"	33.90	12.61	5.24	178	.94	234.0	6.73	"
08:45		"	33.91	12.58	5.21	177	.72	236.3	6.44	"
08:50		"	33.91	12.52	5.17	178	.72	236.0	5.38	"
08:55	↓	"	33.91	12.62	5.19	180	.78	240.1	5.21	"
09:00	0.5	"	33.91	12.63	5.22	185	.73	239.9	4.01	"

Acceptance Criteria: <0.3ft 3% ±0.1 3% 10% ± 10mv 10%

2" Screen Volume = 0.163 gal/ft or 616 ml per foot

Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
09:00	NWIRP-GM-38-GW-TP1-03082012	40 mL CG	3	HCl	TCL VOCs (624)
	((500 mL PL	1	HNO ₃	Hg (245.1)
	((250 mL PL	1	---	TSS (SM2540D)

Comments

[Signature]
 Signature

03/08/12
 Date



Instrument Calibration Log

Project/Site Name: NWIRP Bethpage – GM-38

Date: 3/7/12

Weather: 55°F - 60°F

Calibrated By: VAL / Stacey Lee

Instrument: YSI 556

Serial Number: 10H100928

Parameters	Morning Calibration Time: <u>0800</u>	Cal. Temperature °C	Afternoon Cal. Check Time: <u>1830</u>	Comments
Conductivity ($\mu\text{S}/\text{cm}^\circ$)	<u>1131 / 1000</u>	<u>1.93</u>	<u>880</u>	<u>1060 $\mu\text{S}/\text{cm}$</u>
pH (7)	<u>6.95 / 7.03</u>	<u>4.04</u>	<u>7.25</u>	
pH (4)	<u>3.83 / 4.00</u>	<u>2.28</u>	<u>3.94</u>	
pH (10)	<u>9.77 / 9.90</u>	<u>2.69</u>	<u>10.21</u>	
ORP (mv)	<u>240.4 / 240.0</u>	<u>5.69</u>	<u>226.6</u>	<u>240</u> 200 mv
Dissolved Oxygen (%)	<u>92.81 / 102.2</u>	<u>3.86</u>	<u>110.5</u>	
Zero Dissolved Oxygen (mg/L)	<u>—</u>	<u>—</u>	<u>—</u>	
Barometric Pressure (mmHg)	<u>777.8</u>	<u>—</u>	<u>—</u>	

pH Check (Every 3 hrs): Time:
Standard:
Reading:

Time:
Standard:
Reading:

Time:
Standard:
Reading:

Signature: Stacey Lee

Date: 3/7/12



Instrument Calibration Log

Project/Site Name: NWIRP Bethpage – GM-38

Date: 3/8/12

Weather: 50 F

Calibrated By: SL

Instrument: YSI 556

Serial Number: 10H100928

Parameters	Morning Calibration Time: <u>0745</u>	Cal. Temperature °C	Afternoon Cal. Check Time: <u>1600</u>	Comments
Conductivity ($\mu\text{S}/\text{cm}^\circ$)	<u>881 / 1000</u>	<u>10.93</u>	<u>987</u>	
pH (7)	<u>7.26 / 7.00</u>	<u>10.66</u>	<u>7.06</u>	
pH (4)	<u>3.94 / 3.94</u>	<u>9.95</u>	<u>4.02</u>	
pH (10)	<u>10.21 / 10.03</u>	<u>10.13</u>	<u>9.92</u>	
ORP (240) (mv)	<u>226.0 / 240.0</u>	<u>10.35</u>	<u>242.7</u>	
Dissolved Oxygen (%)	<u>110.5 / 101.0</u>	<u>11.22</u>	<u>98.9</u>	
Zero Dissolved Oxygen (mg/L)				
Barometric Pressure (mmHg)	<u>767.3</u>		<u>765.2</u>	

pH Check (Every 3 hrs): Time:
Standard:
Reading:

Time:
Standard:
Reading:

Time:
Standard:
Reading:

Signature: *gumeyfree*

Date: 3/8/12



Instrument Calibration Log

Project/Site Name: NWIRP Bethpage GM-38

Calibrated By: VL/SL

Instrument/Serial Number	Pre-Cal 1-AM (NTU)	Pre-Cal 1-PM (NTU)	Pre-Cal 10-AM (NTU)	Pre-Cal 10-PM (NTU)	Post-Cal 1-AM (NTU)	Post-Cal 1-PM (NTU)	Post-Cal 10-AM (NTU)	Post-Cal 10-PM (NTU)	Date
LaMotte 2020e / ME15044	1.39	2.91	7.31	8.72	1.00	1.00	10.00	10.00	Time: 0800 & 1730
"	2.74	1.51	9.13	10.20	1.00	1.00	10.00	10.00	Time: 0800 & 1400
									Time: &
									Time: &
									Time: &
									Time: &
									Time: &
									Time: &
									Time: &
									Time: &
									Time: &

Signature: Jacynhee

Date: 3/8/12



Analytical Laboratory Services, Inc.

Environmental • Industrial Hygiene • Field Services

34 Dogwood Lane • Middletown, PA 17057 • 717.944.5541 • Fax 717.944.1430

**CHAIN OF CUSTODY/
REQUEST FOR ANALYSIS**

**ALL SHADED AREAS MUST BE COMPLETED BY THE
CLIENT / SAMPLER. INSTRUCTIONS ON THE BACK.**

Page 1 of 2

Courier: _____

Tracking #: _____

Co. Name: H&S Environmental, Inc.
Contact (Report to): Jen Good **Phone:** 508.366.7442
Address: 160 E. Main St., Suite 2F
 Westborough, MA 01581

Bill to (if different than Report to): Same **PO#:** 2031-005

Project Name#: NWIRP Bethpage GM-38 Qtrly LTM **ALSI Quote #:**

TAT: Normal-Standard TAT is 10-12 business days. **Date Required:**
 Rush-Subject to ALSI approval and surcharges. **Approved By:**

Email? -Y jgood@hsenv.com
Fax? -Y No.:

Sample Description/Location <small>(as it will appear on the lab report)</small>	COC Comments	Sample Date	Military Time	*G or C	**Matrix	Enter Number of Containers Per Analysis														
1 NWIRP-GM-38-GW-RW1-MW1- MS/MSD for VOCs, Hg		3/8/12	1105	G	GW	2	2	1												
2 NWIRP-GM-38-GW-RW1-MW3- 03082012		3/8/12	1330	G	GW	3	1	1												
3 NWIRP-GM-38-GW-RW2-MW1- 03072012		3/7/12	1120	G	GW	3	1	1												
4 NWIRP-GM-38-GW-RW3-MW1- 03072012		3/7/12	1750	G	GW	3	1	1												
5 NWIRP-GM-38-GW-RW3-MW2- 03082012		3/8/12	1215	G	GW	3	1	1												
6 NWIRP-GM-38-GW-RW3-MW3- 03072012 <i>MS/MSD for VOCs, Hg</i>		3/7/12	1445	G	GW	3	3	1												
7 NWIRP-GM-38-GW-RW3-MW4- 03072012		3/7/12	1315	G	GW	3	1	1												
8 NWIRP-GM-38-GW-TP1- 03082012		3/8/12	0910	G	GW	3	1	1												

**Container Type	40 mL	500 mL	250 mL																	
***Container Size	CG	PL	PL																	
Preservative	HCL	HNO3	---																	

ANALYSES/METHOD REQUESTED

TCL VOCs (Method 624)	Mercury (Method 245.1)	TSS (SM2540D)																		
-----------------------	------------------------	---------------	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

Receipt information (completed by Sample)
Performed by: _____ **INITIAL HERE**
Cooler Temp: _____
Therm. ID: _____
No. of Coolers: _____
Notes:

Correct containers?	Correct sample volume?	Correct preservation?	Headspace/Volatiles?	Circle appropriate Y or N.
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	

SAMPLED BY (Please Print):
 Stacey Lee

LOGGED BY (signature): _____ **DATE:** _____ **TIME:** _____
REVIEWED BY (signature): _____ **DATE:** _____ **TIME:** _____

Relinquished By / Company Name	Date	Time	Received By / Company Name	Date	Time
1 Stacey Lee H&S	3/8/12	1500	2		
3			4		
5			6		
7			8		
9			10		

Data Deliverables
 Standard
 CLP-like
 NJ-Reduced
 NJ-Full
 (other) _____
 EDOs Required? If yes, format type: _____
 SOWA Forms? yes no
State Samples Collected In?
 MD
 NJ
 NY
 PA
 Other _____
 PWSID _____
 OOD Criteria Required?

ALSI FIELD SERVICES

Pickup
 Labor
 Composite Sampling
 Rental Equipment
 Other _____

* G=Grab; C=Composite **Matrix: AI=Air; DW=Drinking Water; GW=Groundwater; OI=Oil; OL=Other Liquid; SL=Sludge; SO=Soil; WP=Wipe; WW=Wastewater
 ***Container Type: AG-Amber Glass; CG-Clear Glass; PL-Plastic. Container Size: 250ml, 500ml, 1L, 8oz., etc. Preservative: HCL, HNO3, NaOH, etc.

p.1

5169422393

ECOR SOLUTIONS, Inc

Mar 08 12 03:29p



**CHAIN OF CUSTODY/
REQUEST FOR ANALYSIS**

Courier: _____

Tracking #: _____

ALL SHADED AREAS MUST BE COMPLETED BY THE CLIENT / SAMPLER. INSTRUCTIONS ON THE BACK.

Co. Name: H&S Environmental, Inc.
Contact (Report to): Jen Good **Phone:** 508.366.7442
Address: 160 E. Main St., Suite 2F
Westborough, MA 01581

Bill to (if different than Report to): _____ **PO#:** 2031-005
Same

Project Name#: NWIRP Bethpage GM-38 Qtrly LTM **ALSI Quote #:** _____

TAT: Normal-Standard TAT is 10-12 business days. **Date Required:** _____
 Rush-Subject to ALSI approval and surcharges. **Approved By:** _____

Email? -Y jgood@hsenv.com
Fax? -Y No.:

Sample Description/Location <small>(as it will appear on the lab report)</small>	COC Comments	Sample Date	Military Time	*G or C	**Matrix	Enter Number of Containers Per Analysis														
1 NWIRP-GM-38-GW-RW7-MWA 03072012 <small>DUP</small>		3/7/12	1445	G	GW	3	1	1												
2 NWIRP-GM-38-FB- 03072012		3/7/12	1050	G	GW	3	1													
3 NWIRP-GM-38-TB- 03072012				G	GW	3														
4				G	GW															
5				G	GW															
6				G	GW															
7				G	GW															
8				G	GW															

SAMPLED BY (Please Print): _____ **LOGGED BY (signature):** _____ **DATE:** _____ **TIME:** _____
REVIEWED BY (signature): _____ **DATE:** _____ **TIME:** _____

Relinquished By / Company Name	Date	Time	Received By / Company Name	Date	Time
1			2		
3			4		
5			6		
7			8		
9			10		

Data Deliverables

Standard
 CLP-like
 NJ-Reduced
 NJ-Full
 (Other) _____

SDWA Forms?
yes MD
yes NJ
yes NY
yes PA

State Samples Collected in?

EDDs Required? If yes, format type: _____ Other _____

PWSID _____

BOD Criteria Required?

Receipt Information (Completed by Sampler)

Performed by: _____ **INITIAL HERE**

Cooler Temp: _____
Therm. ID: _____
No. of Coolers: _____

Notes:

	N	K	N	N
Correct containers?	Y	Y	Y	Y
Correct sample volume?	Y	Y	Y	Y
Correct preservation?	Y	Y	Y	Y
Headspace/Volatiles?	Y	Y	Y	Y

Circle appropriate Y or N.

	N	K	N	N
Custody seals Present? (if present)	Y	Y	Y	Y
Seals intact?	Y	Y	Y	Y
Received on ice?	Y	Y	Y	Y
COC/Labels complete/accurate?	Y	Y	Y	Y
Container in good condition?	Y	Y	Y	Y

ALSI FIELD SERVICES

Pickup
 Labor
 Composite Sampling
 Rental Equipment
 Other: _____

* G=Grab; C=Composite **Matrix: AI=Air; DW=Drinking Water; GW=Groundwater; OL=Oil; OL=Other Liquid; SL=Sludge; SO=Soil; WP=Wipe; WW=Wastewater
***Container Type: AG-Amber Glass; CG-Clear Glass, PL-Plastic. Container Size: 250ml, 500ml, 1L, 8oz., etc. Preservative: HCl, HNO3, NaOH, etc.

p.2
5169422393
ECOR SOLUTIONS, Inc
Mar 08 12 03:29p

APPENDIX D
Data Validation Reports

VOLATILE ORGANIC COMPOUNDS
USEPA Region II –Data Validation

Project Name: Naval Weapons Industrial Reserve Plant, GM-38 Area-LTM

Location: 100 Broadway, Bethpage, NY

Project Number: 2031-005

SDG #: 9956129-HNW-041

Client: H&S Environmental, Inc.

Date: 04/24/2012

Laboratory: ALS Environmental, Middletown, PA

Reviewer: Samir A. Naguib

Summary:

1. Data validation was performed on the data for nine (9) water samples, one (1) trip blank and one (1) field blank analyzed for Volatiles by EPA Method 624.
2. The samples were collected on 03/07, 08 and 09/2012. The samples were submitted to ALS Environmental, Middletown, PA on 03/09/2012 for analysis.
3. The USEPA Region II SOP HW-24, Revision No.: 2, August 2008, Validating Volatile Organic Compounds by Gas Chromatography/Mass Spectrometry, SW-846 Method 8260B; USEPA National Functional Guidelines for Organic Data Review, EPA 540/R-99/008, October 1999; EPA Method 624 and Quality Assurance Project Plan for GM-38 Area, Naval Weapons Industrial Reserve Plant, Bethpage, NY; September 3, 2009 were used in evaluating the Volatiles data in this summary report.
4. In general, the data are valid as reported and may be used for decision making purposes. Selected data points were qualified due to nonconformance of certain Quality Control criteria (See discussion below).

Samples:

The samples included in this review are listed below:

Client Sample ID	Laboratory Sample ID	Collection Date	Matrix	Sample Status
NWIRP-GM-38-GW-RW1-MW1	9956129001	03/08/12	Water	
NWIRP-GM-38-GW-RW1-MW3-03082012	9956129002	03/08/12	Water	
NWIRP-GM-38-GW-RW2-MW1-03072012	9956129003	03/07/12	Water	
NWIRP-GM-38-GW-RW3-MW1-03072012	9956129004	03/07/12	Water	
NWIRP-GM-38-GW-RW3-MW2-03082012	9956129005	03/08/12	Water	
NWIRP-GM-38-GW-RW3-MW3-03072012	9956129006	03/07/12	Water	
NWIRP-GM-38-GW-RW3-MW4-03072012	9956129007	03/07/12	Water	
NWIRP-GM-38-GW-TP1-03082012	9956129008	03/08/12	Water	
NWIRP-GM-38-GW-RW3-MW3-03072012DUP	9956129009	03/07/12	Water	Field Duplicate of sample NWIRP-GM-38-GW-RW3-MW3-03072012
NWIRP-GM-38-FB-03072012	9956129010	03/07/12	Water	Field Blank
NWIRP-GM-38-TB-03072012	9956129011	03/09/12	Water	Trip Blank

Sample Conditions/Problems:

1. The Traffic Reports/Chain-of-Custody Records, Sampling Report and/or Laboratory Case Narrative did not indicate any problems with sample receipt, condition of samples, analytical problems or special circumstances affecting the quality of the data. No qualifications were required.

Holding Times:

1. All water samples were analyzed within 14days from sample collection. No qualifications were required.
2. All water samples were properly preserved (pH<2.0). No qualifications were required.

GC/MS Tuning:

1. All of the BFB tunes in the initial and continuing calibrations met the percent relative abundance criteria. No qualifications were required.

Initial Calibration:

1. Initial calibration curve analyzed on 03/12/2012 (ms03.i) exhibited acceptable %RSD and average RRF values for all compounds. No qualifications were required.

Continuing Calibration Verification (CCV):

1. CCV analyzed on 03/13/2012 @ 07:05 AM (ms03.i) exhibited acceptable %Ds ($\leq 15.0\%$) for all compounds with the following exception(s):

Compound	%D
Bromomethane	-19.5
Chloromethane	-18.4
Vinyl Chloride	-36.1

Client Sample ID	Laboratory Sample ID	Compound	Action
NWIRP-GM-38-GW-RW1-MW1	9956129001	Bromomethane, Chloromethane, Vinyl Chloride	UJ
NWIRP-GM-38-GW-RW1-MW3-03082012	9956129002	Bromomethane, Chloromethane, Vinyl Chloride	UJ
NWIRP-GM-38-GW-RW2-MW1-03072012	9956129003	Bromomethane, Chloromethane, Vinyl Chloride	UJ
NWIRP-GM-38-GW-RW3-MW1-03072012	9956129004	Bromomethane, Chloromethane, Vinyl Chloride	UJ
NWIRP-GM-38-GW-RW3-MW2-03082012	9956129005	Bromomethane, Chloromethane, Vinyl Chloride	UJ
NWIRP-GM-38-GW-RW3-MW3-03072012	9956129006	Bromomethane, Chloromethane, Vinyl Chloride	UJ
NWIRP-GM-38-GW-RW3-MW4-03072012	9956129007	Bromomethane, Chloromethane, Vinyl Chloride	UJ
NWIRP-GM-38-GW-TP1-03082012	9956129008	Bromomethane, Chloromethane, Vinyl Chloride	UJ
NWIRP-GM-38-GW-RW3-MW3-03072012DUP	9956129009	Bromomethane, Chloromethane, Vinyl Chloride	UJ
NWIRP-GM-38-FB-03072012	9956129010	Bromomethane, Chloromethane, Vinyl Chloride	UJ
NWIRP-GM-38-TB-03072012	9956129011	Bromomethane, Chloromethane, Vinyl Chloride	UJ

2. CCV analyzed on 03/14/2012 @ 08:57 AM (ms03.i) exhibited acceptable %D ($\leq 15.0\%$) for Trichloroethene. No qualifications were required.

Surrogates:

1. All surrogates %REC values for all water samples and associated QC were within the laboratory control limits. No qualifications were required.



Internal Standard (IS) Area Performance:

1. All samples exhibited acceptable area count for all three internal standards. No qualifications were required.

Method Blank (MB), Storage Blank (SB), Trip Blank (TB), Field Blank (FB), Rinsate Blank (RB) and Equipment Blank (EB):

1. Method Blank (958673) analyzed on 03/13/2012 was free of contamination. No qualifications were required.
2. Method Blank (959143) analyzed on 03/14/2012 was free of contamination. No qualifications were required.
3. Field Blank (NWIRP-GM38-FB-03072012) (9956129010) analyzed on 03/13/2012 was free of contamination. No qualifications were required.
4. Trip Blank (NWIRP-GM38-TB-03072012) (9956129011) analyzed on 03/13/2012 was free of contamination. No qualifications were required.

Laboratory Control Sample (LCS)/ Laboratory Control Sample Duplicate (LCSD):

1. Laboratory Control Sample (958674) was analyzed on 03/13/2012. All %RECs were within the laboratory control limits. No qualifications were required.
2. Laboratory Control Sample (959144) was analyzed on 03/14/2012. All %RECs were within the laboratory control limits. No qualifications were required.

Field Duplicate:

1. Sample NWIRP-GM-38-GW-RW3-MW3-03072012DUP (9956129009) was collected as field duplicate for sample NWIRP-GM-38-GW-RW3-MW3-03072012 (9956129006). All RPDs were ≤50.0%. No qualifications were required.

Field Sample	Compound	Analytical Method	Result	Units	Field Duplicate	Result	Units	RPD	Qualifier
MWIRP-GM-38-GW-RW3-MW3-03072012	1,1-Dichloroethane	EPA 624	3.3	µg/l	MWIRP-GM-38-RW3-MW3-03070212DUP	3.3	µg/l	0.0	None
MWIRP-GM-38-GW-RW3-MW3-03072012	1,1-Dichloroethene	EPA 624	1.9	µg/l	MWIRP-GM-38-RW3-MW3-03070212DUP	1.9	µg/l	0.0	None
MWIRP-GM-38-GW-RW3-MW3-03072012	cis-1,2-Dichloroethene	EPA 624	2.1	µg/l	MWIRP-GM-38-RW3-MW3-03070212DUP	2.1	µg/l	0.0	None
MWIRP-GM-38-GW-RW3-MW3-03072012	Trichloroethene	EPA 624	312	µg/l	MWIRP-GM-38-RW3-MW3-03070212DUP	325	µg/l	4.1	None

Matrix Spike (MS)/ Matrix Spike Duplicate (MSD):

1. Matrix Spike (MS) and Matrix Spike Duplicate (MSD) were performed on sample NWIRP-GM-38-GW-RW3-MW3-03072012 (9956129006). All %RECs and RPDs were within the laboratory control limits with the following exception(s):

Compound	%REC/%REC/RPD	Action
2-Chloroethylvinyl ether	0/0/NA	R ⁽¹⁾

NA= Not Applicable

⁽¹⁾= R qualifier was used due to both MS and MSD were not recovered.

Compound Quantitation and Reported Contract Required Quantitation Limits (CRQLs):

1. All results were within the linear calibration range. No qualifications were required.

Target Compound Identification:

1. All Relative Retention Times (RRTs) of the reported compounds were within ± 0.06 RRT units of the standard (opening CCV).
2. Sample compound spectra were compared against the laboratory standard spectra.
3. No QC deviations were observed.

Comments:

1. Validation qualifiers (if required) were entered into the EDD for SDG: 9956129-HNW-041.

MERCURY
USEPA Region II – Data Validation

Project Name: Naval Weapons Industrial Reserve Plant, GM-38 Area-LTM

Location: 100 Broadway, Bethpage, NY

Project Number: 2031-005

SDG #: 9956129-HNW-041

Client: H&S Environmental, Inc.

Date: 04/25/2012

Laboratory: ALS Environmental, Middletown, PA

Reviewer: Samir A. Naguib

Summary:

1. Data validation was performed on the data for nine (9) water samples and one (1) field blank analyzed for Mercury by EPA Method 245.1.
2. The samples were collected on 03/07 and 08/2012. The samples were submitted to ALS Environmental, Middletown, PA on 03/09/2012 for analysis.
3. The USEPA Region II SOP No. HW-2, Revision 13, September 2006, Validation of Metals for Contract Laboratory Program (CLP), SOW-ILM05.3 (SOP Revision 13); USEPA National Functional Guidelines for Inorganic Data Review, EPA 540-R-04-004, October 2004 and Quality Assurance Project Plan for GM-38 Area, Naval Weapons Industrial Reserve Plant, Bethpage, NY; September 3, 2009 were used in evaluating the Mercury data in this summary report.
4. In general, the data are valid as reported and may be used for decision making purposes. Selected data points were qualified due to nonconformance of certain Quality Control criteria (See discussion below).

Samples:

The samples included in this review are listed below:

Client Sample ID	Laboratory Sample ID	Collection Date	Matrix	Sample Status
NWIRP-GM-38-GW-RW1-MW1	9956129001	03/08/12	Water	
NWIRP-GM-38-GW-RW1-MW3-03082012	9956129002	03/08/12	Water	
NWIRP-GM-38-GW-RW2-MW1-03072012	9956129003	03/07/12	Water	
NWIRP-GM-38-GW-RW3-MW1-03072012	9956129004	03/07/12	Water	
NWIRP-GM-38-GW-RW3-MW2-03082012	9956129005	03/08/12	Water	
NWIRP-GM-38-GW-RW3-MW3-03072012	9956129006	03/07/12	Water	
NWIRP-GM-38-GW-RW3-MW4-03072012	9956129007	03/07/12	Water	
NWIRP-GM-38-GW-TP1-03082012	9956129008	03/08/12	Water	
NWIRP-GM-38-GW-RW3-MW3-03072012DUP	9956129009	03/07/12	Water	Field Duplicate of sample NWIRP-GM-38-GW-RW3-MW3-03072012
NWIRP-GM-38-FB-03072012	9956129010	03/07/12	Water	Field Blank

Sample Conditions/Problems:

1. The Traffic Reports/Chain-of-Custody Records, Sampling Report and/or Laboratory Case Narrative did not indicate any problems with sample receipt, condition of samples, analytical problems or special circumstances affecting the quality of the data. No qualifications were required.

Holding Times:

1. All water samples were digested and analyzed within the 28days holding times for Mercury. No qualifications were required.

Initial and Continuing Calibration Verification (ICV and CCV):

1. The correlation coefficient for Mercury calibration curve analyzed was ≥ 0.995 . No qualifications were required.
2. All ICVs and CCVs %REC values were within the QC limits (80-120%). No qualifications were required.

Blanks (Method Blank, ICB and CCB):

1. All ICBs and CCBs were free of contamination. No qualifications were required.
2. Method Blank (959753) digested on 03/15/2012 was free of contamination. No qualifications were required.

Field Blank (FB) and Equipment Blank (EB):

1. Field Blank (NWIRP-GM-38-FB-03072012) (9956129010) analyzed on 03/15/2012 was free of contamination. No qualifications were required.

Laboratory Control Sample (LCS)/ Laboratory Control Sample Duplicate (LCSD):

1. Mercury %REC in Laboratory Control Sample (959754) analyzed on 03/15/2012 was within the laboratory control limits. No qualifications were required.

Field Duplicate:

1. Sample NWIRP-GM-38-GW-RW3-MW3-03072012DUP (9956129009) was collected as field duplicate for sample NWIRP-GM-38-GW-RW3-MW3-03072012 (9956129006). Both samples were reported as non-detects. No qualifications were required.

Matrix Spike (MS)/ Matrix Spike Duplicate (MSD):

1. Matrix Spike (MS) and Matrix Spike Duplicate (MSD) were performed on sample NWIRP-GM-38-GW-RW3-MW3-03072012 (9956129006). All %RECs and RPD were within the laboratory control limits. No qualifications were required.

Compound Quantitation and Reported Detection Limits:

1. All sample results were reported within the linear calibration range.

Comments:

1. Validation qualifiers (if required) were entered into the EDD for SDG: 9956129-HNW-041.

GENERAL CHEMISTRY
USEPA Region II – Data Validation

Project Name: Naval Weapons Industrial Reserve Plant, GM-38 Area-LTM
Location: 100 Broadway, Bethpage, NY
Project Number: 2031-005
SDG #: 9956129-HNW-041
Client: H&S Environmental, Inc.
Date: 04/25/2012
Laboratory: ALS Environmental, Middletown, PA
Reviewer: Samir A. Naguib

Summary:

1. Data validation was performed on the data for nine (9) water samples analyzed for Solids, Total Suspended (TSS) by SM20th 2540D.
2. The samples were collected on 03/07 and 08/2012. The samples were submitted to ALS Environmental, Middletown, PA on 03/09/2012 for analysis.
3. The USEPA Region II SOP No. HW-2, Revision 13, September 2006, Validation of Metals for Contract Laboratory Program (CLP), SOW-ILM05.3 (SOP Revision 13); USEPA National Functional Guidelines for Inorganic Data Review, EPA 540-R-04-004, October 2004 and Quality Assurance Project Plan for GM-38 Area, Naval Weapons Industrial Reserve Plant, Bethpage, NY; September 3, 2009 were used in evaluating the Solids, Total Suspended data in this summary report.
4. In general, the data are valid as reported and may be used for decision making purposes. Selected data points were qualified due to nonconformance of certain Quality Control criteria (See discussion below).

Samples:

The samples included in this review are listed below:

Client Sample ID	Laboratory Sample ID	Collection Date	Matrix	Sample Status
NWIRP-GM-38-GW-RW1-MW1	9956129001	03/08/12	Water	
NWIRP-GM-38-GW-RW1-MW3-03082012	9956129002	03/08/12	Water	
NWIRP-GM-38-GW-RW2-MW1-03072012	9956129003	03/07/12	Water	
NWIRP-GM-38-GW-RW3-MW1-03072012	9956129004	03/07/12	Water	
NWIRP-GM-38-GW-RW3-MW2-03082012	9956129005	03/08/12	Water	
NWIRP-GM-38-GW-RW3-MW3-03072012	9956129006	03/07/12	Water	
NWIRP-GM-38-GW-RW3-MW4-03072012	9956129007	03/07/12	Water	
NWIRP-GM-38-GW-TP1-03082012	9956129008	03/08/12	Water	
NWIRP-GM-38-GW-RW3-MW3-03072012DUP	9956129009	03/07/12	Water	Field Duplicate of sample NWIRP-GM-38-GW-RW3-MW3-03072012

Sample Conditions/Problems:

1. The Traffic Reports/Chain-of-Custody Records, Sampling Report and/or Laboratory Case Narrative did not indicate any problems with sample receipt, condition of samples, analytical problems or special circumstances affecting the quality of the data. No qualifications were required.

Holding Times:

1. All water samples were analyzed within the 7days holding times for Solids, Total Suspended. No qualifications were required.

Method Blank (MB), Storage Blank (SB), Field Blank (FB), Rinsate Blank (RB) and Equipment Blank (EB):

1. Method Blank (958186) analyzed on 03/12/2012 was free of contamination. No qualifications were required.
2. Method Blank (959110) analyzed on 03/14/2012 was free of contamination. No qualifications were required.

Field Duplicate:

1. Sample NWIRP-GM-38-GW-RW3-MW3-03072012DUP (9956129009) was collected as field duplicate for sample NWIRP-GM-38-GW-RW3-MW3-03072012 (9956129006). Both samples were reported as non-detects. No qualifications were required.

Laboratory Duplicate:

1. Laboratory Duplicate source sample was associated with a different SDG.

Compound Quantitation and Reported Detection Limits:

1. All sample results were reported within the linear calibration range.

Comments:

1. Validation qualifiers (if required) were entered into the EDD for SDG: 9956129-HNW-041.

APPENDIX E
Raw Analytical Data

January 2012 O&M Data

January 31, 2012

Ms. Jennifer Good
H & S Environmental
160 East Main Street, 2F
Westborough, MA 01581

Certificate of Analysis

Project Name:	NWIRP Bethpage - GM-38	Workorder:	9947838
Purchase Order:	2031-003	Workorder ID:	HNW038 NWIRP Bethpage - GM-38

Dear Ms. Good,

Enclosed are the analytical results for samples received by the laboratory on Thursday, January 19, 2012.

The ALS Environmental laboratory in Middletown, Pennsylvania is a National Environmental Laboratory Accreditation Program (NELAP) accredited laboratory and as such, certifies that all applicable test results meet the requirements of NELAP.

If you have any questions regarding this certificate of analysis, please contact Tonya Hironimus (Project Coordinator) or Anna G Milliken (Technical Manager) at (717) 944-5541.

Please visit us at www.analyticalab.com for a listing of ALS' NELAP accreditations and Scope of Work, as well as other links to Water Quality documentation on the internet.

This laboratory report may not be reproduced, except in full, without the written approval of ALS Environmental.

This page is included as part of the Analytical Report and must be retained as a permanent record thereof.


Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

SAMPLE SUMMARY

Workorder: 9947838 HNW038|NWIRP Bethpage - GM-38

Discard Date: 03/31/2012

Lab ID	Sample ID	Matrix	Date Collected	Date Received	Collected By
9947838001	NWIRP-GM-38-PS-RW1-011812	Water	1/18/12 10:00	1/19/12 08:50	Customer
9947838002	NWIRP-GM-38-PS-RW3-011812	Water	1/18/12 10:15	1/19/12 08:50	Customer
9947838003	NWIRP-GM-38-PS-ASE-011812	Water	1/18/12 10:25	1/19/12 08:50	Customer
9947838004	NWIRP-GM-38-PS-BFE-011812	Water	1/18/12 10:35	1/19/12 08:50	Customer
9947838005	NWIRP-GM-38-PS-TE-011812	Water	1/18/12 10:50	1/19/12 08:50	Customer
9947838006	NWIRP-GM-38-PS-LC1-011812	Water	1/18/12 11:00	1/19/12 08:50	Customer
9947838007	NWIRP-GM-38-PS-LC2-011812	Water	1/18/12 11:10	1/19/12 08:50	Customer
9947838008	NWIRP-GM-38-PS-LC3-011812	Water	1/18/12 11:20	1/19/12 08:50	Customer
9947838009	NWIRP-GM-38-PS-TE-DUP-011812	Water	1/18/12 11:30	1/19/12 08:50	Customer
9947838010	NWIRP-GM-38-TB-011812	Water	1/18/12 11:45	1/19/12 08:50	Customer

Workorder Comments:

This report was modified to provide the appropriate VOC compounds for the O&M project. TMH 1/26/12

Notes

- Samples collected by ALS personnel are done so in accordance with the procedures set forth in the ALS Field Sampling Plan (20 - Field Services Sampling Plan).
- All Waste Water analyses comply with methodology requirements of 40 CFR Part 136.
- All Drinking Water analyses comply with methodology requirements of 40 CFR Part 141.
- Unless otherwise noted, all quantitative results for soils are reported on a dry weight basis.
- The Chain of Custody document is included as part of this report.
- All Library Search analytes should be regarded as tentative identifications based on the presumptive evidence of the mass spectra. Concentrations reported are estimated values.

Standard Acronyms/Flags

J, B	Indicates an estimated value between the Method Detection Limit (MDL) and the Practical Quantitation Limit (PQL) for the analyte
U	Indicates that the analyte was Not Detected (ND)
N	Indicates presumptive evidence of the presence of a compound
MDL	Method Detection Limit
PQL	Practical Quantitation Limit
RDL	Reporting Detection Limit
ND	Not Detected - indicates that the analyte was Not Detected at the RDL
Cntr	Analysis was performed using this container
RegLmt	Regulatory Limit
LCS	Laboratory Control Sample
MS	Matrix Spike
MSD	Matrix Spike Duplicate
DUP	Sample Duplicate
%Rec	Percent Recovery
RPD	Relative Percent Difference

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9947838 HNW038|NWIRP Bethpage - GM-38

Lab ID: 9947838001 **Date Collected:** 1/18/2012 10:00 **Matrix:** Water
Sample ID: NWIRP-GM-38-PS-RW1-011812 **Date Received:** 1/19/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	5.0U	ug/L		5.0	5.0	1.2	EPA 624		1/23/12 18:25	MES	A
1,1-Dichloroethane	2.7J	ug/L		5.0	5.0	0.95	EPA 624		1/23/12 18:25	MES	A
1,2-Dichloroethane	5.0U	ug/L		5.0	5.0	1.1	EPA 624		1/23/12 18:25	MES	A
1,1-Dichloroethene	6.4	ug/L		5.0	5.0	0.85	EPA 624		1/23/12 18:25	MES	A
cis-1,2-Dichloroethene	43.4	ug/L		5.0	5.0	1.3	EPA 624		1/23/12 18:25	MES	A
trans-1,2-Dichloroethene	5.0U	ug/L		5.0	5.0	0.60	EPA 624		1/23/12 18:25	MES	A
Tetrachloroethene	92.7	ug/L		5.0	5.0	1.3	EPA 624		1/23/12 18:25	MES	A
1,1,1-Trichloroethane	6.7	ug/L		5.0	5.0	1.4	EPA 624		1/23/12 18:25	MES	A
Trichloroethene	364	ug/L		5.0	5.0	1.1	EPA 624		1/23/12 18:25	MES	A
Vinyl Chloride	3.4J	ug/L		10.0	10.0	1.2	EPA 624		1/23/12 18:25	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	112	%		72-142			EPA 624		1/23/12 18:25	MES	A
4-Bromofluorobenzene (S)	98.2	%		73-119			EPA 624		1/23/12 18:25	MES	A
Dibromofluoromethane (S)	111	%		74-132			EPA 624		1/23/12 18:25	MES	A
Toluene-d8 (S)	126	%		75-133			EPA 624		1/23/12 18:25	MES	A
WET CHEMISTRY											
Total Suspended Solids	5	mg/L		5	5	5	SM20-2540 D		1/20/12 15:10	KAK	M
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	1/23/12	1/23/12 11:42	MNP	J1

Sample Comments:

The GCMS volatiles analysis was performed at a dilution due to the level of target compounds.



Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife **United States:** Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York **Mexico:** Monterrey

ANALYTICAL RESULTS

Workorder: 9947838 HNW038|NWIRP Bethpage - GM-38

Lab ID: **9947838002** Date Collected: 1/18/2012 10:15 Matrix: Water
Sample ID: **NWIRP-GM-38-PS-RW3-011812** Date Received: 1/19/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	5.0U	ug/L		5.0	5.0	1.2	EPA 624		1/23/12 18:59	MES	A
1,1-Dichloroethane	2.6J	ug/L		5.0	5.0	0.95	EPA 624		1/23/12 18:59	MES	A
1,2-Dichloroethane	5.0U	ug/L		5.0	5.0	1.1	EPA 624		1/23/12 18:59	MES	A
1,1-Dichloroethene	1.5J	ug/L		5.0	5.0	0.85	EPA 624		1/23/12 18:59	MES	A
cis-1,2-Dichloroethene	1.5J	ug/L		5.0	5.0	1.3	EPA 624		1/23/12 18:59	MES	A
trans-1,2-Dichloroethene	5.0U	ug/L		5.0	5.0	0.60	EPA 624		1/23/12 18:59	MES	A
Tetrachloroethene	5.0U	ug/L		5.0	5.0	1.3	EPA 624		1/23/12 18:59	MES	A
1,1,1-Trichloroethane	5.0U	ug/L		5.0	5.0	1.4	EPA 624		1/23/12 18:59	MES	A
Trichloroethene	317	ug/L		5.0	5.0	1.1	EPA 624		1/23/12 18:59	MES	A
Vinyl Chloride	10.0U	ug/L		10.0	10.0	1.2	EPA 624		1/23/12 18:59	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	109	%		72-142			EPA 624		1/23/12 18:59	MES	A
4-Bromofluorobenzene (S)	97.1	%		73-119			EPA 624		1/23/12 18:59	MES	A
Dibromofluoromethane (S)	111	%		74-132			EPA 624		1/23/12 18:59	MES	A
Toluene-d8 (S)	128	%		75-133			EPA 624		1/23/12 18:59	MES	A
WET CHEMISTRY											
Total Suspended Solids	5	mg/L		5	5	5	SM20-2540 D		1/20/12 15:10	KAK	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	1/23/12	1/23/12 11:45	MNP	D1

Sample Comments:

The GCMS volatiles analysis was performed at a dilution due to the level of target compounds.


Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9947838 HNW038|NWIRP Bethpage - GM-38

Lab ID: 9947838003 **Date Collected:** 1/18/2012 10:25 **Matrix:** Water
Sample ID: NWIRP-GM-38-PS-ASE-011812 **Date Received:** 1/19/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		1/23/12 19:31	MES	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		1/23/12 19:31	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		1/23/12 19:31	MES	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		1/23/12 19:31	MES	A
cis-1,2-Dichloroethene	0.78J	ug/L		1.0	1.0	0.26	EPA 624		1/23/12 19:31	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		1/23/12 19:31	MES	A
Tetrachloroethene	0.51J	ug/L		1.0	1.0	0.26	EPA 624		1/23/12 19:31	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		1/23/12 19:31	MES	A
Trichloroethene	3.8	ug/L		1.0	1.0	0.21	EPA 624		1/23/12 19:31	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		1/23/12 19:31	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	112	%		72-142			EPA 624		1/23/12 19:31	MES	A
4-Bromofluorobenzene (S)	96.5	%		73-119			EPA 624		1/23/12 19:31	MES	A
Dibromofluoromethane (S)	109	%		74-132			EPA 624		1/23/12 19:31	MES	A
Toluene-d8 (S)	128	%		75-133			EPA 624		1/23/12 19:31	MES	A
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		1/20/12 15:10	KAK	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	1/23/12	1/23/12 11:46	MNP	D1

Sample Comments:


Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife **United States:** Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York **Mexico:** Monterrey

ANALYTICAL RESULTS

Workorder: 9947838 HNW038|NWIRP Bethpage - GM-38

Lab ID: **9947838004** Date Collected: 1/18/2012 10:35 Matrix: Water
Sample ID: **NWIRP-GM-38-PS-BFE-011812** Date Received: 1/19/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		1/23/12 20:04	MES	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		1/23/12 20:04	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		1/23/12 20:04	MES	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		1/23/12 20:04	MES	A
cis-1,2-Dichloroethene	0.79J	ug/L		1.0	1.0	0.26	EPA 624		1/23/12 20:04	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		1/23/12 20:04	MES	A
Tetrachloroethene	0.54J	ug/L		1.0	1.0	0.26	EPA 624		1/23/12 20:04	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		1/23/12 20:04	MES	A
Trichloroethene	3.8	ug/L		1.0	1.0	0.21	EPA 624		1/23/12 20:04	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		1/23/12 20:04	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	114	%		72-142			EPA 624		1/23/12 20:04	MES	A
4-Bromofluorobenzene (S)	96.2	%		73-119			EPA 624		1/23/12 20:04	MES	A
Dibromofluoromethane (S)	111	%		74-132			EPA 624		1/23/12 20:04	MES	A
Toluene-d8 (S)	130	%		75-133			EPA 624		1/23/12 20:04	MES	A
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		1/20/12 15:10	KAK	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	1/23/12	1/23/12 11:47	MNP	D1

Sample Comments:

Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9947838 HNW038|NWIRP Bethpage - GM-38

Lab ID: **9947838005** Date Collected: 1/18/2012 10:50 Matrix: Water
Sample ID: **NWIRP-GM-38-PS-TE-011812** Date Received: 1/19/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		1/23/12 20:37	MES	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		1/23/12 20:37	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		1/23/12 20:37	MES	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		1/23/12 20:37	MES	A
cis-1,2-Dichloroethene	0.96J	ug/L		1.0	1.0	0.26	EPA 624		1/23/12 20:37	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		1/23/12 20:37	MES	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		1/23/12 20:37	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		1/23/12 20:37	MES	A
Trichloroethene	0.70J	ug/L		1.0	1.0	0.21	EPA 624		1/23/12 20:37	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		1/23/12 20:37	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	113	%		72-142			EPA 624		1/23/12 20:37	MES	A
4-Bromofluorobenzene (S)	95.7	%		73-119			EPA 624		1/23/12 20:37	MES	A
Dibromofluoromethane (S)	110	%		74-132			EPA 624		1/23/12 20:37	MES	A
Toluene-d8 (S)	126	%		75-133			EPA 624		1/23/12 20:37	MES	A
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		1/20/12 15:10	KAK	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	1/23/12	1/23/12 11:50	MNP	D1

Sample Comments:


Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife **United States:** Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York **Mexico:** Monterrey

ANALYTICAL RESULTS

Workorder: 9947838 HNW038|NWIRP Bethpage - GM-38

Lab ID: 9947838006	Date Collected: 1/18/2012 11:00	Matrix: Water
Sample ID: NWIRP-GM-38-PS-LC1-011812	Date Received: 1/19/2012 08:50	

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		1/23/12 21:10	MES	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		1/23/12 21:10	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		1/23/12 21:10	MES	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		1/23/12 21:10	MES	A
cis-1,2-Dichloroethene	0.95J	ug/L		1.0	1.0	0.26	EPA 624		1/23/12 21:10	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		1/23/12 21:10	MES	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		1/23/12 21:10	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		1/23/12 21:10	MES	A
Trichloroethene	0.40J	ug/L		1.0	1.0	0.21	EPA 624		1/23/12 21:10	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		1/23/12 21:10	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	111	%		72-142			EPA 624		1/23/12 21:10	MES	A
4-Bromofluorobenzene (S)	99.7	%		73-119			EPA 624		1/23/12 21:10	MES	A
Dibromofluoromethane (S)	112	%		74-132			EPA 624		1/23/12 21:10	MES	A
Toluene-d8 (S)	125	%		75-133			EPA 624		1/23/12 21:10	MES	A
WET CHEMISTRY											
Total Suspended Solids	6	mg/L		5	5	5	SM20-2540 D		1/20/12 15:10	KAK	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	1/23/12	1/23/12 11:51	MNP	D1

Sample Comments:


 Anna G Milliken
 Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
 Vancouver Waterloo · Winnipeg · Yellowknife
 United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York
 Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9947838 HNW038|NWIRP Bethpage - GM-38

Lab ID: 9947838007 **Date Collected:** 1/18/2012 11:10 **Matrix:** Water
Sample ID: NWIRP-GM-38-PS-LC2-011812 **Date Received:** 1/19/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		1/23/12 21:43	MES	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		1/23/12 21:43	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		1/23/12 21:43	MES	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		1/23/12 21:43	MES	A
cis-1,2-Dichloroethene	0.91J	ug/L		1.0	1.0	0.26	EPA 624		1/23/12 21:43	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		1/23/12 21:43	MES	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		1/23/12 21:43	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		1/23/12 21:43	MES	A
Trichloroethene	0.96J	ug/L		1.0	1.0	0.21	EPA 624		1/23/12 21:43	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		1/23/12 21:43	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	115	%		72-142			EPA 624		1/23/12 21:43	MES	A
4-Bromofluorobenzene (S)	97.8	%		73-119			EPA 624		1/23/12 21:43	MES	A
Dibromofluoromethane (S)	114	%		74-132			EPA 624		1/23/12 21:43	MES	A
Toluene-d8 (S)	125	%		75-133			EPA 624		1/23/12 21:43	MES	A
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		1/20/12 15:10	KAK	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	1/23/12	1/23/12 11:52	MNP	D1

Sample Comments:


Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife **United States:** Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York **Mexico:** Monterrey

ANALYTICAL RESULTS

Workorder: 9947838 HNW038|NWIRP Bethpage - GM-38

Lab ID: 9947838008	Date Collected: 1/18/2012 11:20	Matrix: Water
Sample ID: NWIRP-GM-38-PS-LC3-011812	Date Received: 1/19/2012 08:50	

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		1/23/12 22:16	MES	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		1/23/12 22:16	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		1/23/12 22:16	MES	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		1/23/12 22:16	MES	A
cis-1,2-Dichloroethene	0.92J	ug/L		1.0	1.0	0.26	EPA 624		1/23/12 22:16	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		1/23/12 22:16	MES	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		1/23/12 22:16	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		1/23/12 22:16	MES	A
Trichloroethene	0.46J	ug/L		1.0	1.0	0.21	EPA 624		1/23/12 22:16	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		1/23/12 22:16	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	112	%		72-142			EPA 624		1/23/12 22:16	MES	A
4-Bromofluorobenzene (S)	96.6	%		73-119			EPA 624		1/23/12 22:16	MES	A
Dibromofluoromethane (S)	110	%		74-132			EPA 624		1/23/12 22:16	MES	A
Toluene-d8 (S)	125	%		75-133			EPA 624		1/23/12 22:16	MES	A
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		1/20/12 15:10	KAK	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	1/23/12	1/23/12 11:53	MNP	D1

Sample Comments:


 Anna G Milliken
 Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
 Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9947838 HNW038|NWIRP Bethpage - GM-38

Lab ID: **9947838009** Date Collected: 1/18/2012 11:30 Matrix: Water
Sample ID: **NWIRP-GM-38-PS-TE-DUP-011812** Date Received: 1/19/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		1/23/12 22:49	MES	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		1/23/12 22:49	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		1/23/12 22:49	MES	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		1/23/12 22:49	MES	A
cis-1,2-Dichloroethene	0.94J	ug/L		1.0	1.0	0.26	EPA 624		1/23/12 22:49	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		1/23/12 22:49	MES	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		1/23/12 22:49	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		1/23/12 22:49	MES	A
Trichloroethene	0.71J	ug/L		1.0	1.0	0.21	EPA 624		1/23/12 22:49	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		1/23/12 22:49	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	112	%		72-142			EPA 624		1/23/12 22:49	MES	A
4-Bromofluorobenzene (S)	95.5	%		73-119			EPA 624		1/23/12 22:49	MES	A
Dibromofluoromethane (S)	111	%		74-132			EPA 624		1/23/12 22:49	MES	A
Toluene-d8 (S)	124	%		75-133			EPA 624		1/23/12 22:49	MES	A
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		1/20/12 15:10	KAK	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	1/23/12	1/23/12 11:56	MNP	D1

Sample Comments:


Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9947838 HNW038|NWIRP Bethpage - GM-38

Lab ID: **9947838010** Date Collected: 1/18/2012 11:45 Matrix: Water
Sample ID: **NWIRP-GM-38-TB-011812** Date Received: 1/19/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		1/23/12 17:52	MES	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		1/23/12 17:52	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		1/23/12 17:52	MES	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		1/23/12 17:52	MES	A
cis-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		1/23/12 17:52	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		1/23/12 17:52	MES	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		1/23/12 17:52	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		1/23/12 17:52	MES	A
Trichloroethene	1.0U	ug/L		1.0	1.0	0.21	EPA 624		1/23/12 17:52	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		1/23/12 17:52	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	108	%		72-142			EPA 624		1/23/12 17:52	MES	A
4-Bromofluorobenzene (S)	99.6	%		73-119			EPA 624		1/23/12 17:52	MES	A
Dibromofluoromethane (S)	107	%		74-132			EPA 624		1/23/12 17:52	MES	A
Toluene-d8 (S)	126	%		75-133			EPA 624		1/23/12 17:52	MES	A

Sample Comments:

Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

Chain of Custody / Request for Analysis

ALL SHADED AREAS MUST BE COMPLETED BY THE CLIENT / SAMPLER. INSTRUCTIONS ON THE BACK.

Page 1 of 2
 Courier: **FED EX**
 Tracking #: **8705 2109 698**

Container Information

Container Type	40 mL	500 mL	250 mL
CG	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
PL	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
HNO3	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

Complained by: _____
 Performed by: _____
 Cooler Temp: _____
 Therm. ID: **TH210**
 No. of Coolers: _____
 Notes: _____

ANALYSES/METHOD REQUESTED

Matrix	Select VOCs (Method 624) - Incl. CCM	Mercury (Method 245.1)	TSS (SM2540D)	pH (measured in the field)
G	9	5	1	6.08
G	3	1	1	8.18
G	3	1	1	7.99
G	3	1	1	7.90
G	3	1	1	7.60
G	3	1	1	7.79
G	3	1	1	7.73

Enter Number of Containers Per Analysis

Sample Date	Time	Military
01/18	10:00	
01/18	10:15	
01/18	10:35	
01/18	10:55	
01/18	11:00	
01/18	11:10	
01/18	11:20	

LOGGED BY (Signature): _____
REVIEWED BY (Signature): _____
Date: 1/19/12
Time: 1400

SAMPLED BY (Please Print): G. Gargeml
Refiniquished By / Company Name: _____
Date: 1/19/12
Time: 1400

ALS FIELD SERVICES

CO Labels complete/accurate?	<input type="checkbox"/>
Received on time?	<input type="checkbox"/>
(if present) Seals intact?	<input type="checkbox"/>
Custody seals Present?	<input type="checkbox"/>
Correct containers?	<input type="checkbox"/>
Correct sample volume?	<input type="checkbox"/>
Correct preservation?	<input type="checkbox"/>
Headspace/Volatiles?	<input type="checkbox"/>
Circle appropriate Y or N.	

DATA DELIVERABLES

Standard	<input type="checkbox"/>
CLP-like	<input type="checkbox"/>
NI-Reduced	<input type="checkbox"/>
NI-Full	<input type="checkbox"/>
Other	<input type="checkbox"/>

STATS SAMPLES COLLECTED IN?

SDWA	<input type="checkbox"/>
Form	<input type="checkbox"/>
Yes	<input type="checkbox"/>
MD	<input type="checkbox"/>
Yes	<input type="checkbox"/>
IL	<input type="checkbox"/>
Yes	<input type="checkbox"/>
NY	<input checked="" type="checkbox"/>
PA	<input type="checkbox"/>
Other	<input type="checkbox"/>

COPIES REQUIRED?

SDS	<input type="checkbox"/>
Form	<input type="checkbox"/>
Yes	<input type="checkbox"/>
Other	<input type="checkbox"/>

PROJECT INFORMATION

Project Name: **NWIRP Bethpage GM-38 Monthly O&M**
 ALSI Quote #: _____
 Date Required: _____
 Approved By: _____

TAT: Normal-Standard TAT is 10-12 business days.
 Rush-Subject to ALSI approval and surcharges.

Enroll #: _____
 Fax #: _____
 Y No.:

CONTACT INFORMATION

Co. Name: **H&S Environmental, Inc.**
 Contact (Print): **Jen Good**
 Address: **160 E. Main St., Suite 2F**
Westborough, MA 01581
 Phone: **508-366-7442**
 PO#: **3031-003**

BILL TO (if different than Report to):
 Same

COPIES: WHITE - ORIGINAL CANARY - CUSTOMER COPY

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
 Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

Page 2 of 2
 Courier: **9947838**
 Tracking #:

**CHAIN OF CUSTODY/
 REQUEST FOR ANALYSIS**
 ALL SHADED AREAS MUST BE COMPLETED BY THE
 CLIENT / SAMPLER. INSTRUCTIONS ON THE BACK.

Analytical Laboratory Services, Inc.
 Environmental • Industrial Hygiene • Field Services
 34 Dogwood Lane • Middletown, PA 17057 • 717-944-5541 • Fax: 717-944-1430

Co. Name: H&S Environmental, Inc.
Contact (Reports to): Jen Good
Address: 160 E. Main St., Suite 2F
 Westborough, MA 01581
Phone: 508.366.7442

Bill to (if different than Report to):
 Same
PCR: 2031-003
Project Name#: NWIRP Bethpage GM-38 Monthly O&M
ALS1 Quote #:
TAT: Normal-Standard TAT is 10-12 business days.
 Rush-Subject to ALS1 approval and surcharges.
Date Required:
Approved By:
Email#: Y N
Fax#: Y N

Sample Description/Location	COC Comments	Sample Date	Military Time
1 NWIRP-GM-38-PS-7E -DUP-01/18/10		01/18 11:30	
2 NWIRP-GM-38-TB-01/19/10		01/18 11:45	
3			
4			
5			
6			
7			
8			

Container Type
 40 mL 500 mL 250 mL
 CG PL PL
 HCL HNO3
Matrix
 G G W
 G G W
Enter Number of Containers Per Analysis
 1 1 1
Select VOCs (Method 624) - Incl CCl4
 Mercury (Method 245.1)
 TSS (SM2540D)
 pH (measured in the field) 7.60

Receipt Information
 Performed by: **AM**
 Cooler Temp: 32
 Term ID: **TK 215**
 No. of Coolers:
 Notes:

Correct containers?	Correct sample volume?	Received on ice?	COC Labels complete/accurate?	Container in good condition?
<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>

ALS1 FIELD SERVICES
 Pickup
 Labor
 Composite Sampling
 Rental Equipment
 Other:

LOGGED BY (Signature): *G. Gangemi*
REVIEWED BY (Signature): *[Signature]*
Date: 1/19/10
Time: 1400
Received By / Company Name: *[Signature]*
Date: 1/19/10
Time: 0850
State Samples Collected In?
 SDWA Form?
 Standard
 QLP-like
 NI-Reduced
 NI-Full
 Other:
Data Deliverables:
 (none)
 EPCAs Required?
 PWSID: *7014141414*
 100 Credits Required?

Copies: WHITE - ORIGINAL CANARY - CUSTOMER COPY
 * G=Grab; C=Composite
 **Matrix: Air=Air; DW=Drinking Water; GW=Groundwater; OI=Oil; OL=Other Liquid; SL=Sludge; SO=Soil; WP=Wipe; WW=Wastewater
 ***Container Type: AG=Amber Glass; CG=Clear Glass; PL=Plastic; Container Size: 250ml, 500ml, 1L, 8oz, etc. Preservative: HCl, HNO3, NaOH, etc.
 Rev 08-2008

ALS Environmental Laboratory Locations Across North America

Canada: Burlington • Calgary • Centre of Excellence • Edmonton • Fort McMurray • Fort St. John • Grande Prairie • London • Mississauga • Richmond Hill • Saskatoon • Thunder Bay
 Vancouver Waterloo • Winnipeg • Yellowknife United States: Cincinnati • Everett • Fort Collins • Holland • Houston • Middletown • Salt Lake City • Spring City • York Mexico: Monterrey

2/6/2012

Ms. Jennifer Good
H&S Environmental
160 East Main Street #2F

Westborough MA 01581

Project Name: NWIRP GM-38 Bethpage
Project #: 2031-003
Workorder #: 1201391

Dear Ms. Jennifer Good

The following report includes the data for the above referenced project for sample(s) received on 1/24/2012 at Air Toxics Ltd.

The data and associated QC analyzed by Modified TO-15 are compliant with the project requirements or laboratory criteria with the exception of the deviations noted in the attached case narrative.

Thank you for choosing Air Toxics Ltd. for your air analysis needs. Air Toxics Ltd. is committed to providing accurate data of the highest quality. Please feel free to contact the Project Manager: Ausha Scott at 916-985-1000 if you have any questions regarding the data in this report.

Regards,



Ausha Scott
Project Manager

WORK ORDER #: 1201391

Work Order Summary

CLIENT:	Ms. Jennifer Good H&S Environmental 160 East Main Street #2F Westborough, MA 01581	BILL TO:	Accounts Payable H&S Environmental 160 East Main Street #2F Westborough, MA 01581
PHONE:	508-366-7442	P.O. #	12-297
FAX:	508-366-7445	PROJECT #	2031-003 NWIRP GM-38 Bethpage
DATE RECEIVED:	01/24/2012	CONTACT:	Ausha Scott
DATE COMPLETED:	02/06/2012		

<u>FRACTION #</u>	<u>NAME</u>	<u>TEST</u>	<u>RECEIPT VAC./PRES.</u>	<u>FINAL PRESSURE</u>
01A	nwirp-GM-38-AIR-VC11-012012	Modified TO-15	4.5 "Hg	5 psi
02A	nwirp-GM-38-AR-VC12-012012	Modified TO-15	6.0 "Hg	5 psi
02AA	nwirp-GM-38-AR-VC12-012012 Lab Dupli	Modified TO-15	6.0 "Hg	5 psi
03A	nwirp-GM-38-AIR-VC23-012012	Modified TO-15	5.0 "Hg	5 psi
04A	nwirp-GM-38-AIR-VCES-012012-1	Modified TO-15	5.0 "Hg	5 psi
05A	nwirp-GM-38-AR-VCES-012012-2	Modified TO-15	3.5 "Hg	5 psi
06A	Lab Blank	Modified TO-15	NA	NA
07A	CCV	Modified TO-15	NA	NA
08A	LCS	Modified TO-15	NA	NA
08AA	LCSD	Modified TO-15	NA	NA

CERTIFIED BY: 

DATE: 02/06/12

Laboratory Director

Certification numbers: AZ Licensure AZ0719, CA NELAP - 02110CA, LA NELAP - 02089,
 NY NELAP - 11291, TX NELAP - T104704434-11-3, UT NELAP -CA009332011-1, WA NELAP - C935
 Name of Accrediting Agency: NELAP/Florida Department of Health, Scope of Application: Clean Air Act,
 Accreditation number: E87680, Effective date: 07/01/11 , Expiration date: 06/30/12.
 Air Toxics Ltd. certifies that the test results contained in this report meet all requirements of the NELAC standards

This report shall not be reproduced, except in full, without the written approval of Air Toxics Ltd.

180 BLUE RAVINE ROAD, SUITE B FOLSOM, CA - 95630
 (916) 985-1000 . (800) 985-5955 . FAX (916) 985-1020

**LABORATORY NARRATIVE
EPA Method TO-15
H&S Environmental
Workorder# 1201391**

Five 6 Liter Summa Canister samples were received on January 24, 2012. The laboratory performed analysis via EPA Method TO-15 using GC/MS in the full scan mode.

This workorder was independently validated prior to submittal using 'USEPA National Functional Guidelines' as generally applied to the analysis of volatile organic compounds in air. A rules-based, logic driven, independent validation engine was employed to assess completeness, evaluate pass/fail of relevant project quality control requirements and verification of all quantified amounts.

Receiving Notes

The Chain of Custody (COC) information for samples nwirp-GM-38-AR-VC12-012012 and nwirp-GM-38-AR-VCES-012012-2 did not match the entries on the sample tags with regard to sample identification. Therefore the information on the COC was used to process and report the samples.

Analytical Notes

As per client project requirements, the laboratory has reported estimated values for target compound hits that are below the Reporting Limit but greater than the Method Detection Limit. Concentrations that are below the level at which the canister was certified (0.2 ppbv for compounds reported at 0.5 ppbv and 0.8 ppbv for compounds reported at 2.0 ppbv) may be false positives.

Dilution was performed on sample nwirp-GM-38-AIR-VC11-012012 due to the presence of high level target species.

Definition of Data Qualifying Flags

Eight qualifiers may have been used on the data analysis sheets and indicates as follows:

B - Compound present in laboratory blank greater than reporting limit (background subtraction not performed).

J - Estimated value.

E - Exceeds instrument calibration range.

S - Saturated peak.

Q - Exceeds quality control limits.

U - Compound analyzed for but not detected above the reporting limit.

UJ- Non-detected compound associated with low bias in the CCV and/or LCS.

N - The identification is based on presumptive evidence.

File extensions may have been used on the data analysis sheets and indicates as follows:

a-File was requantified

b-File was quantified by a second column and detector

r1-File was requantified for the purpose of reissue



EPA METHOD TO-15 GC/MS FULL SCAN
 NWIRP GM-38 Bethpage

Client ID:	nwirp-GM-38-AIR-VC11-012012	Date/Time Analyzed:	1/27/12 08:37 AM
Lab ID:	1201391-01A	Dilution Factor:	6.32
Date/Time Collecte	1/20/12 10:30 AM	Instrument/Filename:	msdp.i / p012613
Media:	6 Liter Summa Canister		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	7.1	8.6	17	Not Detected U
1,2-Dichloroethane	107-06-2	2.7	6.4	13	5.0 J
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	12	530
cis-1,2-Dichloroethene	156-59-2	6.2	6.3	12	530
Tetrachloroethene	127-18-4	8.8	11	21	1500
Toluene	108-88-3	2.3	6.0	12	9.0 J
Total Xylenes	9999-9999-015	NA	NA	14	8.1 J
trans-1,2-Dichloroethene	156-60-5	8.8	6.3	12	Not Detected U
Trichloroethene	79-01-6	5.3	8.5	17	5700
Vinyl Chloride	75-01-4	2.0	4.0	8.1	39

U = The analyte was analyzed for, but not detected. The associated numerical value is at or below the MDL.
 J = Estimated value.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	111
4-Bromofluorobenzene	460-00-4	75-126	96
Toluene-d8	2037-26-5	74-121	101



EPA METHOD TO-15 GC/MS FULL SCAN
 NWIRP GM-38 Bethpage

Client ID:	nwirp-GM-38-AR-VC12-012012	Date/Time Analyzed:	1/26/12 10:17 PM
Lab ID:	1201391-02A	Dilution Factor:	1.68
Date/Time Collecte	1/20/12 10:30 AM	Instrument/Filename:	msdp.i / p012607
Media:	6 Liter Summa Canister		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	1.9	2.3	4.6	Not Detected U
1,2-Dichloroethane	107-06-2	0.71	1.7	3.4	Not Detected U
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	3.3	2.2 J
cis-1,2-Dichloroethene	156-59-2	1.6	1.7	3.3	2.2 J
Tetrachloroethene	127-18-4	2.4	2.8	5.7	3.5 J
Toluene	108-88-3	0.62	1.6	3.2	Not Detected U
Total Xylenes	9999-9999-015	NA	NA	3.6	Not Detected U
trans-1,2-Dichloroethene	156-60-5	2.3	1.7	3.3	Not Detected U
Trichloroethene	79-01-6	1.4	2.2	4.5	36
Vinyl Chloride	75-01-4	0.53	1.1	2.1	36

U = The analyte was analyzed for, but not detected. The associated numerical value is at or below the MDL.
 J = Estimated value.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	103
4-Bromofluorobenzene	460-00-4	75-126	97
Toluene-d8	2037-26-5	74-121	105



EPA METHOD TO-15 GC/MS FULL SCAN
 NWIRP GM-38 Bethpage

Client ID:	nwirp-GM-38-AR-VC12-012012 Lab Duplic	Date/Time Analyzed:	1/26/12 10:34 PM
Lab ID:	1201391-02AA	Dilution Factor:	1.68
Date/Time Collecte	1/20/12 10:30 AM	Instrument/Filename:	msdp.i / p012608
Media:	6 Liter Summa Canister		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	1.9	2.3	4.6	Not Detected U
1,2-Dichloroethane	107-06-2	0.71	1.7	3.4	Not Detected U
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	3.3	2.1 J
cis-1,2-Dichloroethene	156-59-2	1.6	1.7	3.3	2.0 J
Tetrachloroethene	127-18-4	2.4	2.8	5.7	3.8 J
Toluene	108-88-3	0.62	1.6	3.2	Not Detected U
Total Xylenes	9999-9999-015	NA	NA	3.6	Not Detected U
trans-1,2-Dichloroethene	156-60-5	2.3	1.7	3.3	Not Detected U
Trichloroethene	79-01-6	1.4	2.2	4.5	34
Vinyl Chloride	75-01-4	0.53	1.1	2.1	39

U = The analyte was analyzed for, but not detected. The associated numerical value is at or below the MDL.
 J = Estimated value.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	112
4-Bromofluorobenzene	460-00-4	75-126	100
Toluene-d8	2037-26-5	74-121	106



EPA METHOD TO-15 GC/MS FULL SCAN
 NWIRP GM-38 Bethpage

Client ID:	nwirp-GM-38-AIR-VC23-012012	Date/Time Analyzed:	1/27/12 06:29 AM
Lab ID:	1201391-03A	Dilution Factor:	1.61
Date/Time Collecte	1/20/12 10:30 AM	Instrument/Filename:	msdp.i / p012609
Media:	6 Liter Summa Canister		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	1.8	2.2	4.4	Not Detected U
1,2-Dichloroethane	107-06-2	0.68	1.6	3.2	Not Detected U
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	3.2	3.2
cis-1,2-Dichloroethene	156-59-2	1.6	1.6	3.2	3.2
Tetrachloroethene	127-18-4	2.2	2.7	5.5	3.6 J
Toluene	108-88-3	0.60	1.5	3.0	Not Detected U
Total Xylenes	9999-9999-015	NA	NA	3.5	0.91 J
trans-1,2-Dichloroethene	156-60-5	2.2	1.6	3.2	Not Detected U
Trichloroethene	79-01-6	1.3	2.2	4.3	20
Vinyl Chloride	75-01-4	0.50	1.0	2.0	44

U = The analyte was analyzed for, but not detected. The associated numerical value is at or below the MDL.
 J = Estimated value.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	109
4-Bromofluorobenzene	460-00-4	75-126	94
Toluene-d8	2037-26-5	74-121	103



EPA METHOD TO-15 GC/MS FULL SCAN
 NWIRP GM-38 Bethpage

Client ID:	nwirp-GM-38-AIR-VCES-012012-1	Date/Time Analyzed:	1/27/12 06:57 AM
Lab ID:	1201391-04A	Dilution Factor:	1.61
Date/Time Collecte	1/20/12 10:30 AM	Instrument/Filename:	msdp.i / p012610
Media:	6 Liter Summa Canister		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	1.8	2.2	4.4	Not Detected U
1,2-Dichloroethane	107-06-2	0.68	1.6	3.2	Not Detected U
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	3.2	Not Detected U
cis-1,2-Dichloroethene	156-59-2	1.6	1.6	3.2	Not Detected U
Tetrachloroethene	127-18-4	2.2	2.7	5.5	3.7 J
Toluene	108-88-3	0.60	1.5	3.0	Not Detected U
Total Xylenes	9999-9999-015	NA	NA	3.5	Not Detected U
trans-1,2-Dichloroethene	156-60-5	2.2	1.6	3.2	Not Detected U
Trichloroethene	79-01-6	1.3	2.2	4.3	15
Vinyl Chloride	75-01-4	0.50	1.0	2.0	Not Detected U

U = The analyte was analyzed for, but not detected. The associated numerical value is at or below the MDL.
 J = Estimated value.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	110
4-Bromofluorobenzene	460-00-4	75-126	97
Toluene-d8	2037-26-5	74-121	103



EPA METHOD TO-15 GC/MS FULL SCAN
 NWIRP GM-38 Bethpage

Client ID:	nwirp-GM-38-AR-VCES-012012-2	Date/Time Analyzed:	1/27/12 07:31 AM
Lab ID:	1201391-05A	Dilution Factor:	1.52
Date/Time Collecte	1/20/12 11:20 AM	Instrument/Filename:	msdp.i / p012611
Media:	6 Liter Summa Canister		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	1.7	2.1	4.1	Not Detected U
1,2-Dichloroethane	107-06-2	0.64	1.5	3.1	Not Detected U
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	3.0	Not Detected U
cis-1,2-Dichloroethene	156-59-2	1.5	1.5	3.0	Not Detected U
Tetrachloroethene	127-18-4	2.1	2.6	5.2	Not Detected U
Toluene	108-88-3	0.56	1.4	2.9	Not Detected U
Total Xylenes	9999-9999-015	NA	NA	3.3	Not Detected U
trans-1,2-Dichloroethene	156-60-5	2.1	1.5	3.0	Not Detected U
Trichloroethene	79-01-6	1.3	2.0	4.1	4.7
Vinyl Chloride	75-01-4	0.48	0.97	1.9	Not Detected U

U = The analyte was analyzed for, but not detected. The associated numerical value is at or below the MDL.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	110
4-Bromofluorobenzene	460-00-4	75-126	97
Toluene-d8	2037-26-5	74-121	103



EPA METHOD TO-15 GC/MS FULL SCAN
 NWIRP GM-38 Bethpage

Client ID:	Lab Blank	Date/Time Analyzed:	1/26/12 09:21 PM
Lab ID:	1201391-06A	Dilution Factor:	1.00
Date/Time Collecte	NA - Not Applicable	Instrument/Filename:	msdp.i / p012606c
Media:	NA - Not Applicable		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	1.1	1.4	2.7	Not Detected U
1,2-Dichloroethane	107-06-2	0.42	1.0	2.0	0.44 J
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	2.0	Not Detected U
cis-1,2-Dichloroethene	156-59-2	0.97	0.99	2.0	Not Detected U
Tetrachloroethene	127-18-4	1.4	1.7	3.4	Not Detected U
Toluene	108-88-3	0.37	0.94	1.9	Not Detected U
Total Xylenes	9999-9999-015	NA	NA	2.2	0.52 J
trans-1,2-Dichloroethene	156-60-5	1.4	0.99	2.0	Not Detected U
Trichloroethene	79-01-6	0.84	1.3	2.7	Not Detected U
Vinyl Chloride	75-01-4	0.31	0.64	1.3	Not Detected U

U = The analyte was analyzed for, but not detected. The associated numerical value is at or below the MDL.
 J = Estimated value.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	105
4-Bromofluorobenzene	460-00-4	75-126	101
Toluene-d8	2037-26-5	74-121	102



EPA METHOD TO-15 GC/MS FULL SCAN
 NWIRP GM-38 Bethpage

Client ID:	CCV	Date/Time Analyzed:	1/26/12 07:54 PM
Lab ID:	1201391-07A	Dilution Factor:	1.00
Date/Time Collecte	NA - Not Applicable	Instrument/Filename:	msdp.i / p012602a
Media:	NA - Not Applicable		

Compound	CAS#	%Recovery
1,1,2-Trichloroethane	79-00-5	114
1,2-Dichloroethane	107-06-2	117
1,2-Dichloroethene (Total of cis/trans)	540-59-0	118
cis-1,2-Dichloroethene	156-59-2	115
Tetrachloroethene	127-18-4	105
Toluene	108-88-3	110
Total Xylenes	9999-9999-015	112
trans-1,2-Dichloroethene	156-60-5	121
Trichloroethene	79-01-6	110
Vinyl Chloride	75-01-4	122

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	112
4-Bromofluorobenzene	460-00-4	75-126	106
Toluene-d8	2037-26-5	74-121	101



EPA METHOD TO-15 GC/MS FULL SCAN
 NWIRP GM-38 Bethpage

Client ID:	LCS	Date/Time Analyzed:	1/26/12 08:12 PM
Lab ID:	1201391-08A	Dilution Factor:	1.00
Date/Time Collecte	NA - Not Applicable	Instrument/Filename:	msdp.i / p012603a
Media:	NA - Not Applicable		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)
1,1,2-Trichloroethane	79-00-5		101
1,2-Dichloroethane	107-06-2		103
1,2-Dichloroethene (Total of cis/trans)	540-59-0		112
cis-1,2-Dichloroethene	156-59-2		103
Tetrachloroethene	127-18-4		92
Toluene	108-88-3		97
Total Xylenes	9999-9999-015		98
trans-1,2-Dichloroethene	156-60-5		122
Trichloroethene	79-01-6		100
Vinyl Chloride	75-01-4		111

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	110
4-Bromofluorobenzene	460-00-4	75-126	108
Toluene-d8	2037-26-5	74-121	102

* % Recovery is calculated using unrounded analytical results.



EPA METHOD TO-15 GC/MS FULL SCAN
 NWIRP GM-38 Bethpage

Client ID:	LCSD	Date/Time Analyzed:	1/26/12 08:29 PM
Lab ID:	1201391-08AA	Dilution Factor:	1.00
Date/Time Collecte	NA - Not Applicable	Instrument/Filename:	msdp.i / p012604a
Media:	NA - Not Applicable		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)
1,1,2-Trichloroethane	79-00-5		102
1,2-Dichloroethane	107-06-2		109
1,2-Dichloroethene (Total of cis/trans)	540-59-0		114
cis-1,2-Dichloroethene	156-59-2		104
Tetrachloroethene	127-18-4		95
Toluene	108-88-3		103
Total Xylenes	9999-9999-015		102
trans-1,2-Dichloroethene	156-60-5		123
Trichloroethene	79-01-6		103
Vinyl Chloride	75-01-4		115

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	108
4-Bromofluorobenzene	460-00-4	75-126	108
Toluene-d8	2037-26-5	74-121	105

* % Recovery is calculated using unrounded analytical results.

February 2012 O&M Data

February 23, 2012

Ms. Jennifer Good
H & S Environmental
160 East Main Street, 2F
Westborough, MA 01581

Certificate of Analysis

Project Name:	NWIRP Bethpage - GM-38	Workorder:	9952764
Purchase Order:	2031-003	Workorder ID:	HNW039 NWIRP Bethpage - GM-38

Dear Ms. Good,

Enclosed are the analytical results for samples received by the laboratory on Friday, February 17, 2012.

The ALS Environmental laboratory in Middletown, Pennsylvania is a National Environmental Laboratory Accreditation Program (NELAP) accredited laboratory and as such, certifies that all applicable test results meet the requirements of NELAP.

If you have any questions regarding this certificate of analysis, please contact Tonya Hironimus (Project Coordinator) or Anna G Milliken (Technical Manager) at (717) 944-5541.

Please visit us at www.analyticalab.com for a listing of ALS' NELAP accreditations and Scope of Work, as well as other links to Water Quality documentation on the internet.

This laboratory report may not be reproduced, except in full, without the written approval of ALS Environmental.

This page is included as part of the Analytical Report and must be retained as a permanent record thereof.


Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

SAMPLE SUMMARY

Workorder: 9952764 HNW039|NWIRP Bethpage - GM-38

Discard Date: 04/23/2012

Lab ID	Sample ID	Matrix	Date Collected	Date Received	Collected By
9952764001	NWIRP-GM-38-PS-RW1-021612	Water	2/16/12 12:40	2/17/12 14:00	Customer
9952764002	NWIRP-GM-38-PS-RW3-021612	Water	2/16/12 13:00	2/17/12 14:00	Customer
9952764003	NWIRP-GM-38-PS-ASE-021612	Water	2/16/12 13:10	2/17/12 14:00	Customer
9952764004	NWIRP-GM-38-PS-BFE-021612-1	Water	2/16/12 13:25	2/17/12 14:00	Customer
9952764005	NWIRP-GM-38-PS-TE-021612	Water	2/16/12 13:40	2/17/12 14:00	Customer
9952764006	NWIRP-GM-38-PS-LC1-021612	Water	2/16/12 13:55	2/17/12 14:00	Customer
9952764007	NWIRP-GM-38-PS-LC2-021612	Water	2/16/12 14:10	2/17/12 14:00	Customer
9952764008	NWIRP-GM-38-PS-LC3-021612	Water	2/16/12 14:30	2/17/12 14:00	Customer
9952764009	NWIRP-GM-38-PS-TE DUP-021612	Water	2/16/12 14:40	2/17/12 14:00	Customer
9952764010	NWIRP-GM-38-PS-TB-021612	Water	2/17/12 14:00	2/17/12 14:00	Customer

Workorder Comments:

Notes

- Samples collected by ALS personnel are done so in accordance with the procedures set forth in the ALS Field Sampling Plan (20 - Field Services Sampling Plan).
- All Waste Water analyses comply with methodology requirements of 40 CFR Part 136.
- All Drinking Water analyses comply with methodology requirements of 40 CFR Part 141.
- Unless otherwise noted, all quantitative results for soils are reported on a dry weight basis.
- The Chain of Custody document is included as part of this report.
- All Library Search analytes should be regarded as tentative identifications based on the presumptive evidence of the mass spectra. Concentrations reported are estimated values.

Standard Acronyms/Flags

J, B	Indicates an estimated value between the Method Detection Limit (MDL) and the Practical Quantitation Limit (PQL) for the analyte
U	Indicates that the analyte was Not Detected (ND)
N	Indicates presumptive evidence of the presence of a compound
MDL	Method Detection Limit
PQL	Practical Quantitation Limit
RDL	Reporting Detection Limit
ND	Not Detected - indicates that the analyte was Not Detected at the RDL
Cntr	Analysis was performed using this container
RegLmt	Regulatory Limit
LCS	Laboratory Control Sample
MS	Matrix Spike
MSD	Matrix Spike Duplicate
DUP	Sample Duplicate
%Rec	Percent Recovery
RPD	Relative Percent Difference

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9952764 HNW039|NWIRP Bethpage - GM-38

Lab ID: **9952764001** Date Collected: 2/16/2012 12:40 Matrix: Water
Sample ID: **NWIRP-GM-38-PS-RW1-021612** Date Received: 2/17/2012 14:00

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	5.0U	ug/L		5.0	5.0	1.2	EPA 624		2/21/12 17:26	TMP	A
1,1-Dichloroethane	2.7J	ug/L		5.0	5.0	0.95	EPA 624		2/21/12 17:26	TMP	A
1,2-Dichloroethane	5.0U	ug/L		5.0	5.0	1.1	EPA 624		2/21/12 17:26	TMP	A
1,1-Dichloroethene	5.4	ug/L		5.0	5.0	0.85	EPA 624		2/21/12 17:26	TMP	A
cis-1,2-Dichloroethene	38.6	ug/L		5.0	5.0	1.3	EPA 624		2/21/12 17:26	TMP	A
trans-1,2-Dichloroethene	5.0U	ug/L		5.0	5.0	0.60	EPA 624		2/21/12 17:26	TMP	A
Tetrachloroethene	97.6	ug/L		5.0	5.0	1.3	EPA 624		2/21/12 17:26	TMP	A
1,1,1-Trichloroethane	4.7J	ug/L		5.0	5.0	1.4	EPA 624		2/21/12 17:26	TMP	A
Trichloroethene	338	ug/L		5.0	5.0	1.1	EPA 624		2/21/12 17:26	TMP	A
Vinyl Chloride	4.3J	ug/L		10.0	10.0	1.2	EPA 624		2/21/12 17:26	TMP	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	77.3	%		72-142			EPA 624		2/21/12 17:26	TMP	A
4-Bromofluorobenzene (S)	101	%		73-119			EPA 624		2/21/12 17:26	TMP	A
Dibromofluoromethane (S)	91.8	%		74-132			EPA 624		2/21/12 17:26	TMP	A
Toluene-d8 (S)	115	%		75-133			EPA 624		2/21/12 17:26	TMP	A
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		2/20/12 04:30	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	2/23/12	2/23/12 11:53	MNP	D1

Sample Comments:

The GCMS volatiles analysis was performed at a dilution due to the level of target compounds.


Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9952764 HNW039|NWIRP Bethpage - GM-38

Lab ID: **9952764002** Date Collected: 2/16/2012 13:00 Matrix: Water
Sample ID: **NWIRP-GM-38-PS-RW3-021612** Date Received: 2/17/2012 14:00

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	5.0U	ug/L		5.0	5.0	1.2	EPA 624		2/21/12 17:58	TMP	A
1,1-Dichloroethane	2.3J	ug/L		5.0	5.0	0.95	EPA 624		2/21/12 17:58	TMP	A
1,2-Dichloroethane	5.0U	ug/L		5.0	5.0	1.1	EPA 624		2/21/12 17:58	TMP	A
1,1-Dichloroethene	1.7J	ug/L		5.0	5.0	0.85	EPA 624		2/21/12 17:58	TMP	A
cis-1,2-Dichloroethene	1.6J	ug/L		5.0	5.0	1.3	EPA 624		2/21/12 17:58	TMP	A
trans-1,2-Dichloroethene	5.0U	ug/L		5.0	5.0	0.60	EPA 624		2/21/12 17:58	TMP	A
Tetrachloroethene	5.0U	ug/L		5.0	5.0	1.3	EPA 624		2/21/12 17:58	TMP	A
1,1,1-Trichloroethane	5.0U	ug/L		5.0	5.0	1.4	EPA 624		2/21/12 17:58	TMP	A
Trichloroethene	308	ug/L	1,2	5.0	5.0	1.1	EPA 624		2/21/12 17:58	TMP	A
Vinyl Chloride	10.0U	ug/L		10.0	10.0	1.2	EPA 624		2/21/12 17:58	TMP	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	77	%		72-142			EPA 624		2/21/12 17:58	TMP	A
4-Bromofluorobenzene (S)	102	%		73-119			EPA 624		2/21/12 17:58	TMP	A
Dibromofluoromethane (S)	90.1	%		74-132			EPA 624		2/21/12 17:58	TMP	A
Toluene-d8 (S)	118	%		75-133			EPA 624		2/21/12 17:58	TMP	A
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		2/20/12 04:30	OA	M
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	2/23/12	2/23/12 11:54	MNP	J1

Sample Comments:

The GCMS volatiles analysis was performed at a dilution due to the level of target compounds.


Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9952764 HNW039|NWIRP Bethpage - GM-38

Lab ID: **9952764003** Date Collected: 2/16/2012 13:10 Matrix: Water
Sample ID: **NWIRP-GM-38-PS-ASE-021612** Date Received: 2/17/2012 14:00

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		2/21/12 18:31	TMP	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		2/21/12 18:31	TMP	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		2/21/12 18:31	TMP	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		2/21/12 18:31	TMP	A
cis-1,2-Dichloroethene	0.66J	ug/L		1.0	1.0	0.26	EPA 624		2/21/12 18:31	TMP	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		2/21/12 18:31	TMP	A
Tetrachloroethene	0.56J	ug/L		1.0	1.0	0.26	EPA 624		2/21/12 18:31	TMP	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		2/21/12 18:31	TMP	A
Trichloroethene	3.2	ug/L		1.0	1.0	0.21	EPA 624		2/21/12 18:31	TMP	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		2/21/12 18:31	TMP	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	77.8	%		72-142			EPA 624		2/21/12 18:31	TMP	A
4-Bromofluorobenzene (S)	96.8	%		73-119			EPA 624		2/21/12 18:31	TMP	A
Dibromofluoromethane (S)	87.6	%		74-132			EPA 624		2/21/12 18:31	TMP	A
Toluene-d8 (S)	116	%		75-133			EPA 624		2/21/12 18:31	TMP	A
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		2/20/12 04:30	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	2/23/12	2/23/12 12:00	MNP	D1

Sample Comments:


Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9952764 HNW039|NWIRP Bethpage - GM-38

 Lab ID: **9952764004** Date Collected: 2/16/2012 13:25 Matrix: Water
 Sample ID: **NWIRP-GM-38-PS-BFE-021612-1** Date Received: 2/17/2012 14:00

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		2/21/12 19:04	TMP	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		2/21/12 19:04	TMP	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		2/21/12 19:04	TMP	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		2/21/12 19:04	TMP	A
cis-1,2-Dichloroethene	0.73J	ug/L		1.0	1.0	0.26	EPA 624		2/21/12 19:04	TMP	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		2/21/12 19:04	TMP	A
Tetrachloroethene	0.52J	ug/L		1.0	1.0	0.26	EPA 624		2/21/12 19:04	TMP	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		2/21/12 19:04	TMP	A
Trichloroethene	3.1	ug/L		1.0	1.0	0.21	EPA 624		2/21/12 19:04	TMP	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		2/21/12 19:04	TMP	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	76.5	%		72-142			EPA 624		2/21/12 19:04	TMP	A
4-Bromofluorobenzene (S)	104	%		73-119			EPA 624		2/21/12 19:04	TMP	A
Dibromofluoromethane (S)	89.4	%		74-132			EPA 624		2/21/12 19:04	TMP	A
Toluene-d8 (S)	115	%		75-133			EPA 624		2/21/12 19:04	TMP	A
WET CHEMISTRY											
Total Suspended Solids	5	mg/L		5	5	5	SM20-2540 D		2/20/12 04:30	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	2/23/12	2/23/12 12:01	MNP	D1

Sample Comments:

 Anna G Milliken
 Technical Manager

ALS Environmental Laboratory Locations Across North America

 Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
 Vancouver Waterloo · Winnipeg · Yellowknife **United States:** Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York **Mexico:** Monterrey

ANALYTICAL RESULTS

Workorder: 9952764 HNW039|NWIRP Bethpage - GM-38

Lab ID: **9952764005** Date Collected: 2/16/2012 13:40 Matrix: Water
Sample ID: **NWIRP-GM-38-PS-TE-021612** Date Received: 2/17/2012 14:00

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		2/21/12 19:36	TMP	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		2/21/12 19:36	TMP	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		2/21/12 19:36	TMP	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		2/21/12 19:36	TMP	A
cis-1,2-Dichloroethene	0.85J	ug/L		1.0	1.0	0.26	EPA 624		2/21/12 19:36	TMP	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		2/21/12 19:36	TMP	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		2/21/12 19:36	TMP	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		2/21/12 19:36	TMP	A
Trichloroethene	0.65J	ug/L		1.0	1.0	0.21	EPA 624		2/21/12 19:36	TMP	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		2/21/12 19:36	TMP	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	77.8	%		72-142			EPA 624		2/21/12 19:36	TMP	A
4-Bromofluorobenzene (S)	105	%		73-119			EPA 624		2/21/12 19:36	TMP	A
Dibromofluoromethane (S)	88.8	%		74-132			EPA 624		2/21/12 19:36	TMP	A
Toluene-d8 (S)	114	%		75-133			EPA 624		2/21/12 19:36	TMP	A
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		2/20/12 04:30	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	2/23/12	2/23/12 12:02	MNP	D1

Sample Comments:

Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9952764 HNW039|NWIRP Bethpage - GM-38

Lab ID: **9952764006** Date Collected: 2/16/2012 13:55 Matrix: Water
Sample ID: **NWIRP-GM-38-PS-LC1-021612** Date Received: 2/17/2012 14:00

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		2/21/12 20:09	TMP	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		2/21/12 20:09	TMP	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		2/21/12 20:09	TMP	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		2/21/12 20:09	TMP	A
cis-1,2-Dichloroethene	0.84J	ug/L		1.0	1.0	0.26	EPA 624		2/21/12 20:09	TMP	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		2/21/12 20:09	TMP	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		2/21/12 20:09	TMP	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		2/21/12 20:09	TMP	A
Trichloroethene	0.34J	ug/L		1.0	1.0	0.21	EPA 624		2/21/12 20:09	TMP	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		2/21/12 20:09	TMP	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	79.6	%		72-142			EPA 624		2/21/12 20:09	TMP	A
4-Bromofluorobenzene (S)	100	%		73-119			EPA 624		2/21/12 20:09	TMP	A
Dibromofluoromethane (S)	90.5	%		74-132			EPA 624		2/21/12 20:09	TMP	A
Toluene-d8 (S)	113	%		75-133			EPA 624		2/21/12 20:09	TMP	A
WET CHEMISTRY											
Total Suspended Solids	5	mg/L		5	5	5	SM20-2540 D		2/20/12 04:30	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	2/23/12	2/23/12 12:03	MNP	D1

Sample Comments:

Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife **United States:** Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York **Mexico:** Monterrey

ANALYTICAL RESULTS

Workorder: 9952764 HNW039|NWIRP Bethpage - GM-38

Lab ID: 9952764007 **Date Collected:** 2/16/2012 14:10 **Matrix:** Water
Sample ID: NWIRP-GM-38-PS-LC2-021612 **Date Received:** 2/17/2012 14:00

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		2/21/12 20:42	TMP	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		2/21/12 20:42	TMP	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		2/21/12 20:42	TMP	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		2/21/12 20:42	TMP	A
cis-1,2-Dichloroethene	0.83J	ug/L		1.0	1.0	0.26	EPA 624		2/21/12 20:42	TMP	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		2/21/12 20:42	TMP	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		2/21/12 20:42	TMP	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		2/21/12 20:42	TMP	A
Trichloroethene	0.78J	ug/L		1.0	1.0	0.21	EPA 624		2/21/12 20:42	TMP	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		2/21/12 20:42	TMP	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	81.5	%		72-142			EPA 624		2/21/12 20:42	TMP	A
4-Bromofluorobenzene (S)	98.9	%		73-119			EPA 624		2/21/12 20:42	TMP	A
Dibromofluoromethane (S)	91	%		74-132			EPA 624		2/21/12 20:42	TMP	A
Toluene-d8 (S)	114	%		75-133			EPA 624		2/21/12 20:42	TMP	A
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		2/20/12 04:30	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	2/23/12	2/23/12 12:04	MNP	D1

Sample Comments:


Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife **United States:** Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York **Mexico:** Monterrey

ANALYTICAL RESULTS

Workorder: 9952764 HNW039|NWIRP Bethpage - GM-38

Lab ID: **9952764008** Date Collected: 2/16/2012 14:30 Matrix: Water
Sample ID: **NWIRP-GM-38-PS-LC3-021612** Date Received: 2/17/2012 14:00

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		2/21/12 21:15	TMP	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		2/21/12 21:15	TMP	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		2/21/12 21:15	TMP	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		2/21/12 21:15	TMP	A
cis-1,2-Dichloroethene	0.89J	ug/L		1.0	1.0	0.26	EPA 624		2/21/12 21:15	TMP	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		2/21/12 21:15	TMP	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		2/21/12 21:15	TMP	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		2/21/12 21:15	TMP	A
Trichloroethene	0.34J	ug/L		1.0	1.0	0.21	EPA 624		2/21/12 21:15	TMP	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		2/21/12 21:15	TMP	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	80.6	%		72-142			EPA 624		2/21/12 21:15	TMP	A
4-Bromofluorobenzene (S)	102	%		73-119			EPA 624		2/21/12 21:15	TMP	A
Dibromofluoromethane (S)	92.1	%		74-132			EPA 624		2/21/12 21:15	TMP	A
Toluene-d8 (S)	117	%		75-133			EPA 624		2/21/12 21:15	TMP	A
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		2/20/12 04:30	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	2/23/12	2/23/12 12:05	MNP	D1

Sample Comments:

Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9952764 HNW039|NWIRP Bethpage - GM-38

Lab ID: 9952764009 **Date Collected:** 2/16/2012 14:40 **Matrix:** Water
Sample ID: NWIRP-GM-38-PS-TE DUP-021612 **Date Received:** 2/17/2012 14:00

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		2/21/12 21:47	TMP	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		2/21/12 21:47	TMP	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		2/21/12 21:47	TMP	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		2/21/12 21:47	TMP	A
cis-1,2-Dichloroethene	0.87J	ug/L		1.0	1.0	0.26	EPA 624		2/21/12 21:47	TMP	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		2/21/12 21:47	TMP	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		2/21/12 21:47	TMP	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		2/21/12 21:47	TMP	A
Trichloroethene	0.46J	ug/L		1.0	1.0	0.21	EPA 624		2/21/12 21:47	TMP	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		2/21/12 21:47	TMP	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	78.8	%		72-142			EPA 624		2/21/12 21:47	TMP	A
4-Bromofluorobenzene (S)	98.8	%		73-119			EPA 624		2/21/12 21:47	TMP	A
Dibromofluoromethane (S)	90.3	%		74-132			EPA 624		2/21/12 21:47	TMP	A
Toluene-d8 (S)	117	%		75-133			EPA 624		2/21/12 21:47	TMP	A
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		2/20/12 05:00	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	2/23/12	2/23/12 12:06	MNP	D1

Sample Comments:


Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife **United States:** Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York **Mexico:** Monterrey

ANALYTICAL RESULTS

Workorder: 9952764 HNW039|NWIRP Bethpage - GM-38

Lab ID: **9952764010** Date Collected: 2/17/2012 14:00 Matrix: Water
Sample ID: **NWIRP-GM-38-PS-TB-021612** Date Received: 2/17/2012 14:00

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		2/21/12 16:53	TMP	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		2/21/12 16:53	TMP	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		2/21/12 16:53	TMP	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		2/21/12 16:53	TMP	A
cis-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		2/21/12 16:53	TMP	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		2/21/12 16:53	TMP	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		2/21/12 16:53	TMP	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		2/21/12 16:53	TMP	A
Trichloroethene	1.0U	ug/L		1.0	1.0	0.21	EPA 624		2/21/12 16:53	TMP	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		2/21/12 16:53	TMP	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	73.8	%		72-142			EPA 624		2/21/12 16:53	TMP	A
4-Bromofluorobenzene (S)	106	%		73-119			EPA 624		2/21/12 16:53	TMP	A
Dibromofluoromethane (S)	89.4	%		74-132			EPA 624		2/21/12 16:53	TMP	A
Toluene-d8 (S)	118	%		75-133			EPA 624		2/21/12 16:53	TMP	A

Sample Comments:

Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS QUALIFIERS/FLAGS

Workorder: 9952764 HNW039|NWIRP Bethpage - GM-38

PARAMETER QUALIFIERS/FLAGS

- [1] The QC sample type MSD for method EPA 624 was outside the control limits for the analyte Trichloroethene. The % Recovery was reported as 47.8 and the control limits were 71 to 157.
- [2] The QC sample type MS for method EPA 624 was outside the control limits for the analyte Trichloroethene. The % Recovery was reported as 63.9 and the control limits were 71 to 157.

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife **United States:** Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York **Mexico:** Monterrey

Page 1 of 1
 Counter: 208105
 Tracking #: 208105

**CHAIN OF CUSTODY/
REQUEST FOR ANALYSIS**

**ALL SHADED AREAS MUST BE COMPLETED BY THE
CLIENT / SAMPLER. INSTRUCTIONS ON THE BACK.**

34 Dogwood Lane • Middletown, PA 17057 • 717-944-5541 • Fax: 717-944-1430

Analytical Laboratory Services, Inc.
 Environmental • Industrial Hygiene • Field Services

Co. Name: H&S Environmental, Inc.
Contact (Represent): Jen Good **Phone:** 508.366.7442
Address: 160 E. Main St., Suite 2F
 Westborough, MA 01581

Project Name#: NWIRP Bedpage GM-38 Monthly O&M **ALSI Quote #:**
TAT: Normal-Standard TAT in 19-12 business days. **Date Required:**
 Rush-Subject to ALSI approval and surcharges. **Approved By:**

Bill to (if different than Report to): Same **PO#:** 2031-003

Sample Description/Location	COC Comments	Simple Date	Military Time
1 NWIRP-GM-38-PS-RW1-021612		2/16/12	17:40
2 NWIRP-GM-38-PS-RW3-021612MS/MSD for VOCs, Hg		2/16/12	13:00
3 NWIRP-GM-38-PS-ASE-021612		2/16/12	13:00
4 NWIRP-GM-38-PS-BFE-021612-1		2/16/12	13:40
5 NWIRP-GM-38-PS-TE-021612		2/16/12	13:55
6 NWIRP-GM-38-PS-LC1-021612		2/16/12	14:10
7 NWIRP-GM-38-PS-LC2-021612		2/16/12	14:30
8 NWIRP-GM-38-PS-LC3-021612		2/16/12	14:30

SAMPLED BY (Please Print): G. Gangemi
LOGGED BY (Signature): [Signature]
REVIEWED BY (Signature): [Signature]
Date: 2/16/12 **Time:** 14:30
Company Name: H&S Environmental, Inc.
Date: 2/17/12 **Time:** 16:30

Matrix	Select VOCs (Method 624) - Incl. C14	Mercury (Method 245.1)	TSS (SM2540D)	pH (measured in the field)
G	3	1	1	5.98
GW	9	3	1	6.06
G	3	1	1	6.07
GW	3	1	1	7.01
G	3	1	1	7.35
GW	3	1	1	7.61
G	3	1	1	7.53
GW	3	1	1	7.64

Container Type: AG-Ambor Glass, CG-Clear Glass, PL-Plastic, Container Size: 250ml, 500ml, 1L, 5oz, etc. Preservative: HCl, HNO3, NaOH, etc.

ALS Environmental Laboratory Locations Across North America

Canada: Burlington • Calgary • Centre of Excellence • Edmonton • Fort McMurray • Fort St. John • Grande Prairie • London • Mississauga • Richmond Hill • Saskatoon • Thunder Bay
 Vancouver Waterloo • Winnipeg • Yellowknife United States: Cincinnati • Everett • Fort Collins • Holland • Houston • Middletown • Salt Lake City • Spring City • York Mexico: Monterrey

Page 1 of 1
 Counter: 995274
 Tracking #: 8228 JWS 5775

CHAIN OF CUSTODY/ REQUEST FOR ANALYSIS

ALL SHADED AREAS MUST BE COMPLETED BY THE CLIENT/ SAMPLER. INSTRUCTIONS ON THE BACK.

Analytical Laboratory Services, Inc.
 Environmental ■ Industrial Hygiene ■ Field Services
 34 Dogwood Lane ■ Middletown, PA 17057 ■ 717-944-5541 ■ Fax: 717-944-1430

Co. Name: H&S Environmental, Inc. **Phone:** 508.366.7442
Contact (report to): Jen Good
Address: 160 E. Main St., Suite 2F
 Westborough, MA 01581

Bill to (if different than Report to): PO#: 2031-003
 Same

Project Name#: NWIRP Bethpage GM-38 Monthly O&M **ALS Quote #:**
TAT: Normal-Standard TAT is 10-12 business days. **Date Required:**
 Rush-Subject to ALSI approval and surcharges. **Approved By:**

Sample Description/Location **COC Comments** **Sample Date** **Military Time**

1	NWIRP-GM-38-PS-TE -DUP-09/14/12-2		2/16/12	1440
2	NWIRP-GM-38-TB-2/16/12		2/16/12	1000
3				
4				
5				
6				
7				
8				

SAMPLED BY (Please Print): G. Gangemi
Relinquished By/ Company Name: [Signature]
Date/Time: 2/16/12 1330
Received By/ Company Name: [Signature]
Date/Time: 2/16/12 1330

LOGGED BY (Signature): [Signature]
REVIEWED BY (Signature): [Signature]

Matrix: G GW 3 1 1
 G GW 3

ANALYSES/METHOD REQUESTED

Select VOCs (Method 624) - Incl CCl4	Mercury (Method 245.1)	TSS (SM2540D)	pH (measured in the field)
Enter Number of Containers Per Analysis			
733			

Receipt Information
 Performed by: [Signature]
 Cooler Temp: 2
 Therm. ID: [Signature]
 No. of Coolers:
 Notes:

ALS FIELD SERVICES

Custody seals Present?	Correct containers?	Correct sample volume?	Received on ice?	COC labels complete/accurate?	Container in good condition?
<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>

ALS FIELD SERVICES

State Samples Collected In?	SOA Form?	Standard	EDOS Required?
MD <input type="checkbox"/>	Yes <input type="checkbox"/>	CLP-like <input type="checkbox"/>	Yes <input type="checkbox"/>
NJ <input type="checkbox"/>	Yes <input type="checkbox"/>	NJ-Reduced <input type="checkbox"/>	Yes <input type="checkbox"/>
NY <input checked="" type="checkbox"/>	Yes <input type="checkbox"/>	NLF-ull <input type="checkbox"/>	Yes <input type="checkbox"/>
PA <input type="checkbox"/>	Yes <input type="checkbox"/>	Other <input type="checkbox"/>	Yes <input type="checkbox"/>

Other: Pickup Labor Composite Sampling Rental Equipment

COPIES: WHITE - ORIGINAL CANARY - CUSTOMER COPY

ALS Environmental Laboratory Locations Across North America

 Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
 Vancouver Waterloo · Winnipeg · Yellowknife **United States:** Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York **Mexico:** Monterrey

3/7/2012

Ms. Jennifer Good
H&S Environmental
160 East Main Street #2F

Westborough MA 01581

Project Name: Bethpage GM-38 Monthly

Project #: 2031-004

Workorder #: 1202427

Dear Ms. Jennifer Good

The following report includes the data for the above referenced project for sample(s) received on 2/20/2012 at Air Toxics Ltd.

The data and associated QC analyzed by Modified TO-15 are compliant with the project requirements or laboratory criteria with the exception of the deviations noted in the attached case narrative.

Thank you for choosing Air Toxics Ltd. for your air analysis needs. Air Toxics Ltd. is committed to providing accurate data of the highest quality. Please feel free to contact the Project Manager: Ausha Scott at 916-985-1000 if you have any questions regarding the data in this report.

Regards,



Ausha Scott


Project Manager

WORK ORDER #: 1202427

Work Order Summary

CLIENT:	Ms. Jennifer Good H&S Environmental 160 East Main Street #2F Westborough, MA 01581	BILL TO:	Accounts Payable H&S Environmental 160 East Main Street #2F Westborough, MA 01581
PHONE:	508-366-7442	P.O. #	12-297
FAX:	508-366-7445	PROJECT #	2031-004 Bethpage GM-38 Monthly
DATE RECEIVED:	02/20/2012	CONTACT:	Ausha Scott
DATE COMPLETED:	03/06/2012		

<u>FRACTION #</u>	<u>NAME</u>	<u>TEST</u>	<u>RECEIPT VAC./PRES.</u>	<u>FINAL PRESSURE</u>
01A	NWIRP-GM-38-AIR-VC11-21712	Modified TO-15	0.5 "Hg	5 psi
01AA	NWIRP-GM-38-AIR-VC11-21712 Lab Du	Modified TO-15	0.5 "Hg	5 psi
02A	NWIRP-GM-38-AIR-VC12-21712	Modified TO-15	5.0 "Hg	5 psi
03A	NWIRP-GM-38-AIR-VC23-21712	Modified TO-15	4.5 "Hg	5 psi
04A	NWIRP-GM-38-AIR-ES-21712	Modified TO-15	3.5 "Hg	5 psi
05A	NWIRP-GM-38-AIR-ES-DUP-21712	Modified TO-15	4.0 "Hg	5 psi
06A	Lab Blank	Modified TO-15	NA	NA
07A	CCV	Modified TO-15	NA	NA
08A	LCS	Modified TO-15	NA	NA
08AA	LCSD	Modified TO-15	NA	NA

CERTIFIED BY: 
 Laboratory Director

DATE: 03/06/12

Certification numbers: AZ Licensure AZ0719, CA NELAP - 02110CA, LA NELAP - 02089, NY NELAP - 11291, TX NELAP - T104704434-11-3, UT NELAP -CA009332011-1, WA NELAP - C935
 Name of Accrediting Agency: NELAP/Florida Department of Health, Scope of Application: Clean Air Act,
 Accreditation number: E87680, Effective date: 07/01/11 , Expiration date: 06/30/12.

Air Toxics Ltd. certifies that the test results contained in this report meet all requirements of the NELAC standards
 This report shall not be reproduced, except in full, without the written approval of Eurofins | Air Toxics, Inc.

180 BLUE RAVINE ROAD, SUITE B FOLSOM, CA - 95630
 (916) 985-1000 . (800) 985-5955 . FAX (916) 985-1020

LABORATORY NARRATIVE
EPA Method TO-15
H&S Environmental
Workorder# 1202427

Five 6 Liter Summa Canister samples were received on February 20, 2012. The laboratory performed analysis via EPA Method TO-15 using GC/MS in the full scan mode.

This workorder was independently validated prior to submittal using 'USEPA National Functional Guidelines' as generally applied to the analysis of volatile organic compounds in air. A rules-based, logic driven, independent validation engine was employed to assess completeness, evaluate pass/fail of relevant project quality control requirements and verification of all quantified amounts.

Receiving Notes

The Chain of Custody (COC) information for samples NWIRP-GM-38-AIR-VC11-21712, NWIRP-GM-38-AIR-VC12-21712, NWIRP-GM-38-AIR-VC23-21712, NWIRP-GM-38-AIR-ES-21712 and NWIRP-GM-38-AIR-ES-DUP-21712 did not match the entries on the sample tags with regard to sample identification. Therefore the information on the COC was used to process and report the samples.

Analytical Notes

As per client project requirements, the laboratory has reported estimated values for target compound hits that are below the Reporting Limit but greater than the Method Detection Limit. Concentrations that are below the level at which the canister was certified (0.2 ppbv for compounds reported at 0.5 ppbv and 0.8 ppbv for compounds reported at 2.0 ppbv) may be false positives.

Dilution was performed on samples NWIRP-GM-38-AIR-VC11-21712 and NWIRP-GM-38-AIR-VC11-21712 Lab Duplicate due to the presence of high level target species.

trans-1,2-Dichloroethene was manually integrated in sample NWIRP-GM-38-AIR-VC11-21712.

Vinyl Chloride was manually integrated in the initial calibration.

Definition of Data Qualifying Flags

Eight qualifiers may have been used on the data analysis sheets and indicates as follows:

B - Compound present in laboratory blank greater than reporting limit (background subtraction not performed).

J - Estimated value.

E - Exceeds instrument calibration range.

S - Saturated peak.

Q - Exceeds quality control limits.

U - Compound analyzed for but not detected above the reporting limit.

UJ- Non-detected compound associated with low bias in the CCV and/or LCS.

N - The identification is based on presumptive evidence.

File extensions may have been used on the data analysis sheets and indicates as follows:

a-File was requantified

b-File was quantified by a second column and detector

r1-File was requantified for the purpose of reissue

EPA METHOD TO-15 GC/MS FULL SCAN
Bethpage GM-38 Monthly

Client ID:	NWIRP-GM-38-AIR-VC11-21712	Date/Time Analyzed:	2/23/12 01:14 AM
Lab ID:	1202427-01A	Dilution Factor:	5.44
Date/Time Collecte	2/17/12 10:10 PM	Instrument/Filename:	msdm.i / m022227
Media:	6 Liter Summa Canister		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	1.7	4.7	15	4.8 J
1,2-Dichloroethane	107-06-2	1.2	3.5	11	8.1 J
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	11	400
cis-1,2-Dichloroethene	156-59-2	1.3	3.4	11	390
Tetrachloroethene	127-18-4	2.3	5.9	18	970
Toluene	108-88-3	0.50	3.3	10	25
Total Xylenes	9999-9999-015	NA	NA	12	18
trans-1,2-Dichloroethene	156-60-5	1.6	3.4	11	6.6 J
Trichloroethene	79-01-6	2.1	4.7	15	3400
Vinyl Chloride	75-01-4	0.85	2.2	7.0	28

J = Estimated value.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	104
4-Bromofluorobenzene	460-00-4	75-126	99
Toluene-d8	2037-26-5	74-121	95

EPA METHOD TO-15 GC/MS FULL SCAN
Bethpage GM-38 Monthly

Client ID:	NWIRP-GM-38-AIR-VC11-21712 Lab Dup	Date/Time Analyzed:	2/23/12 01:52 AM
Lab ID:	1202427-01AA	Dilution Factor:	5.44
Date/Time Collecte	2/17/12 10:10 PM	Instrument/Filename:	msdm.i / m022228
Media:	6 Liter Summa Canister		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	1.7	4.7	15	4.1 J
1,2-Dichloroethane	107-06-2	1.2	3.5	11	5.0 J
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	11	400
cis-1,2-Dichloroethene	156-59-2	1.3	3.4	11	400
Tetrachloroethene	127-18-4	2.3	5.9	18	880
Toluene	108-88-3	0.50	3.3	10	4.1 J
Total Xylenes	9999-9999-015	NA	NA	12	9.4 J
trans-1,2-Dichloroethene	156-60-5	1.6	3.4	11	6.3 J
Trichloroethene	79-01-6	2.1	4.7	15	3300
Vinyl Chloride	75-01-4	0.85	2.2	7.0	27

J = Estimated value.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	103
4-Bromofluorobenzene	460-00-4	75-126	96
Toluene-d8	2037-26-5	74-121	93

EPA METHOD TO-15 GC/MS FULL SCAN
Bethpage GM-38 Monthly

Client ID:	NWIRP-GM-38-AIR-VC12-21712	Date/Time Analyzed:	2/22/12 10:44 PM
Lab ID:	1202427-02A	Dilution Factor:	1.61
Date/Time Collecte	2/17/12 10:10 PM	Instrument/Filename:	msdm.i / m022223
Media:	6 Liter Summa Canister		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	0.50	1.4	4.4	0.90 J
1,2-Dichloroethane	107-06-2	0.36	1.0	3.2	1.4 J
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	3.2	81
cis-1,2-Dichloroethene	156-59-2	0.39	1.0	3.2	78
Tetrachloroethene	127-18-4	0.68	1.7	5.5	95
Toluene	108-88-3	0.15	0.97	3.0	4.9
Total Xylenes	9999-9999-015	NA	NA	3.5	3.2 J
trans-1,2-Dichloroethene	156-60-5	0.47	1.0	3.2	1.7 J
Trichloroethene	79-01-6	0.62	1.4	4.3	800
Vinyl Chloride	75-01-4	0.25	0.66	2.0	9.7

J = Estimated value.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	103
4-Bromofluorobenzene	460-00-4	75-126	97
Toluene-d8	2037-26-5	74-121	94

EPA METHOD TO-15 GC/MS FULL SCAN
Bethpage GM-38 Monthly

Client ID:	NWIRP-GM-38-AIR-VC23-21712	Date/Time Analyzed:	2/22/12 11:22 PM
Lab ID:	1202427-03A	Dilution Factor:	1.58
Date/Time Collecte	2/17/12 10:10 PM	Instrument/Filename:	msdm.i / m022224
Media:	6 Liter Summa Canister		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	0.49	1.4	4.3	0.52 J
1,2-Dichloroethane	107-06-2	0.35	1.0	3.2	0.74 J
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	3.1	2.5 J
cis-1,2-Dichloroethene	156-59-2	0.38	1.0	3.1	2.5 J
Tetrachloroethene	127-18-4	0.66	1.7	5.4	5.0 J
Toluene	108-88-3	0.14	0.95	3.0	0.83 J
Total Xylenes	9999-9999-015	NA	NA	3.4	1.4 J
trans-1,2-Dichloroethene	156-60-5	0.46	1.0	3.1	Not Detected U
Trichloroethene	79-01-6	0.61	1.4	4.2	17
Vinyl Chloride	75-01-4	0.25	0.65	2.0	26

U = The analyte was analyzed for, but not detected. The associated numerical value is at or below the MDL.
J = Estimated value.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	100
4-Bromofluorobenzene	460-00-4	75-126	98
Toluene-d8	2037-26-5	74-121	93

EPA METHOD TO-15 GC/MS FULL SCAN
Bethpage GM-38 Monthly

Client ID:	NWIRP-GM-38-AIR-ES-21712	Date/Time Analyzed:	2/22/12 11:59 PM
Lab ID:	1202427-04A	Dilution Factor:	1.52
Date/Time Collecte	2/17/12 10:10 PM	Instrument/Filename:	msdm.i / m022225
Media:	6 Liter Summa Canister		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	0.47	1.3	4.1	Not Detected U
1,2-Dichloroethane	107-06-2	0.34	0.98	3.1	Not Detected U
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	3.0	0.87 J
cis-1,2-Dichloroethene	156-59-2	0.36	0.96	3.0	0.86 J
Tetrachloroethene	127-18-4	0.64	1.6	5.2	4.6 J
Toluene	108-88-3	0.14	0.92	2.9	0.93 J
Total Xylenes	9999-9999-015	NA	NA	3.3	1.3 J
trans-1,2-Dichloroethene	156-60-5	0.44	0.96	3.0	Not Detected U
Trichloroethene	79-01-6	0.59	1.3	4.1	12
Vinyl Chloride	75-01-4	0.24	0.62	1.9	Not Detected U

U = The analyte was analyzed for, but not detected. The associated numerical value is at or below the MDL.
J = Estimated value.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	102
4-Bromofluorobenzene	460-00-4	75-126	98
Toluene-d8	2037-26-5	74-121	93

EPA METHOD TO-15 GC/MS FULL SCAN
Bethpage GM-38 Monthly

Client ID:	NWIRP-GM-38-AIR-ES-DUP-21712	Date/Time Analyzed:	2/23/12 12:36 AM
Lab ID:	1202427-05A	Dilution Factor:	1.55
Date/Time Collecte	2/17/12 11:00 PM	Instrument/Filename:	msdm.i / m022226
Media:	6 Liter Summa Canister		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	0.48	1.4	4.2	Not Detected U
1,2-Dichloroethane	107-06-2	0.35	1.0	3.1	Not Detected U
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	3.1	Not Detected U
cis-1,2-Dichloroethene	156-59-2	0.37	0.98	3.1	Not Detected U
Tetrachloroethene	127-18-4	0.65	1.7	5.2	2.1 J
Toluene	108-88-3	0.14	0.93	2.9	0.50 J
Total Xylenes	9999-9999-015	NA	NA	3.4	Not Detected U
trans-1,2-Dichloroethene	156-60-5	0.45	0.98	3.1	Not Detected U
Trichloroethene	79-01-6	0.60	1.3	4.2	3.9 J
Vinyl Chloride	75-01-4	0.24	0.63	2.0	Not Detected U

U = The analyte was analyzed for, but not detected. The associated numerical value is at or below the MDL.
J = Estimated value.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	104
4-Bromofluorobenzene	460-00-4	75-126	96
Toluene-d8	2037-26-5	74-121	96

EPA METHOD TO-15 GC/MS FULL SCAN
Bethpage GM-38 Monthly

Client ID:	Lab Blank	Date/Time Analyzed:	2/22/12 11:17 AM
Lab ID:	1202427-06A	Dilution Factor:	1.00
Date/Time Collecte	NA - Not Applicable	Instrument/Filename:	msdm.i / m022206a
Media:	NA - Not Applicable		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	0.31	0.87	2.7	0.65 J
1,2-Dichloroethane	107-06-2	0.22	0.65	2.0	0.79 J
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	2.0	1.5 J
cis-1,2-Dichloroethene	156-59-2	0.24	0.63	2.0	0.63 J
Tetrachloroethene	127-18-4	0.42	1.1	3.4	0.51 J
Toluene	108-88-3	0.092	0.60	1.9	0.47 J
Total Xylenes	9999-9999-015	NA	NA	2.2	1.0 J
trans-1,2-Dichloroethene	156-60-5	0.29	0.63	2.0	0.82 J
Trichloroethene	79-01-6	0.38	0.86	2.7	1.2 J
Vinyl Chloride	75-01-4	0.16	0.41	1.3	0.42 J

J = Estimated value.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	101
4-Bromofluorobenzene	460-00-4	75-126	97
Toluene-d8	2037-26-5	74-121	96

EPA METHOD TO-15 GC/MS FULL SCAN
Bethpage GM-38 Monthly

Client ID:	CCV	Date/Time Analyzed:	2/22/12 08:47 AM
Lab ID:	1202427-07A	Dilution Factor:	1.00
Date/Time Collecte	NA - Not Applicable	Instrument/Filename:	msdm.i / m022202a
Media:	NA - Not Applicable		

Compound	CAS#	%Recovery
1,1,2-Trichloroethane	79-00-5	97
1,2-Dichloroethane	107-06-2	107
1,2-Dichloroethene (Total of cis/trans)	540-59-0	92
cis-1,2-Dichloroethene	156-59-2	92
Tetrachloroethene	127-18-4	99
Toluene	108-88-3	90
Total Xylenes	9999-9999-015	96
trans-1,2-Dichloroethene	156-60-5	92
Trichloroethene	79-01-6	97
Vinyl Chloride	75-01-4	94

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	104
4-Bromofluorobenzene	460-00-4	75-126	101
Toluene-d8	2037-26-5	74-121	98

EPA METHOD TO-15 GC/MS FULL SCAN
Bethpage GM-38 Monthly

Client ID:	LCS	Date/Time Analyzed:	2/22/12 09:24 AM
Lab ID:	1202427-08A	Dilution Factor:	1.00
Date/Time Collecte	NA - Not Applicable	Instrument/Filename:	msdm.i / m022203a
Media:	NA - Not Applicable		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)
1,1,2-Trichloroethane	79-00-5		103
1,2-Dichloroethane	107-06-2		111
1,2-Dichloroethene (Total of cis/trans)	540-59-0		105
cis-1,2-Dichloroethene	156-59-2		98
Tetrachloroethene	127-18-4		103
Toluene	108-88-3		94
Total Xylenes	9999-9999-015		100
trans-1,2-Dichloroethene	156-60-5		112
Trichloroethene	79-01-6		106
Vinyl Chloride	75-01-4		101

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	100
4-Bromofluorobenzene	460-00-4	75-126	100
Toluene-d8	2037-26-5	74-121	98

* % Recovery is calculated using unrounded analytical results.

EPA METHOD TO-15 GC/MS FULL SCAN
Bethpage GM-38 Monthly

Client ID:	LCSD	Date/Time Analyzed:	2/22/12 10:02 AM
Lab ID:	1202427-08AA	Dilution Factor:	1.00
Date/Time Collecte	NA - Not Applicable	Instrument/Filename:	msdm.i / m022204a
Media:	NA - Not Applicable		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)
1,1,2-Trichloroethane	79-00-5		104
1,2-Dichloroethane	107-06-2		108
1,2-Dichloroethene (Total of cis/trans)	540-59-0		105
cis-1,2-Dichloroethene	156-59-2		99
Tetrachloroethene	127-18-4		101
Toluene	108-88-3		94
Total Xylenes	9999-9999-015		100
trans-1,2-Dichloroethene	156-60-5		111
Trichloroethene	79-01-6		105
Vinyl Chloride	75-01-4		101

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	100
4-Bromofluorobenzene	460-00-4	75-126	100
Toluene-d8	2037-26-5	74-121	99

* % Recovery is calculated using unrounded analytical results.

March 2012 O&M Data

March 14, 2012

Ms. Jennifer Good
H & S Environmental
160 East Main Street, 2F
Westborough, MA 01581

Certificate of Analysis

Project Name:	NWIRP Bethpage - GM-38	Workorder:	9955732
Purchase Order:	2031-003	Workorder ID:	HNW040 NWIRP Bethpage GM-38

Dear Ms. Good,

Enclosed are the analytical results for samples received by the laboratory on Thursday, March 08, 2012.

The ALS Environmental laboratory in Middletown, Pennsylvania is a National Environmental Laboratory Accreditation Program (NELAP) accredited laboratory and as such, certifies that all applicable test results meet the requirements of NELAP.

If you have any questions regarding this certificate of analysis, please contact Tonya Hironimus (Project Coordinator) or Anna G Milliken (Technical Manager) at (717) 944-5541.

Please visit us at www.analyticalab.com for a listing of ALS' NELAP accreditations and Scope of Work, as well as other links to Water Quality documentation on the internet.

This laboratory report may not be reproduced, except in full, without the written approval of ALS Environmental.

This page is included as part of the Analytical Report and must be retained as a permanent record thereof.



Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

SAMPLE SUMMARY

Workorder: 9955732 HNW040|NWIRP Bethpage GM-38

Discard Date: 05/13/2012

Lab ID	Sample ID	Matrix	Date Collected	Date Received	Collected By
9955732001	NWIRP-GM-38-PS-RW1-03712	Water	3/7/12 09:30	3/8/12 09:15	Customer
9955732002	NWIRP-GM-38-PS-RW3-03712	Water	3/7/12 10:00	3/8/12 09:15	Customer
9955732003	NWIRP-GM-38-PS-ASE-03712	Water	3/7/12 10:10	3/8/12 09:15	Customer
9955732004	NWIRP-GM-38-PS-BFE-03712	Water	3/7/12 10:20	3/8/12 09:15	Customer
9955732005	NWIRP-GM-38-PS-TE-03712	Water	3/7/12 10:35	3/8/12 09:15	Customer
9955732006	NWIRP-GM-38-PS-LC1-03712	Water	3/7/12 10:45	3/8/12 09:15	Customer
9955732007	NWIRP-GM-38-PS-LC2-03712	Water	3/7/12 11:00	3/8/12 09:15	Customer
9955732008	NWIRP-GM-38-PS-LC3-03712	Water	3/7/12 11:15	3/8/12 09:15	Customer
9955732009	NWIRP-GM-38-PS-TE-DUP-03712	Water	3/7/12 11:25	3/8/12 09:15	Customer
9955732010	NWIRP-GM-38-TB-03712	Water	3/8/12 09:15	3/8/12 09:15	Customer

Workorder Comments:

Notes

- Samples collected by ALS personnel are done so in accordance with the procedures set forth in the ALS Field Sampling Plan (20 - Field Services Sampling Plan).
- All Waste Water analyses comply with methodology requirements of 40 CFR Part 136.
- All Drinking Water analyses comply with methodology requirements of 40 CFR Part 141.
- Unless otherwise noted, all quantitative results for soils are reported on a dry weight basis.
- The Chain of Custody document is included as part of this report.
- All Library Search analytes should be regarded as tentative identifications based on the presumptive evidence of the mass spectra. Concentrations reported are estimated values.

Standard Acronyms/Flags

J, B	Indicates an estimated value between the Method Detection Limit (MDL) and the Practical Quantitation Limit (PQL) for the analyte
U	Indicates that the analyte was Not Detected (ND)
N	Indicates presumptive evidence of the presence of a compound
MDL	Method Detection Limit
PQL	Practical Quantitation Limit
RDL	Reporting Detection Limit
ND	Not Detected - indicates that the analyte was Not Detected at the RDL
Cntr	Analysis was performed using this container
RegLmt	Regulatory Limit
LCS	Laboratory Control Sample
MS	Matrix Spike
MSD	Matrix Spike Duplicate
DUP	Sample Duplicate
%Rec	Percent Recovery
RPD	Relative Percent Difference

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9955732 HNW040|NWIRP Bethpage GM-38

Lab ID: **9955732001** Date Collected: 3/7/2012 09:30 Matrix: Water
Sample ID: **NWIRP-GM-38-PS-RW1-03712** Date Received: 3/8/2012 09:15

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	10.0U	ug/L		10.0	10.0	2.4	EPA 624		3/13/12 05:03	MES	D
1,1-Dichloroethane	2.6J	ug/L		10.0	10.0	1.9	EPA 624		3/13/12 05:03	MES	D
1,2-Dichloroethane	10.0U	ug/L		10.0	10.0	2.2	EPA 624		3/13/12 05:03	MES	D
1,1-Dichloroethene	5.0J	ug/L		10.0	10.0	1.7	EPA 624		3/13/12 05:03	MES	D
cis-1,2-Dichloroethene	38.4	ug/L		10.0	10.0	2.6	EPA 624		3/13/12 05:03	MES	D
trans-1,2-Dichloroethene	10.0U	ug/L		10.0	10.0	1.2	EPA 624		3/13/12 05:03	MES	D
Tetrachloroethene	78.9	ug/L		10.0	10.0	2.6	EPA 624		3/13/12 05:03	MES	D
1,1,1-Trichloroethane	5.4J	ug/L		10.0	10.0	2.7	EPA 624		3/13/12 05:03	MES	D
Trichloroethene	333	ug/L		10.0	10.0	2.1	EPA 624		3/13/12 05:03	MES	D
Vinyl Chloride	2.7J	ug/L		20.0	20.0	2.4	EPA 624		3/13/12 05:03	MES	D
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	101	%		72-142			EPA 624		3/13/12 05:03	MES	D
4-Bromofluorobenzene (S)	99.8	%		73-119			EPA 624		3/13/12 05:03	MES	D
Dibromofluoromethane (S)	110	%		74-132			EPA 624		3/13/12 05:03	MES	D
Toluene-d8 (S)	118	%		75-133			EPA 624		3/13/12 05:03	MES	D
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		3/9/12 05:30	OA	M
METALS											
Mercury, Total	0.00050 U	mg/L	1,2	0.00050	0.00050	0.00016	EPA 245.1	3/12/12	3/13/12 10:02	MNP	J1

Sample Comments:

The GCMS volatiles analysis was performed at a dilution due to the level of target compounds.



Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9955732 HNW040|NWIRP Bethpage GM-38

Lab ID: **9955732002** Date Collected: 3/7/2012 10:00 Matrix: Water
Sample ID: **NWIRP-GM-38-PS-RW3-03712** Date Received: 3/8/2012 09:15

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	5.0U	ug/L		5.0	5.0	1.2	EPA 624		3/13/12 20:22	MES	A
1,1-Dichloroethane	2.3J	ug/L		5.0	5.0	0.95	EPA 624		3/13/12 20:22	MES	A
1,2-Dichloroethane	5.0U	ug/L		5.0	5.0	1.1	EPA 624		3/13/12 20:22	MES	A
1,1-Dichloroethene	1.2J	ug/L		5.0	5.0	0.85	EPA 624		3/13/12 20:22	MES	A
cis-1,2-Dichloroethene	1.8J	ug/L		5.0	5.0	1.3	EPA 624		3/13/12 20:22	MES	A
trans-1,2-Dichloroethene	5.0U	ug/L		5.0	5.0	0.60	EPA 624		3/13/12 20:22	MES	A
Tetrachloroethene	5.0U	ug/L		5.0	5.0	1.3	EPA 624		3/13/12 20:22	MES	A
1,1,1-Trichloroethane	5.0U	ug/L		5.0	5.0	1.4	EPA 624		3/13/12 20:22	MES	A
Trichloroethene	307	ug/L		5.0	5.0	1.1	EPA 624		3/13/12 20:22	MES	A
Vinyl Chloride	10.0U	ug/L		10.0	10.0	1.2	EPA 624		3/13/12 20:22	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	105	%		72-142			EPA 624		3/13/12 20:22	MES	A
4-Bromofluorobenzene (S)	90.7	%		73-119			EPA 624		3/13/12 20:22	MES	A
Dibromofluoromethane (S)	112	%		74-132			EPA 624		3/13/12 20:22	MES	A
Toluene-d8 (S)	111	%		75-133			EPA 624		3/13/12 20:22	MES	A
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		3/9/12 05:30	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L	1	0.00050	0.00050	0.00016	EPA 245.1	3/12/12	3/13/12 10:06	MNP	D1

Sample Comments:

The GCMS volatiles analysis was performed at a dilution due to the level of target compounds.


Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9955732 HNW040|NWIRP Bethpage GM-38

Lab ID: **9955732003** Date Collected: 3/7/2012 10:10 Matrix: Water
Sample ID: **NWIRP-GM-38-PS-ASE-03712** Date Received: 3/8/2012 09:15

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 20:56	MES	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 20:56	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 20:56	MES	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		3/13/12 20:56	MES	A
cis-1,2-Dichloroethene	0.77J	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 20:56	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 20:56	MES	A
Tetrachloroethene	0.63J	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 20:56	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		3/13/12 20:56	MES	A
Trichloroethene	3.9	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 20:56	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		3/13/12 20:56	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	107	%		72-142			EPA 624		3/13/12 20:56	MES	A
4-Bromofluorobenzene (S)	92.8	%		73-119			EPA 624		3/13/12 20:56	MES	A
Dibromofluoromethane (S)	113	%		74-132			EPA 624		3/13/12 20:56	MES	A
Toluene-d8 (S)	110	%		75-133			EPA 624		3/13/12 20:56	MES	A
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		3/9/12 05:30	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L	1	0.00050	0.00050	0.00016	EPA 245.1	3/12/12	3/13/12 10:07	MNP	D1

Sample Comments:

Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife **United States:** Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York **Mexico:** Monterrey

ANALYTICAL RESULTS

Workorder: 9955732 HNW040|NWIRP Bethpage GM-38

 Lab ID: **9955732004** Date Collected: 3/7/2012 10:20 Matrix: Water
 Sample ID: **NWIRP-GM-38-PS-BFE-03712** Date Received: 3/8/2012 09:15

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 21:29	MES	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 21:29	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 21:29	MES	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		3/13/12 21:29	MES	A
cis-1,2-Dichloroethene	0.80J	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 21:29	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 21:29	MES	A
Tetrachloroethene	0.60J	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 21:29	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		3/13/12 21:29	MES	A
Trichloroethene	3.9	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 21:29	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		3/13/12 21:29	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	106	%		72-142			EPA 624		3/13/12 21:29	MES	A
4-Bromofluorobenzene (S)	95.8	%		73-119			EPA 624		3/13/12 21:29	MES	A
Dibromofluoromethane (S)	113	%		74-132			EPA 624		3/13/12 21:29	MES	A
Toluene-d8 (S)	109	%		75-133			EPA 624		3/13/12 21:29	MES	A
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		3/9/12 05:30	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L	1	0.00050	0.00050	0.00016	EPA 245.1	3/12/12	3/13/12 10:08	MNP	D1

Sample Comments:

 Anna G Milliken
 Technical Manager

ALS Environmental Laboratory Locations Across North America

 Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
 Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9955732 HNW040|NWIRP Bethpage GM-38

Lab ID: 9955732005 **Date Collected:** 3/7/2012 10:35 **Matrix:** Water
Sample ID: NWIRP-GM-38-PS-TE-03712 **Date Received:** 3/8/2012 09:15

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 22:03	MES	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 22:03	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 22:03	MES	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		3/13/12 22:03	MES	A
cis-1,2-Dichloroethene	0.96J	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 22:03	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 22:03	MES	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 22:03	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		3/13/12 22:03	MES	A
Trichloroethene	0.76J	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 22:03	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		3/13/12 22:03	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	106	%		72-142			EPA 624		3/13/12 22:03	MES	A
4-Bromofluorobenzene (S)	93	%		73-119			EPA 624		3/13/12 22:03	MES	A
Dibromofluoromethane (S)	112	%		74-132			EPA 624		3/13/12 22:03	MES	A
Toluene-d8 (S)	107	%		75-133			EPA 624		3/13/12 22:03	MES	A
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		3/9/12 05:30	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L	1	0.00050	0.00050	0.00016	EPA 245.1	3/12/12	3/13/12 10:11	MNP	D1

Sample Comments:


Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife **United States:** Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York **Mexico:** Monterrey

ANALYTICAL RESULTS

Workorder: 9955732 HNW040|NWIRP Bethpage GM-38

Lab ID: **9955732006** Date Collected: 3/7/2012 10:45 Matrix: Water
Sample ID: **NWIRP-GM-38-PS-LC1-03712** Date Received: 3/8/2012 09:15

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 22:37	MES	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 22:37	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 22:37	MES	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		3/13/12 22:37	MES	A
cis-1,2-Dichloroethene	1.0	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 22:37	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 22:37	MES	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 22:37	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		3/13/12 22:37	MES	A
Trichloroethene	0.46J	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 22:37	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		3/13/12 22:37	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	108	%		72-142			EPA 624		3/13/12 22:37	MES	A
4-Bromofluorobenzene (S)	93.8	%		73-119			EPA 624		3/13/12 22:37	MES	A
Dibromofluoromethane (S)	114	%		74-132			EPA 624		3/13/12 22:37	MES	A
Toluene-d8 (S)	110	%		75-133			EPA 624		3/13/12 22:37	MES	A
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		3/9/12 05:30	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L	1	0.00050	0.00050	0.00016	EPA 245.1	3/12/12	3/13/12 10:12	MNP	D1

Sample Comments:

Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife **United States:** Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York **Mexico:** Monterrey

ANALYTICAL RESULTS

Workorder: 9955732 HNW040|NWIRP Bethpage GM-38

Lab ID: **9955732007** Date Collected: 3/7/2012 11:00 Matrix: Water
Sample ID: **NWIRP-GM-38-PS-LC2-03712** Date Received: 3/8/2012 09:15

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 23:10	MES	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 23:10	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 23:10	MES	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		3/13/12 23:10	MES	A
cis-1,2-Dichloroethene	0.95J	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 23:10	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 23:10	MES	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 23:10	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		3/13/12 23:10	MES	A
Trichloroethene	1.1	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 23:10	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		3/13/12 23:10	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	109	%		72-142			EPA 624		3/13/12 23:10	MES	A
4-Bromofluorobenzene (S)	97.9	%		73-119			EPA 624		3/13/12 23:10	MES	A
Dibromofluoromethane (S)	114	%		74-132			EPA 624		3/13/12 23:10	MES	A
Toluene-d8 (S)	111	%		75-133			EPA 624		3/13/12 23:10	MES	A
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		3/9/12 05:30	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L	1	0.00050	0.00050	0.00016	EPA 245.1	3/12/12	3/13/12 10:13	MNP	D1

Sample Comments:

Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife **United States:** Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York **Mexico:** Monterrey

ANALYTICAL RESULTS

Workorder: 9955732 HNW040|NWIRP Bethpage GM-38

Lab ID: **9955732008** Date Collected: 3/7/2012 11:15 Matrix: Water
Sample ID: **NWIRP-GM-38-PS-LC3-03712** Date Received: 3/8/2012 09:15

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 23:44	MES	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 23:44	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 23:44	MES	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		3/13/12 23:44	MES	A
cis-1,2-Dichloroethene	1.0	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 23:44	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 23:44	MES	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 23:44	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		3/13/12 23:44	MES	A
Trichloroethene	0.47J	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 23:44	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		3/13/12 23:44	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	108	%		72-142			EPA 624		3/13/12 23:44	MES	A
4-Bromofluorobenzene (S)	94	%		73-119			EPA 624		3/13/12 23:44	MES	A
Dibromofluoromethane (S)	112	%		74-132			EPA 624		3/13/12 23:44	MES	A
Toluene-d8 (S)	110	%		75-133			EPA 624		3/13/12 23:44	MES	A
WET CHEMISTRY											
Total Suspended Solids	5U	mg/L		5	5	5	SM20-2540 D		3/9/12 05:30	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L	1	0.00050	0.00050	0.00016	EPA 245.1	3/12/12	3/13/12 10:15	MNP	D1

Sample Comments:

Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9955732 HNW040|NWIRP Bethpage GM-38

Lab ID: **9955732009** Date Collected: 3/7/2012 11:25 Matrix: Water
Sample ID: **NWIRP-GM-38-PS-TE-DUP-03712** Date Received: 3/8/2012 09:15

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/14/12 00:16	MES	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/14/12 00:16	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/14/12 00:16	MES	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		3/14/12 00:16	MES	A
cis-1,2-Dichloroethene	0.98J	ug/L		1.0	1.0	0.26	EPA 624		3/14/12 00:16	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/14/12 00:16	MES	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		3/14/12 00:16	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		3/14/12 00:16	MES	A
Trichloroethene	0.73J	ug/L		1.0	1.0	0.21	EPA 624		3/14/12 00:16	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		3/14/12 00:16	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	110	%		72-142			EPA 624		3/14/12 00:16	MES	A
4-Bromofluorobenzene (S)	97	%		73-119			EPA 624		3/14/12 00:16	MES	A
Dibromofluoromethane (S)	117	%		74-132			EPA 624		3/14/12 00:16	MES	A
Toluene-d8 (S)	108	%		75-133			EPA 624		3/14/12 00:16	MES	A
WET CHEMISTRY											
Total Suspended Solids	6	mg/L		5	5	5	SM20-2540 D		3/9/12 05:30	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L	1	0.00050	0.00050	0.00016	EPA 245.1	3/12/12	3/13/12 10:16	MNP	D1

Sample Comments:

Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife **United States:** Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York **Mexico:** Monterrey

ANALYTICAL RESULTS

Workorder: 9955732 HNW040|NWIRP Bethpage GM-38

Lab ID: 9955732010 **Date Collected:** 3/8/2012 09:15 **Matrix:** Water
Sample ID: NWIRP-GM-38-TB-03712 **Date Received:** 3/8/2012 09:15

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/14/12 00:49	MES	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/14/12 00:49	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/14/12 00:49	MES	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		3/14/12 00:49	MES	A
cis-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		3/14/12 00:49	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/14/12 00:49	MES	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		3/14/12 00:49	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		3/14/12 00:49	MES	A
Trichloroethene	1.0U	ug/L		1.0	1.0	0.21	EPA 624		3/14/12 00:49	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		3/14/12 00:49	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	109	%		72-142			EPA 624		3/14/12 00:49	MES	A
4-Bromofluorobenzene (S)	92.1	%		73-119			EPA 624		3/14/12 00:49	MES	A
Dibromofluoromethane (S)	116	%		74-132			EPA 624		3/14/12 00:49	MES	A
Toluene-d8 (S)	107	%		75-133			EPA 624		3/14/12 00:49	MES	A

Sample Comments:


Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife **United States:** Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York **Mexico:** Monterrey

ANALYTICAL RESULTS QUALIFIERS/FLAGS

Workorder: 9955732 HNW040|NWIRP Bethpage GM-38

PARAMETER QUALIFIERS/FLAGS

- [1] The LCS associated with this sample failed high at 127%. The mercury content in this sample was below our reporting limit. According to the method, the sample was reported with a qualifier. 03/13/12 JWK
- [2] One of the two matrix spike analyses performed on this sample failed to meet acceptable recovery limits. The other matrix spike was within acceptable recovery limits. Matrix interferences are the possible cause for the failure.

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife **United States:** Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York **Mexico:** Monterrey

Analytical Laboratory Services, Inc.
 Environmental • Industrial Hygiene • Field Services
 34 Dogwood Lane • Middletown, PA 17057 • 717-944-5541 • Fax 717-944-1430

Co. Name: H&S Environmental, Inc.
Contact (Report): Jen Good Phone: 508.366.7442
Address: 160 E. Main St., Suite 2F Westborough, MA 01581

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS
ALL SHADED AREAS MUST BE COMPLETED BY THE CLIENT / SAMPLER. INSTRUCTIONS ON THE BACK.

Container Type: 40 mL 500 mL 250 mL
 CG PL PL PL
 HCL HNO3 -
 Preservative: -

Container Size: 5400
 Tracking #: 8709 0201
 Courier: Page 1 of 2

Container Label: Sample Performed by: [Signature]
 Cooler Temp: 4°C
 Therm. ID: TH215
 No. of Coolers: [Blank]
 Notes: [Blank]

Sample Description/Location <small>(as it will appear on the lab record)</small>	Sample Date	Military Time	COC Comments	Enter Number of Containers Per Analysis		pH (measured in the field)	TSS (SM2540D)	Mercury (Method 245.1)	Select VOCs (Method 624) - Incl. C14	Matrix	G or C	Data Deliverables		Standard		State Samples Collected In?		ALS FIELD SERVICES													
				Required?	(other)							Standard	CLP-like	NI-Reduced	NI-Full	SWA Form?	NO	NJ	NY	PA	Print	Labor	Composite Sampling	Real Equipment	Other:						
1 NWIRP-GM-38-PS-241-03710 WSI MSD for VOCs Hg	3/7/10	0830		9	3	6.00				G	GW	Standard	CLP-like	NI-Reduced	NI-Full	SWA Form?	NO	NJ	NY	PA	Print	Labor	Composite Sampling	Real Equipment	Other:						
2 NWIRP-GM-38-PS-RW3-03710MSMB for VOCs Hg	10/20	0800		3	1	6.15				G	GW	Standard	CLP-like	NI-Reduced	NI-Full	SWA Form?	NO	NJ	NY	PA	Print	Labor	Composite Sampling	Real Equipment	Other:						
3 NWIRP-GM-38-PS-ASE-03710	10/20	0800		3	1	6.84				G	GW	Standard	CLP-like	NI-Reduced	NI-Full	SWA Form?	NO	NJ	NY	PA	Print	Labor	Composite Sampling	Real Equipment	Other:						
4 NWIRP-GM-38-PS-BFE-03710	10/20	0800		3	1	7.31				G	GW	Standard	CLP-like	NI-Reduced	NI-Full	SWA Form?	NO	NJ	NY	PA	Print	Labor	Composite Sampling	Real Equipment	Other:						
5 NWIRP-GM-38-PS-TE-03710	10/25	0855		3	1	7.53				G	GW	Standard	CLP-like	NI-Reduced	NI-Full	SWA Form?	NO	NJ	NY	PA	Print	Labor	Composite Sampling	Real Equipment	Other:						
6 NWIRP-GM-38-PS-LC1-03710	10/25	1045		3	1	7.60				G	GW	Standard	CLP-like	NI-Reduced	NI-Full	SWA Form?	NO	NJ	NY	PA	Print	Labor	Composite Sampling	Real Equipment	Other:						
7 NWIRP-GM-38-PS-LC2-03710	11/09	1100		3	1	7.65				G	GW	Standard	CLP-like	NI-Reduced	NI-Full	SWA Form?	NO	NJ	NY	PA	Print	Labor	Composite Sampling	Real Equipment	Other:						
8 NWIRP-GM-38-PS-LC3-03710	11/15	1115		3	1	7.68				G	GW	Standard	CLP-like	NI-Reduced	NI-Full	SWA Form?	NO	NJ	NY	PA	Print	Labor	Composite Sampling	Real Equipment	Other:						
LOGGED BY (signature): [Signature] REVIEWED BY (signature): [Signature]												Date: 3/7/10 1145		Received By / Company Name: [Signature]		Date: 3/12/10		Time: 1145		Received By / Company Name: [Signature]		Date: 3/12/10		Time: 1145		Received By / Company Name: [Signature]		Date: 3/12/10		Time: 1145	
SAMPLED BY (Please Print): G. Gangemi												Date: 3/7/10 1145		Received By / Company Name: [Signature]		Date: 3/12/10		Time: 1145		Received By / Company Name: [Signature]		Date: 3/12/10		Time: 1145		Received By / Company Name: [Signature]		Date: 3/12/10		Time: 1145	

ALS Environmental Laboratory Locations Across North America

Canada: Burlington • Calgary • Centre of Excellence • Edmonton • Fort McMurray • Fort St. John • Grande Prairie • London • Mississauga • Richmond Hill • Saskatoon • Thunder Bay
 Vancouver Waterloo • Winnipeg • Yellowknife United States: Cincinnati • Everett • Fort Collins • Holland • Houston • Middletown • Salt Lake City • Spring City • York Mexico: Monterrey

Page 2 of 2
 Counter: 9109 0201
 Tracking #: 5400

**CHAIN OF CUSTODY/
 REQUEST FOR ANALYSIS**
 ALL SHADED AREAS MUST BE COMPLETED BY THE
 CLIENT / SAMPLER. INSTRUCTIONS ON THE BACK.

Analytical Laboratory Services, Inc.
 Environmental • Industrial Hygiene • Field Services
 34 Dogwood Lane • Middletown, PA 17057 • 717-944-5541 • Fax: 717-944-1430

Co. Name: H&S Environmental, Inc.
Contact (Repeat by): Jan Good **Phone:** 508.366.7442
Address: 160 E. Main St., Suite 2F Westborough, MA 01581
PO#: 2031-003

Project Name#: NWIRP Bethpage GM-38 Monthly O&M **ALSI Quote #:**
TAT: Normal-Standard TAT is 10-12 business days. **Date Required:**
 Rush-Subject to ALSI approval and surcharges. **Approved By:**
Email#: Y N **Job#:**
Fax#: Y N

Sample Description/Location <small>(as it will appear on the lab report)</small>	COC Comments	Sample Date	Military Time	Enter Number of Containers Per Analysis	
				Select VOCs (Method 624) - Incl CCM	TSS (SM2540D)
1 NWIRP-GM-38-PS-TE -DUP-03712		3/7/12	1:05	3	1
2 NWIRP-GM-38-TB-03712	AM 3/8/12	3/7/12	1:00	3	1
3					
4					
5					
6					
7					
8					

LOGGED BY (Signature): [Signature] **Date:** 3/8/12
REVIEWED BY (Signature): [Signature] **Date:** 3/8/12

SAMPLED BY (Please Print): G. Gangemi
Relinquished By (Signature): [Signature] **Date:** 3/7/12
Received By / Company Name: [Signature] **Date:** 3/8/12

Date	Time	Date	Time
3/7/12	1:15	3/8/12	09:15

Receipt Information
 Performed by: [Signature]
 Cooler Temp: 4°C
 Therm ID: TH215
 No. of Coolers: []
 Notes: []

Correct containers?	Correct sample volume?	Correct preservation?	Headspace/Volatiles?	Container in good condition?
<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>

ALS FIELD SERVICES
 Pickup
 Labor
 Composite Sampling
 Rental Equipment
 Other

ALS Environmental Laboratory Locations Across North America

Canada: Burlington • Calgary • Centre of Excellence • Edmonton • Fort McMurray • Fort St. John • Grande Prairie • London • Mississauga • Richmond Hill • Saskatoon • Thunder Bay
 Vancouver Waterloo • Winnipeg • Yellowknife United States: Cincinnati • Everett • Fort Collins • Holland • Houston • Middletown • Salt Lake City • Spring City • York Mexico: Monterrey

3/30/2012

Ms. Jennifer Good
H&S Environmental
160 East Main Street #2F

Westborough MA 01581

Project Name: Bethpage GM-38 Monthly

Project #: 2031-004

Workorder #: 1203230

Dear Ms. Jennifer Good

The following report includes the data for the above referenced project for sample(s) received on 3/12/2012 at Air Toxics Ltd.

The data and associated QC analyzed by Modified TO-15 are compliant with the project requirements or laboratory criteria with the exception of the deviations noted in the attached case narrative.

Thank you for choosing Air Toxics Ltd. for your air analysis needs. Air Toxics Ltd. is committed to providing accurate data of the highest quality. Please feel free to contact the Project Manager: Ausha Scott at 916-985-1000 if you have any questions regarding the data in this report.

Regards,



Ausha Scott


Project Manager

WORK ORDER #: 1203230

Work Order Summary

CLIENT:	Ms. Jennifer Good H&S Environmental 160 East Main Street #2F Westborough, MA 01581	BILL TO:	Accounts Payable H&S Environmental 160 East Main Street #2F Westborough, MA 01581
PHONE:	508-366-7442	P.O. #	12-297
FAX:	508-366-7445	PROJECT #	2031-004 Bethpage GM-38 Monthly
DATE RECEIVED:	03/12/2012	CONTACT:	Ausha Scott
DATE COMPLETED:	03/29/2012		

<u>FRACTION #</u>	<u>NAME</u>	<u>TEST</u>	<u>RECEIPT VAC./PRES.</u>	<u>FINAL PRESSURE</u>
01A	NWIRP-GM-38-AIR-VC11-	Modified TO-15	4.0 "Hg	5 psi
02A	NWIRP-GM-38-AIR-VC12-	Modified TO-15	3.5 "Hg	5 psi
02AA	NWIRP-GM-38-AIR-VC12- Lab Duplicate	Modified TO-15	3.5 "Hg	5 psi
03A	NWIRP-GM-38-AIR-VC23-	Modified TO-15	3.5 "Hg	5 psi
04A	NWIRP-GM-38-AIR-ES-	Modified TO-15	3.0 "Hg	5 psi
05A	NWIRP-GM-38-AIR-ES-DUP	Modified TO-15	3.5 "Hg	5 psi
06A	Lab Blank	Modified TO-15	NA	NA
07A	CCV	Modified TO-15	NA	NA
08A	LCS	Modified TO-15	NA	NA
08AA	LCSD	Modified TO-15	NA	NA

CERTIFIED BY: 

 Laboratory Director

DATE: 03/29/12

Certification numbers: AZ Licensure AZ0719, CA NELAP - 02110CA, LA NELAP - 02089,
 NY NELAP - 11291, TX NELAP - T104704434-11-3, UT NELAP -CA009332011-1, WA NELAP - C935
 Name of Accrediting Agency: NELAP/Florida Department of Health, Scope of Application: Clean Air Act,
 Accreditation number: E87680, Effective date: 07/01/11 , Expiration date: 06/30/12.

Air Toxics Ltd. certifies that the test results contained in this report meet all requirements of the NELAC standards
 This report shall not be reproduced, except in full, without the written approval of Eurofins | Air Toxics, Inc.

180 BLUE RAVINE ROAD, SUITE B FOLSOM, CA - 95630
 (916) 985-1000 . (800) 985-5955 . FAX (916) 985-1020

LABORATORY NARRATIVE
EPA Method TO-15
H&S Environmental
Workorder# 1203230

Five 6 Liter Summa Canister samples were received on March 12, 2012. The laboratory performed analysis via EPA Method TO-15 using GC/MS in the full scan mode.

This workorder was independently validated prior to submittal using 'USEPA National Functional Guidelines' as generally applied to the analysis of volatile organic compounds in air. A rules-based, logic driven, independent validation engine was employed to assess completeness, evaluate pass/fail of relevant project quality control requirements and verification of all quantified amounts.

Receiving Notes

Sample collection date was incomplete on the Chain of Custody (COC) for samples NWIRP-GM-38-AIR-VC11-, NWIRP-GM-38-AIR-VC12-, NWIRP-GM-38-AIR-VC23-, NWIRP-GM-38-AIR-ES- and NWIRP-GM-38-AIR-ES-DUP. The sampling date was taken from the tags.

The Chain of Custody (COC) information for sample NWIRP-GM-38-AIR-VC12- did not match the information on the canister with regard to canister identification. The client was notified of the discrepancy and the information on the canister was used to process and report the sample.

Analytical Notes

As per client project requirements, the laboratory has reported estimated values for target compound hits that are below the Reporting Limit but greater than the Method Detection Limit. Concentrations that are below the level at which the canister was certified (0.2 ppbv for compounds reported at 0.5 ppbv and 0.8 ppbv for compounds reported at 2.0 ppbv) may be false positives.

Dilution was performed on sample NWIRP-GM-38-AIR-VC11- due to the presence of high level target species.

Definition of Data Qualifying Flags

Eight qualifiers may have been used on the data analysis sheets and indicates as follows:

B - Compound present in laboratory blank greater than reporting limit (background subtraction not performed).

J - Estimated value.

E - Exceeds instrument calibration range.

S - Saturated peak.

Q - Exceeds quality control limits.

U - Compound analyzed for but not detected above the reporting limit.

UJ- Non-detected compound associated with low bias in the CCV and/or LCS.

N - The identification is based on presumptive evidence.

File extensions may have been used on the data analysis sheets and indicates as follows:

a-File was requantified

b-File was quantified by a second column and detector

r1-File was requantified for the purpose of reissue

EPA METHOD TO-15 GC/MS FULL SCAN
Bethpage GM-38 Monthly

Client ID:	NWIRP-GM-38-AIR-VCI1-	Date/Time Analyzed:	3/14/12 07:10 PM
Lab ID:	1203230-01A	Dilution Factor:	5.17
Date/Time Collecte	3/8/12 11:10 AM	Instrument/Filename:	msdj.i / j031416
Media:	6 Liter Summa Canister		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	3.4	5.6	14	Not Detected U
1,2-Dichloroethane	107-06-2	1.1	4.2	10	5.6 J
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	10	480
cis-1,2-Dichloroethene	156-59-2	1.9	4.1	10	460
Tetrachloroethene	127-18-4	3.8	7.0	18	1100
Toluene	108-88-3	1.2	3.9	9.7	6.4 J
Total Xylenes	9999-9999-015	NA	NA	11	9.3 J
trans-1,2-Dichloroethene	156-60-5	2.3	4.1	10	6.7 J
Trichloroethene	79-01-6	3.1	5.6	14	4200
Vinyl Chloride	75-01-4	1.6	2.6	6.6	28

J = Estimated value.

U = The analyte was analyzed for, but not detected. The associated numerical value is at or below the MDL.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	107
4-Bromofluorobenzene	460-00-4	75-126	92
Toluene-d8	2037-26-5	74-121	96

EPA METHOD TO-15 GC/MS FULL SCAN
Bethpage GM-38 Monthly

Client ID:	NWIRP-GM-38-AIR-VC12-	Date/Time Analyzed:	3/14/12 05:38 PM
Lab ID:	1203230-02A	Dilution Factor:	1.52
Date/Time Collecte	3/8/12 11:10 AM	Instrument/Filename:	msdj.i / j031412
Media:	6 Liter Summa Canister		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	0.99	1.6	4.1	Not Detected U
1,2-Dichloroethane	107-06-2	0.31	1.2	3.1	1.2 J
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	3.0	68
cis-1,2-Dichloroethene	156-59-2	0.57	1.2	3.0	68
Tetrachloroethene	127-18-4	1.1	2.1	5.2	200
Toluene	108-88-3	0.35	1.1	2.9	7.6
Total Xylenes	9999-9999-015	NA	NA	3.3	6.8
trans-1,2-Dichloroethene	156-60-5	0.68	1.2	3.0	0.98 J
Trichloroethene	79-01-6	0.92	1.6	4.1	820
Vinyl Chloride	75-01-4	0.47	0.78	1.9	7.3

J = Estimated value.

U = The analyte was analyzed for, but not detected. The associated numerical value is at or below the MDL.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	103
4-Bromofluorobenzene	460-00-4	75-126	92
Toluene-d8	2037-26-5	74-121	97

EPA METHOD TO-15 GC/MS FULL SCAN
Bethpage GM-38 Monthly

Client ID:	NWIRP-GM-38-AIR-VC12- Lab Duplicate	Date/Time Analyzed:	3/14/12 07:29 PM
Lab ID:	1203230-02AA	Dilution Factor:	1.52
Date/Time Collecte	3/8/12 11:10 AM	Instrument/Filename:	msdj.i / j031417
Media:	6 Liter Summa Canister		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	0.99	1.6	4.1	Not Detected U
1,2-Dichloroethane	107-06-2	0.31	1.2	3.1	1.0 J
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	3.0	68
cis-1,2-Dichloroethene	156-59-2	0.57	1.2	3.0	69
Tetrachloroethene	127-18-4	1.1	2.1	5.2	190
Toluene	108-88-3	0.35	1.1	2.9	7.1
Total Xylenes	9999-9999-015	NA	NA	3.3	6.7
trans-1,2-Dichloroethene	156-60-5	0.68	1.2	3.0	1.2 J
Trichloroethene	79-01-6	0.92	1.6	4.1	810
Vinyl Chloride	75-01-4	0.47	0.78	1.9	7.6

J = Estimated value.

U = The analyte was analyzed for, but not detected. The associated numerical value is at or below the MDL.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	108
4-Bromofluorobenzene	460-00-4	75-126	90
Toluene-d8	2037-26-5	74-121	95

EPA METHOD TO-15 GC/MS FULL SCAN
Bethpage GM-38 Monthly

Client ID:	NWIRP-GM-38-AIR-VC23-	Date/Time Analyzed:	3/14/12 05:56 PM
Lab ID:	1203230-03A	Dilution Factor:	1.52
Date/Time Collecte	3/8/12 11:10 AM	Instrument/Filename:	msdj.i / j031413
Media:	6 Liter Summa Canister		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	0.99	1.6	4.1	Not Detected U
1,2-Dichloroethane	107-06-2	0.31	1.2	3.1	Not Detected U
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	3.0	1.2 J
cis-1,2-Dichloroethene	156-59-2	0.57	1.2	3.0	1.2 J
Tetrachloroethene	127-18-4	1.1	2.1	5.2	4.6 J
Toluene	108-88-3	0.35	1.1	2.9	0.70 J
Total Xylenes	9999-9999-015	NA	NA	3.3	1.2 J
trans-1,2-Dichloroethene	156-60-5	0.68	1.2	3.0	Not Detected U
Trichloroethene	79-01-6	0.92	1.6	4.1	13
Vinyl Chloride	75-01-4	0.47	0.78	1.9	18

U = The analyte was analyzed for, but not detected. The associated numerical value is at or below the MDL.
J = Estimated value.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	109
4-Bromofluorobenzene	460-00-4	75-126	93
Toluene-d8	2037-26-5	74-121	96

EPA METHOD TO-15 GC/MS FULL SCAN
Bethpage GM-38 Monthly

Client ID:	NWIRP-GM-38-AIR-ES-	Date/Time Analyzed:	3/14/12 06:17 PM
Lab ID:	1203230-04A	Dilution Factor:	1.49
Date/Time Collecte	3/8/12 11:10 AM	Instrument/Filename:	msdj.i / j031414
Media:	6 Liter Summa Canister		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	0.97	1.6	4.1	Not Detected U
1,2-Dichloroethane	107-06-2	0.31	1.2	3.0	Not Detected U
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	3.0	0.59 J
cis-1,2-Dichloroethene	156-59-2	0.56	1.2	3.0	0.59 J
Tetrachloroethene	127-18-4	1.1	2.0	5.0	3.7 J
Toluene	108-88-3	0.34	1.1	2.8	1.2 J
Total Xylenes	9999-9999-015	NA	NA	3.2	Not Detected U
trans-1,2-Dichloroethene	156-60-5	0.67	1.2	3.0	Not Detected U
Trichloroethene	79-01-6	0.90	1.6	4.0	9.7
Vinyl Chloride	75-01-4	0.46	0.76	1.9	Not Detected U

U = The analyte was analyzed for, but not detected. The associated numerical value is at or below the MDL.
J = Estimated value.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	106
4-Bromofluorobenzene	460-00-4	75-126	92
Toluene-d8	2037-26-5	74-121	96

EPA METHOD TO-15 GC/MS FULL SCAN
Bethpage GM-38 Monthly

Client ID:	NWIRP-GM-38-AIR-ES-DUP	Date/Time Analyzed:	3/14/12 06:52 PM
Lab ID:	1203230-05A	Dilution Factor:	1.52
Date/Time Collecte	3/8/12 11:50 AM	Instrument/Filename:	msdj.i / j031415
Media:	6 Liter Summa Canister		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	0.99	1.6	4.1	Not Detected U
1,2-Dichloroethane	107-06-2	0.31	1.2	3.1	Not Detected U
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	3.0	Not Detected U
cis-1,2-Dichloroethene	156-59-2	0.57	1.2	3.0	Not Detected U
Tetrachloroethene	127-18-4	1.1	2.1	5.2	2.3 J
Toluene	108-88-3	0.35	1.1	2.9	1.1 J
Total Xylenes	9999-9999-015	NA	NA	3.3	0.54 J
trans-1,2-Dichloroethene	156-60-5	0.68	1.2	3.0	Not Detected U
Trichloroethene	79-01-6	0.92	1.6	4.1	4.4
Vinyl Chloride	75-01-4	0.47	0.78	1.9	Not Detected U

U = The analyte was analyzed for, but not detected. The associated numerical value is at or below the MDL.
J = Estimated value.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	106
4-Bromofluorobenzene	460-00-4	75-126	93
Toluene-d8	2037-26-5	74-121	96

EPA METHOD TO-15 GC/MS FULL SCAN
Bethpage GM-38 Monthly

Client ID:	Lab Blank	Date/Time Analyzed:	3/14/12 01:44 PM
Lab ID:	1203230-06A	Dilution Factor:	1.00
Date/Time Collecte	NA - Not Applicable	Instrument/Filename:	msdj.i / j031407c
Media:	NA - Not Applicable		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)	Rpt. Limit (ug/m3)	Amount (ug/m3)
1,1,2-Trichloroethane	79-00-5	0.65	1.1	2.7	0.86 J
1,2-Dichloroethane	107-06-2	0.21	0.81	2.0	0.84 J
1,2-Dichloroethene (Total of cis/trans)	540-59-0	NA	NA	2.0	Not Detected U
cis-1,2-Dichloroethene	156-59-2	0.37	0.79	2.0	0.65 J
Tetrachloroethene	127-18-4	0.75	1.4	3.4	1.1 J
Toluene	108-88-3	0.23	0.75	1.9	0.87 J
Total Xylenes	9999-9999-015	NA	NA	2.2	Not Detected U
trans-1,2-Dichloroethene	156-60-5	0.45	0.79	2.0	0.98 J
Trichloroethene	79-01-6	0.60	1.1	2.7	1.0 J
Vinyl Chloride	75-01-4	0.31	0.51	1.3	Not Detected U

U = The analyte was analyzed for, but not detected. The associated numerical value is at or below the MDL.
J = Estimated value.

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	104
4-Bromofluorobenzene	460-00-4	75-126	92
Toluene-d8	2037-26-5	74-121	96

EPA METHOD TO-15 GC/MS FULL SCAN
Bethpage GM-38 Monthly

Client ID:	CCV	Date/Time Analyzed:	3/14/12 11:59 AM
Lab ID:	1203230-07A	Dilution Factor:	1.00
Date/Time Collecte	NA - Not Applicable	Instrument/Filename:	msdj.i / j031403a
Media:	NA - Not Applicable		

Compound	CAS#	%Recovery
1,1,2-Trichloroethane	79-00-5	94
1,2-Dichloroethane	107-06-2	100
1,2-Dichloroethene (Total of cis/trans)	540-59-0	90
cis-1,2-Dichloroethene	156-59-2	89
Tetrachloroethene	127-18-4	89
Toluene	108-88-3	86
Total Xylenes	9999-9999-015	89
trans-1,2-Dichloroethene	156-60-5	90
Trichloroethene	79-01-6	90
Vinyl Chloride	75-01-4	92

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	104
4-Bromofluorobenzene	460-00-4	75-126	96
Toluene-d8	2037-26-5	74-121	100

EPA METHOD TO-15 GC/MS FULL SCAN
Bethpage GM-38 Monthly

Client ID:	LCS	Date/Time Analyzed:	3/14/12 12:39 PM
Lab ID:	1203230-08A	Dilution Factor:	1.00
Date/Time Collecte	NA - Not Applicable	Instrument/Filename:	msdj.i / j031404
Media:	NA - Not Applicable		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)
1,1,2-Trichloroethane	79-00-5		108
1,2-Dichloroethane	107-06-2		114
1,2-Dichloroethene (Total of cis/trans)	540-59-0		109
cis-1,2-Dichloroethene	156-59-2		103
Tetrachloroethene	127-18-4		101
Toluene	108-88-3		101
Total Xylenes	9999-9999-015		103
trans-1,2-Dichloroethene	156-60-5		115
Trichloroethene	79-01-6		106
Vinyl Chloride	75-01-4		108

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	70-130	104
4-Bromofluorobenzene	460-00-4	70-130	95
Toluene-d8	2037-26-5	70-130	101

* % Recovery is calculated using unrounded analytical results.

EPA METHOD TO-15 GC/MS FULL SCAN
Bethpage GM-38 Monthly

Client ID:	LCSD	Date/Time Analyzed:	3/14/12 12:56 PM
Lab ID:	1203230-08AA	Dilution Factor:	1.00
Date/Time Collecte	NA - Not Applicable	Instrument/Filename:	msdj.i / j031405a
Media:	NA - Not Applicable		

Compound	CAS#	MDL (ug/m3)	LOD (ug/m3)
1,1,2-Trichloroethane	79-00-5		110
1,2-Dichloroethane	107-06-2		114
1,2-Dichloroethene (Total of cis/trans)	540-59-0		114
cis-1,2-Dichloroethene	156-59-2		108
Tetrachloroethene	127-18-4		102
Toluene	108-88-3		99
Total Xylenes	9999-9999-015		106
trans-1,2-Dichloroethene	156-60-5		121
Trichloroethene	79-01-6		107
Vinyl Chloride	75-01-4		112

Surrogates	CAS#	Limits	%Recovery
1,2-Dichloroethane-d4	17060-07-0	61-141	110
4-Bromofluorobenzene	460-00-4	75-126	97
Toluene-d8	2037-26-5	74-121	97

* % Recovery is calculated using unrounded analytical results.

March 2012 LTM Data

March 19, 2012

Ms. Jennifer Good
H & S Environmental
160 East Main Street, 2F
Westborough, MA 01581

Certificate of Analysis

Project Name:	NWIRP Bethpage - GM-38	Workorder:	9956129
Purchase Order:	2031-005	Workorder ID:	HNW041 NWIRP Bethpage - GM-38

Dear Ms. Good,

Enclosed are the analytical results for samples received by the laboratory on Friday, March 09, 2012.

The ALS Environmental laboratory in Middletown, Pennsylvania is a National Environmental Laboratory Accreditation Program (NELAP) accredited laboratory and as such, certifies that all applicable test results meet the requirements of NELAP.

If you have any questions regarding this certificate of analysis, please contact Tonya Hironimus (Project Coordinator) or Anna G Milliken (Technical Manager) at (717) 944-5541.

Please visit us at www.analyticalab.com for a listing of ALS' NELAP accreditations and Scope of Work, as well as other links to Water Quality documentation on the internet.

This laboratory report may not be reproduced, except in full, without the written approval of ALS Environmental.

This page is included as part of the Analytical Report and must be retained as a permanent record thereof.



Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

SAMPLE SUMMARY

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Discard Date: 05/18/2012

Lab ID	Sample ID	Matrix	Date Collected	Date Received	Collected By
9956129001	NWIRP-GM-38-GW-RW1-MW1	Water	3/8/12 11:05	3/9/12 08:50	Customer
9956129002	NWIRP-GM-38-GW-RW1-MW3-03082012	Water	3/8/12 13:30	3/9/12 08:50	Customer
9956129003	NWIRP-GM-38-GW-RW2-MW1-03072012	Water	3/7/12 11:20	3/9/12 08:50	Customer
9956129004	NWIRP-GM-38-GW-RW3-MW1-03072012	Water	3/7/12 17:50	3/9/12 08:50	Customer
9956129005	NWIRP-GM-38-GW-RW3-MW2-03082012	Water	3/8/12 12:15	3/9/12 08:50	Customer
9956129006	NWIRP-GM-38-GW-RW3-MW3-03072012	Water	3/7/12 14:45	3/9/12 08:50	Customer
9956129007	NWIRP-GM-38-GW-RW3-MW4-03072012	Water	3/7/12 13:15	3/9/12 08:50	Customer
9956129008	NWIRP-GM-38-GW-TP1-03082012	Water	3/8/12 09:00	3/9/12 08:50	Customer
9956129009	NWIRP-GM-38-GW-RW3-MW3-03072012DUP	Water	3/7/12 14:45	3/9/12 08:50	Customer
9956129010	NWIRP-GM-38-FB-03072012	Water	3/7/12 18:50	3/9/12 08:50	Customer
9956129011	NWIRP-GM-38-TB-03072012	Water	3/9/12 08:50	3/9/12 08:50	Customer

Workorder Comments:

Notes

- Samples collected by ALS personnel are done so in accordance with the procedures set forth in the ALS Field Sampling Plan (20 - Field Services Sampling Plan).
- All Waste Water analyses comply with methodology requirements of 40 CFR Part 136.
- All Drinking Water analyses comply with methodology requirements of 40 CFR Part 141.
- Unless otherwise noted, all quantitative results for soils are reported on a dry weight basis.
- The Chain of Custody document is included as part of this report.
- All Library Search analytes should be regarded as tentative identifications based on the presumptive evidence of the mass spectra. Concentrations reported are estimated values.

Standard Acronyms/Flags

J, B	Indicates an estimated value between the Method Detection Limit (MDL) and the Practical Quantitation Limit (PQL) for the analyte
U	Indicates that the analyte was Not Detected (ND)
N	Indicates presumptive evidence of the presence of a compound
MDL	Method Detection Limit
PQL	Practical Quantitation Limit
RDL	Reporting Detection Limit
ND	Not Detected - indicates that the analyte was Not Detected at the RDL
Cntr	Analysis was performed using this container
RegLmt	Regulatory Limit
LCS	Laboratory Control Sample
MS	Matrix Spike
MSD	Matrix Spike Duplicate
DUP	Sample Duplicate
%Rec	Percent Recovery
RPD	Relative Percent Difference

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: **9956129001** Date Collected: 3/8/2012 11:05 Matrix: Water
Sample ID: **NWIRP-GM-38-GW-RW1-MW1** Date Received: 3/9/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Acrolein	30.0U	ug/L		30.0	30.0	2.4	EPA 624		3/13/12 12:14	MES	A
Acrylonitrile	5.0U	ug/L		5.0	5.0	0.89	EPA 624		3/13/12 12:14	MES	A
Benzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 12:14	MES	A
Bromodichloromethane	1.0U	ug/L		1.0	1.0	0.13	EPA 624		3/13/12 12:14	MES	A
Bromoform	2.0U	ug/L		2.0	2.0	0.21	EPA 624		3/13/12 12:14	MES	A
Bromomethane	2.0U	ug/L		2.0	2.0	0.27	EPA 624		3/13/12 12:14	MES	A
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 12:14	MES	A
Chlorobenzene	1.0U	ug/L		1.0	1.0	0.11	EPA 624		3/13/12 12:14	MES	A
Chlorodibromomethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 12:14	MES	A
Chloroethane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 12:14	MES	A
2-Chloroethylvinyl ether	2.0U	ug/L		2.0	2.0	0.28	EPA 624		3/13/12 12:14	MES	A
Chloroform	1.0U	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 12:14	MES	A
Chloromethane	1.0U	ug/L		1.0	1.0	0.25	EPA 624		3/13/12 12:14	MES	A
1,2-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.20	EPA 624		3/13/12 12:14	MES	A
1,3-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 12:14	MES	A
1,4-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 12:14	MES	A
1,1-Dichloroethane	5.2	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 12:14	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 12:14	MES	A
1,1-Dichloroethene	2.7	ug/L		1.0	1.0	0.17	EPA 624		3/13/12 12:14	MES	A
cis-1,2-Dichloroethene	179	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 12:14	MES	A
trans-1,2-Dichloroethene	3.0	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 12:14	MES	A
1,2-Dichloropropane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 12:14	MES	A
cis-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 12:14	MES	A
trans-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 12:14	MES	A
1,3-Dichloropropene, Total	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 12:14	MES	A
Ethylbenzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 12:14	MES	A
Methylene Chloride	1.0U	ug/L		1.0	1.0	0.32	EPA 624		3/13/12 12:14	MES	A
1,1,2,2-Tetrachloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 12:14	MES	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 12:14	MES	A
Toluene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 12:14	MES	A
1,1,1-Trichloroethane	0.96J	ug/L		1.0	1.0	0.27	EPA 624		3/13/12 12:14	MES	A
1,1,2-Trichloroethane	1.0U	ug/L		1.0	1.0	0.30	EPA 624		3/13/12 12:14	MES	A
Trichloroethene	115	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 12:14	MES	A
Trichlorofluoromethane	1.0U	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 12:14	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		3/13/12 12:14	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	100	%		72-142			EPA 624		3/13/12 12:14	MES	A
4-Bromofluorobenzene (S)	93.2	%		73-119			EPA 624		3/13/12 12:14	MES	A
Dibromofluoromethane (S)	108	%		74-132			EPA 624		3/13/12 12:14	MES	A
Toluene-d8 (S)	114	%		75-133			EPA 624		3/13/12 12:14	MES	A

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: **9956129001** Date Collected: 3/8/2012 11:05 Matrix: Water
 Sample ID: **NWIRP-GM-38-GW-RW1-MW1** Date Received: 3/9/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
WET CHEMISTRY											
Total Suspended Solids	16	mg/L		5	5	5	SM20-2540 D		3/12/12 05:00	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	3/15/12	3/15/12 12:10	MNP	D1

Sample Comments:


 Anna G Milliken
 Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
 Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: **9956129002** Date Collected: 3/8/2012 13:30 Matrix: Water
Sample ID: **NWIRP-GM-38-GW-RW1-MW3-03082012** Date Received: 3/9/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Acrolein	30.0U	ug/L		30.0	30.0	2.4	EPA 624		3/13/12 12:47	MES	A
Acrylonitrile	5.0U	ug/L		5.0	5.0	0.89	EPA 624		3/13/12 12:47	MES	A
Benzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 12:47	MES	A
Bromodichloromethane	1.0U	ug/L		1.0	1.0	0.13	EPA 624		3/13/12 12:47	MES	A
Bromoform	2.0U	ug/L		2.0	2.0	0.21	EPA 624		3/13/12 12:47	MES	A
Bromomethane	2.0U	ug/L		2.0	2.0	0.27	EPA 624		3/13/12 12:47	MES	A
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 12:47	MES	A
Chlorobenzene	1.0U	ug/L		1.0	1.0	0.11	EPA 624		3/13/12 12:47	MES	A
Chlorodibromomethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 12:47	MES	A
Chloroethane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 12:47	MES	A
2-Chloroethylvinyl ether	2.0U	ug/L		2.0	2.0	0.28	EPA 624		3/13/12 12:47	MES	A
Chloroform	0.73J	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 12:47	MES	A
Chloromethane	1.0U	ug/L		1.0	1.0	0.25	EPA 624		3/13/12 12:47	MES	A
1,2-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.20	EPA 624		3/13/12 12:47	MES	A
1,3-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 12:47	MES	A
1,4-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 12:47	MES	A
1,1-Dichloroethane	8.4	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 12:47	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 12:47	MES	A
1,1-Dichloroethene	1.8	ug/L		1.0	1.0	0.17	EPA 624		3/13/12 12:47	MES	A
cis-1,2-Dichloroethene	0.68J	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 12:47	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 12:47	MES	A
1,2-Dichloropropane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 12:47	MES	A
cis-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 12:47	MES	A
trans-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 12:47	MES	A
1,3-Dichloropropene, Total	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 12:47	MES	A
Ethylbenzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 12:47	MES	A
Methylene Chloride	1.0U	ug/L		1.0	1.0	0.32	EPA 624		3/13/12 12:47	MES	A
1,1,2,2-Tetrachloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 12:47	MES	A
Tetrachloroethene	0.65J	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 12:47	MES	A
Toluene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 12:47	MES	A
1,1,1-Trichloroethane	1.8	ug/L		1.0	1.0	0.27	EPA 624		3/13/12 12:47	MES	A
1,1,2-Trichloroethane	0.70J	ug/L		1.0	1.0	0.30	EPA 624		3/13/12 12:47	MES	A
Trichloroethene	2.2	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 12:47	MES	A
Trichlorofluoromethane	1.0U	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 12:47	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		3/13/12 12:47	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	100	%		72-142			EPA 624		3/13/12 12:47	MES	A
4-Bromofluorobenzene (S)	94.8	%		73-119			EPA 624		3/13/12 12:47	MES	A
Dibromofluoromethane (S)	110	%		74-132			EPA 624		3/13/12 12:47	MES	A
Toluene-d8 (S)	112	%		75-133			EPA 624		3/13/12 12:47	MES	A

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: 9956129002	Date Collected: 3/8/2012 13:30	Matrix: Water
Sample ID: NWIRP-GM-38-GW-RW1-MW3-03082012	Date Received: 3/9/2012 08:50	

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
WET CHEMISTRY											
Total Suspended Solids	5	mg/L		5	5	5	SM20-2540 D		3/12/12 05:00	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	3/15/12	3/15/12 12:11	MNP	D1

Sample Comments:


Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife
United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York
Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: **9956129003** Date Collected: 3/7/2012 11:20 Matrix: Water
Sample ID: **NWIRP-GM-38-GW-RW2-MW1-03072012** Date Received: 3/9/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Acrolein	30.0U	ug/L		30.0	30.0	2.4	EPA 624		3/13/12 13:19	MES	A
Acrylonitrile	5.0U	ug/L		5.0	5.0	0.89	EPA 624		3/13/12 13:19	MES	A
Benzene	0.22J	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 13:19	MES	A
Bromodichloromethane	1.0U	ug/L		1.0	1.0	0.13	EPA 624		3/13/12 13:19	MES	A
Bromoform	2.0U	ug/L		2.0	2.0	0.21	EPA 624		3/13/12 13:19	MES	A
Bromomethane	2.0U	ug/L		2.0	2.0	0.27	EPA 624		3/13/12 13:19	MES	A
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 13:19	MES	A
Chlorobenzene	1.0U	ug/L		1.0	1.0	0.11	EPA 624		3/13/12 13:19	MES	A
Chlorodibromomethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 13:19	MES	A
Chloroethane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 13:19	MES	A
2-Chloroethylvinyl ether	2.0U	ug/L		2.0	2.0	0.28	EPA 624		3/13/12 13:19	MES	A
Chloroform	1.0U	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 13:19	MES	A
Chloromethane	1.0U	ug/L		1.0	1.0	0.25	EPA 624		3/13/12 13:19	MES	A
1,2-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.20	EPA 624		3/13/12 13:19	MES	A
1,3-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 13:19	MES	A
1,4-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 13:19	MES	A
1,1-Dichloroethane	0.50J	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 13:19	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 13:19	MES	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		3/13/12 13:19	MES	A
cis-1,2-Dichloroethene	0.34J	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 13:19	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 13:19	MES	A
1,2-Dichloropropane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 13:19	MES	A
cis-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 13:19	MES	A
trans-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 13:19	MES	A
1,3-Dichloropropene, Total	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 13:19	MES	A
Ethylbenzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 13:19	MES	A
Methylene Chloride	1.0U	ug/L		1.0	1.0	0.32	EPA 624		3/13/12 13:19	MES	A
1,1,2,2-Tetrachloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 13:19	MES	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 13:19	MES	A
Toluene	0.19J	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 13:19	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		3/13/12 13:19	MES	A
1,1,2-Trichloroethane	1.0U	ug/L		1.0	1.0	0.30	EPA 624		3/13/12 13:19	MES	A
Trichloroethene	0.67J	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 13:19	MES	A
Trichlorofluoromethane	1.0U	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 13:19	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		3/13/12 13:19	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	98.6	%		72-142			EPA 624		3/13/12 13:19	MES	A
4-Bromofluorobenzene (S)	91.9	%		73-119			EPA 624		3/13/12 13:19	MES	A
Dibromofluoromethane (S)	110	%		74-132			EPA 624		3/13/12 13:19	MES	A
Toluene-d8 (S)	111	%		75-133			EPA 624		3/13/12 13:19	MES	A

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: 9956129003	Date Collected: 3/7/2012 11:20	Matrix: Water
Sample ID: NWIRP-GM-38-GW-RW2-MW1-03072012	Date Received: 3/9/2012 08:50	

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
WET CHEMISTRY											
Total Suspended Solids	6	mg/L		5	5	5	SM20-2540 D		3/12/12 05:00	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	3/15/12	3/15/12 12:12	MNP	D1

Sample Comments:


Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife
United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York
Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: **9956129004** Date Collected: 3/7/2012 17:50 Matrix: Water
Sample ID: **NWIRP-GM-38-GW-RW3-MW1-03072012** Date Received: 3/9/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Acrolein	30.0U	ug/L		30.0	30.0	2.4	EPA 624		3/13/12 13:53	MES	A
Acrylonitrile	5.0U	ug/L		5.0	5.0	0.89	EPA 624		3/13/12 13:53	MES	A
Benzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 13:53	MES	A
Bromodichloromethane	1.0U	ug/L		1.0	1.0	0.13	EPA 624		3/13/12 13:53	MES	A
Bromoform	2.0U	ug/L		2.0	2.0	0.21	EPA 624		3/13/12 13:53	MES	A
Bromomethane	2.0U	ug/L		2.0	2.0	0.27	EPA 624		3/13/12 13:53	MES	A
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 13:53	MES	A
Chlorobenzene	1.0U	ug/L		1.0	1.0	0.11	EPA 624		3/13/12 13:53	MES	A
Chlorodibromomethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 13:53	MES	A
Chloroethane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 13:53	MES	A
2-Chloroethylvinyl ether	2.0U	ug/L		2.0	2.0	0.28	EPA 624		3/13/12 13:53	MES	A
Chloroform	1.0U	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 13:53	MES	A
Chloromethane	1.0U	ug/L		1.0	1.0	0.25	EPA 624		3/13/12 13:53	MES	A
1,2-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.20	EPA 624		3/13/12 13:53	MES	A
1,3-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 13:53	MES	A
1,4-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 13:53	MES	A
1,1-Dichloroethane	0.90J	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 13:53	MES	A
1,2-Dichloroethane	0.43J	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 13:53	MES	A
1,1-Dichloroethene	0.47J	ug/L		1.0	1.0	0.17	EPA 624		3/13/12 13:53	MES	A
cis-1,2-Dichloroethene	0.37J	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 13:53	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 13:53	MES	A
1,2-Dichloropropane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 13:53	MES	A
cis-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 13:53	MES	A
trans-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 13:53	MES	A
1,3-Dichloropropene, Total	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 13:53	MES	A
Ethylbenzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 13:53	MES	A
Methylene Chloride	1.0U	ug/L		1.0	1.0	0.32	EPA 624		3/13/12 13:53	MES	A
1,1,2,2-Tetrachloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 13:53	MES	A
Tetrachloroethene	1.0	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 13:53	MES	A
Toluene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 13:53	MES	A
1,1,1-Trichloroethane	0.58J	ug/L		1.0	1.0	0.27	EPA 624		3/13/12 13:53	MES	A
1,1,2-Trichloroethane	1.0U	ug/L		1.0	1.0	0.30	EPA 624		3/13/12 13:53	MES	A
Trichloroethene	59.0	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 13:53	MES	A
Trichlorofluoromethane	1.0U	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 13:53	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		3/13/12 13:53	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	98.9	%		72-142			EPA 624		3/13/12 13:53	MES	A
4-Bromofluorobenzene (S)	92.9	%		73-119			EPA 624		3/13/12 13:53	MES	A
Dibromofluoromethane (S)	110	%		74-132			EPA 624		3/13/12 13:53	MES	A
Toluene-d8 (S)	113	%		75-133			EPA 624		3/13/12 13:53	MES	A

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: 9956129004	Date Collected: 3/7/2012 17:50	Matrix: Water
Sample ID: NWIRP-GM-38-GW-RW3-MW1-03072012	Date Received: 3/9/2012 08:50	

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	3/15/12	3/15/12 12:13	MNP	D1

Sample Comments:

The TSS was run and this same sample was chosen to have a DUP run on it. The batch blank failed and the DUP failed therefore this sample would need to be reanalyzed, though no sample remained for reanalysis. Due to this, no TSS result was able to be provided for this sample. TMH 3/19/12


 Anna G Milliken
 Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
 Vancouver Waterloo · Winnipeg · Yellowknife
 United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York
 Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: **9956129005** Date Collected: 3/8/2012 12:15 Matrix: Water
Sample ID: **NWIRP-GM-38-GW-RW3-MW2-03082012** Date Received: 3/9/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Acrolein	30.0U	ug/L		30.0	30.0	2.4	EPA 624		3/13/12 14:26	MES	A
Acrylonitrile	5.0U	ug/L		5.0	5.0	0.89	EPA 624		3/13/12 14:26	MES	A
Benzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 14:26	MES	A
Bromodichloromethane	1.0U	ug/L		1.0	1.0	0.13	EPA 624		3/13/12 14:26	MES	A
Bromoform	2.0U	ug/L		2.0	2.0	0.21	EPA 624		3/13/12 14:26	MES	A
Bromomethane	2.0U	ug/L		2.0	2.0	0.27	EPA 624		3/13/12 14:26	MES	A
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 14:26	MES	A
Chlorobenzene	1.0U	ug/L		1.0	1.0	0.11	EPA 624		3/13/12 14:26	MES	A
Chlorodibromomethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 14:26	MES	A
Chloroethane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 14:26	MES	A
2-Chloroethylvinyl ether	2.0U	ug/L		2.0	2.0	0.28	EPA 624		3/13/12 14:26	MES	A
Chloroform	1.0U	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 14:26	MES	A
Chloromethane	1.0U	ug/L		1.0	1.0	0.25	EPA 624		3/13/12 14:26	MES	A
1,2-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.20	EPA 624		3/13/12 14:26	MES	A
1,3-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 14:26	MES	A
1,4-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 14:26	MES	A
1,1-Dichloroethane	0.41J	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 14:26	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 14:26	MES	A
1,1-Dichloroethene	0.27J	ug/L		1.0	1.0	0.17	EPA 624		3/13/12 14:26	MES	A
cis-1,2-Dichloroethene	1.3	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 14:26	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 14:26	MES	A
1,2-Dichloropropane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 14:26	MES	A
cis-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 14:26	MES	A
trans-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 14:26	MES	A
1,3-Dichloropropene, Total	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 14:26	MES	A
Ethylbenzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 14:26	MES	A
Methylene Chloride	1.0U	ug/L		1.0	1.0	0.32	EPA 624		3/13/12 14:26	MES	A
1,1,2,2-Tetrachloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 14:26	MES	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 14:26	MES	A
Toluene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 14:26	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		3/13/12 14:26	MES	A
1,1,2-Trichloroethane	0.32J	ug/L		1.0	1.0	0.30	EPA 624		3/13/12 14:26	MES	A
Trichloroethene	96.5	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 14:26	MES	A
Trichlorofluoromethane	1.0U	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 14:26	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		3/13/12 14:26	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	99.7	%		72-142			EPA 624		3/13/12 14:26	MES	A
4-Bromofluorobenzene (S)	91.5	%		73-119			EPA 624		3/13/12 14:26	MES	A
Dibromofluoromethane (S)	109	%		74-132			EPA 624		3/13/12 14:26	MES	A
Toluene-d8 (S)	113	%		75-133			EPA 624		3/13/12 14:26	MES	A

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: 9956129005	Date Collected: 3/8/2012 12:15	Matrix: Water
Sample ID: NWIRP-GM-38-GW-RW3-MW2-03082012	Date Received: 3/9/2012 08:50	

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
WET CHEMISTRY											
Total Suspended Solids	8	mg/L		5	5	5	SM20-2540 D		3/14/12 05:00	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	3/15/12	3/15/12 12:14	MNP	D1

Sample Comments:


Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife
United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York
Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: **9956129006** Date Collected: 3/7/2012 14:45 Matrix: Water
Sample ID: **NWIRP-GM-38-GW-RW3-MW3-03072012** Date Received: 3/9/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Acrolein	30.0U	ug/L		30.0	30.0	2.4	EPA 624		3/13/12 16:07	MES	A
Acrylonitrile	5.0U	ug/L		5.0	5.0	0.89	EPA 624		3/13/12 16:07	MES	A
Benzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 16:07	MES	A
Bromodichloromethane	1.0U	ug/L		1.0	1.0	0.13	EPA 624		3/13/12 16:07	MES	A
Bromoform	2.0U	ug/L		2.0	2.0	0.21	EPA 624		3/13/12 16:07	MES	A
Bromomethane	2.0U	ug/L		2.0	2.0	0.27	EPA 624		3/13/12 16:07	MES	A
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 16:07	MES	A
Chlorobenzene	1.0U	ug/L		1.0	1.0	0.11	EPA 624		3/13/12 16:07	MES	A
Chlorodibromomethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 16:07	MES	A
Chloroethane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 16:07	MES	A
2-Chloroethylvinyl ether	2.0U	ug/L	1,2	2.0	2.0	0.28	EPA 624		3/13/12 16:07	MES	A
Chloroform	0.42J	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 16:07	MES	A
Chloromethane	1.0U	ug/L		1.0	1.0	0.25	EPA 624		3/13/12 16:07	MES	A
1,2-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.20	EPA 624		3/13/12 16:07	MES	A
1,3-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 16:07	MES	A
1,4-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 16:07	MES	A
1,1-Dichloroethane	3.3	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 16:07	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 16:07	MES	A
1,1-Dichloroethene	1.9	ug/L		1.0	1.0	0.17	EPA 624		3/13/12 16:07	MES	A
cis-1,2-Dichloroethene	2.1	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 16:07	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 16:07	MES	A
1,2-Dichloropropane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 16:07	MES	A
cis-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 16:07	MES	A
trans-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 16:07	MES	A
1,3-Dichloropropene, Total	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 16:07	MES	A
Ethylbenzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 16:07	MES	A
Methylene Chloride	1.0U	ug/L		1.0	1.0	0.32	EPA 624		3/13/12 16:07	MES	A
1,1,2,2-Tetrachloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 16:07	MES	A
Tetrachloroethene	0.72J	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 16:07	MES	A
Toluene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 16:07	MES	A
1,1,1-Trichloroethane	0.84J	ug/L		1.0	1.0	0.27	EPA 624		3/13/12 16:07	MES	A
1,1,2-Trichloroethane	1.0U	ug/L		1.0	1.0	0.30	EPA 624		3/13/12 16:07	MES	A
Trichloroethene	312	ug/L		5.0	5.0	1.1	EPA 624		3/14/12 11:50	MES	G
Trichlorofluoromethane	1.0U	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 16:07	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		3/13/12 16:07	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	101	%		72-142			EPA 624		3/13/12 16:07	MES	A
4-Bromofluorobenzene (S)	94.6	%		73-119			EPA 624		3/13/12 16:07	MES	A
Dibromofluoromethane (S)	109	%		74-132			EPA 624		3/13/12 16:07	MES	A
Toluene-d8 (S)	114	%		75-133			EPA 624		3/13/12 16:07	MES	A

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: **9956129006** Date Collected: 3/7/2012 14:45 Matrix: Water
 Sample ID: **NWIRP-GM-38-GW-RW3-MW3-03072012** Date Received: 3/9/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
1,2-Dichloroethane-d4 (S)	101	%		72-142			EPA 624		3/14/12 11:50	MES	G
4-Bromofluorobenzene (S)	99.4	%		73-119			EPA 624		3/14/12 11:50	MES	G
Dibromofluoromethane (S)	108	%		74-132			EPA 624		3/14/12 11:50	MES	G
Toluene-d8 (S)	118	%		75-133			EPA 624		3/14/12 11:50	MES	G

WET CHEMISTRY

Total Suspended Solids 5U mg/L 5 5 5 SM20-2540 D 3/14/12 05:00 OA M

METALS

Mercury, Total 0.00050 mg/L 0.00050 0.00050 0.00016 EPA 245.1 3/15/12 3/15/12 12:15 MNP J1
 U

Sample Comments:


 Anna G Milliken
 Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
 Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: **9956129007** Date Collected: 3/7/2012 13:15 Matrix: Water
Sample ID: **NWIRP-GM-38-GW-RW3-MW4-03072012** Date Received: 3/9/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Acrolein	30.0U	ug/L		30.0	30.0	2.4	EPA 624		3/13/12 15:00	MES	A
Acrylonitrile	5.0U	ug/L		5.0	5.0	0.89	EPA 624		3/13/12 15:00	MES	A
Benzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 15:00	MES	A
Bromodichloromethane	1.0U	ug/L		1.0	1.0	0.13	EPA 624		3/13/12 15:00	MES	A
Bromoform	2.0U	ug/L		2.0	2.0	0.21	EPA 624		3/13/12 15:00	MES	A
Bromomethane	2.0U	ug/L		2.0	2.0	0.27	EPA 624		3/13/12 15:00	MES	A
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 15:00	MES	A
Chlorobenzene	1.0U	ug/L		1.0	1.0	0.11	EPA 624		3/13/12 15:00	MES	A
Chlorodibromomethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 15:00	MES	A
Chloroethane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 15:00	MES	A
2-Chloroethylvinyl ether	2.0U	ug/L		2.0	2.0	0.28	EPA 624		3/13/12 15:00	MES	A
Chloroform	0.38J	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 15:00	MES	A
Chloromethane	1.0U	ug/L		1.0	1.0	0.25	EPA 624		3/13/12 15:00	MES	A
1,2-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.20	EPA 624		3/13/12 15:00	MES	A
1,3-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 15:00	MES	A
1,4-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 15:00	MES	A
1,1-Dichloroethane	1.8	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 15:00	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 15:00	MES	A
1,1-Dichloroethene	0.21J	ug/L		1.0	1.0	0.17	EPA 624		3/13/12 15:00	MES	A
cis-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 15:00	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 15:00	MES	A
1,2-Dichloropropane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 15:00	MES	A
cis-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 15:00	MES	A
trans-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 15:00	MES	A
1,3-Dichloropropene, Total	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 15:00	MES	A
Ethylbenzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 15:00	MES	A
Methylene Chloride	1.0U	ug/L		1.0	1.0	0.32	EPA 624		3/13/12 15:00	MES	A
1,1,2,2-Tetrachloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 15:00	MES	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 15:00	MES	A
Toluene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 15:00	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		3/13/12 15:00	MES	A
1,1,2-Trichloroethane	1.0U	ug/L		1.0	1.0	0.30	EPA 624		3/13/12 15:00	MES	A
Trichloroethene	4.6	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 15:00	MES	A
Trichlorofluoromethane	1.0U	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 15:00	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		3/13/12 15:00	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	101	%		72-142			EPA 624		3/13/12 15:00	MES	A
4-Bromofluorobenzene (S)	92.2	%		73-119			EPA 624		3/13/12 15:00	MES	A
Dibromofluoromethane (S)	110	%		74-132			EPA 624		3/13/12 15:00	MES	A
Toluene-d8 (S)	113	%		75-133			EPA 624		3/13/12 15:00	MES	A

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: **9956129007** Date Collected: 3/7/2012 13:15 Matrix: Water
Sample ID: **NWIRP-GM-38-GW-RW3-MW4-03072012** Date Received: 3/9/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
WET CHEMISTRY											
Total Suspended Solids	5	mg/L		5	5	5	SM20-2540 D		3/14/12 05:00	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	3/15/12	3/15/12 12:20	MNP	D1

Sample Comments:



Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: **9956129008** Date Collected: 3/8/2012 09:00 Matrix: Water
Sample ID: **NWIRP-GM-38-GW-TP1-03082012** Date Received: 3/9/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Acrolein	30.0U	ug/L		30.0	30.0	2.4	EPA 624		3/13/12 15:34	MES	A
Acrylonitrile	5.0U	ug/L		5.0	5.0	0.89	EPA 624		3/13/12 15:34	MES	A
Benzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 15:34	MES	A
Bromodichloromethane	1.0U	ug/L		1.0	1.0	0.13	EPA 624		3/13/12 15:34	MES	A
Bromoform	2.0U	ug/L		2.0	2.0	0.21	EPA 624		3/13/12 15:34	MES	A
Bromomethane	2.0U	ug/L		2.0	2.0	0.27	EPA 624		3/13/12 15:34	MES	A
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 15:34	MES	A
Chlorobenzene	1.0U	ug/L		1.0	1.0	0.11	EPA 624		3/13/12 15:34	MES	A
Chlorodibromomethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 15:34	MES	A
Chloroethane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 15:34	MES	A
2-Chloroethylvinyl ether	2.0U	ug/L		2.0	2.0	0.28	EPA 624		3/13/12 15:34	MES	A
Chloroform	0.74J	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 15:34	MES	A
Chloromethane	1.0U	ug/L		1.0	1.0	0.25	EPA 624		3/13/12 15:34	MES	A
1,2-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.20	EPA 624		3/13/12 15:34	MES	A
1,3-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 15:34	MES	A
1,4-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 15:34	MES	A
1,1-Dichloroethane	3.7	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 15:34	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 15:34	MES	A
1,1-Dichloroethene	1.2	ug/L		1.0	1.0	0.17	EPA 624		3/13/12 15:34	MES	A
cis-1,2-Dichloroethene	53.3	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 15:34	MES	A
trans-1,2-Dichloroethene	0.87J	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 15:34	MES	A
1,2-Dichloropropane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 15:34	MES	A
cis-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 15:34	MES	A
trans-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 15:34	MES	A
1,3-Dichloropropene, Total	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 15:34	MES	A
Ethylbenzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 15:34	MES	A
Methylene Chloride	1.0U	ug/L		1.0	1.0	0.32	EPA 624		3/13/12 15:34	MES	A
1,1,2,2-Tetrachloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 15:34	MES	A
Tetrachloroethene	4.7	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 15:34	MES	A
Toluene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 15:34	MES	A
1,1,1-Trichloroethane	0.57J	ug/L		1.0	1.0	0.27	EPA 624		3/13/12 15:34	MES	A
1,1,2-Trichloroethane	1.0U	ug/L		1.0	1.0	0.30	EPA 624		3/13/12 15:34	MES	A
Trichloroethene	38.1	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 15:34	MES	A
Trichlorofluoromethane	1.0U	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 15:34	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		3/13/12 15:34	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	100	%		72-142			EPA 624		3/13/12 15:34	MES	A
4-Bromofluorobenzene (S)	91.8	%		73-119			EPA 624		3/13/12 15:34	MES	A
Dibromofluoromethane (S)	110	%		74-132			EPA 624		3/13/12 15:34	MES	A
Toluene-d8 (S)	109	%		75-133			EPA 624		3/13/12 15:34	MES	A

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: **9956129008** Date Collected: 3/8/2012 09:00 Matrix: Water
 Sample ID: **NWIRP-GM-38-GW-TP1-03082012** Date Received: 3/9/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
WET CHEMISTRY											
Total Suspended Solids	7	mg/L		5	5	5	SM20-2540 D		3/14/12 05:00	OA	E
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	3/15/12	3/15/12 12:21	MNP	D1

Sample Comments:


 Anna G Milliken
 Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
 Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: **9956129009** Date Collected: 3/7/2012 14:45 Matrix: Water
Sample ID: **NWIRP-GM-38-GW-RW3-MW3-03072012D** Date Received: 3/9/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Acrolein	30.0U	ug/L		30.0	30.0	2.4	EPA 624		3/13/12 16:41	MES	A
Acrylonitrile	5.0U	ug/L		5.0	5.0	0.89	EPA 624		3/13/12 16:41	MES	A
Benzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 16:41	MES	A
Bromodichloromethane	1.0U	ug/L		1.0	1.0	0.13	EPA 624		3/13/12 16:41	MES	A
Bromoform	2.0U	ug/L		2.0	2.0	0.21	EPA 624		3/13/12 16:41	MES	A
Bromomethane	2.0U	ug/L		2.0	2.0	0.27	EPA 624		3/13/12 16:41	MES	A
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 16:41	MES	A
Chlorobenzene	1.0U	ug/L		1.0	1.0	0.11	EPA 624		3/13/12 16:41	MES	A
Chlorodibromomethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 16:41	MES	A
Chloroethane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 16:41	MES	A
2-Chloroethylvinyl ether	2.0U	ug/L		2.0	2.0	0.28	EPA 624		3/13/12 16:41	MES	A
Chloroform	0.42J	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 16:41	MES	A
Chloromethane	1.0U	ug/L		1.0	1.0	0.25	EPA 624		3/13/12 16:41	MES	A
1,2-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.20	EPA 624		3/13/12 16:41	MES	A
1,3-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 16:41	MES	A
1,4-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 16:41	MES	A
1,1-Dichloroethane	3.3	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 16:41	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 16:41	MES	A
1,1-Dichloroethene	1.9	ug/L		1.0	1.0	0.17	EPA 624		3/13/12 16:41	MES	A
cis-1,2-Dichloroethene	2.1	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 16:41	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 16:41	MES	A
1,2-Dichloropropane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 16:41	MES	A
cis-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 16:41	MES	A
trans-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 16:41	MES	A
1,3-Dichloropropene, Total	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 16:41	MES	A
Ethylbenzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 16:41	MES	A
Methylene Chloride	1.0U	ug/L		1.0	1.0	0.32	EPA 624		3/13/12 16:41	MES	A
1,1,2,2-Tetrachloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 16:41	MES	A
Tetrachloroethene	0.69J	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 16:41	MES	A
Toluene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 16:41	MES	A
1,1,1-Trichloroethane	0.87J	ug/L		1.0	1.0	0.27	EPA 624		3/13/12 16:41	MES	A
1,1,2-Trichloroethane	1.0U	ug/L		1.0	1.0	0.30	EPA 624		3/13/12 16:41	MES	A
Trichloroethene	325	ug/L		5.0	5.0	1.1	EPA 624		3/14/12 12:23	MES	B
Trichlorofluoromethane	1.0U	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 16:41	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		3/13/12 16:41	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	101	%		72-142			EPA 624		3/13/12 16:41	MES	A
4-Bromofluorobenzene (S)	93.6	%		73-119			EPA 624		3/13/12 16:41	MES	A
Dibromofluoromethane (S)	110	%		74-132			EPA 624		3/13/12 16:41	MES	A
Toluene-d8 (S)	113	%		75-133			EPA 624		3/13/12 16:41	MES	A

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: **9956129009** Date Collected: 3/7/2012 14:45 Matrix: Water
Sample ID: **NWIRP-GM-38-GW-RW3-MW3-03072012D** Date Received: 3/9/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
1,2-Dichloroethane-d4 (S)	102	%		72-142			EPA 624		3/14/12 12:23	MES	B
4-Bromofluorobenzene (S)	97.9	%		73-119			EPA 624		3/14/12 12:23	MES	B
Dibromofluoromethane (S)	110	%		74-132			EPA 624		3/14/12 12:23	MES	B
Toluene-d8 (S)	118	%		75-133			EPA 624		3/14/12 12:23	MES	B

WET CHEMISTRY

Total Suspended Solids 5U mg/L 5 5 5 SM20-2540 D 3/14/12 05:00 OA E

METALS

Mercury, Total 0.00050 mg/L 0.00050 0.00050 0.00016 EPA 245.1 3/15/12 3/15/12 12:22 MNP D1
U

Sample Comments:

Anna G Milliken
Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: **9956129010** Date Collected: 3/7/2012 18:50 Matrix: Water
Sample ID: **NWIRP-GM-38-FB-03072012** Date Received: 3/9/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Acrolein	30.0U	ug/L		30.0	30.0	2.4	EPA 624		3/13/12 10:34	MES	A
Acrylonitrile	5.0U	ug/L		5.0	5.0	0.89	EPA 624		3/13/12 10:34	MES	A
Benzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 10:34	MES	A
Bromodichloromethane	1.0U	ug/L		1.0	1.0	0.13	EPA 624		3/13/12 10:34	MES	A
Bromoform	2.0U	ug/L		2.0	2.0	0.21	EPA 624		3/13/12 10:34	MES	A
Bromomethane	2.0U	ug/L		2.0	2.0	0.27	EPA 624		3/13/12 10:34	MES	A
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 10:34	MES	A
Chlorobenzene	1.0U	ug/L		1.0	1.0	0.11	EPA 624		3/13/12 10:34	MES	A
Chlorodibromomethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 10:34	MES	A
Chloroethane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 10:34	MES	A
2-Chloroethylvinyl ether	2.0U	ug/L		2.0	2.0	0.28	EPA 624		3/13/12 10:34	MES	A
Chloroform	1.0U	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 10:34	MES	A
Chloromethane	1.0U	ug/L		1.0	1.0	0.25	EPA 624		3/13/12 10:34	MES	A
1,2-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.20	EPA 624		3/13/12 10:34	MES	A
1,3-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 10:34	MES	A
1,4-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 10:34	MES	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 10:34	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 10:34	MES	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		3/13/12 10:34	MES	A
cis-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 10:34	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 10:34	MES	A
1,2-Dichloropropane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 10:34	MES	A
cis-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 10:34	MES	A
trans-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 10:34	MES	A
1,3-Dichloropropene, Total	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 10:34	MES	A
Ethylbenzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 10:34	MES	A
Methylene Chloride	1.0U	ug/L		1.0	1.0	0.32	EPA 624		3/13/12 10:34	MES	A
1,1,2,2-Tetrachloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 10:34	MES	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 10:34	MES	A
Toluene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 10:34	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		3/13/12 10:34	MES	A
1,1,2-Trichloroethane	1.0U	ug/L		1.0	1.0	0.30	EPA 624		3/13/12 10:34	MES	A
Trichloroethene	1.0U	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 10:34	MES	A
Trichlorofluoromethane	1.0U	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 10:34	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		3/13/12 10:34	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	98.7	%		72-142			EPA 624		3/13/12 10:34	MES	A
4-Bromofluorobenzene (S)	95.2	%		73-119			EPA 624		3/13/12 10:34	MES	A
Dibromofluoromethane (S)	108	%		74-132			EPA 624		3/13/12 10:34	MES	A
Toluene-d8 (S)	114	%		75-133			EPA 624		3/13/12 10:34	MES	A

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: **9956129010** Date Collected: 3/7/2012 18:50 Matrix: Water
 Sample ID: **NWIRP-GM-38-FB-03072012** Date Received: 3/9/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
METALS											
Mercury, Total	0.00050 U	mg/L		0.00050	0.00050	0.00016	EPA 245.1	3/15/12	3/15/12 12:23	MNP	D1

Sample Comments:


 Anna G Milliken
 Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
 Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: **9956129011** Date Collected: 3/9/2012 08:50 Matrix: Water
Sample ID: **NWIRP-GM-38-TB-03072012** Date Received: 3/9/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
VOLATILE ORGANICS											
Acrolein	30.0U	ug/L		30.0	30.0	2.4	EPA 624		3/13/12 10:01	MES	A
Acrylonitrile	5.0U	ug/L		5.0	5.0	0.89	EPA 624		3/13/12 10:01	MES	A
Benzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 10:01	MES	A
Bromodichloromethane	1.0U	ug/L		1.0	1.0	0.13	EPA 624		3/13/12 10:01	MES	A
Bromoform	2.0U	ug/L		2.0	2.0	0.21	EPA 624		3/13/12 10:01	MES	A
Bromomethane	2.0U	ug/L		2.0	2.0	0.27	EPA 624		3/13/12 10:01	MES	A
Carbon Tetrachloride	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 10:01	MES	A
Chlorobenzene	1.0U	ug/L		1.0	1.0	0.11	EPA 624		3/13/12 10:01	MES	A
Chlorodibromomethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 10:01	MES	A
Chloroethane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 10:01	MES	A
2-Chloroethylvinyl ether	2.0U	ug/L		2.0	2.0	0.28	EPA 624		3/13/12 10:01	MES	A
Chloroform	1.0U	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 10:01	MES	A
Chloromethane	1.0U	ug/L		1.0	1.0	0.25	EPA 624		3/13/12 10:01	MES	A
1,2-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.20	EPA 624		3/13/12 10:01	MES	A
1,3-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 10:01	MES	A
1,4-Dichlorobenzene	1.0U	ug/L		1.0	1.0	0.15	EPA 624		3/13/12 10:01	MES	A
1,1-Dichloroethane	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 10:01	MES	A
1,2-Dichloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 10:01	MES	A
1,1-Dichloroethene	1.0U	ug/L		1.0	1.0	0.17	EPA 624		3/13/12 10:01	MES	A
cis-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 10:01	MES	A
trans-1,2-Dichloroethene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 10:01	MES	A
1,2-Dichloropropane	1.0U	ug/L		1.0	1.0	0.24	EPA 624		3/13/12 10:01	MES	A
cis-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 10:01	MES	A
trans-1,3-Dichloropropene	1.0U	ug/L		1.0	1.0	0.14	EPA 624		3/13/12 10:01	MES	A
1,3-Dichloropropene, Total	1.0U	ug/L		1.0	1.0	0.19	EPA 624		3/13/12 10:01	MES	A
Ethylbenzene	1.0U	ug/L		1.0	1.0	0.16	EPA 624		3/13/12 10:01	MES	A
Methylene Chloride	1.0U	ug/L		1.0	1.0	0.32	EPA 624		3/13/12 10:01	MES	A
1,1,2,2-Tetrachloroethane	1.0U	ug/L		1.0	1.0	0.22	EPA 624		3/13/12 10:01	MES	A
Tetrachloroethene	1.0U	ug/L		1.0	1.0	0.26	EPA 624		3/13/12 10:01	MES	A
Toluene	1.0U	ug/L		1.0	1.0	0.12	EPA 624		3/13/12 10:01	MES	A
1,1,1-Trichloroethane	1.0U	ug/L		1.0	1.0	0.27	EPA 624		3/13/12 10:01	MES	A
1,1,2-Trichloroethane	1.0U	ug/L		1.0	1.0	0.30	EPA 624		3/13/12 10:01	MES	A
Trichloroethene	1.0U	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 10:01	MES	A
Trichlorofluoromethane	1.0U	ug/L		1.0	1.0	0.21	EPA 624		3/13/12 10:01	MES	A
Vinyl Chloride	2.0U	ug/L		2.0	2.0	0.24	EPA 624		3/13/12 10:01	MES	A
<i>Surrogate Recoveries</i>	<i>Results</i>	<i>Units</i>	<i>Footnotes</i>	<i>Limits</i>			<i>Method</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>By</i>	<i>Cntr</i>
1,2-Dichloroethane-d4 (S)	102	%		72-142			EPA 624		3/13/12 10:01	MES	A
4-Bromofluorobenzene (S)	97.7	%		73-119			EPA 624		3/13/12 10:01	MES	A
Dibromofluoromethane (S)	111	%		74-132			EPA 624		3/13/12 10:01	MES	A
Toluene-d8 (S)	114	%		75-133			EPA 624		3/13/12 10:01	MES	A

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS

Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

Lab ID: **9956129011** Date Collected: 3/9/2012 08:50 Matrix: Water
 Sample ID: **NWIRP-GM-38-TB-03072012** Date Received: 3/9/2012 08:50

Parameters	Results	Units	Footnotes	LOQ	LOD	DL	Method	Prepared	Analyzed	By	Cntr
------------	---------	-------	-----------	-----	-----	----	--------	----------	----------	----	------

Sample Comments:


 Anna G Milliken
 Technical Manager

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
 Vancouver Waterloo · Winnipeg · Yellowknife United States: Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York Mexico: Monterrey

ANALYTICAL RESULTS QUALIFIERS/FLAGS


Workorder: 9956129 HNW041|NWIRP Bethpage - GM-38

PARAMETER QUALIFIERS/FLAGS

- [1] The QC sample type MS for method EPA 624 was outside the control limits for the analyte 2-Chloroethylvinyl ether. The % Recovery was reported as 0 and the control limits were 1 to 305.
- [2] The QC sample type MSD for method EPA 624 was outside the control limits for the analyte 2-Chloroethylvinyl ether. The % Recovery was reported as 0 and the control limits were 1 to 305.

ALS Environmental Laboratory Locations Across North America

Canada: Burlington · Calgary · Centre of Excellence · Edmonton · Fort McMurray · Fort St. John · Grande Prairie · London · Mississauga · Richmond Hill · Saskatoon · Thunder Bay
Vancouver Waterloo · Winnipeg · Yellowknife **United States:** Cincinnati · Everett · Fort Collins · Holland · Houston · Middletown · Salt Lake City · Spring City · York **Mexico:** Monterrey



Page 1 of 2
 Courier:
 Tracking #: 8705 2403
69160

CHAIN OF CUSTODY/ REQUEST FOR ANALYSIS

ALL SHADED AREAS MUST BE COMPLETED BY THE
 CLIENT / SAMPLER. INSTRUCTIONS ON THE BACK.

**Analytical
 Laboratory Services, Inc.**
 Environmental • Industrial Hygiene • Field Services

34 Dogwood Lane • Middletown, PA 17057 • 717-944-5541 • Fax: 717-944-1430

Co. Name: **H&S Environmental, Inc.**

Contact (Reports): **Jen Good**
 Address: **160 E. Main St., Suite 2F**
Westborough, MA 01581

Phone: **508.366.7442**

Bill to (if different than Report to):

Same

PO#: **2031-005**

ALS Quote #:

Project Name#: **NWIRP Bethpage GM-38 Crty LTM**

TAT: Normal-Standard TAT is 10-12 business days.
 Rush-Subject to ALSI approval and surcharges.

Email? Y N
 Fax? Y N

Sample Description/Location <small>(as it will appear on the lab report)</small>	COC Comments	Sample Date	Military Time
1 NWIRP-GM-38-GW-RW1-MW1-MSMSD for VOCs Hg		3/8/12	1105
2 NWIRP-GM-38-GW-RW1-MW3-03062012		3/8/12	1330
3 NWIRP-GM-38-GW-RW2-MW1-03072012		3/7/12	1120
4 NWIRP-GM-38-GW-RW3-MW1-03072012		3/7/12	1750
5 NWIRP-GM-38-GW-RW3-MW2-03082012		3/8/12	1215
6 NWIRP-GM-38-GW-RW3-MW3-03072012 <small>for VOCs Hg</small>		3/7/12	1445
7 NWIRP-GM-38-GW-RW3-MW4-03072012		3/7/12	1315
8 NWIRP-GM-38-GW-TP1-03082012		3/8/12	0900

Container in good condition?	COC Labels complete/accurate?	Received on ice?	Correct sample volume?	Correct preservation?	Headspace/Volatiles?
<input checked="" type="checkbox"/> Y	<input checked="" type="checkbox"/> Y	<input checked="" type="checkbox"/> Y	<input checked="" type="checkbox"/> Y	<input checked="" type="checkbox"/> Y	<input checked="" type="checkbox"/> Y
<input type="checkbox"/> N	<input type="checkbox"/> N	<input type="checkbox"/> N	<input type="checkbox"/> N	<input type="checkbox"/> N	<input type="checkbox"/> N

Container in good condition?	COC Labels complete/accurate?	Received on ice?	Correct sample volume?	Correct preservation?	Headspace/Volatiles?
<input checked="" type="checkbox"/> Y	<input checked="" type="checkbox"/> Y	<input checked="" type="checkbox"/> Y	<input checked="" type="checkbox"/> Y	<input checked="" type="checkbox"/> Y	<input checked="" type="checkbox"/> Y
<input type="checkbox"/> N	<input type="checkbox"/> N	<input type="checkbox"/> N	<input type="checkbox"/> N	<input type="checkbox"/> N	<input type="checkbox"/> N

State Samples Collected In?	SWA Form?	Standard	Deliverables	Data
<input type="checkbox"/> NY <input type="checkbox"/> NJ <input checked="" type="checkbox"/> NY <input type="checkbox"/> PA	<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> CLP-like <input type="checkbox"/> NJ-Reduced <input type="checkbox"/> NJ-Full	<input type="checkbox"/> FPM, Instrument <input type="checkbox"/> EPCO <input type="checkbox"/> PWSID	<input type="checkbox"/> YES <input type="checkbox"/> NO <input type="checkbox"/> YES <input type="checkbox"/> NO

Relinquished By / Company Name	Date	Time	Received By / Company Name	Date	Time
Stacey Lee	3/8/12	1500	AS	3/9/12	1111

LOGGED BY (signature):
 REVIEWED BY (signature):
 Date: 3/8/12 1500
 Time: 1500
 Received By / Company Name: AS
 Date: 3/9/12 1111
 Time: 1111

SAMPLED BY (Please Print):
 Stacey Lee

ANALYSES/METHOD REQUESTED

Container Type	Container Size	Preservative	Matrix	Enter Number of Containers Per Analysis
40 mL	500 mL	250 mL	TCL VOCs (Method 624)	3
CG	PL	PL	Mercury (Method 245.1)	1
HCL	HNO3	--	TSS (SM2540D)	1

Notes:

Completed by:
 Performed by:
 Cooler Temp: 30
 Therm. ID: THAS
 No. of Coolers:

Container in good condition? Y N
 COC Labels complete/accurate? Y N
 Received on ice? Y N
 Correct sample volume? Y N
 Correct preservation? Y N
 Headspace/Volatiles? Y N

Custom seals Present? Y N

(if present) Seals intact? Y N

ALSI FIELD SERVICES
 Repair
 Labor
 Composite Sampling
 Rental Equipment
 Other

SWA Form? YES NO
 Standard CLP-like NJ-Reduced NJ-Full
 Deliverables FPM, Instrument EPCO PWSID
 Data YES NO YES NO

Relinquished By / Company Name: Stacey Lee
 Date: 3/8/12 1500
 Time: 1500
 Received By / Company Name: AS
 Date: 3/9/12 1111
 Time: 1111

LOGGED BY (signature):
 REVIEWED BY (signature):

SAMPLED BY (Please Print):
 Stacey Lee

Matrix: Air-Air, DW=Drinking Water, GW=Groundwater, Oil-Oil, OL=Other Liquid, SL=Sludge, SO=Soil, WP=Wipo, WW=Wastewater
 Container Type: AG-Amber Glass, CG-Clear Glass, PL-Plastic. Container Size: 250ml, 500ml, 1L, 8oz., etc. Preservative: HCl, HNO3, NaOH, etc.

Copies: WHITE - ORIGINAL CANARY - CUSTOMER COPY

Ref: 08-008

ALS Environmental Laboratory Locations Across North America

Canada: Burlington • Calgary • Centre of Excellence • Edmonton • Fort McMurray • Fort St. John • Grande Prairie • London • Mississauga • Richmond Hill • Saskatoon • Thunder Bay
 Vancouver Waterloo • Winnipeg • Yellowknife United States: Cincinnati • Everett • Fort Collins • Holland • Houston • Middletown • Salt Lake City • Spring City • York Mexico: Monterrey

Analytical Laboratory Services, Inc.
 Environmental • Industrial Hygiene • Field Services
 34 Dogwood Lane • Middletown, PA 17057 • 717-944-5541 • Fax: 717-944-1430

Co. Name: H&S Environmental, Inc.
Contact (Report to): Jen Good
Address: 160 E. Main St., Suite 2F
 Westborough, MA 01581

Phone: 508-366-7442
PO#: 2031-405

Project Name#: NWIRP Bethpage GM-38 Ctry LTM
ALSI Quote #:

TAT: Normal-Standard TAT is 10-12 business days.
 Rush-Subject to ALSI approval and surcharges.

Envi#: Y N
Fac#: Y N

CHAIN OF CUSTODY/ REQUEST FOR ANALYSIS
ALL SHADED AREAS MUST BE COMPLETED BY THE CLIENT / SAMPLER. INSTRUCTIONS ON THE BACK.

Containers: 40 mL, 500 mL, 250 mL
Type: CG, PL, PL
CG: HCL, HNO3
Preservative:

ANALYSES/METHOD REQUESTED

Matrix	TCL VOCs (Method 624)	Mercury (Method 245.1)	TSS (SM2640D)
G GW	3	1	1
G GW	3	1	
G GW	3		
G GW			
G GW			
G GW			
G GW			
G GW			

Enter Number of Containers Per Analysis

Receipt Information
 Completed by: MM
 Performed by: MM
 Cooler Temp: 30
 Therm. ID: TH215
 No. of Coolers:
 Notes:

Correct Containers? Y N
Correct sample volume? Y N
Received on ice? Y N
COC/Labels complete/accurate? Y N
Container in good condition? Y N

ALS FIELD SERVICES
 Reqs
 Labor
 Comps Sampling
 Seal Equipment
 Other

LOGGED BY (Signature): [Signature] **Date:** 3/5/12 **Time:** 11:00

REVIEWED BY (Signature): [Signature] **Date:** 3/5/12 **Time:** 11:00

Relinquished By / Company Name	Date	Time	Received By / Company Name	Date	Time
	2	11:00	AS	3/5/12	08:50
	4				
	6				
	8				
	10				

DELIVERABLES
 Standard
 QLP-like
 NU-Reduced
 NU-Full
 Other

State Samples Collected In?
 MD
 NJ
 NY
 PA

SWA Filter? Yes No
Deliverables Yes No
ECOS Required? Yes No
1000 Check Required? Yes No

Matrix: Air-Air; DW-Drinking Water; GW-Groundwater; GI-Oil; OL-Other Liquid; SL-Sludge; SO-Soil; WP-Water; WW-Wastewater
Container Type: AC-Amber Glass; CG-Clear Glass; PL-Plastic. Container Size: 250ml, 500ml, 1L, 500ml, 1L, 500ml, etc. Preservative: HCl, HNO3, NaOH, etc.

ALS Environmental Laboratory Locations Across North America

Canada: Burlington • Calgary • Centre of Excellence • Edmonton • Fort McMurray • Fort St. John • Grande Prairie • London • Mississauga • Richmond Hill • Saskatoon • Thunder Bay
 Vancouver Waterloo • Winnipeg • Yellowknife United States: Cincinnati • Everett • Fort Collins • Holland • Houston • Middletown • Salt Lake City • Spring City • York Mexico: Monterrey