

Mr. Jason Pelton
Project Manager
New York State Department of Environmental Conservation
Remedial Bureau D
625 Broadway
Albany, New York 12233-7015

Arcadis of New York, Inc.
Two Huntington Quadrangle
Suite 1S10
Melville
New York 11747
Tel 631 249 7600
Fax 631 249 7610
www.arcadis.com

Subject:
Results of Second Quarter 2017 System Operation and Monitoring,
Bethpage Park Groundwater Containment System (BPGWCS),
Operable Unit 3 (OU3; Former Grumman Settling Ponds),
Bethpage, New York, NYSDEC Site #1-30-003A

ENVIRONMENT

Date:
August 24, 2017

Contact:
David E. Stern

Dear Jason:

Enclosed is one electronic PDF copy of the second quarter results of the OU3 BPGWCS operation and monitoring, performed in accordance with the NYSDEC-approved OU3 Groundwater IRM OM&M Manual (Arcadis 2009) and the NYSDEC-approved Sampling and Analysis Plan (SAP; Arcadis 2009). As we have transitioned to electronic submittals (via PDF) in line with NYSDEC's paper reduction program. Hard copies of the report can be provided upon receipt of a written request.

Phone:
631.391.5284

Email:
David.E.Stern@arcadis.com

Our ref:
NY001496.1416

If you have any questions, please do not hesitate to contact us.

Sincerely,

Arcadis of New York, Inc.



David E. Stern
Senior Hydrogeologist

Enclosure

Mr. Jason Pelton
August 24, 2017

Copies:

Ed Hannon, Northrop Grumman
Donald Hesler, NYSDEC
Steven Karpinski, New York State Department of Health
Joseph DeFranco, Nassau County Department of Health
Lorenzo Thantu, USEPA
Carlo San Giovanni, Arcadis
Christopher Engler, Arcadis
Public Repository
File

TABLES



Table 1
Operational Summary
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

MONTH	DAY																															Days Operational (1)
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
2009 Total																																160
2010 Total																																352
2011 Total																																351
2012 Total																																353
2013 Total																																354
2014 Total																																349
2015 Total																																348
2016 Total																																351
1 Q 2017																																88
Apr-17																																30
May-17																																31
Jun-17													(2)		(3)																	29
2 Q 2017																																90
2017 Total																																178
TOTAL																																2,796

Legend:

	Indicates system online for at least the majority of the day.
	Indicates system operated with reduced flow rates.
	Indicates system off-line for at least the majority of the day.
K	Indicates PPZ change-out.
C	Indicates carbon change-out.

Acronyms\Key:

2Q	second quarter
ECU	emission control unit
VPGAC	vapor phase granular activated carbon
PPZ	potassium permanganate-impregnated zeolite
RW	recovery well
LOTO	Lock out tag out
GPM	Gallons per minute

Notes:

(1) Days in which the system was operational for the majority of the day are counted as one day.

Second Quarter 2017

- (2) RW-2 flow less than 60 GPM due to pump fouling and motor issues. Pump fouling is attributed to iron buildup from high influent iron concentrations. A new pump and motor were installed on June 27, 2017
- (3) The system was offline for approximately 26 hours due to LOTO procedures to accommodate relocation of an electrical box during excavation and paving.

Table 2
Summary of Influent Water Sample Analytical Results
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Compound	08/23/16 (µg/L)	12/16/16 (µg/L)	03/17/17 (µg/L)	06/16/17 (µg/L)
Project VOCs				
1,1,1 - Trichloroethane	< 1.0	< 1.0	< 1.0	< 1.0
1,1 - Dichloroethane	< 1.0	0.31 J	0.29 J	< 1.0
1,2 - Dichloroethane	< 1.0	< 1.0	< 1.0	< 1.0
1,1 - Dichloroethene	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	0.25 J	< 1.0	< 1.0	< 1.0
Trichloroethene	3.3	3.9	4.1	3.5
Vinyl Chloride	11	13	5.9	3.4
cis 1,2-Dichloroethene	8.0	7.7	8.2	4.7
trans 1,2-Dichloroethene	< 1.0	< 1.0	< 1.0	< 1.0
Benzene	< 0.50	< 0.50	< 0.50	< 0.50
Toluene	4.5	2.5	0.63 J	< 1.0
Xylene-O	0.22 J	< 1.0	< 1.0	< 1.0
Xylenes - M,P	< 1.0	< 1.0	< 1.0	< 1.0
Subtotal Project VOCs	27	27	19	11.6
Compound	08/23/16 (µg/L)	12/16/16 (µg/L)	03/17/17 (µg/L)	06/16/17 (µg/L)
Non-Project VOCs				
1,1,2,2-Tetrachloroethane	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	< 1.0	< 1.0	< 1.0	< 1.0
1,3-Butanone	NA	NA	NA	< 5.0
2-Butanone	< 10	< 10	< 10	< 10
4-Methyl-2-Pentanone	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	< 10	< 10	< 10	< 10
Bromodichloromethane	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	3.0 J	2.1 J	2.0 J	< 5.0
Chloroethane	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	1.5	1.3	1.0	0.88 J
Chloromethane	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,3-Dichloropropene	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	< 2.0	< 2.0	< 2.0	< 2.0
Dichloromethane	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	0.38 J	0.31 J	0.22 J	< 1.0
Methyl N-Butyl Ketone	< 5.0	< 5.0	< 5.0	< 5.0
Methyl Tert-Butyl Ether	< 1.0	< 1.0	< 1.0	< 1.0
Styrene (Monomer)	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	< 1.0	< 1.0	< 1.0	< 1.0
Trichlorofluoromethane (Freon 11)	< 2.0	< 2.0	< 2.0	< 2.0
Trichlorotrifluoroethane (Freon 113)	< 5.0	< 5.0	< 5.0	< 5.0
1-Chloro-1,1-difluoroethane (Freon 142b)	NA	NA	NA	< 5.0
Subtotal Non-Project VOCs	4.9	3.7	3.2	0.88
Total VOCs⁽¹⁾	32	31	22	12.5
1,4-Dioxane⁽²⁾	0.28	0.97	0.93	0.87

Notes and abbreviations on last page.

Table 2
Summary of Influent Water Sample Analytical Results
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Compound	08/23/16 (µg/L)	12/16/16 (µg/L)	03/17/17 (µg/L)	06/16/17 (µg/L)
Inorganics				
Dissolved Cadmium	--	< 3.0	--	--
Total Cadmium	--	< 3.0	--	--
Dissolved Chromium	--	11	--	--
Total Chromium	--	20	--	--
Dissolved Iron	169	240	146	123
Total Iron	2,640	3,140	233	161
Total Mercury	--	--	--	--
pH⁽³⁾	5.6	5.7	5.5	5.3

Notes and Abbreviations:

- (1) "Total VOCs" represents the sum of individual concentrations of the compounds detected. The values used in calculations referenced in this report have been rounded to the nearest whole number.
- (2) Samples collected during the Third Quarter 2016 were analyzed for 1,4-Dioxane using USEPA Method 8270D SIM. Samples collected during Fourth Quarter 2016, First Quarter 2017, and Second Quarter 2017 were analyzed for 1,4-Dioxane using USEPA Method 522.
- (3) Influent pH samples collected and measured in the field by Arcadis personnel on the dates listed using an Oakton Model 300 pH/conductivity meter. pH units are standard units.

- 700** Bold value indicates a detection.
 -- not analyzed
 J Compound detected below its reporting limit; value is estimated.
 NA not analyzed
 SIM selected ion monitoring
 USEPA United States Environmental Protection Agency
 VOC volatile organic compound
 µg/L micrograms per liter
 < 5 Compound not detected above its laboratory quantification limit.

Table 3
Summary of Effluent Water Sample Analytical Results
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Compound	Discharge Limit ⁽¹⁾ (µg/L)	07/14/16 (µg/L)	08/23/16 (µg/L)	09/14/16 (µg/L)	10/11/16 (µg/L)	11/28/16 (µg/L)	12/16/16 (µg/L)	01/20/17 (µg/L)	02/22/17 (µg/L)	03/17/17 (µg/L)	04/21/17 (µg/L)	05/11/17 (µg/L)	06/18/17 (µg/L)
Project VOCs													
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	5	< 1.0	< 1.0	0.30 J	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Vinyl Chloride	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis 1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans 1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Benzene	5	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Xylene-O	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Xylenes - M,P	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Subtotal Project VOCs	--	0.0	0.0	0.30	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Notes and abbreviations on last page.

Table 3
Summary of Effluent Water Sample Analytical Results
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Compound	Discharge Limit ⁽¹⁾ (µg/L)	07/14/16 (µg/L)	08/23/16 (µg/L)	09/14/16 (µg/L)	10/11/16 (µg/L)	11/28/16 (µg/L)	12/16/16 (µg/L)	01/20/17 (µg/L)	02/22/17 (µg/L)	03/17/17 (µg/L)	04/21/17 (µg/L)	05/11/17 (µg/L)	06/16/17 (µg/L)
Non-Project VOCs													
1,1,2,2-Tetrachloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0 J
1,2-Dichloropropane	0.6	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,3-Butadiene	0.5 ⁽⁹⁾	NA	NA	NA	NA	NA	NA	NA	NA	NA	< 5.0	< 5.0	< 5.0
2-Butanone	50	< 10	< 10	< 10	< 10	< 10	< 10 J	< 10	< 10	< 10	< 10	< 10	< 10
4-Methyl-2-Pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	50	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0 J
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Dichloromethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl N-Butyl Ketone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Methyl Tert-Butyl Ether	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Styrene (Monomer)	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichlorofluoromethane (Freon 11)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
1-Chloro-1,1-difluoroethane (Freon 142b)	--	NA	NA	NA	NA	NA	NA	NA	NA	NA	< 5.0	< 5.0	< 5.0
Subtotal Non-Project VOCs	--	0.0	0.0	0.0	0.0	0.0	0.0	0	0	0	0	0	0
Total VOCs⁽²⁾	--	0.0	0.0	0.30	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Treatment Efficiency⁽³⁾	--	> 99.9%	> 99.9%	99.1%	> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%

Notes and abbreviations on last page.

Table 3
Summary of Effluent Water Sample Analytical Results
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Compound	Discharge Limit ⁽¹⁾ (µg/L)	07/14/16 (µg/L)	08/23/16 (µg/L)	09/14/16 (µg/L)	10/11/16 (µg/L)	11/28/16 (µg/L)	12/16/16 (µg/L)	01/20/17 (µg/L)	02/22/17 (µg/L)	03/17/17 (µg/L)	04/21/17 (µg/L)	05/11/17 (µg/L)	06/16/17 (µg/L)
Inorganics													
Dissolved Cadmium	5	--	< 3.0	--	--	--	< 3.0	--	--	< 3.0	--	--	3.1
Total Cadmium	5	--	< 3.0	--	--	--	< 3.0	--	--	< 3.0	--	--	< 3.0
Dissolved Chromium	50	--	< 10	--	--	--	< 10	--	--	< 10	--	--	< 10
Total Chromium	50	--	< 10	--	--	--	< 10	--	--	< 10	--	--	< 10
Dissolved Iron	600	199	162	270	201	262	224	223	1580⁽⁷⁾	155	136	184	102
Total Iron	600	241	208	304	205	280	622⁽⁷⁾	265	4590⁽⁷⁾	245	236	242	140
Total Mercury	250	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20	< 0.30	< 0.20	< 0.20	< 0.20	< 0.20
1,4-Dioxane ⁽⁶⁾	--	0.41	0.40	0.60	1.3	1.3	1.0	0.9	1.5	1.0	0.82	1.0	0.89
pH ⁽⁴⁾	5.5 - 8.5	-- ⁽⁵⁾	6.4	6.6	6.7	-- ⁽⁵⁾	6.8	4.2⁽⁸⁾	-- ⁽⁵⁾	6.5	6.4	6.4	7.0

Notes and Abbreviations:

- (1) Discharge limits per the interim SPDES equivalency program or Division of Water Technical and Operational Guidance Series (TOGS 1.1.1) Quality Standards and Guidance Values and Groundwater Effluent Limitations, if the compound is not part of the interim SPDES equivalency program.
- (2) "Total VOCs" represents the sum of individual concentrations of compounds detected. The values used in calculations referenced in this report have been rounded to the nearest whole number.
- (3) Treatment efficiency was calculated by dividing the difference between the influent and effluent total VOC concentrations by the influent total VOC concentration.
- (4) Effluent pH samples collected and measured in the field by Arcadis personnel on the dates listed using an Oakton Model 300 pH/conductivity meter. pH units are standard units.
- (5) pHs not recorded due to technician error.
- (6) Samples collected during Second and Third Quarters 2016 were analyzed for 1,4-Dioxane using USEPA Method 8270D SIM. Samples collected during Fourth Quarter 2016, First Quarter 2017, and Second Quarter 2017 were analyzed for 1,4-Dioxane using USEPA Method 522.
- (7) The December 16, 2016 and February 22, 2017 iron concentrations exceeded their discharge limit of 600 µg/l. The exceedances are suspected to be the result of iron precipitates in the effluent sample line, and it was cleaned prior to the next sampling event.
- (8) The anomalous pH value in January 2017 is suspected to be the result of an equipment calibration issue. The pH returned to typical values in subsequent sampling events.
- (9) Discharge limit per Department of Environmental Conservation Chapter X- Division of Water Part 703

- 700** Bold value indicates a detection.
J Compound detected below its reporting limit; value is estimated
NA Not analyzed
SIM selected ion monitoring
SPDES State Pollutant Discharge Elimination System
USEPA United States Environmental Protection Agency
VOC volatile organic compound
µg/L micrograms per liter
-- not analyzed
< 5 Compound not detected above its laboratory quantification limit.

Table 4
Influent Vapor Sample Analytical Results
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Compound ⁽¹⁾	08/23/16 (µg/m ³)	12/22/16 (µg/m ³)	03/17/17 (µg/m ³)	06/16/17 (µg/m ³)
Project VOCs				
1,1,1 - Trichloroethane	0.60	< 1.1	< 0.55	< 2.2
1,1 - Dichloroethane	4.5	4.5	3.5	3.4
1,2 - Dichloroethane	< 0.81	< 1.6	< 0.81	< 3.2
1,1 - Dichloroethene	1.5	1.9	1.8	< 3.2
Tetrachloroethene	3.1	142	0.50	3.8
Trichloroethene	47	58	11	58
Vinyl Chloride	180	143	95	45
cis 1,2-Dichloroethene	155	119	77	67
trans 1,2-Dichloroethene	0.35 J	< 1.6	0.27 J	< 3.2
Benzene	0.70	1.5	< 0.64	< 2.6
Toluene	77	37	< 0.75	2.4 J
Xylene-O	3.6	2.3	< 0.87	< 3.5
Xylenes - M,P	6.1	5.6	< 0.87	< 3.5
Subtotal Project VOCs	479	515	190	179
Compound ⁽¹⁾	08/23/16 (µg/m ³)	12/22/16 (µg/m ³)	03/17/17 (µg/m ³)	06/16/17 (µg/m ³)
Non-Project VOCs				
1,1,2,2-Tetrachloroethane	< 0.69	< 1.4	< 0.69	< 2.7
1,1,2-Trichloroethane	< 0.55	< 1.1	< 0.55	< 2.2
1,2-Dichloropropane	< 0.92	< 1.8	< 0.92	< 3.7
1,3-Butadiene	< 0.44	< 0.88	< 0.44	< 1.8
2-Butanone	1.1	3.2	0.94	1.6 J
4-Methyl-2-Pentanone	< 0.82	< 1.6	< 0.82	< 3.3
Acetone	7.1	19	15	21
Bromodichloromethane	< 0.67	< 1.3	< 0.67	< 2.7
Bromoform	< 0.41	< 0.83	< 0.41	< 1.7
Bromomethane	< 0.78	< 1.6	< 0.78	< 3.1
Carbon Disulfide	< 0.62	11	< 0.62	< 2.5
Carbon Tetrachloride	< 0.25	< 0.50	< 0.25	< 1.0
Chlorobenzene	< 0.92	< 1.8	< 0.92	< 3.7
Chlorodibromomethane	< 0.85	< 1.7	< 0.85	< 3.4
Chlorodifluoromethane (Freon 22)	35	26	22	26
Chloroethane	< 0.53	< 1.1	< 0.53	< 2.1
Chloroform	21	19	13	15
Chloromethane	1.3	1.4	1.2	1.5 J
cis-1,3-Dichloropropene	< 0.91	< 1.8	< 0.91	< 3.6
Dichlorodifluoromethane (Freon 12)	2.7	2.1	1.9	2.7 J
Dichloromethane	3.4	1.8	1.4	3.8
Ethylbenzene	6.1	5.2	< 0.87	< 3.5
Methyl N-Butyl Ketone	< 0.82	< 1.6	< 0.82	< 3.3
Methyl Tert-Butyl Ether	0.65 J	< 1.4	< 0.72	< 2.9
Styrene (Monomer)	< 0.85	< 1.7	< 0.85	< 3.4
trans-1,3-Dichloropropene	< 0.91	< 1.8	< 0.91	< 3.6
Trichlorofluoromethane (Freon 11)	2.1	1.5	1.3	< 2.2
Trichlorotrifluoroethane (Freon 113)	2.1	2.1	1.7	< 3.1
1-Chloro-1,1-difluoroethane (Freon 142b)	< 0.82	< 1.6	< 0.82	< 3.3
Subtotal Non-Project VOCs	83	92	58	72
Total VOCs⁽²⁾	562	607	248	251

Notes and abbreviations on last page.

Table 4
Influent Vapor Sample Analytical Results
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Notes and Abbreviations:

- (1) Vapor samples collected by Arcadis on the dates shown and submitted to a NYSDOH ELAP certified laboratory for VOC analyses per Modified USEPA Method TO-15. A VOC analyte list is provided in the DRAFT Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). Influent samples were collected at Vapor Sampling Port-1 (VSP-1); refer to Figure 3 of this OM&M Report for the location of VSP-1.
- (2) "Total VOCs" represents the sum of individual concentrations of compounds detected. The values used in calculations referenced in this report have been rounded to the nearest whole number.

700	Bold value indicates a detection.
ELAP	Environmental Laboratory Approval Program
IRM	interim remedial measure
J	Compound detected below its reporting limit; value is estimated.
ND	Analyte not detected at or above its laboratory reporting limit.
NYSDOH	New York State Department of Health
OM&M	operation, maintenance, and monitoring
SPDES	State Pollutant Discharge Elimination System
TIC	tentatively identified compound
USEPA	United States Environmental Protection Agency
VOC	volatile organic compound
$\mu\text{g}/\text{m}^3$	micrograms per cubic meter
< 5	Compound not detected above its laboratory quantification limit.

Table 5
Summary of Effluent Vapor Sample Analytical Results
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Compound ⁽¹⁾	08/23/16 (µg/m ³)	12/22/16 (µg/m ³)	03/17/17 (µg/m ³)	06/16/17 (µg/m ³)
Project VOCs				
1,1,1 - Trichloroethane	< 0.55	< 0.55	< 1.1	< 2.2
1,1 - Dichloroethane	6.1	4.5	11	5.3
1,2 - Dichloroethane	< 0.81	< 0.81	< 1.6	< 3.2
1,1 - Dichloroethene	0.63 J	0.83	2.4	< 3.2
Tetrachloroethene	0.29	0.64	25	< 1.1
Trichloroethene	1.1	2.7	10	2.1
Vinyl Chloride	3.6	17	53	2.8
cis 1,2-Dichloroethene	11	40	141	21
trans 1,2-Dichloroethene	< 0.79	< 0.79	< 1.6	< 3.2
Benzene	3.2	6.4	12	< 2.6
Toluene	8.7	4.1	7.2	1.1 J
Xylene-O	< 0.87	0.69 J	339	1.7 J
Xylenes - M,P	0.52 J	2.5	608	2.6 J
Subtotal Project VOCs	35	79	1209	37
Non-Project VOCs				
1,1,2,2-Tetrachloroethane	< 0.69	< 0.69	< 1.4	< 2.7
1,1,2-Trichloroethane	< 0.55	< 0.55	< 1.1	< 2.2
1,2-Dichloropropane	< 0.92	< 0.92	< 1.8	< 3.7
1,3-Butadiene	< 0.44	< 0.44	< 0.88	< 1.8
2-Butanone	2.5	8.8	27	< 2.4
4-Methyl-2-Pentanone	< 0.82	< 0.82	< 1.6	< 3.3
Acetone	51	143	190	21
Bromodichloromethane	< 0.67	< 0.67	< 1.3	< 2.7
Bromoform	< 0.41	< 0.41	< 0.83	< 1.7
Bromomethane	< 0.78	< 0.78	< 1.6	< 3.1
Carbon Disulfide	< 0.62	0.75	< 1.2	< 2.5
Carbon Tetrachloride	< 0.25	< 0.25	< 0.50	< 1.0
Chlorobenzene	< 0.92	< 0.92	< 1.8	< 3.7
Chlorodibromomethane	< 0.85	< 0.85	< 1.7	< 3.4
Chlorodifluoromethane (Freon 22)	40	21	48	27
Chloroethane	< 0.53	< 0.53	< 1.1	< 2.1
Chloroform	40	24	58	27
Chloromethane	6.0	2.0	2.9	1.7
cis-1,3-Dichloropropene	< 0.91	< 0.91	< 1.8	< 3.6
Dichlorodifluoromethane (Freon 12)	2.6	2.1	3.7	< 4.0
Dichloromethane	0.73	10	1.9	3.2
Ethylbenzene	< 0.87	0.96	5.6	2.0 J
Methyl N-Butyl Ketone	< 0.82	< 0.82	< 1.6	< 3.3
Methyl Tert-Butyl Ether	< 0.72	< 0.72	< 1.4	< 2.9
Styrene (Monomer)	< 0.85	< 0.85	< 1.7	< 3.4
trans-1,3-Dichloropropene	< 0.91	< 0.91	< 1.8	< 3.6
Trichlorofluoromethane (Freon 11)	1.7	1.7	3.0	< 2.2
Trichlorotrifluoroethane (Freon 113)	0.74 J	1.4	4.2	< 3.1
1-Chloro-1,1-difluoroethane (Freon 142b)	< 0.82	< 0.82	< 1.6	< 3.3
Subtotal Non-Project VOCs	146	216	344	82
Total VOCs⁽²⁾	181	295	1553	119

Notes and abbreviations on last page.

Table 5
Summary of Effluent Vapor Sample Analytical Results
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Notes and Abbreviations:

- (1) Vapor samples collected by Arcadis on the dates shown and submitted to a NYSDOH ELAP certified laboratory for VOC analyses per Modified USEPA Method TO-15. A VOC analyte list is provided in the DRAFT Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). Effluent samples were collected at Vapor Sampling Port-5 (VSP-5); refer to Figure 3 of this OM&M Report for the location of VSP-5.
- (2) "Total VOCs" represents the sum of individual concentrations of all compounds detected. The values used in calculations referenced in this report have been rounded to the nearest whole number.

700 Bold data indicates that the analyte was detected at or above its reporting limit.

ELAP Environmental Laboratory Approval Program

J Compound detected below its reporting limit; value is estimated.

NYSDOH New York State Department of Health

OM&M operation, maintenance, and monitoring

USEPA United States Environmental Protection Agency

VOC volatile organic compound

$\mu\text{g}/\text{m}^3$ micrograms per cubic meter

< 5 Compound not detected above its laboratory quantification limit.

Table 6
Summary of Effluent Vapor Tentatively Identified Compounds
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Compound ⁽¹⁾	08/23/16 (ppbv)	12/16/16 (ppbv)	03/17/17 (ppbv)	06/16/17 (ppbv)
<u>Tentatively Identified Compounds</u>				
alkane	3.1 J	6.1 J	36 J	--
alkane	2.1 J	2.9 J	23 J	--
alkane	1.9 J	2.7 J	21 J	--
alkane	1.8 J	2.7 J	20 J	--
alkane	1.4 J	--	17 J	--
alkane	--	--	16 J	--
alkane	--	--	14 J	--
C alkyl benzene	--	--	13 J	--
cycloalkane/alkene	2.6 J	7.1 J	19 J	--
cycloalkane/alkene	--	3.7 J	14 J	--
cycloalkane/alkene	--	3.4 J	12 J	--
cycloalkane/alkene	--	1.2 J	--	--
Naphthalene decahydro-methyl	3.5 J	6.0 J	--	--
Naphthalene decahydro-methyl	--	5.8 J	--	--
Naphthalene decahydro-methyl	--	4.2 J	--	--
Unknown	--	3.5 J	23 J	--
Unknown	--	2.0 J	21 J	--
Unknown	--	1.5 J	18 J	--
Unknown	--	--	16 J	--
Unknown Alkane	--	--	13 J	--
Total VOC TICs	22 J	64 J	384 J	0

Notes and abbreviations on last page.

Table 6
Summary of Effluent Vapor Tentatively Identified Compounds
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Notes and Abbreviations:

(1) Vapor samples collected by Arcadis on the dates shown and submitted to a NYSDOH ELAP certified laboratory for VOC analyses per Modified USEPA Method TO-15. A VOC analyte list is provided in the DRAFT Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). Effluent samples were collected at Vapor Sampling Port-5 (VSP-5); refer to Figure 3 of this OM&M Report for the location of VSP-5.

700 Bold data indicates that the analyte was detected at or above its reporting limit.

ELAP Environmental Laboratory Approval Program

J Compound detected below its reporting limit; value is estimated.

B Compound was also detected in the associated field blank.

N Indicates presumptive evidence of a compound.

NYSDOH New York State Department of Health

OM&M operation, maintenance, and monitoring

USEPA United States Environmental Protection Agency

VOC volatile organic compound

ppbv parts per billion by volume

Table 7
Summary of System Parameters
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Date ⁽¹⁾	Water Flow Rates						Water Pressures ⁽²⁾					Air Flow Rate ⁽²⁾	Air Pressures ⁽⁵⁾					Air Temp. ⁽⁵⁾
	Remedial Well ⁽²⁾				Combined Influent ⁽³⁾	Effluent ⁽²⁾	Remedial Well Effluent ⁽⁴⁾				Effluent	Effluent	ECU Influent				Effluent	Effluent
	RW-1	RW-2	RW-3	RW-4			RW-1	RW-2	RW-3	RW-4			GAC-501	GAC-502	PPZ-601	PPZ-602		
	(gpm)	(gpm)	(gpm)	(gpm)	(gpm)	(gpm)	(psi)	(psi)	(psi)	(psi)	(psi)	(scfm)	(iwc)	(iwc)	(iwc)	(iwc)	(iwc)	(°R)
04/18/16	30.9	75.8	75.7	29.9	212	216	55	30	14	55	11	1,814	5.8	3.4	0.5	2.0	0.0	532
05/18/16	29.9	75.4	75.7	30.2	211	224	56	22	20	55	12	1,973	6.5 ⁽⁶⁾	3.4 ⁽⁶⁾	1.0 ⁽⁶⁾	2.0 ⁽⁶⁾	2.0 ⁽⁶⁾	532 ⁽⁶⁾
06/10/16	30.2	73.7	75.2	30.3	209	211	56	11	22	54	11	1,827	7.0 ⁽⁷⁾	3.5 ⁽⁷⁾	1.0 ⁽⁷⁾	2.2 ⁽⁷⁾	0.0 ⁽⁷⁾	537 ⁽⁷⁾
07/14/16	30.3	75.1	75.0	30.8	211	222	55	13	25	54	12	1,816	6.9 ⁽⁸⁾	3.4 ⁽⁸⁾	1.0 ⁽⁸⁾	2.0 ⁽⁸⁾	0.0 ⁽⁸⁾	538 ⁽⁸⁾
08/23/16	30.1	62.7	75.3	29.8	198	203	55	6	21	54	12	1,840	6.5 ⁽⁹⁾	3.2 ⁽⁹⁾	1.0 ⁽⁹⁾	2.0 ⁽⁹⁾	0.0 ⁽⁹⁾	540 ⁽⁹⁾
09/14/16	30.7	74.7	75.1	30.8	211	221	54	6	19	53	11	1,738	6.0 ⁽¹⁰⁾	3.0 ⁽¹⁰⁾	1.0 ⁽¹⁰⁾	2.0 ⁽¹⁰⁾	0.0 ⁽¹⁰⁾	539 ⁽¹⁰⁾
10/11/16	30.0	72.9	74.4	30.9	208	233	55	9	20	53	13	1,689	6.4	3.2	1.0	2.0	0.0	538
11/28/16	30.8	75.9	75.2	29.9	212	226	54	50	43	54	13	1,719	6.5	3.2	1.0	2.0	0.0	532
12/16/16	30.0	74.6	74.8	29.8	209	229	55	46	40	53	12	1,736	6.5 ⁽¹¹⁾	3.0 ⁽¹¹⁾	1.0 ⁽¹¹⁾	1.9 ⁽¹¹⁾	0.0 ⁽¹¹⁾	519 ⁽¹¹⁾
01/20/17	31.0	76.2	75.3	30.1	213	234	54	12	32	53	13	1,757	6.5 ⁽¹²⁾	3.2 ⁽¹²⁾	1.0 ⁽¹²⁾	2.0 ⁽¹²⁾	0.0 ⁽¹²⁾	530 ⁽¹²⁾
02/22/17	30.5	81.2	75.0	30.2	217	230	54	53	28	53	18	1,698	7.0 ⁽¹³⁾	3.5 ⁽¹³⁾	1.0 ⁽¹³⁾	2.0 ⁽¹³⁾	0.0 ⁽¹³⁾	532 ⁽¹³⁾
03/17/17	30.2	79.8	76.0	30.3	216	227	55	53	26	53	25	1,690	6.4 ⁽¹⁴⁾	3.0 ⁽¹⁴⁾	1.0 ⁽¹⁴⁾	1.9 ⁽¹⁴⁾	0.0 ⁽¹⁴⁾	530 ⁽¹⁴⁾
04/21/17	30.6	74.8	75.3	29.8	210	219	55	69	26	54	13	1,695	6.5 ⁽¹⁵⁾	3.0 ⁽¹⁵⁾	1.0 ⁽¹⁵⁾	1.5 ⁽¹⁵⁾	0.0 ⁽¹⁵⁾	534 ⁽¹⁵⁾
05/18/17	30.9	73.93	75.72	30.02	211	229	54	50	25	54	13	1,676	6.0 ⁽¹⁶⁾	3.0 ⁽¹⁶⁾	1.0 ⁽¹⁶⁾	1.9 ⁽¹⁶⁾	0.0 ⁽¹⁶⁾	538 ⁽¹⁶⁾
06/16/17	30.0	58.17	73.1	30.67	192	213	55	8	25	54	14	1,571	6.0 ⁽¹⁷⁾	2.9 ⁽¹⁷⁾	1.0 ⁽¹⁷⁾	1.9 ⁽¹⁷⁾	0.0 ⁽¹⁷⁾	540 ⁽¹⁷⁾

Notes and abbreviations on last page.

Table 7
Summary of System Parameters
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Notes and Abbreviations:

- (1) Operational data collected by Arcadis on days noted. Parameters listed were typically recorded during compliance monitoring events. Data in this table correspond to approximately the past year of system operation.
- (2) Instantaneous parameters obtained from the SCADA HMI: Water Flow Rate, Water Pressure, Air Flow Rate.
- (3) Combined influent water-flow rate is the sum of individual well flow rates via the SCADA System.
- (4) Remedial Well effluent pressure readings measured at the influent manifold within the treatment system building.
- (5) Instantaneous values from field-mounted instruments
- (6) Values collected on May 16, 2016 during the weekly site visit. No values collected on day of sampling.
- (7) Values collected on June 6, 2016 during the weekly site visit. No values collected on day of sampling.
- (8) Values collected on July 11, 2016 during the weekly site visit. No values collected on day of sampling.
- (9) Values collected on August 22, 2016 during the weekly site visit. No values collected on day of sampling.
- (10) Values collected on September 13, 2016 during the weekly site visit. No values collected on day of sampling.
- (11) Values collected on December 19, 2016 during the weekly site visit. No values collected on day of sampling.
- (12) Values collected on January 16, 2017 during the weekly site visit. No values collected on day of sampling.
- (13) Values collected on February 20, 2017 during the weekly site visit. No values collected on day of sampling.
- (14) Values collected on March 20, 2017 during the weekly site visit. No values collected on day of sampling.
- (15) Values collected on April 24, 2017 during the weekly site visit. No values collected on day of sampling.
- (16) Values collected on May 15, 2017 during the weekly site visit. No values collected on day of sampling.
- (17) Values collected on June 26, 2017 during the weekly site visit. No values collected on day of sampling.

ECU	emission control unit
gpm	gallons per minute
HMI	human-machine interface
iwc	inches of water column
psi	pounds per square inch
°R	degrees Rankine
SCADA	Supervisory Control and Data Acquisition
scfm	standard cubic feet per minute
Temp.	temperature

Table 8
Summary of Groundwater Recovered, VOC Mass Recovered, and VOC Mass Recovery Rates
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Operating Period ⁽¹⁾	Volume of Groundwater Recovered (x1,000 gal) ⁽²⁾					VOC Mass Recovered (lbs) ⁽³⁾															VOC Mass Recovery Rate (lbs/day) ⁽⁴⁾																			
						Total VOCs ⁽⁵⁾					Project VOCs ⁽⁶⁾					Non-Project VOCs ⁽⁷⁾					Total VOCs ⁽⁵⁾					Project VOCs ⁽⁶⁾					Non-Project VOCs ⁽⁷⁾									
	RW-1	RW-2	RW-3	RW-4	Total	RW-1	RW-2	RW-3	RW-4	Total	RW-1	RW-2	RW-3	RW-4	Total	RW-1	RW-2	RW-3	RW-4	Total	RW-1	RW-2	RW-3	RW-4	Total	RW-1	RW-2	RW-3	RW-4	Total	RW-1	RW-2	RW-3	RW-4	Total	RW-1	RW-2	RW-3	RW-4	Total
System Pilot Test, Shakedown and Startup Totals⁽⁸⁾	137	270	251	150	808	NA	NA	NA	NA	1.1	NA	NA	NA	NA	1.0	NA	NA	NA	NA	0.1	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
2009 Totals	6,592	13,838	16,445	6,574	43,449	0.17	275	53	14	342	0.17	273	19	0.20	293	<0.01	0.56	35	13	48	<0.01	1.7	0.33	0.086	2.1	<0.01	1.7	0.12	<0.01	NA	1.8	<0.01	<0.01	0.22	0.080	0.30				
2010 Totals	15,726	35,127	38,160	15,689	104,702	0.56	172	412	89	672	0.56	171	28	0.10	200	<0.01	0.17	383	89	469	<0.01	0.46	1.1	0.24	1.8	<0.01	0.46	0.075	<0.01	0.54	<0.01	<0.01	1.0	0.24	1.3					
2011 Totals	15,218	36,570	37,682	15,196	104,666	0.36	167	271	78	516	0.36	167	35	0.090	203	<0.01	1.1	236	78	314	<0.01	0.45	0.73	0.21	1.4	<0.01	0.45	0.095	<0.01	0.55	<0.01	<0.01	0.64	0.21	0.85					
2012 Totals	15,260	35,178	36,111	15,336	101,885	0.28	114	113	40	267	0.25	113	12	0.39	126	<0.01	1.5	101	40	141	<0.01	0.31	0.31	0.11	0.73	<0.01	0.31	0.032	<0.01	0.35	<0.01	<0.01	0.28	0.11	0.39					
2013 Totals	15,968	37,514	36,622	16,036	106,140	0.14	111	41	18	171	0.14	110	4.3	0.36	113	<0.01	1.6	37	18	57	<0.01	0.30	0.11	0.050	0.47	<0.01	0.30	0.012	<0.01	0.31	<0.01	<0.01	0.10	0.049	0.16					
2014 Totals	15,690	33,222	31,199	15,691	95,802	0.063	67	9.9	8.1	85	0.063	65	2.0	0.20	67	<0.01	1.5	8.1	7.9	17	<0.01	0.19	0.028	0.023	0.24	<0.01	0.18	<0.01	<0.01	0.19	<0.01	<0.01	0.023	0.022	0.047					
2015 Totals	15,859	38,082	34,961	14,755	103,657	0.028	47	7.1	4.5	57	0.021	45	1.5	0.20	45	<0.01	1.7	5.6	4.2	12	<0.01	0.13	0.019	0.012	0.16	<0.01	0.12	<0.01	<0.01	0.12	<0.01	<0.01	0.015	0.012	0.032					
2016 Totals	15,826	34,539	39,349	15,826	105,540	<0.01	38	3.2	2.2	44	<0.01	37	1.4	0.20	39	<0.01	1.5	1.7	2.0	5.2	<0.01	0.10	<0.01	<0.01	0.12	<0.01	0.10	<0.01	<0.01	0.11	<0.01	<0.01	<0.01	<0.01	0.014					
January 2017 through March 2017 Totals																																								
01/01/17 - 02/01/17	1,404	2,631	3,511	1,405	8,951	<0.01	1.7	0.25	0.12	2.1	<0.01	1.6	0.13	0.012	1.7	<0.01	0.072	0.12	0.10	0.30	<0.01	0.055	<0.01	<0.01	0.068	<0.01	0.052	<0.01	<0.01	0.055	<0.01	<0.01	<0.01	<0.01	<0.01					
02/01/17 - 03/01/17	1,237	879	3,091	1,237	6,444	<0.01	0.56	0.22	0.10	0.88	<0.01	0.53	0.11	0.011	0.65	<0.01	0.024	0.11	0.091	0.23	<0.01	0.020	<0.01	<0.01	0.031	<0.01	0.019	<0.01	<0.01	0.023	<0.01	<0.01	<0.01	<0.01	<0.01					
03/01/17 - 04/01/17	1,413	3,129	3,532	1,413	9,487	<0.01	2.0	0.25	0.12	2.4	<0.01	1.9	0.13	0.012	2.0	<0.01	0.086	0.12	0.10	0.31	<0.01	0.065	<0.01	<0.01	0.08	<0.01	0.061	<0.01	<0.01	0.065	<0.01	<0.01	<0.01	<0.01	<0.01					
Subtotal Jan - Mar 2017⁽⁹⁾	4,054	6,639	10,134	4,055	24,882	<0.01	4.3	0.72	0.34	5.4	<0.01	4.0	0.37	0.035	4.4	<0.01	0.18	0.35	0.29	0.80	<0.01	0.048	<0.01	<0.01	0.060	<0.01	0.044	<0.01	<0.01	0.049	<0.01	<0.01	<0.01	<0.01	<0.01					
April 2017 Through June 2017 Totals																																								
04/01/17 - 05/01/17	1,379	2,759	3,448	1,379	8,965	<0.01	1.1	0.22	0.12	1.4	<0.01	1.1	0.11	0.017	1.2	<0.01	0.06	0.12	0.11	0.28	<0.01	0.037	<0.01	<0.01	0.048	<0.01	0.037	<0.01	<0.01	0.041	<0.01	<0.01	<0.01	<0.01	<0.01					
05/01/17 - 06/01/17	1,427	2,853	3,567	1,427	9,274	<0.01	1.2	0.23	0.13	1.6	<0.01	1.1	0.11	0.018	1.2	<0.01	0.06	0.12	0.11	0.29	<0.01	0.039	<0.01	<0.01	0.050	<0.01	0.035	<0.01	<0.01	0.040	<0.01	<0.01	<0.01	<0.01	<0.01					
06/01/17 - 07/01/17	1,325	2,649	3,312	1,325	8,611	<0.01	1.1	0.22	0.12	1.4	<0.01	1.0	0.10	0.017	1.1	<0.01	0.05	0.11	0.10	0.26	<0.01	0.037	<0.01	<0.01	0.048	<0.01	0.033	<0.01	<0.01	0.037	<0.01	<0.01	<0.01	<0.01	<0.01					
Subtotal Apr - Jun 2017⁽¹⁰⁾	4,131	8,261	10,327	4,131	26,850	<0.01	3.4	0.67	0.37	4.4	<0.01	3.2	0.32	0.050	3.6	<0.01	0.17	0.34	0.32	0.83	<0.01	0.037	<0.01	<0.01	0.049	<0.01	0.04	<0.01	<0.01	0.04	<0.01	<0.01	<0.01	<0.01	<0.01					
2017 Totals	8,185	14,900	20,461	8,186	51,732	<0.01	7.7	1.4	0.71	10	<0.01	7.2	0.69	0.085	8.0	<0.01	0.35	0.69	0.61	1.6	<0.01	0.043	<0.01	<0.01	0.054	<0.01	0.04	<0.01	<0.01	0.04	<0.01	<0.01	<0.01	<0.01	<0.01					
Total⁽¹¹⁾	124,461	279,240	291,241	123,439	818,381	1.6	999	912	255	2,165	1.6	988	103	1.8	1,095	<0.01	9.9	808	253	1,064	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--					

Notes and Abbreviations:

- (1) Represents operating period between consecutive monitoring events.
- (2) Volume of groundwater recovered is based on individual local well totalized flow readings. Listed value is the difference between totalized flow values recorded between consecutive monitoring events. The total groundwater recovered during a given operating period is the sum of the individual well flow totals. Values shown are rounded to the nearest gallon, but should only be considered accurate to two significant figures to account for error associated with field measurements.
- (3) Mass recovered per well was calculated by multiplying the Total VOC concentration from the most recent sampling event by the number of gallons extracted during the reporting period. The total amount recovered during a given operating period is the sum of masses recovered from each of the individual wells. Values less than ten pounds are presented using two significant figures and values greater than ten pounds have been rounded to the nearest whole number; however, these values should only be considered accurate to two significant figures to account for error associated with field measurements and analytical data.
- (4) Mass recovery rates were calculated by dividing the total mass recovered for each well and for the system by the number of days in the respective operating period. Values are presented using two significant figures.
- (5) "Total VOCs" represents the sum of individual concentrations of the VOCs detected.
- (6) "Project VOCs" represents the sum of individual compound concentrations of 1,1,1-trichloroethane; 1,1-dichloroethane; 1,2-dichloroethane; 1,1-dichloroethene; tetrachloroethene; trichloroethylene; vinyl chloride; cis-1,2-dichloroethene; trans-1,2-dichloroethene; benzene; toluene; and xylenes-o,m, p.
- (7) "Non-Project VOCs" represents the difference between Total VOCs and Project VOCs.
- (8) Values based on operational data recorded prior to system startup on July 21, 2009.
- (9) The volume of groundwater recovered and mass recovered calculations represent the operational period between January 1, 2017 and April 1, 2017.
- (10) The volume of groundwater recovered and mass recovered calculations represent the operational period between April 1, 2017 and July 1, 2017.
- (11) "Total" refers to the amounts removed by the Operable Unit 3 Bethpage Park Groundwater Containment System.

gal gallons
HMI human-machine interface
lbs pounds
lbs/day pounds per day
-- not applicable

Table 9
Summary of Air Quality Impact Analysis
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Toxic Air Contaminant	CAS#	VSP-05 Vapor Effluent ($\mu\text{g}/\text{m}^3$)	Emission Rate ⁽¹⁾			Scaled Impact - Hourly ⁽²⁾ ($\mu\text{g}/\text{m}^3$)	Scaled Impact - Annual ⁽²⁾ ($\mu\text{g}/\text{m}^3$)	SGC ⁽³⁾ ($\mu\text{g}/\text{m}^3$)	AGC ⁽³⁾ ($\mu\text{g}/\text{m}^3$)	% of SGC	% of AGC
			6/16/2017	lb/yr	lb/hr						
1,1 - Dichloroethane	00075-34-3	5.3	0.30	3.45E-05	4.35E-06	1.37E-02	4.2E-04	--	0.63	--	0.1%
Trichloroethene	00079-01-6	2.1	0.12	1.37E-05	1.72E-06	5.43E-03	1.7E-04	20	0.20	0.0%	0.1%
Vinyl Chloride	00075-01-4	2.8	0.16	1.82E-05	2.30E-06	7.24E-03	2.2E-04	180,000	0.11	0.0%	0.2%
cis 1,2-Dichloroethene	00156-59-2	21	1.2	1.37E-04	1.72E-05	5.43E-02	1.7E-03	--	63	--	0.0%
Toluene	00108-88-3	1.1	0.063	7.16E-06	9.02E-07	2.84E-03	8.7E-05	37,000	5,000	0.0%	0.0%
Xylene-O	01330-20-7	1.7	0.10	1.11E-05	1.39E-06	4.40E-03	1.3E-04	22,000	100	0.0%	0.0%
Xylenes - M,P	01330-20-7	2.6	0.15	1.69E-05	2.13E-06	6.72E-03	2.1E-04	22,000	100	0.0%	0.0%
Acetone	00067-64-1	21	1.2	1.37E-04	1.72E-05	5.43E-02	1.7E-03	180,000	30,000	0.0%	0.0%
Chlorodifluoromethane (Freon 22)	00075-45-6	27	1.5	1.76E-04	2.21E-05	6.98E-02	2.1E-03	--	50,000	--	0.0%
Chloroform	00067-66-3	27	1.5	1.76E-04	2.21E-05	6.98E-02	2.1E-03	150	15	0.0%	0.0%
Chloromethane	00074-87-3	1.7	0.10	1.11E-05	1.39E-06	4.40E-03	1.3E-04	22,000	90	0.0%	0.0%
Dichloromethane	00075-09-2	3.2	0.18	2.08E-05	2.62E-06	8.28E-03	2.5E-04	14,000	60	0.0%	0.0%
Ethylbenzene	00100-41-4	2.0	0.11	1.30E-05	1.64E-06	5.17E-03	1.6E-04	--	1,000	--	0.0%

Notes and abbreviations on last page.

Table 9
Summary of Air Quality Impact Analysis
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Notes and Abbreviations:

--	none specified
AGC	annual guideline concentration
CAS#	Chemical Abstracts Service Registry Number
cfm	cubic feet per minute
DAR-1	Division of Air Resources-1
g/s	grams per second
lb/hr	pounds per hour
lb/yr	pounds per year
NYSDEC	New York State Department of Environmental Conservation
SGC	short-term guideline concentration
VSP	vapor sampling point
$\mu\text{g}/\text{m}^3$	micrograms per cubic meter

(1) Emission rate calculated based on an exit air flow rate of 1,726 ft^3/min .

$$1,1,1\text{-Trichloroethane (lb/hr)} = \text{TCE } [\mu\text{g}/\text{m}^3] \times \text{Air Flow Rate } [\text{ft}^3/\text{min}] \times (1 \text{ m}^3/35 \text{ ft}^3) \times (60 \text{ min/hr}) \times (0.000001 \text{ g}/1 \mu\text{g}) \times (0.0022 \text{ lb/g})$$

$$\text{lb/yr} = \text{lb/hr} \times 8,760 \text{ hrs/yr}$$

$$\text{g/s} = \text{lb/hr} \times \text{hr}/3,600 \text{ sec} \times 453.59 \text{ g/lb}$$

(2) Ambient impact based on AERMOD modeling using normalized rate of 1 g/s is scaled to the actual emission rate of the pollutant. Modeling was performed using the representative meteorological data from the nearest station (Brookhaven/Farmingdale) for the years 2011 through 2015. The maximum impact from all the years was used for the calculations.

$$\text{Scaled hourly impact } (\mu\text{g}/\text{m}^3) = \text{AERMOD predicted hourly ambient impact at 1 g/s } ([\mu\text{g}/\text{m}^3]/[\text{g/s}]) \times \text{Actual emission rate}$$

$$\text{Scaled annual impact } (\mu\text{g}/\text{m}^3) = \text{AERMOD predicted annual ambient impact at 1 g/s } ([\mu\text{g}/\text{m}^3]/[\text{g/s}]) \times \text{Actual emission rate}$$

AERMOD Normalized Ambient Impact at 1 g/s	
Hourly ([\mathmu\text{g}/\text{m}^3]/[\text{g/s}])	Annual ([\mathmu\text{g}/\text{m}^3]/[\text{g/s}])
3,153.03	96.49

(3) Short-term and annual guideline concentrations specified in the NYSDEC DAR-1 AGC/SGC tables revised August 10,

Table 10
Concentrations of Volatile Organic Compounds in
Groundwater Samples Collected from Remedial Wells
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Compound ⁽¹⁾ (µg/L)	Sample Location: Sample Date: NYSDEC SCGs	RW-1 8/23/2016	RW-1 12/16/2016	RW-1 3/17/2017	RW-1 6/16/2017
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0
1,1,1,2,2-Tetrachloroethane		< 1.0	< 1.0	< 1.0	< 1.0
1,1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10
4-methyl-2-pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0
Carbon tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0	< 5.0	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	< 1.0	< 1.0	< 1.0	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,3-dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0
Dichloromethane	5	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0
Methyl N-Butyl Ketone	50	< 5.0	< 5.0	< 5.0	< 5.0
Methyl tert-Butyl Ether	5	< 1.0	< 1.0	< 1.0	< 1.0
Styrene	5	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethylene	5	< 1.0	< 1.0	< 1.0	< 1.0
Trichlorofluoromethane (Freon 11)	5	< 2.0	< 2.0	< 2.0	< 2.0
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	< 1.0	< 1.0	< 1.0	< 1.0
Xylene-o	5	< 1.0	< 1.0	< 1.0	< 1.0
Xylenes - m,p	5	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽²⁾		0	0	0	0
Project VOCs⁽³⁾		0	0	0	0
1,4-Dioxane⁽⁴⁾		0.297	0.768	0.758	0.695

Notes and abbreviations on last page.

Table 10
Concentrations of Volatile Organic Compounds in
Groundwater Samples Collected from Remedial Wells
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Compound ⁽¹⁾ (µg/L)	Sample Location: Sample Date: NYSDEC SCGs	RW-2 8/23/2016	RW-2 12/16/2016	RW-2 3/17/2017	RW-2 6/16/2017
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0
1,1,1,2-Tetrachloroethane		< 1.0	< 1.0	< 1.0	< 1.0
1,1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	0.86 J	0.80 J	0.81 J	0.58 J
1,1-Dichloroethene	5	0.23 J	0.21 J	0.37 J	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10
4-methyl-2-pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0
Carbon tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0	< 5.0	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	2.9	2.6	2.5	2.4
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-dichloroethene	5	34.5	26.6	30.9	18.9
cis-1,3-dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0
Dichloromethane	5	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	1.7	1.2	0.78 J	< 1.0
Methyl N-Butyl Ketone	50	< 5.0	< 5.0	< 5.0	< 5.0
Methyl tert-Butyl Ether	5	< 1.0	< 1.0	< 1.0	< 1.0
Styrene	5	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0
Toluene	5	19.7	9.0	2.6	0.41 J
trans-1,2-dichloroethene	5	0.44 J	< 1.0	< 1.0	< 1.0
trans-1,3-dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethylene	5	11.1	12.4	13.6	12.1
Trichlorofluoromethane (Freon 11)	5	< 2.0	< 2.0	< 2.0	< 2.0
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	49.6	38.9	23.9	15.2
Xylene-o	5	0.93 J	0.40 J	0.32 J	< 1.0
Xylenes - m,p	5	1.5	0.69 J	< 1.0	< 1.0
Total VOCs⁽²⁾		123.46	92.8	75.78	49.59
Project VOCs⁽³⁾		118.86	89	72.5	47.19
1,4-Dioxane⁽⁴⁾		1.07	1.72	1.97	1.76

Notes and abbreviations on last page.

Table 10
Concentrations of Volatile Organic Compounds in
Groundwater Samples Collected from Remedial Wells
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Compound ⁽¹⁾ (µg/L)	Sample Location: Sample Date:	RW-3 8/23/2016	RW-3 12/16/2016	RW-3 3/17/2017	RW-3 6/16/2017
	NYSDEC SCGs				
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0
1,1,1,2,2-Tetrachloroethane		< 1.0	< 1.0	< 1.0	< 1.0
1,1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10
4-methyl-2-pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0
Carbon tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	4.0 J	3.2 J	2.9 J	2.8 J
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	2.1	1.8	1.3	1.2
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-dichloroethene	5	1.5	2.1	2.0	1.6
cis-1,3-dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0
Dichloromethane	5	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0
Methyl N-Butyl Ketone	50	< 5.0	< 5.0	< 5.0	< 5.0
Methyl tert-Butyl Ether	5	< 1.0	< 1.0	< 1.0	< 1.0
Styrene	5	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	0.26 J	< 1.0	0.26 J	< 1.0
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethylene	5	1.9	2.4	2.2	2.2
Trichlorofluoromethane (Freon 11)	5	< 2.0	< 2.0	< 2.0	< 2.0
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	< 1.0	< 1.0	< 1.0	< 1.0
Xylene-o	5	< 1.0	< 1.0	< 1.0	< 1.0
Xylenes - m,p	5	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽²⁾		9.76	9.5	8.66	7.8
Project VOCs⁽³⁾		3.66	4.5	4.46	3.8
1,4-Dioxane⁽⁴⁾		0.180	0.662	0.663	0.612

Notes and abbreviations on last page.

Table 10
Concentrations of Volatile Organic Compounds in
Groundwater Samples Collected from Remedial Wells
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Compound ⁽¹⁾ (µg/L)	Sample Location: Sample Date: NYSDEC SCGs	RW-4 8/23/2016	RW-4 12/16/2016	RW-4 3/17/2017	RW-4 6/16/2017
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0
1,1,1,2,2-Tetrachloroethane		< 1.0	< 1.0	< 1.0	< 1.0
1,1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	0.28 J	0.31 J	< 1.0	0.34 J
1,1-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10
4-methyl-2-pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0
Carbon tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	13.8	11.6	8.8	9.3
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	0.28 J	0.29 J	< 1.0	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,3-dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0
Dichloromethane	5	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0
Methyl N-Butyl Ketone	50	< 5.0	< 5.0	< 5.0	< 5.0
Methyl tert-Butyl Ether	5	< 1.0	< 1.0	< 1.0	< 1.0
Styrene	5	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	0.65 J	0.53 J	0.52 J	0.65 J
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethylene	5	0.59 J	0.51 J	0.54 J	0.52 J
Trichlorofluoromethane (Freon 11)	5	< 2.0	< 2.0	< 2.0	< 2.0
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	< 1.0	< 1.0	< 1.0	< 1.0
Xylene-o	5	< 1.0	< 1.0	< 1.0	< 1.0
Xylenes - m,p	5	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽²⁾		15.6	13.24	9.86	10.81
Project VOCs⁽³⁾		1.52	1.35	1.06	1.51
1,4-Dioxane⁽⁴⁾		< 0.10 U	0.284	0.238	0.227

Notes and abbreviations on last page.

Table 10
Concentrations of Volatile Organic Compounds in
Groundwater Samples Collected from Remedial Wells
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Notes and Abbreviations:

- (1) Water samples collected by Arcadis on the dates shown and submitted to a NYSDOH ELAP certified laboratory for VOC analyses per NYSDEC ASP 2005, Method OLM 4.3 (prior to September 1, 2014) and per USEPA Method 8260C (after September 1, 2014). Results validated following protocols specified in Sampling and Analysis Plan in the DRAFT Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). See previous quarterly reports for historical analytical results.
- (2) "Total VOCs" represents the sum of individual concentrations of the VOCs detected.
- (3) "Project VOCs" represents the sum of individual compound concentrations of 1,1,1-trichloroethane; 1,1-dichloroethane; 1,2-dichloroethane; 1,1-dichloroethene; tetrachloroethene; trichloroethene; vinyl chloride; cis-1,2-dichloroethene; trans-1,2-dichloroethene; benzene; toluene; and xylenes-o,m, and p.
- (4) Samples collected during Second and Third Quarters 2016 were analyzed for 1,4-Dioxane using USEPA Method 8270D SIM. Samples collected during Fourth Quarter 2016, First Quarter 2017 and Second Quarter 2017 were analyzed for 1,4-Dioxane using USEPA Method 522.


Indicates an exceedance of an SCG.

- 700** Bold data indicates a detection.
- ASP analytical services protocol
- ELAP Environmental Laboratory Approval Program
- NYSDEC New York State Department of Environmental Conservation.
- NYSDOH New York State Department of Health
- SCGs standards, criteria, and guidance values
- SIM selected ion monitoring
- VOC volatile organic compound
- µg/L micrograms per liter
- not analyzed
- NE not established
- J Compound detected below its reporting limit; value is estimated.
- < 5 Compound not detected above its laboratory quantification limit.

FIGURES



CITY:SYRACUSE,NY DIV:GROUP:ENV DB:A.SANCHEZ LD: PIC:(Op) PM:(Reop) TM:(Op) LVR:(Op)ON:"OFF"REF: G:\ENV\CAD\STRACUSE\ACT\1001496114\DOMINANT\1496_BUI.dwg LAYOUT: BETHPAGE PARK. SAVED: 11/11/2015 4:51 PM ACADVER: 19.1.S (LMS TECH) PAGES: 19. PAGESETUP: PLOTSTYLETABLE: PLOTTED: 11/11/2015 4:54 PM BY: STOWELL,GARY

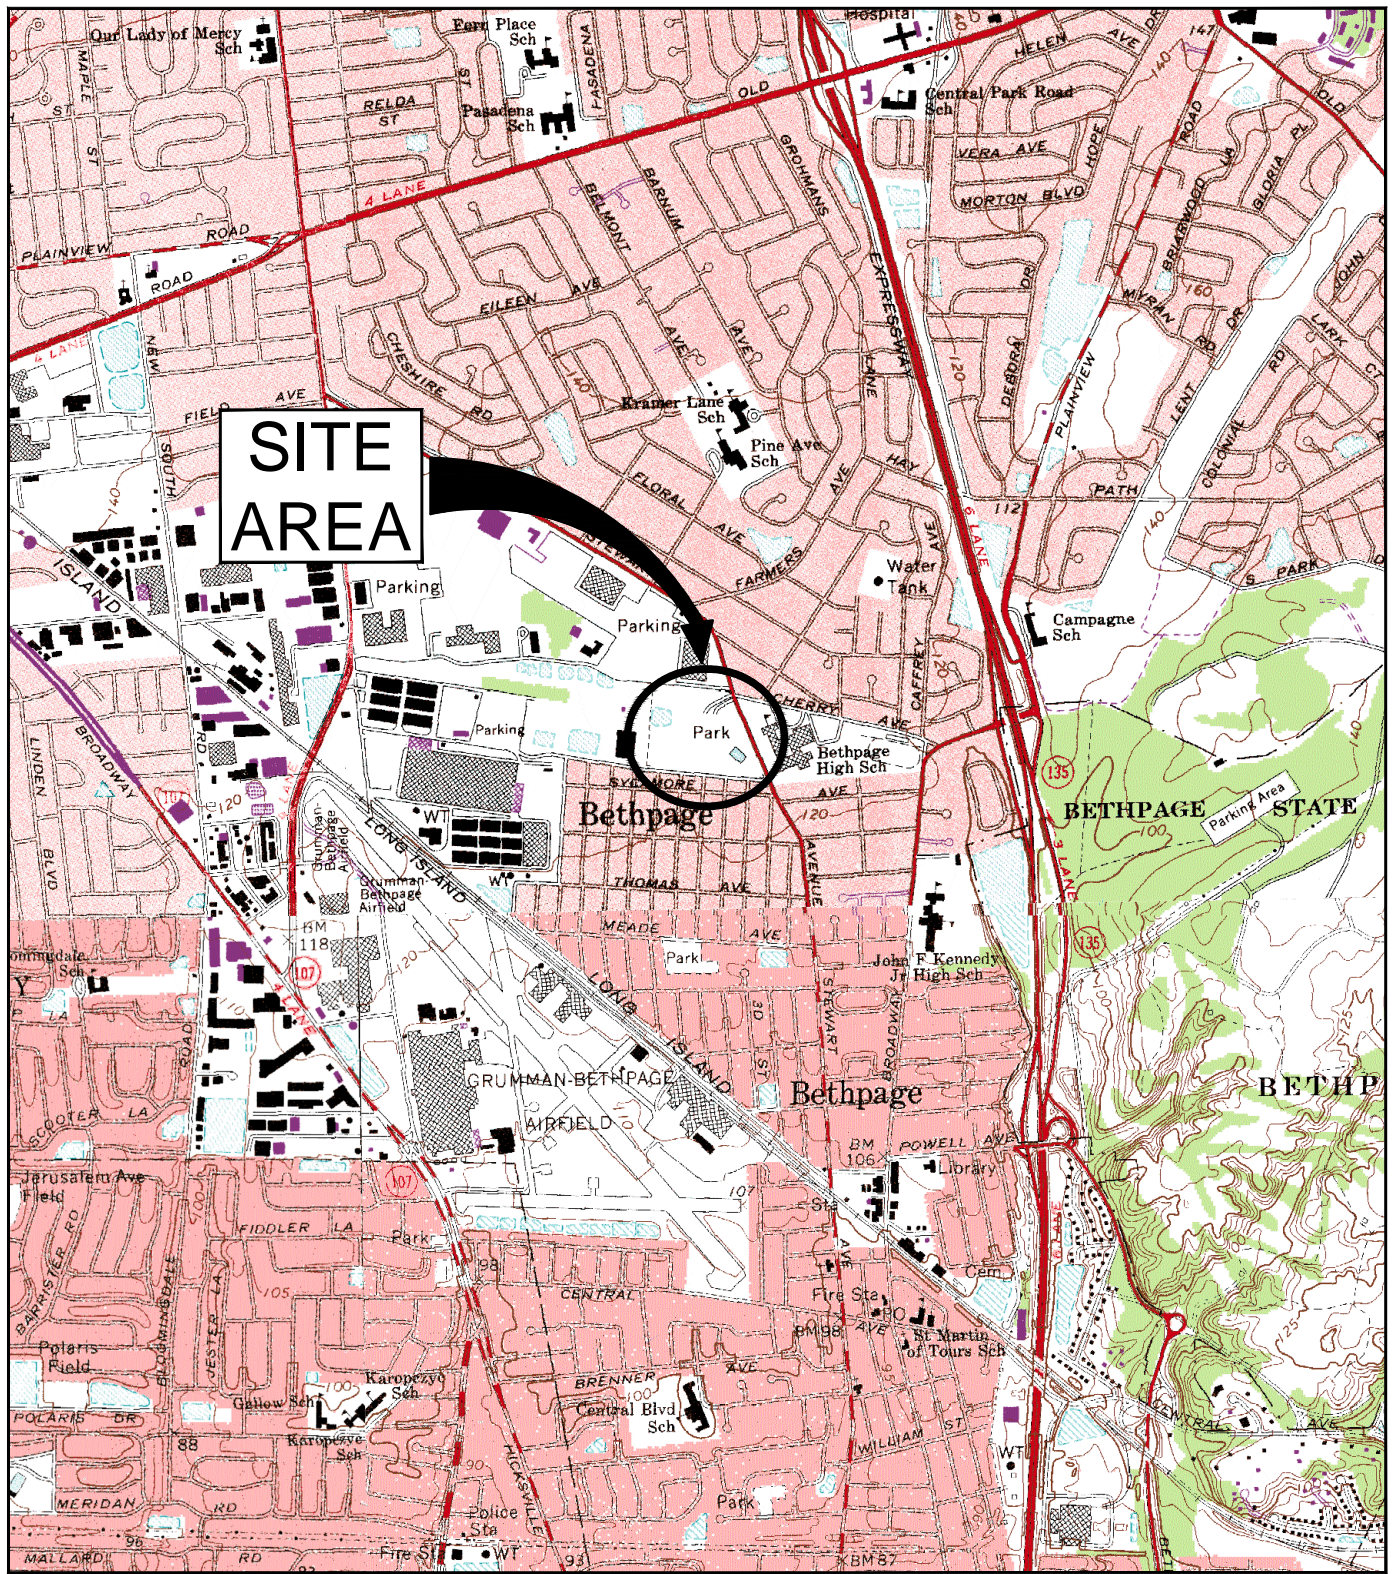


SOURCE: USGS 7.5 MIN. AMITYVILLE QUADRANGLE, AMITYVILLE, N.Y., 1994, FREEPORT QUADRANGLE, FREEPORT, N.Y., 1994, HICKSVILLE QUADRANGLE, HICKSVILLE, N.Y., 1967, PHOTOREVISED 1979, HUNTINGTON, N.Y., 1967, PHOTOREVISED 1979



<p>BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM OPERABLE UNIT 3 (FORMER GRUMMAN SETTLING PONDS) BETHPAGE, NEW YORK</p>	
<p>SITE LOCATION</p>	
	<p>Design & Consultancy for natural and built assets</p>
<p>FIGURE</p>	<p>1</p>

CITY:SYRACUSE-NY DIV:GROUP:ENV DBA:SANCHEZ LD:AS PIC:(Op) PM:(Rep) TM:(Op) LVR:(Op)N="OFF=REF" G:\ENVCAD\SYRACUSE\ACT\NY00498\1410MM\41198B01.DWG LAYOUT:2 SAVED: 11/11/2015 4:26 PM ACADVER: 19.1S (LMS TECH) PAGES: 19 PAGES: 19 PLOTSTYLETABLE: ... PLOTTED: 11/11/2015 4:54 PM BY: STOWELL, GARY XREFS: IMAGES: PROJECTNAME: ...

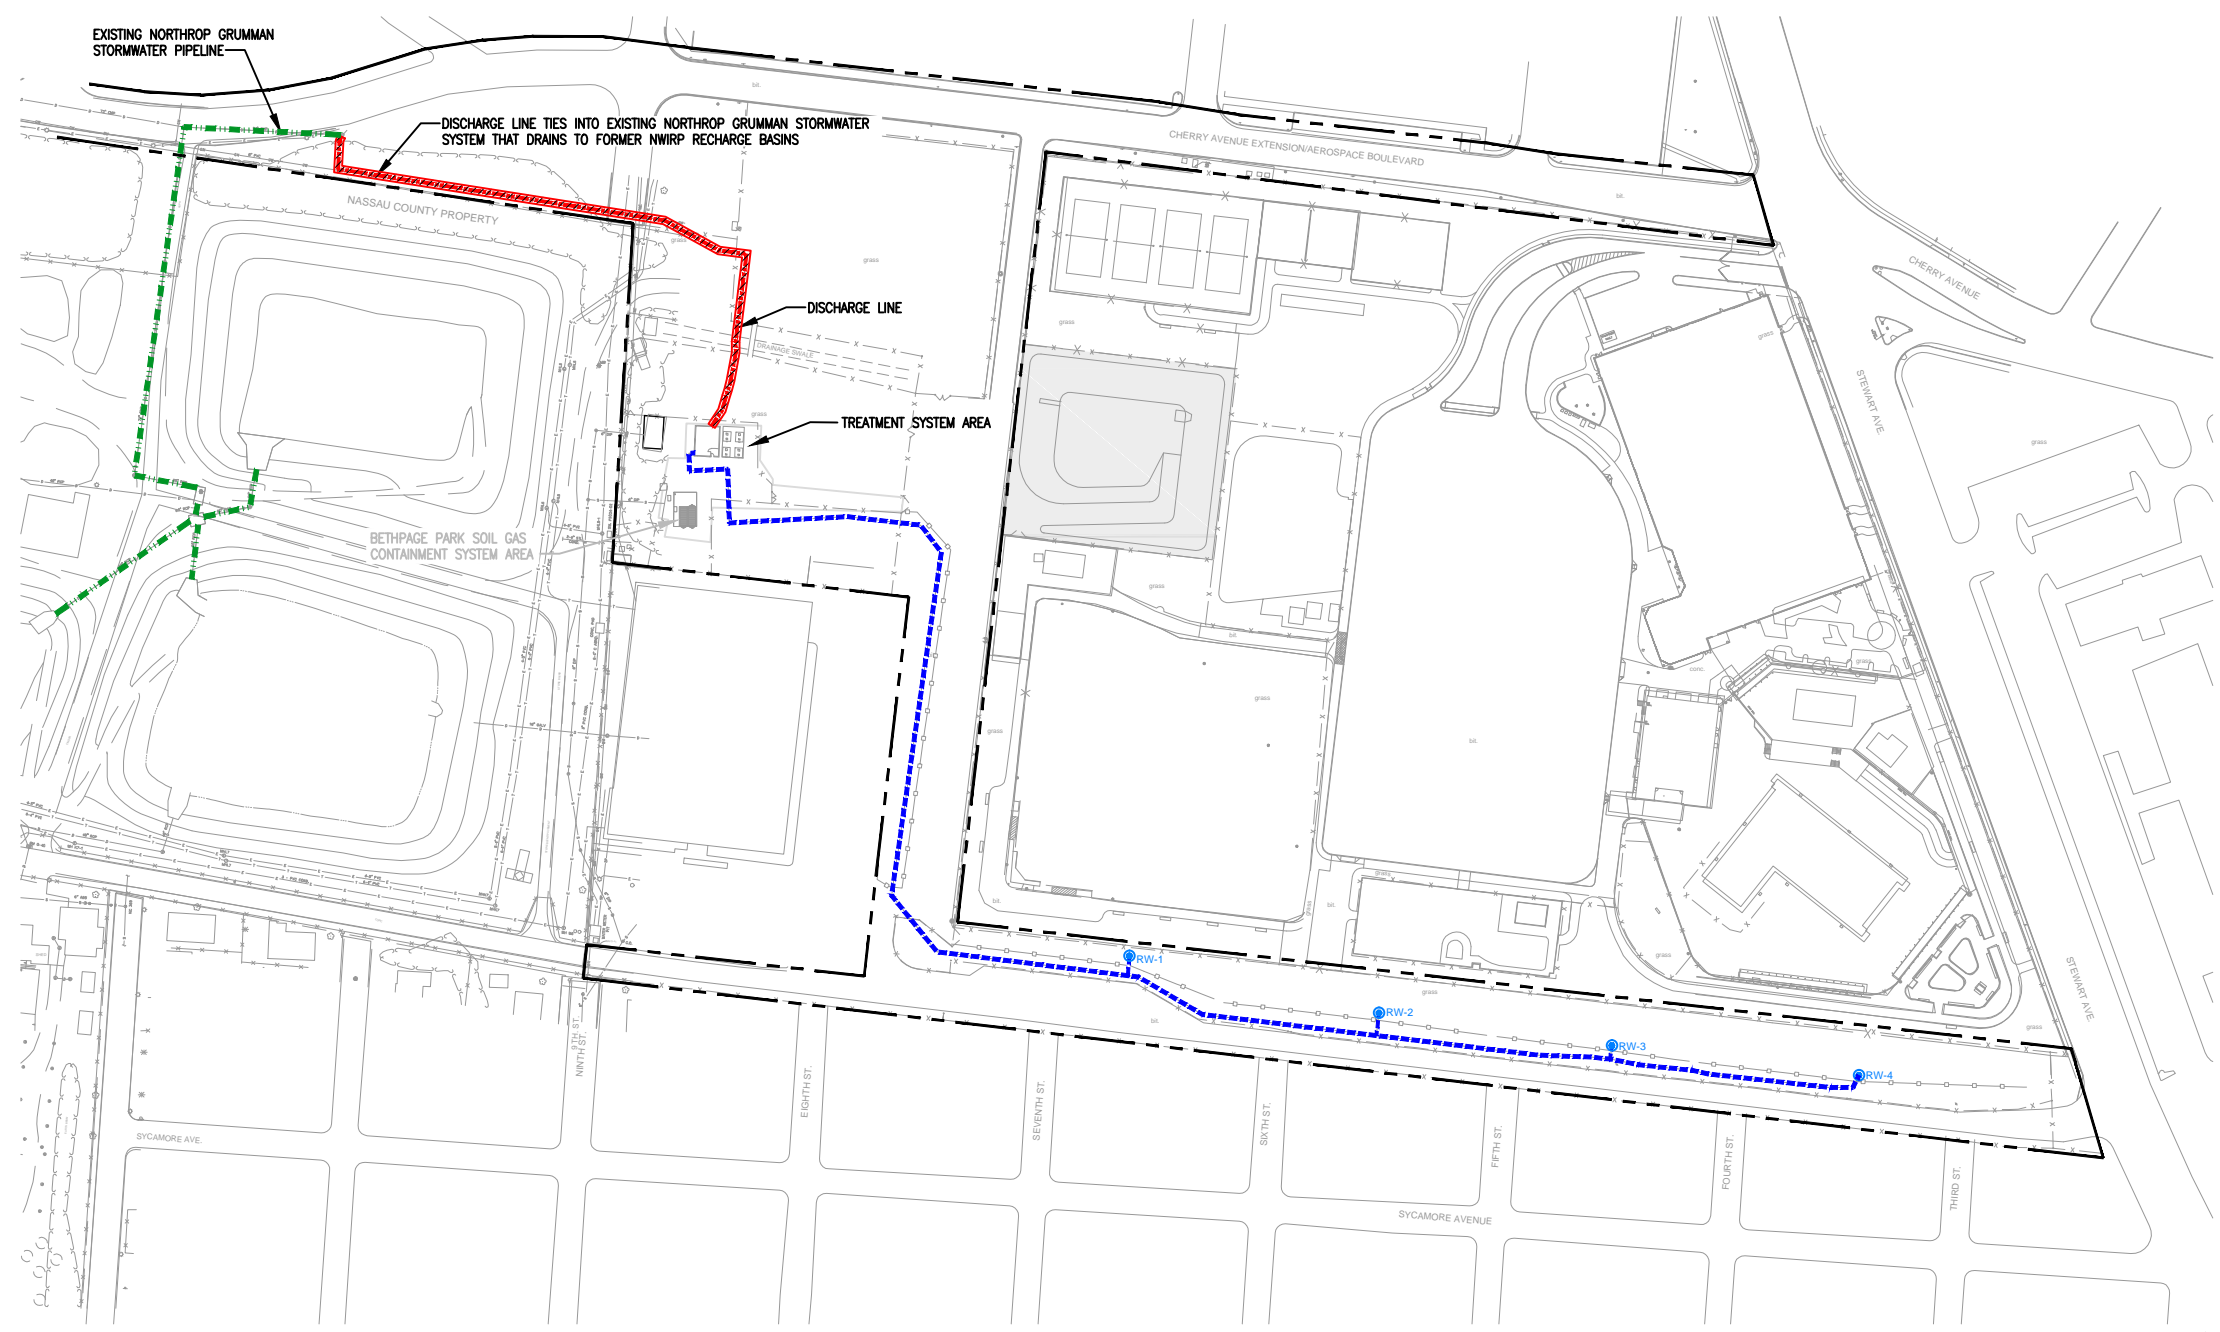

- LEGEND:**
- NORTHROP GRUMMAN PROPERTY LINE
 - - - - - FENCE
 - bit. BITUMINOUS PAVEMENT
 - INFLUENT PIPELINE AND ELECTRICAL CONDUITS
 - EFFLUENT PIPELINE
 - EXISTING NORTHROP GRUMMAN STORMWATER PIPELINE
 - RW-4 REMEDIAL WELL
 - NWIRP NAVAL WEAPONS INDUSTRIAL RESERVE PLANT (NOW OWNED BY NASSAU COUNTY)




BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM
OPERABLE UNIT 3
(FORMER GRUMMAN SETTLING PONDS)
BETHPAGE, NEW YORK

**GROUNDWATER CONTAINMENT
SYSTEM SITE PLAN**

ARCADIS Design & Consultancy
for natural and built assets

FIGURE
2


CITY:SYRACUSE,NY DIV:GROUPE:ENV DB:A,SANCHEZ,LD:AS PIC:(Opt) PM:(Ref) LVR:(OPTION) OFF=REF*
 \arcadis-us.com\office\data\Syracuse-NY\ENV\CAD\SYRACUSE\ACT\NY\001496114\OMM\IN\NY1496D02.dwg LAYOUT: 3 SAVED: 11/11/2015 2:57 PM ACADVER: 19.1S (LMS TECH) PAGES: 3 PLOTSTYLETABLE: ... PLOTSETUP: ... PLOTTED: 5/13/2016 12:13 PM BY: HARRIS, JESSICA
 XREFS: IMAGES: PROJECTNAME: ...

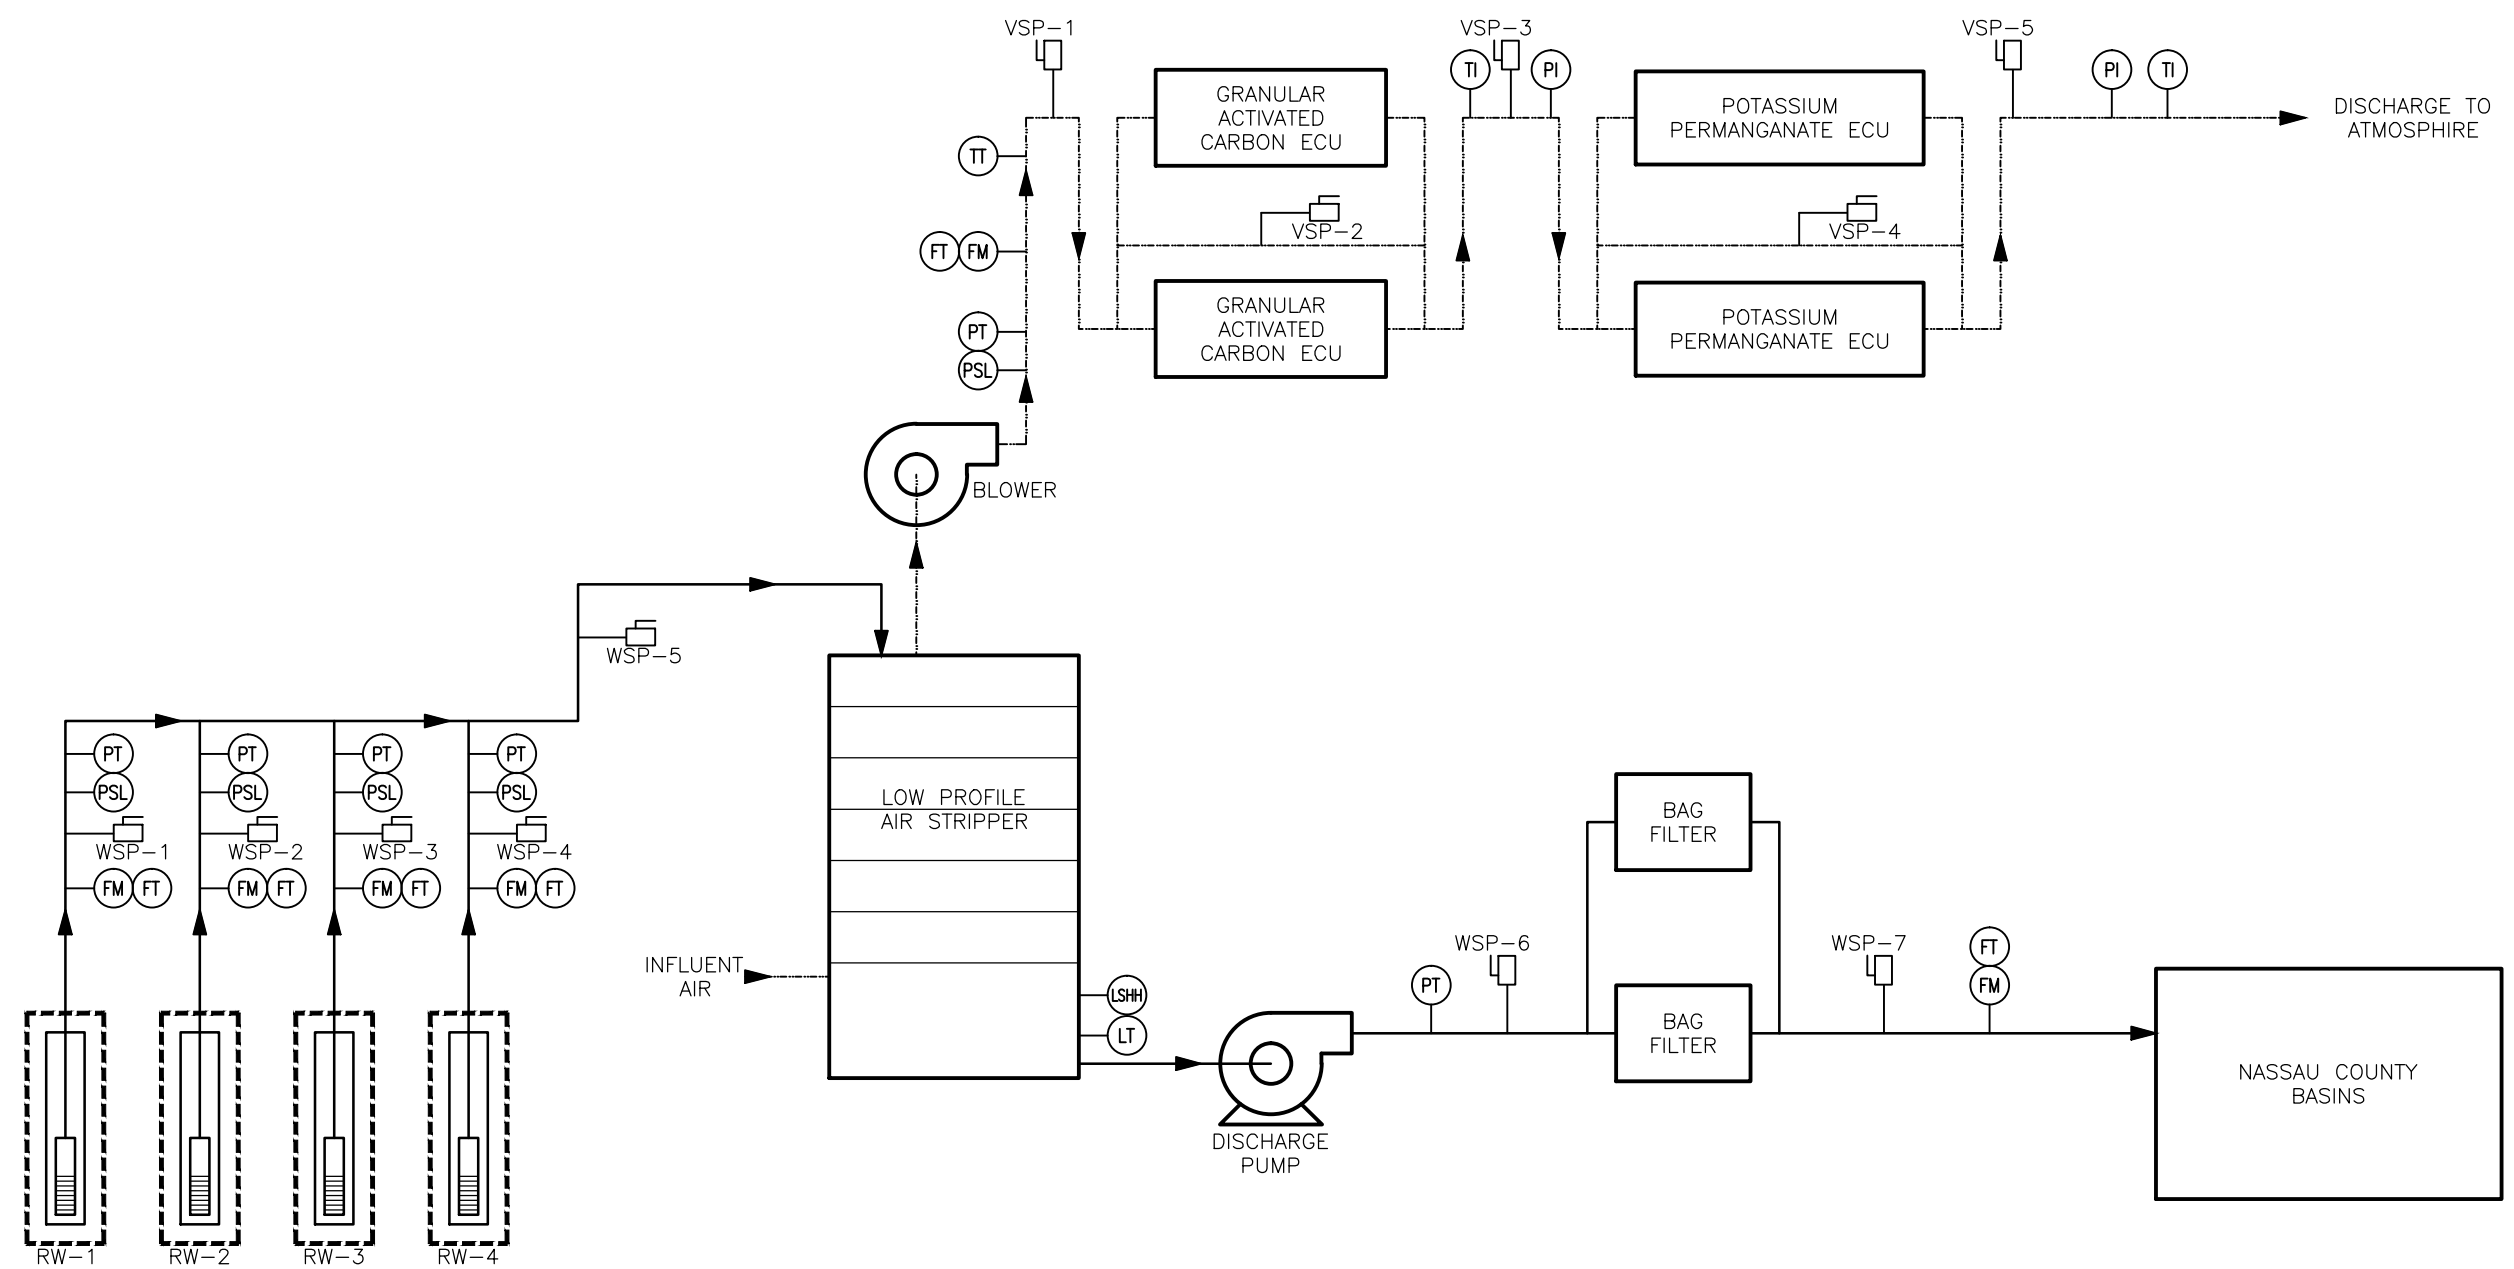

- LEGEND:**
- PROCESS WATER
 - - - PROCESS AIR
 - ⊗ FM INSTRUMENT
 - SAMPLE PORT
 - ▶ FLOW DIRECTION
 - FM FLOW METER
 - FT FLOW RATE TRANSMITTER
 - PSL PRESSURE SWITCH LOW
 - PT PRESSURE TRANSMITTER
 - PI PRESSURE INDICATOR
 - LSHH LEVEL SWITCH HIGH HIGH
 - LT LEVEL TRANSMITTER
 - TT TEMPERATURE TRANSMITTER
 - TI TEMPERATURE INDICATOR
 - WSP WATER SAMPLE PORT
 - VSP VAPOR SAMPLE PORT
 - ECU EMISSION CONTROL UNIT

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM
 OPERABLE UNIT 3
 (FORMER GRUMMAN SETTLING PONDS)
 BETHPAGE, NEW YORK

**GROUNDWATER TREATMENT SYSTEM
 PROCESS SCHEMATIC AND
 MONITORING LOCATIONS**

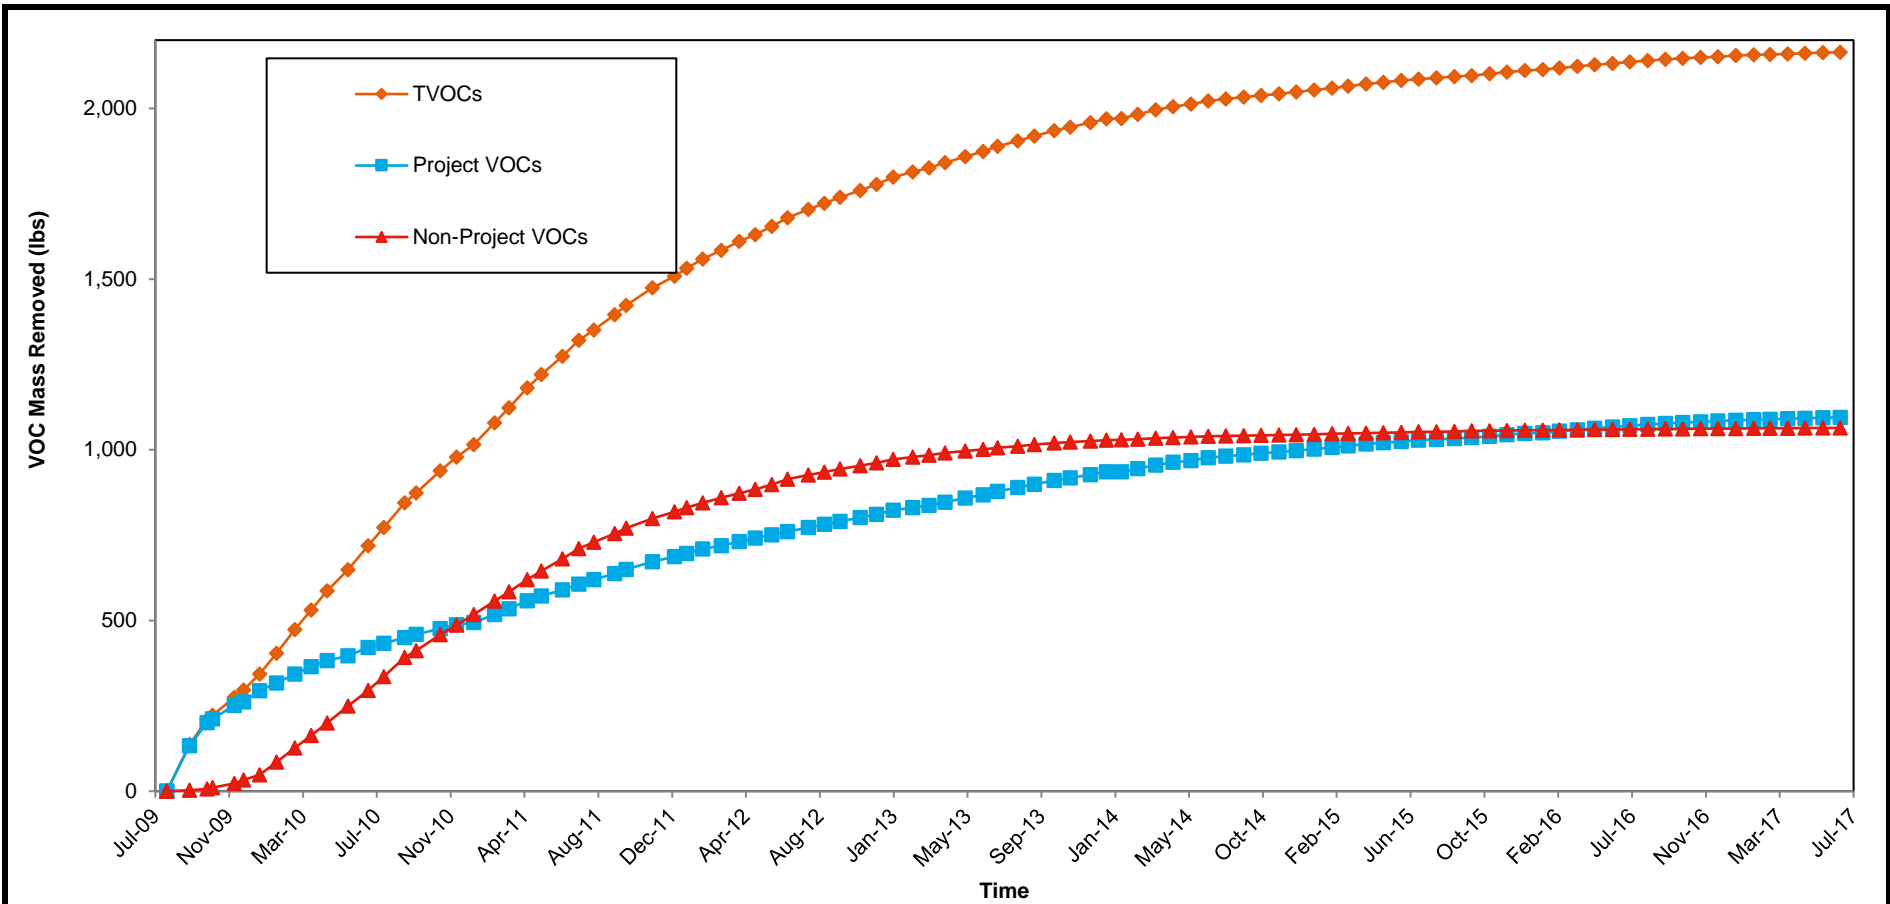

Notes:

VOC = volatile organic compound

lbs = pounds

TVOCs = total VOCs detected

Project VOCs = sum of 1,1,1-trichloroethane; 1,1-dichloroethane; 1,2-dichloroethane; 1,1-dichloroethene; tetrachloroethene; trichloroethene; vinyl chloride; cis-1,2-dichloroethene; trans-1,2-dichloroethene; benzene; toluene; and total xylenes.


Non-Project VOCs = sum of VOCs that are not Project VOCs.

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM
 OPERABLE UNIT 3
 (FORMER GRUMMAN SETTLING PONDS)
 BETHPAGE, NEW YORK

**CUMULATIVE TOTAL, PROJECT, AND
 NON-PROJECT VOC MASS REMOVED
 THROUGH
 JUNE 2017**



FIGURE
5

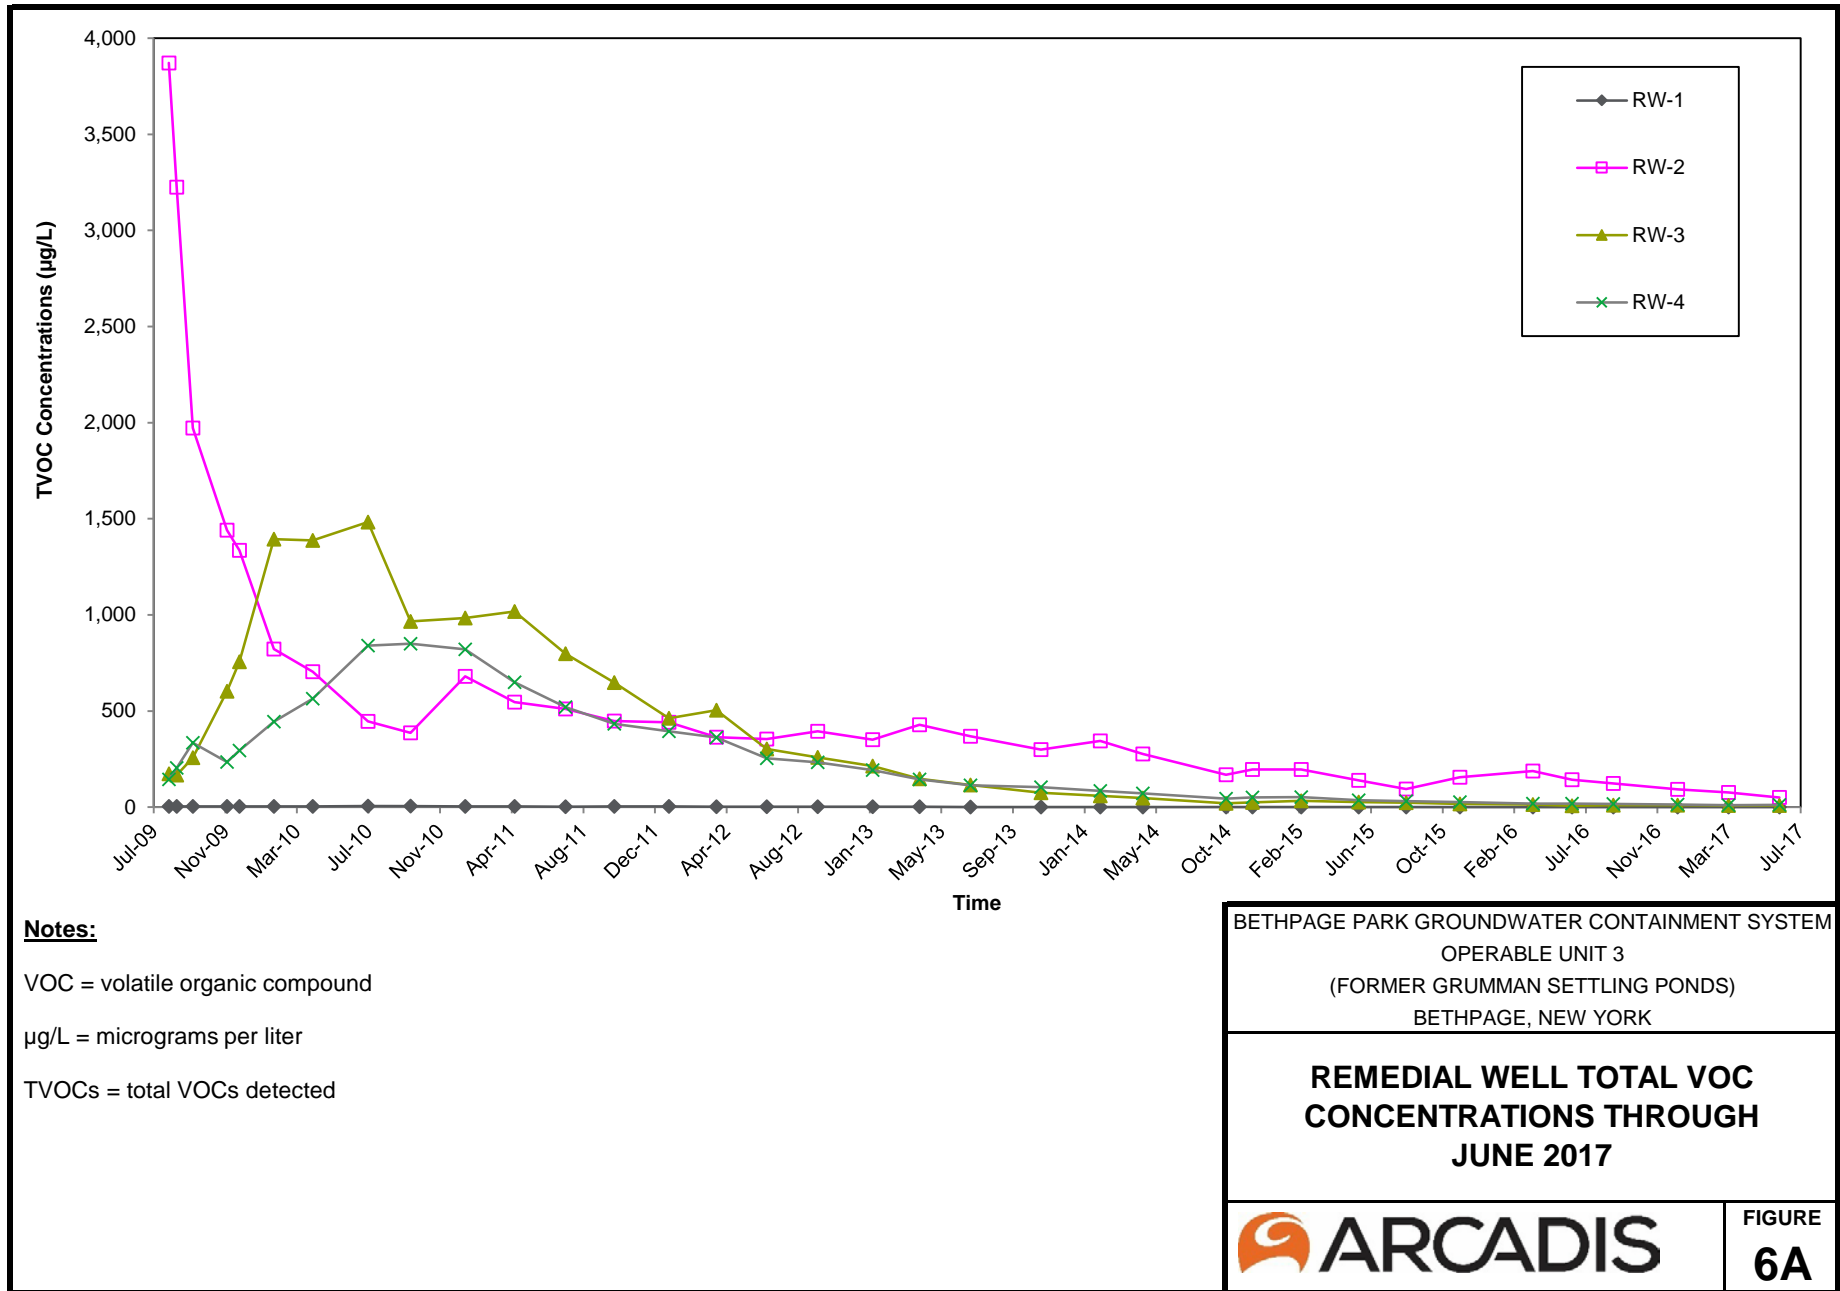

Notes:

VOC = volatile organic compound

µg/L = micrograms per liter


TVOCs = total VOCs detected

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM
 OPERABLE UNIT 3
 (FORMER GRUMMAN SETTLING PONDS)
 BETHPAGE, NEW YORK

**REMEDIAL WELL TOTAL VOC
 CONCENTRATIONS THROUGH
 JUNE 2017**



FIGURE
6A

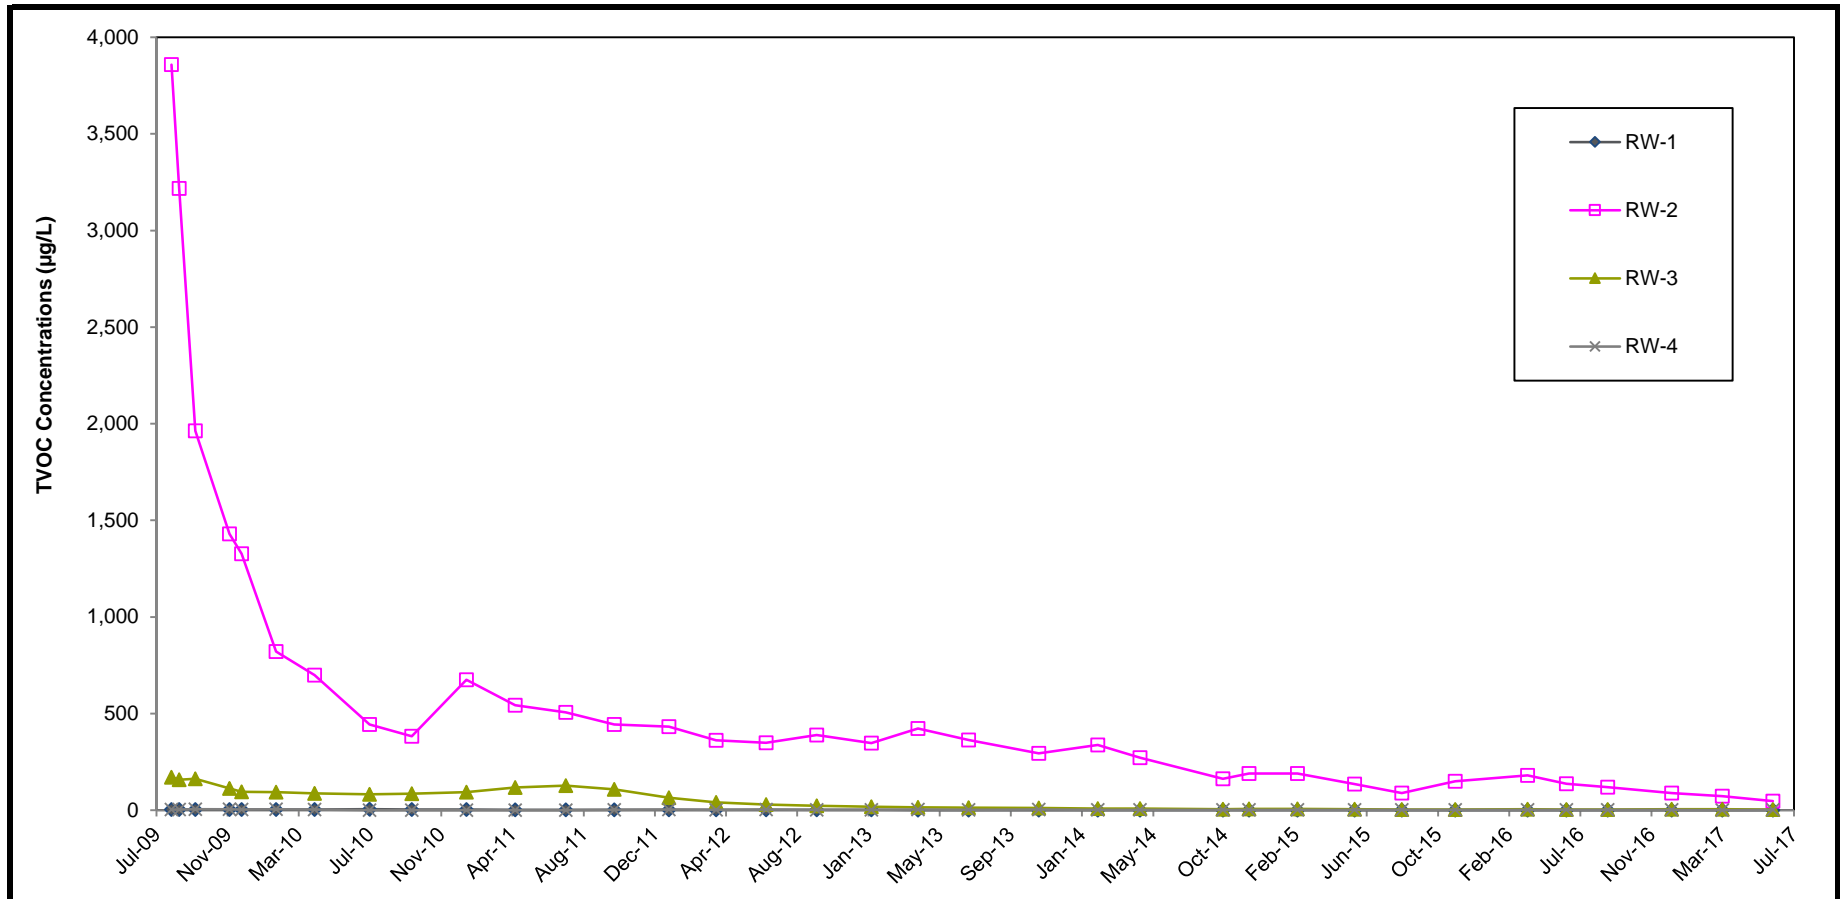

Notes:

VOC = volatile organic compound

µg/L = micrograms per liter

TVOCs = total VOCs detected


Project VOCs = sum of 1,1,1-trichloroethane; 1,1-dichloroethane; 1,2-dichloroethane; 1,1-dichloroethene; tetrachloroethene; trichloroethene; vinyl chloride; cis-1,2-dichloroethene; trans-1,2-dichloroethene; benzene; toluene and total xylenes.

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM
 OPERABLE UNIT 3
 (FORMER GRUMMAN SETTLING PONDS)
 BETHPAGE, NEW YORK

**REMEDIAL WELL PROJECT VOC
 CONCENTRATIONS THROUGH
 JUNE 2017**



FIGURE
6B

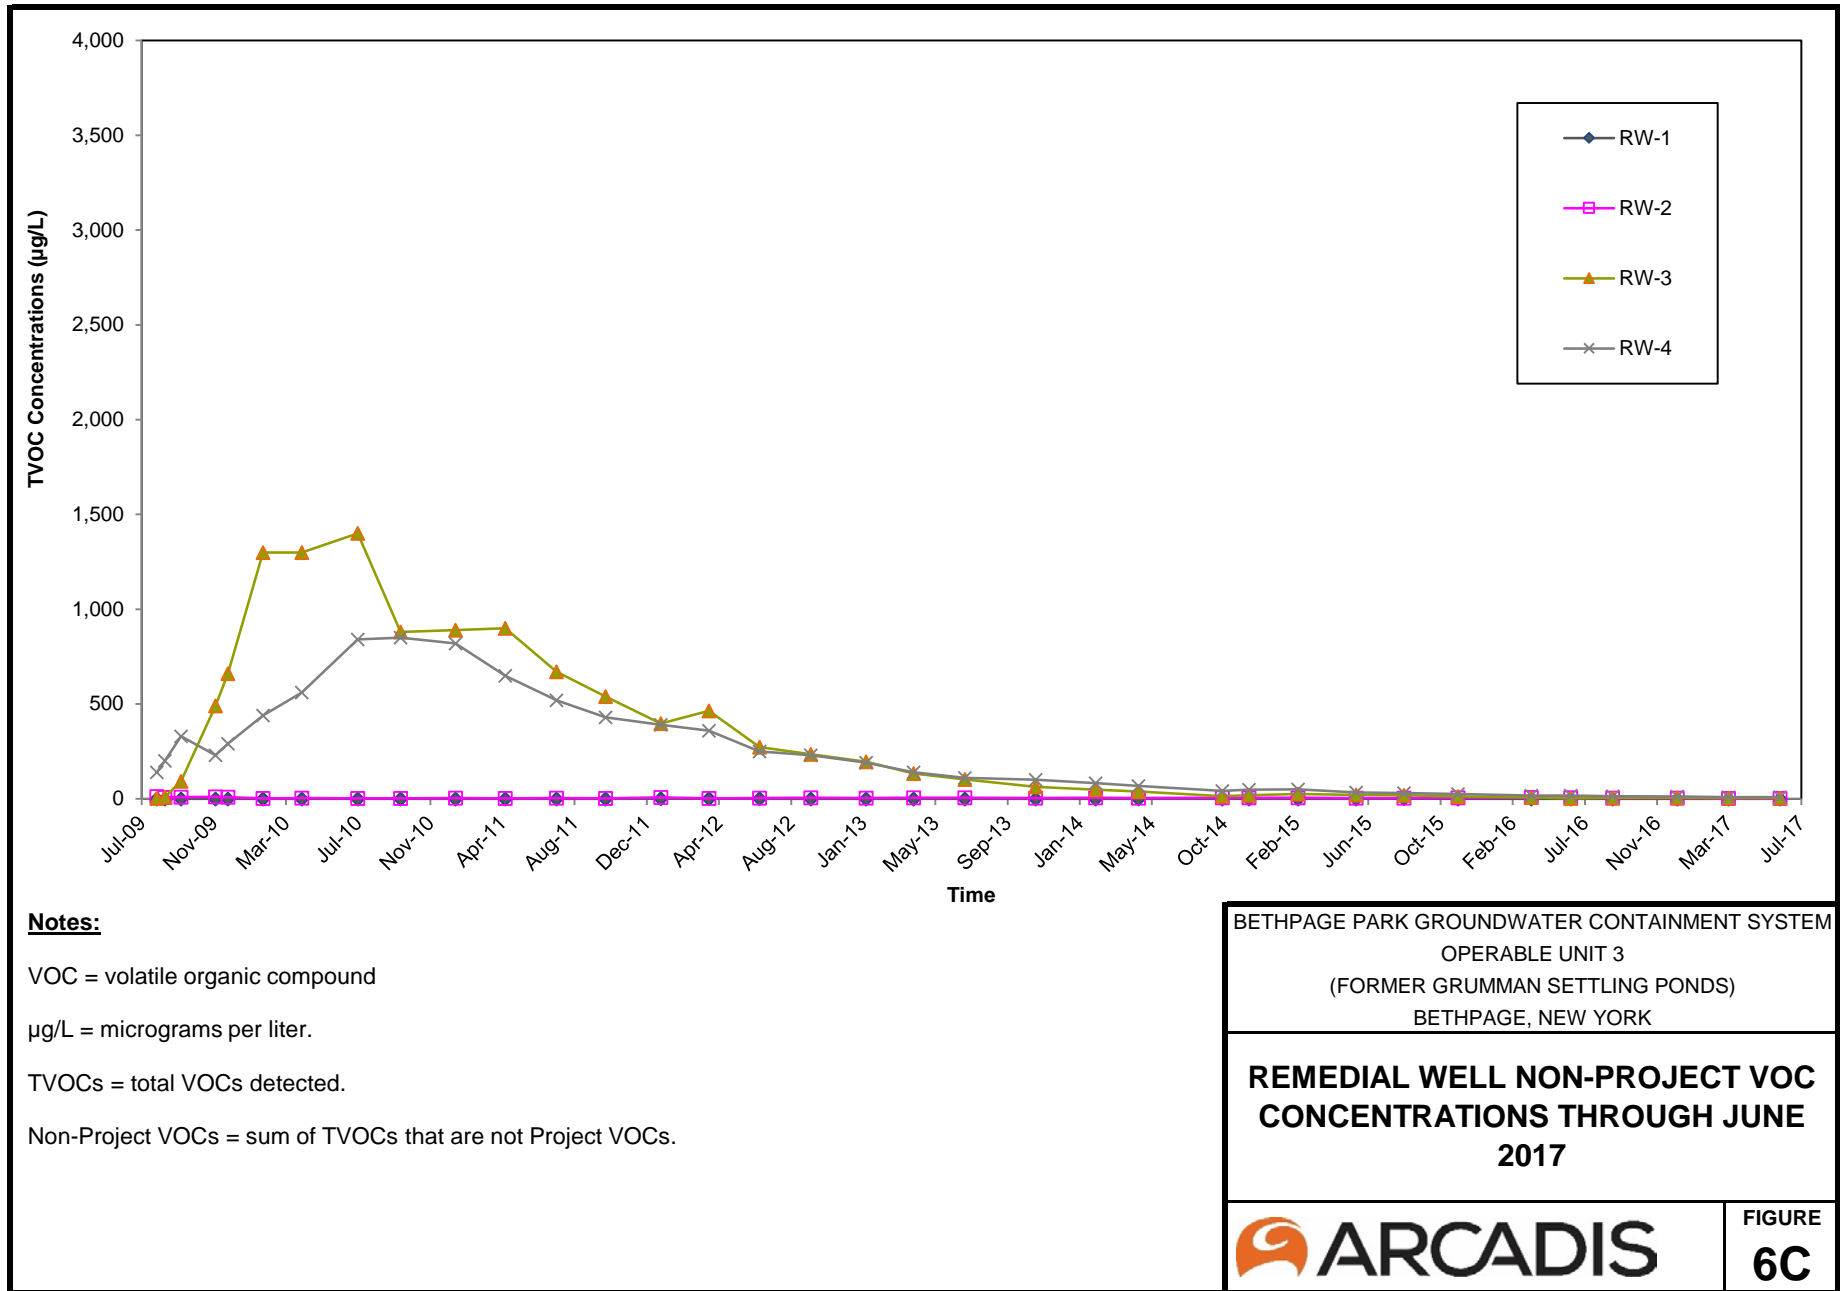

Notes:

VOC = volatile organic compound

µg/L = micrograms per liter.

TVOCs = total VOCs detected.


Non-Project VOCs = sum of TVOCs that are not Project VOCs.

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM
 OPERABLE UNIT 3
 (FORMER GRUMMAN SETTLING PONDS)
 BETHPAGE, NEW YORK

**REMEDIAL WELL NON-PROJECT VOC
 CONCENTRATIONS THROUGH JUNE
 2017**



FIGURE
6C

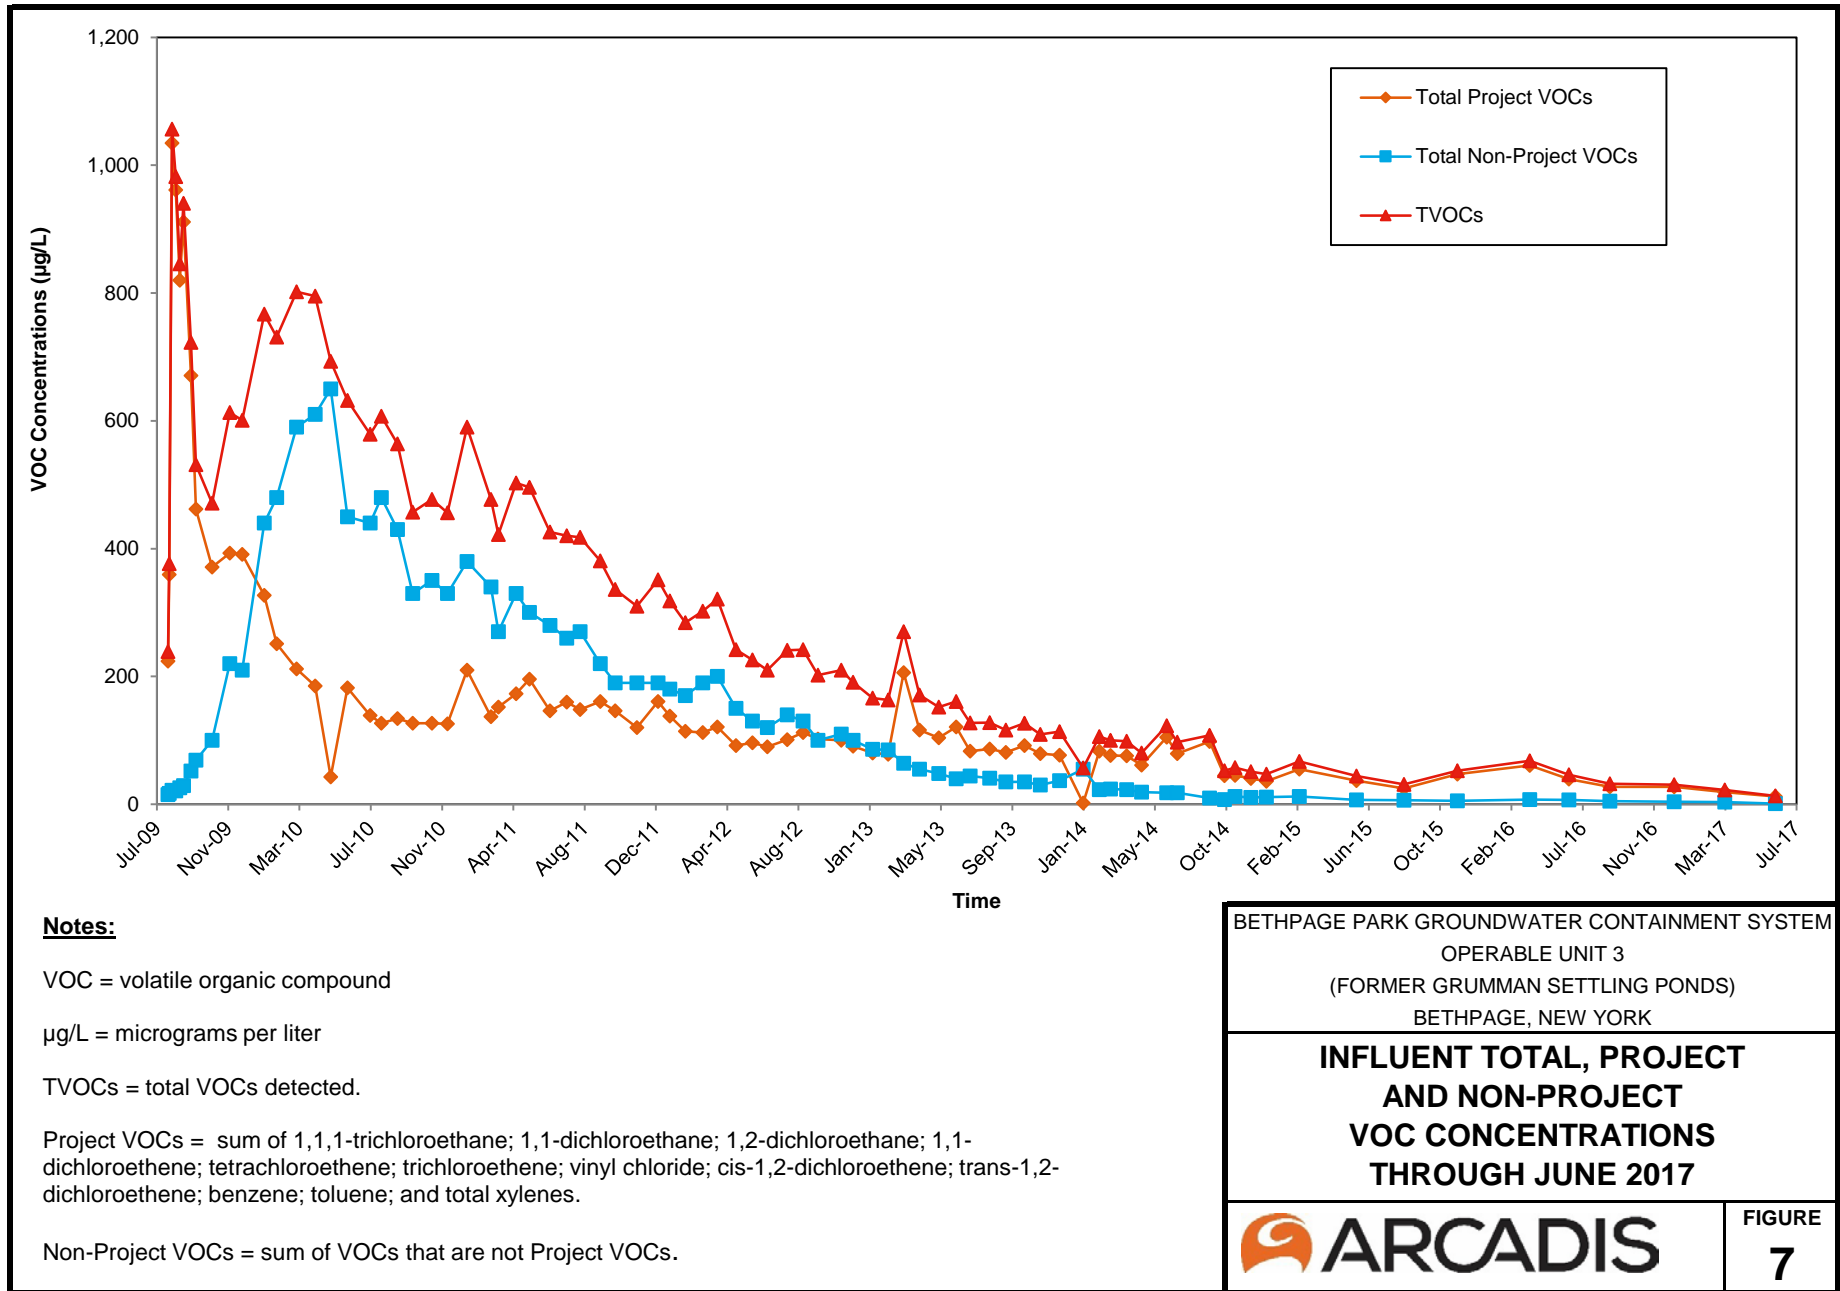

Notes:

VOC = volatile organic compound

µg/L = micrograms per liter

TVOCs = total VOCs detected.

Project VOCs = sum of 1,1,1-trichloroethane; 1,1-dichloroethane; 1,2-dichloroethane; 1,1-dichloroethene; tetrachloroethene; trichloroethene; vinyl chloride; cis-1,2-dichloroethene; trans-1,2-dichloroethene; benzene; toluene; and total xylenes.


Non-Project VOCs = sum of VOCs that are not Project VOCs.

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM
 OPERABLE UNIT 3
 (FORMER GRUMMAN SETTLING PONDS)
 BETHPAGE, NEW YORK

**INFLUENT TOTAL, PROJECT
 AND NON-PROJECT
 VOC CONCENTRATIONS
 THROUGH JUNE 2017**



FIGURE
7

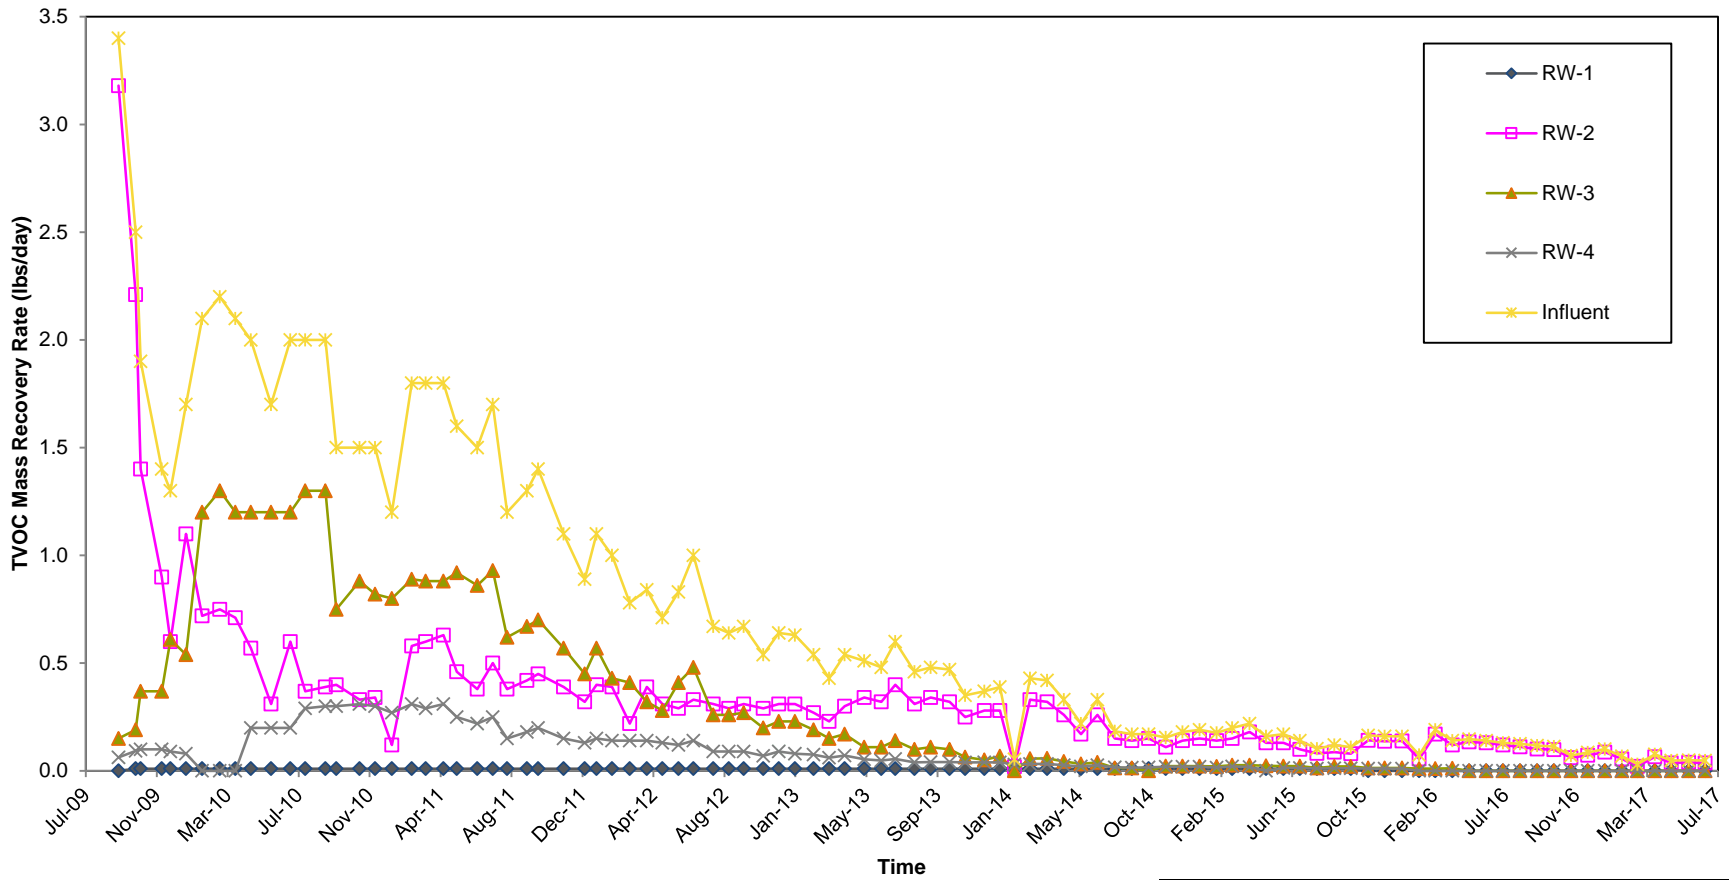

Notes:

VOC = volatile organic compound

lbs/day = pounds per day


TVOCs = total VOCs detected

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM
 OPERABLE UNIT 3
 (FORMER GRUMMAN SETTLING PONDS)
 BETHPAGE, NEW YORK

**TOTAL VOC MASS RECOVERY RATES
 THROUGH
 JUNE 2017**



FIGURE
8A

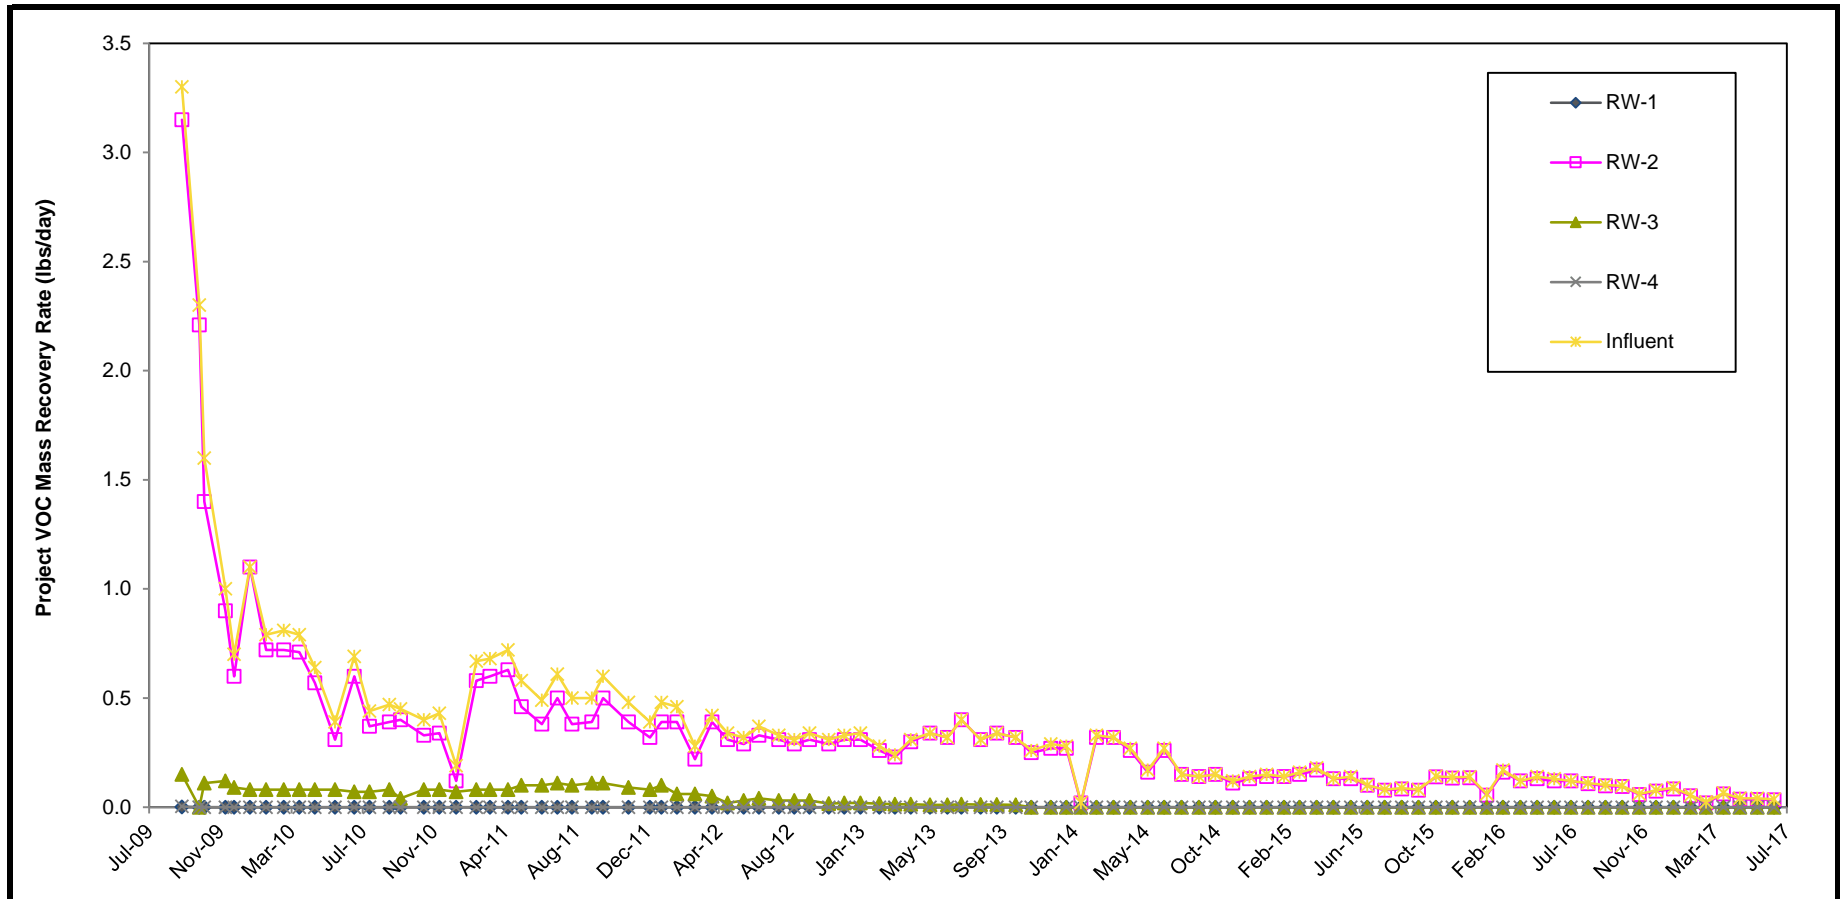

Notes:

VOC = volatile organic compound

lbs/day = pounds per day.

Project VOCs = Sum of 1,1,1-trichloroethane; 1,1-dichloroethane; 1,2-dichloroethane; 1,1-dichloroethene; tetrachloroethene; trichloroethene; vinyl chloride; cis-1,2-dichloroethene; trans-1,2-dichloroethene; benzene; toluene; and total xylenes


Time

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM
 OPERABLE UNIT 3
 (FORMER GRUMMAN SETTLING PONDS)
 BETHPAGE, NEW YORK

**PROJECT VOC MASS RECOVERY
 RATES THROUGH
 JUNE 2017**



FIGURE
8B

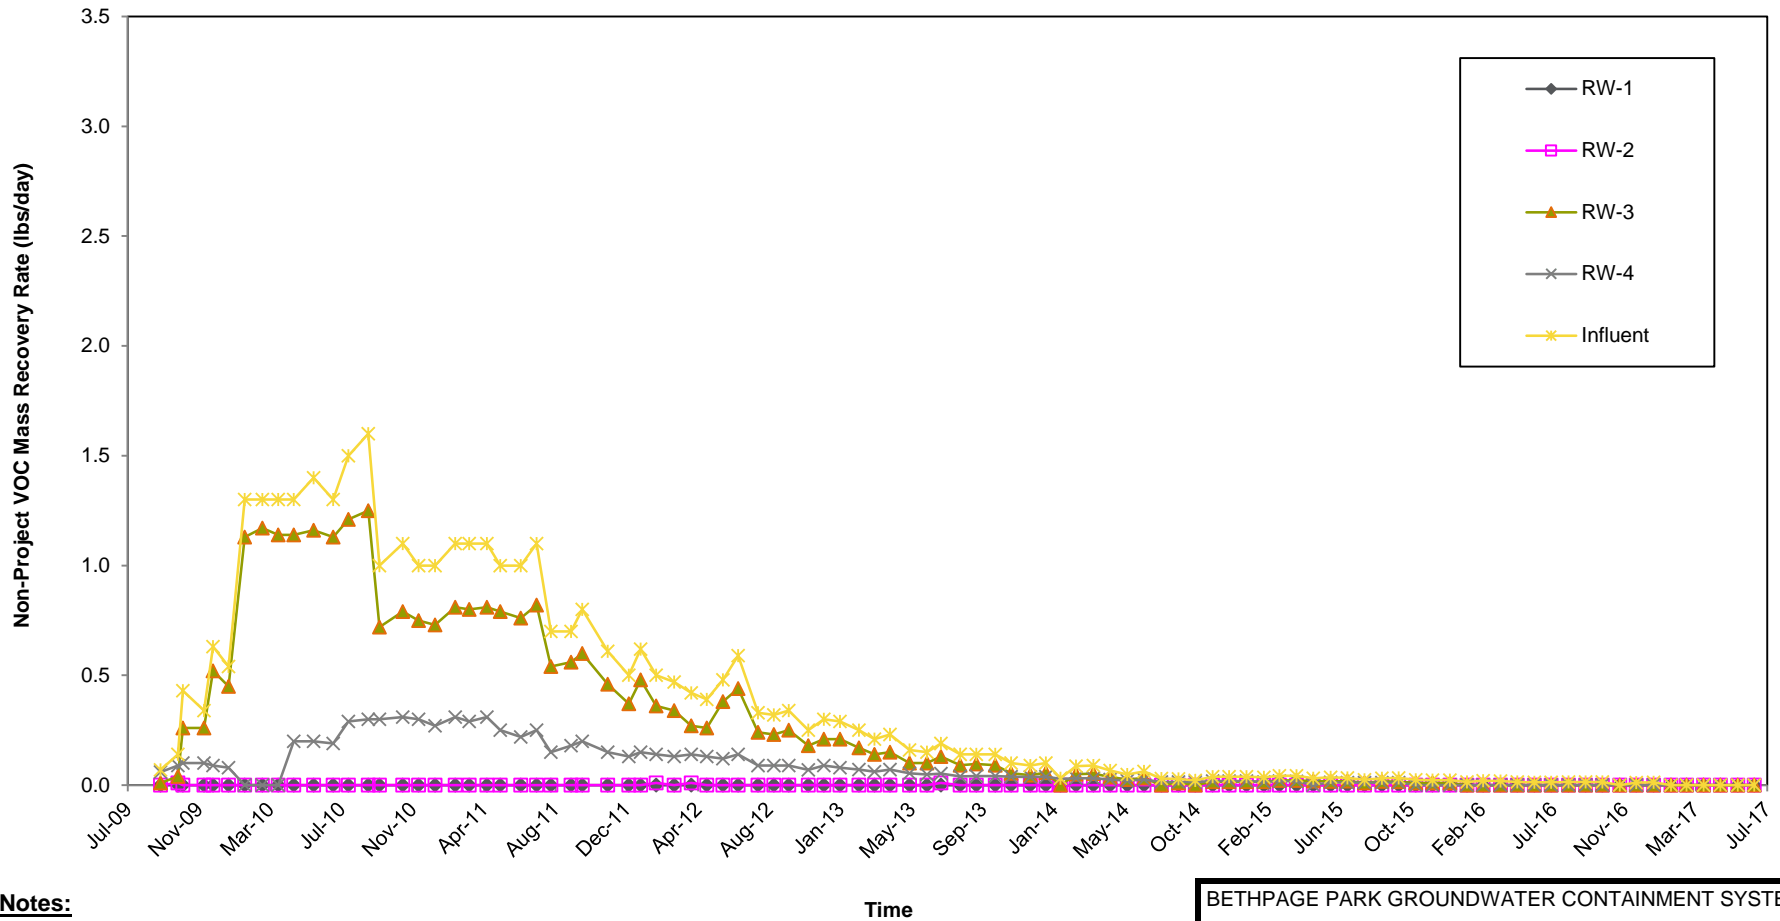

Notes:

VOC = volatile organic compound

lbs/day = pounds per day

Non-Project VOCs = sum of VOCs that are not Project VOCs.

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM
 OPERABLE UNIT 3
 (FORMER GRUMMAN SETTLING PONDS)
 BETHPAGE, NEW YORK

**NON-PROJECT VOC MASS RECOVERY
 RATES THROUGH
 JUNE 2017**



FIGURE
8C