

Mr. Jason Pelton
Project Manager
New York State Department of Environmental Conservation
Remedial Bureau D
625 Broadway
Albany, NY 12233-7015

Arcadis of New York, Inc.
Two Huntington
Quadrangle
Suite 1S10
Melville
New York 11747
Phone: 631 249 7600
Fax: 631 249 7610
www.arcadis.com

Date: March 31, 2021

Our Ref: 30059266

Subject: 2020 Annual Summary Report - System Operation and Monitoring,
Bethpage Park Groundwater Containment System (BPGWCS),
Operable Unit 3 (Former Grumman Settling Ponds),
Bethpage, New York, NYSDEC Site #1-30-003A.

Dear Jason,

Enclosed is one electronic PDF copy of the 2020 Annual Summary Report for the BPGWCS operation and monitoring, performed in accordance with the NYSDEC-approved OU3 Groundwater IRM OM&M Manual (Arcadis 2009) and the NYSDEC-approved Sampling and Analysis Plan (SAP; Arcadis 2009). As we have transitioned to electronic submittals (via PDF) in line with NYSDEC's paper reduction program, hard copies of the report can be provided on request.

If you have any questions, please do not hesitate to contact me.

Sincerely,
Arcadis of New York, Inc.



Christopher Engler, PE New York PE-069748
Vice President

Email: Christopher.Engler@arcadis.com

Direct Line: 315.409.6579

CC. Edward Hannon, Northrop Grumman
Donald Hesler, NYSDEC
Jim Sullivan, NYS Dept. of Health
Donald Irwin, Nassau County Dept. of Health
Robin Putnam, Nassau County Dept. of Health
Richard Castle, Nassau County Dept. of Health
Carlo San Giovanni, Arcadis
Nidal Azzam, USEPA
Carol Stein, USEPA
Public Repository
File

Northrop Grumman

2020 ANNUAL OPERATION, MAINTENANCE, AND MONITORING REPORT

Operable Unit 3 – Groundwater

Bethpage, New York

NYSDEC ID # 1-30-003A

March 31, 2021

2020 Annual Operation, Maintenance, and Monitoring Report

Operable Unit 3 – Groundwater

March 31, 2021

Prepared By:

Arcadis of New York, Inc.
Two Huntington Quadrangle, Suite 1S10
Melville
New York 11747
Phone: 631 249 7600
Fax: 631 249 7610

Prepared For:

Northrop Grumman

Our Ref:

30059266



Arnas Nemickas
Project Manager



Christopher Engler, PE
Engineer of Record | New York PE-069748



Michael F. Wolfert
Technical Expert



Carlo San Giovanni
Program Manager

This document is intended only for the use of the individual or entity for which it was prepared and may contain information that is privileged, confidential and exempt from disclosure under applicable law. Any dissemination, distribution or copying of this document is strictly prohibited.

Contents

1	Introduction	1
2	Bethpage Park Groundwater Containment System Objectives	2
3	Bethpage Park Groundwater Containment System Description	2
4	Operation and Maintenance Activities	3
4.1	Annual System Performance and Alarm Summary	3
5	System Monitoring Activities	4
5.1	2020 System Monitoring Activities	4
5.2	Summary of Monitoring Results and Conclusions	5
5.2.1	System Operation and Effectiveness	5
5.2.2	Regulatory Status of Discharges	6
5.2.2.1	Air Discharge	6
5.2.2.2	Water Discharge	7
6	Environmental Effectiveness Monitoring	7
6.1	Hydraulic Monitoring	8
6.1.1	Activities	8
6.1.2	Results	8
6.2	Groundwater Quality Monitoring	8
6.2.1	Activities	8
6.2.2	Results	9
6.3	Environmental Effectiveness Monitoring Conclusions	9
7	Suggestions	9
8	References	10

Tables

Table 1	Operational Summary
Table 2	Summary of Influent Water Sample Analytical Results
Table 3	Summary of Effluent Water Sample Analytical Results
Table 4	Summary of Influent Vapor Sample Analytical Results
Table 5	Summary of Effluent Vapor Sample Analytical Results
Table 6	Summary of Effluent Vapor Tentatively Identified Compounds
Table 7	Summary of System Parameters
Table 8	Summary of Groundwater Recovered, VOC Mass Recovered, and VOC Mass Recovery Rates
Table 9	Summary of Air Quality Impact Analysis
Table 10	Summary of Remedial Well Groundwater Sample Analytical Results - VOCs
Table 11	Summary of Water-Level Elevations
Table 12	Summary of Monitoring Well Groundwater Sample Analytical Results - VOCs and 1,4-Dioxane
Table 13	Summary of Monitoring Well Groundwater Sample Analytical Results - Metals

Figures

Figure 1	Site Location
Figure 2	Site and Groundwater Containment System
Figure 3	Groundwater Treatment System Process Schematic, Process Flow Diagram, and Monitoring Locations
Figure 4	Groundwater Monitoring Network Site Plan
Figure 5	Cumulative Total, Project, and Non-Project VOC Mass Removed
Figure 6A	Remedial Well Total VOC Concentrations
Figure 6B	Remedial Well Project VOC Concentrations
Figure 6C	Remedial Well Non-Project VOC Concentrations
Figure 7	Influent Total, Project, and Non-Project VOC Concentrations
Figure 8A	Total VOC Mass Recovery Rates
Figure 8B	Project VOC Mass Recovery Rates
Figure 8C	Non-Project VOC Mass Recovery

2020 Annual Operation, Maintenance, and Monitoring Report
Operable Unit 3 - Groundwater

Figure 9 Groundwater Monitoring Network and Configuration of the Shallow Potentiometric Surface and Groundwater Flow Directions, Third Quarter 2020

Figure 10 Cross Section D-D' Showing TVOCs in Groundwater and Direction of Vertical Groundwater Flow, Third Quarter 2020

Appendices

Appendix A. Well Construction Information and Environmental Effectiveness Monitoring Program

Appendix B. Compliance and Performance Program

1 Introduction

Pursuant to the Administrative Order on Consent (AOC) Index #W1-0018-04-01 (New York State Department of Environmental Conservation [NYSDEC] 2005) and the Operable Unit 3 (OU3) Record of Decision (ROD) (NYSDEC 2013), Arcadis of New York, Inc. (Arcadis), on behalf of Northrop Grumman, has prepared this OU3 Bethpage Park Groundwater Containment System (BPGWCS) Annual Summary Report for submittal to the NYSDEC. The present-day Bethpage Community Park property (Park), McKay Field Access Road, and Former Plant 24 Access Road, which the NYSDEC has termed the “Former Grumman Settling Ponds Area” and designated as OU3, are referred to herein as the Site Area. Figure 1 provides a Site Location map.

The BPGWCS (previously referred to as the Groundwater Interim Remedial Measure and also known as the also known as the OU3 On-site Containment [ONCT] system) has been operational since July 21, 2009. The operation, maintenance, and monitoring (OM&M) activities performed during 2020 (i.e., January 1 through December 31, 2020 [the “annual reporting period”]) are summarized in this Annual Summary Report. This report also describes the OM&M activities performed during the Fourth Quarter of 2020 (i.e., October 1 through December 31, 2020 [“Fourth Quarter”]). Data summaries for the previous three 2020 quarterly operational periods are available in the following letter reports:

- Results of First Quarter 2020 System Operation and Monitoring for the Bethpage Park Groundwater Containment System, May 2020 (Arcadis 2020a)
- Results of Second Quarter 2020 System Operation and Monitoring for the Bethpage Park Groundwater Containment System, August 2020 (Arcadis 2020b)
- Results of Third Quarter 2020 System Operation and Monitoring for the Bethpage Park Groundwater Containment System, November 2020 (Arcadis 2020c)

During the annual reporting period, the BPGWCS Remedial System and Environmental Effectiveness Monitoring Programs were conducted in accordance with the OU3 BPGWCS Groundwater Interim Operation, Maintenance, and Monitoring Manual (OM&M Manual; Arcadis 2016). However, in contrast to previous reporting periods, there were intermittent In-Situ Thermal Remedy (ISTR) discharges through the BPGWCS system during this annual reporting period, which were conducted in accordance with the NYSDEC-approved ISTR Liquid Waste Management Plan (EMAGIN 2020).

As discussed in the OU3 Site Area Remedial Investigation Report (Site Area RI) (Arcadis 2011), Northrop Grumman does not take responsibility for certain compounds (e.g., Freon 12 and Freon 22) present in Site Area groundwater. Throughout this Annual Report, a distinction is made between “Project” and “Non-Project” volatile organic compounds (VOCs), defined as follows:

- Project VOCs: VOCs that may be related to former Northrop Grumman historical activities. For this OM&M Report, Project VOCs include 1,1,1-trichloroethane; 1,1-dichloroethane; 1,2-dichloroethane; 1,1-dichloroethene; tetrachloroethene; trichloroethylene (TCE); vinyl chloride (VC); cis-1,2-dichloroethene (cis-1,2-DCE); trans-1,2-dichloroethene (trans-1,2-DCE); benzene; toluene; xylene-O, and xylenes-M,P.
- Non-Project VOCs: VOCs, such as Chloroform, Freon 12 and Freon 22, that are understood to be unrelated to former Northrop Grumman activities but have been detected in Site Area groundwater. As noted in the Site Area RI (Arcadis 2011), a sub-plume of Freon 22 has been identified originating from the area of the Town of

Oyster Bay's (Town's) former ice rink. Based on Town information (Zervos 2007), Freon 22 was used by the Town and released to the environment.

2 Bethpage Park Groundwater Containment System Objectives

Remedial action objectives (RAOs) for the BPGWCS are as follows:

- Mitigate the off-site migration of dissolved-phase VOCs in groundwater. Specifically, the BPGWCS was designed to address:
 - Groundwater that has total VOC concentrations greater than 5 micrograms per liter ($\mu\text{g/L}$) in the upper 20 feet of the surficial aquifer across the 1,200-foot-wide lateral extent of the Site Area southern boundary.
 - Groundwater below the upper 20 feet of the surficial aquifer that has total VOC concentrations greater than 50 $\mu\text{g/L}$ across the 1,200-foot-wide lateral extent of the Site Area southern boundary.
- Comply with applicable NYSDEC standards, criteria, and guidance values (SCGs) for treated water and air emissions.

A secondary benefit of the BPGWCS is the creation of a clean-waterfront atop downgradient groundwater, which minimizes the potential for vapor intrusion downgradient of the Site Area.

3 Bethpage Park Groundwater Containment System Description

The BPGWCS consists of:

- A pump-and-treat system where groundwater is:
 - Extracted along the Former Plant 24 Access Road via four remedial wells.
 - Conveyed to a treatment plant at McKay Field via four underground pipelines.
 - Treated via air stripping to reduce concentrations of Project and Non-Project VOCs to comply with applicable NYSDEC SCGs for treated water.
 - Filtered to remove oxidized metals to comply with applicable NYSDEC SCGs for treated water.
 - Returned to the aquifer via a discharge pipeline routed to a recharge basin located on the adjacent former Bethpage Navy Weapons Industrial Reserve Plant property.
- A vapor-phase treatment system that reduces concentrations of Project VOCs in the air stripper off-gas prior to discharge to the atmosphere.
- A groundwater monitoring network utilized to periodically assess the environmental effectiveness of the BPGWCS.

Major components of the BPGWCS are as follows:

- Four remedial wells (RW-1, RW-2, RW-3, and RW-4) with design pumping rates of 30 gallons per minute (gpm), 75 gpm, 75 gpm, and 30 gpm, respectively; for a total design influent flow rate of 210 gpm.
- One low-profile air stripper to remove VOCs from extracted groundwater prior to discharge to the recharge basin.
- Two bag filter units configured so that one is operational and the other is in standby mode. The system control logic automatically switches from the operational filter unit to the standby filter unit when the operational bag filters are full to prevent a system shutdown and the spent filters are then replaced.
- Four emission control units, two containing vapor-phase granular-activated carbon and two containing potassium permanganate-impregnated zeolite, to treat Project VOCs in the air stripper off-gas.
- A groundwater monitoring network, consisting of 47 monitoring locations, including 23 groundwater monitoring wells, four remedial wells, and 20 piezometers.

Figure 2 shows the layout of the BPGWCS, and Figure 3 provides a schematic drawing of the remedial systems. Figure 4 shows groundwater sampling locations that form the groundwater monitoring network. Appendix A provides construction details for the monitoring wells and piezometers. The latest version of the OM&M Manual (Arcadis 2016) provides additional information.

4 Operation and Maintenance Activities

4.1 Annual System Performance and Alarm Summary

The 2020 system operational up-time is documented in Table 1 and summarized below along with BPGWCS shutdowns that occurred in 2020.

In 2020:

- The system operated 345 out of 365 days (95% uptime), which is slightly down from 97% runtime observed in 2019.
- The remedial wells operated at reduced flow rates during portions of the year due to pump wear attributed to iron build-up in the pumps, influent pipelines and valves. The reduced flow rates were corrected by adjusting the manifold globe valves or through the performance of periodic system maintenance (i.e. pulling and replacing the remedial well pumps and valve cleaning).
- There were thirty-five (35) routine system shutdowns (less than 12 hours each) due to alarm conditions encountered during normal operation of the system. Alarms in this category were responded to and troubleshooting was completed to restart the system within the same day (less than 12 hours).
- The following eight (8) non-routine system shutdowns resulted in downtime period greater than 12 hours each, of which:
 - One (1) shutdown was due to a broken fan on the blower on December 29th, 2019. The system was brought back online January 10th, 2020.
 - One (1) shutdown was due to a PSEG transformer failure on July 4th, 2020. The system was brought back online July 6th, 2020.

- One (1) planned shutdown was for air stripper chemical cleaning on July 7th, 2020. The system was brought back online the same day.
- One (1) planned system shutdown to accommodate the PSEG electric power connection to the ISTR system transformers on July 31, 2020. The system was restarted on August 3rd, 2020.
- One (1) shutdown was due to a power outage from Tropical Storm Isaias on August 5th, 2020. The system was brought back online August 7th, 2020.
- One (1) shutdown was due to bag filter replacement on August 9th, 2020. The system was brought back online with reduced flow rates on August 11th, 2020.
- One (1) shutdown was to accommodate a PSEG transformer repair on August 12th, 2020. The system was brought back online with reduced flow rates on August 13th, 2020. Normal system operation resumed on August 14th, 2020.
- One (1) shutdown was to accommodate extension of the effluent stack on December 21st, 2020. The system was brought back online December 22nd, 2020.
- In total for 2020, there was approximately 25 days of reduced flow attributed to RW-1 being turned off for ISTR discharge and unforeseen RW-2 motor and pump overload conditions associated with iron build-up. Generally, the system was restarted without incident the same day or the day following routine alarms.

5 System Monitoring Activities

5.1 2020 System Monitoring Activities

The following compliance and performance monitoring activities were conducted during the annual reporting period (per Section 6 of the OM&M Manual for a summary of the compliance and performance monitoring program requirements):

- Twelve (12) sampling events to collect thirty-two (32) required water samples (WSP-1 through WSP-5 on a quarterly basis and WSP-7 on a monthly basis) and eight (8) air samples (Influent and effluent on a quarterly basis).
- Forty-five (45) weekly site visits to monitor and record key system operational parameters.

System O&M results for the annual reporting period are summarized in the following tables and figures:

- Operational Summary, including monitoring events, system operational days, and noteworthy site activities (Table 1);
- Summary of Influent and Effluent Water Sample Analytical Results (Tables 2 and 3, respectively) - Table 3 also provides the BPGWCS treatment system removal efficiency.
- Summary of Influent and Effluent Vapor Sample Analytical Results and Summary of Effluent Vapor Tentatively Identified Compounds (Tables 4, 5 and 6, respectively) - Table 5 also provides the BPGWCS treatment system removal efficiency.
- Summary of System Parameters, including flow rates, line pressures, and temperatures (Table 7).

- Summary of Groundwater Recovered, VOC Mass Recovered, and VOC Mass Recovery Rates (Table 8) - Table 8 provides a breakdown of these parameters by Remedial Well and System and breaks down the VOC mass recovered and VOC recovery rates into Project, Non-Project, and total VOCs.
- Cumulative Total, Project, and Non-Project VOC Mass Removed (Figure 5).
- Remedial Well Total, Project, and Non-Project VOC Concentrations (Figures 6A, 6B, and 6C, respectively).
- Influent Total, Project, and Non-Project VOC Concentrations (Figure 7); and,
- Total, Project, and Non-Project VOC Mass Recovery Rates (Figures 8A, 8B, and 8C, respectively).

5.2 Summary of Monitoring Results and Conclusions

5.2.1 System Operation and Effectiveness

Annual BPGWCS monitoring results and conclusions are summarized below:

- Total volume of groundwater recovered and treated (Table 8):
 - 2020 Annual Total: 103 million gallons
 - Cumulative total since system startup: 1.2 billion gallons
- Total VOC mass recovered (Table 8):
 - 2020 Annual Total: 20.6 lbs of VOCs
 - Cumulative total since system startup: 2,221 lbs of VOCs
- VOC mass recovered and mass removal rates (Table 8 and Figures 8A, 8B, and 8C):
 - The majority of VOCs recovered during the annual reporting period were Project VOCs (98 percent or 20.2 lbs).
 - Majority of Project VOCs were recovered by RW-2 (94 percent or 19.3 lbs) and RW-3 (4 percent or 0.9 lbs).
 - All Non-Project VOCs were recovered by RW-3 (0.36 lbs).
- Treatment system influent concentrations (Tables 2, and Figures 6A, 6B, 6C, and 7):
 - During the annual reporting period, total Project VOC influent concentrations ranged from 17.0 µg/L in February to 18.4 µg/L in May and were generally stable over the annual reporting period. These concentrations were below the peak concentration observed in 2014 (105 µg/L). Total Project VOC influent concentrations have generally decreased since 2010.
 - Total Non-Project VOC influent concentrations were detected at concentration of 0.6 µg/L in February and May during the annual reporting period and were generally stable over the annual reporting period. These concentrations were below the peak concentration observed in 2014 (55 µg/L). Total Non-Project VOC influent concentrations have generally decreased since 2010.
 - Total iron (144 µg/L – 189 µg/L) detected during the annual reporting period is consistent with historical values.

2020 Annual Operation, Maintenance, and Monitoring Report
Operable Unit 3 - Groundwater

- Mercury has not been detected in influent or effluent sample since system startup. Sample collection for mercury analysis has been deemed unnecessary, and has not been performed since September of 2018.
- Project VOCs Concentrations in Remedial Wells (Table 10):
 - In RW-1, Project VOCs were not detected during the annual reporting period.
 - In RW-2, several Project VOCs (cis-1,2-DCE, TCE, and VC) continue to be detected above applicable SCGs, but the detections remained stable during the annual reporting period.
 - In RW-3, some Project VOCs (cis-1,2-DCE and TCE) were detected during all quarters, but the detections were below the applicable SCGs.
 - In RW-4, one Project VOC (TCE) was detected in the second and fourth quarters, but the detections were below the applicable SCG and none were detected during the first and third quarters.
 - In RW-2 Project VOCs have decreased from the peak total concentration observed at system startup in July 2009 (3858 µg/L) to 80.4 µg/L in October 2020.
 - Similar to total influent concentrations, Project VOC remedial well concentrations have generally decreased since 2010, with Project VOCs not detected above applicable SCGs in Remedial Well RW-3 since November 2013, and no detections in RW-1 since system startup.
- Non-Project VOCs in Remedial Wells RW-1, RW-2, RW-3 and RW-4 (Table 10) were not detected above applicable SCGs during 2020. Similar to total influent Non-Project VOC concentrations, Non-Project VOC remedial well concentrations have generally decreased during the annual reporting period and since 2010, with Non-Project VOCs not detected above applicable SCGs in Remedial Wells RW-1, RW-2, or RW-4 since system startup. Only two detections of Non-Project VOCs have been above applicable SCGs in RW-3 since system startup.
- The air stripper, air stripper off-gas treatment system, and bag filter system performed within acceptable operating ranges during the annual reporting period, as indicated by:
 - The air stripper VOC removal efficiency was greater than 99.9 percent for Project and Non-Project VOCs (Table 3).
 - Both water and air discharges complied with applicable SCGs and discharge limits (Tables 3, and 9).

5.2.2 Regulatory Status of Discharges

5.2.2.1 Air Discharge

Influent concentrations for the annual reporting period were compared to 6NYCRR III A Part 212-2.3(b) (Rule 212), Table 4 - Degree of Air Cleaning Required for Non-Criteria Air Contaminants. Concentrations of all effluent compounds detected during the Fourth Quarter were less than 16,959 µg/m³ (concentration equivalent to 0.1 pounds per hour at a flow rate of 1,577 standard cubic feet per minute), as shown in Table 9 of this report. Therefore, in accordance with the requirements of Table 4 of the NYSDEC regulations, air dispersion modeling was performed to demonstrate that the maximum off-site air concentration is less than the NYSDEC Division of Air Resources (DAR-1) Annual Guidance Concentrations (AGCs) on a 12-month rolling average and Short-term Guidance Concentrations (SGCs), issued August 10, 2016 (NYSDEC 2016).

Effluent concentrations for the annual period are provided on Table 5. The U.S. Environmental Protection Agency (USEPA) air quality dispersion model AERMOD was used to estimate the highest ambient air concentration of the compounds on Table 5. AERMOD is the USEPA's recommended best state-of-the-art practice Gaussian plume dispersion model. Gaussian models are the most widely used techniques for estimating the impact of non-reactive pollutants, per Appendix W of Title 40 Code of Federal Regulations (CFR) 51 – Guideline of Air Quality Models.

The following parameters were used for the AERMOD model analysis:

- Urban dispersion coefficients.
- AERMAP base and terrain elevations, processed using National Elevation Dataset (NED) digitized terrain data.
- Surface and upper air observations measured at the National Weather Service stations located at Farmingdale and Brookhaven airports for calendar years 2011-2015, in accordance with NYSDEC's DAR-1 Air Dispersion Modeling Guidance Document. This longer period of time was reviewed for the model run, to provide a conservative estimate of atmospheric impacts on the off-site concentrations.
- Discrete receptor grids, per the following methodology:
 - Receptors were located along the property boundary at distances not exceeding 25 meters.
 - A 1.5 km x 1.5 km Cartesian grid with distances of 50 meters between the receptors; and
 - A 3.0 km x 3.0 km Cartesian grid with distances of 100 meters between the receptors.
- Emission rate: 1 gram per second (g/s).

Table 9 provides the compound specific scaled hourly ambient air impact and the scaled annual ambient air impact for the Fourth Quarter sampling event. Based on the model, the maximum one-hour ambient air impact was 9,778.35 [$\mu\text{g}/\text{m}^3$]/[g/s] and the maximum annual ambient air impact was 189.33 [$\mu\text{g}/\text{m}^3$]/[g/s]. As shown, the scaled ambient air impacts for the BPGWCS are below the corresponding SGCs and AGCs, which is consistent with the previous quarterly results during the annual reporting period.

Based on the ambient modeling analysis, the BPGWCS effluent air discharge for the annual reporting period meets the requirements for DAR-1 and is below the Rule 212 requirements.

5.2.2.2 Water Discharge

The BPGWCS-treated water effluent met NYSDEC regulatory requirements during the annual reporting period (Table 3 and Appendix B), as noted below:

- The measured concentration of individual VOCs in the treated water effluent were below applicable discharge limits, per the interim State Pollutant Discharge Elimination System (SPDES) equivalency permit.
- The measured concentrations of total and dissolved iron in the treated water effluent were below applicable SPDES discharge limits.

6 Environmental Effectiveness Monitoring

The OU3 BPGWCS System environmental effectiveness (i.e., hydraulic monitoring and groundwater quality monitoring) activities and results for the annual reporting period are discussed below.

6.1 Hydraulic Monitoring

6.1.1 Activities

In accordance with the OM&M Manual requirements and methodologies (Arcadis 2016), groundwater hydraulic monitoring was performed quarterly during the annual reporting period. Specifically, depth-to-water measurements were completed on February 20, May 28, July 20, and December 3, 2020, at the 43 monitoring wells/piezometers and 4 remedial wells forming the approved monitoring well network (Figure 4). Table 11 summarizes results of depth-to-water measurements to date.

6.1.2 Results

Figure 9 provides the configuration of the shallow potentiometric surface and the inferred horizontal groundwater flow directions on July 20, 2020 (3rd quarter) at the Site Area. Comparing third quarter water-level elevations from 2020 to those from 2019 reveal that the water table was approximately one-foot lower at the time water level elevations were recorded in 2020 as compared to 2019.

Groundwater hydraulic monitoring is conducted quarterly however, the shallow potentiometric surface is mapped for only one quarter yearly as the rise and fall of this surface seasonally, due to recharge or lack thereof, and has a negligible effect on the capture zone. As Figure 9 shows, groundwater flow in the area is generally toward the south/south east. The BPGWCS system is capturing groundwater flow from beneath the Bethpage Community Park. The southern edge of the capture zone (groundwater divide) extends to the south of Monitoring Wells MW-204-1, MW-205-1 and MW-206-1 and is slightly north of Sycamore Avenue, north of MW-200-1 through MW-203-1.

Figure 10 provides a cross-sectional view of vertical groundwater flow (based on groundwater levels measured on July 20, 2020), and Project VOC concentrations in groundwater (based on results from the July 2020 groundwater sampling round [3rd Quarter]). Figure 10 indicates groundwater containing Project VOCs are being captured and removed by remedial well RW-2, which is consistent with and greater than the intended purpose of the OU3 BPGWCS System.

Figure 9 in combination with Figure 10 indicate that the OU3 BPGWCS System provides effective vertical and horizontal hydraulic control of groundwater containing Project VOCs and prevents its movement offsite.

6.2 Groundwater Quality Monitoring

6.2.1 Activities

An annual groundwater sampling round was performed in July 2020 as part of site-wide sampling activity. Groundwater samples were collected from 19 monitoring wells that are specified for sampling in the OM&M Manual (Arcadis 2016).

An initial Hydraulic Effectiveness Evaluation (HEE) of the OU3 BPGWCS System was performed in 2014-2015 (ERM 2015). As part of this HEE, a total of 6 monitoring wells and 6 piezometers were installed. Groundwater samples were also collected during this annual round from 4 of the monitoring wells installed during the Initial HEE (i.e., MW-204-1, MW-205-1, MW-206-1 and MW-208-1). Monitoring Wells MW-207A and MW-207B, installed during the Initial HEE, were assessed and found to be unusable in 2017. Therefore, monitoring wells

MW-207A and MW-207B were replaced by MW-207A-1R and MW-207B-1R in 2018 as part of a Supplemental HEE conducted in 2018. Sampling results are presented in the Supplemental HEE report (EMAGIN 2018). These changes and additions to the BPGWCS monitoring well network over the past 6 years are a part of the current 19 monitoring wells sampled on an annual basis and 43 monitoring wells/piezometers measured on a quarterly basis for hydraulic monitoring.

6.2.2 Results

Groundwater samples collected from the 19 monitoring wells were analyzed for Target Compound List (TCL) VOCs, plus Freon 12 and Freon 22, using USEPA Method 8260C, 1,4-Dioxane using USEPA Method 8270D SIM and total (unfiltered) and dissolved (filtered) metals (cadmium and chromium) using USEPA Method 6010.

Groundwater quality data, including historical results to date, are summarized in Table 12 (for VOCs and 1,4-Dioxane) and Table 13 (for metals).

6.3 Environmental Effectiveness Monitoring Conclusions

As discussed above, Figures 9 and 10 indicate that the OU3 BPGWCS System is operating as designed, that the expected associated capture zone has developed, and that off-site migration of groundwater containing Project VOCs is being prevented. This observation is also supported by a NYDEC letter dated March 18, 2016 that states “that the OU3 groundwater treatment system is, overall, containing the OU3 groundwater plume source”.

A NYSDEC Technical Memorandum, dated November 28, 2018, requested Toluene be included to the analyte list for all groundwater samples. As shown in Table 12, since analysis for toluene began it has not been identified at concentrations above detection limits (i.e. 1.0 ppb).

Groundwater monitoring results presented in Figure 9 and Figure 10 confirm that the OU3 BPGWCS is effectively preventing Project VOCs in groundwater from migrating offsite.

7 Suggestions

Based on the groundwater analytical results collected during the annual reporting period, Arcadis suggests continued operation of the OU3 BPGWCS as is.

8 References




- Arcadis of New York, Inc. (Arcadis). 2016. DRAFT Operation, Maintenance, and Monitoring Manual, Bethpage Park Groundwater Containment System, Operable Unit 3 (Former Grumman Settling Ponds), Bethpage, New York. March 2016.
- Arcadis. 2011. Remedial Investigation Report (Site Area). Operable Unit 3 – Former Grumman Settling Ponds, Bethpage, New York. NYSDEC Site #1-30-003A. February 8, 2011.
- Arcadis. 2012. Operation, Maintenance, and Monitoring Report for the Groundwater Interim Remedial Measure, 2011 Annual Summary Report. Operable Unit 3 – Former Grumman Settling Ponds, Bethpage, New York. NYSDEC Site #1-30-003A. March 23, 2012.
- Arcadis. 2020a. Results of First Quarter 2019 System Operation and Monitoring, May 2020, Operable Unit 3 (Former Grumman Settling Ponds), Bethpage, New York. NYSDEC ID #1-30-003A.
- Arcadis. 2020b. Results of Second Quarter 2019 System Operation and Monitoring, August 2020, Operable Unit 3 (Former Grumman Settling Ponds), Bethpage, New York. NYSDEC ID #1-30-003A.
- Arcadis. 2020c. Results of Third Quarter 2019 System Operation and Monitoring, November 2020, Operable Unit 3 (Former Grumman Settling Ponds), Bethpage, New York. NYSDEC ID #1-30-003A.
- EMAGIN. 2016. Work Plan for Supplemental Groundwater Characterization, Bethpage Park Groundwater Containment System. September 30, 2016.
- EMAGIN. 2016. Work Plan for Supplemental Groundwater Characterization, Bethpage Park Groundwater Containment System. May 16, 2016.
- EMAGIN. 2018. Technical Memorandum OU3 Hydraulic Effective Evaluation – Supplemental Groundwater Characterization, Bethpage Park Groundwater Containment System. August 2018.
- ERM Consulting and Engineering, Inc. (ERM). 2015. Bethpage Park Groundwater Containment System Hydraulic Effectiveness Evaluation Report. July 2015.
- New York State Department of Environmental Conservation (NYSDEC). 2005. Order on Consent, Index #W1-0018-04-01, Site #1-30-003A, July 4, 2005.
- NYSDEC. 2009. Interim State Pollution Discharge Elimination System (SPDES) Letter, March 19, 2009.
- NYSDEC. 2013. Record of Decision, Northrop Grumman – Bethpage Facility, Operable Unit Number: 03, State Superfund Project, Bethpage, Nassau County, Site No. 130003A, March 29, 2013.
- NYSDEC. 2016. DAR-1 AGC/SGC Tables. Revised August 10, 2016.
- NYSDEC. 2018. Technical Memorandum, OU3 (Former Grumman Settling Ponds) Hydraulic Effectiveness Evaluation - Supplemental Groundwater Characterization, NYSDEC Site No. 130003A. Nov 28, 2018.
- Zervos, Theodore. 2007. Deposition of Theodore Zervos in the matter Town of Oyster Bay v. Northrop Grumman Systems Corporation et al. Case No. 05-CV-1945 (TCP)(AKT). January 22, 2007.

Tables

Table 1
Operational Summary
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Northrop Grumman,
Bethpage, New York

MONTH	DAY																															Days Operational ¹		
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31			
2009 Total																																		160
2010 Total																																		352
2011 Total																																		351
2012 Total																																		353
2013 Total																																		354
2014 Total																																		349
2015 Total																																		348
2016 Total																																		351
2017 Total																																		354
2018 Total																																		348
2019 Total																																		355
Oct 2020	(2)	(2)	(2)	(2)	(2)	(2)	(2)	(2)	(2)	(2)	(2)	(2)	(2)	(2)	(2)	(5)																	31	
Nov 2020													(5)														(3)	(5)	(3)	(3)	(3)	(3)	(3)	30
Dec 2020															(5)							(4)	(4)							(5)			29	
4Q 2020																																		90
2020 Total																																		345
TOTAL																																		4020

Legend:

-  Indicates system online the majority or all of the day.
-  Indicates system operated with reduced flow rates.
-  Indicates system off-line the majority or all of the day.

Notes, Abbreviations, and Units on last page.

Table 1
Operational Summary
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Northrop Grumman,
Bethpage, New York

Notes:

1. Days the system was operational for the majority of the day are counted as one day.

Fourth Quarter 2020

2. System operated at a reduced flowrate due to RW-1 pump failure and ISTR related activities.
3. System operated at a reduced flowrate due to RW-2 pump failure and ISTR related activities.
4. System was shutdown for effluent stack extension.
5. ISTR Discharge event.

Abbreviations/Units:

4Q Fourth Quarter

Table 2
Summary of Influent Water Sample Analytical Results
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Northrop Grumman,
Bethpage, New York

Compound (All Constituent Concentrations in µg/L)	02/06/20	05/14/20	07/08/20	12/2/2020 ⁽³⁾
Non-Project VOCs				
Dichlorodifluoromethane (Freon 12)	< 2.0	< 2.0	< 2.0	NS
Dichloromethane	< 2.0	< 2.0	< 2.0	NS
Ethylbenzene	< 1.0	< 1.0	< 1.0	NS
Methyl N-Butyl Ketone	< 5.0	< 5.0	< 5.0	NS
Methyl Tert-Butyl Ether	< 1.0	< 1.0	< 1.0	NS
Styrene (Monomer)	< 1.0	< 1.0	< 1.0	NS
trans-1,3-Dichloropropene	< 1.0	< 1.0	< 1.0	NS
Trichlorofluoromethane (Freon 11)	< 2.0	< 2.0	< 2.0	NS
Trichlorotrifluoroethane (Freon 113)	< 5.0	< 5.0	< 5.0	NS
1-Chloro-1,1-difluoroethane (Freon 142b)	< 5.0	< 5.0	< 5.0	NS
Subtotal Non-Project VOCs	0.6	0.6	ND	--
Total VOCs¹	18	19	17	--
1,4-Dioxane	1.0	1.3	1.0	NS
pH ²	5.1	5.6	5.6	--

Notes, Abbreviations, Qualifiers, and Units:

1. "Total VOCs" represents the sum of individual concentrations of the compounds detected. The values used in calculations referenced in this report have been rounded to the nearest whole number.
 2. Influent pH samples collected and measured in the field by Arcadis personnel on the dates listed using a field calibrated pH/conductivity meter. pH units are standard units.
 3. Quarter 4 sampling was conducted during ISTR Baker Tank discharge. The combined Influent sample port (WSP-5) is located upstream of the ISTR connection into the influent line. Due to this setup, the combined influent port (WSP-5) was not sampled as it would not be representative of the true combined influent.
- USEPA United States Environmental Protection Agency
VOC Volatile Organic Compound
- 3.0** Bold value indicates a detection.
< 1.0 Compound not detected at or above the laboratory quantification limit.
µg/L micrograms per liter
ND Analyte not detected at, or above its laboratory quantification limit.
NS Not sampled

Table 3
Summary of Effluent Water Sample Analytical Results
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Northrop Grumman,
Bethpage, New York

Compound (All Constituent Concentrations in µg/L)	Discharge Limit ¹	01/14/20	02/06/20	03/03/20	04/15/20	05/14/20	06/04/20	07/08/20	08/18/20	09/02/20	10/6/2020 ⁷	11/5/2020 ⁷	12/2/2020 ⁷
Project VOCs													
1,1,1-Trichloroethane	5 ²	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethene	5 ²	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5 ²	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	5 ²	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Vinyl Chloride	5 ²	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis 1,2-Dichloroethene	5 ²	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans 1,2-Dichloroethene	5 ²	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Subtotal Project VOCs		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Compound (All Constituent Concentrations in µg/L)	Discharge Limit ¹	01/14/20	02/06/20	03/03/20	04/15/20	05/14/20	06/04/20	07/08/20	08/18/20	09/02/20	10/6/2020 ⁷	11/5/2020 ⁷	12/2/2020 ⁷
Non-Project VOCs													
Chloroform	5 ²	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Dichloromethane	5 ²	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Trichlorotrifluoroethane (Freon 113)	5 ²	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Subtotal Non-Project VOCs		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Total VOCs³		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Treatment Efficiency ⁴		> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%
Compound (All Constituent Concentrations in µg/L)	Discharge Limit ¹	01/14/20	02/06/20	03/03/20	04/15/20	05/14/20	06/04/20	07/08/20	08/18/20	09/02/20	10/6/2020 ⁷	11/5/2020 ⁷	12/2/2020 ⁷
Inorganics													
Total Iron	600	< 100	< 100	144	< 100	144	113	< 100	< 100	< 100	< 100	< 100	189
Total Manganese	600	50.1	49.7	51.9	45.3	44.2	46.5	45.0	47.8	46.0	51.1	43.9	46.1
Nitrate and Nitrite	10,000	2,400	2,900	2,800	2,600	2,800	2,900	2,700	2,700	2,600	2,600	2,500	2,600
Total Kjeldahl Nitrogen	10,000	< 200	< 200	< 200	< 200	< 200	< 200	< 200	< 200	< 200	< 200	< 200	< 200
Total Nitrogen	10,000	2,400	2,900	2,800	2,600	2,800	2,900	2,700	2,700	2,600	2,600	2,500	2,600
1,4-Dioxane	NE	0.76	1.0	0.79	1.2	1.4	1.3	1.3	1.1	1.2	1.1	1.6	1.3
pH ⁵	5.5-8.5	6.3	6.1	6.1	5.9	6.9	6.5	6.5	6.7	6.6	6.9 ⁽⁶⁾	6.8	6.8

Notes, Abbreviations, Qualifiers, and Units on last page.

Table 3
Summary of Effluent Water Sample Analytical Results
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Northrop Grumman,
Bethpage, New York

Notes, Abbreviations, Qualifiers, and Units:

1. Discharge limits per the interim SPDES equivalency program or Division of Water Technical and Operational Guidance Series (TOGS 1.1.1) Quality Standards and Guidance Values and Groundwater Effluent Limitations, if the compound is not part of the SPDES Permit Equivalency.
2. As of September 2017, the 10 SPDES VOCs discharge limits are per Site Number 1-30-003A Operable Unit 3 SPDES Permit Equivalency.
3. "Total VOCs" represents the sum of individual concentrations of compounds detected. The values used in calculations referenced in this report have been rounded to the nearest whole
4. Treatment efficiency was calculated by dividing the difference between the influent and effluent total VOC concentrations by the influent total VOC concentration.
5. Effluent pH measured on site using a handheld pH meter. pH units are standard units.
6. Due to pH meter malfunction on 10/6/20, the reported pH was measured on 10/15/20 under similar conditions during the second ISTR tank discharge.
7. Results validated following protocols specified in Sampling and Analysis Plan in the Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). See previous annual reports for historical analytical results.

NYSDEC New York State Department of Environmental Conservation
SPDES State Pollutant Discharge Elimination System
USEPA United States Environmental Protection Agency
VOC Volatile Organic Compound
NE Not Established

102 Bold value indicates a detection.
< 0.50 Compound not detected above the laboratory quantification limit.
µg/L micrograms per liter
ND Analyte not detected at, or above its laboratory quantification limit.

Table 4
Influent Vapor Sample Analytical Results
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Northrop Grumman,
Bethpage, New York

Compound ¹ (All Constituent Concentrations in µg/m ³)	03/30/20	05/14/20	07/08/20	10/6/2020 ³
Project VOCs				
1,1,1 - Trichloroethane	1.2	1.0	1.3	1.3
1,1 - Dichloroethane	7.3	5.7	6.5	5.7
1,2 - Dichloroethane	0.45 J	< 0.81	< 0.81	0.34 J
1,1 - Dichloroethene	1.3	0.91	1.3	0.99
Tetrachloroethene	2.6	1.9	4.6	3.1
Trichloroethene	58.6	69.9	94.6	76.3
Vinyl Chloride	50.1	56.2	94.3	54.4
cis 1,2-Dichloroethene	182	170	206	195
trans 1,2-Dichloroethene	0.52 J	0.48 J	0.48 J	0.67
Benzene	0.58 J	0.35 J	0.58 J	0.73
Toluene	0.83	0.57 J	1.1	0.53 J
o-Xylene	1.0	0.83 J	1.5	1.1
m,p-Xylene	0.65 J	< 0.87	0.56 J	0.65 J
Subtotal Project VOCs	307	308	413	341
Non-Project VOCs				
1,1,2,2-Tetrachloroethane	< 0.69	< 0.69	< 0.69	< 0.55
1,1,2-Trichloroethane	< 0.55	< 0.55	< 0.55	< 0.44
1,2-Dichloropropane	0.60 J	0.51 J	0.65 J	0.55 J
1,3-Butadiene	< 0.44	< 0.44	< 0.44	< 0.35
2-Butanone	< 0.59	< 0.59	< 0.59	0.68
4-Methyl-2-Pentanone	< 0.82	< 0.82	< 0.82	< 0.66
Acetone	< 0.48	6.9	5.2	5.5
Bromodichloromethane	< 0.67	< 0.67	< 0.67	< 0.54
Bromoform	< 0.41	< 0.41	< 0.41	< 0.33
Bromomethane	< 0.78	< 0.78	< 0.78	< 0.62
Carbon Disulfide	< 0.62	< 0.62	< 0.62	< 0.50
Carbon Tetrachloride	0.48	< 0.25	< 0.25	0.62
Chlorobenzene	< 0.92	< 0.92	< 0.92	< 0.74
Chlorodibromomethane	< 0.85	< 0.85	< 0.85	< 0.68
Chlorodifluoromethane (Freon 22)	< 0.70	5.6	< 0.70	6.3
Chloroethane	< 0.53	< 0.53	< 0.53	< 0.42
Chloroform	11	9.3	11	10
Chloromethane	2.1	1.3	1.5	1.6
cis-1,3-Dichloropropene	< 0.91	< 0.91	< 0.91	< 0.73
Dichlorodifluoromethane (Freon 12)	< 0.99	1.8	2.2	2.8
Dichloromethane	0.83	0.73	< 0.69	1.6
Ethylbenzene	0.56 J	< 0.87	< 0.87	< 0.69
Methyl N-Butyl Ketone	< 0.82	< 0.82	< 0.82	< 0.65
Methyl Tert-Butyl Ether	0.69 J	< 0.72	< 0.72	0.50 J
Styrene (Monomer)	< 0.85	< 0.85	< 0.85	< 0.68
trans-1,3-Dichloropropene	< 0.91	< 0.91	< 0.91	< 0.73
Trichlorofluoromethane (Freon 11)	< 0.56	1.2	1.3	1.7
Trichlorotrifluoroethane (Freon 113)	1.7	1.5	1.8	1.8
1-Chloro-1,1-difluoroethane (Freon 142b)	< 0.82	< 0.82	< 0.82	< 0.66
Subtotal Non-Project VOCs	18	29	24	34
Total VOCs²	325	337	436	374

Notes, Abbreviations, Qualifiers, and Units on last page.

Table 4
Influent Vapor Sample Analytical Results
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Northrop Grumman,
Bethpage, New York

Notes, Abbreviations, Qualifiers, and Units:

1. Vapor samples collected by Arcadis on the dates shown and submitted to a NYSDOH ELAP certified laboratory for VOC analyses per Modified USEPA Method TO-15. A VOC analyte list is provided in the DRAFT Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). Influent samples were collected at Vapor Sampling Port-1 (VSP-1); refer to Figure 3 of this OM&M Report for the location of VSP-1.

2. "Total VOCs" represents the sum of individual concentrations of compounds detected. The values used in calculations referenced in this report have been rounded to the nearest whole number.

3. Results validated following protocols specified in Sampling and Analysis Plan in the Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). See previous annual reports for historical analytical results.

ELAP	Environmental Laboratory Approval Program
NYSDOH	New York State Department of Health
OM&M	Operation, Maintenance, and Monitoring
USEPA	United States Environmental Protection Agency
VOC	Volatile Organic Compound

0.93	Bold value indicates a detection.
< 0.81	Compound not detected above the laboratory quantification limit.
J	Result is estimated.

$\mu\text{g}/\text{m}^3$ micrograms per cubic meter

Table 5
Summary of Effluent Vapor Sample Analytical Results
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Northrop Grumman,
Bethpage, New York

Compound ¹ (All Constituent Concentrations in µg/m ³)	03/30/20	05/14/20	07/08/20	10/6/2020 ³
Project VOCs				
1,1,1 - Trichloroethane	0.93	0.76	1.0	1.1
1,1 - Dichloroethane	6.1	4.9	6.1	5.7
1,2 - Dichloroethane	0.45 J	< 0.81	< 0.81	0.36 J
1,1 - Dichloroethene	1.0	0.71	1.1	0.87
Tetrachloroethene	1.7	1.2	3.3	4.0
Trichloroethene	29	30	50	37
Vinyl Chloride	26.3	26.1	44.2	28.1
cis 1,2-Dichloroethene	109	99.5	111	107
trans 1,2-Dichloroethene	< 0.79	< 0.79	< 0.79	< 0.63
Benzene	0.38 J	< 0.64	< 0.64	0.35 J
Toluene	1.4	1.4	1.3	1.2
o-Xylene	0.74 J	0.48 J	0.74 J	0.96
m,p-Xylene	0.61 J	0.56 J	0.48 J	1.5
Subtotal Project VOCs	178	166	219	188
Non-Project VOCs				
1,1,2,2-Tetrachloroethane	< 0.69	< 0.69	< 0.69	< 0.55
1,1,2-Trichloroethane	< 0.55	< 0.55	< 0.55	< 0.44
1,2-Dichloropropane	0.46 J	< 0.92	< 0.92	0.38 J
1,3-Butadiene	< 0.44	< 0.44	< 0.44	< 0.35
2-Butanone	< 0.59	< 0.59	< 0.59	5.0
4-Methyl-2-Pentanone	< 0.82	< 0.82	< 0.82	< 0.66
Acetone	< 0.48	24.9	43.9	36.8
Bromodichloromethane	< 0.67	< 0.67	< 0.67	< 0.54
Bromoform	< 0.41	< 0.41	< 0.41	< 0.33
Bromomethane	< 0.78	< 0.78	< 0.78	< 0.62
Carbon Disulfide	< 0.62	< 0.62	< 0.62	< 0.50
Carbon Tetrachloride	0.45	< 0.25	< 0.25	0.50
Chlorobenzene	< 0.92	< 0.92	< 0.92	< 0.74
Chlorodibromomethane	< 0.85	< 0.85	< 0.85	< 0.68
Chlorodifluoromethane (Freon 22)	< 0.70	5.6	< 0.70	6.7
Chloroethane	< 0.53	< 0.53	< 0.53	< 0.42
Chloroform	11	9.3	12.0	10
Chloromethane	1.4	1.1	1.4	1.5
cis-1,3-Dichloropropene	< 0.91	< 0.91	< 0.91	< 0.73
Dichlorodifluoromethane (Freon 12)	< 0.99	1.8	2.3	2.9
Dichloromethane	4.5	0.76	< 0.69	2.6
Ethylbenzene	0.48 J	< 0.87	< 0.87	< 0.69
Methyl N-Butyl Ketone	< 0.82	< 0.82	< 0.82	< 0.65
Methyl Tert-Butyl Ether	< 0.72	< 0.72	< 0.72	< 0.58
Styrene (Monomer)	< 0.85	< 0.85	< 0.85	< 0.68
trans-1,3-Dichloropropene	< 0.91	< 0.91	< 0.91	< 0.73
Trichlorofluoromethane (Freon 11)	< 0.56	1.2	1.5	2.0
Trichlorotrifluoroethane (Freon 113)	1.9	1.6	2.2	2.1
1-Chloro-1,1-difluoroethane (Freon 142b)	< 0.82	< 0.82	< 0.82	< 0.66
Subtotal Non-Project VOCs	20	46	63	70
Total VOCs²	198	212	283	259

Notes, Abbreviations, Qualifiers, and Units on last page.

Table 5
Summary of Effluent Vapor Sample Analytical Results
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Northrop Grumman,
Bethpage, New York

Notes, Abbreviations, Qualifiers, and Units:

1. Vapor samples collected by Arcadis on the dates shown and submitted to a NYSDOH ELAP certified laboratory for VOC analyses per Modified USEPA Method TO-15. A VOC analyte list is provided in the DRAFT Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). Effluent samples were collected at Vapor Sampling Port-5 (VSP-5); refer to Figure 3 of this OM&M Report for the location of VSP-5.

2. "Total VOCs" represents the sum of individual concentrations of all compounds detected. The values used in calculations referenced in this report have been rounded to the nearest whole number.

3. Results validated following protocols specified in Sampling and Analysis Plan in the Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). See previous annual reports for historical analytical results.

ELAP Environmental Laboratory Approval Program

NYSDOH New York State Department of Health

OM&M Operation, Maintenance, and Monitoring

USEPA United States Environmental Protection Agency

VOC Volatile Organic Compound

0.76 Bold value indicates a detection.

< 0.81 Compound not detected above the laboratory quantification limit.

J Result is estimated.

µg/m³ micrograms per cubic meter

Table 6
Summary of Effluent Vapor Tentatively Identified Compounds
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Northrop Grumman,
Bethpage, New York

Compound ¹ (All Constituent Concentrations in ppbv)	03/30/20	05/14/20	07/08/20	10/6/2020 ³
<u>Tentatively Identified Compounds</u>				
Acetone	8.9 JN	ND	ND	ND
Carbon Dioxide	15 JNB	170 JB	170 JNB	65 JNB
Difluorochloromethane	1.5 JN	ND	ND	ND
Ethanol	1.3 JN	ND	ND	1.3 JN
Cumene	ND	ND	1.8 JN	1.6 JN
2-Phenyl-2-Propanol	ND	ND	1.2 JN	ND
Acetaldehyde	ND	ND	ND	4.2 JN
Unknown (A)	1.1 J	ND	ND	ND
Unknown (B)	ND	ND	5.7 J	ND
Total VOC TICs²	12.8 J	ND	8.7 J	7.1 J

Notes, Abbreviations, Qualifiers, and Units:

1. Vapor samples collected by Arcadis on the dates shown and submitted to a NYSDOH ELAP certified laboratory for VOC analyses per Modified USEPA Method TO-15. A VOC analyte list is provided in the DRAFT Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). Effluent samples were collected at Vapor Sampling Port-5 (VSP-5); refer to Figure 3 of this OM&M Report for the location of VSP-5.

2. Compounds found in associated method blank are not included in Total VOC TICs.

3. Results validated following protocols specified in Sampling and Analysis Plan in the Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). See previous annual reports for historical analytical results.

ECU	Emission Control Unit
ELAP	Environmental Laboratory Approval Program
NYSDOH	New York State Department of Health
OM&M	Operation, Maintenance, and Monitoring
TIC	Tentatively Identified Compound
USEPA	United States Environmental Protection Agency
VOC	Volatile Organic Compound

3.3	Bold value indicates a detection.
ND	TIC were not detected.
B	TIC was detected in the associated method blank.
J	Result is estimated.
N	Indicates presumptive evidence of a compound.
ppbv	parts per billion by volume

Table 7
Summary of System Parameters
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Northrop Grumman,
Bethpage, New York

Date ¹	Water Flow Rates (All Flows in gpm)						Water Pressures (All Pressures in psi)					Air Flow Rate (scfm) ²	Air Pressures (All Pressures in iwc) ^{5,6}				Air Temp. (°R) ⁵	
	Remedial Well ²				Combined Influent ³	Effluent ²	Remedial Well Effluent ^{2,4}				Effluent ⁵		Effluent	ECU Influent				
	RW-1	RW-2	RW-3	RW-4			RW-1	RW-2	RW-3	RW-4				GAC-501	GAC-502	PPZ-601		PPZ-602
01/16/20	30.3	75.8	75.6	30.6	212	231	57	44	42	56	14	1,526	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	531
02/06/20	31.5	75.5	76.3	30.1	213	225	56	42	38	56	14	1,575	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	530
03/03/20	30.7	75.8	75.5	30.6	213	227	56	33	40	56	15	1,600	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	538
04/15/20	31.2	70.1	75.4	30.8	208	213	56	6	36	56	16	1,570	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	538
05/14/20	30.2	75.8	75.2	30.2	211	226	57	50	36	57	25	1,572	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	548
06/04/20	30.8	75.0	75.0	31.3	212	219	56	46	33	55	14	1,500	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	544
07/08/20	30.6	75.3	75.4	30.2	211	225	57	42	36	56	17	1,500	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	550
08/18/20	30.4	75.0	75.0	30.0	210	227	57	46	35	55	13	1,500	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	544
09/02/20	30.8	74.5	74.9	30.3	211	220	56	41	36	56	16	1,500	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	544
10/19/2020 ⁷	30.2	75.0	75.4	30.1	211	226	56	66	39	56	14	1,515	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	540
11/05/20	30.7	75.0	74.8	30.4	211	227	56	60	38	55	16	1,475	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	540
12/02/20	30.1	77.2	75.4	30.1	213	221	57	37	36	56	12	1,493	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	531

Notes, Abbreviations, and Units on last page.

Table 7
Summary of System Parameters
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Northrop Grumman,
Bethpage, New York

Notes, Abbreviations, and Units:

1. Operational data collected by Arcadis on days noted. Parameters listed were typically recorded during compliance monitoring events. Data in this table correspond to approximately the past year of system operation.
2. Instantaneous parameters obtained from the SCADA HMI: Water Flow Rate, Water Pressure, Air Flow Rate.
3. Combined influent water-flow rate is the sum of individual well flow rates via the SCADA System.
4. Remedial Well effluent pressure readings measured at the influent manifold within the treatment system building.
5. Instantaneous values recorded from field-mounted instruments during weekly site visits. On 5/14/2020 effluent air temperature was recorded using SCADA daily average temperature due to gauge calibration.
6. Pressure readings recorded as < 1.0 iwc due to pressure being too low for gauge sensitivity.
7. Data recorded by Northrop Grumman Operator due to compliance monitoring event taking place during ISTR discharge event which required RW-1 to be turned off.

ECU	Emission Control Unit
GAC	Granular Activated Carbon
HMI	Human-Machine Interface
RW	Remedial Well
SCADA	Supervisory Control and Data Acquisition
Temp	Temperature
gpm	gallons per minute
iwc	inches of water column
psi	pounds per square inch
°R	degrees Rankine
scfm	standard cubic feet per minute

Table 8
Summary of Groundwater Recovered, VOC Mass Recovered, and VOC Mass Recovery Rates
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Northrop Grumman,
Bethpage, New York

Operating Period ¹	Volume of Groundwater Recovered (x1,000 gal) ²					VOC Mass Recovered (lbs) ³															VOC Mass Recovery Rate (lbs/day) ⁴																			
						Total VOCs ⁵					Project VOCs ⁶					Non-Project VOCs ⁷					Total VOCs ⁵				Project VOCs ⁶				Non-Project VOCs ⁷											
	RW-1	RW-2	RW-3	RW-4	Total	RW-1	RW-2	RW-3	RW-4	Total	RW-1	RW-2	RW-3	RW-4	Total	RW-1	RW-2	RW-3	RW-4	Total	RW-1	RW-2	RW-3	RW-4	Total	RW-1	RW-2	RW-3	RW-4	Total	RW-1	RW-2	RW-3	RW-4	Total	RW-1	RW-2	RW-3	RW-4	Total
System Pilot Test, Shakedown and Startup Totals⁸	137	270	251	150	808	NA	NA	NA	NA	1.1	NA	NA	NA	NA	1.0	NA	NA	NA	NA	0.1	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
2010 Totals	15,726	35,127	38,160	15,689	104,702	0.56	172	412	89	672	0.56	171	28	0.10	200	< 0.01	0.17	383	89	469	< 0.01	0.46	1.1	0.24	1.8	< 0.01	0.46	0.075	< 0.01	0.54	< 0.01	< 0.01	1.0	0.24	1.3					
2011 Totals	15,218	36,570	37,682	15,196	104,666	0.36	167	271	78	516	0.36	167	35	0.090	203	< 0.01	1.1	236	78	314	< 0.01	0.45	0.73	0.21	1.4	< 0.01	0.45	0.095	< 0.01	0.55	< 0.01	< 0.01	0.64	0.21	0.85					
2012 Totals	15,260	35,178	36,111	15,336	101,885	0.28	114	113	40	267	0.25	113	12	0.39	126	< 0.01	1.5	101	40	141	< 0.01	0.31	0.31	0.11	0.73	< 0.01	0.31	0.032	< 0.01	0.35	< 0.01	< 0.01	0.28	0.11	0.39					
2013 Totals	15,968	37,514	36,622	16,036	106,140	0.14	111	41	18	171	0.14	110	4.3	0.36	113	< 0.01	1.6	37	18	57	< 0.01	0.30	0.11	0.050	0.47	< 0.01	0.30	0.012	< 0.01	0.31	< 0.01	< 0.01	0.10	0.049	0.16					
2014 Totals	15,690	33,222	31,199	15,691	95,802	0.063	67	9.9	8.1	85	0.063	65	2.0	0.20	67	< 0.01	1.5	8.1	7.9	17	< 0.01	0.19	0.028	0.023	0.24	< 0.01	0.18	< 0.01	< 0.01	0.19	< 0.01	< 0.01	0.023	0.022	0.047					
2015 Totals	15,859	38,082	34,961	14,755	103,657	0.028	47	7.1	4.5	57	0.021	45	1.5	0.20	45	< 0.01	1.7	5.6	4.2	12	< 0.01	0.13	0.019	0.012	0.16	< 0.01	0.12	< 0.01	< 0.01	0.12	< 0.01	< 0.01	0.015	0.012	0.032					
2016 Totals	15,826	34,539	39,349	15,826	105,540	< 0.01	38	3.2	2.2	44	< 0.01	37	1.4	0.20	39	< 0.01	1.5	1.7	2.0	5.2	< 0.01	0.10	< 0.01	< 0.01	0.12	< 0.01	0.10	< 0.01	< 0.01	0.10	< 0.01	< 0.01	< 0.01	< 0.01	0.014					
2017 Totals	16,005	31,600	37,614	15,965	101,184	< 0.01	13	2.2	1.2	17	< 0.01	13	1.1	0.16	14	< 0.01	0.56	1.1	1.1	2.7	< 0.01	0.037	< 0.01	< 0.01	0.046	< 0.01	0.035	< 0.01	< 0.01	0.038	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
2019 Totals	15,456	32,470	38,416	15,343	101,685	< 0.01	11.51	1.36	0.22	13.10	< 0.01	11.51	1.07	< 0.01	12.59	< 0.01	< 0.01	0.29	0.18	0.63	< 0.01	0.032	< 0.01	< 0.01	0.036	< 0.01	0.032	< 0.01	< 0.01	0.034	< 0.01	< 0.01	< 0.01	0.001	< 0.01					
January 2020 through March 2020																																								
01/01/20 - 02/01/20	934	2,343	2,331	938	6,545	< 0.01	1.04	0.08	< 0.01	1.13	< 0.01	1.0	0.07	< 0.01	1.1	< 0.01	< 0.01	0.01	< 0.01	0.011	< 0.01	0.034	< 0.01	< 0.01	0.036	< 0.01	0.034	< 0.01	< 0.01	0.036	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
02/01/20 - 03/01/20	1,265	3,122	3,141	1,252	8,780	< 0.01	1.39	0.11	< 0.01	1.50	< 0.01	1.4	0.10	< 0.01	1.5	< 0.01	< 0.01	0.02	< 0.01	0.015	< 0.01	0.048	< 0.01	< 0.01	0.052	< 0.01	0.048	< 0.01	< 0.01	0.051	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
03/01/20 - 04/01/20	1,315	3,333	3,347	1,342	9,337	< 0.01	1.48	0.12	< 0.01	1.60	< 0.01	1.5	0.11	< 0.01	1.6	< 0.01	< 0.01	0.02	< 0.01	0.016	< 0.01	0.048	< 0.01	< 0.01	0.052	< 0.01	0.048	< 0.01	< 0.01	0.051	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
Subtotal Jan - Mar 2020	3,514	8,798	8,818	3,532	24,662	< 0.01	3.91	0.32	< 0.01	4.23	< 0.01	3.9	0.28	< 0.01	4.2	< 0.01	< 0.01	0.04	< 0.01	0.04	< 0.01	0.043	< 0.01	< 0.01	0.046	< 0.01	0.043	< 0.01	< 0.01	0.046	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
April 2020 through June 2020																																								
04/01/20 - 05/01/20	1,325	3,018	3,247	1,321	8,911	< 0.01	1.51	0.10	< 0.01	1.60	< 0.01	1.5	0.06	< 0.01	1.6	< 0.01	< 0.01	0.04	< 0.01	0.038	< 0.01	0.050	< 0.01	< 0.01	0.053	< 0.01	0.050	< 0.01	< 0.01	0.052	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
05/01/20 - 06/01/20	1,350	3,069	3,334	1,338	9,090	< 0.01	1.53	0.10	< 0.01	1.63	< 0.01	1.5	0.06	< 0.01	1.6	< 0.01	< 0.01	0.04	< 0.01	0.039	< 0.01	0.049	< 0.01	< 0.01	0.053	< 0.01	0.049	< 0.01	< 0.01	0.051	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
06/01/20 - 07/01/20	1,304	3,203	3,219	1,309	9,036	< 0.01	1.60	0.09	< 0.01	1.70	< 0.01	1.6	0.06	< 0.01	1.7	< 0.01	< 0.01	0.04	< 0.01	0.038	< 0.01	0.053	< 0.01	< 0.01	0.057	< 0.01	0.053	< 0.01	< 0.01	0.055	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
Subtotal Apr - June 2020	3,979	9,289	9,801	3,968	27,037	< 0.01	4.64	0.29	< 0.01	4.93	< 0.01	4.6	0.17	< 0.01	4.8	< 0.01	< 0.01	0.12	< 0.01	0.12	< 0.01	0.051	< 0.01	< 0.01	0.054	< 0.01	0.051	< 0.01	< 0.01	0.053	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
July 2020 through September 2020																																								
07/01/20 - 08/01/20	1,214	2,995	3,010	1,216	8,435	< 0.01	1.59	0.10	< 0.01	1.70	< 0.01	1.6	0.07	< 0.01	1.7	< 0.01	< 0.01	0.03	< 0.01	0.033	< 0.01	0.051	< 0.01	< 0.01	0.055	< 0.01	0.051	< 0.01	< 0.01	0.054	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
08/01/20 - 09/01/20	1,148	2,512	2,834	1,157	7,651	< 0.01	1.34	0.10	< 0.01	1.43	< 0.01	1.3	0.07	< 0.01	1.4	< 0.01	< 0.01	0.03	< 0.01	0.031	< 0.01	0.043	< 0.01	< 0.01	0.046	< 0.01	0.043	< 0.01	< 0.01	0.045	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
09/01/20 - 10/01/20	1,302	3,106	3,246	1,301	8,956	< 0.01	1.65	0.11	< 0.01	1.76	< 0.01	1.7	0.08	< 0.01	1.7	< 0.01	< 0.01	0.04	< 0.01	0.035	< 0.01	0.055	< 0.01	< 0.01	0.059	< 0.01	0.055	< 0.01	< 0.01	0.058	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
Subtotal July - Sept 2020	3,664	8,613	9,090	3,674	25,042	< 0.01	4.58	0.31	< 0.01	4.89	< 0.01	4.6	0.21	< 0.01	4.8	< 0.01	< 0.01	0.10	< 0.01	0.10	< 0.01	0.050	< 0.01	< 0.01	0.053	< 0.01	0.050	< 0.01	< 0.01	0.052	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
October 2020 through December 2020																																								
10/01/20 - 11/01/20	761	3,279	3,370	1,343	8,753	< 0.01	2.22	0.12	< 0.01	2.34	< 0.01	2.2	0.08	< 0.01	2.3	< 0.01	< 0.01	0.04	< 0.01	0.037	< 0.01	0.072	< 0.01	< 0.01	0.076	< 0.01	0.072	< 0.01	< 0.01	0.074	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
11/01/20 - 12/01/20	1,292	2,643	3,236	1,315	8,486	< 0.01	1.79	0.12	< 0.01	1.91	< 0.01	1.8	0.08	< 0.01	1.9	< 0.01	< 0.01	0.04	< 0.01	0.035	< 0.01	0.060	< 0.01	< 0.01	0.064	< 0.01	0.060	< 0.01	< 0.01	0.062	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
12/01/20 - 01/01/21	1,264	3,193	3,222	1,281	8,959	< 0.01	2.17	0.12	< 0.01	2.28	< 0.01	2.2	0.08	< 0.01	2.2	< 0.01	< 0.01	0.04	< 0.01	0.035	< 0.01	0.070	< 0.01	< 0.01	0.074	< 0.01	0.070	< 0.01	< 0.01	0.072	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
Subtotal Oct through Jan 2021⁹	3,318	9,114	9,828	3,938	26,198	< 0.01	6.18	0.35	< 0.01	6.53	< 0.01	6.2	0.25	< 0.01	6.4	< 0.01	< 0.01	0.11	< 0.01	0.11	< 0.01	0.067	< 0.01	< 0.01	0.071	< 0.01	0.067	< 0.01	< 0.01	0.070	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
2020 Totals	14,475	35,814	37,537	15,113	102,939	< 0.01	19.3	1.3	< 0.01	20.6	< 0.01	19.3	0.91	< 0.01	20.2	< 0.01	< 0.01	0.36	< 0.01	0.36	< 0.01	0.053	< 0.01	< 0.01	0.056	< 0.01	0.053	< 0.01	< 0.01	0.055	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
Total Since System Start Up	177,357	401,935	416,820	176,591	1,172,704	2	1,049	916	256	2,221	2	1,038	107	2	1,148	< 0.01	10	810	254	1,067	--	--																		

Table 9
Summary of Air Quality Impact Analysis
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Northrop Grumman,
Bethpage, New York



Toxic Air Contaminant ⁴	CAS#	VSP-05 Vapor Effluent (µg/m ³)	Emission Rate ¹			Scaled Impact - Hourly ² (µg/m ³)	Scaled Impact - Annual ² (µg/m ³)	SGC ³ (µg/m ³)	AGC ³ (µg/m ³)	% of SGC	% of AGC
			10/6/2020	lb/yr	lb/hr						
Project VOCs											
1,1,1-Trichloroethane	71-55-6	1.1	0.05	5.96E-06	7.5E-07	7.3E-03	1.4E-04	9,000	5,000	0.0%	0.0%
1,1-Dichloroethane	75-34-3	5.7	0.27	3.09E-05	3.9E-06	3.8E-02	7.4E-04	--	0.63	--	0.1%
1,1-Dichloroethene	75-35-4	0.87	0.04	4.72E-06	5.9E-07	5.8E-03	1.1E-04	--	200	--	0.0%
1,2-Dichloroethane	107-06-2	0.36	0.02	1.95E-06	2.5E-07	2.4E-03	4.7E-05	--	0.04	--	0.1%
Benzene	71-43-2	0.35	0.02	1.90E-06	2.4E-07	2.3E-03	4.5E-05	1,300	0.13	0.0%	0.0%
cis-1,2-Dichloroethene	156-59-2	107	5.08	5.80E-04	7.3E-05	7.1E-01	1.4E-02	--	63	--	0.0%
Tetrachloroethene	127-18-4	4.0	0.19	2.17E-05	2.7E-06	2.7E-02	5.2E-04	300	4	0.0%	0.0%
Toluene	108-88-3	1.2	0.06	6.50E-06	8.2E-07	8.0E-03	1.6E-04	37,000	5,000	0.0%	0.0%
Trichloroethene	79-01-6	37	1.76	2.01E-04	2.5E-05	2.5E-01	4.8E-03	20	0.2	1.2%	2.4%
Vinyl Chloride	75-01-4	28.1	1.33	1.52E-04	1.9E-05	1.9E-01	3.6E-03	180,000	0.11	0.0%	3.3%
Xylene-O	1330-20-7	0.96	0.02	1.84E-06	2.3E-07	2.3E-03	4.4E-05	22,000	100	0.0%	0.0%
Xylenes - M,P	1330-20-7	1.5	0.03	3.04E-06	3.8E-07	3.7E-03	7.2E-05	22,000	100	0.0%	0.0%
Non-Project VOCs											
1,2-Dichloropropane	78-87-5	0.38	0.02	2.06E-06	2.6E-07	2.5E-03	4.9E-05	--	4	--	0.0%
2-Butanone	78-93-3	5.0	0.24	2.71E-05	3.4E-06	3.3E-02	6.5E-04	13,000	5000	0.0%	0.0%
Acetone	67-64-1	36.8	1.75	1.99E-04	2.5E-05	2.5E-01	4.8E-03	180,000	30,000	0.0%	0.0%
Carbon Tetrachloride	56-23-5	0.50	0.02	2.71E-06	3.4E-07	3.3E-03	6.5E-05	1,900	0	0.0%	0.0%
Chlorodifluoromethane (Freon 22)	75-45-6	6.7	0.32	3.63E-05	4.6E-06	4.5E-02	8.7E-04	--	50,000	--	0.0%
Chloroform	67-66-3	10	0.47	5.42E-05	6.8E-06	6.7E-02	1.3E-03	150	14.7	0.0%	0.0%
Chloromethane	74-87-3	1.5	0.07	8.13E-06	1.0E-06	1.0E-02	1.9E-04	22,000	90	0.0%	0.0%
Dichlorodifluoromethane (Freon 12)	75-71-8	2.9	0.14	1.57E-05	2.0E-06	1.9E-02	3.7E-04	--	12000	--	0.0%
Dichloromethane	75-09-2	2.6	0.12	1.41E-05	1.8E-06	1.7E-02	3.4E-04	14,000	60	0.0%	0.0%
Trichlorofluoromethane (Freon 11)	75-69-4	2.0	0.09	1.08E-05	1.4E-06	1.3E-02	2.6E-04	9,000	5,000	0.0%	0.0%
Trichlorotrifluoroethane (Freon 113)	76-13-1	2.1	0.10	1.14E-05	1.4E-06	1.4E-02	2.7E-04	960,000	180,000	0.0%	0.0%

Notes, Abbreviations, and Units on last page.

Table 9
Summary of Air Quality Impact Analysis
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Northrop Grumman,
Bethpage, New York



Notes, Abbreviations, and Units:

- Emission rate calculated based on VSP-05 effluent concentration and a daily average exit air flow rate of 1,450 ft³/min for 10/06/2020. Emission rate standardized at 70 °F and 1 atm.
 $1,1,1\text{-Trichloroethane (lb/hr)} = \text{TCE } [\mu\text{g/m}^3] \times \text{Air Flow Rate [ft}^3/\text{min}] \times (1 \text{ m}^3/35.3147 \text{ ft}^3) \times (60 \text{ min/hr}) \times (0.000001 \text{ g/1 } \mu\text{g}) \times (0.0022 \text{ lb/g})$
 $\text{lb/yr} = \text{lb/hr} \times 8,760 \text{ hrs/yr}$
 $\text{g/s} = \text{lb/hr} \times \text{hr}/3,600 \text{ sec} \times 453.59 \text{ g/lb}$
- Ambient impact based on AERMOD modeling using normalized rate of 1 g/s is scaled to the actual emission rate of the pollutant. Modeling was performed using the representative meteorological data from the nearest station (Brookhaven/Farmingdale) for the years 2015 through 2019. The maximum impact from all the years was used for the calculations.
 $\text{Scaled hourly impact } (\mu\text{g/m}^3) = \text{AERMOD predicted hourly ambient impact at 1 g/s } ([\mu\text{g/m}^3]/[\text{g/s}]) \times \text{Actual emission rate (g/s)}$
 $\text{Scaled annual impact } (\mu\text{g/m}^3) = \text{AERMOD predicted annual ambient impact at 1 g/s } ([\mu\text{g/m}^3]/[\text{g/s}]) \times \text{Actual emission rate (g/s)}$

AERMOD Normalized Ambient Impact at 1 g/s	
Hourly ([$\mu\text{g/m}^3$]/[g/s])	Annual ([$\mu\text{g/m}^3$]/[g/s])
9,778.35	189.33

- Short-term and annual guideline concentrations specified in the NYSDEC DAR-1 AGC/SGC tables revised August 10, 2016.
- Compounds not detected above the laboratory reporting limit are excluded from the air quality impact analysis summary.

AGC	Annual Guideline Concentration
DAR-1	Division of Air Resources-1
--	None Specified
NYSDEC	New York State Department of Environmental Conservation
SGC	Short-term Guideline Concentration
VSP	Vapor Sampling Point
cfm	cubic feet per minute
g/s	grams per second
lb/hr	pounds per hour
lb/yr	pounds per year
$\mu\text{g/m}^3$	micrograms per cubic meter

Table 10
Summary of Remedial Well Groundwater Sample Analytical Results - VOCs
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Northrop Grumman,
Bethpage, New York

Compound ¹ (All Constituent Concentrations in µg/L)	Sample Location: Sample Date: NYSDEC SCGs	RW-1 2/6/2020	RW-1 5/14/2020	RW-1 7/8/2020	RW-1 10/20/2020	RW-2 2/6/2020	RW-2 5/14/2020	RW-2 7/8/2020	RW-2 10/6/2020	RW-3 2/6/2020	RW-3 5/14/2020	RW-3 7/8/2020	RW-3 10/6/2020	RW-4 2/6/2020	RW-4 5/14/2020	RW-4 7/8/2020	RW-4 10/6/2020
Project VOCs																	
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	0.84 J	0.98 J	0.91 J	1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethylene	5	< 1.0	< 1.0	< 1.0	< 1.0	10.5	13.0	12.0	14.7	2.2	0.63 J	1.7	1.7	< 1.0	0.63 J	< 1.0	0.58 J
Vinyl Chloride	2	< 1.0	< 1.0	< 1.0	< 1.0	10.3	13.6	17	17.1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	31.7	32.4	33.9	48.6	1.6	1.5	1.1	1.3	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Xylene-o	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Xylenes-m,p	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Subtotal Project VOCs		ND	ND	ND	ND	53.3	60.0	63.8	80.4	3.8	2.1	2.8	3.0	ND	0.63	ND	0.58
Non-Project VOCs																	
1,1,2,2-Tetrachloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,3-Butadiene	0.5	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
2-Butanone	NE	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10
4-methyl-2-pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	0.56 J	1.4	1.3	1.3	< 1.0	< 1.0	< 1.0	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,3-dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Dichloromethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl N-Butyl Ketone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Methyl tert-Butyl Ether	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Styrene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichlorofluoromethane (Freon 11)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
1-Chloro-1,1-difluoroethane (Freon 142b)	NE	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Subtotal Non-Project VOCs		ND	ND	ND	ND	ND	ND	ND	ND	0.6	1.4	1.3	1.3	ND	ND	ND	ND
Total VOCs²		ND	ND	ND	ND	53.3	60.0	63.8	80.4	4.4	3.5	4.1	4.3	ND	0.63	ND	0.58
1,4-Dioxane		0.38	0.32	0.32	0.31	2.3	3.0	3.0	1.9	0.56	0.59	0.45	0.46	0.20 J	0.18 J	0.13 J	0.25 U

Notes, Abbreviations, Qualifiers, and Units on last page.

Table 10
Summary of Remedial Well Groundwater Sample Analytical Results - VOCs
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Northrop Grumman,
Bethpage, New York

Notes, Abbreviations, Qualifiers, and Units:

1. Water samples collected by Arcadis on the dates shown and submitted to a NYSDOH ELAP certified laboratory for VOC analyses per NYSDEC ASP 2005, Method OLM 4.3 (prior to September 1, 2014) and per EPA Method 8260C (after September 1, 2014). Results validated following protocols specified in Sampling and Analysis Plan in the DRAFT Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). See previous quarterly reports for historical analytical results.

2. "Total VOCs" represents the sum of individual concentrations of the VOCs detected.

ASP	Analytical Services Protocol
ELAP	Environmental Laboratory Approval Program
NE	Not Established
NYSDEC	New York State Department of Environmental Conservation
NYSDOH	New York State Department of Health
OLM	Ozone Limited Method
OM&M	Operation, Maintenance, and Monitoring
SCGs	Standards, Criteria, and Guidance values
USEPA	United States Environmental Protection Agency
VOC	Volatile Organic Compound

	Bold cell outline indicates an exceedance of an SCG
1.4	Bold data indicates a detection
< 1.0	Compound not detected above its laboratory quantification limit
J	Compound detected below its reporting limit; value is estimated
U	Indicates the compound was analyzed for but not detected above the specified level
ND	Analyte not detected at, or above its laboratory quantification limit.
µg/L	micrograms per liter

Table 11
Summary of Water-Level Elevations
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Well/Piezometer Identification (All Elevations in ft msl)	Casing Elevation	Baseline ⁽¹⁾ 5/8/2009	1Q 2020 2/20/2020	2Q 2020 5/28/2020	3Q 2020 7/20/2020	4Q 2020 12/3/2020
Recovery Wells						
RW-1	125.18	69.75	70.95	71.08	69.99	69.38
RW-2	124.48	72.27	61.33	61.88	59.75	60.08
RW-3	122.84	69.40	67.75	67.74	66.77	66.14
RW-4	121.24	69.25	70.40	70.54	69.37	68.64
Monitoring Wells						
B24MW-2	126.96	74.31	74.47	74.32	73.77	73.66
B24MW-3	127.11	72.63	73.93	73.88	73.07	68.51
B30MW-1	128.33	73.55	73.59	73.49	72.77	71.98
BCPMW-1	125.73	73.16	NM	NM	NM	NM
BCPMW-2	126.39	72.55	NM	NM	NM	NM
BCPMW-3	124.94	72.46	NM	72.11	NM	70.54
BCPMW-4-1	128.71	72.30	71.92	71.92	71.02	70.27
BCPMW-4-2	129.33	72.58	72.20	72.20	71.34	70.53
BCPMW-4-3	129.20	72.32	72.09	72.04	71.16	70.46
BCPMW-5-1	129.37	72.79	NM	NM	NM	NM
BCPMW-6-1	126.01	72.12	71.87	120.82	70.88	70.16
BCPMW-6-2	125.16	71.74	71.58	71.50	70.52	69.81
BCPMW-7-1	124.81	72.00	71.96	71.77	70.90	70.05
MW-200-1	123.49	72.16	72.00	71.98	71.13	70.39
MW-201-1	121.69	72.04	71.76	71.77	70.83	70.09
MW-202-1	119.27	71.90	71.70	71.74	70.78	70.09
MW-203-1	118.25	71.83	71.72	71.73	70.74	70.06
MW-204-1	124.95	--	72.48	71.95	71.09	70.35
MW-205-1	123.47	--	71.73	71.69	71.40	70.05
MW-206-1	120.80	--	71.75	71.76	70.78	63.40
MW-207A-1R ⁽²⁾	120.38	--	71.43	71.37	70.44	69.69
MW-207B-1R ⁽²⁾	120.48	--	71.62	71.60	70.56	69.97
MW-208-1	118.56	--	71.93	71.39	70.59	70.21
Piezometers						
PZ-1a	128.82	72.56	71.43	71.40	70.52	69.77
PZ-1b	128.92	72.47	71.80	71.75	70.90	70.13
PZ-1c	128.96	72.47	72.07	72.00	71.10	70.40
PZ-2a	128.36	72.47	71.77	71.73	70.84	70.06
PZ-2b	128.37	72.43	71.74	71.69	70.81	70.07
PZ-2c	128.55	72.41	71.99	71.94	71.00	70.32
PZ-3	124.99	72.52	71.54	71.60	70.74	69.96
PZ-4	125.31	72.50	49.39	71.67	70.85	70.09
PZ-5a	129.07	72.50	72.52	72.46	71.64	70.92
PZ-5b	129.06	72.50	72.42	72.35	71.47	70.76
PZ-5c	128.84	--	72.42	72.30	71.46	70.75
PZ-6a	125.67	72.50	71.63	71.60	70.71	69.91
PZ-6b	125.74	72.50	71.55	71.53	70.61	69.85
PZ-7a	125.10	72.50	70.96	71.92	71.07	70.23
PZ-7b	125.06	72.50	71.73	71.73	70.74	70.02
PZ-8a	127.63	--	71.58	71.51	70.64	69.88
PZ-8b	127.54	--	71.62	71.57	70.71	69.99
PZ-8c	127.57	--	67.92	71.80	70.90	70.19
PZ-9a	125.30	--	NM	NM	NM	NM
PZ-10a	125.27	--	72.73	72.65	71.90	71.07

Notes and abbreviations on last page.

Table 11
Summary of Water-Level Elevations
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Notes and Abbreviations:

- 1. Baseline readings were taken prior to system startup, which occurred on July 21, 2009.
 - 2. Wells installed by EMAGIN in 2017 to replace monitoring wells MW-207-1a (replaced by MW-207A-1R) and MW-207-1b (replaced by MW-207B-1R) installed by ERM in 2015.
- ft msl Feet relative to mean sea level
- NM Not measured due to In-Situ Thermal Remediation activities
- Not measured as well or piezometer not installed as that time

Table 12
Concentrations of Volatile Organic Compounds and 1,4-Dioxane
in Groundwater Samples Collected from Monitoring Wells,
Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds)
Bethpage, New York

Compound ^(1,2,3) (All Constituent Concentrations in µg/L)	Sample Location: Sample Date:	B24MW-2 12/29/2016	B24MW-2 8/4/2017	B24MW-2 8/9/2018	B24MW-2 7/18/2019	B24MW-2 7/16/2020
	NYSDEC SCGs					
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2,2-Tetrachloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10	< 10
2-Hexanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
4-Methyl-2-Pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl-Tert-Butylether	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methylene Chloride	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Styrene (Monomer)	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	5	2.4	2.1	2.5	4.0	6.1
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
o-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
m,p-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽⁴⁾		2.4	2.1	2.5	4	6.1
Project VOCs⁽⁵⁾		2.4	2.1	2.5	4	6.1
1,4-Dioxane⁽⁶⁾		0.417	0.348	0.16 J	0.29	0.91

See Notes and Abbreviations on Last Page

Table 12
Concentrations of Volatile Organic Compounds and 1,4-Dioxane
in Groundwater Samples Collected from Monitoring Wells,
Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds)
Bethpage, New York

Compound ^(1,2,3)	Sample Location:	B24MW-3	B24MW-3	B24MW-3	B24MW-3	B24MW-3
(All Constituent Concentrations in µg/L)	Sample Date:	1/20/2017	8/2/2017	8/9/2018	7/16/2019	7/9/2020
	NYSDEC SCGs					
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2,2-Tetrachloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10	< 10
2-Hexanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
4-Methyl-2-Pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-Dichloroethene	5	< 1.0	0.59 J	< 1.0	3.2	< 1.0
cis-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl-Tert-Butylether	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methylene Chloride	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Styrene (Monomer)	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	5	< 1.0	< 1.0	< 1.0	1.3	< 1.0
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
o-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
m,p-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽⁴⁾		ND	0.59	ND	4.5	ND
Project VOCs⁽⁵⁾		ND	0.59	ND	4.5	ND
1,4-Dioxane⁽⁶⁾		0.918	0.675	0.11 J	< 0.24	0.31

See Notes and Abbreviations on Last Page

Table 12
Concentrations of Volatile Organic Compounds and 1,4-Dioxane
in Groundwater Samples Collected from Monitoring Wells,
Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds)
Bethpage, New York

Compound ^(1,2,3) (All Constituent Concentrations in µg/L)	Sample Location: Sample Date:	B30MW-1 1/4/2017	B30MW-1 8/3/2017	B30MW-1 8/9/2018	B30MW-1 7/17/2019	B30MW-1 7/21/2020
	NYSDEC SCGs					
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2,2-Tetrachloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10	< 10
2-Hexanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
4-Methyl-2-Pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl-Tert-Butylether	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methylene Chloride	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Styrene (Monomer)	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
o-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
m,p-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽⁴⁾		ND	ND	ND	ND	ND
Project VOCs⁽⁵⁾		ND	ND	ND	ND	ND
1,4-Dioxane⁽⁶⁾		< 0.200	< 0.200	< 0.24	< 0.24	< 0.24

See Notes and Abbreviations on Last Page

Table 12
Concentrations of Volatile Organic Compounds and 1,4-Dioxane
in Groundwater Samples Collected from Monitoring Wells,
Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds)
Bethpage, New York

Compound ^(1,2,3) (All Constituent Concentrations in µg/L)	Sample Location:	BCPMW-4-1	BCPMW-4-1	BCPMW-4-1	BCPMW-4-1	BCPMW-4-1	BCPMW-4-1
	Sample Date:	12/30/2015	12/28/2016	7/31/2017	7/24/2018	7/11/2019	7/20/2020
	NYSDEC SCGs						
1,1,1-Trichloroethane	5	7.3	0.36 J	< 1.0	< 1.0	< 1.0	1.4
1,1,2,2-Tetrachloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	1	1.7	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	27.1	3.2	1.6	0.87 J	0.73 J	6.2
1,1-Dichloroethene	5	1.7	0.42 J	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	0.6	1.3	0.87 J	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	1.5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10	< 10	< 10
2-Hexanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
4-Methyl-2-Pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	1.1	1.4	0.76 J	< 1.0	< 1.0	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-Dichloroethene	5	252 D	81.4	53.5	30.7	20.7	96.7
cis-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl-Tert-Butylether	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methylene Chloride	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Styrene (Monomer)	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	1.1	0.50 J	< 1.0	< 1.0	< 1.0	< 1.0
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-Dichloroethene	5	0.86 J	0.49 J	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	5	81.5	48.2	21.9	13.5	8.9	32.9
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	197	3.3	< 1.0	< 1.0	< 1.0	5.6
o-Xylene	5	0.70 J	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
m,p-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽⁴⁾		570	140	78	45	30	142.8
Project VOCs⁽⁵⁾		570	140	77	45	30	142.8
1,4-Dioxane⁽⁶⁾		37.7	39.3	2.64	0.68	7.4	31

See Notes and Abbreviations on Last Page

Table 12
Concentrations of Volatile Organic Compounds and 1,4-Dioxane
in Groundwater Samples Collected from Monitoring Wells,
Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds)
Bethpage, New York

Compound ^(1,2,3) (All Constituent Concentrations in µg/L)	Sample Location:	BCPMW-4-2	BCPMW-4-2 (REP)	BCPMW-4-2	BCPMW-4-2	BCPMW-4-2	BCPMW-4-2
	Sample Date:	12/22/2016	12/22/2016	7/31/2017	7/24/2018	7/11/2019	7/20/2020
	NYSDEC SCGs						
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2,2-Tetrachloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	0.22 J	0.23 J	0.25 J	0.87 J	0.97 J	0.59
1,1-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10	< 10	< 10
2-Hexanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
4-Methyl-2-Pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	3.9	3.6	2.3	1.3	< 1.0	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-Dichloroethene	5	16.9	17.4	19.9	58.1	68.5	54.6
cis-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl-Tert-Butylether	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methylene Chloride	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Styrene (Monomer)	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	< 1.0	0.27 J	< 1.0	< 1.0	< 1.0	< 1.0
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-Dichloroethene	5	0.62 J	0.58 J	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	5	18.0	18.1	17.6	61.5	37.0	44.1
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	0.97
o-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
m,p-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽⁴⁾		40	40	40	120	110	100.26
Project VOCs⁽⁵⁾		36	37	38	120	110	100.26
1,4-Dioxane⁽⁶⁾		2.34	2.40	1.35	2.4	0.77	10

See Notes and Abbreviations on Last Page

Table 12
Concentrations of Volatile Organic Compounds and 1,4-Dioxane
in Groundwater Samples Collected from Monitoring Wells,
Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds)
Bethpage, New York

Compound ^(1,2,3)	Sample Location:	BCPMW-4-3	BCPMW-4-3	BCPMW-4-3	BCPMW-4-3	BCPMW-4-3
(All Constituent Concentrations in µg/L)	Sample Date:	12/22/2016	8/3/2017	8/8/2018	7/11/2019	7/21/2020
	NYSDEC SCGs					
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2,2-Tetrachloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10	< 10
2-Hexanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
4-Methyl-2-Pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	0.52 J	< 1.0	< 1.0	< 1.0	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl-Tert-Butylether	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methylene Chloride	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Styrene (Monomer)	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
o-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
m,p-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽⁴⁾		0.52	ND	ND	ND	ND
Project VOCs⁽⁵⁾		ND	ND	ND	ND	ND
1,4-Dioxane⁽⁶⁾		0.776	0.616	0.43	0.41	0.44

See Notes and Abbreviations on Last Page

Table 12
Concentrations of Volatile Organic Compounds and 1,4-Dioxane
in Groundwater Samples Collected from Monitoring Wells,
Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds)
Bethpage, New York

Compound ^(1,2,3)	Sample Location:	BCPMW-6-1	BCPMW-6-1	BCPMW-6-1	BCPMW-6-1	BCPMW-6-1
(All Constituent Concentrations in µg/L)	Sample Date:	12/27/2016	8/1/2017	8/6/2018	7/15/2019	7/13/2020
	NYSDEC SCGs					
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2,2-Tetrachloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10	< 10
2-Hexanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
4-Methyl-2-Pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0	< 5.0	3.7 J	4.1 J	3.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl-Tert-Butylether	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methylene Chloride	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Styrene (Monomer)	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
o-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
m,p-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽⁴⁾		ND	ND	3.7	4.1	3
Project VOCs⁽⁵⁾		ND	ND	ND	ND	ND
1,4-Dioxane⁽⁶⁾		< 0.200	< 0.200	< 0.24	< 0.23	< 0.23

See Notes and Abbreviations on Last Page

Table 12
Concentrations of Volatile Organic Compounds and 1,4-Dioxane
in Groundwater Samples Collected from Monitoring Wells,
Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds)
Bethpage, New York

Compound ^(1,2,3)	Sample Location:	BCPMW-6-2	BCPMW-6-2	BCPMW-6-2	BCPMW-6-2	BCPMW-6-2
(All Constituent Concentrations in µg/L)	Sample Date:	12/27/2016	8/2/2017	8/6/2018	7/16/2019	7/13/2020
	NYSDEC SCGs					
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2,2-Tetrachloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	< 1.0	0.21 J	< 1.0	< 1.0	< 1.0
1,1-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10	< 10
2-Hexanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
4-Methyl-2-Pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-Dichloroethene	5	< 1.0	< 1.0	0.97 J	0.92 J	< 1.0
cis-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl-Tert-Butylether	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methylene Chloride	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Styrene (Monomer)	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
o-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
m,p-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽⁴⁾		ND	0.21	0.97	0.92	ND
Project VOCs⁽⁵⁾		ND	0.21	0.97	0.92	ND
1,4-Dioxane⁽⁶⁾		< 0.200	< 0.100	0.092 J	0.096 J	0.16

See Notes and Abbreviations on Last Page

Table 12
Concentrations of Volatile Organic Compounds and 1,4-Dioxane
in Groundwater Samples Collected from Monitoring Wells,
Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds)
Bethpage, New York

Compound ^(1,2,3)	Sample Location:	BCPMW-7-1	BCPMW-7-1	BCPMW-7-1	BCPMW-7-1	BCPMW-7-1	BCPMW-7-1
(All Constituent Concentrations in µg/L)	Sample Date:	12/28/2016	8/1/2017	8/3/2018	8/8/2018	7/10/2019	7/9/2020
	NYSDEC SCGs						
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2,2-Tetrachloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10	< 10	< 10
2-Hexanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
4-Methyl-2-Pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl-Tert-Butylether	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methylene Chloride	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Styrene (Monomer)	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
o-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
m,p-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽⁴⁾		ND	ND	ND	ND	ND	ND
Project VOCs⁽⁵⁾		ND	ND	ND	ND	ND	ND
1,4-Dioxane⁽⁶⁾		< 0.200	< 0.200	--	< 0.24	< 0.24	< 0.24

See Notes and Abbreviations on Last Page

Table 12
Concentrations of Volatile Organic Compounds and 1,4-Dioxane
in Groundwater Samples Collected from Monitoring Wells,
Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds)
Bethpage, New York

Compound ^(1,2,3)	Sample Location:	MW-200-1	MW-200-1	MW-200-1	MW-200-1	MW-200-1
(All Constituent Concentrations in µg/L)	Sample Date:	1/17/2017	8/7/2017	7/30/2018	7/8/2019	7/14/2020
	NYSDEC SCGs					
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2,2-Tetrachloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethene	5	< 1.0	< 1.0	< 1.0 J	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10	< 10
2-Hexanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
4-Methyl-2-Pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0 J	< 2.0	< 2.0
Carbon Tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0	< 5.0	< 5.0 J	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl-Tert-Butylether	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methylene Chloride	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Styrene (Monomer)	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
o-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
m,p-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽⁴⁾		ND	ND	ND	ND	ND
Project VOCs⁽⁵⁾		ND	ND	ND	ND	ND
1,4-Dioxane⁽⁶⁾		0.725	0.537	0.40	0.26	0.35

See Notes and Abbreviations on Last Page

Table 12
Concentrations of Volatile Organic Compounds and 1,4-Dioxane
in Groundwater Samples Collected from Monitoring Wells,
Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds)
Bethpage, New York

Compound ^(1,2,3)	Sample Location:	MW-201-1	MW-201-1	MW-201-1	MW-201-1	MW-201-1
(All Constituent Concentrations in µg/L)	Sample Date:	1/18/2017	8/8/2017	8/1/2018	7/8/2019	7/14/2020
	NYSDEC SCGs					
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2,2-Tetrachloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10	< 10
2-Hexanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
4-Methyl-2-Pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-Dichloroethene	5	2.0	1.5	0.87 J	< 1.0	0.6
cis-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl-Tert-Butylether	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methylene Chloride	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Styrene (Monomer)	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	5	1.6	1.3	0.90 J	0.69 J	< 1.0
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
o-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
m,p-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽⁴⁾		3.6	2.8	1.8	0.69	0.6
Project VOCs⁽⁵⁾		3.6	2.8	1.8	0.69	0.6
1,4-Dioxane⁽⁶⁾		0.655	0.676	0.40	0.30	0.47

See Notes and Abbreviations on Last Page

Table 12
Concentrations of Volatile Organic Compounds and 1,4-Dioxane
in Groundwater Samples Collected from Monitoring Wells,
Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds)
Bethpage, New York

Compound ^(1,2,3)	Sample Location:	MW-202-1	MW-202-1	MW-202-1	MW-202-1	MW-202-1
(All Constituent Concentrations in µg/L)	Sample Date:	1/19/2017	8/9/2017	7/31/2018	7/10/2019	7/17/2020
	NYSDEC SCGs					
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2,2-Tetrachloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	0.66 J	0.80 J	< 1.0	< 1.0	< 1.0
1,1-Dichloroethene	5	0.33 J	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10	< 10
2-Hexanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
4-Methyl-2-Pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-Dichloroethene	5	0.45 J	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl-Tert-Butylether	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methylene Chloride	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Styrene (Monomer)	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	1.3	1.4	1.1	< 1.0	< 1.0
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	5	0.68 J	0.96 J	0.70 J	< 1.0	< 1.0
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
o-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
m,p-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽⁴⁾		3.4	3.2	1.8	ND	ND
Project VOCs⁽⁵⁾		3.4	3.2	1.8	ND	ND
1,4-Dioxane⁽⁶⁾		0.396	0.518	0.30	0.17 J	0.24

See Notes and Abbreviations on Last Page

Table 12
Concentrations of Volatile Organic Compounds and 1,4-Dioxane
in Groundwater Samples Collected from Monitoring Wells,
Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds)
Bethpage, New York

Compound ^(1,2,3)	Sample Location:	MW-203-1	MW-203-1	MW-203-1	MW-203-1	MW-203-1
(All Constituent Concentrations in µg/L)	Sample Date:	1/20/2017	8/10/2017	8/2/2018	7/9/2019	7/15/2020
	NYSDEC SCGs					
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2,2-Tetrachloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	0.30 J	0.34 J	< 1.0	< 1.0	< 1.0
1,1-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10	< 10
2-Hexanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
4-Methyl-2-Pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	2.0 J	3.3 J	< 5.0	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	0.27 J	0.35 J	< 1.0	< 1.0	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-Dichloroethene	5	0.92 J	0.55 J	< 1.0	< 1.0	< 1.0
cis-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl-Tert-Butylether	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methylene Chloride	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Styrene (Monomer)	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	0.76 J	1.2	< 1.0	1.2	< 1.0
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	5	3.9	2.9	2.6	2.3	3.2
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
o-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
m,p-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽⁴⁾		8.2	8.6	2.6	3.5	3.2
Project VOCs⁽⁵⁾		5.9	5.0	2.6	3.5	3.2
1,4-Dioxane⁽⁶⁾		0.401	0.262	0.19 J	0.24	0.27

See Notes and Abbreviations on Last Page

Table 12
Concentrations of Volatile Organic Compounds and 1,4-Dioxane
in Groundwater Samples Collected from Monitoring Wells,
Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds)
Bethpage, New York

Compound ^(1,2,3) (All Constituent Concentrations in µg/L)	Sample Location: Sample Date:	MW-204-1 1/17/2017	MW-204-1 8/7/2017	MW-204-1 (REP) 8/7/2017	MW-204-1 7/30/2018	MW-204-1 7/8/2019	MW-204-1 7/14/2020
	NYSDEC SCGs						
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2,2-Tetrachloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0 J	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10	< 10	< 10
2-Hexanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
4-Methyl-2-Pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0 J	< 2.0	< 2.0
Carbon Tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0	< 5.0	< 5.0	< 5.0 J	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	0.24 J	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-Dichloroethene	5	3.4	< 1.0	< 1.0	< 1.0	< 1.0	1.0
cis-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl-Tert-Butylether	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methylene Chloride	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Styrene (Monomer)	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	5	4.1	2.4	2.5	0.63 J	< 1.0	1.7
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
o-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
m,p-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽⁴⁾		7.7	2.4	2.5	0.63	ND	2.7
Project VOCs⁽⁵⁾		7.5	2.4	2.5	0.63	ND	2.7
1,4-Dioxane⁽⁶⁾		0.350	0.306	0.319	0.25 J	0.14 J	< 0.23

See Notes and Abbreviations on Last Page

Table 12
Concentrations of Volatile Organic Compounds and 1,4-Dioxane
in Groundwater Samples Collected from Monitoring Wells,
Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds)
Bethpage, New York

Compound ^(1,2,3)	Sample Location:	MW-205-1	MW-205-1	MW-205-1	MW-205-1	MW-205-1
(All Constituent Concentrations in µg/L)	Sample Date:	1/18/2017	8/8/2017	8/1/2018	7/8/2019	7/14/2020
	NYSDEC SCGs					
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2,2-Tetrachloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10	< 10
2-Hexanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
4-Methyl-2-Pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	0.64 J	< 1.0	< 1.0	< 1.0	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-Dichloroethene	5	0.39 J	0.62 J	0.76 J	< 1.0	< 1.0
cis-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl-Tert-Butylether	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methylene Chloride	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Styrene (Monomer)	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	5	0.91 J	0.41 J	< 1.0	< 1.0	< 1.0
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
o-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
m,p-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽⁴⁾		1.9	1.0	0.76	ND	ND
Project VOCs⁽⁵⁾		1.3	1.0	0.76	ND	ND
1,4-Dioxane⁽⁶⁾		0.366	0.714	0.40	0.16 J	0.3

See Notes and Abbreviations on Last Page

Table 12
Concentrations of Volatile Organic Compounds and 1,4-Dioxane
in Groundwater Samples Collected from Monitoring Wells,
Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds)
Bethpage, New York

Compound ^(1,2,3)	Sample Location:	MW-206-1	MW-206-1	MW-206-1	MW-206-1	MW-206-1
(All Constituent Concentrations in µg/L)	Sample Date:	1/19/2017	8/9/2017	7/31/2018	7/9/2019	7/17/2020
	NYSDEC SCGs					
1,1,1-Trichloroethane	5	0.27 J	0.76 J	< 1.0	< 1.0	< 1.0
1,1,2,2-Tetrachloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	0.74 J	3.0	0.96 J	< 1.0	0.58
1,1-Dichloroethene	5	0.27 J	1.7	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10	< 10
2-Hexanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
4-Methyl-2-Pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-Dichloroethene	5	0.92 J	1.3	0.56 J	< 1.0	< 1.0
cis-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl-Tert-Butylether	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methylene Chloride	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Styrene (Monomer)	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	0.56 J	2.8	1.4	< 1.0	1.3
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	5	< 1.0	0.65 J	0.79 J	< 1.0	0.75
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
o-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
m,p-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽⁴⁾		2.8	10	3.7	ND	2.63
Project VOCs⁽⁵⁾		2.8	10	3.7	ND	2.63
1,4-Dioxane⁽⁶⁾		0.301	1.06	0.34	0.21 J	0.59

See Notes and Abbreviations on Last Page

Table 12
Concentrations of Volatile Organic Compounds and 1,4-Dioxane
in Groundwater Samples Collected from Monitoring Wells,
Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds)
Bethpage, New York

Compound ^(1,2,3) (All Constituent Concentrations in µg/L)	Sample Location:	MW-207A-1R	MW-207B-1R	MW-207A-1R	MW-207B-1R
	Sample Date:	7/10/2019	7/10/2019	7/16/2020	7/16/2020
	NYSDEC SCGs				
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2,2-Tetrachloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10
2-Hexanone	50	< 5.0	< 5.0	< 5.0	< 5.0
4-Methyl-2-Pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0	< 5.0	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	< 1.0	< 1.0	< 1.0	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0
Methyl-Tert-Butylether	5	< 1.0	< 1.0	< 1.0	< 1.0
Methylene Chloride	5	< 2.0	< 2.0	< 2.0	< 2.0
Styrene (Monomer)	5	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-Dichloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	5	< 1.0	0.88 J	< 1.0	0.69
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	< 1.0	< 1.0	< 1.0	< 1.0
o-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0
m,p-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽⁴⁾		ND	0.88	ND	0.69
Project VOCs⁽⁵⁾		ND	0.88	ND	0.69
1,4-Dioxane⁽⁶⁾		0.45	0.68	0.45	0.87

See Notes and Abbreviations on Last Page

Table 12
Concentrations of Volatile Organic Compounds and 1,4-Dioxane
in Groundwater Samples Collected from Monitoring Wells,
Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds)
Bethpage, New York

Compound ^(1,2,3)	Sample Location:	MW-208-1	MW-208-1	MW-208-1	MW-208-1 (REP)	MW-208-1	MW-208-1 (REP)	MW-208-1
(All Constituent Concentrations in µg/L)	Sample Date:	1/20/2017	8/10/2017	8/2/2018	8/2/2018	7/9/2019	7/9/2019	7/15/2020
	NYSDEC SCGs							
1,1,1-Trichloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2,2-Tetrachloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	5	2.1	1.1	0.61 J	< 1.0	0.69 J	< 1.0	< 1.0
1,1-Dichloroethene	5	0.70 J	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloroethane	0.6	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	1	0.35 J	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
2-Butanone	NE	< 10	< 10	< 10	< 10	< 10	< 10	< 10
2-Hexanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
4-Methyl-2-Pentanone	50	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0 J	< 5.0	< 5.0
Acetone	NE	< 10	< 10	< 10	< 10	< 10	< 10	< 10
Benzene	1	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	60	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Chloroethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	7	2.8	1.4	0.75 J	0.71 J	0.53 J	0.62 J	< 1.0
Chloromethane	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,2-Dichloroethene	5	597	268	129	135	176 J	166	44.6
cis-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl-Tert-Butylether	5	0.43 J	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methylene Chloride	5	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0
Styrene (Monomer)	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Tetrachloroethene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Toluene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,2-Dichloroethene	5	0.60 J	1.6	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	0.4	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	5	10.9	12.8	11.7	11.4	9.1	9.4	4.5
Trichlorotrifluoroethane (Freon 113)	5	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0
Vinyl Chloride	2	3.3	1.8	1.1	0.98 J	< 1.0	< 1.0	< 1.0
o-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
m,p-Xylene	5	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
Total VOCs⁽⁴⁾		620	290	140	150	190	180	49.1
Project VOCs⁽⁵⁾		610	290	140	150	190	180	49.1
1,4-Dioxane⁽⁶⁾		1.02	0.800	0.51	0.35	0.38	0.40	0.40

See Notes and Abbreviations on Last Page

Table 12
Concentrations of Volatile Organic Compounds and 1,4-Dioxane
in Groundwater Samples Collected from Monitoring Wells,
Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds)
Bethpage, New York

Compound ^(1,2,3)	Sample Location:	MW-208-2 (REP)
(All Constituent Concentrations in µg/L)	Sample Date:	7/16/2020
	NYSDEC SCGs	
1,1,1-Trichloroethane	5	< 1.0
1,1,2,2-Tetrachloroethane	5	< 1.0
1,1,2-Trichloroethane	1	< 1.0
1,1-Dichloroethane	5	< 1.0
1,1-Dichloroethene	5	< 1.0
1,2-Dichloroethane	0.6	< 1.0
1,2-Dichloropropane	1	< 1.0
2-Butanone	NE	< 10
2-Hexanone	50	< 5.0
4-Methyl-2-Pentanone	50	< 5.0
Acetone	NE	< 10
Benzene	1	< 0.50
Bromodichloromethane	50	< 1.0
Bromoform	50	< 1.0
Bromomethane	5	< 2.0
Carbon Disulfide	60	< 2.0
Carbon Tetrachloride	5	< 1.0
Chlorobenzene	5	< 1.0
Chlorodifluoromethane (Freon 22)	NE	< 5.0
Chloroethane	5	< 1.0
Chloroform	7	< 1.0
Chloromethane	5	< 1.0
cis-1,2-Dichloroethene	5	44.4
cis-1,3-Dichloropropene	0.4	< 1.0
Chlorodibromomethane	50	< 1.0
Dichlorodifluoromethane (Freon 12)	5	< 2.0
Ethylbenzene	5	< 1.0
Methyl-Tert-Butylether	5	< 1.0
Methylene Chloride	5	< 2.0
Styrene (Monomer)	5	< 1.0
Tetrachloroethene	5	< 1.0
Toluene	5	< 1.0
trans-1,2-Dichloroethene	5	< 1.0
trans-1,3-Dichloropropene	0.4	< 1.0
Trichloroethene	5	4.5
Trichlorotrifluoroethane (Freon 113)	5	< 5.0
Vinyl Chloride	2	< 1.0
o-Xylene	5	< 1.0
m,p-Xylene	5	< 1.0
Total VOCs⁽⁴⁾		48.9
Project VOCs⁽⁵⁾		48.9
1,4-Dioxane⁽⁶⁾		0.41

See Notes and Abbreviations on Last Page

Table 12
Concentrations of Volatile Organic Compounds and 1,4-Dioxane
in Groundwater Samples Collected from Monitoring Wells,
Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds)
Bethpage, New York

Notes and Abbreviations

1. Historical data available in previous quarterly reports.
2. Results are validated at 20% frequency, per protocols specified in Sampling and Analysis Plan in the Bethpage Park Groundwater Containment System OM&M Manual (ARCADIS 2016).
3. Samples analyzed for the TCL VOCs using USEPA Method 8260C.
4. "Total VOCs" represents the sum of individual concentrations of the VOCs detected. TVOCs were rounded to two significant figures.
5. "Project VOCs" represents the sum of individual concentrations of 1,1,1-Trichloroethane; 1,1-Dichloroethane; 1,2-Dichloroethane; 1,1-Dichloroethene; Tetrachloroethene; Trichloroethene; Vinyl Chloride; cis-1,2-Dichloroethene; trans-1,2-Dichloroethene; Benzene; Toluene; and Xylenes-o,m, and p.
6. Samples analyzed for 1,4-Dioxane using USEPA Method 8270D SIM (prior to 2016), per USEPA Method 522 SIM (2016-2017) and per USEPA Method 8270D SIM (since 2018).

	Bolded outline indicates an exceedance of an SCG.
< 5	Compound not detected above its laboratory quantification limit.
2.1	Bold value indicates a detection.
D	Constituent identified from secondary dilution
J	Result is estimated
ug/L	Micrograms per liter
NE	Not Established
--	Not Analyzed
NYSDEC	New York State Department of Environmental Conservation
REP	Field Replicate QA/QC sample
SCGs	Standards, Criteria, and Guidance values
SIM	Selective Ion Monitoring
TCL	Target compound list.
USEPA	United State Environmental Protection Agency
VOC	Volatile Organic Compound
OU	Operable Unit
ND	Analyte not detected at, or above its laboratory quantification limit.

Table 13
Concentrations of Metals in Groundwater Samples Collected
from Monitoring Wells, Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds),
Bethpage, New York

Constituents (All Constituent Concentrations in µg/l)	Sample Location:	BCPMW-4-1	BCPMW-4-1	BCPMW-4-1	BCPMW-4-1
	Sample Date:	7/31/2017	7/24/2018	7/11/2019	7/20/2020
	NYSDEC SCGs				
Cadmim, Total	5	< 3.0	< 3.0	< 3.0	< 3.0
Cadmim, Dissolved	5	< 3.0	< 3.0	< 3.0	< 3.0
Chromim, Total	50	< 10	< 10	19.4	30.3
Chromim, Dissolved	50	< 10	< 10	17.2	27.6

Table 13
Concentrations of Metals in Groundwater Samples Collected
from Monitoring Wells, Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds),
Bethpage, New York

Constituents (All Constituent Concentrations in µg/l)	Sample Location:	BCPMW-4-2	BCPMW-4-2	BCPMW-4-2	BCPMW-4-2
	Sample Date:	7/31/2017	7/24/2018	7/11/2019	7/20/2020
	NYSDEC SCGs				
Cadmim, Total	5	< 3.0	< 3.0	< 3.0	< 3.0
Cadmim, Dissolved	5	< 3.0	< 3.0	< 3.0	< 3.0
Chromim, Total	50	< 10	< 10	< 10	< 10
Chromim, Dissolved	50	< 10	< 10	< 10	< 10

Table 13
Concentrations of Metals in Groundwater Samples Collected
from Monitoring Wells, Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds),
Bethpage, New York

Constituents (All Constituent Concentrations in µg/l)	Sample Location:	BCPMW-4-3	BCPMW-4-3	BCPMW-4-3	BCPMW-4-3
	Sample Date:	8/3/2017	8/8/2018	7/11/2019	7/21/2020
	NYSDEC SCGs				
Cadmim, Total	5	< 3.0	< 3.0	< 3.0	< 3.0
Cadmim, Dissolved	5	< 3.0	< 3.0	< 3.0	< 3.0
Chromim, Total	50	< 10	< 10	< 10	< 10
Chromim, Dissolved	50	< 10	< 10	< 10	< 10

Table 13
Concentrations of Metals in Groundwater Samples Collected
from Monitoring Wells, Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds),
Bethpage, New York

Constituents (All Constituent Concentrations in µg/l)	Sample Location:	BCPMW-6-1	BCPMW-6-1	BCPMW-6-1	BCPMW-6-1	BCPMW-6-2	BCPMW-6-2	BCPMW-6-2
	Sample Date:	8/1/2017	8/6/2018	7/15/2019	7/13/2020	8/2/2017	8/6/2018	7/13/2020
	NYSDEC SCGs							
Cadmim, Total	5	< 3.0	< 3.0	< 3.0	< 3.0	3.3	< 3.0	< 3.0
Cadmim, Dissolved	5	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
Chromim, Total	50	< 10	< 10	< 10	< 10	87.7	< 10	19.8
Chromim, Dissolved	50	< 10	< 10	< 10	< 10	< 10	< 10	< 10

Table 13
Concentrations of Metals in Groundwater Samples Collected
from Monitoring Wells, Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds),
Bethpage, New York

Constituents (All Constituent Concentrations in µg/l)	Sample Location:	BCPMW-7-1	BCPMW-7-1	BCPMW-7-1	BCPMW-7-1	BCPMW-7-1	MW-200-1	MW-200-1	MW-200-1	MW-200-1
	Sample Date:	8/1/2017	8/3/2018	8/8/2018	7/10/2019	7/9/2020	8/7/2017	7/30/2018	7/8/2019	7/14/2020
	NYSDEC SCGs									
Cadmim, Total	5	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
Cadmim, Dissolved	5	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
Chromim, Total	50	< 10	< 10	< 10	< 10	11.6	11.1	12.4	11.5	15.4
Chromim, Dissolved	50	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10

Table 13
Concentrations of Metals in Groundwater Samples Collected
from Monitoring Wells, Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds),
Bethpage, New York

Constituents (All Constituent Concentrations in µg/l)	Sample Location:	MW-201-1	MW-201-1	MW-201-1	MW-201-1
	Sample Date:	8/8/2017	8/1/2018	7/8/2019	7/14/2020
	NYSDEC SCGs				
Cadmim, Total	5	< 3.0	< 3.0	< 3.0	< 3.0
Cadmim, Dissolved	5	< 3.0	< 3.0	< 3.0	< 3.0
Chromim, Total	50	11.7	< 10	< 10	18
Chromim, Dissolved	50	< 10	< 10	< 10	< 10

Table 13
Concentrations of Metals in Groundwater Samples Collected
from Monitoring Wells, Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds),
Bethpage, New York

Constituents (All Constituent Concentrations in µg/l)	Sample Location:	MW-202-1	MW-202-1	MW-202-1	MW-202-1
	Sample Date:	8/9/2017	7/31/2018	7/10/2019	7/17/2020
	NYSDEC SCGs				
Cadmim, Total	5	< 3.0	< 3.0	< 3.0	< 3.0
Cadmim, Dissolved	5	< 3.0	< 3.0	< 3.0	< 3.0
Chromim, Total	50	73.4	21.4	26.5	71.4
Chromim, Dissolved	50	14.4	< 10	< 10	13.2

Table 13
Concentrations of Metals in Groundwater Samples Collected
from Monitoring Wells, Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds),
Bethpage, New York

Constituents (All Constituent Concentrations in µg/l)	Sample Location:	MW-203-1	MW-203-1	MW-203-1	MW-203-1
	Sample Date:	8/10/2017	8/2/2018	7/9/2019	7/15/2020
	NYSDEC SCGs				
Cadmim, Total	5	< 3.0	< 3.0	< 3.0	< 3.0
Cadmim, Dissolved	5	< 3.0	< 3.0	< 3.0	< 3.0
Chromim, Total	50	138	22.7	< 10	13.1
Chromim, Dissolved	50	< 10	< 10	< 10	< 10

Table 13
Concentrations of Metals in Groundwater Samples Collected
from Monitoring Wells, Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds),
Bethpage, New York

Constituents (All Constituent Concentrations in µg/l)	Sample Location:	MW-204-1	MW-204-1 (REP)	MW-204-1	MW-204-1	MW-204-1	MW-205-1	MW-205-1	MW-205-1	MW-205-1
	Sample Date:	8/7/2017	8/7/2017	7/30/2018	7/8/2019	7/14/2020	8/8/2017	8/1/2018	7/8/2019	7/14/2020
	NYSDEC SCGs									
Cadmim, Total	5	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
Cadmim, Dissolved	5	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
Chromim, Total	50	175	171	239	30.1	18.9	134	88.7	70.2	242
Chromim, Dissolved	50	87.0	85.3	89.1	< 10	< 10	< 10	23.7	22.1	80

Table 13
Concentrations of Metals in Groundwater Samples Collected
from Monitoring Wells, Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds),
Bethpage, New York

Constituents (All Constituent Concentrations in µg/l)	Sample Location:	MW-206-1	MW-206-1	MW-206-1	MW-206-1	MW-207A-1R	MW-207A-1R	MW-207B-1R	MW-207B-1R
	Sample Date:	8/9/2017	7/31/2018	7/9/2019	7/17/2020	7/10/2019	7/16/2020	7/10/2019	7/16/2020
	NYSDEC SCGs								
Cadmim, Total	5	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
Cadmim, Dissolved	5	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
Chromim, Total	50	82.0	13.6	10.7	24.7	< 10	< 10	86.6	215
Chromim, Dissolved	50	10.7	< 10	< 10	< 10	< 10	< 10	< 10	< 10

Table 13
Concentrations of Metals in Groundwater Samples Collected
from Monitoring Wells, Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds),
Bethpage, New York

Constituents (All Constituent Concentrations in µg/l)	Sample Location:	MW-208-1	MW-208-1	MW-208-1 (REP)	MW-208-1	MW-208-1 (REP)	MW-208-1	MW-208-1 (REP)
	Sample Date:	8/10/2017	8/2/2018	8/2/2018	7/9/2019	7/9/2019	7/15/2020	7/15/2020
	NYSDEC SCGs							
Cadmim, Total	5	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
Cadmim, Dissolved	5	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
Chromim, Total	50	< 10	< 10	< 10	< 10	< 10	< 10	< 10
Chromim, Dissolved	50	< 10	< 10	< 10	< 10	< 10	< 10	< 10

Table 13
Concentrations of Metals in Groundwater Samples Collected
from Monitoring Wells, Bethpage Park Groundwater Containment System,
OU3 (Former Settling Ponds),
Bethpage, New York


Notes and Abbreviations:

1. Historical data available in previous quarterly reports.
2. Results are validated at 20% frequency, per protocols specified in Sampling and Analysis Plan in the Bethpage Park Groundwater Containment System OM&M Manual (ARCADIS 2016).
3. Samples analyzed for metals using USEPA Method 6010.

ug/L	Micrograms per liter
	Indicates an exceedance of an SCG
12.5	Bold indicates a detection
< 3.0	Compound not detected above its laboratory quantification limit
NYSDEC	New York State Department of Environmental Conservation
SCGs	Standards, Criteria, and Guidance values
OU	Operable Unit

Figures

CITY:SYRACUSE-NY DIV:GROUP:ENV DB:A.SANCHEZ LD: PIC:Op4 PM:Reop4 TM:Op4 LVR:Op4 ON:OFF-REF.
 G:\ENV\CAD\STRACUSE\ACT\1001496114\DOMINANT\1496_BUI.dwg LAYOUT: BETHPAGE PARK. SAVED: 11/11/2015 4:51 PM ACADVER: 19.1.S (LMS TECH) PAGES: 19. PAGESETUP: PLOTSTYLETABLE: PLOTTED: 11/11/2015 4:54 PM BY: STOWELL, GARY

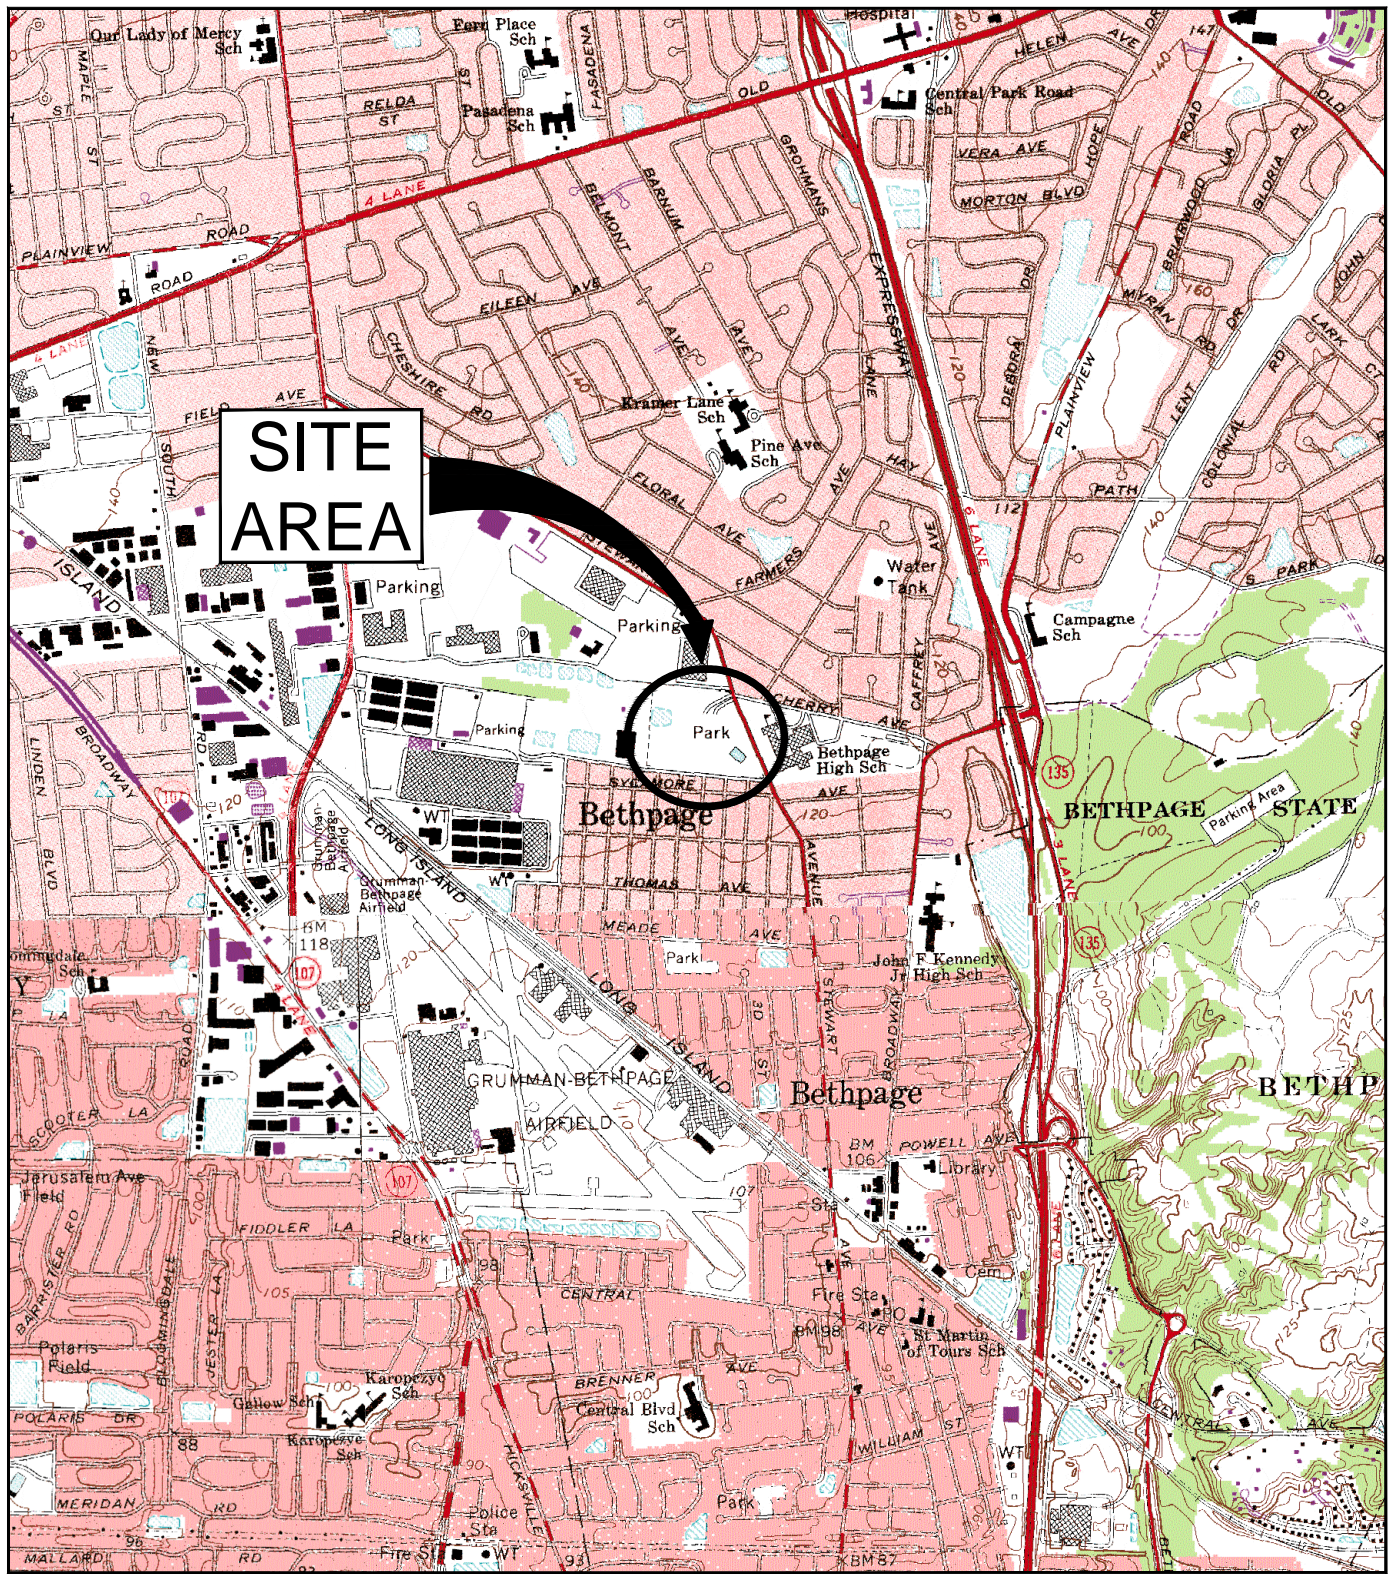

SOURCE:
 USGS 7.5 MIN. AMITYVILLE QUADRANGLE, AMITYVILLE, N.Y., 1994, FREEPORT QUADRANGLE, FREEPORT, N.Y., 1994,
 HICKSVILLE QUADRANGLE, HICKSVILLE, N.Y., 1967, PHOTOREVISED 1979, HUNTINGTON, N.Y., 1967, PHOTOREVISED 1979




BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM
 OPERABLE UNIT 3
 (FORMER GRUMMAN SETTLING PONDS)
 BETHPAGE, NEW YORK

SITE LOCATION



FIGURE
1


CITY:SYRACUSE-ENV DIV\GROUP:ENV DB:A-SANCHEZ LD:AS PIC:(Opt) PM:(Read) TM:(Opt) Lyr:(Option)-OFF=REF- PLOT:11/11/2015 4:57 PM ACADVER:21.05 (LMS TECH) PAGES:3 LAYOUT:3 SAVED:11/11/2015 4:57 PM BY: SANCHEZ, ADRIAN

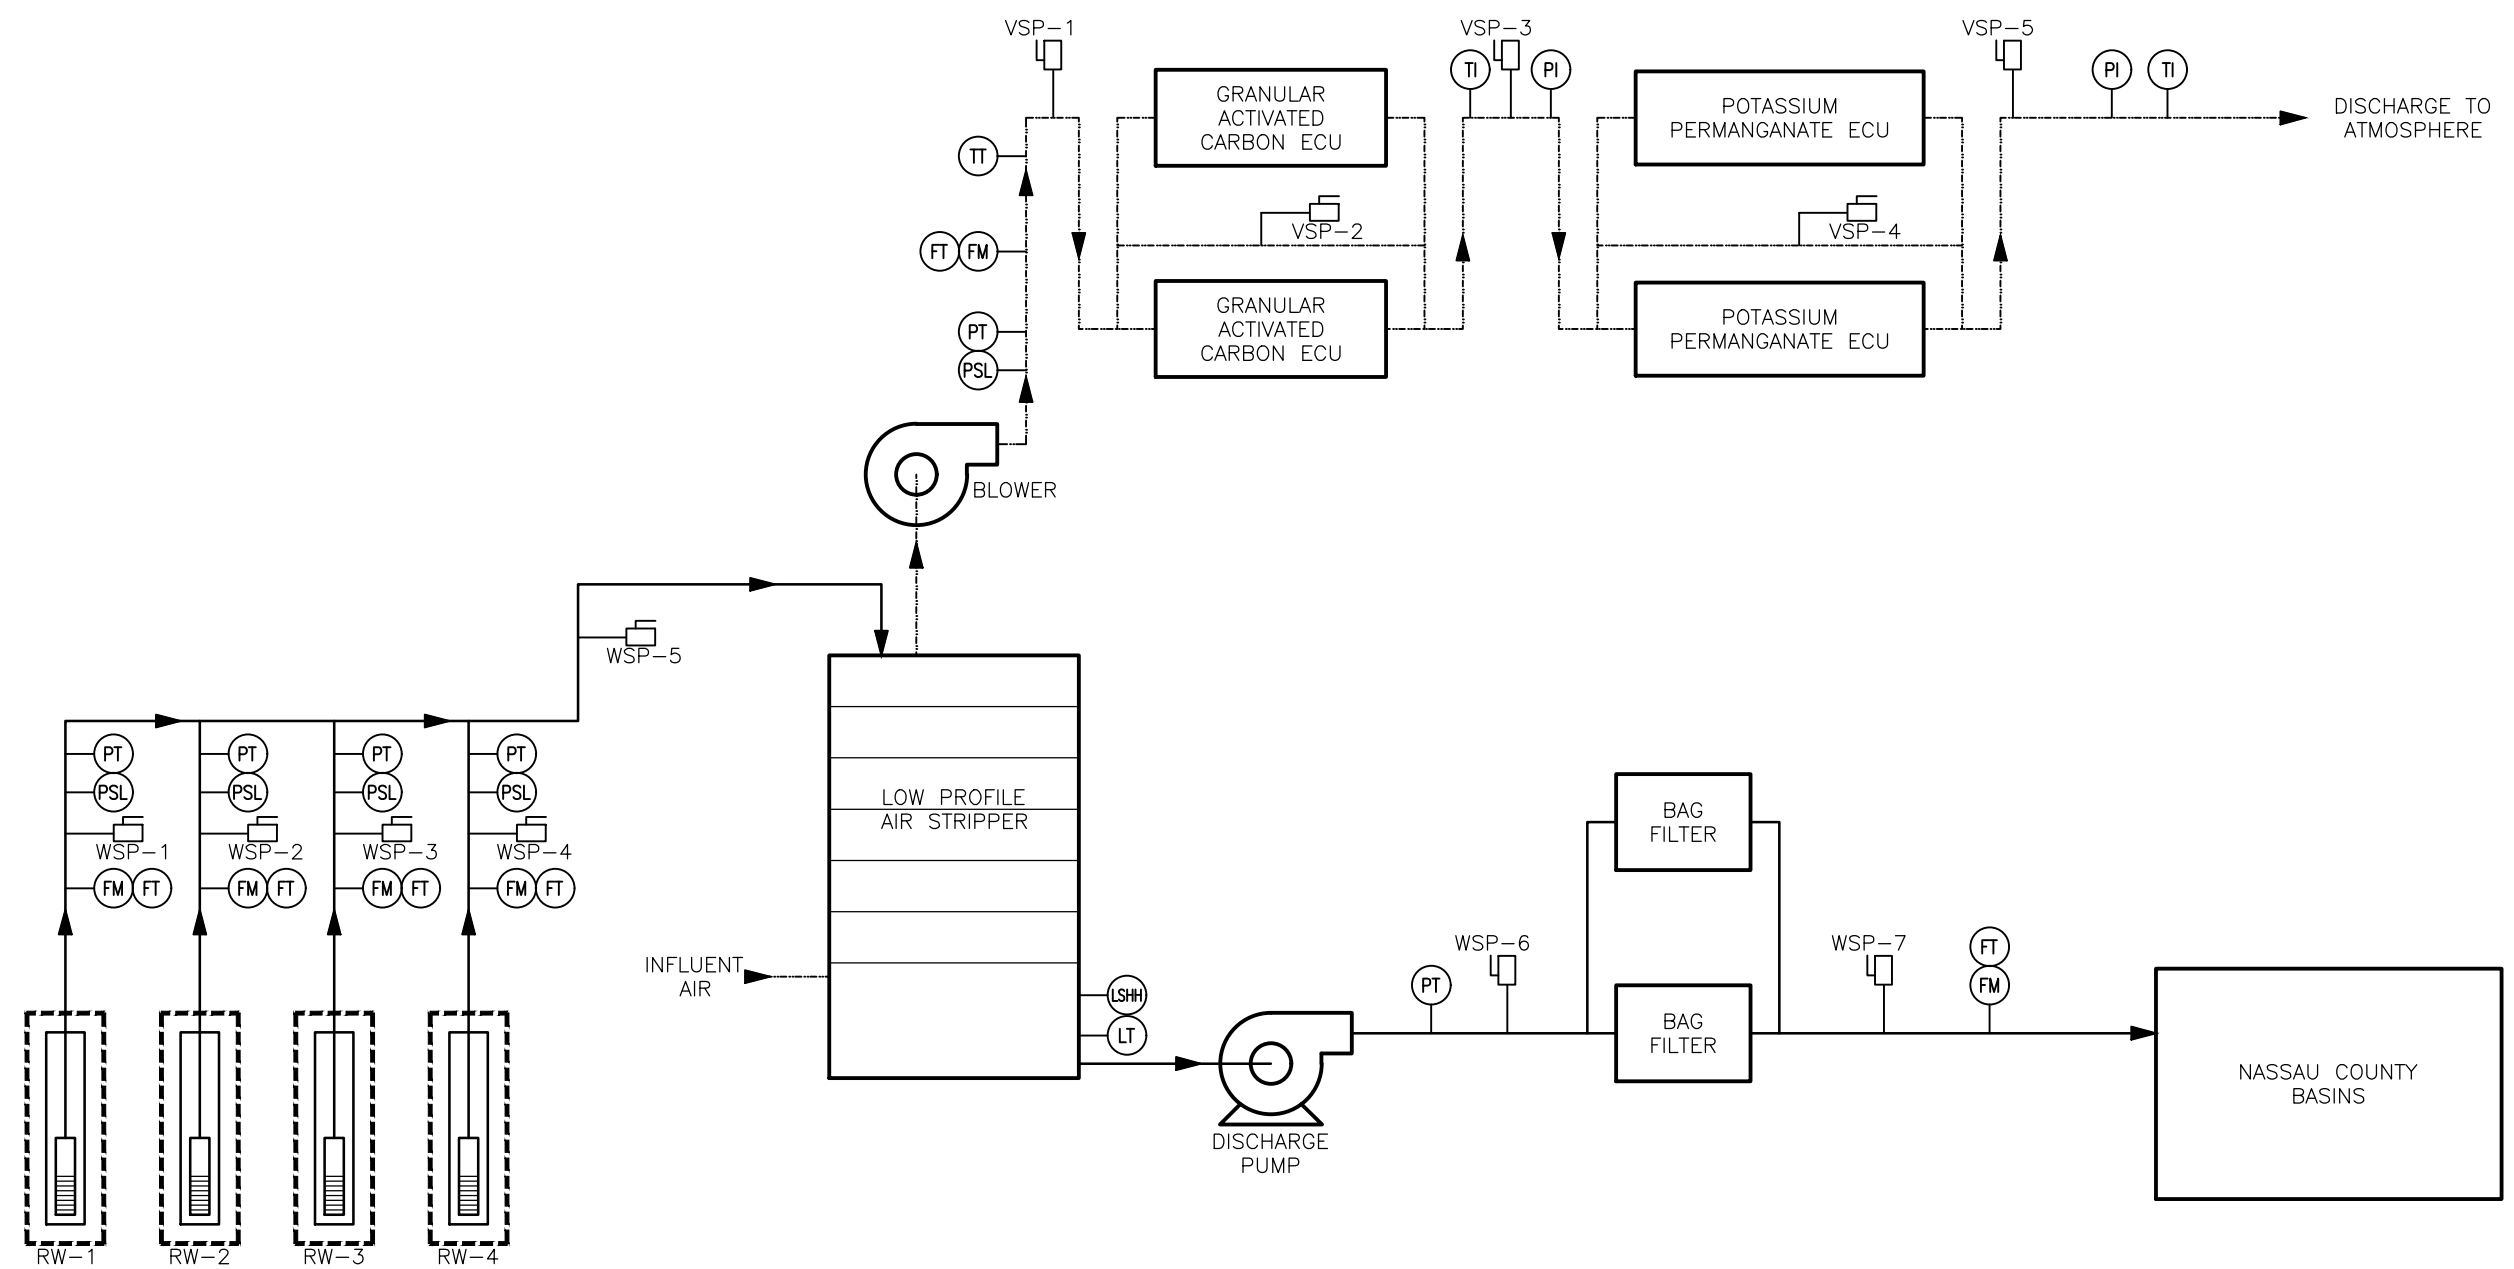

- LEGEND:**
- PROCESS WATER
 - - - PROCESS AIR
 - ⊗ INSTRUMENT
 - SAMPLE PORT
 - ▶ FLOW DIRECTION
 - FM FLOW METER
 - FT FLOW RATE TRANSMITTER
 - PSL PRESSURE VACUUM LOW
 - PT PRESSURE TRANSMITTER
 - PI PRESSURE INDICATOR
 - LSHH LEVEL SWITCH HIGH HIGH
 - LT LEVEL TRANSMITTER
 - TT TEMPERATURE TRANSMITTER
 - TI TEMPERATURE INDICATOR
 - WSP WATER SAMPLE PORT
 - VSP VAPOR SAMPLE PORT
 - ECU EMISSION CONTROL UNIT

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM
 OPERABLE UNIT 3
 (FORMER GRUMMAN SETTLING PONDS)
 BETHPAGE, NEW YORK

**GROUNDWATER TREATMENT SYSTEM
 PROCESS SCHEMATIC AND
 MONITORING LOCATIONS**

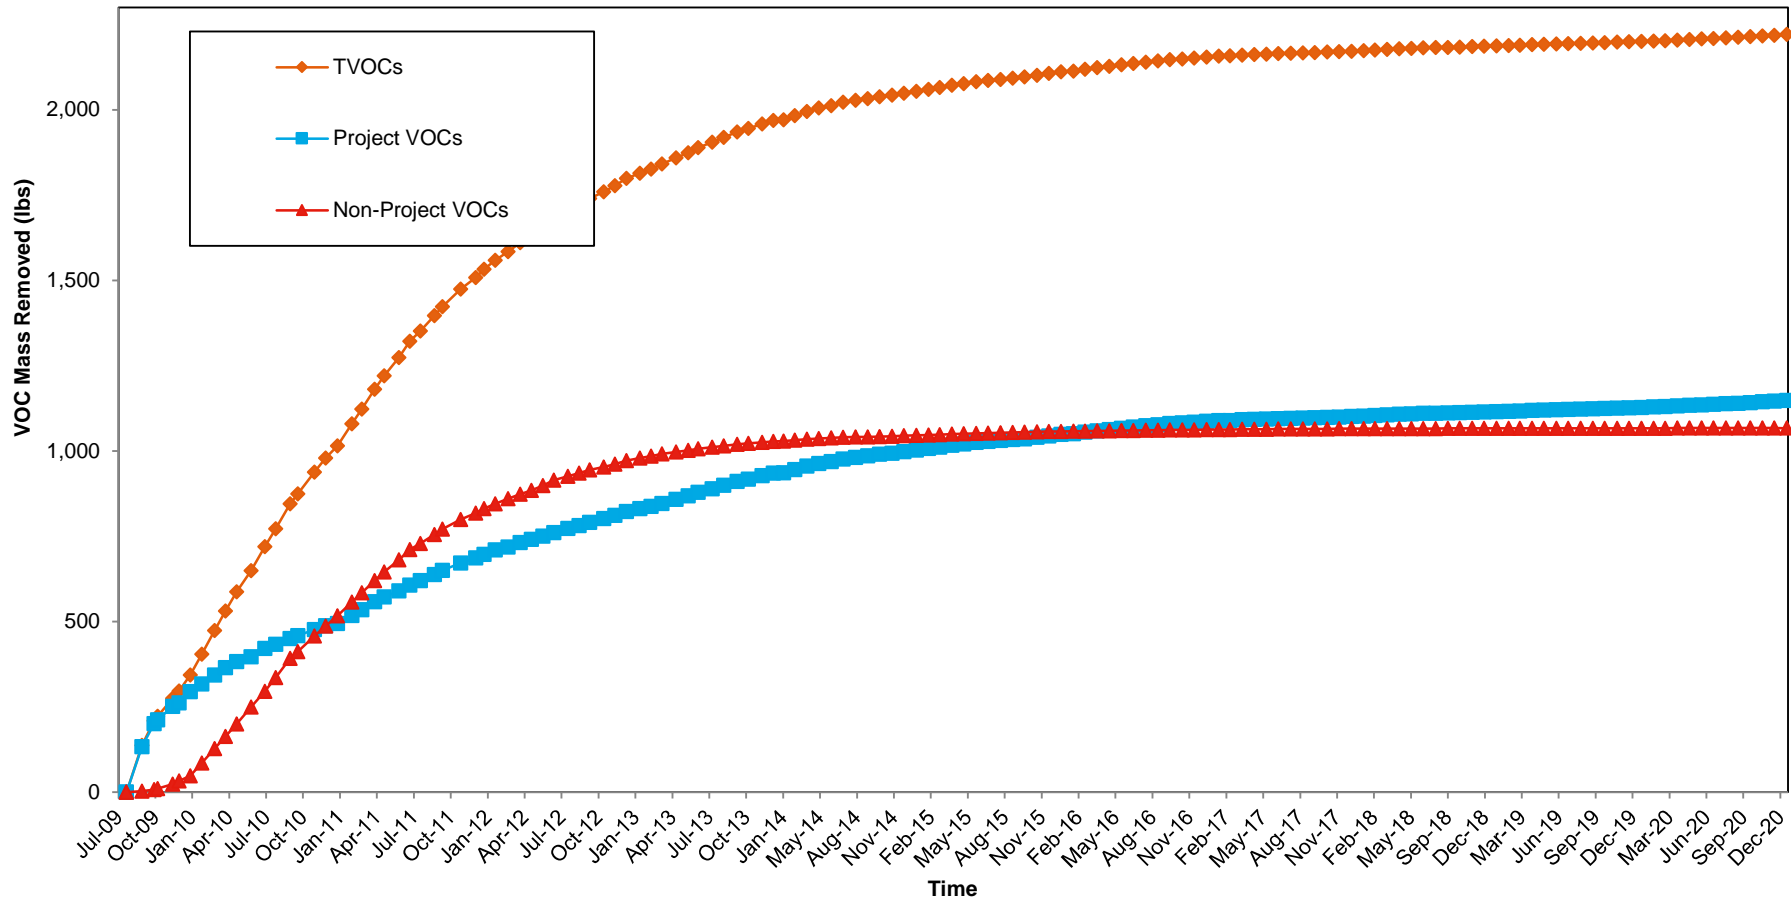

Abbreviations, Notes, and Units:

VOC = Volatile Organic Compound
 TVOCs = Total VOCs detected

Project VOCs = sum of 1,1,1-trichloroethane; 1,1-dichloroethane; 1,2-dichloroethane; 1,1-dichloroethene; tetrachloroethene; trichloroethene; vinyl chloride; cis-1,2-dichloroethene; trans-1,2-dichloroethene; benzene; toluene; and total xylenes.

Non-Project VOCs = sum of VOCs that are not Project VOCs.


lbs = pounds

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM
 OPERABLE UNIT 3
 (FORMER GRUMMAN SETTLING PONDS)
 BETHPAGE, NEW YORK

**CUMULATIVE TOTAL, PROJECT, AND
 NON-PROJECT VOC MASS REMOVED**



FIGURE
5

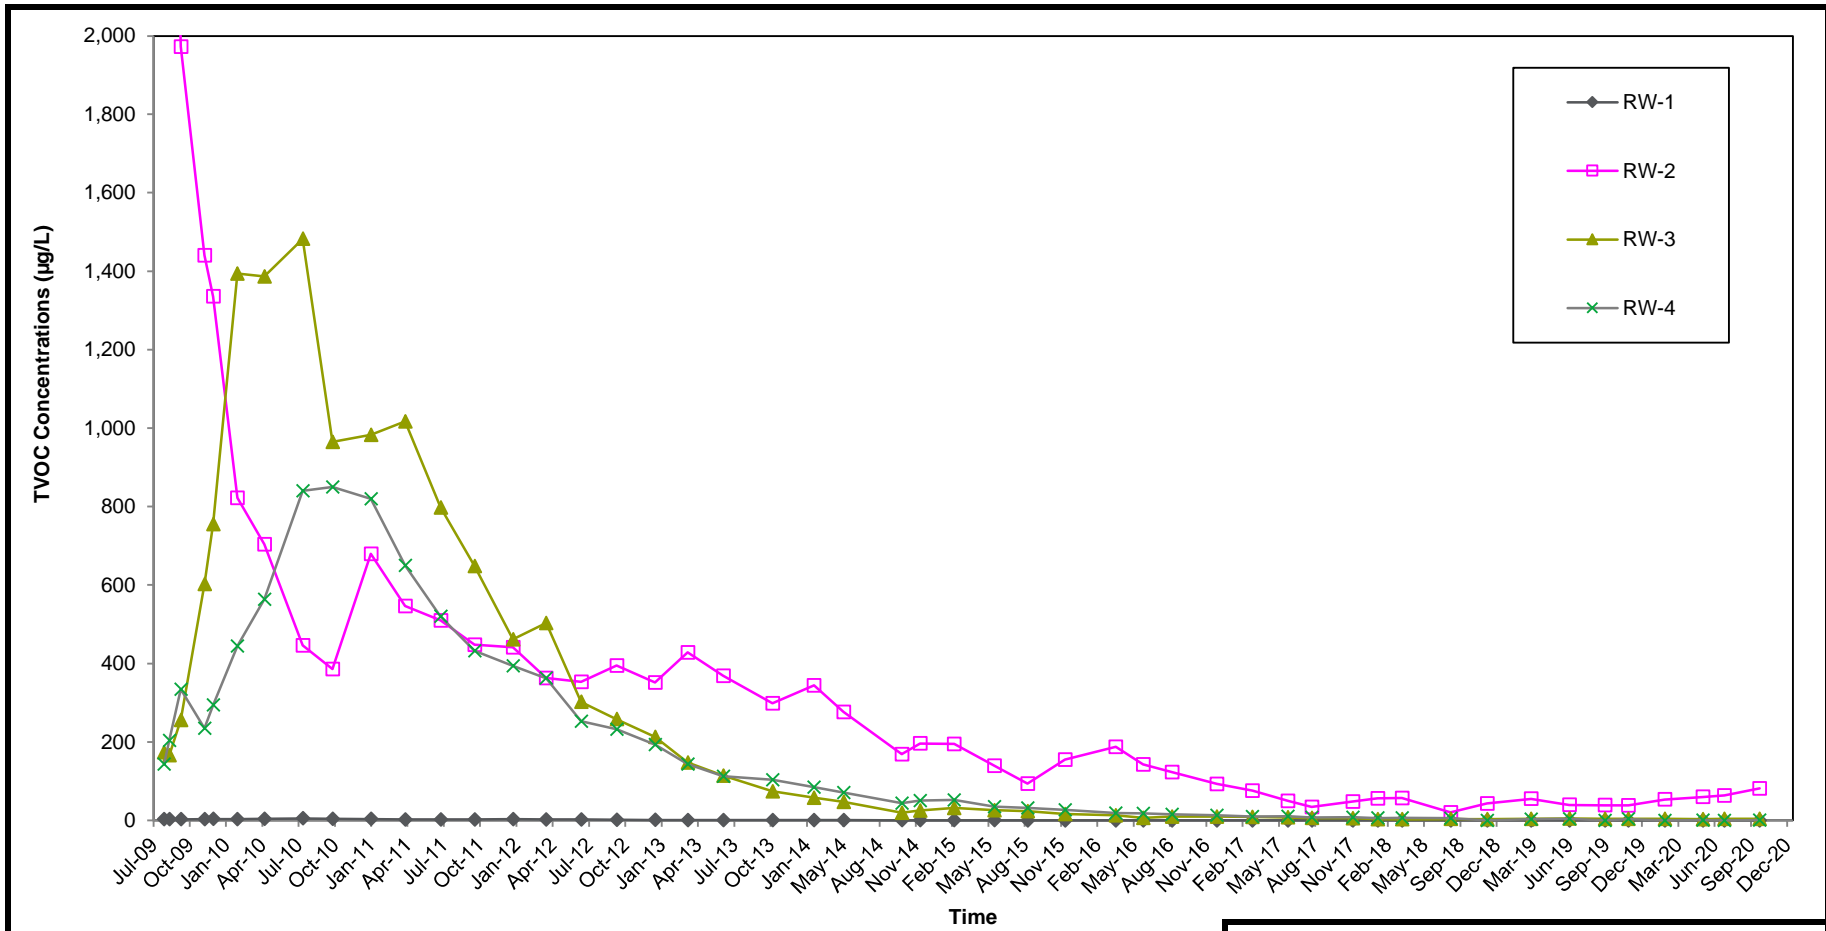


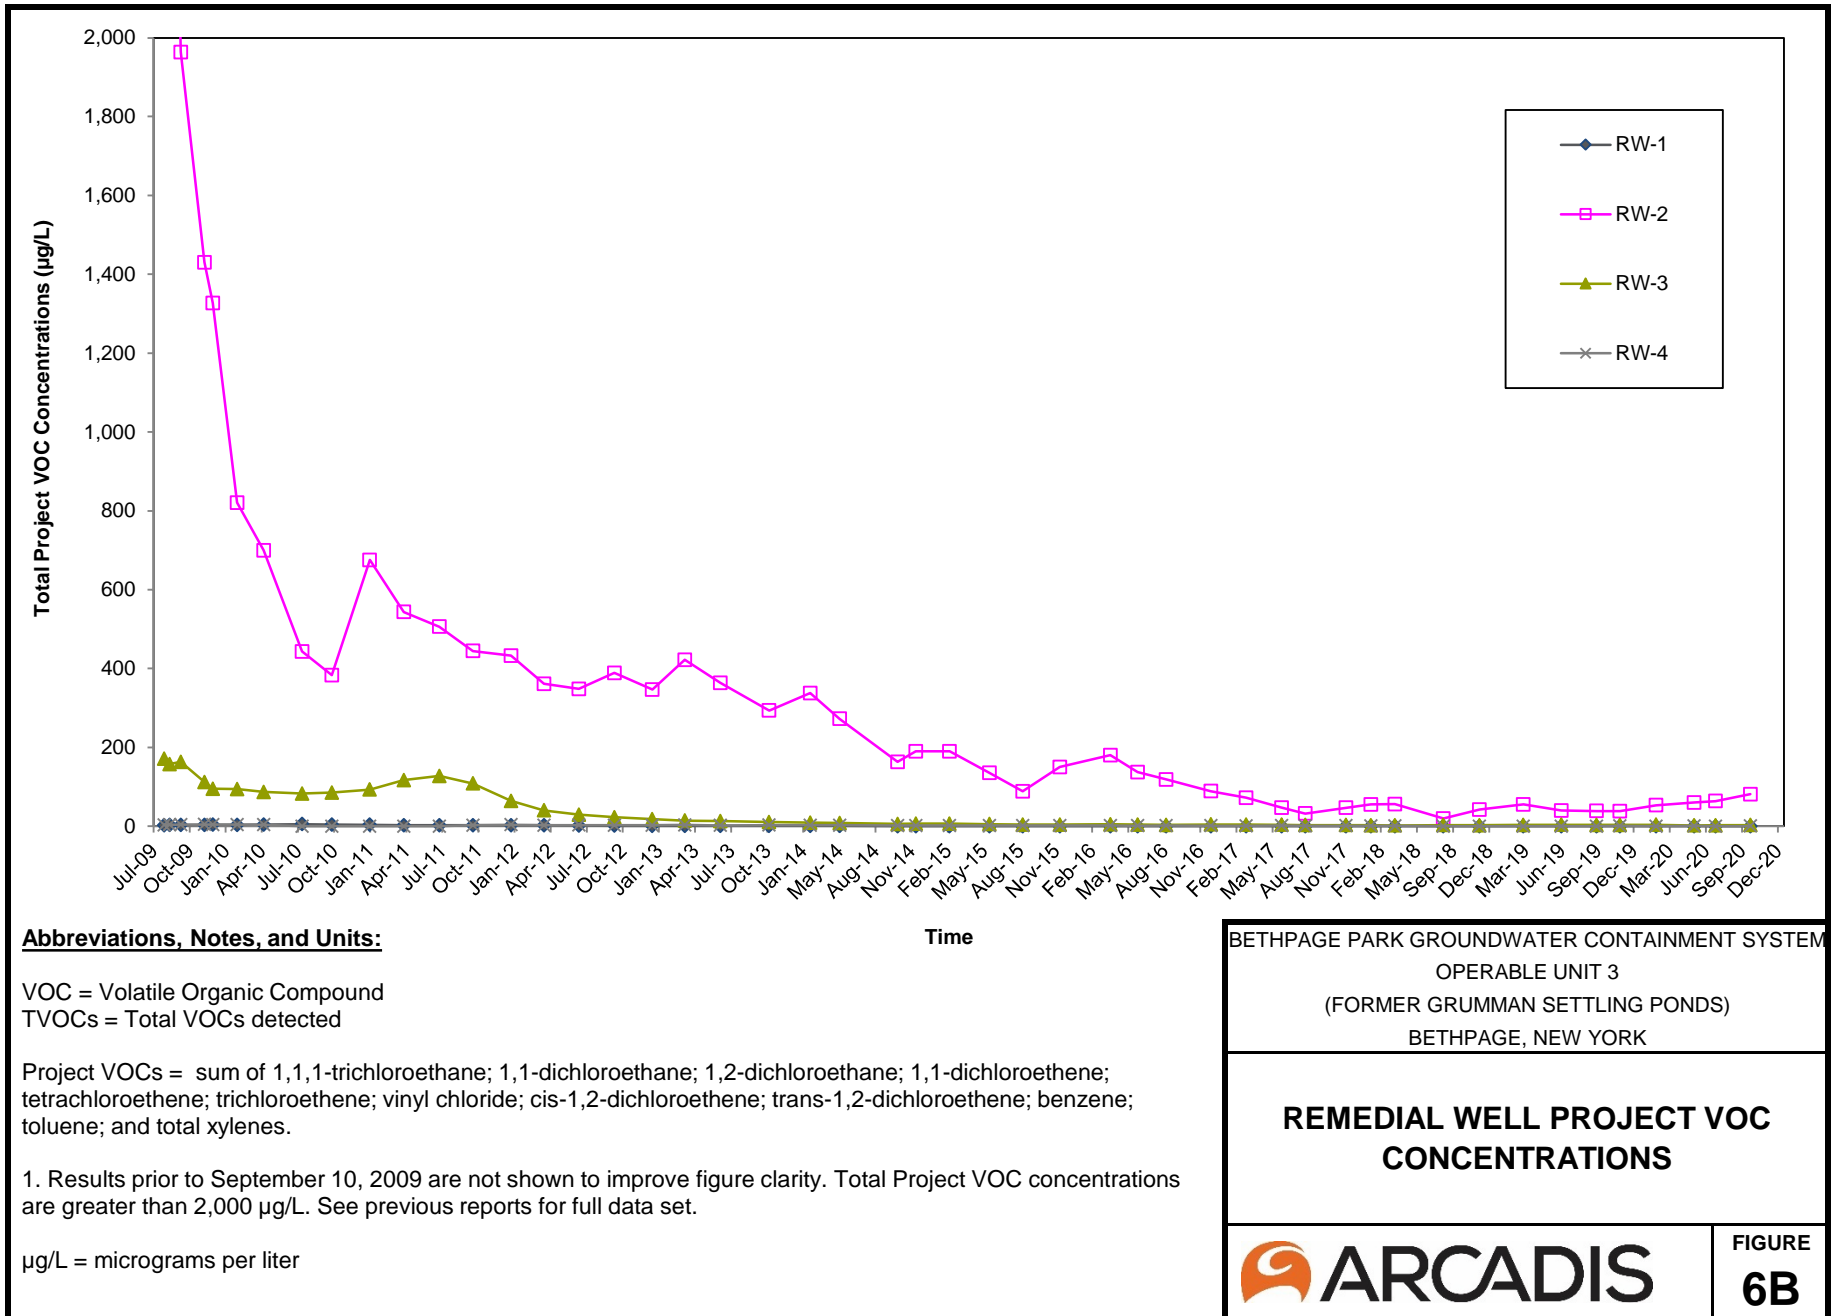
Abbreviations, Notes, and Units:

VOC = Volatile Organic Compound
 TVOCs = Total VOCs detected

1. Results prior to September 10, 2009 are not shown to improve figure clarity. The TVOC concentrations are greater than 2,000 µg/L. See previous reports for full data set.

µg/L = micrograms per liter

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM OPERABLE UNIT 3 (FORMER GRUMMAN SETTLING PONDS) BETHPAGE, NEW YORK	
REMEDIAL WELL TOTAL VOC CONCENTRATIONS	
	FIGURE 6A



Abbreviations, Notes, and Units:

VOC = Volatile Organic Compound
 TVOCs = Total VOCs detected


Project VOCs = sum of 1,1,1-trichloroethane; 1,1-dichloroethane; 1,2-dichloroethane; 1,1-dichloroethene; tetrachloroethene; trichloroethene; vinyl chloride; cis-1,2-dichloroethene; trans-1,2-dichloroethene; benzene; toluene; and total xylenes.

1. Results prior to September 10, 2009 are not shown to improve figure clarity. Total Project VOC concentrations are greater than 2,000 µg/L. See previous reports for full data set.


µg/L = micrograms per liter


BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM
 OPERABLE UNIT 3
 (FORMER GRUMMAN SETTLING PONDS)
 BETHPAGE, NEW YORK

**REMEDIAL WELL PROJECT VOC
 CONCENTRATIONS**

 **ARCADIS**

**FIGURE
 6B**

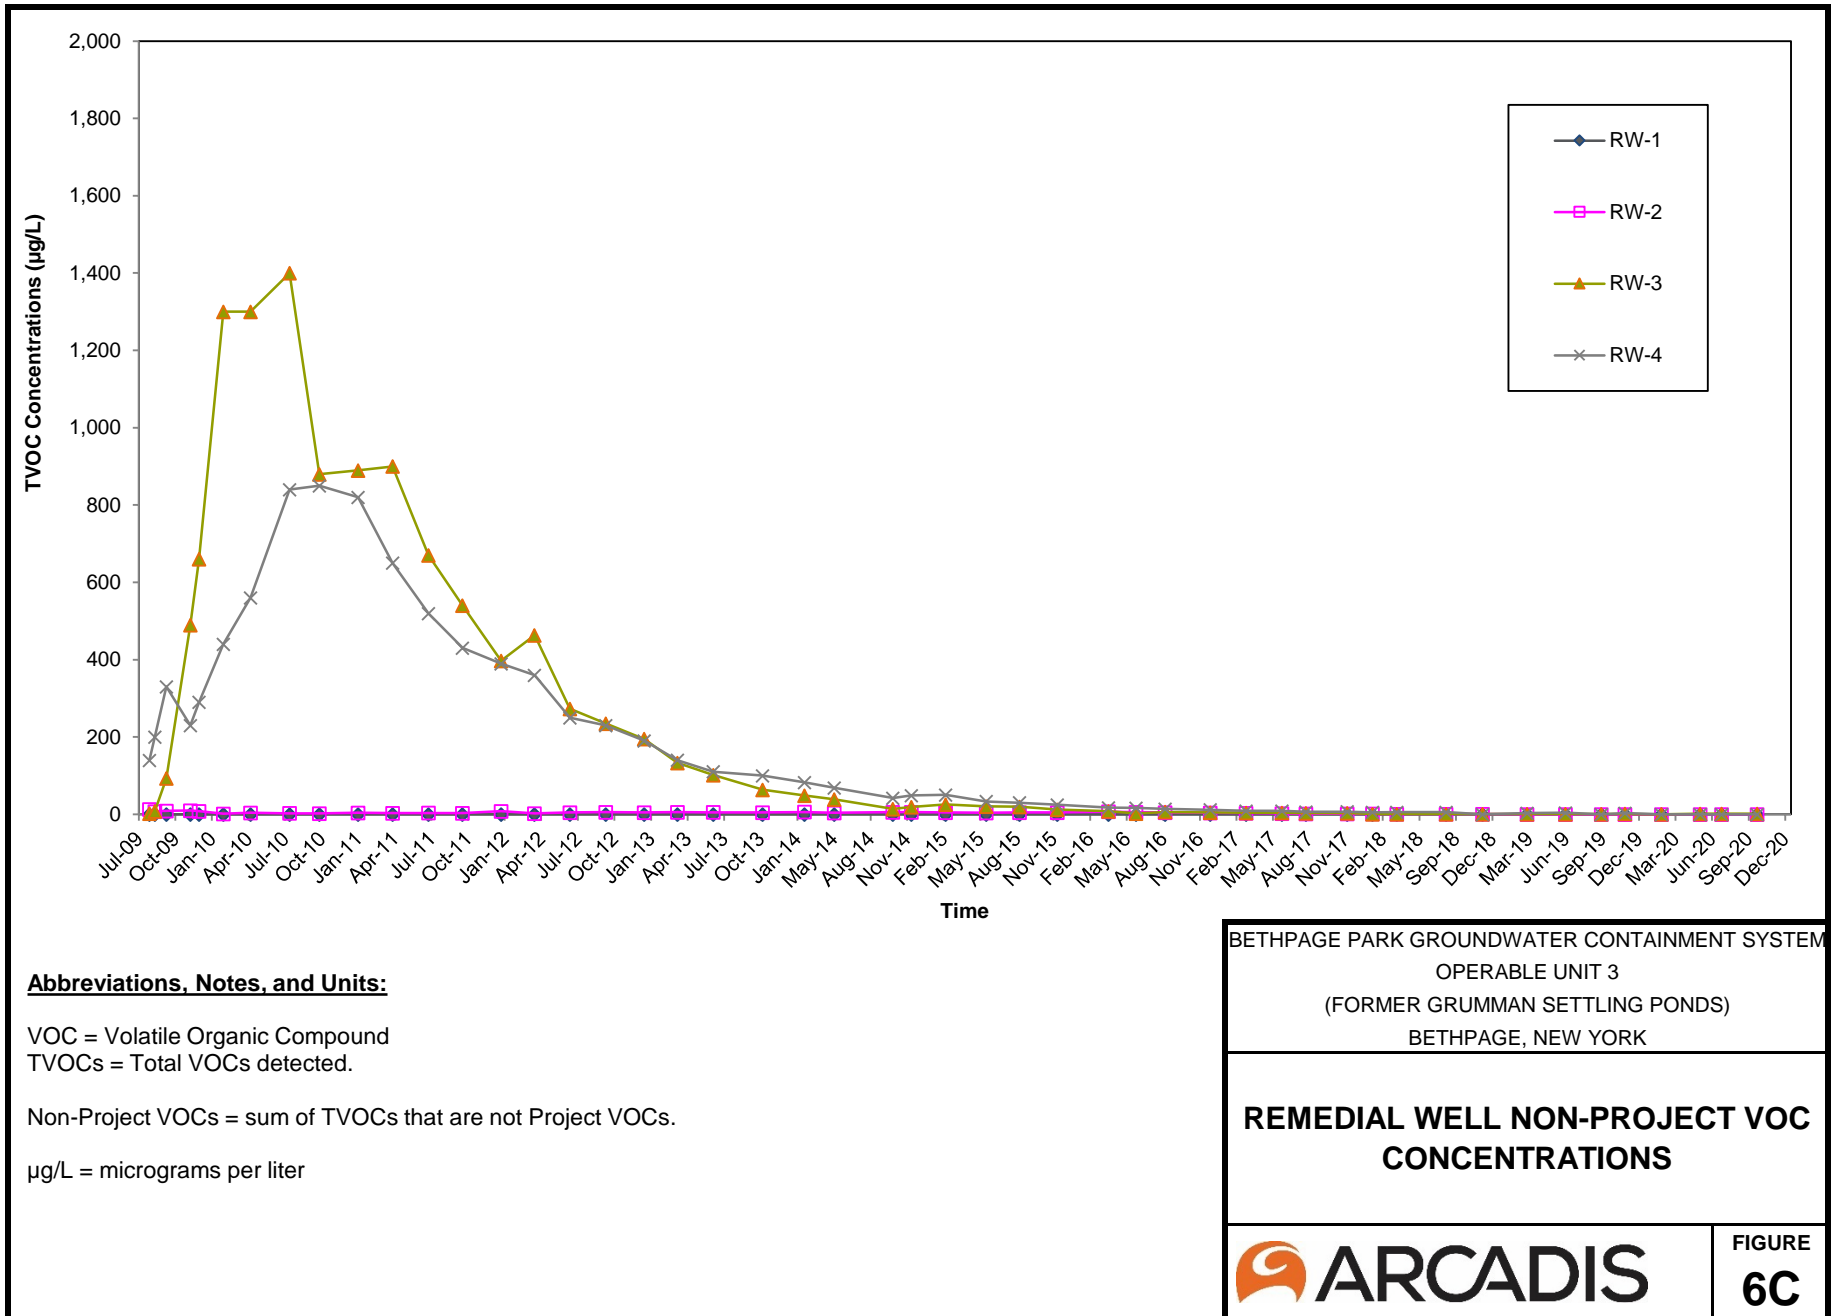

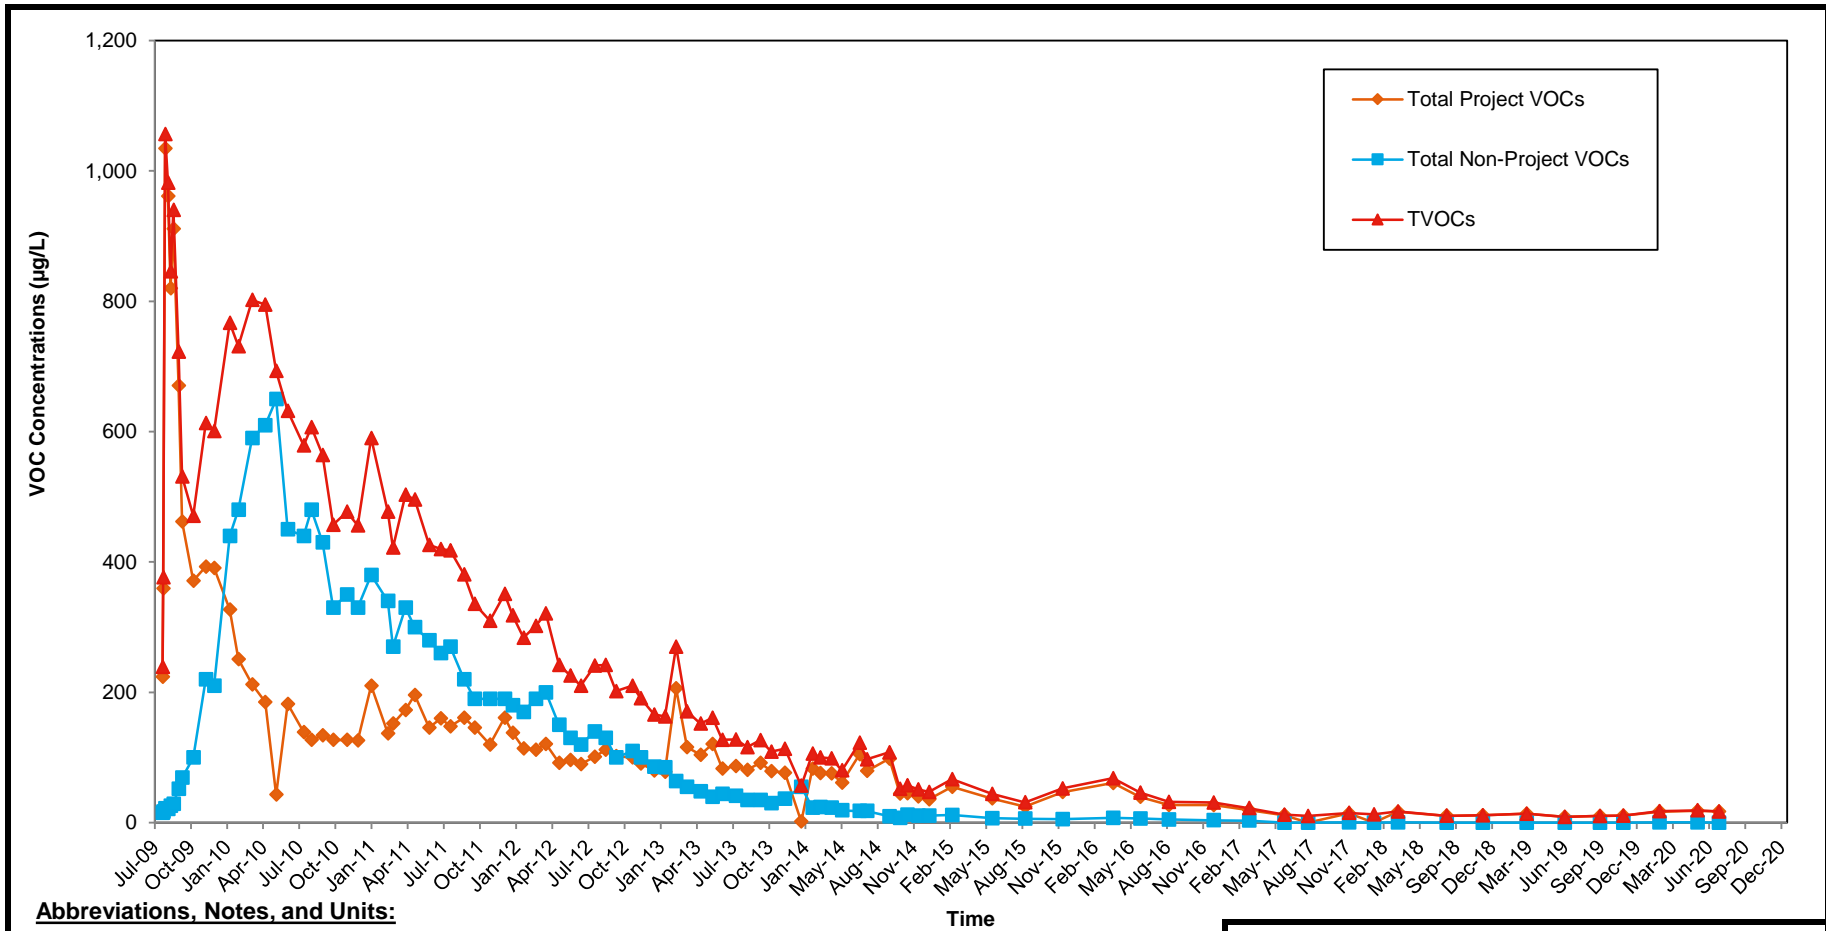

Abbreviations, Notes, and Units:


VOC = Volatile Organic Compound
 TVOCs = Total VOCs detected.

Project VOCs = sum of 1,1,1-trichloroethane; 1,1-dichloroethane; 1,2-dichloroethane; 1,1-dichloroethene; tetrachloroethene; trichloroethene; vinyl chloride; cis-1,2-dichloroethene; trans-1,2-dichloroethene; benzene; toluene; and total xylenes.

Non-Project VOCs = sum of VOCs that are not Project VOCs.
 1. Quarter 4 sampling was conducted during ISTR Baker Tank discharge. The combined Influent sample port (WSP-5) is located upstream of the ISTR connection into the influent line. Due to this setup, the combined influent port (WSP-5) was not sampled as it would not be representative of the true combined influent.

µg/L = micrograms per liter

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM OPERABLE UNIT 3 (FORMER GRUMMAN SETTLING PONDS) BETHPAGE, NEW YORK	
INFLUENT TOTAL, PROJECT AND NON-PROJECT VOC CONCENTRATIONS	
	FIGURE 7

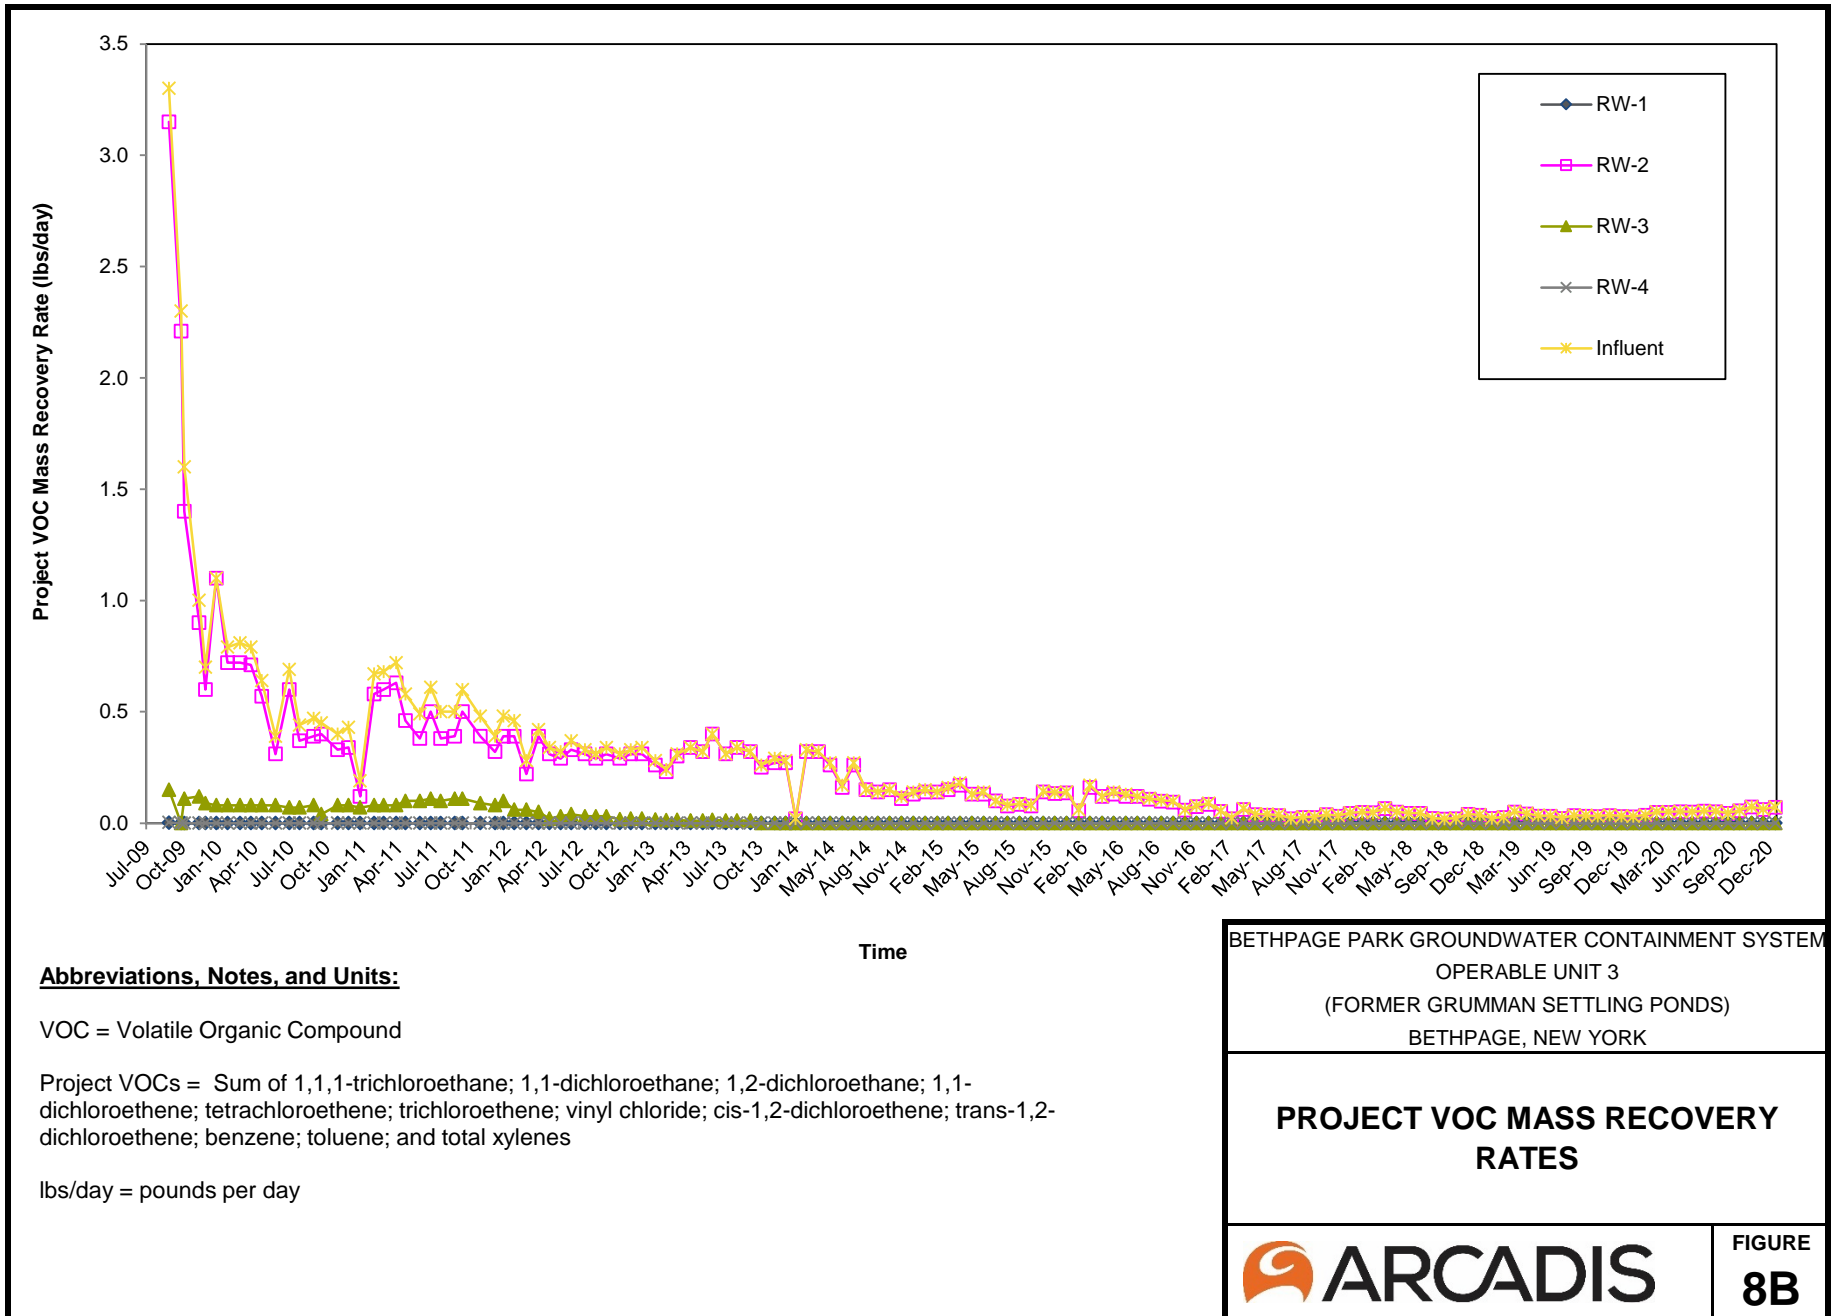

Abbreviations, Notes, and Units:

VOC = Volatile Organic Compound

Project VOCs = Sum of 1,1,1-trichloroethane; 1,1-dichloroethane; 1,2-dichloroethane; 1,1-dichloroethene; tetrachloroethene; trichloroethene; vinyl chloride; cis-1,2-dichloroethene; trans-1,2-dichloroethene; benzene; toluene; and total xylenes


lbs/day = pounds per day

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM
 OPERABLE UNIT 3
 (FORMER GRUMMAN SETTLING PONDS)
 BETHPAGE, NEW YORK

PROJECT VOC MASS RECOVERY RATES



FIGURE 8B

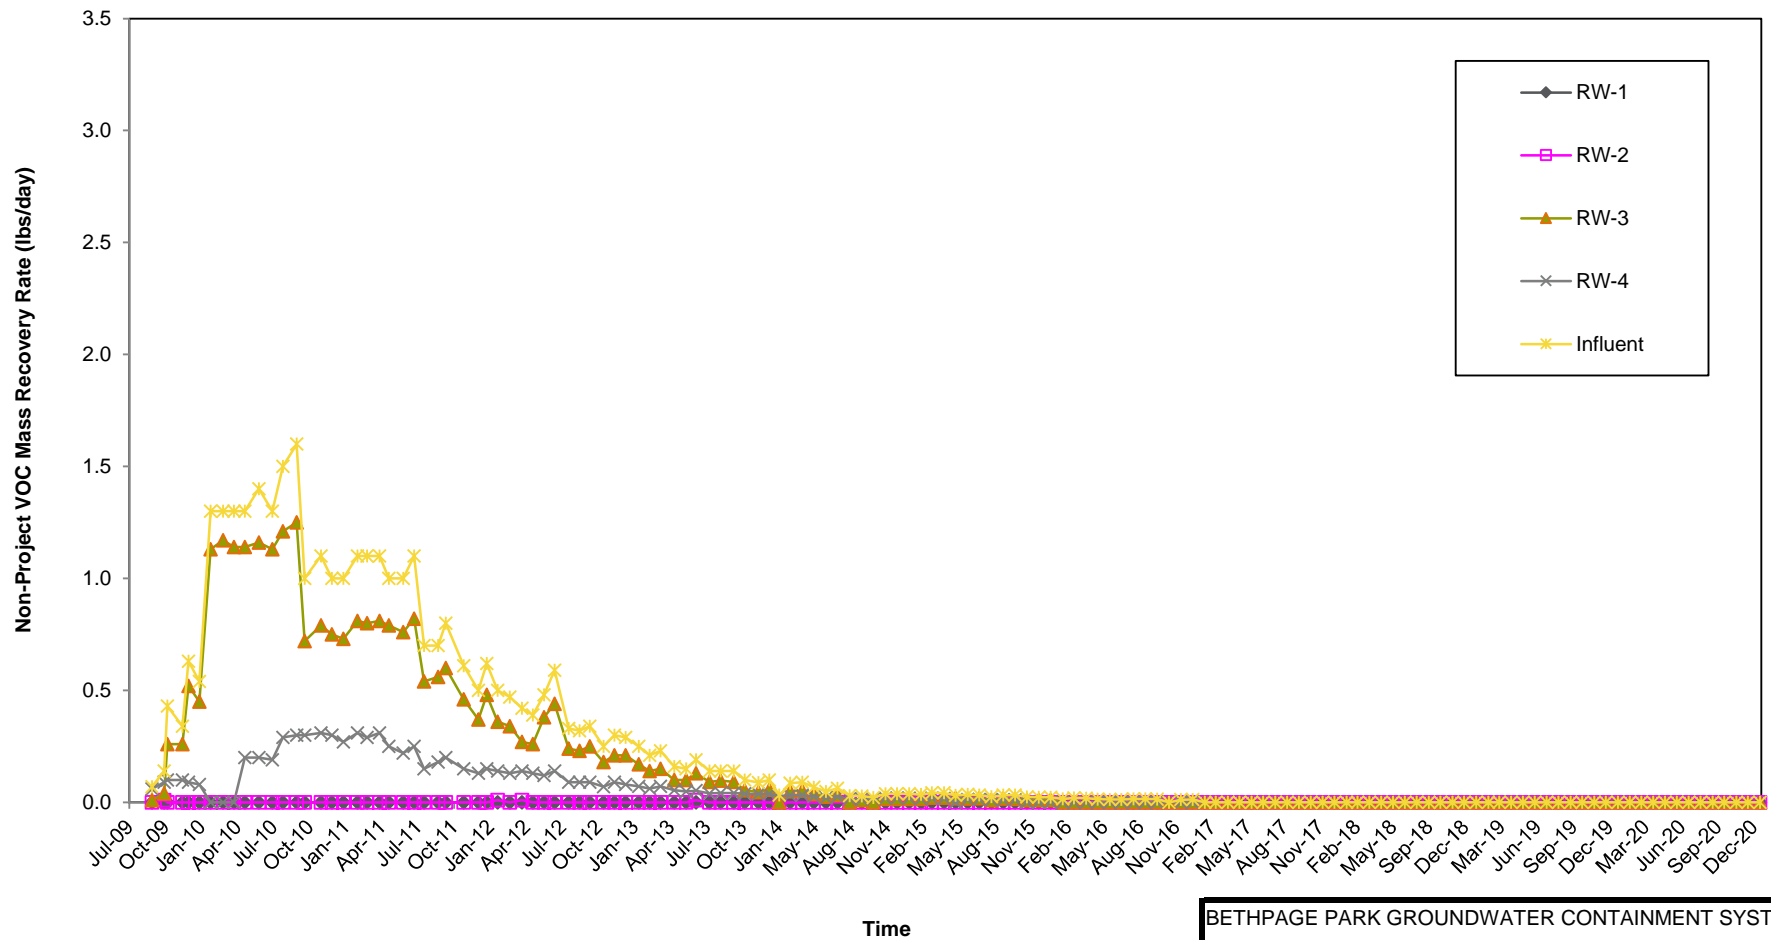

Abbreviations, Notes, and Units:

VOC = Volatile Organic Compound

Non-Project VOCs = sum of VOCs that are not Project VOCs.

lbs/day = pounds per day


BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM
 OPERABLE UNIT 3
 (FORMER GRUMMAN SETTLING PONDS)
 BETHPAGE, NEW YORK

NON-PROJECT VOC MASS RECOVERY RATES



FIGURE
8C


CITY OF SYRACUSE ENVIRONMENTAL SERVICES DIVISION, 1100 WEST WASHINGTON STREET, SYRACUSE, NY 13202-1145
 PROJECT: OPERABLE UNIT 3 ONCT SYSTEM BETHPAGE, NEW YORK
 DRAWING: CROSS SECTION D-D' SHOWING TVOCs IN GROUNDWATER AND DIRECTION OF VERTICAL GROUNDWATER FLOW
 DATE: 07/20/2021
 PLOTTED: 2/26/2021 10:44 AM BY: JACQUELINE KIMBERLY

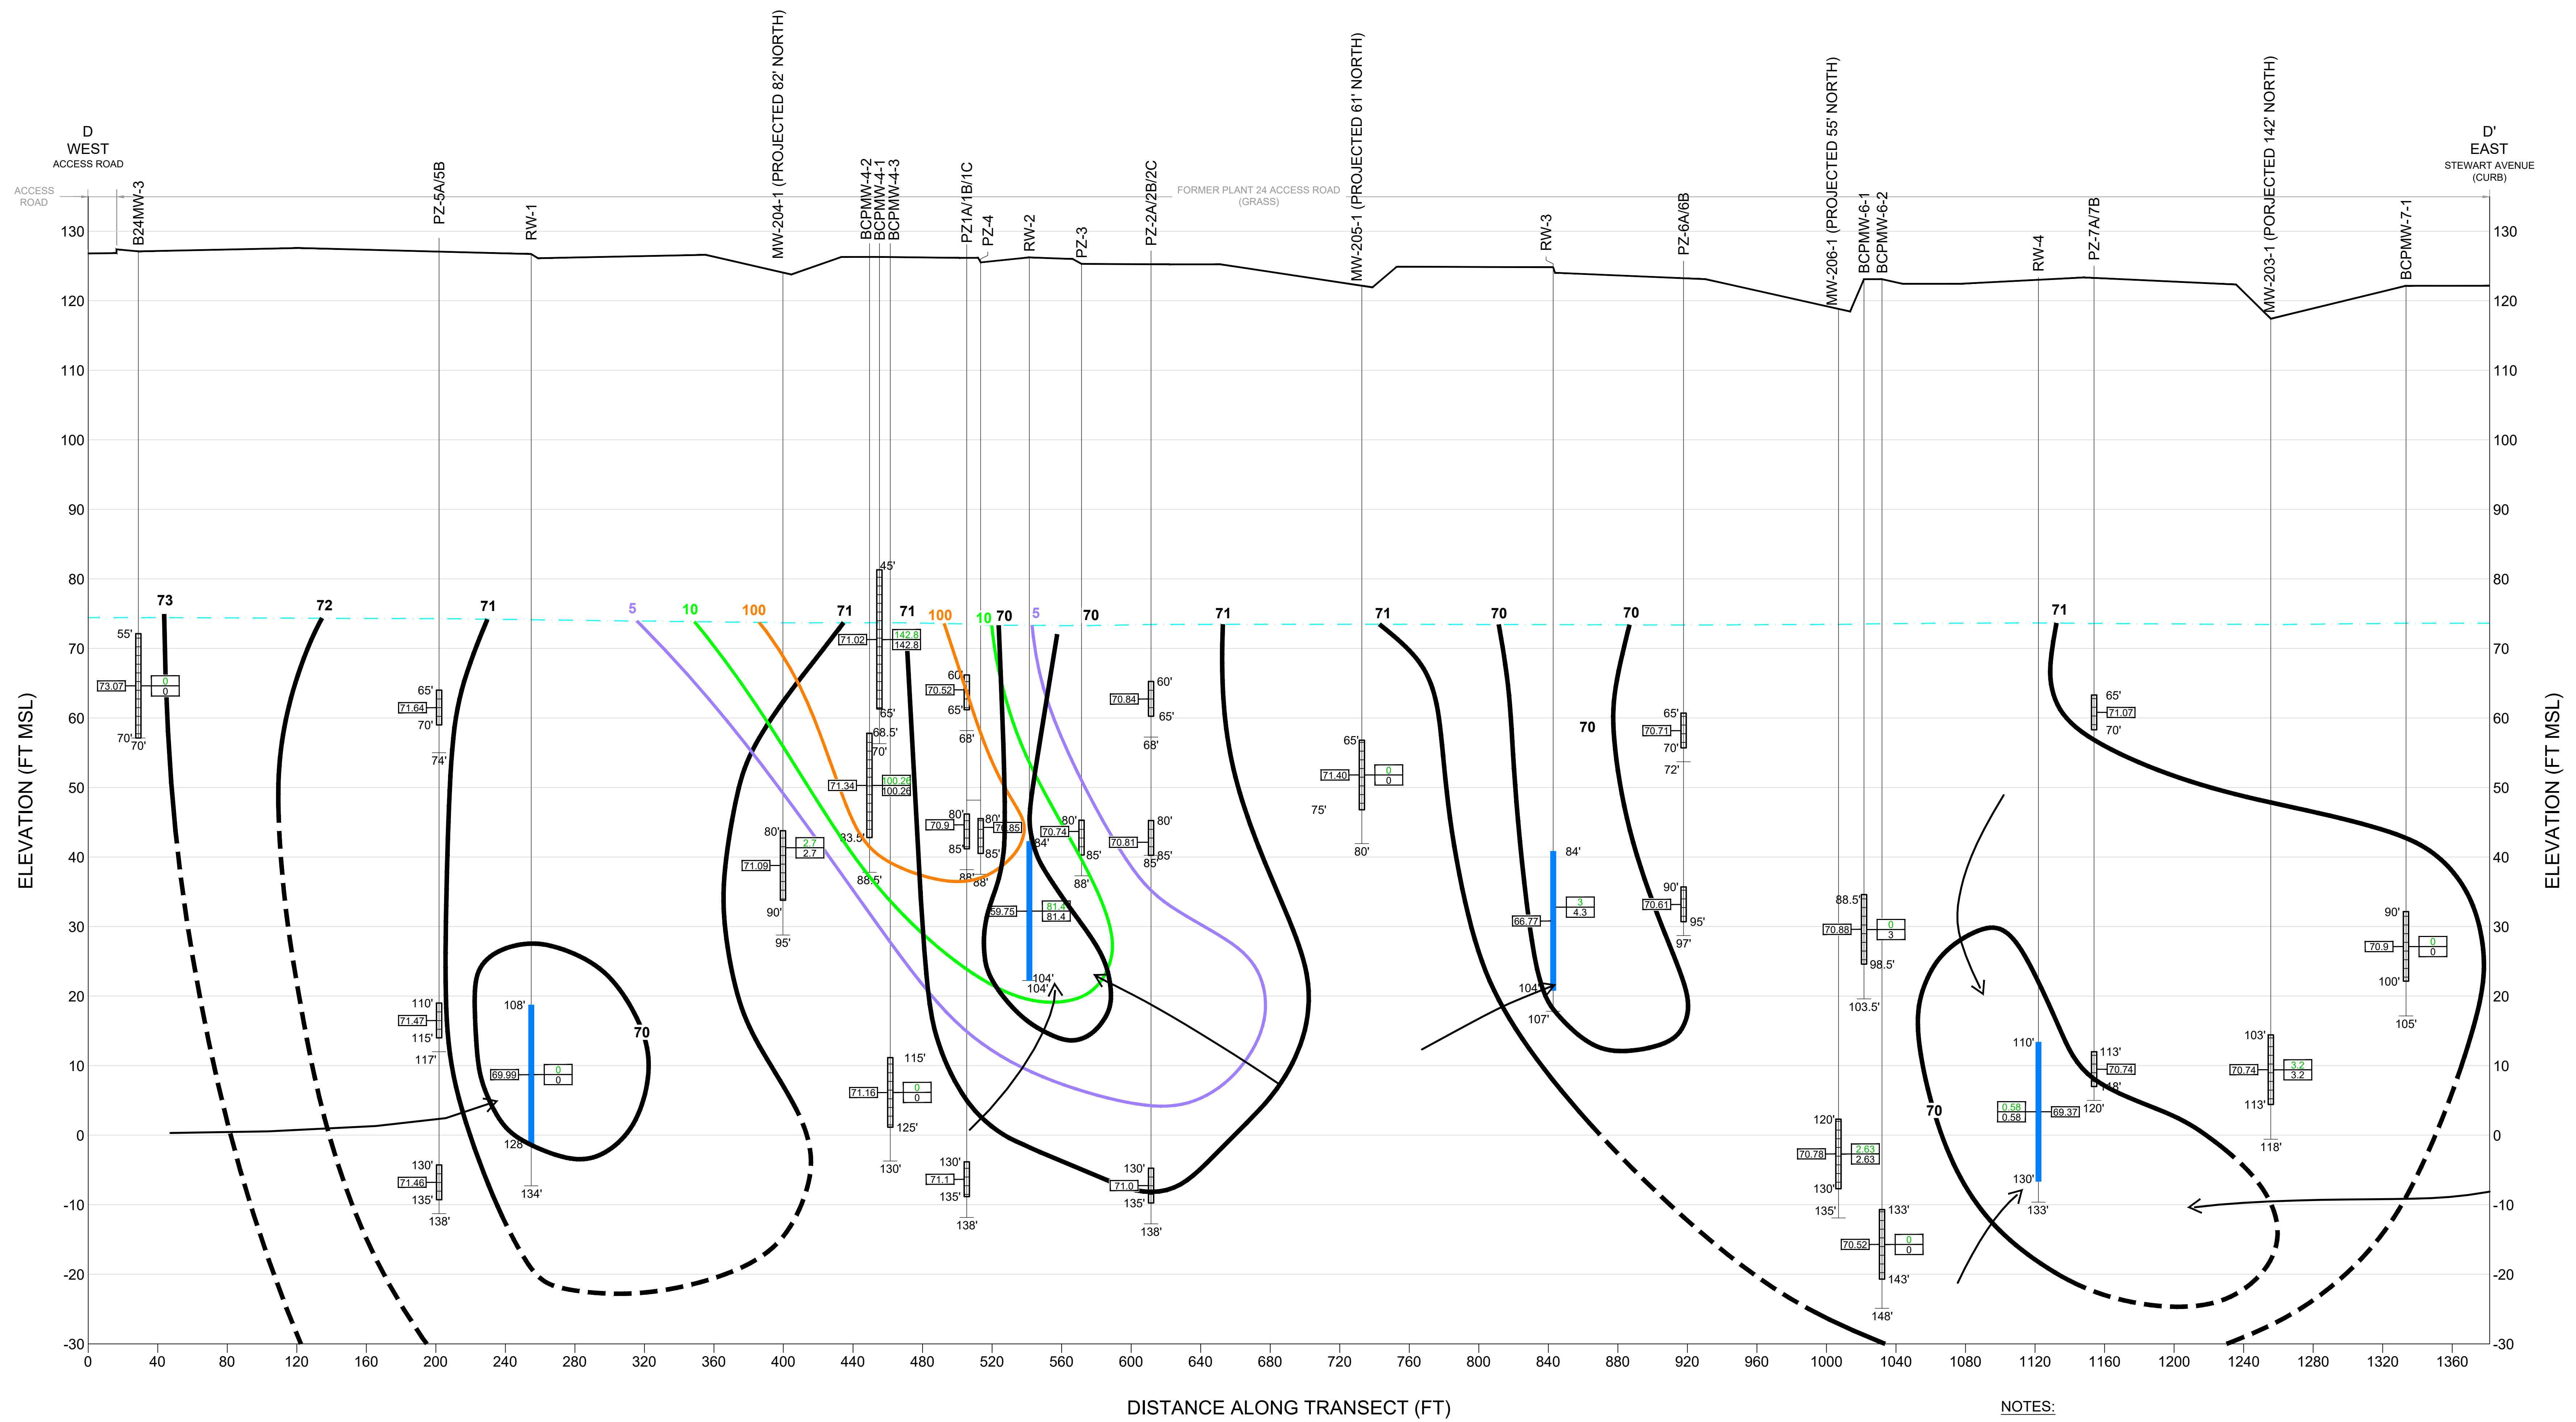

DISTANCE ALONG TRANSECT (FT)

NOTES:



1. WATER LEVEL ELEVATIONS CALCULATED FROM DATA COLLECTED ON JULY 20, 2020.
2. WELL TVOC/PROJECT TVOC DATA FROM THE JULY 2020 SAMPLING ROUND. RESULT REPRESENTATIVE OF ENTIRE WELL SCREEN INTERVAL.
3. TVOC CONTOURS ARE BASED ON PROJECT TVOC DATA, SEE NOTE 2.
4. APPROXIMATE DOWNGRADIENT EXTENT OF CAPTURE ZONE (GROUNDWATER DIVIDE) IS NORTH OF WELLS MW-200-1, MW-201-1, MW-202-1, AND MW-203-1, SEE FIGURE 9.
5. PROJECT VOCS ARE VOCS THAT MAY BE RELATED TO FORMER GRUMMAN HISTORICAL ACTIVITIES. NON-PROJECT VOCS ARE VOCS THAT ARE NOT RELATED TO FORMER GRUMMAN ACTIVITIES BUT HAVE BEEN DETECTED IN THE SITE AREA. PLEASE REFER TO THE REPORT TABLES FOR LISTS OF PROJECT AND NON-PROJECT VOCS.
6. REFER TO TABLE 7 FOR PUMPING RATES OF REMEDIAL WELLS.

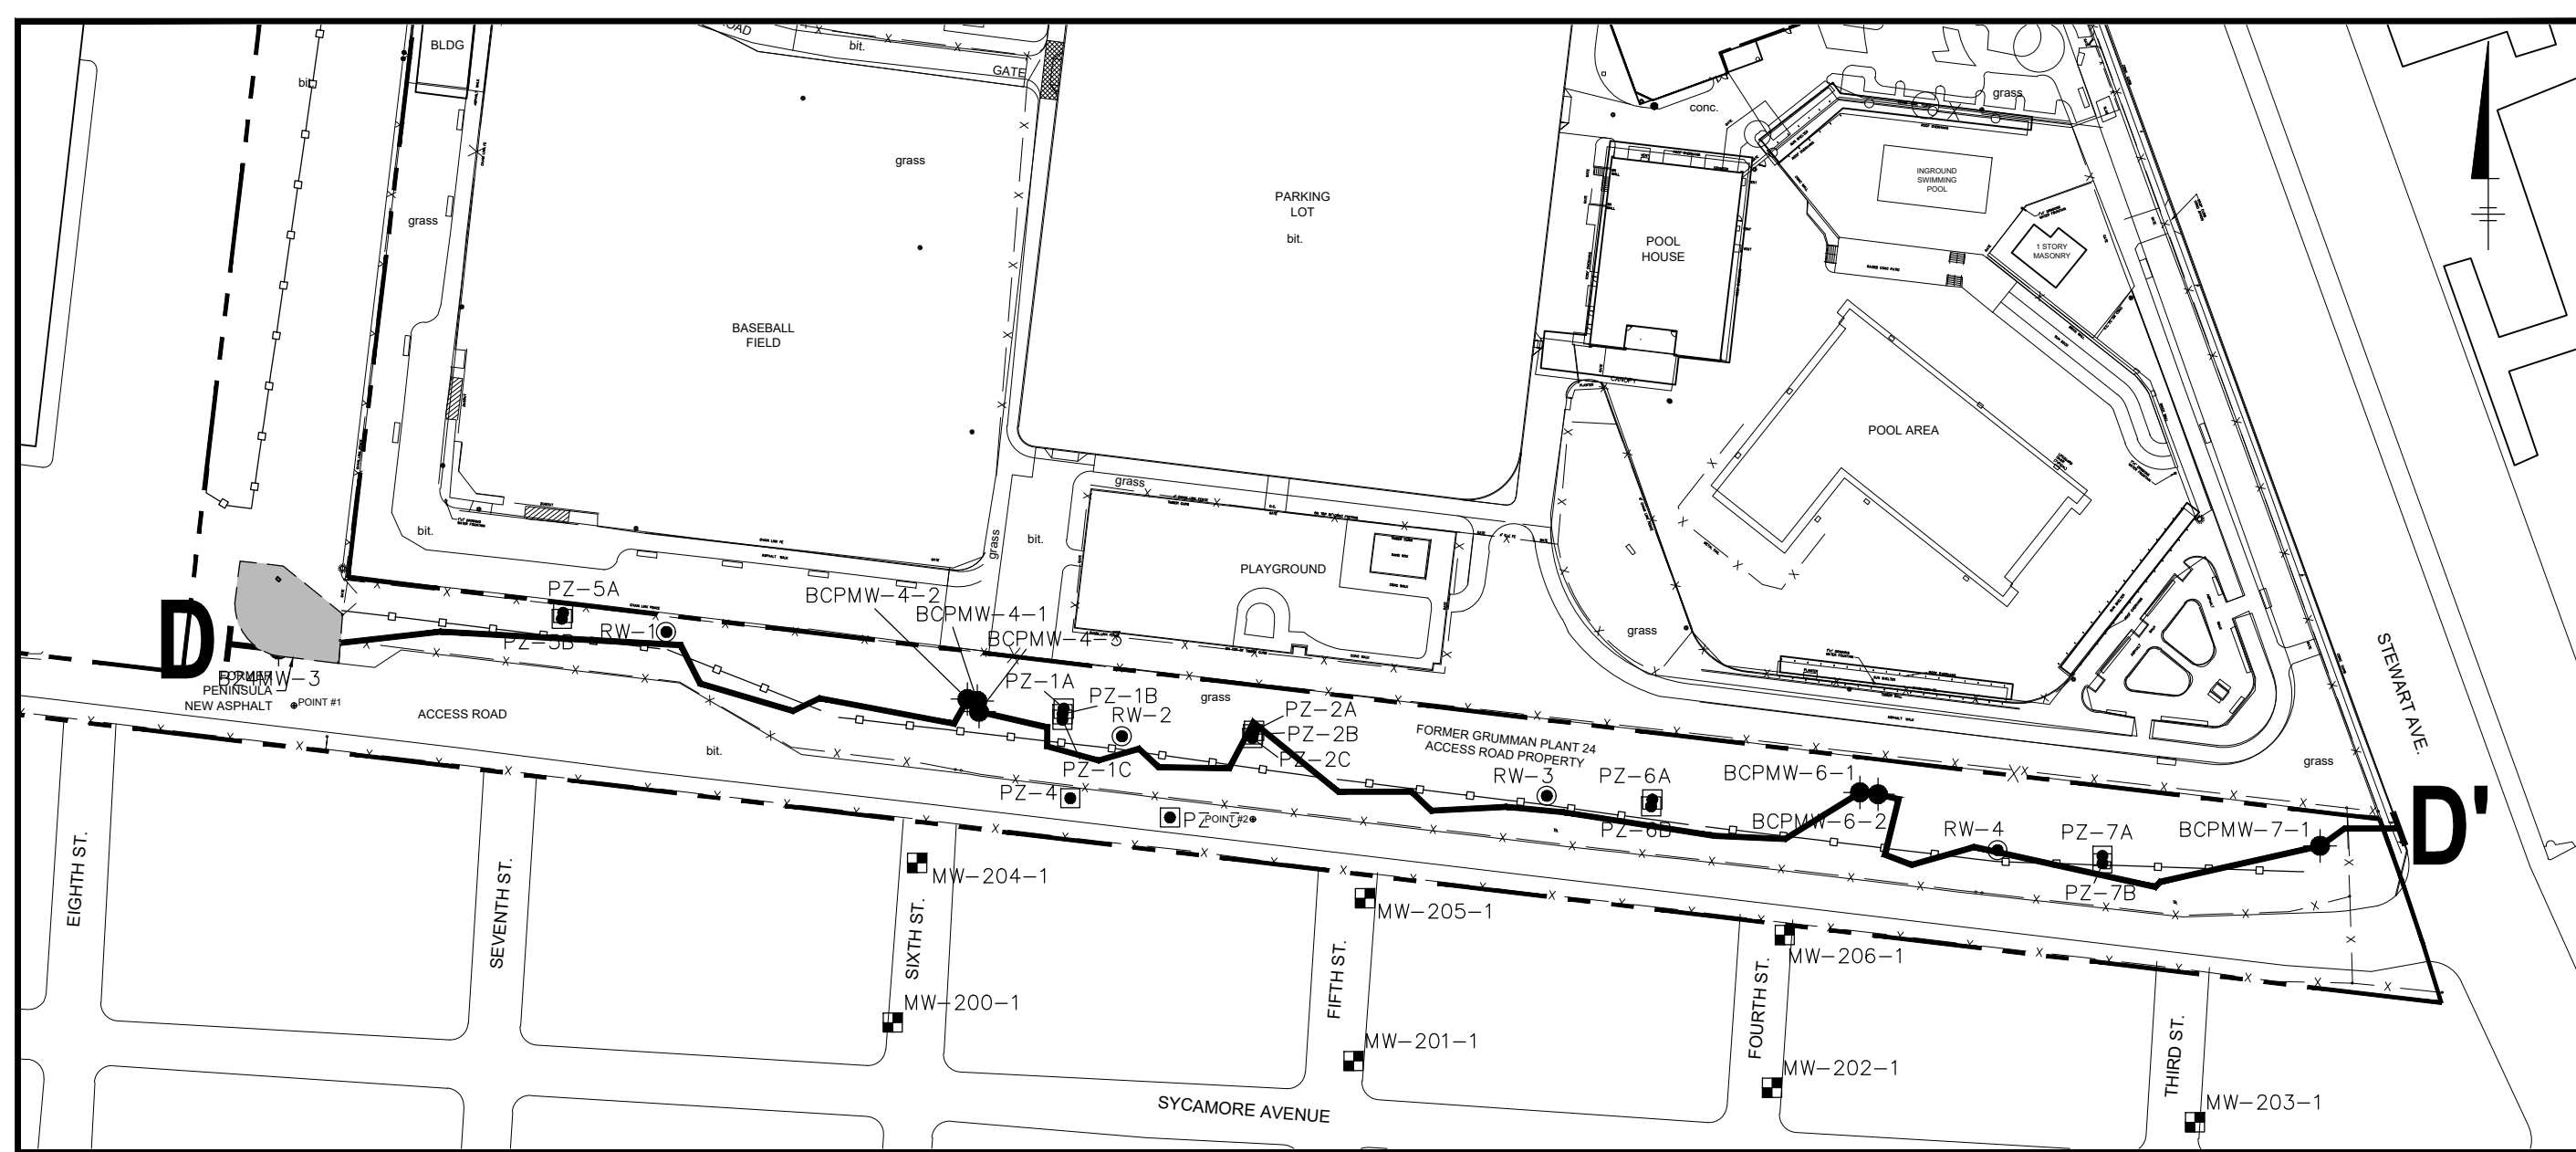

KEY PLAN SHOWING CROSS SECTION D-D'

APPROXIMATE SCALE IN FEET

EXPLANATION

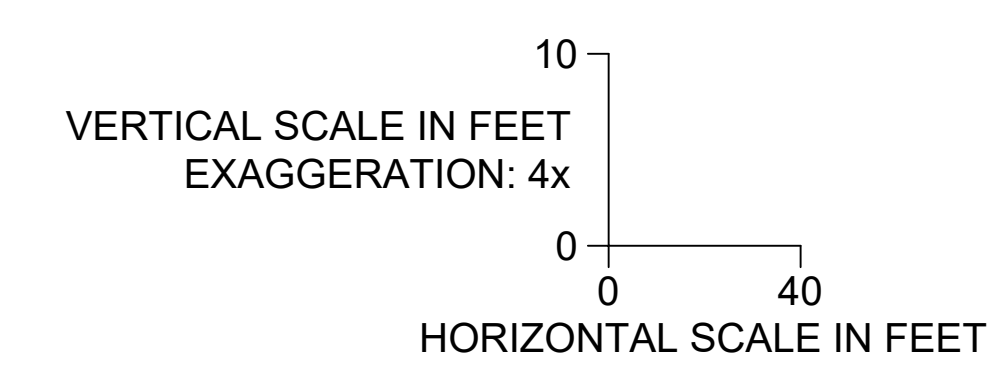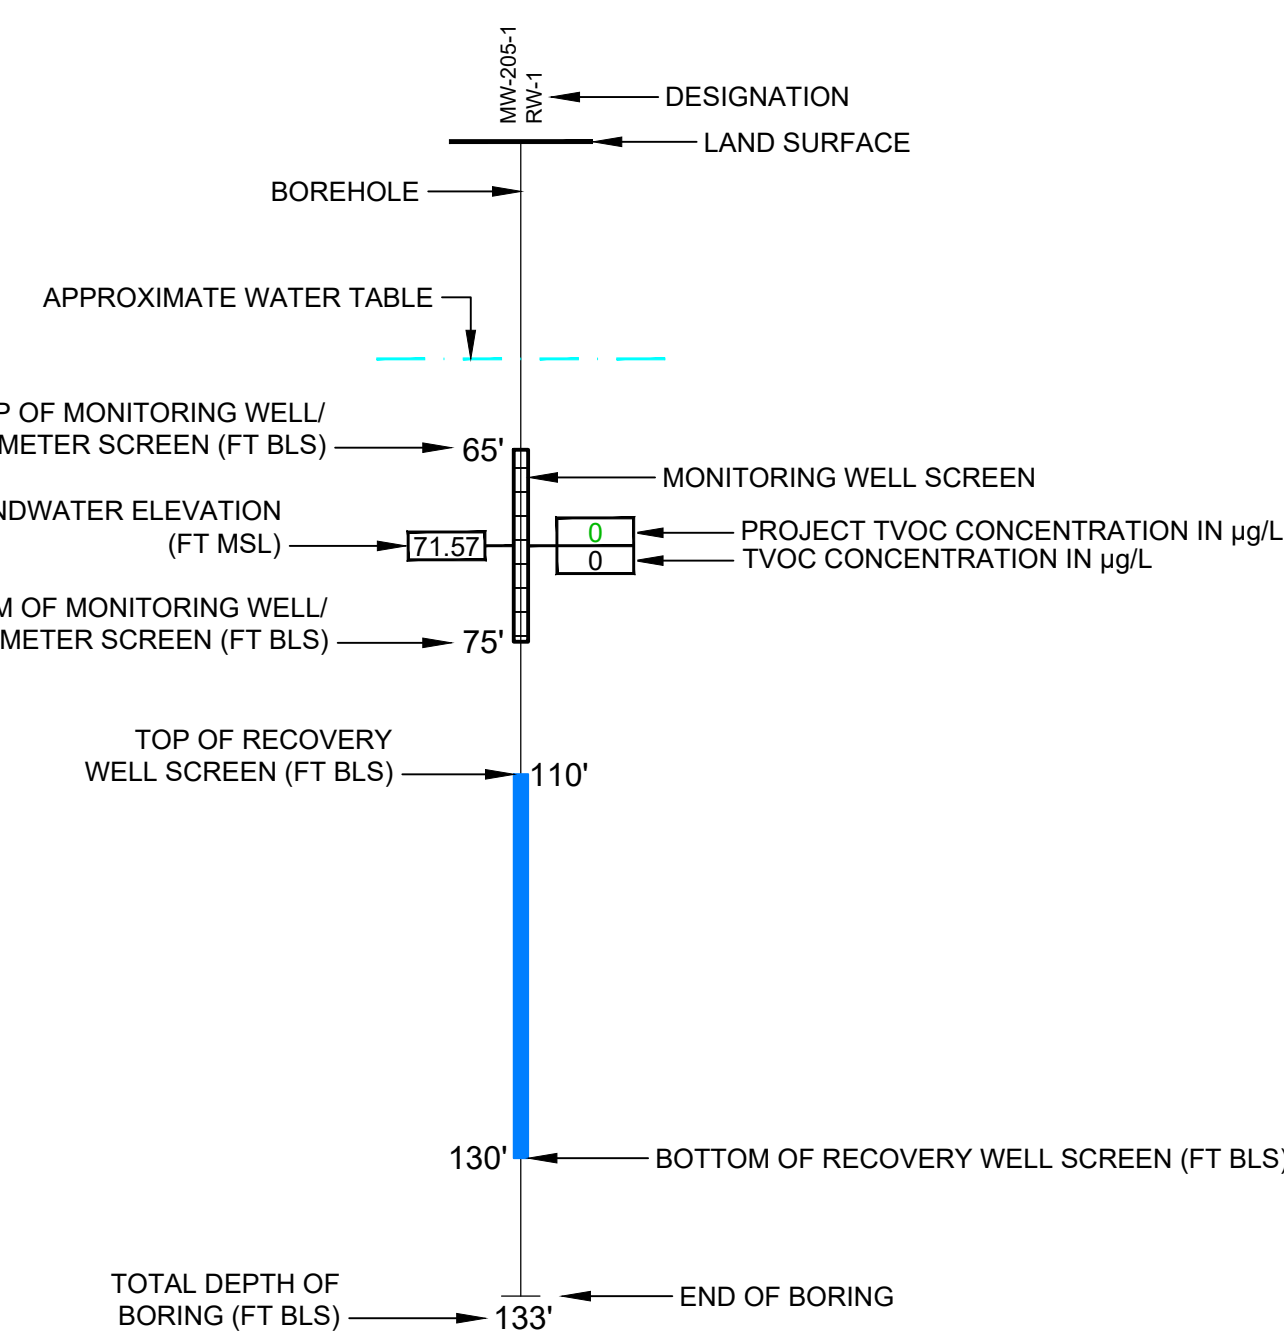

DEFINITIONS:
 FT - FEET
 MSL - MEAN SEA LEVEL
 BLS - BELOW LAND SURFACE
 µg/L - MICROGRAMS PER LITER
 TVOC - TOTAL VOLATILE ORGANIC COMPOUND
 NM - NOT MEASURED

LEGEND:

- 72 — GROUNDWATER ELEVATION CONTOUR IN FEET RELATIVE TO MEAN SEA LEVEL, DASHED WHERE LESS CONTROL AVAILABLE
- ← VERTICAL DIRECTION OF GROUNDWATER FLOW
- 10 — PROJECT TVOC CONTOUR IN µg/L, DASHED WHERE LESS CONTROL AVAILABLE

OPERABLE UNIT 3
 ONCT SYSTEM
 BETHPAGE, NEW YORK

CROSS SECTION D-D' SHOWING TVOCs IN GROUNDWATER AND DIRECTION OF VERTICAL GROUNDWATER FLOW THIRD QUARTER 2020

ARCADIS | Design & Consultancy for natural and built assets

FIGURE 10

Appendix A

Well Construction Information and Environmental Effectiveness Monitoring Program

Appendix A
Well Construction Information and Environmental Effectiveness Monitoring Program
Bethpage Park Groundwater Containment System
Operable Unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Well ID ⁽²⁾	Well Diameter (inches)	Depth to Screen		Screen Length (ft)	Well Depth (ft)	Well Materials	Water Levels ⁽³⁾	MONITORING ACTIVITY			
		Top (ft bls)	Bottom (ft bls)					WATER QUALITY ⁽¹⁾			
								VOC	SVOC	Cd/Cr	Fe/Mn
Monitoring Wells											
BCPMW-1	2	50	65	15	65	Sch. 40 PVC	Quarterly	Baseline	--	Baseline	--
BCPMW-2	2	60	75	15	75	Sch. 40 PVC	Quarterly	Baseline	--	Baseline	Baseline
BCPMW-3	2	59	74	15	74	Sch. 40 PVC	Quarterly	Baseline	--	Baseline	Baseline
BCPMW-4-1	4	45	65	20	70	Sch. 40 PVC	Quarterly	Baseline/Semiannual ⁽⁴⁾	Semiannual	Baseline/Annual	Baseline
BCPMW-4-2	4	68.5	83.5	15	88.5	Sch. 40 PVC	Quarterly	Baseline/Semiannual ⁽⁴⁾	Semiannual	Baseline/Annual	Baseline
BCPMW-4-3	4	115	125	10	130	Sch. 40 PVC	Quarterly	Baseline/Semiannual ⁽⁴⁾	Semiannual	Baseline/Annual	Baseline
BCPMW-5-1	4	50	65	15	70	Sch. 80 PVC/ SS	Quarterly	Baseline	--	Baseline	Baseline
BCPMW-6-1	4	88.5	98.5	10	103.5	Sch. 40 PVC	Quarterly	Baseline/Semiannual ⁽⁴⁾	Semiannual	Baseline/Annual	--
BCPMW-6-2	4	133	143	10	148	Sch. 40 PVC	Quarterly	Baseline/Semiannual ⁽⁴⁾	Semiannual	Baseline/Annual	--
BCPMW-7-1	4	90	100	10	105	Sch. 40 PVC	Quarterly	Baseline/Semiannual ⁽⁴⁾	Semiannual	Baseline/Annual	--
B24MW-2	2	54	74	20	74	PVC	Quarterly	Baseline/Annual	Annual	Baseline	--
B24MW-3	2	55	70	15	70	PVC	Quarterly	Baseline/Annual	Annual	Baseline	--
B30MW-1	2	57	72	15	72	PVC	Quarterly	Baseline/Annual	Annual	Baseline	--
MW-200-1	4	85	95	10	100	Sch. 40 PVC/ SS	Quarterly	Baseline/Semiannual ⁽⁴⁾	Semiannual	Baseline/Annual	--
MW-201-1	4	70	80	10	85	Sch. 40 PVC/ SS	Quarterly	Baseline/Semiannual ⁽⁴⁾	Semiannual	Baseline/Annual	--
MW-202-1	4	125	135	10	140	Sch. 40 PVC/ SS	Quarterly	Baseline/Semiannual ⁽⁴⁾	Semiannual	Baseline/Annual	--
MW-203-1	4	103	113	10	118	Sch. 40 PVC/ SS	Quarterly	Baseline/Semiannual ⁽⁴⁾	Semiannual	Baseline/Annual	--
MW-204-1	4	80	90	10	95	Sch. 40 PVC/ SS	Quarterly	Annual	Annual	--	--
MW-205-1 ⁽⁵⁾	4	65	75	10	80	Sch. 40 PVC/ SS	Quarterly	Annual	Annual	--	--
MW-206-1 ⁽⁵⁾	4	120	130	10	135	Sch. 40 PVC/ SS	Quarterly	Annual	Annual	--	--
MW-207A-1R ⁽⁶⁾	4	120	130	10	135	Sch. 40 PVC/ SS	Quarterly	Annual	Annual	--	--
MW-207B-1R ⁽⁶⁾	4	210	220	10	225	Sch. 40 PVC/ SS	Quarterly	Annual	Annual	--	--
MW-208-1 ⁽⁵⁾	4	80	90	10	92	Sch. 40 PVC/ SS	Quarterly	Annual	Annual	--	--
Remedial Wells⁽¹⁾											
RW-01	8	108	128	20	134	Sch. 80 PVC/SS	Quarterly	Baseline/Quarterly	Quarterly	Baseline/Annual	--
RW-02	6	84	104	20	104	Steel/SS	Quarterly	Baseline/Quarterly	Quarterly	Baseline/Annual	--
RW-03	8	84	104	20	107	Sch. 80 PVC/SS	Quarterly	Baseline/Quarterly	Quarterly	Baseline/Annual	--
RW-04	8	110	130	20	133	Sch. 80 PVC/SS	Quarterly	Baseline/Quarterly	Quarterly	Baseline/Annual	--

Notes and Abbreviations on Last Page

Appendix A
 Well Construction Information and Environmental Effectiveness Monitoring Program
 Bethpage Park Groundwater Containment System
 Operable Unit 3 (Former Grumman Settling Ponds)
 Bethpage, New York

Well ID ⁽²⁾	Well Diameter (inches)	Depth to Screen		Screen Length (ft)	Well Depth (ft)	Well Materials	Water Levels ⁽³⁾	MONITORING ACTIVITY			
		Top (ft bls)	Bottom (ft bls)					WATER QUALITY ⁽¹⁾			
								VOC	SVOC	Cd/Cr	Fe/Mn
Piezometers											
PZ-01a	2	60	65	5	68	Sch. 40 PVC	Quarterly	--	--	--	--
PZ-01b	1	80	85	5	88	Sch. 40 PVC	Quarterly	--	--	--	--
PZ-01c	1	130	135	5	138	Sch. 40 PVC	Quarterly	--	--	--	--
PZ-02a	2	60	65	5	68	Sch. 40 PVC	Quarterly	--	--	--	--
PZ-02b	1	80	85	5	85	Sch. 40 PVC	Quarterly	--	--	--	--
PZ-02c	1	130	135	5	138	Sch. 40 PVC	Quarterly	--	--	--	--
PZ-03	1	80	85	5	88	Sch. 40 PVC	Quarterly	--	--	--	--
PZ-04	1	80	85	5	88	Sch. 40 PVC	Quarterly	--	--	--	--
PZ-05a	2	65	70	5	74	Sch. 40 PVC	Quarterly	--	--	--	--
PZ-05b	1	110	115	5	117	Sch. 40 PVC	Quarterly	--	--	--	--
PZ-05c ⁽⁵⁾	2	130	135	5	138	Sch. 40 PVC	Quarterly	--	--	--	--
PZ-06a	2	65	70	5	72	Sch. 40 PVC	Quarterly	--	--	--	--
PZ-06b	1	90	95	5	97	Sch. 40 PVC	Quarterly	--	--	--	--
PZ-07a	2	65	70	5	72	Sch. 40 PVC	Quarterly	--	--	--	--
PZ-07b	1	113	118	5	120	Sch. 40 PVC	Quarterly	--	--	--	--
PZ-08a ⁽⁵⁾	2	60	65	5	68	Sch. 40 PVC	Quarterly	--	--	--	--
PZ-08b ⁽⁵⁾	2	80	85	5	88	Sch. 40 PVC	Quarterly	--	--	--	--
PZ-08c ⁽⁵⁾	2	130	135	5	138	Sch. 40 PVC	Quarterly	--	--	--	--
PZ-09a ⁽⁵⁾	2	57	62	5	67	Sch. 40 PVC	Quarterly	--	--	--	--
PZ-10a ⁽⁵⁾	2	65	70	5	75	Sch. 40 PVC	Quarterly	--	--	--	--

Notes and Abbreviations on Last Page

Appendix A
Well Construction Information and Environmental Effectiveness Monitoring Program
Bethpage Park Groundwater Containment System
Operable unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Notes and Abbreviations:

- (1) Water samples will be collected and analyzed in accordance with the method and procedures described in the BPGWCS OM&M Manual (Arcadis 2016) .
- (2) Approximate locations of the wells and piezometers in the OU3 BPGWCS Monitoring Program are shown in Figure 4.
- (3) Water Levels will be measured in all wells/piezometers during the baseline monitoring event in accordance with the procedures presented in the BPGWCS OM&M Manual (Arcadis 2016) .
- (4) Semiannual wells will be monitored annually after Year 1.
- (5) Wells installed by ERM in 2015.
- (6) Wells installed by EMAGIN in 2017.

Sch. 80 PVC: schedule 80 polyvinyl chloride

Sch. 40 PVC: schedule 40 polyvinyl chloride

BPGWCS: Bethpage Park Groundwater Containment System

SS: stainless steel

Steel: low carbon steel

ft: feet

ft bls: feet below land surface

Appendix A
Well Construction Information and Environmental Effectiveness Monitoring Program
Bethpage Park Groundwater Containment System
Operable unit 3 (Former Grumman Settling Ponds)
Bethpage, New York

Table 2. Remedial System Monitoring Program, Bethpage Park Groundwater Containment System, Operable Unit 3 (Former Grumman Settling Ponds), Northrop Grumman Systems, Corporation, Bethpage, New York. ⁽¹⁾

Sample Location/Instrument ⁽¹⁾	Parameter (Method) ⁽²⁾	Frequency	
		Long-Term ⁽³⁾	SCADA Data Acquisition
<u>Water Samples</u> ⁽⁴⁾			
Remedial Well 1 (WSP-1)	VOCs (USEPA 8260)	Quarterly	NA
	Iron (USEPA 6010)	Annually	NA
	1,4-Dioxane (USEPA 8270)	Quarterly	NA
Remedial Well 2 (WSP-2)	VOCs (USEPA 8260)	Quarterly	NA
	Iron (USEPA 6010)	Annually	NA
	1,4-Dioxane (USEPA 8270)	Quarterly	NA
Remedial Well 3 (WSP-3)	VOCs (USEPA 8260)	Quarterly	NA
	Iron (USEPA 6010)	Annually	NA
	1,4-Dioxane (USEPA 8270)	Quarterly	NA
Remedial Well 4 (WSP-4)	VOCs (USEPA 8260)	Quarterly	NA
	Iron (USEPA 6010)	Annually	NA
	1,4-Dioxane (USEPA 8270)	Quarterly	NA
Air Stripper Influent (WSP-5)	VOCs (USEPA 8260)	Quarterly	NA
	Iron (USEPA 6010)	Quarterly	NA
	1,4-Dioxane (USEPA 8270)	Quarterly	NA
Air Stripper Effluent (WSP-6)	Iron (USEPA 6010)	As Needed	NA
Plant Effluent (WSP-7)	VOCs (USEPA 8260)	Monthly	NA
	1,4-Dioxane (USEPA 8270)	Monthly	NA
	Iron (USEPA 6010)	Monthly	NA
	ph (field)	Monthly	NA
	Mercury	Monthly	NA
<u>Air Samples</u> ^{(4) (5)}			
Air Stripper Effluent/ECU-1 Influent (VSP-1)	VOCs (TO-15 Modified)	Quarterly	NA
ECU-1 Effluent/ECU-2 Influent (VSP-2)	VOCs (TO-15 Modified)	As Needed	NA
ECU-2 Effluent/ECU-3 Influent (VSP-3)	VOCs (TO-15 Modified)	As Needed	NA
ECU-3 Effluent/ECU-4 Influent (VSP-4)	VOCs (TO-15 Modified)	As Needed	NA

Table 2. Remedial System Monitoring Program, Bethpage Park Groundwater Containment System, Operable Unit 3 (Former Grumman Settling Ponds), Northrop Grumman Systems, Corporation, Bethpage, New York. ⁽¹⁾

Sample Location/Instrument ⁽¹⁾	Parameter (Method) ⁽²⁾	Frequency	
		Long-Term ⁽³⁾	SCADA Data Acquisition
Total Effluent (VSP-5)	VOCs (TO-15 Modified)	Quarterly	NA

Table 2. Remedial System Monitoring Program, Bethpage Park Groundwater Containment System, Operable Unit 3
 (Former Grumman Settling Ponds), Northrop Grumman Systems, Corporation, Bethpage, New York. ⁽¹⁾

Sample Location/Instrument ⁽¹⁾	Parameter (Method) ⁽²⁾	Frequency	
		Long-Term ⁽³⁾	SCADA Data Acquisition
<u>Water Flow Measurements</u>			
Remedial Well RW-1 (FT - 110)	Flow rate (gpm + total gal.)	Weekly	Continuously
Remedial Well RW-2 (FT - 120)	Flow rate (gpm + total gal.)	Weekly	Continuously
Remedial Well RW-3 (FT - 130)	Flow rate (gpm + total gal.)	Weekly	Continuously
Remedial Well RW-4 (FT - 140)	Flow rate (gpm + total gal.)	Weekly	Continuously
Combined Influent (FR - 200)	Flow rate (gpm + total gal.)	Weekly	Continuously
System Effluent (FT-700)	Flow rate (gpm + total gal.)	Weekly	Continuously
<u>Air Flow Measurements</u>			
Air Stripper Effluent (FT-500)	Flow rate (SCFM)	Weekly	Continuously
<u>Water Pressure Measurements</u>			
Remedial Well RW-1 (PT - 110)	Pressure (i.w.g.)	Weekly	Continuously
Remedial Well RW-2 (PT - 120)	Pressure (i.w.g.)	Weekly	Continuously
Remedial Well RW-3 (PT - 130)	Pressure (i.w.g.)	Weekly	Continuously
Remedial Well RW-4 (PT - 140)	Pressure (i.w.g.)	Weekly	Continuously
Air Stripper Effluent (PT-700)	Pressure (i.w.g.)	Weekly	Continuously
<u>Air Temperature & Relatively Humidity Measurements</u>			
Air Stripper Effluent (TT-500)	Temperature	Weekly	Continuously
ECU Mid-Train (TI-503)	Temperature	Weekly	NA
Effluent (TI-603)	Temperature	Weekly	NA

Table 2. Remedial System Monitoring Program, Bethpage Park Groundwater Containment System, Operable Unit 3 (Former Grumman Settling Ponds), Northrop Grumman Systems, Corporation, Bethpage, New York. ⁽¹⁾

Sample Location/Instrument ⁽¹⁾	Parameter (Method) ⁽²⁾	Frequency	
		Long-Term ⁽³⁾	SCADA Data Acquisition
<i>Air Pressure Measurements</i>			
Air Stripper Effluent (PT-500)	Pressure (i.w.g.)	Quarterly	Continuously
ECU #1 Influent (PI-501)	Pressure (i.w.g.)	Quarterly	NA
ECU #2 Influent (PI-502)	Pressure (i.w.g.)	Quarterly	NA
ECU #3 Influent (PI-601)	Pressure (i.w.g.)	Quarterly	NA
ECU #4 Influent (PI-602)	Pressure (i.w.g.)	Quarterly	NA
System Effluent (PI-603)	Pressure (i.w.g.)	Quarterly	NA

Notes:

- (1) Refer to Appendix E of the Operation, Maintenance and Monitoring Manual for a diagram showing referenced sample locations and measurement points.
- (2) Parameters/methods may be modified based on review of short-term and/or long-term testing results. Parameters shown in **Bold** indicate parameters that require NYSDEC notification/approval prior to change in monitoring schedule.
- (3) Long-term schedule is tentative. Modification may be required/recommended based on the results of water quality trends.
- (4) Samples will be analyzed in accordance with the methods and procedures described in the Sampling and Analysis Plan.
- (5) Additional air samples will be collected to help calculate media usage rates and to help determine media changeout frequencies.

Acronyms:

NA	Not applicable	NYSDEC	New York State Department of Environmental Conservation
ECU	Emissions control unit	EPA	U.S. Environmental Protection Agency
VOCs	Volatile organic compounds	SCADA	Supervisory Control And Data Acquisition
gal.	Gallons		
gpm	Gallons per minute		
i.w.g.	Inches water gauge		

Appendix B

Compliance and Performance Program

Sample Location/Instrument ⁽¹⁾	Parameter (Method) ⁽²⁾	Frequency			
		Short-Term ⁽³⁾		Long-Term ⁽⁴⁾	SCADA Data Acquisition
		(First month)	(Five month period following first month)		
Water Samples ⁽⁵⁾					
Remedial Well 1 (WSP-1)	VOCs (USEPA Method 8260C)	Bi-Weekly	Quarterly	Quarterly	NA
	Iron (USEPA 6010C)	Bi-Weekly	Annually	Annually	NA
	Cadmium and Chromium (USEPA 6010C) ⁽¹¹⁾				
	---		Annually	Annually	NA
Remedial Well 2 (WSP-2)	1,4-Dioxane (USEPA Method 522) ⁽¹²⁾		Quarterly	Quarterly	NA
	VOCs (USEPA Method 8260C)	Bi-Weekly	Quarterly	Quarterly	NA
	Iron (USEPA 6010C)	Bi-Weekly	Annually	Annually	NA
	Cadmium and Chromium (USEPA 6010C) ⁽¹¹⁾				
Remedial Well 3 (WSP-3)	---		Annually	Annually	NA
	1,4-Dioxane (USEPA Method 522) ⁽¹²⁾		Quarterly	Quarterly	NA
	VOCs (USEPA Method 8260C)	Bi-Weekly	Quarterly	Quarterly	NA
	Iron (USEPA 6010C)	Bi-Weekly	Annually	Annually	NA
Remedial Well 4 (WSP-4)	Cadmium and Chromium (USEPA 6010C) ⁽¹¹⁾				
	---		Annually	Annually	NA
	1,4-Dioxane (USEPA Method 522) ⁽¹²⁾		Quarterly	Quarterly	NA
	VOCs (USEPA Method 8260C)	Bi-Weekly	Quarterly	Quarterly	NA
Air Stripper Influent (WSP-5)	Iron (USEPA 6010C)	Bi-Weekly	Annually	Annually	NA
	---		Annually	Annually	NA
	1,4-Dioxane (USEPA Method 522) ⁽¹²⁾		Quarterly	Quarterly	NA
	VOCs (USEPA Method 8260C)	1-hr ⁽⁶⁾ ; Days 1, 3, & Weekly	Monthly	Quarterly	NA
Air Stripper Effluent (WSP-6)	Iron (USEPA 6010C)	1-hr ⁽⁶⁾ ; Days 1, 3, & Weekly	Monthly	Quarterly	NA
	1,4-Dioxane (USEPA Method 522) ⁽¹²⁾		Quarterly	Quarterly	NA
	Iron (USEPA 6010C)	1-hr ⁽⁶⁾ ; As Needed	As Needed	As Needed	NA
Plant Effluent (WSP-7)	VOCs (USEPA Method 8260C and 624) ⁽¹³⁾	1-hr ⁽⁶⁾ ; Days 1, 3, & Weekly	Monthly	Monthly	NA
	Iron (USEPA 6010C)	1-hr ⁽⁶⁾ ; Days 1, 3, & Weekly	Monthly	Monthly	NA
	Mercury (USEPA 7470A) ⁽⁷⁾	1-hr ⁽⁶⁾ ; Days 1, 3, & Weekly	Monthly	Monthly	NA
	1,4-Dioxane (USEPA Method 522) ⁽¹²⁾		Monthly	Monthly	NA
	Cadmium and Chromium (USEPA 6010C) ⁽¹¹⁾				
	---		Quarterly	Quarterly	NA
	Total Nitrogen, Nitrate + Nitrite (USEPA Method 353.2) ⁽¹³⁾		Monthly	Monthly	NA
	TKN (USEPA Method 351.2) ⁽¹³⁾		Monthly	Monthly	NA
Air Samples ^{(9) (10)}	pH (field) ⁽⁸⁾	1-hr ⁽⁶⁾ ; Days 1, 3, & Weekly	Monthly	Monthly	NA
	and		Quarterly	Quarterly	NA
Air Stripper Effluent/ECU-1 Influent (VSP-1)	VOCs (TO-15 Modified)	Monthly	Monthly	Quarterly	NA
ECU-1 Effluent/ECU-2 Influent (VSP-2)	VOCs (TO-15 Modified)	As Needed	As Needed	As Needed	NA
ECU-2 Effluent/ECU-3 Influent (VSP-3)	VOCs (TO-15 Modified)	As Needed	As Needed	As Needed	NA
ECU-3 Effluent/ECU-4 Influent (VSP-4)	VOCs (TO-15 Modified)	As Needed	As Needed	As Needed	NA
Total Effluent (VSP-5)	VOCs (TO-15 Modified)	Monthly	Monthly	Quarterly	NA

See notes on last page.

Sample Location/Instrument ⁽¹⁾	Parameter (Method) ⁽²⁾	Frequency			
		Short-Term ⁽³⁾		Long-Term ⁽⁴⁾	SCADA Data Acquisition
		(First month)	(Five month period following first month)		
<u>Water Flow Measurements</u>					
Remedial Well RW-1 (FT - 110)	Flow rate (gpm + total gal.)	(Daily -1st week) Weekly	Weekly	Weekly	Continuously
Remedial Well RW-2 (FT - 120)	Flow rate (gpm + total gal.)	(Daily -1st week) Weekly	Weekly	Weekly	Continuously
Remedial Well RW-3 (FT - 130)	Flow rate (gpm + total gal.)	(Daily -1st week) Weekly	Weekly	Weekly	Continuously
Remedial Well RW-4 (FT - 140)	Flow rate (gpm + total gal.)	(Daily -1st week) Weekly	Weekly	Weekly	Continuously
Combined Influent (FR - 200)	Flow rate (gpm + total gal.)	(Daily -1st week) Weekly	Weekly	Weekly	Continuously
System Effluent (FT-700)	Flow rate (gpm + total gal.)	(Daily -1st week) Weekly	Weekly	Weekly	Continuously
<u>Air Flow Measurements</u>					
Air Stripper Effluent (FT-500)	Flow rate (SCFM)	(Daily -1st week) Weekly	Weekly	Weekly	Continuously
<u>Water Pressure Measurements</u>					
Remedial Well RW-1 (PT - 110)	Pressure (i.w.g.)	(Daily -1st week) Weekly	Weekly	Weekly	Continuously
Remedial Well RW-2 (PT - 120)	Pressure (i.w.g.)	(Daily -1st week) Weekly	Weekly	Weekly	Continuously
Remedial Well RW-3 (PT - 130)	Pressure (i.w.g.)	(Daily -1st week) Weekly	Weekly	Weekly	Continuously
Remedial Well RW-4 (PT - 140)	Pressure (i.w.g.)	(Daily -1st week) Weekly	Weekly	Weekly	Continuously
Air Stripper Effluent (PT-700)	Pressure (i.w.g.)	(Daily -1st week) Weekly	Weekly	Weekly	Continuously
<u>Air Temperature & Relatively Humidity Measurements</u>					
Air Stripper Effluent (TT-500)	Temperature	Weekly	Weekly	Weekly	Continuously
ECU Mid-Train (TI-503)	Temperature	Weekly	Weekly	Weekly	NA
Effluent (TI-603)	Temperature	Weekly	Weekly	Weekly	NA
<u>Air Pressure Measurements</u>					
Air Stripper Effluent (PT-500)	Pressure (i.w.g.)	(Daily -1st week) Weekly	Monthly	Quarterly	Continuously
ECU #1 Influent (PI-501)	Pressure (i.w.g.)	(Daily -1st week) Weekly	Monthly	Quarterly	NA
ECU #2 Influent (PI-502)	Pressure (i.w.g.)	(Daily -1st week) Weekly	Monthly	Quarterly	NA
ECU #3 Influent (PI-601)	Pressure (i.w.g.)	(Daily -1st week) Weekly	Monthly	Quarterly	NA
ECU #4 Influent (PI-602)	Pressure (i.w.g.)	(Daily -1st week) Weekly	Monthly	Quarterly	NA
System Effluent (PI-603)	Pressure (i.w.g.)	(Daily -1st week) Weekly	Monthly	Quarterly	NA

See notes on last page.

Abbreviations, Notes and Units:

- (1) Refer to Figure 3 of this Operation, Maintenance, & Monitoring (OM&M) Report and Appendix E of the Groundwater IRM OM&M Manual (OM&M Manual (ARCADIS 2009)) for a diagram showing referenced sample locations and measurement points.
- (2) Parameters/methods may be modified based on review of short-term and/or long-term testing results. Parameters shown in **Bold** indicate parameters that require NYSDEC notification/approval prior to change in monitoring schedule.
- (3) Short-term schedule is tentative. Modification may be required/recommended based on the results of start-up and performance testing.
- (4) Long-term schedule is tentative. Modification may be required/recommended based on the results of short-term testing or water quality trends.
- (5) Water samples will be collected in accordance with the methods described in the Sampling and Analysis Plan, which is included as Appendix A of the OM&M Manual (ARCADIS 2009). Samples will be analyzed in accordance with the methods and procedures described in the Sampling and Analysis Plan.
- (6) Per NYSDEC request, a 1-hr pilot test was performed during system shake-down. The 1-hr pilot test samples were also analyzed for Mercury (Hg).
- (7) Per the interim treated effluent (water) discharge criteria provided in the NYSDEC letter dated March 19, 2009, select samples were analyzed for Mercury (Hg).
- (8) As authorized by the NYSDEC, the pH monitoring frequency was reduced from weekly to monthly beginning on February 8, 2010.
- (9) Air samples collected and analyzed in accordance with methods described in the Sampling and Analysis Plan, which is included as Appendix A of the OM&M Manual (ARCADIS 2009).
- (10) Additional air samples will be collected to help calculate media usage rates and to help determine media changeout frequencies.
- (11) Cadmium and Chromium analyses are part of the Environmental Effectiveness Monitoring Program (Table A-1) and the original discharge permit application. They are included here for consistency.
- (12) As of July 11 2018, 1,4-Dioxane is analyzed per USEPA Method 8270-SIM-CLLE.
- (13) As of November 2017, plant effluent was analyzed for permit equivalency Volatile Organic Compounds (VOCs) using USEPA Method 624; Total Nitrogen is calculated as the sum of Nitrogen, (Nitrate+Nitrite) and Total Kjeldahl Nitrogen (TKN), (CAS number: 14797-55-8, 14797-65-0, and 7727-37-9, respectively) by USEPA Methods 353.2 and 351.2, respectively; Total Iron and Manganese using USEPA Method 200.7.

ECU	Emissions Control Unit
EPA	U.S. Environmental Protection Agency
NA	Not Applicable
---	Not Required
NYSDEC	New York State Department of Environmental Conservation
OM&M	Operation, Maintenance and Monitoring
SCADA	Supervisory Control And Data Acquisition
SPDES	State Pollutant Discharge Elimination System
USEPA	United States Environmental Protection Agency
VOCs	Volatile Organic Compounds (refer Tables D-3 and D-5 in the Quality Assurance Project Plan (QAPP) (Appendix D of the OM&M Manual (ARCADIS 2009)) for the analyte lists for aqueous and air samples, respectively)
gal	gallons
gpm	gallons per minute
i.w.g.	inches water gauge

Arcadis of New York, Inc.
Two Huntington Quadrangle, Suite 1S10
Melville
New York 11747
Phone: 631 249 7600
Fax: 631 249 7610
www.arcadis.com