

Mr. Jason Pelton  
Project Manager  
New York State Department of Environmental Conservation  
Remedial Bureau D  
625 Broadway  
Albany, New York 12233-7015

Arcadis of New York, Inc.  
Two Huntington  
Quadrangle  
Suite 1S10  
Melville  
New York 11747  
Phone: 631 249 7600  
Fax: 631 249 7610

[www.arcadis.com](http://www.arcadis.com)

Date: May 27, 2021

Our Ref: 30062516.RPTI4  
30059250.NAVI4

Subject: 2021 First Quarter Operation Maintenance and Monitoring Report,  
Operable Unit 2, Northrop Grumman and Naval Weapons Industrial Reserve  
Plant (NWIRP) Sites, Bethpage, New York.  
(NYSDEC Site #'s 1-30-003A and B)

Dear Jason:

On behalf of Northrop Grumman, Arcadis is providing the NYSDEC with the First Quarter 2021 Operation, Maintenance, and Monitoring Report (Report). This Report was prepared to document the operation, maintenance, and monitoring (OM&M) activities conducted for the on-site portion of the Operable Unit 2 (OU2) groundwater remedy and the results of ongoing volatile organic compound (VOC) and inorganic monitoring in groundwater to meet the remedial objectives set forth in the March 2001 OU2 Record of Decision (ROD) and associated December 2019 Amended Record of Decision (AROD).

Table 1 summarizes OU2 remedial system performance operational data, total mass removal, and water balance. Tables 2 and 3 provide the analytical results for remedial system water and vapor samples, respectively, for this period. Tables 4A and 4B provide the air modeling inputs and outputs and resulting analyses based on quarterly vapor samples collected from the Tower 96 and Tower 102 systems, respectively, for this period. Tables 5A and 5B provide a summary of percent mass emittance of TCE from vapor sampling completed during the First Quarter 2020 through the First Quarter 2021. Table 6 provides validated analytical results associated with groundwater monitoring efforts completed during this period. Figures 1 through 3 show the Locations of Wells and On-site Groundwater Remedy, ONCT Groundwater Extraction and Treatment System Site Plan, and the ONCT Groundwater Extraction and Treatment System Schematic, respectively.

Jason Pelton  
NYSDEC  
May 27, 2021

Please contact us if you have any questions or comments.

Sincerely,  
Arcadis of New York, Inc.



Christopher Engler, P.E.  
New York PE-069748  
Vice President

Email: [christopher.engler@arcadis.com](mailto:christopher.engler@arcadis.com)  
Direct Line: 315.409.6579

CC. Ed Hannon – Northrop Grumman  
Chris Engelhardt – NYSDEC Region 1  
Donald Hesler – NYSDEC  
Steven Scharf – NYSDEC  
James Sullivan – New York State Department of Health  
Donald Irwin – NCDOH  
Robin Putman – NCDOH  
Richard Castle - NCDOH  
James Watts-Gravette – NAVFAC Mid-Atlantic Environmental  
David Brayack – TetraTech NUS, Inc.  
Paul Bluestein – Glenn Springs Holdings, Inc.  
Manfred Bohms – Steel Equities  
Nidal Azzam – USEPA  
Carol Stein - USEPA  
Matthew Russo – Town of Oyster Bay  
Stan Carey – Massapequa Water District  
Richard Kern – New York American Water  
Frank Koch – South Farmingdale Water District  
John Reinhardt – Town of Hempstead Water District  
Michael Boufis – Bethpage Water District  
Bethpage Public Library  
File

Enclosures

# Tables

Table 1  
Operational Summary for the Treatment System  
First Quarter 2021<sup>(1)</sup> Reporting Period  
Operable Unit 2  
Northrop Grumman  
Bethpage, New York

	Quarterly Flow Rates (gpm)		Quarterly Flow Volumes (MG)		
	Current Model Design <sup>(2)</sup>	Current Operational Flow <sup>(3,4)</sup>	Design <sup>(2)</sup>	Actual <sup>(3,4)</sup>	% of Design <sup>(14)</sup>
<b>Influent Groundwater</b>					
Well 1 <sup>(7)</sup>	800	883	104	106	102%
Well 3R <sup>(7)</sup>	700	705	91	83	91%
Well 17 <sup>(7)</sup>	1,000	1,033	130	131	101%
Well 18 <sup>(7)</sup>	800	982	104	92	88%
Well 19 <sup>(7)</sup>	500	597	65	75	115%
<b>Total<sup>(8)</sup></b>	<b>3,800</b>	<b>4,200</b>	<b>494</b>	<b>487</b>	<b>99%</b>
<b>Effluent Groundwater<sup>(9)</sup></b>					
Calpine	100 - 400	364	--	47	--
OXY Biosparge <sup>(10)</sup>	2 - 42	0	--	0	--
West Recharge Basins	1,112 - 1,455	1,012	--	131	--
South Recharge Basins <sup>(10)</sup>	2,231	2,377	289	308	107%
<b>Total<sup>(11)</sup></b>	<b>--</b>	<b>3,753</b>	<b>--</b>	<b>486</b>	<b>--</b>
<b>Additional Flow to South Recharge Basins</b>					
Storm Water Runoff Contributing to South Recharge Basins Flow Volume <sup>(11)</sup>	--	--	--	19	--
<b>Total Flow Volume to South Recharge Basins<sup>(10,11,12)</sup></b>			<b>296</b>	<b>327</b>	<b>110%</b>
<b>Treatment Efficiencies<sup>(13)</sup></b>					
Tower 96 System:	>99.9%				
Tower 102 System:	>99.9%				

See Notes and Abbreviations on last page.

Table 1  
Operational Summary for the Treatment System  
First Quarter 2021<sup>(1)</sup> Reporting Period  
Operable Unit 2  
Northrop Grumman  
Bethpage, New York

	Quarterly VOC Concentrations (µg/L)		VOC Mass Removed (lbs)	
	TCE <sup>(5)</sup>	TVOC <sup>(5,6)</sup>	Quarterly	Cumulative
<b>Influent Groundwater</b>				
Well 1 <sup>(7)</sup>	578	611	541	52,564
Well 3R <sup>(7)</sup>	199	248	172	93,234
Well 17 <sup>(7)</sup>	130	151	165	54,933
Well 18 <sup>(7)</sup>	31.8	54.5	42	7,080
Well 19 <sup>(7)</sup>	84	103	64	9,260
<b>Total<sup>(8)</sup></b>	--	--	<b>984</b>	<b>217,071</b>
<b>Effluent Groundwater<sup>(9)</sup></b>				
Calpine	--	--	--	--
OXY Biosparge <sup>(10)</sup>	--	--	--	--
West Recharge Basins	--	ND	--	--
South Recharge Basins <sup>(10)</sup>	--	1.1	--	--
<b>Total<sup>(11)</sup></b>				
<b>Additional Flow to South Recharge Basins</b>				
Storm Water Runoff Contributing to South Recharge Basins Flow Volume <sup>(11)</sup>	--	--	--	--
<b>Total Flow Volume to South Recharge Basins<sup>(10,11,12)</sup></b>				
<b>Treatment Efficiencies<sup>(13)</sup></b>				
Tower 96 System:				
Tower 102 System:				

See Notes and Abbreviations on last page.

**Notes and Abbreviations:**

- (1) Quarterly reporting period: January 01, 2021 through March 31, 2021.
- (2) "Current Model Design" flow rates were determined for the five remedial wells and for the South Recharge Basin based on computer modeling (ARCADIS G&M, Inc. 2002, updated in 2021). Flow rates for Calpine Power Plant (Calpine), Occidental Chemical (OXY) Biosparge, and West Recharge Basin flow rates are typical flow rates and are provided for reader information. "Design" flow volumes represent the volume of water that is expected to be pumped/discharged during the reporting period and is calculated by multiplying the design rate by the reporting period duration.
- (3) Actual flow rates for the remedial wells represent the average actual pumping rates when the pumps are operational and do not take into account the time that a well is not operational. Actual flow volumes during Quarter 1 are taken from the monthly SPDES reports which are calculated by using the SCADA instantaneous flow rates transmitted from local flow meters.
- (4) "Actual" flow rates for the system discharges represent the average flow rate during the entire reporting period and are determined by dividing the total flow recorded during the reporting period by the reporting period duration.
- (5) The TCE and TVOC concentrations are from the quarterly sampling events performed during this reporting period on February 24, 2021 and March 16, 2021.
- (6) The TVOC concentration for the two sets of recharge basins are their respective average monthly Outfall SPDES concentrations for the current quarter.
- (7) Tower 96 was shutdown for maintenance for 148 hours from February 18, 2021 to February 24, 2021 for exterior blower bearing repair and balancing. The Tower 102 System shut down for 6.25 hours from February 19, 2021 to February 20, 2021 due to an issue with the hydrovane and associated corrective actions. The Tower 96 System was shut down for 6.5 hours on March 3, 2021 for change-out of the GAC within the supplemental GAC beds.
- (8) Total pumpage/recharge rates are accurate to  $\pm 15\%$  based on available information and expected or typical precision/accuracy factors for the gauges and meters.
- (9) There are four possible discharges for the effluent groundwater: South Recharge Basins, West Recharge Basins, Calpine, and the OXY Biosparge system. Treated water is continuously discharged to the south and west recharge basins during routine operation, and is available "on-demand" to both Calpine for use as make-up water, and the OXY Biosparge remediation system. For this quarter, the quarterly flow rates to the south and west recharge basins (SRB and WRB, respectively) were calculated using the remedial well flow rates and available additional information and assumptions provided by Northrop Grumman regarding flow distribution, as follows: the Tower 96 system (Remedial Wells 1 and 3R) discharges effluent water to the WRB, less Calpine usage and less 119 gpm of Tower 102 steam condenser usage (15.8 MG); the Tower 102 system (Remedial Wells 17 through 19), including the Tower 102 steam condenser usage (15.8 MG), discharges effluent water to the SRB.
- (10) Oxy has not reported any water usage for the OXY Biosparge system since May 2016.
- (11) Storm water runoff volume is calculated by multiplying the adjusted tributary area and NOAA precipitation data for the reporting periods. The tributary area is adjusted by the runoff coefficient to exclude the infiltration volume from the total rainfall volume. The tributary area, runoff coefficient, and adjusted tributary area are from Dvirka and Bartilucci Consulting Engineers' Storm Water Permit Evaluation Report (January, 28, 2010). The NOAA precipitation data are calculated as a sum of NOAA daily precipitation data for the reporting period. NOAA precipitation data are retrieved from Station GHCND:USW00054787 - FARMINGDALE REPUBLIC AIRPORT, NY US for January, February and March 2021.
- (12) Total Flow Volume to South Recharge Basins is estimated as a sum of flow volumes contributed by the effluent groundwater to South Recharge Basins and from storm water runoff to South Recharge Basins. First Quarter 2021 calculated South Recharge Basin flow volume is within historical operating range.
- (13) Treatment System Efficiencies are calculated by dividing the difference between the remedial well flow weighted influent and effluent TVOC concentrations by the remedial well flow weighted influent concentration.
- (14) Due to VFD and pump motor failures, Well 18 was down between January 20, 2021 and February 11, 2021. To enhance system capture during this period, the remaining recovery well flow rates were adjusted as follows: Well 1 flow rate was increased to 1,000 gpm; Well 17 flow rate was increased to 1,100 gpm; and Well 19 flow rate was increased to 900 gpm.

- Not Applicable
- µg/L micrograms per liter
- gpm gallons per minute
- lbs pounds
- MG million gallons
- NOAA National Oceanic and Atmospheric Administration
- SCADA Supervisory Controls and Data Acquisition
- SPDES State Pollution Discharge Elimination System
- TCE trichloroethene
- TVOC total volatile organic compounds
- VOC volatile organic compounds

**Table 2**  
**Concentrations of Constituents in Remedial Wells and**  
**Treatment System Effluents**  
**First Quarter 2021<sup>(1)</sup> Reporting Period**  
**Operable Unit 2**  
**Northrop Grumman,**  
**Bethpage, New York**



<b>Constituents<sup>(2)</sup></b> <b>(Units in µg/L)</b>	<b>CAS#</b>	<b>Location ID:</b> <b>Sample ID:</b> <b>Sample Date:</b>	<b>WELL 1</b> <b>WELL 1</b> <b>3/16/2021</b>	<b>WELL 3R</b> <b>WELL 3R</b> <b>3/16/2021</b>	<b>96 EFFLUENT</b> <b>96 EFFLUENT</b> <b>3/16/2021</b>
<b><u>Volatile Organic Compounds (VOCs)<sup>(3)</sup></u></b>					
1,1,1-Trichloroethane	00071-55-6		< 0.50	<b>0.53</b>	< 0.50
1,1,2,2-Tetrachloroethane	00079-34-5		< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	00079-00-5		< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	00075-34-3		<b>0.76 J</b>	<b>1.3</b>	< 1.0
1,1-Dichloroethene	00075-35-4		<b>1.5</b>	<b>4.0</b>	< 0.50
1,2-Dichloroethane	00107-06-2		< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	00078-87-5		<b>3.7</b>	< 1.0	< 1.0
2-Butanone (MEK)	00078-93-3		< 10	< 10	< 10
2-Hexanone (MBK)	00591-78-6		< 5.0	< 5.0	< 5.0
4-Methyl-2-Pentanone (MIK)	00108-10-1		< 5.0	< 5.0	< 5.0
Acetone	00067-64-1		< 10	< 10	< 10
Benzene	00071-43-2		< 0.50	< 0.50	< 0.50
Bromodichloromethane	00075-27-4		< 1.0	< 1.0	< 1.0
Bromoform	00075-25-2		< 1.0	< 1.0	< 1.0
Bromomethane	00074-83-9		< 2.0	< 2.0	< 2.0
Carbon Disulfide	00075-15-0		< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	00056-23-5		< 1.0	< 1.0	< 1.0
Chlorobenzene	00108-90-7		< 1.0	< 1.0	< 1.0
Chloroethane	00075-00-3		< 1.0	< 1.0	< 1.0
Chloroform	00067-66-3		<b>0.48 J</b>	<b>&lt; 0.50</b>	< 0.50
Chloromethane	00074-87-3		< 1.0	< 1.0	< 1.0
cis-1,2-Dichloroethene	00156-59-2		<b>5.9</b>	<b>3.3</b>	< 0.50
cis-1,3-Dichloropropene	10061-01-5		< 1.0	< 1.0	< 1.0
Dibromochloromethane	00124-48-1		< 1.0	< 1.0	< 1.0
Ethylbenzene	00100-41-4		< 1.0	< 1.0	< 1.0
Dichloromethane	00075-09-2		< 0.50	< 0.50	< 0.50
Styrene	00100-42-5		< 1.0	< 1.0	< 1.0
Tetrachloroethene	00127-18-4		<b>17.5</b>	<b>36.6</b>	< 0.50
Toluene	00108-88-3		< 1.0	< 1.0	< 1.0
trans-1,2-Dichloroethene	00156-60-5		< 0.50	< 0.50	< 0.50
trans-1,3-Dichloropropene	10061-02-6		< 1.0	< 1.0	< 1.0
Trichloroethylene	00079-01-6		<b>578</b>	<b>199</b>	< 0.50
Trichlorotrifluoroethane (Freon 113)	00076-13-1		3.4	<b>2.0</b>	< 0.50
Vinyl Chloride	00075-01-4		< 0.50	<b>1.6</b>	< 0.50
Xylene-o	00095-47-6		< 1.0	< 1.0	< 1.0
Xylene-m,p	179601-23-1		< 1.0	< 1.0	< 1.0
<b>Total VOCs<sup>(4)</sup></b>			<b>611</b>	<b>248</b>	<b>ND</b>
<b>1,4-Dioxane<sup>(3)</sup></b>			<b>6.8</b>	<b>11</b>	<b>8.7</b>

Notes and abbreviations on last page.

**Table 2**  
**Concentrations of Constituents in Remedial Wells and**  
**Treatment System Effluents**  
**First Quarter 2021<sup>(1)</sup> Reporting Period**  
**Operable Unit 2**  
**Northrop Grumman,**  
**Bethpage, New York**



Constituents <sup>(2)</sup> (Units in µg/L)	CAS#	Location ID:	WELL 17	WELL 18	WELL 19
		Sample ID:	WELL 17	WELL 18	WELL 19
		Sample Date:	2/24/2021	2/24/2021	2/24/2021
<b>Volatile Organic Compounds (VOCs)<sup>(3)</sup></b>					
1,1,1-Trichloroethane	00071-55-6		< 0.50	< 0.50	< 0.50
1,1,2,2-Tetrachloroethane	00079-34-5		< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	00079-00-5		< 1.0	< 1.0	< 1.0
1,1-Dichloroethane	00075-34-3		<b>0.61 J</b>	<b>1.2</b>	< 1.0
1,1-Dichloroethene	00075-35-4		<b>1.3</b>	<b>2.8</b>	<b>0.93</b>
1,2-Dichloroethane	00107-06-2		< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	00078-87-5		<b>0.69 J</b>	< 1.0	< 1.0
2-Butanone (MEK)	00078-93-3		< 10	< 10	< 10
2-Hexanone (MBK)	00591-78-6		< 5.0	< 5.0	< 5.0
4-Methyl-2-Pentanone (MIK)	00108-10-1		< 5.0	< 5.0	< 5.0
Acetone	00067-64-1		< 10	< 10	< 10
Benzene	00071-43-2		< 0.50	< 0.50	< 0.50
Bromodichloromethane	00075-27-4		< 1.0	< 1.0	< 1.0
Bromoform	00075-25-2		< 1.0	< 1.0	< 1.0
Bromomethane	00074-83-9		< 2.0	< 2.0	< 2.0
Carbon Disulfide	00075-15-0		< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	00056-23-5		< 1.0	< 1.0	< 1.0
Chlorobenzene	00108-90-7		< 1.0	< 1.0	< 1.0
Chloroethane	00075-00-3		< 1.0	< 1.0	< 1.0
Chloroform	00067-66-3		< 0.50	< 0.50	< 0.50
Chloromethane	00074-87-3		< 1.0	< 1.0	< 1.0
cis-1,2-Dichloroethene	00156-59-2		<b>2.3</b>	<b>2.6</b>	<b>11.3</b>
cis-1,3-Dichloropropene	10061-01-5		< 1.0	< 1.0	< 1.0
Dibromochloromethane	00124-48-1		< 1.0	< 1.0	< 1.0
Ethylbenzene	00100-41-4		< 1.0	< 1.0	< 1.0
Dichloromethane	00075-09-2		< 0.50	< 0.50	< 0.50
Styrene	00100-42-5		< 1.0	< 1.0	< 1.0
Tetrachloroethene	00127-18-4		<b>14.4</b>	<b>15.2</b>	<b>5.6</b>
Toluene	00108-88-3		< 1.0	< 1.0	< 1.0
trans-1,2-Dichloroethene	00156-60-5		< 0.50	< 0.50	< 0.50
trans-1,3-Dichloropropene	10061-02-6		< 1.0	< 1.0	< 1.0
Trichloroethylene	00079-01-6		<b>130</b>	<b>31.8</b>	<b>84.4</b>
Trichlorotrifluoroethane (Freon 113)	00076-13-1		<b>1.9</b>	<b>0.86</b>	<b>0.68</b>
Vinyl Chloride	00075-01-4		< 0.50	< 0.50	< 0.50
Xylene-o	00095-47-6		< 1.0	< 1.0	< 1.0
Xylene-m,p	179601-23-1		< 1.0	< 1.0	< 1.0
<b>Total VOCs<sup>(4)</sup></b>			<b>151</b>	<b>54.5</b>	<b>102.9</b>
<b>1,4-Dioxane<sup>(3)</sup></b>			<b>6.9</b>	<b>4.8</b>	<b>4.2</b>

Notes and abbreviations on last page.



**Table 2**  
**Concentrations of Constituents in Remedial Wells and**  
**Treatment System Effluents**  
**First Quarter 2021<sup>(1)</sup> Reporting Period**  
**Operable Unit 2**  
**Northrop Grumman,**  
**Bethpage, New York**



<b>Constituents<sup>(2)</sup></b> <b>(Units in µg/L)</b>	<b>CAS#</b>	<b>Location ID:</b> <b>Sample ID:</b> <b>Sample Date:</b>	<b>WELL 19</b> <b>REP-120820-JS-1</b> <b>2/24/2021</b>	<b>102 EFFLUENT</b> <b>102 EFFLUENT</b> <b>2/24/2021</b>
<b><u>Volatile Organic Compounds (VOCs)<sup>(3)</sup></u></b>				
1,1,1-Trichloroethane	00071-55-6		< 0.50	< 0.50
1,1,2,2-Tetrachloroethane	00079-34-5		< 1.0	< 1.0
1,1,2-Trichloroethane	00079-00-5		< 1.0	< 1.0
1,1-Dichloroethane	00075-34-3		< 1.0	< 1.0
1,1-Dichloroethene	00075-35-4		<b>1.2</b>	< 0.50
1,2-Dichloroethane	00107-06-2		< 1.0	< 1.0
1,2-Dichloropropane	00078-87-5		< 1.0	< 1.0
2-Butanone (MEK)	00078-93-3		< 10	< 10
2-Hexanone (MBK)	00591-78-6		< 5.0	< 5.0
4-Methyl-2-Pentanone (MIK)	00108-10-1		< 5.0	< 5.0
Acetone	00067-64-1		< 10	< 10
Benzene	00071-43-2		< 0.50	< 0.50
Bromodichloromethane	00075-27-4		< 1.0	< 1.0
Bromoform	00075-25-2		< 1.0	< 1.0
Bromomethane	00074-83-9		< 2.0	< 2.0
Carbon Disulfide	00075-15-0		< 2.0	< 2.0
Carbon Tetrachloride	00056-23-5		< 1.0	< 1.0
Chlorobenzene	00108-90-7		< 1.0	< 1.0
Chloroethane	00075-00-3		< 1.0	< 1.0
Chloroform	00067-66-3		< 0.50	< 0.50
Chloromethane	00074-87-3		< 1.0	< 1.0
cis-1,2-Dichloroethene	00156-59-2		<b>11.7</b>	< 0.50
cis-1,3-Dichloropropene	10061-01-5		< 1.0	< 1.0
Dibromochloromethane	00124-48-1		< 1.0	< 1.0
Ethylbenzene	00100-41-4		< 1.0	< 1.0
Dichloromethane	00075-09-2		< 0.50	< 0.50
Styrene	00100-42-5		< 1.0	< 1.0
Tetrachloroethene	00127-18-4		<b>5.4</b>	< 0.50
Toluene	00108-88-3		< 1.0	< 1.0
trans-1,2-Dichloroethene	00156-60-5		< 0.50	< 0.50
trans-1,3-Dichloropropene	10061-02-6		< 1.0	< 1.0
Trichloroethylene	00079-01-6		<b>84.6</b>	< 0.50
Trichlorotrifluoroethane (Freon 113)	00076-13-1		<b>0.72</b>	< 0.50
Vinyl Chloride	00075-01-4		< 0.50	< 0.50
Xylene-o	00095-47-6		< 1.0	< 1.0
Xylene-m,p	179601-23-1		< 1.0	< 1.0
<b>Total VOCs<sup>(4)</sup></b>			<b>103.6</b>	<b>ND</b>
<b>1,4-Dioxane<sup>(3)</sup></b>			<b>4.4</b>	<b>5.6</b>

Notes and abbreviations on last page.

Table 2  
Concentrations of Constituents in Remedial Wells and  
Treatment System Effluents  
First Quarter 2021<sup>(1)</sup> Reporting Period  
Operable Unit 2  
Northrop Grumman  
Bethpage, New York



**Notes and Abbreviations:**

- (1) Quarterly reporting period: January 01, 2021 through March 31, 2021.
- (2) Results for the program are validated at 20% frequency, per protocols specified in OU2 Groundwater Monitoring Plan (Arcadis 2016).
- (3) VOC samples analyzed using USEPA Method 8260C. 1,4-Dioxane samples analyzed using USEPA Method 8270D-SIM.
- (4) TVOC concentrations are rounded to the number of decimal places of the individual VOC with the least numerical precision (decimal place), including whole numbers with no decimal place.

<b>1.5</b>	Bold value indicates a detection
< 1.0	Compound is not detected above its laboratory quantification limit
µg/L	micrograms per liter
ND	Not detected
J	Constituent value is estimated
OU2	Operable Unit 2
REP	Blind Replicate Sample
USEPA	United States Environmental Protection Agency
VOC	Volatile Organic Compound

**Table 3A**  
**Vapor Sample Analytical Results**  
**Tower 96 Treatment System**  
**First Quarter 2021<sup>(1)</sup> Reporting Period**  
**Operable Unit 2**  
**Northrop Grumman**  
**Bethpage, New York**



<b>Constituents</b> <b>(Units in µg/m<sup>3</sup>)</b>	<b>Location ID:</b> <b>Sample ID:</b> <b>Sample Date:</b>	<b>96 INFLUENT</b> <b>T96 INFLUENT (AA)</b> <b>3/16/2021</b>	<b>96 MID-EFFLUENT</b> <b>T96 MIDTRAIN (AA)</b> <b>3/16/2021</b>	<b>96 EFFLUENT</b> <b>T96 EFFLUENT (AA)</b> <b>3/16/2021</b>
<b><u>Volatile Organic Compounds (VOCs)<sup>(2)</sup></u></b>	<b>CAS #</b>			
1,1,1-Trichloroethane	00071-55-6	<b>10</b>	<b>5.2</b>	< 0.44
1,1,2,2-Tetrachloroethane	00079-34-5	< 0.55	< 0.55	< 0.55
1,1,2-Trichloroethane	00079-00-5	<b>1.8</b>	< 0.44	< 0.44
1,1-Dichloroethane	00075-34-3	<b>26</b>	<b>16</b>	< 0.65
1,1-Dichloroethene	00075-35-4	<b>74.1</b>	<b>50.0</b>	<b>0.34</b>
1,2-Dichloroethane	00107-06-2	<b>1.7</b>	<b>0.85</b>	< 0.65
1,2-Dichloropropane	00078-87-5	<b>61.9</b>	<b>20</b>	< 0.74
Benzene	00071-43-2	<b>128</b>	<b>22</b>	<b>5.1</b>
Bromodichloromethane	00075-27-4	< 0.54	< 0.54	< 0.54
Bromoform	00075-25-2	< 0.33	< 0.33	< 0.33
Bromomethane	00074-83-9	< 0.62	< 0.62	< 0.62
Carbon Disulfide	00075-15-0	< 0.50	< 0.50	<b>0.24 J</b>
Carbon Tetrachloride	00056-23-5	<b>2.5</b>	<b>1.3</b>	< 0.20
Chlorobenzene	00108-90-7	<b>0.97</b>	< 0.74	< 0.74
Chloroethane	00075-00-3	<b>2.1</b>	<b>1.6</b>	<b>1.4</b>
Chloroform	00067-66-3	<b>11</b>	<b>6.3</b>	< 0.78
Chloromethane	00074-87-3	<b>0.99</b>	<b>1.2</b>	<b>1.6</b>
cis-1,2-Dichloroethene	00156-59-2	<b>115</b>	<b>69.4</b>	<b>3.3</b>
cis-1,3-Dichloropropene	10061-01-5	< 0.73	< 0.73	< 0.73
Dibromochloromethane	00124-48-1	< 0.68	< 0.68	< 0.68
Ethylbenzene	00100-41-4	<b>0.48 J</b>	< 0.69	<b>1.3</b>
Dichloromethane	00075-09-2	<b>0.59</b>	<b>0.59</b>	<b>9.7</b>
Styrene	00100-42-5	<b>0.43 J</b>	< 0.68	< 0.68
Tetrachloroethene	00127-18-4	<b>705</b>	<b>203</b>	<b>8.1</b>
Toluene	00108-88-3	<b>2.9</b>	<b>0.79</b>	<b>11</b>
trans-1,2-Dichloroethene	00156-60-5	<b>1.4</b>	<b>0.87</b>	< 0.63
trans-1,3-Dichloropropene	10061-02-6	< 0.73	< 0.73	< 0.73
Trichloroethylene	00079-01-6	<b>13,500</b>	<b>5,320</b>	<b>34</b>
Trichlorotrifluoroethane (Freon 113)	00076-13-1	<b>64</b>	<b>35</b>	< 0.61
Vinyl Chloride	00075-01-4	<b>20</b>	<b>16</b>	<b>11</b>
Xylene-o	00095-47-6	< 0.69	< 0.69	<b>0.83</b>
Xylene-m,p	179601-23-1	<b>0.52 J</b>	<b>0.33 J</b>	<b>3.2</b>
<b>Total VOCs<sup>(3)</sup></b>		<b>14,731</b>	<b>5,770</b>	<b>91<sup>(4)</sup></b>

Notes and abbreviations on last page.

**Table 3A  
Vapor Sample Analytical Results,  
Tower 96 Treatment System,  
First Quarter 2021<sup>(1)</sup> Reporting Period  
Operable Unit 2  
Northrop Grumman  
Bethpage, New York**



**Notes and Abbreviations:**

- (1) Quarterly reporting period: January 01, 2021 through March 31, 2021.
- (2) Vapor samples collected by Arcadis on the dates shown and submitted to a NYSDOH ELAP certified laboratory for VOC analyses per Modified USEPA Method TO-15.
- (3) TVOC concentrations are rounded to the number of decimal places of the individual VOC with the least numerical precision (decimal place), including whole numbers with no decimal place.
- (4) GAC within the supplemental GAC beds was replaced on March 3, 2021.

<b>10</b>	Bold value indicates a detection
< 0.55	Compound is not detected above its laboratory quantification limit.
µg/m <sup>3</sup>	micrograms per cubic meter
J	Compound detected below its reporting limit; value is estimated.
ELAP	Environmental Laboratory Approval Program
NYSDOH	New York State Department of Health
USEPA	United States Environmental Protection Agency
VOC	Volatile Organic Compound

**Table 3B**  
**Vapor Sample Analytical Results**  
**Tower 102 Treatment System**  
**First Quarter 2021<sup>(1)</sup> Reporting Period**  
**Operable Unit 2**  
**Northrop Grumman**  
**Bethpage, New York**



<b>Constituents</b> <b>(Units in µg/m<sup>3</sup>)</b>	<b>Location ID:</b> <b>Sample ID:</b> <b>Sample Date:</b>	<b>102 INFLUENT</b> <b>T102 INFLUENT</b> <b>(AA)</b> <b>2/24/2021</b>	<b>102 EFFLUENT</b> <b>T102 EFFLUENT</b> <b>(AA)</b> <b>2/24/2021</b>
<b><u>Volatile Organic Compounds (VOCs)<sup>(2)</sup></u></b>	<b>CAS #</b>		
1,1,1-Trichloroethane	00071-55-6	<b>6.5 J</b>	< 0.55
1,1,2,2-Tetrachloroethane	00079-34-5	< 14	< 0.69
1,1,2-Trichloroethane	00079-00-5	< 11	< 0.55
1,1-Dichloroethane	00075-34-3	<b>28</b>	<b>13</b>
1,1-Dichloroethene	00075-35-4	<b>52.7</b>	<b>31</b>
1,2-Dichloroethane	00107-06-2	< 16	< 0.81
1,2-Dichloropropane	00078-87-5	<b>11 J</b>	< 0.92
Benzene	00071-43-2	< 13	<b>0.24 J</b>
Bromodichloromethane	00075-27-4	< 13	< 0.67
Bromoform	00075-25-2	< 8.3	< 0.41
Bromomethane	00074-83-9	< 16	< 0.78
Carbon Disulfide	00075-15-0	< 12	< 0.62
Carbon Tetrachloride	00056-23-5	< 5.0	< 0.25
Chlorobenzene	00108-90-7	< 18	< 0.92
Chloroethane	00075-00-3	< 11	< 0.53
Chloroform	00067-66-3	<b>7.8 J</b>	<b>2.0</b>
Chloromethane	00074-87-3	< 8.3	<b>0.91</b>
cis-1,2 Dichloroethene	00156-59-2	<b>151</b>	<b>17</b>
cis-1,3-Dichloropropene	10061-01-5	< 18	< 0.91
Dibromochloromethane	00124-48-1	< 17	< 0.85
Ethylbenzene	00100-41-4	< 17	< 0.87
Dichloromethane	00075-09-2	< 14	<b>4.5</b>
Styrene	00100-42-5	< 17	< 0.85
Tetrachloroethene	00127-18-4	<b>473</b>	<b>1.8</b>
Toluene	00108-88-3	<b>21</b>	<b>1.2</b>
trans-1,2-Dichloroethene	00156-60-5	< 16	<b>0.30 J</b>
trans-1,3-Dichloropropene	10061-02-6	< 18	< 0.91
Trichloroethylene	00079-01-6	<b>2,890</b>	<b>13</b>
Trichlorotrifluoroethane (Freon 113)	00076-13-1	<b>39</b>	<b>19</b>
Vinyl Chloride	00075-01-4	< 2.0	< 0.10
Xylene-o	00095-47-6	< 17	< 0.87
Xylene-m,p	179601-23-1	<b>23</b>	<b>0.87</b>
<b>Total VOCs<sup>(3)</sup></b>		<b>3,703</b>	<b>105</b>

Notes and abbreviations on last page.

Table 3B  
Vapor Sample Analytical Results  
Tower 102 Treatment System  
First Quarter 2021<sup>(1)</sup> Reporting Period  
Operable Unit 2  
Northrop Grumman  
Bethpage, New York



**Notes and Abbreviations:**

- (1) Quarterly reporting period: January 01, 2021 through March 31, 2021.
- (2) Vapor samples collected by Arcadis on the dates shown and submitted to a NYSDOH ELAP certified laboratory for VOC analyses per Modified USEPA Method TO-15.
- (3) TVOC concentrations are rounded to the number of decimal places of the individual VOC with the least numerical precision (decimal place), including whole numbers with no decimal place.

<b>28.0</b>	Bold value indicates a detection
< 11	Compound is not detected above its laboratory quantification limit.
µg/m <sup>3</sup>	micrograms per cubic meter
J	Compound detected below its reporting limit; value is estimated.
ELAP	Environmental Laboratory Approval Program
NYSDOH	New York State Department of Health
USEPA	United States Environmental Protection Agency
VOC	Volatile Organic Compound



Table 4A  
 Summary of AERMOD Air Quality Impact Analysis  
 Tower 96 Treatment System  
 First Quarter 2021<sup>(1)</sup> Reporting Period  
 Operable Unit 2  
 Northrop Grumman  
 Bethpage, New York

Constituents	CAS#	T96 Effluent (ug/m <sup>3</sup> ) <sup>(6)</sup>	Emission Rate <sup>(2)</sup>			Scaled Impact - Hourly <sup>(3)</sup>	Scaled Impact - Annual <sup>(3)</sup>	SGC <sup>(4)</sup>	AGC <sup>(4)</sup>	%SGC	% AGC
		3/16/2021	lb/yr	lb/hr	g/s	(ug/m <sup>3</sup> )	(ug/m <sup>3</sup> )	(ug/m <sup>3</sup> )	(ug/m <sup>3</sup> )		
1,1 - Dichloroethene	00075-35-4	<b>0.34</b>	0.06	6.34E-06	7.99E-07	1.18E-04	3.47E-06	--	200.0	--	0.00%
Tetrachloroethene	00127-18-4	<b>8.1</b>	1.32	1.51E-04	1.90E-05	2.82E-03	8.27E-05	300	4.0	0.00%	0.00%
Trichloroethene <sup>(5)</sup>	00079-01-6	<b>34</b>	5.56	6.34E-04	7.99E-05	1.18E-02	3.47E-04	20	0.2	0.06%	0.17%
Vinyl Chloride <sup>(5)</sup>	00075-01-4	<b>11</b>	1.80	2.05E-04	2.59E-05	3.83E-03	1.12E-04	180,000	0.1	0.00%	0.10%
cis-1,2-Dichloroethene	00156-59-2	<b>3.3</b>	0.54	6.16E-05	7.76E-06	1.15E-03	3.37E-05	--	63.0	--	0.00%
Benzene <sup>(5)</sup>	00071-43-2	<b>5.1</b>	0.83	9.51E-05	1.20E-05	1.77E-03	5.21E-05	1,300	0.1	0.00%	0.04%
Toluene	00108-88-3	<b>11</b>	1.80	2.05E-04	2.59E-05	3.83E-03	1.12E-04	37,000	5,000.0	0.00%	0.00%
Total Xylene	01330-20-7	<b>4.03</b>	0.64	7.28E-05	9.17E-06	1.36E-03	3.98E-05	37000	5,000.0	0.00%	0.00%
Xylene-o	01330-20-7	<b>0.83</b>	0.13	1.50E-05	1.89E-06	2.80E-04	8.20E-06	22,000	100.0	0.00%	0.00%
Xylenes - m,p	01330-20-7	<b>3.2</b>	0.51	5.78E-05	7.28E-06	1.08E-03	3.16E-05	22,000	100.0	0.00%	0.00%
Carbon Disulfide	00078-93-9	<b>0.24 J</b>	0.04	4.48E-06	5.64E-07	8.35E-05	2.45E-06	6200	700.0	0.00%	0.00%
Chloroethane	00075-00-3	<b>1.4</b>	0.23	2.61E-05	3.29E-06	4.87E-04	1.43E-05	--	10,000.0	--	0.00%
Chloromethane	00074-87-3	<b>1.6</b>	0.26	2.98E-05	3.76E-06	5.57E-04	1.63E-05	22,000	90.0	0.00%	0.00%
Dichloromethane	00078-93-19	<b>9.7</b>	1.59	1.81E-04	2.28E-05	3.38E-03	9.91E-05	14,000	60.0	0.00%	0.00%
Ethylbenzene	00078-93-20	<b>1.3</b>	0.21	2.35E-05	2.96E-06	4.38E-04	1.28E-05	--	1,000.0	--	0.00%

See Notes and Abbreviations on last page.



**Table 4A**  
**Summary of AERMOD Air Quality Impact Analysis**  
**Tower 96 Treatment System**  
**First Quarter 2021<sup>(1)</sup> Reporting Period**  
**Operable Unit 2**  
**Northrop Grumman**  
**Bethpage, New York**

**Notes and Abbreviations:**

- (1) Quarterly reporting period: January 01, 2021 through March 31, 2021.
- (2) Emission rate calculated based on effluent concentration and a stack air flow rate of 4,946 acfm. The stack air flow rate (in acfm) is taken from the actual stack air flow rate on 3/16/2021. Effluent temperature used in the model was 92°F from direct read in-line gauge.  
 Trichloroethene (lb/hr) = (Trichloroethene ug/m3) x (4,946 ft3/min) x (1 m3/35 ft3) x (60 min/hr) x (0.000001 g/1 ug) x (0.0022 lb/g)  
 lb/yr = lb/hr x 8,760 hrs/yr  
 g/s = lb/hr x 1 hr/3,600 sec x 453.59 g/1 lb
- (3) Ambient impact based on AERMOD modeling using normalized rate of 1 g/s is scaled to the actual emission rate of the pollutant. Modeling was performed using the representative meteorological data from the nearest station (Farmingdale, NY) for the years 2011 through 2015, and a stack which is 55 feet high and 20 inches in diameter. The maximum impact from all the years was used for the calculations.  
 Scaled hourly impact (ug/m3) = AERMOD predicted hourly ambient impact at 1 g/s ([ug/m3]/[g/s]) x Actual emission rate (g/s)  
 Scaled annual impact (ug/m3) = AERMOD predicted annual ambient impact at 1 g/s ([ug/m3]/[g/s]) x Actual emission rate (g/s)

AERMOD Normalized Ambient Impact at 1 g/s	
Hourly ([ug/m <sup>3</sup> ]/[g/s])	Annual ([ug/m <sup>3</sup> ]/[g/s])
148.05	4.35

- (4) Short-term and annual guideline concentrations for air toxic pollutants specified in the NYSDEC DAR-1 AGC/SGC tables revised August 10, 2016.
- (5) Vinyl Chloride and Benzene potential emission rates are less than 0.1 lb/hr and therefore below the trigger emissions for degree of air cleaning requirement (6 CRR-NY 212-2.3). TCE potential emissions are above the trigger limit and require a 12 month rolling average of annual emission to be maintained (see Table 5A) to demonstrate compliance with the 6 CRR-NY 212-2.2 500 lb/year requirement.
- (6)GAC within the supplemental GAC beds was replaced on March 3, 2021.

--	None Specified
<b>0.34</b>	bold value indicates a detection
acfm	actual cubic feet per minute
g/s	grams per second
µg/m <sup>3</sup>	micrograms per cubic meter
lb/yr	pounds per year
lb/hr	pounds per hour
AGC	Annual Guideline Concentration
CAS #	Chemical Abstracts Service Registry Number
CRR-NY	New York Codes, Rules and Regulations
DAR-1	Division of Air Resources-1
NYSDEC	New York State Department of Environmental Conservation
SGC	Short-term Guideline Concentration



**Table 4B**  
**Summary of AERMOD Air Quality Impact Analysis**  
**Tower 102 Treatment System**  
**First Quarter 2021<sup>(1)</sup> Reporting Period**  
**Operable Unit 2**  
**Northrop Grumman**  
**Bethpage, New York**

Constituents	CAS#	T102 Effluent (ug/m <sup>3</sup> )	Emission Rate <sup>(2)</sup>			Scaled Impact - Hourly <sup>(3)</sup>	Scaled Impact - Annual <sup>(3)</sup>	SGC <sup>(4)</sup>	AGC <sup>(4)</sup>	%SGC	% AGC
		2/24/2021	lb/yr	lb/hr	g/s	(ug/m <sup>3</sup> )	(ug/m <sup>3</sup> )	(ug/m <sup>3</sup> )	(ug/m <sup>3</sup> )		
1,1 - Dichloroethane	00075-34-3	<b>13</b>	3.34	3.82E-04	4.81E-05	1.68E-02	1.10E-04	--	0.6	--	0.02%
1,1 - Dichloroethene	00075-35-4	<b>31.0</b>	7.97	9.10E-04	1.15E-04	4.00E-02	2.62E-04	--	200.0	--	0.00%
Tetrachloroethene	00127-18-4	<b>1.8</b>	0.46	5.28E-05	6.66E-06	2.32E-03	1.52E-05	300	4.0	0.00%	0.00%
Trichloroethene <sup>(5)</sup>	00079-01-6	<b>13</b>	3.34	3.82E-04	4.81E-05	1.68E-02	1.10E-04	20	0.2	0.08%	0.05%
cis-1,2-Dichloroethene	00156-59-2	<b>17</b>	4.37	4.99E-04	6.29E-05	2.19E-02	1.44E-04	--	63.0	--	0.00%
trans-1,2-Dichloroethene	00156-60-5	<b>0.30 J</b>	0.08	8.81E-06	1.11E-06	3.87E-04	2.54E-06	--	63.0	--	0.00%
Benzene <sup>(5)</sup>	00071-43-2	<b>0.24 J</b>	0.06	7.05E-06	8.88E-07	3.10E-04	2.03E-06	1300	0.1	0.00%	0.00%
Toluene	00108-88-3	<b>1.2</b>	0.31	3.52E-05	4.44E-06	1.55E-03	1.01E-05	37000	5,000.0	0.00%	0.00%
Total Xylene	01330-20-7	<b>0.87</b>	0.22	2.55E-05	3.22E-06	1.12E-03	7.35E-06	37000	5,000.0	0.00%	0.00%
Xylenes - M,P	01330-20-7	<b>0.87</b>	0.22	2.55E-05	3.22E-06	1.12E-03	7.35E-06	22000	100.0	0.00%	0.00%
Chloroform	00067-66-3	<b>2.0</b>	1.52	1.73E-04	2.18E-05	7.61E-03	4.99E-05	150	14.7	0.01%	0.00%
Chloromethane	00074-87-3	<b>0.91</b>	0.23	2.67E-05	3.37E-06	1.17E-03	7.69E-06	22,000	90.0	0.00%	0.00%
Dichloromethane	00075-09-2	<b>4.5</b>	1.16	1.32E-04	1.66E-05	5.81E-03	3.80E-05	14,000	60.0	0.00%	0.00%
Trichlorotrifluoroethane (Freon 113)	00076-13-1	<b>19</b>	4.89	5.58E-04	7.03E-05	2.45E-02	1.61E-04	960,000	180,000.0	0.00%	0.00%

See Notes and Abbreviations on last page.



**Table 4B**  
**Summary of AERMOD Air Quality Impact Analysis**  
**Tower 102 Treatment System**  
**First Quarter 2021<sup>(1)</sup> Reporting Period**  
**Operable Unit 2**  
**Northrop Grumman**  
**Bethpage, New York**

**Notes and Abbreviations:**

- (1) Quarterly reporting period: January 01, 2021 through March 31, 2021.
- (2) Emission rate calculated based on effluent concentration and a stack air flow rate of 7,785 cfm. The stack air flow rate (in acfm) is taken from the actual stack air flow rate on 2/24/2021.  
 Effluent temperature used in the model was 80°F from direct read in-line gauge.  
 $\text{Trichloroethene (lb/hr)} = (\text{Trichloroethene ug/m}^3) \times (7,785 \text{ ft}^3/\text{min}) \times (1 \text{ m}^3/35 \text{ ft}^3) \times (60 \text{ min/hr}) \times (0.000001 \text{ g/1 ug}) \times (0.0022 \text{ lb/g})$   
 $\text{lb/yr} = \text{lb/hr} \times 8,760 \text{ hrs/yr}$   
 $\text{g/s} = \text{lb/hr} \times 1 \text{ hr}/3,600 \text{ sec} \times 453.59 \text{ g/1 lb}$
- (3) Ambient impact based on AERMOD modeling using normalized rate of 1 g/s is scaled to the actual emission rate of the pollutant. Modeling was performed using the representative meteorological data from the nearest station (Farmingdale, NY) for the years 2011 through 2015, and a stack which is 69.52 feet high and 24 inches in diameter. The maximum impact from all the years was used for the calculations.  
 $\text{Scaled hourly impact (ug/m}^3) = \text{AERMOD predicted hourly ambient impact at 1 g/s } ([\text{ug/m}^3]/[\text{g/s}]) \times \text{Actual emission rate (g/s)}$   
 $\text{Scaled annual impact (ug/m}^3) = \text{AERMOD predicted annual ambient impact at 1 g/s } ([\text{ug/m}^3]/[\text{g/s}]) \times \text{Actual emission rate (g/s)}$

AERMOD Normalized Ambient Impact at 1 g/s	
Hourly ([ug/m <sup>3</sup> ]/[g/s])	Annual ([ug/m <sup>3</sup> ]/[g/s])
348.85	2.29

- (4) Short-term and annual guideline concentrations for air toxic pollutants specified in the NYSDEC DAR-1 AGC/SGC tables revised August 10, 2016.
- (5) Benzene potential emission rate is less than 0.1 lb/hr and therefore below the trigger emissions for degree of air cleaning requirement (6 CRR-NY 212-2.3). TCE potential emissions are above the trigger limit and require a 12 month rolling average of annual emission to be maintained (see Table 5B) to demonstrate compliance with the 6 CRR-NY 212-2.2 500 lb/year requirement.

--	None Specified
<b>13</b>	bold value indicates a detection
acfm	actual cubic feet per minute
g/s	grams per second
µg/m <sup>3</sup>	micrograms per cubic meter
lb/yr	pounds per year
lb/hr	pounds per hour
AGC	Annual Guideline Concentration
CAS #	Chemical Abstracts Service Registry Number
CRR-NY	New York Codes, Rules and Regulations
DAR-1	Division of Air Resources-1
NYSDEC	New York State Department of Environmental Conservation
SGC	Short-term Guideline Concentration

**Table 5A**  
**Summary of TCE Mass Removal**  
**Tower 96 Treatment System**  
**First Quarter 2021<sup>(1)</sup> Reporting Period**  
**Operable Unit 2**  
**Northrop Grumman**  
**Bethpage, New York**

Date	TCE Concentration ( $\mu\text{g}/\text{m}^3$ ) <sup>(2)</sup>			TCE Mass Emission <sup>(3)</sup>	Percent of Allowable TCE Emissions <sup>(4)</sup>
	T96 INFLUENT	T96 MIDTRAIN	T96 EFFLUENT	(lbs)	12 Month Rolling Average
5/13/2020 <sup>(5)</sup>	5,640	2,350	4,330	90	21.6%
8/19/2020	7,310	4,180	1,550	65.0	34.2%
11/17/2020	19,300 <sup>(6)</sup>	2,190	5,040	196.4	72.9%
3/16/2021	13,500	5,320	34 <sup>(7)</sup>	1.8	70.8%

**Notes and Abbreviations:**

- (1) Quarterly reporting period: January 01, 2021 through March 31, 2021.
- (2) Vapor samples collected by Arcadis on the dates shown and submitted to a NYSDOH ELAP-certified laboratory for VOC analyses per Modified USEPA Method TO-15.
- (3) TCE Mass Emission calculated based on the exhaust air flow rate on the day of sampling and the period of time since the preceding day of sampling.  
 $\text{TCE (lb)} = \text{TCE Concentration } [\mu\text{g}/\text{m}^3] \times \text{Days} \times \text{Flow Rate } [\text{ft}^3/\text{min}] \times (1 \text{ m}^3/35 \text{ ft}^3) \times (60 \text{ min}/\text{hr}) \times (24 \text{ hr}/\text{day}) \times (0.000001 \text{ g}/1 \text{ ug}) \times (0.0022 \text{ lb}/\text{g})$
- (4) Percent of allowable TCE emissions to date is a time-weighted annual rolling average based on the 500 lb/year emission limit specified in the CRR-NY 212-2.2 Table 2. High Toxicity Air Contaminant List, revised April 1, 2017.
- (5) The elevated Second Quarter 2020 effluent vapor-phase contaminant concentrations, compared to prior quarterly sample events were attributed to a malfunctioning steam actuator valve noted at the regenerative vapor-phase granular activated carbon vessels (RVPGAC), which allowed regenerative steam and condensate to partially commingle with system vapor-phase effluent. It should be noted that no SGC or AGC air emission exceedance was associated with this sampling event, and the steam actuator valve was repaired.
- (6) Given that Q4 2020 TCE aqueous-phase influent concentrations are comparable to Q1 through Q3 2020 and prior quarters, it is unclear what caused this elevated vapor-phase concentration. Northrop Grumman inspected the GAC units and determined that they were functional.
- (7) GAC within the supplemental GAC beds was replaced on March 3, 2021.

$\mu\text{g}/\text{m}^3$	micrograms per cubic meter
lbs	pounds
CRR-NY	Codes, Rules and Regulations of the State of New York
ELAP	Environmental Laboratory Approval Program
NS	Not Sampled
NYSDOH	New York State Department of Health
SUP	Supplemental
TCE	Trichloroethylene
USEPA	United States Environmental Protection Agency
VOC	Volatile Organic Compound
VPGAC	vapor phase granular activated carbon

**Table 5B**  
**Summary of TCE Mass Removal**  
**Tower 102 Treatment System**  
**First Quarter 2021<sup>(1)</sup> Reporting Period**  
**Operable Unit 2**  
**Northrop Grumman**  
**Bethpage, New York**

Date	TCE Concentration ( $\mu\text{g}/\text{m}^3$ ) <sup>(2)</sup>		TCE Mass Emission <sup>(3)</sup>		Percentage of Allowable TCE Emissions <sup>(4)</sup>	
	T102 INFLUENT	T102 EFFLUENT	lbs	lbs/day	Period	12 Month Rolling Average
5/13/2020	2,130	17	0.6	0.01	0.9%	1.0%
8/26/2020	3,910	105	7.6	0.07	5.3%	2.2%
12/8/2020	2,130	1,990 <sup>(5)</sup>	147.8	1.42	103.7%	31.4%
2/24/2021	2,890	13	0.7	0.01	0.7%	31.4%

**Notes and Abbreviations:**

- (1) Quarterly reporting period: January 01, 2021 through March 31, 2021.
- (2) Vapor samples collected by Arcadis on the dates shown and submitted to a NYSDOH ELAP-certified laboratory for VOC analyses per Modified USEPA Method TO-15.
- (3) TCE Mass Emission calculated based on the exhaust air flow rate on the day of sampling and the period of time since the preceding sampling day.  
  

$$\text{TCE (lb)} = \text{TCE Concentration } [\mu\text{g}/\text{m}^3] \times \text{Days} \times \text{Flow Rate } [\text{ft}^3/\text{min}] \times (1 \text{ m}^3/35 \text{ ft}^3) \times (60 \text{ min}/\text{hr}) \times (24 \text{ hr}/\text{day}) \times (0.000001 \text{ g}/1 \text{ ug}) \times (0.0022 \text{ lb}/\text{g})$$
- (4) Percent of allowable TCE emissions to date is a time-weighted annual rolling average based on the 500 lb/year emission limit specified in the CRR-NY 212-2.2 Table 2. High Toxicity Air Contaminant List, revised April 1, 2017.
- (5) The elevated effluent vapor-phase contaminant concentrations, compared to prior quarterly sample events, are potentially related to a malfunctioning steam actuator valve noted at the regenerative vapor-phase granular activated carbon vessels (RVPGAC), which may have allowed regenerative steam and condensate to partially commingle with system vapor-phase effluent. It should be noted that no SGC or AGC air emission exceedance were noted associated with this sampling event, and the steam actuator valve has since been repaired. Arcadis will closely monitor contaminant concentrations during future sampling events.

$\mu\text{g}/\text{m}^3$	Micrograms per cubic meter
lbs	Pounds
ELAP	Environmental Laboratory Approval Program
NYSDOH	New York State Department of Health
TCE	Trichloroethene
USEPA	United States Environmental Protection Agency
VOC	Volatile Organic Compound

**Table 6**  
**Concentrations of Volatile Organic Compounds**  
**and 1,4-Dioxane in Monitoring Wells**  
**First Quarter 2021<sup>(1)</sup> Reporting Period**  
**Operable Unit 2,**  
**Northrop Grumman**  
**Bethpage, New York**



<b>Constituents</b>	<b>Location ID: Sample ID: Sample Date:</b>	<b>BPOW 2-1 <sup>(2)</sup> BPOW 2-1 3/8/2021</b>	<b>BPOW 2-2 <sup>(2)</sup> BPOW 2-2 3/8/2021</b>	<b>BPOW 2-3 <sup>(2)</sup> BPOW 2-3 3/8/2021</b>	<b>GM-21D2 GM-21D2 3/8/2021</b>
<b>Units (µg/L)</b>					
<b><u>Volatile Organic Compounds (VOCs) <sup>(3,4)</sup></u></b>					
1,1,1-Trichloroethane		< 0.50	< 0.50	< 0.50	< 1.0
1,1,2,2-Tetrachloroethane		< 0.50	< 0.50	< 0.50	< 1.0
1,1,2-trichloro-1,2,2-trifluoroethane (Freon 113)		< 1.0	< 1.0	< 1.0	< 5.0
1,1,2-Trichloroethane		< 0.50	< 0.50	< 0.50	< 1.0
1,1-Dichloroethane		< 0.50	< 0.50	< 0.50	< 1.0
1,1-Dichloroethene		< 0.50	< 0.50	< 0.50	< 1.0
1,2-Dichloroethane		< 0.50	< 0.50	< 0.50	< 1.0
1,2-Dichloropropane		< 0.50	< 0.50	< 0.50	< 1.0
2-Butanone (MEK)		< 5.0	< 5.0	< 5.0	< 10
2-Hexanone		< 2.0	< 2.0	< 2.0	< 5.0
4-methyl-2-pentanone (MIK)		< 2.0	< 2.0	< 2.0	< 5.0
Acetone		< 5.0	< 5.0	< 5.0	< 10
Benzene		< 0.50	< 0.50	< 0.50	< 0.50
Bromodichloromethane		< 0.50	< 0.50	< 0.50	< 1.0
Bromoform		< 0.50	< 0.50	< 0.50	< 1.0
Bromomethane		< 0.50	< 0.50	< 0.50	< 2.0
Carbon Disulfide		< 0.50	< 0.50	< 0.50	< 2.0
Carbon tetrachloride		< 0.50	< 0.50	< 0.50	< 1.0
Chlorobenzene		< 0.50	< 0.50	< 0.50	< 1.0
Chloroethane		< 0.50	< 0.50	< 0.50	< 1.0
Chloroform		< 0.50	< 0.50	< 0.50	< 1.0
Chloromethane		< 0.50	< 0.50	< 0.50	< 1.0
cis-1,2-dichloroethene		< 0.50	< 0.50	< 0.50	< 1.0
cis-1,3-dichloropropene		< 0.50	< 0.50	< 0.50	< 1.0
Dibromochloromethane		< 0.50	< 0.50	< 0.50	< 1.0
Ethylbenzene		< 0.50	< 0.50	< 0.50	< 1.0
Methylene Chloride		< 0.50	< 0.50	< 0.50	< 2.0
Styrene		< 0.50	< 0.50	< 0.50	< 1.0
Tetrachloroethene		< 0.50	< 0.50	< 0.50	< 1.0
Toluene		< 0.50	< 0.50	< 0.50	< 1.0
trans-1,2-dichloroethene		< 0.50	< 0.50	< 0.50	< 1.0
trans-1,3-dichloropropene		< 0.50	< 0.50	< 0.50	< 1.0
Trichloroethylene		< 0.50	< 0.50	< 0.50	<b>5.6</b>
Vinyl Chloride		< 0.50	< 0.50	< 0.50	< 1.0
Xylene-o		< 0.50	< 0.50	< 0.50	< 1.0
Xylenes - m,p		< 0.50	< 0.50	< 0.50	< 1.0
<b>Total VOCs <sup>(5)</sup></b>		ND	ND	ND	<b>5.6</b>
<b>1,4-Dioxane <sup>(3,4)</sup></b>		<b>0.705 J</b>	<b>0.716</b>	<b>2.89</b>	<b>4.5</b>

See last page for Notes and Abbreviations.

**Table 6**  
**Concentrations of Volatile Organic Compounds**  
**and 1,4-Dioxane in Monitoring Wells**  
**First Quarter 2021<sup>(1)</sup> Reporting Period**  
**Operable Unit 2,**  
**Northrop Grumman**  
**Bethpage, New York**




**Notes and Abbreviations:**

- (1) Quarterly reporting period: January 01, 2021 through March 31, 2021.
- (2) These outpost wells have been repurposed for use as plume monitoring wells per the June 2015 Groundwater Monitoring Plan Addendum (ARCADIS of New York, Inc., 2015), as conditionally approved by the NYSDEC (August 25, 2015). Therefore, TVOC trigger levels that may have been previously established are no longer shown.
- (3) BPOW samples were analyzed for VOCs using USEPA Method 524.2, and 1,4-dioxane using USEPA Method 522. GM-21D2 sample was analyzed for VOCs by USEPA Method 8260C and 1,4-dioxane using USEPA Method 8270D SIM.
- (4) Results for the program are validated at 20% frequency, per protocols specified in the OU2 Groundwater Monitoring Plan (Arcadis 2016).
- (5) TVOC concentrations are rounded to the number of decimal places of the individual VOC with the least numerical precision (decimal place), including whole numbers with no decimal place.

<b>5.6</b>	Bold value indicates a detection
VOC	Volatile Organic Compound
ND	Not detected
µg/L	micrograms per liter
J	Compound detected below its reporting limit; value is estimated
<0.5	Compound not detected above its laboratory quantification limit


# Figures

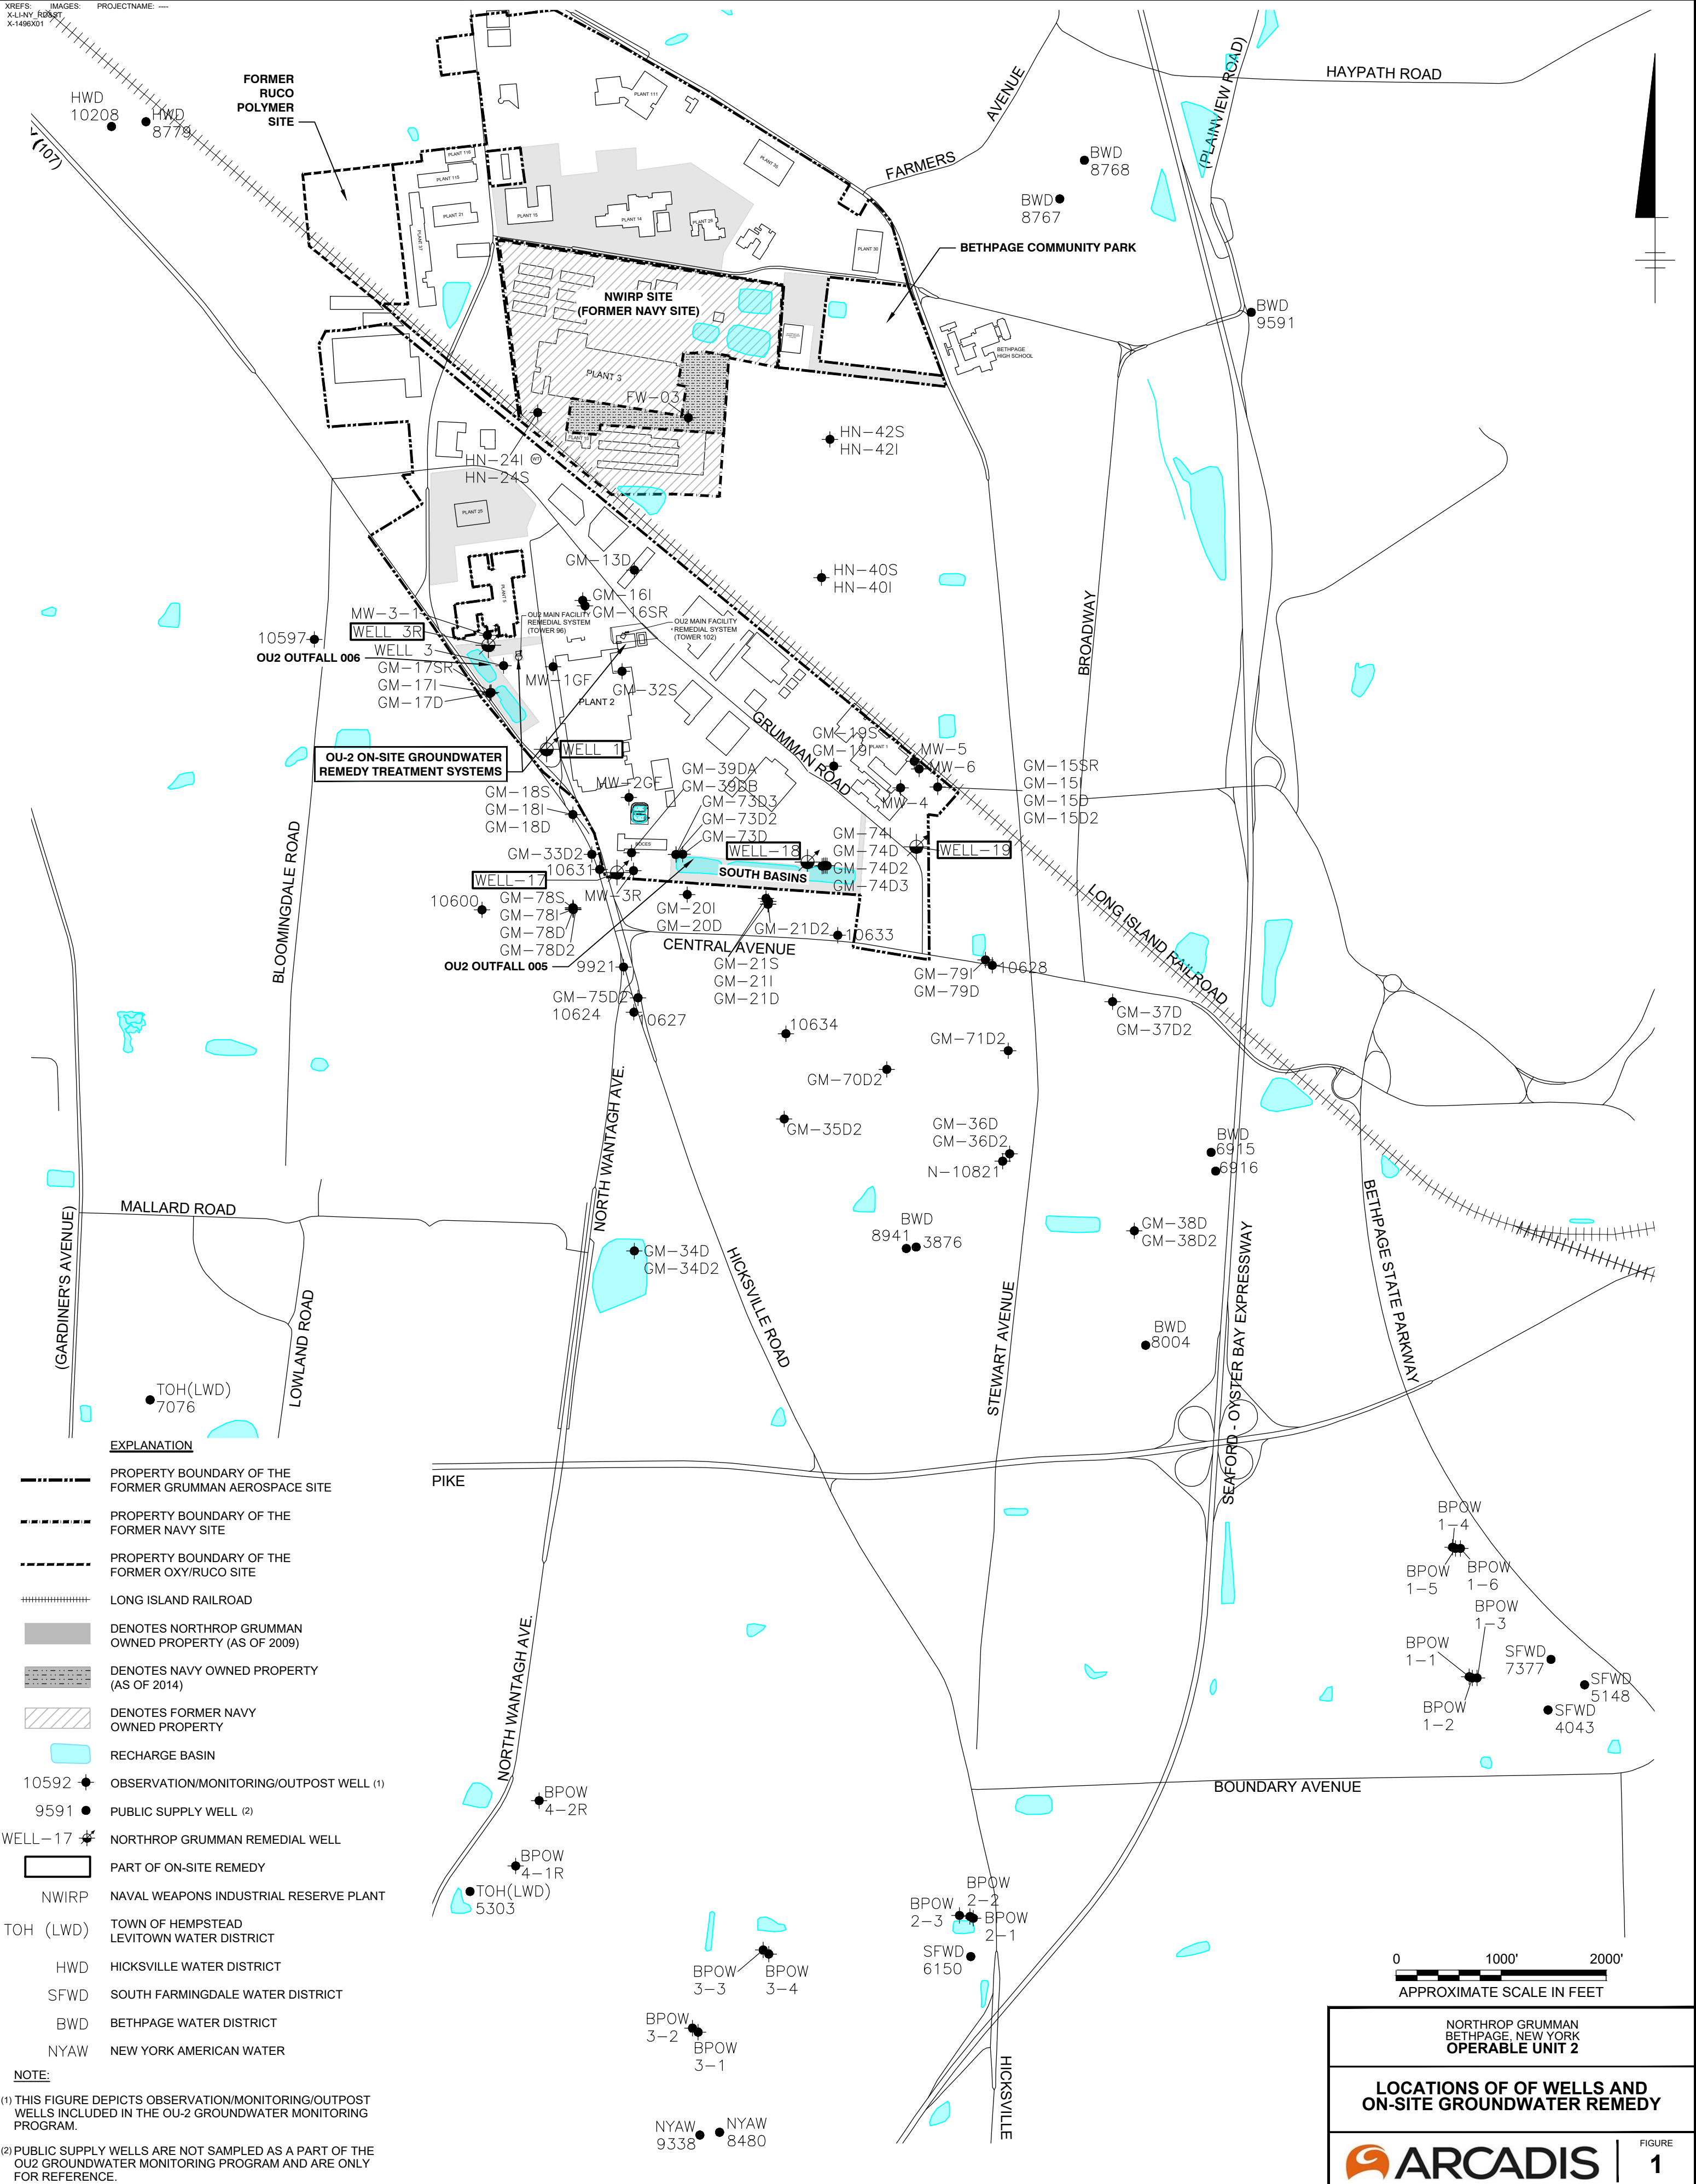

**EXPLANATION**

- PROPERTY BOUNDARY OF THE FORMER GRUMMAN AEROSPACE SITE
- PROPERTY BOUNDARY OF THE FORMER NAVY SITE
- PROPERTY BOUNDARY OF THE FORMER OXY/RUCO SITE
- ==== LONG ISLAND RAILROAD
- DENOTES NORTHROP GRUMMAN OWNED PROPERTY (AS OF 2009)
- DENOTES NAVY OWNED PROPERTY (AS OF 2014)
- ▨ DENOTES FORMER NAVY OWNED PROPERTY
- RECHARGE BASIN
- 10592 ● OBSERVATION/MONITORING/OUTPOST WELL (1)
- 9591 ● PUBLIC SUPPLY WELL (2)
- WELL-17 ● NORTHROP GRUMMAN REMEDIAL WELL
- ▭ PART OF ON-SITE REMEDY
- NWIRP NAVAL WEAPONS INDUSTRIAL RESERVE PLANT
- TOH (LWD) TOWN OF HEMPSTEAD LEVITOWN WATER DISTRICT
- HWD HICKSVILLE WATER DISTRICT
- SFWD SOUTH FARMINGDALE WATER DISTRICT
- BWD BETHPAGE WATER DISTRICT
- NYAW NEW YORK AMERICAN WATER

**NOTE:**  
 (1) THIS FIGURE DEPICTS OBSERVATION/MONITORING/OUTPOST WELLS INCLUDED IN THE OU-2 GROUNDWATER MONITORING PROGRAM.  
 (2) PUBLIC SUPPLY WELLS ARE NOT SAMPLED AS A PART OF THE OU2 GROUNDWATER MONITORING PROGRAM AND ARE ONLY FOR REFERENCE.



NORTHROP GRUMMAN  
 BETHPAGE, NEW YORK  
**OPERABLE UNIT 2**


**LOCATIONS OF OF WELLS AND  
 ON-SITE GROUNDWATER REMEDY**

FIGURE  
**1**



CITY:SYRACUSE,NY DIV:GROUPE/FENY DBA:SANJHEZ LD:ALS PC:(C)1 PLM:(R)1 TH:(C)1 LVR:(G)10N1-CFC-REF: C:\Users\schilling\OneDrive\Documents\Projects\Northrop Grumman\Project Files\OU2 ONCT ONCT-GW-ETS-SITEPLAN.dwg LAYOUT: 2 SAVED: 5/26/2021 4:29 PM ACADVER: 24.08 (ANSI TECH) PAGESETUP: --- PLOTTED: 5/26/2021 4:29 PM BY: SCHILLING, ADAM

XREFS: IMAGES: PROJECTNAME: ---  
 XBD:R-BL  
 X-LANT:RD&ST  
 X-NG:GW-PIPE

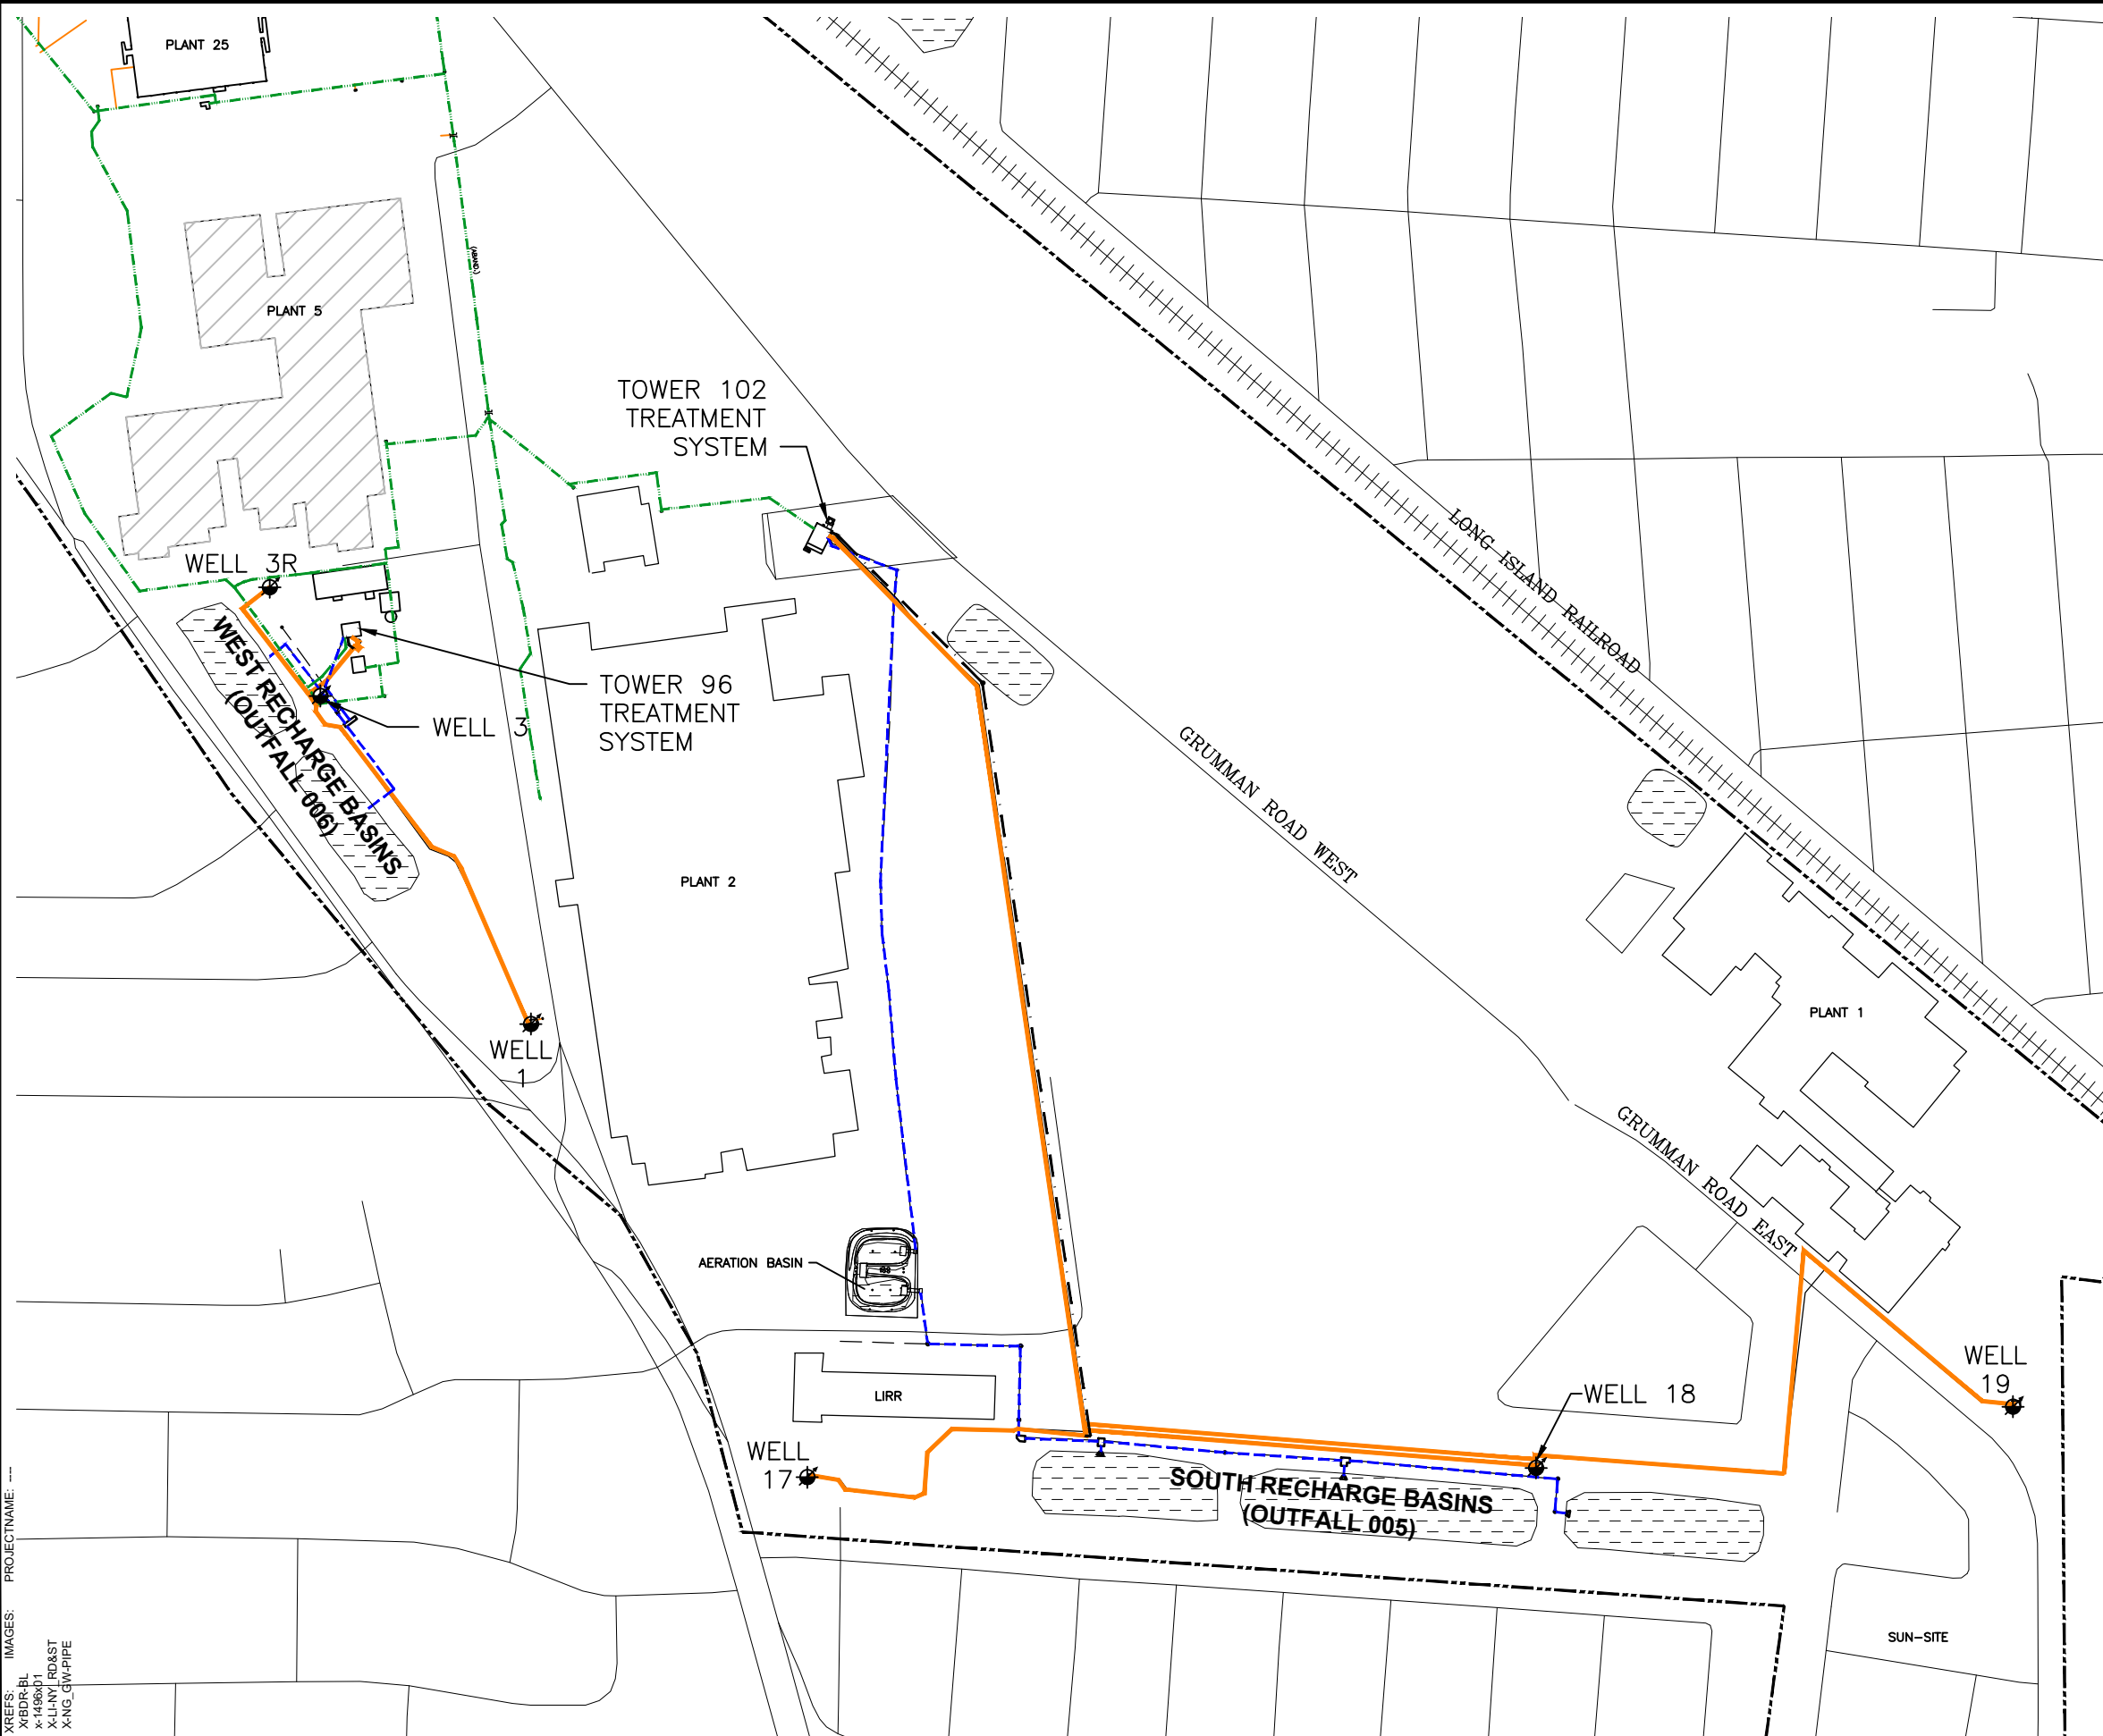

**LEGEND:**

- FORMER NORTHROP GRUMMAN PROPERTY LINE
- INFLUENT LINE
- - - - - BYPASS
- STORM DRAIN (EFFLUENT)
- NON POTABLE WATER DISTRIBUTION LINE (EFFLUENT)
- + + + + + RAILROAD TRACKS
- x - x - FENCE
- WELL 18 REMEDIAL WELL
- BASIN
- ONCT ON-SITE CONTAMINANT

**NOTES:**


1. DRAWING IS NOT TO BE USED FOR DESIGN PURPOSES. LAYOUT OF PIPING IS FOR REPRESENTATION ONLY (LOCATIONS ARE APPROXIMATE).
2. THE PIPING REPRESENTED IN THIS DRAWING MAY BE CONSTRUCTED OF CAST IRON PIPE (CIP), DUCTILE IRON PIPE (DIP), ASBESTOS CEMENT PIPE (ACP) OR TRANSITE, OR A COMBINATION OF THESE PIPE TYPES.

NORTHROP GRUMMAN SYSTEMS CORPORATION  
 BETHPAGE, NEW YORK  
**OPERABLE UNIT 2**


**ONCT GROUNDWATER  
 EXTRACTION AND TREATMENT  
 SYSTEM SITE PLAN**

**ARCADIS** | **FIGURE 2**

# TOWER 96 TREATMENT SYSTEM:

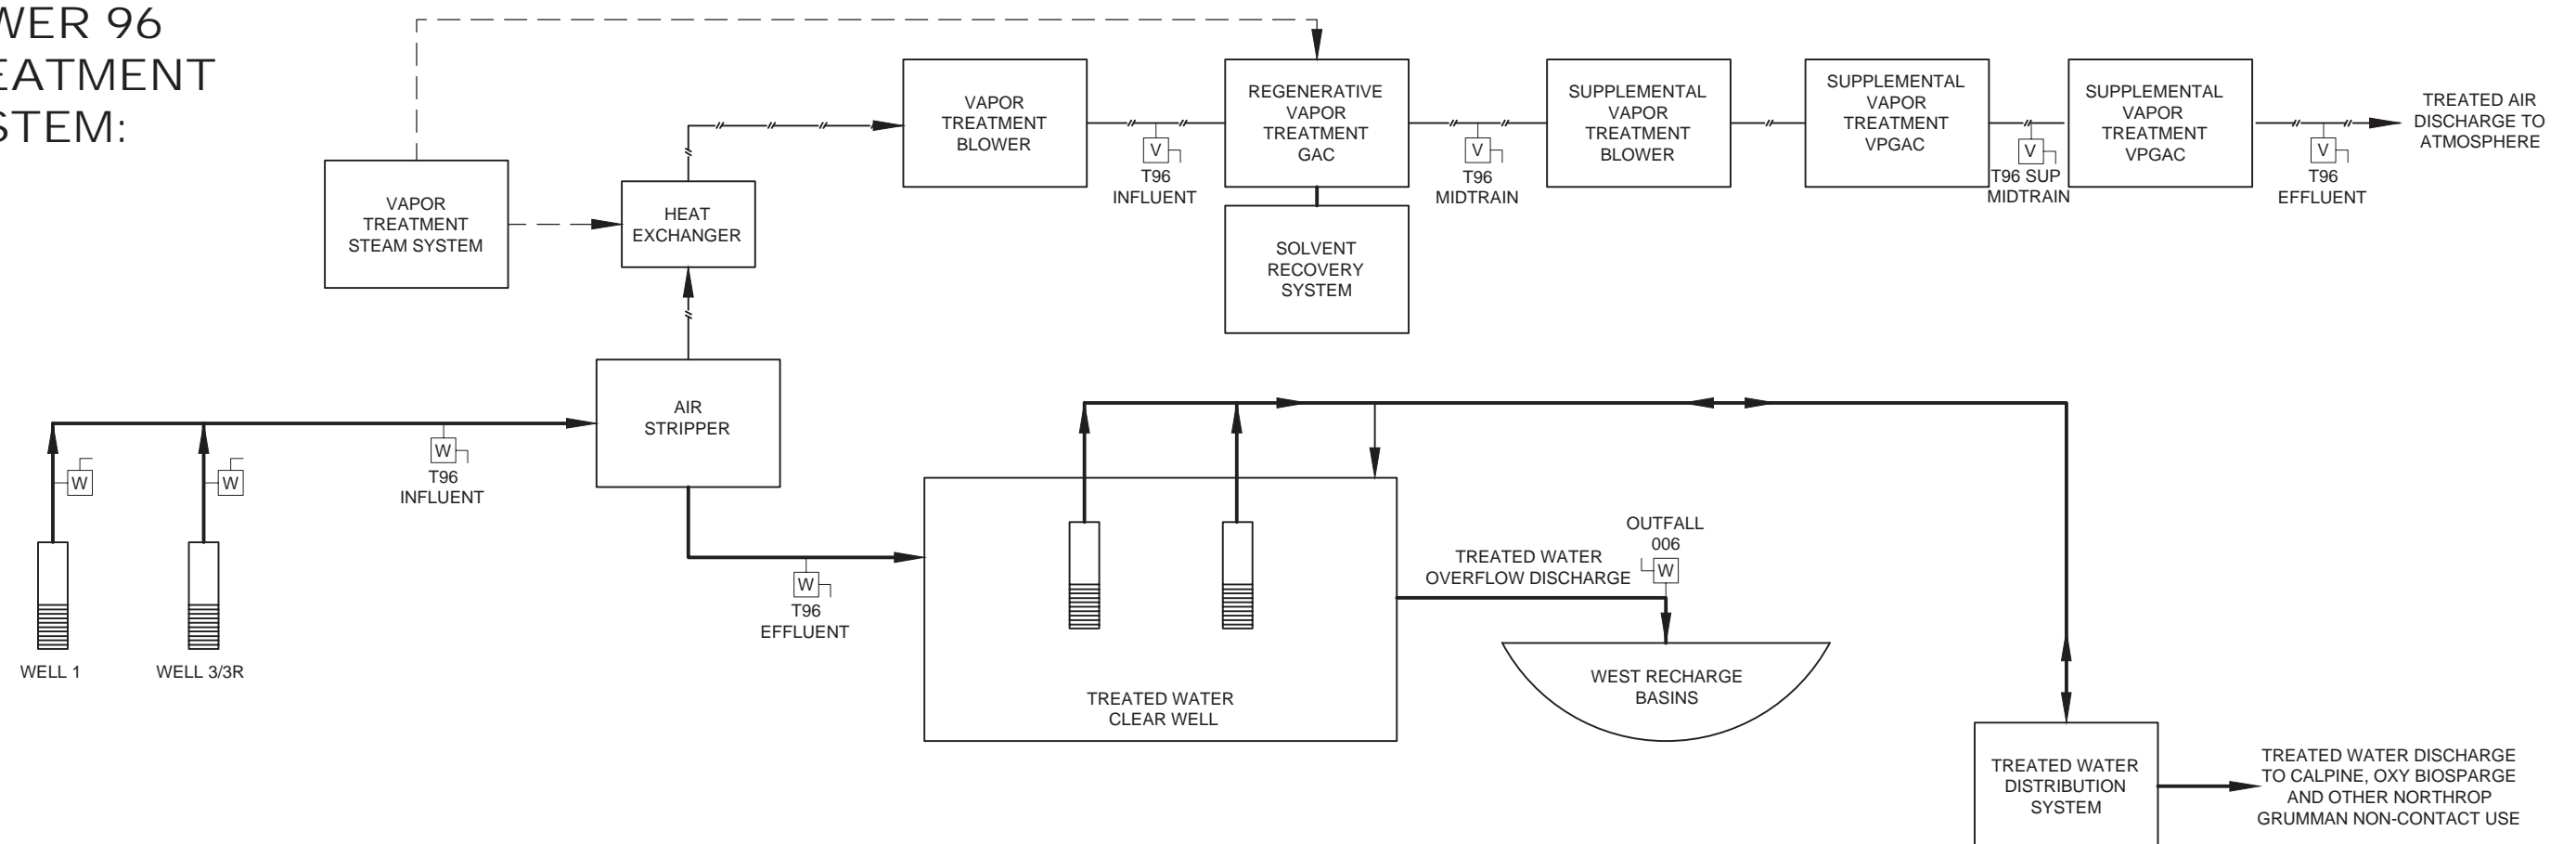

# TOWER 102 TREATMENT SYSTEM:

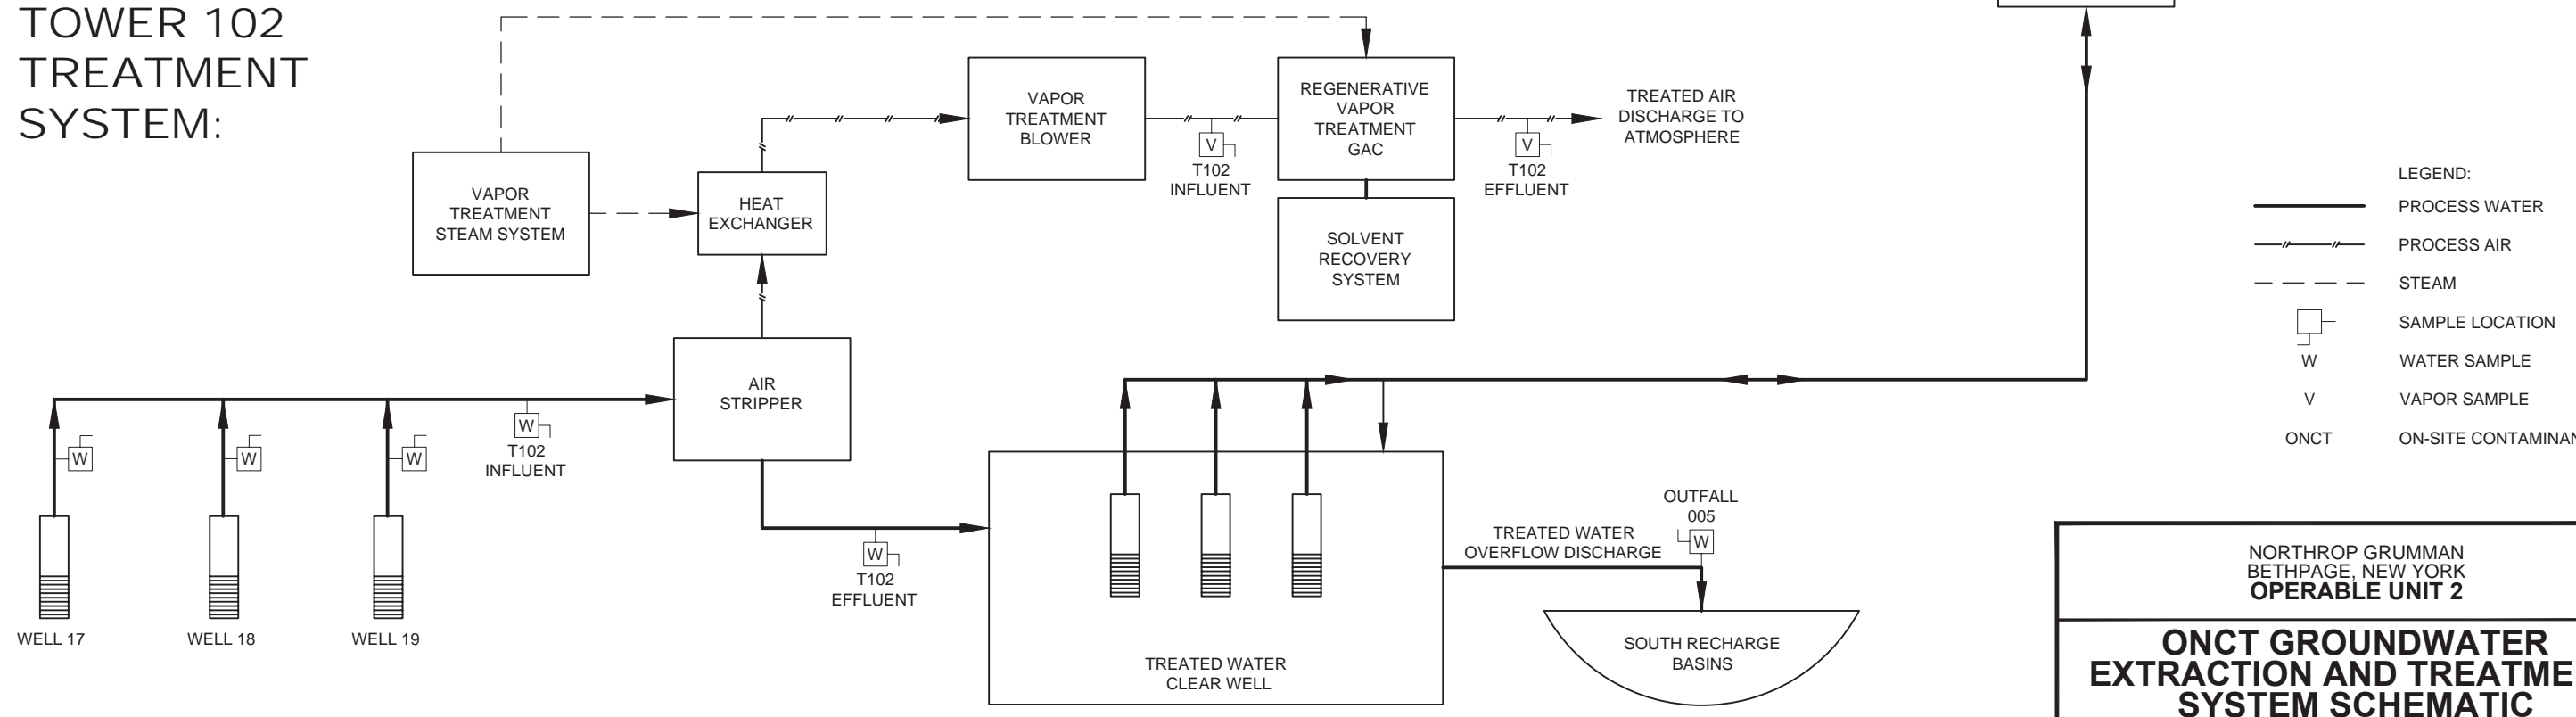

- LEGEND:
- PROCESS WATER
  - - - PROCESS AIR
  - - - - STEAM
  - W SAMPLE LOCATION
  - W WATER SAMPLE
  - V VAPOR SAMPLE
  - ONCT ON-SITE CONTAMINANT

NORTHROP GRUMMAN  
BETHPAGE, NEW YORK  
**OPERABLE UNIT 2**

**ONCT GROUNDWATER  
EXTRACTION AND TREATMENT  
SYSTEM SCHEMATIC**

**ARCADIS** | FIGURE 3

CITY: SYRACUSE, NY DIV: GROUP ENV DB: A. SANCHEZ LD: ALS PIC: (Regd) TM: (Opt) LYR: (Opt) ON: -OFF-REF\* (PATRICIA RICHE PDF CHANGES SUP BED TEXT and extra VSP-10.26.17)  
 G:\ENV\CAD\SYRACUSE\ACT\NY0014961414\G\MMH14961414\F03.dwg LAYOUT: 3 SAVED: 3/15/2016 10:09 AM ACADVER: 19.1 S (LMS TECH) PAGES: 3 PLOT STYLE: PLT: FULL.CTB PLOTTED: 3/15/2016 10:30 AM BY: SANCHEZ, ADRIAN  
 XREFS: IMAGES: PROJECTNAME: