

**Quarterly Operations Report  
Third Quarter 2016**

**Groundwater Treatment Plant  
GM-38 Area Groundwater Remediation  
Naval Weapons Industrial Reserve Plant  
Bethpage, New York**

**Contract No. N40085-10-D-9409  
Contract Task Order No. 0002**

January 2017

Prepared for:



Naval Facilities Engineering Command Mid-Atlantic  
9324 Virginia Avenue  
Norfolk, VA 23511

Prepared by:



**KOMAN Government Solutions, LLC  
160 East Main Street, Suite 2F  
Westborough, Massachusetts 01581  
(508) 366-7442**

**Quarterly Operations Report  
Third Quarter 2016**

**Groundwater Treatment Plant  
GM-38 Area Groundwater Remediation  
Naval Weapons Industrial Reserve Plant  
Bethpage, New York**

**Contract No. N40085-10-D-9409  
Contract Task Order No. 0002**

**January 2017**

Prepared for:

Naval Facilities Engineering Command Mid-Atlantic  
9324 Virginia Avenue  
Norfolk, VA 23511



---

Patrick Schauble  
Program Manager

1/26/17

Date

---

Jennifer Good  
Project Manager

1/26/17

Date

## TABLE OF CONTENTS

<b>1.0</b>	<b>INTRODUCTION.....</b>	<b>1-1</b>
1.1	Background.....	1-1
1.2	GWTP Overview .....	1-2
<b>2.0</b>	<b>GWTP OPERATIONS AND MAINTENANCE.....</b>	<b>2-1</b>
2.1	Routine Maintenance Activities .....	2-1
2.2	Non-routine Maintenance / Site Activities .....	2-1
<b>3.0</b>	<b>GWTP MONITORING.....</b>	<b>3-1</b>
3.1	Process Water Quality Monitoring.....	3-1
3.2	Air Quality Monitoring.....	3-1
3.3	Groundwater Quality Monitoring.....	3-2
3.3.1	Groundwater Quality Results .....	3-3
3.3.2	Quality Assurance/Quality Control Sampling.....	3-3
3.3.3	Groundwater Concentration Trends .....	3-4
<b>4.0</b>	<b>CONCLUSIONS AND RECOMMENDATIONS.....</b>	<b>4-1</b>
<b>5.0</b>	<b>REFERENCES.....</b>	<b>5-1</b>

### **TABLES**

TABLE 1	Discharge Monitoring Results – Third Quarter 2016
TABLE 2	Air Sampling Results – Third Quarter 2016
TABLE 3	Stack Emissions – Third Quarter 2016
TABLE 4	Groundwater Level Measurements – Third Quarter 2016
TABLE 5	Summary of Groundwater Chemistry Results – Third Quarter 2016
TABLE 6	Summary of Groundwater Analytical Results – Third Quarter 2016
TABLE 7	Summary of Historical Groundwater Analytical Results through Third Quarter 2016

### **FIGURES**

FIGURE 1	Site Map
FIGURE 2	Process Flow Diagram
FIGURE 3	GM-38 Area Site Map
FIGURE 4	Third Quarter 2016 Groundwater Analytical Map – Select VOC Concentrations
FIGURE 5	Groundwater Concentrations Trends of Select VOCs – RW-1
FIGURE 6	Groundwater Concentrations Trends of Select VOCs – RW-3
FIGURE 7	Groundwater Concentrations Trends of Select VOCs - RW1-MW1

- FIGURE 8 Groundwater Concentrations Trends of Select VOCs - RW1-MW3
- FIGURE 9 Groundwater Concentrations Trends of Select VOCs - RW2-MW1
- FIGURE 10 Groundwater Concentrations Trends of Select VOCs - RW3-MW1
- FIGURE 11 Groundwater Concentrations Trends of Select VOCs – RW3-MW2
- FIGURE 12 Groundwater Concentrations Trends of Select VOCs – RW3-MW3
- FIGURE 13 Groundwater Concentrations Trends of Select VOCs – RW3-MW4
- FIGURE 14 Groundwater Concentrations Trends of Select VOCs - TP-01

## **APPENDICES**

- APPENDIX A NYSDEC Effluent Limitations and Monitoring Requirements and July 2016 – September 2016 DMRs
- APPENDIX B NYSDEC Air Discharge Limit Documentation
- APPENDIX C Field Logs and Chain of Custody Documentation – Third Quarter 2016
- APPENDIX D Data Validation Reports – Third Quarter 2016

## Acronyms and Abbreviations

ARAR	Applicable or Relevant and Appropriate Requirement
AS	air stripper
ASE	air stripper effluent
BFE	bag filter effluent
bgs	below ground surface
CERCLA	Comprehensive Environmental Response Compensation and Liability Act
DAR	Division of Air Resources
DCA	dichloroethane
DCE	dichloroethene
DMR	Discharge Monitoring Report
DO	dissolved oxygen
DoD	Department of Defense
DTW	depth to water
ECL	Environmental Conservation Law
EB	equipment rinsate blank
ELAP	Environmental Laboratory Accreditation Program
GOCO	Government Owned Contractor Operated
gpm	gallon per minute
GWTP	groundwater treatment plant
KGS	KOMAN Government Solutions, LLC
HMI	human-machine interface
IRP	Installation Restoration Program
LGAC	liquid-phase granular activated carbon
MS/MSD	matrix spike/matrix spike duplicate
NAVFAC	Naval Facilities Engineering Command Mid-Atlantic
Navy	U.S. Department of the Navy
NELAC	National Environmental Accreditation Conference
NG	Northrop Grumman
NWIRP	Naval Weapons Industrial Reserve Plant
NYSDEC	New York State Department of Environmental Conservation
NYSDOH	New York State Department of Health
O&M	Operation and Maintenance
ORP	oxidation reduction potential

OU	operable unit
PCE	tetrachloroethene
PLC	programmable logic controller
QA/QC	quality assurance / quality control
ROD	Record of Decision
RPD	relative percent difference
SC	standard conductivity
scfm	standard cubic feet per minute
SPDES	Storm Pollution Discharge Elimination System
TB	trip blank
TCE	trichloroethene
TE	treated effluent
TSS	total suspended solids
TtEC	Tetra Tech EC, Inc.
USEPA	U.S. Environmental Protection Agency
VGAC	vapor-phase granular activated carbon
VOC	volatile organic compound

## 1.0 INTRODUCTION

KOMAN Government Solutions, LLC (KGS) has prepared this Quarterly Operations Report for the GM-38 Area Groundwater Treatment Plant (GWTP) at the Naval Weapons Industrial Reserve Plant (NWIRP) in Bethpage, New York. This report has been prepared for the U.S. Department of the Navy (Navy), Naval Facilities Engineering Command (NAVFAC), Mid-Atlantic, under Contract No. N40085-10-D-9409, Contract Task Order No. 0002. This Third Quarter 2016 Operations Report details activities that occurred from July to September 2016. Data was collected and operational activities were performed by KGS in accordance with the following documents:

- *Final Operation, Maintenance & Monitoring Plan for Groundwater Treatment Plant GM-38 Area Groundwater Remediation, Naval Weapons Industrial Reserve Plant, Bethpage, New York* prepared by Tetra Tech EC, Inc. (TtEC) in 2010, hereafter referred to as the “O&M Manual.”
- *Final Sampling and Analysis Plan (Field Sampling Plan and Quality Assurance Project Plan), UFP-SAP for Operations, Maintenance, and Monitoring of the Groundwater Treatment Plant, GM-38 Area, Naval Weapons Industrial Reserve Plant, Bethpage, New York* prepared by TtEC in 2010.

### 1.1 Background

NWIRP Bethpage is located in east central Nassau County, Long Island, New York, approximately 30 miles east of New York City (**Figure 1**) and is currently listed by New York State Department of Environmental Conservation (NYSDEC) as an “inactive hazardous waste site” (#1-30-003B). In the late 1990s, the Navy's property totaled approximately 109.5 acres and was a Government Owned Contractor-Operated (GOCO) facility that was operated by Northrop Grumman (NG) until September 1998. NWIRP Bethpage was bordered on the north, west, and south by property owned, or formerly owned, by NG that covered approximately 550 acres, and on the east by a residential neighborhood.

The GM-38 Area refers to a cluster of monitoring wells installed in the 1990s by NG. The GM-38 Area is approximately 8,500 feet south, southeast and hydraulically downgradient of NWIRP Bethpage. The GWTP is located within a utility easement with a street address of 100 Broadway, Bethpage, NY.

The “hot spot” cleanup remedy for the GM-38 Area groundwater was originally set forth in Record of Decision (ROD) documents for Operable Unit 2 (OU 2) Groundwater for the NG and NWIRP Sites (New York State Registry Site Numbers 1-30-003A & 1-30-003B, respectively) issued by NYSDEC Division of Environmental Remediation in March 2001 and for the NWIRP Bethpage Site by NAVFAC in April 2003 (Revision 1). The selected remedy was chosen in accordance with the New York State Environmental Conservation Law (ECL) and the Navy's Installation Restoration Program (IRP). It is also consistent with the Comprehensive Environmental Response Compensation and Liability Act (CERCLA), as amended, 42 U.S.C. §§ 9601-9675.

## 1.2 GWTP Overview

Groundwater is extracted from recovery wells RW-1 and RW-3 (though RW-3 has recently been taken off-line, as described below) and treated in the GWTP. The treatment process consists of flow equalization, air stripping and vapor-phase carbon treatment, bag filtration, and liquid-phase carbon treatment. Though the GWTP was originally equipped with a pH adjustment system utilizing sodium hydroxide, it has since been determined that pH adjustment is not necessary and the equipment has been taken off-line and sodium hydroxide sent off site for beneficial reuse. A process flow diagram is presented as **Figure 2**. The treated water is either re-injected into injection well IW-1 or discharged into the Nassau County Recharge Basin #495. Under CERCLA, the Navy is required to meet the effluent requirement in the NYSDEC's Storm Pollution Discharge Elimination System (SPDES) Permit Application as an Applicable or Relevant and Appropriate Requirement (ARAR).

The GWTP was designed to operate at an average flow rate of 1,100 gallons per minute (gpm) (800 gpm from RW-1 and 300 gpm from RW-3), as measured by the average discharge flow rate. It was determined that this flow rate would be necessary to effectively contain the higher concentration of contamination in the GM-38 Area groundwater. Volatile Organic Compounds (VOCs) in the influent groundwater consist of trichloroethene (TCE), tetrachloroethene (PCE), vinyl chloride, cis-1,2-dichloroethene (cis-1,2-DCE), 1,2-dichloroethane (1,2-DCA), benzene, toluene, and total xylenes.

The air stripper (AS) is a structural aluminum tower that is packed with 3.5-inch diameter polypropylene Jaeger Tripack. Groundwater is pumped to the air stripper distribution port and sprayed over the column of Jaeger Tripack at a flow rate of approximately 1,000 to 1,100 gpm. Previously, 100 gpm of recirculated water was also rerouted through the AS, but as of October 2010, recirculation was no longer deemed necessary to the operation of the system. An induced draft countercurrent flow of air enters the air stripper below the base of the packing material at a rate of 8,000 standard cubic feet per minute (scfm). The large surface area of the packing material allows for a mass transfer of the VOCs from the groundwater into the air stream. The VOCs in the off-gas, except for vinyl chloride, are removed via two 20,000-lb vapor phase granular activated carbon (VGAC) units (VGAC-1 and VGAC-2). Vinyl chloride is oxidized by a 20,000-lb vessel containing zeolite impregnated with potassium permanganate (VGAC-3) into potassium chloride and carbon dioxide. The potassium chloride remains in the pore structure of the zeolite substrate. The treated off-gas is discharged from the stack.

Water treated by the air stripper is subsequently processed through three 8,000-lb liquid phase granular activated carbon (LGAC) units in parallel prior to discharge in the recovery basin (or injection well, if necessary. To date, no water has been discharged to the injection well).

The GWTP is controlled by a programmable logic controller (PLC)-based digital and analog control system, with instrumentation that monitors pH, pressure, tank level, flow transmitters, differential pressure transmitters, water level in recovery wells, and motor operational status. The information in the PLC is made available to an operator via a human-machine interface (HMI) program. By using this program, the status of the GWTP can be displayed in real time and adjusted, if necessary, by the operator.



An evaluation of the GM-38 Area, conducted in order to better determine the capture zone of the recovery wells, recommended that use of recovery well RW-3 be discontinued. The report entitled “*Capture Zone Evaluation and Path Forward, GM-38 Area Groundwater Treatment Plant*” (Tetra Tech 2014) was submitted to NYSDEC in March 2014. The recommended path forward consisted of ceasing operation of recovery well RW-3 and increasing the pumping rate of recovery well RW-1. These system modifications would maintain the existing GWTP pumping rate of 1,000 to 1,100 gpm while maintaining the desired capture zone of the GWTP. Based on modeling results, impacted groundwater that was being captured by RW-3 would now be captured by RW-1 (Tetra Tech 2014). NYSDEC concurred with the implementation of this path forward and associated system modifications on 20 April 2015. On 1 July 2015, in accordance with the approved path forward, recovery well RW-3 was taken off-line. The flowrate of recovery well RW-1 was increased from approximately 800 gpm to approximately 1,000 gpm. Since July 2015, RW-3 has been activated on a monthly basis (for approximately one hour per month at a flowrate of approximately 200 gpm) to maintain operational status and to allow for sampling.

## 2.0 GWTP OPERATIONS AND MAINTENANCE

While designed to run completely automated, the GWTP requires regular visits by an operator to record and adjust operational parameters and to perform scheduled maintenance. The GWTP is equipped with telemetry that will alert an on-call operator in the event of a plant shutdown.

### 2.1 Routine Maintenance Activities

Routine maintenance activities at the GWTP were performed during the operator's visits. These activities include general site inspections, collection of operational data (water and vapor flowrates, differential pressures across the AS, carbon units, bag filter units and blower discharge pressures, tank levels and totalizer readings), measurement of water levels in the recovery wells, adjustment of pump signal settings, collection of vapor and process water samples, changing out of bag filters, switching of lead/lag pump assignments, and preventive maintenance of system equipment.

In addition, the following maintenance tasks were also performed during this reporting period:

- On 12 July, 15 September, and 22 September, bag filters were changed out.
- On 20 September, a carbon changeout was performed on LGAC-1, LGAC-2, and LGAC-3. After carbon was allowed to hydrate for 24 hours, the LGACs were backwashed on 22 September and system restarted.

### 2.2 Non-routine Maintenance / Site Activities

The following non-routine activities occurred during the Third Quarter:

- As previously mentioned, on 1 July 2015, recovery well RW-3 was taken off-line and the pumping rate for RW-1 was increased. RW-3 was operated for approximately one hour each subsequent month to maintain the operational status of the well and to allow samples to be collected on a semi-annual basis.
- On 1 July and 5 July, a rain gauge alarm was received. The system was restarted upon clearing of the alarm.
- On 20 July, the GAC heater stopped working correctly. An instrumentation contractor evaluated the heater and determined that the temperature monitor relay had failed. The process control meter, with relays, was replaced on 22 July, programmed, and heater resumed normal operation.
- On 11 August and 21 August, the system went down due to a power interruption caused by storms and/or loss of power in the area. The system was restarted upon arrival by the operator and restoration of power.
- A steel platform was fabricated and installed around the two bag filter units to better facilitate access to and maintenance of the vessels. Installation of the platform included rotation of the bag filter influent valves to allow clearance for the platform.

### 3.0 GWTP MONITORING

The intent of the GWTP is to remove contaminant mass and reduce elevated VOC levels to levels similar to those in the surrounding aquifer. It is anticipated that GWTP operation will minimize contaminant impacts on water supply wells and currently unaffected portions of the groundwater aquifer. The GWTP is not intended to remediate groundwater contamination in the local aquifer to non-detectable levels (TtEC 2010). Various process samples (water and vapor) are collected on a monthly basis to monitor GWTP efficiency and to ensure compliance with Federal and State effluent discharge and air emission requirements. In addition, groundwater samples are collected semi-annually to monitor water quality and determine the effectiveness of the remediation activities and monitor the hydraulic containment and capture of impacted groundwater by the recovery wells.

#### 3.1 Process Water Quality Monitoring

Processed groundwater is analyzed to comply with calculations submitted by the Navy and approved by NYSDEC Water Division for the effluent limitations and monitoring requirements. These results are also submitted to NYSDEC on a monthly basis in the form of a Discharge Monitoring Report (DMR). A copy of the approved NYSDEC effluent limitation and monitoring constituents and the reporting forms are included in **Appendix A**.

Monthly aqueous samples are collected from the active recovery well, RW-1, and the treated effluent (TE) discharge line. In addition, various intermediary process system samples are collected monthly, consisting of air stripper effluent (ASE), bag filter effluent (BFE), and effluent of each of the three LGAC units (LC1, LC2, and LC3). Sampling frequency of now inactive recovery well, RW-3, was reduced from monthly to semi-annually.

The analytical results of monthly process water samples collected during the Third Quarter are presented in **Table 1**. The data demonstrates that all permitted constituents were in compliance with regulatory requirements during the Third Quarter.

**Table 1** also summarizes the average monthly flowrates in gallons per minute along with the total volume of water processed during each month of the Third Quarter.

Monthly DMRs for the Third Quarter (July – September 2016) are included in **Appendix A**.

#### 3.2 Air Quality Monitoring

Treated off-gas discharged at the stack of the GWTP is subject to emissions limitations. Original discharge goals were derived from calculations submitted by the Navy and approved by the NYSDEC Division of Air Resources (DAR) in July 2009. In November 2011, the Navy submitted an evaluation proposing revised discharge goals, which NYSDEC approved in October 2013. A copy of this documentation is included as **Appendix B**.

While only sampling of the stack emissions is required for NYSDEC compliance, process vapor samples are also collected using 6-L summa canisters at various locations to monitor for breakthrough of the

VGAC units. The analytical results of monthly influent and effluent vapor samples as well as midfluent samples (VC12 and VC23) collected during the Third Quarter are presented in **Table 2**. Air emissions calculations using the stack vapor concentrations along with discharge flowrates are presented in **Table 3**. The calculations demonstrate that all constituents were within the regulatory requirements during the Third Quarter based on the calculated emission rates.

### 3.3 Groundwater Quality Monitoring

The groundwater monitoring well system at the GM-38 Groundwater Remediation Area consists of fourteen monitoring wells (as summarized in **Table 4**), three recovery wells (RW-1, RW-2, RW-3) and one injection well (IW-1). Though RW-2 was installed in 2005, a pump was never installed in this well and the well is not operated as a recovery well due to concerns expressed by the Bethpage Water District. As mentioned above, RW-3 was taken off-line on 1 July 2015. Well locations are depicted on **Figure 3**.

Depth to water (DTW) measurements are collected from twelve of the monitoring wells on a quarterly basis. Prior to 2014, water quality samples were collected from eight of the monitoring wells on a quarterly basis; beginning in 2014, the sample collection frequency was reduced to semi-annually, with sample collection generally in the March and September time-frame. The monitoring network includes well clusters located near the recovery and injection wells as described below and as shown on **Figure 3**. In addition, two wells, GM-38D and GM-38D2, located at the corner of Arthur Avenue and Broadway, are monitored by others.

Semi-annual groundwater samples are collected from eight monitoring wells (RW1-MW1, RW1-MW3, RW2-MW1, RW3-MW1, RW3-MW2, RW3-MW3, RW3-MW4, and TP-01) and one recovery well (RW-3). Samples are collected from monitoring wells using bladder pumps in accordance with the U.S. Environmental Protection Agency (USEPA) low-flow sampling methodologies. Samples are collected from recovery well RW-3 using the dedicated extraction pump following a 3-well volume purge. Results of the groundwater sampling for the Third Quarter are presented in Section 3.3.1 below, and descriptions of monitoring well locations are as follows:

#### Recovery Well 1 (RW-1) Monitoring Wells

The RW-1 cluster consists of three monitoring wells screened between 395 and 435 feet below ground surface (bgs). RW1-MW1 is located approximately 140 feet northwest of RW-1 and RW1-MW2 is located approximately 50 feet north of RW-1. RW1-MW3 is located approximately 400 feet northeast of RW-1, on the eastern side of Seaford Oyster Bay Expressway. All three wells are hydraulically monitored while only RW1-MW1 and RW1-MW3 are also monitored for water quality.

#### Recovery Well 2 (RW-2) Monitoring Wells

The RW-2 cluster consists of three monitoring wells screened between 470 and 510 feet bgs. RW2-MW1 is located approximately 60 feet northwest of RW-2, RW2-MW2 is located approximately 20 feet west of RW-2, and RW2-MW3 is located approximately 100 feet west of RW-2. All three wells are hydraulically monitored while only RW2-MW1 is monitored for water quality.

### Recovery Well 3 (RW-3) Monitoring Wells

The RW-3 cluster consists of four monitoring wells. RW3-MW2 and RW3-MW4 are screened between 475 and 495 feet bgs. RW3-MW1 and RW3-MW3 are screened between 330 and 350 feet bgs and 320 and 340 feet bgs, respectively. RW3-MW1 and RW3-MW2 are located approximately 500 feet west of the GM-38 cluster, at the intersection of Arthur Avenue and Leroy Avenue. RW3-MW3 and RW3-MW4 are located approximately 400 feet north of the intersection of Arthur Avenue and Broadway. All four wells are both hydraulically monitored and monitored for water quality.

### TP-01

TP-01 is screened between 450 and 470 feet bgs and is located approximately 25 feet north of the GWTP building, inside the fenced area. It is hydraulically monitored to observe the change in water levels due to the influence from the pumping rates at the neighboring public water supply well field near the hot spot area and is also monitored for water quality.

### Injection Well 1 (IW-1) Monitoring Well

There is one monitoring well associated with injection well IW-1. IW1-MW1 is screened between 20 and 150 feet bgs, is located approximately 20 feet south of IW-1, and is only hydraulically monitored on a quarterly basis.

## **3.3.1 Groundwater Quality Results**

KGS collected groundwater samples for the Third Quarter on 14-15 September 2016. Field parameters measured during well purging, which consisted of pH, specific conductance (SC), temperature, oxidation-reduction potential (ORP) and dissolved oxygen (DO), are summarized in **Table 5**. Following stabilization of field parameters, groundwater samples were collected. Copies of the field logs and chain of custody documentation are presented in **Appendix C**.

Groundwater samples were submitted to a National Environmental Laboratory Accreditation Conference (NELAC), Department of Defense (DoD) Environmental Laboratory Accreditation Program (ELAP) certified, laboratory, Analytical Laboratories Services, located in Rochester, NY. The samples were analyzed for VOCs via USEPA Method 624, mercury via USEPA Method 245.1, and total suspended solids (TSS) via USEPA Method SM20 2540D. Validated analytical sampling results collected during the Third Quarter monitoring event are summarized in **Table 6**. Data validation reports are presented in **Appendix D**. Raw analytical data is provided under separate cover.

## **3.3.2 Quality Assurance/Quality Control Sampling**

Quality assurance/quality control (QA/QC) samples were collected during the semi-annual groundwater monitoring event in accordance with the *Final Sampling and Analysis Plan* (TtEC 2010a). These samples consisted of blind field duplicates (collected from RW3-MW2 during the Third Quarter), matrix spike/matrix spike duplicate (MS/MSD) samples, equipment rinsate blanks (EB) collected at a rate of one per sampling event, and trip blanks (TB) submitted at a rate of one per sample cooler. No contaminants were detected in the equipment blank or trip blank submitted for this event. The overall lack of contamination in the blanks indicates that quality control requirements were achieved.

For field duplicate samples, the precision between the original sample and its duplicate is evaluated by calculating the relative percent difference (RPD). RPDs for the Third Quarter sampling event are presented in the data validation report in **Appendix D**. As indicated, RPDs for most analytes were well below the guideline of 50%, and a majority of the RPDs were below 10%. This overall consistency between the samples and its duplicate verifies that proper sample collection methods were followed.

### 3.3.3 Groundwater Concentration Trends

Historical groundwater analytical results through the Third Quarter are presented in **Table 7**. Groundwater analytical results of select VOCs (cis-1,2-DCE, PCE, TCE, and vinyl chloride) for the Third Quarter monitoring event are presented graphically as **Figure 4**. Additionally, concentration trends of select VOCs (cis-1,2-DCE, TCE, and PCE, as well as vinyl chloride for RW-1) over time for each recovery well (RW-1, sampled monthly, and RW-3 now sampled semi-annually) and the eight monitoring wells sampled during the Third Quarter monitoring event are presented in **Figures 5 through 14** and discussed below.

**Figure 5** presents concentrations detected at recovery well RW-1, including the most recent data collected in the Third Quarter 2016. Concentrations of TCE have decreased from initial concentrations in early 2010 (maximum value of 747 µg/L detected in April 2010), remaining below 300 µg/L since the latter half of 2012, below 200 µg/L since May 2014 and below 150 µg/L since December 2015. During the Third Quarter 2016, TCE was detected at a concentration of 120 µg/L in July, August, and September. Concentrations of cis-1,2-DCE have followed a similar trend, decreasing from a high of 160 µg/L in February 2010 to a low of 8.9 µg/L in May 2016. PCE concentrations have also exhibited decreasing trends over time, with concentrations decreasing from 180 µg/L in February 2010 to a low of 25 µg/L in June 2016. Concentrations of vinyl chloride have decreased below initial concentrations in 2010. After reaching a maximum concentration of 61 µg/L in February 2010, vinyl chloride concentrations have remained below 5.0 µg/L since the final quarter of 2011 and below 1.0 µg/L since June 2013.

**Figure 6** presents concentrations detected at recovery well RW-3, including the most recent data collected in the Third Quarter 2016. Concentrations of TCE have decreased from initial concentrations in February 2010 (660 µg/L), remaining below 300 µg/L from the latter half of 2012 through the Third Quarter 2015, with a low of 160 µg/L detected in December 2013. In March 2016, the TCE concentration increased to 370 µg/L; however, in June 2016, the TCE concentrations decreased to between 210 µg/L to 280 µg/L, and in September 2016 the TCE concentration was 230 µg/L. Concentrations of cis-1,2-DCE have remained consistently below 4.0 µg/L, and below 2.0 µg/L since September 2013, though the concentration increased slightly to 2.5 µg/L in June 2016. PCE has been detected at low levels during only a few sampling events, with the most recent detection of 0.64 µg/L in September 2016. Vinyl chloride has not been detected during any sampling event.

**Figure 7** presents concentrations detected at RW1-MW1, including the most recent data collected in the Third Quarter 2016. The concentration of TCE in the Third Quarter 2016 (110 µg/L) was higher than initial concentrations observed in May 2005 (53.6 µg/L) but less than the highest concentration observed to date (175 µg/L in September 2013). The concentration of cis-1,2-DCE in the Third Quarter 2016 (16 µg/L) was below the initial concentration observed in May 2005 (78.6 µg/L), below the maximum

concentration observed in May 2009 (180 µg/L), and the lowest concentration observed to date. Concentrations of PCE have remained consistently below 1.0 µg/L.

**Figure 8** presents concentrations detected at RW1-MW3, including the most recent data collected in the Third Quarter 2016. Concentrations of cis-1,2-DCE and PCE have consistently remained below 1.0 µg/L. Concentrations of TCE have also remained low, ranging from 0.58 J µg/L in July 2010 to a maximum of 4.5 µg/L in March 2016.

**Figure 9** presents concentrations detected at RW2-MW1, including the most recent data collected in the Third Quarter 2016. Concentrations of TCE in the Third Quarter 2016 (18 µg/L) were less than initial concentrations observed in May 2005 (37.6 µg/L) and also below the maximum TCE concentration observed in March 2016 (43.9 µg/L). The concentration of cis-1,2-DCE observed in the Third Quarter 2016 (6.1 µg/L) was above initial concentrations observed in May 2005 (non-detect), but below the maximum observed to date (15.3 µg/L in March 2016). PCE has not been detected during any sampling event.

**Figure 10** presents concentrations detected at RW3-MW1, including the most recent data collected in the Third Quarter 2016. Concentrations of TCE in the Third Quarter 2016 (40 µg/L) were slightly higher than initial concentrations observed in January 2010 (35.0 µg/L), though remain less than maximum TCE concentrations observed in November 2010 (77.6 µg/L). Concentrations of cis-1,2-DCE have remained consistently below 1.0 µg/L, falling to non-detectable levels since March 2015. Concentrations of PCE have remained consistently near or below 2.0 µg/L, with a concentration of 2.3 µg/L in the Third Quarter 2016.

**Figure 11** presents concentrations detected at RW3-MW2, including the most recent data collected in the Third Quarter 2016. TCE concentrations observed in the Third Quarter 2016 (190 µg/L) were above initial concentrations observed in January 2010 (160 µg/L), but below the maximum concentration observed in April 2010 (211 µg/L). Concentrations of cis-1,2-DCE at this location have consistently remained between 1.0 – 2.0 µg/L. PCE has only been detected during a few sampling events, with concentrations ranging from 0.28 J µg/L in August 2012 to 0.66 J µg/L in March 2016.

**Figure 12** presents concentrations detected at RW3-MW3, including the most recent data collected in the Third Quarter 2016. TCE concentrations observed in the Third Quarter 2016 (260 µg/L) were less than initial concentrations observed in January 2010 (350 µg/L), and also less than the maximum concentration observed in June 2013 (410 µg/L). Concentrations of cis-1,2-DCE have remained near or below 2.0 µg/L and PCE has remained below 1.0 µg/L.

**Figure 13** presents concentrations detected at RW3-MW4, including the most recent data collected in the Third Quarter 2016. TCE concentrations have decreased since the initial sampling event in January 2010 (21 µg/L), with a concentration of 4.3 µg/L observed in the Third Quarter 2016. PCE has only been detected during two sampling events: in September 2015 at a concentration of 0.31 J µg/L March 2016 at a concentration of 0.46 J µg/L, and cis-1,2-DCE has not been detected since the initial sampling event in January 2010 (0.46 µg/L).

**Figure 14** presents concentrations detected at TP-01, including the most recent data collected in the Third Quarter 2016. TCE concentrations observed in the Third Quarter 2016 (47 µg/L) were less than initial concentrations observed in January 2010 (65 µg/L), which was also the maximum concentration observed to date. Concentrations of cis-1,2-DCE have generally decreased over time, from an initial value of 190 µg/L to 12 µg/L in the Third Quarter 2016. PCE concentrations have ranged from non-detectable levels in March 2014 to 6.0 µg/L in June 2012.



#### **4.0 CONCLUSIONS AND RECOMMENDATIONS**

The intent of the groundwater treatment system at GM-38 is to remove mass and reduce elevated VOC concentrations to levels similar to those in the surrounding aquifer, and in doing so minimize the impacts on downgradient water supply wells and currently unaffected portions of the aquifer. Based on the removal of VOCs by the GWTP and decreasing contaminant concentration trends observed in the recovery wells and several of the monitoring wells, progress toward these goals is apparent. VOC concentrations in recovery well RW-3 and surrounding monitoring wells should continue to be evaluated to ensure concentrations are continuing to decrease since deactivation of RW-3 in July 2015.

Based on the concentrations in the groundwater wells, the GWTP should continue to be operated. In accordance with the O&M Manual, the groundwater sampling frequency for the eight monitoring wells has been reduced to semi-annually. Water levels for the 14 monitoring wells will continue to be monitored on a quarterly basis.

## 5.0 REFERENCES

Tetra Tech, Inc. (Tetra Tech). 2014. *Capture Zone Evaluation and Path Forward, GM-38 Area Groundwater Treatment Plant, Naval Weapons Industrial Reserve Plant, Bethpage, New York*. March.

Tetra Tech EC, Inc. (TtEC). 2010. *Final Operation, Maintenance & Monitoring Plan for Groundwater Treatment Plant GM-38 Area Groundwater Remediation, Naval Weapons Industrial Reserve Plant, Bethpage, New York*. April.

Tetra Tech EC, Inc. (TtEC). 2010a. *Final Sampling and Analysis Plan (Field Sampling Plan and Quality Assurance Project Plan), UFP-SAP for Operations, Maintenance, and Monitoring of the Groundwater Treatment Plant, GM-38 Area, Naval Weapons Industrial Reserve Plant, Bethpage, New York*. September.

## **TABLES**

**Table 1**  
**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Discharge Monitoring Results**  
**Third Quarter 2016**

SPDES Parameters	Daily Maximum Goal	Units	July 2016									
			RW-1 <sup>(1)</sup>	RW-3 <sup>(2)</sup>	Combined Influent <sup>(1)</sup>	Air Stripper Effluent (ASE)	Bag Filter Effluent (BFE)	Liquid Carbon 1 Effluent (LC1)	Liquid Carbon 2 Effluent (LC2)	Liquid Carbon 3 Effluent (LC3)	Treated Effluent (TE)	Treated Effluent (TE) Duplicate
Process Stream												
Well Depth		ft	445	530	NA	NA	NA	NA	NA	NA	NA	NA
Screened Interval		ft	335-395 410-430	392-412 442-504	NA	NA	NA	NA	NA	NA	NA	NA
Sampling Date			7/5/16									
Average Flowrate	1100	GPM	990	0.3	990	NR	989	NR	NR	NR	1,014	NR
Total Flow		gallons	44,198,025	12,800	44,210,825	NR	44,134,939	NR	NR	NR	45,256,458	NR
pH	5.5 - 8.5	SU	5.33	N/A	5.33	5.91	5.95	5.98	6.01	6.01	6.04	6.02
Carbon Tetrachloride	NA	µg/L	ND (1.0)	N/A	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1-Dichloroethane	5	µg/L	2.2	N/A	2.2	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,2-Dichloroethane	0.6	µg/L	ND (1.0)	N/A	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1-Dichloroethene	5	µg/L	1.6	N/A	1.6	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
cis 1,2-Dichloroethene	5	µg/L	11	N/A	11	0.36 J	0.34 J	0.38 J	0.36 J	0.36 J	0.39 J	0.32 J
trans 1,2-Dichloroethene	5	µg/L	ND (1.0)	N/A	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
Tetrachloroethene	5	µg/L	28	N/A	28	0.32 J	0.24 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1,1-Trichloroethene	5	µg/L	1.1	N/A	1.1	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
Trichloroethene	5	µg/L	120	N/A	120	2.0	1.9	1.1	0.89 J	0.89 J	0.96 J	0.91 J
Vinyl Chloride	2	µg/L	0.43 J	N/A	0.43 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
Mercury	0.00025	mg/L	ND (0.00010)	N/A	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)
Total Suspended Solids (TSS)	NA	mg/L	ND (1.0)	N/A	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)

**Table 1**  
**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Discharge Monitoring Results**  
**Third Quarter 2016**

SPDES Parameters	Daily Maximum Goal	Units	August 2016									
			RW-1 <sup>(1)</sup>	RW-3 <sup>(2)</sup>	Combined Influent <sup>(1)</sup>	Air Stripper Effluent (ASE)	Bag Filter Effluent (BFE)	Liquid Carbon 1 Effluent (LC1)	Liquid Carbon 2 Effluent (LC2)	Liquid Carbon 3 Effluent (LC3)	Treated Effluent (TE)	Treated Effluent (TE) Duplicate
Process Stream												
Well Depth		ft	445	530	NA	NA	NA	NA	NA	NA	NA	NA
Screened Interval		ft	335-395 410-430	392-412 442-504	NA	NA	NA	NA	NA	NA	NA	NA
Sampling Date			8/1/16									
Average Flowrate	1100	GPM	978	0.3	978	NR	976	NR	NR	NR	1,001	NR
Total Flow		gallons	43,636,307	11,900	43,648,207	NR	43,572,663	NR	NR	NR	44,673,611	NR
pH	5.5 - 8.5	SU	5.26	N/A	5.26	5.81	5.84	5.85	5.88	5.89	5.89	5.87
Carbon Tetrachloride	NA	µg/L	ND (1.0)	N/A	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1-Dichloroethane	5	µg/L	2.1	N/A	2.1	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,2-Dichloroethane	0.6	µg/L	0.35 J	N/A	0.35 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1-Dichloroethene	5	µg/L	1.3	N/A	1.3	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
cis 1,2-Dichloroethene	5	µg/L	9.4	N/A	9.4	0.40 J	0.40 J	0.42 J	0.41 J	0.39 J	0.39 J	0.45 J
trans 1,2-Dichloroethene	5	µg/L	ND (1.0)	N/A	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
Tetrachloroethene	5	µg/L	27	N/A	27	0.23 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1,1-Trichloroethene	5	µg/L	1.2	N/A	1.2	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
Trichloroethene	5	µg/L	120	N/A	120	1.8	1.7	1.3	0.81 J	0.89 J	1.0	0.90 J
Vinyl Chloride	2	µg/L	0.33 J	N/A	0.33 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
Mercury	0.00025	mg/L	ND (0.00010)	N/A	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)
Total Suspended Solids (TSS)	NA	mg/L	ND (1.0)	N/A	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)

**Table 1**  
**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Discharge Monitoring Results**  
**Third Quarter 2016**

SPDES Parameters	Daily Maximum Goal	Units	September 2016 <sup>(3)</sup>									
			RW-1 <sup>(1)</sup>	RW-3 <sup>(2)</sup>	Combined Influent <sup>(1)</sup>	Air Stripper Effluent (ASE)	Bag Filter Effluent (BFE)	Liquid Carbon 1 Effluent (LC1)	Liquid Carbon 2 Effluent (LC2)	Liquid Carbon 3 Effluent (LC3)	Treated Effluent (TE)	Treated Effluent (TE) Duplicate
Process Stream												
Well Depth		ft	445	530	NA	NA	NA	NA	NA	NA	NA	NA
Screened Interval		ft	335-395 410-430	392-412 442-504	NA	NA	NA	NA	NA	NA	NA	NA
Sampling Date			9/6/16									
Average Flowrate	1100	GPM	923	0.3	924	NR	924	NR	NR	NR	946	NR
Total Flow		gallons	39,887,336	12,800	39,900,136	NR	39,921,167	NR	NR	NR	40,854,572	NR
pH	5.5 - 8.5	SU	5.29	N/A	5.29	5.86	6.02	6.03	6.04	6.07	6.07	6.09
Carbon Tetrachloride	NA	µg/L	ND (1.0)	N/A	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1-Dichloroethane	5	µg/L	2.0	N/A	2.0	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,2-Dichloroethane	0.6	µg/L	ND (1.0)	N/A	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1-Dichloroethene	5	µg/L	1.5	N/A	1.5	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
cis 1,2-Dichloroethene	5	µg/L	9.4	N/A	9.4	ND (1.0)	0.33 J	0.30 J	0.36 J	0.38 J	0.40 J	0.29 J
trans 1,2-Dichloroethene	5	µg/L	ND (1.0)	N/A	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
Tetrachloroethene	5	µg/L	27	N/A	27	0.21 J	0.26 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1,1-Trichloroethene	5	µg/L	1.1	N/A	1.1	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
Trichloroethene	5	µg/L	120	N/A	120	1.9	1.7	1.0	0.86 J	0.79 J	0.89 J	0.85 J
Vinyl Chloride	2	µg/L	0.27 J	N/A	0.27 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
Mercury	0.00025	mg/L	ND (0.00010)	N/A	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)
Total Suspended Solids (TSS)	NA	mg/L	ND (1.0)	N/A	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)

**Notes:**

B - Method blank contamination

J - Estimated result between laboratory method detection limit and reporting limit

N/A - Not Applicable

ND - Not detected above laboratory method detection limit. Limit of detection (LOD) given in parentheses.

NR - Not Recorded

gpm - gallons per minute

(1) On 1 July 2015, the RW-1 flowrate was increased from ~800 gpm to ~1,000 gpm and RW-3 was taken off-line, as approved by NYSDEC on 20 April 2015. Influent concentrations presented above are therefore equivalent to RW-1 concentrations only.

(2) To maintain the integrity of RW-3 for potential future use, approximately 200 gallons per minute of water are pumped for a 1-hour period from the well on a monthly basis. RW-3 is sampled semi-annually, consistent with the groundwater monitoring program.

(3) Monthly process samples were collected on 9/6/16. Changeout of the liquid phase granular activated carbon (LGAC) was performed on 9/20/16.

**Table 2**  
**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Air Sampling Results**  
**Third Quarter 2016**

DAR Parameters	Discharge Goal <sup>(3)</sup>	Units	July 2016					August 2016				
			Influent (VCI1)	VC12	VC23	Effluent <sup>(5)</sup>	Effluent Duplicate <sup>(5)</sup>	Influent (VCI1)	VC12	VC23	Effluent	Effluent Duplicate
Process Stream												
Sampling Date			7/5/16					8/8/16				
Average Flowrate		CFM	NR	NR	NR	8,347	NR	NR	NR	NR	7,786	NR
Total Flow <sup>(1)</sup>		ft <sup>3</sup>	NR	NR	NR	360,590,400	NR	NR	NR	NR	347,581,920	NR
Total Flow <sup>(2)</sup>		m <sup>3</sup>	NR	NR	NR	10,210,783	NR	NR	NR	NR	9,842,424	NR
1,2-Dichloroethane	NA	µg/m <sup>3</sup>	6.7	55	ND	ND	ND	4.7 J	6.1	ND	ND	ND
cis 1,2-Dichloroethene	> 100,000 <sup>(4)</sup>	µg/m <sup>3</sup>	180	2,500	1.3 J	3.5	ND	130	200	4.9	1.9 J	1.9 J
trans 1,2-Dichloroethene		µg/m <sup>3</sup>	2.6 J	32	ND	ND	ND	2.0 J	3.4	ND	ND	ND
1,2-Dichloroethene (total)	> 100,000	µg/m <sup>3</sup>	190	2,500	ND	ND	ND	130	210	ND	ND	ND
Toluene	NA	µg/m <sup>3</sup>	1.6 J	3.1 J	0.70 J	3.6	ND	26	0.35 J	0.56 J	ND	ND
Xylene	NA	µg/m <sup>3</sup>	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1,2-Trichloroethane	NA	µg/m <sup>3</sup>	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Trichloroethene	2,600	µg/m <sup>3</sup>	2,200	930	71	83	4.5	2,000	190	62	1.4 J	1.8 J
Vinyl Chloride	560	µg/m <sup>3</sup>	7.0	11	8.4	3.7	4.9	3.3 J	3.6	4.0	1.7 J	1.6 J
Tetrachloroethene	5,100	µg/m <sup>3</sup>	450	180	55	29	2.1 J	420	34	53	ND	ND

**Table 2**  
**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Air Sampling Results**  
**Third Quarter 2016**

DAR Parameters	Discharge Goal <sup>(3)</sup>	Units	September 2016				
			Influent (VC11)	VC12	VC23	Effluent <sup>(6)</sup>	Effluent Duplicate <sup>(6)</sup>
Process Stream							
Sampling Date			9/6/16				
Average Flowrate		CFM	NR	NR	NR	7,823	NR
Total Flow <sup>(1)</sup>		ft <sup>3</sup>	NR	NR	NR	337,947,429	NR
Total Flow <sup>(2)</sup>		m <sup>3</sup>	NR	NR	NR	9,569,605	NR
1,2-Dichloroethane	NA	µg/m <sup>3</sup>	4.0 J	4.6	ND	0.76 J	0.51 J
cis 1,2-Dichloroethene	> 100,000 <sup>(4)</sup>	µg/m <sup>3</sup>	130	160	27	30	29
trans 1,2-Dichloroethene		µg/m <sup>3</sup>	1.9 J	3.3	0.95 J	ND	0.96 J
1,2-Dichloroethene (total)	> 100,000	µg/m <sup>3</sup>	140	170	28	30	30
Toluene	NA	µg/m <sup>3</sup>	ND	0.56 J	2.6 J	7.2	4.0
Xylene	NA	µg/m <sup>3</sup>	ND	ND	ND	ND	ND
1,1,2-Trichloroethane	NA	µg/m <sup>3</sup>	1.5 J	ND	ND	ND	ND
Trichloroethene	2,600	µg/m <sup>3</sup>	2,400	440	94	830	910
Vinyl Chloride	560	µg/m <sup>3</sup>	4.1	4.5	4.5	3.8	4.2
Tetrachloroethene	5,100	µg/m <sup>3</sup>	460	55	66	260	280

Notes:

NA - Not applicable

ND - Not detected

NR - Not recorded

NS - Not sampled

SGC - Short-term Guideline Concentration

µg/m<sup>3</sup> - micrograms per cubic meter

CFM - cubic feet per minute

DAR - Division of Air Resources

(1) Total Flow (ft<sup>3</sup>) = avg flowrate (cfm) \* operational time (min)

(2) Total Flow (m<sup>3</sup>) = total flow (ft<sup>3</sup>) \* (0.3048<sup>3</sup>)m<sup>3</sup>/ft<sup>3</sup>

(3) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

(4) Discharge goal is for total 1,2-Dichloroethene.

(5) Effluent concentrations presented above differ from concentrations of the duplicate sample collected at this location and are also higher than concentrations observed in previous and subsequent months.

(6) Effluent concentrations presented above are not in-line with concentrations observed in previous months and are also not consistent with results of a subsequent sample collected on 10/7/16, indicating effluent results presented above are not likely indicative of actual conditions.



**Table 3**  
**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Stack Emissions**  
**Third Quarter 2016**

DAR Parameters	Discharge Goal <sup>(1)</sup>	Units	July 2016	August 2016	September 2016 <sup>(2)</sup>	
Sampling Date			7/5/16	8/8/16	9/6/16	
Average Flowrate		CFM	8,347	7,786	7,823	
Total Flow		ft <sup>3</sup>	360,590,400	347,581,920	337,947,429	
Total Flow		m <sup>3</sup>	10,210,783	9,842,424	9,569,605	
Trichloroethene	0.09	lb/hr	0.00251	0.00004	0.02432	0.00012
Vinyl Chloride	0.02	lb/hr	0.00011	0.00005	0.00011	0.00005
1,2 Dichloroethene	11	lb/hr	0.00000	0.00000	0.00088	0.00070
1,2-Dichloroethane	NA	lb/hr	0.00000	0.00000	0.00002	0.00000
Toluene	NA	lb/hr	0.00011	0.00000	0.00021	0.00004
Xylene	NA	lb/hr	0.00000	0.00000	0.00000	0.00000
1,1,2-Trichloroethane	NA	lb/hr	0.00000	0.00000	0.00000	0.00000
Tetrachloroethene	0.18	lb/hr	0.00088	0.00000	0.00762	0.00002

Notes:

NA - Not applicable

lb/hr - pounds per hour

DAR - Division of Air Resources

CFM - Cubic feet per minute

Stack Emissions (lb/hr) = average flowrate (cfm) \* (0.3048<sup>^3</sup>)m<sup>3</sup>/ft<sup>3</sup> \* conc.(ug/m<sup>3</sup>) \* 1 lb/453592370 ug \* 60 min/hr

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

(2) Concentrations of the effluent sample collected on 9/6/16 are not in-line with concentrations observed in previous months and are also not consistent with results of a subsequent sample collected on 10/7/16, indicating the September results may not reflect actual conditions. Emission rates were calculated using the September 2016 effluent data on the left. Emission rates were calculated using the average of the effluent concentrations from August and October 2016 on the right, as these concentrations and calculated emissions more likely reflect actual conditions. Calculated emission rates using both the September 2016 effluent concentrations and the average of the August 2016 and October 2016 effluent concentrations remain below the discharge goals.

**Table 4**  
**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Groundwater Level Measurements**  
**Third Quarter 2016**

Monitoring Well ID	Date	Well Elevation (ft amsl)	Total Depth (ft)	Screen Interval (ft)	Depth to Water (ft)	Groundwater Elevation (ft amsl)
RW1-MW1	09/13/16	85.86	435	395-435	42.17	43.69
RW1-MW2	09/13/16	87.35	435	395-435	44.47	42.88
RW1-MW3	09/13/16	80.34	435	395-435	35.90	44.44
RW2-MW1	09/13/16	90.75	510	470-510	45.04	45.71
RW2-MW2	09/13/16	90.15	510	470-510	44.41	45.74
RW2-MW3	09/13/16	89.75	510	470-510	44.19	45.56
RW3-MW1	09/13/16	92.22	350	330-350	42.78	49.44
RW3-MW2	09/13/16	91.98	495	475-495	44.91	47.07
RW3-MW3	09/13/16	92.98	340	320-340	44.26	48.72
RW3-MW4	09/13/16	92.92	495	475-495	46.07	46.85
TP-01	09/13/16	85.91	470	450-470	40.36	45.55
IW1-MW1	09/13/16	89.41	150	20-150	40.97	48.44
GM38D	NA	91.37	340	320-340	NA	NA
GM382D	NA	91.57	495	475-495	NA	NA

**Notes:**

amsl - above mean sea level

ft - feet

NA - Not Available

**Table 5**  
**Summary of Final Groundwater Chemistry Data**  
**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Summary of Groundwater Chemistry Results**  
**Third Quarter 2016**

Location	Temp (°C)	pH (SU)	S.C. (uS/cm)	DO (mg/L)	ORP (mV)	Turbidity (NTU)	Color (Visual)
RW1-MW1	16.59	4.42	185	0.68	196.4	0.01	clear
RW1-MW3	14.34	5.10	193	0.29	109.3	3.04	clear
RW2-MW1	16.20	5.72	188	0.26	29.6	1.45	clear
RW3-MW1	16.07	4.85	133	5.38	144.3	7.88	clear
RW3-MW2	15.50	4.79	105	0.54	201.5	0.66	clear
RW3-MW3	16.62	4.61	119	0.21	151.8	9.56	clear
RW3-MW4	15.73	4.32	115	0.20	128.4	1.81	clear
TP-01	14.24	5.71	179	7.50	148.5	0.33	clear

**Notes:**

S.C. = Specific Conductance

mS/cm = milliSiemens per centimeter

NTU = nephelometric turbidity units

mg/L = milligrams per liter

°C = degrees celsius

mV = millivolts

SU = standard units

ORP = oxidation/reduction potential

**Table 6**  
**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Summary of Detected Groundwater Analytical Results**  
**Third Quarter 2016**

Sample ID	RW1-MW1	RW1-MW3	RW2-MW1	RW3-MW1	RW3-MW2	RW3-MW2	RW3-MW3	RW3-MW4	TP-01	RW-3 <sup>(2)</sup>
Sample Date	9/14/2016	9/14/2016	9/15/2016	9/14/2016	9/14/2016	9/14/2016	9/15/2016	9/15/2016	9/14/2016	9/15/2016
Comments						Duplicate				
<b>VOCS (EPA 624) ug/L<sup>(1)</sup></b>										
Chloroform	0.48 J	0.80 J	2.4	ND	0.24 J	0.23 J	0.48 J	ND	1.6	0.26 J
1,1-dichloroethane	7.0	7.0	6.4	0.33 J	0.39 J	0.34 J	3.5	2.0	2.1	1.8
1,2-dichloroethane	ND	ND	0.93 J	ND	ND	ND	0.30 J	ND	0.70 J	ND
1,1-dichloroethene	1.8	1.7	1.6	0.21 J	0.31 J	0.37 J	2.0	0.40 J	0.68 J	1.5
cis-1,2-dichloroethene	16	0.44 J	6.1	ND	1.5	1.5	1.1	ND	12	1.4
trans-1,2-dichloroethene	0.42 J	ND	ND	ND	ND	ND	ND	ND	ND	ND
Tetrachloroethene	0.45 J	0.35 J	ND	2.3	0.48 J	0.54 J	0.58 J	ND	0.37 J	0.64 J
1,1,1-trichloroethane	1.0	1.6	0.56 J	0.21 J	0.44 J	0.47 J	0.75 J	0.24 J	0.49 J	0.95 J
1,1,2-trichloroethane	ND	0.41 J	ND	ND	0.31 J	0.21 J	ND	ND	ND	0.29 J
Trichloroethene	110	3.5	18	40	190	190	260	4.3	47	230
Mercury (EPA 245.1) ug/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
TSS (SM20 2540D) mg/L	ND	1.8	3.8	ND	ND	ND	1.1	1.4	ND	ND

**Notes:**

J = estimated value

ND = Not detected above laboratory method detection limit

mg/L = milligrams per liter

µg/L = micrograms per liter

(1) Samples were analyzed for TCL VOCs. Only those VOCs detected are presented above.

(2) RW-3, previously an active extraction well sampled on a monthly basis, was taken off-line on 7/1/15. RW-3 is now sampled semi-annually, in conjunction with the semi-annual LTM events.



**Table 7**  
**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Summary of Historical Groundwater Analytical Results**  
**Through Third Quarter 2016**

Sample ID	RW1-MW2				RW1-MW3																							
	5/4/2005	7/22/2005	5/28/2009	6/18/2013 <sup>(2)</sup>	1/20/2010	4/21/2010	7/29/2010	11/10/2010	3/25/2011	6/14/2011	9/28/2011	11/30/2011	3/8/2012	6/7/2012	8/22/2012	12/7/2012	3/14/2013	6/19/2013 <sup>(2)</sup>	9/17/2013	12/17/2013	3/25/2014	9/23/2014	3/25/2015	9/14/2015	3/21/2016	9/14/2016		
Comments																												
Well Depth (Ft)	435				435																							
Screened Interval (Ft)	395-435				395-435																							
VOCS (EPA 624) ug/L <sup>(4)</sup>																												
Acrolein	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Acrylonitrile	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Acetone	ND	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Benzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Bromodichloromethane	ND	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Bromoform	ND	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Bromomethane	ND	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
2-butanone	R	R	ND	ND	NR	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
carbon disulfide	ND	ND	ND	NR	NR	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Carbon tetrachloride	ND	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.41 J	ND	
Chlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Dibromochloromethane	NR	NR	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Chloroethane	ND	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
2-chloroethylvinyl ether	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Chloroform	ND	1.4	ND	ND	0.67J	0.80J	0.47J	0.69J	0.73J	NR	0.97 J	ND	0.73 J	0.64 J	ND	1.2 J	ND	0.82	ND	ND	0.74 J	0.67 J	0.79 J	ND	0.79 J	0.80 J		
Chloromethane	ND	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.29 J	ND	ND	ND		
Cyclohexane	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
1,2-dibromo-3-chloro-propane	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
1,2-dibromomethane	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
1,2-dichlorobenzene	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
1,3-dichlorobenzene	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
1,4-dichlorobenzene	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
dichlorodifluoromethane	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
1,1-dichloroethane	4.6	5.5	3.4	3.9	2.4	4.6	1.5	2.3	2.4	9.3	10.1 J	2.1	8.4	5.7	9.4	9.3	8.5	10	9.7 J	8.1	8.6	6.1 J	8.1	7.7	7.4	7.0		
1,2-dichloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.18 J	ND	ND	ND	ND	ND	ND	ND	ND		
1,1-dichloroethene	3.2	12.3	ND	ND	0.42J	1.10	ND	0.28J	ND	1.8	2.2 J	ND	1.8	0.86 J	2.4	2.2	1.7	1.8	1.6	1.9	2.1	1.6 J	2.3 J	2.3	2.5	1.7		
cis-1,2-dichloroethene	181.0	47.6	160.0	120	0.54J	0.48J	0.36J	0.55J	0.58J	0.59 J	0.43 J	0.55 J	0.68 J	0.33 J	0.56 J	0.46 J	0.53 J	0.46 J	0.72 J	0.60 J	0.57 J	0.44 J	0.54 J	0.49 J	0.58 J	0.44 J		
trans-1,2-dichloroethene	2.5	7.6	2.5	1.9 J	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		
1,2-dichloropropane	ND	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		
cis-1,3-dichloropropene	ND	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		
trans-1,3-dichloropropene	ND	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		
1,4-dioxane	4.01	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
Ethylbenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		
2-hexanone	ND	ND	ND	ND	NR	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
isopropylbenzene	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
methyl acetate	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
Methylene chloride	1.0	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		
methylcyclohexane	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
4-methyl-2-pentanone	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
methyl-tert-butyl-ether	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
styrene	ND	ND	ND	NR	NR	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
1,1,2,2-tetrachloroethane	ND	ND	ND	ND	NR	ND	ND	ND	ND	NR	ND	ND	ND	0.23 J	ND	ND	ND	0.20 J	ND	ND	ND	ND	ND	ND	ND	0.25 J		
1,2,4-trichlorobenzene	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
Tetrachloroethene	ND	134.0	19.0	5.9	ND	0.49J	ND	ND	ND	0.33 J	0.62 J	ND	0.65 J	0.30 J	0.97 J	0.40 J	ND	ND	ND	ND	ND	ND	ND	0.50 J	ND	0.35 J		
Toluene	0.32J	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		
1,1,1-trichloroethane	1.3	1.0	ND	ND	0.41J	0.98J	ND	0.26J	0.33J	1.6	2.7 J	ND	ND	1.1 J	1.9	1.7	1.4	1.8	1.5	2.0	1.7	1.2 J	1.5	1.6	2.1	1.6		
1,1,2-trichloroethane	ND	0.65J	ND	ND	0.62J	0.60J	0.36J	0.55J	0.41J	NR	0.57 J	0.63 J	0.70 J	0.61 J	0.56 J	0.54 J	0.61 J	0.46 J	ND	0.55 J	0.46 J	0.46 J	0.43 J	0.44 J	0.47 J	0.41 J		
Trichloroethene	158.0	198.0	200.0	64	1.2	1.6	0.58J	0.91J	1.0	1.4	1.8 J	1.0 J	2.2	1.3	2.3	1.6	1.9	1.7	2.5	3.2	2.5	1.9	2.0	2.4	4.5	3.5		
m,p-xylene	NR	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
Trichlorofluoromethane	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
Trichlorotrifluoroethane	NR	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
Trichlorofluoromethane	NR	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
o-xylene	NR	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
1,1,2-trichloro-1,2,2-trifluoroethane	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR		
Vinyl chloride	12.9	187.0	4.1	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		
xylenes (total)	ND	ND	ND	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR		
Mercury (EPA 245.1) ug/L	NR	NR	0.20	NR	NR	<0.20	<0.20	<0.20	<0.20	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		
TSS (SM20 2540D) mg/L	NR	NR	4.0	NR	NR	8.0	<4.0	<4.0	<4.0	ND	ND	ND	5	ND	ND	ND	ND	ND	ND	ND	5	ND	ND	ND	ND	1.8		







Table 7  
GM-38 Area Groundwater Remediation  
Groundwater Treatment Plant  
Naval Weapons Industrial Reserve Plant - Bethpage, NY  
Summary of Historical Groundwater Analytical Results  
Through Third Quarter 2016

Sample ID	RW3-MW2																												
	1/19/2010	1/19/2010	4/22/2010	7/29/2010	11/9/2010	11/9/2010	3/25/2011	6/14/2011	9/27/2011	11/30/2011	3/8/2012	6/7/2012	8/22/2012	8/22/2012	12/4/2012	12/4/2012	3/14/2013	6/20/2013 <sup>(J)</sup>	9/17/2013	12/17/2013	3/25/2014	9/23/2014	9/23/2014	3/25/2015	9/14/2015	3/22/2016	9/14/2016	9/14/2016	
Sample Date	Duplicate				Duplicate								Duplicate	Duplicate								Duplicate						Duplicate	
Comments																													
Well Depth (Ft)	495																												
Screened Interval (Ft)	475-495																												
VOCS (EPA 624) ug/L <sup>(L)</sup>																													
Acrolein	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Acrylonitrile	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Acetone	NR	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Benzene	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Bromodichloromethane	NR	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Bromoform	NR	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Bromomethane	NR	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
2-butanone	NR	NR	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
carbon disulfide	NR	NR	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Carbon tetrachloride	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Chlorobenzene	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Dibromochloromethane	NR	NR	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Chloroethane	NR	NR	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
2-chloroethylvinyl ether	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Chloroform	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	0.23 J	ND	ND	0.62 J	0.64 J	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.27 J	0.24 J	0.23 J	
Chloromethane	NR	NR	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
cyclohexane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
1,2-dibromo-3-chloro-propane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
1,2-dibromomethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
1,2-dichlorobenzene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
1,3-dichlorobenzene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
1,4-dichlorobenzene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
dichlorodifluoromethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
1,1-dichloroethane	ND	ND	0.54J	ND	ND	ND	0.52 J	0.37 J	ND	0.41 J	0.66 J	0.74 J	0.73 J	0.69 J	0.71 J	0.68 J	ND	0.65 J	0.59 J	0.62 J	0.51 J	0.51 J	0.56 J	0.47 J	0.52 J	0.39 J	0.34 J		
1,2-dichloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,1-dichloroethene	ND	ND	1.2	ND	ND	ND	0.57 J	0.45 J	0.27 J	0.27 J	0.36 J	0.49 J	0.49 J	0.40 J	0.43 J	0.53 J	ND	0.29 J	0.45 J	0.44 J	0.38 J	0.33 J	0.33 J	0.30 J	0.46 J	0.31 J	0.37 J		
cis-1,2-dichloroethene	1.5J	1.6J	2.4	1.1	0.92J	0.92J	1.6	1.7	1.1	1.4	1.3	1.5	1.6	1.5	1.6	1.6	ND	1.3 J	1.9	1.7	1.4	1.3	1.5	1.4	1.7	1.5	1.5		
trans-1,2-dichloroethene	ND	ND	0.43 J	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		
1,2-dichloropropane	NR	NR	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	0.69 J	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		
cis-1,3-dichloropropene	NR	NR	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		
trans-1,3-dichloropropene	NR	NR	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		
1,4-dioxane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Ethylbenzene	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		
2-hexanone	NR	NR	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
isopropylbenzene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
methyl acetate	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Methylene chloride	NR	NR	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
methylcyclohexane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
4-methyl-2-pentanone	NR	NR	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
methyl-tert-butyl-ether	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
styrene	NR	NR	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
1,1,2,2-tetrachloroethane	NR	NR	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,2,4-trichlorobenzene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Tetrachloroethene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.28 J	ND	ND	ND	ND	ND	ND	ND	ND	0.29 J	ND	ND	ND	0.52 J	0.66 J	0.48 J	0.54 J	
Toluene	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,1,1-trichloroethane	ND	ND	0.58J	ND	ND	ND	0.39 J	0.43 J	ND	ND	0.54 J	0.52 J	0.49 J	0.42 J	0.43 J	0.41 J	ND	0.47 J	0.50 J	0.43 J	0.36 J	0.39 J	0.38 J	0.41 J	0.47 J	0.44 J	0.47 J		
1,1,2-trichloroethane	ND	ND	ND	ND	0.25 J	0.27J	ND	NR	0.32 J	0.32 J	0.32 J	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.32 J	0.31 J	0.21 J		
Trichloroethene	160	170	211	73	58.2	60.9	110	135	151	71.9	96.5	209	198	192	173 J	171	155	140	174	176	164	148	151	159	169	204	190	190	
m,p-xylene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Trichlorofluoromethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Trichlorotrifluoroethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
o-xylene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
1,1,2-trichloro-1,2,2-trifluoroethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Vinyl chloride	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
xlenes (total)	ND	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Mercury (EPA 245.1) ug/L	NR	NR	<0.20	<0.20	<0.20	<0.20	<0.20	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
TSS (SM20 2540D) mg/L	NR	NR	5.0	6.0	ND	10.0	10.0	7	6	ND	8	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	

Table 7  
 GM-38 Area Groundwater Remediation  
 Groundwater Treatment Plant  
 Naval Weapons Industrial Reserve Plant - Bethpage, NY  
 Summary of Historical Groundwater Analytical Results  
 Through Third Quarter 2016


Sample ID	RW3-MW3																								
	1/20/2010	4/22/2010	4/22/2010	7/28/2010	11/3/2010 <sup>(1)</sup>	3/25/2011	6/15/2011	9/28/2011	11/29/2011	3/7/2012	3/7/2012	6/7/2012	8/22/2012	12/4/2012	3/14/2013	6/21/2013 <sup>(2)</sup>	9/18/2013	12/17/2013	3/26/2014	9/23/2014	3/25/2015	3/25/2015	9/15/2015	3/21/2016	9/15/2016
Sample Date			Duplicate								Duplicate														
Comments																									
Well Depth (Ft)	340																								
Screened Interval (Ft)	320-340																								
VOCS (EPA 624) ug/L <sup>(4)</sup>																									
Acrolein	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND	ND	150 R	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Acrylonitrile	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Acetone	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Benzene	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Bromodichloromethane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Bromoform	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Bromomethane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2-butanone	NR	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
carbon disulfide	NR	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Carbon tetrachloride	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Chlorobenzene	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Dibromochloromethane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Chloroethane	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2-chloroethylvinyl ether	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Chloroform	ND	ND	0.40J	0.46J	ND	0.33J	NR	0.48 J	ND	0.42 J	0.42 J	2.3 J	ND	0.88 J	ND	ND	ND	3.4 J	ND	0.27 J	0.40 J	0.33 J	ND	ND	0.48 J
Chloromethane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
cyclohexane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
1,2-dibromo-3-chloro-propane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
1,2-dibromomethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
1,2-dichlorobenzene	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,3-dichlorobenzene	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,4-dichlorobenzene	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
dichlorodifluoromethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
1,1-dichloroethane	ND	1.6	1.6	2.3	1.0	1.5	7.1	3.2 J	1.5	3.3	3.3	2.6 J	ND	4.2	4.5 J	ND	ND	3.7 J	4.9 J	1.3 J	1.8	1.8	1.2	4.0	3.5
1,2-dichloroethane	ND	0.52J	0.54J	ND	ND	ND	0.37 J	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.30 J
1,1-dichloroethene	ND	1.1	1.3	1.2	ND	0.96J	2.6	1.8 J	0.96 J	1.9	1.9	1.7 J	1.4 J	1.9	2.1 J	ND	ND	ND	2.4 J	0.94 J	1.5 J	1.4 J	1.1	2.4	2.0
cis-1,2-dichloroethene	ND	2.1	2.1	1.7	ND	2.3	1.2	1.9	2.1	2.1	2.1	1.4 J	1.8 J	1.2	ND	ND	ND	ND	1.2	1.3	1.3	1.3	1.1	1.1	1.1
trans-1,2-dichloroethene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2-dichloropropane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
cis-1,3-dichloropropene	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
trans-1,3-dichloropropene	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,4-dioxane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Ethylbenzene	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2-hexanone	NR	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
isopropylbenzene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
methyl acetate	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Methylene chloride	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	3.2 J	ND	6.2 J	ND	ND	ND	ND	ND	ND	ND	ND	ND
methylcyclohexane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
4-methyl-2-pentanone	NR	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR
methyl-tert-butyl-ether	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
styrene	NR	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
1,1,2,2-tetrachloroethane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2,4-trichlorobenzene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Tetrachloroethene	ND	0.45J	0.49J	ND	ND	ND	0.40 J	0.50 J	ND	0.72 J	0.69 J	ND	ND	0.43 J	ND	ND	ND	ND	ND	ND	0.36 J	0.37 J	0.77 J	0.71 J	0.58 J
Toluene	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1,1-trichloroethane	ND	0.95J	1.0J	0.72J	ND	0.62J	1.3	1.0 J	0.49 J	0.84 J	0.87 J	ND	ND	0.85 J	ND	ND	ND	ND	ND	0.40 J	0.48 J	0.45 J	0.36 J	1.1	0.75 J
1,1,2-trichloroethane	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Trichloroethene	350	397	382	297	8.5	288	331	215 J	250	312	325	285	248	291	347	410	322	322	350	147	182	184	138	284	260
m,p-xylene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR
Trichlorofluoromethane	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND
Trichlorotrifluoroethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Trichlorofluoromethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR
o-xylene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
1,1,2-trichloro-1,2,2-trifluoroethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Vinyl chloride	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
xylenes (total)	ND	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Mercury (EPA 245.1) ug/L	NR	<0.20	<0.20	<0.20	<0.20	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
TSS (SM20 2540D) mg/L	NR	4.0	5.0	<4.0	<4.0	<4.0	ND	ND	ND	ND	ND	13	10	5	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	1.1

Table 7  
 GM-38 Area Groundwater Remediation  
 Groundwater Treatment Plant  
 Naval Weapons Industrial Reserve Plant - Bethpage, NY  
 Summary of Historical Groundwater Analytical Results  
 Through Third Quarter 2016


Sample ID	RW3-MW4																						
	1/20/2010	4/22/2010	7/28/2010	7/28/2010	11/3/2010 <sup>(1)</sup>	3/24/2011	6/15/2011	9/28/2011	11/29/2011	3/7/2012	6/7/2012	8/22/2012	12/4/2012	3/14/2013	6/21/2013 <sup>(2)</sup>	9/17/2013	12/17/2013	3/26/2014	9/23/2014	3/25/2015	9/15/2015	3/21/2016	9/15/2016
Comments	Duplicate																						
Well Depth (Ft)	495																						
Screened Interval (Ft)	475-495																						
VOCS (EPA 624) ug/L <sup>(4)</sup>																							
Acrolein	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND	30 R	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND
Acrylonitrile	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND
Acetone	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR
Benzene	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Bromodichloromethane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Bromoform	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Bromomethane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2-butanone	NR	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
carbon disulfide	NR	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Carbon tetrachloride	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Chlorobenzene	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Dibromochloromethane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Chloroethane	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2-chloroethylvinyl ether	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND
Chloroform	ND	ND	ND	ND	0.32J	ND	NR	0.87 J	ND	0.38 J	ND	ND	0.71 J	ND	1.2	ND	ND	1.2 J	0.38 J	1.2	ND	0.64 J	ND
Chloromethane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
cyclohexane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
1,2-dibromo-3-chloro-propane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
1,2-dibromomethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
1,2-dichlorobenzene	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND
1,3-dichlorobenzene	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND
1,4-dichlorobenzene	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND
dichlorodifluoromethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
1,1-dichloroethane	2.5	0.6	0.54J	0.50J	1.8	0.81	0.78 J	5.4 J	0.84 J	1.8	0.50 J	ND	1.2	3.8	4.6	2.9	4.9	5.5	2.7 J	6.9	0.88 J	4.9	2.0
1,2-dichloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.23 J	ND	ND	0.37 J	ND	ND	ND	ND	ND
1,1-dichloroethene	1.0	ND	ND	ND	0.86J	ND	0.20 J	0.53 J	ND	0.21 J	ND	ND	0.19 J	0.38 J	0.42 J	ND	0.39 J	0.95 J	0.37 J	1.3 J	0.21 J	0.85 J	0.40 J
cis-1,2-dichloroethene	0.46J	ND	ND	ND	1.6	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
trans-1,2-dichloroethene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2-dichloropropane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
cis-1,3-dichloropropene	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
trans-1,3-dichloropropene	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,4-dioxane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Ethylbenzene	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2-hexanone	NR	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
isopropylbenzene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
methyl acetate	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Methylene chloride	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.43 J	ND
methylcyclohexane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
4-methyl-2-pentanone	NR	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR
methyl-tert-butyl-ether	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
styrene	NR	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
1,1,2,2-tetrachloroethane	NR	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2,4-trichlorobenzene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Tetrachloroethene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.31 J	0.46 J	ND
Toluene	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1,1-trichloroethane	ND	ND	ND	ND	0.67J	ND	ND	0.66 J	ND	ND	ND	ND	ND	ND	0.29 J	ND	0.39 J	0.48 J	ND	0.60 J	ND	0.48 J	0.24 J
1,1,2-trichloroethane	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Trichloroethene	21	11	7.5	8.0	308	7.7	6.7	3.4 J	5.6	4.6	5.4	5.5	4.5	2.3	1.8	5.0	4.4	3.3	2.5	2.7	4.1	2.9	4.3
m,p-xylene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR
Trichlorofluoromethane	NR	NR	NR	NR	NR	NR	NR	ND	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND
Trichlorotrifluoroethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR
Trichlorofluoromethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR
o-xylene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR
1,1,2-trichloro-1,2,2-trifluoroethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Vinyl chloride	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
xylenes (total)	ND	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Mercury (EPA 245.1) ug/L	NR	<0.20	<0.20	<0.20	<0.20	<0.20	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
TSS (SM20 2540D) mg/L	NR	16.0	<4.0	<4.0	<4.0	<4.0	ND	11	6	5	ND	ND	ND	22	ND	ND	ND	9	5	5	ND	1.4	



## **FIGURES**

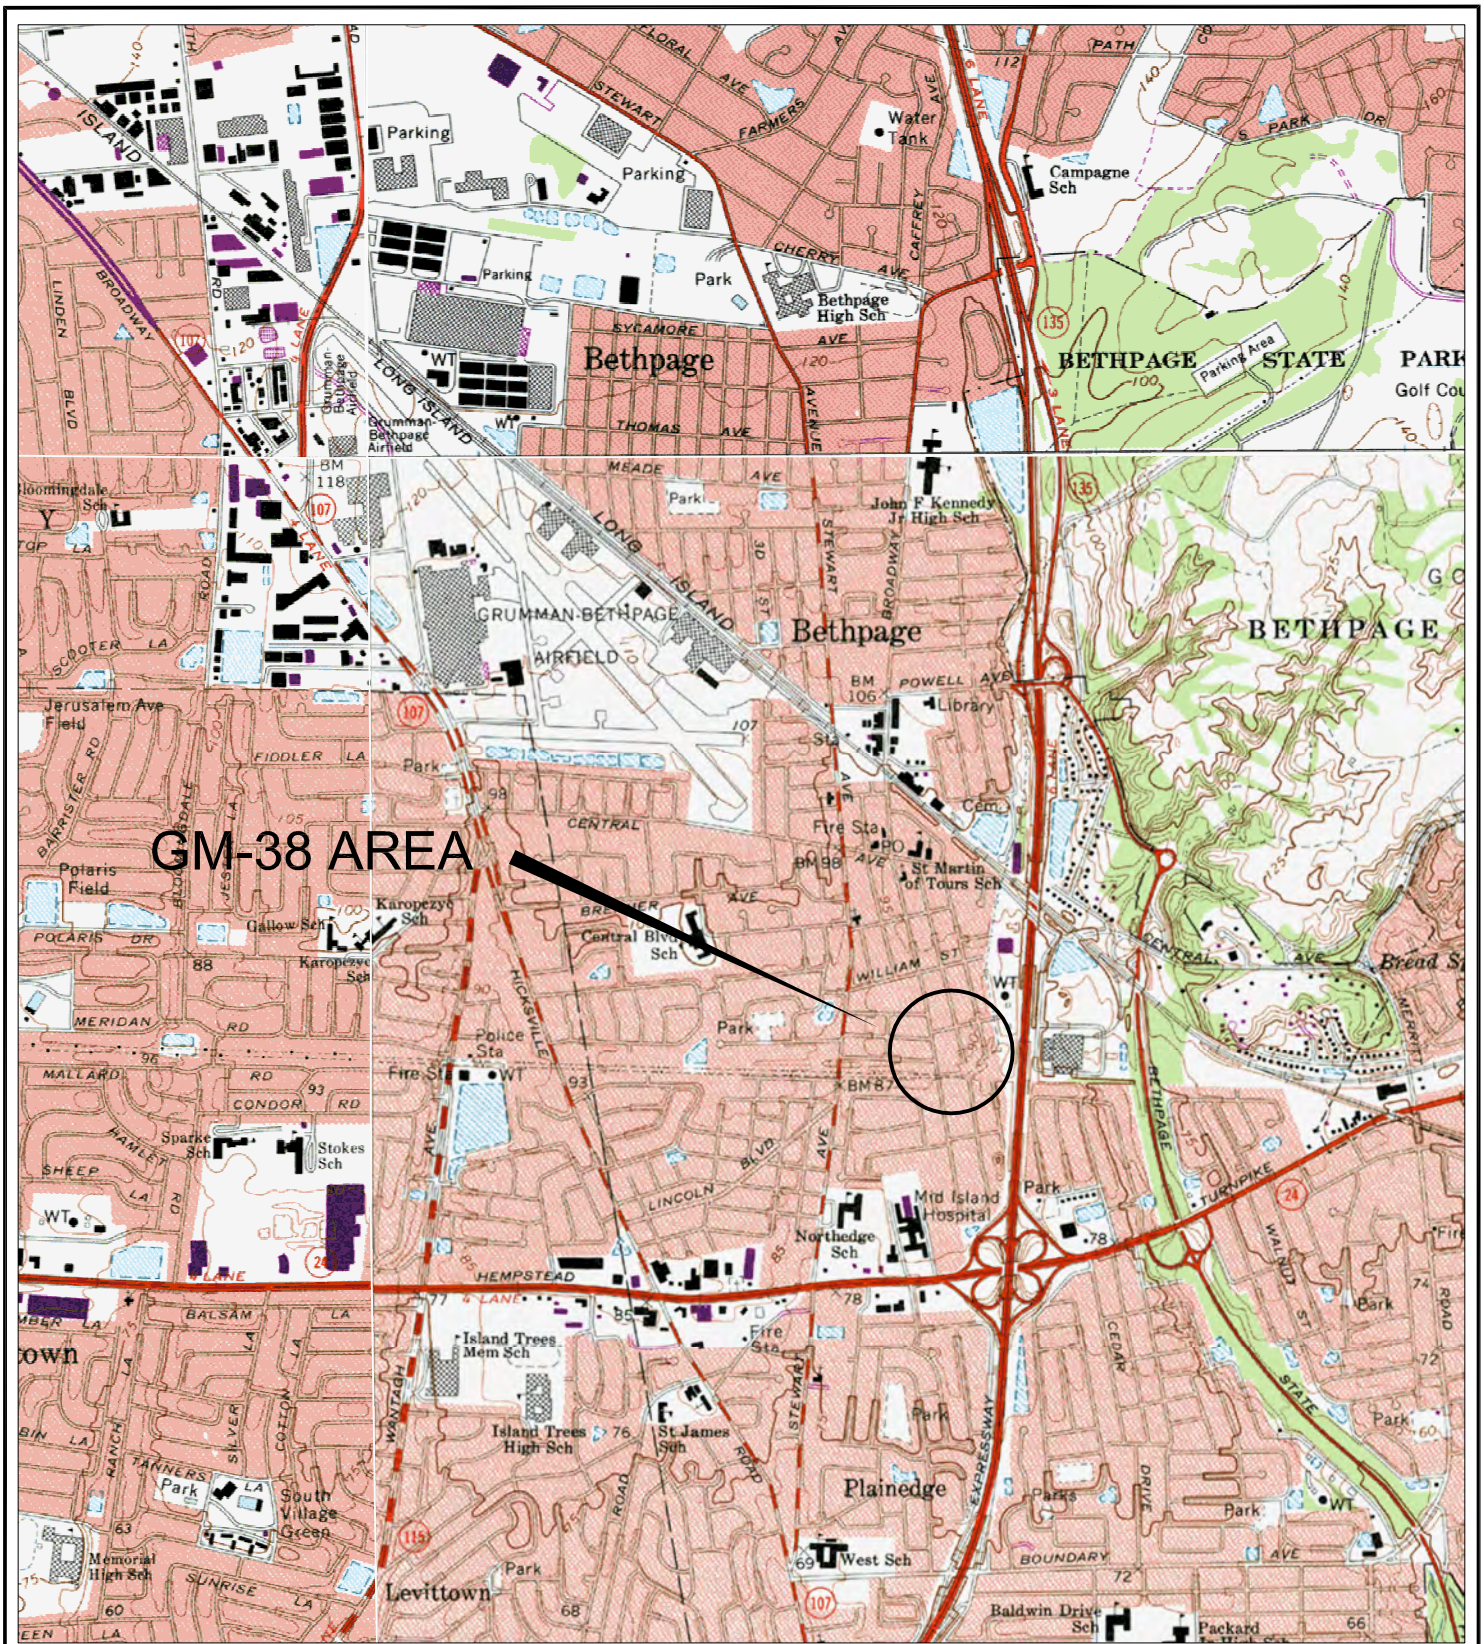


**GM-38 AREA**



Source: U.S.G.S. Topographic Maps (7.5 Minute)  
Amityville, Freeport, Hicksville, Huntington, NY Quadrangles

U.S. Navy RAC  
Engineering Field Activity, Northeast  
GM-38 Area (Offsite)  
NWIRP Bethpage  
Bethpage, NY

Figure 1  
Site Location Map

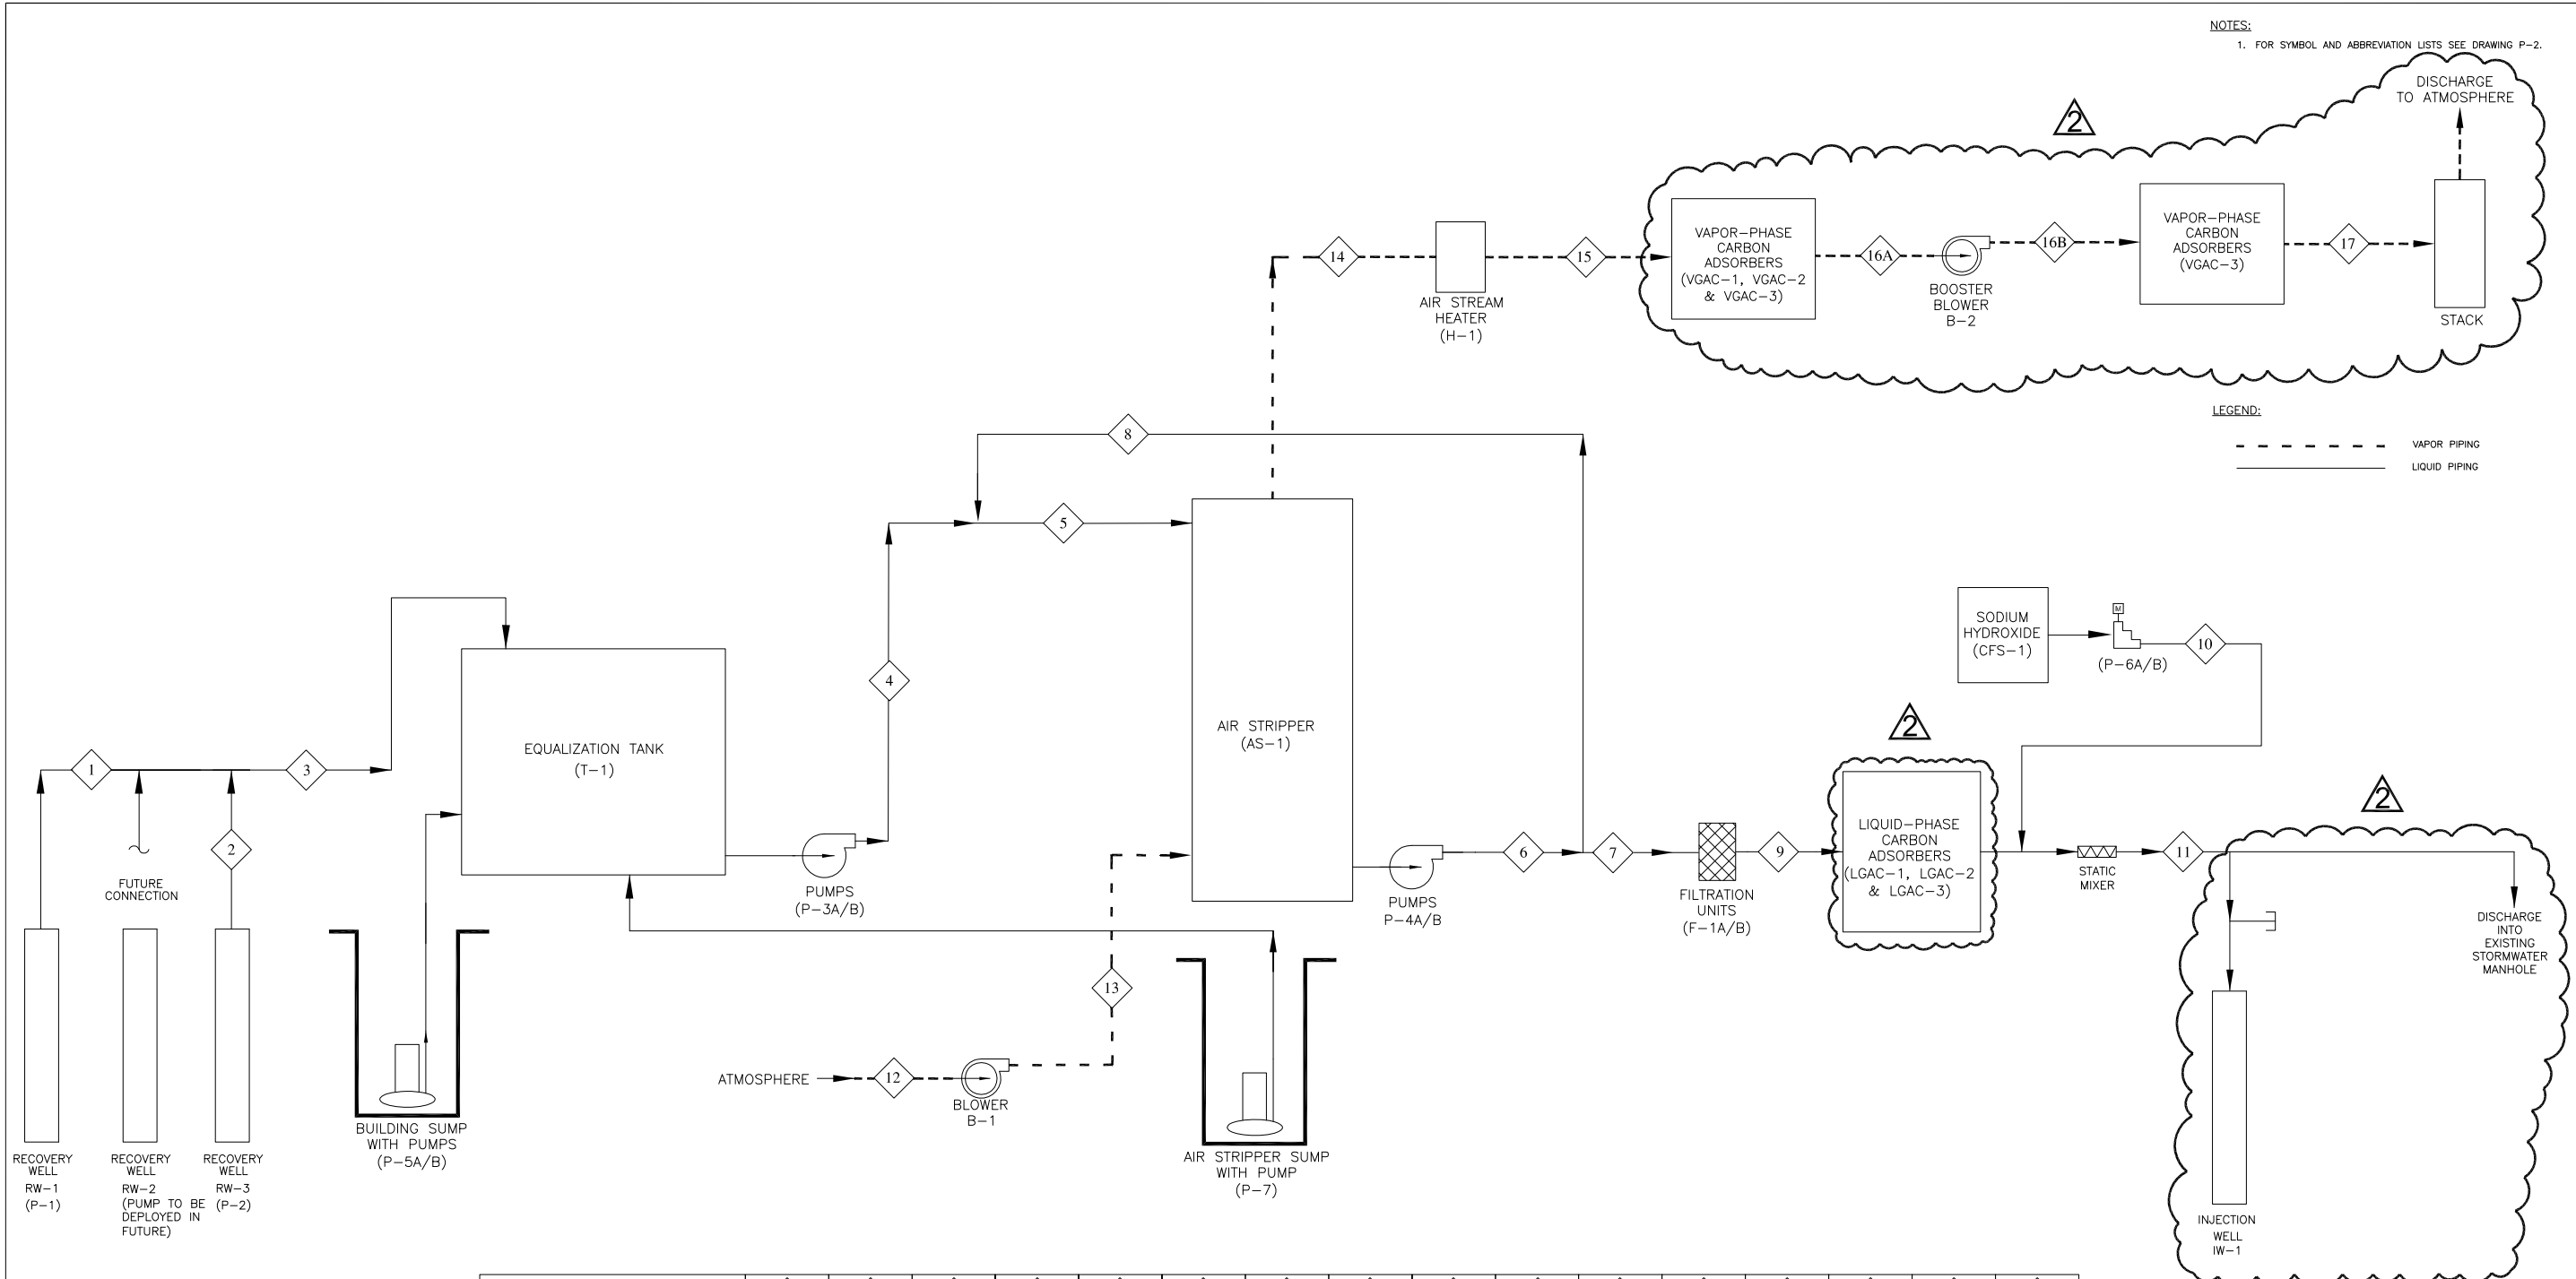

NOTES:  
 1. FOR SYMBOL AND ABBREVIATION LISTS SEE DRAWING P-2.

LEGEND:  
 --- VAPOR PIPING  
 ——— LIQUID PIPING

STREAM NO.	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
COMPOSITION (UG/L, UNLESS OTHERWISE NOTED)																
BENZENE	4	4	4	4	3	-	-	-	-	-	-	-	-	-	-	-
TOLUENE	15	15	15	15	12	-	-	-	-	-	-	-	-	-	-	-
XYLENES, TOTAL	16	16	16	16	12	-	-	-	-	-	-	-	-	-	-	-
1,2-DICHLOROETHANE	3	3	3	3	2.8	-	-	-	-	-	2.7	E-07	-	-	-	-
cis 1,2-DICHLOROETHENE	1100	1100	1100	1100	1008	0.10	0.10	0.10	0.10	-	1.0	E-04	-	-	-	-
VINYL CHLORIDE	300	300	300	300	275	0.03	0.03	0.03	0.03	-	2.7	E-05	-	-	-	-
TETRACHLOROETHENE (PCE)	900	900	900	900	825	0.08	0.08	0.08	0.08	-	8.2	E-05	-	-	-	-
TRICHLOROETHENE (TCE)	3400	3400	3400	3400	3117	3.12	3.12	3.12	3.12	-	3.1	E-03	-	-	-	-
WATER FLOW RATE (GPM)	800	300	1100	1100	1200	1200	1100	100	1100	1.1 gpd	1100	-	-	-	-	-
TEMPERATURE (°F)	55	55	55	55	55	55	55	55	55	60	55	-	-	-	-	-
PRESSURE (PSIG)	-	-	-	-	-	-	-	-	-	-	-	-0.27	1.50	1.36	1.18	0.53
DENSITY (lb/ft³)	-	-	-	-	-	-	-	-	-	95.5	-	0.077	0.085	0.084	0.082	0.079
MASS FLOW RATE (lb/hr)	400364	150136	550500	550500	600545	600545	550500	50,045	550500	0.59	550500	36,960	40,800	40,320	39,360	37,920
RELATIVE HUMIDITY (%)	-	-	-	-	-	-	-	-	-	-	-	50	50	100	50	50
STATIC PRESSURE (PSIA)	-	-	-	-	-	-	-	-	-	-	-	0.214	0.214	0.214	0.275	0.275
pH (S.U.)	5.5	5.5	5.5	5.5	5.5	6.0	6.0	6.0	6.0	14	7.0	-	-	-	-	-
VAPOR FLOW RATE (CFM)	-	-	-	-	-	-	-	-	-	-	-	8000	8000	8000	8000	8000
TOTAL VAPOR VOC (PPMV)	-	-	-	-	-	-	-	-	-	-	-	-	-	25.5	25.5	1.2
TOTAL VAPOR VOC (LBS/HR)	-	-	-	-	-	-	-	-	-	-	-	-	-	3.18	3.18	0.15

THIS DRAWING PRODUCED ON AUTOCAD DO NOT REVISE MANUALLY


THIS DOCUMENT IS THE PROPERTY OF NAVAL FACILITIES ENGINEERING COMMAND, PREPARED BY TETRA TECH EC, INC., AND IS PROVIDED UPON THE CONDITION THAT IT WILL NOT BE REPRODUCED, COPIED, OR ISSUED TO A THIRD PARTY, AND WILL BE USED SOLELY FOR THE ORIGINAL INTENDED PURPOSE AND SOLELY FOR THE EXECUTION OR REVIEW OF THE ENGINEERING CONSTRUCTION OF THE PROJECT.

IT IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW, ARTICLE 145, FOR ANY PERSON UNLESS UNDER THE DIRECTION OF A NEW YORK STATE LICENSED PROFESSIONAL ENGINEER, TO ALTER AN ITEM ON THIS DOCUMENT IN ANY WAY.


TETRA TECH ENGINEERING CORPORATION PC			
DATE	05/05/06	DATE	05/05/06
PREP BY	DLB	DATE	03/31/08
APPROVD	BKE	DATE	02/24/09
REV	1	DESCRIPTION	FINAL DESIGN
REV	2	DESCRIPTION	ADDED FUTURE CONNECTION TO FUTURE SUBMITTALS, REVISED BASED ON VENDOR SUBMITTALS, DRAWING UPDATES FOR CONSTRUCTION.
DEPARTMENT OF THE NAVY	NAVAL WEAPONS INDUSTRIAL RESERVE PLANT	ENGINEERING FIELD ACTIVITY - NORTHEAST	STATE
LESTER	BETHPAGE, NEW YORK	GM-38 AREA	PENNSYLVANIA
		GROUNDWATER TREATMENT PLANT	
		PROCESS FLOW DIAGRAM - GROUNDWATER AND OFF-GAS TREATMENT	
APPROVED		DATE	
SAT TO		DATE	
CODE	LD. NO.		80091
SPEC.	NO.		
CONSTR.	CONTR. NO.		N62472-99-D-0032
NAVFAC	DRAWING NO.		Figure 2
SHEET	OF	DIS. SH. NO.	
D	1-4		

**Legend**

- Monitoring Well (Monitored by Navy)
- Monitoring Well (Monitored by Northrop Grumman)
- ⊠ Recovery Well
- ⊠ Injection Well

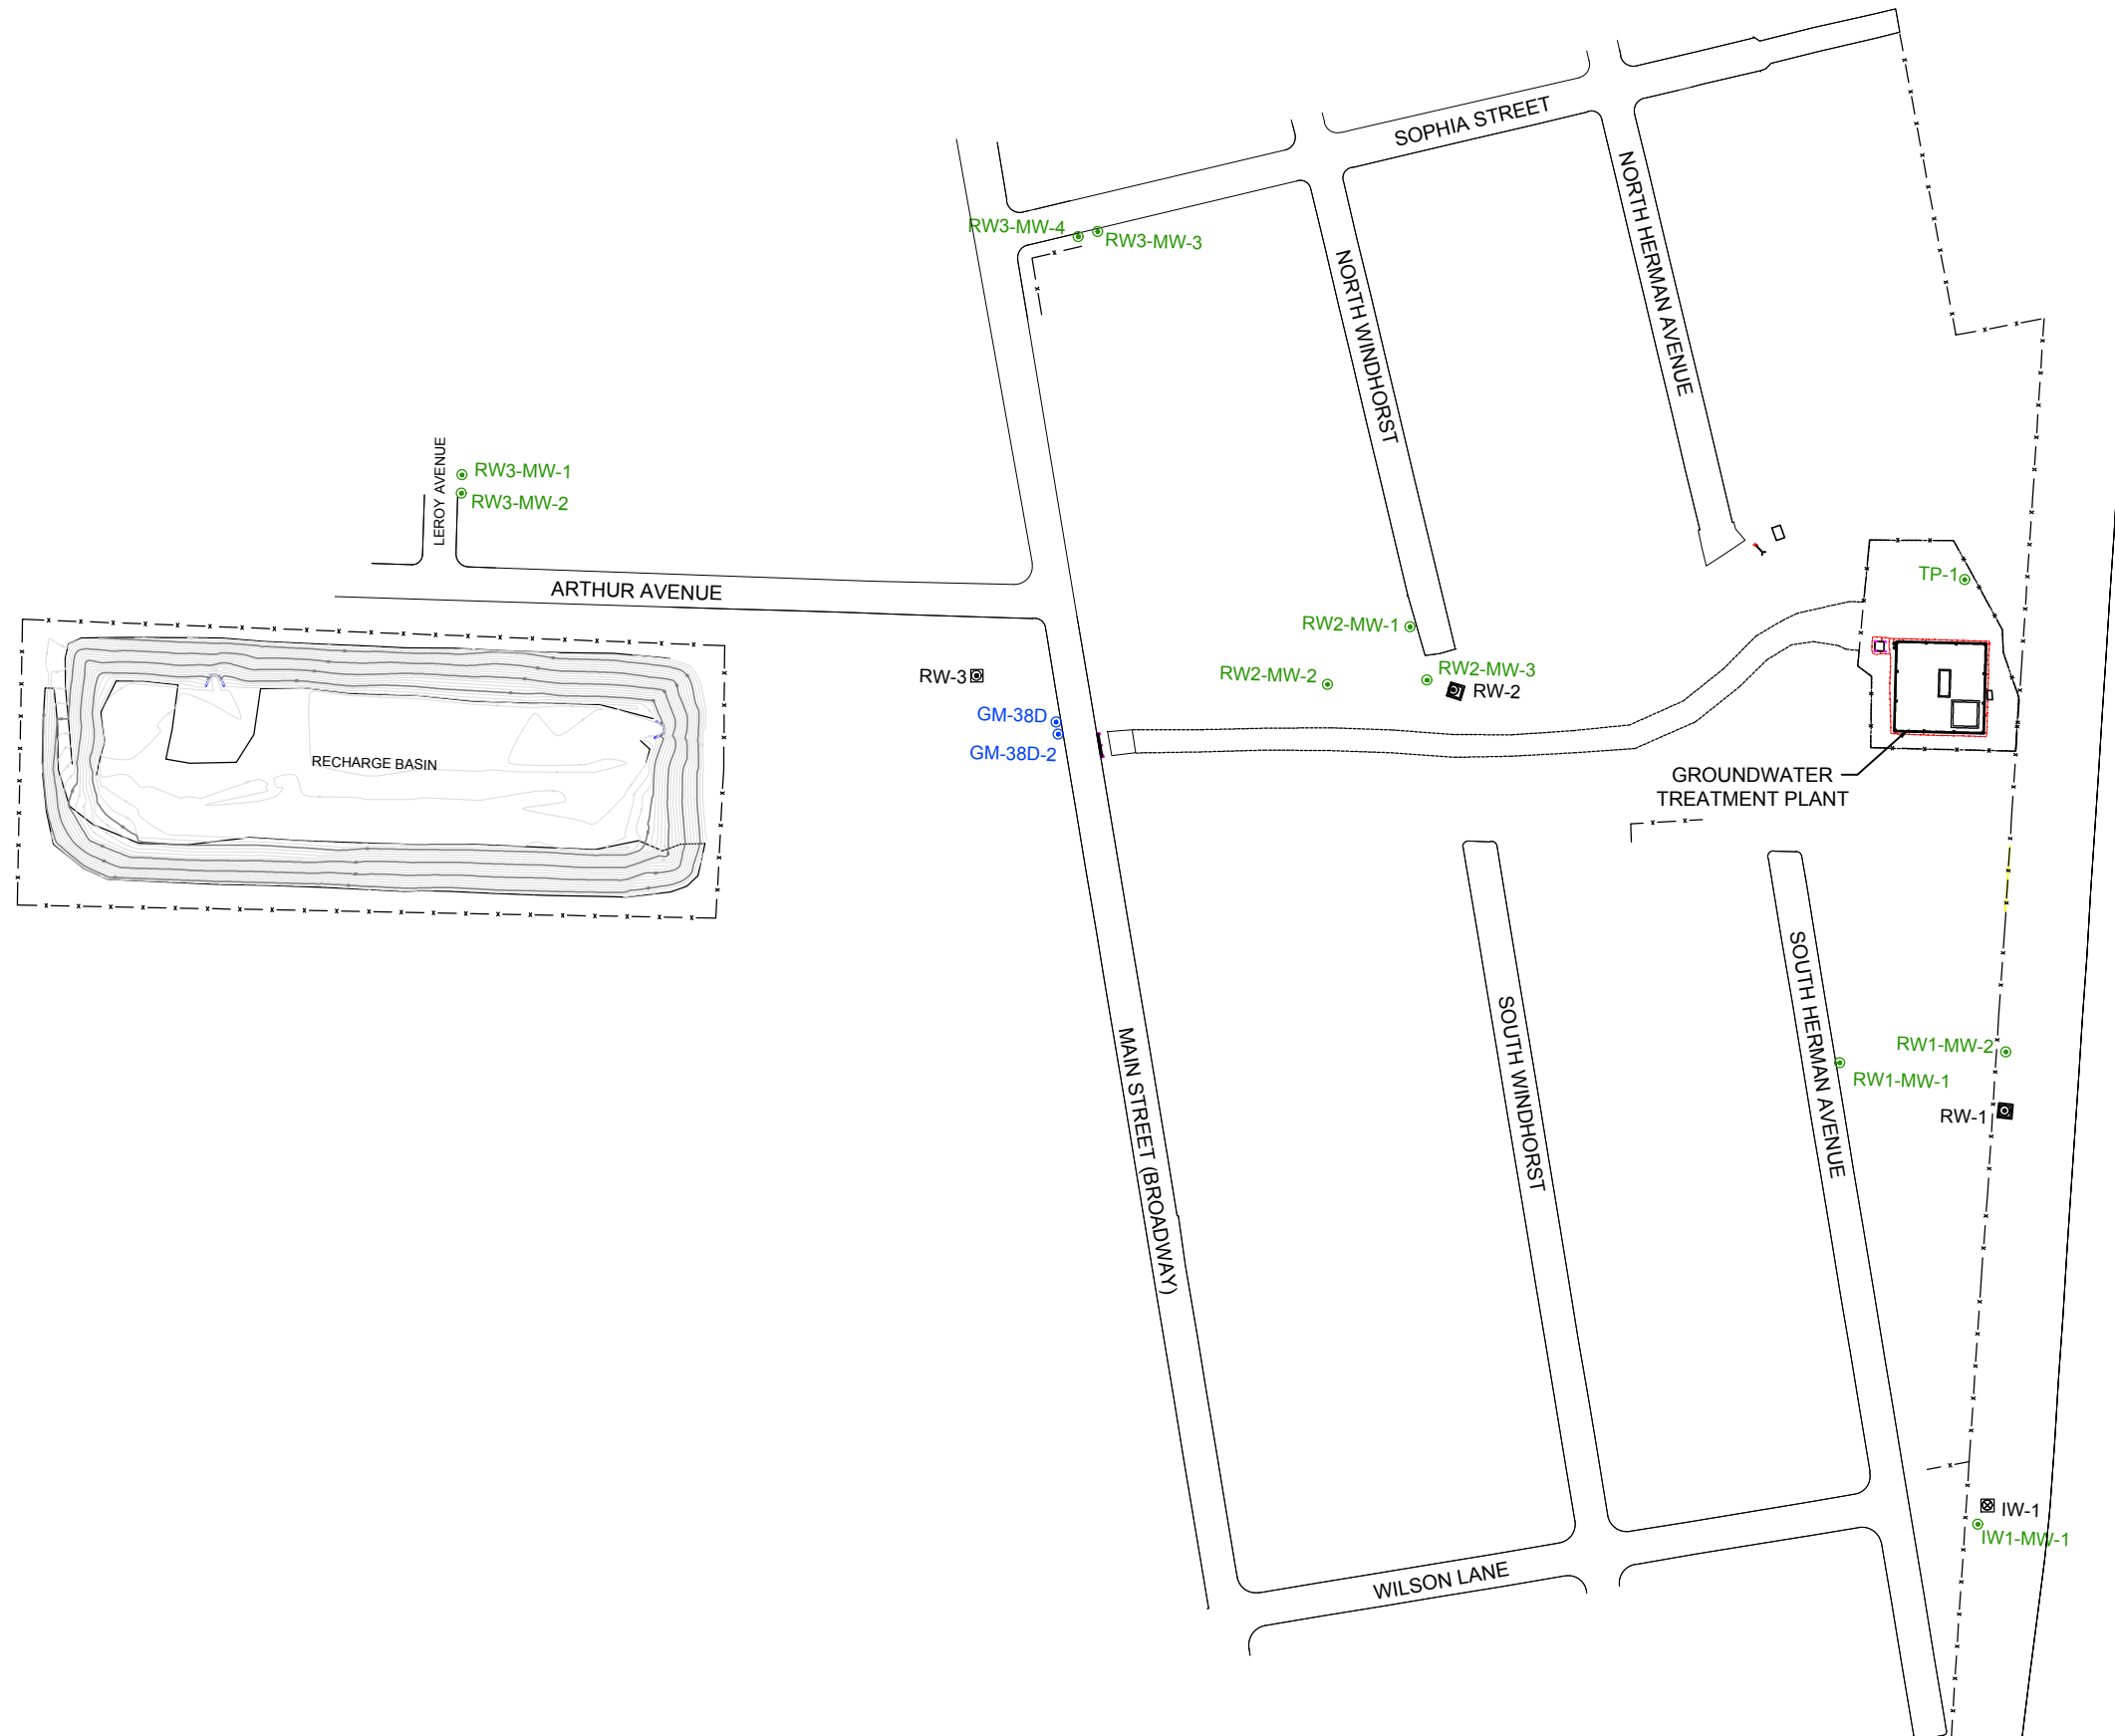


(SEAFORD-OYSTER BAY EXPRESSWAY - RTE 135)

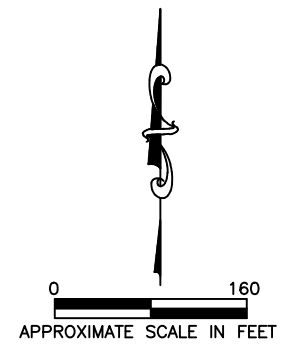

<b>SITE MAP</b>			
<b>NWIRP BETHPAGE GM-38 AREA BETHPAGE, NEW YORK</b>			
KOMAN Government Solutions, LLC 160 East Main Street, Suite 2F, Westborough, MA 01581			
SCALE	DATE	FIGURE	
SEE BARSCALE	4/26/2016	3	



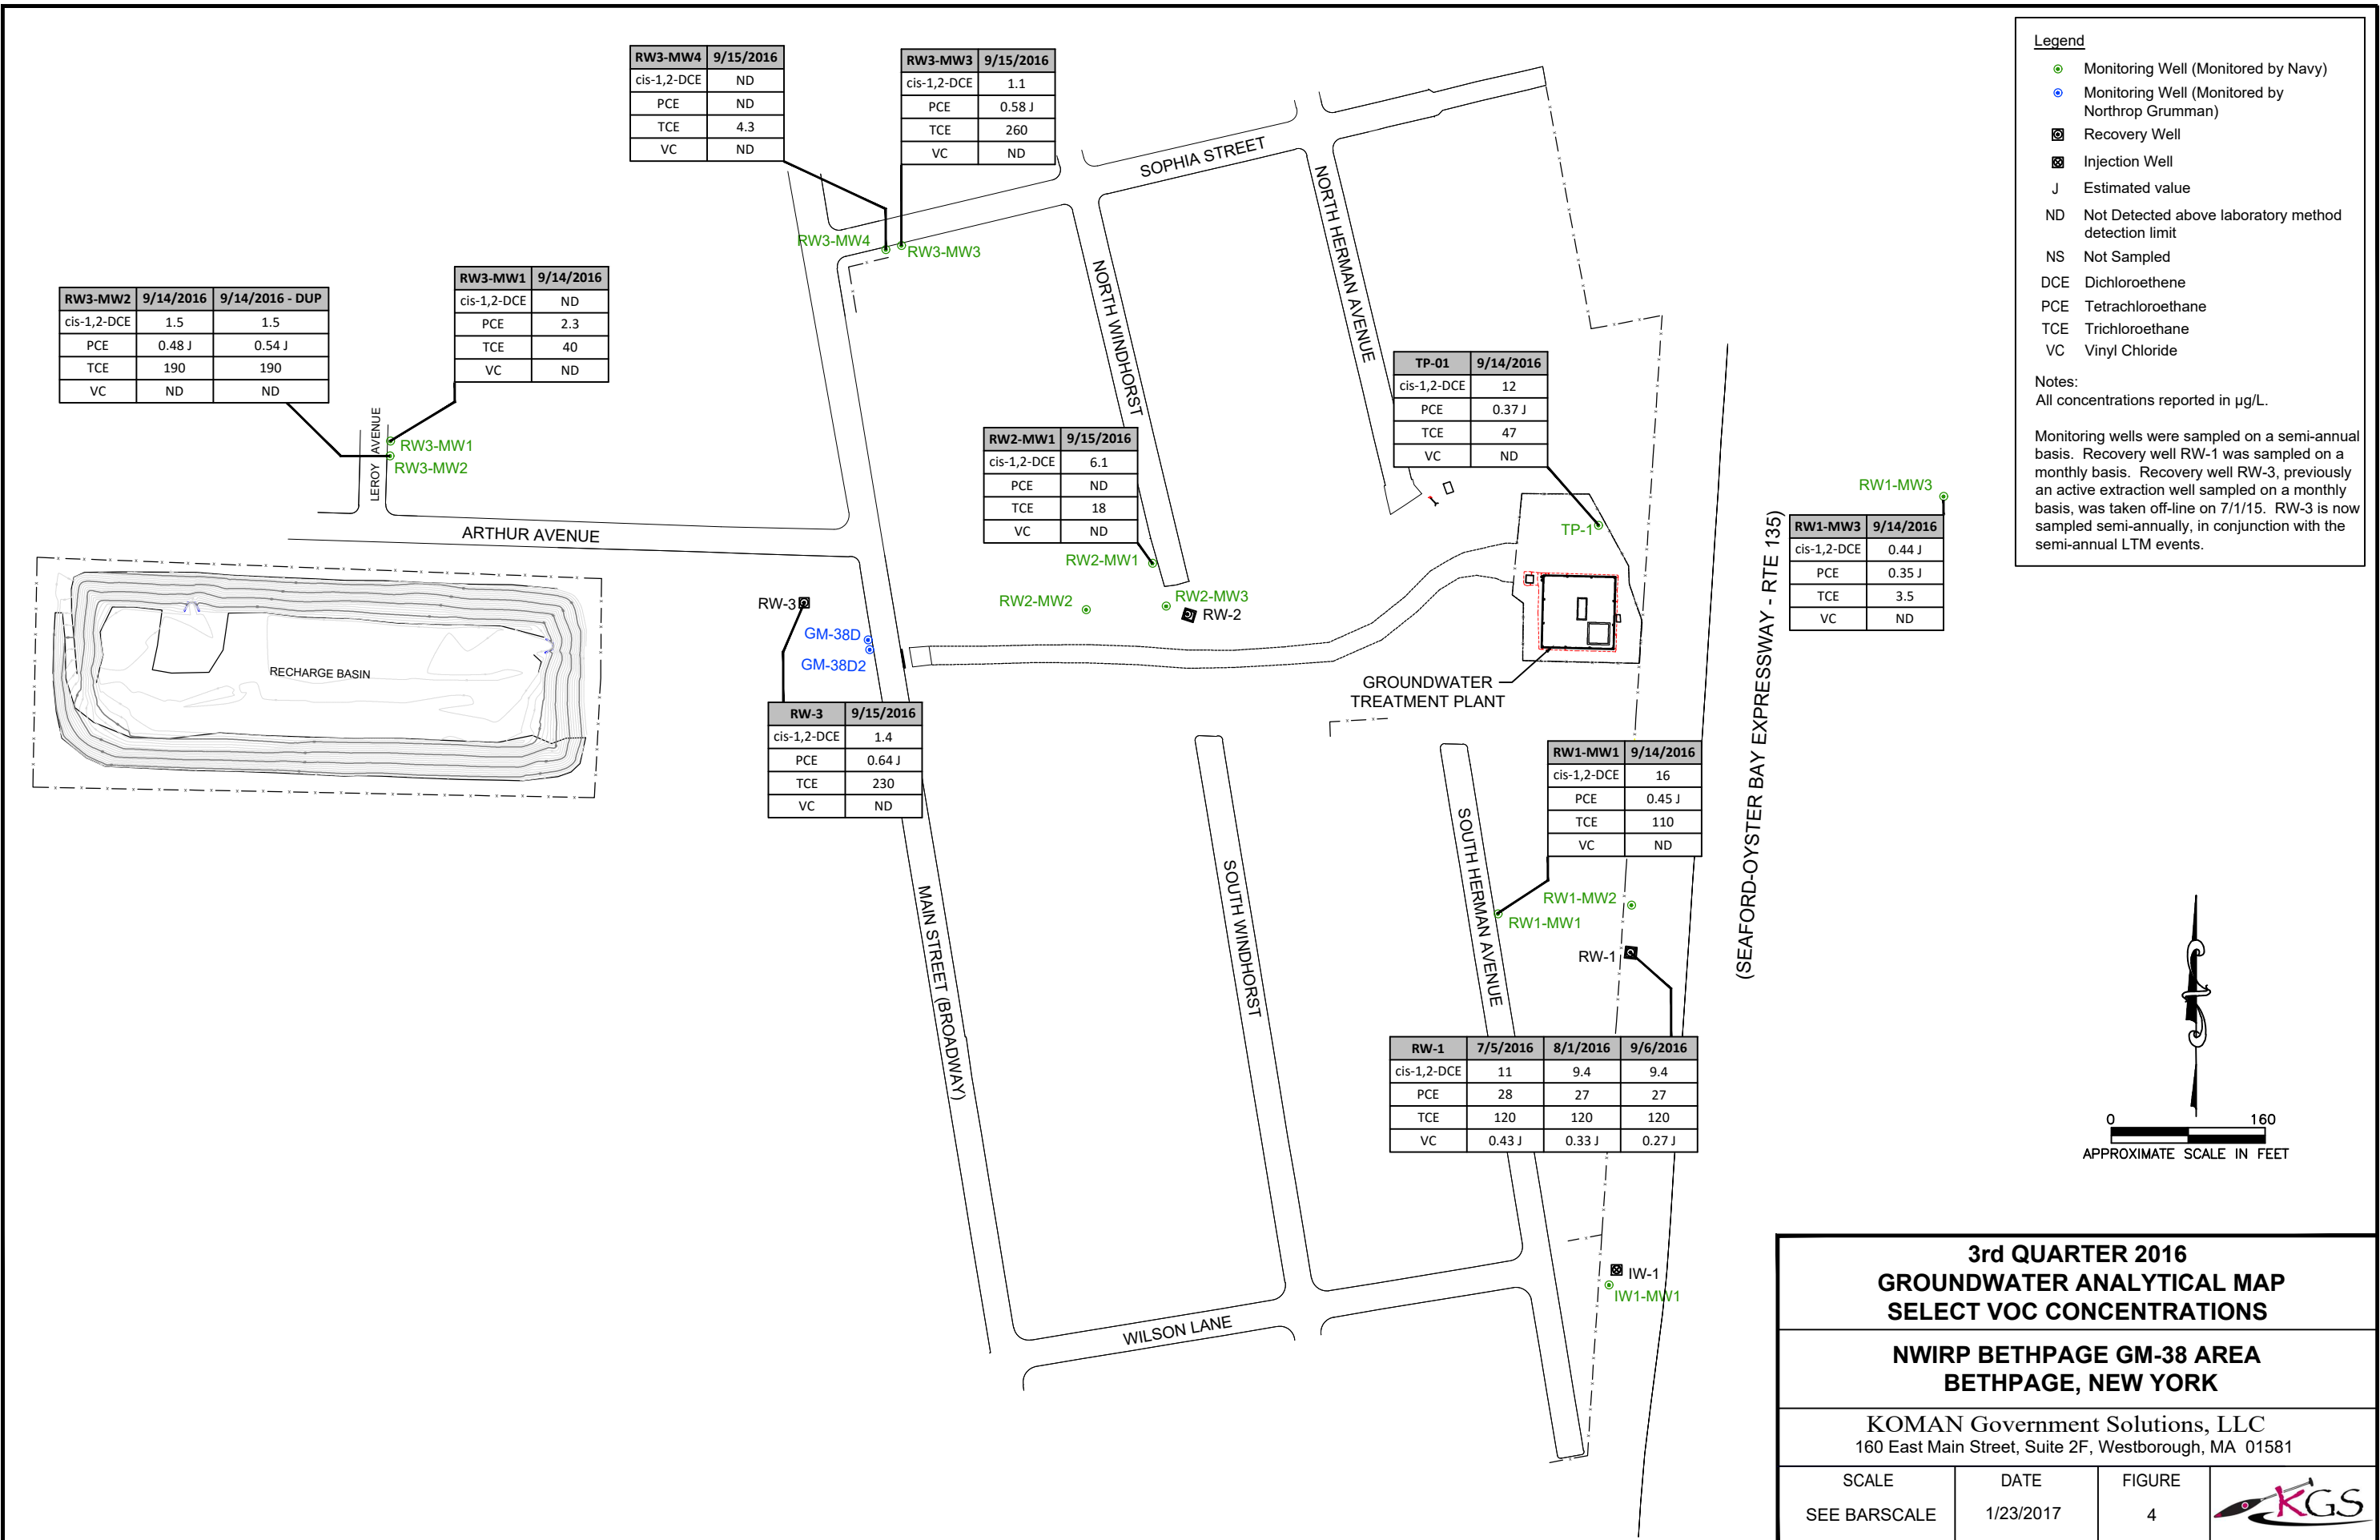

**Legend**

- Monitoring Well (Monitored by Navy)
- Monitoring Well (Monitored by Northrop Grumman)
- ⊠ Recovery Well
- ⊠ Injection Well
- J Estimated value
- ND Not Detected above laboratory method detection limit
- NS Not Sampled
- DCE Dichloroethene
- PCE Tetrachloroethane
- TCE Trichloroethane
- VC Vinyl Chloride

**Notes:**  
All concentrations reported in µg/L.

Monitoring wells were sampled on a semi-annual basis. Recovery well RW-1 was sampled on a monthly basis. Recovery well RW-3, previously an active extraction well sampled on a monthly basis, was taken off-line on 7/1/15. RW-3 is now sampled semi-annually, in conjunction with the semi-annual LTM events.

RW3-MW2	9/14/2016	9/14/2016 - DUP
cis-1,2-DCE	1.5	1.5
PCE	0.48 J	0.54 J
TCE	190	190
VC	ND	ND

RW3-MW1	9/14/2016
cis-1,2-DCE	ND
PCE	2.3
TCE	40
VC	ND

RW3-MW4	9/15/2016
cis-1,2-DCE	ND
PCE	ND
TCE	4.3
VC	ND

RW3-MW3	9/15/2016
cis-1,2-DCE	1.1
PCE	0.58 J
TCE	260
VC	ND

RW2-MW1	9/15/2016
cis-1,2-DCE	6.1
PCE	ND
TCE	18
VC	ND


TP-01	9/14/2016
cis-1,2-DCE	12
PCE	0.37 J
TCE	47
VC	ND

RW-3	9/15/2016
cis-1,2-DCE	1.4
PCE	0.64 J
TCE	230
VC	ND

RW1-MW1	9/14/2016
cis-1,2-DCE	16
PCE	0.45 J
TCE	110
VC	ND


RW-1	7/5/2016	8/1/2016	9/6/2016
cis-1,2-DCE	11	9.4	9.4
PCE	28	27	27
TCE	120	120	120
VC	0.43 J	0.33 J	0.27 J

RW1-MW3	9/14/2016
cis-1,2-DCE	0.44 J
PCE	0.35 J
TCE	3.5
VC	ND

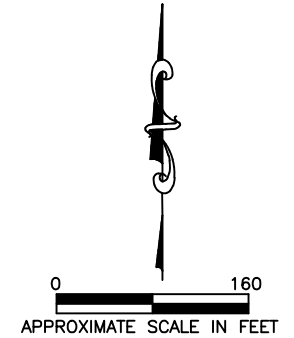


<b>3rd QUARTER 2016 GROUNDWATER ANALYTICAL MAP SELECT VOC CONCENTRATIONS</b>			
<b>NWIRP BETHPAGE GM-38 AREA BETHPAGE, NEW YORK</b>			
KOMAN Government Solutions, LLC 160 East Main Street, Suite 2F, Westborough, MA 01581			
SCALE	DATE	FIGURE	
SEE BARSCALE	1/23/2017	4	


Figure 5  
GM-38 Area Groundwater Remediation  
Naval Weapons Industrial Reserve Plant - Bethpage, NY  
Groundwater Concentration Trends of Select VOCs  
RW1

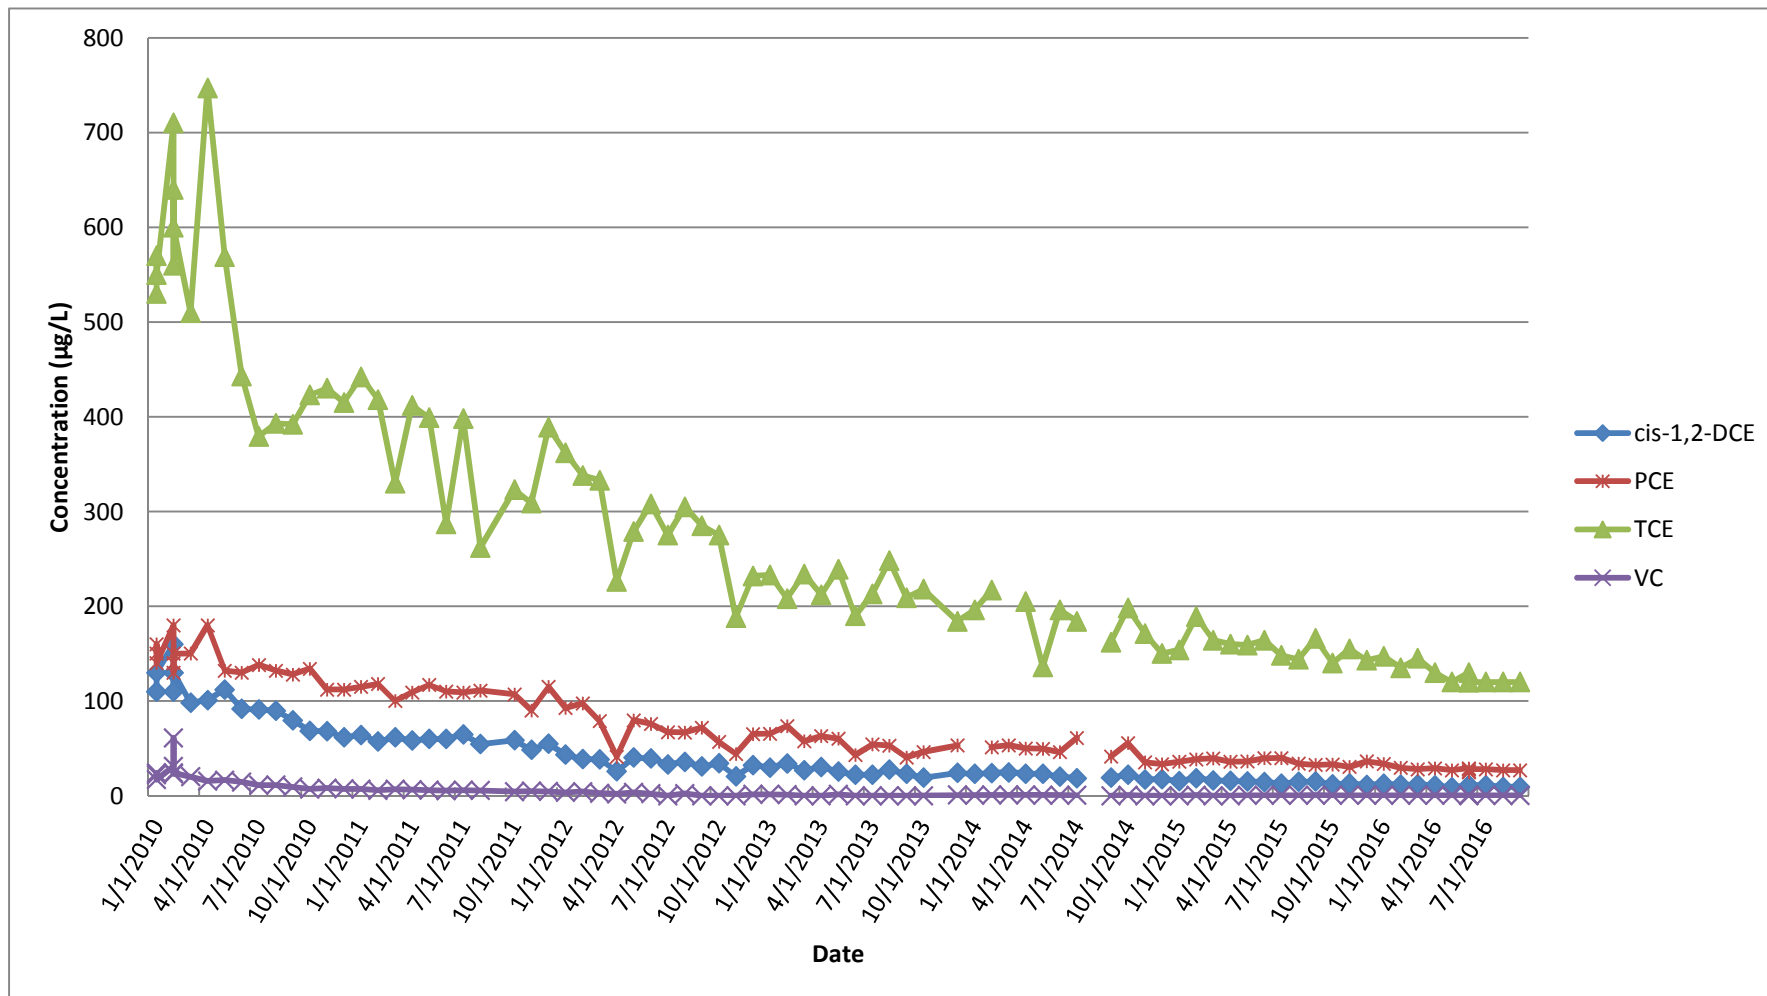


**Figure 6**  
**GM-38 Area Groundwater Remediation**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Groundwater Concentration Trends of Select VOCs**  
**RW3**

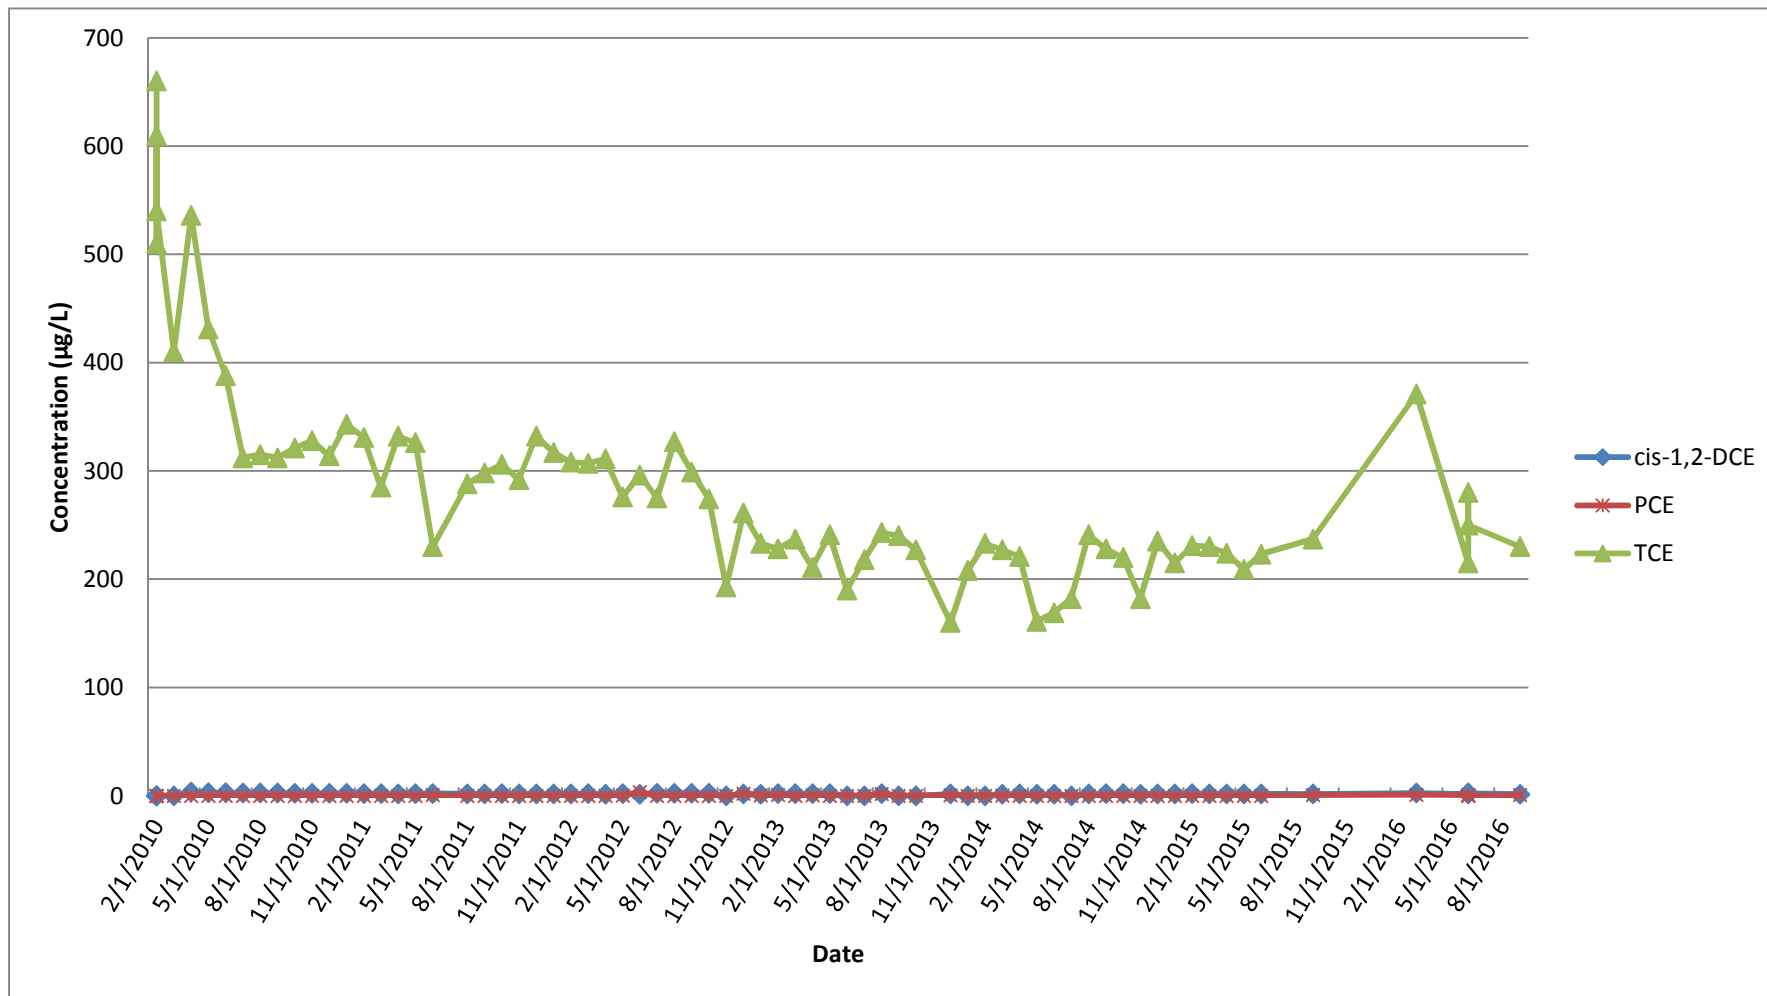


**Figure 7**  
**GM-38 Area Groundwater Remediation**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Groundwater Concentration Trends of Select VOCs**  
**RW1-MW1**

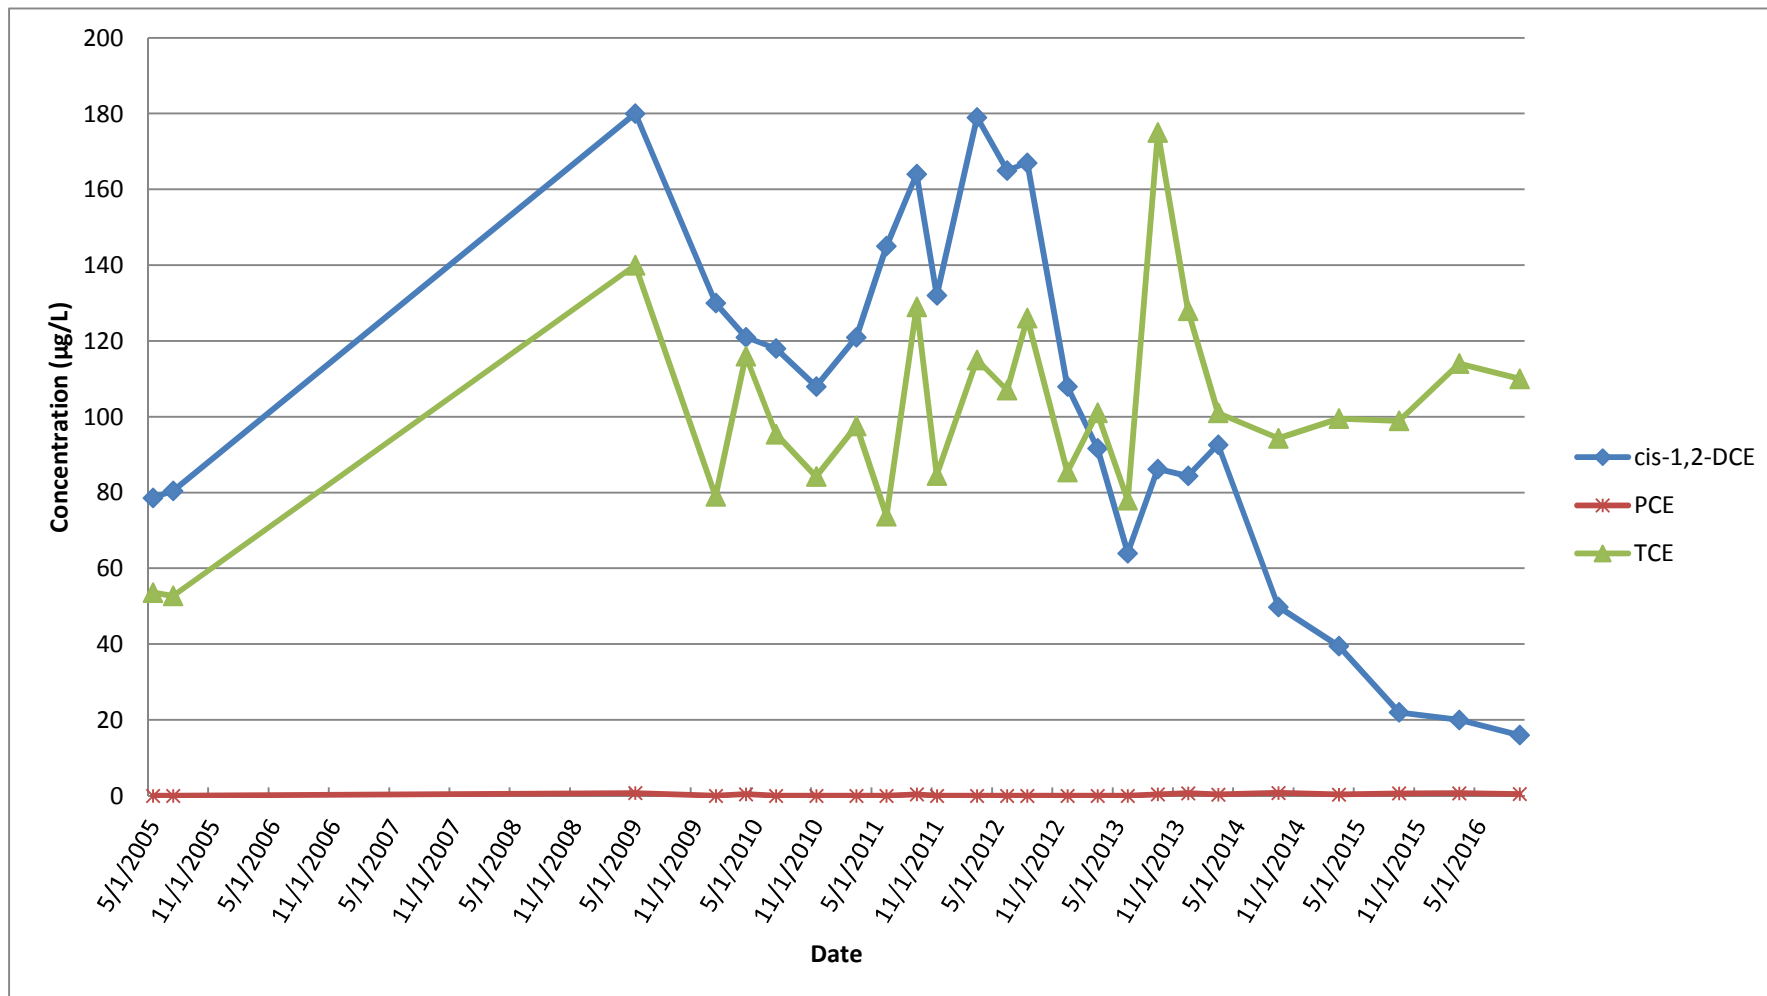

**Figure 8**  
**GM-38 Area Groundwater Remediation**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Groundwater Concentration Trends of Select VOCs**  
**RW1-MW3**

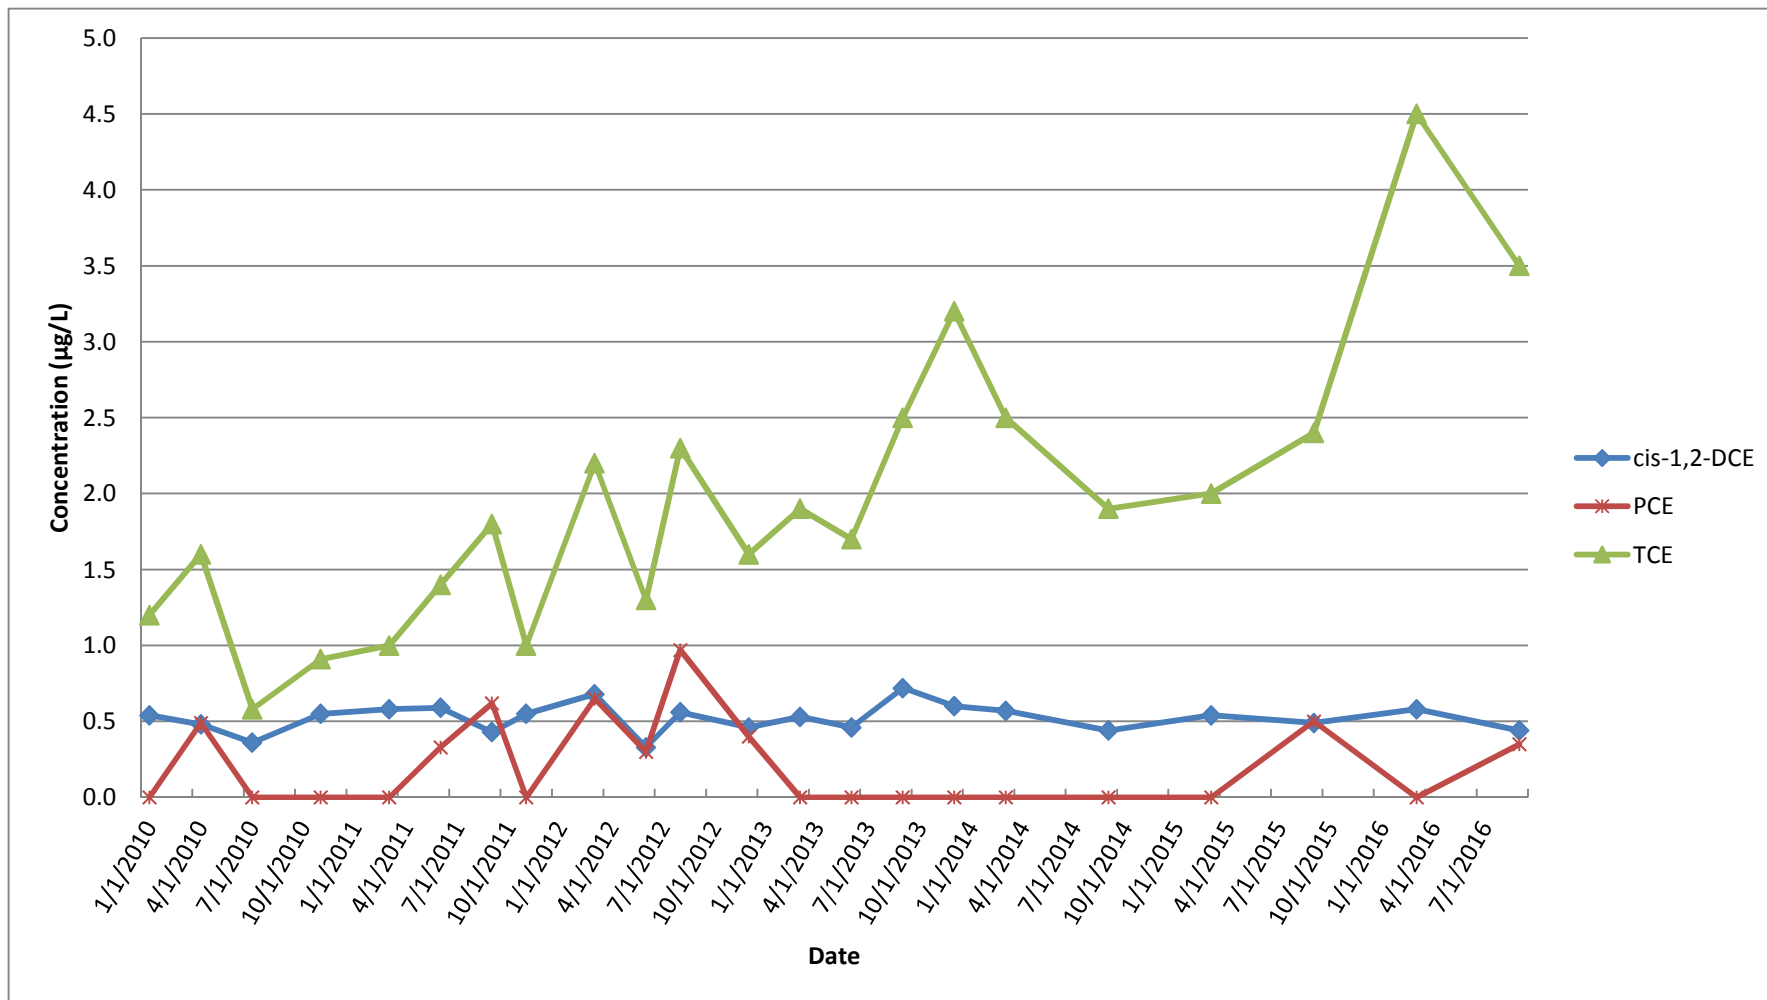

**Figure 9**  
**GM-38 Area Groundwater Remediation**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Groundwater Concentration Trends of Select VOCs**  
**RW2-MW1**

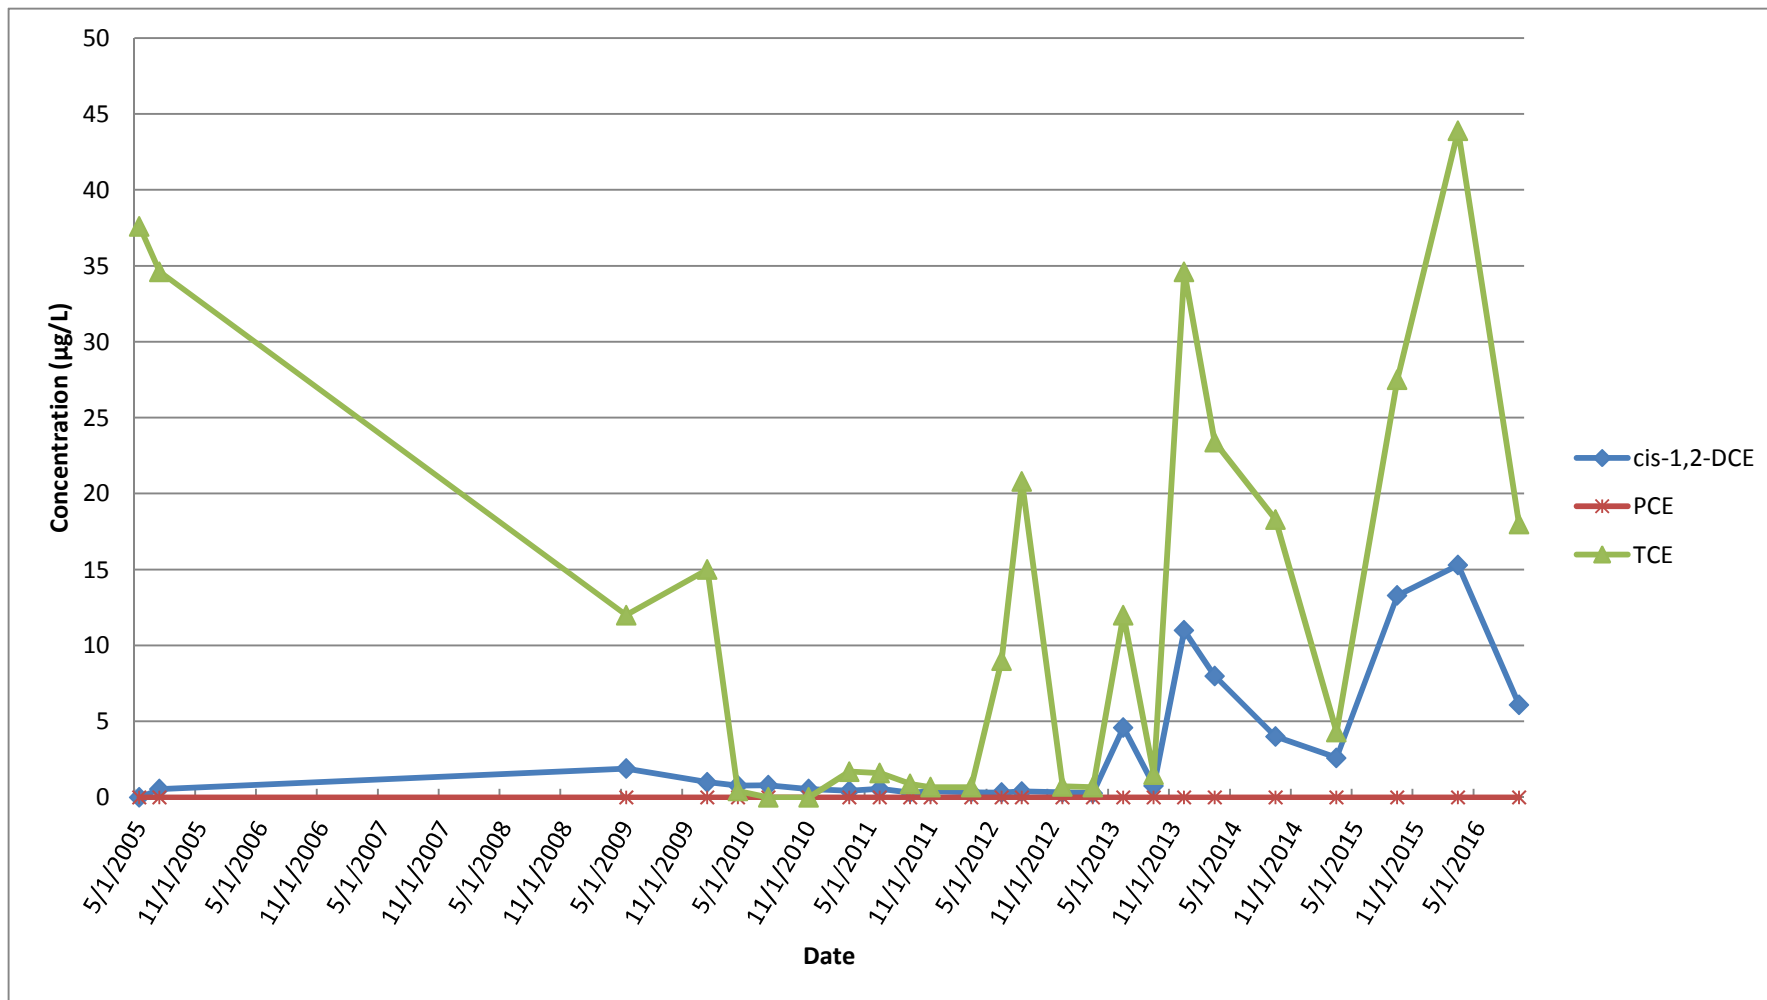

**Figure 10**  
**GM-38 Area Groundwater Remediation**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Groundwater Concentration Trends of Select VOCs**  
**RW3-MW1**



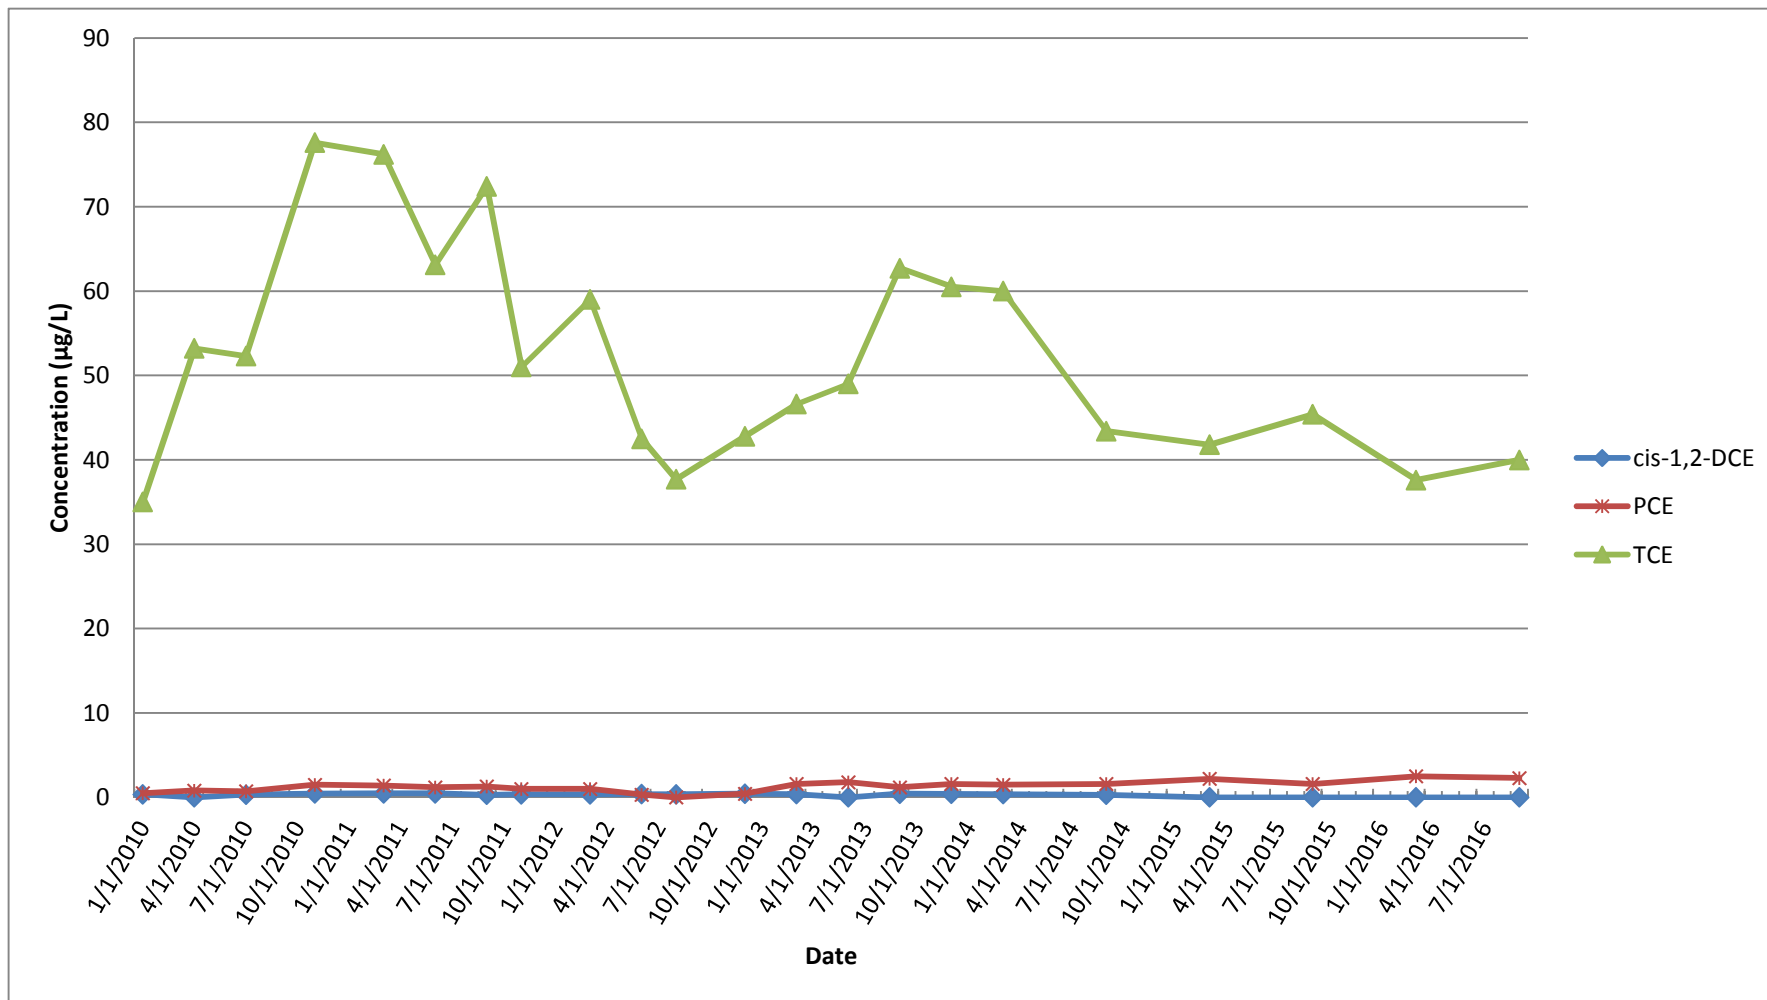


Figure 11  
GM-38 Area Groundwater Remediation  
Naval Weapons Industrial Reserve Plant - Bethpage, NY  
Groundwater Concentration Trends of Select VOCs  
RW3-MW2




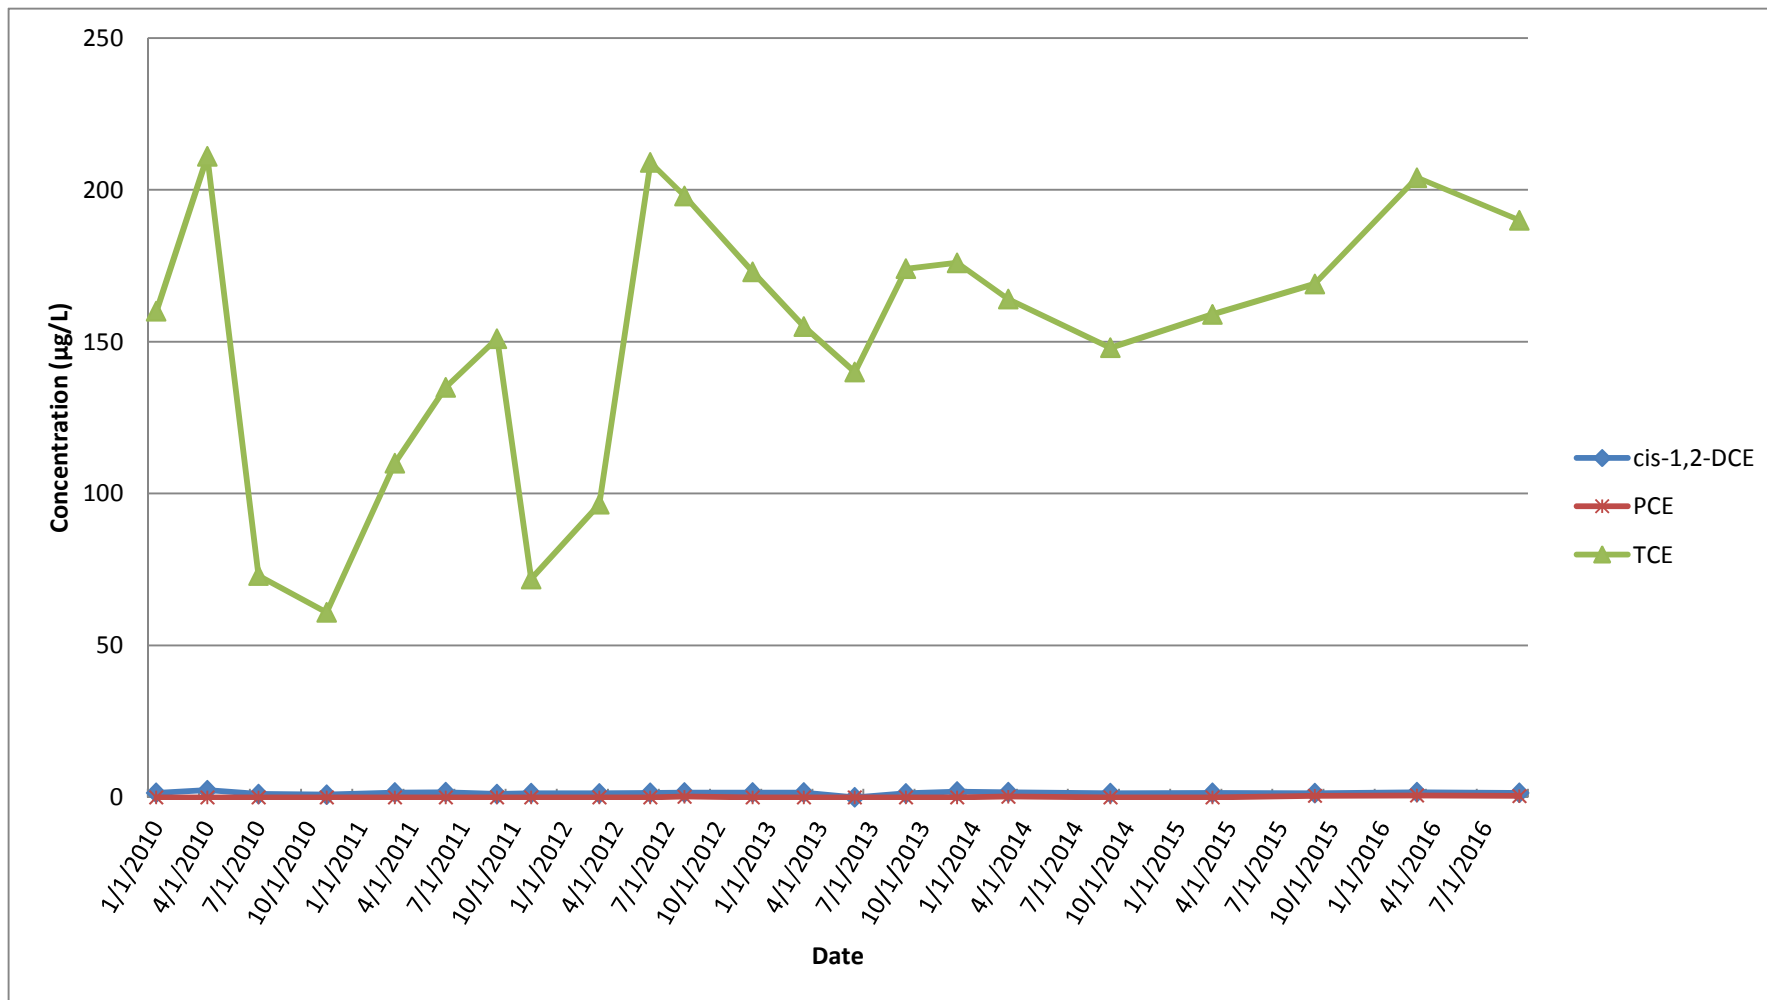


**Figure 12**  
**GM-38 Area Groundwater Remediation**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Groundwater Concentration Trends of Select VOCs**  
**RW3-MW3**

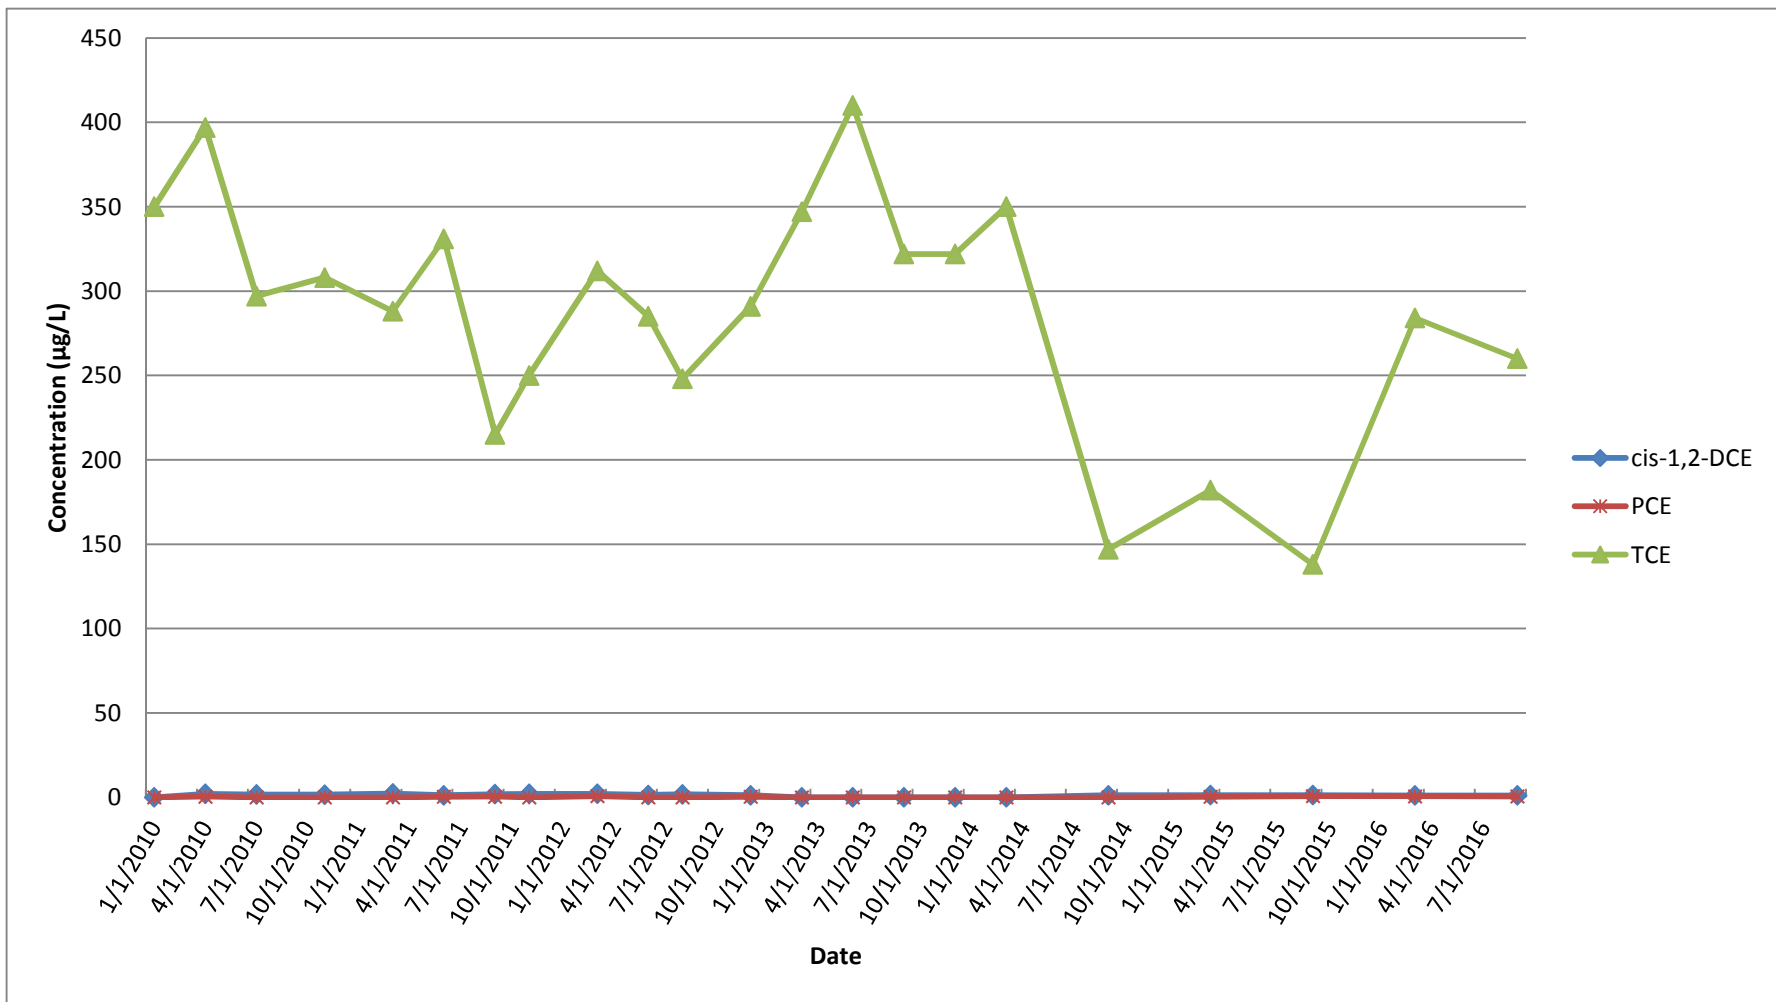

**Figure 13**  
**GM-38 Area Groundwater Remediation**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Groundwater Concentration Trends of Select VOCs**  
**RW3-MW4**

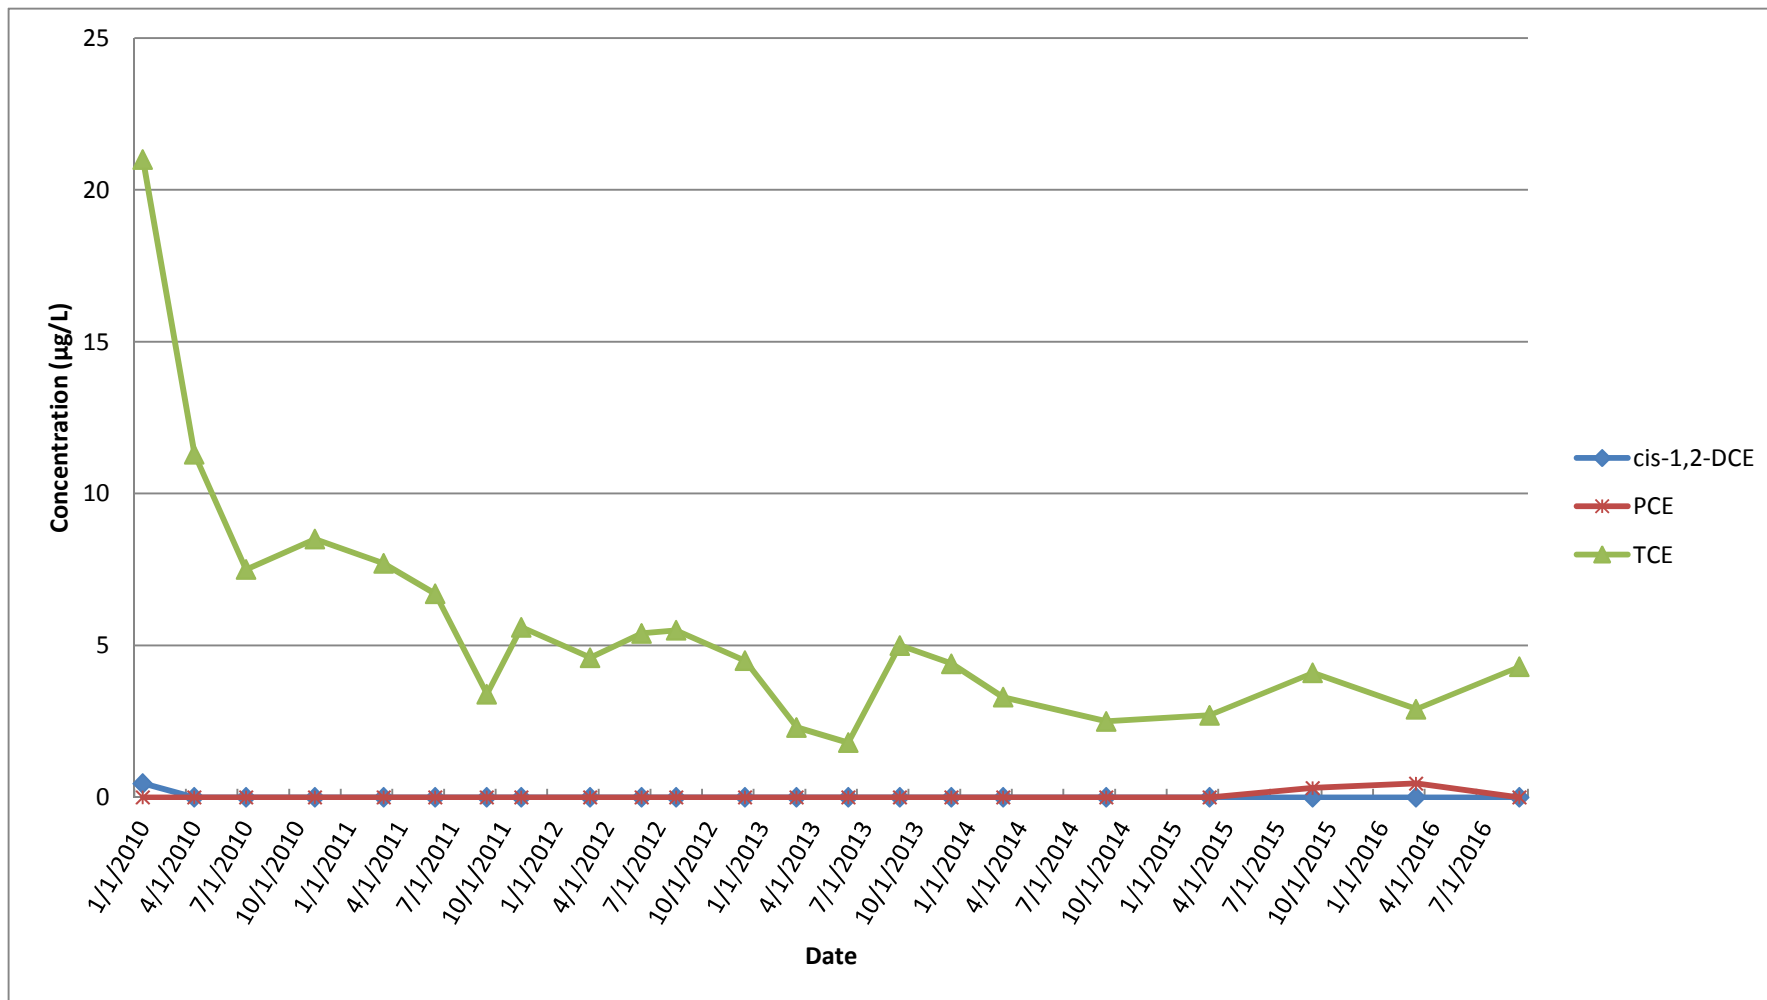

**Figure 14**  
**GM-38 Area Groundwater Remediation**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Groundwater Concentration Trends of Select VOCs**  
**TP-01**

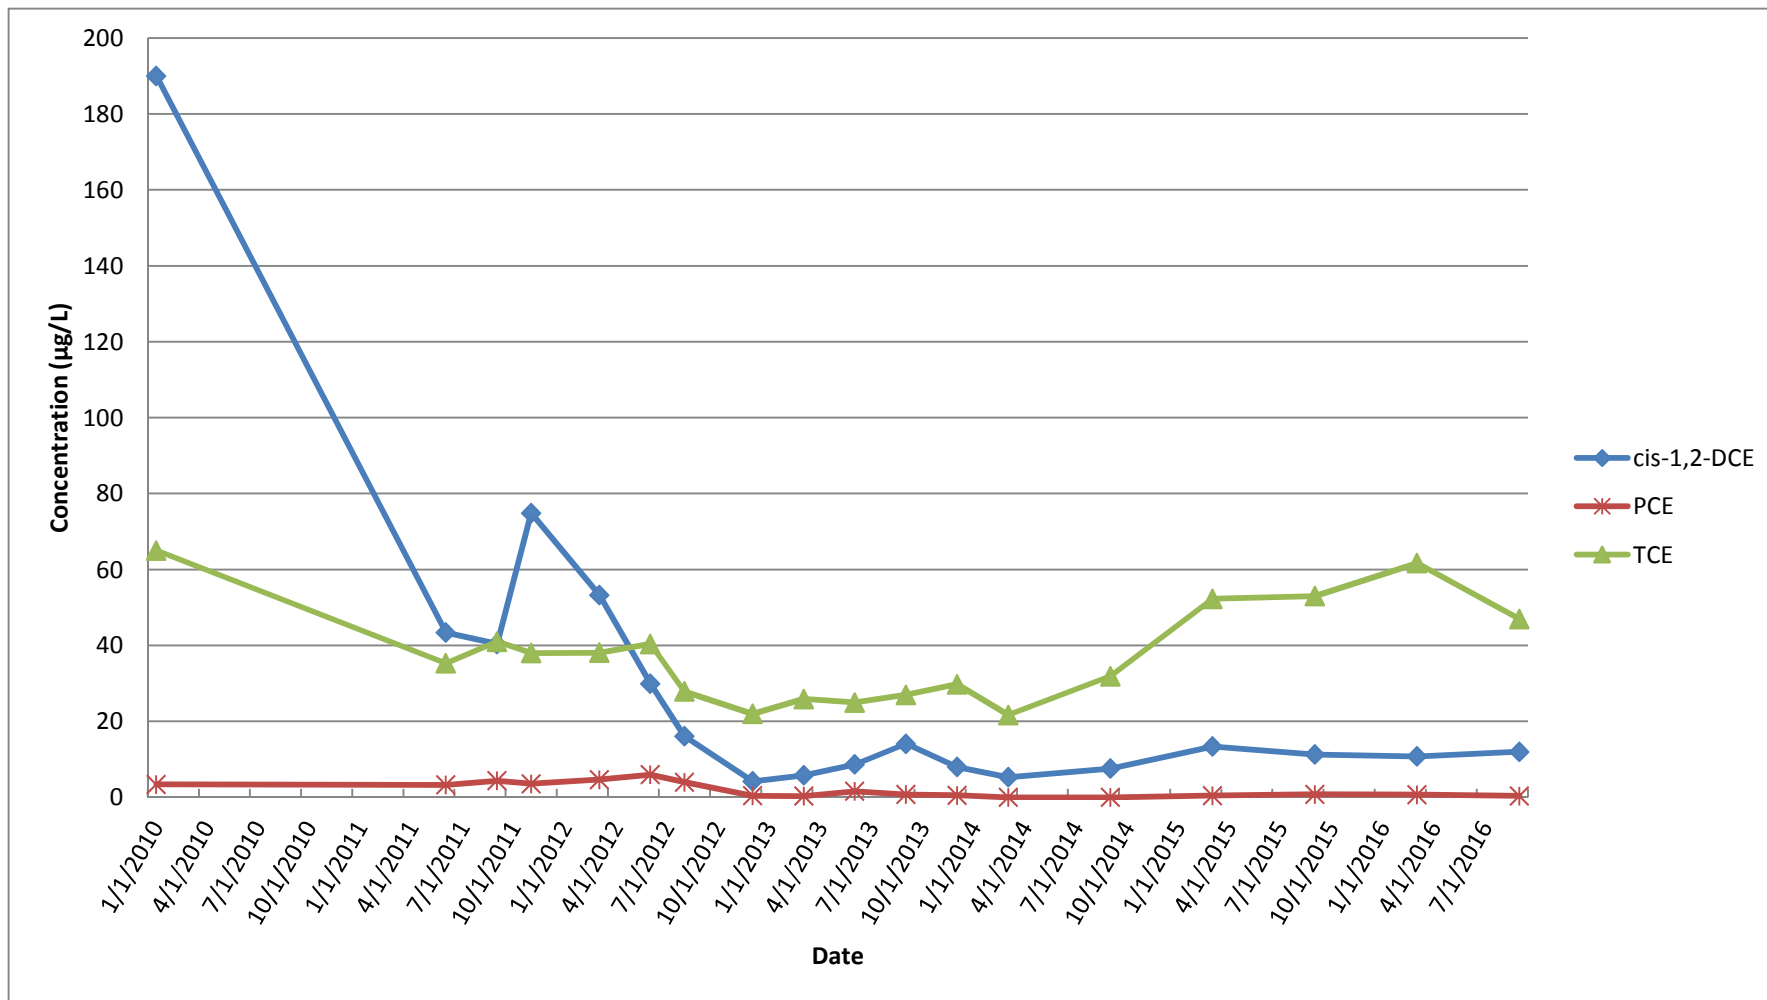


**APPENDIX A**


**NYSDEC EFFLUENT LIMITATIONS AND MONITORING  
REQUIREMENTS AND MONTHLY DMRS**

**New York State Department of Environmental Conservation  
Division of Water**

Bureau of Water Permits, 4<sup>th</sup> Floor  
625 Broadway, Albany, New York 12233-3505  
Phone: (518) 402-8111 • FAX: (518) 402-9029  
Website: www.dec.state.ny.us



Alexander B. Grannis  
Commissioner

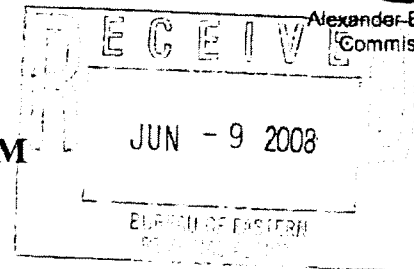**MEMORANDUM**

**TO:** Steven Scharf, DER

**FROM:** Jean Occidental, DOW, Bureau of Water Permits JO

**SUBJECT:** Naval Weapons Industrial Reserve Plant (NWIRP); DER Site # 1-01-001

**DRAINAGE BASIN:** na

**DATE:** June 6, 2008

In response to your request and the permittee's SPDES Permit Equivalent Application dated April 27, 2008, attached is the effluent criteria for the above noted groundwater remediation discharge.

The Division of Water does not have any regulatory authority over a discharge from a State, PRP, or Federal Superfund Site. The Division of Environmental Remediation will be responsible for ensuring compliance with the attached effluent criteria and approval of all engineering submissions. Additional Condition (1) identifies the contact to send all effluent results, engineering submissions, and modification requests. The Regional Water Engineer should be kept apprised of the status of these discharges and, in accordance with the attached criteria, receive a copy of the effluent results for informational purposes.

If you have any questions, please call me at (518) 402-8116.

**Attachment**

cc: (w/att) RWE, Region 1  
C. Webber  
BWP Permit Coordinator

Naval Weapons Industrial Reserve Plant

DER site # 1-01-001

Page 1 of 2

## EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS

During the period beginning: April 1, 2009and lasting until: April 1, 2014

the discharges from the treatment facility to Groundwater shall be limited and monitored by the operator as specified below:

Outfall and Parameters	Limitations		Units	Minimum Monitoring Requirements	
	Daily Avg.	Daily Max.		Measurement Frequency	Sample Type
Treated Groundwater Remediation Discharge from: Recovery Wells 1, 2, and 3					
Flow	Monitor	1100	GPM	Continuous	Recorder
pH (range)	5.5 - 8.5		SU	Weekly	Grab
1,1-Dichloroethane	NA	5	µg/l	Monthly <sup>1</sup>	Grab
1,2-Dichloroethane	NA	0.6	µg/l	Monthly <sup>1</sup>	Grab
1,1-Dichloroethene	NA	5	µg/l	Monthly <sup>1</sup>	Grab
cis-1,2-Dichloroethene	NA	5	µg/l	Monthly <sup>1</sup>	Grab
trans-1,2-Dichloroethene	NA	5	µg/l	Monthly <sup>1</sup>	Grab
Tetrachloroethene	NA	5	µg/l	Monthly <sup>1</sup>	Grab
1,1,1-Trichloroethane	NA	5	µg/l	Monthly <sup>1</sup>	Grab
Trichloroethene	NA	5	µg/l	Monthly <sup>1</sup>	Grab
Vinyl chloride	NA	2	µg/l	Monthly <sup>1</sup>	Grab
Mercury	NA	0.25	µg/l	Monthly <sup>1</sup>	Grab

Footnotes:

- (1) The minimum measurement frequency shall be monthly following a period of 24 consecutive weekly sampling events showing no exceedances of the stated discharge limitations.

Naval Weapons Industrial Reserve Plant

DER site # 1-01-001

Page 1 of 2

Additional Conditions:

- (1) Discharge is not authorized until such time as an engineering submission showing the method of treatment is approved by the Department. The discharge rate may not exceed the effective or design treatment system capacity. All monitoring data, engineering submissions and modification requests must be submitted to:

Steven Scharf  
Division of Environmental Remediation  
NYSDEC, 625 Broadway  
Albany, NY 12233-7015  
Phone: (518) 402-9620

With a copy sent to:

Regional Water Engineer  
NYSDEC - Region 1  
Building 40, SUNY Campus  
Stony Brook, New York 11790-2356  
Phone: (631) 444-0354

- (2) Only site generated wastewater is authorized for treatment and discharge.
- (3) Authorization to discharge is valid only for the period noted above but may be renewed if appropriate. A request for renewal must be received 6 months prior to the expiration date to allow for a review of monitoring data and reassessment of monitoring requirements.
- (4) Any use of corrosion/scale inhibitors, biocidal-type compounds, or other water treatment chemicals used in the treatment process must be approved by the department prior to use.
- (5) This discharge and administration of this discharge must comply with the substantive requirements of 6NYCRR Part 750.

**JULY 2016**





23 August 2016

Mr. Henry Wilkie  
New York State Department of Environmental Conservation  
Division of Solid & Hazardous Materials  
625 Broadway  
Albany, NY 12233-7252

**Subject: GROUNDWATER DISCHARGE MONITORING/AIR EMISSION REPORT  
GM-38 AREA, NWIRP BETHPAGE, NY; DER SITE # 1-30-003B-OU 2  
JULY 2016 REPORTING PERIOD**

Dear Mr. Wilkie:

KOMAN Government Solutions, LLC (KGS) is submitting this monthly monitoring report of the groundwater discharge and air emission results for the Groundwater Treatment Plant (GWTP) located at the Former Naval Weapons Industrial Reserve Plant (NWIRP), Bethpage, NY, GM-38 Area. This report was prepared in accordance with GWTP operational requirements for DER Site # 1-30-003B-OU 2.

GWTP operational data from 1 July 2016 to 31 July 2016 are presented in Attachment A. There was no significant downtime for the GWTP during this reporting period.

As indicated in Attachment A, all permitted constituents were in compliance with regulatory guidelines during this reporting period.

Please contact me at 508-366-7442 with any questions or concerns you may have regarding this report.

Sincerely,  
KOMAN Government Solutions, LLC

Jennifer Good  
Project Manager

Attachment A: Groundwater and Air Sampling Results from July 2016

Cc: Steven Scharf – NYSDEC  
Jean Occidental - NYSDEC Division of Water  
Jennifer Pilewski - NYSDEC – Region 1 Water Engineer  
Gerard Ennis - Nassau County Department of Public Works  
Linda Bianculli - Town of Oyster Bay  
Lora Fly - NAVFAC Mid-Atlantic RPM  
Greg Pearman – NWIRP Bethpage  
GM-38 Copy

**ATTACHMENT A**  
**GROUNDWATER AND AIR SAMPLING RESULTS**  
**JULY 2016**

**GM-38 Area Groundwater Remediation  
Groundwater Treatment Plant  
Naval Weapons Industrial Reserve Plant - Bethpage, NY  
Discharge Monitoring Report  
July 2016**

SPDES Parameters	July 2016					
	Daily Treated Effluent Maximum	Units	RW-1 <sup>(1)</sup>	RW-3 <sup>(2)</sup>	Combined Influent <sup>(1)</sup>	Treated Effluent
Well Depth	N/A	ft	445	530	N/A	N/A
Screened Interval	N/A	ft bgs	335-395 410-430	392-412 442-504	N/A	N/A
Sampling Date	N/A		7/5/16			
Average Flowrate	1100	GPM	990	0.3	990	1,014
Total Flow	N/A	gallons	44,198,025	12,800	44,210,825	45,256,458
pH	5.5 - 8.5	SU	5.33	NS	5.33	6.04
Carbon Tetrachloride	NA	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)
1,1-Dichloroethane	5	µg/L	2.2	NS	2.2	ND (1.0)
1,2-Dichloroethane	0.6	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)
1,1-Dichloroethene	5	µg/L	1.6	NS	1.6	ND (1.0)
cis 1,2-Dichloroethene	5	µg/L	11	NS	11	0.39 J
trans 1,2-Dichloroethene	5	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)
Tetrachloroethene	5	µg/L	28	NS	28	ND (1.0)
1,1,1-Trichloroethene	5	µg/L	1.1	NS	1.1	ND (1.0)
Trichloroethene	5	µg/L	120	NS	120	0.96 J
Vinyl Chloride	2	µg/L	0.43 J	NS	0.43 J	ND (1.0)
Mercury	0.00025	mg/L	ND (0.00010)	NS	ND (0.00010)	ND (0.00010)
Total Suspended Solids (TSS)	N/A	mg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)

**Notes:**

B - Method blank contamination

J - Estimated result between laboratory method detection limit and reporting limit

ND - Not detected above laboratory method detection limit. Reporting Limit (RL) given in parentheses.

NR - Not Recorded

NS - Not Sampled. RW-3 sampling frequency has been reduced from monthly to semi-annually.

N/A - Not Applicable

NS - Not Sampled

(1) On 1 July 2015, the RW-1 flowrate was increased from ~800 gpm to ~1,000 gpm and RW-3 was taken off-line, as approved by NYSDEC on 20 April 2015. Influent concentrations presented above are therefore equivalent to RW-1 concentrations only.

(2) To maintain the integrity of RW-3 for potential future use, approximately 200 gallons per minute of water are pumped for a 1-hour period from the well on a monthly basis. RW-3 is sampled semi-annually, consistent with the groundwater monitoring program.

**GM-38 Area Groundwater Remediation  
Groundwater Treatment Plant  
Naval Weapons Industrial Reserve Plant - Bethpage, NY  
Air Sampling Results  
July 2016**

DAR Parameters	Units	Discharge Goal <sup>(1)</sup>	July 2016	
			Influent	Effluent <sup>(3)</sup>
Process Stream				
Sampling Date	N/A	N/A	7/5/16	
Average Flowrate	CFM	N/A	NR	8,347
Total Flow	ft <sup>3</sup>	N/A	NR	360,590,400
Total Flow	m <sup>3</sup>	N/A	NR	10,210,783
1,2-Dichloroethane	µg/m <sup>3</sup>	N/A	6.7	ND
cis 1,2-Dichloroethene	µg/m <sup>3</sup>	> 100,000 <sup>(2)</sup>	180	3.5
trans 1,2-Dichloroethene	µg/m <sup>3</sup>		2.6 J	ND
1,2-Dichloroethene (total)	µg/m <sup>3</sup>	>100,000	190	ND
Toluene	µg/m <sup>3</sup>	N/A	1.6 J	3.6
Total Xylene	µg/m <sup>3</sup>	N/A	ND	ND
1,1,2-Trichloroethane	µg/m <sup>3</sup>	N/A	ND	ND
Trichloroethene	µg/m <sup>3</sup>	2,600	2,200	83
Vinyl Chloride	µg/m <sup>3</sup>	560	7.0	3.7
Tetrachloroethene	µg/m <sup>3</sup>	5,100	450	29

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

J - Estimated result between laboratory method detection limit and reporting limit

N/A - Not Applicable

NR - Not recorded

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

(2) Discharge goal is for total 1,2-Dichloroethene.

(3) Effluent concentrations presented above differ from concentrations of the duplicate sample collected at this location and are also higher than concentrations observed in previous months. Effluent results will be confirmed with the August 2016 monthly sample collection.

**GM-38 Area Groundwater Remediation  
Groundwater Treatment Plant  
Naval Weapons Industrial Reserve Plant - Bethpage, NY  
Controlled Stack Emissions  
July 2016**

<b>DAR Parameters</b>	<b>Units</b>	<b>Discharge Goal <sup>(1)</sup></b>	<b>July 2016</b>
Sampling Date	N/A	N/A	7/5/16
Average Flowrate	CFM	N/A	8,347
Total Flow	ft <sup>3</sup>	N/A	360,590,400
Total Flow	m <sup>3</sup>	N/A	10,210,783
Trichloroethene	lb/hr	0.09	0.00251
Vinyl Chloride	lb/hr	0.02	0.00011
1,2 Dichloroethene	lb/hr	11	0.00000
1,2-Dichloroethane	lb/hr	N/A	0.00000
Toluene	lb/hr	N/A	0.00011
Total Xylene	lb/hr	N/A	0.00000
1,1,2-Trichloroethane	lb/hr	N/A	0.00000
Tetrachloroethene	lb/hr	0.18	0.00088

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

N/A - Not Applicable

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

**AUGUST 2016**



21 September 2016

Mr. Henry Wilkie  
New York State Department of Environmental Conservation  
Division of Solid & Hazardous Materials  
625 Broadway  
Albany, NY 12233-7252

**Subject: GROUNDWATER DISCHARGE MONITORING/AIR EMISSION REPORT  
GM-38 AREA, NWIRP BETHPAGE, NY; DER SITE # 1-30-003B-OU 2  
AUGUST 2016 REPORTING PERIOD**

Dear Mr. Wilkie:

KOMAN Government Solutions, LLC (KGS) is submitting this monthly monitoring report of the groundwater discharge and air emission results for the Groundwater Treatment Plant (GWTP) located at the Former Naval Weapons Industrial Reserve Plant (NWIRP), Bethpage, NY, GM-38 Area. This report was prepared in accordance with GWTP operational requirements for DER Site # 1-30-003B-OU 2.

GWTP operational data from 1 August 2016 to 31 August 2016 are presented in Attachment A. There was no significant downtime for the GWTP during this reporting period. Minimal unscheduled downtime occurred due to various power outages during this reporting period.

As indicated in Attachment A, all permitted constituents were in compliance with regulatory guidelines during this reporting period.

Please contact me at 508-366-7442 with any questions or concerns you may have regarding this report.

Sincerely,  
KOMAN Government Solutions, LLC

Jennifer Good  
Project Manager

Attachment A: Groundwater and Air Sampling Results from August 2016



Cc: Steven Scharf – NYSDEC  
Jean Occidental - NYSDEC Division of Water  
Jennifer Pilewski - NYSDEC – Region 1 Water Engineer  
Gerard Ennis - Nassau County Department of Public Works  
Linda Bianculli - Town of Oyster Bay  
Lora Fly - NAVFAC Mid-Atlantic RPM  
Greg Pearman – NWIRP Bethpage  
GM-38 Copy

**ATTACHMENT A**  
**GROUNDWATER AND AIR SAMPLING RESULTS**  
**AUGUST 2016**

**GM-38 Area Groundwater Remediation  
Groundwater Treatment Plant  
Naval Weapons Industrial Reserve Plant - Bethpage, NY  
Discharge Monitoring Report  
August 2016**

SPDES Parameters	August 2016					
	Daily Treated Effluent Maximum	Units	RW-1 <sup>(1)</sup>	RW-3 <sup>(2)</sup>	Combined Influent <sup>(1)</sup>	Treated Effluent
Well Depth	N/A	ft	445	530	N/A	N/A
Screened Interval	N/A	ft bgs	335-395 410-430	392-412 442-504	N/A	N/A
Sampling Date	N/A		8/1/16			
Average Flowrate	1100	GPM	978	0.3	978	1,001
Total Flow	N/A	gallons	43,636,307	11,900	43,648,207	44,673,611
pH	5.5 - 8.5	SU	5.26	NS	5.26	5.89
Carbon Tetrachloride	NA	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)
1,1-Dichloroethane	5	µg/L	2.1	NS	2.1	ND (1.0)
1,2-Dichloroethane	0.6	µg/L	0.35 J	NS	0.35 J	ND (1.0)
1,1-Dichloroethene	5	µg/L	1.3	NS	1.3	ND (1.0)
cis 1,2-Dichloroethene	5	µg/L	9.4	NS	9.4	0.39 J
trans 1,2-Dichloroethene	5	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)
Tetrachloroethene	5	µg/L	27	NS	27	ND (1.0)
1,1,1-Trichloroethene	5	µg/L	1.2	NS	1.2	ND (1.0)
Trichloroethene	5	µg/L	120	NS	120	1.0
Vinyl Chloride	2	µg/L	0.33 J	NS	0.33 J	ND (1.0)
Mercury	0.00025	mg/L	ND (0.00010)	NS	ND (0.00010)	ND (0.00010)
Total Suspended Solids (TSS)	N/A	mg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)

**Notes:**

B - Method blank contamination

J - Estimated result between laboratory method detection limit and reporting limit

ND - Not detected above laboratory method detection limit. Reporting Limit (RL) given in parentheses.

NR - Not Recorded

NS - Not Sampled. RW-3 sampling frequency has been reduced from monthly to semi-annually.

N/A - Not Applicable

NS - Not Sampled

(1) On 1 July 2015, the RW-1 flowrate was increased from ~800 gpm to ~1,000 gpm and RW-3 was taken off-line, as approved by NYSDEC on 20 April 2015. Influent concentrations presented above are therefore equivalent to RW-1 concentrations only.

(2) To maintain the integrity of RW-3 for potential future use, approximately 200 gallons per minute of water are pumped for a 1-hour period from the well on a monthly basis. RW-3 is sampled semi-annually, consistent with the groundwater monitoring program.

**GM-38 Area Groundwater Remediation  
Groundwater Treatment Plant  
Naval Weapons Industrial Reserve Plant - Bethpage, NY  
Air Sampling Results  
August 2016**

DAR Parameters	Units	Discharge Goal <sup>(1)</sup>	August 2016	
			Influent	Effluent
Process Stream				
Sampling Date	N/A	N/A	8/8/16	
Average Flowrate	CFM	N/A	NR	7,786
Total Flow	ft <sup>3</sup>	N/A	NR	347,581,920
Total Flow	m <sup>3</sup>	N/A	NR	9,842,424
1,2-Dichloroethane	µg/m <sup>3</sup>	N/A	4.7 J	ND
cis 1,2-Dichloroethene	µg/m <sup>3</sup>	> 100,000 <sup>(2)</sup>	130	1.9 J
trans 1,2-Dichloroethene	µg/m <sup>3</sup>		2.0 J	ND
1,2-Dichloroethene (total)	µg/m <sup>3</sup>	>100,000	130	ND
Toluene	µg/m <sup>3</sup>	N/A	26	ND
Total Xylene	µg/m <sup>3</sup>	N/A	ND	ND
1,1,2-Trichloroethane	µg/m <sup>3</sup>	N/A	ND	ND
Trichloroethene	µg/m <sup>3</sup>	2,600	2,000	1.4 J
Vinyl Chloride	µg/m <sup>3</sup>	560	3.3 J	1.7 J
Tetrachloroethene	µg/m <sup>3</sup>	5,100	420	ND

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

J - Estimated result between laboratory method detection limit and reporting limit

N/A - Not Applicable

NR - Not recorded

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

(2) Discharge goal is for total 1,2-Dichloroethene.

**GM-38 Area Groundwater Remediation  
Groundwater Treatment Plant  
Naval Weapons Industrial Reserve Plant - Bethpage, NY  
Controlled Stack Emissions  
August 2016**

<b>DAR Parameters</b>	<b>Units</b>	<b>Discharge Goal <sup>(1)</sup></b>	<b>August 2016</b>
Sampling Date	N/A	N/A	8/8/16
Average Flowrate	CFM	N/A	7,786
Total Flow	ft <sup>3</sup>	N/A	347,581,920
Total Flow	m <sup>3</sup>	N/A	9,842,424
Trichloroethene	lb/hr	0.09	0.00004
Vinyl Chloride	lb/hr	0.02	0.00005
1,2 Dichloroethene	lb/hr	11	0.00000
1,2-Dichloroethane	lb/hr	N/A	0.00000
Toluene	lb/hr	N/A	0.00000
Total Xylene	lb/hr	N/A	0.00000
1,1,2-Trichloroethane	lb/hr	N/A	0.00000
Tetrachloroethene	lb/hr	0.18	0.00000

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

N/A - Not Applicable

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

**SEPTEMBER 2016**



31 October 2016

Mr. Henry Wilkie  
New York State Department of Environmental Conservation  
Division of Solid & Hazardous Materials  
625 Broadway  
Albany, NY 12233-7252

**Subject: GROUNDWATER DISCHARGE MONITORING/AIR EMISSION REPORT  
GM-38 AREA, NWIRP BETHPAGE, NY; DER SITE # 1-30-003B-OU 2  
SEPTEMBER 2016 REPORTING PERIOD**

Dear Mr. Wilkie:

KOMAN Government Solutions, LLC (KGS) is submitting this monthly monitoring report of the groundwater discharge and air emission results for the Groundwater Treatment Plant (GWTP) located at the Former Naval Weapons Industrial Reserve Plant (NWIRP), Bethpage, NY, GM-38 Area. This report was prepared in accordance with GWTP operational requirements for DER Site # 1-30-003B-OU 2.

GWTP operational data from 1 September 2016 to 30 September 2016 are presented in Attachment A. During this reporting period, scheduled downtime occurred in order to perform a routine changeout of the liquid phase granular activated carbon (LGAC). This scheduled downtime affected the average flowrates during the September 2016 reporting period.

As indicated in Attachment A, all permitted constituents were in compliance with regulatory guidelines during this reporting period.

Please contact me at 508-366-7442 with any questions or concerns you may have regarding this report.

Sincerely,  
KOMAN Government Solutions, LLC

Jennifer Good  
Project Manager

Attachment A: Groundwater and Air Sampling Results from September 2016

Cc: Steven Scharf – NYSDEC  
Jean Occidental - NYSDEC Division of Water  
Jennifer Pilewski - NYSDEC – Region 1 Water Engineer  
Gerard Ennis - Nassau County Department of Public Works  
Linda Bianculli - Town of Oyster Bay  
Lora Fly - NAVFAC Mid-Atlantic RPM  
Greg Pearman – NWIRP Bethpage  
GM-38 Copy



**ATTACHMENT A**  
**GROUNDWATER AND AIR SAMPLING RESULTS**  
**SEPTEMBER 2016**

**GM-38 Area Groundwater Remediation  
Groundwater Treatment Plant  
Naval Weapons Industrial Reserve Plant - Bethpage, NY  
Discharge Monitoring Report  
September 2016**

SPDES Parameters	September 2016 <sup>(3)</sup>					
	Daily Treated Effluent Maximum	Units	RW-1 <sup>(1)</sup>	RW-3 <sup>(2)</sup>	Combined Influent <sup>(1)</sup>	Treated Effluent
Well Depth	N/A	ft	445	530	N/A	N/A
Screened Interval	N/A	ft bgs	335-395 410-430	392-412 442-504	N/A	N/A
Sampling Date	N/A		9/6/16			
Average Flowrate	1100	GPM	923	0.3	924	946
Total Flow	N/A	gallons	39,887,336	12,800	39,900,136	40,854,572
pH	5.5 - 8.5	SU	5.29	NS	5.29	6.07
Carbon Tetrachloride	NA	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)
1,1-Dichloroethane	5	µg/L	2.0	NS	2.0	ND (1.0)
1,2-Dichloroethane	0.6	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)
1,1-Dichloroethene	5	µg/L	1.5	NS	1.5	ND (1.0)
cis 1,2-Dichloroethene	5	µg/L	9.4	NS	9.4	0.40 J
trans 1,2-Dichloroethene	5	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)
Tetrachloroethene	5	µg/L	27	NS	27	ND (1.0)
1,1,1-Trichloroethene	5	µg/L	1.1	NS	1.1	ND (1.0)
Trichloroethene	5	µg/L	120	NS	120	0.89 J
Vinyl Chloride	2	µg/L	0.27 J	NS	0.27 J	ND (1.0)
Mercury	0.00025	mg/L	ND (0.00010)	NS	ND (0.00010)	ND (0.00010)
Total Suspended Solids (TSS)	N/A	mg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)

**Notes:**

B - Method blank contamination

J - Estimated result between laboratory method detection limit and reporting limit

ND - Not detected above laboratory method detection limit. Reporting Limit (RL) given in parentheses.

NR - Not Recorded

NS - Not Sampled. RW-3 sampling frequency has been reduced from monthly to semi-annually.

N/A - Not Applicable

NS - Not Sampled

(1) On 1 July 2015, the RW-1 flowrate was increased from ~800 gpm to ~1,000 gpm and RW-3 was taken off-line, as approved by NYSDEC on 20 April 2015. Influent concentrations presented above are therefore equivalent to RW-1 concentrations only.

(2) To maintain the integrity of RW-3 for potential future use, approximately 200 gallons per minute of water are pumped for a 1-hour period from the well on a monthly basis. RW-3 is sampled semi-annually, consistent with the groundwater monitoring program.

(3) Monthly process samples were collected on 9/6/16. Changeout of the liquid phase granular activated carbon (LGAC) was performed on 9/20/16.

**GM-38 Area Groundwater Remediation  
Groundwater Treatment Plant  
Naval Weapons Industrial Reserve Plant - Bethpage, NY  
Air Sampling Results  
September 2016**

DAR Parameters	Units	Discharge Goal <sup>(1)</sup>	September 2016	
			Influent	Effluent <sup>(3)</sup>
Process Stream				
Sampling Date	N/A	N/A	9/6/16	
Average Flowrate	CFM	N/A	NR	7,823
Total Flow	ft <sup>3</sup>	N/A	NR	337,947,429
Total Flow	m <sup>3</sup>	N/A	NR	9,569,605
1,2-Dichloroethane	µg/m <sup>3</sup>	N/A	4.0 J	0.76 J
cis 1,2-Dichloroethene	µg/m <sup>3</sup>	> 100,000 <sup>(2)</sup>	130	30
trans 1,2-Dichloroethene	µg/m <sup>3</sup>		1.9 J	ND
1,2-Dichloroethene (total)	µg/m <sup>3</sup>	>100,000	140	30
Toluene	µg/m <sup>3</sup>	N/A	ND	7.2
Total Xylene	µg/m <sup>3</sup>	N/A	ND	ND
1,1,2-Trichloroethane	µg/m <sup>3</sup>	N/A	1.5 J	ND
Trichloroethene	µg/m <sup>3</sup>	2,600	2,400	830
Vinyl Chloride	µg/m <sup>3</sup>	560	4.1	3.8
Tetrachloroethene	µg/m <sup>3</sup>	5,100	460	260

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

J - Estimated result between laboratory method detection limit and reporting limit

N/A - Not Applicable

NR - Not recorded

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

(2) Discharge goal is for total 1,2-Dichloroethene.

(3) Effluent concentrations presented above are not in-line with concentrations observed in previous months and are also not consistent with results of a subsequent sample collected on 10/7/16, indicating effluent results presented above are not likely indicative of actual conditions.

**GM-38 Area Groundwater Remediation  
Groundwater Treatment Plant  
Naval Weapons Industrial Reserve Plant - Bethpage, NY  
Controlled Stack Emissions  
September 2016**

<b>DAR Parameters</b>	<b>Units</b>	<b>Discharge Goal <sup>(1)</sup></b>	<b>September 2016 <sup>(2)</sup></b>	
Sampling Date	N/A	N/A	9/6/16	
Average Flowrate	CFM	N/A	7,823	
Total Flow	ft <sup>3</sup>	N/A	337,947,429	
Total Flow	m <sup>3</sup>	N/A	9,569,605	
Trichloroethene	lb/hr	0.09	0.02432	0.00012
Vinyl Chloride	lb/hr	0.02	0.00011	0.00005
1,2 Dichloroethene	lb/hr	11	0.00088	0.00070
1,2-Dichloroethane	lb/hr	N/A	0.00002	0.00000
Toluene	lb/hr	N/A	0.00021	0.00004
Total Xylene	lb/hr	N/A	0.00000	0.00000
1,1,2-Trichloroethane	lb/hr	N/A	0.00000	0.00000
Tetrachloroethene	lb/hr	0.18	0.00762	0.00002

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

N/A - Not Applicable

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

(2) Concentrations of the effluent sample collected on 9/6/16 are not in-line with concentrations observed in previous months and are also not consistent with results of a subsequent sample collected on 10/7/16, indicating the September results may not reflect actual conditions. Emission rates were calculated using the September 2016 effluent data on the left. Emission rates were calculated using the average of the effluent concentrations from August and October 2016 on the right, as these concentrations and calculated emissions more likely reflect actual conditions. Calculated emission rates using both the September 2016 effluent concentrations and the average of the August 2016 and October 2016 effluent concentrations remain below the discharge goals.

**APPENDIX B**

**NYSDEC AIR DISCHARGE LIMIT  
DOCUMENTATION**

**New York State Department of Environmental Conservation**  
**Division of Environmental Remediation**  
**Remedial Action Bureau A, 12<sup>th</sup> Floor**  
625 Broadway, Albany, New York 12233-7015  
Phone: (518) 402-9620 FAX: (518) 402-9022



Joseph Martens  
Commissioner

October 31, 2013

Lora Fly  
Remedial Program Manager  
NAVFAC Mid-Atlantic  
Northeast IPT  
9742 Maryland Avenue  
Norfolk, VA, 23511-3095

RE: Northrop Grumman, Naval Weapons Industrial Reserve Plant (NWIRP) and Grumman Steel Los Sites, NYSDEC Site No.'s 1-30-003 A & B.

Dear Ms. Fly:

Tetra Tech NUS Inc., on behalf of the Department of the Navy NAVFAC Midlantic, has submitted an application to remove the GM 38 Area Groundwater Extraction and Treatment system impregnated Xeolite<sup>™</sup> resin from the air discharge treatment system. Currently, the air treatment system uses a combined activated carbon with permanganate impregnated resin treatment train. The New York State Department of Environmental Conservation (NYSDEC) has reviewed the Department of the Navy application and concurs with the findings presented.

The routine monitoring, as detailed in Table 1, clearly indicates that vinyl chloride, one of the main contaminants of concern, has diminished to almost non-detect, and discharge concentrations have dropped to below the limit to require air treatment for the other contaminants as well. However, NAVFAC Midlantic is still proposing activated carbon to reduce the other discharge contaminant levels. Therefore, the NYSDEC hereby approves the proposed changes to the GM 38 Area air treatment. The Xeolite<sup>™</sup> resin beds will remain in place should reactivation, based on routine monitoring, be required.

If you have any questions in the interim, please contact me at (518)402-9620.

Sincerely,

Steven M. Scharf, P.E.  
Project Engineer  
Remedial Action Bureau A  
Division of Environmental Remediation

EC: J. Swartwout  
S. Scharf  
W. Parish, Region 1  
S. Karpinski, NYSDOH  
E. Hannon, NGC  
D. Stern, Arcadis  
D. Brayack, TTNUS



NOR-01264

November 21, 2011

Mr. Stephen Scharf  
New York Department of Environmental Conservation  
Division of Environmental Remediation  
Bureau of Remedial Action A  
625 Broadway, 11<sup>th</sup> Floor  
Albany, New York 12233-7015

Reference: CLEAN Contract No. N62470-08-D-1001  
Contract Task Order WE06

Subject: Proposed Modification to Discharge Limits for Off Gas Volatile Organic Compounds (VOCs)  
for Air Stripping Tower  
GM-38 Offsite Groundwater Treatment Plant,  
NWIRP Bethpage, New York

Dear Mr. Scharf:


On behalf of the Navy, please find enclosed a copy of the subject document. This document presents an evaluation of current concentrations of off gas VOCs from the GM-38 groundwater treatment plant air-stripping tower (prior to treatment with granular activated carbon). Maximum emission rates were re-evaluated due to decreasing maximum concentrations of target VOCs in un-treated air stripper AS-1 off gas. In addition, breakthrough of target contaminants (e.g., cis-1,2-dichloroethene) is beginning to occur in the granular activated carbon bed. Maximum emission rates were re-evaluated to provide a determination if breakthrough of contaminants would trigger the need for a replacement of the granular activated carbon bed.

Existing Discharge Goals were established in the "Final Operation, Maintenance and Monitoring Plan for Groundwater Treatment Plant GM-38 Area Groundwater Remediation" prepared by Tetra Tech EC (April 2010). Existing goals were based on emission estimates for a 95% reduction (see Attachment A), instead of being based on the original DAR-1 analysis of air stripper off gas. Emission estimates were calculated using the air stripper design flow rate of 8,000 cubic feet per minute (cfm), and previous contaminant discharge rates in pounds per hour (lb/hr). Original emission estimates are provided in Attachment B.

Proposed Revised Discharge Goals were calculated using an average flow rate of 9,200 cfm, January to March 2011 VOC loading rates (taken from the Quarterly Operations Report First Quarter 2011 from ECOR Federal Services), and the Actual Annual % of Annual Guideline Concentrations (AGCs), taken from the revised DAR-1 Model Output. The revised DAR-1 Model Output is provided in Attachment C. Existing Discharge Goals and Proposed Revised Discharge Goals are compared in tabular format in the first page of the attachment. Proposed Revised Discharge Goals for trichloroethene (TCE) are the same as previous. The proposed limit for tetrachloroethene (PCE) is approximately 10 times the previous limit, and vinyl chloride is approximately 2 times the previous limit. Revised Discharge Goals for 1,2-dichloroethene (goals are the same for cis-1,2-dichloroethene) are 100 times greater than previously established limits. It is recommended that these revised limits replace previous discharge goals, and treatment of air stripper off gas by granular activated carbon is recommended to continue for TCE and PCE, with no treatment required for vinyl chloride and 1,2-dichloroethene.

If you have any questions please contact Ms. Lora Fly, NAVFAC Mid-LANT, at (757) 341-2012.

Sincerely,



David D. Brayack, P.E.  
Project Manager

Enclosure: (1) Proposed Modification to Discharge Limits for Off Gas Volatile Organic Compounds  
(VOCs) for Air Stripping Tower  
GM-38 Offsite Groundwater Treatment Plant

Distribution:

Mid-Lant, Lora Fly  
NYSDEC (Albany), Henry Wilkie  
NYSDOH (Troy), Steve Karpinski  
NAVAIR, Richard Smith  
USEPA, Carol Stein  
NGC, Kent Smith  
Tetra Tech NUS, Dave Brayack  
ECOR Solutions, Al Taormina  
Administrative Record  
Public Repository  
Project File

Tetra Tech NUS, Inc.

5700 Lake Wright Drive, Suite 309, Norfolk, VA 23502  
Tel 757.461.3768 Fax 757.461.4148 www.ttnus.com



**TABLE 1**  
**COMPARISON OF EXISTING DISCHARGE GOALS WITH ACTUAL EMISSIONS AND PROPOSED DISCHARGE GOALS**  
**AIR STRIPPING TOWER GM-38 OFFSITE GROUNDWATER TREATMENT PLANT**  
**NWIRP BETHPAGE, NEW YORK**

Chemical	Existing Discharge Goal		Actual January to March 2011 Values (Pre-Off Gas Treatment)		Proposed Revised Discharge Goals based on DAR-1 Analysis	
	Existing Discharge Loading Rate (pounds (lbs)/hour) <sup>(1)</sup>	Equivalent Existing Discharge Goals ( $\mu\text{g}/\text{m}^3$ ) <sup>(2)</sup>	Actual Jan-Mar 2011 Concentration ( $\mu\text{g}/\text{m}^3$ ) <sup>(3)</sup>	Actual VOC Loading Pre-Off Gas Treatment (lbs/hour) <sup>(4)</sup>	Proposed Discharge Loading Rate (lbs/hour) <sup>(5)</sup>	Equivalent Proposed Discharge Goal ( $\mu\text{g}/\text{m}^3$ ) <sup>(5)</sup>
TCE	0.09	2,600	10,000	0.345	0.09	2,600
PCE	0.02	580	6,800	0.234	0.18	5,100
Vinyl Chloride	0.01	290	76	0.003	0.02	560
1,2-Dichloroethene (total)	0.03	870	750	0.026	11	greater than 100,000

**Notes:**

<sup>(1)</sup>Existing Discharge Goals are based on the design flow rate of 8,000 cfm. Existing Discharge Goals were taken from the Final Operations and Maintenance Plan for GM-38 Area Groundwater Remediation from Tetra Tech EC. Existing goals were based on emission estimates for a 95% reduction, and not the previous DAR-1 Analysis. Attachment B (provided at the end of this package) provides the original emission estimates.

<sup>(2)</sup>Existing Discharge Goals were calculated using the actual flow rate of 9,200 cfm and the existing discharge loading rate in pounds per hour (lb/hr).

<sup>(3)</sup>Values were taken from the Quarterly Operations Report First Quarter 2011 from ECOR Federal Services. Values were the maximum effluent concentration in off gas from air stripper stack AS-1 prior to treatment with vapor phase granular activated carbon (GAC), for the months of January, February and March 2011.

<sup>(4)</sup>Actual VOC Loading was calculated using an average flow rate of 9,200 cfm and the January-March 2011 concentrations. Existing off gas treatment consists of two stage vapor phase GAC followed by potassium permanganate zeolite media to provide additional treatment for vinyl chloride.

<sup>(5)</sup>Values were calculated using an average flow rate of 9,200 cfm, and the Actual Annual % of the AGCs from the 2011 DAR-1 Model Output to achieve air quality requirements.

**ATTACHMENT A**  
**2008 AIR PERMIT SUBMITTAL**

# New York State Department of Environmental Conservation Air Permit Application



DEC ID									
-									

APPLICATION ID														
-														

OFFICE USE ONLY									

## Section I - Certification

Title V Certification	
I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons directly responsible for gathering the information [required pursuant to 6 NYCRR 201-6.3(d)] I believe the information is, true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fines and imprisonment for knowing violations.	
Responsible Official	Title
Signature	Date ____ / ____ / ____

State Facility Certification	
I certify that this facility will be operated in conformance with all provisions of existing regulations.	
Responsible Official	Title
Signature	Date ____ / ____ / ____

## Section II - Identification Information

Title V Facility Permit <u>N/A</u>	<input type="checkbox"/> New	<input type="checkbox"/> Significant Modification	<input type="checkbox"/> Administrative Amendment	State Facility Permit <u>N/A</u>
<input type="checkbox"/> Renewal	<input type="checkbox"/> Minor Modification	General Permit Title: _____		<input type="checkbox"/> New
<input checked="" type="checkbox"/> Application involves construction of new facility		<input type="checkbox"/> Application involves construction of new emission unit(s)		
				<input type="checkbox"/> Modification
				General Permit Title: _____

Owner/Firm				
Name <u>US Navy/NAVFAC Midlant</u>				
Street Address <u>9742 Maryland Ave, Bldg Z-144</u>				
City <u>Norfolk</u>	State <u>VA</u>	Country <u>US</u>	Zip <u>23511-3095</u>	
Owner Classification <input checked="" type="checkbox"/> Federal		<input type="checkbox"/> State	<input type="checkbox"/> Municipal	
<input type="checkbox"/> Corporation/Partnership		<input type="checkbox"/> Individual	Taxpayer ID	
Facility				<input type="checkbox"/> Confidential
Name <u>Naval Weapons Industrial Reserve Plant (NWIRP) GM-38 Area</u>				
Location Address <u>Bethpage</u>				
<input type="checkbox"/> City / <input checked="" type="checkbox"/> Town / <input type="checkbox"/> Village <u>Oyster Bay, New York</u>			Zip <u>11714</u>	
Project Description				<input type="checkbox"/> Continuation Sheet(s)
<u>Air stripping of groundwater to remove VOCs</u>				

Owner/Firm Contact Mailing Address				
Name (Last, First, Middle Initial) <u>Fly, Lora</u>			Phone No. (757) 444-0781	
Affiliation <u>Department of the Navy</u>		Title <u>Remedial PM</u>	Fax No. ( )	
Street Address <u>9742 Maryland Ave. Bldg Z-144</u>				
City <u>Norfolk</u>	State <u>VA</u>	Country <u>US</u>	Zip <u>23511-3095</u>	
Facility Contact Mailing Address				
Name (Last, First, Middle Initial) <u>Same</u>			Phone No. ( )	
Affiliation		Title	Fax No. ( )	
Street Address				
City	State	Country	Zip	

New York State Department of Environmental Conservation  
Air Permit Application



DEC ID									
-									

**Section III - Facility Information**

Classification					
<input type="checkbox"/> Hospital	<input type="checkbox"/> Residential	<input type="checkbox"/> Educational/Institutional	<input type="checkbox"/> Commercial	<input checked="" type="checkbox"/> Industrial	<input type="checkbox"/> Utility

Affected States (Title V Only) N/A					
<input type="checkbox"/> Vermont	<input type="checkbox"/> Massachusetts	<input type="checkbox"/> Rhode Island	<input type="checkbox"/> Pennsylvania	Tribal Land: _____	
<input type="checkbox"/> New Hampshire	<input type="checkbox"/> Connecticut	<input type="checkbox"/> New Jersey	<input type="checkbox"/> Ohio	Tribal Land: _____	

SIC Codes											
9999											

Facility Description		<input type="checkbox"/> Continuation Sheet(s)
Groundwater Remediation by Air Stripping followed by Vapor-Phase GAC for emission control		

Compliance Statements (Title V Only) N/A	
<p>I certify that as of the date of this application the facility is in compliance with all applicable requirements: <input type="checkbox"/> YES <input type="checkbox"/> NO</p> <p>If one or more emission units at the facility are not in compliance with all applicable requirements at the time of signing this application (the 'NO' box must be checked), the noncomplying units must be identified in the "Compliance Plan" block on page 8 of this form along with the compliance plan information required. For all emission units at this facility that are operating <u>in compliance</u> with all applicable requirements complete the following:</p> <ul style="list-style-type: none"> <li><input type="checkbox"/> This facility will continue to be operated and maintained in such a manner as to assure compliance for the duration of the permit, except those units referenced in the compliance plan portion of Section IV of this application.</li> <li><input type="checkbox"/> For all emission units, subject to any applicable requirements that will become effective during the term of the permit, this facility will meet all such requirements on a timely basis.</li> <li><input type="checkbox"/> Compliance certification reports will be submitted at least once a year. Each report will certify compliance status with respect to each requirement, and the method used to determine the status.</li> </ul>	

Facility Applicable Federal Requirements N/A										<input type="checkbox"/> Continuation Sheet(s)
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause	
	CERCLA	all substantive requirements								

Facility State Only Requirements										<input type="checkbox"/> Continuation Sheet(s)
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause	

New York State Department of Environmental Conservation  
Air Permit Application



DEC ID											
-						-					

**Section III - Facility Information (continued)**

Facility Compliance Certification									N/A	<input type="checkbox"/> Continuation Sheet(s)
Rule Citation										
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause	
<input type="checkbox"/> Applicable Federal Requirement		<input type="checkbox"/> Capping		CAS No.			Contaminant Name			
<input type="checkbox"/> State Only Requirement										
Monitoring Information										
<input type="checkbox"/> Ambient Air Monitoring			<input type="checkbox"/> Work Practice Involving Specific Operations				<input type="checkbox"/> Record Keeping/Maintenance Procedures			
Description										
Work Practice		Process Material					Reference Test Method			
Type	Code	Description								
Code		Parameter				Manufacturer Name/Model No.				
		Description								
Limit			Limit Units							
Upper	Lower	Code	Description							
Averaging Method			Monitoring Frequency			Reporting Requirements				
Code	Description		Code	Description		Code	Description			

Facility Emissions Summary					<input type="checkbox"/> Continuation Sheet(s)	
CAS No.	Contaminant Name	PTE		Actual (lbs/yr)		
		(lbs/yr)	Range Code			
NY075 - 00 - 5	PM-10					
NY075 - 00 - 0	PARTICULATES					
7446 - 09 - 5	SULFUR DIOXIDE					
NY210 - 00 - 0	OXIDES OF NITROGEN					
630 - 08 - 0	CARBON MONOXIDE					
7439 - 92 - 1	LEAD					
NY998 - 00 - 0	VOC	117				
NY100 - 00 - 0	HAP	110				
0079 - 01 - 6	Trichloroethylene	99				
00075 - 01 - 4	Vinyl Chloride	3.7				
00540 - 59 - 0	1,2-Dichloroethylene	7.3				
-	-					
-	-					

New York State Department of Environmental Conservation  
Air Permit Application



DEC ID									
-									

**Section IV - Emission Unit Information**

<b>Emission Unit Description</b>										<input type="checkbox"/> Continuation Sheet(s)
EMISSION UNIT	0	-	0	0	E	U	1			
Air Stripper AS-1 for groundwater remediation, provided with activated carbon for emission control.										
The emission point is stack 00ST-1. The 2-stage VGAC is followed by a 3rd vessel containing a potassium permanganate zeolite media for increased VC capacity.										

<b>Building</b>					<input type="checkbox"/> Continuation Sheet(s)
Building	Building Name		Length (ft)	Width (ft)	Orientation
BLDG-1	Treatment Plant		75	75	0

<b>Emission Point</b>							<input type="checkbox"/> Continuation Sheet(s)
EMISSION PT.	00ST1						
Ground Elev. (ft)	Height (ft)	Height Above Structure (ft)	Inside Diameter (in)	Exit Temp. (°F)	Cross Section		
90	40	15	36	80	Length (in)	Width (in)	
Exit Velocity (FPS)	Exit Flow (ACFM)	NYTM (E) (KM)	NYTM (N) (KM)	Building	Distance to Property Line (ft)	Date of Removal	
19	8020			BLDG-1	50		
EMISSION PT.							
Ground Elev. (ft)	Height (ft)	Height Above Structure (ft)	Inside Diameter (in)	Exit Temp. (°F)	Cross Section		
					Length (in)	Width (in)	
Exit Velocity (FPS)	Exit Flow (ACFM)	NYTM (E) (KM)	NYTM (N) (KM)	Building	Distance to Property Line (ft)	Date of Removal	

<b>Emission Source/Control</b>								<input type="checkbox"/> Continuation Sheet(s)
Emission Source		Date of Construction	Date of Operation	Date of Removal	Control Type		Manufacturer's Name/Model No.	
ID	Type				Code	Description		
AS-1	I				048	Granular Act. Carbon	Air Stripping Column	
Design Capacity	Design Capacity Units			Waste Feed		Waste Type		
	Code	Description		Code	Description	Code	Description	
Emission Source		Date of Construction	Date of Operation	Date of Removal	Control Type		Manufacturer's Name/Model No.	
ID	Type				Code	Description		
Design Capacity	Design Capacity Units			Waste Feed		Waste Type		
	Code	Description		Code	Description	Code	Description	

New York State Department of Environmental Conservation  
Air Permit Application



DEC ID									
-									

**Section IV - Emission Unit Information (continued)**

Process Information										<input type="checkbox"/> Continuation Sheet(s)	
EMISSION UNIT 0 - 00 E U 1								PROCESS		P R 1	
Description											
The remedial system is air stripping, using a packed column at a groundwater flow rate of 1,100 gpm (plus 100 gpm recycle, for a total of 1,200 gpm). Vapor phase treatment includes the use of 3 vessels, a 2-stage GAC unit, followed by a 3rd vessel containing a potassium permanganate impregnated zeolite for increased VC capacity. Prior to entering the vapor-phase GAC adsorption system, the humidity of the air stripper exhaust is reduced to approximately 50 percent or less to optimize the efficiency of the vapor-phase GAC.											
Air Stripper AS-1: Existing. Type: Vertical, Cylindrical Construction: Aluminum											
Packing: 25-foot Jaeger Tripack. Dimensions: 10.0 ft. Dia x 47 ft. H											
Source Classification Code (SCC)		Total Thruput		Thruput Quantity Units							
		Quantity/Hr	Quantity/Yr	Code	Description						
<input type="checkbox"/> Confidential <input checked="" type="checkbox"/> Operating at Maximum Capacity <input type="checkbox"/> Activity with Insignificant Emissions		Operating Schedule		Building		Floor/Location					
		Hrs/Day	Days/Yr								
		24	365	BLDG-1		Main					
Emission Source/Control Identifier(s)											
AS-1											
EMISSION UNIT -								PROCESS			
Description											
Source Classification Code (SCC)		Total Thruput		Thruput Quantity Units							
		Quantity/Hr	Quantity/Yr	Code	Description						
<input type="checkbox"/> Confidential <input type="checkbox"/> Operating at Maximum Capacity <input type="checkbox"/> Activity with Insignificant Emissions		Operating Schedule		Building		Floor/Location					
		Hrs/Day	Days/Yr								
Emission Source/Control Identifier(s)											

New York State Department of Environmental Conservation  
Air Permit Application



DEC ID									
-									

**Section IV - Emission Unit Information (continued)**

Emission Unit	Emission Point	Process	Emission Source	Emission Unit Applicable Federal Requirements										<input type="checkbox"/> Continuation Sheet(s)	
				Title	Type	Part	Sub Part	Section	Sub Division	Parag.	Sub Parag.	Clause	Sub Clause		
-															
-															
-															
-															

Emission Unit	Emission Point	Process	Emission Source	Emission Unit State Only Requirements										<input type="checkbox"/> Continuation Sheet(s)	
				Title	Type	Part	Sub Part	Section	Sub Division	Parag.	Sub Parag.	Clause	Sub Clause		
-															
-															
-															
-															

Emission Unit Compliance Certification										<input type="checkbox"/> Continuation Sheet(s)
<b>Rule Citation</b>										
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause	
6	NYCRR	212								
<input checked="" type="checkbox"/> Applicable Federal Requirement			<input type="checkbox"/> State Only Requirement			<input type="checkbox"/> Capping				
Emission Unit	Emission Point	Process	Emission Source	CAS No.			Contaminant Name			
0-00EU1	00ST1	PR1	AS-1	00079 - 01 - 6			Trichloroethylene			
<b>Monitoring Information</b>										
<input type="checkbox"/> Continuous Emission Monitoring <input checked="" type="checkbox"/> Intermittent Emission Testing <input type="checkbox"/> Ambient Air Monitoring					<input type="checkbox"/> Monitoring of Process or Control Device Parameters as Surrogate <input type="checkbox"/> Work Practice Involving Specific Operations <input type="checkbox"/> Record Keeping/Maintenance Procedures					
<b>Description</b>										
Monthly grab samples analyzed for VOCs from the vapor phase treatment system influent, effluent and two intermediate locations.										
Work Practice		Process Material				Reference Test Method				
Type	Code	Description								
Parameter		Manufacturer Name/Model No.								
Code	Description									
23	Concentration									
Limit			Limit Units							
Upper	Lower	Code	Description							
3,125		255	micrograms per cubic meter							
Averaging Method		Monitoring Frequency		Reporting Requirements						
Code	Description	Code	Description	Code	Description					
01	Instantaneous	05	Monthly	10	Upon Request					



New York State Department of Environmental Conservation  
Air Permit Application



DEC ID									
-									

**Section IV - Emission Unit Information (continued)**

Determination of Non-Applicability (Title V Only) N/A <input type="checkbox"/> Continuation Sheet(s)										
Rule Citation										
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause	
Emission Unit	Emission Point	Process	Emission Source			<input type="checkbox"/> Applicable Federal Requirement <input type="checkbox"/> State Only Requirement				
Description										
Rule Citation										
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause	
Emission Unit	Emission Point	Process	Emission Source			<input type="checkbox"/> Applicable Federal Requirement <input type="checkbox"/> State Only Requirement				
Description										
Process Emissions Summary <input type="checkbox"/> Continuation Sheet(s)										
EMISSION UNIT	0 - 0 0 E U 1					PROCESS	P	R	1	
CAS No.	Contaminant Name			% Thruput	% Capture	% Control	ERP (lbs/hr)	ERP How Determined		
0079 - 01 - 6	Trichloroethylene					95	1.87	02		
PTE			Standard Units	PTE How Determined		Actual				
(lbs/hr)	(lbs/yr)	(standard units)				(lbs/hr)	(lbs/yr)			
0.09	99			02						
EMISSION UNIT	0 - 0 0 E U 1					PROCESS	P	R	1	
CAS No.	Contaminant Name			% Thruput	% Capture	% Control	ERP (lbs/hr)	ERP How Determined		
00075 - 01 - 4	Vinyl Chloride					95	0.17	03		
PTE			Standard Units	PTE How Determined		Actual				
(lbs/hr)	(lbs/yr)	(standard units)				(lbs/hr)	(lbs/yr)			
0.01	3.7			02						
EMISSION UNIT	0 - 0 0 E U 1					PROCESS	P	R	1	
CAS No.	Contaminant Name			% Thruput	% Capture	% Control	ERP (lbs/hr)	ERP How Determined		
000540 - 59 - 0	1,2-Dichloroethylene					95	0.6	02		
PTE			Standard Units	PTE How Determined		Actual				
(lbs/hr)	(lbs/yr)	(standard units)				(lbs/hr)	(lbs/yr)			
0.03	7.3			02						

New York State Department of Environmental Conservation  
Air Permit Application



DEC ID									
-									

**Section IV - Emission Unit Information (continued)**

EMISSION UNIT		Emission Unit Emissions Summary				<input type="checkbox"/> Continuation Sheet(s)
0	-	0	0	E	U	1
CAS No.		Contaminant Name				
00107- 06 - 2		1,2-Dichloroethane				
ERP (lbs/yr)	PTE Emissions		Actual			
	(lbs/hr)	(lbs/yr)	(lbs/hr)	(lbs/yr)		
13.4	Below Reporting Threshold BRT					
CAS No.		Contaminant Name				
00108 - 88 - 3		Toluene				
ERP (lbs/yr)	PTE Emissions		Actual			
	(lbs/hr)	(lbs/yr)	(lbs/hr)	(lbs/yr)		
72.7	BRT		BRT			
CAS No.		Contaminant Name				
01330- 20 - 7		Xylene				
ERP (lbs/yr)	PTE Emissions		Actual			
	(lbs/hr)	(lbs/yr)	(lbs/hr)	(lbs/yr)		
77.1	BRT		BRT			
CAS No.		Contaminant Name				
-		1,1,2-Trichloroethane				
ERP (lbs/yr)	PTE Emissions		Actual			
	(lbs/hr)	(lbs/yr)	(lbs/hr)	(lbs/yr)		
	BRT		BRT			

Compliance Plan													<input type="checkbox"/> Continuation Sheet(s)
For any emission units which are <u>not in compliance</u> at the time of permit application, the applicant shall complete the following													
Consent Order			Certified progress reports are to be submitted every 6 months beginning ____ / ____ / ____										
Emission Unit	Process	Emission Source	Applicable Federal Requirement										
			Title	Type	Part	Sub Part	Section	Sub Division	Parag.	Sub Parag.	Clause	Sub Clause	
Remedial Measure / Intermediate Milestones										R/I	Date Scheduled		

New York State Department of Environmental Conservation  
Air Permit Application



DEC ID									
-									

**Section IV - Emission Unit Information (continued)**

Request for Emission Reduction Credits										<input type="checkbox"/> Continuation Sheet(s)														
EMISSION UNIT										-														
Emission Reduction Description																								
Contaminant Emission Reduction Data																								
Baseline Period										/					to					/				
										Date					Method									
										/					/									
CAS No.					Contaminant Name										ERC (lbs/yr)									
-					-										Netting					Offset				
-					-										-					-				
-					-										-					-				
Facility to Use Future Reduction																								
Name										APPLICATION ID														
-										-														
Location Address																								
<input type="checkbox"/> City / <input type="checkbox"/> Town / <input type="checkbox"/> Village										State					Zip									

Use of Emission Reduction Credits										<input type="checkbox"/> Continuation Sheet(s)														
EMISSION UNIT										-														
Proposed Project Description																								
Contaminant Emissions Increase Data																								
CAS No.					Contaminant Name										PEP (lbs/yr)									
-					-										-									
Statement of Compliance																								
<input type="checkbox"/> All facilities under the ownership of this "ownership/firm" are operating in compliance with all applicable requirements and state regulations including any compliance certification requirements under Section 114(a)(3) of the Clean Air Act Amendments of 1990, or are meeting the schedule of a consent order.																								
Source of Emission Reduction Credit - Facility																								
Name										PERMIT ID														
-										-														
Location Address																								
<input type="checkbox"/> City / <input type="checkbox"/> Town / <input type="checkbox"/> Village										State					Zip									
Emission Unit					CAS No.					Contaminant Name					ERC (lbs/yr)									
-					-					-					Netting					Offset				
-					-					-					-					-				
-					-					-					-					-				



DEC ID									
-									

Supporting Documentation

- P.E. Certification (form attached)
- List of Exempt Activities (form attached)
- Plot Plan
- Methods Used to Determine Compliance (form attached)
- Calculations
- Air Quality Model ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- Confidentiality Justification
- Ambient Air Monitoring Plan ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- Stack Test Protocols/Reports ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- Continuous Emissions Monitoring Plans/QA/QC ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- MACT Demonstration ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- Operational Flexibility: Description of Alternative Operating Scenarios and Protocols
- Title IV: Application/Registration
- ERC Quantification (form attached)
- Use of ERC(s) (form attached)
- Baseline Period Demonstration
- Analysis of Contemporaneous Emission Increase/Decrease
- LAER Demonstration ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- BACT Demonstration ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- Other Document(s): \_\_\_\_\_ ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- \_\_\_\_\_ ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- \_\_\_\_\_ ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- \_\_\_\_\_ ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- \_\_\_\_\_ ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- \_\_\_\_\_ ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- \_\_\_\_\_ ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- \_\_\_\_\_ ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- \_\_\_\_\_ ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- \_\_\_\_\_ ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- \_\_\_\_\_ ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- \_\_\_\_\_ ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- \_\_\_\_\_ ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )

**ATTACHMENT B**

**2008 EMISSION ESTIMATES BASED ON 95% REMOVAL**

**ATTACHMENT 1  
Emission Estimate**

POTENTIAL EMISSION ESTIMATES,  
USED TO DEVELOP 95% REDUCTION  
OF EMISSION VALUES AS BASED ON  
INFLUENT GROUNDWATER CONCENTRATIONS  
(95% REDUCTION OF EMISSION  
VALUES ARE PROVIDED  
ON PAGE 7 OF THE 2008 AIR  
PERMIT APPLICATION PROCESS  
EMISSIONS SUMMARY)

Feed Water Flow 1,100 gpm: max or normal  
250 m<sup>3</sup>/hr  
Water Flow Including Recycle 1,200 gpm: max or normal  
273 m<sup>3</sup>/hr  
Air Flow 8,000 cfm  
13,592 m<sup>3</sup>/hr  
A/W vol ratio 50

EXAMPLE EMISSION CALC: Vinyl Chloride  
4.8 ug/L x 1000 L/m<sup>3</sup> x 250 m<sup>3</sup> water/13,623 m<sup>3</sup> air = 88 ug/m<sup>3</sup>

Name	CAS Number	Toxicity: H/M/L <sup>2</sup>	VOC <sup>3</sup>	HAP <sup>4</sup>	GW Conc. <sup>1</sup>		Effluent Conc. <sup>1</sup>		Uncontrolled Stripper Exhaust							
					Max ug/L	Avg ug/L	Max ug/L	Avg ug/L	Max lb/day	Avg lb/day	Max lb/hr	Avg lb/hr	Max gm/sec	Avg gm/sec	Max ug/m <sup>3</sup>	Avg ug/m <sup>3</sup>
1,1,1-Trichloroethane (Methyl Chloroform)	00071-55-6	L	No	Yes	3	3.0			0.04	0.04	0.00	0.00	2.08E-04	2.08E-04	55	55
1,1,2-Trichloroethane	00079-00-5	M	Yes	Yes	3.5	0.3			0.05	0.00	0.00	0.00	2.43E-04	2.08E-05	64	6
1,1-Dichloroethane	00075-34-3	L	Yes	Yes	4	0.7			0.05	0.01	0.00	0.00	2.77E-04	4.85E-05	74	13
1,2-Dichloroethane	00107-06-2	M	Yes	Yes	3	1.0	0.3	0.1	0.04	0.01	0.00	0.00	1.87E-04	6.24E-05	55	18
1,1-Dichloroethylene (Vinylidene Chloride)	00075-35-4	M	Yes	Yes	9	1.6			0.12	0.02	0.00	0.00	6.24E-04	1.11E-04	165	29
1,2-Dichloroethylene	00540-59-0	M	Yes	No	1,100	31.5	1.3	0.0	14.51	0.42	0.60	0.02	7.62E-02	2.18E-03	20,219	579
Benzene	00071-43-2	H	Yes	Yes	4	0.1			0.05	0.00	0.00	0.00	2.77E-04	6.94E-06	74	2
Carbon Tetrachloride	00056-23-5	H	Yes	Yes	4	0.1			0.05	0.00	0.00	0.00	2.77E-04	6.94E-06	74	2
Chlorobenzene (Monochlorobenzene)	00108-90-7	M	Yes	Yes	1	0.1			0.01	0.00	0.00	0.00	6.94E-05	6.94E-06	18	2
Chloroform	00067-66-3	M	Yes	Yes	2	0.8			0.03	0.01	0.00	0.00	1.39E-04	5.55E-05	37	15
Methyl Tert Butyl Ether	01634-04-4	M	Yes	Yes	2	0.1			0.03	0.00	0.00	0.00	1.39E-04	6.94E-06	37	2
Tetrachloroethylene	00127-18-4	M	Yes	Yes	900	33.8	0.9	0.0	11.88	0.45	0.49	0.02	6.24E-02	2.34E-03	16,543	621
Toluene	00108-88-3	L	Yes	Yes	15	0.7			0.20	0.01	0.01	0.00	1.04E-03	4.85E-05	276	13
Trichloroethylene	00079-01-6	M	Yes	Yes	3,400	411.5	4.5	0.5	44.86	5.43	1.87	0.23	2.35E-01	2.85E-02	62,494	7,564
Vinyl chloride	00075-01-4	H	Yes	Yes	300	4.8	0.0	0.0	3.96	0.06	0.17	0.00	2.08E-02	3.33E-04	5,514	88
Xylenes	01330-20-7	M	Yes	Yes	16	0.2			0.21	0.00	0.01	0.00	1.11E-03	1.39E-05	294	4
Total VOCs					5,764	487.3	7.0	0.6	76.05	6.43	3.17	0.27				
Total HAPs					4,667	458.8	5.7	0.6	61.57	6.05	2.57	0.25				

Total Uncontrolled VOC 2,347 lb/yr  
Total Uncontrolled HAP 2,209 lb/yr

1. Source: "GM-38 Groundwater Remedy Analysis Report", February 2003
2. Source: DAR-1 AGC/SGC Tables, NYSDEC Division of Air Resources, Air Toxics Section, September 10, 2007.
3. Source: 6 NYCRR Part 200.1(cg)
4. Source: 6 NYCRR Part 200.1(ag)

**ATTACHMENT 1  
Emission Estimate**

Feed Water Flow 1,100 gpm: max or normal  
250 m<sup>3</sup>/hr  
Water Flow Including Recycle 1,200 gpm: max or normal  
273 m<sup>3</sup>/hr  
Air Flow 8,000 cfm  
13,592 m<sup>3</sup>/hr  
A/W vol ratio 50

Name	CAS Number	Toxicity: H/M/L <sup>2</sup>	VOC <sup>3</sup>	HAP <sup>4</sup>	Control by GAC	Controlled Stripper Exhat			
						Max lb/day	Avg lb/day	Max gm/sec	Avg gm/sec
1,1,1-Trichloroethane (Methyl Chloroform)	00071-55-6	L	No	Yes	95%	0.00	0.00	1.04E-05	1.04E-05
1,1,2-Trichloroethane	00079-00-5	M	Yes	Yes	95%	0.00	0.00	1.21E-05	1.04E-06
1,1-Dichloroethane	00075-34-3	L	Yes	Yes	95%	0.00	0.00	1.39E-05	2.43E-06
1,2-Dichloroethane	00107-06-2	M	Yes	Yes	95%	0.00	0.00	9.36E-06	3.12E-06
1,1-Dichloroethylene (Vinylidene Chloride)	00075-35-4	M	Yes	Yes	95%	0.01	0.00	3.12E-05	5.55E-06
1,2-Dichloroethylene	00540-59-0	M	Yes	No	95%	0.73	0.02	3.81E-03	1.09E-04
Benzene	00071-43-2	H	Yes	Yes	95%	0.00	0.00	1.39E-05	3.47E-07
Carbon Tetrachloride	00056-23-5	H	Yes	Yes	95%	0.00	0.00	1.39E-05	3.47E-07
Chlorobenzene (Monochlorobenzene)	00108-90-7	M	Yes	Yes	95%	0.00	0.00	3.47E-06	3.47E-07
Chloroform	00067-66-3	M	Yes	Yes	95%	0.00	0.00	6.94E-06	2.77E-06
Methyl Tert Butyl Ether	01634-04-4	M	Yes	Yes	95%	0.00	0.00	6.94E-06	3.47E-07
Tetrachloroethylene	00127-18-4	M	Yes	Yes	95%	0.59	0.02	3.12E-03	1.17E-04
Toluene	00108-88-3	L	Yes	Yes	95%	0.01	0.00	5.20E-05	2.43E-06
Trichloroethylene	00079-01-6	M	Yes	Yes	95%	2.24	0.27	1.18E-02	1.43E-03
Vinyl chloride	00075-01-4	H	Yes	Yes	95%	0.20	0.00	1.04E-03	1.66E-05
Xylenes	01330-20-7	M	Yes	Yes	95%	0.01	0.00	5.55E-05	6.94E-07
Total VOCs						3.80	0.32		
Total HAPs						3.08	0.30		
						Total Controlled VOC		117 lb/yr	
						Total Controlled HAP		110 lb/yr	

1. Source: "GM-38 Groundwater Remedy Analysis Report", February 2003
2. Source: DAR-1 AGC/SGC Tables, NYSDEC Division of Air Resources, Air Tox
3. Source: 6 NYCRR Part 200.1(cg)
4. Source: 6 NYCRR Part 200.1(ag)

**ATTACHMENT C**  
**2011 DISCHARGE GOALS AND 2011 DAR-1 ANALYSIS**



Tetra Tech NUS		STANDARD CALCULATION SHEET	
CLIENT: US CLEAN	FILE No:	BY: SK	PAGE: 1 of 1
SUBJECT: Calculation of Current Discharge Goals GM-38 Area NWIRP Bethpage, New York		CHECKED BY:	DATE: 9/7/2011

**1. Purpose:**

To calculate current discharge goals for Trichloroethene (TCE), Tetrachloroethene (PCE), Vinyl Chloride, cis 1,2-Dichloroethene, and 1,2-Dichloroethene (total), for treatment of off-gas from the air stripper stack AS-1.

**2. Approach:**

From the Contaminant Assessment Summary of the DAR-1 Model output for TCE, PCE, Vinyl Chloride, cis 1,2-Dichloroethene, and 1,2-Dichloroethene (total) (see DAR-1 output for analysis inputs), use the Actual Annual % of the Annual Guideline Concentration (AGC), a current average flow rate of 9,200 cubic feet per minute (cfm), and influent chemical emission rates in pounds per hour (lb/hour) and pounds per year (lb/year) to back calculate current discharge goals.

**3. Calculation of Current Discharge Goals:**

Chemical	Current Actual Annual % of AGC <sup>(1)</sup>	Current Maximum Concentration (µg/m <sup>3</sup> ) <sup>(2)</sup>	Current Chemical Emission Rate Prior to Treatment (lb/hour) <sup>(3)</sup>	Current Chemical Emission Rate Prior to Treatment (lb/year) <sup>(3)</sup>	Calculated Discharge Goal (lb/hr) <sup>(4)</sup>	Calculated Discharge Goal (lb/year) <sup>(4)</sup>	Maximum Allowable Concentration (µg/m <sup>3</sup> ) <sup>(4)</sup>
TCE	390.6	10,000	0.3446	3,019	0.0882	770	2,600
PCE	132.8	6,800	0.2344	2,053	0.1764	1,500	5,100
Vinyl Chloride	13.49	76	0.0026	22.94	0.0194	170	560
cis 1,2-Dichloroethene	0.2322	750	0.0258	226.4	11.13	98,000	320,000
1,2-Dichloroethene (total)	0.2322	750	0.0258	226.4	11.13	98,000	320,000

**Notes:**

<sup>(1)</sup>Actual Annual % of the AGCs is from the attached DAR-1 Model Output.

<sup>(2)</sup>Values were taken from the Quarterly Operations Report First Quarter 2011 (June 2011) from ECOR Federal Services. Values were the maximum effluent concentration in off gas from air stripper stack AS-1 for the months of January, February, and March 2011.

<sup>(3)</sup>Chemical Emission Rates were calculated from maximum concentrations and an average flow rate of 9,200 cfm.

<sup>(4)</sup>Discharge Goals are based on a flow of 9,200 cfm, and calculated from the Actual Annual % of the AGCs from the DAR-1 Model Output to achieve air quality requirements. The summary of additional inputs for this model run is provided in the DAR-1 Model Output. Stack height is 40 feet, and the property line was evaluated at a distance of 50 feet.

BETHPAGE SITE GM-38 OFF-SITE GROUNDWATER AIR STRIPPER STACK EMISSIONS  
 DAR-1 MODEL OUTPUT, POINT SOURCE (STACK EMISSIONS) TYPE  
 INCLUDES ISCLT MODELING SUMMARY

- I. Summary of Inputs for Model Run to Nearest Property Line (50 feet), worst case scenario (highest contaminant concentrations seen in first quarter 2011 in untreated effluent from Air Stripper AS-1 prior to treatment with granular activated carbon (GAC))

Chemical	CAS No. 00079-01-6 (TCE)	CAS No. 00127-18-4 (PCE)	CAS No. 00075-01-4 (Vinyl Chloride)	CAS No. 00156-59-2 (cis 1,2- Dichloroethene)	CAS No. 00540-59-0 (1,2- Dichloroethene, total)
Emission Rate Prior to Treatment <sup>(1)</sup> (lb/hour)	0.3444	0.2342	0.0026	0.0258	0.0258
Emission Rate Prior to Treatment <sup>(1)</sup> (lb/year)	3,017	2,052	22.93	226.0	226.0
Maximum Concentration of Untreated Off Gas ( $\mu\text{g}/\text{m}^3$ ) <sup>(1)</sup>	10,000	6,800	76	750	750
Annual Guideline Concentration (AGC) ( $\mu\text{g}/\text{m}^3$ )	0.5	1.0	0.11	63	63
Short-term Guideline Concentration (SGC) ( $\mu\text{g}/\text{m}^3$ )	14,000	1,000	180,000	--	--

HA	Height Above stack/ maximum height of plume (HA, feet)	15
SH	Stack Height/Treatment Building Air Stack (SH, feet)	40
D	Stack Diameter (D, inches)	36
T	Stack Exit Temperature (T, degrees Fahrenheit)	80
V	Stack Exit Velocity (V, ft/sec)	21.69
Q <sup>(2)</sup>	Stack Exit Flow Rate [Q, Actual Cubic Feet per Minute (ACFM)]	9,200
Dpl	Shortest Distance from Source Building (Treatment Building) to Property Line (Dpl, feet) for point sources	50
BW	Building Width (BW, feet) of Source Building (Treatment Building) for point sources	75
BL	Building Length (BL, feet) of Source Building (Treatment Building)	75
Q	Actual Hourly Emission Rate (lbs/hour) for source contaminant	Chemical specific, see above
Qa	Actual Annual Emission Rate (lbs/year) for source contaminant	Chemical specific, see above

<sup>(1)</sup> Emission rates and maximum concentration values were taken from the Quarterly Operations Report First Quarter (June 2011) as provided by ECOR Services, using January, February, and March 2011 maximum rates of untreated off gas from Air Stripper AS-1 in the

GM-38 Treatment Building. Emission rates are based on continuous operation 24 hours per day, 7 days a week, 52 weeks a year, or approximately 8,760 hours of operation.

<sup>(2)</sup> "Q" is an average value of January and February 2011 monthly flow rates. Effective water and vapor flow rates were reduced during the reporting period of March due to a shutdown of the Treatment Plant on March 23, 2011.

II. Contaminant Assessment Summary of TCE, PCE, Vinyl Chloride, cis 1,2-Dichloroethene, and 1,2-Dichloroethene (total):

CONTAMINANT ASSESSMENT SUMMARY OF DAR-1 ANALYSIS						9/ 8/11
						Page 1
CAS NUMBER	AGC ug/m3	SHORT-TERM	CAVITY	POINT or AREA SOURCE		
		MAXIMUM (Cav. Pt. Area) % OF SGC	ACTUAL ANNUAL % OF AGC	POTENTIAL ANNUAL % OF AGC	ACTUAL ANNUAL % OF AGC	
00075-01-4	0.11000000	0.0005	0.0000	13.3889	13.4948	
00079-01-6	0.50000000	0.7757	0.0000	390.1734	390.6266	
00127-18-4	1.00000000	7.3852	0.0000	132.6635	132.8415	
00156-59-2	63.00000000	0.0000	0.0000	0.2320	0.2322	
00540-59-0	63.00000000	0.0000	0.0000	0.2320	0.2322	
SUMMARY TOTALS		8.1614	0.0000	536.6897	537.4274	

III. Contaminant Impact Summary of TCE, PCE, Vinyl Chloride, cis 1,2-Dichloroethene, and 1,2-Dichloroethene (total):

CONTAMINANT IMPACT SUMMARY OF DAR-1 ANALYSIS						9/ 8/11
						Page 1
CAS NUMBER	AGC ug/m3	SHORT-TERM	CAVITY	POINT or AREA SOURCE		
		MAXIMUM (Cav. Pt. Area) ug/m3	ACTUAL ANNUAL ug/m3	POTENTIAL ANNUAL ug/m3	ACTUAL ANNUAL ug/m3	
00075-01-4	0.11000000	0.81988204	0.00000000	0.01472780	0.01484433	
00079-01-6	0.50000000	108.60282900	0.00000000	1.95086694	1.95113296	
00127-18-4	1.00000000	73.85244750	0.00000000	1.32663476	1.32841504	
00156-59-2	63.00000000	8.13575172	0.00000000	0.14614509	0.14630693	
00540-59-0	63.00000000	8.13575172	0.00000000	0.14614509	0.14630693	

IV. Contaminant Impact Summary Step by Step Menu for TCE:

```

*****
NWIRP BETHPAGE GM-38 AREA          BETHPAGE          OYSTER BAY, NEW
EMISSION POINT =          TOTAL          CAS NUMBER = 00079-01-6          SIC = 0
AGC =          0.500000000 ug/m3          SGC =          14000.000000 ug/m3
STACK: HA= 15., SH= 40., D= 36., T= 80., U= 21.69, q= 9200.00
BUILDING: Dpl= 50., BW= 75., BL= 75., %CONTROL= 0.0000
** Reported Hourly Emission Rate <Q> is equal to          0.344400000 lbs/hour.
** Reported Annual Emission Rate <Qa> is equal to          3017.000000 lbs/year.
II.B. REFINED CAVITY IMPACT METHOD <DAR-1, APPENDIX B>.
II.B.1. Shortest Distance from building to Property Line < 50. feet >
is less than or equal to the cavity length, or 3 building
heights < 75. feet >. Therefore, this building will have
cavity impacts <if they occur> at receptors off plant property.
II.B.2. The largest building dimension < 75. feet > is greater than or
equal to the building height < 25. feet >. Therefore, the
computer will NOT redefine the cavity length.
II.B.3. Stack height < 40. feet > is greater than cavity height
< 38. feet >. Therefore, this source does not contribute to
the buildings cavity impact. The Computer will assume the
CAVITY Annual Impact equals 0.00 ug/m3.
II.C. CAVITY Annual Impact < 0.000 ug/m3 > is less than AGC
< 0.500 ug/m3 >.
III.A. STANDARD POINT SOURCE METHOD <DAR-1, APPENDIX B>.
III.A.1.b. Momentum flux, Fm, is equal to 1000.331 ft<4>/sec<2>.
III.A.1.b. Effective stack height, he, is equal to 51.001 feet.
III.A.2. STANDARD POINT SOURCE Actual Annual Impact is equal
to 2.604 ug/m3 for 8760. hours/year of operation.
III.A.3. STANDARD POINT SOURCE Potential Annual Impact is equal
to 2.601 ug/m3 assuming 8,760 hours/year of operation.
III.A.4.a. Stack height to building height ratio is greater than
1.5, but less than 2.5. Computer will multiply actual
annual & potential annual impacts by 0.75 factor.

```

III.A.5. STANDARD POINT SOURCE Short-Term Impact is calculated below using the DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.

III.D. STANDARD POINT SOURCE Actual Annual Impact < 1.953 ug/m3 > is greater than AGC < 0.500 ug/m3 >.

\*\*\*\* Refer to DAR-1 Section III.D.1. A refined site \*\*\*\*  
 \*\*\*\* specific modeling analysis may be required. \*\*\*\*

III.D. STANDARD POINT SOURCE Potential Annual Impact < 1.951 ug/m3 > is greater than AGC < 0.500 ug/m3 >.

\*\*\*\* Potential Annual Impact is based upon 8760 hours/year \*\*\*\*  
 \*\*\*\* operation instead of reported 8760. hours/year. \*\*\*\*

2.0 DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.  
 See "Technical Reference for the Screening Procedures of the DAR-1 Software Program, Wade/Sedefian," 1/11/94.

2.2 CAVITY Short-Term Impact is equal to 0.00 ug/m3 as the plume escaped the cavity region:  $h_s < 40. \text{ feet} > > h_c < 26. \text{ feet} >$ .

II.C. CAVITY Short-Term Impact < 0.000 ug/m3 > is less than SGC < 14000.000 ug/m3 >.

2.3 Momentum flux,  $F_m$ , is equal to 1000.331 ft(4)/sec(2).

2.3 Effective stack height,  $h_e$ , is equal to 51.001 feet.

2.4 Maximum non-downwash GEP stack Short-Term Impact (GSTP) is equal to 38.826 ug/m3, for  $h_s/h_b = 1.60$

2.5 Maximum downwash Short-Term Impact (GSTD) is equal to 129.908 ug/m3, for:  $h_s/h_b = 1.60$  and ESH = 51. feet.

2.6 Adjusted maximum downwash Short-Term (GSTD) is equal to 108.603 ug/m3, for: RF = 0.84

III.D. Maximum non-cavity Short-Term Impact (CST: 108.603 ug/m3 > is less than the SGC < 14000.000 ug/m3 > for the point source.

2.7 Maximum Short-Term cavity, point, or area source impact (SHORT-TERM MAXIMUM, (Cav,Pt,Area)) equals 108.603 ug/m3 and is reported in the ANALYSIS MENU. This value is less than the SGC < 14000.000 ug/m3 >.

V. Contaminant Impact Summary Step by Step Menu for PCE:

```

*****
NWIRP BETHPAGE GM-38 AREA          BETHPAGE          OYSTER BAY, MEV
EMISSION POINT =          TOTAL          CAS NUMBER = 00127-18-4          SIC = 0
AGC =          1.000000000 ug/m3          SGC =          1000.000000 ug/m3
STACK: HA=          15., SH=          40., D=          36., T=          80., U=          21.69, q=          9200.00
BUILDING: Dpl=          50., BW=          75., BL=          75., %CONTROL=          0.0000
** Reported Hourly Emission Rate (Q) is equal to          0.234200000 lbs/hour.
** Reported Annual Emission Rate (Qa) is equal to          2052.000000 lbs/year.
II.B. REFINED CAVITY IMPACT METHOD (DAR-1, APPENDIX B).
II.B.1. Shortest Distance from building to Property Line ( 50. feet )
is less than or equal to the cavity length, or 3 building
heights ( 75. feet ). Therefore, this building will have
cavity impacts (if they occur) at receptors off plant property.
II.B.2. The largest building dimension ( 75. feet ) is greater than or
equal to the building height ( 25. feet ). Therefore, the
computer will NOT redefine the cavity length.
II.B.3. Stack height ( 40. feet ) is greater than cavity height
( 38. feet ). Therefore, this source does not contribute to
the buildings cavity impact. The Computer will assume the
CAVITY Annual Impact equals 0.00 ug/m3.
II.C. CAVITY Annual Impact ( 0.000 ug/m3 ) is less than AGC
( 1.000 ug/m3 ).
III.A. STANDARD POINT SOURCE METHOD (DAR-1, APPENDIX B).
III.A.1.b. Momentum flux, Fm, is equal to 1000.331 ft<4>/sec<2>.
III.A.1.b. Effective stack height, he, is equal to 51.001 feet.
III.A.2. STANDARD POINT SOURCE Actual Annual Impact is equal
to 1.771 ug/m3 for 8762. hours/year of operation.
III.A.3. STANDARD POINT SOURCE Potential Annual Impact is equal
to 1.769 ug/m3 assuming 8,760 hours/year of operation.
III.A.4.a. Stack height to building height ratio is greater than
1.5, but less than 2.5. Computer will multiply actual
annual & potential annual impacts by 0.75 factor.

```

III.A.5. STANDARD POINT SOURCE Short-Term Impact is calculated below using the DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.

III.D. STANDARD POINT SOURCE Actual Annual Impact ( 1.328 ug/m3 ) is greater than AGC ( 1.000 ug/m3 ).

\*\*\*\* Refer to DAR-1 Section III.D.1. A refined site \*\*\*\*  
\*\*\*\* specific modeling analysis may be required. \*\*\*\*

III.D. STANDARD POINT SOURCE Potential Annual Impact ( 1.327 ug/m3 ) is greater than AGC ( 1.000 ug/m3 ).

\*\*\*\* Potential Annual Impact is based upon 8760 hours/year \*\*\*\*  
\*\*\*\* operation instead of reported 8762. hours/year. \*\*\*\*

2.0 DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.  
See "Technical Reference for the Screening Procedures of the DAR-1 Software Program, Wade/Sedefian," 1/11/94.

2.2 CAVITY Short-Term Impact is equal to 0.000 ug/m3 as the plume escaped the cavity region: hc( 40. feet ) > hc( 26. feet ).

II.C. CAVITY Short-Term Impact ( 0.000 ug/m3 ) is less than SGC ( 1000.000 ug/m3 ).

2.3 Momentum Flux,  $F_m$ , is equal to 1000.331 ft<sup>4</sup>/sec<sup>2</sup>.

2.3 Effective stack height,  $h_e$ , is equal to 51.001 feet.

2.4 Maximum non-downwash GEP stack Short-Term Impact (CSTP) is equal to 26.403 ug/m3, for  $h_c/h_b = 1.60$

2.5 Maximum downwash Short-Term Impact (CSTD) is equal to 88.340 ug/m3, for:  $h_c/h_b = 1.60$  and ESH = 51. feet.

2.6 Adjusted maximum downwash Short-Term (CSTD) is equal to 73.852 ug/m3, for: RF = 0.84

III.D. Maximum non-cavity Short-Term Impact (CST: 73.852 ug/m3 ) is less than the SGC ( 1000.000 ug/m3 ) for the point source.

2.7 Maximum Short-Term cavity, point, or area source impact (SHORT-TERM MAXIMUM, (Cav,Pt,Area)) equals 73.852 ug/m3 and is reported in the ANALYSIS MENU. This value is less than the SGC ( 1000.000 ug/m3 ).

VI. Contaminant Impact Summary Step by Step Menu for Vinyl Chloride:

```

*****
NWIRP BETHPAGE GM-38 AREA          BETHPAGE          OYSTER BAY, NEW
EMISSION POINT =          TOTAL          CAS NUMBER = 00075-01-4          SIC = 0
AGC =          0.110000000 ug/m3          SGC =          180000.000000 ug/m3
STACK: HA=          15., SH=          40., D=          36., I=          80., U=          21.69, q=          9200.00
BUILDING: Dpl=          50., BW=          75., BL=          75., %CONTROL=          0.0000
** Reported Hourly Emission Rate <Q> is equal to          0.002600000 lbs/hour.
** Reported Annual Emission Rate <Qa> is equal to          22.930000 lbs/year.
II.B. REFINED CAVITY IMPACT METHOD <DAR-1, APPENDIX B>.
II.B.1. Shortest Distance from building to Property Line < 50. feet >
is less than or equal to the cavity length, or 3 building
heights < 75. feet >. Therefore, this building will have
cavity impacts <if they occur> at receptors off plant property.
II.B.2. The largest building dimension < 75. feet > is greater than or
equal to the building height < 25. feet >. Therefore, the
computer will NOT redefine the cavity length.
II.B.3. Stack height < 40. feet > is greater than cavity height
< 38. feet >. Therefore, this source does not contribute to
the buildings cavity impact. The Computer will assume the
CAVITY Annual Impact equals 0.00 ug/m3.
II.C. CAVITY Annual Impact < 0.000 ug/m3 > is less than AGC
< 0.110 ug/m3 >.
III.A. STANDARD POINT SOURCE METHOD <DAR-1, APPENDIX B>.
III.A.1.b. Momentum flux, Fm, is equal to 1000.331 ft<4>/sec<2>.
III.A.1.b. Effective stack height, he, is equal to 51.001 feet.
III.A.2. STANDARD POINT SOURCE Actual Annual Impact is equal
to 0.020 ug/m3 for 8819. hours/year of operation.
III.A.3. STANDARD POINT SOURCE Potential Annual Impact is equal
to 0.020 ug/m3 assuming 8,760 hours/year of operation.
III.A.4.a. Stack height to building height ratio is greater than
1.5, but less than 2.5. Computer will multiply actual
annual & potential annual impacts by 0.75 factor.

```



III.A.5. STANDARD POINT SOURCE Short-Term Impact is calculated below using the DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.

III.D. STANDARD POINT SOURCE Actual Annual Impact < 0.015 ug/m3 > is less than AGC < 0.110 ug/m3 >.

III.D. STANDARD POINT SOURCE Potential Annual Impact < 0.015 ug/m3 > is less than AGC < 0.110 ug/m3 >.

\*\*\*\* Potential Annual Impact is based upon 8760 hours/year \*\*\*\*  
 \*\*\*\* operation instead of reported 8819. hours/year. \*\*\*\*

2.0 DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.  
 See "Technical Reference for the Screening Procedures of the DAR-1 Software Program, Wade/Sedefian," 1/11/94.

2.2 CAVITY Short-Term Impact is equal to 0.00 ug/m3 as the plume escaped the cavity region: hs< 40. feet > hc< 26. feet >.

II.C. CAVITY Short-Term Impact < 0.000 ug/m3 > is less than SGC < 180000.000 ug/m3 >.

2.3 Momentum flux,  $F_m$ , is equal to 1000.331 ft<4>/sec<2>.

2.3 Effective stack height,  $h_e$ , is equal to 51.001 feet.

2.4 Maximum non-downwash GEP stack Short-Term Impact (CSTP) is equal to 0.293 ug/m3, for  $h_s/h_b = 1.60$

2.5 Maximum downwash Short-Term Impact (CSTD) is equal to 0.981 ug/m3, for:  $h_s/h_b = 1.60$  and  $ESH = 51. feet.$

2.6 Adjusted maximum downwash Short-Term (CSTD) is equal to 0.820 ug/m3, for:  $RF = 0.84$

III.D. Maximum non-cavity Short-Term Impact (CST: 0.820 ug/m3 > is less than the SGC < 180000.000 ug/m3 > for the point source.

2.7 Maximum Short-Term cavity, point, or area source impact (SHORT-TERM MAXIMUM, (Cav,Pt,Area)) equals 0.820 ug/m3 and is reported in the ANALYSIS MENU. This value is less than the SGC < 180000.000 ug/m3 >.

VII. Contaminant Impact Summary Step by Step Menu for cis 1,2-Dichloroethene:

```

*****
NWIRP BETHPAGE GM-38 AREA          BETHPAGE          OYSTER BAY, NEW
EMISSION POINT =          TOTAL          CAS NUMBER = 00156-59-2          SIC = 0
AGC =          63.000000000 ug/m3          SGC =          0.000000 ug/m3
STACK: HA=          15., SH=          40., D=          36., I=          80., U=          21.69, q=          9200.00
BUILDING: Dpl=          50., BW=          75., BL=          75., %CONTROL=          0.0000
** Reported Hourly Emission Rate <Q> is equal to          0.025800000 lbs/hour.
** Reported Annual Emission Rate <Qa> is equal to          226.000000 lbs/year.
II.B. REFINED CAVITY IMPACT METHOD <DAR-1, APPENDIX B>.
II.B.1. Shortest Distance from building to Property Line < 50. feet >
is less than or equal to the cavity length, or 3 building
heights < 75. feet >. Therefore, this building will have
cavity impacts <if they occur> at receptors off plant property.
II.B.2. The largest building dimension < 75. feet > is greater than or
equal to the building height < 25. feet >. Therefore, the
computer will NOT redefine the cavity length.
II.B.3. Stack height < 40. feet > is greater than cavity height
< 38. feet >. Therefore, this source does not contribute to
the buildings cavity impact. The Computer will assume the
CAVITY Annual Impact equals 0.00 ug/m3.
II.C. CAVITY Annual Impact < 0.000 ug/m3 > is less than AGC
< 63.000 ug/m3 >.
III.A. STANDARD POINT SOURCE METHOD <DAR-1, APPENDIX B>.
III.A.1.b. Momentum flux, Fm, is equal to 1000.331 ft<4>/sec<2>.
III.A.1.b. Effective stack height, he, is equal to 51.001 feet.
III.A.2. STANDARD POINT SOURCE Actual Annual Impact is equal
to 0.195 ug/m3 for 8760. hours/year of operation.
III.A.3. STANDARD POINT SOURCE Potential Annual Impact is equal
to 0.195 ug/m3 assuming 8,760 hours/year of operation.
III.A.4.a. Stack height to building height ratio is greater than
1.5, but less than 2.5. Computer will multiply actual
annual & potential annual impacts by 0.75 factor.

```

III.A.5. STANDARD POINT SOURCE Short-Term Impact is calculated below using the DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.

III.D. STANDARD POINT SOURCE Actual Annual Impact < 0.146 ug/m3 > is less than AGC < 63.000 ug/m3 >.

III.D. STANDARD POINT SOURCE Potential Annual Impact < 0.146 ug/m3 > is less than AGC < 63.000 ug/m3 >.

\*\*\*\* Potential Annual Impact is based upon 8760 hours/year \*\*\*\*  
\*\*\*\* operation instead of reported 8760. hours/year. \*\*\*\*

2.0 DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.  
See 'Technical Reference for the Screening Procedures of the DAR-1 Software Program, Wade/Sedefian,' 1/11/94.

2.2 CAVITY Short-Term Impact is equal to 0.00 ug/m3 as the plume escaped the cavity region: hs( 40. feet) > hc( 26. feet).

II.C. CAVITY Short-Term Impact is equal to 0.000 ug/m3.  
There is no SGC for this contaminant.

2.3 Momentum flux, Fm, is equal to 1000.331 ft(4)/sec(2).

2.3 Effective stack height, he, is equal to 51.001 feet.

2.4 Maximum non-downwash GEP stack Short-Term Impact (CSTP) is equal to 2.909 ug/m3, for hs/hb = 1.60

2.5 Maximum downwash Short-Term Impact (CSTD) is equal to 9.732 ug/m3, for: hs/hb = 1.60 and ESH = 51. feet.

2.6 Adjusted maximum downwash Short-Term (CSTD) is equal to 8.136 ug/m3, for: RF = 0.84

III.D. Maximum non-cavity Short-Term Impact (CST) equals 8.136 ug/m3 for the point source. There is no SGC for this contaminant.

2.7 Maximum Short-Term cavity, point, or area source impact (SHORT-TERM MAXIMUM, (Cav,Pt,Area)) equals 8.136 ug/m3 and is reported in the ANALYSIS MENU.

VIII. Contaminant Impact Summary Step by Step Menu for 1,2-Dichloroethene (total):

```
*****
NWIRP BETHPAGE GM-38 AREA          BETHPAGE          OYSTER BAY, NEW
EMISSION POINT =          TOTAL          CAS NUMBER = 00540-59-0          SIC = 0
AGC =          63.000000000 ug/m3          SGC =          0.000000 ug/m3
STACK: HA=          15., SH=          40., D=          36., T=          80., U=          21.69, q=          9200.00
BUILDING: Dpl=          50., BW=          75., BL=          75., %CONTROL=          0.0000
** Reported Hourly Emission Rate <Q> is equal to          0.025800000 lbs/hour.
** Reported Annual Emission Rate <Qa> is equal to          226.000000 lbs/year.
II.B. REFINED CAVITY IMPACT METHOD <DAR-1, APPENDIX B>.
II.B.1. Shortest Distance from building to Property Line < 50. feet >
is less than or equal to the cavity length, or 3 building
heights < 75. feet >. Therefore, this building will have
cavity impacts <if they occur> at receptors off plant property.
II.B.2. The largest building dimension < 75. feet > is greater than or
equal to the building height < 25. feet >. Therefore, the
computer will NOT redefine the cavity length.
II.B.3. Stack height < 40. feet > is greater than cavity height
< 38. feet >. Therefore, this source does not contribute to
the buildings cavity impact. The Computer will assume the
CAVITY Annual Impact equals 0.00 ug/m3.
II.C. CAVITY Annual Impact < 0.000 ug/m3 > is less than AGC
< 63.000 ug/m3 >.
III.A. STANDARD POINT SOURCE METHOD <DAR-1, APPENDIX B>.
III.A.1.b. Momentum flux, Pm, is equal to 1000.331 ft<4>/sec<2>.
III.A.1.b. Effective stack height, he, is equal to 51.001 feet.
III.A.2. STANDARD POINT SOURCE Actual Annual Impact is equal
to 0.195 ug/m3 for 8760. hours/year of operation.
III.A.3. STANDARD POINT SOURCE Potential Annual Impact is equal
to 0.195 ug/m3 assuming 8,760 hours/year of operation.
III.A.4.a. Stack height to building height ratio is greater than
1.5, but less than 2.5. Computer will multiply actual
annual & potential annual impacts by 0.75 factor.
```

```

III.A.5. STANDARD POINT SOURCE Short-Term Impact is calculated below
         using the DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.

III.D. STANDARD POINT SOURCE Actual Annual Impact < 0.146 ug/m3 > is
         less than AGC < 63.000 ug/m3 >.

III.D. STANDARD POINT SOURCE Potential Annual Impact < 0.146 ug/m3 >
         is less than AGC < 63.000 ug/m3 >.

**** Potential Annual Impact is based upon 8760 hours/year ****
**** operation instead of reported 8760. hours/year. ****

2.0 DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.
    See "Technical Reference for the Screening Procedures of the
    DAR-1 Software Program, Wade/Sedefian," 1/11/94.

2.2 CAVITY Short-Term Impact is equal to 0.00 ug/m3 as the plume
     escaped the cavity region: hs< 40. feet > hc< 26. feet >.

II.C. CAVITY Short-Term Impact is equal to 0.000 ug/m3.
       There is no SGC for this contaminant.

2.3 Momentum flux, Fm, is equal to 1000.331 ft<4>/sec<2>.

2.3 Effective stack height, he, is equal to 51.001 feet.

2.4 Maximum non-downwash GEP stack Short-Term Impact <CSTP> is equal
     to 2.909 ug/m3, for hs/hb = 1.60

2.5 Maximum downwash Short-Term Impact <CSTD> is equal
     to 9.732 ug/m3, for: hs/hb = 1.60 and ESH = 51. feet.

2.6 Adjusted maximum downwash Short-Term <CSTD> is equal
     to 8.136 ug/m3, for: RF = 0.84

III.D. Maximum non-cavity Short-Term Impact <CST> equals 8.136 ug/m3
       for the point source. There is no SGC for this contaminant.

2.7 Maximum Short-Term cavity, point, or area source impact
     <SHORT-TERM MAXIMUM, <Cav.Pt.Area>> equals 8.136 ug/m3
     and is reported in the ANALYSIS MENU.

```

IX. AGCs and SGCs for TCE, PCE, Vinyl Chloride, cis 1,2-Dichloroethene, and 1,2-Dichloroethene (total):

AGCs & SGCs						9/ 8/11	
						Page 1	
CAS NUMBER	CONTAMINANT NAME	SGC ug/m3	II O V	AGC ug/m3	II O V	CODES	
00075-01-4	VINYL CHLORIDE	18000.00000	D	0.110000000	E	H	U HA
00079-01-6	TRICHLOROETHYLENE	14000.00000	Z	0.500000000	D	M	U HA
00127-10-4	TETRACHLOROETHYLENE	1000.00000	H	1.000000000	H	M	U HA
00156-59-2	DICHLOROETHYLENE, cis	0.00000		63.000000000	D	M	
00540-59-0	DICHLOROETHYLENE, 12	0.00000		63.000000000	D	M	

X. Contaminant Emissions Summary for TCE, PCE, Vinyl Chloride, cis 1,2-Dichloroethene, and 1,2-Dichloroethene (total):

CONTAMINANT EMISSIONS SUMMARY				9/ 8/11	
				Page 1	
CAS NUMBER	CONTAMINANT NAME	NUM. OF EPs PER CONTAM.	EMISSIONS (lbs/hour)	EMISSIONS (lbs/year)	
00075-01-4	VINYL CHLORIDE	1	0.0026000	22.93000	
00079-01-6	TRICHLOROETHYLENE	1	0.3444000	3017.00000	
00127-10-4	TETRACHLOROETHYLENE	1	0.2342000	2052.00000	
00156-59-2	DICHLOROETHYLENE, cis	1	0.0258000	226.00000	
00540-59-0	DICHLOROETHYLENE, 12	1	0.0258000	226.00000	
SUMMARY TOTALS		5	0.6328000	5543.93000	

XI. Meter Grid Modeling Results for Maximum Annual Concentrations of TCE, within 25 meters:

CONCENTRATIONS x 10 <sup>-2</sup> (ug/m3) for 00079-01-6													09/08/11		
AGC =													13:17:58		
TIME	367000.	368000.	369000.	370000.	371000.	372000.	373000.	374000.	375000.	376000.	377000.	378000.			
4511000.	0.04	0.06	0.08	0.14	0.23	0.32	0.41	0.30	0.14	0.10	0.08	0.06	0.05		
4510000.	0.03	0.05	0.08	0.13	0.25	0.43	0.60	0.40	0.17	0.12	0.09	0.07	0.06		
4509000.	0.02	0.03	0.06	0.11	0.24	0.58	1.01	0.52	0.22	0.14	0.11	0.08	0.06		
4508000.	0.02	0.03	0.04	0.06	0.18	0.62	2.16	0.64	0.31	0.19	0.13	0.11	0.09		
4507000.	0.02	0.03	0.04	0.06	0.11	0.26	7.27	1.43	0.60	0.34	0.22	0.15	0.12		
4506000.	0.03	0.03	0.05	0.07	0.13	0.33	2.58	2.99	1.12	0.51	0.30	0.20	0.14		
4505000.	0.03	0.04	0.05	0.08	0.20	0.45	0.94	0.81	0.60	0.45	0.33	0.23	0.16		
4504000.	0.03	0.04	0.07	0.12	0.20	0.22	0.47	0.43	0.33	0.27	0.24	0.20	0.16		

TOP 100 CONTRIBUTORS TO MAXIMUM CONCENTRATION FOR 00079-01-6							09/08/11	
@ UTMN: 373000.							13:17:58	
Emission Point	Facility Name (shortened)	EP DIR	Distance to Max.(m)	CONC. ug/m3	Percent of Max.			
TOTAL	NWIRP BETHPAGE GM-38 AREA	SSE	539.	0.727E-01	100.000			
TOTAL OF ALL	1 CONTRIBUTORS			0.727E-01	100.000			

XII. ISCLT Model Run Information, within 25 meters:

```

                                MODEL RUN INFORMATION
                                09/08/11
                                13:17:58

1. Current GRID SPACING equals 1000. meters.
2. Maximum Concentration (flashing) equals 0.0727115273 ug/m3
   @ UTME: 373000. UTMN: 4507000.

3. RUN FILE: TEMP?.RUN
4. METEOROLOGICAL FILE: ALB.MET
5. RUN MODE: URBAN
6. HALF-LIVES: not used to account for pollutant removal from air.
7. BLD. WAKE EFFECTS: AS-1 METHOD, All data KNOWN (hb, hv, hl, orientation)
8. EMISSIONS: ACTUAL ANNUAL EMISSIONS
9. SOURCES: All sources within 25. meters of
   UTME: 373275. UTMN: 4506537.
10. CONTAMINANT CAS NUMBER(s): 00079-01-6
11. EMISSION POINT - CONTAMINANT(s) found by computer: 1
12. No data is being copied to DUMP file.
```

**APPENDIX C**

**FIELD LOGS AND  
CHAIN OF CUSTODY DOCUMENTATION**



Date: 09/13/16



### Groundwater Level Measurement Sheet

Project Site: NWIRP Bethpage – GM-38

Location: Bethpage, NY

Field Crew: J, KA

Water Level Meter: Solinst

Weather: Sunny, clear, ~80° F

Time of Low Tide: N/A

Time of High Tide: N/A

Well ID	Time	Depth to Water (ft.)	Total Depth of Well / Screenshot Interval (ft.)	PID (ppm)	Comments
RW1-MW1	1513	42.17	435 / 395-435	---	
RW1-MW2	1448	44.47	435 / 395-435	---	
RW1-MW3	1548	35.90	435 / 395-435	---	
RW2-MW1	1531	45.04	510 / 470-510	---	
RW2-MW2	1538	44.41	510 / 470-510	---	
RW2-MW3	1534	44.19	510 / 470-510	---	
RW3-MW1	1520	42.78	350 / 330-350	---	
RW3-MW2	1518	44.91	495 / 475-495	---	
RW3-MW3	1526	44.20	340 / 320-340	---	
RW3-MW4	1524	46.07	495 / 475-495	---	
TP1	1500	40.36	470 / 450-470	---	
IW1-MW1	1452	40.97	470 / 450-470	---	
RW-1	1455	✓ OK	Open vault and check integrity of piping, etc.		
RW-3	1500 (9/15/16)	✓ OK	Open vault and check integrity of piping, etc.		

Signature: [Handwritten Signature]

Date: 9/13/16

# KOMAN Government Solutions, LLC

## Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38  
 Location: Bethpage, NY  
 Well ID: RW 1 - MW 1

Date: 09/14/16  
 Sampler: R. KA   
 PID: \_\_\_\_\_

Start Time: 0940 End Time: 1025  
 Well Construction: 4"  
 Depth to Water: 42.17  
 Well Depth: ~435  
 Water Column: ~397'  
 Total Volume Removed (L): ~9.0L  
 Dedicated Pump in Well?: No

### Field Testing Equipment

Make	Model	Serial #
YSI	556	17083
LaMotte	2020e	903522
QED	MP15	
Marschalk Bladder Pump	24"	ID# 11995

Time (hh:mm)	Volume Removed (L)	Flow Rate (mL/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm <sup>o</sup> )	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
0945	1.0	200	43.05	19.07	5.02	179	6.59	180.1	0.28	clear
0950			43.08	17.36	4.73	179	2.43	186.2	0.60	"
0955			43.08	16.98	4.64	182	1.25	189.4	0.41	"
1000			43.08	16.87	4.53	185	1.01	194.6	0.38	"
1005			43.09	16.70	4.45	185	0.73	199.2	0.45	"
1010			43.11	17.42	4.44	185	0.66	200.2	0.41	"
1015			43.11	16.85	4.43	185	0.68	199.7	0.38	"
1020			43.11	16.62	4.42	185	0.67	198.8	0.02	"
1025			43.11	16.59	4.42	185	0.68	196.4	0.01	"

Acceptance Criteria:                      <0.3ft                      3%                      ±0.1                      3%                      10%                      ± 10mv                      10%

2" Screen Volume = 0.16 gal/ft


6" Screen Volume = 1.46 gal/ft

4" Screen Volume = 0.64 gal/ft

### Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
1025	NWIRP-GM-38-GW-4	40 mL CG	3	---	TCL VOCs (624)
	RW 1 - MW 1 - 091416	500 mL PL	1	HNO <sub>3</sub>	Hg (245.1)
		250 mL PL	1	---	TSS (SM2540D)

### Comments

\_\_\_\_\_  
 \_\_\_\_\_  
 Signature                      9/14/16 Date

# ROMAN Government Solutions, LLC

## Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38  
 Location: Bethpage, NY  
 Well ID: RW 1 - MW 3

Date: 09/14/16  
 Sampler: JK, KA  
 PID: \_\_\_\_\_



Start Time: 1110 End Time: 1200

Well Construction: 4"

Depth to Water: 35.90

Well Depth: 2350

Water Column: 2314

Total Volume Removed (L): 220 L

Dedicated Pump in Well?: No

### Field Testing Equipment

Make	Model	Serial #
YSI	556	17083
LaMotte	Z020e	903522
QED	MP15	
Marschalk Bladder Pump	24"	ID# 11995

Time (hh:mm)	Volume Removed (L)	Flow Rate (mL/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm°)	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
1115	0.0	400	35.94	14.99	4.87	193	0.70	157.4	3.60	Clear
1120	2.0	400	35.94	14.57	4.67	193	0.56	147.9	2.70	Clear
1125		400	35.94	14.50	4.75	193	0.43	138.1	4.71	Clear
1130		400	35.94	14.49	4.85	193	0.40	130.5	6.33	Clear
1135		400	35.94	14.43	4.99	193	0.35	120.3	4.09	Clear
1140		400	35.94	14.44	5.01	193	0.34	118.6	3.99	Clear
1145		400	35.92	14.41	5.04	193	0.32	115.8	3.81	"
1150			35.91	14.39	5.06	193	0.30	112.3	4.68	"
1155			35.91	14.35	5.09	193	0.31	110.8	3.98	"
1200			35.91	14.32	5.10	193	0.29	109.3	3.24	"

Acceptance Criteria: <0.3ft 3% ±0.1 3% 10% ± 10mv 10%

2" Screen Volume = 0.16 gal/ft

6" Screen Volume = 1.46 gal/ft

4" Screen Volume = 0.64 gal/ft

### Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
1200	NWIRP-GM-38-GW-	40 mL CG	3	---	TCL VOCs (624)
	RW 3-MW 1- 091416	500 mL PL	1	HNO <sub>3</sub>	Hg (245.1)
		250 mL PL	1	---	TSS (SM2540D)

### Comments

\_\_\_\_\_  
 Signature

\_\_\_\_\_  
 Date 9/14/16

# KOMAN Government Solutions, LLC

## Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38  
 Location: Bethpage, NY  
 Well ID: RW 2 - MW 1

Date: 09/15/16  
 Sampler: JG, KA  
 PID: \_\_\_\_\_



Start Time: 1138 End Time: 1248

Well Construction: 4"

Depth to Water: 45.04

Well Depth: 510

Water Column: ~4051

Total Volume Removed (L): 14L

Dedicated Pump in Well?: No

### Field Testing Equipment

Make	Model	Serial #
YSI	556	831453
LaMotte	2020e	903522
QED	MP15	
Marschalk Bladder Pump	24"	ID# 11995

Time (hh:mm)	Volume Removed (L)	Flow Rate (mL/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm <sup>o</sup> )	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
1143	1.0	200	45.15	15.26	6.44	159	0.16	92.8	1.54	Clear
1148			45.15	16.09	6.69	158	0.13	79.4	2.24	"
1153			45.13	16.37	6.91	157	0.13	70.9	1.99	"
1158			45.13	16.32	6.80	156	0.13	53.8	1.82	"
1203			45.12	16.37	6.26	154	0.18	48.9	1.02	"
1208			45.12	16.24	5.95	160	0.17	42.1	3.37	"
1213			45.11	16.22	5.84	166	0.21	39.7	2.76	"
1218			45.10	16.16	5.79	173	0.26	36.1	2.89	"
1223			45.05	16.31	5.77	179	0.28	32.2	2.60	"
1228			45.06	16.29	5.77	182	0.28	30.5	2.45	"
1233			45.05	16.35	5.75	184	0.28	32.2	2.11	"
1238			45.04	16.24	5.74	186	0.27	29.5	1.74	"

Acceptance Criteria: <0.3ft 3% ±0.1 3% 10% ± 10mv 10%

2" Screen Volume = 0.16 gal/ft

6" Screen Volume = 1.46 gal/ft


4" Screen Volume = 0.64 gal/ft

### Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis					
	NWIRP-GM-38-GW-	40 mL CG	3	—	TCL VOCs (624)					
	RW 2-MW 1 - 091516	500 mL PL	1	HNO <sub>3</sub>	Hg (245.1)					
		250 mL PL	1	—	TSS (SM2540D)					
1243	1.0	200	45.02	16.19	5.73	187	0.26	29.8	1.71	Clear
1248	1.0	200	45.00	16.20	5.72	188	0.26	29.6	1.45	"

### Comments

# pH seems low - measure w/ separate pH meter to verify = 6.25

  
 Signature

9/15/16  
 Date

# KOMAN Government Solutions, LLC

## Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38  
 Location: Bethpage, NY  
 Well ID: RW3 - MW1

Date: 09/14/16  
 Sampler: JG, KA  
 PID: \_\_\_\_\_



Start Time: 1244 End Time: 1429  
 Well Construction: 4"  
 Depth to Water: 42.78  
 Well Depth: ~350  
 Water Column: ~327  
 Total Volume Removed (L): ~32L  
 Dedicated Pump in Well?: No

### Field Testing Equipment

Make	Model	Serial #
YSI	556	<u>17083</u>
LaMotte	2020e	<u>903522</u>
QED	MP15	
Marschalk Bladder Pump	24"	ID# <u>11995</u>

Time (hh:mm)	Volume Removed (L)	Flow Rate (mL/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm°)	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
1249	1.5	350	43.28	17.20	4.76	129	4.91	173.5	10.53	clear
1254			—	16.75	4.78	134	4.94	169.0	15.6	"
1259			—	16.64	4.04	135	4.89	155.4	24.9	clear
1304			—	16.59	5.30	134	4.90	141.1	28.5	clear
1309			43.18	16.54	5.58	134	5.03	125.7	27.2	clear
1310			43.19	16.59	5.22	134	5.04	127.9	24.1	"
1310			43.19	16.48	5.06	133	5.10	134.9	26.0	"
1324			43.18	16.55	4.98	134	5.27	141.8	27.0	"
1329			43.18	16.47	4.97	133	5.22	140.4	18.6	"
1334			43.18	16.32	4.85	133	5.30	146.4	21.2	"
1339			43.18	16.30	4.76	133	5.28	152.6	19.2	"
1344			43.18	16.24	4.68	133	5.31	155.6	16.0	clear

Acceptance Criteria:

<0.3ft

3%

±0.1

3%

10%

± 10mv

10%

2" Screen Volume = 0.16 gal/ft

6" Screen Volume = 1.46 gal/ft

4" Screen Volume = 0.64 gal/ft

### Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
1429	NWIRP-GM-38-GW-	40 mL CG	3	—	TCL VOCs (624)
	RW3-MW1-091416	500 mL PL	1	HNO <sub>3</sub>	Hg (245.1)
		250 mL PL	1	—	TSS (SM2540D)

### Comments

DW meter stopped working, had to switch out

[Signature]  
 Signature

9/14/16  
 Date



# KOMAN Government Solutions, LLC

## Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38  
 Location: Bethpage, NY  
 Well ID: RW 3 - MW 2

Date: 09/14/16  
 Sampler: JE, KA  
 PID: \_\_\_\_\_



Start Time: 1442 End Time: 1622

Well Construction: 4"  
 Depth to Water: 44.91  
 Well Depth: ~495'  
 Water Column: ~440'  
 Total Volume Removed (L): ~302  
 Dedicated Pump in Well?: No

### Field Testing Equipment

Make	Model	Serial #
YSI	556	17083
LaMotte	2020e	903522
QED	MP15	
Marschalk Bladder Pump	24"	ID# A0242

Time (hh:mm)	Volume Removed (L)	Flow Rate (mL/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm <sup>2</sup> )	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
1447	1.5	300	45.58	18.03	5.36	101	1.35	133.6	5.11	Clear
1452			45.63	17.54	5.48	101	0.61	113.1	5.48	"
1457			45.61	17.15	5.84	100	0.38	92.7	5.30	"
1502			45.60	16.44	6.25	100	0.34	76.1	5.26	"
1507			45.60	16.77	6.46	100	0.33	51.9	5.20	"
1512			45.56	16.67	6.90	100	0.32	-26.1	4.40	"
1517			45.54	16.56	7.42	100	0.31	-1.0	2.46	"
1522			45.50	16.45	7.26	101	0.35	-11.8	2.53	"
1527			45.46	16.33	7.43	102	0.37	-10.3	2.64	"
1532			45.45	16.22	7.78	102	0	-13.7	2.10	"
1537	pH seems high - take out YSI + bag to recalibrate pH - low well running									

Acceptance Criteria: <0.3ft 3% ±0.1 3% 10% ± 10mv 10%

2" Screen Volume = 0.16 gal/ft  
 4" Screen Volume = 0.64 gal/ft  
 6" Screen Volume = 1.46 gal/ft

### Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
1622	NWIRP-GM-38-GW-	40 mL CG	3	-	TCL VOCs (624)
	RW 3 - MW 2 - 091416	500 mL PL	1	HNO <sub>3</sub>	Hg (245.1)
		250 mL PL	1	-	TSS (SM2540D)
	BP-GM38-RW3-MW-2-DUP-091416	for all parameters			
	-MS	for WCS, Hg, mlyg			
	-MSD				

### Comments

Due to issue w/ pH/ORP probe, do not wait for these parameters to stabilize, as readings assumed to be in error

Signature: \_\_\_\_\_ Date: 9/14/16

Using Septa meter, measure pH of well water = 4.79  
 ORP of well water = 201.5

# KOMAN Government Solutions, LLC

Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38  
 Location: Bethpage, NY  
 Well ID: RW 3 MW 2

Date: 09/14/16  
 Sampler: J. K. K.  
 PID: \_\_\_\_\_



Start Time: \_\_\_\_\_ End Time: \_\_\_\_\_  
 Well Construction: 4"  
 Depth to Water: \_\_\_\_\_  
 Well Depth: su pg 1  
 Water Column: \_\_\_\_\_  
 Total Volume Removed (L): \_\_\_\_\_  
 Dedicated Pump in Well?: No

### Field Testing Equipment

Make	Model	Serial #
YSI	556	
LaMotte	2020e	
QED	MP15	
Marschalk Bladder Pump	24"	ID#

Time (hh:mm)	Volume Removed (L)	Flow Rate (mL/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm°)	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
1552	1.5	300	45.35	16.21	7.34	106	0.62	-77.6	0.85	Clear
1557			45.33	15.88	7.60	104	0.57	-89.5	0.91	Clear
1602			45.31	15.74	8.16	105	0.64	-100.8	1.01	Clear
1607			45.30	15.72	8.23	105	0.59	-116.0	1.13	Clear
1612			45.28	15.65	8.28	105	0.57	-121.8	1.10	"
1617			45.26	15.59	8.35	105	0.55	-127.6	0.89	"
1622			45.28	15.53	8.35	105	0.54	-118.5	0.66	"

Acceptance Criteria: <0.3ft 3% ±0.1 3% 10% ± 10mv 10%

2" Screen Volume = 0.16 gal/ft  
 4" Screen Volume = 0.64 gal/ft

6" Screen Volume = 1.46 gal/ft

### Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
1622	NWIRP-GM-38-GW-	40 mL CG	3	--	TCL VOCs (624)
	RW 3-MW2-091416	500 mL PL	1	HNO <sub>3</sub>	Hg (245.1)
		250 mL PL	1	--	TSS (SM2540D)
	<u>su pg 1</u>				

### Comments

\_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

[Signature]  
 Signature

9/14/16  
 Date

pg



# KOMAN Government Solutions, LLC

Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38  
 Location: Bethpage, NY  
 Well ID: RW 3 - MW 3

Date: 09/15/16  
 Sampler: SR, KR  
 PID: \_\_\_\_\_



Start Time: 0920 End Time: 1100

Well Construction: 4"

Depth to Water: 44.26

Well Depth: ~340'

Water Column: ~296'

Total Volume Removed (L): ~25L

Dedicated Pump in Well?: No

### Field Testing Equipment

Make	Model	Serial #
YSI	556	031453
LaMotte	2020e	903522
QED	MP15	
Marschalk Bladder Pump	24"	ID# A00247

Time (hh:mm)	Volume Removed (L)	Flow Rate (mL/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm <sup>2</sup> )	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
0925	1.25	250	44.51	16.72	4.40	119	3.76	176.6	0.16	Clear
0930			44.51	16.43	4.40	120	1.10	151.8	11.8	Clear w/ turbidity
0935			44.49	16.54	4.45	120	0.64	149.8	12.3	"
0940			44.49	16.51	4.49	120	0.52	147.9	11.54	"
0945			44.48	16.58	4.52	120	0.47	146.2	10.77	"
0950			44.49	16.56	4.52	119	0.41	146.5	10.88	"
0955			44.49	16.60	4.58	120	0.38	145.8	10.62	"
1000			44.49	16.70	4.58	120	0.36	145.4	10.55	"
1005			44.49	16.80	4.61	119	0.33	145.7	9.91	Clear
1010			44.49	16.98	4.65	120	0.30	146.7	9.99	"
1015			44.49	16.98	4.66	120	0.29	146.2	9.95	"
1020			44.49	16.98	4.66	120	0.27	146.2	9.93	"

Acceptance Criteria:

<0.3ft

3%

±0.1

3%

10%

± 10mv

10%

2" Screen Volume = 0.16 gal/ft

6" Screen Volume = 1.46 gal/ft

4" Screen Volume = 0.64 gal/ft

### Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis					
	NWIRP-GM-38-GW-	40 mL CG	3	-	TCL VOCs (624)					
	RW 3-MW 3-091516	500 mL PL	1	HNO <sub>3</sub>	Hg (245.1)					
		250 mL PL	1	-	TSS (SM2540D)					
1025	1.25	250	44.49	16.80	4.67	120	0.26	146.5	9.58	Clear
1030			44.47	16.58	4.55	118	0.25	153.3	9.66	"
1035			44.47	16.86	4.64	119	0.24	150.1	9.51	"
1040			44.47	16.21	4.54	119	0.22	151.9	9.50	"
1045			44.47	16.46	4.54	118	0.23	154.0	9.38	"
1050			44.46	16.90	4.69	119	0.21	147.3	9.17	"
1055			44.46	16.32	4.64	119	0.21	147.6	9.55	"

### Comments

1045  
1055

pH seems a little low - verify final pH w/ separate pH meter = 5.31

*[Signature]*  
Signature

9/15/16  
Date

1100 ↓ ↓ | 44.46 | 16.62 | 4.61 | 119 | 0.21 | 151.8 | 9.56 | Clear

# KOMAN Government Solutions, LLC

Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38  
 Location: Bethpage, NY  
 Well ID: RW 3 - MW 4

Date: 09/15/16  
 Sampler: JB, KA  
 PID: \_\_\_\_\_



Start Time: 0755 End Time: 0910

Well Construction: 4"  
 Depth to Water: 46.07  
 Well Depth: 495'  
 Water Column: 2449'  
 Total Volume Removed (L): 15L  
 Dedicated Pump in Well?: No

### Field Testing Equipment

Make	Model	Serial #
YSI	556	031453
LaMotte	2020e	903522
QED	MP15	
Marschalk Bladder Pump	24"	ID# 11995

Time (hh:mm)	Volume Removed (L)	Flow Rate (mL/min)	Depth to Water (ft)	Temp (°C)	pH * (STD)	SPC (µS/cm <sup>2</sup> )	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
0800	1.0	200	46.50	15.84	4.09	147	2.51	153.8	2.04	Clear
0805			46.50	15.61	4.02	136	1.34	151.5	2.53	"
0810			46.50	15.42	3.99	132	1.30	146.6	1.45	"
0815			46.50	15.35	3.97	119	0.87	143.2	1.14	"
0820			46.50	15.32	3.96	116	0.67	141.8	1.65	"
0825			46.50	15.26	3.93	114	0.46	139.3	2.39	"
0830			46.52	15.23	3.93	113	0.39	137.4	3.18	"
0835			46.52	15.21	3.93	114	0.34	135.5	7.93	"
0840			46.52	15.20	3.94	115	0.31	133.7	2.78	"
0845			46.54	15.45	3.94	115	0.26	133.9	1.95	"
0850			46.54	15.64	4.03	115	0.23	127.3	2.34	"
0855			46.55	15.60	4.02	115	0.22	128.2	2.01	"

Acceptance Criteria: <0.3ft      3%      ±0.1      3%      10%      ± 10mv      10%

2" Screen Volume = 0.16 gal/ft

6" Screen Volume = 1.46 gal/ft

4" Screen Volume = 0.64 gal/ft


### Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis					
0910	NWIRP-GM-38-GW-	40 mL CG	3	---	TCL VOCs (624)					
	RW 3 - MW 4 - 091516	500 mL PL	1	HNO <sub>3</sub>	Hg (245.1)					
		250 mL PL	1	---	TSS (SM2540D)					
0900	1.0	200	46.55	15.72	4.02	116	0.21	128.6	1.74	Clear
0905			46.56	15.74	4.01	115	0.22	128.3	1.80	"
0910			46.56	15.73	4.02	115	0.20	128.4	1.81	"

### Comments

\* pH seems to be reading a little low, esp based on many calibrations

check pH w/ another pH meter @ time of sampling = 4.32

  
 Signature

9/15/16  
 Date

# KOMAN Government Solutions, LLC

## Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38  
Location: Bethpage, NY  
Well ID: TP1

Date: 09/14/16  
Sampler: JK KA  
PID: \_\_\_\_\_



Start Time: 0753 End Time: 0843

### Field Testing Equipment

Well Construction: 4"  
Depth to Water: 40.36  
Well Depth: 470'  
Water Column: ~430'  
Total Volume Removed (L): ~19 L  
Dedicated Pump in Well?: No

Make	Model	Serial #
YSI	556	17083
LaMotte	2020e	903522
QED	MP15	
Marschalk Bladder Pump	24"	ID# 11995

Time (hh:mm)	Volume Removed (L)	Flow Rate (mL/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm°)	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
0758	0.19	380	41.66	14.57	5.53	179	7.83	236.7	0.74	Clear
0803		380	41.67	14.33	5.73	180	7.71	217.5	0.56	Clear
0808		"	41.67	14.31	5.39	180	7.59	203.0	0.67	"
0813		"	41.67	14.29	5.46	179	7.66	182.9	0.93	"
0818		"	41.67	14.22	5.52	179	7.66	167.8	0.70	"
0823		"	41.67	14.21	5.11	178	7.59	161.7	0.62	"
0828		"	41.67	14.20	5.63	179	7.57	159.6	0.54	"
0833		"	41.68	14.20	5.64	179	7.59	153.2	0.24	"
0838		"	41.68	14.24	5.69	179	7.53	149.0	0.29	"
0843	✓	✓	41.70	14.24	5.71	179	7.50	148.5	0.33	"

Acceptance Criteria: <0.3ft 3% ±0.1 3% 10% ± 10mv 10%  
2" Screen Volume = 0.16 gal/ft 6" Screen Volume = 1.46 gal/ft  
4" Screen Volume = 0.64 gal/ft

### Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
0843	NWIRP-GM-38-GW-TP1-091416	40 mL CG	3	--	TCL VOCs (624)
		500 mL PL	1	HNO <sub>3</sub>	Hg (245.1)
		250 mL PL	1	--	TSS (SM2540D)

### Comments

contact equipment / field blank BP-GM38-FB-091416 @ 0805  
after drawing pump

\_\_\_\_\_  
Signature

9/14/16  
Date

# KOMAN Government Solutions, LLC

## Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38  
 Location: Bethpage, NY  
 Well ID: RW -MW RW-3

Date: 09/15/16  
 Sampler: JR  
 PID: \_\_\_\_\_



Start Time: 1:38 End Time: 1:40  
 Well Construction: 4"  
 Depth to Water: \_\_\_\_\_  
 Well Depth: \_\_\_\_\_  
 Water Column: \_\_\_\_\_  
 Total Volume Removed (L): \_\_\_\_\_  
 Dedicated Pump in Well?: No

### Field Testing Equipment

Make	Model	Serial #
YSI	556	031453
LaMotte	2020e	903527
QED	MP15	DeLiberated
Marschalk Bladder Pump	24"	ID# <u>mp</u>

Time (hh:mm)	Volume Removed (L)	Flow Rate (mL/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm <sup>o</sup> )	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
1:40	2200L	20gpm	—	14.74	4.80	104	3.07	216.6	2.69	clear


Acceptance Criteria:                          <0.3ft                  3%                  ±0.1                  3%                  10%                  ± 10mv                  10%

2" Screen Volume = 0.16 gal/ft                          6" Screen Volume = 1.46 gal/ft  
 4" Screen Volume = 0.64 gal/ft

### Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
1:40	<del>NWIRP-GM-38-GW</del>	40 mL CG	3	—	TCL VOCs (624)
	RW -MW -	500 mL PL	1	HNO <sub>3</sub>	Hg (245.1)
	RW3-091516	250 mL PL	1	—	TSS (SM2540D)

**Comments**                  Verify pH at depth. pH meter = 4.36

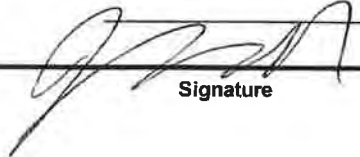  
 \_\_\_\_\_  
 Signature

9/15/16  
 \_\_\_\_\_  
 Date

RW-3 - 9/15/16

Changed RW-1 setpt from 89 to 73

@ 1438 → Flowrate from ~1,200 gpm → ~800 gpm

Turned RW-3 on in Auto

Setpt is @ 75 → Flowrate ~ 200 gpm

Sampled RW-3 @ 1540

Returned to normal @ 1545

RW-1 → 89 setpt

RW-3 → off in manual

Good  
9/15/16



### Instrument Calibration Log

Project/Site Name: NWIRP Bethpage – GM-38

Date: 09/14/16

Weather: clear, sunny, w/dm, ~50°F

Calibrated By: JF

Instrument: YSI 556

Serial Number: 17083

Parameters	Morning Calibration Time: <u>0720</u>	Cal. Temperature °C	Afternoon Cal. Check Time: <u>1705</u>	Comments
Conductivity 1413 (µS/cm <sup>2</sup> )	<u>1,055 / 1,1413</u>	<u>21.72</u>	<u>1,1471 / 1,1413</u>	
pH (7)	<u>7.06 / 7.00</u> <sup>post</sup> <u>7.07</u>	<u>22.85</u>	<u>21</u> —	pH probe not working ↓
pH (4)	<u>3.88 / 4.00</u>	<u>23.04</u>	<u>14</u> —	
pH (10)	<u>10.03 / 10.01</u>	<u>23.13</u>	<u>16</u> —	
ORP 240 (mv)	<u>243.0 / 240.0</u>	<u>22.79</u>	<u>239.5 / 240.0</u>	
Dissolved Oxygen (%)	<u>99.6 / 100.0</u>	<u>22.52</u>	<u>99.4 / 100.0</u>	
Zero Dissolved Oxygen (mg/L)	—	—		
Barometric Pressure (mmHg)	—	—		

pH Check (Every 3 hrs): Time: \_\_\_\_\_  
 Standard: NA  
 Reading: \_\_\_\_\_  
 (NJ only)

Time: \_\_\_\_\_  
 Standard: NA  
 Reading: \_\_\_\_\_

Time: \_\_\_\_\_  
 Standard: NA  
 Reading: \_\_\_\_\_

Signature: [Handwritten Signature]

Date: 9/14/16



### Instrument Calibration Log

Project/Site Name: NWIRP Bethpage - GM-38

Date: 09/15/16

Weather: Clear

Calibrated By: KGA

Instrument: YSI 556

Serial Number: 031453

Parameters	Morning Calibration		Cal. Temperature °C	Afternoon Cal. Check		Comments
	Time: <u>7:30</u>			Time: <u>1500</u>		
Conductivity 1413 (µS/cm²)	<u>1416</u>	<u>1413</u>	<u>22.46</u>	<u>1338</u>		
pH (7)	<u>6.74</u>	<u>7.00</u>	<u>22.48</u>	<u>6.53</u>		Issue w/ pH calibration - had to calibrate more than once, kept getting out of range error
pH (4)	<u>5.01</u>	<u>4.00</u>	<u>22.39</u>	<u>3.96</u>		
pH (10)	<u>9.64</u>	<u>10.00</u>	<u>22.53</u>	<u>9.38</u>		
ORP 240 (mv)	<u>231.7</u>	<u>240.1</u>	<u>22.43</u>	<u>249.0</u>		
Dissolved Oxygen (%)	<u>98.7%</u>	<u>100.1%</u>	<u>22.51</u>	<u>94.27%</u>		
Zero Dissolved Oxygen (mg/L)	<u>—</u>	<u>—</u>	<u>—</u>	<u>—</u>		
Barometric Pressure (mmHg)	<u>—</u>	<u>—</u>	<u>—</u>	<u>—</u>		

pH Check (Every 3 hrs): Time: \_\_\_\_\_  
 Standard: NA  
 Reading: \_\_\_\_\_  
 (NJ only)

Time: \_\_\_\_\_  
 Standard: NA  
 Reading: \_\_\_\_\_

Time: \_\_\_\_\_  
 Standard: NA  
 Reading: \_\_\_\_\_

Signature: KGA

Date: 9/15/16



### Instrument Calibration Log

Project/Site Name: NWIRP Bethpage GM-38

Calibrated By: JG

Instrument/Serial Number	Pre-Cal 1-AM (NTU)	Pre-Cal 1-PM (NTU)	Pre-Cal 10-AM (NTU)	Pre-Cal 10-PM (NTU)	Post-Cal 1-AM (NTU)	Post-Cal 1-PM (NTU)	Post-Cal 10-AM (NTU)	Post-Cal 10-PM (NTU)	Date
LaMotte 2020e 903522	0.99	0.89	10.07	9.67	1.00	1.00	10.00	10.00	9/11/16 Time: 0730 & 1725
"	1.09	1.08	9.52	9.89	1.00	1.00	10.00	10.00	9/15/16 Time: 715 & 1500
									Time: &
									Time: &
									Time: &
									Time: &
									Time: &
									Time: &
									Time: &
									Time: &
									Time: &
									Time: &

Signature: 

Date: 9/15/16





**APPENDIX D**

**DATA VALIDATION REPORTS**

**VOLATILE ORGANIC COMPOUNDS**  
USEPA Region II –Data Validation

**Project Name:** Naval Weapons Industrial Reserve Plant, GM-38 Area-LTM  
**Location:** 100 Broadway, Bethpage, NY  
**Project Number:** 2031-816  
**SDG #:** R1609816  
**Client:** KOMAM Government Solutions, LLC  
**Date:** 12/12/2016  
**Laboratory:** ALS Environmental, Middletown, PA  
**Reviewer:** Sherri Pullar

**Summary:**

1. Data validation was performed on the data for ten (10) water samples, one (1) trip blank and one (1) field blank analyzed for Volatiles by EPA Method 624.
2. The samples were collected on 9/14 thru 15/2016. The samples were submitted to ALS Environmental, Middletown, PA on 9/16/2016 for analysis.
3. The USEPA Region II SOP HW-24, Revision No.: 2, 2008, Validating Volatile Organic Compounds by Gas Chromatography/Mass Spectrometry, SW-846 Method 8260B; USEPA National Functional Guidelines for Organic Data Review, EPA 540/R-99/008, October 1999; EPA Method 624 and Quality Assurance Project Plan for GM-38 Area, Naval Weapons Industrial Reserve Plant, Bethpage, NY; September 3, 2009 were used in evaluating the Volatiles data in this summary report.
4. In general, the data are valid as reported and may be used for decision making purposes. Selected data points were qualified due to nonconformance of certain Quality Control criteria (See discussion below).



**Samples:**

The samples included in this review are listed below:

<b>Client Sample ID</b>	<b>Laboratory Sample ID</b>	<b>Collection Date</b>	<b>Matrix</b>	<b>Sample Status</b>
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	9/14/2016	Water	
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	9/14/2016	Water	
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	9/14/2016	Water	
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	9/14/2016	Water	
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	9/14/2016	Water	
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	9/14/2016	Water	Field Duplicate of sample BP-GM-38-GW-RW3-MW2-091416
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	9/14/2016	Water	
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	9/15/2016	Water	
BP-GM-38-GW-TP1-091416	R1609816-009	9/14/2016	Water	
BP-GM-38-RW3-091516	R1609816-010	9/15/2016	Water	
BP-GM-38-FB-091416	R1609816-011	9/14/2016	Water	Field Blank
BP-GM-38-TB-091516	R1609816-012	9/15/2016	Water	Trip Blank

**Sample Conditions/Problems:**

1. The Traffic Reports/Chain-of-Custody Records, Sampling Report and/or Laboratory Case Narrative did not indicate any problems with sample receipt, condition of samples, analytical problems or special circumstances affecting the quality of the data. No qualifications were required.



**Holding Times:**

1. All water samples were analyzed within 14 days from sample collection. No qualifications were required.
2. All water samples were properly preserved (pH<2.0). No qualifications were required.

**GC/MS Tuning:**

1. All of the BFB tunes in the initial and continuing calibrations met the percent relative abundance criteria. No qualifications were required.

**Initial Calibration:**

1. Initial calibration curve analyzed on 7/14/2016 (R-MS-06) exhibited acceptable %RSD and average RRF values for all compounds. No qualifications were required.

**Continuing Calibration Verification (CCV):**

1. CCV analyzed on 9/19/2016 @ 15:30 (R-MS-06) exhibited acceptable %Ds ( $\leq 20.0\%$ ) for all compounds with the following exception(s):

Compound	%D
Acrolein	-68.4
Bromomethane	34.5

Client Sample ID	Laboratory Sample ID	Compound	Action
BP-GM-38-FB-091416	R1609816-011	Acrolein, Bromomethane	UJ
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	Acrolein, Bromomethane	UJ
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	Acrolein, Bromomethane	UJ
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	Acrolein, Bromomethane	UJ
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	Acrolein, Bromomethane	UJ
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	Acrolein, Bromomethane	UJ
BP-GM-38-GW-RW1-MW3-091416	R1609816-	Acrolein, Bromomethane	UJ



Client Sample ID	Laboratory Sample ID	Compound	Action
	002		
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	Acrolein, Bromomethane	UJ
BP-GM-38-GW-TP1-091416	R1609816-009	Acrolein, Bromomethane	UJ
BP-GM-38-RW3-091516	R1609816-010	Acrolein, Bromomethane	UJ

2. CCV analyzed on 9/20/2016 @ 10:56 (R-MS-06) exhibited acceptable %Ds ( $\leq 20.0\%$ ) for all compounds with the following exception(s):

Compound	%D
Bromomethane	43.1

Client Sample ID	Laboratory Sample ID	Compound	Action
BP-GM-38-TB-091516	R1609816-012	Bromomethane	UJ
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	Bromomethane	UJ
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	Bromomethane	UJ
BP-GM-38-RW3-091516	R1609816-010	Bromomethane	UJ

**Surrogates:**

1. All surrogates %REC values for all water samples and associated QC were within the laboratory control limits. No qualifications were required.

**Internal Standard (IS) Area Performance:**

1. All samples exhibited acceptable area count for all three internal standards. No qualifications were required.

**Method Blank (MB), Storage Blank (SB), Trip Blank (TB), Field Blank (FB), Rinsate Blank (RB) and Equipment Blank (EB):**

1. Method Blank (RQ1611102-04) analyzed on 9/19/2016 was free of contamination with the exception of the following:

Sample ID	Compound	Result (µg/l)	Action Level (5x)* (µg/l)	Sample(s) Affected	Action
RQ1611102-04	Bromomethane	0.44	2.2	BP-GM-38-FB-091416, BP-GM-38-GW-RW3-MW2-091416 BP-GM-38-GW-RW3-MW1-091416, BP-GM-38-RW3-MW-2-DUP-091416 BP-GM-38-GW-RW3-MW3-091516 BP-GM-38-GW-RW1-MW1-091416 BP-GM-38-GW-RW1-MW3-091416 BP-GM-38-GW-RW2-MW1-091516 BP-GM-38-GW-TP1-091416 BP-GM-38-GW-RW3-091516	None

2. Method Blank (RQ1611212-04) analyzed on 9/20/2016 was free of contamination. No qualifications were required.
3. Field Blank (BP-GM-38-FB-091416) (R1609816-011) analyzed on 9/19/2016 was free of contamination with the exception of trichloroethene (0.26 µg/l). Trichloroethene was greater than 5x the blank concentration in the associated field samples; therefore, no qualifications were required.
4. Trip Blank (BP-GM-38-TB-091516) (R1609816-012) analyzed on 9/20/2016 was free of contamination. No qualifications were required.

**Laboratory Control Sample (LCS)/ Laboratory Control Sample Duplicate (LCSD):**

1. Laboratory Control Sample (RQ1611102-03) was analyzed on 09/19/2016. All %RECs were within the laboratory control limits. No qualifications were required.
2. Laboratory Control Sample (RQ1611212-03) was analyzed on 09/20/2016. All %RECs were within the laboratory control limits. No qualifications were required.

**Field Duplicate:**

1. Sample BP-GM-38-RW3-MW-2-DUP-091416 (R1609816-006) was collected as field duplicate for sample BP-GM-38-GW-RW3-MW2-091416 (R1609816-005). All RPDs were ≤50.0%. No qualifications were required.



Field Sample	Compound	Analytical Method	Result	Units	Field Duplicate	Result	Units	RPD	Qualifier
BP-GM-38-GW-RW3-MW2-091416	1,1,1-Trichloroethane	EPA 624	0.44	µg/l	BP-GM-38-RW3-MW-2-DUP-091416	0.47	µg/l	6.6	None
BP-GM-38-GW-RW3-MW2-091416	1,1,2-Trichloroethane	EPA 624	0.31	µg/l	BP-GM-38-RW3-MW-2-DUP-091416	0.21	µg/l	38.7	None
BP-GM-38-GW-RW3-MW2-091416	1,1-Dichloroethane	EPA 624	0.39	µg/l	BP-GM-38-RW3-MW-2-DUP-091416	0.34	µg/l	13.7	None
BP-GM-38-GW-RW3-MW2-091416	1,1-Dichloroethene	EPA 624	0.31	µg/l	BP-GM-38-RW3-MW-2-DUP-091416	0.37	µg/l	17.6	None
BP-GM-38-GW-RW3-MW2-091416	Chloroform	EPA 624	0.24	µg/l	BP-GM-38-RW3-MW-2-DUP-091416	0.23	µg/l	4.3	None
BP-GM-38-GW-RW3-MW2-091416	Cis-1,2-Dichloroethene	EPA 624	1.5	µg/l	BP-GM-38-RW3-MW-2-DUP-091416	1.5	µg/l	0	None
BP-GM-38-GW-RW3-MW2-091416	Tetrachloroethene	EPA 624	0.48	µg/l	BP-GM-38-RW3-MW-2-DUP-091416	0.54	µg/l	11.8	None
BP-GM-38-GW-RW3-MW2-091416	Trichloroethene	EPA 624	190	µg/l	BP-GM-38-RW3-MW-2-DUP-091416	190	µg/l	0	None

**Matrix Spike (MS)/ Matrix Spike Duplicate (MSD):**

1. Matrix Spike (MS) and Matrix Spike Duplicate (MSD) were performed on sample BP-GM-38-GW-RW3-MW2-091416 (R1609816-005). All %RECs and RPDs were within the laboratory control limits. No qualifications were required.

**Compound Quantitation and Reported Contract Required Quantitation Limits (CRQLs):**

1. All results were within the linear calibration range with the exception of trichloroethene in samples BP-GM-38-GW-RW3-MW3-091516 and BP-GM-38-RW3-091516. The laboratory re-ran the samples at 2x dilution. The laboratory reported the results from both runs. Trichloroethene results should be taken from the diluted run all other results for these two samples are reported from the initial run. The validator marked the “Reportable\_Results” column “Y” for reportable and “N” for do not report this data.

**Target Compound Identification:**

1. All Relative Retention Times (RRTs) of the reported compounds were within ± 0.06 RRT units of the standard (opening CCV).
2. Sample compound spectra were compared against the laboratory standard spectra.
3. No QC deviations were observed.





**Comments:**

1. Validation qualifiers (if required) were entered into the EDD for SDG: R1609816



**MERCURY**  
USEPA Region II – Data Validation

**Project Name:** Naval Weapons Industrial Reserve Plant, GM-38 Area-LTM  
**Location:** 100 Broadway, Bethpage, NY  
**Project Number:** 2031-816  
**SDG #:** R1609816  
**Client:** KOMAM Government Solutions, LLC  
**Date:** 12/12/2016  
**Laboratory:** ALS Environmental, Middletown, PA  
**Reviewer:** Sherri Pullar

**Summary:**

1. Data validation was performed on the data for ten (10) water samples and one (1) field blank analyzed for Mercury by EPA Method 245.1.
2. The samples were collected on 9/14 thru 15/2016. The samples were submitted to ALS Environmental, Middletown, PA on 9/16/2016 for analysis.
3. The USEPA Region II SOP No. HW-2, Revision 13, September 2006, Validation of Metals for Contract Laboratory Program (CLP), SOW-ILM05.3 (SOP Revision 13); USEPA National Functional Guidelines for Inorganic Data Review, EPA 540-R-04-004, October 2004 and Quality Assurance Project Plan for GM-38 Area, Naval Weapons Industrial Reserve Plant, Bethpage, NY; September 3, 2009 were used in evaluating the Mercury data in this summary report.
4. In general, the data are valid as reported and may be used for decision making purposes. Selected data points were qualified due to nonconformance of certain Quality Control criteria (See discussion below).



**Samples:**

The samples included in this review are listed below:

<b>Client Sample ID</b>	<b>Laboratory Sample ID</b>	<b>Collection Date</b>	<b>Matrix</b>	<b>Sample Status</b>
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	9/14/2016	Water	
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	9/14/2016	Water	
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	9/14/2016	Water	
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	9/14/2016	Water	
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	9/14/2016	Water	
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	9/14/2016	Water	Field Duplicate of sample BP-GM-38-GW-RW3-MW2-091416
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	9/14/2016	Water	
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	9/15/2016	Water	
BP-GM-38-GW-TP1-091416	R1609816-009	9/14/2016	Water	
BP-GM-38-RW3-091516	R1609816-010	9/15/2016	Water	
BP-GM-38-FB-091416	R1609816-011	9/14/2016	Water	Field Blank

**Sample Conditions/Problems:**

1. The Traffic Reports/Chain-of-Custody Records, Sampling Report and/or Laboratory Case Narrative did not indicate any problems with sample receipt, condition of samples, analytical problems or special circumstances affecting the quality of the data. No qualifications were required.

**Holding Times:**

1. All water samples were digested and analyzed within the 28 days holding times for Mercury. No qualifications were required.



**Initial and Continuing Calibration Verification (ICV and CCV):**

1. The correlation coefficient for Mercury calibration curve analyzed was  $\geq 0.995$ . No qualifications were required.
2. All ICVs and CCVs %REC values were within the QC limits (80-120%). No qualifications were required.

**Blanks (Method Blank, ICB and CCB):**

1. All ICBs and CCBs were free of contamination. No qualifications were required.
2. Method Blank digested on 10/04/2016 was free of contamination. No qualifications were required.

**Field Blank (FB) and Equipment Blank (EB):**

1. Field Blank (BP-GM-38-FB-091416) (R1609816-011) analyzed on 10/04/2016 was free of contamination. No qualifications were required.

**Laboratory Control Sample (LCS)/ Laboratory Control Sample Duplicate (LCSD):**

1. Mercury %REC in Laboratory Control Sample (R1609816) analyzed on 10/04/2016 was within the laboratory control limits. No qualifications were required.

**Laboratory Duplicate:**

1. Laboratory Duplicate was performed on sample BP-GM-38-GW-RW3-MW2-091416 (R1609816-005). All RPDs were within the laboratory control limits. No qualifications were required.

**Field Duplicate:**

1. Sample BP-GM-38-RW2-MW-1-DUP-032116 (R1609816-006) was collected as field duplicate for sample BP-GM-38-GW-RW3-MW2-091416 (R1609816-005). Both samples were reported as non-detects. No qualifications were required.

**Matrix Spike (MS)/ Matrix Spike Duplicate (MSD) and Duplicate/Laboratory Duplicate:**

1. Matrix Spike (MS) and Matrix Spike Duplicate (MSD) were performed on sample BP-BP-GM-38-GW-RW3-MW2-091416 (R1609816-005). All %RECs and RPD were within the laboratory control limits. No qualifications were required.

**Compound Quantitation and Reported Detection Limits:**

1. All sample results were reported within the linear calibration range.

**Comments:**

1. Validation qualifiers (if required) were entered into the EDD for SDG: R1609816.

**GENERAL CHEMISTRY**  
USEPA Region II – Data Validation

**Project Name:** Naval Weapons Industrial Reserve Plant, GM-38 Area-LTM  
**Location:** 100 Broadway, Bethpage, NY  
**Project Number:** 2031-816  
**SDG #:** R1609816  
**Client:** KOMAM Government Solutions, LLC  
**Date:** 12/12/2016  
**Laboratory:** ALS Environmental, Middletown, PA  
**Reviewer:** Sherri Pullar

**Summary:**

1. Data validation was performed on the data for ten (10) water samples analyzed for Solids, Total Suspended (TSS) by SM20<sup>th</sup> 2540D.
2. The samples were collected on 9/14 thru 15/2016. The samples were submitted to ALS Environmental, Middletown, PA on 9/16/2016 for analysis.
3. The USEPA Region II SOP No. HW-2, Revision 13, September 2006, Validation of Metals for Contract Laboratory Program (CLP), SOW-ILM05.3 (SOP Revision 13); USEPA National Functional Guidelines for Inorganic Data Review, EPA 540-R-04-004, October 2004 and Quality Assurance Project Plan for GM-38 Area, Naval Weapons Industrial Reserve Plant, Bethpage, NY; September 3, 2009 were used in evaluating the Solids, Total Suspended data in this summary report.
4. In general, the data are valid as reported and may be used for decision making purposes. No data points were qualified due to nonconformance of Quality Control criteria (See discussion below).



**Samples:**

The samples included in this review are listed below:

<b>Client Sample ID</b>	<b>Laboratory Sample ID</b>	<b>Collection Date</b>	<b>Matrix</b>	<b>Sample Status</b>
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	9/14/2016	Water	
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	9/14/2016	Water	
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	9/14/2016	Water	
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	9/14/2016	Water	
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	9/14/2016	Water	
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	9/14/2016	Water	Field Duplicate of sample BP-GM-38-GW-RW3-MW2-091416
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	9/14/2016	Water	
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	9/15/2016	Water	
BP-GM-38-GW-TP1-091416	R1609816-009	9/14/2016	Water	
BP-GM-38-RW3-091516	R1609816-010	9/15/2016	Water	

**Sample Conditions/Problems:**

1. The Traffic Reports/Chain-of-Custody Records, Sampling Report and/or Laboratory Case Narrative did not indicate any problems with sample receipt, condition of samples, analytical problems or special circumstances affecting the quality of the data. No qualifications were required.

**Holding Times:**

1. All water samples were analyzed within the 7 days holding times for Solids, Total Suspended. No qualifications were required.



**Method Blank (MB), Storage Blank (SB), Field Blank (FB), Rinsate Blank (RB) and Equipment Blank (EB):**

1. Method Blank (R1609816) analyzed on 9/19/2016 was free of contamination. No qualifications were required.

**Laboratory Control Sample (LCS)/ Laboratory Control Sample Duplicate (LCSD):**

1. Mercury %RECs/RPD in Laboratory Control Sample/Laboratory Control Sample Duplicate (R1609816) analyzed on 09/19/2016 were within the laboratory control limits. No qualifications were required.

**Field Duplicate:**

1. Sample BP-GM-38-RW3-MW-2-DUP-091416 (R1609816-006) was collected as field duplicate for sample BP-GM-38-GW-RW3-MW2-091416 (R1609816-005). Both samples were reported as non-detects. No qualifications were required.

**Compound Quantitation and Reported Detection Limits:**

1. All sample results were reported within the linear calibration range.

**Comments:**

1. Validation qualifiers (if required) were entered into the EDD for SDG: R1609816.





NWIRP BETHPAGE GM-38  
SEPTEMBER 2016 EVENT  
DATA SUMMARY TABLE  
AQUEOUS  
SDG: R1609816

Sample Name	Lab ID	Analytical Method	Analysis Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	2540D	20160919	1	Solids, Total Suspended (TSS)	1	MG_L	U		
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	1,1,1-Trichloroethane (TCA)	1	UG_L		0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	1,1,2,2-Tetrachloroethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	1,1,2-Trichloroethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	1,1-Dichloroethane (1,1-DCA)	7	UG_L		0.21	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	1,1-Dichloroethene (1,1-DCE)	1.8	UG_L		0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	1,2-Dichlorobenzene	1	UG_L	U	0.25	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	1,2-Dichloroethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	1,2-Dichloropropane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	1,3-Dichlorobenzene	1	UG_L	U	0.22	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	1,4-Dichlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	2-Chloroethyl Vinyl Ether	1	UG_L	U	0.6	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	Acrolein	10	UG_L	UJ	2.9	
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	Acrylonitrile	10	UG_L	U	1.8	
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	Benzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	Bromodichloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	Bromoform	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	Bromomethane	1	UG_L	UJ	0.44	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	Carbon Tetrachloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	Chlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	Chloroethane	1	UG_L	U	0.24	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	Chloroform	0.48	UG_L	J	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	Chloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	Dibromochloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	Methylene Chloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	Ethylbenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	Tetrachloroethene (PCE)	0.45	UG_L	J	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	Toluene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	Trichloroethene (TCE)	110	UG_L		0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	Trichlorofluoromethane (CFC 11)	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	Vinyl Chloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	cis-1,2-Dichloroethene	16	UG_L		0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	cis-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	trans-1,2-Dichloroethene	0.42	UG_L	J	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	trans-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	624	20160919	1	1,3-Dichloropropene, Total	2	UG_L	U		



NWIRP BETHPAGE GM-38  
SEPTEMBER 2016 EVENT  
DATA SUMMARY TABLE  
AQUEOUS  
SDG: R1609816

Sample Name	Lab ID	Analytical Method	Analysis Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-GW-RW1-MW1-091416	R1609816-001	245.1	20161004	1	Mercury	0.1	UG_L	U	0.04	0.1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	2540D	20160919	1	Solids, Total Suspended (TSS)	1.8	MG_L			
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	1,1,1-Trichloroethane (TCA)	1.6	UG_L		0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	1,1,2,2-Tetrachloroethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	1,1,2-Trichloroethane	0.41	UG_L	J	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	1,1-Dichloroethane (1,1-DCA)	7	UG_L		0.21	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	1,1-Dichloroethene (1,1-DCE)	1.7	UG_L		0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	1,2-Dichlorobenzene	1	UG_L	U	0.25	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	1,2-Dichloroethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	1,2-Dichloropropane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	1,3-Dichlorobenzene	1	UG_L	U	0.22	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	1,4-Dichlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	2-Chloroethyl Vinyl Ether	1	UG_L	U	0.6	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	Acrolein	10	UG_L	UJ	2.9	
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	Acrylonitrile	10	UG_L	U	1.8	
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	Benzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	Bromodichloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	Bromoform	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	Bromomethane	1	UG_L	UJ	0.44	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	Carbon Tetrachloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	Chlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	Chloroethane	1	UG_L	U	0.24	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	Chloroform	0.8	UG_L	J	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	Chloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	Dibromochloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	Methylene Chloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	Ethylbenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	Tetrachloroethene (PCE)	0.35	UG_L	J	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	Toluene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	Trichloroethene (TCE)	3.5	UG_L		0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	Trichlorofluoromethane (CFC 11)	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	Vinyl Chloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	cis-1,2-Dichloroethene	0.44	UG_L	J	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	cis-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	trans-1,2-Dichloroethene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	trans-1,3-Dichloropropene	1	UG_L	U	0.2	1



NWIRP BETHPAGE GM-38  
SEPTEMBER 2016 EVENT  
DATA SUMMARY TABLE  
AQUEOUS  
SDG: R1609816

Sample Name	Lab ID	Analytical Method	Analysis Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	624	20160919	1	1,3-Dichloropropene, Total	2	UG_L	U		
BP-GM-38-GW-RW1-MW3-091416	R1609816-002	245.1	20161004	1	Mercury	0.1	UG_L	U	0.04	0.1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	2540D	20160919	1	Solids, Total Suspended (TSS)	3.8	MG_L			
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	1,1,1-Trichloroethane (TCA)	0.56	UG_L	J	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	1,1,2,2-Tetrachloroethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	1,1,2-Trichloroethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	1,1-Dichloroethane (1,1-DCA)	6.4	UG_L		0.21	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	1,1-Dichloroethene (1,1-DCE)	1.6	UG_L		0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	1,2-Dichlorobenzene	1	UG_L	U	0.25	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	1,2-Dichloroethane	0.93	UG_L	J	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	1,2-Dichloropropane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	1,3-Dichlorobenzene	1	UG_L	U	0.22	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	1,4-Dichlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	2-Chloroethyl Vinyl Ether	1	UG_L	U	0.6	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	Acrolein	10	UG_L	UJ	2.9	
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	Acrylonitrile	10	UG_L	U	1.8	
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	Benzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	Bromodichloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	Bromoform	1	UG_L	U	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	Bromomethane	1	UG_L	UJ	0.44	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	Carbon Tetrachloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	Chlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	Chloroethane	1	UG_L	U	0.24	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	Chloroform	2.4	UG_L		0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	Chloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	Dibromochloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	Methylene Chloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	Ethylbenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	Tetrachloroethene (PCE)	1	UG_L	U	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	Toluene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	Trichloroethene (TCE)	18	UG_L		0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	Trichlorofluoromethane (CFC 11)	1	UG_L	U	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	Vinyl Chloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	cis-1,2-Dichloroethene	6.1	UG_L		0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	cis-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	trans-1,2-Dichloroethene	1	UG_L	U	0.2	1



NWIRP BETHPAGE GM-38  
SEPTEMBER 2016 EVENT  
DATA SUMMARY TABLE  
AQUEOUS  
SDG: R1609816

Sample Name	Lab ID	Analytical Method	Analysis Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	trans-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	624	20160919	1	1,3-Dichloropropene, Total	2	UG_L	U		
BP-GM-38-GW-RW2-MW1-091516	R1609816-003	245.1	20161004	1	Mercury	0.1	UG_L	U	0.04	0.1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	2540D	20160919	1	Solids, Total Suspended (TSS)	1	MG_L	U		
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	1,1,1-Trichloroethane (TCA)	0.21	UG_L	J	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	1,1,2,2-Tetrachloroethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	1,1,2-Trichloroethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	1,1-Dichloroethane (1,1-DCA)	0.33	UG_L	J	0.21	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	1,1-Dichloroethene (1,1-DCE)	0.21	UG_L	J	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	1,2-Dichlorobenzene	1	UG_L	U	0.25	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	1,2-Dichloroethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	1,2-Dichloropropane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	1,3-Dichlorobenzene	1	UG_L	U	0.22	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	1,4-Dichlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	2-Chloroethyl Vinyl Ether	1	UG_L	U	0.6	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	Acrolein	10	UG_L	UJ	2.9	
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	Acrylonitrile	10	UG_L	U	1.8	
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	Benzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	Bromodichloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	Bromoform	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	Bromomethane	1	UG_L	UJ	0.44	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	Carbon Tetrachloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	Chlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	Chloroethane	1	UG_L	U	0.24	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	Chloroform	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	Chloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	Dibromochloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	Methylene Chloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	Ethylbenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	Tetrachloroethene (PCE)	2.3	UG_L		0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	Toluene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	Trichloroethene (TCE)	40	UG_L		0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	Trichlorofluoromethane (CFC 11)	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	Vinyl Chloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	cis-1,2-Dichloroethene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	cis-1,3-Dichloropropene	1	UG_L	U	0.2	1



NWIRP BETHPAGE GM-38  
SEPTEMBER 2016 EVENT  
DATA SUMMARY TABLE  
AQUEOUS  
SDG: R1609816

Sample Name	Lab ID	Analytical Method	Analysis Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	trans-1,2-Dichloroethene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	trans-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	624	20160919	1	1,3-Dichloropropene, Total	2	UG_L	U		
BP-GM-38-GW-RW3-MW1-091416	R1609816-004	245.1	20161004	1	Mercury	0.1	UG_L	U	0.04	0.1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	2540D	20160919	1	Solids, Total Suspended (TSS)	1	MG_L	U		
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	1,1,1-Trichloroethane (TCA)	0.44	UG_L	J	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	1,1,2,2-Tetrachloroethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	1,1,2-Trichloroethane	0.31	UG_L	J	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	1,1-Dichloroethane (1,1-DCA)	0.39	UG_L	J	0.21	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	1,1-Dichloroethene (1,1-DCE)	0.31	UG_L	J	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	1,2-Dichlorobenzene	1	UG_L	U	0.25	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	1,2-Dichloroethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	1,2-Dichloropropane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	1,3-Dichlorobenzene	1	UG_L	U	0.22	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	1,3-Dichloropropene, Total	2	UG_L	U		
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	1,4-Dichlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	2-Chloroethyl Vinyl Ether	1	UG_L	U	0.6	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	Acrolein	10	UG_L	UJ	2.9	
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	Acrylonitrile	10	UG_L	U	1.8	
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	Benzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	Bromodichloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	Bromoform	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	Bromomethane	1	UG_L	UJ	0.44	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	Carbon Tetrachloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	Chlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	Chloroethane	1	UG_L	U	0.24	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	Chloroform	0.24	UG_L	J	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	Chloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	cis-1,2-Dichloroethene	1.5	UG_L		0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	cis-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	Dibromochloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	Ethylbenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	Methylene Chloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	Tetrachloroethene (PCE)	0.48	UG_L	J	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	Toluene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	trans-1,2-Dichloroethene	1	UG_L	U	0.2	1



NWIRP BETHPAGE GM-38  
SEPTEMBER 2016 EVENT  
DATA SUMMARY TABLE  
AQUEOUS  
SDG: R1609816

Sample Name	Lab ID	Analytical Method	Analysis Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	trans-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	Trichloroethene (TCE)	190	UG_L		0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	Trichlorofluoromethane (CFC 11)	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	624	20160919	1	Vinyl Chloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW2-091416	R1609816-005	245.1	20161004	1	Mercury	0.1	UG_L	U	0.04	0.1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	2540D	20160919	1	Solids, Total Suspended (TSS)	1	MG_L	U		
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	1,1,1-Trichloroethane (TCA)	0.47	UG_L	J	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	1,1,2,2-Tetrachloroethane	1	UG_L	U	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	1,1,2-Trichloroethane	0.21	UG_L	J	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	1,1-Dichloroethane (1,1-DCA)	0.34	UG_L	J	0.21	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	1,1-Dichloroethene (1,1-DCE)	0.37	UG_L	J	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	1,2-Dichlorobenzene	1	UG_L	U	0.25	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	1,2-Dichloroethane	1	UG_L	U	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	1,2-Dichloropropane	1	UG_L	U	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	1,3-Dichlorobenzene	1	UG_L	U	0.22	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	1,3-Dichloropropene, Total	2	UG_L	U		
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	1,4-Dichlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	2-Chloroethyl Vinyl Ether	1	UG_L	U	0.6	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	Acrolein	10	UG_L	UJ	2.9	
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	Acrylonitrile	10	UG_L	U	1.8	
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	Benzene	1	UG_L	U	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	Bromodichloromethane	1	UG_L	U	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	Bromoform	1	UG_L	U	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	Bromomethane	1	UG_L	UJ	0.44	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	Carbon Tetrachloride	1	UG_L	U	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	Chlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	Chloroethane	1	UG_L	U	0.24	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	Chloroform	0.23	UG_L	J	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	Chloromethane	1	UG_L	U	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	cis-1,2-Dichloroethene	1.5	UG_L		0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	cis-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	Dibromochloromethane	1	UG_L	U	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	Ethylbenzene	1	UG_L	U	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	Methylene Chloride	1	UG_L	U	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	Tetrachloroethene (PCE)	0.54	UG_L	J	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	Toluene	1	UG_L	U	0.2	1



NWIRP BETHPAGE GM-38  
SEPTEMBER 2016 EVENT  
DATA SUMMARY TABLE  
AQUEOUS  
SDG: R1609816

Sample Name	Lab ID	Analytical Method	Analysis Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	trans-1,2-Dichloroethene	1	UG_L	U	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	trans-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	Trichloroethene (TCE)	190	UG_L		0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	Trichlorofluoromethane (CFC 11)	1	UG_L	U	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	624	20160919	1	Vinyl Chloride	1	UG_L	U	0.2	1
BP-GM-38-RW3-MW-2-DUP-091416	R1609816-006	245.1	20161004	1	Mercury	0.1	UG_L	U	0.04	0.1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	2540D	20160919	1	Solids, Total Suspended (TSS)	1.1	MG_L			
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	1,1,1-Trichloroethane (TCA)	0.75	UG_L	J	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	1,1,2,2-Tetrachloroethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	1,1,2-Trichloroethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	1,1-Dichloroethane (1,1-DCA)	3.5	UG_L		0.21	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	1,1-Dichloroethane (1,1-DCE)	2	UG_L		0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	1,2-Dichlorobenzene	1	UG_L	U	0.25	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	1,2-Dichloroethane	0.3	UG_L	J	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	1,2-Dichloropropane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	1,3-Dichlorobenzene	1	UG_L	U	0.22	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	1,3-Dichloropropene, Total	2	UG_L	U		
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	1,4-Dichlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	2-Chloroethyl Vinyl Ether	1	UG_L	U	0.6	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	Acrolein	10	UG_L	UJ	2.9	
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	Acrylonitrile	10	UG_L	U	1.8	
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	Benzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	Bromodichloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	Bromoform	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	Bromomethane	1	UG_L	UJ	0.44	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	Carbon Tetrachloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	Chlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	Chloroethane	1	UG_L	U	0.24	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	Chloroform	0.48	UG_L	J	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	Chloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	cis-1,2-Dichloroethene	1.1	UG_L		0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	cis-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	Dibromochloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	Ethylbenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	Methylene Chloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	Tetrachloroethene (PCE)	0.58	UG_L	J	0.2	1



**NWIRP BETHPAGE GM-38  
SEPTEMBER 2016 EVENT  
DATA SUMMARY TABLE  
AQUEOUS  
SDG: R1609816**

Sample Name	Lab ID	Analytical Method	Analysis Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	Toluene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	trans-1,2-Dichloroethene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	trans-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160920	2	Trichloroethene (TCE)	260	UG_L	D	0.4	2
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	Trichlorofluoromethane (CFC 11)	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	624	20160919	1	Vinyl Chloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW3-091516	R1609816-007	245.1	20161004	1	Mercury	0.1	UG_L	U	0.04	0.1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	2540D	20160919	1	Solids, Total Suspended (TSS)	1.4	MG_L			
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	1,1,1-Trichloroethane (TCA)	0.24	UG_L	J	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	1,1,2,2-Tetrachloroethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	1,1,2-Trichloroethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	1,1-Dichloroethane (1,1-DCA)	2	UG_L		0.21	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	1,1-Dichloroethane (1,1-DCE)	0.4	UG_L	J	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	1,2-Dichlorobenzene	1	UG_L	U	0.25	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	1,2-Dichloroethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	1,2-Dichloropropane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	1,3-Dichlorobenzene	1	UG_L	U	0.22	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	1,4-Dichlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	2-Chloroethyl Vinyl Ether	1	UG_L	U	0.6	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	Acrolein	10	UG_L	U	2.9	
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	Acrylonitrile	10	UG_L	U	1.8	
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	Benzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	Bromodichloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	Bromoform	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	Bromomethane	1	UG_L	UJ	0.44	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	Carbon Tetrachloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	Chlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	Chloroethane	1	UG_L	U	0.24	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	Chloroform	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	Chloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	Dibromochloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	Methylene Chloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	Ethylbenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	Tetrachloroethene (PCE)	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	Toluene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	Trichloroethene (TCE)	4.3	UG_L		0.2	1





NWIRP BETHPAGE GM-38  
SEPTEMBER 2016 EVENT  
DATA SUMMARY TABLE  
AQUEOUS  
SDG: R1609816

Sample Name	Lab ID	Analytical Method	Analysis Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	Trichlorofluoromethane (CFC 11)	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	Vinyl Chloride	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	cis-1,2-Dichloroethene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	cis-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	trans-1,2-Dichloroethene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	trans-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	624	20160920	1	1,3-Dichloropropene, Total	2	UG_L	U		
BP-GM-38-GW-RW3-MW4-091516	R1609816-008	245.1	20161004	1	Mercury	0.1	UG_L	U	0.04	0.1
BP-GM-38-GW-TP1-091416	R1609816-009	2540D	20160919	1	Solids, Total Suspended (TSS)	1	MG_L	U		
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	1,1,1-Trichloroethane (TCA)	0.49	UG_L	J	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	1,1,2,2-Tetrachloroethane	1	UG_L	U	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	1,1,2-Trichloroethane	1	UG_L	U	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	1,1-Dichloroethane (1,1-DCA)	2.1	UG_L		0.21	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	1,1-Dichloroethene (1,1-DCE)	0.68	UG_L	J	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	1,2-Dichlorobenzene	1	UG_L	U	0.25	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	1,2-Dichloroethane	0.7	UG_L	J	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	1,2-Dichloropropane	1	UG_L	U	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	1,3-Dichlorobenzene	1	UG_L	U	0.22	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	1,4-Dichlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	2-Chloroethyl Vinyl Ether	1	UG_L	U	0.6	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	Acrolein	10	UG_L	UJ	2.9	
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	Acrylonitrile	10	UG_L	U	1.8	
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	Benzene	1	UG_L	U	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	Bromodichloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	Bromoform	1	UG_L	U	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	Bromomethane	1	UG_L	UJ	0.44	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	Carbon Tetrachloride	1	UG_L	U	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	Chlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	Chloroethane	1	UG_L	U	0.24	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	Chloroform	1.6	UG_L		0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	Chloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	Dibromochloromethane	1	UG_L	U	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	Methylene Chloride	1	UG_L	U	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	Ethylbenzene	1	UG_L	U	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	Tetrachloroethene (PCE)	0.37	UG_L	J	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	Toluene	1	UG_L	U	0.2	1



NWIRP BETHPAGE GM-38  
SEPTEMBER 2016 EVENT  
DATA SUMMARY TABLE  
AQUEOUS  
SDG: R1609816

Sample Name	Lab ID	Analytical Method	Analysis Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	Trichloroethene (TCE)	47	UG_L		0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	Trichlorofluoromethane (CFC 11)	1	UG_L	U	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	Vinyl Chloride	1	UG_L	U	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	cis-1,2-Dichloroethene	12	UG_L		0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	cis-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	trans-1,2-Dichloroethene	1	UG_L	U	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	trans-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-GW-TP1-091416	R1609816-009	624	20160919	1	1,3-Dichloropropene, Total	2	UG_L	U		
BP-GM-38-GW-TP1-091416	R1609816-009	245.1	20161004	1	Mercury	0.1	UG_L	U	0.04	0.1
BP-GM-38-RW3-091516	R1609816-010	2540D	20160919	1	Solids, Total Suspended (TSS)	1	MG_L	U		
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	1,1,1-Trichloroethane (TCA)	0.95	UG_L	J	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	1,1,2,2-Tetrachloroethane	1	UG_L	U	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	1,1,2-Trichloroethane	0.29	UG_L	J	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	1,1-Dichloroethane (1,1-DCA)	1.8	UG_L		0.21	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	1,1-Dichloroethene (1,1-DCE)	1.5	UG_L		0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	1,2-Dichlorobenzene	1	UG_L	U	0.25	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	1,2-Dichloroethane	1	UG_L	U	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	1,2-Dichloropropane	1	UG_L	U	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	1,3-Dichlorobenzene	1	UG_L	U	0.22	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	1,3-Dichloropropene, Total	2	UG_L	U		
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	1,4-Dichlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	2-Chloroethyl Vinyl Ether	1	UG_L	U	0.6	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	Acrolein	10	UG_L	UJ	2.9	
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	Acrylonitrile	10	UG_L	U	1.8	
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	Benzene	1	UG_L	U	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	Bromodichloromethane	1	UG_L	U	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	Bromoform	1	UG_L	U	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	Bromomethane	1	UG_L	UJ	0.44	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	Carbon Tetrachloride	1	UG_L	U	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	Chlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	Chloroethane	1	UG_L	U	0.24	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	Chloroform	0.26	UG_L	J	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	Chloromethane	1	UG_L	U	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	cis-1,2-Dichloroethene	1.4	UG_L		0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	cis-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	Dibromochloromethane	1	UG_L	U	0.2	1



NWIRP BETHPAGE GM-38  
SEPTEMBER 2016 EVENT  
DATA SUMMARY TABLE  
AQUEOUS  
SDG: R1609816

Sample Name	Lab ID	Analytical Method	Analysis Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	Ethylbenzene	1	UG_L	U	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	Methylene Chloride	1	UG_L	U	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	Tetrachloroethene (PCE)	0.64	UG_L	J	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	Toluene	1	UG_L	U	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	trans-1,2-Dichloroethene	1	UG_L	U	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	trans-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160920	2	Trichloroethene (TCE)	230	UG_L	D	0.4	2
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	Trichlorofluoromethane (CFC 11)	1	UG_L	U	0.2	1
BP-GM-38-RW3-091516	R1609816-010	624	20160919	1	Vinyl Chloride	1	UG_L	U	0.2	1
BP-GM-38-RW3-091516	R1609816-010	245.1	20161004	1	Mercury	0.1	UG_L	U	0.04	0.1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	1,1,1-Trichloroethane (TCA)	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	1,1,2,2-Tetrachloroethane	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	1,1,2-Trichloroethane	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	1,1-Dichloroethane (1,1-DCA)	1	UG_L	U	0.21	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	1,1-Dichloroethene (1,1-DCE)	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	1,2-Dichlorobenzene	1	UG_L	U	0.25	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	1,2-Dichloroethane	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	1,2-Dichloropropane	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	1,3-Dichlorobenzene	1	UG_L	U	0.22	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	1,4-Dichlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	2-Chloroethyl Vinyl Ether	1	UG_L	U	0.6	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	Acrolein	10	UG_L	UJ	2.9	
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	Acrylonitrile	10	UG_L	U	1.8	
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	Benzene	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	Bromodichloromethane	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	Bromoform	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	Bromomethane	1	UG_L	UJ	0.44	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	Carbon Tetrachloride	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	Chlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	Chloroethane	1	UG_L	U	0.24	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	Chloroform	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	Chloromethane	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	Dibromochloromethane	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	Methylene Chloride	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	Ethylbenzene	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	Tetrachloroethene (PCE)	1	UG_L	U	0.2	1



NWIRP BETHPAGE GM-38  
SEPTEMBER 2016 EVENT  
DATA SUMMARY TABLE  
AQUEOUS  
SDG: R1609816

Sample Name	Lab ID	Analytical Method	Analysis Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	Toluene	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	Trichloroethene (TCE)	0.26	UG_L	J	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	Trichlorofluoromethane (CFC 11)	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	Vinyl Chloride	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	cis-1,2-Dichloroethene	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	cis-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	trans-1,2-Dichloroethene	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	trans-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-FB-091416	R1609816-011	624	20160919	1	1,3-Dichloropropene, Total	2	UG_L	U		
BP-GM-38-FB-091416	R1609816-011	245.1	20161004	1	Mercury	0.1	UG_L	U	0.04	0.1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	1,1,1-Trichloroethane (TCA)	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	1,1,2,2-Tetrachloroethane	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	1,1,2-Trichloroethane	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	1,1-Dichloroethane (1,1-DCA)	1	UG_L	U	0.21	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	1,1-Dichloroethene (1,1-DCE)	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	1,2-Dichlorobenzene	1	UG_L	U	0.25	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	1,2-Dichloroethane	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	1,2-Dichloropropane	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	1,3-Dichlorobenzene	1	UG_L	U	0.22	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	1,4-Dichlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	2-Chloroethyl Vinyl Ether	1	UG_L	U	0.6	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	Acrolein	10	UG_L	U	2.9	
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	Acrylonitrile	10	UG_L	U	1.8	
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	Benzene	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	Bromodichloromethane	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	Bromoform	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	Bromomethane	1	UG_L	UJ	0.44	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	Carbon Tetrachloride	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	Chlorobenzene	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	Chloroethane	1	UG_L	U	0.24	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	Chloroform	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	Chloromethane	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	Dibromochloromethane	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	Methylene Chloride	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	Ethylbenzene	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	Tetrachloroethene (PCE)	1	UG_L	U	0.2	1



NWIRP BETHPAGE GM-38  
SEPTEMBER 2016 EVENT  
DATA SUMMARY TABLE  
AQUEOUS  
SDG: R1609816

Sample Name	Lab ID	Analytical Method	Analysis Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	Toluene	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	Trichloroethene (TCE)	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	Trichlorofluoromethane (CFC 11)	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	Vinyl Chloride	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	cis-1,2-Dichloroethene	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	cis-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	trans-1,2-Dichloroethene	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	trans-1,3-Dichloropropene	1	UG_L	U	0.2	1
BP-GM-38-TB-091516	R1609816-012	624	20160920	1	1,3-Dichloropropene, Total	2	UG_L	U		