

**LEGEND**  
 - - - - - INDICATES FIELD WIRING

**NOTES**  
 1. REFER TO DRAWING E-14 FOR WIRE SIZE AND COLOR CODE.


**REFERENCE DRAWINGS**  
 E-12 PLAN  
 E-15 PLC CONTROL PANEL ARRANGEMENT

**DATE PRINTED**  
 5/26/05

**100% REVIEW DRAWINGS**  
 NOT FOR CONSTRUCTION

SCALE VERIFICATION: THIS BAR MEASURES 1" ON ORIGINAL. ADJUST SCALE ACCORDINGLY.

| No | Revision | Date | Initial |
|----|----------|------|---------|
|    |          |      |         |
|    |          |      |         |
|    |          |      |         |
|    |          |      |         |
|    |          |      |         |

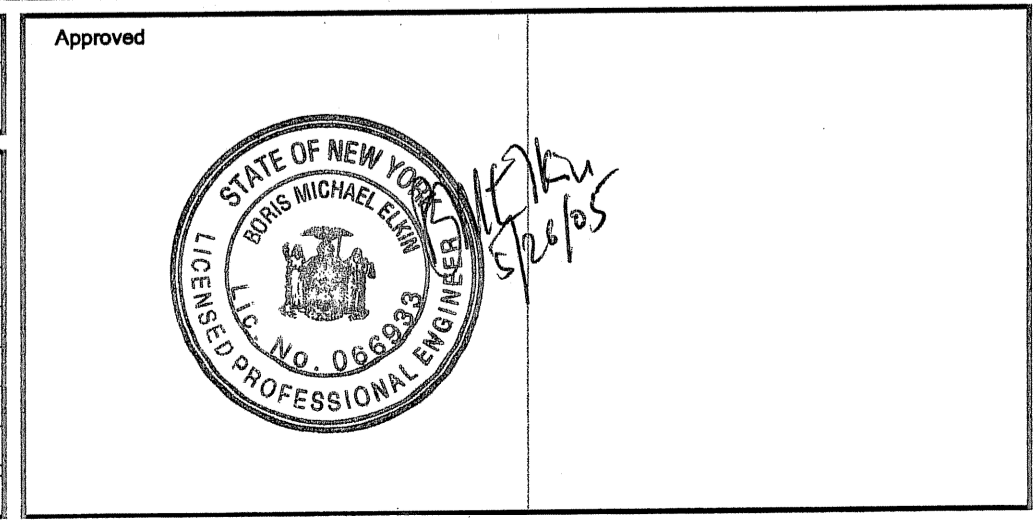

HOOKER/RUCO SITE  
 HICKSVILLE, NEW YORK

BIOSPARGE TREATMENT SYSTEM

INJECTION WELL IW-9  
 REMOTE I/O PANEL WIRING DIAGRAM

|                           |  |                         |  |                            |  |                           |  |
|---------------------------|--|-------------------------|--|----------------------------|--|---------------------------|--|
| Project Manager:<br>J.KAY |  | Reviewed By:<br>BME/TFP |  | Designed By:<br>D. SZALACH |  | Date:<br>SEPTEMBER 2003   |  |
| Scale:<br>NONE            |  | Project No:<br>06883-10 |  | Report No:<br>045          |  | Drawing No:<br>E-16 SHT.9 |  |