




130072

September 21, 2005

Mr. Shewen Bian
US Army Corps of Engineers, Metro East Residency
Fort Hamilton Military Community
408 Pershing Loop
Brooklyn, NY 11252

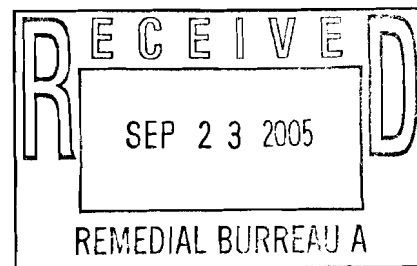

Regional Office

1293 Broad St.
Suite 200
Bloomfield, NJ 07003

Phone: 973.338.7011
Fax: 973.338.7950

RE: **Transmittal of July 2005 and August 2005 Monthly O&M Activity Reports**
Stanton Cleaners Area Groundwater Contamination Site, Great Neck, New York
USACE LTRA Contract DACW41-03-D-0004, T.O. 004

Dear Mr. Bian:

Environmental Chemical Corporation (ECC) is transmitting in this letter one hardcopy each of the July 2005 and August 2005 Monthly O&M Activity Reports for the Stanton Cleaners LTRA site. As of this date, the July data has still not been received from the CLP. Please see the latest O&M analytical data through May 2005, included in these reports. To date, all effluent data has been non-detect, or below the discharge criteria. ECC will immediately identify all parties copied on this letter, upon discovery, if any analytical results are outside compliance criteria.

Please review the attached report, and let us know if you have any comments, or require additional information.

If you have any questions, please contact me at (973) 338-7011, ext. 121.

Sincerely,
Environmental Chemical Corporation

David M. Miller, P.G.
Project Manager

cc: Mr. Damian Duda, US EPA Region II – 2 copies, and softcopy via e-mail
Mr. Gerard Burke, NYSDEC – 1 softcopy via electronic mail and 1 hardcopy via mail
Division of Env. Remediation
625 Broadway – 11th Floor
Albany, New York 12233-7015
gwburke@gw.dec.ny.us
(518) 402-9798

Corporate Office

1240 Bayshore Highway
Burlingame, CA 94010

Phone: (650) 347-1555
Fax: (650) 347-8789

www.ecc.net

Monthly Operations and Monitoring Report

July 2005

Site:

Stanton Cleaners Area Groundwater Contamination Site Great Neck, New York

Prepared for:

Environmental Chemical Corporation 1293 Broad Street, Suite
200 Bloomfield, New Jersey 07003

Prepared by:

Earth Tech, Inc.
7870 Villa Park Drive, Suite 400
Richmond, Virginia 23228

August 31, 2005

ET Project No. 70536.02.01.02

Monthly Operations and Monitoring Report

July 2005

Site:

Stanton Cleaners Area Groundwater Contamination Site Great Neck, New York

Prepared for:

Environmental Chemical Corporation 1293 Broad Street, Suite
200 Bloomfield, New Jersey 07003

Prepared by:

Earth Tech, Inc.
7870 Villa Park Drive, Suite 400
Richmond, Virginia 23228

Author: James Kearns

August 31, 2005

Title: Environmental Scientist

ET Project No. 70536.02.01.02

Date: August 31, 2005

Reviewer: _____

Title: _____

Date: _____

Table of Contents

1.0	INTRODUCTION	1
2.0	SUMMARY OF ACTIVITIES DURING JULY 2005	2
3.0	GROUNDWATER TREATMENT SYSTEM ACTIVITIES.....	2
3.1	Operation and Maintenance.....	2
3.2	Sampling and Analysis.....	3
3.2.1	Raw and Treated Groundwater	3
3.2.2	Process Air Stream Monitoring.....	4
4.0	MONITORING WELL SAMPLING	4
5.0	PLUME PERIMETER MONITORING	4
6.0	INDOOR AIR QUALITY SAMPLING	5
7.0	FUTURE EVENTS PLANNED	5
8.0	PROBLEM AREAS AND RECOMMENDED SOLUTIONS (OUTSTANDING ISSUES)	5

Tables

Table 1	Estimated PCE Recovery Rates (September 2003 – July 2005)
---------	---

Figures

Figure 1	Site Location Map
Figure 2	Average PCE Concentrations (September 2003 – July 2005)

Appendices

Appendix A	Daily Quality Control Reports (DQCRs)
Appendix B	Groundwater Treatment System Operation & Maintenance Checklists
Appendix C	Groundwater Treatment System Downloaded Operational Data
Appendix D	Sampling Trip Reports
Appendix E	Groundwater Treatment System Raw and Treated Analytical Data
Appendix F	Soil Vapor Extraction and Pump and Treat System Bi-weekly Air Monitoring Logs
Appendix G	Semi-Annual Groundwater Sampling Analytical Data
Appendix H	Historical Groundwater Level Monitoring Results (Ongoing)
Appendix I	Indoor Air Quality Analytical Data
Appendix J	Action List Dated July 2005

1.0 INTRODUCTION

This Monthly Operations and Monitoring Report, July 2005 (Monthly Report) has been prepared by Earth Tech, Inc., as a subcontractor to Environmental Chemical Corporation (ECC), under Contract No.5442-001-001.

The Stanton Cleaners Area Groundwater Contamination (Stanton) site is located at 110 Cutter Mill Road in Great Neck, Nassau County, New York. The Stanton Cleaner Property (SCP) is approximately ¼ acre in size and includes a two-story building in which a dry-cleaning business operates and an adjacent one-story boiler/storage building as well as a two-story treatment building. The site is bordered by an indoor tennis facility, a synagogue and school facility.

Improper handling and disposal of spent dry cleaning solvents, including Tetrachloroethylene (PCE), resulted in the release of hazardous substances at the site. PCE migrated from the site's subsurface soils into the indoor air environments of the surrounding buildings and into groundwater beneath the site, resulting in a significant threat to human health.

In 1983, approximately 20 cubic yards of PCE-contaminated soil was removed from behind the Stanton Cleaners property.

In 1989, a groundwater extraction and treatment system was installed by the original Site operator to address groundwater contamination which resulted from improper disposal of spent PCE behind the SCP building. This system is not currently operational.

In 1998, the New York State Department of Environmental Conservation (NYSDEC) funded the construction of a new air stripper treatment system for the WAGNN water supply wells, which are impacted by contamination from the Site. This treatment system is currently in operation. In October 1998, as an immediate response action, the EPA installed a temporary soil vapor interceptor system, adjacent to the tennis club, to mitigate impacts from PCE vapors to the indoor air of this facility.

In 2001, the EPA completed the construction and installation of a soil vapor extraction (SVE) system and a ground water treatment (GWT) system on the SCP. Both the SVE and GWT systems are housed in the treatment building that was constructed on the SCP. The SVE was installed to remediate the VOC-contaminated soils, thus reducing the indoor air contamination in the adjacent affected buildings to safe levels. The GWT system was installed to remediate the VOC-contaminated groundwater and to remove the threat of vapors through the Site soils. Both systems are currently operating at the Site. The collected VOC-contaminated vapors and groundwater from both systems are treated through separate granular activated carbon (GAC) systems.

The site is presently under the jurisdiction of the Remedial Branch of the USEPA, Region II; USACE provides oversight to USEPA for the remedial action and the long-term remedial action programs. ECC provides oversight to the USACE to perform long-term remediation actions. Earth Tech, as a subcontractor to ECC, provides support on the following tasks as described in the Work Plan:

- Operation and maintenance (O&M) of the GWTS and SVE, including sampling and reporting;
 - Sampling of monitoring wells associated with the site in order to track the migration of the contaminant plume, along with reporting.
-

- Sampling of indoor air quality of buildings adjacent to the site in order to identify all the adjacent buildings being impacted by site related contaminants and the effectiveness of the remedial actions being instituted at the site.

All work under this contract is performed in accordance with the following documents:

- Work Plan for Long-Term Remedial Action Support;
- Site-Specific Health and Safety Plan (HASP), dated July 23, 2001 and
- Sampling Quality Assurance Project Plan (SQAPP) dated August 22, 2000.

As required by the Scope of Work for this project, monthly summary reports are prepared to document and summarize the activities taking place. These reports provide a concise description of work performed during the reporting period and include pertinent deliverables as appendices. This monthly summary report covers the period between July 1 and July 31, 2005.

2.0 SUMMARY OF ACTIVITIES DURING JULY 2005

The following list summarizes activities performed and milestone dates under this contract during the reporting period, July 2005:

- July 7– Weekly O&M Inspection
- July 7 – Monthly water level measurements
- July 7- Bi-weekly system air monitoring not performed as REAC was performing system air sampling
- July 12- Monthly P&T system sampling
- July 25 – Bi-weekly system air monitoring
- July 25 – Weekly O&M Inspection
- July 27 – Quarterly Indoor Air Quality Sampling

Details of system shutdowns and alarms during the month of July 2005 are discussed in section 3.1. Daily Quality Control Reports (DQCRs), which include projected work for the following two weeks, are completed for each day of site activities. Copies of these reports are included as Appendix A.

3.0 GROUNDWATER TREATMENT SYSTEM ACTIVITIES

3.1 Operation and Maintenance

The GWTS treated and discharged 2,668,422.6 gallons during the month of July 2005. The system was operational (recovery well pumps running) for approximately 740 of the 744 hours during the month, for an average operating flow of 60.1 gallons per minute (gpm). The system has treated a total of 100,856,696.4 gallons since the plant startup in November 2001.

There are currently two recovery wells pumping water into the system (EPA-EXT-02 and EPA-EXT-4R). EPA-EXT-02 is located in the triangle, the corner of New Cutter Mill Road and Mirrielees Road. Extraction well MW-24 was also pumping from the triangle location until it was turned off and April 20, 2005. Extraction well EPA-EXT-4R was activated on April 20, 2005. This new extraction well is located in the parking lot directly in front of the Stanton Dry Cleaners building. The decision to turn off extraction well MW-24 and replace it with EPA-ECT-4R was made by the USEPA.

The facility is equipped with a remote monitoring and control system that was accessed a minimum of three times per week, by the lead engineer, during the reporting period to ensure proper system operation and notify response personnel if a problem or abnormal condition was observed. The system also provides remote notification of alarm conditions via automatic e-mail and text messaging.

The Treatment System Operation and Maintenance Checklist were completed during each O&M inspection event and the checklists for July 7 and 25, 2005 are provided in Appendix B. When the system is operational, any abnormal conditions or parameters outside of the normal operating range are addressed by the lead operator and/or monitoring/environmental technician on site (Jim Simmonds or James Kearns). If they require guidance or notes any serious conditions, the inspector notifies the task manager (Tom Williams). The checklists are completed on site and sent to the task manager for review and scheduling of additional work if needed. Abnormal conditions and/or parameters outside the operating range are addressed, including repairs, cleaning, and continued monitoring.

System operational and alarm conditions are automatically stored by the PLC. This data is downloaded every two weeks. The July 2005 operational data is included in Appendix C. While operational, the system data are within the normal ranges and are consistent with visual observations, with any exceptions as described above.

The effluent flow data table in Appendix C shows daily discharge flows from each day of system operation and cumulative treated water discharge for each day during the reporting period, as well as a summary of total monthly flow and average daily flow since the system was started up in October 2001.

3.2 Sampling and Analysis

3.2.1 Raw and Treated Groundwater

In accordance with the SQAPP, GWTS sampling is conducted on a monthly basis to monitor plant efficiency, to determine whether liquid carbon breakthrough has occurred, and to verify that contract-specific discharge parameters (in accordance with National Pollutant Discharge Elimination System (NPDES) permit equivalency) are met. The combined GWTS influent, along with the GWTS effluent (discharge), will be sampled by the 15th of each month. Collected samples will be shipped to a designated EPA, CLP lab for analysis of TCL volatile organic compounds.

Earth Tech personnel conducted the GWTS influent and effluent sampling for this report period on July 23, 2005. The samples were shipped to the USEP Region II DESA Laboratory, located in Edison, NJ for analysis of low concentration TCL volatile organic compounds. A copy of the full sampling trip report containing the chain of custody forms and FedEx air bill is included in Appendix D. Laboratory analytical results for the GWTS sampling event during this reporting period will be forwarded to ECC under separate cover from the laboratory.

Measurements of influent and effluent pH and turbidity, along with effluent conductivity, are automatically monitored and recorded by the GWTS PLC on a daily basis; this information is included with the downloaded data in Appendix C.

The next GWTS influent / effluent sampling event is scheduled for August 15, 2005.

3.2.2 Process Air Stream Monitoring

Air monitoring of the SVE and Pump and Treat System is performed on a bi-weekly basis. It includes monitoring for VOCs, air velocity, temperature, humidity, dew point, vacuum pressure and other parameters, as specified in the O&M manual. Air monitoring is performed at the following locations within the system:

- Combined SVE - Influent (pre-treatment),
- Post groundwater Air-Stripper (pre-treatment),
- Post vapor phase carbon vessel 1 – Air Stripper air discharge (post-treatment).
- Post vapor phase carbon vessel 2 – SVE air discharge (post-treatment).
- Sub-slab monitoring points (pre-treatment)

Bi-weekly air monitoring activities were conducted on July 25, 2005. The bi-weekly air monitoring logs are included in Appendix F. Estimated PCE removal rates for the SVE system are presented in Table 1. A Graph showing the estimated PCE removal rate trend over time is presented in Figure 2. The next bi-weekly air-monitoring event is scheduled for August 3, 2005.

4.0 Monitoring Well Sampling

Groundwater samples from select monitoring wells both on and off-site are collected on a quarterly basis and shipped to a designated EPA, CLP lab for analysis. Groundwater sampling activities are performed in accordance with the USEPA Groundwater Sampling SOP #2007 and the USEPA Low-Stress Purging and Sampling SOP provided in the SQAPP. Each quarterly sampling event is coordinated with the local water authority to schedule the event when local water supply drawdown conditions do not impact the measurements. The location and number of monitoring wells as well as analytical parameters will be determined before each event by the USPEA, USACE, and ECC.

The first semi-annual groundwater sampling event of 2005 was conducted by Earth Tech personnel on February 7 through 11, 2005. A total of 25 groundwater monitoring wells were sampled for analysis of the presence of TCL volatiles only. A copy of the full sampling trip report containing the chain of custody forms and FedEx air bills is included in Appendix D.

Laboratory analytical results for this quarterly groundwater sampling event will be forwarded to ECC under separate cover from the laboratory. The next quarterly groundwater sampling event is scheduled for the week of August 29, 2005. It will entail sampling 28 monitoring wells, 15 of which will have natural attenuation perimeter analysis.

5.0 PLUME PERIMETER MONITORING

Groundwater level measurements are obtained from both on-site and offsite wells once a month in order to evaluate capture zone(s) around the groundwater extraction wells. The event is coordinated with the local water authority so the event can be scheduled when the local water supply drawdown conditions will have minimal impact to the measurements.

Water level measurements were collected on July 7, 2005. The location and number of monitoring wells was determined by the USEPA based on the site Capture Zone Analysis Plan. Groundwater level measurements for July 2005 and historical groundwater level measurements are provided in Appendix H.

6.0 Indoor Air Quality Sampling

Indoor air quality samples from select locations within the treatment building and buildings along the perimeter of the site are collected using summa canisters on a quarterly basis and shipped to a designated EPA, CLP lab for analysis. The location and number of indoor air quality samples to be collected as well as analytical parameters will be determined by the USEPA, USACE and ECC.

The last indoor air quality sampling event was conducted on July 27, 2005 by Earth Tech personnel. This sampling event was conducted to address air quality issues within the groundwater treatment building. The sampling report for this event is included in Appendix

7.0 FUTURE EVENTS PLANNED

The following scheduled events are planned (or have since occurred) during the next three reporting periods:

- Continue to perform GWTS inspection and maintenance as required;
- Continue to perform bi-weekly system air monitoring;
- Collect system influent and effluent samples as directed by USACE/ECC/USEPA;
- Obtain groundwater level measurements as directed by USACE/ECC/USEPA;
- Collect groundwater samples from monitoring wells as directed by USACE/ECC/USEPA;
- Collect indoor air quality samples as directed by USACE/ECC/USEPA;
- HVAC Filter Change Out (Long Island Hebrew Academy Roof)
- Semi-Annual Groundwater Monitoring Well Sampling Event (August)

8.0 PROBLEM AREAS AND RECOMMENDED SOLUTIONS (OUTSTANDING ISSUES)

An Action List of ongoing and completed items is provided in Appendix J to track work tasks that have been targeted as issues to be addressed.

Tables

TABLE 1
ESTIMATED PCE RECOVERY RATES
STANTON CLEANERS AREA GROUNDWATER CONTAMINATION SITE
250 CFM SVE SYSTEM
September 2003 - July 2005

Date	# of Days	Flow Rate		VOC			
		(cfm)	Avg (cfm)	Concentration (ppm)	Average (ppm)	Discharge Rate (lbs/day)	Total Discharge (lbs)
9/11/2003	1	225	225	4.2	4.20	0.6	0.6
9/25/2003	13	210	217.5	4.7	4.45	0.6	7.8
10/8/2003	13	213	211.5	5	4.85	0.6	8.2
10/23/2003	15	210	210	12.2	8.6	1.1	16.7
11/5/2003	13	215	212.5	6.8	9.5	1.2	16.2
11/22/2003	17	211	213	6	6.4	0.8	14.3
12/4/2003	12	205	208	5.9	5.95	0.8	9.2
12/17/2003	13	200	202.5	4	4.95	0.6	8.0
12/30/2003	13	210	205	4	4.95	0.6	8.1
1/15/2004	16	205	207.5	4.1	4.05	0.5	8.3
2/5/2004	SVE System Manually Shutdown Since 1/16/04						
2/12/2004	8	200	200	3.5	3.5	0.4	3.5
2/26/2004	14	205	202.5	5.3	4.4	0.6	7.7
3/10/2004	12	200	202.5	5	5.15	0.6	7.7
3/25/2004	15	199	199.5	5.1	5.05	0.6	9.3
4/13/2004	19	175	187	6.3	5.7	0.7	12.5
4/29/2004	16	170	172.5	6	6.15	0.7	10.5

Notes:

VOC readings taken before vapor phase carbon off-gas treatment.

Deep SVE Wells Closed on 12/10/03 Per OSC's Request

Formula provided by EPA in the "Elements for Effective Management of Operating Pump and Treatment Systems" publication.

$$M_{air} = Q_{air} \times C_{air} \times \frac{0.0283 \text{ m}^3}{\text{ft}^3} \times \frac{1440 \text{ min}}{\text{day}} \times \frac{2.2 \text{ lbs}}{1000000 \text{ mg}}$$

$$C_{air} (\text{mg/m}^3) = \frac{\text{Conc} (\text{ppmv}) \times 1 \text{ mole air} \times 1000 \text{ L} \times 1000 \text{ mg}}{1\text{E}+06 \times 24.1 \text{ L} \times \text{m}^3 \times \text{g}} \times MW_x$$

Notes:

M_{air} = mass loading, removal rate in air (lbs/day)

Q_{air} = flow rate in air (cfm)

C_{air} = contaminant concentration (mg/m³)

MW_x = molecular weight in grams/mole, for PCE is 166

Note: The conversion factor (1 mole air)/(24.1 L) varies with both temperature and pressure. At a pressure of 1 atmosphere and a temperature of 32 degrees Farenheit

(0 degrees Celcius), the conversion is (1 mole air)/(22.4 L).

TABLE 1 (continued)
ESTIMATED PCE RECOVERY RATES
STANTON CLEANERS AREA GROUNDWATER CONTAMINATION SITE
250 CFM SVE SYSTEM
September 2003 - July 2005

Date	# of Days	Flow Rate		VOC			
		(cfm)	Avg (cfm)	Concentration (ppm)	Average (ppm)	Discharge Rate (lbs/day)	Total Discharge (lbs)
5/13/2004	14	150	160	6	6	0.6	8.3
5/30/2004	17	147	148.5	5.9	5.95	0.5	9.3
6/10/2004	11	150	148.5	4.4	5.15	0.5	5.2
6/30/2004	20	145	147.5	5.6	5	0.5	9.1
7/8/2004	8	140	142.5	4.9	5.25	0.5	3.7
7/22/2004	14	139	139.5	4.8	4.85	0.4	5.8
8/9/2004	18	140	139.5	3.1	3.95	0.3	6.1
8/31/2004	1	135	137.5	3	3.05	0.3	0.3
9/8/2004	8	120	127.5	2.9	2.95	0.2	1.9
9/30/2004	22	121	120.5	3.1	3	0.2	4.9
10/4/2004	5	121	121	2.9	3	0.2	1.1
10/20/2004	15	120	120.5	2.8	2.85	0.2	3.2
11/1/2004	12	121	120.5	3	2.9	0.2	2.6
11/17/2004	16	125	123	4.1	3.55	0.3	4.3
11/29/2004	12	120	122.5	4.2	4.15	0.3	3.8
12/7/2004	8	121	120.5	4.2	4.2	0.3	2.5
12/16/2004	9	120	120.5	4.1	4.15	0.3	2.8
1/12/2005	27	120	120	4.5	4.3	0.3	8.6
1/17/2005	5	120	120	4.5	4.5	0.3	1.7
2/9/2005	23	120	120	3.9	4.2	0.3	7.2
2/23/2005	14	120	120	3.5	3.7	0.3	3.8
3/2/2005	7	120	120	3.2	3.35	0.2	1.7
3/16/2005	14	120	120	3.5	3.35	0.2	3.5
4/4/2005	19	120	120	3	3.25	0.2	4.6
4/20/2005	16	120	120	2.9	2.95	0.2	3.5
5/3/2005	13	120	120	3.1	3.00	0.2	2.9
5/19/2005	16	120	120	2.9	3.00	0.2	3.6
6/15/2005	26	120	120	1	1.95	0.1	3.8
6/22/2005	7	270	120	8.3	5.60	0.4	2.9
7/25/2005	33	280	275	8.3	8.30	1.4	46.5
						Total	317.7

Notes:

SVE system turned off from 8/24/2004 through 8/31/2004 during tennis court demolition activities.

New SVE well EPA-EXT-04 on-line 11/04/2004

VOC readings taken before vapor phase carbon off-gas treatment.

Deep SVE Wells Closed on 12/10/03 Per OSC's Request

Formula provided by EPA in the "Elements for Effective Management of Operating Pump and Treatment Systems" publication.

$M_{air} = Q_{air} \times C_{air} \times 0.0283 \frac{m^3}{ft^3} \times 1440 \frac{min}{day} \times 2.2 \frac{lbs}{mg}$

ft³ day 1000000 mg

$C_{air} (mg/m^3) = \frac{Conc (ppmv) \times 1 \text{ mole air} \times 1000 L}{1E+06} \times 1000 \frac{mg}{m^3} \times MW_x$

1E+06 24.1 L m³ g

Notes:

M_{air} = mass loading, removal rate in air (lbs/day)

Q_{air} = flow rate in air (cfm)

C_{air} = contaminant concentration (mg/m³)

MW_x = molecular weight in grams/mole, for PCE is 166

Note: The conversion factor (1 mole air)/(24.1 L) varies with both temperature and pressure. At a pressure of 1 atmosphere and a temperature of 32 degrees Fahrenheit

(0 degrees Celcius), the conversion is (1 mole air)/(22.4 L).

Figures




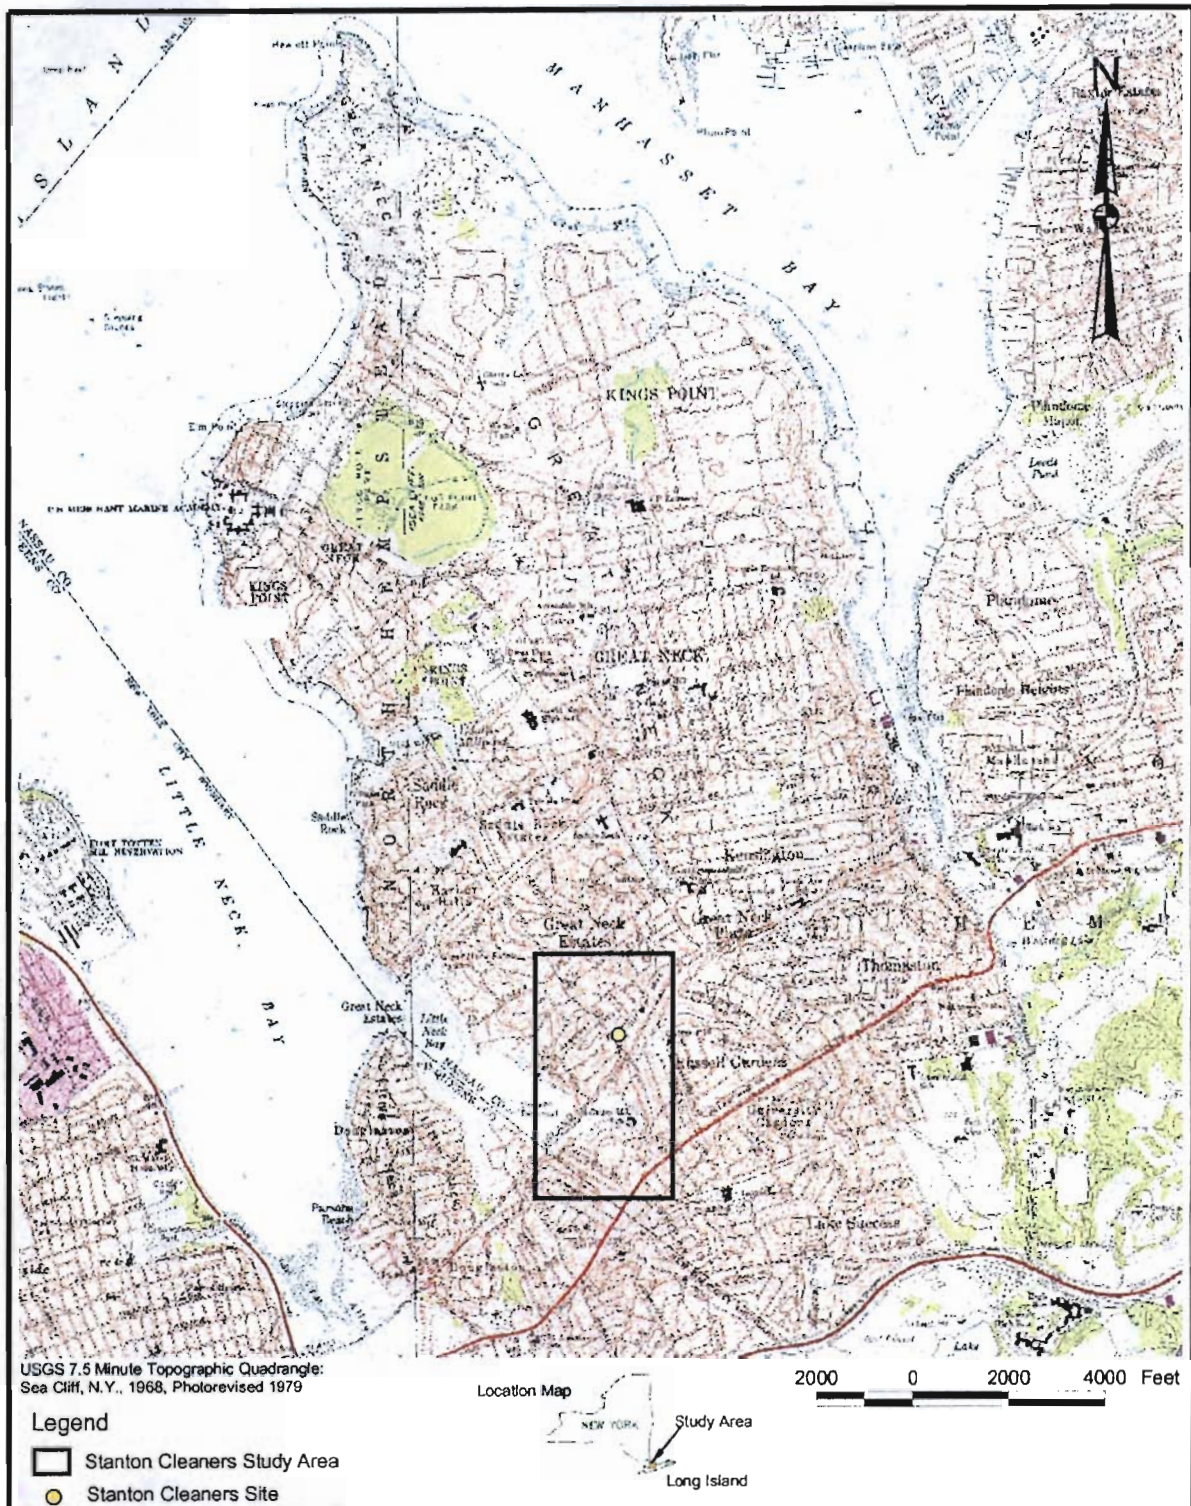


Figure 1
Site Location Map
Stanton Cleaners Area
Groundwater Contamination Site

Stanton Cleaners Area
Groundwater Contamination Site
Great Neck, Nassau County, New York

Figure 2
 STANTON CLEANERS AREA GROUNDWATER CONTAMINATION SITE
 AVERAGE PCE CONCENTRATIONS (ppm)
 250 CFM FINAL SVE SYSTEM
 September 2003 - July 2005

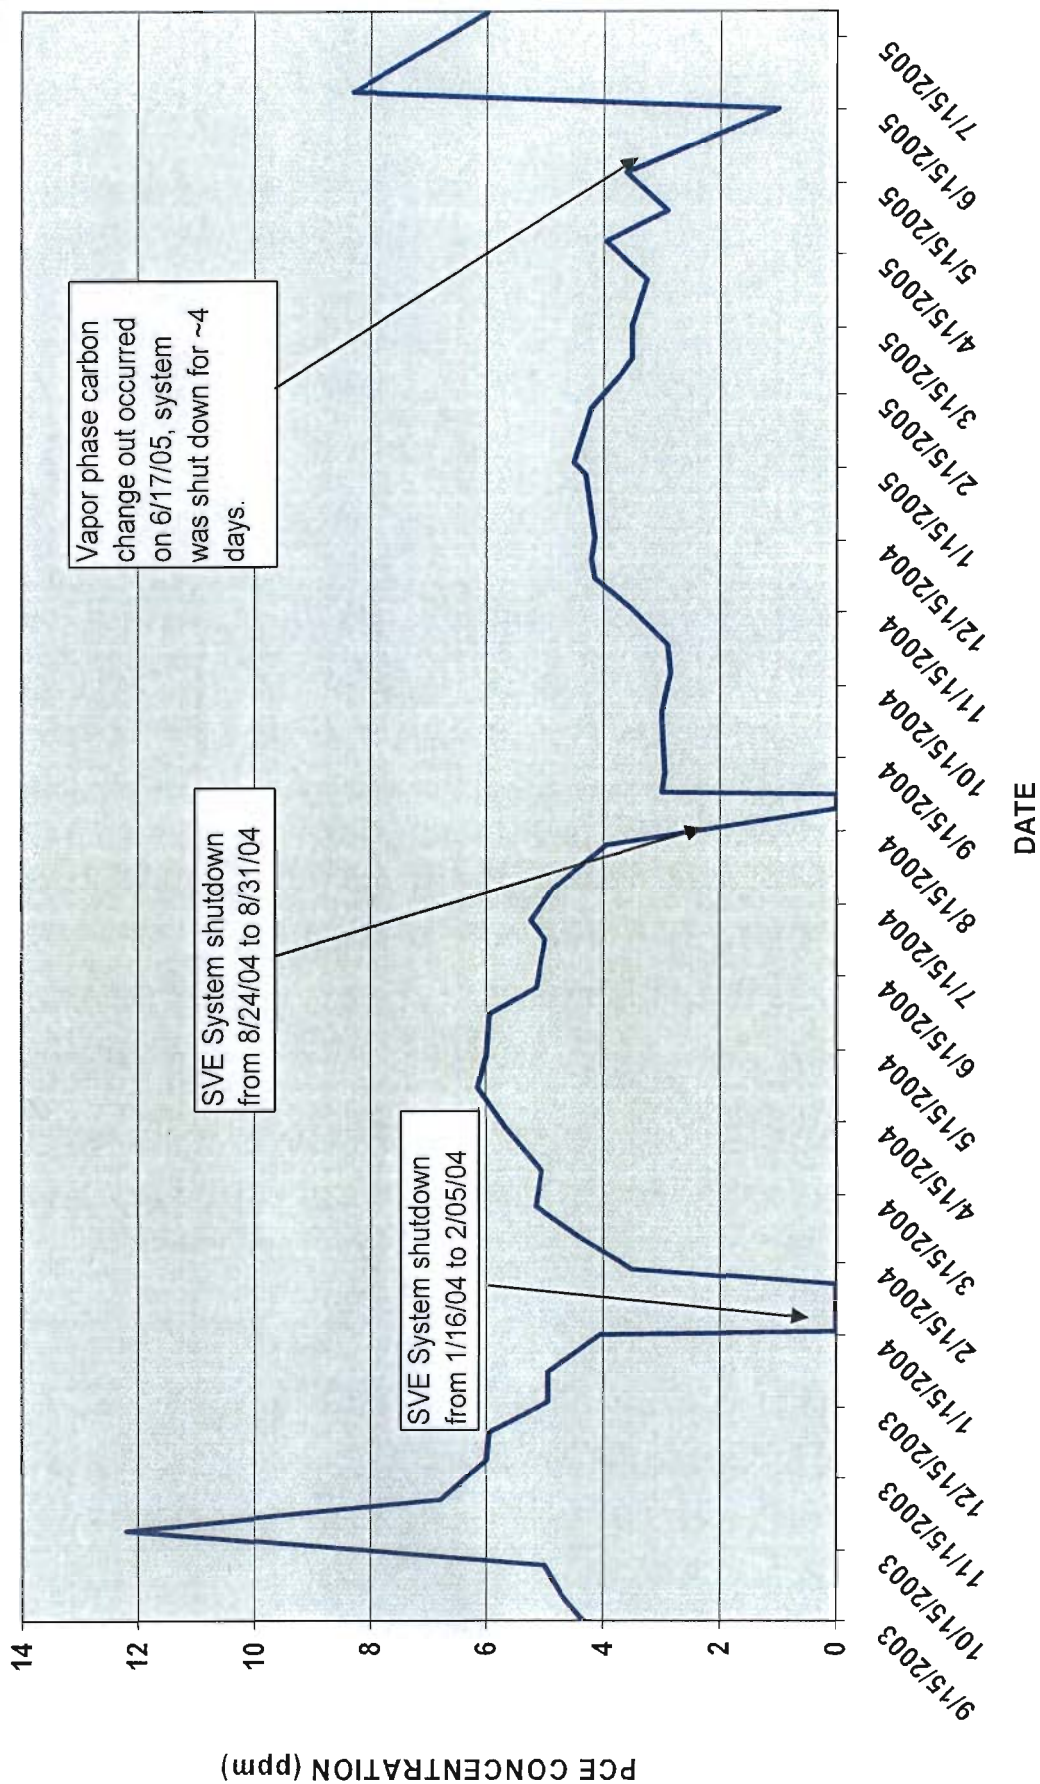

Appendix A

Daily Quality Control Reports (DQCRs)

DAILY QUALITY CONTROL REPORT

Site Name and Location: Stanton Cleaners Site (LTRA) – Great Neck, NY

Client: ECC

Contract No: 5442-001-001

Contractor: Earth Tech, Inc.

Address: 7870 Villa Park Drive, Suite 400
Richmond, Virginia 23228

Phone No.: (804) 515-8300

Date: 7/07/05

Earth Tech Project No.: 70536

Day	S	M	T	W	T	F	S
Weather					OVERCAST		
Temp.					72°		
Wind					STILL		
Humidity					75%		

Earth Tech Personnel On-Site: **Jim Kearns, Rob Derrick**

Subcontractor (include names & responsibilities): **N/A—REAC, ERT, Damian Duda**

On site for air sampling activities. ECC on site completing punch list.

Contract Materials and Equipment on site: **Ford Explorer, Chevy Blazer**

Work Performed (include sampling; list by NAS number if applicable):

Monthly gauging of monitoring wells

Weekly O&M Inspection

Quality Control Activities (including field calibrations):

Health and Safety Levels and Activities: **Level D**

Problems Encountered/Correction Action Taken: **N/A**

Explain Developments Leading to Change in SOW or Finding of Fact: **N/A**

Preparatory Inspection (list all inspections by subject and specification location; attach minutes of meeting and list of all attendees): **N/A**

Have all required submittals and samples of construction been approved? **Yes**

Do the materials and equipment to be used conform to the submittals? **Yes**

Has all preliminary work been inspected, tested, and completed? **Yes**

DAILY QUALITY CONTROL REPORT

Site Name and Location: Stanton Cleaners Site (LTRA) – Great Neck, NY

Client: ECC

Contract No: 5442-001-001

Contractor: Earth Tech, Inc.

Address: 7870 Villa Park Drive, Suite 400

Richmond, Virginia 23228

Phone No.: (804) 515-8300

Date: 7/07/05

Earth Tech Project No.: 70536

Test required and inspection techniques to be executed to prove contract compliance (include both expected and actual results): **N/A**

Has a phase hazard analysis been performed? **Included in the Site Specific Health & Safety Plan**

Comments and deficiencies noted and corrective actions taken: **Explained in work performed section.**

Initial Inspection: List all inspections by subject and specification location. Comment and/or deficiencies noted and corrective actions taken.

Explained in work performed section.

Follow-up Inspection: List all inspections by subject and specification location. Comment and/or deficiencies noted and corrective actions taken.

Special Notes: **Bi-weekly air monitoring not performed as ERT/REAC were performing air sampling activities.**

Tomorrow's Expectations:

Weekly O&M Inspection

By: James Kearns

Title: Environmental Scientist

Signature:

(Quality Control Representative/Manager)

The above report is complete and correct. All materials and equipment used and all work performed during this reporting period are in compliance with the contract specifications and submittals, except as noted above.

Signature:

(Contractor's Authorized Representative)

DAILY QUALITY CONTROL REPORT

Site Name and Location: Stanton Cleaners Site (LTRA) – Great Neck, NY

Client: ECC

Contract No: 5442-001-001

Contractor: Earth Tech, Inc.

Address: 7870 Villa Park Drive, Suite 400

Richmond, Virginia 23228

Phone No.: (804) 515-8300

Date: 7/25/05

Earth Tech Project No.: 70536

Day	S	M	T	W	T	F	S
Weather		CLOUDY					
Temp.		78°F					
Wind		LOW					
Humidity		71.5					

Earth Tech Personnel On-Site: **Jimmy Kearns, Rob Derrick, Frank Mahalski**

Subcontractor (include names & responsibilities): **N/A**

Contract Materials and Equipment on site: **Ford Explorer, Veloci-Calc, PID**

and general hand tools.

Work Performed (include sampling; list by NAS number if applicable): **Used PID&Veloci-Calc for air monitoring of sub-slabs(except D), AS, influent, SVE-EXT-4R**

Weekly O&M Inspection

Bi-weekly Air Monitoring

Quality Control Activities (including field calibrations): **Calibrated PID**

Health and Safety Levels and Activities: **Level D**

Problems Encountered/Correction Action Taken: **N/A**

Explain Developments Leading to Change in SOW or Finding of Fact: **N/A**

Preparatory Inspection (list all inspections by subject and specification location; attach minutes of meeting and list of all attendees): **N/A**

Have all required submittals and samples of construction been approved? **Yes**

Do the materials and equipment to be used conform to the submittals? **Yes**

DAILY QUALITY CONTROL REPORT	
Site Name and Location: Stanton Cleaners Site (LTRA) – Great Neck, NY	
Client: ECC	Contract No: 5442-001-001
Contractor: Earth Tech, Inc.	
Address: 7870 Villa Park Drive, Suite 400 Richmond, Virginia 23228	
Phone No.: (804) 515-8300	
Date: 7/25/05	Earth Tech Project No.: 70536
Has all preliminary work been inspected, tested, and completed? Yes	
Test required and inspection techniques to be executed to prove contract compliance (include both expected and actual results): N/A	
Has a phase hazard analysis been performed? Included in the Site Specific Health & Safety Plan	
Comments and deficiencies noted and corrective actions taken: Explained in work performed section.	
Initial Inspection: List all inspections by subject and specification location. Comment and/or deficiencies noted and corrective actions taken. Explained in work performed section.	
Follow-up Inspection: List all inspections by subject and specification location. Comment and/or deficiencies noted and corrective actions taken.	
Special Notes: Air monitoring not done for Sub-slab D (blocked by vehicle)	
Tomorrow's Expectations: Weekly O&M Inspection	
By: James Kearns Title: Environmental Scientist	
Signature: (Quality Control Representative/Manager)	
The above report is complete and correct. All materials and equipment used and all work performed during this reporting period are in compliance with the contract specifications and submittals, except as noted above.	
Signature: (Contractor's Authorized Representative)	

Appendix B

Groundwater Treatment System Operation & Maintenance Checklists

STANTON CLEANERS AREA GROUNDWATER CONTAMINATION SITE OPERATION AND MAINTENANCE

1. A. Is any part of the system leaking? YES ☒ NO

If so, list where. _____

- B. Is there water on the floor? YES ☒ NO

If so, list where. _____

- C. Are all three (3) floor sump level switches in place? ☒ YES NO

- D. Is there any evidence of water in any of these floor sumps? YES ☒ NO

Note: If water is present, remove with shop vac or paper towels.

2. A. Display screen on computer will either show system or screen saver. If screen saver is on, tap screen with finger to show screen. If only the desktop is showing with no system screen, click the *Lookout - (Stanton)* icon on the taskbar at the bottom of the screen.

- B. From the site display, monitor and record the following.

1. Recovery Well EPA-EXT-02 flow¹ _____ 19 _____ GPM
2. Recovery Well EPA-EXT-02 valve open _____ 100 _____ %
3. Recovery Well EPA-EXT-4R flow _____ 37 _____ GPM
4. Recovery Well EPA-EXT-4R valve open _____ 40 _____ %
5. Recovery Well EPA-EXT-04 flow _____ NA _____ GPM
6. Recovery Well EPA-EXT-04 valve open _____ NA _____ %
7. Recovery Well pH _____ 6.8 _____ pH
8. Recovery Well conductivity _____ 54 _____ cond
9. Air Stripper pH _____ 7.8 _____ pH
10. Air Stripper temperature _____ 156 _____ deg. F
11. Air Stripper air flow _____ 184 _____ CFM
12. Pre-vapor carbon pressure _____ 0 _____ "wc (inches of water)
13. Post carbon air flow _____ 1561 _____ CFM
14. Discharge conductivity _____ 117 _____ micromhos
15. Discharge pH _____ 8.1 _____ pH
16. Discharge flow _____ 67 _____ GPM

¹ Wells EPA-EXT-02 and MW-24 wells are manifolded together in the field and are piped into the treatment building together. The EPA-EXT-02 water flow meter is therefore actually displaying and totalizing the output of both wells.

17. Discharge total gallons _____ 100,299,583 _____ Gal

18. SVE inlet vacuum _____ 4 _____ "Hg

19. SVE air flow _____ 82 _____ CFM

C. From the treatment room, monitor and record the following.

1. Recovery Well EPA-EXT-02 total flow _____ 9,832,900 _____ Gal

2. Recovery Well EXT-04 total flow _____ NA _____ Gal

3. Recovery Well EPA-EXT-4R total flow _____ 5,741,100 _____ Gal

5. Recovery Well pH _____ 6.79 _____ Ph

6. Recovery Well conductivity _____ 0.57 _____ cond

7. Air Stripper pH _____ 7.85 _____ pH

8. Air Stripper temperature _____ 15.6 _____ deg. F

9. Air Stripper Pump water flow _____ 6.5 _____ GPM

10. Air Stripper Pump pressure _____ 44 _____ PSI

11. Discharge conductivity _____ 1.11 _____ cond

12. Discharge pH _____ 8.11 _____ pH

13. Discharge total gallons _____ 100,299,583 _____ Gal

14. SVE inlet vacuum (digital readout) _____ 4 _____ "Hg

15. SVE inlet vacuum _____ -4 _____ "Hg

16. SVE post knockout vacuum _____ -6 _____ "Hg

3. A. If time allows, check to see that the treatment system is cycling properly as described in STANTON CLEANERS AREA GROUNDWATER CONTAMINATION SITE O&M Manual.

Notes:

STANTON CLEANERS AREA GROUNDWATER CONTAMINATION SITE OPERATION AND MAINTENANCE

1. A. Is any part of the system leaking? YES ☒ NO

If so, list where. _____

- B. Is there water on the floor? ☒ YES NO

If so, list where. Vapor phase carbon vessels on pipes are sweating

- C. Are all three (3) floor sump level switches in place? ☒ YES NO

- D. Is there any evidence of water in any of these floor sumps? YES ☒ NO

Note: If water is present, remove with shop vac or paper towels.

2. A. Display screen on computer will either show system or screen saver. If screen saver is on, tap screen with finger to show screen. If only the desktop is showing with no system screen, click the *Lookout – (Stanton)* icon on the taskbar at the bottom of the screen.

- B. From the site display, monitor and record the following.

1. Recovery Well EPA-EXT-02 flow¹ _____ 19 _____ GPM
2. Recovery Well EPA-EXT-02 valve open _____ 100 _____ %
3. Recovery Well IW-01 flow _____ NA _____ GPM
4. Recovery Well IW-01 valve open _____ NA _____ %
5. Recovery Well EPA-EXT-04 flow _____ 38 _____ GPM
6. Recovery Well EPA-EXT-04 valve open _____ 40 _____ %
7. Recovery Well pH _____ 6.8 _____ pH
8. Recovery Well conductivity _____ 55 _____ cond
9. Air Stripper pH _____ 7.9 _____ pH
10. Air Stripper temperature _____ 156 _____ deg. F
11. Air Stripper air flow _____ 410 _____ CFM
12. Pre-vapor carbon pressure _____ .20 _____ "wc (inches of water)
13. Post carbon air flow _____ faulty valve _____ CFM
14. Discharge conductivity _____ 117 _____ micromhos
15. Discharge pH _____ 8.3 _____ pH
16. Discharge flow _____ 70 _____ GPM

¹ Wells EPA-EXT-02 and MW-24 wells are manifolded together in the field and are piped into the treatment building together. The EPA-EXT-02 water flow meter is therefore actually displaying and totalizing the output of both wells.

17. Discharge total gallons _____ 98,758,232 _____ Gal
18. SVE inlet vacuum _____ not working _____ "Hg
19. SVE air flow _____ 100 _____ CFM

C. From the treatment room, monitor and record the following.

1. Recovery Well EPA-EXT-02 total flow _____ 88,957,791 _____ Gal
2. Recovery Well EXT-04 total flow _____ cant read meter _____ Gal
3. Recovery Well EPA-EXT-03 total flow _____ NA _____ Gal
5. Recovery Well pH _____ 6.80 _____ pH
6. Air Stripper pH _____ 8.00 _____ pH
7. Air Stripper temperature _____ 15.6 _____ deg. F
8. Air Stripper Pump water flow _____ 65 _____ GPM
9. Air Stripper Pump pressure _____ 43 _____ PSI
10. Discharge conductivity _____ 1.11 _____ cond
11. Discharge pH _____ 8.35 _____
12. Discharge total gallons _____ 98,758,232 _____ Gal
13. SVE inlet vacuum (digital readout) _____ 2.2 _____ PSID
14. SVE post knockout vacuum _____ "Hg

3. A. If time allows, check to see that the treatment system is cycling properly as described in STANTON CLEANERS AREA GROUNDWATER CONTAMINATION SITE O&M Manual.

Notes:

Appendix C

Groundwater Treatment System Downloaded Operational Data

Stanton Cleaners Groundwater Contamination Site - July 2005 - Site Operation Data

	Recovery Well 1	Recovery Well 2	Recovery Well 3	Discharge	Discharge	Influent water	Influent conductivity	Effluent conductivity	Influent water	Air Stripper water	Discharge water	Total gallons discharged	Air Stripper Air Flow	Combined Discharge Air Flow	SVE Air Flow
	Flow (GPM)	Flow (GPM)	Flow (GPM)	Flow (GPM)	Flow (CFM)	Temperature (deg F)			pH	pH	pH				
7/1/2005 6:00	19	0	38	71	2601	157	55	120	6.8	7.9	8.2	9820273.3	428	2601	77
7/1/2005 6:00	19	0	36	71	2447	157	55	119	6.8	7.9	8.2	9821109.6	465	2447	82
7/1/2005 8:00	19	0	37	69	2509	157	56	120	6.8	7.9	8.2	9823148.3	476	2509	75
7/1/2005 12:00	19	0	36	70	2553	158	55	121	6.8	8	8.2	9824869.1	396	2553	71
7/1/2005 16:00	19	0	38	70	2396	158	55	122	6.8	8	8.2	98260210.6	457	2396	75
7/1/2005 20:00	19	0	37	69	2447	158	55	120	6.8	8	8.2	98274962.3	418	2447	71
7/2/2005 0:00	19	0	35	72	2341	158	55	120	6.8	7.9	8.2	98288935	445	2341	75
7/2/2005 4:00	19	0	38	73	2553	158	55	120	6.8	7.9	8.2	9830359.9	372	2553	77
7/2/2005 8:00	19	0	36	69	2298	157	56	120	6.8	7.9	8.2	98317695.7	342	2298	71
7/2/2005 12:00	19	0	38	68	2396	157	55	118	6.8	8	8.2	98332960.4	378	2396	85
7/2/2005 16:00	19	0	38	0	2394	157	55	119	6.8	8	8.2	98346528	315	2394	75
7/2/2005 20:00	19	0	40	68	2472	156	55	119	6.8	8	8.3	98361075.4	403	2472	74
7/3/2005 0:00	19	0	38	70	2447	156	55	118	6.8	7.9	8.2	98375438.4	396	2447	87
7/3/2005 4:00	19	0	35	72	2601	155	55	117	6.8	7.9	8.2	98389608.2	384	2601	77
7/3/2005 8:00	19	0	39	72	2544	156	55	117	6.8	7.9	8.2	98404167.6	444	2544	82
7/3/2005 12:00	19	0	38	69	2447	156	55	118	6.8	8	8.2	98418569	396	2447	75
7/3/2005 16:00	19	0	35	71	2505	156	55	118	6.8	8	8.2	98432874.1	387	2505	75
7/3/2005 20:00	19	0	36	72	2553	156	55	118	6.8	8	8.3	98447209.6	444	2553	81
7/4/2005 0:00	19	0	36	72	2748	155	55	117	6.8	8	8.2	98461553.1	432	2748	75
7/4/2005 4:00	19	0	35	70	2553	155	56	117	6.8	7.9	8.2	98475910.3	432	2553	78
7/4/2005 8:00	19	0	35	7	2691	156	55	117	6.8	7.9	8.2	98490223.8	435	2691	71
7/4/2005 12:00	19	0	36	69	2601	157	54	119	6.8	8	8.2	98504925.1	428	2601	85
7/4/2005 16:00	19	0	38	70	2507	156	55	118	6.8	8	8.3	98519281.5	406	2507	81
7/4/2005 20:00	19	0	37	69	2546	156	55	119	6.8	8	8.3	98533632	382	2546	75
7/5/2005 0:00	19	0	36	70	2553	156	55	118	6.8	7.9	8.2	98547995.6	420	2553	76
7/5/2005 4:00	19	0	36	72	2396	157	56	119	6.8	8	8.2	98562368.2	445	2396	77
7/5/2005 8:00	19	0	35	0	2447	157	55	119	6.8	7.9	8.2	98576844.7	438	2447	79
7/5/2005 12:00	19	0	39	72	2396	158	55	121	6.8	8	8.3	98591380.5	386	2396	75
7/5/2005 16:00	19	0	39	69	2507	158	55	121	6.8	8	8.3	98605725.1	430	2507	75
7/5/2005 20:00	19	0	36	71	2426	158	55	120	6.8	8	8.3	98620095	398	2426	76
7/6/2005 0:00	19	0	37	71	2548	158	55	120	6.8	7.9	8.3	98634273.3	406	2548	76
7/6/2005 4:00	19	0	37	70	2548	158	56	119	6.8	8	8.3	98648544.1	398	2548	70
7/6/2005 8:00	19	0	36	72	2553	158	55	120	6.8	8	8.3	98662921.1	387	2553	76
7/6/2005 12:00	19	0	39	69	2553	158	55	121	6.8	8	8.3	98677276.5	387	2553	80
7/6/2005 16:00	19	0	38	70	2331	158	54	122	6.8	8	8.3	98691639.8	277	2331	69
7/6/2005 20:00	19	0	36	70	2341	158	55	120	6.8	8	8.3	98705976.6	423	2341	75
7/7/2005 0:00	19	0	35	68	2447	157	55	119	6.8	8	8.3	98720312.8	377	2447	80
7/7/2005 4:00	19	0	38	69	2746	156	55	118	6.8	7.9	8.3	98734653.8	386	2746	82
7/7/2005 8:00	19	0	38	68	2601	156	55	117	6.8	7.9	8.3	98748997.2	418	2601	71
7/7/2005 12:00	19	0	37	71	2551	156	55	117	6.8	7.9	8.3	98763382.6	404	2551	70
7/7/2005 16:00	19	0	37	69	2748	157	55	118	6.8	7.9	8.3	98777820	353	2748	76
7/7/2005 20:00	19	0	39	73	2546	156	55	119	6.8	7.9	8.3	98792257.2	393	2546	82
7/8/2005 0:00	19	0	36	69	2553	157	55	118	6.8	7.9	8.3	98806647.4	414	2553	82
7/8/2005 4:00	19	0	36	72	2544	156	55	117	6.8	7.9	8.3	98821053.7	407	2544	74
7/8/2005 8:00	19	0	36	68	2551	156	54	116	6.8	7.9	8.3	98835482.3	390	2551	82
7/8/2005 12:00	19	0	40	69	2553	156	55	117	6.8	7.9	8.3	98850011.5	330	2553	78
7/8/2005 16:00	19	0	36	68	2341	156	56	117	6.8	7.9	8.3	98864684.6	215	2341	76
7/8/2005 20:00	19	0	38	70	2498	156	54	117	6.8	7.9	8.3	98879326.2	377	2498	77
7/9/2005 0:00	19	0	39	9	2500	155	55	116	6.8	7.9	8.2	98894000.3	356	2500	71
7/9/2005 4:00	19	0	37	72	2601	156	55	117	6.8	7.9	8.2	989086976.4	340	2601	82
7/9/2005 8:00	19	0	36	71	2746	157	55	118	6.8	7.9	8.2	98923326.2	367	2746	79
7/9/2005 12:00	19	0	37	69	2741	157	55	119	6.8	8	8.2	98938012.2	422	2741	75
7/9/2005 16:00	19	0	39	68	2447	156	56	118	6.8	8	8.3	98952618.3	363	2447	76
7/9/2005 20:00	19	0	36	0	2505	157	55	119	6.8	8	8.3	98967369.8	371	2505	75
7/10/2005 0:00	19	0	36	69	2544	156	55	118	6.8	7.9	8.2	98982077.4	423	2544	76
7/10/2005 4:00	19	0	37	0	2541	156	55	117	6.8	7.9	8.2	989968119.3	413	2541	83
7/10/2005 8:00	19	0	36	71	2256	156	55	118	6.8	7.9	8.2	99011529.3	480	2256	76
7/10/2005 12:00	19	0	36	72	2502	157	55	118	6.8	8	8.2	99026330	387	2502	81
7/10/2005 16:00	19	0	36	69	2447	157	56	119	6.8	8	8.3	99041079.8	372	2447	81
7/10/2005 20:00	19	0	39	73	2509	157	55	119	6.8	8	8.3	99055774.9	366	2509	75
7/11/2005 0:00	19	0	38	0	2544	156	55	117	6.8	7.9	8.2	99070494.3	361	2544	75
7/11/2005 4:00	19	0	41	72	2553	156	55	117	6.8	7.9	8.2	99085244.7	353	2553	86
7/11/2005 8:00	19	0	37	69	2447	156	55	118	6.8	7.9	8.2	990999576.4	392	2447	76
7/11/2005 12:00	19	0	36	72	2396	158	56	120	6.8	8	8.2	99114681.4	432	2396	75
7/11/2005 16:00	19	0	37	71	2509	159	55	122	6.8	8	8.2	99129373.3	396	2509	74
7/11/2005 20:00	19	0	37	69	2396	158	55	122	6.8	8	8.2	99144066.4	383	2396	74
7/12/2005 0:00	19	0	37	68	2544	158	55	121	6.8	8	8.2	99158776	378	2544	75
7/12/2005 4:00	19	0	40	69	2502	158	55	120	6.8	7.9	8.2	99173442.3	378	2502	79
7/12/2005 8:00	19	0	38	72	2449	158	55	120	6.8	7.9	8.2	99188124.4	409	2449	75

7162003 0:00	19	0	35	1	2396	158	55	129	0.8	8	8.2	9953486.5	387	2396	75
7162003 12:00	19	0	36	69	2340	159	55	121	0.8	8	8.2	99538844.6	367	2340	74
7162003 16:00	19	0	36	68	2396	159	55	122	0.8	8	8.2	99555407	149	2396	79
7162003 20:00	19	0	36	68	2508	158	55	122	0.8	8	8.2	99567940.5	357	2508	76
7172003 0:00	19	0	36	0	2183	158	55	121	0.8	8	8.2	99582204.7	316	2183	70
7172003 4:00	19	0	37	69	2362	158	55	121	0.8	8	8.2	99596539.4	346	2362	75
7172003 8:00	19	0	37	72	3227	158	54	121	0.8	8	8.2	99611003.6	331	3227	71
7172003 12:00	19	0	39	68	2396	159	55	121	0.8	8	8.2	99625413.1	386	2396	75
7172003 16:00	19	0	35	68	2507	159	55	122	0.8	8	8.2	99639946.5	333	2507	69
7172003 20:00	19	0	37	0	2447	159	55	122	0.8	8	8.2	99643004.4	354	2447	69
7182003 0:00	19	0	39	0	2157	159	55	121	0.8	8	8.2	99668955.3	357	2157	86
7182003 4:00	19	0	38	69	2362	159	55	122	0.8	8	8.2	99681704.6	298	2362	75
7182003 8:00	19	0	38	68	2141	159	55	122	0.8	7.9	8.2	99697652.6	325	2141	73
7182003 12:00	19	0	36	72	2254	160	56	124	0.8	7.9	8.2	99712112.7	321	2254	73
7182003 16:00	19	0	39	70	2183	160	56	123	0.8	8	8.2	99716649.7	308	2183	74
7182003 20:00	19	0	37	70	2183	159	55	123	0.8	8	8.2	99741120.4	340	2183	76
7192003 0:00	19	0	36	68	2301	159	56	122	0.8	7.9	8.2	99755566.9	302	2300	76
7192003 4:00	19	0	37	67	2100	159	55	122	0.8	7.9	8.2	99770002.8	337	2100	75
7192003 8:00	19	0	35	71	2254	160	56	123	0.8	7.9	8.1	99784439.2	264	2254	75
7192003 12:00	19	0	36	70	2178	160	56	124	0.8	8	8.2	9979887.4	281	2178	69
7192003 16:00	19	0	36	69	2100	160	55	124	0.8	8	8.2	99813223.4	331	2100	80
7192003 20:00	19	0	37	67	2394	159	55	122	0.8	8	8.2	99827751.9	341	2394	72
7202003 0:00	19	0	36	68	2100	159	56	122	0.8	7.9	8.2	99842163.8	295	2100	75
7202003 4:00	19	0	36	71	2302	159	55	122	0.8	7.9	8.2	99856566.3	352	2302	75
7202003 8:00	19	0	39	67	2178	158	55	121	0.8	7.9	8.2	99870855.2	269	2178	77
7202003 12:00	19	0	38	68	2038	158	55	120	0.8	8	8.2	99885310	317	2038	74
7202003 16:00	19	0	37	67	2134	158	55	121	0.8	8	8.2	99899672.1	302	2134	75
7202003 20:00	19	0	38	68	2394	157	56	120	0.8	8	8.2	99914056.8	310	2394	64
7212003 0:00	19	0	37	67	2254	157	55	119	0.8	7.9	8.2	99928453.9	351	2254	75
7212003 4:00	19	0	37	69	2155	157	55	119	0.8	7.9	8.2	99942839.9	302	2155	75
7212003 8:00	19	0	37	0	2183	157	55	118	0.8	7.9	8.2	99957317	354	2183	76
7212003 12:00	19	0	38	70	2254	157	55	119	0.8	8	8.2	99971787.5	376	2254	69
7212003 16:00	19	0	37	67	2183	157	56	120	0.8	8	8.2	99986121.1	338	2183	68
7212003 20:00	19	0	35	67	2183	158	55	121	0.8	8	8.2	10000390.8	308	2183	74
7222003 0:00	19	0	36	69	2254	158	55	120	0.8	7.9	8.2	10004734.6	288	2254	70
7222003 4:00	19	0	38	69	2155	157	56	119	0.8	7.9	8.2	100029104.1	302	2155	75
7222003 8:00	19	0	36	68	2104	158	55	120	0.8	7.9	8.1	100044347.8.6	308	2104	76
7222003 12:00	19	0	37	8	2178	157	55	119	0.8	8	8.2	100058063.3	359	2178	70
7222003 16:00	19	0	36	68	2180	158	55	121	0.8	8	8.2	100072301.6	346	2180	74
7222003 20:00	19	0	39	67	2183	158	55	120	0.8	8	8.2	100086796.9	322	2183	74
7232003 0:00	19	0	37	68	2100	158	55	120	0.8	7.9	8.2	100101052.8	297	2100	74
7232003 4:00	19	0	35	0	2173	157	55	119	0.8	7.9	8.2	100115427.6	292	2173	75
7232003 8:00	19	0	37	71	2035	157	54	118	0.8	7.9	8.2	100129924	280	2035	75
7232003 12:00	19	0	39	71	1727	156	55	118	0.8	8	8.2	100144210.5	252	1727	75
7232003 16:00	19	0	36	69	1810	156	55	117	0.8	8	8.2	100158401.1	199	1803	70
7232003 20:00	19	0	39	67	1693	156	55	119	0.8	7.9	8.2	100173033.2	215	1693	69
7242003 0:00	19	0	36	69	1686	156	55	116	0.8	7.9	8.2	100187299.4	190	1686	75
7242003 4:00	19	0	38	0	1302	155	55	116	0.8	7.9	8.1	100201596.9	139	1302	77
7242003 8:00	19	0	39	67	1686	156	55	117	0.8	7.9	8.1	100216126.7	174	1686	82
7242003 12:00	19	0	37	67	1354	156	55	117	0.8	7.9	8.1	100230426.3	181	1354	80

7/24/2005 16:00	19	0	37	68	502	156	55	118	0.0	7.9	8.1	10024870	138	1302	77
7/24/2005 20:00	19	0	38	66	734	157	55	118	0.0	7.8	8.1	10025927.6	144	1354	75
7/25/2005 0:00	19	0	36	7	1410	156	55	117	0.0	7.8	8.1	10027380.2	144	1410	87
7/25/2005 4:00	19	0	35	68	1555	156	55	116	0.0	7.8	8.1	100288108.9	154	1555	82
7/25/2005 8:00	19	0	36	66	1412	157	54	118	0.0	7.8	8.1	100302782.5	146	1412	75
7/25/2005 12:00	19	0	37	68	1313	157	55	119	0.0	7.8	8.1	100316848.8	154	1313	71
7/25/2005 16:00	19	0	38	69	1318	158	55	121	0.0	7.8	8.1	100331242.9	161	1318	69
7/25/2005 20:00	19	0	37	67	1285	158	55	120	0.0	7.7	8.1	100345819	145	1285	71
7/26/2005 0:00	19	0	39	68	1207	158	55	120	0.0	7.7	8	100360409	144	1207	75
7/26/2005 4:00	19	0	38	68	1342	157	54	119	0.0	7.7	8	100374867.1	188	1342	75
7/26/2005 8:00	19	0	37	72	1352	158	55	120	0.0	7.7	8	100389346.7	135	1352	72
7/26/2005 12:00	19	0	36	68	1285	157	55	119	0.0	7.7	8	100403855.6	114	1285	80
7/26/2005 16:00	19	0	37	0	1320	159	56	124	0.0	7.7	8	100417719.3	184	1320	70
7/26/2005 20:00	19	0	36	67	1289	158	56	121	0.0	7.7	8	100432182.9	170	1289	70
7/27/2005 0:00	19	0	37	67	1256	158	56	121	0.0	7.7	8	100446632.5	149	1256	75
7/27/2005 4:00	19	0	36	0	1147	158	55	120	0.0	7.7	8	100460950.7	148	1147	77
7/27/2005 8:00	19	0	36	70	1315	158	55	121	0.0	7.6	8	100475309.8	151	1315	75
7/27/2005 12:00	19	0	38	66	1143	159	55	122	0.0	7.6	8	100489780.6	135	1143	70
7/27/2005 16:00	19	0	39	67	1143	159	56	123	0.0	7.6	8	100504259.5	169	1143	74
7/27/2005 20:00	19	0	36	70	1147	157	55	119	0.0	7.6	8	100518817.8	127	1147	71
7/28/2005 0:00	19	0	37	68	1313	156	54	119	0.0	7.6	8	100533861.8	166	1313	86
7/28/2005 4:00	19	0	36	69	1311	156	55	118	0.0	7.6	7.9	100547304.8	165	1311	75
7/28/2005 8:00	19	0	36	71	1308	156	55	117	0.0	7.6	7.9	100561783.2	148	1308	75
7/28/2005 12:00	0	0	0	0	18	156	55	121	0.0	7.6	7.9	100576381.8	44	18	24
7/28/2005 16:00	19	0	37	0	1313	156	55	118	0.0	7.6	7.9	100590347.7	114	1313	73
7/28/2005 20:00	19	0	38	67	1138	156	56	117	0.0	7.6	7.9	100604889.5	114	1138	82
7/29/2005 0:00	19	0	36	66	1138	156	55	117	0.0	7.6	7.9	100619201.5	141	1138	77
7/29/2005 4:00	20	0	36	69	1256	156	55	117	0.0	7.6	7.9	100633648.7	145	1256	76
7/29/2005 8:00	19	0	37	69	1147	156	54	117	0.0	7.5	7.9	100648048.3	117	1147	70
7/29/2005 12:00	19	0	37	66	1065	156	55	119	0.0	7.5	7.9	1006625280.3	135	1065	77
7/29/2005 16:00	19	0	36	67	1062	157	55	119	0.0	7.5	7.9	100676950.3	127	1062	72
7/29/2005 20:00	19	0	38	68	1138	157	55	119	0.0	7.5	7.9	100691445.7	103	1138	75
7/30/2005 0:00	19	0	39	69	1311	157	55	119	0.0	7.5	7.9	100705930.8	79	1311	77
7/30/2005 4:00	19	0	40	0	1138	157	55	119	0.0	7.5	7.9	100720401.8	124	1138	82
7/30/2005 8:00	19	0	37	67	1138	157	55	118	0.0	7.5	7.9	100734821.3	123	1138	76
7/30/2005 12:00	19	0	36	70	1094	157	55	118	0.0	7.5	7.9	100749306.3	113	1094	82
7/30/2005 16:00	19	0	37	67	991	157	56	119	0.0	7.5	7.9	100763766	161	991	80
7/30/2005 20:00	19	0	38	66	1104	156	55	118	0.0	7.5	7.9	100778286	134	1104	76
7/31/2005 0:00	19	0	36	0	1062	156	54	118	0.0	7.5	7.9	100792804.3	109	1062	72
7/31/2005 4:00	19	0	35	66	1147	156	55	117	0.0	7.5	7.8	100807333.6	117	1147	82
7/31/2005 8:00	19	0	36	65	1062	157	55	118	0.0	7.5	7.8	100821880.5	128	1062	69
7/31/2005 12:00	19	0	37	65	1104	157	55	119	0.0	7.5	7.9	100836399.1	127	1104	76
7/31/2005 16:00	19	0	36	65	1138	157	55	118	0.0	7.5	7.8	100850827.4	87	1138	78
7/31/2005 20:00	19	0	36	67	1138	156	55	117	0.0	7.5	7.8	100865266.4	100	1138	76

Appendix D
Sampling Trip Reports

SAMPLING TRIP REPORT

Site Name: STANTON CLEANERS AREA GROUNDWATER CONTAMINATION SITE **CERCLIS ID Number:** NYD047650197 **Sampling Dates:** July 12, 2005 **CLP Case Number:** N/A **Site Location:** 110 Cutter Mill Road, Great Neck, New York, 11021 **Sample Descriptions:** Groundwater Treatment System Influent / Effluent.

Laboratories Receiving Samples (Table 1):

Case Number	Sample Type	Name and Address of Laboratory
N/A	TCL-VOAs OLC03.2	USEPA Region II (USEPA) Building 209 MS-230 2890 Woodbridge Avenue Edison, N.J. 08837

Sample Dispatch Data (Table 2):

On July 12, 2005, six (6) groundwater samples, including one (1) duplicate sample and one (1) trip blank were shipped to the U.S. Environmental Protection Agency Region II Lab (USEPA) for TCL-VOAs analysis.

FedEx Airbill No.	Number of Coolers	Number and Type of Samples	Time and Date of Shipping
851611551538	1	6 Aqueous Samples including 1 duplicate sample, and 1 Trip Blank for TCL-VOAs.	7/12/04 @ 11:00 TO: USEPA

Sampling Personnel (Table 3):

Name	Organization	Site Duties
Tom Williams	Earth Tech, Inc.	Task Manager
John Huisman	Earth Tech, Inc.	Health & Safety/Sampler
Robert Derrick	Earth Tech, Inc.	Sampling Assistant
Todd Nash	Earth Tech, Inc.	Sampling Assistant

Sample Numbers and Collection Points (Table 4):

Laboratory	Analyses	Sample Type	CLP Sample #	Sample Collection Point(SCP)
USEPA	TCL- VOAs	Aqueous Groundwater	EPA-EXT-02	EPA-EXT-02
			EPA-EXT-4R	EPA-EXT-4R
			INFLUENT	Influent
			EFFLUENT	Effluent
			TB	Trip Blank
			EFFLUENT-A	Duplicate of Effluent

Additional Comments:

All groundwater samples were collected after a five gallon purge from the sample ports located within the treatment system. Volumes were collected from the influent (INFLUENT), effluent (EFFLUENT), extraction wells EPA-EXT-02 and EPA-EXT-4R, of the treatment system for the following analysis: Target Compound List (TCL) Volatile Organic Compounds. In addition, one duplicate sample (EFFLUENT-A) was collected from the effluent of the groundwater treatment process and was a duplicate sample of sample EFFLUENT. One trip blank (TB) was also included in the shipment. Copies of the Chain of Custody forms and a copy of the FedEx airbill are included in Appendix A and B, respectively.

Earth Tech personnel also collected real time water quality parameters from the raw water for all the sampling locations (Influent, Effluent, EPA-EXT-02 and EPA-EXT-4R) and the results are included in Appendix C.

Appendix A
Chain of Custody (July 12, 2005 System Sampling Event)

EPA USEPA Contract Laboratory Program
Organic Traffic Report & Chain of Custody Record

Case No:

DAS No:

R

ID: 2 Contract Code: LIS ID: NYD047650197 Name/State: Stanton Cleaners Site/NY Contact Leader: James Kearns Operations and Maintenance Shipping Co: Earth Tech, Inc.	Date Shipped: 7/12/2005 Carrier Name: FedEx Airbill: 851611551538 Shipped to: USEPA REGION II DESA LAB Building 209 MS 230 2890 Woodbridge Avenue Edison NJ 08837 (732) 906-6886	Chain of Custody Record Relinquished By (Date / Time) 1 <i>James Kearns</i> 7/12/05 11:00 2 3 4	Sampler Signature: <i>James Kearns</i> Received By (Date / Time)
--	---	---	---

UNIC FILE No.	MATRIX/ SAMPLER	CONC/ TYPE	ANALYSIS/ TURNAROUND	TAG No./ PRESERVATIVE/ Bottles	STATION LOCATION	SAMPLE COLLECT DATE/TIME		INORGANIC SAMPLE No.	QC Type
ENT	Ground Water/ James Kearns	L/G	VOA (14)	(HCL) (3)	Effluent	S: 7/12/2005	9:25		--
ENT-A	Ground Water/ James Kearns	L/G	VOA (14)	(HCL) (3)	Effluent-A	S: 7/12/2005	9:30		Field Duplicate
ET-02	Ground Water/ James Kearns	L/G	VOA (14)	(HCL) (3)	EPA-EXT-02	S: 7/12/2005	9:02		--
ET-4R	Ground Water/ James Kearns	L/G	VOA (14)	(HCL) (3)	EPA-EXT-4R	S: 7/12/2005	9:10		--
ENT	Ground Water/ James Kearns	L/G	VOA (14)	(HCL) (3)	Influent	S: 7/12/2005	9:15		--
	Ground Water/ James Kearns	L/G	VOA (14)	(HCL) (3)	TB	S: 7/12/2005	8:00		Trip Blank

Use for Case Sample ID: N	Sample(s) to be used for laboratory QC: EFFLUENT-A, TB	Additional Sampler Signature(s):	Chain of Custody Seal Number:
Key: CLP TCL Volatiles	Concentration: L = Low, M = Low/Medium, H = High	Type/Designate: Composite = C, Grab = G	Shipment Iced?

Number: **2-525300610-071205-0001**

less preliminary results. Requests for preliminary results will increase analytical costs.

Copy to Sample Management Office, 2000 Edmund Halley Dr., Reston, VA 20191-3400 Phone 703/264-9348 Fax 703/264-9222



**USEPA Contract Laboratory Program
Organic Traffic Report & Chain of Custody Record**

Case No:
DAS No:
SDG No:

L

pped: 7/12/2005 lame: FedEx 851611551538 to: USEPA REGION II DESA LAB Building 209 MS 230 2890 Woodbridge Avenue Edison NJ 08837 (732) 906-6886	Chain of Custody Record		Sampler Signature: <i>[Signature]</i>	For Lab Use Only Lab Contract No: _____ Unit Price: _____ Transfer To: _____ Lab Contract No: _____ Unit Price: _____	
	Relinquished By	(Date / Time)	Received By		(Date / Time)
	1 <i>James Kearns</i>	7/12/05 11:00			
	2				
	3				
4					

ANALYTICAL No.	MATRIX/ SAMPLER	CONC/ TYPE	ANALYSIS/ TURNAROUND	TAG No./ PRESERVATIVE/ Bottles	STATION LOCATION	SAMPLE COLLECT DATE/TIME	INORGANIC SAMPLE No.	FOR LAB USE ONLY Sample Condition On Receipt
JENT	Ground Water/ James Kearns	L/G	VOA (14)	(HCL) (3)	Effluent	S: 7/12/2005 9:25		
JENT-A	Ground Water/ James Kearns	L/G	VOA (14)	(HCL) (3)	Effluent-A	S: 7/12/2005 9:30		
EXT-02	Ground Water/ James Kearns	L/G	VOA (14)	(HCL) (3)	EPA-EXT-02	S: 7/12/2005 9:02		
EXT-4R	Ground Water/ James Kearns	L/G	VOA (14)	(HCL) (3)	EPA-EXT-4R	S: 7/12/2005 9:10		
ENT	Ground Water/ James Kearns	L/G	VOA (14)	(HCL) (3)	Influent	S: 7/12/2005 9:15		
	Ground Water/ James Kearns	L/G	VOA (14)	(HCL) (3)	TB	S: 7/12/2005 8:00		

or Case N	Sample(s) to be used for laboratory QC: EFFLUENT-A, TB	Additional Sampler Signature(s):	Cooler Temperature Upon Receipt:	Chain of Custody Seal Number:
Key:	Concentration: L = Low, M = Low/Medium, H = High	Type/Designate: Composite = C, Grab = G	Custody Seal Intact? ☐	Shipment Iced? ☐

PLP TCL Volatiles

umber: 2-525300610-071205-0001

s preliminary results. Requests for preliminary results will increase analytical costs.

to Sample Management Office, 2000 Edmund Halley Dr., Reston, VA, 20191-3400 Phone 703/264-9348 Fax 703/264-9222

RECEIVED COPY

Appendix B
FedEx Airbill (July 12, 2005 System Sampling Event)



US Air Mail

FE 851611551538

10/27/05

0200

24X13X15

1 From **Sender's Name**
Date **7-12-05** **Sender's FedEx Account Number** **2374-42578**
Sender's Name **James Kearns** **Company** **Earth Tech, Inc**
Address **277 Kuth Avenue**
City **Franklin Square** **State** **NY** **Zip** **11010**

2 Your Internal Billing Reference
FedEx Number or Internal Code

3 To **Recipient's Name** **Simple Custodian** **Company** **USEPA Region II Perm Lab**
Recipient's Address **Building 209 MS 240**
Address **2840 Woodbridge Avenue**
City **Edison** **State** **NJ** **Zip** **08837**

4a Express Package Service

Packages up to 150 lbs.

☒ FedEx Priority Overnight®
☐ FedEx Standard Overnight®
☐ FedEx First Overnight®

FedEx 2Day®

FedEx Express Saver®

4b Express Freight Service

Packages over 150 lbs.

FedEx 1Day Freight®

FedEx 2Day Freight®

FedEx 3Day Freight®

*E&T is not available

**Weight is limited to 200

5 Packaging

FedEx Envelope®

FedEx Pak®

FedEx Box®

FedEx Tube

Other ☒

6 Special Handling

SATURDAY Delivery

HOLD Workday

HOLD Saturday

FedEx Home Delivery®

FedEx Location

FedEx Location

FedEx Home Delivery®

FedEx Location

FedEx Location

Does this shipment contain dangerous goods?

No

Yes

Yes

Yes

Yes

Yes

Yes

Yes

Yes

Yes

Yes

7 Payment Bill to:

Enter FedEx Acct. No. on Credit Card No. below

Request

Credit Card

Cash/Check

Total Packages

Total Weight

Total Declared Value

1

24

\$ 100

8 Sign to Authorize Delivery Without a Signature

By signing this authorization, you agree that the carrier is authorized to deliver the shipment without a signature and to return the shipment to the sender if no one is available to receive it.

467

Questions? Visit our Web site at fedex.com
1-800-368-6388

Appendix C
Water Quality Parameters (July 12, 2005 System Sampling Event)

STANTON CLEANERS SITE LTRA

Groundwater Pump and Treatment System Water Quality Parameters Log

Date: 7/12/05
Project # 70536

	pH	COND	TURB	DO	TEMP	SALINITY
EPA-EXT-02	6.43	0.693	0	11.5	17.7	1
EPA-EXT-4R	6.88	0.510	0	11.8	16.9	1
Discharge	7.34	0.556	0	10.7	19.2	1

Total Gallons pumped: 99,190,022 gallons

Flow rate: 70 gpm

Equipment Calibrated by: James Kearns

Comments: EPA-EXT-04 and EPA-EXT-4R were operating

Water samples collected by: James Kearns

Water monitoring performed by: James Kearns/Robert Derrick/ Todd Nash

TEMP. - Temperature measured in degrees Fahrenheit.

COND. - Conductivity measured in milliSiemens per centimeter (mS/cm).

TURB. - Turbidity measure in nephelometric turbidity units (NTU).

DO - Dissolved Oxygen measured in milligrams per liter (mg/L).

SALINITY - Salinity in percentage.

SAMPLING TRIP REPORT

Site Name: STANTON CLEANERS AREA GROUNDWATER CONTAMINATION SITE

CERCLIS ID Number: NYD047650197

Sampling Dates: July 26-27, 2005

CLP Case Number: N/A

Site Location: 110 Cutter Mill Road, Great Neck, New York, 11021

Sample Descriptions: Semi-Annual 24-hour Indoor Air Sampling

Sample Procedures: Nine air samples were collected for analysis of volatile organic compounds (VOCs) Via EPA method TO-15. Sampling was performed following guidelines in the modified U.S. EPA Method TO-15, *Determination of VOCs in Ambient Air using Summa® Passivated Canister Sampling and Gas Chromatographic Analysis*. At the end of the sampling period, the canister valve was closed/ capped, and the sampling times and final canister pressures were recorded on the identification tag that had been attached to the Summa® canisters prior to sampling. Sample documentation was completed and chains of custody records were prepared.

Laboratories Receiving Samples:

Case Number	Sample Type	Name and Address of Laboratory
N/A	EPA-TO-15	Data Chem Laboratories (DCL) 960 W. Levoy Drive Salt Lake City, Utah 84123

Sample Dispatch Data:

On July 27, 2005, nine Summa® Canister air samples (including two duplicate samples and three outdoor air samples) were shipped to Data Chem Laboratories (DCL) in Salt Lake City, UT for analysis via EPA method TO-15. Indoor air samples were collected at the Long Island Hebrew Academy, Silvertstein Hebrew Academy, and the Stanton Cleaners Area Groundwater Contamination Site Remediation Plant.

FedEx Airbill No.	Number of Boxes	Number and Type of Samples	Time and Date of Shipping
851611551571 851611551582	2	9 Air samples, including 1 duplicate sample, for analysis EPA Method TO-15.	07/27/05 @ 14:00 TO: DCL

Sampling Personnel:

Name	Organization	Site Duties
Tom Williams	Earth Tech, Inc.	Project Manager
James Kearns	Earth Tech, Inc.	Task Manager/Health & Safety/Sampler

Frank Mahalski	Earth Tech, Inc.	Sampler
Robert Derrick	Earth Tech, Inc.	Sampler

Sample Numbers and Collection Points:

Appendix A includes a table with a list of all Summa® Canister collection points and their assigned sample numbers. The Chain of Custody Forms and the Analytical Request Form are included in Appendix B. The FedEx Airbills are included in Appendix C. Appendix D contains a map that depicts the locations of the samples collected during this event.

Additional Comments:

Eight of the nine SUMMA Canister samples collected and submitted to the laboratory were collected over a 24-hour period from July 26 to July 27, 2005. One sample, LIHA-Basement A (initially intended to be a duplicate sample of LIHA-Basement), collected at the Long Island Hebrew Academy was observed to be complete at 14:30 p.m. on July 26, 2005, with an estimated total sampling duration of 5 hours and 18 minutes. Although the sample will not be representative of a 24 hour period, it was determined that the data obtained from this short sampling duration may be of use. Therefore, the sample was included in the sample shipment to Data Chem Laboratories and will be analyzed. All nine air samples were requested to be analyzed for volatile organic compounds via EPA Method TO-15.

One duplicate sample was collected during this event. Sample SHA-Ground Floor A is a duplicate sample of SHA-Ground Floor.

.

Appendix A

Table Containing Sample Numbers and Collection Points

Stanton Cleaners Groundwater Contamination Site
Indoor Air Quality Sampling (Summa Canister)
July 2005

Sample ID	Analytical Method	Location	Start Date / Time	End Date / Time	Total Time	Initial and Final Pressure	Summa Number	Valve Number
LIHA-Roof Top	EPA-TO-15	LIHA Roof Top	7/26/05 9:08 a.m.	7/27/05 8:30 a.m.	23 hrs 22 min	Initial: 29" Hg Final: 4" Hg	108861	108556
LIHA-Basement	EPA-TO-15	LIHA-Basement	7/26/05 9:13 a.m.	7/27/05 9:11a.m.	23 hrs 58 min	Initial: 30" Hg Final: 0.1" Hg	108019	108947
LIHA-Basement A	EPA-TO-15	LIHA Basement Duplicate	7/26/05 9:12 a.m.	7/26/05 2:30p.m.	5 hrs 18 min	Initial: 30" Hg Final: 0" Hg	108890	108827
SHA-Parking Lot S wind 0-5mph	EPA-TO-15	SHA Parking Lot (Ambient, ~5ft. Off ground, Stanton Cleaners Side of Building)	7/26/05 7:50 a.m.	7/27/05 9:00 a.m.	25 hrs 10 min	Initial: 30" Hg Final: 13" Hg	108980	108877
Stanton-Parking Lot	EPA-TO-15	Stanton Parking Lot (Ambient, ~5ft. Off ground, Stanton Cleaners Side of Building)	7/26/05 7:36 a.m.	7/27/05 7:19 a.m.	23 hrs 43 min	Initial: 32" Hg Final: 3" Hg	108814	108990
SHA-Ground Floor*	EPA-TO-15	SHA Ground Floor	7/26/05 11:50 a.m.	7/27/05 11:44 a.m.	23 hrs 54 min	Initial: 30" Hg Final: 2" Hg	108680	108619
SHA-Ground Floor A*	EPA-TO-15	SHA Ground Floor (Duplicate)	7/26/05 11:49 a.m.	7/27/05 11:45 a.m.	23 hrs 56 min	Initial: 30" Hg Final: 1" Hg	108856	108616
Stanton Treatment Building 2nd Floor	EPA-TO-15	Stanton EPA Treatment Building- 2nd Floor	7/26/05 7:44 a.m.	7/27/05 7:21 a.m.	23 hrs 37 min	Initial: 32" Hg Final: 1.5" Hg	107007	108944
Stanton Treatment Building Catwalk	EPA-TO-15	EPA Treatment Building (Catwalk)	7/26/05 7:40 a.m.	7/27/05 7:21 a.m.	23 hrs 41 min	Initial: 30" Hg Final: 0.5" Hg	108689	108557

Notes: LIHA - Long Island Hebrew Academy
SHA - Sonia & Max Silverstein Hebrew Academy
*Classroom 102 on South side of building

Appendix B

Chain of Custody and Analytical Request Form

DataChem Laboratories, Inc.
CANISTER CHAIN-OF-CUSTODY AND FIELD DATA RECORD

Earthtec No: 07003	Project/Job/Task: Stanton - Indoor Air Sampling
-------------------------------------	--

do not apply adhesive labels directly on Canisters

tags are provided, attached to Canisters for your convenience, to apply adhesive labels

DataChem Labs
use only

Serial No.:	Date Cleaned	Initial Vacuum (inches of Hg vacuum)	VFR flow rate (ml/min)	Initials:	Field Vacuum before sampling (inches of Hg vacuum)	Final Vacuum after sampling (inches of Hg vacuum)	Client Sample Identification	Other Client Information
700	6.30.05	>250		mt	30	13"	SHA-PARKING LOT	5 wind, 0-Smph
007	7.5.05				32	1.5"	STANTON-2ND FLOOR	
089	7.5.05				30	0.5"	STANTON-CATWALK	
050	7.5.05				30	1" 20.4	SHA-GROUND FLOOR A	DUPLICATE OF SHA-GROUND FLOOR
014	7.8.05				32	3"	STANTON-PARKING LOT	
Serial No.:								
550	7.21.05		~3.0	mt				
3619								
3947								
0827								
0944								

Original Field Sample Chain-of-Custody

Released By: (Signature)	Date/Time	Received By: (Signature)	Reason for Transfer/Storage Location
<i>Shawn Hogan</i>	7.21.05/6:00	<i>Don Han</i>	Sampling
<i>Shawn Hogan</i>	7.27.05/14:00		

Return to:
DataChem Laboratories, Inc.
 960 W. LeVoy Drive
 Salt Lake City, UT 84123
 800-356-9135

do not apply adhesive labels directly on Canisters

tags are provided, attached to Canisters for your convenience, to apply adhesive labels

4/22/2006

DataChem Laboratories, Inc. CANISTER CHAIN-OF-CUSTODY AND FIELD DATA RECORD

Client: Earthtec	Project/Job/Task: Spent Air Sampling
Account No: 27003	

Please do not apply adhesive labels directly on Canisters

Manilla tags are provided, attached to Canisters for your convenience, to apply adhesive labels

DataChem Labs	use only
---------------	----------

Canister Serial No.:	Date Cleaned	Initial Vacuum (inches of Hg vacuum)	VFR flow rate (ml/min)	Initials:	Field Vacuum before sampling (inches of Hg vacuum)	Final Vacuum after sampling (inches of Hg vacuum)	Client Sample Identification	Other Client Information
108019	7.5.05	>25.0		MT	30	30.1	SH4 - BASEMENT LITH - BASEMENT	
108080	6.30.05				30	30	SH4 - BASEMENT LITH - BASEMENT	
108090	7.5.05				30	30	SH4 - BASEMENT LITH - BASEMENT	
108061	7.14.05				29	4"	SH4 - BASEMENT LITH - BASEMENT	
VFR Serial No.:								
108037	7.21.05		~3.0	MT				
108014								
108551								
108990								

Relinquished By: (Signature)	Date/Time	Received By: (Signature)	Reason for Transfer/Storage Location	Return to:
<i>Andrew H. [Signature]</i>	7/21/05 10:00	<i>Jan [Signature]</i>	Sampling	
Weight (g)	7/21/05			

Original Field Sample Chain-of-Custody

Please do not apply adhesive labels directly on Canisters

Manilla tags are provided, attached to Canisters for your convenience, to apply adhesive labels

800-356-9135
Salt Lake City, UT 84123
960 W. LeVoy Drive
DataChem Laboratories, Inc.



**DATA
CHEM**
LABORATORIES, INC.

ANALYTICAL REQUEST FORM

1. ☐ REGULAR Status

☐ RUSH Status Requested - ADDITIONAL CHARGE
RESULTS REQUIRED BY _____

DATE

CONTACT DATACHEM LABS PRIOR TO SENDING SAMPLES

2. Date 7/26/05 Purchase Order No. _____ 4. Quote No. _____
3. Company Name Earth Tech, Inc. H ECC DCL Project Manager _____
Address 1243 Broad St. Suite 200
Stamford NJ 07003
5. Sample Collection
Person to Contact Dave Miller Sampling Site Stanton - LTJLA
Telephone (H3) 202-9011 Industrial Process _____
Fax Telephone () _____ Date of Collection 7/26/05
E-mail Address dmiller@ECC.net Time Collected _____
Billing Address (if different from above) Date of Shipment 7/27/05
Environmental Chemical Corp. Chain of Custody No. 1 of 1
1243 Broad St. Suite 200
Stamford NJ

6. REQUEST FOR ANALYSES

Client Sample Number	Matrix*	Sample Volume	ANALYSES REQUESTED - Use method number if known	Units**
LHA-Roof Top	Air	6L Sample	EPA-TO-15	ug/m ³
LHA-Basement	Air	6L Sample	EPA-TO-15	ug/m ³
LHA-Basement A	Air	6L Sample	EPA-TO-15	ug/m ³
SHA-Parking Lot	Air	6L Sample	EPA-TO-15	ug/m ³
Stanton-Parking Lot	Air	6L Sample	EPA-TO-15	ug/m ³
SHA-Ground Flr	Air	6L Sample	EPA-TO-15	ug/m ³
SHA-Corridor Flr A	Air	6L Sample	EPA-TO-15	ug/m ³
Stanton-Transit Bldg Flr	Air	6L Sample	EPA-TO-15	ug/m ³
Stanton-Transit Bldg Flr	Air	6L Sample	EPA-TO-15	ug/m ³

* Specify: Solid sorbent tube, e.g. Charcoal; Filter type; Impinger solution; Bulk sample; Blood; Urine; Tissue; Soil; Water; Other

** 1. ug/sample 2. mg/m³ 3. ppm 4. % 5. _____ (other) Please indicate one or more units in the column entitled Units**

Comments Report in units ug/m³

LHA-Basement A data = 10000 only, tested in duplicate

Sampler shipped in two separate boxes.

Possible Contamination and/or Chemical Hazards _____

7. Chain of Custody (Optional)

Relinquished by	<u>Sharon Memon</u>	Shipped to Lab	Date/Time	<u>7/27/05</u>	<u>14:00</u>
Received by	_____		Date/Time	_____	_____
Relinquished by	_____		Date/Time	_____	_____
Received by	_____		Date/Time	_____	_____
Relinquished by	_____		Date/Time	_____	_____
Received by	_____		Date/Time	_____	_____

Appendix C

FedEx Airbills

FedEx Express US Airbill

FedEx Tracking Number **851611551582**

1 From Please print and press hard
 Date **7-27-05** Sender's FedEx Account Number **243-477-100 (24)**
 Sender's Name **James Kearns** Phone **(801) 283-5981**
 Company **Earth Tech Inc**
 Address **110 Cotton Mill Road**
 City **Great Neck** State **NY** ZIP **11021**

2 Your Internal Billing Reference **5442001**

3 To
 Recipient's Name **Sample Custodian** Phone **(800) 356-9135**
 Company **Data Chem Laboratories**
 Recipient's Address **960 W. Levey Drive**
Via cannot deliver to P.O. boxes or P.O. ZIP codes.
 Address **Salt Lake City** State **Utah** ZIP **84123**
Enter recipient's address in Section 3.

Try online shipping at fedex.com

By using this Airbill you agree to the service conditions on the back of this Airbill and in our current Service Guide, including terms that limit our liability.
Questions? Visit our Web site at fedex.com
 or call 1.800.GoFedEx 1.800.463.3339.

Form 1040 **0200**

4a Express Package Service Packages up to 150 lbs. To most locations
☒ FedEx Priority Overnight Next business morning* ☐ FedEx Standard Overnight Next business afternoon* ☐ FedEx First Overnight Earliest next business morning delivery to select locations*

☐ FedEx 2Day Second business day* ☐ FedEx Express Saver Third business day*
FedEx Envelope rate not available. Minimum charge: One pound rate.

4b Express Freight Service Packages over 150 lbs. To most locations
☐ FedEx 1Day Freight* ☐ FedEx 2Day Freight Second business day* ☐ FedEx 3Day Freight Third business day*
* Call for Confirmation.

5 Packaging * Declared value limit \$500
☐ FedEx Envelope* ☐ FedEx Pak* includes FedEx Small Pak, FedEx Large Pak, and FedEx Sturdy Pak ☐ FedEx Box ☐ FedEx Tube ☒ Other

6 Special Handling Include FedEx address in Section 3.
☐ SATURDAY Delivery Available ONLY for FedEx Priority Overnight, FedEx 2Day, FedEx 1Day Freight, and FedEx 2Day Freight to select ZIP codes ☐ HOLD Weekday at FedEx Location NOT Available for FedEx First Overnight ☐ HOLD Saturday at FedEx Location Available ONLY for FedEx Priority Overnight and FedEx 2Day to select locations
 Does this shipment contain dangerous goods?
☒ No ☐ Yes As per attached Shipper's Declaration ☐ Yes Shipper's Declaration not required ☐ Dry Ice Dry Ice, 9 UN 1845 ☐ Cargo Aircraft Only
Dangerous goods including Dry Ice cannot be shipped in FedEx pack except as noted.

7 Payment Bill to:
☒ Sender Account No. in Section 1 is required ☐ Recipient Enter FedEx Account No. or Credit Card No. below. ☐ Third Party ☐ Credit Card ☐ Cash/Check

Total Packages	Total Weight	Total Declared Value*
		\$.00

* Our liability is limited to \$100 unless you declare a higher value. See back for details. FedEx Use Only

8 Sign to Authorize Delivery Without a Signature
 By signing this Airbill you agree to deliver this shipment without obtaining a signature and agree to indemnify and hold us harmless from any resulting claims.
467

RETAIN THIS COPY FOR YOUR RECORDS.

FedEx Express US Airbill

FedEx Tracking Number **851611551571**

1 From Please print and press hard
 Date **7-27-05** Sender's FedEx Account Number **243-477-100 (24)**
 Sender's Name **James Kearns** Phone **(801) 283-5981**
 Company **Earth Tech Inc**
 Address **110 Cotton Mill Road**
 City **Great Neck** State **NY** ZIP **11021**

2 Your Internal Billing Reference **5442001**

3 To
 Recipient's Name **Sample Custodian** Phone **(800) 356-9135**
 Company **Data Chem Laboratories**

Form 1040 **0200**

4a Express Package Service Packages up to 150 lbs. To most locations
☒ FedEx Priority Overnight Next business morning* ☐ FedEx Standard Overnight Next business afternoon* ☐ FedEx First Overnight Earliest next business morning delivery to select locations*

☐ FedEx 2Day Second business day* ☐ FedEx Express Saver Third business day*
FedEx Envelope rate not available. Minimum charge: One pound rate.

4b Express Freight Service Packages over 150 lbs. To most locations
☐ FedEx 1Day Freight* ☐ FedEx 2Day Freight Second business day* ☐ FedEx 3Day Freight Third business day*
* Call for Confirmation.


5 Packaging * Declared value limit \$500
☐ FedEx Envelope* ☐ FedEx Pak* includes FedEx Small Pak, FedEx Large Pak, and FedEx Sturdy Pak ☐ FedEx Box ☐ FedEx Tube ☒ Other

6 Special Handling Include FedEx address in Section 3.
☐ SATURDAY Delivery Available ONLY for FedEx Priority Overnight, FedEx 2Day, FedEx 1Day Freight, and FedEx 2Day Freight to select ZIP codes ☐ HOLD Weekday at FedEx Location NOT Available for FedEx First Overnight ☐ HOLD Saturday at FedEx Location Available ONLY for FedEx Priority Overnight and FedEx 2Day to select locations
 Does this shipment contain dangerous goods?
☒ No ☐ Yes As per attached Shipper's Declaration ☐ Yes Shipper's Declaration not required ☐ Dry Ice Dry Ice, 9 UN 1845 ☐ Cargo Aircraft Only
Dangerous goods including Dry Ice cannot be shipped in FedEx pack except as noted.

RETAIN THIS COPY FOR YOUR RECORDS.

Appendix D

Indoor Air Sampling Location Map

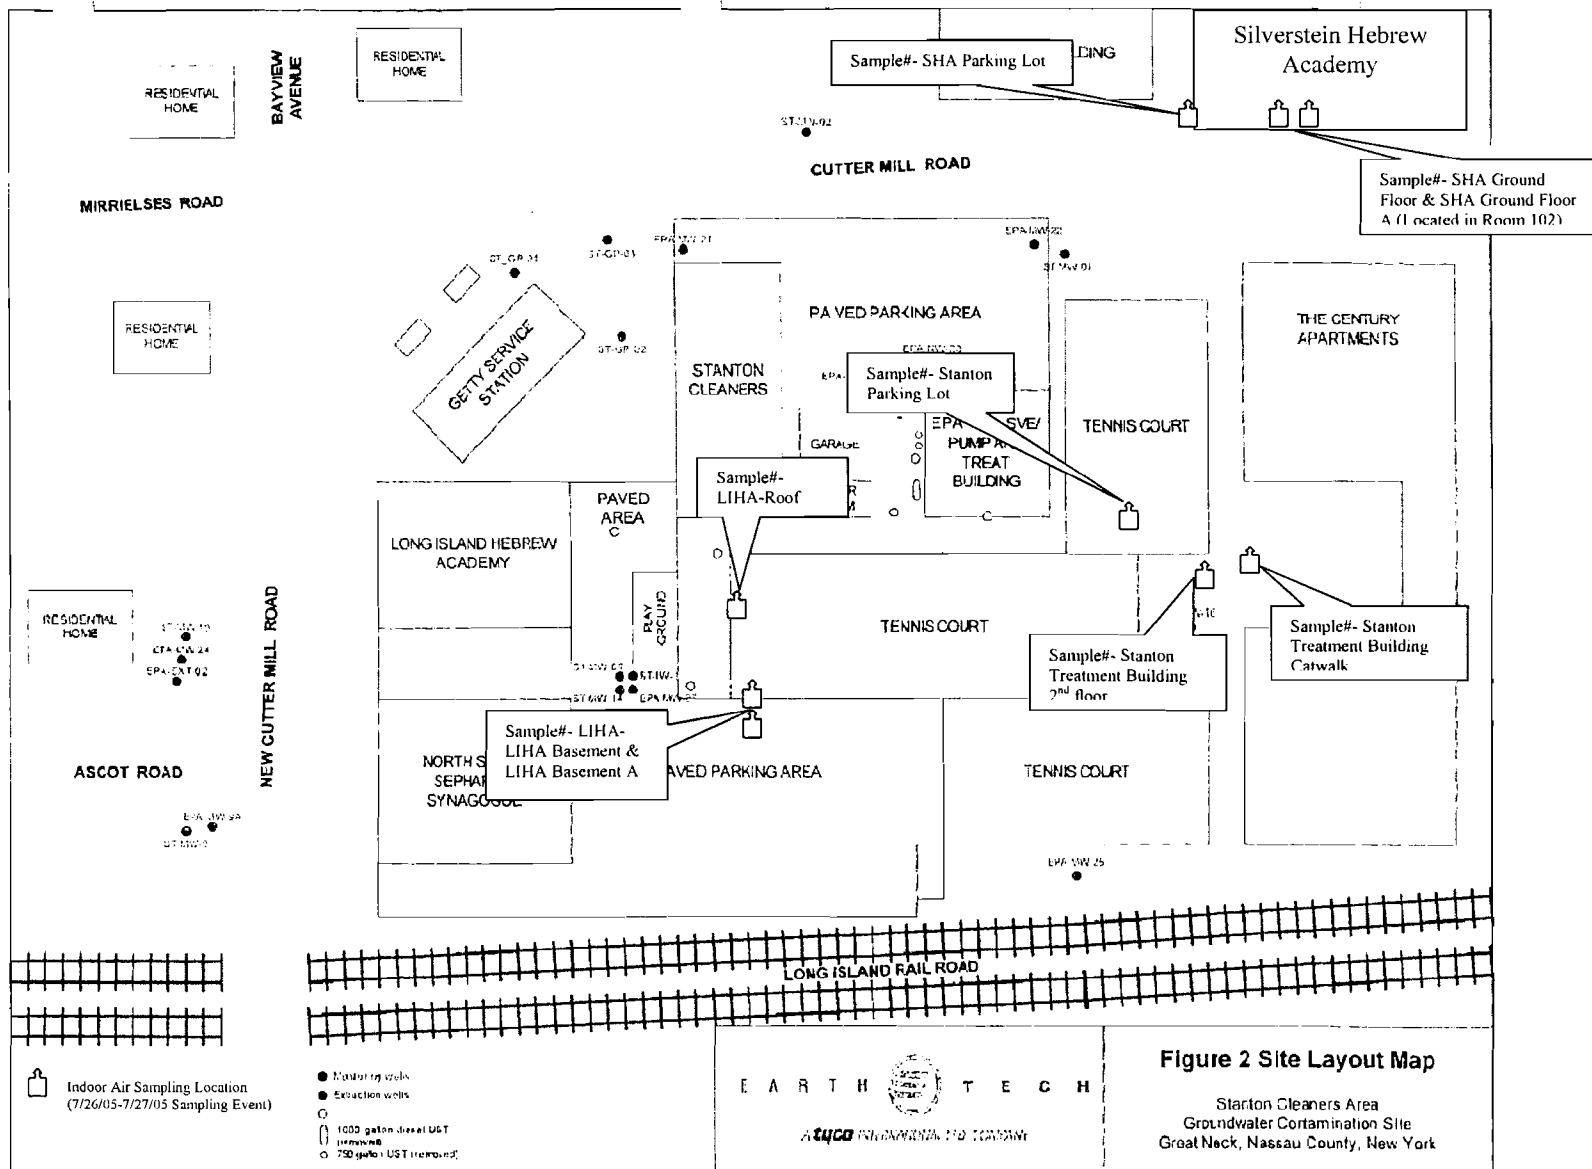

Appendix E

Groundwater Treatment System Raw and Treated Analytical Data

Stanton Cleaners Analytical Tracking Table
Influent and Effluent Groundwater Data

Sample Location	ECC ID*	EPA ID	Date Collected	Compounds Detected	Result (µg/L)	Qualifier**
Influent	SC-01	B0001	10/27/2003	MTBE	2	J
				cis -1,2-Dichloroethene	2	J
				Trichloroethene (TCE)	3	J
				Toluene	3	J
				Tetrachloroethene	350 (D)	
Effluent	SC-04	B0002	10/27/2003	None		
Trip Blank	SC-TB	B0003	10/27/2003	Acetone	61	J
				Methylene chloride	2	J
Influent	SC-01	B0177	11/12/2003	Tetrachloroethene (PCE)	240	
				Chlorodifluoromethane	8.6	NJ
				1,2-Dichloroethene	3.3	NJ
Effluent	SC-04	B0178	11/12/2003	Chlorodifluoromethane	22	NJ
Influent Dup	SC-60	B0179	11/12/2003	Tetrachloroethene	250	
				Chlorodifluoromethane	29	NJ
				1,2-Dichloroethene	3.4	NJ
Trip Blank	SC-TB	B0180	11/12/2003	Tetrachloroethene	9.4	
				Chlorodifluoromethane	4.3	NJ
Influent	SC-01	B17J3	12/10/2003	Tetrachloroethene	290 (D)	
				cis -1,2-Dichloroethene	2	J
				Trichloroethene	3	J
Effluent	SC-04	B17J4	12/10/2003	None		
Influent Dup	SC-61	B17J5	12/10/2003	Tetrachloroethene	280 (D)	
				cis -1,2-Dichloroethene	2	J
				Trichloroethene	3	J
Trip Blank	SC-TB	B17J6	12/10/2003	MTBE	5	J
				Toluene	2	J
				Ethylbenzene	2	J
Influent	SC-01	B1000	1/12/2004	MTBE	2.7	
				cis -1,2-Dichloroethene	1.5	
				Trichloroethene	2.5	
				Tetrachloroethene	280	
Effluent	SC-04	B1001	1/12/2004	None		
Influent Dup	SC-62	B1002	1/12/2004	MTBE	2.6	
				cis -1,2-Dichloroethene	1.5	
				Trichloroethene	2.5	
				Tetrachloroethene	300	
Trip Blank	SC-TB	B1003	1/12/2004	Methylene chloride	0.6	K
				MTBE	3.7	
				Tetrachloroethene	7.9	
				m&p-Xylene	0.7	
Influent	SC-01	B17Z0	2/12/2004	cis -1,2-Dichloroethene	1.7	
				Trichloroethene	3.0	
				Tetrachloroethene	610 (D)	
				Unknown TIC	0.53	J
Effluent	SC-04	B17Z1	2/12/2004	Acetone	3.8	J
Influent Dup	SC-63	B17Z2	2/12/2004	Acetone	25	J
				cis -1,2-Dichloroethene	1.7	
				Trichloroethene	2.8	
				Tetrachloroethene	440 (D)	

Stanton Cleaners Analytical Tracking Table
Influent and Effluent Groundwater Data

Sample Location	ECC ID*	EPA ID	Date Collected	Compounds Detected	Result (µg/L)	Qualifier**
Trip Blank	SC-TB	B17Z3	2/12/2004	Methylene chloride	0.16	J
				MTBE	4.7	
				Chloroform	0.26	J
				Tetrachloroethene	7.1	
				Xylene (total)	0.56	
				1,3-Dichlorobenzene	0.40	J
				1,4-Dichlorobenzene	0.38	J
				Unknown TIC	0.58	J
				Benzene, 1-ethyl-3-methyl-	0.72	JN
Influent	SC-01	B17Z6	3/10/2004	MTBE	2.7	
				cis -1,2-Dichloroethene	1.2	
				Trichloroethene	2.3	
Effluent	SC-04	B17Z7	3/10/2004	Tetrachloroethene	260	
				Tetrachloroethene	0.70	
Influent Dup	SC-64	B17Z8	3/10/2004	MTBE	2.8	
				cis -1,2-Dichloroethene	1.2	
				Trichloroethene	2.3	
Trip Blank	SC-TB	B17Z9	3/10/2004	Tetrachloroethene	260	
				Acetone	1.8	
				Toluene	0.50	
Influent	SC-01	B1BS2	4/14/2004	Isobutane	41	NJ
				MTBE	1.9	
				cis -1,2-Dichloroethene	0.83	
Effluent	SC-04	B1BS3	4/14/2004	Trichloroethene	1.5	
				Tetrachloroethene	380 (D)	
				Tetrachloroethene	1.9	
Influent Dup	SC-65	B1BS4	4/14/2004	Acetone	1.2	J
				MTBE	1.5	
				cis -1,2-Dichloroethene	0.67	J
Trip Blank	SC-TB	B1BS5	4/14/2004	Trichloroethene	1.1	
				Tetrachloroethene	260 (D)	
				Methylene chloride	0.17	J
Influent	SC-01	B1BS6	5/20/2004	Chloroform	2.8	
				Bromodichloromethane	0.80	
				MTBE	2.1	
Effluent	SC-04	B1BS7	5/20/2004	cis -1,2-Dichloroethene	1.0	
				Trichloroethene	1.8	
				Tetrachloroethene	190	
Influent Dup	SC-66	B1BS8	5/20/2004	Acetone	1.2	
				Acetone	0	
				MTBE	2.1	
Trip Blank	SC-TB	B1BS9	5/20/2004	cis -1,2-Dichloroethene	0.9	
				Trichloroethene	1.6	
				Tetrachloroethene	200	
Influent	SC-01	B1BS6	6/15/2004	Acetone	1	
				Chloroform	0	
				Bromodichloromethane	0	
				Carbon Disulfide	1.1	
				MTBE	2.7	
				cis -1,2-Dichloroethene	1.3	
				Trichloroethene	2.4	
				Tetrachloroethene	320	

Stanton Cleaners Analytical Tracking Table
Influent and Effluent Groundwater Data

Sample Location	ECC ID*	EPA ID	Date Collected	Compounds Detected	Result (µg/L)	Qualifier**
Effluent	SC-04	B1BS7	6/15/2004	Tetrachloroethene	2.1	
Influent Dup	SC-67	B1BS8	6/15/2004	MTBE	2.3	
				cis-1,2-Dichloroethene	1.2	
				Trichloroethene	2.2	
				Tetrachloroethene	330	
Trip Blank	SC-TB	B1BS9	6/15/2004	None		
Influent	SC-01	B1FJ2	7/13/2004	Acetone	0.8	
				MTBE	2.3	
				cis-1,2-Dichloroethene	1.1	
				Trichloroethene	1.7	
				Tetrachloroethene	170	
Effluent	SC-04	B1FJ3	7/13/2004	Acetone	0.72	
				Tetrachloroethene	2	
Influent Dup	SC-67	B1FJ4	7/13/2004	MTBE	2.4	
				cis-1,2-Dichloroethene	1.1	
				Trichloroethene	1.8	
				Tetrachloroethene	160	
Trip Blank	SC-TB	B1FJ5	7/13/2004	Acetone	0.73	
				Acetic Acid, Ethyl Ester	2.5	NJ
Influent	SC-01	B1GH2	8/16/2004	MTBE	1.9	
				cis-1,2-Dichloroethene	0.7	
				Trichloroethene	1.5	
				Tetrachloroethene	200	
				Acetone	2	
Effluent	SC-04	B1GH3	8/16/2004	Tetrachloroethene	5.4	
				Acetone	1.6	
Influent Dup	SC-69	B1GH4	8/16/2004	Acetone	1.2	
				MTBE	2	
				cis-1,2-Dichloroethene	0.7	
				Trichloroethene	1.5	
				Tetrachloroethene	210	
Influent	SC-01			Chloromethane	0.80	
				Acetone	1.0	
				MTBE	1.5	
				cis-1,2-Dichloroethene	0.70	
				Trichloroethene	1.4	
				Tetrachloroethene	200	
Effluent	SC-04			Chloromethane	0.80	
				Acetone	2.1	
				Tetrachloroethene	1.7	
Influent Dup	SC-70			Acetone	1.0	
				MTBE	1.3	
				cis-1,2-Dichloroethene	0.60	
				Trichloroethene	1.4	
				Tetrachloroethene	210	
Trip Blank	SC-TB			Acetone	2.2	
				2-Butanone	1.5	
Influent	SC-01	B1LZ2	10/21/2004	Acetone	5	J
				Methylene chloride	0.2	J
				MTBE	0.82	
				cis-1,2-Dichloroethene	0.5	
				Trichloroethene	1.2	
				Tetrachloroethene	220	

Stanton Cleaners Analytical Tracking Table
Influent and Effluent Groundwater Data

Sample Location	ECC ID*	EPA ID	Date Collected	Compounds Detected	Result (µg/L)	Qualifier**
Effluent	SC-04	B1LZ3	10/21/2004	Acetone	5	J
				Methylene chloride	0.5	UJ
				Tetrachloroethene	0.2	J
Influent Dup	SC-71	B1LZ4	10/21/2004	Acetone	5	J
				Methylene chloride	1.1	
				MTBE	1.1	
				cis-1,2-Dichloroethene	0.64	
				Trichloroethene	1.1	
				Tetrachloroethene	210	(D)
Trip Blank	SC-TB	B1LZ5	10/21/2004	Acetone	5.7	
				Methylene chloride	0.68	
				Toluene	0.39	J
Influent	SC-01	B1T22	11/17/2004	Acetone	3	J
				Methylene chloride	1.3	U
				MTBE	1.3	
				cis-1,2-Dichloroethene	0.64	
				Trichloroethene	1.2	
				Tetrachloroethene	170	(D)
Effluent	SC-04	B1T23	11/17/2004	Methyl Acetate	0.5	UJ
				Methylene chloride	0.5	U
Influent Dup	SC-72	B1T24	11/17/2004	Methylene chloride	0.85	U
				MTBE	1.3	
				cis-1,2-Dichloroethene	0.5	
				Trichloroethene	0.83	
				Tetrachloroethene	160	(D)
Trip Blank	SC-TB	B1T25	11/17/2004	Acetone	3	J
				Methyl Acetate	0.5	UJ
				Methylene chloride	0.46	J
				2-Butanone	2.4	J
				Tetrachloroethene	9.6	
				1,2,3-Trichlorobenzene	0.5	UJ
Influent	SC-01	B1T79	12/15/2004	MTBE	1.6	
				cis-1,2-Dichloroethene	0.45	J
				Trichloroethene (TCE)	1.0	J
				Tetrachloroethene	100	(D)
				Methylcyclohexane	1	UJ
				Bromomethane	1	UJ
				Bromodichloromethane	1	UJ
				Chloromethane	1	UJ
				1,2-Dichloroethene	1	UJ
				1,2-Dichloropropane	1	UJ
				2-Hexanone	10	R
				4-Methyl-2-pentanone	10	R
				Benzene	0.5	JB
Effluent	SC-04	B1T81	12/15/2004	1,2,4-Trichlorobenzene	0.5	JB
				1,2,3-Trichlorobenzene	0.5	JB
				Methyl tert-Butyl Ether	1.6	
Influent Dup	SC-73	B1T80	12/15/2004	cis-1,2-Dichloroethene	0.48	J
				Trichloroethene	0.98	J
				4-Methyl-2-pentanone	10	R
				Tetrachloroethene	98	(D)
				2-Hexanone	10	R

Stanton Cleaners Analytical Tracking Table
Influent and Effluent Groundwater Data

Sample Location	ECC ID*	EPA ID	Date Collected	Compounds Detected	Result (µg/L)	Qualifier**
Trip Blank	SC-TB	B1T82	12/15/2004	Chloroform	0.1	J
				Cyclohexane	0.15	J
				Benzene	0.5	JB
				Toluene	0.21	J
Influent	SC-01	B1W00	1/21/2005	MTBE	1.5	
				cis-1,2-Dichloroethene	0.7	
				Trichloroethene (TCE)	1.4	
				Tetrachloroethene	160	
Effluent	SC-04	B1W02	1/21/2005	Acetone	1.8	
Influent Dup	SC-74	B1W01	1/21/2005	Methyl tert-Butyl Ether	1.4	
				cis-1,2-Dichloroethene	0.7	
				Trichloroethene	1.4	
				Tetrachloroethene	150	
Trip Blank	SC-TB	B1W03	1/21/2005	Acetone	10	
				Acetone	3.5	
				MTBE	1.4	
				cis-1,2-Dichloroethene	0.5	
Influent	SC-01	AG00197	2/3/2005	Trichloroethene (TCE)	1.1	
				Tetrachloroethene	140	
				Acetone	1.2	
				Acetone	1.2	
Effluent	SC-04	AG00198	2/3/2005	Methyl tert-Butyl Ether	1.5	
				cis-1,2-Dichloroethene	0.54	
				Trichloroethene	1.1	
				Tetrachloroethene	140	
Influent Dup	SC-75	AG00199	2/3/2005	Acetone	1.1	
				Acetone	4.3	
				4-Methyl-2-pentanone	1.2	
				MTBE	1.4	
Trip Blank	SC-TB	AG00200	2/3/2005	Acetone	2.5	
				Trichloroethene (TCE)	1.1	
				Tetrachloroethene	130	
				Acetone	1.8	
Influent	SC-01	AG00468	3/9/2005	Acetone	1.4	
				MTBE	1.2	
				Trichloroethene	1.1	
				Tetrachloroethene	130	
Effluent	SC-04	AG00469	3/9/2005	Acetone	1.7	
				Chloroform	1.6	
				MTBE	1.7	
				2-Butanone	2.2	
Influent Dup	SC-76	AG00470	3/9/2005	Acetone	2.4	
				Trichloroethene (TCE)	1.1	
				Tetrachloroethene	65	
				2-Butanone	2.5	
Trip Blank	SC-TB	AG00471	3/9/2005	Acetone	5.1	
				Trichloroethene (TCE)	1.3	
				Tetrachloroethene	9.5	
				None		
Influent (EPA-EXT-02)	SC-01	AG00825	4/22/2005	2-Butanone	2.8	
				Acetone	4.9	
				Trichloroethene	1.3	
				Tetrachloroethene	9	
Influent (EPA-EXT-4R)	SC-02	AG00826	4/22/2005	2-Butanone	2.8	
				Acetone	4.9	
				Trichloroethene	1.3	
				Tetrachloroethene	9	
Effluent	SC-04	AG00827	4/22/2005	2-Butanone	2.8	
				Acetone	4.9	
				Trichloroethene	1.3	
				Tetrachloroethene	9	
Influent Dup (EPA-EXT-02) (EPA-EXT-4R)	SC-77	AG00828	4/22/2005	2-Butanone	2.8	
				Acetone	4.9	
				Trichloroethene	1.3	
				Tetrachloroethene	9	

Stanton Cleaners Analytical Tracking Table
Influent and Effluent Groundwater Data

Sample Location	ECC ID*	EPA ID	Date Collected	Compounds Detected	Result (µg/L)	Qualifier**
Trip Blank	SC-TB	AG00829	4/22/2005	Acetone	1	
				Chloroform	1.7	
				Trichloroethene (TCE)	0.84	
Influent (EPA-EXT-02)	SC-01	AG01320	5/24/2005	MTBE	1.1	
				Trichloroethene (TCE)	1.0	
				Tetrachloroethene	100	
Influent (EPA-EXT-4R)	SC-02	AG01321	5/24/2005	Tetrachloroethene	8.8	
Effluent	SC-04	AG01322	5/24/2005	Acetone	1.3	
Influent Dup (EPA-EXT-02) (EPA-EXT-4R)	SC-78	AG01323	5/24/2005	Tetrachloroethene	8.6	
Trip Blank	SC-TB	AG01324	5/24/2005	Acetone	1.3	
				Chloroform	13	
				Bromodichloromethane	2.5	

Notes:

- = Unless otherwise noted, samples collected from ECC ID SC-04 were used as the matrix spike / matrix spike duplicate sample.
- ** = Data validation was performed by EPA Region II. ECC carried over assigned qualifiers and did not perform a separate review or validation of the data.
- (D) = Detection from a dilution of the sample.
- J = qualified as estimated
- JN = Presumptive evidence for the presence of the material at an estimated value.
- K = The reported value may be biased high.
- µg/L = micrograms per liter
- MTBE = Tert-butyl-methyl-ether
- NJ = TIC. The reported value is estimated.
- TIC = Tentatively Identified Compound.

Appendix F

Soil Vapor Extraction and Pump and Treat System Bi-weekly Air Monitoring Logs

**STANTON CLEANERS AREA GROUNDWATER
CONTAMINATION SITE
Soil-Vapor Extraction and Pump and Treat System
Bi-Weekly Air Monitoring Log**

Date: 7/25/05
Project # 70536

70536

	MultiRAE Plus PGM-50					VelociCalc Plus				
	VOC	CO	Oxygen	LEL	H2S	Temp.	Vac. Pre.	%RH	Dew pt.	Flow
Influent SVE	8.1	0	19.70%	0%	0	116.3	-0.01	23.30%	69.40	280
Post Air Stripper	0.0	0	20.90%	0%	0	60.2	N/A	92.80%	57.60	3.5
Post SVE Carbon	0.0	0	19.70%	0%	0	97.7	-0.009	36.50%	67.00	N/A
Post AS Carbon	0.0	0	20.90%	0%	0	64.2	-0.013	85.20%	59.00	135
Sub-Slab A	0.8	0	20.90%	0%	0	81.8	-0.002	68.00%	69.70	17
Sub-Slab B	1.1	0	20.90%	0%	0	82.4	-0.011	70.60%	71.20	3.5
Sub-Slab C	0.5	0	20.90%	0%	0	90.7	-0.01	70.10%	79.40	11.25
Background	0.0	0	20.90%	0%	0	78.1	N/A	71.50%	67.10	N/A
SVE-EXT-4R	1.2	0	20.90%	0%	0	85.9	-0.01	60.10%	70.30	1.85
Sub-Slab D										

Equipment calibrated by: R. Derrick, F. Mahalski
Air monitoring collected by: R. Derrick, F. Mahalski
Air sample readings performed by: R. Derrick, F. Mahalski

Comments:

- 1) Sub-Slab identifications altered during this event. What had previously been called Sub-Slab C is now SVE-EXT-4R as this sample port monitored SVE-EXT-4R. Further details of the sub-slab monitoring points are included on the attached map.
- 2) Sub-slab sample ports online since 3/22/05
- 3) Sub-slab D blocked by vehicle therefore monitoring was not performed during this event.
- 4) New SVE well EPA-EXT-04 online since 11/4/04

VOC: Volatile Organic Compounds
CO: Carbon Monoxide
LEL: Lower Explosive Limit
ppm: parts per million
temperature: measured in degrees Fahrenheit
pressure: measured in inches of water (in/H₂O), inches of mercury (in/Hg), or pounds per square inch (psi).
Flow: measured in cubic feet per minute (cfm)

%RH: relative humidity
Dew Pt.: dew point in degrees Fahrenheit
AS: Air Stripper
SVE: Soil Vapor Extraction System
N/A: not available/applicable

Appendix G

Semi-Annual Groundwater Sampling Analytical Data

Appendix H

Historical Groundwater Level Monitoring Results (Ongoing)

**HISTORICAL GROUNDWATER ELEVATIONS
STANTON CLEANERS AREA GROUNDWATER CONTAMINATION SITE
GREAT NECK, NASSAU COUNTY, NEW YORK**

Well ID	Top of PVC Elevation (ft msl)	10/29/2003		10/31/2003		11/22/03 - 11/23/03	
		DTW (ft BTOC)	Elevation (ft msl)	DTW (ft BTOC)	Elevation (ft msl)	DTW (ft BTOC)	Elevation (ft msl)
EPA-MW-11D	74.63	57.74	16.89	57.94	16.69	60.07	14.56
EPA-MW-21	84.13	66.70	17.43	66.14	17.99	66.86	17.27
EPA-MW-22	82.20	64.51	17.69	64.08	18.12	65.09	17.11
EPA-MW-23	82.83	64.97	17.86	64.54	18.29	78.61	4.22
EPA-MW-27	69.32	51.74	17.58	51.12	18.20	52.85	16.47
ST-MW-02	82.03	64.19	17.84	63.78	18.25	64.40	17.63
ST-MW-06	69.83	63.43	6.40	44.82	25.01	44.92	24.91
ST-MW-09	78.13	61.39	16.74	60.67	17.46	62.52	15.61
ST-MW-11	75.25	58.67	16.58	58.06	17.19	60.59	14.66
ST-MW-12	87.20	73.84	13.36	70.18	17.02	72.01	15.19
ST-MW-14	69.73	50.94	18.79	50.76	18.97	56.40	13.33
ST-MW-16	75.78	55.51	20.27	55.53	20.25	65.51	10
ST-MW-17	86.53	69.95	16.58	69.27	17.26	71.55	14.98
ST-MW-19	82.50	67.01	15.49	64.93	17.57	68.04	14.46
ST-MW-20	84.53	65.99	18.54	65.83	18.70	73.45	11.08

Notes:

ft msl - feet mean sea level

ft BTOC - feet below top of casing

-- - Not measured

**HISTORICAL GROUNDWATER ELEVATIONS
STANTON CLEANERS AREA GROUNDWATER CONTAMINATION SITE
GREAT NECK, NASSAU COUNTY, NEW YORK**

Well ID	Top of PVC Elevation (ft msl)	12/17/03 - 12/18/03		1/12/2004		2/26/2004	
		DTW (ft BTOC)	Elevation (ft msl)	DTW (ft BTOC)	Elevation (ft msl)	DTW (ft BTOC)	Elevation (ft msl)
EPA-MW-11D	74.63	59.00	15.63	57.52	17.11	56.50	18.13
EPA-MW-21	84.13	64.99	19.14	66.17	17.96	64.30	19.83
EPA-MW-22	82.20	63.03	19.17	63.99	18.21	61.90	20.30
EPA-MW-23	82.83	77.05	5.78	64.45	18.38	63.00	19.83
EPA-MW-27	69.32	51.75	17.57	51.22	18.10	50.50	18.82
ST-MW-02	82.03	63.25	18.78	64.03	18.00	62.03	20.00
ST-MW-06	69.83	43.10	26.73	45.74	24.09	44.40	25.43
ST-MW-09	78.13	61.50	16.63	--	--	60.00	18.13
ST-MW-11	75.25	59.23	16.02	62.10	13.15	60.90	14.35
ST-MW-12	87.20	72.00	15.20	70.27	16.93	60.50	26.70
ST-MW-14	69.73	55.05	14.68	NA	NA	48.70	21.03
ST-MW-16	75.78	64.18	11.60	54.99	20.79	53.00	22.78
ST-MW-17	86.53	69.99	16.54	69.40	17.13	67.25	19.28
ST-MW-19	82.50	67.21	15.29	--	--	65.25	17.25
ST-MW-20	84.53	71.56	12.97	63.51	21.02	61.75	22.78

Notes:

ft msl - feet mean sea level

ft BTOC - feet below top of casing

-- - Not measured

**HISTORICAL GROUNDWATER ELEVATIONS
STANTON CLEANERS AREA GROUNDWATER CONTAMINATION SITE
GREAT NECK, NASSAU COUNTY, NEW YORK**

Well ID	Top of PVC Elevation (ft msl)	3/29/2004		4/5/2004		5/19/2004	
		DTW (ft BTOC)	Elevation (ft msl)	DTW (ft BTOC)	Elevation (ft msl)	DTW (ft BTOC)	Elevation (ft msl)
EPA-MW-11D	74.63	60.00	14.63	60.36	14.27	60.30	14.33
EPA-MW-21	84.13	66.99	17.14	67.38	16.75	67.10	17.03
EPA-MW-22	82.20	61.90	20.30	65.00	17.20	64.98	17.22
EPA-MW-23	82.83	65.10	17.73	65.59	17.24	65.25	17.58
EPA-MW-27	69.32	52.08	17.24	52.84	16.48	53.10	16.22
ST-MW-02	82.03	63.99	18.04	64.90	17.13	64.87	17.16
ST-MW-06	69.83	45.60	24.23	46.24	23.59	46.25	23.58
ST-MW-09	78.13	62.80	15.33	--	--	62.00	16.13
ST-MW-11	75.25	60.00	15.25	60.85	14.40	60.46	14.79
ST-MW-12	87.20	72.22	14.98	72.22	14.98	72.12	15.08
ST-MW-14	69.73	56.99	12.74	57.87	11.86	58.13	11.60
ST-MW-16	75.78	54.68	21.10	55.48	20.30	55.09	20.69
ST-MW-17	86.53	70.25	16.28	71.76	14.77	71.80	14.73
ST-MW-19	82.50	66.00	16.50	--	--	65.78	16.72
ST-MW-20	84.53	71.45	13.08	73.78	10.75	73.65	10.88

Notes:

ft msl - feet mean sea level

ft BTOC - feet below top of casing

-- - Not measured

**HISTORICAL GROUNDWATER ELEVATIONS
STANTON CLEANERS AREA GROUNDWATER CONTAMINATION SITE**

GREAT NECK, NASSAU COUNTY, NEW YORK

Well ID	Top of PVC Elevation (ft msl)	6/14/2004		7/21/04 - 7/22/04		8/2/2004	
		DTW (ft BTOC)	Elevation (ft msl)	DTW (ft BTOC)	Elevation (ft msl)	DTW (ft BTOC)	Elevation (ft msl)
EPA-MW-11D	74.63	59.97	14.66	59.75	14.88	59.75	14.88
EPA-MW-21	84.13	67.00	17.13	66.99	17.14	66.11	18.02
EPA-MW-22	82.20	64.78	17.42	64.50	17.70	64.33	17.87
EPA-MW-23	82.83	66.21	16.62	66.10	16.73	65.16	17.67
EPA-MW-27	69.32	53.05	16.27	52.98	16.34	54.86	14.46
ST-MW-02	82.03	65.11	16.92	65.00	17.03	59.85	22.18
ST-MW-06	69.83	45.99	23.84	45.66	24.17	44.11	25.72
ST-MW-09	78.13	62.00	16.13	61.79	16.34	--	--
ST-MW-11	75.25	60.40	14.85	60.39	14.86	60.50	14.75
ST-MW-12	87.20	72.29	14.91	72.20	15.00	71.36	15.84
ST-MW-14	69.73	58.55	11.18	58.34	11.39	55.56	14.17
ST-MW-16	75.78	55.09	20.69	55.01	20.77	54.85	20.93
ST-MW-17	86.53	71.52	15.01	71.46	15.07	70.80	15.73
ST-MW-19	82.50	65.00	17.50	64.77	17.73	--	--
ST-MW-20	84.53	73.44	11.09	73.25	11.28	71.66	12.87

Notes:

ft msl - feet mean sea level

ft BTOC - feet below top of casing

-- - Not measured

**HISTORICAL GROUNDWATER ELEVATIONS
STANTON CLEANERS AREA GROUNDWATER CONTAMINATION SITE
GREAT NECK, NASSAU COUNTY, NEW YORK**

Well ID	Top of PVC Elevation (ft msl)	9/28/04 - 9/29/04		10/12/04 -10/13/04		11/3/2004	
		DTW (ft BTOC)	Elevation (ft msl)	DTW (ft BTOC)	Elevation (ft msl)	DTW (ft BTOC)	Elevation (ft msl)
EPA-MW-11D	74.63	59.70	14.93	58.97	15.66	58.95	15.68
EPA-MW-21	84.13	66.75	17.38	66.50	17.63	66.41	17.72
EPA-MW-22	82.20	64.41	17.79	64.34	17.86	64.32	17.88
EPA-MW-23	82.83	65.11	17.72	65.00	17.83	64.87	17.96
EPA-MW-27	69.32	52.31	17.01	52.25	17.07	52.26	17.06
ST-MW-02	82.03	65.00	17.03	65.03	17.00	65.00	17.03
ST-MW-06	69.83	44.55	25.28	55.34	14.49	55.29	14.54
ST-MW-09	78.13	62.00	16.13	62.12	16.01	62.15	15.98
ST-MW-11	75.25	60.41	14.84	60.50	14.75	60.34	14.91
ST-MW-12	87.20	72.00	15.20	72.21	14.99	72.22	14.98
ST-MW-14	69.73	56.71	13.02	56.50	13.23	56.49	13.24
ST-MW-16	75.78	55.10	20.68	57.00	18.78	57.01	18.77
ST-MW-17	86.53	70.99	15.54	70.98	15.55	70.95	15.58
ST-MW-19	82.50	64.84	17.66	64.80	17.70	64.79	17.71
ST-MW-20	84.53	71.97	12.56	72.00	12.53	72.55	11.98

Notes:

ft msl - feet mean sea level

ft BTOC - feet below top of casing

-- - Not measured

**HISTORICAL GROUNDWATER ELEVATIONS
STANTON CLEANERS AREA GROUNDWATER CONTAMINATION SITE
GREAT NECK, NASSAU COUNTY, NEW YORK**

Well ID	Top of PVC Elevation (ft msl)	12/8/2004		1/3/2005		2/7/2005	
		DTW (ft BTOC)	Elevation (ft msl)	DTW (ft BTOC)	Elevation (ft msl)	DTW (ft BTOC)	Elevation (ft msl)
EPA-MW-11D	74.63	59.75	14.88	59.10	15.53	57.63	17.00
EPA-MW-21	84.13	66.61	17.52	65.67	18.46	65.80	18.33
EPA-MW-22	82.20	64.33	17.87	64.44	17.76	65.32	16.88
EPA-MW-23	82.83	65.16	17.67	65.10	17.73	64.44	18.39
EPA-MW-27	69.32	52.24	17.08	51.87	17.45	50.85	18.47
ST-MW-02	82.03	64.54	17.49	64.78	17.25	63.90	18.13
ST-MW-06	69.83	44.11	25.72	55.41	14.42	47.32	22.51
ST-MW-09	78.13	59.98	18.15	62.31	15.82	63.44	14.69
ST-MW-11	75.25	60.50	14.75	59.99	15.26	58.64	16.61
ST-MW-12	87.20	71.36	15.84	71.98	15.22	70.45	16.75
ST-MW-14	69.73	55.56	14.17	56.51	13.22	50.15	19.58
ST-MW-16	75.78	54.85	20.93	57.08	18.70	55.15	20.63
ST-MW-17	86.53	70.80	15.73	71.03	15.50	70.75	15.78
ST-MW-19	82.50	64.32	18.18	64.76	17.74	65.01	17.49
ST-MW-20	84.53	71.66	12.87	72.43	12.10	65.09	19.44

Notes:

ft msl - feet mean sea level

ft BTOC - feet below top of casing

-- - Not measured

**HISTORICAL GROUNDWATER ELEVATIONS
STANTON CLEANERS AREA GROUNDWATER CONTAMINATION SITE
GREAT NECK, NASSAU COUNTY, NEW YORK**

Well ID	Top of PVC	3/22/2005	4/11/2005	5/19/2005
---------	------------	-----------	-----------	-----------

	Elevation (ft msl)	DTW (ft BTOC)	Elevation (ft msl)	DTW (ft BTOC)	Elevation (ft msl)	DTW (ft BTOC)	Elevation (ft msl)
EPA-MW-11D	74.63	60.00	14.63	60.99	13.64	61.00	13.63
EPA-MW-21	84.13	64.50	19.63	64.00	20.13	63.21	20.92
EPA-MW-22	82.20	64.55	17.65	65.12	17.08	65.43	16.77
EPA-MW-23	82.83	65.00	17.83	65.10	17.73	65.00	17.83
EPA-MW-27	69.32	51.67	17.65	51.60	17.72	51.33	17.99
ST-MW-02	82.03	63.99	18.04	63.89	18.14	63.40	18.63
ST-MW-06	69.83	55.40	14.43	55.42	14.41	55.32	14.51
ST-MW-09	78.13	61.20	16.93	61.78	16.35	61.72	16.41
ST-MW-11	75.25	60.10	15.15	60.00	15.25	59.99	15.26
ST-MW-12	87.20	72.00	15.20	71.21	15.99	71.12	16.08
ST-MW-14	69.73	56.20	13.53	56.33	13.40	56.34	13.39
ST-MW-16	75.78	57.00	18.78	57.10	18.68	57.30	18.48
ST-MW-17	86.53	70.78	15.75	70.00	16.53	59.90	26.63
ST-MW-19	82.50	63.23	19.27	63.00	19.50	63.00	19.50
ST-MW-20	84.53	71.32	13.21	71.21	13.32	71.71	12.82

Notes:

ft msl - feet mean sea level

ft BTOC - feet below top of casing

-- - Not measured

**HISTORICAL GROUNDWATER ELEVATIONS
STANTON CLEANERS AREA GROUNDWATER CONTAMINATION SITE
GREAT NECK, NASSAU COUNTY, NEW YORK**

Well ID	Top of PVC Elevation (ft msl)	6/15/2005		7/7/2005	
		DTW (ft BTOC)	Elevation (ft msl)	DTW (ft BTOC)	Elevation (ft msl)
EPA-MW-11D	74.63	58.70	15.93	58.51	16.12
EPA-MW-21	84.13	66.35	17.78	66.27	17.83
EPA-MW-22	82.20	63.83	18.37	63.78	18.42
EPA-MW-23	82.83	64.32	18.51	64.29	18.54
EPA-MW-27	69.32	51.45	17.87	51.35	17.97
ST-MW-02	82.03	--	--	--	--
ST-MW-06	69.83	45.70	24.13	45.90	23.93
ST-MW-09	78.13	63.45	14.68	63.29	14.84
ST-MW-11	75.25	--	--	--	--
ST-MW-12	87.20	71.02	16.18	70.71	16.49
ST-MW-14	69.73	55.08	14.65	54.99	14.74
ST-MW-16	75.78	54.54	21.24	54.71	21.07
ST-MW-17	86.53	70.35	16.18	70.17	16.36
ST-MW-19	82.50	66.82	15.68	66.89	15.61
ST-MW-20	84.53	71.20	13.33	71.07	13.46

Notes:

ft msl - feet mean sea level

ft BTOC - feet below top of casing

-- - Not measured

Appendix I

Indoor Air Quality Analytical Data

Appendix J

Action List Dated July 2005



A Tyco Infrastructure Services Company

July 2005 ACTION LIST SUMMARY

PROJECT: Stanton Cleaners

JOB
NUMBER: 70536

LOCATION: Great Neck, NY

DATE: July 2005

CLIENT: USACE / USEPA

COMPLETED ITEMS	DATE PERFORMED
IAQ sampling event	7/26/2005

OUTSTANDING ITEMS	RECOMMENDED SOLUTION
Upcoming MWs to be sampled week of August 29. MW sampling to include 28 locations for VOCs, and 15 locations for MNA monitoring (list per OSC) Replacement of circuit breaker panel. Installation of cage around radon blower at the Long Island Jewish Academy	