

OPERATIONS AND MAINTENANCE REPORT MAY 2018

United States Environmental Protection Agency
Lawrence Aviation Industries Superfund Site
Port Jefferson Station, Suffolk County, New York

Contract No. EP-W-09-009
Work Assignment No. C01-LTRA-02NS



USEPA WORK ASSIGNMENT NUMBER: C01-LTRA-02NS

USEPA CONTRACT NUMBER: EP-W-09-009

HDR

REMEDIAL ACTION CONTRACT (RAC) 2 PROGRAM

OPERATIONS AND MAINTENANCE REPORT

MAY 2018

LAWRENCE AVIATION INDUSTRIES SUPERFUND SITE

PORT JEFFERSON STATION, NEW YORK

June 28, 2018

TABLE OF CONTENTS

| | |
|--|------------|
| TABLE OF CONTENTS..... | ii |
| LIST OF FIGURES | iii |
| LIST OF TABLES..... | iv |
| LIST OF APPENDICES..... | v |
| ACRONYMS AND ABBREVIATIONS | vi |
| 1.0 OVERVIEW | 1-1 |
| 1.1 Purpose of Report and LTRA Objectives | 1-2 |
| 2.0 LAWRENCE AVIATION INDUSTRIES GROUNDWATER TREATMENT SYSTEM PERFORMANCE AND COMPLIANCE SAMPLING RESULTS | 2-1 |
| 2.1 Extraction Well Performance..... | 2-1 |
| 2.2 Treatment System Performance and Compliance | 2-2 |
| 2.3 Injection Well Performance | 2-3 |
| 3.0 OLD MILL POND GROUNDWATER TREATMENT SYSTEM PERFORMANCE AND COMPLIANCE SAMPLING RESULTS..... | 3-1 |
| 3.1 Extraction Well Performance..... | 3-1 |
| 3.2 Treatment System Performance and Compliance | 3-2 |
| 4.0 FACILITY OFF-GAS TREATMENT SYSTEM PERFORMANCE AND COMPLIANCE MONITORING RESULTS..... | 4-1 |
| 4.1 LAI GWTF..... | 4-1 |
| 4.2 OMP GWTF..... | 4-1 |
| 5.0 Summary and Recommendations..... | 5-1 |
| 5.1 LAI GWTF..... | 5-1 |
| 5.2 OMP GWTF..... | 5-1 |

LIST OF FIGURES

| | |
|------------|--|
| Figure 1-1 | Site Location Map |
| Figure 1-2 | LAI and OMP GWTF Locations |
| Figure 1-3 | LAI GWTF Layout |
| Figure 1-4 | Old Mill Pond GWTF Layout |
| Figure 1-5 | LAI GWTF Process Diagram and Sample Locations |
| Figure 1-6 | OMP GWTF Process Diagram and Sample Locations |
| Figure 2-1 | LAI Influent CVOC Concentrations and Mass Removed vs. Time – EW-01 |
| Figure 2-2 | LAI Influent CVOC Concentrations and Mass Removed vs. Time – EW-02 |
| Figure 3-1 | OMP Influent CVOC Concentrations and Mass Removed vs. Time – EW-1 |
| Figure 3-2 | OMP Influent CVOC Concentrations and Mass Removed vs. Time – EW-2 |
| Figure 3-3 | OMP Influent CVOC Concentrations and Mass Removed vs. Time – EW-6 |

LIST OF TABLES

| | |
|-----------|---|
| Table 1-1 | Summary of Well Construction Details, Lawrence Aviation Industries Groundwater Treatment Facility |
| Table 1-2 | Summary of Well Construction Details, Old Mill Pond Groundwater Treatment Facility |
| Table 2-1 | Summary of Monthly Operations, Lawrence Aviation Industries Groundwater Treatment Facility |
| Table 2-2 | Summary of Extraction Well Groundwater Influent CVOC Data and Estimated Mass Removal Rates, Lawrence Aviation Industries Groundwater Treatment Facility |
| Table 2-3 | Summary of Facility Process Sampling – CVOCs, Metals, and Wet Chemistry Parameters, Lawrence Aviation Industries Groundwater Treatment Facility |
| Table 2-4 | Summary of SPDES Permit Equivalent Compliance Data, Lawrence Aviation Industries Groundwater Treatment Facility |
| Table 2-5 | Summary of Operating Values, Lawrence Aviation Industries Groundwater Treatment Facility |
| Table 3-1 | Summary of Monthly Operations, Old Mill Pond Groundwater Treatment Facility |
| Table 3-2 | Summary of Extraction Well Groundwater Influent CVOC Data and Estimated Mass Removal Rates, Old Mill Pond Groundwater Treatment Facility |
| Table 3-3 | Summary of Facility Process Sampling – CVOCs, Metals, and Wet Chemistry Parameters, Old Mill Pond Groundwater Treatment Facility |
| Table 3-4 | Summary of SPDES Permit Equivalent Compliance Data, Old Mill Pond Groundwater Treatment Facility |
| Table 3-5 | Summary of Operating Values, Old Mill Pond Groundwater Treatment Facility |
| Table 4-1 | Summary of Air Pollution Control Permit Equivalent Compliance Data Lawrence Aviation Industries Groundwater Treatment Facility |
| Table 4-2 | Summary of Air Sampling Data Old Mill Pond Groundwater Treatment Facility |

LIST OF APPENDICES

| | |
|------------|---|
| Appendix A | Data Usability Analysis Report |
| Appendix B | System Runtime Log |
| B1 | Lawrence Aviation Industries Groundwater Treatment Facility |
| B2 | Old Mill Pond Groundwater Treatment Facility |
| Appendix C | System Alarm Log |
| C1 | Lawrence Aviation Industries Groundwater Treatment Facility |
| C2 | Old Mill Pond Groundwater Treatment Facility |
| Appendix D | Data Summary Tables |
| D1 | Facility Process Sampling Aqueous Data |
| D2 | Trip Blanks |
| D3 | Facility Process Sampling Air Data |
| Appendix E | Backup Calculations |
| E1 | Figure 2-1 – Influent CVOC Concentrations and Mass Removed vs. Time – EW-01 |
| E2 | Figure 2-2 – Influent CVOC Concentrations and Mass Removed vs. Time – EW-02 |
| E3 | Figure 3-1 – Influent CVOC Concentrations and Mass Removed vs. Time – EW-1 |
| E4 | Figure 3-2 – Influent CVOC Concentrations and Mass Removed vs. Time – EW-2 |
| E5 | Figure 3-3 – Influent CVOC Concentrations and Mass Removed vs. Time – EW-6 |
| Appendix F | Summary of Monthly Operations from October 2012 to September 2017 |
| F1 | Lawrence Aviation Industries Groundwater Treatment Facility |
| F2 | Old Mill Pond Groundwater Treatment Facility |

ACRONYMS AND ABBREVIATIONS

| | |
|---------------------|---|
| amsl | above mean sea level |
| bgs | below ground surface |
| btc | below top of reference point on casing |
| cf | cubic feet |
| cfm | cubic feet per minute |
| cis-1,2-DCE | cis-1,2-dichloroethene |
| CVOC | chlorinated volatile organic compound |
| d | day |
| °F | degrees Fahrenheit |
| D | diluted result |
| 1,1-DCA | 1,1-dichloroethane |
| 1,1-DCE | 1,1-dichloroethene |
| DESA | Division of Environmental Science and Assessment |
| DPA™ | Dry Penetrating Agent |
| DQI | data quality indicator |
| EFF | effluent |
| EPA | United States Environmental Protection Agency |
| ERRS | Emergency Response and Removal Section |
| EW | extraction well |
| ft | feet |
| g | gram |
| g/mole | gram per mole |
| GAC | granular activated carbon |
| gal | gallon |
| GES | Groundwater & Environmental Services, Inc |
| gpm | gallons per minute |
| GPS | global positioning system |
| GWTF | groundwater treatment facility |
| HDR | Henningson, Durham & Richardson, Architecture and Engineering |
| | PC |
| hp | horse power |
| ID | identification |
| in H ₂ O | inches water column |
| INF | influent |
| ITP | Initial Testing Program |
| IW | injection well |
| K | reported value maybe biased high |
| kWh | kilowatt hour |
| L | lamber projections |
| l | liter |
| L | reported value maybe biased low |
| l/gal | liter per gallon |
| LAI | Lawrence Aviation Industries |

ACRONYMS AND ABBREVIATIONS (CONTINUED)

| | |
|-------------------|---|
| < | less than |
| lb | pound |
| lb/d | pounds per day |
| lb/g | pounds per gram |
| LTRA | Long-term Response Action |
| mg/l | milligram per liter |
| µg/l | microgram per liter |
| µg | microgram |
| µg/m ³ | microgram per cubic meter |
| min/day | minutes per day |
| mol/l | mole per liter |
| N/A | not applicable |
| NA | result not available |
| NAD | North American Datum |
| NAVD | North American Vertical Datum |
| NC | not collected |
| NS | not sampled |
| NSF | National Sanitation Foundation |
| NY | New York |
| NYS | New York State |
| NYSDEC | New York State Department of Environmental Conservation |
| O&M | operations and maintenance |
| OMP | Old Mill Pond |
| PCE | tetrachloroethene |
| % | percentage |
| PLC | programmable logic controller |
| ppbv | parts per billion by volume |
| ppm | parts per million |
| psi | pounds per square inch |
| Q | quarter |
| QAPP | Quality Assurance Project Plan |
| RA | remedial action |
| RAC 2 | Remedial Action Contract 2 |
| RD | remedial design |
| ROD | record of decision |
| Site | LAI Superfund Site |
| SPC | State Plane Coordinates |
| SPDES | State Pollutant Discharge Elimination System |
| STP | standard temperature and pressure |
| SU | standard unit |
| 1,1,1-TCA | 1,1,1-trichloroethane |
| TCE | trichloroethene |

ACRONYMS AND ABBREVIATIONS (CONTINUED)

| | |
|-----|---------------------------|
| U | not detected |
| VC | vinyl chloride |
| VFD | variable frequency drive |
| VOC | volatile organic compound |
| Y | year |

1.0 OVERVIEW

This operations and maintenance (O&M) report for the Lawrence Aviation Industries (LAI) Superfund Site (Site) was prepared by Henningson, Durham & Richardson, Architecture and Engineering PC, in association with HDR Engineering, Inc. (HDR) under United States Environmental Protection Agency (EPA) Contract Number EP-W-09-009, EPA Work Assignment Number C01-LTRA-02NS. The O&M report was prepared pursuant to Subtask 9.3 of the Work Plan.

The Site includes LAI's manufacturing plant which totals about 40 acres and historically produced titanium sheeting for the aeronautics industry (hereinafter referred to as the "LAI industrial facility"). The LAI industrial facility consists of 10 buildings located in the southwestern portion of the property. Approximately 80 acres located to the northeast and east of the LAI industrial facility are referred to as the "Outlying Parcels," which are vacant, wooded areas. The Outlying Parcels are part of the Site. The groundwater at the Site has been impacted by chlorinated volatile organic compounds (CVOCs), specifically tetrachloroethene (PCE) and trichloroethene (TCE) due to past disposal practices. On September 29, 2006, EPA issued the record of decision (ROD) selecting the remedial action (RA) for the Site, which covered both soil and groundwater. The soil remedy has been addressed by others. The RA is being conducted to hydraulically contain and to treat groundwater at the source area at the LAI Site and to prevent the migration of contaminated groundwater further downgradient into Old Mill Pond (OMP), Old Mill Creek and Port Jefferson Harbor. **Figure 1-1** shows the Site Location Map.

HDR has been conducting the long-term response action (LTRA) including operation, maintenance and monitoring of the groundwater treatment facility (GWTF) at the source area at the LAI Site and a GWTF at the downgradient contaminated groundwater plume, located to the north of the LAI industrial facility, near OMP since October 2012. **Figure 1-2** shows the LAI and OMP GWTF Locations.

The GWTF at the LAI Site was completed in September 28, 2010 and is currently in the seventh year of LTRA. The LAI GWTF layout is shown on **Figure 1-3**. Hydraulic plume control of the source area is achieved by extracting contaminated groundwater via two extraction wells (EW-01 and EW-02). Extracted groundwater is treated by an air stripper and discharged to groundwater via five upgradient injection wells (IW-01 through IW-05) under a New York State Department of Environmental Conservation (NYSDEC) State Pollutant Discharge Elimination System (SPDES) permit equivalent. The volatile organic compound (VOC)-rich air exiting the air stripper is treated by two vapor phase granular activated carbon (GAC) units before discharging to the air under a NYSDEC air permit equivalent. **Table 1-1** provides the well construction details.

The downgradient GWTF near OMP was completed in August 2011 and is currently in the sixth year of LTRA. The OMP GWTF layout is shown on **Figure 1-4**. Design, construction, and initial operation of this treatment system were completed by EPA Region 2 Emergency Response and Removal Section (ERRS) Removal Action Branch. The system includes five extraction wells (EW-1 through EW-4 and EW-6) which provide hydraulic control of the plume. Three of the extraction wells (EW-1, EW-2, and EW-6) are currently active. EW-3 and EW-4 are standby wells and are not utilized for the extraction of groundwater due to elevated iron levels. Extraction well EW-5 is not used for groundwater extraction and hydraulic control since the well is not of adequate size or depth for a pump. The extracted groundwater is treated

by an air stripper which is followed by two liquid phase GAC units. The treated effluent is discharged to OMP under a NYSDEC SPDES permit equivalent. The VOC-contaminated air is treated by three vapor phase GAC units in lead-lag phase before discharge to the air under a NYSDEC air permit equivalent. **Table 1-2** provides the well construction details.

1.1 Purpose of Report and LTRA Objectives

This document summarizes the monthly performance of the GWTF at the LAI Site and the downgradient GWTF near OMP during the O&M period from May 1 to 31, 2018. Operation, maintenance, and monitoring of the facilities were performed by HDR's subcontractor, GRB Environmental Services, Inc. (GRB) under HDR's direction.

The purpose of this O&M report is to present the results of the monthly operations and compliance sampling, and provide a summary of maintenance and operational problems encountered at both treatment facilities.

The detailed scope and objectives are included in the April 2016, Revision 3 LTRA Quality Assurance Project Plan (QAPP); the primary objectives are summarized below:

- To confirm achievement of remedial system performance requirements, as specified in the RA subcontract documents (i.e., specifications, drawings, approved RA Subcontractor submittals);
- To confirm compliance with the NYSDEC SPDES and Air Pollution Control permit equivalents; and
- To obtain data for assessing LTRA progress and to support decisions regarding treatment system O&M and optimization.

A process flow schematic for the LAI and OMP treatment systems, including system sample locations, is provided as **Figure 1-5** and **Figure 1-6**, respectively.

A data usability evaluation was performed to verify conformance with the LTRA QAPP requirements and confirm data usability as per the data quality indicators (DQIs) specified in the LTRA QAPP. Sample data were evaluated for precision, accuracy, representativeness, comparability, sensitivity, and completeness. The data usability analysis report is included as **Appendix A**. Samples for the monthly treatment system performance and compliance sampling were analyzed for VOCs, metals, and/or wet chemistry parameters. No data were rejected for the samples, so all data are usable. The results indicate that sufficient data were collected to obtain a complete and usable data set.

2.0 LAWRENCE AVIATION INDUSTRIES GROUNDWATER TREATMENT SYSTEM PERFORMANCE AND COMPLIANCE SAMPLING RESULTS

Groundwater treatment system performance and compliance monitoring activities were conducted at the LAI GWTF from May 1 to 31, 2018. The results are presented below. The primary site-related VOCs are PCE and TCE. The following CVOCs have also been included for monitoring purposes as they have been detected site wide at low concentrations historically: 1,1,1-trichloroethane (1,1,1-TCA), cis-1,2-dichloroethene (cis-1,2-DCE), 1,1-dichloroethene (1,1-DCE), 1,1-dichloroethane (1,1-DCA), chloroform and vinyl chloride (VC).

2.1 Extraction Well Performance

The results of extraction well performance are summarized in the following tables and figures:

- **Table 2-1** - Summary of monthly operations
- **Table 2-2** - Summary of extraction well influent CVOC data and estimated mass removal rate
- **Table 2-3** - Summary of facility process sampling for CVOCs, metals, and wet chemistry
- **Table 2-4** - Summary of SPDES Permit Equivalent compliance data
- **Figures 2-1 and 2-2** - Illustration of extraction well influent CVOC data and mass removal rate estimates for extraction wells EW-01 and EW-02, respectively. Backup calculations for Figures 2-1 and 2-2 are included in **Appendix E**. Only mass that was removed from the ground and treated via the air-stripper was included in the mass removal totals.

Extraction well performance for the LAI GWTF for May 2018 is provided in **Table 2-1** and summarized below. **Appendix B1** provides the system runtime log for the month. Monthly data from October 2012 to September 2017 is provided in **Appendix F1**.

- Both extraction wells operated in a flow control mode during the reporting period where the speed of the extraction well pump is set at a constant rate by the facility programmable logic controller (PLC).
- For the reporting period, EW-01 operated at an average flow rate of approximately 77 gallons per minute (gpm). A total of 3,437,552 gallons were extracted from EW-01 for the reporting period and treated via the air stripper with discharge to the effluent injection well field.
- For the reporting period, EW-02 operated at an average flow rate of approximately 76 gpm. A total of 3,388,432 gallons were extracted from EW-02 and treated via the air stripper with discharge to the effluent injection well field.
- Each extraction well is designed to operate at a minimum flow rate of 75 gpm. The facility operated under this configuration for the reporting period with a total average flow rate of approximately 153 gpm.

- Approximately 6.8 million gallons of groundwater were extracted, and approximately 3.2 pounds (lbs.) of CVOC mass were extracted and treated during the reporting period. A total of approximately 225 lbs. of CVOC mass have been extracted to date since October 2012. **Table 2-2** provides a summary of extraction well groundwater influent CVOC data and estimated mass removal rates.
- **Figure 2-1** indicates total site-related CVOC concentrations in EW-01 were detected at 251 µg/l during ITP and 197 µg/l in October 2012 when HDR took over the operations of the LAI facility. CVOC concentrations in EW-01 have decreased to approximately 91 µg/l in May 2018. This is a reduction of approximately 64% since ITP. Concentrations in EW-01 have generally been stable since HDR took over operations.
- **Figure 2-2** indicates total site-related CVOC concentrations in EW-02 were detected at 154 µg/l during ITP and 37 µg/l in October 2012 when HDR took over the operations of the LAI facility. CVOC concentrations in EW-02 are approximately 19 µg/l in May 2018. This is a reduction of approximately 87% since ITP. Concentrations in EW-02 have generally been stable since HDR took over operations.
- The decrease in CVOC concentrations in both extraction wells since ITP is likely attributable to reduction of CVOC concentrations in the source area due to in situ chemical oxidation (ISCO) treatment during the RA, pump-and-treat system operations and volume of water being extracted from each well during the reporting period, which would account for more dilution.

2.2 Treatment System Performance and Compliance

System performance data and observations (e.g., functionality, uptime) are detailed in **Table 2-1** and summarized below.

- A total system uptime of approximately 99.9% was achieved for the reporting period, which is above the minimum remedial design (RD) performance criterion of 90%.
- A total of 15 minutes of planned overall system downtime was reported due to shutting down the system to grease the blower and pump motor parts. Unplanned downtime of about 45 minutes occurred at the LAI facility during this reporting period due to shutdowns of air stripper blower, extraction wells, and high water level alarms.
- **Appendix C1** provides a summary of alarms that resulted in system shutdown.
- Facility process samples were collected on May 8, 2018 to assist with evaluating the facility operations. **Table 2-3** shows the analytical results for extracted water samples collected throughout the treatment system.
- Total CVOC influent mass removal rate of approximately 99% was achieved by the air stripper.

- Aluminum precipitation continued to be observed within the air stripper during the reporting period. **Table 2-3** shows that aluminum in EW-01 was detected at a concentration of 850 µg/l. Aluminum concentrations in EW-01 have decreased since the ITP, when aluminum concentrations in EW-01 averaged approximately 2,700 µg/l. Aluminum concentrations in EW-01 have been relatively stable since January 2013 and observed to decrease gradually since August 2014. Aluminum concentrations in EW-02 have remained relatively stable and at low levels since facility startup. Aluminum in EW-02 was not detected above the method detection limit of 100 µg/l during the reporting period.
- **Table 2-3** shows that potassium in EW-01 was detected at a concentration of 9,420 µg/l during the reporting period. It appears that the residual potassium permanganate oxidant present near EW-01 has been generally decreasing since August 2014.
- Monthly maintenance activities consisted of replacing the bag filter units as required.
- No injuries occurred during the reporting period.
- The results of the groundwater treatment system compliance sampling are summarized in **Table 2-4**. Detailed data summary tables are included in **Appendix D**. Effluent samples were collected on May 8, 2018. The NYSDEC SPDES permit equivalent criteria were met for groundwater effluent discharges to groundwater for all criteria.
- Operating parameters not monitored by the PLC were collected on a weekly basis with data summarized in **Table 2-5**.
- Off-gas treatment system performance and compliance is discussed in Section 4.0.

2.3 Injection Well Performance

Based on the sampling results for this period, aluminum continues to precipitate in the air stripper and is expected to continually foul the injection well screens. The injection wells were originally being reconditioned with DPA™ and standard mechanical pump and surge methods. In the fall of 2014 a new method, that included use of DPA™ in combination with a nitrogen burst technology, was tested. The new method resulted in a fair improvement in well capacity but due to lower than originally designed capacity, the effluent is being distributed amongst multiple injection wells to accommodate the flow. Injection wells IW-01, IW-02, and IW-03 at LAI were rehabilitated in October 2015; and IW-01, IW-04, and IW-05 were rehabilitated between October 25 and November 21, 2016. Rehabilitation of injection wells IW-01, IW-02, IW-03, and IW-05 began on December 11, 2017 and was completed on January 16, 2018.

3.0 OLD MILL POND GROUNDWATER TREATMENT SYSTEM PERFORMANCE AND COMPLIANCE SAMPLING RESULTS

Groundwater treatment system performance and compliance monitoring activities were conducted at the downgradient OMP facility during the reporting period from May 1 to 31, 2018. The results are presented below.

3.1 Extraction Well Performance

The results of extraction well performance are summarized in the following tables and figures:

- **Table 3-1** - Summary of monthly operations
- **Table 3-2** - Summary of extraction well influent CVOC data and estimated mass removal rate
- **Table 3-3** - Summary of facility process sampling for CVOCs, metals, and wet chemistry
- **Table 3-4** - Summary of SPDES Permit Equivalent compliance data
- **Figures 3-1, 3-2 and 3-3** - Illustration of extraction well influent CVOC data and mass removal rate estimates for extraction wells EW-1, EW-2 and EW-6, respectively. Backup calculations for Figures 3-1, 3-2 and 3-3 are included in **Appendix E**. Only mass that was removed from the ground and treated via the air-stripper was included in the mass removal totals.

Extraction well performance for the GWTF at OMP for May 2018 is detailed in **Table 3-1** and summarized below. **Appendix B2** provides the system runtime log for the month. The data presented for the OMP facility in **Table 3-1** is based on the operator's field notes and available data recorded by the PLC. Monthly data from October 2012 to September 2017 are provided in **Appendix F2**.

- The three extraction wells operated in a flow control mode during the reporting period where the speed of the extraction well pump is set at a constant rate by the facility PLC.
- For the reporting period, EW-1 operated at an average flow rate of approximately 63 gpm. A total of 2,833,440 gallons were extracted from EW-1 for the reporting period and treated via the air stripper with discharge to OMP.
- For the reporting period, EW-2 operated at an average flow rate of approximately 68 gpm. A total of 3,014,416 gallons were extracted from EW-2 for the reporting period and treated via the air stripper with discharge to OMP.
- For the reporting period, EW-6 operated at an average flow rate of approximately 79 gpm. A total of 3,542,128 gallons were extracted from EW-6 for the reporting period and treated via the air stripper with discharge to OMP.

- The facility operated under this configuration for the remainder of the reporting period with a total average flow rate of approximately 210 gpm.
- Approximately 9.4 million gallons of groundwater were extracted, and approximately 12 lbs. of CVOC mass were extracted and treated during the reporting period. Approximately 879 lbs. of CVOC mass have been extracted and treated to date since October 2012. **Table 3-2** provides a summary of extraction well groundwater influent CVOC data and estimated mass removal rates.
- **Figure 3-1** indicates the site-wide CVOC influent concentrations in EW-1 have decreased from 313 µg/l since system startup in August 2011 to 94 µg/l in May 2018.
- **Figure 3-2** indicates the site-wide CVOC influent concentrations in EW-2 have decreased since system startup from 454 µg/l in August 2011 to 59 µg/l in May 2018.
- **Figure 3-3** indicates the site-wide CVOC influent concentrations in EW-6 have decreased since startup from 934 µg/l in September 2013 to 281 µg/l in May 2018.
- The overall decrease in CVOC concentrations observed in all three extraction wells is attributed to the operation of EW-6, which appears to be providing more hydraulic control to the plume since its startup in September 2013. These concentrations will continue to be monitored on a monthly basis to establish performance trends. Slight variations in trends are expected due to fluctuations in site-wide groundwater elevations.

3.2 Treatment System Performance and Compliance

System performance data and observations (e.g., functionality, uptime) are detailed in **Table 3-1** and summarized below. Data presented in the table and below is based on operator's field notes and available PLC data.

- A total system uptime of approximately 99.9% was achieved, which is above the minimum RD performance criterion of 90%.
- A total of 10 minutes of planned overall system downtime was reported during bag filter change out and forgreasing the blower and pump motors. No unplanned system downtime was reported in May 2018.
- Facility process samples were collected on May 8, 2018 to assist with analyzing the facility operations. **Table 3-3** shows the analytical results for extracted water samples collected throughout the treatment system.
- A total CVOC influent mass removal rate of approximately 96% was achieved by the air stripper. The TCE concentration was 5.8 µg/l after the air stripper and 5.3 µg/l after the first liquid activated carbon unit. TCE was present in the facility effluent, at 4.5 µg/l, which does not exceed the SPDES permit limit.

- Metals concentrations remained stable throughout the treatment system for the reporting period.
- No injuries or reported incidents occurred during the reporting period.
- The results of groundwater treatment system compliance sampling are summarized in **Table 3-4**. Detailed data summary tables are included in **Appendix D**. SPDES effluent samples were collected on May 8, 2018. The NYSDEC SPDES permit equivalent criteria were met for groundwater effluent discharges to groundwater.
- Operating parameters not monitored by the PLC were collected on a weekly basis with data summarized in **Table 3-5**.

4.0 FACILITY OFF-GAS TREATMENT SYSTEM PERFORMANCE AND COMPLIANCE MONITORING RESULTS

4.1 LAI GWTF

The off-gas treatment system performance and compliance monitoring activities were completed at the LAI GWTF during this reporting period from May 1 to 31, 2018. The testing results and air calculations are summarized in **Table 4-1**.

System performance data and observations (e.g., functionality, uptime) discussed in Section 2.0 support that the treatment system is operating in accordance with RD requirements. Detailed data summary tables are included in **Appendix D**. Off-gas system performance for the GWTF is summarized below.

- Samples were collected from influent, intermediate, and effluent sample ports of the vapor-phase GAC system for VOC analysis via EPA method TO-15 (see **Table 4-1**) on May 8, 2018 in accordance with NYSDEC Air Pollution Control permit equivalency requirements.
- Low concentrations of TCE and PCE were detected in the effluent samples from GAC-1 and GAC-2 for the reporting period. However, the treatment system effluent vapor concentrations were below the permit-equivalency requirements criteria and will continue to be monitored to determine need for change-out.
- Operating parameters not monitored by the PLC were collected on a weekly basis with data summarized in **Table 2-5**.

4.2 OMP GWTF

The off-gas system performance and compliance monitoring activities were completed at the OMP GWTF during this reporting period from May 1 to 31, 2018. The testing results are summarized in **Table 4-2**.

System performance data and observations (e.g., functionality, uptime) discussed in Section 3.0 support that the treatment system is operating in accordance with RD requirements. Detailed data summary tables are included in **Appendix D**. Off-gas system performance for the GWTF is summarized below.

- Samples were collected from influent, intermediate, and effluent sample ports of the vapor-phase GAC system for VOC analysis via EPA method TO-15 (see **Table 4-2**) on May 8, 2018 in accordance with NYSDEC Air Pollution Control permit equivalency requirements.
- TCE and PCE were detected in the effluent samples from GAC-3, GAC-1, and GAC-2 for the reporting period. However, the treatment system effluent vapor concentrations were below the permit-equivalency requirements criteria.
- Operating parameters not monitored by the PLC were collected on a weekly basis with data summarized in **Table 3-5**.

5.0 SUMMARY AND RECOMMENDATIONS

A summary of the monthly compliance and monitoring program results is provided below, along with corresponding recommendations for on-going O&M activities at both GWTFs.

5.1 LAI GWTF

- The treatment system at the LAI Site should continue to operate in flow control mode to maintain hydraulic control of the plume with groundwater flow from EW-01 and EW-02 operating at a total design flow rate of approximately 153 gpm. Flow rates may need to be adjusted to extend the life of the bag filters.
- Aluminum precipitation continued to be observed within the air-stripper at the LAI GWTF during the reporting period. Aluminum concentrations in EW-01 and EW-02 appear to be stabilized and will continue to be monitored.
- CVOC concentrations observed in EW-01 and EW-02 have decreased by approximately 64% and 87%, respectively, since facility startup. Such trends will continue to be tracked and discussed as part of future monthly progress reports.
- Although low concentrations of TCE and PCE were detected in the vapor effluent samples from both GAC units, each unit is still adsorbing the majority of the CVOC contamination. A carbon change-out is recommended based on the off gas system monitoring results.
- SPDES permit equivalent criteria and Air Pollution Control permit equivalent criteria were met at the LAI GWTF. The treatment system will continue to be monitored for compliance with NYSDEC SPDES and air permit equivalents.

5.2 OMP GWTF

- The treatment system at OMP should continue to operate in flow control mode to capture the plume with groundwater flow from EW-1, EW-2, and EW-6. The operating total average flow rate is approximately 210 gpm.
- CVOC concentrations observed in EW-1, EW-2, and EW-6 have decreased gradually since startup. Such trends will continue to be tracked and discussed as part of future monthly progress reports.
- SPDES permit equivalent criteria were met at the OMP treatment facility. The treatment system will continue to be monitored for compliance with NYSDEC SPDES permit equivalent.
- Current sampling results indicate that TCE and PCE were discharged to the atmosphere from the off-gas system. The discharged concentrations are monitored against the OMP facility permit equivalent and are within the allowable limits. However, a vapor-phase carbon change-out will be performed in May 2018 based on the off gas system monitoring results.

FIGURES



Map source: Adapted from NYSDEC Interactive Mapping Gateway: <http://www.nysgis.state.ny.us/gateway/index.html>

Fig1_LAIsiteLocation.ai



Henningson, Durham & Richardson
Architecture and Engineering, P.C.


1 International Blvd, 10th Floor
Mahwah, NJ 07495

Site Location Map

Lawrence Aviation Industries Superfund Site

Port Jefferson Station, New York

Figure
1-1

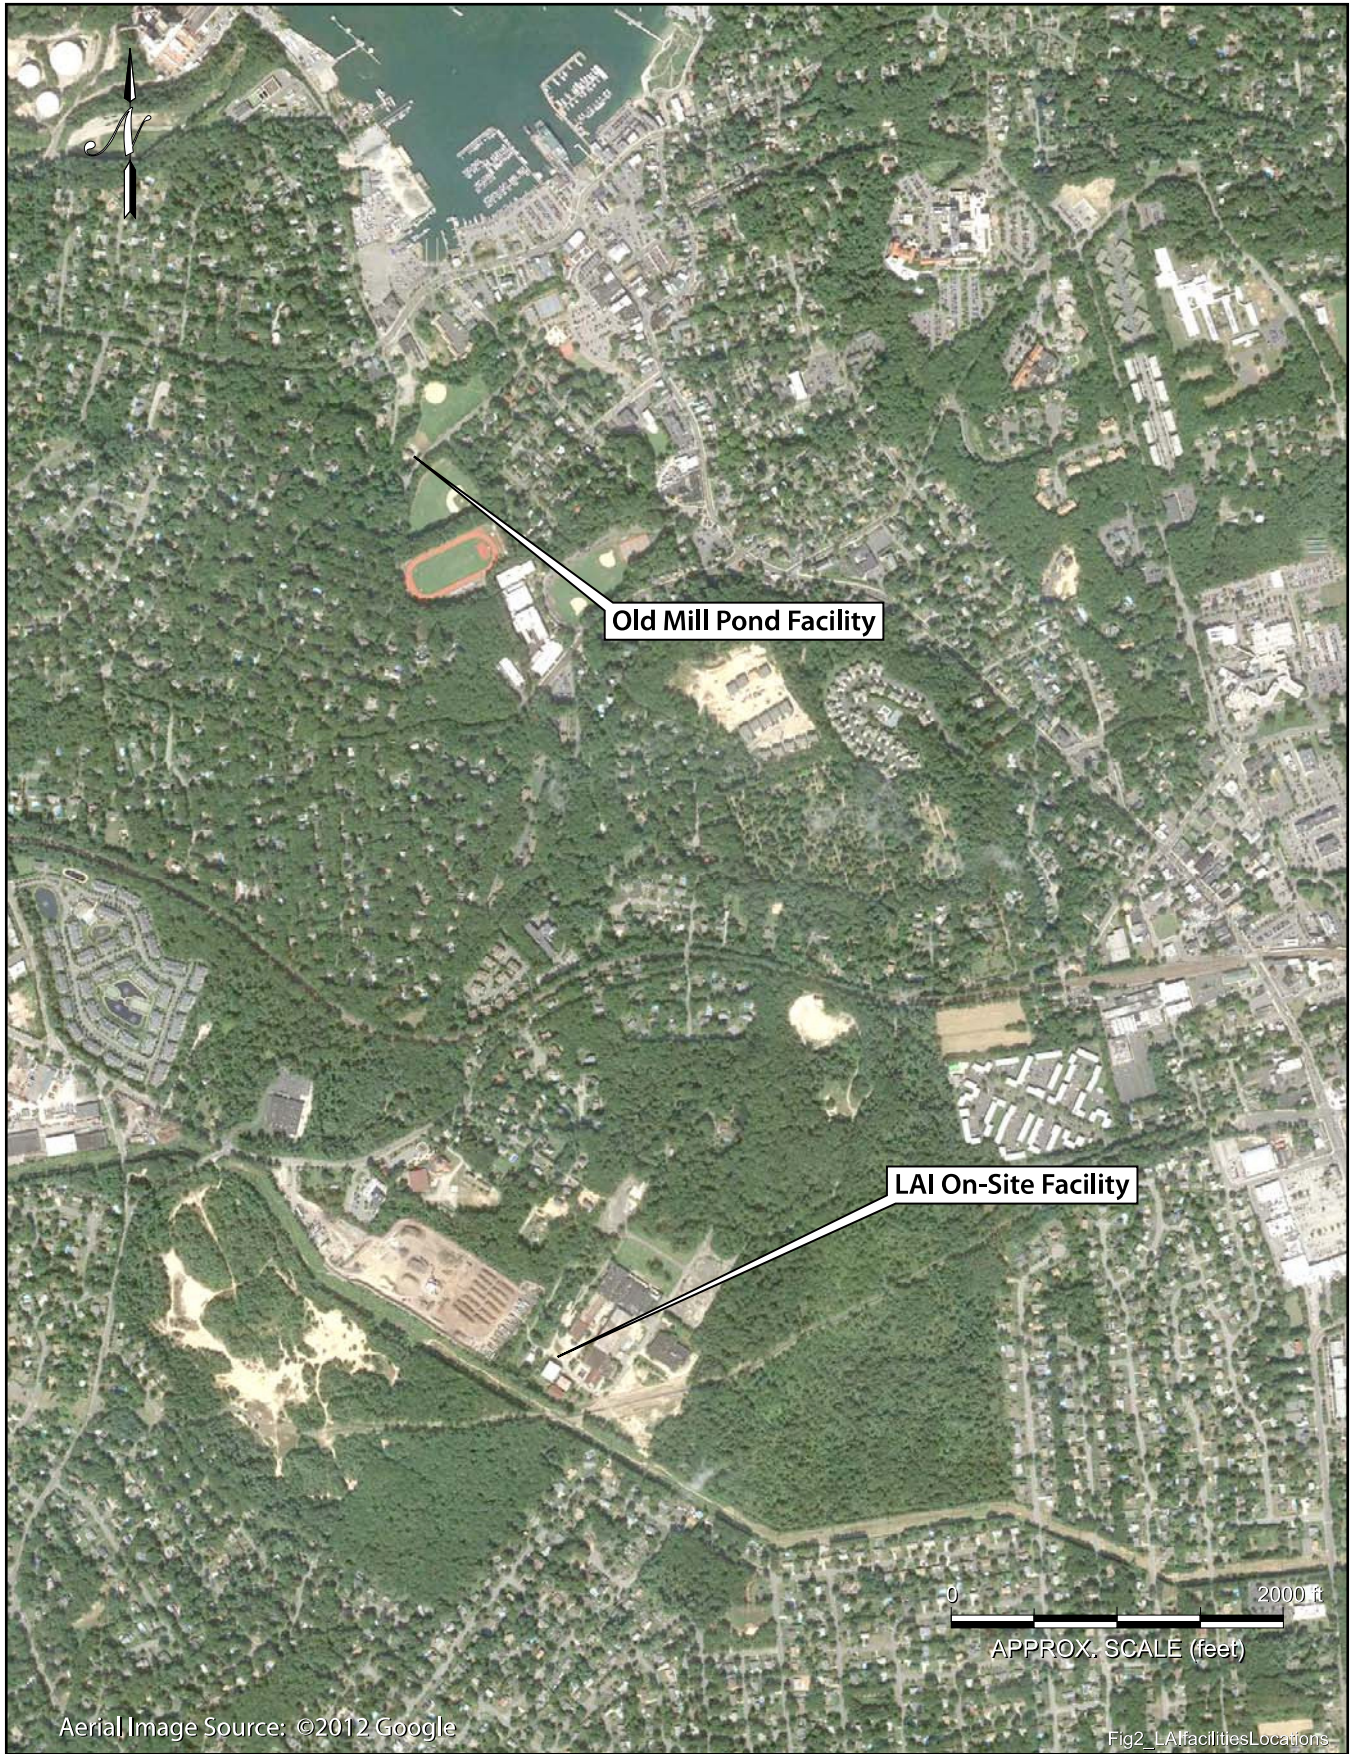

Aerial Image Source: ©2012 Google

Fig2_LAI facilities Locations



Henningson, Durham & Richardson
Architecture and Engineering, P.C.


1 International Blvd, 10th Floor
Mahwah, NJ 07495

LAI Facilities Locations

Lawrence Aviation Industries Superfund Site

Port Jefferson Station, New York

Figure
1-2

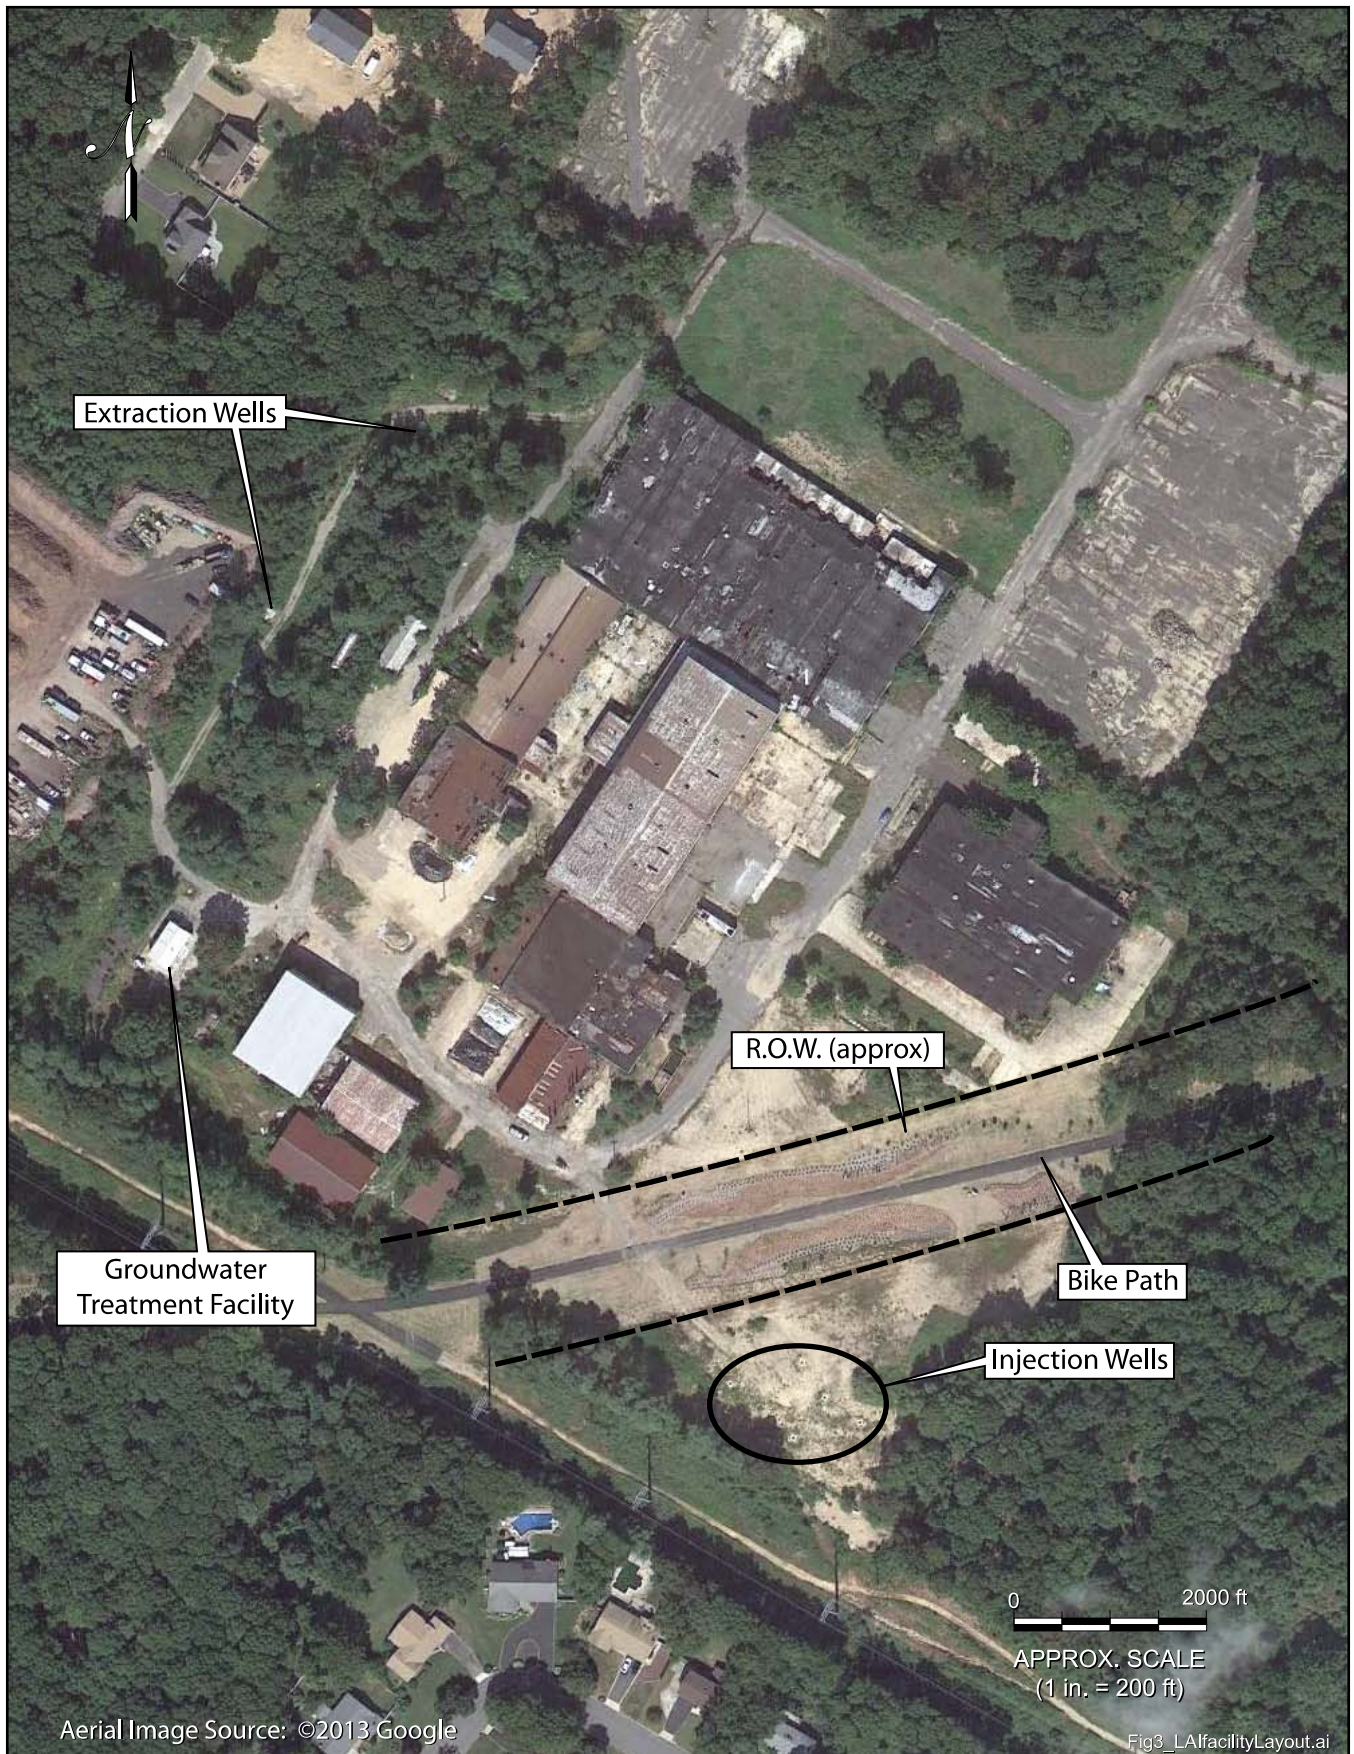

Henningson, Durham & Richardson
Architecture and Engineering, P.C.
1 International Blvd, 10th Floor
Mahwah, NJ 07495


LAI GWTF Layout

Lawrence Aviation Industries Superfund Site

Port Jefferson Station, New York

Figure

1-3

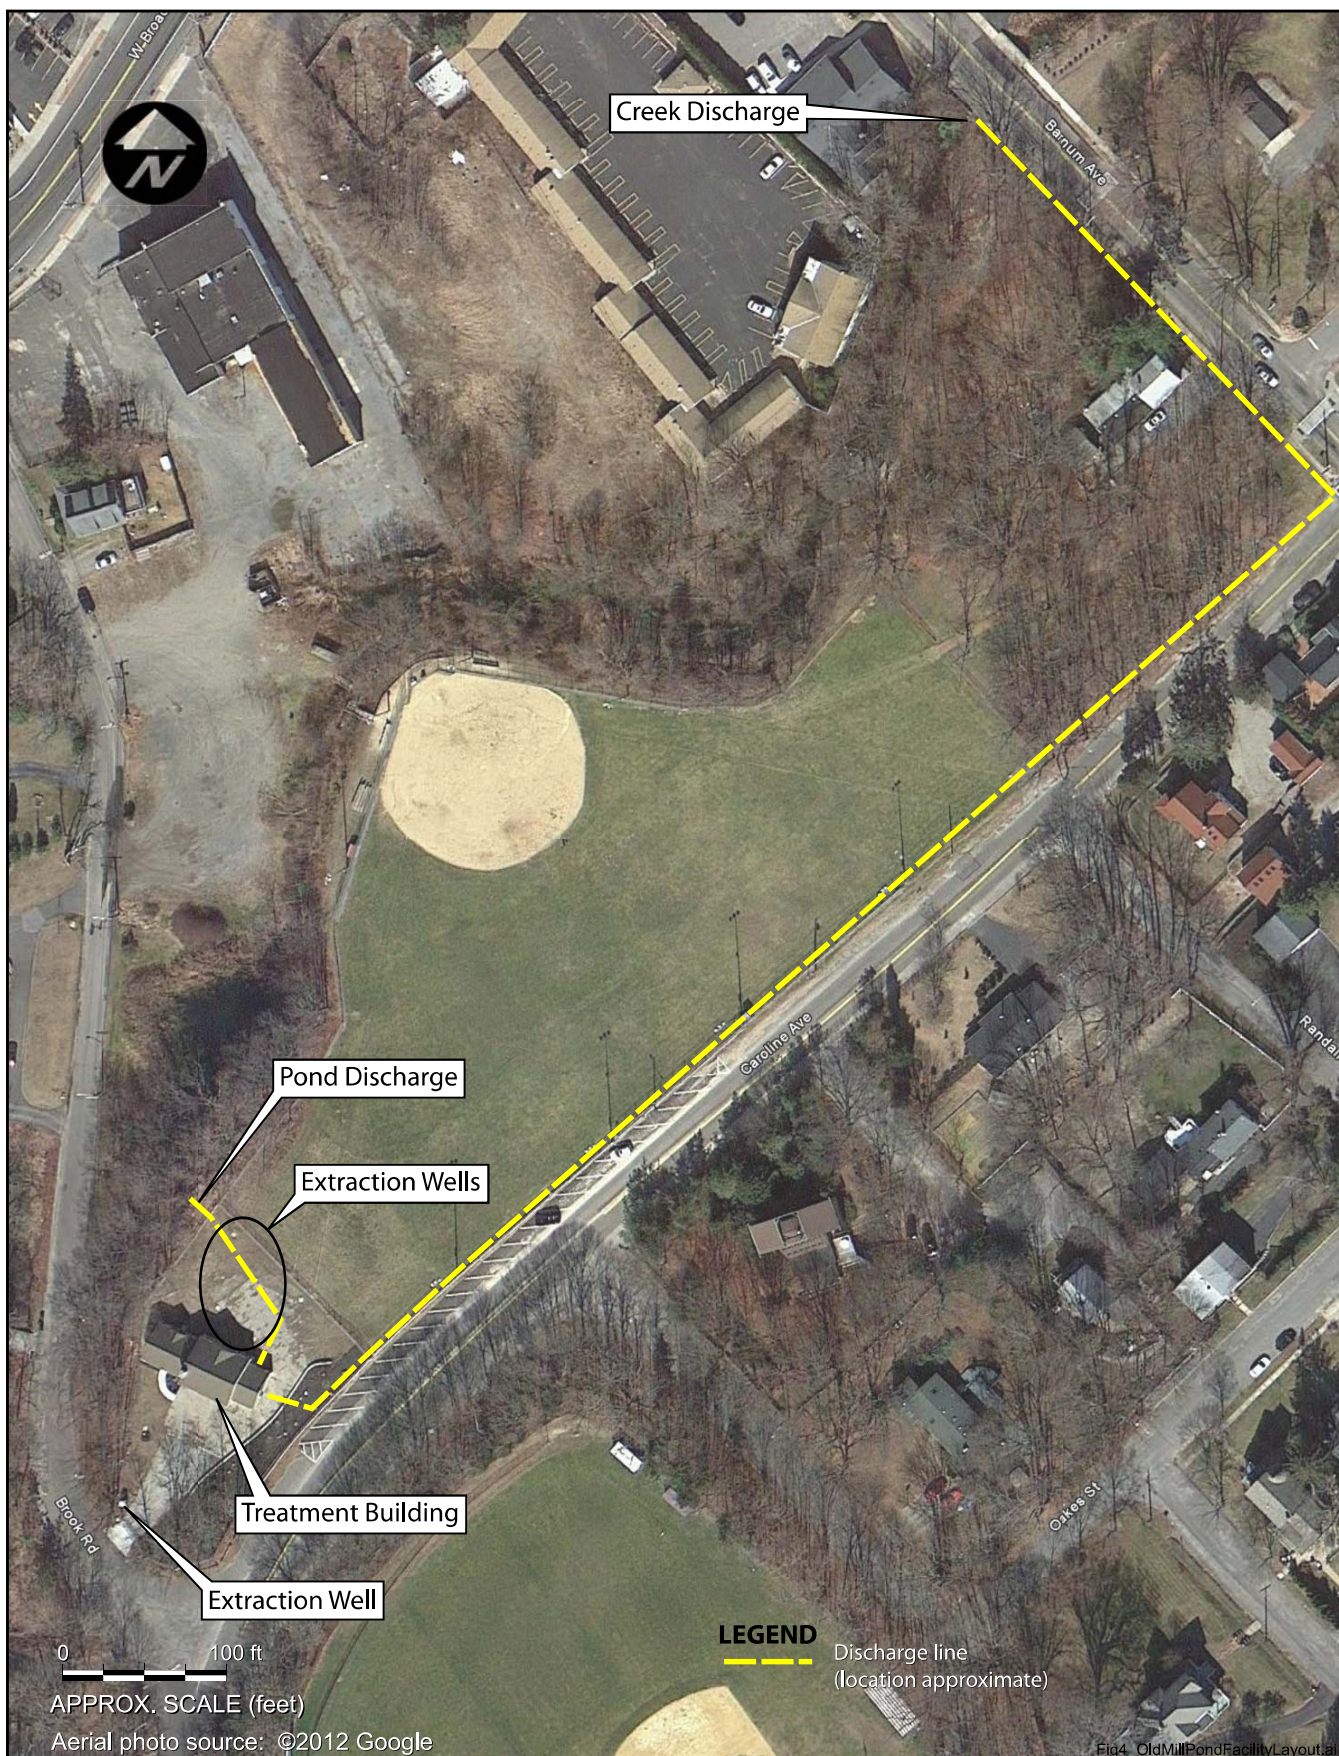

Henningson, Durham & Richardson
Architecture and Engineering, P.C.


1 International Blvd., 10th Floor
Mahwah, NJ 07495

Old Mill Pond GWTF Layout

Lawrence Aviation Industries Superfund Site


Port Jefferson Station, New York

Figure
1-4

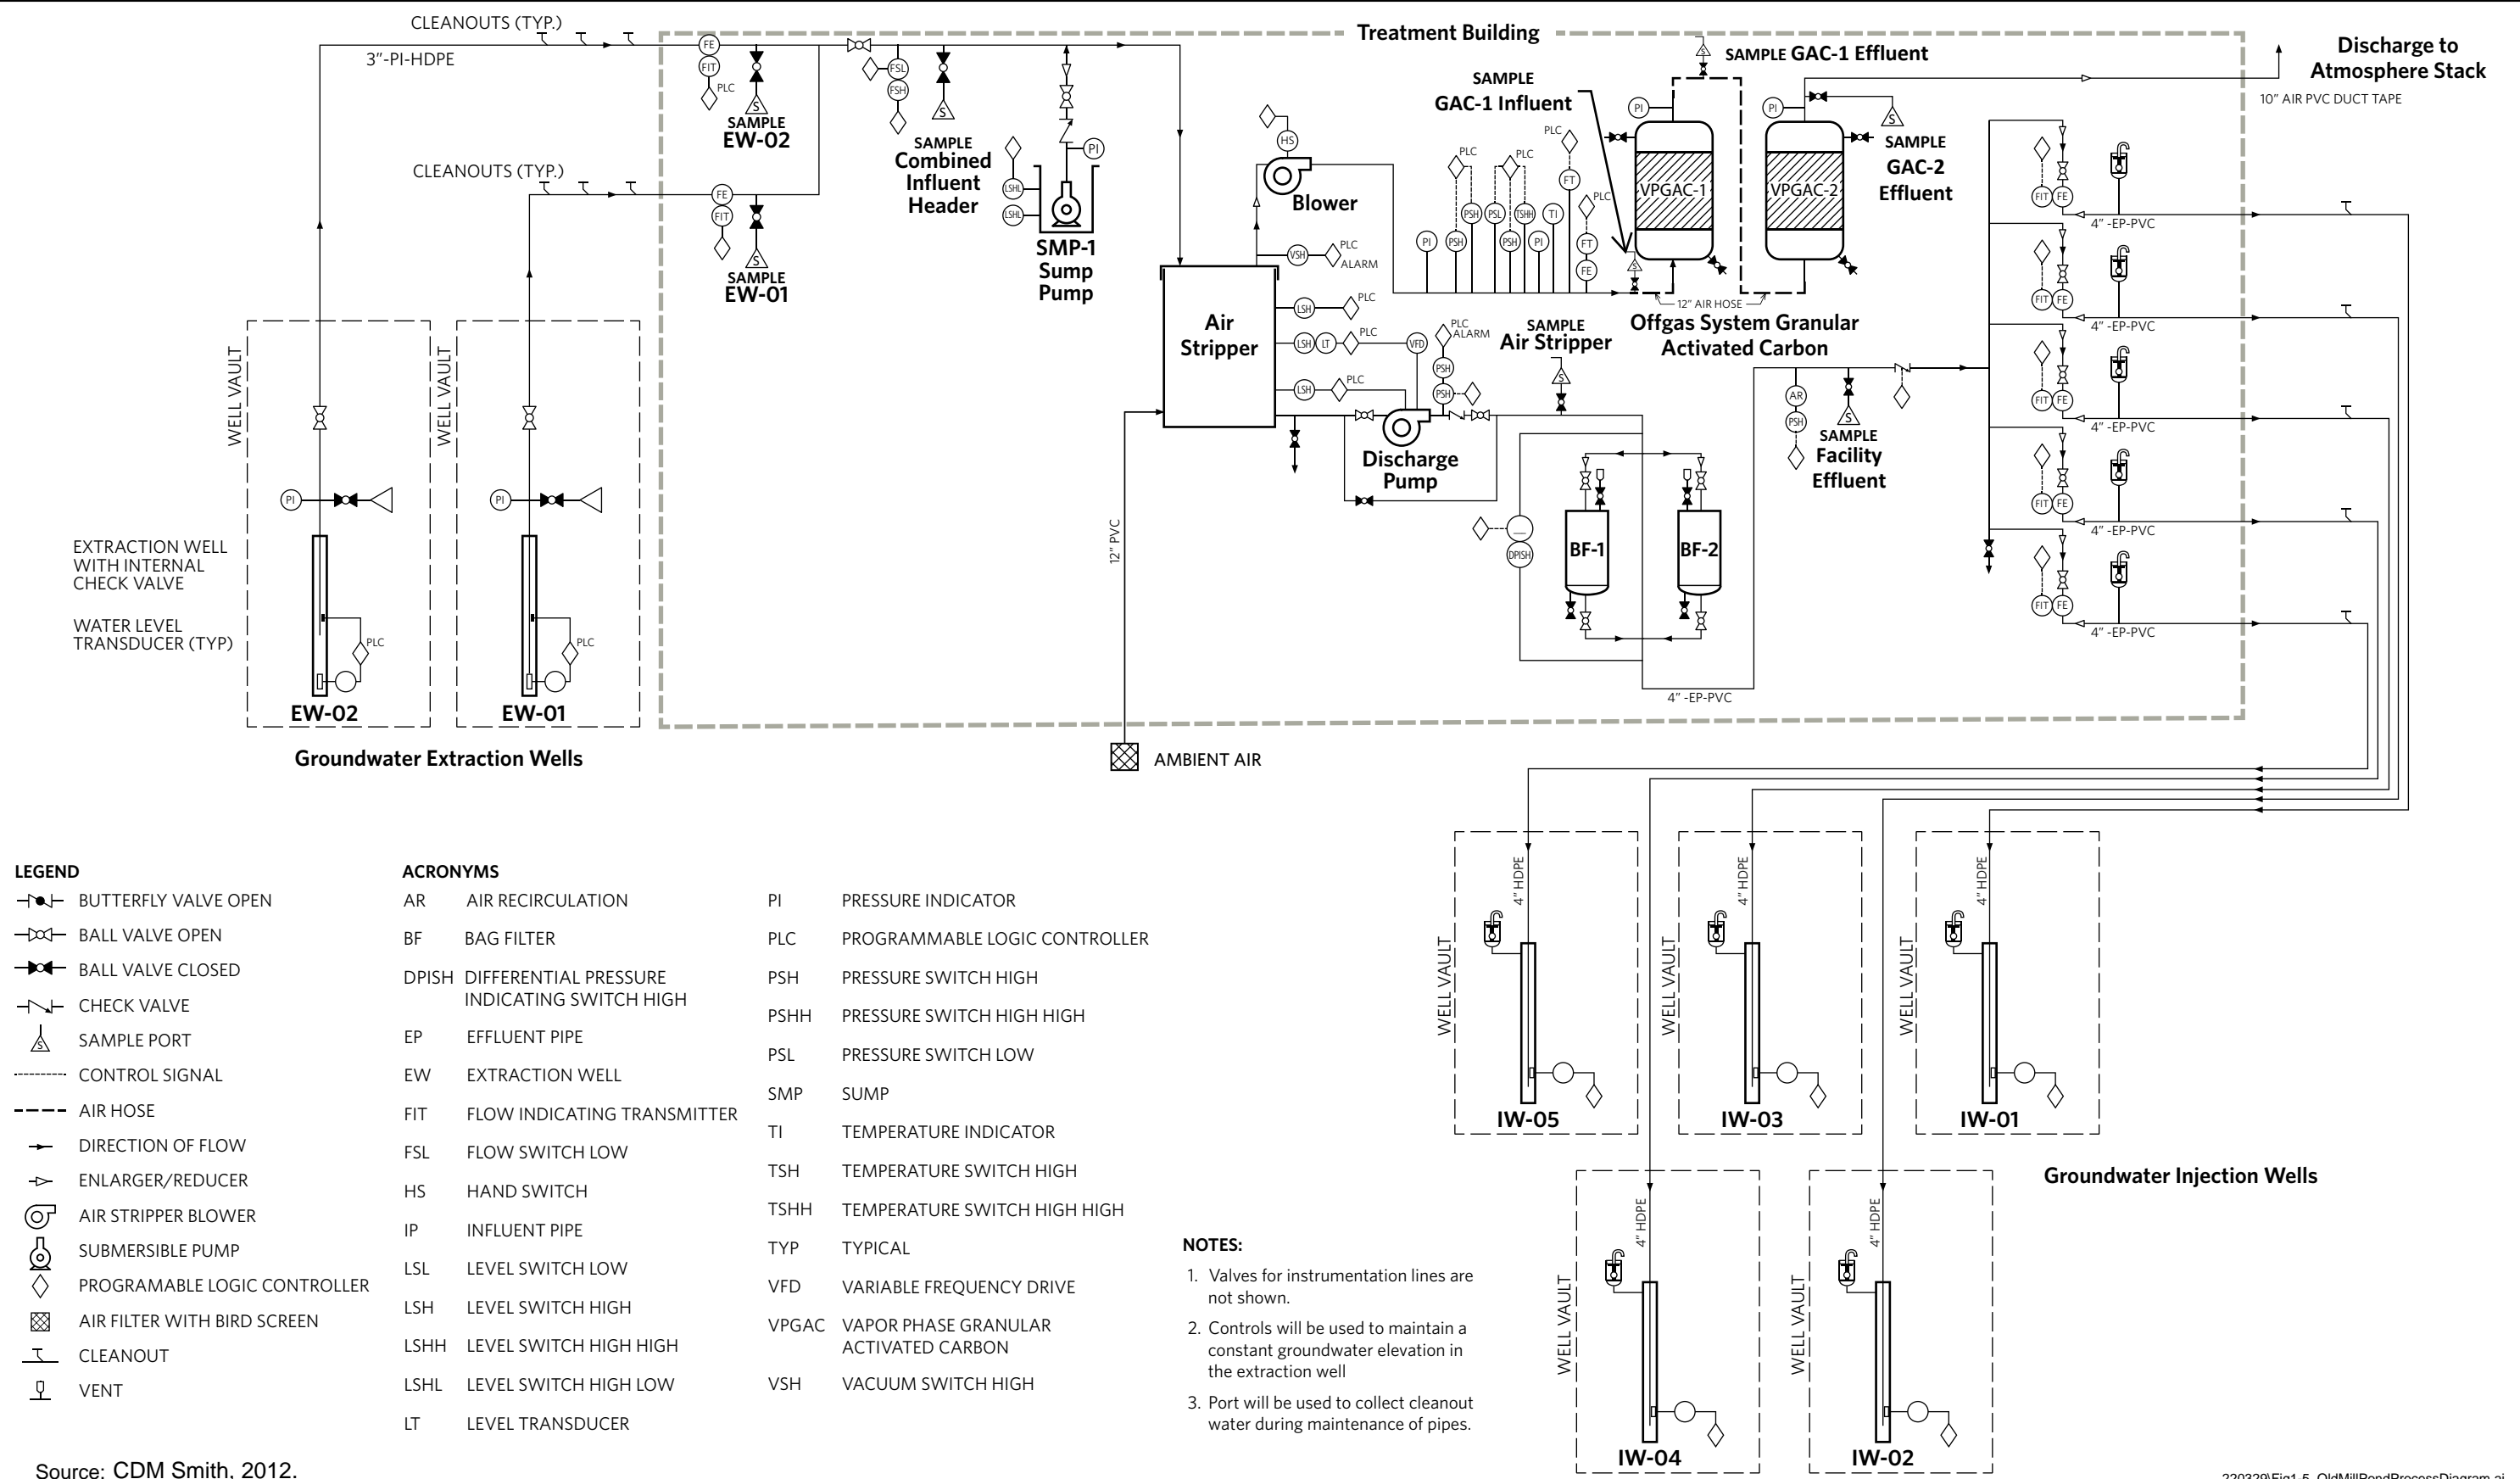

Source: CDM Smith, 2012.

220329\Fig1-5_OldMillPondProcessDiagram.ai

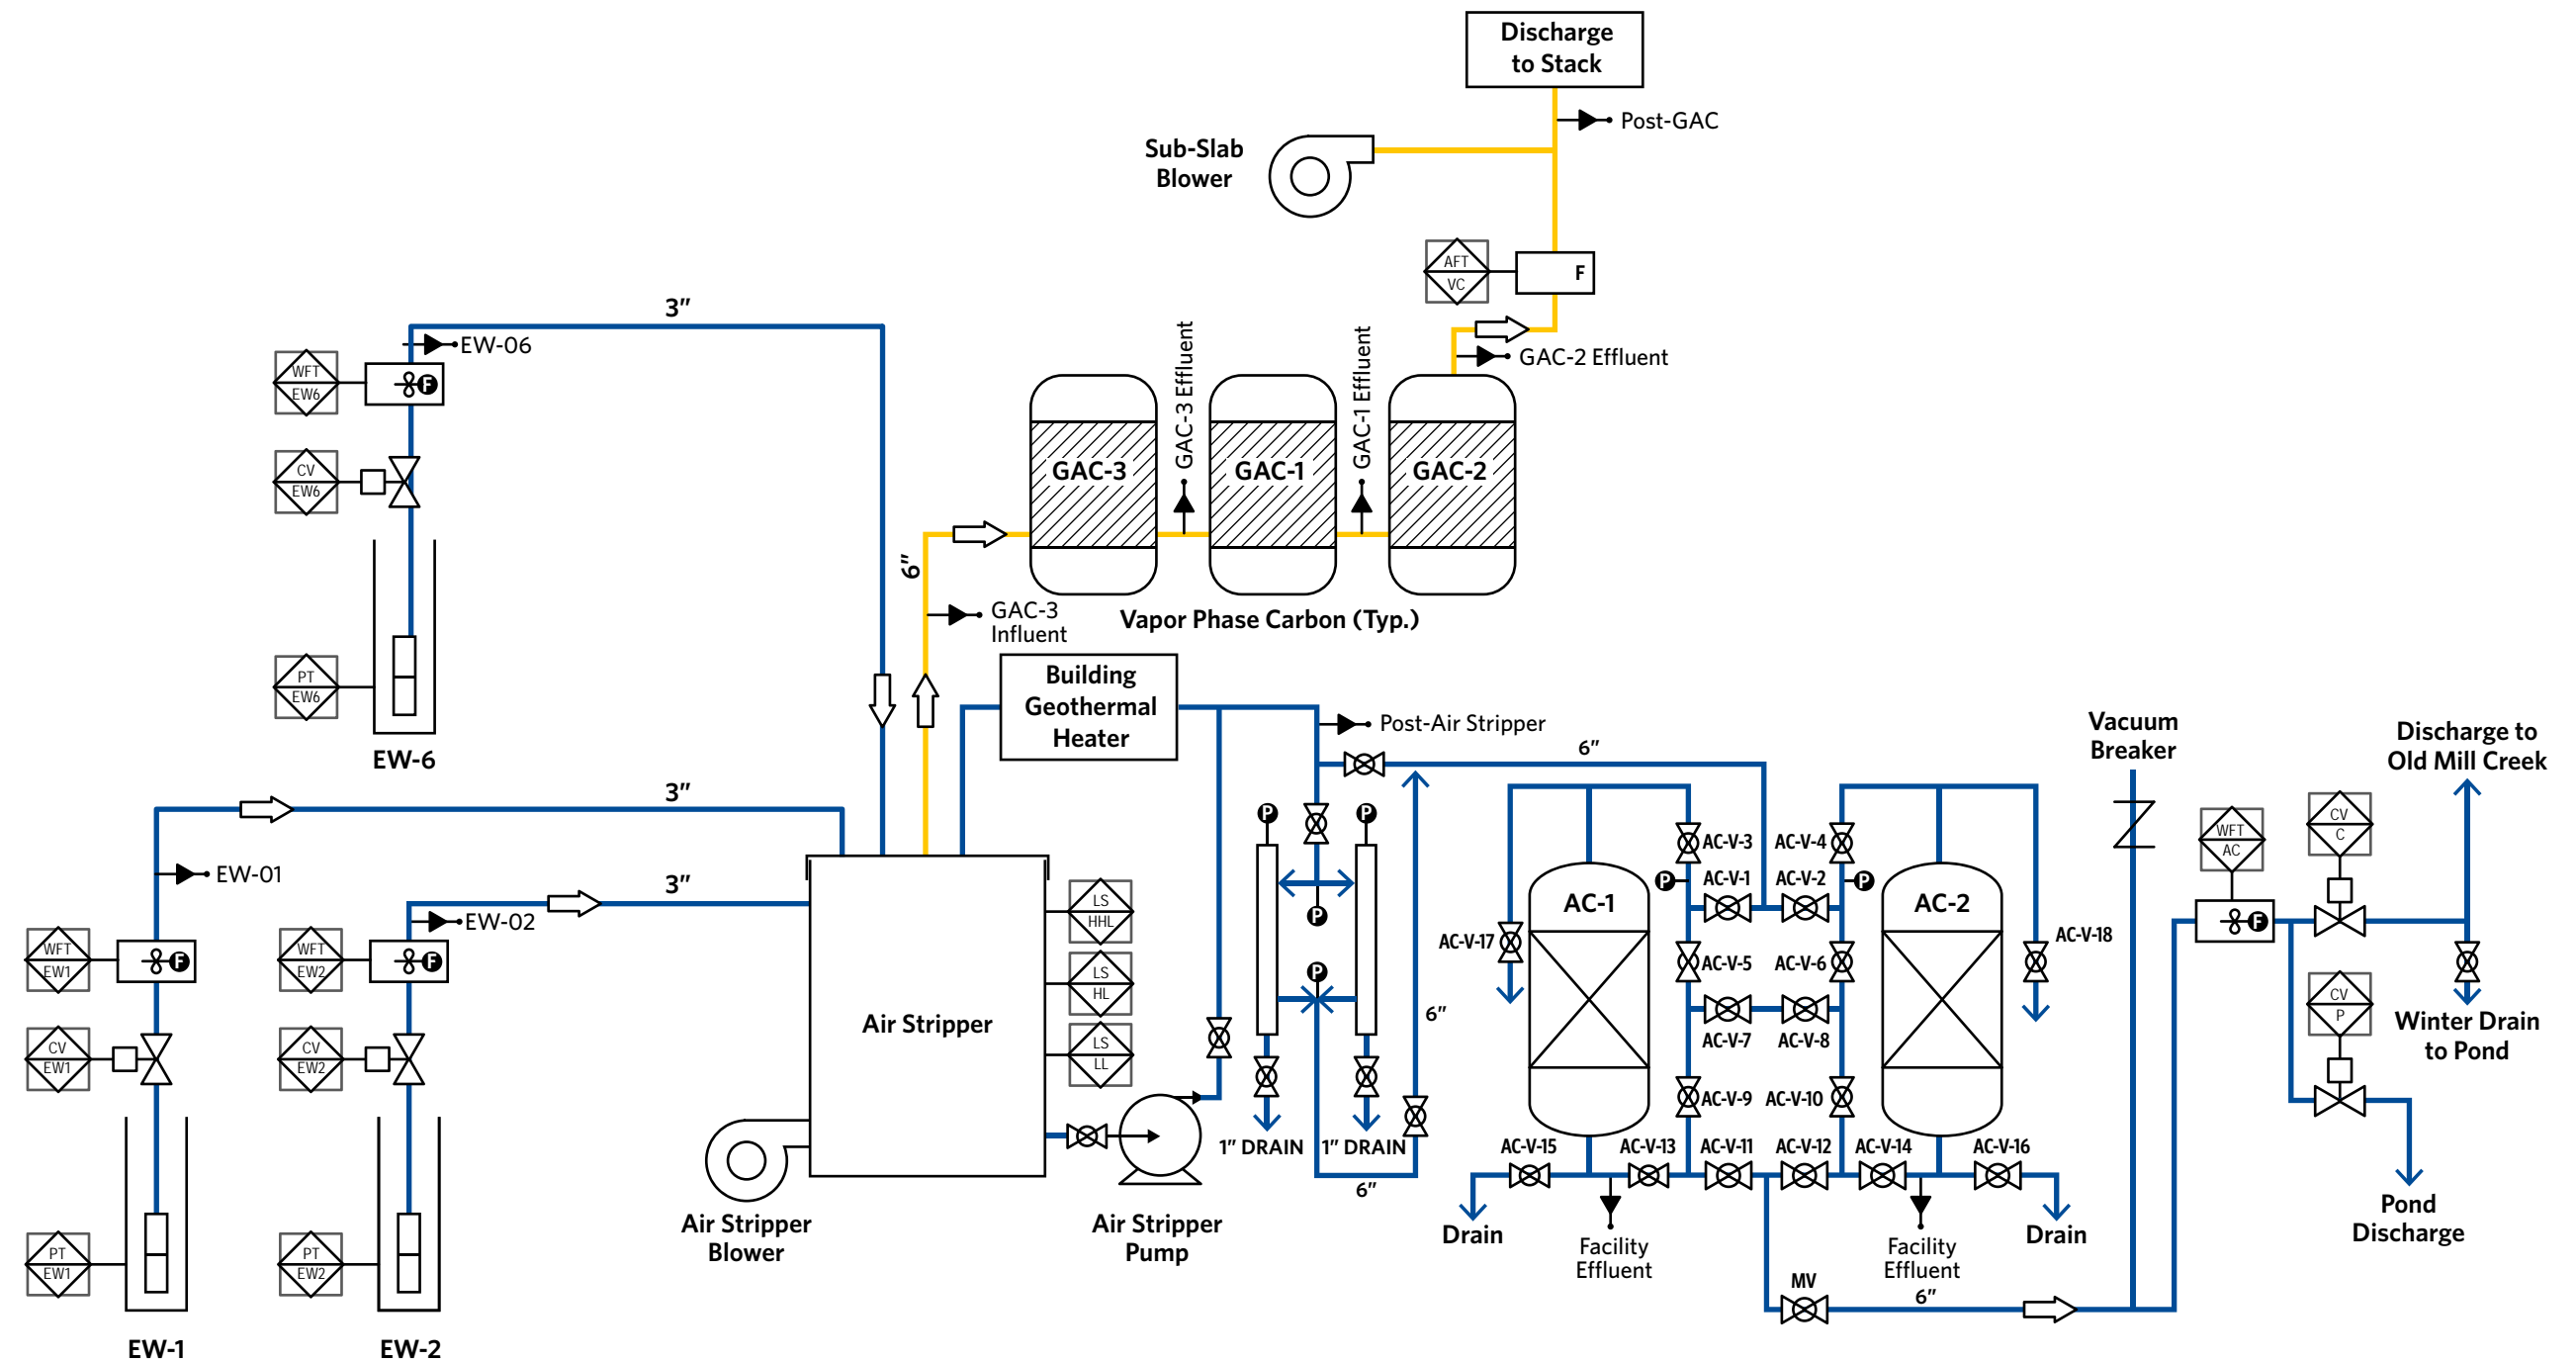

WFT - Water Flow Transmitter
FCV - Flow Control Valve
PT - Pressure Transmitter
HHL - High High Level
HL - High Level
LL - Low Level
TT - Temperature Transmitter
pHT - pH Transmitter
CT - Conductivity Transmitter
AFT - Air Flow Transmitter
CV - Control Valve

WFM - Water Flow Meter
SP - Sample Port
F - Flow Meter
IW - Injection Well
MW - Monitoring Well
EW - Extraction Well
MV - Manual Valve
AC - Activated Carbon
P - Pressure
VB - Vacuum Breaker
LS - Level Sump

Water Piping
Air Piping

Submersible Groundwater Pump
Sample Port
Inline Flow Meter
Insertion Flow Meter

Powered Valve
Butterfly Valve
Liquid Transfer Pump
Centrifugal Blower

Pressure Gauge
PLC Input
Flow Direction

Source: Environmental Restoration, LLC, 2012.

220329\Fig1-6_OldMillPondProcessDiagram.ai



HDR Engineering, Inc.
1 International Blvd.
Mahwah, NJ 07495

Lawrence Aviation Industries Superfund Site
Port Jefferson Station, New York

OMP GWTF Process Diagram
and Sample Locations

Figure
1-6

Figure 2-1
Influent CVOC Concentrations and Mass Removed vs. Time- EW-01
Lawrence Aviation Industries Groundwater Treatment Facility
Lawrence Aviation Industries Site, Port Jefferson Station, NY

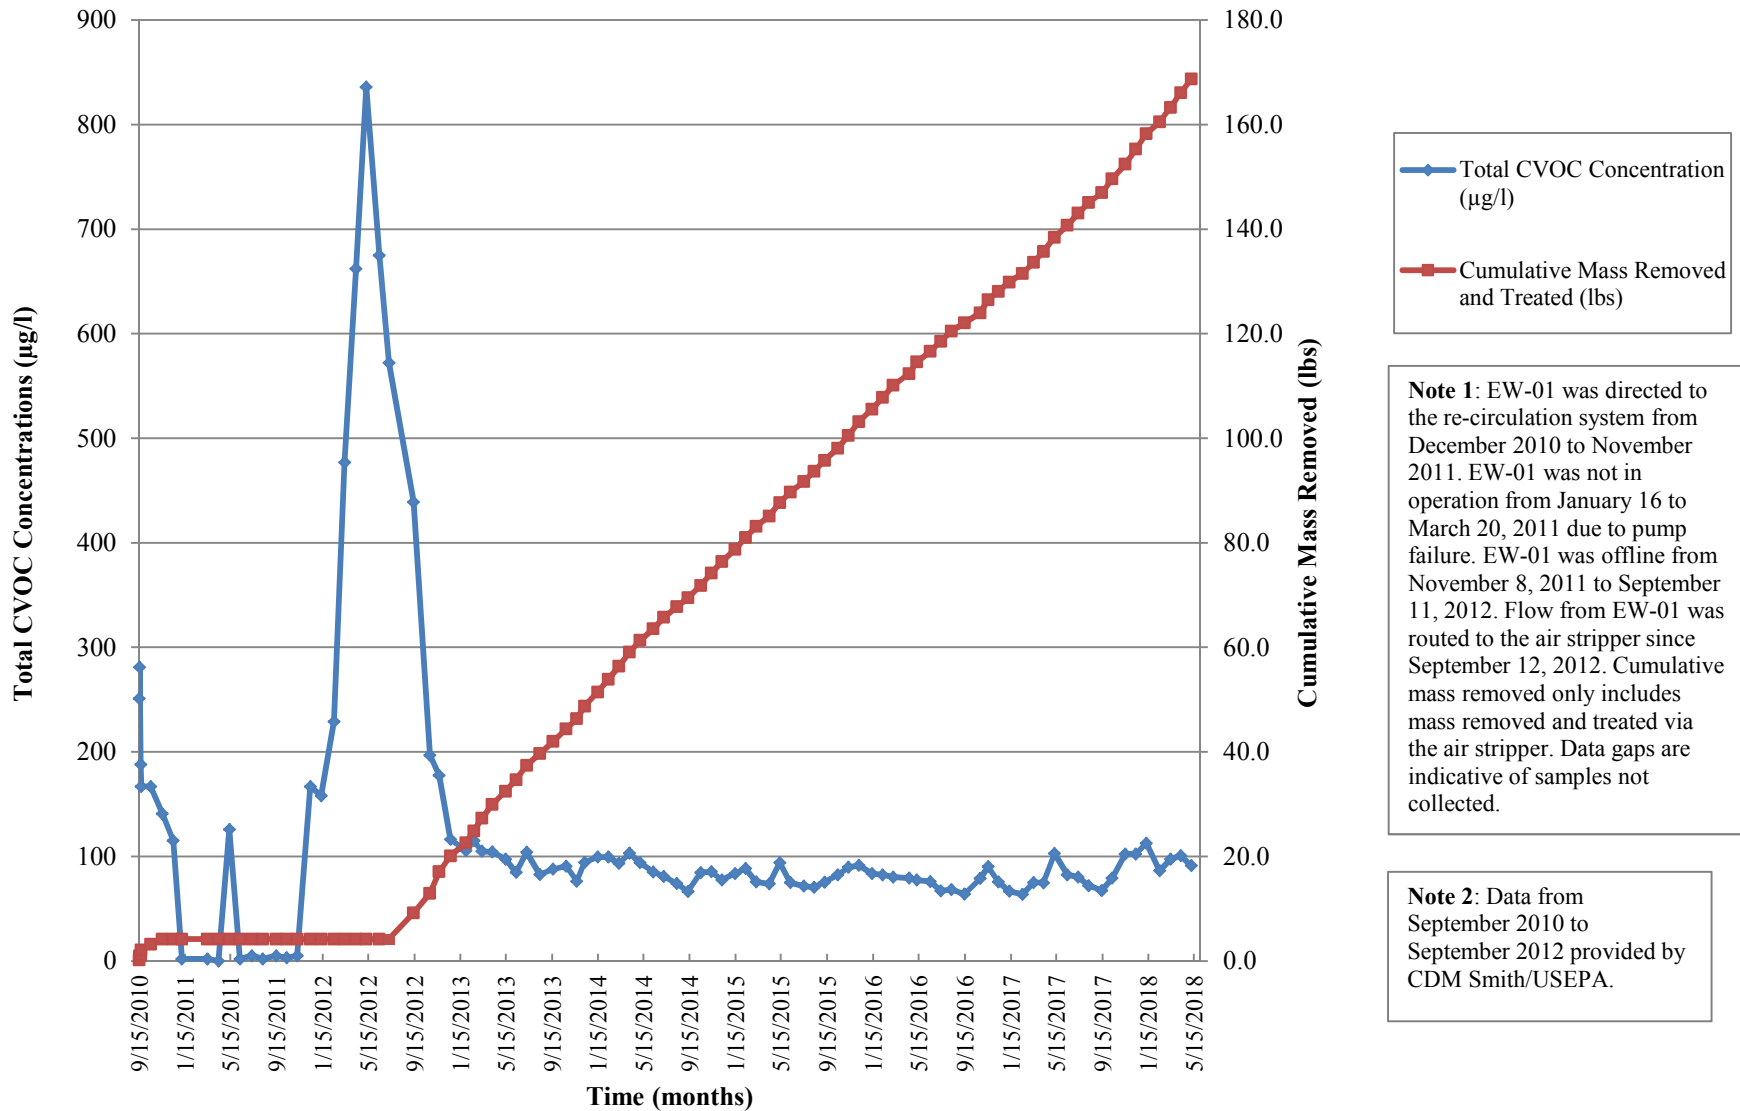


Figure 2-2
Influent CVOC Concentrations and Mass Removed vs. Time- EW-02
Lawrence Aviation Industries Groundwater Treatment Facility
Lawrence Aviation Industries Site, Port Jefferson Station, NY


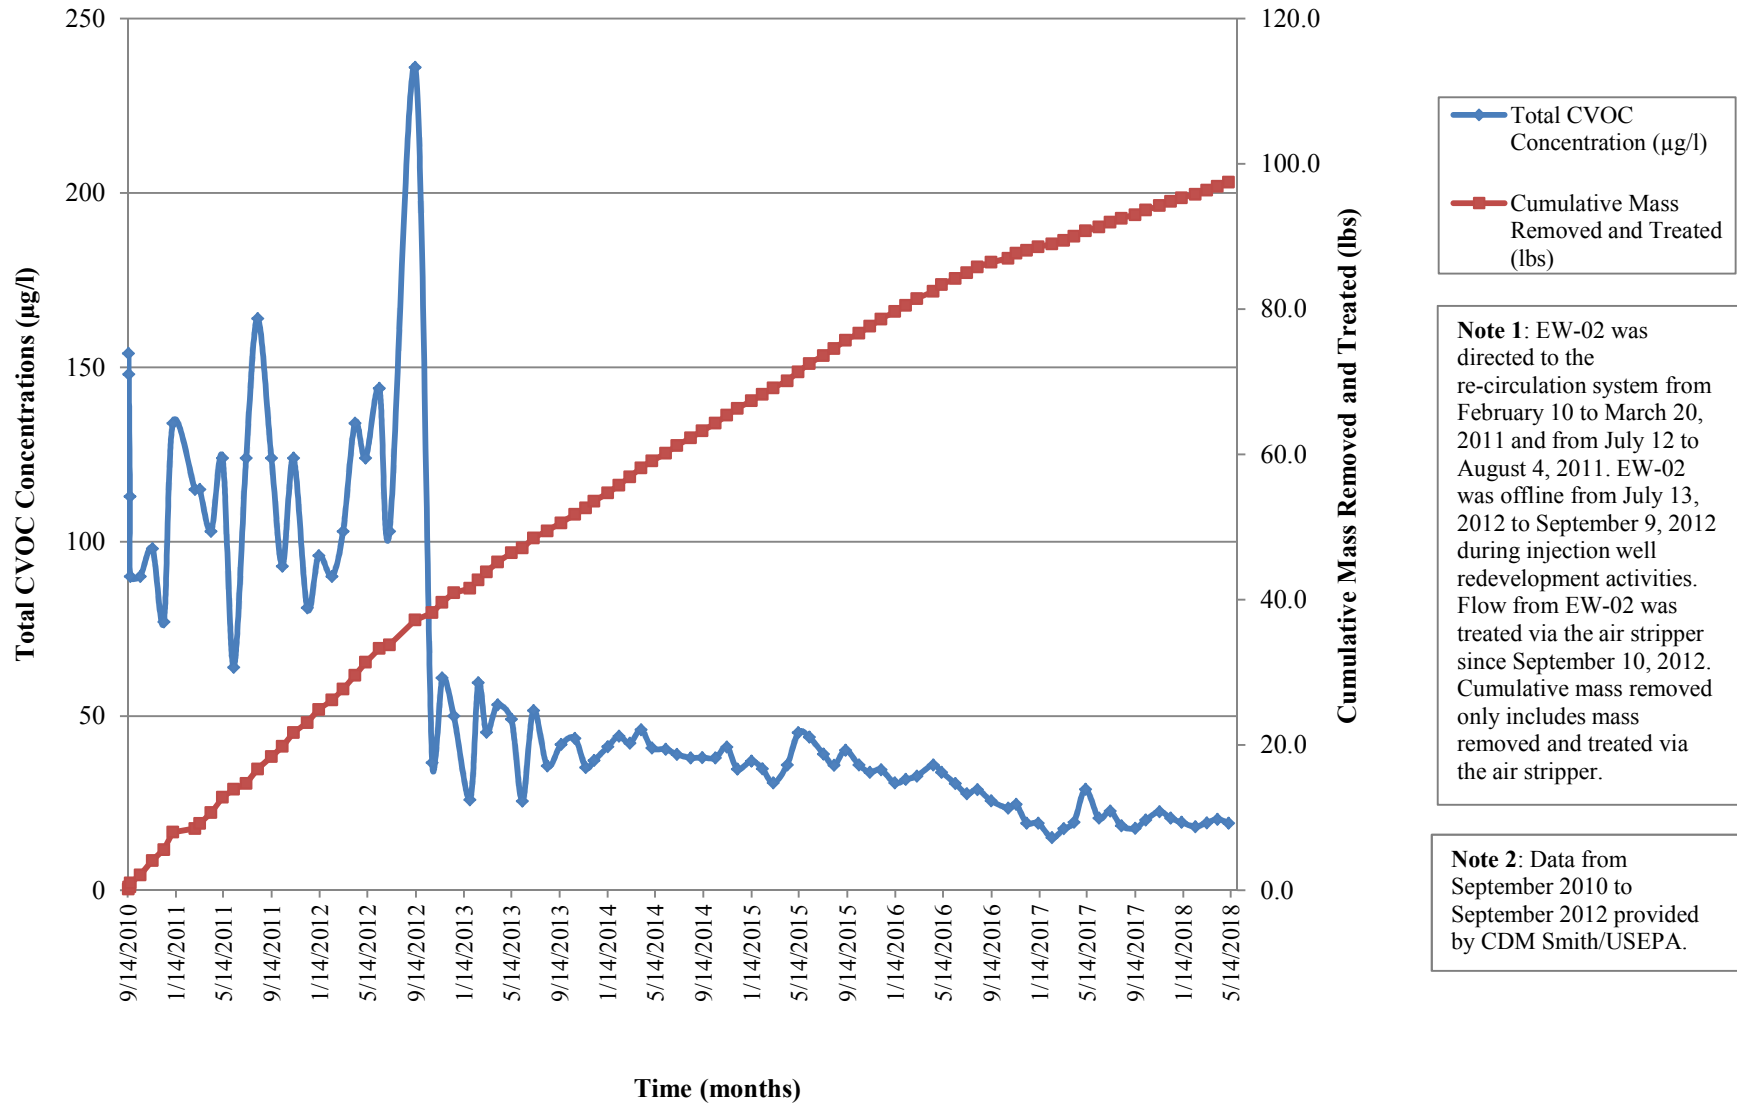


Figure 3-1
Influent CVOC Concentrations and Mass Removed vs. Time- EW-1
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Site, Port Jefferson Station, NY

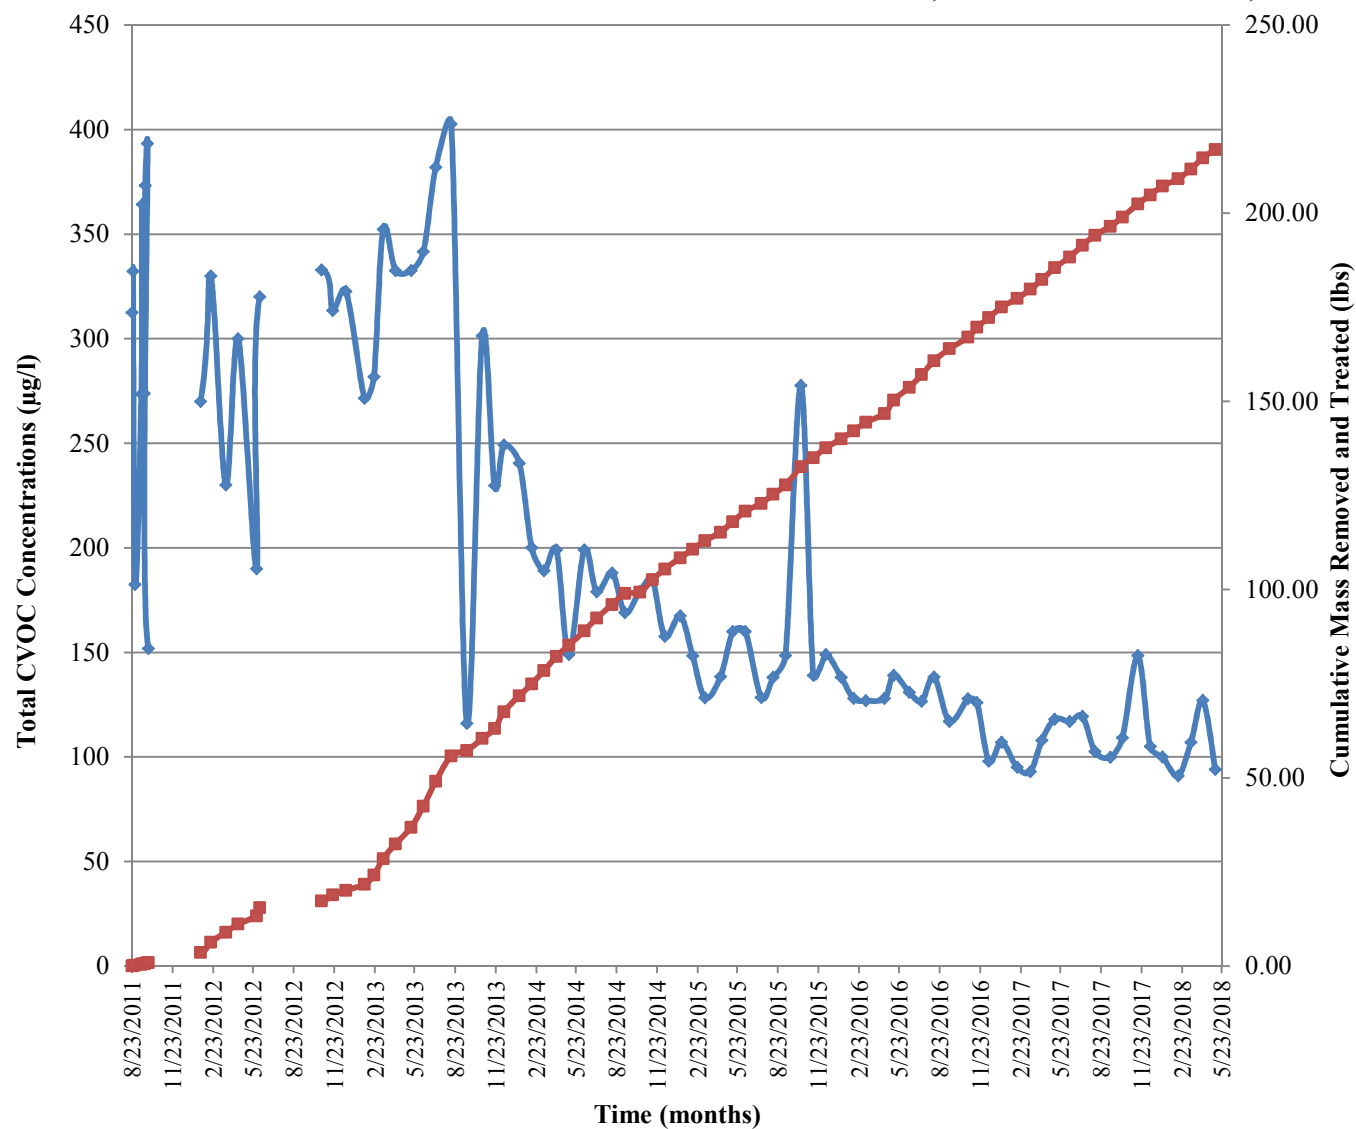

Note 1: No samples were collected from October to December 2011 due to change in sampling strategy. Cumulative mass removed only includes mass removed and treated via the air stripper. No sample was collected in September 2013 due to laboratory constraints. Total CVOC concentrations for September 2013 was estimated.

Note 2: Data from August 2011 to June 2012 provided by USEPA/ERT. Data for July to September 2012 will be

—◆— Total CVOCs Concentrations (µg/l)

Figure 3-2
Influent CVOC Concentrations and Mass Removed vs. Time- EW-2
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Site, Port Jefferson Station, NY


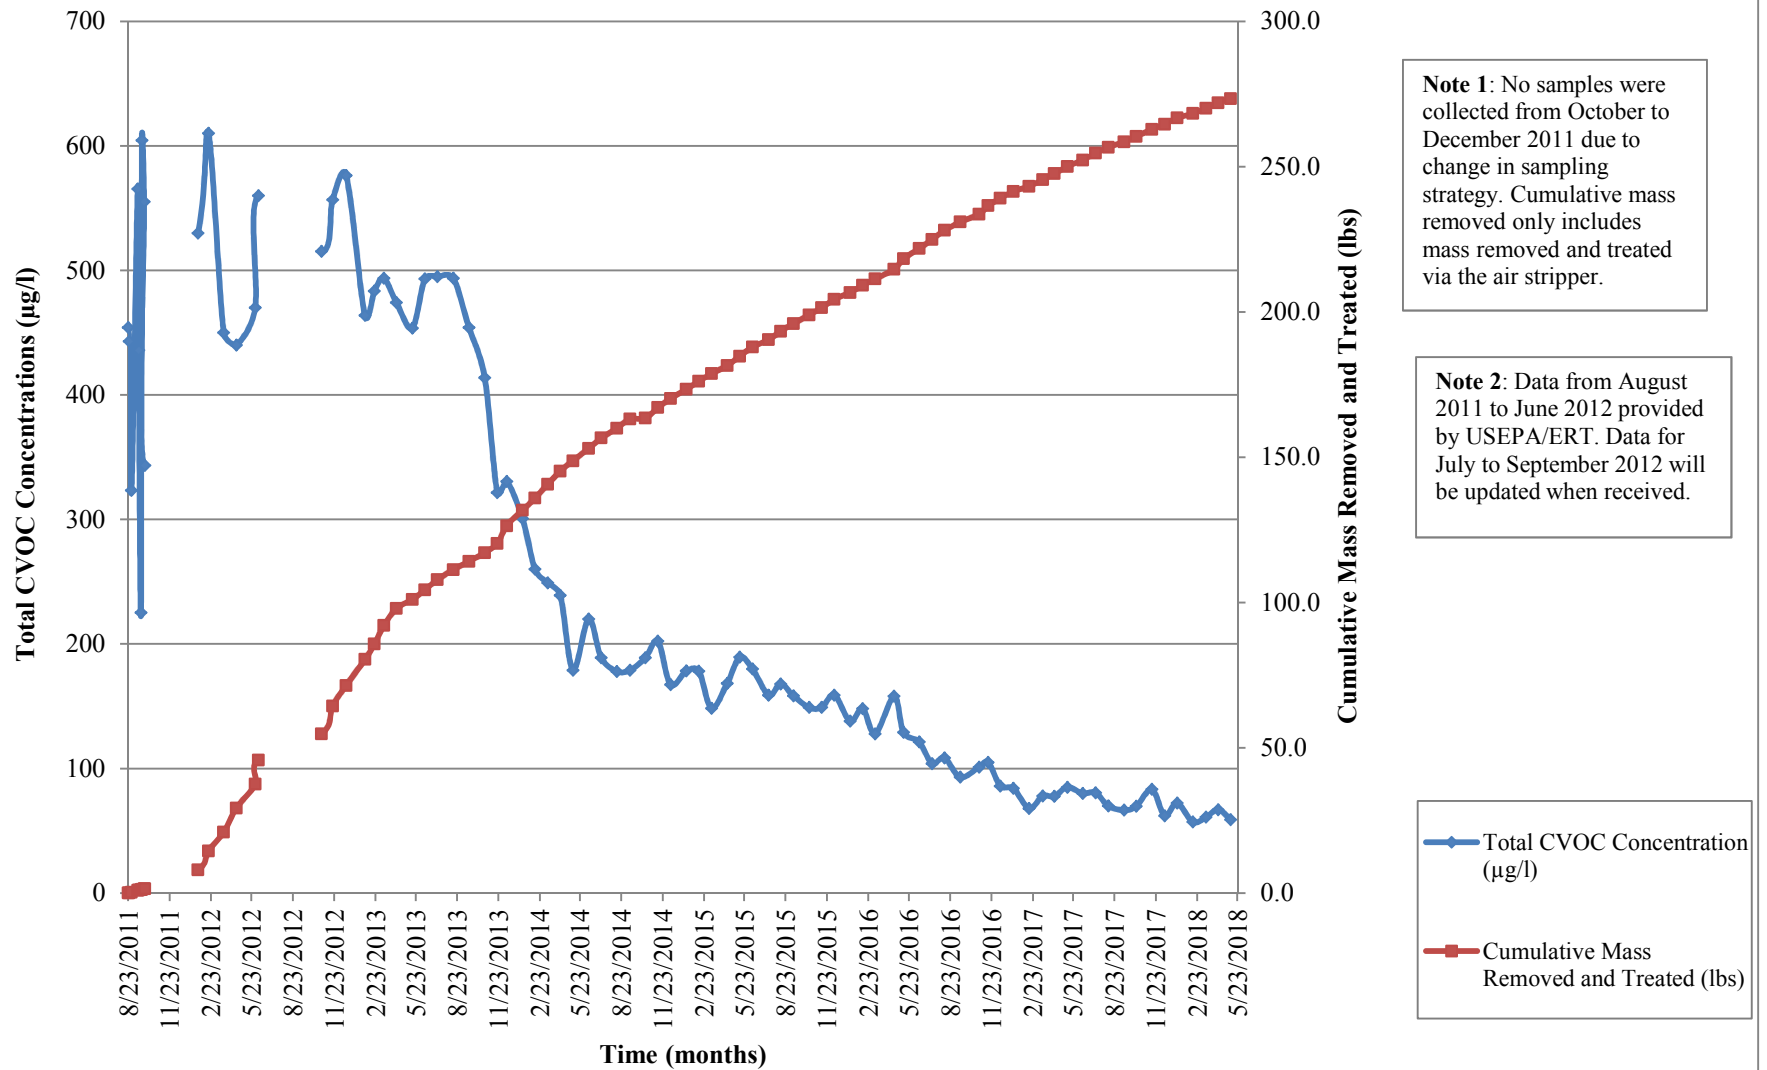


Figure 3-3
Influent CVOC Concentrations and Mass Removed vs. Time- EW-6
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Site, Port Jefferson Station, NY

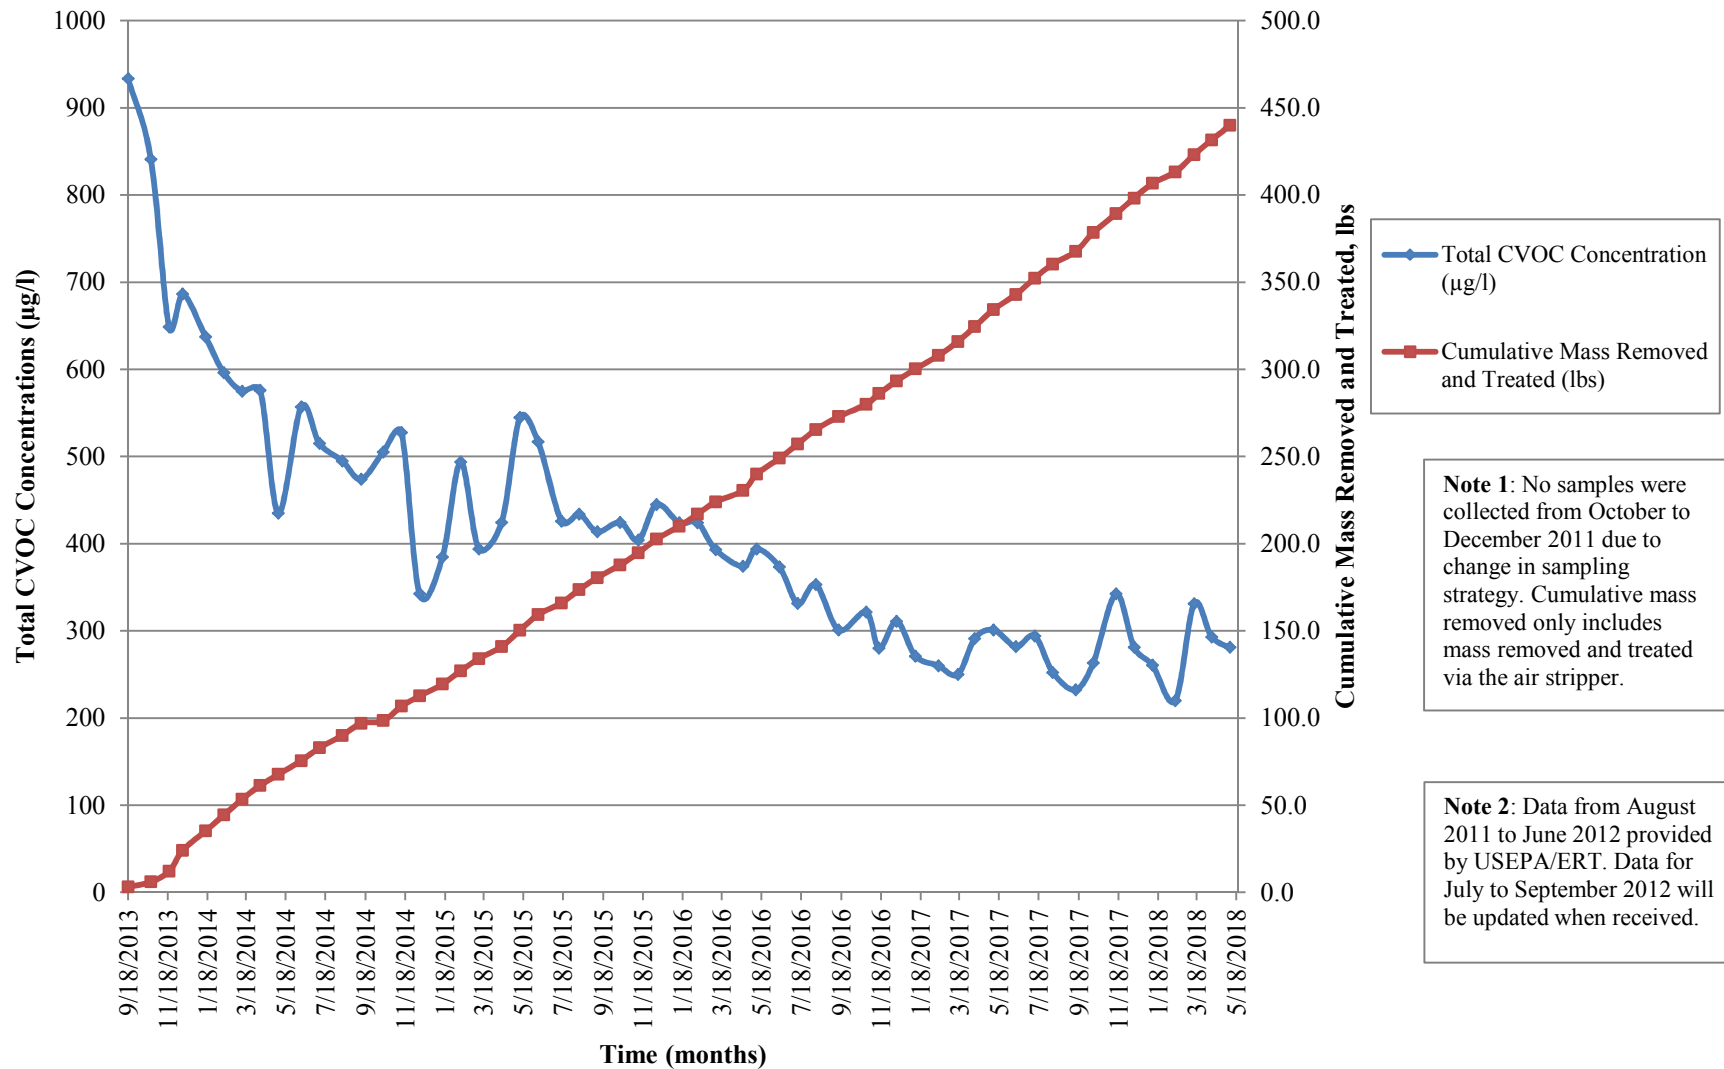

TABLES

Table 1-1
Summary of Well Construction Details
Lawrence Aviation Industries Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Well ID | Surface Elevation (ft amsl) | Top of Casing (ft amsl) | Total Depth (ft bgs) | Diameter of Well (inches) | Top of Screened Interval (ft bgs) | Bottom of Screened Interval (ft bgs) | Top of Screened Interval (ft amsl) ¹ | Bottom of Screened Interval (ft amsl) ¹ |
|---------|-----------------------------|-------------------------|----------------------|---------------------------|-----------------------------------|--------------------------------------|---|--|
| EW-01 | 220.8 * | 219.30 | 252 | 10 | 182 * 238 * | 222 * 248 * | 38.8 * -17.2 * | -1.2 * -27.2 * |
| EW-02 | 224.1 * | 222.61 | 250 | 10 | 182 * 229 * | 214 * 240 * | 42.1 * -4.9 * | 10.1 * -15.9 * |
| IW-01 | 226.3 * | 225.99 | 258 | 6 | 183 | 248 | 43.3 * | -21.7 * |
| IW-02 | 225.6 * | 225.27 | 258 | 6 | 183 | 248 | 42.6 * | -22.4 * |
| IW-03 | 225.3 * | 224.99 | 258 | 6 | 183 | 248 | 42.3 * | -22.7 * |
| IW-04 | 226.0 * | 225.68 | 258 | 6 | 183 | 248 | 43.0 * | -22.0 * |
| IW-05 | 224.8 * | 224.48 | 258 | 6 | 183 | 248 | 41.8 * | -23.2 * |

Notes:

1. Coordinates based on Horizontal Datum : NAD 1983, SPC (3104 NY L); Vertical Datum: NAVD 1988

* Elevations are estimated.

Acronyms:

ID - identification

ft - feet

amsl- above mean sea level

NY - New York

NAVD - North American Vertical Datum

NAD - North American Datum

SPC - State Plane Coordinates

L - lambr projections

bgs - below ground surface

EW- extraction well

IW - injection well

Table 1-2
Summary of Well Construction Details
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Site, Port Jefferson Station, New York

| Well ID | Top of Casing Elevation ¹ (ft amsl) | Total Depth (ft btc) | Diameter of Well (inches) | Top of Screened Interval (ft btc) | Bottom of Screened Interval (ft btc) |
|-------------------|---|---------------------------------|--------------------------------------|--|---|
| EW-1 ² | 22.58 | 139.7 | 6 | 120 | 140 |
| EW-2 ² | 22.76 | 109.4 | 6 | 90 | 110 |
| EW-3 ³ | 22.88 | 109.8 | 6 | 90 | 110 |
| EW-4 ³ | 22.56 | 79.5 | 6 | 60 | 80 |
| EW-5 ⁴ | 22.84 | 39.6 | 4 | 20 | 40 |
| EW-6 ² | 18.97 | 127 | 6 | 90 | 120 |

Notes:

1. Measured by a licensed surveyor.
2. Currently being pumped for plume hydraulic control.
3. EW-3 and EW-4 are standby wells and are not used for groundwater extraction due to elevated iron levels.
4. EW-5 is not used for groundwater extraction since the well is not of adequate size or depth for a pump.

Acronyms:

ID - identification

ft - feet

amsl- above mean sea level

btc - below top of reference point on casing

EW - extraction well

Table 2-1
Summary of Monthly Operations
Lawrence Aviation Industries Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Item | Cumulative Year 2 ¹ | Cumulative Year 3 ¹ | Cumulative Year 4 ¹ | Cumulative Year 5 ¹ | Cumulative Year 6 ¹ | Oct. 2017 | Nov. 2017 | Dec. 2017 | Jan. 2018 | Feb. 2018 | Mar. 2018 | Apr. 2018 | May. 2018 | Notes |
|--|-----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|--|
| Calendar Days in Period | 365 | 365 | 365 | 366 | 365 | 31 | 30 | 31 | 31 | 28 | 31 | 30 | 31 | |
| Treatment System Runtime (hours) | | | | | | | | | | | | | | |
| EW-01 Runtime | 8,026 | 8,486 | 8,592 | 8,219 | 8,398 | 742 | 704 | 734 | 681 | 671 | 743 | 718 | 741 | Estimated based on Operator's notes and PLC logs. |
| EW-02 Runtime | 8,035 | 8,490 | 8,600 | 8,574 | 8,420 | 743 | 704 | 734 | 681 | 671 | 739 | 717 | 743 | |
| Treatment System Downtime (hours) | | | | | | | | | | | | | | |
| Planned | 173 | 92 | 49 | 19 | 169 | 2.00 | 0.00 | 8.50 | 44.50 | 1.25 | 0.50 | 0.00 | 0.25 | greasing blower motor and pump parts |
| Unplanned | 554 | 177 | 95 | 90 | 171 | 0.00 | 16.50 | 1.00 | 20.00 | 0.00 | 0.00 | 3.00 | 0.75 | shutdowns of air stripper blower, extraction wells, and high water level alarms. |
| System Uptime | 91.7% | 96.9% | 98.3% | 98.8% | 96.2% | 99.7% | 97.7% | 98.7% | 91.3% | 99.8% | 99.9% | 99.6% | 99.9% | |
| Treatment Summary | | | | | | | | | | | | | | |
| Gallons extracted from EW-01 | 35,092,444 | 37,425,150 | 39,360,108 | 37,911,184 | 38,807,936 | 3,463,040 | 3,283,328 | 3,387,552 | 3,147,024 | 3,116,464 | 3,425,984 | 3,313,920 | 3,437,552 | Estimated based on Operator's notes and PLC logs. |
| Average flow rate from EW-01 (gpm) | 73 | 73 | 76 | 77 | 77 | 78 | 78 | 77 | 77 | 77 | 77 | 77 | 77 | |
| Gallons extracted from EW-02 | 36,103,992 | 37,304,570 | 39,182,852 | 39,850,976 | 38,342,384 | 3,233,168 | 3,237,872 | 3,342,576 | 3,105,312 | 3,068,144 | 3,381,024 | 3,266,288 | 3,388,432 | |
| Average flow rate from EW-02 (gpm) | 75 | 73 | 76 | 77 | 76 | 73 | 77 | 76 | 76 | 76 | 76 | 76 | 76 | |
| Total gallons treated | 71,196,436 | 74,729,720 | 78,542,960 | 77,762,160 | 77,150,320 | 6,696,208 | 6,521,200 | 6,730,128 | 6,252,336 | 6,184,608 | 6,807,008 | 6,580,208 | 6,825,984 | |

Acronyms:

gpm - gallons per minute
% - percentage

Notes:

1. Monthly data from October 2012 through September 2017 collected by HDR provided in Appendix F.

Table 2-2
Summary of Extraction Well Groundwater Influent CVOC Data and Estimated Mass Removal Rates
Lawrence Aviation Industries Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Sampling Month | Extraction Well | Sample ID | Average Flow Rate (gpm) | Concentrations of CVOCs (µg/l) | | | | | | | | | | | | | | | | | | Total CVOCs ¹ (µg/l) | Mass Removal Rate (lb/d) ² | No. of Days in the period | % System Uptime to GWTF | Total Mass Removed and Treated (lb) |
|----------------|-----------------|------------------|-------------------------|--------------------------------|--------------------|--------------------|------------|---------------|------------------------|-------------------|-----------------|----------------|----|-----|---|-----|--|------|--------------------------|-----|----|---------------------------------|---------------------------------------|---------------------------|-------------------------|-------------------------------------|
| | | | | 1,1,1-Trichloroethane | 1,1-Dichloroethane | 1,1-Dichloroethene | Chloroform | Chloromethane | cis-1,2-Dichloroethene | Tetrachloroethene | Trichloroethene | Vinyl Chloride | | | | | | | | | | | | | | |
| 2018-05 | EW-01 | 01-EW01-20180508 | 77 | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | UJ | 0.5 | U | 2.2 | | 89.0 | | 0.5 | UJ | 91.2 | 0.0845 | 31 | 100.0% | 2.62 |
| | EW-02 | 01-EW02-20180508 | 76 | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | UJ | 0.5 | U | 1.3 | | 18.0 | | 0.5 | UJ | 19.3 | 0.0176 | | | 0.55 |
| | | | | | | | | | | | | | | | | | | | Total | | | | 3.17 | | | |
| | | | | | | | | | | | | | | | | | | | Total since October 2012 | | | | 225.18 | | | |

Notes:
1. Non detects assumed to be 0
2. Mass removal rate calculated:
Mass removal rate (lb/d)^2 = Groundwater Influent Concentration (µg/l) x groundwater flow rate (gpm) x 1440 min/day x 3.79 l/gal x 1 lb/453,600,000 µg

Acronyms:
ID - identification
gpm - gallons per minute
CVOCs - chlorinated volatile organic compounds
µg/l - microgram per liter
lb/d - pounds per day
U - not detected
L - Value may be biased low
J - Estimated Value
% - percentage
lb -pounds
min/day - minute per day
l/gal - liter per gallon
lb/µg - pounds per microgram

Table 2-3
Summary of Facility Process Sampling - CVOs, Metals and Wet Chemistry Parameters
Lawrence Aviation Industries Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Facility Location | | Lawrence Aviation Industries | | | | | | | | | |
|-----------------------------------|-------|------------------------------|------|-------------------|------|-------------------|------|-------------------|------|-------------------|------|
| Sample ID | | 01-EW01 | | 01-EW02 | | 01-CINF | | 01-AS | | 01-EFF | |
| Sample Name | | 01-EW01-20180508 | | 01-EW02-20180508 | | 01-INF-20180508 | | 01-AS-20180508 | | 01-EFF-20180508 | |
| Location Code | | Extraction Well 1 | | Extraction Well 2 | | Combined Influent | | Post-Air Stripper | | Facility Effluent | |
| Sample Date | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | |
| Analyte | Units | Results | Qual | Results | Qual | Results | Qual | Results | Qual | Results | Qual |
| VOLATILE ORGANIC COMPOUNDS | | | | | | | | | | | |
| 1,1,1-Trichloroethane | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| 1,1-Dichloroethane | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| 1,1-Dichloroethene | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| Chloroform | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| Chloromethane | ug/l | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ |
| cis-1,2-Dichloroethylene | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| Tetrachloroethylene (PCE) | ug/l | 2.2 | | 1.3 | | 1.9 | | 0.5 | U | 0.5 | U |
| Trichloroethene (TCE) | ug/l | 89 | | 18 | | 55 | | 0.5 | U | 0.5 | U |
| Vinyl Chloride | ug/l | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ |
| METALS | | | | | | | | | | | |
| Aluminum | ug/l | 850 | | 100 | U | 476 | | 451 | | 406 | |
| Antimony | ug/l | 20 | U | 20 | U | 20 | U | 20 | U | 20 | U |
| Arsenic | ug/l | 8 | U | 8 | U | 8 | U | 8 | U | 8 | U |
| Barium | ug/l | 100 | U | 104 | | 100 | U | 100 | U | 100 | U |
| Beryllium | ug/l | 3 | U | 3 | U | 3 | U | 3 | U | 3 | U |
| Cadmium | ug/l | 3 | U | 3 | U | 3 | U | 3 | U | 3 | U |
| Calcium | ug/l | 13400 | | 14400 | | 14000 | | 13800 | | 13900 | |
| Chromium, Total | ug/l | 17.4 | | 6.37 | | 12.1 | | 11.7 | | 12 | |
| Cobalt | ug/l | 20 | U | 20 | U | 20 | U | 20 | U | 20 | U |
| Copper | ug/l | 10 | U | 10 | U | 10 | U | 10 | U | 10 | U |
| Iron | ug/l | 50 | U | 50 | U | 50 | U | 50 | U | 50 | U |
| Lead | ug/l | 8 | U | 8 | U | 8 | U | 8 | U | 8 | U |
| Magnesium | ug/l | 7000 | | 6790 | | 6940 | | 6830 | | 6860 | |
| Manganese | ug/l | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U |
| Mercury | ug/l | 0.2 | U | 0.2 | U | 0.2 | U | 0.2 | U | 0.2 | U |
| Nickel | ug/l | 20 | U | 20 | U | 20 | U | 20 | U | 20 | U |
| Potassium | ug/l | 9420 | | 3110 | | 6470 | | 6220 | | 6280 | |
| Selenium | ug/l | 20 | U | 20 | U | 20 | U | 20 | U | 20 | U |
| Silver | ug/l | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U |
| Sodium | ug/l | 21200 | | 19100 | | 20300 | | 19900 | | 20000 | |
| Thallium | ug/l | 20 | U | 20 | U | 20 | U | 20 | U | 20 | U |
| Vanadium | ug/l | 20 | U | 20 | U | 20 | U | 20 | U | 20 | U |
| Zinc | ug/l | 20 | U | 31.5 | | 27.1 | | 20 | U | 20 | U |
| WET CHEMISTRY | | | | | | | | | | | |
| Fluoride | mg/l | 5 | | 0.63 | | 3 | | 2.5 | | 2.9 | |

Acronyms:

ID - Identification

U - Non-Detect Value

J - Estimated value

µg/l - microgram per liter

mg/l - milligram per liter

01 - Lawrence Aviation Industries Facility Sample

Table 2-4
Summary of SPDES Permit Equivalent Compliance Data
Lawrence Aviation Industries Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| | | | | |
|-------------------------|---------------------------------|-----------------|----------|---|
| Sampling Month | | May 2018 | | |
| Sample Location | | 01-EFF | | |
| Sample Name | | 01-EFF-20180508 | | |
| Compound | SPDES Discharge Criteria | | 5/8/2018 | |
| 1,1,1-Trichloroethane | 5 | µg/l | 0.5 | U |
| 1,1-Dichloroethane | 5 | µg/l | 0.5 | U |
| cis-1,2-Dichloroethene | 5 | µg/l | 0.5 | U |
| Tetrachloroethene | 5 | µg/l | 0.5 | U |
| Trichloroethene | 5 | µg/l | 0.5 | U |
| Aluminum | monitor | µg/l | 406 | |
| Chromium, total | 100 | µg/l | 12 | |
| Fluoride | monitor | mg/l | 2.9 | |
| Iron | 600 | µg/l | 50 | U |
| Lead | 50 | µg/l | 8 | U |
| Manganese | 600 | µg/l | 5 | U |
| Nickel | 200 | µg/l | 20 | U |
| Sum of Iron & Manganese | <1000 | µg/l | 55 | |
| pH (5/4/18)* | 5.8 to 8.5 | SU | 7.45 | |
| pH (5/11/18)* | 5.8 to 8.5 | SU | 7.52 | |
| pH (5/18/18)* | 5.8 to 8.5 | SU | 7.64 | |
| pH (5/25/18)* | 5.8 to 8.5 | SU | 7.61 | |

Acronyms:

EFF - effluent

µg/l - microgram per liter

mg/l - milligram per liter

SU - standard units

SPDES - State Pollutant Discharge Elimination System

U - not detected

< - less than

* - value from field measurement

Notes:

Highlighted values indicate exceedances

Table 2-5
Summary of Operating Values
Lawrence Aviation Industries Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Parameter | Date: | 5/4/18 | Date: | 5/11/18 | Date: | 5/18/18 | Date: | 5/25/18 |
|--------------------------------------|---------|---------------------|---------|---------------------|---------|---------------------|---------|---------------------|
| | Reading | | Reading | | Reading | | Reading | |
| EW-01 inlet line pressure | 6.0 | psi | 6.0 | psi | 6.0 | psi | 6.0 | psi |
| EW-02 inlet line pressure | 6.0 | psi | 6.0 | psi | 6.0 | psi | 6.0 | psi |
| Combined influent line pressure | 5.0 | psi | 5.0 | psi | 5.0 | psi | 5.0 | psi |
| Effluent line pressure | 21 | psi | 20 | psi | 14 | psi | 16 | psi |
| Air stripper blower discharge temp | 88 | °F | 87 | °F | 86 | °F | 88 | °F |
| Air stripper blower vacuum | -12 | in H ₂ O | -12 | in H ₂ O | -12 | in H ₂ O | -12 | in H ₂ O |
| VOC screening | | | | | | | | |
| - Prior to GAC vessels | 0.3 | ppm | 0.4 | ppm | 0.4 | ppm | 0.4 | ppm |
| - Between GAC vessels | 0.3 | ppm | 0.4 | ppm | 0.3 | ppm | 0.4 | ppm |
| - Discharge to atmosphere | 0.0 | ppm | 0.1 | ppm | 0.1 | ppm | 0.1 | ppm |
| Blower Pressure Values | | | | | | | | |
| - Prior to GAC vessels | 5.0 | psi | 5.0 | psi | 5.0 | psi | 5.0 | psi |
| - Between GAC vessels | 2.0 | psi | 2.0 | psi | 2.0 | psi | 2.0 | psi |
| Kilowatt hours (meter reading x40) * | NC | kWh | NC | kWh | NC | kWh | NC | kWh |

Acronyms:

NC - not collected

ppm - parts per million

psi - pounds per square inch

°F - degrees Fahrenheit

kWh - kilowatt hour

in H₂O - inches water column

GAC - granular activated carbon

VOC - volatile organic compound

*Spot reading multiplied by factor of 40 per manufacturer's direction

Table 3-1
Summary of Monthly Operations
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Item | Cumulative Year 1 ¹ | Cumulative Year 2 ¹ | Cumulative Year 3 ¹ | Cumulative Year 4 ¹ | Cumulative Year 5 ¹ | Oct. 2017 | Nov. 2017 | Dec. 2017 | Jan. 2018 | Feb. 2018 | Mar. 2018 | Apr. 2018 | May 2018 | Notes |
|-----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|-----------|------------|------------|------------|-----------|------------|-----------|-----------|---|
| Calendar Days in Period | 365 | 365 | 365 | 366 | 365 | 31 | 30 | 31 | 31 | 28 | 31 | 30 | 31 | |
| Treatment System Runtime (hours) | | | | | | | | | | | | | | |
| EW-1 Runtime | 8,269 | 8,623 | 8,612 | 8,531 | 8,355 | 729 | 720 | 744 | 744 | 672 | 744 | 720 | 744 | Estimated based on Operator's notes and PLC logs. |
| EW-2 Runtime | 8,269 | 8,623 | 8,612 | 8,531 | 8,523 | 729 | 720 | 744 | 744 | 672 | 744 | 720 | 744 | |
| EW-6 Runtime | 349 | 8,623 | 8,612 | 8,531 | 8,518 | 729 | 720 | 744 | 744 | 672 | 744 | 720 | 744 | |
| Treatment System Downtime (hours) | | | | | | | | | | | | | | |
| Planned | 398 | 89 | 37 | 216 | 292 | 0 | 0 | 0.25 | 0.25 | 0 | 0.25 | 0 | 0.17 | Changing bag filters, greasing blower and pump motors |
| Unplanned | 93.5 | 48 | 111 | 38 | 113 | 15 | 0 | 0.25 | 0 | 0 | 0 | 0 | 0 | |
| System Uptime | 94.3% | 98.4% | 98.3% | 97.1% | 97.3% | 98.0% | 100.0% | 99.9% | 99.97% | 100.00% | 99.97% | 100.00% | 99.98% | |
| Treatment Summary | | | | | | | | | | | | | | |
| Gallons extracted from EW-1 | 15,768,246 | 24,257,650 | 24,705,902 | 30,394,120 | 35,180,416 | 2,701,472 | 2,762,960 | 2,762,961 | 2,816,560 | 2,579,824 | 2,856,256 | 2,764,224 | 2,833,440 | Estimated based on Operator's notes and PLC logs. |
| Average flow rate from EW-1 (gpm) | 31 | 47 | 48 | 60 | 70 | 62 | 64 | 62 | 63 | 64 | 64 | 64 | 63 | |
| Gallons extracted from EW-2 | 17,993,299 | 23,737,308 | 24,757,273 | 32,641,496 | 40,404,000 | 3,194,160 | 3,443,664 | 3,443,665 | 3,559,904 | 3,224,736 | 3,570,480 | 3,319,760 | 3,014,416 | |
| Average flow rate from EW-2 (gpm) | 33 | 47 | 48 | 64 | 79 | 73 | 80 | 77 | 80 | 80 | 80 | 77 | 68 | |
| Gallons extracted from EW-6 | 379,888 | 19,894,160 | 24,089,619 | 28,893,808 | 40,902,808 | 3,714,528 | 3,798,544 | 3,798,545 | 3,908,160 | 3,515,288 | 3,631,640 | 3,455,440 | 3,542,128 | |
| Average flow rate from EW-6 (gpm) | 19 | 39 | 47 | 57 | 80 | 85 | 88 | 85 | 88 | 87 | 81 | 80 | 79 | |
| Total gallons treated | 34,141,433 | 67,889,118 | 73,552,794 | 91,929,424 | 116,487,224 | 9,610,160 | 10,005,168 | 10,005,171 | 10,284,624 | 9,319,848 | 10,058,376 | 9,539,424 | 9,389,984 | |

Acronyms:
gpm - gallons per minute
% - percentage
PLC - programmable logic controller
GAC - granular activated carbon

Notes:
1. Monthly data from October 2012 to September 2013 collected by HDR provided in Appendix F.

Table 3-2
Summary of Extraction Well Groundwater Influent CVOC Data and Estimated Mass Removal Rates
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Sampling Month | Extraction Well | Sample ID | Average Flow Rate (gpm) | Concentrations of CVOCs (µg/l) | | | | | | | | | | | | | | | | Total CVOCs ¹ (µg/l) | Mass Removal Rate (lb/d) ² | No. of Days in the period | % System Uptime to GWTF | Total Mass Removed and Treated (lb) | | |
|----------------|-----------------|------------------|-------------------------|--------------------------------|--------------------|--------------------|------------|---------------|--------------------------|-------------------|-----------------|----------------|----|-----|--|-----|--|-----|--|---------------------------------|---------------------------------------|---------------------------|-------------------------|-------------------------------------|--------------------------|--------|
| | | | | 1,1,1-Trichloroethane | 1,1-Dichloroethane | 1,1-Dichloroethene | Chloroform | Chloromethane | cis-1,2-Dichloroethylene | Tetrachloroethene | Trichloroethene | Vinyl Chloride | | | | | | | | | | | | | | |
| 2018-05 | EW-1 | 02-EW01-20180508 | 63 | 1.2 | | 1.7 | | 0.68 | | 0.62 | | 0.5 | UJ | 1.2 | | 1.8 | | 90 | | 0.5 | UJ | 94 | 0.0714036 | 31 | 100.0% | 2.21 |
| | EW-2 | 02-EW02-20180508 | 68 | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.53 | J | 1.1 | | 4.9 | | 52 | | 0.5 | UJ | 59 | 0.04788683 | | | 1.48 |
| | EW-6 | 02-EW06-20180508 | 79 | 0.5 | U | 0.5 | U | 0.5 | U | 0.51 | | 0.54 | J | 2 | | 8.1 | | 270 | | 0.5 | UJ | 281 | 0.26714026 | | | 8.28 |
| | | | | | | | | | | | | | | | | | | | | | | | | | Total | 11.98 |
| | | | | | | | | | | | | | | | | | | | | | | | | | Total since October 2012 | 879.41 |

Notes:
1. Non detects assumed to be 0.
2. Mass removal rate calculated:

Groundwater Influent Concentration (µg/l) x groundwater flow rate (gpm) x 1440 min/day x 3.79 l/gal x 1 lb/453,600,000 µg

Acronyms:
ID - identification
gpm - gallons per minute
µg/l - microgram per liter
CVOCs - chlorinated volatile organic compounds
lb/d - pounds per day
U - not detected
J - estimated value
% - percentage
lb - pounds
min/day- minute per day
l/gal- liter per gallon
lb/µg - pounds per microgram

Table 3-3
Summary of Facility Process Sampling - CVOCs, Metals, and Wet Chemistry Parameters
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Facility Location | | Old Mill Pond | | | | | | | | | | | |
|-----------------------------------|-------|-------------------|------|-------------------|------|-------------------|------|-------------------|------|-----------------|------|-------------------|------|
| Sample ID | | 02-EW01 | | 02-EW02 | | 02-EW06 | | 02-AS | | 02-GAC | | 02-EFF | |
| Sample Name | | 02-EW01-20180508 | | 02-EW02-20180508 | | 02-EW06-20180508 | | 02-AS-20180508 | | 02-GAC-20180508 | | 02-EFF-20180508 | |
| Location Code | | Extraction Well 1 | | Extraction Well 2 | | Extraction Well 6 | | Post-Air Stripper | | Post-GAC | | Facility Effluent | |
| Sample Date | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | |
| Analyte | Units | Results | Qual | Results | Qual | Results | Qual | Results | Qual | Results | Qual | Results | Qual |
| VOLATILE ORGANIC COMPOUNDS | | | | | | | | | | | | | |
| 1,1,1-Trichloroethane | ug/l | 1.2 | | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| 1,1-Dichloroethane | ug/l | 1.7 | | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| 1,1-Dichloroethene | ug/l | 0.7 | | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| Chloroform | ug/l | 0.6 | | 0.5 | U | 0.5 | | 0.5 | U | 0.5 | U | 0.5 | U |
| Chloromethane | ug/l | 0.5 | UJ | 0.5 | J | 0.5 | J | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ |
| cis-1,2-Dichloroethylene | ug/l | 1.2 | | 1.1 | | 1.9 | | 0.5 | U | 0.5 | U | 0.5 | U |
| Tetrachloroethylene(PCE) | ug/l | 1.8 | | 4.9 | | 8.1 | | 0.5 | U | 0.5 | U | 0.5 | U |
| Trichloroethene (TCE) | ug/l | 90 | | 52 | | 270 | | 5.8 | | 5.3 | | 4.5 | |
| Vinyl Chloride | ug/l | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ |
| METALS | | | | | | | | | | | | | |
| Aluminum | ug/l | 100 | U | 100 | U | 100 | U | 100 | U | 100 | U | 100 | U |
| Antimony | ug/l | 20 | U | 20 | U | 20 | U | 20 | U | 20 | U | 20 | U |
| Arsenic | ug/l | 8 | U | 8 | U | 8 | U | 8 | U | 8 | U | 8 | U |
| Barium | ug/l | 120 | | 121 | | 120 | | 122 | | 121 | | 119 | |
| Beryllium | ug/l | 3 | U | 3 | U | 3 | U | 3 | U | 3 | U | 3 | U |
| Cadmium | ug/l | 3 | U | 3 | U | 3 | U | 3 | U | 3 | U | 3 | U |
| Calcium | ug/l | 16200 | | 18000 | | 17900 | | 17600 | | 17400 | | 17200 | |
| Chromium, Total | ug/l | 5 | U | 6.39 | | 6.44 | | 5.77 | | 5.55 | | 5.64 | |
| Cobalt | ug/l | 20 | U | 20 | U | 20 | U | 20 | U | 20 | U | 20 | U |
| Copper | ug/l | 10 | U | 10 | U | 10 | U | 10 | U | 10 | U | 10 | U |
| Iron | ug/l | 50 | U | 50 | U | 50 | U | 50 | U | 50 | U | 50 | U |
| Lead | ug/l | 8 | U | 8 | U | 8 | U | 8 | U | 8 | U | 8 | U |
| Magnesium | ug/l | 6030 | | 8010 | | 8260 | | 7610 | | 7520 | | 7440 | |
| Manganese | ug/l | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U |
| Mercury | ug/l | 0.2 | U | 0.2 | U | 0.2 | U | 0.2 | U | 0.2 | U | 0.2 | U |
| Nickel | ug/l | 20 | U | 20 | U | 20 | U | 20 | U | 20 | U | 20 | U |
| Potassium | ug/l | 1350 | | 9690 | | 8430 | | 6660 | | 6600 | | 6550 | |
| Selenium | ug/l | 20 | U | 20 | U | 20 | U | 20 | U | 20 | U | 20 | U |
| Silver | ug/l | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U |
| Sodium | ug/l | 14100 | | 17600 | | 22200 | | 18300 | | 18100 | | 18000 | |
| Thallium | ug/l | 20 | U | 20 | U | 20 | U | 20 | U | 20 | U | 20 | U |
| Vanadium | ug/l | 20 | U | 20 | U | 20 | U | 20 | U | 20 | U | 20 | U |
| Zinc | ug/l | 20 | U | 20 | U | 20 | U | 20 | U | 20 | U | 20 | U |
| WET CHEMISTRY | | | | | | | | | | | | | |
| Fluoride | mg/l | 0.066 | | 0.05 | U | 0.05 | U | 0.05 | U | 0.05 | U | 0.05 | U |

Acronyms:
ID - Identification
U - Non-Detect Value
J - Estimated Value
GAC - Granular Activated Carbon
ug/l - microgram per liter
mg/l - milligram per liter
02 - Old Mill Pond Facility Sample

Table 3-4
Summary of SPDES Permit Equivalent Compliance Data
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| | | | | |
|------------------------|---------------------------------|------|-----------------|----|
| Sampling Month | | | May 2018 | |
| Sample Location | | | 02-EFF | |
| Sample Name | | | 02-EFF-20180508 | |
| Compound | SPDES Discharge Criteria | | 5/8/2018 | |
| 1,1,1-Trichloroethane | 10 | µg/l | 0.5 | U |
| 1,1-Dichloroethane | 10 | µg/l | 0.5 | U |
| 1,1-Dichloroethene | 10 | µg/l | 0.5 | U |
| Chloromethane | 10 | µg/l | 0.5 | UJ |
| cis-1,2-Dichloroethene | 10 | µg/l | 0.5 | U |
| Tetrachloroethene | 1 | µg/l | 0.5 | U |
| Trichloroethene | 10 | µg/l | 4.5 | |
| Chromium, total | monitor | µg/l | 5.6 | |
| Copper | 13.4 | µg/l | 10 | U |
| Iron | 0.3 | µg/l | 50 | U |
| Zinc | 0.12 | µg/l | 20 | U |
| pH (5/4/18)* | 5.8 to 8.5 | SU | 6.69 | |
| pH (5/11/18)* | 5.8 to 8.5 | SU | 6.68 | |
| pH (5/18/18)* | 5.8 to 8.5 | SU | 6.73 | |
| pH (5/25/18)* | 5.8 to 8.5 | SU | 7.08 | |

Acronyms:

EFF - effluent

µg/l - microgram per liter

mg/l - milligram per liter

SU - standard units

SPDES - State Pollutant Discharge Elimination System

U - not detected

NA - not available

* - value from field measurement

Notes:

Highlighted values indicate exceedances

Table 3-5
Summary of Operating Values
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Parameter | Date: | 5/4/18 | Date: | 5/11/18 | Date: | 5/18/18 | Date: | 5/25/18 |
|-------------------------------------|---------|---------------------|---------|---------------------|---------|---------------------|---------|---------------------|
| | Reading | | Reading | | Reading | | Reading | |
| EW-01 inlet line pressure | 3.75 | psi | 4.00 | psi | 4.00 | psi | 4.00 | psi |
| EW-02 inlet line pressure | 4.25 | psi | 4.50 | psi | 4.50 | psi | 4.50 | psi |
| EW-06 inlet line pressure | 5.25 | psi | 5.25 | psi | 5.25 | psi | 5.25 | psi |
| Combined influent line pressure | NC | psi | NC | psi | NC | psi | NC | psi |
| Effluent line pressure | 4.00 | psi | 4.00 | psi | 4.00 | psi | 3.75 | psi |
| Air stripper blower discharge temp | NC | °F | NC | °F | NC | °F | NC | °F |
| Air stripper blower vacuum | NC | in H ₂ O | NC | in H ₂ O | NC | in H ₂ O | NC | in H ₂ O |
| VOC screening | | | | | | | | |
| - Prior to GAC 3 (influent) | 1.3 | ppm | 1.1 | ppm | 1.2 | ppm | 1.1 | ppm |
| - Between GAC 3 and GAC 1 | 1.2 | ppm | 1.1 | ppm | 0.0 | ppm | 0.0 | ppm |
| - Between GAC 1 and GAC 2 | 1.2 | ppm | 1.1 | ppm | 0.0 | ppm | 0.0 | ppm |
| - After GAC 2 (effluent to air) | 0.2 | ppm | 0.3 | ppm | 0.5 | ppm | 0.2 | ppm |
| Blower Differential Pressure Values | 33.5 | in H ₂ O | 34.0 | in H ₂ O | 33.5 | in H ₂ O | 32.0 | in H ₂ O |
| Blower Flowrates | 2,210 | cfm | 2,210 | cfm | 2,230 | cfm | 2,280 | cfm |
| Kilowatt hours (meter reading x40)* | NC | kWh | NC | kWh | NC | kWh | NC | kWh |

Acronyms:

NC - not collected

ppm - parts per million

psi - pounds per square inch

°F - degrees Fahrenheit

kWh - kilowatt hour

in H₂O - inches water column

GAC - granular activated carbon

VOC - volatile organic compound

cfm - cubic feet per minute

*Spot reading multiplied by factor of 40 per manufacturer's direction

Table 4-1
Summary of Air Pollution Control Permit Equivalent Compliance Data
Lawrence Aviation Industries Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Sampling Month | Sampling Date | Compound | Influent GAC-1 Concentration (ppbv) | | Effluent GAC-1 Concentration (ppbv) | | Effluent GAC-2 Concentration (ppbv) | | Molecular Weight (g/mole) | Air Flow Rate (cfm) | Emissions Rate from Stack (lb/d) ¹ | Permit Equivalent Limit (lb/d) |
|----------------|---------------|----------|---|--|---|--|--|--|---------------------------------|------------------------|--|-----------------------------------|
| May 2018 | 5/8/2018 | PCE | 4.7 | | 0.64 | | 0.27 | | 165.82 | 1,276 | 0.00021 | 0.0055 |
| | | TCE | 170 | | 140 | | 70 | | 131.38 | | 0.04313 | 0.1320 |

Acronyms:

PCE - tetrachloroethene

TCE - trichloroethene

GAC - granular activated carbon

ppbv - parts per billion by volume

g/mole - gram per mole

cfm - cubic feet per minute

lb/d - pounds per day

min/day - minutes per day

lb/g - pounds per gram

mol/l - mole per liter

STP - standard temperature and pressure

cf - cubic feet

l - liter

Notes:

1. Emissions rate was calculated :

Emissions rate (lb/d)² = Effluent air concentration (ppbv) x Molecular Weight (g/mole) x Air flow rate (cfm) x 1440 min/day x (1 lb/453.6 g) x (1 mol/24.47 l at STP) x (1 l/0.0353 cf) x 1/10⁹

Table 4-2
Summary of Air Sampling Data
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Sampling Month | Sampling Date | Compound | Influent GAC-3 Concentration (ppbv) | Effluent GAC-3 Concentration (ppbv) | Effluent GAC-1 Concentration (ppbv) | Effluent GAC-2 Concentration (ppbv) | Molecular Weight (g/mole) | Air Flow Rate (cfm) | Emissions Rate from Stack (lb/d) ¹ | OMP Permit Equivalent Limit (lb/d) |
|----------------|---------------|----------|---|---|---|---|------------------------------|------------------------|--|--|
| May 2018 | 5/8/2018 | PCE | 7 | 52 | 1.2 | J | 165.82 | 2,233 | 0.00082 | 0.0216 |
| | | TCE | 300 | 400 | 390 | | 131.38 | | 0.39884 | 1.638 |

Acronyms:

PCE - tetrachloroethene

TCE - trichloroethene

GAC - granular activated carbon

ppbv - parts per billion by volume

g/mole - gram per mole

cfm - cubic feet per minute

lb/d - pounds per day

min/day - minutes per day

lb/g - pounds per gram

mol/l - mole per liter

STP - standard temperature and pressure

cf - cubic feet

l - liter

J - estimated

Notes:

* From dilution analysis

1. Emissions rate was calculated :

Emissions rate (cfm) = Effluent air concentration (ppbv) x Molecular Weight (g/mole) x Air flow rate (cfm) x 1440 min/day x (1 lb/453.6 g) x (1 mol/24.47 l at STP) x (1 l/0.0353 cf) x 1/10⁹

APPENDIX A

Data Usability Analysis Report

DATA USABILITY ANALYSIS

LAWRENCE AVIATION INDUSTRIES SITE

To meet the primary objectives of the Long-Term Response Action (LTRA) program at the Lawrence Aviation Industries Site (LAI), in August 2012 the United States Environmental Protection Agency (EPA), Region 2 issued a work assignment to Henningson, Durham & Richardson, Architecture and Engineering PC, in association with HDR Engineering, Inc. (HDR) for the operation and maintenance of the groundwater treatment systems at the LAI Site. The system at the LAI facility was completed on September 28, 2010 and is currently in its 7th year of LTRA. Construction of the Old Mill Pond treatment facility was completed in August 2011 and is currently in its 6th year of LTRA. This data usability analysis is for samples collected in May 2018. Aqueous samples were collected from eleven locations and air samples from seven locations. In addition, quality assurance/quality control (QA/QC) samples were collected including one field duplicate and one trip blank associated with the aqueous samples only. QA/QC samples were not collected for the air samples in accordance with the EPA-approved Final QAPP (HDR, 2016). All analytical sample results were generated by the EPA Division of Environmental Science and Assessment (DESA) Region 2 laboratory or an EPA Contract Laboratory Program (CLP) laboratory for the following analyses and methods:

| Laboratory | Analysis | Method | Matrix |
|------------------------------------|----------------|-----------------------------|---------|
| DESA Region 2 | Fluoride | EPA 300.0/SOP C-94 Rev 2.6 | Aqueous |
| DESA Region 2 | Mercury | EPA 245.1/SOP C-110 Rev 2.5 | Aqueous |
| DESA Region 2 | Metals ICP TAL | EPA 200.7/SOP C-109 Rev 3.4 | Aqueous |
| DESA Region 2 | VOA Trace/SF | EPA 524.2/SOP DW-1 Rev 2.6 | Aqueous |
| CLP – Bureau Veritas North America | VOA | TO-15 | Air |

Note: TAL = Target Analyte List; VOA = Volatile Organic Analysis; SOP = Standard Operating Procedure; TO = Toxic Organic

The results provided by the DESA or CLP laboratories are considered definitive data and underwent a systematic data validation to provide assurance that the data were adequate for its intended use. The validation was performed based on an evaluation of project objectives, method-specific QA/QC information (such as holding times, calibration records, laboratory- and field-supplied blanks, duplicate precision, and surrogate and spike recovery), relevant sections of the EPA Region 2 Data Validation Standard Operating Procedures (SOPs), relevant sections of the EPA National Functional Guidelines for Organic and Inorganic Data Validation, and/or the best professional judgment of the validator. Validation was performed by EPA personnel with the appropriate training and/or experience in performing data validation for the analyses of interest associated with the project. Qualifiers (as appropriate) were added to the data based on the results of the validation.

Note that since this project is in the LTRA phase, the focus was placed on site-specific contaminants of concern with regard to the VOCs: 1,1,1-trichloroethane (1,1,1-TCA), 1,1-dichloroethane (1,1-DCA), 1,1-dichloroethene (1,1-DCE), chloroform, cis-1,2-dichloroethene (cis-1,2-DCE), trichloroethene (TCE), tetrachloroethene (PCE), and vinyl chloride (VC). The attached results tables provide the sample number, sample location, sample collection date, and the result and qualifiers for these constituents.

As part of the data assessment by the DESA Region 2 laboratory, data qualifiers are presented along with the analytical results. Qualifiers used with regard to the assessment of the May 2018 samples for the

site-specific contaminants of concern are highlighted in bold for clarity.

- **U- The analyte was not detected at or above the reporting limit.**
- **J- The identification of the analyte is acceptable; the reported value is an estimate.**
- K- The identification of the analyte is acceptable; the reported value may be biased high.
- **L- The identification of the analyte is acceptable; the reported value may be biased low.**
- NJ- There is presumptive evidence that the analyte is present; the analyte is reported as tentative identification. The reported value is estimated.

The data assessment for organic aqueous samples is typically performed for holding time, contract required quantitation limits (CRQLs), deuterated monitoring compounds (DMCs), blank contamination, mass spectrometer tuning, calibration, internal standards performance GC/MS, compound identification, contract problems non-compliance, and field documentation. The laboratory was able to achieve the CRQLs, where applicable, for each analyte requested with the exception of the trace VOCs bromomrthane and bromochloromethane. The CRQLs for these compounds in water is 0.5 ug/l, the laboratory reporting limits were raised in all samples due to problems associated with the initial calibration curve. There were no other issues identified in the EPA narrative for the samples collected in May 2018.

The data assessment for inorganic aqueous samples is typically performed for the following criteria per the EPA Technical Direction Form (TDF): preservation, holding time, contract required detection limit (CRDL) standard, matrix spike/matrix spike duplicate (MS/MSD), Interference Check Sample (ICS), laboratory duplicate, field duplicate, ICP serial dilution, and field blank. There were no issues identified in the EPA narrative for the samples collected in May 2018.

As part of the data assessment by the CLP laboratory, data qualifiers are presented along with the analytical results. Qualifiers used with regard to the assessment of the May 2018 samples for the site-specific contaminants of concern are highlighted in bold for clarity.

- **U- The analyte analyzed for, but was not detected at a level greater than or equal to the level of the adjusted CRQL.**
- **J- The analyte was positively identified and the associated numerical value is the approximate concentration of the analyte in the sample (due either to the quality of the data generated because certain quality control criteria were not met, or the concentration of the analyte was below the CRQL).**
- UJ- The analyte was not detected at a level greater than or equal to the adjusted CRQL. However, the reported adjusted CRQL is approximate and may be inaccurate or imprecise.
- R- The sample results are unusable due to the quality of the data generated because certain criteria were not met. The analyte may or may not be present in the sample.
- N- The analysis indicates the presence of an analyte for which there is presumptive evidence to make a “tentative identification”.
- NJ- The analysis indicated the presence of an analyte that has been “tentatively identified” and the associated numerical value represent its approximate concentration.
- D – Although the definition for this qualifier is not included in the data narrative, it indicates a diluted value.

The data assessment for organic air samples was performed for the following criteria per the EPA SOW:

holding time, leak test evaluation, canister certification, laboratory control/laboratory control duplicate recovery (LCS/LCSD), blank contamination, mass spectrometer tuning, calibration, internal standards performance, compound identification, dilutions, re-extractions & reanalysis, contract problems - non-compliance, field documentation, and other considerations.

A minor finding is one where the level of uncertainty is acceptable, and no significant bias is observed. One minor finding noted in the EPA validation narrative was that one or more analytes in one or more samples were qualified “J” due to results detected above the method detection limit (MDL) but below the CRQL.

There were no other issues identified in the EPA validation narrative for the samples collected in May 2018. All data are usable as reported.

The following sections provide an evaluation of the usability of the data for the Site, as compared to the site-specific QA/QC requirements outlined in the EPA-approved Final QAPP (HDR, 2016).

Precision

Precision is the measurement of agreement in repeated tests of the same or identical samples, under prescribed conditions. Precision data indicate how consistent and reproducible the field sampling or analytical procedures have been. For the Site data, precision was determined through replicate measurements of the same or identical samples, i.e., a field duplicate sample. The acceptance criterion for the duplicate is a relative percent difference (RPD) of less than 25 percent (for fluoride and VOCs) or 20 percent (for TAL metals and mercury) for aqueous samples. The RPD was not calculated for any set of sample pairs where concentrations were not detected in both of the data sets; agreement between the original sample and the duplicate can be inferred when both of the results are non-detects. All of the sample pairs that contained detections in both of the data sets were within the RPD limits prescribed. The results indicate the sampling program achieved overall good reproducibility.

Accuracy

Accuracy is the degree of agreement of a measured sample result or average of results with an accepted reference or true value. It is the quantitative measurement of the bias of a system, and is expressed in terms of percent recovery (%R). Accuracy of the data can be determined through the use of surrogate compounds, internal standard compounds, matrix spike samples, and laboratory control spike samples. No issues were identified in the EPA narrative for DESA laboratory. The CLP laboratory provided results for the method blank, laboratory control sample and duplicate analyzed with regard to the air samples. The results were within acceptable limits. Based on the information provided and available results, the laboratories achieved a good degree of accuracy.

Representativeness

Representativeness is the degree to which the results of the analyses accurately and precisely represent a characteristic of a population, a process condition, or an environmental condition. In this case, representativeness is the degree to which the data reflect the contaminants present and their concentration magnitudes in the sampled site areas. Representativeness of data occurs through the selection of appropriate sampling locations and the implementation of approved sampling procedures. The sampling locations for this round of sampling consisted solely of fixed sample locations/ports. In addition, field personnel

followed the procedures outlined in the EPA-approved QAPP (HDR, 2016) for the Site.

Comparability

To increase the degree of comparability between data results and between past, present and future sampling events, standard environmental analytical methods were employed by the off-site laboratories. Routine Analytical Service (RAS) sample analyses available through the EPA CLP were utilized for the TCL VOCs, TAL metals, and inorganics analyses as specified in the CLP SOWs.

Completeness

Completeness is determined by the percentage of samples that meet or exceed all of the criteria objective levels (i.e., the number of usable sample results for the data set). All of the sample results were determined to be usable.

Sensitivity

Sensitivity is the ability of the analytical method or instrument to detect a target analyte at the level of interest. The method detection limit (MDL) is a statistically-derived value that represents a 99 percent confidence level that the reported instrument signal is different from a blank sample. The quantitation limit (QL) is the minimum concentration of an analyte that can be routinely identified by the laboratory, and is generally between three and ten times the MDL. Analytical methods are matrix-, moisture- and dilution-dependent. The sample quantitation limit (SQL) actually determined for a constituent for a specific sample may be higher than the QL due to these issues. The laboratory was able to achieve the CRQLs, where applicable, for each analyte requested with the exception of bromomethane and bromochloromethane; the reporting limits were raised due to issues with the initial calibration curve. These analytes are not contaminants of concern for the site. There were no issues identified in the EPA narrative for the samples collected in May 2018.

Blank Contamination Elimination

Blanks were prepared to identify any contamination that may have been introduced into the samples. Validation determines the need for qualification of sampling analytical results based on blank contamination. One trip blank sample was submitted with the aqueous samples for the May 2018 sampling event. 2-Butanone and acetone were detected at concentrations of 5.9 and 15 ug/l, respectively, in the trip blank sample; however, these compounds were non-detect at 5 ug/l in all of the aqueous field samples. No contaminants of concern for the site were noted in the trip blank sample that was collected and analyzed.

Usability Summary

The definitive data for the LTRA May 2018 event fulfilled the site-specific QA/QC requirements, as all of the results were determined to be usable. Therefore, the results are acceptable for use to support Site decisions.

References

HDR, 2016. Uniform Federal Policy of Quality Assurance Project Plans, Region 2 Architect-Engineering

Services Contract, Contract #EP-W-09-009, Project-Specific UFP-QAPP, Lawrence Aviation Industries Long-Term Response Action. Revised March 2016.

APPENDIX B

System Runtime Log

Appendix B1
System Runtime Log - May 2018
Lawrence Aviation Industries Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, NY

| Dates | ASB_FR | EFF_PH | EW1_RT | EW1_TOT* | EW1_WTE | EW2_RT | EW2_TOT* | EW2_WTE | IW1_WTE | IW2_WTE | IW3_WTE | IW4_WTE | IW5_WTE |
|-----------|--------|--------|--------|-----------|---------|--------|-----------|---------|---------|---------|---------|---------|---------|
| | scfm | SU | hours | gallons | ft amsl | hours | gallons | ft amsl | ft amsl | ft amsl | ft amsl | ft amsl | ft amsl |
| 5/1/2018 | 1,282 | 7.62 | 24 | 111,872 | 30.75 | 24 | 110,432 | 29.70 | 36.61 | 37.27 | 122.35 | 167.97 | 151.44 |
| 5/2/2018 | 1,281 | 7.63 | 24 | 110,768 | 30.81 | 23 | 108,896 | 29.75 | 36.63 | 37.31 | 124.33 | 165.83 | 147.49 |
| 5/3/2018 | 1,279 | 7.65 | 23 | 111,872 | 30.79 | 24 | 110,432 | 29.71 | 36.63 | 37.33 | 125.57 | 162.93 | 148.80 |
| 5/4/2018 | 1,279 | 7.64 | 24 | 111,888 | 30.83 | 24 | 110,256 | 29.77 | 36.67 | 37.37 | 132.45 | 166.80 | 149.95 |
| 5/5/2018 | 1,282 | 7.63 | 24 | 111,872 | 30.72 | 24 | 110,432 | 29.65 | 36.59 | 37.31 | 135.04 | 169.21 | 151.33 |
| 5/6/2018 | 1,253 | 7.63 | 24 | 111,616 | 30.85 | 24 | 109,792 | 29.79 | 36.70 | 37.39 | 135.61 | 171.08 | 151.90 |
| 5/7/2018 | 1,290 | 7.63 | 24 | 99,088 | 31.12 | 24 | 97,888 | 30.01 | 36.56 | 53.45 | 131.03 | 151.24 | 115.83 |
| 5/8/2018 | 1,265 | 7.63 | 24 | 111,872 | 30.80 | 24 | 110,432 | 29.71 | 36.63 | 37.48 | 135.40 | 161.99 | 148.88 |
| 5/9/2018 | 1,267 | 7.63 | 24 | 111,872 | 30.85 | 24 | 110,016 | 29.77 | 36.68 | 37.48 | 134.01 | 165.68 | 150.48 |
| 5/10/2018 | 1,266 | 7.62 | 24 | 112,656 | 30.89 | 24 | 111,200 | 29.79 | 36.72 | 37.57 | 133.94 | 168.98 | 151.12 |
| 5/11/2018 | 1,264 | 7.63 | 24 | 111,088 | 30.78 | 24 | 109,664 | 29.69 | 36.65 | 40.44 | 135.88 | 169.87 | 145.88 |
| 5/12/2018 | 1,253 | 7.62 | 24 | 111,856 | 30.82 | 24 | 110,432 | 29.73 | 36.70 | 59.76 | 140.86 | 169.22 | 128.79 |
| 5/13/2018 | 1,244 | 7.61 | 24 | 111,872 | 30.83 | 24 | 110,240 | 29.77 | 36.72 | 63.57 | 140.43 | 173.14 | 133.31 |
| 5/14/2018 | 1,258 | 7.62 | 24 | 111,872 | 30.90 | 24 | 110,016 | 29.84 | 36.76 | 64.70 | 137.64 | 164.17 | 137.09 |
| 5/15/2018 | 1,271 | 7.63 | 24 | 111,872 | 30.87 | 24 | 110,432 | 29.79 | 36.75 | 63.44 | 137.54 | 167.72 | 139.29 |
| 5/16/2018 | 1,284 | 7.63 | 24 | 111,872 | 30.81 | 24 | 110,240 | 29.75 | 36.71 | 63.25 | 132.68 | 169.18 | 142.05 |
| 5/17/2018 | 1,282 | 7.63 | 24 | 112,640 | 30.89 | 24 | 111,200 | 29.83 | 36.75 | 61.87 | 134.68 | 172.59 | 143.32 |
| 5/18/2018 | 1,294 | 7.63 | 24 | 111,664 | 30.80 | 24 | 109,040 | 29.76 | 36.70 | 61.73 | 146.12 | 168.97 | 143.60 |
| 5/19/2018 | 1,283 | 7.62 | 24 | 111,872 | 30.97 | 24 | 110,432 | 29.91 | 36.81 | 62.29 | 149.52 | 167.87 | 146.35 |
| 5/20/2018 | 1,283 | 7.63 | 24 | 111,872 | 30.97 | 24 | 110,240 | 29.92 | 36.80 | 62.62 | 152.93 | 173.05 | 146.71 |
| 5/21/2018 | 1,290 | 7.63 | 24 | 111,872 | 30.86 | 24 | 109,808 | 29.79 | 36.74 | 62.25 | 153.22 | 168.68 | 147.14 |
| 5/22/2018 | 1,285 | 7.63 | 24 | 111,872 | 30.92 | 24 | 110,432 | 29.83 | 36.81 | 62.55 | 155.22 | 171.31 | 148.60 |
| 5/23/2018 | 1,277 | 7.63 | 24 | 111,888 | 30.94 | 24 | 110,288 | 29.88 | 36.81 | 64.03 | 159.96 | 174.03 | 149.63 |
| 5/24/2018 | 1,289 | 7.64 | 24 | 111,856 | 30.88 | 24 | 110,432 | 29.82 | 36.77 | 62.80 | 158.43 | 174.89 | 149.56 |
| 5/25/2018 | 1,278 | 7.64 | 24 | 111,888 | 30.98 | 24 | 110,240 | 29.89 | 36.85 | 63.73 | 162.89 | 177.29 | 149.94 |
| 5/26/2018 | 1,271 | 7.65 | 24 | 111,872 | 30.94 | 24 | 110,432 | 29.84 | 36.83 | 63.54 | 163.96 | 178.82 | 149.87 |
| 5/27/2018 | 1,267 | 7.63 | 24 | 111,872 | 30.87 | 24 | 110,048 | 29.79 | 36.79 | 64.01 | 164.85 | 180.09 | 150.76 |
| 5/28/2018 | 1,313 | 7.63 | 24 | 95,744 | 31.42 | 24 | 104,496 | 30.32 | 36.77 | 56.41 | 164.26 | 155.79 | 121.45 |
| 5/29/2018 | 1,274 | 7.64 | 23 | 111,088 | 30.97 | 24 | 99,664 | 29.90 | 36.83 | 60.80 | 166.12 | 165.01 | 149.70 |
| 5/30/2018 | 1,279 | 7.64 | 24 | 112,656 | 30.91 | 24 | 111,216 | 29.81 | 36.82 | 62.30 | 166.85 | 169.59 | 149.91 |
| 5/31/2018 | 1,272 | 7.63 | 23 | 111,088 | 30.98 | 24 | 109,664 | 29.87 | 36.88 | 62.74 | 167.58 | 172.42 | 150.36 |
| Averages | 1,276 | 7.63 | N/A | N/A | 30.89 | N/A | N/A | 29.82 | 36.73 | 54.15 | 145.21 | 168.88 | 144.86 |
| Totals | N/A | N/A | 741 | 3,437,552 | N/A | 743 | 3,388,432 | N/A | N/A | N/A | N/A | N/A | N/A |

Acronyms:

| | |
|--|--|
| ASB_FR - air stripper blower flow rate | IW3_WTE - injection well 3 water table elevation |
| EFF_PH - effluent pH | IW4_WTE - injection well 4 water table elevation |
| EW1_RT - extraction well 1 run time | IW5_WTE - injection well 5 water table elevation |
| EW1_TOT - extraction well 1 flow non-resetting totalizer | scfm - standard cubic feet per minute |
| EW1_WTE - extraction well 1 water table elevation | SU - standard units |
| EW2_RT - extraction well 2 run time | gpm - gallons per minute |
| EW2_TOT - extraction well 2 flow non-resetting totalizer | ft amsl - feet above mean sea level |
| EW2_WTE - extraction well 2 water table elevation | N/A - not applicable |
| IW1_WTE - injection well 1 water table elevation | PLC - programmable logic controller |
| IW2_WTE - injection well 2 water table elevation | |

Notes:

* - Values retrieved from operator's logs and may not match data presented in Table 2-1 due to periodic flow fluctuations

** - System down for air stripper cleanout

Appendix B2
System Runtime Log - May 2018
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, NY

| Date | EW1_FLOW_TOTAL * | EW2_FLOW_TOTAL * | EW3_FLOW_TOTAL | EW4_FLOW_TOTAL | EW6_FLOW_TOTAL * |
|-----------------|------------------|------------------|----------------|----------------|------------------|
| | (gallons) | (gallons) | (gallons) | (gallons) | (gallons) |
| 5/1/2018 | 92032 | 92032 | 0 | 0 | 115040 |
| 5/2/2018 | 91488 | 96288 | 0 | 0 | 114208 |
| 5/3/2018 | 91872 | 91808 | 0 | 0 | 114736 |
| 5/4/2018 | 92096 | 92096 | 0 | 0 | 115120 |
| 5/5/2018 | 92096 | 104800 | 0 | 0 | 115120 |
| 5/6/2018 | 91936 | 114896 | 0 | 0 | 114896 |
| 5/7/2018 | 92096 | 115120 | 0 | 0 | 115120 |
| 5/8/2018 | 91552 | 112080 | 0 | 0 | 114272 |
| 5/9/2018 | 92096 | 92096 | 0 | 0 | 115120 |
| 5/10/2018 | 91840 | 102688 | 0 | 0 | 114752 |
| 5/11/2018 | 92096 | 92096 | 0 | 0 | 115120 |
| 5/12/2018 | 92096 | 92096 | 0 | 0 | 115120 |
| 5/13/2018 | 92096 | 92096 | 0 | 0 | 115120 |
| 5/14/2018 | 73568 | 75648 | 0 | 0 | 91872 |
| 5/15/2018 | 89120 | 94832 | 0 | 0 | 112240 |
| 5/16/2018 | 91968 | 94272 | 0 | 0 | 114912 |
| 5/17/2018 | 92096 | 92096 | 0 | 0 | 115120 |
| 5/18/2018 | 92096 | 92096 | 0 | 0 | 115120 |
| 5/19/2018 | 92096 | 92096 | 0 | 0 | 115120 |
| 5/20/2018 | 92160 | 92160 | 0 | 0 | 115200 |
| 5/21/2018 | 92096 | 92096 | 0 | 0 | 115120 |
| 5/22/2018 | 92096 | 92096 | 0 | 0 | 115120 |
| 5/23/2018 | 92096 | 92096 | 0 | 0 | 115120 |
| 5/24/2018 | 92096 | 92096 | 0 | 0 | 115120 |
| 5/25/2018 | 92096 | 92096 | 0 | 0 | 115120 |
| 5/26/2018 | 92096 | 92096 | 0 | 0 | 115120 |
| 5/27/2018 | 92096 | 92096 | 0 | 0 | 115120 |
| 5/28/2018 | 92096 | 98880 | 0 | 0 | 115120 |
| 5/29/2018 | 92160 | 115200 | 0 | 0 | 115200 |
| 5/30/2018 | 92000 | 115120 | | | 115120 |
| 5/31/2018 | 92096 | 115120 | 0 | 0 | 115120 |
| TOTAL ** | 2,833,440 | 3,014,416 | 0 | 0 | 3,542,128 |

Acronyms:

EW- extraction well

Flow - totalizer flow

NA - not available

* - Values retrieved from operator's logs and may not match data presented in Table 3-1 due to periodic flow fluctuations.

** - Totals for EW1_FLOW_TOTAL, EW2_FLOW_TOTAL, and EW6_FLOW_TOTAL are the difference of the final and first totalizer readings of May for EW1, EW2, and EW6, respectively.

APPENDIX C

System Alarm Log

Appendix C1
System Alarm Logs - May 2018
Lawrence Aviation Industries Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, NY

| Date | Time | TagName | Alarm Description ¹ | Restart | | System Shutdown Reason |
|-----------|-------|----------|--|-----------|-------|--|
| | | | | Date | Time | |
| 5/2/2018 | 14:58 | ASB_SD | Air stripper blower shut down | 5/2/2018 | 14:59 | Complete system shutdown. Local alarm display |
| 5/18/2018 | 14:21 | ASB_SD | Air stripper blower shut down | 5/18/2018 | 14:24 | Complete system shutdown. Local alarm display |
| 5/7/2018 | 6:03 | ASB_SD | Air stripper blower shut down | 5/7/2018 | 6:09 | Complete system shutdown. Local alarm display |
| 5/6/2018 | 22:29 | ASB_SD | Air stripper blower shut down | 5/6/2018 | 22:32 | Complete system shutdown. Local alarm display |
| 5/2/2018 | 14:58 | ASS_LAH | Air stripper sump high level alarm | 5/2/2018 | 14:59 | Complete system shutdown. Local alarm display |
| 5/18/2018 | 14:21 | ASS_LAH | Air stripper sump high level alarm | 5/18/2018 | 14:24 | Complete system shutdown. Local alarm display |
| 5/7/2018 | 6:03 | ASS_LAH | Air stripper sump high level alarm | 5/7/2018 | 6:09 | Complete system shutdown. Local alarm display |
| 5/6/2018 | 22:29 | ASS_LAH | Air stripper sump high level alarm | 5/6/2018 | 22:32 | Complete system shutdown. Local alarm display |
| 5/2/2018 | 14:58 | EW1_SD | Extraction well 1 shut down | 5/2/2018 | 14:59 | Complete system shutdown. Local alarm display |
| 5/18/2018 | 14:21 | EW1_SD | Extraction well 1 shut down | 5/18/2018 | 14:24 | Complete system shutdown. Local alarm display |
| 5/7/2018 | 6:03 | EW1_SD | Extraction well 1 shut down | 5/7/2018 | 6:09 | Complete system shutdown. Local alarm display |
| 5/6/2018 | 22:29 | EW1_SD | Extraction well 1 shut down | 5/6/2018 | 22:32 | Complete system shutdown. Local alarm display |
| 5/2/2018 | 14:58 | EW2_SD | Extraction well 2 shut down | 5/2/2018 | 14:59 | Complete system shutdown. Local alarm display |
| 5/18/2018 | 14:21 | EW2_SD | Extraction well 2 shut down | 5/18/2018 | 14:24 | Complete system shutdown. Local alarm display |
| 5/7/2018 | 6:03 | EW2_SD | Extraction well 2 shut down | 5/7/2018 | 6:09 | Complete system shutdown. Local alarm display |
| 5/6/2018 | 22:29 | EW2_SD | Extraction well 2 shut down | 5/6/2018 | 22:32 | Complete system shutdown. Local alarm display |
| 5/7/2018 | 6:01 | IW2_LAHH | Injection well 2 high-high level alarm | 5/7/2018 | 6:07 | All pumps shut down. Delayed complete system shutdown. Local alarm display |
| 5/2/2018 | 14:52 | P1_SD | Pump shut down | 5/2/2018 | 14:55 | Complete system shutdown. Local alarm display |
| 5/18/2018 | 14:21 | P1_SD | Pump shut down | 5/18/2018 | 14:24 | Complete system shutdown. Local alarm display |
| 5/7/2018 | 6:03 | P1_SD | Pump shut down | 5/7/2018 | 6:09 | Complete system shutdown. Local alarm display |
| 5/6/2018 | 22:29 | P1_SD | Pump shut down | 5/6/2018 | 22:32 | Complete system shutdown. Local alarm display |

Note:

1. Only alarms resulting in system shutdown have been listed.

Appendix C2
System Alarm Logs - May 2018
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, NY

| Date | Time In | Alarm Description ¹ | System Shutdown Reason |
|-----------|-------------|--|--|
| 5/1/2018 | 9:46:13 AM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/2/2018 | 1:46:23 PM | Airstripper Blower alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/2/2018 | 3:36:32 PM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/2/2018 | 6:47:12 PM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/3/2018 | 7:00:25 AM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/3/2018 | 2:13:03 PM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/6/2018 | 10:52:23 PM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/8/2018 | 8:18:52 PM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/8/2018 | 8:48:56 PM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/8/2018 | 9:32:00 PM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/8/2018 | 11:27:53 PM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/10/2018 | 10:11:47 PM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/10/2018 | 10:38:53 PM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/14/2018 | 7:26:29 AM | Airstripper Blower alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/14/2018 | 1:56:20 PM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/16/2018 | 2:25:04 AM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/15/2018 | 4:00:28 PM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/15/2018 | 4:05:53 PM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/15/2018 | 4:12:47 PM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/15/2018 | 4:19:57 PM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/15/2018 | 4:26:53 PM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/15/2018 | 4:34:01 PM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/15/2018 | 4:41:10 PM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/15/2018 | 4:48:16 PM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |
| 5/15/2018 | 7:55:57 PM | Airstripper Blower Sump high level alarm | Blower shutdown due to high water level in the air stripper sump |

Note:

1. Only alarms resulting in system shutdown have been listed.

APPENDIX D

Data Summary Tables

Appendix D1
May 2018 - Facility Process Sampling Aqueous Data
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Facility Location | | | | Lawrence Aviation Industries | | | | | | | | | | | | Old Mill Pond | | | | | | | | | | | |
|----------------------------|---------------------------------------|-------------|---------|------------------------------|---------|-------------------|---------|-----------------------------|---------|-------------------|---------|-------------------|---------|-------------------|---------|-------------------|---------|-------------------|---------|-------------------|---------|-------------------|---------|-----------------|---------|-------------------|----|
| Sample ID | | | | 01-EW01 | | 01-EW02 | | 01-EW02 | | 01-CINF | | 01-AS | | 01-EFF | | 02-EW01 | | 02-EW02 | | 02-EW06 | | 02-AS | | 02-GAC | | 02-EFF | |
| Sample Name | | | | 01-EW01-20180508 | | 01-EW02-20180508 | | 11-EW02-20180508 | | 01-INF-20180508 | | 01-AS-20180508 | | 01-EFF-20180508 | | 02-EW01-20180508 | | 02-EW02-20180508 | | 02-EW06-20180508 | | 02-AS-20180508 | | 02-GAC-20180508 | | 02-EFF-20180508 | |
| Location Code | | | | Extraction Well 1 | | Extraction Well 2 | | Extraction Well 2 Duplicate | | Combined Influent | | Post-Air Stripper | | Facility Effluent | | Extraction Well 1 | | Extraction Well 2 | | Extraction Well 6 | | Post-Air Stripper | | Post-GAC | | Facility Effluent | |
| Sample Date | | | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | |
| Analyte | Cas No. | Units | Results | Qual | Results | Qual | Results | Qual | Results | Qual | Results | Qual | Results | Qual | Results | Qual | Results | Qual | Results | Qual | Results | Qual | Results | Qual | Results | Qual | |
| VOLATILE ORGANIC COMPOUNDS | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| USEPA SOP DW-1 | 1,1,1-Trichloroethane | 71-55-6 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 1.2 | | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | 1,1,2,2-Tetrachloroethane | 79-34-5 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | 1,1,2-Trichloro-1,2,2-Trifluoroethane | 76-13-1 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | 1,1,2-Trichloroethane | 79-00-5 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | 1,1-Dichloroethane | 75-34-3 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 1.7 | | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | 1,1-Dichloroethene | 75-35-4 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.68 | | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | 1,2,3-Trichlorobenzene | 87-61-6 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | 1,2,4-Trichlorobenzene | 120-82-1 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | 1,2-Dibromo-3-Chloropropane | 96-12-8 | ug/l | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ |
| USEPA SOP DW-1 | 1,2-Dibromoethane | 106-93-4 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | 1,2-Dichlorobenzene | 95-50-1 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | 1,2-Dichloroethane | 107-06-2 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | 1,2-Dichloropropane | 78-87-5 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | 1,3-Dichlorobenzene | 541-73-1 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | 1,4-Dichlorobenzene | 106-46-7 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | 2-Butanone | 78-93-3 | ug/l | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U |
| USEPA SOP DW-1 | 2-Hexanone | 591-78-6 | ug/l | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U |
| USEPA SOP DW-1 | 4-Methyl-2-Pentanone | 108-10-1 | ug/l | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U |
| USEPA SOP DW-1 | Acetone | 67-64-1 | ug/l | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U | 5 | U |
| USEPA SOP DW-1 | Benzene | 71-43-2 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | Bromochloromethane | 74-97-5 | ug/l | 1 | U | 1 | U | 1 | U | 1 | U | 1 | U | 1 | U | 1 | U | 1 | U | 1 | U | 1 | U | 1 | U | 1 | U |
| USEPA SOP DW-1 | Bromodichloromethane | 75-27-4 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | Bromoform | 75-25-2 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | Bromomethane | 74-83-9 | ug/l | 1 | UJ | 1 | UJ | 1 | UJ | 1 | UJ | 1 | UJ | 1 | UJ | 1 | UJ | 1 | UJ | 1 | UJ | 1 | UJ | 1 | UJ | 1 | UJ |
| USEPA SOP DW-1 | Carbon Disulfide | 75-15-0 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | Carbon Tetrachloride | 56-23-5 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | Chlorobenzene | 108-90-7 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | Chloroethane | 75-00-3 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | Chloroform | 67-66-3 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.62 | | 0.5 | U | 0.51 | | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | Chloromethane | 74-87-3 | ug/l | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ | 0.53 | J | 0.54 | J | 0.5 | UJ | 0.5 | UJ | 0.5 | UJ |
| USEPA SOP DW-1 | cis-1,2-Dichloroethylene | 156-59-2 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 1.2 | | 1.1 | | 1.9 | | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | cis-1,3-Dichloropropene | 10061-01-5 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | Cyclohexane | 110-82-7 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | Dibromochloromethane | 124-48-1 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | Dichlorodifluoromethane | 75-71-8 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | Ethylbenzene | 100-41-4 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | Isopropylbenzene | 98-82-8 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | M, P Xylenes | 179601-23-1 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | Methyl Acetate | 79-20-9 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | Methyl tert-Butyl Ether | 1634-04-4 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.57 | | 1 | | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | Methylcyclohexane | 108-87-2 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | Methylene Chloride | 75-09-2 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U | 0.5 | U |
| USEPA SOP DW-1 | o-Xylene (1,2-Dimethylbenzene) | 95-47-6 | ug/l | 0.5 | U | 0.5 | U | 0.5 | U | | | | | | | | | | | | | | | | | | |

Appendix D2
May 2018 - Trip Blank
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Facility Location | | | Lawrence Aviation Industries | |
|-----------------------------------|-------------|-------|------------------------------|------|
| Sample ID | | | | |
| Sample Name | | | 01-TB-20180508 | |
| Sample Date | | | 5/8/2018 | |
| Analyte | Cas No. | Units | Results | Qual |
| VOLATILE ORGANIC COMPOUNDS | | | | |
| 1,1,1-Trichloroethane | 71-55-6 | ug/l | 0.5 | U |
| 1,1,2,2-Tetrachloroethane | 79-34-5 | ug/l | 0.5 | U |
| 1,1,2-Trichloro-1,2,2-Trifluoroet | 76-13-1 | ug/l | 0.5 | U |
| 1,1,2-Trichloroethane | 79-00-5 | ug/l | 0.5 | U |
| 1,1-Dichloroethane | 75-34-3 | ug/l | 0.5 | U |
| 1,1-Dichloroethene | 75-35-4 | ug/l | 0.5 | U |
| 1,2,3-Trichlorobenzene | 87-61-6 | ug/l | 0.5 | U |
| 1,2,4-Trichlorobenzene | 120-82-1 | ug/l | 0.5 | U |
| 1,2-Dibromo-3-Chloropropane | 96-12-8 | ug/l | 0.5 | UJ |
| 1,2-Dibromoethane | 106-93-4 | ug/l | 0.5 | U |
| 1,2-Dichlorobenzene | 95-50-1 | ug/l | 0.5 | U |
| 1,2-Dichloroethane | 107-06-2 | ug/l | 0.5 | U |
| 1,2-Dichloropropane | 78-87-5 | ug/l | 0.5 | U |
| 1,3-Dichlorobenzene | 541-73-1 | ug/l | 0.5 | U |
| 1,4-Dichlorobenzene | 106-46-7 | ug/l | 0.5 | U |
| 2-Butanone | 78-93-3 | ug/l | 5.9 | |
| 2-Hexanone | 591-78-6 | ug/l | 5 | U |
| 4-Methyl-2-Pentanone | 108-10-1 | ug/l | 5 | U |
| Acetone | 67-64-1 | ug/l | 15 | |
| Benzene | 71-43-2 | ug/l | 0.5 | U |
| Bromochloromethane | 74-97-5 | ug/l | 1 | U |
| Bromodichloromethane | 75-27-4 | ug/l | 0.5 | U |
| Bromoform | 75-25-2 | ug/l | 0.5 | U |
| Bromomethane | 74-83-9 | ug/l | 1 | UJ |
| Carbon Disulfide | 75-15-0 | ug/l | 0.5 | U |
| Carbon Tetrachloride | 56-23-5 | ug/l | 0.5 | U |
| Chlorobenzene | 108-90-7 | ug/l | 0.5 | U |
| Chloroethane | 75-00-3 | ug/l | 0.5 | U |
| Chloroform | 67-66-3 | ug/l | 0.5 | U |
| Chloromethane | 74-87-3 | ug/l | 0.5 | UJ |
| cis-1,2-Dichloroethylene | 156-59-2 | ug/l | 0.5 | U |
| cis-1,3-Dichloropropene | 10061-01-5 | ug/l | 0.5 | U |
| Cyclohexane | 110-82-7 | ug/l | 0.5 | U |
| Dibromochloromethane | 124-48-1 | ug/l | 0.5 | U |
| Dichlorodifluoromethane | 75-71-8 | ug/l | 0.5 | U |
| Ethylbenzene | 100-41-4 | ug/l | 0.5 | U |
| Isopropylbenzene | 98-82-8 | ug/l | 0.5 | U |
| M, P Xylenes | 179601-23-1 | ug/l | 0.5 | U |
| Methyl Acetate | 79-20-9 | ug/l | 0.5 | U |
| Methyl tert-Butyl Ether | 1634-04-4 | ug/l | 0.5 | U |
| Methylcyclohexane | 108-87-2 | ug/l | 0.5 | U |
| Methylene Chloride | 75-09-2 | ug/l | 0.5 | U |
| o-Xylene (1,2-Dimethylbenzene) | 95-47-6 | ug/l | 0.5 | U |
| Styrene | 100-42-5 | ug/l | 0.5 | U |
| Tetrachloroethylene(PCE) | 127-18-4 | ug/l | 0.5 | U |
| Toluene | 108-88-3 | ug/l | 0.5 | U |
| trans-1,2-Dichloroethene | 156-60-5 | ug/l | 0.5 | U |
| trans-1,3-Dichloropropene | 10061-02-6 | ug/l | 0.5 | U |
| Trichloroethene (TCE) | 79-01-6 | ug/l | 0.5 | U |
| Trichlorofluoromethane | 75-69-4 | ug/l | 0.5 | U |
| Vinyl Chloride | 75-01-4 | ug/l | 0.5 | UJ |

Acronyms:
ID - Identification
U - Non-Detect Value
J - Estimated Value
µg/l - microgram per liter
01 - Lawrence Aviation Industries Facility Sample

Appendix D3
May 2018 - Facility Process Sampling Air Data
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Facility Location | | Lawrence Aviation Industries | | | | | | Old Mill Pond | | | | | | | |
|----------------------------|----------|------------------------------|------|-----------------|------|-----------------|------|----------------|------|----------------|------|----------------|------|----------------|------|
| Sample ID | | 01-INF-GAC01 | | 01-EFF-GAC01 | | 01-EFF-GAC02 | | 02-INF-GAC03 | | 02-EFF-GAC03 | | 02-EFF-GAC01 | | 02-EFF-GAC02 | |
| Sample Name | | BEAG7 | | BEAG8 | | BEAG9 | | BEAH0 | | BEAH1 | | BEAH2 | | BEAH3 | |
| Location Code | | Influent GAC-01 | | Effluent GAC-01 | | Effluent GAC-02 | | Influent | | Post GAC-03 | | Post GAC-01 | | Effluent | |
| Sample Date | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | | 5/8/2018 | |
| Analyte | Cas No. | Results (ppbv) | Qual | Results (ppbv) | Qual | Results (ppbv) | Qual | Results (ppbv) | Qual | Results (ppbv) | Qual | Results (ppbv) | Qual | Results (ppbv) | Qual |
| VOLATILE ORGANIC COMPOUNDS | | | | | | | | | | | | | | | |
| 1,1,1-Trichloroethane | 71-55-6 | 0.34 | J | 0.22 | J | 0.7 | | 1.7 | J | 2.4 | J | 2.3 | J | 2.5 | |
| 1,1-Dichloroethane | 75-34-3 | 0.76 | J | 0.64 | J | 0.69 | | 4 | | 5.8 | | 5.9 | | 6 | |
| 1,1-Dichloroethene | 75-35-4 | 0.26 | J | 0.26 | J | 0.26 | J | 1.6 | J | 2.3 | J | 2.3 | J | 2.4 | J |
| Chloroform | 67-66-3 | 1.1 | | 0.84 | J | 1 | | 1.6 | J | 2.3 | J | 2.3 | J | 2.3 | J |
| cis-1,2-Dichloroethylene | 156-59-2 | 0.42 | J | 0.36 | J | 0.6 | | 5.5 | | 8.5 | | 8.4 | | 8.6 | |
| Tetrachloroethylene(PCE) | 127-18-4 | 4.7 | | 0.64 | J | 0.27 | J | 7 | | 52 | | 1.2 | J | 0.6 | J |
| Trichloroethene (TCE) | 79-01-6 | 170 | | 140 | | 70 | | 300 | | 400 | | 390 | | 370 | |
| Vinyl Chloride | 75-01-4 | 1 | U | 1 | U | 0.5 | U | 2.5 | U | 2.5 | U | 2.5 | U | 2.5 | U |

Acronyms:
ID - identification
U - Non-Detect Value
J - Estimated Value
GAC - Granular Activated Carbon
ppbv - parts per billion
01 - Lawrence Aviation Industries Facility Sample
02 - Old Mill Pond Facility Sample

APPENDIX E

Backup Calculations

Appendix E1 - Backup Calculations
Figure 2-1 - Influent CVOC Concentrations and Mass Removed vs. Time - EW-01
Lawrence Aviation Industries Groundwater Treatment Facility
Lawrence Aviation Industries Site, Port Jefferson Station, New York

| Month | Sample ID | Sample Date | Average Flow Rate (gpm) | Total CVOC Concentration (µg/l) | No. of Pumping Days in Period | Mass Removed and Treated ¹ (lbs) | Cumulative Mass Removed and Treated (lbs) |
|--------------------------|-------------------|-------------|-------------------------|---------------------------------|-------------------------------|---|---|
| ITP ² | ITP EW-01 Day 1 | 9/15/2010 | 47 | 251 | 1 | 0.17 | 0.2 |
| | ITP EW-01 Day 2 | 9/16/2010 | 27 | 281 | 3 | 0.75 | 0.9 |
| | ITP EW-01 Day 4 | 9/19/2010 | 28 | 188 | 1 | 0.17 | 1.1 |
| | ITP EW-01 Day 5 | 9/20/2010 | 75 | 167 | 6 | 1.0 | 2.1 |
| October ^{2,3} | N/A | 10/15/2010 | N/A | 167 | 31 | 1.1 | 3.2 |
| November ^{2,4} | N/A | 11/15/2010 | N/A | 141 | 30 | 1.0 | 4.2 |
| December ^{2,5} | EW-01-101214 | 12/14/2010 | N/A | 115 | 31 | 0.0 | 4.2 |
| January ^{2,5,6} | EW-01-110106 | 1/6/2011 | N/A | 2 | 31 | 0.0 | 4.2 |
| February ^{2,6} | NS | | N/A | | | | |
| March ^{2,5,6} | N/A | 3/15/2011 | N/A | 2 | 31 | 0.0 | 4.2 |
| April ^{2,5} | EW-01-110413 | 4/13/2011 | N/A | 0 | 30 | 0.0 | 4.2 |
| May ^{2,5} | EW-01-110512 | 5/12/2011 | N/A | 126 | 31 | 0.0 | 4.2 |
| June ^{2,5} | EW-01-110609 | 6/9/2011 | N/A | 2 | 30 | 0.0 | 4.2 |
| July ^{2,5} | EW-01-110711 | 7/11/2011 | N/A | 5 | 31 | 0.0 | 4.2 |
| August ^{2,5} | EW-01-110809 | 8/9/2011 | N/A | 2 | 31 | 0.0 | 4.2 |
| September ^{2,5} | EW-01-110913 | 9/13/2011 | N/A | 5 | 30 | 0.0 | 4.2 |
| October ^{2,5} | EW-01-111011 | 10/11/2011 | N/A | 3 | 30 | 0.0 | 4.2 |
| November ^{2,7} | EW-01-111108 | 11/8/2011 | N/A | 5 | 31 | 0.0 | 4.2 |
| December ^{2,7} | EW-01-111213 | 12/13/2011 | N/A | 167 | 30 | 0.0 | 4.2 |
| January ^{2,7} | EW-01-120111 | 1/11/2012 | N/A | 158 | 31 | 0.0 | 4.2 |
| February ^{2,7} | EW-01-120214 | 2/14/2012 | N/A | 229 | 29 | 0.0 | 4.2 |
| March ^{2,7} | EW-01-120313 | 3/13/2012 | N/A | 477 | 31 | 0.0 | 4.2 |
| April ^{2,7} | EW-01-120412 | 4/12/2012 | N/A | 662 | 30 | 0.0 | 4.2 |
| May ^{2,7} | EW-01-120509 | 5/9/2012 | N/A | 836 | 31 | 0.0 | 4.2 |
| June ^{2,7} | EW-01-120613 | 6/13/2012 | N/A | 675 | 30 | 0.0 | 4.2 |
| July ^{2,7} | EW-01-120709 | 7/9/2012 | N/A | 572 | 31 | 0.0 | 4.2 |
| August ^{2,7} | NS | | N/A | | | | |
| September ^{2,7} | EW-01-120912 | 9/12/2012 | N/A | 439 | 30 | 5.0 | 9.2 |
| October | NYD002041531-0006 | 10/25/2012 | 59 | 197 | 31 | 3.75 | 12.9 |
| November | NYD002041531-0027 | 11/19/2012 | 74 | 177 | 30 | 4.13 | 17.1 |
| December | NYD002041531-0047 | 12/19/2012 | 74 | 116 | 31 | 3.04 | 20.1 |
| January | NYD002041531-0069 | 1/29/2013 | 74 | 106 | 31 | 2.49 | 22.6 |
| February | 01-EW01-20130219 | 2/19/2013 | 75 | 115 | 28 | 2.25 | 24.9 |
| March | 01-EW01-20130312 | 3/12/2013 | 71 | 105 | 31 | 2.46 | 27.3 |
| April | 01-EW01-20130409 | 4/9/2013 | 73 | 104 | 30 | 2.61 | 29.9 |
| May | 01-EW01-20130514 | 5/14/2013 | 75 | 97 | 31 | 2.55 | 32.5 |
| June | 01-EW01-20130611 | 6/11/2013 | 74 | 85 | 30 | 2.19 | 34.7 |
| July | 01-EW01-20130709 | 7/9/2013 | 74 | 104 | 31 | 2.77 | 37.4 |
| August | 01-EW01-20130813 | 8/13/2013 | 73 | 83 | 31 | 2.24 | 39.7 |
| September | 01-EW01-20130917 | 9/17/2013 | 74 | 88 | 30 | 2.31 | 42.0 |
| October | 01-EW01-102213 | 10/22/2013 | 75 | 91 | 31 | 2.44 | 44.4 |
| November | 01-EW01-20131119 | 11/19/2013 | 74 | 76 | 30 | 1.91 | 46.3 |
| December | 01-EW01-20131210 | 12/10/2013 | 74 | 94 | 31 | 2.42 | 48.8 |
| January | 01-EW01-20140114 | 1/14/2014 | 75 | 100 | 31 | 2.71 | 51.5 |
| February | 01-EW01-20140211 | 2/11/2014 | 75 | 99 | 28 | 2.44 | 53.9 |
| March | 01-EW01-20140311 | 3/11/2014 | 73 | 93 | 31 | 2.48 | 56.4 |
| April | 01-EW01-20140408 | 4/8/2014 | 74 | 103 | 30 | 2.72 | 59.1 |
| May | 01-EW01-20140506 | 5/6/2014 | 67 | 94 | 31 | 2.22 | 61.3 |
| June | 01-EW01-20140610 | 6/10/2014 | 74 | 85 | 30 | 2.22 | 63.5 |
| July | 01-EW01-20140708 | 7/8/2014 | 74 | 81 | 31 | 2.21 | 65.8 |
| August | 01-EW01-20140812 | 8/12/2014 | 74 | 74 | 31 | 2.01 | 67.8 |
| September | 01-EW01-20140910 | 9/10/2014 | 73 | 67 | 30 | 1.72 | 69.5 |
| October | 01-EW01-20141014 | 10/14/2014 | 76 | 85 | 31 | 2.36 | 71.8 |
| November | 01-EW01-20141111 | 11/11/2014 | 74 | 85 | 30 | 2.36 | 74.2 |
| December | 01-EW01-20141209 | 12/9/2014 | 78 | 78 | 31 | 2.17 | 76.4 |

Appendix E1 - Backup Calculations
Figure 2-1 - Influent CVOC Concentrations and Mass Removed vs. Time - EW-01
Lawrence Aviation Industries Groundwater Treatment Facility
Lawrence Aviation Industries Site, Port Jefferson Station, New York

| Month | Sample ID | Sample Date | Average Flow Rate (gpm) | Total CVOC Concentration (µg/l) | No. of Pumping Days in Period | Mass Removed and Treated ¹ (lbs) | Cumulative Mass Removed and Treated (lbs) |
|-----------|------------------|-------------|-------------------------|---------------------------------|-------------------------------|---|---|
| January | 01-EW01-20150113 | 1/13/2015 | 78 | 84 | 31 | 2.35 | 78.7 |
| February | 01-EW01-20150210 | 2/10/2015 | 77 | 89 | 28 | 2.27 | 81.0 |
| March | 01-EW01-20150310 | 3/10/2015 | 76 | 76 | 31 | 2.14 | 83.1 |
| April | 01-EW01-20150414 | 4/14/2015 | 75 | 74 | 30 | 1.97 | 85.1 |
| May | 01-EW01-20150512 | 5/12/2015 | 75 | 94 | 31 | 2.59 | 87.7 |
| June | 01-EW01-20150609 | 6/9/2015 | 75 | 75 | 30 | 1.99 | 89.7 |
| July | 01-EW01-20150715 | 7/15/2015 | 77 | 72 | 31 | 2.03 | 91.7 |
| August | 01-EW01-20150811 | 8/11/2015 | 77 | 71 | 31 | 1.94 | 93.7 |
| September | 01-EW01-20150908 | 9/8/2015 | 78 | 76 | 30 | 2.11 | 95.8 |
| October | 01-EW01-20151013 | 10/13/2015 | 77 | 83 | 31 | 2.32 | 98.1 |
| November | 01-EW01-20151110 | 11/10/2015 | 76 | 90 | 30 | 2.44 | 100.5 |
| December | 01-EW01-20151208 | 12/8/2015 | 77 | 92 | 31 | 2.64 | 103.2 |
| January | 01-EW01-20160112 | 1/12/2016 | 78 | 84 | 31 | 2.40 | 105.6 |
| February | 01-EW01-20160209 | 2/9/2016 | 78 | 82 | 29 | 2.23 | 107.8 |
| March | 01-EW01-20160308 | 3/8/2016 | 78 | 80 | 31 | 2.32 | 110.1 |
| April | 01-EW01-20160419 | 4/19/2016 | 78 | 79 | 30 | 2.22 | 112.3 |
| May | 01-EW01-20160510 | 5/10/2016 | 78 | 77 | 31 | 2.23 | 114.6 |
| June | 01-EW01-20160614 | 6/14/2016 | 76 | 76 | 30 | 2.03 | 116.6 |
| July | 01-EW01-20160712 | 7/12/2016 | 78 | 67 | 31 | 1.94 | 118.5 |
| August | 01-EW01-20160809 | 8/9/2016 | 76 | 68 | 31 | 1.92 | 120.5 |
| September | 01-EW01-20160913 | 9/13/2016 | 75 | 64 | 30 | 1.60 | 122.1 |
| October | 01-EW01-20161025 | 10/25/2016 | 71 | 79 | 31 | 1.90 | 124.0 |
| November | 01-EW01-20161115 | 11/15/2016 | 78 | 90 | 30 | 2.52 | 126.5 |
| December | 01-EW01-20161212 | 12/12/2016 | 76 | 76 | 31 | 1.61 | 128.1 |
| January | 01-EW01-20170110 | 1/10/2017 | 78 | 67 | 31 | 1.77 | 129.9 |
| February | 01-EW01-20170214 | 2/14/2017 | 78 | 64 | 28 | 1.65 | 131.5 |
| March | 01-EW01-20170316 | 3/16/2017 | 78 | 75 | 31 | 2.13 | 133.6 |
| April | 01-EW01-20170411 | 4/11/2017 | 78 | 75 | 30 | 2.08 | 135.7 |
| May | 01-EW01-20170510 | 5/10/2017 | 78 | 103 | 31 | 2.71 | 138.4 |
| June | 01-EW01-20170613 | 6/13/2017 | 78 | 82 | 30 | 2.29 | 140.7 |
| July | 01-EW01-20170712 | 7/12/2017 | 78 | 80 | 31 | 2.32 | 143.0 |
| August | 01-EW01-20170809 | 8/9/2017 | 77 | 72 | 31 | 2.03 | 145.1 |
| September | 01-EW01-20170913 | 9/13/2017 | 78 | 68 | 30 | 1.89 | 147.0 |
| October | 01-EW01-20171010 | 10/10/2017 | 78 | 79 | 31 | 2.30 | 149.6 |
| November | 01-EW01-20171114 | 11/14/2017 | 78 | 102 | 30 | 2.81 | 152.4 |
| December | 01-EW01-20171212 | 12/12/2017 | 77 | 102 | 31 | 2.90 | 155.3 |
| January | 01-EW01-20180109 | 1/9/2018 | 77 | 113 | 30 | 2.97 | 158.3 |
| February | 01-EW01-20180213 | 2/13/2018 | 77 | 86 | 28 | 2.23 | 160.5 |
| March | 01-EW01-20180314 | 3/14/2018 | 77 | 97 | 31 | 2.79 | 163.3 |
| April | 01-EW01-20180410 | 4/10/2018 | 77 | 101 | 30 | 2.79 | 166.1 |
| May | 01-EW01-20180508 | 5/8/2018 | 77 | 91 | 31 | 2.62 | 168.7 |

Notes:

1. The mass removal rate was calculated using the following formula. Only flow going to the GWTF was included.
Total CVOC Concentration (µg/l) x Groundwater Extracted (gal) x 3.79 (l/gal) x 1(lb)/453,600,000 (µg)
2. Data provided by CDM Smith/USEPA.
3. The sample results for ITP Day 5 were used for October. A representative date of October 15, 2011 was used.
4. The Total CVOC concentration was calculated as an average of the October and December results. A representative date of November 15, 2011 was used.
5. Discharge from EW-01 was routed to the permanganate re-circulation system during this period.
6. EW-01 was not in operation from January 16 to March 20, 2011 due to pump failure. No sample was collected from EW-01 in February or March. The EW-01 January sample results were used for the March calculations. A representative date of March 15, 2011 was used.
7. EW-01 was offline from November 8, 2011 to September 11, 2012. Flow from EW-01 was routed to the air stripper since September 12, 2012.

Acronyms:

CVOC - chlorinated volatile organic compound
ITP - initial testing program
EW- extraction well
GWTF - groundwater treatment facility
ID - identification

lb - pound
µg/l - microgram per liter
gal- gallons
l - liter
NS - no sample

N/A - not available

Appendix E2 - Backup Calculations
Figure 2-2 - Influent CVOC Concentrations and Mass Removed vs. Time - EW-02
Lawrence Aviation Industries Groundwater Treatment Facility
Lawrence Aviation Industries Site, Port Jefferson Station, New York

| Month | Sample ID | Sample Date | Average Flow Rate (gpm) | Total CVOC Concentration (µg/l) | No. of Pumping Days in Period | Mass Removed and Treated ¹ (lbs) | Cumulative Mass Removed and Treated (lbs) |
|--------------------------|-------------------|-------------|-------------------------|---------------------------------|-------------------------------|---|---|
| ITP ² | ITP EW-02 Day 1 | 9/15/2010 | 47 | 154 | 1 | 0.17 | 0.2 |
| | ITP EW-02 Day 2 | 9/16/2010 | 27 | 148 | 3 | 0.25 | 0.4 |
| | ITP EW-02 Day 4 | 9/19/2010 | 26 | 113 | 1 | 0.08 | 0.5 |
| | ITP EW-02 Day 5 | 9/20/2010 | 75 | 90 | 6 | 0.5 | 1.0 |
| October ^{2,3} | N/A | 10/15/2010 | N/A | 90 | 31 | 1.1 | 2.1 |
| November ^{2,4} | EW-02-101105 | 11/15/2010 | N/A | 98 | 30 | 2.0 | 4.1 |
| December ^{2,5} | EW-02-101214 | 12/14/2010 | N/A | 77 | 31 | 1.5 | 5.6 |
| January ^{2,5} | EW-02-110106 | 1/6/2011 | N/A | 134 | 31 | 2.4 | 8.0 |
| February ^{2,6} | EW-02-110303 | 3/3/2011 | N/A | 115 | 28 | 0.5 | 8.5 |
| March ^{2,6} | N/A | 3/15/2011 | N/A | 115 | 31 | 0.7 | 9.2 |
| April ^{2,5} | EW-02-110413 | 4/13/2011 | N/A | 103 | 30 | 1.5 | 10.7 |
| May ^{2,5} | EW-02-110512 | 5/12/2011 | N/A | 124 | 31 | 2.1 | 12.8 |
| June ^{2,5} | EW-02-110609 | 6/9/2011 | N/A | 64 | 30 | 1.1 | 13.9 |
| July ^{2,7} | EW-02-110711 | 7/11/2011 | N/A | 124 | 31 | 0.8 | 14.7 |
| August ^{2,7} | EW-02-110809 | 8/9/2011 | N/A | 164 | 31 | 2.0 | 16.7 |
| September ^{2,5} | EW-02-110913 | 9/13/2011 | N/A | 124 | 30 | 1.7 | 18.4 |
| October ^{2,5} | EW-02-111011 | 10/11/2011 | N/A | 93 | 30 | 1.4 | 19.8 |
| November ^{2,5} | EW-02-111108 | 11/8/2011 | N/A | 124 | 31 | 1.9 | 21.7 |
| December ^{2,5} | EW-02-111213 | 12/13/2011 | N/A | 81 | 30 | 1.4 | 23.1 |
| January ^{2,7} | EW-02-120111 | 1/11/2012 | N/A | 96 | 31 | 1.8 | 24.9 |
| February ^{2,7} | EW-02-120214 | 2/14/2012 | N/A | 90 | 29 | 1.3 | 26.2 |
| March ^{2,7} | EW-02-120313 | 3/13/2012 | N/A | 103 | 31 | 1.5 | 27.7 |
| April ^{2,7} | EW-02-120412 | 4/12/2012 | N/A | 134 | 30 | 1.9 | 29.6 |
| May ^{2,7} | EW-02-120509 | 5/9/2012 | N/A | 124 | 31 | 1.8 | 31.4 |
| June ^{2,7} | EW-02-120613 | 6/13/2012 | N/A | 144 | 30 | 1.9 | 33.3 |
| July ^{2,7} | EW-02-120709 | 7/9/2012 | N/A | 103 | 31 | 0.5 | 33.8 |
| August ^{2,8} | NS | | N/A | | | | |
| September ^{2,7} | EW-02-120912 | 9/12/2012 | N/A | 236 | 30 | 3.4 | 37.2 |
| October | NYD002041531-0007 | 10/25/2012 | 87 | 37 | 31 | 1.03 | 38.2 |
| November | NYD002041531-0028 | 11/19/2012 | 74 | 61 | 30 | 1.41 | 39.6 |
| December | NYD002041531-0048 | 12/19/2012 | 74 | 50 | 31 | 1.31 | 41.0 |
| January | NYD002041531-0070 | 1/29/2013 | 74 | 26 | 31 | 0.61 | 41.6 |
| February | 01-EW02-20130219 | 2/19/2013 | 74 | 60 | 28 | 1.17 | 42.7 |
| March | 01-EW02-20130312 | 3/12/2013 | 74 | 45 | 31 | 1.12 | 43.9 |
| April | 01-EW02-20130409 | 4/9/2013 | 73 | 53 | 30 | 1.33 | 45.2 |
| May | 01-EW02-20130514 | 5/14/2013 | 74 | 49 | 31 | 1.28 | 46.5 |
| June | 01-EW02-20130611 | 6/11/2013 | 74 | 26 | 30 | 0.66 | 47.1 |
| July | 01-EW02-20130709 | 7/9/2013 | 74 | 52 | 31 | 1.39 | 48.5 |
| August | 01-EW02-20130813 | 8/13/2013 | 73 | 36 | 31 | 0.96 | 49.5 |
| September | 01-EW02-20130917 | 9/17/2013 | 74 | 42 | 30 | 1.1 | 50.6 |
| October | 01-EW02-102213 | 10/22/2013 | 75 | 44 | 31 | 1.17 | 51.7 |
| November | 01-EW02-20131119 | 11/19/2013 | 74 | 35 | 30 | 0.88 | 52.6 |
| December | 01-EW02-20131210 | 12/10/2013 | 74 | 37 | 31 | 0.96 | 53.6 |
| January | 01-EW02-20140114 | 1/14/2014 | 75 | 41 | 31 | 1.11 | 54.7 |
| February | 01-EW02-20140211 | 2/11/2014 | 74 | 44 | 28 | 1.09 | 55.8 |
| March | 01-EW02-20140311 | 3/11/2014 | 74 | 42 | 31 | 1.15 | 56.9 |
| April | 01-EW02-20140408 | 4/8/2014 | 74 | 46 | 30 | 1.22 | 58.2 |
| May | 01-EW02-20140506 | 5/6/2014 | 67 | 41 | 31 | 0.97 | 59.1 |
| June | 01-EW02-20140610 | 6/10/2014 | 73 | 41 | 30 | 1.05 | 60.2 |
| July | 01-EW02-20140708 | 7/8/2014 | 74 | 39 | 31 | 1.06 | 61.2 |
| August | 01-EW02-20140812 | 8/12/2014 | 74 | 38 | 31 | 1.04 | 62.3 |
| September | 01-EW02-20140910 | 9/10/2014 | 72 | 38 | 30 | 0.97 | 63.2 |
| October | 01-EW02-20141014 | 10/14/2014 | 75 | 38 | 31 | 1.06 | 64.3 |
| November | 02-EW02-20141112 | 11/12/2014 | 74 | 41 | 30 | 1.10 | 65.4 |
| December | 01-EW02-20141209 | 12/9/2014 | 77 | 35 | 31 | 0.96 | 66.4 |
| January | 01-EW02-20150113 | 1/13/2015 | 77 | 37 | 31 | 1.03 | 67.4 |
| February | 01-EW02-20150210 | 2/10/2015 | 77 | 35 | 28 | 0.89 | 68.3 |
| March | 01-EW02-20150310 | 3/10/2015 | 77 | 31 | 31 | 0.88 | 69.2 |
| April | 01-EW02-20150414 | 4/14/2015 | 77 | 36 | 30 | 0.98 | 70.1 |
| May | 01-EW02-20150512 | 5/12/2015 | 74 | 45 | 31 | 1.23 | 71.4 |
| June | 01-EW02-20150609 | 6/9/2015 | 74 | 44 | 30 | 1.16 | 72.5 |
| July | 01-EW02-20150715 | 7/15/2015 | 76 | 39 | 31 | 1.10 | 73.6 |
| August | 01-EW02-20150811 | 8/11/2015 | 76 | 36 | 31 | 0.97 | 74.6 |

Appendix E2 - Backup Calculations
Figure 2-2 - Influent CVOC Concentrations and Mass Removed vs. Time - EW-02
Lawrence Aviation Industries Groundwater Treatment Facility
Lawrence Aviation Industries Site, Port Jefferson Station, New York

| Month | Sample ID | Sample Date | Average Flow Rate (gpm) | Total CVOC Concentration (µg/l) | No. of Pumping Days in Period | Mass Removed and Treated ¹ (lbs) | Cumulative Mass Removed and Treated (lbs) |
|-----------|------------------|-------------|-------------------------|---------------------------------|-------------------------------|---|---|
| September | 01-EW02-20150909 | 9/9/2015 | 77 | 40 | 30 | 1.11 | 75.7 |
| October | 01-EW02-20151013 | 10/13/2015 | 76 | 36 | 31 | 1.00 | 76.7 |
| November | 01-EW02-20151110 | 11/10/2015 | 78 | 34 | 30 | 0.95 | 77.7 |
| December | 01-EW02-20151208 | 12/8/2015 | 76 | 35 | 31 | 0.98 | 78.6 |
| January | 01-EW02-20160112 | 1/12/2016 | 90 | 31 | 31 | 1.03 | 79.7 |
| February | 01-EW02-20160209 | 2/9/2016 | 76 | 32 | 29 | 0.85 | 80.5 |
| March | 01-EW02-20160308 | 3/8/2016 | 77 | 33 | 31 | 0.94 | 81.5 |
| April | 01-EW02-20160419 | 4/19/2016 | 77 | 36 | 30 | 0.99 | 82.4 |
| May | 01-EW02-20160510 | 5/10/2016 | 77 | 34 | 31 | 0.96 | 83.4 |
| June | 01-EW02-20160614 | 6/14/2016 | 76 | 31 | 30 | 0.82 | 84.2 |
| July | 01-EW02-20160713 | 7/13/2016 | 77 | 28 | 31 | 0.79 | 85.0 |
| August | 01-EW02-20160809 | 8/9/2016 | 75 | 29 | 31 | 0.80 | 85.8 |
| September | 01-EW02-20160913 | 9/13/2016 | 74 | 26 | 30 | 0.63 | 86.4 |
| October | 01-EW02-20161026 | 10/26/2016 | 70 | 24 | 31 | 0.56 | 87.0 |
| November | 01-EW02-20161115 | 11/15/2016 | 77 | 25 | 30 | 0.68 | 87.7 |
| December | 01-EW02-20161212 | 12/12/2016 | 75 | 19 | 31 | 0.40 | 88.1 |
| January | 01-EW02-20170110 | 1/10/2017 | 77 | 19 | 31 | 0.50 | 88.6 |
| February | 01-EW02-20170214 | 2/14/2017 | 77 | 15 | 28 | 0.39 | 89.0 |
| March | 01-EW02-20170316 | 3/16/2017 | 77 | 18 | 31 | 0.50 | 89.5 |
| April | 01-EW02-20170411 | 4/11/2017 | 77 | 20 | 30 | 0.54 | 90.0 |
| May | 01-EW02-20170510 | 5/10/2017 | 77 | 29 | 31 | 0.75 | 90.8 |
| June | 01-EW02-20170613 | 6/13/2017 | 77 | 21 | 30 | 0.57 | 91.3 |
| July | 01-EW02-20170712 | 7/12/2017 | 77 | 23 | 31 | 0.65 | 92.0 |
| August | 01-EW02-20170809 | 8/9/2017 | 76 | 19 | 31 | 0.52 | 92.5 |
| September | 01-EW02-20170913 | 9/13/2017 | 76 | 18 | 30 | 0.49 | 93.0 |
| October | 01-EW02-20171010 | 10/10/2017 | 73 | 20 | 31 | 0.55 | 93.6 |
| November | 01-EW02-20171114 | 11/14/2017 | 77 | 23 | 30 | 0.61 | 94.2 |
| December | 01-EW02-20171212 | 12/12/2017 | 76 | 21 | 31 | 0.58 | 94.8 |
| January | 01-EW02-20180109 | 1/9/2018 | 76 | 20 | 30 | 0.51 | 95.3 |
| February | 01-EW02-20180213 | 2/13/2018 | 76 | 18 | 28 | 0.47 | 95.8 |
| March | 01-EW02-20180314 | 3/14/2018 | 76 | 19 | 31 | 0.55 | 96.4 |
| April | 01-EW02-20180410 | 4/10/2018 | 76 | 20 | 30 | 0.56 | 96.9 |
| May | 01-EW02-20180508 | 5/8/2018 | 79 | 19 | 31 | 0.57 | 97.5 |

Notes:

1. The mass removal rate was calculated using the following formula. Only flow going to the GWTF was included.
Total CVOC Concentration (µg/l) x Groundwater Extracted (gal) x 3.79 (l/gal) x 1(lb)/453,600,000 (µg)
2. Data provided by CDM Smith/USEPA.
3. The sample results for ITP Day 5 were used for October. A representative date of October 15, 2011 was used.
4. The Total CVOC concentration was calculated as an average of the October and December results. A representative date of November 15, 2011 was used.
5. Discharge from EW-02 was treated via the air stripper.
6. Discharge from EW-02 was routed to the permanganate re-circulations system from February 10 to March 20, 2011.
No sample was collected from EW-02 in March. The EW-02 February sample results were used for the March calculations.
A representative date of March 15, 2011 was used.
7. Discharge from EW-02 routed to the permanganate re-circulation system from July 12 to August 4, 2011.
Flow from EW-02 was treated via the air stripper on all other days of the reporting period. EW-02 was offline from July 13, 2012 to September 9, 2012 during injection well redevelopment activities. Flow from EW-02 was treated via the air stripper since September 10, 2012.
8. No sample was collected since the plant was offline during injection well redevelopment activities.

Acronyms:

CVOC - chlorinated volatile organic compound
ITP - initial testing program
EW- extraction well
GWTF - groundwater treatment facility
ID - identification
N/A - not available

lb - pound
µg/l - microgram per liter
gal- gallons
l - liter
NS - no sample

Appendix E3 - Backup Calculations
Figure 3-1 - Influent CVOC Concentrations and Mass Removed vs. Time - EW-1
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Site, Port Jefferson Station, New York

| Month | Sample ID | Sample Date | Average Flow Rate (gpm) | Total CVOCs Concentrations (µg/l) | No. of Pumping Days in Period | Mass Removed and Treated ¹ (lbs) | Cumulative Mass Removed and Treated (lbs) |
|--------------------------|-------------------|-------------|-------------------------|-----------------------------------|-------------------------------|---|---|
| August | N/A | 8/23/2011 | 8 | 313 | 1 | 0.03 | 0.03 |
| | N/A | 8/25/2011 | 8 | 332 | 2 | 0.06 | 0.1 |
| | N/A | 8/30/2011 | 8 | 182 | 5 | 0.10 | 0.2 |
| September | N/A | 9/13/2011 | 6 | 274 | 14 | 0.28 | 0.5 |
| | N/A | 9/15/2011 | 6 | 364 | 2 | 0.06 | 0.5 |
| | N/A | 9/20/2011 | 6 | 274 | 5 | 0.10 | 0.6 |
| | N/A | 9/22/2011 | 7 | 373 | 2 | 0.06 | 0.7 |
| | N/A | 9/27/2011 | 8 | 393 | 5 | 0.20 | 0.9 |
| | N/A | 9/29/2011 | 8 | 152 | 2 | 0.02 | 0.9 |
| October ^{2,3} | N/A | | | | | | |
| November ^{2,3} | N/A | | | | | | |
| December ^{2,3} | N/A | | | | | | |
| January ² | N/A | 1/25/2012 | 30 | 270 | 30 | 2.69 | 3.6 |
| February ² | N/A | 2/17/2012 | 26 | 330 | 30 | 2.69 | 6.3 |
| March ² | N/A | 3/22/2012 | 26 | 230 | 30 | 2.69 | 9.0 |
| April ² | N/A | 4/19/2012 | 37 | 300 | 28 | 2.16 | 11.1 |
| May ² | N/A | 5/31/2012 | 17 | 190 | 28 | 2.16 | 13.3 |
| June ² | N/A | 6/7/2012 | 16 | 320 | 28 | 2.16 | 15.5 |
| July ^{2,4} | | | | | | | |
| August ^{2,4} | | | | | | | |
| September ^{2,4} | | | | | | | |
| October | NYD002041531-0012 | 10/25/2012 | 16 | 333 | 31 | 1.78 | 17.2 |
| November | NYD002041531-0033 | 11/19/2012 | 16 | 314 | 30 | 1.67 | 18.9 |
| December ⁵ | NYD002041531-0053 | 12/19/2012 | 10 | 323 | 31 | 1.20 | 20.1 |
| January | NYD002041531-0080 | 1/30/2013 | 16 | 271 | 31 | 1.61 | 21.7 |
| February | 01-EW01-20130219 | 2/20/2013 | 30 | 282 | 28 | 2.44 | 24.2 |
| March | 02-EW01-20130313 | 3/13/2013 | 33 | 352 | 31 | 4.37 | 28.5 |
| April | 02-EW01-20130410 | 4/10/2013 | 33 | 333 | 30 | 3.90 | 32.4 |
| May | 02-EW01-20130515 | 5/15/2013 | 39 | 333 | 31 | 4.42 | 36.9 |
| June | 02-EW01-20130612 | 6/12/2013 | 48 | 342 | 30 | 5.59 | 42.4 |
| July | 02-EW01-20130710 | 7/10/2013 | 48 | 382 | 31 | 6.65 | 49.1 |
| August | 02-EW01-20130814 | 8/14/2013 | 48 | 403 | 31 | 6.74 | 55.8 |
| September | 02-EW01-20130918 | 9/18/2013 | 38 | 116 | 30 | 1.42 | 57.3 |
| October | 02-EW01-102313 | 10/23/2013 | 30 | 301 | 31 | 3.18 | 60.4 |
| November | 02-EW01-20131120 | 11/20/2013 | 34 | 230 | 30 | 2.64 | 63.1 |
| December | 02-EW01-20131211 | 12/11/2013 | 49 | 249 | 31 | 4.45 | 67.5 |
| January | 02-EW01-20140115 | 1/15/2014 | 48 | 241 | 31 | 4.28 | 71.8 |
| February | 02-EW01-20140212 | 2/12/2014 | 48 | 200 | 28 | 3.15 | 75.0 |
| March | 02-EW01-20140312 | 3/12/2014 | 51 | 189 | 31 | 3.57 | 78.5 |
| April | 02-EW01-20140409 | 4/9/2014 | 53 | 199 | 30 | 3.72 | 82.2 |
| May | 02-EW01-20140507 | 5/7/2014 | 54 | 149 | 31 | 2.97 | 85.2 |
| June | 02-EW01-20140611 | 6/11/2014 | 53 | 199 | 30 | 3.83 | 89.0 |
| July | 02-EW01-20140709 | 7/9/2014 | 51 | 179 | 31 | 3.41 | 92.5 |
| August | 02-EW01-20140813 | 8/13/2014 | 51 | 188 | 31 | 3.59 | 96.0 |
| September | 02-EW01-20140911 | 9/11/2014 | 49 | 169 | 30 | 2.97 | 99.0 |
| October | 02-EW01-20141015 | 10/15/2014 | 49 | 179 | 31 | 3.27 | 99.3 |
| November | 02-EW01-20141112 | 11/12/2014 | 50 | 184 | 30 | 3.30 | 102.6 |
| December | 02-EW01-20141210 | 12/10/2014 | 49 | 158 | 31 | 2.87 | 105.5 |

Appendix E3 - Backup Calculations
Figure 3-1 - Influent CVOC Concentrations and Mass Removed vs. Time - EW-1
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Site, Port Jefferson Station, New York

| Month | Sample ID | Sample Date | Average Flow Rate (gpm) | Total CVOCs Concentrations (µg/l) | No. of Pumping Days in Period | Mass Removed and Treated ¹ (lbs) | Cumulative Mass Removed and Treated (lbs) |
|-----------|------------------|-------------|-------------------------|-----------------------------------|-------------------------------|---|---|
| January | 02-EW01-20150114 | 1/14/2015 | 48 | 167 | 31 | 2.96 | 108.4 |
| February | 02-EW01-20150211 | 2/11/2015 | 48 | 148 | 28 | 2.30 | 110.7 |
| March | 02-EW01-20150311 | 3/11/2015 | 48 | 128 | 31 | 2.28 | 113.0 |
| April | 02-EW01-20150415 | 4/15/2015 | 47 | 138 | 30 | 2.23 | 115.3 |
| May | 02-EW01-20150513 | 5/13/2015 | 47 | 160 | 31 | 2.77 | 118.0 |
| June | 02-EW01-20150610 | 6/10/2015 | 48 | 160 | 30 | 2.77 | 120.8 |
| July | 02-EW01-20150716 | 7/16/2015 | 46 | 129 | 31 | 2.10 | 122.9 |
| August | 02-EW01-20150812 | 8/12/2015 | 47 | 138 | 31 | 2.41 | 125.3 |
| September | 02-EW01-20150909 | 9/9/2015 | 46 | 148 | 30 | 2.45 | 127.8 |
| October | 02-EW01-20151014 | 10/14/2015 | 48 | 278 | 31 | 4.90 | 132.7 |
| November | 02-EW01-20151111 | 11/11/2015 | 48 | 139 | 30 | 2.38 | 135.0 |
| December | 02-EW01-20151209 | 12/9/2015 | 48 | 149 | 31 | 2.64 | 137.7 |
| January | 02-EW01-20160113 | 1/13/2016 | 48 | 138 | 31 | 2.40 | 140.1 |
| February | 02-EW01-20160210 | 2/10/2016 | 48 | 128 | 29 | 2.11 | 142.2 |
| March | 02-EW01-20160309 | 3/9/2016 | 48 | 127 | 31 | 2.27 | 144.5 |
| April | 02-EW01-20160420 | 4/20/2016 | 71 | 128 | 30 | 2.34 | 146.8 |
| May | 02-EW01-20160511 | 5/11/2016 | 69 | 139 | 31 | 3.57 | 150.4 |
| June | 02-EW01-20160615 | 6/15/2016 | 72 | 131 | 30 | 3.39 | 153.7 |
| July | 02-EW01-20160713 | 7/13/2016 | 72 | 127 | 31 | 3.36 | 157.1 |
| August | 02-EW01-20160810 | 8/10/2016 | 72 | 138 | 31 | 3.68 | 160.8 |
| September | 02-EW01-20160914 | 9/14/2016 | 74 | 117 | 30 | 3.20 | 164.0 |
| October | 02-EW01-20161026 | 10/26/2016 | 71 | 128 | 31 | 3.09 | 167.1 |
| November | 02-EW01-20161115 | 11/15/2016 | 58 | 126 | 30 | 2.62 | 169.7 |
| December | 02-EW01-20161212 | 12/12/2016 | 71 | 98 | 31 | 2.57 | 172.3 |
| January | 02-EW01-20170110 | 1/10/2017 | 72 | 107 | 31 | 2.80 | 175.1 |
| February | 02-EW01-20170214 | 2/14/2017 | 73 | 95 | 28 | 2.30 | 177.4 |
| March | 02-EW01-20170316 | 3/16/2017 | 70 | 93 | 31 | 2.43 | 179.8 |
| April | 02-EW01-20170411 | 4/11/2017 | 71 | 108 | 30 | 2.58 | 182.4 |
| May | 02-EW01-20170510 | 5/10/2017 | 72 | 118 | 31 | 3.12 | 185.5 |
| June | 02-EW01-20170613 | 6/13/2017 | 72 | 117 | 30 | 2.88 | 188.4 |
| July | 02-EW01-20170712 | 7/12/2017 | 72 | 119 | 31 | 3.11 | 191.5 |
| August | 02-EW01-20170809 | 8/9/2017 | 71 | 103 | 31 | 2.65 | 194.1 |
| September | 02-EW01-20170913 | 9/13/2017 | 67 | 100 | 30 | 2.39 | 196.5 |
| October | 02-EW01-20171010 | 10/10/2017 | 62 | 109 | 31 | 2.47 | 199.0 |
| November | 02-EW01-20171114 | 11/14/2017 | 64 | 148 | 30 | 3.43 | 202.4 |
| December | 02-EW01-20171212 | 12/12/2017 | 62 | 105 | 31 | 2.43 | 204.9 |
| January | 02-EW01-20180109 | 1/9/2018 | 63 | 100 | 31 | 2.35 | 207.2 |
| February | 02-EW01-20180213 | 2/13/2018 | 64 | 91 | 28 | 1.96 | 209.2 |
| March | 02-EW01-20180314 | 3/14/2018 | 64 | 107 | 31 | 2.56 | 211.7 |
| April | 02-EW01-20180410 | 4/10/2018 | 64 | 127 | 30 | 2.93 | 214.7 |
| May | 02-EW01-20180508 | 5/8/2018 | 36 | 94 | 31 | 2.21 | 216.9 |

Notes:

1. The mass removal rate was calculated using the following formula. Only flow going to the GWTF was included.
Total CVOC Concentration (µg/l) x Groundwater Extracted (gal) x 3.79 (l/gal) x 1(lb)/453,600,000 (µg)
2. Data provided by USEPA/ERT.
3. No October to December 2011 data due to change in sampling strategy.
4. Data for July to September 2012 will be updated when received.
5. Spent vapor GAC unit was turned offline for change-out. All influent water was treated via the liquid phase GAC and the air stripper was turned off.

Acronyms:

| | |
|---|---------------------------------|
| CVOC - chlorinated volatile organic compounds | lb - pound |
| EW- extraction well | µg/l - microgram per liter |
| GWTF - groundwater treatment facility | gal- gallons |
| ID - identification | l - liter |
| N/A - not available | GAC - granular activated carbon |
| gpm - gallons per minute | |

Appendix E4 - Backup Calculations
Figure 3-2 - Influent CVOC Concentrations and Mass Removed vs. Time - EW-2
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Site, Port Jefferson Station, New York

| Month | Sample ID | Sample Date | Average Flow Rate (gpm) | Total CVOC Concentration (µg/l) | No. of Pumping Days in Period | Mass Removed and Treated ¹ (lbs) | Cumulative Mass Removed and Treated (lbs) |
|--------------------------|-------------------|-------------|-------------------------|---------------------------------|-------------------------------|---|---|
| August ² | N/A | 8/23/2011 | 7 | 454 | 0 | 0.00 | 0.0 |
| | N/A | 8/25/2011 | 7 | 443 | 2 | 0.08 | 0.1 |
| | N/A | 8/30/2011 | 7 | 323 | 5 | 0.15 | 0.2 |
| September ² | N/A | 9/13/2011 | 8 | 565 | 14 | 0.70 | 0.9 |
| | N/A | 9/15/2011 | 8 | 436 | 2 | 0.08 | 1.0 |
| | N/A | 9/20/2011 | 8 | 225 | 5 | 0.10 | 1.1 |
| | N/A | 9/22/2011 | 7 | 604 | 2 | 0.10 | 1.2 |
| | N/A | 9/27/2011 | 7 | 555 | 5 | 0.25 | 1.5 |
| | N/A | 9/29/2011 | 8 | 343 | 2 | 0.06 | 1.5 |
| October ^{2,3} | N/A | | | | | | |
| November ^{2,3} | N/A | | | | | | |
| December ^{2,3} | N/A | | | | | | |
| January ² | N/A | 1/25/2012 | 36 | 530 | 30 | 6.47 | 8.0 |
| February ² | N/A | 2/17/2012 | 32 | 610 | 30 | 6.47 | 14.5 |
| March ² | N/A | 3/22/2012 | 34 | 450 | 30 | 6.47 | 20.9 |
| April ² | N/A | 4/19/2012 | 40 | 440 | 28 | 8.29 | 29.2 |
| May ² | N/A | 5/31/2012 | 53 | 470 | 28 | 8.29 | 37.5 |
| June ² | N/A | 6/7/2012 | 56 | 560 | 28 | 8.29 | 45.8 |
| July ^{2,4} | | | | | | | |
| August ^{2,4} | | | | | | | |
| September ^{2,4} | | | | | | | |
| October | NYD002041531-0013 | 10/25/2012 | 52 | 515 | 31 | 8.93 | 54.7 |
| November | NYD002041531-0034 | 11/19/2012 | 52 | 557 | 30 | 9.62 | 64.3 |
| December ⁵ | NYD002041531-0054 | 12/19/2012 | 33 | 576 | 31 | 7.09 | 71.4 |
| January | NYD002041531-0081 | 1/30/2013 | 52 | 464 | 31 | 8.96 | 80.4 |
| February | 01-EW02-20130219 | 2/20/2013 | 38 | 484 | 28 | 5.30 | 85.7 |
| March | 02-EW02-20130313 | 3/13/2013 | 35 | 494 | 31 | 6.39 | 92.1 |
| April | 02-EW02-20130410 | 4/10/2013 | 35 | 474 | 30 | 5.83 | 97.9 |
| May | 02-EW02-20130515 | 5/15/2013 | 20 | 454 | 31 | 3.09 | 101.0 |
| June | 02-EW02-20130612 | 6/12/2013 | 20 | 493 | 30 | 3.33 | 104.3 |
| July | 02-EW02-20130710 | 7/10/2013 | 20 | 495 | 31 | 3.55 | 107.9 |
| August | 02-EW02-20130814 | 8/14/2013 | 20 | 494 | 31 | 3.41 | 111.3 |
| September | 02-EW02-20130918 | 9/18/2013 | 20 | 454 | 30 | 2.87 | 114.2 |
| October | 02-EW02-102313 | 10/23/2013 | 20 | 414 | 31 | 2.97 | 117.1 |
| November | 02-EW02-20131120 | 11/20/2013 | 29 | 321 | 30 | 3.21 | 120.3 |
| December | 02-EW02-20131211 | 12/11/2013 | 50 | 331 | 31 | 6.05 | 126.4 |
| January | 02-EW02-20140115 | 1/15/2014 | 48 | 301 | 31 | 5.35 | 131.7 |
| February | 02-EW02-20140212 | 2/12/2014 | 50 | 260 | 28 | 4.21 | 135.9 |
| March | 02-EW02-20140312 | 3/12/2014 | 52 | 249 | 31 | 4.75 | 140.7 |
| April | 02-EW02-20140409 | 4/9/2014 | 52 | 239 | 30 | 4.45 | 145.1 |
| May | 02-EW02-20140507 | 5/7/2014 | 54 | 179 | 31 | 3.59 | 148.7 |
| June | 02-EW02-20140611 | 6/11/2014 | 54 | 220 | 30 | 4.25 | 153.0 |
| July | 02-EW02-20140709 | 7/9/2014 | 51 | 189 | 31 | 3.59 | 156.6 |
| August | 02-EW02-20140813 | 8/13/2014 | 51 | 178 | 31 | 3.40 | 160.0 |
| September | 02-EW02-20140911 | 9/11/2014 | 49 | 179 | 30 | 3.13 | 163.1 |
| October | 02-EW02-20141015 | 10/15/2014 | 49 | 189 | 31 | 3.46 | 163.4 |
| November | 02-EW02-20141112 | 11/12/2014 | 50 | 202 | 30 | 3.64 | 167.1 |
| December | 02-EW02-20141210 | 12/10/2014 | 50 | 167 | 31 | 3.07 | 170.1 |

Appendix E4 - Backup Calculations
Figure 3-2 - Influent CVOC Concentrations and Mass Removed vs. Time - EW-2
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Site, Port Jefferson Station, New York

| Month | Sample ID | Sample Date | Average Flow Rate (gpm) | Total CVOC Concentration (µg/l) | No. of Pumping Days in Period | Mass Removed and Treated ¹ (lbs) | Cumulative Mass Removed and Treated (lbs) |
|-----------|------------------|-------------|-------------------------|---------------------------------|-------------------------------|---|---|
| January | 02-EW02-20150114 | 1/14/2015 | 49 | 178 | 31 | 3.22 | 173.4 |
| February | 02-EW02-20150211 | 2/11/2015 | 47 | 178 | 28 | 2.76 | 176.1 |
| March | 02-EW02-20150311 | 3/11/2015 | 48 | 148 | 31 | 2.64 | 178.8 |
| April | 02-EW02-20150415 | 4/15/2015 | 47 | 168 | 30 | 2.72 | 181.5 |
| May | 02-EW02-20150513 | 5/13/2015 | 47 | 189 | 31 | 3.28 | 184.8 |
| June | 02-EW02-20150610 | 6/10/2015 | 48 | 180 | 30 | 3.11 | 187.9 |
| July | 02-EW02-20150716 | 7/16/2015 | 45 | 159 | 31 | 2.56 | 190.4 |
| August | 02-EW02-20150812 | 8/12/2015 | 47 | 168 | 31 | 2.92 | 193.4 |
| September | 02-EW02-20150909 | 9/9/2015 | 46 | 158 | 30 | 2.62 | 196.0 |
| October | 02-EW02-20151014 | 10/14/2015 | 53 | 149 | 31 | 2.94 | 198.9 |
| November | 02-EW02-20151111 | 11/11/2015 | 48 | 149 | 30 | 2.55 | 201.5 |
| December | 02-EW02-20151209 | 12/9/2015 | 48 | 159 | 31 | 2.81 | 204.3 |
| January | 02-EW02-20160113 | 1/13/2016 | 48 | 138 | 31 | 2.40 | 206.7 |
| February | 02-EW02-20160210 | 2/10/2016 | 48 | 148 | 29 | 2.44 | 209.1 |
| March | 02-EW02-20160309 | 3/9/2016 | 48 | 128 | 31 | 2.28 | 211.4 |
| April | 02-EW02-20160420 | 4/20/2016 | 79 | 158 | 30 | 3.23 | 214.6 |
| May | 02-EW02-20160511 | 5/11/2016 | 77 | 129 | 31 | 3.69 | 218.3 |
| June | 02-EW02-20160615 | 6/15/2016 | 80 | 121 | 30 | 3.49 | 221.8 |
| July | 02-EW02-20160713 | 7/13/2016 | 80 | 104 | 31 | 3.06 | 224.9 |
| August | 02-EW02-20160810 | 8/10/2016 | 80 | 109 | 31 | 3.21 | 228.1 |
| September | 02-EW02-20160914 | 9/14/2016 | 82 | 93 | 30 | 2.84 | 230.9 |
| October | 02-EW02-20161026 | 10/26/2016 | 79 | 101 | 31 | 2.74 | 233.7 |
| November | 02-EW02-20161115 | 11/15/2016 | 77 | 105 | 30 | 2.90 | 236.6 |
| December | 02-EW02-20161212 | 12/12/2016 | 78 | 86 | 31 | 2.52 | 239.1 |
| January | 02-EW02-20170110 | 1/10/2017 | 78 | 84 | 31 | 2.38 | 241.5 |
| February | 02-EW02-20170214 | 2/14/2017 | 79 | 68 | 28 | 1.79 | 243.2 |
| March | 02-EW02-20170316 | 3/16/2017 | 78 | 78 | 31 | 2.26 | 245.5 |
| April | 02-EW02-20170411 | 4/11/2017 | 79 | 78 | 30 | 2.06 | 247.6 |
| May | 02-EW02-20170510 | 5/10/2017 | 80 | 85 | 31 | 2.50 | 250.1 |
| June | 02-EW02-20170613 | 6/13/2017 | 80 | 80 | 30 | 2.19 | 252.3 |
| July | 02-EW02-20170712 | 7/12/2017 | 80 | 81 | 31 | 2.34 | 254.6 |
| August | 02-EW02-20170809 | 8/9/2017 | 80 | 70 | 31 | 2.03 | 256.6 |
| September | 02-EW02-20170913 | 9/13/2017 | 80 | 67 | 30 | 1.90 | 258.5 |
| October | 02-EW02-20171010 | 10/10/2017 | 73 | 70 | 31 | 1.86 | 260.4 |
| November | 02-EW02-20171114 | 11/14/2017 | 80 | 83 | 30 | 2.41 | 262.8 |
| December | 02-EW02-20171212 | 12/12/2017 | 77 | 62 | 31 | 1.79 | 264.6 |
| January | 02-EW02-20180109 | 1/9/2018 | 80 | 72 | 31 | 2.15 | 266.7 |
| February | 02-EW02-20180213 | 2/13/2018 | 80 | 57 | 28 | 1.52 | 268.3 |
| March | 02-EW02-20180314 | 3/14/2018 | 80 | 61 | 31 | 1.81 | 270.1 |
| April | 02-EW02-20180410 | 4/10/2018 | 77 | 67 | 30 | 1.86 | 271.9 |
| May | 02-EW02-20180508 | 5/8/2018 | 68 | 59 | 31 | 1.48 | 273.4 |

Notes:

1. The mass removal rate was calculated using the following formula. Only flow going to the GWTF was included.
Total CVOC Concentration (µg/l) x Groundwater Extracted (gal) x 3.79 (l/gal) x 1(lb)/453,600,000 (µg)
2. Data provided by USEPA/ERT.
3. No October to December 2011 data due to change in sampling strategy.
4. Data for July to September 2012 will be updated when received.
5. Spent vapor GAC unit was turned offline for change-out. All influent water was treated via the liquid phase GAC and the air stripper was turned off.

Acronyms:

CVOC- chlorinated volatile organic compound
EW- extraction well
GWTF - groundwater treatment facility
ID - identification
N/A - not available
gpm - gallons per minute

lb - pound
µg/l - microgram per liter
gal- gallons
l - liter
GAC - granular activated carbon

Appendix E5 - Backup Calculations
Figure 3-3 - Influent CVOC Concentrations and Mass Removed vs. Time - EW-6
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Site, Port Jefferson Station, New York

| Month | Sample ID | Sample Date | Average Flow Rate (gpm) | Total CVOC Concentration (µg/l) | No. of Pumping Days in Period | Mass Removed and Treated ¹ (lbs) | Cumulative Mass Removed and Treated (lbs) |
|------------------------|------------------|-------------|-------------------------|---------------------------------|-------------------------------|---|---|
| September ² | 02-EW06-20130918 | 9/18/2013 | 19 | 934 | 30 | 3.05 | 3.1 |
| October | 02-EW06-102313 | 10/23/2013 | 18 | 841 | 31 | 2.97 | 6.0 |
| November | 02-EW06-20131120 | 11/20/2013 | 28 | 649 | 30 | 6.12 | 12.1 |
| December | 02-EW06-20131211 | 12/11/2013 | 47 | 687 | 31 | 11.93 | 24.1 |
| January | 02-EW06-20140115 | 1/15/2014 | 47 | 637 | 31 | 11.14 | 35.2 |
| February | 02-EW06-20140212 | 2/12/2014 | 47 | 596 | 28 | 9.14 | 44.4 |
| March | 02-EW06-20140312 | 3/12/2014 | 43 | 575 | 31 | 9.02 | 53.4 |
| April | 02-EW06-20140409 | 4/9/2014 | 39 | 576 | 30 | 7.93 | 61.3 |
| May | 02-EW06-20140507 | 5/7/2014 | 39 | 435 | 31 | 6.35 | 67.7 |
| June | 02-EW06-20140611 | 6/11/2014 | 39 | 557 | 30 | 7.86 | 75.5 |
| July | 02-EW06-20140709 | 7/9/2014 | 39 | 515 | 31 | 7.37 | 82.9 |
| August | 02-EW06-20140813 | 8/13/2014 | 39 | 495 | 31 | 7.09 | 90.0 |
| September | 02-EW06-20140911 | 9/11/2014 | 41 | 474 | 30 | 6.93 | 96.9 |
| October | 02-EW06-20141015 | 10/15/2014 | 46 | 505 | 31 | 8.51 | 98.5 |
| November | 02-EW06-20141112 | 11/12/2014 | 44 | 527 | 30 | 8.26 | 106.7 |
| December | 02-EW06-20141210 | 12/10/2014 | 46 | 342 | 31 | 5.88 | 112.6 |
| January | 02-EW06-20150114 | 1/14/2015 | 48 | 385 | 31 | 6.78 | 119.4 |
| February | 02-EW06-20150211 | 2/11/2015 | 46 | 494 | 28 | 7.65 | 127.1 |
| March | 02-EW06-20150311 | 3/11/2015 | 48 | 394 | 31 | 7.01 | 134.1 |
| April | 02-EW06-20150415 | 4/15/2015 | 47 | 425 | 30 | 6.85 | 140.9 |
| May | 02-EW06-20150513 | 5/13/2015 | 47 | 545 | 31 | 9.43 | 150.3 |
| June | 02-EW06-20150610 | 6/10/2015 | 48 | 517 | 30 | 8.95 | 159.3 |
| July | 02-EW06-20150716 | 7/16/2015 | 44 | 426 | 31 | 6.70 | 166.0 |
| August | 02-EW06-20150812 | 8/12/2015 | 48 | 434 | 31 | 7.64 | 173.6 |
| September | 02-EW06-20150909 | 9/9/2015 | 46 | 414 | 30 | 6.84 | 180.5 |
| October | 02-EW06-20151014 | 10/14/2015 | 47 | 424 | 31 | 7.32 | 187.8 |
| November | 02-EW06-20151111 | 11/11/2015 | 48 | 404 | 30 | 6.93 | 194.7 |
| December | 02-EW06-20151209 | 12/9/2015 | 48 | 445 | 31 | 7.87 | 202.6 |
| January | 02-EW06-20160113 | 1/13/2016 | 48 | 424 | 31 | 7.37 | 209.9 |
| February | 02-EW06-20160210 | 2/10/2016 | 48 | 424 | 29 | 7.00 | 216.9 |
| March | 02-EW06-20160309 | 3/9/2016 | 48 | 393 | 31 | 7.02 | 224.0 |
| April | 02-EW06-20160420 | 4/20/2016 | 67 | 374 | 30 | 6.51 | 230.5 |
| May | 02-EW06-20160511 | 5/11/2016 | 64 | 394 | 31 | 9.42 | 239.9 |
| June | 02-EW06-20160615 | 6/15/2016 | 68 | 373 | 30 | 9.11 | 249.0 |
| July | 02-EW06-20160713 | 7/13/2016 | 66 | 331 | 31 | 8.13 | 257.1 |
| August | 02-EW06-20160810 | 8/10/2016 | 64 | 353 | 31 | 8.35 | 265.5 |
| September | 02-EW06-20160914 | 9/14/2016 | 66 | 301 | 30 | 7.37 | 272.9 |
| October | 02-EW06-20161026 | 10/26/2016 | 64 | 321 | 31 | 7.03 | 279.9 |
| November | 02-EW06-20161115 | 11/15/2016 | 61 | 280 | 30 | 6.16 | 286.0 |
| December | 02-EW06-20161212 | 12/12/2016 | 63 | 311 | 31 | 7.30 | 293.3 |
| January | 02-EW06-20170110 | 1/10/2017 | 70 | 271 | 31 | 6.87 | 300.2 |
| February | 02-EW06-20170214 | 2/14/2017 | 89 | 260 | 28 | 7.68 | 307.9 |
| March | 02-EW06-20170316 | 3/16/2017 | 86 | 250 | 31 | 8.02 | 315.9 |
| April | 02-EW06-20170411 | 4/11/2017 | 88 | 291 | 30 | 8.63 | 324.5 |
| May | 02-EW06-20170510 | 5/10/2017 | 88 | 301 | 31 | 9.76 | 334.3 |
| June | 02-EW06-20170613 | 6/13/2017 | 89 | 282 | 30 | 8.61 | 342.9 |
| July | 02-EW06-20170712 | 7/12/2017 | 88 | 294 | 31 | 9.38 | 352.3 |
| August | 02-EW06-20170809 | 8/9/2017 | 88 | 252 | 31 | 8.06 | 360.4 |
| September | 02-EW06-20170913 | 9/13/2017 | 88 | 232 | 30 | 7.30 | 367.7 |
| October | 02-EW06-20171010 | 10/10/2017 | 85 | 263 | 31 | 8.18 | 378.4 |
| November | 02-EW06-20171114 | 11/14/2017 | 88 | 342 | 30 | 10.87 | 389.3 |
| December | 02-EW06-20171212 | 12/12/2017 | 85 | 281 | 31 | 8.88 | 398.1 |
| January | 02-EW06-20180109 | 1/9/2018 | 88 | 261 | 31 | 8.51 | 406.7 |
| February | 02-EW06-20180213 | 2/13/2018 | 87 | 220 | 28 | 6.47 | 413.1 |
| March | 02-EW06-20180314 | 3/14/2018 | 81 | 331 | 31 | 10.00 | 423.1 |
| April | 02-EW06-20180410 | 4/10/2018 | 80 | 293 | 30 | 8.45 | 431.6 |
| May | 02-EW06-20180508 | 5/8/2018 | 79 | 281 | 31 | 8.28 | 439.9 |

Notes:

- The mass removal rate was calculated using the following formula. Only flow going to the GWTF was included.
Total CVOC Concentration (µg/l) x Groundwater Extracted (gal) x 3.79 (l/gal) x 1 (lb)/453,600,000 (µg)
- Installation and startup of EW-6 was completed by August 31, 2013.

Acronyms:

CVOC - chlorinated volatile organic compound
EW- extraction well
GWTF - groundwater treatment facility
ID - identification
GAC - granular activated carbon

lb - pound
µg/l - microgram per liter
gal- gallons
l - liter
gpm - gallons per minute

APPENDIX F

Summary of Monthly Operations from October 2012 to September 2016

Appendix F1
Summary of Monthly Operations from October 2012 to September 2017
Lawrence Aviation Industries Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Item | Oct. 2012 | Nov. 2012 | Dec. 2012 | Jan. 2013 | Feb. 2013 | Mar. 2013 | Apr. 2013 | May 2013 | Jun. 2013 | Jul. 2013 | Aug. 2013 | Sep. 2013 | Cummulative Year 2 ¹ |
|--|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|------------------------------------|
| Calender Days in Period | 31 | 30 | 31 | 31 | 28 | 31 | 30 | 31 | 30 | 31 | 31 | 30 | 365 |
| Treatment System Runtime (hours) | | | | | | | | | | | | | |
| EW-01 Runtime | 644 | 628 | 704 | 634 | 521 | 657 | 682 | 699 | 697 | 719 | 737 | 704 | 8,026 |
| EW-02 Runtime | 647 | 624 | 706 | 635 | 524 | 662 | 682 | 699 | 695 | 719 | 737 | 705 | 8,035 |
| Treatment System Downtime (hours) | | | | | | | | | | | | | |
| Planned | 79 | 57 | 0 | 0 | 0 | 19 | 0 | 0 | 1 | 15 | 0 | 2 | 173 |
| Unplanned | 18 | 35 | 38 | 110 | 148 | 68 | 38 | 45 | 24 | 10 | 7 | 13 | 554 |
| System Uptime | 86.96% | 87.22% | 94.89% | 85.35% | 77.97% | 88.98% | 94.72% | 93.95% | 96.81% | 96.64% | 99.06% | 97.92% | 91.71% |
| Treatment Summary | | | | | | | | | | | | | |
| Gallons extracted from EW-01 | 2,297,748 | 2,789,848 | 3,155,268 | 2,838,708 | 2,341,080 | 2,949,936 | 2,982,040 | 3,128,604 | 3,076,344 | 3,173,404 | 3,225,336 | 3,134,128 | 35,092,444 |
| Average flow rate from EW-01 (gpm) | 59 | 74 | 74.4 | 74.3 | 74.6 | 71 | 73.2 | 74.7 | 74 | 73.9 | 73.3 | 74.4 | 72.6 |
| Gallons extracted from EW-02 | 3,398,856 | 2,803,508 | 3,138,300 | 2,825,020 | 2,321,688 | 2,938,988 | 2,978,928 | 3,117,764 | 3,066,004 | 3,169,072 | 3,217,712 | 3,128,152 | 36,103,992 |
| Average flow rate from EW-02 (gpm) | 87 | 74 | 74 | 74 | 74.5 | 74.4 | 73.1 | 74.3 | 73.7 | 73.8 | 73.1 | 74.3 | 75.1 |
| Total gallons treated | 5,696,604 | 5,593,356 | 6,293,568 | 5,663,728 | 4,662,768 | 5,888,924 | 5,960,968 | 6,246,368 | 6,142,348 | 6,342,476 | 6,443,048 | 6,262,280 | 71,196,436 |

Acronyms:

gpm - gallons per minute

% - percentage

Notes:

1. Monthly data from September 2010 to September 2012 collected by CDM Smith has not been included herein. Refer to individual monthly reports for appropriate notes.

Appendix F1
Summary of Monthly Operations from October 2012 to September 2017
Lawrence Aviation Industries Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Item | Oct. 2013 | Nov. 2013 | Dec. 2013 | Jan. 2014 | Feb. 2014 | Mar. 2014 | Apr. 2014 | May 2014 | Jun. 2014 | Jul. 2014 | Aug. 2014 | Sep. 2014 | Cummulative Year 3 |
|--|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------------------|
| Calender Days in Period | 31 | 30 | 31 | 31 | 28 | 31 | 30 | 31 | 30 | 31 | 31 | 30 | 365 |
| Treatment System Runtime (hours) | | | | | | | | | | | | | |
| EW-01 Runtime | 715 | 676 | 692 | 722 | 656 | 727 | 709 | 708 | 704 | 738 | 733 | 706 | 8,486 |
| EW-02 Runtime | 715 | 677 | 692 | 722 | 660 | 726 | 709 | 708 | 704 | 738 | 733 | 706 | 8,490 |
| Treatment System Downtime (hours) | | | | | | | | | | | | | |
| Planned | 4 | 7 | 17 | 6 | 1 | 5 | 3 | 17 | 9 | 0 | 10.5 | 13.5 | 92 |
| Unplanned | 25 | 37 | 35 | 16 | 11 | 12 | 8 | 19 | 7 | 6 | 0.5 | 0.5 | 177 |
| System Uptime | 96.10% | 94.03% | 93.01% | 97.04% | 98.21% | 97.72% | 98.47% | 95.16% | 97.78% | 99.19% | 98.52% | 98.06% | 96.94% |
| Treatment Summary | | | | | | | | | | | | | |
| Gallons extracted from EW-01 | 3,202,168 | 3,010,928 | 3,059,608 | 3,250,064 | 2,928,160 | 3,234,224 | 3,160,550 | 2,833,544 | 3,116,864 | 3,262,176 | 3,273,424 | 3,093,440 | 37,425,150 |
| Average flow rate from EW-01 (gpm) | 75 | 73.7 | 73.9 | 75.3 | 74.7 | 72.9 | 74.3 | 66.7 | 73.8 | 73.7 | 74.4 | 73.0 | 73 |
| Gallons extracted from EW-02 | 3,191,552 | 3,006,376 | 3,064,520 | 3,217,176 | 2,924,040 | 3,232,128 | 3,158,330 | 2,832,176 | 3,102,968 | 3,262,096 | 3,272,208 | 3,041,000 | 37,304,570 |
| Average flow rate from EW-02 (gpm) | 74.8 | 74 | 74 | 74.5 | 74.2 | 74.5 | 74.2 | 66.7 | 73.5 | 73.7 | 74.4 | 71.8 | 73 |
| Total gallons treated | 6,393,720 | 6,017,304 | 6,124,128 | 6,467,240 | 5,852,200 | 6,466,352 | 6,318,880 | 5,665,720 | 6,219,832 | 6,524,272 | 6,545,632 | 6,134,440 | 74,729,720 |

Acronyms:

gpm - gallons per minute

% - percentage

Notes:

1. Monthly data from September 2010 to September 2012 collected by CDM Smith has not been included herein. Refer to individual monthly reports for appropriate notes.

Appendix F1
Summary of Monthly Operations from October 2012 to September 2017
Lawrence Aviation Industries Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Item | Oct. 2014 | Nov. 2014 | Dec. 2014 | Jan. 2015 | Feb. 2015 | Mar. 2015 | Apr. 2015 | May 2015 | Jun. 2015 | Jul. 2015 | Aug. 2015 | Sep. 2015 | Cumulative Year 4 ¹ |
|--|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------------------------------|
| Calender Days in Period | 31 | 30 | 31 | 31 | 28 | 31 | 30 | 31 | 30 | 31 | 31 | 30 | 365 |
| Treatment System Runtime (hours) | | | | | | | | | | | | | |
| EW-01 Runtime | 736 | 717 | 716.25 | 725 | 666 | 742 | 707 | 734 | 707 | 711 | 711 | 719 | 8,592 |
| EW-02 Runtime | 737 | 717 | 716 | 725 | 669 | 742 | 707 | 736 | 708 | 711 | 712 | 720 | 8,600 |
| Treatment System Downtime (hours) | | | | | | | | | | | | | |
| Planned | 2.0 | 3.0 | 27.5 | 0.0 | 0.0 | 0.0 | 12.0 | 0.0 | 0.0 | 4.5 | 0.0 | 0.0 | 49 |
| Unplanned | 3.5 | 0.0 | 0.75 | 19.00 | 9.00 | 2.00 | 0.75 | 10.00 | 13.00 | 2.5 | 33.0 | 1.0 | 95 |
| System Uptime | 98.9% | 99.6% | 96.3% | 97.4% | 98.7% | 99.7% | 98.2% | 98.7% | 98.2% | 99.1% | 95.6% | 99.9% | 98.3% |
| Treatment Summary | | | | | | | | | | | | | |
| Gallons extracted from EW-01 | 3,334,832 | 3,188,970 | 3,506,200 | 3,261,210 | 3,085,096 | 3,391,200 | 3,201,808 | 3,288,136 | 3,194,336 | 3,274,400 | 3,283,072 | 3,350,848 | 39,360,108 |
| Average flow rate from EW-01 (gpm) | 75.5 | 74.1 | 77.9 | 78.0 | 77.2 | 76.2 | 75.5 | 74.7 | 75.3 | 76.8 | 77.0 | 77.7 | 76 |
| Gallons extracted from EW-02 | 3,328,600 | 3,194,130 | 3,461,230 | 3,222,900 | 3,085,656 | 3,436,448 | 3,246,528 | 3,261,472 | 3,157,808 | 3,232,384 | 3,243,584 | 3,312,112 | 39,182,852 |
| Average flow rate from EW-02 (gpm) | 75.3 | 74.2 | 76.9 | 77.0 | 76.9 | 77.2 | 76.5 | 73.9 | 74.3 | 75.8 | 75.9 | 76.7 | 76 |
| Total gallons treated | 6,663,432 | 6,383,100 | 6,967,430 | 6,484,110 | 6,170,752 | 6,827,648 | 6,448,336 | 6,549,608 | 6,352,144 | 6,506,784 | 6,526,656 | 6,662,960 | 78,542,960 |

Acronyms:

gpm - gallons per minute

% - percentage

Notes:

1. Monthly data from September 2010 to September 2012 collected by CDM Smith has not been included herein. Refer to individual monthly reports for appropriate notes.

Appendix F1
Summary of Monthly Operations from October 2012 to September 2017
Lawrence Aviation Industries Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Item | Oct. 2015 | Nov. 2015 | Dec. 2015 | Jan. 2016 | Feb. 2016 | Mar. 2016 | Apr. 2016 | May 2016 | Jun. 2016 | Jul. 2016 | Aug. 2016 | Sep. 2016 | Cumulative Year 5 ¹ |
|--|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------------------------------|
| Calender Days in Period | 31 | 30 | 31 | 31 | 29 | 31 | 30 | 31 | 30 | 31 | 31 | 30 | 366 |
| Treatment System Runtime (hours) | | | | | | | | | | | | | |
| EW-01 Runtime | 728 | 718 | 743 | 384 | 694 | 695 | 694 | 740 | 700 | 739 | 741 | 644 | 8,219 |
| EW-02 Runtime | 728 | 718 | 743 | 740 | 696 | 694 | 695 | 740 | 699 | 739 | 741 | 643 | 8,574 |
| Treatment System Downtime (hours) | | | | | | | | | | | | | |
| Planned | 0.0 | 0.0 | 0.0 | 2.0 | 0.0 | 0.8 | 0.0 | 2.8 | 12.3 | 0.5 | 0.0 | 0.5 | 19 |
| Unplanned | 16.5 | 2.0 | 1.25 | 2.50 | 0.50 | 0.00 | 1.00 | 0.25 | 6.00 | 2.0 | 2.8 | 55.0 | 90 |
| System Uptime | 97.8% | 99.7% | 99.8% | 99.4% | 99.9% | 99.9% | 99.9% | 99.6% | 97.5% | 99.7% | 99.6% | 92.3% | 98.8% |
| Treatment Summary | | | | | | | | | | | | | |
| Gallons extracted from EW-01 | 3,367,072 | 3,254,352 | 3,448,304 | 1,786,272 | 3,233,568 | 3,235,664 | 3,236,144 | 3,445,744 | 3,192,080 | 3,439,664 | 3,368,224 | 2,904,096 | 37,911,184 |
| Average flow rate from EW-01 (gpm) | 77.1 | 75.5 | 77.4 | 77.5 | 77.7 | 77.6 | 77.7 | 77.6 | 76.0 | 77.6 | 75.8 | 75.2 | 77 |
| Gallons extracted from EW-02 | 3,329,584 | 3,350,272 | 3,403,680 | 4,014,368 | 3,190,496 | 3,193,440 | 3,190,416 | 3,397,856 | 3,200,784 | 3,393,856 | 3,320,112 | 2,866,112 | 39,850,976 |
| Average flow rate from EW-02 (gpm) | 76.3 | 77.8 | 76.4 | 90.5 | 76.5 | 76.7 | 76.5 | 76.5 | 76.3 | 76.5 | 74.7 | 74.3 | 77 |
| Total gallons treated | 6,696,656 | 6,604,624 | 6,851,984 | 5,800,640 | 6,424,064 | 6,429,104 | 6,426,560 | 6,843,600 | 6,392,864 | 6,833,520 | 6,688,336 | 5,770,208 | 77,762,160 |

Acronyms:

gpm - gallons per minute

% - percentage

Notes:

1. Monthly data from September 2010 to September 2012 collected by CDM Smith has not been included herein. Refer to individual monthly reports for appropriate notes.

Appendix F1
Summary of Monthly Operations from October 2012 to September 2017
Lawrence Aviation Industries Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Item | Oct. 2016 | Nov. 2016 | Dec. 2016 | Jan. 2017 | Feb. 2017 | Mar. 2017 | Apr. 2017 | May 2017 | Jun. 2017 | Jul. 2017 | Aug. 2017 | Sept. 2017 | Cumulative Year 6 ¹ |
|--|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|------------|-----------------------------------|
| Calender Days in Period | 31 | 30 | 31 | 31 | 28 | 31 | 30 | 31 | 30 | 31 | 31 | 30 | 365 |
| Treatment System Runtime (hours) | | | | | | | | | | | | | |
| EW-01 Runtime | 677 | 719 | 666 | 677 | 662 | 726 | 696 | 675 | 709 | 738 | 733 | 720 | 8,398 |
| EW-02 Runtime | 676 | 714 | 677 | 678 | 662 | 727 | 712 | 674 | 710 | 739 | 733 | 718 | 8,420 |
| Treatment System Downtime (hours) | | | | | | | | | | | | | |
| Planned | 63.00 | 1.00 | 46.00 | 23.00 | 9.00 | 15.00 | 6.00 | 2.75 | 1.00 | 1.00 | 1.00 | 0.25 | 169 |
| Unplanned | 4.50 | 5.00 | 21.00 | 43.00 | 1.00 | 2.00 | 2.00 | 67.25 | 9.00 | 4.00 | 10.00 | 1.75 | 171 |
| System Uptime | 90.9% | 99.2% | 91.0% | 91.1% | 98.5% | 97.7% | 98.9% | 90.6% | 98.6% | 99.3% | 98.5% | 99.7% | 96.2% |
| Treatment Summary | | | | | | | | | | | | | |
| Gallons extracted from EW-01 | 2,890,096 | 3,356,208 | 3,032,576 | 3,164,192 | 3,082,992 | 3,387,456 | 3,240,896 | 3,144,064 | 3,308,560 | 3,441,120 | 3,404,032 | 3,355,744 | 38,807,936 |
| Average flow rate from EW-01 (gpm) | 71 | 78 | 76 | 78 | 78 | 78 | 78 | 78 | 78 | 78 | 77 | 78 | 77 |
| Gallons extracted from EW-02 | 2,855,392 | 3,286,608 | 3,045,808 | 3,117,296 | 3,044,720 | 3,344,336 | 3,272,576 | 3,100,560 | 3,265,232 | 3,394,880 | 3,343,232 | 3,271,744 | 38,342,384 |
| Average flow rate from EW-02 (gpm) | 70 | 77 | 75 | 77 | 77 | 77 | 77 | 77 | 77 | 77 | 76 | 76 | 76 |
| Total gallons treated | 5,745,488 | 6,642,816 | 6,078,384 | 6,281,488 | 6,127,712 | 6,731,792 | 6,513,472 | 6,244,624 | 6,573,792 | 6,836,000 | 6,747,264 | 6,627,488 | 77,150,320 |

Acronyms:

gpm - gallons per minute

% - percentage

Notes:

1. Monthly data from September 2010 to September 2012 collected by CDM Smith has not been included herein. Refer to individual monthly reports for appropriate notes.

Appendix F2
Summary of Monthly Operations from October 2012 to September 2017
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Item | Oct. 2012 | Nov. 2012 | Dec. 2012 | Jan. 2013 | Feb. 2013 | Mar. 2013 | Apr. 2013 | May 2013 | Jun. 2013 | Jul. 2013 | Aug. 2013 | Sep. 2013 | Cumulative Yr 1 ¹ |
|--|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|------------------------------|
| Calender Days in Period | 31 | 30 | 31 | 31 | 28 | 31 | 30 | 31 | 30 | 31 | 31 | 30 | 365 |
| Treatment System Runtime (hours) | | | | | | | | | | | | | |
| EW-1 Runtime | 665 | 663 | 744 | 741 | 575 | 744 | 709 | 682.5 | 680 | 723 | 696 | 646 | 8,269 |
| EW-2 Runtime | 665 | 663 | 744 | 741 | 575 | 744 | 709 | 682.5 | 680 | 723 | 696 | 646 | 8,269 |
| EW-6 Runtime | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | 349 | 349 |
| Treatment System Downtime (hours) | | | | | | | | | | | | | |
| Planned | 79 | 57 | 0 | 3 | 97 | 0 | 0 | 54.5 | 29 | 0 | 13 | 65.5 | 398 |
| Unplanned | 0 | 0 | 0 | 0 | 0 | 0 | 11 | 7 | 11 | 21 | 35 | 8.5 | 93.5 |
| System Uptime | 89.38% | 92.08% | 100.00% | 99.59% | 85.56% | 100.00% | 98.47% | 91.73% | 94.44% | 97.18% | 93.55% | 89.72% | 94.31% |
| Treatment Summary | | | | | | | | | | | | | |
| Gallons extracted from EW-1 | 622,080 | 668,160 | 446,400 | 1,305,138 | 864,230 | 1,435,678 | 1,322,059 | 1,597,751 | 1,933,018 | 2,038,214 | 2,059,064 | 1,476,454 | 15,768,246 |
| Average flow rate from EW-1 (gpm) | 16 | 16 | 10 | 16 | 30 | 33 | 33 | 38.7 | 48 | 48 | 48 | 37.9 | 31.3 |
| Gallons extracted from EW-2 | 2,021,760 | 2,171,520 | 1,473,120 | 4,221,765 | 1,027,086 | 1,519,756 | 1,438,736 | 826,196 | 815,192 | 855,960 | 857,944 | 764,264 | 17,993,299 |
| Average flow rate from EW-2 (gpm) | 52 | 52 | 33 | 52 | 38 | 34.7 | 34.6 | 19.8 | 20 | 20 | 20 | 19.5 | 33.0 |
| Gallons extracted from EW-6 | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | 379,888 | 379,888 |
| Average flow rate from EW-6 (gpm) | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | 18.7 | 18.7 |
| Total gallons treated | 2,643,840 | 2,839,680 | 1,919,520 | 5,526,903 | 1,891,316 | 2,955,434 | 2,760,795 | 2,423,947 | 2,748,210 | 2,894,174 | 2,917,008 | 2,620,606 | 34,141,433 |

Acronyms:

gpm - gallons per minute
 % - percentage
 PLC - programmable logic controller

Notes:

1. Monthly data from August 2011 to September 2012 collected by Environmental Restoration, LLC has not been included herein. Refer individual monthly reports for appropriate notes.

Appendix F2
Summary of Monthly Operations from October 2012 to September 2017
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Item | Oct. 2013 | Nov. 2013 | Dec. 2013 | Jan. 2014 | Feb. 2014 | Mar. 2014 | Apr. 2014 | May 2014 | Jun. 2014 | Jul. 2014 | Aug. 2014 | Sep. 2014 | Cumulative Yr 2 |
|--|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|--------------------|
| Calender Days in Period | 31 | 30 | 31 | 31 | 28 | 31 | 30 | 31 | 30 | 31 | 31 | 30 | 365 |
| Treatment System Runtime (hours) | | | | | | | | | | | | | |
| EW-1 Runtime | 712 | 677 | 733 | 742 | 652 | 736 | 710 | 743 | 718 | 740 | 744 | 716 | 8,623 |
| EW-2 Runtime | 712 | 677 | 733 | 742 | 652 | 736 | 710 | 743 | 718 | 740 | 744 | 716 | 8,623 |
| EW-6 Runtime | 712 | 677 | 733 | 742 | 652 | 736 | 710 | 743 | 718 | 740 | 744 | 716 | 8,623 |
| Treatment System Downtime (hours) | | | | | | | | | | | | | |
| Planned | 12 | 39 | 5 | 0 | 19 | 5 | 7 | 0 | 0 | 0 | 0 | 2 | 89 |
| Unplanned | 20 | 4 | 6 | 2 | 1 | 3 | 3 | 1 | 2 | 4 | 0 | 2 | 48 |
| System Uptime | 95.70% | 94.03% | 98.52% | 99.73% | 97.02% | 98.92% | 98.61% | 99.87% | 99.72% | 99.46% | 100.00% | 99.44% | 98.42% |
| Treatment Summary | | | | | | | | | | | | | |
| Gallons extracted from EW-1 | 1,181,304 | 1,340,866 | 2,108,928 | 2,135,224 | 1,876,720 | 2,231,848 | 2,239,568 | 2,322,368 | 2,236,496 | 2,281,056 | 2,200,424 | 2,102,848 | 24,257,650 |
| Average flow rate from EW-1 (gpm) | 29.6 | 33.9 | 48.6 | 48.3 | 48.2 | 51.2 | 52.6 | 53.7 | 53.4 | 51.4 | 49.3 | 48.9 | 47.4 |
| Gallons extracted from EW-2 | 835,992 | 1,159,930 | 2,138,678 | 2,135,224 | 1,876,728 | 2,212,808 | 2,224,852 | 2,344,796 | 2,244,336 | 2,279,628 | 2,181,824 | 2,102,512 | 23,737,308 |
| Average flow rate from EW-2 (gpm) | 20.1 | 29.4 | 49.8 | 49.5 | 49.5 | 51.6 | 52.2 | 53.8 | 53.7 | 51.3 | 48.9 | 48.9 | 46.6 |
| Gallons extracted from EW-6 | 757,007 | 1,078,611 | 2,058,836 | 2,070,261 | 1,814,709 | 1,805,363 | 1,647,036 | 1,734,432 | 1,674,106 | 1,712,433 | 1,792,928 | 1,748,438 | 19,894,160 |
| Average flow rate from EW-6 (gpm) | 18.4 | 27.8 | 47.3 | 47 | 47 | 42.5 | 38.7 | 39.2 | 39.2 | 38.6 | 40.2 | 40.7 | 38.9 |
| Total gallons treated | 2,774,303 | 3,579,407 | 6,306,442 | 6,340,709 | 5,568,157 | 6,250,019 | 6,111,456 | 6,401,596 | 6,154,938 | 6,273,117 | 6,175,176 | 5,953,798 | 67,889,118 |

Acronyms:

gpm - gallons per minute

% - percentage

PLC - programmable logic controller

Notes:

1. Monthly data from August 2011 to September 2012 collected by Environmental Restoration, LLC has not been included herein. Refer individual monthly reports for appropriate notes.

Appendix F2
Summary of Monthly Operations from October 2012 to September 2017
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Item | Oct. 2014 | Nov. 2014 | Dec. 2014 | Jan. 2015 | Feb. 2015 | Mar. 2015 | Apr. 2015 | May 2015 | Jun. 2015 | Jul. 2015 | Aug. 2015 | Sep. 2015 | Cumulative Yr 3 |
|--|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|--------------------|
| Calender Days in Period | 31 | 30 | 31 | 31 | 28 | 31 | 30 | 31 | 30 | 31 | 31 | 30 | 365 |
| Treatment System Runtime (hours) | | | | | | | | | | | | | |
| EW-1 Runtime | 738 | 712 | 724 | 744 | 647 | 743 | 680 | 743 | 720 | 709 | 739 | 714 | 8,612 |
| EW-2 Runtime | 738 | 712 | 724 | 744 | 647 | 743 | 680 | 743 | 720 | 709 | 739 | 714 | 8,612 |
| EW-6 Runtime | 738 | 712 | 724 | 744 | 647 | 743 | 680 | 743 | 720 | 709 | 739 | 714 | 8,612 |
| Treatment System Downtime (hours) | | | | | | | | | | | | | |
| Planned | 4 | 0 | 0 | 0 | 0 | 1 | 0.50 | 1.00 | 0 | 30.75 | 0 | 0 | 37 |
| Unplanned | 2 | 7.75 | 20.5 | 0 | 25.5 | 0 | 40 | 0 | 0 | 4 | 5.5 | 6 | 111 |
| System Uptime | 99.2% | 98.9% | 97.2% | 100.0% | 96.2% | 99.9% | 94.4% | 99.9% | 100.0% | 95.3% | 99.3% | 99.2% | 98.3% |
| Treatment Summary | | | | | | | | | | | | | |
| Gallons extracted from EW-1 | 2,149,232 | 2,139,350 | 2,268,679 | 2,073,921 | 1,853,776 | 2,129,088 | 1,930,520 | 2,072,000 | 2,072,304 | 1,954,272 | 2,084,640 | 1,978,120 | 24,705,902 |
| Average flow rate from EW-1 (gpm) | 48.5 | 50.1 | 49.1 | 47.8 | 47.8 | 47.8 | 47.4 | 46.5 | 48.0 | 45.9 | 47.0 | 46.2 | 47.7 |
| Gallons extracted from EW-2 | 2,152,480 | 2,149,530 | 2,293,146 | 2,114,797 | 1,853,776 | 2,129,108 | 1,930,668 | 2,072,008 | 2,072,304 | 1,931,744 | 2,079,408 | 1,978,304 | 24,757,273 |
| Average flow rate from EW-2 (gpm) | 48.6 | 50.3 | 49.6 | 48.8 | 47.8 | 47.8 | 47.4 | 46.5 | 48.0 | 45.4 | 46.9 | 46.2 | 47.8 |
| Gallons extracted from EW-6 | 2,002,356 | 1,869,801 | 2,141,084 | 2,050,988 | 1,853,228 | 2,127,246 | 1,930,448 | 2,072,000 | 2,071,724 | 1,883,200 | 2,109,272 | 1,978,272 | 24,089,619 |
| Average flow rate from EW-6 (gpm) | 45.2 | 43.8 | 46.4 | 47.6 | 47.8 | 47.7 | 47.3 | 46.5 | 48.0 | 44.3 | 47.6 | 46.2 | 46.5 |
| Total gallons treated | 6,304,068 | 6,158,681 | 6,702,909 | 6,239,706 | 5,560,780 | 6,385,442 | 5,791,636 | 6,216,008 | 6,216,332 | 5,769,216 | 6,273,320 | 5,934,696 | 73,552,794 |

Acronyms:

gpm - gallons per minute

% - percentage

PLC - programmable logic controller

Notes:

1. Monthly data from August 2011 to September 2012 collected by Environmental Restoration, LLC has not been included herein. Refer individual monthly reports for appropriate notes.

Appendix F2
Summary of Monthly Operations from October 2012 to September 2017
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Item | Oct. 2015 | Nov. 2015 | Dec. 2015 | Jan. 2016 | Feb. 2016 | Mar. 2016 | Apr. 2016 | May-2016 | Jun. 2016 | Jul. 2016 | Aug. 2016 | Sep. 2016 | Cumulative Yr 4 |
|--|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|--------------------|
| Calender Days in Period | 31 | 30 | 31 | 31 | 29 | 31 | 30 | 31 | 30 | 31 | 31 | 30 | 366 |
| Treatment System Runtime (hours) | | | | | | | | | | | | | |
| EW-1 Runtime | 740 | 717 | 743 | 728 | 687 | 743 | 519 | 744 | 718 | 738 | 739 | 717 | 8,531 |
| EW-2 Runtime | 740 | 717 | 743 | 728 | 687 | 743 | 519 | 744 | 718 | 738 | 739 | 717 | 8,531 |
| EW-6 Runtime | 740 | 717 | 743 | 728 | 687 | 743 | 519 | 744 | 718 | 738 | 739 | 717 | 8,531 |
| Treatment System Downtime (hours) | | | | | | | | | | | | | |
| Planned | 3 | 0 | 1 | 6 | 0 | 1 | 200.75 | 0.25 | 0 | 0 | 4.5 | 0.25 | 216 |
| Unplanned | 1 | 3 | 0.25 | 11 | 9 | 0.5 | 0.5 | 0.25 | 2.5 | 6.5 | 0.5 | 3 | 38 |
| System Uptime | 99.5% | 99.6% | 99.9% | 97.8% | 98.7% | 99.9% | 72.0% | 99.9% | 99.7% | 99.1% | 99.3% | 99.5% | 97.1% |
| Treatment Summary | | | | | | | | | | | | | |
| Gallons extracted from EW-1 | 2,110,712 | 2,049,248 | 2,115,840 | 2,082,888 | 1,976,320 | 2,138,064 | 2,197,984 | 3,085,976 | 3,094,992 | 3,172,544 | 3,184,776 | 3,184,776 | 30,394,120 |
| Average flow rate from EW-1 (gpm) | 47.5 | 47.6 | 47.5 | 47.7 | 47.9 | 48.0 | 70.6 | 69.2 | 71.9 | 71.7 | 71.8 | 74.1 | 59.6 |
| Gallons extracted from EW-2 | 2,358,520 | 2,051,192 | 2,116,224 | 2,082,944 | 1,976,624 | 2,138,240 | 2,452,752 | 3,428,808 | 3,438,848 | 3,524,992 | 3,536,176 | 3,536,176 | 32,641,496 |
| Average flow rate from EW-2 (gpm) | 53.1 | 47.7 | 47.5 | 47.7 | 48.0 | 48.0 | 78.8 | 76.9 | 79.9 | 79.7 | 79.8 | 82.2 | 64.1 |
| Gallons extracted from EW-6 | 2,062,800 | 2,051,144 | 2,116,208 | 2,082,936 | 1,976,604 | 2,138,196 | 2,087,168 | 2,860,672 | 2,919,300 | 2,936,636 | 2,831,072 | 2,831,072 | 28,893,808 |
| Average flow rate from EW-6 (gpm) | 46.5 | 47.7 | 47.5 | 47.7 | 48.0 | 48.0 | 67.1 | 64.1 | 67.8 | 66.4 | 63.8 | 65.8 | 56.7 |
| Total gallons treated | 6,532,032 | 6,151,584 | 6,348,272 | 6,248,768 | 5,929,548 | 6,414,500 | 6,737,904 | 9,375,456 | 9,453,140 | 9,634,172 | 9,552,024 | 9,552,024 | 91,929,424 |

Acronyms:

gpm - gallons per minute

% - percentage

PLC - programmable logic controller

Notes:

1. Monthly data from August 2011 to September 2012 collected by Environmental Restoration, LLC has not been included herein. Refer individual monthly reports for appropriate notes.

Appendix F2
Summary of Monthly Operations from October 2012 to September 2017
Old Mill Pond Groundwater Treatment Facility
Lawrence Aviation Industries Superfund Site, Port Jefferson Station, New York

| Item | Oct. 2016 | Nov. 2016 | Dec. 2016 | Jan. 2017 | Feb. 2017 | Mar. 2017 | Apr. 2017 | May 2017 | Jun. 2017 | Jul. 2017 | Aug. 2017 | Sept. 2017 | Cumulative Year 5 ¹ |
|--|-----------|-----------|-----------|-----------|-----------|------------|-----------|------------|-----------|------------|------------|------------|-----------------------------------|
| Calender Days in Period | 31 | 30 | 31 | 31 | 28 | 31 | 30 | 31 | 30 | 31 | 31 | 30 | 365 |
| Treatment System Runtime (hours) | | | | | | | | | | | | | |
| EW-1 Runtime | 681 | 550 | 744 | 724 | 662 | 743 | 672 | 736 | 685 | 723 | 725 | 712 | 8,355 |
| EW-2 Runtime | 681 | 718 | 744 | 724 | 662 | 743 | 672 | 736 | 685 | 723 | 725 | 712 | 8,523 |
| EW-6 Runtime | 681 | 718 | 744 | 719 | 662 | 743 | 672 | 736 | 685 | 723 | 725 | 712 | 8,518 |
| Treatment System Downtime (hours) | | | | | | | | | | | | | |
| Planned | 63 | 168 | 0 | 19 | 9 | 0 | 31.5 | 0 | 0.5 | 1 | 0 | 0.25 | 292 |
| Unplanned | 0.5 | 2 | 0 | 1 | 1 | 1 | 17 | 8 | 35 | 20.5 | 19.5 | 7.75 | 113 |
| System Uptime | 91.5% | 99.7% | 100.0% | 97.3% | 98.5% | 99.9% | 93.3% | 98.9% | 95.1% | 97.1% | 97.4% | 98.9% | 97.3% |
| Treatment Summary | | | | | | | | | | | | | |
| Gallons extracted from EW-1 | 2,889,688 | 1,913,496 | 3,164,544 | 3,123,496 | 2,888,152 | 3,136,608 | 2,862,984 | 3,173,712 | 2,977,144 | 3,110,944 | 3,093,704 | 2,845,944 | 35,180,416 |
| Average flow rate from EW-1 (gpm) | 71 | 58 | 71 | 72 | 73 | 70 | 71 | 72 | 72 | 72 | 71 | 67 | 70 |
| Gallons extracted from EW-2 | 3,239,056 | 3,311,528 | 3,500,992 | 3,368,408 | 3,131,712 | 3,489,528 | 3,180,984 | 3,527,136 | 3,306,112 | 3,456,624 | 3,476,464 | 3,415,456 | 40,404,000 |
| Average flow rate from EW-2 (gpm) | 79 | 77 | 78 | 78 | 79 | 78 | 79 | 80 | 80 | 80 | 80 | 80 | 79 |
| Gallons extracted from EW-6 | 2,617,344 | 2,635,616 | 2,811,392 | 3,019,856 | 3,539,656 | 3,838,032 | 3,532,296 | 3,881,464 | 3,642,816 | 3,802,608 | 3,824,768 | 3,756,960 | 40,902,808 |
| Average flow rate from EW-6 (gpm) | 64 | 61 | 63 | 70 | 89 | 86 | 88 | 88 | 89 | 88 | 88 | 88 | 80 |
| Total gallons treated | 8,746,088 | 7,860,640 | 9,476,928 | 9,511,760 | 9,559,520 | 10,464,168 | 9,576,264 | 10,582,312 | 9,926,072 | 10,370,176 | 10,394,936 | 10,018,360 | 116,487,224 |

Acronyms:

gpm - gallons per minute

% - percentage

PLC - programmable logic controller

Notes:

1. Monthly data from August 2011 to September 2012 collected by Environmental Restoration, LLC has not been included herein. Refer individual monthly reports for appropriate notes.