

-DRAFT-

PROJECT STATUS MEMORANDUM


NO. 04-01

TO: Pamela Tames, USEPA

FROM: Mark M. Goldberg, P.E.
Alfred N. Kovalik, P.E.

DATE: March 23, 2004

PROJECT: Rowe Industries Superfund Site
Ground-Water Recovery and Treatment System
January 2004 Status Report
Sag Harbor, New York



LBG Engineering Services, P.C. (LBG) commenced operation of the ground-water remediation system at the above-referenced site on December 17, 2002. This status report presents a summary of system performance, operation and maintenance, and monitoring activities for the site from January 1, 2004 through January 31, 2004. The report includes a summary of system performance parameters, system operation parameters, analytical results for ground-water, system effluent samples, and air quality results.

SUMMARY OF SYSTEM PERFORMANCE AND OPERATION
(January 1, 2004 through January 31, 2004)

- | | |
|---|----------------------------------|
| 1. Hours of operation during the reporting period: | 398 hours (54%) |
| 2. Alarm conditions during the reporting period: | See Table 1 |
| 3. Was the SPDES VOC discharge permit criteria achieved: | yes, (Table 2) |
| 4. Total volume of water pumped during the reporting period: | 11,008,650 gallons |
| 5. Was the system effluent flow below the SPDES limit of 1,023,000 gpd: | yes, (Graph 1) |
| 6. Mass of VOCs recovered during the reporting period: | 5.4 pounds |
| 7. Cumulative mass of VOCs recovered since startup on 12/17/02:
(calculations can be provided upon request) | 103.4 pounds |
| 8. Effluent VOC vapor concentration for the reporting period: | 0.21 mg/m ³ (Table 3) |
| 9. Was the effluent VOC vapor emission rate below 0.022 lbs/hr.:
(calculations can be provided upon request) | yes (0.00273 lbs/hr.) |

GROUND-WATER RECOVERY SYSTEM STATUS SUMMARY

The following table summarizes select recovery well parameters for the reporting period. Table 4 presents a summary of the quality results for water samples collected from the recovery wells. Graph 2 presents PCE concentrations for each recovery well. For wells with water-quality that meets or is approaching remedial criteria, Graph 3 presents PCE concentrations at an expanded scale in order to compare them to the PCE aquifer restoration concentration of 5 ug/L. Laboratory analytical reports are included as Appendix I.

Well	Volume Pumped (gal)	Average Flow (gpm)	Minimum Design Flow Required for Plume Capture (gpm)	Total VOC Concentration (µg/L)	VOC Recovery (lbs)
RW-1	649,551	23.7	26	6.2	0.03
RW-2	636,071	23.1	26	9.8	0.05
RW-3	708,471	30.0	23	12.3	0.07
RW-4*	1,196,200	50.0	13	275.9	2.75
RW-5	1,324,491	55.0	42	18.9	0.21
RW-6	734,999	35.0	28	162.4	1.00
RW-7	1,467,925	69.9	54	193.7	2.37
RW-8	1,236,437	45.8	46	27.3	0.28
RW-9	790,156	44.2	68	92.8	0.61

*Estimated volume and flow due to sensor power supply malfunction.

Recovery wells RW-1, RW-2, RW-8 and RW-9 had average flows below the minimum design flow required to capture the plume due to iron build-up in the recovery wells or associated influent piping. Maintenance of the recovery well piping and influent piping will be scheduled.

BAG FILTER STATUS

The following table presents an operational summary of the bag filter usage and configuration for the reporting period.

Dates	Bank 1	Bank 2	Bank 3
Jan 1 to Jan 14	7 of 8 housings used	7 of 8 housings used	Not active
Jan 14 to Jan 23	7 of 8 housings used	7 of 8 housings used	Not active
Jan 23 to Jan 29	400 micron bag filters used in 8 of 8 housings	400 micron bag filters used in 8 of 8 housings	400 micron bag filters used in 8 of 8 housings
Jan 29 to Jan 31	7 of 8 housings used	7 of 8 housings used	Not active

Unless otherwise specified, 200 micron bag filters were used.

The 400-micron bag filters were used in all three filter banks from January 23 through January 29 to compare the performance to the standard 200-micron bag filters. Based on visual observations, the 400-micron bag filters performed well and did not foul as quickly with iron as

the 200-micron bag filters. The inner lining of the 400-micron bag filter appeared to rip more readily, however, when placing the bags into the housings. Because the established bag filter configuration with the 200-micron filters is working adequately, there are no plans to change to the 400-micron bag filters.

OTHER O&M MODIFICATIONS

During this reporting period, there were no other significant modifications to the full scale pump and treat remediation system.

MMG:ng

Attachments

cc: Terry Gerrish, CH2M Hill
Mark Lucas, CH2M Hill
Phil McAndrew, Kraft Foods, N.A.
Jeff Trad, NYSDEC
Chief-Operation Maintenance and Support Section
(Graph 4, table 2 and Appendix III)
Robert Schneck, RWE, R-1, NYSDEC
David Gilmartin, Jr., Esq., Town of Southampton

H:\NABIS\2004\Monthly reports\January 2004\Status0401\January.doc

TABLES

TABLE 1
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

MAINTENANCE LOG
(January 1, 2004 through January 31, 2004)

Date	Time	System Changes/Modifications	Personnel
1/2/2004	2:00 AM	Communication Failure Alarm.	
1/9/2004	1:35 PM	Reset the Communication Failure Alarm.	PJ
		Replaced the PLC battery.	PJ
		Changed setpoints for static depth to water in Recovery Wells.	PJ
		Replaced the Transducer in RW-7	PJ
		Greased pumps	PJ
1/13/2004	6:43 PM	Power Failure Alarm for RW-5, RW-6, RW-7 and RW-8	
1/14/2004	8:28 AM	Reset power failure alarms and restarted the system	MG
	9:30 AM	Removed ice build-up in the NP4-2 air sample port. Shut system down prior to removing the NP4-2 sample port	MG
		Changed multi-bag filter bags (200 µm) in banks 1 and 2, seven of eight housings used.	MG
	9:45 AM	Restarted the system.	MG
	9:46 AM	RW-9 Low Flow Alarm.	
	9:47 AM	Reset RW-9 Low Flow Alarm	MG
	9:48 AM	RW-9 Low Flow Alarm.	
	11:14 AM	Attempt to troubleshoot RW-9 low flow alarm did not work. Left RW-9 in acknowledge mode but did not reset.	MG
1/18/2004	11:59 AM	Booster Blower Failure Alarm	
1/23/2004	9:04 AM	Reset Booster Blower Failure Alarm. Restarted the system.	MG
	9:04 AM	RW-1, RW-3 and offsite low flow alarms.	
	9:08 AM	Reset RW-1, RW-3 and offsite low flow alarm and restarted the system	MG
	1:09 PM	Restarted RW-9	PJ
		Changed all three banks to 400 micron multi-bag filter bags. All three banks were operating.	MG
1/27/2004	10:00 AM	Communication Failure Alarm	

TABLE 1
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

MAINTENANCE LOG
 (January 1, 2004 through January 31, 2004)

Date	Time	System Changes/Modifications	Personnel
1/29/2004	10:31 AM	Reset the Communication Failure Alarm and Restarted the System. The system had to be re-booted by hitting the circuit breaker switch which triggered several alarms.	MG
	10:33 AM	RW-9 Low Flow Alarm and Onsite Low flow alarm.	
	11:56 AM	Attempt to troubleshoot the RW-9 low flow alarm did not work. Left RW-1 through RW-8 running and left RW-9 in the "off" mode until a Rockwell engineer can troubleshoot. Set onsite combined flow meter setpoint to 200%.	MG
		Changed multi-bag filter bags (200 µm) in banks 1, 2 and 3, seven of eight housings used. Left bank 3 inactive.	MG
1/31/2004	8:56 AM	Turned off RW-1, RW-2 and RW-3 to clean on-site combined flow meter.	PJ
	9:26 AM	Cleaned flow meter and turned RW-1, RW-2 and RW-3 back on. Reset the on-site combined flow meter setpoint to 75%.	PJ
	9:37 AM	Restarted RW-9.	PJ
		Changed lead pumps to TP1A and TP2B.	PJ

TABLE 2

GROUND-WATER REMEDIAL ACTION
 ROWE INDUSTRIES SUPERFUND SITE
 SAG HARBOR, NEW YORK

DISCHARGE WATER QUALITY RESULTS

Date Sampled	pH ^{2/}	TDS (mg/L)	PCE (ug/L)	1,1,1-TCA (ug/L)	TCE (ug/L)	1,1-DCA (ug/L)	1,1-DCE (ug/L)	1,2-DCE (ug/L)	Xylene (ug/L)	Toluene (ug/L)	Ethylbenzene (ug/L)	Methylene Chloride (ug/L)	Freon 113 (ug/L)	Naphthalene (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)
SPDES Limits	6.5 to 8.5	---	1	5	5	5	5	5	5	5	5	5	---	10	7	---	---	---
9-Jan-04	6.75	120	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	34.9 ^{4/}	2.71
14-Jan-04	6.5	110	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	1.72	0.137
23-Jan-04	6.5	110	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	3.18	0.31
29-Jan-04	6.5	100	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	9.96	0.981

SPDES: State Pollutant Discharge Elimination System
 mg/L: Milligrams per liter
 ug/L: Micrograms per liter
 ---: Not established

NM: Not Measured
 TDS: Total dissolved solids
 PCE: Tetrachloroethylene
 TCE: Trichloroethylene
 1,1-DCA: 1,1-Dichloroethane
 1,1-DCE: 1,1-Dichloroethene
 1,2-DCE: 1,2-Dichloroethene
 MTBE: Methyl tert-butyl ether

- Notes:
1. TDS & Freon 113 added to parameter analysis with February 2003 Samples.
 2. pH was measured using litmus paper.
 3. "Discharge" samples were collected from sample port labeled NP2-10.
 4. Elevated iron concentrations on January 9th are attributed to iron build-up at the sample port and collecting water samples soon after re-starting the system.

TABLE 4

GROUND-WATER REMEDIAL ACTION
 ROWE INDUSTRIES SUPERFUND SITE
 SAG HARBOR, NEW YORK

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	Isopropylbenzene (ug/L)	1,1-Dichloroethane (ug/L)	cis-1,2-Dichloroethane (ug/L)	1,1-Dichloroethene (ug/L)	Methylene Chloride (ug/L)	Carbon Disulfide (ug/L)
RW-1	5-Sep-02	ND<1	ND<1	ND<1	27	1.9	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	5-Sep-02	ND<1	ND<1	ND<1	ND<1	2.6	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Oct-02	ND<1	ND<1	ND<1	ND<1	2.2	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	9-Oct-02	ND<1	ND<1	ND<1	ND<1	2.8	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Nov-02	ND<1	ND<1	ND<1	ND<1	-	-	0.032	ND<0.02	-	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Jan-03	ND<1	ND<1	ND<1	ND<1	2.4	16	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	ND<1	ND<1	ND<1	ND<1	2.0	9.8	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	ND<1	ND<1	ND<1	ND<1	1.4	4.3	0.566	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	10
	23-Apr-03	ND<1	ND<1	ND<1	ND<1	1.2	8.6	0.053	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	ND<1	ND<1	ND<1	ND<1	1.8	8.7	0.051	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	3.6
	11-Jun-03	ND<1	ND<1	ND<1	ND<1	ND<1	8.1	0.0290	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	ND<1	ND<1	ND<1	ND<1	2.9	6.6	0.0100	0.03	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	ND<1	ND<1	ND<1	ND<1	2.6	9.4	0.0930	0.011	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	ND<1	ND<1	ND<1	ND<1	3.2	14	0.0540	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
25-Nov-03	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.0613	0.0074	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
23-Dec-03	ND<1	ND<1	ND<1	ND<1	2.2	9.4	0.0190	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
23-Jan-04	ND<1	ND<1	ND<1	ND<1	4.0	2.2	0.0098	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
RW-2	5-Sep-02	190	2.9	ND<1	ND<1	ND<1	21	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	5-Sep-02	120	1.4	ND<1	ND<1	ND<1	18	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Oct-02	140	2	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	9-Oct-02	110	1.9	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	6.6	ND<1
	26-Nov-02	-	-	-	-	-	-	50.9	0.188	-	-	-	-	-	-
	3-Jan-03	38	1.3	ND<1	ND<1	ND<1	7.5	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	31	ND<1	ND<1	ND<1	ND<1	6.7	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	26	1.8	ND<1	ND<1	ND<1	ND<1	11.4	0.059	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	14	1.3	ND<1	ND<1	ND<1	ND<1	6.31	0.212	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	21	2	ND<1	ND<1	ND<1	3.8	5.51	0.052	ND<1	ND<1	ND<1	ND<1	3.7	ND<1
	11-Jun-03	15	0.6	ND<1	ND<1	ND<1	ND<1	3.01	0.885	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	12	ND<1	ND<1	ND<1	ND<1	ND<1	5.34	0.438	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	7.9	ND<1	ND<1	ND<1	ND<1	ND<1	5.99	0.758	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	9.2	0.5	ND<1	ND<1	ND<1	6.0	4.49	0.899	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
25-Nov-03	8.1	0.7	ND<1	ND<1	ND<1	ND<1	6.79	0.101	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
23-Dec-03	5.5	ND<1	ND<1	ND<1	ND<1	5.5	5.46	0.0213	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
23-Jan-04	8.7	ND<1	ND<1	ND<1	ND<1	1.1	5.57	0.207	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	

TABLE 4

GROUND-WATER REMEDIAL ACTION
 ROWE INDUSTRIES SUPERFUND SITE
 SAG HARBOR, NEW YORK

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	Isopropylbenzene (ug/L)	1,1-Dichloroethane (ug/L)	Cis-1,2-Dichloroethene (ug/L)	1,1-Dichloroethene (ug/L)	Methylene Chloride (ug/L)	Carbon Disulfide (ug/L)
RW-3	5-Sep-02	23	1.6	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	5-Sep-02	30	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Oct-02	18	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	9-Oct-02	19	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Nov-02	-	-	-	-	-	-	2.23	2.34	-	-	-	-	-	-
	3-Jan-03	2.8	8.5	4.8	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	2.7	5.8	2.4	ND<1	ND<1	1.8	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	2.4	3.6	1.1	ND<1	ND<1	ND<1	1.84	0.013	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	1.1	1.2	ND<1	ND<1	ND<1	ND<1	1.81	0.395	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	2.2	2.5	1.1	ND<1	ND<1	ND<1	1.68	0.166	ND<1	ND<1	ND<1	ND<1	3.7	ND<1
	11-Jun-03	2.4	3.4	1.8	ND<1	ND<1	ND<1	2.37	0.517	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	2.3	5.7	2.3	ND<1	ND<1	ND<1	1.77	0.656	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	2.8	5.8	2.9	ND<1	ND<1	ND<1	2.24	1.57	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	2.1	5.3	2.6	ND<1	ND<1	ND<1	1.86	1.69	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	1.9	5.2	3.3	ND<1	ND<1	ND<1	2.59	1.27	ND<1	ND<1	0.6	ND<1	ND<1	ND<1
23-Dec-03	1.2	5.8	ND<1	ND<1	ND<1	ND<1	1.96	0.129	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
23-Jan-04	2.2	6.9	3.2	ND<1	ND<1	ND<1	1.96	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
RW-4	23-Sep-02	550	8.5	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-02	590	9.5	1.6	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Oct-02	670	11	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	9-Oct-02	450	9.6	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Nov-02	-	-	-	-	-	-	11	2.41	-	-	-	-	-	-
	3-Jan-03	190	3.8	7.1	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	130	6.5	0.7	ND<1	ND<1	4.3	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	150	3.6	ND<1	ND<1	ND<1	ND<1	1.36	0.041	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	110	3.1	ND<1	ND<1	ND<1	ND<1	3.18	0.136	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	170	5.4	1.0	ND<1	ND<1	3.4	2.38	0.023	ND<1	ND<1	ND<1	ND<1	3.3	ND<1
	11-Jun-03	170	4.8	ND<1	ND<1	ND<1	ND<1	1.03	0.572	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	200	5.9	1.3	ND<1	ND<1	ND<1	2.67	0.292	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	210	5.7	1.1	ND<1	ND<1	ND<1	3.21	0.529	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	390	8.2	1.0	ND<1	ND<1	ND<1	2.95	0.922	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	380	6.8	1.6	ND<1	ND<1	ND<1	6.93	0.221	ND<1	ND<1	0.9	0.8	ND<1	ND<1
23-Dec-03	270	7.9	ND<1	ND<1	ND<1	ND<1	5.45	0.0331	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
23-Jan-04	270	5.9	ND<1	ND<1	ND<1	ND<1	3.56	0.48	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	

TABLE 4

GROUND-WATER REMEDIAL ACTION
 ROWE INDUSTRIES SUPERFUND SITE
 SAG HARBOR, NEW YORK

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	Isopropylbenzene (ug/L)	1,1-Dichloroethane (ug/L)	Cis-1,2-Dichloroethene (ug/L)	1,1-Dichloroethene (ug/L)	Methylene Chloride (ug/L)	Carbon Disulfide (ug/L)
RW-5	12-Sep-02	ND<1	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Sep-02	ND<1	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Oct-02	ND<1	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	9-Oct-02	ND<1	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Nov-02	-	-	-	-	-	-	ND<0.02	ND<0.02	-	-	-	-	-	-
	3-Jan-03	5.5	ND<1	ND<1	ND<1	1.9	1.5	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	5.8	ND<1	ND<1	ND<1	1.1	3.5	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	19	ND<1	ND<1	ND<1	ND<1	ND<1	0.489	0.013	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	12	ND<1	ND<1	ND<1	ND<1	ND<1	0.068	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	21	ND<1	ND<1	ND<1	ND<1	0.8	6.7	ND<0.02	ND<1	ND<1	ND<1	ND<1	3.6	ND<1
	11-Jun-03	21	ND<1	ND<1	ND<1	ND<1	ND<1	6.2	0.76	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	11	ND<1	ND<1	ND<1	ND<1	1.1	9.7	6.47	0.068	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	15	ND<1	ND<1	ND<1	ND<1	0.9	7.3	0.269	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	18	ND<1	ND<1	ND<1	ND<1	ND<1	8.1	0.043	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
25-Nov-03	18	ND<1	ND<1	ND<1	ND<1	ND<1	13.1	0.0097	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
23-Dec-03	11	ND<1	ND<1	ND<1	ND<1	ND<1	7.5	0.0523	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
23-Jan-04	14	ND<1	ND<1	ND<1	ND<1	0.9	4.0	0.05	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	
RW-6	12-Sep-02	69	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Sep-02	140	1.1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Oct-02	120	1.7	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	9-Oct-02	130	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Nov-02	-	-	-	-	-	-	0.37	ND<0.02	-	-	-	-	-	-
	3-Jan-03	110	1.1	ND<1	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	97	1.6	ND<1	ND<1	0.6	ND<1	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	130	1.0	ND<1	ND<1	ND<1	ND<1	3.05	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	79	1.0	ND<1	ND<1	ND<1	ND<1	0.028	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	120	1.8	ND<1	ND<1	0.6	ND<1	0.068	ND<0.02	ND<1	ND<1	ND<1	ND<1	3.5	ND<1
	11-Jun-03	120	0.7	ND<1	ND<1	ND<1	ND<1	0.0097	0.011	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	150	0.6	ND<1	ND<1	ND<1	ND<1	0.186	0.034	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	140	2.2	ND<1	ND<1	ND<1	ND<1	0.089	0.018	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	140	2.6	ND<1	ND<1	ND<1	ND<1	0.023	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
25-Nov-03	180	3.3	1.0	ND<1	ND<1	ND<1	0.342	0.0083	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
23-Dec-03	120	2.6	ND<1	ND<1	ND<1	ND<1	0.017	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
23-Jan-04	160	2.4	ND<1	ND<1	ND<1	ND<1	0.015	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	

GROUND-WATER REMEDIAL ACTION
 ROWE INDUSTRIES SUPERFUND SITE
 SAG HARBOR, NEW YORK

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	Isopropylbenzene (ug/L)	1,1-Dichloroethane (ug/L)	cis-1,2-Dichloroethene (ug/L)	1,1-Dichloroethene (ug/L)	Methylene Chloride (ug/L)	Carbon Disulfide (ug/L)	
RW-7	12-Sep-02	270	4.1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	12-Sep-02	350	5.2	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Oct-02	360	4.7	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	9-Oct-02	370	4.9	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	26-Nov-02	-	-	-	-	-	-	0.075	ND<0.02	-	-	-	-	-	-	-
	3-Jan-03	160	2.5	1.3	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	120	2.3	1.1	ND<1	0.5	1.4	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	160	2.3	ND<1	ND<1	ND<1	ND<1	0.405	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	100	1.8	ND<1	ND<1	ND<1	ND<1	0.016	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	140	3.1	1.0	ND<1	ND<1	ND<1	0.032	ND<0.02	ND<1	ND<1	ND<1	ND<1	4.0	ND<1	
	11-Jun-03	140	2.0	ND<1	ND<1	ND<1	ND<1	0.0246	0.0086	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	150	2.1	ND<1	ND<1	ND<1	ND<1	0.024	0.041	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	120	2.3	ND<1	ND<1	ND<1	ND<1	0.011	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	130	2.9	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	140	3.4	1.1	ND<1	ND<1	ND<1	0.0464	ND<0.02	ND<1	ND<1	0.2	ND<1	ND<1	ND<1	ND<1
23-Dec-03	110	2.8	ND<1	ND<1	ND<1	ND<1	0.0239	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
23-Jan-04	190	3.7	ND<1	ND<1	ND<1	ND<1	0.0069	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
RW-8	23-Sep-02	130	7.1	ND<1	ND<1	ND<1	-	-	-	1.1	ND<1	ND<1	ND<1	ND<1	ND<1	
	23-Sep-02	100	6.6	ND<1	ND<1	ND<1	-	-	-	1.4	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Oct-02	100	7.5	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	9-Oct-02	94	6.6	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	26-Nov-02	-	-	-	-	-	-	12.1	1.43	-	-	-	-	-	-	-
	3-Jan-03	59	4.3	4	ND<1	ND<1	ND<1	-	-	ND<1	2.4	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	58	4.2	3.2	ND<1	ND<1	ND<1	-	-	ND<1	1.8	0.6	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	70	2.9	2.7	ND<1	ND<1	ND<1	0.544	0.141	ND<1	1.4	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	41	2.0	1.8	ND<1	ND<1	ND<1	11.8	0.352	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	61	3.9	3.8	ND<1	ND<1	ND<1	10.1	0.068	ND<1	1.8	ND<1	ND<1	3.4	ND<1	ND<1
	11-Jun-03	57	3.1	2.7	ND<1	ND<1	ND<1	9.14	1.10	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	35	1.9	3.2	ND<1	ND<1	ND<1	10.5	0.43	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	30	1.7	3.6	ND<1	ND<1	ND<1	11.1	1.18	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	28	2.5	4.4	ND<1	ND<1	ND<1	9.93	0.40	ND<1	3.3	ND<1	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	27	2.3	5.4	ND<1	ND<1	ND<1	13.3	0.21	ND<1	4.1	0.7	1.3	ND<1	ND<1	ND<1
23-Dec-03	17	2.1	2.6	ND<1	ND<1	ND<1	9.16	0.05	ND<1	1.3	ND<1	ND<1	ND<1	ND<1	ND<1	
23-Jan-04	16	2.2	4.1	ND<1	ND<1	ND<1	9.73	2.72	ND<1	3.5	ND<1	1.5	ND<1	ND<1	ND<1	

TABLE 4

GROUND-WATER REMEDIAL ACTION
 ROWE INDUSTRIES SUPERFUND SITE
 SAG HARBOR, NEW YORK

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	Isopropylbenzene (ug/L)	1,1-Dichloroethane (ug/L)	cis-1,2-Dichloroethene (ug/L)	1,1-Dichloroethene (ug/L)	Methylene Chloride (ug/L)	Carbon Disulfide (ug/L)	
RW-9	23-Sep-02	12	2.9	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	23-Sep-02	11	3	3.5	ND<1	ND<1	-	-	-	ND<1	5.3	ND<1	ND<1	ND<1	ND<1	
	8-Oct-02	9.2	2.5	3.5	ND<1	ND<1	-	-	-	ND<1	6	1.1	ND<1	ND<1	ND<1	
	9-Oct-02	16	3.4	6.6	ND<1	ND<1	-	-	-	ND<1	5.2	ND<1	ND<1	ND<1	ND<1	
	26-Nov-02	-	-	-	-	-	-	2.99	1.72	-	-	-	-	-	-	-
	3-Jan-03	17	2.5	6.9	ND<1	ND<1	ND<1	-	-	ND<1	3.1	ND<1	ND<1	ND<1	ND<1	
	23-Jan-03	23	2.8	4.3	ND<1	ND<1	ND<1	-	-	ND<1	2.5	0.6	ND<1	ND<1	ND<1	
	21-Mar-03	23	2.2	2.8	2.8	ND<1	ND<1	11.0	0.013	ND<1	1.7	ND<1	ND<1	ND<1	ND<1	
	23-Apr-03	15	1.2	1.8	1.8	ND<1	ND<1	3.55	1.97	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	13-May-03	21	1.8	1.8	3.6	ND<1	ND<1	2.95	0.046	ND<1	1.9	ND<1	ND<1	3.2	ND<1	
	11-Jun-03	18	1.6	1.6	4.8	ND<1	ND<1	2.75	1.74	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	23-Jul-03	4.7	1.6	7.3	ND<1	ND<1	ND<1	3.60	0.467	ND<1	3.6	ND<1	ND<1	ND<1	ND<1	
	23-Sep-03	25	1.2	1.2	3.5	ND<1	ND<1	4.05	2.69	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	30-Oct-03	22	2.1	2.1	5.8	ND<1	ND<1	3.49	2.88	ND<1	3.5	ND<1	ND<1	ND<1	ND<1	
	25-Nov-03	27	2.2	2.2	8.2	ND<1	ND<1	5.39	1.72	ND<1	5.2	1.72	1.4	ND<1	ND<1	
	23-Dec-03	11	1.7	1.7	5.4	ND<1	ND<1	1.94	1.57	ND<1	3.0	ND<1	ND<1	ND<1	ND<1	
23-Jan-04	2.3	2.2	13	ND<1	ND<1	ND<1	0.638	0.029	ND<1	1.8	ND<1	1.5	ND<1	72		

ND: Not detected
 <#: Less than method detection limit
 ug/L: Micrograms per liter
 -: Not analyzed


PCE: Tetrachloroethylene
 TCE: Trichloroethylene
 TCA: 1,1,1-Trichloroethane
 1,1-DCA: 1,1-Dichloroethane

1,1-DCE: 1,1-Dichloroethene
 1,2-DCE: 1,2-Dichloroethene
 MTBE: Methyl Tertiary Butyl Ether

GRAPHS


GRAPH 1
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

EFFLUENT FLOW DATA
 (January 1, 2004 through January 31, 2004)

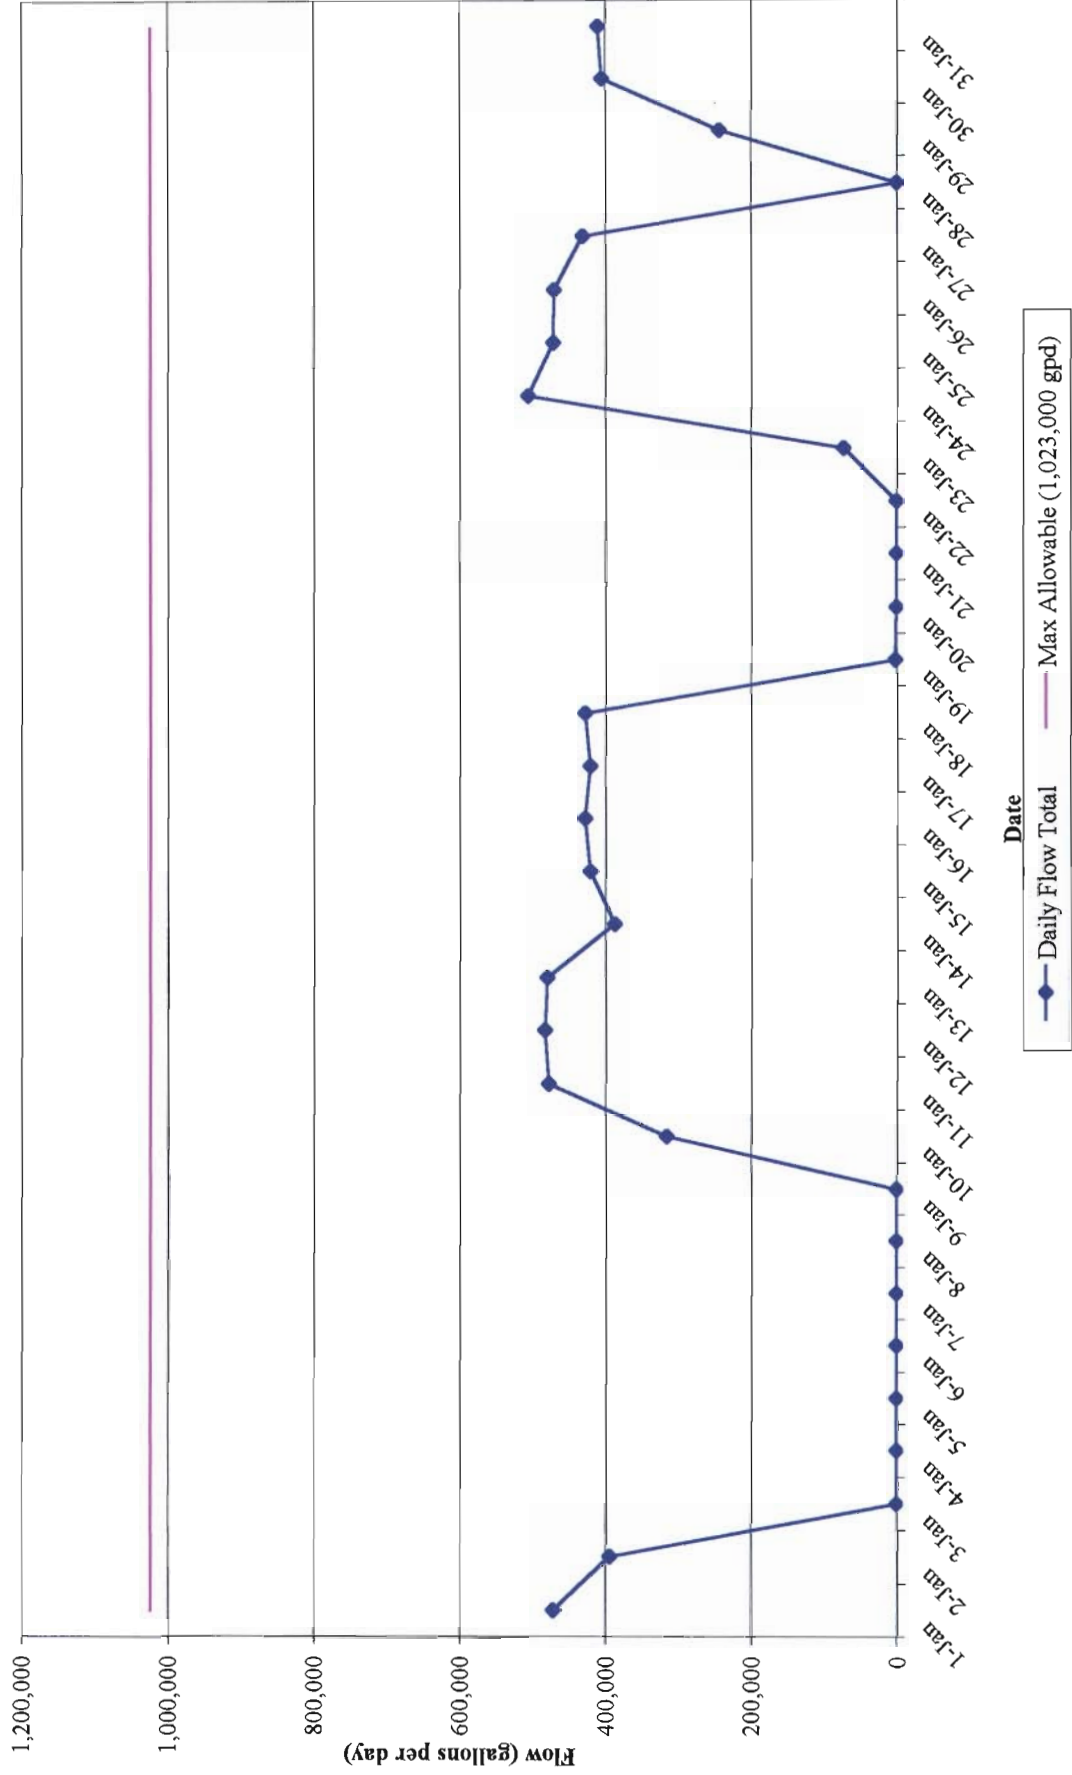


GRAPH 2
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RECOVERY WELL PCE CONCENTRATION IN MICROGRAMS PER LITER

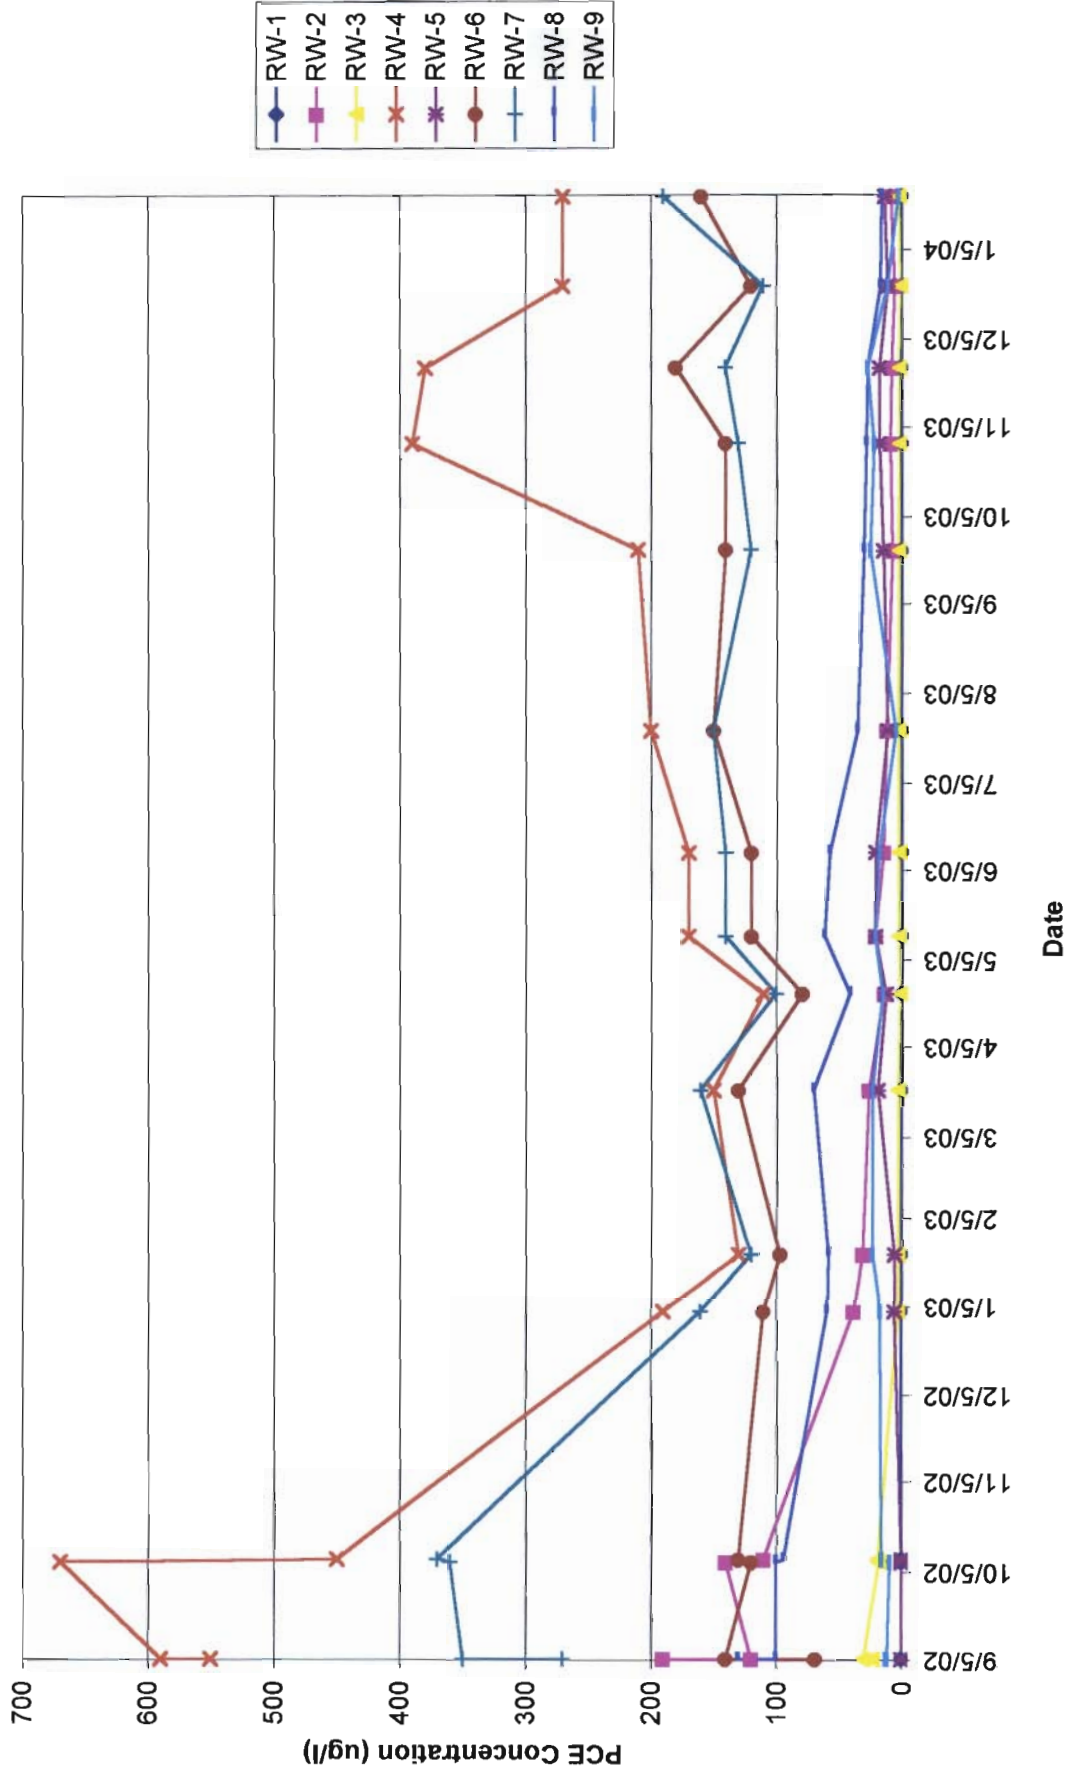

GRAPH 3
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RECOVERY WELL PCE CONCENTRATION FOR SELECT RECOVERY WELLS

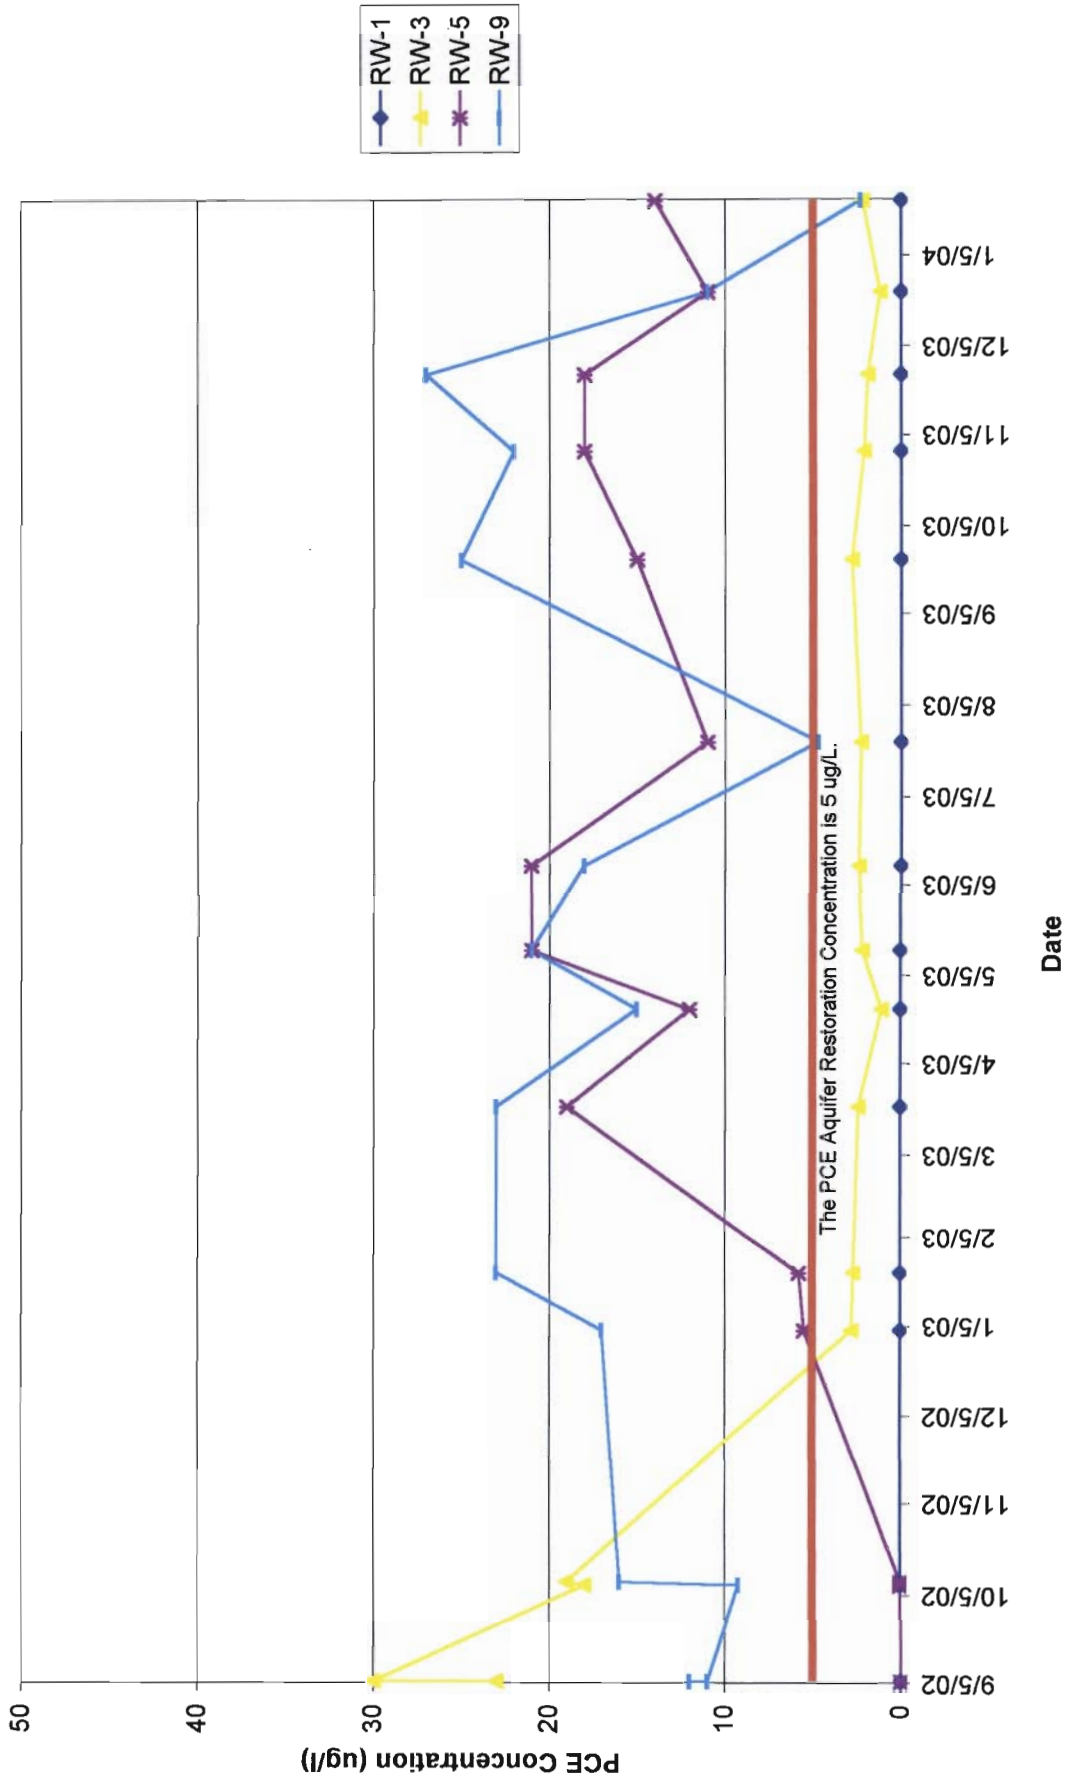

APPENDIX I
JANUARY 2004 LABORATORY ANALYTICAL REPORTS

January 21, 2004

Paul Jobmann
Legette Brashears & Graham Inc.
126 Monroe Turnpike
Trumbull, CT 06611

TEL: (203) 452-3110

FAX (203) 452-3111

RE: Rowe Industries

Order No.: 0401078

Dear Paul Jobmann:

American Analytical Laboratories, LLC. received 3 samples on 1/14/2004 for the analyses presented in the following report.

There were no problems with the analyses and all data for associated QC met EPA or laboratory specifications.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Lori Beyer
Lab Director

CLIENT: Legette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0401078

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0401078-01A	WQ010904:1410 NP2-6		1/9/2004	1/14/2004
0401078-01B	WQ010904:1410 NP2-6		1/9/2004	1/14/2004
0401078-01C	WQ010904:1410 NP2-6		1/9/2004	1/14/2004
0401078-02A	WQ010904:1415 NP2-7		1/9/2004	1/14/2004
0401078-02B	WQ010904:1415 NP2-7		1/9/2004	1/14/2004
0401078-02C	WQ010904:1415 NP2-7		1/9/2004	1/14/2004
0401078-03A	WQ010904:1420 NP2-10		1/9/2004	1/14/2004
0401078-03B	WQ010904:1420 NP2-10		1/9/2004	1/14/2004
0401078-03C	WQ010904:1420 NP2-10		1/9/2004	1/14/2004

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ol style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.

American Analytical Laboratories, LLC.

Date: 21-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401078
Project: Rowe Industries
Lab ID: 0401078-01A

Client Sample ID: WQ010904:1410 NP2-6
Tag Number:
Collection Date: 1/9/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
1,1,1-Trichloroethane	1.7	1.0		µg/L	1	1/14/2004 8:20:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
2-Butanone	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
2-Hexanone	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Acetone	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Benzene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Bromobenzene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Bromoform	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Bromomethane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Carbon disulfide	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Chloroethane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit S - Spike Recovery outside accepted recovery limits
 J - Analyte detected below quantitation limits R - RPD outside accepted recovery limits
 B - Analyte detected in the associated Method Blank E - Value above quantitation range
 * - Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 21-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401078
Project: Rowe Industries
Lab ID: 0401078-01A

Client Sample ID: WQ010904:1410 NP2-6
Tag Number:
Collection Date: 1/9/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Chloromethane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Dibromomethane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/14/2004 8:20:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Methylene chloride	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Naphthalene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
o-Xylene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Styrene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Tetrachloroethene	69	1.0		µg/L	1	1/14/2004 8:20:00 PM
Toluene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Trichloroethene	2.2	1.0		µg/L	1	1/14/2004 8:20:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/14/2004 8:20:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/14/2004 8:20:00 PM

Qualifiers:
 ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 21-Jan-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ010904:1410 NP2-6
Lab Order:	0401078	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/9/2004
Lab ID:	0401078-01B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	8.24	0.0200		mg/L	1	1/15/2004 11:35:20 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 21-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401078
Project: Rowe Industries
Lab ID: 0401078-01C

Client Sample ID: WQ010904:1410 NP2-6
Tag Number:
Collection Date: 1/9/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON			E200.7			Analyst: JP
Iron	0.202	0.0200		mg/L	1	1/15/2004 11:32:55 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 21-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401078
Project: Rowe Industries
Lab ID: 0401078-02A

Client Sample ID: WQ010904:1415 NP2-7
Tag Number:
Collection Date: 1/9/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
2-Butanone	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
2-Hexanone	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Acetone	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Benzene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Bromobenzene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Bromoform	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Bromomethane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Carbon disulfide	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Chloroethane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit S - Spike Recovery outside accepted recovery limits
 J - Analyte detected below quantitation limits R - RPD outside accepted recovery limits
 B - Analyte detected in the associated Method Blank E - Value above quantitation range
 * - Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 21-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401078
Project: Rowe Industries
Lab ID: 0401078-02A

Client Sample ID: WQ010904:1415 NP2-7
Tag Number:
Collection Date: 1/9/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B				Analyst: LDS
Chloroform	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Chloromethane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Dibromomethane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/14/2004 9:00:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Methylene chloride	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Naphthalene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
o-Xylene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Styrene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Tetrachloroethene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Toluene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Trichloroethene	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/14/2004 9:00:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/14/2004 9:00:00 PM

Qualifiers:
 ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 21-Jan-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ010904:1415 NP2-7
Lab Order:	0401078	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/9/2004
Lab ID:	0401078-02B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	13.7	0.0200		mg/L	1	1/15/2004 11:39:57 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 21-Jan-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ010904:1415 NP2-7
Lab Order:	0401078	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/9/2004
Lab ID:	0401078-02C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst: JP
Iron	0.897	0.0200		mg/L	1	1/15/2004 11:37:45 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 21-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401078
Project: Rowe Industries
Lab ID: 0401078-03A

Client Sample ID: WQ010904:1420 NP2-10
Tag Number:
Collection Date: 1/9/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
2-Butanone	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
2-Hexanone	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Acetone	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Benzene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Bromobenzene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Bromoform	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Bromomethane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Carbon disulfide	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Chloroethane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 21-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401078
Project: Rowe Industries
Lab ID: 0401078-03A

Client Sample ID: WQ010904:1420 NP2-10
Tag Number:
Collection Date: 1/9/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Chloromethane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Dibromomethane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/14/2004 9:41:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Methylene chloride	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Naphthalene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
o-Xylene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Styrene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Tetrachloroethene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Toluene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Trichloroethene	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/14/2004 9:41:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/14/2004 9:41:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level
 S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 21-Jan-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ010904:1420 NP2-10
Lab Order:	0401078	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/9/2004
Lab ID:	0401078-03B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	34.9	0.0200		mg/L	1	1/15/2004 12:12:14 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 21-Jan-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ010904:1420 NP2-10
Lab Order:	0401078	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/9/2004
Lab ID:	0401078-03C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst: JP
Iron	2.71	0.0200		mg/L	1	1/15/2004 12:06:32 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: BK
Total Dissolved Solids (Residue, Filterable)	120	1.0		mg/L	1	1/14/2004

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

January 22, 2004

Paul Jobmann
Legette Brashears & Graham Inc.
126 Monroe Turnpike
Trumbull, CT 06611

TEL: (203) 452-3110

FAX (203) 452-3111

RE: Rowe Industries

Order No.: 0401099

Dear Paul Jobmann:

American Analytical Laboratories, LLC. received 3 samples on 1/16/2004 for the analyses presented in the following report.

There were no problems with the analyses and all data for associated QC met EPA or laboratory specifications.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Lori Beyer
Lab Director

CLIENT: Legette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0401099

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0401099-01A	WQ011404:900 NP2-6		1/14/2004	1/16/2004
0401099-01B	WQ011404:900 NP2-6		1/14/2004	1/16/2004
0401099-01C	WQ011404:900 NP2-6		1/14/2004	1/16/2004
0401099-02A	WQ011404:903 NP2-7		1/14/2004	1/16/2004
0401099-02B	WQ011404:903 NP2-7		1/14/2004	1/16/2004
0401099-02C	WQ011404:903 NP2-7		1/14/2004	1/16/2004
0401099-03A	WQ011404:906 NP2-10		1/14/2004	1/16/2004
0401099-03B	WQ011404:906 NP2-10		1/14/2004	1/16/2004
0401099-03C	WQ011404:906 NP2-10		1/14/2004	1/16/2004

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ol style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.

American Analytical Laboratories, LLC.

Date: 22-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401099
Project: Rowe Industries
Lab ID: 0401099-01A

Client Sample ID: WQ011404:900 NP2-6
Tag Number:
Collection Date: 1/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
1,1,1-Trichloroethane	3.6	1.0		µg/L	1	1/20/2004 4:03:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
1,1-Dichloroethane	1.5	1.0		µg/L	1	1/20/2004 4:03:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
2-Butanone	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
2-Hexanone	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Acetone	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Benzene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Bromobenzene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Bromoform	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Bromomethane	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Carbon disulfide	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Chloroethane	U	1.0		µg/L	1	1/20/2004 4:03:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 22-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401099
Project: Rowe Industries
Lab ID: 0401099-01A

Client Sample ID: WQ011404:900 NP2-6
Tag Number:
Collection Date: 1/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
		SW8260B				Analyst: LDS
Chloroform	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Chloromethane	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Dibromomethane	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/20/2004 4:03:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Methylene chloride	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Naphthalene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
o-Xylene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Styrene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Tetrachloroethene	61	1.0		µg/L	1	1/20/2004 4:03:00 PM
Toluene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Trichloroethene	3.0	1.0		µg/L	1	1/20/2004 4:03:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/20/2004 4:03:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/20/2004 4:03:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 22-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401099
Project: Rowe Industries
Lab ID: 0401099-01B

Client Sample ID: WQ011404:900 NP2-6
Tag Number:
Collection Date: 1/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	1.57	0.0200		mg/L	1	1/19/2004 2:22:26 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 22-Jan-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ011404:900 NP2-6
Lab Order:	0401099	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/14/2004
Lab ID:	0401099-01C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.105	0.0200		mg/L	1	1/19/2004 2:16:20 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 22-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401099
Project: Rowe Industries
Lab ID: 0401099-02A

Client Sample ID: WQ011404:903 NP2-7
Tag Number:
Collection Date: 1/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
2-Butanone	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
2-Hexanone	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Acetone	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Benzene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Bromobenzene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Bromoform	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Bromomethane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Carbon disulfide	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Chloroethane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 22-Jan-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ011404:903 NP2-7
Lab Order:	0401099	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/14/2004
Lab ID:	0401099-02A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Chloromethane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Dibromomethane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/20/2004 4:51:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Methylene chloride	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Naphthalene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
o-Xylene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Styrene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Tetrachloroethene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Toluene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Trichloroethene	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/20/2004 4:51:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/20/2004 4:51:00 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 22-Jan-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ011404:903 NP2-7
Lab Order:	0401099	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/14/2004
Lab ID:	0401099-02B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	1.34	0.0200		mg/L	1	1/19/2004 2:34:12 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 22-Jan-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ011404:903 NP2-7
Lab Order:	0401099	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/14/2004
Lab ID:	0401099-02C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.121	0.0200		mg/L	1	1/19/2004 2:31:55 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 22-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401099
Project: Rowe Industries
Lab ID: 0401099-03A

Client Sample ID: WQ011404:906 NP2-10
Tag Number:
Collection Date: 1/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
2-Butanone	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
2-Hexanone	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Acetone	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Benzene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Bromobenzene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Bromoform	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Bromomethane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Carbon disulfide	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Chloroethane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit S - Spike Recovery outside accepted recovery limits
 J - Analyte detected below quantitation limits R - RPD outside accepted recovery limits
 B - Analyte detected in the associated Method Blank E - Value above quantitation range
 * - Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 22-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401099
Project: Rowe Industries
Lab ID: 0401099-03A

Client Sample ID: WQ011404:906 NP2-10
Tag Number:
Collection Date: 1/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
		SW8260B				Analyst: LDS
Chloroform	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Chloromethane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Dibromomethane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/20/2004 5:32:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Methylene chloride	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Naphthalene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
o-Xylene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Styrene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Tetrachloroethene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Toluene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Trichloroethene	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/20/2004 5:32:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/20/2004 5:32:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 22-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401099
Project: Rowe Industries
Lab ID: 0401099-03B

Client Sample ID: WQ011404:906 NP2-10
Tag Number:
Collection Date: 1/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	1.72	0.0200		mg/L	1	1/19/2004 2:39:01 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 22-Jan-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ011404:906 NP2-10
Lab Order:	0401099	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/14/2004
Lab ID:	0401099-03C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.137	0.0200		mg/L	1	1/19/2004 2:36:25 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: BK
Total Dissolved Solids (Residue, Filterable)	110	1.0		mg/L	1	1/20/2004

Qualifiers: ND - Not Detected at the Reporting Limit S - Spike Recovery outside accepted recovery limits
 J - Analyte detected below quantitation limits R - RPD outside accepted recovery limits
 B - Analyte detected in the associated Method Blank E - Value above quantitation range
 * - Value exceeds Maximum Contaminant Level

January 30, 2004

Paul Jobmann
Legette Brashears & Graham Inc.
126 Monroe Turnpike
Trumbull, CT 06611

TEL: (203) 452-3110

FAX (203) 452-3111

RE: Rowe Industries

Order No.: 0401165

Dear Paul Jobmann:

American Analytical Laboratories, LLC. received 3 samples on 1/27/2004 for the analyses presented in the following report.

There were no problems with the analyses and all data for associated QC met EPA or laboratory specifications.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Lori Beyer
Lab Director

CLIENT: Legette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0401165

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0401165-01A	WQ012304:1420 NP2-6		1/23/2004	1/27/2004
0401165-01B	WQ012304:1420 NP2-6		1/23/2004	1/27/2004
0401165-01C	WQ012304:1420 NP2-6		1/23/2004	1/27/2004
0401165-02A	WQ012304:1427 NP2-7		1/23/2004	1/27/2004
0401165-02B	WQ012304:1427 NP2-7		1/23/2004	1/27/2004
0401165-02C	WQ012304:1427 NP2-7		1/23/2004	1/27/2004
0401165-03A	WQ012304:1425 NP2-10		1/23/2004	1/27/2004
0401165-03B	WQ012304:1425 NP2-10		1/23/2004	1/27/2004
0401165-03C	WQ012304:1425 NP2-10		1/23/2004	1/27/2004

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ol style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.

American Analytical Laboratories, LLC.

Date: 30-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401165
Project: Rowe Industries
Lab ID: 0401165-01A

Client Sample ID: WQ012304:1420 NP2-6
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
1,1,1-Trichloroethane	2.7	1.0		µg/L	1	1/29/2004 4:12:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
2-Butanone	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
2-Hexanone	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Acetone	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Benzene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Bromobenzene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Bromochloromethane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Bromodichloromethane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Bromoform	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Bromomethane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Carbon disulfide	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Chlorobenzene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Chloroethane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 30-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401165
Project: Rowe Industries
Lab ID: 0401165-01A

Client Sample ID: WQ012304:1420 NP2-6
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						Analyst: LDS
		SW8260B				
Chloroform	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Chloromethane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Dibromochloromethane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Dibromomethane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Ethylbenzene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Isopropylbenzene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
m,p-Xylene	U	2.0		µg/L	1	1/29/2004 4:12:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Methylene chloride	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Naphthalene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
n-Butylbenzene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
n-Propylbenzene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
o-Xylene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Styrene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Tetrachloroethene	65	1.0		µg/L	1	1/29/2004 4:12:00 AM
Toluene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Trichloroethene	2.3	1.0		µg/L	1	1/29/2004 4:12:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Vinyl acetate	U	1.0		µg/L	1	1/29/2004 4:12:00 AM
Vinyl chloride	U	1.0		µg/L	1	1/29/2004 4:12:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 30-Jan-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ012304:1420 NP2-6
Lab Order:	0401165	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401165-01B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	5.35	0.0200		mg/L	1	1/30/2004 11:16:34 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 30-Jan-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ012304:1420 NP2-6
Lab Order:	0401165	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401165-01C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.0860	0.0200		mg/L	1	1/30/2004 11:10:33 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 30-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401165
Project: Rowe Industries
Lab ID: 0401165-02A

Client Sample ID: WQ012304:1427 NP2-7
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
2-Butanone	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
2-Hexanone	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Acetone	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Benzene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Bromobenzene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Bromochloromethane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Bromodichloromethane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Bromoform	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Bromomethane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Carbon disulfide	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Chlorobenzene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Chloroethane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 30-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401165
Project: Rowe Industries
Lab ID: 0401165-02A

Client Sample ID: WQ012304:1427 NP2-7
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B				Analyst: LDS
Chloroform	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Chloromethane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Dibromochloromethane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Dibromomethane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Ethylbenzene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Isopropylbenzene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
m,p-Xylene	U	2.0		µg/L	1	1/29/2004 4:52:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Methylene chloride	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Naphthalene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
n-Butylbenzene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
n-Propylbenzene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
o-Xylene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Styrene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Tetrachloroethene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Toluene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Trichloroethene	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Vinyl acetate	U	1.0		µg/L	1	1/29/2004 4:52:00 AM
Vinyl chloride	U	1.0		µg/L	1	1/29/2004 4:52:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 30-Jan-04

CLIENT: Legette Brashears & Graham Inc.
 Lab Order: 0401165
 Project: Rowe Industries
 Lab ID: 0401165-02B

Client Sample ID: WQ012304:1427 NP2-7
 Tag Number:
 Collection Date: 1/23/2004
 Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	6.12	0.0200		mg/L	1	1/30/2004 11:22:05 AM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 30-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401165
Project: Rowe Industries
Lab ID: 0401165-02C

Client Sample ID: WQ012304:1427 NP2-7
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON Iron	0.457	E200.7		(SW3005A) mg/L	1	Analyst: JP 1/30/2004 11:19:15 AM

Qualifiers:
ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 30-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401165
Project: Rowe Industries
Lab ID: 0401165-03A

Client Sample ID: WQ012304:1425 NP2-10
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
2-Butanone	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
2-Hexanone	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Acetone	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Benzene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Bromobenzene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Bromochloromethane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Bromodichloromethane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Bromoform	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Bromomethane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Carbon disulfide	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Chlorobenzene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Chloroethane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 30-Jan-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401165
Project: Rowe Industries
Lab ID: 0401165-03A

Client Sample ID: WQ012304:1425 NP2-10
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
		SW8260B				Analyst: LDS
Chloroform	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Chloromethane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Dibromochloromethane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Dibromomethane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Ethylbenzene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Isopropylbenzene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
m,p-Xylene	U	2.0		µg/L	1	1/29/2004 5:40:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Methylene chloride	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Naphthalene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
n-Butylbenzene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
n-Propylbenzene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
o-Xylene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Styrene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Tetrachloroethene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Toluene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Trichloroethene	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Vinyl acetate	U	1.0		µg/L	1	1/29/2004 5:40:00 AM
Vinyl chloride	U	1.0		µg/L	1	1/29/2004 5:40:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 30-Jan-04

CLIENT: Legette Brashears & Graham Inc.	Client Sample ID: WQ012304:1425 NP2-10
Lab Order: 0401165	Tag Number:
Project: Rowe Industries	Collection Date: 1/23/2004
Lab ID: 0401165-03B	Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	3.18	0.0200		mg/L	1	1/30/2004 11:27:15 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 30-Jan-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ012304:1425 NP2-10
Lab Order:	0401165	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401165-03C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.310	0.0200		mg/L	1	1/30/2004 11:24:45 AM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: BK
Total Dissolved Solids (Residue, Filterable)	110	1.0		mg/L	1	1/30/2004

Qualifiers: ND - Not Detected at the Reporting Limit S - Spike Recovery outside accepted recovery limits
 J - Analyte detected below quantitation limits R - RPD outside accepted recovery limits
 B - Analyte detected in the associated Method Blank E - Value above quantitation range
 * - Value exceeds Maximum Contaminant Level

February 03, 2004

Paul Jobmann
Legette Brashears & Graham Inc.
126 Monroe Turnpike
Trumbull, CT 06611

TEL: (203) 452-3110

FAX (203) 452-3111

RE: Rowe Industries

Order No.: 0401164


Dear Paul Jobmann:

American Analytical Laboratories, LLC. received 9 samples on 1/27/2004 for the analyses presented in the following report.

There were no problems with the analyses and all data for associated QC met EPA or laboratory specifications.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0401164

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0401164-01A	GWQ012304:1210 NP1-1-1		1/23/2004	1/27/2004
0401164-01B	GWQ012304:1210 NP1-1-1		1/23/2004	1/27/2004
0401164-01C	GWQ012304:1210 NP1-1-1		1/23/2004	1/27/2004
0401164-01D	GWQ012304:1210 NP1-1-1		1/23/2004	1/27/2004
0401164-02A	GWQ012304:1215 NP1-1-2		1/23/2004	1/27/2004
0401164-02B	GWQ012304:1215 NP1-1-2		1/23/2004	1/27/2004
0401164-02C	GWQ012304:1215 NP1-1-2		1/23/2004	1/27/2004
0401164-02D	GWQ012304:1215 NP1-1-2		1/23/2004	1/27/2004
0401164-03A	GWQ012304:1227 NP1-1-3		1/23/2004	1/27/2004
0401164-03B	GWQ012304:1227 NP1-1-3		1/23/2004	1/27/2004
0401164-03C	GWQ012304:1227 NP1-1-3		1/23/2004	1/27/2004
0401164-03D	GWQ012304:1227 NP1-1-3		1/23/2004	1/27/2004
0401164-04A	GWQ012304:1245 NP1-1-4		1/23/2004	1/27/2004
0401164-04B	GWQ012304:1245 NP1-1-4		1/23/2004	1/27/2004
0401164-04C	GWQ012304:1245 NP1-1-4		1/23/2004	1/27/2004
0401164-04D	GWQ012304:1245 NP1-1-4		1/23/2004	1/27/2004
0401164-05A	GWQ012304:1255 NP1-1-5		1/23/2004	1/27/2004
0401164-05B	GWQ012304:1255 NP1-1-5		1/23/2004	1/27/2004
0401164-05C	GWQ012304:1255 NP1-1-5		1/23/2004	1/27/2004
0401164-05D	GWQ012304:1255 NP1-1-5		1/23/2004	1/27/2004
0401164-06A	GWQ012304:1305 NP1-1-6		1/23/2004	1/27/2004
0401164-06B	GWQ012304:1305 NP1-1-6		1/23/2004	1/27/2004
0401164-06C	GWQ012304:1305 NP1-1-6		1/23/2004	1/27/2004
0401164-06D	GWQ012304:1305 NP1-1-6		1/23/2004	1/27/2004
0401164-07A	GWQ012304:1310 NP1-1-7		1/23/2004	1/27/2004
0401164-07B	GWQ012304:1310 NP1-1-7		1/23/2004	1/27/2004
0401164-07C	GWQ012304:1310 NP1-1-7		1/23/2004	1/27/2004
0401164-07D	GWQ012304:1310 NP1-1-7		1/23/2004	1/27/2004
0401164-08A	GWQ012304:1325 NP1-1-8		1/23/2004	1/27/2004
0401164-08B	GWQ012304:1325 NP1-1-8		1/23/2004	1/27/2004
0401164-08C	GWQ012304:1325 NP1-1-8		1/23/2004	1/27/2004
0401164-08D	GWQ012304:1325 NP1-1-8		1/23/2004	1/27/2004
0401164-09A	GWQ012304:1335 NP1-1-9		1/23/2004	1/27/2004
0401164-09B	GWQ012304:1335 NP1-1-9		1/23/2004	1/27/2004
0401164-09C	GWQ012304:1335 NP1-1-9		1/23/2004	1/27/2004
0401164-09D	GWQ012304:1335 NP1-1-9		1/23/2004	1/27/2004



56 TOLEDO STREET • FARMINGDALE, NEW YORK 11735
 (631) 454-6100 • FAX (631) 454-8027 • email: AAL20000@aol.com

NYSDOH ELAP 11418
 AIHA PAT, LPAT 102391
 CTDOH PH-0205

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

CLIENT NAME/ADDRESS L.B.G. 126 Monroe Turnpike Trumbull, CT 06611		CONTACT: Paul Tobmann		SAMPLER (SIGNATURE) <i>Mark M. Goldberg</i>	DATE 1/26/04	TIME 3:35 pm	SAMPLE(S) SEALED <input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		
PROJECT LOCATION: Rowe		SAMPLER NAME (PRINT) Mark M. Goldberg		SAMPLER NAME (PRINT) Mark M. Goldberg		CORRECT CONTAINER(S) <input checked="" type="checkbox"/> YES <input type="checkbox"/> NO			
LABORATORY ID #	MATRIX	TYPE	PRES.	SAMPLE # - LOCATION	ANALYSIS REQUIRED	DATE	TIME	P.O.#	
0401164-0112	L	G	HEI	GUQ012304-1210 NPA-1-1	5260 MTFE	1/26/04	3:35 pm		
0401164-0210	L			1215 NPA-1-2	5260 MTFE	1/26/04	3:35 pm		
0401164-0310	L			1227 NPA-1-3	5260 MTFE	1/26/04	3:35 pm		
0401164-0410	L			1245 NPA-1-4	5260 MTFE	1/26/04	3:35 pm		
0401164-0510	L			1255 NPA-1-5	5260 MTFE	1/26/04	3:35 pm		
0401164-0610	L			1305 NPA-1-6	5260 MTFE	1/26/04	3:35 pm		
0401164-0710	L			1310 NPA-1-7	5260 MTFE	1/26/04	3:35 pm		
0401164-0810	L			1325 NPA-1-8	5260 MTFE	1/26/04	3:35 pm		
0401164-0910	L			1335 NPA-1-9	5260 MTFE	1/26/04	3:35 pm		
MATRIX S=SOIL; L=LIQUID; SL=SLUDGE; A=AIR; W=WIPE; P=PAINT CHIPS; B=BULK MATERIAL				TURNAROUND REQUIRED: NORMAL <input checked="" type="checkbox"/> STAT Q BY / /				COMMENTS / INSTRUCTIONS	
RELINQUISHED BY (SIGNATURE) <i>Mark M. Goldberg</i>		DATE 1/26/04 TIME 4:00 pm		PRINTED NAME Mark M. Goldberg		RECEIVED BY LAB (SIGNATURE) <i>Paul By</i>		DATE TIME	
RELINQUISHED BY (SIGNATURE)		DATE TIME		PRINTED NAME		RECEIVED BY LAB (SIGNATURE)		DATE TIME	

AMERICAN ANALYTICAL LABORATORIES, LLC
56 TOLEDO STREET
FARMINGDALE, NEW YORK 11735
TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ol style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
 Lab Order: 0401164
 Project: Rowe Industries
 Lab ID: 0401164-01A

Client Sample ID: GWQ012304:1210 NP1-1-1
 Tag Number:
 Collection Date: 1/23/2004
 Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
2-Butanone	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
2-Hexanone	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Acetone	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Benzene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Bromobenzene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Bromoform	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Bromomethane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Carbon disulfide	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Chloroethane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-01A

Client Sample ID: GWQ012304:1210 NP1-1-1
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
		SW8260B				Analyst: LDS
Chloroform	4.0	1.0		µg/L	1	1/29/2004 1:17:00 PM
Chloromethane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Dibromomethane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/29/2004 1:17:00 PM
Methyl tert-butyl ether	2.2	1.0		µg/L	1	1/29/2004 1:17:00 PM
Methylene chloride	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Naphthalene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
o-Xylene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Styrene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Tetrachloroethene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Toluene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Trichloroethene	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/29/2004 1:17:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/29/2004 1:17:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1210 NP1-1-1
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-01B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	0.0098	0.0200	J	mg/L	1	1/30/2004 9:19:17 AM
Manganese	0.137	0.0200		mg/L	1	1/30/2004 9:19:17 AM

Qualifiers:

ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
B - Analyte detected in the associated Method Blank	E - Value above quantitation range
* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-01C

Client Sample ID: GWQ012304:1210 NP1-1-1
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	U	0.0200		mg/L	1	1/30/2004 9:16:34 AM
Manganese	0.135	0.0200		mg/L	1	1/30/2004 9:16:34 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1210 NP1-1-1
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-01D	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	52.3	10.0		mg/L	1	1/30/2004
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: BK
Total Dissolved Solids (Residue, Filterable)	200	1.0		mg/L	1	1/30/2004
TURBIDITY		E180.1				Analyst: KK
Turbidity	U	1.00	H	NTU	1	1/29/2004

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-02A

Client Sample ID: GWQ012304:1215 NP1-1-2
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
2-Butanone	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
2-Hexanone	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Acetone	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Benzene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Bromobenzene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Bromoform	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Bromomethane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Carbon disulfide	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Chloroethane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit S - Spike Recovery outside accepted recovery limits
 J - Analyte detected below quantitation limits R - RPD outside accepted recovery limits
 B - Analyte detected in the associated Method Blank E - Value above quantitation range
 * - Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1215 NP1-1-2
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-02A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
		SW8260B				Analyst: LDS
Chloroform	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Chloromethane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Dibromomethane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/29/2004 2:09:00 PM
Methyl tert-butyl ether	1.1	1.0		µg/L	1	1/29/2004 2:09:00 PM
Methylene chloride	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Naphthalene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
o-Xylene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Styrene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Tetrachloroethene	8.7	1.0		µg/L	1	1/29/2004 2:09:00 PM
Toluene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Trichloroethene	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/29/2004 2:09:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/29/2004 2:09:00 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-02B

Client Sample ID: GWQ012304:1215 NP1-1-2
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	5.57	0.0200		mg/L	1	1/30/2004 9:31:31 AM
Manganese	1.30	0.0200		mg/L	1	1/30/2004 9:31:31 AM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
 Lab Order: 0401164
 Project: Rowe Industries
 Lab ID: 0401164-02C

Client Sample ID: GWQ012304:1215 NP1-1-2
 Tag Number:
 Collection Date: 1/23/2004
 Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	0.207	0.0200		mg/L	1	1/30/2004 9:27:35 AM
Manganese	1.26	0.0200		mg/L	1	1/30/2004 9:27:35 AM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1215 NP1-1-2
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-02D	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS Hardness, Calcium/Magnesium (As CaCO3)	39.8	M2340 B 10.0		mg/L	1	Analyst: JP 1/30/2004
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	140	E160.1 1.0		mg/L	1	Analyst: BK 1/30/2004
TURBIDITY Turbidity	3.50	E180.1 1.00	H	NTU	1	Analyst: KK 1/29/2004

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1227 NP1-1-3
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-03A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
1,1,1-Trichloroethane	3.2	1.0		µg/L	1	1/29/2004 3:00:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
2-Butanone	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
2-Hexanone	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Acetone	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Benzene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Bromobenzene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Bromoform	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Bromomethane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Carbon disulfide	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Chloroethane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-03A

Client Sample ID: GWQ012304:1227 NP1-1-3
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
		SW8260B				Analyst: LDS
Chloroform	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Chloromethane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Dibromomethane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/29/2004 3:00:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Methylene chloride	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Naphthalene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
o-Xylene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Styrene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Tetrachloroethene	2.2	1.0		µg/L	1	1/29/2004 3:00:00 PM
Toluene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Trichloroethene	6.9	1.0		µg/L	1	1/29/2004 3:00:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/29/2004 3:00:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/29/2004 3:00:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-03B

Client Sample ID: GWQ012304:1227 NP1-1-3
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	1.96	0.0200		mg/L	1	1/30/2004 9:35:46 AM
Manganese	0.134	0.0200		mg/L	1	1/30/2004 9:35:46 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1227 NP1-1-3
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-03C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	1.50	0.0200		mg/L	1	1/30/2004 9:33:41 AM
Manganese	0.129	0.0200		mg/L	1	1/30/2004 9:33:41 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1227 NP1-1-3
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-03D	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS						Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	37.8	10.0		mg/L	1	1/30/2004
TOTAL DISSOLVED SOLIDS						Analyst: BK
Total Dissolved Solids (Residue, Filterable)	110	1.0		mg/L	1	1/30/2004
TURBIDITY						Analyst: KK
Turbidity	2.00	1.00	H	NTU	1	1/29/2004

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-04A

Client Sample ID: GWQ012304:1245 NP1-1-4
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
2-Butanone	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
2-Hexanone	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Acetone	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Benzene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Bromobenzene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Bromoform	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Bromomethane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Carbon disulfide	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Chloroethane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-04A

Client Sample ID: GWQ012304:1245 NP1-1-4
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						Analyst: LDS
		SW8260B				
Chloroform	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Chloromethane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Dibromomethane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/29/2004 3:51:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Methylene chloride	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Naphthalene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
o-Xylene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Styrene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Tetrachloroethene	270	1.0		µg/L	1	1/29/2004 3:51:00 PM
Toluene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Trichloroethene	5.9	1.0		µg/L	1	1/29/2004 3:51:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/29/2004 3:51:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/29/2004 3:51:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1245 NP1-1-4
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-04B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	3.56	0.0200		mg/L	1	1/30/2004 9:44:34 AM
Manganese	2.16	0.0200		mg/L	1	1/30/2004 9:44:34 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-04C

Client Sample ID: GWQ012304:1245 NP1-1-4
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	0.480	0.0200		mg/L	1	1/30/2004 9:40:59 AM
Manganese	2.12	0.0200		mg/L	1	1/30/2004 9:40:59 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1245 NP1-1-4
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-04D	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS Hardness, Calcium/Magnesium (As CaCO3)	36.8	M2340 10.0	B	mg/L	1	1/30/2004 Analyst: JP
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	2.0	E160.1 1.0		mg/L	1	1/30/2004 Analyst: BK
TURBIDITY Turbidity	6.50	E180.1 1.00	H	NTU	1	1/29/2004 Analyst: KK

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-05A

Client Sample ID: GWQ012304:1255 NP1-1-5
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
2-Butanone	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
2-Hexanone	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Acetone	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Benzene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Bromobenzene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Bromoform	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Bromomethane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Carbon disulfide	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Chloroethane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-05A

Client Sample ID: GWQ012304:1255 NP1-1-5
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B				Analyst: LDS
Chloroform	0.9	1.0	J	µg/L	1	1/29/2004 4:40:00 PM
Chloromethane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Dibromomethane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/29/2004 4:40:00 PM
Methyl tert-butyl ether	4.0	1.0		µg/L	1	1/29/2004 4:40:00 PM
Methylene chloride	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Naphthalene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
o-Xylene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Styrene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Tetrachloroethene	14	1.0		µg/L	1	1/29/2004 4:40:00 PM
Toluene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Trichloroethene	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/29/2004 4:40:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/29/2004 4:40:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-05B

Client Sample ID: GWQ012304:1255 NP1-1-5
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	0.0500	0.0200		mg/L	1	1/30/2004 10:07:47 AM
Manganese	0.0056	0.0200	J	mg/L	1	1/30/2004 10:07:47 AM

Qualifiers:
ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1255 NP1-1-5
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-05C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	U	0.0200		mg/L	1	1/30/2004 9:53:30 AM
Manganese	0.0061	0.0200	J	mg/L	1	1/30/2004 9:53:30 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1255 NP1-1-5
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-05D	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	37.2	10.0		mg/L	1	1/30/2004
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: BK
Total Dissolved Solids (Residue, Filterable)	130	1.0		mg/L	1	1/30/2004
TURBIDITY		E180.1				Analyst: KK
Turbidity	U	1.00	H	NTU	1	1/29/2004

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-06A

Client Sample ID: GWQ012304:1305 NP1-1-6
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
2-Butanone	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
2-Hexanone	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Acetone	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Benzene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Bromobenzene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Bromoform	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Bromomethane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Carbon disulfide	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Chloroethane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit S - Spike Recovery outside accepted recovery limits
 J - Analyte detected below quantitation limits R - RPD outside accepted recovery limits
 B - Analyte detected in the associated Method Blank E - Value above quantitation range
 * - Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-06A

Client Sample ID: GWQ012304:1305 NP1-1-6
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
		SW8260B				Analyst: LDS
Chloroform	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Chloromethane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Dibromomethane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/29/2004 5:34:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Methylene chloride	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Naphthalene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
o-Xylene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Styrene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Tetrachloroethene	160	1.0		µg/L	1	1/29/2004 5:34:00 PM
Toluene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Trichloroethene	2.4	1.0		µg/L	1	1/29/2004 5:34:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/29/2004 5:34:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/29/2004 5:34:00 PM

Qualifiers:
 ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1305 NP1-1-6
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-06B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	0.015	0.0200	J	mg/L	1	1/30/2004 10:14:08 AM
Manganese	0.336	0.0200		mg/L	1	1/30/2004 10:14:08 AM

Qualifiers: ND - Not Detected at the Reporting Limit S - Spike Recovery outside accepted recovery limits
 J - Analyte detected below quantitation limits R - RPD outside accepted recovery limits
 B - Analyte detected in the associated Method Blank E - Value above quantitation range
 * - Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1305 NP1-1-6
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-06C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	U	0.0200		mg/L	1	1/30/2004 10:11:58 AM
Manganese	0.327	0.0200		mg/L	1	1/30/2004 10:11:58 AM

Qualifiers: ND - Not Detected at the Reporting Limit S - Spike Recovery outside accepted recovery limits
 J - Analyte detected below quantitation limits R - RPD outside accepted recovery limits
 B - Analyte detected in the associated Method Blank E - Value above quantitation range
 * - Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1305 NP1-1-6
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-06D	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	40.9	10.0		mg/L	1	1/30/2004
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: BK
Total Dissolved Solids (Residue, Filterable)	130	1.0		mg/L	1	1/30/2004
TURBIDITY		E180.1				Analyst: KK
Turbidity	U	1.00	H	NTU	1	1/29/2004

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-07A

Client Sample ID: GWQ012304:1310 NP1-1-7
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
2-Butanone	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
2-Hexanone	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Acetone	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Benzene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Bromobenzene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Bromoform	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Bromomethane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Carbon disulfide	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Chloroethane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit S - Spike Recovery outside accepted recovery limits
 J - Analyte detected below quantitation limits R - RPD outside accepted recovery limits
 B - Analyte detected in the associated Method Blank E - Value above quantitation range
 * - Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-07A

Client Sample ID: GWQ012304:1310 NP1-1-7
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Chloromethane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Dibromomethane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/29/2004 6:15:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Methylene chloride	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Naphthalene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
o-Xylene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Styrene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Tetrachloroethene	190	1.0		µg/L	1	1/29/2004 6:15:00 PM
Toluene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Trichloroethene	3.7	1.0		µg/L	1	1/29/2004 6:15:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/29/2004 6:15:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/29/2004 6:15:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Leette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1310 NP1-1-7
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-07B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	0.0069	0.0200	J	mg/L	1	1/30/2004 10:30:43 AM
Manganese	0.0687	0.0200		mg/L	1	1/30/2004 10:30:43 AM

Qualifiers: ND - Not Detected at the Reporting Limit S - Spike Recovery outside accepted recovery limits
 J - Analyte detected below quantitation limits R - RPD outside accepted recovery limits
 B - Analyte detected in the associated Method Blank E - Value above quantitation range
 * - Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-07C

Client Sample ID: GWQ012304:1310 NP1-1-7
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	U	0.0200		mg/L	1	1/30/2004 10:34:32 AM
Manganese	0.0665	0.0200		mg/L	1	1/30/2004 10:34:32 AM

Qualifiers:
ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1310 NP1-1-7
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-07D	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	31.6	10.0		mg/L	1	1/30/2004
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: BK
Total Dissolved Solids (Residue, Filterable)	110	1.0		mg/L	1	1/30/2004
TURBIDITY		E180.1				Analyst: KK
Turbidity	U	1.00	H	NTU	1	1/29/2004

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-08A

Client Sample ID: GWQ012304:1325 NP1-1-8
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
1,1,1-Trichloroethane	4.1	1.0		µg/L	1	1/29/2004 6:57:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
1,1-Dichloroethane	3.5	1.0		µg/L	1	1/29/2004 6:57:00 PM
1,1-Dichloroethene	1.5	1.0		µg/L	1	1/29/2004 6:57:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
2-Butanone	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
2-Hexanone	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Acetone	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Benzene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Bromobenzene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Bromoform	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Bromomethane	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Carbon disulfide	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Chloroethane	U	1.0		µg/L	1	1/29/2004 6:57:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-08A

Client Sample ID: GWQ012304:1325 NP1-1-8
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
		SW8260B				Analyst: LDS
Chloroform	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Chloromethane	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Dibromomethane	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/29/2004 6:57:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Methylene chloride	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Naphthalene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
o-Xylene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Styrene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Tetrachloroethene	16	1.0		µg/L	1	1/29/2004 6:57:00 PM
Toluene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Trichloroethene	2.2	1.0		µg/L	1	1/29/2004 6:57:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/29/2004 6:57:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/29/2004 6:57:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1325 NP1-1-8
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-08B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	9.73	0.0200		mg/L	1	1/30/2004 10:40:13 AM
Manganese	0.490	0.0200		mg/L	1	1/30/2004 10:40:13 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-08C

Client Sample ID: GWQ012304:1325 NP1-1-8
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	2.72	0.0200		mg/L	1	1/30/2004 10:37:31 AM
Manganese	0.474	0.0200		mg/L	1	1/30/2004 10:37:31 AM

Qualifiers: ND - Not Detected at the Reporting Limit S - Spike Recovery outside accepted recovery limits
 J - Analyte detected below quantitation limits R - RPD outside accepted recovery limits
 B - Analyte detected in the associated Method Blank E - Value above quantitation range
 * - Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1325 NP1-1-8
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-08D	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	26.5	10.0		mg/L	1	1/30/2004
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: BK
Total Dissolved Solids (Residue, Filterable)	97	1.0		mg/L	1	1/30/2004
TURBIDITY		E180.1				Analyst: KK
Turbidity	2.50	1.00	H	NTU	1	1/29/2004

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-09A

Client Sample ID: GWQ012304:1335 NP1-1-9
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
1,1,1-Trichloroethane	13	1.0		µg/L	1	1/29/2004 7:37:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
1,1-Dichloroethane	1.8	1.0		µg/L	1	1/29/2004 7:37:00 PM
1,1-Dichloroethene	1.5	1.0		µg/L	1	1/29/2004 7:37:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
2-Butanone	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
2-Hexanone	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Acetone	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Benzene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Bromobenzene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Bromoform	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Bromomethane	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Carbon disulfide	72	1.0		µg/L	1	1/29/2004 7:37:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Chloroethane	U	1.0		µg/L	1	1/29/2004 7:37:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0401164
Project: Rowe Industries
Lab ID: 0401164-09A

Client Sample ID: GWQ012304:1335 NP1-1-9
Tag Number:
Collection Date: 1/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Chloromethane	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Dibromomethane	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/29/2004 7:37:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Methylene chloride	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Naphthalene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
o-Xylene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Styrene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Tetrachloroethene	2.3	1.0		µg/L	1	1/29/2004 7:37:00 PM
Toluene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Trichloroethene	2.2	1.0		µg/L	1	1/29/2004 7:37:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/29/2004 7:37:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/29/2004 7:37:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit S - Spike Recovery outside accepted recovery limits
 J - Analyte detected below quantitation limits R - RPD outside accepted recovery limits
 B - Analyte detected in the associated Method Blank E - Value above quantitation range
 * - Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1335 NP1-1-9
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-09B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	0.638	0.0200		mg/L	1	1/30/2004 10:48:25 AM
Manganese	1.06	0.0200		mg/L	1	1/30/2004 10:48:25 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1335 NP1-1-9
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-09C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	0.0290	0.0200		mg/L	1	1/30/2004 10:42:16 AM
Manganese	1.05	0.0200		mg/L	1	1/30/2004 10:42:16 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 03-Feb-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ012304:1335 NP1-1-9
Lab Order:	0401164	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/23/2004
Lab ID:	0401164-09D	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	23.2	10.0		mg/L	1	1/30/2004
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: BK
Total Dissolved Solids (Residue, Filterable)	110	1.0		mg/L	1	1/30/2004
TURBIDITY		E180.1				Analyst: KK
Turbidity	U	1.00	H	NTU	1	1/29/2004

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

February 09, 2004

Paul Jobmann
Legette Brashears & Graham Inc.
126 Monroc Turnpike
Trumbull, CT 06611

TEL: (203) 452-3110

FAX (203) 452-3111

RE: Rowe

Order No.: 0402005

Dear Paul Jobmann:

American Analytical Laboratories, LLC. received 3 samples on 2/2/2004 for the analyses presented in the following report.

There were no problems with the analyses and all data for associated QC met EPA or laboratory specifications.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Lori Beyer
Lab Director



American Analytical Laboratories, LLC.

Date: 09-Feb-04

CLIENT: Legette Brashears & Graham Inc.**Project:** Rowe**Lab Order:** 0402005**Work Order Sample Summary**

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0402005-01A	WQ012904:1043 NP2-6		1/29/2004	2/2/2004
0402005-01B	WQ012904:1043 NP2-6		1/29/2004	2/2/2004
0402005-01C	WQ012904:1043 NP2-6		1/29/2004	2/2/2004
0402005-02A	WQ012904:1034 NP2-7		1/29/2004	2/2/2004
0402005-02B	WQ012904:1034 NP2-7		1/29/2004	2/2/2004
0402005-02C	WQ012904:1034 NP2-7		1/29/2004	2/2/2004
0402005-03A	WQ012903:1048 NP2-10		1/29/2004	2/2/2004
0402005-03B	WQ012903:1048 NP2-10		1/29/2004	2/2/2004
0402005-03C	WQ012903:1048 NP2-10		1/29/2004	2/2/2004

AMERICAN ANALYTICAL LABORATORIES, LLC
56 TOLEDO STREET
FARMINGDALE, NEW YORK 11735
TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ol style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analyte concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.

American Analytical Laboratories, LLC.

Date: 09-Feb-04

CLIENT: Legette Brashears & Graham Inc.
 Lab Order: 0402005
 Project: Rowe
 Lab ID: 0402005-01A

Client Sample ID: WQ012904:1043 NP2-6
 Tag Number:
 Collection Date: 1/29/2004
 Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
2-Butanone	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
2-Hexanone	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Acetone	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Benzene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Bromobenzene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Bromochloromethane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Bromodichloromethane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Bromoform	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Bromomethane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Carbon disulfide	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Chlorobenzene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Chloroethane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPI) outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 09-Feb-04

CLIENT: Legette Brashears & Graham Inc.
 Lab Order: 0402005
 Project: Rowe
 Lab ID: 0402005-01A

Client Sample ID: WQ012904:1043 NP2-6
 Tag Number:
 Collection Date: 1/29/2004
 Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Chloromethane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
cis-1,3-Dichloropropane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Dibromochloromethane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Dibromomethane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Ethylbenzene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Isopropylbenzene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
m,p-Xylene	0.8	2.0	J	µg/L	1	2/3/2004 6:58:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Methylene chloride	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Naphthalene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
n-Butylbenzene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
n-Propylbenzene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
o-Xylene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Styrene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Tetrachloroethene	35	1.0		µg/L	1	2/3/2004 6:58:00 PM
Toluene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Trichloroethene	1.7	1.0		µg/L	1	2/3/2004 6:58:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Vinyl acetate	U	1.0		µg/L	1	2/3/2004 6:58:00 PM
Vinyl chloride	U	1.0		µg/L	1	2/3/2004 6:58:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit S - Spike Recovery outside accepted recovery limits
 J - Analyte detected below quantitation limits R - RPI outside accepted recovery limits
 B - Analyte detected in the associated Method Blank K - Value above quantitation range
 * - Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 09-Feb-04

CLIENT: Legette Brashears & Graham Inc.
 Lab Order: 0402005
 Project: Rowe
 Lab ID: 0402005-01B

Client Sample ID: WQ012904:1043 NP2-G
 Tag Number:
 Collection Date: 1/29/2004
 Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7				Analyst: JP
Iron	11.3	0.0200		mg/L	1	2/3/2004 11:30:17 AM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level
 S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 09-Feb-04

CLIENT: Legette Brashears & Graham Inc.
 Lab Order: 0402005
 Project: Rowe
 Lab ID: 0402005-01C

Client Sample ID: WQ012904:1043 NP2-6
 Tag Number:
 Collection Date: 1/29/2004
 Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst JP
Iron	0.113	0.0200		mg/L	1	2/3/2004 11:27:38 AM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level
 S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 09-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0402005
Project: Rowe
Lab ID: 0402005-02A

Client Sample ID: WQ012904:1034 NP2-7
Tag Number:
Collection Date: 1/29/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
2-Butanone	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
2-Hexanone	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Acetone	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Benzene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Bromobenzene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Bromochloromethane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Bromodichloromethane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Bromoform	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Bromomethane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Carbon disulfide	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Chlorobenzene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Chloroethane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit S - Spike Recovery outside accepted recovery limits
 J - Analyte detected below quantitation limits R - RPD outside accepted recovery limits
 B - Analyte detected in the associated Method Blank H - Value above quantitation range
 * - Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 09-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0402005
Project: Rowe
Lab ID: 0402005-02A

Client Sample ID: WQ012904:1034 NP2-7
Tag Number:
Collection Date: 1/29/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						Analyst: LDS
Chloroform	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Chloromethano	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
cis-1,2-Dichloroethano	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
cis-1,3-Dichloropropano	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Dibromochloromethane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Dibromomethane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Ethylbenzene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Hexachlorobutadieno	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Isopropylbenzene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
m,p-Xylene	U	2.0		µg/L	1	2/3/2004 7:43:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Methylene chloride	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Naphthalene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
n-Butylbenzene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
n-Propylbenzene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
o-Xylene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Styrene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Tetrachloroethene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Toluene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Trichloroethane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Vinyl acetate	U	1.0		µg/L	1	2/3/2004 7:43:00 PM
Vinyl chloride	U	1.0		µg/L	1	2/3/2004 7:43:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit S - Spike Recovery outside accepted recovery limits
 J - Analyte detected below quantitation limits R - RPD outside accepted recovery limits
 B - Analyte detected in the associated Method Blank I - Value above quantitation range
 * - Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 09-Feb-04

CLIENT: Legotte Brashcars & Graham Inc.
Lab Order: 0402005
Project: Rowe
Lab ID: 0402005-02B

Client Sample ID: WQ012904:1034 NP2-7
Tag Number:
Collection Date: 1/29/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7				Analyst JP
Iron	8.74	0.0200		mg/L	1	2/3/2004 11:36:46 AM

Qualifiers:
 ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 09-Feb-04

CLIENT: Legette Brashears & Graham Inc.

Client Sample ID: WQ012904:1034 NP2-7

Lab Order: 0402005

Tag Number:

Project: Rowe

Collection Date: 1/29/2004

Lab ID: 0402005-02C

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst: JP
Iron	0.597	0.0200		mg/L	1	2/3/2004 11:33:30 AM

Qualifiers:

ND - Not Detected at the Reporting Limit

S - Spike Recovery outside accepted recovery limits

J - Analyte detected below quantitation limits

R - RPD outside accepted recovery limits

B - Analyte detected in the associated Method Blank

E - Value above quantitation range

* - Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 09-Feb-04

CLIENT: Legotte Brashears & Graham Inc.
Lab Order: 0402005
Project: Rowe
Lab ID: 0402005-03A

Client Sample ID: WQ012903:1048 NP2-10
Tag Number:
Collection Date: 1/29/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
2-Butanone	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
2-Hexanone	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Acetone	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Benzene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Bromobenzene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Bromochloromethane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Bromodichloromethane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Bromoform	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Bromomethane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Carbon disulfide	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Chlorobenzene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Chloroethane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM

Qualifiers: NI) - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 09-Feb-04

CLIENT: Legotte Brashears & Graham Inc.
 Lab Order: 0402005
 Project: Rowe
 Lab ID: 0402005-03A

Client Sample ID: WQ012903:1048 NP2-10
 Tag Number:
 Collection Date: 1/29/2004
 Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B				Analyst: LDS
Chloroform	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Chloromethane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Dibromochloromethane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Dibromomethane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Ethylbenzene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Isopropylbenzene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
m,p-Xylene	U	2.0		µg/L	1	2/3/2004 8:27:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Methylene chloride	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Naphthalene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
n-Butylbenzene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
n-Propylbenzene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
o-Xylene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Styrene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Tetrachloroethene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Toluene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Trichloroethene	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Vinyl acetate	U	1.0		µg/L	1	2/3/2004 8:27:00 PM
Vinyl chloride	U	1.0		µg/L	1	2/3/2004 8:27:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit S - Spike Recovery outside accepted recovery limits
 J - Analyte detected below quantitation limits R - RPD outside accepted recovery limits
 B - Analyte detected in the associated Method Blank E - Value above quantitation range
 * - Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 09-Feb-04

CLIENT: Legette Brashears & Graham Inc.

Client Sample ID: WQ012903:1048 NP2-10

Lab Order: 0402005

Tag Number:

Project: Rowe

Collection Date: 1/29/2004

Lab ID: 0402005-03B

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7				Analyst: JP
Iron	9.96	0.0200		mg/L	1	2/3/2004 11:50:17 AM

Qualifiers:

ND - Not Detected at the Reporting Limit

S - Spike Recovery outside accepted recovery limits

J - Analyte detected below quantitation limits

R - RPD outside accepted recovery limits

B - Analyte detected in the associated Method Blank

E - Value above quantitation range

■ - Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 09-Feb-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0402005
Project: Rowe
Lab ID: 0402005-03C

Client Sample ID: WQ012903:1048 NP2-10
Tag Number:
Collection Date: 1/29/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst: JP
Iron	0.981	0.0200		mg/L	1	2/3/2004 11:47:04 AM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: BK
Total Dissolved Solids (Residue, Filterable)	100	1.0		mg/L	1	2/3/2004

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level
 S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

ANALYTICAL REPORT

JOB NUMBER: 205678

Prepared For:

LEGGETTE, BRASHEARS & GRAHAM
126 Monroe Turnpike
Trumbull, CT 06611

Project: ROWE INDUSTRIES

Attention: Paul Jobmann

Date: 01/28/2004

Michele D. Sciongay
Signature

Name: Michele D. Sciongay

Title: Project Manager

E-Mail: msciongay@stl-inc.com

January 28, 2004
Date

STL Connecticut
128 Long Hill Cross Road
Shelton, CT 06484

This Report Contains (107) Pages

STL Report : 205678
LEGGETTE, BRASHEARS & GRAHAMCase Narrative

Sample Receipt – All samples were received in good condition.

Volatile Organics – Air volatile organics were determined by purge and trap GC/MS using guidance provided in Method TO-17.

Samples NP4-1-2 and NP4-1-1 were analyzed at sample volumes of .4L and .2L, respectively, due to high target compound concentrations..

Sample Calculation:


Sample ID-NP4-1-2
Compound-Trichloroethene


$$\frac{(38732)(25)}{(135029)(.214)} = 33.5 = 33\text{NG}$$

$$\frac{(33\text{NG})(.08206)(298)}{(.4\text{L})(131)(1.0\text{ATM})} = 15.4 \text{ nL/L.}$$

The test results in this report meet all NELAP requirements for parameters for which accreditation is required or available. Any exceptions to NELAP requirements are noted in the case narrative.

I certify that this data package is in compliance with the terms and conditions of this contract, both technically and for completeness, for other than the conditions detailed above. Release of the data contained in this hardcopy data package and in the computer-readable data submitted on diskette has been authorized by the Laboratory Manager or his designee, as verified by the following signature.


Daniel Helfrich
Technical Director


Date

S A M P L E I N F O R M A T I O N
Date: 01/28/2004

Job Number.: 205678
Customer....: LEGGETTE, BRASHEARS & GRAHAM
Attn.....: Paul Jobmann

Project Number.....: 20000283
Customer Project ID....: ROWE INDUSTRIES
Project Description....: Rowe Industries

Laboratory Sample ID	Customer Sample ID	Sample Matrix	Date Sampled	Time Sampled	Date Received	Time Received
205678-1	AQ011404:910 NP4-1	Air	01/14/2004	09:10	01/15/2004	09:15
205678-2	AQ011404:912 NP4-2	Air	01/14/2004	09:12	01/15/2004	09:15
205678-3	AQ011404:914 NP4-3	Air	01/14/2004	09:14	01/15/2004	09:15

STL Connecticut		Form 1		Client Sample ID	NP4-1-1
Method: TO17				Lab Sample ID	205678-1
Sample Volume (L)	0.200			Date Sampled	1/14/2004
Temp (C)	25			Date Analyzed	1/26/2004
Compound	nL/L (ppbv/v) Qualifier	RL		mg/M3 Qualifier	RL
Chloromethane	48.4 U	48.4		0.100 U	0.100
Vinyl Chloride	39.1 U	39.1		0.100 U	0.100
Bromomethane	73.4	25.7		0.285	0.100
Chloroethane	37.9 U	37.9		0.100 U	0.100
1,1-Dichloroethene	12.6 U	12.6		0.050 U	0.050
Carbon Disulfide	16.1 U	16.1		0.050 U	0.050
Methylene Chloride	15.8	14.4		0.055	0.050
trans-1,2-Dichloroethene	12.7 U	12.7		0.050 U	0.050
1,1-Dichloroethane	12.4 U	12.4		0.050 U	0.050
cis-1,2-Dichloroethene	12.7 U	12.7		0.050 U	0.050
Chloroform	10.3 U	10.3		0.050 U	0.050
1,1,1-Trichloroethane	9.2 U	9.2		0.050 U	0.050
Carbon Tetrachloride	7.9 U	7.9		0.050 U	0.050
Benzene	15.66 U	15.7		0.0500 U	0.050
1,2-Dichloroethane	12.4 U	12.4		0.050 U	0.050
Trichloroethene	3.7 J	9.3		0.020 J	0.050
1,2-Dichloropropane	10.8 U	10.8		0.050 U	0.050
Bromodichloromethane	7.5 U	7.5		0.050 U	0.050
cis-1,3-Dichloropropene	11.0 U	11.0		0.050 U	0.050
Toluene	6.6 J	13.3		0.025 J	0.050
trans-1,3-Dichloropropene	11.0 U	11.0		0.050 U	0.050
1,1,2-Trichloroethane	9.2 U	9.2		0.050 U	0.050
Tetrachloroethene	110.5	7.4		0.750	0.050
Dibromochloromethane	5.9 U	5.9		0.050 U	0.050
Chlorobenzene	10.8 U	10.8		0.050 U	0.050
Ethylbenzene	11.5 U	11.5		0.050 U	0.050
m&p-Xylenes	11.5 U	11.5		0.050 U	0.050
o-Xylene	11.5 U	11.5		0.050 U	0.050
Styrene	11.8 U	11.8		0.050 U	0.050
Bromoform	4.8 U	4.8		0.050 U	0.050
1,1,2,2-Tetrachloroethane	7.3 U	7.3		0.050 U	0.050

0000003

STL Connecticut		Form 1		Client Sample ID		NP4-1-2	
Method: TO17				Lab Sample ID		205678-2	
Sample Volume (L)		0.400		Date Sampled		1/14/2004	
Temp (C)		25		Date Analyzed		1/26/2004	
Compound	nL/L (ppbv/v)	Qualifier	RL	mg/M3	Qualifier	RL	
Chloromethane	24.2	U	24.2	0.050	U	0.050	
Vinyl Chloride	19.6	U	19.6	0.050	U	0.050	
Bromomethane	23.2		12.9	0.090		0.050	
Chloroethane	19.0	U	19.0	0.050	U	0.050	
1,1-Dichloroethene	6.3	U	6.3	0.025	U	0.025	
Carbon Disulfide	8.0	U	8.0	0.025	U	0.025	
Methylene Chloride	15.1		7.2	0.053		0.025	
trans-1,2-Dichloroethene	6.4	U	6.4	0.025	U	0.025	
1,1-Dichloroethane	6.2	U	6.2	0.025	U	0.025	
cis-1,2-Dichloroethene	6.4	U	6.4	0.025	U	0.025	
Chloroform	5.1	U	5.1	0.025	U	0.025	
1,1,1-Trichloroethane	4.6	U	4.6	0.025	U	0.025	
Carbon Tetrachloride	4.0	U	4.0	0.025	U	0.025	
Benzene	7.83	U	7.8	0.0250	U	0.025	
1,2-Dichloroethane	6.2	U	6.2	0.025	U	0.025	
Trichloroethene	15.4		4.7	0.083		0.025	
1,2-Dichloropropane	5.4	U	5.4	0.025	U	0.025	
Bromodichloromethane	3.7	U	3.7	0.025	U	0.025	
cis-1,3-Dichloropropene	5.5	U	5.5	0.025	U	0.025	
Toluene	8.0		6.6	0.030		0.025	
trans-1,3-Dichloropropene	5.5	U	5.5	0.025	U	0.025	
1,1,2-Trichloroethane	4.6	U	4.6	0.025	U	0.025	
Tetrachloroethene	73.7		3.7	0.500		0.025	
Dibromochloromethane	2.9	U	2.9	0.025	U	0.025	
Chlorobenzene	5.4	U	5.4	0.025	U	0.025	
Ethylbenzene	5.8	U	5.8	0.025	U	0.025	
m&p-Xylenes	5.8	U	5.8	0.025	U	0.025	
o-Xylene	5.8	U	5.8	0.025	U	0.025	
Styrene	5.9	U	5.9	0.025	U	0.025	
Bromoform	2.4	U	2.4	0.025	U	0.025	
1,1,2,2-Tetrachloroethane	3.6	U	3.6	0.025	U	0.025	

0000004

STL Connecticut		Form 1		Client Sample ID		NP4-3	
Method: TO17				Lab Sample ID		205678-3	
Sample Volume (L)		: 1.000		Date Sampled		1/14/2004	
Temp (C)		25		Date Analyzed		1/22/2004	
Compound	nL/L (ppbv/v)	Qualifier	RL	mg/M3	Qualifier	RL	
Chloromethane	9.7	U	9.7	0.020	U	0.020	
Vinyl Chloride	7.8	U	7.8	0.020	U	0.020	
Bromomethane	2.6	J	5.1	0.010	J	0.020	
Chloroethane	7.6	U	7.6	0.020	U	0.020	
1,1-Dichloroethene	2.5	U	2.5	0.010	U	0.010	
Carbon Disulfide	3.2	U	3.2	0.010	U	0.010	
Methylene Chloride	10.7		2.9	0.037		0.010	
trans-1,2-Dichloroethene	2.5	U	2.5	0.010	U	0.010	
1,1-Dichloroethane	5.4		2.5	0.022		0.010	
cis-1,2-Dichloroethene	2.5	U	2.5	0.010	U	0.010	
Chloroform	2.5		2.1	0.012		0.010	
1,1,1-Trichloroethane	18.4		1.8	0.100		0.010	
Carbon Tetrachloride	1.9		1.6	0.012		0.010	
Benzene	3.1	U	3.1	0.010	U	0.010	
1,2-Dichloroethane	2.5	U	2.5	0.010	U	0.010	
Trichloroethene	1.9	U	1.9	0.010	U	0.010	
1,2-Dichloropropane	2.2	U	2.2	0.010	U	0.010	
Bromodichloromethane	1.5	U	1.5	0.010	U	0.010	
cis-1,3-Dichloropropene	2.2	U	2.2	0.010	U	0.010	
Toluene	4.0		2.7	0.015		0.010	
trans-1,3-Dichloropropene	2.2	U	2.2	0.010	U	0.010	
1,1,2-Trichloroethane	1.8	U	1.8	0.010	U	0.010	
Tetrachloroethene	1.5	U	1.5	0.010	U	0.010	
Dibromochloromethane	1.2	U	1.2	0.010	U	0.010	
Chlorobenzene	2.2	U	2.2	0.010	U	0.010	
Ethylbenzene	2.3	U	2.3	0.010	U	0.010	
m&p-Xylenes	2.3	U	2.3	0.010	U	0.010	
o-Xylene	2.3	U	2.3	0.010	U	0.010	
Styrene	2.4	U	2.4	0.010	U	0.010	
Bromoform	1.0	U	1.0	0.010	U	0.010	
1,1,2,2-Tetrachloroethane	1.5	U	1.5	0.010	U	0.010	

0000005

LABORATORY CHRONICLE

Job Number: 205678

Date: 01/28/2004

CUSTOMER: LEGGETTE, BRASHEARS & GRAHAM

PROJECT: ROWE INDUSTRIES

ATTN: Paul Jobmann

Lab ID:	Client ID:	Date Recvd:	Sample Date:			DILUTION
METHOD	DESCRIPTION	RUN#	BATCH#	PREP BT	#(S)	DATE/TIME ANALYZED
205678-1	AQ011404:910 NP4-1	01/15/2004	01/14/2004	1	27625	
T017	Volatile Organics (Air)					
205678-2	AQ011404:912 NP4-2	01/15/2004	01/14/2004	1	27625	
T017	Volatile Organics (Air)					
205678-3	AQ011404:914 NP4-3	01/15/2004	01/14/2004	1	27490	
T017	Volatile Organics (Air)					

QUALITY ASSURANCE METHODS

REFERENCES AND NOTES

Report Date: 01/28/2004

REPORT COMMENTS

- 1) All pages of this report are integral parts of the analytical data. Therefore, this report should be reproduced only in its entirety.
- 2) Soil, sediment and sludge sample results are reported on a "dry weight" basis except when analyzed for landfill disposal or incineration parameters. All other solid matrix samples are reported on an "as received" basis unless noted differently.
- 3) Reporting limits are adjusted for sample size used, dilutions and moisture content if applicable.
- 4) The test results for the noted analytical method(s) meet the requirements of NELAC. Lab Cert. ID# 10604
- 5) According to 40CFR Part 136.3, pH, Chlorine Residual and Dissolved Oxygen analyses are to be performed immediately after aqueous sample collection. When these parameters are not indicated as field (e.g. pH Field) they were not analyzed immediately, but as soon as possible on laboratory receipt.

Glossary of flags, qualifiers and abbreviation

Inorganic Qualifiers (Q-Column)

- U Analyte was not detected at or above the reporting limit.
- < Not detected at or above the reporting limit.
- J Result is less than the RL, but greater than or equal to the method detection limit.
- B Result is less than the CRDL/RL, but greater than or equal to the IDL/MDL.
- S Result was determined by the Method of Standard Additions.

Inorganic Flags (Flag Column)

- ~ ICV,CCV,ICB,CCB,ISA,ISB,CRI,CRA,MRL: Instrument related QC exceed th upper or lower control limits.
- * LCS, LCD, MD: Batch QC exceeds the upper or lower control limits.
- + MSA correlation coefficient is less than 0.995.
- 4 MS, MSD: The analyte present in the original sample is 4 times greater than the matrix spike concentration; therefore, control limits are not applicable.
- E SD: Serial dilution exceeds the control limits.
- H MB, EB: Batch QC is greater than reporting limit or had a negative instrument reading lower than the absolute value of the reporting limit.
- N MS, MSD: Spike recovery exceeds the upper or lower control limits.
- W PS: Post-digestion spike was outside 85-115% control limits.

Organic Qualifiers (Q - Column)

- U Analyte was not detected at or above the reporting limit.
- ND Compound not detected.
- J Result is an estimated value below the reporting limit or a tentatively identified compound (TIC).
- Q Result was qualitatively confirmed, but not quantified.
- C Pesticide identification was confirmed by GC/MS.
- Y The chromatographic response resembles a typical fuel pattern.
- Z The chromatographic response does not resemble a typical fuel pattern.
- E Result exceeded calibration range, secondary dilution required.

Organic Flags (Flags Column)

- ~ MB,EB,MLE: Batch QC is greater than reporting limit.
- * LCS, LCD, CCV, MS, MSD, Surrogate, RS:Batch QC exceeds the upper or lower control limits.
- A Concentration exceeds the instrument calibration range or below the reporting limit.
- B Compound was found in the blank and sample.
- D Surrogate or matrix spike recoveries were not obtained because the extract was diluted for analysis; also compounds analyzed at a dilution will be flagged with a D.
- H Alternate peak selection upon analytical review
- I Indicates the presence of an interference, recovery is not calculated.
- M Manually integrated compound.
- P The lower of the two values is reported when the % difference between the results of two GC columns is greater than 25%.

QUALITY ASSURANCE METHODS

REFERENCES AND NOTES

Report Date: 01/28/2004

Abbreviations

Batch	Designation given to identify a specific extraction, digestion, preparation set, or analysis set
CAP	Capillary Column
CCB	Continuing Calibration Blank
CCV	Continuing Calibration Verification
CF	Confirmation Analysis
CRA	Low Level Standard Check - GFAA; Mercury
CRI	Low Level Standard Check - ICP
Dil Fac	Dilution Factor
DL	Secondary dilution and analysis
DLFac	Detection Limit Factor
DSH	Distilled Standard - High Level
DSL	Distilled Standard - Low Level
DSM	Distilled Standard - Medium Level
EB	Extraction Blank
ICB	Initial Calibration Blank
ICV	Initial Calibration Verification
IDL	Instrument Detection Limit
ISA	Interference Check Sample A
ISB	Interference Check Sample B
Job No.	The first six digits of the sample ID which refers to a specific client, project and sample group
Lab ID	An 8 number unique laboratory identification
LCD	Laboratory Control Standard Duplicate
LCS	Laboratory Control Standard with reagent grade water or a matrix free from the analyte of interest
MB	Method Blank or (PB) Preparation Blank
MD	Method Duplicate
MDL	Method Detection Limit
MLE	Medium Level Extraction Blank
MRL	Method Reporting Limit Standard
MSA	Method of Standard Additions
MS	Matrix Spike
MSD	Matrix Spike Duplicate
ND	Not Detected
PACK	Packed Column
PREPF	Preparation factor used by the Laboratory's Information Management System (LIMS)
PS	Post Spike
PSD	Post Spike Duplicate
RA	Re-analysis
RE	Re-extraction and analysis
RL	Reporting Limit
RPD	Relative Percent Difference of duplicate (unrounded) analyses
RRF	Relative Response Factor
RS	Reference Standard
RT	Retention Time
RTW	Retention Time Window
SampleID	A 9 digit number unique for each sample, the first six digits are referred as the job number
SCB	Seeded Control Blank
SD	Serial Dilution
UCB	Unseeded Control Blank

One or a combination of these data qualifiers and abbreviations may appear in the analytical report.

STL-Connecticut Certification Summary (as of January 2004)

The laboratory identification numbers for the STL-Connecticut laboratory are provided in the following table. Many states certify laboratories for specific parameters or tests within a category (i.e. method 325.2 for wastewater). The information in the following table indicates the lab is certified in a general category of testing such as drinking water or wastewater analysis. The laboratory should be contacted directly if parameter-specific certification information is required.

State	Responsible Agency	Certification	Expiration Date	Lab Number
Connecticut	Department of Health Services	Drinking Water, Wastewater	12/31/04	PH-0497
Maine	Department of Health and Environmental Services	Drinking Water, Wastewater/Solid, Hazardous Waste	04/18/04	CT023
Massachusetts	Department of Environmental Protection	Potable/Non-Potable Water	06/30/04	CT023
New Hampshire	Department of Environmental Services	Drinking Water, Wastewater	08/29/04	2528
New Jersey	Department of Environmental Protection	Drinking Water, Wastewater	06/30/04	46410
New York	Department of Health	CLP, Drinking Water, Wastewater, Solid/ Hazardous Waste NELAC	04/01/04	10602
Rhode Island	Department of Health	Chemistry...Non-Potable Water and Wastewater	12/30/04	A43
Utah	Department of Health	RCRA	05/31/04	2032614458

0000009

Chain of Custody Record

STL-4124 (0901)

Client: **LBG** Chain of Custody Number: **180041**
 Address: **126 Monroe Turnpike** Lab Number: **1/14/04**
 City: **Trumbull** State: **CT** Zip Code: **06611** Page: **1** of **1**
 Project Name and Location (State): **Rowe**

Project Manager: **Paul Jobmann** Telephone Number (Area Code)/Fax Number: **203-452-3100**
 Site Contact: **Paul Jobmann** Lab Contact: **Paul Jobmann**
 Carrier/Waybill Number: _____

Contract/Purchase Order/Quote No. _____

Sample I.D. No. and Description (Containers for each sample may be combined on one line)	Date	Time	Matrix					Containers & Preservatives					Special Instructions/ Conditions of Receipt			
			Air	Sed	Soil	Unpres	H2SO4	HNO3	HCl	NaOH	ZnAc	HNO3				
AR011404-910 NP4-1 (Q1)	1/14/04	9^{am}	X													
AR011404-912 NP4-2 (Q2)	1/14/04	9^{am}	X													
AR011404-914 NP4-3 (Q3)	1/14/04	9^{am}	X													
205678	01/27/2004															MASSED HAD SCREEN H.O.C

Possible Hazard Identification
 Non-Hazard Flammable Skin Irritant Poison B Unknown Return To Client Disposal By Lab Archive For _____ Months (A fee may be assessed if samples are retained longer than 1 month)

Turn Around Time Required
 24 Hours 48 Hours 7 Days 14 Days 21 Days Other _____

QC Requirements (Specify)
 1. Relinquished By: **Marke M. Goldberg** Date: **1/15/04** Time: **8:30**
 2. Relinquished By: _____ Date: _____ Time: _____
 3. Relinquished By: _____ Date: _____ Time: _____

1. Received By: **Larry Decker** Date: **1-15-04** Time: **8:30**
 2. Received By: _____ Date: _____ Time: _____
 3. Received By: **H. Blachman** Date: **01/15/04** Time: **09:15**

Job Number.: 205678 Location.: 57207 Check List Number.: 1 Description.:
 Customer Job ID.....: Job Check List Date.: Date of the Report...: 01/15/2004
 Project Number.: 20000283 Project Description.: Rowe Industries Project Manager.....: mds
 Customer.....: LEGGETTE, BRASHEARS & GRAHAM Contact.: Paul Jobmann

Questions ? (Y/N) Comments

Chain-of-Custody Present?..... Y
 ...If "yes", completed properly?..... Y
 Custody seal on shipping container?..... N
 ...If "yes", custody seal intact?..... N
 Custody seals on sample containers?..... N
 ...If "yes", custody seal intact?..... N
 Samples iced?..... N
 Temperature of cooler acceptable? (4 deg C +/- 2). N 14C
 Samples received intact (good condition)?..... Y
 Volatile samples acceptable? (no headspace).....
 Correct containers used?..... Y
 Adequate sample volume provided?..... Y
 Samples preserved correctly?.....
 Samples received within holding-time?..... Y
 Agreement between COC and sample labels?..... Y
 Radioactivity at or below background levels?..... Y
 A Sample Discrepancy Report (SDR) was needed?..... N
 Comments.....
 If samples were shipped was there an air bill #?.. N P/U BY LARRY
 Sample Custodian Signature/Date..... Y

C-C 01/15/04
 Page 1