


LBG ENGINEERING SERVICES, P.C.

Professional Environmental & Civil Engineers



126 Monroe Turnpike
Trumbull, CT 06611
(203) 452-3110
(203) 452-3119 FAX)

June 7, 2004

Mr. Jeffery Trad
Project Manager
New York State Department of Environmental Conservation
Division of Environmental Remediation, Construction Services
625 Broadway, 12th floor
Albany, NY 12233-7013

RE: April 2004 Status Report
Ground-Water Remedial Action
Rowe Industries Superfund Site
Sag Harbor, New York

Dear Mr. Trad:

The enclosed letter report details the operation status of the full-scale ground-water pump and treat system at the above referenced site. LBG has enclosed an additional copy of the report to be forwarded to the Chief of the Operation Maintenance and Support Section.

Should you or the Operation Maintenance and Support Section have any questions, please feel free to contact myself, Paul Jobmann, or Al Kovalik at (203) 452-3100.

Very truly yours,

LEGGETTE, BRASHEARS & GRAHAM, INC.

Mark M. Goldberg

Mark M. Goldberg, P.E.
Senior Environmental Engineer

MG:ng

Enclosures

H:\NABIS\2004\Monthly reports\April 2004\trad_April 2004_report.doc

-DRAFT-

PROJECT STATUS MEMORANDUM

NO. 04-04

TO: Pamela Tames, USEPA

FROM: Mark M. Goldberg, P.E.
Alfred N. Kovalik, P.E.

DATE: June 7, 2004

PROJECT: Rowe Industries Superfund Site
Ground-Water Recovery and Treatment System
April 2004 Status Report
Sag Harbor, New York

LBG Engineering Services, P.C. (LBG) commenced operation of the ground-water remediation system at the above-referenced site on December 17, 2002. This status report presents a summary of system performance, operation and maintenance, and monitoring activities for the site from April 1, 2004 through April 30, 2004. The report includes a summary of system performance parameters, system operation parameters, analytical results for ground water, system effluent samples, and air-quality results.

SUMMARY OF SYSTEM PERFORMANCE AND OPERATION

(April 1, 2004 through April 30, 2004)

- | | |
|--|-----------------------------------|
| 1. Hours of operation during the reporting period: | 647 hours (90%) |
| 2. Alarm conditions during the reporting period: | See table 1 |
| 3. Was the SPDES VOC discharge permit criteria achieved: | yes, (table 2) |
| 4. Total volume of water pumped during the reporting period:
(The flow meter counter for Transfer Pump malfunctioned,
therefore avg. flow x hours of operation was used as an estimate.) | 14,688,864 gal. (est.) |
| 5. Was the system effluent flow below the SPDES limit of
1,023,000 gpd: | yes, (Graph 1) |
| 6. Mass of VOCs recovered during the reporting period: | 4.9 pounds |
| 7. Cumulative mass of VOCs recovered since startup on 12/17/02:
(calculations can be provided upon request) | 121.6 pounds |
| 8. Effluent VOC vapor concentration for the reporting period: | 0.175 mg/m ³ (table 3) |
| 9. Was the effluent VOC vapor emission rate below 0.022 lbs/hr.:
(calculations can be provided upon request) | yes (0.00217 lbs/hr.) |

GROUND-WATER RECOVERY SYSTEM STATUS SUMMARY

The following table summarizes select recovery well parameters for the reporting period. Table 4 presents a summary of the quality results for water samples collected from recovery wells. Graph 2 presents PCE concentrations for each recovery well. For wells with water quality that meets or is approaching remedial criteria, Graph 3 presents PCE concentrations at an expanded scale in order to compare them to the PCE aquifer restoration concentration of 5 ug/l. Laboratory analytical reports are included as Appendix I.

Well	Volume Pumped (gal)	Average Flow (gpm)	Minimum Design Flow Required for Plume Capture (gpm)	Total VOC Concentration (µg/l)	VOC Recovery (lbs)
RW-1	722,533	18.3	26	9.0	0.05
RW-2	563,783	14.7	26	7.2	0.03
RW-3 **	453,719	30.0	23	16.0	0.06
RW-4*	1,943,350	50.0	13	22.0	0.36
RW-5	2,259,517	55.0	42	25.6	0.48
RW-6	1,129,864	34.7	28	116.8	1.10
RW-7	2,255,621	69.5	54	81.5	1.53
RW-8	1,384,417	44.1	46	27.9	0.32
RW-9	1,437,893	38.4	68	25.2	0.30

*Estimated volume and flow due to sensor power supply malfunction. Future activities are being planned to move the RW-4 control panel above grade.

** RW-3 was not operating from April 9 to April 28, 2004 due to a drive malfunction.

Recovery Wells RW-1, RW-2, RW-8 and RW-9 had average flows below the minimum design flow required to capture the plume due to iron build-up in the recovery well pumps, the recovery well screens and the surrounding well formation, and associated influent piping. Despite cleaning the recovery well vault piping in RW-2, RW-4, RW-8, the onsite combined flow meter, and the offsite combined flow meter, the decreased flows from these wells persist. Recovery well pump cleaning and servicing for RW-1, RW-2, RW-4, RW-6, RW-7, RW-8 and RW-9 has been scheduled for May. In addition, the rehabilitation of Recovery Wells RW-1, RW-2, RW-4, RW-6, RW-7, RW-8 and RW-9 has been scheduled for May. Cleaning of the RW-2, RW-9 recovery well vault piping, and onsite/offsite combined flow meters, check valves, basket strainer and building influent piping with high pressure water jets, will be included in the scheduled work for May. Once all of this work is completed, the recovery well flow in these wells is expected to improve.

BAG FILTER STATUS

The following table presents an operational summary of the bag filter usage and configuration for the reporting period.

Dates	Bank 1	Bank 2	Bank 3
Apr. 1 to Apr. 30	7 of 8 housings used	7 of 8 housings used	Not active

Unless otherwise specified, 200 micron bag filters were used.

No modifications were made to the filter bank configuration or operation during this reporting period.

OTHER O&M MODIFICATIONS AND FUTURE O&M ACTIVITIES

Static water levels at select monitor wells and all recovery wells were measured on April 28, 2004. The system had been down for approximately three days due to communication failure on April 25, 2004, therefore, water levels in the aquifer had an opportunity to recover. Transfer pumps TP1B and TP2A were switched to be the lead pumps and transfer pumps TP1A and TP2B are now the lag pumps during this operating period.

A carbon change-out will be conducted in May. Future O&M activities scheduled for the late spring and summer include well rehabilitation of select recovery wells, moving the RW-4 control panel to an above-grade position, and monitor well construction at select locations to improve contaminant plume characterization and capture zone characterization.

cc: Terry Gerrish, CH2M Hill
Mark Lucas, CH2M Hill
Phil McAndrew, Kraft Foods, N.A.
Jeff Trad, NYSDEC
Chief-Operation Maintenance and Support Section
Robert Schneck, RWE, R-1, NYSDEC
David Gilmartin, Jr., Esq., Town of Southampton

MMG:ng

Attachments

H:\NABIS\2004\Monthly reports\April 2004\RevisedStatus0404April.doc

TABLES

TABLE 1
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

MAINTENANCE LOG
(April 1, 2004 through April 30, 2004)

Date	Time	System Changes/Modifications	Personnel
4/6/2004	9:00 AM	Computer stopped recording hourly operation data.	
4/9/2004	9:02 AM	Shut-down the system to reset the computer	MG
	9:20 AM	Re-booted the computer and restarted the system	MG
	9:24 AM	RW-3 drive is not ramping up. Tried restarting RW-3 several times. Similar problem experienced with RW-9 drive in February. RW-3 was left in the off position.	MG
		The low flow alarm setpoint on the on-site combined flow meter was changed from 75% to 200% because of increased iron build-up.	MG
		The flow setpoint for RW-1 was increased from 15 gpm to 20 gpm	MG
		Changed multi-bag filter bags (200 µm) in banks 1 and 2, seven of eight housings used.	MG
4/14/2004	9:27 AM	Changed multi-bag filter bags (200 µm) in banks 1 and 2, seven of eight housings used.	MG
4/21/2004	10:30 AM	Shut-off system recovery wells for maintenance.	MG/JM
	11:29 AM	Re-started the system recovery wells.	MG/JM
		Changed multi-bag filter bags (200 µm) in banks 1 and 2, seven of eight housings used.	MG/JM
		Removed obstructions in monitor wells N-37 and MW-48A.	MG/JM
		Switched Lead/Lag pumps, TP1A to TP1B and TP2B to TP2A; lubricated pump motors.	MG/JM
		Removed RW-3 flow meter to check for build-up or obstruction. Cleaned flow meter; no significant build-up observed; the RW-3 drive still wouldn't ramp up.	MG/JM
4/25/2004	10:35 AM	Communication Failure Alarm; System shut down.	
4/28/2004		Changed multi-bag filter bags (200 µm) in banks 1 and 2, seven of eight housings used.	MG
		Changed RW-1 and RW-2 flow setpoints from 20 gpm to 15 gpm.	PJ
		Measured static depth to water in recovery wells and monitor wells.	MG/JM
		Adjusted the RW-3 drive "run boost" and "start/acceleration boost" lower. Drive was sending out too much current which caused a drive alarm. RW-3 restarted.	PJ
	12:30 PM	Restarted the system.	PJ/MG

TABLE 2

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

DISCHARGE WATER QUALITY RESULTS

Date Sampled	pH ^{1/}	TDS (mg/L)	PCE (ug/L)	1,1,1-TCA (ug/L)	TCE (ug/L)	1,1-DCA (ug/L)	1,1-DCE (ug/L)	1,2-DCE (ug/L)	Xylene (ug/L)	Toluene (ug/L)	Ethylbenzene (ug/L)	Methylene Chloride (ug/L)	Freon 113 (ug/L)	Naphthalene (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)
SPDES Limits	6.5 to 8.5	—	1	5	5	5	5	5	5	5	5	5	—	10	7	—	—	—
9-Apr-04	6.1	110	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	5.61	0.32
14-Apr-04	6.1	94	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	1.9 ^{3/}	ND<1.0	ND<1.0	ND<1.0	ND<1.0	0.735	0.104
21-Apr-04	6.1	90	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	0.585	0.231
28-Apr-04	6.1	NM	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	9.88	0.224

SPDES: State Pollutant Discharge Elimination System

mg/L: Milligrams per liter

ug/L: Micrograms per liter

—: Not established

NM: Not Measured

TDS: Total dissolved solids

PCE: Tetrachloroethylene

TCE: Trichloroethene

1,1-DCA: 1,1-Dichloroethane

1,1-DCE: 1,1-Dichloroethene

1,2-DCE: 1,2-Dichloroethene

MTBE: Methyl tert-butyl ether

Notes:

1. pH was measured using litmus paper. Influent pH values from recovery wells are below 6.5 on a regular basis.

2. "Discharge" samples were collected from sample port labeled NP2-10.

3. Methylene Chloride was detected in the laboratory method blank.

TABLE 3

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

CARBON UNIT SYSTEM AIR QUALITY RESULTS

Precarbon			Parameters (mg/m3)																					TOTAL VOCs	
Sample Name	Date	Time	PCE	TCE	TCA	DCE	DCA	cis-DCE	Toluene	Benzene	m&p-Xylenes	o-Xylene	Styrene	CF	MC	CM	CD	BM	CB	EB	VC	CT			
AQ0312031131NP4-1	3/12/03	11:31	1.3	0.04	0.04	ND	ND	ND	0.02	0.009	ND	ND	ND	ND	ND	ND	ND	0.09	ND	ND	ND	ND	ND	1.50	
AQ0409030942NP4-1	4/9/03	9:42	0.72	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.72	
AQ060503:1155NP4-1	6/5/03	11:55	0.6	0.02	ND	ND	ND	ND	0.003	0.003	ND	ND	ND	ND	0.097	ND	ND	0.063	ND	ND	ND	ND	ND	ND	0.79
AQ071103:1340NP4-1	7/11/03	13:40	0.7	0.026	0.041	0.006	0.01	0.002	0.011	0.003	0.005	0.002	0.001	0.009	0.012	ND	0.043	0.022	ND	0.002	ND	ND	ND	ND	0.88
AQ082003:1210NP4-1	8/20/03	12:10	1.1	0.05	ND	ND	ND	ND	0.05	0.02	ND	ND	ND	ND	0.26	0.05	0.26	0.23	ND	ND	ND	ND	ND	ND	2.02
AQ090503:1005NP4-1	9/5/03	10:05	0.75	0.03	0.035	ND	ND	ND	0.01	0.005	ND	ND	ND	ND	0.05	0.02	0.055	0.135	ND	ND	ND	ND	ND	ND	1.09
AQ100803:1320NP4-1	10/8/03	13:20	0.6	0.03	0.03	ND	ND	ND	ND	0.005	ND	ND	ND	0.005	0.085	0.01	0.055	0.125	ND	ND	ND	ND	ND	ND	0.95
AQ110703:128NP4-1	11/7/03	13:28	0.367	0.187	0.213	0.027	ND	0.013	0.21	0.013	0.01	ND	ND	0.043	0.567	ND	0.233	0.11	ND	ND	ND	ND	ND	ND	1.99
AQ011404:910NP4-1	1/14/04	9:10	0.75	0.02	ND	ND	ND	ND	0.025	ND	ND	ND	ND	ND	0.055	ND	ND	0.285	ND	ND	ND	ND	ND	ND	1.14
AQ020504:924NP4-1	2/5/04	9:24	1.12	0.052	0.052	ND	ND	ND	0.036	0.004	0.002	ND	ND	0.01	0.062	ND	0.07	0.022	ND	ND	ND	ND	ND	ND	1.43
AQ030304:910NP4-1	3/3/04	9:10	0.48	0.02	ND	ND	ND	ND	0.014	0.004	ND	ND	ND	ND	0.01	ND	ND	0.068	ND	ND	ND	ND	ND	ND	0.60
AQ040904:1000NP4-1	4/9/04	10:00	0.425	0.02	0.033	ND	ND	ND	0.023	0.005	ND	ND	ND	ND	0.013	ND	0.04	0.008	ND	ND	ND	ND	ND	ND	0.57

Midcarbon			Parameters (mg/m3)																					TOTAL VOCs	
Sample Name	Date	Time	PCE	TCE	TCA	DCE	DCA	cis-DCE	Toluene	Benzene	m&p-Xylenes	o-Xylene	Styrene	CF	MC	CM	CD	BM	CB	EB	VC	CT			
AQ0312031131NP4-2	3/12/03	11:31	0.01	0.003	0.045	0.012	0.021	0.007	0.03	0.005	0.006	0.002	0.002	0.012	ND	ND	0.002	0.009	0.001	0.002	ND	ND	ND	ND	0.17
AQ0409030943NP4-2	4/9/03	9:43	0.006	0.003	0.049	0.01	0.018	0.006	0.008	0.001	0.004	ND	ND	0.011	0.081	ND	0.019	0.006	ND	ND	ND	ND	ND	ND	0.22
AQ060503:1156NP4-2	6/5/03	11:56	0.032	0.001	0.014	ND	ND	0.002	0.002	0.001	ND	ND	ND	0.004	0.018	0.002	ND	0.021	ND	ND	ND	ND	ND	ND	0.10
AQ071103:1340NP4-1	7/11/03	13:41	0.009	0.004	0.022	0.005	0.008	0.004	0.007	0.004	0.003	0.002	ND	0.006	0.005	ND	0.03	0.005	ND	0.001	ND	ND	ND	ND	0.12
AQ082003:1212NP4-2	8/20/03	12:12	0.024	0.016	0.049	0.007	ND	0.004	0.13	0.012	0.34	0.14	ND	0.009	ND	ND	0.13	0.078	ND	0.1	ND	ND	ND	ND	1.04
AQ090503:1007NP4-2	9/5/03	10:07	0.006	0.013	0.023	0.006	0.013	0.003	0.011	0.002	0.003	0.0009	ND	0.006	0.032	0.007	0.025	0.086	ND	0.0006	ND	ND	ND	ND	0.24
AQ100803:1322NP4-2	10/8/03	13:22	0.027	0.022	0.055	0.007	0.018	0.005	0.017	0.004	0.004	0.002	ND	0.011	0.026	0.003	0.047	0.042	ND	0.001	ND	ND	ND	ND	0.29
AQ110703:130NP4-2	11/7/03	13:30	0.27	0.011	ND	ND	ND	ND	0.012	ND	ND	ND	ND	0.002	0.057	ND	0.019	0.013	ND	ND	ND	ND	ND	ND	0.38
AQ011404:9:12NP4-2	1/14/04	9:12	0.5	0.083	ND	ND	ND	ND	0.03	ND	ND	ND	ND	ND	0.053	ND	ND	0.09	ND	ND	ND	ND	ND	ND	0.76
AQ020504:926NP4-2	2/5/04	9:26	1.1	0.160	0.061	0.011	0.026	0.005	0.048	0.004	0.006	ND	ND	0.013	0.047	ND	0.045	0.015	ND	ND	ND	ND	ND	ND	1.54
AQ030304:912NP4-2	3/3/04	9:12	0.41	0.057	0.024	ND	ND	ND	0.009	0.002	ND	ND	ND	0.006	0.007	ND	ND	0.005	ND	ND	ND	ND	ND	ND	0.52
AQ040904:1002NP4-2	4/9/04	10:02	0.325	0.040	0.033	ND	0.023	ND	0.03	0.005	0.002	ND	ND	ND	0.008	ND	0.063	0.008	ND	ND	ND	ND	ND	ND	0.54

Postcarbon			Parameters (mg/m3)																					TOTAL VOCs	
Sample Name	Date	Time	PCE	TCE	TCA	DCE	DCA	cis-DCE	Toluene	Benzene	m&p-Xylenes	o-Xylene	Styrene	CF	MC	CM	CD	BM	CB	EB	VC	CT			
AQ0312031132NP4-3	3/12/03	11:32	ND	ND	0.008	0.01	0.018	ND	0.01	0.002	0.002	ND	ND	0.006	ND	ND	0.003	0.01	ND	ND	ND	ND	ND	ND	0.07
AQ0409030944NP4-3	4/9/03	9:44	ND	ND	0.02	0.01	0.017	ND	0.005	ND	0.002	ND	ND	0.009	0.023	ND	0.019	0.017	ND	ND	ND	ND	ND	ND	0.12
AQ060503:1157NP4-3	6/5/03	11:57	ND	ND	0.068	0.036	0.056	0.014	0.011	0.019	0.005	ND	ND	0.031	0.028	ND	0.041	0.03	ND	ND	ND	ND	ND	ND	0.34
AQ071103:1340NP4-1	7/11/03	13:43	0.002	0.001	0.013	0.008	0.011	0.003	0.009	0.002	0.003	0.002	ND	0.007	0.008	0.002	0.04	0.016	ND	0.002	ND	ND	ND	ND	0.13
AQ082003:1215NP4-3	8/20/03	12:15	0.011	0.002	0.035	0.011	0.022	0.006	0.1	0.017	0.25	0.1	ND	ND	0.012	ND	0.1	0.043	ND	0.073	0.002	ND	ND	ND	0.78
AQ090503:1010NP4-3	9/5/03	10:15	ND	0.003	0.017	0.004	0.009	0.003	0.011	0.006	0.003	0.001	ND	0.006	0.028	0.004	0.038	0.029	ND	0.0008	ND	ND	ND	ND	0.16
AQ100803:1324NP4-3	10/8/03	13:24	0.001	0.0006	0.035	0.008	0.018	0.005	0.017	0.005	0.003	0.001	ND	0.009	0.012	ND	0.056	0.049	ND	0.0009	ND	ND	ND	ND	0.22
AQ110703:132NP4-3	11/7/03	13:32	0.015	0.005	0.089	0.009	0.029	0.005	0.055	0.006	0.004	ND	ND	0.016	0.24	ND	0.068	0.044	ND	ND	ND	ND	ND	ND	0.59
AQ011404:914NP4-3	1/14/04	9:14	ND	ND	0.1	ND	0.022	ND	0.015	ND	ND	ND	ND	0.012	0.037	ND	ND	0.01	ND	ND	ND	ND	0.012	ND	0.21
AQ020504:928NP4-3	2/5/04	9:28	0.017	0.019	0.093	0.012	0.024	0.01	0.04	0.004	0.005	ND	ND	0.017	0.046	ND	0.055	0.015	ND	ND	ND	ND	ND	ND	0.36
AQ030304:914NP4-3	3/3/04	9:14	ND	0.002	0.034	ND	ND	ND	0.011	0.002	ND	ND	ND	0.008	0.008	ND	0.019	0.007	ND	ND	ND	ND	ND	ND	0.09
AQ040904:1005NP4-3	4/9/04	10:05	0.004	ND	0.028	0.006	0.013	0.004	0.037	0.003	0.004	0.001	0.003	ND	0.009	ND	0.048	0.014	ND	0.001	ND	ND	ND	ND	0.18

PCE - Tetrachloroethane
TCE - Trichloroethane
TCA - 1,1,1-Trichloroethane

DCE - 1,1-Dichloroethene
DCA - 1,1-Dichloroethane
cis-DCE - cis-1,2-Dichloroethene
CT - Carbon Tetrachloride

CF - Chloroform
MC - Methylene Chloride
CM - Chloromethane
CD - Carbon Disulfide

BM - Bromomethane
CB - Chlorobenzene
EB - Ethylbenzene
VC - Vinyl Chloride

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	Isopropylbenzene (ug/L)	1,1-Dichloroethane (ug/L)	cis-1,2-Dichloroethene (ug/L)	1,1-Dichloroethene (ug/L)	Methylene Chloride (ug/L)	Naphthalene (ug/L)
RW-1	5-Sep-02	ND<1	ND<1	ND<1	27	1.9	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	5-Sep-02	ND<1	ND<1	ND<1	ND<1	2.6	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Oct-02	ND<1	ND<1	ND<1	ND<1	2.2	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	9-Oct-02	ND<1	ND<1	ND<1	ND<1	2.8	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Nov-02	-	-	-	-	-	-	0.032	ND<0.02	-	-	-	-	-	ND<1
	3-Jan-03	ND<1	ND<1	ND<1	ND<1	2.4	16	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	ND<1	ND<1	ND<1	ND<1	2.0	9.8	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	ND<1	ND<1	ND<1	ND<1	1.4	4.3	0.566	ND<0.02	ND<1	ND<1	ND<1	ND<1	10	ND<1
	23-Apr-03	ND<1	ND<1	ND<1	ND<1	1.2	8.6	0.053	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	ND<1	ND<1	ND<1	ND<1	1.8	8.7	0.051	ND<0.02	ND<1	ND<1	ND<1	ND<1	3.6	ND<1
	11-Jun-03	ND<1	ND<1	ND<1	ND<1	ND<1	8.1	0.0290	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	ND<1	ND<1	ND<1	ND<1	2.9	6.6	0.0100	0.03	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	ND<1	ND<1	ND<1	ND<1	2.6	9.4	0.0930	0.011	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	ND<1	ND<1	ND<1	ND<1	3.2	14	0.0540	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.0613	0.0074	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Dec-03	ND<1	ND<1	ND<1	ND<1	2.2	9.4	0.0190	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-04	ND<1	ND<1	ND<1	ND<1	4.0	2.2	0.0098	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	ND<1	ND<1	ND<1	ND<1	4.6	5.2	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
RW-2	8-Mar-04	ND<1	ND<1	ND<1	ND<1	ND<1	4.1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	5.5
	14-Apr-04	ND<1	ND<1	ND<1	ND<1	2.9	6.1	0.0240	ND<0.02	ND<1	ND<1	ND<1	ND<1	1.8 *	ND<1
	5-Sep-02	190	2.9	ND<1	ND<1	ND<1	21	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	5-Sep-02	120	1.4	ND<1	ND<1	ND<1	18	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Oct-02	140	2	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	9-Oct-02	110	1.9	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	6.6	ND<1
	26-Nov-02	-	-	-	-	-	-	50.9	0.188	-	-	-	-	-	ND<1
	3-Jan-03	38	1.3	ND<1	ND<1	ND<1	7.5	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	31	ND<1	ND<1	ND<1	ND<1	6.7	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	26	1.8	ND<1	ND<1	ND<1	ND<1	11.4	0.059	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	14	1.3	ND<1	ND<1	ND<1	ND<1	6.31	0.212	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	21	2	ND<1	ND<1	ND<1	3.8	5.51	0.052	ND<1	ND<1	ND<1	ND<1	3.7	ND<1
	11-Jun-03	15	0.6	ND<1	ND<1	ND<1	ND<1	3.01	0.885	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	12	ND<1	ND<1	ND<1	ND<1	ND<1	5.34	0.438	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	7.9	ND<1	ND<1	ND<1	ND<1	ND<1	5.99	0.758	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	9.2	0.5	ND<1	ND<1	ND<1	6.0	4.49	0.899	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	8.1	0.7	ND<1	ND<1	ND<1	ND<1	6.79	0.101	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Dec-03	5.5	ND<1	ND<1	ND<1	ND<1	5.5	5.46	0.0213	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-04	8.7	ND<1	ND<1	ND<1	ND<1	1.1	5.57	0.207	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	5.4	ND<1	ND<1	ND<1	ND<1	3.9	3.77	0.0748	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Mar-04	4.9	ND<1	ND<1	ND<1	ND<1	3.3	0.343	0.318	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Apr-04	4.4	ND<1	ND<1	ND<1	ND<1	2.8	5.59	0.224	ND<1	ND<1	ND<1	ND<1	1.8 *	ND<1

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	Isopropyl-benzene (ug/L)	1,1-Dichloro-ethane (ug/L)	cis-1,2-Dichloro-ethene (ug/L)	1,1-Dichloro-ethene (ug/L)	Methylene Chloride (ug/L)	Naphthalene (ug/L)
RW-3	5-Sep-02	23	1.6	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	5-Sep-02	30	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Oct-02	18	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	9-Oct-02	19	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Nov-02	-	-	-	-	-	-	2.23	2.34	-	-	-	-	-	ND<1
	3-Jan-03	2.8	8.5	4.8	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	2.7	5.8	2.4	ND<1	ND<1	1.8	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	2.4	3.6	1.1	ND<1	ND<1	ND<1	1.84	0.013	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	1.1	1.2	ND<1	ND<1	ND<1	ND<1	1.81	0.395	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	2.2	2.5	1.1	ND<1	ND<1	ND<1	1.68	0.166	ND<1	ND<1	ND<1	ND<1	3.7	ND<1
	11-Jun-03	2.4	3.4	1.8	ND<1	ND<1	ND<1	2.37	0.517	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	2.3	5.7	2.3	ND<1	ND<1	ND<1	1.77	0.636	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	2.8	5.8	2.9	ND<1	ND<1	ND<1	2.24	1.57	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	2.1	5.3	2.6	ND<1	ND<1	ND<1	1.86	1.69	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	1.9	5.2	3.3	ND<1	ND<1	ND<1	2.59	1.27	ND<1	ND<1	0.6	ND<1	ND<1	ND<1
	23-Dec-03	1.2	5.8	ND<1	ND<1	ND<1	ND<1	1.96	0.129	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-04	2.2	6.9	3.2	ND<1	ND<1	ND<1	1.96	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	ND<1	3.6	2.2	ND<1	ND<1	ND<1	1.63	1.43	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Mar-04	1.2	5.0	2.3	ND<1	ND<1	ND<1	3.34	0.542	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	28-Apr-04	1.3	8.8	4.4	ND<1	ND<1	ND<1	3.07	1.32	ND<1	ND<1	1.5	ND<1	ND<1	ND<1
RW-4	23-Sep-02	550	8.5	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-02	590	9.5	1.6	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Oct-02	670	11	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	9-Oct-02	450	9.6	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Nov-02	-	-	-	-	-	-	11	2.41	-	-	-	-	-	ND<1
	3-Jan-03	190	3.8	7.1	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	130	6.5	0.7	ND<1	ND<1	4.3	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	150	3.6	ND<1	ND<1	ND<1	ND<1	1.36	0.041	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	110	3.1	ND<1	ND<1	ND<1	ND<1	3.18	0.136	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	170	5.4	1.0	ND<1	ND<1	3.4	2.38	0.023	ND<1	ND<1	ND<1	ND<1	3.3	ND<1
	11-Jun-03	170	4.8	ND<1	ND<1	ND<1	ND<1	1.03	0.572	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	200	5.9	1.3	ND<1	ND<1	ND<1	2.67	0.292	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	210	5.7	1.1	ND<1	ND<1	ND<1	3.21	0.529	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	390	8.2	1.0	ND<1	ND<1	ND<1	2.95	0.922	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	380	6.8	1.6	ND<1	ND<1	ND<1	6.93	0.221	ND<1	1.2	0.9	0.8	ND<1	ND<1
	23-Dec-03	270	7.9	ND<1	ND<1	ND<1	ND<1	5.45	0.0331	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-04	270	5.9	ND<1	ND<1	ND<1	ND<1	3.56	0.48	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	170	6.9	14.0	ND<1	ND<1	ND<1	3.28	0.353	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Mar-04	170	5.8	4.5	ND<1	ND<1	ND<1	1.61	0.0691	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Apr-04	22	ND<1	ND<1	ND<1	ND<1	ND<1	0.982	0.173	ND<1	ND<1	ND<1	ND<1	2.1*	ND<1

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	Isopropylbenzene (ug/L)	1,1-Dichloroethane (ug/L)	cis-1,2-Dichloroethene (ug/L)	1,1-Dichloroethene (ug/L)	Methylene Chloride (ug/L)	Naphthalene (ug/L)
RW-5	12-Sep-02	ND<1	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Sep-02	ND<1	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Oct-02	ND<1	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	9-Oct-02	ND<1	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Nov-02	-	-	-	-	-	-	ND<0.02	ND<0.02	-	-	-	-	-	ND<1
	3-Jan-03	5.5	ND<1	ND<1	ND<1	1.9	1.5	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	5.8	ND<1	ND<1	ND<1	1.1	3.5	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	19	ND<1	ND<1	ND<1	ND<1	ND<1	0.489	0.013	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	12	ND<1	ND<1	ND<1	ND<1	ND<1	0.068	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	21	ND<1	ND<1	ND<1	0.8	6.7	0.146	ND<0.02	ND<1	ND<1	ND<1	ND<1	3.6	ND<1
	11-Jun-03	21	ND<1	ND<1	ND<1	ND<1	6.2	0.76	0.0356	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	11	ND<1	ND<1	ND<1	1.1	9.7	6.47	0.068	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	15	ND<1	ND<1	ND<1	0.9	7.3	0.269	0.021	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	18	ND<1	ND<1	ND<1	ND<1	8.1	0.043	0.016	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	18	ND<1	ND<1	ND<1	ND<1	ND<1	13.1	0.0097	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Dec-03	11	ND<1	ND<1	ND<1	ND<1	7.5	0.0523	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-04	14	ND<1	ND<1	ND<1	0.9	4.0	0.05	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	14	ND<1	ND<1	ND<1	1.0	6.2	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Mar-04	14	ND<1	ND<1	ND<1	ND<1	5.0	0.0852	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Apr-04	18	ND<1	1.5	ND<1	ND<1	6.1	0.147	0.015	ND<1	ND<1	ND<1	ND<1	2*	ND<1
RW-6	12-Sep-02	69	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Sep-02	140	1.1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Oct-02	120	1.7	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	9-Oct-02	130	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Nov-02	-	-	-	-	-	-	0.37	ND<0.02	-	-	-	-	-	ND<1
	3-Jan-03	110	1.1	ND<1	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	97	1.6	ND<1	ND<1	0.6	ND<1	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	130	1.0	ND<1	ND<1	ND<1	ND<1	3.05	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	79	1.0	ND<1	ND<1	ND<1	ND<1	0.028	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	120	1.8	ND<1	ND<1	0.6	ND<1	0.068	ND<0.02	ND<1	ND<1	ND<1	ND<1	3.5	ND<1
	11-Jun-03	120	0.7	ND<1	ND<1	ND<1	ND<1	0.0097	0.011	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	150	0.6	ND<1	ND<1	ND<1	ND<1	0.186	0.034	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	140	2.2	ND<1	ND<1	ND<1	ND<1	0.089	0.018	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	140	2.6	ND<1	ND<1	ND<1	ND<1	0.023	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	180	3.3	1.0	ND<1	ND<1	ND<1	0.342	0.0083	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Dec-03	120	2.6	ND<1	ND<1	ND<1	ND<1	0.017	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-04	160	2.4	ND<1	ND<1	ND<1	ND<1	0.015	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	130	3.3	1.1	ND<1	ND<1	1.7	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Mar-04	110	2.7	ND<1	ND<1	ND<1	1.6	0.077	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Apr-04	110	2.9	1.3	ND<1	ND<1	2.6	0.016	ND<0.02	ND<1	ND<1	ND<1	ND<1	1.8*	ND<1

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	Isopropylbenzene (ug/L)	1,1-Dichloroethane (ug/L)	cis-1,2-Dichloroethene (ug/L)	1,1-Dichloroethene (ug/L)	Methylene Chloride (ug/L)	Naphthalene (ug/L)
RW-7	12-Sep-02	270	4.1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Sep-02	350	5.2	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Oct-02	360	4.7	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	9-Oct-02	370	4.9	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Nov-02	-	-	-	-	-	-	0.075	ND<0.02	-	-	-	-	-	ND<1
	3-Jan-03	160	2.5	1.3	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	120	2.3	1.1	ND<1	0.5	1.4	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	160	2.3	ND<1	ND<1	ND<1	ND<1	0.405	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	100	1.8	ND<1	ND<1	ND<1	ND<1	0.016	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	140	3.1	1.0	ND<1	ND<1	ND<1	0.032	ND<0.02	ND<1	ND<1	ND<1	ND<1	4.0	ND<1
	11-Jun-03	140	2.0	ND<1	ND<1	ND<1	ND<1	0.0246	0.0086	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	150	2.1	ND<1	ND<1	ND<1	ND<1	0.024	0.041	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	120	2.3	ND<1	ND<1	ND<1	ND<1	0.011	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	130	2.9	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	140	3.4	1.1	ND<1	ND<1	ND<1	0.0464	ND<0.02	ND<1	ND<1	0.2	ND<1	ND<1	ND<1
	23-Dec-03	110	2.8	ND<1	ND<1	ND<1	ND<1	0.0239	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-04	190	3.7	ND<1	ND<1	ND<1	ND<1	0.0069	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	120	2.9	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Mar-04	100	3.0	ND<1	ND<1	ND<1	ND<1	0.0205	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Apr-04	79	2.5	ND<1	ND<1	ND<1	ND<1	0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	2.2*	ND<1
RW-8	23-Sep-02	130	7.1	ND<1	ND<1	ND<1	-	-	-	1.1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-02	100	6.6	ND<1	ND<1	ND<1	-	-	-	1.4	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Oct-02	100	7.5	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	9-Oct-02	94	6.6	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Nov-02	-	-	-	-	-	-	12.1	1.43	-	-	-	-	-	ND<1
	3-Jan-03	59	4.3	4	ND<1	ND<1	ND<1	-	-	ND<1	2.4	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	58	4.2	3.2	ND<1	ND<1	ND<1	-	-	ND<1	1.8	0.6	ND<1	ND<1	ND<1
	21-Mar-03	70	2.9	2.7	ND<1	ND<1	ND<1	0.544	0.141	ND<1	1.4	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	41	2.0	1.8	ND<1	ND<1	ND<1	11.8	0.352	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	61	3.9	3.8	ND<1	ND<1	ND<1	10.1	0.068	ND<1	1.8	ND<1	ND<1	3.4	ND<1
	11-Jun-03	57	3.1	2.7	ND<1	ND<1	ND<1	9.14	1.10	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	35	1.9	3.2	ND<1	ND<1	ND<1	10.5	0.43	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	30	1.7	3.6	ND<1	ND<1	ND<1	11.1	1.18	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	28	2.5	4.4	ND<1	ND<1	ND<1	9.93	0.40	ND<1	3.3	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	27	2.3	5.4	ND<1	ND<1	ND<1	13.3	0.21	ND<1	4.1	0.7	1.3	ND<1	ND<1
	23-Dec-03	17	2.1	2.6	ND<1	ND<1	ND<1	9.16	0.05	ND<1	1.3	ND<1	ND<1	ND<1	ND<1
	23-Jan-04	16	2.2	4.1	ND<1	ND<1	ND<1	9.73	2.72	ND<1	3.5	ND<1	1.5	ND<1	ND<1
	11-Feb-04	15	2.2	4.7	ND<1	ND<1	ND<1	8.74	0.19	ND<1	4.1	ND<1	ND<1	ND<1	ND<1
	8-Mar-04	22	2.7	4.3	ND<1	ND<1	ND<1	11.9	0.23	ND<1	3.9	ND<1	ND<1	ND<1	ND<1
	14-Apr-04	14	2.0	6.2	ND<1	ND<1	ND<1	10.7	0.14	ND<1	5.7	ND<1	ND<1	1.9*	ND<1

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	Isopropyl-benzene (ug/L)	1,1-Dichloro-ethane (ug/L)	cis-1,2-Dichloro-ethene (ug/L)	1,1-Dichloro-ethene (ug/L)	Methylene Chloride (ug/L)	Naphthalene (ug/L)
RW-9	23-Sep-02	12	2.9	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-02	11	3	3.5	ND<1	ND<1	-	-	-	ND<1	5.3	ND<1	ND<1	ND<1	ND<1
	8-Oct-02	9.2	2.5	3.5	ND<1	ND<1	-	-	-	ND<1	6	1.1	ND<1	ND<1	ND<1
	9-Oct-02	16	3.4	6.6	ND<1	ND<1	-	-	-	ND<1	5.2	ND<1	ND<1	ND<1	ND<1
	26-Nov-02	-	-	-	-	-	-	2.99	1.72	-	-	-	-	-	ND<1
	3-Jan-03	17	2.5	6.9	ND<1	ND<1	ND<1	-	-	ND<1	3.1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	23	2.8	4.3	ND<1	ND<1	ND<1	-	-	ND<1	2.5	0.6	ND<1	ND<1	ND<1
	21-Mar-03	23	2.2	2.8	ND<1	ND<1	ND<1	11.0	0.013	ND<1	1.7	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	15	1.2	1.8	ND<1	ND<1	ND<1	3.55	1.97	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	21	1.8	3.6	ND<1	ND<1	ND<1	2.95	0.046	ND<1	1.9	ND<1	ND<1	3.2	ND<1
	11-Jun-03	18	1.6	4.8	ND<1	ND<1	ND<1	2.75	1.74	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	4.7	1.6	7.3	ND<1	ND<1	ND<1	3.60	0.467	ND<1	3.6	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	25	1.2	3.5	ND<1	ND<1	ND<1	4.05	2.69	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	22	2.1	5.8	ND<1	ND<1	ND<1	3.49	2.88	ND<1	3.5	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	27	2.2	8.2	ND<1	ND<1	ND<1	5.39	1.72	ND<1	5.2	ND<1	1.4	ND<1	ND<1
	23-Dec-03	11	1.7	5.4	ND<1	ND<1	ND<1	1.94	1.57	ND<1	3.0	ND<1	ND<1	ND<1	ND<1
	23-Jan-04	2.3	2.2	13	ND<1	ND<1	ND<1	0.638	0.029	ND<1	1.8	ND<1	1.5	ND<1	ND<1
	11-Feb-04	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	ND<1
	8-Mar-04	ND<1	2.2	12	ND<1	ND<1	ND<1	1.24	0.222	ND<1	3.7	ND<1	1.3	ND<1	ND<1
	14-Apr-04	5.6	1.7	10	ND<1	ND<1	ND<1	2.65	1.22	ND<1	5.9	ND<1	2.0	2.0*	ND<1

ND: Not detected

<#: Less than method detection limit

ug/L: Micrograms per liter

-: Not analyzed

PCE: Tetrachloroethylene

TCE: Trichloroethylene

TCA: 1,1,1-Trichloroethane

1,1-DCA: 1,1-Dichloroethane

1,1-DCE: 1,1-Dichloroethene

1,2-DCE: 1,2-Dichloroethene

MTBE: Methyl Tertiary Butyl Ether


NM: Not Measured due to drive failure

*Methylene Chloride detected in 4/14/04 laboratory method blank

GRAPHS


GRAPH 1
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

EFFLUENT FLOW DATA
(April 1, 2004 through April 30, 2004)

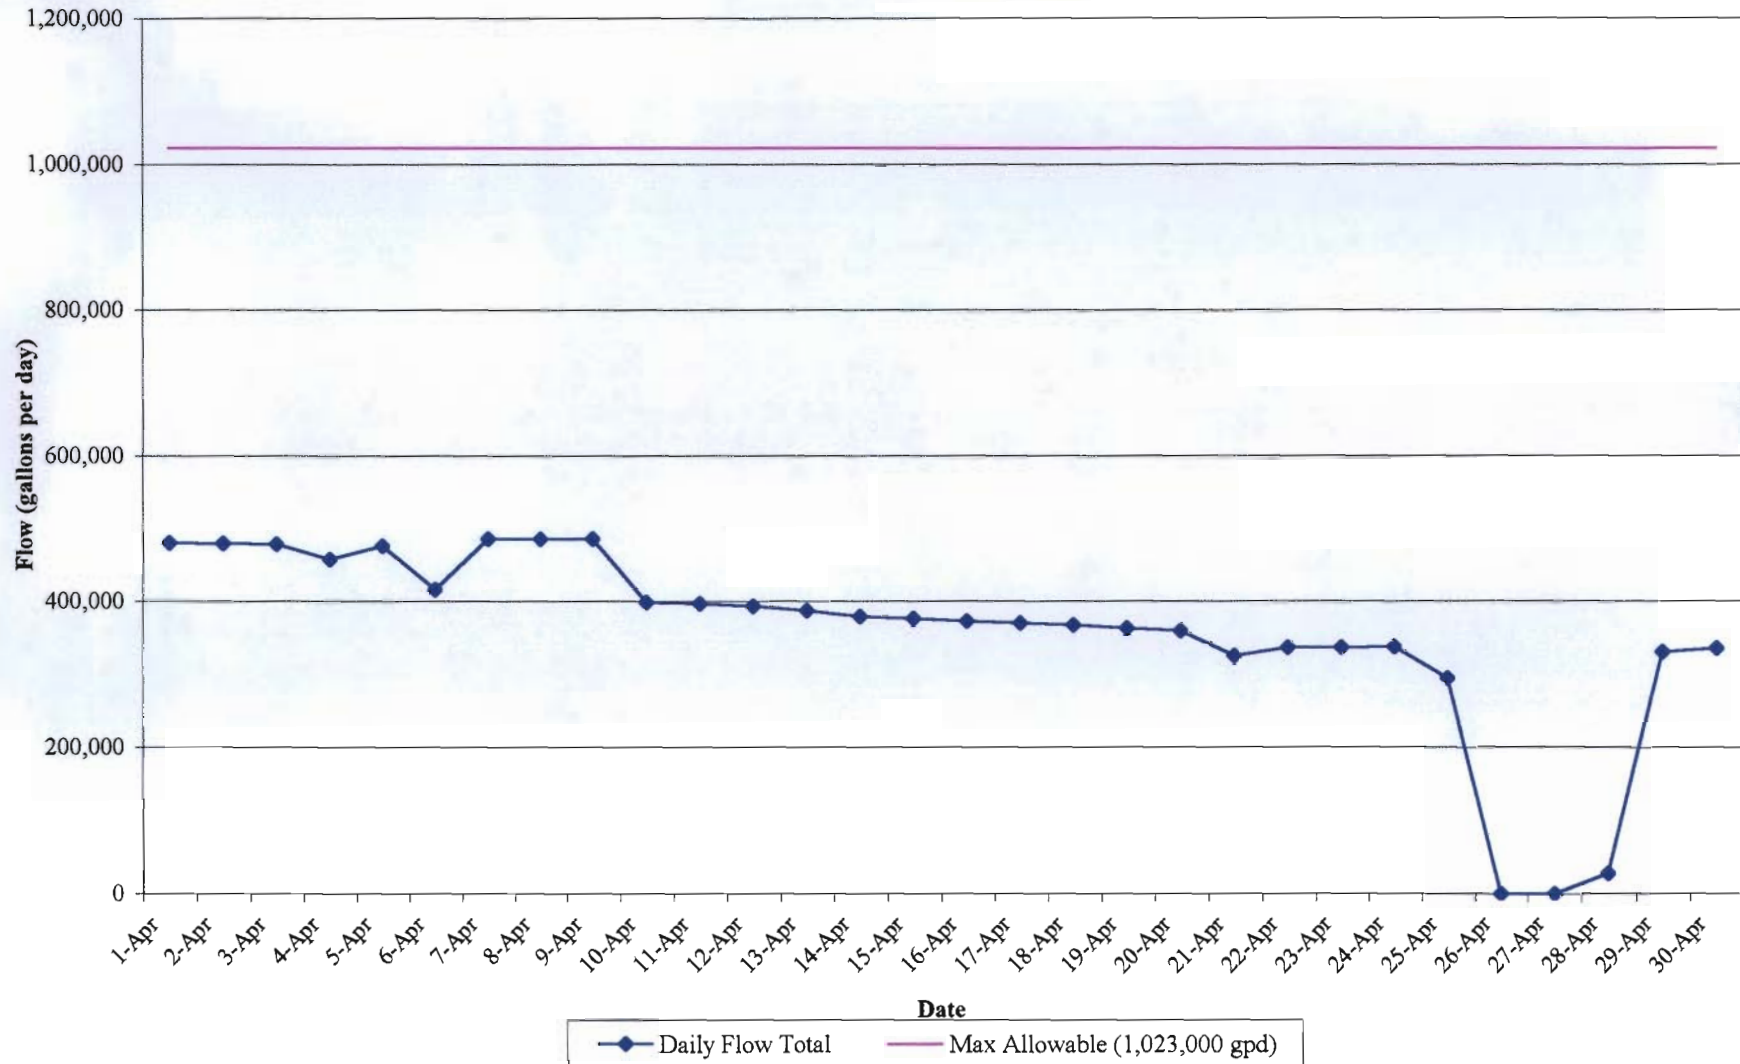


GRAPH 2 **GROUND-WATER REMEDIAL ACTION** **ROWE INDUSTRIES SUPERFUND SITE** **SAG HARBOR, NEW YORK**

RECOVERY WELL PCE CONCENTRATION IN MICROGRAMS PER LITER

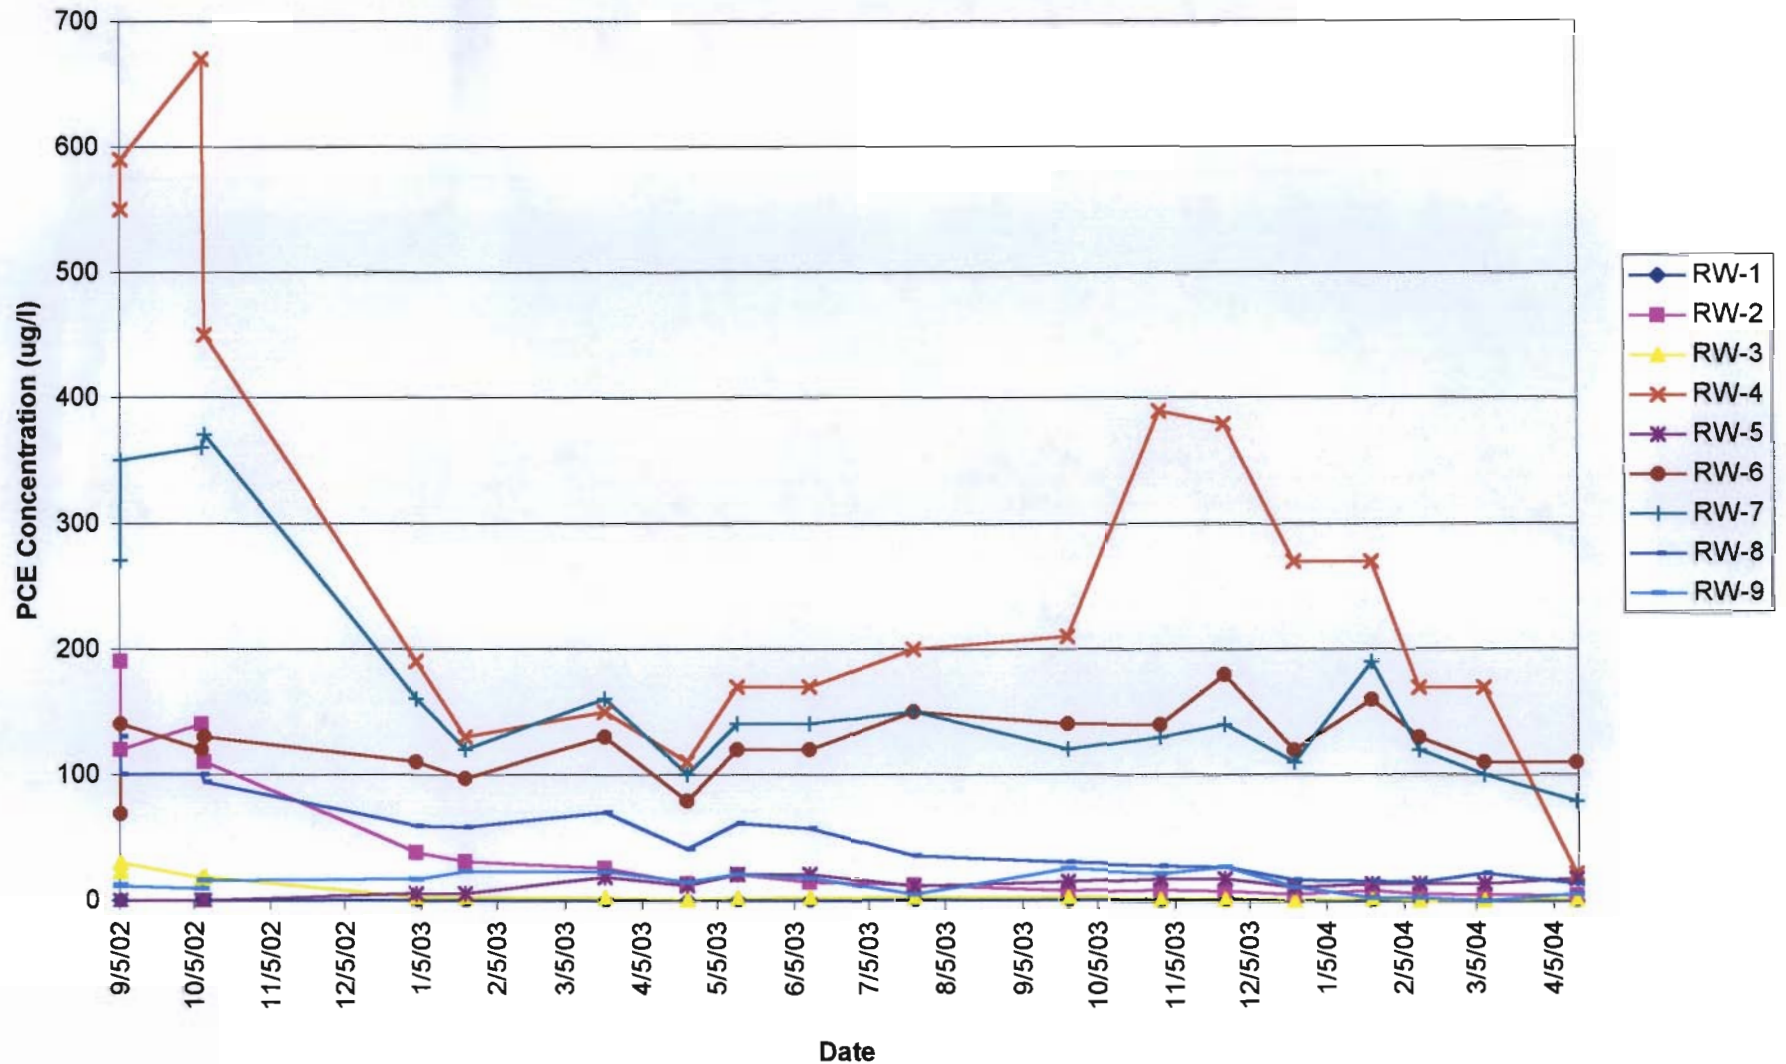

GRAPH 3
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RECOVERY WELL PCE CONCENTRATION FOR SELECT RECOVERY WELLS

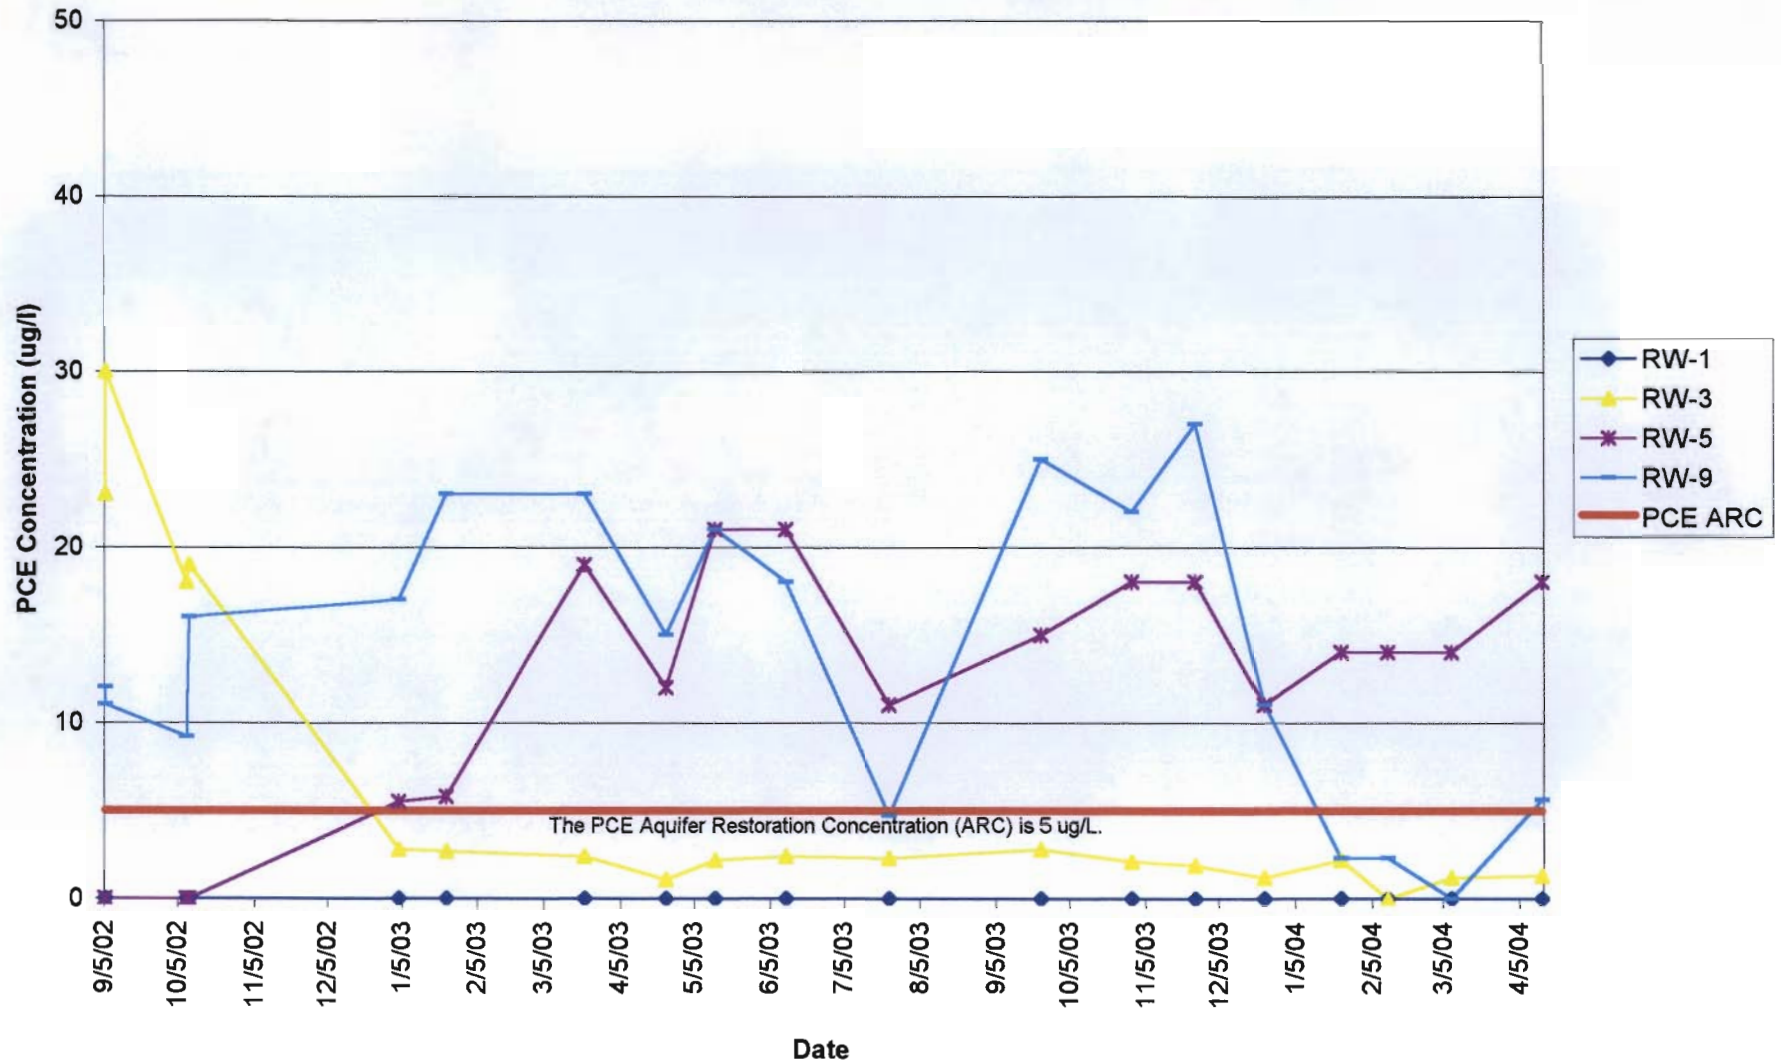

APPENDIX I
APRIL 2004 LABORATORY ANALYTICAL REPORTS

April 20, 2004

Mark Goldberg
Legette Brashears & Graham Inc.
126 Monroe Turnpike
Trumbull, CT 06611

TEL: (203) 452-3110

FAX (203) 452-3111

RE: Rowe Industries

Order No.: 0404080

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 samples on 4/13/2004 for the analyses presented in the following report.

There were no problems with the analyses and all data for associated QC met EPA or laboratory specifications.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Lori Beyer
Lab Director




American Analytical Laboratories, LLC.

Date: 20-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0404080

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0404080-01A	WQ040904:950 NP2-6		4/9/2004	4/13/2004
0404080-01B	WQ040904:950 NP2-6		4/9/2004	4/13/2004
0404080-02A	WQ040904:952 NP2-7		4/9/2004	4/13/2004
0404080-02B	WQ040904:952 NP2-7		4/9/2004	4/13/2004
0404080-03A	WQ040904:955 NP2-10		4/9/2004	4/13/2004
0404080-03B	WQ040904:955 NP2-10		4/9/2004	4/13/2004



NYSDOH	ELAP	11418
CTDOH	PH-0205	
NJDEP	NY050	
PADEP	68-573	

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100

FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 20-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404080
Project: Rowe Industries
Lab ID: 0404080-01A

Client Sample ID: WQ040904:950 NP2-6
Tag Number:
Collection Date: 4/9/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7				Analyst: JP
Iron	10.2	0.0200		mg/L	1	4/14/2004 1:29:03 PM
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
2-Butanone	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
2-Hexanone	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Acetone	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Benzene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Bromobenzene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Bromochloromethane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Bromodichloromethane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Bromoform	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Bromomethane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Carbon disulfide	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	4/13/2004 5:58:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 20-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404080
Project: Rowe Industries
Lab ID: 0404080-01A

Client Sample ID: WQ040904:950 NP2-6
Tag Number:
Collection Date: 4/9/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chlorobenzene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Chloroethane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Chloroform	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Chloromethane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Dibromochloromethane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Dibromomethane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Ethylbenzene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Isopropylbenzene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
m,p-Xylene	U	2.0		µg/L	1	4/13/2004 5:58:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Methylene chloride	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Naphthalene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
n-Butylbenzene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
n-Propylbenzene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
o-Xylene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Styrene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Tetrachloroethene	4.7	1.0		µg/L	1	4/13/2004 5:58:00 PM
Toluene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Trichloroethene	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Vinyl acetate	U	1.0		µg/L	1	4/13/2004 5:58:00 PM
Vinyl chloride	U	1.0		µg/L	1	4/13/2004 5:58:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 20-Apr-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ040904:950 NP2-6
Lab Order:	0404080	Tag Number:	
Project:	Rowe Industries	Collection Date:	4/9/2004
Lab ID:	0404080-01B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.0731	0.0200		mg/L	1	4/14/2004 1:20:15 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 20-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404080
Project: Rowe Industries
Lab ID: 0404080-02A

Client Sample ID: WQ040904:952 NP2-7
Tag Number:
Collection Date: 4/9/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	6.72	0.0200		mg/L	1	4/14/2004 1:34:00 PM
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
2-Butanone	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
2-Hexanone	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Acetone	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Benzene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Bromobenzene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Bromochloromethane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Bromodichloromethane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Bromoform	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Bromomethane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Carbon disulfide	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	4/13/2004 6:40:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 20-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404080
Project: Rowe Industries
Lab ID: 0404080-02A

Client Sample ID: WQ040904:952 NP2-7
Tag Number:
Collection Date: 4/9/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chlorobenzene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Chloroethane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Chloroform	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Chloromethane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Dibromochloromethane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Dibromomethane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Ethylbenzene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Isopropylbenzene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
m,p-Xylene	U	2.0		µg/L	1	4/13/2004 6:40:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Methylene chloride	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Naphthalene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
n-Butylbenzene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
n-Propylbenzene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
o-Xylene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Styrene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Tetrachloroethene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Toluene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Trichloroethene	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Vinyl acetate	U	1.0		µg/L	1	4/13/2004 6:40:00 PM
Vinyl chloride	U	1.0		µg/L	1	4/13/2004 6:40:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 20-Apr-04

CLIENT: Legette Brashears & Graham Inc.**Client Sample ID:** WQ040904:952 NP2-7**Lab Order:** 0404080**Tag Number:****Project:** Rowe Industries**Collection Date:** 4/9/2004**Lab ID:** 0404080-02B**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.212	0.0200		mg/L	1	4/14/2004 1:31:37 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 20-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404080
Project: Rowe Industries
Lab ID: 0404080-03A

Client Sample ID: WQ040904:955 NP2-10
Tag Number:
Collection Date: 4/9/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	5.61	0.0200		mg/L	1	4/14/2004 1:39:00 PM
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
2-Butanone	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
2-Hexanone	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Acetone	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Benzene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Bromobenzene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Bromochloromethane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Bromodichloromethane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Bromoform	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Bromomethane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Carbon disulfide	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	4/13/2004 7:22:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 20-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404080
Project: Rowe Industries
Lab ID: 0404080-03A

Client Sample ID: WQ040904:955 NP2-10
Tag Number:
Collection Date: 4/9/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chlorobenzene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Chloroethane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Chloroform	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Chloromethane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Dibromochloromethane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Dibromomethane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Ethylbenzene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Isopropylbenzene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
m,p-Xylene	U	2.0		µg/L	1	4/13/2004 7:22:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Methylene chloride	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Naphthalene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
n-Butylbenzene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
n-Propylbenzene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
o-Xylene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Styrene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Tetrachloroethene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Toluene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Trichloroethene	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Vinyl acetate	U	1.0		µg/L	1	4/13/2004 7:22:00 PM
Vinyl chloride	U	1.0		µg/L	1	4/13/2004 7:22:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 20-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404080
Project: Rowe Industries
Lab ID: 0404080-03B

Client Sample ID: WQ040904:955 NP2-10
Tag Number:
Collection Date: 4/9/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.320	0.0200		mg/L	1	4/14/2004 1:36:26 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: BK
Total Dissolved Solids (Residue, Filterable)	110	1.0		mg/L	1	4/16/2004

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

April 26, 2004

Mark Goldberg
Legette Brashears & Graham Inc.
126 Monroe Turnpike
Trumbull, CT 06611

TEL: (203) 452-3110

FAX (203) 452-3111

RE: Rowe Industries

Order No.: 0404112

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 samples on 4/16/2004 for the analyses presented in the following report.

There were no problems with the analyses and all data for associated QC met EPA or laboratory specifications.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Lori Beyer
Lab Director




American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0404112

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0404112-01A	WQ041404:945 NP2-6		4/14/2004	4/16/2004
0404112-01B	WQ041404:945 NP2-6		4/14/2004	4/16/2004
0404112-01C	WQ041404:945 NP2-6		4/14/2004	4/16/2004
0404112-02A	WQ041404:950 NP2-7		4/14/2004	4/16/2004
0404112-02B	WQ041404:950 NP2-7		4/14/2004	4/16/2004
0404112-02C	WQ041404:950 NP2-7		4/14/2004	4/16/2004
0404112-03A	WQ041404:955 NP2-10		4/14/2004	4/16/2004
0404112-03B	WQ041404:955 NP2-10		4/14/2004	4/16/2004
0404112-03C	WQ041404:955 NP2-10		4/14/2004	4/16/2004



NYSDOH	ELAP	11418
CTDOH	PH-0205	
NJDEP	NY050	
PADEP	68-573	

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.

Project: Rowe Industries

Lab Order: 0404112

CASE NARRATIVE

Samples were analyzed using the methods outlined in the following references:

Test Methods for Evaluating Solid Waste, Physical/Chemical Methods, SW846, 3rd Edition

All method blanks, laboratory spikes, and/or matrix spikes met quality assurance objectives. Acceptable levels of Methylene Chloride was detected in the volatile method blank. Sample results have been qualified, "B" as required. The presence of this compound cannot be attributed to sample matrix constituents.

Lori Beyer

LABORATORY DIRECTOR

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100

FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404112
Project: Rowe Industries
Lab ID: 0404112-01A

Client Sample ID: WQ041404:945 NP2-6
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
1,1,1-Trichloroethane	2.6	1.0		µg/L	1	4/17/2004 2:50:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
1,1-Dichloroethane	1.8	1.0		µg/L	1	4/17/2004 2:50:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
2-Butanone	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
2-Hexanone	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Acetone	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Benzene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Bromobenzene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Bromochloromethane	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Bromodichloromethane	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Bromoform	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Bromomethane	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Carbon disulfide	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Chlorobenzene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Chloroethane	U	1.0		µg/L	1	4/17/2004 2:50:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404112
Project: Rowe Industries
Lab ID: 0404112-01A

Client Sample ID: WQ041404:945 NP2-6
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Chloromethane	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Dibromochloromethane	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Dibromomethane	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Ethylbenzene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Isopropylbenzene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
m,p-Xylene	U	2.0		µg/L	1	4/17/2004 2:50:00 AM
Methyl tert-butyl ether	2.9	1.0		µg/L	1	4/17/2004 2:50:00 AM
Methylene chloride	1.8	1.0	B	µg/L	1	4/17/2004 2:50:00 AM
Naphthalene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
n-Butylbenzene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
n-Propylbenzene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
o-Xylene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Styrene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Tetrachloroethene	38	1.0		µg/L	1	4/17/2004 2:50:00 AM
Toluene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Trichloroethene	1.6	1.0		µg/L	1	4/17/2004 2:50:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Vinyl acetate	U	1.0		µg/L	1	4/17/2004 2:50:00 AM
Vinyl chloride	U	1.0		µg/L	1	4/17/2004 2:50:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ041404:945 NP2-6
Lab Order:	0404112	Tag Number:	
Project:	Rowe Industries	Collection Date:	4/14/2004
Lab ID:	0404112-01B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	7.62	0.0200		mg/L	1	4/19/2004 10:07:11 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404112
Project: Rowe Industries
Lab ID: 0404112-01C

Client Sample ID: WQ041404:945 NP2-6
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.114	0.0200		mg/L	1	4/19/2004 10:01:54 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404112
Project: Rowe Industries
Lab ID: 0404112-02A

Client Sample ID: WQ041404:950 NP2-7
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
1,1,1-Trichloroethane	3.3	1.0		µg/L	1	4/17/2004 3:30:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
1,1-Dichloroethane	2.1	1.0		µg/L	1	4/17/2004 3:30:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
2-Butanone	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
2-Hexanone	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Acetone	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Benzene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Bromobenzene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Bromochloromethane	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Bromodichloromethane	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Bromoform	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Bromomethane	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Carbon disulfide	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Chlorobenzene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Chloroethane	U	1.0		µg/L	1	4/17/2004 3:30:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404112
Project: Rowe Industries
Lab ID: 0404112-02A

Client Sample ID: WQ041404:950 NP2-7
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Chloromethane	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Dibromochloromethane	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Dibromomethane	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Ethylbenzene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Isopropylbenzene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
m,p-Xylene	U	2.0		µg/L	1	4/17/2004 3:30:00 AM
Methyl tert-butyl ether	2.8	1.0		µg/L	1	4/17/2004 3:30:00 AM
Methylene chloride	2.0	1.0	B	µg/L	1	4/17/2004 3:30:00 AM
Naphthalene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
n-Butylbenzene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
n-Propylbenzene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
o-Xylene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Styrene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Tetrachloroethene	42	1.0		µg/L	1	4/17/2004 3:30:00 AM
Toluene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Trichloroethene	1.5	1.0		µg/L	1	4/17/2004 3:30:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Vinyl acetate	U	1.0		µg/L	1	4/17/2004 3:30:00 AM
Vinyl chloride	U	1.0		µg/L	1	4/17/2004 3:30:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404112
Project: Rowe Industries
Lab ID: 0404112-02B

Client Sample ID: WQ041404:950 NP2-7
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	1.40	0.0200		mg/L	1	4/19/2004 10:12:59 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ041404:950 NP2-7
Lab Order:	0404112	Tag Number:	
Project:	Rowe Industries	Collection Date:	4/14/2004
Lab ID:	0404112-02C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.0777	0.0200		mg/L	1	4/19/2004 10:09:57 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brasbears & Graham Inc.
Lab Order: 0404112
Project: Rowe Industries
Lab ID: 0404112-03A

Client Sample ID: WQ041404:955 NP2-10
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
2-Butanone	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
2-Hexanone	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Acetone	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Benzene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Bromobenzene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Bromochloromethane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Bromodichloromethane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Bromoform	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Bromomethane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Carbon disulfide	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Chlorobenzene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Chloroethane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404112
Project: Rowe Industries
Lab ID: 0404112-03A

Client Sample ID: WQ041404:955 NP2-10
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Chloromethane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Dibromochloromethane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Dibromomethane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Ethylbenzene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Isopropylbenzene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
m,p-Xylene	U	2.0		µg/L	1	4/17/2004 4:11:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Methylene chloride	1.9	1.0	B	µg/L	1	4/17/2004 4:11:00 AM
Naphthalene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
n-Butylbenzene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
n-Propylbenzene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
o-Xylene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Styrene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Tetrachloroethene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Toluene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Trichloroethene	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Vinyl acetate	U	1.0		µg/L	1	4/17/2004 4:11:00 AM
Vinyl chloride	U	1.0		µg/L	1	4/17/2004 4:11:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404112
Project: Rowe Industries
Lab ID: 0404112-03B

Client Sample ID: WQ041404:955 NP2-10
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	0.735	0.0200		mg/L	1	4/19/2004 10:28:29 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ041404:955 NP2-10
Lab Order:	0404112	Tag Number:	
Project:	Rowe Industries	Collection Date:	4/14/2004
Lab ID:	0404112-03C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.104	0.0200		mg/L	1	4/19/2004 10:25:52 AM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: IP
Total Dissolved Solids (Residue, Filterable)	94	1.0		mg/L	1	4/20/2004

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

April 26, 2004

Mark Goldberg
Legette Brashears & Graham Inc.
126 Monroe Turnpike
Trumbull, CT 06611

TEL: (203) 452-3110

FAX (203) 452-3111

RE: Rowe Industries

Order No.: 0404111

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 8 samples on 4/16/2004 for the analyses presented in the following report.

There were no problems with the analyses and all data for associated QC met EPA or laboratory specifications.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Lori Beyer
Lab Director



American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0404111

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0404111-01A	GWQ041404:1000 NP1-1-1		4/14/2004	4/16/2004
0404111-01B	GWQ041404:1000 NP1-1-1		4/14/2004	4/16/2004
0404111-01C	GWQ041404:1000 NP1-1-1		4/14/2004	4/16/2004
0404111-02A	GWQ041404:1005 NP1-1-2		4/14/2004	4/16/2004
0404111-02B	GWQ041404:1005 NP1-1-2		4/14/2004	4/16/2004
0404111-02C	GWQ041404:1005 NP1-1-2		4/14/2004	4/16/2004
0404111-03A	GWQ041404:1015 NP1-1-4		4/14/2004	4/16/2004
0404111-03B	GWQ041404:1015 NP1-1-4		4/14/2004	4/16/2004
0404111-03C	GWQ041404:1015 NP1-1-4		4/14/2004	4/16/2004
0404111-04A	GWQ041404:1020 NP1-1-5		4/14/2004	4/16/2004
0404111-04B	GWQ041404:1020 NP1-1-5		4/14/2004	4/16/2004
0404111-04C	GWQ041404:1020 NP1-1-5		4/14/2004	4/16/2004
0404111-05A	GWQ041404:1025 NP1-1-6		4/14/2004	4/16/2004
0404111-05B	GWQ041404:1025 NP1-1-6		4/14/2004	4/16/2004
0404111-05C	GWQ041404:1025 NP1-1-6		4/14/2004	4/16/2004
0404111-06A	GWQ041404:1030 NP1-1-7		4/14/2004	4/16/2004
0404111-06B	GWQ041404:1030 NP1-1-7		4/14/2004	4/16/2004
0404111-06C	GWQ041404:1030 NP1-1-7		4/14/2004	4/16/2004
0404111-07A	GWQ041404:1035 NP1-1-8		4/14/2004	4/16/2004
0404111-07B	GWQ041404:1035 NP1-1-8		4/14/2004	4/16/2004
0404111-07C	GWQ041404:1035 NP1-1-8		4/14/2004	4/16/2004
0404111-08A	GWQ041404:1040 NP1-1-9		4/14/2004	4/16/2004
0404111-08B	GWQ041404:1040 NP1-1-9		4/14/2004	4/16/2004
0404111-08C	GWQ041404:1040 NP1-1-9		4/14/2004	4/16/2004

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0404111

CASE NARRATIVE

Samples were analyzed using the methods outlined in the following references:

Test Methods for Evaluating Solid Waste, Physical/Chemical Methods, SW846, 3rd Edition

All method blanks, laboratory spikes, and/or matrix spikes met quality assurance objectives. Acceptable levels of Methylene Chloride was detected in the volatile method blank. Sample results have been qualified, "B" as required. The presence of this compound cannot be attributed to sample matrix constituents.

Lori Beyer
LABORATORY DIRECTOR

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-01A

Client Sample ID: GWQ041404:1000 NP1-1-1
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
2-Butanone	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
2-Hexanone	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Acetone	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Benzene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Bromobenzene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Bromochloromethane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Bromodichloromethane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Bromoform	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Bromomethane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Carbon disulfide	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Chlorobenzene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Chloroethane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-01A

Client Sample ID: GWQ041404:1000 NP1-1-1
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	2.9	1.0		µg/L	1	4/16/2004 9:41:00 PM
Chloromethane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Dibromochloromethane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Dibromomethane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Ethylbenzene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Isopropylbenzene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
m,p-Xylene	U	2.0		µg/L	1	4/16/2004 9:41:00 PM
Methyl tert-butyl ether	6.1	1.0		µg/L	1	4/16/2004 9:41:00 PM
Methylene chloride	1.8	1.0	B	µg/L	1	4/16/2004 9:41:00 PM
Naphthalene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
n-Butylbenzene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
n-Propylbenzene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
o-Xylene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Styrene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Tetrachloroethene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Toluene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Trichloroethene	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Vinyl acetate	U	1.0		µg/L	1	4/16/2004 9:41:00 PM
Vinyl chloride	U	1.0		µg/L	1	4/16/2004 9:41:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-01B

Client Sample ID: GWQ041404:1000 NP1-1-1
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	0.0241	0.0200		mg/L	1	4/20/2004 12:09:02 PM
Manganese	0.134	0.0200		mg/L	1	4/20/2004 12:09:02 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-01C

Client Sample ID: GWQ041404:1000 NP1-1-1
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	52.7	10.0		mg/L	1	4/20/2004
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	U	0.0200		mg/L	1	4/20/2004 11:49:44 AM
Manganese	0.109	0.0200		mg/L	1	4/20/2004 11:49:44 AM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: IP
Total Dissolved Solids (Residue, Filterable)	160	1.0		mg/L	1	4/20/2004
TURBIDITY		E180.1				Analyst: KK
Turbidity	U	1.00		NTU	1	4/19/2004

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-02A

Client Sample ID: GWQ041404:1005 NP1-1-2
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
2-Butanone	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
2-Hexanone	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Acetone	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Benzene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Bromobenzene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Bromochloromethane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Bromodichloromethane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Bromoform	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Bromomethane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Carbon disulfide	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Chlorobenzene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Chloroethane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-02A

Client Sample ID: GWQ041404:1005 NP1-1-2
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Chloromethane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Dibromochloromethane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Dibromomethane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Ethylbenzene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Isopropylbenzene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
m,p-Xylene	U	2.0		µg/L	1	4/16/2004 10:21:00 PM
Methyl tert-butyl ether	2.8	1.0		µg/L	1	4/16/2004 10:21:00 PM
Methylene chloride	1.8	1.0	B	µg/L	1	4/16/2004 10:21:00 PM
Naphthalene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
n-Butylbenzene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
n-Propylbenzene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
o-Xylene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Styrene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Tetrachloroethene	4.4	1.0		µg/L	1	4/16/2004 10:21:00 PM
Toluene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Trichloroethene	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Vinyl acetate	U	1.0		µg/L	1	4/16/2004 10:21:00 PM
Vinyl chloride	U	1.0		µg/L	1	4/16/2004 10:21:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-02B

Client Sample ID: GWQ041404:1005 NP1-1-2
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	5.59	0.0200		mg/L	1	4/20/2004 12:15:19 PM
Manganese	1.39	0.0200		mg/L	1	4/20/2004 12:15:19 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-02C

Client Sample ID: GWQ041404:1005 NP1-1-2
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	48.1	10.0		mg/L	1	4/20/2004
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	0.224	0.0200		mg/L	1	4/20/2004 11:52:08 AM
Manganese	1.20	0.0200		mg/L	1	4/20/2004 11:52:08 AM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: IP
Total Dissolved Solids (Residue, Filterable)	99	1.0		mg/L	1	4/20/2004
TURBIDITY		E180.1				Analyst: KK
Turbidity	3.80	1.00		NTU	1	4/19/2004

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-03A

Client Sample ID: GWQ041404:1015 NP1-1-4
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
2-Butanone	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
2-Hexanone	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Acetone	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Benzene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Bromobenzene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Bromochloromethane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Bromodichloromethane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Bromoform	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Bromomethane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Carbon disulfide	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Chlorobenzene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Chloroethane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-03A

Client Sample ID: GWQ041404:1015 NP1-1-4
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Chloromethane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Dibromochloromethane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Dibromomethane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Ethylbenzene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Isopropylbenzene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
m,p-Xylene	U	2.0		µg/L	1	4/16/2004 10:59:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Methylene chloride	2.1	1.0	B	µg/L	1	4/16/2004 10:59:00 PM
Naphthalene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
n-Butylbenzene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
n-Propylbenzene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
o-Xylene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Styrene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Tetrachloroethene	22	1.0		µg/L	1	4/16/2004 10:59:00 PM
Toluene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Trichloroethene	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Vinyl acetate	U	1.0		µg/L	1	4/16/2004 10:59:00 PM
Vinyl chloride	U	1.0		µg/L	1	4/16/2004 10:59:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-03B

Client Sample ID: GWQ041404:1015 NP1-1-4
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	0.982	0.0200		mg/L	1	4/20/2004 12:26:13 PM
Manganese	0.132	0.0200		mg/L	1	4/20/2004 12:26:13 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ041404:1015 NP1-1-4
Lab Order:	0404111	Tag Number:	
Project:	Rowe Industries	Collection Date:	4/14/2004
Lab ID:	0404111-03C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	11.6	10.0		mg/L	1	4/20/2004
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	0.173	0.0200		mg/L	1	4/20/2004 11:54:36 AM
Manganese	0.0983	0.0200		mg/L	1	4/20/2004 11:54:36 AM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: IP
Total Dissolved Solids (Residue, Filterable)	4.0	1.0		mg/L	1	4/20/2004
TURBIDITY		E180.1				Analyst: KK
Turbidity	2.70	1.00		NTU	1	4/19/2004

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-04A

Client Sample ID: GWQ041404:1020 NP1-1-5
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
1,1,1-Trichloroethane	1.5	1.0		µg/L	1	4/16/2004 11:38:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
2-Butanone	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
2-Hexanone	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Acetone	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Benzene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Bromobenzene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Bromochloromethane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Bromodichloromethane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Bromoform	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Bromomethane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Carbon disulfide	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Chlorobenzene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Chloroethane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC:

Date: 26-Apr-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ041404:1020 NP1-1-5
Lab Order:	0404111	Tag Number:	
Project:	Rowe Industries	Collection Date:	4/14/2004
Lab ID:	0404111-04A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Chloromethane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Dibromochloromethane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Dibromomethane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Ethylbenzene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Isopropylbenzene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
m,p-Xylene	U	2.0		µg/L	1	4/16/2004 11:38:00 PM
Methyl tert-butyl ether	6.1	1.0		µg/L	1	4/16/2004 11:38:00 PM
Methylene chloride	2.0	1.0	B	µg/L	1	4/16/2004 11:38:00 PM
Naphthalene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
n-Butylbenzene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
n-Propylbenzene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
o-Xylene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Styrene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Tetrachloroethene	18	1.0		µg/L	1	4/16/2004 11:38:00 PM
Toluene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Trichloroethene	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Vinyl acetate	U	1.0		µg/L	1	4/16/2004 11:38:00 PM
Vinyl chloride	U	1.0		µg/L	1	4/16/2004 11:38:00 PM

Qualifiers:
 ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-04B

Client Sample ID: GWQ041404:1020 NP1-1-5
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	0.147	0.0200		mg/L	1	4/20/2004 12:28:27 PM
Manganese	0.014	0.0200	J	mg/L	1	4/20/2004 12:28:27 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-04C

Client Sample ID: GWQ041404:1020 NP1-1-5
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	33.4	10.0		mg/L	1	4/20/2004
DISSOLVED IRON,MANGANESE		E200.7				Analyst: JP
Iron	0.015	0.0200	J	mg/L	1	4/20/2004 11:56:55 AM
Manganese	U	0.0200		mg/L	1	4/20/2004 11:56:55 AM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: IP
Total Dissolved Solids (Residue, Filterable)	110	1.0		mg/L	1	4/20/2004
TURBIDITY		E180.1				Analyst: KK
Turbidity	U	1.00		NTU	1	4/19/2004

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-05A

Client Sample ID: GWQ041404:1025 NP1-1-6
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
1,1,1-Trichloroethane	1.3	1.0		µg/L	1	4/17/2004 12:16:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
2-Butanone	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
2-Hexanone	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Acetone	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Benzene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Bromobenzene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Bromochloromethane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Bromodichloromethane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Bromoform	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Bromomethane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Carbon disulfide	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Chlorobenzene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Chloroethane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-05A

Client Sample ID: GWQ041404:1025 NP1-1-6
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Chloromethane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Dibromochloromethane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Dibromomethane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Ethylbenzene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Isopropylbenzene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
m,p-Xylene	U	2.0		µg/L	1	4/17/2004 12:16:00 AM
Methyl tert-butyl ether	2.6	1.0		µg/L	1	4/17/2004 12:16:00 AM
Methylene chloride	1.8	1.0	B	µg/L	1	4/17/2004 12:16:00 AM
Naphthalene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
n-Butylbenzene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
n-Propylbenzene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
o-Xylene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Styrene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Tetrachloroethene	110	1.0		µg/L	1	4/17/2004 12:16:00 AM
Toluene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Trichloroethene	2.9	1.0		µg/L	1	4/17/2004 12:16:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Vinyl acetate	U	1.0		µg/L	1	4/17/2004 12:16:00 AM
Vinyl chloride	U	1.0		µg/L	1	4/17/2004 12:16:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-05B

Client Sample ID: GWQ041404:1025 NP1-1-6
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	0.016	0.0200	J	mg/L	1	4/20/2004 12:30:46 PM
Manganese	0.354	0.0200		mg/L	1	4/20/2004 12:30:46 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-05C

Client Sample ID: GWQ041404:1025 NP1-1-6
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	35.4	10.0		mg/L	1	4/20/2004
DISSOLVED IRON,MANGANESE		E200.7				Analyst: JP
Iron	U	0.0200		mg/L	1	4/20/2004 11:59:04 AM
Manganese	0.306	0.0200		mg/L	1	4/20/2004 11:59:04 AM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: IP
Total Dissolved Solids (Residue, Filterable)	120	1.0		mg/L	1	4/20/2004
TURBIDITY		E180.1				Analyst: KK
Turbidity	U	1.00		NTU	1	4/19/2004

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-06A

Client Sample ID: GWQ041404:1030 NP1-1-7
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
2-Butanone	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
2-Hexanone	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Acetone	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Benzene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Bromobenzene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Bromochloromethane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Bromodichloromethane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Bromoform	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Bromomethane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Carbon disulfide	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Chlorobenzene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Chloroethane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-06A

Client Sample ID: GWQ041404:1030 NP1-1-7
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Chloromethane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Dibromochloromethane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Dibromomethane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Ethylbenzene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Isopropylbenzene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
m,p-Xylene	U	2.0		µg/L	1	4/17/2004 12:56:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Methylene chloride	2.2	1.0	B	µg/L	1	4/17/2004 12:56:00 AM
Naphthalene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
n-Butylbenzene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
n-Propylbenzene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
o-Xylene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Styrene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Tetrachloroethene	79	1.0		µg/L	1	4/17/2004 12:56:00 AM
Toluene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Trichloroethene	2.5	1.0		µg/L	1	4/17/2004 12:56:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Vinyl acetate	U	1.0		µg/L	1	4/17/2004 12:56:00 AM
Vinyl chloride	U	1.0		µg/L	1	4/17/2004 12:56:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.

Client Sample ID: GWQ041404:1030 NP1-1-7

Lab Order: 0404111

Tag Number:

Project: Rowe Industries

Collection Date: 4/14/2004

Lab ID: 0404111-06B

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	0.020	0.0200	J	mg/L	1	4/20/2004 12:33:02 PM
Manganese	0.0540	0.0200		mg/L	1	4/20/2004 12:33:02 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-06C

Client Sample ID: GWQ041404:1030 NP1-1-7
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	28.8	10.0		mg/L	1	4/20/2004
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	U	0.0200		mg/L	1	4/20/2004 12:01:07 PM
Manganese	0.0468	0.0200		mg/L	1	4/20/2004 12:01:07 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: IP
Total Dissolved Solids (Residue, Filterable)	74	1.0		mg/L	1	4/20/2004
TURBIDITY		E180.1				Analyst: KK
Turbidity	U	1.00		NTU	1	4/19/2004

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-07A

Client Sample ID: GWQ041404:1035 NP1-1-8
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
1,1,1-Trichloroethane	6.2	1.0		µg/L	1	4/17/2004 1:34:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
1,1-Dichloroethane	5.7	1.0		µg/L	1	4/17/2004 1:34:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
2-Butanone	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
2-Hexanone	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Acetone	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Benzene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Bromobenzene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Bromochloromethane	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Bromodichloromethane	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Bromoform	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Bromomethane	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Carbon disulfide	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Chlorobenzene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Chloroethane	U	1.0		µg/L	1	4/17/2004 1:34:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-07A

Client Sample ID: GWQ041404:1035 NP1-1-8
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Chloromethane	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Dibromochloromethane	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Dibromomethane	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Ethylbenzene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Isopropylbenzene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
m,p-Xylene	U	2.0		µg/L	1	4/17/2004 1:34:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Methylene chloride	1.9	1.0	B	µg/L	1	4/17/2004 1:34:00 AM
Naphthalene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
n-Butylbenzene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
n-Propylbenzene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
o-Xylene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Styrene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Tetrachloroethene	14	1.0		µg/L	1	4/17/2004 1:34:00 AM
Toluene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Trichloroethene	2.0	1.0		µg/L	1	4/17/2004 1:34:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Vinyl acetate	U	1.0		µg/L	1	4/17/2004 1:34:00 AM
Vinyl chloride	U	1.0		µg/L	1	4/17/2004 1:34:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-07B

Client Sample ID: GWQ041404:1035 NP1-1-8
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	10.7	0.0200		mg/L	1	4/20/2004 12:35:33 PM
Manganese	0.698	0.0200		mg/L	1	4/20/2004 12:35:33 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ041404:1035 NP1-1-8
Lab Order:	0404111	Tag Number:	
Project:	Rowe Industries	Collection Date:	4/14/2004
Lab ID:	0404111-07C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	25.9	10.0		mg/L	1	4/20/2004
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	0.139	0.0200		mg/L	1	4/20/2004 12:03:22 PM
Manganese	0.580	0.0200		mg/L	1	4/20/2004 12:03:22 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: IP
Total Dissolved Solids (Residue, Filterable)	63	1.0		mg/L	1	4/20/2004
TURBIDITY		E180.1				Analyst: KK
Turbidity	3.10	1.00		NTU	1	4/19/2004

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-08A

Client Sample ID: GWQ041404:1040 NP1-1-9
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
1,1,1-Trichloroethane	10	1.0		µg/L	1	4/17/2004 2:12:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
1,1-Dichloroethane	5.9	1.0		µg/L	1	4/17/2004 2:12:00 AM
1,1-Dichloroethene	2.0	1.0		µg/L	1	4/17/2004 2:12:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
2-Butanone	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
2-Hexanone	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Acetone	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Benzene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Bromobenzene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Bromochloromethane	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Bromodichloromethane	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Bromoforn	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Bromomethane	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Carbon disulfide	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Chlorobenzene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Chloroethane	U	1.0		µg/L	1	4/17/2004 2:12:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-08A

Client Sample ID: GWQ041404:1040 NP1-1-9
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Chloromethane	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Dibromochloromethane	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Dibromomethane	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Ethylbenzene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Isopropylbenzene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
m,p-Xylene	U	2.0		µg/L	1	4/17/2004 2:12:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Methylene chloride	2.0	1.0	B	µg/L	1	4/17/2004 2:12:00 AM
Naphthalene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
n-Butylbenzene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
n-Propylbenzene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
o-Xylene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Styrene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Tetrachloroethene	5.6	1.0		µg/L	1	4/17/2004 2:12:00 AM
Toluene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Trichloroethene	1.7	1.0		µg/L	1	4/17/2004 2:12:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Vinyl acetate	U	1.0		µg/L	1	4/17/2004 2:12:00 AM
Vinyl chloride	U	1.0		µg/L	1	4/17/2004 2:12:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-08B

Client Sample ID: GWQ041404:1040 NP1-1-9
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	2.65	0.0200		mg/L	1	4/20/2004 12:38:03 PM
Manganese	1.14	0.0200		mg/L	1	4/20/2004 12:38:03 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 26-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404111
Project: Rowe Industries
Lab ID: 0404111-08C

Client Sample ID: GWQ041404:1040 NP1-1-9
Tag Number:
Collection Date: 4/14/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	26.8	10.0		mg/L	1	4/20/2004
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	1.22	0.0200		mg/L	1	4/20/2004 12:06:44 PM
Manganese	0.951	0.0200		mg/L	1	4/20/2004 12:06:44 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: IP
Total Dissolved Solids (Residue, Filterable)	62	1.0		mg/L	1	4/20/2004
TURBIDITY		E180.1				Analyst: KK
Turbidity	11.0	1.00		NTU	1	4/19/2004

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

April 28, 2004

Mark Goldberg
Legette Brashears & Graham Inc.
126 Monroe Turnpike
Trumbull, CT 06611

TEL: (203) 452-3110

FAX (203) 452-3111

RE: Rowe Industries

Order No.: 0404164

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 samples on 4/23/2004 for the analyses presented in the following report.

There were no problems with the analyses and all data for associated QC met EPA or laboratory specifications.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Lori Beyer
Lab Director



American Analytical Laboratories, LLC.

Date: 28-Apr-04

CLIENT: Legette Brashears & Graham Inc.**Project:** Rowe Industries**Lab Order:** 0404164**Work Order Sample Summary**

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0404164-01A	WQ042104:1005 NP2-6		4/21/2004	4/23/2004
0404164-01B	WQ042104:1005 NP2-6		4/21/2004	4/23/2004
0404164-01C	WQ042104:1005 NP2-6		4/21/2004	4/23/2004
0404164-02A	WQ042104:1007 NP2-7		4/21/2004	4/23/2004
0404164-02B	WQ042104:1007 NP2-7		4/21/2004	4/23/2004
0404164-02C	WQ042104:1007 NP2-7		4/21/2004	4/23/2004
0404164-03A	WQ042104:1010 NP2-10		4/21/2004	4/23/2004
0404164-03B	WQ042104:1010 NP2-10		4/21/2004	4/23/2004
0404164-03C	WQ042104:1010 NP2-10		4/21/2004	4/23/2004

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 28-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404164
Project: Rowe Industries
Lab ID: 0404164-01A

Client Sample ID: WQ042104:1005 NP2-6
Tag Number:
Collection Date: 4/21/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
1,1,1-Trichloroethane	3.3	1.0		µg/L	1	4/27/2004 1:49:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
2-Butanone	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
2-Hexanone	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Acetone	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Benzene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Bromobenzene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Bromochloromethane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Bromodichloromethane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Bromoform	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Bromomethane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Carbon disulfide	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Chlorobenzene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Chloroethane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 28-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404164
Project: Rowe Industries
Lab ID: 0404164-01A

Client Sample ID: WQ042104:1005 NP2-6
Tag Number:
Collection Date: 4/21/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Chloromethane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Dibromochloromethane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Dibromomethane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Ethylbenzene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Isopropylbenzene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
m,p-Xylene	U	2.0		µg/L	1	4/27/2004 1:49:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Methylene chloride	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Naphthalene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
n-Butylbenzene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
n-Propylbenzene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
o-Xylene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Styrene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Tetrachloroethene	55	1.0		µg/L	1	4/27/2004 1:49:00 AM
Toluene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Trichloroethene	2.3	1.0		µg/L	1	4/27/2004 1:49:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Vinyl acetate	U	1.0		µg/L	1	4/27/2004 1:49:00 AM
Vinyl chloride	U	1.0		µg/L	1	4/27/2004 1:49:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 28-Apr-04

CLIENT: Legette Brashears & Graham Inc.

Client Sample ID: WQ042104:1005 NP2-6

Lab Order: 0404164

Tag Number:

Project: Rowe Industries

Collection Date: 4/21/2004

Lab ID: 0404164-01B

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	2.03	0.0200		mg/L	1	4/26/2004 2:06:26 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 28-Apr-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ042104:1005 NP2-6
Lab Order:	0404164	Tag Number:	
Project:	Rowe Industries	Collection Date:	4/21/2004
Lab ID:	0404164-01C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.109	0.0200		mg/L	1	4/26/2004 2:03:49 PM

Qualifiers:

- ND - Not Detected at the Reporting Limit
- J - Analyte detected below quantitation limits
- B - Analyte detected in the associated Method Blank
- * - Value exceeds Maximum Contaminant Level

- S - Spike Recovery outside accepted recovery limits
- R - RPD outside accepted recovery limits
- E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 28-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404164
Project: Rowe Industries
Lab ID: 0404164-02A

Client Sample ID: WQ042104:1007 NP2-7
Tag Number:
Collection Date: 4/21/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						Analyst: LDS
SW8260B						
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
2-Butanone	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
2-Hexanone	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Acetone	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Benzene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Bromobenzene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Bromochloromethane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Bromodichloromethane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Bromoform	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Bromomethane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Carbon disulfide	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Chlorobenzene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Chloroethane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 28-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404164
Project: Rowe Industries
Lab ID: 0404164-02A

Client Sample ID: WQ042104:1007 NP2-7
Tag Number:
Collection Date: 4/21/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Chloromethane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Dibromochloromethane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Dibromomethane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Ethylbenzene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Isopropylbenzene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
m,p-Xylene	U	2.0		µg/L	1	4/27/2004 2:30:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Methylene chloride	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Naphthalene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
n-Butylbenzene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
n-Propylbenzene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
o-Xylene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Styrene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Tetrachloroethene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Toluene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Trichloroethene	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Vinyl acetate	U	1.0		µg/L	1	4/27/2004 2:30:00 AM
Vinyl chloride	U	1.0		µg/L	1	4/27/2004 2:30:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 28-Apr-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ042104:1007 NP2-7
Lab Order:	0404164	Tag Number:	
Project:	Rowe Industries	Collection Date:	4/21/2004
Lab ID:	0404164-02B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	2.02	0.0200		mg/L	1	4/26/2004 2:16:08 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, LLC.

Date: 28-Apr-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ042104:1007 NP2-7
Lab Order:	0404164	Tag Number:	
Project:	Rowe Industries	Collection Date:	4/21/2004
Lab ID:	0404164-02C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.0750	0.0200		mg/L	1	4/26/2004 2:08:45 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 28-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404164
Project: Rowe Industries
Lab ID: 0404164-03A

Client Sample ID: WQ042104:1010 NP2-10
Tag Number:
Collection Date: 4/21/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
2-Butanone	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
2-Hexanone	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Acetone	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Benzene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Bromobenzene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Bromochloromethane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Bromodichloromethane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Bromoform	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Bromomethane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Carbon disulfide	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Chlorobenzene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Chloroethane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 28-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404164
Project: Rowe Industries
Lab ID: 0404164-03A

Client Sample ID: WQ042104:1010 NP2-10
Tag Number:
Collection Date: 4/21/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Chloromethane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Dibromochloromethane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Dibromomethane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Ethylbenzene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Isopropylbenzene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
m,p-Xylene	U	2.0		µg/L	1	4/27/2004 3:10:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Methylene chloride	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Naphthalene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
n-Butylbenzene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
n-Propylbenzene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
o-Xylene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Styrene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Tetrachloroethene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Toluene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Trichloroethene	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Vinyl acetate	U	1.0		µg/L	1	4/27/2004 3:10:00 AM
Vinyl chloride	U	1.0		µg/L	1	4/27/2004 3:10:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 28-Apr-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0404164
Project: Rowe Industries
Lab ID: 0404164-03B

Client Sample ID: WQ042104:1010 NP2-10
Tag Number:
Collection Date: 4/21/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	0.585	0.0200		mg/L	1	4/26/2004 2:22:13 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 28-Apr-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ042104:1010 NP2-10
Lab Order:	0404164	Tag Number:	
Project:	Rowe Industries	Collection Date:	4/21/2004
Lab ID:	0404164-03C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.231	0.0200		mg/L	1	4/26/2004 2:19:56 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: IP
Total Dissolved Solids (Residue, Filterable)	90	1.0		mg/L	1	4/27/2004

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

May 12, 2004

Mark Goldberg
Legette Brashears & Graham Inc.
126 Monroe Turnpike
Trumbull, CT 06611

TEL: (203) 452-3110
FAX (203) 452-3111

RE: Rowe Industries

Order No.: 0405012

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 4 samples on 5/4/2004 for the analyses presented in the following report.

There were no problems with the analyses and all data for associated QC met EPA or laboratory specifications.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Lori Beyer
Lab Director



American Analytical Laboratories, LLC.

Date: 12-May-04

CLIENT: Legette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0405012

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0405012-01A	WQ042804:1405 NP2-6		4/28/2004	5/4/2004
0405012-01B	WQ042804:1405 NP2-6		4/28/2004	5/4/2004
0405012-02A	WQ042804:1407 NP2-7		4/28/2004	5/4/2004
0405012-02B	WQ042804:1407 NP2-7		4/28/2004	5/4/2004
0405012-02C	WQ042804:1407 NP2-7		4/28/2004	5/4/2004
0405012-03A	WQ042804:1410 NP2-10		4/28/2004	5/4/2004
0405012-03B	WQ042804:1410 NP2-10		4/28/2004	5/4/2004
0405012-03C	WQ042804:1410 NP2-10		4/28/2004	5/4/2004
0405012-04A	GWQ042904:529 NP-1-1-3		4/29/2004	5/4/2004
0405012-04B	GWQ042904:529 NP-1-1-3		4/29/2004	5/4/2004
0405012-04C	GWQ042904:529 NP-1-1-3		4/29/2004	5/4/2004

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100

FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 12-May-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ042804:1405 NP2-6
Lab Order:	0405012	Tag Number:	
Project:	Rowe Industries	Collection Date:	4/28/2004
Lab ID:	0405012-01A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
1,1,1-Trichloroethane	3.4	1.0		µg/L	1	5/5/2004 8:02:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
2-Butanone	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
2-Hexanone	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Acetone	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Benzene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Bromobenzene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Bromochloromethane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Bromodichloromethane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Bromoform	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Bromomethane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Carbon disulfide	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Chlorobenzene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Chloroethane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 12-May-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0405012
Project: Rowe Industries
Lab ID: 0405012-01A

Client Sample ID: WQ042804:1405 NP2-6
Tag Number:
Collection Date: 4/28/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Chloromethane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Dibromochloromethane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Dibromomethane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Ethylbenzene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Isopropylbenzene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
m,p-Xylene	U	2.0		µg/L	1	5/5/2004 8:02:00 AM
Methyl tert-butyl ether	2.1	1.0		µg/L	1	5/5/2004 8:02:00 AM
Methylene chloride	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Naphthalene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
n-Butylbenzene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
n-Propylbenzene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
o-Xylene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Styrene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Tetrachloroethene	51	1.0		µg/L	1	5/5/2004 8:02:00 AM
Toluene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Trichloroethene	3.0	1.0		µg/L	1	5/5/2004 8:02:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Vinyl acetate	U	1.0		µg/L	1	5/5/2004 8:02:00 AM
Vinyl chloride	U	1.0		µg/L	1	5/5/2004 8:02:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 12-May-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0405012
Project: Rowe Industries
Lab ID: 0405012-01B

Client Sample ID: WQ042804:1405 NP2-6
Tag Number:
Collection Date: 4/28/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	6.60	0.0200		mg/L	1	5/5/2004 2:43:25 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 12-May-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0405012
Project: Rowe Industries
Lab ID: 0405012-02A

Client Sample ID: WQ042804:1407 NP2-7
Tag Number:
Collection Date: 4/28/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
2-Butanone	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
2-Hexanone	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Acetone	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Benzene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Bromobenzene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Bromochloromethane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Bromodichloromethane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Bromoform	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Bromomethane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Carbon disulfide	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Chlorobenzene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Chloroethane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 12-May-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0405012
Project: Rowe Industries
Lab ID: 0405012-02A

Client Sample ID: WQ042804:1407 NP2-7
Tag Number:
Collection Date: 4/28/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Chloromethane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Dibromochloromethane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Dibromomethane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Ethylbenzene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Isopropylbenzene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
m,p-Xylene	U	2.0		µg/L	1	5/5/2004 8:40:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Methylene chloride	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Naphthalene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
n-Butylbenzene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
n-Propylbenzene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
o-Xylene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Styrene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Tetrachloroethene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Toluene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Trichloroethene	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Vinyl acetate	U	1.0		µg/L	1	5/5/2004 8:40:00 AM
Vinyl chloride	U	1.0		µg/L	1	5/5/2004 8:40:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 12-May-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0405012
Project: Rowe Industries
Lab ID: 0405012-02B

Client Sample ID: WQ042804:1407 NP2-7
Tag Number:
Collection Date: 4/28/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	4.93	0.0200		mg/L	1	5/5/2004 2:56:40 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 12-May-04

CLIENT: Legette Brashears & Graham Inc.

Client Sample ID: WQ042804:1407 NP2-7

Lab Order: 0405012

Tag Number:

Project: Rowe Industries

Collection Date: 4/28/2004

Lab ID: 0405012-02C

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.144	0.0200		mg/L	1	5/5/2004 2:54:20 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 12-May-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0405012
Project: Rowe Industries
Lab ID: 0405012-03A

Client Sample ID: WQ042804:1410 NP2-10
Tag Number:
Collection Date: 4/28/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
2-Butanone	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
2-Hexanone	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Acetone	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Benzene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Bromobenzene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Bromochloromethane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Bromodichloromethane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Bromoform	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Bromomethane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Carbon disulfide	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Chlorobenzene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Chloroethane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 12-May-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0405012
Project: Rowe Industries
Lab ID: 0405012-03A

Client Sample ID: WQ042804:1410 NP2-10
Tag Number:
Collection Date: 4/28/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Chloromethane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Dibromochloromethane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Dibromomethane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Ethylbenzene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Isopropylbenzene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
m,p-Xylene	U	2.0		µg/L	1	5/5/2004 9:18:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Methylene chloride	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Naphthalene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
n-Butylbenzene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
n-Propylbenzene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
o-Xylene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Styrene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Tetrachloroethene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Toluene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Trichloroethene	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Vinyl acetate	U	1.0		µg/L	1	5/5/2004 9:18:00 AM
Vinyl chloride	U	1.0		µg/L	1	5/5/2004 9:18:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 12-May-04

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ042804:1410 NP2-10
Lab Order:	0405012	Tag Number:	
Project:	Rowe Industries	Collection Date:	4/28/2004
Lab ID:	0405012-03B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	9.88	0.0200		mg/L	1	5/5/2004 3:05:37 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.**Date:** 12-May-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0405012
Project: Rowe Industries
Lab ID: 0405012-03C

Client Sample ID: WQ042804:1410 NP2-10
Tag Number:
Collection Date: 4/28/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.224	0.0200		mg/L	1	5/5/2004 3:00:27 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 12-May-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0405012
Project: Rowe Industries
Lab ID: 0405012-04A

Client Sample ID: GWQ042904:529 NP-1-1-3
Tag Number:
Collection Date: 4/29/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
1,1,1-Trichloroethane	4.4	1.0		µg/L	1	5/5/2004 9:56:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
2-Butanone	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
2-Hexanone	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Acetone	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Benzene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Bromobenzene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Bromochloromethane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Bromodichloromethane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Bromoform	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Bromomethane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Carbon disulfide	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Chlorobenzene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Chloroethane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 12-May-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0405012
Project: Rowe Industries
Lab ID: 0405012-04A

Client Sample ID: GWQ042904:529 NP-1-1-3
Tag Number:
Collection Date: 4/29/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Chloromethane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
cis-1,2-Dichloroethene	1.5	1.0		µg/L	1	5/5/2004 9:56:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Dibromochloromethane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Dibromomethane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Ethylbenzene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Isopropylbenzene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
m,p-Xylene	U	2.0		µg/L	1	5/5/2004 9:56:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Methylene chloride	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Naphthalene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
n-Butylbenzene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
n-Propylbenzene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
o-Xylene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Styrene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Tetrachloroethene	1.3	1.0		µg/L	1	5/5/2004 9:56:00 AM
Toluene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Trichloroethene	8.8	1.0		µg/L	1	5/5/2004 9:56:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Vinyl acetate	U	1.0		µg/L	1	5/5/2004 9:56:00 AM
Vinyl chloride	U	1.0		µg/L	1	5/5/2004 9:56:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 12-May-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0405012
Project: Rowe Industries
Lab ID: 0405012-04B

Client Sample ID: GWQ042904:529 NP-1-1-3
Tag Number:
Collection Date: 4/29/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	39.9	10.0		mg/L	1	5/5/2004
TOTAL IRON,MANGANESE		E200.7				Analyst: JP
Iron	3.07	0.0200		mg/L	1	5/5/2004 2:50:38 PM
Manganese	0.131	0.0200		mg/L	1	5/5/2004 2:50:38 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, LLC.

Date: 12-May-04

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0405012
Project: Rowe Industries
Lab ID: 0405012-04C

Client Sample ID: GWQ042904:529 NP-1-1-3
Tag Number:
Collection Date: 4/29/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	1.32	0.0200		mg/L	1	5/5/2004 3:09:23 PM
Manganese	0.119	0.0200		mg/L	1	5/5/2004 3:09:23 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: IP
Total Dissolved Solids (Residue, Filterable)	97	1.0		mg/L	1	5/6/2004
TURBIDITY		E180.1				Analyst: KK
Turbidity	6.50	1.00		NTU	1	5/5/2004

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

ANALYTICAL REPORT

JOB NUMBER: 206320

Prepared For:

LEGGETTE, BRASHEARS & GRAHAM
126 Monroe Turnpike
Trumbull, CT 06611

Project: ROWE INDUSTRIES

Attention: Paul Jobmann

Date: 04/26/2004

Michele D. Sciongay
Signature

Name: Michele D. Sciongay

Title: Project Manager

E-Mail: msciongay@stl-inc.com

April 26, 2004
Date

STL Connecticut
128 Long Hill Cross Road
Shelton, CT 06484



STL

STL Report : 206320
LEGGETTE, BRASHEARS & GRAHAM

Case Narrative

Sample Receipt – All samples were received in good condition.

Volatile Organics – Air volatile organics were determined by purge and trap GC/MS using guidance provided in Method TO-17. The instrumentation used was a Perkin Elmer ATD 50 interfaced with a Hewlett-Packard Model 5972A GC/MS/DS.

Sample Calculation:

Sample ID- AQ040904:1000 NP4-1
Compound-Tetrachloroethene

$$\frac{(4567720)(25)}{(381156)(.568)} = 527.46 = 530 \text{ ng.}$$

$$\frac{(530\text{NG})(.08206)(298)}{(1\text{L})(166)(1.0\text{ATM})} = 78.1 \text{ nL/L.}$$

Samples AQ040904:1000 NP4-1 and AQ040904:1002 NP4-2 were originally analyzed at sample volumes of 1L with target compounds over the calibration curves. These compounds were flagged with an "A". The samples were re-analyzed at volumes of .4L with results within the calibration curve. Both analyses were reported.

The test results in this report meet all NELAP requirements for parameters for which accreditation is required or available. Any exceptions to NELAP requirements are noted in the case narrative.

Date: 04/26/2004

```
Project Number.....: 20000283
Customer Project ID....: ROWE INDUSTRIES
Project Description....: Rowe Industries
```

Page 1

0000002

STL Connecticut		Form 1	
		Client Sample ID	NP4-1
Method: TO17		Lab Sample ID	206320-1
Sample Volume (L)	1.000	Date Sampled	4/9/2004
Temp (C)	25	Date Analyzed	4/15/2004
		nL/L	
Compound	(ppbv/v) Qualifier	RL	mg/M3 Qualifier RL
Chloromethane	9.7 U	9.7	0.020 U 0.020
Vinyl Chloride	7.8 U	7.8	0.020 U 0.020
Bromomethane	0.8 JB	5.1	0.003 JB 0.020
Chloroethane	7.6 U	7.6	0.020 U 0.020
1,1-Dichloroethene	1.3 J	2.5	0.005 J 0.010
Carbon Disulfide	18.6	3.2	0.058 0.010
Methylene Chloride	1.7 JB	2.9	0.006 JB 0.010
trans-1,2-Dichloroethene	2.5 U	2.5	0.010 U 0.010
1,1-Dichloroethane	3.2	2.5	0.013 0.010
cis-1,2-Dichloroethene	0.8 J	2.5	0.003 J 0.010
Chloroform	2.1 U	2.1	0.010 U 0.010
1,1,1-Trichloroethane	6.1	1.8	0.033 0.010
Carbon Tetrachloride	1.6 U	1.6	0.010 U 0.010
Benzene	1.3 JB	3.1	0.004 JB 0.010
1,2-Dichloroethane	2.5 U	2.5	0.010 U 0.010
Trichloroethene	4.7	1.9	0.025 0.010
1,2-Dichloropropane	2.2 U	2.2	0.010 U 0.010
Bromodichloromethane	1.5 U	1.5	0.010 U 0.010
cis-1,3-Dichloropropene	2.2 U	2.2	0.010 U 0.010
Toluene	9.3	2.7	0.035 0.010
trans-1,3-Dichloropropene	2.2 U	2.2	0.010 U 0.010
1,1,2-Trichloroethane	1.8 U	1.8	0.010 U 0.010
Tetrachloroethene	78.1 A	1.5	0.530 A 0.010
Dibromochloromethane	1.2 U	1.2	0.010 U 0.010
Chlorobenzene	2.2 U	2.2	0.010 U 0.010
Ethylbenzene	0.5 J	2.3	0.002 J 0.010
m&p-Xylenes	0.9 J	2.3	0.004 J 0.010
o-Xylene	0.2 J	2.3	0.001 J 0.010
Styrene	0.7 J	2.4	0.003 J 0.010
Bromoform	1.0 U	1.0	0.010 U 0.010
1,1,2,2-Tetrachloroethane	1.5 U	1.5	0.010 U 0.010

0000003

STL Connecticut		Form 1		
		Client Sample ID	NP4-1DL	
Method: TO17		Lab Sample ID	206320-1DL	
Sample Volume (L)	0.400	Date Sampled	4/9/2004	
Temp (C)	25	Date Analyzed	4/15/2004	
Compound	nL/L (ppbv/v) Qualifier	RL	mg/M3 Qualifier	RL
Chloromethane	24.2 U	24.2	0.050 U	0.050
Vinyl Chloride	19.6 U	19.6	0.050 U	0.050
Bromomethane	1.9 JB	12.9	0.008 JB	0.050
Chloroethane	19.0 U	19.0	0.050 U	0.050
1,1-Dichloroethene	6.3 U	6.3	0.025 U	0.025
Carbon Disulfide	12.9	8.0	0.040	0.025
Methylene Chloride	3.6 JB	7.2	0.013 JB	0.025
trans-1,2-Dichloroethene	6.4 U	6.4	0.025 U	0.025
1,1-Dichloroethane	6.2 U	6.2	0.025 U	0.025
cis-1,2-Dichloroethene	6.4 U	6.4	0.025 U	0.025
Chloroform	5.1 U	5.1	0.025 U	0.025
1,1,1-Trichloroethane	6.0	4.6	0.033	0.025
Carbon Tetrachloride	4.0 U	4.0	0.025 U	0.025
Benzene	1.6 JB	7.8	0.005 JB	0.025
1,2-Dichloroethane	6.2 U	6.2	0.025 U	0.025
Trichloroethene	3.7 J	4.7	0.020 J	0.025
1,2-Dichloropropane	5.4 U	5.4	0.025 U	0.025
Bromodichloromethane	3.7 U	3.7	0.025 U	0.025
cis-1,3-Dichloropropene	5.5 U	5.5	0.025 U	0.025
Toluene	6.0 J	6.6	0.023 J	0.025
trans-1,3-Dichloropropene	5.5 U	5.5	0.025 U	0.025
1,1,2-Trichloroethane	4.6 U	4.6	0.025 U	0.025
Tetrachloroethene	62.6	3.7	0.425	0.025
Dibromochloromethane	2.9 U	2.9	0.025 U	0.025
Chlorobenzene	5.4 U	5.4	0.025 U	0.025
Ethylbenzene	5.8 U	5.8	0.025 U	0.025
m&p-Xylenes	5.77 U	5.8	0.025 U	0.025
o-Xylene	5.8 U	5.8	0.025 U	0.025
Styrene	5.9 U	5.9	0.025 U	0.025
Bromoform	2.4 U	2.4	0.025 U	0.025
1,1,2,2-Tetrachloroethane	3.6 U	3.6	0.025 U	0.025

0000004

STL Connecticut		Form 1		
		Client Sample ID	NP4-2	
Method: TO17		Lab Sample ID	206320-2	
Sample Volume (L)	1.000	Date Sampled	4/9/2004	
Temp (C)	25	Date Analyzed	4/15/2004	
Compound	nL/L (ppbv/v) Qualifier	RL	mg/M3 Qualifier	RL
Chloromethane	9.7 U	9.7	0.020 U	0.020
Vinyl Chloride	7.8 U	7.8	0.020 U	0.020
Bromomethane	1.0 JB	5.1	0.004 JB	0.020
Chloroethane	7.6 U	7.6	0.020 U	0.020
1,1-Dichloroethene	2.0 J	2.5	0.008 J	0.010
Carbon Disulfide	12.5	3.2	0.039	0.010
Methylene Chloride	2.0 JB	2.9	0.007 JB	0.010
trans-1,2-Dichloroethene	2.5 U	2.5	0.010 U	0.010
1,1-Dichloroethane	4.2	2.5	0.017	0.010
cis-1,2-Dichloroethene	1.0 J	2.5	0.004 J	0.010
Chloroform	1.4 J	2.1	0.007 J	0.010
1,1,1-Trichloroethane	7.4	1.8	0.040	0.010
Carbon Tetrachloride	1.6 U	1.6	0.010 U	0.010
Benzene	0.9 JB	3.1	0.003 JB	0.010
1,2-Dichloroethane	2.5 U	2.5	0.010 U	0.010
Trichloroethene	9.9	1.9	0.053	0.010
1,2-Dichloropropane	2.2 U	2.2	0.010 U	0.010
Bromodichloromethane	1.5 U	1.5	0.010 U	0.010
cis-1,3-Dichloropropene	2.2 U	2.2	0.010 U	0.010
Toluene	7.7	2.7	0.029	0.010
trans-1,3-Dichloropropene	2.2 U	2.2	0.010 U	0.010
1,1,2-Trichloroethane	1.8 U	1.8	0.010 U	0.010
Tetrachloroethene	67.8 A	1.5	0.460 A	0.010
Dibromochloromethane	1.2 U	1.2	0.010 U	0.010
Chlorobenzene	2.2 U	2.2	0.010 U	0.010
Ethylbenzene	0.21 J	2.3	0.0009 J	0.010
m&p-Xylenes	0.7 J	2.3	0.003 J	0.010
o-Xylene	0.18 J	2.3	0.0008 J	0.010
Styrene	0.5 J	2.4	0.002 J	0.010
Bromoform	1.0 U	1.0	0.010 U	0.010
1,1,2,2-Tetrachloroethane	1.5 U	1.5	0.010 U	0.010

00000005

STL Connecticut		Form 1		
		Client Sample ID	NP4-2DL	
Method: TO17		Lab Sample ID	206320-2DL	
Sample Volume (L)	0.400	Date Sampled	4/9/2004	
Temp (C)	25	Date Analyzed	4/15/2004	
Compound	nL/L (ppbv/v) Qualifier	RL	mg/M3 Qualifier	RL
Chloromethane	24.2 U	24.2	0.050 U	0.050
Vinyl Chloride	19.6 U	19.6	0.050 U	0.050
Bromomethane	1.9 JB	12.9	0.008 JB	0.050
Chloroethane	19.0 U	19.0	0.050 U	0.050
1,1-Dichloroethene	6.3 U	6.3	0.025 U	0.025
Carbon Disulfide	20.1	8.0	0.063	0.025
Methylene Chloride	2.2 JB	7.2	0.008 JB	0.025
trans-1,2-Dichloroethene	6.4 U	6.4	0.025 U	0.025
1,1-Dichloroethane	5.6	6.2	0.023	0.025
cis-1,2-Dichloroethene	6.4 U	6.4	0.025 U	0.025
Chloroform	5.1 U	5.1	0.025 U	0.025
1,1,1-Trichloroethane	6.0	4.6	0.033	0.025
Carbon Tetrachloride	4.0 U	4.0	0.025 U	0.025
Benzene	1.6 JB	7.8	0.005 JB	0.025
1,2-Dichloroethane	6.2 U	6.2	0.025 U	0.025
Trichloroethene	7.5	4.7	0.040	0.025
1,2-Dichloropropane	5.4 U	5.4	0.025 U	0.025
Bromodichloromethane	3.7 U	3.7	0.025 U	0.025
cis-1,3-Dichloropropene	5.5 U	5.5	0.025 U	0.025
Toluene	8.0	6.6	0.030	0.025
trans-1,3-Dichloropropene	5.5 U	5.5	0.025 U	0.025
1,1,2-Trichloroethane	4.6 U	4.6	0.025 U	0.025
Tetrachloroethene	47.9	3.7	0.325	0.025
Dibromochloromethane	2.9 U	2.9	0.025 U	0.025
Chlorobenzene	5.4 U	5.4	0.025 U	0.025
Ethylbenzene	5.8 U	5.8	0.025 U	0.025
m&p-Xylenes	0.46 J	5.8	0.002 J	0.025
o-Xylene	5.8 U	5.8	0.025 U	0.025
Styrene	5.9 U	5.9	0.025 U	0.025
Bromoform	2.4 U	2.4	0.025 U	0.025
1,1,2,2-Tetrachloroethane	3.6 U	3.6	0.025 U	0.025

00000006

STL Connecticut		Form 1	
		Client Sample ID	NP4-3
Method: TO17		Lab Sample ID	206320-3
Sample Volume (L)	1.000	Date Sampled	4/9/2004
Temp (C)	25	Date Analyzed	4/15/2004
		nL/L	
Compound	(ppbv/v) Qualifier	RL	mg/M3 Qualifier RL
Chloromethane	9.7 U	9.7	0.020 U 0.020
Vinyl Chloride	7.8 U	7.8	0.020 U 0.020
Bromomethane	3.6 JB	5.1	0.014 JB 0.020
Chloroethane	7.6 U	7.6	0.020 U 0.020
1,1-Dichloroethene	1.5 J	2.5	0.006 J 0.010
Carbon Disulfide	15.4	3.2	0.048 0.010
Methylene Chloride	2.6 JB	2.9	0.009 JB 0.010
trans-1,2-Dichloroethene	2.5 U	2.5	0.010 U 0.010
1,1-Dichloroethane	3.2	2.5	0.013 0.010
cis-1,2-Dichloroethene	1.0 J	2.5	0.004 J 0.010
Chloroform	2.1 U	2.1	0.010 U 0.010
1,1,1-Trichloroethane	5.1	1.8	0.028 0.010
Carbon Tetrachloride	1.6 U	1.6	0.010 U 0.010
Benzene	0.9 JB	3.1	0.003 JB 0.010
1,2-Dichloroethane	2.5 U	2.5	0.010 U 0.010
Trichloroethene	1.9 U	1.9	0.010 U 0.010
1,2-Dichloropropane	2.2 U	2.2	0.010 U 0.010
Bromodichloromethane	1.5 U	1.5	0.010 U 0.010
cis-1,3-Dichloropropene	2.2 U	2.2	0.010 U 0.010
Toluene	9.8	2.7	0.037 0.010
trans-1,3-Dichloropropene	2.2 U	2.2	0.010 U 0.010
1,1,2-Trichloroethane	1.8 U	1.8	0.010 U 0.010
Tetrachloroethene	0.6 J	1.5	0.004 J 0.010
Dibromochloromethane	1.2 U	1.2	0.010 U 0.010
Chlorobenzene	2.2 U	2.2	0.010 U 0.010
Ethylbenzene	0.2 J	2.3	0.001 J 0.010
m&p-Xylenes	0.9 J	2.3	0.004 J 0.010
o-Xylene	0.2 J	2.3	0.001 J 0.010
Styrene	0.7 J	2.4	0.003 J 0.010
Bromoform	1.0 U	1.0	0.010 U 0.010
1,1,2,2-Tetrachloroethane	1.5 U	1.5	0.010 U 0.010

0000007

L A B O R A T O R Y C H R O N I C L E

Job Number: 206320

Date: 04/26/2004

CUSTOMER: LEGGETTE, BRASHEARS & GRAHAM

PROJECT: ROWE INDUSTRIES

ATTN: Paul Jobmann

Lab ID: 206320-1 Client ID: AQ040904:1000 NP4-1

Date Recvd: 04/13/2004 Sample Date: 04/09/2004

METHOD	DESCRIPTION	RUN#	BATCH#	PREP BT	#(S)	DATE/TIME ANALYZED	DILUTION
T017	Volatile Organics (Air)	1	31451				
T017	Volatile Organics (Air)	1	31451			0000	
T017	Volatile Organics (Air)	2	31451				
T017	Volatile Organics (Air)	2	31451			0000	

Lab ID: 206320-2 Client ID: AQ040904:1002 NP4-2

Date Recvd: 04/13/2004 Sample Date: 04/09/2004

METHOD	DESCRIPTION	RUN#	BATCH#	PREP BT	#(S)	DATE/TIME ANALYZED	DILUTION
T017	Volatile Organics (Air)	1	31451				
T017	Volatile Organics (Air)	1	31451				
T017	Volatile Organics (Air)	2	31451				
T017	Volatile Organics (Air)	2	31451				

Lab ID: 206320-3 Client ID: AQ040904:1005 NP4-3

Date Recvd: 04/13/2004 Sample Date: 04/09/2004

METHOD	DESCRIPTION	RUN#	BATCH#	PREP BT	#(S)	DATE/TIME ANALYZED	DILUTION
T017	Volatile Organics (Air)	1	31451				

00000008

QUALITY ASSURANCE METHODS

REFERENCES AND NOTES

Report Date: 04/26/2004

REPORT COMMENTS

- 1) All pages of this report are integral parts of the analytical data. Therefore, this report should be reproduced only in its entirety.
- 2) Soil, sediment and sludge sample results are reported on a "dry weight" basis except when analyzed for landfill disposal or incineration parameters. All other solid matrix samples are reported on an "as received" basis unless noted differently.
- 3) Reporting limits are adjusted for sample size used, dilutions and moisture content if applicable.
- 4) The test results for the noted analytical method(s) meet the requirements of NELAC. Lab Cert. ID# 10604
- 5) According to 40CFR Part 136.3, pH, Chlorine Residual and Dissolved Oxygen analyses are to be performed immediately after aqueous sample collection. When these parameters are not indicated as field (e.g. pH field) they were not analyzed immediately, but as soon as possible on laboratory receipt.

Glossary of flags, qualifiers and abbreviation

Inorganic Qualifiers (Q-Column)

- U Analyte was not detected at or above the reporting limit.
- < Not detected at or above the reporting limit.
- J Result is less than the RL, but greater than or equal to the method detection limit.
- B Result is less than the CRDL/RL, but greater than or equal to the IDL/MDL.
- S Result was determined by the Method of Standard Additions.

Inorganic Flags (Flag Column)

- ICV,CCV,ICB,CCB,ISA,ISB,CRI,CRA,MRL: Instrument related QC exceed the upper or lower control limits.
- * LCS, LCD, MD: Batch QC exceeds the upper or lower control limits.
- + MSA correlation coefficient is less than 0.995.
- 4 MS, MSD: The analyte present in the original sample is 4 times greater than the matrix spike concentration; therefore, control limits are not applicable.
- E SD: Serial dilution exceeds the control limits.
- H MB, EB: Batch QC is greater than reporting limit or had a negative instrument reading lower than the absolute value of the reporting limit.
- N MS, MSD: Spike recovery exceeds the upper or lower control limits.
- W PS: Post-digestion spike was outside 85-115% control limits.

Organic Qualifiers (Q - Column)

- U Analyte was not detected at or above the reporting limit.
- ND Compound not detected.
- J Result is an estimated value below the reporting limit or a tentatively identified compound (TIC).
- Q Result was qualitatively confirmed, but not quantified.
- C Pesticide identification was confirmed by GC/MS.
- Y The chromatographic response resembles a typical fuel pattern.
- Z The chromatographic response does not resemble a typical fuel pattern.
- E Result exceeded calibration range, secondary dilution required.

Organic Flags (Flags Column)

- MB,EB, MLE: Batch QC is greater than reporting limit.
- * LCS, LCD, CCV, MS, MSD, Surrogate, RS:Batch QC exceeds the upper or lower control limits.
- A Concentration exceeds the instrument calibration range or below the reporting limit.
- B Compound was found in the blank and sample.
- D Surrogate or matrix spike recoveries were not obtained because the extract was diluted for analysis; also compounds analyzed at a dilution will be flagged with a D.
- H Alternate peak selection upon analytical review
- I Indicates the presence of an interference, recovery is not calculated.
- M Manually integrated compound.
- P The lower of the two values is reported when the % difference between the results of two GC columns is greater than 25%.

QUALITY ASSURANCE METHODS

REFERENCES AND NOTES

Report Date: 04/26/2004

Abbreviations

Batch	Designation given to identify a specific extraction, digestion, preparation set, or analysis set
CAP	Capillary Column
CCB	Continuing Calibration Blank
CCV	Continuing Calibration Verification
CF	Confirmation Analysis
CRA	Low Level Standard Check - GFAA; Mercury
CRI	Low Level Standard Check - ICP
Dil Fac	Dilution Factor
DL	Secondary dilution and analysis
DLFac	Detection Limit Factor
DSH	Distilled Standard - High Level
DSL	Distilled Standard - Low Level
DSM	Distilled Standard - Medium Level
EB	Extraction Blank
ICB	Initial Calibration Blank
ICV	Initial Calibration Verification
IDL	Instrument Detection Limit
ISA	Interference Check Sample A
ISB	Interference Check Sample B
Job No.	The first six digits of the sample ID which refers to a specific client, project and sample group
Lab ID	An 8 number unique laboratory identification
LCD	Laboratory Control Standard Duplicate
LCS	Laboratory Control Standard with reagent grade water or a matrix free from the analyte of interest
MB	Method Blank or (PB) Preparation Blank
MD	Method Duplicate
MDL	Method Detection Limit
MLE	Medium Level Extraction Blank
MRL	Method Reporting Limit Standard
MSA	Method of Standard Additions
MS	Matrix Spike
MSD	Matrix Spike Duplicate
ND	Not Detected
PACK	Packed Column
PREPF	Preparation factor used by the Laboratory's Information Management System (LIMS)
PS	Post Spike
PSD	Post Spike Duplicate
RA	Re-analysis
RE	Re-extraction and analysis
RL	Reporting Limit
RPD	Relative Percent Difference of duplicate (unrounded) analyses
RRF	Relative Response Factor
RS	Reference Standard
RT	Retention Time
RTW	Retention Time Window
SampleID	A 9 digit number unique for each sample, the first six digits are referred as the job number
SCB	Seeded Control Blank
SD	Serial Dilution
UCB	Unseeded Control Blank

One or a combination of these data qualifiers and abbreviations may appear in the analytical report.

STL-Connecticut

Certification Summary (as of January 2004)

The laboratory identification numbers for the STL-Connecticut laboratory are provided in the following table. Many states certify laboratories for specific parameters or tests within a category (i.e. method 325.2 for wastewater). The information in the following table indicates the lab is certified in a general category of testing such as drinking water or wastewater analysis. The laboratory should be contacted directly if parameter-specific certification information is required.

State	Responsible Agency	Certification	Expiration Date	Lab Number
Connecticut	Department of Health Services	Drinking Water, Wastewater	12/31/04	PH-0497
Maine	Department of Health and Environmental Services	Drinking Water, Wastewater/Solid, Hazardous Waste	04/18/04	CT023
Massachusetts	Department of Environmental Protection	Potable/Non-Potable Water	06/30/04	CT023
New Hampshire	Department of Environmental Services	Drinking Water, Wastewater	08/29/04	2528
New Jersey	Department of Environmental Protection	Drinking Water, Wastewater	06/30/04	46410
New York	Department of Health	CLP, Drinking Water, Wastewater, Solid/ Hazardous Waste NELAC	04/01/04	10602
Rhode Island	Department of Health	Chemistry...Non- Potable Water and Wastewater	12/30/04	A43
Utah	Department of Health	RCRA	05/31/04	2032614458

0000011