

LEGGETTE, BRASHEARS & GRAHAM, INC.

PROFESSIONAL GROUND-WATER AND ENVIRONMENTAL ENGINEERING SERVICES

126 MONROE TURNPIKE
TRUMBULL, CT 06611
203-452-3100
FAX 203-452-3111
www.lbgweb.com

January 31, 2005

FEB - 1 2005

Mr. Jeffery Trad
Project Manager
New York State Department of Environmental Conservation
Division of Environmental Remediation, Construction Services
625 Broadway, 12th floor
Albany, NY 12233-7013

RE: November 2004 Status Report
Ground-Water Remedial Action
Rowe Industries Superfund Site
Sag Harbor, New York


Dear Mr. Trad:

The enclosed letter report details the operation status of the full-scale ground-water pump and treat system at the above referenced site. LBG has enclosed an additional copy of the report to be forwarded to the Chief of the Operation Maintenance and Support Section.

Should you or the Operation Maintenance and Support Section have any questions, please feel free to contact myself, Paul Jobmann, or Al Kovalik at (203) 452-3100.

Very truly yours,

LEGGETTE, BRASHEARS & GRAHAM, INC.



Mark M. Goldberg, P.E.
Senior Environmental Engineer

MG:ng

Enclosures

H:\NABIS\2004\Monthly reports\November 2004\trad_Nov 2004_report.doc

-DRAFT-

PROJECT STATUS MEMORANDUM

NO. 11-04

TO: Pamela Tames, USEPA

FROM: Mark M. Goldberg, P.E.
Alfred N. Kovalik, P.E.

DATE: January 31, 2005

PROJECT: Rowe Industries Superfund Site
Ground-Water Recovery and Treatment System
November 2004 Status Report
Sag Harbor, New York

LBG Engineering Services, P.C. (LBG) commenced operation of the ground-water remediation system at the above-referenced site on December 17, 2002. This status report presents a summary of system performance, operation and maintenance, and monitoring activities for the site from November 1, 2004 through November 30, 2004. The report includes a summary of system performance parameters, system operation parameters, analytical results for ground-water, system effluent samples, and air quality results.

SUMMARY OF SYSTEM PERFORMANCE AND OPERATION

(November 1, 2004 through November 30, 2004)

- | | |
|---|-----------------------------------|
| 1. Hours of operation during the reporting period: | 582 hours (81%) |
| 2. Alarm conditions during the reporting period: | See Table 1 |
| 3. Was the SPDES VOC discharge permit criteria achieved: | yes, (Table 2) |
| 4. Total volume of water pumped during the reporting period: | 8,127,720 gal. |
| 5. Was the system effluent flow below the SPDES limit of 1,023,000 gpd: | yes, (Graph 1) |
| 6. Mass of VOCs recovered during the reporting period: | 1.9 pounds |
| 7. Cumulative mass of VOCs recovered since startup on 12/17/02:
(calculations can be provided upon request) | 149.1 pounds |
| 8. Effluent VOC vapor concentration for the reporting period: | 0.110 mg/m ³ (Table 3) |
| 9. Was the effluent VOC vapor emission rate below 0.022 lbs/hr.:
(calculations can be provided upon request) | yes (0.00101 lbs/hr) |

GROUND-WATER RECOVERY SYSTEM STATUS SUMMARY

The following table summarizes select recovery well parameters for the reporting period. Table 4 presents a summary of the quality results for water samples collected from recovery wells. Graph 2 presents PCE concentrations for each recovery well. For wells with water quality that meets or is approaching remedial criteria, Graph 3 presents PCE concentrations at an expanded scale in order to compare them to the PCE aquifer restoration concentration of 5 ug/L. Laboratory analytical reports are included as Appendix I.

Well	Volume Pumped (gal)	Average Flow (gpm)	Minimum Design Flow Required for Plume Capture (gpm)	Total VOC Concentration (µg/L)	VOC Recovery (lbs)
RW-1	226,126	16.0	26	3.9	0.01
RW-2	452,253	27.0	26	11.0	0.04
RW-3	226,126	18.7	23	10.6	0.02
RW-4*	1,396,880	40.0	13	145.2	1.69
RW-5	2,030,615	55.0	42	23.6	0.40
RW-6	1,015,351	29.9	28	101	0.86
RW-7	2,023,720	69.9	54	36	0.61
RW-8	1,631,321	50.0	46	12.8	0.17
RW-9	1,014,932	31.0	68	9.1	0.08

*Estimated volume and flow due to sensor power supply malfunction. RW-4 control modification is scheduled for December 7-9.

Recovery wells RW-1, RW-3 and RW-9 had average flows below the minimum design flow required to capture the plume. Below grade pipe cleaning and vault pipe cleaning have been completed on several occasions and the flow has not returned to historical rates in these recovery wells. To increase the flow in RW-1 and RW-3, LBG has investigated the viability of increasing the motor and pump sizes. Larger motors would require new drives and filters. Based on the low concentrations of contaminants being extracted from these wells, the incremental benefit (i.e. mass removed) is minimal and, therefore, is not being pursued further. Impacted groundwater not captured by the on-site recovery wells will be captured by downgradient off-site recovery wells. Flow below the minimum design flow at RW-9 is believed to be caused by iron build-up in a section of pipe between RW-9 and a clean-out port located between RW-8 and RW-9. An attempt was made to construct a mechanical device to help the water jet negotiate the pipe bends, however, the initial tests to direct the water jet were not successful. LBG will install a new clean-out port between RW-8 and RW-9 (near the intersection of Brick Kiln Road and Noyac Road). The clean-out port will be angled in the upstream direction (towards RW-9) to allow the high-pressure water jets to access and clean this section of the piping. LBG also investigated the viability of "pigging" this section of the discharge pipe; an action that will only be considered further if the new clean-out port does not restore flow in RW-9 to historic rates (90 to 100 gpm).

The effluent pH values are below the State Pollutant Discharge Elimination System (SPDES) Applicable or Relevant and Appropriate Requirements (ARARs) of 6.5 on a routine basis. pH readings of water samples from the recovery wells are observed to be in the range of approximately 5.8 to 6.5, which is the background pH for the groundwater in this area.

BAG FILTER STATUS

The following table presents an operational summary of the bag filter usage and configuration for the reporting period.

Dates	Bank 1	Bank 2	Bank 3
Nov. 1 to Nov. 3	7 of 8 housings used with 200 micron bag filters	7 of 8 housings used with 200 micron bag filters	Not active
Nov. 3 to Nov. 9	7 of 8 housings used with 200 micron bag filters	7 of 8 housings used with 400 micron bag filters	Not active
Nov. 9 to Nov 30	7 of 8 housings used with 400 micron bag filters	7 of 8 housings used with 400 micron bag filters	Not active

No modifications were made to the filter bank configuration or operation during this reporting period.

OTHER O&M MODIFICATIONS AND FUTURE O&M ACTIVITIES

- On November 15, 2004, injection of the EHCTM product began in the former drum storage area (FDSA). RW-1, RW-2 and RW-3 were shut off to allow water levels to rise in the FDSA, which allowed the EHCTM product to impact more of the subsurface. In addition, these recovery wells were shut off to minimize groundwater flow out of the FDSA. On November 22, 2004, the injection process was completed. A letter report summarizing the events of the injection activities will be provided under separate cover.
- On November 20, 2004, the repaired and recalibrated air stripper blower (ASB) air flow meter was installed. The new readings show the air flow to be approximately 2,000 to 2,100 cfm. The booster blower (BB) air flow meter was removed from the system and sent to the manufacturer for recalibration.
- On November 20, 2004, malfunctioning wellhead pressure sensors at RW-1 and RW-8 were replaced with new sensors.
- On November 20, 2004, a blown fuse was replaced at the RW-9 control panel.
- On November 23, 2004, recharge basin rehabilitation was completed for both basins.

Future O&M activities scheduled for the fall of 2004 and the winter of 2005 include:

- Decommission select monitor wells (MW), soil vapor extraction (SVE) wells, sparge points (SP) and vapor monitoring points (VP) in the FDSA in December;
- Re-calibrate the booster blower air flow meter;
- Move the RW-4 control panel to an above-grade position; and,
- Install a new clean-out port between RW-8 and RW-9.

cc: Terry Gerrish, CH2M Hill
Mark Lucas, CH2M Hill
Phil McAndrew, Kraft Foods, N.A. – .pdf
Lisa Krogman, Kraft Foods, N.A. (Environ) – .pdf
Jeff Trad, NYSDEC
Chief-Operation Maintenance and Support Section
Robert Schneck, RWE, R-1, NYSDEC
David Gilmartin, Jr., Esq., Town of Southampton

MMG:ng

Attachments

H:\NABIS\2004\Monthly reports\November 2004\Status Nov 04.doc

TABLES

TABLE 1
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

MAINTENANCE LOG
(November 1, 2004 through November 30, 2004)

Date	Time	System Changes/Modifications	Personnel
11/3/2004		Changed multi-bag filter bags 200 um in bank 1 and 400 um in bank 2; seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	MG
11/9/2004		Changed multi-bag filter bags (400 um) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	MG
11/11/2004	6:54 PM	Communication Failure Alarm.	
11/15/2004		Injection of EHC product in the FDSA began.	TS, MG, ETL, Adventus
	3:25 PM	Reset the communication failure alarm and restarted the system. RW-1, RW-2 and RW-3 will remain off during injection activities to minimize groundwater flow away from the injection area.	MG
		Updated static depth to water levels in recovery wells.	MG
11/17/2004	8:19 PM	ASB Low Pressure Alarm	
11/18/2004	11:12 AM	Replaced broken ASB belt; reset the alarm and restarted the system	MG
11/19/2004	12:12 PM	Turned off recovery well pumps for recharge basin cleaning.	PJ
	4:00 PM	Switched discharge flow from primary basin to secondary basin.	MG
		Replaced wellhead pressure sensors for RW-1 and RW-8.	PJ
		Blown fuses were observed in the RW-1 and RW-9 control panels.	
		Changed multi-bag filter bags (400 um) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	PJ
11/20/2004	12:20 PM	Replaced fuse in RW-9 and restarted the system (offsite wells only).	PJ
11/22/2004		Injection activities in the FDSA are completed	TS, ETL, Adventus
11/23/2004	8:19 AM	Turned recovery wells off for routine O&M.	TS
		Basin rehabilitation was completed for both discharge basins.	ETL, TS
		Changed multi-bag filter bags (400 um) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	TS
	2:45 PM	Restarted the system (offsite wells only).	TS

TABLE 2

**GROUND-WATER REMEDIAL ACTION
 ROWE INDUSTRIES SUPERFUND SITE
 SAG HARBOR, NEW YORK**

EFFLUENT WATER QUALITY RESULTS

Date Sampled	pH ^v	TDS (mg/L)	PCE (ug/L)	1,1,1-TCA (ug/L)	TCE (ug/L)	1,1-DCA (ug/L)	1,1-DCE (ug/L)	1,2-DCE (ug/L)	Xylene (ug/L)	Bromoform (ug/L)	Dibromo- chloromethane (ug/L)	Methylene Chloride (ug/L)	Freon 113 (ug/L)	Naph- thalene (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)
SPDES Limits	6.5 to 8.5	—	1	5	5	5	5	5	5	—	—	5	—	10	7	—	—	—
3-Nov-04	5.3	88	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	1.02	0.186
9-Nov-04	5.3	110	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	3.65	0.108
16-Nov-04	5.3	100	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	1.6	0.107
23-Nov-04	5.3	84	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	0.817	0.111

SPDES: State Pollutant Discharge Elimination System

mg/L: Milligrams per liter

ug/L: Micrograms per liter

—: Not established

NM: Not Measured

TDS: Total dissolved solids

PCE: Tetrachloroethylene

TCE: Trichloroethene

1,1-DCA: 1,1-Dichloroethane

1,1-DCE: 1,1-Dichloroethene

1,2-DCE: 1,2-Dichloroethene

MTBE: Methyl tert-butyl ether

Notes:

1. pH was measured using litmus paper. Influent pH values from recovery wells are below 6.5 on a regular basis.
2. "Discharge" samples were collected from sample port labeled NP2-10.

TABLE 3

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

CARBON UNIT SYSTEM AIR QUALITY RESULTS

Precarbon			Parameters (mg/m3)																				TOTAL VOCs
Sample Name	Date	Time	PCE	TCE	TCA	DCE	DCA	cis-DCE	Toluene	Benzene	m&p-Xylenes	o-Xylene	Styrene	CF	MC	CM	CD	BM	CB	EB	VC	CT	
AQ110703:128NP4-1	11/7/2003	13:28	0.367	0.187	0.213	0.027	ND	0.013	0.21	0.013	0.01	ND	ND	0.043	0.567	ND	0.233	0.11	ND	ND	ND	ND	
AQ011404:910NP4-1	1/14/2004	9:10	0.75	0.02	ND	ND	ND	ND	0.025	ND	ND	ND	ND	ND	0.055	ND	ND	0.285	ND	ND	ND	ND	
AQ020504:924NP4-1	2/5/2004	9:24	1.12	0.052	0.052	ND	ND	ND	0.036	0.004	0.002	ND	ND	0.01	0.062	ND	0.07	0.022	ND	ND	ND	ND	
AQ030304:910NP4-1	3/3/2004	9:10	0.48	0.02	ND	ND	ND	ND	0.014	0.004	ND	ND	ND	ND	0.01	ND	ND	0.068	ND	ND	ND	ND	
AQ040804:1000NP4-1	4/8/2004	10:00	0.425	0.02	0.033	ND	ND	ND	0.023	0.005	ND	ND	ND	ND	0.013	ND	0.04	0.008	ND	ND	ND	ND	
AQ050504:1355NP4-1	5/5/2005	13:55	0.375	0.023	0.035	ND	ND	ND	0.015	0.005	0.0023	ND	ND	0.005	0.08	ND	0.04	0.063	ND	ND	ND	ND	
AQ060204:1200NP4-1	6/2/2004	12:00	0.28	0.013	0.017	ND	ND	ND	0.027	0.005	0.012	0.007	0.002	0.007	0.023	0.005	0.058	0.12	ND	0.004	ND	ND	
AQ070704:1415NP4-1	7/7/2004	14:15	0.86	0.03	0.12	ND	ND	ND	0.02	0.02	ND	ND	ND	0.009	0.05	ND	0.08	0.07	ND	ND	ND	ND	
AQ080404:1330NP4-1	8/4/2004	13:30	1.3	0.089	0.22	0.012	0.016	0.007	0.031	0.004	0.003	0.001	0.004	0.013	0.044	0.005	0.076	0.067	ND	0.001	ND	ND	
AQ080204:1431NP4-1	9/2/2004	14:31	0.83	0.054	0.13	0.009	0.013	0.004	0.028	0.008	0.004	0.001	0.003	0.01	0.073	0.003	0.076	0.04	ND	0.001	ND	ND	
AQ100704:1210NP4-1	10/7/2004	12:10	0.4	0.035	0.058	0.005	0.005	0.003	0.036	0.008	0.003	0.001	0.002	0.008	0.05	ND	0.045	0.06	ND	0.001	ND	ND	
AQ110304:945NP4-1	11/3/2004	9:45	0.44	0.032	0.074	0.01	0.022	0.004	0.02	0.008	0.0018	ND	0.0012	0.006	0.1	0.006	0.02	0.152	ND	ND	ND	ND	

Midcarbon			Parameters (mg/m3)																				TOTAL VOCs
Sample Name	Date	Time	PCE	TCE	TCA	DCE	DCA	cis-DCE	Toluene	Benzene	m&p-Xylenes	o-Xylene	Styrene	CF	MC	CM	CD	BM	CB	EB	VC	CT	
AQ011404:912NP4-2	1/14/2004	9:12	0.5	0.083	ND	ND	ND	ND	0.03	ND	ND	ND	ND	ND	0.053	ND	ND	0.09	ND	ND	ND	ND	
AQ020504:926NP4-2	2/5/2004	9:26	1.1	0.180	0.061	0.011	0.026	0.005	0.048	0.004	0.008	ND	ND	0.013	0.047	ND	0.045	0.015	ND	ND	ND	ND	
AQ030304:912NP4-2	3/3/2004	9:12	0.41	0.057	0.024	ND	ND	ND	0.009	0.002	ND	ND	ND	0.008	0.007	ND	ND	0.005	ND	ND	ND	ND	
AQ040804:1002NP4-2	4/8/2004	10:02	0.325	0.040	0.033	ND	0.023	ND	0.03	0.005	0.002	ND	ND	ND	0.008	ND	0.083	0.008	ND	ND	ND	ND	
AQ050504:1357NP4-2	5/5/2005	13:57	0.25	0.033	0.035	ND	ND	ND	0.02	0.005	0.003	ND	ND	0.008	0.055	ND	0.063	0.083	ND	0.003	ND	ND	
AQ060204:1202NP4-2	6/2/2004	12:02	0.012	0.002	ND	ND	ND	ND	0.02	0.003	0.002	0.0008	0.001	ND	0.021	0.003	0.041	0.057	ND	0.0008	ND	ND	
AQ070704:1420NP4-2	7/7/2004	14:20	0.013	0.002	ND	ND	ND	ND	0.032	0.004	0.003	0.0009	0.003	ND	0.058	0.004	0.097	0.027	ND	0.001	ND	ND	
AQ080404:1335NP4-2	8/4/2004	13:35	0.048	0.002	ND	0.005	ND	ND	0.031	0.002	0.003	0.001	0.003	ND	0.063	0.004	0.078	0.071	ND	0.001	ND	ND	
AQ080204:1432NP4-2	9/2/2004	14:32	0.014	0.002	ND	0.005	ND	ND	0.059	0.005	0.005	0.001	0.003	ND	0.068	0.003	0.088	0.025	ND	0.002	ND	ND	
AQ100704:1212NP4-2	10/7/2004	12:12	0.021	0.001	ND	0.006	0.01	ND	0.018	0.007	0.003	0.001	0.002	0.002	0.011	ND	0.036	0.057	ND	0.001	ND	ND	
AQ110304:947NP4-2	11/3/2004	9:47	0.015	ND	ND	0.007	0.014	ND	0.022	0.005	0.002	0.0004	0.002	ND	0.034	0.005	0.018	0.026	ND	0.0004	ND	ND	

Postcarbon			Parameters (mg/m3)																				TOTAL VOCs
Sample Name	Date	Time	PCE	TCE	TCA	DCE	DCA	cis-DCE	Toluene	Benzene	m&p-Xylenes	o-Xylene	Styrene	CF	MC	CM	CD	BM	CB	EB	VC	CT	
AQ110703:132NP4-3	11/7/2003	13:32	0.015	0.005	0.089	0.009	0.029	0.005	0.055	0.006	0.004	ND	ND	0.016	0.24	ND	0.068	0.044	ND	ND	ND	ND	
AQ011404:914NP4-3	1/14/2004	9:14	ND	ND	0.1	ND	0.022	ND	0.015	ND	ND	ND	ND	0.012	0.037	ND	ND	0.01	ND	ND	ND	0.012	
AQ020504:928NP4-3	2/5/2004	9:28	0.017	0.019	0.093	0.012	0.024	0.01	0.04	0.004	0.005	ND	ND	0.017	0.048	ND	0.055	0.015	ND	ND	ND	ND	
AQ030304:914NP4-3	3/3/2004	9:14	ND	0.002	0.034	ND	ND	ND	0.011	0.002	ND	ND	ND	0.008	0.008	ND	0.019	0.007	ND	ND	ND	ND	
AQ040804:1005NP4-3	4/8/2004	10:05	0.004	ND	0.028	0.008	0.013	0.004	0.037	0.003	0.004	0.001	0.003	ND	0.009	ND	0.048	0.014	ND	0.001	ND	ND	
AQ050504:1400NP4-3	5/5/2004	14:00	0.004	0.005	0.031	0.008	0.015	0.004	0.016	0.004	0.002	0.0005	0.001	0.008	0.034	0.005	0.039	0.18	ND	0.0007	ND	ND	
AQ080204:1204NP4-3	8/2/2004	12:04	0.003	0.002	ND	ND	ND	ND	0.019	0.002	0.002	0.0005	0.001	ND	0.02	0.004	0.039	0.1	ND	0.0008	ND	ND	
AQ070704:1425NP4-3	7/7/2004	14:25	0.003	0.002	ND	ND	ND	ND	0.032	0.004	0.003	0.0009	0.003	ND	0.062	ND	0.11	0.006	ND	0.001	ND	ND	
AQ080404:1340NP4-3	8/4/2004	13:40	0.02	0.002	ND	ND	ND	ND	0.03	0.004	0.003	0.001	0.004	ND	0.055	0.004	0.087	0.055	ND	0.001	ND	ND	
AQ080204:1433NP4-3	9/2/2004	14:33	0.023	0.003	ND	ND	ND	ND	0.062	0.008	0.005	0.001	0.003	ND	0.087	0.004	0.085	0.033	ND	0.002	ND	ND	
AQ100704:1215NP4-3	10/7/2004	12:15	0.001	0.001	ND	ND	ND	ND	0.045	0.004	0.003	0.0009	0.003	ND	0.011	ND	0.033	0.034	ND	0.001	ND	ND	
AQ110304:950NP4-3	11/3/2004	9:50	0.005	ND	ND	0.002	ND	ND	0.022	0.005	0.002	0.0004	0.002	ND	0.032	ND	0.017	0.022	ND	0.0005	ND	ND	

PCE - Tetrachloroethane
TCE - Trichloroethane
TCA - 1,1,1-Trichloroethane

DCE - 1,1-Dichloroethane
DCA - 1,1-Dichloroethane
cis-DCE - cis-1,2-Dichloroethane
CT - Carbon Tetrachloride

CF - Chloroform
MC - Methylene Chloride
CM - Chloromethane
CD - Carbon Disulfide

BM - Bromomethane
CB - Chlorobenzene
EB - Ethylbenzene
VC - Vinyl Chloride

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled ARAR's	PCE (ug/L) 5	TCE (ug/L) 5	TCA (ug/L) 5	Vinyl Acetate (ug/L) NE	Chloroform (ug/L) 7	MTBE (ug/L) NE	Total Iron (mg/L) 300	Dissolved Iron (mg/L) 300	Isopropylbenzene (ug/L) NE	1,1-Dichloroethane (ug/L) 5	cis-1,2-Dichloroethane (ug/L) 5	1,1-Dichloroethene (ug/L) 5	Methylene Chloride (ug/L) 5	Bromoform (ug/L) NE	Dibromochloromethane (ug/L) NE	Naphthalene (ug/L) NE
RW-1	26-Nov-02	-	-	-	-	-	-	0.032	ND<0.02	-	-	-	-	-	ND<1	ND<1	ND<1
	3-Jan-03	ND<1	ND<1	ND<1	ND<1	2.4	16	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	ND<1	ND<1	ND<1	ND<1	2.0	9.8	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	ND<1	ND<1	ND<1	ND<1	1.4	4.3	0.566	ND<0.02	ND<1	ND<1	ND<1	ND<1	10	ND<1	ND<1	ND<1
	23-Apr-03	ND<1	ND<1	ND<1	ND<1	1.2	8.6	0.053	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	ND<1	ND<1	ND<1	ND<1	1.8	8.7	0.051	ND<0.02	ND<1	ND<1	ND<1	ND<1	3.6	ND<1	ND<1	ND<1
	11-Jun-03	ND<1	ND<1	ND<1	ND<1	ND<1	8.1	0.0290	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	ND<1	ND<1	ND<1	ND<1	2.9	6.6	0.0100	0.03	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	ND<1	ND<1	ND<1	ND<1	2.6	9.4	0.0930	0.011	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	ND<1	ND<1	ND<1	ND<1	3.2	14	0.0540	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.0613	0.0074	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Dec-03	ND<1	ND<1	ND<1	ND<1	2.2	9.4	0.0190	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-04	ND<1	ND<1	ND<1	ND<1	4.0	2.2	0.0098	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	ND<1	ND<1	ND<1	ND<1	4.6	5.2	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Mar-04	ND<1	ND<1	ND<1	ND<1	ND<1	4.1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	5.5
	14-Apr-04	ND<1	ND<1	ND<1	ND<1	2.9	6.1	0.0240	ND<0.02	ND<1	ND<1	ND<1	ND<1	1.8*	ND<1	ND<1	ND<1
	5-May-04	ND<1	ND<1	ND<1	ND<1	5.6	6.8	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	6.1*	ND<1	ND<1	ND<1
	14-Jun-04	ND<1	ND<1	ND<1	ND<1	2.0	3.4	0.0454	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-04	ND<1	ND<1	ND<1	ND<1	ND<1	3.1	0.0190	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
RW-2	26-Aug-04 ***	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	15-Sep-04	ND<1	ND<1	ND<1	ND<1	2.8	ND<1	0.0865	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	2.5	ND<1	8.0
	7-Oct-04	ND<1	ND<1	ND<1	ND<1	ND<1	2.2	0.0332	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	ND<1	ND<1	ND<1	ND<1	1.9	2.0	0.0133	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Nov-02	-	-	-	-	-	-	50.9	0.188	-	-	-	-	-	ND<1	ND<1	ND<1
	3-Jan-03	38	1.3	ND<1	ND<1	ND<1	7.5	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	31	ND<1	ND<1	ND<1	ND<1	6.7	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	26	1.8	ND<1	ND<1	ND<1	ND<1	11.4	0.059	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	14	1.3	ND<1	ND<1	ND<1	ND<1	6.31	0.212	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	21	2	ND<1	ND<1	ND<1	3.8	5.51	0.052	ND<1	ND<1	ND<1	ND<1	3.7	ND<1	ND<1	ND<1
	11-Jun-03	15	0.6	ND<1	ND<1	ND<1	ND<1	3.01	0.885	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	12	ND<1	ND<1	ND<1	ND<1	ND<1	5.34	0.438	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	7.9	ND<1	ND<1	ND<1	ND<1	ND<1	5.99	0.758	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	9.2	0.5	ND<1	ND<1	ND<1	6.0	4.49	0.899	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	8.1	0.7	ND<1	ND<1	ND<1	ND<1	6.79	0.101	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Dec-03	5.5	ND<1	ND<1	ND<1	ND<1	5.5	5.46	0.0213	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-04	8.7	ND<1	ND<1	ND<1	ND<1	1.1	5.57	0.207	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	5.4	ND<1	ND<1	ND<1	ND<1	3.9	3.77	0.0748	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Mar-04	4.9	ND<1	ND<1	ND<1	ND<1	3.3	0.343	0.318	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Apr-04	4.4	ND<1	ND<1	ND<1	ND<1	2.8	5.59	0.224	ND<1	ND<1	ND<1	ND<1	1.8*	ND<1	ND<1	ND<1
	5-May-04	8.2	ND<1	ND<1	ND<1	ND<1	4.7	4.5	0.691	ND<1	ND<1	ND<1	ND<1	5.6*	ND<1	ND<1	ND<1
	14-Jun-04	ND<1	ND<1	ND<1	ND<1	ND<1	2.0	52.5	1.03	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-04	6.5	ND<1	ND<1	ND<1	ND<1	1.3	4.88	0.704	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Aug-04 ***	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	15-Sep-04	12	ND<1	ND<1	ND<1	ND<1	ND<1	3.82	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	10	ND<1	ND<1	ND<1	ND<1	1.5	4.78	0.213	ND<1	ND<1	ND<1	ND<1	ND<1	2.1	1.5	ND<1
	3-Nov-04	11	ND<1	ND<1	ND<1	ND<1	ND<1	5.21	0.152	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled ARAR's	PCE (ug/L) 5	TCE (ug/L) 5	TCA (ug/L) 5	Vinyl Acetate (ug/L) NE	Chloroform (ug/L) 7	MTBE (ug/L) NE	Total Iron (mg/L) 300	Dissolved Iron (mg/L) 300	Isopropylbenzene (ug/L) NE	1,1-Dichloroethane (ug/L) 5	cis-1,2-Dichloroethene (ug/L) 5	1,1-Dichloroethene (ug/L) 5	Methylene Chloride (ug/L) 5	Bromoform (ug/L) NE	Dibromochloromethane (ug/L) NE	Naphthalene (ug/L) NE
RW-3	26-Nov-02	-	-	-	-	-	-	2.23	2.34	-	-	-	-	-	ND<1	ND<1	ND<1
	3-Jan-03	2.8	8.5	4.8	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	2.7	5.8	2.4	ND<1	ND<1	1.8	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	2.4	3.6	1.1	ND<1	ND<1	ND<1	1.84	0.013	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	1.1	1.2	ND<1	ND<1	ND<1	ND<1	1.81	0.395	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	2.2	2.5	1.1	ND<1	ND<1	ND<1	1.68	0.166	ND<1	ND<1	ND<1	ND<1	3.7	ND<1	ND<1	ND<1
	11-Jun-03	2.4	3.4	1.8	ND<1	ND<1	ND<1	2.37	0.517	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	2.3	5.7	2.3	ND<1	ND<1	ND<1	1.77	0.636	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	2.8	5.8	2.9	ND<1	ND<1	ND<1	2.24	1.57	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	2.1	5.3	2.6	ND<1	ND<1	ND<1	1.66	1.69	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	1.9	5.2	3.3	ND<1	ND<1	ND<1	2.59	1.27	ND<1	ND<1	0.6	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Dec-03	1.2	5.8	ND<1	ND<1	ND<1	ND<1	1.96	0.129	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-04	2.2	6.9	3.2	ND<1	ND<1	ND<1	1.98	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	ND<1	3.6	2.2	ND<1	ND<1	ND<1	1.63	1.43	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Mar-04	1.2	5.0	2.3	ND<1	ND<1	ND<1	3.34	0.542	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	28-Apr-04	1.3	8.8	4.4	ND<1	ND<1	ND<1	3.07	1.32	ND<1	ND<1	1.5	ND<1	ND<1	ND<1	ND<1	ND<1
	5-May-04	0.9	6.9	3.6	ND<1	ND<1	ND<1	2.07	1.96	ND<1	ND<1	ND<1	ND<1	5.8*	ND<1	ND<1	ND<1
	30-Jun-04	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.77	0.619	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-04	2.4	6.1	2.6	ND<1	ND<1	ND<1	2.07	1.79	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Aug-04 ***	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	15-Sep-04	2.7	21	8.7	ND<1	ND<1	ND<1	1.91	0.42	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	2.2	12	5.0	ND<1	ND<1	ND<1	2.09	1.82	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	1.5	6.5	2.6	ND<1	ND<1	ND<1	1.87	1.8	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
RW-4	26-Nov-02	-	-	-	-	-	-	11	2.41	-	-	-	-	-	ND<1	ND<1	ND<1
	3-Jan-03	190	3.8	7.1	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	130	6.5	0.7	ND<1	ND<1	4.3	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	150	3.6	ND<1	ND<1	ND<1	ND<1	1.36	0.041	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	110	3.1	ND<1	ND<1	ND<1	ND<1	3.18	0.136	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	170	5.4	1.0	ND<1	ND<1	3.4	2.38	0.023	ND<1	ND<1	ND<1	ND<1	3.3	ND<1	ND<1	ND<1
	11-Jun-03	170	4.8	ND<1	ND<1	ND<1	ND<1	1.03	0.572	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	200	5.9	1.3	ND<1	ND<1	ND<1	2.67	0.292	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	210	5.7	1.1	ND<1	ND<1	ND<1	3.21	0.529	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	390	8.2	1.0	ND<1	ND<1	ND<1	2.95	0.922	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	380	6.8	1.6	ND<1	ND<1	ND<1	6.93	0.221	ND<1	1.2	0.9	0.8	ND<1	ND<1	ND<1	ND<1
	23-Dec-03	270	7.9	ND<1	ND<1	ND<1	ND<1	5.45	0.0331	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-04	270	5.9	ND<1	ND<1	ND<1	ND<1	3.56	0.48	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	170	6.9	14.0	ND<1	ND<1	ND<1	3.28	0.353	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Mar-04	170	5.8	4.5	ND<1	ND<1	ND<1	1.61	0.0691	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Apr-04	22	ND<1	ND<1	ND<1	ND<1	ND<1	0.982	0.173	ND<1	ND<1	ND<1	ND<1	2.1*	ND<1	ND<1	ND<1
	5-May-04	470	6.2	7.8	ND<1	ND<1	ND<1	7.08	2.33	ND<1	ND<1	ND<1	ND<1	7.2*	ND<1	ND<1	ND<1
	30-Jun-04	110	3.8	26	ND<1	ND<1	ND<1	4.44	1.11	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-04	110	3.2	29	ND<1	ND<1	ND<1	1.4	5.00	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Aug-04 ***	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	15-Sep-04	120	3.7	18	ND<1	ND<1	ND<1	2.98	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	3.2	ND<1	ND<1
	7-Oct-04	94	ND<1	14	ND<1	ND<1	ND<1	3.65	0.126	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-NOV-04	130	4.2	11	ND<1	ND<1	ND<1	4.75	0.205	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled ARAR's	PCE (ug/L) 5	TCE (ug/L) 5	TCA (ug/L) 5	Vinyl Acetate (ug/L) NE	Chloroform (ug/L) 7	MTBE (ug/L) NE	Total Iron (mg/L) 300	Dissolved Iron (mg/L) 300	Isopropylbenzene (ug/L) NE	1,1-Dichloroethane (ug/L) 5	cis-1,2-Dichloroethene (ug/L) 5	1,1-Dichloroethene (ug/L) 5	Methylene Chloride (ug/L) 5	Bromoform (ug/L) NE	Dibromochloromethane (ug/L) NE	Naphthalene (ug/L) NE
RW-5	26-Nov-02	-	-	-	-	-	-	ND<0.02	ND<0.02	-	-	-	-	-	ND<1	ND<1	ND<1
	3-Jan-03	5.5	ND<1	ND<1	ND<1	1.9	1.5	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	5.8	ND<1	ND<1	ND<1	1.1	3.5	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	19	ND<1	ND<1	ND<1	ND<1	ND<1	0.489	0.013	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	12	ND<1	ND<1	ND<1	ND<1	ND<1	0.068	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	21	ND<1	ND<1	ND<1	0.8	6.7	0.146	ND<0.02	ND<1	ND<1	ND<1	ND<1	3.6	ND<1	ND<1	ND<1
	11-Jun-03	21	ND<1	ND<1	ND<1	ND<1	6.2	0.76	0.0356	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	11	ND<1	ND<1	ND<1	1.1	9.7	6.47	0.068	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	15	ND<1	ND<1	ND<1	0.9	7.3	0.269	0.021	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	18	ND<1	ND<1	ND<1	ND<1	8.1	0.043	0.016	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	18	ND<1	ND<1	ND<1	ND<1	ND<1	13.1	0.0097	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Dec-03	11	ND<1	ND<1	ND<1	ND<1	7.5	0.0523	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-04	14	ND<1	ND<1	ND<1	0.9	4.0	0.05	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	14	ND<1	ND<1	ND<1	1.0	6.2	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Mar-04	14	ND<1	ND<1	ND<1	ND<1	5.0	0.0852	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Apr-04	18	ND<1	1.5	ND<1	ND<1	6.1	0.147	0.015	ND<1	ND<1	ND<1	ND<1	2*	ND<1	ND<1	ND<1
	5-May-04	38	0.8	3.2	ND<1	1.5	8.0	0.055	0.015	ND<1	ND<1	ND<1	ND<1	6.4*	ND<1	ND<1	ND<1
	14-Jun-04	17	ND<1	4.6	ND<1	ND<1	3.9	0.054	0.022	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-04	21	ND<1	4.6	ND<1	ND<1	3.1	0.0254	0.0285	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Aug-04 ***	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	15-Sep-04	24	ND<1	6.5	ND<1	ND<1	3.2	2.39	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	2.3	ND<1	ND<1
	7-Oct-04	16	ND<1	5.2	ND<1	ND<1	2.4	0.139	0.0163	ND<1	ND<1	ND<1	ND<1	ND<1	1.8	1.4	ND<1
	3-Nov-04	15	ND<1	6.4	ND<1	ND<1	2.2	0.0287	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
RW-6	26-Nov-02	-	-	-	-	-	-	0.37	ND<0.02	-	-	-	-	-	ND<1	ND<1	ND<1
	3-Jan-03	110	1.1	ND<1	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	97	1.6	ND<1	ND<1	0.6	ND<1	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	130	1.0	ND<1	ND<1	ND<1	ND<1	3.05	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	79	1.0	ND<1	ND<1	ND<1	ND<1	0.028	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	120	1.8	ND<1	ND<1	0.8	ND<1	0.068	ND<0.02	ND<1	ND<1	ND<1	ND<1	3.5	ND<1	ND<1	ND<1
	11-Jun-03	120	0.7	ND<1	ND<1	ND<1	ND<1	0.0097	0.011	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	150	0.6	ND<1	ND<1	ND<1	ND<1	0.186	0.034	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	140	2.2	ND<1	ND<1	ND<1	ND<1	0.089	0.018	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	140	2.6	ND<1	ND<1	ND<1	ND<1	0.023	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	180	3.3	1.0	ND<1	ND<1	ND<1	0.342	0.0083	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Dec-03	120	2.6	ND<1	ND<1	ND<1	ND<1	0.017	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-04	160	2.4	ND<1	ND<1	ND<1	ND<1	0.015	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	130	3.3	1.1	ND<1	ND<1	1.7	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Mar-04	110	2.7	ND<1	ND<1	ND<1	1.6	0.077	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Apr-04	110	2.9	1.3	ND<1	ND<1	2.6	0.016	ND<0.02	ND<1	ND<1	ND<1	ND<1	1.8*	ND<1	ND<1	ND<1
	5-May-04	210	4.8	ND<1	ND<1	ND<1	3.2	0.719	ND<0.02	ND<1	ND<1	ND<1	ND<1	5.9*	ND<1	ND<1	ND<1
	14-Jun-04	92	3.6	1.3	ND<1	ND<1	2.1	0.151	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-04	100	2.8	1.2	ND<1	ND<1	1.7	0.437	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Aug-04 ***	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	15-Sep-04	130	3.3	2.2	ND<1	ND<1	ND<1	0.0976	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	4.0	ND<1	ND<1
	7-Oct-04	94	ND<1	1.6	ND<1	ND<1	ND<1	0.214	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	2.9	2.0	ND<1
	3-Nov-04	94	2.1	2.4	ND<1	ND<1	2.5	0.0111	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled ARAR's	PCE (ug/L) 5	TCE (ug/L) 5	TCA (ug/L) 5	Vinyl Acetate (ug/L) NE	Chloroform (ug/L) 7	MTBE (ug/L) NE	Total Iron (mg/L) 300	Dissolved Iron (mg/L) 300	Isopropyl- benzene (ug/L) NE	1,1-Dichloro- ethane (ug/L) 5	cis-1,2-Dichloro- ethane (ug/L) 5	1,1-Dichloro- ethene (ug/L) 5	Methylene Chloride (ug/L) 5	Bromoform (ug/L) NE	Dibromochloromethane (ug/L) NE	Naphthalene (ug/L) NE
RW-7	26-Nov-02	-	-	-	-	-	-	0.075	ND<0.02	-	-	-	-	-	ND<1	ND<1	ND<1
	3-Jan-03	160	2.5	1.3	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	120	2.3	1.1	ND<1	0.5	1.4	-	-	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	160	2.3	ND<1	ND<1	ND<1	ND<1	0.405	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	100	1.8	ND<1	ND<1	ND<1	ND<1	0.016	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	140	3.1	1.0	ND<1	ND<1	ND<1	0.032	ND<0.02	ND<1	ND<1	ND<1	ND<1	4.0	ND<1	ND<1	ND<1
	11-Jun-03	140	2.0	ND<1	ND<1	ND<1	ND<1	0.0246	0.0086	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	150	2.1	ND<1	ND<1	ND<1	ND<1	0.024	0.041	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	120	2.3	ND<1	ND<1	ND<1	ND<1	0.011	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	130	2.9	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	140	3.4	1.1	ND<1	ND<1	ND<1	0.0464	ND<0.02	ND<1	ND<1	0.2	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Dec-03	110	2.8	ND<1	ND<1	ND<1	ND<1	0.0239	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-04	180	3.7	ND<1	ND<1	ND<1	ND<1	0.0069	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	120	2.9	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Mar-04	100	3.0	ND<1	ND<1	ND<1	ND<1	0.0205	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Apr-04	79	2.5	ND<1	ND<1	ND<1	ND<1	0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	2.2*	ND<1	ND<1	ND<1
	5-May-04	130	4.0	ND<1	ND<1	ND<1	ND<1	0.012	ND<0.02	ND<1	ND<1	ND<1	ND<1	6.2*	ND<1	ND<1	ND<1
	14-Jun-04	59	2.7	ND<1	ND<1	ND<1	ND<1	0.018	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-04	55	2.1	ND<1	ND<1	ND<1	ND<1	0.791	0.017	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Aug-04 ***	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
RW-8	15-Sep-04	59	2.2	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	2.6	ND<1	ND<1
	7-Oct-04	36	ND<1	ND<1	ND<1	ND<1	ND<1	0.0429	0.0126	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	36	ND<1	ND<1	ND<1	ND<1	ND<1	0.0214	0.0108	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Nov-02	-	-	-	-	-	-	12.1	1.43	-	-	-	-	-	ND<1	ND<1	ND<1
	3-Jan-03	59	4.3	4	ND<1	ND<1	ND<1	-	-	ND<1	2.4	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	58	4.2	3.2	ND<1	ND<1	ND<1	-	-	ND<1	1.8	0.6	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	70	2.9	2.7	ND<1	ND<1	ND<1	0.544	0.141	ND<1	1.4	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	41	2.0	1.8	ND<1	ND<1	ND<1	11.8	0.352	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	61	3.9	3.8	ND<1	ND<1	ND<1	10.1	0.068	ND<1	1.8	ND<1	ND<1	3.4	ND<1	ND<1	ND<1
	11-Jun-03	57	3.1	2.7	ND<1	ND<1	ND<1	9.14	1.10	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	35	1.9	3.2	ND<1	ND<1	ND<1	10.5	0.43	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	30	1.7	3.6	ND<1	ND<1	ND<1	11.1	1.18	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	28	2.5	4.4	ND<1	ND<1	ND<1	9.93	0.40	ND<1	3.3	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	27	2.3	5.4	ND<1	ND<1	ND<1	13.3	0.21	ND<1	4.1	0.7	1.3	ND<1	ND<1	ND<1	ND<1
	23-Dec-03	17	2.1	2.6	ND<1	ND<1	ND<1	9.16	0.05	ND<1	1.3	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-04	16	2.2	4.1	ND<1	ND<1	ND<1	9.73	2.72	ND<1	3.5	ND<1	1.5	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	15	2.2	4.7	ND<1	ND<1	ND<1	8.74	0.19	ND<1	4.1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Mar-04	22	2.7	4.3	ND<1	ND<1	ND<1	11.9	0.23	ND<1	3.9	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Apr-04	14	2.0	6.2	ND<1	ND<1	ND<1	10.7	0.14	ND<1	5.7	ND<1	ND<1	1.9*	ND<1	ND<1	ND<1
	5-May-04	27	4.1	8.3	ND<1	ND<1	ND<1	8.77	0.21	ND<1	8.7	ND<1	ND<1	8.5*	ND<1	ND<1	ND<1
	14-Jun-04	10	2.4	5.8	ND<1	ND<1	ND<1	9.15	0.10	ND<1	4.0	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-04 **	3	1.0	3.7	ND<1	ND<1	ND<1	4.18	0.21	ND<1	2.1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Aug-04 ***	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	15-Sep-04	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	27-Oct-04	4.1	1.0	2.2	ND<1	ND<1	ND<1	28.8	0.2	ND<1	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	5.3	ND<1	4.0	ND<1	ND<1	ND<1	10.6	0.3	ND<1	3.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled ARAR's	PCE (ug/L) 5	TCE (ug/L) 5	TCA (ug/L) 5	Vinyl Acetate (ug/L) NE	Chloroform (ug/L) 7	MTBE (ug/L) NE	Total Iron (mg/L) 300	Dissolved Iron (mg/L) 300	Isopropylbenzene (ug/L) NE	1,1-Dichloroethane (ug/L) 5	cis-1,2-Dichloroethane (ug/L) 5	1,1-Dichloroethene (ug/L) 5	Methylene Chloride (ug/L) 5	Bromoform (ug/L) NE	Dibromochloromethane (ug/L) NE	Naphthalene (ug/L) NE
RW-9	26-Nov-02	-	-	-	-	-	-	2.99	1.72	-	-	-	-	-	ND<1	ND<1	ND<1
	3-Jan-03	17	2.5	6.9	ND<1	ND<1	ND<1	-	-	ND<1	3.1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-03	23	2.8	4.3	ND<1	ND<1	ND<1	-	-	ND<1	2.5	0.6	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Mar-03	23	2.2	2.8	ND<1	ND<1	ND<1	11.0	0.013	ND<1	1.7	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Apr-03	15	1.2	1.8	ND<1	ND<1	ND<1	3.55	1.97	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-May-03	21	1.8	3.6	ND<1	ND<1	ND<1	2.95	0.046	ND<1	1.9	ND<1	ND<1	3.2	ND<1	ND<1	ND<1
	11-Jun-03	18	1.6	4.8	ND<1	ND<1	ND<1	2.75	1.74	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jul-03	4.7	1.6	7.3	ND<1	ND<1	ND<1	3.60	0.467	ND<1	3.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Sep-03	25	1.2	3.5	ND<1	ND<1	ND<1	4.05	2.69	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Oct-03	22	2.1	5.8	ND<1	ND<1	ND<1	3.49	2.88	ND<1	3.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	25-Nov-03	27	2.2	6.2	ND<1	ND<1	ND<1	5.39	1.72	ND<1	5.2	ND<1	ND<1	1.4	ND<1	ND<1	ND<1
	23-Dec-03	11	1.7	5.4	ND<1	ND<1	ND<1	1.94	1.57	ND<1	3.0	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-04	2.3	2.2	13	ND<1	ND<1	ND<1	0.638	0.029	ND<1	1.8	ND<1	1.5	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	ND<1	ND<1	ND<1
	8-Mar-04	ND<1	2.2	12	ND<1	ND<1	ND<1	1.24	0.222	ND<1	3.7	ND<1	1.3	ND<1	ND<1	ND<1	ND<1
	14-Apr-04	5.6	1.7	10	ND<1	ND<1	ND<1	2.65	1.22	ND<1	5.9	ND<1	2.0	2.0*	ND<1	ND<1	ND<1
	5-May-04	3.7	1.7	13	ND<1	ND<1	ND<1	2.58	1.83	ND<1	6.7	ND<1	1.7	7.1*	ND<1	ND<1	ND<1
	14-Jun-04	1.8	1.9	8.2	ND<1	ND<1	ND<1	3.03	1.11	ND<1	3.0	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-04	3.4	1.3	5.1	ND<1	ND<1	ND<1	2.6	1.95	ND<1	1.8	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Aug-04 ***	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	ND<1	NM
	15-Sep-04	3.7	1.0	6.0	ND<1	ND<1	ND<1	0.049	ND<0.02	ND<1	1.9	ND<1	ND<1	ND<1	1.6	ND<1	ND<1
	7-Oct-04	3.1	ND<1	5.0	ND<1	ND<1	ND<1	3.12	0.716	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	1.6	ND<1	5.9	ND<1	ND<1	ND<1	2.97	1.41	ND<1	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1

ND: Not detected
<#: Less than method detection limit
ug/L: Micrograms per liter
-: Not analyzed

ARAR's are chemical specific aquifer restoration goals for ground-water at the Former Rowe Industries Superfund Site.
Bold values indicate an exceedance of the ARAR standard established for the site.

PCE: Tetrachloroethylene
TCE: Trichloroethylene
TCA: 1,1,1-Trichloroethane
1,1-DCA: 1,1-Dichloroethane

1,1-DCE: 1,1-Dichloroethene
1,2-DCE: 1,2-Dichloroethene
MTBE: Methyl Tertiary Butyl Ether
NM: Not Measured

*Methylene Chloride detected in laboratory method blank
NE: ARAR goal was not established for this compound by the EPA.


** The July 14, 2004 sample collected for RW-8 only represents water in the pipe since the RW-8 pump was not operating at this time.

*** The August 26, 2004 samples were lost during shipment.

GRAPHS


GRAPH 1
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

EFFLUENT FLOW DATA
(November 1, 2004 through November 30, 2004)

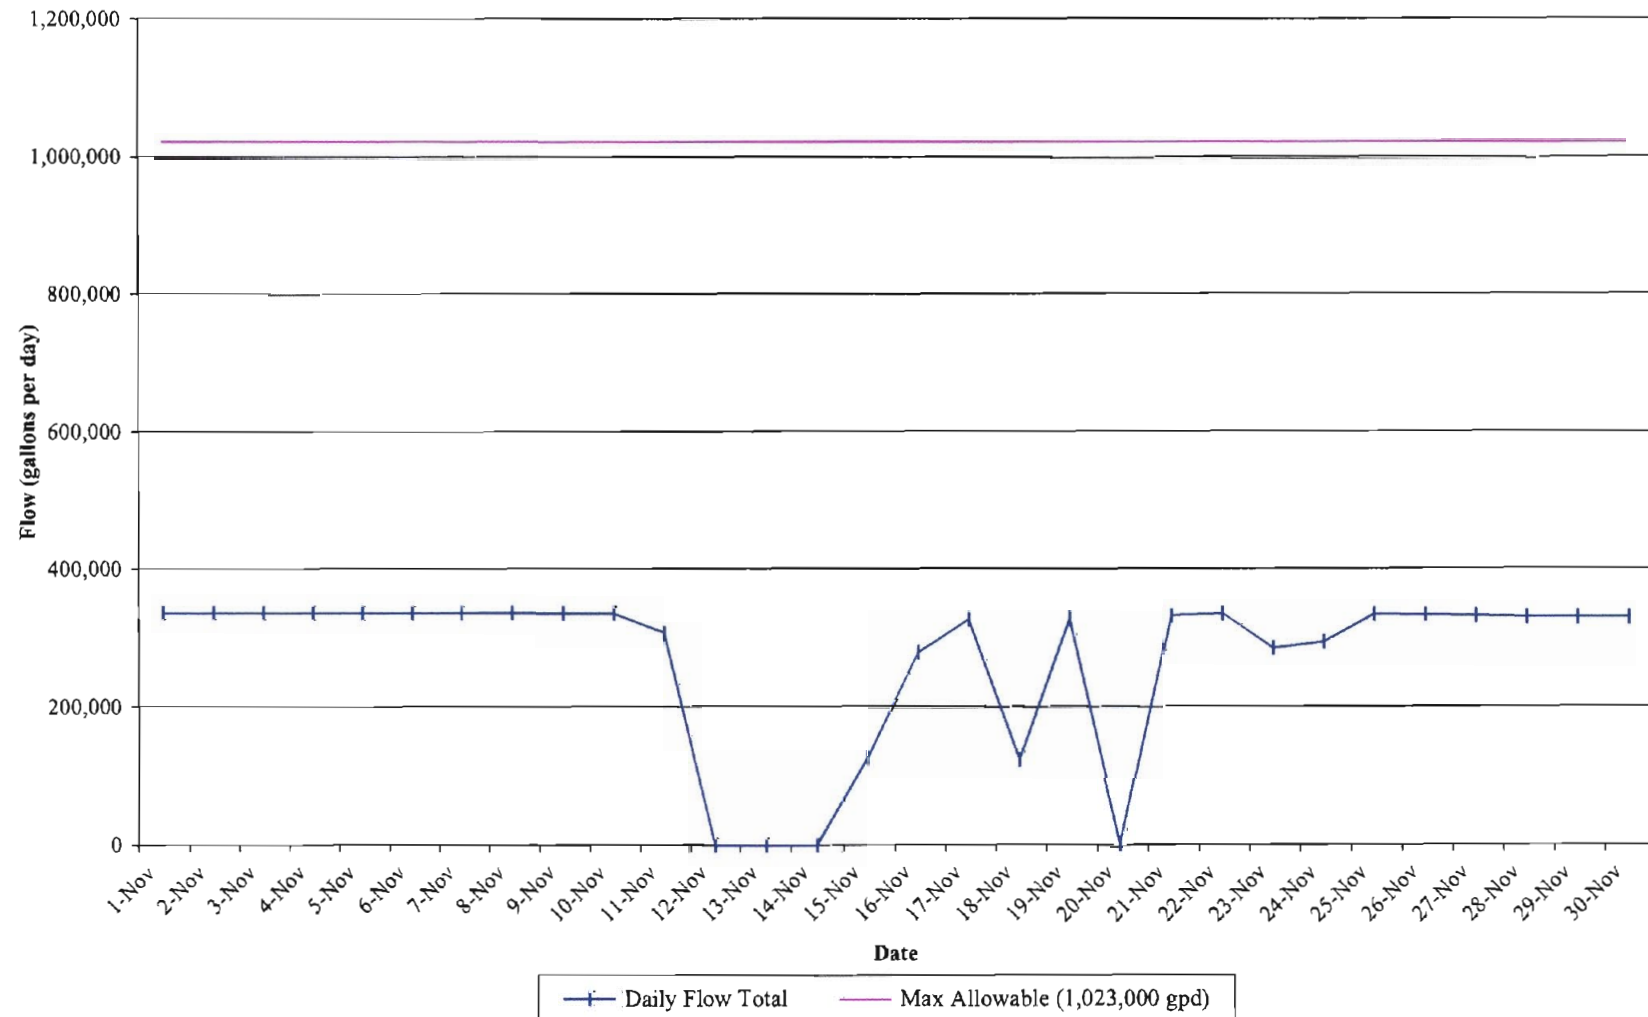


GRAPH 2
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RECOVERY WELL PCE CONCENTRATION IN MICROGRAMS PER LITER

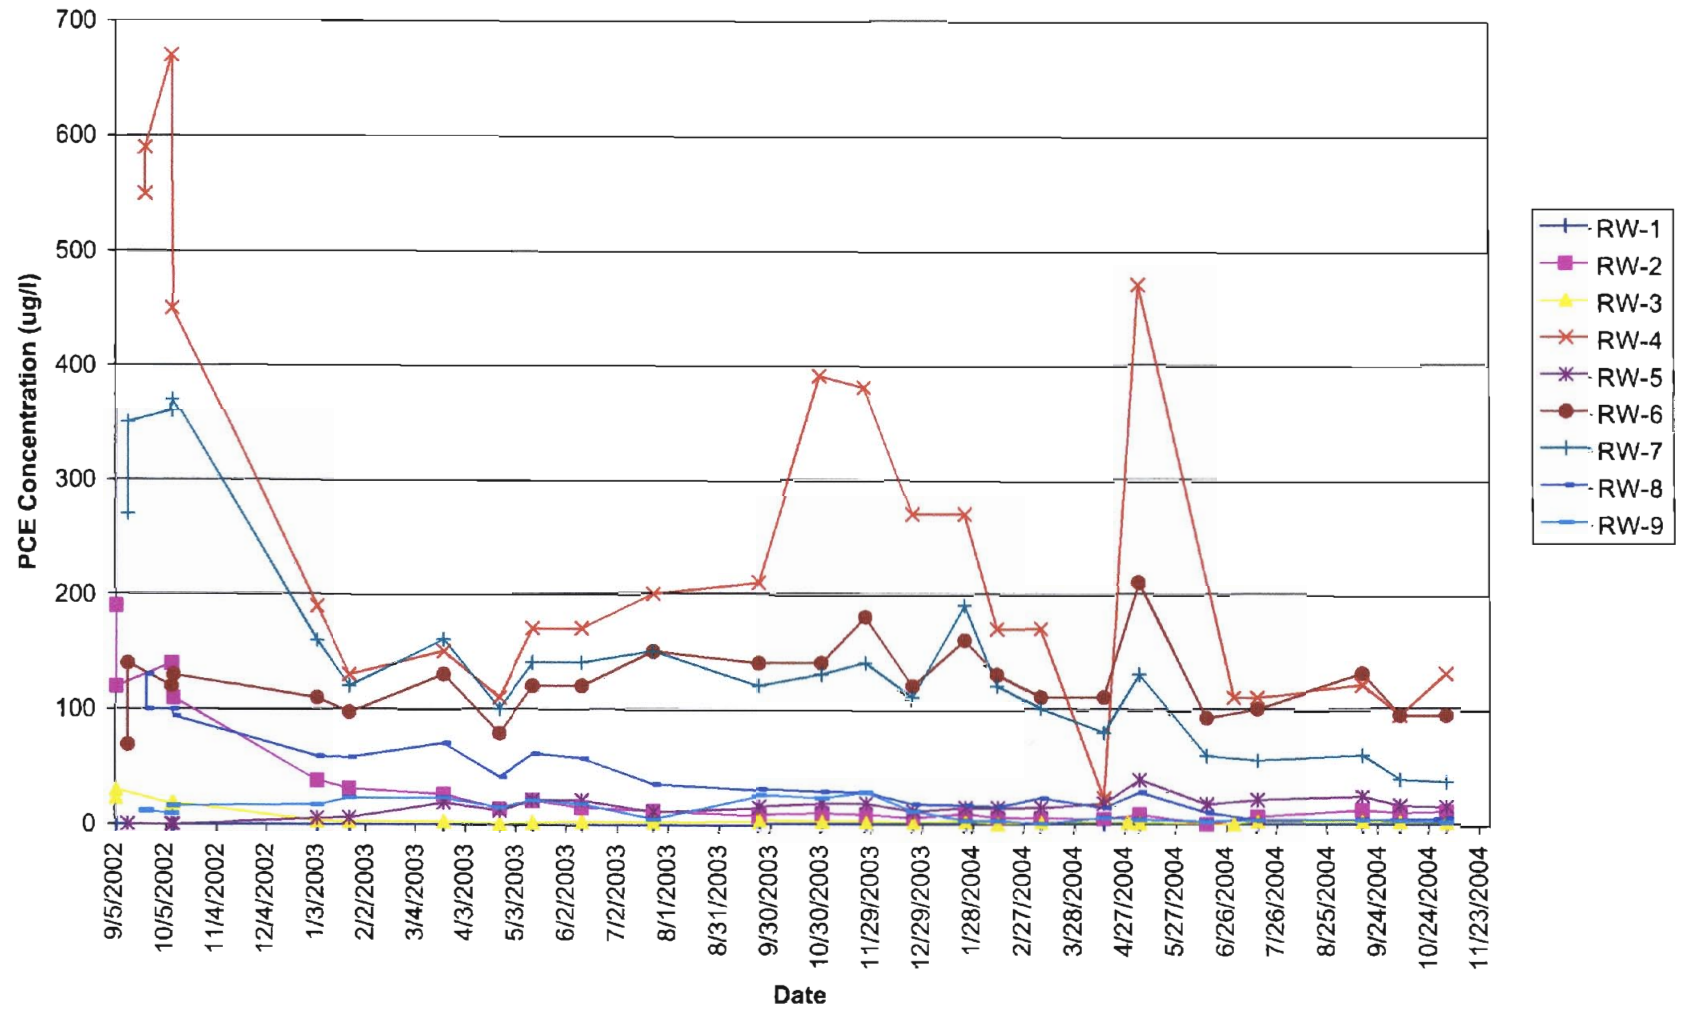

GRAPH 3
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

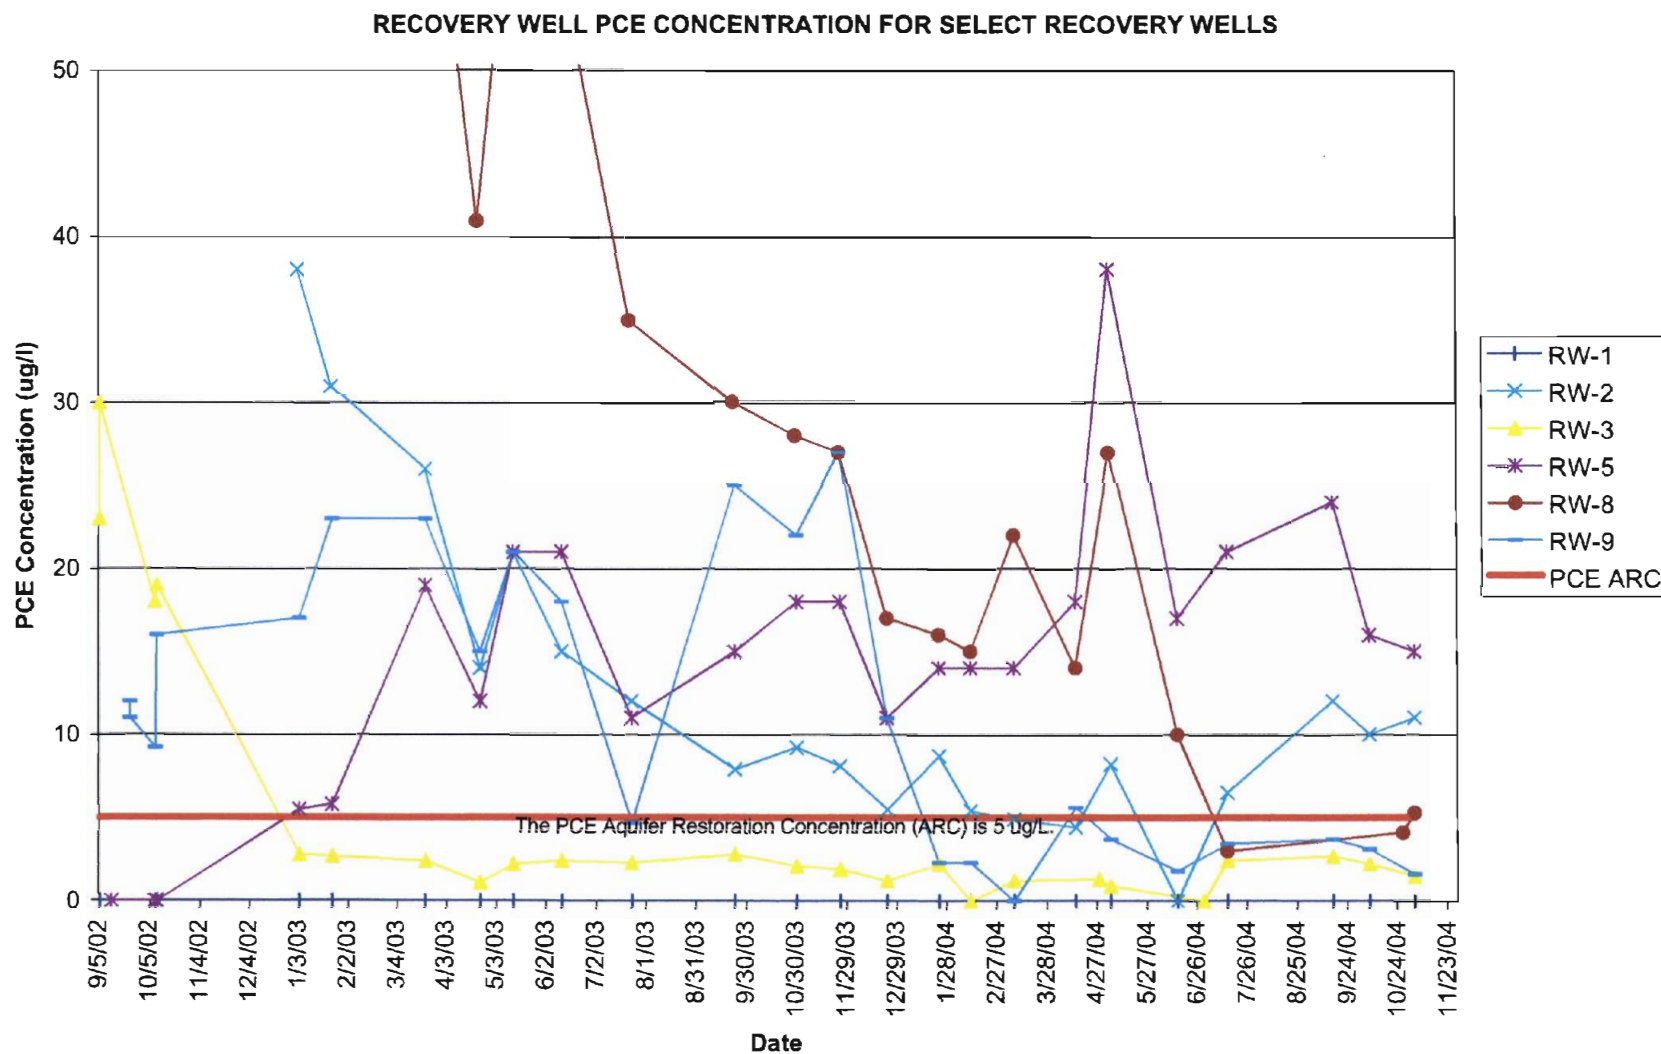

APPENDIX I
NOVEMBER 2004 LABORATORY ANALYTICAL REPORTS

Friday, November 12, 2004

Mark Goldberg
Leggette Brashears & Graham Inc.
126 Monroe Turnpike
Trumbull, CT 06611

TEL: (203) 452-3110

FAX (203) 452-3111

RE: Rowe Industries

Order No.: 0411071

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 11/5/2004 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,



Lori Beyer
Lab Director



American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.**Project:** Rowe Industries**Lab Order:** 0411071**Work Order Sample Summary**

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0411071-01A	WQ110304:930 NP2-6		11/3/2004	11/5/2004
0411071-01B	WQ110304:930 NP2-6		11/3/2004	11/5/2004
0411071-01C	WQ110304:930 NP2-6		11/3/2004	11/5/2004
0411071-02A	WQ110304:932 NP2-7		11/3/2004	11/5/2004
0411071-02B	WQ110304:932 NP2-7		11/3/2004	11/5/2004
0411071-02C	WQ110304:932 NP2-7		11/3/2004	11/5/2004
0411071-03A	WQ110304:935 NP2-10		11/3/2004	11/5/2004
0411071-03B	WQ110304:935 NP2-10		11/3/2004	11/5/2004
0411071-03C	WQ110304:935 NP2-10		11/3/2004	11/5/2004

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the Instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc. **Client Sample ID:** WQ110304:930 NP2-6
Lab Order: 0411071 **Tag Number:**
Project: Rowe Industries **Collection Date:** 11/3/2004
Lab ID: 0411071-01A **Date Received:** 11/5/2004 **Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
1,1,1-Trichloroethane	2.8	1.0		µg/L	1	11/5/2004 6:19:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
2-Butanone	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
2-Hexanone	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Acetone	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Benzene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Bromobenzene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Bromochloromethane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Bromodichloromethane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Bromoform	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Bromomethane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Carbon disulfide	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Chlorobenzene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Chloroethane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM

Qualifiers:
 * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ110304:930 NP2-6
Lab Order:	0411071	Tag Number:	
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411071-01A	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
Chloroform	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Chloromethane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Dibromochloromethane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Dibromomethane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Ethylbenzene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Isopropylbenzene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
m,p-Xylene	U	2.0		µg/L	1	11/5/2004 6:19:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Methylene chloride	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Naphthalene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
n-Butylbenzene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
n-Propylbenzene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
o-Xylene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Styrene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Tetrachloroethene	22	1.0		µg/L	1	11/5/2004 6:19:00 PM
Toluene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Trichloroethene	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Vinyl acetate	U	1.0		µg/L	1	11/5/2004 6:19:00 PM
Vinyl chloride	U	1.0		µg/L	1	11/5/2004 6:19:00 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ110304:930 NP2-6
Lab Order:	0411071	Tag Number:	
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411071-01B	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	3.81	0.0200		mg/L	1	11/8/2004 1:56:53 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ110304:930 NP2-6
Lab Order:	0411071	Tag Number:	
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411071-01C	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	1.23	0.0200		mg/L	1	11/8/2004 1:54:18 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggett Brashears & Graham Inc. Client Sample ID: WQ110304:932 NP2-7
 Lab Order: 0411071 Tag Number:
 Project: Rowe Industries Collection Date: 11/3/2004
 Lab ID: 0411071-02A Date Received: 11/5/2004 Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
2-Butanone	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
2-Hexanone	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Acetone	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Benzene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Bromobenzene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Bromochloromethane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Bromodichloromethane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Bromoform	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Bromomethane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Carbon disulfide	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Chlorobenzene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Chloroethane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ110304:932 NP2-7

Lab Order: 0411071

Tag Number:

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411071-02A

Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
Chloroform	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Chloromethane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Dibromochloromethane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Dibromomethane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Ethylbenzene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Isopropylbenzene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
m,p-Xylene	U	2.0		µg/L	1	11/5/2004 7:58:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Methylene chloride	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Naphthalene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
n-Butylbenzene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
n-Propylbenzene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
o-Xylene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Styrene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Tetrachloroethene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Toluene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Trichloroethene	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Vinyl acetate	U	1.0		µg/L	1	11/5/2004 7:58:00 PM
Vinyl chloride	U	1.0		µg/L	1	11/5/2004 7:58:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ110304:932 NP2-7
Lab Order:	0411071	Tag Number:	
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411071-02B	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	1.92	0.0200		mg/L	1	11/8/2004 2:07:15 PM

Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** WQ110304:932 NP2-7**Lab Order:** 0411071**Tag Number:****Project:** Rowe Industries**Collection Date:** 11/3/2004**Lab ID:** 0411071-02C**Date Received:** 11/5/2004**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.400	0.0200		mg/L	1	11/8/2004 1:59:03 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc. Client Sample ID: WQ110304:935 NP2-10
 Lab Order: 0411071 Tag Number:
 Project: Rowe Industries Collection Date: 11/3/2004
 Lab ID: 0411071-03A Date Received: 11/5/2004 Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
2-Butanone	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
2-Hexanone	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Acetone	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Benzene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Bromobenzene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Bromochloromethane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Bromodichloromethane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Bromoform	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Bromomethane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Carbon disulfide	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Chlorobenzene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Chloroethane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ110304:935 NP2-10

Lab Order: 0411071

Tag Number:

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411071-03A

Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
Chloroform	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Chloromethane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Dibromochloromethane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Dibromomethane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Ethylbenzene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Isopropylbenzene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
m,p-Xylene	U	2.0		µg/L	1	11/5/2004 8:30:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Methylene chloride	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Naphthalene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
n-Butylbenzene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
n-Propylbenzene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
o-Xylene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Styrene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Tetrachloroethene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Toluene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Trichloroethene	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Vinyl acetate	U	1.0		µg/L	1	11/5/2004 8:30:00 PM
Vinyl chloride	U	1.0		µg/L	1	11/5/2004 8:30:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ110304:935 NP2-10
Lab Order:	0411071	Tag Number:	
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411071-03B	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	1.02	0.0200		mg/L	1	11/8/2004 2:14:32 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ110304:935 NP2-10
Lab Order:	0411071	Tag Number:	
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411071-03C	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.186	0.0200		mg/L	1	11/8/2004 2:10:14 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: AT
Total Dissolved Solids (Residue, Filterable)	88	1.0		mg/L	1	11/8/2004

Qualifiers:	* Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits		

Thursday, November 18, 2004

Mark Goldberg
Leggette Brashears & Graham Inc.
126 Monroe Turnpike
Trumbull, CT 06611

TEL: (203) 452-3110

FAX (203) 452-3111

RE: Rowe

Order No.: 0411112

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 11/11/2004 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,



Lori Beyer
Lab Director



American Analytical Laboratories, LLC.

Date: 18-Nov-04

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe
Lab Order: 0411112

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0411112-01A	WQ110904:915 NP2-6		11/9/2004	11/11/2004
0411112-01B	WQ110904:915 NP2-6		11/9/2004	11/11/2004
0411112-01C	WQ110904:915 NP2-6		11/9/2004	11/11/2004
0411112-02A	WQ110904:917 NP2-7		11/9/2004	11/11/2004
0411112-02B	WQ110904:917 NP2-7		11/9/2004	11/11/2004
0411112-02C	WQ110904:917 NP2-7		11/9/2004	11/11/2004
0411112-03A	WQ110904:920 NP2-10		11/9/2004	11/11/2004
0411112-03B	WQ110904:920 NP2-10		11/9/2004	11/11/2004
0411112-03C	WQ110904:920 NP2-10		11/9/2004	11/11/2004

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100

FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 18-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ110904:915 NP2-6

Lab Order: 0411112

Tag Number:

Project: Rowe

Collection Date: 11/9/2004

Lab ID: 0411112-01A

Date Received: 11/11/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
1,1,1-Trichloroethane	3.6	1.0		µg/L	1	11/15/2004 6:00:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
2-Butanone	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
2-Hexanone	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
Acetone	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
Benzene	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
Bromobenzene	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
Bromochloromethane	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
Bromodichloromethane	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
Bromoform	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
Bromomethane	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
Carbon disulfide	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
Chlorobenzene	U	1.0		µg/L	1	11/15/2004 6:00:00 PM
Chloroethane	U	1.0		µg/L	1	11/15/2004 6:00:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 18-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ110904:915 NP2-6

Lab Order: 0411112

Tag Number:

Project: Rowe

Collection Date: 11/9/2004

Lab ID: 0411112-01A

Date Received: 11/11/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
Chloromethane	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
Dibromochloromethane	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
Dibromomethane	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
Ethylbenzene	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
Isopropylbenzene	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
m,p-Xylene	U	2.0		µg/L	1	11/15/2004 8:00:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
Methylene chloride	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
Naphthalene	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
n-Butylbenzene	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
n-Propylbenzene	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
o-Xylene	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
Styrene	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
Tetrachloroethene	35	1.0		µg/L	1	11/15/2004 8:00:00 PM
Toluene	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
Trichloroethene	2.2	1.0		µg/L	1	11/15/2004 8:00:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
Vinyl acetate	U	1.0		µg/L	1	11/15/2004 8:00:00 PM
Vinyl chloride	U	1.0		µg/L	1	11/15/2004 8:00:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 18-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ110904:915 NP2-6
Lab Order:	0411112	Tag Number:	
Project:	Rowe	Collection Date:	11/9/2004
Lab ID:	0411112-01B	Date Received:	11/11/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	7.59	0.0200		mg/L	1	11/17/2004 1:11:43 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 18-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ110904:915 NP2-6
Lab Order:	0411112	Tag Number:	
Project:	Rowe	Collection Date:	11/9/2004
Lab ID:	0411112-01C	Date Received:	11/11/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.0600	0.0200		mg/L	1	11/17/2004 1:09:39 PM

Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	

American Analytical Laboratories, LLC.

Date: 18-Nov-04

CLIENT: Leggett Brashears & Graham Inc.

Client Sample ID: WQ110904:917 NP2-7

Lab Order: 0411112

Tag Number:

Project: Rowe

Collection Date: 11/9/2004

Lab ID: 0411112-02A

Date Received: 11/11/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
2-Butanone	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
2-Hexanone	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Acetone	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Benzene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Bromobenzene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Bromochloromethane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Bromodichloromethane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Bromoforn	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Bromomethane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Carbon disulfide	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Chlorobenzene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Chloroethane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 18-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ110904:917 NP2-7
Lab Order:	0411112	Tag Number:	
Project:	Rowe	Collection Date:	11/9/2004
Lab ID:	0411112-02A	Date Received:	11/11/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Chloromethane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
cis-1,2-Dichloroethane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Dibromochloromethane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Dibromomethane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Ethylbenzene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Isopropylbenzene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
m,p-Xylene	U	2.0		µg/L	1	11/15/2004 7:52:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Methylene chloride	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Naphthalene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
n-Butylbenzene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
n-Propylbenzene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
o-Xylene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Styrene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Tetrachloroethene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Toluene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Trichloroethene	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Vinyl acetate	U	1.0		µg/L	1	11/15/2004 7:52:00 PM
Vinyl chloride	U	1.0		µg/L	1	11/15/2004 7:52:00 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 18-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ110904:917 NP2-7
Lab Order:	0411112	Tag Number:	
Project:	Rowe	Collection Date:	11/9/2004
Lab ID:	0411112-02B	Date Received:	11/11/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	1.19	0.0200		mg/L	1	11/17/2004 1:17:06 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 18-Nov-04

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** WQ110904:917 NP2-7**Lab Order:** 0411112**Tag Number:****Project:** Rowe**Collection Date:** 11/9/2004**Lab ID:** 0411112-02C**Date Received:** 11/11/2004**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.177	0.0200		mg/L	1	11/17/2004 1:13:54 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 18-Nov-04

CLIENT: Leggette Brashears & Graham Inc. **Client Sample ID:** WQ110904:920 NP2-10
Lab Order: 0411112 **Tag Number:**
Project: Rowe **Collection Date:** 11/9/2004
Lab ID: 0411112-03A **Date Received:** 11/11/2004 **Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
2-Butanone	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
2-Hexanone	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Acetone	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Benzene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Bromobenzene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Bromochloromethane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Bromodichloromethane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Bromoform	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Bromomethane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Carbon disulfide	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Chlorobenzene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Chloroethane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 18-Nov-04

CLIENT: Leggett Brashears & Graham Inc. Client Sample ID: WQ110904:920 NP2-10
 Lab Order: 0411112 Tag Number:
 Project: Rowe Collection Date: 11/9/2004
 Lab ID: 0411112-03A Date Received: 11/11/2004 Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Chloromethane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Dibromochloromethane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Dibromomethane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Ethylbenzene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Isopropylbenzene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
m,p-Xylene	U	2.0		µg/L	1	11/15/2004 8:29:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Methylene chloride	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Naphthalene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
n-Butylbenzene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
n-Propylbenzene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
o-Xylene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Styrene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Tetrachloroethene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Toluene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Trichloroethene	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Vinyl acetate	U	1.0		µg/L	1	11/15/2004 8:29:00 PM
Vinyl chloride	U	1.0		µg/L	1	11/15/2004 8:29:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 18-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ110904:920 NP2-10
Lab Order:	0411112	Tag Number:	
Project:	Rowe	Collection Date:	11/9/2004
Lab ID:	0411112-03B	Date Received:	11/11/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	3.65	0.0200		mg/L	1	11/17/2004 1:21:54 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 18-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ110904:920 NP2-10

Lab Order: 0411112

Tag Number:

Project: Rowe

Collection Date: 11/9/2004

Lab ID: 0411112-03C

Date Received: 11/11/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.108	0.0200		mg/L	1	11/17/2004 1:19:45 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: AT
Total Dissolved Solids (Residue, Filterable)	110	1.0		mg/L	1	11/15/2004

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit

Monday, November 22, 2004

Mark Goldberg
Leggette Brashears & Graham Inc.
126 Monroe Turnpike
Trumbull, CT 06611

TEL: (203) 452-3110

FAX (203) 452-3111

RE: Rowe Industries

Order No.: 0411133

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 11/17/2004 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,



Lori Beyer
Lab Director



American Analytical Laboratories, LLC.**Date:** 22-Nov-04

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0411133

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0411133-01A	WQ111604:850 NP2-6	2546	11/16/2004	11/17/2004
0411133-01B	WQ111604:850 NP2-6	2546	11/16/2004	11/17/2004
0411133-01C	WQ111604:850 NP2-6	2546	11/16/2004	11/17/2004
0411133-02A	WQ111604:852 NP2-7	2546	11/16/2004	11/17/2004
0411133-02B	WQ111604:852 NP2-7	2546	11/16/2004	11/17/2004
0411133-02C	WQ111604:852 NP2-7	2546	11/16/2004	11/17/2004
0411133-03A	WQ111604:855 NP2-10	2546	11/16/2004	11/17/2004
0411133-03B	WQ111604:855 NP2-10	2546	11/16/2004	11/17/2004
0411133-03C	WQ111604:855 NP2-10	2546	11/16/2004	11/17/2004

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 22-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ111604:850 NP2-6
Lab Order:	0411133	Tag Number:	2546
Project:	Rowe Industries	Collection Date:	11/16/2004
Lab ID:	0411133-01A	Date Received:	11/17/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
1,1,1-Trichloroethane	3.6	1.0		µg/L	1	11/17/2004 5:54:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
2-Butanone	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
2-Hexanone	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Acetone	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Benzene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Bromobenzene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Bromochloromethane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Bromodichloromethane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Bromoform	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Bromomethane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Carbon disulfide	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Chlorobenzene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Chloroethane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM

Qualifiers:
 * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 22-Nov-04

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0411133
Project: Rowe Industries
Lab ID: 0411133-01A

Client Sample ID: WQ111604:850 NP2-6
Tag Number: 2546
Collection Date: 11/16/2004
Matrix: LIQUID

Date Received: 11/17/2004

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
Chloroform	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Chloromethane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Dibromochloromethane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Dibromomethane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Ethylbenzene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Isopropylbenzene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
m,p-Xylene	U	2.0		µg/L	1	11/17/2004 5:54:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Methylene chloride	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Naphthalene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
n-Butylbenzene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
n-Propylbenzene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
o-Xylene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Styrene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Tetrachloroethene	27	1.0		µg/L	1	11/17/2004 5:54:00 PM
Toluene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Trichloroethene	1.3	1.0		µg/L	1	11/17/2004 5:54:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Vinyl acetate	U	1.0		µg/L	1	11/17/2004 5:54:00 PM
Vinyl chloride	U	1.0		µg/L	1	11/17/2004 5:54:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 22-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ111604:850 NP2-6
Lab Order:	0411133	Tag Number:	2546
Project:	Rowe Industries	Collection Date:	11/16/2004
Lab ID:	0411133-01B	Date Received:	11/17/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7				Analyst: JP
Iron	3.55	0.0200		mg/L	1	11/18/2004 1:12:11 PM

Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	

American Analytical Laboratories, LLC.

Date: 22-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ111604:850 NP2-6
Lab Order:	0411133	Tag Number:	2546
Project:	Rowe Industries	Collection Date:	11/16/2004
Lab ID:	0411133-01C	Date Received:	11/17/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst: JP
Iron	0.425	0.0200		mg/L	1	11/18/2004 1:10:06 PM

Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	

American Analytical Laboratories, LLC.

Date: 22-Nov-04

CLIENT: Leggett Brashears & Graham Inc.

Client Sample ID: WQ111604:852 NP2-7

Lab Order: 0411133

Tag Number: 2546

Project: Rowe Industries

Collection Date: 11/16/2004

Lab ID: 0411133-02A

Date Received: 11/17/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
2-Butanone	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
2-Hexanone	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Acetone	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Benzene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Bromobenzene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Bromochloromethane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Bromodichloromethane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Bromioform	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Bromomethane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Carbon disulfide	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Chlorobenzene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Chloroethane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 22-Nov-04

CLIENT: Leggett Brashears & Graham Inc. Client Sample ID: WQ111604:852 NP2-7
 Lab Order: 0411133 Tag Number: 2546
 Project: Rowe Industries Collection Date: 11/16/2004
 Lab ID: 0411133-02A Date Received: 11/17/2004 Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
Chloroform	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Chloromethane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Dibromochloromethane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Dibromomethane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Ethylbenzene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Isopropylbenzene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
m,p-Xylene	U	2.0		µg/L	1	11/17/2004 6:26:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Methylene chloride	0.98	1.0	J B	µg/L	1	11/17/2004 6:26:00 PM
Naphthalene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
n-Butylbenzene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
n-Propylbenzene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
o-Xylene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Styrene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Tetrachloroethene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Toluene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Trichloroethene	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Vinyl acetate	U	1.0		µg/L	1	11/17/2004 6:26:00 PM
Vinyl chloride	U	1.0		µg/L	1	11/17/2004 6:26:00 PM

for P 11/22/04

Qualifiers: * Value exceeds Maximum Contaminant Level B Analyte detected in the associated Method Blank
 E Value above quantitation range H Holding times for preparation or analysis exceeded
 J Analyte detected below quantitation limits ND Not Detected at the Reporting Limit
 S Spike Recovery outside accepted recovery limits

American Analytical Laboratories, LLC.

Date: 22-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ111604:852 NP2-7
Lab Order:	0411133	Tag Number:	2546
Project:	Rowe Industries	Collection Date:	11/16/2004
Lab ID:	0411133-02B	Date Received:	11/17/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7				Analyst: JP
Iron	3.38	0.0200		mg/L	1	11/18/2004 1:18:19 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 22-Nov-04

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** WQ111604:852 NP2-7**Lab Order:** 0411133**Tag Number:** 2546**Project:** Rowe Industries**Collection Date:** 11/16/2004**Lab ID:** 0411133-02C**Date Received:** 11/17/2004**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst: JP
Iron	0.111	0.0200		mg/L	1	11/18/2004 1:15:26 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 22-Nov-04

CLIENT: Leggette Brashears & Graham Inc. Client Sample ID: WQ111604:855 NP2-10
 Lab Order: 0411133 Tag Number: 2546
 Project: Rowe Industries Collection Date: 11/16/2004
 Lab ID: 0411133-03A Date Received: 11/17/2004 Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
2-Butanone	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
2-Hexanone	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Acetone	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Benzene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Bromobenzene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Bromochloromethane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Bromodichloromethane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Bromoform	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Bromomethane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Carbon disulfide	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Chlorobenzene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Chloroethane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 22-Nov-04

CLIENT: Leggette Brashears & Graham Inc. **Client Sample ID:** WQ111604:855 NP2-10
Lab Order: 0411133 **Tag Number:** 2546
Project: Rowe Industries **Collection Date:** 11/16/2004
Lab ID: 0411133-03A **Date Received:** 11/17/2004 **Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
Chloroform	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Chloromethane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Dibromochloromethane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Dibromomethane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Ethylbenzene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Isopropylbenzene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
m,p-Xylene	U	2.0		µg/L	1	11/17/2004 6:58:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Methylene chloride	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Naphthalene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
n-Butylbenzene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
n-Propylbenzene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
o-Xylene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Styrene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Tetrachloroethene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Toluene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Trichloroethene	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Vinyl acetate	U	1.0		µg/L	1	11/17/2004 6:58:00 PM
Vinyl chloride	U	1.0		µg/L	1	11/17/2004 6:58:00 PM

Qualifiers:
 * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 22-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ111604:855 NP2-10
Lab Order:	0411133	Tag Number:	2546
Project:	Rowe Industries	Collection Date:	11/16/2004
Lab ID:	0411133-03B	Date Received:	11/17/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7				Analyst: JP
Iron	1.60	0.0200		mg/L	1	11/18/2004 1:38:51 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 22-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ111604:855 NP2-10
Lab Order:	0411133	Tag Number:	2546
Project:	Rowe Industries	Collection Date:	11/16/2004
Lab ID:	0411133-03C	Date Received:	11/17/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst: JP
Iron	0.107	0.0200		mg/L	1	11/18/2004 1:36:45 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: AT
Total Dissolved Solids (Residue, Filterable)	100	1.0		mg/L	1	11/19/2004

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit

Friday, December 03, 2004

Mark Goldberg
Leggette Brashears & Graham Inc.
126 Monroe Turnpike
Trumbull, CT 06611

TEL: (203) 452-3110

FAX (203) 452-3111

RE: Rowe

Order No.: 0411231

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 11/30/2004 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,



Lori Beyer
Lab Director



American Analytical Laboratories, LLC.

Date: 03-Dec-04

CLIENT: Leggette Brashears & Graham Inc.**Project:** Rowe**Lab Order:** 0411231**Work Order Sample Summary**

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0411231-01A	WQ112304:800 NP2-6	2545	11/23/2004	11/30/2004
0411231-01B	WQ112304:800 NP2-6	2545	11/23/2004	11/30/2004
0411231-01C	WQ112304:800 NP2-6	2545	11/23/2004	11/30/2004
0411231-02A	WQ112304:805 NP2-7	2545	11/23/2004	11/30/2004
0411231-02B	WQ112304:805 NP2-7	2545	11/23/2004	11/30/2004
0411231-02C	WQ112304:805 NP2-7	2545	11/23/2004	11/30/2004
0411231-03A	WQ112304:810 NP2-10	2545	11/23/2004	11/30/2004
0411231-03B	WQ112304:810 NP2-10	2545	11/23/2004	11/30/2004
0411231-03C	WQ112304:810 NP2-10	2545	11/23/2004	11/30/2004

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 03-Dec-04

CLIENT: Leggette Brashears & Graham Inc. Client Sample ID: WQ112304:800 NP2-6
 Lab Order: 0411231 Tag Number: 2545
 Project: Rowe Collection Date: 11/23/2004
 Lab ID: 0411231-01A Date Received: 11/30/2004 Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
1,1,1-Trichloroethane	3.6	1.0		µg/L	1	11/30/2004 4:40:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
2-Butanone	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
2-Hexanone	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Acetone	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Benzene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Bromobenzene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Bromochloromethane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Bromodichloromethane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Bromoform	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Bromomethane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Carbon disulfide	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Chlorobenzene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Chloroethane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 03-Dec-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ112304:800 NP2-6
Lab Order:	0411231	Tag Number:	2545
Project:	Rowe	Collection Date:	11/23/2004
Lab ID:	0411231-01A	Date Received:	11/30/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						Analyst: LDS
Chloroform	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Chloromethane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Dibromochloromethane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Dibromomethane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Ethylbenzene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Isopropylbenzene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
m,p-Xylene	U	2.0		µg/L	1	11/30/2004 4:40:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Methylene chloride	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Naphthalene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
n-Butylbenzene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
n-Propylbenzene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
o-Xylene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Styrene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Tetrachloroethene	26	1.0		µg/L	1	11/30/2004 4:40:00 PM
Toluene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Trichloroethene	1.2	1.0		µg/L	1	11/30/2004 4:40:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Vinyl acetate	U	1.0		µg/L	1	11/30/2004 4:40:00 PM
Vinyl chloride	U	1.0		µg/L	1	11/30/2004 4:40:00 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 03-Dec-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ112304:800 NP2-6
Lab Order:	0411231	Tag Number:	2545
Project:	Rowe	Collection Date:	11/23/2004
Lab ID:	0411231-01B	Date Received:	11/30/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	7.26	0.0200		mg/L	1	12/1/2004 12:25:49 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 03-Dec-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ112304:800 NP2-6
Lab Order:	0411231	Tag Number:	2545
Project:	Rowe	Collection Date:	11/23/2004
Lab ID:	0411231-01C	Date Received:	11/30/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.0826	0.0200		mg/L	1	12/1/2004 12:23:12 PM

Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	

American Analytical Laboratories, LLC.

Date: 03-Dec-04

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0411231
Project: Rowe
Lab ID: 0411231-02A

Client Sample ID: WQ112304:805 NP2-7
Tag Number: 2545
Collection Date: 11/23/2004
Matrix: LIQUID

Date Received: 11/30/2004

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
2-Butanone	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
2-Hexanone	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Acetone	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Benzene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Bromobenzene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Bromochloromethane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Bromodichloromethane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Bromoforn	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Bromomethane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Carbon disulfide	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Chlorobenzene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Chloroethane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 03-Dec-04

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0411231
Project: Rowe
Lab ID: 0411231-02A

Client Sample ID: WQ112304:805 NP2-7
Tag Number: 2545
Collection Date: 11/23/2004
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Chloromethane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Dibromochloromethane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Dibromomethane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Ethylbenzene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Isopropylbenzene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
m,p-Xylene	U	2.0		µg/L	1	11/30/2004 5:18:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Methylene chloride	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Naphthalene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
n-Butylbenzene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
n-Propylbenzene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
o-Xylene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Styrene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Tetrachloroethene	0.94	1.0	J	µg/L	1	11/30/2004 5:18:00 PM
Toluene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Trichloroethene	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Vinyl acetate	U	1.0		µg/L	1	11/30/2004 5:18:00 PM
Vinyl chloride	U	1.0		µg/L	1	11/30/2004 5:18:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 03-Dec-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ112304:805 NP2-7
Lab Order:	0411231	Tag Number:	2545
Project:	Rowe	Collection Date:	11/23/2004
Lab ID:	0411231-02B	Date Received:	11/30/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	2.68	0.0200		mg/L	1	12/1/2004 12:30:06 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 03-Dec-04

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** WQ112304:805 NP2-7**Lab Order:** 0411231**Tag Number:** 2545**Project:** Rowe**Collection Date:** 11/23/2004**Lab ID:** 0411231-02C**Date Received:** 11/30/2004**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.107	0.0200		mg/L	1	12/1/2004 12:28:11 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 03-Dec-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ112304:810 NP2-10

Lab Order: 0411231

Tag Number: 2545

Project: Rowe

Collection Date: 11/23/2004

Lab ID: 0411231-03A

Date Received: 11/30/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
2-Butanone	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
2-Hexanone	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Acetone	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Benzene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Bromobenzene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Bromochloromethane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Bromodichloromethane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Bromoform	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Bromomethane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Carbon disulfide	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Chlorobenzene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Chloroethane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.
Date: 03-Dec-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ112304:810 NP2-10
Lab Order:	0411231	Tag Number:	2545
Project:	Rowe	Collection Date:	11/23/2004
Lab ID:	0411231-03A	Date Received:	11/30/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: LDS		
Chloroform	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Chloromethane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Dibromochloromethane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Dibromomethane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Ethylbenzene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Isopropylbenzene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
m,p-Xylene	U	2.0		µg/L	1	11/30/2004 5:51:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Methylene chloride	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Naphthalene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
n-Butylbenzene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
n-Propylbenzene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
o-Xylene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Styrene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Tetrachloroethene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Toluene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Trichloroethene	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Vinyl acetate	U	1.0		µg/L	1	11/30/2004 5:51:00 PM
Vinyl chloride	U	1.0		µg/L	1	11/30/2004 5:51:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 03-Dec-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ112304:810 NP2-10
Lab Order:	0411231	Tag Number:	2545
Project:	Rowe	Collection Date:	11/23/2004
Lab ID:	0411231-03B	Date Received:	11/30/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	0.817	0.0200		mg/L	1	12/1/2004 12:42:02 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 03-Dec-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ112304:810 NP2-10
Lab Order:	0411231	Tag Number:	2545
Project:	Rowe	Collection Date:	11/23/2004
Lab ID:	0411231-03C	Date Received:	11/30/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.111	0.0200		mg/L	1	12/1/2004 12:38:46 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: AT
Total Dissolved Solids (Residue, Filterable)	84	1.0		mg/L	1	11/30/2004

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

REMIT TO: American Analytical Laboratories, LLC.
Accounts Receivable
188 Long Island Avenue
Wyandanch, NY 11798
TEL: (631) 586-2000

INVOICE

INV DATE: November 12, 2004
Print DATE: November 12, 2004

Invoice No: 366404

Invoice TO Leggette Brashears & Graham Inc.
126 Monroe Turnpike
Trumbull, CT 06611

Attn: Accounts Payable
Phone: (203) 452-3110

Work Order 0411072

Order Name Rowe Industries

PO Number:

Date Received 11/5/2004

Item	Remarks	Matrix	Qty	Unit Price	Mult	Quoted	Test Total
DISSOLVED IRON, MANGANESE		Liquid	9	\$60.00	1	\$60.00	\$540.00
HARDNESS		Liquid	9	\$20.00	1	\$20.00	\$180.00
TOTAL DISSOLVED SOLIDS		Liquid	9	\$15.00	1	\$15.00	\$135.00
TOTAL IRON, MANGANESE		Liquid	9	\$50.00	1	\$50.00	\$450.00
VOLATILE SW-846 8260 PLUS MTBE & FREO		Liquid	9	\$100.00	1	\$100.00	\$900.00

Subtotal: \$2,205.00

Discount: 0.00%

Surcharge: 0.00%

Misc Charges: \$0.00

Payment Received: \$0.00

INVOICE Total: \$2,205.00

Interest charge 1.5% per month - 15 days after date on invoice



Friday, November 12, 2004

Mark Goldberg
Leggette Brashears & Graham Inc.
126 Monroe Turnpike
Trumbull, CT 06611

TEL: (203) 452-3110

FAX (203) 452-3111

RE: Rowe Industries

Order No.: 0411072

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 9 sample(s) on 11/5/2004 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,



Lori Beyer
Lab Director



American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.**Project:** Rowe Industries**Lab Order:** 0411072**Work Order Sample Summary**

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0411072-01A	GWQ110304:1100 NP1-1-1	2595	11/3/2004	11/5/2004
0411072-01B	GWQ110304:1100 NP1-1-1	2595	11/3/2004	11/5/2004
0411072-01C	GWQ110304:1100 NP1-1-1	2595	11/3/2004	11/5/2004
0411072-01D	GWQ110304:1100 NP1-1-1	2595	11/3/2004	11/5/2004
0411072-02A	GWQ110304:1100 NP1-1-2	2595	11/3/2004	11/5/2004
0411072-02B	GWQ110304:1100 NP1-1-2	2595	11/3/2004	11/5/2004
0411072-02C	GWQ110304:1100 NP1-1-2	2595	11/3/2004	11/5/2004
0411072-02D	GWQ110304:1100 NP1-1-2	2595	11/3/2004	11/5/2004
0411072-03A	GWQ110304:1120 NP1-1-3	2595	11/3/2004	11/5/2004
0411072-03B	GWQ110304:1120 NP1-1-3	2595	11/3/2004	11/5/2004
0411072-03C	GWQ110304:1120 NP1-1-3	2595	11/3/2004	11/5/2004
0411072-03D	GWQ110304:1120 NP1-1-3	2595	11/3/2004	11/5/2004
0411072-04A	GWQ110304:1130 NP1-1-4	2595	11/3/2004	11/5/2004
0411072-04B	GWQ110304:1130 NP1-1-4	2595	11/3/2004	11/5/2004
0411072-04C	GWQ110304:1130 NP1-1-4	2595	11/3/2004	11/5/2004
0411072-04D	GWQ110304:1130 NP1-1-4	2595	11/3/2004	11/5/2004
0411072-05A	GWQ110304:1140 NP1-1-5	2595	11/3/2004	11/5/2004
0411072-05B	GWQ110304:1140 NP1-1-5	2595	11/3/2004	11/5/2004
0411072-05C	GWQ110304:1140 NP1-1-5	2595	11/3/2004	11/5/2004
0411072-05D	GWQ110304:1140 NP1-1-5	2595	11/3/2004	11/5/2004
0411072-06A	GWQ110304:1150 NP1-1-6	2595	11/3/2004	11/5/2004
0411072-06B	GWQ110304:1150 NP1-1-6	2595	11/3/2004	11/5/2004
0411072-06C	GWQ110304:1150 NP1-1-6	2595	11/3/2004	11/5/2004
0411072-06D	GWQ110304:1150 NP1-1-6	2595	11/3/2004	11/5/2004
0411072-07A	GWQ110304:1200 NP1-1-7	2595	11/3/2004	11/5/2004
0411072-07B	GWQ110304:1200 NP1-1-7	2595	11/3/2004	11/5/2004
0411072-07C	GWQ110304:1200 NP1-1-7	2595	11/3/2004	11/5/2004
0411072-07D	GWQ110304:1200 NP1-1-7	2595	11/3/2004	11/5/2004
0411072-08A	GWQ110304:1210 NP1-1-8	2595	11/3/2004	11/5/2004
0411072-08B	GWQ110304:1210 NP1-1-8	2595	11/3/2004	11/5/2004
0411072-08C	GWQ110304:1210 NP1-1-8	2595	11/3/2004	11/5/2004
0411072-08D	GWQ110304:1210 NP1-1-8	2595	11/3/2004	11/5/2004
0411072-09A	GWQ110304:1220 NP1-1-9	2595	11/3/2004	11/5/2004
0411072-09B	GWQ110304:1220 NP1-1-9	2595	11/3/2004	11/5/2004
0411072-09C	GWQ110304:1220 NP1-1-9	2595	11/3/2004	11/5/2004
0411072-09D	GWQ110304:1220 NP1-1-9	2595	11/3/2004	11/5/2004

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

CLIENT NAME/ADDRESS LBG 126 Monroe Turnpike Trumbull, CT 06611	CONTACT: Mark K Goldberg	SAMPLER (SIGNATURE) Mark M. Goldberg	SAMPLE(S) SEALED YES NO
		SAMPLER NAME (PRINT) Mark M. Goldberg	CORRECT CONTAINER(S) YES NO

PROJECT LOCATION:
Rowe

LABORATORY ID #	MATRIX	# CON-TAINERS	SAMPLING DATE/ TIME	SAMPLE # - LOCATION	ANALYSIS REQUIRED										FOR METHANOL PRESERVED SAMPLES [VOLATILE VIAL #]	
0411071-1	L	5	11/3/04	GWR110304-1100 NPI-1-1	8260	MTBE	From 13	Total + Diss Fe	Total + Diss Mn	Hardness	Turbidity	TDS				
-2	↓	↓	↓	1110 NPI-1-2	↓	↓	↓	↓	↓	↓	↓	↓				
-3	↓	↓	↓	1120 NPI-1-3	↓	↓	↓	↓	↓	↓	↓	↓				
-4	↓	↓	↓	1130 NPI-1-4	↓	↓	↓	↓	↓	↓	↓	↓				
-5	↓	↓	↓	1140 NPI-1-5	↓	↓	↓	↓	↓	↓	↓	↓				
-6	↓	↓	↓	1150 NPI-1-6	↓	↓	↓	↓	↓	↓	↓	↓				
-7	↓	↓	↓	1200 NPI-1-7	↓	↓	↓	↓	↓	↓	↓	↓				
-8	↓	↓	↓	1210 NPI-1-8	↓	↓	↓	↓	↓	↓	↓	↓				
-9	↓	↓	↓	1220 NPI-1-9	↓	↓	↓	↓	↓	↓	↓	↓				

MATRIX S=SOIL; L=LIQUID; SL=SLUDGE; A-AIR; W=WIPE; P=PAINT CHIPS; B=BULK MATERIAL TYPE G=GRAB; C=COMPOSITE, SS=SPLIT SPOON				TURNAROUND REQUIRED: NORMAL ☒ STAT ☐ BY / /		COOLER TEMPERATURE:	
RELINQUISHED BY (SIGNATURE) Mark M. Goldberg				DATE 11/4/04 TIME 16:00		PRINTED NAME Mark Goldberg	
RELINQUISHED BY (SIGNATURE)				DATE		PRINTED NAME	
RECEIVED BY LAB (SIGNATURE) PA				DATE 11/5/04 TIME 1530		PRINTED NAME P. Antonio	
RECEIVED BY LAB (SIGNATURE)				DATE		PRINTED NAME	

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100

FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ110304:1100 NP1-1-1

Lab Order: 0411072

Tag Number: 2595

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411072-01A

Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
2-Butanone	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
2-Hexanone	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Acetone	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Benzene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Bromobenzene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Bromochloromethane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Bromodichloromethane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Bromoform	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Bromomethane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Carbon disulfide	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Chlorobenzene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Chloroethane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ110304:1100 NP1-1-1

Lab Order: 0411072

Tag Number: 2595

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411072-01A Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
Chloroform	1.9	1.0		µg/L	1	11/5/2004 9:03:00 PM
Chloromethane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Dibromochloromethane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Dibromomethane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Ethylbenzene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Isopropylbenzene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
m,p-Xylene	U	2.0		µg/L	1	11/5/2004 9:03:00 PM
Methyl tert-butyl ether	2.0	1.0		µg/L	1	11/5/2004 9:03:00 PM
Methylene chloride	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Naphthalene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
n-Butylbenzene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
n-Propylbenzene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
o-Xylene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Styrene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Tetrachloroethene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Toluene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Trichloroethene	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Vinyl acetate	U	1.0		µg/L	1	11/5/2004 9:03:00 PM
Vinyl chloride	U	1.0		µg/L	1	11/5/2004 9:03:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1100 NP1-1-1
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-01B	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	0.0133	0.0200	J	mg/L	1	11/8/2004 2:18:48 PM
Manganese	0.102	0.0200		mg/L	1	11/8/2004 2:18:48 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ110304:1100 NP1-1-1

Lab Order: 0411072

Tag Number: ~~4~~ 2595 (18)

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411072-01C

Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	U	0.0200		mg/L	1	11/8/2004 2:16:42 PM
Manganese	0.108	0.0200		mg/L	1	11/8/2004 2:16:42 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ110304:1100 NP1-1-1**Lab Order:** 0411072**Tag Number:** x 2595 (JB)**Project:** Rowe Industries**Collection Date:** 11/3/2004**Lab ID:** 0411072-01D**Date Received:** 11/5/2004**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS						Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	54.3	M2340 B 1.00		mg/L	1	11/8/2004
TOTAL DISSOLVED SOLIDS						Analyst: AT
Total Dissolved Solids (Residue, Filterable)	250	E160.1 1.0		mg/L	1	11/8/2004

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ110304:1100 NP1-1-2

Lab Order: 0411072

Tag Number: 2595

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411072-02A

Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1				SW8260B	Analyst: RN	
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
2-Butanone	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
2-Hexanone	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Acetone	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Benzene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Bromobenzene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Bromochloromethane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Bromodichloromethane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Bromoform	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Bromomethane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Carbon disulfide	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Chlorobenzene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Chloroethane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ110304:1100 NP1-1-2

Lab Order: 0411072

Tag Number: 2595

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411072-02A

Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
Chloroform	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Chloromethane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Dibromochloromethane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Dibromomethane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Ethylbenzene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Isopropylbenzene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
m,p-Xylene	U	2.0		µg/L	1	11/5/2004 9:35:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Methylene chloride	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Naphthalene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
n-Butylbenzene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
n-Propylbenzene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
o-Xylene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Styrene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Tetrachloroethene	11	1.0		µg/L	1	11/5/2004 9:35:00 PM
Toluene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Trichloroethene	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Vinyl acetate	U	1.0		µg/L	1	11/5/2004 9:35:00 PM
Vinyl chloride	U	1.0		µg/L	1	11/5/2004 9:35:00 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1100 NP1-1-2
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-02B	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	5.21	0.0200		mg/L	1	11/8/2004 2:23:31 PM
Manganese	1.06	0.0200		mg/L	1	11/8/2004 2:23:31 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1100 NP1-1-2
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-02C	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	0.152	0.0200		mg/L	1	11/8/2004 2:20:55 PM
Manganese	1.13	0.0200		mg/L	1	11/8/2004 2:20:55 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1100 NP1-1-2
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-02D	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS						Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	48.3	1.00		mg/L	1	11/8/2004
TOTAL DISSOLVED SOLIDS						Analyst: AT
Total Dissolved Solids (Residue, Filterable)	83	1.0		mg/L	1	11/8/2004

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ110304:1120 NP1-1-3

Lab Order: 0411072

Tag Number: 2595

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411072-03A

Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1				SW8260B	Analyst: RN	
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
1,1,1-Trichloroethane	2.6	1.0		µg/L	1	11/5/2004 10:07:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
2-Butanone	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
2-Hexanone	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Acetone	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Benzene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Bromobenzene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Bromochloromethane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Bromodichloromethane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Bromoform	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Bromomethane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Carbon disulfide	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Chlorobenzene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Chloroethane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ110304:1120 NP1-1-3

Lab Order: 0411072

Tag Number: 2595

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411072-03A

Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1				SW8260B	Analyst: RN	
Chloroform	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Chloromethane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Dibromochloromethane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Dibromomethane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Ethylbenzene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Isopropylbenzene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
m,p-Xylene	U	2.0		µg/L	1	11/5/2004 10:07:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Methylene chloride	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Naphthalene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
n-Butylbenzene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
n-Propylbenzene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
o-Xylene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Styrene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Tetrachloroethene	1.5	1.0		µg/L	1	11/5/2004 10:07:00 PM
Toluene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Trichloroethene	6.5	1.0		µg/L	1	11/5/2004 10:07:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Vinyl acetate	U	1.0		µg/L	1	11/5/2004 10:07:00 PM
Vinyl chloride	U	1.0		µg/L	1	11/5/2004 10:07:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1120 NP1-1-3
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-03B	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	1.87	0.0200		mg/L	1	11/8/2004 2:28:19 PM
Manganese	0.107	0.0200		mg/L	1	11/8/2004 2:28:19 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1120 NP1-1-3
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-03C	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	1.80	0.0200		mg/L	1	11/8/2004 2:26:11 PM
Manganese	0.108	0.0200		mg/L	1	11/8/2004 2:26:11 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ110304:1120 NP1-1-3

Lab Order: 0411072

Tag Number: 2595

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411072-03D

Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS			M2340 B			Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	39.9	1.00		mg/L	1	11/8/2004
TOTAL DISSOLVED SOLIDS			E160.1			Analyst: AT
Total Dissolved Solids (Residue, Filterable)	62	1.0		mg/L	1	11/8/2004

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ110304:1130 NP1-1-4

Lab Order: 0411072

Tag Number: 2595

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411072-04A Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1				SW8260B		Analyst: RN
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
1,1,1-Trichloroethane	11	1.0		µg/L	1	11/5/2004 10:40:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
2-Butanone	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
2-Hexanone	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Acetone	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Benzene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Bromobenzene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Bromochloromethane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Bromodichloromethane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Bromoform	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Bromomethane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Carbon disulfide	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Chlorobenzene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Chloroethane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ110304:1130 NP1-1-4

Lab Order: 0411072

Tag Number: 2595

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411072-04A

Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
Chloroform	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Chloromethane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Dibromochloromethane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Dibromomethane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Ethylbenzene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Isopropylbenzene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
m,p-Xylene	U	2.0		µg/L	1	11/5/2004 10:40:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Methylene chloride	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Naphthalene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
n-Butylbenzene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
n-Propylbenzene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
o-Xylene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Styrene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Tetrachloroethene	130	1.0		µg/L	1	11/5/2004 10:40:00 PM
Toluene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Trichloroethene	4.2	1.0		µg/L	1	11/5/2004 10:40:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Vinyl acetate	U	1.0		µg/L	1	11/5/2004 10:40:00 PM
Vinyl chloride	U	1.0		µg/L	1	11/5/2004 10:40:00 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1130 NP1-1-4
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-04B	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	4.75	0.0200		mg/L	1	11/8/2004 2:32:56 PM
Manganese	1.26	0.0200		mg/L	1	11/8/2004 2:32:56 PM

Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1130 NP1-1-4
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-04C	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	0.205	0.0200		mg/L	1	11/8/2004 2:30:35 PM
Manganese	1.31	0.0200		mg/L	1	11/8/2004 2:30:35 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1130 NP1-1-4
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-04D	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS			M2340 B			Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	32.1	1.00		mg/L	1	11/8/2004
TOTAL DISSOLVED SOLIDS			E160.1			Analyst: AT
Total Dissolved Solids (Residue, Filterable)	56	1.0		mg/L	1	11/8/2004

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ110304:1140 NP1-1-5

Lab Order: 0411072

Tag Number: 2595

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411072-05A

Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
1,1,1-Trichloroethane	6.4	1.0		µg/L	1	11/5/2004 11:12:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
2-Butanone	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
2-Hexanone	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Acetone	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Benzene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Bromobenzene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Bromochloromethane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Bromodichloromethane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Bromoform	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Bromomethane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Carbon disulfide	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Chlorobenzene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Chloroethane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1140 NP1-1-5
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-05A	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
Chloroform	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Chloromethane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Dibromochloromethane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Dibromomethane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Ethylbenzene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Isopropylbenzene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
m,p-Xylene	U	2.0		µg/L	1	11/5/2004 11:12:00 PM
Methyl tert-butyl ether	2.2	1.0		µg/L	1	11/5/2004 11:12:00 PM
Methylene chloride	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Naphthalene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
n-Butylbenzene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
n-Propylbenzene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
o-Xylene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Styrene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Tetrachloroethene	15	1.0		µg/L	1	11/5/2004 11:12:00 PM
Toluene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Trichloroethene	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Vinyl acetate	U	1.0		µg/L	1	11/5/2004 11:12:00 PM
Vinyl chloride	U	1.0		µg/L	1	11/5/2004 11:12:00 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1140 NP1-1-5
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-05B	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	0.0287	0.0200		mg/L	1	11/8/2004 2:45:55 PM
Manganese	U	0.0200		mg/L	1	11/8/2004 2:45:55 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1140 NP1-1-5
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-05C	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	0.0119	0.0200	J	mg/L	1	11/8/2004 2:42:50 PM
Manganese	U	0.0200		mg/L	1	11/8/2004 2:42:50 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1140 NP1-1-5
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-05D	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS						Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	34.1	1.00		mg/L	1	11/8/2004
TOTAL DISSOLVED SOLIDS						Analyst: AT
Total Dissolved Solids (Residue, Filterable)	99	1.0		mg/L	1	11/8/2004

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ110304:1150 NP1-1-6

Lab Order: 0411072

Tag Number: 2595

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411072-06A

Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						Analyst: RN
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
1,1,1-Trichloroethane	2.4	1.0		µg/L	1	11/5/2004 11:44:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
2-Butanone	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
2-Hexanone	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Acetone	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Benzene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Bromobenzene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Bromochloromethane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Bromodichloromethane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Bromoform	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Bromomethane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Carbon disulfide	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Chlorobenzene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Chloroethane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ110304:1150 NP1-1-6

Lab Order: 0411072

Tag Number: 2595

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411072-06A

Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
Chloroform	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Chloromethane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Dibromochloromethane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Dibromomethane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Ethylbenzene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Isopropylbenzene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
m,p-Xylene	U	2.0		µg/L	1	11/5/2004 11:44:00 PM
Methyl tert-butyl ether	2.5	1.0		µg/L	1	11/5/2004 11:44:00 PM
Methylene chloride	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Naphthalene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
n-Butylbenzene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
n-Propylbenzene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
o-Xylene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Styrene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Tetrachloroethene	94	1.0		µg/L	1	11/5/2004 11:44:00 PM
Toluene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Trichloroethene	2.1	1.0		µg/L	1	11/5/2004 11:44:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Vinyl acetate	U	1.0		µg/L	1	11/5/2004 11:44:00 PM
Vinyl chloride	U	1.0		µg/L	1	11/5/2004 11:44:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ110304:1150 NP1-1-6**Lab Order:** 0411072**Tag Number:** 2595**Project:** Rowe Industries**Collection Date:** 11/3/2004**Lab ID:** 0411072-06B**Date Received:** 11/5/2004**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	0.0111	0.0200	J	mg/L	1	11/8/2004 2:49:45 PM
Manganese	0.276	0.0200		mg/L	1	11/8/2004 2:49:45 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1150 NP1-1-6
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-06C	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	U	0.0200		mg/L	1	11/8/2004 2:47:51 PM
Manganese	0.281	0.0200		mg/L	1	11/8/2004 2:47:51 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1150 NP1-1-6
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-06D	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS						Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	36.8	1.00		mg/L	1	11/8/2004
TOTAL DISSOLVED SOLIDS						Analyst: AT
Total Dissolved Solids (Residue, Filterable)	U	1.0		mg/L	1	11/8/2004

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ110304:1200 NP1-1-7

Lab Order: 0411072

Tag Number: 2595

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411072-07A

Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						Analyst: RN
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
2-Butanone	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
2-Hexanone	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Acetone	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Benzene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Bromobenzene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Bromochloromethane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Bromodichloromethane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Bromoform	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Bromomethane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Carbon disulfide	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Chlorobenzene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Chloroethane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ110304:1200 NP1-1-7

Lab Order: 0411072

Tag Number: 2595

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411072-07A

Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
Chloroform	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Chloromethane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Dibromochloromethane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Dibromomethane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Ethylbenzene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Isopropylbenzene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
m,p-Xylene	U	2.0		µg/L	1	11/6/2004 12:16:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Methylene chloride	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Naphthalene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
n-Butylbenzene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
n-Propylbenzene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
o-Xylene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Styrene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Tetrachloroethene	36	1.0		µg/L	1	11/6/2004 12:16:00 AM
Toluene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Trichloroethene	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Vinyl acetate	U	1.0		µg/L	1	11/6/2004 12:16:00 AM
Vinyl chloride	U	1.0		µg/L	1	11/6/2004 12:16:00 AM

Qualifiers: *

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank

H Holding times for preparation or analysis exceeded

ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1200 NP1-1-7
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-07B	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	0.0214	0.0200		mg/L	1	11/8/2004 2:55:00 PM
Manganese	0.0474	0.0200		mg/L	1	11/8/2004 2:55:00 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1200 NP1-1-7
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-07C	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	0.0108	0.0200	J	mg/L	1	11/8/2004 2:52:18 PM
Manganese	0.0468	0.0200		mg/L	1	11/8/2004 2:52:18 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1200 NP1-1-7
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-07D	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS						Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	29.7	1.00	M2340 B	mg/L	1	11/8/2004
TOTAL DISSOLVED SOLIDS						Analyst: AT
Total Dissolved Solids (Residue, Filterable)	61	1.0	E160.1	mg/L	1	11/8/2004

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ110304:1210 NP1-1-8

Lab Order: 0411072

Tag Number: 2595

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411072-08A

Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
1,1,1-Trichloroethane	4.0	1.0		µg/L	1	11/6/2004 12:48:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
1,1-Dichloroethane	3.5	1.0		µg/L	1	11/6/2004 12:48:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
2-Butanone	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
2-Hexanone	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Acetone	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Benzene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Bromobenzene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Bromochloromethane	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Bromodichloromethane	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Bromoform	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Bromomethane	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Carbon disulfide	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Chlorobenzene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Chloroethane	U	1.0		µg/L	1	11/6/2004 12:48:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ110304:1210 NP1-1-8

Lab Order: 0411072

Tag Number: 2595

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411072-08A

Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
Chloroform	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Chloromethane	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Dibromochloromethane	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Dibromomethane	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Ethylbenzene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Isopropylbenzene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
m,p-Xylene	U	2.0		µg/L	1	11/6/2004 12:48:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Methylene chloride	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Naphthalene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
n-Butylbenzene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
n-Propylbenzene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
o-Xylene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Styrene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Tetrachloroethene	5.3	1.0		µg/L	1	11/6/2004 12:48:00 AM
Toluene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Trichloroethene	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Vinyl acetate	U	1.0		µg/L	1	11/6/2004 12:48:00 AM
Vinyl chloride	U	1.0		µg/L	1	11/6/2004 12:48:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1210 NP1-1-8
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-08B	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	10.6	0.0200		mg/L	1	11/8/2004 3:00:15 PM
Manganese	0.514	0.0200		mg/L	1	11/8/2004 3:00:15 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ110304:1210 NP1-1-8**Lab Order:** 0411072**Tag Number:** 2595**Project:** Rowe Industries**Collection Date:** 11/3/2004**Lab ID:** 0411072-08C**Date Received:** 11/5/2004**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	0.271	0.0200		mg/L	1	11/8/2004 2:57:36 PM
Manganese	0.508	0.0200		mg/L	1	11/8/2004 2:57:36 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1210 NP1-1-8
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-08D	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS						Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	24.3	1.00		mg/L	1	11/8/2004
TOTAL DISSOLVED SOLIDS						Analyst: AT
Total Dissolved Solids (Residue, Filterable)	52	1.0		mg/L	1	11/8/2004

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ110304:1220 NP1-1-9

Lab Order: 0411072

Tag Number: 2595

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411072-09A

Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
1,1,1-Trichloroethane	5.9	1.0		µg/L	1	11/6/2004 1:20:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
1,1-Dichloroethane	1.6	1.0		µg/L	1	11/6/2004 1:20:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
2-Butanone	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
2-Hexanone	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Acetone	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Benzene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Bromobenzene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Bromochloromethane	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Bromodichloromethane	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Bromoform	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Bromomethane	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Carbon disulfide	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Chlorobenzene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Chloroethane	U	1.0		µg/L	1	11/6/2004 1:20:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ110304:1220 NP1-1-9

Lab Order: 0411072

Tag Number: 2595

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411072-09A Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: RN		
Chloroform	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Chloromethane	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Dibromochloromethane	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Dibromomethane	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Ethylbenzene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Isopropylbenzene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
m,p-Xylene	U	2.0		µg/L	1	11/6/2004 1:20:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Methylene chloride	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Naphthalene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
n-Butylbenzene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
n-Propylbenzene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
o-Xylene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Styrene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Tetrachloroethene	1.6	1.0		µg/L	1	11/6/2004 1:20:00 AM
Toluene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Trichloroethene	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Vinyl acetate	U	1.0		µg/L	1	11/6/2004 1:20:00 AM
Vinyl chloride	U	1.0		µg/L	1	11/6/2004 1:20:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ110304:1220 NP1-1-9

Lab Order: 0411072

Tag Number: 2595

Project: Rowe Industries

Collection Date: 11/3/2004

Lab ID: 0411072-09B

Date Received: 11/5/2004

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	2.97	0.0200		mg/L	1	11/8/2004 3:05:32 PM
Manganese	0.941	0.0200		mg/L	1	11/8/2004 3:05:32 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ110304:1220 NP1-1-9
Lab Order:	0411072	Tag Number:	2595
Project:	Rowe Industries	Collection Date:	11/3/2004
Lab ID:	0411072-09C	Date Received:	11/5/2004
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	1.41	0.0200		mg/L	1	11/8/2004 3:02:52 PM
Manganese	0.957	0.0200		mg/L	1	11/8/2004 3:02:52 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

American Analytical Laboratories, LLC.

Date: 12-Nov-04

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ110304:1220 NP1-1-9**Lab Order:** 0411072**Tag Number:** 2595**Project:** Rowe Industries**Collection Date:** 11/3/2004**Lab ID:** 0411072-09D**Date Received:** 11/5/2004**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS						Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	26.7	1.00	M2340 B	mg/L	1	11/8/2004
TOTAL DISSOLVED SOLIDS						Analyst: AT
Total Dissolved Solids (Residue, Filterable)	64	1.0	E160.1	mg/L	1	11/8/2004

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit

ANALYTICAL REPORT

JOB NUMBER: 207990

Prepared For:

LEGGETTE, BRASHEARS & GRAHAM
126 Monroe Turnpike
Trumbull, CT 06611

Project: ROWE INDUSTRIES

Attention: Mark Goldberg

Date: 11/19/2004



Signature

Name: William D. Goodman

Title: Project Manager

E-Mail: wgoodman@stl-inc.com



Date

STL Connecticut
128 Long Hill Cross Road
Shelton, CT 06484

This Report Contains (123) Pages

STL Report : 207990
LEGGETTE, BRASHEARS, & GRAHAM

Case Narrative

Sample Receipt – All samples were received in good condition.

Volatile Organics – Air volatile organics were determined by purge and trap GC/MS using guidance provided in Method TO-17.

Sample Calculation:

Sample ID- AQ110304:945NP4-1
Compound-Bromomethane

$$\frac{(1201464)(25)}{(1258686)(.313)} = 76.24 = 76 \text{ ng}$$

$$\frac{(76\text{NG})(.08206)(298)}{(.5\text{L})(95)(1.0\text{ATM})} = 39.12 = 39.1 \text{ nL/L.}$$

Sample AQ110304:945NP4-1 was analyzed at a sample volume of .5L for high targets. The target compound, tetrachloroethene, was still above the calibration curve despite the lower sample volume. This compound was flagged with an "A".

The test results in this report meet all NELAP requirements for parameters for which accreditation is required or available. Any exceptions to NELAP requirements are noted in the case narrative.

Date: 11/19/2004

Project Number.....: 20000283
Customer Project ID....: ROWE INDUSTRIES
Project Description....: Rowe Industries

Laboratory Sample ID	Customer Sample ID	Sample Matrix	Date Sampled	Time Sampled	Date Received	Time Received
207990-1	AQ110304:945NP4-1	Air	11/03/2004	00:00	11/04/2004	13:20
207990-2	AQ110304:947NP4-2	Air	11/03/2004	00:00	11/04/2004	13:20
207990-3	AQ110304:950NP4-3	Air	11/03/2004	00:00	11/04/2004	13:20

STL Connecticut		Form 1		
		Client Sample ID	NP4-1	
Method: TO17		Lab Sample ID	207990-1	
Sample Volume (L)	0.500	Date Sampled	11/3/2004	
Temp (C)	25	Date Analyzed	11/10/2004	
Compound	nL/L (ppbv/v) Qualifier	RL	mg/M3 Qualifier	RL
Chloromethane	2.9 JB	19.4	0.0060 JB	0.040
Vinyl Chloride	15.7 U	15.7	0.0400 U	0.040
Bromomethane	39.1 B	10.3	0.1520 B	0.040
Chloroethane	15.2 U	15.2	0.0400 U	0.040
1,1-Dichloroethene	2.5 J	5.0	0.0100 J	0.020
Carbon Disulfide	6.4	6.4	0.0200	0.020
Methylene Chloride	28.8 B	5.8	0.1000 B	0.020
trans-1,2-Dichloroethene	5.1 U	5.1	0.0200 U	0.020
1,1-Dichloroethane	5.4	4.9	0.0220	0.020
cis-1,2-Dichloroethene	1.0 J	5.1	0.0040 J	0.020
Chloroform	1.6 J	4.1	0.0080 J	0.020
1,1,1-Trichloroethane	13.6	3.7	0.0740	0.020
Carbon Tetrachloride	3.2 U	3.2	0.0200 U	0.020
Benzene	2.5 JB	6.3	0.0080 JB	0.020
1,2-Dichloroethane	4.9 U	4.9	0.0200 U	0.020
Trichloroethene	6.0	3.7	0.0320	0.020
1,2-Dichloropropane	4.3 U	4.3	0.0200 U	0.020
Bromodichloromethane	3.0 U	3.0	0.0200 U	0.020
cis-1,3-Dichloropropene	4.4 U	4.4	0.0200 U	0.020
Toluene	5.3	5.3	0.0200	0.020
trans-1,3-Dichloropropene	4.4 U	4.4	0.0200 U	0.020
1,1,2-Trichloroethane	3.7 U	3.7	0.0200 U	0.020
Tetrachloroethene	64.8 A	2.9	0.4400 A	0.020
Dibromochloromethane	2.4 U	2.4	0.0200 U	0.020
Chlorobenzene	4.3 U	4.3	0.0200 U	0.020
Ethylbenzene	4.6 U	4.6	0.0200 U	0.020
m&p-Xylenes	0.4 J	4.6	0.0018 J	0.020
o-Xylene	4.6 U	4.6	0.0200 U	0.020
Styrene	0.3 J	4.7	0.0012 J	0.020
Bromoform	1.9 U	1.9	0.0200 U	0.020
1,1,2,2-Tetrachloroethane	2.9 U	2.9	0.0200 U	0.020

STL Connecticut		Form 1		
		Client Sample ID	NP4-2	
Method: TO17		Lab Sample ID	207990-2	
Sample Volume (L)	1.000	Date Sampled	11/3/2004	
Temp (C)	25	Date Analyzed	11/10/2004	
Compound	nL/L (ppbv/v) Qualifier	RL	mg/M3 Qualifier	RL
Chloromethane	2.4 JB	9.7	0.0050 JB	0.020
Vinyl Chloride	7.8 U	7.8	0.0200 U	0.020
Bromomethane	6.7 B	5.1	0.0260 B	0.020
Chloroethane	7.6 U	7.6	0.0200 U	0.020
1,1-Dichloroethene	1.8 J	2.5	0.0070 J	0.010
Carbon Disulfide	5.8	3.2	0.0180	0.010
Methylene Chloride	9.8 B	2.9	0.0340 B	0.010
trans-1,2-Dichloroethene	2.5 U	2.5	0.0100 U	0.010
1,1-Dichloroethane	3.5	2.5	0.0140	0.010
cis-1,2-Dichloroethene	2.5 U	2.5	0.0100 U	0.010
Chloroform	2.1 U	2.1	0.0100 U	0.010
1,1,1-Trichloroethane	1.8 U	1.8	0.0100 U	0.010
Carbon Tetrachloride	1.6 U	1.6	0.0100 U	0.010
Benzene	1.6 JB	3.1	0.0050 JB	0.010
1,2-Dichloroethane	2.5 U	2.5	0.0100 U	0.010
Trichloroethene	1.9 U	1.9	0.0100 U	0.010
1,2-Dichloropropane	2.2 U	2.2	0.0100 U	0.010
Bromodichloromethane	1.5 U	1.5	0.0100 U	0.010
cis-1,3-Dichloropropene	2.2 U	2.2	0.0100 U	0.010
Toluene	5.8	2.7	0.0220	0.010
trans-1,3-Dichloropropene	2.2 U	2.2	0.0100 U	0.010
1,1,2-Trichloroethane	1.8 U	1.8	0.0100 U	0.010
Tetrachloroethene	2.2	1.5	0.0150	0.010
Dibromochloromethane	1.2 U	1.2	0.0100 U	0.010
Chlorobenzene	2.2 U	2.2	0.0100 U	0.010
Ethylbenzene	0.1 J	2.3	0.0004 J	0.010
m&p-Xylenes	0.5 J	2.3	0.0020 J	0.010
o-Xylene	0.1 J	2.3	0.0004 J	0.010
Styrene	0.5 J	2.4	0.0020 J	0.010
Bromoform	1.0 U	1.0	0.0100 U	0.010
1,1,2,2-Tetrachloroethane	1.5 U	1.5	0.0100 U	0.010

STL Connecticut		Form 1	
		Client Sample ID	NP4-3
Method: TO17		Lab Sample ID	207990-3
Sample Volume (L)	1.000	Date Sampled	11/3/2004
Temp (C)	25	Date Analyzed	11/10/2004

Compound	nL/L (ppbv/v) Qualifier	RL	mg/M3 Qualifier	RL
Chloromethane	9.7 U	9.7	0.0200 U	0.020
Vinyl Chloride	7.8 U	7.8	0.0200 U	0.020
Bromomethane	5.7 B	5.1	0.0220 B	0.020
Chloroethane	7.6 U	7.6	0.0200 U	0.020
1,1-Dichloroethene	0.5 J	2.5	0.0020 J	0.010
Carbon Disulfide	5.5	3.2	0.0170	0.010
Methylene Chloride	9.2 B	2.9	0.0320 B	0.010
trans-1,2-Dichloroethene	2.5 U	2.5	0.0100 U	0.010
1,1-Dichloroethane	2.5 U	2.5	0.0100 U	0.010
cis-1,2-Dichloroethene	2.5 U	2.5	0.0100 U	0.010
Chloroform	2.1 U	2.1	0.0100 U	0.010
1,1,1-Trichloroethane	1.8 U	1.8	0.0100 U	0.010
Carbon Tetrachloride	1.6 U	1.6	0.0100 U	0.010
Benzene	1.6 JB	3.1	0.0050 JB	0.010
1,2-Dichloroethane	2.5 U	2.5	0.0100 U	0.010
Trichloroethene	1.9 U	1.9	0.0100 U	0.010
1,2-Dichloropropane	2.2 U	2.2	0.0100 U	0.010
Bromodichloromethane	1.5 U	1.5	0.0100 U	0.010
cis-1,3-Dichloropropene	2.2 U	2.2	0.0100 U	0.010
Toluene	5.8	2.7	0.0220	0.010
trans-1,3-Dichloropropene	2.2 U	2.2	0.0100 U	0.010
1,1,2-Trichloroethane	1.8 U	1.8	0.0100 U	0.010
Tetrachloroethene	0.7 J	1.5	0.0050 J	0.010
Dibromochloromethane	1.2 U	1.2	0.0100 U	0.010
Chlorobenzene	2.2 U	2.2	0.0100 U	0.010
Ethylbenzene	0.1 J	2.3	0.0005 J	0.010
m&p-Xylenes	0.5 J	2.3	0.0020 J	0.010
o-Xylene	0.1 J	2.3	0.0004 J	0.010
Styrene	0.5 J	2.4	0.0020 J	0.010
Bromoform	1.0 U	1.0	0.0100 U	0.010
1,1,2,2-Tetrachloroethane	1.5 U	1.5	0.0100 U	0.010

LABORATORY CHRONICLE

Job Number: 207990

Date: 11/19/2004

CUSTOMER: LEGGETTE, BRASHEARS & GRAHAM

PROJECT: ROME INDUSTRIES

ATTN: Mark Goldberg

Lab ID: 207990-1	Client ID: AQ110304:945NP4-1	Date Recvd: 11/04/2004	Sample Date: 11/03/2004	
METHOD	DESCRIPTION	RUN# BATCH# PREP BT #(S)	DATE/TIME ANALYZED	DILUTION
T017	Volatile Organics (Air)	1 40804		
Lab ID: 207990-2	Client ID: AQ110304:947NP4-2	Date Recvd: 11/04/2004	Sample Date: 11/03/2004	
METHOD	DESCRIPTION	RUN# BATCH# PREP BT #(S)	DATE/TIME ANALYZED	DILUTION
T017	Volatile Organics (Air)	1 40804		
Lab ID: 207990-3	Client ID: AQ110304:950NP4-3	Date Recvd: 11/04/2004	Sample Date: 11/03/2004	
METHOD	DESCRIPTION	RUN# BATCH# PREP BT #(S)	DATE/TIME ANALYZED	DILUTION
T017	Volatile Organics (Air)	1 40804		

AIR

2A

WATER VOLATILE SYSTEM MONITORING COMPOUND RECOVERY

Dm 11/17/01

Lab Name: STL-CT

Contract:

Lab Code: STL-CT

Case No.: 207990 SAS No.:

SDG No.: 207990

	EPA SAMPLE NO.	SMC1 #	SMC2 (DCE) #	SMC3 (TOL) #	OTHER (BFB) #	TOT OUT
01	VBLKTD	112	91	102	95	
02	LCS	108	96	100	96	
03	NP4-2	109	89	101	89	
04	NP4-3	105	87	101	91	
05	NP4-1	106	86	103	94	
06						
07						
08						
09						
10						
11						
12						
13						
14						
15						
16						
17						
18						
19						
20						
21						
22						
23						
24						
25						
26						
27						
28						
29						
30						

QC LIMITS
 SMC1 = Dibromofluoromethane (70-130)
 SMC2 (DCE) = 1,2-Dichloroethane-d4 (70-130)
 SMC3 (TOL) = Toluene-d8 (70-130)
 OTHER (BFB) = Bromofluorobenzene (70-130)

Column to be used to flag recovery values

* Values outside of contract required QC limits

D System Monitoring Compound diluted out

FORM 3

Data File: \\TARGET1 CT\\Files\\chem\\VOA\\mst.i\\T043734.b\\T3739.D Page 3
 Report Date: 12-Nov-2004 17:12

STL-CT

RECOVERY REPORT

Client Name:
 Sample Matrix: LIQUID
 Lab Smp Id: LCS
 Level: LOW
 Data Type: MS DATA
 SpikeList File: AIRQCS.spk
 Sublist File: all.sub
 Method File: \\TARGET1 CT\\Files\\chem\\VOA\\mst.i\\T043734.b\\TAIRFULL.m
 Misc Info: : LCS;;; 020_ppbQCS ; TO-17; * 1L* ; AIR

Client SDG: SDGa24843
 Fraction: VOA
 Client Smp ID: LCS
 Operator: M.Crowe
 SampleType: LCS
 Quant Type: ISTD

SPIKE COMPOUND	CONC ADDED ug/L	CONC RECOVERED ug/L	% RECOVERED	LIMITS
4 Vinyl Chloride	20	15	76.60	60-140
5 Bromomethane	20	16	82.46	60-140
6 Chloroethane	20	15	73.99	60-140
12 1,1-Dichloroethene	20	21	106.12	60-140
11 Trichlorotrifluoro	20	18	91.51	60-140
17 Acetone	20	18	90.31	60-140
13 Carbon Disulfide	20	18	89.08	60-140
16 Methylene Chloride	20	16	82.38	60-140
18 trans-1,2-Dichloro	20	21	105.52	60-140
28 1,1-Dichloroethane	20	18	91.46	60-140
30 cis-1,2-Dichloroet	20	19	95.79	60-140
40 2-Butanone	20	22	107.76	60-140
33 Chloroform	20	20	98.01	60-140
38 1,1,1-Trichloroeth	20	22	108.53	60-140
39 Carbon Tetrachlori	20	25	126.40	60-140
51 1,2-Dichloroethane	20	21	104.78	60-140
48 Benzene	20	20	97.83	60-140
56 Trichloroethene	20	20	101.50	60-140
63 cis-1,3-Dichloropr	20	19	93.12	60-140
72 4-Methyl-2-Pentano	20	15	72.76	60-140
69 Toluene	20	19	94.28	60-140
66 trans-1,3-Dichloro	20	16	80.88	60-140
67 1,1,2-Trichloroeth	20	19	94.90	60-140
73 Tetrachloroethene	20	21	104.26	60-140
75 Dibromochlorometha	20	20	102.26	60-140
80 Chlorobenzene	20	20	98.98	60-140
82 Ethylbenzene	20	19	97.24	60-140
83 Xylene (total)mp	40	39	97.15	60-140
84 Xylene (total)o	20	20	98.53	60-140
85 Styrene	20	18	88.33	60-140
86 Bromoform	20	20	101.18	60-140
89 1,1,2,2-Tetrachlor	20	18	90.12	60-140
101 1,3-Dichlorobenzen	20	19	94.26	60-140
102 1,4-Dichlorobenzen	20	21	104.89	60-140
103 1,2-Dichlorobenzen	20	20	101.37	60-140

AIR

2A

WATER VOLATILE SYSTEM MONITORING COMPOUND RECOVERY

Don 11/17/04

Lab Name: STL-CT

Contract:

Lab Code: STL-CT

Case No.: 207990 SAS No.:

SDG No.: 207990

	EPA SAMPLE NO.	SMC1 #	SMC2 (DCE) #	SMC3 (TOL) #	OTHER (BFB) #	TOT OUT
01	VBLKTD	112	91	102	95	
02	LCS	108	96	100	96	
03	NP4-2	109	89	101	89	
04	NP4-3	105	87	101	91	
05	NP4-1	106	86	103	94	
06						
07						
08						
09						
10						
11						
12						
13						
14						
15						
16						
17						
18						
19						
20						
21						
22						
23						
24						
25						
26						
27						
28						
29						
30						

QC LIMITS
 SMC1 = Dibromofluoromethane (70-130)
 SMC2 (DCE) = 1,2-Dichloroethane-d4 (70-130)
 SMC3 (TOL) = Toluene-d8 (70-130)
 OTHER (BFB) = Bromofluorobenzene (70-130)

Column to be used to flag recovery values

* Values outside of contract required QC limits

D System Monitoring Compound diluted out

FORM 3

Data File: \\TARGET1 CT\\Files\\chem\\VOA\\mst.i\\T043734.b\\T3739.D Page 3
Report Date: 12-Nov-2004 17:12

STL-CT

RECOVERY REPORT

Client Name: Client SDG: SDGa24843
Sample Matrix: LIQUID Fraction: VOA
Lab Smp Id: LCS Client Smp ID: LCS
Level: LOW Operator: M.Crowe
Data Type: MS DATA SampleType: LCS
SpikeList File: AIRQCS.spk Quant Type: ISTD
Sublist File: all.sub
Method File: \\TARGET1 CT\\Files\\chem\\VOA\\mst.i\\T043734.b\\TAIRFULL.m
Misc Info: : LCS;;; 020_ppbQCS ; TO-17; * 1L* ; AIR

SPIKE COMPOUND	CONC ADDED ug/L	CONC RECOVERED ug/L	% RECOVERED	LIMITS
4 Vinyl Chloride	20	15	76.60	60-140
5 Bromomethane	20	16	82.46	60-140
6 Chloroethane	20	15	73.99	60-140
12 1,1-Dichloroethene	20	21	106.12	60-140
11 Trichlorotrifluoro	20	18	91.51	60-140
17 Acetone	20	18	90.31	60-140
13 Carbon Disulfide	20	18	89.08	60-140
16 Methylene Chloride	20	16	82.38	60-140
18 trans-1,2-Dichloro	20	21	105.52	60-140
28 1,1-Dichloroethane	20	18	91.46	60-140
30 cis-1,2-Dichloroet	20	19	95.79	60-140
40 2-Butanone	20	22	107.76	60-140
33 Chloroform	20	20	98.01	60-140
38 1,1,1-Trichloroeth	20	22	108.53	60-140
39 Carbon Tetrachlori	20	25	126.40	60-140
51 1,2-Dichloroethane	20	21	104.78	60-140
48 Benzene	20	20	97.83	60-140
56 Trichloroethene	20	20	101.50	60-140
63 cis-1,3-Dichloropr	20	19	93.12	60-140
72 4-Methyl-2-Pentano	20	15	72.76	60-140
69 Toluene	20	19	94.28	60-140
66 trans-1,3-Dichloro	20	16	80.88	60-140
67 1,1,2-Trichloroeth	20	19	94.90	60-140
73 Tetrachloroethene	20	21	104.26	60-140
75 Dibromochlorometha	20	20	102.26	60-140
80 Chlorobenzene	20	20	98.98	60-140
82 Ethylbenzene	20	19	97.24	60-140
83 Xylene (total)mp	40	39	97.15	60-140
84 Xylene (total)o	20	20	98.53	60-140
85 Styrene	20	18	88.33	60-140
86 Bromoform	20	20	101.18	60-140
89 1,1,2,2-Tetrachlor	20	18	90.12	60-140
101 1,3-Dichlorobenzen	20	19	94.26	60-140
102 1,4-Dichlorobenzen	20	21	104.89	60-140
103 1,2-Dichlorobenzen	20	20	101.37	60-140

QUALITY ASSURANCE METHODS

REFERENCES AND NOTES

Report Date: 11/19/2004

REPORT COMMENTS

- 1) All pages of this report are integral parts of the analytical data. Therefore, this report should be reproduced only in its entirety.
- 2) Soil, sediment and sludge sample results are reported on a "dry weight" basis except when analyzed for landfill disposal or incineration parameters. All other solid matrix samples are reported on an "as received" basis unless noted differently.
- 3) Reporting limits are adjusted for sample size used, dilutions and moisture content if applicable.
- 4) The test results for the noted analytical method(s) meet the requirements of NELAC. Lab Cert. ID# 10604
- 5) According to 40CFR Part 136.3, pH, Chlorine Residual and Dissolved Oxygen analyses are to be performed immediately after aqueous sample collection. When these parameters are not indicated as field (e.g. pH Field) they were not analyzed immediately, but as soon as possible on laboratory receipt.

Glossary of flags, qualifiers and abbreviation

Inorganic Qualifiers (Q-Column)

- U Analyte was not detected at or above the reporting limit.
- < Not detected at or above the reporting limit.
- J Result is less than the RL, but greater than or equal to the method detection limit.
- B Result is less than the CRDL/RL, but greater than or equal to the IDL/MDL.
- S Result was determined by the Method of Standard Additions.

Inorganic Flags (Flag Column)

- ICV,CCV,ICB,CCB,ISA,ISB,CRI,CRA,MRL: Instrument related QC exceed th upper or lower control limits.
- * LCS, LCD, MD: Batch QC exceeds the upper or lower control limits.
- + MSA correlation coefficient is less than 0.995.
- 4 MS, MSD: The analyte present in the original sample is 4 times greater than the matrix spike concentration; therefore, control limits are not applicable.
- E SD: Serial dilution exceeds the control limits.
- H MB, EB: Batch QC is greater than reporting limit or had a negative instrument reading lower than the absolute value of the reporting limit.
- N MS, MSD: Spike recovery exceeds the upper or lower control limits.
- W PS: Post-digestion spike was outside 85-115% control limits.

Organic Qualifiers (Q - Column)

- U Analyte was not detected at or above the reporting limit.
- ND Compound not detected.
- J Result is an estimated value below the reporting limit or a tentatively identified compound (TIC).
- Q Result was qualitatively confirmed, but not quantified.
- C Pesticide identification was confirmed by GC/MS.
- Y The chromatographic response resembles a typical fuel pattern.
- Z The chromatographic response does not resemble a typical fuel pattern.
- E Result exceeded calibration range, secondary dilution required.

Organic Flags (Flags Column)

- MB,EB, MLE: Batch QC is greater than reporting limit.
- * LCS, LCD, CCV, MS, MSD, Surrogate, RS:Batch QC exceeds the upper or lower control limits.
- A Concentration exceeds the instrument calibration range or below the reporting limit.
- B Compound was found in the blank.
- D Surrogate or matrix spike recoveries were not obtained because the extract was diluted for analysis; also compounds analyzed at a dilution will be flagged with a D.
- H Alternate peak selection upon analytical review
- I Indicates the presence of an interference, recovery is not calculated.
- M Manually integrated compound.
- P The lower of the two values is reported when the % difference between the results of two GC columns is greater than 25%.

QUALITY ASSURANCE METHODS

REFERENCES AND NOTES

Report Date: 11/19/2004

Abbreviations

Batch	Designation given to identify a specific extraction, digestion, preparation set, or analysis set
CAP	Capillary Column
CCB	Continuing Calibration Blank
CCV	Continuing Calibration Verification
CF	Confirmation Analysis
CRA	Low Level Standard Check - GFAA; Mercury
CRI	Low Level Standard Check - ICP
Dil Fac	Dilution Factor
DL	Secondary dilution and analysis
DLFac	Detection Limit Factor
DSH	Distilled Standard - High Level
DSL	Distilled Standard - Low Level
DSM	Distilled Standard - Medium Level
EB	Extraction Blank
ICB	Initial Calibration Blank
ICV	Initial Calibration Verification
IDL	Instrument Detection Limit
ISA	Interference Check Sample A
ISB	Interference Check Sample B
Job No.	The first six digits of the sample ID which refers to a specific client, project and sample group
Lab ID	An 8 number unique laboratory identification
LCD	Laboratory Control Standard Duplicate
LCS	Laboratory Control Standard with reagent grade water or a matrix free from the analyte of interest
MB	Method Blank or (PB) Preparation Blank
MD	Method Duplicate
MDL	Method Detection Limit
MLE	Medium Level Extraction Blank
MRL	Method Reporting Limit Standard
MSA	Method of Standard Additions
MS	Matrix Spike
MSD	Matrix Spike Duplicate
ND	Not Detected
PACK	Packed Column
PREPF	Preparation factor used by the Laboratory's Information Management System (LIMS)
PS	Post Spike
PSD	Post Spike Duplicate
RA	Re-analysis
RE	Re-extraction and analysis
RL	Reporting Limit
RPD	Relative Percent Difference of duplicate (unrounded) analyses
RRF	Relative Response Factor
RS	Reference Standard
RT	Retention Time
RTW	Retention Time Window
SampleID	A 9 digit number unique for each sample, the first six digits are referred as the job number
SCB	Seeded Control Blank
SD	Serial Dilution
UCB	Unseeded Control Blank

One or a combination of these data qualifiers and abbreviations may appear in the analytical report.

STL-Connecticut Certification Summary (as of October 2004)

The laboratory identification numbers for the STL-Connecticut laboratory are provided in the following table. Many states certify laboratories for specific parameters or tests within a category (i.e. method 325.2 for wastewater). The information in the following table indicates the lab is certified in a general category of testing such as drinking water or wastewater analysis. The laboratory should be contacted directly if parameter-specific certification information is required.

State	Responsible Agency	Parameter Category	Effective Date	Lab ID
Connecticut	Department of Health Services	Drinking Water, Wastewater	12/31/04	PH-0497
Maine	Department of Health and Environmental Services	Drinking Water, Wastewater/Solid, Hazardous Waste	04/18/06	CT023
Massachusetts	Department of Environmental Protection	Potable/Non-Potable Water	06/30/05	CT023
New Hampshire	Department of Environmental Services	Drinking Water, Wastewater	08/29/05	2528
New Jersey	Department of Environmental Protection	Drinking Water, Wastewater	06/30/05	46410
New York	Department of Health	CLP, Drinking Water, Wastewater, Solid/ Hazardous Waste NELAC	04/01/05	10602
Rhode Island	Department of Health	Chemistry...Non- Potable Water and Wastewater	12/30/04	A43
Utah	Department of Health	RCRA	05/31/05	2032614458