


LBG ENGINEERING SERVICES, P.C.

Professional Environmental & Civil Engineers



4 Research Drive
Suite 301
Shelton, CT 06484
(203) 929-8555
(203) 926-9140 (FAX)

April 12, 2006

Mr. Jeffery Trad
Project Manager
New York State Department of Environmental Conservation
Division of Environmental Remediation, Construction Services
625 Broadway, 12th floor
Albany, NY 12233-7013

RE: February 2006 Status Report
Ground-Water Remedial Action
Rowe Industries Superfund Site
Sag Harbor, New York

Dear Mr. Trad:

The enclosed letter report details the operation status of the full-scale ground-water pump and treat system at the above referenced site. LBG has enclosed an additional copy of the report to be forwarded to the Chief of the Operation Maintenance and Support Section.

Should you or the Operation Maintenance and Support Section have any questions, please feel free to contact myself, Paul Jobmann, or Al Kovalik at (203) 929-8555.

Very truly yours,

LEGGETTE, BRASHEARS & GRAHAM, INC.

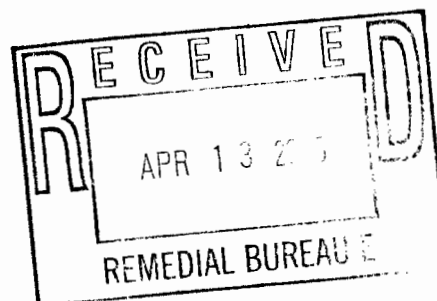
Mark M. Goldberg

Mark M. Goldberg, P.E.
Senior Environmental Engineer

MG:ng

Enclosures

H:\NABIS\2006\Monthly Reports\Feb 2006\trad_Feb2006_report.doc



-DRAFT-

PROJECT STATUS MEMORANDUM

NO. 02-06

TO: Pamela Tames, USEPA

FROM: Mark M. Goldberg, P.E.
Paul Jobmann

DATE: April 5, 2006

PROJECT: Rowe Industries Superfund Site
Ground-Water Recovery and Treatment System
February 2006 Status Report
Sag Harbor, New York

LBG Engineering Services, P.C. (LBG) commenced operation of the ground-water remediation system at the above-referenced site on December 17, 2002. This status report presents a summary of system performance, operation and maintenance, and monitoring activities for the site from February 1, 2006 through February 28, 2006. The report includes a summary of system performance parameters, system operation parameters, analytical results for ground water, system effluent samples, and air quality results.

SUMMARY OF SYSTEM PERFORMANCE AND OPERATION

(February 1, 2006 through February 28, 2006)

- | | |
|---|-----------------------------------|
| 1. Hours of operation during the reporting period: | 430 hours (64%) |
| 2. Alarm conditions during the reporting period: | See Table 1 |
| 3. Was the SPDES VOC discharge permit criteria achieved: | yes, (Table 2) |
| 4. Total volume of water pumped during the reporting period: | 10,951,920 gal. |
| 5. Was the system effluent flow below the SPDES limit of 1,023,000 gpd: | yes, (Graph 1) |
| 6. Mass of VOCs recovered during the reporting period: | 2.4 pounds |
| 7. Cumulative mass of VOCs recovered since startup on 12/17/02:
(calculations can be provided upon request) | 180.6 pounds |
| 8. Effluent VOC vapor concentration for the reporting period: | 0.142 mg/m ³ (Table 3) |
| 9. Was the effluent VOC vapor emission rate below 0.022 lbs/hr.:
(calculations can be provided upon request) | yes (0.00139 lbs/hr) |

GROUND-WATER RECOVERY SYSTEM STATUS SUMMARY

The following table summarizes select recovery well parameters for the reporting period. Table 4 presents a summary of the quality results for water samples collected from recovery wells. Graph 2 presents PCE concentrations for each recovery well. For wells with water quality that meets or is approaching remedial criteria, Graph 3 presents PCE concentrations at an expanded scale in order to compare them to the PCE aquifer restoration concentration of 5 ug/L. Laboratory analytical reports are included as Appendix I.

Well	Volume Pumped (gal)	Average Flow (gpm)	Minimum Design Flow (gpm)	Total VOC Concentration (µg/L)	VOC Recovery (lbs)
RW-2	740,780	27	26	14.8	0.09
RW-3	287,841	11	23	12.8	0.03
RW-4	846,636	40	13	32.7	0.23
RW-5	1,545,430	55	42	6.7	0.09
RW-6	664,612	15	28	79.6	0.26
RW-7	1,756,334	70	54	42.1	0.62
RW-8	1,159,302	47	46	6.0	0.06
RW-9	1,723,395	73	68	3.9	0.06

Recovery wells RW-3 and RW-6 had average flows below the respective minimum design flows determined to be necessary for capture of the plume.

The pumping rate and specific capacity from RW-3 have both decreased with time. Rehabilitation efforts in 2005 did not improve the specific capacity of this well. Build-up of microbial growth in the formation, in conjunction with the finer soils associated with the aquifer in the immediate vicinity of RW-3, are believed to be causing the decrease in well yield. This well's performance will be addressed during 2006 well rehabilitation activities.

The ground-water drawdown at RW-6 is significant and the drawdown is continuing to increase; therefore, the pumping rate at RW-6 will continue to be 15 gpm as long as well conditions allow. This well's performance will be addressed during 2006 well rehabilitation activities.

Gradual decreases in flow at RW-8 and RW-9 have been detected in the last one to two months because of iron build-up. Well rehabilitation efforts planned this year should improve the yield of these wells.

The effluent pH values are below the State Pollutant Discharge Elimination System (SPDES) Applicable or Relevant and Appropriate Requirements (ARARs) of 6.5 on a routine basis. January pH readings of water samples from the recovery wells were observed to be in the range of approximately 6.2 to 6.8. The FSP&T system does not use any chemical treatment processes to alter pH. In addition, the effluent water discharge and the recovery well extraction points are located in

the same aquifer. As discussed with the New York State Department of Environmental Conservation (NYSDEC), because the low pH is naturally occurring, and because of the previously mentioned factors, it is not considered an exceedance of the discharge requirements.

BAG FILTER STATUS

The following table presents an operational summary of the bag filter usage and configuration for the reporting period.

Dates	Bank 1	Bank 2	Bank 3
February 1 to 28	7 of 8 housings used with 400 micron bag filters	7 of 8 housings used with 400 micron bag filters	Not active

No modifications were made to the filter bank configuration or operation during this reporting period.

OTHER O&M ACTIVITIES AND FUTURE O&M ACTIVITIES

Other O&M activities conducted in February 2006 include:

- On February 1, 2006, a malfunctioning flow meter transmitter was replaced at RW-4.
- On February 8, 2006, a Verizon phone technician repaired the phone line to the Focused Pump and Treat (FP&T) system.

Future O&M activities scheduled for the winter and spring of 2006 include:

- Troubleshoot the air stripper blower and booster blower air flow meter malfunction and the hardware malfunction;
- Clean the remediation building pipes, inspect the air stripper tower sump and transfer tank;
- Construct an access manway for the equalization tank on the sidewall, two to three feet above the floor;
- Investigate the cause of the red dust observed at the base plate of transfer pump TP-1B; and,
- Conduct well rehabilitation activities starting in May 2006.

cc: Phil McAndrew, Kraft Foods, N.A. – .pdf
Lisa Krogman, Kraft Foods, N.A. (Environ) – .pdf
Jeff Trad, NYSDEC
Chief-Operation Maintenance and Support Section, NYSDEC
William Spitz, RWM, R-1, NYSDEC
Garrett W. Swensen Jr., Esq., Town of Southampton

MMG:ng

Attachments

H:\NABIS\2006\Monthly Reports\Feb 2006>Status0206Feb.doc

TABLES

TABLE 1
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

MAINTENANCE LOG
(February 1, 2006 through February 28, 2006)

Date	Time	System Changes/Modifications	Personnel
2/1/2006	7:41 AM	Reset communication failure alarm that occurred on 1/29/06, rebooted the computer and restarted the system.	RD
		Changed multi-bag filter bags (400 µm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD
		Replaced the malfunctioning RW-4 flow meter transmitter. The flow from RW-4 is now reading 40 gpm.	RD
2/8/2006		Changed multi-bag filter bags (400 µm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD
		Verizon phone technician repaired a malfunctioning phone line that is used for the Focused Pump & Treat (FP&T) system.	RD, Verizon
2/14/2006		Changed multi-bag filter bags (400 µm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD
2/16/2006	7:00 AM	Communication Failure Alarm; system shut down.	
2/22/2006	7:44 AM	Reset the communication failure alarm, rebooted the computer and restarted the system.	RD
		Changed multi-bag filter bags (400 µm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD
2/24/2006	2:00 PM	Power failure alarm, RW-4, 5, 6 and 8 pump fault alarms. System still operating with remaining wells. With the reduced flow, transfer pump operation changed from constant flow (normal operation) to cycling on and off.	
	2:34 PM	Because transfer pumps are cycling, LBG forced the system to shut down by creating an artificial high-high level alarm in the Equalization tank.	PJ
2/28/2006	7:59 AM	Reset the recovery well drives, reset the alarms and restarted the system.	SS, ETL
		Changed multi-bag filter bags (400 µm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD

TABLE 1
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

MAINTENANCE LOG
(February 1, 2006 through February 28, 2006)

Date	Time	System Changes/Modifications	Personnel
2/1/2006	7:41 AM	Reset communication failure alarm that occurred on 1/29/06, rebooted the computer and restarted the system.	RD
		Changed multi-bag filter bags (400 µm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD
		Replaced the malfunctioning RW-4 flow meter transmitter. The flow from RW-4 is now reading 40 gpm.	RD
2/8/2006		Changed multi-bag filter bags (400 µm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD
		Verizon phone technician repaired a malfunctioning phone line that is used for the Focused Pump & Treat (FP&T) system.	RD, Verizon
2/14/2006		Changed multi-bag filter bags (400 µm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD
2/16/2006	7:00 AM	Communication Failure Alarm; system shut down.	
2/22/2006	7:44 AM	Reset the communication failure alarm, rebooted the computer and restarted the system.	RD
		Changed multi-bag filter bags (400 µm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD
2/24/2006	2:00 PM	Power failure alarm, RW-4, 5, 6 and 8 pump fault alarms. System still operating with remaining wells. With the reduced flow, transfer pumps are cycling on and off.	
	2:34 PM	Because transfer pumps are cycling, LBG forced the system to shut down by creating an artificial high-high level alarm in the Equalization tank.	PJ
2/28/2006	7:59 AM	Reset the recovery well drives, reset the alarms and restarted the system.	SS, ETL
		Changed multi-bag filter bags (400 µm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

EFFLUENT WATER QUALITY RESULTS

Date Sampled ³	pH ¹	TDS (mg/l)	PCE (ug/l)	1,1,1-TCA (ug/l)	TCE (ug/l)	1,1-DCA (ug/l)	1,1-DCE (ug/l)	1,2-DCE (ug/l)	Xylene (ug/l)	Bromoform (ug/l)	Dibromo- chloromethane (ug/l)	Methylene Chloride (ug/l)	Freon 113 (ug/l)	Acetone (ug/l)	Chloroform (ug/l)	MTBE (ug/l)	Total Iron (mg/l)	Dissolved Iron (mg/l)
SPDES Limits	6.5 to 8.5	---	1	5	5	5	5	5	5	---	---	5	---	50	7	---	---	---
1-Feb-06	5.1	90	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	8.5 ³	ND<1.0	ND<1.0	ND<1.0	ND<1.0	2.54	0.108
8-Feb-06	5.3	116	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	1.31	0.0403
14-Feb-06 ⁴	5.1	117	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	1.58	0.042
22-Feb-06	5.3	250 ⁵	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	63 ⁵	0.576 ⁵
28-Feb-06	5.8	89	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	19 ³	ND<1.0	16 ³	ND<1.0	ND<1.0	164 ⁵	2.03 ⁵

SPDES: State Pollutant Discharge Elimination System

mg/l: Milligrams per liter

ug/l: Micrograms per liter

---: Not established

NM: Not Measured

TDS: Total dissolved solids

PCE: Tetrachloroethylene

TCE: Trichloroethylene

1,1-DCA: 1,1-Dichloroethane

1,1-DCE: 1,1-Dichloroethene

1,2-DCE: 1,2-Dichloroethene

MTBE: Methyl tert-butyl ether

Notes:

- pH was measured using litmus paper. Influent pH values from recovery wells, which reflect the pH of natural ground water, are below 6.5 on a regular basis.
- "Effluent" samples were collected from sample port labeled NP2-10 unless otherwise noted.
- Methylene chloride and acetone detected in these samples are suspected to be from laboratory contamination.
- Some of the sample bottles for NP2-10 were broken during sample shipment. Effluent sample results for VOCs, total iron and dissolved iron on February 14, 2006 are reported from sample port NP2-7, which is located after the air stripper tower and before the transfer tank. Total dissolved solids (TDS) is reported from NP2-10.
- High iron concentrations and TDS detected in the effluent may be caused by iron sediment build-up in the lower sump, the bottom of the transfer tank, the effluent pipe or the effluent pipe fittings. Pipe cleaning and tank and lower sump inspection is being scheduled.

CARBON UNIT SYSTEM AIR QUALITY RESULTS

Midcarbon	Sample Name	Date	Time	Parameters (mg/m3)																	TOTAL VOCs		
				PCE	TCE	TC4	DCE	DCA	cis-DCE	Toluene	Benzene	m&p-Xylenes	o-Xylene	Styrene	CF	MC	CM	CD	BM	CB		EB	VC
	AQ030205:1110NP4-2	3/2/05	11:10	ND	ND	0.14	0.009	0.022	0.004	0.016	0.002	0.002	ND	ND	0.011	0.01	ND	0.008	0.021	ND	ND	ND	0.25
	AQ040705:1432NP4-2	4/7/05	14:32	0.004	ND	0.069	0.005	0.014	0.003	0.012	0.002	ND	ND	ND	0.006	0.05	ND	0.026	ND	ND	ND	ND	0.19
	AQ050205:1410NP4-2	5/2/05	14:10	ND	ND	0.086	0.006	ND	0.003	0.016	0.001	ND	ND	ND	0.003	0.006	ND	0.005	0.01	ND	ND	ND	0.13
	AQ062405:1241NP4-2	6/24/05	12:41	ND	ND	0.063	ND	ND	ND	0.017	0.023	0.005	0.006	ND	0.007	0.096	ND	0.047	ND	ND	ND	ND	0.32
	AQ070705:1415NP4-2	7/7/05	14:15	ND	ND	0.036	ND	ND	ND	0.036	0.006	0.002	ND	ND	ND	0.65 ^{iv}	ND	0.49 ^{iv}	0.11	ND	ND	ND	0.33
	AQ080205:1405NP4-2	8/2/05	14:05	0.019	ND	0.05	ND	ND	ND	0.051	0.006	0.007	ND	0.006	0.007	0.029 ^{iv}	ND	0.72 ^{iv}	0.048	0.002	ND	ND	0.34
	AQ090805:905NP4-2	9/8/05	9:05	0.008	ND	0.039	ND	ND	ND	0.049	0.002	0.024	0.012	ND	0.004	0.10 ^{iv}	ND	0.018	0.013	ND	0.003	ND	0.27
	AQ100605:1232NP4-2	10/6/05	12:32	0.007	ND	0.1	0.01	0.028	0.009	0.013	0.001	0.001	ND	0.003	0.01	0.021	ND	0.049	ND	0.001	ND	ND	0.26
	AQ111605:1132NP4-2	11/16/05	11:32	0.01	ND	0.058	0.004	0.015	0.004	0.013	0.002	0.002	ND	ND	0.005	0.017	ND	0.021	0.031	ND	ND	ND	0.18
	AQ120805:935NP4-2	12/8/05	9:35	0.003	ND	0.13	0.009	0.023	0.007	0.013	0.002	0.004	0.001	0.003	0.006	0.007 ²ⁱ	ND	0.021	0.018	0.001	0.003	ND	0.24
	AQ010406:850NP4-2	1/4/06	8:50	0.006	ND	0.11	0.005	0.017	0.006	0.018	0.001	0.003	ND	0.003	0.005	0.007	ND	0.022	0.009	0.001	0.002	ND	0.21
	AQ020106:750NP4-2	2/1/06	7:50	0.002	ND	0.086	ND	0.013	0.007	0.012	0.012	0.007	0.002	0.002	0.003	0.017	ND	0.01	ND	0.002	ND	ND	0.19

Notes: 1. Methylene chloride and/or carbon disulfide concentrations in all three air samples collected during the July 7, August 9 and September 8, 2005 sampling events are greatly elevated due to suspected laboratory contamination. The methylene chloride concentration from the June 24, 2005 sampling event was used instead of the July 7, August 9 or September 8, 2005 methylene chloride concentrations to calculate the total VOCs for July, August and September 2005. The carbon disulfide concentration from the June 24, 2005 sampling event was used instead of the July 7 and August 9, 2005 carbon disulfide concentration to calculate the total VOCs for July and August 2005.

2. The methylene chloride concentration in the air samples collected on December 8, 2005 are suspected to be from laboratory contamination.

3. The laboratory procedure for the % bromomethane recovered exceeded the upper limit for quality control, therefore the bromomethane concentration for January 4, 2006 was used to calculate the total VOC concentration for the February 1, 2006 samples.

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled ARAR's	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	1,1-Dichloro- ethane (ug/L)	cis-1,2-Dichloro- ethane (ug/L)	1,1-Dichloro- ethene (ug/L)	Methylene Chloride (ug/L)	Toluene (ug/L)	Dibromochloro- methane (ug/L)	Acetone (ug/L)
RW-1	15-Sep-04	ND<1	ND<1	ND<1	NE	2.8	ND<1	0.0865	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	ND<1	ND<1	ND<1	ND<1	ND<1	2.2	0.0332	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	ND<1	ND<1	ND<1	ND<1	1.9	2.0	0.0133	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	ND<1	ND<1	ND<1	ND<1	9.8	ND<1	0.0229	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-Jan-05	ND<1	ND<1	ND<1	ND<1	1.5	2.1	0.0703	0.0326	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	ND<1	ND<1	ND<1	ND<1	4.6	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	ND<1	ND<1	ND<1	ND<1	2.5	ND<1	0.0285	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	ND<1	ND<1	ND<1	ND<1	1.5	ND<1	0.0357	0.0217	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	ND<1	ND<1	ND<1	ND<1	4.0	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	ND<1	ND<1	ND<1	ND<1	2.1	ND<1	0.0289	ND<0.02	ND<1	ND<1	ND<1	8.4*	ND<1	ND<1	6.9*
	15-Sep-04	12	ND<1	ND<1	ND<1	ND<1	ND<1	3.82	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	10	ND<1	ND<1	ND<1	ND<1	1.5	4.78	0.213	ND<1	ND<1	ND<1	ND<1	ND<1	1.5	ND<1
	3-Nov-04	11	ND<1	ND<1	ND<1	ND<1	ND<1	5.21	0.152	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
RW-2	15-Dec-04	10	ND<1	ND<1	ND<1	ND<1	ND<1	10.8	0.297	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	25	ND<1	ND<1	ND<1	ND<1	ND<1	4.81	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	18	ND<1	ND<1	ND<1	ND<1	ND<1	5.01	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	20	1.1	ND<1	ND<1	ND<1	ND<1	5.28	0.0816	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	9.0	ND<1	ND<1	ND<1	ND<1	ND<1	4.51	0.128	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	8.2	ND<1	ND<1	ND<1	ND<1	ND<1	3.69	0.17	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	12.0	ND<1	1.0	ND<1	ND<1	ND<1	3.5	0.0511	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	7.7	1.1	ND<1	ND<1	ND<1	ND<1	0.28	0.0298	ND<1	ND<1	ND<1	7.3*	ND<1	ND<1	5.6*
	9-Aug-05	5.4	ND<1	ND<1	ND<1	ND<1	ND<1	3.74	0.107	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	16	1.8	ND<1	ND<1	ND<1	ND<1	3.57	0.0704	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	15	2.1	ND<1	ND<1	ND<1	ND<1	6.1	0.0269	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	34	2.1	ND<1	ND<1	ND<1	ND<1	4.25	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	5.2	2.0	ND<1	ND<1	ND<1	ND<1	9.15	0.0696	ND<1	ND<1	ND<1	4.8*	1.0	ND<1	ND<1
	14-Feb-06	6.5	4.3	1.2	ND<1	ND<1	ND<1	3.99	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled ARAR's	PCE (ug/L) 5	TCE (ug/L) 5	TCA (ug/L) 5	Vinyl Acetate (ug/L) NE	Chloroform (ug/L) 7	MTBE (ug/L) NE	Total Iron (mg/L) 300	Dissolved Iron (mg/L) 300	1,1-Dichloro-ethane (ug/L) 5	cis-1,2-Dichloro-ethane (ug/L) 5	1,1-Dichloro-ethene (ug/L) 5	Methylene Chloride (ug/L) 1/5	Toluene (ug/L) NE	Dibromochloromethane (ug/L) NE	Acetone (ug/L) 1/NE
RW-3	15-Sep-04	2.7	21	8.7	ND<1	ND<1	ND<1	1.91	0.42	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	2.2	12	5.0	ND<1	ND<1	ND<1	2.09	1.82	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	1.5	6.5	2.6	ND<1	ND<1	ND<1	1.87	1.8	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	3.77	0.489	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.60	2.24	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	1.6	1.3	ND<1	ND<1	ND<1	ND<1	2.10	1.15	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	3	13	5.0	ND<1	ND<1	ND<1	1.89	1.36	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	ND<1	2.0	ND<1	ND<1	ND<1	ND<1	46.1	0.539	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	2.2	7.7	2.8	ND<1	ND<1	ND<1	1.85	0.82	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	9.91	10	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	2.01	0.649	ND<1	ND<1	ND<1	9.1*	ND<1	ND<1	6.9*
	9-Aug-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.50	0.973	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	1	3.6	1.2	ND<1	ND<1	ND<1	2.03	0.71	ND<1	2.6	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	1.3	ND<1	ND<1	ND<1	ND<1	ND<1	1.83	0.708	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.11	0.556	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	1.7	17	7.9	ND<1	ND<1	ND<1	1.93	0.455	ND<1	ND<1	ND<1	4.6*	ND<1	ND<1	ND<1
	14-Feb-06	1.4	8.9	2.5	ND<1	ND<1	ND<1	3.80	0.157	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Sep-04	120	3.7	18	ND<1	ND<1	ND<1	2.98	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	94	ND<1	14	ND<1	ND<1	ND<1	3.65	0.126	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
RW-4	3-Nov-04	130	4.2	11	ND<1	ND<1	ND<1	4.75	0.205	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	230	5.7	35	ND<1	ND<1	ND<1	1.90	1.62	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	160	4.1	7.3	ND<1	ND<1	ND<1	6.11	3.28	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	15-Mar-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	19-Apr-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	2-May-05	80	2.4	9.8	ND<1	ND<1	ND<1	3.77	0.0687	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Jun-05	74	2.6	ND<1	ND<1	ND<1	ND<1	9.95	9.28	ND<1	ND<1	ND<1	4.5*	ND<1	ND<1	ND<1
	14-Jul-05	37	ND<1	8.9	ND<1	ND<1	ND<1	3.22	0.0185	ND<1	ND<1	ND<1	9.4*	ND<1	ND<1	7.4*
	9-Aug-05	31	ND<1	ND<1	ND<1	ND<1	ND<1	2.49	0.111	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	45	ND<1	6	ND<1	ND<1	ND<1	3.47	0.173	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	30	ND<1	ND<1	ND<1	ND<1	ND<1	3.69	0.0777	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Dec-05	64	2.0	1.5	ND<1	ND<1	ND<1	2.82	0.0302	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	15	ND<1	9.5	ND<1	ND<1	ND<1	7.78	0.0412	ND<1	ND<1	ND<1	5.2*	ND<1	ND<1	ND<1
	14-Feb-06	24	ND<1	8.7	ND<1	ND<1	ND<1	6.05	0.0627	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled ARAR's	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	1,1-Dichloro-ethane (ug/L)	cis-1,2-Dichloro-ethene (ug/L)	1,1-Dichloro-ethene (ug/L)	Methylene Chloride (ug/L)	Toluene (ug/L)	Dibromochloromethane (ug/L)	Acetone (ug/L)
RW-5	15-Sep-04	24	ND<1	6.5	ND<1	ND<1	3.2	2.39	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	16	ND<1	5.2	ND<1	ND<1	2.4	0.139	0.0163	ND<1	ND<1	ND<1	ND<1	ND<1	1.4	ND<1
	3-Nov-04	15	ND<1	6.4	ND<1	ND<1	2.2	0.0287	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	28	ND<1	28	ND<1	ND<1	ND<1	0.0621	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	12	ND<1	5.6	ND<1	ND<1	2.0	0.0269	0.0172	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	11	ND<1	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	14	ND<1	4.3	ND<1	ND<1	2.6	0.318	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	9	ND<1	4.1	ND<1	ND<1	ND<1	0.0887	0.0187	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	13	ND<1	5.7	ND<1	ND<1	ND<1	0.0223	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	4.7	ND<1	ND<1	ND<1	ND<1	ND<1	0.0177	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	8.2	ND<1	1.6	ND<1	ND<1	ND<1	0.0358	ND<0.02	ND<1	ND<1	ND<1	9.5*	ND<1	ND<1	5.6*
	9-Aug-05	2.6	ND<1	ND<1	ND<1	ND<1	ND<1	0.0227	0.0303	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	8	ND<1	3.8	ND<1	ND<1	ND<1	0.0185	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	2.6	ND<1	ND<1	ND<1	ND<1	ND<1	0.0482	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	2.4	ND<1	ND<1	ND<1	ND<1	ND<1	0.0468	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	2.3	ND<1	2.0	ND<1	ND<1	ND<1	0.0558	0.0119	ND<1	ND<1	ND<1	4.6*	ND<1	ND<1	ND<1
	14-Feb-06	2.9	ND<1	3.8	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
RW-6	15-Sep-04	130	3.3	2.2	ND<1	ND<1	ND<1	0.0976	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	2.0	ND<1
	7-Oct-04	94	ND<1	1.6	ND<1	ND<1	ND<1	0.214	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	94	2.1	2.4	ND<1	ND<1	2.5	0.0111	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	200	3.8	16	ND<1	ND<1	ND<1	4.73	0.117	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	86	2.1	3.7	ND<1	ND<1	2.4	0.0279	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	110	2.4	7.6	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	120	2.3	6.6	ND<1	ND<1	2.7	0.0294	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	74	ND<1	7.0	ND<1	ND<1	ND<1	0.0509	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	96	2.8	8.5	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	69	1.6	13	ND<1	ND<1	ND<1	0.067	0.0195	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	64	1.6	9.5	ND<1	ND<1	ND<1	0.0406	ND<0.02	ND<1	ND<1	ND<1	7.2*	ND<1	ND<1	7*
	9-Aug-05	49	ND<1	12	ND<1	ND<1	ND<1	0.088	0.0366	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	100	1.6	12	ND<1	ND<1	ND<1	1.3	0.0143	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	68	ND<1	ND<1	ND<1	ND<1	ND<1	0.144	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	100	2.1	20	ND<1	ND<1	ND<1	0.139	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	41	1.1	16	ND<1	ND<1	ND<1	0.189	ND<0.02	ND<1	ND<1	ND<1	4.6*	ND<1	ND<1	ND<1
	22-Feb-06	63	1.6	15	ND<1	ND<1	ND<1	0.116	0.0155	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled ARAR's	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	1,1-Dichloro-ethane (ug/L)	cis-1,2-Dichloro-ethene (ug/L)	1,1-Dichloro-ethene (ug/L)	Methylene Chloride (ug/L)	Toluene (ug/L)	Dibromochloromethane (ug/L)	Acetone (ug/L)
RW-7	15-Sep-04	59	2.2	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	38	ND<1	ND<1	ND<1	ND<1	ND<1	0.0429	0.0126	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	36	ND<1	ND<1	ND<1	ND<1	ND<1	0.0214	0.0108	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	82	ND<1	4.3	ND<1	ND<1	ND<1	0.0272	0.00876	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	37	1.1	ND<1	ND<1	ND<1	ND<1	0.0343	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	45	ND<1	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	42	1.5	1.7	ND<1	ND<1	ND<1	0.0356	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	22	ND<1	ND<1	ND<1	ND<1	ND<1	0.107	0.0152	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	30	ND<1	ND<1	ND<1	ND<1	ND<1	0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	32	1.0	4.7	ND<1	ND<1	ND<1	0.0753	0.02	1.5	ND<1	1.1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	32	ND<1	2.2	ND<1	ND<1	ND<1	0.0155	ND<0.02	ND<1	ND<1	ND<1	8.7*	ND<1	ND<1	7.2*
	9-Aug-05	31	ND<1	6.2	ND<1	ND<1	ND<1	0.0903	0.0409	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	39	ND<1	3.4	ND<1	ND<1	ND<1	0.0452	ND<0.02	1.7	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	36	ND<1	ND<1	ND<1	ND<1	ND<1	0.536	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	70	ND<1	12.0	ND<1	ND<1	ND<1	0.253	ND<0.02	4.2	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	26	ND<1	5.0	ND<1	ND<1	ND<1	0.343	ND<0.02	2.2	ND<1	ND<1	5.0*	ND<1	ND<1	ND<1
	14-Feb-06	36	ND<1	4.1	ND<1	ND<1	ND<1	0.0332	ND<0.02	2.0	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Sep-04	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	ND<1	ND<1	NM
	27-Oct-04	4.1	1.0	2.2	ND<1	ND<1	ND<1	28.8	0.235	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
RW-8	3-Nov-04	5.3	ND<1	4.0	ND<1	ND<1	ND<1	10.6	0.271	3.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	16	ND<1	22	ND<1	ND<1	ND<1	15.6	0.149	15	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	6.9	1.3	3.9	ND<1	ND<1	ND<1	8.92	2.85	2.7	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	7.4	ND<1	7.2	ND<1	ND<1	ND<1	8.24	ND<0.02	4.7	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	9.0	1.3	4.2	ND<1	ND<1	ND<1	7.54	0.075	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	3.5	ND<1	3.5	ND<1	ND<1	ND<1	8.89	0.321	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	5.6	ND<1	5.2	ND<1	ND<1	ND<1	7.33	0.073	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	2.7	ND<1	5.8	ND<1	ND<1	ND<1	7.06	0.325	2.1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	2.6	ND<1	3.4	ND<1	ND<1	ND<1	8.33	0.017	ND<1	ND<1	ND<1	8.5*	ND<1	ND<1	8.2*
	9-Aug-05	1.8	ND<1	2.9	ND<1	ND<1	ND<1	0.24	0.065	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	2.9	ND<1	4.2	ND<1	ND<1	ND<1	7.53	0.255	2.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	7.65	0.106	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	2.4	ND<1	5.0	ND<1	ND<1	ND<1	5.19	0.021	3.2	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	1.3	ND<1	3.7	ND<1	ND<1	ND<1	7.25	0.097	2.0	ND<1	ND<1	4.9*	ND<1	ND<1	ND<1
	14-Feb-06	1.5	ND<1	3.0	ND<1	ND<1	ND<1	8.06	ND<0.02	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled ARAR's	PCE (ug/L) 5	TCE (ug/L) 5	TCA (ug/L) 5	Vinyl Acetate (ug/L) NE	Chloroform (ug/L) 7	MTBE (ug/L) NE	Total Iron (mg/L) 300	Dissolved Iron (mg/L) 300	1,1-Dichloroethane (ug/L) 5	cis-1,2-Dichloroethene (ug/L) 5	1,1-Dichloroethene (ug/L) 5	Methylene Chloride (ug/L) 11 5	Toluene (ug/L) NE	Dibromochloromethane (ug/L) NE	Acetone (ug/L) 11 NE
RW-9	15-Sep-04	3.7	1.0	6.0	ND<1	ND<1	ND<1	0.049	ND<0.02	1.9	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	3.1	ND<1	5.0	ND<1	ND<1	ND<1	3.12	0.716	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	1.6	ND<1	5.9	ND<1	ND<1	ND<1	2.97	1.41	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	1.3	ND<1	31	ND<1	ND<1	ND<1	2.78	0.497	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	ND<1	1.0	6.4	ND<1	ND<1	ND<1	2.35	1.72	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	ND<1	ND<1	10	ND<1	ND<1	ND<1	0.0974	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	ND<1	1.4	5.9	ND<1	ND<1	ND<1	1.55	0.507	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	ND<1	ND<1	4.5	ND<1	ND<1	ND<1	1.59	0.091	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	ND<1	2.9	9.0	ND<1	ND<1	ND<1	2.89	0.0596	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	ND<1	ND<1	5.8	ND<1	ND<1	ND<1	1.38	0.149	0.9	ND<1	1.2	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	3.4	ND<1	3.1	ND<1	ND<1	ND<1	2.55	0.238	ND<1	ND<1	ND<1	6.9 *	ND<1	ND<1	7.3 *
	9-Aug-05	ND<1	ND<1	1.4	ND<1	ND<1	ND<1	0.994	0.0734	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	1.2	ND<1	2.0	ND<1	ND<1	ND<1	3.64	0.161	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	1.31	0.108	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	ND<1	ND<1	2.9	ND<1	ND<1	ND<1	2.01	0.024	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	ND<1	ND<1	1.4	ND<1	ND<1	ND<1	2.36	0.0905	ND<1	ND<1	ND<1	4.9 *	ND<1	ND<1	ND<1
	14-Feb-06	2.1	ND<1	1.8	ND<1	ND<1	ND<1	5.23	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1

ND: Not detected

<#: Less than method detection limit

ug/L: Micrograms per liter

-: Not analyzed

ARAR's are chemical specific aquifer restoration goals for ground water at the Former Rowe Industries Superfund Site.

Bold values indicate an exceedance of the ARAR standard established for the site.

PCE: Tetrachloroethylene

TCE: Trichloroethylene

TCA: 1,1,1-Trichloroethane

1,1-DCA: 1,1-Dichloroethane

1,1-DCE: 1,1-Dichloroethene

1,2-DCE: 1,2-Dichloroethene

MTBE: Methyl Tertiary Butyl Ether

NM: Not Measured

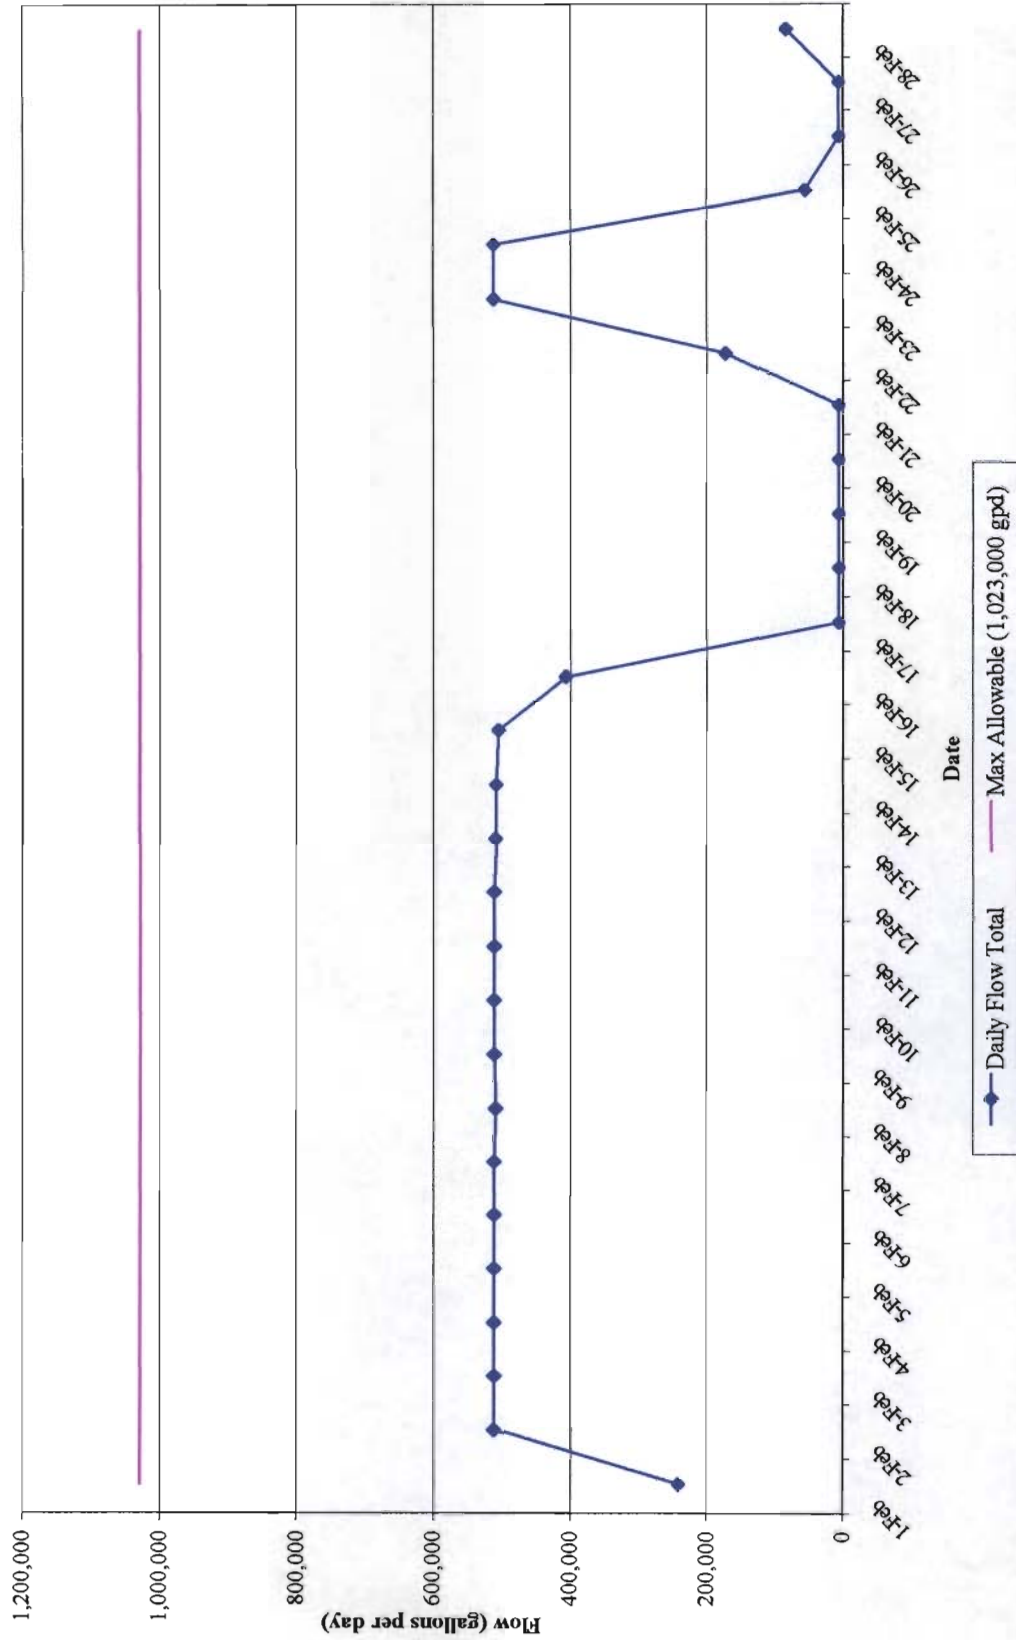
ARAR goal was not established for this compound by the EPA.

*Concentrations with an asterisk following them are due to laboratory contamination.

GRAPHS

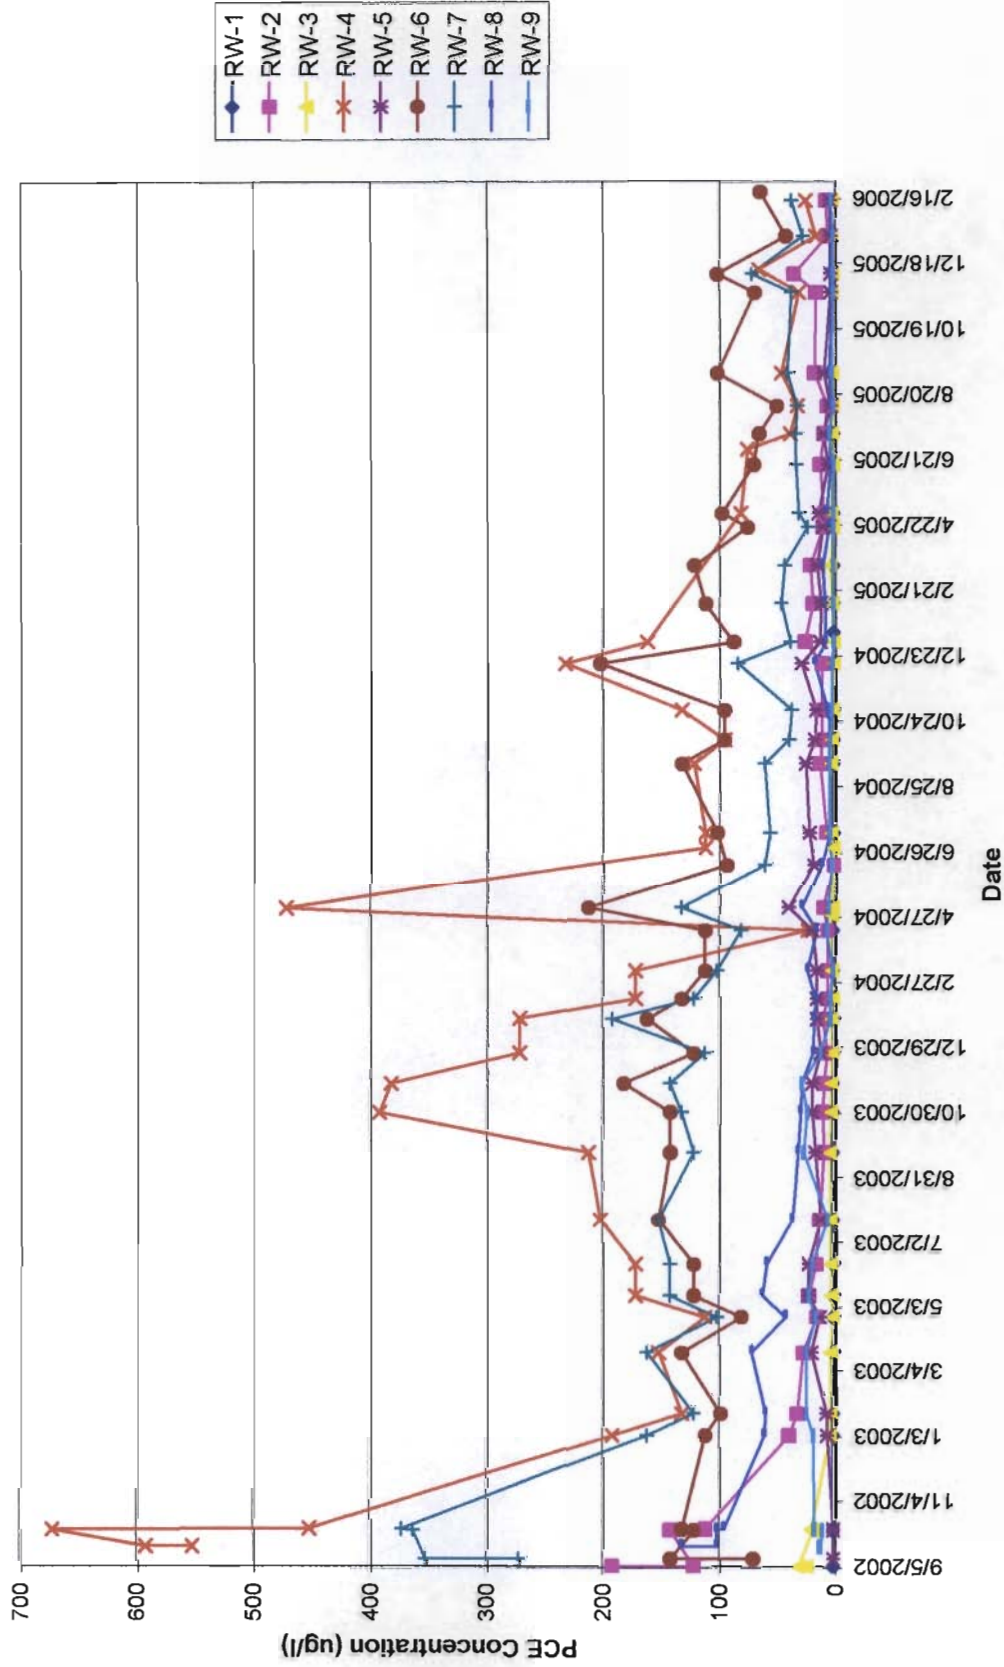
GRAPH 1
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

EFFLUENT FLOW DATA
 (February 1, 2006 through February 28, 2006)



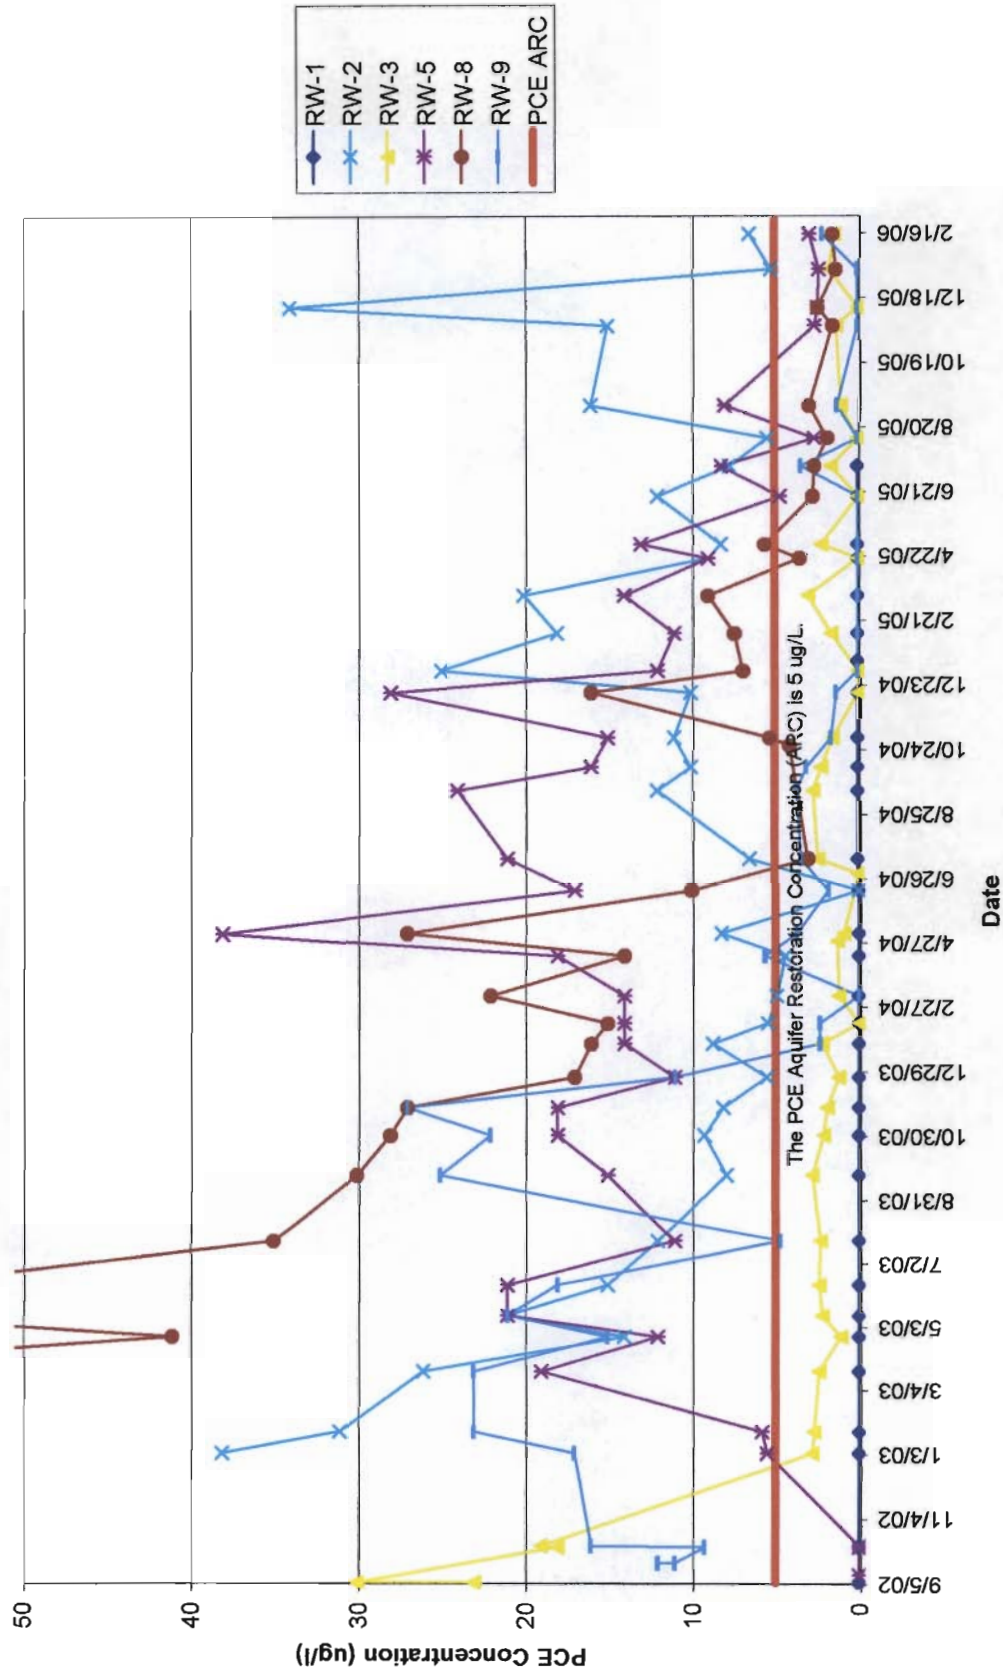
GRAPH 2
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RECOVERY WELL PCE CONCENTRATION IN MICROGRAMS PER LITER



GRAPH 3 GROUND-WATER REMEDIAL ACTION ROWE INDUSTRIES SUPERFUND SITE SAG HARBOR, NEW YORK

RECOVERY WELL PCE CONCENTRATION FOR SELECT RECOVERY WELLS



APPENDIX I
FEBRUARY 2006 LABORATORY ANALYTICAL REPORTS



NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Friday, February 10, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0602047

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 2/3/2006 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 10-Feb-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0602047

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0602047-01A	WQ020106:800 NP2-6		2/1/2006	2/3/2006
0602047-01B	WQ020106:800 NP2-6		2/1/2006	2/3/2006
0602047-01C	WQ020106:800 NP2-6		2/1/2006	2/3/2006
0602047-02A	WQ020106:805 NP2-7		2/1/2006	2/3/2006
0602047-02B	WQ020106:805 NP2-7		2/1/2006	2/3/2006
0602047-02C	WQ020106:805 NP2-7		2/1/2006	2/3/2006
0602047-03A	WQ020106:810 NP2-10		2/1/2006	2/3/2006
0602047-03B	WQ020106:810 NP2-10		2/1/2006	2/3/2006
0602047-03C	WQ020106:810 NP2-10		2/1/2006	2/3/2006



ELAP 11418
PAT, LPAT 15668
PH-0205

556 TOLEDO STREET • FARMINGDALE, NY 11735 • (516) 454-6100 • FAX: (516) 454-8027

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 10-Feb-06

CLIENT: Leggette Brashears & Graham Inc. **Client Sample ID:** WQ020106:800 NP2-6
Lab Order: 0602047 **Tag Number:**
Project: Rowe Industries **Collection Date:** 2/1/2006
Lab ID: 0602047-01A **Date Received:** 2/3/2006 **Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: SB		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
1,1,1-Trichloroethane	3.8	1.0		µg/L	1	2/4/2006 6:29:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
2-Butanone	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
2-Hexanone	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Acetone	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Benzene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Bromobenzene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Bromochloromethane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Bromodichloromethane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Bromoform	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Bromomethane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Carbon disulfide	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Chlorobenzene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Chloroethane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit
 U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 10-Feb-06

CLIENT: Leggette Brashears & Graham Inc. **Client Sample ID:** WQ020106:800 NP2-6
Lab Order: 0602047 **Tag Number:**
Project: Rowe Industries **Collection Date:** 2/1/2006
Lab ID: 0602047-01A **Date Received:** 2/3/2006 **Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Chloromethane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Dibromochloromethane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Dibromomethane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Ethylbenzene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Isopropylbenzene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
m,p-Xylene	U	2.0		µg/L	1	2/4/2006 6:29:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Methylene chloride	7.7	1.0	B	µg/L	1	2/4/2006 6:29:00 AM
Naphthalene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
n-Butylbenzene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
n-Propylbenzene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
o-Xylene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Styrene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Tetrachloroethene	23	1.0		µg/L	1	2/4/2006 6:29:00 AM
Toluene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Trichloroethene	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Vinyl acetate	U	1.0		µg/L	1	2/4/2006 6:29:00 AM
Vinyl chloride	U	1.0		µg/L	1	2/4/2006 6:29:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit
 U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 10-Feb-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ020106:800 NP2-6
Lab Order:	0602047	Tag Number:	
Project:	Rowe Industries	Collection Date:	2/1/2006
Lab ID:	0602047-01B	Date Received:	2/3/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	2.43	0.0200		mg/L	1	2/9/2006 12:48:50 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 10-Feb-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ020106:800 NP2-6
Lab Order:	0602047	Tag Number:	
Project:	Rowe Industries	Collection Date:	2/1/2006
Lab ID:	0602047-01C	Date Received:	2/3/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.0417	0.0200		mg/L	1	2/9/2006 12:46:42 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 10-Feb-06

CLIENT: Leggette Brashears & Graham Inc. Client Sample ID: WQ020106:805 NP2-7
 Lab Order: 0602047 Tag Number:
 Project: Rowe Industries Collection Date: 2/1/2006
 Lab ID: 0602047-02A Date Received: 2/3/2006 Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: SB		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
2-Butanone	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
2-Hexanone	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Acetone	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Benzene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Bromobenzene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Bromochloromethane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Bromodichloromethane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Bromoform	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Bromomethane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Carbon disulfide	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Chlorobenzene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Chloroethane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit
 U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 10-Feb-06

CLIENT: Leggette Brashears & Graham Inc. **Client Sample ID:** WQ020106:805 NP2-7
Lab Order: 0602047 **Tag Number:**
Project: Rowe Industries **Collection Date:** 2/1/2006
Lab ID: 0602047-02A **Date Received:** 2/3/2006 **Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Chloromethane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Dibromochloromethane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Dibromomethane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Ethylbenzene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Isopropylbenzene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
m,p-Xylene	U	2.0		µg/L	1	2/4/2006 7:06:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Methylene chloride	8.2	1.0	B	µg/L	1	2/4/2006 7:06:00 AM
Naphthalene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
n-Butylbenzene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
n-Propylbenzene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
o-Xylene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Styrene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Tetrachloroethene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Toluene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Trichloroethene	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Vinyl acetate	U	1.0		µg/L	1	2/4/2006 7:06:00 AM
Vinyl chloride	U	1.0		µg/L	1	2/4/2006 7:06:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits
 B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit
 U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 10-Feb-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ020106:805 NP2-7
Lab Order:	0602047	Tag Number:	
Project:	Rowe Industries	Collection Date:	2/1/2006
Lab ID:	0602047-02B	Date Received:	2/3/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	2.64	0.0200		mg/L	1	2/9/2006 12:52:59 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

Page 7 of 12

American Analytical Laboratories, LLC.

Date: 10-Feb-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ020106:805 NP2-7
Lab Order:	0602047	Tag Number:	
Project:	Rowe Industries	Collection Date:	2/1/2006
Lab ID:	0602047-02C	Date Received:	2/3/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.0913	0.0200		mg/L	1	2/9/2006 12:51:08 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit
- U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 10-Feb-06

CLIENT: Leggette Brashears & Graham Inc. Client Sample ID: WQ020106:810 NP2-10
 Lab Order: 0602047 Tag Number:
 Project: Rowe Industries Collection Date: 2/1/2006
 Lab ID: 0602047-03A Date Received: 2/3/2006 Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B		Analyst: SB		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
2-Butanone	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
2-Hexanone	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Acetone	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Benzene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Bromobenzene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Bromochloromethane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Bromodichloromethane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Bromoform	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Bromomethane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Carbon disulfide	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Chlorobenzene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Chloroethane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit
 U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 10-Feb-06

CLIENT: Leggette Brashears & Graham Inc. **Client Sample ID:** WQ020106:810 NP2-10
Lab Order: 0602047 **Tag Number:**
Project: Rowe Industries **Collection Date:** 2/1/2006
Lab ID: 0602047-03A **Date Received:** 2/3/2006 **Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Chloromethane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Dibromochloromethane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Dibromomethane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Ethylbenzene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Isopropylbenzene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
m,p-Xylene	U	2.0		µg/L	1	2/4/2006 7:44:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Methylene chloride	8.5	1.0	B	µg/L	1	2/4/2006 7:44:00 AM
Naphthalene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
n-Butylbenzene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
n-Propylbenzene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
o-Xylene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Styrene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Tetrachloroethene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Toluene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Trichloroethene	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Vinyl acetate	U	1.0		µg/L	1	2/4/2006 7:44:00 AM
Vinyl chloride	U	1.0		µg/L	1	2/4/2006 7:44:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level B Analyte detected in the associated Method Blank
 E Value above quantitation range H Holding times for preparation or analysis exceeded
 J Analyte detected below quantitation limits ND Not Detected at the Reporting Limit
 S Spike Recovery outside accepted recovery limits U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 10-Feb-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ020106:810 NP2-10
Lab Order:	0602047	Tag Number:	
Project:	Rowe Industries	Collection Date:	2/1/2006
Lab ID:	0602047-03B	Date Received:	2/3/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	2.54	0.0200		mg/L	1	2/9/2006 12:57:16 PM

Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed for but not detected

Page 11 of 12

American Analytical Laboratories, LLC.

Date: 10-Feb-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ020106:810 NP2-10
Lab Order:	0602047	Tag Number:	
Project:	Rowe Industries	Collection Date:	2/1/2006
Lab ID:	0602047-03C	Date Received:	2/3/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.108	0.0200		mg/L	1	2/9/2006 12:55:07 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	90.0	1.00		mg/L	1	2/6/2006

Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed for but not detected



NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Monday, March 06, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0602192

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 2/17/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,


Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 06-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0602192

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0602192-01A	WQ020806:800 NP2-6		2/8/2006	2/17/2006
0602192-01B	WQ020806:800 NP2-6		2/8/2006	2/17/2006
0602192-01C	WQ020806:800 NP2-6		2/8/2006	2/17/2006
0602192-02A	WQ020806:805 NP2-7		2/8/2006	2/17/2006
0602192-02B	WQ020806:805 NP2-7		2/8/2006	2/17/2006
0602192-02C	WQ020806:805 NP2-7		2/8/2006	2/17/2006
0602192-03A	WQ020806:810 NP2-10		2/8/2006	2/17/2006
0602192-03B	WQ020806:810 NP2-10		2/8/2006	2/17/2006
0602192-03C	WQ020806:810 NP2-10		2/8/2006	2/17/2006

56 TOLEDO STREET • FARMINGDALE, NY 11735 • (516) 454-6100 • FAX (516) 454-8027

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100

FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 06-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602192
Project: Rowe Industries
Lab ID: 0602192-01A

Client Sample ID: WQ020806:800 NP2-6
Tag Number:
Collection Date: 2/8/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
1,1,1-Trichloroethane	3.8	1.0		µg/L	1	2/21/2006 5:23:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
2-Butanone	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
2-Hexanone	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Acetone	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Benzene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Bromobenzene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Bromochloromethane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Bromodichloromethane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Bromoform	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Bromomethane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Carbon disulfide	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Chlorobenzene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM

Qualifiers:
 B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 S Spike Recovery outside accepted recovery limits
 X Value exceeds Maximum Contaminant Level

E Value above quantitation range
 ND Not Detected at the Reporting Limit
 U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 06-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602192
Project: Rowe Industries
Lab ID: 0602192-01A

Client Sample ID: WQ020806:800 NP2-6
Tag Number:
Collection Date: 2/8/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Chloroform	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Chloromethane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Dibromochloromethane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Dibromomethane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Ethylbenzene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Isopropylbenzene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
m,p-Xylene	U	2.0		µg/L	1	2/21/2006 5:23:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Methylene chloride	U	1.0	B	µg/L	1	2/21/2006 5:23:00 AM
Naphthalene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
n-Butylbenzene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
n-Propylbenzene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
o-Xylene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Styrene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Tetrachloroethene	16	1.0		µg/L	1	2/21/2006 5:23:00 AM
Toluene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Trichloroethene	1.6	1.0		µg/L	1	2/21/2006 5:23:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Vinyl acetate	U	1.0		µg/L	1	2/21/2006 5:23:00 AM
Vinyl chloride	U	1.0		µg/L	1	2/21/2006 5:23:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected
	X	Value exceeds Maximum Contaminant Level		

American Analytical Laboratories, LLC.

Date: 06-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602192
Project: Rowe Industries
Lab ID: 0602192-01B

Client Sample ID: WQ020806:800 NP2-6
Tag Number:
Collection Date: 2/8/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	1.98	0.0200		mg/L	1	3/2/2006 2:01:04 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected
	X	Value exceeds Maximum Contaminant Level		

American Analytical Laboratories, LLC.

Date: 06-Mar-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ020806:800 NP2-6
Lab Order:	0602192	Tag Number:	
Project:	Rowe Industries	Collection Date:	2/8/2006
Lab ID:	0602192-01C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	U	0.0200		mg/L	1	3/2/2006 1:53:07 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected
	X	Value exceeds Maximum Contaminant Level		

American Analytical Laboratories, LLC.

Date: 06-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602192
Project: Rowe Industries
Lab ID: 0602192-02A

Client Sample ID: WQ020806:805 NP2-7
Tag Number:
Collection Date: 2/8/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
2-Butanone	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
2-Hexanone	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Acetone	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Benzene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Bromobenzene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Bromochloromethane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Bromodichloromethane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Bromoform	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Bromomethane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Carbon disulfide	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Chlorobenzene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected
	X	Value exceeds Maximum Contaminant Level		

American Analytical Laboratories, LLC.

Date: 06-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602192
Project: Rowe Industries
Lab ID: 0602192-02A

Client Sample ID: WQ020806:805 NP2-7
Tag Number:
Collection Date: 2/8/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Chloroform	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Chloromethane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Dibromochloromethane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Dibromomethane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Ethylbenzene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Isopropylbenzene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
m,p-Xylene	U	2.0		µg/L	1	2/21/2006 7:15:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Methylene chloride	U	1.0	B	µg/L	1	2/21/2006 7:15:00 AM
Naphthalene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
n-Butylbenzene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
n-Propylbenzene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
o-Xylene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Styrene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Tetrachloroethene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Toluene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Trichloroethene	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Vinyl acetate	U	1.0		µg/L	1	2/21/2006 7:15:00 AM
Vinyl chloride	U	1.0		µg/L	1	2/21/2006 7:15:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected
	X	Value exceeds Maximum Contaminant Level		

American Analytical Laboratories, LLC.

Date: 06-Mar-06

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** WQ020806:805 NP2-7**Lab Order:** 0602192**Tag Number:****Project:** Rowe Industries**Collection Date:** 2/8/2006**Lab ID:** 0602192-02B**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	2.50	0.0200		mg/L	1	3/2/2006 2:14:33 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected
	X	Value exceeds Maximum Contaminant Level		

American Analytical Laboratories, LLC.

Date: 06-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602192
Project: Rowe Industries
Lab ID: 0602192-02C

Client Sample ID: WQ020806:805 NP2-7
Tag Number:
Collection Date: 2/8/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.0408	0.0200		mg/L	1	3/2/2006 2:11:28 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected
	X	Value exceeds Maximum Contaminant Level		

American Analytical Laboratories, LLC.

Date: 06-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602192
Project: Rowe Industries
Lab ID: 0602192-03A

Client Sample ID: WQ020806:810 NP2-10
Tag Number:
Collection Date: 2/8/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
2-Butanone	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
2-Hexanone	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Acetone	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Benzene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Bromobenzene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Bromochloromethane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Bromodichloromethane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Bromoform	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Bromomethane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Carbon disulfide	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Chlorobenzene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected
	X	Value exceeds Maximum Contaminant Level		

American Analytical Laboratories, LLC.

Date: 06-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602192
Project: Rowe Industries
Lab ID: 0602192-03A

Client Sample ID: WQ020806:810 NP2-10
Tag Number:
Collection Date: 2/8/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Chloroform	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Chloromethane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Dibromochloromethane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Dibromomethane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Ethylbenzene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Isopropylbenzene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
m,p-Xylene	U	2.0		µg/L	1	2/21/2006 7:53:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Methylene chloride	U	1.0	B	µg/L	1	2/21/2006 7:53:00 AM
Naphthalene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
n-Butylbenzene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
n-Propylbenzene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
o-Xylene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Styrene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Tetrachloroethene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Toluene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Trichloroethene	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Vinyl acetate	U	1.0		µg/L	1	2/21/2006 7:53:00 AM
Vinyl chloride	U	1.0		µg/L	1	2/21/2006 7:53:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected
	X	Value exceeds Maximum Contaminant Level		

American Analytical Laboratories, LLC.

Date: 06-Mar-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ020806:810 NP2-10
Lab Order:	0602192	Tag Number:	
Project:	Rowe Industries	Collection Date:	2/8/2006
Lab ID:	0602192-03B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	1.31	0.0200		mg/L	1	3/2/2006 2:18:04 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected
	X	Value exceeds Maximum Contaminant Level		

American Analytical Laboratories, LLC.

Date: 06-Mar-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ020806:810 NP2-10
Lab Order:	0602192	Tag Number:	
Project:	Rowe Industries	Collection Date:	2/8/2006
Lab ID:	0602192-03C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.0403	0.0200		mg/L	1	3/2/2006 2:31:06 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	116	1.00	H	mg/L	1	2/21/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected
	X	Value exceeds Maximum Contaminant Level		



NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Friday, March 03, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555

FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0602193

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 2/17/2006 for the analyses presented in the following report.

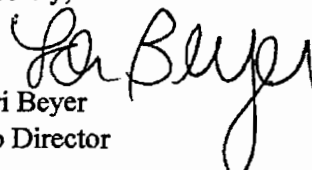
Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,


Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.**Project:** Rowe Industries**Lab Order:** 0602193**Work Order Sample Summary**

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0602193-01A	WQ021406:930 NP2-6		2/14/2006	2/17/2006
0602193-01B	WQ021406:930 NP2-6		2/14/2006	2/17/2006
0602193-01C	WQ021406:930 NP2-6		2/14/2006	2/17/2006
0602193-02A	WQ021406:955 NP2-7		2/14/2006	2/17/2006
0602193-02B	WQ021406:955 NP2-7		2/14/2006	2/17/2006
0602193-02C	WQ021406:955 NP2-7		2/14/2006	2/17/2006
0602193-03A	WQ021406:940 NP2-10		2/14/2006	2/17/2006
0602193-03B	WQ021406:940 NP2-10		2/14/2006	2/17/2006

NYSDOH	ELAP	11418
AIHA	PAT, LPAT	15668
CTDOH	PH-0205	

556 TOLEDO STREET • FARMINGDALE, NY 11735 • (516) 454-6100 • FAX (516) 454-8027

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602193
Project: Rowe Industries
Lab ID: 0602193-01A

Client Sample ID: WQ021406:930 NP2-6
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
1,1,1-Trichloroethane	3.9	1.0		µg/L	1	2/21/2006 8:31:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
2-Butanone	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
2-Hexanone	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Acetone	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Benzene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Bromobenzene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Bromochloromethane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Bromodichloromethane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Bromoform	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Bromomethane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Carbon disulfide	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Chlorobenzene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM

Qualifiers:
 B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 S Spike Recovery outside accepted recovery limits
 X Value exceeds Maximum Contaminant Level

E Value above quantitation range
 ND Not Detected at the Reporting Limit
 U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggett Brashears & Graham Inc.
Lab Order: 0602193
Project: Rowe Industries
Lab ID: 0602193-01A

Client Sample ID: WQ021406:930 NP2-6
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Chloroform	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Chloromethane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Dibromochloromethane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Dibromomethane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Ethylbenzene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Isopropylbenzene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
m,p-Xylene	U	2.0		µg/L	1	2/21/2006 8:31:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Methylene chloride	U	1.0	B	µg/L	1	2/21/2006 8:31:00 AM
Naphthalene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
n-Butylbenzene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
n-Propylbenzene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
o-Xylene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Styrene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Tetrachloroethene	16	1.0		µg/L	1	2/21/2006 8:31:00 AM
Toluene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Trichloroethene	1.4	1.0		µg/L	1	2/21/2006 8:31:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Vinyl acetate	U	1.0		µg/L	1	2/21/2006 8:31:00 AM
Vinyl chloride	U	1.0		µg/L	1	2/21/2006 8:31:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected
	X	Value exceeds Maximum Contaminant Level		

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602193
Project: Rowe Industries
Lab ID: 0602193-01B

Client Sample ID: WQ021406:930 NP2-6
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	2.45	0.0200		mg/L	1	3/2/2006 2:39:41 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected
	X	Value exceeds Maximum Contaminant Level		

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602193
Project: Rowe Industries
Lab ID: 0602193-01C

Client Sample ID: WQ021406:930 NP2-6
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	U	0.0200		mg/L	1	3/2/2006 2:36:24 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected
	X	Value exceeds Maximum Contaminant Level		

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggett Brashears & Graham Inc.
Lab Order: 0602193
Project: Rowe Industries
Lab ID: 0602193-02A

Client Sample ID: WQ021406:955 NP2-7
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11						Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
2-Butanone	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
2-Hexanone	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Acetone	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Benzene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Bromobenzene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Bromochloromethane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Bromodichloromethane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Bromoform	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Bromomethane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Carbon disulfide	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Chlorobenzene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected
	X	Value exceeds Maximum Contaminant Level		

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602193
Project: Rowe Industries
Lab ID: 0602193-02A

Client Sample ID: WQ021406:955 NP2-7
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Chloroform	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Chloromethane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Dibromochloromethane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Dibromomethane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Ethylbenzene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Isopropylbenzene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
m,p-Xylene	U	2.0		µg/L	1	2/21/2006 9:08:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Methylene chloride	U	1.0	B	µg/L	1	2/21/2006 9:08:00 AM
Naphthalene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
n-Butylbenzene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
n-Propylbenzene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
o-Xylene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Styrene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Tetrachloroethene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Toluene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Trichloroethene	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Vinyl acetate	U	1.0		µg/L	1	2/21/2006 9:08:00 AM
Vinyl chloride	U	1.0		µg/L	1	2/21/2006 9:08:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected
	X	Value exceeds Maximum Contaminant Level		

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602193
Project: Rowe Industries
Lab ID: 0602193-02B

Client Sample ID: WQ021406:955 NP2-7
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	1.58	0.0200		mg/L	1	3/2/2006 2:55:49 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected
	X	Value exceeds Maximum Contaminant Level		

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** WQ021406:955 NP2-7**Lab Order:** 0602193**Tag Number:****Project:** Rowe Industries**Collection Date:** 2/14/2006**Lab ID:** 0602193-02C**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.0423	0.0200		mg/L	1	3/2/2006 2:52:46 PM

Qualifiers:

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
S Spike Recovery outside accepted recovery limits
X Value exceeds Maximum Contaminant Level

E Value above quantitation range
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** WQ021406:940 NP2-10**Lab Order:** 0602193**Tag Number:****Project:** Rowe Industries**Collection Date:** 2/14/2006**Lab ID:** 0602193-03B**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	117	1.00		mg/L	1	2/21/2006

Qualifiers:

B	Analyte detected in the associated Method Blank
H	Holding times for preparation or analysis exceeded
S	Spike Recovery outside accepted recovery limits
X	Value exceeds Maximum Contaminant Level

E	Value above quantitation range
ND	Not Detected at the Reporting Limit
U	Indicates the compound was analyzed for but not detected

Page 10 of 10

03/03/06



NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Wednesday, March 08, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0602286

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 2/28/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,


Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 08-Mar-06

CLIENT: Leggette Brashears & Graham Inc.**Project:** Rowe Industries**Lab Order:** 0602286**Work Order Sample Summary**

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0602286-01A	WQ022206:800 NP2-6		2/22/2006 8:00:00 AM	2/28/2006
0602286-01B	WQ022206:800 NP2-6		2/22/2006 8:00:00 AM	2/28/2006
0602286-01C	WQ022206:800 NP2-6		2/22/2006 8:00:00 AM	2/28/2006
0602286-02A	WQ022206:805 NP2-7		2/22/2006 8:05:00 AM	2/28/2006
0602286-02B	WQ022206:805 NP2-7		2/22/2006 8:05:00 AM	2/28/2006
0602286-02C	WQ022206:805 NP2-7		2/22/2006 8:05:00 AM	2/28/2006
0602286-03A	WQ022206:810 NP2-10		2/22/2006 8:10:00 AM	2/28/2006
0602286-03B	WQ022206:810 NP2-10		2/22/2006 8:10:00 AM	2/28/2006
0602286-03C	WQ022206:810 NP2-10		2/22/2006 8:10:00 AM	2/28/2006



NYSDOH	ELAP	11418
AIHA	PAT, LPAT	15668
CTDOH	PH-0205	

56 TOLEDO STREET • FARMINGDALE, NY 11735 • (516) 454-6100 • FAX (516) 454-8027

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 08-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602286
Project: Rowe Industries
Lab ID: 0602286-01A

Client Sample ID: WQ022206:800 NP2-6
Tag Number:
Collection Date: 2/22/2006 8:00:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: SB		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
1,1,1-Trichloroethane	3.4	1.0		µg/L	1	2/28/2006 4:41:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
2-Butanone	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
2-Hexanone	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Acetone	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Benzene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Bromobenzene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Bromochloromethane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Bromodichloromethane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Bromoform	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Bromomethane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Carbon disulfide	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Chlorobenzene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 08-Mar-06

CLIENT: Leggette Brashears & Graham Inc. **Client Sample ID:** WQ022206:800 NP2-6
Lab Order: 0602286 **Tag Number:**
Project: Rowe Industries **Collection Date:** 2/22/2006 8:00:00 AM
Lab ID: 0602286-01A **Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: SB		
Chloroethane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Chloroform	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Chloromethane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Dibromochloromethane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Dibromomethane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Ethylbenzene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Isopropylbenzene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
m,p-Xylene	U	2.0		µg/L	1	2/28/2006 4:41:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Methylene chloride	U	1.0	B	µg/L	1	2/28/2006 4:41:00 PM
Naphthalene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
n-Butylbenzene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
n-Propylbenzene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
o-Xylene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Styrene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Tetrachloroethene	16	1.0		µg/L	1	2/28/2006 4:41:00 PM
Toluene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Trichloroethene	0.76	1.0	J	µg/L	1	2/28/2006 4:41:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Vinyl acetate	U	1.0		µg/L	1	2/28/2006 4:41:00 PM
Vinyl chloride	U	1.0		µg/L	1	2/28/2006 4:41:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 08-Mar-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ022206:800 NP2-6
Lab Order:	0602286	Tag Number:	
Project:	Rowe Industries	Collection Date:	2/22/2006 8:00:00 AM
Lab ID:	0602286-01B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7				Analyst: JP
Iron	14.2	0.0200		mg/L	1	3/6/2006 3:35:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 08-Mar-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ022206:800 NP2-6
Lab Order:	0602286	Tag Number:	
Project:	Rowe Industries	Collection Date:	2/22/2006 8:00:00 AM
Lab ID:	0602286-01C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.0268	0.0200		mg/L	1	3/6/2006 3:32:52 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 08-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602286
Project: Rowe Industries
Lab ID: 0602286-02A

Client Sample ID: WQ022206:805 NP2-7
Tag Number:
Collection Date: 2/22/2006 8:05:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: SB		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
2-Butanone	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
2-Hexanone	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Acetone	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Benzene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Bromobenzene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Bromochloromethane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Bromodichloromethane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Bromoform	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Bromomethane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Carbon disulfide	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Chlorobenzene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM

Qualifiers: B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits
X Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 08-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602286
Project: Rowe Industries
Lab ID: 0602286-02A

Client Sample ID: WQ022206:805 NP2-7
Tag Number:
Collection Date: 2/22/2006 8:05:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: SB		
Chloroethane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Chloroform	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Chloromethane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Dibromochloromethane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Dibromomethane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Ethylbenzene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Isopropylbenzene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
m,p-Xylene	U	2.0		µg/L	1	2/28/2006 5:16:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Methylene chloride	U	1.0	B	µg/L	1	2/28/2006 5:16:00 PM
Naphthalene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
n-Butylbenzene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
n-Propylbenzene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
o-Xylene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Styrene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Tetrachloroethene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Toluene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Trichloroethene	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Vinyl acetate	U	1.0		µg/L	1	2/28/2006 5:16:00 PM
Vinyl chloride	U	1.0		µg/L	1	2/28/2006 5:16:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 08-Mar-06

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** WQ022206:805 NP2-7**Lab Order:** 0602286**Tag Number:****Project:** Rowe Industries**Collection Date:** 2/22/2006 8:05:00 AM**Lab ID:** 0602286-02B**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7				Analyst: JP
Iron	30.9	0.0200		mg/L	1	3/6/2006 3:47:03 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 08-Mar-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ022206:805 NP2-7
Lab Order:	0602286	Tag Number:	
Project:	Rowe Industries	Collection Date:	2/22/2006 8:05:00 AM
Lab ID:	0602286-02C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.406	0.0200		mg/L	1	3/6/2006 3:37:27 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 08-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602286
Project: Rowe Industries
Lab ID: 0602286-03A

Client Sample ID: WQ022206:810 NP2-10
Tag Number:
Collection Date: 2/22/2006 8:10:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: SB		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
2-Butanone	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
2-Hexanone	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Acetone	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Benzene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Bromobenzene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Bromochloromethane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Bromodichloromethane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Bromoform	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Bromomethane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Carbon disulfide	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Chlorobenzene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM

Qualifiers:
 B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit
 U Indicates the compound was analyzed for but not detected

E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits
 X Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 08-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602286
Project: Rowe Industries
Lab ID: 0602286-03A

Client Sample ID: WQ022206:810 NP2-10
Tag Number:
Collection Date: 2/22/2006 8:10:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: SB		
Chloroethane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Chloroform	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Chloromethane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Dibromochloromethane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Dibromomethane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Ethylbenzene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Isopropylbenzene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
m,p-Xylene	U	2.0		µg/L	1	2/28/2006 5:51:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Methylene chloride	U	1.0	B	µg/L	1	2/28/2006 5:51:00 PM
Naphthalene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
n-Butylbenzene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
n-Propylbenzene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
o-Xylene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Styrene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Tetrachloroethene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Toluene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Trichloroethene	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Vinyl acetate	U	1.0		µg/L	1	2/28/2006 5:51:00 PM
Vinyl chloride	U	1.0		µg/L	1	2/28/2006 5:51:00 PM

Qualifiers:
 B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit
 U Indicates the compound was analyzed for but not detected

E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits
 X Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 08-Mar-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ022206:810 NP2-10
Lab Order:	0602286	Tag Number:	
Project:	Rowe Industries	Collection Date:	2/22/2006 8:10:00 AM
Lab ID:	0602286-03B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7				Analyst: JP
Iron	63.0	0.0200		mg/L	1	3/6/2006 3:54:04 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 08-Mar-06

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** WQ022206:810 NP2-10**Lab Order:** 0602286**Tag Number:****Project:** Rowe Industries**Collection Date:** 2/22/2006 8:10:00 AM**Lab ID:** 0602286-03C**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.576	0.0200		mg/L	1	3/6/2006 3:51:05 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	250	1.00		mg/L	1	3/1/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Thursday, March 09, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555

FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0603001

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 3/1/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,


Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 09-Mar-06

CLIENT: Leggette Brashears & Graham Inc.**Project:** Rowe Industries**Lab Order:** 0603001**Work Order Sample Summary**

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0603001-01A	WQ022806:800 NP2-6	2549	2/28/2006	3/1/2006
0603001-01B	WQ022806:800 NP2-6	2549	2/28/2006	3/1/2006
0603001-01C	WQ022806:800 NP2-6	2549	2/28/2006	3/1/2006
0603001-02A	WQ022806:805 NP-2-7	2549	2/28/2006	3/1/2006
0603001-02B	WQ022806:805 NP-2-7	2549	2/28/2006	3/1/2006
0603001-02C	WQ022806:805 NP-2-7	2549	2/28/2006	3/1/2006
0603001-03A	WQ022806:810 NP2-10	2549	2/28/2006	3/1/2006
0603001-03B	WQ022806:810 NP2-10	2549	2/28/2006	3/1/2006
0603001-03C	WQ022806:810 NP2-10	2549	2/28/2006	3/1/2006



56 TOLEDO STREET • FARMINGDALE, NEW YORK 11735
(631) 454-6100 • FAX (631) 454-8027

NYSDOH	11418
CTDOH	PH-0205
NJDEP	NY050
PADEP	68-573

TAG # / COC 2549

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100

FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 09-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0603001
Project: Rowe Industries
Lab ID: 0603001-01A

Client Sample ID: WQ022806:800 NP2-6
Tag Number: 2549
Collection Date: 2/28/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: SB		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
1,1,1-Trichloroethane	3.2	1.0		µg/L	1	3/1/2006 12:23:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
2-Butanone	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
2-Hexanone	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Acetone	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Benzene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Bromobenzene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Bromochloromethane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Bromodichloromethane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Bromoform	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Bromomethane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Carbon disulfide	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Chlorobenzene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 09-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0603001
Project: Rowe Industries
Lab ID: 0603001-01A

Client Sample ID: WQ022806:800 NP2-6
Tag Number: 2549
Collection Date: 2/28/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: SB		
Chloroethane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Chloroform	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Chloromethane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Dibromochloromethane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Dibromomethane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Ethylbenzene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Isopropylbenzene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
m,p-Xylene	U	2.0		µg/L	1	3/1/2006 12:23:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Methylene chloride	U	1.0	B	µg/L	1	3/1/2006 12:23:00 PM
Naphthalene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
n-Butylbenzene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
n-Propylbenzene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
o-Xylene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Styrene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Tetrachloroethene	17	1.0		µg/L	1	3/1/2006 12:23:00 PM
Toluene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Trichloroethene	0.81	1.0	J	µg/L	1	3/1/2006 12:23:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Vinyl acetate	U	1.0		µg/L	1	3/1/2006 12:23:00 PM
Vinyl chloride	U	1.0		µg/L	1	3/1/2006 12:23:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 09-Mar-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ022806:800 NP2-6
Lab Order:	0603001	Tag Number:	2549
Project:	Rowe Industries	Collection Date:	2/28/2006
Lab ID:	0603001-01B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	2.89	0.0200		mg/L	1	3/7/2006 3:21:32 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 09-Mar-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ022806:800 NP2-6
Lab Order:	0603001	Tag Number:	2549
Project:	Rowe Industries	Collection Date:	2/28/2006
Lab ID:	0603001-01C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.0386	0.0200		mg/L	1	3/7/2006 3:18:07 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 09-Mar-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ022806:805 NP-2-7
Lab Order:	0603001	Tag Number:	2549
Project:	Rowe Industries	Collection Date:	2/28/2006
Lab ID:	0603001-02A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: SB		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
2-Butanone	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
2-Hexanone	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Acetone	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Benzene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Bromobenzene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Bromochloromethane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Bromodichloromethane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Bromoform	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Bromomethane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Carbon disulfide	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Chlorobenzene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 09-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0603001
Project: Rowe Industries
Lab ID: 0603001-02A

Client Sample ID: WQ022806:805 NP-2-7
Tag Number: 2549
Collection Date: 2/28/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: SB		
Chloroethane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Chloroform	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Chloromethane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Dibromochloromethane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Dibromomethane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Ethylbenzene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Isopropylbenzene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
m,p-Xylene	U	2.0		µg/L	1	3/1/2006 2:29:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Methylene chloride	U	1.0	B	µg/L	1	3/1/2006 2:29:00 PM
Naphthalene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
n-Butylbenzene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
n-Propylbenzene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
o-Xylene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Styrene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Tetrachloroethene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Toluene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Trichloroethene	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Vinyl acetate	U	1.0		µg/L	1	3/1/2006 2:29:00 PM
Vinyl chloride	U	1.0		µg/L	1	3/1/2006 2:29:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.**Date:** 09-Mar-06**CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** WQ022806:805 NP-2-7**Lab Order:** 0603001**Tag Number:** 2549**Project:** Rowe Industries**Collection Date:** 2/28/2006**Lab ID:** 0603001-02B**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	102	0.0200		mg/L	1	3/7/2006 3:26:30 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 09-Mar-06

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ022806:805 NP-2-7

Lab Order: 0603001

Tag Number: 2549

Project: Rowe Industries

Collection Date: 2/28/2006

Lab ID: 0603001-02C

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.832	0.0200		mg/L	1	3/7/2006 3:24:21 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 09-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0603001
Project: Rowe Industries
Lab ID: 0603001-03A

Client Sample ID: WQ022806:810 NP2-10
Tag Number: 2549
Collection Date: 2/28/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: SB		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
2-Butanone	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
2-Hexanone	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Acetone	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Benzene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Bromobenzene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Bromochloromethane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Bromodichloromethane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Bromoform	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Bromomethane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Carbon disulfide	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Chlorobenzene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM

Qualifiers: B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit
 U Indicates the compound was analyzed for but not detected

E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits
 X Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 09-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0603001
Project: Rowe Industries
Lab ID: 0603001-03A

Client Sample ID: WQ022806:810 NP2-10
Tag Number: 2549
Collection Date: 2/28/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: SB		
Chloroethane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Chloroform	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Chloromethane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Dibromochloromethane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Dibromomethane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Ethylbenzene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Isopropylbenzene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
m,p-Xylene	U	2.0		µg/L	1	3/1/2006 3:04:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Methylene chloride	U	1.0	B	µg/L	1	3/1/2006 3:04:00 PM
Naphthalene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
n-Butylbenzene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
n-Propylbenzene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
o-Xylene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Styrene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Tetrachloroethene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Toluene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Trichloroethene	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Vinyl acetate	U	1.0		µg/L	1	3/1/2006 3:04:00 PM
Vinyl chloride	U	1.0		µg/L	1	3/1/2006 3:04:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 09-Mar-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ022806:810 NP2-10
Lab Order:	0603001	Tag Number:	2549
Project:	Rowe Industries	Collection Date:	2/28/2006
Lab ID:	0603001-03B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	164	0.0200		mg/L	1	3/7/2006 3:41:31 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 09-Mar-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ022806:810 NP2-10
Lab Order:	0603001	Tag Number:	2549
Project:	Rowe Industries	Collection Date:	2/28/2006
Lab ID:	0603001-03C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	2.03	0.0200		mg/L	1	3/7/2006 3:37:31 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	89.0	1.00		mg/L	1	3/7/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



NYSDOH 11418
NJDEP NY060
CTDOH PH-0205
PADEP 68-00573

Thursday, March 02, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0602194

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 7 sample(s) on 2/17/2006 for the analyses presented in the following report.

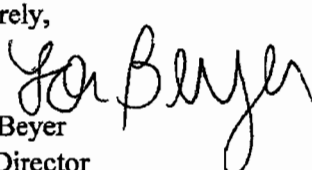
Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,


Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 02-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0602194

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0602194-01A	GWQ021406:800 NP1-1-2		2/14/2006	2/17/2006
0602194-01B	GWQ021406:800 NP1-1-2		2/14/2006	2/17/2006
0602194-01C	GWQ021406:800 NP1-1-2		2/14/2006	2/17/2006
0602194-01D	GWQ021406:800 NP1-1-2		2/14/2006	2/17/2006
0602194-02A	GWQ021406:810 NP1-1-3		2/14/2006	2/17/2006
0602194-02B	GWQ021406:810 NP1-1-3		2/14/2006	2/17/2006
0602194-02C	GWQ021406:810 NP1-1-3		2/14/2006	2/17/2006
0602194-02D	GWQ021406:810 NP1-1-3		2/14/2006	2/17/2006
0602194-03A	GWQ021406:820 NP1-1-4		2/14/2006	2/17/2006
0602194-03B	GWQ021406:820 NP1-1-4		2/14/2006	2/17/2006
0602194-03C	GWQ021406:820 NP1-1-4		2/14/2006	2/17/2006
0602194-03D	GWQ021406:820 NP1-1-4		2/14/2006	2/17/2006
0602194-04A	GWQ021406:830 NP1-1-5		2/14/2006	2/17/2006
0602194-04B	GWQ021406:830 NP1-1-5		2/14/2006	2/17/2006
0602194-04C	GWQ021406:830 NP1-1-5		2/14/2006	2/17/2006
0602194-04D	GWQ021406:830 NP1-1-5		2/14/2006	2/17/2006
0602194-05A	GWQ021406:850 NP1-1-7		2/14/2006	2/17/2006
0602194-05B	GWQ021406:850 NP1-1-7		2/14/2006	2/17/2006
0602194-05C	GWQ021406:850 NP1-1-7		2/14/2006	2/17/2006
0602194-05D	GWQ021406:850 NP1-1-7		2/14/2006	2/17/2006
0602194-06A	GWQ021406:900 NP1-1-8		2/14/2006	2/17/2006
0602194-06B	GWQ021406:900 NP1-1-8		2/14/2006	2/17/2006
0602194-06C	GWQ021406:900 NP1-1-8		2/14/2006	2/17/2006
0602194-06D	GWQ021406:900 NP1-1-8		2/14/2006	2/17/2006
0602194-07A	GWQ021406:910 NP1-1-9		2/14/2006	2/17/2006
0602194-07B	GWQ021406:910 NP1-1-9		2/14/2006	2/17/2006
0602194-07C	GWQ021406:910 NP1-1-9		2/14/2006	2/17/2006
0602194-07D	GWQ021406:910 NP1-1-9		2/14/2006	2/17/2006

CLIENT NAME/ADDRESS				CONTACT:		DATE		TIME		SAMPLE(S) SEALED		YES/NO	
LABORATORY ID #				MATRIX		TYPE		PRES.		SAMPLE # - LOCATION		PROJECT LOCATION:	
LBB				4 Research Dr.		Shelton, CT 06484		Mark Goldberg		2/16/06		10:00	
PROJECT LOCATION:				Rowe		L		G		HC11 Hw03		GWQ021406; 800 NPI-1-2	
MISSING 140A				L		G		HC11 Hw03		810 NPI-1-3		820 NPI-1-4	
				L		G		HC11 Hw03		830 NPI-1-5		840 NPI-1-6	
				L		G		HC11 Hw03		850 NPI-1-7		860 NPI-1-8	
				L		G		HC11 Hw03		870 NPI-1-9		880 NPI-1-10	
				L		G		HC11 Hw03		890 NPI-1-11		900 NPI-1-12	
				L		G		HC11 Hw03		910 NPI-1-13		920 NPI-1-14	
				L		G		HC11 Hw03		930 NPI-1-15		940 NPI-1-16	
				L		G		HC11 Hw03		950 NPI-1-17		960 NPI-1-18	
				L		G		HC11 Hw03		970 NPI-1-19		980 NPI-1-20	
				L		G		HC11 Hw03		990 NPI-1-21		1000 NPI-1-22	
				L		G		HC11 Hw03		1010 NPI-1-23		1020 NPI-1-24	
				L		G		HC11 Hw03		1030 NPI-1-25		1040 NPI-1-26	
				L		G		HC11 Hw03		1050 NPI-1-27		1060 NPI-1-28	
				L		G		HC11 Hw03		1070 NPI-1-29		1080 NPI-1-30	
				L		G		HC11 Hw03		1090 NPI-1-31		1100 NPI-1-32	
				L		G		HC11 Hw03		1110 NPI-1-33		1120 NPI-1-34	
				L		G		HC11 Hw03		1130 NPI-1-35		1140 NPI-1-36	
				L		G		HC11 Hw03		1150 NPI-1-37		1160 NPI-1-38	
				L		G		HC11 Hw03		1170 NPI-1-39		1180 NPI-1-40	
				L		G		HC11 Hw03		1190 NPI-1-41		1200 NPI-1-42	
				L		G		HC11 Hw03		1210 NPI-1-43		1220 NPI-1-44	
				L		G		HC11 Hw03		1230 NPI-1-45		1240 NPI-1-46	
				L		G		HC11 Hw03		1250 NPI-1-47		1260 NPI-1-48	
				L		G		HC11 Hw03		1270 NPI-1-49		1280 NPI-1-50	
				L		G		HC11 Hw03		1290 NPI-1-51		1300 NPI-1-52	
				L		G		HC11 Hw03		1310 NPI-1-53		1320 NPI-1-54	
				L		G		HC11 Hw03		1330 NPI-1-55		1340 NPI-1-56	
				L		G		HC11 Hw03		1350 NPI-1-57		1360 NPI-1-58	
				L		G		HC11 Hw03		1370 NPI-1-59		1380 NPI-1-60	
				L		G		HC11 Hw03		1390 NPI-1-61		1400 NPI-1-62	
				L		G		HC11 Hw03		1410 NPI-1-63		1420 NPI-1-64	
				L		G		HC11 Hw03		1430 NPI-1-65		1440 NPI-1-66	
				L		G		HC11 Hw03		1450 NPI-1-67		1460 NPI-1-68	
				L		G		HC11 Hw03		1470 NPI-1-69		1480 NPI-1-70	
				L		G		HC11 Hw03		1490 NPI-1-71		1500 NPI-1-72	
				L		G		HC11 Hw03		1510 NPI-1-73		1520 NPI-1-74	
				L		G		HC11 Hw03		1530 NPI-1-75		1540 NPI-1-76	
				L		G		HC11 Hw03		1550 NPI-1-77		1560 NPI-1-78	
				L		G		HC11 Hw03		1570 NPI-1-79		1580 NPI-1-80	
				L		G		HC11 Hw03		1590 NPI-1-81		1600 NPI-1-82	

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE / E.C.I. STODIAN / GOI DENBOD-CIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100

FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-01A

Client Sample ID: GWQ021406:800 NP1-1-2
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
1,1,1-Trichloroethane	1.2	1.0		µg/L	1	2/21/2006 9:45:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
2-Butanone	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
2-Hexanone	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Acetone	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Benzene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Bromobenzene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Bromochloromethane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Bromodichloromethane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Bromoform	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Bromomethane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Carbon disulfide	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Chlorobenzene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-01A

Client Sample ID: GWQ021406:800 NP1-1-2
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Chloroform	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Chloromethane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
cis-1,2-Dichloroethene	2.8	1.0		µg/L	1	2/21/2006 9:45:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Dibromochloromethane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Dibromomethane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Ethylbenzene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Isopropylbenzene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
m,p-Xylene	U	2.0		µg/L	1	2/21/2006 9:45:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Methylene chloride	U	1.0	B	µg/L	1	2/21/2006 9:45:00 AM
Naphthalene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
n-Butylbenzene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
n-Propylbenzene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
o-Xylene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Styrene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Tetrachloroethene	6.5	1.0		µg/L	1	2/21/2006 9:45:00 AM
Toluene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Trichloroethene	4.3	1.0		µg/L	1	2/21/2006 9:45:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Vinyl acetate	U	1.0		µg/L	1	2/21/2006 9:45:00 AM
Vinyl chloride	U	1.0		µg/L	1	2/21/2006 9:45:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-01B

Client Sample ID: GWQ021406:800 NP1-1-2
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON, MANGANESE		E200.7		SW3010A		Analyst: JP
Iron	3.99	0.0200		mg/L	1	3/1/2006 2:41:28 PM
Manganese	0.810	0.0200		mg/L	1	3/1/2006 2:41:28 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ021406:800 NP1-1-2**Lab Order:** 0602194**Tag Number:****Project:** Rowe Industries**Collection Date:** 2/14/2006**Lab ID:** 0602194-01C**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON, MANGANESE		E200.7		SW3005A		Analyst: JP
Iron	U	0.0200		mg/L	1	3/1/2006 2:39:04 PM
Manganese	0.718	0.0200		mg/L	1	3/1/2006 2:39:04 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ021406:800 NP1-1-2**Lab Order:** 0602194**Tag Number:****Project:** Rowe Industries**Collection Date:** 2/14/2006**Lab ID:** 0602194-01D**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS						Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	57.6	1.00	M2340 B	mg/L	1	3/1/2006
TURBIDITY						Analyst: KK
Turbidity	1.30	1.00	E180.1 H	NTU	1	2/20/2006
TOTAL DISSOLVED SOLIDS						Analyst: VP
Total Dissolved Solids (Residue, Filterable)	140	1.00	E160.1	mg/L	1	2/21/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-02A

Client Sample ID: GWQ021406:810 NP1-1-3
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
1,1,1-Trichloroethane	2.5	1.0		µg/L	1	2/21/2006 10:22:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
2-Butanone	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
2-Hexanone	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Acetone	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Benzene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Bromobenzene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Bromochloromethane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Bromodichloromethane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Bromoform	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Bromomethane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Carbon disulfide	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Chlorobenzene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-02A

Client Sample ID: GWQ021406:810 NP1-1-3
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Chloroform	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Chloromethane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Dibromochloromethane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Dibromomethane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Ethylbenzene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Isopropylbenzene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
m,p-Xylene	U	2.0		µg/L	1	2/21/2006 10:22:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Methylene chloride	U	1.0	B	µg/L	1	2/21/2006 10:22:00 AM
Naphthalene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
n-Butylbenzene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
n-Propylbenzene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
o-Xylene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Styrene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Tetrachloroethene	1.4	1.0		µg/L	1	2/21/2006 10:22:00 AM
Toluene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Trichloroethene	8.9	1.0		µg/L	1	2/21/2006 10:22:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Vinyl acetate	U	1.0		µg/L	1	2/21/2006 10:22:00 AM
Vinyl chloride	U	1.0		µg/L	1	2/21/2006 10:22:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ021406:810 NP1-1-3

Lab Order: 0602194

Tag Number:

Project: Rowe Industries

Collection Date: 2/14/2006

Lab ID: 0602194-02B

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON, MANGANESE		E200.7		SW3010A		Analyst: JP
Iron	3.80	0.0200		mg/L	1	3/1/2006 2:47:07 PM
Manganese	0.114	0.0200		mg/L	1	3/1/2006 2:47:07 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-02C

Client Sample ID: GWQ021406:810 NP1-1-3
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON, MANGANESE		E200.7		SW3005A		Analyst: JP
Iron	0.157	0.0200		mg/L	1	3/1/2006 2:45:12 PM
Manganese	0.0960	0.0200		mg/L	1	3/1/2006 2:45:12 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ021406:810 NP1-1-3
Lab Order:	0602194	Tag Number:	
Project:	Rowe Industries	Collection Date:	2/14/2006
Lab ID:	0602194-02D	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	41.2	1.00		mg/L	1	3/1/2006
TURBIDITY		E180.1				Analyst: KK
Turbidity	2.90	1.00	H	NTU	1	2/20/2006
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	93.0	1.00		mg/L	1	2/21/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-03A

Client Sample ID: GWQ021406:820 NP1-1-4
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
1,1,1-Trichloroethane	8.7	1.0		µg/L	1	2/21/2006 10:59:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
1,1-Dichloropropane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
2-Butanone	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
2-Hexanone	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Acetone	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Benzene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Bromobenzene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Bromochloromethane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Bromodichloromethane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Bromoform	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Bromomethane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Carbon disulfide	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Chlorobenzene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-03A

Client Sample ID: GWQ021406:820 NP1-1-4
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Chloroform	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Chloromethane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Dibromochloromethane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Dibromomethane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Ethylbenzene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Isopropylbenzene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
m,p-Xylene	U	2.0		µg/L	1	2/21/2006 10:59:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Methylene chloride	U	1.0	B	µg/L	1	2/21/2006 10:59:00 AM
Naphthalene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
n-Butylbenzene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
n-Propylbenzene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
o-Xylene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Styrene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Tetrachloroethene	24	1.0		µg/L	1	2/21/2006 10:59:00 AM
Toluene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Trichloroethene	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Vinyl acetate	U	1.0		µg/L	1	2/21/2006 10:59:00 AM
Vinyl chloride	U	1.0		µg/L	1	2/21/2006 10:59:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ021406:820 NP1-1-4**Lab Order:** 0602194**Tag Number:****Project:** Rowe Industries**Collection Date:** 2/14/2006**Lab ID:** 0602194-03B**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON, MANGANESE		E200.7		SW3010A		Analyst: JP
Iron	6.05	0.0200		mg/L	1	3/1/2006 2:51:35 PM
Manganese	1.34	0.0200		mg/L	1	3/1/2006 2:51:35 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-03C

Client Sample ID: GWQ021406:820 NP1-1-4
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON, MANGANESE		E200.7		SW3005A		Analyst: JP
Iron	0.0627	0.0200		mg/L	1	3/1/2006 2:49:31 PM
Manganese	1.31	0.0200		mg/L	1	3/1/2006 2:49:31 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-03D

Client Sample ID: GWQ021406:820 NP1-1-4
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS Hardness, Calcium/Magnesium (As CaCO ₃)	39.0	M2340 B 1.00		mg/L	1	Analyst: JP 3/1/2006
TURBIDITY Turbidity	U	E180.1 1.00	H	NTU	1	Analyst: KK 2/20/2006
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	164	E160.1 1.00		mg/L	1	Analyst: VP 2/21/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-04A

Client Sample ID: GWQ021406:830 NP1-1-5
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
1,1,1-Trichloroethane	3.8	1.0		µg/L	1	2/21/2006 11:37:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
2-Butanone	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
2-Hexanone	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Acetone	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Benzene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Bromobenzene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Bromochloromethane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Bromodichloromethane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Bromofom	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Bromomethane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Carbon disulfide	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Chlorobenzene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM

Qualifiers: B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits
X Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-04A

Client Sample ID: GWQ021406:830 NP1-1-5
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Chloroform	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Chloromethane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Dibromochloromethane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Dibromomethane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Ethylbenzene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Isopropylbenzene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
m,p-Xylene	U	2.0		µg/L	1	2/21/2006 11:37:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Methylene chloride	U	1.0	B	µg/L	1	2/21/2006 11:37:00 AM
Naphthalene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
n-Butylbenzene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
n-Propylbenzene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
o-Xylene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Styrene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Tetrachloroethene	2.9	1.0		µg/L	1	2/21/2006 11:37:00 AM
Toluene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Trichloroethene	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Vinyl acetate	U	1.0		µg/L	1	2/21/2006 11:37:00 AM
Vinyl chloride	U	1.0		µg/L	1	2/21/2006 11:37:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ021406:830 NP1-1-5**Lab Order:** 0602194**Tag Number:****Project:** Rowe Industries**Collection Date:** 2/14/2006**Lab ID:** 0602194-04B**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON, MANGANESE		E200.7		SW3010A		Analyst: JP
Iron	U	0.0200		mg/L	1	3/1/2006 3:06:34 PM
Manganese	0.00727	0.0200	J	mg/L	1	3/1/2006 3:06:34 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-04C

Client Sample ID: GWQ021406:830 NP1-1-5
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON, MANGANESE		E200.7		SW3005A		Analyst: JP
Iron	U	0.0200		mg/L	1	3/1/2006 3:02:56 PM
Manganese	0.00759	0.0200	J	mg/L	1	3/1/2006 3:02:56 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-04D

Client Sample ID: GWQ021406:830 NP1-1-5
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	38.9	1.00		mg/L	1	3/1/2006
TURBIDITY		E180.1				Analyst: KK
Turbidity	U	1.00	H	NTU	1	2/20/2006
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	149	1.00		mg/L	1	2/21/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-05A

Client Sample ID: GWQ021406:850 NP1-1-7
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
1,1,1-Trichloroethane	4.1	1.0		µg/L	1	2/21/2006 12:14:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
1,1-Dichloroethane	2.0	1.0		µg/L	1	2/21/2006 12:14:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
2-Butanone	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
2-Hexanone	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Acetone	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Benzene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Bromobenzene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Bromochloromethane	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Bromodichloromethane	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Bromoform	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Bromomethane	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Carbon disulfide	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Chlorobenzene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-05A

Client Sample ID: GWQ021406:850 NP1-1-7
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Chloroform	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Chloromethane	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Dibromochloromethane	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Dibromomethane	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Ethylbenzene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Isopropylbenzene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
m,p-Xylene	U	2.0		µg/L	1	2/21/2006 12:14:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Methylene chloride	U	1.0	B	µg/L	1	2/21/2006 12:14:00 PM
Naphthalene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
n-Butylbenzene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
n-Propylbenzene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
o-Xylene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Styrene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Tetrachloroethene	36	1.0		µg/L	1	2/21/2006 12:14:00 PM
Toluene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Trichloroethene	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Vinyl acetate	U	1.0		µg/L	1	2/21/2006 12:14:00 PM
Vinyl chloride	U	1.0		µg/L	1	2/21/2006 12:14:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-05B

Client Sample ID: GWQ021406:850 NP1-1-7
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON, MANGANESE		E200.7		SW3010A		Analyst: JP
Iron	0.0332	0.0200		mg/L	1	3/1/2006 3:11:56 PM
Manganese	0.0531	0.0200		mg/L	1	3/1/2006 3:11:56 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-05C

Client Sample ID: GWQ021406:850 NP1-1-7
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON, MANGANESE		E200.7		SW3005A		Analyst: JP
Iron	U	0.0200		mg/L	1	3/1/2006 3:08:46 PM
Manganese	0.0502	0.0200		mg/L	1	3/1/2006 3:08:46 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ021406:850 NP1-1-7**Lab Order:** 0602194**Tag Number:****Project:** Rowe Industries**Collection Date:** 2/14/2006**Lab ID:** 0602194-05D**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	30.1	1.00		mg/L	1	3/1/2006
TURBIDITY		E180.1				Analyst: KK
Turbidity	U	1.00	H	NTU	1	2/20/2006
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	92.0	1.00		mg/L	1	2/21/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-06A

Client Sample ID: GWQ021406:900 NP1-1-8
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
1,1,1-Trichloroethane	3.0	1.0		µg/L	1	2/21/2006 12:51:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
1,1-Dichloroethane	1.5	1.0		µg/L	1	2/21/2006 12:51:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
2-Butanone	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
2-Hexanone	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Acetone	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Benzene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Bromobenzene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Bromochloromethane	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Bromodichloromethane	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Bromoform	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Bromomethane	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Carbon disulfide	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Chlorobenzene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-06A

Client Sample ID: GWQ021406:900 NP1-1-8
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Chloroform	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Chloromethane	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Dibromochloromethane	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Dibromomethane	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Ethylbenzene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Isopropylbenzene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
m,p-Xylene	U	2.0		µg/L	1	2/21/2006 12:51:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Methylene chloride	U	1.0	B	µg/L	1	2/21/2006 12:51:00 PM
Naphthalene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
n-Butylbenzene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
n-Propylbenzene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
o-Xylene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Styrene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Tetrachloroethene	1.5	1.0		µg/L	1	2/21/2006 12:51:00 PM
Toluene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Trichloroethene	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Vinyl acetate	U	1.0		µg/L	1	2/21/2006 12:51:00 PM
Vinyl chloride	U	1.0		µg/L	1	2/21/2006 12:51:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggett Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-06B

Client Sample ID: GWQ021406:900 NP1-1-8
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON, MANGANESE		E200.7		SW3010A		Analyst: JP
Iron	8.06	0.0200		mg/L	1	3/1/2006 3:19:44 PM
Manganese	0.743	0.0200		mg/L	1	3/1/2006 3:19:44 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-06C

Client Sample ID: GWQ021406:900 NP1-1-8
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON, MANGANESE		E200.7		SW3005A		Analyst: JP
Iron	U	0.0200		mg/L	1	3/1/2006 3:14:21 PM
Manganese	0.664	0.0200		mg/L	1	3/1/2006 3:14:21 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-06D

Client Sample ID: GWQ021406:900 NP1-1-8
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	23.9	1.00		mg/L	1	3/1/2006
TURBIDITY		E180.1				Analyst: KK
Turbidity	1.70	1.00	H	NTU	1	2/20/2006
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	75.0	1.00		mg/L	1	2/21/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-07A

Client Sample ID: GWQ021406:910 NP1-1-9
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
1,1,1-Trichloroethane	1.8	1.0		µg/L	1	2/21/2006 1:28:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
2-Butanone	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
2-Hexanone	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Acetone	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Benzene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Bromobenzene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Bromochloromethane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Bromodichloromethane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Bromoform	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Bromomethane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Carbon disulfide	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Chlorobenzene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-07A

Client Sample ID: GWQ021406:910 NP1-1-9
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Chloroform	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Chloromethane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Dibromochloromethane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Dibromomethane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Ethylbenzene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Isopropylbenzene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
m,p-Xylene	U	2.0		µg/L	1	2/21/2006 1:28:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Methylene chloride	U	1.0	B	µg/L	1	2/21/2006 1:28:00 PM
Naphthalene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
n-Butylbenzene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
n-Propylbenzene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
o-Xylene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Styrene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Tetrachloroethene	2.1	1.0		µg/L	1	2/21/2006 1:28:00 PM
Toluene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Trichloroethene	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Vinyl acetate	U	1.0		µg/L	1	2/21/2006 1:28:00 PM
Vinyl chloride	U	1.0		µg/L	1	2/21/2006 1:28:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-07B

Client Sample ID: GWQ021406:910 NP1-1-9
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON, MANGANESE		E200.7		SW3010A		Analyst: JP
Iron	5.23	0.0200		mg/L	1	3/1/2006 3:24:01 PM
Manganese	0.754	0.0200		mg/L	1	3/1/2006 3:24:01 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ021406:910 NP1-1-9
Lab Order:	0602194	Tag Number:	
Project:	Rowe Industries	Collection Date:	2/14/2006
Lab ID:	0602194-07C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON, MANGANESE		E200.7		SW3005A		Analyst: JP
Iron	U	0.0200		mg/L	1	3/1/2006 3:22:14 PM
Manganese	0.737	0.0200		mg/L	1	3/1/2006 3:22:14 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 03-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602194
Project: Rowe Industries
Lab ID: 0602194-07D

Client Sample ID: GWQ021406:910 NP1-1-9
Tag Number:
Collection Date: 2/14/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	25.2	1.00		mg/L	1	3/1/2006
TURBIDITY		E180.1				Analyst: KK
Turbidity	1.30	1.00	H	NTU	1	2/20/2006
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	98.0	1.00		mg/L	1	2/21/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Wednesday, March 08, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0602287

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 1 sample(s) on 2/28/2006 for the analyses presented in the following report.

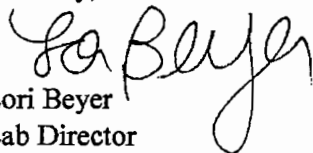
Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,


Lori Beyer
Lab Director

American Analytical Laboratories, LLC.**Date:** 08-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0602287

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0602287-01A	GWQ022206:830 NP1-1-6		2/22/2006	2/28/2006
0602287-01B	GWQ022206:830 NP1-1-6		2/22/2006	2/28/2006
0602287-01C	GWQ022206:830 NP1-1-6		2/22/2006	2/28/2006
0602287-01D	GWQ022206:830 NP1-1-6		2/22/2006	2/28/2006



NYSDOH	ELAP	11418
AIHA	PAT, LPAT	15668
CTDOH	PH-0205	

556 TOLEDO STREET • FARMINGDALE, NY 11735 • (516) 454-6100 • FAX (516) 454-8027

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100

FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 08-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602287
Project: Rowe Industries
Lab ID: 0602287-01A

Client Sample ID: GWQ022206:830 NP1-1-6
Tag Number:
Collection Date: 2/22/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: SB		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
1,1,1-Trichloroethane	15	1.0		µg/L	1	2/28/2006 6:28:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
2-Butanone	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
2-Hexanone	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Acetone	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Benzene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Bromobenzene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Bromochloromethane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Bromodichloromethane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Bromoform	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Bromomethane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Carbon disulfide	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Chlorobenzene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 08-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602287
Project: Rowe Industries
Lab ID: 0602287-01A

Client Sample ID: GWQ022206:830 NP1-1-6
Tag Number:
Collection Date: 2/22/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: SB		
Chloroethane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Chloroform	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Chloromethane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Dibromochloromethane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Dibromomethane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Ethylbenzene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Isopropylbenzene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
m,p-Xylene	U	2.0		µg/L	1	2/28/2006 6:28:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Methylene chloride	U	1.0	B	µg/L	1	2/28/2006 6:28:00 PM
Naphthalene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
n-Butylbenzene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
n-Propylbenzene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
o-Xylene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Styrene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Tetrachloroethene	63	1.0		µg/L	1	2/28/2006 6:28:00 PM
Toluene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Trichloroethene	1.6	1.0		µg/L	1	2/28/2006 6:28:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Vinyl acetate	U	1.0		µg/L	1	2/28/2006 6:28:00 PM
Vinyl chloride	U	1.0		µg/L	1	2/28/2006 6:28:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 08-Mar-06

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ022206:830 NP1-1-6**Lab Order:** 0602287**Tag Number:****Project:** Rowe Industries**Collection Date:** 2/22/2006**Lab ID:** 0602287-01B**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON, MANGANESE		E200.7				Analyst: JP
Iron	0.116	0.0200		mg/L	1	3/6/2006 4:00:47 PM
Manganese	0.179	0.0200		mg/L	1	3/6/2006 4:00:47 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 08-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602287
Project: Rowe Industries
Lab ID: 0602287-01C

Client Sample ID: GWQ022206:830 NP1-1-6
Tag Number:
Collection Date: 2/22/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON, MANGANESE		E200.7		SW3005A		Analyst: JP
Iron	0.0155	0.0200	J	mg/L	1	3/6/2006 3:58:17 PM
Manganese	0.184	0.0200		mg/L	1	3/6/2006 3:58:17 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	125	1.00		mg/L	1	3/1/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 08-Mar-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0602287
Project: Rowe Industries
Lab ID: 0602287-01D

Client Sample ID: GWQ022206:830 NP1-1-6
Tag Number:
Collection Date: 2/22/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	32.6	1.00		mg/L	1	3/6/2006
TURBIDITY		E180.1				Analyst: KK
Turbidity	U	1.00	H	NTU	1	3/3/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

ANALYTICAL REPORT

JOB NUMBER: 212028

Prepared For:

LEGGETTE, BRASHEARS & GRAHAM
4 Research Drive
Suite 301
Shelton, CT 06484

Project: ROWE INDUSTRIES

Attention: Mark Goldberg

Date: 02/17/2006



Signature

Name: Erin A. Gaus

Title: Project Manager

E-Mail: egaus@stl-inc.com

02/17/06

Date

STL Connecticut
128 Long Hill Cross Road
Shelton, CT 06484

This Report Contains (140) Pages



STL

STL Report : 212028
LEGGETTE, BRASHEARS, & GRAHAM

Case Narrative

Sample Receipt – All samples were received in good condition.

Volatile Organics – Air volatile organics were determined by purge and trap GC/MS using guidance provided in Method TO-17. The instrumentation used was a Perkin Elmer ATD 50 interfaced with a Hewlett-Packard Model 5972A GC/MS/DS.

The samples in this job were collected in tedlar bags. Samples were transferred by the laboratory to Air Toxic TO-17 tubes and analyzed at sample volumes of 1L and sample AQ020106:745NP4-1 was also analyzed and reported at a sample volume of .3L. Compound concentrations over the calibration curve in the straight analysis for sample AQ020106:745NP4-1 were flagged with an "A".

Sample Calculation:

Sample ID- AQ020106:745 NP4-1
Compound-Bromomethane

$$\frac{(41332 \text{ area})(25\text{ng})}{(154738 \text{ area})(.363 \text{ area/ng})} = 18.4 = 18 \text{ ng}$$

$$\frac{(18 \text{ NG})(.08206)(298)}{(1\text{L})(95)(1.0\text{ATM})} = 4.633 = 4.6 \text{ nL/L.}$$

The test results in this report meet all NELAP requirements for parameters for which accreditation is required or available. Any exceptions to NELAP requirements are noted in the case narrative.

Date: 02/17/2006

Project Number.....: 20000283
Customer Project ID....: ROWE INDUSTRIES
Project Description....: Rowe Industries

Page 1

STL Connecticut		Form 1		Client Sample ID	AQ020106:745NP4-1
Method: TO17		Lab Sample ID		212028-1	
Sample Volume (L)	1.000	Date Sampled		2/1/2006	
Temp (C)	25	Date Analyzed		2/3/2006	
Compound	nL/L (ppbv/v) Qualifier	RL	mg/M3 Qualifier	RL	
Chloromethane	3.9 J	9.7	0.008 J	0.020	
Vinyl Chloride	7.8 U	7.8	0.020 U	0.020	
Bromomethane	4.6 JB	5.1	0.018 JB	0.020	
Chloroethane	7.6 U	7.6	0.020 U	0.020	
1,1-Dichloroethene	2.0 J	2.5	0.008 J	0.010	
Carbon Disulfide	3.9	3.2	0.012	0.010	
Methylene Chloride	6.9	2.9	0.024	0.010	
trans-1,2-Dichloroethene	2.5 U	2.5	0.010 U	0.010	
1,1-Dichloroethane	6.9	2.5	0.028	0.010	
cis-1,2-Dichloroethene	4.6	2.5	0.018	0.010	
Chloroform	1.4 J	2.1	0.007 J	0.010	
1,1,1-Trichloroethane	22.1	1.8	0.120	0.010	
Carbon Tetrachloride	1.6 U	1.6	0.010 U	0.010	
Benzene	2.8 JB	3.1	0.0090 JB	0.010	
1,2-Dichloroethane	2.5 U	2.5	0.010 U	0.010	
Trichloroethene	5.6	1.9	0.030	0.010	
1,2-Dichloropropane	2.2 U	2.2	0.010 U	0.010	
Bromodichloromethane	1.5 U	1.5	0.010 U	0.010	
cis-1,3-Dichloropropene	2.2 U	2.2	0.010 U	0.010	
Toluene	1.3 J	2.7	0.005 J	0.010	
trans-1,3-Dichloropropene	2.2 U	2.2	0.010 U	0.010	
1,1,2-Trichloroethane	1.8 U	1.8	0.010 U	0.010	
Tetrachloroethene	94.3 A	1.5	0.640 A	0.010	
Dibromochloromethane	1.2 U	1.2	0.010 U	0.010	
Chlorobenzene	2.2 U	2.2	0.010 U	0.010	
Ethylbenzene	2.3 U	2.3	0.010 U	0.010	
m&p-Xylenes	0.7 J	2.3	0.003 J	0.010	
o-Xylene	2.3 U	2.3	0.010 U	0.010	
Styrene	2.4 U	2.4	0.010 U	0.010	
Bromoform	1.0 U	1.0	0.010 U	0.010	
1,1,2,2-Tetrachloroethane	1.5 U	1.5	0.010 U	0.010	

STL Connecticut		Form 1		Client Sample ID	AQ020106:745NP4-1DL
Method: TO17		Lab Sample ID		212028-1DL	
Sample Volume (L)	0.300	Date Sampled		2/1/2006	
Temp (C)	25	Date Analyzed		2/3/2006	
Compound	nL/L (ppbv/v) Qualifier	RL	mg/M3 Qualifier	RL	
Chloromethane	8.1 J	32.3	0.017 J	0.067	
Vinyl Chloride	26.1 U	26.1	0.067 U	0.067	
Bromomethane	10.3 JB	17.2	0.040 JB	0.067	
Chloroethane	25.3 U	25.3	0.067 U	0.067	
1,1-Dichloroethene	8.4 U	8.4	0.033 U	0.033	
Carbon Disulfide	10.7 U	10.7	0.033 U	0.033	
Methylene Chloride	2.9 J	9.6	0.010 J	0.033	
trans-1,2-Dichloroethene	8.5 U	8.5	0.033 U	0.033	
1,1-Dichloroethane	5.8 J	8.2	0.023 J	0.033	
cis-1,2-Dichloroethene	4.2 J	8.5	0.017 J	0.033	
Chloroform	0.7 J	6.8	0.003 J	0.033	
1,1,1-Trichloroethane	17.2	6.1	0.093	0.033	
Carbon Tetrachloride	5.3 U	5.3	0.033 U	0.033	
Benzene	7.3 JB	10.4	0.0233 JB	0.033	
1,2-Dichloroethane	8.2 U	8.2	0.033 U	0.033	
Trichloroethene	4.4 J	6.2	0.023 J	0.033	
1,2-Dichloropropane	7.2 U	7.2	0.033 U	0.033	
Bromodichloromethane	5.0 U	5.0	0.033 U	0.033	
cis-1,3-Dichloropropene	7.3 U	7.3	0.033 U	0.033	
Toluene	1.8 J	8.9	0.007 J	0.033	
trans-1,3-Dichloropropene	7.3 U	7.3	0.033 U	0.033	
1,1,2-Trichloroethane	6.1 U	6.1	0.033 U	0.033	
Tetrachloroethene	68.7	4.9	0.467	0.033	
Dibromochloromethane	3.9 U	3.9	0.033 U	0.033	
Chlorobenzene	7.2 U	7.2	0.033 U	0.033	
Ethylbenzene	7.7 U	7.7	0.033 U	0.033	
m&p-Xylenes	7.7 U	7.7	0.033 U	0.033	
o-Xylene	7.7 U	7.7	0.033 U	0.033	
Styrene	7.8 U	7.8	0.033 U	0.033	
Bromoform	3.2 U	3.2	0.033 U	0.033	
1,1,2,2-Tetrachloroethane	4.9 U	4.9	0.033 U	0.033	

STL Connecticut		Form 1		Client Sample ID	AQ020106:750NP4-2
Method: TO17		Lab Sample ID		212028-2	
Sample Volume (L)	1.000	Date Sampled		2/1/2006	
Temp (C)	25	Date Analyzed		2/3/2006	
Compound	nL/L (ppbv/v) Qualifier	RL	mg/M3 Qualifier	RL	
Chloromethane	9.7 U	9.7	0.020 U	0.020	
Vinyl Chloride	7.8 U	7.8	0.020 U	0.020	
Bromomethane	5.1 U	5.1	0.020 U	0.020	
Chloroethane	7.6 U	7.6	0.020 U	0.020	
1,1-Dichloroethene	2.5 U	2.5	0.010 U	0.010	
Carbon Disulfide	3.2	3.2	0.010	0.010	
Methylene Chloride	4.9	2.9	0.017	0.010	
trans-1,2-Dichloroethene	2.5 U	2.5	0.010 U	0.010	
1,1-Dichloroethane	3.2	2.5	0.013	0.010	
cis-1,2-Dichloroethene	1.8 J	2.5	0.007 J	0.010	
Chloroform	0.6 J	2.1	0.003 J	0.010	
1,1,1-Trichloroethane	15.8	1.8	0.086	0.010	
Carbon Tetrachloride	1.6 U	1.6	0.010 U	0.010	
Benzene	3.8 B	3.1	0.0120 B	0.010	
1,2-Dichloroethane	2.5 U	2.5	0.010 U	0.010	
Trichloroethene	1.9 U	1.9	0.010 U	0.010	
1,2-Dichloropropane	2.2 U	2.2	0.010 U	0.010	
Bromodichloromethane	1.5 U	1.5	0.010 U	0.010	
cis-1,3-Dichloropropene	2.2 U	2.2	0.010 U	0.010	
Toluene	4.2	2.7	0.016	0.010	
trans-1,3-Dichloropropene	2.2 U	2.2	0.010 U	0.010	
1,1,2-Trichloroethane	1.8 U	1.8	0.010 U	0.010	
Tetrachloroethene	0.3 J	1.5	0.002 J	0.010	
Dibromochloromethane	1.2 U	1.2	0.010 U	0.010	
Chlorobenzene	2.2 U	2.2	0.010 U	0.010	
Ethylbenzene	0.5 J	2.3	0.002 J	0.010	
m&p-Xylenes	1.6 J	2.3	0.007 J	0.010	
o-Xylene	0.5 J	2.3	0.002 J	0.010	
Styrene	0.5 J	2.4	0.002 J	0.010	
Bromoform	1.0 U	1.0	0.010 U	0.010	
1,1,2,2-Tetrachloroethane	1.5 U	1.5	0.010 U	0.010	

STL Connecticut		Form 1		Client Sample ID	AQ020106:755NP4-3
Method: TO17		Lab Sample ID		212028-3	
Sample Volume (L)	1.000	Date Sampled		2/1/2006	
Temp (C)	25	Date Analyzed		2/3/2006	
Compound	nL/L (ppbv/v) Qualifier	RL	mg/M3 Qualifier	RL	
Chloromethane	9.7 U	9.7	0.020 U	0.020	
Vinyl Chloride	7.8 U	7.8	0.020 U	0.020	
Bromomethane	28.3	5.1	0.110	0.020	
Chloroethane	7.6 U	7.6	0.020 U	0.020	
1,1-Dichloroethene	1.0 J	2.5	0.004 J	0.010	
Carbon Disulfide	3.9	3.2	0.012	0.010	
Methylene Chloride	4.9	2.9	0.017	0.010	
trans-1,2-Dichloroethene	2.5 U	2.5	0.010 U	0.010	
1,1-Dichloroethane	4.0	2.5	0.016	0.010	
cis-1,2-Dichloroethene	0.8 J	2.5	0.003 J	0.010	
Chloroform	1.0 J	2.1	0.005 J	0.010	
1,1,1-Trichloroethane	13.8	1.8	0.075	0.010	
Carbon Tetrachloride	1.6 U	1.6	0.010 U	0.010	
Benzene	0.9 JB	3.1	0.0030 JB	0.010	
1,2-Dichloroethane	2.5 U	2.5	0.010 U	0.010	
Trichloroethene	0.4 J	1.9	0.002 J	0.010	
1,2-Dichloropropane	2.2 U	2.2	0.010 U	0.010	
Bromodichloromethane	1.5 U	1.5	0.010 U	0.010	
cis-1,3-Dichloropropene	2.2 U	2.2	0.010 U	0.010	
Toluene	1.1 J	2.7	0.004 J	0.010	
trans-1,3-Dichloropropene	2.2 U	2.2	0.010 U	0.010	
1,1,2-Trichloroethane	1.8 U	1.8	0.010 U	0.010	
Tetrachloroethene	1.5 U	1.5	0.010 U	0.010	
Dibromochloromethane	1.2 U	1.2	0.010 U	0.010	
Chlorobenzene	2.2 U	2.2	0.010 U	0.010	
Ethylbenzene	2.3 U	2.3	0.010 U	0.010	
m&p-Xylenes	0.2 J	2.3	0.001 J	0.010	
o-Xylene	2.3 U	2.3	0.010 U	0.010	
Styrene	2.4 U	2.4	0.010 U	0.010	
Bromoform	1.0 U	1.0	0.010 U	0.010	
1,1,2,2-Tetrachloroethane	1.5 U	1.5	0.010 U	0.010	

Job Number: 212028

LABORATORY CHRONICLE

Date: 02/17/2006

CUSTOMER: LEGGETTE, BRASHEARS & GRAHAM

PROJECT: ROWE INDUSTRIES

ATTN: Mark Goldberg

Lab ID: 212028-1	Client ID: AQ020106:745NP4-1	Date Recvd: 02/02/2006	Sample Date: 02/01/2006		
METHOD	DESCRIPTION	RUN#	BATCH#	PREP BT # (S)	DATE/TIME ANALYZED
T017	Volatile Organics (Air)	1	61698		
T017	Volatile Organics (Air)	1	61698		0000
T017	Volatile Organics (Air)	2	61698		
T017	Volatile Organics (Air)	2	61698		0000
Lab ID: 212028-2	Client ID: AQ020106:750NP4-2	Date Recvd: 02/02/2006	Sample Date: 02/01/2006		
METHOD	DESCRIPTION	RUN#	BATCH#	PREP BT # (S)	DATE/TIME ANALYZED
T017	Volatile Organics (Air)	1	61698		
Lab ID: 212028-3	Client ID: AQ020106:755NP4-3	Date Recvd: 02/02/2006	Sample Date: 02/01/2006		
METHOD	DESCRIPTION	RUN#	BATCH#	PREP BT # (S)	DATE/TIME ANALYZED
T017	Volatile Organics (Air)	1	61698		

AIR
2A
WATER VOLATILE SYSTEM MONITORING COMPOUND RECOVERY
Pm 2/16/06

Lab Name: STL-CT

Contract:

Lab Code: STL-CT

Case No.: 212028 SAS No.:

SDG No.: 212028

	EPA SAMPLE NO.	SMC1 #	SMC2 (DCE) #	SMC3 (TOL) #	OTHER (BFB) #	TOT OUT
01	VBLKT2	114	83	108	111	
02	LCS	115	91	105	116	
03	AQ020106:745NP4-1	110	94	115	105	
04	AQ020106:750NP4-2	114	97	109	103	
05	AQ020106:755NP4-3	117	96	107	99	
06	AQ020106:NP4-1DL	105	93	109	110	
07						
08						
09						
10						
11						
12						
13						
14						
15						
16						
17						
18						
19						
20						
21						
22						
23						
24						
25						
26						
27						
28						
29						
30						

QC LIMITS
 SMC1 = Dibromofluoromethane (70-130)
 SMC2 (DCE) = 1,2-Dichloroethane-d4 (70-130)
 SMC3 (TOL) = Toluene-d8 (70-130)
 OTHER (BFB) = Bromofluorobenzene (70-130)

Column to be used to flag recovery values

* Values outside of contract required QC limits

D System Monitoring Compound diluted out

STL-INC

RECOVERY REPORT

Client Name: Client SDG: SDGa24843
 Sample Matrix: LIQUID Fraction: VOA
 Lab Smp Id: LCS Operator: L.Decker
 Level: LOW SampleType: LCS
 Data Type: MS DATA Quant Type: ISTD
 SpikeList File: AIRQCS.spk
 Sublist File: all.sub
 Method File: \\target1_ct\Files\chem\VOA\mst.i\T065743.b\TAIRFULL.m
 Misc Info: :LCS ;;;20NG LCS; * 1L* ; AIR

SPIKE COMPOUND	CONC ADDED ug/L	CONC RECOVERED ug/L	% RECOVERED	LIMITS
4 Vinyl Chloride	20	15	73.88	60-140
5 Bromomethane	20	35	173.28*	60-140
6 Chloroethane	20	17	85.10	60-140
12 1,1-Dichloroethene	20	16	81.02	60-140
11 Trichlorotrifluoro	20	14	70.89	60-140
17 Acetone	20	15	77.35	60-140
13 Carbon Disulfide	20	14	70.39	60-140
16 Methylene Chloride	20	15	77.25	60-140
18 trans-1,2-Dichloro	20	17	83.01	60-140
28 1,1-Dichloroethane	20	16	79.94	60-140
30 cis-1,2-Dichloroet	20	16	77.85	60-140
40 2-Butanone	20	18	90.23	60-140
33 Chloroform	20	16	79.03	60-140
38 1,1,1-Trichloroeth	20	19	97.01	60-140
39 Carbon Tetrachlori	20	22	107.93	60-140
51 1,2-Dichloroethane	20	18	89.78	60-140
48 Benzene	20	16	80.44	60-140
56 Trichloroethene	20	17	83.18	60-140
63 cis-1,3-Dichloropr	20	17	85.44	60-140
72 4-Methyl-2-Pentano	20	16	80.83	60-140
69 Toluene	20	16	77.91	60-140
66 trans-1,3-Dichloro	20	14	70.95	60-140
67 1,1,2-Trichloroeth	20	17	85.23	60-140
73 Tetrachloroethene	20	16	82.14	60-140
75 Dibromochlorometha	20	18	89.66	60-140
80 Chlorobenzene	20	16	79.52	60-140
82 Ethylbenzene	20	17	84.48	60-140
83 Xylene (total)mp	40	34	84.00	60-140
84 Xylene (total)o	20	16	80.30	60-140
85 Styrene	20	14	71.11	60-140
86 Bromoform	20	16	79.10	60-140
89 1,1,2,2-Tetrachlor	20	19	95.66	60-140
101 1,3-Dichlorobenzen	20	17	87.37	60-140
102 1,4-Dichlorobenzen	20	17	84.75	60-140
103 1,2-Dichlorobenzen	20	16	80.81	60-140

QUALITY ASSURANCE METHODS

REFERENCES AND NOTES

REPORT COMMENTS

- 1) All pages of this report are integral parts of the analytical data. Therefore, this report should be reproduced only in its entirety.
- 2) Soil, sediment and sludge sample results are reported on a "dry weight" basis except when analyzed for landfill disposal or incineration parameters. All other solid matrix samples are reported on an "as received" basis unless noted differently.
- 3) Reporting limits are adjusted for sample size used, dilutions and moisture content if applicable.
- 4) The test results for the noted analytical method(s) meet the requirements of NELAC. Lab Cert. ID# 10604
- 5) According to 40CFR Part 136.3, pH, Chlorine Residual and Dissolved Oxygen analyses are to be performed immediately after aqueous sample collection. When these parameters are not indicated as field (e.g. pH Field) they were not analyzed immediately, but as soon as possible on laboratory receipt.

Glossary of flags, qualifiers and abbreviation

Inorganic Qualifiers (Q-Column)

- U Analyte was not detected at or above the reporting limit.
- < Not detected at or above the reporting limit.
- J Result is less than the RL, but greater than or equal to the method detection limit.
- B Result is less than the CRDL/RL, but greater than or equal to the IDL/MDL.
- S Result was determined by the Method of Standard Additions.

Inorganic Flags (Flag Column)

- ICV,CCV,ICB,CCB,ISA,ISB,CRI,CRA,MRL: Instrument related QC exceed the upper or lower control limits.
- * LCS, LCD, MD: Batch QC exceeds the upper or lower control limits.
- + MSA correlation coefficient is less than 0.995.
- 4 MS, MSD: The analyte present in the original sample is 4 times greater than the matrix spike concentration; therefore, control limits are not applicable.
- E SD: Serial dilution exceeds the control limits.
- H MB, EB: Batch QC is greater than reporting limit or had a negative instrument reading lower than the absolute value of the reporting limit.
- N MS, MSD: Spike recovery exceeds the upper or lower control limits.
- W PS: Post-digestion spike was outside 85-115% control limits.

Organic Qualifiers (Q - Column)

- U Analyte was not detected at or above the reporting limit.
- ND Compound not detected.
- J Result is an estimated value below the reporting limit or a tentatively identified compound (TIC).
- Q Result was qualitatively confirmed, but not quantified.
- C Pesticide identification was confirmed by GC/MS.
- Y The chromatographic response resembles a typical fuel pattern.
- Z The chromatographic response does not resemble a typical fuel pattern.
- E Result exceeded calibration range, secondary dilution required.

Organic Flags (Flags Column)

- MB,EB, MLE: Batch QC is greater than reporting limit.
- * LCS, LCD, CCV, MS, MSD, Surrogate, RS:Batch QC exceeds the upper or lower control limits.
- A Concentration exceeds the instrument calibration range or below the reporting limit.
- B Compound was found in the blank.
- D Surrogate or matrix spike recoveries were not obtained because the extract was diluted for analysis; also compounds analyzed at a dilution will be flagged with a D.
- H Alternate peak selection upon analytical review
- I Indicates the presence of an interference, recovery is not calculated.
- M Manually integrated compound.
- P The lower of the two values is reported when the % difference between the results of two GC columns is greater than 25%.

QUALITY ASSURANCE METHODS

REFERENCES AND NOTES

Abbreviations

Batch	Designation given to identify a specific extraction, digestion, preparation set, or analysis set
CAP	Capillary Column
CCB	Continuing Calibration Blank
CCV	Continuing Calibration Verification
CF	Confirmation Analysis
CRA	Low Level Standard Check - GFAA; Mercury
CRI	Low Level Standard Check - ICP
Dil.Fac	Dilution Factor
DL	Secondary dilution and analysis
DLFac	Detection Limit Factor
DSH	Distilled Standard - High Level
DSL	Distilled Standard - Low Level
DSM	Distilled Standard - Medium Level
EB	Extraction Blank
ICB	Initial Calibration Blank
ICV	Initial Calibration Verification
IDL	Instrument Detection Limit
ISA	Interference Check Sample A
ISB	Interference Check Sample B
Job No.	The first six digits of the sample ID which refers to a specific client, project and sample group
Lab ID	An 8 number unique laboratory identification
LCD	Laboratory Control Standard Duplicate
LCS	Laboratory Control Standard with reagent grade water or a matrix free from the analyte of interest
MB	Method Blank or (PB) Preparation Blank
MD	Method Duplicate
MDL	Method Detection Limit
MLE	Medium Level Extraction Blank
MRL	Method Reporting Limit Standard
MSA	Method of Standard Additions
MS	Matrix Spike
MSD	Matrix Spike Duplicate
ND	Not Detected
PACK	Packed Column
PREPF	Preparation factor used by the Laboratory's Information Management System (LIMS)
PS	Post Spike
PSD	Post Spike Duplicate
RA	Re-analysis
RE	Re-extraction and analysis
RL	Reporting Limit
RPD	Relative Percent Difference of duplicate (unrounded) analyses
RRF	Relative Response Factor
RS	Reference Standard
RT	Retention Time
RTW	Retention Time Window
SampleID	A 9 digit number unique for each sample, the first six digits are referred as the job number
SCB	Seeded Control Blank
SD	Serial Dilution
UCB	Unseeded Control Blank

One or a combination of these data qualifiers and abbreviations may appear in the analytical report.

STL-Connecticut Certification Summary (as of September 2005)

The laboratory identification numbers for the STL-Connecticut laboratory are provided in the following table. Many states certify laboratories for specific parameters or tests within a category (i.e. method 325.2 for wastewater). The information in the following table indicates the lab is certified in a general category of testing such as drinking water or wastewater analysis. The laboratory should be contacted directly if parameter-specific certification information is required.

State	Responsible Agency	Identification	Expiration Date	Lab Number
Connecticut	Department of Health Services	Drinking Water, Wastewater	12/31/06	PH-0497
Maine	Department of Health and Environmental Services	Drinking Water, Wastewater/Solid, Hazardous Waste	04/18/06	CT023
Massachusetts	Department of Environmental Protection	Potable/Non-Potable Water	06/30/06	CT023
New Hampshire	Department of Environmental Services	Drinking Water, Wastewater	08/29/06	2528
New Jersey	Department of Environmental Protection	Drinking Water, Wastewater	06/30/06	CT410
New York	Department of Health	CLP, Drinking Water, Wastewater, Solid/ Hazardous Waste NELAC	04/01/06	10602
Rhode Island	Department of Health	Chemistry...Non- Potable Water and Wastewater	12/30/06	A43
Utah	Department of Health	RCRA	05/31/06	2032614458

MISCELLANEOUS DOCUMENTS

STL Connecticut
128 Long Hill Cross Road
Shelton, CT 06484
Tel: 203-929-8140

Client

Client	LBG	Project Manager	Mark Goldberg	Date	2/1/06	Chain of Custody Number	02297
--------	-----	-----------------	---------------	------	--------	-------------------------	-------

Address Beverly Dr. Suite 301	Telephone Number (Area Code)/Fax Number 203-929-8555	Lab Number	Page _____ of _____
----------------------------------	---	------------	---------------------

City	State	Zip Code	Site Contact	Lab Contact	Analysis (Attach list if more space is needed)
NE Shelton	CT	06484		Tolson, D. L.	

Project Name and Location (State)	Carrier/Waybill Number
CTIC R 2.2 114	7

[illegible]

	Matrix	Containers & Preservatives	-6-
T			
T			

[illegible][illegible]

AQ020106; f43 NP4-1	α -1-06	f73	x
			x

A Q020106:750 NP4-2	2-1-06	x	x
		750	x
		750	x

[illegible][illegible][illegible][illegible][illegible][illegible]

2020

[illegible][illegible][illegible][illegible][illegible]

Possible hazard identification

☐ Non-Hazard	☐ Flammable	☐ Boiling B	☐ Unknown	☐ Return To Client	☐ Disposal Bulb	☐ Archiving Etc	☐ Months
-------------------------------------	------------------------------------	------------------------------------	----------------------------------	---	--	--	---------------------------------

(A fee may be assessed if samples are retained in excess of 1 month)

Sample Disposal

[illegible]

☐ 24 Hours	☐ 48 Hours	☐ 7 Days	☐ 14 Days	☐ 21 Days	Other _____
Stewart					

1. Relinquished By		1. Received By	
Date	Time	Date	Time
3/2/06	1:00 PM	3/2/06	1:00 PM

	Date	Time	Date	Time
2 Relinquished By	8/2/06	1071	8/2/06	1041

Year	1990	1991	1992	1993	1994	1995	1996	1997	1998	1999	2000	2001	2002	2003	2004	2005	2006	2007	2008	2009	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034	2035	2036	2037	2038	2039	2040	2041	2042	2043	2044	2045	2046	2047	2048	2049	2050	2051	2052	2053	2054	2055	2056	2057	2058	2059	2060	2061	2062	2063	2064	2065	2066	2067	2068	2069	2070	2071	2072	2073	2074	2075	2076	2077	2078	2079	2080	2081	2082	2083	2084	2085	2086	2087	2088	2089	2090	2091	2092	2093	2094	2095	2096	2097	2098	2099	2100
Age	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50	51	52	53	54	55	56	57	58	59	60	61	62	63	64	65	66	67	68	69	70	71	72	73	74	75	76	77	78	79	80	81	82	83	84	85	86	87	88	89	90	91	92	93	94	95	96	97	98	99	100										

Retinquished By	Date	Time	3. Received By	Date	Time
15				12/1/00	1
15				12/1/00	1

Comments
2/27/16 1673

Comments

DISTRIBUTION: WHITE - Returned to Client with Report; CANARY - Stays with the Sample; PINK - Field Copy

rpjsckl		Job Sample Receipt Checklist Report		V2
Job Number.: 212028	Location.: 57207	Check List Number.: 1	Description.:	
Customer Job ID.....		Job Check List Date.:		Date of the Report...: 02/02/2006
Project Number.: 20000283	Project Description.: Rowe Industries			Project Manager.....: eag
Customer.....: LEGGETTE, BRASHEARS & GRAHAM		Contact.: Mark Goldberg		
Questions ?	(Y/N)	Comments		
Chain-of-Custody Present?.....	Y			
...If "yes", completed properly?.....	Y			
Custody seal on shipping container?.....	N			
...If "yes", custody seal intact?.....				
Custody seals on sample containers?.....	N			
...If "yes", custody seal intact?.....				
Samples iced?.....	N			
Temperature of cooler acceptable? (4 deg C +/- 2).		N/A AIRS		
Samples received intact (good condition)?.....	Y			
Volatile samples acceptable? (no headspace).....				
Correct containers used?.....	Y			
Adequate sample volume provided?.....	Y			
Samples preserved correctly?.....				
Samples received within holding-time?.....	Y			
Agreement between COC and sample labels?.....	Y			
Radioactivity at or below background levels?.....	Y			
A Sample Discrepancy Report (SDR) was needed?.....	N			
Comments.....				
If samples were shipped was there an air bill #?..	N	D/O BY CLIENT		
Sample Custodian Signature/Date.....		 2/2/06		