

PROJECT STATUS MEMORANDUM

NO. 05-06

TO: Pamela Tames, USEPA

FROM: Mark M. Goldberg, P.E.
Paul Jobmann

DATE: June 21, 2006

PROJECT: Rowe Industries Superfund Site
Ground-Water Recovery and Treatment System
May 2006 Status Report
Sag Harbor, New York

LBG Engineering Services, P.C. (LBG) commenced operation of the ground-water remediation system at the above-referenced site on December 17, 2002. This status report presents a summary of system performance, operation and maintenance, and monitoring activities for the site from May 1, 2006 through May 31, 2006. The report includes a summary of system performance parameters, system operation parameters, analytical results for ground water, system effluent samples, and air quality results.

SUMMARY OF SYSTEM PERFORMANCE AND OPERATION

(May 1, 2006 through May 31, 2006)

- | | |
|---|-----------------------------------|
| 1. Hours of operation during the reporting period: | 325 hours (44%) |
| 2. Alarm conditions during the reporting period: | See Table 1 |
| 3. Was the SPDES VOC discharge permit criteria achieved: | yes, (Table 2) |
| 4. Total volume of water pumped during the reporting period: | 6,110,330 gal. |
| 5. Was the system effluent flow below the SPDES limit of 1,023,000 gpd: yes, (Graph 1) | |
| 6. Mass of VOCs recovered during the reporting period: | 1.0 pounds |
| 7. Cumulative mass of VOCs recovered since startup on 12/17/02:
(calculations can be provided upon request) | 184.3 pounds |
| 8. Effluent VOC vapor concentration for the reporting period: | 0.127 mg/m ³ (Table 3) |
| 9. Was the effluent VOC vapor emission rate below 0.022 lbs/hr.:
(calculations can be provided upon request) | yes (0.00124 lbs/hr) |

GROUND-WATER RECOVERY SYSTEM STATUS SUMMARY

The following table summarizes select recovery well parameters for the reporting period. Table 4 presents a summary of the quality results for water samples collected from recovery wells. Graph 2 presents PCE concentrations for each recovery well. For wells with water quality that meets or is approaching remedial criteria, Graph 3 presents PCE concentrations at an expanded scale in order to compare them to the PCE aquifer restoration concentration of 5 ug/L. Laboratory analytical reports are included as Appendix I.

Well	Volume Pumped (gal)	Average Flow (gpm)	Minimum Design Flow (gpm)	Total VOC Concentration (µg/L)	VOC Recovery (lbs)
RW-2	475265	26	26	38	0.15
RW-3	150,928	11	23	0	0
RW-4	600152	29	13	26	0.13
RW-5	1,498,629	55	42	0	0
RW-6	374,656	15	28	86	0.27
RW-7	1,497,456	70	54	59	0.74
RW-8	746,320	41	46	0	0
RW-9	1,498,571	70	68	0	0

Recovery wells RW-3, RW-6 and RW-8 had average flows below the respective minimum design flows determined to be necessary for capture of the plume.

The pumping rate and specific capacity from RW-3 have both decreased with time. Rehabilitation efforts in 2005 did not improve the specific capacity of this well. Build-up of microbial growth in the formation, in conjunction with the finer soils associated with the aquifer in the immediate vicinity of RW-3, are believed to be causing the decrease in well yield. This well's performance will be addressed during 2006 well rehabilitation activities.

The ground-water drawdown at RW-6 is significant and is continuing to increase; therefore, the pumping rate at RW-6 will continue to be 15 gpm as long as well conditions allow. This well's performance will be addressed during 2006 well rehabilitation activities.

The pumping rate at RW-8 has decreased below the minimum design flow rate because of iron build-up in the well. This condition will be addressed during the 2006 well rehabilitation activities. It should be noted that the pumping rates in RW-4 and RW-9 are also decreasing because of iron build-up. Well rehabilitation efforts planned this year should improve the yield of these wells.

Based on the May 11, 2006 New York State Department of Environmental Conservation (NYSDEC) letter, the State Pollutant Discharge Elimination System (SPDES) criteria was adjusted

to 5.0 and 8.5. With this adjustment the effluent pH criteria of the FSP&T falls within the noted range of acceptable pH values.

BAG FILTER STATUS

The following table presents an operational summary of the bag filter usage and configuration for the reporting period.

Dates	Bank 1	Bank 2	Bank 3
May 1 to 31	7 of 8 housings used with 400 micron bag filters	7 of 8 housings used with 400 micron bag filters	Not active

No modifications were made to the filter bank configuration or operation during this reporting period.

OTHER O&M ACTIVITIES AND FUTURE O&M ACTIVITIES

Other O&M activities conducted in May 2006 include:

- On May 3, 2006, broken springs in the doors to the recovery well vaults were replaced in RW-2 and RW-3.
- On May 3, 2006, the replacement of the malfunctioning pressure transducer at RW-3 with a new pressure transducer could not be completed because the manufacturer had reconfigured the connection point on the new pressure transducer and it was not compatible with the existing connection. Compatible connectors will be ordered.
- On May 3, 2006, lubricant oil was observed to be leaking from TP-2B, therefore, the lead transfer pump was switched from TP-2B to TP-2A, and TP-2A will operate infrequently, if at all, as the lag pumps. The source of the oil leak will be investigated and repaired.
- On May 4, 2006, effluent from the FSP&T system was not being recorded at the computer. Investigation and troubleshooting was initiated that included replacing the flow meter transmitter and batteries. The troubleshooting did not identify the problem, so further investigation of the effluent flow meter assembly will be conducted.
- On May 10, 2006, the effluent flow meter for the FSP&T system was disassembled and the internal components of the meter were found to be damaged, likely due to normal wear and tear. Replacement parts were ordered.
- On May 24, 2006, well rehabilitation for RW-2 began.
- On May 25, 2006, well rehabilitation for RW-3 began.

Future O&M activities scheduled for the summer of 2006 include:

- Replace malfunctioning air flow meter on the air stripper blower and the booster blower;
- Troubleshoot and repair lubricant oil leak in transfer pump TP-2B;

- Repair the FSP&T system effluent flow meter;
- Replace connectors for installation of new pressure transducer at RW-3;
- Complete well rehabilitation for RW-2, 3, 4, 5, 6, 7, 8 and 9;
- Replace the 1 HP pump and pump motor with a 2 HP pump and pump motor following well rehabilitation activities in RW-3;
- Replace the 2 amp electric filter with a 4 amp electric filter for RW-3 in conjunction with the installation of the new pump motor;
- Clean the air stripper tower sump, transfer tank and equalization tank following well rehabilitation activities; and,
- Construct an access manway for the equalization tank on the sidewall, two to three feet above the floor.

cc: Phil McAndrew, Kraft Foods, N.A. – .pdf
 Lisa Krogman, Kraft Foods, N.A. (Environ) – .pdf
 Jeff Trad, NYSDEC – .pdf
 Chief-Operation Maintenance and Support Section, NYSDEC – .pdf
 William Spitz, RWM, R-1, NYSDEC
 Garrett W. Swensen Jr., Esq., Town of Southampton

MMG:ng

Attachments

H:\JOBFILES\M-N\Nabsag\Ground Water\O&M\FSP&T\Monthly Reports\2006\May 2006\Status0506May.doc

TABLES

TABLE 1
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

MAINTENANCE LOG
(May 1, 2006 through May 31, 2006)

Date	Time	System Changes/Modifications	Personnel
5/3/2006		Replaced broken recovery well vault door springs at RW-2 and RW-3.	RD
		Lubricant leak observed in TP2B, lead pump switched from TP2B to TP2A. Source of leak will be investigated.	RD
		Changed multi-bag filter bags (400 µm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD
5/4/2006		No reading at the computer for FE2-4 effluent flow meter. Initial troubleshooting included replacing the flow meter transmitter and battery. Still no reading. Further troubleshooting revealed that the flow meter assembly was damaged. Replacement parts will be ordered.	MG
		Meet on-site with Delta well and pump to discuss well rehab procedures.	MG
5/10/2006		Changed multi-bag filter bags (400 µm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD
	6:00 AM	System shut down to remove effluent flow meter assembly. Vanes and rotor were determined to be damaged. These parts will be ordered.	RD
	8:30 AM	Restarted the system	RD
	8:50 AM	Communication Failure Alarm; system shut down	
5/17/2006	6:45 AM	Rebooted computer, reset the alarm and restarted the system.	RD
5/18/2006	7:25 PM	Booster blower failure alarm; system shut down.	
5/24/2006	6:12 AM	Reset the booster blower motor starter, reset the booster blower alarm and restarted the system.	RD
		Changed multi-bag filter bags (400 µm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD
	8:30 AM	RW-2 locked out and tagged out for well rehabilitation. The rest of the system is operating.	TS
5/25/06		RW-3 locked out and tagged out for well rehabilitation. RW-4 to RW-9 are still operating.	SS
5/29/06	9:00 AM	Booster blower failure alarm and power failure alarm; system shut down.	
5/30/06	11:00 AM	Reset booster blower failure alarm and power failure alarm and restarted the system.	TS
		Changed multi-bag filter bags (400 µm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	TS

TABLE 2

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

EFFLUENT WATER QUALITY RESULTS

Date Sampled ^{2/}	pH ^{1/}	TDS (mg/l)	PCE (ug/l)	1,1,1-TCA (ug/l)	TCE (ug/l)	1,1-DCA (ug/l)	1,1-DCE (ug/l)	1,2-DCE (ug/l)	Xylene (ug/l)	Bromoform (ug/l)	Dibromo- chloromethane (ug/l)	Methylene Chloride (ug/l)	Freon 113 (ug/l)	Acetone (ug/l)	Chloroform (ug/l)	MTBE (ug/l)	Total Iron (mg/l)	Dissolved Iron (mg/l)
SPDES Limits	5.0 to 8.5	---	1	5	5	5	5	5	5	---	---	5	---	50	7	---	---	---
3-May-06	5.1	100	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	2.08	0.0957
11-May-06	5.1	168	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	46.8 ^{3/}	0.544
17-May-06	5.1	104	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	17 ^{4/}	ND<1.0	ND<1.0	ND<1.0	ND<1.0	4.00	0.068
24-May-06	5.1	305	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	12 ^{4/}	ND<1.0	ND<1.0	ND<1.0	ND<1.0	3.28	0.125
30-May-06	5.1	72	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	1.04	0.063

SPDES: State Pollutant Discharge Elimination System

mg/l: Milligrams per liter

ug/l: Micrograms per liter

---: Not established

NM: Not Measured

TDS: Total dissolved solids

PCE: Tetrachloroethylene

TCE: Trichloroethene

1,1-DCA: 1,1-Dichloroethane

1,1-DCE: 1,1-Dichloroethene

1,2-DCE: 1,2-Dichloroethene

MTBE: Methyl tert-butyl ether

Notes:

- Based on the new SPDES criteria from an NYSDEC letter dated on May 11, 2006, the new allowable pH range for the Rowe Site is between 5.0 and 8.5.
The pH was measured using litmus paper. Influent pH values from recovery wells typically range between 5 and 6.
- "Effluent" samples were collected from sample port labeled NP2-10 unless otherwise noted.
- High iron concentrations detected in the effluent continue to be detected sporadically. Following well rehabilitation activities, the transfer tank, tower sump and equalization tank will be cleaned.
This is expected to reduce the effluent iron concentration.
- This compound was detected in the associated laboratory method blank, therefore it is a suspected laboratory contaminant.

TABLE 3

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

CARBON UNIT SYSTEM AIR QUALITY RESULTS

Precarbon			Parameters (mg/m3)																				TOTAL VOCs
Sample Name	Date	Time	PCE	TCE	TCA	DCE	DCA	cis-DCE	Toluene	Benzene	m&p-Xylenes	o-Xylene	Styrene	CF	MC	CM	CD	BM	CB	EB	VC	CT	
AQ062405:12:40NP4-1	6/24/2005	12:40	0.36	0.028	0.1	ND	ND	ND	0.074	0.046	0.004	ND	ND	ND	0.144	ND	0.054	0.16	ND	ND	ND	ND	
AQ070705:1400NP4-1	7/7/2005	14:00	0.43	0.026	0.12	ND	ND	ND	0.044	ND	0.006	0.002	0.006	ND	0.19 ^{1/}	ND	0.51 ^{1/}	0.024	ND	0.001	ND	ND	
AQ080205:1400NP4-1	8/2/2005	14:00	0.42	0.034	0.15	ND	ND	0.009	0.05	0.008	0.006	ND	0.007	0.006	0.017 ^{1/}	ND	0.66 ^{1/}	0.043	ND	ND	ND	ND	
AQ090805:900NP4-1	9/8/2005	9:00	0.27	0.032	0.1	0.011	ND	0.016	0.079	0.039	0.025	0.013	0.003	ND	1.7 ^{1/}	ND	0.021	0.038	0.01	0.004	ND	ND	
AQ100605:1230NP4-1	10/6/2005	12:30	0.28	0.022	0.1	0.007	0.025	0.011	0.015	0.004	0.003	ND	0.002	0.005	0.036	ND	ND	0.032	ND	ND	ND	ND	
AQ111605:1130NP4-1	11/16/2005	11:30	0.76	0.033	0.11	0.008	0.022	0.054	0.44	0.016	0.012	0.004	0.004	ND	0.05	ND	0.023	0.052	ND	0.002	ND	ND	
AQ120805:930NP4-1	12/8/2005	9:30	0.34	0.016	0.079	0.006	0.02	0.032	0.014	0.003	0.003	ND	0.002	0.004	0.008 ^{2/}	0.002	0.038	0.015	ND	0.001	ND	ND	
AQ010406:845NP4-1	1/4/2006	8:45	0.24	0.027	0.094	0.007	0.019	0.009	0.031	0.014	0.01	0.004	0.005	0.005	0.018	ND	0.027	0.002	ND	0.003	ND	ND	
AQ020106:745NP4-1	2/1/2006	7:45	0.64	0.03	0.12	0.008	0.028	0.018	0.005	0.009	0.003	ND	ND	0.007	0.024	0.008	0.012	0.018 ^{3/}	ND	ND	ND	ND	
AQ032206:1215NP4-1 ^{4/}	3/22/2006	12:15	0.12	0.018	0.077	0.0042	0.018	0.0062	0.0026	0.00096	0.0016	ND	ND	0.0049	0.0025	0.0017	0.0067	ND	ND	ND	ND		
AQ041206:950NP4-1	4/12/2006	9:50	0.18	0.011	0.038	0.004	0.0087	0.007	0.0014	ND	ND	ND	ND	0.0037	0.0011	0.0018	0.0047	ND	ND	ND	ND		
AQ051706:1000NP4-1	5/17/2006	10:00	0.28	0.017	0.048	0.0035	0.013	0.014	0.0093	0.0026	0.0032	ND	ND	0.0037	0.0019	0.0026	0.0097	ND	ND	0.0016	0.0011		

Midcarbon			Parameters (mg/m3)																				TOTAL VOCs
Sample Name	Date	Time	PCE	TCE	TCA	DCE	DCA	cis-DCE	Toluene	Benzene	m&p-Xylenes	o-Xylene	Styrene	CF	MC	CM	CD	BM	CB	EB	VC	CT	
AQ062405:1241NP4-2	6/24/2005	12:41	ND	ND	0.063	ND	ND	ND	0.071	0.023	0.005	ND	0.006	0.007	0.096	ND	0.047	ND	ND	ND	ND	ND	
AQ070705:1415NP4-2	7/7/2005	14:15	ND	ND	0.036	ND	ND	ND	0.036	0.006	0.002	ND	ND	ND	0.65 ^{1/}	ND	0.49 ^{1/}	0.11	ND	ND	ND	ND	
AQ080205:1405NP4-2	8/2/2005	14:05	0.019	ND	0.05	ND	ND	ND	0.051	0.006	0.007	ND	0.006	0.007	0.029 ^{1/}	ND	0.72 ^{1/}	0.048	ND	0.002	ND	ND	
AQ090805:905NP4-2	9/8/2005	9:05	0.008	ND	0.039	ND	ND	ND	0.049	0.002	0.024	0.012	ND	0.004	0.10 ^{1/}	ND	0.018	0.013	ND	0.003	ND	ND	
AQ100605:1232NP4-2	10/6/2005	12:32	0.007	ND	0.1	0.01	0.028	0.009	0.013	0.001	0.003	ND	0.003	0.01	0.021	ND	ND	0.049	ND	ND	0.001	ND	
AQ111605:1132NP4-2	11/16/2005	11:32	0.01	ND	0.058	0.004	0.015	0.004	0.013	0.002	0.002	ND	ND	0.005	0.017	ND	0.021	0.031	ND	ND	ND	ND	
AQ120805:935NP4-2	12/8/2005	9:35	0.003	ND	0.13	0.009	0.023	0.007	0.013	0.002	0.004	0.001	0.003	0.006	0.007 ^{2/}	ND	0.021	0.018	ND	0.001	0.003	ND	
AQ010406:850NP4-2	1/4/2006	8:50	0.006	ND	0.11	0.005	0.017	0.006	0.018	0.001	0.003	ND	0.003	0.005	0.007	ND	0.022	0.009	ND	0.001	ND	ND	
AQ020106:750NP4-2	2/1/2006	7:50	0.002	ND	0.086	ND	0.013	0.007	0.016	0.012	0.007	0.002	0.002	0.003	0.017	ND	0.01	ND	ND	0.002	ND	ND	
AQ032206:1220NP4-2 ^{4/}	3/22/2006	12:20	0.0014	ND	0.075	0.0044	0.013	0.007	0.0041	ND	0.0025	ND	ND	0.0034	0.0027	ND	0.0062	ND	ND	ND	ND	0.00088	
AQ041206:955NP4-2	4/12/2006	0:00	0.0012	ND	0.099	0.0076	0.014	0.0087	0.0015	ND	0.0011	ND	ND	0.0047	0.0013	ND	ND	ND	ND	ND	ND	ND	
AQ051706:1005NP4-2	5/17/2006	10:05	0.0028	0.001	0.065	0.0039	0.014	0.0074	0.0045	ND	0.0032	ND	ND	0.0036	0.003	0.0019	0.0088	ND	ND	ND	ND	ND	

Postcarbon			Parameters (mg/m3)																				TOTAL VOCs
Sample Name	Date	Time	PCE	TCE	TCA	DCE	DCA	cis-DCE	Toluene	Benzene	m&p-Xylenes	o-Xylene	Styrene	CF	MC	CM	CD	BM	CB	EB	VC	CT	
AQ062405:1242NP4-3	6/24/2005	12:42	ND	ND	0.012	ND	ND	ND	0.035	0.002	0.002	ND	0.004	0.004	0.063	ND	0.022	0.054	ND	ND	ND	ND	
AQ070705:1420NP4-3	7/7/2005	14:20	ND	ND	0.014	ND	ND	ND	0.038	0.004	0.003	ND	0.005	ND	0.23 ^{1/}	ND	0.45 ^{1/}	0.046	ND	ND	ND	ND	
AQ080205:1410NP4-3	8/2/2005	14:10	ND	ND	ND	ND	ND	ND	0.068	0.007	0.007	ND	0.008	0.007	0.019 ^{1/}	ND	0.640 ^{1/}	0.046	ND	ND	ND	ND	
AQ090805:910NP4-3	9/8/2005	9:10	ND	ND	0.016	ND	ND	ND	0.038	0.002	0.022	0.01	0.004	0.005	0.025 ^{1/}	ND	0.019	0.035	ND	0.002	ND	ND	
AQ100605:1234NP4-3	10/6/2005	12:34	0.004	ND	0.014	0.004	0.009	0.009	0.012	0.002	0.002	ND	0.002	0.004	0.02	ND	ND	0.084	ND	ND	ND	ND	
AQ111605:1134NP4-3	11/16/2005	11:34	0.003	ND	0.029	ND	0.014	ND	0.044	0.011	0.009	0.003	ND	0.005	0.03	ND	0.022	0.016	ND	0.002	ND	ND	
AQ120805:940NP4-3	12/8/2005	9:40	ND	ND	0.075	0.009	0.028	0.004	0.013	0.002	0.003	0.0003	0.003	0.009	0.009 ^{2/}	ND	0.025	0.02	ND	0.0008	ND	ND	
AQ010406:855NP4-3	1/4/2006	8:55	0.004	ND	0.096	0.006	0.022	0.003	0.017	0.004	0.004	ND	0.003	0.006	0.014	ND	0.022	ND	ND	0.001	ND	ND	
AQ020106:755NP4-3	2/1/2007	7:55	ND	0.002	0.075	0.004	0.016	0.003	0.004	0.003	0.001	ND	ND	0.005	0.017	ND	0.012	0.11 ^{3/}	ND	ND	ND	ND	
AQ032206:1225NP4-3 ^{4/}	3/22/2006	12:25	ND	ND	0.11	0.0046	0.016	0.0045	0.0029	ND	0.0021	ND	ND	0.0049	0.0025	0.0016	0.0055	ND	ND	ND	ND	0.00081	
AQ041206:1000NP4-3	4/12/2006	10:00	ND	ND	0.074	0.0065	0.011	0.0051	0.0018	ND	0.0015	ND	ND	0.0051	0.0013	ND	ND	ND	ND	ND	ND	ND	
AQ051706:1010NP4-3	5/17/2006	10:10	0.0046	ND	0.068	0.0045	0.015	0.0048	0.0046	0.00088	0.0025	ND	ND	0.0042	0.0022	0.0026	0.012	ND	ND	ND	ND	0.00075	

- Notes: 1. Methylene chloride and/or carbon disulfide concentrations in all three air samples collected during the July 7, August 9 and September 8, 2005 sampling events are greatly elevated due to suspected laboratory contamination. The methylene chloride concentration from the June 24, 2005 sampling event was used instead of the July 7, August 9 or September 8, 2005 methylene chloride concentrations to calculate the total VOCs for July, August and September 2005. The carbon disulfide concentration from the June 24, 2005 sampling event was used instead of the July 7 and August 9, 2005 carbon disulfide concentration to calculate the total VOCs for July and August 2005.
2. The methylene chloride concentration in the air samples collected on December 8, 2005 are suspected to be from laboratory contamination.
3. The laboratory procedure for the % bromomethane recovered exceeded the upper limit for quality control, therefore the bromomethane concentration for January 4, 2006 was used to calculate the total VOC concentration in for the February 1, 2006 samples.
4. The air samples from March 2006 and forward were analyzed using the TO-15 method at the Severn Trent Laboratory located in Knoxville, TN. Air sampling using the TO-17 method at the Severn Trent Laboratory in Connecticut is no longer available. The March 2006 air quality results appear to be a little lower or similar to prior air quality results. LBG will continue to monitor the air quality on a monthly basis.

PCE - Tetrachloroethane	DCE - 1,1-Dichloroethane	CF - Chloroform	BM - Bromomethane
TCE - Trichloroethane	DCA - 1,1-Dichloroethane	MC - Methylene Chloride	CB - Chlorobenzene
TCA - 1,1,1-Trichloroethane	cis-DCE - cis-1,2-Dichloroethane	CM - Chloromethane	EB - Ethylbenzene
	CT - Carbon Tetrachloride	CD - Carbon Disulfide	VC - Vinyl Chloride

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	1,1-Dichloro-ethane (ug/L)	cis-1,2-Dichloro-ethene (ug/L)	1,1-Dichloro-ethene (ug/L)	Methylene Chloride (ug/L) ^{1/}	Toluene (ug/L)	Dibromochloromethane (ug/L)	Acetone (ug/L) ^{1/}
	ARAR's	5	5	5	NE	7	NE	300	300	5	5	5	5	NE	NE	NE
RW-1	15-Sep-04	ND<1	ND<1	ND<1	ND<1	2.8	ND<1	0.0865	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	ND<1	ND<1	ND<1	ND<1	ND<1	2.2	0.0332	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	ND<1	ND<1	ND<1	ND<1	1.9	2.0	0.0133	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	ND<1	ND<1	ND<1	ND<1	9.8	ND<1	0.0475	0.0229	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-Jan-05	ND<1	ND<1	ND<1	ND<1	1.5	2.1	0.0703	0.0326	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	ND<1	ND<1	ND<1	ND<1	4.6	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	ND<1	ND<1	ND<1	ND<1	2.5	ND<1	0.0285	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	ND<1	ND<1	ND<1	ND<1	1.5	ND<1	0.0357	0.0217	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	ND<1	ND<1	ND<1	ND<1	4.0	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
RW-2	14-Jul-05	ND<1	ND<1	ND<1	ND<1	2.1	ND<1	0.0289	ND<0.02	ND<1	ND<1	ND<1	8.4*	ND<1	ND<1	6.9*
	7-Mar-06	ND<1	ND<1	ND<1	ND<1	5.2	ND<1	0.1650	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Sep-04	12	ND<1	ND<1	ND<1	ND<1	ND<1	3.82	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	10	ND<1	ND<1	ND<1	ND<1	1.5	4.78	0.213	ND<1	ND<1	ND<1	ND<1	ND<1	1.5	ND<1
	3-Nov-04	11	ND<1	ND<1	ND<1	ND<1	ND<1	5.21	0.152	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	10	ND<1	ND<1	ND<1	ND<1	ND<1	10.8	0.297	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	25	ND<1	ND<1	ND<1	ND<1	ND<1	4.81	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	18	ND<1	ND<1	ND<1	ND<1	ND<1	5.01	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	20	1.1	ND<1	ND<1	ND<1	ND<1	5.28	0.0816	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	9.0	ND<1	ND<1	ND<1	ND<1	ND<1	4.51	0.128	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	8.2	ND<1	ND<1	ND<1	ND<1	ND<1	3.69	0.17	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	12.0	ND<1	1.0	ND<1	ND<1	ND<1	3.5	0.0511	ND<1	2.0	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	7.7	1.1	ND<1	ND<1	ND<1	ND<1	0.28	0.0298	ND<1	ND<1	ND<1	7.3 *	ND<1	ND<1	5.6 *
	9-Aug-05	5.4	ND<1	ND<1	ND<1	ND<1	ND<1	3.74	0.107	ND<1	5.8	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	16	1.8	ND<1	ND<1	ND<1	ND<1	3.57	0.0704	ND<1	11	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	15	2.1	ND<1	ND<1	ND<1	ND<1	6.1	0.0269	ND<1	12	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	34	2.1	ND<1	ND<1	ND<1	ND<1	4.25	ND<0.02	ND<1	25	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	5.2	2.0	ND<1	ND<1	ND<1	ND<1	9.15	0.0696	ND<1	5.0	ND<1	4.8 *	1.0	ND<1	ND<1
	14-Feb-06	6.5	4.3	1.2	ND<1	ND<1	ND<1	3.99	ND<0.02	ND<1	2.8	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Mar-06	6.5	3.5	ND<1	ND<1	ND<1	ND<1	4.76	0.0395	ND<1	3.8	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Apr-06	12.0	3.9	1.2	ND<1	ND<1	ND<1	4.24	0.0522	ND<1	12.0	ND<1	ND<1	ND<1	ND<1	ND<1
	17-May-06	19.0	5.1	ND<1	ND<1	ND<1	ND<1	5.95	0.063	ND<1	14.0	ND<1	ND<1	ND<1	ND<1	ND<1

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	1,1-Dichloro-ethane (ug/L)	cis-1,2-Dichloro-ethene (ug/L)	1,1-Dichloro-ethene (ug/L)	Methylene Chloride (ug/L) ^{1/}	Toluene (ug/L)	Dibromochloromethane (ug/L)	Acetone (ug/L) ^{1/}
	ARAR's	5	5	5	NE	7	NE	300	300	5	5	5	5	NE	NE	NE
RW-3	15-Sep-04	2.7	21	8.7	ND<1	ND<1	ND<1	1.91	0.42	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	2.2	12	5.0	ND<1	ND<1	ND<1	2.09	1.82	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	1.5	6.5	2.6	ND<1	ND<1	ND<1	1.87	1.8	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	3.77	0.489	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.60	2.24	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	1.6	1.3	ND<1	ND<1	ND<1	ND<1	2.10	1.15	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	3	13	5.0	ND<1	ND<1	ND<1	1.89	1.36	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	ND<1	2.0	ND<1	ND<1	ND<1	ND<1	46.1	0.539	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	2.2	7.7	2.8	ND<1	ND<1	ND<1	1.85	0.82	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	9.91	10	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	2.01	0.649	ND<1	ND<1	ND<1	9.1 *	ND<1	ND<1	6.9 *
	9-Aug-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.50	0.973	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	1	3.6	1.2	ND<1	ND<1	ND<1	2.03	0.71	ND<1	2.6	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	1.3	ND<1	ND<1	ND<1	ND<1	ND<1	1.83	0.708	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.11	0.556	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	1.7	17	7.9	ND<1	ND<1	ND<1	1.93	0.455	ND<1	ND<1	ND<1	4.6*	ND<1	ND<1	ND<1
RW-4	14-Feb-06	1.4	8.9	2.5	ND<1	ND<1	ND<1	3.80	0.157	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Mar-06	1.1	3.4	ND<1	ND<1	ND<1	ND<1	1.87	0.297	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Apr-06	0.95	ND<1	ND<1	ND<1	ND<1	ND<1	1.99	0.649	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	17-May-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	1.06	0.353	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Sep-04	120	3.7	18	ND<1	ND<1	ND<1	2.98	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	94	ND<1	14	ND<1	ND<1	ND<1	3.65	0.126	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	130	4.2	11	ND<1	ND<1	ND<1	4.75	0.205	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	230	5.7	35	ND<1	ND<1	ND<1	1.90	1.62	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	160	4.1	7.3	ND<1	ND<1	ND<1	6.11	3.28	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	15-Mar-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	19-Apr-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	2-May-05	80	2.4	9.8	ND<1	ND<1	ND<1	3.77	0.0687	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Jun-05	74	2.6	ND<1	ND<1	ND<1	ND<1	9.95	9.28	ND<1	ND<1	ND<1	4.5*	ND<1	ND<1	ND<1
	14-Jul-05	37	ND<1	8.9	ND<1	ND<1	ND<1	3.22	0.0185	ND<1	ND<1	ND<1	9.4 *	ND<1	ND<1	7.4 *
	9-Aug-05	31	ND<1	ND<1	ND<1	ND<1	ND<1	2.49	0.111	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	45	ND<1	6.0	ND<1	ND<1	ND<1	3.47	0.173	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	30	ND<1	ND<1	ND<1	ND<1	ND<1	3.69	0.0777	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Dec-05	64	2.0	1.5	ND<1	ND<1	ND<1	2.82	0.0302	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	15	ND<1	9.5	ND<1	ND<1	ND<1	7.78	0.0412	ND<1	ND<1	ND<1	5.2 *	ND<1	ND<1	ND<1
	14-Feb-06	24	ND<1	8.7	ND<1	ND<1	ND<1	6.05	0.0627	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Mar-06	22	ND<1	7.0	ND<1	ND<1	ND<1	3.50	0.0476	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Apr-06	26	1.5	6.2	ND<1	ND<1	2	4.17	0.0963	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	17-May-06	26	ND<1	ND<1	ND<1	ND<1	ND<1	3.15	0.109	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (ug/L)	1,1-Dichloro-ethane (ug/L)	cis-1,2-Dichloro-ethene (ug/L)	1,1-Dichloro-ethene (ug/L)	Methylene Chloride (ug/L) ^{1/}	Toluene (ug/L)	Dibromochloromethane (ug/L)	Acetone (ug/L) ^{1/}
	ARAR's	5	5	5	NE	7	NE	300	300	5	5	5	5	NE	NE	NE
RW-5	15-Sep-04	24	ND<1	6.5	ND<1	ND<1	3.2	2.39	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	16	ND<1	5.2	ND<1	ND<1	2.4	0.139	0.0163	ND<1	ND<1	ND<1	ND<1	ND<1	1.4	ND<1
	3-Nov-04	15	ND<1	6.4	ND<1	ND<1	2.2	0.0287	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	28	ND<1	28	ND<1	ND<1	ND<1	0.0621	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	12	ND<1	5.6	ND<1	ND<1	2.0	0.0269	0.0172	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	11	ND<1	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	14	ND<1	4.3	ND<1	ND<1	2.6	0.318	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	9	ND<1	4.1	ND<1	ND<1	ND<1	0.0887	0.0187	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	13	ND<1	5.7	ND<1	ND<1	ND<1	0.0223	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	4.7	ND<1	ND<1	ND<1	ND<1	ND<1	0.0177	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	8.2	ND<1	1.6	ND<1	ND<1	ND<1	0.0358	ND<0.02	ND<1	ND<1	ND<1	9.5 *	ND<1	ND<1	5.6 *
	9-Aug-05	2.6	ND<1	ND<1	ND<1	ND<1	ND<1	0.0227	0.0303	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	8	ND<1	3.8	ND<1	ND<1	ND<1	0.0185	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	2.6	ND<1	ND<1	ND<1	ND<1	ND<1	0.0482	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	2.4	ND<1	ND<1	ND<1	ND<1	ND<1	0.0468	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	2.3	ND<1	2.0	ND<1	ND<1	ND<1	0.0558	0.0119	ND<1	ND<1	ND<1	4.6*	ND<1	ND<1	ND<1
	14-Feb-06	2.9	ND<1	3.8	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Mar-06	2.6	ND<1	3.0	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Apr-06	1.4	ND<1	ND<1	ND<1	1.5	2.4	0.0786	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	17-May-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.016	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
RW-6	15-Sep-04	130	3.3	2.2	ND<1	ND<1	ND<1	0.0976	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	94	ND<1	1.6	ND<1	ND<1	ND<1	0.214	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	2.0	ND<1
	3-Nov-04	94	2.1	2.4	ND<1	ND<1	2.5	0.0111	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	200	3.8	16	ND<1	ND<1	ND<1	4.73	0.117	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	86	2.1	3.7	ND<1	ND<1	2.4	0.0279	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	110	2.4	7.6	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	120	2.3	6.6	ND<1	ND<1	2.7	0.0294	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	74	ND<1	7.0	ND<1	ND<1	ND<1	0.0509	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	96	2.8	8.5	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	69	1.6	13	ND<1	ND<1	ND<1	0.067	0.0195	ND<1	ND<1	2.1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	64	1.6	9.5	ND<1	ND<1	ND<1	0.0406	ND<0.02	ND<1	ND<1	ND<1	7.2 *	ND<1	ND<1	7 *
	9-Aug-05	49	ND<1	12	ND<1	ND<1	ND<1	0.088	0.0366	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	100	1.6	12	ND<1	ND<1	ND<1	1.3	0.0143	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	68	ND<1	ND<1	ND<1	ND<1	ND<1	0.144	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	100	2.1	20	ND<1	ND<1	ND<1	0.139	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	41	1.1	16	ND<1	ND<1	ND<1	0.189	ND<0.02	ND<1	ND<1	ND<1	4.6*	ND<1	ND<1	ND<1
	22-Feb-06	63	1.6	15	ND<1	ND<1	ND<1	0.116	0.0155	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Mar-06	65	1.2	17	ND<1	ND<1	ND<1	0.0429	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Apr-06	62	2.1	22	ND<1	ND<1	2	0.24	0.0137	0.97	ND<1	1.1	ND<1	ND<1	ND<1	ND<1
	17-May-06	68	ND<1	18	ND<1	ND<1	ND<1	0.17	0.019	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	1,1-Dichloro-ethane (ug/L)	cis-1,2-Dichloro-ethene (ug/L)	1,1-Dichloro-ethene (ug/L)	Methylene Chloride (ug/L) ^{1/}	Toluene (ug/L)	Dibromochloromethane (ug/L)	Acetone (ug/L) ^{1/}
	ARAR's	5	5	5	NE	7	NE	300	300	5	5	5	5	NE	NE	NE
RW-7	15-Sep-04	59	2.2	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	38	ND<1	ND<1	ND<1	ND<1	ND<1	0.0429	0.0126	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	36	ND<1	ND<1	ND<1	ND<1	ND<1	0.0214	0.0108	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	82	ND<1	4.3	ND<1	ND<1	ND<1	0.0272	0.00876	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	37	1.1	ND<1	ND<1	ND<1	ND<1	0.0343	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	45	ND<1	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	42	1.5	1.7	ND<1	ND<1	ND<1	0.0356	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	22	ND<1	ND<1	ND<1	ND<1	ND<1	0.107	0.0152	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	30	ND<1	ND<1	ND<1	ND<1	ND<1	0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	32	1.0	4.7	ND<1	ND<1	ND<1	0.0753	0.02	1.5	ND<1	1.1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	32	ND<1	2.2	ND<1	ND<1	ND<1	0.0155	ND<0.02	ND<1	ND<1	ND<1	8.7 *	ND<1	ND<1	7.2 *
	9-Aug-05	31	ND<1	6.2	ND<1	ND<1	ND<1	0.0903	0.0409	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	39	ND<1	3.4	ND<1	ND<1	ND<1	0.0452	ND<0.02	1.7	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	36	ND<1	ND<1	ND<1	ND<1	ND<1	0.536	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	70	ND<1	12.0	ND<1	ND<1	ND<1	0.253	ND<0.02	4.2	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	26	ND<1	5.0	ND<1	ND<1	ND<1	0.343	ND<0.02	2.2	ND<1	ND<1	5.0 *	ND<1	ND<1	ND<1
	14-Feb-06	36	ND<1	4.1	ND<1	ND<1	ND<1	0.0332	ND<0.02	2.0	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Mar-06	38	ND<1	4.1	ND<1	ND<1	ND<1	0.143	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
RW-8	12-Apr-06	49	1.6	7.4	ND<1	ND<1	ND<1	0.0912	0.0175	3.4	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	17-May-06	59	ND<1	ND<1	ND<1	ND<1	ND<1	0.126	0.026	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Sep-04	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	ND<1	ND<1	NM
	27-Oct-04	4.1	1.0	2.2	ND<1	ND<1	ND<1	28.8	0.235	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	5.3	ND<1	4.0	ND<1	ND<1	ND<1	10.6	0.271	3.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	16	ND<1	22	ND<1	ND<1	ND<1	15.6	0.149	15	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	6.9	1.3	3.9	ND<1	ND<1	ND<1	8.92	2.85	2.7	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	7.4	ND<1	7.2	ND<1	ND<1	ND<1	8.24	ND<0.02	4.7	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	9.0	1.3	4.2	ND<1	ND<1	ND<1	7.54	0.075	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	3.5	ND<1	3.5	ND<1	ND<1	ND<1	8.89	0.321	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	5.6	ND<1	5.2	ND<1	ND<1	ND<1	7.33	0.073	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	2.7	ND<1	5.8	ND<1	ND<1	ND<1	7.06	0.325	2.1	ND<1	1.7	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	2.6	ND<1	3.4	ND<1	ND<1	ND<1	8.33	0.017	ND<1	ND<1	ND<1	8.5 *	ND<1	ND<1	8.2 *
	9-Aug-05	1.8	ND<1	2.9	ND<1	ND<1	ND<1	0.24	0.065	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	2.9	ND<1	4.2	ND<1	ND<1	ND<1	7.53	0.255	2.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	7.65	0.106	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	2.4	ND<1	5.0	ND<1	ND<1	ND<1	5.19	0.021	3.2	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	1.3	ND<1	3.7	ND<1	ND<1	ND<1	7.25	0.097	2.0	ND<1	ND<1	4.9 *	ND<1	ND<1	ND<1
	14-Feb-06	1.5	ND<1	3.0	ND<1	ND<1	ND<1	8.06	ND<0.02	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Mar-06	1.3	ND<1	2.8	ND<1	ND<1	ND<1	8.33	0.064	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Apr-06	2.1	0.9	4.5	ND<1	ND<1	ND<1	7.27	0.823	3.3	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	17-May-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.03	0.056	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	1,1-Dichloroethane (ug/L)	cis-1,2-Dichloroethene (ug/L)	1,1-Dichloroethene (ug/L)	Methylene Chloride (ug/L) ^{1/}	Toluene (ug/L)	Dibromochloromethane (ug/L)	Acetone (ug/L) ^{1/}
	ARAR's	5	5	5	NE	7	NE	300	300	5	5	5	5	NE	NE	NE
RW-9	15-Sep-04	3.7	1.0	6.0	ND<1	ND<1	ND<1	0.049	ND<0.02	1.9	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	3.1	ND<1	5.0	ND<1	ND<1	ND<1	3.12	0.716	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	1.6	ND<1	5.9	ND<1	ND<1	ND<1	2.97	1.41	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	1.3	ND<1	31	ND<1	ND<1	ND<1	2.78	0.497	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	ND<1	1.0	6.4	ND<1	ND<1	ND<1	2.35	1.72	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	ND<1	ND<1	10	ND<1	ND<1	ND<1	0.0974	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	ND<1	1.4	5.9	ND<1	ND<1	ND<1	1.55	0.507	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	ND<1	ND<1	4.5	ND<1	ND<1	ND<1	1.59	0.091	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	ND<1	2.9	9.0	ND<1	ND<1	ND<1	2.89	0.0596	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	ND<1	ND<1	5.8	ND<1	ND<1	ND<1	1.38	0.149	0.9	ND<1	1.2	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	3.4	ND<1	3.1	ND<1	ND<1	ND<1	2.55	0.238	ND<1	ND<1	ND<1	6.9 *	ND<1	ND<1	7.3 *
	9-Aug-05	ND<1	ND<1	1.4	ND<1	ND<1	ND<1	0.994	0.0734	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	1.2	ND<1	2.0	ND<1	ND<1	ND<1	3.64	0.161	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	1.31	0.108	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	ND<1	ND<1	2.9	ND<1	ND<1	ND<1	2.01	0.024	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	ND<1	ND<1	1.4	ND<1	ND<1	ND<1	2.36	0.0905	ND<1	ND<1	ND<1	4.9 *	ND<1	ND<1	ND<1
	14-Feb-06	2.1	ND<1	1.8	ND<1	ND<1	ND<1	5.23	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Mar-06	1.3	ND<1	ND<1	ND<1	ND<1	ND<1	3.41	0.333	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Apr-06	ND<1	ND<1	2.2	ND<1	ND<1	ND<1	1.93	0.108	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	17-May-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	1.64	0.054	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1

ND: Not detected

<#: Less than method detection limit

ug/L: Micrograms per liter

:- Not analyzed

PCE: Tetrachloroethylene

TCE: Trichloroethene

TCA: 1,1,1-Trichloroethane

1,1-DCA: 1,1-Dichloroethane

1,1-DCE: 1,1-Dichloroethene

1,2-DCE: 1,2-Dichloroethene

MTBE: Methyl Tertiary Butyl Ether

NM: Not Measured

ARAR's are chemical specific aquifer restoration goals for ground water at the Former Rowe Industries Superfund Site

Bold values indicate an exceedance of the ARAR standard established for the site


NE indicates that the ARAR goal was not established for this compound by the EPA

*Concentrations with an asterisk following them are due to laboratory contamination.

GRAPHS


GRAPH 1
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

EFFLUENT FLOW DATA
(May 1, 2006 through May 31, 2006)

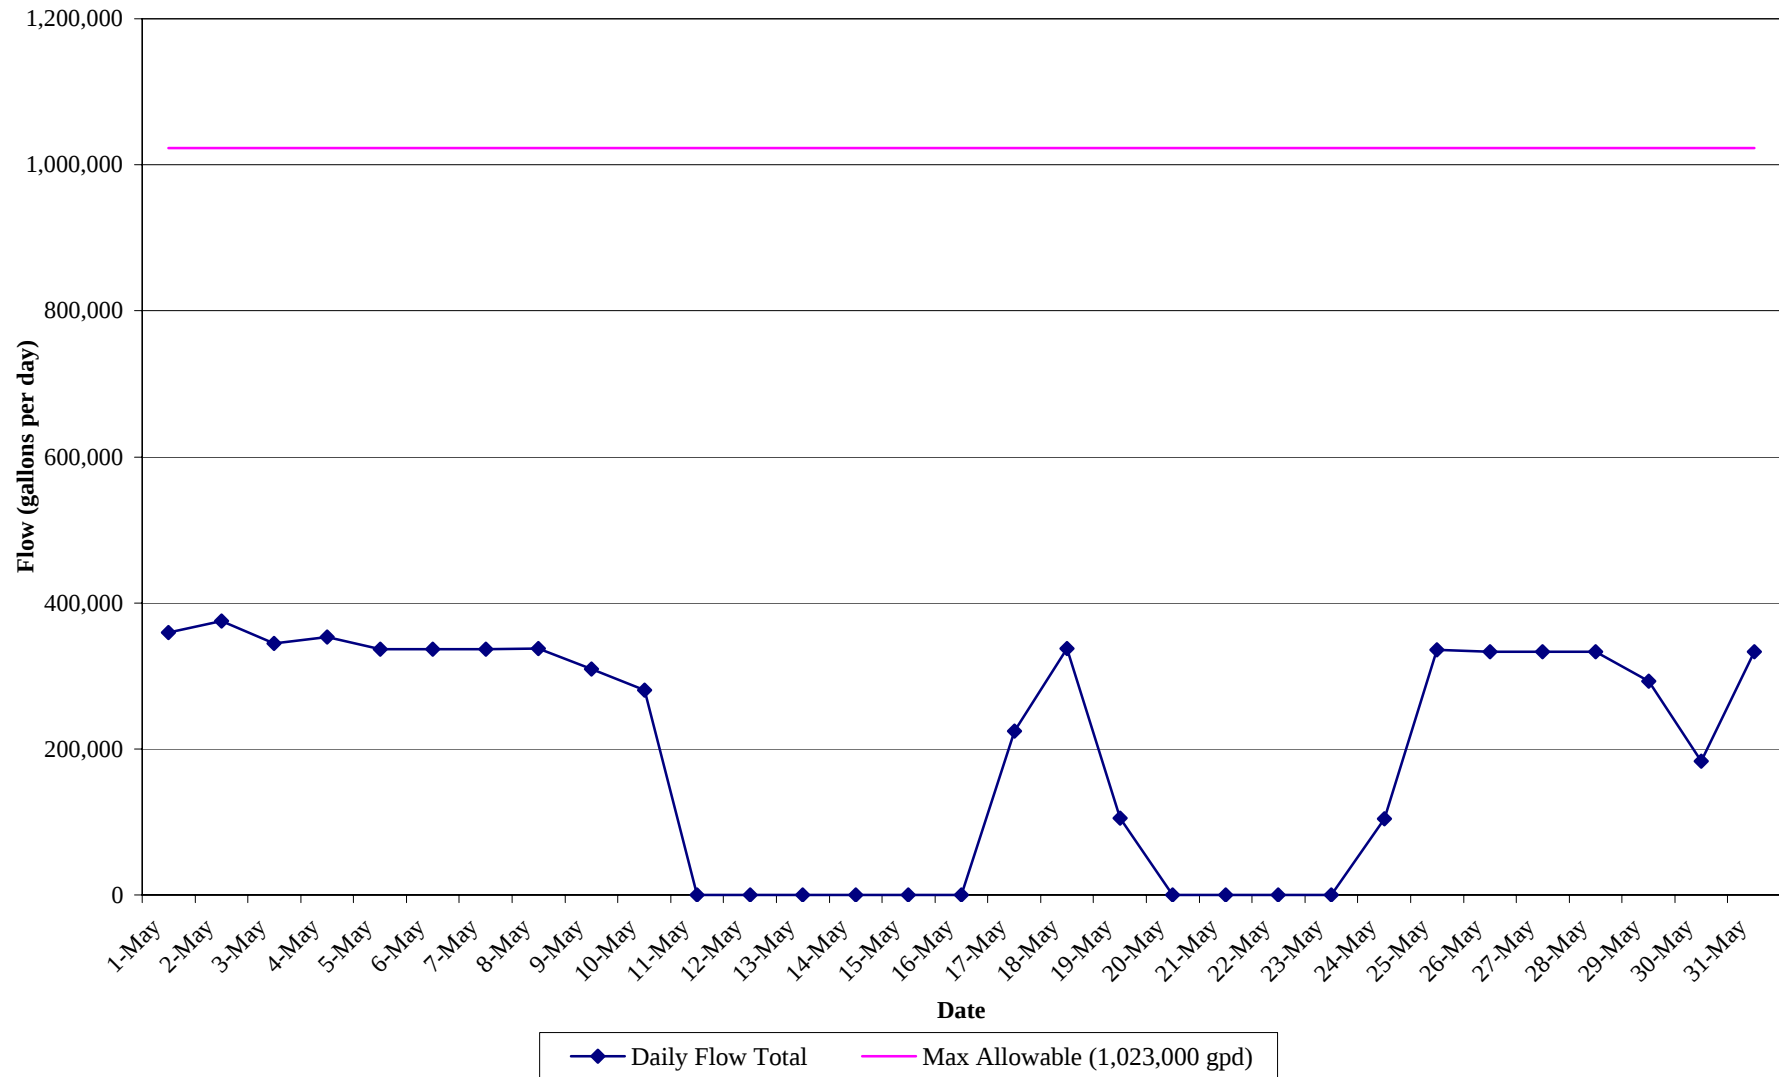


GRAPH 2
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RECOVERY WELL PCE CONCENTRATION IN MICROGRAMS PER LITER

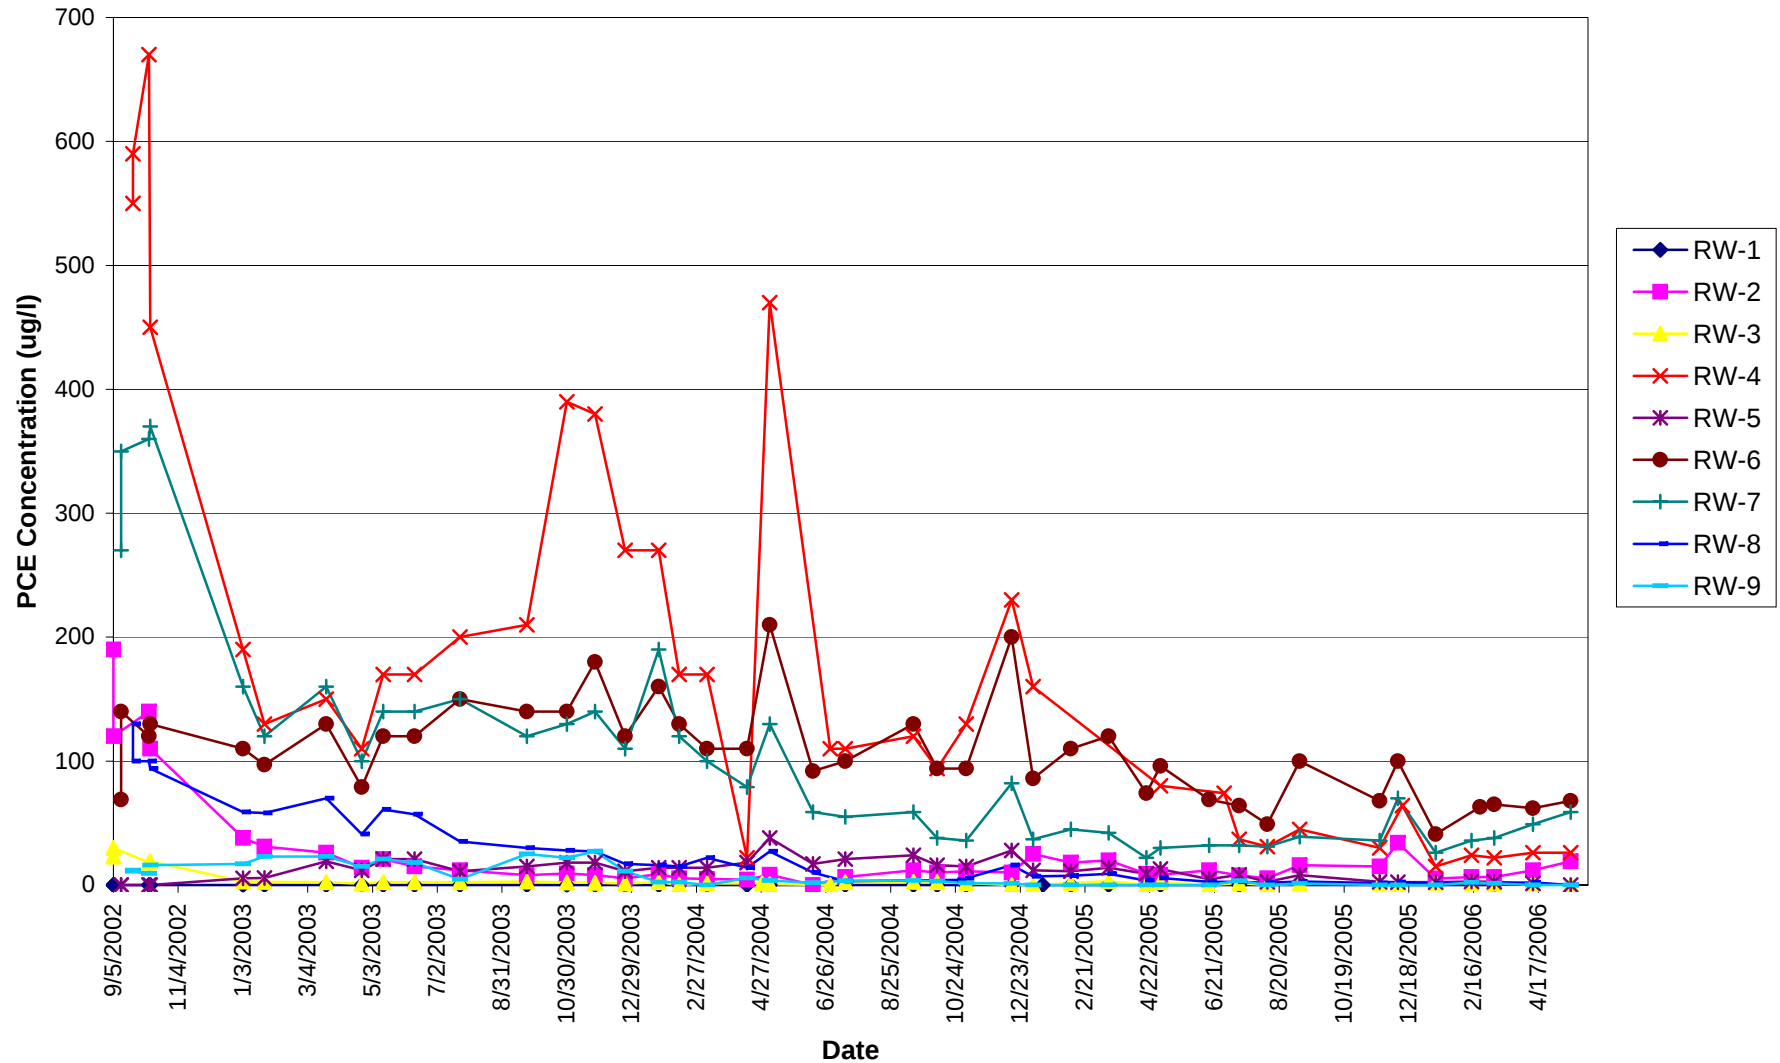

GRAPH 3
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RECOVERY WELL PCE CONCENTRATION FOR SELECT RECOVERY WELLS

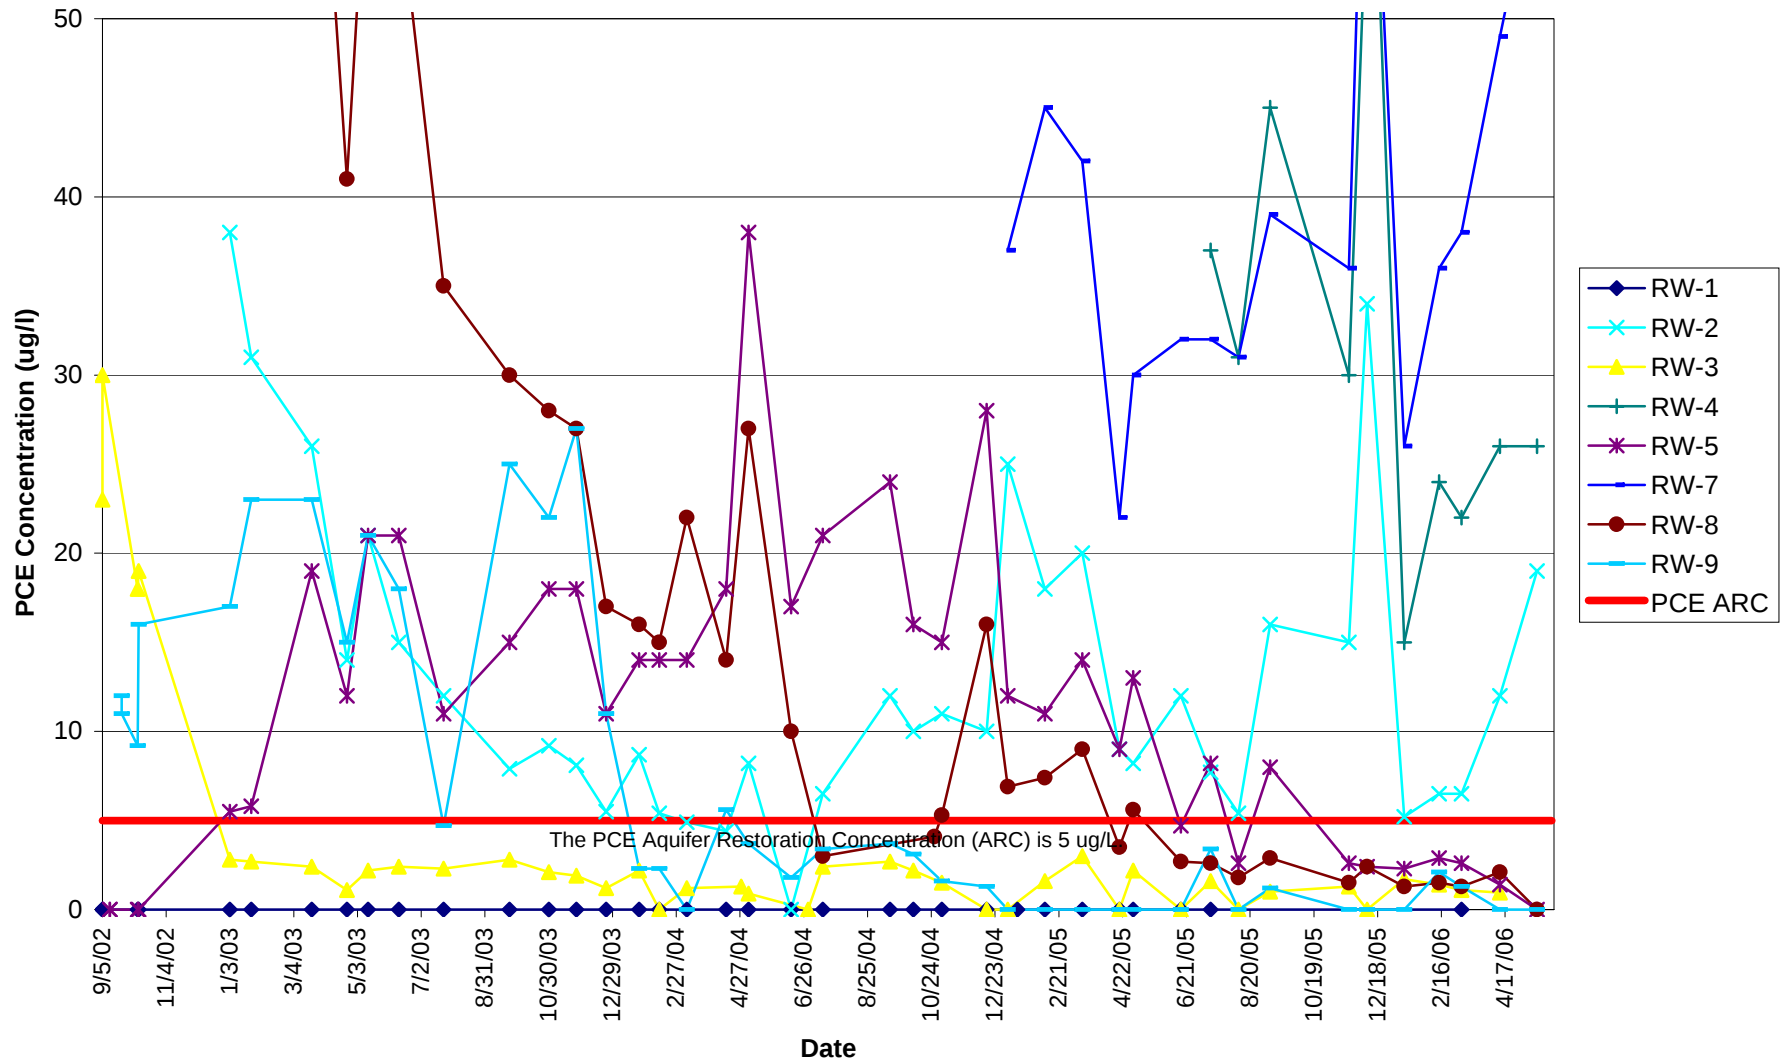

APPENDIX I
MAY 2006 LABORATORY ANALYTICAL REPORTS



NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Wednesday, May 10, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484
TEL: (203) 929-8555
FAX (203) 926-9140
RE: Rowe Industries

Order No.: 0605059

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 5/5/2006 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

Lori Beyer
Lab Director

American Analytical Laboratories, LLC.**Date:** 10-May-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0605059

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0605059-01A	WQ050306:800NP2-6		5/3/2006	5/5/2006
0605059-01B	WQ050306:800NP2-6		5/3/2006	5/5/2006
0605059-01C	WQ050306:800NP2-6		5/3/2006	5/5/2006
0605059-02A	WQ050306:805NP2-7		5/3/2006	5/5/2006
0605059-02B	WQ050306:805NP2-7		5/3/2006	5/5/2006
0605059-02C	WQ050306:805NP2-7		5/3/2006	5/5/2006
0605059-03A	WQ050306:810NP2-10		5/3/2006	5/5/2006
0605059-03B	WQ050306:810NP2-10		5/3/2006	5/5/2006
0605059-03C	WQ050306:810NP2-10		5/3/2006	5/5/2006



56 TOLEDO STREET • FARMINGDALE, NY 11735 • (516) 454-6100 • FAX (516) 454-8027

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 10-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605059
Project: Rowe Industries
Lab ID: 0605059-01A

Client Sample ID: WQ050306:800NP2-6
Tag Number:
Collection Date: 5/3/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: SB
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
2-Butanone	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
2-Hexanone	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Acetone	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Benzene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Bromobenzene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Bromochloromethane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Bromodichloromethane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Bromoform	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Bromomethane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Carbon disulfide	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Chlorobenzene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 10-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605059
Project: Rowe Industries
Lab ID: 0605059-01A

Client Sample ID: WQ050306:800NP2-6
Tag Number:
Collection Date: 5/3/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11						
		SW8260B		SW5030A		Analyst: SB
Chloroethane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Chloroform	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Chloromethane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Dibromochloromethane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Dibromomethane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Ethylbenzene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Isopropylbenzene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
m,p-Xylene	U	2.0		µg/L	1	5/5/2006 6:21:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Methylene chloride	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Naphthalene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
n-Butylbenzene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
n-Propylbenzene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
o-Xylene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Styrene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Tetrachloroethene	14	1.0		µg/L	1	5/5/2006 6:21:00 PM
Toluene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Trichloroethene	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Vinyl acetate	U	1.0		µg/L	1	5/5/2006 6:21:00 PM
Vinyl chloride	U	1.0		µg/L	1	5/5/2006 6:21:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 10-May-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ050306:800NP2-6
Lab Order:	0605059	Tag Number:	
Project:	Rowe Industries	Collection Date:	5/3/2006
Lab ID:	0605059-01B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	2.23	0.0200		mg/L	1	5/8/2006 12:24:17 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 10-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605059
Project: Rowe Industries
Lab ID: 0605059-01C

Client Sample ID: WQ050306:800NP2-6
Tag Number:
Collection Date: 5/3/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.115	0.0200		mg/L	1	5/8/2006 12:22:24 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 10-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605059
Project: Rowe Industries
Lab ID: 0605059-02A

Client Sample ID: WQ050306:805NP2-7
Tag Number:
Collection Date: 5/3/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11						
		SW8260B		SW5030A		Analyst: SB
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
2-Butanone	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
2-Hexanone	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Acetone	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Benzene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Bromobenzene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Bromochloromethane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Bromodichloromethane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Bromoform	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Bromomethane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Carbon disulfide	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Chlorobenzene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 10-May-06

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ050306:805NP2-7

Lab Order: 0605059

Tag Number:

Project: Rowe Industries

Collection Date: 5/3/2006

Lab ID: 0605059-02A

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: SB
Chloroethane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Chloroform	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Chloromethane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Dibromochloromethane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Dibromomethane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Ethylbenzene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Isopropylbenzene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
m,p-Xylene	U	2.0		µg/L	1	5/5/2006 6:57:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Methylene chloride	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Naphthalene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
n-Butylbenzene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
n-Propylbenzene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
o-Xylene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Styrene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Tetrachloroethene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Toluene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Trichloroethene	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Vinyl acetate	U	1.0		µg/L	1	5/5/2006 6:57:00 PM
Vinyl chloride	U	1.0		µg/L	1	5/5/2006 6:57:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 10-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605059
Project: Rowe Industries
Lab ID: 0605059-02B

Client Sample ID: WQ050306:805NP2-7
Tag Number:
Collection Date: 5/3/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	2.57	0.0200		mg/L	1	5/8/2006 12:28:19 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 10-May-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ050306:805NP2-7
Lab Order:	0605059	Tag Number:	
Project:	Rowe Industries	Collection Date:	5/3/2006
Lab ID:	0605059-02C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.0787	0.0200		mg/L	1	5/8/2006 12:26:26 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 10-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605059
Project: Rowe Industries
Lab ID: 0605059-03A

Client Sample ID: WQ050306:810NP2-10
Tag Number:
Collection Date: 5/3/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11						
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
2-Butanone	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
2-Hexanone	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Acetone	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Benzene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Bromobenzene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Bromochloromethane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Bromodichloromethane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Bromoform	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Bromomethane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Carbon disulfide	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Chlorobenzene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 10-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605059
Project: Rowe Industries
Lab ID: 0605059-03A

Client Sample ID: WQ050306:810NP2-10
Tag Number:
Collection Date: 5/3/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: SB
Chloroethane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Chloroform	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Chloromethane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Dibromochloromethane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Dibromomethane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Ethylbenzene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Isopropylbenzene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
m,p-Xylene	U	2.0		µg/L	1	5/5/2006 7:41:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Methylene chloride	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Naphthalene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
n-Butylbenzene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
n-Propylbenzene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
o-Xylene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Styrene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Tetrachloroethene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Toluene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Trichloroethene	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Vinyl acetate	U	1.0		µg/L	1	5/5/2006 7:41:00 PM
Vinyl chloride	U	1.0		µg/L	1	5/5/2006 7:41:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 10-May-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ050306:810NP2-10
Lab Order:	0605059	Tag Number:	
Project:	Rowe Industries	Collection Date:	5/3/2006
Lab ID:	0605059-03B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	2.08	0.0200		mg/L	1	5/8/2006 12:34:45 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level


American Analytical Laboratories, LLC.**Date:** 10-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605059
Project: Rowe Industries
Lab ID: 0605059-03C

Client Sample ID: WQ050306:810NP2-10
Tag Number:
Collection Date: 5/3/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.0957	0.0200		mg/L	1	5/8/2006 12:32:25 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	100	1.00		mg/L	1	5/9/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

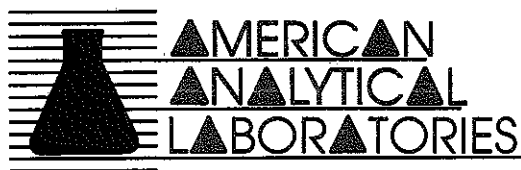

NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Thursday, May 18, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555

FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0605129

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 5/12/2006 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 18-May-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0605129

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0605129-01A	WQ051106:800 NP2-6		5/11/2006	5/12/2006
0605129-01B	WQ051106:800 NP2-6		5/11/2006	5/12/2006
0605129-01C	WQ051106:800 NP2-6		5/11/2006	5/12/2006
0605129-02A	WQ051106:805 NP2-7		5/11/2006	5/12/2006
0605129-02B	WQ051106:805 NP2-7		5/11/2006	5/12/2006
0605129-02C	WQ051106:805 NP2-7		5/11/2006	5/12/2006
0605129-03A	WQ051106:810 NP2-10		5/11/2006	5/12/2006
0605129-03B	WQ051106:810 NP2-10		5/11/2006	5/12/2006
0605129-03C	WQ051106:810 NP2-10		5/11/2006	5/12/2006

56 TOLEDO STREET • FARMINGDALE, NY 11735 • (516) 454-6100 • FAX (516) 454-8027

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 18-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605129
Project: Rowe Industries
Lab ID: 0605129-01A

Client Sample ID: WQ051106:800 NP2-6
Tag Number:
Collection Date: 5/11/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
2-Butanone	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
2-Hexanone	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Acetone	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Benzene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Bromobenzene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Bromochloromethane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Bromodichloromethane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Bromoform	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Bromomethane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Carbon disulfide	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Chlorobenzene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605129
Project: Rowe Industries
Lab ID: 0605129-01A

Client Sample ID: WQ051106:800 NP2-6
Tag Number:
Collection Date: 5/11/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
Chloroethane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Chloroform	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Chloromethane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Dibromochloromethane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Dibromomethane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Ethylbenzene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Isopropylbenzene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
m,p-Xylene	U	2.0		µg/L	1	5/16/2006 6:18:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Methylene chloride	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Naphthalene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
n-Butylbenzene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
n-Propylbenzene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
o-Xylene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Styrene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Tetrachloroethene	12	1.0		µg/L	1	5/16/2006 6:18:00 PM
Toluene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Trichloroethene	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Vinyl acetate	U	1.0		µg/L	1	5/16/2006 6:18:00 PM
Vinyl chloride	U	1.0		µg/L	1	5/16/2006 6:18:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-May-06

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** WQ051106:800 NP2-6**Lab Order:** 0605129**Tag Number:****Project:** Rowe Industries**Collection Date:** 5/11/2006**Lab ID:** 0605129-01B**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	5.28	0.0200		mg/L	1	5/16/2006 12:47:56 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605129
Project: Rowe Industries
Lab ID: 0605129-01C

Client Sample ID: WQ051106:800 NP2-6
Tag Number:
Collection Date: 5/11/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.0334	0.0200		mg/L	1	5/16/2006 12:45:45 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605129
Project: Rowe Industries
Lab ID: 0605129-02A

Client Sample ID: WQ051106:805 NP2-7
Tag Number:
Collection Date: 5/11/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
2-Butanone	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
2-Hexanone	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Acetone	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Benzene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Bromobenzene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Bromochloromethane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Bromodichloromethane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Bromoform	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Bromomethane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Carbon disulfide	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Chlorobenzene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM

Qualifiers:
 B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit
 U Indicates the compound was analyzed for but not detected

E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits
 X Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605129
Project: Rowe Industries
Lab ID: 0605129-02A

Client Sample ID: WQ051106:805 NP2-7
Tag Number:
Collection Date: 5/11/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
Chloroethane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Chloroform	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Chloromethane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Dibromochloromethane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Dibromomethane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Ethylbenzene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Isopropylbenzene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
m,p-Xylene	U	2.0		µg/L	1	5/16/2006 6:56:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Methylene chloride	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Naphthalene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
n-Butylbenzene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
n-Propylbenzene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
o-Xylene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Styrene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Tetrachloroethene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Toluene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Trichloroethene	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Vinyl acetate	U	1.0		µg/L	1	5/16/2006 6:56:00 PM
Vinyl chloride	U	1.0		µg/L	1	5/16/2006 6:56:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605129
Project: Rowe Industries
Lab ID: 0605129-02B

Client Sample ID: WQ051106:805 NP2-7
Tag Number:
Collection Date: 5/11/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	12.2	0.0200		mg/L	1	5/16/2006 12:52:15 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-May-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ051106:805 NP2-7
Lab Order:	0605129	Tag Number:	
Project:	Rowe Industries	Collection Date:	5/11/2006
Lab ID:	0605129-02C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.121	0.0200		mg/L	1	5/16/2006 12:50:18 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605129
Project: Rowe Industries
Lab ID: 0605129-03A

Client Sample ID: WQ051106:810 NP2-10
Tag Number:
Collection Date: 5/11/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
2-Butanone	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
2-Hexanone	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Acetone	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Benzene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Bromobenzene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Bromochloromethane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Bromodichloromethane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Bromoform	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Bromomethane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Carbon disulfide	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Chlorobenzene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605129
Project: Rowe Industries
Lab ID: 0605129-03A

Client Sample ID: WQ051106:810 NP2-10
Tag Number:
Collection Date: 5/11/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11						
		SW8260B		SW5030A		Analyst: MMR
Chloroethane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Chloroform	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Chloromethane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Dibromochloromethane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Dibromomethane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Ethylbenzene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Isopropylbenzene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
m,p-Xylene	U	2.0		µg/L	1	5/16/2006 7:34:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Methylene chloride	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Naphthalene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
n-Butylbenzene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
n-Propylbenzene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
o-Xylene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Styrene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Tetrachloroethene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Toluene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Trichloroethene	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Vinyl acetate	U	1.0		µg/L	1	5/16/2006 7:34:00 PM
Vinyl chloride	U	1.0		µg/L	1	5/16/2006 7:34:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605129
Project: Rowe Industries
Lab ID: 0605129-03B

Client Sample ID: WQ051106:810 NP2-10
Tag Number:
Collection Date: 5/11/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	46.8	0.0200		mg/L	1	5/16/2006 12:57:07 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605129
Project: Rowe Industries
Lab ID: 0605129-03C

Client Sample ID: WQ051106:810 NP2-10
Tag Number:
Collection Date: 5/11/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.544	0.0200		mg/L	1	5/16/2006 12:54:44 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	168	1.00		mg/L	1	5/15/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Wednesday, May 24, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484
TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0605205

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 5/19/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,


Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 24-May-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0605205

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0605205-01A	WQ051706:930 NP2-6		5/17/2006	5/19/2006
0605205-01B	WQ051706:930 NP2-6		5/17/2006	5/19/2006
0605205-01C	WQ051706:930 NP2-6		5/17/2006	5/19/2006
0605205-02A	WQ051706:835 NP2-7		5/17/2006	5/19/2006
0605205-02B	WQ051706:835 NP2-7		5/17/2006	5/19/2006
0605205-02C	WQ051706:835 NP2-7		5/17/2006	5/19/2006
0605205-03A	WQ051706:940 NP2-10		5/17/2006	5/19/2006
0605205-03B	WQ051706:940 NP2-10		5/17/2006	5/19/2006
0605205-03C	WQ051706:940 NP2-10		5/17/2006	5/19/2006

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 24-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605205
Project: Rowe Industries
Lab ID: 0605205-01A

Client Sample ID: WQ051706:930 NP2-6
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
2-Butanone	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
2-Hexanone	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Acetone	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Benzene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Bromobenzene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Bromochloromethane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Bromodichloromethane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Bromoform	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Bromomethane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Carbon disulfide	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Chlorobenzene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM

Qualifiers: B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits
X Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 24-May-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ051706:930 NP2-6
Lab Order:	0605205	Tag Number:	
Project:	Rowe Industries	Collection Date:	5/17/2006
Lab ID:	0605205-01A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
Chloroethane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Chloroform	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Chloromethane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Dibromochloromethane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Dibromomethane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Ethylbenzene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Isopropylbenzene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
m,p-Xylene	U	2.0		µg/L	1	5/22/2006 12:03:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Methylene chloride	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Naphthalene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
n-Butylbenzene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
n-Propylbenzene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
o-Xylene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Styrene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Tetrachloroethene	23	1.0		µg/L	1	5/22/2006 12:03:00 PM
Toluene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Trichloroethene	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Vinyl acetate	U	1.0		µg/L	1	5/22/2006 12:03:00 PM
Vinyl chloride	U	1.0		µg/L	1	5/22/2006 12:03:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.**Date:** 24-May-06**CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** WQ051706:930 NP2-6**Lab Order:** 0605205**Tag Number:****Project:** Rowe Industries**Collection Date:** 5/17/2006**Lab ID:** 0605205-01B**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	4.45	0.0200		mg/L	1	5/23/2006 1:11:47 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 24-May-06

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** WQ051706:930 NP2-6**Lab Order:** 0605205**Tag Number:****Project:** Rowe Industries**Collection Date:** 5/17/2006**Lab ID:** 0605205-01C**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.0300	0.0200		mg/L	1	5/23/2006 1:09:54 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 24-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605205
Project: Rowe Industries
Lab ID: 0605205-02A

Client Sample ID: WQ051706:835 NP2-7
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
2-Butanone	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
2-Hexanone	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Acetone	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Benzene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Bromobenzene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Bromochloromethane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Bromodichloromethane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Bromoform	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Bromomethane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Carbon disulfide	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Chlorobenzene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 24-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605205
Project: Rowe Industries
Lab ID: 0605205-02A

Client Sample ID: WQ051706:835 NP2-7
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
Chloroethane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Chloroform	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Chloromethane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Dibromochloromethane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Dibromomethane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Ethylbenzene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Isopropylbenzene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
m,p-Xylene	U	2.0		µg/L	1	5/22/2006 2:04:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Methylene chloride	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Naphthalene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
n-Butylbenzene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
n-Propylbenzene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
o-Xylene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Styrene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Tetrachloroethene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Toluene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Trichloroethene	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Vinyl acetate	U	1.0		µg/L	1	5/22/2006 2:04:00 PM
Vinyl chloride	U	1.0		µg/L	1	5/22/2006 2:04:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 24-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605205
Project: Rowe Industries
Lab ID: 0605205-02B

Client Sample ID: WQ051706:835 NP2-7
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	4.69	0.0200		mg/L	1	5/23/2006 1:16:21 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.**Date:** 24-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605205
Project: Rowe Industries
Lab ID: 0605205-02C

Client Sample ID: WQ051706:835 NP2-7
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.0560	0.0200		mg/L	1	5/23/2006 1:14:24 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 24-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605205
Project: Rowe Industries
Lab ID: 0605205-03A

Client Sample ID: WQ051706:940 NP2-10
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
2-Butanone	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
2-Hexanone	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Acetone	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Benzene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Bromobenzene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Bromochloromethane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Bromodichloromethane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Bromoform	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Bromomethane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Carbon disulfide	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Chlorobenzene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 24-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605205
Project: Rowe Industries
Lab ID: 0605205-03A

Client Sample ID: WQ051706:940 NP2-10
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
Chloroethane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Chloroform	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Chloromethane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Dibromochloromethane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Dibromomethane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Ethylbenzene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Isopropylbenzene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
m,p-Xylene	U	2.0		µg/L	1	5/22/2006 2:42:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Methylene chloride	17	1.0	B	µg/L	1	5/22/2006 2:42:00 PM
Naphthalene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
n-Butylbenzene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
n-Propylbenzene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
o-Xylene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Styrene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Tetrachloroethene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Toluene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Trichloroethene	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Vinyl acetate	U	1.0		µg/L	1	5/22/2006 2:42:00 PM
Vinyl chloride	U	1.0		µg/L	1	5/22/2006 2:42:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 24-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605205
Project: Rowe Industries
Lab ID: 0605205-03B

Client Sample ID: WQ051706:940 NP2-10
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	4.00	0.0200		mg/L	1	5/23/2006 1:29:40 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.


Date: 24-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605205
Project: Rowe Industries
Lab ID: 0605205-03C

Client Sample ID: WQ051706:940 NP2-10
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.0680	0.0200		mg/L	1	5/23/2006 1:18:48 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	104	1.00		mg/L	1	5/23/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

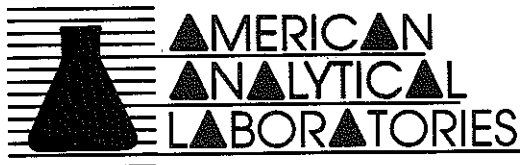

NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Monday, June 05, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0605298

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 5/31/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,


Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 05-Jun-06

CLIENT: Leggette Brashears & Graham Inc.**Project:** Rowe Industries**Lab Order:** 0605298**Work Order Sample Summary**

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0605298-01A	WQ052406:800 NP2-6	2548	5/24/2006	5/31/2006
0605298-01B	WQ052406:800 NP2-6	2548	5/24/2006	5/31/2006
0605298-01C	WQ052406:800 NP2-6	2548	5/24/2006	5/31/2006
0605298-02A	WQ052406:805 NP2-7	2548	5/24/2006	5/31/2006
0605298-02B	WQ052406:805 NP2-7	2548	5/24/2006	5/31/2006
0605298-02C	WQ052406:805 NP2-7	2548	5/24/2006	5/31/2006
0605298-03A	WQ052406:810 NP2-10	2548	5/24/2006	5/31/2006
0605298-03B	WQ052406:810 NP2-10	2548	5/24/2006	5/31/2006
0605298-03C	WQ052406:810 NP2-10	2548	5/24/2006	5/31/2006

56 TOLEDO STREET • FARMINGDALE, NEW YORK 11735
(631) 454-6100 • FAX (631) 454-8027

TAG # / COC

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100

FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 05-Jun-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605298
Project: Rowe Industries
Lab ID: 0605298-01A

Client Sample ID: WQ052406:800 NP2-6
Tag Number: 2548
Collection Date: 5/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
2-Butanone	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
2-Hexanone	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Acetone	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Benzene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Bromobenzene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Bromochloromethane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Bromodichloromethane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Bromoform	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Bromomethane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Carbon disulfide	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Chlorobenzene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 05-Jun-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605298
Project: Rowe Industries
Lab ID: 0605298-01A

Client Sample ID: WQ052406:800 NP2-6
Tag Number: 2548
Collection Date: 5/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
Chloroethane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Chloroform	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Chloromethane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Dibromochloromethane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Dibromomethane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Ethylbenzene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Isopropylbenzene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
m,p-Xylene	U	2.0		µg/L	1	6/1/2006 1:45:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Methylene chloride	9.5	1.0	B	µg/L	1	6/1/2006 1:45:00 AM
Naphthalene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
n-Butylbenzene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
n-Propylbenzene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
o-Xylene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Styrene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Tetrachloroethene	28	1.0		µg/L	1	6/1/2006 1:45:00 AM
Toluene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Trichloroethene	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Vinyl acetate	U	1.0		µg/L	1	6/1/2006 1:45:00 AM
Vinyl chloride	U	1.0		µg/L	1	6/1/2006 1:45:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 05-Jun-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605298
Project: Rowe Industries
Lab ID: 0605298-01B

Client Sample ID: WQ052406:800 NP2-6
Tag Number: 2548
Collection Date: 5/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: BK
Iron	2.16	0.0200		mg/L	1	6/2/2006 1:02:13 PM

Qualifiers:

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits
X Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 05-Jun-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605298
Project: Rowe Industries
Lab ID: 0605298-01C

Client Sample ID: WQ052406:800 NP2-6
Tag Number: 2548
Collection Date: 5/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst: BK
Iron	0.0270	0.0200		mg/L	1	6/2/2006 1:00:10 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 05-Jun-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605298
Project: Rowe Industries
Lab ID: 0605298-02A

Client Sample ID: WQ052406:805 NP2-7
Tag Number: 2548
Collection Date: 5/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
2-Butanone	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
2-Hexanone	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Acetone	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Benzene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Bromobenzene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Bromochloromethane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Bromodichloromethane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Bromoform	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Bromomethane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Carbon disulfide	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Chlorobenzene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM

Qualifiers: B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits
X Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 05-Jun-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605298
Project: Rowe Industries
Lab ID: 0605298-02A

Client Sample ID: WQ052406:805 NP2-7
Tag Number: 2548
Collection Date: 5/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
Chloroethane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Chloroform	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Chloromethane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Dibromochloromethane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Dibromomethane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Ethylbenzene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Isopropylbenzene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
m,p-Xylene	U	2.0		µg/L	1	6/1/2006 2:23:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Methylene chloride	9.6	1.0	B	µg/L	1	6/1/2006 2:23:00 AM
Naphthalene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
n-Butylbenzene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
n-Propylbenzene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
o-Xylene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Styrene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Tetrachloroethene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Toluene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Trichloroethene	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Vinyl acetate	U	1.0		µg/L	1	6/1/2006 2:23:00 AM
Vinyl chloride	U	1.0		µg/L	1	6/1/2006 2:23:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 05-Jun-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605298
Project: Rowe Industries
Lab ID: 0605298-02B

Client Sample ID: WQ052406:805 NP2-7
Tag Number: 2548
Collection Date: 5/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: BK
Iron	2.22	0.0200		mg/L	1	6/2/2006 1:06:19 PM

Qualifiers:

B	Analyte detected in the associated Method Blank	E	Value above quantitation range
H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 05-Jun-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605298
Project: Rowe Industries
Lab ID: 0605298-02C

Client Sample ID: WQ052406:805 NP2-7
Tag Number: 2548
Collection Date: 5/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON			E200.7			Analyst: BK
Iron	0.0600	0.0200		mg/L	1	6/2/2006 1:04:15 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 05-Jun-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605298
Project: Rowe Industries
Lab ID: 0605298-03A

Client Sample ID: WQ052406:810 NP2-10
Tag Number: 2548
Collection Date: 5/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
2-Butanone	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
2-Hexanone	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Acetone	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Benzene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Bromobenzene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Bromochloromethane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Bromodichloromethane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Bromoform	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Bromomethane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Carbon disulfide	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Chlorobenzene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 05-Jun-06

CLIENT: Leggett Brashears & Graham Inc.
Lab Order: 0605298
Project: Rowe Industries
Lab ID: 0605298-03A

Client Sample ID: WQ052406:810 NP2-10
Tag Number: 2548
Collection Date: 5/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
Chloroethane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Chloroform	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Chloromethane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Dibromochloromethane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Dibromomethane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Ethylbenzene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Isopropylbenzene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
m,p-Xylene	U	2.0		µg/L	1	6/1/2006 3:01:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Methylene chloride	12 B	1.0		µg/L	1	6/1/2006 3:01:00 AM
Naphthalene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
n-Butylbenzene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
n-Propylbenzene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
o-Xylene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Styrene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Tetrachloroethene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Toluene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Trichloroethene	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Vinyl acetate	U	1.0		µg/L	1	6/1/2006 3:01:00 AM
Vinyl chloride	U	1.0		µg/L	1	6/1/2006 3:01:00 AM

Handwritten signature/initials

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 05-Jun-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ052406:810 NP2-10
Lab Order:	0605298	Tag Number:	2548
Project:	Rowe Industries	Collection Date:	5/24/2006
Lab ID:	0605298-03B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: BK
Iron	3.28	0.0200		mg/L	1	6/2/2006 1:10:21 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level


American Analytical Laboratories, LLC.

Date: 05-Jun-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ052406:810 NP2-10
Lab Order:	0605298	Tag Number:	2548
Project:	Rowe Industries	Collection Date:	5/24/2006
Lab ID:	0605298-03C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst: BK
Iron	0.125	0.0200		mg/L	1	6/2/2006 1:08:21 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	305	1.00	H	mg/L	1	6/1/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

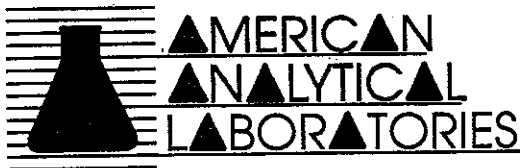

NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Wednesday, June 07, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484
TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe

Order No.: 0606034

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 6/2/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

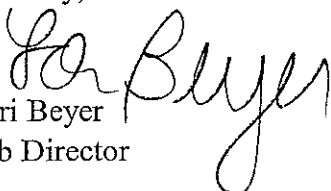
Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 07-Jun-06

CLIENT: Leggette Brashears & Graham Inc.**Project:** Rowe**Lab Order:** 0606034**Work Order Sample Summary**

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0606034-01A	WQ053006:800 NP2-6	2597	5/30/2006	6/2/2006
0606034-01B	WQ053006:800 NP2-6	2597	5/30/2006	6/2/2006
0606034-01C	WQ053006:800 NP2-6	2597	5/30/2006	6/2/2006
0606034-02A	WQ053006:805 NP2-7	2597	5/30/2006	6/2/2006
0606034-02B	WQ053006:805 NP2-7	2597	5/30/2006	6/2/2006
0606034-02C	WQ053006:805 NP2-7	2597	5/30/2006	6/2/2006
0606034-03A	WQ053006:810 NP2-10	2597	5/30/2006	6/2/2006
0606034-03B	WQ053006:810 NP2-10	2597	5/30/2006	6/2/2006
0606034-03C	WQ053006:810 NP2-10	2597	5/30/2006	6/2/2006

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100

FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 07-Jun-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0606034
Project: Rowe
Lab ID: 0606034-01A

Client Sample ID: WQ053006:800 NP2-6
Tag Number: 2597
Collection Date: 5/30/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
2-Butanone	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
2-Hexanone	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Acetone	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Benzene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Bromobenzene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Bromochloromethane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Bromodichloromethane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Bromoform	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Bromomethane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Carbon disulfide	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Chlorobenzene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 07-Jun-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0606034
Project: Rowe
Lab ID: 0606034-01A

Client Sample ID: WQ053006:800 NP2-6
Tag Number: 2597
Collection Date: 5/30/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Chloroform	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Chloromethane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Dibromochloromethane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Dibromomethane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Ethylbenzene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Isopropylbenzene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
m,p-Xylene	U	2.0		µg/L	1	6/5/2006 12:09:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Methylene chloride	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Naphthalene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
n-Butylbenzene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
n-Propylbenzene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
o-Xylene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Styrene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Tetrachloroethene	18	1.0		µg/L	1	6/5/2006 12:09:00 PM
Toluene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Trichloroethene	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Vinyl acetate	U	1.0		µg/L	1	6/5/2006 12:09:00 PM
Vinyl chloride	U	1.0		µg/L	1	6/5/2006 12:09:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 07-Jun-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0606034
Project: Rowe
Lab ID: 0606034-01B

Client Sample ID: WQ053006:800 NP2-6
Tag Number: 2597
Collection Date: 5/30/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	3.77	0.0200		mg/L	1	6/6/2006 1:25:58 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.**Date:** 07-Jun-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0606034
Project: Rowe
Lab ID: 0606034-01C

Client Sample ID: WQ053006:800 NP2-6
Tag Number: 2597
Collection Date: 5/30/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.0790	0.0200		mg/L	1	6/6/2006 1:23:56 PM

Qualifiers:

B	Analyte detected in the associated Method Blank	E	Value above quantitation range
H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 07-Jun-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0606034
Project: Rowe
Lab ID: 0606034-02A

Client Sample ID: WQ053006:805 NP2-7
Tag Number: 2597
Collection Date: 5/30/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
2-Butanone	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
2-Hexanone	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Acetone	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Benzene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Bromobenzene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Bromochloromethane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Bromodichloromethane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Bromoform	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Bromomethane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Carbon disulfide	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Chlorobenzene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 07-Jun-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0606034
Project: Rowe
Lab ID: 0606034-02A

Client Sample ID: WQ053006:805 NP2-7
Tag Number: 2597
Collection Date: 5/30/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Chloroform	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Chloromethane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Dibromochloromethane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Dibromomethane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Ethylbenzene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Isopropylbenzene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
m,p-Xylene	U	2.0		µg/L	1	6/5/2006 2:01:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Methylene chloride	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Naphthalene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
n-Butylbenzene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
n-Propylbenzene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
o-Xylene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Styrene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Tetrachloroethene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Toluene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Trichloroethene	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Vinyl acetate	U	1.0		µg/L	1	6/5/2006 2:01:00 PM
Vinyl chloride	U	1.0		µg/L	1	6/5/2006 2:01:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.**Date:** 07-Jun-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0606034
Project: Rowe
Lab ID: 0606034-02B

Client Sample ID: WQ053006:805 NP2-7
Tag Number: 2597
Collection Date: 5/30/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	1.17	0.0200		mg/L	1	6/6/2006 1:31:02 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 07-Jun-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0606034
Project: Rowe
Lab ID: 0606034-02C

Client Sample ID: WQ053006:805 NP2-7
Tag Number: 2597
Collection Date: 5/30/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.0600	0.0200		mg/L	1	6/6/2006 1:28:48 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 07-Jun-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0606034
Project: Rowe
Lab ID: 0606034-03A

Client Sample ID: WQ053006:810 NP2-10
Tag Number: 2597
Collection Date: 5/30/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
2-Butanone	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
2-Hexanone	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Acetone	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Benzene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Bromobenzene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Bromochloromethane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Bromodichloromethane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Bromoform	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Bromomethane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Carbon disulfide	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Chlorobenzene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 07-Jun-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0606034
Project: Rowe
Lab ID: 0606034-03A

Client Sample ID: WQ053006:810 NP2-10
Tag Number: 2597
Collection Date: 5/30/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Chloroform	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Chloromethane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Dibromochloromethane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Dibromomethane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Ethylbenzene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Isopropylbenzene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
m,p-Xylene	U	2.0		µg/L	1	6/5/2006 2:39:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Methylene chloride	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Naphthalene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
n-Butylbenzene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
n-Propylbenzene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
o-Xylene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Styrene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Tetrachloroethene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Toluene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Trichloroethene	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Vinyl acetate	U	1.0		µg/L	1	6/5/2006 2:39:00 PM
Vinyl chloride	U	1.0		µg/L	1	6/5/2006 2:39:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.**Date:** 07-Jun-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0606034
Project: Rowe
Lab ID: 0606034-03B

Client Sample ID: WQ053006:810 NP2-10
Tag Number: 2597
Collection Date: 5/30/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	1.04	0.0200		mg/L	1	6/6/2006 1:35:27 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level


American Analytical Laboratories, LLC.

Date: 07-Jun-06

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** WQ053006:810 NP2-10**Lab Order:** 0606034**Tag Number:** 2597**Project:** Rowe**Collection Date:** 5/30/2006**Lab ID:** 0606034-03C**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.0630	0.0200		mg/L	1	6/6/2006 1:33:12 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	72.0	1.00		mg/L	1	6/5/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

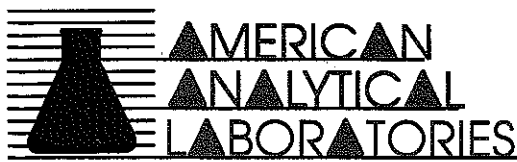

NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Thursday, May 25, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484
TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe

Order No.: 0605204

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 8 sample(s) on 5/19/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

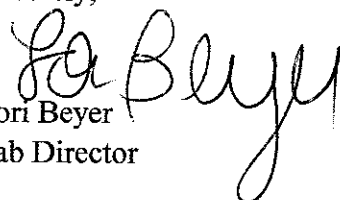
Lori Beyer
Lab Director

American Analytical Laboratories, LLC.**Date:** 25-May-06**CLIENT:** Leggette Brashears & Graham Inc.**Project:** Rowe**Lab Order:** 0605204**Work Order Sample Summary**

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0605204-01A	GWQ051706:800 NP1-1-2		5/17/2006	5/19/2006
0605204-01B	GWQ051706:800 NP1-1-2		5/17/2006	5/19/2006
0605204-01C	GWQ051706:800 NP1-1-2		5/17/2006	5/19/2006
0605204-01D	GWQ051706:800 NP1-1-2		5/17/2006	5/19/2006
0605204-02A	GWQ051706:810 NP1-1-3		5/17/2006	5/19/2006
0605204-02B	GWQ051706:810 NP1-1-3		5/17/2006	5/19/2006
0605204-02C	GWQ051706:810 NP1-1-3		5/17/2006	5/19/2006
0605204-02D	GWQ051706:810 NP1-1-3		5/17/2006	5/19/2006
0605204-03A	GWQ051706:820 NP1-1-4		5/17/2006	5/19/2006
0605204-03B	GWQ051706:820 NP1-1-4		5/17/2006	5/19/2006
0605204-03C	GWQ051706:820 NP1-1-4		5/17/2006	5/19/2006
0605204-03D	GWQ051706:820 NP1-1-4		5/17/2006	5/19/2006
0605204-04A	GWQ051706:830 NP1-1-5		5/17/2006	5/19/2006
0605204-04B	GWQ051706:830 NP1-1-5		5/17/2006	5/19/2006
0605204-04C	GWQ051706:830 NP1-1-5		5/17/2006	5/19/2006
0605204-04D	GWQ051706:830 NP1-1-5		5/17/2006	5/19/2006
0605204-05A	GWQ051706:840 NP1-1-6		5/17/2006	5/19/2006
0605204-05B	GWQ051706:840 NP1-1-6		5/17/2006	5/19/2006
0605204-05C	GWQ051706:840 NP1-1-6		5/17/2006	5/19/2006
0605204-05D	GWQ051706:840 NP1-1-6		5/17/2006	5/19/2006
0605204-06A	GWQ051706:850 NP1-1-7		5/17/2006	5/19/2006
0605204-06B	GWQ051706:850 NP1-1-7		5/17/2006	5/19/2006
0605204-06C	GWQ051706:850 NP1-1-7		5/17/2006	5/19/2006
0605204-06D	GWQ051706:850 NP1-1-7		5/17/2006	5/19/2006
0605204-07A	GWQ051706:900 NP1-1-8		5/17/2006	5/19/2006
0605204-07B	GWQ051706:900 NP1-1-8		5/17/2006	5/19/2006
0605204-07C	GWQ051706:900 NP1-1-8		5/17/2006	5/19/2006
0605204-07D	GWQ051706:900 NP1-1-8		5/17/2006	5/19/2006
0605204-08A	GWQ051706:910 NP1-1-9		5/17/2006	5/19/2006
0605204-08B	GWQ051706:910 NP1-1-9		5/17/2006	5/19/2006
0605204-08C	GWQ051706:910 NP1-1-9		5/17/2006	5/19/2006
0605204-08D	GWQ051706:910 NP1-1-9		5/17/2006	5/19/2006



56 TOLEDO STREET • FARMINGDALE, NEW YORK 11735
(631) 454-6100 • FAX (631) 454-8027

NYSDOH EL/ 11418
CTDOH PH- J5
NJDEP NY050
PADEP 68-573

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

CLIENT NAME/ADDRESS L.B.G. 4 Rosewood Dr. Shelton, CT 06484		CONTACT: Mark Goldberg		SAMPLER (SIGNATURE) <i>[Signature]</i>	DATE 5-18-06	TIME 1:50	SAMPLE(S) SEALED YES/NO YES/NO
PROJECT LOCATION: Rowe		ANALYSIS REQUIRED 8260 MTBE Free 113 Tot. + Diss. Re Turb.idity Hardness TDS		SAMPLER NAME (PRINT) Robert D'Amico		CORRECT CONTAINER(S) YES/NO YES/NO	
LABORATORY ID #	MATRIX	TYPE	PRES.	SAMPLE # - LOCATION	FOR METHANOL PRESERVED SAMPLES (VOLATILE VIAL #)		
0605204-11A2	2A2C2	G	NP1-1-2	810 NP1-1-3			
3A2C2	4A2C2		820 NP1-1-4	830 NP1-1-5			
5A2C2	6A2C2		840 NP1-1-6	850 NP1-1-7			
7A2C2	8A2C2		900 NP1-1-8	910 NP1-1-9			

COOLER TEMPERATURE:

COMMENTS / INSTRUCTIONS

TURNAROUND REQUIRED:

MATRIX S=SOIL; L=LIQUID; SL=SLUDGE; A-AIR; W=WIFE; P=PAINT CHIPS; B=BULK MATERIAL

TYPE G=GRAB; C=COMPOSITE, SS=SPLIT SPOON

NORMAL STAT BY

RELINQUISHED BY (SIGNATURE)

DATE
5-18-06
TIME
17:00

PRINTED NAME
Rob D'Amico

RECEIVED BY LAB (SIGNATURE)

DATE
5/18/06

PRINTED NAME
Robert D'Amico

RELINQUISHED BY (SIGNATURE)

DATE
TIME

PRINTED NAME

RECEIVED BY LAB (SIGNATURE)

DATE
TIME

PRINTED NAME

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-01A

Client Sample ID: GWQ051706:800 NP1-1-2
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
2-Butanone	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
2-Hexanone	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Acetone	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Benzene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Bromobenzene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Bromochloromethane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Bromodichloromethane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Bromoform	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Bromomethane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Carbon disulfide	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Chlorobenzene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-01A

Client Sample ID: GWQ051706:800 NP1-1-2
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
Chloroethane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Chloroform	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Chloromethane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
cis-1,2-Dichloroethene	14	1.0		µg/L	1	5/20/2006 12:06:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Dibromochloromethane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Dibromomethane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Ethylbenzene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Isopropylbenzene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
m,p-Xylene	U	2.0		µg/L	1	5/20/2006 12:06:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Methylene chloride	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Naphthalene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
n-Butylbenzene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
n-Propylbenzene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
o-Xylene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Styrene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Tetrachloroethene	19	1.0		µg/L	1	5/20/2006 12:06:00 PM
Toluene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Trichloroethene	5.1	1.0		µg/L	1	5/20/2006 12:06:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Vinyl acetate	U	1.0		µg/L	1	5/20/2006 12:06:00 PM
Vinyl chloride	U	1.0		µg/L	1	5/20/2006 12:06:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-01B

Client Sample ID: GWQ051706:800 NP1-1-2
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON, MANGANESE		E200.7		SW3010A		Analyst: JP
Iron	5.95	0.0200		mg/L	1	5/23/2006 11:34:01 AM
Manganese	0.726	0.0200		mg/L	1	5/23/2006 11:34:01 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-01C

Client Sample ID: GWQ051706:800 NP1-1-2
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON, MANGANESE		E200.7		SW3005A		Analyst: JP
Iron	0.0630	0.0200		mg/L	1	5/23/2006 11:31:38 AM
Manganese	0.709	0.0200		mg/L	1	5/23/2006 11:31:38 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-01D

Client Sample ID: GWQ051706:800 NP1-1-2
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS Hardness, Calcium/Magnesium (As CaCO ₃)	41.7	M2340 B 1.00		mg/L	1	Analyst: JP 5/24/2006
TURBIDITY Turbidity	3.70	E180.1 1.00		NTU	1	Analyst: KK 5/19/2006
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	108	E160.1 1.00		mg/L	1	Analyst: VP 5/23/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-02A

Client Sample ID: GWQ051706:810 NP1-1-3
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
2-Butanone	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
2-Hexanone	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Acetone	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Benzene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Bromobenzene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Bromochloromethane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Bromodichloromethane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Bromoform	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Bromomethane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Carbon disulfide	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Chlorobenzene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-02A

Client Sample ID: GWQ051706:810 NP1-1-3
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
Chloroethane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Chloroform	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Chloromethane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Dibromochloromethane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Dibromomethane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Ethylbenzene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Isopropylbenzene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
m,p-Xylene	U	2.0		µg/L	1	5/20/2006 12:50:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Methylene chloride	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Naphthalene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
n-Butylbenzene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
n-Propylbenzene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
o-Xylene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Styrene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Tetrachloroethene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Toluene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Trichloroethene	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Vinyl acetate	U	1.0		µg/L	1	5/20/2006 12:50:00 PM
Vinyl chloride	U	1.0		µg/L	1	5/20/2006 12:50:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-02B

Client Sample ID: GWQ051706:810 NP1-1-3
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON, MANGANESE		E200.7		SW3010A		Analyst: JP
Iron	1.06	0.0200		mg/L	1	5/23/2006 11:41:29 AM
Manganese	0.241	0.0200		mg/L	1	5/23/2006 11:41:29 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-02C

Client Sample ID: GWQ051706:810 NP1-1-3
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON, MANGANESE		E200.7		SW3005A		Analyst: JP
Iron	0.353	0.0200		mg/L	1	5/23/2006 11:39:42 AM
Manganese	0.238	0.0200		mg/L	1	5/23/2006 11:39:42 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ051706:810 NP1-1-3
Lab Order:	0605204	Tag Number:	
Project:	Rowe	Collection Date:	5/17/2006
Lab ID:	0605204-02D	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	49.5	1.00		mg/L	1	5/24/2006
TURBIDITY		E180.1				Analyst: KK
Turbidity	3.50	1.00		NTU	1	5/19/2006
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	102	1.00		mg/L	1	5/23/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-03A

Client Sample ID: GWQ051706:820 NP1-1-4
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
2-Butanone	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
2-Hexanone	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Acetone	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Benzene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Bromobenzene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Bromochloromethane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Bromodichloromethane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Bromoform	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Bromomethane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Carbon disulfide	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Chlorobenzene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-03A

Client Sample ID: GWQ051706:820 NP1-1-4
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
Chloroethane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Chloroform	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Chloromethane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Dibromochloromethane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Dibromomethane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Ethylbenzene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Isopropylbenzene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
m,p-Xylene	U	2.0		µg/L	1	5/20/2006 1:33:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Methylene chloride	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Naphthalene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
n-Butylbenzene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
n-Propylbenzene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
o-Xylene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Styrene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Tetrachloroethene	26	1.0		µg/L	1	5/20/2006 1:33:00 PM
Toluene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Trichloroethene	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Vinyl acetate	U	1.0		µg/L	1	5/20/2006 1:33:00 PM
Vinyl chloride	U	1.0		µg/L	1	5/20/2006 1:33:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-03B

Client Sample ID: GWQ051706:820 NP1-1-4
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON, MANGANESE		E200.7		SW3010A		Analyst: JP
Iron	3.15	0.0200		mg/L	1	5/23/2006 11:47:36 AM
Manganese	1.34	0.0200		mg/L	1	5/23/2006 11:47:36 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-03C

Client Sample ID: GWQ051706:820 NP1-1-4
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON, MANGANESE		E200.7		SW3005A		Analyst: JP
Iron	0.109	0.0200		mg/L	1	5/23/2006 11:45:44 AM
Manganese	1.37	0.0200		mg/L	1	5/23/2006 11:45:44 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-03D

Client Sample ID: GWQ051706:820 NP1-1-4
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	34.2	1.00		mg/L	1	5/24/2006
TURBIDITY		E180.1				Analyst: KK
Turbidity	7.10	1.00		NTU	1	5/19/2006
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	102	1.00		mg/L	1	5/23/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-04A

Client Sample ID: GWQ051706:830 NP1-1-5
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
2-Butanone	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
2-Hexanone	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Acetone	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Benzene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Bromobenzene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Bromochloromethane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Bromodichloromethane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Bromoform	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Bromomethane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Carbon disulfide	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Chlorobenzene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-04A

Client Sample ID: GWQ051706:830 NP1-1-5
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
Chloroethane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Chloroform	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Chloromethane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Dibromochloromethane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Dibromomethane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Ethylbenzene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Isopropylbenzene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
m,p-Xylene	U	2.0		µg/L	1	5/20/2006 2:16:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Methylene chloride	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Naphthalene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
n-Butylbenzene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
n-Propylbenzene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
o-Xylene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Styrene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Tetrachloroethene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Toluene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Trichloroethene	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Vinyl acetate	U	1.0		µg/L	1	5/20/2006 2:16:00 PM
Vinyl chloride	U	1.0		µg/L	1	5/20/2006 2:16:00 PM

Qualifiers:

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits
X Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ051706:830 NP1-1-5
Lab Order:	0605204	Tag Number:	
Project:	Rowe	Collection Date:	5/17/2006
Lab ID:	0605204-04B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON, MANGANESE		E200.7		SW3010A		Analyst: JP
Iron	0.0160	0.0200	J	mg/L	1	5/23/2006 12:23:11 PM
Manganese	U	0.0200		mg/L	1	5/23/2006 12:23:11 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-04C

Client Sample ID: GWQ051706:830 NP1-1-5
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON, MANGANESE		E200.7		SW3005A		Analyst: JP
Iron	U	0.0200		mg/L	1	5/23/2006 12:13:49 PM
Manganese	U	0.0200		mg/L	1	5/23/2006 12:13:49 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-04D

Client Sample ID: GWQ051706:830 NP1-1-5
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	31.2	1.00		mg/L	1	5/24/2006
TURBIDITY		E180.1				Analyst: KK
Turbidity	U	1.00		NTU	1	5/19/2006
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	120	1.00		mg/L	1	5/23/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-05A

Client Sample ID: GWQ051706:840 NP1-1-6
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
1,1,1-Trichloroethane	18	1.0		µg/L	1	5/20/2006 3:02:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
2-Butanone	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
2-Hexanone	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Acetone	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Benzene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Bromobenzene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Bromochloromethane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Bromodichloromethane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Bromoform	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Bromomethane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Carbon disulfide	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Chlorobenzene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-05A

Client Sample ID: GWQ051706:840 NP1-1-6
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
Chloroethane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Chloroform	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Chloromethane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Dibromochloromethane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Dibromomethane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Ethylbenzene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Isopropylbenzene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
m,p-Xylene	U	2.0		µg/L	1	5/20/2006 3:02:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Methylene chloride	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Naphthalene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
n-Butylbenzene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
n-Propylbenzene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
o-Xylene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Styrene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Tetrachloroethene	68	1.0		µg/L	1	5/20/2006 3:02:00 PM
Toluene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Trichloroethene	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Vinyl acetate	U	1.0		µg/L	1	5/20/2006 3:02:00 PM
Vinyl chloride	U	1.0		µg/L	1	5/20/2006 3:02:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-05B

Client Sample ID: GWQ051706:840 NP1-1-6
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON, MANGANESE		E200.7		SW3010A		Analyst: JP
Iron	0.170	0.0200		mg/L	1	5/23/2006 12:28:19 PM
Manganese	0.189	0.0200		mg/L	1	5/23/2006 12:28:19 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-05C

Client Sample ID: GWQ051706:840 NP1-1-6
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON, MANGANESE		E200.7		SW3005A		Analyst: JP
Iron	0.0190	0.0200	J	mg/L	1	5/23/2006 12:26:02 PM
Manganese	0.191	0.0200		mg/L	1	5/23/2006 12:26:02 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ051706:840 NP1-1-6
Lab Order:	0605204	Tag Number:	
Project:	Rowe	Collection Date:	5/17/2006
Lab ID:	0605204-05D	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	31.9	1.00		mg/L	1	5/24/2006
TURBIDITY		E180.1				Analyst: KK
Turbidity	U	1.00		NTU	1	5/19/2006
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	116	1.00		mg/L	1	5/23/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-06A

Client Sample ID: GWQ051706:850 NP1-1-7
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
2-Butanone	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
2-Hexanone	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Acetone	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Benzene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Bromobenzene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Bromochloromethane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Bromodichloromethane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Bromoform	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Bromomethane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Carbon disulfide	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Chlorobenzene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-06A

Client Sample ID: GWQ051706:850 NP1-1-7
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
Chloroethane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Chloroform	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Chloromethane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Dibromochloromethane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Dibromomethane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Ethylbenzene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Isopropylbenzene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
m,p-Xylene	U	2.0		µg/L	1	5/20/2006 3:44:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Methylene chloride	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Naphthalene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
n-Butylbenzene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
n-Propylbenzene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
o-Xylene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Styrene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Tetrachloroethene	59	1.0		µg/L	1	5/20/2006 3:44:00 PM
Toluene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Trichloroethene	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Vinyl acetate	U	1.0		µg/L	1	5/20/2006 3:44:00 PM
Vinyl chloride	U	1.0		µg/L	1	5/20/2006 3:44:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-06B

Client Sample ID: GWQ051706:850 NP1-1-7
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON, MANGANESE		E200.7		SW3010A		Analyst: JP
Iron	0.126	0.0200		mg/L	1	5/23/2006 12:32:38 PM
Manganese	0.0660	0.0200		mg/L	1	5/23/2006 12:32:38 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-06C

Client Sample ID: GWQ051706:850 NP1-1-7
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON, MANGANESE		E200.7		SW3005A		Analyst: JP
Iron	0.0260	0.0200		mg/L	1	5/23/2006 12:30:30 PM
Manganese	0.0640	0.0200		mg/L	1	5/23/2006 12:30:30 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ051706:850 NP1-1-7
Lab Order:	0605204	Tag Number:	
Project:	Rowe	Collection Date:	5/17/2006
Lab ID:	0605204-06D	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	31.4	1.00		mg/L	1	5/24/2006
TURBIDITY		E180.1				Analyst: KK
Turbidity	U	1.00		NTU	1	5/19/2006
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	96.0	1.00		mg/L	1	5/23/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-07A

Client Sample ID: GWQ051706:900 NP1-1-8
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
2-Butanone	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
2-Hexanone	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Acetone	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Benzene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Bromobenzene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Bromochloromethane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Bromodichloromethane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Bromoform	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Bromomethane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Carbon disulfide	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Chlorobenzene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-07A

Client Sample ID: GWQ051706:900 NP1-1-8
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
Chloroethane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Chloroform	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Chloromethane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Dibromochloromethane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Dibromomethane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Ethylbenzene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Isopropylbenzene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
m,p-Xylene	U	2.0		µg/L	1	5/20/2006 4:29:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Methylene chloride	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Naphthalene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
n-Butylbenzene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
n-Propylbenzene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
o-Xylene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Styrene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Tetrachloroethene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Toluene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Trichloroethene	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Vinyl acetate	U	1.0		µg/L	1	5/20/2006 4:29:00 PM
Vinyl chloride	U	1.0		µg/L	1	5/20/2006 4:29:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-07B

Client Sample ID: GWQ051706:900 NP1-1-8
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON, MANGANESE		E200.7		SW3010A		Analyst: JP
Iron	2.03	0.0200		mg/L	1	5/23/2006 12:37:15 PM
Manganese	0.908	0.0200		mg/L	1	5/23/2006 12:37:15 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-07C

Client Sample ID: GWQ051706:900 NP1-1-8
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON, MANGANESE		E200.7		SW3005A		Analyst: JP
Iron	0.0560	0.0200		mg/L	1	5/23/2006 12:34:53 PM
Manganese	0.908	0.0200		mg/L	1	5/23/2006 12:34:53 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ051706:900 NP1-1-8
Lab Order:	0605204	Tag Number:	
Project:	Rowe	Collection Date:	5/17/2006
Lab ID:	0605204-07D	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS			M2340 B			Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	24.9	1.00		mg/L	1	5/24/2006
TURBIDITY			E180.1			Analyst: KK
Turbidity	3.40	1.00		NTU	1	5/19/2006
TOTAL DISSOLVED SOLIDS			E160.1			Analyst: VP
Total Dissolved Solids (Residue, Filterable)	74.0	1.00		mg/L	1	5/23/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-08A

Client Sample ID: GWQ051706:910 NP1-1-9
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
2-Butanone	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
2-Hexanone	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Acetone	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Benzene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Bromobenzene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Bromochloromethane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Bromodichloromethane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Bromoform	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Bromomethane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Carbon disulfide	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Chlorobenzene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-08A

Client Sample ID: GWQ051706:910 NP1-1-9
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
Chloroethane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Chloroform	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Chloromethane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Dibromochloromethane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Dibromomethane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Ethylbenzene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Isopropylbenzene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
m,p-Xylene	U	2.0		µg/L	1	5/20/2006 5:13:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Methylene chloride	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Naphthalene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
n-Butylbenzene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
n-Propylbenzene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
o-Xylene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Styrene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Tetrachloroethene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Toluene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Trichloroethene	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Vinyl acetate	U	1.0		µg/L	1	5/20/2006 5:13:00 PM
Vinyl chloride	U	1.0		µg/L	1	5/20/2006 5:13:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0605204
Project: Rowe
Lab ID: 0605204-08B

Client Sample ID: GWQ051706:910 NP1-1-9
Tag Number:
Collection Date: 5/17/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON, MANGANESE		E200.7		SW3010A		Analyst: JP
Iron	1.64	0.0200		mg/L	1	5/23/2006 12:42:05 PM
Manganese	0.766	0.0200		mg/L	1	5/23/2006 12:42:05 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ051706:910 NP1-1-9
Lab Order:	0605204	Tag Number:	
Project:	Rowe	Collection Date:	5/17/2006
Lab ID:	0605204-08C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON, MANGANESE		E200.7		SW3005A		Analyst: JP
Iron	0.0540	0.0200		mg/L	1	5/23/2006 12:39:49 PM
Manganese	0.757	0.0200		mg/L	1	5/23/2006 12:39:49 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-May-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ051706:910 NP1-1-9
Lab Order:	0605204	Tag Number:	
Project:	Rowe	Collection Date:	5/17/2006
Lab ID:	0605204-08D	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS		M2340 B				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO ₃)	21.6	1.00		mg/L	1	5/24/2006
TURBIDITY		E180.1				Analyst: KK
Turbidity	7.10	1.00		NTU	1	5/19/2006
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	68.0	1.00		mg/L	1	5/23/2006

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

H6E190106 Analytical Report	1
Sample Receipt Documentation.....	15
Volatiles.....	18
Raw Sample Data	19
Standards Data	88
Raw QC Data	166
Miscellaneous Data	185
Sample Receipt Documentation.....	192
Total Number of Pages	194

SEVERN
TRENT

STL

STL Knoxville
5815 Middlebrook Pike
Knoxville, TN 37921

Tel: 865 291 3000 Fax: 865 584 4315
www.stl-inc.com

ANALYTICAL REPORT

PROJECT NO. ROWE

NABSAG 0401

Lot #: H6E190106

Mark Goldberg

Leggette, Brashears & Graham,
4 Research Drive
Suite #301
Shelton, CT 06484

SEVERN TRENT LABORATORIES, INC.



Scott A. Harris
Project Manager

May 25, 2006

ANALYTICAL METHODS SUMMARY

H6E190106

<u>PARAMETER</u>	<u>ANALYTICAL METHOD</u>
Volatile Organics by T015	EPA-2 TO-15

References:

EPA-2 "Compendium of Methods for the Determination of Toxic
Organic Compounds in Ambient Air", EPA-625/R-96/010b,
January 1999.

SAMPLE SUMMARY**H6E190106**

<u>WO #</u>	<u>SAMPLE#</u>	<u>CLIENT SAMPLE ID</u>	<u>SAMPLED DATE</u>	<u>SAMP TIME</u>
H5QLJ	001	AQ051706:1000 NP4-1	05/17/06	10:00
H5QLK	002	AQ051706:1005 NP4-2	05/17/06	10:05
H5QLL	003	AQ051706:1010 NP4-3	05/17/06	10:10

NOTE (S) :

- The analytical results of the samples listed above are presented on the following pages.
- All calculations are performed before rounding to avoid round-off errors in calculated results.
- Results noted as "ND" were not detected at or above the stated limit.
- This report must not be reproduced, except in full, without the written approval of the laboratory.
- Results for the following parameters are never reported on a dry weight basis: color, corrosivity, density, flashpoint, ignitability, layers, odor, paint filter test, pH, porosity pressure, reactivity, redox potential, specific gravity, spot tests, solids, solubility, temperature, viscosity, and weight.

PROJECT NARRATIVE H6E190106

The results reported herein are applicable to the samples submitted for analysis only.

This report shall not be reproduced except in full, without the written approval of the laboratory.

The original chain of custody documentation is included with this report.

Sample Receipt

There were no problems with the condition of the samples received.

Quality Control

Unless otherwise noted, all holding times and QC criteria were met, and the test results shown in this report meet all applicable NELAC requirements.

Samples were received on 5/19/06 in Tedlar bags and transferred into Summa Canisters within 72 hours of sampling.

STL Knoxville maintains the following certifications, approvals and accreditations: Arkansas DEQ Cert. #05-043-0, California DHS ELAP Cert. #2423, Colorado DPHE, Connecticut DPH Cert. #PH-0223, Florida DOH Cert. #E87177, Georgia DNR Cert. #906 (SDWA, expires 6/24/05), Hawaii DOH, Illinois EPA Cert. #000687, Indiana DOH Cert. #C-TN-02, Iowa DNR Cert. #375, Kansas DHE Cert. #E-10349, Kentucky DEP Lab ID #90101, Louisiana DEQ Cert. #03079, Louisiana DOHH Cert. #LA030024, Maryland DHMH Cert. #277, Massachusetts DEP Cert. #M-TN009, Michigan DEQ Lab ID #9933, New Jersey DEP Cert. #TN001, New York DOH Lab #10781, North Carolina DPH Lab ID #21705, North Carolina DEHNR Cert. #64, Ohio EPA VAP Cert. #CL0059, Oklahoma DEQ ID #9415, Pennsylvania DEP Cert. #68-00576, South Carolina DHEC Lab ID #84001001, Tennessee DOH Lab ID #02014, Utah DOH Cert. # QUAN3, Virginia DGS Lab ID #00165, Washington DOE Lab #C120, West Virginia DEP Cert. #345, Wisconsin DNR Lab ID #998044300, US Army Corps of Engineers, Naval Facilities Engineering Service Center and USDA Soil Permit #S-46424. This list of approvals is subject to change and does not imply that laboratory certification is available for all parameters reported in this environmental sample data report.

Sample Data Summary

Leggette, Brashears & Graham, Inc.
 Client Sample ID: AQ051706:1000 NP4-1
 GC/MS Volatiles

Lot-Sample # H6E190106 - 001

Work Order # H5QLJ1AA

Matrix.....: AIR

Date Sampled...: 5/17/06
 Prep Date.....: 5/22/06
 Prep Batch #....: 6143089
 Dilution Factor.: 5

Date Received..: 5/19/06
 Analysis Date... 5/23/06
 Method.....: TO-15

PARAMETER	RESULTS (ppb(v/v))	REPORTING LIMIT (ppb(v/v))	RESULTS (ug/m3)	REPORTING LIMIT (ug/m3)
Benzene	0.82	1.0	2.6 J	3.2
Bromodichloromethane	ND	1.0	ND	6.7
Bromoform	ND	1.0	ND	10
Bromomethane	ND	1.0	ND	3.9
Carbon disulfide	3.1	2.5	9.7	7.8
Carbon tetrachloride	ND	1.0	ND	6.3
Chlorobenzene	ND	1.0	ND	4.6
Dibromochloromethane	ND	1.0	ND	8.5
Chloroethane	ND	1.0	ND	2.6
Chloroform	0.75	1.0	3.7 J	4.9
Chloromethane	1.3	2.5	2.6 J	5.2
1,1-Dichloroethane	3.3	1.0	13	4.0
1,2-Dichloroethane	ND	1.0	ND	4.0
cis-1,2-Dichloroethene	3.6	1.0	14	4.0
trans-1,2-Dichloroethene	ND	1.0	ND	4.0
1,1-Dichloroethene	0.88	1.0	3.5 J	4.0
1,2-Dichloropropane	ND	1.0	ND	4.6
cis-1,3-Dichloropropene	ND	1.0	ND	4.5
trans-1,3-Dichloropropene	ND	1.0	ND	4.5
Ethylbenzene	0.36	1.0	1.6 J	4.3
Methylene chloride	0.53	2.5	1.9 J B	8.7
Styrene	ND	1.0	ND	4.3
1,1,2,2-Tetrachloroethane	ND	1.0	ND	6.9
Tetrachloroethene	42	1.0	280	6.8
Toluene	2.5	1.0	9.3	3.8
1,1,1-Trichloroethane	8.7	1.0	48	5.5
1,1,2-Trichloroethane	ND	1.0	ND	5.5
Trichloroethene	3.3	1.0	17	5.4
Vinyl chloride	0.43	1.0	1.1 J	2.6
m-Xylene & p-Xylene	0.74	1.0	3.2 J	4.3
o-Xylene	ND	1.0	ND	4.3

SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
1,2-Dichloroethane-d4	113	70 - 130
Toluene-d8	95	70 - 130

Leggette, Brashears & Graham, Inc.
 Client Sample ID: AQ051706:1000 NP4-1
 GC/MS Volatiles

Lot-Sample # H6E190106 - 001	Work Order # H5QLJ1AA	Matrix.....: AIR
SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
4-Bromofluorobenzene	105	70 - 130

Qualifiers

B Method blank contamination. The associated method blank contains the target analyte at a reportable level.
 J Estimated result. Result is less than RL.

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) * Dilution Factor) * (Molecular Weight/24.45)

Leggette, Brashears & Graham, Inc.
 Client Sample ID: AQ051706:1005 NP4-2
 GC/MS Volatiles

Lot-Sample # H6E190106 - 002 Work Order # H5QLK1AA Matrix.....: AIR

Date Sampled...: 5/17/06 Date Received...: 5/19/06
 Prep Date.....: 5/22/06 Analysis Date...: 5/23/06
 Prep Batch #.....: 6143089
 Dilution Factor.: 5 Method.....: TO-15

PARAMETER	RESULTS (ppb(v/v))	REPORTING LIMIT (ppb(v/v))	RESULTS (ug/m3)	REPORTING LIMIT (ug/m3)
Benzene	ND	1.0	ND	3.2
Bromodichloromethane	ND	1.0	ND	6.7
Bromoform	ND	1.0	ND	10
Bromomethane	ND	1.0	ND	3.9
Carbon disulfide	2.8	2.5	8.8	7.8
Carbon tetrachloride	ND	1.0	ND	6.3
Chlorobenzene	ND	1.0	ND	4.6
Dibromochloromethane	ND	1.0	ND	8.5
Chloroethane	ND	1.0	ND	2.6
Chloroform	0.73	1.0	3.6 J	4.9
Chloromethane	0.94	2.5	1.9 J	5.2
1,1-Dichloroethane	3.5	1.0	14	4.0
1,2-Dichloroethane	ND	1.0	ND	4.0
cis-1,2-Dichloroethene	1.9	1.0	7.4	4.0
trans-1,2-Dichloroethene	ND	1.0	ND	4.0
1,1-Dichloroethene	0.98	1.0	3.9 J	4.0
1,2-Dichloropropane	ND	1.0	ND	4.6
cis-1,3-Dichloropropene	ND	1.0	ND	4.5
trans-1,3-Dichloropropene	ND	1.0	ND	4.5
Ethylbenzene	ND	1.0	ND	4.3
Methylene chloride	0.85	2.5	3.0 J B	8.7
Styrene	ND	1.0	ND	4.3
1,1,2,2-Tetrachloroethane	ND	1.0	ND	6.9
Tetrachloroethene	0.42	1.0	2.8 J	6.8
Toluene	1.2	1.0	4.5	3.8
1,1,1-Trichloroethane	12	1.0	65	5.5
1,1,2-Trichloroethane	ND	1.0	ND	5.5
Trichloroethene	0.21	1.0	1.1 J	5.4
Vinyl chloride	ND	1.0	ND	2.6
m-Xylene & p-Xylene	0.73	1.0	3.2 J	4.3
o-Xylene	ND	1.0	ND	4.3

SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
1,2-Dichloroethane-d4	114	70 - 130
Toluene-d8	95	70 - 130

Leggette, Brashears & Graham, Inc.
 Client Sample ID: AQ051706:1005 NP4-2
 GC/MS Volatiles

Lot-Sample # H6E190106 - 002	Work Order # H5QLK1AA	Matrix.....: AIR
SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
4-Bromofluorobenzene	100	70 - 130

Qualifiers

B Method blank contamination. The associated method blank contains the target analyte at a reportable level.
 J Estimated result. Result is less than RL.

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) * Dilution Factor) * (Molecular Weight/24.45)

Leggette, Brashears & Graham, Inc.
 Client Sample ID: AQ051706:1010 NP4-3
 GC/MS Volatiles

Lot-Sample # H6E190106 - 003 Work Order # H5QLL1AA Matrix.....: AIR

Date Sampled...: 5/17/06 Date Received...: 5/19/06
 Prep Date.....: 5/22/06 Analysis Date...: 5/23/06
 Prep Batch #....: 6143089
 Dilution Factor.: 5 Method.....: TO-15

PARAMETER	RESULTS (ppb(v/v))	REPORTING LIMIT (ppb(v/v))	RESULTS (ug/m3)	REPORTING LIMIT (ug/m3)
Benzene	0.27	1.0	0.88 J	3.2
Bromodichloromethane	ND	1.0	ND	6.7
Bromoform	ND	1.0	ND	10
Bromomethane	ND	1.0	ND	3.9
Carbon disulfide	3.9	2.5	12	7.8
Carbon tetrachloride	ND	1.0	ND	6.3
Chlorobenzene	ND	1.0	ND	4.6
Dibromochloromethane	ND	1.0	ND	8.5
Chloroethane	ND	1.0	ND	2.6
Chloroform	0.87	1.0	4.2 J	4.9
Chloromethane	1.3	2.5	2.6 J	5.2
1,1-Dichloroethane	3.7	1.0	15	4.0
1,2-Dichloroethane	ND	1.0	ND	4.0
cis-1,2-Dichloroethene	1.2	1.0	4.8	4.0
trans-1,2-Dichloroethene	ND	1.0	ND	4.0
1,1-Dichloroethene	1.1	1.0	4.5	4.0
1,2-Dichloropropane	ND	1.0	ND	4.6
cis-1,3-Dichloropropene	ND	1.0	ND	4.5
trans-1,3-Dichloropropene	ND	1.0	ND	4.5
Ethylbenzene	ND	1.0	ND	4.3
Methylene chloride	0.64	2.5	2.2 J B	8.7
Styrene	ND	1.0	ND	4.3
1,1,2,2-Tetrachloroethane	ND	1.0	ND	6.9
Tetrachloroethene	ND	1.0	ND	6.8
Toluene	1.2	1.0	4.6	3.8
1,1,1-Trichloroethane	12	1.0	68	5.5
1,1,2-Trichloroethane	ND	1.0	ND	5.5
Trichloroethene	ND	1.0	ND	5.4
Vinyl chloride	0.29	1.0	0.75 J	2.6
m-Xylene & p-Xylene	0.58	1.0	2.5 J	4.3
o-Xylene	ND	1.0	ND	4.3

SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
1,2-Dichloroethane-d4	113	70 - 130
Toluene-d8	96	70 - 130

Leggette, Brashears & Graham, Inc.
 Client Sample ID: AQ051706:1010 NP4-3
 GC/MS Volatiles

Lot-Sample # H6E190106 - 003	Work Order # H5QLL1AA	Matrix.....: AIR
SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
4-Bromofluorobenzene	102	70 - 130

Qualifiers

B Method blank contamination. The associated method blank contains the target analyte at a reportable level.
 J Estimated result. Result is less than RL.

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) * Dilution Factor) * (Molecular Weight/24.45)

Leggette, Brashears & Graham, Inc.
Client Sample ID: INTRA-LAB BLANK
GC/MS Volatiles

Lot-Sample # H6E230000 - 089B Work Order # H5X9L1AA Matrix.....: AIR

Prep Date.....: 5/22/06 Date Received..: 5/20/06
Prep Batch #.....: 6143089 Analysis Date... 5/22/06
Dilution Factor.: 1 Method.....: TO-15

PARAMETER	RESULTS (ppb(v/v))	REPORTING LIMIT (ppb(v/v))	RESULTS (ug/m3)	REPORTING LIMIT (ug/m3)
Benzene	ND	0.20	ND	0.64
Bromodichloromethane	ND	0.20	ND	1.3
Bromoform	ND	0.20	ND	2.1
Bromomethane	ND	0.20	ND	0.78
Carbon disulfide	ND	0.50	ND	1.6
Carbon tetrachloride	ND	0.20	ND	1.3
Chlorobenzene	ND	0.20	ND	0.92
Dibromochloromethane	ND	0.20	ND	1.7
Chloroethane	ND	0.20	ND	0.53
Chloroform	ND	0.20	ND	0.98
Chloromethane	ND	0.50	ND	1.0
1,1-Dichloroethane	ND	0.20	ND	0.81
1,2-Dichloroethane	ND	0.20	ND	0.81
cis-1,2-Dichloroethene	ND	0.20	ND	0.79
trans-1,2-Dichloroethene	ND	0.20	ND	0.79
1,1-Dichloroethene	ND	0.20	ND	0.79
1,2-Dichloropropane	ND	0.20	ND	0.92
cis-1,3-Dichloropropene	ND	0.20	ND	0.91
trans-1,3-Dichloropropene	ND	0.20	ND	0.91
Ethylbenzene	ND	0.20	ND	0.87
Methylene chloride	0.15	0.50	0.53 J	1.7
Styrene	ND	0.20	ND	0.85
1,1,2,2-Tetrachloroethane	ND	0.20	ND	1.4
Tetrachloroethene	ND	0.20	ND	1.4
Toluene	ND	0.20	ND	0.75
1,1,1-Trichloroethane	ND	0.20	ND	1.1
1,1,2-Trichloroethane	ND	0.20	ND	1.1
Trichloroethene	ND	0.20	ND	1.1
Vinyl chloride	ND	0.20	ND	0.51
m-Xylene & p-Xylene	ND	0.20	ND	0.87
o-Xylene	ND	0.20	ND	0.87

SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
1,2-Dichloroethane-d4	106	70 - 130

Leggette, Brashears & Graham, Inc.
 Client Sample ID: INTRA-LAB BLANK
 GC/MS Volatiles

Lot-Sample # H6E230000 - 089B	Work Order # H5X9L1AA	Matrix.....: AIR
SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
Toluene-d8	102	70 - 130
4-Bromofluorobenzene	90	70 - 130

Qualifiers

J Estimated result. Result is less than RL.

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) * Dilution Factor) * (Molecular Weight/24.45)

Leggette, Brashears & Graham, Inc.
 Client Sample ID: CHECK SAMPLE
 GC/MS Volatiles

Lot-Sample # H6E230000 - 089C Work Order # H5X9L1AC Matrix.....: AIR

Prep Date.....: 5/22/06 Date Received..: 5/20/06
 Prep Batch #.....: 6143089 Analysis Date... 5/22/06
 Dilution Factor.: 1 Method.....: TO-15

PARAMETER	SPIKE AMOUNT (ppb(v/v))	MEASURED AMOUNT (ppb(v/v))	SPIKE AMOUNT (ug/m3)	MEASURED AMOUNT (ug/m3)	PERCENT RECOVERY	RECOVERY LIMITS
Benzene	10.0	9.32	32	30	93	70 - 130
Chlorobenzene	10.0	9.43	46	43	94	70 - 130
1,1-Dichloroethene	10.0	8.38	40	33	84	70 - 130
Toluene	10.0	8.87	38	33	89	70 - 130
Trichloroethene	10.0	10.5	54	57	105	70 - 130

SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
1,2-Dichloroethane-d4	106	70 - 130
Toluene-d8	96	70 - 130
4-Bromofluorobenzene	104	70 - 130

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) * Dilution Factor) * (Molecular Weight/24.45)

Sample Receipt Documentation

JTL Knoxville

5815 Middlebrook Pike • Knoxville, TN 37921-5947
Phone: (865) 291-3000 • Fax: (865) 584-4315
Receiving: (865) 291-3031

ANALYSIS REQUEST AND CHAIN OF CUSTODY RECORD*

Reference Document #
Page 1 of 1

Project Name/No. ¹ Rowe
Sample Team Members ² _____
Profit Center No. ³ _____
Project Manager ⁴ Mark Goldberg
Purchase Order No. ⁶ _____
Required Report Date ¹¹ _____

Samples Shipment Date ⁷ 5-18-06
Lab Destination ⁸ STC Knoxville
Lab Contact ⁹ Scott Harris
Project Contact / Phone ¹² 203-929-8555
Carrier / Waybill No. ¹³ FedEx

Bill to: ⁵ LBS
4 Research Dr.
Shelton, CT 06484
Report to: ¹⁰ Mark Goldberg
@ above address
HGE190106

ONE CONTAINER PER LINE

Sample ¹⁴ Number	Sample ¹⁵ Type	Date/Time ¹⁶ Collected	Container ¹⁷ Type	Sample ¹⁸ Volume	Pre- ¹⁹ servative	Requested Testing ²⁰ Program	Condition on Receipt ²¹ Lab use only
AQ051706.1000 NP4-1	Air	5-17-06 1000 AM	Tedlon	1 L	None	70-15	Custody seals intact <u>0</u> N NA
AQ051706.1005 NP4-2		1005	↓	↓	↓	↓	Temperature received at <u>ambient</u>
AQ051706.1010 NP4-3		1010	↓	↓	↓	↓	Received by <u>MHL</u> Date <u>5/19/06</u>
							Number of packages <u>1-Package</u>
							Tracking # <u>4919 4619 0924</u>
							<u>MHL-5/19/06</u>

Special Instructions: ²³

Possible Hazard Identification: ²⁴

Non-Hazard ☒ Flammable ☐ Skin Irritant ☐ Poison B ☐ Unknown ☐

Turnaround Time Required: ²⁶

Normal ☒ Rush ☐

1. Relinquished by ²⁸ Rowe
(Signature / Affiliation)

Date: 5/18/06
Time: 1500

1. Received by ²⁸ MHL
(Signature / Affiliation)

Date: 5/19/06
Time: 0920

1. Relinquished by
(Signature / Affiliation)

Date: _____
Time: _____

1. Received by
(Signature / Affiliation)

Date: _____
Time: _____

Comments: ²⁹

Yellow: Field copy

STL KNOXVILLE SAMPLE RECEIPT/CONDITION UPON RECEIPT ANOMALY CHECKLIST

Client: L86-Project: RowLot Number: 46E190106

Review Items	Yes	No	NA	If No, what was the problem?	Comments/Actions Taken
1. Do sample container labels match COC? (IDs, Dates, Times)				☐ 1a Do not match COC ☐ 1b Incomplete information ☐ 1c Marking smeared ☐ 1d Label torn ☐ 1e No label ☐ 1f COC not received ☐ 1g Other: _____	
2. Is the cooler temperature within limits? (> freezing temp. of water to 6°C; NC, 1668, 1613B: 0-4°C; VOST: 10°C; MA: 2-6°C)	✓			☐ 2a Temp Blank = _____ ☐ 2b Cooler Temp = _____	
3. Were samples received with correct chemical preservative (excluding Encore)?			✓	☐ 3a Sample preservative = _____	
4. Were custody seals present/intact on cooler and/or containers?		✓		☐ 4a Not present ☐ 4b Not intact ☐ 4c Other: _____	
5. Were all of the samples listed on the COC received?	✓			☐ 5a Samples received-not on COC ☐ 5b Samples not received-on COC	
6. Were all of the sample containers received intact?	✓			☐ 6a Leaking ☐ 6b Broken	
7. Were VOA samples received without headspace?			✓	☐ 7a Headspace (VOA only)	
8. Were samples received in appropriate containers?	✓			☐ 8a Improper container	
9. Did you check for residual chlorine, if necessary?			✓	☐ 9a Could not be determined due to matrix interference	
10. Were samples received within holding time?	✓			☐ 10a Holding time expired	
11. For rad samples, was sample activity info. provided?			✓	☐ Incomplete information	
12. For SOG water samples (1613B, 1668A, 8290, LR PAHs), do samples have visible solids present?			✓	If yes & appears to be >1%, was SOG notified? _____	
13. Are the shipping containers intact?	✓			☐ 13a Leaking ☐ 13b Other: _____	
14. Was COC relinquished? (Signed/Dated/Timed)	✓			☐ 14a Not relinquished	
15. Are tests/parameters listed for each sample?	✓			☐ 15a Incomplete information	
16. Is the matrix of the samples noted?	✓			☐ 15a Incomplete information	
17. Is the date/time of sample collection noted?	✓			☐ 15a Incomplete information	
18. Is the client and project name/# identified?	✓			☐ 15a Incomplete information	
19. Was the sampler identified on the COC?	✓				

Quote #: 69610 PM Instructions: _____Sample Receiving Associate: [Signature]Date: 5/7/06

QA026R18.doc, 1/30/06