

**-DRAFT-**

**PROJECT STATUS MEMORANDUM**

**NO. 06-06**

---

**TO:** Pamela Tames, USEPA

**FROM:** Mark M. Goldberg, P.E.  
Paul Jobmann

**DATE:** August 28, 2006

**PROJECT:** Rowe Industries Superfund Site  
Ground-Water Recovery and Treatment System  
June 2006 Status Report  
Sag Harbor, New York

LBG Engineering Services, P.C. (LBG) commenced operation of the ground-water remediation system at the above-referenced site on December 17, 2002. This status report presents a summary of system performance, operation and maintenance, and monitoring activities for the site from June 1, 2006 through June 30, 2006. The report includes a summary of system performance parameters, system operation parameters, analytical results for ground water, system effluent samples, and air quality results.

**SUMMARY OF SYSTEM PERFORMANCE AND OPERATION**

*(June 1, 2006 through June 30, 2006)*

- |                                                                                                                 |                                   |
|-----------------------------------------------------------------------------------------------------------------|-----------------------------------|
| 1. Hours of operation during the reporting period:                                                              | 526 hours (73%)                   |
| 2. Alarm conditions during the reporting period:                                                                | See Table 1                       |
| 3. Was the SPDES VOC discharge permit criteria achieved:                                                        | yes, (Table 2)                    |
| 4. Total volume of water pumped during the reporting period:                                                    | 8,766,480 gal.                    |
| 5. Was the system effluent flow below the SPDES limit of 1,023,000 gpd: yes, (Graph 1)                          |                                   |
| 6. Mass of VOCs recovered during the reporting period:                                                          | 1.5 pounds                        |
| 7. Cumulative mass of VOCs recovered since startup on 12/17/02:<br>(calculations can be provided upon request)  | 185.8 pounds                      |
| 8. Effluent VOC vapor concentration for the reporting period:                                                   | 0.064 mg/m <sup>3</sup> (Table 3) |
| 9. Was the effluent VOC vapor emission rate below 0.022 lbs/hr.:<br>(calculations can be provided upon request) | yes (0.00063 lbs/hr)              |

## GROUND-WATER RECOVERY SYSTEM STATUS SUMMARY

The following table summarizes select recovery well parameters for the reporting period. Table 4 presents a summary of the quality results for water samples collected from recovery wells. Graph 2 presents PCE concentrations for each recovery well. For wells with water quality that meets or is approaching remedial criteria, Graph 3 presents PCE concentrations at an expanded scale in order to compare them to the PCE aquifer restoration concentration of 5 ug/L. Laboratory analytical reports are included as Appendix I.

| Well *  | Volume Pumped (gal) | Average Flow (gpm) | Minimum Design Flow (gpm) | Total VOC Concentration (µg/L) | VOC Recovery (lbs) |
|---------|---------------------|--------------------|---------------------------|--------------------------------|--------------------|
| RW-2    | 625,419             | 27                 | 26                        | 46                             | 0.24               |
| RW-3 ** | 0                   | 0                  | 23                        | 0                              | 0                  |
| RW-4    | 1,106,887           | 37                 | 13                        | 31.4                           | 0.29               |
| RW-5    | 1,828,633           | 55                 | 42                        | 5.0                            | 0.08               |
| RW-6    | 457,162             | 15                 | 28                        | 103                            | 0.39               |
| RW-7    | 1,825,241           | 70                 | 54                        | 50.2                           | 0.76               |
| RW-8    | 474,629             | 42                 | 46                        | 2.8                            | 0.01               |
| RW-9    | 1,406,516           | 70                 | 68                        | 0                              | 0                  |

\* In addition to the downtime for the system from alarms and maintenance activities, recovery wells RW-2, RW-3, RW-4, RW-8 and RW-9 were not in operation for additional time because of well rehabilitation activities. Well rehabilitation for RW-2 occurred from May 24 to June 2. Well rehabilitation for RW-3 occurred from May 25 to June 5. Well rehabilitation for RW-4 occurred from June 5 to June 12. Well rehabilitation for RW-8 occurred from June 12 to June 16. Well rehabilitation for RW-9 occurred from June 19 to June 27. The system remained operational while individual wells were turned off for rehabilitation.

\*\* Recovery well RW-3 was not operating in June because the new RW-3 drive has to be reprogrammed to account for the two (2) horsepower (HP) pump motor recently installed following well rehabilitation activities (RW-3 formerly had a one (1) HP pump motor).

The pumping rate for RW-2 continues to be 27 gpm, however, a reduction in motor amps (3.2 amps to 2.3 amps) and a reduction in percent motor speed (100% to 80%) between pre and post-rehabilitation activities suggests that the pump does not have to work as hard to maintain this pumping rate. These data also suggest that well rehabilitation activities enhanced this well's performance. Specific capacities and other pertinent observations during well rehabilitation activities will be discussed for this well and other wells in a separate well rehabilitation report in the future.

Recovery wells RW-6 and RW-8 had average flows below the respective minimum design flows determined to be necessary for capture of the plume. The well rehabilitation activities increased the pumping rate for RW-8 to 50 gpm, which is above the minimum design flow rate of 46 gpm. Well rehabilitation for RW-6 is scheduled for July.

The pumping rates for RW-4 and RW-9 increased following well rehabilitation activities. In addition, the percent motor speed and current delivered to the pump motors decreased following well rehabilitation activities. RW-5, 6 and 7 are scheduled for well rehabilitation in July.

Based on the May 11, 2006 New York State Department of Environmental Conservation (NYSDEC) letter, the State Pollutant Discharge Elimination System (SPDES) criteria for pH was adjusted to allow discharge water to be between 5.0 and 8.5. With this adjustment the effluent pH criteria of the FSP&T falls within the noted range of acceptable pH values.

### **BAG FILTER STATUS**

The following table presents an operational summary of the bag filter usage and configuration for the reporting period.

| <b>Dates</b> | <b>Bank 1</b>                                    | <b>Bank 2</b>                                    | <b>Bank 3</b> |
|--------------|--------------------------------------------------|--------------------------------------------------|---------------|
| June 1 to 30 | 7 of 8 housings used with 400 micron bag filters | 7 of 8 housings used with 400 micron bag filters | Not active    |

No modifications were made to the filter bank configuration or operation during this reporting period.

### **OTHER O&M ACTIVITIES AND FUTURE O&M ACTIVITIES**

Other O&M activities conducted in June 2006 include:

- On June 2, 2006, well rehabilitation for RW-2 was completed, however, the well could not be restarted due to a blown fuse, and remained off until a new fuse can be acquired and installed.
- On June 5, 2006, well rehabilitation for RW-3 was completed; a new 2 horsepower pump motor was installed. RW-3 remained off until a new 4 amp motor filter can be installed and the drive is reprogrammed. Well rehabilitation for RW-4 began.
- On June 8, 2006, the fuse in RW-2 was replaced and the well was restarted. A new 4 amp motor filter was installed for RW-3. RW-3 remains off until the drive can be reprogrammed.
- On June 9, 2006, troubleshooting of the air flow meters determined that the electronics shorted-out and melted (burn marks were visible on the circuit boards).
- On June 12, 2006, well rehabilitation for RW-4 was completed and RW-4 resumed operation. Well rehabilitation for RW-8 began.
- On June 16, 2006, well rehabilitation for RW-8 was completed and RW-8 resumed operation.
- On June 19, 2006, well rehabilitation for RW-9 began. RW-8 flow measurements were not being transmitted to the main control panel; troubleshooting of the RW-8 flow meter begins.
- On June 20, 2006, troubleshooting of the RW-8 flow meter continued; the meter was disassembled, damaged flow meter parts were replaced and a new flow meter transmitter

and batteries were installed. However, flow measurements are still not being transmitted back to the main control panel. RW-8 continues to operate and is pumping water based on well head pressure and motor amperage readings.

- On June 21, 2006, RW-8 was turned off to continue troubleshooting of flow meter.
- On June 23, 2006, cove monitoring and water level measurements at select piezometers were conducted.
- On June 27, 2006, well rehabilitation for RW-9 was completed, and RW-9 resumed operation.
- On June 28, 2006, a malfunctioning air-conditioning (A/C) unit was disconnected and removed from its location adjacent to the control panel in preparation for repair. Repair of the A/C unit has been scheduled for early July.

Future O&M activities scheduled for the summer of 2006 include:

- Repair the air stripper blower and booster blower air flow meters;
- Reprogram RW-3 drive for compatibility with the new 2 horsepower motor;
- Repair or replace the malfunctioning air conditioning unit;
- Replace the connections at RW-3 so a new pressure transducer can be installed;
- Complete well rehabilitation for RW-5, 6, and 7;
- Troubleshoot the RW-8 flow meter signal;
- Clean the off site and on site below grade piping leading to the FSP&T;
- Clean the air stripper tower sump, transfer tank and equalization tank following well rehabilitation activities;
- Construct an access manway on the equalization tank to facilitate tank cleaning; and
- Conduct cove monitoring in July.

cc: Phil McAndrew, Kraft Foods, N.A. – .pdf  
Lisa Krogman, Kraft Foods, N.A. (Environ) – .pdf  
Jeff Trad, NYSDEC – .pdf  
Chief-Operation Maintenance and Support Section, NYSDEC – .pdf  
William Spitz, RWM, R-1, NYSDEC  
Garrett W. Swensen Jr., Esq., Town of Southampton

MMG:ng

Attachments

H:\JOBFILES\M-N\Nabsag\Ground Water\O&M\FSP&T\Monthly Reports\2006\June 2006\Status0606June-revised.doc

## TABLES

**TABLE 1**  
**GROUND-WATER REMEDIAL ACTION**  
**ROWE INDUSTRIES SUPERFUND SITE**  
**SAG HARBOR, NEW YORK**

**MAINTENANCE LOG**  
(June 1, 2006 through June 30, 2006)

| Date      | Time     | System Changes/Modifications                                                                                                                                                                                                                                                         | Personnel |
|-----------|----------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------|
| 6/2/2006  | 11:24 AM | Well rehabilitation completed for RW-2. An RW-2 Pump Fault Alarm occurred after trying to restart the well. Troubleshooting determined it to be the result of a blown fuse. RW-2 remains off until the fuse can be replaced.                                                         | DP        |
| 6/5/2006  | 1:46 PM  | RW-3 well rehabilitation was completed. Replaced the existing one horsepower (HP) pump motor with a two HP pump motor. A new motor filter rated at 4 amps will be installed next week. RW-3 remains off until the drive is reprogrammed.                                             |           |
|           | 1:53 PM  | RW-4 well rehabilitation begins.                                                                                                                                                                                                                                                     | TS        |
| 6/6/2006  | 2:48 PM  | System Communication Failure, system shut down.                                                                                                                                                                                                                                      |           |
|           | 2:51 PM  | Reset alarms.                                                                                                                                                                                                                                                                        | MW        |
| 6/7/2006  |          | Changed multi-bag filter bags (400 mm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.                                                                                                                                                        | RD        |
|           | 7:30 AM  | Restarted system.                                                                                                                                                                                                                                                                    | RD        |
| 6/8/2006  | 3:08 PM  | Replaced fuse and restarted RW-2. A new four amp motor filter was installed for RW-3; RW-3 remains off until the drive can be reprogrammed.                                                                                                                                          | PJ        |
| 6/9/2006  | 9:56 AM  | Discontinued operation of FSP&T system, troubleshooting air flow meters. It was determined that the electronics in the sensor shorted out and melted. Repair or replacement of electronics for air flow meters will be conducted.                                                    | PJ        |
|           | 11:23 AM | The FSP&T system was restarted.                                                                                                                                                                                                                                                      | PJ        |
| 6/10/2006 | 7:48 AM  | Booser Blower (BB) Failure Alarm, system shutdown.                                                                                                                                                                                                                                   |           |
| 6/12/06   | 9:30 AM  | Reset BB motor starter, reset alarm and restarted system.                                                                                                                                                                                                                            | MW        |
|           | 11:50 AM | RW-4 well rehabilitation completed. RW-4 resumes operation.                                                                                                                                                                                                                          | MW        |
|           | 12:37 PM | RW-8 well rehabilitation begins.                                                                                                                                                                                                                                                     | MW        |
| 6/14/06   |          | Changed multi-bag filter bags (400 mm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.                                                                                                                                                        | RD        |
| 6/16/06   |          | RW-8 well rehabilitation completed. RW-8 resumes operation.                                                                                                                                                                                                                          | MW        |
| 6/19/06   | 9:31 AM  | RW-9 well rehabilitation begins.                                                                                                                                                                                                                                                     | DP        |
|           | 11:26 AM | RW-8 flow measurements are not being transmitted back to the main control panel. RW-8 operation was discontinued and troubleshooting of the flow meter begins.                                                                                                                       | DP/ETL    |
| 6/20/06   | 11:26 AM | The RW-8 flow meter was disassembled to inspect for obstructions. No obstructions were found, however, partially damaged flow meter parts were replaced. A new flow meter transitter and batteries were installed. The flow meter was re-assembled and RW-8 flow was reading 50 gpm. | DP/ETL    |
|           | 12:50 PM | RW-8 flow measurements are not being transmitted back to the main control panel, troubleshooting the RW-8 flow meter resumes. RW-8 continues to operate and is pumping water based on well head pressure and motor amperage readings.                                                | DP/ETL    |
| 6/21/06   | 12:50 PM | RW-8 is shut off for flow meter troubleshooting.                                                                                                                                                                                                                                     | DP/ETL    |
|           | 2:51 PM  | RW-8 Low Flow Alarm, occurs during troubleshooting activities.                                                                                                                                                                                                                       | DP/ETL    |
|           | 3:23 PM  | Restarted RW-8 operation, however, flow meter readings are still not being transmitted back to the main control panel.                                                                                                                                                               | DP/ETL    |

**TABLE 1**  
**GROUND-WATER REMEDIAL ACTION**  
**ROWE INDUSTRIES SUPERFUND SITE**  
**SAG HARBOR, NEW YORK**

**MAINTENANCE LOG**  
(June 1, 2006 through June 30, 2006)

| Date    | Time     | System Changes/Modifications                                                                                                                  | Personnel |
|---------|----------|-----------------------------------------------------------------------------------------------------------------------------------------------|-----------|
| 6/22/06 |          | Changed multi-bag filter bags (400 mm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.                 | RD        |
| 6/23/06 | 6:00 AM  | Booster Blower Alarm. System shut down                                                                                                        |           |
|         | 7:23 AM  | Reset motor starter, reset alarm, and restarted the system.                                                                                   | DP        |
|         | 11:04 PM | Booster Blower Failure Alarm. System shut down                                                                                                |           |
| 6/24/06 | 1:27 AM  | Power Failure Alarm, system already down. The power failure alarm triggered other alarms (except temperature alarms) listed on 6/24 and 6/25. |           |
|         | 10:11 AM | Bag filter 3 High Pressure Alarm. Bag filter 3 not active.                                                                                    |           |
| 6/27/06 | 9:00 AM  | Reset Booster Blower motor starter, reset alarms, rebooted computer, and restarted system.                                                    | MW        |
|         |          | RW-9 well rehabilitation completed. RW-9 resumes operation.                                                                                   | MW        |
| 6/28/06 |          | Changed multi-bag filter bags (400 mm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.                 | RD        |
|         | 9:23 AM  | RW-8 Low Flow Alarm, RW-8 shuts down. RW-8 remains off for troubleshooting flow meter signal.                                                 | RD        |
| 6/29/06 | 6:00 AM  | Communication Failure Alarm, System shut down.                                                                                                |           |

TABLE 2

**GROUND-WATER REMEDIAL ACTION  
ROWE INDUSTRIES SUPERFUND SITE  
SAG HARBOR, NEW YORK**

**EFFLUENT WATER QUALITY RESULTS**

| Date<br>Sampled <sup>2/</sup> | pH <sup>1/</sup>  | TDS<br>(mg/l) | PCE<br>(ug/l) | 1,1,1-TCA<br>(ug/l) | TCE<br>(ug/l) | 1,1-DCA<br>(ug/l) | 1,1-DCE<br>(ug/l) | 1,2-DCE<br>(ug/l) | Xylene<br>(ug/l) | Bromoform<br>(ug/l) | Dibromo-<br>chloromethane<br>(ug/l) | Methylene<br>Chloride<br>(ug/l) | Freon 113<br>(ug/l) | Acetone<br>(ug/l) | Chloroform<br>(ug/l) | MTBE<br>(ug/l) | Total Iron<br>(mg/l) | Dissolved<br>Iron<br>(mg/l) |
|-------------------------------|-------------------|---------------|---------------|---------------------|---------------|-------------------|-------------------|-------------------|------------------|---------------------|-------------------------------------|---------------------------------|---------------------|-------------------|----------------------|----------------|----------------------|-----------------------------|
| <b>SPDES Limits</b>           | <b>5.0 to 8.5</b> | <b>---</b>    | <b>1</b>      | <b>5</b>            | <b>5</b>      | <b>5</b>          | <b>5</b>          | <b>5</b>          | <b>5</b>         | <b>---</b>          | <b>---</b>                          | <b>5</b>                        | <b>---</b>          | <b>50</b>         | <b>7</b>             | <b>---</b>     | <b>---</b>           | <b>---</b>                  |
| 7-Jun-06                      | 5.3               | 82            | ND<1.0        | ND<1.0              | ND<1.0        | ND<1.0            | ND<1.0            | ND<1.0            | ND<2.0           | ND<1.0              | ND<1.0                              | ND<1.0                          | ND<1.0              | ND<1.0            | ND<1.0               | ND<1.0         | 1.26                 | 0.068                       |
| 14-Jun-06                     | 5.3               | 114           | ND<1.0        | ND<1.0              | ND<1.0        | ND<1.0            | ND<1.0            | ND<1.0            | ND<2.0           | ND<1.0              | ND<1.0                              | ND<1.0                          | ND<1.0              | ND<1.0            | ND<1.0               | ND<1.0         | 0.83                 | 0.065                       |
| 21-Jun-06                     | 5.3               | 114           | ND<1.0        | ND<1.0              | ND<1.0        | ND<1.0            | ND<1.0            | ND<1.0            | ND<2.0           | ND<1.0              | ND<1.0                              | ND<1.0                          | ND<1.0              | ND<1.0            | ND<1.0               | ND<1.0         | 1.13                 | 0.118                       |
| 28-Jun-06                     | 5.3               | 88            | ND<1.0        | ND<1.0              | ND<1.0        | ND<1.0            | ND<1.0            | ND<1.0            | ND<2.0           | ND<1.0              | ND<1.0                              | ND<1.0                          | ND<1.0              | ND<1.0            | ND<1.0               | ND<1.0         | 1.14                 | 0.146                       |

SPDES: State Pollutant Discharge Elimination System

mg/l: Milligrams per liter

ug/l: Micrograms per liter

----: Not established

NM: Not Measured

TDS: Total dissolved solids

PCE: Tetrachloroethylene

TCE: Trichloroethene

1,1-DCA: 1,1-Dichloroethane

1,1-DCE: 1,1-Dichloroethene

1,2-DCE: 1,2-Dichloroethene

MTBE: Methyl tert-butyl ether

Notes:

- Based on the new SPDES criteria from an NYSDEC letter dated on May 11, 2006, the new allowable pH range for the Rowe Site is between 5.0 and 8.5.  
The pH was measured using litmus paper. Influent pH values from recovery wells typically range between 5 and 6.
- "Effluent" samples were collected from sample port labeled NP2-10 unless otherwise noted.

TABLE 3

**GROUND-WATER REMEDIAL ACTION  
ROWE INDUSTRIES SUPERFUND SITE  
SAG HARBOR, NEW YORK**

**CARBON UNIT SYSTEM AIR QUALITY RESULTS**

| Precarbon                        |            |       | Parameters (mg/m3) |       |       |        |        |         |         |         |             |          |         |        |                     |        |                    |                     |      |         |        |    | TOTAL VOCs |      |
|----------------------------------|------------|-------|--------------------|-------|-------|--------|--------|---------|---------|---------|-------------|----------|---------|--------|---------------------|--------|--------------------|---------------------|------|---------|--------|----|------------|------|
| Sample Name                      | Date       | Time  | PCE                | TCE   | TCA   | DCE    | DCA    | cis-DCE | Toluene | Benzene | m&p-Xylenes | o-Xylene | Styrene | CF     | MC                  | CM     | CD                 | BM                  | CB   | EB      | VC     | CT |            |      |
| AQ062405:12:40NP4-1              | 6/24/2005  | 12:40 | 0.36               | 0.028 | 0.1   | ND     | ND     | ND      | 0.074   | 0.046   | 0.004       | ND       | ND      | ND     | 0.144               | ND     | 0.054              | 0.16                | ND   | ND      | ND     | ND | ND         | 0.97 |
| AQ070705:1400NP4-1               | 7/7/2005   | 14:00 | 0.43               | 0.026 | 0.12  | ND     | ND     | ND      | 0.044   | ND      | 0.006       | 0.002    | 0.006   | ND     | 0.19 <sup>1/</sup>  | ND     | 0.51 <sup>1/</sup> | 0.024               | ND   | 0.001   | ND     | ND | ND         | 0.86 |
| AQ080205:1400NP4-1               | 8/2/2005   | 14:00 | 0.42               | 0.034 | 0.15  | ND     | ND     | 0.009   | 0.05    | 0.008   | 0.006       | ND       | 0.007   | 0.006  | 0.017 <sup>1/</sup> | ND     | 0.66 <sup>1/</sup> | 0.043               | ND   | ND      | ND     | ND | ND         | 0.93 |
| AQ090805:900NP4-1                | 9/8/2005   | 9:00  | 0.27               | 0.032 | 0.1   | 0.011  | ND     | 0.016   | 0.079   | 0.039   | 0.025       | 0.013    | 0.003   | ND     | 1.7 <sup>1/</sup>   | ND     | 0.021              | 0.038               | 0.01 | 0.004   | ND     | ND | ND         | 0.81 |
| AQ100605:1230NP4-1               | 10/6/2005  | 12:30 | 0.28               | 0.022 | 0.1   | 0.007  | 0.025  | 0.011   | 0.015   | 0.004   | 0.003       | ND       | 0.002   | 0.005  | 0.036               | ND     | ND                 | 0.032               | ND   | ND      | ND     | ND | ND         | 0.54 |
| AQ111605:1130NP4-1               | 11/16/2005 | 11:30 | 0.76               | 0.033 | 0.11  | 0.008  | 0.022  | 0.054   | 0.44    | 0.016   | 0.012       | 0.004    | 0.004   | ND     | 0.05                | ND     | 0.023              | 0.052               | ND   | 0.002   | ND     | ND | ND         | 1.59 |
| AQ120805:930NP4-1                | 12/8/2005  | 9:30  | 0.34               | 0.016 | 0.079 | 0.006  | 0.02   | 0.032   | 0.014   | 0.003   | 0.003       | ND       | 0.002   | 0.004  | 0.008 <sup>2/</sup> | 0.002  | 0.038              | 0.015               | ND   | 0.001   | ND     | ND | ND         | 0.58 |
| AQ010406:845NP4-1                | 1/4/2006   | 8:45  | 0.24               | 0.027 | 0.094 | 0.007  | 0.019  | 0.009   | 0.031   | 0.014   | 0.01        | 0.004    | 0.005   | 0.005  | 0.018               | ND     | 0.027              | 0.002               | ND   | 0.003   | ND     | ND | ND         | 0.52 |
| AQ020106:745NP4-1                | 2/1/2006   | 7:45  | 0.64               | 0.03  | 0.12  | 0.008  | 0.028  | 0.018   | 0.005   | 0.009   | 0.003       | ND       | ND      | 0.007  | 0.024               | 0.008  | 0.012              | 0.018 <sup>3/</sup> | ND   | ND      | ND     | ND | ND         | 0.91 |
| AQ032206:1215NP4-1 <sup>4/</sup> | 3/22/2006  | 12:15 | 0.12               | 0.018 | 0.077 | 0.0042 | 0.018  | 0.0062  | 0.0026  | 0.00096 | 0.0016      | ND       | ND      | 0.0049 | 0.0025              | 0.0017 | 0.0067             | ND                  | ND   | ND      | ND     | ND | ND         | 0.26 |
| AQ041206:950NP4-1                | 4/12/2006  | 9:50  | 0.18               | 0.011 | 0.038 | 0.004  | 0.0087 | 0.007   | 0.0014  | ND      | ND          | ND       | ND      | 0.0037 | 0.0011              | 0.0018 | 0.0047             | ND                  | ND   | ND      | ND     | ND | ND         | 0.26 |
| AQ051706:1000NP4-1               | 5/17/2006  | 10:00 | 0.28               | 0.017 | 0.048 | 0.0035 | 0.013  | 0.014   | 0.0093  | 0.0026  | 0.0032      | ND       | ND      | 0.0037 | 0.0019              | 0.0026 | 0.0097             | ND                  | ND   | 0.0016  | 0.0011 | ND | ND         | 0.41 |
| AQ062106:800NP4-1                | 6/21/2006  | 8:00  | 0.15               | 0.009 | 0.074 | 0.0037 | 0.014  | 0.0062  | 0.0048  | 0.00092 | 0.0022      | ND       | ND      | 0.0029 | 0.002               | 0.0019 | 0.014              | ND                  | ND   | 0.00091 | ND     | ND | ND         | 0.29 |

| Midcarbon                        |            |       | Parameters (mg/m3) |       |       |        |        |         |         |         |             |          |         |        |                     |        |                    |       |    |       |       |         | TOTAL VOCs |      |
|----------------------------------|------------|-------|--------------------|-------|-------|--------|--------|---------|---------|---------|-------------|----------|---------|--------|---------------------|--------|--------------------|-------|----|-------|-------|---------|------------|------|
| Sample Name                      | Date       | Time  | PCE                | TCE   | TCA   | DCE    | DCA    | cis-DCE | Toluene | Benzene | m&p-Xylenes | o-Xylene | Styrene | CF     | MC                  | CM     | CD                 | BM    | CB | EB    | VC    | CT      |            |      |
| AQ062405:1241NP4-2               | 6/24/2005  | 12:41 | ND                 | ND    | 0.063 | ND     | ND     | ND      | 0.071   | 0.023   | 0.005       | ND       | 0.006   | 0.007  | 0.096               | ND     | 0.047              | ND    | ND | ND    | ND    | ND      | ND         | 0.32 |
| AQ070705:1415NP4-2               | 7/7/2005   | 14:15 | ND                 | ND    | 0.036 | ND     | ND     | ND      | 0.036   | 0.006   | 0.002       | ND       | ND      | ND     | 0.65 <sup>1/</sup>  | ND     | 0.49 <sup>1/</sup> | 0.11  | ND | ND    | ND    | ND      | ND         | 0.33 |
| AQ080205:1405NP4-2               | 8/2/2005   | 14:05 | 0.019              | ND    | 0.05  | ND     | ND     | ND      | 0.051   | 0.006   | 0.007       | ND       | 0.006   | 0.007  | 0.029 <sup>1/</sup> | ND     | 0.72 <sup>1/</sup> | 0.048 | ND | 0.002 | ND    | ND      | ND         | 0.34 |
| AQ090805:905NP4-2                | 9/8/2005   | 9:05  | 0.008              | ND    | 0.039 | ND     | ND     | ND      | 0.049   | 0.002   | 0.024       | 0.012    | ND      | 0.004  | 0.10 <sup>1/</sup>  | ND     | 0.018              | 0.013 | ND | 0.003 | ND    | ND      | ND         | 0.27 |
| AQ100605:1232NP4-2               | 10/6/2005  | 12:32 | 0.007              | ND    | 0.1   | 0.01   | 0.028  | 0.009   | 0.013   | 0.001   | 0.003       | ND       | 0.003   | 0.01   | 0.021               | ND     | ND                 | 0.049 | ND | ND    | 0.001 | ND      | ND         | 0.26 |
| AQ111605:1132NP4-2               | 11/16/2005 | 11:32 | 0.01               | ND    | 0.058 | 0.004  | 0.015  | 0.004   | 0.013   | 0.002   | 0.002       | ND       | ND      | 0.005  | 0.017               | ND     | 0.021              | 0.031 | ND | ND    | ND    | ND      | ND         | 0.18 |
| AQ120805:935NP4-2                | 12/8/2005  | 9:35  | 0.003              | ND    | 0.13  | 0.009  | 0.023  | 0.007   | 0.013   | 0.002   | 0.004       | 0.001    | 0.003   | 0.006  | 0.007 <sup>2/</sup> | ND     | 0.021              | 0.018 | ND | 0.001 | 0.003 | ND      | ND         | 0.24 |
| AQ010406:850NP4-2                | 1/4/2006   | 8:50  | 0.006              | ND    | 0.11  | 0.005  | 0.017  | 0.006   | 0.018   | 0.001   | 0.003       | ND       | 0.003   | 0.005  | 0.007               | ND     | 0.022              | 0.009 | ND | 0.001 | ND    | ND      | ND         | 0.21 |
| AQ020106:750NP4-2                | 2/1/2006   | 7:50  | 0.002              | ND    | 0.086 | ND     | 0.013  | 0.007   | 0.016   | 0.012   | 0.007       | 0.002    | 0.002   | 0.003  | 0.017               | ND     | 0.01               | ND    | ND | 0.002 | ND    | ND      | ND         | 0.19 |
| AQ032206:1220NP4-2 <sup>4/</sup> | 3/22/2006  | 12:20 | 0.0014             | ND    | 0.075 | 0.0044 | 0.013  | 0.007   | 0.0041  | ND      | 0.0025      | ND       | ND      | 0.0034 | 0.0027              | ND     | 0.0062             | ND    | ND | ND    | ND    | 0.00088 | ND         | 0.12 |
| AQ041206:955NP4-2                | 4/12/2006  | 0:00  | 0.0012             | ND    | 0.099 | 0.0076 | 0.014  | 0.0087  | 0.0015  | ND      | 0.0011      | ND       | ND      | 0.0047 | 0.0013              | ND     | ND                 | ND    | ND | ND    | ND    | ND      | ND         | 0.14 |
| AQ051706:1005NP4-2               | 5/17/2006  | 10:05 | 0.0028             | 0.001 | 0.065 | 0.0039 | 0.014  | 0.0074  | 0.0045  | ND      | 0.0032      | ND       | ND      | 0.0036 | 0.003               | 0.0019 | 0.0088             | ND    | ND | ND    | ND    | ND      | ND         | 0.12 |
| AQ062106:805NP4-2                | 6/21/2006  | 8:05  | ND                 | ND    | 0.025 | 0.0028 | 0.0081 | 0.0045  | 0.0036  | ND      | 0.0014      | ND       | ND      | 0.0023 | 0.0019              | 0.0026 | 0.014              | ND    | ND | ND    | 0.001 | ND      | ND         | 0.07 |

| Postcarbon                       |            |       | Parameters (mg/m3) |       |       |        |        |         |         |         |             |          |         |        |                     |        |                     |                    |    |        |         |         | TOTAL VOCs |      |
|----------------------------------|------------|-------|--------------------|-------|-------|--------|--------|---------|---------|---------|-------------|----------|---------|--------|---------------------|--------|---------------------|--------------------|----|--------|---------|---------|------------|------|
| Sample Name                      | Date       | Time  | PCE                | TCE   | TCA   | DCE    | DCA    | cis-DCE | Toluene | Benzene | m&p-Xylenes | o-Xylene | Styrene | CF     | MC                  | CM     | CD                  | BM                 | CB | EB     | VC      | CT      |            |      |
| AQ062405:1242NP4-3               | 6/24/2005  | 12:42 | ND                 | ND    | 0.012 | ND     | ND     | ND      | 0.035   | 0.002   | 0.002       | ND       | 0.004   | 0.004  | 0.063               | ND     | 0.022               | 0.054              | ND | ND     | ND      | ND      | ND         | 0.20 |
| AQ070705:1420NP4-3               | 7/7/2005   | 14:20 | ND                 | ND    | 0.014 | ND     | ND     | ND      | 0.038   | 0.004   | 0.003       | ND       | 0.005   | ND     | 0.23 <sup>1/</sup>  | ND     | 0.45 <sup>1/</sup>  | 0.046              | ND | ND     | ND      | ND      | ND         | 0.20 |
| AQ080205:1410NP4-3               | 8/2/2005   | 14:10 | ND                 | ND    | ND    | ND     | ND     | ND      | 0.068   | 0.007   | 0.007       | ND       | 0.008   | 0.007  | 0.019 <sup>1/</sup> | ND     | 0.640 <sup>1/</sup> | 0.046              | ND | ND     | ND      | ND      | ND         | 0.23 |
| AQ090805:910NP4-3                | 9/8/2005   | 9:10  | ND                 | ND    | 0.016 | ND     | ND     | ND      | 0.038   | 0.002   | 0.022       | 0.01     | 0.004   | 0.005  | 0.025 <sup>1/</sup> | ND     | 0.019               | 0.035              | ND | 0.002  | ND      | ND      | ND         | 0.22 |
| AQ100605:1234NP4-3               | 10/6/2005  | 12:34 | 0.004              | ND    | 0.014 | 0.004  | 0.009  | 0.009   | 0.012   | 0.002   | 0.002       | ND       | 0.002   | 0.004  | 0.02                | ND     | ND                  | 0.084              | ND | ND     | ND      | ND      | ND         | 0.17 |
| AQ111605:1134NP4-3               | 11/16/2005 | 11:34 | 0.003              | ND    | 0.029 | ND     | 0.014  | ND      | 0.044   | 0.011   | 0.009       | 0.003    | ND      | 0.005  | 0.03                | ND     | 0.022               | 0.016              | ND | 0.002  | ND      | ND      | ND         | 0.19 |
| AQ120805:940NP4-3                | 12/8/2005  | 9:40  | ND                 | ND    | 0.075 | 0.009  | 0.028  | 0.004   | 0.013   | 0.002   | 0.003       | 0.0003   | 0.003   | 0.009  | 0.009 <sup>2/</sup> | ND     | 0.025               | 0.02               | ND | 0.0008 | ND      | ND      | ND         | 0.19 |
| AQ010406:855NP4-3                | 1/4/2006   | 8:55  | 0.004              | ND    | 0.096 | 0.006  | 0.022  | 0.003   | 0.017   | 0.004   | 0.004       | ND       | 0.003   | 0.006  | 0.014               | ND     | 0.022               | ND                 | ND | 0.001  | ND      | ND      | ND         | 0.20 |
| AQ020106:755NP4-3                | 2/1/2007   | 7:55  | ND                 | 0.002 | 0.075 | 0.004  | 0.016  | 0.003   | 0.004   | 0.003   | 0.001       | ND       | ND      | 0.005  | 0.017               | ND     | 0.012               | 0.11 <sup>3/</sup> | ND | ND     | ND      | ND      | ND         | 0.14 |
| AQ032206:1225NP4-3 <sup>4/</sup> | 3/22/2006  | 12:25 | ND                 | ND    | 0.11  | 0.0046 | 0.016  | 0.0045  | 0.0029  | ND      | 0.0021      | ND       | ND      | 0.0049 | 0.0025              | 0.0016 | 0.0055              | ND                 | ND | ND     | ND      | 0.00081 | ND         | 0.16 |
| AQ041206:1000NP4-3               | 4/12/2006  | 10:00 | ND                 | ND    | 0.074 | 0.0065 | 0.011  | 0.0051  | 0.0018  | ND      | 0.0015      | ND       | ND      | 0.0051 | 0.0013              | ND     | ND                  | ND                 | ND | ND     | ND      | ND      | ND         | 0.11 |
| AQ051706:1010NP4-3               | 5/17/2006  | 10:10 | 0.0046             | ND    | 0.068 | 0.0045 | 0.015  | 0.0048  | 0.0046  | 0.00088 | 0.0025      | ND       | ND      | 0.0042 | 0.0022              | 0.0026 | 0.012               | ND                 | ND | ND     | 0.00075 | ND      | ND         | 0.13 |
| AQ062106:810NP4-3                | 6/21/2006  | 8:10  | ND                 | ND    | 0.023 | 0.0027 | 0.0066 | 0.0036  | 0.0042  | 0.00075 | 0.0016      | ND       | ND      | 0.0018 | 0.0018              | 0.0023 | 0.015               | ND                 | ND | ND     | 0.0008  | ND      | ND         | 0.06 |

Notes: 1. Methylene chloride and/or carbon disulfide concentrations in all three air samples collected during the July 7, August 9 and September 8, 2005 sampling events are greatly elevated due to suspected laboratory contamination. The methylene chloride concentration from the June 24, 2005 sampling event was used instead of the July 7, August 9 or September 8, 2005 methylene chloride concentrations to calculate the total VOCs for July, August and September 2005. The carbon disulfide concentration from the June 24, 2005 sampling event was used instead of the July 7 and August 9, 2005 carbon disulfide concentration to calculate the total VOCs for July and August 2005.

2. The methylene chloride concentration in the air samples collected on December 8, 2005 are suspected to be from laboratory contamination.

3. The laboratory procedure for the % bromomethane recovered exceeded the upper limit for quality control, therefore the bromomethane concentration for January 4, 2006 was used to calculate the total VOC concentration in for the February 1, 2006 samples.

4. The air samples from March 2006 and forward were analyzed using the TO-15 method at the Severn Trent Laboratory located in Knoxville, TN. Air sampling using the TO-17 method at the Severn Trent Laboratory in Connecticut is no longer available. The March 2006 air quality results appear to be a little lower or similar to prior air quality results. LBG will continue to monitor the air quality on a monthly basis.

PCE - Tetrachloroethane  
TCE - Trichloroethane  
TCA - 1,1,1-Trichloroethane

DCE - 1,1-Dichloroethane  
DCA - 1,1-Dichloroethane  
cis-DCE - cis-1,2-Dichloroethane  
CT - Carbon Tetrachloride

CF - Chloroform  
MC - Methylene Chloride  
CM - Chloromethane  
CD - Carbon Disulfide

BM - Bromomethane  
CB - Chlorobenzene  
EB - Ethylbenzene  
VC - Vinyl Chloride

TABLE 4

**GROUND-WATER REMEDIAL ACTION  
ROWE INDUSTRIES SUPERFUND SITE  
SAG HARBOR, NEW YORK**

**RECOVERY WELL WATER QUALITY RESULTS**

| Recovery Well | Date Sampled | PCE (ug/L) | TCE (ug/L) | TCA (ug/L) | Vinyl Acetate (ug/L) | Chloroform (ug/L) | MTBE (ug/L) | Total Iron (mg/L) | Dissolved Iron (mg/L) | 1,1-Dichloro-ethane (ug/L) | cis-1,2-Dichloro-ethene (ug/L) | 1,1-Dichloro-ethene (ug/L) | Methylene Chloride (ug/L) <sup>1/</sup> | Toluene (ug/L) | Dibromochloromethane (ug/L) | Acetone (ug/L) <sup>1/</sup> |
|---------------|--------------|------------|------------|------------|----------------------|-------------------|-------------|-------------------|-----------------------|----------------------------|--------------------------------|----------------------------|-----------------------------------------|----------------|-----------------------------|------------------------------|
|               | ARAR's       | 5          | 5          | 5          | NE                   | 7                 | NE          | 300               | 300                   | 5                          | 5                              | 5                          | 5                                       | NE             | NE                          | NE                           |
| RW-1          | 15-Sep-04    | ND<1       | ND<1       | ND<1       | ND<1                 | 2.8               | ND<1        | 0.0865            | ND<0.02               | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 7-Oct-04     | ND<1       | ND<1       | ND<1       | ND<1                 | 2.2               | ND<1        | 0.0332            | ND<0.02               | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 3-Nov-04     | ND<1       | ND<1       | ND<1       | ND<1                 | 1.9               | ND<1        | 0.0133            | ND<0.02               | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 15-Dec-04    | ND<1       | ND<1       | ND<1       | ND<1                 | 9.8               | ND<1        | 0.0475            | 0.0229                | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 13-Jan-05    | ND<1       | ND<1       | ND<1       | ND<1                 | 1.5               | ND<1        | 0.0703            | 0.0326                | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Feb-05     | ND<1       | ND<1       | ND<1       | ND<1                 | 4.6               | ND<1        | ND<0.02           | ND<0.02               | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 15-Mar-05    | ND<1       | ND<1       | ND<1       | ND<1                 | 2.5               | ND<1        | 0.0285            | ND<0.02               | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 19-Apr-05    | ND<1       | ND<1       | ND<1       | ND<1                 | 1.5               | ND<1        | 0.0357            | 0.0217                | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 2-May-05     | ND<1       | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | ND<0.02           | ND<0.02               | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 16-Jun-05    | ND<1       | ND<1       | ND<1       | ND<1                 | 4.0               | ND<1        | ND<0.02           | ND<0.02               | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 14-Jul-05    | ND<1       | ND<1       | ND<1       | ND<1                 | 2.1               | ND<1        | 0.0289            | ND<0.02               | ND<1                       | ND<1                           | ND<1                       | 8.4*                                    | ND<1           | ND<1                        | 6.9*                         |
|               | 7-Mar-06     | ND<1       | ND<1       | ND<1       | ND<1                 | 5.2               | ND<1        | 0.1650            | ND<0.02               | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 15-Sep-04    | 12         | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 3.82              | ND<0.02               | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 7-Oct-04     | 10         | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 1.5               | 0.213                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | 1.5                         | ND<1                         |
| RW-2          | 3-Nov-04     | 11         | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 5.21              | 0.152                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 15-Dec-04    | 10         | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 10.8              | 0.297                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 4-Jan-05     | 25         | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 4.81              | 1.5                   | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Feb-05     | 18         | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 5.01              | ND<0.02               | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 15-Mar-05    | 20         | 1.1        | ND<1       | ND<1                 | ND<1              | ND<1        | 5.28              | 0.0816                | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 19-Apr-05    | 9.0        | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 4.51              | 0.128                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 2-May-05     | 8.2        | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 3.69              | 0.17                  | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 16-Jun-05    | 12.0       | ND<1       | 1.0        | ND<1                 | ND<1              | ND<1        | 3.5               | 0.0511                | ND<1                       | 2.0                            | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 14-Jul-05    | 7.7        | 1.1        | ND<1       | ND<1                 | ND<1              | ND<1        | 0.28              | 0.0298                | ND<1                       | ND<1                           | ND<1                       | 7.3 *                                   | ND<1           | ND<1                        | 5.6 *                        |
|               | 9-Aug-05     | 5.4        | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 3.74              | 0.107                 | ND<1                       | 5.8                            | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Sep-05     | 16         | 1.8        | ND<1       | ND<1                 | ND<1              | ND<1        | 3.57              | 0.0704                | ND<1                       | 11                             | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 19-Oct-05    | NM         | NM         | NM         | NM                   | NM                | NM          | NM                | NM                    | NM                         | NM                             | NM                         | NM                                      | NM             | NM                          | NM                           |
|               | 21-Nov-05    | 15         | 2.1        | ND<1       | ND<1                 | ND<1              | ND<1        | 6.1               | 0.0269                | ND<1                       | 12                             | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Dec-05     | 34         | 2.1        | ND<1       | ND<1                 | ND<1              | ND<1        | 4.25              | ND<0.02               | ND<1                       | 25                             | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 12-Jan-06    | 5.2        | 2.0        | ND<1       | ND<1                 | ND<1              | ND<1        | 9.15              | 0.0696                | ND<1                       | 5.0                            | ND<1                       | 4.8 *                                   | 1.0            | ND<1                        | ND<1                         |
|               | 14-Feb-06    | 6.5        | 4.3        | 1.2        | ND<1                 | ND<1              | ND<1        | 3.99              | ND<0.02               | ND<1                       | 2.8                            | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 7-Mar-06     | 6.5        | 3.5        | ND<1       | ND<1                 | ND<1              | ND<1        | 4.76              | 0.0395                | ND<1                       | 3.8                            | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 12-Apr-06    | 12.0       | 3.9        | 1.2        | ND<1                 | ND<1              | ND<1        | 4.24              | 0.0522                | ND<1                       | 12.0                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 17-May-06    | 19.0       | 5.1        | ND<1       | ND<1                 | ND<1              | ND<1        | 5.95              | 0.063                 | ND<1                       | 14.0                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 21-Jun-06    | 13.0       | 3.0        | 25.0       | ND<1                 | ND<1              | ND<1        | 3.57              | 0.093                 | ND<1                       | 5.0                            | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |

TABLE 4

**GROUND-WATER REMEDIAL ACTION  
ROWE INDUSTRIES SUPERFUND SITE  
SAG HARBOR, NEW YORK**

**RECOVERY WELL WATER QUALITY RESULTS**

| Recovery Well | Date Sampled             | PCE (ug/L) | TCE (ug/L) | TCA (ug/L) | Vinyl Acetate (ug/L) | Chloroform (ug/L) | MTBE (ug/L) | Total Iron (mg/L) | Dissolved Iron (mg/L) | 1,1-Dichloro-ethane (ug/L) | cis-1,2-Dichloro-ethene (ug/L) | 1,1-Dichloro-ethene (ug/L) | Methylene Chloride <sup>1/</sup> (ug/L) | Toluene (ug/L) | Dibromochloromethane (ug/L) | Acetone (ug/L) <sup>1/</sup> |
|---------------|--------------------------|------------|------------|------------|----------------------|-------------------|-------------|-------------------|-----------------------|----------------------------|--------------------------------|----------------------------|-----------------------------------------|----------------|-----------------------------|------------------------------|
|               | ARAR's                   | 5          | 5          | 5          | NE                   | 7                 | NE          | 300               | 300                   | 5                          | 5                              | 5                          | 5                                       | NE             | NE                          | NE                           |
| RW-3          | 15-Sep-04                | 2.7        | 21         | 8.7        | ND<1                 | ND<1              | ND<1        | 1.91              | 0.42                  | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 7-Oct-04                 | 2.2        | 12         | 5.0        | ND<1                 | ND<1              | ND<1        | 2.09              | 1.82                  | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 3-Nov-04                 | 1.5        | 6.5        | 2.6        | ND<1                 | ND<1              | ND<1        | 1.87              | 1.8                   | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 15-Dec-04                | ND<1       | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 3.77              | 0.489                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 4-Jan-05                 | ND<1       | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 2.60              | 2.24                  | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Feb-05                 | 1.6        | 1.3        | ND<1       | ND<1                 | ND<1              | ND<1        | 2.10              | 1.15                  | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 15-Mar-05                | 3          | 13         | 5.0        | ND<1                 | ND<1              | ND<1        | 1.89              | 1.36                  | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 19-Apr-05                | ND<1       | 2.0        | ND<1       | ND<1                 | ND<1              | ND<1        | 46.1              | 0.539                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 2-May-05                 | 2.2        | 7.7        | 2.8        | ND<1                 | ND<1              | ND<1        | 1.85              | 0.82                  | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 16-Jun-05                | ND<1       | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 9.91              | 10                    | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 14-Jul-05                | 1.6        | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 2.01              | 0.649                 | ND<1                       | ND<1                           | ND<1                       | 9.1 *                                   | ND<1           | ND<1                        | 6.9 *                        |
|               | 9-Aug-05                 | ND<1       | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 2.50              | 0.973                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Sep-05                 | 1          | 3.6        | 1.2        | ND<1                 | ND<1              | ND<1        | 2.03              | 0.71                  | ND<1                       | 2.6                            | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 19-Oct-05                | NM         | NM         | NM         | NM                   | NM                | NM          | NM                | NM                    | NM                         | NM                             | NM                         | NM                                      | NM             | NM                          | NM                           |
|               | 21-Nov-05                | 1.3        | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 1.83              | 0.708                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Dec-05                 | ND<1       | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 2.11              | 0.556                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 12-Jan-06                | 1.7        | 17         | 7.9        | ND<1                 | ND<1              | ND<1        | 1.93              | 0.455                 | ND<1                       | ND<1                           | ND<1                       | 4.6 *                                   | ND<1           | ND<1                        | ND<1                         |
|               | 14-Feb-06                | 1.4        | 8.9        | 2.5        | ND<1                 | ND<1              | ND<1        | 3.80              | 0.157                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 7-Mar-06                 | 1.1        | 3.4        | ND<1       | ND<1                 | ND<1              | ND<1        | 1.87              | 0.297                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 12-Apr-06                | 0.95       | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 1.99              | 0.649                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 17-May-06                | ND<1       | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 1.06              | 0.353                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 21-June-06 <sup>1/</sup> | NM         | NM         | NM         | NM                   | NM                | NM          | NM                | NM                    | NM                         | NM                             | NM                         | NM                                      | NM             | NM                          | NM                           |
| RW-4          | 15-Sep-04                | 120        | 3.7        | 18         | ND<1                 | ND<1              | ND<1        | 2.98              | ND<0.02               | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 7-Oct-04                 | 94         | ND<1       | 14         | ND<1                 | ND<1              | ND<1        | 3.65              | 0.126                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 3-Nov-04                 | 130        | 4.2        | 11         | ND<1                 | ND<1              | ND<1        | 4.75              | 0.205                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 15-Dec-04                | 230        | 5.7        | 35         | ND<1                 | ND<1              | ND<1        | 1.90              | 1.62                  | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 4-Jan-05                 | 160        | 4.1        | 7.3        | ND<1                 | ND<1              | ND<1        | 6.11              | 3.28                  | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Feb-05                 | NM         | NM         | NM         | NM                   | NM                | NM          | NM                | NM                    | NM                         | NM                             | NM                         | NM                                      | NM             | NM                          | NM                           |
|               | 15-Mar-05                | NM         | NM         | NM         | NM                   | NM                | NM          | NM                | NM                    | NM                         | NM                             | NM                         | NM                                      | NM             | NM                          | NM                           |
|               | 19-Apr-05                | NM         | NM         | NM         | NM                   | NM                | NM          | NM                | NM                    | NM                         | NM                             | NM                         | NM                                      | NM             | NM                          | NM                           |
|               | 2-May-05                 | 80         | 2.4        | 9.8        | ND<1                 | ND<1              | ND<1        | 3.77              | 0.0687                | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 30-Jun-05                | 74         | 2.6        | ND<1       | ND<1                 | ND<1              | ND<1        | 9.95              | 9.28                  | ND<1                       | ND<1                           | ND<1                       | 4.5 *                                   | ND<1           | ND<1                        | ND<1                         |
|               | 14-Jul-05                | 37         | ND<1       | 8.9        | ND<1                 | ND<1              | ND<1        | 3.22              | 0.0185                | ND<1                       | ND<1                           | ND<1                       | 9.4 *                                   | ND<1           | ND<1                        | 7.4 *                        |
|               | 9-Aug-05                 | 31         | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 2.49              | 0.111                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Sep-05                 | 45         | ND<1       | 6.0        | ND<1                 | ND<1              | ND<1        | 3.47              | 0.173                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 19-Oct-05                | NM         | NM         | NM         | NM                   | NM                | NM          | NM                | NM                    | NM                         | NM                             | NM                         | NM                                      | NM             | NM                          | NM                           |
|               | 21-Nov-05                | 30         | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 3.69              | 0.0777                | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 12-Dec-05                | 64         | 2.0        | 1.5        | ND<1                 | ND<1              | ND<1        | 2.82              | 0.0302                | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 12-Jan-06                | 15         | ND<1       | 9.5        | ND<1                 | ND<1              | ND<1        | 7.78              | 0.0412                | ND<1                       | ND<1                           | ND<1                       | 5.2 *                                   | ND<1           | ND<1                        | ND<1                         |
|               | 14-Feb-06                | 24         | ND<1       | 8.7        | ND<1                 | ND<1              | ND<1        | 6.05              | 0.0627                | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 7-Mar-06                 | 22         | ND<1       | 7.0        | ND<1                 | ND<1              | ND<1        | 3.50              | 0.0476                | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 12-Apr-06                | 26         | 1.5        | 6.2        | ND<1                 | ND<1              | 2           | 4.17              | 0.0963                | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 17-May-06                | 26         | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 3.15              | 0.109                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 21-Jun-06                | 23         | ND<1       | 8.4        | ND<1                 | ND<1              | ND<1        | 9.23              | 0.086                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |

TABLE 4

**GROUND-WATER REMEDIAL ACTION  
ROWE INDUSTRIES SUPERFUND SITE  
SAG HARBOR, NEW YORK**

**RECOVERY WELL WATER QUALITY RESULTS**

| Recovery Well | Date Sampled | PCE (ug/L) | TCE (ug/L) | TCA (ug/L) | Vinyl Acetate (ug/L) | Chloroform (ug/L) | MTBE (ug/L) | Total Iron (mg/L) | Dissolved Iron (mg/L) | 1,1-Dichloroethane (ug/L) | cis-1,2-Dichloroethene (ug/L) | 1,1-Dichloroethene (ug/L) | Methylene Chloride <sup>1/</sup> (ug/L) | Toluene (ug/L) | Dibromochloromethane (ug/L) | Acetone (ug/L) <sup>1/</sup> |
|---------------|--------------|------------|------------|------------|----------------------|-------------------|-------------|-------------------|-----------------------|---------------------------|-------------------------------|---------------------------|-----------------------------------------|----------------|-----------------------------|------------------------------|
|               | ARAR's       | 5          | 5          | 5          | NE                   | 7                 | NE          | 300               | 300                   | 5                         | 5                             | 5                         | 5                                       | NE             | NE                          | NE                           |
| RW-5          | 15-Sep-04    | 24         | ND<1       | 6.5        | ND<1                 | ND<1              | 3.2         | 2.39              | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 7-Oct-04     | 16         | ND<1       | 5.2        | ND<1                 | ND<1              | 2.4         | 0.139             | 0.0163                | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | 1.4                         | ND<1                         |
|               | 3-Nov-04     | 15         | ND<1       | 6.4        | ND<1                 | ND<1              | 2.2         | 0.0287            | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 15-Dec-04    | 28         | ND<1       | 28         | ND<1                 | ND<1              | ND<1        | 0.0621            | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 4-Jan-05     | 12         | ND<1       | 5.6        | ND<1                 | ND<1              | 2.0         | 0.0269            | 0.0172                | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Feb-05     | 11         | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | ND<0.02           | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 15-Mar-05    | 14         | ND<1       | 4.3        | ND<1                 | ND<1              | 2.6         | 0.318             | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 19-Apr-05    | 9          | ND<1       | 4.1        | ND<1                 | ND<1              | ND<1        | 0.0887            | 0.0187                | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 2-May-05     | 13         | ND<1       | 5.7        | ND<1                 | ND<1              | ND<1        | 0.0223            | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 16-Jun-05    | 4.7        | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 0.0177            | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 14-Jul-05    | 8.2        | ND<1       | 1.6        | ND<1                 | ND<1              | ND<1        | 0.0358            | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | 9.5 *                                   | ND<1           | ND<1                        | 5.6 *                        |
|               | 9-Aug-05     | 2.6        | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 0.0227            | 0.0303                | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Sep-05     | 8          | ND<1       | 3.8        | ND<1                 | ND<1              | ND<1        | 0.0185            | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 19-Oct-05    | NM         | NM         | NM         | NM                   | NM                | NM          | NM                | NM                    | NM                        | NM                            | NM                        | NM                                      | NM             | NM                          | NM                           |
|               | 21-Nov-05    | 2.6        | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 0.0482            | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Dec-05     | 2.4        | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 0.0468            | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 12-Jan-06    | 2.3        | ND<1       | 2.0        | ND<1                 | ND<1              | ND<1        | 0.0558            | 0.0119                | ND<1                      | ND<1                          | ND<1                      | 4.6*                                    | ND<1           | ND<1                        | ND<1                         |
|               | 14-Feb-06    | 2.9        | ND<1       | 3.8        | ND<1                 | ND<1              | ND<1        | ND<0.02           | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 7-Mar-06     | 2.6        | ND<1       | 3.0        | ND<1                 | ND<1              | ND<1        | ND<0.02           | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 12-Apr-06    | 1.4        | ND<1       | ND<1       | ND<1                 | 1.5               | 2.4         | 0.0786            | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 17-May-06    | ND<1       | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 0.016             | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 21-Jun-06    | 2.4        | ND<1       | 2.6        | ND<1                 | ND<1              | ND<1        | 0.195             | 0.012                 | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
| RW-6          | 15-Sep-04    | 130        | 3.3        | 2.2        | ND<1                 | ND<1              | ND<1        | 0.0976            | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 7-Oct-04     | 94         | ND<1       | 1.6        | ND<1                 | ND<1              | ND<1        | 0.214             | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | 2.0                         | ND<1                         |
|               | 3-Nov-04     | 94         | 2.1        | 2.4        | ND<1                 | ND<1              | 2.5         | 0.0111            | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 15-Dec-04    | 200        | 3.8        | 16         | ND<1                 | ND<1              | ND<1        | 4.73              | 0.117                 | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 4-Jan-05     | 86         | 2.1        | 3.7        | ND<1                 | ND<1              | 2.4         | 0.0279            | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Feb-05     | 110        | 2.4        | 7.6        | ND<1                 | ND<1              | ND<1        | ND<0.02           | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 15-Mar-05    | 120        | 2.3        | 6.6        | ND<1                 | ND<1              | 2.7         | 0.0294            | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 19-Apr-05    | 74         | ND<1       | 7.0        | ND<1                 | ND<1              | ND<1        | 0.0509            | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 2-May-05     | 96         | 2.8        | 8.5        | ND<1                 | ND<1              | ND<1        | ND<0.02           | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 16-Jun-05    | 69         | 1.6        | 13         | ND<1                 | ND<1              | ND<1        | 0.067             | 0.0195                | ND<1                      | ND<1                          | 2.1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 14-Jul-05    | 64         | 1.6        | 9.5        | ND<1                 | ND<1              | ND<1        | 0.0406            | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | 7.2 *                                   | ND<1           | ND<1                        | 7 *                          |
|               | 9-Aug-05     | 49         | ND<1       | 12         | ND<1                 | ND<1              | ND<1        | 0.088             | 0.0366                | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Sep-05     | 100        | 1.6        | 12         | ND<1                 | ND<1              | ND<1        | 1.3               | 0.0143                | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 19-Oct-05    | NM         | NM         | NM         | NM                   | NM                | NM          | NM                | NM                    | NM                        | NM                            | NM                        | NM                                      | NM             | NM                          | NM                           |
|               | 21-Nov-05    | 68         | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 0.144             | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Dec-05     | 100        | 2.1        | 20         | ND<1                 | ND<1              | ND<1        | 0.139             | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 12-Jan-06    | 41         | 1.1        | 16         | ND<1                 | ND<1              | ND<1        | 0.189             | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | 4.6*                                    | ND<1           | ND<1                        | ND<1                         |
|               | 22-Feb-06    | 63         | 1.6        | 15         | ND<1                 | ND<1              | ND<1        | 0.116             | 0.0155                | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 7-Mar-06     | 65         | 1.2        | 17         | ND<1                 | ND<1              | ND<1        | 0.0429            | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 12-Apr-06    | 62         | 2.1        | 22         | ND<1                 | ND<1              | 2           | 0.24              | 0.0137                | 0.97                      | ND<1                          | 1.1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 17-May-06    | 68         | ND<1       | 18         | ND<1                 | ND<1              | ND<1        | 0.17              | 0.019                 | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 21-Jun-06    | 83         | ND<1       | 20         | ND<1                 | ND<1              | ND<1        | 0.075             | 0.025                 | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |

TABLE 4

**GROUND-WATER REMEDIAL ACTION  
ROWE INDUSTRIES SUPERFUND SITE  
SAG HARBOR, NEW YORK**

**RECOVERY WELL WATER QUALITY RESULTS**

| Recovery Well | Date Sampled | PCE (ug/L) | TCE (ug/L) | TCA (ug/L) | Vinyl Acetate (ug/L) | Chloroform (ug/L) | MTBE (ug/L) | Total Iron (mg/L) | Dissolved Iron (mg/L) | 1,1-Dichloro-ethane (ug/L) | cis-1,2-Dichloro-ethene (ug/L) | 1,1-Dichloro-ethene (ug/L) | Methylene Chloride (ug/L) <sup>1/</sup> | Toluene (ug/L) | Dibromochloromethane (ug/L) | Acetone (ug/L) <sup>1/</sup> |
|---------------|--------------|------------|------------|------------|----------------------|-------------------|-------------|-------------------|-----------------------|----------------------------|--------------------------------|----------------------------|-----------------------------------------|----------------|-----------------------------|------------------------------|
|               | ARAR's       | 5          | 5          | 5          | NE                   | 7                 | NE          | 300               | 300                   | 5                          | 5                              | 5                          | 5                                       | NE             | NE                          | NE                           |
| RW-7          | 15-Sep-04    | 59         | 2.2        | ND<1       | ND<1                 | ND<1              | ND<1        | ND<0.02           | ND<0.02               | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 7-Oct-04     | 38         | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 0.0429            | 0.0126                | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 3-Nov-04     | 36         | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 0.0214            | 0.0108                | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 15-Dec-04    | 82         | ND<1       | 4.3        | ND<1                 | ND<1              | ND<1        | 0.0272            | 0.00876               | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 4-Jan-05     | 37         | 1.1        | ND<1       | ND<1                 | ND<1              | ND<1        | 0.0343            | ND<0.02               | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Feb-05     | 45         | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | ND<0.02           | ND<0.02               | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 15-Mar-05    | 42         | 1.5        | 1.7        | ND<1                 | ND<1              | ND<1        | 0.0356            | ND<0.02               | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 19-Apr-05    | 22         | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 0.107             | 0.0152                | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 2-May-05     | 30         | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 0.02              | ND<0.02               | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 16-Jun-05    | 32         | 1.0        | 4.7        | ND<1                 | ND<1              | ND<1        | 0.0753            | 0.02                  | 1.5                        | ND<1                           | 1.1                        | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 14-Jul-05    | 32         | ND<1       | 2.2        | ND<1                 | ND<1              | ND<1        | 0.0155            | ND<0.02               | ND<1                       | ND<1                           | ND<1                       | 8.7 *                                   | ND<1           | ND<1                        | 7.2 *                        |
|               | 9-Aug-05     | 31         | ND<1       | 6.2        | ND<1                 | ND<1              | ND<1        | 0.0903            | 0.0409                | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Sep-05     | 39         | ND<1       | 3.4        | ND<1                 | ND<1              | ND<1        | 0.0452            | ND<0.02               | 1.7                        | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 19-Oct-05    | NM         | NM         | NM         | NM                   | NM                | NM          | NM                | NM                    | NM                         | NM                             | NM                         | NM                                      | NM             | NM                          | NM                           |
|               | 21-Nov-05    | 36         | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 0.536             | ND<0.02               | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Dec-05     | 70         | ND<1       | 12.0       | ND<1                 | ND<1              | ND<1        | 0.253             | ND<0.02               | 4.2                        | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 12-Jan-06    | 26         | ND<1       | 5.0        | ND<1                 | ND<1              | ND<1        | 0.343             | ND<0.02               | 2.2                        | ND<1                           | ND<1                       | 5.0 *                                   | ND<1           | ND<1                        | ND<1                         |
|               | 14-Feb-06    | 36         | ND<1       | 4.1        | ND<1                 | ND<1              | ND<1        | 0.0332            | ND<0.02               | 2.0                        | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 7-Mar-06     | 38         | ND<1       | 4.1        | ND<1                 | ND<1              | ND<1        | 0.143             | ND<0.02               | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 12-Apr-06    | 49         | 1.6        | 7.4        | ND<1                 | ND<1              | ND<1        | 0.0912            | 0.0175                | 3.4                        | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 17-May-06    | 59         | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 0.126             | 0.026                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 21-Jun-06    | 44         | ND<1       | 4.6        | ND<1                 | ND<1              | ND<1        | 0.081             | 0.013                 | 1.6                        | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
| RW-8          | 15-Sep-04    | NM         | NM         | NM         | NM                   | NM                | NM          | NM                | NM                    | NM                         | NM                             | NM                         | NM                                      | ND<1           | ND<1                        | NM                           |
|               | 27-Oct-04    | 4.1        | 1.0        | 2.2        | ND<1                 | ND<1              | ND<1        | 28.8              | 0.235                 | 1.6                        | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 3-Nov-04     | 5.3        | ND<1       | 4.0        | ND<1                 | ND<1              | ND<1        | 10.6              | 0.271                 | 3.5                        | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 15-Dec-04    | 16         | ND<1       | 22         | ND<1                 | ND<1              | ND<1        | 15.6              | 0.149                 | 15                         | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 4-Jan-05     | 6.9        | 1.3        | 3.9        | ND<1                 | ND<1              | ND<1        | 8.92              | 2.85                  | 2.7                        | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Feb-05     | 7.4        | ND<1       | 7.2        | ND<1                 | ND<1              | ND<1        | 8.24              | ND<0.02               | 4.7                        | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 15-Mar-05    | 9.0        | 1.3        | 4.2        | ND<1                 | ND<1              | ND<1        | 7.54              | 0.075                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 19-Apr-05    | 3.5        | ND<1       | 3.5        | ND<1                 | ND<1              | ND<1        | 8.89              | 0.321                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 2-May-05     | 5.6        | ND<1       | 5.2        | ND<1                 | ND<1              | ND<1        | 7.33              | 0.073                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 16-Jun-05    | 2.7        | ND<1       | 5.8        | ND<1                 | ND<1              | ND<1        | 7.06              | 0.325                 | 2.1                        | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 14-Jul-05    | 2.6        | ND<1       | 3.4        | ND<1                 | ND<1              | ND<1        | 8.33              | 0.017                 | ND<1                       | ND<1                           | ND<1                       | 8.5 *                                   | ND<1           | ND<1                        | 8.2 *                        |
|               | 9-Aug-05     | 1.8        | ND<1       | 2.9        | ND<1                 | ND<1              | ND<1        | 0.24              | 0.065                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Sep-05     | 2.9        | ND<1       | 4.2        | ND<1                 | ND<1              | ND<1        | 7.53              | 0.255                 | 2.5                        | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 19-Oct-05    | NM         | NM         | NM         | NM                   | NM                | NM          | NM                | NM                    | NM                         | NM                             | NM                         | NM                                      | NM             | NM                          | NM                           |
|               | 21-Nov-05    | 1.5        | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 7.65              | 0.106                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Dec-05     | 2.4        | ND<1       | 5.0        | ND<1                 | ND<1              | ND<1        | 5.19              | 0.021                 | 3.2                        | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 12-Jan-06    | 1.3        | ND<1       | 3.7        | ND<1                 | ND<1              | ND<1        | 7.25              | 0.097                 | 2.0                        | ND<1                           | ND<1                       | 4.9 *                                   | ND<1           | ND<1                        | ND<1                         |
|               | 14-Feb-06    | 1.5        | ND<1       | 3.0        | ND<1                 | ND<1              | ND<1        | 8.06              | ND<0.02               | 1.5                        | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 7-Mar-06     | 1.3        | ND<1       | 2.8        | ND<1                 | ND<1              | ND<1        | 8.33              | 0.064                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 12-Apr-06    | 2.1        | 0.9        | 4.5        | ND<1                 | ND<1              | ND<1        | 7.27              | 0.823                 | 3.3                        | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 17-May-06    | ND<1       | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 2.03              | 0.056                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 21-Jun-06    | ND<1       | ND<1       | 2.8        | ND<1                 | ND<1              | ND<1        | 8.40              | 0.897                 | ND<1                       | ND<1                           | ND<1                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |

TABLE 4

**GROUND-WATER REMEDIAL ACTION  
ROWE INDUSTRIES SUPERFUND SITE  
SAG HARBOR, NEW YORK**

**RECOVERY WELL WATER QUALITY RESULTS**

| Recovery Well | Date Sampled             | PCE (ug/L) | TCE (ug/L) | TCA (ug/L) | Vinyl Acetate (ug/L) | Chloroform (ug/L) | MTBE (ug/L) | Total Iron (mg/L) | Dissolved Iron (mg/L) | 1,1-Dichloroethane (ug/L) | cis-1,2-Dichloroethene (ug/L) | 1,1-Dichloroethene (ug/L) | Methylene Chloride (ug/L) <sup>1/</sup> | Toluene (ug/L) | Dibromochloromethane (ug/L) | Acetone (ug/L) <sup>1/</sup> |
|---------------|--------------------------|------------|------------|------------|----------------------|-------------------|-------------|-------------------|-----------------------|---------------------------|-------------------------------|---------------------------|-----------------------------------------|----------------|-----------------------------|------------------------------|
|               | ARAR's                   | 5          | 5          | 5          | NE                   | 7                 | NE          | 300               | 300                   | 5                         | 5                             | 5                         | 5                                       | NE             | NE                          | NE                           |
| RW-9          | 15-Sep-04                | 3.7        | 1.0        | 6.0        | ND<1                 | ND<1              | ND<1        | 0.049             | ND<0.02               | 1.9                       | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 7-Oct-04                 | 3.1        | ND<1       | 5.0        | ND<1                 | ND<1              | ND<1        | 3.12              | 0.716                 | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 3-Nov-04                 | 1.6        | ND<1       | 5.9        | ND<1                 | ND<1              | ND<1        | 2.97              | 1.41                  | 1.6                       | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 15-Dec-04                | 1.3        | ND<1       | 31         | ND<1                 | ND<1              | ND<1        | 2.78              | 0.497                 | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 4-Jan-05                 | ND<1       | 1.0        | 6.4        | ND<1                 | ND<1              | ND<1        | 2.35              | 1.72                  | 1.6                       | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Feb-05                 | ND<1       | ND<1       | 10         | ND<1                 | ND<1              | ND<1        | 0.0974            | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 15-Mar-05                | ND<1       | 1.4        | 5.9        | ND<1                 | ND<1              | ND<1        | 1.55              | 0.507                 | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 19-Apr-05                | ND<1       | ND<1       | 4.5        | ND<1                 | ND<1              | ND<1        | 1.59              | 0.091                 | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 2-May-05                 | ND<1       | 2.9        | 9.0        | ND<1                 | ND<1              | ND<1        | 2.89              | 0.0596                | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 16-Jun-05                | ND<1       | ND<1       | 5.8        | ND<1                 | ND<1              | ND<1        | 1.38              | 0.149                 | 0.9                       | ND<1                          | 1.2                       | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 14-Jul-05                | 3.4        | ND<1       | 3.1        | ND<1                 | ND<1              | ND<1        | 2.55              | 0.238                 | ND<1                      | ND<1                          | ND<1                      | 6.9 *                                   | ND<1           | ND<1                        | 7.3 *                        |
|               | 9-Aug-05                 | ND<1       | ND<1       | 1.4        | ND<1                 | ND<1              | ND<1        | 0.994             | 0.0734                | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Sep-05                 | 1.2        | ND<1       | 2.0        | ND<1                 | ND<1              | ND<1        | 3.64              | 0.161                 | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 19-Oct-05                | NM         | NM         | NM         | NM                   | NM                | NM          | NM                | NM                    | NM                        | NM                            | NM                        | NM                                      | NM             | NM                          | NM                           |
|               | 21-Nov-05                | ND<1       | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 1.31              | 0.108                 | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 8-Dec-05                 | ND<1       | ND<1       | 2.9        | ND<1                 | ND<1              | ND<1        | 2.01              | 0.024                 | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 12-Jan-06                | ND<1       | ND<1       | 1.4        | ND<1                 | ND<1              | ND<1        | 2.36              | 0.0905                | ND<1                      | ND<1                          | ND<1                      | 4.9 *                                   | ND<1           | ND<1                        | ND<1                         |
|               | 14-Feb-06                | 2.1        | ND<1       | 1.8        | ND<1                 | ND<1              | ND<1        | 5.23              | ND<0.02               | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 7-Mar-06                 | 1.3        | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 3.41              | 0.333                 | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 12-Apr-06                | ND<1       | ND<1       | 2.2        | ND<1                 | ND<1              | ND<1        | 1.93              | 0.108                 | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 17-May-06                | ND<1       | ND<1       | ND<1       | ND<1                 | ND<1              | ND<1        | 1.64              | 0.054                 | ND<1                      | ND<1                          | ND<1                      | ND<1                                    | ND<1           | ND<1                        | ND<1                         |
|               | 21-June-06 <sup>2/</sup> | NM         | NM         | NM         | NM                   | NM                | NM          | NM                | NM                    | NM                        | NM                            | NM                        | NM                                      | NM             | NM                          | NM                           |

ND: Not detected

<#: Less than method detection limit

ug/L: Micrograms per liter

-: Not analyzed

ARAR's are chemical specific aquifer restoration goals for ground water at the Former Rowe Industries Superfund Site.

Bold values indicate an exceedance of the ARAR standard established for the site.

PCE: Tetrachloroethylene

TCE: Trichloroethene

TCA: 1,1,1-Trichloroethane

1,1-DCA: 1,1-Dichloroethane

1,1-DCE: 1,1-Dichloroethene

1,2-DCE: 1,2-Dichloroethene

MTBE: Methyl Tertiary Butyl Ether

NM: Not Measured

NE indicates that the ARAR goal was not established for this compound by the EPA.

\*Concentrations with an asterisk following them are due to laboratory contamination.


<sup>1/</sup> RW-3 is currently non operational weighting for the reprogramming of the drive for the new 4 amp pump.

<sup>2/</sup> RW-9 was being rehabilitated during this sampling event, thus no water sample was collected.

## GRAPHS


**GRAPH 1**  
**GROUND-WATER REMEDIAL ACTION**  
**ROWE INDUSTRIES SUPERFUND SITE**  
**SAG HARBOR, NEW YORK**

**EFFLUENT FLOW DATA**  
(June 1, 2006 through June 31, 2006)

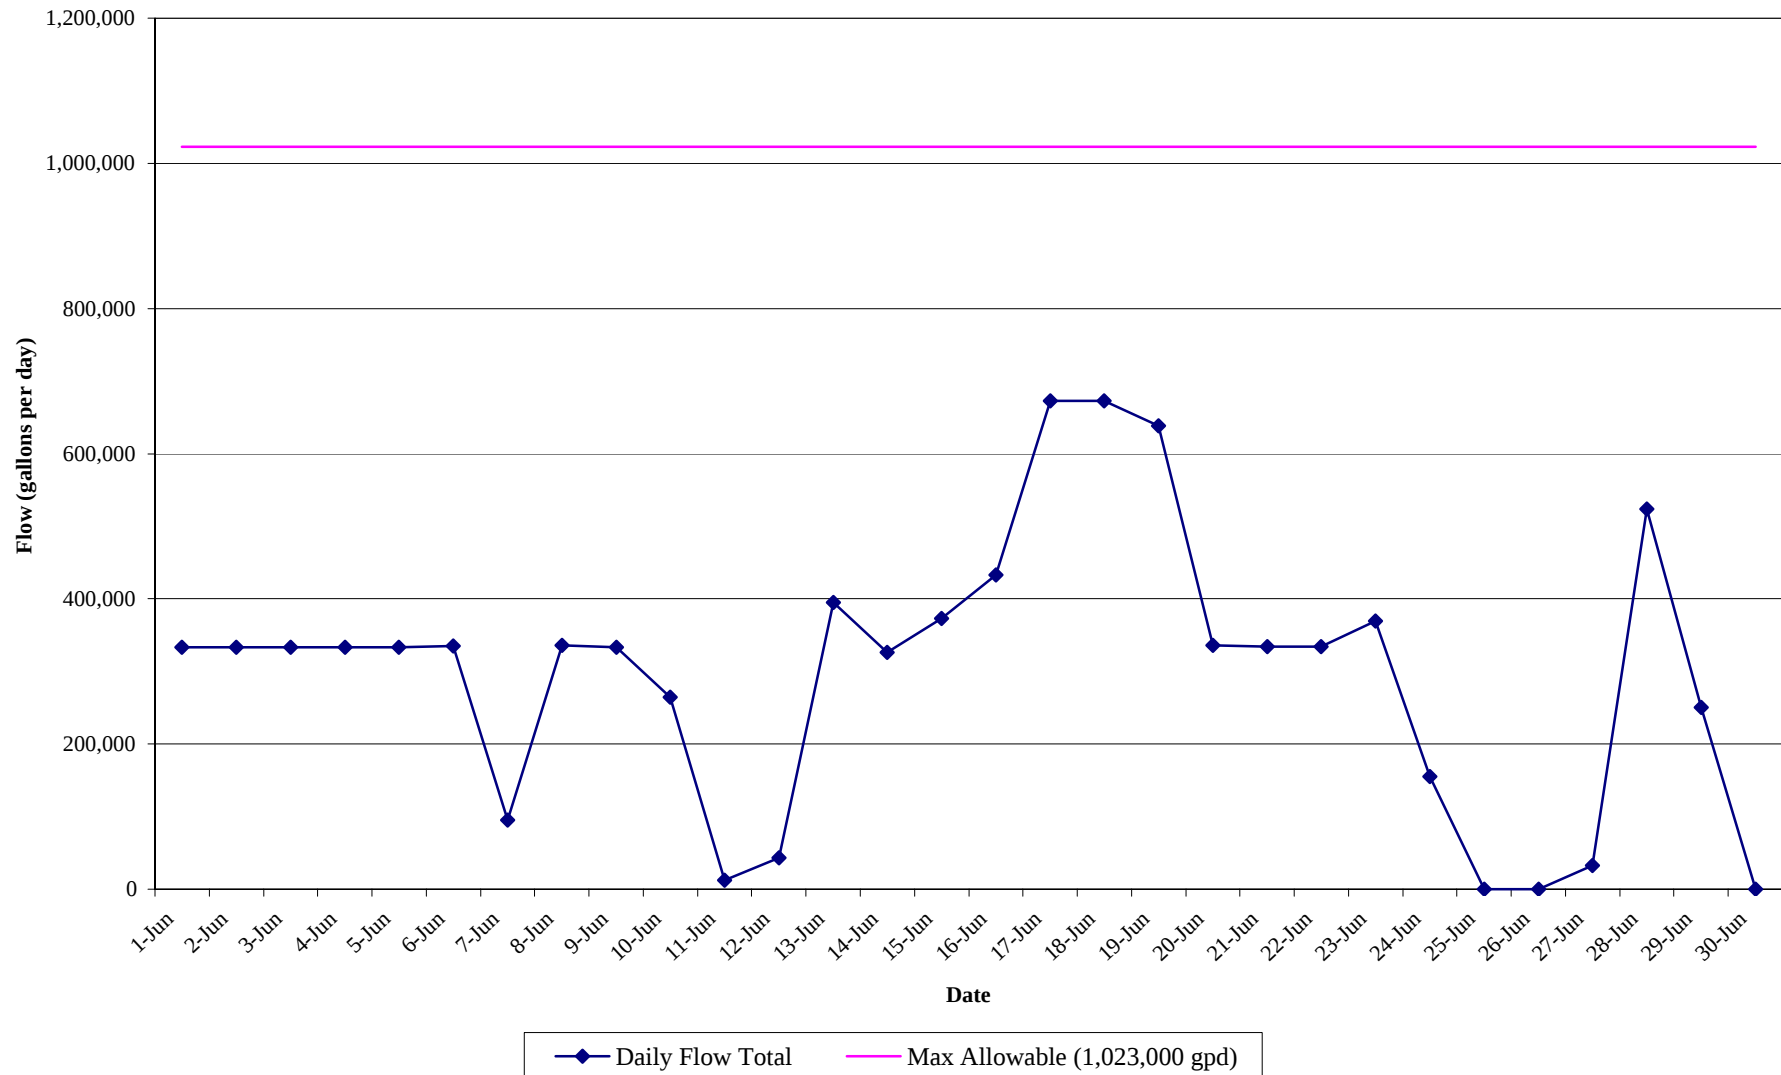


**GRAPH 2**  
GROUND-WATER REMEDIAL ACTION  
ROWE INDUSTRIES SUPERFUND SITE  
SAG HARBOR, NEW YORK


**RECOVERY WELL PCE CONCENTRATION IN MICROGRAMS PER LITER**

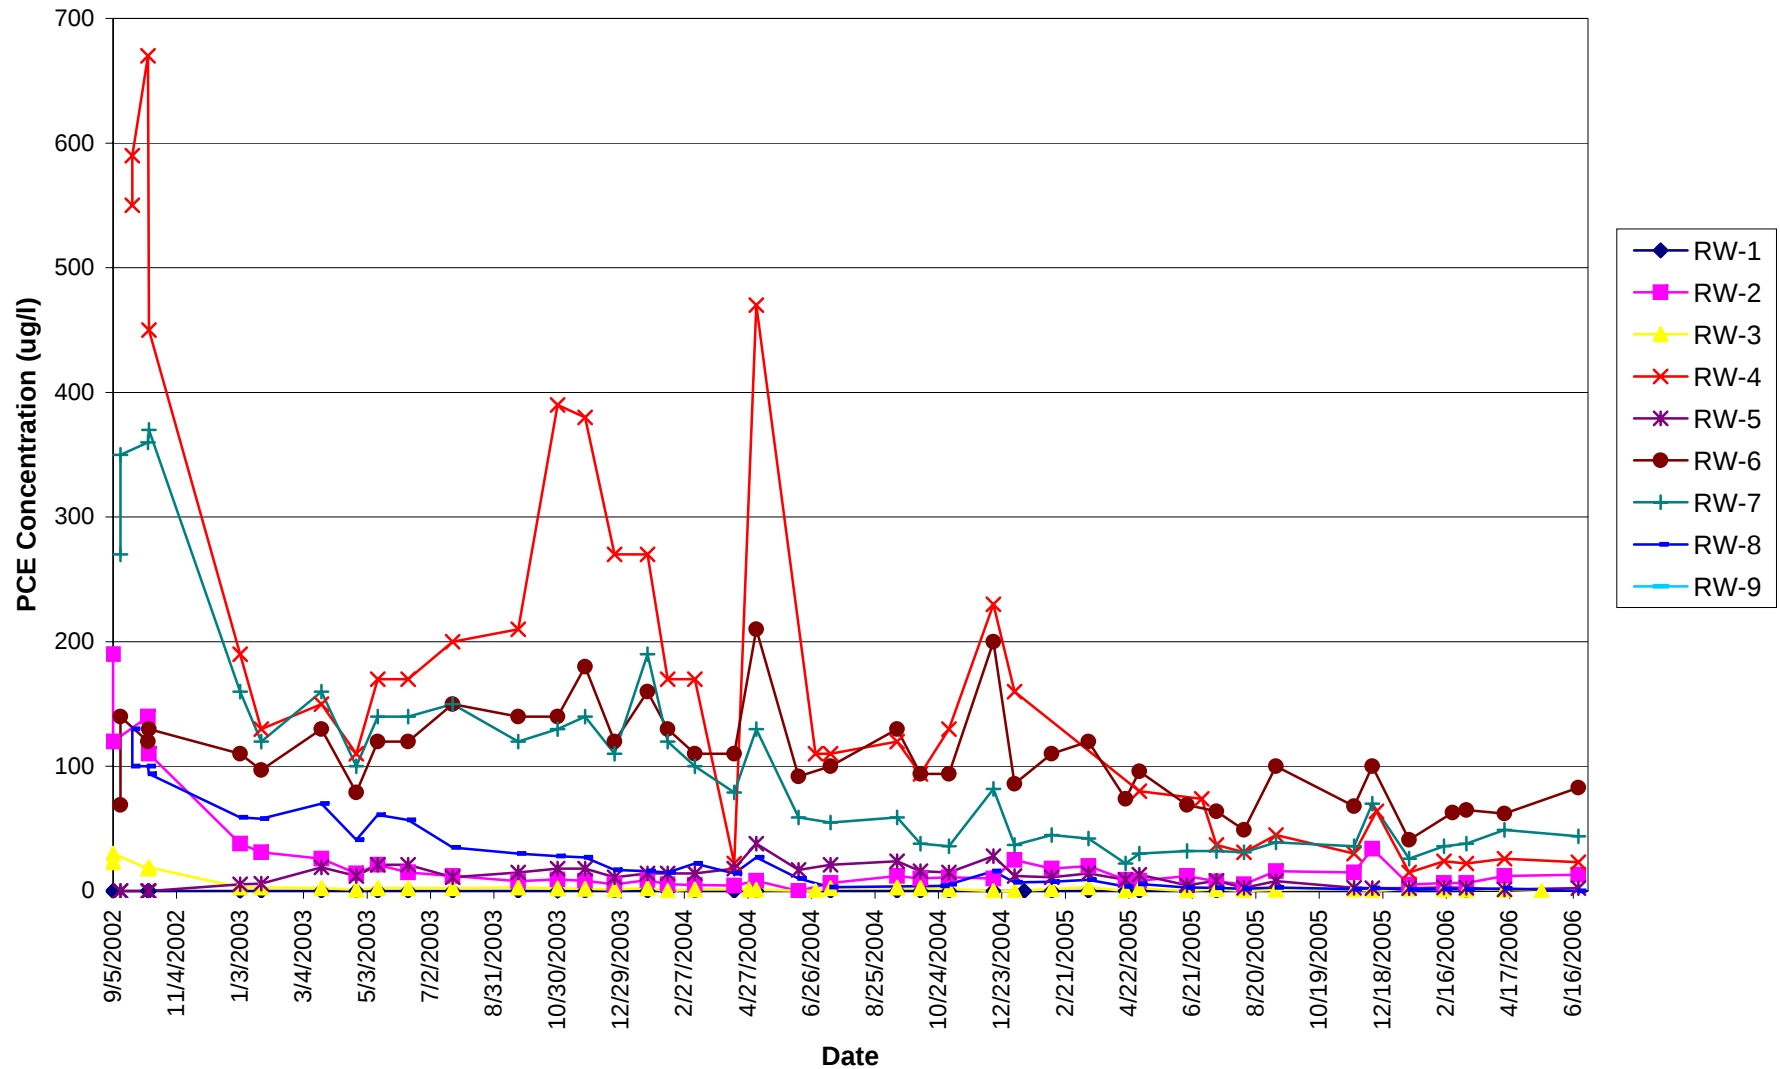

**GRAPH 3**  
GROUND-WATER REMEDIAL ACTION  
ROWE INDUSTRIES SUPERFUND SITE  
SAG HARBOR, NEW YORK

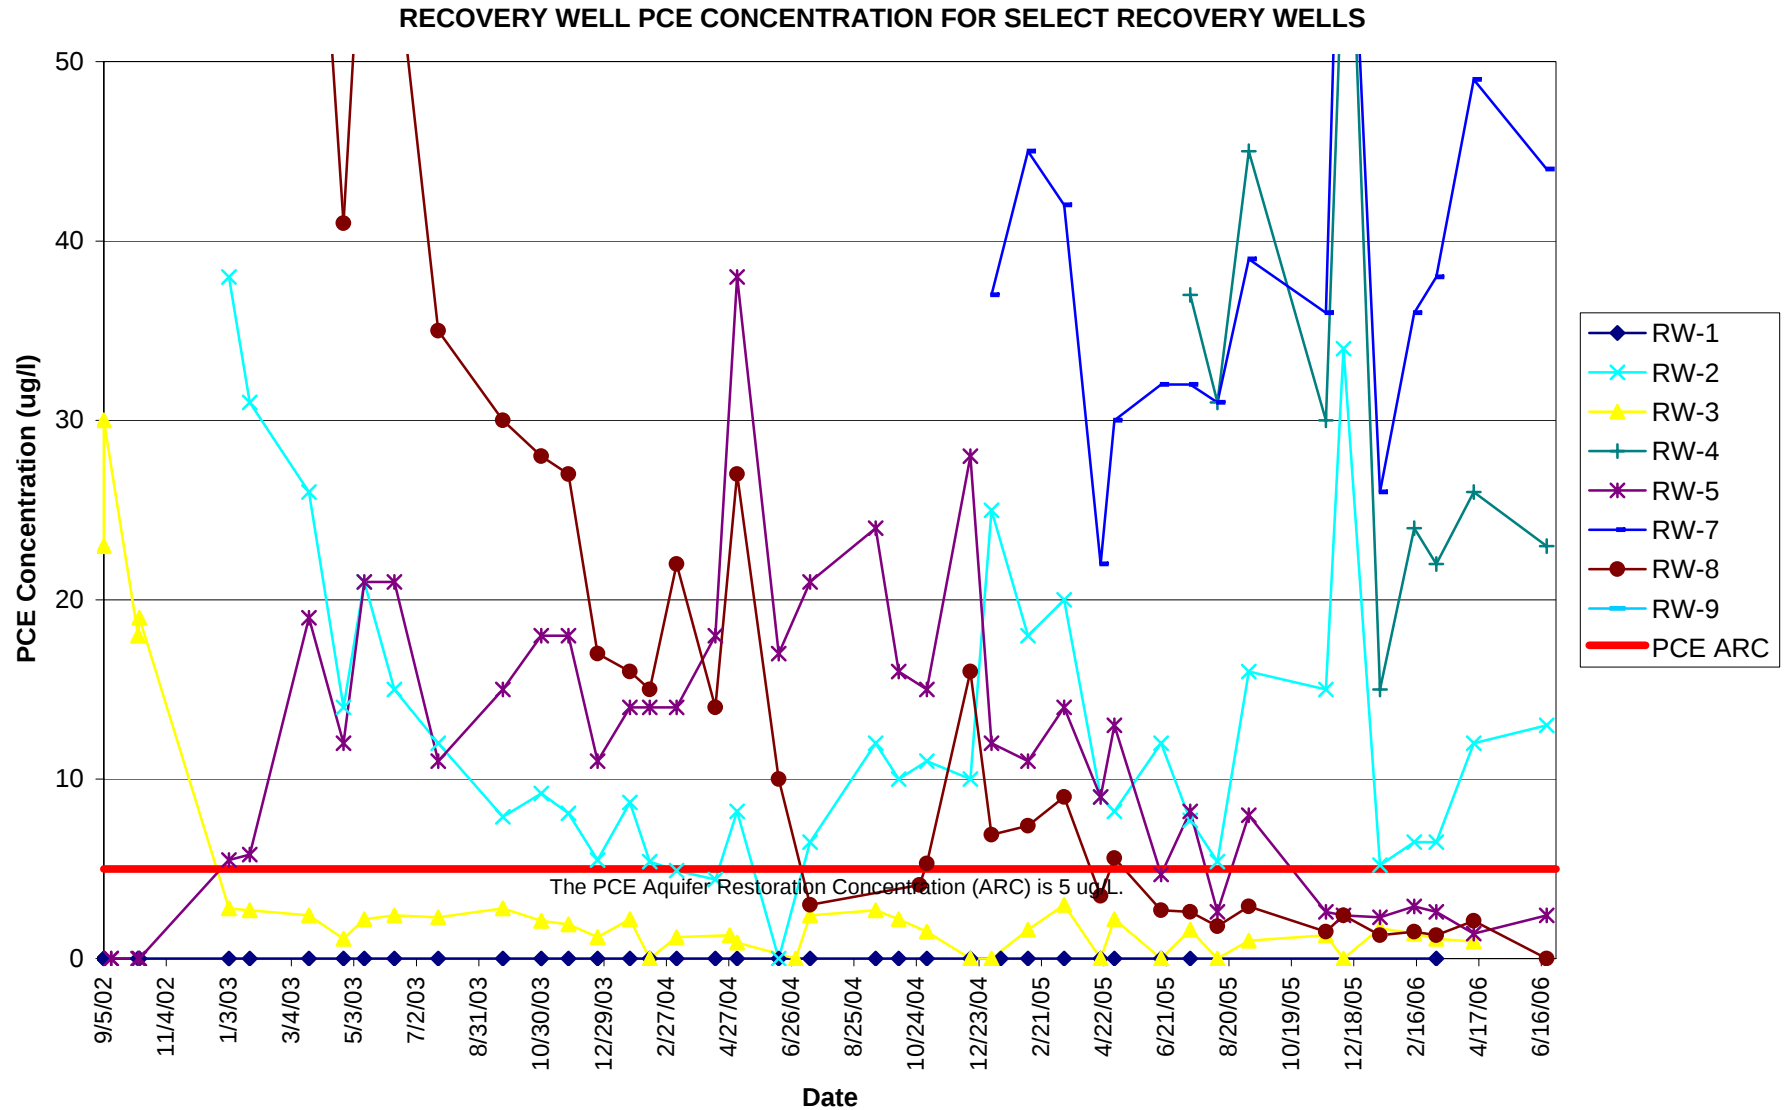

**APPENDIX I**  
**JUNE 2006 LABORATORY ANALYTICAL REPORTS**

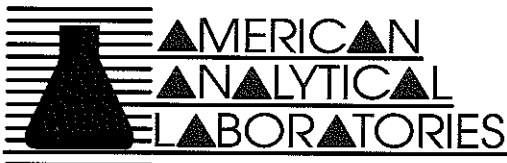

NYSDOH 11418  
NJDEP NY050  
CTDOH PH-0205  
PADEP 68-00573

Thursday, June 15, 2006

Mark Goldberg  
Leggette Brashears & Graham Inc.  
4 Research Drive  
Suite 301  
Shelton, CT 06484

TEL: (203) 929-8555

FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0606097

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 6/9/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at [lbeyer@american-analytical.com](mailto:lbeyer@american-analytical.com).

Sincerely,

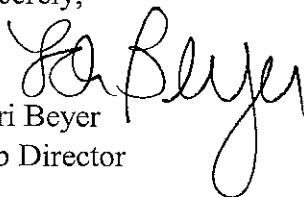  
Lori Beyer  
Lab Director

**American Analytical Laboratories, LLC.**

Date: 15-Jun-06

---

**CLIENT:** Leggette Brashears & Graham Inc.  
**Project:** Rowe Industries  
**Lab Order:** 0606097

---

**Work Order Sample Summary**

---

| Lab Sample ID | Client Sample ID    | Tag Number | Date Collected | Date Received |
|---------------|---------------------|------------|----------------|---------------|
| 0606097-01A   | WQ060706:825 NP2-6  |            | 6/7/2006       | 6/9/2006      |
| 0606097-01B   | WQ060706:825 NP2-6  |            | 6/7/2006       | 6/9/2006      |
| 0606097-01C   | WQ060706:825 NP2-6  |            | 6/7/2006       | 6/9/2006      |
| 0606097-02A   | WQ060706:830 NP2-7  |            | 6/7/2006       | 6/9/2006      |
| 0606097-02B   | WQ060706:830 NP2-7  |            | 6/7/2006       | 6/9/2006      |
| 0606097-02C   | WQ060706:830 NP2-7  |            | 6/7/2006       | 6/9/2006      |
| 0606097-03A   | WQ060706:820 NP2-10 |            | 6/7/2006       | 6/9/2006      |
| 0606097-03B   | WQ060706:820 NP2-10 |            | 6/7/2006       | 6/9/2006      |
| 0606097-03C   | WQ060706:820 NP2-10 |            | 6/7/2006       | 6/9/2006      |

---

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

## **AMERICAN ANALYTICAL LABORATORIES, LLC**

**56 TOLEDO STREET**

**FARMINGDALE, NEW YORK 11735**

**TELEPHONE: (631) 454-6100      FAX: (631) 454-8027**

### **DATA REPORTING QUALIFIERS**

For reporting results, the following "Results Qualifiers" are used:

|              |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
|--------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Value</b> | If the result is greater than or equal to the detection limit, report the value                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
| <b>U</b>     | Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.                                                                                                                                                                                                                                                                                           |
| <b>J</b>     | Indicates an estimated value. The flag is used:<br><ol style="list-style-type: none"><li>(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)</li><li>(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.</li></ol> |
| <b>B</b>     | Indicates the analyte was found in the blank as well as the sample report "10B".                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   |
| <b>E</b>     | Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
| <b>D</b>     | This flag identifies all compounds identified in an analysis at a secondary dilution factor.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |
| <b>P</b>     | This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".                                                                                                                                                                                                                                                                                                                                                                              |
| <b>N</b>     | This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.                                                                                                                                                                                                                                                                           |
| <b>H</b>     | Indicates sample was received and/or analyzed outside of The method allowable holding time                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         |

# American Analytical Laboratories, LLC.

Date: 15-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606097  
**Project:** Rowe Industries  
**Lab ID:** 0606097-01A

**Client Sample ID:** WQ060706:825 NP2-6  
**Tag Number:**  
**Collection Date:** 6/7/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units          | DF | Date Analyzed        |
|-----------------------------------------------------|--------|----------------|------|----------------|----|----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | <b>SW5030A</b> |    | <b>Analyst: LDS</b>  |
| 1,1,1,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 1,1,1-Trichloroethane                               | 2.8    | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 1,1,2,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 1,1,2-Trichloro-1,2,2-trifluoroethane               | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 1,1,2-Trichloroethane                               | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 1,1-Dichloroethane                                  | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 1,1-Dichloroethene                                  | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 1,1-Dichloropropene                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 1,2,3-Trichlorobenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 1,2,3-Trichloropropane                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 1,2,4-Trichlorobenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 1,2,4-Trimethylbenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 1,2-Dibromo-3-chloropropane                         | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 1,2-Dibromoethane                                   | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 1,2-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 1,2-Dichloroethane                                  | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 1,2-Dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 1,3,5-Trimethylbenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 1,3-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 1,3-dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 1,4-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 2,2-Dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 2-Butanone                                          | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 2-Chloroethyl vinyl ether                           | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 2-Chlorotoluene                                     | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 2-Hexanone                                          | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 4-Chlorotoluene                                     | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 4-Isopropyltoluene                                  | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| 4-Methyl-2-pentanone                                | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Acetone                                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Benzene                                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Bromobenzene                                        | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Bromochloromethane                                  | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Bromodichloromethane                                | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Bromoform                                           | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Bromomethane                                        | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Carbon disulfide                                    | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Carbon tetrachloride                                | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Chlorobenzene                                       | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

# American Analytical Laboratories, LLC.

Date: 15-Jun-06

|                   |                                  |                          |                    |
|-------------------|----------------------------------|--------------------------|--------------------|
| <b>CLIENT:</b>    | Leggette Brashears & Graham Inc. | <b>Client Sample ID:</b> | WQ060706:825 NP2-6 |
| <b>Lab Order:</b> | 0606097                          | <b>Tag Number:</b>       |                    |
| <b>Project:</b>   | Rowe Industries                  | <b>Collection Date:</b>  | 6/7/2006           |
| <b>Lab ID:</b>    | 0606097-01A                      | <b>Matrix:</b>           | LIQUID             |

| Analyses                                            | Result | Limit          | Qual | Units          | DF | Date Analyzed        |
|-----------------------------------------------------|--------|----------------|------|----------------|----|----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | <b>SW5030A</b> |    | <b>Analyst: LDS</b>  |
| Chloroethane                                        | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Chloroform                                          | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Chloromethane                                       | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| cis-1,2-Dichloroethene                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| cis-1,3-Dichloropropene                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Dibromochloromethane                                | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Dibromomethane                                      | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Dichlorodifluoromethane                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Ethylbenzene                                        | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Hexachlorobutadiene                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Isopropylbenzene                                    | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| m,p-Xylene                                          | U      | 2.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Methyl tert-butyl ether                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Methylene chloride                                  | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Naphthalene                                         | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| n-Butylbenzene                                      | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| n-Propylbenzene                                     | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| o-Xylene                                            | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| sec-Butylbenzene                                    | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Styrene                                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| tert-Butylbenzene                                   | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Tetrachloroethene                                   | 16     | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Toluene                                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| trans-1,2-Dichloroethene                            | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| trans-1,3-Dichloropropene                           | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Trichloroethene                                     | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Trichlorofluoromethane                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Vinyl acetate                                       | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |
| Vinyl chloride                                      | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:00:00 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**

Date: 15-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606097  
**Project:** Rowe Industries  
**Lab ID:** 0606097-01B

**Client Sample ID:** WQ060706:825 NP2-6  
**Tag Number:**  
**Collection Date:** 6/7/2006  
**Matrix:** LIQUID

| Analyses          | Result | Limit         | Qual | Units          | DF | Date Analyzed        |
|-------------------|--------|---------------|------|----------------|----|----------------------|
| <b>TOTAL IRON</b> |        | <b>E200.7</b> |      | <b>SW3010A</b> |    | <b>Analyst: JP</b>   |
| Iron              | 3.83   | 0.0200        |      | mg/L           | 1  | 6/13/2006 2:22:35 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.****Date:** 15-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606097  
**Project:** Rowe Industries  
**Lab ID:** 0606097-01C

**Client Sample ID:** WQ060706:825 NP2-6  
**Tag Number:**  
**Collection Date:** 6/7/2006  
**Matrix:** LIQUID

| Analyses       | Result | Limit  | Qual | Units   | DF | Date Analyzed        |
|----------------|--------|--------|------|---------|----|----------------------|
| DISSOLVED IRON |        | E200.7 |      | SW3005A |    | Analyst: JP          |
| Iron           | 0.0980 | 0.0200 |      | mg/L    | 1  | 6/13/2006 2:20:00 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

# American Analytical Laboratories, LLC.

Date: 15-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606097  
**Project:** Rowe Industries  
**Lab ID:** 0606097-02A

**Client Sample ID:** WQ060706:830 NP2-7  
**Tag Number:**  
**Collection Date:** 6/7/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units          | DF | Date Analyzed        |
|-----------------------------------------------------|--------|----------------|------|----------------|----|----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | <b>SW5030A</b> |    | <b>Analyst: LDS</b>  |
| 1,1,1,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 1,1,1-Trichloroethane                               | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 1,1,2,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 1,1,2-Trichloro-1,2,2-trifluoroethane               | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 1,1,2-Trichloroethane                               | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 1,1-Dichloroethane                                  | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 1,1-Dichloroethene                                  | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 1,1-Dichloropropene                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 1,2,3-Trichlorobenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 1,2,3-Trichloropropane                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 1,2,4-Trichlorobenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 1,2,4-Trimethylbenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 1,2-Dibromo-3-chloropropane                         | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 1,2-Dibromoethane                                   | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 1,2-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 1,2-Dichloroethane                                  | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 1,2-Dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 1,3,5-Trimethylbenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 1,3-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 1,3-dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 1,4-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 2,2-Dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 2-Butanone                                          | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 2-Chloroethyl vinyl ether                           | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 2-Chlorotoluene                                     | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 2-Hexanone                                          | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 4-Chlorotoluene                                     | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 4-Isopropyltoluene                                  | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| 4-Methyl-2-pentanone                                | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Acetone                                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Benzene                                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Bromobenzene                                        | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Bromochloromethane                                  | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Bromodichloromethane                                | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Bromoform                                           | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Bromomethane                                        | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Carbon disulfide                                    | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Carbon tetrachloride                                | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Chlorobenzene                                       | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

# American Analytical Laboratories, LLC.

Date: 15-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606097  
**Project:** Rowe Industries  
**Lab ID:** 0606097-02A

**Client Sample ID:** WQ060706:830 NP2-7  
**Tag Number:**  
**Collection Date:** 6/7/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units          | DF | Date Analyzed        |
|-----------------------------------------------------|--------|----------------|------|----------------|----|----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | <b>SW5030A</b> |    | <b>Analyst: LDS</b>  |
| Chloroethane                                        | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Chloroform                                          | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Chloromethane                                       | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| cis-1,2-Dichloroethene                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| cis-1,3-Dichloropropene                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Dibromochloromethane                                | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Dibromomethane                                      | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Dichlorodifluoromethane                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Ethylbenzene                                        | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Hexachlorobutadiene                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Isopropylbenzene                                    | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| m,p-Xylene                                          | U      | 2.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Methyl tert-butyl ether                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Methylene chloride                                  | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Naphthalene                                         | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| n-Butylbenzene                                      | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| n-Propylbenzene                                     | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| o-Xylene                                            | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| sec-Butylbenzene                                    | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Styrene                                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| tert-Butylbenzene                                   | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Tetrachloroethene                                   | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Toluene                                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| trans-1,2-Dichloroethene                            | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| trans-1,3-Dichloropropene                           | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Trichloroethene                                     | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Trichlorofluoromethane                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Vinyl acetate                                       | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |
| Vinyl chloride                                      | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 10:38:00 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.****Date:** 15-Jun-06**CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** WQ060706:830 NP2-7**Lab Order:** 0606097**Tag Number:****Project:** Rowe Industries**Collection Date:** 6/7/2006**Lab ID:** 0606097-02B**Matrix:** LIQUID

| Analyses          | Result | Limit         | Qual | Units          | DF | Date Analyzed        |
|-------------------|--------|---------------|------|----------------|----|----------------------|
| <b>TOTAL IRON</b> |        | <b>E200.7</b> |      | <b>SW3010A</b> |    | Analyst: <b>JP</b>   |
| Iron              | 1.27   | 0.0200        |      | mg/L           | 1  | 6/13/2006 2:27:06 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**

Date: 15-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606097  
**Project:** Rowe Industries  
**Lab ID:** 0606097-02C

**Client Sample ID:** WQ060706:830 NP2-7  
**Tag Number:**  
**Collection Date:** 6/7/2006  
**Matrix:** LIQUID

| Analyses                      | Result | Limit            | Qual | Units           | DF | Date Analyzed                       |
|-------------------------------|--------|------------------|------|-----------------|----|-------------------------------------|
| <b>DISSOLVED IRON</b><br>Iron | 0.0570 | E200.7<br>0.0200 |      | SW3005A<br>mg/L | 1  | Analyst: JP<br>6/13/2006 2:24:48 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

# American Analytical Laboratories, LLC.

Date: 15-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606097  
**Project:** Rowe Industries  
**Lab ID:** 0606097-03A

**Client Sample ID:** WQ060706:820 NP2-10  
**Tag Number:**  
**Collection Date:** 6/7/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units          | DF | Date Analyzed        |
|-----------------------------------------------------|--------|----------------|------|----------------|----|----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | <b>SW5030A</b> |    | <b>Analyst: LDS</b>  |
| 1,1,1,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 1,1,1-Trichloroethane                               | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 1,1,2,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 1,1,2-Trichloro-1,2,2-trifluoroethane               | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 1,1,2-Trichloroethane                               | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 1,1-Dichloroethane                                  | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 1,1-Dichloroethene                                  | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 1,1-Dichloropropene                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 1,2,3-Trichlorobenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 1,2,3-Trichloropropane                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 1,2,4-Trichlorobenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 1,2,4-Trimethylbenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 1,2-Dibromo-3-chloropropane                         | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 1,2-Dibromoethane                                   | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 1,2-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 1,2-Dichloroethane                                  | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 1,2-Dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 1,3,5-Trimethylbenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 1,3-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 1,3-dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 1,4-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 2,2-Dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 2-Butanone                                          | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 2-Chloroethyl vinyl ether                           | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 2-Chlorotoluene                                     | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 2-Hexanone                                          | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 4-Chlorotoluene                                     | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 4-Isopropyltoluene                                  | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| 4-Methyl-2-pentanone                                | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Acetone                                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Benzene                                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Bromobenzene                                        | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Bromochloromethane                                  | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Bromodichloromethane                                | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Bromoform                                           | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Bromomethane                                        | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Carbon disulfide                                    | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Carbon tetrachloride                                | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Chlorobenzene                                       | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

# American Analytical Laboratories, LLC.

Date: 15-Jun-06

|                   |                                  |                          |                     |
|-------------------|----------------------------------|--------------------------|---------------------|
| <b>CLIENT:</b>    | Leggette Brashears & Graham Inc. | <b>Client Sample ID:</b> | WQ060706:820 NP2-10 |
| <b>Lab Order:</b> | 0606097                          | <b>Tag Number:</b>       |                     |
| <b>Project:</b>   | Rowe Industries                  | <b>Collection Date:</b>  | 6/7/2006            |
| <b>Lab ID:</b>    | 0606097-03A                      | <b>Matrix:</b>           | LIQUID              |

| Analyses                                            | Result | Limit          | Qual | Units          | DF | Date Analyzed        |
|-----------------------------------------------------|--------|----------------|------|----------------|----|----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | <b>SW5030A</b> |    | <b>Analyst: LDS</b>  |
| Chloroethane                                        | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Chloroform                                          | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Chloromethane                                       | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| cis-1,2-Dichloroethene                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| cis-1,3-Dichloropropene                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Dibromochloromethane                                | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Dibromomethane                                      | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Dichlorodifluoromethane                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Ethylbenzene                                        | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Hexachlorobutadiene                                 | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Isopropylbenzene                                    | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| m,p-Xylene                                          | U      | 2.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Methyl tert-butyl ether                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Methylene chloride                                  | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Naphthalene                                         | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| n-Butylbenzene                                      | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| n-Propylbenzene                                     | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| o-Xylene                                            | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| sec-Butylbenzene                                    | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Styrene                                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| tert-Butylbenzene                                   | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Tetrachloroethene                                   | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Toluene                                             | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| trans-1,2-Dichloroethene                            | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| trans-1,3-Dichloropropene                           | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Trichloroethene                                     | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Trichlorofluoromethane                              | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Vinyl acetate                                       | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |
| Vinyl chloride                                      | U      | 1.0            |      | µg/L           | 1  | 6/9/2006 11:16:00 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**

Date: 15-Jun-06

|                   |                                  |                          |                     |
|-------------------|----------------------------------|--------------------------|---------------------|
| <b>CLIENT:</b>    | Leggette Brashears & Graham Inc. | <b>Client Sample ID:</b> | WQ060706:820 NP2-10 |
| <b>Lab Order:</b> | 0606097                          | <b>Tag Number:</b>       |                     |
| <b>Project:</b>   | Rowe Industries                  | <b>Collection Date:</b>  | 6/7/2006            |
| <b>Lab ID:</b>    | 0606097-03B                      | <b>Matrix:</b>           | LIQUID              |

| Analyses          | Result | Limit         | Qual | Units          | DF | Date Analyzed        |
|-------------------|--------|---------------|------|----------------|----|----------------------|
| <b>TOTAL IRON</b> |        | <b>E200.7</b> |      | <b>SW3010A</b> |    | Analyst: <b>JP</b>   |
| Iron              | 1.26   | 0.0200        |      | mg/L           | 1  | 6/13/2006 2:35:04 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**


Date: 15-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606097  
**Project:** Rowe Industries  
**Lab ID:** 0606097-03C

**Client Sample ID:** WQ060706:820 NP2-10  
**Tag Number:**  
**Collection Date:** 6/7/2006  
**Matrix:** LIQUID

| Analyses                                     | Result | Limit         | Qual | Units          | DF | Date Analyzed        |
|----------------------------------------------|--------|---------------|------|----------------|----|----------------------|
| <b>DISSOLVED IRON</b>                        |        | <b>E200.7</b> |      | <b>SW3005A</b> |    | Analyst: <b>JP</b>   |
| Iron                                         | 0.0680 | 0.0200        |      | mg/L           | 1  | 6/13/2006 2:29:10 PM |
| <b>TOTAL DISSOLVED SOLIDS</b>                |        | <b>E160.1</b> |      |                |    | Analyst: <b>VP</b>   |
| Total Dissolved Solids (Residue, Filterable) | 82.0   | 1.00          |      | mg/L           | 1  | 6/9/2006             |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

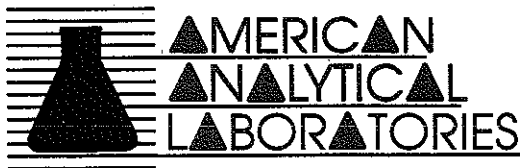

NYSDOH 11418  
NJDEP NY050  
CTDOH PH-0205  
PADEP 68-00573

Friday, June 23, 2006

Mark Goldberg  
Leggette Brashears & Graham Inc.  
4 Research Drive  
Suite 301  
Shelton, CT 06484

TEL: (203) 929-8555  
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0606171

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 6/16/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at [lbeyer@american-analytical.com](mailto:lbeyer@american-analytical.com).

Sincerely,

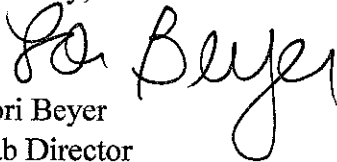  
Lori Beyer  
Lab Director

**American Analytical Laboratories, LLC.****Date:** 23-Jun-06**CLIENT:** Leggette Brashears & Graham Inc.**Project:** Rowe Industries**Lab Order:** 0606171**Work Order Sample Summary**

| Lab Sample ID | Client Sample ID    | Tag Number | Date Collected | Date Received |
|---------------|---------------------|------------|----------------|---------------|
| 0606171-01A   | WQ061406:800 NP2-6  | 10265      | 6/14/2006      | 6/16/2006     |
| 0606171-01B   | WQ061406:800 NP2-6  | 10265      | 6/14/2006      | 6/16/2006     |
| 0606171-01C   | WQ061406:800 NP2-6  | 10265      | 6/14/2006      | 6/16/2006     |
| 0606171-02A   | WQ061406:805 NP2-7  | 10265      | 6/14/2006      | 6/16/2006     |
| 0606171-02B   | WQ061406:805 NP2-7  | 10265      | 6/14/2006      | 6/16/2006     |
| 0606171-02C   | WQ061406:805 NP2-7  | 10265      | 6/14/2006      | 6/16/2006     |
| 0606171-03A   | WQ061406:810 NP2-10 | 10265      | 6/14/2006      | 6/16/2006     |
| 0606171-03B   | WQ061406:810 NP2-10 | 10265      | 6/14/2006      | 6/16/2006     |
| 0606171-03C   | WQ061406:810 NP2-10 | 10265      | 6/14/2006      | 6/16/2006     |

**CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT**

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

## **AMERICAN ANALYTICAL LABORATORIES, LLC**

**56 TOLEDO STREET**

**FARMINGDALE, NEW YORK 11735**

**TELEPHONE: (631) 454-6100      FAX: (631) 454-8027**

### **DATA REPORTING QUALIFIERS**

For reporting results, the following "Results Qualifiers" are used:

|              |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
|--------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Value</b> | If the result is greater than or equal to the detection limit, report the value                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
| <b>U</b>     | Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.                                                                                                                                                                                                                                                                                           |
| <b>J</b>     | Indicates an estimated value. The flag is used:<br><ol style="list-style-type: none"><li>(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)</li><li>(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.</li></ol> |
| <b>B</b>     | Indicates the analyte was found in the blank as well as the sample report "10B".                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   |
| <b>E</b>     | Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
| <b>D</b>     | This flag identifies all compounds identified in an analysis at a secondary dilution factor.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |
| <b>P</b>     | This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".                                                                                                                                                                                                                                                                                                                                                                              |
| <b>N</b>     | This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.                                                                                                                                                                                                                                                                           |
| <b>H</b>     | Indicates sample was received and/or analyzed outside of The method allowable holding time                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         |

# American Analytical Laboratories, LLC.

Date: 23-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606171  
**Project:** Rowe Industries  
**Lab ID:** 0606171-01A

**Client Sample ID:** WQ061406:800 NP2-6  
**Tag Number:** 10265  
**Collection Date:** 6/14/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units          | DF | Date Analyzed        |
|-----------------------------------------------------|--------|----------------|------|----------------|----|----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | <b>SW5030A</b> |    | Analyst: MMR         |
| 1,1,1,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 1,1,1-Trichloroethane                               | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 1,1,2,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 1,1,2-Trichloro-1,2,2-trifluoroethane               | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 1,1,2-Trichloroethane                               | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 1,1-Dichloroethane                                  | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 1,1-Dichloroethene                                  | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 1,1-Dichloropropene                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 1,2,3-Trichlorobenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 1,2,3-Trichloropropane                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 1,2,4-Trichlorobenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 1,2,4-Trimethylbenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 1,2-Dibromo-3-chloropropane                         | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 1,2-Dibromoethane                                   | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 1,2-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 1,2-Dichloroethane                                  | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 1,2-Dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 1,3,5-Trimethylbenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 1,3-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 1,3-dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 1,4-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 2,2-Dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 2-Butanone                                          | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 2-Chloroethyl vinyl ether                           | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 2-Chlorotoluene                                     | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 2-Hexanone                                          | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 4-Chlorotoluene                                     | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 4-Isopropyltoluene                                  | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| 4-Methyl-2-pentanone                                | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Acetone                                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Benzene                                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Bromobenzene                                        | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Bromochloromethane                                  | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Bromodichloromethane                                | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Bromoform                                           | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Bromomethane                                        | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Carbon disulfide                                    | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Carbon tetrachloride                                | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Chlorobenzene                                       | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

# American Analytical Laboratories, LLC.

Date: 23-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606171  
**Project:** Rowe Industries  
**Lab ID:** 0606171-01A

**Client Sample ID:** WQ061406:800 NP2-6  
**Tag Number:** 10265  
**Collection Date:** 6/14/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units          | DF | Date Analyzed        |
|-----------------------------------------------------|--------|----------------|------|----------------|----|----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | <b>SW5030A</b> |    | <b>Analyst: MMR</b>  |
| Chloroethane                                        | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Chloroform                                          | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Chloromethane                                       | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| cis-1,2-Dichloroethene                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| cis-1,3-Dichloropropene                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Dibromochloromethane                                | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Dibromomethane                                      | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Dichlorodifluoromethane                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Ethylbenzene                                        | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Hexachlorobutadiene                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Isopropylbenzene                                    | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| m,p-Xylene                                          | U      | 2.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Methyl tert-butyl ether                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Methylene chloride                                  | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Naphthalene                                         | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| n-Butylbenzene                                      | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| n-Propylbenzene                                     | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| o-Xylene                                            | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| sec-Butylbenzene                                    | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Styrene                                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| tert-Butylbenzene                                   | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Tetrachloroethene                                   | 22     | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Toluene                                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| trans-1,2-Dichloroethene                            | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| trans-1,3-Dichloropropene                           | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Trichloroethene                                     | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Trichlorofluoromethane                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Vinyl acetate                                       | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |
| Vinyl chloride                                      | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 7:13:00 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**

Date: 23-Jun-06

|                   |                                  |                          |                    |
|-------------------|----------------------------------|--------------------------|--------------------|
| <b>CLIENT:</b>    | Leggette Brashears & Graham Inc. | <b>Client Sample ID:</b> | WQ061406:800 NP2-6 |
| <b>Lab Order:</b> | 0606171                          | <b>Tag Number:</b>       | 10265              |
| <b>Project:</b>   | Rowe Industries                  | <b>Collection Date:</b>  | 6/14/2006          |
| <b>Lab ID:</b>    | 0606171-01B                      | <b>Matrix:</b>           | LIQUID             |

| Analyses          | Result | Limit         | Qual | Units          | DF | Date Analyzed        |
|-------------------|--------|---------------|------|----------------|----|----------------------|
| <b>TOTAL IRON</b> |        | <b>E200.7</b> |      | <b>SW3010A</b> |    | Analyst: JP          |
| Iron              | 1.19   | 0.0200        |      | mg/L           | 1  | 6/20/2006 1:00:25 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**

Date: 23-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** WQ061406:800 NP2-6**Lab Order:** 0606171**Tag Number:** 10265**Project:** Rowe Industries**Collection Date:** 6/14/2006**Lab ID:** 0606171-01C**Matrix:** LIQUID

| Analyses       | Result | Limit  | Qual | Units   | DF | Date Analyzed         |
|----------------|--------|--------|------|---------|----|-----------------------|
| DISSOLVED IRON |        | E200.7 |      | SW3005A |    | Analyst: JP           |
| Iron           | 0.0700 | 0.0200 |      | mg/L    | 1  | 6/20/2006 12:56:21 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |
|                    |    |                                                          |   |                                                 |

# American Analytical Laboratories, LLC.

Date: 23-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606171  
**Project:** Rowe Industries  
**Lab ID:** 0606171-02A

**Client Sample ID:** WQ061406:805 NP2-7  
**Tag Number:** 10265  
**Collection Date:** 6/14/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units          | DF | Date Analyzed        |
|-----------------------------------------------------|--------|----------------|------|----------------|----|----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | <b>SW5030A</b> |    | Analyst: MMR         |
| 1,1,1,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 1,1,1-Trichloroethane                               | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 1,1,2,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 1,1,2-Trichloro-1,2,2-trifluoroethane               | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 1,1,2-Trichloroethane                               | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 1,1-Dichloroethane                                  | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 1,1-Dichloroethene                                  | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 1,1-Dichloropropene                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 1,2,3-Trichlorobenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 1,2,3-Trichloropropane                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 1,2,4-Trichlorobenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 1,2,4-Trimethylbenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 1,2-Dibromo-3-chloropropane                         | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 1,2-Dibromoethane                                   | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 1,2-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 1,2-Dichloroethane                                  | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 1,2-Dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 1,3,5-Trimethylbenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 1,3-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 1,3-dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 1,4-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 2,2-Dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 2-Butanone                                          | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 2-Chloroethyl vinyl ether                           | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 2-Chlorotoluene                                     | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 2-Hexanone                                          | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 4-Chlorotoluene                                     | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 4-Isopropyltoluene                                  | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| 4-Methyl-2-pentanone                                | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Acetone                                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Benzene                                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Bromobenzene                                        | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Bromochloromethane                                  | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Bromodichloromethane                                | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Bromoform                                           | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Bromomethane                                        | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Carbon disulfide                                    | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Carbon tetrachloride                                | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Chlorobenzene                                       | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

# American Analytical Laboratories, LLC.

Date: 23-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606171  
**Project:** Rowe Industries  
**Lab ID:** 0606171-02A

**Client Sample ID:** WQ061406:805 NP2-7  
**Tag Number:** 10265  
**Collection Date:** 6/14/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units          | DF | Date Analyzed        |
|-----------------------------------------------------|--------|----------------|------|----------------|----|----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | <b>SW5030A</b> |    | Analyst: MMR         |
| Chloroethane                                        | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Chloroform                                          | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Chloromethane                                       | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| cis-1,2-Dichloroethene                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| cis-1,3-Dichloropropene                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Dibromochloromethane                                | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Dibromomethane                                      | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Dichlorodifluoromethane                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Ethylbenzene                                        | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Hexachlorobutadiene                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Isopropylbenzene                                    | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| m,p-Xylene                                          | U      | 2.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Methyl tert-butyl ether                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Methylene chloride                                  | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Naphthalene                                         | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| n-Butylbenzene                                      | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| n-Propylbenzene                                     | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| o-Xylene                                            | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| sec-Butylbenzene                                    | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Styrene                                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| tert-Butylbenzene                                   | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Tetrachloroethene                                   | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Toluene                                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| trans-1,2-Dichloroethene                            | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| trans-1,3-Dichloropropene                           | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Trichloroethene                                     | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Trichlorofluoromethane                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Vinyl acetate                                       | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |
| Vinyl chloride                                      | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:05:00 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**

Date: 23-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606171  
**Project:** Rowe Industries  
**Lab ID:** 0606171-02B

**Client Sample ID:** WQ061406:805 NP2-7  
**Tag Number:** 10265  
**Collection Date:** 6/14/2006  
**Matrix:** LIQUID

| Analyses          | Result | Limit         | Qual | Units          | DF | Date Analyzed        |
|-------------------|--------|---------------|------|----------------|----|----------------------|
| <b>TOTAL IRON</b> |        | <b>E200.7</b> |      | <b>SW3010A</b> |    | <b>Analyst: JP</b>   |
| Iron              | 1.73   | 0.0200        |      | mg/L           | 1  | 6/20/2006 1:05:50 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**

Date: 23-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606171  
**Project:** Rowe Industries  
**Lab ID:** 0606171-02C

**Client Sample ID:** WQ061406:805 NP2-7  
**Tag Number:** 10265  
**Collection Date:** 6/14/2006  
**Matrix:** LIQUID

| Analyses       | Result | Limit  | Qual | Units   | DF | Date Analyzed        |
|----------------|--------|--------|------|---------|----|----------------------|
| DISSOLVED IRON |        | E200.7 |      | SW3005A |    | Analyst: JP          |
| Iron           | 0.0610 | 0.0200 |      | mg/L    | 1  | 6/20/2006 1:03:53 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |
|                    |    |                                                          |   |                                                 |

# American Analytical Laboratories, LLC.

Date: 23-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606171  
**Project:** Rowe Industries  
**Lab ID:** 0606171-03A

**Client Sample ID:** WQ061406:810 NP2-10  
**Tag Number:** 10265  
**Collection Date:** 6/14/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units          | DF | Date Analyzed        |
|-----------------------------------------------------|--------|----------------|------|----------------|----|----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | <b>SW5030A</b> |    | Analyst: MMR         |
| 1,1,1,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 1,1,1-Trichloroethane                               | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 1,1,2,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 1,1,2-Trichloro-1,2,2-trifluoroethane               | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 1,1,2-Trichloroethane                               | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 1,1-Dichloroethane                                  | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 1,1-Dichloroethene                                  | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 1,1-Dichloropropene                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 1,2,3-Trichlorobenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 1,2,3-Trichloropropane                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 1,2,4-Trichlorobenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 1,2,4-Trimethylbenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 1,2-Dibromo-3-chloropropane                         | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 1,2-Dibromoethane                                   | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 1,2-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 1,2-Dichloroethane                                  | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 1,2-Dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 1,3,5-Trimethylbenzene                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 1,3-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 1,3-dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 1,4-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 2,2-Dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 2-Butanone                                          | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 2-Chloroethyl vinyl ether                           | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 2-Chlorotoluene                                     | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 2-Hexanone                                          | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 4-Chlorotoluene                                     | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 4-Isopropyltoluene                                  | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| 4-Methyl-2-pentanone                                | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Acetone                                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Benzene                                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Bromobenzene                                        | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Bromochloromethane                                  | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Bromodichloromethane                                | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Bromoform                                           | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Bromomethane                                        | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Carbon disulfide                                    | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Carbon tetrachloride                                | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Chlorobenzene                                       | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |

**Qualifiers:**  
 B Analyte detected in the associated Method Blank  
 H Holding times for preparation or analysis exceeded  
 ND Not Detected at the Reporting Limit  
 U Indicates the compound was analyzed for but not detected

E Value above quantitation range  
 J Analyte detected below quantitation limits  
 S Spike Recovery outside accepted recovery limits  
 X Value exceeds Maximum Contaminant Level

# American Analytical Laboratories, LLC.

Date: 23-Jun-06

|                   |                                  |                          |                     |
|-------------------|----------------------------------|--------------------------|---------------------|
| <b>CLIENT:</b>    | Leggette Brashears & Graham Inc. | <b>Client Sample ID:</b> | WQ061406:810 NP2-10 |
| <b>Lab Order:</b> | 0606171                          | <b>Tag Number:</b>       | 10265               |
| <b>Project:</b>   | Rowe Industries                  | <b>Collection Date:</b>  | 6/14/2006           |
| <b>Lab ID:</b>    | 0606171-03A                      | <b>Matrix:</b>           | LIQUID              |

| Analyses                                            | Result | Limit          | Qual | Units          | DF | Date Analyzed        |
|-----------------------------------------------------|--------|----------------|------|----------------|----|----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | <b>SW5030A</b> |    | Analyst: MMR         |
| Chloroethane                                        | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Chloroform                                          | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Chloromethane                                       | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| cis-1,2-Dichloroethene                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| cis-1,3-Dichloropropene                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Dibromochloromethane                                | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Dibromomethane                                      | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Dichlorodifluoromethane                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Ethylbenzene                                        | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Hexachlorobutadiene                                 | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Isopropylbenzene                                    | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| m,p-Xylene                                          | U      | 2.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Methyl tert-butyl ether                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Methylene chloride                                  | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Naphthalene                                         | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| n-Butylbenzene                                      | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| n-Propylbenzene                                     | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| o-Xylene                                            | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| sec-Butylbenzene                                    | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Styrene                                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| tert-Butylbenzene                                   | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Tetrachloroethene                                   | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Toluene                                             | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| trans-1,2-Dichloroethene                            | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| trans-1,3-Dichloropropene                           | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Trichloroethene                                     | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Trichlorofluoromethane                              | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Vinyl acetate                                       | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |
| Vinyl chloride                                      | U      | 1.0            |      | µg/L           | 1  | 6/16/2006 9:43:00 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**

Date: 23-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606171  
**Project:** Rowe Industries  
**Lab ID:** 0606171-03B

**Client Sample ID:** WQ061406:810 NP2-10  
**Tag Number:** 10265  
**Collection Date:** 6/14/2006  
**Matrix:** LIQUID

| Analyses          | Result | Limit         | Qual | Units          | DF | Date Analyzed        |
|-------------------|--------|---------------|------|----------------|----|----------------------|
| <b>TOTAL IRON</b> |        | <b>E200.7</b> |      | <b>SW3010A</b> |    | <b>Analyst: JP</b>   |
| Iron              | 0.831  | 0.0200        |      | mg/L           | 1  | 6/20/2006 1:10:41 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**


Date: 23-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606171  
**Project:** Rowe Industries  
**Lab ID:** 0606171-03C

**Client Sample ID:** WQ061406:810 NP2-10  
**Tag Number:** 10265  
**Collection Date:** 6/14/2006  
**Matrix:** LIQUID

| Analyses                                        | Result | Limit         | Qual | Units          | DF | Date Analyzed        |
|-------------------------------------------------|--------|---------------|------|----------------|----|----------------------|
| <b>DISSOLVED IRON</b>                           |        | <b>E200.7</b> |      | <b>SW3005A</b> |    | Analyst: JP          |
| Iron                                            | 0.0650 | 0.0200        |      | mg/L           | 1  | 6/20/2006 1:08:44 PM |
| <b>TOTAL DISSOLVED SOLIDS</b>                   |        | <b>E160.1</b> |      |                |    | Analyst: JC          |
| Total Dissolved Solids (Residue,<br>Filterable) | 114    | 1.00          | H    | mg/L           | 1  | 6/22/2006            |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

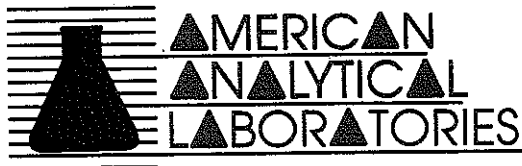

NYSDOH 11418  
NJDEP NY050  
CTDOH PH-0205  
PADEP 68-00573

Wednesday, June 28, 2006

Mark Goldberg  
Leggette Brashears & Graham Inc.  
4 Research Drive  
Suite 301  
Shelton, CT 06484

TEL: (203) 929-8555

FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0606224

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 6/23/2006 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at [lbeyer@american-analytical.com](mailto:lbeyer@american-analytical.com).

Sincerely,

  
Lori Beyer  
Lab Director

**American Analytical Laboratories, LLC.****Date:** 28-Jun-06

---

**CLIENT:** Leggette Brashears & Graham Inc.  
**Project:** Rowe Industries  
**Lab Order:** 0606224**Work Order Sample Summary**

---

| <b>Lab Sample ID</b> | <b>Client Sample ID</b> | <b>Tag Number</b> | <b>Date Collected</b> | <b>Date Received</b> |
|----------------------|-------------------------|-------------------|-----------------------|----------------------|
| 0606224-01A          | WQ062106:930 NP2-6      | 10266             | 6/21/2006             | 6/23/2006            |
| 0606224-01B          | WQ062106:930 NP2-6      | 10266             | 6/21/2006             | 6/23/2006            |
| 0606224-01C          | WQ062106:930 NP2-6      | 10266             | 6/21/2006             | 6/23/2006            |
| 0606224-02A          | WQ062106:935 NP2-7      | 10266             | 6/21/2006             | 6/23/2006            |
| 0606224-02B          | WQ062106:935 NP2-7      | 10266             | 6/21/2006             | 6/23/2006            |
| 0606224-02C          | WQ062106:935 NP2-7      | 10266             | 6/21/2006             | 6/23/2006            |
| 0606224-03A          | WQ062106:940 NP2-10     | 10266             | 6/21/2006             | 6/23/2006            |
| 0606224-03B          | WQ062106:940 NP2-10     | 10266             | 6/21/2006             | 6/23/2006            |
| 0606224-03C          | WQ062106:940 NP2-10     | 10266             | 6/21/2006             | 6/23/2006            |



**AMERICAN ANALYTICAL LABORATORIES, LLC**

**56 TOLEDO STREET**

**FARMINGDALE, NEW YORK 11735**

**TELEPHONE: (631) 454-6100**

**FAX: (631) 454-8027**

**DATA REPORTING QUALIFIERS**

For reporting results, the following "Results Qualifiers" are used:

|              |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
|--------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Value</b> | If the result is greater than or equal to the detection limit, report the value                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
| <b>U</b>     | Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.                                                                                                                                                                                                                                                                                           |
| <b>J</b>     | Indicates an estimated value. The flag is used:<br><ul style="list-style-type: none"><li>(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)</li><li>(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.</li></ul> |
| <b>B</b>     | Indicates the analyte was found in the blank as well as the sample report "10B".                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   |
| <b>E</b>     | Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
| <b>D</b>     | This flag identifies all compounds identified in an analysis at a secondary dilution factor.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |
| <b>P</b>     | This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".                                                                                                                                                                                                                                                                                                                                                                              |
| <b>N</b>     | This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.                                                                                                                                                                                                                                                                           |
| <b>H</b>     | Indicates sample was received and/or analyzed outside of The method allowable holding time                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         |

# American Analytical Laboratories, LLC.

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606224  
**Project:** Rowe Industries  
**Lab ID:** 0606224-01A

**Client Sample ID:** WQ062106:930 NP2-6  
**Tag Number:** 10266  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units               | DF | Date Analyzed        |
|-----------------------------------------------------|--------|----------------|------|---------------------|----|----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | <b>Analyst: LDS</b> |    |                      |
| 1,1,1,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 1,1,1-Trichloroethane                               | 6.8    | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 1,1,2,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 1,1,2-Trichloro-1,2,2-trifluoroethane               | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 1,1,2-Trichloroethane                               | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 1,1-Dichloroethane                                  | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 1,1-Dichloroethene                                  | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 1,1-Dichloropropene                                 | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 1,2,3-Trichlorobenzene                              | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 1,2,3-Trichloropropane                              | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 1,2,4-Trichlorobenzene                              | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 1,2,4-Trimethylbenzene                              | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 1,2-Dibromo-3-chloropropane                         | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 1,2-Dibromoethane                                   | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 1,2-Dichlorobenzene                                 | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 1,2-Dichloroethane                                  | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 1,2-Dichloropropane                                 | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 1,3,5-Trimethylbenzene                              | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 1,3-Dichlorobenzene                                 | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 1,3-dichloropropane                                 | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 1,4-Dichlorobenzene                                 | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 2,2-Dichloropropane                                 | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 2-Butanone                                          | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 2-Chloroethyl vinyl ether                           | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 2-Chlorotoluene                                     | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 2-Hexanone                                          | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 4-Chlorotoluene                                     | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 4-Isopropyltoluene                                  | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| 4-Methyl-2-pentanone                                | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| Acetone                                             | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| Benzene                                             | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| Bromobenzene                                        | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| Bromochloromethane                                  | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| Bromodichloromethane                                | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| Bromoform                                           | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| Bromomethane                                        | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| Carbon disulfide                                    | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| Carbon tetrachloride                                | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |
| Chlorobenzene                                       | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 7:18:00 AM |

|                    |    |                                                         |   |                                                 |
|--------------------|----|---------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank         | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded      | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                     | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detecte | X | Value exceeds Maximum Contaminant Level         |
|                    |    |                                                         |   |                                                 |

# American Analytical Laboratories, LLC.

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606224  
**Project:** Rowe Industries  
**Lab ID:** 0606224-01A

**Client Sample ID:** WQ062106:930 NP2-6  
**Tag Number:** 10266  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units        | DF | Date Analyzed        |
|-----------------------------------------------------|--------|----------------|------|--------------|----|----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | Analyst: LDS |    |                      |
| Chloroethane                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| Chloroform                                          | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| Chloromethane                                       | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| cis-1,2-Dichloroethene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| cis-1,3-Dichloropropene                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| Dibromochloromethane                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| Dibromomethane                                      | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| Dichlorodifluoromethane                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| Ethylbenzene                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| Hexachlorobutadiene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| Isopropylbenzene                                    | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| m,p-Xylene                                          | U      | 2.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| Methyl tert-butyl ether                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| Methylene chloride                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| Naphthalene                                         | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| n-Butylbenzene                                      | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| n-Propylbenzene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| o-Xylene                                            | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| sec-Butylbenzene                                    | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| Styrene                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| tert-Butylbenzene                                   | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| Tetrachloroethene                                   | 20     | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| Toluene                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| trans-1,2-Dichloroethene                            | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| trans-1,3-Dichloropropene                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| Trichloroethene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| Trichlorofluoromethane                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| Vinyl acetate                                       | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |
| Vinyl chloride                                      | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 7:18:00 AM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.****Date:** 28-Jun-06

---

|                   |                                  |                          |                    |
|-------------------|----------------------------------|--------------------------|--------------------|
| <b>CLIENT:</b>    | Leggette Brashears & Graham Inc. | <b>Client Sample ID:</b> | WQ062106:930 NP2-6 |
| <b>Lab Order:</b> | 0606224                          | <b>Tag Number:</b>       | 10266              |
| <b>Project:</b>   | Rowe Industries                  | <b>Collection Date:</b>  | 6/21/2006          |
| <b>Lab ID:</b>    | 0606224-01B                      | <b>Matrix:</b>           | LIQUID             |

---

| <b>Analyses</b>   | <b>Result</b> | <b>Limit</b>  | <b>Qual</b> | <b>Units</b>   | <b>DF</b> | <b>Date Analyzed</b> |
|-------------------|---------------|---------------|-------------|----------------|-----------|----------------------|
| <b>TOTAL IRON</b> |               | <b>E200.7</b> |             | <b>SW3010A</b> |           | <b>Analyst: JP</b>   |
| Iron              | 2.52          | 0.0200        |             | mg/L           | 1         | 6/27/2006 3:17:11 PM |

---

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**

Date: 28-Jun-06

---

|                   |                                  |                          |                    |
|-------------------|----------------------------------|--------------------------|--------------------|
| <b>CLIENT:</b>    | Leggette Brashears & Graham Inc. | <b>Client Sample ID:</b> | WQ062106:930 NP2-6 |
| <b>Lab Order:</b> | 0606224                          | <b>Tag Number:</b>       | 10266              |
| <b>Project:</b>   | Rowe Industries                  | <b>Collection Date:</b>  | 6/21/2006          |
| <b>Lab ID:</b>    | 0606224-01C                      | <b>Matrix:</b>           | LIQUID             |

---

| Analyses              | Result | Limit         | Qual | Units          | DF | Date Analyzed        |
|-----------------------|--------|---------------|------|----------------|----|----------------------|
| <b>DISSOLVED IRON</b> |        | <b>E200.7</b> |      | <b>SW3005A</b> |    | Analyst: JP          |
| Iron                  | 0.120  | 0.0200        |      | mg/L           | 1  | 6/27/2006 3:15:14 PM |

---

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

# American Analytical Laboratories, LLC.

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606224  
**Project:** Rowe Industries  
**Lab ID:** 0606224-02A

**Client Sample ID:** WQ062106:935 NP2-7  
**Tag Number:** 10266  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units        | DF | Date Analyzed        |
|-----------------------------------------------------|--------|----------------|------|--------------|----|----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | Analyst: LDS |    |                      |
| 1,1,1,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 1,1,1-Trichloroethane                               | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 1,1,2,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 1,1,2-Trichloro-1,2,2-trifluoroethane               | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 1,1,2-Trichloroethane                               | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 1,1-Dichloroethane                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 1,1-Dichloroethene                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 1,1-Dichloropropene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 1,2,3-Trichlorobenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 1,2,3-Trichloropropane                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 1,2,4-Trichlorobenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 1,2,4-Trimethylbenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 1,2-Dibromo-3-chloropropane                         | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 1,2-Dibromoethane                                   | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 1,2-Dichlorobenzene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 1,2-Dichloroethane                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 1,2-Dichloropropane                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 1,3,5-Trimethylbenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 1,3-Dichlorobenzene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 1,3-dichloropropane                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 1,4-Dichlorobenzene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 2,2-Dichloropropane                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 2-Butanone                                          | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 2-Chloroethyl vinyl ether                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 2-Chlorotoluene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 2-Hexanone                                          | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 4-Chlorotoluene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 4-Isopropyltoluene                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| 4-Methyl-2-pentanone                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| Acetone                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| Benzene                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| Bromobenzene                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| Bromochloromethane                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| Bromodichloromethane                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| Bromoform                                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| Bromomethane                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| Carbon disulfide                                    | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| Carbon tetrachloride                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |
| Chlorobenzene                                       | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:10:00 AM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |
|                    |    |                                                          |   |                                                 |

# American Analytical Laboratories, LLC.

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606224  
**Project:** Rowe Industries  
**Lab ID:** 0606224-02A

**Client Sample ID:** WQ062106:935 NP2-7  
**Tag Number:** 10266  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units               | DF | Date Analyzed        |
|-----------------------------------------------------|--------|----------------|------|---------------------|----|----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | <b>Analyst: LDS</b> |    |                      |
| Chloroethane                                        | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| Chloroform                                          | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| Chloromethane                                       | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| cis-1,2-Dichloroethene                              | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| cis-1,3-Dichloropropene                             | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| Dibromochloromethane                                | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| Dibromomethane                                      | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| Dichlorodifluoromethane                             | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| Ethylbenzene                                        | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| Hexachlorobutadiene                                 | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| Isopropylbenzene                                    | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| m,p-Xylene                                          | U      | 2.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| Methyl tert-butyl ether                             | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| Methylene chloride                                  | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| Naphthalene                                         | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| n-Butylbenzene                                      | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| n-Propylbenzene                                     | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| o-Xylene                                            | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| sec-Butylbenzene                                    | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| Styrene                                             | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| tert-Butylbenzene                                   | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| Tetrachloroethene                                   | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| Toluene                                             | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| trans-1,2-Dichloroethene                            | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| trans-1,3-Dichloropropene                           | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| Trichloroethene                                     | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| Trichlorofluoromethane                              | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| Vinyl acetate                                       | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |
| Vinyl chloride                                      | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 9:10:00 AM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.****Date:** 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606224  
**Project:** Rowe Industries  
**Lab ID:** 0606224-02B

**Client Sample ID:** WQ062106:935 NP2-7  
**Tag Number:** 10266  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses          | Result | Limit         | Qual | Units          | DF | Date Analyzed        |
|-------------------|--------|---------------|------|----------------|----|----------------------|
| <b>TOTAL IRON</b> |        | <b>E200.7</b> |      | <b>SW3010A</b> |    | Analyst: JP          |
| Iron              | 1.09   | 0.0200        |      | mg/L           | 1  | 6/27/2006 3:21:00 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606224  
**Project:** Rowe Industries  
**Lab ID:** 0606224-02C

**Client Sample ID:** WQ062106:935 NP2-7  
**Tag Number:** 10266  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses       | Result | Limit  | Qual | Units   | DF | Date Analyzed        |
|----------------|--------|--------|------|---------|----|----------------------|
| DISSOLVED IRON |        | E200.7 |      | SW3005A |    | Analyst: JP          |
| Iron           | 0.110  | 0.0200 |      | mg/L    | 1  | 6/27/2006 3:19:07 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

# American Analytical Laboratories, LLC.

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606224  
**Project:** Rowe Industries  
**Lab ID:** 0606224-03A

**Client Sample ID:** WQ062106:940 NP2-10  
**Tag Number:** 10266  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units        | DF | Date Analyzed        |
|-----------------------------------------------------|--------|----------------|------|--------------|----|----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | Analyst: LDS |    |                      |
| 1,1,1,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 1,1,1-Trichloroethane                               | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 1,1,2,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 1,1,2-Trichloro-1,2,2-trifluoroethane               | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 1,1,2-Trichloroethane                               | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 1,1-Dichloroethane                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 1,1-Dichloroethene                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 1,1-Dichloropropene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 1,2,3-Trichlorobenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 1,2,3-Trichloropropane                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 1,2,4-Trichlorobenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 1,2,4-Trimethylbenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 1,2-Dibromo-3-chloropropane                         | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 1,2-Dibromoethane                                   | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 1,2-Dichlorobenzene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 1,2-Dichloroethane                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 1,2-Dichloropropane                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 1,3,5-Trimethylbenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 1,3-Dichlorobenzene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 1,3-dichloropropane                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 1,4-Dichlorobenzene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 2,2-Dichloropropane                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 2-Butanone                                          | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 2-Chloroethyl vinyl ether                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 2-Chlorotoluene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 2-Hexanone                                          | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 4-Chlorotoluene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 4-Isopropyltoluene                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| 4-Methyl-2-pentanone                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Acetone                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Benzene                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Bromobenzene                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Bromochloromethane                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Bromodichloromethane                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Bromoform                                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Bromomethane                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Carbon disulfide                                    | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Carbon tetrachloride                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Chlorobenzene                                       | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

# American Analytical Laboratories, LLC.

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606224  
**Project:** Rowe Industries  
**Lab ID:** 0606224-03A

**Client Sample ID:** WQ062106:940 NP2-10  
**Tag Number:** 10266  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units        | DF | Date Analyzed        |
|-----------------------------------------------------|--------|----------------|------|--------------|----|----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | Analyst: LDS |    |                      |
| Chloroethane                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Chloroform                                          | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Chloromethane                                       | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| cis-1,2-Dichloroethene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| cis-1,3-Dichloropropene                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Dibromochloromethane                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Dibromomethane                                      | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Dichlorodifluoromethane                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Ethylbenzene                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Hexachlorobutadiene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Isopropylbenzene                                    | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| m,p-Xylene                                          | U      | 2.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Methyl tert-butyl ether                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Methylene chloride                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Naphthalene                                         | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| n-Butylbenzene                                      | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| n-Propylbenzene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| o-Xylene                                            | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| sec-Butylbenzene                                    | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Styrene                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| tert-Butylbenzene                                   | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Tetrachloroethene                                   | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Toluene                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| trans-1,2-Dichloroethene                            | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| trans-1,3-Dichloropropene                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Trichloroethene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Trichlorofluoromethane                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Vinyl acetate                                       | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |
| Vinyl chloride                                      | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 9:48:00 AM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.****Date:** 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606224  
**Project:** Rowe Industries  
**Lab ID:** 0606224-03B

**Client Sample ID:** WQ062106:940 NP2-10  
**Tag Number:** 10266  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses          | Result | Limit         | Qual | Units          | DF | Date Analyzed        |
|-------------------|--------|---------------|------|----------------|----|----------------------|
| <b>TOTAL IRON</b> |        | <b>E200.7</b> |      | <b>SW3010A</b> |    | <b>Analyst: JP</b>   |
| Iron              | 1.13   | 0.0200        |      | mg/L           | 1  | 6/27/2006 3:25:09 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |
|                    |    |                                                          |   |                                                 |

**American Analytical Laboratories, LLC.**


Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606224  
**Project:** Rowe Industries  
**Lab ID:** 0606224-03C

**Client Sample ID:** WQ062106:940 NP2-10  
**Tag Number:** 10266  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                        | Result | Limit         | Qual | Units          | DF | Date Analyzed        |
|-------------------------------------------------|--------|---------------|------|----------------|----|----------------------|
| <b>DISSOLVED IRON</b>                           |        | <b>E200.7</b> |      | <b>SW3005A</b> |    | Analyst: JP          |
| Iron                                            | 0.118  | 0.0200        |      | mg/L           | 1  | 6/27/2006 3:23:09 PM |
| <b>TOTAL DISSOLVED SOLIDS</b>                   |        | <b>E160.1</b> |      |                |    | Analyst: JC          |
| Total Dissolved Solids (Residue,<br>Filterable) | 114    | 1.00          |      | mg/L           | 1  | 6/26/2006            |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

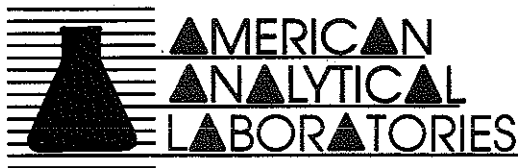

NYSDOH 11418  
NJDEP NY050  
CTDOH PH-0205  
PADEP 68-00573

Friday, July 07, 2006

Mark Goldberg  
Leggette Brashears & Graham Inc.  
4 Research Drive  
Suite 301  
Shelton, CT 06484

TEL: (203) 929-8555  
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0606300

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 6/30/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

  
Lori Beyer  
Lab Director

**American Analytical Laboratories, LLC.****Date:** 07-Jul-06

---

**CLIENT:** Leggette Brashears & Graham Inc.  
**Project:** Rowe Industries  
**Lab Order:** 0606300

---

**Work Order Sample Summary**

---

| <b>Lab Sample ID</b> | <b>Client Sample ID</b> | <b>Tag Number</b> | <b>Date Collected</b> | <b>Date Received</b> |
|----------------------|-------------------------|-------------------|-----------------------|----------------------|
| 0606300-01A          | WQ062806:800 NP2-6      | 10269             | 6/28/2006             | 6/30/2006            |
| 0606300-01B          | WQ062806:800 NP2-6      | 10269             | 6/28/2006             | 6/30/2006            |
| 0606300-01C          | WQ062806:800 NP2-6      | 10269             | 6/28/2006             | 6/30/2006            |
| 0606300-02A          | WQ062806:805 NP2-7      | 10269             | 6/28/2006             | 6/30/2006            |
| 0606300-02B          | WQ062806:805 NP2-7      | 10269             | 6/28/2006             | 6/30/2006            |
| 0606300-02C          | WQ062806:805 NP2-7      | 10269             | 6/28/2006             | 6/30/2006            |
| 0606300-03A          | WQ062806:810 NP2-10     | 10269             | 6/28/2006             | 6/30/2006            |
| 0606300-03B          | WQ062806:810 NP2-10     | 10269             | 6/28/2006             | 6/30/2006            |
| 0606300-03C          | WQ062806:810 NP2-10     | 10269             | 6/28/2006             | 6/30/2006            |

---

**CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT**

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

## **AMERICAN ANALYTICAL LABORATORIES, LLC**

**56 TOLEDO STREET**

**FARMINGDALE, NEW YORK 11735**

**TELEPHONE: (631) 454-6100      FAX: (631) 454-8027**

### **DATA REPORTING QUALIFIERS**

For reporting results, the following "Results Qualifiers" are used:

|              |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
|--------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Value</b> | If the result is greater than or equal to the detection limit, report the value                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
| <b>U</b>     | Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.                                                                                                                                                                                                                                                                                           |
| <b>J</b>     | Indicates an estimated value. The flag is used:<br><ol style="list-style-type: none"><li>(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)</li><li>(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.</li></ol> |
| <b>B</b>     | Indicates the analyte was found in the blank as well as the sample report "10B".                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   |
| <b>E</b>     | Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
| <b>D</b>     | This flag identifies all compounds identified in an analysis at a secondary dilution factor.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |
| <b>P</b>     | This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".                                                                                                                                                                                                                                                                                                                                                                              |
| <b>N</b>     | This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.                                                                                                                                                                                                                                                                           |
| <b>H</b>     | Indicates sample was received and/or analyzed outside of The method allowable holding time                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         |

# American Analytical Laboratories, LLC.

Date: 07-Jul-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606300  
**Project:** Rowe Industries  
**Lab ID:** 0606300-01A

**Client Sample ID:** WQ062806:800 NP2-6  
**Tag Number:** 10269  
**Collection Date:** 6/28/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units | DF | Date Analyzed       |
|-----------------------------------------------------|--------|----------------|------|-------|----|---------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        |                |      |       |    |                     |
|                                                     |        | <b>SW8260B</b> |      |       |    | <b>Analyst: MMR</b> |
|                                                     |        | <b>SW5030A</b> |      |       |    |                     |
| 1,1,1,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 1,1,1-Trichloroethane                               | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 1,1,2,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 1,1,2-Trichloro-1,2,2-trifluoroethane               | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 1,1,2-Trichloroethane                               | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 1,1-Dichloroethane                                  | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 1,1-Dichloroethene                                  | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 1,1-Dichloropropene                                 | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 1,2,3-Trichlorobenzene                              | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 1,2,3-Trichloropropane                              | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 1,2,4-Trichlorobenzene                              | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 1,2,4-Trimethylbenzene                              | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 1,2-Dibromo-3-chloropropane                         | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 1,2-Dibromoethane                                   | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 1,2-Dichlorobenzene                                 | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 1,2-Dichloroethane                                  | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 1,2-Dichloropropane                                 | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 1,3,5-Trimethylbenzene                              | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 1,3-Dichlorobenzene                                 | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 1,3-dichloropropane                                 | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 1,4-Dichlorobenzene                                 | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 2,2-Dichloropropane                                 | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 2-Butanone                                          | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 2-Chloroethyl vinyl ether                           | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 2-Chlorotoluene                                     | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 2-Hexanone                                          | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 4-Chlorotoluene                                     | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 4-Isopropyltoluene                                  | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| 4-Methyl-2-pentanone                                | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| Acetone                                             | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| Benzene                                             | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| Bromobenzene                                        | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| Bromochloromethane                                  | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| Bromodichloromethane                                | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| Bromoform                                           | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| Bromomethane                                        | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| Carbon disulfide                                    | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| Carbon tetrachloride                                | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |
| Chlorobenzene                                       | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 5:44:00 AM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

# American Analytical Laboratories, LLC.

Date: 07-Jul-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606300  
**Project:** Rowe Industries  
**Lab ID:** 0606300-01A

**Client Sample ID:** WQ062806:800 NP2-6  
**Tag Number:** 10269  
**Collection Date:** 6/28/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units          | DF | Date Analyzed       |
|-----------------------------------------------------|--------|----------------|------|----------------|----|---------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        |                |      |                |    |                     |
|                                                     |        | <b>SW8260B</b> |      |                |    |                     |
|                                                     |        |                |      | <b>SW5030A</b> |    |                     |
|                                                     |        |                |      |                |    | Analyst: MMR        |
| Chloroethane                                        | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| Chloroform                                          | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| Chloromethane                                       | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| cis-1,2-Dichloroethene                              | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| cis-1,3-Dichloropropene                             | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| Dibromochloromethane                                | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| Dibromomethane                                      | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| Dichlorodifluoromethane                             | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| Ethylbenzene                                        | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| Hexachlorobutadiene                                 | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| Isopropylbenzene                                    | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| m,p-Xylene                                          | U      | 2.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| Methyl tert-butyl ether                             | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| Methylene chloride                                  | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| Naphthalene                                         | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| n-Butylbenzene                                      | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| n-Propylbenzene                                     | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| o-Xylene                                            | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| sec-Butylbenzene                                    | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| Styrene                                             | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| tert-Butylbenzene                                   | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| Tetrachloroethene                                   | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| Toluene                                             | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| trans-1,2-Dichloroethene                            | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| trans-1,3-Dichloropropene                           | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| Trichloroethene                                     | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| Trichlorofluoromethane                              | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| Vinyl acetate                                       | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |
| Vinyl chloride                                      | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 5:44:00 AM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**

Date: 07-Jul-06

|                   |                                  |                          |                    |
|-------------------|----------------------------------|--------------------------|--------------------|
| <b>CLIENT:</b>    | Leggette Brashears & Graham Inc. | <b>Client Sample ID:</b> | WQ062806:800 NP2-6 |
| <b>Lab Order:</b> | 0606300                          | <b>Tag Number:</b>       | 10269              |
| <b>Project:</b>   | Rowe Industries                  | <b>Collection Date:</b>  | 6/28/2006          |
| <b>Lab ID:</b>    | 0606300-01B                      | <b>Matrix:</b>           | LIQUID             |

| Analyses          | Result | Limit         | Qual | Units          | DF | Date Analyzed       |
|-------------------|--------|---------------|------|----------------|----|---------------------|
| <b>TOTAL IRON</b> |        | <b>E200.7</b> |      | <b>SW3010A</b> |    | Analyst: <b>JP</b>  |
| Iron              | 1.51   | 0.0200        |      | mg/L           | 1  | 7/6/2006 2:59:10 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**

Date: 07-Jul-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606300  
**Project:** Rowe Industries  
**Lab ID:** 0606300-01C

**Client Sample ID:** WQ062806:800 NP2-6  
**Tag Number:** 10269  
**Collection Date:** 6/28/2006  
**Matrix:** LIQUID

| Analyses              | Result | Limit         | Qual | Units          | DF | Date Analyzed       |
|-----------------------|--------|---------------|------|----------------|----|---------------------|
| <b>DISSOLVED IRON</b> |        | <b>E200.7</b> |      | <b>SW3005A</b> |    | Analyst: JP         |
| Iron                  | 0.226  | 0.0200        |      | mg/L           | 1  | 7/6/2006 2:57:11 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |
|                    |    |                                                          |   |                                                 |

# American Analytical Laboratories, LLC.

Date: 07-Jul-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606300  
**Project:** Rowe Industries  
**Lab ID:** 0606300-02A

**Client Sample ID:** WQ062806:805 NP2-7  
**Tag Number:** 10269  
**Collection Date:** 6/28/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units          | DF | Date Analyzed       |
|-----------------------------------------------------|--------|----------------|------|----------------|----|---------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | <b>SW5030A</b> |    | <b>Analyst: MMR</b> |
| 1,1,1,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 1,1,1-Trichloroethane                               | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 1,1,2,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 1,1,2-Trichloro-1,2,2-trifluoroethane               | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 1,1,2-Trichloroethane                               | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 1,1-Dichloroethane                                  | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 1,1-Dichloroethene                                  | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 1,1-Dichloropropene                                 | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 1,2,3-Trichlorobenzene                              | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 1,2,3-Trichloropropane                              | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 1,2,4-Trichlorobenzene                              | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 1,2,4-Trimethylbenzene                              | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 1,2-Dibromo-3-chloropropane                         | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 1,2-Dibromoethane                                   | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 1,2-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 1,2-Dichloroethane                                  | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 1,2-Dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 1,3,5-Trimethylbenzene                              | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 1,3-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 1,3-dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 1,4-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 2,2-Dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 2-Butanone                                          | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 2-Chloroethyl vinyl ether                           | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 2-Chlorotoluene                                     | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 2-Hexanone                                          | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 4-Chlorotoluene                                     | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 4-Isopropyltoluene                                  | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| 4-Methyl-2-pentanone                                | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Acetone                                             | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Benzene                                             | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Bromobenzene                                        | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Bromochloromethane                                  | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Bromodichloromethane                                | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Bromoform                                           | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Bromomethane                                        | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Carbon disulfide                                    | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Carbon tetrachloride                                | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Chlorobenzene                                       | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |

**Qualifiers:**  
 B Analyte detected in the associated Method Blank  
 H Holding times for preparation or analysis exceeded  
 ND Not Detected at the Reporting Limit  
 U Indicates the compound was analyzed for but not detected

E Value above quantitation range  
 J Analyte detected below quantitation limits  
 S Spike Recovery outside accepted recovery limits  
 X Value exceeds Maximum Contaminant Level

# American Analytical Laboratories, LLC.

Date: 07-Jul-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606300  
**Project:** Rowe Industries  
**Lab ID:** 0606300-02A

**Client Sample ID:** WQ062806:805 NP2-7  
**Tag Number:** 10269  
**Collection Date:** 6/28/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units          | DF | Date Analyzed       |
|-----------------------------------------------------|--------|----------------|------|----------------|----|---------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | <b>SW5030A</b> |    | Analyst: MMR        |
| Chloroethane                                        | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Chloroform                                          | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Chloromethane                                       | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| cis-1,2-Dichloroethene                              | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| cis-1,3-Dichloropropene                             | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Dibromochloromethane                                | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Dibromomethane                                      | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Dichlorodifluoromethane                             | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Ethylbenzene                                        | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Hexachlorobutadiene                                 | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Isopropylbenzene                                    | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| m,p-Xylene                                          | U      | 2.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Methyl tert-butyl ether                             | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Methylene chloride                                  | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Naphthalene                                         | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| n-Butylbenzene                                      | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| n-Propylbenzene                                     | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| o-Xylene                                            | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| sec-Butylbenzene                                    | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Styrene                                             | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| tert-Butylbenzene                                   | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Tetrachloroethene                                   | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Toluene                                             | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| trans-1,2-Dichloroethene                            | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| trans-1,3-Dichloropropene                           | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Trichloroethene                                     | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Trichlorofluoromethane                              | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Vinyl acetate                                       | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |
| Vinyl chloride                                      | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:21:00 AM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**

Date: 07-Jul-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606300  
**Project:** Rowe Industries  
**Lab ID:** 0606300-02B

**Client Sample ID:** WQ062806:805 NP2-7  
**Tag Number:** 10269  
**Collection Date:** 6/28/2006  
**Matrix:** LIQUID

| Analyses          | Result | Limit         | Qual | Units          | DF | Date Analyzed       |
|-------------------|--------|---------------|------|----------------|----|---------------------|
| <b>TOTAL IRON</b> |        | <b>E200.7</b> |      | <b>SW3010A</b> |    | Analyst: <b>JP</b>  |
| Iron              | 5.41   | 0.0200        |      | mg/L           | 1  | 7/6/2006 3:06:42 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**

Date: 07-Jul-06

**CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** WQ062806:805 NP2-7**Lab Order:** 0606300**Tag Number:** 10269**Project:** Rowe Industries**Collection Date:** 6/28/2006**Lab ID:** 0606300-02C**Matrix:** LIQUID

| Analyses              | Result | Limit         | Qual | Units          | DF | Date Analyzed       |
|-----------------------|--------|---------------|------|----------------|----|---------------------|
| <b>DISSOLVED IRON</b> |        | <b>E200.7</b> |      | <b>SW3005A</b> |    | Analyst: <b>JP</b>  |
| Iron                  | 0.0740 | 0.0200        |      | mg/L           | 1  | 7/6/2006 3:01:18 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

# American Analytical Laboratories, LLC.

Date: 07-Jul-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606300  
**Project:** Rowe Industries  
**Lab ID:** 0606300-03A

**Client Sample ID:** WQ062806:810 NP2-10  
**Tag Number:** 10269  
**Collection Date:** 6/28/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units          | DF | Date Analyzed       |
|-----------------------------------------------------|--------|----------------|------|----------------|----|---------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        |                |      |                |    |                     |
|                                                     |        | <b>SW8260B</b> |      | <b>SW5030A</b> |    | Analyst: MMR        |
| 1,1,1,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 1,1,1-Trichloroethane                               | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 1,1,2,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 1,1,2-Trichloro-1,2,2-trifluoroethane               | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 1,1,2-Trichloroethane                               | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 1,1-Dichloroethane                                  | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 1,1-Dichloroethene                                  | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 1,1-Dichloropropene                                 | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 1,2,3-Trichlorobenzene                              | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 1,2,3-Trichloropropane                              | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 1,2,4-Trichlorobenzene                              | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 1,2,4-Trimethylbenzene                              | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 1,2-Dibromo-3-chloropropane                         | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 1,2-Dibromoethane                                   | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 1,2-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 1,2-Dichloroethane                                  | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 1,2-Dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 1,3,5-Trimethylbenzene                              | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 1,3-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 1,3-dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 1,4-Dichlorobenzene                                 | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 2,2-Dichloropropane                                 | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 2-Butanone                                          | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 2-Chloroethyl vinyl ether                           | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 2-Chlorotoluene                                     | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 2-Hexanone                                          | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 4-Chlorotoluene                                     | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 4-Isopropyltoluene                                  | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| 4-Methyl-2-pentanone                                | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| Acetone                                             | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| Benzene                                             | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| Bromobenzene                                        | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| Bromochloromethane                                  | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| Bromodichloromethane                                | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| Bromoform                                           | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| Bromomethane                                        | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| Carbon disulfide                                    | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| Carbon tetrachloride                                | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |
| Chlorobenzene                                       | U      | 1.0            |      | µg/L           | 1  | 7/1/2006 6:58:00 AM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

# American Analytical Laboratories, LLC.

Date: 07-Jul-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606300  
**Project:** Rowe Industries  
**Lab ID:** 0606300-03A

**Client Sample ID:** WQ062806:810 NP2-10  
**Tag Number:** 10269  
**Collection Date:** 6/28/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units | DF | Date Analyzed       |
|-----------------------------------------------------|--------|----------------|------|-------|----|---------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        |                |      |       |    |                     |
|                                                     |        | <b>SW8260B</b> |      |       |    | <b>Analyst: MMR</b> |
|                                                     |        | <b>SW5030A</b> |      |       |    |                     |
| Chloroethane                                        | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| Chloroform                                          | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| Chloromethane                                       | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| cis-1,2-Dichloroethene                              | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| cis-1,3-Dichloropropene                             | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| Dibromochloromethane                                | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| Dibromomethane                                      | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| Dichlorodifluoromethane                             | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| Ethylbenzene                                        | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| Hexachlorobutadiene                                 | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| Isopropylbenzene                                    | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| m,p-Xylene                                          | U      | 2.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| Methyl tert-butyl ether                             | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| Methylene chloride                                  | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| Naphthalene                                         | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| n-Butylbenzene                                      | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| n-Propylbenzene                                     | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| o-Xylene                                            | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| sec-Butylbenzene                                    | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| Styrene                                             | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| tert-Butylbenzene                                   | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| Tetrachloroethene                                   | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| Toluene                                             | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| trans-1,2-Dichloroethene                            | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| trans-1,3-Dichloropropene                           | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| Trichloroethene                                     | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| Trichlorofluoromethane                              | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| Vinyl acetate                                       | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |
| Vinyl chloride                                      | U      | 1.0            |      | µg/L  | 1  | 7/1/2006 6:58:00 AM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**

Date: 07-Jul-06

**CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** WQ062806:810 NP2-10**Lab Order:** 0606300**Tag Number:** 10269**Project:** Rowe Industries**Collection Date:** 6/28/2006**Lab ID:** 0606300-03B**Matrix:** LIQUID

| Analyses          | Result | Limit         | Qual | Units          | DF | Date Analyzed       |
|-------------------|--------|---------------|------|----------------|----|---------------------|
| <b>TOTAL IRON</b> |        | <b>E200.7</b> |      | <b>SW3010A</b> |    | Analyst: JP         |
| Iron              | 1.14   | 0.0200        |      | mg/L           | 1  | 7/6/2006 3:11:31 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**


Date: 07-Jul-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606300  
**Project:** Rowe Industries  
**Lab ID:** 0606300-03C

**Client Sample ID:** WQ062806:810 NP2-10  
**Tag Number:** 10269  
**Collection Date:** 6/28/2006  
**Matrix:** LIQUID

| Analyses                                     | Result | Limit         | Qual | Units          | DF | Date Analyzed       |
|----------------------------------------------|--------|---------------|------|----------------|----|---------------------|
| <b>DISSOLVED IRON</b>                        |        | <b>E200.7</b> |      | <b>SW3005A</b> |    | Analyst: <b>JP</b>  |
| Iron                                         | 0.146  | 0.0200        |      | mg/L           | 1  | 7/6/2006 3:08:58 PM |
| <b>TOTAL DISSOLVED SOLIDS</b>                |        | <b>E160.1</b> |      |                |    | Analyst: <b>JC</b>  |
| Total Dissolved Solids (Residue, Filterable) | 88.0   | 1.00          |      | mg/L           | 1  | 7/5/2006            |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |
|                    |    |                                                          |   |                                                 |

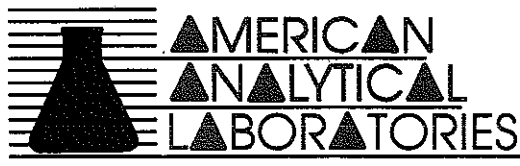

NYSDOH 11418  
NJDEP NY050  
CTDOH PH-0205  
PADEP 68-00573

Wednesday, June 28, 2006

Mark Goldberg  
Leggette Brashears & Graham Inc.  
4 Research Drive  
Suite 301  
Shelton, CT 06484  
TEL: (203) 929-8555  
FAX (203) 926-9140

RE: Rowe Industries

Dear Mark Goldberg:

Order No.: 0606225

American Analytical Laboratories, LLC. received 6 sample(s) on 6/23/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

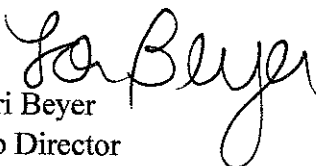  
Lori Beyer  
Lab Director

**American Analytical Laboratories, LLC.**

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.**Project:** Rowe Industries**Lab Order:** 0606225**Work Order Sample Summary**

| Lab Sample ID | Client Sample ID      | Tag Number | Date Collected | Date Received |
|---------------|-----------------------|------------|----------------|---------------|
| 0606225-01A   | GWQ062106:800 NP1-1-2 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-01B   | GWQ062106:800 NP1-1-2 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-01C   | GWQ062106:800 NP1-1-2 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-01D   | GWQ062106:800 NP1-1-2 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-02A   | GWQ062106:830 NP1-1-4 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-02B   | GWQ062106:830 NP1-1-4 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-02C   | GWQ062106:830 NP1-1-4 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-02D   | GWQ062106:830 NP1-1-4 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-03A   | GWQ062106:840 NP1-1-5 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-03B   | GWQ062106:840 NP1-1-5 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-03C   | GWQ062106:840 NP1-1-5 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-03D   | GWQ062106:840 NP1-1-5 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-04A   | GWQ062106:850 NP1-1-6 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-04B   | GWQ062106:850 NP1-1-6 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-04C   | GWQ062106:850 NP1-1-6 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-04D   | GWQ062106:850 NP1-1-6 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-05A   | GWQ062106:900 NP1-1-7 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-05B   | GWQ062106:900 NP1-1-7 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-05C   | GWQ062106:900 NP1-1-7 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-05D   | GWQ062106:900 NP1-1-7 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-06A   | GWQ062106:910 NP1-1-8 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-06B   | GWQ062106:910 NP1-1-8 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-06C   | GWQ062106:910 NP1-1-8 | 10267      | 6/21/2006      | 6/23/2006     |
| 0606225-06D   | GWQ062106:910 NP1-1-8 | 10267      | 6/21/2006      | 6/23/2006     |

**CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT**

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

## **AMERICAN ANALYTICAL LABORATORIES, LLC**

**56 TOLEDO STREET**

**FARMINGDALE, NEW YORK 11735**

**TELEPHONE: (631) 454-6100      FAX: (631) 454-8027**

### **DATA REPORTING QUALIFIERS**

For reporting results, the following "Results Qualifiers" are used:

|              |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
|--------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Value</b> | If the result is greater than or equal to the detection limit, report the value                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
| <b>U</b>     | Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.                                                                                                                                                                                                                                                                                           |
| <b>J</b>     | Indicates an estimated value. The flag is used:<br><ol style="list-style-type: none"><li>(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)</li><li>(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.</li></ol> |
| <b>B</b>     | Indicates the analyte was found in the blank as well as the sample report "10B".                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   |
| <b>E</b>     | Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
| <b>D</b>     | This flag identifies all compounds identified in an analysis at a secondary dilution factor.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |
| <b>P</b>     | This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".                                                                                                                                                                                                                                                                                                                                                                              |
| <b>N</b>     | This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.                                                                                                                                                                                                                                                                           |
| <b>H</b>     | Indicates sample was received and/or analyzed outside of The method allowable holding time                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         |

# American Analytical Laboratories, LLC.

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-01A

**Client Sample ID:** GWQ062106:800 NP1-1-2  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units        | DF | Date Analyzed         |
|-----------------------------------------------------|--------|----------------|------|--------------|----|-----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | Analyst: LDS |    |                       |
| 1,1,1,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 1,1,1-Trichloroethane                               | 25     | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 1,1,2,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 1,1,2-Trichloro-1,2,2-trifluoroethane               | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 1,1,2-Trichloroethane                               | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 1,1-Dichloroethane                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 1,1-Dichloroethene                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 1,1-Dichloropropene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 1,2,3-Trichlorobenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 1,2,3-Trichloropropane                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 1,2,4-Trichlorobenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 1,2,4-Trimethylbenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 1,2-Dibromo-3-chloropropane                         | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 1,2-Dibromoethane                                   | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 1,2-Dichlorobenzene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 1,2-Dichloroethane                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 1,2-Dichloropropane                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 1,3,5-Trimethylbenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 1,3-Dichlorobenzene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 1,3-dichloropropane                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 1,4-Dichlorobenzene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 2,2-Dichloropropane                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 2-Butanone                                          | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 2-Chloroethyl vinyl ether                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 2-Chlorotoluene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 2-Hexanone                                          | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 4-Chlorotoluene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 4-Isopropyltoluene                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| 4-Methyl-2-pentanone                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| Acetone                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| Benzene                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| Bromobenzene                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| Bromochloromethane                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| Bromodichloromethane                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| Bromoform                                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| Bromomethane                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| Carbon disulfide                                    | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| Carbon tetrachloride                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |
| Chlorobenzene                                       | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 10:25:00 AM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

# American Analytical Laboratories, LLC.

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-01A

**Client Sample ID:** GWQ062106:800 NP1-1-2  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units               | DF | Date Analyzed         |
|-----------------------------------------------------|--------|----------------|------|---------------------|----|-----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | <b>Analyst: LDS</b> |    |                       |
| Chloroethane                                        | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| Chloroform                                          | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| Chloromethane                                       | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| cis-1,2-Dichloroethene                              | 5.0    | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| cis-1,3-Dichloropropene                             | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| Dibromochloromethane                                | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| Dibromomethane                                      | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| Dichlorodifluoromethane                             | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| Ethylbenzene                                        | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| Hexachlorobutadiene                                 | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| Isopropylbenzene                                    | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| m,p-Xylene                                          | U      | 2.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| Methyl tert-butyl ether                             | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| Methylene chloride                                  | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| Naphthalene                                         | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| n-Butylbenzene                                      | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| n-Propylbenzene                                     | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| o-Xylene                                            | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| sec-Butylbenzene                                    | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| Styrene                                             | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| tert-Butylbenzene                                   | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| Tetrachloroethene                                   | 13     | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| Toluene                                             | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| trans-1,2-Dichloroethene                            | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| trans-1,3-Dichloropropene                           | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| Trichloroethene                                     | 3.0    | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| Trichlorofluoromethane                              | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| Vinyl acetate                                       | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |
| Vinyl chloride                                      | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 10:25:00 AM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |
|                    |    |                                                          |   |                                                 |

**American Analytical Laboratories, LLC.**

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ062106:800 NP1-1-2**Lab Order:** 0606225**Tag Number:** 10267**Project:** Rowe Industries**Collection Date:** 6/21/2006**Lab ID:** 0606225-01B**Matrix:** LIQUID

| Analyses                     | Result | Limit         | Qual | Units          | DF | Date Analyzed        |
|------------------------------|--------|---------------|------|----------------|----|----------------------|
| <b>TOTAL IRON, MANGANESE</b> |        | <b>E200.7</b> |      | <b>SW3010A</b> |    | <b>Analyst: JP</b>   |
| Iron                         | 3.57   | 0.0200        |      | mg/L           | 1  | 6/27/2006 3:36:42 PM |
| Manganese                    | 0.711  | 0.0200        |      | mg/L           | 1  | 6/27/2006 3:36:42 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ062106:800 NP1-1-2**Lab Order:** 0606225**Tag Number:** 10267**Project:** Rowe Industries**Collection Date:** 6/21/2006**Lab ID:** 0606225-01C**Matrix:** LIQUID

| Analyses                  | Result | Limit  | Qual | Units   | DF | Date Analyzed        |
|---------------------------|--------|--------|------|---------|----|----------------------|
| DISSOLVED IRON, MANGANESE |        | E200.7 |      | SW3005A |    | Analyst: JP          |
| Iron                      | 0.0930 | 0.0200 |      | mg/L    | 1  | 6/27/2006 3:33:56 PM |
| Manganese                 | 0.683  | 0.0200 |      | mg/L    | 1  | 6/27/2006 3:33:56 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |
|                    |    |                                                          |   |                                                 |

**American Analytical Laboratories, LLC.**

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-01D

**Client Sample ID:** GWQ062106:800 NP1-1-2  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                                                      | Result | Limit                  | Qual | Units | DF | Date Analyzed            |
|-------------------------------------------------------------------------------|--------|------------------------|------|-------|----|--------------------------|
| <b>HARDNESS</b><br>Hardness, Calcium/Magnesium (As CaCO <sub>3</sub> )        | 48.1   | <b>M2340 B</b><br>1.00 |      | mg/L  | 1  | Analyst: JP<br>6/27/2006 |
| <b>TURBIDITY</b><br>Turbidity                                                 | 6.50   | <b>E180.1</b><br>1.00  |      | NTU   | 1  | Analyst: KK<br>6/23/2006 |
| <b>TOTAL DISSOLVED SOLIDS</b><br>Total Dissolved Solids (Residue, Filterable) | 346    | <b>E160.1</b><br>1.00  |      | mg/L  | 1  | Analyst: JC<br>6/26/2006 |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |
|                    |    |                                                          |   |                                                 |

# American Analytical Laboratories, LLC.

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-02A

**Client Sample ID:** GWQ062106:830 NP1-1-4  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                 | Result | Limit   | Qual | Units        | DF | Date Analyzed         |
|------------------------------------------|--------|---------|------|--------------|----|-----------------------|
| VOLATILE SW-846 8260 PLUS MTBE & FREON11 |        | SW8260B |      | Analyst: LDS |    |                       |
| 1,1,1,2-Tetrachloroethane                | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 1,1,1-Trichloroethane                    | 8.4    | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 1,1,2,2-Tetrachloroethane                | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 1,1,2-Trichloro-1,2,2-trifluoroethane    | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 1,1,2-Trichloroethane                    | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 1,1-Dichloroethane                       | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 1,1-Dichloroethene                       | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 1,1-Dichloropropene                      | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 1,2,3-Trichlorobenzene                   | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 1,2,3-Trichloropropane                   | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 1,2,4-Trichlorobenzene                   | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 1,2,4-Trimethylbenzene                   | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 1,2-Dibromo-3-chloropropane              | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 1,2-Dibromoethane                        | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 1,2-Dichlorobenzene                      | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 1,2-Dichloroethane                       | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 1,2-Dichloropropane                      | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 1,3,5-Trimethylbenzene                   | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 1,3-Dichlorobenzene                      | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 1,3-dichloropropane                      | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 1,4-Dichlorobenzene                      | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 2,2-Dichloropropane                      | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 2-Butanone                               | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 2-Chloroethyl vinyl ether                | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 2-Chlorotoluene                          | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 2-Hexanone                               | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 4-Chlorotoluene                          | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 4-Isopropyltoluene                       | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| 4-Methyl-2-pentanone                     | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Acetone                                  | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Benzene                                  | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Bromobenzene                             | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Bromochloromethane                       | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Bromodichloromethane                     | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Bromoform                                | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Bromomethane                             | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Carbon disulfide                         | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Carbon tetrachloride                     | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Chlorobenzene                            | U      | 1.0     |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |

**Qualifiers:** B Analyte detected in the associated Method Blank  
H Holding times for preparation or analysis exceeded  
ND Not Detected at the Reporting Limit  
U Indicates the compound was analyzed for but not detected

E Value above quantitation range  
J Analyte detected below quantitation limits  
S Spike Recovery outside accepted recovery limits  
X Value exceeds Maximum Contaminant Level

# American Analytical Laboratories, LLC.

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-02A

**Client Sample ID:** GWQ062106:830 NP1-1-4  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units        | DF | Date Analyzed         |
|-----------------------------------------------------|--------|----------------|------|--------------|----|-----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | Analyst: LDS |    |                       |
| Chloroethane                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Chloroform                                          | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Chloromethane                                       | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| cis-1,2-Dichloroethene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| cis-1,3-Dichloropropene                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Dibromochloromethane                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Dibromomethane                                      | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Dichlorodifluoromethane                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Ethylbenzene                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Hexachlorobutadiene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Isopropylbenzene                                    | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| m,p-Xylene                                          | U      | 2.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Methyl tert-butyl ether                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Methylene chloride                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Naphthalene                                         | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| n-Butylbenzene                                      | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| n-Propylbenzene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| o-Xylene                                            | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| sec-Butylbenzene                                    | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Styrene                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| tert-Butylbenzene                                   | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Tetrachloroethene                                   | 23     | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Toluene                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| trans-1,2-Dichloroethene                            | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| trans-1,3-Dichloropropene                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Trichloroethene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Trichlorofluoromethane                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Vinyl acetate                                       | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |
| Vinyl chloride                                      | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:02:00 AM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ062106:830 NP1-1-4**Lab Order:** 0606225**Tag Number:** 10267**Project:** Rowe Industries**Collection Date:** 6/21/2006**Lab ID:** 0606225-02B**Matrix:** LIQUID

| Analyses                     | Result | Limit         | Qual | Units          | DF | Date Analyzed        |
|------------------------------|--------|---------------|------|----------------|----|----------------------|
| <b>TOTAL IRON, MANGANESE</b> |        | <b>E200.7</b> |      | <b>SW3010A</b> |    | <b>Analyst: JP</b>   |
| Iron                         | 9.23   | 0.0200        |      | mg/L           | 1  | 6/27/2006 3:41:01 PM |
| Manganese                    | 1.48   | 0.0200        |      | mg/L           | 1  | 6/27/2006 3:41:01 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |
|                    |    |                                                          |   |                                                 |

**American Analytical Laboratories, LLC.**

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-02C

**Client Sample ID:** GWQ062106:830 NP1-1-4  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                  | Result | Limit  | Qual | Units   | DF | Date Analyzed        |
|---------------------------|--------|--------|------|---------|----|----------------------|
| DISSOLVED IRON, MANGANESE |        | E200.7 |      | SW3005A |    | Analyst: JP          |
| Iron                      | 0.0860 | 0.0200 |      | mg/L    | 1  | 6/27/2006 3:38:56 PM |
| Manganese                 | 1.45   | 0.0200 |      | mg/L    | 1  | 6/27/2006 3:38:56 PM |

|             |    |                                                          |   |                                                 |
|-------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| Qualifiers: | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|             | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|             | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|             | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |
|             |    |                                                          |   |                                                 |

**American Analytical Laboratories, LLC.****Date:** 28-Jun-06**CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ062106:830 NP1-1-4**Lab Order:** 0606225**Tag Number:** 10267**Project:** Rowe Industries**Collection Date:** 6/21/2006**Lab ID:** 0606225-02D**Matrix:** LIQUID

| Analyses                                            | Result | Limit | Qual           | Units | DF | Date Analyzed |
|-----------------------------------------------------|--------|-------|----------------|-------|----|---------------|
| <b>HARDNESS</b>                                     |        |       | <b>M2340 B</b> |       |    | Analyst: JP   |
| Hardness, Calcium/Magnesium (As CaCO <sub>3</sub> ) | 38.1   | 1.00  |                | mg/L  | 1  | 6/27/2006     |
| <b>TURBIDITY</b>                                    |        |       | <b>E180.1</b>  |       |    | Analyst: KK   |
| Turbidity                                           | 10.0   | 1.00  |                | NTU   | 1  | 6/23/2006     |
| <b>TOTAL DISSOLVED SOLIDS</b>                       |        |       | <b>E160.1</b>  |       |    | Analyst: JC   |
| Total Dissolved Solids (Residue, Filterable)        | 416    | 1.00  |                | mg/L  | 1  | 6/26/2006     |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

# American Analytical Laboratories, LLC.

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-03A

**Client Sample ID:** GWQ062106:840 NPI-1-5  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units        | DF | Date Analyzed         |
|-----------------------------------------------------|--------|----------------|------|--------------|----|-----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | Analyst: LDS |    |                       |
| 1,1,1,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 1,1,1-Trichloroethane                               | 2.6    | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 1,1,2,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 1,1,2-Trichloro-1,2,2-trifluoroethane               | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 1,1,2-Trichloroethane                               | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 1,1-Dichloroethane                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 1,1-Dichloroethene                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 1,1-Dichloropropene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 1,2,3-Trichlorobenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 1,2,3-Trichloropropane                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 1,2,4-Trichlorobenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 1,2,4-Trimethylbenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 1,2-Dibromo-3-chloropropane                         | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 1,2-Dibromoethane                                   | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 1,2-Dichlorobenzene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 1,2-Dichloroethane                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 1,2-Dichloropropane                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 1,3,5-Trimethylbenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 1,3-Dichlorobenzene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 1,3-dichloropropane                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 1,4-Dichlorobenzene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 2,2-Dichloropropane                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 2-Butanone                                          | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 2-Chloroethyl vinyl ether                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 2-Chlorotoluene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 2-Hexanone                                          | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 4-Chlorotoluene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 4-Isopropyltoluene                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| 4-Methyl-2-pentanone                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Acetone                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Benzene                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Bromobenzene                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Bromochloromethane                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Bromodichloromethane                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Bromoform                                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Bromomethane                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Carbon disulfide                                    | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Carbon tetrachloride                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Chlorobenzene                                       | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |
|                    |    |                                                          |   |                                                 |

**American Analytical Laboratories, LLC.**

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-03A

**Client Sample ID:** GWQ062106:840 NP1-1-5  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units        | DF | Date Analyzed         |
|-----------------------------------------------------|--------|----------------|------|--------------|----|-----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | Analyst: LDS |    |                       |
| Chloroethane                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Chloroform                                          | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Chloromethane                                       | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| cis-1,2-Dichloroethene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| cis-1,3-Dichloropropene                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Dibromochloromethane                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Dibromomethane                                      | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Dichlorodifluoromethane                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Ethylbenzene                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Hexachlorobutadiene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Isopropylbenzene                                    | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| m,p-Xylene                                          | U      | 2.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Methyl tert-butyl ether                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Methylene chloride                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Naphthalene                                         | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| n-Butylbenzene                                      | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| n-Propylbenzene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| o-Xylene                                            | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| sec-Butylbenzene                                    | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Styrene                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| tert-Butylbenzene                                   | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Tetrachloroethene                                   | 2.4    | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Toluene                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| trans-1,2-Dichloroethene                            | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| trans-1,3-Dichloropropene                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Trichloroethene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Trichlorofluoromethane                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Vinyl acetate                                       | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |
| Vinyl chloride                                      | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 11:40:00 AM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |
|                    |    |                                                          |   |                                                 |

**American Analytical Laboratories, LLC.****Date:** 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-03B

**Client Sample ID:** GWQ062106:840 NP1-1-5  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                     | Result  | Limit         | Qual | Units          | DF | Date Analyzed        |
|------------------------------|---------|---------------|------|----------------|----|----------------------|
| <b>TOTAL IRON, MANGANESE</b> |         | <b>E200.7</b> |      | <b>SW3010A</b> |    | <b>Analyst: JP</b>   |
| Iron                         | 0.195   | 0.0200        |      | mg/L           | 1  | 6/27/2006 3:46:03 PM |
| Manganese                    | 0.00800 | 0.0200        | J    | mg/L           | 1  | 6/27/2006 3:46:03 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.****Date:** 28-Jun-06**CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ062106:840 NP1-1-5**Lab Order:** 0606225**Tag Number:** 10267**Project:** Rowe Industries**Collection Date:** 6/21/2006**Lab ID:** 0606225-03C**Matrix:** LIQUID

| Analyses                  | Result  | Limit  | Qual | Units   | DF | Date Analyzed        |
|---------------------------|---------|--------|------|---------|----|----------------------|
| DISSOLVED IRON, MANGANESE |         | E200.7 |      | SW3005A |    | Analyst: JP          |
| Iron                      | 0.0120  | 0.0200 | J    | mg/L    | 1  | 6/27/2006 3:44:11 PM |
| Manganese                 | 0.00800 | 0.0200 | J    | mg/L    | 1  | 6/27/2006 3:44:11 PM |

**Qualifiers:**

|    |                                                          |
|----|----------------------------------------------------------|
| B  | Analyte detected in the associated Method Blank          |
| H  | Holding times for preparation or analysis exceeded       |
| ND | Not Detected at the Reporting Limit                      |
| U  | Indicates the compound was analyzed for but not detected |

|   |                                                 |
|---|-------------------------------------------------|
| E | Value above quantitation range                  |
| J | Analyte detected below quantitation limits      |
| S | Spike Recovery outside accepted recovery limits |
| X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-03D

**Client Sample ID:** GWQ062106:840 NP1-1-5  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                                                      | Result | Limit                  | Qual | Units | DF | Date Analyzed            |
|-------------------------------------------------------------------------------|--------|------------------------|------|-------|----|--------------------------|
| <b>HARDNESS</b><br>Hardness, Calcium/Magnesium (As CaCO <sub>3</sub> )        | 35.8   | <b>M2340 B</b><br>1.00 |      | mg/L  | 1  | Analyst: JP<br>6/27/2006 |
| <b>TURBIDITY</b><br>Turbidity                                                 | U      | <b>E180.1</b><br>1.00  |      | NTU   | 1  | Analyst: KK<br>6/23/2006 |
| <b>TOTAL DISSOLVED SOLIDS</b><br>Total Dissolved Solids (Residue, Filterable) | 426    | <b>E160.1</b><br>1.00  |      | mg/L  | 1  | Analyst: JC<br>6/26/2006 |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |
|                    |    |                                                          |   |                                                 |

# American Analytical Laboratories, LLC.

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-04A

**Client Sample ID:** GWQ062106:850 NP1-1-6  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units               | DF | Date Analyzed         |
|-----------------------------------------------------|--------|----------------|------|---------------------|----|-----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | Analyst: <b>LDS</b> |    |                       |
| 1,1,1,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 1,1,1-Trichloroethane                               | 20     | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 1,1,2,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 1,1,2-Trichloro-1,2,2-trifluoroethane               | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 1,1,2-Trichloroethane                               | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 1,1-Dichloroethane                                  | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 1,1-Dichloroethene                                  | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 1,1-Dichloropropene                                 | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 1,2,3-Trichlorobenzene                              | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 1,2,3-Trichloropropane                              | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 1,2,4-Trichlorobenzene                              | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 1,2,4-Trimethylbenzene                              | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 1,2-Dibromo-3-chloropropane                         | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 1,2-Dibromoethane                                   | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 1,2-Dichlorobenzene                                 | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 1,2-Dichloroethane                                  | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 1,2-Dichloropropane                                 | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 1,3,5-Trimethylbenzene                              | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 1,3-Dichlorobenzene                                 | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 1,3-dichloropropane                                 | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 1,4-Dichlorobenzene                                 | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 2,2-Dichloropropane                                 | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 2-Butanone                                          | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 2-Chloroethyl vinyl ether                           | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 2-Chlorotoluene                                     | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 2-Hexanone                                          | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 4-Chlorotoluene                                     | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 4-Isopropyltoluene                                  | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| 4-Methyl-2-pentanone                                | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| Acetone                                             | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| Benzene                                             | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| Bromobenzene                                        | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| Bromochloromethane                                  | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| Bromodichloromethane                                | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| Bromoform                                           | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| Bromomethane                                        | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| Carbon disulfide                                    | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| Carbon tetrachloride                                | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |
| Chlorobenzene                                       | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 12:18:00 PM |

|                    |    |                                                         |   |                                                 |
|--------------------|----|---------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank         | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded      | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                     | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detecte | X | Value exceeds Maximum Contaminant Level         |
|                    |    |                                                         |   |                                                 |

**American Analytical Laboratories, LLC.**

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-04A

**Client Sample ID:** GWQ062106:850 NP1-1-6  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units | DF | Date Analyzed         |
|-----------------------------------------------------|--------|----------------|------|-------|----|-----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      |       |    | <b>Analyst: LDS</b>   |
| Chloroethane                                        | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| Chloroform                                          | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| Chloromethane                                       | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| cis-1,2-Dichloroethene                              | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| cis-1,3-Dichloropropene                             | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| Dibromochloromethane                                | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| Dibromomethane                                      | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| Dichlorodifluoromethane                             | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| Ethylbenzene                                        | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| Hexachlorobutadiene                                 | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| Isopropylbenzene                                    | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| m,p-Xylene                                          | U      | 2.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| Methyl tert-butyl ether                             | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| Methylene chloride                                  | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| Naphthalene                                         | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| n-Butylbenzene                                      | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| n-Propylbenzene                                     | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| o-Xylene                                            | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| sec-Butylbenzene                                    | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| Styrene                                             | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| tert-Butylbenzene                                   | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| Tetrachloroethene                                   | 83     | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| Toluene                                             | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| trans-1,2-Dichloroethene                            | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| trans-1,3-Dichloropropene                           | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| Trichloroethene                                     | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| Trichlorofluoromethane                              | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| Vinyl acetate                                       | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |
| Vinyl chloride                                      | U      | 1.0            |      | µg/L  | 1  | 6/24/2006 12:18:00 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-04B

**Client Sample ID:** GWQ062106:850 NP1-1-6  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                     | Result | Limit         | Qual | Units          | DF | Date Analyzed        |
|------------------------------|--------|---------------|------|----------------|----|----------------------|
| <b>TOTAL IRON, MANGANESE</b> |        | <b>E200.7</b> |      | <b>SW3010A</b> |    | <b>Analyst: JP</b>   |
| Iron                         | 0.0750 | 0.0200        |      | mg/L           | 1  | 6/27/2006 3:50:26 PM |
| Manganese                    | 0.210  | 0.0200        |      | mg/L           | 1  | 6/27/2006 3:50:26 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.****Date:** 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-04C

**Client Sample ID:** GWQ062106:850 NP1-1-6  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                  | Result | Limit  | Qual | Units   | DF | Date Analyzed        |
|---------------------------|--------|--------|------|---------|----|----------------------|
| DISSOLVED IRON, MANGANESE |        | E200.7 |      | SW3005A |    | Analyst: JP          |
| Iron                      | 0.0250 | 0.0200 |      | mg/L    | 1  | 6/27/2006 3:48:06 PM |
| Manganese                 | 0.206  | 0.0200 |      | mg/L    | 1  | 6/27/2006 3:48:06 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |
|                    |    |                                                          |   |                                                 |

**American Analytical Laboratories, LLC.**

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-04D

**Client Sample ID:** GWQ062106:850 NP1-1-6  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit | Qual | Units | DF | Date Analyzed |
|-----------------------------------------------------|--------|-------|------|-------|----|---------------|
| <b>HARDNESS</b>                                     |        |       |      |       |    | Analyst: JP   |
| Hardness, Calcium/Magnesium (As CaCO <sub>3</sub> ) | 32.8   | 1.00  |      | mg/L  | 1  | 6/27/2006     |
| <b>TURBIDITY</b>                                    |        |       |      |       |    | Analyst: KK   |
| Turbidity                                           | U      | 1.00  |      | NTU   | 1  | 6/23/2006     |
| <b>TOTAL DISSOLVED SOLIDS</b>                       |        |       |      |       |    | Analyst: JC   |
| Total Dissolved Solids (Residue, Filterable)        | 346    | 1.00  |      | mg/L  | 1  | 6/26/2006     |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

# American Analytical Laboratories, LLC.

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-05A

**Client Sample ID:** GWQ062106:900 NP1-1-7  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units        | DF | Date Analyzed         |
|-----------------------------------------------------|--------|----------------|------|--------------|----|-----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | Analyst: LDS |    |                       |
| 1,1,1,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 1,1,1-Trichloroethane                               | 4.6    | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 1,1,2,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 1,1,2-Trichloro-1,2,2-trifluoroethane               | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 1,1,2-Trichloroethane                               | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 1,1-Dichloroethane                                  | 1.6    | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 1,1-Dichloroethene                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 1,1-Dichloropropene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 1,2,3-Trichlorobenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 1,2,3-Trichloropropane                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 1,2,4-Trichlorobenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 1,2,4-Trimethylbenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 1,2-Dibromo-3-chloropropane                         | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 1,2-Dibromoethane                                   | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 1,2-Dichlorobenzene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 1,2-Dichloroethane                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 1,2-Dichloropropane                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 1,3,5-Trimethylbenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 1,3-Dichlorobenzene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 1,3-dichloropropane                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 1,4-Dichlorobenzene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 2,2-Dichloropropane                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 2-Butanone                                          | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 2-Chloroethyl vinyl ether                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 2-Chlorotoluene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 2-Hexanone                                          | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 4-Chlorotoluene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 4-Isopropyltoluene                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| 4-Methyl-2-pentanone                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Acetone                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Benzene                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Bromobenzene                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Bromochloromethane                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Bromodichloromethane                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Bromoform                                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Bromomethane                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Carbon disulfide                                    | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Carbon tetrachloride                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Chlorobenzene                                       | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |

**Qualifiers:** B Analyte detected in the associated Method Blank  
H Holding times for preparation or analysis exceeded  
ND Not Detected at the Reporting Limit  
U Indicates the compound was analyzed for but not detected

E Value above quantitation range  
J Analyte detected below quantitation limits  
S Spike Recovery outside accepted recovery limits  
X Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-05A

**Client Sample ID:** GWQ062106:900 NP1-1-7  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units        | DF | Date Analyzed         |
|-----------------------------------------------------|--------|----------------|------|--------------|----|-----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | Analyst: LDS |    |                       |
| Chloroethane                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Chloroform                                          | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Chloromethane                                       | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| cis-1,2-Dichloroethene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| cis-1,3-Dichloropropene                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Dibromochloromethane                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Dibromomethane                                      | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Dichlorodifluoromethane                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Ethylbenzene                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Hexachlorobutadiene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Isopropylbenzene                                    | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| m,p-Xylene                                          | U      | 2.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Methyl tert-butyl ether                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Methylene chloride                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Naphthalene                                         | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| n-Butylbenzene                                      | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| n-Propylbenzene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| o-Xylene                                            | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| sec-Butylbenzene                                    | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Styrene                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| tert-Butylbenzene                                   | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Tetrachloroethene                                   | 44     | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Toluene                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| trans-1,2-Dichloroethene                            | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| trans-1,3-Dichloropropene                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Trichloroethene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Trichlorofluoromethane                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Vinyl acetate                                       | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |
| Vinyl chloride                                      | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 12:55:00 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |
|                    |    |                                                          |   |                                                 |

**American Analytical Laboratories, LLC.****Date:** 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-05B

**Client Sample ID:** GWQ062106:900 NP1-1-7  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                     | Result | Limit         | Qual | Units          | DF | Date Analyzed        |
|------------------------------|--------|---------------|------|----------------|----|----------------------|
| <b>TOTAL IRON, MANGANESE</b> |        | <b>E200.7</b> |      | <b>SW3010A</b> |    | <b>Analyst: JP</b>   |
| Iron                         | 0.0810 | 0.0200        |      | mg/L           | 1  | 6/27/2006 3:54:55 PM |
| Manganese                    | 0.0630 | 0.0200        |      | mg/L           | 1  | 6/27/2006 3:54:55 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.****Date:** 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-05C

**Client Sample ID:** GWQ062106:900 NP1-1-7  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                  | Result | Limit  | Qual | Units   | DF | Date Analyzed        |
|---------------------------|--------|--------|------|---------|----|----------------------|
| DISSOLVED IRON, MANGANESE |        | E200.7 |      | SW3005A |    | Analyst: JP          |
| Iron                      | 0.0130 | 0.0200 | J    | mg/L    | 1  | 6/27/2006 3:52:31 PM |
| Manganese                 | 0.0590 | 0.0200 |      | mg/L    | 1  | 6/27/2006 3:52:31 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |
|                    |    |                                                          |   |                                                 |

**American Analytical Laboratories, LLC.**

Date: 28-Jun-06

|                   |                                  |                          |                       |
|-------------------|----------------------------------|--------------------------|-----------------------|
| <b>CLIENT:</b>    | Leggette Brashears & Graham Inc. | <b>Client Sample ID:</b> | GWQ062106:900 NP1-1-7 |
| <b>Lab Order:</b> | 0606225                          | <b>Tag Number:</b>       | 10267                 |
| <b>Project:</b>   | Rowe Industries                  | <b>Collection Date:</b>  | 6/21/2006             |
| <b>Lab ID:</b>    | 0606225-05D                      | <b>Matrix:</b>           | LIQUID                |

| Analyses                                            | Result | Limit          | Qual | Units | DF | Date Analyzed |
|-----------------------------------------------------|--------|----------------|------|-------|----|---------------|
| <b>HARDNESS</b>                                     |        | <b>M2340 B</b> |      |       |    | Analyst: JP   |
| Hardness, Calcium/Magnesium (As CaCO <sub>3</sub> ) | 29.9   | 1.00           |      | mg/L  | 1  | 6/27/2006     |
| <b>TURBIDITY</b>                                    |        | <b>E180.1</b>  |      |       |    | Analyst: KK   |
| Turbidity                                           | U      | 1.00           |      | NTU   | 1  | 6/23/2006     |
| <b>TOTAL DISSOLVED SOLIDS</b>                       |        | <b>E160.1</b>  |      |       |    | Analyst: JC   |
| Total Dissolved Solids (Residue, Filterable)        | 438    | 1.00           |      | mg/L  | 1  | 6/26/2006     |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

# American Analytical Laboratories, LLC.

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-06A

**Client Sample ID:** GWQ062106:910 NP1-1-8  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units        | DF | Date Analyzed        |
|-----------------------------------------------------|--------|----------------|------|--------------|----|----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | Analyst: LDS |    |                      |
| 1,1,1,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 1,1,1-Trichloroethane                               | 2.8    | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 1,1,2,2-Tetrachloroethane                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 1,1,2-Trichloro-1,2,2-trifluoroethane               | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 1,1,2-Trichloroethane                               | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 1,1-Dichloroethane                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 1,1-Dichloroethene                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 1,1-Dichloropropene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 1,2,3-Trichlorobenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 1,2,3-Trichloropropane                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 1,2,4-Trichlorobenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 1,2,4-Trimethylbenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 1,2-Dibromo-3-chloropropane                         | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 1,2-Dibromoethane                                   | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 1,2-Dichlorobenzene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 1,2-Dichloroethane                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 1,2-Dichloropropane                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 1,3,5-Trimethylbenzene                              | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 1,3-Dichlorobenzene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 1,3-dichloropropane                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 1,4-Dichlorobenzene                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 2,2-Dichloropropane                                 | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 2-Butanone                                          | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 2-Chloroethyl vinyl ether                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 2-Chlorotoluene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 2-Hexanone                                          | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 4-Chlorotoluene                                     | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 4-Isopropyltoluene                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| 4-Methyl-2-pentanone                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| Acetone                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| Benzene                                             | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| Bromobenzene                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| Bromochloromethane                                  | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| Bromodichloromethane                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| Bromoform                                           | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| Bromomethane                                        | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| Carbon disulfide                                    | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| Carbon tetrachloride                                | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |
| Chlorobenzene                                       | U      | 1.0            |      | µg/L         | 1  | 6/24/2006 1:32:00 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |
|                    |    |                                                          |   |                                                 |

# American Analytical Laboratories, LLC.

Date: 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-06A

**Client Sample ID:** GWQ062106:910 NP1-1-8  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit          | Qual | Units               | DF | Date Analyzed        |
|-----------------------------------------------------|--------|----------------|------|---------------------|----|----------------------|
| <b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b> |        | <b>SW8260B</b> |      | <b>Analyst: LDS</b> |    |                      |
| Chloroethane                                        | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| Chloroform                                          | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| Chloromethane                                       | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| cis-1,2-Dichloroethene                              | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| cis-1,3-Dichloropropene                             | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| Dibromochloromethane                                | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| Dibromomethane                                      | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| Dichlorodifluoromethane                             | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| Ethylbenzene                                        | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| Hexachlorobutadiene                                 | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| Isopropylbenzene                                    | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| m,p-Xylene                                          | U      | 2.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| Methyl tert-butyl ether                             | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| Methylene chloride                                  | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| Naphthalene                                         | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| n-Butylbenzene                                      | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| n-Propylbenzene                                     | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| o-Xylene                                            | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| sec-Butylbenzene                                    | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| Styrene                                             | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| tert-Butylbenzene                                   | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| Tetrachloroethene                                   | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| Toluene                                             | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| trans-1,2-Dichloroethene                            | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| trans-1,3-Dichloropropene                           | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| Trichloroethene                                     | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| Trichlorofluoromethane                              | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| Vinyl acetate                                       | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |
| Vinyl chloride                                      | U      | 1.0            |      | µg/L                | 1  | 6/24/2006 1:32:00 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.**

Date: 28-Jun-06

|                   |                                  |                          |                       |
|-------------------|----------------------------------|--------------------------|-----------------------|
| <b>CLIENT:</b>    | Leggette Brashears & Graham Inc. | <b>Client Sample ID:</b> | GWQ062106:910 NP1-1-8 |
| <b>Lab Order:</b> | 0606225                          | <b>Tag Number:</b>       | 10267                 |
| <b>Project:</b>   | Rowe Industries                  | <b>Collection Date:</b>  | 6/21/2006             |
| <b>Lab ID:</b>    | 0606225-06B                      | <b>Matrix:</b>           | LIQUID                |

| Analyses                     | Result | Limit         | Qual | Units          | DF | Date Analyzed        |
|------------------------------|--------|---------------|------|----------------|----|----------------------|
| <b>TOTAL IRON, MANGANESE</b> |        | <b>E200.7</b> |      | <b>SW3010A</b> |    | Analyst: JP          |
| Iron                         | 8.40   | 0.0200        |      | mg/L           | 1  | 6/27/2006 4:07:31 PM |
| Manganese                    | 0.848  | 0.0200        |      | mg/L           | 1  | 6/27/2006 4:07:31 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

**American Analytical Laboratories, LLC.****Date:** 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-06C

**Client Sample ID:** GWQ062106:910 NP1-1-8  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                  | Result | Limit  | Qual | Units   | DF | Date Analyzed        |
|---------------------------|--------|--------|------|---------|----|----------------------|
| DISSOLVED IRON, MANGANESE |        | E200.7 |      | SW3005A |    | Analyst: JP          |
| Iron                      | 0.897  | 0.0200 |      | mg/L    | 1  | 6/27/2006 4:02:49 PM |
| Manganese                 | 0.798  | 0.0200 |      | mg/L    | 1  | 6/27/2006 4:02:49 PM |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |
|                    |    |                                                          |   |                                                 |

**American Analytical Laboratories, LLC.****Date:** 28-Jun-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0606225  
**Project:** Rowe Industries  
**Lab ID:** 0606225-06D

**Client Sample ID:** GWQ062106:910 NP1-1-8  
**Tag Number:** 10267  
**Collection Date:** 6/21/2006  
**Matrix:** LIQUID

| Analyses                                            | Result | Limit | Qual | Units | DF | Date Analyzed |
|-----------------------------------------------------|--------|-------|------|-------|----|---------------|
| <b>HARDNESS</b>                                     |        |       |      |       |    | Analyst: JP   |
| Hardness, Calcium/Magnesium (As CaCO <sub>3</sub> ) | 23.5   | 1.00  |      | mg/L  | 1  | 6/27/2006     |
| <b>TURBIDITY</b>                                    |        |       |      |       |    | Analyst: KK   |
| Turbidity                                           | 4.50   | 1.00  |      | NTU   | 1  | 6/23/2006     |
| <b>TOTAL DISSOLVED SOLIDS</b>                       |        |       |      |       |    | Analyst: JC   |
| Total Dissolved Solids (Residue, Filterable)        | 68.0   | 1.00  |      | mg/L  | 1  | 6/26/2006     |

|                    |    |                                                          |   |                                                 |
|--------------------|----|----------------------------------------------------------|---|-------------------------------------------------|
| <b>Qualifiers:</b> | B  | Analyte detected in the associated Method Blank          | E | Value above quantitation range                  |
|                    | H  | Holding times for preparation or analysis exceeded       | J | Analyte detected below quantitation limits      |
|                    | ND | Not Detected at the Reporting Limit                      | S | Spike Recovery outside accepted recovery limits |
|                    | U  | Indicates the compound was analyzed for but not detected | X | Value exceeds Maximum Contaminant Level         |

|                                           |            |
|-------------------------------------------|------------|
| <b>H6F230109 Analytical Report.....</b>   | <b>1</b>   |
| <b>Sample Receipt Documentation .....</b> | <b>15</b>  |
| <b>Volatiles .....</b>                    | <b>18</b>  |
| Raw Sample Data .....                     | 19         |
| Standards Data .....                      | 93         |
| Raw QC Data.....                          | 178        |
| Miscellaneous Data.....                   | 207        |
| <b>Sample Receipt Documentation .....</b> | <b>211</b> |
| <b>Total Number of Pages .....</b>        | <b>213</b> |



STL

STL Knoxville  
5815 Middlebrook Pike  
Knoxville, TN 37921

Tel: 865 291 3000 Fax: 865 584 4315  
www.stl-inc.com

## ANALYTICAL REPORT

NABSAG 0401

Lot #: H6F230109

Mark Goldberg

Leggette, Brashears & Graham,  
4 Research Drive  
Suite #301  
Shelton, CT 06484

SEVERN TRENT LABORATORIES, INC.

A handwritten signature in black ink, appearing to read "Scott A. Harris".

Scott A. Harris  
Project Manager

July 5, 2006

## ANALYTICAL METHODS SUMMARY

H6F230109

| <u>PARAMETER</u>          | <u>ANALYTICAL<br/>METHOD</u> |
|---------------------------|------------------------------|
| Volatile Organics by TO15 | EPA-2 TO-15                  |

### References:

EPA-2      "Compendium of Methods for the Determination of Toxic Organic Compounds in Ambient Air", EPA-625/R-96/010b, January 1999.

**SAMPLE SUMMARY**

H6F230109

| <u>WO #</u> | <u>SAMPLE#</u> | <u>CLIENT SAMPLE ID</u> | <u>SAMPLED<br/>DATE</u> | <u>SAMP<br/>TIME</u> |
|-------------|----------------|-------------------------|-------------------------|----------------------|
| H7210       | 001            | AQ062106:800 NP4-1      | 06/22/06                | 08:00                |
| H7211       | 002            | AQ062106:805 NP4-2      | 06/22/06                | 08:05                |
| H7212       | 003            | AQ062106:810 NP4-3      | 06/22/06                | 08:10                |

**NOTE(S) :**

- The analytical results of the samples listed above are presented on the following pages.
- All calculations are performed before rounding to avoid round-off errors in calculated results.
- Results noted as "ND" were not detected at or above the stated limit.
- This report must not be reproduced, except in full, without the written approval of the laboratory.
- Results for the following parameters are never reported on a dry weight basis: color, corrosivity, density, flashpoint, ignitability, layers, odor, paint filter test, pH, porosity pressure, reactivity, redox potential, specific gravity, spot tests, solids, solubility, temperature, viscosity, and weight.

## **PROJECT NARRATIVE**

### **H6F230109**

The results reported herein are applicable to the samples submitted for analysis only.

This report shall not be reproduced except in full, without the written approval of the laboratory.

**The original chain of custody documentation is included with this report.**

#### **Sample Receipt**

The “Relinquished by” field on the chain of custody documentation did not contain a signature.

#### **Quality Control**

Unless otherwise noted, all holding times and QC criteria were met and the test results shown in this report meet all applicable NELAC requirements.

Samples were received on 6/23/06 in Tedlar bags and analyzed within 72 hours of sampling.

STL Knoxville maintains the following certifications, approvals and accreditations: Arkansas DEQ Cert. #05-043-0, California DHS ELAP Cert. #2423, Colorado DPHE, Connecticut DPH Cert. #PH-0223, Florida DOH Cert. #E87177, Georgia DNR Cert. #906 (SDWA, expires 6/24/05), Hawaii DOH, Illinois EPA Cert. #000687, Indiana DOH Cert. #C-TN-02, Iowa DNR Cert. #375, Kansas DHE Cert. #E-10349, Kentucky DEP Lab ID #90101, Louisiana DEQ Cert. #03079, Louisiana DOHH Cert. #LA030024, Maryland DHMH Cert. #277, Massachusetts DEP Cert. #M-TN009, Michigan DEQ Lab ID #9933, New Jersey DEP Cert. #TN001, New York DOH Lab #10781, North Carolina DPH Lab ID #21705, North Carolina DEHNR Cert. #64, Ohio EPA VAP Cert. #CL0059, Oklahoma DEQ ID #9415, Pennsylvania DEP Cert. #68-00576, South Carolina DHEC Lab ID #84001001, Tennessee DOH Lab ID #02014, Utah DOH Cert. # QUAN3, Virginia DGS Lab ID #00165, Washington DOE Lab #C120, West Virginia DEP Cert. #345, Wisconsin DNR Lab ID #998044300, US Army Corps of Engineers, Naval Facilities Engineering Service Center and USDA Soil Permit #S-46424. This list of approvals is subject to change and does not imply that laboratory certification is available for all parameters reported in this environmental sample data report.

# Sample Data Summary

## Leggette, Brashears &amp; Graham, Inc.

Client Sample ID: AQ062106:800 NP4-1

## GC/MS Volatiles

Lot-Sample # H6F230109 - 001

Work Order # H72101AA

Matrix.....: AIR

Date Sampled...: 6/22/06

Date Received..: 6/23/06

Prep Date.....: 6/23/06

Analysis Date... 6/23/06

Prep Batch #.....: 6177623

Dilution Factor.: 5

Method.....: TO-15

| PARAMETER                      | RESULTS<br>(ppb(v/v)) | REPORTING<br>LIMIT (ppb(v/v)) | RESULTS (ug/m3) | REPORTING<br>LIMIT (ug/m3) |
|--------------------------------|-----------------------|-------------------------------|-----------------|----------------------------|
| <b>Benzene</b>                 | <b>0.29</b>           | <b>1.0</b>                    | <b>0.93 J</b>   | <b>3.2</b>                 |
| Bromodichloromethane           | ND                    | 1.0                           | ND              | 6.7                        |
| Bromoform                      | ND                    | 1.0                           | ND              | 10                         |
| Bromomethane                   | ND                    | 1.0                           | ND              | 3.9                        |
| <b>Carbon disulfide</b>        | <b>4.5</b>            | <b>2.5</b>                    | <b>14</b>       | <b>7.8</b>                 |
| Carbon tetrachloride           | ND                    | 1.0                           | ND              | 6.3                        |
| Chlorobenzene                  | ND                    | 1.0                           | ND              | 4.6                        |
| Dibromochloromethane           | ND                    | 1.0                           | ND              | 8.5                        |
| Chloroethane                   | ND                    | 1.0                           | ND              | 2.6                        |
| <b>Chloroform</b>              | <b>0.60</b>           | <b>1.0</b>                    | <b>2.9 J</b>    | <b>4.9</b>                 |
| <b>Chloromethane</b>           | <b>0.93</b>           | <b>2.5</b>                    | <b>1.9 J</b>    | <b>5.2</b>                 |
| <b>1,1-Dichloroethane</b>      | <b>3.4</b>            | <b>1.0</b>                    | <b>14</b>       | <b>4.0</b>                 |
| 1,2-Dichloroethane             | ND                    | 1.0                           | ND              | 4.0                        |
| <b>cis-1,2-Dichloroethene</b>  | <b>1.6</b>            | <b>1.0</b>                    | <b>6.2</b>      | <b>4.0</b>                 |
| trans-1,2-Dichloroethene       | ND                    | 1.0                           | ND              | 4.0                        |
| <b>1,1-Dichloroethene</b>      | <b>0.94</b>           | <b>1.0</b>                    | <b>3.7 J</b>    | <b>4.0</b>                 |
| 1,2-Dichloropropane            | ND                    | 1.0                           | ND              | 4.6                        |
| cis-1,3-Dichloropropene        | ND                    | 1.0                           | ND              | 4.5                        |
| trans-1,3-Dichloropropene      | ND                    | 1.0                           | ND              | 4.5                        |
| Ethylbenzene                   | ND                    | 1.0                           | ND              | 4.3                        |
| <b>Methylene chloride</b>      | <b>0.57</b>           | <b>2.5</b>                    | <b>2.0 J B</b>  | <b>8.7</b>                 |
| Styrene                        | ND                    | 1.0                           | ND              | 4.3                        |
| 1,1,2,2-Tetrachloroethane      | ND                    | 1.0                           | ND              | 6.9                        |
| <b>Tetrachloroethene</b>       | <b>22</b>             | <b>1.0</b>                    | <b>150</b>      | <b>6.8</b>                 |
| <b>Toluene</b>                 | <b>1.3</b>            | <b>1.0</b>                    | <b>4.8</b>      | <b>3.8</b>                 |
| <b>1,1,1-Trichloroethane</b>   | <b>14</b>             | <b>1.0</b>                    | <b>74</b>       | <b>5.5</b>                 |
| 1,1,2-Trichloroethane          | ND                    | 1.0                           | ND              | 5.5                        |
| <b>Trichloroethene</b>         | <b>1.7</b>            | <b>1.0</b>                    | <b>9.0</b>      | <b>5.4</b>                 |
| <b>Vinyl chloride</b>          | <b>0.36</b>           | <b>1.0</b>                    | <b>0.91 J</b>   | <b>2.6</b>                 |
| <b>m-Xylene &amp; p-Xylene</b> | <b>0.52</b>           | <b>1.0</b>                    | <b>2.2 J</b>    | <b>4.3</b>                 |
| o-Xylene                       | ND                    | 1.0                           | ND              | 4.3                        |

| SURROGATE             | PERCENT<br>RECOVERY | LABORATORY<br>CONTROL<br>LIMITS (%) |
|-----------------------|---------------------|-------------------------------------|
| 1,2-Dichloroethane-d4 | 102                 | 70 - 130                            |
| Toluene-d8            | 106                 | 70 - 130                            |

Leggette, Brashears & Graham, Inc.  
 Client Sample ID: AQ062106:800 NP4-1  
 GC/MS Volatiles

|                              |                       |                                     |
|------------------------------|-----------------------|-------------------------------------|
| Lot-Sample # H6F230109 - 001 | Work Order # H72101AA | Matrix.....: AIR                    |
| SURROGATE                    | PERCENT<br>RECOVERY   | LABORATORY<br>CONTROL<br>LIMITS (%) |
| 4-Bromofluorobenzene         | 97                    | 70 - 130                            |

Qualifiers

B Method blank contamination. The associated method blank contains the target analyte at a reportable level.  
 J Estimated result. Result is less than RL.

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)\*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) \* Dilution Factor) \* (Molecular Weight/24.45)

Leggette, Brashears & Graham, Inc.  
 Client Sample ID: AQ062106:805 NP4-2  
 GC/MS Volatiles

Lot-Sample # H6F230109 - 002

Work Order # H72111AA

Matrix.....: AIR

Date Sampled...: 6/22/06

Date Received...: 6/23/06

Prep Date.....: 6/23/06

Analysis Date...: 6/23/06

Prep Batch #.....: 6177623

Dilution Factor.: 5

Method.....: TO-15

| PARAMETER                      | RESULTS<br>(ppb(v/v)) | REPORTING<br>LIMIT (ppb(v/v)) | RESULTS (ug/m3) | REPORTING<br>LIMIT (ug/m3) |
|--------------------------------|-----------------------|-------------------------------|-----------------|----------------------------|
| Benzene                        | ND                    | 1.0                           | ND              | 3.2                        |
| Bromodichloromethane           | ND                    | 1.0                           | ND              | 6.7                        |
| Bromoform                      | ND                    | 1.0                           | ND              | 10                         |
| Bromomethane                   | ND                    | 1.0                           | ND              | 3.9                        |
| <b>Carbon disulfide</b>        | <b>4.5</b>            | <b>2.5</b>                    | <b>14</b>       | <b>7.8</b>                 |
| Carbon tetrachloride           | ND                    | 1.0                           | ND              | 6.3                        |
| Chlorobenzene                  | ND                    | 1.0                           | ND              | 4.6                        |
| Dibromochloromethane           | ND                    | 1.0                           | ND              | 8.5                        |
| Chloroethane                   | ND                    | 1.0                           | ND              | 2.6                        |
| <b>Chloroform</b>              | <b>0.47</b>           | <b>1.0</b>                    | <b>2.3</b> J    | <b>4.9</b>                 |
| <b>Chloromethane</b>           | <b>1.3</b>            | <b>2.5</b>                    | <b>2.6</b> J    | <b>5.2</b>                 |
| <b>1,1-Dichloroethane</b>      | <b>2.0</b>            | <b>1.0</b>                    | <b>8.1</b>      | <b>4.0</b>                 |
| 1,2-Dichloroethane             | ND                    | 1.0                           | ND              | 4.0                        |
| <b>cis-1,2-Dichloroethene</b>  | <b>1.1</b>            | <b>1.0</b>                    | <b>4.5</b>      | <b>4.0</b>                 |
| trans-1,2-Dichloroethene       | ND                    | 1.0                           | ND              | 4.0                        |
| <b>1,1-Dichloroethene</b>      | <b>0.71</b>           | <b>1.0</b>                    | <b>2.8</b> J    | <b>4.0</b>                 |
| 1,2-Dichloropropane            | ND                    | 1.0                           | ND              | 4.6                        |
| cis-1,3-Dichloropropene        | ND                    | 1.0                           | ND              | 4.5                        |
| trans-1,3-Dichloropropene      | ND                    | 1.0                           | ND              | 4.5                        |
| Ethylbenzene                   | ND                    | 1.0                           | ND              | 4.3                        |
| <b>Methylene chloride</b>      | <b>0.56</b>           | <b>2.5</b>                    | <b>1.9</b> J B  | <b>8.7</b>                 |
| Styrene                        | ND                    | 1.0                           | ND              | 4.3                        |
| 1,1,2,2-Tetrachloroethane      | ND                    | 1.0                           | ND              | 6.9                        |
| Tetrachloroethene              | ND                    | 1.0                           | ND              | 6.8                        |
| <b>Toluene</b>                 | <b>0.95</b>           | <b>1.0</b>                    | <b>3.6</b> J    | <b>3.8</b>                 |
| <b>1,1,1-Trichloroethane</b>   | <b>4.6</b>            | <b>1.0</b>                    | <b>25</b>       | <b>5.5</b>                 |
| 1,1,2-Trichloroethane          | ND                    | 1.0                           | ND              | 5.5                        |
| Trichloroethene                | ND                    | 1.0                           | ND              | 5.4                        |
| <b>Vinyl chloride</b>          | <b>0.40</b>           | <b>1.0</b>                    | <b>1.0</b> J    | <b>2.6</b>                 |
| <b>m-Xylene &amp; p-Xylene</b> | <b>0.33</b>           | <b>1.0</b>                    | <b>1.4</b> J    | <b>4.3</b>                 |
| o-Xylene                       | ND                    | 1.0                           | ND              | 4.3                        |

| SURROGATE             | PERCENT<br>RECOVERY | LABORATORY<br>CONTROL<br>LIMITS (%) |
|-----------------------|---------------------|-------------------------------------|
| 1,2-Dichloroethane-d4 | 105                 | 70 - 130                            |
| Toluene-d8            | 106                 | 70 - 130                            |

Leggette, Brashears & Graham, Inc.  
 Client Sample ID: AQ062106:805 NP4-2  
 GC/MS Volatiles

|                              |                       |                                     |
|------------------------------|-----------------------|-------------------------------------|
| Lot-Sample # H6F230109 - 002 | Work Order # H72111AA | Matrix.....: AIR                    |
| SURROGATE                    | PERCENT<br>RECOVERY   | LABORATORY<br>CONTROL<br>LIMITS (%) |
| 4-Bromofluorobenzene         | 97                    | 70 - 130                            |

Qualifiers

B Method blank contamination. The associated method blank contains the target analyte at a reportable level.  
 J Estimated result. Result is less than RL.

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)\*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) \* Dilution Factor) \* (Molecular Weight/24.45)

Leggette, Brashears & Graham, Inc.  
 Client Sample ID: AQ062106:810 NP4-3  
 GC/MS Volatiles

Lot-Sample # H6F230109 - 003      Work Order # H72121AA      Matrix.....: AIR

Date Sampled...: 6/22/06      Date Received..: 6/23/06  
 Prep Date.....: 6/23/06      Analysis Date... 6/23/06  
 Prep Batch #.....: 6177623  
 Dilution Factor.: 5      Method.....: TO-15

| PARAMETER                      | RESULTS<br>(ppb(v/v)) | REPORTING<br>LIMIT (ppb(v/v)) | RESULTS (ug/m3)     | REPORTING<br>LIMIT (ug/m3) |
|--------------------------------|-----------------------|-------------------------------|---------------------|----------------------------|
| <b>Benzene</b>                 | <b>0.24</b>           | <b>1.0</b>                    | <b>0.75      J</b>  | <b>3.2</b>                 |
| Bromodichloromethane           | ND                    | 1.0                           | ND                  | 6.7                        |
| Bromoform                      | ND                    | 1.0                           | ND                  | 10                         |
| Bromomethane                   | ND                    | 1.0                           | ND                  | 3.9                        |
| <b>Carbon disulfide</b>        | <b>4.9</b>            | <b>2.5</b>                    | <b>15</b>           | <b>7.8</b>                 |
| Carbon tetrachloride           | ND                    | 1.0                           | ND                  | 6.3                        |
| Chlorobenzene                  | ND                    | 1.0                           | ND                  | 4.6                        |
| Dibromochloromethane           | ND                    | 1.0                           | ND                  | 8.5                        |
| Chloroethane                   | ND                    | 1.0                           | ND                  | 2.6                        |
| <b>Chloroform</b>              | <b>0.37</b>           | <b>1.0</b>                    | <b>1.8      J</b>   | <b>4.9</b>                 |
| <b>Chloromethane</b>           | <b>1.1</b>            | <b>2.5</b>                    | <b>2.3      J</b>   | <b>5.2</b>                 |
| <b>1,1-Dichloroethane</b>      | <b>1.6</b>            | <b>1.0</b>                    | <b>6.6</b>          | <b>4.0</b>                 |
| 1,2-Dichloroethane             | ND                    | 1.0                           | ND                  | 4.0                        |
| <b>cis-1,2-Dichloroethene</b>  | <b>0.90</b>           | <b>1.0</b>                    | <b>3.6      J</b>   | <b>4.0</b>                 |
| trans-1,2-Dichloroethene       | ND                    | 1.0                           | ND                  | 4.0                        |
| <b>1,1-Dichloroethene</b>      | <b>0.68</b>           | <b>1.0</b>                    | <b>2.7      J</b>   | <b>4.0</b>                 |
| 1,2-Dichloropropane            | ND                    | 1.0                           | ND                  | 4.6                        |
| cis-1,3-Dichloropropene        | ND                    | 1.0                           | ND                  | 4.5                        |
| trans-1,3-Dichloropropene      | ND                    | 1.0                           | ND                  | 4.5                        |
| Ethylbenzene                   | ND                    | 1.0                           | ND                  | 4.3                        |
| <b>Methylene chloride</b>      | <b>0.53</b>           | <b>2.5</b>                    | <b>1.8      J B</b> | <b>8.7</b>                 |
| Styrene                        | ND                    | 1.0                           | ND                  | 4.3                        |
| 1,1,2,2-Tetrachloroethane      | ND                    | 1.0                           | ND                  | 6.9                        |
| Tetrachloroethene              | ND                    | 1.0                           | ND                  | 6.8                        |
| <b>Toluene</b>                 | <b>1.1</b>            | <b>1.0</b>                    | <b>4.2</b>          | <b>3.8</b>                 |
| <b>1,1,1-Trichloroethane</b>   | <b>4.2</b>            | <b>1.0</b>                    | <b>23</b>           | <b>5.5</b>                 |
| 1,1,2-Trichloroethane          | ND                    | 1.0                           | ND                  | 5.5                        |
| Trichloroethene                | ND                    | 1.0                           | ND                  | 5.4                        |
| <b>Vinyl chloride</b>          | <b>0.31</b>           | <b>1.0</b>                    | <b>0.80      J</b>  | <b>2.6</b>                 |
| <b>m-Xylene &amp; p-Xylene</b> | <b>0.37</b>           | <b>1.0</b>                    | <b>1.6      J</b>   | <b>4.3</b>                 |
| o-Xylene                       | ND                    | 1.0                           | ND                  | 4.3                        |

| SURROGATE             | PERCENT<br>RECOVERY | LABORATORY<br>CONTROL<br>LIMITS (%) |
|-----------------------|---------------------|-------------------------------------|
| 1,2-Dichloroethane-d4 | 103                 | 70 - 130                            |
| Toluene-d8            | 106                 | 70 - 130                            |

Leggette, Brashears & Graham, Inc.  
 Client Sample ID: AQ062106:810 NP4-3  
 GC/MS Volatiles

|                              |                       |                                     |
|------------------------------|-----------------------|-------------------------------------|
| Lot-Sample # H6F230109 - 003 | Work Order # H72121AA | Matrix.....: AIR                    |
| SURROGATE                    | PERCENT<br>RECOVERY   | LABORATORY<br>CONTROL<br>LIMITS (%) |
| 4-Bromofluorobenzene         | 97                    | 70 - 130                            |

Qualifiers

B Method blank contamination. The associated method blank contains the target analyte at a reportable level.  
 J Estimated result. Result is less than RL.

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)\*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) \* Dilution Factor) \* (Molecular Weight/24.45)

Leggette, Brashears & Graham, Inc.  
 Client Sample ID: INTRA-LAB BLANK  
 GC/MS Volatiles

Lot-Sample # H6F260000 - 623B

Work Order # H78X21AA

Matrix.....: AIR

Prep Date.....: 6/23/06

Date Received..: 6/23/06

Prep Batch #.....: 6177623

Analysis Date... 6/23/06

Dilution Factor.: 1

Method.....: TO-15

| PARAMETER                 | RESULTS<br>(ppb(v/v)) | REPORTING<br>LIMIT (ppb(v/v)) | RESULTS (ug/m3) | REPORTING<br>LIMIT (ug/m3) |
|---------------------------|-----------------------|-------------------------------|-----------------|----------------------------|
| Benzene                   | ND                    | 0.20                          | ND              | 0.64                       |
| Bromodichloromethane      | ND                    | 0.20                          | ND              | 1.3                        |
| Bromoform                 | ND                    | 0.20                          | ND              | 2.1                        |
| Bromomethane              | ND                    | 0.20                          | ND              | 0.78                       |
| Carbon disulfide          | ND                    | 0.50                          | ND              | 1.6                        |
| Carbon tetrachloride      | ND                    | 0.20                          | ND              | 1.3                        |
| Chlorobenzene             | ND                    | 0.20                          | ND              | 0.92                       |
| Dibromochloromethane      | ND                    | 0.20                          | ND              | 1.7                        |
| Chloroethane              | ND                    | 0.20                          | ND              | 0.53                       |
| Chloroform                | ND                    | 0.20                          | ND              | 0.98                       |
| Chloromethane             | ND                    | 0.50                          | ND              | 1.0                        |
| 1,1-Dichloroethane        | ND                    | 0.20                          | ND              | 0.81                       |
| 1,2-Dichloroethane        | ND                    | 0.20                          | ND              | 0.81                       |
| cis-1,2-Dichloroethene    | ND                    | 0.20                          | ND              | 0.79                       |
| trans-1,2-Dichloroethene  | ND                    | 0.20                          | ND              | 0.79                       |
| 1,1-Dichloroethene        | ND                    | 0.20                          | ND              | 0.79                       |
| 1,2-Dichloropropane       | ND                    | 0.20                          | ND              | 0.92                       |
| cis-1,3-Dichloropropene   | ND                    | 0.20                          | ND              | 0.91                       |
| trans-1,3-Dichloropropene | ND                    | 0.20                          | ND              | 0.91                       |
| Ethylbenzene              | ND                    | 0.20                          | ND              | 0.87                       |
| <b>Methylene chloride</b> | <b>0.11</b>           | <b>0.50</b>                   | <b>0.39 J</b>   | <b>1.7</b>                 |
| Styrene                   | ND                    | 0.20                          | ND              | 0.85                       |
| 1,1,2,2-Tetrachloroethane | ND                    | 0.20                          | ND              | 1.4                        |
| Tetrachloroethene         | ND                    | 0.20                          | ND              | 1.4                        |
| Toluene                   | ND                    | 0.20                          | ND              | 0.75                       |
| 1,1,1-Trichloroethane     | ND                    | 0.20                          | ND              | 1.1                        |
| 1,1,2-Trichloroethane     | ND                    | 0.20                          | ND              | 1.1                        |
| Trichloroethene           | ND                    | 0.20                          | ND              | 1.1                        |
| Vinyl chloride            | ND                    | 0.20                          | ND              | 0.51                       |
| m-Xylene & p-Xylene       | ND                    | 0.20                          | ND              | 0.87                       |
| o-Xylene                  | ND                    | 0.20                          | ND              | 0.87                       |

SURROGATE

PERCENT  
RECOVERYLABORATORY  
CONTROL  
LIMITS (%)

1,2-Dichloroethane-d4

105

70 - 130

Leggette, Brashears & Graham, Inc.  
 Client Sample ID: INTRA-LAB BLANK  
 GC/MS Volatiles

Lot-Sample # H6F260000 - 623B

Work Order # H78X21AA

Matrix.....: AIR

| SURROGATE            | PERCENT<br>RECOVERY | LABORATORY<br>CONTROL<br>LIMITS (%) |
|----------------------|---------------------|-------------------------------------|
| Toluene-d8           | 98                  | 70 - 130                            |
| 4-Bromofluorobenzene | 96                  | 70 - 130                            |

Qualifiers

J Estimated result. Result is less than RL.

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)\*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) \* Dilution Factor) \* (Molecular Weight/24.45)

Leggette, Brashears & Graham, Inc.  
 Client Sample ID: CHECK SAMPLE  
 GC/MS Volatiles

Lot-Sample # H6F260000 - 623C      Work Order # H78X21AC      Matrix.....: AIR

Prep Date.....: 6/23/06      Date Received...: 6/23/06  
 Prep Batch #.....: 6177623      Analysis Date...: 6/23/06  
 Dilution Factor.: 1      Method.....: TO-15

| PARAMETER          | SPIKE<br>AMOUNT<br>(ppb(v/v)) | MEASURED<br>AMOUNT<br>(ppb(v/v)) | SPIKE<br>AMOUNT<br>(ug/m3) | MEASURED<br>AMOUNT<br>(ug/m3) | PERCENT<br>RECOVERY | RECOVERY<br>LIMITS |
|--------------------|-------------------------------|----------------------------------|----------------------------|-------------------------------|---------------------|--------------------|
| Benzene            | 10.0                          | 9.37                             | 32                         | 30                            | 94                  | 70 - 130           |
| Chlorobenzene      | 10.0                          | 10.0                             | 46                         | 46                            | 100                 | 70 - 130           |
| 1,1-Dichloroethene | 10.0                          | 9.82                             | 40                         | 39                            | 98                  | 70 - 130           |
| Toluene            | 10.0                          | 9.68                             | 38                         | 36                            | 97                  | 70 - 130           |
| Trichloroethene    | 10.0                          | 10.1                             | 54                         | 54                            | 101                 | 70 - 130           |

| SURROGATE             | PERCENT<br>RECOVERY | LABORATORY<br>CONTROL<br>LIMITS (%) |
|-----------------------|---------------------|-------------------------------------|
| 1,2-Dichloroethane-d4 | 107                 | 70 - 130                            |
| Toluene-d8            | 101                 | 70 - 130                            |
| 4-Bromofluorobenzene  | 101                 | 70 - 130                            |

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)\*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) \* Dilution Factor) \* (Molecular Weight/24.45)

## Sample Receipt Documentation

# ANALYSIS REQUEST AND CHAIN OF CUSTODY RECORD\*

Reference Document #

Page 1 of

H16F230109

Project Name/No. <sup>1</sup> RoweSample Team Members <sup>2</sup> \_\_\_\_\_Profit Center No. <sup>3</sup> \_\_\_\_\_Project Manager <sup>4</sup> Mark GoldbergPurchase Order No. <sup>6</sup> \_\_\_\_\_Required Report Date <sup>11</sup> \_\_\_\_\_Samples Shipment Date <sup>7</sup> 6-22-06Lab Destination <sup>8</sup> STC KnoxvilleLab Contact <sup>9</sup> Scott HarrisProject Contact / Phone <sup>12</sup> 203-929-8555Carrier / Waybill No. <sup>13</sup> FedExBill to: <sup>5</sup> LBC4 Research Dr.Shelton, CT 06484Report to: <sup>10</sup> Mark Goldberg@ Above address

## ONE CONTAINER PER LINE

| Sample <sup>14</sup><br>Number | Sample <sup>15</sup><br>Type | Date/Time <sup>16</sup><br>Collected | Container <sup>17</sup><br>Type | Sample <sup>18</sup><br>Volume | Pre- <sup>19</sup><br>servative | Requested Testing <sup>20</sup><br>Program | Condition on Receipt <sup>21</sup><br>Lab use only |
|--------------------------------|------------------------------|--------------------------------------|---------------------------------|--------------------------------|---------------------------------|--------------------------------------------|----------------------------------------------------|
| AQ06216: 800 NP4-1             | AIR                          | 6-22-06<br>800                       | Tedlar                          | 1L                             | None                            | TO-15                                      | Custody seals intact <u>Y</u> N NA                 |
| " " 805 NP4-2                  | ↓                            | 805                                  | ↓                               | ↓                              | ↓                               | ↓                                          | Temperature received at <u>AMBIENT</u>             |
| " " 810 NP4-3                  | ↓                            | 810                                  | ↓                               | ↓                              | ↓                               | ↓                                          | Received by <u>WFO</u> Date <u>6-23-06</u>         |
|                                |                              |                                      |                                 |                                |                                 |                                            | Number of packages <u>1</u> <u>UNIT</u>            |
|                                |                              |                                      |                                 |                                |                                 |                                            | Tracking # <u>FEDX#</u>                            |
|                                |                              |                                      |                                 |                                |                                 |                                            | <u>7919 7810 8102</u>                              |

### Special Instructions: <sup>23</sup>

#### Possible Hazard Identification: <sup>24</sup>

Non-Hazard ☒ Flammable ☐ Skin Irritant ☐ Poison B ☐ Unknown ☐Turnaround Time Required: <sup>25</sup>Normal ☒ Rush ☐1. Relinquished by <sup>26</sup>  
(Signature / Affiliation)1. Relinquished by  
(Signature / Affiliation)1. Relinquished by  
(Signature / Affiliation)Comments: <sup>29</sup>

#### Sample Disposal: <sup>25</sup>

Return to Client ☐ Disposal by Lab ☐ Archive (mos.)QC Level: <sup>27</sup>I. ☐ II. ☐ III. ☐ Project Specific (specify):1. Received by <sup>28</sup>  
(Signature / Affiliation)1. Received by  
(Signature / Affiliation)1. Received by  
(Signature / Affiliation)

Date: \_\_\_\_\_

Time: \_\_\_\_\_

Date: \_\_\_\_\_

Time: \_\_\_\_\_

Date: \_\_\_\_\_

Time: \_\_\_\_\_

Date: \_\_\_\_\_

Time: \_\_\_\_\_

# STL KNOXVILLE SAMPLE RECEIPT/CONDITION UPON RECEIPT ANOMALY CHECKLIST

Client: LBG Project: RWF Lot Number: HV230009

| Review Items                                                                                                                    | Yes | No | NA | If No, what was the problem?                                                                                                                                                                                                                                                                                              | Comments/Actions Taken |
|---------------------------------------------------------------------------------------------------------------------------------|-----|----|----|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------|
| 1. Do sample container labels match COC?<br>(IDs, Dates, Times)                                                                 | ✓   |    |    | <input type="checkbox"/> 1a Do not match COC<br><input type="checkbox"/> 1b Incomplete information<br><input type="checkbox"/> 1c Marking smeared<br><input type="checkbox"/> 1d Label torn<br><input type="checkbox"/> 1e No label<br><input type="checkbox"/> 1f COC not received<br><input type="checkbox"/> 1g Other: | NA                     |
| 2. Is the cooler temperature within limits? (> freezing temp. of water to 6 °C; NC, 1668, 1613B: 0-4°C; VOST: 10°C; MA: 2-6 °C) |     | ✓  |    | <input type="checkbox"/> 2a Temp Blank = _____<br><input type="checkbox"/> 2b Cooler Temp = _____                                                                                                                                                                                                                         |                        |
| 3. Were samples received with correct chemical preservative (excluding Encore)?                                                 |     | ✓  |    | <input type="checkbox"/> 3a Sample preservative =                                                                                                                                                                                                                                                                         |                        |
| 4. Were custody seals present/intact on cooler and/or containers?                                                               |     | ✓  |    | <input type="checkbox"/> 4a Not present<br><input type="checkbox"/> 4b Not intact<br><input type="checkbox"/> 4c Other:                                                                                                                                                                                                   |                        |
| 5. Were all of the samples listed on the COC received?                                                                          |     | ✓  |    | <input type="checkbox"/> 5a Samples received-not on COC<br><input type="checkbox"/> 5b Samples not received-on COC                                                                                                                                                                                                        |                        |
| 6. Were all of the sample containers received intact?                                                                           |     | ✓  |    | <input type="checkbox"/> 6a Leaking<br><input type="checkbox"/> 6b Broken                                                                                                                                                                                                                                                 |                        |
| 7. Were VOA samples received without headspace?                                                                                 |     | ✓  |    | <input type="checkbox"/> 7a Headspace (VOA only)                                                                                                                                                                                                                                                                          |                        |
| 8. Were samples received in appropriate containers?                                                                             |     | ✓  |    | <input type="checkbox"/> 8a Improper container                                                                                                                                                                                                                                                                            |                        |
| 9. Did you check for residual chlorine, if necessary?                                                                           |     | ✓  |    | <input type="checkbox"/> 9a Could not be determined due to matrix interference                                                                                                                                                                                                                                            |                        |
| 10. Were samples received within holding time?                                                                                  |     | ✓  |    | <input type="checkbox"/> 10a Holding time expired                                                                                                                                                                                                                                                                         |                        |
| 11. For rad samples, was sample activity info. provided?                                                                        |     | ✓  |    | <input type="checkbox"/> Incomplete information                                                                                                                                                                                                                                                                           |                        |
| 12. For SOG water samples (1613B, 1668A, 8290, LR PAHs), do samples have visible solids present?                                |     | ✓  |    | If yes & appears to be >1%, was SOG notified?                                                                                                                                                                                                                                                                             |                        |
| 13. Are the shipping containers intact?                                                                                         |     | ✓  |    | <input type="checkbox"/> 13a Leaking<br><input type="checkbox"/> 13b Other:                                                                                                                                                                                                                                               |                        |
| 14. Was COC relinquished? (Signed/Dated/Timed)                                                                                  |     | ✓  |    | <input checked="" type="checkbox"/> 14a Not relinquished                                                                                                                                                                                                                                                                  |                        |
| 15. Are tests/parameters listed for each sample?                                                                                |     | ✓  |    | <input type="checkbox"/> 15a Incomplete information                                                                                                                                                                                                                                                                       |                        |
| 16. Is the matrix of the samples noted?                                                                                         |     | ✓  |    | <input type="checkbox"/> 15a Incomplete information                                                                                                                                                                                                                                                                       |                        |
| 17. Is the date/time of sample collection noted?                                                                                |     | ✓  |    | <input type="checkbox"/> 15a Incomplete information                                                                                                                                                                                                                                                                       |                        |
| 18. Is the client and project name/# identified?                                                                                |     | ✓  |    | <input type="checkbox"/> 15a Incomplete information                                                                                                                                                                                                                                                                       |                        |
| 19. Was the sampler identified on the COC?                                                                                      |     | ✓  |    |                                                                                                                                                                                                                                                                                                                           |                        |

Quote #: \_\_\_\_\_ PM Instructions: \_\_\_\_\_

Sample Receiving Associate: Dan Johnson Date: 6-23-06 QA026R18.doc, 1/30/06