

**PROJECT STATUS MEMORANDUM**

**NO. 08-06**

**TO:** Pamela Tames, USEPA

**FROM:** Mark M. Goldberg, P.E.  
Tunde H. Komuves-Sandor

**DATE:** November 8, 2006

**PROJECT:** Rowe Industries Superfund Site  
Ground-Water Recovery and Treatment System  
August 2006 Status Report  
Sag Harbor, New York

LBG Engineering Services, P.C. (LBG) commenced operation of the ground-water remediation system at the above-referenced site on December 17, 2002. This status report presents a summary of system performance, operation and maintenance, and monitoring activities for the site from August 1, 2006 through August 31, 2006. The report includes a summary of system performance parameters, system operation parameters, analytical results for ground water, system effluent samples, and air quality results.

**SUMMARY OF SYSTEM PERFORMANCE AND OPERATION**

*(August 1, 2006 through August 31, 2006)*

- |   |                                  |
|---|----------------------------------|
| 1. Hours of operation during the reporting period:  | 286 hours (38%)                  |
| 2. Alarm conditions during the reporting period:  | See Table 1                      |
| 3. Was the SPDES VOC discharge permit criteria achieved:  | yes, (Table 2)                   |
| 4. Total volume of water pumped during the reporting period:  | 8,678,150 gal.                   |
| 5. Was the system effluent flow below the SPDES limit of 1,023,000 gpd: yes, (Graph 1)                          |                                  |
| 6. Mass of VOCs recovered during the reporting period:  | 1.7 pounds                       |
| 7. Cumulative mass of VOCs recovered since startup on 12/17/02:<br>(calculations can be provided upon request)  | 188.7 pounds                     |
| 8. Effluent VOC vapor concentration for the reporting period:   | 0.07 mg/m <sup>3</sup> (Table 3) |
| 9. Was the effluent VOC vapor emission rate below 0.022 lbs/hr.:<br>(calculations can be provided upon request) | yes (0.00064 lbs/hr)             |

## GROUND-WATER RECOVERY SYSTEM STATUS SUMMARY

The following table summarizes select recovery well parameters for the reporting period. Table 4 presents a summary of the quality results for water samples collected from recovery wells. Graph 2 presents PCE concentrations for each recovery well. For wells with water quality that meets or is approaching remedial criteria, Graph 3 presents PCE concentrations at an expanded scale in order to compare them to the PCE aquifer restoration concentration of 5 ug/L. Laboratory analytical reports are included as Appendix I.

Well	Volume Pumped (gal)	Average Flow (gpm)	Minimum Design Flow (gpm)	Total VOC Concentration (µg/L)	VOC Recovery (lbs)
RW-2	543,616	27	26	19.2	0.09
RW-3 *	0	0	23	0	0
RW-4	1,087,390	40	13	23.0	0.20
RW-5	1,087,610	50	42	0	0
RW-6	271,939	15	28	52.0	0.12
RW-7	1,075,970	70	54	46.9	0.41
RW-8	1,087,767	50	46	3.2	0.03
RW-9	1,088,540	80	68	0	0

\*Recovery well RW-3 was not operating in July because the new RW-3 drive has to be reprogrammed to account for the two (2) horsepower (HP) pump motor recently installed following well rehabilitation activities (RW-3 formerly had a one (1) HP pump motor).

Recovery well RW-6 had an average flow below the respective minimum design flow determined to be necessary for capture of the plume. The performance of RW-6 will continue to be monitored.

The effluent pH of the treated water from the FSP&T system is within the acceptable State Pollutant Discharge System (SPDES) criteria for the site as shown on Table 2.

### BAG FILTER STATUS

The following table presents an operational summary of the bag filter usage and configuration for the reporting period.

Dates	Bank 1	Bank 2	Bank 3
August 1 to 31	7 of 8 housings used with 400 micron bag filters	7 of 8 housings used with 400 micron bag filters	Not active

No modifications were made to the filter bank configuration or operation during this reporting period.

## OTHER O&M ACTIVITIES AND FUTURE O&M ACTIVITIES

Other O&M activities conducted in August 2006 include:

- On August 7, 2006, cove monitoring was conducted.
- On August 8, 2006, An equalization (EQ) tank access man-way was constructed near the base to facilitate easier access to clean the inside of the tank.
- On August 16, 2006, transfer pump TP-2B was serviced by a service technician from Barish Pump, Inc. The lead pumps were switched from TP1B to TP1A, and TP2B to TP2A.

Future O&M activities scheduled for the summer and fall of 2006 include:

- Repair the air stripper blower and booster blower air flow meters;
- Reprogram RW-3 drive for compatibility with the new 2 horsepower motor;
- Replace malfunctioning RW-3 pressure transducer.
- Conduct cove monitoring in September.
- Conduct semi-annual sampling in September.

cc: Phil McAndrew, Kraft Foods, N.A. – .pdf  
Lisa Krogman, Kraft Foods, N.A. (Environ) – .pdf  
Jeff Trad, NYSDEC – .pdf  
Chief-Operation Maintenance and Support Section, NYSDEC – .pdf  
William Spitz, RWM, R-1, NYSDEC  
Garrett W. Swensen Jr., Esq., Town of Southampton

MMG:ng

Attachments

H:\NABIS\2006\Monthly Reports\August 2006>Status0806Aug.doc

## **TABLES**

**TABLE 1**  
**GROUND-WATER REMEDIAL ACTION**  
**ROWE INDUSTRIES SUPERFUND SITE**  
**SAG HARBOR, NEW YORK**

**MAINTENANCE LOG**  
(August 1, 2006 through August 31, 2006)

<b>Date</b>	<b>Time</b>	<b>System Changes/Modifications</b>	<b>Personnel</b>
8/2/2006	3:34 AM	Power Failure alarm, but FSP&T system was operating until approximately 6:00 AM on 8/4/06 based on recorded flow data.	
8/8/2006		Changed multi-bag filter bags (400 mm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD
		Construction of EQ tank manway by Burt Process and Earth Technology LLC.	RD/Burt Process/ETL
	2:45 PM	Reset 8/2/06 Power Failure Alarm and other power failure and EQ tank related alarms, and restarted system.	RD
8/11/2006	9:00 AM	Booster Blower failure alarm, system shut down.	
8/16/2006		Troubleshooting of transfer pumps by service tech, switched lead pump from TP1B to TP1A and TP2B to TP2A.	RD/Barish Pump
	9:45 AM	Reset 8/11/06 Booster Blower failure alarm and restarted system.	RD
		Changed multi-bag filter bags (400 mm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD
	8:12 PM	Booster Blower Low Pressure Alarm. System shut down	
	8:13 PM	Bag filter 3 High Pressure Warning. & Bag filter 3 High Pressure Alarm.	
8/24/2006	7:13 AM	Reset alarms, and restarted system.	RD
	7:35 AM	RW-7 pump fault alarm occurred.	RD
	7:53 AM	RW-7 pump fault alarm reset.	RD
		Changed multi-bag filter bags (400 mm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD
8/28/2006		Changed multi-bag filter bags (400 mm) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	THKS
		Vacuumed out water from drip trays beneath bag filter housings and transfer tank sump.	THKS
8/30/2006		Communication Failure alarm, system shut down.	

TABLE 2

GROUND-WATER REMEDIAL ACTION  
 ROWE INDUSTRIES SUPERFUND SITE  
 SAG HARBOR, NEW YORK

EFFLUENT WATER QUALITY RESULTS

Date Sampled <sup>2/</sup>	pH <sup>1/</sup>	TDS (mg/l)	PCE (ug/l)	1,1,1-TCA (ug/l)	TCE (ug/l)	1,1-DCA (ug/l)	1,1-DCE (ug/l)	1,2-DCE (ug/l)	Xylene (ug/l)	Bromoform (ug/l)	Dibromo-chloromethane (ug/l)	Methylene Chloride (ug/l)	Freon 113 (ug/l)	Acetone (ug/l)	Chloroform (ug/l)	MTBE (ug/l)	Total Iron (mg/l)	Dissolved Iron (mg/l)
SPDES Limits	5.0 to 8.5	---	1	5	5	5	5	5	5	---	---	5	---	50	7	---	---	---
8-Aug-06	5.3	112	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	5.31	0.142
16-Aug-06	5.3	164	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	2.12	0.155
24-Aug-06	5.1	126	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	1.26	0.211
28-Aug-06	5.0	142	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	1.88	0.312

SPDES: State Pollutant Discharge Elimination System  
 mg/l: Milligrams per liter  
 ug/l: Micrograms per liter  
 ----: Not established

NM: Not Measured  
 TDS: Total dissolved solids  
 PCE: Tetrachloroethylene  
 TCE: Trichloroethene

1,1-DCA: 1,1-Dichloroethane  
 1,1-DCE: 1,1-Dichloroethene  
 1,2-DCE: 1,2-Dichloroethene  
 MTBE: Methyl tert-butyl ether

Notes:

- Based on the new SPDES criteria from an NYSDEC letter dated on May 11, 2006, the new allowable pH range for the Rowe Site is between 5.0 and 8.5. The pH was measured using litmus paper. Influent pH values from recovery wells typically range between 5 and 6.
- "Effluent" samples were collected from sample port labeled NP2-10 unless otherwise noted. RW-2 was operating from July 23-25. (No wells were operating from July 25-30th)

TABLE 3

**GROUND-WATER REMEDIAL ACTION  
ROWE INDUSTRIES SUPERFUND SITE  
SAG HARBOR, NEW YORK**

**CARBON UNIT SYSTEM AIR QUALITY RESULTS**

Precarbon			Parameters (mg/m <sup>3</sup> )																			TOTAL VOCs	
Sample Name	Date	Time	PCE	TCE	TCA	DCE	DCA	cis-DCE	Toluene	Benzene	m&p-Xylenes	o-Xylene	Styrene	CF	MC	CM	CD	BM	CB	EB	VC	CT	
AQ080205:1400NP4-1	8/2/2005	14:00	0.42	0.034	0.15	ND	ND	0.009	0.05	0.008	0.006	ND	0.007	0.006	0.017 <sup>1/</sup>	ND	0.66 <sup>1/</sup>	0.043	ND	ND	ND	ND	0.93
AQ090805:900NP4-1	9/8/2005	9:00	0.27	0.032	0.1	0.011	ND	0.016	0.079	0.039	0.025	0.013	0.003	ND	1.7 <sup>1/</sup>	ND	0.021	0.038	0.01	0.004	ND	ND	0.81
AQ100605:1230NP4-1	10/6/2005	12:30	0.28	0.022	0.1	0.007	0.025	0.011	0.015	0.004	0.003	ND	0.002	0.005	0.036	ND	ND	0.032	ND	ND	ND	ND	0.54
AQ111605:1130NP4-1	11/16/2005	11:30	0.76	0.033	0.11	0.008	0.022	0.054	0.44	0.016	0.012	0.004	0.004	ND	0.05	ND	0.023	0.052	ND	0.002	ND	ND	1.59
AQ120805:930NP4-1	12/8/2005	9:30	0.34	0.016	0.079	0.006	0.02	0.032	0.014	0.003	0.003	ND	0.002	0.004	0.008 <sup>2/</sup>	0.002	0.038	0.015	ND	0.001	ND	ND	0.58
AQ010406:845NP4-1	1/4/2006	8:45	0.24	0.027	0.094	0.007	0.019	0.009	0.031	0.014	0.01	0.004	0.005	0.005	0.018	ND	0.027	0.002	ND	0.003	ND	ND	0.52
AQ020106:745NP4-1	2/1/2006	7:45	0.64	0.03	0.12	0.008	0.028	0.018	0.005	0.009	0.003	ND	ND	0.007	0.024	0.008	0.012	0.018 <sup>3/</sup>	ND	ND	ND	ND	0.91
AQ032206:1215NP4-1 <sup>4/</sup>	3/22/2006	12:15	0.12	0.018	0.077	0.0042	0.018	0.0062	0.0026	0.00096	0.0016	ND	ND	0.0049	0.0025	0.0017	0.0067	ND	ND	ND	ND	0.26	
AQ041206:950NP4-1	4/12/2006	9:50	0.18	0.011	0.038	0.004	0.0087	0.007	0.0014	ND	ND	ND	ND	0.0037	0.0011	0.0018	0.0047	ND	ND	ND	ND	0.26	
AQ051706:1000NP4-1	5/17/2006	10:00	0.28	0.017	0.048	0.0035	0.013	0.014	0.0093	0.0026	0.0032	ND	ND	0.0037	0.0019	0.0026	0.0097	ND	ND	0.0016	0.0011	0.41	
AQ062106:800NP4-1	6/21/2006	8:00	0.15	0.009	0.074	0.0037	0.014	0.0062	0.0048	0.00092	0.0022	ND	ND	0.0029	0.002	0.0019	0.014	ND	ND	0.00091	ND	0.29	
AQ072006:900NP4-1	7/20/2006	9:00	0.095	0.008	0.091	ND	0.0074	0.005	0.0057	ND	0.0069	0.0062	ND	ND	0.0067	0.0022	0.013	ND	ND	ND	ND	0.25	
AQ082406:900NP4-1	8/24/2006	9:00	0.28	0.012	0.055	0.0034	0.0083	0.013	0.0043	0.0021	0.0022	ND	ND	0.003	0.0043	ND	0.009	ND	ND	ND	0.0014	0.40	
Midcarbon			Parameters (mg/m <sup>3</sup> )																			TOTAL VOCs	
Sample Name	Date	Time	PCE	TCE	TCA	DCE	DCA	cis-DCE	Toluene	Benzene	m&p-Xylenes	o-Xylene	Styrene	CF	MC	CM	CD	BM	CB	EB	VC	CT	
AQ080205:1405NP4-2	8/2/2005	14:05	0.019	ND	0.05	ND	ND	ND	0.051	0.006	0.007	ND	0.006	0.007	0.029 <sup>1/</sup>	ND	0.72 <sup>1/</sup>	0.048	ND	0.002	ND	ND	0.34
AQ090805:905NP4-2	9/8/2005	9:05	0.008	ND	0.039	ND	ND	ND	0.049	0.002	0.024	0.012	ND	0.004	0.10 <sup>1/</sup>	ND	0.018	0.013	ND	0.003	ND	ND	0.27
AQ100605:1232NP4-2	10/6/2005	12:32	0.007	ND	0.1	0.01	0.028	0.009	0.013	0.001	0.003	ND	0.003	0.01	0.021	ND	ND	0.049	ND	ND	0.001	ND	0.26
AQ111605:1132NP4-2	11/16/2005	11:32	0.01	ND	0.058	0.004	0.015	0.004	0.013	0.002	0.002	ND	ND	0.005	0.017	ND	0.021	0.031	ND	ND	ND	ND	0.18
AQ120805:935NP4-2	12/8/2005	9:35	0.003	ND	0.13	0.009	0.023	0.007	0.013	0.002	0.004	0.001	0.003	0.006	0.007 <sup>2/</sup>	ND	0.021	0.018	ND	0.001	0.003	ND	0.24
AQ010406:850NP4-2	1/4/2006	8:50	0.006	ND	0.11	0.005	0.017	0.006	0.018	0.001	0.003	ND	0.003	0.005	0.007	ND	0.022	0.009	ND	0.001	ND	ND	0.21
AQ020106:750NP4-2	2/1/2006	7:50	0.002	ND	0.086	ND	0.013	0.007	0.016	0.012	0.007	0.002	0.002	0.003	0.017	ND	0.01	ND	ND	0.002	ND	ND	0.19
AQ032206:1220NP4-2 <sup>4/</sup>	3/22/2006	12:20	0.0014	ND	0.075	0.0044	0.013	0.007	0.0041	ND	0.0025	ND	ND	0.0034	0.0027	ND	0.0062	ND	ND	ND	0.00088	0.12	
AQ041206:955NP4-2	4/12/2006	0:00	0.0012	ND	0.099	0.0076	0.014	0.0087	0.0015	ND	0.0011	ND	ND	0.0047	0.0013	ND	ND	ND	ND	ND	ND	0.14	
AQ051706:1005NP4-2	5/17/2006	10:05	0.0028	0.001	0.065	0.0039	0.014	0.0074	0.0045	ND	0.0032	ND	ND	0.0036	0.003	0.0019	0.0088	ND	ND	ND	ND	0.12	
AQ062106:805NP4-2	6/21/2006	8:05	ND	ND	0.025	0.0028	0.0081	0.0045	0.0036	ND	0.0014	ND	ND	0.0023	0.0019	0.0026	0.014	ND	ND	ND	0.001	0.07	
AQ072006:905NP4-2	7/20/2006	9:05	ND	ND	0.022	ND	0.0078	0.0044	ND	ND	ND	ND	ND	ND	ND	ND	0.013	ND	ND	ND	ND	ND	0.05
AQ082006:902NP4-2	8/24/2006	9:02	ND	ND	0.023	0.0017	0.0054	0.0045	0.0035	ND	0.0018	ND	ND	0.0019	0.0025	ND	0.013	ND	ND	ND	ND	ND	0.06
Postcarbon			Parameters (mg/m <sup>3</sup> )																			TOTAL VOCs	
Sample Name	Date	Time	PCE	TCE	TCA	DCE	DCA	cis-DCE	Toluene	Benzene	m&p-Xylenes	o-Xylene	Styrene	CF	MC	CM	CD	BM	CB	EB	VC	CT	
AQ080205:1410NP4-3	8/2/2005	14:10	ND	ND	ND	ND	ND	ND	0.068	0.007	0.007	ND	0.008	0.007	0.019 <sup>1/</sup>	ND	0.640 <sup>1/</sup>	0.046	ND	ND	ND	ND	0.23
AQ090805:910NP4-3	9/8/2005	9:10	ND	ND	0.016	ND	ND	ND	0.038	0.002	0.022	0.01	0.004	0.005	0.025 <sup>1/</sup>	ND	0.019	0.035	ND	0.002	ND	ND	0.22
AQ100605:1234NP4-3	10/6/2005	12:34	0.004	ND	0.014	0.004	0.009	0.009	0.012	0.002	0.002	ND	0.002	0.004	0.02	ND	ND	0.084	ND	ND	ND	ND	0.17
AQ111605:1134NP4-3	11/16/2005	11:34	0.003	ND	0.029	ND	0.014	ND	0.044	0.011	0.009	0.003	ND	0.005	0.03	ND	0.022	0.016	ND	0.002	ND	ND	0.19
AQ120805:940NP4-3	12/8/2005	9:40	ND	ND	0.075	0.009	0.028	0.004	0.013	0.002	0.003	0.0003	0.003	0.009	0.009 <sup>2/</sup>	ND	0.025	0.02	ND	0.0008	ND	ND	0.19
AQ010406:855NP4-3	1/4/2006	8:55	0.004	ND	0.096	0.006	0.022	0.003	0.017	0.004	0.004	ND	0.003	0.006	0.014	ND	0.022	ND	ND	0.001	ND	ND	0.20
AQ020106:755NP4-3	2/1/2007	7:55	ND	0.002	0.075	0.004	0.016	0.003	0.004	0.003	0.001	ND	ND	0.005	0.017	ND	0.012	0.11 <sup>3/</sup>	ND	ND	ND	ND	0.14
AQ032206:1225NP4-3 <sup>4/</sup>	3/22/2006	12:25	ND	ND	0.11	0.0046	0.016	0.0045	0.0029	ND	0.0021	ND	ND	0.0049	0.0025	0.0016	0.0055	ND	ND	ND	0.00081	0.16	
AQ041206:1000NP4-3	4/12/2006	10:00	ND	ND	0.074	0.0065	0.011	0.0051	0.0018	ND	0.0015	ND	ND	0.0051	0.0013	ND	ND	ND	ND	ND	ND	ND	0.11
AQ051706:1010NP4-3	5/17/2006	10:10	0.0046	ND	0.068	0.0045	0.015	0.0048	0.0046	0.00088	0.0025	ND	ND	0.0042	0.0022	0.0026	0.012	ND	ND	ND	0.00075	0.13	
AQ062106:810NP4-3	6/21/2006	8:10	ND	ND	0.023	0.0027	0.0066	0.0036	0.0042	0.00075	0.0016	ND	ND	0.0018	0.0018	0.0023	0.015	ND	ND	ND	0.0008	0.06	
AQ072006:910NP4-3	7/20/2006	9:10	ND	ND	0.017	ND	0.0058	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.012	ND	ND	ND	ND	ND	0.03
AQ082406:904NP4-3	8/24/2006	9:04	ND	ND	0.025	0.0029	0.0082	0.0046	0.0038	0.00079	0.0018	ND	ND	0.002	0.0022	ND	0.014	ND	ND	ND	ND	ND	0.07

Notes: 1. Methylene chloride and/or carbon disulfide concentrations in all three air samples collected during the July 7, August 9 and September 8, 2005 sampling events are greatly elevated due to suspected laboratory contamination. The methylene chloride concentration from the June 24, 2005 sampling event was used instead of the July 7, August 9 or September 8, 2005 methylene chloride concentrations to calculate the total VOCs for July, August and September 2005. The carbon disulfide concentration from the June 24, 2005 sampling event was used instead of the July 7 and August 9, 2005 carbon disulfide concentration to calculate the total VOCs for July and August 2005.

2. The methylene chloride concentration in the air samples collected on December 8, 2005 are suspected to be from laboratory contamination.

3. The laboratory procedure for the % bromomethane recovered exceeded the upper limit for quality control, therefore the bromomethane concentration for January 4, 2006 was used to calculate the total VOC concentration in for the February 1, 2006 samples.

4. The air samples from March 2006 and forward were analyzed using the TO-15 method at the Severn Trent Laboratory located in Knoxville, TN. Air sampling using the TO-17 method at the Severn Trent Laboratory in Connecticut is no longer available. The March 2006 air quality results appear to be a little lower or similar to prior air quality results. LBG will continue to monitor the air quality on a monthly basis.

PCE - Tetrachloroethane	DCE - 1,1-Dichloroethene	CF - Chloroform	BM - Bromomethane
TCE - Trichloroethene	DCA - 1,1-Dichloroethane	MC - Methylene Chloride	CB - Chlorobenzene
TCA - 1,1,1-Trichloroethane	cis-DCE - cis-1,2-Dichloroethene	CM - Chloromethane	EB - Ethylbenzene
	CT - Carbon Tetrachloride	CD - Carbon Disulfide	VC - Vinyl Chloride

TABLE 4

**GROUND-WATER REMEDIAL ACTION  
ROWE INDUSTRIES SUPERFUND SITE  
SAG HARBOR, NEW YORK**

**RECOVERY WELL WATER QUALITY RESULTS**

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	1,1-Dichloroethane (ug/L)	cis-1,2-Dichloroethene (ug/L)	1,1-Dichloroethene (ug/L)	Methylene Chloride (ug/L) <sup>1/</sup>	Toluene (ug/L)	Dibromochloromethane (ug/L)	Acetone (ug/L) <sup>1/</sup>
	ARAR's	5	5	5	NE	7	NE	300	300	5	5	5	5	NE	NE	NE
RW-1	15-Sep-04	ND<1	ND<1	ND<1	ND<1	2.8	ND<1	0.0865	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	ND<1	ND<1	ND<1	ND<1	ND<1	2.2	0.0332	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	ND<1	ND<1	ND<1	ND<1	1.9	2.0	0.0133	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	ND<1	ND<1	ND<1	ND<1	9.8	ND<1	0.0475	0.0229	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-Jan-05	ND<1	ND<1	ND<1	ND<1	1.5	2.1	0.0703	0.0326	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	ND<1	ND<1	ND<1	ND<1	4.6	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	ND<1	ND<1	ND<1	ND<1	2.5	ND<1	0.0285	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	ND<1	ND<1	ND<1	ND<1	1.5	ND<1	0.0357	0.0217	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	ND<1	ND<1	ND<1	ND<1	4.0	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	ND<1	ND<1	ND<1	ND<1	2.1	ND<1	0.0289	ND<0.02	ND<1	ND<1	ND<1	8.4*	ND<1	ND<1	6.9*
	7-Mar-06	ND<1	ND<1	ND<1	ND<1	5.2	ND<1	0.1650	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Sep-04	12	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	3.82	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	10	ND<1	ND<1	ND<1	ND<1	ND<1	1.5	4.78	0.213	ND<1	ND<1	ND<1	ND<1	ND<1	1.5
3-Nov-04	11	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	5.21	0.152	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
15-Dec-04	10	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	10.8	0.297	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
4-Jan-05	25	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	4.81	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
8-Feb-05	18	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	5.01	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
15-Mar-05	20	1.1	ND<1	ND<1	ND<1	ND<1	ND<1	5.28	0.0816	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
19-Apr-05	9.0	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	4.51	0.128	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
2-May-05	8.2	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	3.69	0.17	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
16-Jun-05	12.0	ND<1	1.0	ND<1	ND<1	ND<1	ND<1	3.5	0.0511	ND<1	2.0	ND<1	ND<1	ND<1	ND<1	
14-Jul-05	7.7	1.1	ND<1	ND<1	ND<1	ND<1	ND<1	0.28	0.0298	ND<1	ND<1	7.3*	ND<1	ND<1	5.6*	
9-Aug-05	5.4	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	3.74	0.107	ND<1	5.8	ND<1	ND<1	ND<1	ND<1	
8-Sep-05	16	1.8	ND<1	ND<1	ND<1	ND<1	ND<1	3.57	0.0704	ND<1	11	ND<1	ND<1	ND<1	ND<1	
19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	
21-Nov-05	15	2.1	ND<1	ND<1	ND<1	ND<1	ND<1	6.1	0.0269	ND<1	12	ND<1	ND<1	ND<1	ND<1	
8-Dec-05	34	2.1	ND<1	ND<1	ND<1	ND<1	ND<1	4.25	ND<0.02	ND<1	25	ND<1	ND<1	ND<1	ND<1	
12-Jan-06	5.2	2.0	ND<1	ND<1	ND<1	ND<1	ND<1	9.15	0.0696	ND<1	5.0	ND<1	4.8*	1.0	ND<1	
14-Feb-06	6.5	4.3	1.2	ND<1	ND<1	ND<1	ND<1	3.99	ND<0.02	ND<1	2.8	ND<1	ND<1	ND<1	ND<1	
7-Mar-06	6.5	3.5	ND<1	ND<1	ND<1	ND<1	ND<1	4.76	0.0395	ND<1	3.8	ND<1	ND<1	ND<1	ND<1	
12-Apr-06	12.0	3.9	1.2	ND<1	ND<1	ND<1	ND<1	4.24	0.0522	ND<1	12.0	ND<1	ND<1	ND<1	ND<1	
17-May-06	19.0	5.1	ND<1	ND<1	ND<1	ND<1	ND<1	5.95	0.063	ND<1	14.0	ND<1	ND<1	ND<1	ND<1	
21-Jun-06	13.0	3.0	25	ND<1	ND<1	ND<1	ND<1	3.57	0.093	ND<1	5.0	ND<1	ND<1	ND<1	ND<1	
20-Jul-06	8.0	3.4	60	ND<1	ND<1	ND<1	ND<1	4.49	0.177	ND<1	7.5	ND<1	ND<1	ND<1	ND<1	
24-Aug-06	11.0	1.1	25	ND<1	ND<1	ND<1	ND<1	4.14	0.0172	ND<1	5.7	ND<1	ND<1	ND<1	ND<1	



TABLE 4

**GROUND-WATER REMEDIAL ACTION  
ROWE INDUSTRIES SUPERFUND SITE  
SAG HARBOR, NEW YORK**

**RECOVERY WELL WATER QUALITY RESULTS**

Recovery Well	Date Sampled	PCE	TCE	TCA	Vinyl Acetate	Chloroform	MTBE	Total Iron	Dissolved Iron	1,1-Dichloroethane	cis-1,2-Dichloroethene	1,1-Dichloroethene	Methylene Chloride <sup>1/</sup>	Toluene	Dibromochloromethane	Acetone <sup>1/</sup>
		(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(mg/L)	(mg/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)
	ARAR's	5	5	5	NE	7	NE	300	300	5	5	5	5	NE	NE	NE
RW-3	15-Sep-04	2.7	21	8.7	ND<1	ND<1	ND<1	1.91	0.42	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	2.2	12	5.0	ND<1	ND<1	ND<1	2.09	1.82	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	1.5	6.5	2.6	ND<1	ND<1	ND<1	1.87	1.8	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	3.77	0.489	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.60	2.24	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	1.6	1.3	ND<1	ND<1	ND<1	ND<1	2.10	1.15	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	3	13	5.0	ND<1	ND<1	ND<1	1.89	1.36	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	ND<1	2.0	ND<1	ND<1	ND<1	ND<1	46.1	0.539	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	2.2	7.7	2.8	ND<1	ND<1	ND<1	1.85	0.82	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	9.91	10	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	2.01	0.649	ND<1	ND<1	ND<1	9.1 *	ND<1	ND<1	6.9 *
	9-Aug-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.50	0.973	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	1	3.6	1.2	ND<1	ND<1	ND<1	2.03	0.71	ND<1	2.6	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	1.3	ND<1	ND<1	ND<1	ND<1	ND<1	1.83	0.708	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.11	0.556	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	1.7	17	7.9	ND<1	ND<1	ND<1	1.93	0.455	ND<1	ND<1	ND<1	4.6*	ND<1	ND<1	ND<1
	14-Feb-06	1.4	8.9	2.5	ND<1	ND<1	ND<1	3.80	0.157	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Mar-06	1.1	3.4	ND<1	ND<1	ND<1	ND<1	1.87	0.297	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Apr-06	0.95	ND<1	ND<1	ND<1	ND<1	ND<1	1.99	0.649	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	17-May-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	1.06	0.353	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Jun-06 <sup>1/</sup>	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	20-Jul-06	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	24-Aug-06	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
RW-4	15-Sep-04	120	3.7	18	ND<1	ND<1	ND<1	2.98	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	94	ND<1	14	ND<1	ND<1	ND<1	3.65	0.126	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	130	4.2	11	ND<1	ND<1	ND<1	4.75	0.205	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	230	5.7	35	ND<1	ND<1	ND<1	1.90	1.62	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	160	4.1	7.3	ND<1	ND<1	ND<1	6.11	3.28	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	15-Mar-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	19-Apr-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	2-May-05	80	2.4	9.8	ND<1	ND<1	ND<1	3.77	0.0687	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Jun-05	74	2.6	ND<1	ND<1	ND<1	ND<1	9.95	9.28	ND<1	ND<1	ND<1	4.5*	ND<1	ND<1	ND<1
	14-Jul-05	37	ND<1	8.9	ND<1	ND<1	ND<1	3.22	0.0185	ND<1	ND<1	ND<1	9.4 *	ND<1	ND<1	7.4 *
	9-Aug-05	31	ND<1	ND<1	ND<1	ND<1	ND<1	2.49	0.111	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	45	ND<1	6.0	ND<1	ND<1	ND<1	3.47	0.173	ND<1	ND<1	ND<1	3.47	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	30	ND<1	ND<1	ND<1	ND<1	ND<1	3.69	0.0777	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Dec-05	64	2.0	1.5	ND<1	ND<1	ND<1	2.82	0.0302	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	15	ND<1	9.5	ND<1	ND<1	ND<1	7.78	0.0412	ND<1	ND<1	ND<1	5.2 *	ND<1	ND<1	ND<1
	14-Feb-06	24	ND<1	8.7	ND<1	ND<1	ND<1	6.05	0.0627	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Mar-06	22	ND<1	7.0	ND<1	ND<1	ND<1	3.50	0.0476	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Apr-06	26	1.5	6.2	ND<1	ND<1	2	4.17	0.0963	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	17-May-06	26	ND<1	ND<1	ND<1	ND<1	ND<1	3.15	0.109	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Jun-06	23	ND<1	8.4	ND<1	ND<1	ND<1	9.23	0.086	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	20-Jul-06	14	ND<1	9.4	ND<1	ND<1	ND<1	4.10	0.155	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	24-Aug-06	23	ND<1	ND<1	ND<1	ND<1	ND<1	8.60	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1

TABLE 4

**GROUND-WATER REMEDIAL ACTION  
ROWE INDUSTRIES SUPERFUND SITE  
SAG HARBOR, NEW YORK**

**RECOVERY WELL WATER QUALITY RESULTS**

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	1,1-Dichloroethane (ug/L)	cis-1,2-Dichloroethene (ug/L)	1,1-Dichloroethene (ug/L)	Methylene Chloride (ug/L) <sup>1/</sup>	Toluene (ug/L)	Dibromochloromethane (ug/L)	Acetone (ug/L) <sup>1/</sup>	
	ARAR's	5	5	5	NE	7	NE	300	300	5	5	5	5	NE	NE	NE	
RW-5	15-Sep-04	24	ND<1	6.5	ND<1	ND<1	3.2	2.39	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	7-Oct-04	16	ND<1	5.2	ND<1	ND<1	2.4	0.139	0.0163	ND<1	ND<1	ND<1	ND<1	ND<1	1.4	ND<1	
	3-Nov-04	15	ND<1	6.4	ND<1	ND<1	2.2	0.0287	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Dec-04	28	ND<1	28	ND<1	ND<1	ND<1	0.0621	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	4-Jan-05	12	ND<1	5.6	ND<1	ND<1	2.0	0.0269	0.0172	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Feb-05	11	ND<1	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	14	ND<1	4.3	ND<1	ND<1	ND<1	2.6	0.318	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	9	ND<1	4.1	ND<1	ND<1	ND<1	0.0887	0.0187	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	13	ND<1	5.7	ND<1	ND<1	ND<1	0.0223	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	4.7	ND<1	ND<1	ND<1	ND<1	ND<1	0.0177	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	8.2	ND<1	1.6	ND<1	ND<1	ND<1	0.0358	ND<0.02	ND<1	ND<1	ND<1	9.5 *	ND<1	ND<1	ND<1	5.6 *
	9-Aug-05	2.6	ND<1	ND<1	ND<1	ND<1	ND<1	0.0227	0.0303	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	8	ND<1	3.8	ND<1	ND<1	ND<1	0.0185	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	2.6	ND<1	ND<1	ND<1	ND<1	ND<1	0.0482	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	2.4	ND<1	ND<1	ND<1	ND<1	ND<1	0.0468	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	2.3	ND<1	2.0	ND<1	ND<1	ND<1	0.0558	0.0119	ND<1	ND<1	ND<1	4.6*	ND<1	ND<1	ND<1	ND<1
	14-Feb-06	2.9	ND<1	3.8	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Mar-06	2.6	ND<1	3.0	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Apr-06	1.4	ND<1	ND<1	ND<1	ND<1	1.5	2.4	0.0786	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	17-May-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.016	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Jun-06	2.4	ND<1	2.6	ND<1	ND<1	ND<1	0.195	0.012	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	20-Jul-06	1.3	ND<1	3.1	ND<1	ND<1	ND<1	0.184	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	24-Aug-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.09	0.0116	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
RW-6	15-Sep-04	130	3.3	2.2	ND<1	ND<1	ND<1	0.0976	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	7-Oct-04	94	ND<1	1.6	ND<1	ND<1	ND<1	0.214	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	2.0	ND<1	
	3-Nov-04	94	2.1	2.4	ND<1	ND<1	2.5	0.0111	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Dec-04	200	3.8	16	ND<1	ND<1	ND<1	4.73	0.117	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	4-Jan-05	86	2.1	3.7	ND<1	ND<1	2.4	0.0279	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Feb-05	110	2.4	7.6	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Mar-05	120	2.3	6.6	ND<1	ND<1	2.7	0.0294	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Apr-05	74	ND<1	7.0	ND<1	ND<1	ND<1	0.0509	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	2-May-05	96	2.8	8.5	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	69	1.6	13	ND<1	ND<1	ND<1	0.067	0.0195	ND<1	ND<1	2.1	ND<1	ND<1	ND<1	ND<1	
	14-Jul-05	64	1.6	9.5	ND<1	ND<1	ND<1	0.0406	ND<0.02	ND<1	ND<1	ND<1	7.2 *	ND<1	ND<1	7 *	
	9-Aug-05	49	ND<1	12	ND<1	ND<1	ND<1	0.088	0.0366	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	100	1.6	12	ND<1	ND<1	ND<1	1.3	0.0143	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	68	ND<1	ND<1	ND<1	ND<1	ND<1	0.144	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	100	2.1	20	ND<1	ND<1	ND<1	0.139	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	41	1.1	16	ND<1	ND<1	ND<1	0.189	ND<0.02	ND<1	ND<1	ND<1	4.6*	ND<1	ND<1	ND<1	ND<1
	22-Feb-06	63	1.6	15	ND<1	ND<1	ND<1	0.116	0.0155	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Mar-06	65	1.2	17	ND<1	ND<1	ND<1	0.0429	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Apr-06	62	2.1	22	ND<1	ND<1	2	0.24	0.0137	0.97	ND<1	1.1	ND<1	ND<1	ND<1	ND<1	ND<1
	17-May-06	68	ND<1	18	ND<1	ND<1	ND<1	0.17	0.019	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Jun-06	83	ND<1	20	ND<1	ND<1	ND<1	0.075	0.025	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	20-Jul-06	45	1.5	24	ND<1	ND<1	ND<1	1.01	0.0169	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	24-Aug-06	30	ND<1	22	ND<1	ND<1	ND<1	5.36	0.0563	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1

TABLE 4

**GROUND-WATER REMEDIAL ACTION  
ROWE INDUSTRIES SUPERFUND SITE  
SAG HARBOR, NEW YORK**

**RECOVERY WELL WATER QUALITY RESULTS**

Recovery Well	Date Sampled	PCE	TCE	TCA	Vinyl Acetate	Chloroform	MTBE	Total Iron	Dissolved Iron	1,1-Dichloroethane	cis-1,2-Dichloroethene	1,1-Dichloroethene	Methylene Chloride <sup>1/</sup>	Toluene	Dibromochloromethane	Acetone <sup>1/</sup>	
		(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(mg/L)	(mg/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	
	ARAR's	5	5	5	NE	7	NE	300	300	5	5	5	5	NE	NE	NE	
RW-7	15-Sep-04	59	2.2	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	7-Oct-04	38	ND<1	ND<1	ND<1	ND<1	ND<1	0.0429	0.0126	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	3-Nov-04	36	ND<1	ND<1	ND<1	ND<1	ND<1	0.0214	0.0108	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Dec-04	82	ND<1	4.3	ND<1	ND<1	ND<1	0.0272	0.00876	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	4-Jan-05	37	1.1	ND<1	ND<1	ND<1	ND<1	0.0343	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Feb-05	45	ND<1	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Mar-05	42	1.5	1.7	ND<1	ND<1	ND<1	0.0356	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Apr-05	22	ND<1	ND<1	ND<1	ND<1	ND<1	0.107	0.0152	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	2-May-05	30	ND<1	ND<1	ND<1	ND<1	ND<1	0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	16-Jun-05	32	1.0	4.7	ND<1	ND<1	ND<1	0.0753	0.02	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	14-Jul-05	32	ND<1	2.2	ND<1	ND<1	ND<1	0.0155	ND<0.02	ND<1	ND<1	ND<1	8.7 *	ND<1	ND<1	7.2 *	
	9-Aug-05	31	ND<1	6.2	ND<1	ND<1	ND<1	0.0903	0.0409	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Sep-05	39	ND<1	3.4	ND<1	ND<1	ND<1	0.0452	ND<0.02	1.7	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	36	ND<1	ND<1	ND<1	ND<1	ND<1	0.536	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Dec-05	70	ND<1	12.0	ND<1	ND<1	ND<1	0.253	ND<0.02	4.2	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	12-Jan-06	26	ND<1	5.0	ND<1	ND<1	ND<1	0.343	ND<0.02	2.2	ND<1	ND<1	5.0 *	ND<1	ND<1	ND<1	
	14-Feb-06	36	ND<1	4.1	ND<1	ND<1	ND<1	0.0332	ND<0.02	2.0	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	7-Mar-06	38	ND<1	4.1	ND<1	ND<1	ND<1	0.143	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	12-Apr-06	49	1.6	7.4	ND<1	ND<1	ND<1	0.0912	0.0175	3.4	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	17-May-06	59	ND<1	ND<1	ND<1	ND<1	ND<1	0.126	0.026	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	21-Jun-06	44	ND<1	4.6	ND<1	ND<1	ND<1	0.081	0.013	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	20-Jul-06	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	24-Aug-06	39	ND<1	7.9	ND<1	ND<1	ND<1	0.3	0.1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
RW-8	15-Sep-04	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	ND<1	ND<1	NM	
	27-Oct-04	4.1	1.0	2.2	ND<1	ND<1	ND<1	28.8	0.235	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	3-Nov-04	5.3	ND<1	4.0	ND<1	ND<1	ND<1	10.6	0.271	3.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Dec-04	16	ND<1	22	ND<1	ND<1	ND<1	15.6	0.149	15	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	4-Jan-05	6.9	1.3	3.9	ND<1	ND<1	ND<1	8.92	2.85	2.7	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Feb-05	7.4	ND<1	7.2	ND<1	ND<1	ND<1	8.24	ND<0.02	4.7	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Mar-05	9.0	1.3	4.2	ND<1	ND<1	ND<1	7.54	0.075	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Apr-05	3.5	ND<1	3.5	ND<1	ND<1	ND<1	8.89	0.321	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	2-May-05	5.6	ND<1	5.2	ND<1	ND<1	ND<1	7.33	0.073	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	16-Jun-05	2.7	ND<1	5.8	ND<1	ND<1	ND<1	7.06	0.325	2.1	ND<1	1.7	ND<1	ND<1	ND<1	ND<1	
	14-Jul-05	2.6	ND<1	3.4	ND<1	ND<1	ND<1	8.33	0.017	ND<1	ND<1	ND<1	8.5 *	ND<1	ND<1	8.2 *	
	9-Aug-05	1.8	ND<1	2.9	ND<1	ND<1	ND<1	0.24	0.065	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Sep-05	2.9	ND<1	4.2	ND<1	ND<1	ND<1	7.53	0.255	2.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	7.65	0.106	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Dec-05	2.4	ND<1	5.0	ND<1	ND<1	ND<1	5.19	0.021	3.2	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	12-Jan-06	1.3	ND<1	3.7	ND<1	ND<1	ND<1	7.25	0.097	2.0	ND<1	ND<1	4.9 *	ND<1	ND<1	ND<1	
	14-Feb-06	1.5	ND<1	3.0	ND<1	ND<1	ND<1	8.06	ND<0.02	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	7-Mar-06	1.3	ND<1	2.8	ND<1	ND<1	ND<1	8.33	0.064	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	12-Apr-06	2.1	0.9	4.5	ND<1	ND<1	ND<1	7.27	0.823	3.3	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	17-May-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.03	0.056	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	21-Jun-06	ND<1	ND<1	2.8	ND<1	ND<1	ND<1	8.40	0.897	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	20-Jul-06	1.0	ND<1	4.0	ND<1	ND<1	ND<1	10.80	0.175	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	24-Aug-06	ND<1	ND<1	3.2	ND<1	ND<1	ND<1	5.98	1.860	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	

TABLE 4

GROUND-WATER REMEDIAL ACTION  
 ROWE INDUSTRIES SUPERFUND SITE  
 SAG HARBOR, NEW YORK

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE	TCE	TCA	Vinyl Acetate	Chloroform	MTBE	Total Iron	Dissolved Iron	1,1-Dichloroethane	cis-1,2-Dichloroethene	1,1-Dichloroethene	Methylene Chloride <sup>1/</sup>	Toluene	Dibromochloromethane	Acetone <sup>1/</sup>	
		(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(mg/L)	(mg/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	
ARAR's	5	5	5	5	NE	7	NE	300	300	5	5	5	5	NE	NE	NE	
RW-9	15-Sep-04	3.7	1.0	6.0	ND<1	ND<1	ND<1	0.049	ND<0.02	1.9	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	7-Oct-04	3.1	ND<1	5.0	ND<1	ND<1	ND<1	3.12	0.716	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	3-Nov-04	1.6	ND<1	5.9	ND<1	ND<1	ND<1	2.97	1.41	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Dec-04	1.3	ND<1	31	ND<1	ND<1	ND<1	2.78	0.497	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	4-Jan-05	ND<1	1.0	6.4	ND<1	ND<1	ND<1	2.35	1.72	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Feb-05	ND<1	ND<1	10	ND<1	ND<1	ND<1	0.0974	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Mar-05	ND<1	1.4	5.9	ND<1	ND<1	ND<1	1.55	0.507	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Apr-05	ND<1	ND<1	4.5	ND<1	ND<1	ND<1	1.59	0.091	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	2-May-05	ND<1	2.9	9.0	ND<1	ND<1	ND<1	2.89	0.0596	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	16-Jun-05	ND<1	ND<1	5.8	ND<1	ND<1	ND<1	1.38	0.149	0.9	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	14-Jul-05	3.4	ND<1	3.1	ND<1	ND<1	ND<1	2.55	0.238	ND<1	ND<1	ND<1	6.9 *	ND<1	ND<1	7.3 *	
	9-Aug-05	ND<1	ND<1	1.4	ND<1	ND<1	ND<1	0.994	0.0734	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Sep-05	1.2	ND<1	2.0	ND<1	ND<1	ND<1	3.64	0.161	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	1.31	0.108	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Dec-05	ND<1	ND<1	2.9	ND<1	ND<1	ND<1	2.01	0.024	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	12-Jan-06	ND<1	ND<1	1.4	ND<1	ND<1	ND<1	2.36	0.0905	ND<1	ND<1	ND<1	4.9 *	ND<1	ND<1	ND<1	
	14-Feb-06	2.1	ND<1	1.8	ND<1	ND<1	ND<1	5.23	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	7-Mar-06	1.3	ND<1	ND<1	ND<1	ND<1	ND<1	3.41	0.333	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	12-Apr-06	ND<1	ND<1	2.2	ND<1	ND<1	ND<1	1.93	0.108	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
17-May-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	1.64	0.054	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1		
21-June-06 <sup>2/</sup>	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	
20-Jul-06	ND<1	ND<1	2.2	ND<1	ND<1	ND<1	3.5	0.695	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1		
24-Aug-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.97	0.0165	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1		

ND: Not detected

<#: Less than method detection limit

ug/L: Micrograms per liter

-: Not analyzed

ARAR's are chemical specific aquifer restoration goals for ground water at the Former Rowe Industries Superfund Site.

Bold values indicate an exceedance of the ARAR standard established for the site.

PCE: Tetrachloroethylene

TCE: Trichloroethene

TCA: 1,1,1-Trichloroethane

1,1-DCA: 1,1-Dichloroethane

1,1-DCE: 1,1-Dichloroethene

1,2-DCE: 1,2-Dichloroethene

MTBE: Methyl Tertiary Butyl Ether

NM: Not Measured

NE indicates that the ARAR goal was not established for this compound by the EPA.

\*Concentrations with an asterisk following them are due to laboratory contamination.


<sup>1/</sup> RW-3 is currently non operational weighting for the reprogramming of the drive for the new 4 amp pump.

<sup>2/</sup> RW-9 was being rehabilitated during this sampling event, thus no water sample was collected.

## **GRAPHS**


**GRAPH 1**  
**GROUND-WATER REMEDIAL ACTION**  
**ROWE INDUSTRIES SUPERFUND SITE**  
**SAG HARBOR, NEW YORK**

**EFFLUENT FLOW DATA**  
(August 1, 2006 through August 31, 2006)

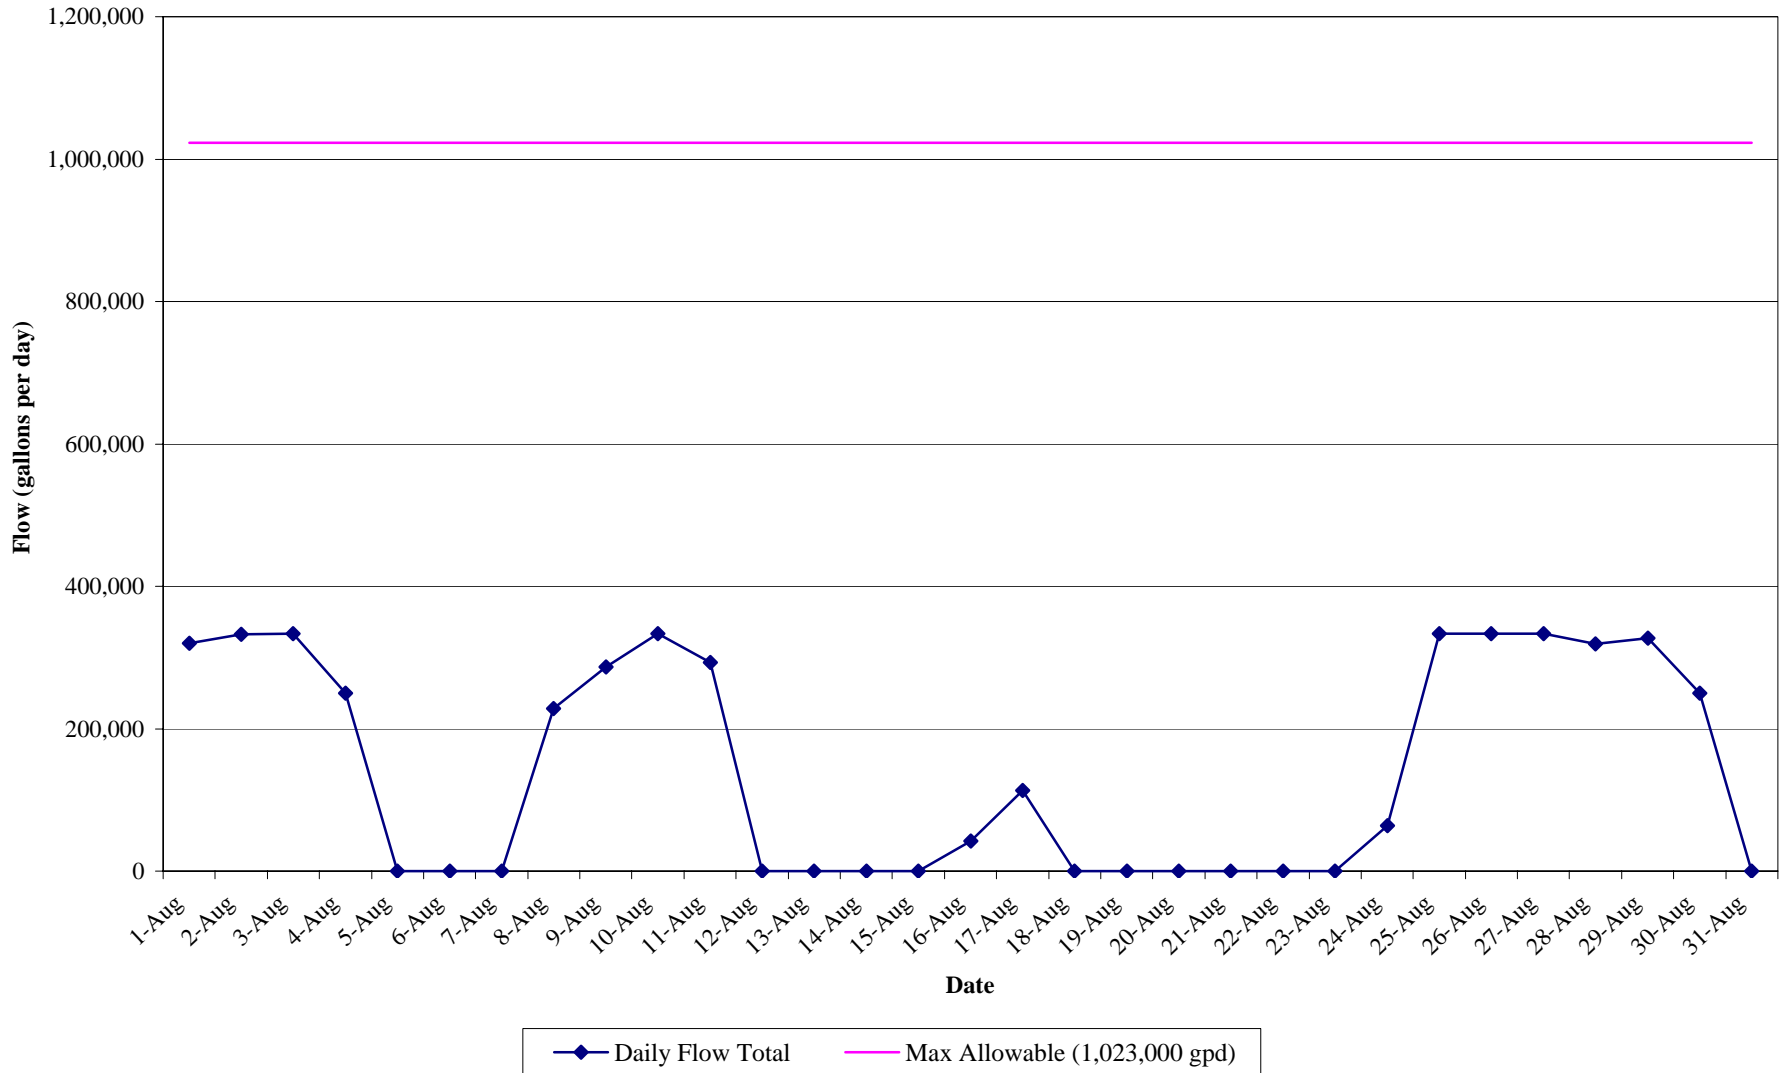


**GRAPH 2**  
**GROUND-WATER REMEDIAL ACTION**  
**ROWE INDUSTRIES SUPERFUND SITE**  
**SAG HARBOR, NEW YORK**

**RECOVERY WELL PCE CONCENTRATION IN MICROGRAMS PER LITER**

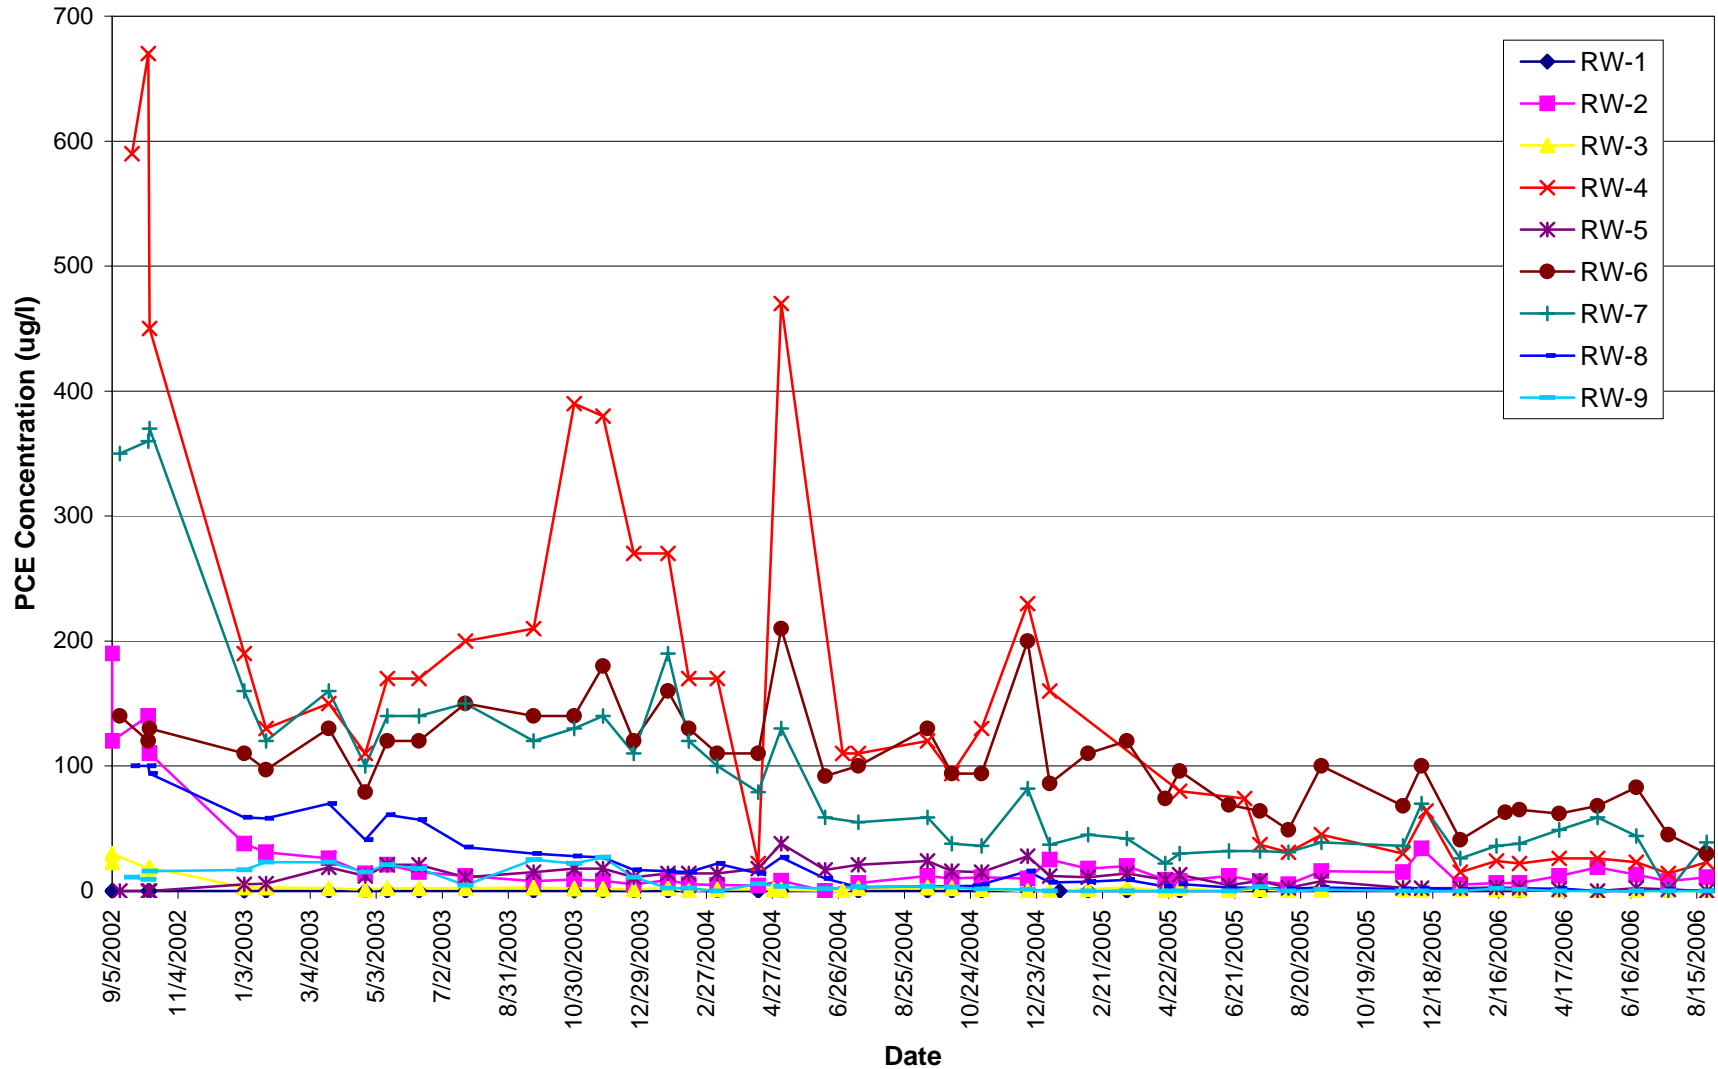

**GRAPH 3**  
**GROUND-WATER REMEDIAL ACTION**  
**ROWE INDUSTRIES SUPERFUND SITE**  
**SAG HARBOR, NEW YORK**

**RECOVERY WELL PCE CONCENTRATION FOR SELECT RECOVERY WELLS**

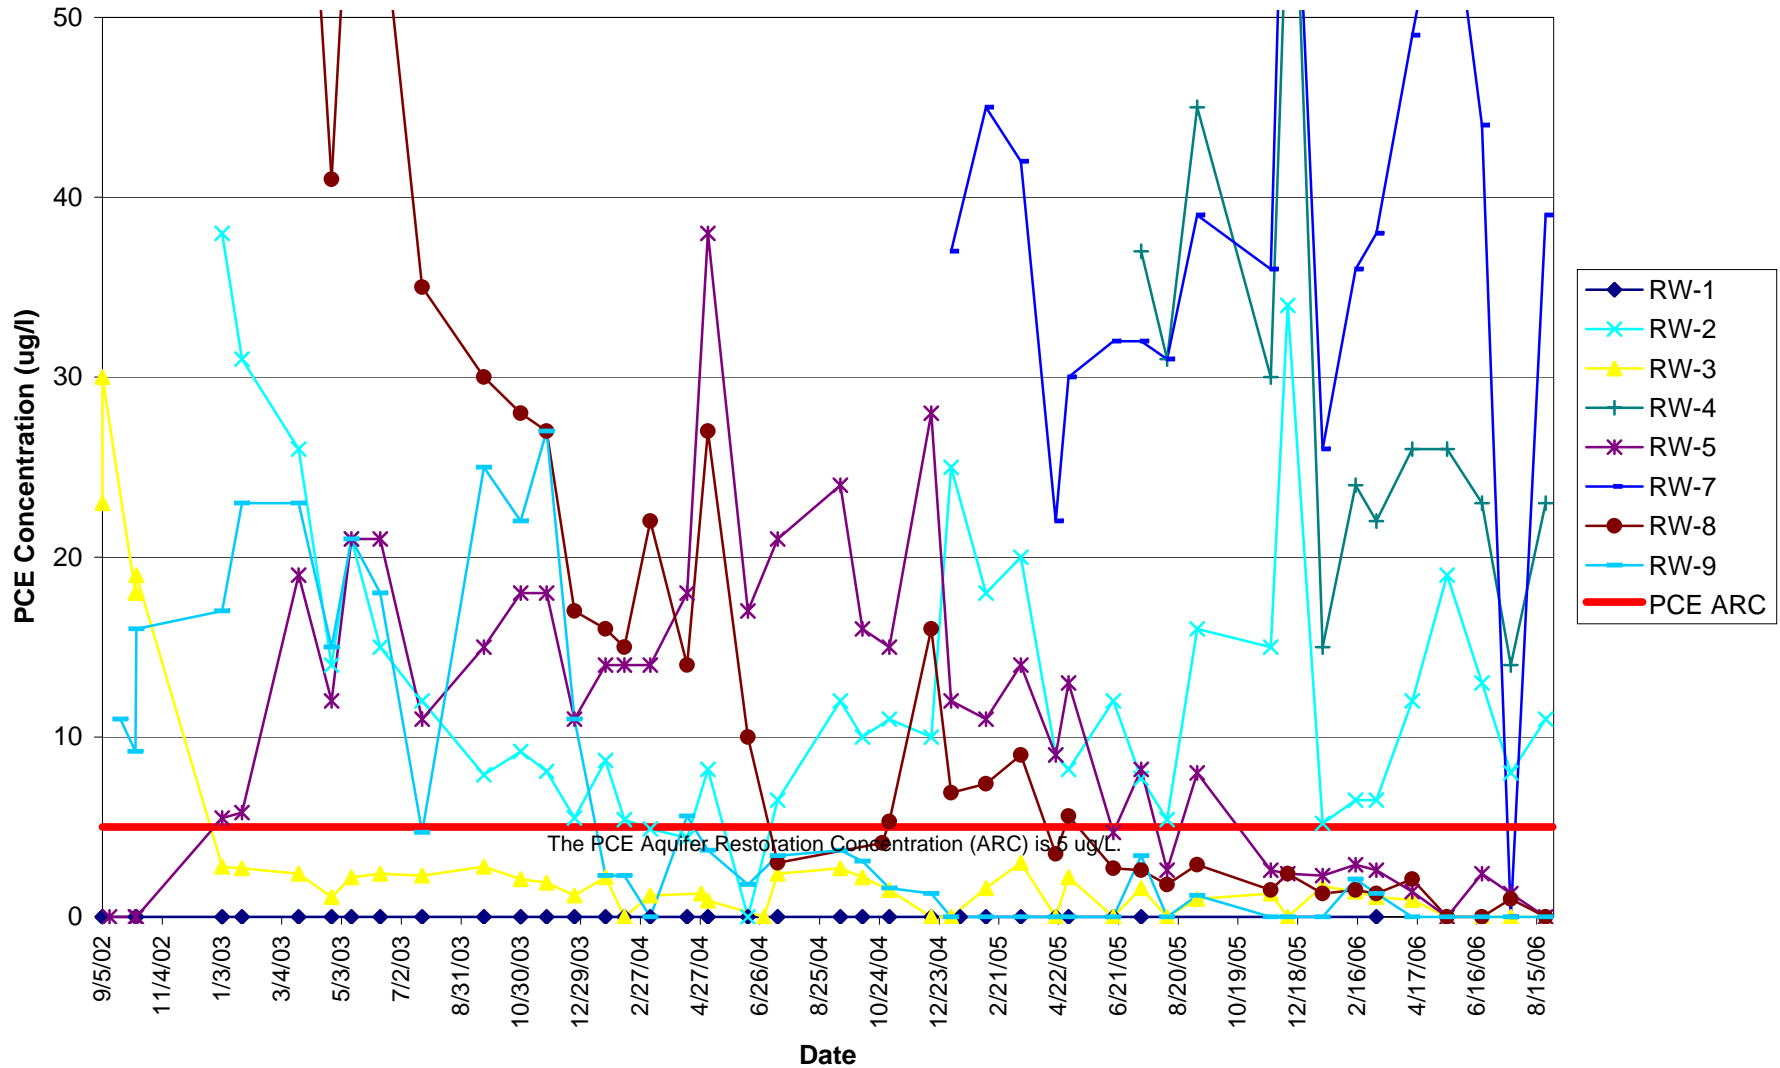



**APPENDIX I**  
**AUGUST 2006 LABORATORY ANALYTICAL REPORTS**

Monday, August 14, 2006

Mark Goldberg  
Leggette Brashears & Graham Inc.  
4 Research Drive  
Suite 301  
Shelton, CT 06484

TEL: (203) 929-8555  
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0608114

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 8/10/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at [lbeyer@american-analytical.com](mailto:lbeyer@american-analytical.com).

Sincerely,

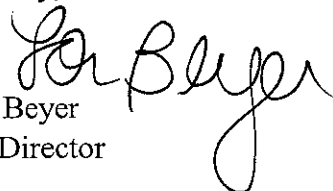  
Lori Beyer  
Lab Director

**CLIENT:** Leggette Brashears & Graham Inc.  
**Project:** Rowe Industries  
**Lab Order:** 0608114

**Work Order Sample Summary**

---

<b>Lab Sample ID</b>	<b>Client Sample ID</b>	<b>Tag Number</b>	<b>Date Collected</b>	<b>Date Received</b>
0608114-01A	WQ080806: 800 NP2-6	10274	8/8/2006	8/10/2006
0608114-01B	WQ080806: 800 NP2-6	10274	8/8/2006	8/10/2006
0608114-01C	WQ080806: 800 NP2-6	10274	8/8/2006	8/10/2006
0608114-02A	WQ080806: 805 NP2-7	10274	8/8/2006	8/10/2006
0608114-02B	WQ080806: 805 NP2-7	10274	8/8/2006	8/10/2006
0608114-02C	WQ080806: 805 NP2-7	10274	8/8/2006	8/10/2006
0608114-03A	WQ080806: 810 NP2-10	10274	8/8/2006	8/10/2006
0608114-03B	WQ080806: 810 NP2-10	10274	8/8/2006	8/10/2006
0608114-03C	WQ080806: 810 NP2-10	10274	8/8/2006	8/10/2006



**AMERICAN ANALYTICAL LABORATORIES, LLC**

**56 TOLEDO STREET**

**FARMINGDALE, NEW YORK 11735**

**TELEPHONE: (631) 454-6100 FAX: (631) 454-8027**

**DATA REPORTING QUALIFIERS**

For reporting results, the following "Results Qualifiers" are used:

<b>Value</b>	If the result is greater than or equal to the detection limit, report the value
<b>U</b>	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
<b>J</b>	Indicates an estimated value. The flag is used: <ol style="list-style-type: none"><li>(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)</li><li>(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.</li></ol>
<b>B</b>	Indicates the analyte was found in the blank as well as the sample report "10B".
<b>E</b>	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
<b>D</b>	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
<b>P</b>	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
<b>N</b>	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
<b>H</b>	Indicates sample was received and/or analyzed outside of The method allowable holding time

# American Analytical Laboratories, LLC.

Date: 14-Aug-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608114  
**Project:** Rowe Industries  
**Lab ID:** 0608114-01A

**Client Sample ID:** WQ080806: 800 NP2-6  
**Tag Number:** 10274  
**Collection Date:** 8/8/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: <b>LDS</b>
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
1,1,1-Trichloroethane	7.1	1.0		µg/L	1	8/11/2006 8:06:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
2-Butanone	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
2-Hexanone	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Acetone	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Benzene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Bromobenzene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Bromochloromethane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Bromodichloromethane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Bromoform	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Bromomethane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Carbon disulfide	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Chlorobenzene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 14-Aug-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608114  
**Project:** Rowe Industries  
**Lab ID:** 0608114-01A

**Client Sample ID:** WQ080806: 800 NP2-6  
**Tag Number:** 10274  
**Collection Date:** 8/8/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		<b>Analyst: LDS</b>
Chloroethane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Chloroform	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Chloromethane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Dibromochloromethane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Dibromomethane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Ethylbenzene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Isopropylbenzene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
m,p-Xylene	U	2.0		µg/L	1	8/11/2006 8:06:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Methylene chloride	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Naphthalene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
n-Butylbenzene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
n-Propylbenzene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
o-Xylene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Styrene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Tetrachloroethene	13	1.0		µg/L	1	8/11/2006 8:06:00 AM
Toluene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Trichloroethene	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Vinyl acetate	U	1.0		µg/L	1	8/11/2006 8:06:00 AM
Vinyl chloride	U	1.0		µg/L	1	8/11/2006 8:06:00 AM

**Qualifiers:**  
 B Analyte detected in the associated Method Blank  
 H Holding times for preparation or analysis exceeded  
 ND Not Detected at the Reporting Limit  
 U Indicates the compound was analyzed for but not detected

E Value above quantitation range  
 J Analyte detected below quantitation limits  
 S Spike Recovery outside accepted recovery limits  
 X Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 14-Aug-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ080806: 800 NP2-6
<b>Lab Order:</b>	0608114	<b>Tag Number:</b>	10274
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/8/2006
<b>Lab ID:</b>	0608114-01B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: <b>JP</b>
Iron	5.17	0.0200		mg/L	1	8/14/2006 11:00:11 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



**American Analytical Laboratories, LLC.**

Date: 14-Aug-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ080806: 800 NP2-6
<b>Lab Order:</b>	0608114	<b>Tag Number:</b>	10274
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/8/2006
<b>Lab ID:</b>	0608114-01C	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: JP
Iron	0.0658	0.0200		mg/L	1	8/14/2006 10:58:07 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 14-Aug-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ080806: 805 NP2-7
<b>Lab Order:</b>	0608114	<b>Tag Number:</b>	10274
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/8/2006
<b>Lab ID:</b>	0608114-02A	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>						Analyst: LDS
		<b>SW8260B</b>		<b>SW5030A</b>		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
2-Butanone	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
2-Hexanone	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Acetone	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Benzene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Bromobenzene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Bromochloromethane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Bromodichloromethane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Bromoform	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Bromomethane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Carbon disulfide	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Chlorobenzene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 14-Aug-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ080806: 805 NP2-7
<b>Lab Order:</b>	0608114	<b>Tag Number:</b>	10274
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/8/2006
<b>Lab ID:</b>	0608114-02A	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		<b>Analyst: LDS</b>
Chloroethane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Chloroform	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Chloromethane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Dibromochloromethane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Dibromomethane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Ethylbenzene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Isopropylbenzene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
m,p-Xylene	U	2.0		µg/L	1	8/11/2006 8:43:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Methylene chloride	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Naphthalene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
n-Butylbenzene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
n-Propylbenzene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
o-Xylene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Styrene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Tetrachloroethene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Toluene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Trichloroethene	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Vinyl acetate	U	1.0		µg/L	1	8/11/2006 8:43:00 AM
Vinyl chloride	U	1.0		µg/L	1	8/11/2006 8:43:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 14-Aug-06

---

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ080806: 805 NP2-7
<b>Lab Order:</b>	0608114	<b>Tag Number:</b>	10274
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/8/2006
<b>Lab ID:</b>	0608114-02B	<b>Matrix:</b>	LIQUID

---

<b>Analyses</b>	<b>Result</b>	<b>Limit</b>	<b>Qual</b>	<b>Units</b>	<b>DF</b>	<b>Date Analyzed</b>
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		<b>Analyst: JP</b>
Iron	5.47	0.0200		mg/L	1	8/14/2006 11:02:14 AM

---

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 14-Aug-06

---

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ080806: 805 NP2-7
<b>Lab Order:</b>	0608114	<b>Tag Number:</b>	10274
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/8/2006
<b>Lab ID:</b>	0608114-02C	<b>Matrix:</b>	LIQUID

---

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: <b>JP</b>
Iron	0.114	0.0200		mg/L	1	8/14/2006 11:05:07 AM

---

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 14-Aug-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608114  
**Project:** Rowe Industries  
**Lab ID:** 0608114-03A

**Client Sample ID:** WQ080806: 810 NP2-10  
**Tag Number:** 10274  
**Collection Date:** 8/8/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
2-Butanone	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
2-Hexanone	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Acetone	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Benzene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Bromobenzene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Bromochloromethane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Bromodichloromethane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Bromoform	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Bromomethane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Carbon disulfide	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Chlorobenzene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 14-Aug-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ080806: 810 NP2-10
<b>Lab Order:</b>	0608114	<b>Tag Number:</b>	10274
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/8/2006
<b>Lab ID:</b>	0608114-03A	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: <b>LDS</b>
Chloroethane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Chloroform	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Chloromethane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Dibromochloromethane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Dibromomethane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Ethylbenzene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Isopropylbenzene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
m,p-Xylene	U	2.0		µg/L	1	8/11/2006 9:19:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Methylene chloride	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Naphthalene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
n-Butylbenzene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
n-Propylbenzene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
o-Xylene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Styrene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Tetrachloroethene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Toluene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Trichloroethene	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Vinyl acetate	U	1.0		µg/L	1	8/11/2006 9:19:00 AM
Vinyl chloride	U	1.0		µg/L	1	8/11/2006 9:19:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 14-Aug-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ080806: 810 NP2-10
<b>Lab Order:</b>	0608114	<b>Tag Number:</b>	10274
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/8/2006
<b>Lab ID:</b>	0608114-03B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: JP
Iron	5.31	0.0200		mg/L	1	8/14/2006 11:10:46 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



**American Analytical Laboratories, LLC.**

Date: 14-Aug-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ080806: 810 NP2-10
<b>Lab Order:</b>	0608114	<b>Tag Number:</b>	10274
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/8/2006
<b>Lab ID:</b>	0608114-03C	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: <b>JP</b>
Iron	0.142	0.0200		mg/L	1	8/14/2006 11:06:57 AM
<b>TOTAL DISSOLVED SOLIDS</b>		<b>E160.1</b>				Analyst: <b>JC</b>
Total Dissolved Solids (Residue, Filterable)	112	1.00		mg/L	1	8/10/2006

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

Wednesday, August 23, 2006

Mark Goldberg  
Leggette Brashears & Graham Inc.  
4 Research Drive  
Suite 301  
Shelton, CT 06484

TEL: (203) 929-8555

FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0608180

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 8/16/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at [lbeyer@american-analytical.com](mailto:lbeyer@american-analytical.com).

Sincerely,

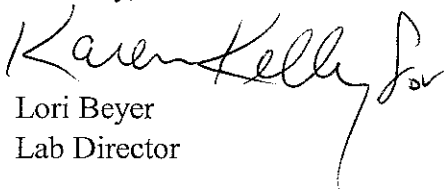  
Lori Beyer  
Lab Director

**CLIENT:** Leggette Brashears & Graham Inc.  
**Project:** Rowe Industries  
**Lab Order:** 0608180

**Work Order Sample Summary**

---

<b>Lab Sample ID</b>	<b>Client Sample ID</b>	<b>Tag Number</b>	<b>Date Collected</b>	<b>Date Received</b>
0608180-01A	WQ081606:800 NP2-6	10981	8/16/2006	8/16/2006
0608180-01B	WQ081606:800 NP2-6	10981	8/16/2006	8/16/2006
0608180-01C	WQ081606:800 NP2-6	10981	8/16/2006	8/16/2006
0608180-02A	WQ081606:805 NP2-7	10981	8/16/2006	8/16/2006
0608180-02B	WQ081606:805 NP2-7	10981	8/16/2006	8/16/2006
0608180-02C	WQ081606:805 NP2-7	10981	8/16/2006	8/16/2006
0608180-03A	WQ081606:810 NP2-10	10981	8/16/2006	8/16/2006
0608180-03B	WQ081606:810 NP2-10	10981	8/16/2006	8/16/2006
0608180-03C	WQ081606:810 NP2-10	10981	8/16/2006	8/16/2006



# AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

## DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

<b>Value</b>	If the result is greater than or equal to the detection limit, report the value
<b>U</b>	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
<b>J</b>	Indicates an estimated value. The flag is used: <ol style="list-style-type: none"><li>(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)</li><li>(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.</li></ol>
<b>B</b>	Indicates the analyte was found in the blank as well as the sample report "10B".
<b>E</b>	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
<b>D</b>	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
<b>P</b>	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
<b>N</b>	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
<b>H</b>	Indicates sample was received and/or analyzed outside of The method allowable holding time

# American Analytical Laboratories, LLC.

Date: 23-Aug-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608180  
**Project:** Rowe Industries  
**Lab ID:** 0608180-01A

**Client Sample ID:** WQ081606:800 NP2-6  
**Tag Number:** 10981  
**Collection Date:** 8/16/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
1,1,1-Trichloroethane	5.6	1.0		µg/L	1	8/21/2006 10:29:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
2-Butanone	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
2-Hexanone	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Acetone	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Benzene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Bromobenzene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Bromochloromethane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Bromodichloromethane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Bromoform	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Bromomethane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Carbon disulfide	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Chlorobenzene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 23-Aug-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608180  
**Project:** Rowe Industries  
**Lab ID:** 0608180-01A

**Client Sample ID:** WQ081606:800 NP2-6  
**Tag Number:** 10981  
**Collection Date:** 8/16/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>				Analyst: <b>LDS</b>
Chloroethane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Chloroform	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Chloromethane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Dibromochloromethane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Dibromomethane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Ethylbenzene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Isopropylbenzene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
m,p-Xylene	U	2.0		µg/L	1	8/21/2006 10:29:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Methylene chloride	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Naphthalene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
n-Butylbenzene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
n-Propylbenzene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
o-Xylene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Styrene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Tetrachloroethene	18	1.0		µg/L	1	8/21/2006 10:29:00 PM
Toluene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Trichloroethene	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Vinyl acetate	U	1.0		µg/L	1	8/21/2006 10:29:00 PM
Vinyl chloride	U	1.0		µg/L	1	8/21/2006 10:29:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 23-Aug-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608180  
**Project:** Rowe Industries  
**Lab ID:** 0608180-01B

**Client Sample ID:** WQ081606:800 NP2-6  
**Tag Number:** 10981  
**Collection Date:** 8/16/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: <b>JP</b>
Iron	2.64	0.0200		mg/L	1	8/22/2006 2:11:33 PM

Qualifiers:			
B	Analyte detected in the associated Method Blank	E	Value above quantitation range
H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



**American Analytical Laboratories, LLC.**

Date: 23-Aug-06

---

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ081606:800 NP2-6
<b>Lab Order:</b>	0608180	<b>Tag Number:</b>	10981
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/16/2006
<b>Lab ID:</b>	0608180-01C	<b>Matrix:</b>	LIQUID

---

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: <b>JP</b>
Iron	0.0829	0.0200		mg/L	1	8/22/2006 2:09:36 PM

---

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 23-Aug-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ081606:805 NP2-7
<b>Lab Order:</b>	0608180	<b>Tag Number:</b>	10981
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/16/2006
<b>Lab ID:</b>	0608180-02A	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>						
		<b>SW8260B</b>				Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
2-Butanone	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
2-Hexanone	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Acetone	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Benzene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Bromobenzene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Bromochloromethane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Bromodichloromethane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Bromoform	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Bromomethane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Carbon disulfide	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Chlorobenzene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 23-Aug-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ081606:805 NP2-7
<b>Lab Order:</b>	0608180	<b>Tag Number:</b>	10981
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/16/2006
<b>Lab ID:</b>	0608180-02A	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		Analyst: <b>LDS</b>		
Chloroethane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Chloroform	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Chloromethane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Dibromochloromethane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Dibromomethane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Ethylbenzene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Isopropylbenzene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
m,p-Xylene	U	2.0		µg/L	1	8/21/2006 11:07:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Methylene chloride	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Naphthalene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
n-Butylbenzene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
n-Propylbenzene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
o-Xylene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Styrene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Tetrachloroethene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Toluene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Trichloroethene	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Vinyl acetate	U	1.0		µg/L	1	8/21/2006 11:07:00 PM
Vinyl chloride	U	1.0		µg/L	1	8/21/2006 11:07:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 23-Aug-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ081606:805 NP2-7
<b>Lab Order:</b>	0608180	<b>Tag Number:</b>	10981
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/16/2006
<b>Lab ID:</b>	0608180-02B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: <b>JP</b>
Iron	1.76	0.0200		mg/L	1	8/22/2006 2:17:48 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

**Date:** 23-Aug-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ081606:805 NP2-7
<b>Lab Order:</b>	0608180	<b>Tag Number:</b>	10981
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/16/2006
<b>Lab ID:</b>	0608180-02C	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: JP
Iron	0.146	0.0200		mg/L	1	8/22/2006 2:15:52 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 23-Aug-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608180  
**Project:** Rowe Industries  
**Lab ID:** 0608180-03A

**Client Sample ID:** WQ081606:810 NP2-10  
**Tag Number:** 10981  
**Collection Date:** 8/16/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		Analyst: <b>LDS</b>		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
2-Butanone	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
2-Hexanone	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Acetone	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Benzene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Bromobenzene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Bromochloromethane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Bromodichloromethane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Bromoform	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Bromomethane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Carbon disulfide	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Chlorobenzene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 23-Aug-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608180  
**Project:** Rowe Industries  
**Lab ID:** 0608180-03A

**Client Sample ID:** WQ081606:810 NP2-10  
**Tag Number:** 10981  
**Collection Date:** 8/16/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>						
		<b>SW8260B</b>				Analyst: <b>LDS</b>
Chloroethane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Chloroform	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Chloromethane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Dibromochloromethane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Dibromomethane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Ethylbenzene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Isopropylbenzene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
m,p-Xylene	U	2.0		µg/L	1	8/21/2006 11:44:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Methylene chloride	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Naphthalene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
n-Butylbenzene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
n-Propylbenzene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
o-Xylene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Styrene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Tetrachloroethene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Toluene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Trichloroethene	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Vinyl acetate	U	1.0		µg/L	1	8/21/2006 11:44:00 PM
Vinyl chloride	U	1.0		µg/L	1	8/21/2006 11:44:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 23-Aug-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ081606:810 NP2-10
<b>Lab Order:</b>	0608180	<b>Tag Number:</b>	10981
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/16/2006
<b>Lab ID:</b>	0608180-03B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: <b>JP</b>
Iron	2.12	0.0200		mg/L	1	8/22/2006 2:23:12 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



**American Analytical Laboratories, LLC.**

Date: 23-Aug-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ081606:810 NP2-10
<b>Lab Order:</b>	0608180	<b>Tag Number:</b>	10981
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/16/2006
<b>Lab ID:</b>	0608180-03C	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: <b>JP</b>
Iron	0.155	0.0200		mg/L	1	8/22/2006 2:20:24 PM
<b>TOTAL DISSOLVED SOLIDS</b>		<b>E160.1</b>				Analyst: <b>JC</b>
Total Dissolved Solids (Residue, Filterable)	164	1.00		mg/L	1	8/16/2006

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

Friday, September 01, 2006

Mark Goldberg  
Leggette Brashears & Graham Inc.  
4 Research Drive  
Suite 301  
Shelton, CT 06484

TEL: (203) 929-8555  
FAX (203) 926-9140

RE: Rowe Industries

Dear Mark Goldberg:

Order No.: 0608259

American Analytical Laboratories, LLC. received 3 sample(s) on 8/24/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at [lbeyer@american-analytical.com](mailto:lbeyer@american-analytical.com).

Sincerely,

  
Lori Beyer  
Lab Director

**CLIENT:** Leggette Brashears & Graham Inc.  
**Project:** Rowe Industries  
**Lab Order:** 0608259

**Work Order Sample Summary**

---

<b>Lab Sample ID</b>	<b>Client Sample ID</b>	<b>Tag Number</b>	<b>Date Collected</b>	<b>Date Received</b>
0608259-01A	WQ082406:930 NP2-6	11008	8/24/2006	8/24/2006
0608259-01B	WQ082406:930 NP2-6	11008	8/24/2006	8/24/2006
0608259-01C	WQ082406:930 NP2-6	11008	8/24/2006	8/24/2006
0608259-02A	WQ082406:935 NP2-7	11008	8/24/2006	8/24/2006
0608259-02B	WQ082406:935 NP2-7	11008	8/24/2006	8/24/2006
0608259-02C	WQ082406:935 NP2-7	11008	8/24/2006	8/24/2006
0608259-03A	WQ082406:940 NP2-10	11008	8/24/2006	8/24/2006
0608259-03B	WQ082406:940 NP2-10	11008	8/24/2006	8/24/2006
0608259-03C	WQ082406:940 NP2-10	11008	8/24/2006	8/24/2006

TAG # / COC 11008

# CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

CLIENT NAME/ADDRESS <b>L-66</b> <b>4 Research Dr.</b> <b>Stelton, CT</b>	CONTACT: <b>Mark Goldberg</b>	SAMPLER (SIGNATURE) 	SAMPLE(S) SEALED <b>YES</b> / NO
PROJECT LOCATION: <b>Rowe</b>		SAMPLER NAME (PRINT) <b>Rob Drew</b>	CORRECT CONTAINER(S) <b>YES</b> / NO

LABORATORY ID #	MATRIX	# CONTAINERS	SAMPLING DATE/TIME	SAMPLE # - LOCATION	ANALYSIS REQUIRED	FOR METHANOL PRESERVED SAMPLES (VOLATILE VIAL #)
0602257-1ABC	V	4	8-24-06	WA082406: 930MP2-6	X X X X	
-2ABC	↓	4	↓	↓ : 935MP2-7	X X X X	
-3ABC	↓	5	↓	↓ : 940MP2-10	X X X X X	

Cooler Temperature:	COMMENTS / INSTRUCTIONS		
TURNAROUND REQUIRED:	NORMAL <input checked="" type="checkbox"/> STAT <input type="checkbox"/> BY / / RECEIVED BY LAB (SIGNATURE)  DATE/TIME 8/24/06 1120	RECEIVED BY LAB (SIGNATURE) DATE/TIME 8/24/06 1120	RECEIVED BY LAB (SIGNATURE) DATE/TIME

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

**AMERICAN ANALYTICAL LABORATORIES, LLC**

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

**DATA REPORTING QUALIFIERS**

For reporting results, the following "Results Qualifiers" are used:

<b>Value</b>	If the result is greater than or equal to the detection limit, report the value
<b>U</b>	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
<b>J</b>	Indicates an estimated value. The flag is used: <ol style="list-style-type: none"><li>(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)</li><li>(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.</li></ol>
<b>B</b>	Indicates the analyte was found in the blank as well as the sample report "10B".
<b>E</b>	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
<b>D</b>	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
<b>P</b>	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
<b>N</b>	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
<b>H</b>	Indicates sample was received and/or analyzed outside of The method allowable holding time

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608259  
**Project:** Rowe Industries  
**Lab ID:** 0608259-01A

**Client Sample ID:** WQ082406:930 NP2-6  
**Tag Number:** 11008  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
1,1,1-Trichloroethane	5.8	1.0		µg/L	1	8/29/2006 2:29:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
2-Butanone	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
2-Hexanone	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Acetone	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Benzene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Bromobenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Bromochloromethane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Bromodichloromethane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Bromoform	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Bromomethane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Carbon disulfide	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Chlorobenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608259  
**Project:** Rowe Industries  
**Lab ID:** 0608259-01A

**Client Sample ID:** WQ082406:930 NP2-6  
**Tag Number:** 11008  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Chloroform	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Chloromethane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Dibromochloromethane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Dibromomethane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Ethylbenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Isopropylbenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
m,p-Xylene	U	2.0		µg/L	1	8/29/2006 2:29:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Methylene chloride	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Naphthalene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
n-Butylbenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
n-Propylbenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
o-Xylene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Styrene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Tetrachloroethene	13	1.0		µg/L	1	8/29/2006 2:29:00 PM
Toluene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Trichloroethene	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Vinyl acetate	U	1.0		µg/L	1	8/29/2006 2:29:00 PM
Vinyl chloride	U	1.0		µg/L	1	8/29/2006 2:29:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ082406:930 NP2-6
<b>Lab Order:</b>	0608259	<b>Tag Number:</b>	11008
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/24/2006
<b>Lab ID:</b>	0608259-01B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	2.11	E200.7 0.0200		SW3010A mg/L	1	Analyst: JP 8/30/2006 1:12:14 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ082406:930 NP2-6
<b>Lab Order:</b>	0608259	<b>Tag Number:</b>	11008
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/24/2006
<b>Lab ID:</b>	0608259-01C	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: JP
Iron	0.0580	0.0200		mg/L	1	8/30/2006 1:09:22 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

# American Analytical Laboratories, LLC.

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608259  
**Project:** Rowe Industries  
**Lab ID:** 0608259-02A

**Client Sample ID:** WQ082406:935 NP2-7  
**Tag Number:** 11008  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		<b>Analyst: LDS</b>
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
2-Butanone	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
2-Hexanone	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Acetone	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Benzene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Bromobenzene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Bromochloromethane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Bromodichloromethane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Bromoform	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Bromomethane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Carbon disulfide	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Chlorobenzene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608259  
**Project:** Rowe Industries  
**Lab ID:** 0608259-02A

**Client Sample ID:** WQ082406:935 NP2-7  
**Tag Number:** 11008  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Chloroform	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Chloromethane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Dibromochloromethane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Dibromomethane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Ethylbenzene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Isopropylbenzene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
m,p-Xylene	U	2.0		µg/L	1	8/29/2006 3:11:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Methylene chloride	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Naphthalene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
n-Butylbenzene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
n-Propylbenzene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
o-Xylene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Styrene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Tetrachloroethene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Toluene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Trichloroethene	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Vinyl acetate	U	1.0		µg/L	1	8/29/2006 3:11:00 PM
Vinyl chloride	U	1.0		µg/L	1	8/29/2006 3:11:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ082406:935 NP2-7
<b>Lab Order:</b>	0608259	<b>Tag Number:</b>	11008
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/24/2006
<b>Lab ID:</b>	0608259-02B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	1.21	0.0200		mg/L	1	8/30/2006 1:19:16 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ082406:935 NP2-7
<b>Lab Order:</b>	0608259	<b>Tag Number:</b>	11008
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/24/2006
<b>Lab ID:</b>	0608259-02C	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON Iron	0.194	E200.7 0.0200		SW3005A mg/L	1	Analyst: JP 8/30/2006 1:16:14 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608259  
**Project:** Rowe Industries  
**Lab ID:** 0608259-03A

**Client Sample ID:** WQ082406:940 NP2-10  
**Tag Number:** 11008  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
2-Butanone	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
2-Hexanone	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Acetone	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Benzene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Bromobenzene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Bromochloromethane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Bromodichloromethane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Bromoform	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Bromomethane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Carbon disulfide	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Chlorobenzene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608259  
**Project:** Rowe Industries  
**Lab ID:** 0608259-03A

**Client Sample ID:** WQ082406:940 NP2-10  
**Tag Number:** 11008  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>						
		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Chloroform	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Chloromethane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Dibromochloromethane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Dibromomethane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Ethylbenzene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Isopropylbenzene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
m,p-Xylene	U	2.0		µg/L	1	8/29/2006 3:54:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Methylene chloride	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Naphthalene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
n-Butylbenzene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
n-Propylbenzene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
o-Xylene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Styrene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Tetrachloroethene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Toluene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Trichloroethene	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Vinyl acetate	U	1.0		µg/L	1	8/29/2006 3:54:00 PM
Vinyl chloride	U	1.0		µg/L	1	8/29/2006 3:54:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ082406:940 NP2-10
<b>Lab Order:</b>	0608259	<b>Tag Number:</b>	11008
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/24/2006
<b>Lab ID:</b>	0608259-03B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: JP
Iron	1.26	0.0200		mg/L	1	8/30/2006 1:23:50 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

<b>CLIENT:</b> Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b> WQ082406:940 NP2-10
<b>Lab Order:</b> 0608259	<b>Tag Number:</b> 11008
<b>Project:</b> Rowe Industries	<b>Collection Date:</b> 8/24/2006
<b>Lab ID:</b> 0608259-03C	<b>Matrix:</b> LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON</b>		<b>E200.7</b>		<b>SW3005A</b>		
Iron	0.211	0.0200		mg/L	1	Analyst: JP 8/30/2006 1:21:23 PM
<b>TOTAL DISSOLVED SOLIDS</b>		<b>E160.1</b>				
Total Dissolved Solids (Residue, Filterable)	126	1.00		mg/L	1	Analyst: JC 8/25/2006

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



NYSDOH 11418  
NJDEP NY050  
CTDOH PH-0205  
PADEP 68-00573

Wednesday, September 06, 2

Mark Goldberg  
Leggette Brashears & Graham Inc.  
4 Research Drive  
Suite 301  
Shelton, CT 06484

TEL: (203) 929-8555  
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0608306

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 8/30/2006 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at [lbeyer@american-analytical.com](mailto:lbeyer@american-analytical.com).

Sincerely,

Lori Beyer  
Lab Director

**CLIENT:** Leggette Brashears & Graham Inc.  
**Project:** Rowe Industries  
**Lab Order:** 0608306

**Work Order Sample Summary**

<b>Lab Sample ID</b>	<b>Client Sample ID</b>	<b>Tag Number</b>	<b>Date Collected</b>	<b>Date Received</b>
0608306-01A	WQ082806:1030 NP2-6	11009	8/28/2006	8/30/2006
0608306-01B	WQ082806:1030 NP2-6	11009	8/28/2006	8/30/2006
0608306-01C	WQ082806:1030 NP2-6	11009	8/28/2006	8/30/2006
0608306-02A	WQ082806:1035 NP2-7	11009	8/28/2006	8/30/2006
0608306-02B	WQ082806:1035 NP2-7	11009	8/28/2006	8/30/2006
0608306-02C	WQ082806:1035 NP2-7	11009	8/28/2006	8/30/2006
0608306-03A	WQ082806:1040 NP2-10	11009	8/28/2006	8/30/2006
0608306-03B	WQ082806:1040 NP2-10	11009	8/28/2006	8/30/2006
0608306-03C	WQ082806:1040 NP2-10	11009	8/28/2006	8/30/2006



**AMERICAN ANALYTICAL LABORATORIES, LLC**

**56 TOLEDO STREET**

**FARMINGDALE, NEW YORK 11735**

**TELEPHONE: (631) 454-6100      FAX: (631) 454-8027**

**DATA REPORTING QUALIFIERS**

For reporting results, the following "Results Qualifiers" are used:

<b>Value</b>	If the result is greater than or equal to the detection limit, report the value
<b>U</b>	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
<b>J</b>	Indicates an estimated value. The flag is used: <ol style="list-style-type: none"><li>(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)</li><li>(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.</li></ol>
<b>B</b>	Indicates the analyte was found in the blank as well as the sample report "10B".
<b>E</b>	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
<b>D</b>	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
<b>P</b>	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
<b>N</b>	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
<b>H</b>	Indicates sample was received and/or analyzed outside of The method allowable holding time

**American Analytical Laboratories, LLC.**

Date: 06-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608306  
**Project:** Rowe Industries  
**Lab ID:** 0608306-01A

**Client Sample ID:** WQ082806:1030 NP2-6  
**Tag Number:** 11009  
**Collection Date:** 8/28/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>						Analyst: <b>LDS</b>
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
1,1,1-Trichloroethane	24	1.0		µg/L	1	8/31/2006 10:31:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
2-Butanone	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
2-Hexanone	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Acetone	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Benzene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Bromobenzene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Bromochloromethane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Bromodichloromethane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Bromoform	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Bromomethane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Carbon disulfide	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Chlorobenzene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM

**Qualifiers:**  
 B Analyte detected in the associated Method Blank  
 H Holding times for preparation or analysis exceeded  
 ND Not Detected at the Reporting Limit  
 U Indicates the compound was analyzed for but not detecte

E Value above quantitation range  
 J Analyte detected below quantitation limits  
 S Spike Recovery outside accepted recovery limits  
 X Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 06-Sep-06

<b>CLIENT:</b> Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b> WQ082806:1030 NP2-6
<b>Lab Order:</b> 0608306	<b>Tag Number:</b> 11009
<b>Project:</b> Rowe Industries	<b>Collection Date:</b> 8/28/2006
<b>Lab ID:</b> 0608306-01A	<b>Matrix:</b> LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: <b>LDS</b>
Chloroethane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Chloroform	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Chloromethane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Dibromochloromethane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Dibromomethane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Ethylbenzene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Isopropylbenzene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
m,p-Xylene	U	2.0		µg/L	1	8/31/2006 10:31:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Methylene chloride	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Naphthalene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
n-Butylbenzene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
n-Propylbenzene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
o-Xylene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Styrene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Tetrachloroethene	9.5	1.0		µg/L	1	8/31/2006 10:31:00 PM
Toluene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Trichloroethene	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Vinyl acetate	U	1.0		µg/L	1	8/31/2006 10:31:00 PM
Vinyl chloride	U	1.0		µg/L	1	8/31/2006 10:31:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 06-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ082806:1030 NP2-6
<b>Lab Order:</b>	0608306	<b>Tag Number:</b>	11009
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/28/2006
<b>Lab ID:</b>	0608306-01B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: <b>JP</b>
Iron	3.04	0.0200		mg/L	1	8/30/2006 1:38:02 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



**American Analytical Laboratories, LLC.**

Date: 06-Sep-06

---

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ082806:1030 NP2-6
<b>Lab Order:</b>	0608306	<b>Tag Number:</b>	11009
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/28/2006
<b>Lab ID:</b>	0608306-01C	<b>Matrix:</b>	LIQUID

---

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: <b>JP</b>
Iron	0.397	0.0200		mg/L	1	8/30/2006 1:35:56 PM

---

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 06-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ082806:1035 NP2-7
<b>Lab Order:</b>	0608306	<b>Tag Number:</b>	11009
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/28/2006
<b>Lab ID:</b>	0608306-02A	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: <b>LDS</b>
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
2-Butanone	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
2-Hexanone	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Acetone	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Benzene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Bromobenzene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Bromochloromethane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Bromodichloromethane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Bromoform	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Bromomethane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Carbon disulfide	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Chlorobenzene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 06-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608306  
**Project:** Rowe Industries  
**Lab ID:** 0608306-02A

**Client Sample ID:** WQ082806:1035 NP2-7  
**Tag Number:** 11009  
**Collection Date:** 8/28/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: <b>LDS</b>
Chloroethane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Chloroform	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Chloromethane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Dibromochloromethane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Dibromomethane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Ethylbenzene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Isopropylbenzene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
m,p-Xylene	U	2.0		µg/L	1	8/31/2006 11:15:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Methylene chloride	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Naphthalene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
n-Butylbenzene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
n-Propylbenzene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
o-Xylene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Styrene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Tetrachloroethene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Toluene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Trichloroethene	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Vinyl acetate	U	1.0		µg/L	1	8/31/2006 11:15:00 PM
Vinyl chloride	U	1.0		µg/L	1	8/31/2006 11:15:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 06-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ082806:1035 NP2-7
<b>Lab Order:</b>	0608306	<b>Tag Number:</b>	11009
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/28/2006
<b>Lab ID:</b>	0608306-02B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: <b>JP</b>
Iron	1.28	0.0200		mg/L	1	8/30/2006 1:46:40 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 06-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ082806:1035 NP2-7
<b>Lab Order:</b>	0608306	<b>Tag Number:</b>	11009
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/28/2006
<b>Lab ID:</b>	0608306-02C	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: JP
Iron	0.251	0.0200		mg/L	1	8/30/2006 1:44:45 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

# American Analytical Laboratories, LLC.

Date: 06-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ082806:1040 NP2-10
<b>Lab Order:</b>	0608306	<b>Tag Number:</b>	11009
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/28/2006
<b>Lab ID:</b>	0608306-03A	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: <b>LDS</b>
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	9/1/2006
1,1,1-Trichloroethane	U	1.0		µg/L	1	9/1/2006
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	9/1/2006
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	9/1/2006
1,1,2-Trichloroethane	U	1.0		µg/L	1	9/1/2006
1,1-Dichloroethane	U	1.0		µg/L	1	9/1/2006
1,1-Dichloroethene	U	1.0		µg/L	1	9/1/2006
1,1-Dichloropropene	U	1.0		µg/L	1	9/1/2006
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	9/1/2006
1,2,3-Trichloropropane	U	1.0		µg/L	1	9/1/2006
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	9/1/2006
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	9/1/2006
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	9/1/2006
1,2-Dibromoethane	U	1.0		µg/L	1	9/1/2006
1,2-Dichlorobenzene	U	1.0		µg/L	1	9/1/2006
1,2-Dichloroethane	U	1.0		µg/L	1	9/1/2006
1,2-Dichloropropane	U	1.0		µg/L	1	9/1/2006
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	9/1/2006
1,3-Dichlorobenzene	U	1.0		µg/L	1	9/1/2006
1,3-dichloropropane	U	1.0		µg/L	1	9/1/2006
1,4-Dichlorobenzene	U	1.0		µg/L	1	9/1/2006
2,2-Dichloropropane	U	1.0		µg/L	1	9/1/2006
2-Butanone	U	1.0		µg/L	1	9/1/2006
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	9/1/2006
2-Chlorotoluene	U	1.0		µg/L	1	9/1/2006
2-Hexanone	U	1.0		µg/L	1	9/1/2006
4-Chlorotoluene	U	1.0		µg/L	1	9/1/2006
4-Isopropyltoluene	U	1.0		µg/L	1	9/1/2006
4-Methyl-2-pentanone	U	1.0		µg/L	1	9/1/2006
Acetone	U	1.0		µg/L	1	9/1/2006
Benzene	U	1.0		µg/L	1	9/1/2006
Bromobenzene	U	1.0		µg/L	1	9/1/2006
Bromochloromethane	U	1.0		µg/L	1	9/1/2006
Bromodichloromethane	U	1.0		µg/L	1	9/1/2006
Bromoform	U	1.0		µg/L	1	9/1/2006
Bromomethane	U	1.0		µg/L	1	9/1/2006
Carbon disulfide	U	1.0		µg/L	1	9/1/2006
Carbon tetrachloride	U	1.0		µg/L	1	9/1/2006
Chlorobenzene	U	1.0		µg/L	1	9/1/2006

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 06-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608306  
**Project:** Rowe Industries  
**Lab ID:** 0608306-03A

**Client Sample ID:** WQ082806:1040 NP2-10  
**Tag Number:** 11009  
**Collection Date:** 8/28/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>						Analyst: LDS
		<b>SW8260B</b>		<b>SW5030A</b>		
Chloroethane	U	1.0		µg/L	1	9/1/2006
Chloroform	U	1.0		µg/L	1	9/1/2006
Chloromethane	U	1.0		µg/L	1	9/1/2006
cis-1,2-Dichloroethene	U	1.0		µg/L	1	9/1/2006
cis-1,3-Dichloropropene	U	1.0		µg/L	1	9/1/2006
Dibromochloromethane	U	1.0		µg/L	1	9/1/2006
Dibromomethane	U	1.0		µg/L	1	9/1/2006
Dichlorodifluoromethane	U	1.0		µg/L	1	9/1/2006
Ethylbenzene	U	1.0		µg/L	1	9/1/2006
Hexachlorobutadiene	U	1.0		µg/L	1	9/1/2006
Isopropylbenzene	U	1.0		µg/L	1	9/1/2006
m,p-Xylene	U	2.0		µg/L	1	9/1/2006
Methyl tert-butyl ether	U	1.0		µg/L	1	9/1/2006
Methylene chloride	U	1.0		µg/L	1	9/1/2006
Naphthalene	U	1.0		µg/L	1	9/1/2006
n-Butylbenzene	U	1.0		µg/L	1	9/1/2006
n-Propylbenzene	U	1.0		µg/L	1	9/1/2006
o-Xylene	U	1.0		µg/L	1	9/1/2006
sec-Butylbenzene	U	1.0		µg/L	1	9/1/2006
Styrene	U	1.0		µg/L	1	9/1/2006
tert-Butylbenzene	U	1.0		µg/L	1	9/1/2006
Tetrachloroethene	U	1.0		µg/L	1	9/1/2006
Toluene	U	1.0		µg/L	1	9/1/2006
trans-1,2-Dichloroethene	U	1.0		µg/L	1	9/1/2006
trans-1,3-Dichloropropene	U	1.0		µg/L	1	9/1/2006
Trichloroethene	U	1.0		µg/L	1	9/1/2006
Trichlorofluoromethane	U	1.0		µg/L	1	9/1/2006
Vinyl acetate	U	1.0		µg/L	1	9/1/2006
Vinyl chloride	U	1.0		µg/L	1	9/1/2006

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 06-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ082806:1040 NP2-10
<b>Lab Order:</b>	0608306	<b>Tag Number:</b>	11009
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/28/2006
<b>Lab ID:</b>	0608306-03B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: JP
Iron	1.88	0.0200		mg/L	1	8/30/2006 1:51:37 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



**American Analytical Laboratories, LLC.**

Date: 06-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ082806:1040 NP2-10
<b>Lab Order:</b>	0608306	<b>Tag Number:</b>	11009
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/28/2006
<b>Lab ID:</b>	0608306-03C	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: <b>JP</b>
Iron	0.312	0.0200		mg/L	1	8/30/2006 1:48:54 PM
<b>TOTAL DISSOLVED SOLIDS</b>		<b>E160.1</b>				Analyst: <b>JC</b>
Total Dissolved Solids (Residue, Filterable)	142	1.00		mg/L	1	9/1/2006

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

Friday, September 01, 2006

Mark Goldberg  
Leggette Brashears & Graham Inc.  
4 Research Drive  
Suite 301  
Shelton, CT 06484

TEL: (203) 929-8555  
FAX (203) 926-9140

RE: Rowe Industries

Dear Mark Goldberg:

Order No.: 0608262

American Analytical Laboratories, LLC. received 7 sample(s) on 8/24/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at [lbeyer@american-analytical.com](mailto:lbeyer@american-analytical.com).

Sincerely,

  
Lori Beyer  
Lab Director

**CLIENT:** Leggette Brashears & Graham Inc.  
**Project:** Rowe Industries  
**Lab Order:** 0608262

**Work Order Sample Summary**

<b>Lab Sample ID</b>	<b>Client Sample ID</b>	<b>Tag Number</b>	<b>Date Collected</b>	<b>Date Received</b>
0608262-01A	GWQ082406:800 NP1-1-2	11007	8/24/2006	8/24/2006
0608262-01B	GWQ082406:800 NP1-1-2	11007	8/24/2006	8/24/2006
0608262-01C	GWQ082406:800 NP1-1-2	11007	8/24/2006	8/24/2006
0608262-01D	GWQ082406:800 NP1-1-2	11007	8/24/2006	8/24/2006
0608262-02A	GWQ082406:810 NP1-1-4	11007	8/24/2006	8/24/2006
0608262-02B	GWQ082406:810 NP1-1-4	11007	8/24/2006	8/24/2006
0608262-02C	GWQ082406:810 NP1-1-4	11007	8/24/2006	8/24/2006
0608262-02D	GWQ082406:810 NP1-1-4	11007	8/24/2006	8/24/2006
0608262-03A	GWQ082406:820 NP1-1-5	11007	8/24/2006	8/24/2006
0608262-03B	GWQ082406:820 NP1-1-5	11007	8/24/2006	8/24/2006
0608262-03C	GWQ082406:820 NP1-1-5	11007	8/24/2006	8/24/2006
0608262-03D	GWQ082406:820 NP1-1-5	11007	8/24/2006	8/24/2006
0608262-04A	GWQ082406:830 NP1-1-6	11007	8/24/2006	8/24/2006
0608262-04B	GWQ082406:830 NP1-1-6	11007	8/24/2006	8/24/2006
0608262-04C	GWQ082406:830 NP1-1-6	11007	8/24/2006	8/24/2006
0608262-04D	GWQ082406:830 NP1-1-6	11007	8/24/2006	8/24/2006
0608262-05A	GWQ082406:840 NP1-1-7	11007	8/24/2006	8/24/2006
0608262-05B	GWQ082406:840 NP1-1-7	11007	8/24/2006	8/24/2006
0608262-05C	GWQ082406:840 NP1-1-7	11007	8/24/2006	8/24/2006
0608262-05D	GWQ082406:840 NP1-1-7	11007	8/24/2006	8/24/2006
0608262-06A	GWQ082406:850 NP1-1-8	11007	8/24/2006	8/24/2006
0608262-06B	GWQ082406:850 NP1-1-8	11007	8/24/2006	8/24/2006
0608262-06C	GWQ082406:850 NP1-1-8	11007	8/24/2006	8/24/2006
0608262-06D	GWQ082406:850 NP1-1-8	11007	8/24/2006	8/24/2006
0608262-07A	GWQ082406:900 NP1-1-9	11007	8/24/2006	8/24/2006
0608262-07B	GWQ082406:900 NP1-1-9	11007	8/24/2006	8/24/2006
0608262-07C	GWQ082406:900 NP1-1-9	11007	8/24/2006	8/24/2006
0608262-07D	GWQ082406:900 NP1-1-9	11007	8/24/2006	8/24/2006



**AMERICAN ANALYTICAL LABORATORIES, LLC**

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

**DATA REPORTING QUALIFIERS**

For reporting results, the following "Results Qualifiers" are used:

<b>Value</b>	If the result is greater than or equal to the detection limit, report the value
<b>U</b>	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
<b>J</b>	Indicates an estimated value. The flag is used: <ol style="list-style-type: none"><li>(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)</li><li>(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.</li></ol>
<b>B</b>	Indicates the analyte was found in the blank as well as the sample report "10B".
<b>E</b>	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
<b>D</b>	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
<b>P</b>	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
<b>N</b>	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
<b>H</b>	Indicates sample was received and/or analyzed outside of The method allowable holding time

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-01A

**Client Sample ID:** GWQ082406:800 NP1-1-2  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		<b>Analyst: LDS</b>
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
1,1,1-Trichloroethane	25	1.0		µg/L	1	8/29/2006 10:54:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
2-Butanone	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
2-Hexanone	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Acetone	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Benzene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Bromobenzene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Bromochloromethane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Bromodichloromethane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Bromoform	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Bromomethane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Carbon disulfide	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Chlorobenzene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

<b>CLIENT:</b> Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b> GWQ082406:800 NP1-1-2
<b>Lab Order:</b> 0608262	<b>Tag Number:</b> 11007
<b>Project:</b> Rowe Industries	<b>Collection Date:</b> 8/24/2006
<b>Lab ID:</b> 0608262-01A	<b>Matrix:</b> LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Chloroform	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Chloromethane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
cis-1,2-Dichloroethene	5.7	1.0		µg/L	1	8/29/2006 10:54:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Dibromochloromethane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Dibromomethane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Ethylbenzene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Isopropylbenzene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
m,p-Xylene	U	2.0		µg/L	1	8/29/2006 10:54:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Methylene chloride	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Naphthalene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
n-Butylbenzene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
n-Propylbenzene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
o-Xylene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Styrene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Tetrachloroethene	11	1.0		µg/L	1	8/29/2006 10:54:00 AM
Toluene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Trichloroethene	1.1	1.0		µg/L	1	8/29/2006 10:54:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Vinyl acetate	U	1.0		µg/L	1	8/29/2006 10:54:00 AM
Vinyl chloride	U	1.0		µg/L	1	8/29/2006 10:54:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detect	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ082406:800 NP1-1-2
<b>Lab Order:</b>	0608262	<b>Tag Number:</b>	11007
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/24/2006
<b>Lab ID:</b>	0608262-01B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: JP
Iron	4.14	0.0200		mg/L	1	8/30/2006 12:22:22 PM
Manganese	0.647	0.0200		mg/L	1	8/30/2006 12:22:22 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level



**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-01C

**Client Sample ID:** GWQ082406:800 NP1-1-2  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: JP
Iron	0.0172	0.0200	J	mg/L	1	8/30/2006 12:20:20 PM
Manganese	0.720	0.0200		mg/L	1	8/30/2006 12:20:20 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ082406:800 NP1-1-2
<b>Lab Order:</b>	0608262	<b>Tag Number:</b>	11007
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/24/2006
<b>Lab ID:</b>	0608262-01D	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>HARDNESS</b> Hardness, Calcium/Magnesium (As CaCO3)	38.1	<b>M2340 B</b> 1.00		mg/L	1	Analyst: JP 8/30/2006
<b>TURBIDITY</b> Turbidity	7.20	<b>E180.1</b> 1.00		NTU	1	Analyst: KK 8/24/2006
<b>TOTAL DISSOLVED SOLIDS</b> Total Dissolved Solids (Residue, Filterable)	106	<b>E160.1</b> 1.00		mg/L	1	Analyst: JC 8/25/2006

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-02A

**Client Sample ID:** GWQ082406:810 NP1-1-4  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		<b>Analyst: LDS</b>
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
2-Butanone	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
2-Hexanone	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Acetone	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Benzene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Bromobenzene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Bromochloromethane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Bromodichloromethane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Bromoform	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Bromomethane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Carbon disulfide	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Chlorobenzene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-02A

**Client Sample ID:** GWQ082406:810 NP1-1-4  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Chloroform	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Chloromethane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Dibromochloromethane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Dibromomethane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Ethylbenzene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Isopropylbenzene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
m,p-Xylene	U	2.0		µg/L	1	8/29/2006 11:36:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Methylene chloride	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Naphthalene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
n-Butylbenzene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
n-Propylbenzene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
o-Xylene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Styrene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Tetrachloroethene	23	1.0		µg/L	1	8/29/2006 11:36:00 AM
Toluene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Trichloroethene	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Vinyl acetate	U	1.0		µg/L	1	8/29/2006 11:36:00 AM
Vinyl chloride	U	1.0		µg/L	1	8/29/2006 11:36:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

**Date:** 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-02B

**Client Sample ID:** GWQ082406:810 NP1-1-4  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: <b>JP</b>
Iron	8.60	0.0200		mg/L	1	8/30/2006 12:29:50 PM
Manganese	1.31	0.0200		mg/L	1	8/30/2006 12:29:50 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ082406:810 NP1-1-4
<b>Lab Order:</b>	0608262	<b>Tag Number:</b>	11007
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/24/2006
<b>Lab ID:</b>	0608262-02C	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: <b>JP</b>
Iron	U	0.0200		mg/L	1	8/30/2006 12:27:11 PM
Manganese	1.45	0.0200		mg/L	1	8/30/2006 12:27:11 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ082406:810 NP1-1-4
<b>Lab Order:</b>	0608262	<b>Tag Number:</b>	11007
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/24/2006
<b>Lab ID:</b>	0608262-02D	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>HARDNESS</b> Hardness, Calcium/Magnesium (As CaCO3)	37.2	<b>M2340 B</b> 1.00		mg/L	1	Analyst: JP 8/30/2006
<b>TURBIDITY</b> Turbidity	8.70	<b>E180.1</b> 1.00		NTU	1	Analyst: KK 8/24/2006
<b>TOTAL DISSOLVED SOLIDS</b> Total Dissolved Solids (Residue, Filterable)	126	<b>E160.1</b> 1.00		mg/L	1	Analyst: JC 8/25/2006

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-03A

**Client Sample ID:** GWQ082406:820 NP1-1-5  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		<b>Analyst: LDS</b>
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
2-Butanone	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
2-Hexanone	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Acetone	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Benzene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Bromobenzene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Bromochloromethane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Bromodichloromethane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Bromoform	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Bromomethane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Carbon disulfide	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Chlorobenzene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM

**Qualifiers:** B Analyte detected in the associated Method Blank E Value above quantitation range  
H Holding times for preparation or analysis exceeded J Analyte detected below quantitation limits  
ND Not Detected at the Reporting Limit S Spike Recovery outside accepted recovery limits  
U Indicates the compound was analyzed for but not detected X Value exceeds Maximum Contaminant Level



**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-03A

**Client Sample ID:** GWQ082406:820 NP1-1-5  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		<b>Analyst: LDS</b>
Chloroethane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Chloroform	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Chloromethane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Dibromochloromethane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Dibromomethane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Ethylbenzene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Isopropylbenzene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
m,p-Xylene	U	2.0		µg/L	1	8/29/2006 12:19:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Methylene chloride	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Naphthalene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
n-Butylbenzene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
n-Propylbenzene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
o-Xylene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Styrene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Tetrachloroethene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Toluene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Trichloroethene	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Vinyl acetate	U	1.0		µg/L	1	8/29/2006 12:19:00 PM
Vinyl chloride	U	1.0		µg/L	1	8/29/2006 12:19:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

**Date:** 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-03B

**Client Sample ID:** GWQ082406:820 NP1-1-5  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: JP
Iron	2.09	0.0200		mg/L	1	8/30/2006 12:35:06 PM
Manganese	0.0151	0.0200	J	mg/L	1	8/30/2006 12:35:06 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ082406:820 NP1-1-5
<b>Lab Order:</b>	0608262	<b>Tag Number:</b>	11007
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/24/2006
<b>Lab ID:</b>	0608262-03C	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: JP
Iron	0.0116	0.0200	J	mg/L	1	8/30/2006 12:32:48 PM
Manganese	0.00610	0.0200	J	mg/L	1	8/30/2006 12:32:48 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ082406:820 NP1-1-5
<b>Lab Order:</b>	0608262	<b>Tag Number:</b>	11007
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/24/2006
<b>Lab ID:</b>	0608262-03D	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>HARDNESS</b>		<b>M2340 B</b>				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	36.3	1.00		mg/L	1	8/30/2006
<b>TURBIDITY</b>		<b>E180.1</b>				Analyst: KK
Turbidity	4.00	1.00		NTU	1	8/24/2006
<b>TOTAL DISSOLVED SOLIDS</b>		<b>E160.1</b>				Analyst: JC
Total Dissolved Solids (Residue, Filterable)	128	1.00		mg/L	1	8/25/2006

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-04A

**Client Sample ID:** GWQ082406:830 NP1-1-6  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
1,1,1-Trichloroethane	22	1.0		µg/L	1	8/29/2006 1:02:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
2-Butanone	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
2-Hexanone	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Acetone	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Benzene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Bromobenzene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Bromochloromethane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Bromodichloromethane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Bromoform	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Bromomethane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Carbon disulfide	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Chlorobenzene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM

**Qualifiers:** B Analyte detected in the associated Method Blank E Value above quantitation range  
H Holding times for preparation or analysis exceeded J Analyte detected below quantitation limits  
ND Not Detected at the Reporting Limit S Spike Recovery outside accepted recovery limits  
U Indicates the compound was analyzed for but not detected X Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-04A

**Client Sample ID:** GWQ082406:830 NP1-1-6  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Chloroform	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Chloromethane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Dibromochloromethane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Dibromomethane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Ethylbenzene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Isopropylbenzene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
m,p-Xylene	U	2.0		µg/L	1	8/29/2006 1:02:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Methylene chloride	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Naphthalene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
n-Butylbenzene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
n-Propylbenzene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
o-Xylene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Styrene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Tetrachloroethene	30	1.0		µg/L	1	8/29/2006 1:02:00 PM
Toluene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Trichloroethene	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Vinyl acetate	U	1.0		µg/L	1	8/29/2006 1:02:00 PM
Vinyl chloride	U	1.0		µg/L	1	8/29/2006 1:02:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ082406:830 NP1-1-6
<b>Lab Order:</b>	0608262	<b>Tag Number:</b>	11007
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/24/2006
<b>Lab ID:</b>	0608262-04B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: JP
Iron	5.36	0.0200		mg/L	1	8/30/2006 12:39:29 PM
Manganese	0.198	0.0200		mg/L	1	8/30/2006 12:39:29 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

**Date:** 01-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ082406:830 NP1-1-6
<b>Lab Order:</b>	0608262	<b>Tag Number:</b>	11007
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/24/2006
<b>Lab ID:</b>	0608262-04C	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3005A</b>		<b>Analyst: JP</b>
Iron	0.0563	0.0200		mg/L	1	8/30/2006 12:37:34 PM
Manganese	0.214	0.0200		mg/L	1	8/30/2006 12:37:34 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ082406:830 NP1-1-6
<b>Lab Order:</b>	0608262	<b>Tag Number:</b>	11007
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/24/2006
<b>Lab ID:</b>	0608262-04D	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>HARDNESS</b> Hardness, Calcium/Magnesium (As CaCO3)	35.7	M2340 B 1.00		mg/L	1	Analyst: JP 8/30/2006
<b>TURBIDITY</b> Turbidity	7.10	E180.1 1.00		NTU	1	Analyst: KK 8/24/2006
<b>TOTAL DISSOLVED SOLIDS</b> Total Dissolved Solids (Residue, Filterable)	136	E160.1 1.00		mg/L	1	Analyst: JC 8/25/2006

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-05A

**Client Sample ID:** GWQ082406:840 NP1-1-7  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
1,1,1-Trichloroethane	7.9	1.0		µg/L	1	8/29/2006 1:46:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
2-Butanone	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
2-Hexanone	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Acetone	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Benzene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Bromobenzene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Bromochloromethane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Bromodichloromethane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Bromoform	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Bromomethane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Carbon disulfide	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Chlorobenzene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-05A

**Client Sample ID:** GWQ082406:840 NP1-1-7  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Chloroform	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Chloromethane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Dibromochloromethane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Dibromomethane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Ethylbenzene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Isopropylbenzene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
m,p-Xylene	U	2.0		µg/L	1	8/29/2006 1:46:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Methylene chloride	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Naphthalene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
n-Butylbenzene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
n-Propylbenzene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
o-Xylene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Styrene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Tetrachloroethene	39	1.0		µg/L	1	8/29/2006 1:46:00 PM
Toluene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Trichloroethene	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Vinyl acetate	U	1.0		µg/L	1	8/29/2006 1:46:00 PM
Vinyl chloride	U	1.0		µg/L	1	8/29/2006 1:46:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-05B

**Client Sample ID:** GWQ082406:840 NP1-1-7  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: JP
Iron	0.307	0.0200		mg/L	1	8/30/2006 12:44:24 PM
Manganese	0.0806	0.0200		mg/L	1	8/30/2006 12:44:24 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ082406:840 NP1-1-7
<b>Lab Order:</b>	0608262	<b>Tag Number:</b>	11007
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/24/2006
<b>Lab ID:</b>	0608262-05C	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: JP
Iron	0.0593	0.0200		mg/L	1	8/30/2006 12:41:41 PM
Manganese	0.0820	0.0200		mg/L	1	8/30/2006 12:41:41 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-05D

**Client Sample ID:** GWQ082406:840 NP1-1-7  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>HARDNESS</b>		<b>M2340 B</b>				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	32.9	1.00		mg/L	1	8/30/2006
<b>TURBIDITY</b>		<b>E180.1</b>				Analyst: KK
Turbidity	U	1.00		NTU	1	8/24/2006
<b>TOTAL DISSOLVED SOLIDS</b>		<b>E160.1</b>				Analyst: JC
Total Dissolved Solids (Residue, Filterable)	120	1.00		mg/L	1	8/25/2006

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-06A

**Client Sample ID:** GWQ082406:850 NP1-1-8  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
1,1,1-Trichloroethane	3.2	1.0		µg/L	1	8/29/2006 5:00:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
2-Butanone	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
2-Hexanone	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Acetone	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Benzene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Bromobenzene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Bromochloromethane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Bromodichloromethane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Bromoform	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Bromomethane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Carbon disulfide	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Chlorobenzene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-06A

**Client Sample ID:** GWQ082406:850 NP1-1-8  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Chloroform	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Chloromethane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Dibromochloromethane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Dibromomethane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Ethylbenzene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Isopropylbenzene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
m,p-Xylene	U	2.0		µg/L	1	8/29/2006 5:00:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Methylene chloride	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Naphthalene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
n-Butylbenzene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
n-Propylbenzene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
o-Xylene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Styrene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Tetrachloroethene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Toluene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Trichloroethene	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Vinyl acetate	U	1.0		µg/L	1	8/29/2006 5:00:00 AM
Vinyl chloride	U	1.0		µg/L	1	8/29/2006 5:00:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ082406:850 NP1-1-8
<b>Lab Order:</b>	0608262	<b>Tag Number:</b>	11007
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/24/2006
<b>Lab ID:</b>	0608262-06B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: JP
Iron	5.98	0.0200		mg/L	1	8/30/2006 12:59:44 PM
Manganese	0.600	0.0200		mg/L	1	8/30/2006 12:59:44 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

**Date:** 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-06C

**Client Sample ID:** GWQ082406:850 NP1-1-8  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: JP
Iron	1.86	0.0200		mg/L	1	8/30/2006 12:57:45 PM
Manganese	0.631	0.0200		mg/L	1	8/30/2006 12:57:45 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ082406:850 NP1-1-8
<b>Lab Order:</b>	0608262	<b>Tag Number:</b>	11007
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/24/2006
<b>Lab ID:</b>	0608262-06D	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>HARDNESS</b>						Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	21.8	1.00	M2340 B	mg/L	1	8/30/2006
<b>TURBIDITY</b>						Analyst: KK
Turbidity	3.30	1.00	E180.1	NTU	1	8/24/2006
<b>TOTAL DISSOLVED SOLIDS</b>						Analyst: JC
Total Dissolved Solids (Residue, Filterable)	144	1.00	E160.1	mg/L	1	8/25/2006

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-07A

**Client Sample ID:** GWQ082406:900 NP1-1-9  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		<b>Analyst: LDS</b>
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
2-Butanone	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
2-Hexanone	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Acetone	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Benzene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Bromobenzene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Bromochloromethane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Bromodichloromethane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Bromofom	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Bromomethane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Carbon disulfide	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Chlorobenzene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-07A

**Client Sample ID:** GWQ082406:900 NP1-1-9  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Chloroform	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Chloromethane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Dibromochloromethane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Dibromomethane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Ethylbenzene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Isopropylbenzene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
m,p-Xylene	U	2.0		µg/L	1	8/29/2006 5:38:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Methylene chloride	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Naphthalene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
n-Butylbenzene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
n-Propylbenzene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
o-Xylene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Styrene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Tetrachloroethene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Toluene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Trichloroethene	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Vinyl acetate	U	1.0		µg/L	1	8/29/2006 5:38:00 AM
Vinyl chloride	U	1.0		µg/L	1	8/29/2006 5:38:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-07B

**Client Sample ID:** GWQ082406:900 NP1-1-9  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: JP
Iron	0.970	0.0200		mg/L	1	8/30/2006 1:05:18 PM
Manganese	0.828	0.0200		mg/L	1	8/30/2006 1:05:18 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0608262  
**Project:** Rowe Industries  
**Lab ID:** 0608262-07C

**Client Sample ID:** GWQ082406:900 NP1-1-9  
**Tag Number:** 11007  
**Collection Date:** 8/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: JP
Iron	0.0165	0.0200	J	mg/L	1	8/30/2006 1:03:20 PM
Manganese	0.892	0.0200		mg/L	1	8/30/2006 1:03:20 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 01-Sep-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ082406:900 NP1-1-9
<b>Lab Order:</b>	0608262	<b>Tag Number:</b>	11007
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	8/24/2006
<b>Lab ID:</b>	0608262-07D	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>HARDNESS</b>		<b>M2340 B</b>				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	20.7	1.00		mg/L	1	8/30/2006
<b>TURBIDITY</b>		<b>E180.1</b>				Analyst: KK
Turbidity	2.10	1.00		NTU	1	8/24/2006
<b>TOTAL DISSOLVED SOLIDS</b>		<b>E160.1</b>				Analyst: JC
Total Dissolved Solids (Residue, Filterable)	110	1.00		mg/L	1	8/25/2006

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level



**H6H250114 Analytical Report ..... 1**  
**Sample Receipt Documentation ..... 15**  
**Total Number of Pages ..... 17**



STL Knoxville  
5815 Middlebrook Pike  
Knoxville, TN 37921

Tel: 865 291 3000 Fax: 865 584 4315  
www.stl-inc.com

# ANALYTICAL REPORT

Rowe-NABSAG 0401

Lot #: H6H250114

Mark Goldberg

Leggette, Brashears & Graham,  
4 Research Drive  
Suite #301  
Shelton, CT 06484

SEVERN TRENT LABORATORIES, INC.

Scott A. Harris  
Project Manager

August 31, 2006

# ANALYTICAL METHODS SUMMARY

H6H250114

<u>PARAMETER</u>	<u>ANALYTICAL METHOD</u>
Volatile Organics by TO15	EPA-2 TO-15

## References:

EPA-2 "Compendium of Methods for the Determination of Toxic Organic Compounds in Ambient Air", EPA-625/R-96/010b, January 1999.

## SAMPLE SUMMARY

H6H250114

<u>WO #</u>	<u>SAMPLE#</u>	<u>CLIENT SAMPLE ID</u>	<u>SAMPLED DATE</u>	<u>SAMP TIME</u>
JC6AH	001	AQ082406:900 NP4-1	08/24/06	09:00
JC6AJ	002	AQ082406:902 NP4-2	08/24/06	09:02
JC6AL	003	AQ082406:904 NP4-3	08/24/06	09:04

**NOTE (S) :**

- The analytical results of the samples listed above are presented on the following pages.
- All calculations are performed before rounding to avoid round-off errors in calculated results.
- Results noted as "ND" were not detected at or above the stated limit.
- This report must not be reproduced, except in full, without the written approval of the laboratory.
- Results for the following parameters are never reported on a dry weight basis: color, corrosivity, density, flashpoint, ignitability, layers, odor, paint filter test, pH, porosity pressure, reactivity, redox potential, specific gravity, spot tests, solids, solubility, temperature, viscosity, and weight.

## **PROJECT NARRATIVE H6H250114**

The results reported herein are applicable to the samples submitted for analysis only.

This report shall not be reproduced except in full, without the written approval of the laboratory.

**The original chain of custody documentation is included with this report.**

### **Sample Receipt**

There were no problems with the condition of the samples received.

### **Quality Control**

Unless otherwise noted, all holding times and QC criteria were met and the test results shown in this report meet all applicable NELAC requirements.

The samples were received on 8/25/06 in Tedlar bags and analyzed within 72 hours of sampling.

STL Knoxville maintains the following certifications, approvals and accreditations: Arkansas DEQ Cert. #05-043-0, California DHS ELAP Cert. #2423, Colorado DPHE, Connecticut DPH Cert. #PH-0223, Florida DOH Cert. #E87177, Georgia DNR Cert. #906 (SDWA, expires 6/24/05), Hawaii DOH, Illinois EPA Cert. #000687, Indiana DOH Cert. #C-TN-02, Iowa DNR Cert. #375, Kansas DHE Cert. #E-10349, Kentucky DEP Lab ID #90101, Louisiana DEQ Cert. #03079, Louisiana DOHH Cert. #LA030024, Maryland DHMH Cert. #277, Massachusetts DEP Cert. #M-TN009, Michigan DEQ Lab ID #9933, New Jersey DEP Cert. #TN001, New York DOH Lab #10781, North Carolina DPH Lab ID #21705, North Carolina DEHNR Cert. #64, Ohio EPA VAP Cert. #CL0059, Oklahoma DEQ ID #9415, Pennsylvania DEP Cert. #68-00576, South Carolina DHEC Lab ID #84001001, Tennessee DOH Lab ID #02014, Utah DOH Cert. # QUAN3, Virginia DGS Lab ID #00165, Washington DOE Lab #C120, West Virginia DEP Cert. #345, Wisconsin DNR Lab ID #998044300, US Army Corps of Engineers, Naval Facilities Engineering Service Center and USDA Soil Permit #S-46424. This list of approvals is subject to change and does not imply that laboratory certification is available for all parameters reported in this environmental sample data report.

# Sample Data Summary

**Leggette, Brashears & Graham, Inc.**  
**Client Sample ID: AQ082406:900 NP4-1**  
**GC/MS Volatiles**

Lot-Sample # H6H250114 - 001      Work Order # JC6AH1AA      Matrix.....: AIR

Date Sampled...: 8/24/06      Date Received...: 8/25/06  
 Prep Date.....: 8/25/06      Analysis Date.. 8/25/06  
 Prep Batch #.....: 6237490  
 Dilution Factor.: 5      Method..... TO-15

PARAMETER	RESULTS (ppb(v/v))	REPORTING LIMIT (ppb(v/v))	RESULTS (ug/m3)	REPORTING LIMIT (ug/m3)
Benzene	0.65	1.0	2.1 J	3.2
Bromodichloromethane	ND	1.0	ND	6.7
Bromoform	ND	1.0	ND	10
Bromomethane	ND	1.0	ND	3.9
Carbon disulfide	2.9	2.5	9.0	7.8
Carbon tetrachloride	ND	1.0	ND	6.3
Chlorobenzene	ND	1.0	ND	4.6
Dibromochloromethane	ND	1.0	ND	8.5
Chloroethane	ND	1.0	ND	2.6
Chloroform	0.62	1.0	3.0 J	4.9
Chloromethane	ND	2.5	ND	5.2
1,1-Dichloroethane	2.0	1.0	8.3	4.0
1,2-Dichloroethane	ND	1.0	ND	4.0
cis-1,2-Dichloroethene	3.2	1.0	13	4.0
trans-1,2-Dichloroethene	ND	1.0	ND	4.0
1,1-Dichloroethene	0.86	1.0	3.4 J	4.0
1,2-Dichloropropane	ND	1.0	ND	4.6
cis-1,3-Dichloropropene	ND	1.0	ND	4.5
trans-1,3-Dichloropropene	ND	1.0	ND	4.5
Ethylbenzene	ND	1.0	ND	4.3
Methylene chloride	1.2	2.5	4.3 J B	8.7
Styrene	ND	1.0	ND	4.3
1,1,2,2-Tetrachloroethane	ND	1.0	ND	6.9
Tetrachloroethene	42	1.0	280	6.8
Toluene	1.1	1.0	4.3	3.8
1,1,1-Trichloroethane	10	1.0	55	5.5
1,1,2-Trichloroethane	ND	1.0	ND	5.5
Trichloroethene	2.3	1.0	12	5.4
Vinyl chloride	0.53	1.0	1.4 J	2.6
m-Xylene & p-Xylene	0.50	1.0	2.2 J	4.3
o-Xylene	ND	1.0	ND	4.3

SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
1,2-Dichloroethane-d4	89	70 - 130
Toluene-d8	104	70 - 130

Leggette, Brashears & Graham, Inc.  
 Client Sample ID: AQ082406:900 NP4-1  
 GC/MS Volatiles

Lot-Sample # H6H250114 - 001	Work Order # JC6AH1AA	Matrix.....: AIR
SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
4-Bromofluorobenzene	87	70 - 130

Qualifiers

B Method blank contamination. The associated method blank contains the target analyte at a reportable level.  
 J Estimated result. Result is less than RL.

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)\*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) \* Dilution Factor) \* (Molecular Weight/24.45)



Leggette, Brashears & Graham, Inc.  
 Client Sample ID: AQ082406:902 NP4-2  
 GC/MS Volatiles

Lot-Sample # H6H250114 - 002      Work Order # JC6AJ1AA      Matrix.....: AIR

Date Sampled...: 8/24/06      Date Received..: 8/25/06  
 Prep Date.....: 8/25/06      Analysis Date.. 8/25/06  
 Prep Batch #....: 6237490  
 Dilution Factor.: 5      Method..... TO-15

PARAMETER	RESULTS (ppb(v/v))	REPORTING LIMIT (ppb(v/v))	RESULTS (ug/m3)	REPORTING LIMIT (ug/m3)
Benzene	ND	1.0	ND	3.2
Bromodichloromethane	ND	1.0	ND	6.7
Bromoform	ND	1.0	ND	10
Bromomethane	ND	1.0	ND	3.9
<b>Carbon disulfide</b>	<b>4.1</b>	<b>2.5</b>	<b>13</b>	<b>7.8</b>
Carbon tetrachloride	ND	1.0	ND	6.3
Chlorobenzene	ND	1.0	ND	4.6
Dibromochloromethane	ND	1.0	ND	8.5
Chloroethane	ND	1.0	ND	2.6
<b>Chloroform</b>	<b>0.40</b>	<b>1.0</b>	<b>1.9</b> <b>J</b>	<b>4.9</b>
Chloromethane	ND	2.5	ND	5.2
<b>1,1-Dichloroethane</b>	<b>1.3</b>	<b>1.0</b>	<b>5.4</b>	<b>4.0</b>
1,2-Dichloroethane	ND	1.0	ND	4.0
<b>cis-1,2-Dichloroethene</b>	<b>1.1</b>	<b>1.0</b>	<b>4.5</b>	<b>4.0</b>
trans-1,2-Dichloroethene	ND	1.0	ND	4.0
<b>1,1-Dichloroethene</b>	<b>0.43</b>	<b>1.0</b>	<b>1.7</b> <b>J</b>	<b>4.0</b>
1,2-Dichloropropane	ND	1.0	ND	4.6
cis-1,3-Dichloropropene	ND	1.0	ND	4.5
trans-1,3-Dichloropropene	ND	1.0	ND	4.5
Ethylbenzene	ND	1.0	ND	4.3
<b>Methylene chloride</b>	<b>0.71</b>	<b>2.5</b>	<b>2.5</b> <b>J B</b>	<b>8.7</b>
Styrene	ND	1.0	ND	4.3
1,1,2,2-Tetrachloroethane	ND	1.0	ND	6.9
Tetrachloroethene	ND	1.0	ND	6.8
<b>Toluene</b>	<b>0.92</b>	<b>1.0</b>	<b>3.5</b> <b>J</b>	<b>3.8</b>
<b>1,1,1-Trichloroethane</b>	<b>4.3</b>	<b>1.0</b>	<b>23</b>	<b>5.5</b>
1,1,2-Trichloroethane	ND	1.0	ND	5.5
Trichloroethene	ND	1.0	ND	5.4
Vinyl chloride	ND	1.0	ND	2.6
<b>m-Xylene &amp; p-Xylene</b>	<b>0.42</b>	<b>1.0</b>	<b>1.8</b> <b>J</b>	<b>4.3</b>
o-Xylene	ND	1.0	ND	4.3

SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
1,2-Dichloroethane-d4	87	70 - 130

Leggette, Brashears & Graham, Inc.  
 Client Sample ID: AQ082406:902 NP4-2  
 GC/MS Volatiles

Lot-Sample # H6H250114 - 002	Work Order # JC6AJ1AA	Matrix.....: AIR
SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
Toluene-d8	105	70 - 130
4-Bromofluorobenzene	80	70 - 130

Qualifiers

B Method blank contamination. The associated method blank contains the target analyte at a reportable level.  
 J Estimated result. Result is less than RL.

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)\*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) \* Dilution Factor) \* (Molecular Weight/24.45)

Leggette, Brashears & Graham, Inc.  
 Client Sample ID: AQ082406:904 NP4-3  
 GC/MS Volatiles

Lot-Sample # H6H250114 - 003      Work Order # JC6AL1AA      Matrix.....: AIR

Date Sampled...: 8/24/06      Date Received...: 8/25/06  
 Prep Date.....: 8/25/06      Analysis Date.. 8/25/06  
 Prep Batch #....: 6237490  
 Dilution Factor.: 5      Method..... TO-15

PARAMETER	RESULTS (ppb(v/v))	REPORTING LIMIT (ppb(v/v))	RESULTS (ug/m3)	REPORTING LIMIT (ug/m3)
Benzene	0.25	1.0	0.79 J	3.2
Bromodichloromethane	ND	1.0	ND	6.7
Bromoform	ND	1.0	ND	10
Bromomethane	ND	1.0	ND	3.9
Carbon disulfide	4.3	2.5	14	7.8
Carbon tetrachloride	ND	1.0	ND	6.3
Chlorobenzene	ND	1.0	ND	4.6
Dibromochloromethane	ND	1.0	ND	8.5
Chloroethane	ND	1.0	ND	2.6
Chloroform	0.42	1.0	2.0 J	4.9
Chloromethane	ND	2.5	ND	5.2
1,1-Dichloroethane	2.0	1.0	8.2	4.0
1,2-Dichloroethane	ND	1.0	ND	4.0
cis-1,2-Dichloroethene	1.2	1.0	4.6	4.0
trans-1,2-Dichloroethene	ND	1.0	ND	4.0
1,1-Dichloroethene	0.73	1.0	2.9 J	4.0
1,2-Dichloropropane	ND	1.0	ND	4.6
cis-1,3-Dichloropropene	ND	1.0	ND	4.5
trans-1,3-Dichloropropene	ND	1.0	ND	4.5
Ethylbenzene	ND	1.0	ND	4.3
Methylene chloride	0.63	2.5	2.2 J B	8.7
Styrene	ND	1.0	ND	4.3
1,1,2,2-Tetrachloroethane	ND	1.0	ND	6.9
Tetrachloroethene	ND	1.0	ND	6.8
Toluene	1.0	1.0	3.8	3.8
1,1,1-Trichloroethane	4.6	1.0	25	5.5
1,1,2-Trichloroethane	ND	1.0	ND	5.5
Trichloroethene	ND	1.0	ND	5.4
Vinyl chloride	ND	1.0	ND	2.6
m-Xylene & p-Xylene	0.42	1.0	1.8 J	4.3
o-Xylene	ND	1.0	ND	4.3

SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
1,2-Dichloroethane-d4	89	70 - 130
Toluene-d8	104	70 - 130

Leggette, Brashears & Graham, Inc.  
 Client Sample ID: AQ082406:904 NP4-3  
 GC/MS Volatiles

Lot-Sample # H6H250114 - 003	Work Order # JC6AL1AA	Matrix.....: AIR
SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
4-Bromofluorobenzene	82	70 - 130

Qualifiers

B Method blank contamination. The associated method blank contains the target analyte at a reportable level.  
 J Estimated result. Result is less than RL.

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)\*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) \* Dilution Factor) \* (Molecular Weight/24.45)

Leggette, Brashears & Graham, Inc.  
 Client Sample ID: INTRA-LAB BLANK  
 GC/MS Volatiles

Lot-Sample # H6H250000 - 490B      Work Order # JC8L21AA      Matrix.....: AIR

Prep Date.....: 8/25/06      Date Received..: 8/25/06  
 Prep Batch #.....: 6237490      Analysis Date..: 8/25/06  
 Dilution Factor.: 1      Method.....: TO-15

PARAMETER	RESULTS (ppb(v/v))	REPORTING LIMIT (ppb(v/v))	RESULTS (ug/m3)	REPORTING LIMIT (ug/m3)
Benzene	ND	0.20	ND	0.64
Bromodichloromethane	ND	0.20	ND	1.3
Bromoform	ND	0.20	ND	2.1
Bromomethane	ND	0.20	ND	0.78
Carbon disulfide	ND	0.50	ND	1.6
Carbon tetrachloride	ND	0.20	ND	1.3
Chlorobenzene	ND	0.20	ND	0.92
Dibromochloromethane	ND	0.20	ND	1.7
Chloroethane	ND	0.20	ND	0.53
Chloroform	ND	0.20	ND	0.98
Chloromethane	ND	0.50	ND	1.0
1,1-Dichloroethane	ND	0.20	ND	0.81
1,2-Dichloroethane	ND	0.20	ND	0.81
cis-1,2-Dichloroethene	ND	0.20	ND	0.79
trans-1,2-Dichloroethene	ND	0.20	ND	0.79
1,1-Dichloroethene	ND	0.20	ND	0.79
1,2-Dichloropropane	ND	0.20	ND	0.92
cis-1,3-Dichloropropene	ND	0.20	ND	0.91
trans-1,3-Dichloropropene	ND	0.20	ND	0.91
Ethylbenzene	ND	0.20	ND	0.87
<b>Methylene chloride</b>	<b>0.094</b>	<b>0.50</b>	<b>0.33</b>	<b>1.7</b>
Styrene	ND	0.20	ND	0.85
1,1,2,2-Tetrachloroethane	ND	0.20	ND	1.4
Tetrachloroethene	ND	0.20	ND	1.4
Toluene	ND	0.20	ND	0.75
1,1,1-Trichloroethane	ND	0.20	ND	1.1
1,1,2-Trichloroethane	ND	0.20	ND	1.1
Trichloroethene	ND	0.20	ND	1.1
Vinyl chloride	ND	0.20	ND	0.51
m-Xylene & p-Xylene	ND	0.20	ND	0.87
o-Xylene	ND	0.20	ND	0.87

SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
1,2-Dichloroethane-d4	87	70 - 130

Leggette, Brashears & Graham, Inc.  
 Client Sample ID: INTRA-LAB BLANK  
 GC/MS Volatiles

Lot-Sample #	H6H250000 - 490B	Work Order #	JC8L21AA	Matrix.....:	AIR
SURROGATE		PERCENT RECOVERY		LABORATORY CONTROL LIMITS (%)	
Toluene-d8		108		70 - 130	
4-Bromofluorobenzene		84		70 - 130	

Qualifiers

J Estimated result. Result is less than RL.

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)\*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) \* Dilution Factor) \* (Molecular Weight/24.45)

Leggette, Brashears & Graham, Inc.  
 Client Sample ID: CHECK SAMPLE  
 GC/MS Volatiles

Lot-Sample # H6H250000 - 490C      Work Order # JC8L21AC      Matrix.....: AIR

Prep Date.....: 8/25/06      Date Received..: 8/25/06  
 Prep Batch #.....: 6237490      Analysis Date..: 8/25/06  
 Dilution Factor.: 1      Method.....: TO-15

PARAMETER	SPIKE AMOUNT (ppb(v/v))	MEASURED AMOUNT (ppb(v/v))	SPIKE AMOUNT (ug/m3)	MEASURED AMOUNT (ug/m3)	PERCENT RECOVERY	RECOVERY LIMITS
Benzene	10.0	7.10	32	23	71	70 - 130
Chlorobenzene	10.0	8.29	46	38	83	70 - 130
1,1-Dichloroethene	10.0	9.68	40	38	97	70 - 130
Toluene	10.0	7.66	38	29	77	70 - 130
Trichloroethene	10.0	8.28	54	44	83	70 - 130

SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
1,2-Dichloroethane-d4	86	70 - 130
Toluene-d8	100	70 - 130
4-Bromofluorobenzene	95	70 - 130

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)\*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) \* Dilution Factor) \* (Molecular Weight/24.45)

# Sample Receipt Documentation



# STL Knoxville

5815 Middlebrook Pike • Knoxville, TN 37921-5947  
 Phone: (865) 291-3000 • Fax: (865) 584-4315  
 Receiving: (865) 291-3031

# ANALYSIS REQUEST AND CHAIN OF CUSTODY RECORD\*

Reference Document No.  
 Page 1 of 1 H6H250114

Project Name/No. <sup>1</sup> Route Samples Shipment Date <sup>7</sup> 8/24/06  
 Sample Team Members <sup>2</sup> Rob Drew Lab Destination <sup>8</sup> \_\_\_\_\_  
 Profit Center No. <sup>3</sup> MBSAG 04 01 Lab Contact <sup>9</sup> Scott Harris  
 Project Manager <sup>4</sup> Mark Goldberg Project Contact / Phone <sup>12</sup> 203-924-8555  
 Purchase Order No. <sup>6</sup> \_\_\_\_\_ Carrier / Waybill No. <sup>19</sup> \_\_\_\_\_

Bill to: <sup>5</sup> LBG  
4 Research Dr  
Suite 301  
Shelton, CT 06484  
 Report to: <sup>10</sup> Mark Goldberg

## ONE CONTAINER PER LINE

Sample <sup>14</sup> Number	Sample <sup>15</sup> Type	Date/Time <sup>16</sup> Collected	Container <sup>17</sup> Type	Sample <sup>18</sup> Volume	Pre- <sup>19</sup> servative	Requested Testing <sup>20</sup> Program	Condition on Receipt <sup>21</sup> Lab use only
AQ082406: 900 NP4-1	AC	8/24/06 9:00 am	Feller Bags	1L	-	TD-17	Custody seals intact <input checked="" type="checkbox"/> N NA
✓ 902 NP4-2		9:02 am	↓	↓	-	↓	Temperature received at <u>AMBIENT</u>
✓ 904 NP4-3		9:04 am	↓	↓	-	↓	Received by <u>WKS</u> Date <u>8-25-06</u>
							Number of packages <u>1 container</u>
							Tracking # <u>7928 32373148</u>

### Special Instructions: <sup>23</sup>

Possible Hazard Identification: <sup>24</sup>  
 Non-Hazard  Flammable  Skin Irritant  Poison B  Unknown   
 Turnaround Time Required: <sup>26</sup>  
 Normal  Rush

Sample Disposal: <sup>25</sup>  
 Return to Client  Disposal by Lab  Archive (mos.)

QC Level: <sup>27</sup>  
 I.  II.  III.  Project Specific (specify): Full QA/QC

1. Relinquished by <sup>28</sup> Mark M. Goldberg Date: 8/24/06  
 (Signature / Affiliation) Time: 17:00

1. Relinquished by \_\_\_\_\_ Date: \_\_\_\_\_  
 (Signature / Affiliation) Time: \_\_\_\_\_

1. Received by <sup>28</sup> \_\_\_\_\_ Date: 8-25-06  
 (Signature / Affiliation) Time: 07:30

1. Received by \_\_\_\_\_ Date: \_\_\_\_\_  
 (Signature / Affiliation) Time: \_\_\_\_\_

Comments: <sup>29</sup>

STL KNOXVILLE SAMPLE RECEIPT/CONDITION UPON RECEIPT ANOMALY CHECKLIST

Client: LBG Project: RDWF Lot Number: H6H250114

Review Items	Yes	No	NA	If No, what was the problem?	Comments/Actions Taken
1. Do sample container labels match COC? (IDs, Dates, Times)	<input checked="" type="checkbox"/>			<input type="checkbox"/> 1a Do not match COC <input type="checkbox"/> 1b Incomplete information <input type="checkbox"/> 1c Marking smeared <input type="checkbox"/> 1d Label torn <input type="checkbox"/> 1e No label <input type="checkbox"/> 1f COC not received <input type="checkbox"/> 1g Other:	
2. Is the cooler temperature within limits? (> freezing temp. of water to 6 °C; NC, 1668, 1613B: 0-4°C; VOST: 10°C; MA: 2-6 °C)	<input checked="" type="checkbox"/>			<input type="checkbox"/> 2a Temp Blank = _____ <input type="checkbox"/> 2b Cooler Temp = _____	
3. Were samples received with correct chemical preservative (excluding Encore)?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 3a Sample preservative = _____	
4. Were custody seals present/intact on cooler and/or containers?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 4a Not present <input type="checkbox"/> 4b Not intact <input type="checkbox"/> 4c Other:	
5. Were all of the samples listed on the COC received?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 5a Samples received-not on COC <input type="checkbox"/> 5b Samples not received-on COC	
6. Were all of the sample containers received intact?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 6a Leaking <input type="checkbox"/> 6b Broken	
7. Were VOA samples received without headspace?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 7a Headspace (VOA only)	
8. Were samples received in appropriate containers?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 8a Improper container	
9. Did you check for residual chlorine, if necessary?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 9a Could not be determined due to matrix interference	
10. Were samples received within holding time?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 10a Holding time expired	
11. For rad samples, was sample activity info. provided?	<input checked="" type="checkbox"/>			<input type="checkbox"/> Incomplete information	
12. For SOG water samples (1613B, 1668A, 8290, LR PAHs), do samples have visible solids present?	<input checked="" type="checkbox"/>			If yes & appears to be >1%, was SOG notified?	
13. Are the shipping containers intact?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 13a Leaking <input type="checkbox"/> 13b Other:	
14. Was COC relinquished? (Signed/Dated/Timed)	<input checked="" type="checkbox"/>			<input type="checkbox"/> 14a Not relinquished	
15. Are tests/parameters listed for each sample?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 15a Incomplete information	
16. Is the matrix of the samples noted?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 15a Incomplete information	
17. Is the date/time of sample collection noted?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 15a Incomplete information	
18. Is the client and project name/# identified?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 15a Incomplete information	
19. Was the sampler identified on the COC?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 15a Incomplete information	

Quote #: 691610 PM Instructions: \_\_\_\_\_

Sample Receiving Associate: [Signature] Date: 8-28-06