

-DRAFT-

PROJECT STATUS MEMORANDUM

NO. 06-02

TO: Pamela Tames, USEPA

FROM: Mark M. Goldberg, P.E.

DATE: November 8, 2006

PROJECT: Ground Water Remedial Action
Focused Pump & Treat System
Rowe Industries Superfund Site
Sag Harbor, New York
July 2006 through September 2006 Status Report

LBG Engineering Services, P.C. (LBG) restarted the operation of the Focused Pump & Treat (FP&T) system on May 30, 2006. Prior to that time, the FP&T system was in operation from March 22, 2001 to December 23, 2003. This status report presents a summary of the operation, maintenance and monitoring activities for the FP&T system from July 1, 2006 through September 30, 2006.

The data presented in this report indicate that the FP&T system was effectively treating the contaminants of concern (COCs) in the ground water of the former drum storage area (FDSA). The system shut down on September 8, 2006 because of a high equalization (EQ) tank alarm. The decision was made not to restart the FP&T system until the EHC product in the wells could be cleaned. The introduction of the EHC product into the FP&T system is believed to be causing short-circuiting in the carbon units. The short-circuiting is causing pre-mature breakthrough of volatile organic compounds (VOCs) to occur in both carbon units (refer to the discussion below for more details). A summary of the system operation is provided below.

SUMMARY OF SYSTEM OPERATION

(July 2006 through September 2006)

<i>Reporting Period:</i>	92 days
<i>Total Flow During Period:</i>	706,364 gallons
<i>Cumulative Total Flow Since May 30, 2006:</i>	963,415 gallons
<i>Since March 22, 2001:</i>	6,758,035 gallons
<i>System Average Flow:</i>	12.4 gallons per minute (gpm)
<i>Mass of VOCs Recovered:</i>	
<i>Since July 1, 2006:</i>	1.39 pounds (see Table 1)

Cumulative VOCs Recovered Since May 30, 2006: 2.26 pounds
Since March 22, 2001: 19.46 pounds

Discharge Criteria: Effluent water quality criteria met (see Table 8)

Table 1 presents the pre-carbon VOC concentrations, the total volume of water pumped and the mass of VOCs removed and treated by the FP&T system. Graph 1 presents the pre-carbon VOC concentrations and total cumulative mass of VOCs removed since the system was restarted on May 30, 2006. The trend in pre-carbon VOC concentrations is downward for this reporting period. VOC concentrations will continue to be monitored weekly to determine if this trend continues.

The concentration of tetrachloroethylene (PCE) from the FP&T recovery wells during this reporting period ranged from 2.5 ug/l in a sample collected from FRW-2 to 580 ug/l in a sample collected from FRW-3. During this reporting period, the highest and lowest average PCE concentrations in the ground water were consistently detected in the samples from FRW-3 and FRW-4, respectively. The high concentrations of PCE detected in the samples from FRW-3 are expected because this well is near a hot spot in the FDSA source area. The laboratory results from the analysis of water samples from the recovery wells may be found in Tables 2, 3, 4 and 5. Graph 2 illustrates the PCE trends in each recovery well and the pre-carbon (influent) sample. Pre-carbon VOC concentrations as summarized in Table 6 appear to be trending downward.

Vinyl chloride (VC) continues to be detected at low concentrations (less than 6 ug/l) in the water samples from FRW-2 and FRW-3, which indicates that limited degradation continues to occur in the FDSA as a result of the EHCTM injection. The area around FRW-2 and FRW-3 was the location where the heaviest dose of EHCTM was injected. Cis-1,2 dichloroethene (cis-DCE) has also been detected at FRW-1, FRW-2 and FRW-3, which is also an indicator that some degradation of PCE is occurring in the FDSA.

High concentrations of toluene continue to be detected in the ground-water samples from FRW-2 and FRW-3. During this reporting period, toluene concentrations in the ground water at these wells ranged from 420 ug/l to 1,800 ug/l and 120 ug/l to 270 ug/l, respectively. The high toluene concentrations are also a result of the mobilization of this compound by the EHCTM injection. Decreases in toluene concentrations in the ground water are expected with the continued operation of the FP&T system. These results are summarized in Tables 3 and 4.

The EQ tank alarms continued to occur with some frequency because of the EHCTM clogging the bag filter in the FP&T system. The EHCTM product is also believed to be causing short circuiting of water through the lead carbon unit. VOCs in the water were initially detected after the lead (first) carbon vessel on July 13, 2006 and then detected after the second carbon vessel on August 28, 2006, as indicated by the quality data summarized on tables 7 and 8. The carbon was previously changed on June 28, 2006.

LBG will resume operation of the FP&T system in the 4th quarter following a carbon change-out, below-grade pipe cleaning and vacuuming the recovery well sumps. The purpose of vacuuming the sumps of the recovery wells is to remove any accumulated EHCTM from the sump as well as the gravel pack around the wells. It is anticipated that this work, in conjunction with the carbon change, will allow the FP&T operation to resume with fewer alarms caused by the recovery of EHCTM.

The continued operation of the FP&T system is expected to lower the COC concentrations in the FDSA. Any contaminated water migrating from the FDSA has been and will continue to be captured by the onsite recovery wells of the full-scale pump and treat (FSP&T) system.

cc: Phil McAndrew, Kraft Foods, N.A. – .pdf
Lisa Krogman, Kraft Foods, N.A. (Environ) – .pdf
Jeff Trad, NYSDEC – .pdf
Chief-Operation Maintenance and Support Section, NYSDEC – .pdf
William Spitz, RWM, R-1, NYSDEC
Garrett W. Swensen Jr., Esq., Town of Southampton

TABLES

Table 1

**GROUND-WATER REMEDIAL ACTION
FOCUSED PUMP AND TREAT SYSTEM
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

**Mass of VOCs Removed from the FDSA
July 2006 through September 2006**

Date	Total Precarbon VOC Concentrations (µg/L)	Total Volume of Water Pumped (gals)	Volume of Water Processed for Period (gallons)	Total Mass of VOCs Removed (lbs.)	Cumulative Mass of VOCs Removed (lbs.)
7/7/2006	528	6,053,557	1,886	0.01	0.01
7/13/2006	425	6,159,000	105,443	0.37	0.38
7/20/2006	336	6,266,520	107,520	0.30	0.68
7/27/2006	463	6,322,063	55,543	0.21	0.90
7/31/2006	309	6,352,704	30,641	0.08	0.98
8/8/2006	386	6,361,647	8,943	0.03	1.00
8/16/2006	51	6,509,616	147,969	0.06	1.07
8/24/2006	176	6,607,517	97,901	0.14	1.21
8/28/06 ^{1/}	69	6,655,030	47,513	0.03	1.24
9/5/2006	179	6,713,956	58,926	0.09	1.33
9/8/2006 ^{2/}	179	6,758,035	44,079	0.07	1.39

1. The total mass of VOCs removed was calculated by using the difference between the precarbon and post-carbon VOC concentrations.
2. The FP&T system shut down on September 8, 2006 because of an alarm. Total mass removed was calculated using laboratory data from September 5, 2006.

Table 2

**GROUND-WATER REMEDIAL ACTION
FOCUSED PUMP AND TREAT SYSTEM
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

**Recovery Well FRW-1 VOC Concentrations, micrograms per liter
July 2006 through September 2006**

FRW-1											
Date	PCE	TCE	12DCE	TCA	IPB	NPB	124TMB	135TMB	TOLUENE	VC	MC
7/7/2006	230	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	7.8	ND<1	15 ^{1/}
7/13/2006	120	ND<1	1.1	ND<1	ND<1	ND<1	ND<1	ND<1	5.6	ND<1	ND<1
7/20/2006	75	3.5	31	ND<1	ND<1	ND<1	ND<1	ND<1	8.7	ND<1	ND<1
7/27/2006	31	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	13	ND<1	ND<1
8/24/2006	14	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	5.6	ND<1	ND<1
9/20/2006	310	ND<1	5.8	11	ND<1	ND<1	ND<1	ND<1	22	ND<1	ND<1

1. Methylene chloride was detected in the laboratory method blank.

PCE- TETRACHLOROETHYLENE

TCA - 1,1,1-TRICHLOROETHANE

11 2-TCA - 1,1,2-TRICHLOROETHANE

TCE - TRICHLOROETHENE

12DCE - cis1,2-DICHLOROETHENE

MTBE - METHYL TERTIARY-BUTYL ETHER

VC - VINYL CHLORIDE

NPB - n PROPYLBENZENE

124TMB - 1,2,4-TRIMETHYLBENZENE

135TMB - 1,3,5-TRIMETHYLBENZENE

IPB - ISOPROPYLBENZENE

4-IPT - 4-ISOPROPYLTOLUENE

-- - NOT ANALYZED

MC - METHYLENE CHLORIDE

Table 3

**GROUND-WATER REMEDIAL ACTION
FOCUSED PUMP AND TREAT SYSTEM
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

**Recovery Well FRW-2 VOC Concentrations, micrograms per liter
July 2006 through September 2006**

FRW-2											
Date	PCE	TCE	12DCE	TCA	IPB	NPB	124TMB	135TMB	TOLUENE	VC	MC
7/7/2006	47	5.3	9.6	ND<1	ND<1	ND<1	ND<1	ND<1	1,800	ND<1	ND<1
7/13/2006	64	2.6	10	ND<1	ND<1	ND<1	ND<1	ND<1	630	ND<1	ND<1
7/20/2006	14	1.2	9.4	ND<1	ND<1	ND<1	ND<1	ND<1	430	1.1	ND<1
7/27/2006	20	1.5	10	ND<1	ND<1	ND<1	ND<1	ND<1	1,100	ND<1	ND<1
8/24/2006	14	1.8	22	ND<1	ND<1	ND<1	ND<1	ND<1	420	3.0	ND<1
9/20/2006	2.5	ND<1	10	ND<1	ND<1	ND<1	ND<1	ND<1	1,100	ND<1	ND<1

PCE- TETRACHLOROETHYLENE

TCA - 1,1,1-TRICHLOROETHANE

11 2-TCA - 1,1,2-TRICHLOROETHANE

TCE - TRICHLOROETHENE

12DCE - cis1,2-DICHLOROETHENE

MTBE - METHYL TERTIARY-BUTYL ETHER

VC - VINYL CHLORIDE

NPB - n PROPYL BENZENE

124TMB - 1,2,4-TRIMETHYLBENZENE

1,3,5TMB - 1,3,5-TRIMETHYLBENZENE

IPB - ISOPROPYLBENZENE

4-IPT - 4-ISOPROPYLTOLUENE

-- - NOT ANALYZED

MC - METHYLENE CHLORIDE

Table 4

**GROUND-WATER REMEDIAL ACTION
FOCUSED PUMP AND TREAT SYSTEM
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

**Recovery Well FRW-3 VOC Concentrations, micrograms per liter
July 2006 through September 2006**

FRW-3											
Date	PCE	TCE	12DCE	TCA	IPB	NPB	124TMB	135 TMB	TOLUENE	VC	SBB
7/7/2006	550	16	46	2.8	4.4	ND<1	4.0	1.4	190	4.0	ND<1
7/13/2006	330	4.7	46	ND<1	ND<1	ND<1	ND<1	ND<1	140	3.7	ND<1
7/20/2006	310	5.4	43	ND<1	ND<1	ND<1	ND<1	ND<1	170	5.5	ND<1
7/27/2006	500	12	55	2.0	5.1	2.6	4.2	ND<1	270	5.0	2.9
8/24/2006	100	4.0	20	ND<1	ND<1	ND<1	ND<1	ND<1	210	ND<1	ND<1
9/20/06 ^{1/}	480	4.5	26	ND<1	3.1	1.6	3.0	3.9	120	ND<1	2.2
	580	7.3	29	ND<1	3.7	1.8	3.4	4.6	140	ND<1	2.4
	520	4.7	27	ND<1	3.1	1.6	2.2	3.8	120	ND<1	1.6

1. The September 20, 2006 sample for FRW-3 was analyzed in triplicate as part of the laboratory quality assurance/quality control (QA/QC) evaluation for the semi-annual ground-water sampling.

PCE - TETRACHLOROETHYLENE

TCA - 1,1,1-TRICHLOROETHANE

11 2-TCA - 1,1,2-TRICHLOROETHANE

TCE - TRICHLOROETHENE

12DCE - cis1,2-DICHLOROETHENE

MTBE - METHYL TERTIARY-BUTYL ETHER

VC - VINYL CHLORIDE

NPB - n PROPYLBENZENE

124TMB - 1,2,4-TRIMETHYLBENZENE

1,3,5TMB - 1,3,5-TRIMETHYLBENZENE

IPB - ISOPROPYLBENZENE

4-IPT - 4-ISOPROPYLTOLUENE

-- - NOT ANALYZED

SSB - SEC-BUTYLBENZENE

Table 5

**GROUND-WATER REMEDIAL ACTION
FOCUSED PUMP AND TREAT SYSTEM
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

**Recovery Well FRW-4 VOC Concentrations, micrograms per liter
July 2006 through September 2006**

FRW-4											
Date	PCE	TCE	11DCE	TCA	IPB	NPB	124TMB	135TMB	TOLUENE	VC	MC
7/7/2006	19	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	14	ND<1	ND<1
7/13/2006	3.4	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	10	ND<1	ND<1
7/20/2006	4.2	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	7.9	ND<1	ND<1
7/27/2006	6.4	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	12	ND<1	ND<1
8/24/2006	12	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	17	ND<1	ND<1
9/20/2006	4.8	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.8	ND<1	ND<1

PCE- TETRACHLOROETHYLENE

TCA - 1,1,1-TRICHLOROETHANE

11 2-TCA - 1,1,2-TRICHLOROETHANE

TCE - TRICHLOROETHENE

12DCE - cis1,2-DICHLOROETHENE

MTBE - METHYL TERTIARY-BUTYL ETHER

VC - VINYL CHLORIDE

NPB - n PROPYL BENZENE

124TMB - 1,2,4-TRIMETHYLBENZENE

1,3,5TMB - 1,3,5-TRIMETHYLBENZENE

IPB - ISOPROPYLBENZENE

4-IPT - 4-ISOPROPYLTOLUENE

-- - NOT ANALYZED

MC - METHYLENE CHLORIDE

Table 6

**GROUND-WATER REMEDIAL ACTION
FOCUSED FOCUSED PUMP AND TREAT SYSTEM
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

**Pre-Carbon VOC Concentrations, micrograms per liter
July 2006 through September 2006**

PRE-CARBON										
Date	PCE	TCA	12DCE	IPB	NPB	124TMB	135TMB	TCE	Toluene	MC
7/7/2006	160	ND<1	13	ND<1	ND<1	ND<1	ND<1	5.3	350	ND<1
7/13/2006	180	ND<1	21	ND<1	ND<1	ND<1	ND<1	4.0	220	ND<1
7/20/2006	64	ND<1	19	ND<1	ND<1	ND<1	ND<1	3.3	250	ND<1
7/27/2006	120	ND<1	20	ND<1	ND<1	ND<1	ND<1	2.6	320	ND<1
7/31/2006	110	ND<1	17	ND<1	ND<1	ND<1	ND<1	1.9	180	ND<1
8/8/2006	98	ND<1	25	ND<1	ND<1	ND<1	ND<1	2.8	260	ND<1
8/16/2006	27	ND<1	12	ND<1	ND<1	ND<1	ND<1	ND<1	12	ND<1
8/24/2006	22	ND<1	14	ND<1	ND<1	ND<1	ND<1	ND<1	140	ND<1
8/28/2006	30	1.5	6.1	ND<1	ND<1	ND<1	ND<1	ND<1	31	ND<1
9/5/2006	59	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	120	ND<1

PCE- TETRACHLOROETHYLENE
TCA - 1,1,1-TRICHLOROETHANE
112-TCA - 1,1,2-TRICHLOROETHANE
TCE - TRICHLOROETHENE
EB - ETHYLBENZENE
IPB - ISOPROPYLBENZENE
CB - CHLOROBENZENE
MC - METHYLENE CHLORIDE

BF - BROMOFORM
124TMB - 1,2,4-TRIMETHYLBENZENE
135TMB - 1,3,5-TRIMETHYLBENZENE
CB - CHLOROBENZENE
12DCE - cis1,2-DICHLOROETHENE
4-IPT - 4-ISOPROPYLTOLUENE
-- - NOT ANALYZED
NPB - N-PROPYLBENZENE

Table 7

**GROUND-WATER REMEDIAL ACTION
FOCUSED PUMP AND TREAT SYSTEM
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

**Mid-carbon VOC Concentrations, micrograms per liter
July 2006 through September 2006**

MID-CARBON										
Date	PCE	TCA	12DCE	IPB	NPB	124TMB	135TMB	TCE	Toluene	MC
7/7/2006	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
7/13/2006	30	ND<1	1.9	ND<1	ND<1	ND<1	ND<1	ND<1	19	ND<1
7/20/2006	3.8	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	12	ND<1
7/27/2006	17	ND<1	3.5	ND<1	ND<1	ND<1	ND<1	ND<1	57	ND<1
7/31/2006	22	ND<1	4.3	ND<1	ND<1	ND<1	ND<1	ND<1	18	ND<1
8/8/2006	7.4	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	15	ND<1
8/16/2006	9.5	ND<1	1.1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
8/24/2006	6.0	ND<1	3.7	ND<1	ND<1	ND<1	ND<1	ND<1	29	ND<1
8/28/2006	14	ND<1	1.4	ND<1	ND<1	ND<1	ND<1	ND<1	1.4	ND<1
9/5/2006	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1

PCE- TETRACHLOROETHYLENE
TCA - 1,1,1-TRICHLOROETHANE
112-TCA - 1,1,2-TRICHLOROETHANE
TCE - TRICHLOROETHENE
EB - ETHYLBENZENE
IPB - ISOPROPYLBENZENE
CB - CHLOROBENZENE
MC - METHYLENE CHLORIDE

BF - BROMOFORM
124TMB - 1,2,4-TRIMETHYLBENZENE
135TMB - 1,3,5-TRIMETHYLBENZENE
CB - CHLOROBENZENE
12DCE - cis1,2-DICHLOROETHENE
4-IPT - 4-ISOPROPYLTOLUENE
-- - NOT ANALYZED
NPB - N-PROPYLBENZENE

Table 8

**GROUND-WATER REMEDIAL ACTION
FOCUSED PUMP AND TREAT SYSTEM
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

Post-carbon VOC Concentrations, micrograms per liter
July 2006 through September 2006

POST-CARBON										
Date	PCE	TCA	12DCE	IPB	NPB	124TMB	135TMB	TCE	Toluene	MC
SPDES ^{1/}	5	5	5	5	5	5	5	5	5 ^{2/}	5 ^{2/}
7/7/2006	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
7/13/2006	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
7/20/2006	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
7/27/2006	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
7/31/2006	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
8/8/2006	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
8/16/2006	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
8/24/2006	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
8/28/2006	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
9/5/06 ^{3/}	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1

1. SPDES is the state pollutant discharge elimination system equivalent effluent criteria for ground water established for the Former Rowe Industries Superfund site.
2. Toluene and methylene chloride do not have SPDES criteria established for the site, therefore, the "New York State Ambient Water Quality Standards and Guidance Values" document was used to obtain these concentrations.
3. The FP&T system was not turned back on following a September 8, 2006 high equalization tank alarm because of VOC breakthrough detected in the second carbon vessel on August 28, 2006.


PCE- TETRACHLOROETHYLENE
TCA - 1,1,1-TRICHLOROETHANE
112-TCA - 1,1,2-TRICHLOROETHANE
TCE - TRICHLOROETHENE
EB - ETHYLBENZENE
IPB - ISOPROPYLBENZENE
CB - CHLOROBENZENE
MC - METHYLENE CHLORIDE

BF - BROMOFORM
124TMB - 1,2,4-TRIMETHYLBENZENE
135TMB - 1,3,5-TRIMETHYLBENZENE
CB - CHLOROBENZENE
12DCE - cis1,2-DICHLOROETHENE
4-IPT - 4-ISOPROPYLTOLUENE
-- - NOT ANALYZED
NPB - N-PROPYLBENZENE

GRAPHS


GRAPH 1
GROUND WATER REMEDIAL ACTION
FOCUSED PUMP AND TREAT SYSTEM
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

INFLUENT VOC CONCENTRATION AND CUMULATIVE MASS REMOVED FROM FDSA
 May 30, 2006 through September 30, 2006

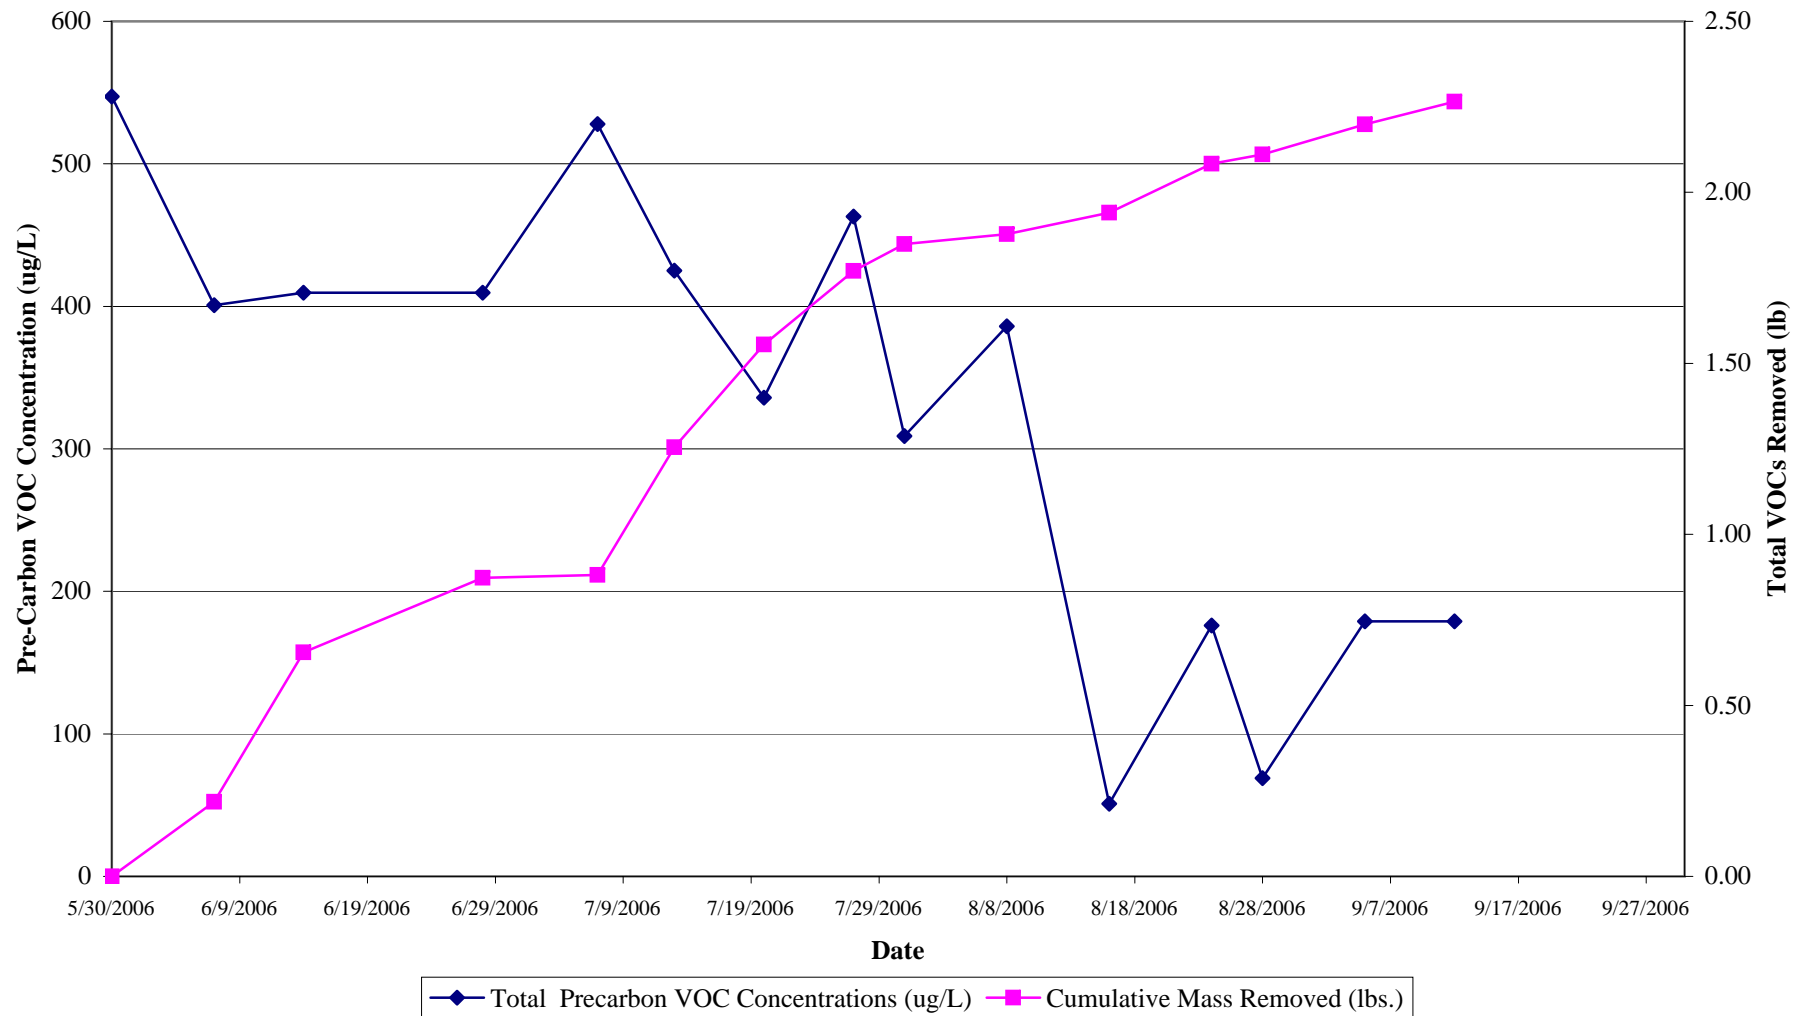

GRAPH 2
GROUND WATER REMEDIAL ACTION
FOCUSED PUMP AND TREAT SYSTEM
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

TETRACHLOROETHENE CONCENTRATIONS IN RECOVERED GROUND WATER
July 1, 2006 through September 30, 2006

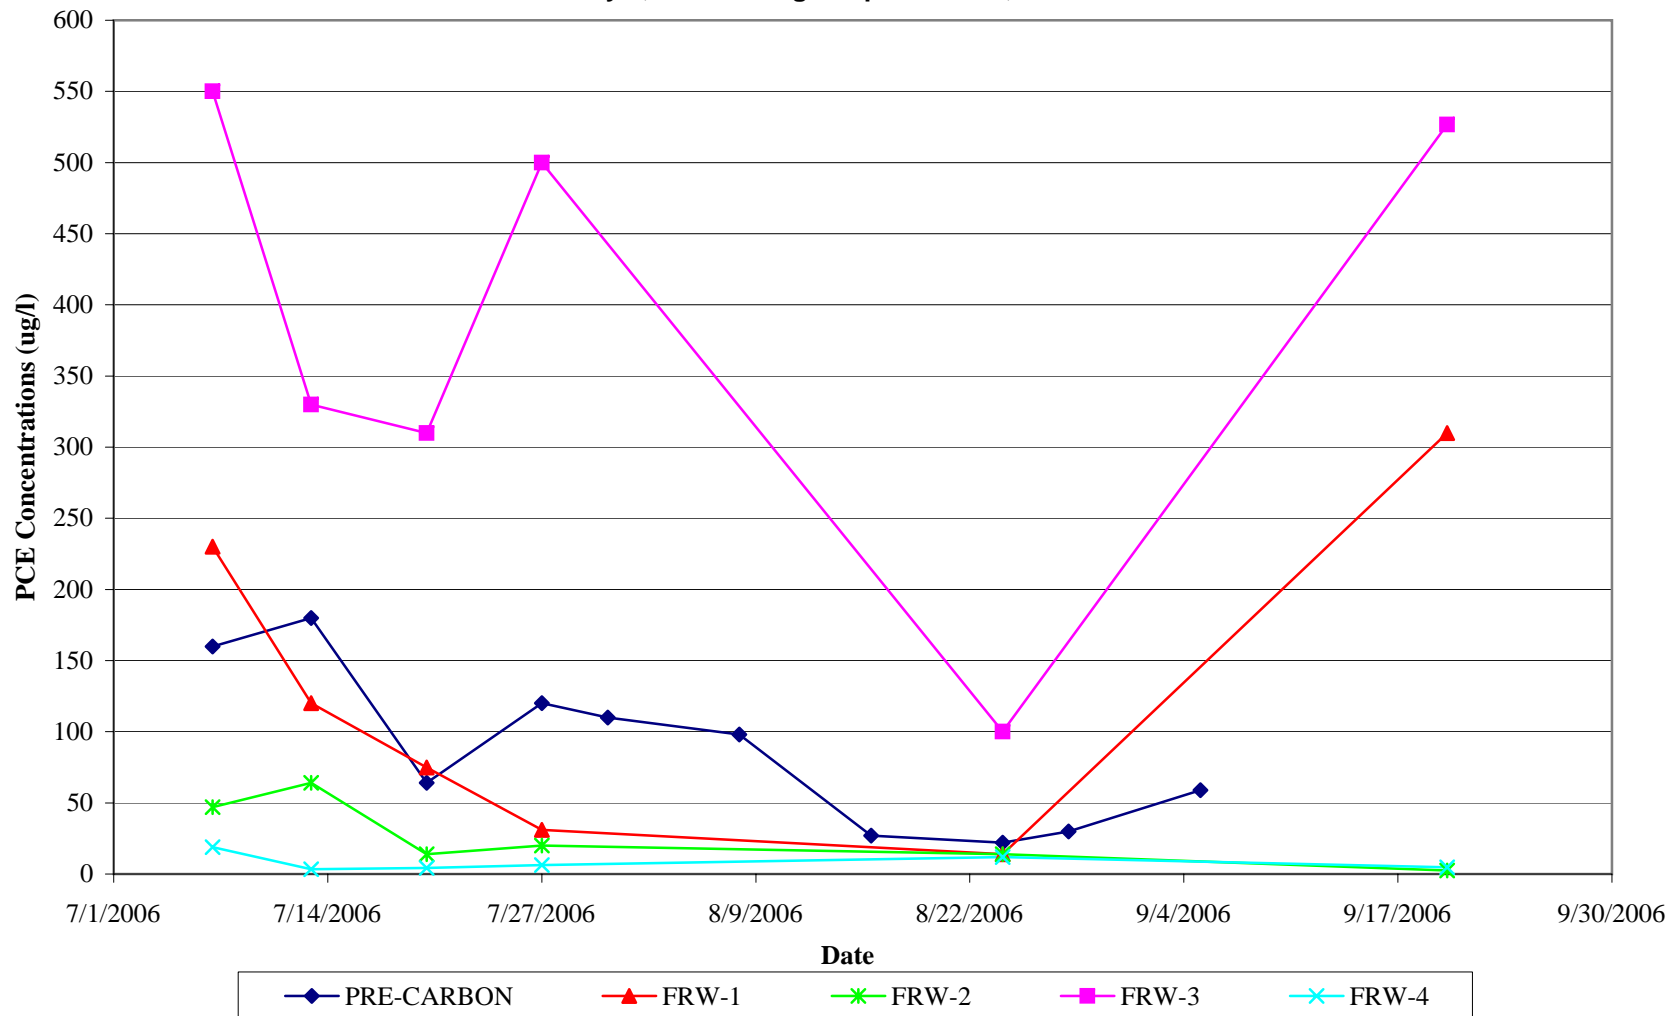

APPENDIX I
3RD QUARTER 2006 LABORATORY ANALYTICAL REPORTS



NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Tuesday, July 18, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555

FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0607065

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 7 sample(s) on 7/11/2006 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 18-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0607065

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0607065-01A	PRE 070706	10271	7/7/2006	7/11/2006
0607065-02A	MID 070706	10271	7/7/2006	7/11/2006
0607065-03A	POST 070706	10271	7/7/2006	7/11/2006
0607065-04A	FRW1 070706	10271	7/7/2006	7/11/2006
0607065-05A	FRW2 070706	10271	7/7/2006	7/11/2006
0607065-06A	FRW3 070706	10271	7/7/2006	7/11/2006
0607065-07A	FRW4 070706	10271	7/7/2006	7/11/2006

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100

FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ol style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 18-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607065
Project: Rowe Industries
Lab ID: 0607065-01A

Client Sample ID: PRE 070706
Tag Number: 10271
Collection Date: 7/7/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
2-Butanone	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
2-Hexanone	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Acetone	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Benzene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Bromobenzene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Bromochloromethane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Bromodichloromethane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Bromoform	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Bromomethane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Carbon disulfide	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Chlorobenzene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607065
Project: Rowe Industries
Lab ID: 0607065-01A

Client Sample ID: PRE 070706
Tag Number: 10271
Collection Date: 7/7/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Chloroform	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Chloromethane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
cis-1,2-Dichloroethene	13	1.0		µg/L	1	7/13/2006 4:19:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Dibromochloromethane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Dibromomethane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Ethylbenzene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Isopropylbenzene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
m,p-Xylene	U	2.0		µg/L	1	7/13/2006 4:19:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Methylene chloride	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Naphthalene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
n-Butylbenzene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
n-Propylbenzene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
o-Xylene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Styrene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Tetrachloroethene	160	1.0		µg/L	1	7/13/2006 4:19:00 AM
Toluene	350	1.0		µg/L	1	7/13/2006 4:19:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Trichloroethene	5.3	1.0		µg/L	1	7/13/2006 4:19:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Vinyl acetate	U	1.0		µg/L	1	7/13/2006 4:19:00 AM
Vinyl chloride	U	1.0		µg/L	1	7/13/2006 4:19:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-Jul-06

CLIENT: Leggett Brashears & Graham Inc.
Lab Order: 0607065
Project: Rowe Industries
Lab ID: 0607065-02A

Client Sample ID: MID 070706
Tag Number: 10271
Collection Date: 7/7/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
2-Butanone	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
2-Hexanone	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Acetone	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Benzene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Bromobenzene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Bromochloromethane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Bromodichloromethane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Bromoform	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Bromomethane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Carbon disulfide	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Chlorobenzene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607065
Project: Rowe Industries
Lab ID: 0607065-02A

Client Sample ID: MID 070706
Tag Number: 10271
Collection Date: 7/7/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Chloroform	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Chloromethane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Dibromochloromethane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Dibromomethane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Ethylbenzene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Isopropylbenzene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
m,p-Xylene	U	2.0		µg/L	1	7/13/2006 4:56:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Methylene chloride	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Naphthalene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
n-Butylbenzene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
n-Propylbenzene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
o-Xylene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Styrene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Tetrachloroethene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Toluene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Trichloroethene	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Vinyl acetate	U	1.0		µg/L	1	7/13/2006 4:56:00 AM
Vinyl chloride	U	1.0		µg/L	1	7/13/2006 4:56:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607065
Project: Rowe Industries
Lab ID: 0607065-03A

Client Sample ID: POST 070706
Tag Number: 10271
Collection Date: 7/7/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
2-Butanone	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
2-Hexanone	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Acetone	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Benzene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Bromobenzene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Bromoform	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Bromomethane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607065
Project: Rowe Industries
Lab ID: 0607065-03A

Client Sample ID: POST 070706
Tag Number: 10271
Collection Date: 7/7/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Chloroform	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Chloromethane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Dibromomethane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/13/2006 4:44:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Methylene chloride	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Naphthalene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
o-Xylene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Styrene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Tetrachloroethene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Toluene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Trichloroethene	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/13/2006 4:44:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/13/2006 4:44:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607065
Project: Rowe Industries
Lab ID: 0607065-04A

Client Sample ID: FRW1 070706
Tag Number: 10271
Collection Date: 7/7/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
2-Butanone	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
2-Hexanone	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Acetone	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Benzene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Bromobenzene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Bromoform	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Bromomethane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607065
Project: Rowe Industries
Lab ID: 0607065-04A

Client Sample ID: FRW1 070706
Tag Number: 10271
Collection Date: 7/7/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Chloroform	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Chloromethane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Dibromomethane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/13/2006 5:21:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Methylene chloride	15	1.0	B	µg/L	1	7/13/2006 5:21:00 PM
Naphthalene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
o-Xylene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Styrene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Tetrachloroethene	230	1.0		µg/L	1	7/13/2006 5:21:00 PM
Toluene	7.8	1.0		µg/L	1	7/13/2006 5:21:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Trichloroethene	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/13/2006 5:21:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/13/2006 5:21:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607065
Project: Rowe Industries
Lab ID: 0607065-05A

Client Sample ID: FRW2 070706
Tag Number: 10271
Collection Date: 7/7/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
2-Butanone	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
2-Hexanone	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Acetone	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Benzene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Bromobenzene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Bromoform	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Bromomethane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607065
Project: Rowe Industries
Lab ID: 0607065-05A

Client Sample ID: FRW2 070706
Tag Number: 10271
Collection Date: 7/7/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Chloroform	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Chloromethane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
cis-1,2-Dichloroethene	9.6	1.0		µg/L	1	7/13/2006 5:57:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Dibromomethane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/13/2006 5:57:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Methylene chloride	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Naphthalene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
o-Xylene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Styrene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Tetrachloroethene	47	1.0		µg/L	1	7/13/2006 5:57:00 PM
Toluene	1800	20		µg/L	20	7/17/2006 1:51:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Trichloroethene	5.3	1.0		µg/L	1	7/13/2006 5:57:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/13/2006 5:57:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/13/2006 5:57:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607065
Project: Rowe Industries
Lab ID: 0607065-06A

Client Sample ID: FRW3 070706
Tag Number: 10271
Collection Date: 7/7/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
1,1,1-Trichloroethane	2.8	1.0		µg/L	1	7/13/2006 6:34:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
1,2,4-Trimethylbenzene	4.0	1.0		µg/L	1	7/13/2006 6:34:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
1,3,5-Trimethylbenzene	1.4	1.0		µg/L	1	7/13/2006 6:34:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
2-Butanone	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
2-Hexanone	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Acetone	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Benzene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Bromobenzene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Bromoform	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Bromomethane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607065
Project: Rowe Industries
Lab ID: 0607065-06A

Client Sample ID: FRW3 070706
Tag Number: 10271
Collection Date: 7/7/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11						
Chloroethane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Chloroform	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Chloromethane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
cis-1,2-Dichloroethene	46	1.0		µg/L	1	7/13/2006 6:34:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Dibromomethane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Isopropylbenzene	4.4	1.0		µg/L	1	7/13/2006 6:34:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/13/2006 6:34:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Methylene chloride	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Naphthalene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
o-Xylene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Styrene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Tetrachloroethene	550	1.0		µg/L	1	7/13/2006 6:34:00 PM
Toluene	190	1.0		µg/L	1	7/13/2006 6:34:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Trichloroethene	16	1.0		µg/L	1	7/13/2006 6:34:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/13/2006 6:34:00 PM
Vinyl chloride	4.0	1.0		µg/L	1	7/13/2006 6:34:00 PM

Analyst: LDS

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 18-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607065
Project: Rowe Industries
Lab ID: 0607065-07A

Client Sample ID: FRW4 070706
Tag Number: 10271
Collection Date: 7/7/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11						
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
2-Butanone	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
2-Hexanone	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Acetone	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Benzene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Bromobenzene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Bromoform	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Bromomethane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.


Date: 18-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607065
Project: Rowe Industries
Lab ID: 0607065-07A

Client Sample ID: FRW4 070706
Tag Number: 10271
Collection Date: 7/7/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Chloroform	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Chloromethane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Dibromomethane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/13/2006 7:11:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Methylene chloride	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Naphthalene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
o-Xylene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Styrene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Tetrachloroethene	19	1.0		µg/L	1	7/13/2006 7:11:00 PM
Toluene	14	1.0		µg/L	1	7/13/2006 7:11:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Trichloroethene	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/13/2006 7:11:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/13/2006 7:11:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

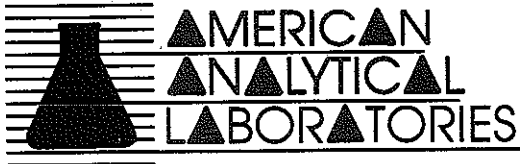

NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Monday, July 17, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484
TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0607121

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 7 sample(s) on 7/14/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

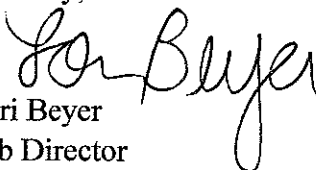
Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 18-Jul-06

CLIENT: Leggette Brashears & Graham Inc.**Project:** Rowe Industries**Lab Order:** 0607121**Work Order Sample Summary**

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0607121-01A	PRE 071306	10272	7/13/2006	7/14/2006
0607121-02A	MID 071306	10272	7/13/2006	7/14/2006
0607121-03A	POST 071306	10272	7/13/2006	7/14/2006
0607121-04A	FRW1 071306	10272	7/13/2006	7/14/2006
0607121-05A	FRW2 071306	10272	7/13/2006	7/14/2006
0607121-06A	FRW3 071306	10272	7/13/2006	7/14/2006
0607121-07A	FRW4 071306	10272	7/13/2006	7/14/2006



56 TOLEDO STREET • FARMINGDALE, NEW YORK 11735
(631) 454-6100 • FAX (631) 454-8027

NYS DC 11418
CTDOH, PH-0205
NJ DEP NY050
PA DEP 68-573

TAG # / COC 10272

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

CLIENT NAME/ADDRESS LBS 4 Research Dr. Shelton, CT		CONTACT: Mark Goldberg		SAMPLER (SIGNATURE) 		SAMPLE(S) SEALED YES / NO YES	
PROJECT LOCATION: Rowe		SAMPLER NAME (PRINT) Robert Drew		CORRECT CONTAINER(S) YES / NO YES		FOR METHANOL PRESERVED SAMPLES [VOLATILE VIAL #]	
LABORATORY ID #	MATRIX	# CONTAINERS	SAMPLING DATE/TIME	SAMPLE # - LOCATION		ANALYSIS REQUIRED 8260 MT 88 7/13/06	
0607121-1A	L	2	7-13-06	Pre: 071306		X	X
2A	L	1		Mid: 071306		X	X
3A	L	1		Post: 071306		X	X
4A	L	1		FRW1: 071306		X	X
5A	L	1		FRW2: 071306		X	X
6A	L	1		FRW3: 071306		X	X
7A	L	1		FRW4: 071306		X	X
COOLER TEMPERATURE:							
COMMENTS / INSTRUCTIONS							
TURNAROUND REQUIRED: NORMAL <input checked="" type="checkbox"/> STAT <input type="checkbox"/> BY 1/1							
RELINQUISHED BY (SIGNATURE) 		DATE 7-13-06 TIME 1700		RECEIVED BY LAB (SIGNATURE) 		DATE 7-13-06 TIME 1710	
RELINQUISHED BY (SIGNATURE)		DATE TIME		RECEIVED BY LAB (SIGNATURE)		DATE TIME	
WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT							

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ul style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 17-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607121
Project: Rowe Industries
Lab ID: 0607121-01A

Client Sample ID: PRE 071306
Tag Number: 10272
Collection Date: 7/13/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
2-Butanone	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
2-Hexanone	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Acetone	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Benzene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Bromobenzene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Bromoform	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Bromomethane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM

Qualifiers:
 B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit
 U Indicates the compound was analyzed for but not detected

E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits
 X Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 17-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607121
Project: Rowe Industries
Lab ID: 0607121-01A

Client Sample ID: PRE 071306
Tag Number: 10272
Collection Date: 7/13/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Chloroform	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Chloromethane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
cis-1,2-Dichloroethene	21	1.0		µg/L	1	7/14/2006 5:30:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Dibromomethane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/14/2006 5:30:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Methylene chloride	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Naphthalene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
o-Xylene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Styrene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Tetrachloroethene	180	1.0		µg/L	1	7/14/2006 5:30:00 PM
Toluene	220	1.0		µg/L	1	7/14/2006 5:30:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Trichloroethene	4.0	1.0		µg/L	1	7/14/2006 5:30:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/14/2006 5:30:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/14/2006 5:30:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 17-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607121
Project: Rowe Industries
Lab ID: 0607121-02A

Client Sample ID: MID 071306
Tag Number: 10272
Collection Date: 7/13/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
2-Butanone	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
2-Hexanone	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Acetone	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Benzene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Bromobenzene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Bromoform	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Bromomethane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 17-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607121
Project: Rowe Industries
Lab ID: 0607121-02A

Client Sample ID: MID 071306
Tag Number: 10272
Collection Date: 7/13/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A	Analyst: LDS	
Chloroethane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Chloroform	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Chloromethane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
cis-1,2-Dichloroethene	1.9	1.0		µg/L	1	7/14/2006 6:07:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Dibromomethane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/14/2006 6:07:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Methylene chloride	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Naphthalene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
o-Xylene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Styrene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Tetrachloroethene	30	1.0		µg/L	1	7/14/2006 6:07:00 PM
Toluene	19	1.0		µg/L	1	7/14/2006 6:07:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Trichloroethene	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/14/2006 6:07:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/14/2006 6:07:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 17-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607121
Project: Rowe Industries
Lab ID: 0607121-03A

Client Sample ID: POST 071306
Tag Number: 10272
Collection Date: 7/13/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
2-Butanone	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
2-Hexanone	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Acetone	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Benzene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Bromobenzene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Bromoform	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Bromomethane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 17-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607121
Project: Rowe Industries
Lab ID: 0607121-03A

Client Sample ID: POST 071306
Tag Number: 10272
Collection Date: 7/13/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Chloroform	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Chloromethane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Dibromomethane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/14/2006 6:44:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Methylene chloride	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Naphthalene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
o-Xylene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Styrene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Tetrachloroethene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Toluene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Trichloroethene	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/14/2006 6:44:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/14/2006 6:44:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 17-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607121
Project: Rowe Industries
Lab ID: 0607121-04A

Client Sample ID: FRW1 071306
Tag Number: 10272
Collection Date: 7/13/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
2-Butanone	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
2-Hexanone	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Acetone	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Benzene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Bromobenzene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Bromoform	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Bromomethane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 17-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607121
Project: Rowe Industries
Lab ID: 0607121-04A

Client Sample ID: FRW1 071306
Tag Number: 10272
Collection Date: 7/13/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Chloroform	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Chloromethane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
cis-1,2-Dichloroethene	1.1	1.0		µg/L	1	7/14/2006 7:21:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Dibromomethane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/14/2006 7:21:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Methylene chloride	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Naphthalene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
o-Xylene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Styrene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Tetrachloroethene	120	1.0		µg/L	1	7/14/2006 7:21:00 PM
Toluene	5.6	1.0		µg/L	1	7/14/2006 7:21:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Trichloroethene	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/14/2006 7:21:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/14/2006 7:21:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 17-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607121
Project: Rowe Industries
Lab ID: 0607121-05A

Client Sample ID: FRW2 071306
Tag Number: 10272
Collection Date: 7/13/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
2-Butanone	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
2-Hexanone	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Acetone	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Benzene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Bromobenzene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Bromoform	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Bromomethane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 17-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607121
Project: Rowe Industries
Lab ID: 0607121-05A

Client Sample ID: FRW2 071306
Tag Number: 10272
Collection Date: 7/13/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Chloroform	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Chloromethane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
cis-1,2-Dichloroethene	10	1.0		µg/L	1	7/14/2006 7:58:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Dibromomethane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/14/2006 7:58:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Methylene chloride	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Naphthalene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
o-Xylene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Styrene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Tetrachloroethene	64	1.0		µg/L	1	7/14/2006 7:58:00 PM
Toluene	630	1.0		µg/L	1	7/14/2006 7:58:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Trichloroethene	2.6	1.0		µg/L	1	7/14/2006 7:58:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/14/2006 7:58:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/14/2006 7:58:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 17-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607121
Project: Rowe Industries
Lab ID: 0607121-06A

Client Sample ID: FRW3 071306
Tag Number: 10272
Collection Date: 7/13/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
2-Butanone	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
2-Hexanone	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Acetone	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Benzene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Bromobenzene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Bromoform	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Bromomethane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 17-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607121
Project: Rowe Industries
Lab ID: 0607121-06A

Client Sample ID: FRW3 071306
Tag Number: 10272
Collection Date: 7/13/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Chloroform	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Chloromethane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
cis-1,2-Dichloroethene	46	1.0		µg/L	1	7/14/2006 8:35:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Dibromomethane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/14/2006 8:35:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Methylene chloride	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Naphthalene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
o-Xylene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Styrene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Tetrachloroethene	330	1.0		µg/L	1	7/14/2006 8:35:00 PM
Toluene	140	1.0		µg/L	1	7/14/2006 8:35:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Trichloroethene	4.7	1.0		µg/L	1	7/14/2006 8:35:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/14/2006 8:35:00 PM
Vinyl chloride	3.7	1.0		µg/L	1	7/14/2006 8:35:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 17-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607121
Project: Rowe Industries
Lab ID: 0607121-07A

Client Sample ID: FRW4 071306
Tag Number: 10272
Collection Date: 7/13/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
2-Butanone	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
2-Hexanone	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Acetone	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Benzene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Bromobenzene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Bromoform	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Bromomethane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.


Date: 17-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607121
Project: Rowe Industries
Lab ID: 0607121-07A

Client Sample ID: FRW4 071306
Tag Number: 10272
Collection Date: 7/13/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Chloroform	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Chloromethane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Dibromomethane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/14/2006 9:12:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Methylene chloride	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Naphthalene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
o-Xylene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Styrene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Tetrachloroethene	3.4	1.0		µg/L	1	7/14/2006 9:12:00 PM
Toluene	10	1.0		µg/L	1	7/14/2006 9:12:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Trichloroethene	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/14/2006 9:12:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/14/2006 9:12:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

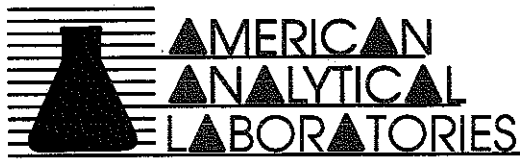

NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Monday, July 24, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484
TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe FP &T

Order No.: 0607172

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 5 sample(s) on 7/20/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

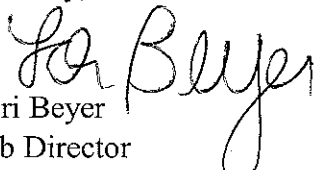
Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 24-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe FP &T
Lab Order: 0607172

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0607172-01A	PRE 072006	10770	7/20/2006	7/20/2006
0607172-02A	FRW1 072006	10770	7/20/2006	7/20/2006
0607172-03A	FRW2 072006	10770	7/20/2006	7/20/2006
0607172-04A	FRW3 072006	10770	7/20/2006	7/20/2006
0607172-05A	FRW4 072006	10770	7/20/2006	7/20/2006

TAG # / COC 10770

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ul style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 24-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607172
Project: Rowe FP &T
Lab ID: 0607172-01A

Client Sample ID: PRE 072006
Tag Number: 10770
Collection Date: 7/20/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
2-Butanone	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
2-Hexanone	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Acetone	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Benzene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Bromobenzene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Bromoform	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Bromomethane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 24-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607172
Project: Rowe FP &T
Lab ID: 0607172-01A

Client Sample ID: PRE 072006
Tag Number: 10770
Collection Date: 7/20/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Chloroform	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Chloromethane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
cis-1,2-Dichloroethene	19	1.0		µg/L	1	7/21/2006 12:47:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Dibromomethane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/21/2006 12:47:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Methylene chloride	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Naphthalene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
o-Xylene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Styrene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Tetrachloroethene	64	1.0		µg/L	1	7/21/2006 12:47:00 PM
Toluene	250	1.0		µg/L	1	7/21/2006 12:47:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Trichloroethene	3.3	1.0		µg/L	1	7/21/2006 12:47:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/21/2006 12:47:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/21/2006 12:47:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 24-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607172
Project: Rowe FP &T
Lab ID: 0607172-02A

Client Sample ID: FRW1 072006
Tag Number: 10770
Collection Date: 7/20/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
2-Butanone	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
2-Hexanone	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Acetone	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Benzene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Bromobenzene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Bromoform	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Bromomethane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 24-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607172
Project: Rowe FP &T
Lab ID: 0607172-02A

Client Sample ID: FRW1 072006
Tag Number: 10770
Collection Date: 7/20/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Chloroform	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Chloromethane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
cis-1,2-Dichloroethene	31	1.0		µg/L	1	7/21/2006 1:28:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Dibromomethane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/21/2006 1:28:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Methylene chloride	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Naphthalene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
o-Xylene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Styrene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Tetrachloroethene	75	1.0		µg/L	1	7/21/2006 1:28:00 PM
Toluene	8.7	1.0		µg/L	1	7/21/2006 1:28:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Trichloroethene	3.5	1.0		µg/L	1	7/21/2006 1:28:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/21/2006 1:28:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/21/2006 1:28:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 24-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607172
Project: Rowe FP &T
Lab ID: 0607172-03A

Client Sample ID: FRW2 072006
Tag Number: 10770
Collection Date: 7/20/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
2-Butanone	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
2-Hexanone	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Acetone	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Benzene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Bromobenzene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Bromoform	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Bromomethane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 24-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607172
Project: Rowe FP &T
Lab ID: 0607172-03A

Client Sample ID: FRW2 072006
Tag Number: 10770
Collection Date: 7/20/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Chloroform	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Chloromethane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
cis-1,2-Dichloroethene	9.4	1.0		µg/L	1	7/21/2006 2:10:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Dibromomethane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/21/2006 2:10:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Methylene chloride	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Naphthalene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
o-Xylene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Styrene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Tetrachloroethene	14	1.0		µg/L	1	7/21/2006 2:10:00 PM
Toluene	430	1.0		µg/L	1	7/21/2006 2:10:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Trichloroethene	1.2	1.0		µg/L	1	7/21/2006 2:10:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/21/2006 2:10:00 PM
Vinyl chloride	1.1	1.0		µg/L	1	7/21/2006 2:10:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 24-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607172
Project: Rowe FP &T
Lab ID: 0607172-04A

Client Sample ID: FRW3 072006
Tag Number: 10770
Collection Date: 7/20/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
2-Butanone	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
2-Hexanone	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Acetone	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Benzene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Bromobenzene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Bromoform	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Bromomethane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 24-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607172
Project: Rowe FP &T
Lab ID: 0607172-04A

Client Sample ID: FRW3 072006
Tag Number: 10770
Collection Date: 7/20/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Chloroform	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Chloromethane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
cis-1,2-Dichloroethene	43	1.0		µg/L	1	7/21/2006 2:51:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Dibromomethane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/21/2006 2:51:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Methylene chloride	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Naphthalene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
o-Xylene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Styrene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Tetrachloroethene	310	1.0		µg/L	1	7/21/2006 2:51:00 PM
Toluene	170	1.0		µg/L	1	7/21/2006 2:51:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Trichloroethene	5.4	1.0		µg/L	1	7/21/2006 2:51:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/21/2006 2:51:00 PM
Vinyl chloride	5.5	1.0		µg/L	1	7/21/2006 2:51:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 24-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607172
Project: Rowe FP &T
Lab ID: 0607172-05A

Client Sample ID: FRW4 072006
Tag Number: 10770
Collection Date: 7/20/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
2-Butanone	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
2-Hexanone	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Acetone	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Benzene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Bromobenzene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Bromoform	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Bromomethane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 24-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607172
Project: Rowe FP &T
Lab ID: 0607172-05A

Client Sample ID: FRW4 072006
Tag Number: 10770
Collection Date: 7/20/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Chloroform	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Chloromethane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Dibromomethane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/21/2006 3:32:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Methylene chloride	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Naphthalene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
o-Xylene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Styrene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Tetrachloroethene	4.2	1.0		µg/L	1	7/21/2006 3:32:00 PM
Toluene	7.9	1.0		µg/L	1	7/21/2006 3:32:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Trichloroethene	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/21/2006 3:32:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/21/2006 3:32:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Thursday, July 20, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe FP & T

Order No.: 0607171

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 2 sample(s) on 7/20/2006 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 20-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe FP & T
Lab Order: 0607171

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0607171-01A	MID 072006	10770	7/20/2006	7/20/2006
0607171-02A	POST 072006	10770	7/20/2006	7/20/2006

TAG # / COC

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ul style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 20-Jul-06

CLIENT: Leggett Brashears & Graham Inc.

Client Sample ID: MID 072006

Lab Order: 0607171

Tag Number: 10770

Project: Rowe FP & T

Collection Date: 7/20/2006

Lab ID: 0607171-01A

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
2-Butanone	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
2-Hexanone	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Acetone	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Benzene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Bromobenzene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Bromoform	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Bromomethane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM

Qualifiers: B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits
X Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 20-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607171
Project: Rowe FP & T
Lab ID: 0607171-01A

Client Sample ID: MID 072006
Tag Number: 10770
Collection Date: 7/20/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Chloroform	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Chloromethane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Dibromomethane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/20/2006 1:59:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Methylene chloride	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Naphthalene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
o-Xylene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Styrene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Tetrachloroethene	3.8	1.0		µg/L	1	7/20/2006 1:59:00 PM
Toluene	12	1.0		µg/L	1	7/20/2006 1:59:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Trichloroethene	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/20/2006 1:59:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/20/2006 1:59:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 20-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607171
Project: Rowe FP & T
Lab ID: 0607171-02A

Client Sample ID: POST 072006
Tag Number: 10770
Collection Date: 7/20/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
2-Butanone	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
2-Hexanone	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Acetone	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Benzene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Bromobenzene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Bromoform	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Bromomethane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 20-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607171
Project: Rowe FP & T
Lab ID: 0607171-02A

Client Sample ID: POST 072006
Tag Number: 10770
Collection Date: 7/20/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Chloroform	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Chloromethane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Dibromomethane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/20/2006 2:36:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Methylene chloride	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Naphthalene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
o-Xylene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Styrene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Tetrachloroethene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Toluene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Trichloroethene	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/20/2006 2:36:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/20/2006 2:36:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Friday, July 28, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0607241

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 5 sample(s) on 7/27/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,


Lori Beyer
Lab Director

American Analytical Laboratories, LLC.**Date:** 28-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0607241

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0607241-01A	PRE 072706	10846	7/27/2006	7/27/2006
0607241-02A	FRW1 072706	10846	7/27/2006	7/27/2006
0607241-03A	FRW2 072706	10846	7/27/2006	7/27/2006
0607241-04A	FRW3 072706	10846	7/27/2006	7/27/2006
0607241-05A	FRW4 072706	10846	7/27/2006	7/27/2006

56 TOLEDO STREET • FARMINGDALE, NEW YORK 11735
(631) 454-6100 • FAX (631) 454-8027

TAG # / COC

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100

FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ol style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 28-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607241
Project: Rowe Industries
Lab ID: 0607241-01A

Client Sample ID: PRE 072706
Tag Number: 10846
Collection Date: 7/27/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
2-Butanone	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
2-Hexanone	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Acetone	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Benzene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Bromobenzene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Bromoform	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Bromomethane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM

Qualifiers:
 B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit
 U Indicates the compound was analyzed for but not detected

E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits
 X Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 28-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607241
Project: Rowe Industries
Lab ID: 0607241-01A

Client Sample ID: PRE 072706
Tag Number: 10846
Collection Date: 7/27/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Chloroform	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Chloromethane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
cis-1,2-Dichloroethene	20	1.0		µg/L	1	7/27/2006 11:28:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Dibromomethane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/27/2006 11:28:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Methylene chloride	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Naphthalene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
o-Xylene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Styrene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Tetrachloroethene	120	1.0		µg/L	1	7/27/2006 11:28:00 PM
Toluene	320	1.0		µg/L	1	7/27/2006 11:28:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Trichloroethene	2.6	1.0		µg/L	1	7/27/2006 11:28:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/27/2006 11:28:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/27/2006 11:28:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 28-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607241
Project: Rowe Industries
Lab ID: 0607241-02A

Client Sample ID: FRW1 072706
Tag Number: 10846
Collection Date: 7/27/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
2-Butanone	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
2-Hexanone	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Acetone	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Benzene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Bromobenzene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Bromochloromethane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Bromodichloromethane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Bromoform	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Bromomethane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Carbon disulfide	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Chlorobenzene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 28-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607241
Project: Rowe Industries
Lab ID: 0607241-02A

Client Sample ID: FRW1 072706
Tag Number: 10846
Collection Date: 7/27/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Chloroform	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Chloromethane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Dibromochloromethane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Dibromomethane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Ethylbenzene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Isopropylbenzene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
m,p-Xylene	U	2.0		µg/L	1	7/28/2006 12:06:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Methylene chloride	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Naphthalene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
n-Butylbenzene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
n-Propylbenzene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
o-Xylene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Styrene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Tetrachloroethene	31	1.0		µg/L	1	7/28/2006 12:06:00 AM
Toluene	13	1.0		µg/L	1	7/28/2006 12:06:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Trichloroethene	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Vinyl acetate	U	1.0		µg/L	1	7/28/2006 12:06:00 AM
Vinyl chloride	U	1.0		µg/L	1	7/28/2006 12:06:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 28-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607241
Project: Rowe Industries
Lab ID: 0607241-03A

Client Sample ID: FRW2 072706
Tag Number: 10846
Collection Date: 7/27/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
2-Butanone	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
2-Hexanone	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Acetone	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Benzene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Bromobenzene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Bromochloromethane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Bromodichloromethane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Bromoform	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Bromomethane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Carbon disulfide	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Chlorobenzene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM

Qualifiers: B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits
X Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 28-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607241
Project: Rowe Industries
Lab ID: 0607241-03A

Client Sample ID: FRW2 072706
Tag Number: 10846
Collection Date: 7/27/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Chloroform	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Chloromethane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
cis-1,2-Dichloroethene	10	1.0		µg/L	1	7/28/2006 12:42:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Dibromochloromethane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Dibromomethane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Ethylbenzene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Isopropylbenzene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
m,p-Xylene	U	2.0		µg/L	1	7/28/2006 12:42:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Methylene chloride	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Naphthalene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
n-Butylbenzene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
n-Propylbenzene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
o-Xylene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Styrene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Tetrachloroethene	20	1.0		µg/L	1	7/28/2006 12:42:00 AM
Toluene	1100	1.0		µg/L	1	7/28/2006 12:42:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Trichloroethene	1.5	1.0		µg/L	1	7/28/2006 12:42:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Vinyl acetate	U	1.0		µg/L	1	7/28/2006 12:42:00 AM
Vinyl chloride	U	1.0		µg/L	1	7/28/2006 12:42:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 28-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607241
Project: Rowe Industries
Lab ID: 0607241-04A

Client Sample ID: FRW3 072706
Tag Number: 10846
Collection Date: 7/27/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
1,1,1-Trichloroethane	2.0	1.0		µg/L	1	7/28/2006 1:19:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
1,2,4-Trimethylbenzene	4.2	1.0		µg/L	1	7/28/2006 1:19:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
2-Butanone	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
2-Hexanone	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Acetone	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Benzene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Bromobenzene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Bromochloromethane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Bromodichloromethane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Bromoform	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Bromomethane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Carbon disulfide	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Chlorobenzene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 28-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607241
Project: Rowe Industries
Lab ID: 0607241-04A

Client Sample ID: FRW3 072706
Tag Number: 10846
Collection Date: 7/27/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Chloroform	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Chloromethane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
cis-1,2-Dichloroethene	55	1.0		µg/L	1	7/28/2006 1:19:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Dibromochloromethane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Dibromomethane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Ethylbenzene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Isopropylbenzene	5.1	1.0		µg/L	1	7/28/2006 1:19:00 AM
m,p-Xylene	U	2.0		µg/L	1	7/28/2006 1:19:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Methylene chloride	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Naphthalene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
n-Butylbenzene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
n-Propylbenzene	2.6	1.0		µg/L	1	7/28/2006 1:19:00 AM
o-Xylene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
sec-Butylbenzene	2.9	1.0		µg/L	1	7/28/2006 1:19:00 AM
Styrene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Tetrachloroethene	500	1.0		µg/L	1	7/28/2006 1:19:00 AM
Toluene	270	1.0		µg/L	1	7/28/2006 1:19:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Trichloroethene	12	1.0		µg/L	1	7/28/2006 1:19:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Vinyl acetate	U	1.0		µg/L	1	7/28/2006 1:19:00 AM
Vinyl chloride	5.0	1.0		µg/L	1	7/28/2006 1:19:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 28-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607241
Project: Rowe Industries
Lab ID: 0607241-05A

Client Sample ID: FRW4 072706
Tag Number: 10846
Collection Date: 7/27/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
2-Butanone	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
2-Hexanone	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Acetone	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Benzene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Bromobenzene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Bromochloromethane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Bromodichloromethane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Bromoform	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Bromomethane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Carbon disulfide	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Chlorobenzene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 28-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607241
Project: Rowe Industries
Lab ID: 0607241-05A

Client Sample ID: FRW4 072706
Tag Number: 10846
Collection Date: 7/27/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Chloroform	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Chloromethane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Dibromochloromethane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Dibromomethane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Ethylbenzene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Isopropylbenzene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
m,p-Xylene	U	2.0		µg/L	1	7/28/2006 1:56:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Methylene chloride	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Naphthalene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
n-Butylbenzene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
n-Propylbenzene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
o-Xylene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Styrene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Tetrachloroethene	6.4	1.0		µg/L	1	7/28/2006 1:56:00 AM
Toluene	12	1.0		µg/L	1	7/28/2006 1:56:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Trichloroethene	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Vinyl acetate	U	1.0		µg/L	1	7/28/2006 1:56:00 AM
Vinyl chloride	U	1.0		µg/L	1	7/28/2006 1:56:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Friday, July 28, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555

FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0607240

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 2 sample(s) on 7/27/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,


Lori Beyer
Lab Director

American Analytical Laboratories, LLC.**Date:** 28-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0607240

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0607240-01A	MID 072706	10846	7/27/2006	7/27/2006
0607240-02A	POST 072706	10846	7/27/2006	7/27/2006

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ol style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 28-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607240
Project: Rowe Industries
Lab ID: 0607240-01A

Client Sample ID: MID 072706
Tag Number: 10846
Collection Date: 7/27/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
2-Butanone	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
2-Hexanone	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Acetone	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Benzene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Bromobenzene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Bromoform	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Bromomethane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 28-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607240
Project: Rowe Industries
Lab ID: 0607240-01A

Client Sample ID: MID 072706
Tag Number: 10846
Collection Date: 7/27/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Chloroform	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Chloromethane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
cis-1,2-Dichloroethene	3.5	1.0		µg/L	1	7/27/2006 7:10:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Dibromomethane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/27/2006 7:10:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Methylene chloride	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Naphthalene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
o-Xylene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Styrene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Tetrachloroethene	17	1.0		µg/L	1	7/27/2006 7:10:00 PM
Toluene	57	1.0		µg/L	1	7/27/2006 7:10:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Trichloroethene	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/27/2006 7:10:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/27/2006 7:10:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 28-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607240
Project: Rowe Industries
Lab ID: 0607240-02A

Client Sample ID: POST 072706
Tag Number: 10846
Collection Date: 7/27/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
2-Butanone	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
2-Hexanone	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Acetone	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Benzene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Bromobenzene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Bromoform	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Bromomethane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.


Date: 28-Jul-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607240
Project: Rowe Industries
Lab ID: 0607240-02A

Client Sample ID: POST 072706
Tag Number: 10846
Collection Date: 7/27/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Chloroform	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Chloromethane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Dibromomethane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/27/2006 7:48:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Methylene chloride	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Naphthalene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
o-Xylene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Styrene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Tetrachloroethene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Toluene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Trichloroethene	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/27/2006 7:48:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/27/2006 7:48:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

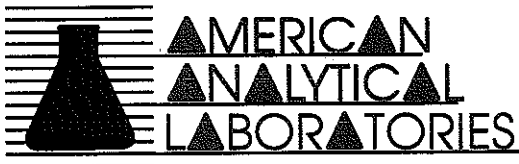

NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Tuesday, August 01, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555

FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0607270

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 1 sample(s) on 7/31/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,


Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 01-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0607270

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0607270-01A	PRE 073106	10852	7/31/2006	7/31/2006

TAG # / COC

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ol style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 01-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607270
Project: Rowe Industries
Lab ID: 0607270-01A

Client Sample ID: PRE 073106
Tag Number: 10852
Collection Date: 7/31/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
2-Butanone	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
2-Hexanone	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Acetone	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Benzene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Bromobenzene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Bromoform	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Bromomethane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.


Date: 01-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607270
Project: Rowe Industries
Lab ID: 0607270-01A

Client Sample ID: PRE 073106
Tag Number: 10852
Collection Date: 7/31/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Chloroform	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Chloromethane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
cis-1,2-Dichloroethene	17	1.0		µg/L	1	7/31/2006 8:48:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Dibromomethane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/31/2006 8:48:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Methylene chloride	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Naphthalene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
o-Xylene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Styrene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Tetrachloroethene	110	1.0		µg/L	1	7/31/2006 8:48:00 PM
Toluene	180	1.0		µg/L	1	7/31/2006 8:48:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Trichloroethene	1.9	1.0		µg/L	1	7/31/2006 8:48:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/31/2006 8:48:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/31/2006 8:48:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

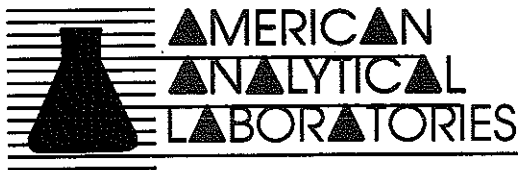

NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Tuesday, August 01, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0607269

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 2 sample(s) on 7/31/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,


Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 01-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0607269

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0607269-01A	MID 073106	10852	7/31/2006	7/31/2006
0607269-02A	POST 073106	10852	7/31/2006	7/31/2006

CLIENT NAME/ADDRESS

CONTACT:

LB5
4 Research A.
Shelton, CT

Merch
S. 11 by

~~SAMPLER (SIGNATURE)~~

SAMPLER NAME (PRINT)

PRINT) Rob Drew

**SAMPLE(S)
SEALED**

☒ YES / NO

CORRECT
CONTAINER(S)

☒ YES / NO

PROJECT LOCATION:

ANALYSIS
REQUIRED

FOR
METHANOL PRESERVED
SAMPLES
[VOLATILE VIAL #]

[illegible]

COOLER TEMPERATURE:

MATRIX S=SOIL; L=LIQUID; SL=SLUDGE; A-AIR; W=WIPE; P=PAINT CHIPS; B=BULK MATERIAL

TURNAROUND REQUIRED:

COMMENTS / INSTRUCTIONS

TYPE G=GRAB; C=COMPOSITE, SS=SPLIT SPOON

RELINQUISHED BY (SIGNATURE)

PRINTED NAME _____

DATE 7-31-06

PRINTED NAME Rob Drew

RECEIVED BY LAB (SIGNATURE)

DATE 3/1/11 PRINTED NAME _____

RELINQUISHED BY (SIGNATURE)

PRINTED NAME

DATE	TIME
------	------

PRINTED NAME

RECEIVED BY LAB (SIGNATURE)

DATE	PRINTED NAME
------	--------------

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ol style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 01-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607269
Project: Rowe Industries
Lab ID: 0607269-01A

Client Sample ID: MID 073106
Tag Number: 10852
Collection Date: 7/31/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
2-Butanone	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
2-Hexanone	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Acetone	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Benzene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Bromobenzene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Bromoform	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Bromomethane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 01-Aug-06

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: MID 073106

Lab Order: 0607269

Tag Number: 10852

Project: Rowe Industries

Collection Date: 7/31/2006

Lab ID: 0607269-01A

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Chloroform	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Chloromethane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
cis-1,2-Dichloroethene	4.3	1.0		µg/L	1	7/31/2006 7:34:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Dibromomethane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/31/2006 7:34:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Methylene chloride	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Naphthalene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
o-Xylene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Styrene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Tetrachloroethene	22	1.0		µg/L	1	7/31/2006 7:34:00 PM
Toluene	18	1.0		µg/L	1	7/31/2006 7:34:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Trichloroethene	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/31/2006 7:34:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/31/2006 7:34:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 01-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607269
Project: Rowe Industries
Lab ID: 0607269-02A

Client Sample ID: POST 073106
Tag Number: 10852
Collection Date: 7/31/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
2-Butanone	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
2-Hexanone	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Acetone	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Benzene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Bromobenzene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Bromoform	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Bromomethane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 01-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0607269
Project: Rowe Industries
Lab ID: 0607269-02A

Client Sample ID: POST 073106
Tag Number: 10852
Collection Date: 7/31/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Chloroform	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Chloromethane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Dibromomethane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/31/2006 8:12:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Methylene chloride	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Naphthalene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
o-Xylene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Styrene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Tetrachloroethene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Toluene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Trichloroethene	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/31/2006 8:12:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/31/2006 8:12:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

Friday, August 11, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0608116

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 2 sample(s) on 8/10/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,



Lori Beyer
Lab Director

American Analytical Laboratories, LLC.**Date:** 11-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0608116

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0608116-01A	Pre: 080806	10275	8/8/2006	8/10/2006
0608116-02A	Mid: 080806	10275	8/8/2006	8/10/2006

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-I AB / PINK-SAMPLE CUSTODIAN / CO-RENDER CUSTODIAN

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ol style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 11-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608116
Project: Rowe Industries
Lab ID: 0608116-01A

Client Sample ID: Pre: 080806
Tag Number: 10275
Collection Date: 8/8/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
2-Butanone	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
2-Hexanone	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Acetone	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Benzene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Bromobenzene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Bromochloromethane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Bromodichloromethane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Bromoform	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Bromomethane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Carbon disulfide	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Chlorobenzene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 11-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608116
Project: Rowe Industries
Lab ID: 0608116-01A

Client Sample ID: Pre: 080806
Tag Number: 10275
Collection Date: 8/8/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Chloroform	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Chloromethane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
cis-1,2-Dichloroethene	25	1.0		µg/L	1	8/11/2006 11:09:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Dibromochloromethane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Dibromomethane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Ethylbenzene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Isopropylbenzene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
m,p-Xylene	U	2.0		µg/L	1	8/11/2006 11:09:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Methylene chloride	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Naphthalene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
n-Butylbenzene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
n-Propylbenzene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
o-Xylene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Styrene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Tetrachloroethene	98	1.0		µg/L	1	8/11/2006 11:09:00 AM
Toluene	260	1.0		µg/L	1	8/11/2006 11:09:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Trichloroethene	2.8	1.0		µg/L	1	8/11/2006 11:09:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Vinyl acetate	U	1.0		µg/L	1	8/11/2006 11:09:00 AM
Vinyl chloride	U	1.0		µg/L	1	8/11/2006 11:09:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 11-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608116
Project: Rowe Industries
Lab ID: 0608116-02A

Client Sample ID: Mid: 080806
Tag Number: 10275
Collection Date: 8/8/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B	SW5030A	Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
2-Butanone	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
2-Hexanone	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Acetone	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Benzene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Bromobenzene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Bromochloromethane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Bromodichloromethane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Bromoform	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Bromomethane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Carbon disulfide	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Chlorobenzene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.


Date: 11-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608116
Project: Rowe Industries
Lab ID: 0608116-02A

Client Sample ID: Mid: 080806
Tag Number: 10275
Collection Date: 8/8/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Chloroform	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Chloromethane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Dibromochloromethane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Dibromomethane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Ethylbenzene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Isopropylbenzene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
m,p-Xylene	U	2.0		µg/L	1	8/11/2006 7:30:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Methylene chloride	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Naphthalene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
n-Butylbenzene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
n-Propylbenzene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
o-Xylene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Styrene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Tetrachloroethene	7.4	1.0		µg/L	1	8/11/2006 7:30:00 AM
Toluene	15	1.0		µg/L	1	8/11/2006 7:30:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Trichloroethene	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Vinyl acetate	U	1.0		µg/L	1	8/11/2006 7:30:00 AM
Vinyl chloride	U	1.0		µg/L	1	8/11/2006 7:30:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

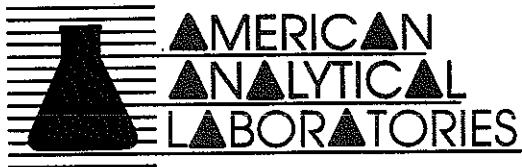

NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Friday, August 11, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484
TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0608115

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 1 sample(s) on 8/10/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,


Lori Beyer
Lab Director

American Analytical Laboratories, LLC.**Date:** 11-Aug-06**CLIENT:** Leggette Brashears & Graham Inc.**Project:** Rowe Industries**Lab Order:** 0608115**Work Order Sample Summary**

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0608115-01A	Post: 080806	10275	8/8/2006	8/10/2006

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ul style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 11-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608115
Project: Rowe Industries
Lab ID: 0608115-01A

Client Sample ID: Post: 080806
Tag Number: 10275
Collection Date: 8/8/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B	SW5030A	Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
2-Butanone	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
2-Hexanone	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Acetone	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Benzene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Bromobenzene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Bromochloromethane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Bromodichloromethane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Bromoform	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Bromomethane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Carbon disulfide	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Chlorobenzene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.


Date: 11-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608115
Project: Rowe Industries
Lab ID: 0608115-01A

Client Sample ID: Post: 080806
Tag Number: 10275
Collection Date: 8/8/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B	SW5030A			Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Chloroform	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Chloromethane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Dibromochloromethane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Dibromomethane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Ethylbenzene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Isopropylbenzene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
m,p-Xylene	U	2.0		µg/L	1	8/11/2006 6:17:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Methylene chloride	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Naphthalene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
n-Butylbenzene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
n-Propylbenzene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
o-Xylene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Styrene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Tetrachloroethene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Toluene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Trichloroethene	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Vinyl acetate	U	1.0		µg/L	1	8/11/2006 6:17:00 AM
Vinyl chloride	U	1.0		µg/L	1	8/11/2006 6:17:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

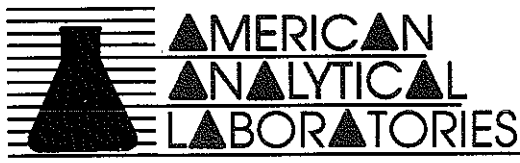

NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Monday, August 21, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0608182

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 2 sample(s) on 8/16/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

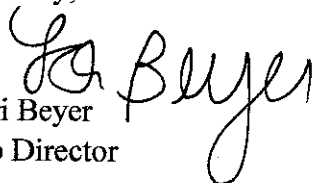
Lori Beyer
Lab Director

American Analytical Laboratories, LLC.**Date:** 21-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0608182

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0608182-01A	PRE:081606	10982	8/16/2006	8/16/2006
0608182-02A	MID:081606	10982	8/16/2006	8/16/2006

56 TOLEDO STREET • FARMINGDALE, NEW YORK 11735
(631) 454-6100 • FAX (631) 454-8027

TAG # / COC

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100

FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ul style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 21-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608182
Project: Rowe Industries
Lab ID: 0608182-01A

Client Sample ID: PRE:081606
Tag Number: 10982
Collection Date: 8/16/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
2-Butanone	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
2-Hexanone	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Acetone	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Benzene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Bromobenzene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Bromochloromethane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Bromodichloromethane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Bromoform	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Bromomethane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Carbon disulfide	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Chlorobenzene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 21-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608182
Project: Rowe Industries
Lab ID: 0608182-01A

Client Sample ID: PRE:081606
Tag Number: 10982
Collection Date: 8/16/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Chloroform	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Chloromethane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
cis-1,2-Dichloroethene	12	1.0		µg/L	1	8/19/2006 2:07:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Dibromochloromethane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Dibromomethane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Ethylbenzene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Isopropylbenzene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
m,p-Xylene	U	2.0		µg/L	1	8/19/2006 2:07:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Methylene chloride	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Naphthalene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
n-Butylbenzene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
n-Propylbenzene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
o-Xylene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Styrene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Tetrachloroethene	27	1.0		µg/L	1	8/19/2006 2:07:00 AM
Toluene	12	1.0		µg/L	1	8/19/2006 2:07:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Trichloroethene	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Vinyl acetate	U	1.0		µg/L	1	8/19/2006 2:07:00 AM
Vinyl chloride	U	1.0		µg/L	1	8/19/2006 2:07:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 21-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608182
Project: Rowe Industries
Lab ID: 0608182-02A

Client Sample ID: MID:081606
Tag Number: 10982
Collection Date: 8/16/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
2-Butanone	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
2-Hexanone	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Acetone	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Benzene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Bromobenzene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Bromochloromethane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Bromodichloromethane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Bromoform	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Bromomethane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Carbon disulfide	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Chlorobenzene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 21-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608182
Project: Rowe Industries
Lab ID: 0608182-02A

Client Sample ID: MID:081606
Tag Number: 10982
Collection Date: 8/16/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B	SW5030A	Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Chloroform	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Chloromethane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
cis-1,2-Dichloroethene	1.1	1.0		µg/L	1	8/19/2006 2:44:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Dibromochloromethane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Dibromomethane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Ethylbenzene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Isopropylbenzene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
m,p-Xylene	U	2.0		µg/L	1	8/19/2006 2:44:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Methylene chloride	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Naphthalene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
n-Butylbenzene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
n-Propylbenzene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
o-Xylene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Styrene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Tetrachloroethene	9.5	1.0		µg/L	1	8/19/2006 2:44:00 AM
Toluene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Trichloroethene	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Vinyl acetate	U	1.0		µg/L	1	8/19/2006 2:44:00 AM
Vinyl chloride	U	1.0		µg/L	1	8/19/2006 2:44:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Monday, August 21, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484
TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe Industries

Dear Mark Goldberg:

Order No.: 0608181

American Analytical Laboratories, LLC. received 1 sample(s) on 8/16/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

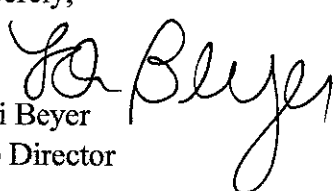
Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 21-Aug-06

CLIENT: Leggette Brashears & Graham Inc.**Project:** Rowe Industries**Lab Order:** 0608181**Work Order Sample Summary**

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0608181-01A	POST:081606	10982	8/16/2006	8/16/2006

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENBOD-C/LIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ol style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 21-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608181
Project: Rowe Industries
Lab ID: 0608181-01A

Client Sample ID: POST:081606
Tag Number: 10982
Collection Date: 8/16/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
2-Butanone	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
2-Hexanone	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Acetone	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Benzene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Bromobenzene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Bromochloromethane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Bromodichloromethane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Bromoform	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Bromomethane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Carbon disulfide	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Chlorobenzene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.


Date: 21-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608181
Project: Rowe Industries
Lab ID: 0608181-01A

Client Sample ID: POST:081606
Tag Number: 10982
Collection Date: 8/16/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11						
		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Chloroform	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Chloromethane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Dibromochloromethane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Dibromomethane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Ethylbenzene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Isopropylbenzene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
m,p-Xylene	U	2.0		µg/L	1	8/18/2006 10:18:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Methylene chloride	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Naphthalene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
n-Butylbenzene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
n-Propylbenzene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
o-Xylene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Styrene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Tetrachloroethene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Toluene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Trichloroethene	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Vinyl acetate	U	1.0		µg/L	1	8/18/2006 10:18:00 PM
Vinyl chloride	U	1.0		µg/L	1	8/18/2006 10:18:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

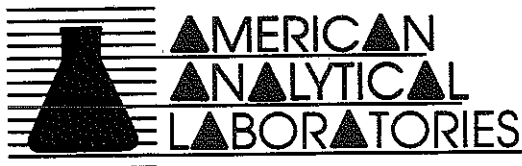

NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Friday, September 01, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555

FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0608261

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 6 sample(s) on 8/24/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,


Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 01-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0608261

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0608261-01A	PRE 082406	11006	8/24/2006	8/24/2006
0608261-02A	MID 082406	11006	8/24/2006	8/24/2006
0608261-03A	FRW 1 082406	11006	8/24/2006	8/24/2006
0608261-04A	FRW 2 082406	11006	8/24/2006	8/24/2006
0608261-05A	FRW 3 082406	11006	8/24/2006	8/24/2006
0608261-06A	FRW 4 082406	11006	8/24/2006	8/24/2006

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ol style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 01-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608261
Project: Rowe Industries
Lab ID: 0608261-01A

Client Sample ID: PRE 082406
Tag Number: 11006
Collection Date: 8/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
2-Butanone	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
2-Hexanone	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Acetone	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Benzene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Bromobenzene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Bromochloromethane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Bromodichloromethane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Bromoform	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Bromomethane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Carbon disulfide	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Chlorobenzene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM

Qualifiers:
 B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit
 U Indicates the compound was analyzed for but not detected

E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits
 X Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 01-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608261
Project: Rowe Industries
Lab ID: 0608261-01A

Client Sample ID: PRE 082406
Tag Number: 11006
Collection Date: 8/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Chloroform	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Chloromethane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
cis-1,2-Dichloroethene	14	1.0		µg/L	1	8/29/2006 1:12:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Dibromochloromethane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Dibromomethane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Ethylbenzene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Isopropylbenzene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
m,p-Xylene	U	2.0		µg/L	1	8/29/2006 1:12:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Methylene chloride	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Naphthalene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
n-Butylbenzene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
n-Propylbenzene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
o-Xylene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Styrene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Tetrachloroethene	22	1.0		µg/L	1	8/29/2006 1:12:00 AM
Toluene	140	1.0		µg/L	1	8/29/2006 1:12:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Trichloroethene	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Vinyl acetate	U	1.0		µg/L	1	8/29/2006 1:12:00 AM
Vinyl chloride	U	1.0		µg/L	1	8/29/2006 1:12:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 01-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608261
Project: Rowe Industries
Lab ID: 0608261-02A

Client Sample ID: MID 082406
Tag Number: 11006
Collection Date: 8/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
2-Butanone	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
2-Hexanone	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Acetone	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Benzene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Bromobenzene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Bromochloromethane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Bromodichloromethane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Bromoform	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Bromomethane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Carbon disulfide	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Chlorobenzene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 01-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608261
Project: Rowe Industries
Lab ID: 0608261-02A

Client Sample ID: MID 082406
Tag Number: 11006
Collection Date: 8/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Chloroform	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Chloromethane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
cis-1,2-Dichloroethene	3.7	1.0		µg/L	1	8/29/2006 1:51:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Dibromochloromethane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Dibromomethane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Ethylbenzene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Isopropylbenzene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
m,p-Xylene	U	2.0		µg/L	1	8/29/2006 1:51:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Methylene chloride	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Naphthalene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
n-Butylbenzene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
n-Propylbenzene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
o-Xylene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Styrene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Tetrachloroethene	6.0	1.0		µg/L	1	8/29/2006 1:51:00 AM
Toluene	29	1.0		µg/L	1	8/29/2006 1:51:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Trichloroethene	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Vinyl acetate	U	1.0		µg/L	1	8/29/2006 1:51:00 AM
Vinyl chloride	U	1.0		µg/L	1	8/29/2006 1:51:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 01-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608261
Project: Rowe Industries
Lab ID: 0608261-03A

Client Sample ID: FRW 1 082406
Tag Number: 11006
Collection Date: 8/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
2-Butanone	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
2-Hexanone	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Acetone	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Benzene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Bromobenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Bromochloromethane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Bromodichloromethane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Bromoform	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Bromomethane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Carbon disulfide	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Chlorobenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 01-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608261
Project: Rowe Industries
Lab ID: 0608261-03A

Client Sample ID: FRW 1 082406
Tag Number: 11006
Collection Date: 8/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Chloroform	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Chloromethane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Dibromochloromethane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Dibromomethane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Ethylbenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Isopropylbenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
m,p-Xylene	U	2.0		µg/L	1	8/29/2006 2:29:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Methylene chloride	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Naphthalene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
n-Butylbenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
n-Propylbenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
o-Xylene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Styrene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Tetrachloroethene	14	1.0		µg/L	1	8/29/2006 2:29:00 AM
Toluene	5.6	1.0		µg/L	1	8/29/2006 2:29:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Trichloroethene	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Vinyl acetate	U	1.0		µg/L	1	8/29/2006 2:29:00 AM
Vinyl chloride	U	1.0		µg/L	1	8/29/2006 2:29:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 01-Sep-06

CLIENT: Leggett Brashears & Graham Inc.
Lab Order: 0608261
Project: Rowe Industries
Lab ID: 0608261-04A

Client Sample ID: FRW 2 082406
Tag Number: 11006
Collection Date: 8/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
2-Butanone	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
2-Hexanone	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Acetone	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Benzene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Bromobenzene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Bromochloromethane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Bromodichloromethane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Bromoform	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Bromomethane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Carbon disulfide	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Chlorobenzene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 01-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608261
Project: Rowe Industries
Lab ID: 0608261-04A

Client Sample ID: FRW 2 082406
Tag Number: 11006
Collection Date: 8/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Chloroform	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Chloromethane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
cis-1,2-Dichloroethene	22	1.0		µg/L	1	8/29/2006 3:06:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Dibromochloromethane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Dibromomethane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Ethylbenzene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Isopropylbenzene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
m,p-Xylene	U	2.0		µg/L	1	8/29/2006 3:06:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Methylene chloride	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Naphthalene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
n-Butylbenzene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
n-Propylbenzene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
o-Xylene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Styrene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Tetrachloroethene	14	1.0		µg/L	1	8/29/2006 3:06:00 AM
Toluene	420	1.0		µg/L	1	8/29/2006 3:06:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Trichloroethene	1.8	1.0		µg/L	1	8/29/2006 3:06:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Vinyl acetate	U	1.0		µg/L	1	8/29/2006 3:06:00 AM
Vinyl chloride	3.0	1.0		µg/L	1	8/29/2006 3:06:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 01-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608261
Project: Rowe Industries
Lab ID: 0608261-05A

Client Sample ID: FRW 3 082406
Tag Number: 11006
Collection Date: 8/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
2-Butanone	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
2-Hexanone	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Acetone	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Benzene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Bromobenzene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Bromochloromethane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Bromodichloromethane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Bromoform	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Bromomethane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Carbon disulfide	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Chlorobenzene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 01-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608261
Project: Rowe Industries
Lab ID: 0608261-05A

Client Sample ID: FRW 3 082406
Tag Number: 11006
Collection Date: 8/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Chloroform	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Chloromethane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
cis-1,2-Dichloroethene	20	1.0		µg/L	1	8/29/2006 3:44:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Dibromochloromethane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Dibromomethane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Ethylbenzene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Isopropylbenzene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
m,p-Xylene	U	2.0		µg/L	1	8/29/2006 3:44:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Methylene chloride	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Naphthalene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
n-Butylbenzene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
n-Propylbenzene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
o-Xylene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Styrene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Tetrachloroethene	100	1.0		µg/L	1	8/29/2006 3:44:00 AM
Toluene	210	1.0		µg/L	1	8/29/2006 3:44:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Trichloroethene	4.0	1.0		µg/L	1	8/29/2006 3:44:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Vinyl acetate	U	1.0		µg/L	1	8/29/2006 3:44:00 AM
Vinyl chloride	U	1.0		µg/L	1	8/29/2006 3:44:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 01-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608261
Project: Rowe Industries
Lab ID: 0608261-06A

Client Sample ID: FRW 4 082406
Tag Number: 11006
Collection Date: 8/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A	Analyst: LDS	
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
2-Butanone	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
2-Hexanone	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Acetone	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Benzene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Bromobenzene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Bromochloromethane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Bromodichloromethane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Bromoform	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Bromomethane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Carbon disulfide	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Chlorobenzene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM

Qualifiers: B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits
X Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 01-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608261
Project: Rowe Industries
Lab ID: 0608261-06A

Client Sample ID: FRW 4 082406
Tag Number: 11006
Collection Date: 8/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B	SW5030A	Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Chloroform	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Chloromethane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Dibromochloromethane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Dibromomethane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Ethylbenzene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Isopropylbenzene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
m,p-Xylene	U	2.0		µg/L	1	8/29/2006 4:22:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Methylene chloride	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Naphthalene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
n-Butylbenzene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
n-Propylbenzene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
o-Xylene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Styrene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Tetrachloroethene	12	1.0		µg/L	1	8/29/2006 4:22:00 AM
Toluene	17	1.0		µg/L	1	8/29/2006 4:22:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Trichloroethene	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Vinyl acetate	U	1.0		µg/L	1	8/29/2006 4:22:00 AM
Vinyl chloride	U	1.0		µg/L	1	8/29/2006 4:22:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Friday, August 25, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0608260

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 1 sample(s) on 8/24/2006 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

A handwritten signature in black ink that reads "Lori Beyer". The signature is written in a cursive, flowing style.

Lori Beyer
Lab Director

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0608260

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0608260-01A	POST 082406	11006	8/24/2006	8/24/2006

TAG # / COC

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

CLIENT NAME/ADDRESS		CONTACT:		SAMPLER (SIGNATURE)		SAMPLE(S) SEALED		YES / NO	
PROJECT LOCATION		SAMPLING DATE/TIME		SAMPLE # - LOCATION		ANALYSIS REQUIRED		FOR METHANOL PRESERVED SAMPLES [VOLATILE VIAL #]	
LABORATORY ID #	MATRIX	# CON-TAINERS	SAMPLING DATE/TIME	SAMPLE # - LOCATION		ANALYSIS REQUIRED		FOR METHANOL PRESERVED SAMPLES [VOLATILE VIAL #]	
100	W	2	8-2-06	PRE: 082406					
101	L	1		MID: 082406					
102	L	1		POST: 082406					
103	L	1		PRE: 082406					
104	L	1		MID: 082406					
105	L	1		POST: 082406					
106	L	1		PRE: 082406					
107	L	1		MID: 082406					
108	L	1		POST: 082406					
109	L	1		PRE: 082406					
110	L	1		MID: 082406					
111	L	1		POST: 082406					
112	L	1		PRE: 082406					
113	L	1		MID: 082406					
114	L	1		POST: 082406					
115	L	1		PRE: 082406					
116	L	1		MID: 082406					
117	L	1		POST: 082406					
118	L	1		PRE: 082406					
119	L	1		MID: 082406					
120	L	1		POST: 082406					
121	L	1		PRE: 082406					
122	L	1		MID: 082406					
123	L	1		POST: 082406					
124	L	1		PRE: 082406					
125	L	1		MID: 082406					
126	L	1		POST: 082406					
127	L	1		PRE: 082406					
128	L	1		MID: 082406					
129	L	1		POST: 082406					
130	L	1		PRE: 082406					
131	L	1		MID: 082406					
132	L	1		POST: 082406					
133	L	1		PRE: 082406					
134	L	1		MID: 082406					
135	L	1		POST: 082406					
136	L	1		PRE: 082406					
137	L	1		MID: 082406					
138	L	1		POST: 082406					
139	L	1		PRE: 082406					
140	L	1		MID: 082406					
141	L	1		POST: 082406					
142	L	1		PRE: 082406					
143	L	1		MID: 082406					
144	L	1		POST: 082406					
145	L	1		PRE: 082406					
146	L	1		MID: 082406					
147	L	1		POST: 082406					
148	L	1		PRE: 082406					
149	L	1		MID: 082406					
150	L	1		POST: 082406					
151	L	1		PRE: 082406					
152	L	1		MID: 082406					
153	L	1		POST: 082406					
154	L	1		PRE: 082406					
155	L	1		MID: 082406					
156	L	1		POST: 082406					
157	L	1		PRE: 082406					
158	L	1		MID: 082406					
159	L	1		POST: 082406					
160	L	1		PRE: 082406					
161	L	1		MID: 082406					
162	L	1		POST: 082406					
163	L	1		PRE: 082406					
164	L	1		MID: 082406					
165	L	1		POST: 082406					

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ol style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 25-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608260
Project: Rowe Industries
Lab ID: 0608260-01A

Client Sample ID: POST 082406
Tag Number: 11006
Collection Date: 8/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
2-Butanone	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
2-Hexanone	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Acetone	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Benzene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Bromobenzene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Bromochloromethane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Bromodichloromethane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Bromoform	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Bromomethane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Carbon disulfide	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Chlorobenzene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 25-Aug-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608260
Project: Rowe Industries
Lab ID: 0608260-01A

Client Sample ID: POST 082406
Tag Number: 11006
Collection Date: 8/24/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Chloroform	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Chloromethane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Dibromochloromethane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Dibromomethane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Ethylbenzene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Isopropylbenzene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
m,p-Xylene	U	2.0		µg/L	1	8/24/2006 3:00:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Methylene chloride	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Naphthalene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
n-Butylbenzene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
n-Propylbenzene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
o-Xylene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Styrene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Tetrachloroethene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Toluene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Trichloroethene	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Vinyl acetate	U	1.0		µg/L	1	8/24/2006 3:00:00 PM
Vinyl chloride	U	1.0		µg/L	1	8/24/2006 3:00:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Wednesday, September 06, 2

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0608308

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 2 sample(s) on 8/30/2006 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,


Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 06-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0608308

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0608308-01A	PRE:082806:1300	11010	8/28/2006	8/30/2006
0608308-02A	MID:082806:1305	11010	8/28/2006	8/30/2006

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ol style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 06-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608308
Project: Rowe Industries
Lab ID: 0608308-01A

Client Sample ID: PRE:082806:1300
Tag Number: 11010
Collection Date: 8/28/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
1,1,1-Trichloroethane	1.5	1.0		µg/L	1	8/31/2006 9:04:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
2-Butanone	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
2-Hexanone	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Acetone	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Benzene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Bromobenzene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Bromochloromethane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Bromodichloromethane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Bromoform	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Bromomethane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Carbon disulfide	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Chlorobenzene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 06-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608308
Project: Rowe Industries
Lab ID: 0608308-01A

Client Sample ID: PRE:082806:1300
Tag Number: 11010
Collection Date: 8/28/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Chloroform	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Chloromethane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
cis-1,2-Dichloroethene	6.1	1.0		µg/L	1	8/31/2006 9:04:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Dibromochloromethane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Dibromomethane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Ethylbenzene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Isopropylbenzene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
m,p-Xylene	U	2.0		µg/L	1	8/31/2006 9:04:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Methylene chloride	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Naphthalene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
n-Butylbenzene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
n-Propylbenzene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
o-Xylene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Styrene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Tetrachloroethene	30	1.0		µg/L	1	8/31/2006 9:04:00 PM
Toluene	31	1.0		µg/L	1	8/31/2006 9:04:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Trichloroethene	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Vinyl acetate	U	1.0		µg/L	1	8/31/2006 9:04:00 PM
Vinyl chloride	U	1.0		µg/L	1	8/31/2006 9:04:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 06-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608308
Project: Rowe Industries
Lab ID: 0608308-02A

Client Sample ID: MID:082806:1305
Tag Number: 11010
Collection Date: 8/28/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
2-Butanone	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
2-Hexanone	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Acetone	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Benzene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Bromobenzene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Bromochloromethane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Bromodichloromethane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Bromoform	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Bromomethane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Carbon disulfide	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Chlorobenzene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 06-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608308
Project: Rowe Industries
Lab ID: 0608308-02A

Client Sample ID: MID:082806:1305
Tag Number: 11010
Collection Date: 8/28/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Chloroform	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Chloromethane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
cis-1,2-Dichloroethene	1.4	1.0		µg/L	1	8/31/2006 9:48:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Dibromochloromethane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Dibromomethane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Ethylbenzene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Isopropylbenzene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
m,p-Xylene	U	2.0		µg/L	1	8/31/2006 9:48:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Methylene chloride	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Naphthalene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
n-Butylbenzene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
n-Propylbenzene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
o-Xylene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Styrene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Tetrachloroethene	14	1.0		µg/L	1	8/31/2006 9:48:00 PM
Toluene	1.4	1.0		µg/L	1	8/31/2006 9:48:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Trichloroethene	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Vinyl acetate	U	1.0		µg/L	1	8/31/2006 9:48:00 PM
Vinyl chloride	U	1.0		µg/L	1	8/31/2006 9:48:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Wednesday, September 06, 2

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0608307

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 1 sample(s) on 8/30/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,


Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 06-Sep-06

CLIENT: Leggette Brashears & Graham Inc.**Project:** Rowe Industries**Lab Order:** 0608307**Work Order Sample Summary**

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0608307-01A	POST:082806:1310	11010	8/28/2006	8/30/2006

TAG# / COC

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100

FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ol style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 06-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608307
Project: Rowe Industries
Lab ID: 0608307-01A

Client Sample ID: POST:082806:1310
Tag Number: 11010
Collection Date: 8/28/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
2-Butanone	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
2-Hexanone	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Acetone	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Benzene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Bromobenzene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Bromochloromethane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Bromodichloromethane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Bromoform	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Bromomethane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Carbon disulfide	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Chlorobenzene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM

Qualifiers:
 B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit
 U Indicates the compound was analyzed for but not detected

E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits
 X Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 06-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0608307
Project: Rowe Industries
Lab ID: 0608307-01A


Client Sample ID: POST:082806:1310
Tag Number: 11010
Collection Date: 8/28/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Chloroform	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Chloromethane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Dibromochloromethane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Dibromomethane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Ethylbenzene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Isopropylbenzene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
m,p-Xylene	U	2.0		µg/L	1	9/1/2006 12:44:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Methylene chloride	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Naphthalene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
n-Butylbenzene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
n-Propylbenzene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
o-Xylene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Styrene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Tetrachloroethene	1.5	1.0		µg/L	1	9/1/2006 12:44:00 AM
Toluene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Trichloroethene	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Vinyl acetate	U	1.0		µg/L	1	9/1/2006 12:44:00 AM
Vinyl chloride	U	1.0		µg/L	1	9/1/2006 12:44:00 AM

Qualifiers:

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits
X Value exceeds Maximum Contaminant Level

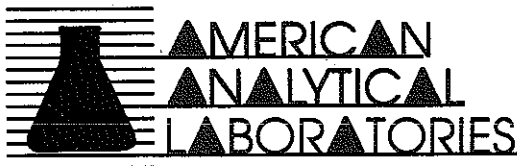

NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Tuesday, September 12, 200

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0609037

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 2 sample(s) on 9/7/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

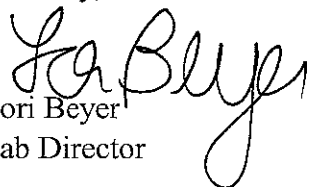
Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 12-Sep-06

CLIENT: Leggette Brashears & Graham Inc.

Project: Rowe Industries

Lab Order: 0609037

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0609037-01A	PRE:090506		9/5/2006	9/7/2006
0609037-02A	MID:090506		9/5/2006	9/7/2006

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ol style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 12-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0609037
Project: Rowe Industries
Lab ID: 0609037-01A

Client Sample ID: PRE:090506
Tag Number:
Collection Date: 9/5/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11						Analyst: MMR
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
2-Butanone	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
2-Hexanone	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Acetone	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Benzene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Bromobenzene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Bromochloromethane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Bromodichloromethane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Bromoform	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Bromomethane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Carbon disulfide	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Chlorobenzene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 12-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0609037
Project: Rowe Industries
Lab ID: 0609037-01A

Client Sample ID: PRE:090506
Tag Number:
Collection Date: 9/5/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
Chloroethane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Chloroform	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Chloromethane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Dibromochloromethane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Dibromomethane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Ethylbenzene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Isopropylbenzene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
m,p-Xylene	U	2.0		µg/L	1	9/8/2006 12:08:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Methylene chloride	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Naphthalene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
n-Butylbenzene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
n-Propylbenzene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
o-Xylene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Styrene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Tetrachloroethene	59	1.0		µg/L	1	9/8/2006 12:08:00 PM
Toluene	120	1.0		µg/L	1	9/8/2006 12:08:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Trichloroethene	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Vinyl acetate	U	1.0		µg/L	1	9/8/2006 12:08:00 PM
Vinyl chloride	U	1.0		µg/L	1	9/8/2006 12:08:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 12-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0609037
Project: Rowe Industries
Lab ID: 0609037-02A

Client Sample ID: MID:090506
Tag Number:
Collection Date: 9/5/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
2-Butanone	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
2-Hexanone	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Acetone	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Benzene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Bromobenzene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Bromochloromethane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Bromodichloromethane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Bromoform	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Bromomethane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Carbon disulfide	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Chlorobenzene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 12-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0609037
Project: Rowe Industries
Lab ID: 0609037-02A

Client Sample ID: MID:090506
Tag Number:
Collection Date: 9/5/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: MMR
Chloroethane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Chloroform	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Chloromethane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Dibromochloromethane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Dibromomethane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Ethylbenzene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Isopropylbenzene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
m,p-Xylene	U	2.0		µg/L	1	9/8/2006 12:46:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Methylene chloride	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Naphthalene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
n-Butylbenzene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
n-Propylbenzene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
o-Xylene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Styrene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Tetrachloroethene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Toluene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Trichloroethene	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Vinyl acetate	U	1.0		µg/L	1	9/8/2006 12:46:00 PM
Vinyl chloride	U	1.0		µg/L	1	9/8/2006 12:46:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

Friday, September 08, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe Industries

Dear Mark Goldberg:

Order No.: 0609036

American Analytical Laboratories, LLC. received 1 sample(s) on 9/7/2006 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,



Lori Beyer
Lab Director

American Analytical Laboratories, LLC.**Date:** 08-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0609036

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0609036-01A	POST:090506		9/5/2006	9/7/2006



NYSDOH	ELAP	11418
AIHA	PAT, LPAT	15668
CTDOH	PH-0205	

56 TOLEDO STREET • FARMINGDALE, NY 11735 • (516) 454-6100 • FAX (516) 454-8027

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ol style="list-style-type: none">(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 08-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0609036
Project: Rowe Industries
Lab ID: 0609036-01A

Client Sample ID: POST:090506
Tag Number:
Collection Date: 9/5/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
2-Butanone	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
2-Hexanone	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Acetone	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Benzene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Bromobenzene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Bromochloromethane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Bromodichloromethane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Bromoform	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Bromomethane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Carbon disulfide	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Chlorobenzene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 08-Sep-06

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0609036
Project: Rowe Industries
Lab ID: 0609036-01A

Client Sample ID: POST:090506
Tag Number:
Collection Date: 9/5/2006
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 PLUS MTBE & FREON11		SW8260B		SW5030A		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Chloroform	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Chloromethane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Dibromochloromethane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Dibromomethane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Ethylbenzene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Isopropylbenzene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
m,p-Xylene	U	2.0		µg/L	1	9/8/2006 8:58:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Methylene chloride	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Naphthalene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
n-Butylbenzene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
n-Propylbenzene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
o-Xylene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Styrene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Tetrachloroethene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Toluene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Trichloroethene	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Vinyl acetate	U	1.0		µg/L	1	9/8/2006 8:58:00 AM
Vinyl chloride	U	1.0		µg/L	1	9/8/2006 8:58:00 AM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level