

**PROJECT STATUS MEMORANDUM**

**NO. 10-06**

**TO:** Pamela Tames, USEPA

**FROM:** Mark M. Goldberg, P.E.  
Tunde H. Komuves-Sandor

**DATE:** December 15, 2006

**PROJECT:** Rowe Industries Superfund Site  
Ground-Water Recovery and Treatment System  
October 2006 Status Report  
Sag Harbor, New York

LBG Engineering Services, P.C. (LBG) commenced operation of the ground-water remediation system at the above-referenced site on December 17, 2002. This status report presents a summary of system performance, operation and maintenance, and monitoring activities for the site from October 1, 2006 through October 31, 2006. The report includes a summary of system performance parameters, system operation parameters, analytical results for ground water, system effluent samples, and air quality results.

**SUMMARY OF SYSTEM PERFORMANCE AND OPERATION**

*(October 1, 2006 through October 31, 2006)*

- |   |                                  |
|---|----------------------------------|
| 1. Hours of operation during the reporting period:  | 617 hours (83%)                  |
| 2. Alarm conditions during the reporting period:  | See Table 1                      |
| 3. Was the SPDES VOC discharge permit criteria achieved:  | yes, (Table 2)                   |
| 4. Total volume of water pumped during the reporting period:  | 17,181,350 gal.                  |
| 5. Was the system effluent flow below the SPDES limit of 1,023,000 gpd: yes, (Graph 1)                          |                                  |
| 6. Mass of VOCs recovered during the reporting period:  | 3.1 pounds                       |
| 7. Cumulative mass of VOCs recovered since startup on 12/17/02:<br>(calculations can be provided upon request)  | 193.8 pounds                     |
| 8. Effluent VOC vapor concentration for the reporting period:   | 0.08 mg/m <sup>3</sup> (Table 3) |
| 9. Was the effluent VOC vapor emission rate below 0.022 lbs/hr.:<br>(calculations can be provided upon request) | yes (0.00073 lbs/hr)             |

## GROUND-WATER RECOVERY SYSTEM STATUS SUMMARY

The following table summarizes select recovery well parameters for the reporting period. Table 4 presents a summary of the quality results for water samples collected from recovery wells. Graph 2 presents PCE concentrations for each recovery well. For wells with water quality that meets or is approaching remedial criteria, Graph 3 presents PCE concentrations at an expanded scale in order to compare them to the PCE aquifer restoration concentration of 5 ug/L. Laboratory analytical reports are included as Appendix I.

Well	Volume Pumped (gal)	Average Flow (gpm)	Minimum Design Flow (gpm)	Total VOC Concentration (µg/L)	VOC Recovery (lbs)
RW-2	1,073,847	27	26	171.1	1.53
RW-3 *	0	0	23	0	0
RW-4	2,147,440	39	13	16.6	0.30
RW-5	2,147,700	50	42	2.4	0.04
RW-6	536,923	15	28	61.2	0.27
RW-7	2,139,400	70	54	31.9	0.57
RW-8	2,145,885	50	46	6.0	0.11
RW-9	2,514,600	80	68	1.5	0.03

\*Recovery well RW-3 was not operating in October because the new RW-3 drive has to be reprogrammed to account for the two (2) horsepower (HP) pump motor recently installed following well rehabilitation activities (RW-3 formerly had a one (1) HP pump motor).

Recovery well RW-6 had an average flow below the respective minimum design flow determined to be necessary for capture of the plume. RW-6 will continue to be monitored for performance. The ground-water model for the site will be updated for the annual report to reflect the current pumping and water quality conditions to determine if the FSP&T system can effectively capture the plume if RW-6 is not operating.

Ground water quality results from RW-2 continue to show elevated 1,1,1 Trichloroethane (TCA) concentrations compared to historical results. A ground-water modeling evaluation will be completed in the near future to validate the “capture zone shift” hypothesis presented in the September 2006 Status Report. The TCA concentration in the ground water will continue to be monitored on a monthly basis.

The effluent pH of the treated water from the FSP&T system is within the acceptable State Pollutant Discharge System (SPDES) criteria for the site as shown in Table 2.

### BAG FILTER STATUS

The following table presents an operational summary of the bag filter usage and configuration for the reporting period.

<b>Dates</b>	<b>Bank 1</b>	<b>Bank 2</b>	<b>Bank 3</b>
October 1 to 31	7 of 8 housings used with 400 micron bag filters	7 of 8 housings used with 400 micron bag filters	Not active

No modifications were made to the filter bank configuration or operation during this reporting period.

### **OTHER O&M ACTIVITIES AND FUTURE O&M ACTIVITIES**

Other O&M activities conducted in October 2006 include:

- On October 11, 2006, the malfunctioning RW-8 pressure transducer was replaced.

Future O&M activities scheduled for the fall and winter of 2006 include:

- Conduct recharge basin rehabilitation;
- Reprogram RW-3 drive for compatibility with the new 2 horsepower motor;
- Troubleshoot air flow meters; and
- Clean treatment building influent pipes and RW-2, 4, 8, 9 flow meters, valves and pipes.

cc: Phil McAndrew, Kraft Foods, N.A. – .pdf  
 Lisa Krogman, Kraft Foods, N.A. (Environ) – .pdf  
 Jeff Trad, NYSDEC – .pdf  
 Chief-Operation Maintenance and Support Section, NYSDEC – .pdf  
 William Spitz, RWM, R-1, NYSDEC  
 Garrett W. Swensen Jr., Esq., Town of Southampton

MMG:ng

Attachments

H:\JOBFILES\M-N\Nabsag\Ground Water\O&M\FSP&T\Monthly Reports\2006\October 2006\Status1006Oct.doc

## **TABLES**

**TABLE 1**  
**GROUND-WATER REMEDIAL ACTION**  
**ROWE INDUSTRIES SUPERFUND SITE**  
**SAG HARBOR, NEW YORK**

**MAINTENANCE LOG**  
(October 1, 2006 through October 31, 2006)

<b>Date</b>	<b>Time</b>	<b>System Changes/Modifications</b>	<b>Personnel</b>
10/4/2006		Changed multi-bag filter bags (400 mm) in Banks 1 and 2, seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD
10/11/2006		Changed multi-bag filter bags (400 mm) in Banks 1 and 2, seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD
		The malfunctioning RW-8 pressure transducer was replaced.	RD
10/13/2006	12:26 AM	System communication failure; system shut down.	
10/18/2006	7:13 AM	Reset system communication failure alarm and restarted the system.	RD
10/24/2006		Changed multi-bag filter bags (400 mm) in Banks 1 and 2, seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD

TABLE 2

GROUND-WATER REMEDIAL ACTION  
 ROWE INDUSTRIES SUPERFUND SITE  
 SAG HARBOR, NEW YORK

EFFLUENT WATER QUALITY RESULTS

Date Sampled <sup>2/</sup>	pH <sup>1/</sup>	TDS (mg/l)	PCE (ug/l)	1,1,1-TCA (ug/l)	TCE (ug/l)	1,1-DCA (ug/l)	1,1-DCE (ug/l)	1,2-DCE (ug/l)	Xylene (ug/l)	Bromoform (ug/l)	Dibromo-chloromethane (ug/l)	Methylene Chloride (ug/l)	Freon 113 (ug/l)	Acetone (ug/l)	Chloroform (ug/l)	MTBE (ug/l)	Total Iron (mg/l)	Dissolved Iron (mg/l)
SPDES Limits	5.0 to 8.5	---	1	5	5	5	5	5	5	---	---	5	---	50	7	---	---	---
4-Oct-06	5.3	82	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	1.63	0.0911
10-Oct-06	5.3	100	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	1.07	0.0609
18-Oct-06	5.3	78	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	2.72	0.0926
24-Oct-06	5.3	110	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	1.75	0.0876

SPDES: State Pollutant Discharge Elimination System  
 mg/l: Milligrams per liter  
 ug/l: Micrograms per liter  
 ----: Not established

NM: Not Measured  
 TDS: Total dissolved solids  
 PCE: Tetrachloroethylene  
 TCE: Trichloroethene

1,1-DCA: 1,1-Dichloroethane  
 1,1-DCE: 1,1-Dichloroethene  
 1,2-DCE: 1,2-Dichloroethene  
 MTBE: Methyl tert-butyl ether

Notes:

- Based on the new SPDES criteria from an NYSDEC letter dated on May 11, 2006, the new allowable pH range for the Rowe Site is between 5.0 and 8.5. The pH was measured using litmus paper. Influent pH values from recovery wells typically range between 5 and 6.
- "Effluent" samples were collected from sample port labeled NP2-10 unless otherwise noted.



TABLE 4

**GROUND-WATER REMEDIAL ACTION  
ROWE INDUSTRIES SUPERFUND SITE  
SAG HARBOR, NEW YORK**

**RECOVERY WELL WATER QUALITY RESULTS**

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	1,1-Dichloroethane (ug/L)	cis-1,2-Dichloroethene (ug/L)	1,1-Dichloroethene (ug/L)	Methylene Chloride (ug/L) <sup>1/</sup>	Toluene (ug/L)	Dibromochloromethane (ug/L)	Acetone (ug/L) <sup>1/</sup>
	ARAR's	5	5	5	NE	7	NE	300	300	5	5	5	5	NE	NE	NE
RW-1	15-Sep-04	ND<1	ND<1	ND<1	ND<1	2.8	ND<1	0.0865	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	ND<1	ND<1	ND<1	ND<1	ND<1	2.2	0.0332	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	ND<1	ND<1	ND<1	ND<1	1.9	2.0	0.0133	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	ND<1	ND<1	ND<1	ND<1	<b>9.8</b>	ND<1	0.0475	0.0229	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	13-Jan-05	ND<1	ND<1	ND<1	ND<1	1.5	2.1	0.0703	0.0326	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	ND<1	ND<1	ND<1	ND<1	4.6	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	ND<1	ND<1	ND<1	ND<1	2.5	ND<1	0.0285	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	ND<1	ND<1	ND<1	ND<1	1.5	ND<1	0.0357	0.0217	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	ND<1	ND<1	ND<1	ND<1	4.0	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	ND<1	ND<1	ND<1	ND<1	2.1	ND<1	0.0289	ND<0.02	ND<1	ND<1	ND<1	<b>8.4*</b>	ND<1	ND<1	6.9*
	7-Mar-06	ND<1	ND<1	ND<1	ND<1	5.2	ND<1	0.1650	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Sep-06	ND<1	ND<1	ND<1	ND<1	1.7	ND<1	NA	NA	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Sep-04	<b>12</b>	ND<1	ND<1	ND<1	ND<1	ND<1	3.82	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	<b>10</b>	ND<1	ND<1	ND<1	ND<1	ND<1	1.5	4.78	0.213	ND<1	ND<1	ND<1	ND<1	ND<1	1.5
3-Nov-04	<b>11</b>	ND<1	ND<1	ND<1	ND<1	ND<1	5.21	0.152	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
15-Dec-04	<b>10</b>	ND<1	ND<1	ND<1	ND<1	ND<1	10.8	0.297	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
4-Jan-05	<b>25</b>	ND<1	ND<1	ND<1	ND<1	ND<1	4.81	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
8-Feb-05	<b>18</b>	ND<1	ND<1	ND<1	ND<1	ND<1	5.01	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
15-Mar-05	<b>20</b>	1.1	ND<1	ND<1	ND<1	ND<1	5.28	0.0816	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
19-Apr-05	<b>9.0</b>	ND<1	ND<1	ND<1	ND<1	ND<1	4.51	0.128	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
2-May-05	<b>8.2</b>	ND<1	ND<1	ND<1	ND<1	ND<1	3.69	0.17	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
16-Jun-05	<b>12.0</b>	ND<1	1.0	ND<1	ND<1	ND<1	3.5	0.0511	ND<1	2.0	ND<1	ND<1	ND<1	ND<1	ND<1	
14-Jul-05	<b>7.7</b>	1.1	ND<1	ND<1	ND<1	ND<1	0.28	0.0298	ND<1	ND<1	ND<1	<b>7.3*</b>	ND<1	ND<1	5.6*	
9-Aug-05	<b>5.4</b>	ND<1	ND<1	ND<1	ND<1	ND<1	3.74	0.107	ND<1	<b>5.8</b>	ND<1	ND<1	ND<1	ND<1	ND<1	
8-Sep-05	<b>16</b>	1.8	ND<1	ND<1	ND<1	ND<1	3.57	0.0704	ND<1	<b>11</b>	ND<1	ND<1	ND<1	ND<1	ND<1	
19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	
21-Nov-05	<b>15</b>	2.1	ND<1	ND<1	ND<1	ND<1	6.1	0.0269	ND<1	<b>12</b>	ND<1	ND<1	ND<1	ND<1	ND<1	
8-Dec-05	<b>34</b>	2.1	ND<1	ND<1	ND<1	ND<1	4.25	ND<0.02	ND<1	<b>25</b>	ND<1	ND<1	ND<1	ND<1	ND<1	
12-Jan-06	<b>5.2</b>	2.0	ND<1	ND<1	ND<1	ND<1	9.15	0.0696	ND<1	5.0	ND<1	4.8*	1.0	ND<1	ND<1	
14-Feb-06	<b>6.5</b>	4.3	1.2	ND<1	ND<1	ND<1	3.99	ND<0.02	ND<1	2.8	ND<1	ND<1	ND<1	ND<1	ND<1	
7-Mar-06	<b>6.5</b>	3.5	ND<1	ND<1	ND<1	ND<1	4.76	0.0395	ND<1	3.8	ND<1	ND<1	ND<1	ND<1	ND<1	
12-Apr-06	<b>12.0</b>	3.9	1.2	ND<1	ND<1	ND<1	4.24	0.0522	ND<1	<b>12.0</b>	ND<1	ND<1	ND<1	ND<1	ND<1	
17-May-06	<b>19.0</b>	<b>5.1</b>	ND<1	ND<1	ND<1	ND<1	5.95	0.063	ND<1	<b>14.0</b>	ND<1	ND<1	ND<1	ND<1	ND<1	
21-Jun-06	<b>13.0</b>	3.0	<b>25</b>	ND<1	ND<1	ND<1	3.57	0.093	ND<1	<b>5.0</b>	ND<1	ND<1	ND<1	ND<1	ND<1	
20-Jul-06	<b>8.0</b>	3.4	<b>60</b>	ND<1	ND<1	ND<1	4.49	0.177	ND<1	<b>7.5</b>	ND<1	ND<1	ND<1	ND<1	ND<1	
24-Aug-06	<b>11.0</b>	1.1	<b>25</b>	ND<1	ND<1	ND<1	4.14	0.0172	ND<1	<b>5.7</b>	ND<1	ND<1	ND<1	ND<1	ND<1	
19-Sep-06	2.8	ND<1	<b>200</b>	ND<1	ND<1	ND<1	13.7	0.0184	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
24-Oct-06	5.0	1.6	<b>160</b>	ND<1	ND<1	ND<1	3.6	0.00756	ND<1	3.6	0.91	ND<1	ND<1	ND<1	ND<1	



TABLE 4

**GROUND-WATER REMEDIAL ACTION  
ROWE INDUSTRIES SUPERFUND SITE  
SAG HARBOR, NEW YORK**

**RECOVERY WELL WATER QUALITY RESULTS**

Recovery Well	Date Sampled	PCE	TCE	TCA	Vinyl Acetate	Chloroform	MTBE	Total Iron	Dissolved Iron	1,1-Dichloroethane	cis-1,2-Dichloroethene	1,1-Dichloroethene	Methylene Chloride <sup>1/</sup>	Toluene	Dibromochloromethane	Acetone <sup>1/</sup>
		(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(mg/L)	(mg/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)
	ARAR's	5	5	5	NE	7	NE	300	300	5	5	5	5	NE	NE	NE
RW-3	15-Sep-04	2.7	21	8.7	ND<1	ND<1	ND<1	1.91	0.42	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	2.2	12	5.0	ND<1	ND<1	ND<1	2.09	1.82	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	1.5	6.5	2.6	ND<1	ND<1	ND<1	1.87	1.8	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	3.77	0.489	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.60	2.24	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	1.6	1.3	ND<1	ND<1	ND<1	ND<1	2.10	1.15	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	3	13	5.0	ND<1	ND<1	ND<1	1.89	1.36	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	ND<1	2.0	ND<1	ND<1	ND<1	ND<1	46.1	0.539	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	2.2	7.7	2.8	ND<1	ND<1	ND<1	1.85	0.82	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	9.91	10	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	2.01	0.649	ND<1	ND<1	ND<1	9.1 *	ND<1	ND<1	6.9 *
	9-Aug-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.50	0.973	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	1	3.6	1.2	ND<1	ND<1	ND<1	2.03	0.71	ND<1	2.6	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	1.3	ND<1	ND<1	ND<1	ND<1	ND<1	1.83	0.708	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.11	0.556	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	1.7	17	7.9	ND<1	ND<1	ND<1	1.93	0.455	ND<1	ND<1	ND<1	4.6*	ND<1	ND<1	ND<1
	14-Feb-06	1.4	8.9	2.5	ND<1	ND<1	ND<1	3.80	0.157	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Mar-06	1.1	3.4	ND<1	ND<1	ND<1	ND<1	1.87	0.297	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Apr-06	0.95	ND<1	ND<1	ND<1	ND<1	ND<1	1.99	0.649	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	17-May-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	1.06	0.353	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-June-06	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	20-Jul-06	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	24-Aug-06	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
19-Sep-06	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	
24-Oct-06	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	
RW-4	15-Sep-04	120	3.7	18	ND<1	ND<1	ND<1	2.98	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	94	ND<1	14	ND<1	ND<1	ND<1	3.65	0.126	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	130	4.2	11	ND<1	ND<1	ND<1	4.75	0.205	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	230	5.7	35	ND<1	ND<1	ND<1	1.90	1.62	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	160	4.1	7.3	ND<1	ND<1	ND<1	6.11	3.28	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	15-Mar-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	19-Apr-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	2-May-05	80	2.4	9.8	ND<1	ND<1	ND<1	3.77	0.0687	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	30-Jun-05	74	2.6	ND<1	ND<1	ND<1	ND<1	9.95	9.28	ND<1	ND<1	ND<1	4.5*	ND<1	ND<1	ND<1
	14-Jul-05	37	ND<1	8.9	ND<1	ND<1	ND<1	3.22	0.0185	ND<1	ND<1	ND<1	9.4 *	ND<1	ND<1	7.4 *
	9-Aug-05	31	ND<1	ND<1	ND<1	ND<1	ND<1	2.49	0.111	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	45	ND<1	6.0	ND<1	ND<1	ND<1	3.47	0.173	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	30	ND<1	ND<1	ND<1	ND<1	ND<1	3.69	0.0777	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Dec-05	64	2.0	1.5	ND<1	ND<1	ND<1	2.82	0.0302	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	15	ND<1	9.5	ND<1	ND<1	ND<1	7.78	0.0412	ND<1	ND<1	ND<1	5.2 *	ND<1	ND<1	ND<1
	14-Feb-06	24	ND<1	8.7	ND<1	ND<1	ND<1	6.05	0.0627	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Mar-06	22	ND<1	7.0	ND<1	ND<1	ND<1	3.50	0.0476	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Apr-06	26	1.5	6.2	ND<1	ND<1	2	4.17	0.0963	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	17-May-06	26	ND<1	ND<1	ND<1	ND<1	ND<1	3.15	0.109	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	21-Jun-06	23	ND<1	8.4	ND<1	ND<1	ND<1	9.23	0.086	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	20-Jul-06	14	ND<1	9.4	ND<1	ND<1	ND<1	4.10	0.155	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	24-Aug-06	23	ND<1	ND<1	ND<1	ND<1	ND<1	8.60	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
19-Sep-06	9	ND<1	7.5	ND<1	ND<1	ND<1	5.95	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
24-Oct-06	11	ND<1	5.6	ND<1	ND<1	ND<1	7.17	0.0178	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	

TABLE 4

GROUND-WATER REMEDIAL ACTION  
 ROWE INDUSTRIES SUPERFUND SITE  
 SAG HARBOR, NEW YORK

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE	TCE	TCA	Vinyl Acetate	Chloroform	MTBE	Total Iron	Dissolved Iron	1,1-Dichloroethane	cis-1,2-Dichloroethene	1,1-Dichloroethene	Methylene Chloride <sup>1/</sup>	Toluene	Dibromochloromethane	Acetone <sup>1/</sup>	
		(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(mg/L)	(mg/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	
RW-5	15-Sep-04	24	ND<1	6.5	ND<1	ND<1	3.2	2.39	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	7-Oct-04	16	ND<1	5.2	ND<1	ND<1	2.4	0.139	0.0163	ND<1	ND<1	ND<1	ND<1	ND<1	1.4	ND<1	
	3-Nov-04	15	ND<1	6.4	ND<1	ND<1	2.2	0.0287	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Dec-04	28	ND<1	28	ND<1	ND<1	ND<1	0.0621	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	4-Jan-05	12	ND<1	5.6	ND<1	ND<1	2.0	0.0269	0.0172	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Feb-05	11	ND<1	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Mar-05	14	ND<1	4.3	ND<1	ND<1	2.6	0.318	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Apr-05	9	ND<1	4.1	ND<1	ND<1	ND<1	0.0887	0.0187	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	2-May-05	13	ND<1	5.7	ND<1	ND<1	ND<1	0.0223	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	16-Jun-05	4.7	ND<1	ND<1	ND<1	ND<1	ND<1	0.0177	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	14-Jul-05	8.2	ND<1	1.6	ND<1	ND<1	ND<1	0.0358	ND<0.02	ND<1	ND<1	ND<1	9.5 *	ND<1	ND<1	5.6 *	
	9-Aug-05	2.6	ND<1	ND<1	ND<1	ND<1	ND<1	0.0227	0.0303	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Sep-05	8	ND<1	3.8	ND<1	ND<1	ND<1	0.0185	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	2.6	ND<1	ND<1	ND<1	ND<1	ND<1	0.0482	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Dec-05	2.4	ND<1	ND<1	ND<1	ND<1	ND<1	0.0468	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	12-Jan-06	2.3	ND<1	2.0	ND<1	ND<1	ND<1	0.0558	0.0119	ND<1	ND<1	ND<1	4.6*	ND<1	ND<1	ND<1	
	14-Feb-06	2.9	ND<1	3.8	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	7-Mar-06	2.6	ND<1	3.0	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	12-Apr-06	1.4	ND<1	ND<1	ND<1	1.5	2.4	0.0786	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	17-May-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.016	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	21-Jun-06	2.4	ND<1	2.6	ND<1	ND<1	ND<1	0.195	0.012	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	20-Jul-06	1.3	ND<1	3.1	ND<1	ND<1	ND<1	0.184	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	24-Aug-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.09	0.0116	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
19-Sep-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.194	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1		
24-Oct-06	1.1	ND<1	1.3	ND<1	ND<1	ND<1	0.0683	0.00684	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1		
RW-6	15-Sep-04	130	3.3	2.2	ND<1	ND<1	ND<1	0.0976	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	7-Oct-04	94	ND<1	1.6	ND<1	ND<1	ND<1	0.214	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	2.0	ND<1	
	3-Nov-04	94	2.1	2.4	ND<1	ND<1	2.5	0.0111	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Dec-04	200	3.8	16	ND<1	ND<1	ND<1	4.73	0.117	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	4-Jan-05	86	2.1	3.7	ND<1	ND<1	2.4	0.0279	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Feb-05	110	2.4	7.6	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Mar-05	120	2.3	6.6	ND<1	ND<1	2.7	0.0294	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Apr-05	74	ND<1	7.0	ND<1	ND<1	ND<1	0.0509	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	2-May-05	96	2.8	8.5	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	16-Jun-05	69	1.6	13	ND<1	ND<1	ND<1	0.067	0.0195	ND<1	ND<1	ND<1	2.1	ND<1	ND<1	ND<1	
	14-Jul-05	64	1.6	9.5	ND<1	ND<1	ND<1	0.0406	ND<0.02	ND<1	ND<1	ND<1	7.2 *	ND<1	ND<1	7 *	
	9-Aug-05	49	ND<1	12	ND<1	ND<1	ND<1	0.088	0.0366	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Sep-05	100	1.6	12	ND<1	ND<1	ND<1	1.3	0.0143	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	68	ND<1	ND<1	ND<1	ND<1	ND<1	0.144	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Dec-05	100	2.1	20	ND<1	ND<1	ND<1	0.139	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	12-Jan-06	41	1.1	16	ND<1	ND<1	ND<1	0.189	ND<0.02	ND<1	ND<1	ND<1	4.6*	ND<1	ND<1	ND<1	
	22-Feb-06	63	1.6	15	ND<1	ND<1	ND<1	0.116	0.0155	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	7-Mar-06	65	1.2	17	ND<1	ND<1	ND<1	0.0429	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	12-Apr-06	62	2.1	22	ND<1	ND<1	2	0.24	0.0137	0.97	ND<1	1.1	ND<1	ND<1	ND<1	ND<1	
	17-May-06	68	ND<1	18	ND<1	ND<1	ND<1	0.17	0.019	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	21-Jun-06	83	ND<1	20	ND<1	ND<1	ND<1	0.075	0.025	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	20-Jul-06	45	1.5	24	ND<1	ND<1	ND<1	1.01	0.0169	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	24-Aug-06	30	ND<1	22	ND<1	ND<1	ND<1	5.36	0.0563	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
19-Sep-06	46	ND<1	27	ND<1	ND<1	ND<1	0.916	0.0078	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1		
24-Oct-06	45	1.2	15	ND<1	ND<1	ND<1	1.84	0.007	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1		

TABLE 4

**GROUND-WATER REMEDIAL ACTION  
ROWE INDUSTRIES SUPERFUND SITE  
SAG HARBOR, NEW YORK**

**RECOVERY WELL WATER QUALITY RESULTS**

Recovery Well	Date Sampled	PCE	TCE	TCA	Vinyl Acetate	Chloroform	MTBE	Total Iron	Dissolved Iron	1,1-Dichloroethane	cis-1,2-Dichloroethene	1,1-Dichloroethene	Methylene Chloride <sup>1/</sup>	Toluene	Dibromochloromethane	Acetone <sup>1/</sup>	
		(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(mg/L)	(mg/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	
	ARAR's	5	5	5	NE	7	NE	300	300	5	5	5	5	NE	NE	NE	
RW-7	15-Sep-04	59	2.2	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	7-Oct-04	38	ND<1	ND<1	ND<1	ND<1	ND<1	0.0429	0.0126	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	3-Nov-04	36	ND<1	ND<1	ND<1	ND<1	ND<1	0.0214	0.0108	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Dec-04	82	ND<1	4.3	ND<1	ND<1	ND<1	0.0272	0.00876	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	4-Jan-05	37	1.1	ND<1	ND<1	ND<1	ND<1	0.0343	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Feb-05	45	ND<1	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Mar-05	42	1.5	1.7	ND<1	ND<1	ND<1	0.0356	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Apr-05	22	ND<1	ND<1	ND<1	ND<1	ND<1	0.107	0.0152	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	2-May-05	30	ND<1	ND<1	ND<1	ND<1	ND<1	0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	16-Jun-05	32	1.0	4.7	ND<1	ND<1	ND<1	0.0753	0.02	1.5	ND<1	ND<1	1.1	ND<1	ND<1	ND<1	
	14-Jul-05	32	ND<1	2.2	ND<1	ND<1	ND<1	0.0155	ND<0.02	ND<1	ND<1	ND<1	8.7 *	ND<1	ND<1	7.2 *	
	9-Aug-05	31	ND<1	6.2	ND<1	ND<1	ND<1	0.0903	0.0409	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Sep-05	39	ND<1	3.4	ND<1	ND<1	ND<1	0.0452	ND<0.02	1.7	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	36	ND<1	ND<1	ND<1	ND<1	ND<1	0.536	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Dec-05	70	ND<1	12.0	ND<1	ND<1	ND<1	0.253	ND<0.02	4.2	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	12-Jan-06	26	ND<1	5.0	ND<1	ND<1	ND<1	0.343	ND<0.02	2.2	ND<1	ND<1	5.0 *	ND<1	ND<1	ND<1	
	14-Feb-06	36	ND<1	4.1	ND<1	ND<1	ND<1	0.0332	ND<0.02	2.0	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	7-Mar-06	38	ND<1	4.1	ND<1	ND<1	ND<1	0.143	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	12-Apr-06	49	1.6	7.4	ND<1	ND<1	ND<1	0.0912	0.0175	3.4	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	17-May-06	59	ND<1	ND<1	ND<1	ND<1	ND<1	0.126	0.026	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	21-Jun-06	44	ND<1	4.6	ND<1	ND<1	ND<1	0.081	0.013	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	20-Jul-06	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	24-Aug-06	39	ND<1	7.9	ND<1	ND<1	ND<1	0.307	0.1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
19-Sep-06	36	ND<1	7.5	ND<1	ND<1	ND<1	0.116	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1		
24-Oct-06	26	ND<1	3.5	ND<1	ND<1	ND<1	0.0692	0.00846	2.4	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1		
RW-8	15-Sep-04	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	ND<1	ND<1	NM	
	27-Oct-04	4.1	1.0	2.2	ND<1	ND<1	ND<1	28.8	0.235	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	3-Nov-04	5.3	ND<1	4.0	ND<1	ND<1	ND<1	10.6	0.271	3.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Dec-04	16	ND<1	22	ND<1	ND<1	ND<1	15.6	0.149	15	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	4-Jan-05	6.9	1.3	3.9	ND<1	ND<1	ND<1	8.92	2.85	2.7	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Feb-05	7.4	ND<1	7.2	ND<1	ND<1	ND<1	8.24	ND<0.02	4.7	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Mar-05	9.0	1.3	4.2	ND<1	ND<1	ND<1	7.54	0.075	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Apr-05	3.5	ND<1	3.5	ND<1	ND<1	ND<1	8.89	0.321	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	2-May-05	5.6	ND<1	5.2	ND<1	ND<1	ND<1	7.33	0.073	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	16-Jun-05	2.7	ND<1	5.8	ND<1	ND<1	ND<1	7.06	0.325	2.1	ND<1	ND<1	1.7	ND<1	ND<1	ND<1	
	14-Jul-05	2.6	ND<1	3.4	ND<1	ND<1	ND<1	8.33	0.017	ND<1	ND<1	ND<1	8.5 *	ND<1	ND<1	8.2 *	
	9-Aug-05	1.8	ND<1	2.9	ND<1	ND<1	ND<1	0.24	0.065	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Sep-05	2.9	ND<1	4.2	ND<1	ND<1	ND<1	7.53	0.255	2.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	7.65	0.106	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Dec-05	2.4	ND<1	5.0	ND<1	ND<1	ND<1	5.19	0.021	3.2	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	12-Jan-06	1.3	ND<1	3.7	ND<1	ND<1	ND<1	7.25	0.097	2.0	ND<1	ND<1	4.9 *	ND<1	ND<1	ND<1	
	14-Feb-06	1.5	ND<1	3.0	ND<1	ND<1	ND<1	8.06	ND<0.02	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	7-Mar-06	1.3	ND<1	2.8	ND<1	ND<1	ND<1	8.33	0.064	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	12-Apr-06	2.1	0.9	4.5	ND<1	ND<1	ND<1	7.27	0.823	3.3	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	17-May-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.03	0.056	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	21-Jun-06	ND<1	ND<1	2.8	ND<1	ND<1	ND<1	8.40	0.897	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	20-Jul-06	1.0	ND<1	4.0	ND<1	ND<1	ND<1	10.80	0.175	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	24-Aug-06	ND<1	ND<1	3.2	ND<1	ND<1	ND<1	5.98	1.860	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
19-Sep-06	ND<1	ND<1	3.0	ND<1	ND<1	ND<1	7.44	0.009	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1		
24-Oct-06	0.9	ND<1	3.1	ND<1	ND<1	ND<1	8.32	0.0605	2.0	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1		

TABLE 4

GROUND-WATER REMEDIAL ACTION  
 ROWE INDUSTRIES SUPERFUND SITE  
 SAG HARBOR, NEW YORK

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE	TCE	TCA	Vinyl Acetate	Chloroform	MTBE	Total Iron	Dissolved Iron	1,1-Dichloroethane	cis-1,2-Dichloroethene	1,1-Dichloroethene	Methylene Chloride <sup>1/</sup>	Toluene	Dibromochloromethane	Acetone <sup>1/</sup>	
		(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(mg/L)	(mg/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	(ug/L)	
ARAR's	5	5	5	5	NE	7	NE	300	300	5	5	5	5	NE	NE	NE	
RW-9	15-Sep-04	3.7	1.0	<b>6.0</b>	ND<1	ND<1	ND<1	0.049	ND<0.02	1.9	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	7-Oct-04	3.1	ND<1	<b>5.0</b>	ND<1	ND<1	ND<1	3.12	0.716	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	3-Nov-04	1.6	ND<1	<b>5.9</b>	ND<1	ND<1	ND<1	2.97	1.41	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Dec-04	1.3	ND<1	<b>31</b>	ND<1	ND<1	ND<1	2.78	0.497	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	4-Jan-05	ND<1	1.0	<b>6.4</b>	ND<1	ND<1	ND<1	2.35	1.72	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Feb-05	ND<1	ND<1	<b>10</b>	ND<1	ND<1	ND<1	0.0974	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Mar-05	ND<1	1.4	<b>5.9</b>	ND<1	ND<1	ND<1	1.55	0.507	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Apr-05	ND<1	ND<1	4.5	ND<1	ND<1	ND<1	1.59	0.091	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	2-May-05	ND<1	2.9	<b>9.0</b>	ND<1	ND<1	ND<1	2.89	0.0596	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	16-Jun-05	ND<1	ND<1	<b>5.8</b>	ND<1	ND<1	ND<1	1.38	0.149	0.9	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	14-Jul-05	3.4	ND<1	3.1	ND<1	ND<1	ND<1	2.55	0.238	ND<1	ND<1	ND<1	<b>6.9 *</b>	ND<1	ND<1	7.3 *	
	9-Aug-05	ND<1	ND<1	1.4	ND<1	ND<1	ND<1	0.994	0.0734	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Sep-05	1.2	ND<1	2.0	ND<1	ND<1	ND<1	3.64	0.161	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	1.31	0.108	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Dec-05	ND<1	ND<1	2.9	ND<1	ND<1	ND<1	2.01	0.024	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	12-Jan-06	ND<1	ND<1	1.4	ND<1	ND<1	ND<1	2.36	0.0905	ND<1	ND<1	ND<1	4.9 *	ND<1	ND<1	ND<1	
	14-Feb-06	2.1	ND<1	1.8	ND<1	ND<1	ND<1	5.23	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	7-Mar-06	1.3	ND<1	ND<1	ND<1	ND<1	ND<1	3.41	0.333	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	12-Apr-06	ND<1	ND<1	2.2	ND<1	ND<1	ND<1	1.93	0.108	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	17-May-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	1.64	0.054	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	21-June-06 <sup>2/</sup>	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	20-Jul-06	ND<1	ND<1	2.2	ND<1	ND<1	ND<1	3.5	0.695	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	24-Aug-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.97	0.0165	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
19-Sep-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	5.16	ND<0.02	ND<1	ND<1	ND<1	ND<1	18*	ND<1	ND<1		
24-Oct-06	ND<1	ND<1	1.5	ND<1	ND<1	ND<1	6.96	0.00719	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1		

ND: Not detected

<#: Less than method detection limit

ug/L: Micrograms per liter

-: Not analyzed

ARAR's are chemical specific aquifer restoration goals for ground water at the Former Rowe Industries Superfund Site. Bold values indicate an exceedance of the ARAR standard established for the site.

PCE: Tetrachloroethylene

TCE: Trichloroethene

TCA: 1,1,1-Trichloroethane

1,1-DCA: 1,1-Dichloroethane

1,1-DCE: 1,1-Dichloroethene

1,2-DCE: 1,2-Dichloroethene

MTBE: Methyl Tertiary Butyl Ether

NM: Not Measured

NE indicates that the ARAR goal was not established for this compound by the EPA.

\*Concentrations with an asterisk following them are due to laboratory contamination.


<sup>1/</sup> RW-3 is currently non operational weighting for the reprogramming of the drive for the new 4 amp pump.

<sup>2/</sup> RW-9 was being rehabilitated during this sampling event, thus no water sample was collected.

## **GRAPHS**


**GRAPH 1**  
**GROUND-WATER REMEDIAL ACTION**  
**ROWE INDUSTRIES SUPERFUND SITE**  
**SAG HARBOR, NEW YORK**

**EFFLUENT FLOW DATA**  
(October 1, 2006 through October 31, 2006)

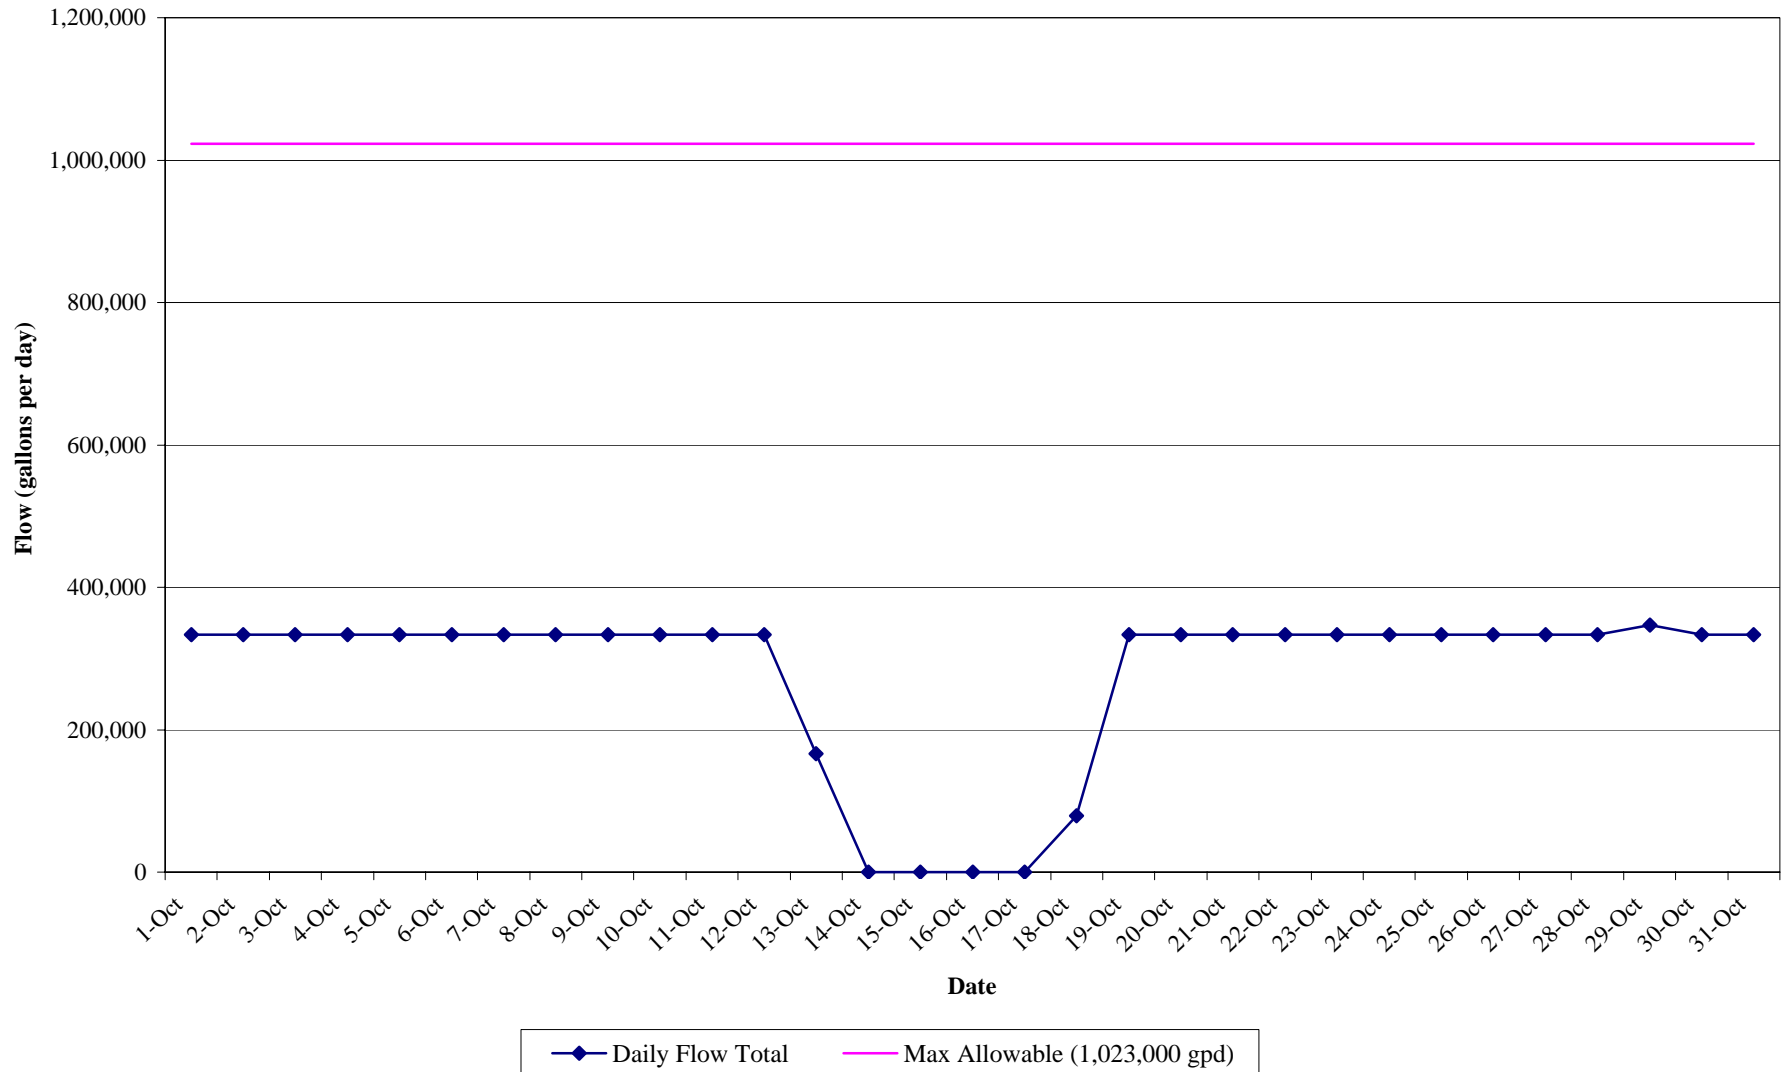


**GRAPH 2**  
**GROUND-WATER REMEDIAL ACTION**  
**ROWE INDUSTRIES SUPERFUND SITE**  
**SAG HARBOR, NEW YORK**

**RECOVERY WELL PCE CONCENTRATION IN MICROGRAMS PER LITER**

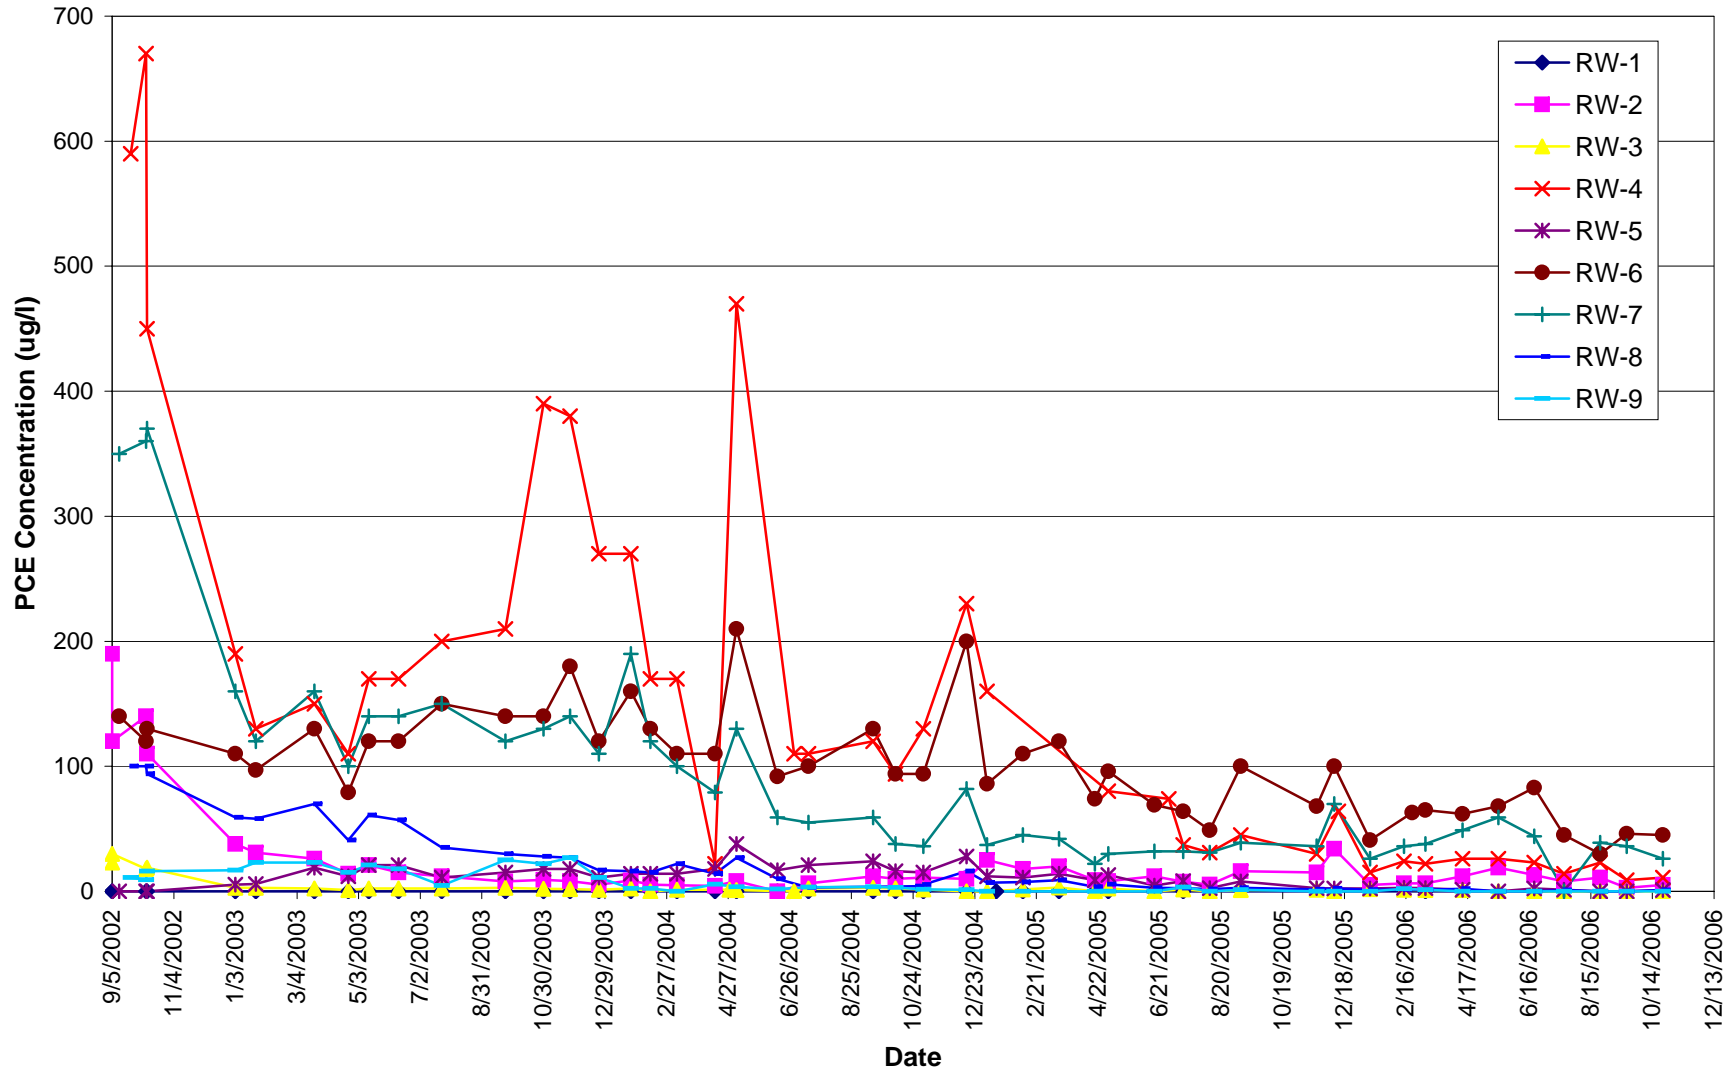

**GRAPH 3**  
**GROUND-WATER REMEDIAL ACTION**  
**ROWE INDUSTRIES SUPERFUND SITE**  
**SAG HARBOR, NEW YORK**

**RECOVERY WELL PCE CONCENTRATION FOR SELECT RECOVERY WELLS**

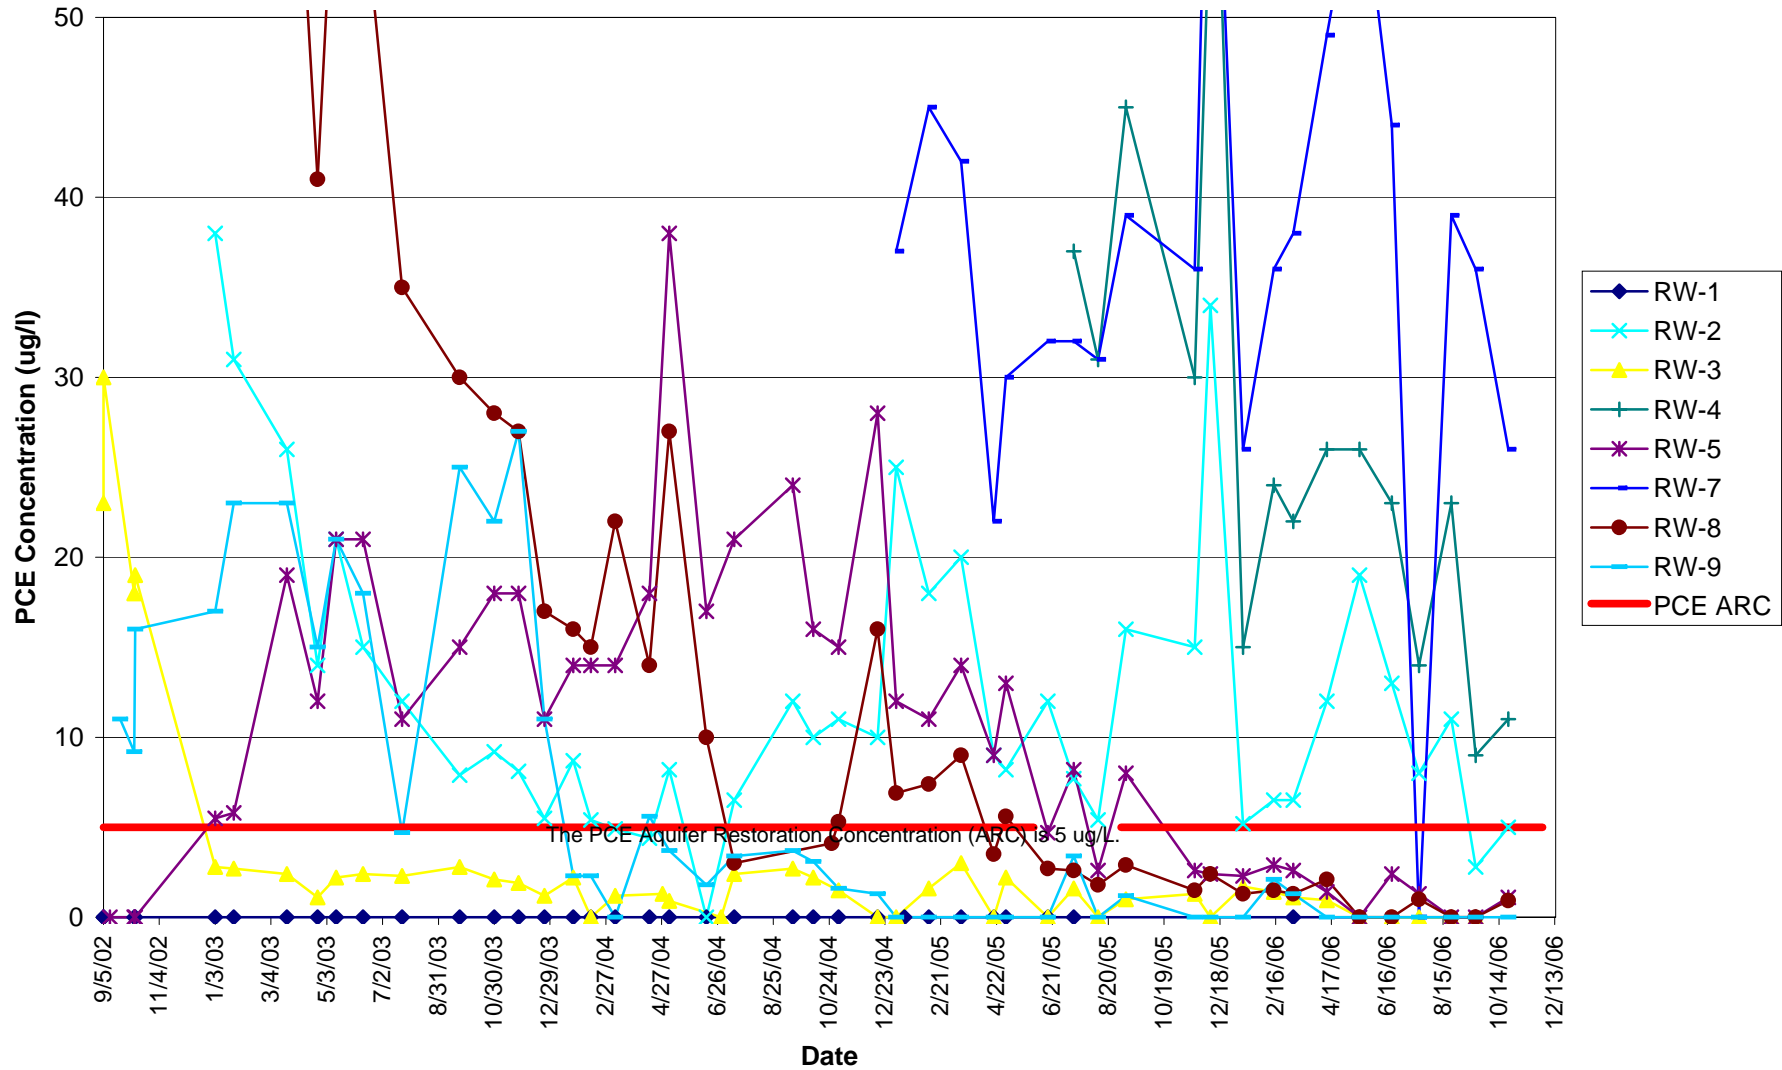



**APPENDIX I**  
**OCTOBER 2006 LABORATORY ANALYTICAL REPORTS**

Monday, October 16, 2006

Mark Goldberg  
Leggette Brashears & Graham Inc.  
4 Research Drive  
Suite 301  
Shelton, CT 06484

TEL: (203) 929-8555

FAX (203) 926-9140

RE: Rowe Industries

Dear Mark Goldberg:

Order No.: 0610065

American Analytical Laboratories, LLC. received 3 sample(s) on 10/6/2006 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at [lbeyer@american-analytical.com](mailto:lbeyer@american-analytical.com).

Sincerely,



Lori Beyer  
Lab Director

---

**CLIENT:** Leggette Brashears & Graham Inc.  
**Project:** Rowe Industries  
**Lab Order:** 0610065

**Work Order Sample Summary**

---

<b>Lab Sample ID</b>	<b>Client Sample ID</b>	<b>Tag Number</b>	<b>Date Collected</b>	<b>Date Received</b>
0610065-01A	WQ100406:800 NP-2-6	10279	10/4/2006	10/6/2006
0610065-01B	WQ100406:800 NP-2-6	10279	10/4/2006	10/6/2006
0610065-02A	WQ100406:800 NP-2-7	10279	10/4/2006	10/6/2006
0610065-02B	WQ100406:800 NP-2-7	10279	10/4/2006	10/6/2006
0610065-03A	WQ100406:800 NP-2-10	10279	10/4/2006	10/6/2006
0610065-03B	WQ100406:800 NP-2-10	10279	10/4/2006	10/6/2006

## CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

CLIENT NAME/ADDRESS

*L.B.G. Research Pr. Shelton, CT*  
**CONTACT:** *Mark Goldberg*

SAMPLER (SIGNATURE)

*[Signature]*

SAMPLE(S) SEALED  YES  NO

SAMPLER NAME (PRINT)

*Robert Drew*

CORRECT CONTAINER(S)  YES  NO

PROJECT LOCATION:

*Flowe*

LABORATORY ID #	MATRIX	# CONTAINERS	SAMPLING DATE/TIME	SAMPLE # - LOCATION	ANALYSIS REQUIRED	FOR METHANOL PRESERVED SAMPLES (VOLATILE VIAL #)
0610065-01AA	W	4	10-4-06	W060406 : 800 NP2-6	X X X X	
-02AA	↓	4	↓	↓ : 805 NP2-7	X X X X	
-03AA	↓	5	↓	↓ : 810 NP2-10	X X X X	

*0210  
MTLC  
Fres. 113  
Tot. + Diss. Fr.  
TDS*

**MATRIX** S=SOIL; L=LIQUID; SL=SLUDGE; A=AIR; W=WIPE; P=PAINT CHIPS; B=BULK MATERIAL  
**TYPE** G=GRAB; C=COMPOSITE; SS=SPLIT SPOON

**COOLER TEMPERATURE:**

**COMMENTS / INSTRUCTIONS:**

RELINQUISHED BY (SIGNATURE)	DATE TIME	PRINTED NAME
<i>[Signature]</i>	10-4-06 1700	Rob Drew
RECEIVED BY LAB (SIGNATURE)	DATE TIME	PRINTED NAME
<i>[Signature]</i>	10/6/06 1436	Craig Maceri
RECEIVED BY LAB (SIGNATURE)	DATE TIME	PRINTED NAME

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

**AMERICAN ANALYTICAL LABORATORIES, LLC**

**56 TOLEDO STREET**

**FARMINGDALE, NEW YORK 11735**

**TELEPHONE: (631) 454-6100      FAX: (631) 454-8027**

**DATA REPORTING QUALIFIERS**

For reporting results, the following "Results Qualifiers" are used:

<b>Value</b>	If the result is greater than or equal to the detection limit, report the value
<b>U</b>	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
<b>J</b>	Indicates an estimated value. The flag is used: <ol style="list-style-type: none"><li>(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)</li><li>(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.</li></ol>
<b>B</b>	Indicates the analyte was found in the blank as well as the sample report "10B".
<b>E</b>	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
<b>D</b>	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
<b>P</b>	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
<b>N</b>	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
<b>H</b>	Indicates sample was received and/or analyzed outside of The method allowable holding time

**American Analytical Laboratories, LLC.**

Date: 16-Oct-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ100406:800 NP-2-6
<b>Lab Order:</b>	0610065	<b>Tag Number:</b>	10279
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/4/2006
<b>Lab ID:</b>	0610065-01A	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		<b>Analyst: JP</b>
Iron	1.98	0.0200		mg/L	1	10/10/2006 10:30:10 AM
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>				<b>Analyst: MMR</b>
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
1,1,1-Trichloroethane	21	1.0		µg/L	1	10/10/2006 3:42:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
2-Butanone	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
2-Hexanone	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Acetone	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Benzene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Bromobenzene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Bromochloromethane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Bromodichloromethane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Bromoform	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Bromomethane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Carbon disulfide	U	1.0		µg/L	1	10/10/2006 3:42:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 16-Oct-06

<b>CLIENT:</b> Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b> WQ100406:800 NP-2-6
<b>Lab Order:</b> 0610065	<b>Tag Number:</b> 10279
<b>Project:</b> Rowe Industries	<b>Collection Date:</b> 10/4/2006
<b>Lab ID:</b> 0610065-01A	<b>Matrix:</b> LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		Analyst: MMR		
Carbon tetrachloride	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Chlorobenzene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Chloroethane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Chloroform	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Chloromethane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Dibromochloromethane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Dibromomethane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Ethylbenzene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Isopropylbenzene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
m,p-Xylene	U	2.0		µg/L	1	10/10/2006 3:42:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Methylene chloride	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Naphthalene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
n-Butylbenzene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
n-Propylbenzene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
o-Xylene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Styrene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Tetrachloroethene	11	1.0		µg/L	1	10/10/2006 3:42:00 AM
Toluene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Trichloroethene	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Vinyl acetate	U	1.0		µg/L	1	10/10/2006 3:42:00 AM
Vinyl chloride	U	1.0		µg/L	1	10/10/2006 3:42:00 AM

<b>Qualifiers:</b>	B Analyte detected in the associated Method Blank	E Value above quantitation range
	H Holding times for preparation or analysis exceeded	J Analyte detected below quantitation limits
	ND Not Detected at the Reporting Limit	S Spike Recovery outside accepted recovery limits
	U Indicates the compound was analyzed for but not detected	X Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 16-Oct-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ100406:800 NP-2-6
<b>Lab Order:</b>	0610065	<b>Tag Number:</b>	10279
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/4/2006
<b>Lab ID:</b>	0610065-01B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: JP
Iron	0.0122	0.0200	J	mg/L	1	10/10/2006 10:32:55 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



# American Analytical Laboratories, LLC.

Date: 16-Oct-06

<b>CLIENT:</b> Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b> WQ100406:800 NP-2-7
<b>Lab Order:</b> 0610065	<b>Tag Number:</b> 10279
<b>Project:</b> Rowe Industries	<b>Collection Date:</b> 10/4/2006
<b>Lab ID:</b> 0610065-02A	<b>Matrix:</b> LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		<b>Analyst: JP</b>
Iron	1.39	0.0200		mg/L	1	10/10/2006 10:40:57 AM
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>				<b>Analyst: MMR</b>
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
2-Butanone	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
2-Hexanone	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Acetone	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Benzene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Bromobenzene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Bromochloromethane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Bromodichloromethane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Bromoform	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Bromomethane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Carbon disulfide	U	1.0		µg/L	1	10/10/2006 4:25:00 AM

<b>Qualifiers:</b>	B Analyte detected in the associated Method Blank	E Value above quantitation range
	H Holding times for preparation or analysis exceeded	J Analyte detected below quantitation limits
	ND Not Detected at the Reporting Limit	S Spike Recovery outside accepted recovery limits
	U Indicates the compound was analyzed for but not detected	X Value exceeds Maximum Contaminant Level

# American Analytical Laboratories, LLC.

Date: 16-Oct-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ100406:800 NP-2-7
<b>Lab Order:</b>	0610065	<b>Tag Number:</b>	10279
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/4/2006
<b>Lab ID:</b>	0610065-02A	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>				Analyst: MMR
Carbon tetrachloride	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Chlorobenzene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Chloroethane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Chloroform	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Chloromethane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Dibromochloromethane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Dibromomethane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Ethylbenzene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Isopropylbenzene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
m,p-Xylene	U	2.0		µg/L	1	10/10/2006 4:25:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Methylene chloride	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Naphthalene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
n-Butylbenzene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
n-Propylbenzene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
o-Xylene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Styrene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Tetrachloroethene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Toluene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Trichloroethene	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Vinyl acetate	U	1.0		µg/L	1	10/10/2006 4:25:00 AM
Vinyl chloride	U	1.0		µg/L	1	10/10/2006 4:25:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 16-Oct-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ100406:800 NP-2-7
<b>Lab Order:</b>	0610065	<b>Tag Number:</b>	10279
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/4/2006
<b>Lab ID:</b>	0610065-02B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: JP
Iron	0.0547	0.0200		mg/L	1	10/10/2006 10:39:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 16-Oct-06

<b>CLIENT:</b> Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b> WQ100406:800 NP-2-10
<b>Lab Order:</b> 0610065	<b>Tag Number:</b> 10279
<b>Project:</b> Rowe Industries	<b>Collection Date:</b> 10/4/2006
<b>Lab ID:</b> 0610065-03A	<b>Matrix:</b> LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		<b>Analyst: JP</b>
Iron	1.63	0.0200		mg/L	1	10/10/2006 10:45:25 AM
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>				<b>Analyst: MMR</b>
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
2-Butanone	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
2-Hexanone	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Acetone	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Benzene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Bromobenzene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Bromochloromethane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Bromodichloromethane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Bromofom	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Bromomethane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Carbon disulfide	U	1.0		µg/L	1	10/10/2006 5:07:00 AM

<b>Qualifiers:</b>	B Analyte detected in the associated Method Blank	E Value above quantitation range
	H Holding times for preparation or analysis exceeded	J Analyte detected below quantitation limits
	ND Not Detected at the Reporting Limit	S Spike Recovery outside accepted recovery limits
	U Indicates the compound was analyzed for but not detecte	X Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 16-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610065  
**Project:** Rowe Industries  
**Lab ID:** 0610065-03A

**Client Sample ID:** WQ100406:800 NP-2-10  
**Tag Number:** 10279  
**Collection Date:** 10/4/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		Analyst: MMR		
Carbon tetrachloride	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Chlorobenzene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Chloroethane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Chloroform	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Chloromethane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Dibromochloromethane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Dibromomethane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Ethylbenzene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Isopropylbenzene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
m,p-Xylene	U	2.0		µg/L	1	10/10/2006 5:07:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Methylene chloride	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Naphthalene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
n-Butylbenzene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
n-Propylbenzene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
o-Xylene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Styrene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Tetrachloroethene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Toluene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Trichloroethene	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Vinyl acetate	U	1.0		µg/L	1	10/10/2006 5:07:00 AM
Vinyl chloride	U	1.0		µg/L	1	10/10/2006 5:07:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 16-Oct-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ100406:800 NP-2-10
<b>Lab Order:</b>	0610065	<b>Tag Number:</b>	10279
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/4/2006
<b>Lab ID:</b>	0610065-03B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON</b>		<b>E200.7</b>		<b>SW3005A</b>		
Iron	0.0911	0.0200		mg/L	1	Analyst: JP 10/10/2006 10:43:11 AM
<b>TOTAL DISSOLVED SOLIDS</b>		<b>E160.1</b>				
Total Dissolved Solids (Residue, Filterable)	82.0	1.00		mg/L	1	Analyst: JC 10/10/2006

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



NYSDOH 11418  
NJDEP NY050  
CTDOH PH-0205  
PADEP 68-00573

Tuesday, October 24, 2006

Mark Goldberg  
Leggette Brashears & Graham Inc.  
4 Research Drive  
Suite 301  
Shelton, CT 06484

TEL: (203) 929-8555  
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0610099

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 10/12/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at [lbeyer@american-analytical.com](mailto:lbeyer@american-analytical.com).

Sincerely,

  
Lori Beyer  
Lab Director

**CLIENT:** Leggette Brashears & Graham Inc.  
**Project:** Rowe Industries  
**Lab Order:** 0610099

**Work Order Sample Summary**

---

<b>Lab Sample ID</b>	<b>Client Sample ID</b>	<b>Tag Number</b>	<b>Date Collected</b>	<b>Date Received</b>
0610099-01A	WQ101006:800NP2-6	10280	10/10/2006	10/12/2006
0610099-01B	WQ101006:800NP2-6	10280	10/10/2006	10/12/2006
0610099-02A	WQ101006:805NP2-7	10280	10/10/2006	10/12/2006
0610099-02B	WQ101006:805NP2-7	10280	10/10/2006	10/12/2006
0610099-03A	WQ101006:810NP2-10	10280	10/10/2006	10/12/2006
0610099-03B	WQ101006:810NP2-10	10280	10/10/2006	10/12/2006





# CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

CLIENT NAME/ADDRESS: 186 4 Research Dr, Shelton, CT

CONTACT: Mark Goldbey

PROJECT LOCATION: Row

SAMPLER (SIGNATURE): [Signature]

SAMPLER NAME (PRINT): Rob Drew

SAMPLE(S) SEALED: YES / NO

CORRECT CONTAINER(S): YES / NO

FOR METHANOL PRESERVED SAMPLES (VOLATILE VIAL #)

LABORATORY ID #	MATRIX	# CONTAINERS	SAMPLING DATE/TIME	SAMPLE # - LOCATION	ANALYSIS REQUIRED	RECEIVED BY LAB (SIGNATURE)	RECEIVED BY LAB (SIGNATURE)	DATE TIME	DATE TIME	PRINTED NAME	PRINTED NAME
0610099-01AB	W	4	10-10-06	W8101006; 800 NP2-6	X	[Signature]	[Signature]	10-11-06	10-24	Craig Mas	Craig Mas
-02AB	↓	4	↓	↓; 805 NP2-7	X	[Signature]	[Signature]				
-03AB	↓	5	↓	↓; 810 NP2-10	X	[Signature]	[Signature]				

COOLER TEMPERATURE: \_\_\_\_\_

COMMENTS / INSTRUCTIONS: \_\_\_\_\_

TURNAROUND REQUIRED: \_\_\_\_\_

RECEIVED BY LAB (SIGNATURE): [Signature] BY [Signature]

MATRIX S=SOIL; L=LIQUID; SL=SLUDGE; A-AIR; W=WIPE; P=PAINT CHIPS; B=BULK MATERIAL

TYPE G=GRAB; C=COMPOSITE, SS=SPLIT SPOON

RECEIVED BY LAB (SIGNATURE): [Signature] DATE TIME: 10-11-06

RECEIVED BY LAB (SIGNATURE): [Signature] DATE TIME: 10-24

PRINTED NAME: Rob Drew

PRINTED NAME: Craig Mas

# AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

## DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: <ol style="list-style-type: none"><li>(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)</li><li>(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.</li></ol>
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

**American Analytical Laboratories, LLC.**

Date: 24-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610099  
**Project:** Rowe Industries  
**Lab ID:** 0610099-01A

**Client Sample ID:** WQ101006:800NP2-6  
**Tag Number:** 10280  
**Collection Date:** 10/10/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: JP
Iron	2.53	0.0200		mg/L	1	10/16/2006 1:58:00 PM
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
1,1,1-Trichloroethane	14	1.0		µg/L	1	10/17/2006 6:15:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
2-Butanone	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
2-Hexanone	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Acetone	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Benzene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Bromobenzene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Bromochloromethane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Bromodichloromethane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Bromoform	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Bromomethane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Carbon disulfide	U	1.0		µg/L	1	10/17/2006 6:15:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 24-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610099  
**Project:** Rowe Industries  
**Lab ID:** 0610099-01A

**Client Sample ID:** WQ101006:800NP2-6  
**Tag Number:** 10280  
**Collection Date:** 10/10/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>	<b>SW5030A</b>			Analyst: LDS
Carbon tetrachloride	1.6	1.0		µg/L	1	10/17/2006 6:15:00 PM
Chlorobenzene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Chloroethane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Chloroform	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Chloromethane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Dibromochloromethane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Dibromomethane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Ethylbenzene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Isopropylbenzene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
m,p-Xylene	U	2.0		µg/L	1	10/17/2006 6:15:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Methylene chloride	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Naphthalene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
n-Butylbenzene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
n-Propylbenzene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
o-Xylene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Styrene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Tetrachloroethene	6.0	1.0		µg/L	1	10/17/2006 6:15:00 PM
Toluene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Trichloroethene	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Vinyl acetate	U	1.0		µg/L	1	10/17/2006 6:15:00 PM
Vinyl chloride	U	1.0		µg/L	1	10/17/2006 6:15:00 PM

**Qualifiers:** B Analyte detected in the associated Method Blank E Value above quantitation range  
H Holding times for preparation or analysis exceeded J Analyte detected below quantitation limits  
ND Not Detected at the Reporting Limit S Spike Recovery outside accepted recovery limits  
U Indicates the compound was analyzed for but not detected X Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 24-Oct-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ101006:800NP2-6
<b>Lab Order:</b>	0610099	<b>Tag Number:</b>	10280
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/10/2006
<b>Lab ID:</b>	0610099-01B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: JP
Iron	0.0171	0.0200	J	mg/L	1	10/16/2006 1:56:07 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 24-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610099  
**Project:** Rowe Industries  
**Lab ID:** 0610099-02A

**Client Sample ID:** WQ101006:805NP2-7  
**Tag Number:** 10280  
**Collection Date:** 10/10/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: JP
Iron	1.21	0.0200		mg/L	1	10/16/2006 2:02:59 PM
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
2-Butanone	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
2-Hexanone	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Acetone	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Benzene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Bromobenzene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Bromochloromethane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Bromodichloromethane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Bromoform	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Bromomethane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Carbon disulfide	U	1.0		µg/L	1	10/17/2006 7:00:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 24-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610099  
**Project:** Rowe Industries  
**Lab ID:** 0610099-02A

**Client Sample ID:** WQ101006:805NP2-7  
**Tag Number:** 10280  
**Collection Date:** 10/10/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
Carbon tetrachloride	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Chlorobenzene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Chloroethane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Chloroform	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Chloromethane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Dibromochloromethane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Dibromomethane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Ethylbenzene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Isopropylbenzene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
m,p-Xylene	U	2.0		µg/L	1	10/17/2006 7:00:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Methylene chloride	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Naphthalene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
n-Butylbenzene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
n-Propylbenzene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
o-Xylene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Styrene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Tetrachloroethene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Toluene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Trichloroethene	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Vinyl acetate	U	1.0		µg/L	1	10/17/2006 7:00:00 PM
Vinyl chloride	U	1.0		µg/L	1	10/17/2006 7:00:00 PM

**Qualifiers:** B Analyte detected in the associated Method Blank E Value above quantitation range  
H Holding times for preparation or analysis exceeded J Analyte detected below quantitation limits  
ND Not Detected at the Reporting Limit S Spike Recovery outside accepted recovery limits  
U Indicates the compound was analyzed for but not detected X Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 24-Oct-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ101006:805NP2-7
<b>Lab Order:</b>	0610099	<b>Tag Number:</b>	10280
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/10/2006
<b>Lab ID:</b>	0610099-02B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.0399	0.0200		mg/L	1	10/16/2006 2:00:53 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level



# American Analytical Laboratories, LLC.

Date: 24-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610099  
**Project:** Rowe Industries  
**Lab ID:** 0610099-03A

**Client Sample ID:** WQ101006:810NP2-10  
**Tag Number:** 10280  
**Collection Date:** 10/10/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: JP
Iron	1.07	0.0200		mg/L	1	10/16/2006 2:12:29 PM
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
2-Butanone	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
2-Hexanone	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Acetone	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Benzene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Bromobenzene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Bromochloromethane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Bromodichloromethane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Bromoform	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Bromomethane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Carbon disulfide	U	1.0		µg/L	1	10/17/2006 7:42:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 24-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610099  
**Project:** Rowe Industries  
**Lab ID:** 0610099-03A

**Client Sample ID:** WQ101006:810NP2-10  
**Tag Number:** 10280  
**Collection Date:** 10/10/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
Carbon tetrachloride	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Chlorobenzene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Chloroethane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Chloroform	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Chloromethane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Dibromochloromethane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Dibromomethane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Ethylbenzene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Isopropylbenzene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
m,p-Xylene	U	2.0		µg/L	1	10/17/2006 7:42:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Methylene chloride	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Naphthalene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
n-Butylbenzene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
n-Propylbenzene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
o-Xylene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Styrene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Tetrachloroethene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Toluene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Trichloroethene	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Vinyl acetate	U	1.0		µg/L	1	10/17/2006 7:42:00 PM
Vinyl chloride	U	1.0		µg/L	1	10/17/2006 7:42:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level


**American Analytical Laboratories, LLC.**

Date: 24-Oct-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ101006:810NP2-10
<b>Lab Order:</b>	0610099	<b>Tag Number:</b>	10280
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/10/2006
<b>Lab ID:</b>	0610099-03B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: JP
Iron	0.0609	0.0200		mg/L	1	10/16/2006 2:10:38 PM
<b>TOTAL DISSOLVED SOLIDS</b>		<b>E160.1</b>				Analyst: JC
Total Dissolved Solids (Residue, Filterable)	100	1.00		mg/L	1	10/16/2006

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

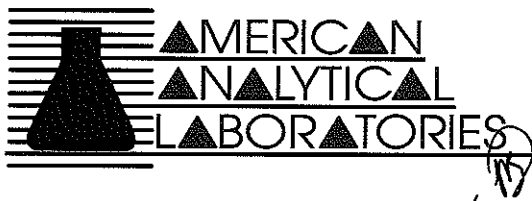

NYSDOH 11418  
NJDEP NY050  
CTDOH PH-0205  
PADEP 68-00573

Wednesday, October 25, 2006

Mark Goldberg  
Leggette Brashears & Graham Inc.  
4 Research Drive  
Suite 301  
Shelton, CT 06484

TEL: (203) 929-8555  
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0610173

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 10/18/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at [lbeyer@american-analytical.com](mailto:lbeyer@american-analytical.com).

Sincerely,

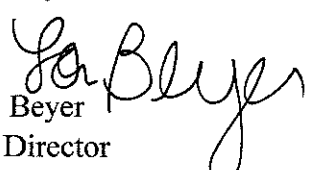  
Lori Beyer  
Lab Director

---

**CLIENT:** Leggette Brashears & Graham Inc.  
**Project:** Rowe Industries  
**Lab Order:** 0610173

**Work Order Sample Summary**

---

<b>Lab Sample ID</b>	<b>Client Sample ID</b>	<b>Tag Number</b>	<b>Date Collected</b>	<b>Date Received</b>
0610173-01A	WQ101806:800NP2-6	12575	10/18/2006	10/18/2006
0610173-01B	WQ101806:800NP2-6	12575	10/18/2006	10/18/2006
0610173-02A	WQ101806:805NP2-7	12575	10/18/2006	10/18/2006
0610173-02B	WQ101806:805NP2-7	12575	10/18/2006	10/18/2006
0610173-03A	WQ101806:810NP2-10	12575	10/18/2006	10/18/2006
0610173-03B	WQ101806:810NP2-10	12575	10/18/2006	10/18/2006

TAG # / COC 12575

# CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

CLIENT NAME/ADDRESS  
*L-66  
4 Research Dr.  
Shelton CT*

CONTACT:  
*Mark Goldberg*

SAMPLER (SIGNATURE)  
*[Signature]*

SAMPLE(S) SEALED  
 YES / NO

SAMPLER NAME (PRINT)  
*Rob Drew*

CORRECT CONTAINER(S)  
 YES / NO

PROJECT LOCATION:  
*Rowe*

LABORATORY ID #	MATRIX	# CONTAINERS	SAMPLING DATE/ TIME	SAMPLE # - LOCATION
06/0173-01AB	<i>W</i>	<i>4</i>	<i>10-18-06</i>	<i>WR101806; 800 MP2-6</i>
<i>-02AB</i>	<i>↓</i>	<i>4</i>	<i>↓</i>	<i>↓ 805 MP2-7</i>
<i>-03AB</i>	<i>↓</i>	<i>5</i>	<i>↓</i>	<i>↓ 810 MP2-10</i>

ANALYSIS REQUIRED  
*MT BE  
Tetra 113  
TDs  
For*

FOR METHANOL PRESERVED SAMPLES  
(VOLATILE VIAL #)

COOLER TEMPERATURE:

COMMENTS / INSTRUCTIONS

TURNAROUND REQUIRED:  
NORMAL  STAT  BY / /

MATRIX S=SOIL; L=LIVID; SL=SLUDGE; A-AIR; W=WIPE; P=PAINT CHIPS; B=BULK MATERIAL

TYPE G=GRAB; C=COMPOSITE, SS=SPLIT SPOON

RELINQUISHED BY (SIGNATURE)	DATE TIME	PRINTED NAME	RECEIVED BY LAB (SIGNATURE)	DATE TIME
<i>[Signature]</i>	<i>10-18-06 1009</i>	<i>Rob Drew</i>	<i>[Signature]</i>	<i>10:07</i>
RELINQUISHED BY (SIGNATURE)	DATE TIME	PRINTED NAME	RECEIVED BY LAB (SIGNATURE)	DATE TIME
<i>[Signature]</i>			<i>[Signature]</i>	

**AMERICAN ANALYTICAL LABORATORIES, LLC**

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

**DATA REPORTING QUALIFIERS**

For reporting results, the following "Results Qualifiers" are used:

<b>Value</b>	If the result is greater than or equal to the detection limit, report the value
<b>U</b>	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
<b>J</b>	Indicates an estimated value. The flag is used: <ol style="list-style-type: none"><li>(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)</li><li>(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.</li></ol>
<b>B</b>	Indicates the analyte was found in the blank as well as the sample report "10B".
<b>E</b>	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
<b>D</b>	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
<b>P</b>	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
<b>N</b>	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
<b>H</b>	Indicates sample was received and/or analyzed outside of The method allowable holding time

**American Analytical Laboratories, LLC.**

Date: 25-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610173  
**Project:** Rowe Industries  
**Lab ID:** 0610173-01A

**Client Sample ID:** WQ101806:800NP2-6  
**Tag Number:** 12575  
**Collection Date:** 10/18/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: JP
Iron	3.16	0.0200		mg/L	1	10/19/2006 12:56:26 PM
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
1,1,1-Trichloroethane	15	1.0		µg/L	1	10/22/2006 8:26:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
1,1-Dichloroethane	1.1	1.0		µg/L	1	10/22/2006 8:26:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
2-Butanone	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
2-Hexanone	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Acetone	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Benzene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Bromobenzene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Bromochloromethane	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Bromodichloromethane	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Bromoform	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Bromomethane	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Carbon disulfide	U	1.0		µg/L	1	10/22/2006 8:26:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



**American Analytical Laboratories, LLC.**

Date: 25-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610173  
**Project:** Rowe Industries  
**Lab ID:** 0610173-01A

**Client Sample ID:** WQ101806:800NP2-6  
**Tag Number:** 12575  
**Collection Date:** 10/18/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
Carbon tetrachloride	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Chlorobenzene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Chloroethane	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Chloroform	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Chloromethane	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Dibromochloromethane	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Dibromomethane	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Ethylbenzene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Isopropylbenzene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
m,p-Xylene	U	2.0		µg/L	1	10/22/2006 8:26:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Methylene chloride	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Naphthalene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
n-Butylbenzene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
n-Propylbenzene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
o-Xylene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Styrene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Tetrachloroethene	12	1.0		µg/L	1	10/22/2006 8:26:00 PM
Toluene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Trichloroethene	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Vinyl acetate	U	1.0		µg/L	1	10/22/2006 8:26:00 PM
Vinyl chloride	U	1.0		µg/L	1	10/22/2006 8:26:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 25-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610173  
**Project:** Rowe Industries  
**Lab ID:** 0610173-01B

**Client Sample ID:** WQ101806:800NP2-6  
**Tag Number:** 12575  
**Collection Date:** 10/18/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON</b> Iron	0.0282	E200.7		mg/L	1	Analyst: JP 10/19/2006 12:53:04 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 25-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610173  
**Project:** Rowe Industries  
**Lab ID:** 0610173-02A

**Client Sample ID:** WQ101806:805NP2-7  
**Tag Number:** 12575  
**Collection Date:** 10/18/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		<b>Analyst: JP</b>
Iron	6.69	0.0200		mg/L	1	10/19/2006 1:07:42 PM
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		<b>Analyst: LDS</b>
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
2-Butanone	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
2-Hexanone	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Acetone	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Benzene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Bromobenzene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Bromochloromethane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Bromodichloromethane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Bromoform	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Bromomethane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Carbon disulfide	U	1.0		µg/L	1	10/22/2006 9:04:00 PM

**Qualifiers:** B Analyte detected in the associated Method Blank E Value above quantitation range  
H Holding times for preparation or analysis exceeded J Analyte detected below quantitation limits  
ND Not Detected at the Reporting Limit S Spike Recovery outside accepted recovery limits  
U Indicates the compound was analyzed for but not detected X Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 25-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610173  
**Project:** Rowe Industries  
**Lab ID:** 0610173-02A

**Client Sample ID:** WQ101806:805NP2-7  
**Tag Number:** 12575  
**Collection Date:** 10/18/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		<b>Analyst: LDS</b>
Carbon tetrachloride	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Chlorobenzene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Chloroethane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Chloroform	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Chloromethane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Dibromochloromethane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Dibromomethane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Ethylbenzene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Isopropylbenzene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
m,p-Xylene	U	2.0		µg/L	1	10/22/2006 9:04:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Methylene chloride	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Naphthalene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
n-Butylbenzene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
n-Propylbenzene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
o-Xylene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Styrene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Tetrachloroethene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Toluene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Trichloroethene	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Vinyl acetate	U	1.0		µg/L	1	10/22/2006 9:04:00 PM
Vinyl chloride	U	1.0		µg/L	1	10/22/2006 9:04:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

**Date:** 25-Oct-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ101806:805NP2-7
<b>Lab Order:</b>	0610173	<b>Tag Number:</b>	12575
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/18/2006
<b>Lab ID:</b>	0610173-02B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.0449	0.0200		mg/L	1	10/19/2006 12:58:54 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 25-Oct-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ101806:810NP2-10
<b>Lab Order:</b>	0610173	<b>Tag Number:</b>	12575
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/18/2006
<b>Lab ID:</b>	0610173-03A	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		<b>Analyst: JP</b>
Iron	2.72	0.0200		mg/L	1	10/19/2006 1:11:30 PM
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		<b>Analyst: LDS</b>
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
2-Butanone	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
2-Hexanone	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Acetone	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Benzene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Bromobenzene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Bromochloromethane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Bromodichloromethane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Bromoform	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Bromomethane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Carbon disulfide	U	1.0		µg/L	1	10/22/2006 9:42:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

# American Analytical Laboratories, LLC.

Date: 25-Oct-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ101806:810NP2-10
<b>Lab Order:</b>	0610173	<b>Tag Number:</b>	12575
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/18/2006
<b>Lab ID:</b>	0610173-03A	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		<b>Analyst: LDS</b>
Carbon tetrachloride	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Chlorobenzene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Chloroethane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Chloroform	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Chloromethane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Dibromochloromethane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Dibromomethane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Ethylbenzene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Isopropylbenzene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
m,p-Xylene	U	2.0		µg/L	1	10/22/2006 9:42:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Methylene chloride	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Naphthalene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
n-Butylbenzene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
n-Propylbenzene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
o-Xylene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Styrene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Tetrachloroethene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Toluene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Trichloroethene	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Vinyl acetate	U	1.0		µg/L	1	10/22/2006 9:42:00 PM
Vinyl chloride	U	1.0		µg/L	1	10/22/2006 9:42:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 25-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610173  
**Project:** Rowe Industries  
**Lab ID:** 0610173-03B

**Client Sample ID:** WQ101806:810NP2-10  
**Tag Number:** 12575  
**Collection Date:** 10/18/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: JP
Iron	0.0926	0.0200		mg/L	1	10/19/2006 1:09:41 PM
<b>TOTAL DISSOLVED SOLIDS</b>		<b>E160.1</b>				Analyst: JC
Total Dissolved Solids (Residue, Filterable)	78.0	1.00		mg/L	1	10/24/2006

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



Tuesday, October 31, 2006

Mark Goldberg  
Leggette Brashears & Graham Inc.  
4 Research Drive  
Suite 301  
Shelton, CT 06484

TEL: (203) 929-8555  
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0610257

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 10/26/2006 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at [lbeyer@american-analytical.com](mailto:lbeyer@american-analytical.com).

Sincerely,



Lori Beyer  
Lab Director

---

**CLIENT:** Leggette Brashears & Graham Inc.  
**Project:** Rowe Industries  
**Lab Order:** 0610257

**Work Order Sample Summary**

---

<b>Lab Sample ID</b>	<b>Client Sample ID</b>	<b>Tag Number</b>	<b>Date Collected</b>	<b>Date Received</b>
0610257-01A	WQ102406:910 NP2-6	10283	10/24/2006	10/26/2006
0610257-01B	WQ102406:910 NP2-6	10283	10/24/2006	10/26/2006
0610257-01C	WQ102406:910 NP2-6	10283	10/24/2006	10/26/2006
0610257-02A	WQ102406:915 NP2-7	10283	10/24/2006	10/26/2006
0610257-02B	WQ102406:915 NP2-7	10283	10/24/2006	10/26/2006
0610257-02C	WQ102406:915 NP2-7	10283	10/24/2006	10/26/2006
0610257-03A	WQ102406:920 NP2-10	10283	10/24/2006	10/26/2006
0610257-03B	WQ102406:920 NP2-10	10283	10/24/2006	10/26/2006
0610257-03C	WQ102406:920 NP2-10	10283	10/24/2006	10/26/2006

TAG # / COC 10283

### CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

<b>CLIENT NAME/ADDRESS</b> LBB 4 Research Dr. Shelton, CT			<b>CONTACT:</b> Mark Goldberg		<b>SAMPLER (SIGNATURE)</b> 	<b>SAMPLE(S) SEALED</b> YES/DNO YES
<b>PROJECT LOCATION:</b>			<b>SAMPLER NAME (PRINT)</b> Robert Drew		<b>CORRECT CONTAINER(S)</b> YES / NO YES	FOR METHANOL PRESERVED SAMPLES [ VOLATILE VIAL # ]
<b>LABORATORY ID #</b>			<b>MATRIX</b>		<b>ANALYSIS REQUIRED</b>	
<b># CONTAINERS</b>			<b>SAMPLING DATE/TIME</b>		FROM 1/3 TOT. + D/S. Fe 10/25 10:25	
<b>LABORATORY ID #</b>			<b>SAMPLE # - LOCATION</b>		8200 NTBC	
0610257-01AB W	4	10-24-06	WA102406:910 NPA-6	X X X X	X	
-02AB	4	↓	↓ :915 NPA-7	X X X X	X	
-03AB	5	↓	↓ :920 NPA-10	X X X X	X	
<b>COOLER TEMPERATURE:</b>						
<b>COMMENTS / INSTRUCTIONS</b>						
<b>MATRIX</b> S=SOIL, L=LIQUID, SL=SLUDGE, A=AIR, W=WIPE, P=PAINT CHIPS, B=BULK MATERIAL <b>TYPE</b> G=GRAB, C=COMPOSITE, SS=SPLIT SPOON						
<b>RELINQUISHED BY (SIGNATURE)</b> 			<b>PRINTED NAME</b> Robert Drew		<b>DATE TIME</b> 10/25/06 1:700	<b>RECEIVED BY LAB (SIGNATURE)</b> 
<b>RELINQUISHED BY (SIGNATURE)</b> 			<b>PRINTED NAME</b> Robert Drew		<b>DATE TIME</b> 10/25 10:25	<b>RECEIVED BY LAB (SIGNATURE)</b> 
<b>TURNAROUND REQUIRED:</b>						
NORMAL <input checked="" type="checkbox"/> STAT <input type="checkbox"/> BY 1 / 1						
<b>COOLING INSTRUCTIONS:</b>						

**AMERICAN ANALYTICAL LABORATORIES, LLC**

**56 TOLEDO STREET**

**FARMINGDALE, NEW YORK 11735**

**TELEPHONE: (631) 454-6100      FAX: (631) 454-8027**

**DATA REPORTING QUALIFIERS**

For reporting results, the following "Results Qualifiers" are used:

<b>Value</b>	If the result is greater than or equal to the detection limit, report the value
<b>U</b>	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
<b>J</b>	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
<b>B</b>	Indicates the analyte was found in the blank as well as the sample report "10B".
<b>E</b>	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
<b>D</b>	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
<b>P</b>	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
<b>N</b>	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
<b>H</b>	Indicates sample was received and/or analyzed outside of The method allowable holding time

**American Analytical Laboratories, LLC.**

Date: 31-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610257  
**Project:** Rowe Industries  
**Lab ID:** 0610257-01A

**Client Sample ID:** WQ102406:910 NP2-6  
**Tag Number:** 10283  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>	<b>SW5030A</b>	Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
1,1,1-Trichloroethane	15	1.0		µg/L	1	10/29/2006 4:30:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
2-Butanone	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
2-Hexanone	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Acetone	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Benzene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Bromobenzene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Bromochloromethane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Bromodichloromethane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Bromoform	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Bromomethane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Carbon disulfide	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Chlorobenzene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 31-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610257  
**Project:** Rowe Industries  
**Lab ID:** 0610257-01A

**Client Sample ID:** WQ102406:910 NP2-6  
**Tag Number:** 10283  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: LDS
Chloroethane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Chloroform	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Chloromethane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Dibromochloromethane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Dibromomethane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Ethylbenzene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Isopropylbenzene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
m,p-Xylene	U	2.0		µg/L	1	10/29/2006 4:30:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Methylene chloride	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Naphthalene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
n-Butylbenzene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
n-Propylbenzene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
o-Xylene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Styrene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Tetrachloroethene	7.5	1.0		µg/L	1	10/29/2006 4:30:00 PM
Toluene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Trichloroethene	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Vinyl acetate	U	1.0		µg/L	1	10/29/2006 4:30:00 PM
Vinyl chloride	U	1.0		µg/L	1	10/29/2006 4:30:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 31-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610257  
**Project:** Rowe Industries  
**Lab ID:** 0610257-01B

**Client Sample ID:** WQ102406:910 NP2-6  
**Tag Number:** 10283  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: JP
Iron	2.72	0.0200		mg/L	1	10/31/2006 12:43:55 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 31-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610257  
**Project:** Rowe Industries  
**Lab ID:** 0610257-01C

**Client Sample ID:** WQ102406:910 NP2-6  
**Tag Number:** 10283  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: JP
Iron	U	0.0200		mg/L	1	10/31/2006 12:41:12 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



**American Analytical Laboratories, LLC.**

Date: 31-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610257  
**Project:** Rowe Industries  
**Lab ID:** 0610257-02A

**Client Sample ID:** WQ102406:915 NP2-7  
**Tag Number:** 10283  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		<b>Analyst: LDS</b>
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
2-Butanone	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
2-Hexanone	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Acetone	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Benzene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Bromobenzene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Bromochloromethane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Bromodichloromethane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Bromoform	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Bromomethane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Carbon disulfide	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Chlorobenzene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 31-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610257  
**Project:** Rowe Industries  
**Lab ID:** 0610257-02A

**Client Sample ID:** WQ102406:915 NP2-7  
**Tag Number:** 10283  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>	<b>SW5030A</b>	Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Chloroform	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Chloromethane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Dibromochloromethane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Dibromomethane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Ethylbenzene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Isopropylbenzene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
m,p-Xylene	U	2.0		µg/L	1	10/29/2006 5:13:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Methylene chloride	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Naphthalene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
n-Butylbenzene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
n-Propylbenzene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
o-Xylene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Styrene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Tetrachloroethene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Toluene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Trichloroethene	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Vinyl acetate	U	1.0		µg/L	1	10/29/2006 5:13:00 PM
Vinyl chloride	U	1.0		µg/L	1	10/29/2006 5:13:00 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 31-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610257  
**Project:** Rowe Industries  
**Lab ID:** 0610257-02B

**Client Sample ID:** WQ102406:915 NP2-7  
**Tag Number:** 10283  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: JP
Iron	2.51	0.0200		mg/L	1	10/31/2006 12:54:20 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 31-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610257  
**Project:** Rowe Industries  
**Lab ID:** 0610257-02C

**Client Sample ID:** WQ102406:915 NP2-7  
**Tag Number:** 10283  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		SW3005A		Analyst: JP
Iron	0.0376	0.0200		mg/L	1	10/31/2006 12:52:03 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 31-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610257  
**Project:** Rowe Industries  
**Lab ID:** 0610257-03A

**Client Sample ID:** WQ102406:920 NP2-10  
**Tag Number:** 10283  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>						Analyst: LDS
		<b>SW8260B</b>		<b>SW5030A</b>		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
2-Butanone	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
2-Hexanone	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Acetone	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Benzene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Bromobenzene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Bromochloromethane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Bromodichloromethane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Bromoform	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Bromomethane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Carbon disulfide	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Chlorobenzene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM

**Qualifiers:**  
 B Analyte detected in the associated Method Blank  
 H Holding times for preparation or analysis exceeded  
 ND Not Detected at the Reporting Limit  
 U Indicates the compound was analyzed for but not detected

E Value above quantitation range  
 J Analyte detected below quantitation limits  
 S Spike Recovery outside accepted recovery limits  
 X Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 31-Oct-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610257  
**Project:** Rowe Industries  
**Lab ID:** 0610257-03A

**Client Sample ID:** WQ102406:920 NP2-10  
**Tag Number:** 10283  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		<b>Analyst: LDS</b>
Chloroethane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Chloroform	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Chloromethane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Dibromochloromethane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Dibromomethane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Ethylbenzene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Isopropylbenzene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
m,p-Xylene	U	2.0		µg/L	1	10/29/2006 5:59:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Methylene chloride	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Naphthalene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
n-Butylbenzene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
n-Propylbenzene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
o-Xylene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Styrene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Tetrachloroethene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Toluene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Trichloroethene	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Vinyl acetate	U	1.0		µg/L	1	10/29/2006 5:59:00 PM
Vinyl chloride	U	1.0		µg/L	1	10/29/2006 5:59:00 PM

Qualifiers:			
B	Analyte detected in the associated Method Blank	E	Value above quantitation range
H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 31-Oct-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ102406:920 NP2-10
<b>Lab Order:</b>	0610257	<b>Tag Number:</b>	10283
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/24/2006
<b>Lab ID:</b>	0610257-03B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		SW3010A		Analyst: JP
Iron	1.75	0.0200		mg/L	1	10/31/2006 1:12:07 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 31-Oct-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	WQ102406:920 NP2-10
<b>Lab Order:</b>	0610257	<b>Tag Number:</b>	10283
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/24/2006
<b>Lab ID:</b>	0610257-03C	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: <b>JP</b>
Iron	0.0876	0.0200		mg/L	1	10/31/2006 1:08:12 PM
<b>TOTAL DISSOLVED SOLIDS</b>		<b>E160.1</b>				Analyst: <b>JC</b>
Total Dissolved Solids (Residue, Filterable)	110	1.0		mg/L	1	

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level





NYSDOH 11418  
NJDEP NY050  
CTDOH PH-0205  
PADEP 68-00573

Thursday, November 02, 2006 <sup>LB</sup>

Mark Goldberg  
Leggette Brashears & Graham Inc.  
4 Research Drive  
Suite 301  
Shelton, CT 06484

TEL: (203) 929-8555  
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0610258

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 7 sample(s) on 10/26/2006 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at [lbeyer@american-analytical.com](mailto:lbeyer@american-analytical.com).

Sincerely,

  
Lori Beyer  
Lab Director

**CLIENT:** Leggette Brashears & Graham Inc.**Project:** Rowe Industries**Lab Order:** 0610258**Work Order Sample Summary**

<b>Lab Sample ID</b>	<b>Client Sample ID</b>	<b>Tag Number</b>	<b>Date Collected</b>	<b>Date Received</b>
0610258-01A	GWQ102406:800NP1-1-2	10281	10/24/2006	10/26/2006
0610258-01B	GWQ102406:800NP1-1-2	10281	10/24/2006	10/26/2006
0610258-01C	GWQ102406:800NP1-1-2	10281	10/24/2006	10/26/2006
0610258-01D	GWQ102406:800NP1-1-2	10281	10/24/2006	10/26/2006
0610258-02A	GWQ102406:810NP1-1-4	10281	10/24/2006	10/26/2006
0610258-02B	GWQ102406:810NP1-1-4	10281	10/24/2006	10/26/2006
0610258-02C	GWQ102406:810NP1-1-4	10281	10/24/2006	10/26/2006
0610258-02D	GWQ102406:810NP1-1-4	10281	10/24/2006	10/26/2006
0610258-03A	GWQ102406:820NP1-1-5	10281	10/24/2006	10/26/2006
0610258-03B	GWQ102406:820NP1-1-5	10281	10/24/2006	10/26/2006
0610258-03C	GWQ102406:820NP1-1-5	10281	10/24/2006	10/26/2006
0610258-03D	GWQ102406:820NP1-1-5	10281	10/24/2006	10/26/2006
0610258-04A	GWQ102406:830NP1-1-6	10281	10/24/2006	10/26/2006
0610258-04B	GWQ102406:830NP1-1-6	10281	10/24/2006	10/26/2006
0610258-04C	GWQ102406:830NP1-1-6	10281	10/24/2006	10/26/2006
0610258-04D	GWQ102406:830NP1-1-6	10281	10/24/2006	10/26/2006
0610258-05A	GWQ102406:840NP1-1-7	10281	10/24/2006	10/26/2006
0610258-05B	GWQ102406:840NP1-1-7	10281	10/24/2006	10/26/2006
0610258-05C	GWQ102406:840NP1-1-7	10281	10/24/2006	10/26/2006
0610258-05D	GWQ102406:840NP1-1-7	10281	10/24/2006	10/26/2006
0610258-06A	GWQ102406:850NP1-1-8	10281	10/24/2006	10/26/2006
0610258-06B	GWQ102406:850NP1-1-8	10281	10/24/2006	10/26/2006
0610258-06C	GWQ102406:850NP1-1-8	10281	10/24/2006	10/26/2006
0610258-06D	GWQ102406:850NP1-1-8	10281	10/24/2006	10/26/2006
0610258-07A	GWQ102406:900NP1-1-9	10281	10/24/2006	10/26/2006
0610258-07B	GWQ102406:900NP1-1-9	10281	10/24/2006	10/26/2006
0610258-07C	GWQ102406:900NP1-1-9	10281	10/24/2006	10/26/2006
0610258-07D	GWQ102406:900NP1-1-9	10281	10/24/2006	10/26/2006



56 TOLEDO STREET • FARMINGDALE, NEW YORK 11735  
 (631) 454-6100 • FAX (631) 454-8027

NYSDC 11418  
 CTDOH PH-0205  
 NJDEP NY050  
 PADEP 68-573

TAG # / COC 10281

# CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

CLIENT NAME/ADDRESS LBO 4 Research Dr. Shelton, CT	CONTACT: Mark Goldberg	SAMPLER (SIGNATURE) <i>M. Drew</i>	SAMPLE(S) SEALED <input checked="" type="checkbox"/> YES / <input type="checkbox"/> NO
		SAMPLER NAME (PRINT) Robert Drew	CORRECT CONTAINER(S) <input checked="" type="checkbox"/> YES / <input type="checkbox"/> NO

LABORATORY ID #	MATRIX	# CONTAINERS	SAMPLING DATE/TIME	SAMPLE # - LOCATION	ANALYSIS REQUIRED		FOR METHANOL PRESERVED SAMPLES (VOLATILE VIAL #)
					8260	MTBE	
061025P-01ABCD	W	5	10-24-06	6000 2406; 800 NPI-1-2	X	X	
-02ABCD				800 NPI-1-4		X	
-03ABCD				800 NPI-1-5		X	
-04ABCD				800 NPI-1-6		X	
-05ABCD				800 NPI-1-7		X	
-06ABCD				800 NPI-1-8		X	
-07ABCD				900 NPI-1-9		X	

PROJECT LOCATION: **Rowe**

ANALYSIS REQUIRED: 8260, MTBE

Free 113, Tot + Diss. Pb, Tot + Diss. Mn, Turbidity, TDS

MATRIX S=SOIL; L=LIQUID; SL=SLUDGE; A=AIR; W=WIPE; P=PAINT CHIPS; B=BULK MATERIAL	TURNAROUND REQUIRED: NORMAL <input checked="" type="checkbox"/> STAT <input type="checkbox"/> BY / /	COOLER TEMPERATURE:
TYPE G=GRAB; C=COMPOSITE, SS=SPLIT SPOON	RECEIVED BY LAB (SIGNATURE) <i>Craig Masri</i>	COMMENTS / INSTRUCTIONS
RELINQUISHED BY (SIGNATURE) <i>M. Drew</i>	PRINTED NAME Robert Drew	DATE/TIME 10-25-06 1700
RELINQUISHED BY (SIGNATURE)	PRINTED NAME	DATE/TIME
	RECEIVED BY LAB (SIGNATURE)	DATE/TIME
	PRINTED NAME	DATE/TIME
	RECEIVED BY LAB (SIGNATURE)	DATE/TIME
	PRINTED NAME	DATE/TIME

**AMERICAN ANALYTICAL LABORATORIES, LLC**

**56 TOLEDO STREET**

**FARMINGDALE, NEW YORK 11735**

**TELEPHONE: (631) 454-6100      FAX: (631) 454-8027**

**DATA REPORTING QUALIFIERS**

For reporting results, the following "Results Qualifiers" are used:

<b>Value</b>	If the result is greater than or equal to the detection limit, report the value
<b>U</b>	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
<b>J</b>	Indicates an estimated value. The flag is used: <ol style="list-style-type: none"><li>(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)</li><li>(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.</li></ol>
<b>B</b>	Indicates the analyte was found in the blank as well as the sample report "10B".
<b>E</b>	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
<b>D</b>	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
<b>P</b>	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
<b>N</b>	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
<b>H</b>	Indicates sample was received and/or analyzed outside of The method allowable holding time

# American Analytical Laboratories, LLC.

Date: 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-01A

**Client Sample ID:** GWQ102406:800NP1-1-2  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>						
		<b>SW8260B</b>		<b>SW5030A</b>		<b>Analyst: SB</b>
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
1,1,1-Trichloroethane	160	1.0		µg/L	1	11/1/2006 1:49:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
1,1-Dichloroethene	0.91	1.0	J	µg/L	1	11/1/2006 1:49:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
2-Butanone	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
2-Hexanone	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Acetone	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Benzene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Bromobenzene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Bromochloromethane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Bromodichloromethane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Bromoform	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Bromomethane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Carbon disulfide	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Chlorobenzene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

# American Analytical Laboratories, LLC.

Date: 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-01A

**Client Sample ID:** GWQ102406:800NP1-1-2  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: <b>SB</b>
Chloroethane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Chloroform	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Chloromethane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
cis-1,2-Dichloroethene	3.6	1.0		µg/L	1	11/1/2006 1:49:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Dibromochloromethane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Dibromomethane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Ethylbenzene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Isopropylbenzene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
m,p-Xylene	U	2.0		µg/L	1	11/1/2006 1:49:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Methylene chloride	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Naphthalene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
n-Butylbenzene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
n-Propylbenzene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
o-Xylene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Styrene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Tetrachloroethene	5.0	1.0		µg/L	1	11/1/2006 1:49:00 AM
Toluene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Trichloroethene	1.6	1.0		µg/L	1	11/1/2006 1:49:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Vinyl acetate	U	1.0		µg/L	1	11/1/2006 1:49:00 AM
Vinyl chloride	U	1.0		µg/L	1	11/1/2006 1:49:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-01B

**Client Sample ID:** GWQ102406:800NP1-1-2  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: <b>JP</b>
Iron	3.60	0.0200		mg/L	1	10/31/2006 11:20:02 AM
Manganese	0.621	0.0200		mg/L	1	10/31/2006 11:20:02 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ102406:800NP1-1-2
<b>Lab Order:</b>	0610258	<b>Tag Number:</b>	10281
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/24/2006
<b>Lab ID:</b>	0610258-01C	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: JP
Iron	0.00756	0.0200	J	mg/L	1	10/31/2006 11:17:54 AM
Manganese	0.614	0.0200		mg/L	1	10/31/2006 11:17:54 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ102406:800NP1-1-2
<b>Lab Order:</b>	0610258	<b>Tag Number:</b>	10281
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/24/2006
<b>Lab ID:</b>	0610258-01D	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>HARDNESS</b>			<b>M2340 B</b>			Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	53.3	1.00		mg/L	1	10/31/2006
<b>TURBIDITY</b>			<b>E180.1</b>			Analyst: KK
Turbidity	3.30	1.00		NTU	1	10/26/2006
<b>TOTAL DISSOLVED SOLIDS</b>			<b>E160.1</b>			Analyst: JC
Total Dissolved Solids (Residue, Filterable)	120	1.0		mg/L	1	

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-02A

**Client Sample ID:** GWQ102406:810NP1-1-4  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>						Analyst: <b>SB</b>
		<b>SW8260B</b>		<b>SW5030A</b>		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
1,1,1-Trichloroethane	5.6	1.0		µg/L	1	11/1/2006 2:35:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
2-Butanone	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
2-Hexanone	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Acetone	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Benzene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Bromobenzene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Bromochloromethane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Bromodichloromethane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Bromoform	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Bromomethane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Carbon disulfide	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Chlorobenzene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-02A

**Client Sample ID:** GWQ102406:810NP1-1-4  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: <b>SB</b>
Chloroethane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Chloroform	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Chloromethane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Dibromochloromethane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Dibromomethane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Ethylbenzene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Isopropylbenzene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
m,p-Xylene	U	2.0		µg/L	1	11/1/2006 2:35:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Methylene chloride	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Naphthalene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
n-Butylbenzene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
n-Propylbenzene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
o-Xylene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Styrene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Tetrachloroethene	11	1.0		µg/L	1	11/1/2006 2:35:00 AM
Toluene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Trichloroethene	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Vinyl acetate	U	1.0		µg/L	1	11/1/2006 2:35:00 AM
Vinyl chloride	U	1.0		µg/L	1	11/1/2006 2:35:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ102406:810NP1-1-4
<b>Lab Order:</b>	0610258	<b>Tag Number:</b>	10281
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/24/2006
<b>Lab ID:</b>	0610258-02B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: JP
Iron	7.17	0.0200		mg/L	1	10/31/2006 11:24:14 AM
Manganese	1.23	0.0200		mg/L	1	10/31/2006 11:24:14 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ102406:810NP1-1-4
<b>Lab Order:</b>	0610258	<b>Tag Number:</b>	10281
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/24/2006
<b>Lab ID:</b>	0610258-02C	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: JP
Iron	0.0178	0.0200	J	mg/L	1	10/31/2006 11:22:17 AM
Manganese	1.22	0.0200		mg/L	1	10/31/2006 11:22:17 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-02D

**Client Sample ID:** GWQ102406:810NP1-1-4  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>HARDNESS</b>			<b>M2340 B</b>			Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	40.4	1.00		mg/L	1	10/31/2006
<b>TURBIDITY</b>			<b>E180.1</b>			Analyst: KK
Turbidity	2.90	1.00		NTU	1	10/26/2006
<b>TOTAL DISSOLVED SOLIDS</b>			<b>E160.1</b>			Analyst: JC
Total Dissolved Solids (Residue, Filterable)	140	1.0		mg/L	1	

Qualifiers:				
B	Analyte detected in the associated Method Blank	E	Value above quantitation range	
H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits	
ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits	
U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level	

# American Analytical Laboratories, LLC.

Date: 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-03A

**Client Sample ID:** GWQ102406:820NP1-1-5  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: <b>SB</b>
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
1,1,1-Trichloroethane	1.3	1.0		µg/L	1	11/1/2006 3:20:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
2-Butanone	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
2-Hexanone	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Acetone	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Benzene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Bromobenzene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Bromochloromethane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Bromodichloromethane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Bromoform	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Bromomethane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Carbon disulfide	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Chlorobenzene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM

**Qualifiers:**  
 B Analyte detected in the associated Method Blank  
 H Holding times for preparation or analysis exceeded  
 ND Not Detected at the Reporting Limit  
 U Indicates the compound was analyzed for but not detected

E Value above quantitation range  
 J Analyte detected below quantitation limits  
 S Spike Recovery outside accepted recovery limits  
 X Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-03A

**Client Sample ID:** GWQ102406:820NP1-1-5  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: <b>SB</b>
Chloroethane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Chloroform	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Chloromethane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Dibromochloromethane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Dibromomethane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Ethylbenzene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Isopropylbenzene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
m,p-Xylene	U	2.0		µg/L	1	11/1/2006 3:20:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Methylene chloride	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Naphthalene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
n-Butylbenzene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
n-Propylbenzene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
o-Xylene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Styrene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Tetrachloroethene	1.1	1.0		µg/L	1	11/1/2006 3:20:00 AM
Toluene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Trichloroethene	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Vinyl acetate	U	1.0		µg/L	1	11/1/2006 3:20:00 AM
Vinyl chloride	U	1.0		µg/L	1	11/1/2006 3:20:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ102406:820NP1-1-5
<b>Lab Order:</b>	0610258	<b>Tag Number:</b>	10281
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/24/2006
<b>Lab ID:</b>	0610258-03B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3010A</b>		<b>Analyst: JP</b>
Iron	0.0683	0.0200		mg/L	1	10/31/2006 11:31:53 AM
Manganese	0.00913	0.0200	J	mg/L	1	10/31/2006 11:31:53 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ102406:820NP1-1-5
<b>Lab Order:</b>	0610258	<b>Tag Number:</b>	10281
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/24/2006
<b>Lab ID:</b>	0610258-03C	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: JP
Iron	0.00684	0.0200	J	mg/L	1	10/31/2006 11:26:25 AM
Manganese	0.00875	0.0200	J	mg/L	1	10/31/2006 11:26:25 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

# American Analytical Laboratories, LLC.

Date: 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-03D

**Client Sample ID:** GWQ102406:820NP1-1-5  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>HARDNESS</b>						Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	41.0	1.00		mg/L	1	10/31/2006
<b>TURBIDITY</b>						Analyst: KK
Turbidity	U	1.00		NTU	1	10/26/2006
<b>TOTAL DISSOLVED SOLIDS</b>						Analyst: JC
Total Dissolved Solids (Residue, Filterable)	160	1.0		mg/L	1	

Qualifiers:			
B	Analyte detected in the associated Method Blank	E	Value above quantitation range
H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

# American Analytical Laboratories, LLC.

Date: 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-04A

**Client Sample ID:** GWQ102406:830NPI-1-6  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: <b>SB</b>
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
1,1,1-Trichloroethane	15	1.0		µg/L	1	11/1/2006 4:04:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
2-Butanone	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
2-Hexanone	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Acetone	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Benzene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Bromobenzene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Bromochloromethane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Bromodichloromethane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Bromoform	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Bromomethane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Carbon disulfide	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Chlorobenzene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM

**Qualifiers:**  
 B Analyte detected in the associated Method Blank  
 H Holding times for preparation or analysis exceeded  
 ND Not Detected at the Reporting Limit  
 U Indicates the compound was analyzed for but not detected

E Value above quantitation range  
 J Analyte detected below quantitation limits  
 S Spike Recovery outside accepted recovery limits  
 X Value exceeds Maximum Contaminant Level

# American Analytical Laboratories, LLC.

Date: 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-04A

**Client Sample ID:** GWQ102406:830NP1-1-6  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		<b>Analyst: SB</b>
Chloroethane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Chloroform	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Chloromethane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Dibromochloromethane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Dibromomethane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Ethylbenzene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Isopropylbenzene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
m,p-Xylene	U	2.0		µg/L	1	11/1/2006 4:04:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Methylene chloride	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Naphthalene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
n-Butylbenzene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
n-Propylbenzene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
o-Xylene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Styrene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Tetrachloroethene	45	1.0		µg/L	1	11/1/2006 4:04:00 AM
Toluene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Trichloroethene	1.2	1.0		µg/L	1	11/1/2006 4:04:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Vinyl acetate	U	1.0		µg/L	1	11/1/2006 4:04:00 AM
Vinyl chloride	U	1.0		µg/L	1	11/1/2006 4:04:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

**Date:** 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-04B

**Client Sample ID:** GWQ102406:830NP1-1-6  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3010A</b>		<b>Analyst: JP</b>
Iron	1.84	0.0200		mg/L	1	10/31/2006 11:35:54 AM
Manganese	0.173	0.0200		mg/L	1	10/31/2006 11:35:54 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-04C

**Client Sample ID:** GWQ102406:830NP1-1-6  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: JP
Iron	0.00700	0.0200	J	mg/L	1	10/31/2006 11:34:06 AM
Manganese	0.159	0.0200		mg/L	1	10/31/2006 11:34:06 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ102406:830NP1-1-6
<b>Lab Order:</b>	0610258	<b>Tag Number:</b>	10281
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/24/2006
<b>Lab ID:</b>	0610258-04D	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>HARDNESS</b>			<b>M2340 B</b>			Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	36.8	1.00		mg/L	1	10/31/2006
<b>TURBIDITY</b>			<b>E180.1</b>			Analyst: KK
Turbidity	U	1.00		NTU	1	10/26/2006
<b>TOTAL DISSOLVED SOLIDS</b>			<b>E160.1</b>			Analyst: JC
Total Dissolved Solids (Residue, Filterable)	120	1.0		mg/L	1	

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



# American Analytical Laboratories, LLC.

Date: 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-05A

**Client Sample ID:** GWQ102406:840NP1-1-7  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: <b>SB</b>
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
1,1,1-Trichloroethane	3.5	1.0		µg/L	1	11/1/2006 4:50:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
1,1-Dichloroethane	2.4	1.0		µg/L	1	11/1/2006 4:50:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
2-Butanone	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
2-Hexanone	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Acetone	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Benzene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Bromobenzene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Bromochloromethane	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Bromodichloromethane	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Bromoform	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Bromomethane	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Carbon disulfide	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Chlorobenzene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM

**Qualifiers:**  
 B Analyte detected in the associated Method Blank  
 H Holding times for preparation or analysis exceeded  
 ND Not Detected at the Reporting Limit  
 U Indicates the compound was analyzed for but not detected

E Value above quantitation range  
 J Analyte detected below quantitation limits  
 S Spike Recovery outside accepted recovery limits  
 X Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-05A

**Client Sample ID:** GWQ102406:840NP1-1-7  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: <b>SB</b>
Chloroethane	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Chloroform	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Chloromethane	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Dibromochloromethane	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Dibromomethane	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Ethylbenzene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Isopropylbenzene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
m,p-Xylene	U	2.0		µg/L	1	11/1/2006 4:50:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Methylene chloride	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Naphthalene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
n-Butylbenzene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
n-Propylbenzene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
o-Xylene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Styrene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Tetrachloroethene	26	1.0		µg/L	1	11/1/2006 4:50:00 AM
Toluene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Trichloroethene	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Vinyl acetate	U	1.0		µg/L	1	11/1/2006 4:50:00 AM
Vinyl chloride	U	1.0		µg/L	1	11/1/2006 4:50:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ102406:840NP1-1-7
<b>Lab Order:</b>	0610258	<b>Tag Number:</b>	10281
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/24/2006
<b>Lab ID:</b>	0610258-05B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: JP
iron	0.0692	0.0200		mg/L	1	10/31/2006 12:23:13 PM
Manganese	0.0598	0.0200		mg/L	1	10/31/2006 12:23:13 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ102406:840NP1-1-7
<b>Lab Order:</b>	0610258	<b>Tag Number:</b>	10281
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/24/2006
<b>Lab ID:</b>	0610258-05C	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: JP
Iron	0.00846	0.0200	J	mg/L	1	10/31/2006 12:20:26 PM
Manganese	0.0554	0.0200		mg/L	1	10/31/2006 12:20:26 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ102406:840NP1-1-7
<b>Lab Order:</b>	0610258	<b>Tag Number:</b>	10281
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/24/2006
<b>Lab ID:</b>	0610258-05D	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>HARDNESS</b>			<b>M2340 B</b>			Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	31.8	1.00		mg/L	1	10/31/2006
<b>TURBIDITY</b>			<b>E180.1</b>			Analyst: KK
Turbidity	U	1.00		NTU	1	10/26/2006
<b>TOTAL DISSOLVED SOLIDS</b>			<b>E160.1</b>			Analyst: JC
Total Dissolved Solids (Residue, Filterable)	84	1.0		mg/L	1	

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

# American Analytical Laboratories, LLC.

Date: 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-06A

**Client Sample ID:** GWQ102406:850NP1-1-8  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>						Analyst: <b>SB</b>
		<b>SW8260B</b>		<b>SW5030A</b>		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
1,1,1-Trichloroethane	3.1	1.0		µg/L	1	11/1/2006 5:34:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
1,1-Dichloroethane	2.0	1.0		µg/L	1	11/1/2006 5:34:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
2-Butanone	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
2-Hexanone	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Acetone	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Benzene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Bromobenzene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Bromochloromethane	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Bromodichloromethane	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Bromoform	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Bromomethane	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Carbon disulfide	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Chlorobenzene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM

**Qualifiers:**  
 B Analyte detected in the associated Method Blank  
 H Holding times for preparation or analysis exceeded  
 ND Not Detected at the Reporting Limit  
 U Indicates the compound was analyzed for but not detected

E Value above quantitation range  
 J Analyte detected below quantitation limits  
 S Spike Recovery outside accepted recovery limits  
 X Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-06A

**Client Sample ID:** GWQ102406:850NP1-1-8  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: <b>SB</b>
Chloroethane	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Chloroform	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Chloromethane	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Dibromochloromethane	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Dibromomethane	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Ethylbenzene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Isopropylbenzene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
m,p-Xylene	U	2.0		µg/L	1	11/1/2006 5:34:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Methylene chloride	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Naphthalene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
n-Butylbenzene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
n-Propylbenzene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
o-Xylene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Styrene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Tetrachloroethene	0.92	1.0	J	µg/L	1	11/1/2006 5:34:00 AM
Toluene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Trichloroethene	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Vinyl acetate	U	1.0		µg/L	1	11/1/2006 5:34:00 AM
Vinyl chloride	U	1.0		µg/L	1	11/1/2006 5:34:00 AM

**Qualifiers:** B Analyte detected in the associated Method Blank E Value above quantitation range  
H Holding times for preparation or analysis exceeded J Analyte detected below quantitation limits  
ND Not Detected at the Reporting Limit S Spike Recovery outside accepted recovery limits  
U Indicates the compound was analyzed for but not detected X Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ102406:850NP1-1-8
<b>Lab Order:</b>	0610258	<b>Tag Number:</b>	10281
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/24/2006
<b>Lab ID:</b>	0610258-06B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: JP
Iron	8.32	0.0200		mg/L	1	10/31/2006 12:29:05 PM
Manganese	0.727	0.0200		mg/L	1	10/31/2006 12:29:05 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level



**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-06C

**Client Sample ID:** GWQ102406:850NP1-1-8  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3005A</b>		Analyst: <b>JP</b>
Iron	0.0605	0.0200		mg/L	1	10/31/2006 12:26:03 PM
Manganese	0.661	0.0200		mg/L	1	10/31/2006 12:26:03 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ102406:850NP1-1-8
<b>Lab Order:</b>	0610258	<b>Tag Number:</b>	10281
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/24/2006
<b>Lab ID:</b>	0610258-06D	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>HARDNESS</b>			<b>M2340 B</b>			Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	23.6	1.00		mg/L	1	10/31/2006
<b>TURBIDITY</b>			<b>E180.1</b>			Analyst: KK
Turbidity	6.10	1.00		NTU	1	10/26/2006
<b>TOTAL DISSOLVED SOLIDS</b>			<b>E160.1</b>			Analyst: JC
Total Dissolved Solids (Residue, Filterable)	74	1.0		mg/L	1	

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-07A

**Client Sample ID:** GWQ102406:900NP1-1-9  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: <b>SB</b>
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
1,1,1-Trichloroethane	1.5	1.0		µg/L	1	11/1/2006 6:18:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
2-Butanone	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
2-Hexanone	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Acetone	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Benzene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Bromobenzene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Bromochloromethane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Bromodichloromethane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Bromoform	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Bromomethane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Carbon disulfide	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Chlorobenzene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-07A

**Client Sample ID:** GWQ102406:900NP1-1-9  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>VOLATILE SW-846 8260 PLUS MTBE &amp; FREON11</b>		<b>SW8260B</b>		<b>SW5030A</b>		Analyst: <b>SB</b>
Chloroethane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Chloroform	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Chloromethane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Dibromochloromethane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Dibromomethane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Ethylbenzene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Isopropylbenzene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
m,p-Xylene	U	2.0		µg/L	1	11/1/2006 6:18:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Methylene chloride	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Naphthalene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
n-Butylbenzene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
n-Propylbenzene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
o-Xylene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Styrene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Tetrachloroethene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Toluene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Trichloroethene	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Vinyl acetate	U	1.0		µg/L	1	11/1/2006 6:18:00 AM
Vinyl chloride	U	1.0		µg/L	1	11/1/2006 6:18:00 AM

**Qualifiers:**  
 B Analyte detected in the associated Method Blank  
 H Holding times for preparation or analysis exceeded  
 ND Not Detected at the Reporting Limit  
 U Indicates the compound was analyzed for but not detected

E Value above quantitation range  
 J Analyte detected below quantitation limits  
 S Spike Recovery outside accepted recovery limits  
 X Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ102406:900NP1-1-9
<b>Lab Order:</b>	0610258	<b>Tag Number:</b>	10281
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/24/2006
<b>Lab ID:</b>	0610258-07B	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>TOTAL IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3010A</b>		Analyst: JP
Iron	6.96	0.0200		mg/L	1	10/31/2006 12:38:02 PM
Manganese	0.694	0.0200		mg/L	1	10/31/2006 12:38:02 PM

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

**American Analytical Laboratories, LLC.**

**Date:** 02-Nov-06

**CLIENT:** Leggette Brashears & Graham Inc.  
**Lab Order:** 0610258  
**Project:** Rowe Industries  
**Lab ID:** 0610258-07C

**Client Sample ID:** GWQ102406:900NP1-1-9  
**Tag Number:** 10281  
**Collection Date:** 10/24/2006  
**Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>DISSOLVED IRON, MANGANESE</b>		<b>E200.7</b>		<b>SW3005A</b>		<b>Analyst: JP</b>
Iron	0.00719	0.0200	J	mg/L	1	10/31/2006 12:34:46 PM
Manganese	0.682	0.0200		mg/L	1	10/31/2006 12:34:46 PM

Qualifiers:				
B	Analyte detected in the associated Method Blank	E	Value above quantitation range	
H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits	
ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits	
U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level	

**American Analytical Laboratories, LLC.**

Date: 02-Nov-06

<b>CLIENT:</b>	Leggette Brashears & Graham Inc.	<b>Client Sample ID:</b>	GWQ102406:900NP1-1-9
<b>Lab Order:</b>	0610258	<b>Tag Number:</b>	10281
<b>Project:</b>	Rowe Industries	<b>Collection Date:</b>	10/24/2006
<b>Lab ID:</b>	0610258-07D	<b>Matrix:</b>	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
<b>HARDNESS</b>		<b>M2340 B</b>				Analyst: JP
Hardness, Calcium/Magnesium (As CaCO3)	25.9	1.00		mg/L	1	10/31/2006
<b>TURBIDITY</b>		<b>E180.1</b>				Analyst: KK
Turbidity	8.40	1.00		NTU	1	10/26/2006
<b>TOTAL DISSOLVED SOLIDS</b>		<b>E160.1</b>				Analyst: JC
Total Dissolved Solids (Residue, Filterable)	80	1.0		mg/L	1	

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

**H6J260127 Analytical Report ..... 1**  
**Sample Receipt Documentation ..... 15**  
**Total Number of Pages ..... 17**





STL Knoxville  
5815 Middlebrook Pike  
Knoxville, TN 37921

Tel: 865 291 3000 Fax: 865 584 4315  
www.stl-inc.com

# ANALYTICAL REPORT

Rowe-NABSAG 0401

Lot #: H6J260127

Mark Goldberg

Leggette, Brashears & Graham,  
4 Research Drive  
Suite #301  
Shelton, CT 06484

SEVERN TRENT LABORATORIES, INC.

Jamie A. McKinney  
Project Manager

November 8, 2006

# ANALYTICAL METHODS SUMMARY

H6J260127

<u>PARAMETER</u>	<u>ANALYTICAL METHOD</u>
Volatile Organics by TO15	EPA-2 TO-15

## References:

EPA-2 "Compendium of Methods for the Determination of Toxic Organic Compounds in Ambient Air", EPA-625/R-96/010b, January 1999.

## SAMPLE SUMMARY

H6J260127

<u>WO #</u>	<u>SAMPLE#</u>	<u>CLIENT SAMPLE ID</u>	<u>SAMPLED DATE</u>	<u>SAMP TIME</u>
JG9V1	001	AQ102506:930 NP4-1	10/25/06	09:30
JG9WC	002	AQ102506:935 NP4-2	10/25/06	09:35
JG9WD	003	AQ102506:936 NP4-3	10/25/06	09:36

**NOTE (S) :**

- The analytical results of the samples listed above are presented on the following pages.
- All calculations are performed before rounding to avoid round-off errors in calculated results.
- Results noted as "ND" were not detected at or above the stated limit.
- This report must not be reproduced, except in full, without the written approval of the laboratory.
- Results for the following parameters are never reported on a dry weight basis: color, corrosivity, density, flashpoint, ignitability, layers, odor, paint filter test, pH, porosity pressure, reactivity, redox potential, specific gravity, spot tests, solids, solubility, temperature, viscosity, and weight.

## **PROJECT NARRATIVE**

### **H6J260127**

The results reported herein are applicable to the samples submitted for analysis only.

This report shall not be reproduced except in full, without the written approval of the laboratory.

**The original chain of custody documentation is included with this report.**

#### **Sample Receipt**

The analysis listed on the chain of custody documentation is TO-17. The analysis should be TO-15.

#### **Quality Control and Data Interpretation**

Unless otherwise noted, all holding times and QC criteria were met and the test results shown in this report meet all applicable NELAC requirements.

Samples were received on 10/26/06 in Tedlar bags and analyzed within 72 hours of sampling.

The EPA method requires that all target analytes in the continuing calibration verification standard be within 30% difference from the initial calibration. The laboratory standard operating procedure allows up to four analytes in the calibration verification to be  $\leq 40\%$  difference from the initial calibration. The calibration verification analyzed on 10/27/06 exhibited a %difference of  $>30\%$  but  $\leq 40\%$  for vinyl chloride.

STL Knoxville maintains the following certifications, approvals and accreditations: Arkansas DEQ Cert. #05-043-0, California DHS ELAP Cert. #2423, Colorado DPHE, Connecticut DPH Cert. #PH-0223, Florida DOH Cert. #E87177, Georgia DNR Cert. #906, Hawaii DOH, Illinois EPA Cert. #000687, Indiana DOH Cert. #C-TN-02, Iowa DNR Cert. #375, Kansas DHE Cert. #E-10349, Kentucky DEP Lab ID #90101, Louisiana DEQ Cert. #03079, Louisiana DOHH Cert. #LA030024, Maryland DHMH Cert. #277, Massachusetts DEP Cert. #M-TN009, Michigan DEQ Lab ID #9933, New Jersey DEP Cert. #TN001, New York DOH Lab #10781, North Carolina DPH Lab ID #21705, North Carolina DEHNR Cert. #64, Ohio EPA VAP Cert. #CL0059, Oklahoma DEQ ID #9415, Pennsylvania DEP Cert. #68-00576, South Carolina DHEC Lab ID #84001001, Tennessee DOH Lab ID #02014, Utah DOH Cert. # QUAN3, Virginia DGS Lab ID #00165, Washington DOE Lab #C120, West Virginia DEP Cert. #345, Wisconsin DNR Lab ID #998044300, Naval Facilities Engineering Service Center and USDA Soil Permit #S-46424. This list of approvals is subject to change and does not imply that laboratory certification is available for all parameters reported in this environmental sample data report.

---

# Sample Data Summary

Leggette, Brashears & Graham, Inc.  
 Client Sample ID: AQ102506:930 NP4-1  
 GC/MS Volatiles

Lot-Sample # H6J260127 - 001      Work Order # JG9V11AA      Matrix.....: AIR

Date Sampled...: 10/25/06      Date Received...: 10/26/06  
 Prep Date.....: 10/27/06      Analysis Date..: 10/27/06  
 Prep Batch #....: 6303399  
 Dilution Factor.: 5      Method.....: TO-15

PARAMETER	RESULTS (ppb(v/v))	REPORTING LIMIT (ppb(v/v))	RESULTS (ug/m3)	REPORTING LIMIT (ug/m3)
Benzene	ND	1.0	ND	3.2
Bromodichloromethane	ND	1.0	ND	6.7
Bromoform	ND	1.0	ND	10
Bromomethane	ND	1.0	ND	3.9
<b>Carbon disulfide</b>	<b>2.9</b>	<b>2.5</b>	<b>9.1</b>	<b>7.8</b>
Carbon tetrachloride	ND	1.0	ND	6.3
Chlorobenzene	ND	1.0	ND	4.6
Dibromochloromethane	ND	1.0	ND	8.5
Chloroethane	ND	1.0	ND	2.6
<b>Chloroform</b>	<b>0.87</b>	<b>1.0</b>	<b>4.3</b>	<b>4.9</b>
Chloromethane	ND	2.5	ND	5.2
<b>1,1-Dichloroethane</b>	<b>3.2</b>	<b>1.0</b>	<b>13</b>	<b>4.0</b>
1,2-Dichloroethane	ND	1.0	ND	4.0
<b>cis-1,2-Dichloroethene</b>	<b>0.87</b>	<b>1.0</b>	<b>3.5</b>	<b>4.0</b>
trans-1,2-Dichloroethene	ND	1.0	ND	4.0
<b>1,1-Dichloroethene</b>	<b>1.1</b>	<b>1.0</b>	<b>4.5</b>	<b>4.0</b>
1,2-Dichloropropane	ND	1.0	ND	4.6
cis-1,3-Dichloropropene	ND	1.0	ND	4.5
trans-1,3-Dichloropropene	ND	1.0	ND	4.5
Ethylbenzene	ND	1.0	ND	4.3
<b>Methylene chloride</b>	<b>0.29</b>	<b>2.5</b>	<b>1.00</b>	<b>8.7</b>
Styrene	ND	1.0	ND	4.3
1,1,2,2-Tetrachloroethane	ND	1.0	ND	6.9
<b>Tetrachloroethene</b>	<b>21</b>	<b>1.0</b>	<b>140</b>	<b>6.8</b>
<b>Toluene</b>	<b>0.62</b>	<b>1.0</b>	<b>2.3</b>	<b>3.8</b>
<b>1,1,1-Trichloroethane</b>	<b>37</b>	<b>1.0</b>	<b>200</b>	<b>5.5</b>
1,1,2-Trichloroethane	ND	1.0	ND	5.5
<b>Trichloroethene</b>	<b>1.2</b>	<b>1.0</b>	<b>6.3</b>	<b>5.4</b>
<b>Vinyl chloride</b>	<b>0.38</b>	<b>1.0</b>	<b>0.97</b>	<b>2.6</b>
<b>m-Xylene &amp; p-Xylene</b>	<b>0.42</b>	<b>1.0</b>	<b>1.8</b>	<b>4.3</b>
o-Xylene	ND	1.0	ND	4.3

SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
1,2-Dichloroethane-d4	109	70 - 130
Toluene-d8	108	70 - 130
4-Bromofluorobenzene	101	70 - 130

Leggette, Brashears & Graham, Inc.  
Client Sample ID: AQ102506:930 NP4-1  
GC/MS Volatiles

---

Lot-Sample # H6J260127 - 001      Work Order # JG9V11AA      Matrix.....: AIR

Qualifiers

- B            Method blank contamination. The associated method blank contains the target analyte at a reportable level.
- J            Estimated result. Result is less than RL.

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)\*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) \* Dilution Factor) \* (Molecular Weight/24.45)

Leggette, Brashears & Graham, Inc.  
 Client Sample ID: AQ102506:935 NP4-2  
 GC/MS Volatiles

Lot-Sample # H6J260127 - 002      Work Order # JG9WC1AA      Matrix.....: AIR

Date Sampled...: 10/25/06      Date Received...: 10/26/06  
 Prep Date.....: 10/27/06      Analysis Date..: 10/27/06  
 Prep Batch #.....: 6303399  
 Dilution Factor.: 5      Method.....: TO-15

PARAMETER	RESULTS (ppb(v/v))	REPORTING LIMIT (ppb(v/v))	RESULTS (ug/m3)	REPORTING LIMIT (ug/m3)
Benzene	ND	1.0	ND	3.2
Bromodichloromethane	ND	1.0	ND	6.7
Bromoform	ND	1.0	ND	10
Bromomethane	ND	1.0	ND	3.9
<b>Carbon disulfide</b>	<b>2.5</b>	<b>2.5</b>	<b>7.7</b>	<b>7.8</b>
Carbon tetrachloride	ND	1.0	ND	6.3
Chlorobenzene	ND	1.0	ND	4.6
Dibromochloromethane	ND	1.0	ND	8.5
<b>Chloroethane</b>	<b>0.25</b>	<b>1.0</b>	<b>0.65</b>	<b>2.6</b>
<b>Chloroform</b>	<b>0.53</b>	<b>1.0</b>	<b>2.6</b>	<b>4.9</b>
Chloromethane	ND	2.5	ND	5.2
<b>1,1-Dichloroethane</b>	<b>2.8</b>	<b>1.0</b>	<b>11</b>	<b>4.0</b>
1,2-Dichloroethane	ND	1.0	ND	4.0
<b>cis-1,2-Dichloroethene</b>	<b>1.1</b>	<b>1.0</b>	<b>4.4</b>	<b>4.0</b>
trans-1,2-Dichloroethene	ND	1.0	ND	4.0
<b>1,1-Dichloroethene</b>	<b>0.97</b>	<b>1.0</b>	<b>3.9</b>	<b>4.0</b>
1,2-Dichloropropane	ND	1.0	ND	4.6
cis-1,3-Dichloropropene	ND	1.0	ND	4.5
trans-1,3-Dichloropropene	ND	1.0	ND	4.5
Ethylbenzene	ND	1.0	ND	4.3
<b>Methylene chloride</b>	<b>0.30</b>	<b>2.5</b>	<b>1.0</b>	<b>8.7</b>
Styrene	ND	1.0	ND	4.3
1,1,2,2-Tetrachloroethane	ND	1.0	ND	6.9
<b>Tetrachloroethene</b>	<b>0.30</b>	<b>1.0</b>	<b>2.1</b>	<b>6.8</b>
<b>Toluene</b>	<b>0.48</b>	<b>1.0</b>	<b>1.8</b>	<b>3.8</b>
<b>1,1,1-Trichloroethane</b>	<b>11</b>	<b>1.0</b>	<b>62</b>	<b>5.5</b>
1,1,2-Trichloroethane	ND	1.0	ND	5.5
Trichloroethene	ND	1.0	ND	5.4
<b>Vinyl chloride</b>	<b>0.35</b>	<b>1.0</b>	<b>0.90</b>	<b>2.6</b>
<b>m-Xylene &amp; p-Xylene</b>	<b>0.32</b>	<b>1.0</b>	<b>1.4</b>	<b>4.3</b>
o-Xylene	ND	1.0	ND	4.3

SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
1,2-Dichloroethane-d4	110	70 - 130
Toluene-d8	112	70 - 130
4-Bromofluorobenzene	102	70 - 130



Leggette, Brashears & Graham, Inc.  
Client Sample ID: AQ102506:935 NP4-2  
GC/MS Volatiles

---

Lot-Sample # H6J260127 - 002

Work Order # JG9WC1AA

Matrix.....: AIR

Qualifiers

B Method blank contamination. The associated method blank contains the target analyte at a reportable level.  
J Estimated result. Result is less than RL.

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)\*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) \* Dilution Factor) \* (Molecular Weight/24.45)

Leggette, Brashears & Graham, Inc.  
 Client Sample ID: AQ102506:936 NP4-3  
 GC/MS Volatiles

Lot-Sample # H6J260127 - 003      Work Order # JG9WD1AA      Matrix.....: AIR

Date Sampled...: 10/25/06      Date Received..: 10/26/06  
 Prep Date.....: 10/27/06      Analysis Date..: 10/27/06  
 Prep Batch #....: 6303399  
 Dilution Factor.: 5      Method.....: TO-15

PARAMETER	RESULTS (ppb(v/v))	REPORTING LIMIT (ppb(v/v))	RESULTS (ug/m3)	REPORTING LIMIT (ug/m3)
Benzene	ND	1.0	ND	3.2
Bromodichloromethane	ND	1.0	ND	6.7
Bromoform	ND	1.0	ND	10
Bromomethane	ND	1.0	ND	3.9
<b>Carbon disulfide</b>	<b>2.8</b>	<b>2.5</b>	<b>8.7</b>	<b>7.8</b>
Carbon tetrachloride	ND	1.0	ND	6.3
Chlorobenzene	ND	1.0	ND	4.6
Dibromochloromethane	ND	1.0	ND	8.5
<b>Chloroethane</b>	<b>0.24</b>	<b>1.0</b>	<b>0.62</b>	<b>2.6</b>
<b>Chloroform</b>	<b>0.58</b>	<b>1.0</b>	<b>2.8</b>	<b>4.9</b>
Chloromethane	ND	2.5	ND	5.2
<b>1,1-Dichloroethane</b>	<b>2.4</b>	<b>1.0</b>	<b>9.8</b>	<b>4.0</b>
1,2-Dichloroethane	ND	1.0	ND	4.0
<b>cis-1,2-Dichloroethene</b>	<b>1.2</b>	<b>1.0</b>	<b>4.8</b>	<b>4.0</b>
trans-1,2-Dichloroethene	ND	1.0	ND	4.0
<b>1,1-Dichloroethene</b>	<b>0.64</b>	<b>1.0</b>	<b>2.5</b>	<b>4.0</b>
1,2-Dichloropropane	ND	1.0	ND	4.6
cis-1,3-Dichloropropene	ND	1.0	ND	4.5
trans-1,3-Dichloropropene	ND	1.0	ND	4.5
Ethylbenzene	ND	1.0	ND	4.3
<b>Methylene chloride</b>	<b>0.27</b>	<b>2.5</b>	<b>0.93</b>	<b>8.7</b>
Styrene	ND	1.0	ND	4.3
1,1,2,2-Tetrachloroethane	ND	1.0	ND	6.9
Tetrachloroethene	ND	1.0	ND	6.8
<b>Toluene</b>	<b>0.45</b>	<b>1.0</b>	<b>1.7</b>	<b>3.8</b>
<b>1,1,1-Trichloroethane</b>	<b>7.5</b>	<b>1.0</b>	<b>41</b>	<b>5.5</b>
1,1,2-Trichloroethane	ND	1.0	ND	5.5
Trichloroethene	ND	1.0	ND	5.4
<b>Vinyl chloride</b>	<b>0.31</b>	<b>1.0</b>	<b>0.78</b>	<b>2.6</b>
<b>m-Xylene &amp; p-Xylene</b>	<b>0.30</b>	<b>1.0</b>	<b>1.3</b>	<b>4.3</b>
o-Xylene	ND	1.0	ND	4.3

SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
1,2-Dichloroethane-d4	110	70 - 130
Toluene-d8	112	70 - 130
4-Bromofluorobenzene	102	70 - 130

Leggette, Brashears & Graham, Inc.  
Client Sample ID: AQ102506:936 NP4-3  
GC/MS Volatiles

---

Lot-Sample # H6J260127 - 003

Work Order # JG9WD1AA

Matrix.....: AIR

Qualifiers

B Method blank contamination. The associated method blank contains the target analyte at a reportable level.  
J Estimated result. Result is less than RL.

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)\*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) \* Dilution Factor) \* (Molecular Weight/24.45)

Leggette, Brashears & Graham, Inc.  
 Client Sample ID: INTRA-LAB BLANK  
 GC/MS Volatiles

Lot-Sample # H6J300000 - 399B      Work Order # JHJPX1AA      Matrix.....: AIR

Prep Date.....: 10/27/06      Date Received..: 10/25/06  
 Prep Batch #....: 6303399      Analysis Date..: 10/27/06  
 Dilution Factor.: 1      Method.....: TO-15

PARAMETER	RESULTS (ppb(v/v))	REPORTING LIMIT (ppb(v/v))	RESULTS (ug/m3)	REPORTING LIMIT (ug/m3)
Benzene	ND	0.20	ND	0.64
Bromodichloromethane	ND	0.20	ND	1.3
Bromoform	ND	0.20	ND	2.1
Bromomethane	ND	0.20	ND	0.78
Carbon disulfide	ND	0.50	ND	1.6
Carbon tetrachloride	ND	0.20	ND	1.3
Chlorobenzene	ND	0.20	ND	0.92
Dibromochloromethane	ND	0.20	ND	1.7
Chloroethane	ND	0.20	ND	0.53
Chloroform	ND	0.20	ND	0.98
Chloromethane	ND	0.50	ND	1.0
1,1-Dichloroethane	ND	0.20	ND	0.81
1,2-Dichloroethane	ND	0.20	ND	0.81
cis-1,2-Dichloroethene	ND	0.20	ND	0.79
trans-1,2-Dichloroethene	ND	0.20	ND	0.79
1,1-Dichloroethene	ND	0.20	ND	0.79
1,2-Dichloropropane	ND	0.20	ND	0.92
cis-1,3-Dichloropropene	ND	0.20	ND	0.91
trans-1,3-Dichloropropene	ND	0.20	ND	0.91
Ethylbenzene	ND	0.20	ND	0.87
<b>Methylene chloride</b>	<b>0.078</b>	<b>0.50</b>	<b>0.27</b> J	<b>1.7</b>
Styrene	ND	0.20	ND	0.85
1,1,2,2-Tetrachloroethane	ND	0.20	ND	1.4
Tetrachloroethene	ND	0.20	ND	1.4
Toluene	ND	0.20	ND	0.75
1,1,1-Trichloroethane	ND	0.20	ND	1.1
1,1,2-Trichloroethane	ND	0.20	ND	1.1
Trichloroethene	ND	0.20	ND	1.1
Vinyl chloride	ND	0.20	ND	0.51
m-Xylene & p-Xylene	ND	0.20	ND	0.87
o-Xylene	ND	0.20	ND	0.87

SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
1,2-Dichloroethane-d4	106	70 - 130
Toluene-d8	113	70 - 130
4-Bromofluorobenzene	92	70 - 130

Leggette, Brashears & Graham, Inc.  
Client Sample ID: INTRA-LAB BLANK  
GC/MS Volatiles

---

Lot-Sample # H6J300000 - 399B

Work Order # JHJPX1AA

Matrix.....: AIR

Qualifiers

J Estimated result. Result is less than RL.

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)\*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) \* Dilution Factor) \* (Molecular Weight/24.45)

**Leggette, Brashears & Graham, Inc.**  
**Client Sample ID: CHECK SAMPLE**  
**GC/MS Volatiles**

**Lot-Sample #** H6J300000 - 399C      **Work Order #** JHJPX1AC      **Matrix.....:** AIR

**Prep Date.....:** 10/27/06      **Date Received...:** 10/25/06  
**Prep Batch #.....:** 6303399      **Analysis Date..:** 10/27/06  
**Dilution Factor..:** 1      **Method.....:** TO-15

<u>PARAMETER</u>	<u>SPIKE AMOUNT (ppb(v/v))</u>	<u>MEASURED AMOUNT (ppb(v/v))</u>	<u>SPIKE AMOUNT (ug/m3)</u>	<u>MEASURED AMOUNT (ug/m3)</u>	<u>PERCENT RECOVERY</u>	<u>RECOVERY LIMITS</u>
Benzene	10.0	8.54	32	27	85	70 - 130
Chlorobenzene	10.0	9.50	46	44	95	70 - 130
1,1-Dichloroethene	10.0	10.7	40	42	107	70 - 130
Toluene	10.0	9.30	38	35	93	70 - 130
Trichloroethene	10.0	9.66	54	52	97	70 - 130

<u>SURROGATE</u>	<u>PERCENT RECOVERY</u>	<u>LABORATORY CONTROL LIMITS (%)</u>
1,2-Dichloroethane-d4	106	70 - 130
Toluene-d8	110	70 - 130
4-Bromofluorobenzene	106	70 - 130

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)\*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) \* Dilution Factor) \* (Molecular Weight/24.45)

# Sample Receipt Documentation

**JTL Knoxville**

5815 Middlebrook Pike • Knoxville, TN 37921-5947  
 Phone: (865) 291-3000 • Fax: (865) 584-4315  
 Receiving: (865) 291-3031

**ANALYSIS REQUEST AND CHAIN OF CUSTODY RECORD\***

Reference Document / Page 1 of 1

Project Name/No. 1 Rowe  
 Sample Team Members 2 Rob Drew  
 Profit Center No. 3 NABSAG 0401  
 Project Manager 4 Mark Goldberg  
 Purchase Order No. 6 \_\_\_\_\_  
 Required Report Date 11 \_\_\_\_\_

Samples Shipment Date 7 10-25-2006  
 Lab Destination 8 \_\_\_\_\_  
 Lab Contact 9 Scott Harris  
 Project Contact / Phone 12 203-929-8555  
 Carrier / Waybill No. 13 \_\_\_\_\_

Bill to: 5 JBG  
4 Research Dr.  
Suite 301  
Shelton, CT 06484  
 Report to: 10 Mark Goldberg  
HGJ260127

**ONE CONTAINER PER LINE**

Sample 14 Number	Sample 15 Type	Date/Time 16 Collected	Container 17 Type	Sample 18 Volume	Pre- 19 servative	Requested Testing 20 Program	Condition on Receipt 21 Lab use only
AC102506; 930 NP4-1	APR	10-25-06	Tekor bag	1L	-	TD-17	Custody seals intact <input checked="" type="checkbox"/> N NA Temperature received at <u>Analysis</u>
↓ :935 NP4-2	↓	↓	↓	↓	-	↓	Received by <u>Acute</u> Date <u>10/26/06</u>
↓ :936 NP4-3	↓	↓	↓	↓	-	↓	Number of packages <u>1-FedEx</u> Tracking # <u>790592570057</u>
							<u>Ma Li 10/26/06</u>

Special Instructions: 23

Possible Hazard Identification: 24

Non-Hazard  Flammable  Skin Irritant  Poison B  Unknown  Sample Disposal: 25  
 Turnaround Time Required: 26  
 Normal  Rush  Return to Client  Disposal by Lab  Archive (mos.)

QC Level: 27  
 I.  II.  III.  Project Specific (specify):  
 1. Relinquished by 28  
 (Signature / Affiliation) [Signature] Date: 10-25-06  
 Time: 1000 (Signature / Affiliation) [Signature] Date: 10/26/06  
 Time: 0950

1. Relinquished by  
 (Signature / Affiliation) \_\_\_\_\_ Date: \_\_\_\_\_  
 Time: \_\_\_\_\_ (Signature / Affiliation) \_\_\_\_\_ Date: \_\_\_\_\_  
 Time: \_\_\_\_\_

Comments: 29



STL KNOXVILLE SAMPLE RECEIPT/CONDITION UPON RECEIPT ANOMALY CHECKLIST

Client: LLG Project: Rowe Lot Number: 165260127

Review Items	Yes	No	NA	If No, what was the problem?	Comments/Actions Taken
1. Do sample container labels match COC? (IDs, Dates, Times)	<input checked="" type="checkbox"/>			<input type="checkbox"/> 1a Do not match COC <input type="checkbox"/> 1b Incomplete information <input type="checkbox"/> 1c Marking smeared <input type="checkbox"/> 1d Label torn <input type="checkbox"/> 1e No label <input type="checkbox"/> 1f COC not received <input type="checkbox"/> 1g Other:	Best on COC is listed as TO-17 Talked with M about it and Am (ag99AA) in for TO-15
2. Is the cooler temperature within limits? (> freezing temp. of water to 6°C; NC, 1668, 1613B: 0-4°C; VOST: 10°C; MA: 2-6 °C)	<input checked="" type="checkbox"/>			<input type="checkbox"/> 2a Temp Blank = _____ <input type="checkbox"/> 2b Cooler Temp = _____	
3. Were samples received with correct chemical preservative (excluding Encore)?	<input checked="" type="checkbox"/>		<input checked="" type="checkbox"/>	<input type="checkbox"/> 3a Sample preservative = _____	
4. Were custody seals present/intact on cooler and/or containers?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 4a Not present <input type="checkbox"/> 4b Not intact <input type="checkbox"/> 4c Other:	
5. Were all of the samples listed on the COC received?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 5a Samples received-not on COC <input type="checkbox"/> 5b Samples not received-on COC	
6. Were all of the sample containers received intact?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 6a Leaking <input type="checkbox"/> 6b Broken	
7. Were VOA samples received without headspace?	<input checked="" type="checkbox"/>		<input checked="" type="checkbox"/>	<input type="checkbox"/> 7a Headspace (VOA only)	
8. Were samples received in appropriate containers?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 8a Improper container	
9. Did you check for residual chlorine, if necessary?	<input checked="" type="checkbox"/>		<input checked="" type="checkbox"/>	<input type="checkbox"/> 9a Could not be determined due to matrix interference	
10. Were samples received within holding time?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 10a Holding time expired	
11. For rad samples, was sample activity info. provided?	<input checked="" type="checkbox"/>			<input type="checkbox"/> Incomplete information	
12. For SOG water samples (1613B, 1668A, 8290, LR PAHs), do samples have visible solids present?	<input checked="" type="checkbox"/>		<input checked="" type="checkbox"/>	If yes & appears to be > 1%, was SOG notified?	
13. Are the shipping containers intact?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 13a Leaking <input type="checkbox"/> 13b Other:	
14. Was COC relinquished? (Signed/Dated/Timed)	<input checked="" type="checkbox"/>			<input type="checkbox"/> 14a Not relinquished	
15. Are tests/parameters listed for each sample?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 15a Incomplete information	
16. Is the matrix of the samples noted?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 15a Incomplete information	
17. Is the date/time of sample collection noted?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 15a Incomplete information	
18. Is the client and project name/# identified?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 15a Incomplete information	
19. Was the sampler identified on the COC?	<input checked="" type="checkbox"/>			<input type="checkbox"/> 15a Incomplete information	

Quote #: 69610 PM Instructions: \_\_\_\_\_

Sample Receiving Associate: [Signature] Date: 10/21/06