

-DRAFT-

PROJECT STATUS MEMORANDUM

NO. 08-01

TO: Pamela Tames, USEPA

FROM: Mark M. Goldberg, P.E.

DATE: April 22, 2008

PROJECT: Ground Water Remedial Action
Focused Pump & Treat System
Former Rowe Industries Superfund Site
Sag Harbor, New York
First Quarter (January 17 through March 31, 2008) Status Report

LBG Engineering Services, P.C. (LBG) discontinued operation of the Focused Pump and Treat (FP&T) system on April 3, 2007 because water quality data from the recovery wells in the Former Drum Storage Area (FDSA) indicated that degradation of tetrachloroethylene (PCE) was occurring, as discussed in the First Quarter 2007 Status Report for the FP&T system. Since that time, monitoring data appear to indicate that degradation of COCs increases when the FP&T system is not operating. LBG has been monitoring the water quality at the four FP&T recovery wells (FRW-1, 2, 3 and 4) on a monthly basis while the system has been inactive to determine if the trend in degradation of PCE to daughter products (i.e. 1,2 cis-dichloroethylene (12DCE) and vinyl chloride (VC)) is continuing in the FDSA. The locations of the FP&T recovery wells are shown on Figure 1.

Tables 1, 2, 3 and 4 and Graphs 1, 2, 3 and 4 present the water quality data for FRW-1, 2, 3 and 4, respectively, since the beginning of 2007. The water quality data for the latest quarter indicate that some degradation of PCE is continuing because 12DCE and VC are present in the water samples collected from FRW-1, 2 and 3. The concentration of PCE and daughter products in the ground water varies with each sample round; however, the concentrations of daughter products at wells FRW-1, 2, and 3 continue to be higher when the FP&T system is not operating compared to when the system was running.

The concentration of PCE in the ground water at FRW-1 is variable. The PCE concentrations at FRW-2 during the 1st quarter of 2008 are fairly consistent with PCE concentrations detected in 2007. The PCE concentration at FRW-3 increased this quarter, but it is not above the historical high concentrations. The concentrations of the COCs from the ground water at FRW-4 continue to be low compared to the other three recovery wells.

Table 5 presents ground-water quality field measurements that were collected with a calibrated U-22 Horiba water quality meter (Horiba) on February 5, 2008 and March 10, 2008 for pH, dissolved oxygen (DO), oxidation-reduction potential (ORP), temperature, conductivity and turbidity. The first four parameters (pH, DO, ORP and temperature) are the most important

factors that are measured to determine if the aquifer conditions are favorable for degradation of the COCs. ORP was in the preferred range for degradation in all wells except FRW-1. pH was in the preferred range for degradation of COCs in all wells. Colder ground-water temperatures in the winter will slow down microbial activity and, therefore, will slow down COC degradation.

Table 6 presents DO and temperature measurements collected from different wells in the FDSA. DO and temperature were measured with two different calibrated meters (Horiba U-22 and YSI 560) in March to determine the accuracy of these measurements. The factors under evaluation were the following:

1. Recording measurements at the wells compared to the sample ports in the FP&T trailer; and,
2. Recording measurements from two different meters (to check the accuracy of the Horiba U-22, which is the meter that is normally used for field measurements).

The data in Table 6 suggest that DO and temperature measurements collected for the two meters were similar from the three monitor wells (MW98-01A, 05A, 05B) located in the FDSA (refer to Figure 1 for monitor well locations). Therefore, the data obtained using the Horiba U-22 is judged to be accurate.

However, the DO measurements increase and temperature measurements decrease when samples are collected from the sample ports in the FP&T trailer compared to readings directly from the wells. Furthermore, the low DO concentrations measured at the wells suggest that the conditions in the aquifer may be more anaerobic than previously indicated, which is favorable for degradation of COCs. The increase in DO observed at the trailer is most likely caused by aeration of the water during pumping and the decrease in temperature observed from the well to the trailer (i.e. the solubility of oxygen in water increases with decreasing temperature). This evaluation suggests that DO and temperature measurements collected at the trailer are not representative of DO and temperature measurements in the FDSA ground water and the conditions in the FDSA are more conducive to degradation of the COCs than previously expected. Therefore, while monthly DO readings (along with the other field readings) will continue to be collected and recorded from the sample ports using the Horiba U-22 meter, a more representative measure of DO and temperature in the ground water of the FDSA will be completed during semi-annual sampling events when access to wells is available (i.e. conditions of the access agreement).

Based on the water quality data collected in the first quarter of 2008, there is sufficient evidence to indicate that degradation of the COCs is continuing. Therefore, LBG recommends leaving the FP&T system inactive for the second quarter of 2008 and continuing to monitor the water quality trends at the four wells.

cc: Jeffrey S. Srulovitz, Kraft Foods Global, Inc. – .pdf
Lisa Krogman, Environ – .pdf
Jeff Trad, NYSDEC – .pdf
Chief-Operation Maintenance and Support Section, NYSDEC – .pdf
William Spitz, RWM, R-1, NYSDEC

TABLES

Table 1

**GROUND-WATER REMEDIAL ACTION
FOCUSED PUMP AND TREAT SYSTEM
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

**Recovery Well FRW-1 VOC Concentrations, micrograms per liter
January 1, 2007 through March 31, 2008**

FRW-1											
Date	PCE	TCE	12DCE	TCA	11DCA	11DCE	T12DCE	135TMB	TOLUENE	VC	MC
1/10/2007	240	5.5	28	9.7	ND<1	ND<1	ND<1	ND<1	3.1	1.6	ND<1
3/7/2007	41	ND<1	620	ND<1	ND<1	ND<1	ND<1	ND<1	5.6	170	ND<1
3/28/2007	170	3.1	2.4	ND<1	ND<1	ND<1	ND<1	ND<1	4.6	1.3	ND<1
4/3/2007	110	8.6	93	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	30	ND<1
5/1/2007	400	6.5	34	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	37	ND<1
6/7/2007	200	6.8	43	ND<1	ND<1	ND<1	ND<1	ND<1	0.98	88	ND<1
7/12/2007	53	3.0	9.0	1.8	ND<1	ND<1	ND<1	ND<1	1.4	13	ND<1
8/8/2007	300	7.2	8.2	21	2.1	ND<1	ND<1	ND<1	ND<1	6.9	ND<1
9/12/2007	430	8.1	9.0	22	1.6	ND<1	ND<1	ND<1	ND<1	2.6	ND<1
10/3/2007	380	7.8	10	14	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
11/28/2007	3.9	25	15	ND<1	ND<1	4.3	ND<1	ND<1	ND<1	83	ND<1
12/12/2007	710	32	12	23	2.2	ND<1	ND<1	ND<1	0.72	6.2	ND<1
1/16/2008	410	17	24	8	0.95	ND<1	ND<1	ND<1	2	5.9	ND<1
2/5/2008	160	25	15	1.8	ND<1	ND<1	ND<1	ND<1	ND<1	4.8	ND<1
3/10/2008	600	110	43	13	5.1	10	2.4	ND<1	ND<1	68	ND<1

PCE- TETRACHLOROETHYLENE

TCA - 1,1,1-TRICHLOROETHANE

11DCA - 1,1-DICHLOROETHANE

TCE - TRICHLOROETHENE

12DCE - cis1,2-DICHLOROETHENE

MTBE - METHYL TERTIARY-BUTYL ETHER

VC - VINYL CHLORIDE

11DCE - 1,1 DICHLOROETHYLENE

T12DCE - trans 1,2 DICHLOROETHENE

135TMB - 1,3,5-TRIMETHYLBENZENE

IPB - ISOPROPYLBENZENE

4-IPT - 4-ISOPROPYLTOLUENE

-- - NOT ANALYZED

MC - METHYLENE CHLORIDE

Table 2

**GROUND-WATER REMEDIAL ACTION
FOCUSED PUMP AND TREAT SYSTEM
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

**Recovery Well FRW-2 VOC Concentrations, micrograms per liter
January 1, 2007 through March 31, 2008**

FRW-2											
Date	PCE	TCE	12DCE	TCA	IPB	NPB	124TMB	11DCA	TOLUENE	VC	EB
1/10/2007	4.8	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	33	59	ND<1
3/7/2007	5.7	ND<1	180	ND<1	ND<1	ND<1	ND<1	ND<1	640	15	ND<1
3/28/2007	72	3.5	17	ND<1	1.5	ND<1	ND<1	ND<1	19	6.0	ND<1
4/3/2007	98	2.7	19	ND<1	ND<1	ND<1	ND<1	ND<1	24	7.3	ND<1
5/1/2007	23	6.1	280	ND<1	ND<1	ND<1	ND<1	ND<1	440	17	ND<1
6/7/2007	28	14	180	ND<1	ND<1	ND<1	ND<1	ND<1	130	6.6	ND<1
7/12/2007	16	15	82	ND<1	2.8	1.1	ND<1	ND<1	120	5.7	0.60
8/8/2007	1.3	ND<1	40	ND<1	1.9	ND<1	ND<1	ND<1	44	10	ND<1
9/12/2007	11	22	260	ND<1	ND<1	ND<1	ND<1	1.6	64	19	ND<1
10/3/2007	ND<1	ND<1	12	ND<1	ND<1	ND<1	ND<1	ND<1	2.9	14	ND<1
11/28/2007	10	19	150	ND<1	1.1	ND<1	1.0	ND<1	8.5	8.7	ND<1
12/12/2007	92	9.1	12	0.85	2	1.2	ND<1	ND<1	6.7	2.4	ND<1
1/16/2008	110	17	37	ND<1	2.7	1.1	ND<1	ND<1	3	4.6	ND<1
2/5/2008	22	12	44	ND<1	ND<1	ND<1	ND<1	ND<1	8.1	34	ND<1
3/10/2008	27	10	73	ND<1	1.5	ND<1	ND<1	ND<1	1.1	2.0	ND<1

PCE- TETRACHLOROETHYLENE

TCA - 1,1,1-TRICHLOROETHANE

11DCA - 1,1-DICHLOROETHANE

TCE - TRICHLOROETHENE

12DCE - cis1,2-DICHLOROETHENE

MTBE - METHYL TERTIARY-BUTYL ETHER

VC - VINYL CHLORIDE

NPB - n PROPYLBENZENE

124TMB - 1,2,4-TRIMETHYLBENZENE

135TMB - 1,3,5-TRIMETHYLBENZENE

IPB - ISOPROPYLBENZENE

4-IPT - 4-ISOPROPYLTOLUENE

-- - NOT ANALYZED

EB - ETHYLBENZENE

Table 3

**GROUND-WATER REMEDIAL ACTION
FOCUSED PUMP AND TREAT SYSTEM
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

**Recovery Well FRW-3 VOC Concentrations, micrograms per liter
January 1, 2007 through March 31, 2008**

FRW-3											
Date	PCE	TCE	12DCE	TCA	IPB	NPB	O-XYL	11DCA	TOLUENE	VC	SBB
1/10/2007	31	3.4	290	ND<1	2.5	1.6	ND<1	0.97	68	27	ND<1
3/7/2007	120	16	110	18	ND<1	ND<1	ND<1	ND<1	26	ND<1	ND<1
3/28/2007	12	1.3	ND<1	ND<1	0.97	ND<1	ND<1	ND<1	58	ND<1	ND<1
4/3/2007	11	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	49	ND<1	ND<1
5/1/2007	190	28	280	10	ND<1	ND<1	ND<1	3.1	160	10	ND<1
6/7/2007	340	19	180	17	ND<1	ND<1	ND<1	13	35	110	ND<1
7/12/2007	620	33	44	33	2.4	0.91	ND<1	11	5.6	11	ND<1
8/8/2007	610	44	170	33	1.5	ND<1	ND<1	9.3	3	6.9	ND<1
9/12/2007	220	19	170	6.1	1.9	ND<1	ND<1	8.1	14	8.2	0.84
10/3/2007	1.9	20	11	ND<1	2.1	1	0.61	ND<1	4.7	9.9	ND<1
11/28/2007	8.2	2.6	3.7	ND<1	0.83	ND<1	ND<1	2.5	2.1	ND<1	ND<1
12/12/2007	160	88	26	1.3	ND<1	ND<1	ND<1	0.55	2.4	6.6	ND<1
1/16/2008	ND<1	13	4.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	3.1	ND<1
2/5/2008	6.6	130	30	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	11	ND<1
3/10/2008	62	23	160	1.3	0.91	0.53	ND<1	1.1	1.4	11	ND<1

PCE- TETRACHLOROETHYLENE

TCA - 1,1,1-TRICHLOROETHANE

11 2-TCA - 1,1,2-TRICHLOROETHANE

TCE - TRICHLOROETHENE

12DCE - cis1,2-DICHLOROETHENE

MTBE - METHYL TERTIARY-BUTYL ETHER

VC - VINYL CHLORIDE

NPB - n PROPYLBENZENE

O-XYL - O-XYLENE

11DCA - 1,1 DICHLOROETHANE

IPB - ISOPROPYLBENZENE

4-IPT - 4-ISOPROPYLTOLUENE

-- - NOT ANALYZED

SSB - SEC-BUTYLBENZENE

Table 4

**GROUND-WATER REMEDIAL ACTION
FOCUSED PUMP AND TREAT SYSTEM
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

**Recovery Well FRW-4 VOC Concentrations, micrograms per liter
January 1, 2007 through March 31, 2008**

FRW-4											
Date	PCE	TCE	12DCE	TCA	IPB	NPB	124TMB	135TMB	TOLUENE	VC	BUTAN
1/10/2007	51	1.7	12	0.97	ND<1	ND<1	ND<1	ND<1	1.4	2.2	ND<1
3/7/2007	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
3/28/2007	ND<1	0.90	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
4/3/2007	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
5/1/2007	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
6/7/2007	8.0	ND<1	2.4	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	120
7/12/2007	2.1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
8/8/2007	4.8	2.5	5.4	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
9/12/2007	6.9	ND<1	9	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	1.3	ND<1
10/3/2007	4.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
11/28/2007	0.78	ND<1	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
12/12/2007	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
1/16/2008	3.3	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
2/5/2008	13	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
3/10/2008	2.3	0.99	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1

PCE- TETRACHLOROETHYLENE

TCA - 1,1,1-TRICHLOROETHANE

11 2-TCA - 1,1,2-TRICHLOROETHANE

TCE - TRICHLOROETHENE

12DCE - cis1,2-DICHLOROETHENE

MTBE - METHYL TERTIARY-BUTYL ETHER

VC - VINYL CHLORIDE

NPB - n PROPYLBENZENE

124TMB - 1,2,4-TRIMETHYLBENZENE

135TMB - 1,3,5-TRIMETHYLBENZENE

IPB - ISOPROPYLBENZENE

4-IPT - 4-ISOPROPYLTOLUENE

-- - NOT ANALYZED

BUTAN - 2-BUTANONE

Table 5

**GROUND-WATER REMEDIAL ACTION
FOCUSED PUMP AND TREAT SYSTEM
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

Summary of Recovery Well Field Parameters

Well ID	Date	Field Parameters					
		pH	DO (mg/l) ^{1/}	ORP (mV)	Temp. (°C) ^{1/}	Cond. (mS/cm)	Turbidity (NTU)
FRW-1	2/20/2008	6.30	6.60	-6	6.0	31	0
	3/10/2008	6.68	6.89	-35	7.2	39	-10 ^{2/}
FRW-2	2/20/2008	6.38	5.96	-62	6.3	56	5
	3/10/2008	6.70	5.87	-70	7.7	53	11
FRW-3	2/20/2008	6.55	6.33	-76	6.3	45	2
	3/10/2008	6.74	5.67	-74	7.8	46	20
FRW-4	2/20/2008	6.76	4.10	-62	5.4	21	0
	3/10/2008	6.93	4.68	-63	7.6	22	1
Preferred Parameter Range for Degradation of COCs		6 to 8	< 1 (lower is better)	< -50 (lower is better)	25 to 35	---	---

1. DO and temperature measurements were collected from the sample ports in the FP&T trailer. Temperature differences between sample port in the trailer and the wells may be causing the DO differences observed between these locations. Refer to Table 6 and the text in the report.
2. Inaccurate reading from Horiba U-22 meter.

TABLE 6

**GROUND-WATER REMEDIAL ACTION
FOCUSED PUMP AND TREAT SYSTEM
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

**March 10 and 11, 2008 Dissolved Oxygen and Temperature Measurements in
the FDSA**

Well ID	HORIBA U-22					YSI-560	
	WELL ^{1/}		FP&T TRAILER ^{2/}			WELL ^{1/}	
	DO	Temp	DO	Temp.	DO	DO	Temp
FRW-1	NM	NM	6.89	7.2	1.11	1.11	13.1
FRW-2	NM	NM	5.87	7.7	0.98	0.98	12.6
FRW-3	NM	NM	5.67	7.8	0.98	0.98	12.3
FRW-4	NM	NM	4.68	7.6	0.98	0.98	12.6
MW98-01A	0.61	12.1	NA	NA	0.99	0.99	13.0
MW98-05A	1.68	10.6	NA	NA	0.98	0.98	12.9
MW98-05B	0.62	11.6	NA	NA	1.03	1.03	12.6


NOTES

1. Measurements were collected directly from the well.
 2. Measurements were collected from the sample ports in the FP&T trailer.
- NA indicates not applicable
NM indicates not measured.

GRAPHS


GRAPH 1
GROUND WATER REMEDIAL ACTION
FOCUSED PUMP AND TREAT SYSTEM
FORMER ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

CHLORINATED VOC CONCENTRATIONS IN RECOVERED GROUND WATER FROM FRW-1
January 1, 2007 to March 31, 2008

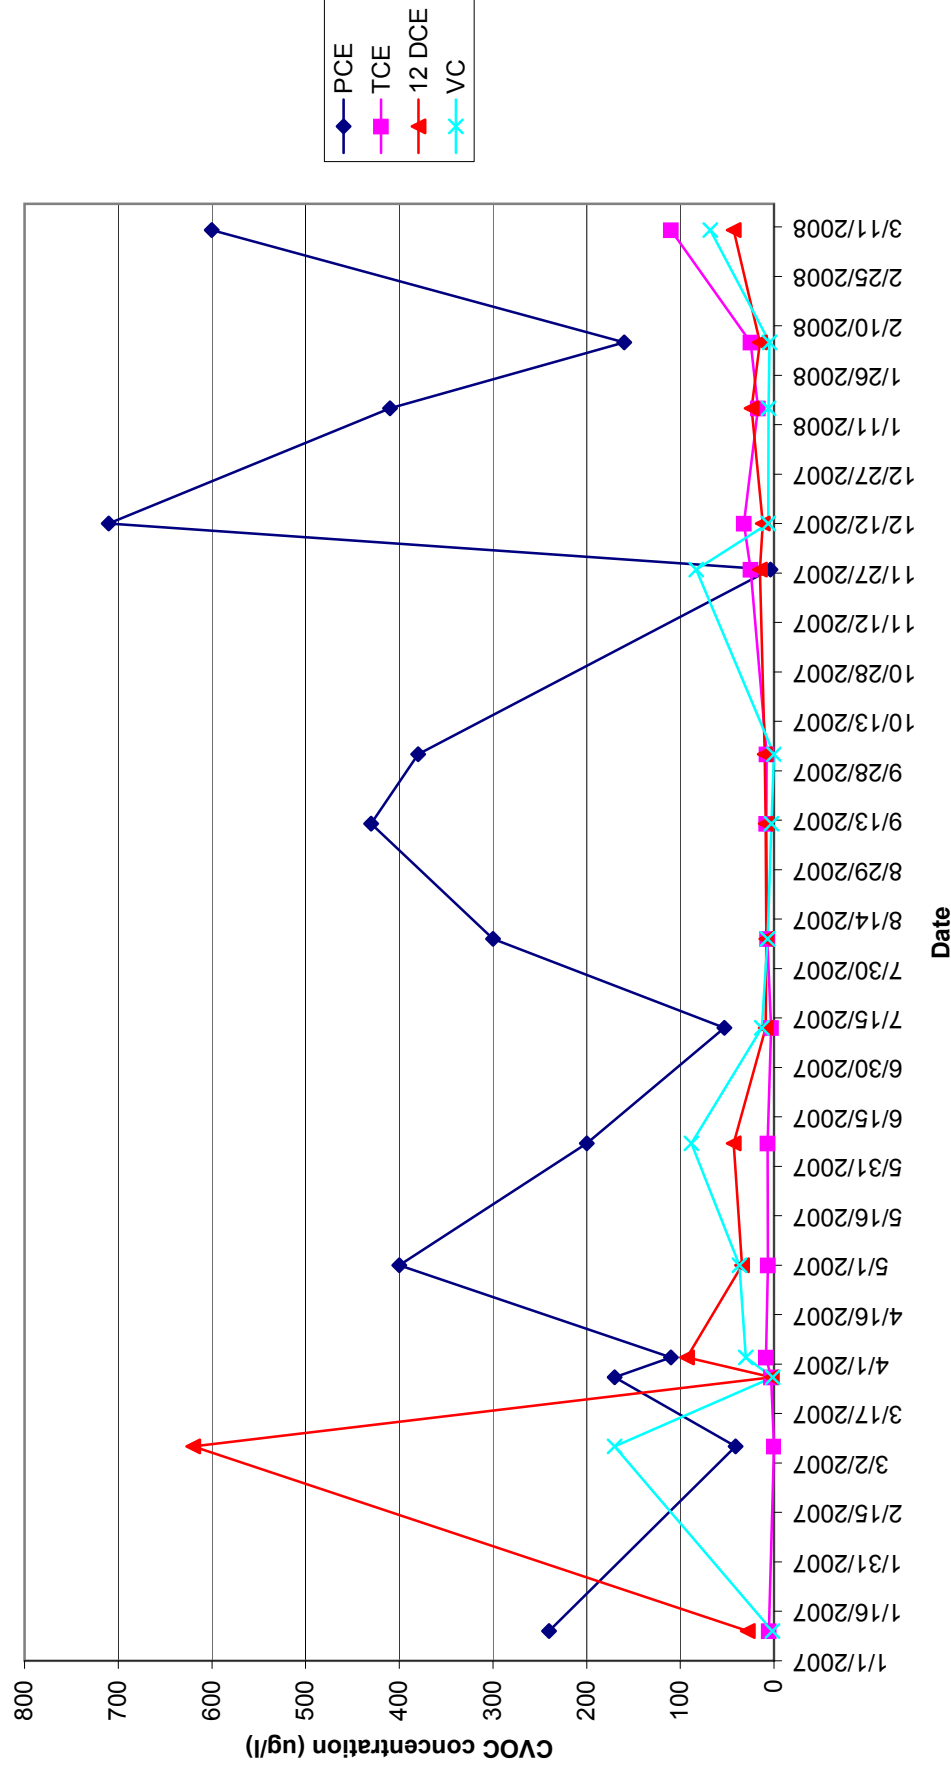


GRAPH 2
GROUND WATER REMEDIAL ACTION
FOCUSED PUMP AND TREAT SYSTEM
FORMER ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

CHLORINATED VOC CONCENTRATIONS IN RECOVERED GROUND WATER FROM FRW-2
January 1, 2007 to March 31, 2008

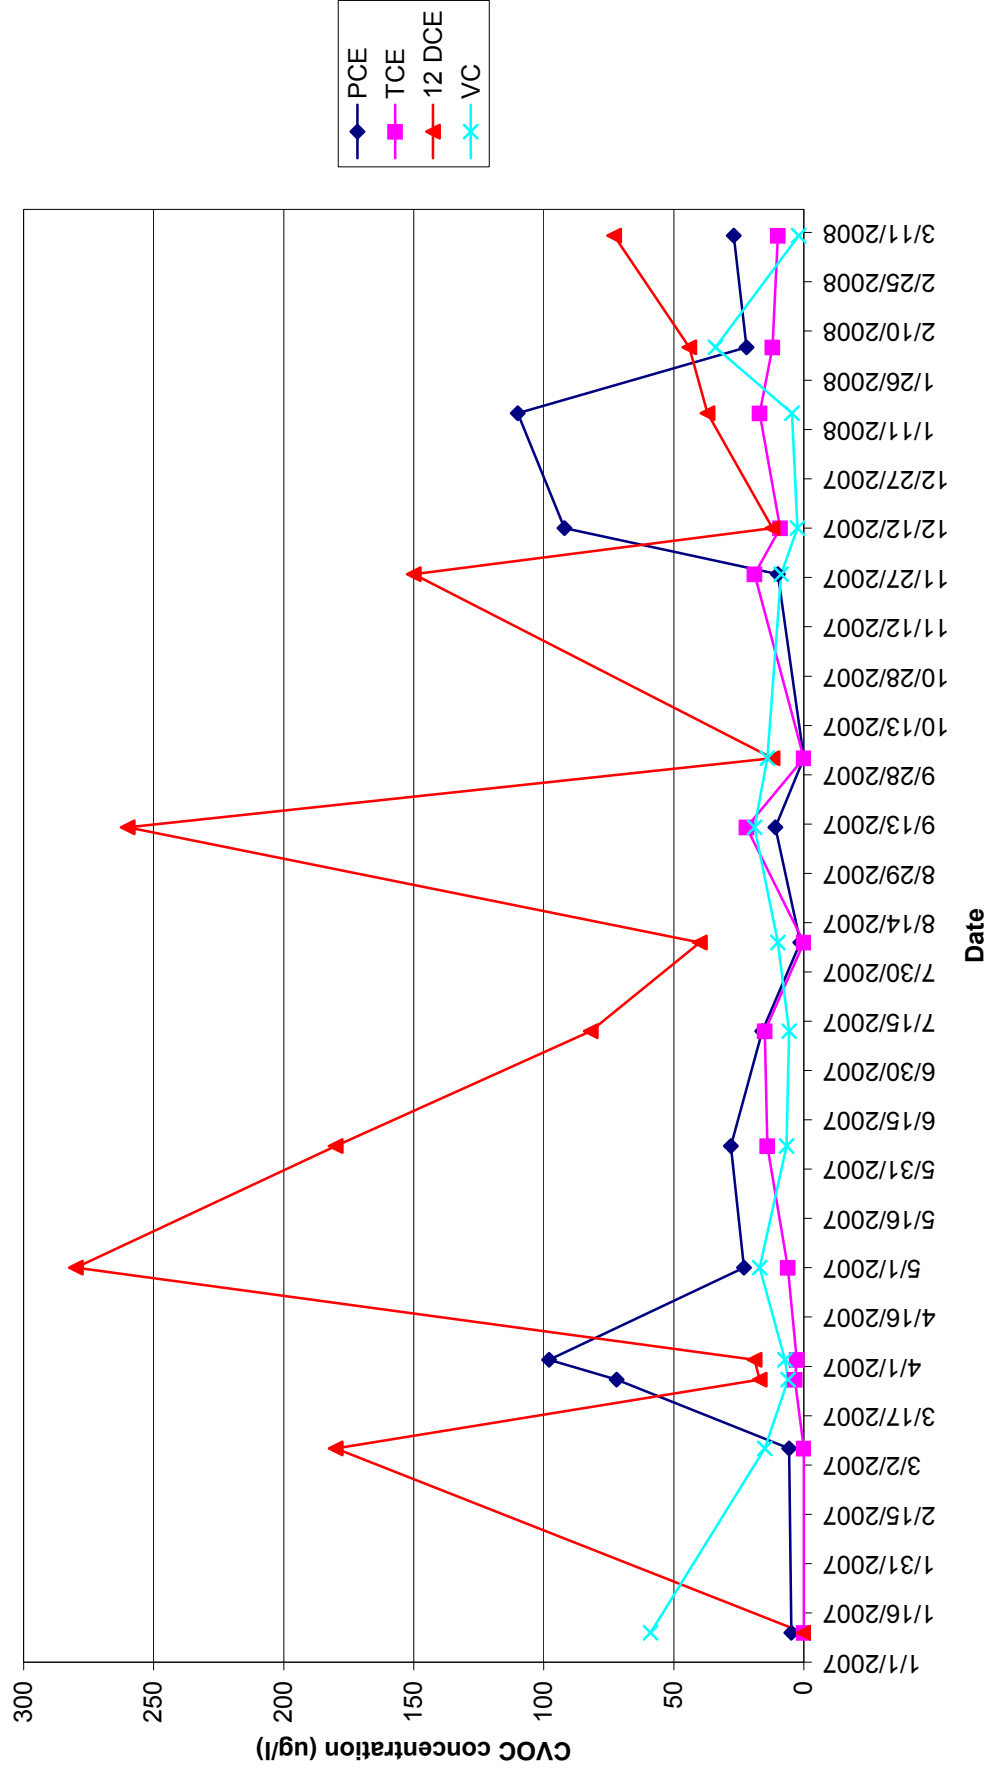


GRAPH 3
GROUND WATER REMEDIAL ACTION
FOCUSED PUMP AND TREAT SYSTEM
FORMER ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

CHLORINATED VOC CONCENTRATIONS IN RECOVERED GROUND WATER FROM FRW-3
January 1, 2007 to March 31, 2008


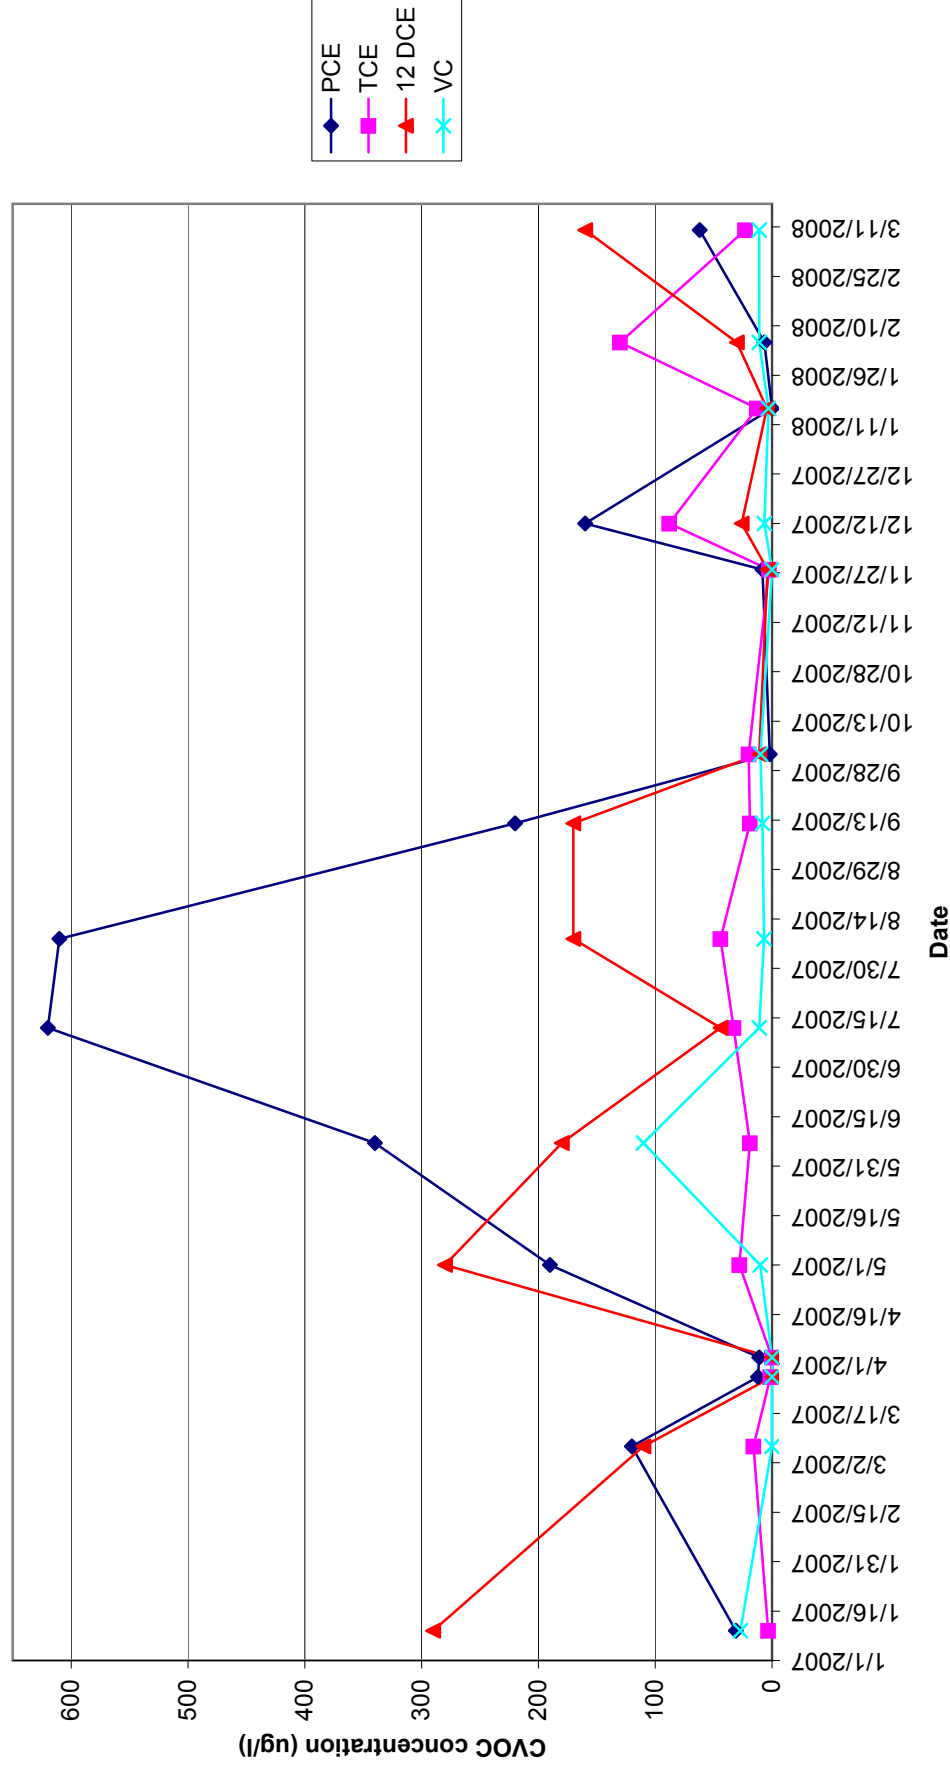


GRAPH 4
GROUND WATER REMEDIAL ACTION
FOCUSED PUMP AND TREAT SYSTEM
FORMER ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

CHLORINATED VOC CONCENTRATIONS IN RECOVERED GROUND WATER FROM FRW-4
January 1, 2007 to March 31, 2008

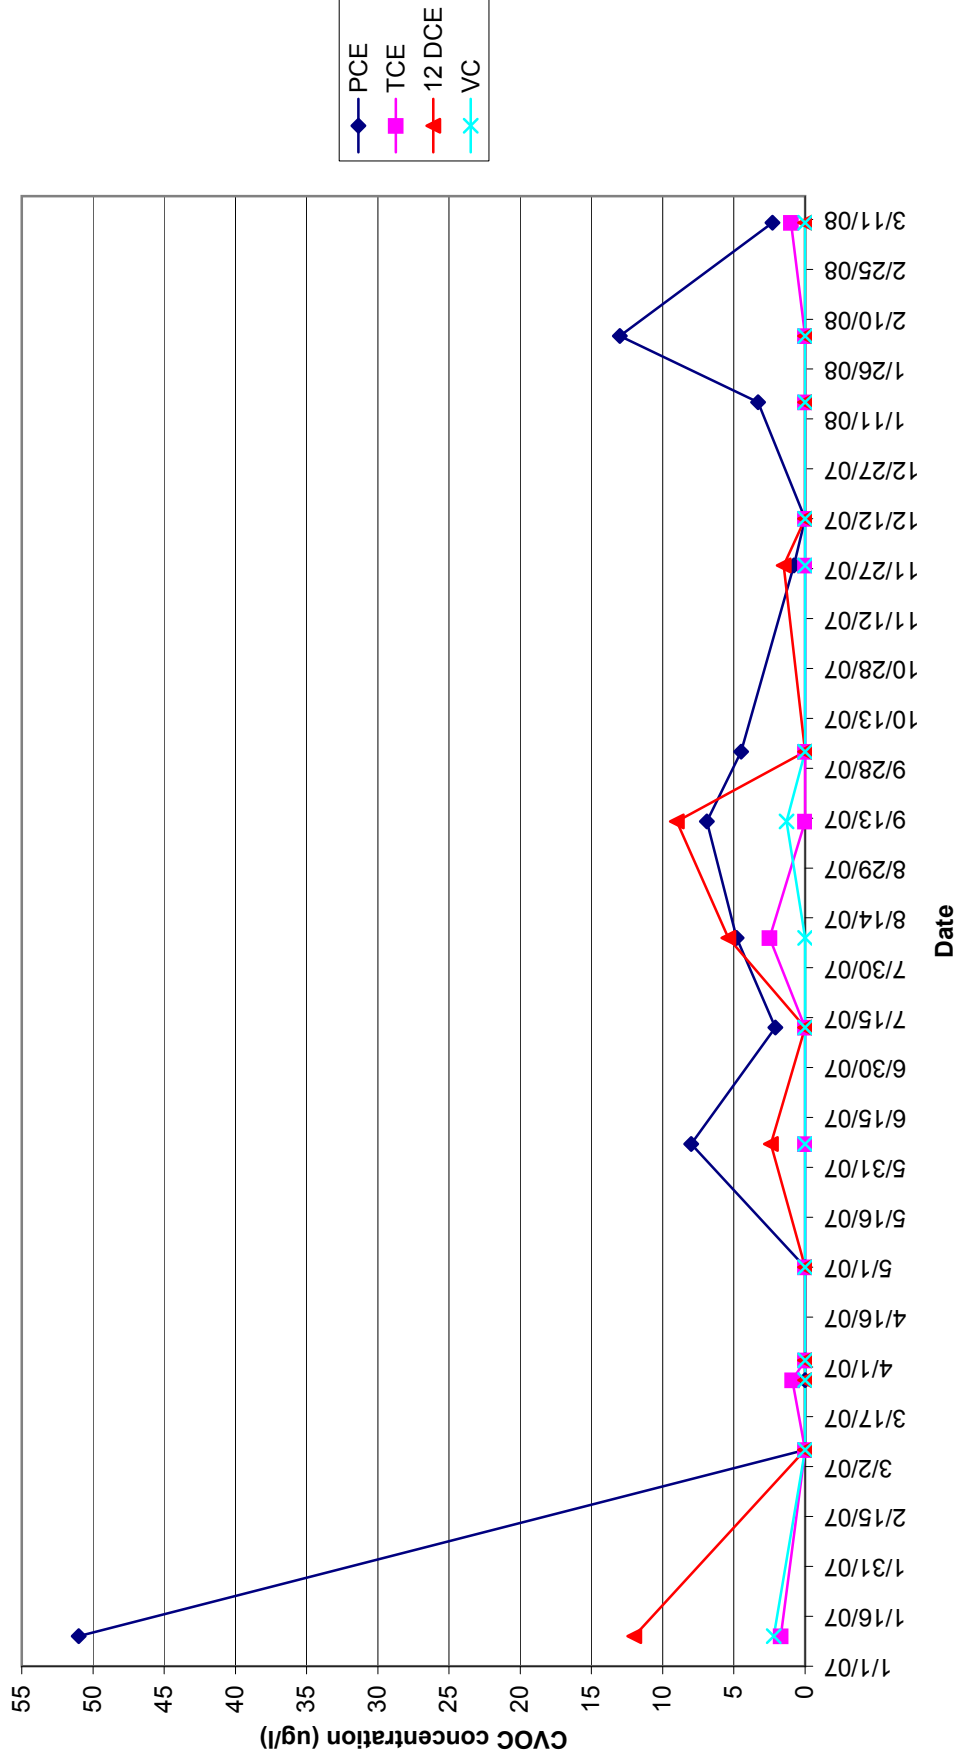

FIGURE

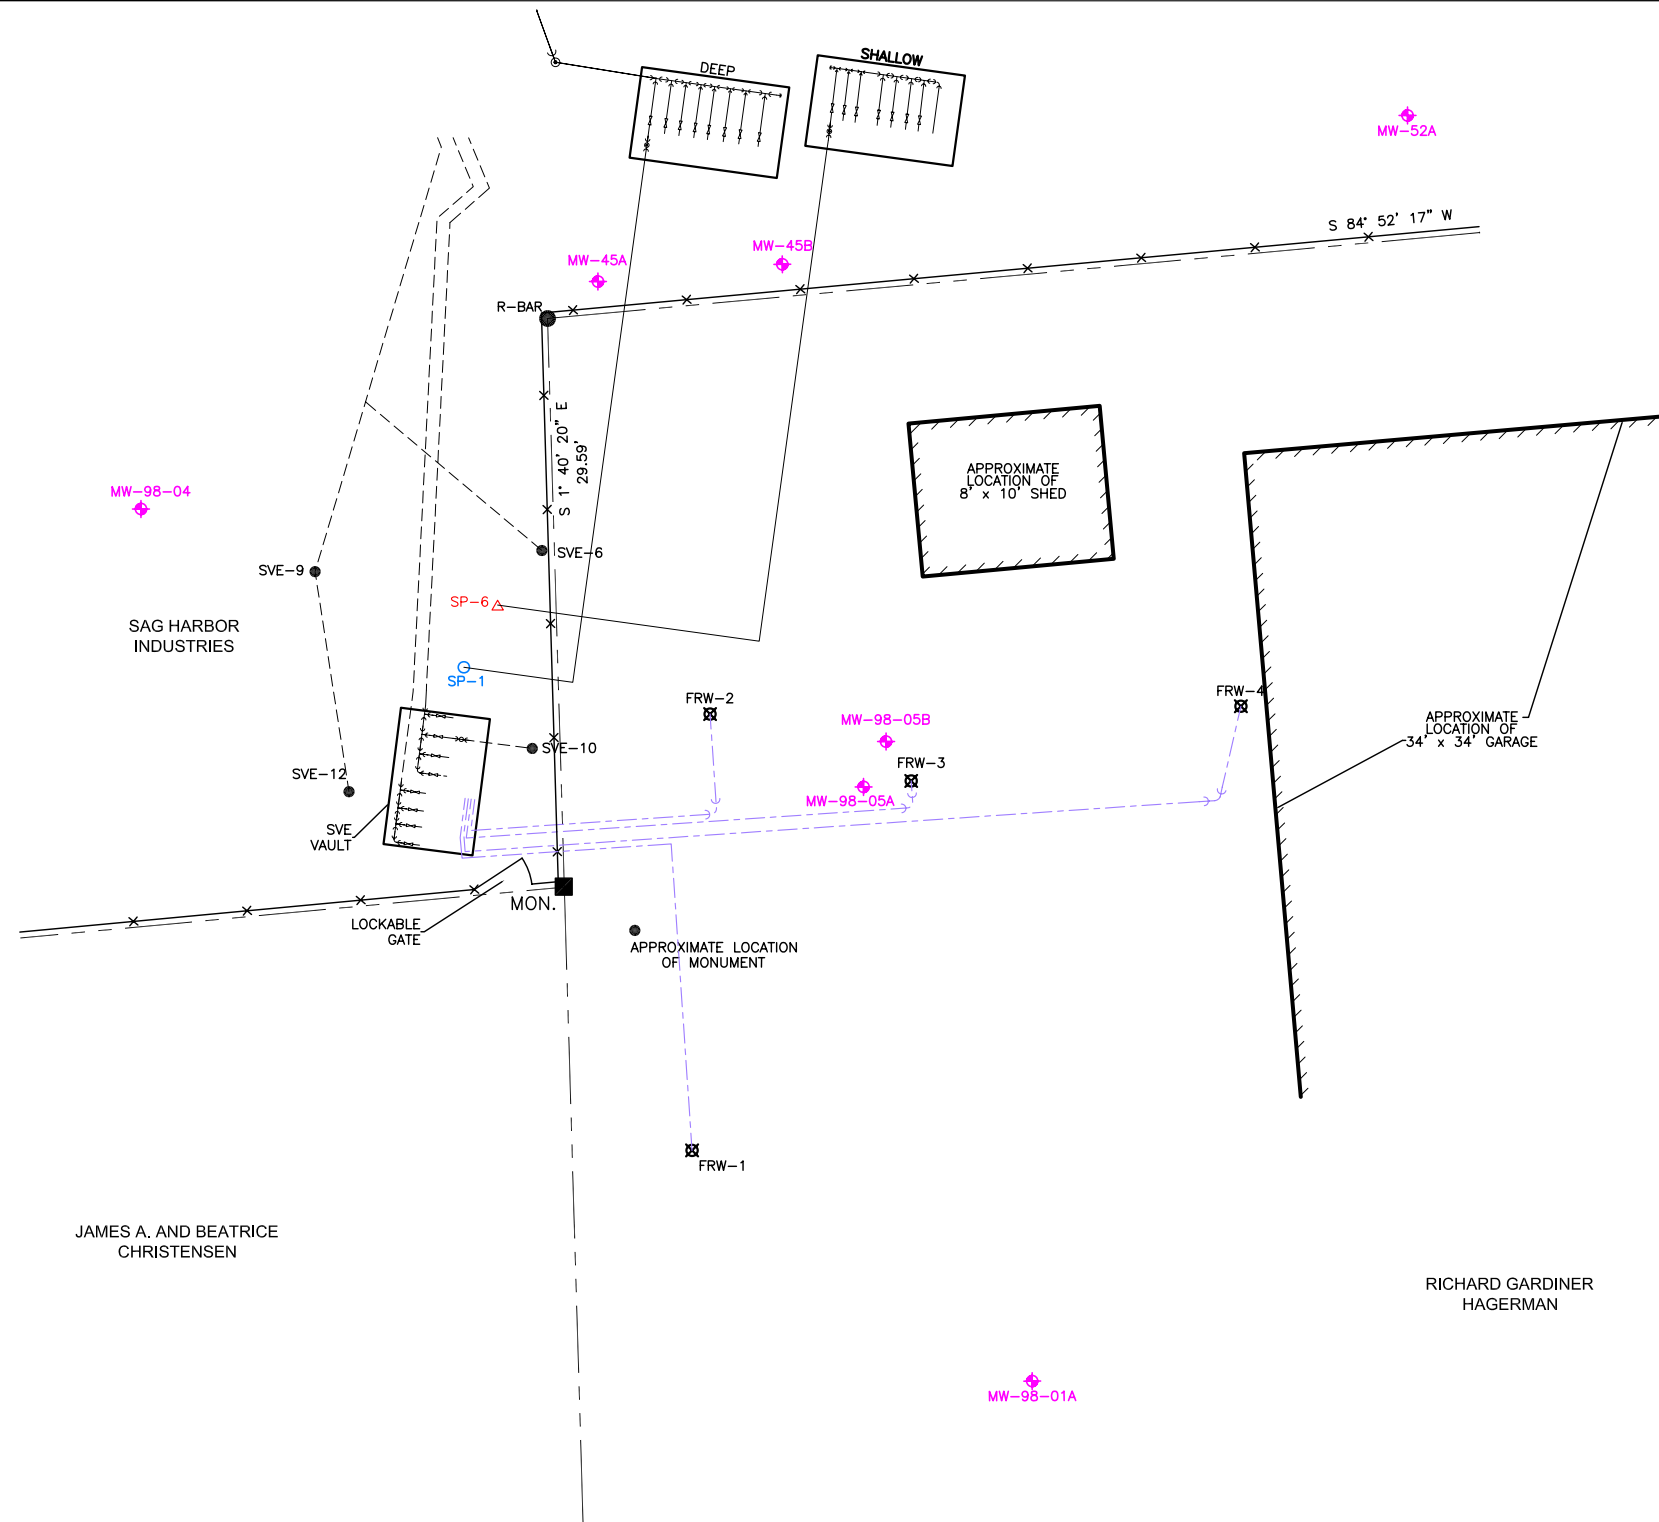

- LEGEND**
- PROPERTY BOUNDARY
 - CHAIN LINK FENCE
 - APPROXIMATE LOCATION OF BELOW GRADE SVE PIPING
 - APPROXIMATE LOCATION OF BELOW GRADE AIR SPARGE PIPING
 - APPROXIMATE LOCATION OF FOCUSED REMEDIATION GROUND-WATER RECOVERY PIPING
 - MONITOR WELL LOCATION
 - SHALLOW AIR SPARGE WELL LOCATION
 - DEEP AIR SPARGE WELL LOCATION
 - SVE WELL LOCATION
 - FOCUSED REMEDIATION RECOVERY WELL LOCATION

0 10
SCALE IN FEET

GROUND-WATER REMEDIATION DESIGN
FORMER ROWE INDUSTRIES SITE
SAG HARBOR, NEW YORK

FORMER DRUM STORAGE AREA SITE MAP

DATE	REVISED	PREPARED BY: LBG ENGINEERING SERVICES, P.C. Professional Environmental and Civil Engineers 4 Research Drive Suite 301 Shelton, Connecticut 06484 (203) 929-8555		
				
DRAWN:	RAC	CHECKED:	MG	DATE: 02/13/08
				FIGURE: 1

APPENDIX I

1ST QUARTER 2008 LABORATORY ANALYTICAL REPORTS



NYSDOH	11418
NJDEP	NY050
CTDOH	PH-0205
PADEP	68-00573

Tuesday, February 12, 2008

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555

FAX (203) 926-9140

RE: Rowe

Order No.: 0802099

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 4 sample(s) on 2/7/2008 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,


Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 12-Feb-08

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe
Lab Order: 0802099

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0802099-01A	020508:1015RW-1		2/5/2008 10:15:00 AM	2/7/2008
0802099-02A	020508:1020RW-2		2/5/2008 10:20:00 AM	2/7/2008
0802099-03A	020508:1025RW-3		2/5/2008 10:25:00 AM	2/7/2008
0802099-04A	020508:1030RW-4		2/5/2008 10:30:00 AM	2/7/2008

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100

FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value.
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of the method allowable holding time.

American Analytical Laboratories, LLC.

Date: 12-Feb-08

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0802099
Project: Rowe
Lab ID: 0802099-01A

Client Sample ID: 020508:1015RW-1
Tag Number:
Collection Date: 2/5/2008 10:15:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113		SW8260B		Analyst: LA		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
1,1,1-Trichloroethane	1.8	1.0		µg/L	1	2/8/2008 9:36:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
2-Butanone	U	3.0		µg/L	1	2/8/2008 9:36:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
2-Hexanone	U	2.0		µg/L	1	2/8/2008 9:36:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
4-Methyl-2-pentanone	U	2.0		µg/L	1	2/8/2008 9:36:00 PM
Acetone	U	2.0		µg/L	1	2/8/2008 9:36:00 PM
Benzene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Bromobenzene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Bromochloromethane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Bromodichloromethane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Bromoform	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Bromomethane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Carbon disulfide	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Chlorobenzene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 12-Feb-08

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0802099
Project: Rowe
Lab ID: 0802099-01A

Client Sample ID: 020508:1015RW-1
Tag Number:
Collection Date: 2/5/2008 10:15:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113		SW8260B		Analyst: LA		
Chloroethane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Chloroform	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Chloromethane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
cis-1,2-Dichloroethene	15	1.0		µg/L	1	2/8/2008 9:36:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Dibromochloromethane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Dibromomethane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Ethylbenzene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Isopropylbenzene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
m,p-Xylene	U	2.0		µg/L	1	2/8/2008 9:36:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Methylene chloride	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Naphthalene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
n-Butylbenzene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
n-Propylbenzene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
o-Xylene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Styrene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Tetrachloroethene	160	1.0		µg/L	1	2/8/2008 9:36:00 PM
Toluene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Trichloroethene	25	1.0		µg/L	1	2/8/2008 9:36:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Vinyl acetate	U	1.0		µg/L	1	2/8/2008 9:36:00 PM
Vinyl chloride	4.8	1.0		µg/L	1	2/8/2008 9:36:00 PM
Surr: 4-Bromofluorobenzene	117	54-134		%REC	1	2/8/2008 9:36:00 PM
Surr: Dibromofluoromethane	96.1	52-132		%REC	1	2/8/2008 9:36:00 PM
Surr: Toluene-d8	108	51-127		%REC	1	2/8/2008 9:36:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 12-Feb-08

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0802099
Project: Rowe
Lab ID: 0802099-02A

Client Sample ID: 020508:1020RW-2
Tag Number:
Collection Date: 2/5/2008 10:20:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113		SW8260B		Analyst: LA		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
2-Butanone	U	3.0		µg/L	1	2/8/2008 10:15:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
2-Hexanone	U	2.0		µg/L	1	2/8/2008 10:15:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
4-Methyl-2-pentanone	U	2.0		µg/L	1	2/8/2008 10:15:00 PM
Acetone	U	2.0		µg/L	1	2/8/2008 10:15:00 PM
Benzene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Bromobenzene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Bromochloromethane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Bromodichloromethane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Bromoform	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Bromomethane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Carbon disulfide	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Chlorobenzene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 12-Feb-08

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0802099
Project: Rowe
Lab ID: 0802099-02A

Client Sample ID: 020508:1020RW-2
Tag Number:
Collection Date: 2/5/2008 10:20:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113		SW8260B		Analyst: LA		
Chloroethane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Chloroform	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Chloromethane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
cis-1,2-Dichloroethene	44	1.0		µg/L	1	2/8/2008 10:15:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Dibromochloromethane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Dibromomethane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Ethylbenzene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Isopropylbenzene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
m,p-Xylene	U	2.0		µg/L	1	2/8/2008 10:15:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Methylene chloride	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Naphthalene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
n-Butylbenzene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
n-Propylbenzene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
o-Xylene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Styrene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Tetrachloroethene	22	1.0		µg/L	1	2/8/2008 10:15:00 PM
Toluene	8.1	1.0		µg/L	1	2/8/2008 10:15:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Trichloroethene	12	1.0		µg/L	1	2/8/2008 10:15:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Vinyl acetate	U	1.0		µg/L	1	2/8/2008 10:15:00 PM
Vinyl chloride	34	1.0		µg/L	1	2/8/2008 10:15:00 PM
Surr: 4-Bromofluorobenzene	110	54-134		%REC	1	2/8/2008 10:15:00 PM
Surr: Dibromofluoromethane	103	52-132		%REC	1	2/8/2008 10:15:00 PM
Surr: Toluene-d8	107	51-127		%REC	1	2/8/2008 10:15:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 12-Feb-08

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0802099
Project: Rowe
Lab ID: 0802099-03A

Client Sample ID: 020508:1025RW-3
Tag Number:
Collection Date: 2/5/2008 10:25:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113		SW8260B		Analyst: LA		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
2-Butanone	U	3.0		µg/L	1	2/8/2008 10:54:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
2-Hexanone	U	2.0		µg/L	1	2/8/2008 10:54:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
4-Methyl-2-pentanone	U	2.0		µg/L	1	2/8/2008 10:54:00 PM
Acetone	U	2.0		µg/L	1	2/8/2008 10:54:00 PM
Benzene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Bromobenzene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Bromochloromethane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Bromodichloromethane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Bromoform	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Bromomethane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Carbon disulfide	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Chlorobenzene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 12-Feb-08

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0802099
Project: Rowe
Lab ID: 0802099-03A

Client Sample ID: 020508:1025RW-3
Tag Number:
Collection Date: 2/5/2008 10:25:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113		SW8260B		Analyst: LA		
Chloroethane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Chloroform	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Chloromethane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
cis-1,2-Dichloroethene	30	1.0		µg/L	1	2/8/2008 10:54:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Dibromochloromethane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Dibromomethane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Ethylbenzene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Isopropylbenzene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
m,p-Xylene	U	2.0		µg/L	1	2/8/2008 10:54:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Methylene chloride	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Naphthalene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
n-Butylbenzene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
n-Propylbenzene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
o-Xylene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Styrene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Tetrachloroethene	6.6	1.0		µg/L	1	2/8/2008 10:54:00 PM
Toluene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Trichloroethene	130	1.0		µg/L	1	2/8/2008 10:54:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Vinyl acetate	U	1.0		µg/L	1	2/8/2008 10:54:00 PM
Vinyl chloride	11	1.0		µg/L	1	2/8/2008 10:54:00 PM
Surr: 4-Bromofluorobenzene	118	54-134		%REC	1	2/8/2008 10:54:00 PM
Surr: Dibromofluoromethane	92.1	52-132		%REC	1	2/8/2008 10:54:00 PM
Surr: Toluene-d8	111	51-127		%REC	1	2/8/2008 10:54:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 12-Feb-08

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0802099
Project: Rowe
Lab ID: 0802099-04A

Client Sample ID: 020508:1030RW-4
Tag Number:
Collection Date: 2/5/2008 10:30:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113		SW8260B		Analyst: LA		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
2-Butanone	U	3.0		µg/L	1	2/8/2008 11:39:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
2-Hexanone	U	2.0		µg/L	1	2/8/2008 11:39:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
4-Methyl-2-pentanone	U	2.0		µg/L	1	2/8/2008 11:39:00 PM
Acetone	U	2.0		µg/L	1	2/8/2008 11:39:00 PM
Benzene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Bromobenzene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Bromochloromethane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Bromodichloromethane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Bromoform	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Bromomethane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Carbon disulfide	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Chlorobenzene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 12-Feb-08

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0802099
Project: Rowe
Lab ID: 0802099-04A

Client Sample ID: 020508:1030RW-4
Tag Number:
Collection Date: 2/5/2008 10:30:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113		SW8260B		Analyst: LA		
Chloroethane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Chloroform	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Chloromethane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Dibromochloromethane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Dibromomethane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Ethylbenzene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Isopropylbenzene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
m,p-Xylene	U	2.0		µg/L	1	2/8/2008 11:39:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Methylene chloride	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Naphthalene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
n-Butylbenzene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
n-Propylbenzene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
o-Xylene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Styrene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Tetrachloroethene	13	1.0		µg/L	1	2/8/2008 11:39:00 PM
Toluene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Trichloroethene	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Vinyl acetate	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Vinyl chloride	U	1.0		µg/L	1	2/8/2008 11:39:00 PM
Surr: 4-Bromofluorobenzene	119	54-134		%REC	1	2/8/2008 11:39:00 PM
Surr: Dibromofluoromethane	93.1	52-132		%REC	1	2/8/2008 11:39:00 PM
Surr: Toluene-d8	104	51-127		%REC	1	2/8/2008 11:39:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

Friday, March 14, 2008

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484
TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe

Order No.: 0803133

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 4 sample(s) on 3/12/2008 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

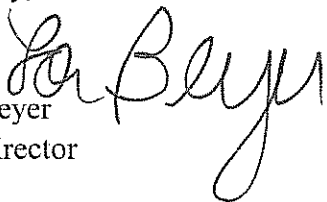
Lori Beyer
Lab Director

American Analytical Laboratories, LLC.**Date:** 14-Mar-08**CLIENT:** Leggette Brashears & Graham Inc.**Project:** Rowe**Lab Order:** 0803133**Work Order Sample Summary**

Lab Sample ID	Client Sample ID	Tag Number	Date Collected	Date Received
0803133-01A	031008:1040RW1		3/10/2008 10:40:00 AM	3/12/2008
0803133-02A	031008:1045RW2		3/10/2008 10:45:00 AM	3/12/2008
0803133-03A	031008:1050RW3		3/10/2008 10:50:00 AM	3/12/2008
0803133-04A	031008:1055RW4		3/10/2008 10:55:00 AM	3/12/2008

TAG # / COC _____

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value.
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of the method allowable holding time.

American Analytical Laboratories, LLC.

Date: 14-Mar-08

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0803133
Project: Rowe
Lab ID: 0803133-01A

Client Sample ID: 031008:1040RW1
Tag Number:
Collection Date: 3/10/2008 10:40:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
1,1,1-Trichloroethane	13	1.0		µg/L	1	3/13/2008 2:05:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
1,1-Dichloroethane	5.1	1.0		µg/L	1	3/13/2008 2:05:00 PM
1,1-Dichloroethene	10	1.0		µg/L	1	3/13/2008 2:05:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
2-Butanone	U	3.0		µg/L	1	3/13/2008 2:05:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
2-Hexanone	U	2.0		µg/L	1	3/13/2008 2:05:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
4-Methyl-2-pentanone	U	2.0		µg/L	1	3/13/2008 2:05:00 PM
Acetone	U	2.0		µg/L	1	3/13/2008 2:05:00 PM
Benzene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Bromobenzene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Bromochloromethane	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Bromodichloromethane	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Bromoform	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Bromomethane	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Carbon disulfide	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Chlorobenzene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 14-Mar-08

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0803133
Project: Rowe
Lab ID: 0803133-01A

Client Sample ID: 031008:1040RW1
Tag Number:
Collection Date: 3/10/2008 10:40:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113		SW8260B		Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Chloroform	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Chloromethane	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
cis-1,2-Dichloroethene	43	1.0		µg/L	1	3/13/2008 2:05:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Dibromochloromethane	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Dibromomethane	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Ethylbenzene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Isopropylbenzene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
m,p-Xylene	U	2.0		µg/L	1	3/13/2008 2:05:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Methylene chloride	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Naphthalene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
n-Butylbenzene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
n-Propylbenzene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
o-Xylene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Styrene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Tetrachloroethene	600	1.0		µg/L	1	3/13/2008 2:05:00 PM
Toluene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
trans-1,2-Dichloroethene	2.4	1.0		µg/L	1	3/13/2008 2:05:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Trichloroethene	110	1.0		µg/L	1	3/13/2008 2:05:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Vinyl acetate	U	1.0		µg/L	1	3/13/2008 2:05:00 PM
Vinyl chloride	68	1.0		µg/L	1	3/13/2008 2:05:00 PM
Surr: 4-Bromofluorobenzene	96.3	54-134		%REC	1	3/13/2008 2:05:00 PM
Surr: Dibromofluoromethane	105	52-132		%REC	1	3/13/2008 2:05:00 PM
Surr: Toluene-d8	104	51-127		%REC	1	3/13/2008 2:05:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 14-Mar-08

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0803133
Project: Rowe
Lab ID: 0803133-02A

Client Sample ID: 031008:1045RW2
Tag Number:
Collection Date: 3/10/2008 10:45:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
2-Butanone	U	3.0		µg/L	1	3/13/2008 2:29:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
2-Hexanone	U	2.0		µg/L	1	3/13/2008 2:29:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
4-Methyl-2-pentanone	U	2.0		µg/L	1	3/13/2008 2:29:00 PM
Acetone	U	2.0		µg/L	1	3/13/2008 2:29:00 PM
Benzene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Bromobenzene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Bromochloromethane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Bromodichloromethane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Bromoform	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Bromomethane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Carbon disulfide	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Chlorobenzene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 14-Mar-08

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0803133
Project: Rowe
Lab ID: 0803133-02A

Client Sample ID: 031008:1045RW2
Tag Number:
Collection Date: 3/10/2008 10:45:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113		SW8260B		Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Chloroform	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Chloromethane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
cis-1,2-Dichloroethene	73	1.0		µg/L	1	3/13/2008 2:29:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Dibromochloromethane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Dibromomethane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Ethylbenzene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Isopropylbenzene	1.5	1.0		µg/L	1	3/13/2008 2:29:00 PM
m,p-Xylene	U	2.0		µg/L	1	3/13/2008 2:29:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Methylene chloride	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Naphthalene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
n-Butylbenzene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
n-Propylbenzene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
o-Xylene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Styrene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Tetrachloroethene	27	1.0		µg/L	1	3/13/2008 2:29:00 PM
Toluene	1.1	1.0		µg/L	1	3/13/2008 2:29:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Trichloroethene	10	1.0		µg/L	1	3/13/2008 2:29:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Vinyl acetate	U	1.0		µg/L	1	3/13/2008 2:29:00 PM
Vinyl chloride	2.0	1.0		µg/L	1	3/13/2008 2:29:00 PM
Surr: 4-Bromofluorobenzene	100	54-134		%REC	1	3/13/2008 2:29:00 PM
Surr: Dibromofluoromethane	111	52-132		%REC	1	3/13/2008 2:29:00 PM
Surr: Toluene-d8	92.1	51-127		%REC	1	3/13/2008 2:29:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 14-Mar-08

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0803133
Project: Rowe
Lab ID: 0803133-03A

Client Sample ID: 031008:1050RW3
Tag Number:
Collection Date: 3/10/2008 10:50:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
1,1,1-Trichloroethane	1.3	1.0		µg/L	1	3/13/2008 2:55:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
1,1-Dichloroethane	1.1	1.0		µg/L	1	3/13/2008 2:55:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
2-Butanone	U	3.0		µg/L	1	3/13/2008 2:55:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
2-Hexanone	U	2.0		µg/L	1	3/13/2008 2:55:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
4-Methyl-2-pentanone	U	2.0		µg/L	1	3/13/2008 2:55:00 PM
Acetone	U	2.0		µg/L	1	3/13/2008 2:55:00 PM
Benzene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Bromobenzene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Bromochloromethane	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Bromodichloromethane	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Bromoform	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Bromomethane	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Carbon disulfide	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Chlorobenzene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 14-Mar-08

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0803133
Project: Rowe
Lab ID: 0803133-03A

Client Sample ID: 031008:1050RW3
Tag Number:
Collection Date: 3/10/2008 10:50:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113		SW8260B		Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Chloroform	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Chloromethane	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
cis-1,2-Dichloroethene	160	1.0		µg/L	1	3/13/2008 2:55:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Dibromochloromethane	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Dibromomethane	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Ethylbenzene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Isopropylbenzene	0.91	1.0		µg/L	1	3/13/2008 2:55:00 PM
m,p-Xylene	U	2.0		µg/L	1	3/13/2008 2:55:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Methylene chloride	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Naphthalene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
n-Butylbenzene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
n-Propylbenzene	0.53	1.0		µg/L	1	3/13/2008 2:55:00 PM
o-Xylene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Styrene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Tetrachloroethene	62	1.0		µg/L	1	3/13/2008 2:55:00 PM
Toluene	1.4	1.0		µg/L	1	3/13/2008 2:55:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Trichloroethene	23	1.0		µg/L	1	3/13/2008 2:55:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Vinyl acetate	U	1.0		µg/L	1	3/13/2008 2:55:00 PM
Vinyl chloride	11	1.0		µg/L	1	3/13/2008 2:55:00 PM
Surr: 4-Bromofluorobenzene	103	54-134		%REC	1	3/13/2008 2:55:00 PM
Surr: Dibromofluoromethane	108	52-132		%REC	1	3/13/2008 2:55:00 PM
Surr: Toluene-d8	97.2	51-127		%REC	1	3/13/2008 2:55:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 14-Mar-08

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0803133
Project: Rowe
Lab ID: 0803133-04A

Client Sample ID: 031008:1055RW4
Tag Number:
Collection Date: 3/10/2008 10:55:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113		SW8260B		Analyst: LDS		
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
2-Butanone	U	3.0		µg/L	1	3/13/2008 3:21:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
2-Hexanone	U	2.0		µg/L	1	3/13/2008 3:21:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
4-Methyl-2-pentanone	U	2.0		µg/L	1	3/13/2008 3:21:00 PM
Acetone	U	2.0		µg/L	1	3/13/2008 3:21:00 PM
Benzene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Bromobenzene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Bromochloromethane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Bromodichloromethane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Bromoform	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Bromomethane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Carbon disulfide	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Chlorobenzene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detecte	X	Value exceeds Maximum Contaminant Level

American Analytical Laboratories, LLC.

Date: 14-Mar-08

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0803133
Project: Rowe
Lab ID: 0803133-04A

Client Sample ID: 031008:1055RW4
Tag Number:
Collection Date: 3/10/2008 10:55:00 AM
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113		SW8260B		Analyst: LDS		
Chloroethane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Chloroform	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Chloromethane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Dibromochloromethane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Dibromomethane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Ethylbenzene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Isopropylbenzene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
m,p-Xylene	U	2.0		µg/L	1	3/13/2008 3:21:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Methylene chloride	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Naphthalene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
n-Butylbenzene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
n-Propylbenzene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
o-Xylene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Styrene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Tetrachloroethene	2.3	1.0		µg/L	1	3/13/2008 3:21:00 PM
Toluene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Trichloroethene	0.99	1.0	J	µg/L	1	3/13/2008 3:21:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Vinyl acetate	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Vinyl chloride	U	1.0		µg/L	1	3/13/2008 3:21:00 PM
Surr: 4-Bromofluorobenzene	109	54-134		%REC	1	3/13/2008 3:21:00 PM
Surr: Dibromofluoromethane	107	52-132		%REC	1	3/13/2008 3:21:00 PM
Surr: Toluene-d8	96.3	51-127		%REC	1	3/13/2008 3:21:00 PM

Qualifiers:	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation limits
	ND	Not Detected at the Reporting Limit	S	Spike Recovery outside accepted recovery limits
	U	Indicates the compound was analyzed for but not detected	X	Value exceeds Maximum Contaminant Level