

-DRAFT-

PROJECT STATUS MEMORANDUM

NO. 08-08

TO: Pamela Tames, USEPA

FROM: Mark M. Goldberg, P.E.
Tunde H. Komuves-Sandor

DATE: October 10, 2008

PROJECT: Rowe Industries Superfund Site
Ground-Water Recovery and Treatment System
August 2008 Status Report
Sag Harbor, New York

LBG Engineering Services, P.C. (LBG) commenced operation of the ground-water remediation system at the above-referenced site on December 17, 2002. This status report presents a summary of system performance, operation and maintenance, and monitoring activities for the site from August 1, 2008 through August 31, 2008. The report includes a summary of system performance parameters, system operation parameters, and analytical results for ground water, system effluent samples, and air quality results.

SUMMARY OF SYSTEM PERFORMANCE AND OPERATION

(August 1, 2008 through August 31, 2008)

- | | |
|---|----------------------------------|
| 1. Hours of operation during the reporting period: | 504 hours (68 %) |
| 2. Alarm conditions during the reporting period: | See Table 1 |
| 3. Was the SPDES VOC discharge permit criteria achieved: | yes, (Table 2) |
| 4. Total volume of water pumped during the reporting period: | 11,553,663 gal. |
| 5. Was the system effluent flow below the SPDES limit of 1,023,000 gpd: yes, (Graph 1) | |
| 6. Mass of VOCs recovered during the reporting period: | 0.4 pounds |
| 7. Cumulative mass of VOCs recovered since startup on 12/17/02:
(calculations can be provided upon request) | 211.8 pounds |
| 8. Effluent VOC vapor concentration for the reporting period: | 0.05 mg/m ³ (Table 3) |
| 9. Was the effluent VOC vapor emission rate below 0.022 lbs/hr.:
(calculations can be provided upon request) | yes (0.00052 lbs/hr) |

GROUND-WATER RECOVERY SYSTEM STATUS SUMMARY

The following table summarizes select recovery well parameters for the reporting period. Table 4 presents a summary of the quality results for water samples collected from recovery wells. Graph 2 presents PCE concentrations for each recovery well. For wells with water quality that meets or is approaching remedial criteria, Graph 3 presents PCE concentrations at an expanded scale in order to compare them to the PCE aquifer restoration concentration of 5 ug/L. Laboratory analytical reports are included as Appendix I.

Well	Volume pumped ² (gal)	Average Flow (gpm)	Lowest Measured Flow (gpm) ¹	Total VOC Concentration (µg/L)	VOC Recovery (lbs)
RW-2	815,429	27	13	3.8	0.03
RW-3	858,465	28	10	4.8	0.03
RW-4	1,210,881	40	10	8.2	0.08
RW-5	1,309,124	50	50	0	0
RW-6	455,167	15	15	25	0.09
RW-7	2,118,626	70	69	12.5	0.22
RW-8	1,510,594	50	41	0	0
RW-9	2,420,783	80	16	0	0

¹Lowest measured flows are based on the lowest average 24 - hour pumping rates for each well recorded to date.

² The RW and system influent flow meters were not functioning properly for part of the month so the total volume pumped was calculated using the average flow and the hours of operation.

Based on the results of the updated ground-water model for the site, the plume is not migrating beyond the influence of the full scale pump and treat (FSP&T) system if the recovery well pumps operate at or above the “Lowest Measured Flows”. All wells were at or above their lowest measured flow when they were operating.

BAG FILTER STATUS

The following table presents an operational summary of the bag filter usage and configuration for the reporting period.

Dates	Bank 1	Bank 2	Bank 3
August 1 to 31	7 of 8 housings used with 400 micron bag filters	7 of 8 housings used with 400 micron bag filters	Not active

No modifications were made to the filter bank configuration or operation during this reporting period.

OTHER O&M ACTIVITIES AND FUTURE O&M ACTIVITIES

Other O&M activities conducted in August 2008 include:

- On August 12, 2008, the system control program was reinstalled due to a program malfunction; and annual potable water backflow preventer testing was completed.

Future O&M activities scheduled for the fall of 2008 include:

- conduct semi-annual monitor well sampling and measure ground-water elevations during pumping and static conditions;
- connect the water discharge line of the Focus Pump and Treat (FP&T) recovery system to the FSP&T system;
- recharge basin maintenance; and
- vapor-phase carbon change out.

MMG:nv

Attachments

cc: Jeff Srulovitz - Kraft Foods Global, Inc. - .pdf
Lisa Krogman, Environ – .pdf
Angela DeDolph, Environ – .pdf
Jeff Trad, NYSDEC – .pdf
Chief-Operation Maintenance and Support Section, NYSDEC – .pdf
William Spitz, RWM, R-1, NYSDEC
Garrett W. Swensen Jr., Esq., Town of Southampton

TABLES

TABLE 1
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

MAINTENANCE LOG
(August 1, 2008 through August 31, 2008)

Date	Time	System Changes/Modifications	Personnel
8/2/2008	2:23 PM	RW-5 shut down due to a low flow alarm.	
8/4/2008	12:15 PM	Reset, reboot computer, restart treatment system with the exception of RW-5. RW-5 remains off due to a faulty flow meter. The RW-5 flow meter shall be investigated.	JF
8/5/2008		Changed multi-bag filter bags (400 mm) in Banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	SH
	10:08 AM	Troubleshoot RW-5 and determined it was a malfunctioning transmitter. The RW-5 transmitter was replaced and RW-5 was restarted.	SH
	10:50 AM	RW-4 flow meter not operating properly. After troubleshooting, the reed switch and transmitter were identified to need replacement. Following replacement of these flow meter components, RW-4 was restarted.	SH
	12:00 PM	Turned treatment system off due to a leaking clean out port, tightened cap of cleanout port and restarted system.	SH
8/6/2008	7:14 AM	System shutdown due to a Booster Blower fault.	
	2:35 PM	Reset Booster Blower motor starter, cleared alarm and restarted the system.	JF
8/7/2008	9:26 AM	System shutdown, no alarms recorded, shutdown most likely due to a computer malfunction. This issue will be investigated.	
8/12/2008		Changed multi-bag filter bags (400 mm) in Banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	SH
	11:06 AM	Investigation of computer malfunction determined the system program needed to be reloaded. The computer was rebooted, the program was reloaded and the system setpoints were checked and adjusted, as needed. Following these actions, the system was restarted. The cause of the problem will be evaluated.	SH
		The annual testing of the potable water backflow preventer was completed.	SH, GF Schiavoni representative
8/19/2008		Changed multi-bag filter bags (400 mm) in Banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	SH
8/26/2008		Changed multi-bag filter bags (400 mm) in Banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	SH
8/27/2008	9:26 AM	System shutdown due to a Communication Failure	

TABLE 2

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

EFFLUENT WATER QUALITY RESULTS

Date Sampled ^{2/}	pH ^{1/}	TDS (mg/l)	PCE (ug/l)	1,1,1-TCA (ug/l)	TCE (ug/l)	1,1-DCA (ug/l)	1,1-DCE (ug/l)	1,2-DCE (ug/l)	Xylene (ug/l)	Bromoform (ug/l)	Dibromo- chloromethane (ug/l)	Methylene Chloride (ug/l)	Freon 113 (ug/l)	Acetone (ug/l)	Chloroform (ug/l)	Alkalinity (mg/L)	Sulfite (mg/L)	MTBE (ug/l)	Total Iron (mg/l)	Dissolved Iron (mg/l)
SPDES Limits	5.0 to 8.5	---	5	5	5	5	5	5	5	---	---	5	---	50	7	NE	NE	---	---	---
5-Aug-08	5.40	113	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0			ND<1.0	2.46	0.180
12-Aug-08	5.50	113	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0			ND<1.0	1.42	0.131
19-Aug-08	5.50	44	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0			ND<1.0	1.33	0.175
26-Aug-08	5.53	124	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0			ND<1.0	1.57	0.168

SPDES: State Pollutant Discharge Elimination System

mg/l: Milligrams per liter

ug/l: Micrograms per liter

---: Not established

J: Analyte detected below quantitation limits

NM: Not Measured

TDS: Total dissolved solids

PCE: Tetrachloroethylene

TCE: Trichloroethylene

1,1-DCA: 1,1-Dichloroethane

1,1-DCE: 1,1-Dichloroethene

1,2-DCE: 1,2-Dichloroethene

MTBE: Methyl tert-butyl ether

Notes:

1. Based on the new SPDES criteria from an NYSDDEC letter dated on May 11, 2006, the new allowable pH range for the Rowe Site is between 5.0 and 8.5.

The pH was measured with a new calibrated electronic pH meter. Influent pH values from recovery wells typically range between 5 and 6.

2. "Effluent" samples were collected from sample port labeled NP2-10 unless otherwise noted.

TABLE 3

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

CARBON UNIT SYSTEM AIR QUALITY RESULTS

Precarbon			Parameters (mg/m3)																				TOTAL VOCs			
Sample Name	Date	Time	PCE	TCE	TCA	DCE	DCA	cis-DCE	Toluene	Benzene	m&p-Xylenes	o-Xylene	Styrene	CF	MC	CM	CD	BM	CB	EB	VC	CE		CT	DCP	
AQ080807:1100NP4-1	8/8/2007	11:00	0.0028 ^B	0.0072	ND	ND	ND	ND	0.0027	0.0029	ND	ND	ND	ND	0.0028 ^B	0.0025	0.021	ND	ND	ND	ND	ND	ND	ND	ND	0.04
AQ091207:1100NP4-1	9/12/2007	11:00	0.370	0.0031	0.027	ND	0.0077	ND	0.11	ND	ND	ND	ND	ND	0.0047	0.002	0.11	ND	ND	ND	ND	ND	ND	ND	ND	0.64
AQ100307:900NP4-1	10/3/2007	9:00	0.200	0.0080	0.005	0.004	0.016	ND	0.0026	0.0012	ND	ND	ND	ND	0.0061	ND	0.0074	ND	ND	ND	0.0015 ^B	ND	ND	ND	ND	0.30
AQ112807:900NP4-1	11/28/2007	9:00	0.110	0.0046	0.034	0.0037	0.013	0.0023	0.0022	0.001	ND	ND	ND	ND	0.0062	0.002	0.0061	ND	ND	ND	ND	ND	ND	ND	ND	0.19
AQ121207:900NP4-1	12/12/2007	9:00	0.090	0.0047	0.040	0.0021	0.015	ND	0.0023	ND	ND	ND	ND	ND	0.0058	0.0011	ND	0.0022	ND	ND	ND	ND	ND	ND	ND	0.16
AQ116087:900NP4-1	1/16/2008	9:00	0.032	ND	0.022	ND	0.0079	ND	ND	ND	ND	ND	ND	ND	0.0025	0.04	0.0013	ND	ND	ND	ND	ND	ND	ND	ND	0.11
AQ021308:1100NP4-1	2/13/2008	11:00	0.063	0.0037	0.025	0.0022	0.012	ND	0.0027	ND	ND	ND	ND	ND	0.0021 ^B	0.0025	0.0034	ND	ND	ND	ND	ND	ND	ND	ND	0.12
AQ032708:1220NP4-1	3/27/2008	12:20	0.069	0.0039	0.042	0.0031	0.018	ND	0.0022	ND	ND	ND	ND	ND	0.0073	0.0032	0.002	ND	ND	ND	ND	ND	ND	ND	ND	0.15
AQ042208:1030NP4-1	4/22/2008	10:30	0.110	0.0055	0.027	0.0024	0.012	0.0023	0.0034	0.0013	ND	ND	ND	ND	0.0052 ^B	0.0031	0.0028	ND	ND	ND	ND	ND	ND	ND	ND	0.18
AQ052708:1700NP4-1	5/27/2008	17:00	0.077	0.0045	0.028	0.0027	0.010	ND	0.0012	ND	ND	ND	ND	ND	0.0030 ^B	0.0034	0.0079	ND	ND	ND	ND	ND	ND	ND	ND	0.14
AQ062508:800NP4-1	6/25/2008	8:00	0.062	0.0041	0.030	0.0022	0.010	ND	0.0038	0.0014	ND	ND	ND	ND	0.0038 ^B	0.002	0.013	ND	ND	ND	ND	ND	ND	ND	ND	0.13
AQ073008:1310NP4-1	7/30/2008	13:00	0.080	0.0055	0.034	0.0022	0.0088	ND	0.0035	0.0014	ND	ND	ND	ND	0.0023 ^B	0.0019	0.011	ND	ND	ND	ND	ND	ND	ND	ND	0.15
AQ081908:1200NP4-1	8/19/2008	12:00	0.055	0.0095	0.052	0.0025	0.012	ND	0.0049	0.00091	ND	ND	ND	ND	0.0036 ^B	0.0028	0.015	ND	ND	ND	ND	ND	ND	ND	ND	0.16

Mid-carbon			Parameters (mg/m3)																			TOTAL VOCs				
Sample Name	Date	Time	PCE	TCE	TCA	DCE	DCA	cis-DCE	Toluene	Benzene	m&p-Xylenes	o-Xylene	Styrene	CF	MC	CM	CD	BM	CB	EB	VC		CE	CT	DCP	
AQ080807:1105NP4-2	8/8/2007	11:05	1.3 ^B	0.120	0.33	0.0053	0.035	0.0068	0.0092	0.0049	0.0028	ND	ND	ND	0.016	0.0026 ^B	0.0018	0.02	ND	ND	ND	ND	ND	0.0028	0.0012	0.56
AQ091207:1105NP4-2	9/12/2007	11:05	1.8	0.051	0.100	0.0040	0.020	ND	0.0029	0.0035	ND	ND	ND	ND	0.0075	0.0042	0.0029	0.025	ND	ND	ND	0.0011	ND	ND	ND	2.05
AQ100307:905NP4-2	10/3/2007	9:05	0.220	0.018	0.054	0.0017	0.015	ND	ND	0.00093	ND	ND	ND	ND	0.0053	0.0014	0.01	0.025	ND	ND	ND	0.0012 ^B	ND	ND	ND	0.33
AQ112807:905NP4-2	11/28/2007	9:05	0.086	0.011	0.072	0.0038	0.015	ND	0.0014	ND	ND	ND	ND	ND	0.0056	0.0019 ^B	ND	0.0051	ND	ND	ND	ND	ND	ND	ND	0.20
AQ121207:905NP4-2	12/12/2007	9:05	0.250	0.025	0.086	0.0023	0.017	ND	0.010	0.00095	ND	ND	ND	ND	0.0064	0.0014	0.0024	0.0024	ND	ND	ND	ND	ND	ND	ND	0.40
AQ116087:905NP4-2	1/16/2008	9:05	0.210	0.007	0.079	ND	0.015	ND	ND	ND	ND	ND	ND	ND	0.0066	ND	0.0032 ^B	ND	ND	ND	ND	ND	ND	ND	ND	0.32
AQ021308:1105NP4-2	2/13/2008	11:05	0.029	0.004	0.066	0.0026	0.017	0.0014	0.002	ND	ND	ND	ND	ND	0.0059	0.0044	0.0035	0.0035	ND	ND	ND	ND	ND	ND	ND	0.14
AQ032708:1225NP4-2	3/27/2008	12:25	0.240	0.007	0.039	0.0032	0.014	ND	0.0033	ND	ND	ND	ND	ND	0.006	0.0034	0.0021	0.0021	ND	ND	ND	ND	ND	ND	ND	0.32
AQ042208:1035NP4-2	4/22/2008	10:35	0.025	0.052	0.040	0.0033	0.015	ND	0.0036	0.0012	0.0042	ND	ND	ND	0.0057	0.0061 ^B	0.0030	0.0047	ND	ND	ND	ND	ND	ND	ND	0.16
AQ052707:1705NP4-2	5/27/2008	17:05	0.044	0.008	0.081	0.0042	0.021	ND	0.0010	ND	ND	ND	ND	ND	0.0098	0.0054 ^B	0.0024	0.0081	ND	ND	ND	ND	ND	ND	ND	0.18
AQ062508:905NP4-2	6/25/2008	8:05	0.420	0.040	0.083	0.0037	0.022	0.0046	0.0046	0.0026	ND	ND	ND	ND	0.0061 ^B	0.0066	0.021	0.0021	ND	ND	ND	ND	ND	ND	ND	0.62
AQ073008:1315NP4-2	7/30/2008	13:05	0.480	0.046	0.130	0.0029	0.014	0.0022	0.0030	0.0018	ND	ND	ND	ND	0.0078	0.0023 ^B	0.015	0.015	ND	ND	ND	ND	0.0022	ND	ND	0.70
AQ081908:1205NP4-2	8/19/2008	12:05	0.260	0.041	0.090	0.0021	0.010	0.0015	0.0028	ND	ND	ND	ND	ND	0.0059	0.0044 ^B	0.0029	0.016	ND	ND	ND	ND	ND	ND	ND	0.43

Postcarbon			Parameters (mg/m3)														TOTAL									
Sample Name	Date	Time	PCE	TCE	TCA	DCE	DCA	cis-DCE	Toluene	Benzene	m&p-Xylenes	o-Xylene	Styrene	CF	MC	CM	CD	BM	CB	EB	VC	CE	CT	DCP	VOCs	
AQ080807:1110NP4-3	8/8/2007	11:10	0.013 ^B	0.0015	0.190	0.0063	0.029	0.011	0.41	0.0018	ND	ND	ND	0.011	0.0047 ^B	0.0037	0.019	ND	ND	ND	ND	ND	ND	ND	ND	0.68
AQ091207:1110NP4-3	9/12/2007	11:10	ND	ND	0.033	ND	0.0061	ND	0.0028	ND	ND	ND	ND	0.0028	0.0013	ND	0.0099	ND	ND	ND	0.00092	ND	ND	ND	ND	0.06
AQ100307:910NP4-3	10/3/2007	9:10	ND	ND	0.044	ND	0.0076	0.0021	0.0033	ND	ND	ND	ND	0.0033	0.0012	ND	0.008	ND	ND	ND	ND	ND	ND	ND	ND	0.07
AQ112807:910NP4-3	11/28/2007	9:10	ND	ND	0.11	0.0030	0.014	0.0022	0.0015	ND	ND	ND	ND	0.0045	0.0018 ^B	ND	0.0061	ND	ND	ND	ND	ND	ND	ND	ND	0.14
AQ121207:910NP4-3	12/12/2007	9:10	ND	ND	0.16	0.0033	0.025	0.003	0.0012	ND	ND	ND	ND	0.007	ND	ND	0.0028	ND	ND	ND	ND	ND	ND	ND	ND	0.20
AQ116087:910NP4-3	1/16/2008	9:10	ND	ND	0.14	0.0025	0.022	ND	0.0032	ND	ND	ND	ND	0.0082	ND	0.0034	ND	ND	ND	ND	0.0011	ND	ND	ND	ND	0.18
AQ021308:1110NP4-3	2/13/2008	11:10	ND	ND	0.12	0.0029	0.018	0.0019	0.0022	ND	ND	ND	ND	0.007	0.0023	0.0025	0.0038	ND	ND	ND	ND	ND	ND	ND	ND	0.16
AQ032708:1230NP4-3	3/27/2008	12:30	ND	ND	0.063	0.0036	0.014	ND	0.0019	ND	ND	ND	ND	0.006	0.0029	0.0026	0.0023	ND	ND	ND	ND	ND	ND	ND	ND	0.10
AQ042208:1040NP4-3	4/22/2008	10:40	ND	ND	0.030	0.0020	0.0073	ND	0.0035	0.00099	ND	ND	ND	0.0034	0.0055 ^B	0.0024	0.0036	ND	ND	ND	ND	ND	ND	ND	ND	0.05
AQ052707:1708NP4-3	5/27/2008	17:08	ND	ND	0.045	0.0039	0.013	0.0014	0.0025	ND	ND	ND	ND	0.0057	0.0088 ^B	0.0027	0.0046	ND	ND	ND	ND	ND	ND	ND	ND	0.08
AQ062508:810NP4-3	6/25/2008	8:10	ND	0.001	0.024	0.0025	0.011	0.0022	0.0034	0.0012	ND	ND	ND	0.0044	0.0064 ^B	0.0069	0.019	ND	ND	ND	ND	ND	ND	ND	ND	0.08
AQ073008:1312NP4-3	7/30/2008	13:20	ND	ND	0.022	0.0027	0.0089	0.0015	0.0070	0.0028	0.0099	0.0031	ND	0.0036	0.0022 ^B	0.0019	0.014	ND	ND	ND	ND	ND	ND	ND	ND	0.08
AQ081908:1210NP4-3	8/19/2008	12:10	ND	ND	0.018	0.0024	0.0084	0.0028	0.0028	ND	ND	ND	ND	0.0033	0.0051 ^B	0.0037	0.016	ND	ND	ND	ND	ND	ND	ND	ND	0.05

PCE - Tetrachloroethane
TCE - Trichloroethane
TCA - 1,1,1-Trichloroethane
CE - Chloroethane
DCE - 1,1-Dichloroethane
DCA - 1,1-Dichloroethane
cis-DCE - cis-1,2-Dichloroethane
CT - Carbon Tetrachloride
DCE - 1,1-Dichloroethane
DCA - 1,1-Dichloroethane
cis-DCE - cis-1,2-Dichloroethane
CT - Carbon Disulfide
CF - Chloroform
MC - Methylene Chloride
CM - Chloromethane
CD - Carbon Disulfide
BM - Bromomethane
CB - Chlorobenzene
EB - Ethylbenzene
VC - Vinyl Chloride
DCP - 1,2-Dichloropropane

Note: B Method blank contamination. The associated method blank contains the target analyte at a reportable level.

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	1,1-Dichloro-ethane (ug/L)	cis-1,2-Dichloro-ethene (ug/L)	1,1-Dichloro-ethene (ug/L)	Methylene Chloride (ug/L)	Toluene (ug/L)	Dibromochloromethane (ug/L)	m,p-Xylene (ug/L)	o-Xylene (ug/L)	Ethylbenzene (ug/L)	Acetone (ug/L)	
	ARAR's	5	5	5	NE	7	NE	300	300	5	5	5	5	NE	NE				NE	
RW-1	15-Sep-04	ND<1	ND<1	ND<1	ND<1	2.8	ND<1	0.0865	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	7-Oct-04	ND<1	ND<1	ND<1	ND<1	ND<1	2.2	0.0332	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	3-Nov-04	ND<1	ND<1	ND<1	ND<1	1.9	2.0	0.0133	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	15-Dec-04	ND<1	ND<1	ND<1	ND<1	9.8	ND<1	0.0475	0.0229	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	13-Jan-05	ND<1	ND<1	ND<1	ND<1	1.5	2.1	0.0703	0.0326	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	8-Feb-05	ND<1	ND<1	ND<1	ND<1	4.6	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	15-Mar-05	ND<1	ND<1	ND<1	ND<1	2.5	ND<1	0.0285	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	19-Apr-05	ND<1	ND<1	ND<1	ND<1	1.5	ND<1	0.0357	0.0217	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	2-May-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	16-Jun-05	ND<1	ND<1	ND<1	ND<1	4.0	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	14-Jul-05	ND<1	ND<1	ND<1	ND<1	2.1	ND<1	0.0289	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	3.3	1.3	1	6.9*	
	7-Mar-06	ND<1	ND<1	ND<1	ND<1	5.2	ND<1	0.1650	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	19-Sep-06	ND<1	ND<1	ND<1	ND<1	1.7	ND<1	NA	NA	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	7-Mar-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	NA	NA	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	3-Oct-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	NA	NA	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	13-Mar-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	NA	NA	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	24-Aug-06	11.0	1.1	25	ND<1	ND<1	ND<1	4.14	0.0172	ND<1	5.7	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	19-Sep-06	2.8	ND<1	200	ND<1	ND<1	ND<1	13.7	0.0184	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	24-Oct-06	5.0	1.6	160	ND<1	ND<1	ND<1	3.6	0.00756	ND<1	3.6	0.91	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
RW-2	29-Nov-06	6.0	1.8	36	ND<1	ND<1	ND<1	14.1	0.0148	ND<1	3	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	20-Dec-06	2.2	ND<1	110	ND<1	ND<1	ND<1	11.8	0.0197	ND<1	2.8	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	10-Jan-07	4.2	2.7	68	ND<1	ND<1	ND<1	2.77	0.458	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	8-Feb-07	3.4	2.4	62	ND<1	ND<1	ND<1	8.72	0.00829	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	7-Mar-07	ND<1	ND<1	31	ND<1	ND<1	ND<1	4.28	0.107	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	18-Apr-07	3	1.7	23	ND<1	ND<1	ND<1	3.81	0.32	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	10-May-07	ND<1	ND<1	26	ND<1	ND<1	ND<1	3.04	0.00589	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	15-Jun-07	1.1	1.2	ND<1	ND<1	ND<1	ND<1	2.7	0.0392	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	18-Jul-07	1.2	0.78	17	ND<1	ND<1	ND<1	2.26	0.198	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	16-Aug-07	0.75	ND<1	10	ND<1	ND<1	ND<1	3.92	0.157	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	12-Sep-07	1.6	ND<1	1.2	ND<1	ND<1	ND<1	1.76	0.232	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	3-Oct-07	1.4	ND<1	1.2	ND<1	ND<1	ND<1	1.9	1.28	ND<1	0.65	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	19-Nov-07	5.6	ND<1	ND<1	ND<1	ND<1	ND<1	2.18	0.0132	ND<1	1.6	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	12-Dec-07	2.2	0.86	8.3	ND<1	ND<1	ND<1	5.55	0.0186	ND<1	0.61	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	16-Jan-08	2	ND<1	5.9	ND<1	ND<1	ND<1	3.09	0.185	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	13-Feb-08	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	10-Mar-08	1.9	ND<1	5.6	ND<1	ND<1	ND<1	2.74	0.0592	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	17-Apr-08	1.6	ND<1	4.1	ND<1	ND<1	ND<1	2.83	0.252	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	27-May-08	1.8	ND<1	2.9	ND<1	ND<1	ND<1	3.00	0.838	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	17-Jun-08	ND<1	ND<1	1.8	ND<1	ND<1	ND<1	2.65	0.143	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	30-Jul-08	1.4	ND<1	1.5	ND<1	ND<1	ND<1	2.47	0.318	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	
	12-Aug-08	2.5	ND<1	1.3	ND<1	ND<1	ND<1	4.40	0.0279	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1	

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	cis-1,2-Dichloro-ethene (ug/L)	1,1-Dichloro-ethane (ug/L)	1,1-Dichloro-ethene (ug/L)	Methylene Chloride (ug/L)	Toluene (ug/L)	Dibromochloromethane (ug/L)	m,p-Xylene (ug/L)	o-Xylene (ug/L)	Ethylbenzene (ug/L)	Acetone (ug/L)
	ARAR's	5	5	5	NE	7	NE	300	300	5	5	5	5	NE	NE				NE
RW-3	24-Aug-06	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	19-Sep-06	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	24-Oct-06	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	29-Nov-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.36	0.053	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	20-Dec-06	6.4	ND<1	4.4	ND<1	ND<1	ND<1	17.3	0.0112	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	10-Jan-07	1.2	8	3.5	ND<1	ND<1	ND<1	1.87	1.63	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.1	ND<1	ND<1	ND<1
	8-Feb-07	ND<1	3.2	ND<1	ND<1	ND<1	ND<1	ND<0.02	2.16	0.954	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	7-Mar-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.09	1.65	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	18-Apr-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.24	0.761	ND<1	ND<1	ND<1	6.1*	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	10-May-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	1.89	1.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	25-Jun-07	0.91	8.5	ND<1	ND<1	ND<1	ND<1	2.48	0.19	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	18-Jul-07	ND<1	2.8	1.2	ND<1	ND<1	ND<1	2.36	0.0414	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	16-Aug-07	ND<1	1.2	0.72	ND<1	ND<1	ND<1	2.95	1.16	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	12-Sep-07	ND<1	1.6	ND<1	ND<1	ND<1	ND<1	2.20	1.49	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	3-Oct-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.46	2.16	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	19-Nov-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.70	0.971	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	12-Dec-07	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	16-Jan-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	3.73	0.229	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	13-Feb-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	1.88	1.09	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	10-Mar-08	ND<1	2.2	0.8	ND<1	ND<1	ND<1	2.23	2.08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	17-Apr-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	4.27	1.94	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	27-May-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.08	1.61	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	17-Jun-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	1.87	1.56	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	30-Jul-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	1.92	1.63	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	22-Aug-08	ND<1	3.7	1.1	ND<1	ND<1	ND<1	2.17	0.152	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
RW-4	24-Aug-06	23	ND<1	ND<1	ND<1	ND<1	ND<1	8.60	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	19-Sep-06	9	ND<1	7.5	ND<1	ND<1	ND<1	5.95	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	24-Oct-06	11	ND<1	5.6	ND<1	ND<1	ND<1	7.17	0.0178	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	29-Nov-06	14	0.9	ND<1	ND<1	ND<1	ND<1	2.82	0.00708	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	20-Dec-06	6.4	ND<1	4.4	ND<1	ND<1	ND<1	17.30	0.0112	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	10-Jan-07	12	ND<1	4.6	ND<1	ND<1	ND<1	3.17	0.0794	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	8-Feb-07	13	ND<1	3.3	ND<1	ND<1	ND<1	3.64	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	7-Mar-07	7.3	ND<1	2.1	ND<1	ND<1	ND<1	3.85	0.0767	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	18-Apr-07	10	ND<1	ND<1	ND<1	ND<1	ND<1	4.46	0.251	ND<1	ND<1	ND<1	7.2*	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	10-May-07	11	ND<1	ND<1	ND<1	ND<1	ND<1	3.67	0.0422	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	20-Jun-07	5.3	ND<1	0.89	ND<1	ND<1	ND<1	3.73	0.048	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	25-Jul-07	6.9	ND<1	3.3	ND<1	ND<1	ND<1	6.58	3.37	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	16-Aug-07	5.8	ND<1	5.0	ND<1	ND<1	ND<1	4.44	0.213	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	12-Sep-07	7	ND<1	6.3	ND<1	ND<1	ND<1	4.02	1.73	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	3-Oct-07	9.4	1.1	10.0	ND<1	ND<1	ND<1	5.04	3.1	0.68	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	19-Nov-07	15	1.3	8.2	ND<1	ND<1	ND<1	3.73	0.0317	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	12-Dec-07	7.7	ND<1	4.6	ND<1	ND<1	ND<1	4.47	2.34	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	16-Jan-08	7.9	ND<1	4.2	ND<1	ND<1	ND<1	4.67	0.954	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	13-Feb-08	2.1	ND<1	ND<1	ND<1	ND<1	ND<1	8.28	0.371	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	10-Mar-08	6.5	0.57	3.0	ND<1	ND<1	ND<1	4.96	1.94	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	17-Apr-08	6.1	ND<1	2.6	ND<1	ND<1	ND<1	5.86	0.96	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	27-May-08	9.9	1.3	ND<1	ND<1	ND<1	ND<1	6.13	4.14	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	17-Jun-08	13	ND<1	ND<1	ND<1	ND<1	ND<1	6.47	3.85	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	30-Jul-08	4.6	ND<1	3.0	ND<1	ND<1	ND<1	5.73	0.215	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	12-Aug-08	4.7	ND<1	3.5	ND<1	ND<1	ND<1	4.89	1.37	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	1,1-Dichloro-ethane (ug/L)	cis-1,2-Dichloro-ethene (ug/L)	1,1-Dichloro-ethene (ug/L)	Methylene Chloride (ug/L)	Toluene (ug/L)	Dibromochloromethane (ug/L)	m,p-Xylene (ug/L)	o-Xylene (ug/L)	Ethylbenzene (ug/L)	Acetone (ug/L)
RW-5	ARAR's	5	5	5	NE	7	NE	300	300	5	5	5	5	NE	NE				NE
	24-Aug-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.09	0.0116	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	19-Sep-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.194	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	24-Oct-06	1.1	ND<1	1.3	ND<1	ND<1	ND<1	0.0683	0.00684	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	29-Nov-06	6	ND<1	1.3	ND<1	ND<1	ND<1	0.136	0.0195	ND<1	ND<1	ND<1	ND<1	0.96	ND<1	ND<2	ND<1	ND<1	ND<1
	20-Dec-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.508	0.0113	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	10-Jan-07	1.2	ND<1	ND<1	ND<1	ND<1	ND<1	0.0608	0.0128	ND<1	ND<1	ND<1	ND<1	2.8	ND<1	12	ND<1	3.9	ND<1
	8-Feb-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.327	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	7-Mar-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.0655	0.00722	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	18-Apr-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.973	0.0106	ND<1	ND<1	ND<1	8.1*	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	10-May-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.0763	0.00469	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	20-Jun-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.118	0.00747	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	18-Jul-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.395	0.0889	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	16-Aug-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.0450	0.008	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	12-Sep-07	ND<1	ND<1	ND<1	ND<1	0.6	ND<1	0.0460	0.008	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	3-Oct-07	ND<1	ND<1	ND<1	ND<1	0.81	ND<1	0.0600	0.350	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	19-Nov-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.1330	0.022	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	12-Dec-07	ND<1	ND<1	0.61	ND<1	0.65	ND<1	0.0368	0.014	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	16-Jan-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.0732	0.0441	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	13-Feb-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.3680	0.0121	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	10-Mar-08	ND<1	ND<1	ND<1	ND<1	0.67	ND<1	0.0491	0.0236	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
RW-6	27-Apr-08	ND<1	ND<1	3.1	ND<1	ND<1	ND<1	0.1090	0.0735	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	17-May-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.0522	0.0113	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	17-Jun-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.0404	0.0259	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	30-Jul-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.267	0.0229	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	12-Aug-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.450	0.0187	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	24-Aug-06	30	ND<1	22	ND<1	ND<1	ND<1	5.36	0.0563	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	19-Sep-06	46	ND<1	27	ND<1	ND<1	ND<1	0.916	0.0078	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	24-Oct-06	45	1.2	15	ND<1	ND<1	ND<1	1.84	0.007	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	29-Nov-06	36	1.0	14	ND<1	ND<1	ND<1	0.399	0.137	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	20-Dec-06	31	ND<1	13	ND<1	ND<1	ND<1	2.43	0.00877	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	10-Jan-07	46	0.96	16	ND<1	ND<1	ND<1	0.0348	ND<0.02	ND<1	ND<1	ND<1	ND<1	2.2	ND<1	11	3.3	3.2	ND<1
	8-Feb-07	42	ND<1	13	ND<1	ND<1	ND<1	0.0928	0.00453	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	7-Mar-07	29	ND<1	8.4	ND<1	ND<1	ND<1	0.153	0.0108	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	18-Apr-07	28	ND<1	8.3	ND<1	ND<1	ND<1	0.554	0.0316	ND<1	ND<1	ND<1	7.2*	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	10-May-07	31	ND<1	7.7	ND<1	ND<1	ND<1	0.206	0.00708	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	20-Jun-07	19	ND<1	6.6	ND<1	ND<1	ND<1	0.127	0.0139	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	18-Jul-07	20	ND<1	6.8	ND<1	ND<1	ND<1	0.595	0.597	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	16-Aug-07	19	ND<1	6.7	ND<1	ND<1	ND<1	0.0610	0.0200	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	12-Sep-07	21	ND<1	7.0	ND<1	ND<1	ND<1	0.1990	0.0330	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	3-Oct-07	14	ND<1	11.0	ND<1	ND<1	ND<1	0.94	0.0860	0.92	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	19-Nov-07	20	ND<1	12.0	ND<1	ND<1	ND<1	0.2620	0.0317	1.1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	12-Dec-07	25	ND<1	7.5	ND<1	ND<1	ND<1	0.0567	0.0282	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	16-Jan-08	22	ND<1	6.9	ND<1	ND<1	ND<1	0.0815	0.0453	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	13-Feb-08	19	ND<1	6.4	ND<1	ND<1	ND<1	0.1710	0.0188	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	10-Mar-08	19	ND<1	6.1	ND<1	ND<1	ND<1	0.1520	0.0282	0.61	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	17-Apr-08	17	ND<1	5.2	ND<1	ND<1	ND<1	1.3200	0.0465	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	27-May-08	17	ND<1	6.5	ND<1	ND<1	ND<1	0.1240	0.0646	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	17-Jun-08	16	ND<1	7.7	ND<1	ND<1	ND<1	0.1090	0.0331	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	30-Jul-08	15	ND<1	8.3	ND<1	ND<1	ND<1	0.1020	0.0320	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	12-Aug-08	16	ND<1	9.0	ND<1	ND<1	ND<1	0.1570	0.0143	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	1,1-Dichloro-ethane (ug/L)	cis-1,2-Dichloro-ethene (ug/L)	1,1-Dichloro-ethene (ug/L)	Methylene Chloride (ug/L)	Toluene (ug/L)	Dibromochloromethane (ug/L)	m,p-Xylene (ug/L)	o-Xylene (ug/L)	Ethylbenzene (ug/L)	Acetone (ug/L)
	ARAR's	5	5	5	NE	7	NE	300	300	5	5	5	5	NE	NE				NE
RW-7	24-Aug-06	39	ND<1	7.9	ND<1	ND<1	ND<1	0.307	0.1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	19-Sep-06	36	ND<1	7.5	ND<1	ND<1	ND<1	0.116	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	24-Oct-06	26	ND<1	3.5	ND<1	ND<1	ND<1	0.0692	0.00846	2.4	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	9-Nov-06	33	ND<1	4.1	ND<1	ND<1	ND<1	0.1910	0.04990	1.0	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	20-Dec-06	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	10-Jan-07	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	8-Feb-07	43	ND<1	4.4	ND<1	ND<1	ND<1	0.131	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	7-Mar-07	23	ND<1	2.7	ND<1	ND<1	ND<1	0.0492	0.0221	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	18-Apr-07	34	ND<1	ND<1	ND<1	ND<1	ND<1	0.138	0.0438	ND<1	ND<1	ND<1	6.5*	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	10-May-07	22	ND<1	2.3	ND<1	ND<1	ND<1	0.111	0.0271	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	20-Jun-07	14	ND<1	1.7	ND<1	ND<1	ND<1	0.136	0.0165	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	18-Jul-07	17	ND<1	2	ND<1	ND<1	ND<1	0.434	0.0548	1.2	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	16-Aug-07	14	ND<1	1.6	ND<1	ND<1	ND<1	0.239	0.0250	1.1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	12-Sep-07	24	ND<1	2	ND<1	ND<1	ND<1	0.17	0.0800	0.68	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	3-Oct-07	25	0.73	2.8	ND<1	ND<1	ND<1	0.194	0.2090	0.95	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	19-Nov-07	11	ND<1	1.1	ND<1	ND<1	ND<1	0.163	0.0259	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	12-Dec-07	12	ND<1	1.4	ND<1	ND<1	ND<1	0.172	0.0538	1.3	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	16-Jan-08	8.4	ND<1	0.73	ND<1	ND<1	ND<1	0.125	0.0499	0.82	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	13-Feb-08	11	ND<1	ND<1	ND<1	ND<1	ND<1	0.0982	0.0381	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	10-Mar-08	11	ND<1	1.1	ND<1	ND<1	ND<1	0.0793	0.0488	0.97	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	17-Apr-08	11	ND<1	ND<1	ND<1	ND<1	ND<1	0.488	0.0711	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	27-May-08	10	ND<1	1.2	ND<1	ND<1	ND<1	0.127	0.0399	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	17-Jun-08	11	ND<1	ND<1	ND<1	ND<1	ND<1	0.0584	0.0302	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	30-Jul-08	10	ND<1	1.2	ND<1	ND<1	ND<1	0.0728	0.0379	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	12-Aug-08	11	ND<1	1.5	ND<1	ND<1	ND<1	0.0287	0.0079	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
RW-8	24-Aug-06	ND<1	ND<1	3.2	ND<1	ND<1	ND<1	5.98	1.860	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	19-Sep-06	ND<1	ND<1	3.0	ND<1	ND<1	ND<1	7.44	0.009	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	24-Oct-06	0.9	ND<1	3.1	ND<1	ND<1	ND<1	8.32	0.0605	2.0	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	29-Nov-06	1.0	ND<1	3.4	ND<1	ND<1	ND<1	3.87	0.0091	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	20-Dec-06	ND<1	ND<1	3.5	ND<1	ND<1	ND<1	62.80	0.0346	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	10-Jan-07	1.3	ND<1	3.5	ND<1	ND<1	ND<1	6.57	0.8100	ND<1	ND<1	ND<1	ND<1	1.9	ND<1	9.3	2.8	2.7	ND<1
	8-Feb-07	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	7-Mar-07	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	18-Apr-07	ND<1	ND<1	2.2	ND<1	ND<1	ND<1	9.13	0.3820	ND<1	ND<1	ND<1	6.7*	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	10-May-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	24.70	0.0129	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	20-Jun-07	ND<1	ND<1	1.7	ND<1	ND<1	ND<1	6.67	0.0341	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	18-Jul-07	ND<1	ND<1	1.5	ND<1	ND<1	ND<1	8.16	0.0505	1.3	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	16-Aug-07	ND<1	ND<1	1.2	ND<1	ND<1	ND<1	26.7	0.4350	1.1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	12-Sep-07	ND<1	ND<1	1.5	ND<1	ND<1	ND<1	8.7	0.3860	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	3-Oct-07	ND<1	ND<1	2.0	ND<1	ND<1	ND<1	7.5	5.43	1.2	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	19-Nov-07	0.6	ND<1	ND<1	ND<1	ND<1	ND<1	11.2	0.0442	1.3	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	12-Dec-07	ND<1	ND<1	1.3	ND<1	ND<1	ND<1	7.87	3.02	1.3	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	16-Jan-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	7.19	1.00	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	13-Feb-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	7.14	0.0771	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	10-Mar-08	ND<1	ND<1	1.2	ND<1	ND<1	ND<1	6.08	1.81	1.0	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	17-Apr-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	10.20	0.08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	27-May-08	1.4	ND<1	1.1	ND<1	ND<1	ND<1	5.26	2.24	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	17-Jun-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	6.73	1.16	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	30-Jul-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	8.44	0.0768	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	12-Aug-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	7.92	0.6310	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	1,1-Dichloro-ethane (ug/L)	cis-1,2-Dichloro-ethene (ug/L)	1,1-Dichloro-ethene (ug/L)	Methylene Chloride (ug/L)	Toluene (ug/L)	Dibromochloromethane (ug/L)	m,p-Xylene (ug/L)	o-Xylene (ug/L)	Ethylbenzene (ug/L)	Acetone (ug/L)
	ARAR's	5	5	5	NE	7	NE	300	300	5	5	5	5	NE	NE				NE
	24-Aug-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.97	0.0165	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	19-Sep-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	5.16	ND<0.02	ND<1	ND<1	ND<1	18*	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	24-Oct-06	ND<1	ND<1	1.5	ND<1	ND<1	ND<1	6.96	0.00719	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	29-Nov-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	3.99	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	20-Dec-06	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	6.54	0.01119	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	10-Jan-07	ND<1	ND<1	1.4	ND<1	ND<1	ND<1	5.08	0.0855	ND<1	ND<1	ND<1	ND<1	1.4	ND<1	7	2	2.1	ND<1
	8-Feb-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.96	0.0076	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	7-Mar-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	8.03	0.399	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	18-Apr-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.77	0.232	ND<1	ND<1	ND<1	6.2*	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	10-May-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.6	0.0356	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	25-Jun-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.888	0.04	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	18-Jul-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.59	0.0227	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	16-Aug-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	4.39	0.0250	ND<1	ND<1	ND<1	13*	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	12-Sep-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	4.33	0.4040	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	3-Oct-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	1.18	0.180	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	19-Nov-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.704	0.065	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	12-Dec-07	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	3.2	1.92	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	16-Jan-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	3.85	1.46	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	13-Feb-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.94	0.176	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	10-Mar-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.01	0.363	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	17-Apr-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	3.99	1.330	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	27-May-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	9.68	0.579	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	1-Jul-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	3.49	0.770	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	30-Jul-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.14	0.152	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1
	12-Aug-08	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	1.57	0.067	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<2	ND<1	ND<1	ND<1

ND: Not detected

<#: Less than method detection limit

ug/L: Micrograms per liter

-: Not analyzed

ARAR's are chemical specific aquifer restoration goals for ground water at the Former Rowe Industries Superfund Site.

Bold values indicate an exceedance of the ARAR standard established for the site

PCE: Tetrachloroethylene

TCE: Trichloroethylene

TCA: 1,1,1-Trichloroethane

1,1-DCA: 1,1-Dichloroethane

MTBE: Methyl Tertiary Butyl Ether

NM: Not Measured

NE indicates that the ARAR goal was not established for this compound by the EPA.

*Concentrations with an asterisk following them are due to laboratory contamination.

^{1/} RW-3 is currently non operational waiting for the reprogramming of the drive for the new 4 amp pump.

^{2/} RW-9 was being rehabilitated during this sampling event, thus no water sample was collected.


GRAPHS

GRAPH 1


GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

EFFLUENT FLOW DATA


(August 1, 2008 through August 31, 2008)

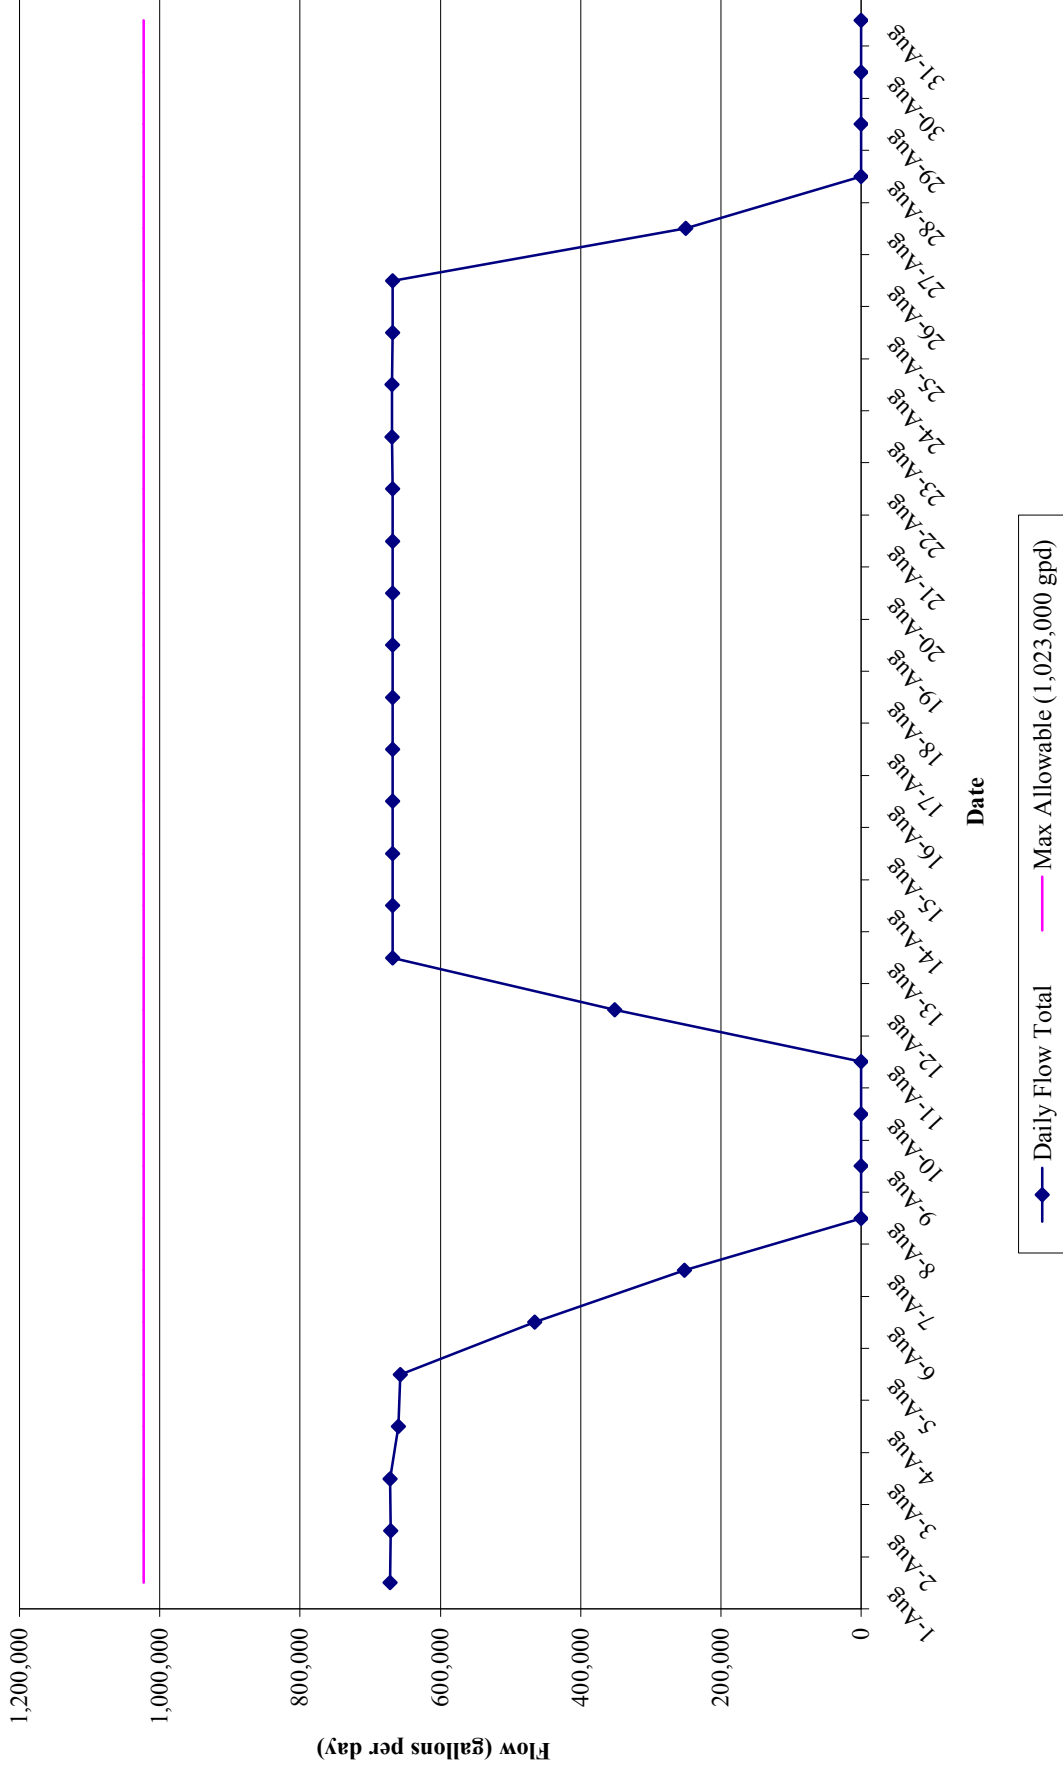

GRAPH 2
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

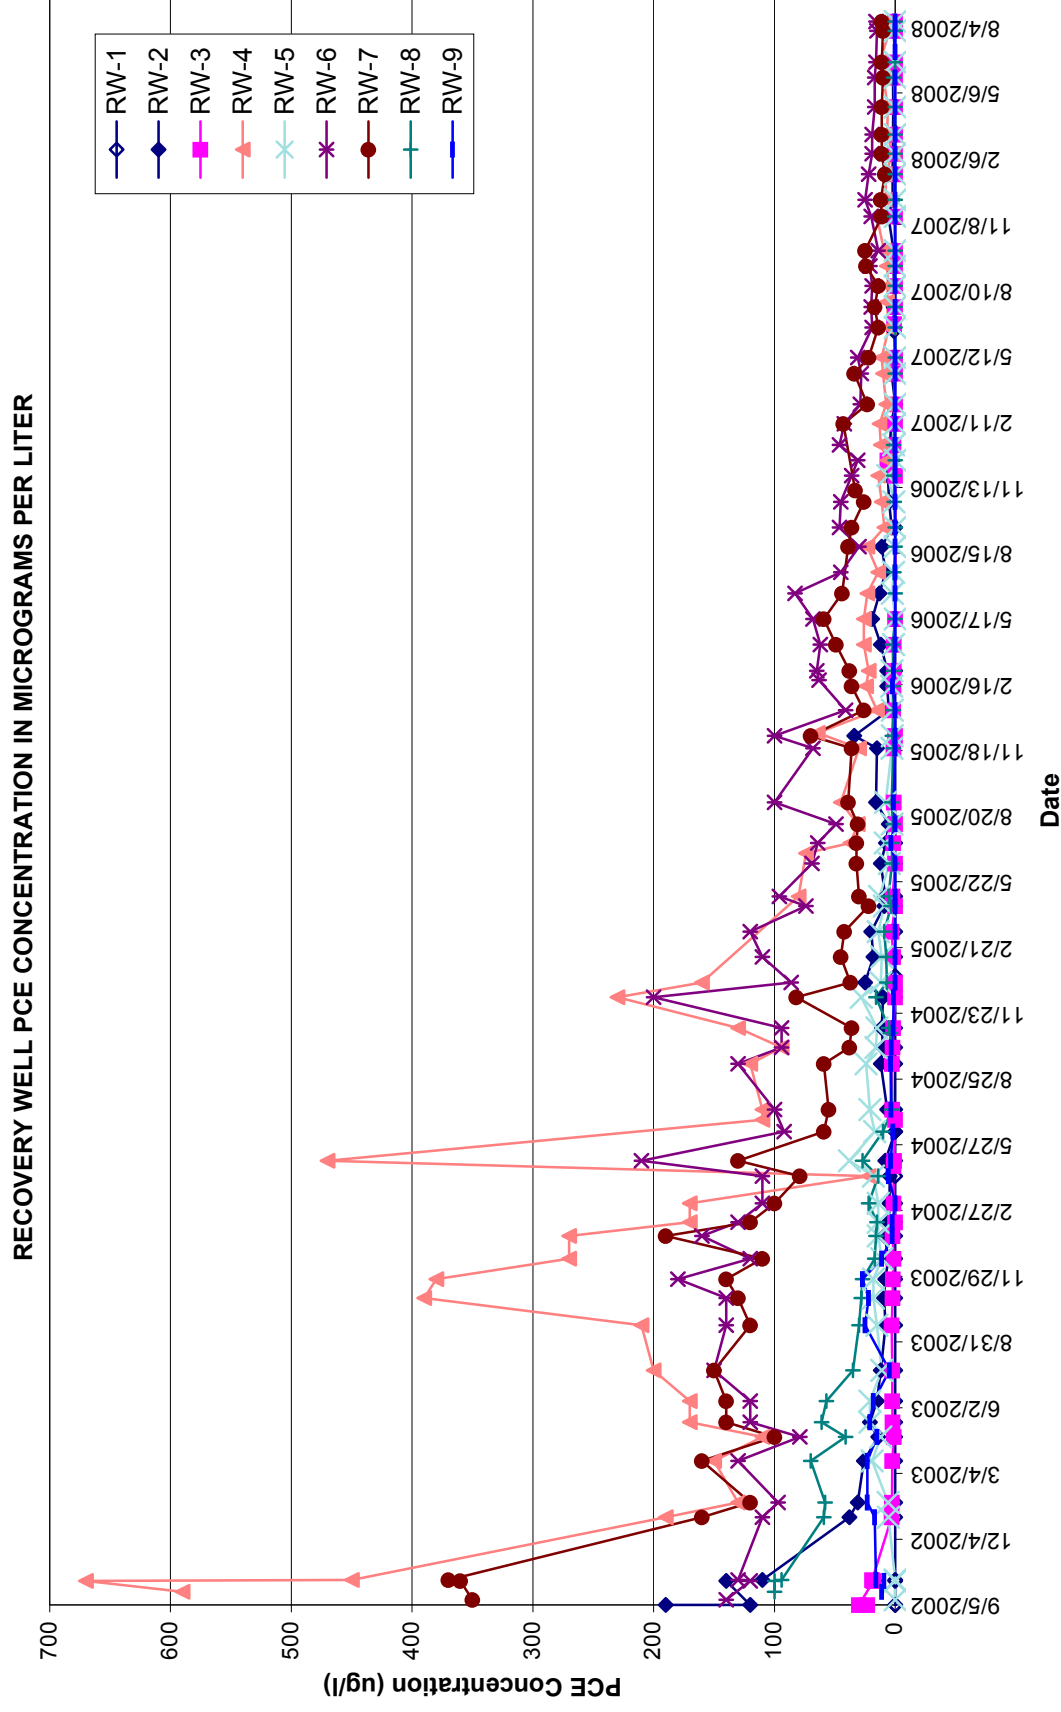

GRAPH 3
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

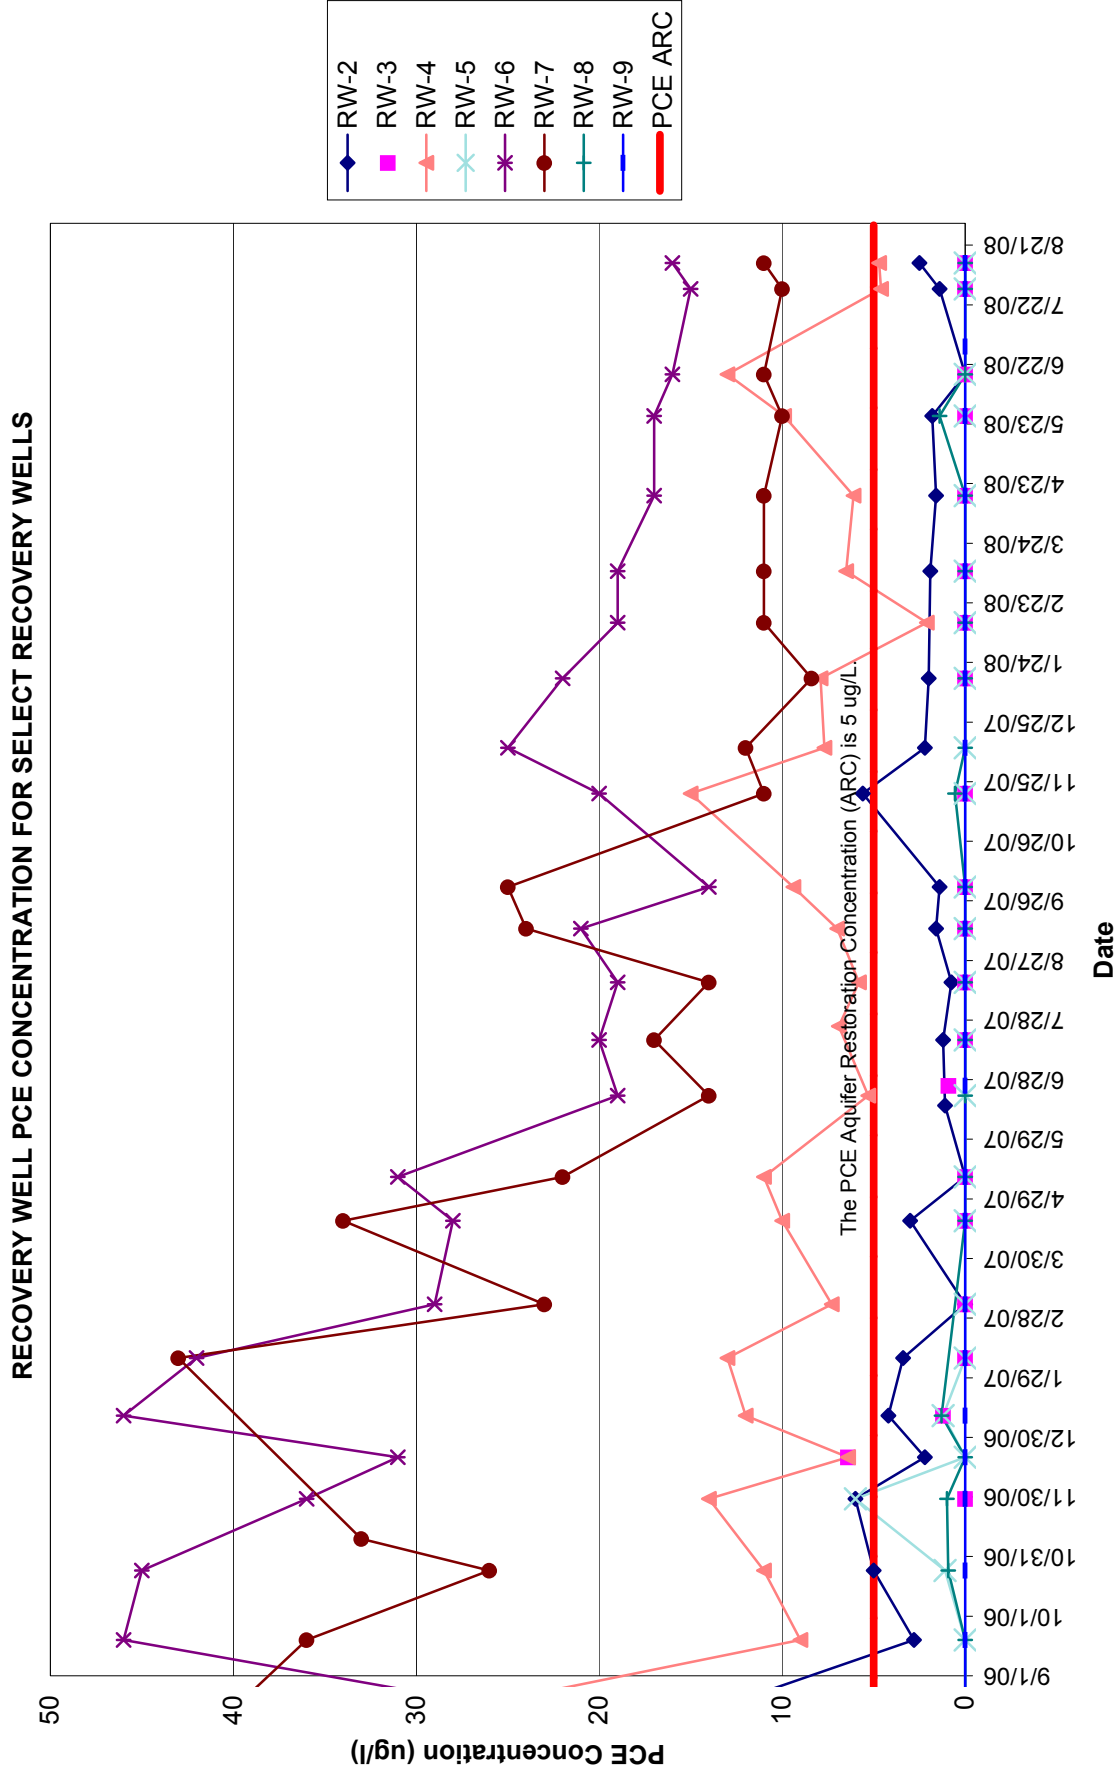

APPENDIX I
AUGUST 2008 LABORATORY ANALYTICAL REPORTS

Thursday, August 14, 2008

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe

Order No.: 0808131

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 8/8/2008 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The results reported herein relate only to the items tested or to the samples as received by the laboratory. This report may not be reproduced, except in full, without the approval of American Analytical Laboratories, LLC and is not considered complete without a cover page and chain of custody documentation. The limits (LOQ) provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report. This package has been reviewed by American Analytical Laboratories' QA Department/Laboratory Director to comply with NELAC standards prior to report submittal.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

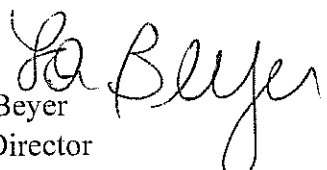
Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 14-Aug-08

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe
Lab Order: 0808131

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Date Collected	Date Received
0808131-01A	WQ080508:1100NP2-6	8/5/2008 11:00:00 AM	8/8/2008
0808131-01B	WQ080508:1100NP2-6	8/5/2008 11:00:00 AM	8/8/2008
0808131-01C	WQ080508:1100NP2-6	8/5/2008 11:00:00 AM	8/8/2008
0808131-02A	WQ080508:1105NP2-7	8/5/2008 11:05:00 AM	8/8/2008
0808131-02B	WQ080508:1105NP2-7	8/5/2008 11:05:00 AM	8/8/2008
0808131-02C	WQ080508:1105NP2-7	8/5/2008 11:05:00 AM	8/8/2008
0808131-03A	WQ080508:1110NP2-10	8/5/2008 11:10:00 AM	8/8/2008
0808131-03B	WQ080508:1110NP2-10	8/5/2008 11:10:00 AM	8/8/2008
0808131-03C	WQ080508:1110NP2-10	8/5/2008 11:10:00 AM	8/8/2008
0808131-03D	WQ080508:1110NP2-10	8/5/2008 11:10:00 AM	8/8/2008

TAG# / COC _____

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100

FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value.
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of the method allowable holding time.

American Analytical Laboratories, LLC.

Date: 14-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ080508:1100NP2-6

Lab Order: 0808131

Collection Date: 8/5/2008 11:00:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808131-01A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
1,1,1,2-Tetrachloroethane	U	0.09	1.0		µg/L	1	8/11/2008 2:48:00 PM
1,1,1-Trichloroethane	U	0.17	1.0		µg/L	1	8/11/2008 2:48:00 PM
1,1,2,2-Tetrachloroethane	U	0.06	1.0		µg/L	1	8/11/2008 2:48:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	0.13	1.0		µg/L	1	8/11/2008 2:48:00 PM
1,1,2-Trichloroethane	U	0.07	1.0		µg/L	1	8/11/2008 2:48:00 PM
1,1-Dichloroethane	U	0.11	1.0		µg/L	1	8/11/2008 2:48:00 PM
1,1-Dichloroethene	U	0.15	1.0		µg/L	1	8/11/2008 2:48:00 PM
1,1-Dichloropropene	U	0.12	1.0		µg/L	1	8/11/2008 2:48:00 PM
1,2,3-Trichlorobenzene	U	0.07	1.0	C	µg/L	1	8/11/2008 2:48:00 PM
1,2,3-Trichloropropane	U	0.08	1.0		µg/L	1	8/11/2008 2:48:00 PM
1,2,4-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/11/2008 2:48:00 PM
1,2,4-Trimethylbenzene	U	0.09	1.0		µg/L	1	8/11/2008 2:48:00 PM
1,2-Dibromo-3-chloropropane	U	0.09	1.0		µg/L	1	8/11/2008 2:48:00 PM
1,2-Dibromoethane	U	0.06	1.0		µg/L	1	8/11/2008 2:48:00 PM
1,2-Dichlorobenzene	U	0.08	1.0	C	µg/L	1	8/11/2008 2:48:00 PM
1,2-Dichloroethane	U	0.08	1.0		µg/L	1	8/11/2008 2:48:00 PM
1,2-Dichloropropane	U	0.1	1.0		µg/L	1	8/11/2008 2:48:00 PM
1,3,5-Trimethylbenzene	U	0.11	1.0		µg/L	1	8/11/2008 2:48:00 PM
1,3-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/11/2008 2:48:00 PM
1,3-dichloropropane	U	0.08	1.0		µg/L	1	8/11/2008 2:48:00 PM
1,4-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/11/2008 2:48:00 PM
2,2-Dichloropropane	U	0.11	1.0		µg/L	1	8/11/2008 2:48:00 PM
2-Butanone	U	1.28	3.0		µg/L	1	8/11/2008 2:48:00 PM
2-Chloroethyl vinyl ether	U	0.08	1.0		µg/L	1	8/11/2008 2:48:00 PM
2-Chlorotoluene	U	0.09	1.0		µg/L	1	8/11/2008 2:48:00 PM
2-Hexanone	U	0.22	2.0		µg/L	1	8/11/2008 2:48:00 PM
4-Chlorotoluene	U	0.09	1.0		µg/L	1	8/11/2008 2:48:00 PM
4-Isopropyltoluene	U	0.1	1.0		µg/L	1	8/11/2008 2:48:00 PM
4-Methyl-2-pentanone	U	0.21	2.0		µg/L	1	8/11/2008 2:48:00 PM
Acetone	U	0.19	2.0	C	µg/L	1	8/11/2008 2:48:00 PM
Benzene	U	0.11	1.0		µg/L	1	8/11/2008 2:48:00 PM
Bromobenzene	U	0.07	1.0		µg/L	1	8/11/2008 2:48:00 PM
Bromochloromethane	U	0.4	1.0		µg/L	1	8/11/2008 2:48:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
	LOQ Limit of Quantitation	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
	C Calibration %RSD/%D exceeded for non-CCC analytes	

American Analytical Laboratories, LLC.

Date: 14-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808131
Project: Rowe
Lab ID: 0808131-01A

Client Sample ID: WQ080508:1100NP2-6
Collection Date: 8/5/2008 11:00:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
Bromodichloromethane	U	0.08	1.0		µg/L	1	8/11/2008 2:48:00 PM
Bromoform	U	0.06	1.0		µg/L	1	8/11/2008 2:48:00 PM
Bromomethane	U	0.17	1.0		µg/L	1	8/11/2008 2:48:00 PM
Carbon disulfide	U	0.14	1.0		µg/L	1	8/11/2008 2:48:00 PM
Carbon tetrachloride	U	0.16	1.0		µg/L	1	8/11/2008 2:48:00 PM
Chlorobenzene	U	0.09	1.0		µg/L	1	8/11/2008 2:48:00 PM
Chloroethane	U	0.16	1.0		µg/L	1	8/11/2008 2:48:00 PM
Chloroform	U	0.1	1.0		µg/L	1	8/11/2008 2:48:00 PM
Chloromethane	U	0.18	1.0		µg/L	1	8/11/2008 2:48:00 PM
cis-1,2-Dichloroethene	U	0.11	1.0		µg/L	1	8/11/2008 2:48:00 PM
cis-1,3-Dichloropropene	U	0.08	1.0		µg/L	1	8/11/2008 2:48:00 PM
Dibromochloromethane	U	0.07	1.0		µg/L	1	8/11/2008 2:48:00 PM
Dibromomethane	U	0.07	1.0		µg/L	1	8/11/2008 2:48:00 PM
Dichlorodifluoromethane	U	0.15	1.0		µg/L	1	8/11/2008 2:48:00 PM
Ethylbenzene	U	0.1	1.0		µg/L	1	8/11/2008 2:48:00 PM
Hexachlorobutadiene	U	0.12	1.0	C	µg/L	1	8/11/2008 2:48:00 PM
Isopropylbenzene	U	0.11	1.0		µg/L	1	8/11/2008 2:48:00 PM
m,p-Xylene	U	0.2	2.0		µg/L	1	8/11/2008 2:48:00 PM
Methyl tert-butyl ether	U	0.08	1.0		µg/L	1	8/11/2008 2:48:00 PM
Methylene chloride	U	0.08	1.0		µg/L	1	8/11/2008 2:48:00 PM
Naphthalene	U	0.08	1.0	C	µg/L	1	8/11/2008 2:48:00 PM
n-Butylbenzene	U	0.11	1.0	C	µg/L	1	8/11/2008 2:48:00 PM
n-Propylbenzene	U	0.11	1.0		µg/L	1	8/11/2008 2:48:00 PM
o-Xylene	U	0.1	1.0		µg/L	1	8/11/2008 2:48:00 PM
sec-Butylbenzene	U	0.1	1.0		µg/L	1	8/11/2008 2:48:00 PM
Styrene	U	0.08	1.0		µg/L	1	8/11/2008 2:48:00 PM
tert-Butylbenzene	U	0.1	1.0		µg/L	1	8/11/2008 2:48:00 PM
Tetrachloroethene	2.1	0.12	1.0		µg/L	1	8/11/2008 2:48:00 PM
Toluene	U	0.12	1.0		µg/L	1	8/11/2008 2:48:00 PM
trans-1,2-Dichloroethene	U	0.12	1.0		µg/L	1	8/11/2008 2:48:00 PM
trans-1,3-Dichloropropene	U	0.07	1.0		µg/L	1	8/11/2008 2:48:00 PM
Trichloroethene	U	0.13	1.0		µg/L	1	8/11/2008 2:48:00 PM
Trichlorofluoromethane	U	0.15	1.0		µg/L	1	8/11/2008 2:48:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 14-Aug-08

ELAP ID : 11418**CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** WQ080508:1100NP2-6**Lab Order:** 0808131**Collection Date:** 8/5/2008 11:00:00 AM**Project:** Rowe**Matrix:** LIQUID**Lab ID:** 0808131-01A**Certificate of Results**

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B		Analyst: LA		
Vinyl acetate	U	0.06	1.0		µg/L	1	8/11/2008 2:48:00 PM
Vinyl chloride	U	0.14	1.0		µg/L	1	8/11/2008 2:48:00 PM
Surr: 4-Bromofluorobenzene	97.2	0	54-134		%REC	1	8/11/2008 2:48:00 PM
Surr: Dibromofluoromethane	98.6	0	52-132		%REC	1	8/11/2008 2:48:00 PM
Surr: Toluene-d8	100	0	51-127		%REC	1	8/11/2008 2:48:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 14-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ080508:1100NP2-6

Lab Order: 0808131

Collection Date: 8/5/2008 11:00:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808131-01B

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL IRON				E200.7	SW3010A		Analyst: JP
Iron	2.57	0.005	0.0200		mg/L	1	8/8/2008 2:13:12 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 14-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ080508:1100NP2-6

Lab Order: 0808131

Collection Date: 8/5/2008 11:00:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808131-01C

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
DISSOLVED IRON			E200.7		SW3010A		Analyst: JP
Iron	0.0857	0.005	0.0200		mg/L	1	8/8/2008 2:11:09 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 14-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808131
Project: Rowe
Lab ID: 0808131-02A

Client Sample ID: WQ080508:1105NP2-7
Collection Date: 8/5/2008 11:05:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
1,1,1,2-Tetrachloroethane	U	0.09	1.0		µg/L	1	8/11/2008 3:18:00 PM
1,1,1-Trichloroethane	U	0.17	1.0		µg/L	1	8/11/2008 3:18:00 PM
1,1,2,2-Tetrachloroethane	U	0.06	1.0		µg/L	1	8/11/2008 3:18:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	0.13	1.0		µg/L	1	8/11/2008 3:18:00 PM
1,1,2-Trichloroethane	U	0.07	1.0		µg/L	1	8/11/2008 3:18:00 PM
1,1-Dichloroethane	U	0.11	1.0		µg/L	1	8/11/2008 3:18:00 PM
1,1-Dichloroethene	U	0.15	1.0		µg/L	1	8/11/2008 3:18:00 PM
1,1-Dichloropropene	U	0.12	1.0		µg/L	1	8/11/2008 3:18:00 PM
1,2,3-Trichlorobenzene	U	0.07	1.0	C	µg/L	1	8/11/2008 3:18:00 PM
1,2,3-Trichloropropane	U	0.08	1.0		µg/L	1	8/11/2008 3:18:00 PM
1,2,4-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/11/2008 3:18:00 PM
1,2,4-Trimethylbenzene	U	0.09	1.0		µg/L	1	8/11/2008 3:18:00 PM
1,2-Dibromo-3-chloropropane	U	0.09	1.0		µg/L	1	8/11/2008 3:18:00 PM
1,2-Dibromoethane	U	0.06	1.0		µg/L	1	8/11/2008 3:18:00 PM
1,2-Dichlorobenzene	U	0.08	1.0	C	µg/L	1	8/11/2008 3:18:00 PM
1,2-Dichloroethane	U	0.08	1.0		µg/L	1	8/11/2008 3:18:00 PM
1,2-Dichloropropane	U	0.1	1.0		µg/L	1	8/11/2008 3:18:00 PM
1,3,5-Trimethylbenzene	U	0.11	1.0		µg/L	1	8/11/2008 3:18:00 PM
1,3-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/11/2008 3:18:00 PM
1,3-dichloropropane	U	0.08	1.0		µg/L	1	8/11/2008 3:18:00 PM
1,4-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/11/2008 3:18:00 PM
2,2-Dichloropropane	U	0.11	1.0		µg/L	1	8/11/2008 3:18:00 PM
2-Butanone	U	1.28	3.0		µg/L	1	8/11/2008 3:18:00 PM
2-Chloroethyl vinyl ether	U	0.08	1.0		µg/L	1	8/11/2008 3:18:00 PM
2-Chlorotoluene	U	0.09	1.0		µg/L	1	8/11/2008 3:18:00 PM
2-Hexanone	U	0.22	2.0		µg/L	1	8/11/2008 3:18:00 PM
4-Chlorotoluene	U	0.09	1.0		µg/L	1	8/11/2008 3:18:00 PM
4-Isopropyltoluene	U	0.1	1.0		µg/L	1	8/11/2008 3:18:00 PM
4-Methyl-2-pentanone	U	0.21	2.0		µg/L	1	8/11/2008 3:18:00 PM
Acetone	U	0.19	2.0	C	µg/L	1	8/11/2008 3:18:00 PM
Benzene	U	0.11	1.0		µg/L	1	8/11/2008 3:18:00 PM
Bromobenzene	U	0.07	1.0		µg/L	1	8/11/2008 3:18:00 PM
Bromochloromethane	U	0.4	1.0		µg/L	1	8/11/2008 3:18:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
	LOQ Limit of Quantitation	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
	C Calibration %RSD/%D exceeded for non-CCC analytes	

American Analytical Laboratories, LLC.

Date: 14-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808131
Project: Rowe
Lab ID: 0808131-02A

Client Sample ID: WQ080508:1105NP2-7
Collection Date: 8/5/2008 11:05:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
Bromodichloromethane	U	0.08	1.0		µg/L	1	8/11/2008 3:18:00 PM
Bromoform	U	0.06	1.0		µg/L	1	8/11/2008 3:18:00 PM
Bromomethane	U	0.17	1.0		µg/L	1	8/11/2008 3:18:00 PM
Carbon disulfide	U	0.14	1.0		µg/L	1	8/11/2008 3:18:00 PM
Carbon tetrachloride	U	0.16	1.0		µg/L	1	8/11/2008 3:18:00 PM
Chlorobenzene	U	0.09	1.0		µg/L	1	8/11/2008 3:18:00 PM
Chloroethane	U	0.16	1.0		µg/L	1	8/11/2008 3:18:00 PM
Chloroform	U	0.1	1.0		µg/L	1	8/11/2008 3:18:00 PM
Chloromethane	U	0.18	1.0		µg/L	1	8/11/2008 3:18:00 PM
cis-1,2-Dichloroethene	U	0.11	1.0		µg/L	1	8/11/2008 3:18:00 PM
cis-1,3-Dichloropropene	U	0.08	1.0		µg/L	1	8/11/2008 3:18:00 PM
Dibromochloromethane	U	0.07	1.0		µg/L	1	8/11/2008 3:18:00 PM
Dibromomethane	U	0.07	1.0		µg/L	1	8/11/2008 3:18:00 PM
Dichlorodifluoromethane	U	0.15	1.0		µg/L	1	8/11/2008 3:18:00 PM
Ethylbenzene	U	0.1	1.0		µg/L	1	8/11/2008 3:18:00 PM
Hexachlorobutadiene	U	0.12	1.0	C	µg/L	1	8/11/2008 3:18:00 PM
Isopropylbenzene	U	0.11	1.0		µg/L	1	8/11/2008 3:18:00 PM
m,p-Xylene	U	0.2	2.0		µg/L	1	8/11/2008 3:18:00 PM
Methyl tert-butyl ether	U	0.08	1.0		µg/L	1	8/11/2008 3:18:00 PM
Methylene chloride	U	0.08	1.0		µg/L	1	8/11/2008 3:18:00 PM
Naphthalene	U	0.08	1.0	C	µg/L	1	8/11/2008 3:18:00 PM
n-Butylbenzene	U	0.11	1.0	C	µg/L	1	8/11/2008 3:18:00 PM
n-Propylbenzene	U	0.11	1.0		µg/L	1	8/11/2008 3:18:00 PM
o-Xylene	U	0.1	1.0		µg/L	1	8/11/2008 3:18:00 PM
sec-Butylbenzene	U	0.1	1.0		µg/L	1	8/11/2008 3:18:00 PM
Styrene	U	0.08	1.0		µg/L	1	8/11/2008 3:18:00 PM
tert-Butylbenzene	U	0.1	1.0		µg/L	1	8/11/2008 3:18:00 PM
Tetrachloroethene	U	0.12	1.0		µg/L	1	8/11/2008 3:18:00 PM
Toluene	U	0.12	1.0		µg/L	1	8/11/2008 3:18:00 PM
trans-1,2-Dichloroethene	U	0.12	1.0		µg/L	1	8/11/2008 3:18:00 PM
trans-1,3-Dichloropropene	U	0.07	1.0		µg/L	1	8/11/2008 3:18:00 PM
Trichloroethene	U	0.13	1.0		µg/L	1	8/11/2008 3:18:00 PM
Trichlorofluoromethane	U	0.15	1.0		µg/L	1	8/11/2008 3:18:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 14-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ080508:1105NP2-7

Lab Order: 0808131

Collection Date: 8/5/2008 11:05:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808131-02A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
Vinyl acetate	U	0.06	1.0		µg/L	1	8/11/2008 3:18:00 PM
Vinyl chloride	U	0.14	1.0		µg/L	1	8/11/2008 3:18:00 PM
Surr: 4-Bromofluorobenzene	99.6	0	54-134		%REC	1	8/11/2008 3:18:00 PM
Surr: Dibromofluoromethane	101	0	52-132		%REC	1	8/11/2008 3:18:00 PM
Surr: Toluene-d8	100	0	51-127		%REC	1	8/11/2008 3:18:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 14-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808131
Project: Rowe
Lab ID: 0808131-02B

Client Sample ID: WQ080508:1105NP2-7
Collection Date: 8/5/2008 11:05:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL IRON			E200.7		SW3010A		Analyst: JP
Iron	2.86	0.005	0.0200		mg/L	1	8/8/2008 2:37:25 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 14-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808131
Project: Rowe
Lab ID: 0808131-02C

Client Sample ID: WQ080508:1105NP2-7
Collection Date: 8/5/2008 11:05:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
DISSOLVED IRON				E200.7	SW3010A		Analyst: JP
Iron	0.202	0.005	0.0200		mg/L	1	8/8/2008 2:15:14 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 14-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808131
Project: Rowe
Lab ID: 0808131-03A

Client Sample ID: WQ080508:1110NP2-10
Collection Date: 8/5/2008 11:10:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
1,1,1,2-Tetrachloroethane	U	0.09	1.0		µg/L	1	8/11/2008 3:49:00 PM
1,1,1-Trichloroethane	U	0.17	1.0		µg/L	1	8/11/2008 3:49:00 PM
1,1,2,2-Tetrachloroethane	U	0.06	1.0		µg/L	1	8/11/2008 3:49:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	0.13	1.0		µg/L	1	8/11/2008 3:49:00 PM
1,1,2-Trichloroethane	U	0.07	1.0		µg/L	1	8/11/2008 3:49:00 PM
1,1-Dichloroethane	U	0.11	1.0		µg/L	1	8/11/2008 3:49:00 PM
1,1-Dichloroethene	U	0.15	1.0		µg/L	1	8/11/2008 3:49:00 PM
1,1-Dichloropropene	U	0.12	1.0		µg/L	1	8/11/2008 3:49:00 PM
1,2,3-Trichlorobenzene	U	0.07	1.0	C	µg/L	1	8/11/2008 3:49:00 PM
1,2,3-Trichloropropane	U	0.08	1.0		µg/L	1	8/11/2008 3:49:00 PM
1,2,4-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/11/2008 3:49:00 PM
1,2,4-Trimethylbenzene	U	0.09	1.0		µg/L	1	8/11/2008 3:49:00 PM
1,2-Dibromo-3-chloropropane	U	0.09	1.0		µg/L	1	8/11/2008 3:49:00 PM
1,2-Dibromoethane	U	0.06	1.0		µg/L	1	8/11/2008 3:49:00 PM
1,2-Dichlorobenzene	U	0.08	1.0	C	µg/L	1	8/11/2008 3:49:00 PM
1,2-Dichloroethane	U	0.08	1.0		µg/L	1	8/11/2008 3:49:00 PM
1,2-Dichloropropane	U	0.1	1.0		µg/L	1	8/11/2008 3:49:00 PM
1,3,5-Trimethylbenzene	U	0.11	1.0		µg/L	1	8/11/2008 3:49:00 PM
1,3-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/11/2008 3:49:00 PM
1,3-dichloropropane	U	0.08	1.0		µg/L	1	8/11/2008 3:49:00 PM
1,4-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/11/2008 3:49:00 PM
2,2-Dichloropropane	U	0.11	1.0		µg/L	1	8/11/2008 3:49:00 PM
2-Butanone	U	1.28	3.0		µg/L	1	8/11/2008 3:49:00 PM
2-Chloroethyl vinyl ether	U	0.08	1.0		µg/L	1	8/11/2008 3:49:00 PM
2-Chlorotoluene	U	0.09	1.0		µg/L	1	8/11/2008 3:49:00 PM
2-Hexanone	U	0.22	2.0		µg/L	1	8/11/2008 3:49:00 PM
4-Chlorotoluene	U	0.09	1.0		µg/L	1	8/11/2008 3:49:00 PM
4-Isopropyltoluene	U	0.1	1.0		µg/L	1	8/11/2008 3:49:00 PM
4-Methyl-2-pentanone	U	0.21	2.0		µg/L	1	8/11/2008 3:49:00 PM
Acetone	U	0.19	2.0	C	µg/L	1	8/11/2008 3:49:00 PM
Benzene	U	0.11	1.0		µg/L	1	8/11/2008 3:49:00 PM
Bromobenzene	U	0.07	1.0		µg/L	1	8/11/2008 3:49:00 PM
Bromochloromethane	U	0.4	1.0		µg/L	1	8/11/2008 3:49:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
	LOQ Limit of Quantitation	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
	C Calibration %RSD/%D exceeded for non-CCC analytes	

American Analytical Laboratories, LLC.

Date: 14-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808131
Project: Rowe
Lab ID: 0808131-03A

Client Sample ID: WQ080508:1110NP2-10
Collection Date: 8/5/2008 11:10:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
Bromodichloromethane	U	0.08	1.0		µg/L	1	8/11/2008 3:49:00 PM
Bromoform	U	0.06	1.0		µg/L	1	8/11/2008 3:49:00 PM
Bromomethane	U	0.17	1.0		µg/L	1	8/11/2008 3:49:00 PM
Carbon disulfide	U	0.14	1.0		µg/L	1	8/11/2008 3:49:00 PM
Carbon tetrachloride	U	0.16	1.0		µg/L	1	8/11/2008 3:49:00 PM
Chlorobenzene	U	0.09	1.0		µg/L	1	8/11/2008 3:49:00 PM
Chloroethane	U	0.16	1.0		µg/L	1	8/11/2008 3:49:00 PM
Chloroform	U	0.1	1.0		µg/L	1	8/11/2008 3:49:00 PM
Chloromethane	U	0.18	1.0		µg/L	1	8/11/2008 3:49:00 PM
cis-1,2-Dichloroethene	U	0.11	1.0		µg/L	1	8/11/2008 3:49:00 PM
cis-1,3-Dichloropropene	U	0.08	1.0		µg/L	1	8/11/2008 3:49:00 PM
Dibromochloromethane	U	0.07	1.0		µg/L	1	8/11/2008 3:49:00 PM
Dibromomethane	U	0.07	1.0		µg/L	1	8/11/2008 3:49:00 PM
Dichlorodifluoromethane	U	0.15	1.0		µg/L	1	8/11/2008 3:49:00 PM
Ethylbenzene	U	0.1	1.0		µg/L	1	8/11/2008 3:49:00 PM
Hexachlorobutadiene	U	0.12	1.0	C	µg/L	1	8/11/2008 3:49:00 PM
Isopropylbenzene	U	0.11	1.0		µg/L	1	8/11/2008 3:49:00 PM
m,p-Xylene	U	0.2	2.0		µg/L	1	8/11/2008 3:49:00 PM
Methyl tert-butyl ether	U	0.08	1.0		µg/L	1	8/11/2008 3:49:00 PM
Methylene chloride	U	0.08	1.0		µg/L	1	8/11/2008 3:49:00 PM
Naphthalene	U	0.08	1.0	C	µg/L	1	8/11/2008 3:49:00 PM
n-Butylbenzene	U	0.11	1.0	C	µg/L	1	8/11/2008 3:49:00 PM
n-Propylbenzene	U	0.11	1.0		µg/L	1	8/11/2008 3:49:00 PM
o-Xylene	U	0.1	1.0		µg/L	1	8/11/2008 3:49:00 PM
sec-Butylbenzene	U	0.1	1.0		µg/L	1	8/11/2008 3:49:00 PM
Styrene	U	0.08	1.0		µg/L	1	8/11/2008 3:49:00 PM
tert-Butylbenzene	U	0.1	1.0		µg/L	1	8/11/2008 3:49:00 PM
Tetrachloroethene	U	0.12	1.0		µg/L	1	8/11/2008 3:49:00 PM
Toluene	U	0.12	1.0		µg/L	1	8/11/2008 3:49:00 PM
trans-1,2-Dichloroethene	U	0.12	1.0		µg/L	1	8/11/2008 3:49:00 PM
trans-1,3-Dichloropropene	U	0.07	1.0		µg/L	1	8/11/2008 3:49:00 PM
Trichloroethene	U	0.13	1.0		µg/L	1	8/11/2008 3:49:00 PM
Trichlorofluoromethane	U	0.15	1.0		µg/L	1	8/11/2008 3:49:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 14-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808131
Project: Rowe
Lab ID: 0808131-03A

Client Sample ID: WQ080508:1110NP2-10
Collection Date: 8/5/2008 11:10:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B		Analyst: LA		
Vinyl acetate	U	0.06	1.0		µg/L	1	8/11/2008 3:49:00 PM
Vinyl chloride	U	0.14	1.0		µg/L	1	8/11/2008 3:49:00 PM
Surr: 4-Bromofluorobenzene	99.2	0	54-134		%REC	1	8/11/2008 3:49:00 PM
Surr: Dibromofluoromethane	99.9	0	52-132		%REC	1	8/11/2008 3:49:00 PM
Surr: Toluene-d8	99.3	0	51-127		%REC	1	8/11/2008 3:49:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 14-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ080508:1110NP2-10

Lab Order: 0808131

Collection Date: 8/5/2008 11:10:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808131-03B

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL IRON				E200.7	SW3010A		Analyst: JP
Iron	2.46	0.005	0.0200		mg/L	1	8/8/2008 2:41:33 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 14-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ080508:1110NP2-10

Lab Order: 0808131

Collection Date: 8/5/2008 11:10:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808131-03C

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
DISSOLVED IRON				E200.7	SW3010A		Analyst: JP
Iron	0.180	0.005	0.0200		mg/L	1	8/8/2008 2:39:29 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com

nelc

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 14-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ080508:1110NP2-10

Lab Order: 0808131

Collection Date: 8/5/2008 11:10:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808131-03D

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL DISSOLVED SOLIDS				M2540C			Analyst: AS
Total Dissolved Solids (Residue, Filterable)	113	0	1.00		mg/L	1	8/12/2008

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
	LOQ Limit of Quantitation	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
	C Calibration %RSD/%D exceeded for non-CCC analytes	

CLIENT: Leggett Brashears & Graham Inc.
 Work Order: 0808131
 Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: V624LCS-081108L	SampType: LCS	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37500						
Client ID: LCSW	Batch ID: R37500	TestNo: SW8260B		Analysis Date: 8/11/2008	SeqNo: 491113						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,1,1-Trichloroethane	36	1.0	50.00	0	72.6	43	148				
1,1,2,2-Tetrachloroethane	30	1.0	50.00	0	60.6	32	148				
1,1,2-Trichloroethane	32	1.0	50.00	0	64.8	42	136				
1,1-Dichloroethane	36	1.0	50.00	0	72.5	40	150				
1,1-Dichloroethene	45	1.0	50.00	0	90.2	30	154				
1,2-Dichlorobenzene	31	1.0	50.00	0	62.9	40	129				
1,2-Dichloroethane	35	1.0	50.00	0	69.4	36	141				
1,2-Dichloropropane	35	1.0	50.00	0	69.0	44	138				
1,3-Dichlorobenzene	33	1.0	50.00	0	66.4	40	133				
1,4-Dichlorobenzene	32	1.0	50.00	0	63.7	40	135				
2-Chloroethyl vinyl ether	31	1.0	50.00	0	62.9	21	139				
2-Hexanone	64	2.0	50.00	0	129	35	135				
4-Methyl-2-pentanone	69	2.0	125.0	0	55.4	35	135				
Acetone	90	2.0	125.0	0	72.0	35	135				
Benzene	35	1.0	50.00	0	69.4	45	144				
Bromodichloromethane	34	1.0	50.00	0	68.8	35	136				
Bromoform	31	1.0	50.00	0	61.1	28	138				
Bromomethane	42	1.0	50.00	0	84.4	26	148				
Carbon tetrachloride	39	1.0	50.00	0	77.2	45	141				
Chlorobenzene	34	1.0	50.00	0	67.9	41	142				
Chloroethane	44	1.0	50.00	0	89.0	36	143				
Chloroform	35	1.0	50.00	0	69.8	42	137				
Chloromethane	45	1.0	50.00	0	89.6	35	151				
cis-1,3-Dichloropropene	33	1.0	50.00	0	66.7	42	130				
Dibromochloromethane	34	1.0	50.00	0	67.2	21	134				
Ethylbenzene	33	1.0	50.00	0	66.9	45	146				
Tetrachloroethene	34	1.0	50.00	0	68.2	45	136				
Toluene	33	1.0	50.00	0	66.6	43	134				
trans-1,2-Dichloroethene	36	1.0	50.00	0	72.1	42	135				
trans-1,3-Dichloropropene	31	1.0	50.00	0	61.8	37	133				

Qualifiers: E Value above quantitation range
 LOD Limit of Detection
 R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
 LOQ Limit of Quantitation
 S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
 ND Not Detected at the Reporting Limit
 U Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808131
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113 W

Sample ID: V624LCS-081108L	SampleType: LCS	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37500						
Client ID: LCSW	Batch ID: R37500	TestNo: SW8260B		Analysis Date: 8/11/2008	SeqNo: 491113						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Trichloroethene	34	1.0	50.00	0	68.8	43	140				
Trichlorofluoromethane	47	1.0	50.00	0	93.4	50	148				
Vinyl chloride	46	1.0	50.00	0	91.9	35	142				
Surr: 4-Bromofluorobenzene	49		50.00		97.4	54	134				
Surr: Dibromofluoromethane	51		50.00		101	52	132				
Surr: Toluene-d8	50		50.00		101	51	127				

Sample ID: VBLK081108L	Sample Type: MBLK	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37500						
Client ID: PBW	Batch ID: R37500	TestNo: SW8260B		Analysis Date: 8/11/2008	SeqNo: 491114						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

1,1,1,2-Tetrachloroethane	U	1.0									
1,1,1-Trichloroethane	U	1.0									
1,1,2,2-Tetrachloroethane	U	1.0									
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0									
1,1,2-Trichloroethane	U	1.0									
1,1-Dichloroethane	U	1.0									
1,1-Dichloroethene	U	1.0									
1,1-Dichloropropene	U	1.0									
1,2,3-Trichlorobenzene	U	1.0									
1,2,3-Trichloropropene	U	1.0									
1,2,4-Trichlorobenzene	U	1.0									
1,2,4-Trimethylbenzene	U	1.0									
1,2-Dibromo-3-chloropropane	U	1.0									
1,2-Dibromoethane	U	1.0									
1,2-Dichlorobenzene	U	1.0									
1,2-Dichloroethane	U	1.0									
1,2-Dichloropropane	U	1.0									
1,3,5-Trimethylbenzene	U	1.0									
1,3-Dichlorobenzene	U	1.0									
1,3-dichloropropane	U	1.0									

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
LOD		Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
R		RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808131
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: VBLK081108L	SampType: MBLK	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37500						
Client ID: PBW	Batch ID: R37500	TestNo: SW8260B		Analysis Date: 8/11/2008	SeqNo: 491114						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,4-Dichlorobenzene	U	1.0									
2,2-Dichloropropane	U	1.0									
2-Butanone	U	3.0									
2-Chloroethyl vinyl ether	U	1.0									
2-Chlorotoluene	U	1.0									
2-Hexanone	U	2.0									
4-Chlorotoluene	U	1.0									
4-Isopropyltoluene	U	1.0									
4-Methyl-2-pentanone	U	2.0									
Acetone	U	2.0									C
Benzene	U	1.0									
Bromobenzene	U	1.0									
Bromochloromethane	U	1.0									
Bromodichloromethane	U	1.0									
Bromoform	U	1.0									
Bromomethane	U	1.0									
Carbon disulfide	U	1.0									
Carbon tetrachloride	U	1.0									
Chlorobenzene	U	1.0									
Chloroethane	U	1.0									
Chloroform	U	1.0									
Chloromethane	U	1.0									
cis-1,2-Dichloroethene	U	1.0									
cis-1,3-Dichloropropene	U	1.0									
Dibromochloromethane	U	1.0									
Dibromomethane	U	1.0									
Dichlorodifluoromethane	U	1.0									
Ethylbenzene	U	1.0									
Hexachlorobutadiene	U	1.0									
Isopropylbenzene	U	1.0									
m,p-Xylene	U	2.0									C

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.

Work Order: 0808131

Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: VBLK081108L	SampType: MBLK	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37500						
Client ID: PBW	Batch ID: R37500	TestNo: SW8260B		Analysis Date: 8/11/2008	SeqNo: 491114						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Methyl tert-butyl ether											

Methyl tert-butyl ether	U	1.0									
Methylene chloride	U	1.0									
Naphthalene	U	1.0									
n-Butylbenzene	U	1.0									C
n-Propylbenzene	U	1.0									C
o-Xylene	U	1.0									
sec-Butylbenzene	U	1.0									
Styrene	U	1.0									
tert-Butylbenzene	U	1.0									
Tetrachloroethene	U	1.0									
Toluene	U	1.0									
trans-1,2-Dichloroethene	U	1.0									
trans-1,3-Dichloropropene	U	1.0									
Trichloroethene	U	1.0									
Trichlorofluoromethane	U	1.0									
Vinyl acetate	U	1.0									
Vinyl chloride	U	1.0									
Surr: 4-Bromofluorobenzene	51		50.00		101	54		134			
Surr: Dibromofluoromethane	50		50.00		101	52		132			
Surr: Toluene-d8	51		50.00		103	51		127			

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

II Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Legette Brashears & Graham Inc.
Work Order: 0808131
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: FE_D

Sample ID: PBW-080808A	SampleType: MBLK	TestCode: FE_D	Units: mg/L	Prep Date: 8/8/2008	RunNo: 37443						
Client ID: PBW	Batch ID: 22515	TestNo: E200.7	SW3010A	Analysis Date: 8/8/2008	SeqNo: 490354						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Iron	U	0.0200									

Sample ID: LCSW-080808A	SampleType: LCS	TestCode: FE_D	Units: mg/L	Prep Date: 8/8/2008	RunNo: 37443						
Client ID: LCSW	Batch ID: 22515	TestNo: E200.7	SW3010A	Analysis Date: 8/8/2008	SeqNo: 490355						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Iron	1.94	0.0200	2.000	0	96.8	68	122				

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
LOD	Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit	
R	RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed	

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808131
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: FE_T

Sample ID: PBW-080808A	SampType: MBLK	TestCode: FE_T	Units: mg/L	Prep Date: 8/8/2008	RunNo: 37443						
Client ID: PBW	Batch ID: 22515	TestNo: E200.7	SW3010A	Analysis Date: 8/8/2008	SeqNo: 490298						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Iron	U	0.0200									

Sample ID: LCSW-080808A	SampType: LCS	TestCode: FE_T	Units: mg/L	Prep Date: 8/8/2008	RunNo: 37443						
Client ID: LCSW	Batch ID: 22515	TestNo: E200.7	SW3010A	Analysis Date: 8/8/2008	SeqNo: 490299						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Iron	1.94	0.0200	2.000	0	96.8	68	122				

Sample ID: 0808131-03B-MS		SampType: MS	TestCode: FE_T	Units: mg/L	Prep Date: 8/8/2008	RunNo: 37443					
Client ID: WQ080508:1110NP2		Batch ID: 22515	TestNo: E200.7	SW3010A	Analysis Date: 8/8/2008	SeqNo: 490352					
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Iron	3.54	0.0200	1.000	2.462	107	68	122				

Sample ID: 0808131-03B-MSD		SampType: MSD		TestCode: FE_T		Units: mg/L		Prep Date: 8/8/2008		RunNo: 37443	
Client ID: WQ080508:1110NP2		Batch ID: 22515		TestNo: E200.7		SW3010A		Analysis Date: 8/8/2008		SeqNo: 490353	
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Iron	3.57	0.0200	1.000	2.462	111	68	122	3.536	0.910	20	

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
	LOD	Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	R	RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808131
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: TDS_W

Sample ID: MB-R37564	SampType: MBLK	TestCode: TDS_W	Units: mg/L	Prep Date:	RunNo: 37564						
Client ID: PBW	Batch ID: R37564	TestNo: M2540C		Analysis Date: 8/12/2008	SeqNo: 492144						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Total Dissolved Solids (Residue, Filtra											U
											1.00

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
	LOD	Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	R	RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

Friday, August 22, 2008

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555

FAX (203) 926-9140

RE: Rowe

Order No.: 0808216

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 8/15/2008 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The results reported herein relate only to the items tested or to the samples as received by the laboratory. This report may not be reproduced, except in full, without the approval of American Analytical Laboratories, LLC and is not considered complete without a cover page and chain of custody documentation. The limits (LOQ) provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report. This package has been reviewed by American Analytical Laboratories' QA Department/Laboratory Director to comply with NELAC standards prior to report submittal.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

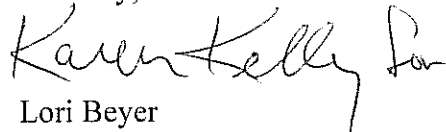

Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 22-Aug-08

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe
Lab Order: 0808216

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Date Collected	Date Received
0808216-01A	WQ081208:1230NP2-6	8/12/2008 12:30:00 PM	8/15/2008
0808216-01B	WQ081208:1230NP2-6	8/12/2008 12:30:00 PM	8/15/2008
0808216-01C	WQ081208:1230NP2-6	8/12/2008 12:30:00 PM	8/15/2008
0808216-02A	WQ081208:1235NP2-7	8/12/2008 12:35:00 PM	8/15/2008
0808216-02B	WQ081208:1235NP2-7	8/12/2008 12:35:00 PM	8/15/2008
0808216-02C	WQ081208:1235NP2-7	8/12/2008 12:35:00 PM	8/15/2008
0808216-03A	WQ081208:1240NP2-10	8/12/2008 12:40:00 PM	8/15/2008
0808216-03B	WQ081208:1240NP2-10	8/12/2008 12:40:00 PM	8/15/2008
0808216-03C	WQ081208:1240NP2-10	8/12/2008 12:40:00 PM	8/15/2008
0808216-03D	WQ081208:1240NP2-10	8/12/2008 12:40:00 PM	8/15/2008

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value.
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of the method allowable holding time.

American Analytical Laboratories, LLC.

Date: 22-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808216
Project: Rowe
Lab ID: 0808216-01A

Client Sample ID: WQ081208:1230NP2-6
Collection Date: 8/12/2008 12:30:00 PM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
1,1,1,2-Tetrachloroethane	U	0.09	1.0		µg/L	1	8/21/2008 7:27:00 AM
1,1,1-Trichloroethane	U	0.17	1.0	C	µg/L	1	8/21/2008 7:27:00 AM
1,1,2,2-Tetrachloroethane	U	0.06	1.0	C	µg/L	1	8/21/2008 7:27:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	0.13	1.0		µg/L	1	8/21/2008 7:27:00 AM
1,1,2-Trichloroethane	U	0.07	1.0		µg/L	1	8/21/2008 7:27:00 AM
1,1-Dichloroethane	U	0.11	1.0		µg/L	1	8/21/2008 7:27:00 AM
1,1-Dichloroethene	U	0.15	1.0		µg/L	1	8/21/2008 7:27:00 AM
1,1-Dichloropropene	U	0.12	1.0		µg/L	1	8/21/2008 7:27:00 AM
1,2,3-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 7:27:00 AM
1,2,3-Trichloropropane	U	0.08	1.0	C	µg/L	1	8/21/2008 7:27:00 AM
1,2,4-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 7:27:00 AM
1,2,4-Trimethylbenzene	U	0.09	1.0		µg/L	1	8/21/2008 7:27:00 AM
1,2-Dibromo-3-chloropropane	U	0.09	1.0	C	µg/L	1	8/21/2008 7:27:00 AM
1,2-Dibromoethane	U	0.06	1.0	C	µg/L	1	8/21/2008 7:27:00 AM
1,2-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 7:27:00 AM
1,2-Dichloroethane	U	0.08	1.0	C	µg/L	1	8/21/2008 7:27:00 AM
1,2-Dichloropropane	U	0.1	1.0		µg/L	1	8/21/2008 7:27:00 AM
1,3,5-Trimethylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 7:27:00 AM
1,3-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 7:27:00 AM
1,3-dichloropropane	U	0.08	1.0		µg/L	1	8/21/2008 7:27:00 AM
1,4-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 7:27:00 AM
2,2-Dichloropropane	U	0.11	1.0		µg/L	1	8/21/2008 7:27:00 AM
2-Butanone	U	1.28	3.0		µg/L	1	8/21/2008 7:27:00 AM
2-Chloroethyl vinyl ether	U	0.08	1.0	C	µg/L	1	8/21/2008 7:27:00 AM
2-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 7:27:00 AM
2-Hexanone	U	0.22	2.0		µg/L	1	8/21/2008 7:27:00 AM
4-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 7:27:00 AM
4-Isopropyltoluene	U	0.1	1.0		µg/L	1	8/21/2008 7:27:00 AM
4-Methyl-2-pentanone	U	0.21	2.0		µg/L	1	8/21/2008 7:27:00 AM
Acetone	U	0.19	2.0		µg/L	1	8/21/2008 7:27:00 AM
Benzene	U	0.11	1.0		µg/L	1	8/21/2008 7:27:00 AM
Bromobenzene	U	0.07	1.0		µg/L	1	8/21/2008 7:27:00 AM
Bromochloromethane	U	0.4	1.0		µg/L	1	8/21/2008 7:27:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 22-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808216
Project: Rowe
Lab ID: 0808216-01A

Client Sample ID: WQ081208:1230NP2-6
Collection Date: 8/12/2008 12:30:00 PM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
Bromodichloromethane	U	0.08	1.0		µg/L	1	8/21/2008 7:27:00 AM
Bromoform	U	0.06	1.0		µg/L	1	8/21/2008 7:27:00 AM
Bromomethane	U	0.17	1.0	C	µg/L	1	8/21/2008 7:27:00 AM
Carbon disulfide	U	0.14	1.0		µg/L	1	8/21/2008 7:27:00 AM
Carbon tetrachloride	U	0.16	1.0		µg/L	1	8/21/2008 7:27:00 AM
Chlorobenzene	U	0.09	1.0		µg/L	1	8/21/2008 7:27:00 AM
Chloroethane	U	0.16	1.0		µg/L	1	8/21/2008 7:27:00 AM
Chloroform	U	0.1	1.0		µg/L	1	8/21/2008 7:27:00 AM
Chloromethane	U	0.18	1.0		µg/L	1	8/21/2008 7:27:00 AM
cis-1,2-Dichloroethene	U	0.11	1.0	C	µg/L	1	8/21/2008 7:27:00 AM
cis-1,3-Dichloropropene	U	0.08	1.0		µg/L	1	8/21/2008 7:27:00 AM
Dibromochloromethane	U	0.07	1.0		µg/L	1	8/21/2008 7:27:00 AM
Dibromomethane	U	0.07	1.0		µg/L	1	8/21/2008 7:27:00 AM
Dichlorodifluoromethane	U	0.15	1.0	C	µg/L	1	8/21/2008 7:27:00 AM
Ethylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 7:27:00 AM
Hexachlorobutadiene	U	0.12	1.0		µg/L	1	8/21/2008 7:27:00 AM
Isopropylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 7:27:00 AM
m,p-Xylene	U	0.2	2.0		µg/L	1	8/21/2008 7:27:00 AM
Methyl tert-butyl ether	U	0.08	1.0		µg/L	1	8/21/2008 7:27:00 AM
Methylene chloride	U	0.08	1.0		µg/L	1	8/21/2008 7:27:00 AM
Naphthalene	U	0.08	1.0	C	µg/L	1	8/21/2008 7:27:00 AM
n-Butylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 7:27:00 AM
n-Propylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 7:27:00 AM
o-Xylene	U	0.1	1.0		µg/L	1	8/21/2008 7:27:00 AM
sec-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 7:27:00 AM
Styrene	U	0.08	1.0		µg/L	1	8/21/2008 7:27:00 AM
tert-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 7:27:00 AM
Tetrachloroethene	2.5	0.12	1.0		µg/L	1	8/21/2008 7:27:00 AM
Toluene	U	0.12	1.0		µg/L	1	8/21/2008 7:27:00 AM
trans-1,2-Dichloroethene	U	0.12	1.0		µg/L	1	8/21/2008 7:27:00 AM
trans-1,3-Dichloropropene	U	0.07	1.0		µg/L	1	8/21/2008 7:27:00 AM
Trichloroethene	U	0.13	1.0		µg/L	1	8/21/2008 7:27:00 AM
Trichlorofluoromethane	U	0.15	1.0		µg/L	1	8/21/2008 7:27:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 22-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ081208:1230NP2-6

Lab Order: 0808216

Collection Date: 8/12/2008 12:30:00 PM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808216-01A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
Vinyl acetate	U	0.06	1.0	C	µg/L	1	8/21/2008 7:27:00 AM
Vinyl chloride	U	0.14	1.0	C	µg/L	1	8/21/2008 7:27:00 AM
Surr: 4-Bromofluorobenzene	89.3	0	54-134		%REC	1	8/21/2008 7:27:00 AM
Surr: Dibromofluoromethane	74.2	0	52-132		%REC	1	8/21/2008 7:27:00 AM
Surr: Toluene-d8	96.8	0	51-127		%REC	1	8/21/2008 7:27:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
LOQ		Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 22-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808216
Project: Rowe
Lab ID: 0808216-01B

Client Sample ID: WQ081208:1230NP2-6
Collection Date: 8/12/2008 12:30:00 PM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL IRON			E200.7		SW3010A		Analyst: JP
Iron	2.88	0.005	0.0200		mg/L	1	8/20/2008 10:17:52 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 22-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ081208:1230NP2-6

Lab Order: 0808216

Collection Date: 8/12/2008 12:30:00 PM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808216-01C

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
DISSOLVED IRON				E200.7	SW3010A		Analyst: JP
Iron	0.0324	0.005	0.0200		mg/L	1	8/20/2008 10:15:48 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 22-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808216
Project: Rowe
Lab ID: 0808216-02A

Client Sample ID: WQ081208:1235NP2-7
Collection Date: 8/12/2008 12:35:00 PM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B		Analyst: LA		
1,1,1,2-Tetrachloroethane	U	0.09	1.0		µg/L	1	8/21/2008 7:54:00 AM
1,1,1-Trichloroethane	U	0.17	1.0		µg/L	1	8/21/2008 7:54:00 AM
1,1,2,2-Tetrachloroethane	U	0.06	1.0		µg/L	1	8/21/2008 7:54:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	0.13	1.0		µg/L	1	8/21/2008 7:54:00 AM
1,1,2-Trichloroethane	U	0.07	1.0		µg/L	1	8/21/2008 7:54:00 AM
1,1-Dichloroethane	U	0.11	1.0		µg/L	1	8/21/2008 7:54:00 AM
1,1-Dichloroethene	U	0.15	1.0		µg/L	1	8/21/2008 7:54:00 AM
1,1-Dichloropropene	U	0.12	1.0		µg/L	1	8/21/2008 7:54:00 AM
1,2,3-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 7:54:00 AM
1,2,3-Trichloropropane	U	0.08	1.0		µg/L	1	8/21/2008 7:54:00 AM
1,2,4-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 7:54:00 AM
1,2,4-Trimethylbenzene	U	0.09	1.0		µg/L	1	8/21/2008 7:54:00 AM
1,2-Dibromo-3-chloropropane	U	0.09	1.0		µg/L	1	8/21/2008 7:54:00 AM
1,2-Dibromoethane	U	0.06	1.0		µg/L	1	8/21/2008 7:54:00 AM
1,2-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 7:54:00 AM
1,2-Dichloroethane	U	0.08	1.0		µg/L	1	8/21/2008 7:54:00 AM
1,2-Dichloropropane	U	0.1	1.0		µg/L	1	8/21/2008 7:54:00 AM
1,3,5-Trimethylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 7:54:00 AM
1,3-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 7:54:00 AM
1,3-dichloropropane	U	0.08	1.0		µg/L	1	8/21/2008 7:54:00 AM
1,4-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 7:54:00 AM
2,2-Dichloropropane	U	0.11	1.0		µg/L	1	8/21/2008 7:54:00 AM
2-Butanone	U	1.28	3.0		µg/L	1	8/21/2008 7:54:00 AM
2-Chloroethyl vinyl ether	U	0.08	1.0	C	µg/L	1	8/21/2008 7:54:00 AM
2-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 7:54:00 AM
2-Hexanone	U	0.22	2.0		µg/L	1	8/21/2008 7:54:00 AM
4-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 7:54:00 AM
4-Isopropyltoluene	U	0.1	1.0		µg/L	1	8/21/2008 7:54:00 AM
4-Methyl-2-pentanone	U	0.21	2.0		µg/L	1	8/21/2008 7:54:00 AM
Acetone	U	0.19	2.0		µg/L	1	8/21/2008 7:54:00 AM
Benzene	U	0.11	1.0		µg/L	1	8/21/2008 7:54:00 AM
Bromobenzene	U	0.07	1.0		µg/L	1	8/21/2008 7:54:00 AM
Bromochloromethane	U	0.4	1.0		µg/L	1	8/21/2008 7:54:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 22-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808216
Project: Rowe
Lab ID: 0808216-02A

Client Sample ID: WQ081208:1235NP2-7
Collection Date: 8/12/2008 12:35:00 PM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B		Analyst: LA		
Bromodichloromethane	U	0.08	1.0		µg/L	1	8/21/2008 7:54:00 AM
Bromoform	U	0.06	1.0		µg/L	1	8/21/2008 7:54:00 AM
Bromomethane	U	0.17	1.0		µg/L	1	8/21/2008 7:54:00 AM
Carbon disulfide	U	0.14	1.0		µg/L	1	8/21/2008 7:54:00 AM
Carbon tetrachloride	U	0.16	1.0		µg/L	1	8/21/2008 7:54:00 AM
Chlorobenzene	U	0.09	1.0		µg/L	1	8/21/2008 7:54:00 AM
Chloroethane	U	0.16	1.0		µg/L	1	8/21/2008 7:54:00 AM
Chloroform	U	0.1	1.0		µg/L	1	8/21/2008 7:54:00 AM
Chloromethane	U	0.18	1.0	C	µg/L	1	8/21/2008 7:54:00 AM
cis-1,2-Dichloroethene	U	0.11	1.0		µg/L	1	8/21/2008 7:54:00 AM
cis-1,3-Dichloropropene	U	0.08	1.0		µg/L	1	8/21/2008 7:54:00 AM
Dibromochloromethane	U	0.07	1.0		µg/L	1	8/21/2008 7:54:00 AM
Dibromomethane	U	0.07	1.0		µg/L	1	8/21/2008 7:54:00 AM
Dichlorodifluoromethane	U	0.15	1.0		µg/L	1	8/21/2008 7:54:00 AM
Ethylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 7:54:00 AM
Hexachlorobutadiene	U	0.12	1.0		µg/L	1	8/21/2008 7:54:00 AM
Isopropylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 7:54:00 AM
m,p-Xylene	U	0.2	2.0		µg/L	1	8/21/2008 7:54:00 AM
Methyl tert-butyl ether	U	0.08	1.0		µg/L	1	8/21/2008 7:54:00 AM
Methylene chloride	U	0.08	1.0		µg/L	1	8/21/2008 7:54:00 AM
Naphthalene	U	0.08	1.0		µg/L	1	8/21/2008 7:54:00 AM
n-Butylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 7:54:00 AM
n-Propylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 7:54:00 AM
o-Xylene	U	0.1	1.0		µg/L	1	8/21/2008 7:54:00 AM
sec-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 7:54:00 AM
Styrene	U	0.08	1.0		µg/L	1	8/21/2008 7:54:00 AM
tert-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 7:54:00 AM
Tetrachloroethene	U	0.12	1.0		µg/L	1	8/21/2008 7:54:00 AM
Toluene	U	0.12	1.0		µg/L	1	8/21/2008 7:54:00 AM
trans-1,2-Dichloroethene	U	0.12	1.0		µg/L	1	8/21/2008 7:54:00 AM
trans-1,3-Dichloropropene	U	0.07	1.0		µg/L	1	8/21/2008 7:54:00 AM
Trichloroethene	U	0.13	1.0		µg/L	1	8/21/2008 7:54:00 AM
Trichlorofluoromethane	U	0.15	1.0		µg/L	1	8/21/2008 7:54:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 22-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ081208:1235NP2-7

Lab Order: 0808216

Collection Date: 8/12/2008 12:35:00 PM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808216-02A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
Vinyl acetate	U	0.06	1.0		µg/L	1	8/21/2008 7:54:00 AM
Vinyl chloride	U	0.14	1.0		µg/L	1	8/21/2008 7:54:00 AM
Surr: 4-Bromofluorobenzene	81.0	0	54-134		%REC	1	8/21/2008 7:54:00 AM
Surr: Dibromofluoromethane	77.1	0	52-132		%REC	1	8/21/2008 7:54:00 AM
Surr: Toluene-d8	103	0	51-127		%REC	1	8/21/2008 7:54:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 22-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ081208:1235NP2-7

Lab Order: 0808216

Collection Date: 8/12/2008 12:35:00 PM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808216-02B

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL IRON				E200.7	SW3010A		Analyst: JP
Iron	1.67	0.005	0.0200		mg/L	1	8/20/2008 10:21:56 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
LOQ	Limit of Quantitation	ND Not Detected at the Reporting Limit
S	Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
C	Calibration %RSD/%D exceeded for non-CCC analytes	

American Analytical Laboratories, LLC.

Date: 22-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ081208:1235NP2-7

Lab Order: 0808216

Collection Date: 8/12/2008 12:35:00 PM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808216-02C

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
DISSOLVED IRON			E200.7		SW3010A		Analyst: JP
Iron	0.171	0.005	0.0200		mg/L	1	8/20/2008 10:19:54 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 22-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808216
Project: Rowe
Lab ID: 0808216-03A

Client Sample ID: WQ081208:1240NP2-10
Collection Date: 8/12/2008 12:40:00 PM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
1,1,1,2-Tetrachloroethane	U	0.09	1.0		µg/L	1	8/21/2008 8:21:00 AM
1,1,1-Trichloroethane	U	0.17	1.0	C	µg/L	1	8/21/2008 8:21:00 AM
1,1,2,2-Tetrachloroethane	U	0.06	1.0	C	µg/L	1	8/21/2008 8:21:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	0.13	1.0		µg/L	1	8/21/2008 8:21:00 AM
1,1,2-Trichloroethane	U	0.07	1.0		µg/L	1	8/21/2008 8:21:00 AM
1,1-Dichloroethane	U	0.11	1.0		µg/L	1	8/21/2008 8:21:00 AM
1,1-Dichloroethene	U	0.15	1.0		µg/L	1	8/21/2008 8:21:00 AM
1,1-Dichloropropene	U	0.12	1.0		µg/L	1	8/21/2008 8:21:00 AM
1,2,3-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 8:21:00 AM
1,2,3-Trichloropropane	U	0.08	1.0	C	µg/L	1	8/21/2008 8:21:00 AM
1,2,4-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 8:21:00 AM
1,2,4-Trimethylbenzene	U	0.09	1.0		µg/L	1	8/21/2008 8:21:00 AM
1,2-Dibromo-3-chloropropane	U	0.09	1.0	C	µg/L	1	8/21/2008 8:21:00 AM
1,2-Dibromoethane	U	0.06	1.0	C	µg/L	1	8/21/2008 8:21:00 AM
1,2-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 8:21:00 AM
1,2-Dichloroethane	U	0.08	1.0	C	µg/L	1	8/21/2008 8:21:00 AM
1,2-Dichloropropane	U	0.1	1.0		µg/L	1	8/21/2008 8:21:00 AM
1,3,5-Trimethylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 8:21:00 AM
1,3-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 8:21:00 AM
1,3-dichloropropane	U	0.08	1.0		µg/L	1	8/21/2008 8:21:00 AM
1,4-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 8:21:00 AM
2,2-Dichloropropane	U	0.11	1.0		µg/L	1	8/21/2008 8:21:00 AM
2-Butanone	U	1.28	3.0		µg/L	1	8/21/2008 8:21:00 AM
2-Chloroethyl vinyl ether	U	0.08	1.0	C	µg/L	1	8/21/2008 8:21:00 AM
2-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 8:21:00 AM
2-Hexanone	U	0.22	2.0		µg/L	1	8/21/2008 8:21:00 AM
4-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 8:21:00 AM
4-Isopropyltoluene	U	0.1	1.0		µg/L	1	8/21/2008 8:21:00 AM
4-Methyl-2-pentanone	U	0.21	2.0		µg/L	1	8/21/2008 8:21:00 AM
Acetone	U	0.19	2.0		µg/L	1	8/21/2008 8:21:00 AM
Benzene	U	0.11	1.0		µg/L	1	8/21/2008 8:21:00 AM
Bromobenzene	U	0.07	1.0		µg/L	1	8/21/2008 8:21:00 AM
Bromochloromethane	U	0.4	1.0		µg/L	1	8/21/2008 8:21:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
	LOQ Limit of Quantitation	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
	C Calibration %RSD/%D exceeded for non-CCC analytes	

American Analytical Laboratories, LLC.

Date: 22-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808216
Project: Rowe
Lab ID: 0808216-03A

Client Sample ID: WQ081208:1240NP2-10
Collection Date: 8/12/2008 12:40:00 PM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
Bromodichloromethane	U	0.08	1.0		µg/L	1	8/21/2008 8:21:00 AM
Bromoform	U	0.06	1.0		µg/L	1	8/21/2008 8:21:00 AM
Bromomethane	U	0.17	1.0	C	µg/L	1	8/21/2008 8:21:00 AM
Carbon disulfide	U	0.14	1.0		µg/L	1	8/21/2008 8:21:00 AM
Carbon tetrachloride	U	0.16	1.0		µg/L	1	8/21/2008 8:21:00 AM
Chlorobenzene	U	0.09	1.0		µg/L	1	8/21/2008 8:21:00 AM
Chloroethane	U	0.16	1.0		µg/L	1	8/21/2008 8:21:00 AM
Chloroform	U	0.1	1.0		µg/L	1	8/21/2008 8:21:00 AM
Chloromethane	U	0.18	1.0		µg/L	1	8/21/2008 8:21:00 AM
cis-1,2-Dichloroethene	U	0.11	1.0	C	µg/L	1	8/21/2008 8:21:00 AM
cis-1,3-Dichloropropene	U	0.08	1.0		µg/L	1	8/21/2008 8:21:00 AM
Dibromochloromethane	U	0.07	1.0		µg/L	1	8/21/2008 8:21:00 AM
Dibromomethane	U	0.07	1.0		µg/L	1	8/21/2008 8:21:00 AM
Dichlorodifluoromethane	U	0.15	1.0	C	µg/L	1	8/21/2008 8:21:00 AM
Ethylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 8:21:00 AM
Hexachlorobutadiene	U	0.12	1.0		µg/L	1	8/21/2008 8:21:00 AM
Isopropylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 8:21:00 AM
m,p-Xylene	U	0.2	2.0		µg/L	1	8/21/2008 8:21:00 AM
Methyl tert-butyl ether	U	0.08	1.0		µg/L	1	8/21/2008 8:21:00 AM
Methylene chloride	U	0.08	1.0		µg/L	1	8/21/2008 8:21:00 AM
Naphthalene	U	0.08	1.0	C	µg/L	1	8/21/2008 8:21:00 AM
n-Butylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 8:21:00 AM
n-Propylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 8:21:00 AM
o-Xylene	U	0.1	1.0		µg/L	1	8/21/2008 8:21:00 AM
sec-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 8:21:00 AM
Styrene	U	0.08	1.0		µg/L	1	8/21/2008 8:21:00 AM
tert-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 8:21:00 AM
Tetrachloroethene	U	0.12	1.0		µg/L	1	8/21/2008 8:21:00 AM
Toluene	U	0.12	1.0		µg/L	1	8/21/2008 8:21:00 AM
trans-1,2-Dichloroethene	U	0.12	1.0		µg/L	1	8/21/2008 8:21:00 AM
trans-1,3-Dichloropropene	U	0.07	1.0		µg/L	1	8/21/2008 8:21:00 AM
Trichloroethene	U	0.13	1.0		µg/L	1	8/21/2008 8:21:00 AM
Trichlorofluoromethane	U	0.15	1.0		µg/L	1	8/21/2008 8:21:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 22-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808216
Project: Rowe
Lab ID: 0808216-03A

Client Sample ID: WQ081208:1240NP2-10
Collection Date: 8/12/2008 12:40:00 PM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B		Analyst: LA		
Vinyl acetate	U	0.06	1.0	C	µg/L	1	8/21/2008 8:21:00 AM
Vinyl chloride	U	0.14	1.0	C	µg/L	1	8/21/2008 8:21:00 AM
Surr: 4-Bromofluorobenzene	94.2	0	54-134		%REC	1	8/21/2008 8:21:00 AM
Surr: Dibromofluoromethane	70.5	0	52-132		%REC	1	8/21/2008 8:21:00 AM
Surr: Toluene-d8	95.3	0	51-127		%REC	1	8/21/2008 8:21:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 22-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808216
Project: Rowe
Lab ID: 0808216-03B

Client Sample ID: WQ081208:1240NP2-10
Collection Date: 8/12/2008 12:40:00 PM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL IRON			E200.7		SW3010A		Analyst: JP
Iron	1.42	0.005	0.0200		mg/L	1	8/20/2008 10:26:02 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 22-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ081208:1240NP2-10

Lab Order: 0808216

Collection Date: 8/12/2008 12:40:00 PM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808216-03C

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
DISSOLVED IRON				E200.7	SW3010A		Analyst: JP
Iron	0.131	0.005	0.0200		mg/L	1	8/20/2008 10:23:59 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 22-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ081208:1240NP2-10

Lab Order: 0808216

Collection Date: 8/12/2008 12:40:00 PM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808216-03D

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL DISSOLVED SOLIDS				M2540C			Analyst: AS
Total Dissolved Solids (Residue, Filterable)	113	0	1.00		mg/L	1	8/18/2008

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 22-Aug-08

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808216
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: V624LCS-082008aY		SampType: LCS		TestCode: 8260MTBE11		Units: µg/L		Prep Date:		RunNo: 37828	
Client ID: LCSW		Batch ID: R37828		TestNo: SW8260B				Analysis Date: 8/21/2008		SeqNo: 498257	
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,1,1-Trichloroethane	45	1.0	50.00	0	90.5	43	148				C
1,1,2,2-Tetrachloroethane	36	1.0	50.00	0	72.0	32	148				C
1,1,2-Trichloroethane	40	1.0	50.00	0	80.1	42	136				
1,1-Dichloroethane	40	1.0	50.00	0	79.2	40	150				
1,1-Dichloroethene	56	1.0	50.00	0	112	30	154				
1,2-Dichlorobenzene	44	1.0	50.00	0	88.5	40	129				C
1,2-Dichloroethane	49	1.0	50.00	0	98.0	36	141				
1,2-Dichloropropane	40	1.0	50.00	0	79.6	44	138				
1,3-Dichlorobenzene	47	1.0	50.00	0	93.0	40	133				
1,4-Dichlorobenzene	45	1.0	50.00	0	90.7	40	135				
2-Butanone	85	3.0	125.0	0	67.8	35	135				
2-Chloroethyl vinyl ether	32	1.0	50.00	0	64.9	21	139				C
2-Hexanone	100	2.0	125.0	0	82.3	35	135				
4-Methyl-2-pentanone	120	2.0	125.0	0	93.1	35	135				
Acetone	88	2.0	125.0	0	70.2	35	135				
Benzene	39	1.0	50.00	0	78.4	45	144				
Bromodichloromethane	46	1.0	50.00	0	91.4	35	136				
Bromoform	48	1.0	50.00	0	95.1	28	138				
Bromomethane	60	1.0	50.00	0	120	26	148				C
Carbon tetrachloride	45	1.0	50.00	0	89.6	45	141				
Chlorobenzene	48	1.0	50.00	0	96.4	41	142				
Chloroethane	38	1.0	50.00	0	76.9	36	143				
Chloroform	40	1.0	50.00	0	80.7	42	137				
Chloromethane	40	1.0	50.00	0	79.9	35	151				
cis-1,3-Dichloropropene	42	1.0	50.00	0	83.5	42	130				
Dibromochloromethane	39	1.0	50.00	0	78.6	21	134				
Ethylbenzene	48	1.0	50.00	0	96.5	45	146				
Tetrachloroethene	48	1.0	50.00	0	96.2	45	136				
Toluene	49	1.0	50.00	0	98.6	43	134				
trans-1,2-Dichloroethene	40	1.0	50.00	0	80.5	42	135				

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
LOD		Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
R		RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808216
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: V624LCS-082008aY		SampType: LCS		TestCode: 8260MTBE11		Units: µg/L		Prep Date:		RunNo: 37828		
Client ID: LCSW		Batch ID: R37828		TestNo: SW8260B				Analysis Date: 8/21/2008		SeqNo: 498257		
Analyte		Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
trans-1,3-Dichloropropene		45	1.0	50.00	0	90.8	37	133				
Trichloroethene		49	1.0	50.00	0	97.8	43	140				
Trichlorofluoromethane		49	1.0	50.00	0	97.7	50	148				
Vinyl chloride		44	1.0	50.00	0	88.2	35	142				C
Surr: 4-Bromofluorobenzene		46		50.00		92.9	54	134				
Surr: Dibromofluoromethane		38		50.00		76.7	52	132				
Surr: Toluene-d8		50		50.00		101	51	127				

Sample ID: VBLK082008aY		SampType: MBLK		TestCode: 8260MTBE11		Units: µg/L		Prep Date:		RunNo: 37828		
Client ID: PBW		Batch ID: R37828		TestNo: SW8260B				Analysis Date: 8/21/2008		SeqNo: 498258		
Analyte		Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,1,1,2-Tetrachloroethane		U	1.0									C
1,1,1-Trichloroethane		U	1.0									C
1,1,2,2-Tetrachloroethane		U	1.0									
1,1,2-Trichloro-1,2,2-trifluoroethane		U	1.0									
1,1,2-Trichloroethane		U	1.0									
1,1-Dichloroethane		U	1.0									
1,1-Dichloroethene		U	1.0									
1,1-Dichloropropene		U	1.0									
1,2,3-Trichlorobenzene		U	1.0									C
1,2,3-Trichloropropane		U	1.0									
1,2,4-Trichlorobenzene		U	1.0									
1,2,4-Trimethylbenzene		U	1.0									C
1,2-Dibromo-3-chloropropane		U	1.0									
1,2-Dibromoethane		U	1.0									C
1,2-Dichlorobenzene		U	1.0									
1,2-Dichloroethane		U	1.0									C
1,2-Dichloropropane		U	1.0									
1,3,5-Trimethylbenzene		U	1.0									C
1,3-Dichlorobenzene		U	1.0									

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
NID Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808216
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: VBLK082008aY		SampType: MBLK		TestCode: 8260MTBE11		Units: µg/L		Prep Date:		RunNo: 37828		
Client ID: PBW		Batch ID: R37828		TestNo: SW8260B				Analysis Date: 8/21/2008		SeqNo: 498258		
Analyte		Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,3-dichloropropane		U	1.0									
1,4-Dichlorobenzene		U	1.0									
2,2-Dichloropropane		U	1.0									
2-Butanone		U	3.0									
2-Chloroethyl vinyl ether		U	1.0									C
2-Chlorotoluene		U	1.0									
2-Hexanone		U	2.0									
4-Chlorotoluene		U	1.0									
4-Isopropyltoluene		U	1.0									
4-Methyl-2-pentanone		U	2.0									
Acetone		U	2.0									
Benzene		U	1.0									
Bromobenzene		U	1.0									
Bromochloromethane		U	1.0									
Bromodichloromethane		U	1.0									
Bromoform		U	1.0									C
Bromomethane		U	1.0									
Carbon disulfide		U	1.0									
Carbon tetrachloride		U	1.0									
Chlorobenzene		U	1.0									
Chloroethane		U	1.0									
Chloroform		U	1.0									
Chloromethane		U	1.0									
cis-1,2-Dichloroethene		U	1.0									C
cis-1,3-Dichloropropene		U	1.0									
Dibromochloromethane		U	1.0									
Dibromomethane		U	1.0									
Dichlorodifluoromethane		U	1.0									C
Ethylbenzene		U	1.0									
Hexachlorobutadiene		U	1.0									
Isopropylbenzene		U	1.0									

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808216
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: VBLK082008aY	SampType: MBLK	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37828						
Client ID: PBW	Batch ID: R37828	TestNo: SW8260B		Analysis Date: 8/21/2008	SeqNo: 498258						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

m,p-Xylene	U	2.0									
Methyl tert-butyl ether	U	1.0									
Methylene chloride	U	1.0									
Naphthalene	U	1.0									
n-Butylbenzene	U	1.0									
n-Propylbenzene	U	1.0									
o-Xylene	U	1.0									
sec-Butylbenzene	U	1.0									
Styrene	U	1.0									
tert-Butylbenzene	U	1.0									
Tetrachloroethene	U	1.0									
Toluene	U	1.0									
trans-1,2-Dichloroethene	U	1.0									
trans-1,3-Dichloropropene	U	1.0									
Trichloroethene	U	1.0									
Trichlorofluoromethane	U	1.0									
Vinyl acetate	U	1.0									
Vinyl chloride	U	1.0									
Surr: 4-Bromofluorobenzene	49		50.00		97.8	54	134				C
Surr: Dibromofluoromethane	38		50.00		76.2	52	132				C
Surr: Toluene-d8	46		50.00		91.4	51	127				

Sample ID: 0808216-03AMSD	SampType: MSD	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37828						
Client ID: WQ081208:1240NP2	Batch ID: R37828	TestNo: SW8260B		Analysis Date: 8/21/2008	SeqNo: 498261						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

1,1,1-Trichloroethane	35	1.0	50.00	0	69.3	43	148				C
1,1,2,2-Tetrachloroethane	25	1.0	50.00	0	49.6	32	148				C
1,1,2-Trichloroethane	26	1.0	50.00	0	52.0	42	136				
1,1-Dichloroethane	28	1.0	50.00	0	55.4	40	150				
1,1-Dichloroethene	42	1.0	50.00	0	84.1	30	154				

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808216
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: 0808216-03AMSD		SampType: MSD	TestCode: 8260MTBE11		Units: µg/L	Prep Date:		RunNo: 37828			
Client ID: WQ081208:1240NP2		Batch ID: R37828	TestNo: SW8260B			Analysis Date: 8/21/2008		SeqNo: 498261			
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,2-Dichlorobenzene	33	1.0	50.00	0	65.8	40	129				C
1,2-Dichloroethane	36	1.0	50.00	0	72.6	36	141				
1,2-Dichloropropane	27	1.0	50.00	0	53.2	44	138				
1,3-Dichlorobenzene	33	1.0	50.00	0	66.1	40	133				SC
1,4-Dichlorobenzene	35	1.0	50.00	0	71.0	40	135				
2-Butanone	40	3.0	50.00	0	79.4	35	135				
2-Chloroethyl vinyl ether	76	1.0	50.00	0	151	21	139				C
2-Hexanone	51	2.0	50.00	0	101	35	135				
4-Methyl-2-pentanone	60	2.0	50.00	0	120	35	135				
Acetone	47	2.0	50.00	0	94.2	35	135				C
Benzene	29	1.0	50.00	0	57.4	45	144				
Bromodichloromethane	31	1.0	50.00	0	61.6	35	136				
Bromoform	34	1.0	50.00	0	68.1	28	138				C
Bromomethane	42	1.0	50.00	0	84.4	26	148				
Carbon tetrachloride	34	1.0	50.00	0	67.5	45	141				
Chlorobenzene	35	1.0	50.00	0	69.3	41	142				C
Chloroethane	29	1.0	50.00	0	58.1	36	143				
Chloroform	29	1.0	50.00	0	57.9	42	137				
Chloromethane	28	1.0	50.00	0	55.4	35	151				C
cis-1,3-Dichloropropene	27	1.0	50.00	0	53.4	42	130				
Dibromochloromethane	25	1.0	50.00	0	50.2	21	134				
Ethylbenzene	33	1.0	50.00	0	66.4	45	146				C
Tetrachloroethene	34	1.0	50.00	0	68.8	45	136				
Toluene	33	1.0	50.00	0	65.7	43	134				
trans-1,2-Dichloroethene	27	1.0	50.00	0	54.8	42	135				C
trans-1,3-Dichloropropene	31	1.0	50.00	0	61.3	37	133				
Trichloroethene	32	1.0	50.00	0	64.4	43	140				
Trichlorofluoromethane	35	1.0	50.00	0	69.5	50	148				C
Vinyl chloride	30	1.0	50.00	0	60.2	35	142				
Surr: 4-Bromofluorobenzene	44		50.00		88.1	54	134				
Surr: Dibromofluoromethane	39		50.00		77.4	52	132				

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analytic detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808216
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: 0808216-03AMSD	Sample Type: MSD	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37828						
Client ID: WQ081208-1240NP2	Batch ID: R37828	TestNo: SW8260B		Analysis Date: 8/21/2008	SeqNo: 498261						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Sample ID: V624LCS-082008aY	Sample Type: LCS	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37828						
Client ID: LCSW	Batch ID: R37828a	TestNo: SW8260B		Analysis Date: 8/21/2008	SeqNo: 498334						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

1,1,1-Trichloroethane	52	1.0	50.00	0	105	43	148				
1,1,2,2-Tetrachloroethane	38	1.0	50.00	0	76.0	32	148				
1,1,2-Trichloroethane	45	1.0	50.00	0	89.1	42	136				
1,1-Dichloroethane	44	1.0	50.00	0	87.2	40	150				
1,1-Dichloroethene	68	1.0	50.00	0	137	30	154				
1,2-Dichlorobenzene	46	1.0	50.00	0	92.5	40	129				
1,2-Dichloroethane	52	1.0	50.00	0	105	36	141				
1,2-Dichloropropane	42	1.0	50.00	0	83.4	44	138				
1,3-Dichlorobenzene	47	1.0	50.00	0	94.4	40	133				
1,4-Dichlorobenzene	48	1.0	50.00	0	95.1	40	135				
2-Butanone	100	3.0	125.0	0	80.0	35	135				
2-Chloroethyl vinyl ether	35	1.0	50.00	0	70.1	21	139				C
2-Hexanone	110	2.0	125.0	0	85.4	35	135				
4-Methyl-2-pentanone	110	2.0	125.0	0	91.2	35	135				
Acetone	120	2.0	125.0	0	92.2	35	135				
Benzene	43	1.0	50.00	0	85.3	45	144				
Bromodichloromethane	50	1.0	50.00	0	100	35	136				
Bromoform	47	1.0	50.00	0	93.6	28	138				
Bromomethane	46	1.0	50.00	0	92.3	26	148				
Carbon tetrachloride	50	1.0	50.00	0	101	45	141				
Chlorobenzene	50	1.0	50.00	0	99.5	41	142				
Chloroethane	46	1.0	50.00	0	92.6	36	143				
Chloroform	45	1.0	50.00	0	90.4	42	137				
Chloromethane	46	1.0	50.00	0	91.5	35	151				C
cis-1,3-Dichloropropene	44	1.0	50.00	0	87.7	42	130				

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits
H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits
J Analyte detected below quantitation limit
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808216
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: V624LCS-082008aY		SampType: LCS		TestCode: 8260MTBE11		Units: µg/L		Prep Date:		RunNo: 37828	
Client ID: LCSW		Batch ID: R37828a		TestNo: SW8260B				Analysis Date: 8/21/2008		SeqNo: 498334	
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Dibromochloromethane	43	1.0	50.00	0	85.2	21	134				
Ethylbenzene	49	1.0	50.00	0	97.4	45	146				
Tetrachloroethene	49	1.0	50.00	0	97.8	45	136				
Toluene	52	1.0	50.00	0	105	43	134				
trans-1,2-Dichloroethene	43	1.0	50.00	0	85.4	42	135				
trans-1,3-Dichloropropene	46	1.0	50.00	0	92.8	37	133				
Trichloroethene	52	1.0	50.00	0	104	43	140				
Trichlorofluoromethane	62	1.0	50.00	0	124	50	148				
Vinyl chloride	51	1.0	50.00	0	102	35	142				
Surr: 4-Bromofluorobenzene	46		50.00		92.6	54	134				
Surr: Dibromofluoromethane	39		50.00		78.5	52	132				
Surr: Toluene-d8	51		50.00		101	51	127				

Sample ID: VBLK082008aY		SampType: MBLK		TestCode: 8260MTBE11		Units: µg/L		Prep Date:		RunNo: 37828	
Client ID: PBW		Batch ID: R37828a		TestNo: SW8260B				Analysis Date: 8/21/2008		SeqNo: 498335	
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,1,1,2-Tetrachloroethane	U	1.0									
1,1,1-Trichloroethane	U	1.0									
1,1,2,2-Tetrachloroethane	U	1.0									
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0									
1,1,2-Trichloroethane	U	1.0									
1,1-Dichloroethane	U	1.0									
1,1-Dichloroethene	U	1.0									
1,1-Dichloropropene	U	1.0									
1,2,3-Trichlorobenzene	U	1.0									
1,2,3-Trichloropropane	U	1.0									
1,2,4-Trichlorobenzene	U	1.0									
1,2,4-Trimethylbenzene	U	1.0									
1,2-Dibromo-3-chloropropane	U	1.0									
1,2-Dibromoethane	U	1.0									

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808216
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: VBLK082008aY	SampleType: MBLK	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37828						
Client ID: PBW	Batch ID: R37828a	TestNo: SW8260B		Analysis Date: 8/21/2008	SeqNo: 498335						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,2-Dichlorobenzene	U	1.0									
1,2-Dichloroethane	U	1.0									
1,2-Dichloropropane	U	1.0									
1,3,5-Trimethylbenzene	U	1.0									
1,3-Dichlorobenzene	U	1.0									
1,3-dichloropropane	U	1.0									
1,4-Dichlorobenzene	U	1.0									
2,2-Dichloropropane	U	1.0									
2-Butanone	U	3.0									
2-Chloroethyl vinyl ether	U	1.0									C
2-Chlorotoluene	U	1.0									
2-Hexanone	U	2.0									
4-Chlorotoluene	U	1.0									
4-Isopropyltoluene	U	1.0									
4-Methyl-2-pentanone	U	2.0									
Acetone	U	2.0									
Benzene	U	1.0									
Bromobenzene	U	1.0									
Bromochloromethane	U	1.0									
Bromodichloromethane	U	1.0									
Bromoform	U	1.0									
Bromomethane	U	1.0									
Carbon disulfide	U	1.0									
Carbon tetrachloride	U	1.0									
Chlorobenzene	U	1.0									
Chloroethane	U	1.0									
Chloroform	U	1.0									
Chloromethane	U	1.0									C
cis-1,2-Dichloroethene	U	1.0									
cis-1,3-Dichloropropene	U	1.0									
Dibromochloromethane	U	1.0									

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808216
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113 W

Sample ID: VBLK082008aY	SampType: MBLK	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37828						
Client ID: PBW	Batch ID: R37828a	TestNo: SW8260B		Analysis Date: 8/21/2008	SeqNo: 498335						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Dibromomethane	U	1.0									
Dichlorodifluoromethane	U	1.0									
Ethylbenzene	U	1.0									
Hexachlorobutadiene	U	1.0									
Isopropylbenzene	U	1.0									
m,p-Xylene	U	2.0									
Methyl tert-butyl ether	U	1.0									
Methylene chloride	U	1.0									
Naphthalene	U	1.0									
n-Butylbenzene	U	1.0									
n-Propylbenzene	U	1.0									
o-Xylene	U	1.0									
sec-Butylbenzene	U	1.0									
Styrene	U	1.0									
tert-Butylbenzene	U	1.0									
Tetrachloroethene	U	1.0									
Toluene	U	1.0									
trans-1,2-Dichloroethene	U	1.0									
trans-1,3-Dichloropropene	U	1.0									
Trichloroethene	U	1.0									
Trichlorofluoromethane	U	1.0									
Vinyl acetate	U	1.0									
Vinyl chloride	U	1.0									
Surr: 4-Bromofluorobenzene	46		50.00		93.0	54	134				
Surr: Dibromofluoromethane	40		50.00		79.3	52	132				
Surr: Toluene-d8	48		50.00		96.4	51	127				

Sample ID: 0808216-03AMS	SampType: MS	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37828						
Client ID: WQ081208:1240NP2	Batch ID: R37828a	TestNo: SW8260B		Analysis Date: 8/21/2008	SeqNo: 498337						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808216
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: 0808216-03AMS	SampType: MS	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37828						
Client ID: WQ081208:1240NP2	Batch ID: R37828a	TestNo: SW8260B		Analysis Date: 8/21/2008	SeqNo: 498337						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,1,1-Trichloroethane	39	1.0	50.00	0	77.7	43	148				
1,1,2,2-Tetrachloroethane	27	1.0	50.00	0	54.8	32	148				
1,1,2-Trichloroethane	29	1.0	50.00	0	58.0	42	136				
1,1-Dichloroethane	33	1.0	50.00	0	66.1	40	150				
1,1-Dichloroethene	55	1.0	50.00	0	111	30	154				
1,2-Dichlorobenzene	34	1.0	50.00	0	68.1	40	129				
1,2-Dichloroethane	41	1.0	50.00	0	82.4	36	141				
1,2-Dichloropropane	29	1.0	50.00	0	58.8	44	138				
1,3-Dichlorobenzene	36	1.0	50.00	0	71.3	40	133				
1,4-Dichlorobenzene	35	1.0	50.00	0	70.9	40	135				
2-Butanone	53	3.0	50.00	0	106	35	135				
2-Chloroethyl vinyl ether	43	1.0	50.00	0	85.2	21	139				C
2-Hexanone	63	2.0	50.00	0	126	35	135				
4-Methyl-2-pentanone	64	2.0	50.00	0	128	35	135				
Acetone	59	2.0	50.00	0	118	35	135				
Benzene	33	1.0	50.00	0	65.1	45	144				
Bromodichloromethane	37	1.0	50.00	0	73.8	35	136				
Bromoform	37	1.0	50.00	0	73.1	28	138				
Bromomethane	33	1.0	50.00	0	65.3	26	148				
Carbon tetrachloride	39	1.0	50.00	0	78.9	45	141				
Chlorobenzene	39	1.0	50.00	0	78.0	41	142				
Chloroethane	36	1.0	50.00	0	72.5	36	143				
Chloroform	33	1.0	50.00	0	66.9	42	137				
Chloromethane	35	1.0	50.00	0	70.2	35	151				
cis-1,3-Dichloropropene	31	1.0	50.00	0	61.1	42	130				C
Dibromochloromethane	30	1.0	50.00	0	60.6	21	134				
Ethylbenzene	39	1.0	50.00	0	77.8	45	146				
Tetrachloroethene	38	1.0	50.00	0	76.8	45	136				
Toluene	40	1.0	50.00	0	80.6	43	134				
trans-1,2-Dichloroethene	33	1.0	50.00	0	66.6	42	135				
trans-1,3-Dichloropropene	33	1.0	50.00	0	66.8	37	133				

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808216
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113 W

Sample ID: 0808216-03AMS		SampType: MS	TestCode: 8260MTBE11		Units: µg/L	Prep Date:		RunNo: 37828			
Client ID: WQ081208:1240NP2		Batch ID: R37828a	TestNo: SW8260B			Analysis Date: 8/21/2008		SeqNo: 498337			
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Trichloroethene	37	1.0	50.00	0	73.6	43	140				
Trichlorofluoromethane	48	1.0	50.00	0	96.2	50	148				
Vinyl chloride	38	1.0	50.00	0	76.3	35	142				
Surr: 4-Bromofluorobenzene	45		50.00		90.9	54	134				
Surr: Dibromofluoromethane	38		50.00		75.8	52	132				
Surr: Toluene-d8	49		50.00		97.8	51	127				

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808216
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: FE_D

Sample ID: PBW-081908A	SampType: MBLK	TestCode: FE_D	Units: mg/L	Prep Date:	RunNo: 37749						
Client ID: PBW	Batch ID: 22654	TestNo: E200.7	SW3010A	Analysis Date: 8/20/2008	SeqNo: 496211						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Iron	U	0.0200									

Sample ID: LCSW-081908A	SampleType: LCS	TestCode: FE_D	Units: mg/L	Prep Date:	RunNo: 37749						
Client ID: LCSW	Batch ID: 22654	TestNo: E200.7	SW3010A	Analysis Date: 8/20/2008	SeqNo: 496212						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Iron	1.96	0.0200	2.000	0	98.2	68	122				

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808216
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: FE_T

Sample ID: PBW-081908A	Sample Type: MBLK	TestCode: FE_T	Units: mg/L	Prep Date:	RunNo: 37749
Client ID: PBW	Batch ID: 22654	TestNo: E200.7	SW3010A	Analysis Date: 8/20/2008	SeqNo: 496130
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual
Iron	U	0.0200			

Sample ID: LCSW-081908A	Sample Type: LCS	TestCode: FE_T	Units: mg/L	Prep Date:	RunNo: 37749
Client ID: LCSW	Batch ID: 22654	TestNo: E200.7	SW3010A	Analysis Date: 8/20/2008	SeqNo: 496131
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual
Iron	1.96	0.0200	2.000	0	98.2 68 122

Sample ID: 0808217-08B-MS	Sample Type: MS	TestCode: FE_T	Units: mg/L	Prep Date: 8/19/2008	RunNo: 37749
Client ID: ZZZZZZ	Batch ID: 22654	TestNo: E200.7	SW3010A	Analysis Date: 8/20/2008	SeqNo: 496644
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual
Iron	2.50	0.0200	1.000	1.573	92.4 68 122

Sample ID: 0808217-08B-MSD	Sample Type: MSD	TestCode: FE_T	Units: mg/L	Prep Date: 8/19/2008	RunNo: 37749
Client ID: ZZZZZZ	Batch ID: 22654	TestNo: E200.7	SW3010A	Analysis Date: 8/20/2008	SeqNo: 496645
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual
Iron	2.50	0.0200	1.000	1.573	92.4 68 122 2.498 0.0132 20

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed


CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808216
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: TDS_W

Sample ID: MB-R37691	SampType: MBLK	TestCode: TDS_W	Units: mg/L	Prep Date:	RunNo: 37691					
Client ID: PBW	Batch ID: R37691	TestNo: M2540C		Analysis Date: 8/18/2008	SeqNo: 495380					
Analyte	Result	PQL	SPK value	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Total Dissolved Solids (Residue, Filtra		U	1.00							

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
	LOD	Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	R	RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

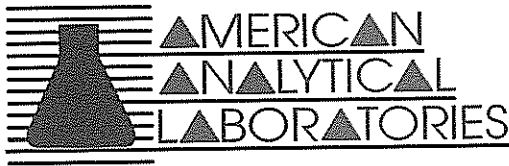

NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Tuesday, August 26, 2008

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe

Order No.: 0808312

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 8/21/2008 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The results reported herein relate only to the items tested or to the samples as received by the laboratory. This report may not be reproduced, except in full, without the approval of American Analytical Laboratories, LLC and is not considered complete without a cover page and chain of custody documentation. The limits (LOQ) provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report. This package has been reviewed by American Analytical Laboratories' QA Department/Laboratory Director to comply with NELAC standards prior to report submittal.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

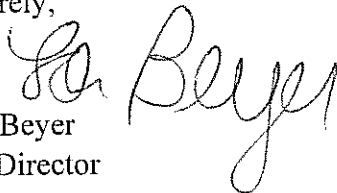
Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 26-Aug-08

CLIENT: Leggette Brashears & Graham Inc.**Project:** Rowe**Lab Order:** 0808312**Work Order Sample Summary**

Lab Sample ID	Client Sample ID	Date Collected	Date Received
0808312-01A	WQ081908:1100NP2-6	8/19/2008 11:00:00 AM	8/21/2008
0808312-01B	WQ081908:1100NP2-6	8/19/2008 11:00:00 AM	8/21/2008
0808312-01C	WQ081908:1100NP2-6	8/19/2008 11:00:00 AM	8/21/2008
0808312-02A	WQ081908:1105NP2-7	8/19/2008 11:05:00 AM	8/21/2008
0808312-02B	WQ081908:1105NP2-7	8/19/2008 11:05:00 AM	8/21/2008
0808312-02C	WQ081908:1105NP2-7	8/19/2008 11:05:00 AM	8/21/2008
0808312-03A	WQ081908:1110NP2-10	8/19/2008 11:10:00 AM	8/21/2008
0808312-03B	WQ081908:1110NP2-10	8/19/2008 11:10:00 AM	8/21/2008
0808312-03C	WQ081908:1110NP2-10	8/19/2008 11:10:00 AM	8/21/2008
0808312-03D	WQ081908:1110NP2-10	8/19/2008 11:10:00 AM	8/21/2008




56 TOLEDO STREET • FARMINGDALE, NEW YORK 11735
(631) 454-6100 • FAX (631) 454-8027

NYSDOH 11418
CTDOH PH-0205
NJDEP NY050
PADEP 68-573

TAG # / COC _____

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

CLIENT NAME/ADDRESS LB60 4 Research Dr. Suite 301 Stelton, NJ 08484				CONTACT: M. Goldberg		SAMPLER (SIGNATURE) 		SAMPLE(S) SEALED YES / NO	
PROJECT LOCATION: Rwoc				ANALYSIS REQUIRED 8260 + MTB6 TGT - DES EC TDS		SAMPLER NAME (PRINT) STEPHEN HNAT		CORRECT CONTAINER(S) YES / NO	
LABORATORY ID #	MATRIX	# CONTAINERS	SAMPLING DATE/TIME	SAMPLE # - LOCATION		FOR METHANOL PRESERVED SAMPLES [VOLATILE VIAL #]			
0808312-01AC	L	4	8/19/08 1100	WQ081908:1100NP2-6					
0808312-01AC	L	4	1105	WQ081908:1105NP2-7					
0808312-01AC	L	5	1110	WQ081908:1110NP2-10					
COOLER TEMPERATURE:						COMMENTS / INSTRUCTIONS			
MATRIX S=SOIL; L=LIQUID; SL=SLUDGE; A-AIR; W=WIFE; P=PAINT CHIPS; B=BULK MATERIAL TYPE G=GRAB; C=COMPOSITE, SS=SPLIT SPOON						TURNAROUND REQUIRED: NORMAL ☒ STAT ☐ BY / /			
RELINQUISHED BY (SIGNATURE) 		DATE 8-20-08 TIME 16:00		PRINTED NAME TONDE LOMUES - SANDOR		RECEIVED BY LAB (SIGNATURE) 		DATE 8/20/08 TIME 10:00	
RELINQUISHED BY (SIGNATURE)		DATE TIME		PRINTED NAME		RECEIVED BY LAB (SIGNATURE)		DATE TIME	

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100

FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value.
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of the method allowable holding time.

American Analytical Laboratories, LLC.

Date: 26-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808312
Project: Rowe
Lab ID: 0808312-01A

Client Sample ID: WQ081908:1100NP2-6
Collection Date: 8/19/2008 11:00:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: DM	
1,1,1,2-Tetrachloroethane	U	0.09	1.0		µg/L	1	8/23/2008 3:09:00 AM
1,1,1-Trichloroethane	1.6	0.17	1.0		µg/L	1	8/23/2008 3:09:00 AM
1,1,2,2-Tetrachloroethane	U	0.06	1.0	C	µg/L	1	8/23/2008 3:09:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	0.13	1.0		µg/L	1	8/23/2008 3:09:00 AM
1,1,2-Trichloroethane	U	0.07	1.0		µg/L	1	8/23/2008 3:09:00 AM
1,1-Dichloroethane	U	0.11	1.0		µg/L	1	8/23/2008 3:09:00 AM
1,1-Dichloroethene	U	0.15	1.0		µg/L	1	8/23/2008 3:09:00 AM
1,1-Dichloropropene	U	0.12	1.0		µg/L	1	8/23/2008 3:09:00 AM
1,2,3-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/23/2008 3:09:00 AM
1,2,3-Trichloropropane	U	0.08	1.0		µg/L	1	8/23/2008 3:09:00 AM
1,2,4-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/23/2008 3:09:00 AM
1,2,4-Trimethylbenzene	U	0.09	1.0		µg/L	1	8/23/2008 3:09:00 AM
1,2-Dibromo-3-chloropropane	U	0.09	1.0		µg/L	1	8/23/2008 3:09:00 AM
1,2-Dibromoethane	U	0.06	1.0		µg/L	1	8/23/2008 3:09:00 AM
1,2-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/23/2008 3:09:00 AM
1,2-Dichloroethane	U	0.08	1.0		µg/L	1	8/23/2008 3:09:00 AM
1,2-Dichloropropane	U	0.1	1.0		µg/L	1	8/23/2008 3:09:00 AM
1,3,5-Trimethylbenzene	U	0.11	1.0		µg/L	1	8/23/2008 3:09:00 AM
1,3-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/23/2008 3:09:00 AM
1,3-dichloropropane	U	0.08	1.0		µg/L	1	8/23/2008 3:09:00 AM
1,4-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/23/2008 3:09:00 AM
2,2-Dichloropropane	U	0.11	1.0		µg/L	1	8/23/2008 3:09:00 AM
2-Butanone	U	1.28	3.0		µg/L	1	8/23/2008 3:09:00 AM
2-Chloroethyl vinyl ether	U	0.08	1.0		µg/L	1	8/23/2008 3:09:00 AM
2-Chlorotoluene	U	0.09	1.0		µg/L	1	8/23/2008 3:09:00 AM
2-Hexanone	U	0.22	2.0		µg/L	1	8/23/2008 3:09:00 AM
4-Chlorotoluene	U	0.09	1.0		µg/L	1	8/23/2008 3:09:00 AM
4-Isopropyltoluene	U	0.1	1.0		µg/L	1	8/23/2008 3:09:00 AM
4-Methyl-2-pentanone	U	0.21	2.0		µg/L	1	8/23/2008 3:09:00 AM
Acetone	U	0.19	2.0		µg/L	1	8/23/2008 3:09:00 AM
Benzene	U	0.11	1.0		µg/L	1	8/23/2008 3:09:00 AM
Bromobenzene	U	0.07	1.0		µg/L	1	8/23/2008 3:09:00 AM
Bromochloromethane	U	0.4	1.0		µg/L	1	8/23/2008 3:09:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 26-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808312
Project: Rowe
Lab ID: 0808312-01A

Client Sample ID: WQ081908:1100NP2-6
Collection Date: 8/19/2008 11:00:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: DM	
Bromodichloromethane	U	0.08	1.0		µg/L	1	8/23/2008 3:09:00 AM
Bromoform	U	0.06	1.0		µg/L	1	8/23/2008 3:09:00 AM
Bromomethane	U	0.17	1.0		µg/L	1	8/23/2008 3:09:00 AM
Carbon disulfide	U	0.14	1.0		µg/L	1	8/23/2008 3:09:00 AM
Carbon tetrachloride	U	0.16	1.0		µg/L	1	8/23/2008 3:09:00 AM
Chlorobenzene	U	0.09	1.0		µg/L	1	8/23/2008 3:09:00 AM
Chloroethane	U	0.16	1.0		µg/L	1	8/23/2008 3:09:00 AM
Chloroform	U	0.1	1.0		µg/L	1	8/23/2008 3:09:00 AM
Chloromethane	U	0.18	1.0		µg/L	1	8/23/2008 3:09:00 AM
cis-1,2-Dichloroethene	U	0.11	1.0		µg/L	1	8/23/2008 3:09:00 AM
cis-1,3-Dichloropropene	U	0.08	1.0		µg/L	1	8/23/2008 3:09:00 AM
Dibromochloromethane	U	0.07	1.0		µg/L	1	8/23/2008 3:09:00 AM
Dibromomethane	U	0.07	1.0		µg/L	1	8/23/2008 3:09:00 AM
Dichlorodifluoromethane	U	0.15	1.0		µg/L	1	8/23/2008 3:09:00 AM
Ethylbenzene	U	0.1	1.0		µg/L	1	8/23/2008 3:09:00 AM
Hexachlorobutadiene	U	0.12	1.0		µg/L	1	8/23/2008 3:09:00 AM
Isopropylbenzene	U	0.11	1.0		µg/L	1	8/23/2008 3:09:00 AM
m,p-Xylene	U	0.2	2.0		µg/L	1	8/23/2008 3:09:00 AM
Methyl tert-butyl ether	U	0.08	1.0		µg/L	1	8/23/2008 3:09:00 AM
Methylene chloride	U	0.08	1.0		µg/L	1	8/23/2008 3:09:00 AM
Naphthalene	U	0.08	1.0	C	µg/L	1	8/23/2008 3:09:00 AM
n-Butylbenzene	U	0.11	1.0	C	µg/L	1	8/23/2008 3:09:00 AM
n-Propylbenzene	U	0.11	1.0		µg/L	1	8/23/2008 3:09:00 AM
o-Xylene	U	0.1	1.0		µg/L	1	8/23/2008 3:09:00 AM
sec-Butylbenzene	U	0.1	1.0		µg/L	1	8/23/2008 3:09:00 AM
Styrene	U	0.08	1.0		µg/L	1	8/23/2008 3:09:00 AM
tert-Butylbenzene	U	0.1	1.0		µg/L	1	8/23/2008 3:09:00 AM
Tetrachloroethene	2.4	0.12	1.0		µg/L	1	8/23/2008 3:09:00 AM
Toluene	U	0.12	1.0		µg/L	1	8/23/2008 3:09:00 AM
trans-1,2-Dichloroethene	U	0.12	1.0		µg/L	1	8/23/2008 3:09:00 AM
trans-1,3-Dichloropropene	U	0.07	1.0		µg/L	1	8/23/2008 3:09:00 AM
Trichloroethene	U	0.13	1.0		µg/L	1	8/23/2008 3:09:00 AM
Trichlorofluoromethane	U	0.15	1.0		µg/L	1	8/23/2008 3:09:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
	LOQ Limit of Quantitation	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
	C Calibration %RSD/%D exceeded for non-CCC analytes	

American Analytical Laboratories, LLC.

Date: 26-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808312
Project: Rowe
Lab ID: 0808312-01A

Client Sample ID: WQ081908:1100NP2-6
Collection Date: 8/19/2008 11:00:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B		Analyst: DM		
Vinyl acetate	U	0.06	1.0		µg/L	1	8/23/2008 3:09:00 AM
Vinyl chloride	U	0.14	1.0		µg/L	1	8/23/2008 3:09:00 AM
Surr: 4-Bromofluorobenzene	100	0	54-134		%REC	1	8/23/2008 3:09:00 AM
Surr: Dibromofluoromethane	95.9	0	52-132		%REC	1	8/23/2008 3:09:00 AM
Surr: Toluene-d8	101	0	51-127		%REC	1	8/23/2008 3:09:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 26-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ081908:1100NP2-6

Lab Order: 0808312

Collection Date: 8/19/2008 11:00:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808312-01B

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL IRON			E200.7		SW3010A		Analyst: JP
Iron	1.11	0.005	0.0200		mg/L	1	8/22/2008 11:26:56 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 26-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808312
Project: Rowe
Lab ID: 0808312-01C

Client Sample ID: WQ081908:1100NP2-6
Collection Date: 8/19/2008 11:00:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
DISSOLVED IRON			E200.7		SW3005A		Analyst: JP
Iron	0.0553	0.005	0.0200		mg/L	1	8/22/2008 11:24:53 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 26-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808312
Project: Rowe
Lab ID: 0808312-02A

Client Sample ID: WQ081908:1105NP2-7
Collection Date: 8/19/2008 11:05:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: DM	
1,1,1,2-Tetrachloroethane	U	0.09	1.0		µg/L	1	8/23/2008 3:38:00 AM
1,1,1-Trichloroethane	U	0.17	1.0		µg/L	1	8/23/2008 3:38:00 AM
1,1,2,2-Tetrachloroethane	U	0.06	1.0		µg/L	1	8/23/2008 3:38:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	0.13	1.0		µg/L	1	8/23/2008 3:38:00 AM
1,1,2-Trichloroethane	U	0.07	1.0		µg/L	1	8/23/2008 3:38:00 AM
1,1-Dichloroethane	U	0.11	1.0		µg/L	1	8/23/2008 3:38:00 AM
1,1-Dichloroethene	U	0.15	1.0		µg/L	1	8/23/2008 3:38:00 AM
1,1-Dichloropropene	U	0.12	1.0		µg/L	1	8/23/2008 3:38:00 AM
1,2,3-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/23/2008 3:38:00 AM
1,2,3-Trichloropropane	U	0.08	1.0		µg/L	1	8/23/2008 3:38:00 AM
1,2,4-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/23/2008 3:38:00 AM
1,2,4-Trimethylbenzene	U	0.09	1.0		µg/L	1	8/23/2008 3:38:00 AM
1,2-Dibromo-3-chloropropane	U	0.09	1.0		µg/L	1	8/23/2008 3:38:00 AM
1,2-Dibromoethane	U	0.06	1.0		µg/L	1	8/23/2008 3:38:00 AM
1,2-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/23/2008 3:38:00 AM
1,2-Dichloroethane	U	0.08	1.0		µg/L	1	8/23/2008 3:38:00 AM
1,2-Dichloropropane	U	0.1	1.0		µg/L	1	8/23/2008 3:38:00 AM
1,3,5-Trimethylbenzene	U	0.11	1.0		µg/L	1	8/23/2008 3:38:00 AM
1,3-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/23/2008 3:38:00 AM
1,3-dichloropropane	U	0.08	1.0		µg/L	1	8/23/2008 3:38:00 AM
1,4-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/23/2008 3:38:00 AM
2,2-Dichloropropane	U	0.11	1.0		µg/L	1	8/23/2008 3:38:00 AM
2-Butanone	U	1.28	3.0		µg/L	1	8/23/2008 3:38:00 AM
2-Chloroethyl vinyl ether	U	0.08	1.0		µg/L	1	8/23/2008 3:38:00 AM
2-Chlorotoluene	U	0.09	1.0		µg/L	1	8/23/2008 3:38:00 AM
2-Hexanone	U	0.22	2.0		µg/L	1	8/23/2008 3:38:00 AM
4-Chlorotoluene	U	0.09	1.0		µg/L	1	8/23/2008 3:38:00 AM
4-Isopropyltoluene	U	0.1	1.0		µg/L	1	8/23/2008 3:38:00 AM
4-Methyl-2-pentanone	U	0.21	2.0		µg/L	1	8/23/2008 3:38:00 AM
Acetone	U	0.19	2.0		µg/L	1	8/23/2008 3:38:00 AM
Benzene	U	0.11	1.0		µg/L	1	8/23/2008 3:38:00 AM
Bromobenzene	U	0.07	1.0		µg/L	1	8/23/2008 3:38:00 AM
Bromochloromethane	U	0.4	1.0		µg/L	1	8/23/2008 3:38:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
	LOQ Limit of Quantitation	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
	C Calibration %RSD/%D exceeded for non-CCC analytes	

American Analytical Laboratories, LLC.

Date: 26-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808312
Project: Rowe
Lab ID: 0808312-02A

Client Sample ID: WQ081908:1105NP2-7
Collection Date: 8/19/2008 11:05:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: DM	
Bromodichloromethane	U	0.08	1.0		µg/L	1	8/23/2008 3:38:00 AM
Bromoform	U	0.06	1.0		µg/L	1	8/23/2008 3:38:00 AM
Bromomethane	U	0.17	1.0		µg/L	1	8/23/2008 3:38:00 AM
Carbon disulfide	U	0.14	1.0		µg/L	1	8/23/2008 3:38:00 AM
Carbon tetrachloride	U	0.16	1.0		µg/L	1	8/23/2008 3:38:00 AM
Chlorobenzene	U	0.09	1.0		µg/L	1	8/23/2008 3:38:00 AM
Chloroethane	U	0.16	1.0		µg/L	1	8/23/2008 3:38:00 AM
Chloroform	U	0.1	1.0		µg/L	1	8/23/2008 3:38:00 AM
Chloromethane	U	0.18	1.0		µg/L	1	8/23/2008 3:38:00 AM
cis-1,2-Dichloroethene	U	0.11	1.0		µg/L	1	8/23/2008 3:38:00 AM
cis-1,3-Dichloropropene	U	0.08	1.0		µg/L	1	8/23/2008 3:38:00 AM
Dibromochloromethane	U	0.07	1.0		µg/L	1	8/23/2008 3:38:00 AM
Dibromomethane	U	0.07	1.0		µg/L	1	8/23/2008 3:38:00 AM
Dichlorodifluoromethane	U	0.15	1.0		µg/L	1	8/23/2008 3:38:00 AM
Ethylbenzene	U	0.1	1.0		µg/L	1	8/23/2008 3:38:00 AM
Hexachlorobutadiene	U	0.12	1.0		µg/L	1	8/23/2008 3:38:00 AM
Isopropylbenzene	U	0.11	1.0		µg/L	1	8/23/2008 3:38:00 AM
m,p-Xylene	U	0.2	2.0		µg/L	1	8/23/2008 3:38:00 AM
Methyl tert-butyl ether	U	0.08	1.0		µg/L	1	8/23/2008 3:38:00 AM
Methylene chloride	U	0.08	1.0		µg/L	1	8/23/2008 3:38:00 AM
Naphthalene	U	0.08	1.0		µg/L	1	8/23/2008 3:38:00 AM
n-Butylbenzene	U	0.11	1.0		µg/L	1	8/23/2008 3:38:00 AM
n-Propylbenzene	U	0.11	1.0		µg/L	1	8/23/2008 3:38:00 AM
o-Xylene	U	0.1	1.0		µg/L	1	8/23/2008 3:38:00 AM
sec-Butylbenzene	U	0.1	1.0		µg/L	1	8/23/2008 3:38:00 AM
Styrene	U	0.08	1.0		µg/L	1	8/23/2008 3:38:00 AM
tert-Butylbenzene	U	0.1	1.0		µg/L	1	8/23/2008 3:38:00 AM
Tetrachloroethene	U	0.12	1.0		µg/L	1	8/23/2008 3:38:00 AM
Toluene	U	0.12	1.0		µg/L	1	8/23/2008 3:38:00 AM
trans-1,2-Dichloroethene	U	0.12	1.0		µg/L	1	8/23/2008 3:38:00 AM
trans-1,3-Dichloropropene	U	0.07	1.0		µg/L	1	8/23/2008 3:38:00 AM
Trichloroethene	U	0.13	1.0		µg/L	1	8/23/2008 3:38:00 AM
Trichlorofluoromethane	U	0.15	1.0		µg/L	1	8/23/2008 3:38:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
	LOQ Limit of Quantitation	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
	C Calibration %RSD/%D exceeded for non-CCC analytes	

American Analytical Laboratories, LLC.

Date: 26-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ081908:1105NP2-7

Lab Order: 0808312

Collection Date: 8/19/2008 11:05:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808312-02A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: DM	
Vinyl acetate	U	0.06	1.0		µg/L	1	8/23/2008 3:38:00 AM
Vinyl chloride	U	0.14	1.0		µg/L	1	8/23/2008 3:38:00 AM
Surr: 4-Bromofluorobenzene	104	0	54-134		%REC	1	8/23/2008 3:38:00 AM
Surr: Dibromofluoromethane	91.9	0	52-132		%REC	1	8/23/2008 3:38:00 AM
Surr: Toluene-d8	102	0	51-127		%REC	1	8/23/2008 3:38:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
LOQ	Limit of Quantitation	ND Not Detected at the Reporting Limit
S	Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
C	Calibration %RSD/%D exceeded for non-CCC analytes	

American Analytical Laboratories, LLC.

Date: 26-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ081908:1105NP2-7

Lab Order: 0808312

Collection Date: 8/19/2008 11:05:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808312-02B

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL IRON				E200.7	SW3010A		Analyst: JP
Iron	1.42	0.005	0.0200		mg/L	1	8/22/2008 11:31:01 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 26-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ081908:1105NP2-7

Lab Order: 0808312

Collection Date: 8/19/2008 11:05:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808312-02C

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
DISSOLVED IRON			E200.7		SW3005A		Analyst: JP
Iron	0.139	0.005	0.0200		mg/L	1	8/22/2008 11:28:59 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 26-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808312
Project: Rowe
Lab ID: 0808312-03A

Client Sample ID: WQ081908:1110NP2-10
Collection Date: 8/19/2008 11:10:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: DM	
1,1,1,2-Tetrachloroethane	U	0.09	1.0		µg/L	1	8/23/2008 4:05:00 AM
1,1,1-Trichloroethane	U	0.17	1.0		µg/L	1	8/23/2008 4:05:00 AM
1,1,2,2-Tetrachloroethane	U	0.06	1.0	C	µg/L	1	8/23/2008 4:05:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	0.13	1.0		µg/L	1	8/23/2008 4:05:00 AM
1,1,2-Trichloroethane	U	0.07	1.0		µg/L	1	8/23/2008 4:05:00 AM
1,1-Dichloroethane	U	0.11	1.0		µg/L	1	8/23/2008 4:05:00 AM
1,1-Dichloroethene	U	0.15	1.0		µg/L	1	8/23/2008 4:05:00 AM
1,1-Dichloropropene	U	0.12	1.0		µg/L	1	8/23/2008 4:05:00 AM
1,2,3-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/23/2008 4:05:00 AM
1,2,3-Trichloropropane	U	0.08	1.0		µg/L	1	8/23/2008 4:05:00 AM
1,2,4-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/23/2008 4:05:00 AM
1,2,4-Trimethylbenzene	U	0.09	1.0		µg/L	1	8/23/2008 4:05:00 AM
1,2-Dibromo-3-chloropropane	U	0.09	1.0		µg/L	1	8/23/2008 4:05:00 AM
1,2-Dibromoethane	U	0.06	1.0		µg/L	1	8/23/2008 4:05:00 AM
1,2-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/23/2008 4:05:00 AM
1,2-Dichloroethane	U	0.08	1.0		µg/L	1	8/23/2008 4:05:00 AM
1,2-Dichloropropane	U	0.1	1.0		µg/L	1	8/23/2008 4:05:00 AM
1,3,5-Trimethylbenzene	U	0.11	1.0		µg/L	1	8/23/2008 4:05:00 AM
1,3-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/23/2008 4:05:00 AM
1,3-dichloropropane	U	0.08	1.0		µg/L	1	8/23/2008 4:05:00 AM
1,4-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/23/2008 4:05:00 AM
2,2-Dichloropropane	U	0.11	1.0		µg/L	1	8/23/2008 4:05:00 AM
2-Butanone	U	1.28	3.0		µg/L	1	8/23/2008 4:05:00 AM
2-Chloroethyl vinyl ether	U	0.08	1.0		µg/L	1	8/23/2008 4:05:00 AM
2-Chlorotoluene	U	0.09	1.0		µg/L	1	8/23/2008 4:05:00 AM
2-Hexanone	U	0.22	2.0		µg/L	1	8/23/2008 4:05:00 AM
4-Chlorotoluene	U	0.09	1.0		µg/L	1	8/23/2008 4:05:00 AM
4-Isopropyltoluene	U	0.1	1.0		µg/L	1	8/23/2008 4:05:00 AM
4-Methyl-2-pentanone	U	0.21	2.0		µg/L	1	8/23/2008 4:05:00 AM
Acetone	U	0.19	2.0		µg/L	1	8/23/2008 4:05:00 AM
Benzene	U	0.11	1.0		µg/L	1	8/23/2008 4:05:00 AM
Bromobenzene	U	0.07	1.0		µg/L	1	8/23/2008 4:05:00 AM
Bromochloromethane	U	0.4	1.0		µg/L	1	8/23/2008 4:05:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
	LOQ Limit of Quantitation	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
	C Calibration %RSD/%D exceeded for non-CCC analytes	

American Analytical Laboratories, LLC.

Date: 26-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808312
Project: Rowe
Lab ID: 0808312-03A

Client Sample ID: WQ081908:1110NP2-10
Collection Date: 8/19/2008 11:10:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: DM	
Bromodichloromethane	U	0.08	1.0		µg/L	1	8/23/2008 4:05:00 AM
Bromoform	U	0.06	1.0		µg/L	1	8/23/2008 4:05:00 AM
Bromomethane	U	0.17	1.0		µg/L	1	8/23/2008 4:05:00 AM
Carbon disulfide	U	0.14	1.0		µg/L	1	8/23/2008 4:05:00 AM
Carbon tetrachloride	U	0.16	1.0		µg/L	1	8/23/2008 4:05:00 AM
Chlorobenzene	U	0.09	1.0		µg/L	1	8/23/2008 4:05:00 AM
Chloroethane	U	0.16	1.0		µg/L	1	8/23/2008 4:05:00 AM
Chloroform	U	0.1	1.0		µg/L	1	8/23/2008 4:05:00 AM
Chloromethane	U	0.18	1.0		µg/L	1	8/23/2008 4:05:00 AM
cis-1,2-Dichloroethene	U	0.11	1.0		µg/L	1	8/23/2008 4:05:00 AM
cis-1,3-Dichloropropene	U	0.08	1.0		µg/L	1	8/23/2008 4:05:00 AM
Dibromochloromethane	U	0.07	1.0		µg/L	1	8/23/2008 4:05:00 AM
Dibromomethane	U	0.07	1.0		µg/L	1	8/23/2008 4:05:00 AM
Dichlorodifluoromethane	U	0.15	1.0		µg/L	1	8/23/2008 4:05:00 AM
Ethylbenzene	U	0.1	1.0		µg/L	1	8/23/2008 4:05:00 AM
Hexachlorobutadiene	U	0.12	1.0		µg/L	1	8/23/2008 4:05:00 AM
Isopropylbenzene	U	0.11	1.0		µg/L	1	8/23/2008 4:05:00 AM
m,p-Xylene	U	0.2	2.0		µg/L	1	8/23/2008 4:05:00 AM
Methyl tert-butyl ether	U	0.08	1.0		µg/L	1	8/23/2008 4:05:00 AM
Methylene chloride	U	0.08	1.0		µg/L	1	8/23/2008 4:05:00 AM
Naphthalene	U	0.08	1.0	C	µg/L	1	8/23/2008 4:05:00 AM
n-Butylbenzene	U	0.11	1.0	C	µg/L	1	8/23/2008 4:05:00 AM
n-Propylbenzene	U	0.11	1.0		µg/L	1	8/23/2008 4:05:00 AM
o-Xylene	U	0.1	1.0		µg/L	1	8/23/2008 4:05:00 AM
sec-Butylbenzene	U	0.1	1.0		µg/L	1	8/23/2008 4:05:00 AM
Styrene	U	0.08	1.0		µg/L	1	8/23/2008 4:05:00 AM
tert-Butylbenzene	U	0.1	1.0		µg/L	1	8/23/2008 4:05:00 AM
Tetrachloroethene	U	0.12	1.0		µg/L	1	8/23/2008 4:05:00 AM
Toluene	U	0.12	1.0		µg/L	1	8/23/2008 4:05:00 AM
trans-1,2-Dichloroethene	U	0.12	1.0		µg/L	1	8/23/2008 4:05:00 AM
trans-1,3-Dichloropropene	U	0.07	1.0		µg/L	1	8/23/2008 4:05:00 AM
Trichloroethene	U	0.13	1.0		µg/L	1	8/23/2008 4:05:00 AM
Trichlorofluoromethane	U	0.15	1.0		µg/L	1	8/23/2008 4:05:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
	LOQ Limit of Quantitation	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
	C Calibration %RSD/%D exceeded for non-CCC analytes	

American Analytical Laboratories, LLC.

Date: 26-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ081908:1110NP2-10

Lab Order: 0808312

Collection Date: 8/19/2008 11:10:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808312-03A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B		Analyst: DM		
Vinyl acetate	U	0.06	1.0		µg/L	1	8/23/2008 4:05:00 AM
Vinyl chloride	U	0.14	1.0		µg/L	1	8/23/2008 4:05:00 AM
Surr: 4-Bromofluorobenzene	98.7	0	54-134		%REC	1	8/23/2008 4:05:00 AM
Surr: Dibromofluoromethane	95.1	0	52-132		%REC	1	8/23/2008 4:05:00 AM
Surr: Toluene-d8	97.7	0	51-127		%REC	1	8/23/2008 4:05:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 26-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ081908:1110NP2-10

Lab Order: 0808312

Collection Date: 8/19/2008 11:10:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808312-03B

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL IRON			E200.7		SW3010A		Analyst: JP
Iron	1.33	0.005	0.0200		mg/L	1	8/22/2008 11:35:06 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 26-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808312
Project: Rowe
Lab ID: 0808312-03C

Client Sample ID: WQ081908:1110NP2-10
Collection Date: 8/19/2008 11:10:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
DISSOLVED IRON			E200.7		SW3005A		Analyst: JP
Iron	0.175	0.005	0.0200		mg/L	1	8/22/2008 11:33:03 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 26-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ081908:1110NP2-10

Lab Order: 0808312

Collection Date: 8/19/2008 11:10:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808312-03D

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL DISSOLVED SOLIDS				M2540C			Analyst: AS
Total Dissolved Solids (Residue, Filterable)	44.0	0	1.00		mg/L	1	8/22/2008

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

CLIENT: Leggette Brashears & Graham Inc.

Work Order: 0808312

Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113 W

Sample ID: V624LCS-082208aY		SampType: LCS		TestCode: 8260MTBE11		Units: µg/L		Prep Date:		RunNo: 37868	
Client ID: LCSW		Batch ID: R37868		TestNo: SW8260B				Analysis Date: 8/22/2008		SeqNo: 498705	
Analyte	Result	PQL	SPK value	SPK RefVal	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,1,1-Trichloroethane	51	1.0	50.00	0	102	43	148				
1,1,2,2-Tetrachloroethane	43	1.0	50.00	0	85.9	32	148				
1,1,2-Trichloroethane	44	1.0	50.00	0	88.3	42	136				
1,1-Dichloroethane	49	1.0	50.00	0	97.4	40	150				
1,1-Dichloroethene	67	1.0	50.00	0	133	30	154				
1,2-Dichlorobenzene	38	1.0	50.00	0	76.5	40	129				
1,2-Dichloroethane	48	1.0	50.00	0	97.0	36	141				
1,2-Dichloropropane	46	1.0	50.00	0	91.0	44	138				
1,3-Dichlorobenzene	42	1.0	50.00	0	83.2	40	133				
1,4-Dichlorobenzene	42	1.0	50.00	0	83.1	40	135				
2-Butanone	100	3.0	125.0	0	81.1	35	135				
2-Chloroethyl vinyl ether	41	1.0	50.00	0	82.9	21	139				
2-Hexanone	96	2.0	125.0	0	76.9	35	135				
4-Methyl-2-pentanone	97	2.0	125.0	0	77.9	35	135				
Acetone	110	2.0	125.0	0	89.0	35	135				
Benzene	45	1.0	50.00	0	89.8	45	144				
Bromodichloromethane	44	1.0	50.00	0	88.7	35	136				
Bromoform	50	1.0	50.00	0	100	28	138				
Bromomethane	56	1.0	50.00	0	111	26	148				
Carbon tetrachloride	48	1.0	50.00	0	96.3	45	141				
Chlorobenzene	45	1.0	50.00	0	89.0	41	142				
Chloroethane	57	1.0	50.00	0	114	36	143				
Chloroform	48	1.0	50.00	0	96.2	42	137				
Chloromethane	59	1.0	50.00	0	118	35	151				
cis-1,3-Dichloropropene	45	1.0	50.00	0	89.9	42	130				
Dibromochloromethane	42	1.0	50.00	0	83.3	21	134				
Ethylbenzene	46	1.0	50.00	0	92.2	45	146				
Tetrachloroethene	45	1.0	50.00	0	89.5	45	136				
Toluene	44	1.0	50.00	0	87.5	43	134				
trans-1,2-Dichloroethene	46	1.0	50.00	0	92.1	42	135				

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
 Work Order: 0808312
 Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: V624LCS-082208aY	SampType: LCS	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37868						
Client ID: LCSW	Batch ID: R37868	TestNo: SW8260B		Analysis Date: 8/22/2008	SeqNo: 498705						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

trans-1,3-Dichloropropene	44	1.0	50.00	0	87.4	37	133				
Trichloroethene	46	1.0	50.00	0	92.1	43	140				
Trichlorofluoromethane	61	1.0	50.00	0	123	50	148				
Vinyl chloride	63	1.0	50.00	0	126	35	142				
Surr: 4-Bromofluorobenzene	55		50.00		111	54	134				
Surr: Dibromofluoromethane	52		50.00		103	52	132				
Surr: Toluene-d8	52		50.00		104	51	127				

Sample ID: VBLK082208aY	SampType: MBLK	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37868						
Client ID: PBW	Batch ID: R37868	TestNo: SW8260B		Analysis Date: 8/23/2008	SeqNo: 498706						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

1,1,1,2-Tetrachloroethane	U	1.0									
1,1,1-Trichloroethane	U	1.0									
1,1,2,2-Tetrachloroethane	U	1.0									
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0									
1,1,2-Trichloroethane	U	1.0									
1,1-Dichloroethane	U	1.0									
1,1-Dichloroethene	U	1.0									
1,1-Dichloropropene	U	1.0									
1,2,3-Trichlorobenzene	U	1.0									
1,2,3-Trichloropropane	U	1.0									
1,2,4-Trichlorobenzene	U	1.0									
1,2,4-Trimethylbenzene	U	1.0									
1,2-Dibromo-3-chloropropane	U	1.0									
1,2-Dibromoethane	U	1.0									
1,2-Dichlorobenzene	U	1.0									
1,2-Dichloroethane	U	1.0									
1,2-Dichloropropane	U	1.0									
1,3,5-Trimethylbenzene	U	1.0									
1,3-Dichlorobenzene	U	1.0									

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
	LOD	Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	R	RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808312
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: VBLK082208aY		SampType: MBLK		TestCode: 8260MTBE11		Units: µg/L		Prep Date:		RunNo: 37868		
Client ID: PBW		Batch ID: R37868		TestNo: SW8260B				Analysis Date: 8/23/2008		SeqNo: 498706		
Analyte		Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,3-dichloropropane		U	1.0									
1,4-Dichlorobenzene		U	1.0									
2,2-Dichloropropane		U	1.0									
2-Butanone		U	3.0									
2-Chloroethyl vinyl ether		U	1.0									
2-Chlorotoluene		U	1.0									
2-Hexanone		U	2.0									
4-Chlorotoluene		U	1.0									
4-Isopropyltoluene		U	1.0									
4-Methyl-2-pentanone		U	2.0									
Acetone		U	2.0									
Benzene		U	1.0									
Bromobenzene		U	1.0									
Bromochloromethane		U	1.0									
Bromodichloromethane		U	1.0									
Bromoform		U	1.0									
Bromomethane		U	1.0									
Carbon disulfide		U	1.0									
Carbon tetrachloride		U	1.0									
Chlorobenzene		U	1.0									
Chloroethane		U	1.0									
Chloroform		U	1.0									
Chloromethane		U	1.0									
cis-1,2-Dichloroethene		U	1.0									
cis-1,3-Dichloropropene		U	1.0									
Dibromochloromethane		U	1.0									
Dibromomethane		U	1.0									
Dichlorodifluoromethane		U	1.0									
Ethylbenzene		U	1.0									
Hexachlorobutadiene		U	1.0									
Isopropylbenzene		U	1.0									

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
LOD		Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
R		RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
 Work Order: 0808312
 Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: VBLK082208aY	SampType: MBLK	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37868						
Client ID: PBW	Batch ID: R37868	TestNo: SW8260B		Analysis Date: 8/23/2008	SeqNo: 498706						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

m,p-Xylene	U	2.0									
Methyl tert-butyl ether	U	1.0									
Methylene chloride	U	1.0									
Naphthalene	U	1.0									
n-Butylbenzene	U	1.0									
n-Propylbenzene	U	1.0									
o-Xylene	U	1.0									
sec-Butylbenzene	U	1.0									
Styrene	U	1.0									
tert-Butylbenzene	U	1.0									
Tetrachloroethene	U	1.0									
Toluene	U	1.0									
trans-1,2-Dichloroethene	U	1.0									
trans-1,3-Dichloropropene	U	1.0									
Trichloroethene	U	1.0									
Trichlorofluoromethane	U	1.0									
Vinyl acetate	U	1.0									
Vinyl chloride	U	1.0									
Surr: 4-Bromofluorobenzene	53		50.00		106	54		134			
Surr: Dibromofluoromethane	50		50.00		99.3	52		132			
Surr: Toluene-d8	50		50.00		100	51		127			

Sample ID: 0808312-03AMS	SampType: MS	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37868						
Client ID: WQ081908:1110NP2	Batch ID: R37868	TestNo: SW8260B		Analysis Date: 8/23/2008	SeqNo: 498708						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

1,1,1-Trichloroethane	43	1.0	50.00	0	85.9	43		148			
1,1,2,2-Tetrachloroethane	38	1.0	50.00	0	76.3	32		148			
1,1,2-Trichloroethane	36	1.0	50.00	0	71.6	42		136			
1,1-Dichloroethane	41	1.0	50.00	0	82.3	40		150			
1,1-Dichloroethene	57	1.0	50.00	0	114	30		154			

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
LOD		Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
R		RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808312
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113 W

Sample ID: 0808312-03AMS	SampType: MS	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37868						
Client ID: WQ081908:1110NP2	Batch ID: R37868	TestNo: SW8260B		Analysis Date: 8/23/2008	SeqNo: 498708						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,2-Dichlorobenzene	37	1.0	50.00	0	73.6	40	129				
1,2-Dichloroethane	42	1.0	50.00	0	84.5	36	141				
1,2-Dichloropropane	39	1.0	50.00	0	78.3	44	138				
1,3-Dichlorobenzene	39	1.0	50.00	0	77.8	40	133				
1,4-Dichlorobenzene	35	1.0	50.00	0	70.8	40	135				
2-Butanone	72	3.0	125.0	0	57.4	35	135				
2-Hexanone	83	2.0	125.0	0	66.6	35	135				
4-Methyl-2-pentanone	85	2.0	125.0	0	68.1	35	135				
Benzene	39	1.0	50.00	0	78.0	45	144				
Bromodichloromethane	39	1.0	50.00	0	78.4	35	136				
Bromoform	38	1.0	50.00	0	76.6	28	138				
Bromomethane	44	1.0	50.00	0	88.0	26	148				
Carbon tetrachloride	42	1.0	50.00	0	84.3	45	141				
Chlorobenzene	38	1.0	50.00	0	76.1	41	142				
Chloroethane	48	1.0	50.00	0	96.9	36	143				
Chloroform	41	1.0	50.00	0	81.1	42	137				
Chloromethane	50	1.0	50.00	0	99.3	35	151				
cis-1,3-Dichloropropene	38	1.0	50.00	0	75.5	42	130				
Dibromochloromethane	36	1.0	50.00	0	72.1	21	134				
Ethylbenzene	40	1.0	50.00	0	79.1	45	146				
Tetrachloroethene	40	1.0	50.00	0	79.9	45	136				
Toluene	41	1.0	50.00	0	82.4	43	134				
trans-1,2-Dichloroethene	39	1.0	50.00	0	78.1	42	135				
trans-1,3-Dichloropropene	37	1.0	50.00	0	73.4	37	133				
Trichloroethene	39	1.0	50.00	0	77.7	43	140				
Trichlorofluoromethane	52	1.0	50.00	0	103	50	148				
Vinyl chloride	52	1.0	50.00	0	105	35	142				
Surr: 4-Bromofluorobenzene	54		50.00		107	54	134				
Surr: Dibromofluoromethane	48		50.00		96.2	52	132				
Surr: Toluene-d8	52		50.00		105	51	127				

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits
H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits
J Analyte detected below quantitation limit
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808312
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: V624LCS-082208aY		SampType: LCS		TestCode: 8260MTBE11		Units: µg/L		Prep Date:		RunNo: 37868	
Client ID: LCSW		Batch ID: R37868a		TestNo: SW8260B				Analysis Date: 8/22/2008		SeqNo: 498709	
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,1,1-Trichloroethane	43	1.0	50.00	0	85.0	43	148				C
1,1,2,2-Tetrachloroethane	39	1.0	50.00	0	77.9	32	148				
1,1,2-Trichloroethane	38	1.0	50.00	0	75.4	42	136				
1,1-Dichloroethane	42	1.0	50.00	0	83.3	40	150				
1,1-Dichloroethene	53	1.0	50.00	0	106	30	154				
1,2-Dichlorobenzene	39	1.0	50.00	0	78.4	40	129				
1,2-Dichloroethane	42	1.0	50.00	0	83.5	36	141				
1,2-Dichloropropane	42	1.0	50.00	0	83.1	44	138				
1,3-Dichlorobenzene	37	1.0	50.00	0	74.9	40	133				
1,4-Dichlorobenzene	38	1.0	50.00	0	75.5	40	135				
2-Butanone	84	3.0	125.0	0	66.9	35	135				
2-Chloroethyl vinyl ether	43	1.0	50.00	0	86.6	21	139				
2-Hexanone	95	2.0	125.0	0	76.0	35	135				
4-Methyl-2-pentanone	86	2.0	125.0	0	68.7	35	135				
Acetone	96	2.0	125.0	0	77.0	35	135				
Benzene	38	1.0	50.00	0	76.8	45	144				
Bromodichloromethane	40	1.0	50.00	0	80.9	35	136				
Bromoform	42	1.0	50.00	0	83.3	28	138				
Bromomethane	51	1.0	50.00	0	101	26	148				
Carbon tetrachloride	43	1.0	50.00	0	85.6	45	141				
Chlorobenzene	37	1.0	50.00	0	74.8	41	142				
Chloroethane	50	1.0	50.00	0	99.3	36	143				
Chloroform	41	1.0	50.00	0	81.3	42	137				
Chloromethane	52	1.0	50.00	0	103	35	151				
cis-1,3-Dichloropropene	39	1.0	50.00	0	77.3	42	130				
Dibromochloromethane	39	1.0	50.00	0	77.5	21	134				
Ethylbenzene	39	1.0	50.00	0	78.4	45	146				
Tetrachloroethene	40	1.0	50.00	0	79.8	45	136				
Toluene	40	1.0	50.00	0	79.1	43	134				
trans-1,2-Dichloroethene	40	1.0	50.00	0	79.2	42	135				
trans-1,3-Dichloropropene	40	1.0	50.00	0	79.0	37	133				

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808312
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: V624LCS-082208aY	Sample Type: LCS	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37868						
Client ID: LCSW	Batch ID: R37868a	TestNo: SW8260B		Analysis Date: 8/22/2008	SeqNo: 498709						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Trichloroethene	41	1.0	50.00	0	81.8	43	140				
Trichlorofluoromethane	50	1.0	50.00	0	101	50	148				
Vinyl chloride	53	1.0	50.00	0	107	35	142				
Surr: 4-Bromofluorobenzene	51		50.00		102	54	134				
Surr: Dibromofluoromethane	48		50.00		95.2	52	132				
Surr: Toluene-d8	51		50.00		101	51	127				

Sample ID: VBLK082208aY	Sample Type: MBLK	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37868						
Client ID: PBW	Batch ID: R37868a	TestNo: SW8260B		Analysis Date: 8/22/2008	SeqNo: 498710						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

1,1,1,2-Tetrachloroethane	U	1.0									
1,1,1-Trichloroethane	U	1.0									
1,1,2,2-Tetrachloroethane	U	1.0									
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0									
1,1,2-Trichloroethane	U	1.0									
1,1-Dichloroethane	U	1.0									
1,1-Dichloroethene	U	1.0									
1,1-Dichloropropene	U	1.0									
1,2,3-Trichlorobenzene	U	1.0									
1,2,3-Trichloropropane	U	1.0									
1,2,4-Trichlorobenzene	U	1.0									
1,2,4-Trimethylbenzene	U	1.0									
1,2-Dibromo-3-chloropropane	U	1.0									
1,2-Dibromoethane	U	1.0									
1,2-Dichlorobenzene	U	1.0									
1,2-Dichloroethane	U	1.0									
1,2-Dichloropropane	U	1.0									
1,3,5-Trimethylbenzene	U	1.0									
1,3-Dichlorobenzene	U	1.0									
1,3-dichloropropane	U	1.0									

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
LOD		Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
R		RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
 Work Order: 0808312
 Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: VBLK082208aY		SampType: MBLK		TestCode: 8260MTBE11		Units: µg/L		Prep Date:		RunNo: 37868		
Client ID: PBW		Batch ID: R37868a		TestNo: SW8260B				Analysis Date: 8/22/2008		SeqNo: 498710		
Analyte		Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,4-Dichlorobenzene		U	1.0									
2,2-Dichloropropane		U	1.0									
2-Butanone		U	3.0									
2-Chloroethyl vinyl ether		U	1.0									
2-Chlorotoluene		U	1.0									
2-Hexanone		U	2.0									
4-Chlorotoluene		U	1.0									
4-Isopropyltoluene		U	1.0									
4-Methyl-2-pentanone		U	2.0									
Acetone		U	2.0									
Benzene		U	1.0									
Bromobenzene		U	1.0									
Bromochloromethane		U	1.0									
Bromodichloromethane		U	1.0									
Bromoform		U	1.0									
Bromomethane		U	1.0									
Carbon disulfide		U	1.0									
Carbon tetrachloride		U	1.0									
Chlorobenzene		U	1.0									
Chloroethane		U	1.0									
Chloroform		U	1.0									
Chloromethane		U	1.0									
cis-1,2-Dichloroethene		U	1.0									
cis-1,3-Dichloropropene		U	1.0									
Dibromochloromethane		U	1.0									
Dibromomethane		U	1.0									
Dichlorodifluoromethane		U	1.0									
Ethylbenzene		U	1.0									
Hexachlorobutadiene		U	1.0									
Isopropylbenzene		U	1.0									
m,p-Xylene		U	2.0									

Qualifiers: E Value above quantitation range
 LOD Limit of Detection
 R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
 LOQ Limit of Quantitation
 S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation limit
 ND Not Detected at the Reporting Limit
 U Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808312
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113 W

Sample ID: VBLK082208aY	SampleType: MBLK	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37868						
Client ID: PBW	Batch ID: R37868a	TestNo: SW8260B		Analysis Date: 8/22/2008	SeqNo: 498710						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Methyl tert-butyl ether	U	1.0									
Methylene chloride	U	1.0									
Naphthalene	U	1.0									
n-Butylbenzene	U	1.0									C
n-Propylbenzene	U	1.0									C
o-Xylene	U	1.0									
sec-Butylbenzene	U	1.0									
Styrene	U	1.0									
tert-Butylbenzene	U	1.0									
Tetrachloroethene	U	1.0									
Toluene	U	1.0									
trans-1,2-Dichloroethene	U	1.0									
trans-1,3-Dichloropropene	U	1.0									
Trichloroethene	U	1.0									
Trichlorofluoromethane	U	1.0									
Vinyl acetate	U	1.0									
Vinyl chloride	U	1.0									
Surr: 4-Bromofluorobenzene	51		50.00		102	54	134				
Surr: Dibromofluoromethane	48		50.00		95.2	52	132				
Surr: Toluene-d8	52		50.00		104	51	127				

Sample ID: 0808312-03AMSD	Sample Type: MSD	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37868						
Client ID: WQ081908:1110NP2	Batch ID: R37868a	TestNo: SW8260B		Analysis Date: 8/23/2008	SeqNo: 498713						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

1,1,1-Trichloroethane	41	1.0	50.00	0	81.2	43	148	42.96	5.67	20	
1,1,2,2-Tetrachloroethane	35	1.0	50.00	0	69.9	32	148	38.16	8.81	20	C
1,1,2-Trichloroethane	38	1.0	50.00	0	76.2	42	136	35.78	6.28	20	
1,1-Dichloroethane	38	1.0	50.00	0	76.5	40	150	41.13	7.20	20	
1,1-Dichloroethene	50	1.0	50.00	0	99.5	30	154	57.00	13.6	20	
1,2-Dichlorobenzene	33	1.0	50.00	0	67.0	40	129	36.79	9.39	20	

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
	LOD	Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	R	RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808312
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: 0808312-03AMSD		SampType: MSD	TestCode: 8260MTBE11		Units: µg/L	Prep Date:		RunNo: 37868			
Client ID: WQ081908:1110NP2		Batch ID: R37868a	TestNo: SW8260B			Analysis Date: 8/23/2008		SeqNo: 498713			
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,2-Dichloroethane	39	1.0	50.00	0	78.3	36	141	42.24	7.57	20	
1,2-Dichloropropane	37	1.0	50.00	0	73.1	44	138	39.17	6.97	20	
1,3-Dichlorobenzene	34	1.0	50.00	0	68.1	40	133	38.92	13.3	20	
1,4-Dichlorobenzene	35	1.0	50.00	0	69.9	40	135	35.38	1.28	20	
2-Butanone	70	3.0	125.0	0	56.3	35	135	71.79	2.01	20	
2-Hexanone	83	2.0	125.0	0	66.4	35	135	83.26	0.361	20	
4-Methyl-2-pentanone	82	2.0	125.0	0	65.3	35	135	85.07	4.18	20	
Benzene	37	1.0	50.00	0	73.6	45	144	39.01	5.86	20	
Bromodichloromethane	39	1.0	50.00	0	77.7	35	136	39.20	0.871	20	
Bromoform	44	1.0	50.00	0	88.6	28	138	38.28	14.6	20	
Bromomethane	46	1.0	50.00	0	92.8	26	148	44.00	5.35	20	
Carbon tetrachloride	40	1.0	50.00	0	81.0	45	141	42.16	4.07	20	
Chlorobenzene	38	1.0	50.00	0	75.4	41	142	38.07	1.00	20	
Chloroethane	43	1.0	50.00	0	86.5	36	143	48.46	11.4	20	
Chloroform	39	1.0	50.00	0	77.0	42	137	40.56	5.19	20	
Chloromethane	43	1.0	50.00	0	86.7	35	151	49.66	13.6	20	
cis-1,3-Dichloropropene	35	1.0	50.00	0	70.2	42	130	37.77	7.33	20	
Dibromochloromethane	36	1.0	50.00	0	71.7	21	134	36.07	0.612	20	
Ethylbenzene	39	1.0	50.00	0	77.8	45	146	39.56	1.63	20	
Tetrachloroethene	38	1.0	50.00	0	76.6	45	136	39.93	4.22	20	
Toluene	37	1.0	50.00	0	73.8	43	134	41.22	11.1	20	
trans-1,2-Dichloroethene	37	1.0	50.00	0	74.0	42	135	39.06	5.47	20	
trans-1,3-Dichloropropene	36	1.0	50.00	0	72.7	37	133	36.72	1.01	20	
Trichloroethene	37	1.0	50.00	0	74.6	43	140	38.83	3.99	20	
Trichlorofluoromethane	45	1.0	50.00	0	90.9	50	148	51.74	13.0	20	
Vinyl chloride	47	1.0	50.00	0	93.6	35	142	52.45	11.4	20	
Surr: 4-Bromofluorobenzene	57		50.00		113	54	134		0	0	
Surr: Dibromofluoromethane	48		50.00		95.5	52	132		0	0	
Surr: Toluene-d8	52		50.00		104	51	127		0	0	

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
LOD		Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
R		RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808312
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: FE_T

Sample ID: 0808312-03B-MS	SampType: MS	TestCode: FE_T	Units: mg/L	Prep Date: 8/22/2008	RunNo: 37826						
Client ID: WQ081908:1110NP2	Batch ID: 22692	TestNo: E200.7	SW3005A	Analysis Date: 8/22/2008	SeqNo: 498081						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Iron	2.26	0.0200	1.000	1.335	92.8	68	122				

Sample ID: 0808312-03B-MSD	SampType: MSD	TestCode: FE_T	Units: mg/L	Prep Date: 8/22/2008	RunNo: 37826						
Client ID: WQ081908:1110NP2	Batch ID: 22692	TestNo: E200.7	SW3005A	Analysis Date: 8/22/2008	SeqNo: 498082						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Iron	2.24	0.0200	1.000	1.335	91.0	68	122	2.263	0.815	20	

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
LOD		Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
R		RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808312
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: TDS_W

Sample ID: MB-R37927	SampType: MBLK	TestCode: TDS_W	Units: mg/L	Prep Date:	RunNo: 37927						
Client ID: PBW	Batch ID: R37927	TestNo: M2540C		Analysis Date: 8/22/2008	SeqNo: 499210						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Total Dissolved Solids (Residue, Filtera		U	1.00								

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
	LOD	Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	R	RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed


Thursday, September 04, 2008 

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe

Dear Mark Goldberg:

Replacement Workorder
 09/14/08
Signature Date

Order No.: 0808394

American Analytical Laboratories, LLC. received 3 sample(s) on 8/28/2008 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The results reported herein relate only to the items tested or to the samples as received by the laboratory. This report may not be reproduced, except in full, without the approval of American Analytical Laboratories, LLC and is not considered complete without a cover page and chain of custody documentation. The limits (LOQ) provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report. This package has been reviewed by American Analytical Laboratories' QA Department/Laboratory Director to comply with NELAC standards prior to report submittal.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

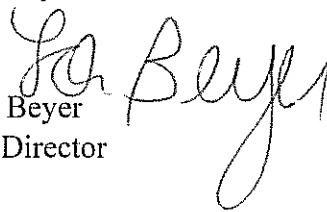
Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 04-Sep-08

CLIENT: Leggette Brashears & Graham Inc.**Project:** Rowe**Lab Order:** 0808394**Work Order Sample Summary**

Lab Sample ID	Client Sample ID	Date Collected	Date Received
0808394-01A	WQ082608:NP2-6	8/26/2008 10:00:00 AM	8/28/2008
0808394-01B	WQ082608:NP2-6	8/26/2008 10:00:00 AM	8/28/2008
0808394-01C	WQ082608:NP2-6	8/26/2008 10:00:00 AM	8/28/2008
0808394-02A	WQ082608:NP2-7	8/26/2008 10:05:00 AM	8/28/2008
0808394-02B	WQ082608:NP2-7	8/26/2008 10:05:00 AM	8/28/2008
0808394-02C	WQ082608:NP2-7	8/26/2008 10:05:00 AM	8/28/2008
0808394-03A	WQ082608:NP2-10	8/26/2008 10:10:00 AM	8/28/2008
0808394-03B	WQ082608:NP2-10	8/26/2008 10:10:00 AM	8/28/2008
0808394-03C	WQ082608:NP2-10	8/26/2008 10:10:00 AM	8/28/2008
0808394-03D	WQ082608:NP2-10	8/26/2008 10:10:00 AM	8/28/2008

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS\$ DOCUMENT

CLIENT NAME/ADDRESS		CONTACT:		PROJECT LOCATION:		SAMPLER (SIGNATURE)		SAMPLE(S) SEALED		YES/NO					
LAB ID#		MATRIX/TYPE		NO. OF CONTAINERS		SAMPLING DATE		SAMPLE # - LOCATION		SAMPLER NAME (PRINT)		CORRECT CONTAINER(S)		YES/NO	
0808394-01AC	W	4	3	8/26/08	1000	WQ082608 NP2-6				EVA FOSTER					
0808394-02AC	W	4	4	8/26/08	1005	WQ082608 NP2-7									
0808394-03AC	W	5	5	8/26/08	1010	WQ082608 NP2-10									
COMMENTS / INSTRUCTIONS - 1 Voa broken during shipping - sufficient sample available for analysis															
MATRIX S=SOIL; W=WATER; SL=SLUDGE; A=AIR; M=MISCELLANEOUS TYPE G=GRAB; C=COMPOSITE															
RELINQUISHED BY (SIGNATURE)		PRINTED NAME		DATE		RECEIVED BY LAB (SIGNATURE)		PRINTED NAME		DATE		E-MAIL ADDRESS FOR RESULTS:			
Kiti		Kiti Deak		08/27/08		Kiti Deak		Kiti Deak		08/27/08		Kiti Deak			
RELINQUISHED BY (SIGNATURE)		PRINTED NAME		DATE		RECEIVED BY LAB (SIGNATURE)		PRINTED NAME		DATE		E-MAIL ADDRESS FOR RESULTS:			
Kiti		Kiti Deak		08/27/08		Kiti Deak		Kiti Deak		08/27/08		Kiti Deak			

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value.
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of the method allowable holding time.

American Analytical Laboratories, LLC.

Date: 04-Sep-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808394
Project: Rowe
Lab ID: 0808394-01A

Client Sample ID: WQ082608:NP2-6
Collection Date: 8/26/2008 10:00:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B		Analyst: LA		
1,1,1,2-Tetrachloroethane	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
1,1,1-Trichloroethane	1.4	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
1,1,2,2-Tetrachloroethane	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
1,1,2-Trichloroethane	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
1,1-Dichloroethane	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
1,1-Dichloroethene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
1,1-Dichloropropene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
1,2,3-Trichlorobenzene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
1,2,3-Trichloropropane	U	0.4	1.0		µg/L	1	9/2/2008 4:44:00 PM
1,2,4-Trichlorobenzene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
1,2,4-Trimethylbenzene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
1,2-Dibromo-3-chloropropane	U	0.4	1.0		µg/L	1	9/2/2008 4:44:00 PM
1,2-Dibromoethane	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
1,2-Dichlorobenzene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
1,2-Dichloroethane	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
1,2-Dichloropropane	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
1,3,5-Trimethylbenzene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
1,3-Dichlorobenzene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
1,3-dichloropropane	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
1,4-Dichlorobenzene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
2,2-Dichloropropane	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
2-Butanone	U	0.3	3.0		µg/L	1	9/2/2008 4:44:00 PM
2-Chloroethyl vinyl ether	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
2-Chlorotoluene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
2-Hexanone	U	0.3	2.0		µg/L	1	9/2/2008 4:44:00 PM
4-Chlorotoluene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
4-Isopropyltoluene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
4-Methyl-2-pentanone	U	0.3	2.0		µg/L	1	9/2/2008 4:44:00 PM
Acetone	U	0.3	2.0		µg/L	1	9/2/2008 4:44:00 PM
Benzene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Bromobenzene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Bromochloromethane	U	0.4	1.0		µg/L	1	9/2/2008 4:44:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 04-Sep-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808394
Project: Rowe
Lab ID: 0808394-01A

Client Sample ID: WQ082608:NP2-6
Collection Date: 8/26/2008 10:00:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
Bromodichloromethane	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Bromoform	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Bromomethane	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Carbon disulfide	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Carbon tetrachloride	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Chlorobenzene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Chloroethane	U	0.4	1.0		µg/L	1	9/2/2008 4:44:00 PM
Chloroform	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Chloromethane	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
cis-1,2-Dichloroethene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
cis-1,3-Dichloropropene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Dibromochloromethane	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Dibromomethane	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Dichlorodifluoromethane	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Ethylbenzene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Hexachlorobutadiene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Isopropylbenzene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
m,p-Xylene	U	0.3	2.0		µg/L	1	9/2/2008 4:44:00 PM
Methyl tert-butyl ether	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Methylene chloride	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Naphthalene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
n-Butylbenzene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
n-Propylbenzene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
o-Xylene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
sec-Butylbenzene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Styrene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
tert-Butylbenzene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Tetrachloroethene	1.5	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Toluene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
trans-1,2-Dichloroethene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
trans-1,3-Dichloropropene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Trichloroethene	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Trichlorofluoromethane	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 04-Sep-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808394
Project: Rowe
Lab ID: 0808394-01A

Client Sample ID: WQ082608:NP2-6
Collection Date: 8/26/2008 10:00:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B		Analyst: LA		
Vinyl acetate	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Vinyl chloride	U	0.3	1.0		µg/L	1	9/2/2008 4:44:00 PM
Surr: 4-Bromofluorobenzene	101	0	54-134		%REC	1	9/2/2008 4:44:00 PM
Surr: Dibromofluoromethane	90.2	0	52-132		%REC	1	9/2/2008 4:44:00 PM
Surr: Toluene-d8	88.0	0	51-127		%REC	1	9/2/2008 4:44:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
LOQ	Limit of Quantitation	ND Not Detected at the Reporting Limit
S	Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
C	Calibration %RSD/%D exceeded for non-CCC analytes	

American Analytical Laboratories, LLC.

Date: 04-Sep-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808394
Project: Rowe
Lab ID: 0808394-01B

Client Sample ID: WQ082608;NP2-6
Collection Date: 8/26/2008 10:00:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL IRON				E200.7	SW3010A		Analyst: JP
Iron	2.38	0.005	0.0200		mg/L	1	8/29/2008 12:13:55 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 04-Sep-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808394
Project: Rowe
Lab ID: 0808394-01C

Client Sample ID: WQ082608:NP2-6
Collection Date: 8/26/2008 10:00:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
DISSOLVED IRON				E200.7	SW3005A		Analyst: JP
Iron	0.0256	0.005	0.0200		mg/L	1	8/29/2008 12:11:52 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 04-Sep-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808394
Project: Rowe
Lab ID: 0808394-02A

Client Sample ID: WQ082608:NP2-7
Collection Date: 8/26/2008 10:05:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
1,1,1,2-Tetrachloroethane	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
1,1,1-Trichloroethane	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
1,1,2,2-Tetrachloroethane	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
1,1,2-Trichloroethane	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
1,1-Dichloroethane	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
1,1-Dichloroethene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
1,1-Dichloropropene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
1,2,3-Trichlorobenzene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
1,2,3-Trichloropropane	U	0.4	1.0		µg/L	1	9/2/2008 5:11:00 PM
1,2,4-Trichlorobenzene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
1,2,4-Trimethylbenzene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
1,2-Dibromo-3-chloropropane	U	0.4	1.0		µg/L	1	9/2/2008 5:11:00 PM
1,2-Dibromoethane	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
1,2-Dichlorobenzene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
1,2-Dichloroethane	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
1,2-Dichloropropane	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
1,3,5-Trimethylbenzene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
1,3-Dichlorobenzene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
1,3-dichloropropane	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
1,4-Dichlorobenzene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
2,2-Dichloropropane	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
2-Butanone	U	0.3	3.0		µg/L	1	9/2/2008 5:11:00 PM
2-Chloroethyl vinyl ether	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
2-Chlorotoluene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
2-Hexanone	U	0.3	2.0		µg/L	1	9/2/2008 5:11:00 PM
4-Chlorotoluene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
4-Isopropyltoluene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
4-Methyl-2-pentanone	U	0.3	2.0		µg/L	1	9/2/2008 5:11:00 PM
Acetone	U	0.3	2.0		µg/L	1	9/2/2008 5:11:00 PM
Benzene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Bromobenzene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Bromochloromethane	U	0.4	1.0		µg/L	1	9/2/2008 5:11:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
	LOQ Limit of Quantitation	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
	C Calibration %RSD/%D exceeded for non-CCC analytes	

American Analytical Laboratories, LLC.

Date: 04-Sep-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808394
Project: Rowe
Lab ID: 0808394-02A

Client Sample ID: WQ082608:NP2-7
Collection Date: 8/26/2008 10:05:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
Bromodichloromethane	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Bromoform	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Bromomethane	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Carbon disulfide	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Carbon tetrachloride	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Chlorobenzene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Chloroethane	U	0.4	1.0		µg/L	1	9/2/2008 5:11:00 PM
Chloroform	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Chloromethane	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
cis-1,2-Dichloroethene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
cis-1,3-Dichloropropene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Dibromochloromethane	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Dibromomethane	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Dichlorodifluoromethane	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Ethylbenzene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Hexachlorobutadiene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Isopropylbenzene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
m,p-Xylene	U	0.3	2.0		µg/L	1	9/2/2008 5:11:00 PM
Methyl tert-butyl ether	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Methylene chloride	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Naphthalene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
n-Butylbenzene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
n-Propylbenzene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
o-Xylene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
sec-Butylbenzene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Styrene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
tert-Butylbenzene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Tetrachloroethene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Toluene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
trans-1,2-Dichloroethene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
trans-1,3-Dichloropropene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Trichloroethene	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Trichlorofluoromethane	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 04-Sep-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ082608:NP2-7

Lab Order: 0808394

Collection Date: 8/26/2008 10:05:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808394-02A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B		Analyst: LA		
Vinyl acetate	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Vinyl chloride	U	0.3	1.0		µg/L	1	9/2/2008 5:11:00 PM
Surr: 4-Bromofluorobenzene	100	0	54-134		%REC	1	9/2/2008 5:11:00 PM
Surr: Dibromofluoromethane	90.0	0	52-132		%REC	1	9/2/2008 5:11:00 PM
Surr: Toluene-d8	101	0	51-127		%REC	1	9/2/2008 5:11:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 04-Sep-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808394
Project: Rowe
Lab ID: 0808394-02B

Client Sample ID: WQ082608:NP2-7
Collection Date: 8/26/2008 10:05:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL IRON				E200.7	SW3010A		Analyst: JP
Iron	1.81	0.005	0.0200		mg/L	1	8/29/2008 12:18:01 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 04-Sep-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808394
Project: Rowe
Lab ID: 0808394-02C

Client Sample ID: WQ082608:NP2-7
Collection Date: 8/26/2008 10:05:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
DISSOLVED IRON				E200.7	SW3005A		Analyst: JP
Iron	0.159	0.005	0.0200		mg/L	1	8/29/2008 12:15:58 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits
C Calibration %RSD/%D exceeded for non-CCC analytes

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
LOD Limit of Detection
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed but not detected.

American Analytical Laboratories, LLC.

Date: 04-Sep-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808394
Project: Rowe
Lab ID: 0808394-03A

Client Sample ID: WQ082608:NP2-10
Collection Date: 8/26/2008 10:10:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
1,1,1,2-Tetrachloroethane	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
1,1,1-Trichloroethane	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
1,1,2,2-Tetrachloroethane	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
1,1,2-Trichloroethane	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
1,1-Dichloroethane	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
1,1-Dichloroethene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
1,1-Dichloropropene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
1,2,3-Trichlorobenzene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
1,2,3-Trichloropropane	U	0.4	1.0		µg/L	1	9/4/2008 11:52:00 AM
1,2,4-Trichlorobenzene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
1,2,4-Trimethylbenzene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
1,2-Dibromo-3-chloropropane	U	0.4	1.0		µg/L	1	9/4/2008 11:52:00 AM
1,2-Dibromoethane	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
1,2-Dichlorobenzene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
1,2-Dichloroethane	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
1,2-Dichloropropane	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
1,3,5-Trimethylbenzene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
1,3-Dichlorobenzene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
1,3-dichloropropane	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
1,4-Dichlorobenzene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
2,2-Dichloropropane	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
2-Butanone	U	0.3	3.0		µg/L	1	9/4/2008 11:52:00 AM
2-Chloroethyl vinyl ether	U	0.3	1.0	C	µg/L	1	9/4/2008 11:52:00 AM
2-Chlorotoluene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
2-Hexanone	U	0.3	2.0		µg/L	1	9/4/2008 11:52:00 AM
4-Chlorotoluene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
4-Isopropyltoluene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
4-Methyl-2-pentanone	U	0.3	2.0		µg/L	1	9/4/2008 11:52:00 AM
Acetone	U	0.3	2.0		µg/L	1	9/4/2008 11:52:00 AM
Benzene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Bromobenzene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Bromochloromethane	U	0.4	1.0		µg/L	1	9/4/2008 11:52:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 04-Sep-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808394
Project: Rowe
Lab ID: 0808394-03A

Client Sample ID: WQ082608:NP2-10
Collection Date: 8/26/2008 10:10:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
Bromodichloromethane	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Bromoform	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Bromomethane	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Carbon disulfide	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Carbon tetrachloride	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Chlorobenzene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Chloroethane	U	0.4	1.0		µg/L	1	9/4/2008 11:52:00 AM
Chloroform	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Chloromethane	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
cis-1,2-Dichloroethene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
cis-1,3-Dichloropropene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Dibromochloromethane	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Dibromomethane	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Dichlorodifluoromethane	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Ethylbenzene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Hexachlorobutadiene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Isopropylbenzene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
m,p-Xylene	U	0.3	2.0		µg/L	1	9/4/2008 11:52:00 AM
Methyl tert-butyl ether	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Methylene chloride	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Naphthalene	U	0.3	1.0	C	µg/L	1	9/4/2008 11:52:00 AM
n-Butylbenzene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
n-Propylbenzene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
o-Xylene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
sec-Butylbenzene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Styrene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
tert-Butylbenzene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Tetrachloroethene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Toluene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
trans-1,2-Dichloroethene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
trans-1,3-Dichloropropene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Trichloroethene	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Trichlorofluoromethane	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
	LOQ Limit of Quantitation	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
	C Calibration %RSD/%D exceeded for non-CCC analytes	

American Analytical Laboratories, LLC.

Date: 04-Sep-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ082608:NP2-10

Lab Order: 0808394

Collection Date: 8/26/2008 10:10:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808394-03A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B		Analyst: LA		
Vinyl acetate	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Vinyl chloride	U	0.3	1.0		µg/L	1	9/4/2008 11:52:00 AM
Surr: 4-Bromofluorobenzene	98.9	0	54-134		%REC	1	9/4/2008 11:52:00 AM
Surr: Dibromofluoromethane	90.7	0	52-132		%REC	1	9/4/2008 11:52:00 AM
Surr: Toluene-d8	93.6	0	51-127		%REC	1	9/4/2008 11:52:00 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com

nel-c

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 04-Sep-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808394
Project: Rowe
Lab ID: 0808394-03B

Client Sample ID: WQ082608:NP2-10
Collection Date: 8/26/2008 10:10:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL IRON				E200.7	SW3010A		Analyst: JP
Iron	1.57	0.005	0.0200		mg/L	1	8/29/2008 12:22:05 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
LOQ	Limit of Quantitation	ND Not Detected at the Reporting Limit
S	Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
C	Calibration %RSD/%D exceeded for non-CCC analytes	

American Analytical Laboratories, LLC.

Date: 04-Sep-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808394
Project: Rowe
Lab ID: 0808394-03C

Client Sample ID: WQ082608:NP2-10
Collection Date: 8/26/2008 10:10:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
DISSOLVED IRON				E200.7	SW3005A		Analyst: JP
Iron	0.168	0.005	0.0200		mg/L	1	8/29/2008 12:20:03 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 04-Sep-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: WQ082608:NP2-10

Lab Order: 0808394

Collection Date: 8/26/2008 10:10:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808394-03D

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL DISSOLVED SOLIDS				M2540C			Analyst: AS
Total Dissolved Solids (Residue, Filterable)	124	0	1.00		mg/L	1	8/29/2008

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808394
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: V624LCS-090208Y		SampType: LCS		TestCode: 8260MTBE11		Units: µg/L		Prep Date:		RunNo: 38047	
Client ID: LCSW		Batch ID: R38047		TestNo: SW8260B				Analysis Date: 9/2/2008		SeqNo: 500149	
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,1,1-Trichloroethane	47	1.0	50.00	0	93.4	43	148				
1,1,2,2-Tetrachloroethane	44	1.0	50.00	0	88.7	32	148				
1,1,2-Trichloroethane	44	1.0	50.00	0	87.6	42	136				
1,1-Dichloroethane	45	1.0	50.00	0	90.9	40	150				
1,1-Dichloroethene	61	1.0	50.00	0	121	30	154				
1,2-Dichlorobenzene	44	1.0	50.00	0	88.5	40	129				
1,2-Dichloroethane	46	1.0	50.00	0	91.7	36	141				
1,2-Dichloropropane	42	1.0	50.00	0	83.6	44	138				
1,3-Dichlorobenzene	44	1.0	50.00	0	88.5	40	133				
1,4-Dichlorobenzene	45	1.0	50.00	0	90.0	40	135				
2-Butanone	77	3.0	125.0	0	61.9	35	135				
2-Chloroethyl vinyl ether	33	1.0	50.00	0	66.9	21	139				
2-Hexanone	74	2.0	125.0	0	59.5	35	135				
4-Methyl-2-pentanone	79	2.0	125.0	0	63.4	35	135				
Benzene	47	1.0	50.00	0	93.8	45	144				
Bromodichloromethane	44	1.0	50.00	0	87.8	35	136				
Bromoform	51	1.0	50.00	0	102	28	138				
Bromomethane	39	1.0	50.00	0	79.0	26	148				
Carbon tetrachloride	48	1.0	50.00	0	95.9	45	141				
Chlorobenzene	48	1.0	50.00	0	96.5	41	142				
Chloroethane	42	1.0	50.00	0	83.9	36	143				
Chloroform	47	1.0	50.00	0	94.4	42	137				
Chloromethane	43	1.0	50.00	0	85.5	35	151				
cis-1,3-Dichloropropene	42	1.0	50.00	0	83.9	42	130				
Dibromochloromethane	43	1.0	50.00	0	86.3	21	134				
Ethylbenzene	49	1.0	50.00	0	97.1	45	146				
Tetrachloroethene	45	1.0	50.00	0	90.7	45	136				
Toluene	47	1.0	50.00	0	93.3	43	134				
trans-1,2-Dichloroethene	47	1.0	50.00	0	93.9	42	135				
trans-1,3-Dichloropropene	44	1.0	50.00	0	88.9	37	133				

Qualifiers: E Value above quantitation range

LOD Limit of Detection

R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded

LOQ Limit of Quantitation

S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li

ND Not Detected at the Reporting Limit

U Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808394
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: V624LCS-090208Y	SampType: LCS	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 38047						
Client ID: LCSW	Batch ID: R38047	TestNo: SW8260B		Analysis Date: 9/2/2008	SeqNo: 500149						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Trichloroethene	46	1.0	50.00	0	91.1	43	140				
Trichlorofluoromethane	47	1.0	50.00	0	94.2	50	148				
Vinyl chloride	46	1.0	50.00	0	91.1	35	142				
Surr: 4-Bromofluorobenzene	52		50.00		105	54	134				
Surr: Dibromofluoromethane	47		50.00		93.4	52	132				
Surr: Toluene-d8	49		50.00		98.9	51	127				

Sample ID: VBLK-090208Y	Samp Type: MBLK	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 38047						
Client ID: PBW	Batch ID: R38047	TestNo: SW8260B		Analysis Date: 9/2/2008	SeqNo: 500150						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

1,1,1,2-Tetrachloroethane	U	1.0									
1,1,1-Trichloroethane	U	1.0									
1,1,2,2-Tetrachloroethane	U	1.0									
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0									
1,1,2-Trichloroethane	U	1.0									
1,1-Dichloroethane	U	1.0									
1,1-Dichloroethene	U	1.0									
1,1-Dichloropropene	U	1.0									
1,2,3-Trichlorobenzene	U	1.0									
1,2,3-Trichloropropene	U	1.0									
1,2,4-Trichlorobenzene	U	1.0									
1,2,4-Trimethylbenzene	U	1.0									
1,2-Dibromo-3-chloropropene	U	1.0									
1,2-Dibromoethane	U	1.0									
1,2-Dichlorobenzene	U	1.0									
1,2-Dichloroethane	U	1.0									
1,2-Dichloropropene	U	1.0									
1,3,5-Trimethylbenzene	U	1.0									
1,3-Dichlorobenzene	U	1.0									
1,3-dichloropropene	U	1.0									

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggettte Brashears & Graham Inc.
Work Order: 0808394
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: VBLK-090208Y		SampType: MBLK		TestCode: 8260MTBE11		Units: µg/L		Prep Date:		RunNo: 38047		
Client ID: PBW		Batch ID: R38047		TestNo: SW8260B				Analysis Date: 9/2/2008		SeqNo: 500150		
Analyte		Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,4-Dichlorobenzene		U	1.0									
2,2-Dichloropropane		U	1.0									
2-Butanone		U	3.0									
2-Chloroethyl vinyl ether		U	1.0									
2-Chlorotoluene		U	1.0									
2-Hexanone		U	2.0									
4-Chlorotoluene		U	1.0									
4-Isopropyltoluene		U	1.0									
4-Methyl-2-pentanone		U	2.0									
Acetone		U	2.0									
Benzene		U	1.0									
Bromobenzene		U	1.0									
Bromochloromethane		U	1.0									
Bromodichloromethane		U	1.0									
Bromoform		U	1.0									
Bromomethane		U	1.0									
Carbon disulfide		U	1.0									
Carbon tetrachloride		U	1.0									
Chlorobenzene		U	1.0									
Chloroethane		U	1.0									
Chloroform		U	1.0									
Chloromethane		U	1.0									
cis-1,2-Dichloroethene		U	1.0									
cis-1,3-Dichloropropene		U	1.0									
Dibromochloromethane		U	1.0									
Dibromomethane		U	1.0									
Dichlorodifluoromethane		U	1.0									
Ethylbenzene		U	1.0									
Hexachlorobutadiene		U	1.0									
Isopropylbenzene		U	1.0									
m,p-Xylene		U	2.0									

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808394
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: VBLK-090208Y	SampType: MBLK	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 38047						
Client ID: PBW	Batch ID: R38047	TestNo: SW8260B		Analysis Date: 9/2/2008	SeqNo: 500150						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Methyl tert-butyl ether	U	1.0									
Methylene chloride	U	1.0									
Naphthalene	U	1.0									
n-Butylbenzene	U	1.0									
n-Propylbenzene	U	1.0									
o-Xylene	U	1.0									
sec-Butylbenzene	U	1.0									
Styrene	U	1.0									
tert-Butylbenzene	U	1.0									
Tetrachloroethene	U	1.0									
Toluene	U	1.0									
trans-1,2-Dichloroethene	U	1.0									
trans-1,3-Dichloropropene	U	1.0									
Trichloroethene	U	1.0									
Trichlorofluoromethane	U	1.0									
Vinyl acetate	U	1.0									
Vinyl chloride	U	1.0									
Surr: 4-Bromofluorobenzene	54		50.00		108	54	134				
Surr: Dibromofluoromethane	47		50.00		93.6	52	132				
Surr: Toluene-d8	48		50.00		96.0	51	127				

Sample ID: V624LCS-090208Y		SampType: LCS		TestCode: 8260MTBE11		Units: µg/L		Prep Date:		RunNo: 38047			
Client ID: LCSW		Batch ID: R38047a		TestNo: SW8260B				Analysis Date: 9/2/2008		SeqNo: 500153			
Analyte		Result		PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,1,1-Trichloroethane		49		1.0	50.00	0	98.0	43		148			
1,1,2,2-Tetrachloroethane		44		1.0	50.00	0	87.4	32		148			
1,1,2-Trichloroethane		43		1.0	50.00	0	85.6	42		136			
1,1-Dichloroethane		46		1.0	50.00	0	92.8	40		150			
1,1-Dichloroethene		56		1.0	50.00	0	113	30		154			
1,2-Dichlorobenzene		46		1.0	50.00	0	92.1	40		129			

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits
H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits
J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808394
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: V624LCS-090208Y		SampType: LCS		TestCode: 8260MTBE11		Units: µg/L		Prep Date:		RunNo: 38047	
Client ID: LCSW		Batch ID: R38047a		TestNo: SW8260B				Analysis Date: 9/2/2008		SeqNo: 500153	
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,2-Dichloroethane	45	1.0	50.00	0	89.1	36	141				
1,2-Dichloropropane	40	1.0	50.00	0	80.6	44	138				
1,3-Dichlorobenzene	48	1.0	50.00	0	96.5	40	133				
1,4-Dichlorobenzene	48	1.0	50.00	0	96.0	40	135				
2-Butanone	68	3.0	125.0	0	54.4	35	135				
2-Chloroethyl vinyl ether	32	1.0	50.00	0	64.9	21	139				
2-Hexanone	69	2.0	125.0	0	54.8	35	135				
4-Methyl-2-pentanone	68	2.0	125.0	0	54.8	35	135				
Benzene	45	1.0	50.00	0	90.3	45	144				
Bromodichloromethane	43	1.0	50.00	0	85.1	35	136				
Bromoform	53	1.0	50.00	0	106	28	138				
Bromomethane	45	1.0	50.00	0	89.9	26	148				
Carbon tetrachloride	49	1.0	50.00	0	98.7	45	141				
Chlorobenzene	49	1.0	50.00	0	98.3	41	142				
Chloroethane	44	1.0	50.00	0	87.8	36	143				
Chloroform	45	1.0	50.00	0	89.5	42	137				
Chloromethane	45	1.0	50.00	0	90.8	35	151				
cis-1,3-Dichloropropene	40	1.0	50.00	0	81.0	42	130				
Dibromochloromethane	40	1.0	50.00	0	80.9	21	134				
Ethylbenzene	50	1.0	50.00	0	101	45	146				
Tetrachloroethene	44	1.0	50.00	0	87.6	45	136				
Toluene	45	1.0	50.00	0	89.8	43	134				
trans-1,2-Dichloroethene	48	1.0	50.00	0	95.5	42	135				
trans-1,3-Dichloropropene	42	1.0	50.00	0	84.6	37	133				
Trichloroethene	46	1.0	50.00	0	91.8	43	140				
Trichlorofluoromethane	46	1.0	50.00	0	92.8	50	148				
Vinyl chloride	45	1.0	50.00	0	90.9	35	142				
Surr: 4-Bromofluorobenzene	52		50.00		104	54	134				
Surr: Dibromofluoromethane	46		50.00		92.5	52	132				
Surr: Toluene-d8	44		50.00		87.3	51	127				

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808394
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: VBLK-090208Y		SampType: MBLK		TestCode: 8260MTBE11		Units: µg/L		Prep Date:		RunNo: 38047			
Client ID: PBW		Batch ID: R38047a		TestNo: SW8260B				Analysis Date: 9/2/2008		SeqNo: 500154			
Analyte		Result		PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,1,1,2-Tetrachloroethane		U		1.0									
1,1,1-Trichloroethane		U		1.0									
1,1,2,2-Tetrachloroethane		U		1.0									
1,1,2-Trichloro-1,2,2-trifluoroethane		U		1.0									
1,1,2-Trichloroethane		U		1.0									
1,1-Dichloroethane		U		1.0									
1,1-Dichloroethene		U		1.0									
1,1-Dichloropropene		U		1.0									
1,2,3-Trichlorobenzene		U		1.0									
1,2,3-Trichloropropane		U		1.0									
1,2,4-Trichlorobenzene		U		1.0									
1,2,4-Trimethylbenzene		U		1.0									
1,2-Dibromo-3-chloropropane		U		1.0									
1,2-Dibromoethane		U		1.0									
1,2-Dichlorobenzene		U		1.0									
1,2-Dichloroethane		U		1.0									
1,2-Dichloropropane		U		1.0									
1,3,5-Trimethylbenzene		U		1.0									
1,3-Dichlorobenzene		U		1.0									
1,3-dichloropropane		U		1.0									
1,4-Dichlorobenzene		U		1.0									
2,2-Dichloropropane		U		1.0									
2-Butanone		U		3.0									
2-Chloroethyl vinyl ether		U		1.0									
2-Chlorotoluene		U		1.0									
2-Hexanone		U		2.0									
4-Chlorotoluene		U		1.0									
4-Isopropyltoluene		U		1.0									
4-Methyl-2-pentanone		U		2.0									
Acetone		U		2.0									
Benzene		U		1.0									

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808394
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: VBLK-090208Y	SampType: MBLK	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 38047						
Client ID: PBW	Batch ID: R38047a	TestNo: SW8260B		Analysis Date: 9/2/2008	SeqNo: 500154						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Bromobenzene	U	1.0									
Bromochloromethane	U	1.0									
Bromodichloromethane	U	1.0									
Bromoform	U	1.0									
Bromomethane	U	1.0									
Carbon disulfide	U	1.0									
Carbon tetrachloride	U	1.0									
Chlorobenzene	U	1.0									
Chloroethane	U	1.0									
Chloroform	U	1.0									
Chloromethane	U	1.0									
cis-1,2-Dichloroethene	U	1.0									
cis-1,3-Dichloropropene	U	1.0									
Dibromochloromethane	U	1.0									
Dibromomethane	U	1.0									
Dichlorodifluoromethane	U	1.0									
Ethylbenzene	U	1.0									
Hexachlorobutadiene	U	1.0									
Isopropylbenzene	U	1.0									
m,p-Xylene	U	2.0									
Methyl tert-butyl ether	U	1.0									
Methylene chloride	U	1.0									
Naphthalene	U	1.0									
n-Butylbenzene	U	1.0									
n-Propylbenzene	U	1.0									
o-Xylene	U	1.0									
sec-Butylbenzene	U	1.0									
Styrene	U	1.0									
tert-Butylbenzene	U	1.0									
Tetrachloroethene	U	1.0									
Toluene	U	1.0									

Qualifiers: E Value above quantitation range H Holding times for preparation or analysis exceeded J Analyte detected below quantitation li
LOD Limit of Detection LOQ Limit of Quantitation ND Not Detected at the Reporting Limit
R RPD outside accepted recovery limits S Spike Recovery outside accepted recovery limits U Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808394
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: VBLK-090208Y	SampType: MBLK	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 38047						
Client ID: PBW	Batch ID: R38047a	TestNo: SW8260B		Analysis Date: 9/2/2008	SeqNo: 500154						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

trans-1,2-Dichloroethene	U	1.0									
trans-1,3-Dichloropropene	U	1.0									
Trichloroethene	U	1.0									
Trichlorofluoromethane	U	1.0									
Vinyl acetate	U	1.0									
Vinyl chloride	U	1.0									
Surr: 4-Bromofluorobenzene	53		50.00		105	54	134				
Surr: Dibromofluoromethane	46		50.00		92.5	52	132				
Surr: Toluene-d8	46		50.00		92.8	51	127				

Sample ID: V624LCS-090408Y	SampType: LCS	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 38047						
Client ID: LCSW	Batch ID: R38047b	TestNo: SW8260B		Analysis Date: 9/4/2008	SeqNo: 500500						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

1,1,1-Trichloroethane	49	1.0	50.00	0	98.0	43	148				
1,1,2,2-Tetrachloroethane	44	1.0	50.00	0	87.4	32	148				
1,1,2-Trichloroethane	46	1.0	50.00	0	91.4	42	136				
1,1-Dichloroethane	46	1.0	50.00	0	91.4	40	150				
1,1-Dichloroethene	62	1.0	50.00	0	124	30	154				
1,2-Dichlorobenzene	46	1.0	50.00	0	92.7	40	129				
1,2-Dichloroethane	47	1.0	50.00	0	93.4	36	141				
1,2-Dichloropropane	46	1.0	50.00	0	91.8	44	138				
1,3-Dichlorobenzene	48	1.0	50.00	0	95.8	40	133				
1,4-Dichlorobenzene	49	1.0	50.00	0	97.9	40	135				
2-Butanone	74	3.0	125.0	0	59.6	35	135				
2-Chloroethyl vinyl ether	34	1.0	50.00	0	69.0	21	139				C
2-Hexanone	74	2.0	125.0	0	58.9	35	135				
4-Methyl-2-pentanone	81	2.0	125.0	0	64.4	35	135				
Acetone	72	2.0	125.0	0	57.2	35	135				
Benzene	45	1.0	50.00	0	90.7	45	144				
Bromodichloromethane	46	1.0	50.00	0	92.8	35	136				

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808394
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: V624LCS-090408Y	SampType: LCS	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 38047						
Client ID: LCSW	Batch ID: R38047b	TestNo: SW8260B		Analysis Date: 9/4/2008	SeqNo: 500500						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Bromoform	54	1.0	50.00	0	109	28	138				
Bromomethane	41	1.0	50.00	0	82.7	26	148				
Carbon tetrachloride	51	1.0	50.00	0	102	45	141				
Chlorobenzene	55	1.0	50.00	0	110	41	142				
Chloroethane	43	1.0	50.00	0	85.7	36	143				
Chloroform	47	1.0	50.00	0	94.2	42	137				
Chloromethane	43	1.0	50.00	0	86.3	35	151				
cis-1,3-Dichloropropene	46	1.0	50.00	0	91.2	42	130				
Dibromochloromethane	43	1.0	50.00	0	86.6	21	134				
Ethylbenzene	54	1.0	50.00	0	109	45	146				
Methylene chloride	U	1.0	50.00	0	115	30	148				
Tetrachloroethene	49	1.0	50.00	0	97.8	45	136				
Toluene	54	1.0	50.00	0	108	43	134				
trans-1,2-Dichloroethene	50	1.0	50.00	0	99.1	42	135				
trans-1,3-Dichloropropene	46	1.0	50.00	0	92.3	37	133				
Trichloroethene	50	1.0	50.00	0	101	43	140				
Trichlorofluoromethane	49	1.0	50.00	0	97.1	50	148				
Vinyl chloride	46	1.0	50.00	0	91.8	35	142				
Surr: 4-Bromofluorobenzene	54		50.00		107	54	134				
Surr: Dibromofluoromethane	46		50.00		92.8	52	132				
Surr: Toluene-d8	46		50.00		92.5	51	127				

Sample ID: VBLK-090408Y	SampType: MBLK	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 38047						
Client ID: PBW	Batch ID: R38047b	TestNo: SW8260B		Analysis Date: 9/4/2008	SeqNo: 500501						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

1,1,1,2-Tetrachloroethane	U	1.0									
1,1,1-Trichloroethane	U	1.0									
1,1,2,2-Tetrachloroethane	U	1.0									
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0									
1,1,2-Trichloroethane	U	1.0									

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

CLIENT: Legette Brashears & Graham Inc.
Work Order: 0808394
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: VBLK-090408Y	SampleType: MBLK	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 38047						
Client ID: PBW	Batch ID: R38047b	TestNo: SW8260B		Analysis Date: 9/4/2008	SeqNo: 500501						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,1-Dichloroethane	U	1.0									
1,1-Dichloroethene	U	1.0									
1,1-Dichloropropene	U	1.0									
1,2,3-Trichlorobenzene	U	1.0									
1,2,3-Trichloropropane	U	1.0									
1,2,4-Trichlorobenzene	U	1.0									
1,2,4-Trimethylbenzene	U	1.0									
1,2-Dibromo-3-chloropropane	U	1.0									
1,2-Dibromoethane	U	1.0									
1,2-Dichlorobenzene	U	1.0									
1,2-Dichloroethane	U	1.0									
1,2-Dichloropropane	U	1.0									
1,3,5-Trimethylbenzene	U	1.0									
1,3-Dichlorobenzene	U	1.0									
1,3-dichloropropane	U	1.0									
1,4-Dichlorobenzene	U	1.0									
2,2-Dichloropropane	U	1.0									
2-Butanone	U	3.0									
2-Chloroethyl vinyl ether	U	1.0									C
2-Chlorotoluene	U	1.0									
2-Hexanone	U	2.0									
4-Chlorotoluene	U	1.0									
4-Isopropyltoluene	U	1.0									
4-Methyl-2-pentanone	U	2.0									
Acetone	U	2.0									
Benzene	U	1.0									
Bromobenzene	U	1.0									
Bromochloromethane	U	1.0									
Bromodichloromethane	U	1.0									
Bromoform	U	1.0									
Bromomethane	U	1.0									

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
	LOD	Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	R	RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808394
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: VBLK-090408Y		SampType: MBLK		TestCode: 8260MTBE11		Units: µg/L		Prep Date:		RunNo: 38047		
Client ID: PBW		Batch ID: R38047b		TestNo: SW8260B				Analysis Date: 9/4/2008		SeqNo: 500501		
Analyte		Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Carbon disulfide		U	1.0									
Carbon tetrachloride		U	1.0									
Chlorobenzene		U	1.0									
Chloroethane		U	1.0									
Chloroform		U	1.0									
Chloromethane		U	1.0									
cis-1,2-Dichloroethene		U	1.0									
cis-1,3-Dichloropropene		U	1.0									
Dibromochloromethane		U	1.0									
Dibromomethane		U	1.0									
Dichlorodifluoromethane		U	1.0									
Ethylbenzene		U	1.0									
Hexachlorobutadiene		U	1.0									
Isopropylbenzene		U	1.0									
m,p-Xylene		U	2.0									
Methyl tert-butyl ether		U	1.0									
Methylene chloride		U	1.0									
Naphthalene		U	1.0									
n-Butylbenzene		U	1.0									
n-Propylbenzene		U	1.0									
o-Xylene		U	1.0									
sec-Butylbenzene		U	1.0									
Styrene		U	1.0									
tert-Butylbenzene		U	1.0									
Tetrachloroethene		U	1.0									
Toluene		U	1.0									
trans-1,2-Dichloroethene		U	1.0									
trans-1,3-Dichloropropene		U	1.0									
Trichloroethene		U	1.0									
Trichlorofluoromethane		U	1.0									
Vinyl acetate		U	1.0									

C

C

Qualifiers: E Value above quantitation range
 LOD Limit of Detection
 R RPD outside accepted recovery limits
 H Holding times for preparation or analysis exceeded
 LOQ Limit of Quantitation
 S Spike Recovery outside accepted recovery limits
 J Analyte detected below quantitation li
 ND Not Detected at the Reporting Limit
 U Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808394
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: VBLK-090408Y	SampType: MBLK	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 38047						
Client ID: PBW	Batch ID: R38047b	TestNo: SW8260B		Analysis Date: 9/4/2008	SeqNo: 500501						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Vinyl chloride	U	1.0									
Surr: 4-Bromofluorobenzene	50		50.00		100	54	134				
Surr: Dibromofluoromethane	44		50.00		87.1	52	132				
Surr: Toluene-d8	45		50.00		89.6	51	127				

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
	LOD	Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	R	RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808394
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: FE_T

Sample ID: PBW-082908A	SampType: MBLK	TestCode: FE_T	Units: mg/L	Prep Date: 8/29/2008	RunNo: 38014					
Client ID: PBW	Batch ID: 22800	TestNo: E200.7	SW3010A	Analysis Date: 8/29/2008	SeqNo: 499869					
Analyte	Result	PQL	SPK value	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Iron	U	0.0200								

Sample ID: LCSW-082908A	SampType: LCS	TestCode: FE_T	Units: mg/L	Prep Date: 8/29/2008	RunNo: 38014					
Client ID: LCSW	Batch ID: 22800	TestNo: E200.7	SW3010A	Analysis Date: 8/29/2008	SeqNo: 499870					
Analyte	Result	PQL	SPK value	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Iron	1.90	0.0200	2.000	94.8	68	122				

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
LOD	LOD	Limit of Detection	LOQ	Limit of Quantitation	NID	Not Detected at the Reporting Limit
R	R	RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggettie Brashears & Graham Inc.
Work Order: 0808394
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: TDS_W

Sample ID: MB-R38038	SampleType: MBLK	TestCode: TDS_W	Units: mg/L	Prep Date:	RunNo: 38038						
Client ID: PBW	Batch ID: R38038	TestNo: M2540C		Analysis Date: 8/29/2008	SeqNo: 500100						
Analyte	Result	PQL	SPK value	SPK RefVal	%REC	LowLimit	HighLimit	RPD RefVal	%RPD	RPDLimit	Qual
Total Dissolved Solids (Residue, Filtera		U	1.00								

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

Monday, August 25, 2008

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe

Order No.: 0808217

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 8 sample(s) on 8/15/2008 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The results reported herein relate only to the items tested or to the samples as received by the laboratory. This report may not be reproduced, except in full, without the approval of American Analytical Laboratories, LLC and is not considered complete without a cover page and chain of custody documentation. The limits (LOQ) provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications. If there are any exceptions a Case Narrative is provided in the report. This package has been reviewed by American Analytical Laboratories' QA Department/Laboratory Director to comply with NELAC standards prior to report submittal.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,



Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 25-Aug-08

CLIENT: Leggette Brashears & Graham Inc.**Project:** Rowe**Lab Order:** 0808217**Work Order Sample Summary**

Lab Sample ID	Client Sample ID	Date Collected	Date Received
0808217-01A	GWQ081208:1030NP1-1-2	8/12/2008 10:30:00 AM	8/15/2008
0808217-01B	GWQ081208:1030NP1-1-2	8/12/2008 10:30:00 AM	8/15/2008
0808217-01C	GWQ081208:1030NP1-1-2	8/12/2008 10:30:00 AM	8/15/2008
0808217-02A	GWQ081208:1040NP1-1-3	8/12/2008 10:40:00 AM	8/15/2008
0808217-02B	GWQ081208:1040NP1-1-3	8/12/2008 10:40:00 AM	8/15/2008
0808217-02C	GWQ081208:1040NP1-1-3	8/12/2008 10:40:00 AM	8/15/2008
0808217-03A	GWQ081208:1050NP1-1-4	8/12/2008 10:50:00 AM	8/15/2008
0808217-03B	GWQ081208:1050NP1-1-4	8/12/2008 10:50:00 AM	8/15/2008
0808217-03C	GWQ081208:1050NP1-1-4	8/12/2008 10:50:00 AM	8/15/2008
0808217-04A	GWQ081208:1100NP1-1-5	8/12/2008 11:00:00 AM	8/15/2008
0808217-04B	GWQ081208:1100NP1-1-5	8/12/2008 11:00:00 AM	8/15/2008
0808217-04C	GWQ081208:1100NP1-1-5	8/12/2008 11:00:00 AM	8/15/2008
0808217-05A	GWQ081208:1110NP1-1-6	8/12/2008 11:10:00 AM	8/15/2008
0808217-05B	GWQ081208:1110NP1-1-6	8/12/2008 11:10:00 AM	8/15/2008
0808217-05C	GWQ081208:1110NP1-1-6	8/12/2008 11:10:00 AM	8/15/2008
0808217-06A	GWQ081208:1120NP1-1-7	8/12/2008 11:20:00 AM	8/15/2008
0808217-06B	GWQ081208:1120NP1-1-7	8/12/2008 11:20:00 AM	8/15/2008
0808217-06C	GWQ081208:1120NP1-1-7	8/12/2008 11:20:00 AM	8/15/2008
0808217-07A	GWQ081208:1130NP1-1-8	8/12/2008 11:30:00 AM	8/15/2008
0808217-07B	GWQ081208:1130NP1-1-8	8/12/2008 11:30:00 AM	8/15/2008
0808217-07C	GWQ081208:1130NP1-1-8	8/12/2008 11:30:00 AM	8/15/2008
0808217-08A	GWQ081208:1140NP1-1-9	8/12/2008 11:40:00 AM	8/15/2008
0808217-08B	GWQ081208:1140NP1-1-9	8/12/2008 11:40:00 AM	8/15/2008
0808217-08C	GWQ081208:1140NP1-1-9	8/12/2008 11:40:00 AM	8/15/2008

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

[illegible]

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC

56 TOLEDO STREET

FARMINGDALE, NEW YORK 11735

TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value.
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of the method allowable holding time.

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ081208:1030NP1-1-2

Lab Order: 0808217

Collection Date: 8/12/2008 10:30:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808217-01A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
1,1,1,2-Tetrachloroethane	U	0.09	1.0		µg/L	1	8/21/2008 2:50:00 PM
1,1,1-Trichloroethane	1.3	0.17	1.0		µg/L	1	8/21/2008 2:50:00 PM
1,1,1,2,2-Tetrachloroethane	U	0.06	1.0		µg/L	1	8/21/2008 2:50:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	0.13	1.0		µg/L	1	8/21/2008 2:50:00 PM
1,1,2-Trichloroethane	U	0.07	1.0		µg/L	1	8/21/2008 2:50:00 PM
1,1-Dichloroethane	U	0.11	1.0		µg/L	1	8/21/2008 2:50:00 PM
1,1-Dichloroethene	U	0.15	1.0		µg/L	1	8/21/2008 2:50:00 PM
1,1-Dichloropropene	U	0.12	1.0		µg/L	1	8/21/2008 2:50:00 PM
1,2,3-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 2:50:00 PM
1,2,3-Trichloropropane	U	0.08	1.0		µg/L	1	8/21/2008 2:50:00 PM
1,2,4-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 2:50:00 PM
1,2,4-Trimethylbenzene	U	0.09	1.0		µg/L	1	8/21/2008 2:50:00 PM
1,2-Dibromo-3-chloropropane	U	0.09	1.0		µg/L	1	8/21/2008 2:50:00 PM
1,2-Dibromoethane	U	0.06	1.0		µg/L	1	8/21/2008 2:50:00 PM
1,2-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 2:50:00 PM
1,2-Dichloroethane	U	0.08	1.0		µg/L	1	8/21/2008 2:50:00 PM
1,2-Dichloropropane	U	0.1	1.0		µg/L	1	8/21/2008 2:50:00 PM
1,3,5-Trimethylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 2:50:00 PM
1,3-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 2:50:00 PM
1,3-dichloropropane	U	0.08	1.0		µg/L	1	8/21/2008 2:50:00 PM
1,4-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 2:50:00 PM
2,2-Dichloropropane	U	0.11	1.0		µg/L	1	8/21/2008 2:50:00 PM
2-Butanone	U	1.28	3.0		µg/L	1	8/21/2008 2:50:00 PM
2-Chloroethyl vinyl ether	U	0.08	1.0		µg/L	1	8/21/2008 2:50:00 PM
2-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 2:50:00 PM
2-Hexanone	U	0.22	2.0		µg/L	1	8/21/2008 2:50:00 PM
4-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 2:50:00 PM
4-Isopropyltoluene	U	0.1	1.0		µg/L	1	8/21/2008 2:50:00 PM
4-Methyl-2-pentanone	U	0.21	2.0		µg/L	1	8/21/2008 2:50:00 PM
Acetone	U	0.19	2.0		µg/L	1	8/21/2008 2:50:00 PM
Benzene	U	0.11	1.0		µg/L	1	8/21/2008 2:50:00 PM
Bromobenzene	U	0.07	1.0		µg/L	1	8/21/2008 2:50:00 PM
Bromochloromethane	U	0.4	1.0		µg/L	1	8/21/2008 2:50:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
	LOQ Limit of Quantitation	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
	C Calibration %RSD/%D exceeded for non-CCC analytes	

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808217
Project: Rowe
Lab ID: 0808217-01A

Client Sample ID: GWQ081208:1030NP1-1-2
Collection Date: 8/12/2008 10:30:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113				SW8260B		Analyst: LA	
Bromodichloromethane	U	0.08	1.0		µg/L	1	8/21/2008 2:50:00 PM
Bromoform	U	0.06	1.0		µg/L	1	8/21/2008 2:50:00 PM
Bromomethane	U	0.17	1.0		µg/L	1	8/21/2008 2:50:00 PM
Carbon disulfide	U	0.14	1.0		µg/L	1	8/21/2008 2:50:00 PM
Carbon tetrachloride	U	0.16	1.0		µg/L	1	8/21/2008 2:50:00 PM
Chlorobenzene	U	0.09	1.0		µg/L	1	8/21/2008 2:50:00 PM
Chloroethane	U	0.16	1.0		µg/L	1	8/21/2008 2:50:00 PM
Chloroform	U	0.1	1.0		µg/L	1	8/21/2008 2:50:00 PM
Chloromethane	U	0.18	1.0		µg/L	1	8/21/2008 2:50:00 PM
cis-1,2-Dichloroethene	U	0.11	1.0		µg/L	1	8/21/2008 2:50:00 PM
cis-1,3-Dichloropropene	U	0.08	1.0		µg/L	1	8/21/2008 2:50:00 PM
Dibromochloromethane	U	0.07	1.0		µg/L	1	8/21/2008 2:50:00 PM
Dibromomethane	U	0.07	1.0		µg/L	1	8/21/2008 2:50:00 PM
Dichlorodifluoromethane	U	0.15	1.0	C	µg/L	1	8/21/2008 2:50:00 PM
Ethylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 2:50:00 PM
Hexachlorobutadiene	U	0.12	1.0		µg/L	1	8/21/2008 2:50:00 PM
Isopropylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 2:50:00 PM
m,p-Xylene	U	0.2	2.0		µg/L	1	8/21/2008 2:50:00 PM
Methyl tert-butyl ether	U	0.08	1.0		µg/L	1	8/21/2008 2:50:00 PM
Methylene chloride	U	0.08	1.0	C	µg/L	1	8/21/2008 2:50:00 PM
Naphthalene	U	0.08	1.0	C	µg/L	1	8/21/2008 2:50:00 PM
n-Butylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 2:50:00 PM
n-Propylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 2:50:00 PM
o-Xylene	U	0.1	1.0		µg/L	1	8/21/2008 2:50:00 PM
sec-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 2:50:00 PM
Styrene	U	0.08	1.0		µg/L	1	8/21/2008 2:50:00 PM
tert-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 2:50:00 PM
Tetrachloroethene	2.5	0.12	1.0		µg/L	1	8/21/2008 2:50:00 PM
Toluene	U	0.12	1.0		µg/L	1	8/21/2008 2:50:00 PM
trans-1,2-Dichloroethene	U	0.12	1.0		µg/L	1	8/21/2008 2:50:00 PM
trans-1,3-Dichloropropene	U	0.07	1.0		µg/L	1	8/21/2008 2:50:00 PM
Trichloroethene	U	0.13	1.0		µg/L	1	8/21/2008 2:50:00 PM
Trichlorofluoromethane	U	0.15	1.0		µg/L	1	8/21/2008 2:50:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ081208:1030NP1-1-2

Lab Order: 0808217

Collection Date: 8/12/2008 10:30:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808217-01A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
Vinyl acetate	U	0.06	1.0		µg/L	1	8/21/2008 2:50:00 PM
Vinyl chloride	U	0.14	1.0		µg/L	1	8/21/2008 2:50:00 PM
Surr: 4-Bromofluorobenzene	98.3	0	54-134		%REC	1	8/21/2008 2:50:00 PM
Surr: Dibromofluoromethane	95.6	0	52-132		%REC	1	8/21/2008 2:50:00 PM
Surr: Toluene-d8	100	0	51-127		%REC	1	8/21/2008 2:50:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.**Date:** 25-Aug-08**ELAP ID :** 11418**CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ081208:1030NP1-1-2**Lab Order:** 0808217**Collection Date:** 8/12/2008 10:30:00 AM**Project:** Rowe**Matrix:** LIQUID**Lab ID:** 0808217-01B**Certificate of Results**

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL IRON				E200.7	SW3010A		Analyst: JP
Iron	4.40	0.005	0.0200		mg/L	1	8/20/2008 10:30:09 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.**Date:** 25-Aug-08**ELAP ID : 11418****CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ081208:1030NP1-1-2**Lab Order:** 0808217**Collection Date:** 8/12/2008 10:30:00 AM**Project:** Rowe**Matrix:** LIQUID**Lab ID:** 0808217-01C**Certificate of Results**

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
DISSOLVED IRON				E200.7	SW3010A		Analyst: JP
Iron	0.0279	0.005	0.0200		mg/L	1	8/20/2008 10:28:05 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808217
Project: Rowe
Lab ID: 0808217-02A

Client Sample ID: GWQ081208:1040NP1-1-3
Collection Date: 8/12/2008 10:40:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113				SW8260B		Analyst: LA	
1,1,1,2-Tetrachloroethane	U	0.09	1.0		µg/L	1	8/21/2008 3:20:00 PM
1,1,1-Trichloroethane	1.1	0.17	1.0		µg/L	1	8/21/2008 3:20:00 PM
1,1,2,2-Tetrachloroethane	U	0.06	1.0		µg/L	1	8/21/2008 3:20:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	0.13	1.0		µg/L	1	8/21/2008 3:20:00 PM
1,1,2-Trichloroethane	U	0.07	1.0		µg/L	1	8/21/2008 3:20:00 PM
1,1-Dichloroethane	U	0.11	1.0		µg/L	1	8/21/2008 3:20:00 PM
1,1-Dichloroethene	U	0.15	1.0		µg/L	1	8/21/2008 3:20:00 PM
1,1-Dichloropropene	U	0.12	1.0		µg/L	1	8/21/2008 3:20:00 PM
1,2,3-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 3:20:00 PM
1,2,3-Trichloropropane	U	0.08	1.0		µg/L	1	8/21/2008 3:20:00 PM
1,2,4-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 3:20:00 PM
1,2,4-Trimethylbenzene	U	0.09	1.0		µg/L	1	8/21/2008 3:20:00 PM
1,2-Dibromo-3-chloropropane	U	0.09	1.0		µg/L	1	8/21/2008 3:20:00 PM
1,2-Dibromoethane	U	0.06	1.0		µg/L	1	8/21/2008 3:20:00 PM
1,2-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 3:20:00 PM
1,2-Dichloroethane	U	0.08	1.0		µg/L	1	8/21/2008 3:20:00 PM
1,2-Dichloropropane	U	0.1	1.0		µg/L	1	8/21/2008 3:20:00 PM
1,3,5-Trimethylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 3:20:00 PM
1,3-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 3:20:00 PM
1,3-dichloropropane	U	0.08	1.0		µg/L	1	8/21/2008 3:20:00 PM
1,4-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 3:20:00 PM
2,2-Dichloropropane	U	0.11	1.0		µg/L	1	8/21/2008 3:20:00 PM
2-Butanone	U	1.28	3.0		µg/L	1	8/21/2008 3:20:00 PM
2-Chloroethyl vinyl ether	U	0.08	1.0		µg/L	1	8/21/2008 3:20:00 PM
2-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 3:20:00 PM
2-Hexanone	U	0.22	2.0		µg/L	1	8/21/2008 3:20:00 PM
4-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 3:20:00 PM
4-Isopropyltoluene	U	0.1	1.0		µg/L	1	8/21/2008 3:20:00 PM
4-Methyl-2-pentanone	U	0.21	2.0		µg/L	1	8/21/2008 3:20:00 PM
Acetone	U	0.19	2.0		µg/L	1	8/21/2008 3:20:00 PM
Benzene	U	0.11	1.0		µg/L	1	8/21/2008 3:20:00 PM
Bromobenzene	U	0.07	1.0		µg/L	1	8/21/2008 3:20:00 PM
Bromochloromethane	U	0.4	1.0		µg/L	1	8/21/2008 3:20:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
	LOQ Limit of Quantitation	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
	C Calibration %RSD/%D exceeded for non-CCC analytes	

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ081208:1040NP1-1-3

Lab Order: 0808217

Collection Date: 8/12/2008 10:40:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808217-02A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B		Analyst: LA		
Bromodichloromethane	U	0.08	1.0		µg/L	1	8/21/2008 3:20:00 PM
Bromoform	U	0.06	1.0		µg/L	1	8/21/2008 3:20:00 PM
Bromomethane	U	0.17	1.0		µg/L	1	8/21/2008 3:20:00 PM
Carbon disulfide	U	0.14	1.0		µg/L	1	8/21/2008 3:20:00 PM
Carbon tetrachloride	U	0.16	1.0		µg/L	1	8/21/2008 3:20:00 PM
Chlorobenzene	U	0.09	1.0		µg/L	1	8/21/2008 3:20:00 PM
Chloroethane	U	0.16	1.0		µg/L	1	8/21/2008 3:20:00 PM
Chloroform	U	0.1	1.0		µg/L	1	8/21/2008 3:20:00 PM
Chloromethane	U	0.18	1.0		µg/L	1	8/21/2008 3:20:00 PM
cis-1,2-Dichloroethene	U	0.11	1.0		µg/L	1	8/21/2008 3:20:00 PM
cis-1,3-Dichloropropene	U	0.08	1.0		µg/L	1	8/21/2008 3:20:00 PM
Dibromochloromethane	U	0.07	1.0		µg/L	1	8/21/2008 3:20:00 PM
Dibromomethane	U	0.07	1.0		µg/L	1	8/21/2008 3:20:00 PM
Dichlorodifluoromethane	U	0.15	1.0	C	µg/L	1	8/21/2008 3:20:00 PM
Ethylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 3:20:00 PM
Hexachlorobutadiene	U	0.12	1.0		µg/L	1	8/21/2008 3:20:00 PM
Isopropylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 3:20:00 PM
m,p-Xylene	U	0.2	2.0		µg/L	1	8/21/2008 3:20:00 PM
Methyl tert-butyl ether	U	0.08	1.0		µg/L	1	8/21/2008 3:20:00 PM
Methylene chloride	U	0.08	1.0	C	µg/L	1	8/21/2008 3:20:00 PM
Naphthalene	U	0.08	1.0	C	µg/L	1	8/21/2008 3:20:00 PM
n-Butylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 3:20:00 PM
n-Propylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 3:20:00 PM
o-Xylene	U	0.1	1.0		µg/L	1	8/21/2008 3:20:00 PM
sec-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 3:20:00 PM
Styrene	U	0.08	1.0		µg/L	1	8/21/2008 3:20:00 PM
tert-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 3:20:00 PM
Tetrachloroethene	U	0.12	1.0		µg/L	1	8/21/2008 3:20:00 PM
Toluene	U	0.12	1.0		µg/L	1	8/21/2008 3:20:00 PM
trans-1,2-Dichloroethene	U	0.12	1.0		µg/L	1	8/21/2008 3:20:00 PM
trans-1,3-Dichloropropene	U	0.07	1.0		µg/L	1	8/21/2008 3:20:00 PM
Trichloroethene	3.7	0.13	1.0		µg/L	1	8/21/2008 3:20:00 PM
Trichlorofluoromethane	U	0.15	1.0		µg/L	1	8/21/2008 3:20:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- LOQ Limit of Quantitation
- S Spike Recovery outside accepted recovery limits
- C Calibration %RSD/%D exceeded for non-CCC analytes

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- LOD Limit of Detection
- ND Not Detected at the Reporting Limit
- U Indicates the compound was analyzed but not detected.

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ081208:1040NP1-1-3**Lab Order:** 0808217**Collection Date:** 8/12/2008 10:40:00 AM**Project:** Rowe**Matrix:** LIQUID**Lab ID:** 0808217-02A**Certificate of Results**

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B		Analyst: LA		
Vinyl acetate	U	0.06	1.0		µg/L	1	8/21/2008 3:20:00 PM
Vinyl chloride	U	0.14	1.0		µg/L	1	8/21/2008 3:20:00 PM
Surr: 4-Bromofluorobenzene	99.0	0	54-134		%REC	1	8/21/2008 3:20:00 PM
Surr: Dibromofluoromethane	97.2	0	52-132		%REC	1	8/21/2008 3:20:00 PM
Surr: Toluene-d8	97.8	0	51-127		%REC	1	8/21/2008 3:20:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.**Date:** 25-Aug-08**ELAP ID : 11418****CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ081208:1040NP1-1-3**Lab Order:** 0808217**Collection Date:** 8/12/2008 10:40:00 AM**Project:** Rowe**Matrix:** LIQUID**Lab ID:** 0808217-02B**Certificate of Results**

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL IRON				E200.7	SW3010A		Analyst: JP
Iron	2.17	0.005	0.0200		mg/L	1	8/20/2008 10:51:20 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.**Date:** 25-Aug-08**ELAP ID : 11418****CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ081208:1040NP1-1-3**Lab Order:** 0808217**Collection Date:** 8/12/2008 10:40:00 AM**Project:** Rowe**Matrix:** LIQUID**Lab ID:** 0808217-02C**Certificate of Results**

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
DISSOLVED IRON				E200.7	SW3010A		Analyst: JP
Iron	0.152	0.005	0.0200		mg/L	1	8/20/2008 10:49:16 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
LOQ	Limit of Quantitation	ND Not Detected at the Reporting Limit
S	Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
C	Calibration %RSD/%D exceeded for non-CCC analytes	

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ081208:1050NP1-1-4

Lab Order: 0808217

Collection Date: 8/12/2008 10:50:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808217-03A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
1,1,1,2-Tetrachloroethane	U	0.09	1.0		µg/L	1	8/21/2008 3:51:00 PM
1,1,1-Trichloroethane	3.5	0.17	1.0		µg/L	1	8/21/2008 3:51:00 PM
1,1,2,2-Tetrachloroethane	U	0.06	1.0		µg/L	1	8/21/2008 3:51:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	0.13	1.0		µg/L	1	8/21/2008 3:51:00 PM
1,1,2-Trichloroethane	U	0.07	1.0		µg/L	1	8/21/2008 3:51:00 PM
1,1-Dichloroethane	U	0.11	1.0		µg/L	1	8/21/2008 3:51:00 PM
1,1-Dichloroethene	U	0.15	1.0		µg/L	1	8/21/2008 3:51:00 PM
1,1-Dichloropropene	U	0.12	1.0		µg/L	1	8/21/2008 3:51:00 PM
1,2,3-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 3:51:00 PM
1,2,3-Trichloropropane	U	0.08	1.0		µg/L	1	8/21/2008 3:51:00 PM
1,2,4-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 3:51:00 PM
1,2,4-Trimethylbenzene	U	0.09	1.0		µg/L	1	8/21/2008 3:51:00 PM
1,2-Dibromo-3-chloropropane	U	0.09	1.0		µg/L	1	8/21/2008 3:51:00 PM
1,2-Dibromoethane	U	0.06	1.0		µg/L	1	8/21/2008 3:51:00 PM
1,2-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 3:51:00 PM
1,2-Dichloroethane	U	0.08	1.0		µg/L	1	8/21/2008 3:51:00 PM
1,2-Dichloropropane	U	0.1	1.0		µg/L	1	8/21/2008 3:51:00 PM
1,3,5-Trimethylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 3:51:00 PM
1,3-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 3:51:00 PM
1,3-dichloropropane	U	0.08	1.0		µg/L	1	8/21/2008 3:51:00 PM
1,4-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 3:51:00 PM
2,2-Dichloropropane	U	0.11	1.0		µg/L	1	8/21/2008 3:51:00 PM
2-Butanone	U	1.28	3.0		µg/L	1	8/21/2008 3:51:00 PM
2-Chloroethyl vinyl ether	U	0.08	1.0		µg/L	1	8/21/2008 3:51:00 PM
2-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 3:51:00 PM
2-Hexanone	U	0.22	2.0		µg/L	1	8/21/2008 3:51:00 PM
4-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 3:51:00 PM
4-Isopropyltoluene	U	0.1	1.0		µg/L	1	8/21/2008 3:51:00 PM
4-Methyl-2-pentanone	U	0.21	2.0		µg/L	1	8/21/2008 3:51:00 PM
Acetone	U	0.19	2.0		µg/L	1	8/21/2008 3:51:00 PM
Benzene	U	0.11	1.0		µg/L	1	8/21/2008 3:51:00 PM
Bromobenzene	U	0.07	1.0		µg/L	1	8/21/2008 3:51:00 PM
Bromochloromethane	U	0.4	1.0		µg/L	1	8/21/2008 3:51:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
	LOQ Limit of Quantitation	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
	C Calibration %RSD/%D exceeded for non-CCC analytes	

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ081208:1050NP1-1-4

Lab Order: 0808217

Collection Date: 8/12/2008 10:50:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808217-03A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
Bromodichloromethane	U	0.08	1.0		µg/L	1	8/21/2008 3:51:00 PM
Bromoform	U	0.06	1.0		µg/L	1	8/21/2008 3:51:00 PM
Bromomethane	U	0.17	1.0		µg/L	1	8/21/2008 3:51:00 PM
Carbon disulfide	U	0.14	1.0		µg/L	1	8/21/2008 3:51:00 PM
Carbon tetrachloride	U	0.16	1.0		µg/L	1	8/21/2008 3:51:00 PM
Chlorobenzene	U	0.09	1.0		µg/L	1	8/21/2008 3:51:00 PM
Chloroethane	U	0.16	1.0		µg/L	1	8/21/2008 3:51:00 PM
Chloroform	U	0.1	1.0		µg/L	1	8/21/2008 3:51:00 PM
Chloromethane	U	0.18	1.0		µg/L	1	8/21/2008 3:51:00 PM
cis-1,2-Dichloroethene	U	0.11	1.0		µg/L	1	8/21/2008 3:51:00 PM
cis-1,3-Dichloropropene	U	0.08	1.0		µg/L	1	8/21/2008 3:51:00 PM
Dibromochloromethane	U	0.07	1.0		µg/L	1	8/21/2008 3:51:00 PM
Dibromomethane	U	0.07	1.0		µg/L	1	8/21/2008 3:51:00 PM
Dichlorodifluoromethane	U	0.15	1.0	C	µg/L	1	8/21/2008 3:51:00 PM
Ethylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 3:51:00 PM
Hexachlorobutadiene	U	0.12	1.0		µg/L	1	8/21/2008 3:51:00 PM
Isopropylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 3:51:00 PM
m,p-Xylene	U	0.2	2.0		µg/L	1	8/21/2008 3:51:00 PM
Methyl tert-butyl ether	U	0.08	1.0		µg/L	1	8/21/2008 3:51:00 PM
Methylene chloride	U	0.08	1.0	C	µg/L	1	8/21/2008 3:51:00 PM
Naphthalene	U	0.08	1.0	C	µg/L	1	8/21/2008 3:51:00 PM
n-Butylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 3:51:00 PM
n-Propylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 3:51:00 PM
o-Xylene	U	0.1	1.0		µg/L	1	8/21/2008 3:51:00 PM
sec-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 3:51:00 PM
Styrene	U	0.08	1.0		µg/L	1	8/21/2008 3:51:00 PM
tert-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 3:51:00 PM
Tetrachloroethene	4.7	0.12	1.0		µg/L	1	8/21/2008 3:51:00 PM
Toluene	U	0.12	1.0		µg/L	1	8/21/2008 3:51:00 PM
trans-1,2-Dichloroethene	U	0.12	1.0		µg/L	1	8/21/2008 3:51:00 PM
trans-1,3-Dichloropropene	U	0.07	1.0		µg/L	1	8/21/2008 3:51:00 PM
Trichloroethene	U	0.13	1.0		µg/L	1	8/21/2008 3:51:00 PM
Trichlorofluoromethane	U	0.15	1.0		µg/L	1	8/21/2008 3:51:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ081208:1050NP1-1-4

Lab Order: 0808217

Collection Date: 8/12/2008 10:50:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808217-03A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B		Analyst: LA		
Vinyl acetate	U	0.06	1.0		µg/L	1	8/21/2008 3:51:00 PM
Vinyl chloride	U	0.14	1.0		µg/L	1	8/21/2008 3:51:00 PM
Surr: 4-Bromofluorobenzene	101	0	54-134		%REC	1	8/21/2008 3:51:00 PM
Surr: Dibromofluoromethane	98.0	0	52-132		%REC	1	8/21/2008 3:51:00 PM
Surr: Toluene-d8	99.6	0	51-127		%REC	1	8/21/2008 3:51:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.**Date:** 25-Aug-08**ELAP ID :** 11418**CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ081208:1050NP1-1-4**Lab Order:** 0808217**Collection Date:** 8/12/2008 10:50:00 AM**Project:** Rowe**Matrix:** LIQUID**Lab ID:** 0808217-03B**Certificate of Results**

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL IRON				E200.7	SW3010A		Analyst: JP
Iron	4.89	0.005	0.0200		mg/L	1	8/20/2008 10:55:26 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.**Date:** 25-Aug-08**ELAP ID : 11418****CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ081208:1050NP1-1-4**Lab Order:** 0808217**Collection Date:** 8/12/2008 10:50:00 AM**Project:** Rowe**Matrix:** LIQUID**Lab ID:** 0808217-03C**Certificate of Results**

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
DISSOLVED IRON				E200.7	SW3010A		Analyst: JP
Iron	1.37	0.005	0.0200		mg/L	1	8/20/2008 10:53:23 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
LOQ		Limit of Quantitation	ND	Not Detected at the Reporting Limit
S		Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
C		Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ081208:1100NP1-1-5

Lab Order: 0808217

Collection Date: 8/12/2008 11:00:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808217-04A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
1,1,1,2-Tetrachloroethane	U	0.09	1.0		µg/L	1	8/21/2008 4:22:00 PM
1,1,1-Trichloroethane	U	0.17	1.0		µg/L	1	8/21/2008 4:22:00 PM
1,1,2,2-Tetrachloroethane	U	0.06	1.0		µg/L	1	8/21/2008 4:22:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	0.13	1.0		µg/L	1	8/21/2008 4:22:00 PM
1,1,2-Trichloroethane	U	0.07	1.0		µg/L	1	8/21/2008 4:22:00 PM
1,1-Dichloroethane	U	0.11	1.0		µg/L	1	8/21/2008 4:22:00 PM
1,1-Dichloroethene	U	0.15	1.0		µg/L	1	8/21/2008 4:22:00 PM
1,1-Dichloropropene	U	0.12	1.0		µg/L	1	8/21/2008 4:22:00 PM
1,2,3-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 4:22:00 PM
1,2,3-Trichloropropane	U	0.08	1.0		µg/L	1	8/21/2008 4:22:00 PM
1,2,4-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 4:22:00 PM
1,2,4-Trimethylbenzene	U	0.09	1.0		µg/L	1	8/21/2008 4:22:00 PM
1,2-Dibromo-3-chloropropane	U	0.09	1.0		µg/L	1	8/21/2008 4:22:00 PM
1,2-Dibromoethane	U	0.06	1.0		µg/L	1	8/21/2008 4:22:00 PM
1,2-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 4:22:00 PM
1,2-Dichloroethane	U	0.08	1.0		µg/L	1	8/21/2008 4:22:00 PM
1,2-Dichloropropane	U	0.1	1.0		µg/L	1	8/21/2008 4:22:00 PM
1,3,5-Trimethylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 4:22:00 PM
1,3-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 4:22:00 PM
1,3-dichloropropane	U	0.08	1.0		µg/L	1	8/21/2008 4:22:00 PM
1,4-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 4:22:00 PM
2,2-Dichloropropane	U	0.11	1.0		µg/L	1	8/21/2008 4:22:00 PM
2-Butanone	U	1.28	3.0		µg/L	1	8/21/2008 4:22:00 PM
2-Chloroethyl vinyl ether	U	0.08	1.0		µg/L	1	8/21/2008 4:22:00 PM
2-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 4:22:00 PM
2-Hexanone	U	0.22	2.0		µg/L	1	8/21/2008 4:22:00 PM
4-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 4:22:00 PM
4-Isopropyltoluene	U	0.1	1.0		µg/L	1	8/21/2008 4:22:00 PM
4-Methyl-2-pentanone	U	0.21	2.0		µg/L	1	8/21/2008 4:22:00 PM
Acetone	U	0.19	2.0		µg/L	1	8/21/2008 4:22:00 PM
Benzene	U	0.11	1.0		µg/L	1	8/21/2008 4:22:00 PM
Bromobenzene	U	0.07	1.0		µg/L	1	8/21/2008 4:22:00 PM
Bromochloromethane	U	0.4	1.0		µg/L	1	8/21/2008 4:22:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ081208:1100NP1-1-5

Lab Order: 0808217

Collection Date: 8/12/2008 11:00:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808217-04A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
Bromodichloromethane	U	0.08	1.0		µg/L	1	8/21/2008 4:22:00 PM
Bromoform	U	0.06	1.0		µg/L	1	8/21/2008 4:22:00 PM
Bromomethane	U	0.17	1.0		µg/L	1	8/21/2008 4:22:00 PM
Carbon disulfide	U	0.14	1.0		µg/L	1	8/21/2008 4:22:00 PM
Carbon tetrachloride	U	0.16	1.0		µg/L	1	8/21/2008 4:22:00 PM
Chlorobenzene	U	0.09	1.0		µg/L	1	8/21/2008 4:22:00 PM
Chloroethane	U	0.16	1.0		µg/L	1	8/21/2008 4:22:00 PM
Chloroform	U	0.1	1.0		µg/L	1	8/21/2008 4:22:00 PM
Chloromethane	U	0.18	1.0		µg/L	1	8/21/2008 4:22:00 PM
cis-1,2-Dichloroethene	U	0.11	1.0		µg/L	1	8/21/2008 4:22:00 PM
cis-1,3-Dichloropropene	U	0.08	1.0		µg/L	1	8/21/2008 4:22:00 PM
Dibromochloromethane	U	0.07	1.0		µg/L	1	8/21/2008 4:22:00 PM
Dibromomethane	U	0.07	1.0		µg/L	1	8/21/2008 4:22:00 PM
Dichlorodifluoromethane	U	0.15	1.0	C	µg/L	1	8/21/2008 4:22:00 PM
Ethylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 4:22:00 PM
Hexachlorobutadiene	U	0.12	1.0		µg/L	1	8/21/2008 4:22:00 PM
Isopropylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 4:22:00 PM
m,p-Xylene	U	0.2	2.0		µg/L	1	8/21/2008 4:22:00 PM
Methyl tert-butyl ether	U	0.08	1.0		µg/L	1	8/21/2008 4:22:00 PM
Methylene chloride	U	0.08	1.0	C	µg/L	1	8/21/2008 4:22:00 PM
Naphthalene	U	0.08	1.0	C	µg/L	1	8/21/2008 4:22:00 PM
n-Butylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 4:22:00 PM
n-Propylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 4:22:00 PM
o-Xylene	U	0.1	1.0		µg/L	1	8/21/2008 4:22:00 PM
sec-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 4:22:00 PM
Styrene	U	0.08	1.0		µg/L	1	8/21/2008 4:22:00 PM
tert-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 4:22:00 PM
Tetrachloroethene	U	0.12	1.0		µg/L	1	8/21/2008 4:22:00 PM
Toluene	U	0.12	1.0		µg/L	1	8/21/2008 4:22:00 PM
trans-1,2-Dichloroethene	U	0.12	1.0		µg/L	1	8/21/2008 4:22:00 PM
trans-1,3-Dichloropropene	U	0.07	1.0		µg/L	1	8/21/2008 4:22:00 PM
Trichloroethene	U	0.13	1.0		µg/L	1	8/21/2008 4:22:00 PM
Trichlorofluoromethane	U	0.15	1.0		µg/L	1	8/21/2008 4:22:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers: * Value exceeds Maximum Contaminant Level

E Value above quantitation range

J Analyte detected below quantitation limits

LOQ Limit of Quantitation

S Spike Recovery outside accepted recovery limits

C Calibration %RSD/%D exceeded for non-CCC analytes

B Analyte detected in the associated Method Blank

H Holding times for preparation or analysis exceeded

LOD Limit of Detection

ND Not Detected at the Reporting Limit

U Indicates the compound was analyzed but not detected.

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ081208:1100NP1-1-5

Lab Order: 0808217

Collection Date: 8/12/2008 11:00:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808217-04A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B		Analyst: LA		
Vinyl acetate	U	0.06	1.0		µg/L	1	8/21/2008 4:22:00 PM
Vinyl chloride	U	0.14	1.0		µg/L	1	8/21/2008 4:22:00 PM
Surr: 4-Bromofluorobenzene	98.3	0	54-134		%REC	1	8/21/2008 4:22:00 PM
Surr: Dibromofluoromethane	98.2	0	52-132		%REC	1	8/21/2008 4:22:00 PM
Surr: Toluene-d8	101	0	51-127		%REC	1	8/21/2008 4:22:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.**Date:** 25-Aug-08**ELAP ID : 11418****CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ081208:1100NP1-1-5**Lab Order:** 0808217**Collection Date:** 8/12/2008 11:00:00 AM**Project:** Rowe**Matrix:** LIQUID**Lab ID:** 0808217-04B**Certificate of Results**

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL IRON				E200.7	SW3010A		Analyst: JP
Iron	0.450	0.005	0.0200		mg/L	1	8/20/2008 10:59:32 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.**Date:** 25-Aug-08**ELAP ID :** 11418**CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ081208:1100NP1-1-5**Lab Order:** 0808217**Collection Date:** 8/12/2008 11:00:00 AM**Project:** Rowe**Matrix:** LIQUID**Lab ID:** 0808217-04C**Certificate of Results**

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
DISSOLVED IRON							
Iron	0.0187	0.005	0.0200	J	mg/L	1	8/20/2008 10:57:29 AM
			E200.7		SW3010A		Analyst: JP

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ081208:1110NP1-1-6

Lab Order: 0808217

Collection Date: 8/12/2008 11:10:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808217-05A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
1,1,1,2-Tetrachloroethane	U	0.09	1.0		µg/L	1	8/21/2008 4:52:00 PM
1,1,1-Trichloroethane	9.0	0.17	1.0		µg/L	1	8/21/2008 4:52:00 PM
1,1,2,2-Tetrachloroethane	U	0.06	1.0		µg/L	1	8/21/2008 4:52:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	0.13	1.0		µg/L	1	8/21/2008 4:52:00 PM
1,1,2-Trichloroethane	U	0.07	1.0		µg/L	1	8/21/2008 4:52:00 PM
1,1-Dichloroethane	U	0.11	1.0		µg/L	1	8/21/2008 4:52:00 PM
1,1-Dichloroethene	U	0.15	1.0		µg/L	1	8/21/2008 4:52:00 PM
1,1-Dichloropropene	U	0.12	1.0		µg/L	1	8/21/2008 4:52:00 PM
1,2,3-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 4:52:00 PM
1,2,3-Trichloropropane	U	0.08	1.0		µg/L	1	8/21/2008 4:52:00 PM
1,2,4-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 4:52:00 PM
1,2,4-Trimethylbenzene	U	0.09	1.0		µg/L	1	8/21/2008 4:52:00 PM
1,2-Dibromo-3-chloropropane	U	0.09	1.0		µg/L	1	8/21/2008 4:52:00 PM
1,2-Dibromoethane	U	0.06	1.0		µg/L	1	8/21/2008 4:52:00 PM
1,2-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 4:52:00 PM
1,2-Dichloroethane	U	0.08	1.0		µg/L	1	8/21/2008 4:52:00 PM
1,2-Dichloropropane	U	0.1	1.0		µg/L	1	8/21/2008 4:52:00 PM
1,3,5-Trimethylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 4:52:00 PM
1,3-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 4:52:00 PM
1,3-dichloropropane	U	0.08	1.0		µg/L	1	8/21/2008 4:52:00 PM
1,4-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 4:52:00 PM
2,2-Dichloropropane	U	0.11	1.0		µg/L	1	8/21/2008 4:52:00 PM
2-Butanone	U	1.28	3.0		µg/L	1	8/21/2008 4:52:00 PM
2-Chloroethyl vinyl ether	U	0.08	1.0		µg/L	1	8/21/2008 4:52:00 PM
2-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 4:52:00 PM
2-Hexanone	U	0.22	2.0		µg/L	1	8/21/2008 4:52:00 PM
4-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 4:52:00 PM
4-Isopropyltoluene	U	0.1	1.0		µg/L	1	8/21/2008 4:52:00 PM
4-Methyl-2-pentanone	U	0.21	2.0		µg/L	1	8/21/2008 4:52:00 PM
Acetone	U	0.19	2.0		µg/L	1	8/21/2008 4:52:00 PM
Benzene	U	0.11	1.0		µg/L	1	8/21/2008 4:52:00 PM
Bromobenzene	U	0.07	1.0		µg/L	1	8/21/2008 4:52:00 PM
Bromochloromethane	U	0.4	1.0		µg/L	1	8/21/2008 4:52:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808217
Project: Rowe
Lab ID: 0808217-05A

Client Sample ID: GWQ081208:1110NP1-1-6
Collection Date: 8/12/2008 11:10:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113				SW8260B		Analyst: LA	
Bromodichloromethane	U	0.08	1.0		µg/L	1	8/21/2008 4:52:00 PM
Bromoform	U	0.06	1.0		µg/L	1	8/21/2008 4:52:00 PM
Bromomethane	U	0.17	1.0		µg/L	1	8/21/2008 4:52:00 PM
Carbon disulfide	U	0.14	1.0		µg/L	1	8/21/2008 4:52:00 PM
Carbon tetrachloride	U	0.16	1.0		µg/L	1	8/21/2008 4:52:00 PM
Chlorobenzene	U	0.09	1.0		µg/L	1	8/21/2008 4:52:00 PM
Chloroethane	U	0.16	1.0		µg/L	1	8/21/2008 4:52:00 PM
Chloroform	U	0.1	1.0		µg/L	1	8/21/2008 4:52:00 PM
Chloromethane	U	0.18	1.0		µg/L	1	8/21/2008 4:52:00 PM
cis-1,2-Dichloroethene	U	0.11	1.0		µg/L	1	8/21/2008 4:52:00 PM
cis-1,3-Dichloropropene	U	0.08	1.0		µg/L	1	8/21/2008 4:52:00 PM
Dibromochloromethane	U	0.07	1.0		µg/L	1	8/21/2008 4:52:00 PM
Dibromomethane	U	0.07	1.0		µg/L	1	8/21/2008 4:52:00 PM
Dichlorodifluoromethane	U	0.15	1.0	C	µg/L	1	8/21/2008 4:52:00 PM
Ethylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 4:52:00 PM
Hexachlorobutadiene	U	0.12	1.0		µg/L	1	8/21/2008 4:52:00 PM
Isopropylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 4:52:00 PM
m,p-Xylene	U	0.2	2.0		µg/L	1	8/21/2008 4:52:00 PM
Methyl tert-butyl ether	U	0.08	1.0		µg/L	1	8/21/2008 4:52:00 PM
Methylene chloride	U	0.08	1.0	C	µg/L	1	8/21/2008 4:52:00 PM
Naphthalene	U	0.08	1.0	C	µg/L	1	8/21/2008 4:52:00 PM
n-Butylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 4:52:00 PM
n-Propylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 4:52:00 PM
o-Xylene	U	0.1	1.0		µg/L	1	8/21/2008 4:52:00 PM
sec-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 4:52:00 PM
Styrene	U	0.08	1.0		µg/L	1	8/21/2008 4:52:00 PM
tert-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 4:52:00 PM
Tetrachloroethene	16	0.12	1.0		µg/L	1	8/21/2008 4:52:00 PM
Toluene	U	0.12	1.0		µg/L	1	8/21/2008 4:52:00 PM
trans-1,2-Dichloroethene	U	0.12	1.0		µg/L	1	8/21/2008 4:52:00 PM
trans-1,3-Dichloropropene	U	0.07	1.0		µg/L	1	8/21/2008 4:52:00 PM
Trichloroethene	U	0.13	1.0		µg/L	1	8/21/2008 4:52:00 PM
Trichlorofluoromethane	U	0.15	1.0		µg/L	1	8/21/2008 4:52:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ081208:1110NP1-1-6

Lab Order: 0808217

Collection Date: 8/12/2008 11:10:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808217-05A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
Vinyl acetate	U	0.06	1.0		µg/L	1	8/21/2008 4:52:00 PM
Vinyl chloride	U	0.14	1.0		µg/L	1	8/21/2008 4:52:00 PM
Surr: 4-Bromofluorobenzene	98.8	0	54-134		%REC	1	8/21/2008 4:52:00 PM
Surr: Dibromofluoromethane	92.8	0	52-132		%REC	1	8/21/2008 4:52:00 PM
Surr: Toluene-d8	99.1	0	51-127		%REC	1	8/21/2008 4:52:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.**Date:** 25-Aug-08**ELAP ID :** 11418**CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ081208:1110NP1-1-6**Lab Order:** 0808217**Collection Date:** 8/12/2008 11:10:00 AM**Project:** Rowe**Matrix:** LIQUID**Lab ID:** 0808217-05B**Certificate of Results**

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL IRON				E200.7	SW3010A		Analyst: JP
Iron	0.157	0.005	0.0200		mg/L	1	8/20/2008 11:03:38 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com




Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.**Date:** 25-Aug-08**ELAP ID :** 11418**CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ081208:1110NP1-1-6**Lab Order:** 0808217**Collection Date:** 8/12/2008 11:10:00 AM**Project:** Rowe**Matrix:** LIQUID**Lab ID:** 0808217-05C**Certificate of Results**

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
DISSOLVED IRON			E200.7		SW3010A		Analyst: JP
Iron	0.0143	0.005	0.0200	J	mg/L	1	8/20/2008 11:01:35 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ081208:1120NP1-1-7

Lab Order: 0808217

Collection Date: 8/12/2008 11:20:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808217-06A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
1,1,1,2-Tetrachloroethane	U	0.09	1.0		µg/L	1	8/21/2008 5:22:00 PM
1,1,1-Trichloroethane	1.5	0.17	1.0		µg/L	1	8/21/2008 5:22:00 PM
1,1,2,2-Tetrachloroethane	U	0.06	1.0		µg/L	1	8/21/2008 5:22:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	0.13	1.0		µg/L	1	8/21/2008 5:22:00 PM
1,1,2-Trichloroethane	U	0.07	1.0		µg/L	1	8/21/2008 5:22:00 PM
1,1-Dichloroethane	U	0.11	1.0		µg/L	1	8/21/2008 5:22:00 PM
1,1-Dichloroethene	U	0.15	1.0		µg/L	1	8/21/2008 5:22:00 PM
1,1-Dichloropropene	U	0.12	1.0		µg/L	1	8/21/2008 5:22:00 PM
1,2,3-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 5:22:00 PM
1,2,3-Trichloropropane	U	0.08	1.0		µg/L	1	8/21/2008 5:22:00 PM
1,2,4-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 5:22:00 PM
1,2,4-Trimethylbenzene	U	0.09	1.0		µg/L	1	8/21/2008 5:22:00 PM
1,2-Dibromo-3-chloropropane	U	0.09	1.0		µg/L	1	8/21/2008 5:22:00 PM
1,2-Dibromoethane	U	0.06	1.0		µg/L	1	8/21/2008 5:22:00 PM
1,2-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 5:22:00 PM
1,2-Dichloroethane	U	0.08	1.0		µg/L	1	8/21/2008 5:22:00 PM
1,2-Dichloropropane	U	0.1	1.0		µg/L	1	8/21/2008 5:22:00 PM
1,3,5-Trimethylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 5:22:00 PM
1,3-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 5:22:00 PM
1,3-dichloropropane	U	0.08	1.0		µg/L	1	8/21/2008 5:22:00 PM
1,4-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 5:22:00 PM
2,2-Dichloropropane	U	0.11	1.0		µg/L	1	8/21/2008 5:22:00 PM
2-Butanone	U	1.28	3.0		µg/L	1	8/21/2008 5:22:00 PM
2-Chloroethyl vinyl ether	U	0.08	1.0		µg/L	1	8/21/2008 5:22:00 PM
2-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 5:22:00 PM
2-Hexanone	U	0.22	2.0		µg/L	1	8/21/2008 5:22:00 PM
4-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 5:22:00 PM
4-Isopropyltoluene	U	0.1	1.0		µg/L	1	8/21/2008 5:22:00 PM
4-Methyl-2-pentanone	U	0.21	2.0		µg/L	1	8/21/2008 5:22:00 PM
Acetone	U	0.19	2.0		µg/L	1	8/21/2008 5:22:00 PM
Benzene	U	0.11	1.0		µg/L	1	8/21/2008 5:22:00 PM
Bromobenzene	U	0.07	1.0		µg/L	1	8/21/2008 5:22:00 PM
Bromochloromethane	U	0.4	1.0		µg/L	1	8/21/2008 5:22:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers: * Value exceeds Maximum Contaminant Level

B Analyte detected in the associated Method Blank

E Value above quantitation range

H Holding times for preparation or analysis exceeded

J Analyte detected below quantitation limits

LOD Limit of Detection

LOQ Limit of Quantitation

ND Not Detected at the Reporting Limit

S Spike Recovery outside accepted recovery limits

U Indicates the compound was analyzed but not detected.

C Calibration %RSD/%D exceeded for non-CCC analytes

Page 26 of 40

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808217
Project: Rowe
Lab ID: 0808217-06A

Client Sample ID: GWQ081208:1120NP1-1-7
Collection Date: 8/12/2008 11:20:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
Bromodichloromethane	U	0.08	1.0		µg/L	1	8/21/2008 5:22:00 PM
Bromoform	U	0.06	1.0		µg/L	1	8/21/2008 5:22:00 PM
Bromomethane	U	0.17	1.0		µg/L	1	8/21/2008 5:22:00 PM
Carbon disulfide	U	0.14	1.0		µg/L	1	8/21/2008 5:22:00 PM
Carbon tetrachloride	U	0.16	1.0		µg/L	1	8/21/2008 5:22:00 PM
Chlorobenzene	U	0.09	1.0		µg/L	1	8/21/2008 5:22:00 PM
Chloroethane	U	0.16	1.0		µg/L	1	8/21/2008 5:22:00 PM
Chloroform	U	0.1	1.0		µg/L	1	8/21/2008 5:22:00 PM
Chloromethane	U	0.18	1.0		µg/L	1	8/21/2008 5:22:00 PM
cis-1,2-Dichloroethene	U	0.11	1.0		µg/L	1	8/21/2008 5:22:00 PM
cis-1,3-Dichloropropene	U	0.08	1.0		µg/L	1	8/21/2008 5:22:00 PM
Dibromochloromethane	U	0.07	1.0		µg/L	1	8/21/2008 5:22:00 PM
Dibromomethane	U	0.07	1.0		µg/L	1	8/21/2008 5:22:00 PM
Dichlorodifluoromethane	U	0.15	1.0	C	µg/L	1	8/21/2008 5:22:00 PM
Ethylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 5:22:00 PM
Hexachlorobutadiene	U	0.12	1.0		µg/L	1	8/21/2008 5:22:00 PM
Isopropylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 5:22:00 PM
m,p-Xylene	U	0.2	2.0		µg/L	1	8/21/2008 5:22:00 PM
Methyl tert-butyl ether	U	0.08	1.0		µg/L	1	8/21/2008 5:22:00 PM
Methylene chloride	U	0.08	1.0	C	µg/L	1	8/21/2008 5:22:00 PM
Naphthalene	U	0.08	1.0	C	µg/L	1	8/21/2008 5:22:00 PM
n-Butylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 5:22:00 PM
n-Propylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 5:22:00 PM
o-Xylene	U	0.1	1.0		µg/L	1	8/21/2008 5:22:00 PM
sec-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 5:22:00 PM
Styrene	U	0.08	1.0		µg/L	1	8/21/2008 5:22:00 PM
tert-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 5:22:00 PM
Tetrachloroethene	11	0.12	1.0		µg/L	1	8/21/2008 5:22:00 PM
Toluene	U	0.12	1.0		µg/L	1	8/21/2008 5:22:00 PM
trans-1,2-Dichloroethene	U	0.12	1.0		µg/L	1	8/21/2008 5:22:00 PM
trans-1,3-Dichloropropene	U	0.07	1.0		µg/L	1	8/21/2008 5:22:00 PM
Trichloroethene	U	0.13	1.0		µg/L	1	8/21/2008 5:22:00 PM
Trichlorofluoromethane	U	0.15	1.0		µg/L	1	8/21/2008 5:22:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ081208:1120NP1-1-7**Lab Order:** 0808217**Collection Date:** 8/12/2008 11:20:00 AM**Project:** Rowe**Matrix:** LIQUID**Lab ID:** 0808217-06A**Certificate of Results**

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B		Analyst: LA		
Vinyl acetate	U	0.06	1.0		µg/L	1	8/21/2008 5:22:00 PM
Vinyl chloride	U	0.14	1.0		µg/L	1	8/21/2008 5:22:00 PM
Surr: 4-Bromofluorobenzene	97.1	0	54-134		%REC	1	8/21/2008 5:22:00 PM
Surr: Dibromofluoromethane	99.8	0	52-132		%REC	1	8/21/2008 5:22:00 PM
Surr: Toluene-d8	99.9	0	51-127		%REC	1	8/21/2008 5:22:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com




Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.**Date:** 25-Aug-08**ELAP ID :** 11418**CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ081208:1120NP1-1-7**Lab Order:** 0808217**Collection Date:** 8/12/2008 11:20:00 AM**Project:** Rowe**Matrix:** LIQUID**Lab ID:** 0808217-06B**Certificate of Results**

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL IRON				E200.7	SW3010A		Analyst: JP
Iron	0.0287	0.005	0.0200		mg/L	1	8/20/2008 11:07:46 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.**Date:** 25-Aug-08**ELAP ID : 11418****CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ081208:1120NP1-1-7**Lab Order:** 0808217**Collection Date:** 8/12/2008 11:20:00 AM**Project:** Rowe**Matrix:** LIQUID**Lab ID:** 0808217-06C**Certificate of Results**

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
DISSOLVED IRON				E200.7	SW3010A		Analyst: JP
Iron	0.00791	0.005	0.0200	J	mg/L	1	8/20/2008 11:05:42 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ081208:1130NP1-1-8

Lab Order: 0808217

Collection Date: 8/12/2008 11:30:00 AM

Project: Rowe

Matrix: LIQUID


Lab ID: 0808217-07A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
1,1,1,2-Tetrachloroethane	U	0.09	1.0		µg/L	1	8/21/2008 5:53:00 PM
1,1,1-Trichloroethane	U	0.17	1.0		µg/L	1	8/21/2008 5:53:00 PM
1,1,2,2-Tetrachloroethane	U	0.06	1.0		µg/L	1	8/21/2008 5:53:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	0.13	1.0		µg/L	1	8/21/2008 5:53:00 PM
1,1,2-Trichloroethane	U	0.07	1.0		µg/L	1	8/21/2008 5:53:00 PM
1,1-Dichloroethane	U	0.11	1.0		µg/L	1	8/21/2008 5:53:00 PM
1,1-Dichloroethene	U	0.15	1.0		µg/L	1	8/21/2008 5:53:00 PM
1,1-Dichloropropene	U	0.12	1.0		µg/L	1	8/21/2008 5:53:00 PM
1,2,3-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 5:53:00 PM
1,2,3-Trichloropropane	U	0.08	1.0		µg/L	1	8/21/2008 5:53:00 PM
1,2,4-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 5:53:00 PM
1,2,4-Trimethylbenzene	U	0.09	1.0		µg/L	1	8/21/2008 5:53:00 PM
1,2-Dibromo-3-chloropropane	U	0.09	1.0		µg/L	1	8/21/2008 5:53:00 PM
1,2-Dibromoethane	U	0.06	1.0		µg/L	1	8/21/2008 5:53:00 PM
1,2-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 5:53:00 PM
1,2-Dichloroethane	U	0.08	1.0		µg/L	1	8/21/2008 5:53:00 PM
1,2-Dichloropropane	U	0.1	1.0		µg/L	1	8/21/2008 5:53:00 PM
1,3,5-Trimethylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 5:53:00 PM
1,3-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 5:53:00 PM
1,3-dichloropropane	U	0.08	1.0		µg/L	1	8/21/2008 5:53:00 PM
1,4-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 5:53:00 PM
2,2-Dichloropropane	U	0.11	1.0		µg/L	1	8/21/2008 5:53:00 PM
2-Butanone	U	1.28	3.0		µg/L	1	8/21/2008 5:53:00 PM
2-Chloroethyl vinyl ether	U	0.08	1.0		µg/L	1	8/21/2008 5:53:00 PM
2-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 5:53:00 PM
2-Hexanone	U	0.22	2.0		µg/L	1	8/21/2008 5:53:00 PM
4-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 5:53:00 PM
4-Isopropyltoluene	U	0.1	1.0		µg/L	1	8/21/2008 5:53:00 PM
4-Methyl-2-pentanone	U	0.21	2.0		µg/L	1	8/21/2008 5:53:00 PM
Acetone	U	0.19	2.0		µg/L	1	8/21/2008 5:53:00 PM
Benzene	U	0.11	1.0		µg/L	1	8/21/2008 5:53:00 PM
Bromobenzene	U	0.07	1.0		µg/L	1	8/21/2008 5:53:00 PM
Bromochloromethane	U	0.4	1.0		µg/L	1	8/21/2008 5:53:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers: * Value exceeds Maximum Contaminant Level

E Value above quantitation range

J Analyte detected below quantitation limits

LOQ Limit of Quantitation

S Spike Recovery outside accepted recovery limits

C Calibration %RSD/%D exceeded for non-CCC analytes

B Analyte detected in the associated Method Blank

H Holding times for preparation or analysis exceeded

LOD Limit of Detection

ND Not Detected at the Reporting Limit

U Indicates the compound was analyzed but not detected.

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ081208:1130NP1-1-8

Lab Order: 0808217

Collection Date: 8/12/2008 11:30:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808217-07A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113				SW8260B		Analyst: LA	
Bromodichloromethane	U	0.08	1.0		µg/L	1	8/21/2008 5:53:00 PM
Bromoform	U	0.06	1.0		µg/L	1	8/21/2008 5:53:00 PM
Bromomethane	U	0.17	1.0		µg/L	1	8/21/2008 5:53:00 PM
Carbon disulfide	U	0.14	1.0		µg/L	1	8/21/2008 5:53:00 PM
Carbon tetrachloride	U	0.16	1.0		µg/L	1	8/21/2008 5:53:00 PM
Chlorobenzene	U	0.09	1.0		µg/L	1	8/21/2008 5:53:00 PM
Chloroethane	U	0.16	1.0		µg/L	1	8/21/2008 5:53:00 PM
Chloroform	U	0.1	1.0		µg/L	1	8/21/2008 5:53:00 PM
Chloromethane	U	0.18	1.0		µg/L	1	8/21/2008 5:53:00 PM
cis-1,2-Dichloroethene	U	0.11	1.0		µg/L	1	8/21/2008 5:53:00 PM
cis-1,3-Dichloropropene	U	0.08	1.0		µg/L	1	8/21/2008 5:53:00 PM
Dibromochloromethane	U	0.07	1.0		µg/L	1	8/21/2008 5:53:00 PM
Dibromomethane	U	0.07	1.0		µg/L	1	8/21/2008 5:53:00 PM
Dichlorodifluoromethane	U	0.15	1.0	C	µg/L	1	8/21/2008 5:53:00 PM
Ethylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 5:53:00 PM
Hexachlorobutadiene	U	0.12	1.0		µg/L	1	8/21/2008 5:53:00 PM
Isopropylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 5:53:00 PM
m,p-Xylene	U	0.2	2.0		µg/L	1	8/21/2008 5:53:00 PM
Methyl tert-butyl ether	U	0.08	1.0		µg/L	1	8/21/2008 5:53:00 PM
Methylene chloride	U	0.08	1.0	C	µg/L	1	8/21/2008 5:53:00 PM
Naphthalene	U	0.08	1.0	C	µg/L	1	8/21/2008 5:53:00 PM
n-Butylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 5:53:00 PM
n-Propylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 5:53:00 PM
o-Xylene	U	0.1	1.0		µg/L	1	8/21/2008 5:53:00 PM
sec-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 5:53:00 PM
Styrene	U	0.08	1.0		µg/L	1	8/21/2008 5:53:00 PM
tert-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 5:53:00 PM
Tetrachloroethene	U	0.12	1.0		µg/L	1	8/21/2008 5:53:00 PM
Toluene	U	0.12	1.0		µg/L	1	8/21/2008 5:53:00 PM
trans-1,2-Dichloroethene	U	0.12	1.0		µg/L	1	8/21/2008 5:53:00 PM
trans-1,3-Dichloropropene	U	0.07	1.0		µg/L	1	8/21/2008 5:53:00 PM
Trichloroethene	U	0.13	1.0		µg/L	1	8/21/2008 5:53:00 PM
Trichlorofluoromethane	U	0.15	1.0		µg/L	1	8/21/2008 5:53:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers: * Value exceeds Maximum Contaminant Level

B Analyte detected in the associated Method Blank

E Value above quantitation range

H Holding times for preparation or analysis exceeded

J Analyte detected below quantitation limits

LOD Limit of Detection

LOQ Limit of Quantitation

ND Not Detected at the Reporting Limit

S Spike Recovery outside accepted recovery limits

U Indicates the compound was analyzed but not detected.

C Calibration %RSD/%D exceeded for non-CCC analytes

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ081208:1130NP1-1-8**Lab Order:** 0808217**Collection Date:** 8/12/2008 11:30:00 AM**Project:** Rowe**Matrix:** LIQUID**Lab ID:** 0808217-07A**Certificate of Results**

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
Vinyl acetate	U	0.06	1.0		µg/L	1	8/21/2008 5:53:00 PM
Vinyl chloride	U	0.14	1.0		µg/L	1	8/21/2008 5:53:00 PM
Surr: 4-Bromofluorobenzene	101	0	54-134		%REC	1	8/21/2008 5:53:00 PM
Surr: Dibromofluoromethane	102	0	52-132		%REC	1	8/21/2008 5:53:00 PM
Surr: Toluene-d8	101	0	51-127		%REC	1	8/21/2008 5:53:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.**Date:** 25-Aug-08**ELAP ID :** 11418**CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ081208:1130NP1-1-8**Lab Order:** 0808217**Collection Date:** 8/12/2008 11:30:00 AM**Project:** Rowe**Matrix:** LIQUID**Lab ID:** 0808217-07B**Certificate of Results**

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL IRON				E200.7	SW3010A		Analyst: JP
Iron	7.92	0.005	0.0200		mg/L	1	8/20/2008 11:21:49 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ081208:1130NP1-1-8

Lab Order: 0808217

Collection Date: 8/12/2008 11:30:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808217-07C

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
DISSOLVED IRON				E200.7	SW3010A		Analyst: JP
Iron	0.631	0.005	0.0200		mg/L	1	8/20/2008 11:19:46 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808217
Project: Rowe
Lab ID: 0808217-08A

Client Sample ID: GWQ081208:1140NP1-1-9
Collection Date: 8/12/2008 11:40:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113				SW8260B		Analyst: LA	
1,1,1,2-Tetrachloroethane	U	0.09	1.0		µg/L	1	8/21/2008 6:23:00 PM
1,1,1-Trichloroethane	U	0.17	1.0		µg/L	1	8/21/2008 6:23:00 PM
1,1,2,2-Tetrachloroethane	U	0.06	1.0		µg/L	1	8/21/2008 6:23:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	0.13	1.0		µg/L	1	8/21/2008 6:23:00 PM
1,1,2-Trichloroethane	U	0.07	1.0		µg/L	1	8/21/2008 6:23:00 PM
1,1-Dichloroethane	U	0.11	1.0		µg/L	1	8/21/2008 6:23:00 PM
1,1-Dichloroethene	U	0.15	1.0		µg/L	1	8/21/2008 6:23:00 PM
1,1-Dichloropropene	U	0.12	1.0		µg/L	1	8/21/2008 6:23:00 PM
1,2,3-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 6:23:00 PM
1,2,3-Trichloropropane	U	0.08	1.0		µg/L	1	8/21/2008 6:23:00 PM
1,2,4-Trichlorobenzene	U	0.07	1.0		µg/L	1	8/21/2008 6:23:00 PM
1,2,4-Trimethylbenzene	U	0.09	1.0		µg/L	1	8/21/2008 6:23:00 PM
1,2-Dibromo-3-chloropropane	U	0.09	1.0		µg/L	1	8/21/2008 6:23:00 PM
1,2-Dibromoethane	U	0.06	1.0		µg/L	1	8/21/2008 6:23:00 PM
1,2-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 6:23:00 PM
1,2-Dichloroethane	U	0.08	1.0		µg/L	1	8/21/2008 6:23:00 PM
1,2-Dichloropropane	U	0.1	1.0		µg/L	1	8/21/2008 6:23:00 PM
1,3,5-Trimethylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 6:23:00 PM
1,3-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 6:23:00 PM
1,3-dichloropropane	U	0.08	1.0		µg/L	1	8/21/2008 6:23:00 PM
1,4-Dichlorobenzene	U	0.08	1.0		µg/L	1	8/21/2008 6:23:00 PM
2,2-Dichloropropane	U	0.11	1.0		µg/L	1	8/21/2008 6:23:00 PM
2-Butanone	U	1.28	3.0		µg/L	1	8/21/2008 6:23:00 PM
2-Chloroethyl vinyl ether	U	0.08	1.0		µg/L	1	8/21/2008 6:23:00 PM
2-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 6:23:00 PM
2-Hexanone	U	0.22	2.0		µg/L	1	8/21/2008 6:23:00 PM
4-Chlorotoluene	U	0.09	1.0		µg/L	1	8/21/2008 6:23:00 PM
4-Isopropyltoluene	U	0.1	1.0		µg/L	1	8/21/2008 6:23:00 PM
4-Methyl-2-pentanone	U	0.21	2.0		µg/L	1	8/21/2008 6:23:00 PM
Acetone	U	0.19	2.0		µg/L	1	8/21/2008 6:23:00 PM
Benzene	U	0.11	1.0		µg/L	1	8/21/2008 6:23:00 PM
Bromobenzene	U	0.07	1.0		µg/L	1	8/21/2008 6:23:00 PM
Bromochloromethane	U	0.4	1.0		µg/L	1	8/21/2008 6:23:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ081208:1140NP1-1-9

Lab Order: 0808217

Collection Date: 8/12/2008 11:40:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808217-08A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
Bromodichloromethane	U	0.08	1.0		µg/L	1	8/21/2008 6:23:00 PM
Bromoform	U	0.06	1.0		µg/L	1	8/21/2008 6:23:00 PM
Bromomethane	U	0.17	1.0		µg/L	1	8/21/2008 6:23:00 PM
Carbon disulfide	U	0.14	1.0		µg/L	1	8/21/2008 6:23:00 PM
Carbon tetrachloride	U	0.16	1.0		µg/L	1	8/21/2008 6:23:00 PM
Chlorobenzene	U	0.09	1.0		µg/L	1	8/21/2008 6:23:00 PM
Chloroethane	U	0.16	1.0		µg/L	1	8/21/2008 6:23:00 PM
Chloroform	U	0.1	1.0		µg/L	1	8/21/2008 6:23:00 PM
Chloromethane	U	0.18	1.0		µg/L	1	8/21/2008 6:23:00 PM
cis-1,2-Dichloroethene	U	0.11	1.0		µg/L	1	8/21/2008 6:23:00 PM
cis-1,3-Dichloropropene	U	0.08	1.0		µg/L	1	8/21/2008 6:23:00 PM
Dibromochloromethane	U	0.07	1.0		µg/L	1	8/21/2008 6:23:00 PM
Dibromomethane	U	0.07	1.0		µg/L	1	8/21/2008 6:23:00 PM
Dichlorodifluoromethane	U	0.15	1.0	C	µg/L	1	8/21/2008 6:23:00 PM
Ethylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 6:23:00 PM
Hexachlorobutadiene	U	0.12	1.0		µg/L	1	8/21/2008 6:23:00 PM
Isopropylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 6:23:00 PM
m,p-Xylene	U	0.2	2.0		µg/L	1	8/21/2008 6:23:00 PM
Methyl tert-butyl ether	U	0.08	1.0		µg/L	1	8/21/2008 6:23:00 PM
Methylene chloride	U	0.08	1.0	C	µg/L	1	8/21/2008 6:23:00 PM
Naphthalene	U	0.08	1.0	C	µg/L	1	8/21/2008 6:23:00 PM
n-Butylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 6:23:00 PM
n-Propylbenzene	U	0.11	1.0		µg/L	1	8/21/2008 6:23:00 PM
o-Xylene	U	0.1	1.0		µg/L	1	8/21/2008 6:23:00 PM
sec-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 6:23:00 PM
Styrene	U	0.08	1.0		µg/L	1	8/21/2008 6:23:00 PM
tert-Butylbenzene	U	0.1	1.0		µg/L	1	8/21/2008 6:23:00 PM
Tetrachloroethene	U	0.12	1.0		µg/L	1	8/21/2008 6:23:00 PM
Toluene	U	0.12	1.0		µg/L	1	8/21/2008 6:23:00 PM
trans-1,2-Dichloroethene	U	0.12	1.0		µg/L	1	8/21/2008 6:23:00 PM
trans-1,3-Dichloropropene	U	0.07	1.0		µg/L	1	8/21/2008 6:23:00 PM
Trichloroethene	U	0.13	1.0		µg/L	1	8/21/2008 6:23:00 PM
Trichlorofluoromethane	U	0.15	1.0		µg/L	1	8/21/2008 6:23:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.

Client Sample ID: GWQ081208:1140NP1-1-9

Lab Order: 0808217

Collection Date: 8/12/2008 11:40:00 AM

Project: Rowe

Matrix: LIQUID

Lab ID: 0808217-08A

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
VOLATILE SW-846 8260 + MTBE & FREON113			SW8260B			Analyst: LA	
Vinyl acetate	U	0.06	1.0		µg/L	1	8/21/2008 6:23:00 PM
Vinyl chloride	U	0.14	1.0		µg/L	1	8/21/2008 6:23:00 PM
Surr: 4-Bromofluorobenzene	97.9	0	54-134		%REC	1	8/21/2008 6:23:00 PM
Surr: Dibromofluoromethane	94.7	0	52-132		%REC	1	8/21/2008 6:23:00 PM
Surr: Toluene-d8	98.1	0	51-127		%REC	1	8/21/2008 6:23:00 PM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

American Analytical Laboratories, LLC.

Date: 25-Aug-08

ELAP ID : 11418

CLIENT: Leggette Brashears & Graham Inc.
Lab Order: 0808217
Project: Rowe
Lab ID: 0808217-08B

Client Sample ID: GWQ081208:1140NP1-1-9
Collection Date: 8/12/2008 11:40:00 AM
Matrix: LIQUID

Certificate of Results

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
TOTAL IRON				E200.7	SW3010A		Analyst: JP
Iron	1.57	0.005	0.0200		mg/L	1	8/20/2008 11:25:56 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735
Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	LOD Limit of Detection
	LOQ Limit of Quantitation	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed but not detected.
	C Calibration %RSD/%D exceeded for non-CCC analytes	

American Analytical Laboratories, LLC.**Date:** 25-Aug-08**ELAP ID :** 11418**CLIENT:** Leggette Brashears & Graham Inc.**Client Sample ID:** GWQ081208:1140NP1-1-9**Lab Order:** 0808217**Collection Date:** 8/12/2008 11:40:00 AM**Project:** Rowe**Matrix:** LIQUID**Lab ID:** 0808217-08C**Certificate of Results**

Analyses	Sample Result	LOD	LOQ	Qual	Units	DF	Date/Time Analyzed
DISSOLVED IRON				E200.7	SW3010A		Analyst: JP
Iron	0.0267	0.005	0.0200		mg/L	1	8/20/2008 11:23:53 AM

American Analytical Laboratories, LLC., 56 Toledo Street, Farmingdale, NY, Zip - 11735

Tel - 6314546100 Fax - 6314548027 www.American-Analytical.com



Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	LOD	Limit of Detection
	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed but not detected.
	C	Calibration %RSD/%D exceeded for non-CCC analytes		

CLIENT: Leggett Brashears & Graham Inc.

Work Order: 0808217

Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113 W

Sample ID: V624LCS-082108L		SampType: LCS		TestCode: 8260MTBE11		Units: µg/L		Prep Date:		RunNo: 37836	
Client ID: LCSW		Batch ID: R37836		TestNo: SW8260B				Analysis Date: 8/21/2008		SeqNo: 498456	
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,1,1-Trichloroethane	49	1.0	50.00	0	98.6	43	148				
1,1,2,2-Tetrachloroethane	38	1.0	50.00	0	76.4	32	148				
1,1,2-Trichloroethane	40	1.0	50.00	0	80.8	42	136				
1,1-Dichloroethane	46	1.0	50.00	0	91.3	40	150				
1,1-Dichloroethene	60	1.0	50.00	0	119	30	154				
1,2-Dichlorobenzene	41	1.0	50.00	0	82.8	40	129				
1,2-Dichloroethane	44	1.0	50.00	0	88.3	36	141				
1,2-Dichloropropane	43	1.0	50.00	0	85.2	44	138				
1,3-Dichlorobenzene	41	1.0	50.00	0	81.8	40	133				
1,4-Dichlorobenzene	41	1.0	50.00	0	82.4	40	135				
2-Chloroethyl vinyl ether	39	1.0	50.00	0	78.0	21	139				
2-Hexanone	76	2.0	125.0	0	61.2	35	135				
4-Methyl-2-pentanone	82	2.0	125.0	0	65.6	35	135				
Benzene	46	1.0	50.00	0	91.2	45	144				
Bromodichloromethane	41	1.0	50.00	0	82.9	35	136				
Bromoform	40	1.0	50.00	0	80.1	28	138				
Bromomethane	53	1.0	50.00	0	106	26	148				
Carbon tetrachloride	48	1.0	50.00	0	96.6	45	141				
Chlorobenzene	42	1.0	50.00	0	84.7	41	142				
Chloroethane	47	1.0	50.00	0	94.3	36	143				
Chloroform	44	1.0	50.00	0	89.0	42	137				
Chloromethane	54	1.0	50.00	0	108	35	151				
cis-1,3-Dichloropropene	41	1.0	50.00	0	83.0	42	130				
Dibromochloromethane	39	1.0	50.00	0	77.0	21	134				
Ethylbenzene	43	1.0	50.00	0	85.5	45	146				
Tetrachloroethene	44	1.0	50.00	0	87.8	45	136				
Toluene	43	1.0	50.00	0	85.4	43	134				
trans-1,2-Dichloroethene	46	1.0	50.00	0	93.0	42	135				
trans-1,3-Dichloropropene	39	1.0	50.00	0	78.3	37	133				
Trichloroethene	43	1.0	50.00	0	86.1	43	140				

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
LOD	R	Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	R	RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808217
Project: Rowe

ANALYTICAL QC SUMMARY REPORT
TestCode: 8260MTBE113_W

Sample ID: V624LCS-082108L	SampType: LCS	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37836						
Client ID: LCSW	Batch ID: R37836	TestNo: SW8260B		Analysis Date: 8/21/2008	SeqNo: 498456						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Trichlorofluoromethane	50	1.0	50.00	0	100	50	148				
Vinyl chloride	56	1.0	50.00	0	112	35	142				
Surr: 4-Bromofluorobenzene	50		50.00		100	54	134				
Surr: Dibromofluoromethane	50		50.00		101	52	132				
Surr: Toluene-d8	50		50.00		100	51	127				

Sample ID: VBLK082108L	SampType: MBLK	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37836						
Client ID: PBW	Batch ID: R37836	TestNo: SW8250B		Analysis Date: 8/21/2008	SeqNo: 498457						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

1,1,1,2-Tetrachloroethane	U	1.0									
1,1,1-Trichloroethane	U	1.0									
1,1,2,2-Tetrachloroethane	U	1.0									
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0									
1,1,2-Trichloroethane	U	1.0									
1,1-Dichloroethane	U	1.0									
1,1-Dichloroethene	U	1.0									
1,1-Dichloropropene	U	1.0									
1,2,3-Trichlorobenzene	U	1.0									
1,2,3-Trichloropropane	U	1.0									
1,2,4-Trichlorobenzene	U	1.0									
1,2,4-Trimethylbenzene	U	1.0									
1,2-Dibromo-3-chloropropane	U	1.0									
1,2-Dibromoethane	U	1.0									
1,2-Dichlorobenzene	U	1.0									
1,2-Dichloroethane	U	1.0									
1,2-Dichloropropane	U	1.0									
1,3,5-Trimethylbenzene	U	1.0									
1,3-Dichlorobenzene	U	1.0									
1,3-dichloropropane	U	1.0									
1,4-Dichlorobenzene	U	1.0									

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
LOD		Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
R		RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808217
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: VBLK082108L	Sample Type: MBLK	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37836						
Client ID: PBW	Batch ID: R37836	TestNo: SW8260B		Analysis Date: 8/21/2008	SeqNo: 498457						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
2,2-Dichloropropane	U	1.0									
2-Butanone	U	3.0									
2-Chloroethyl vinyl ether	U	1.0									
2-Chlorotoluene	U	1.0									
2-Hexanone	U	2.0									
4-Chlorotoluene	U	1.0									
4-Isopropyltoluene	U	1.0									
4-Methyl-2-pentanone	U	2.0									
Acetone	U	2.0									
Benzene	U	1.0									
Bromobenzene	U	1.0									
Bromochloromethane	U	1.0									
Bromodichloromethane	U	1.0									
Bromoform	U	1.0									
Bromomethane	U	1.0									
Carbon disulfide	U	1.0									
Carbon tetrachloride	U	1.0									
Chlorobenzene	U	1.0									
Chloroethane	U	1.0									
Chloroform	U	1.0									
Chloromethane	U	1.0									
cis-1,2-Dichloroethene	U	1.0									
cis-1,3-Dichloropropene	U	1.0									
Dibromochloromethane	U	1.0									
Dibromomethane	U	1.0									
Dichlorodifluoromethane	U	1.0									
Ethylbenzene	U	1.0									
Hexachlorobutadiene	U	1.0									
Isopropylbenzene	U	1.0									
m,p-Xylene	U	2.0									
Methyl tert-butyl ether	U	1.0									

C

C

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
LOD	Limit of Detection		LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
R	RPD outside accepted recovery limits		S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggett Brashears & Graham Inc.
Work Order: 0808217
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: VBLK082108L	SampType: MBLK	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37836						
Client ID: PBW	Batch ID: R37836	TestNo: SW8260B		Analysis Date: 8/21/2008	SeqNo: 498457						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Methylene chloride	U	1.0									C
Naphthalene	U	1.0									C
n-Butylbenzene	U	1.0									
n-Propylbenzene	U	1.0									
o-Xylene	U	1.0									
sec-Butylbenzene	U	1.0									
Styrene	U	1.0									
tert-Butylbenzene	U	1.0									
Tetrachloroethene	U	1.0									
Toluene	U	1.0									
trans-1,2-Dichloroethene	U	1.0									
trans-1,3-Dichloropropene	U	1.0									
Trichloroethene	U	1.0									
Trichlorofluoromethane	U	1.0									
Vinyl acetate	U	1.0									
Vinyl chloride	U	1.0									
Surr: 4-Bromofluorobenzene	51		50.00		102	54	134				
Surr: Dibromofluoromethane	50		50.00		99.3	52	132				
Surr: Toluene-d8	50		50.00		101	51	127				

Sample ID: 0808217-08AMS	SampType: MS	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37836						
Client ID: GWQ081208:1140N	Batch ID: R37836	TestNo: SW8260B		Analysis Date: 8/21/2008	SeqNo: 498466						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

1,1,1-Trichloroethane	43	1.0	50.00	0	86.9	43	148				
1,1,2,2-Tetrachloroethane	35	1.0	50.00	0	70.3	32	148				
1,1,2-Trichloroethane	37	1.0	50.00	0	73.6	42	136				
1,1-Dichloroethane	41	1.0	50.00	0	82.8	40	150				
1,1-Dichloroethene	51	1.0	50.00	0	101	30	154				
1,2-Dichlorobenzene	37	1.0	50.00	0	73.9	40	129				
1,2-Dichloroethane	37	1.0	50.00	0	73.4	36	141				

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
LOD		Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
R		RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808217
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: 0808217-08AMS		Sample Type: MS	TestCode: 8260MTBE11		Units: µg/L	Prep Date:		RunNo: 37836			
Client ID: GWQ081208:1140N		Batch ID: R37836	TestNo: SW8260B			Analysis Date: 8/21/2008		SeqNo: 498466			
Analyte	Result	PQL	SPK value	SPK RefVal	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,2-Dichloropropane	38	1.0	50.00	0	75.8	44	138				
1,3-Dichlorobenzene	37	1.0	50.00	0	74.8	40	133				
1,4-Dichlorobenzene	36	1.0	50.00	0	72.0	40	135				
2-Chloroethyl vinyl ether	24	1.0	50.00	0	48.2	21	139				
2-Hexanone	63	2.0	125.0	0	50.5	35	135				
4-Methyl-2-pentanone	67	2.0	125.0	0	53.5	35	135				
Benzene	38	1.0	50.00	0	76.0	45	144				
Bromodichloromethane	37	1.0	50.00	0	73.2	35	136				
Bromoform	34	1.0	50.00	0	67.4	28	138				
Bromomethane	45	1.0	50.00	0	89.6	26	148				
Carbon tetrachloride	44	1.0	50.00	0	87.9	45	141				
Chlorobenzene	37	1.0	50.00	0	74.0	41	142				
Chloroethane	42	1.0	50.00	0	83.0	36	143				
Chloroform	39	1.0	50.00	0	78.9	42	137				
Chloromethane	45	1.0	50.00	0	90.8	35	151				
cis-1,3-Dichloropropene	34	1.0	50.00	0	67.3	42	130				
Dibromochloromethane	34	1.0	50.00	0	67.1	21	134				
Ethylbenzene	37	1.0	50.00	0	73.3	45	146				
Tetrachloroethene	39	1.0	50.00	0	78.8	45	136				
Toluene	38	1.0	50.00	0	76.3	43	134				
trans-1,2-Dichloroethene	40	1.0	50.00	0	79.7	42	135				
trans-1,3-Dichloropropene	31	1.0	50.00	0	62.5	37	133				
Trichloroethene	40	1.0	50.00	0	79.6	43	140				
Trichlorofluoromethane	44	1.0	50.00	0	88.4	50	148				
Vinyl chloride	46	1.0	50.00	0	91.5	35	142				
Surr: 4-Bromofluorobenzene	47		50.00		94.2	54	134				
Surr: Dibromofluoromethane	49		50.00		97.4	52	132				
Surr: Toluene-d8	50		50.00		99.5	51	127				

Qualifiers:		E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
LOD		R	Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
R		R	RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808217
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: 8260MTBE113_W

Sample ID: 0808217-08AMSD		SampType: MSD		TestCode: 8260MTBE11		Units: µg/L		Prep Date:		RunNo: 37836	
Client ID: GWQ081208:1140N		Batch ID: R37836		TestNo: SW8260B				Analysis Date: 8/21/2008		SeqNo: 498467	
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
1,1,1-Trichloroethane	49	1.0	50.00	0	97.3	43	148	43.46	11.2	20	
1,1,2,2-Tetrachloroethane	38	1.0	50.00	0	76.6	32	148	35.15	8.58	20	
1,1,2-Trichloroethane	42	1.0	50.00	0	83.6	42	136	36.78	12.7	20	
1,1-Dichloroethane	46	1.0	50.00	0	92.6	40	150	41.38	11.2	20	
1,1-Dichloroethene	57	1.0	50.00	0	113	30	154	50.71	11.1	20	
1,2-Dichlorobenzene	40	1.0	50.00	0	80.8	40	129	36.94	9.00	20	
1,2-Dichloroethane	44	1.0	50.00	0	88.0	36	141	36.68	18.1	20	
1,2-Dichloropropane	43	1.0	50.00	0	86.3	44	138	37.89	13.0	20	
1,3-Dichlorobenzene	38	1.0	50.00	0	75.3	40	133	37.38	0.720	20	
1,4-Dichlorobenzene	38	1.0	50.00	0	75.8	40	135	35.99	5.12	20	
2-Chloroethyl vinyl ether	28	1.0	50.00	0	56.4	21	139	24.09	15.7	20	
2-Hexanone	80	2.0	125.0	0	63.7	35	135	63.12	23.1	20	R
4-Methyl-2-pentanone	85	2.0	125.0	0	68.1	35	135	66.84	24.1	20	R
Benzene	44	1.0	50.00	0	87.0	45	144	37.99	13.5	20	
Bromodichloromethane	41	1.0	50.00	0	83.0	35	136	36.62	12.5	20	
Bromoform	42	1.0	50.00	0	83.9	28	138	33.68	21.9	20	R
Bromomethane	51	1.0	50.00	0	102	26	148	44.81	12.8	20	
Carbon tetrachloride	47	1.0	50.00	0	94.9	45	141	43.95	7.62	20	
Chlorobenzene	42	1.0	50.00	0	83.8	41	142	37.01	12.4	20	
Chloroethane	46	1.0	50.00	0	91.0	36	143	41.52	9.19	20	
Chloroform	46	1.0	50.00	0	91.1	42	137	39.44	14.3	20	
Chloromethane	51	1.0	50.00	0	101	35	151	45.41	10.9	20	
cis-1,3-Dichloropropene	39	1.0	50.00	0	77.7	42	130	33.64	14.4	20	
Dibromochloromethane	41	1.0	50.00	0	82.5	21	134	33.53	20.7	20	R
Ethylbenzene	41	1.0	50.00	0	81.1	45	146	36.67	10.1	20	
Tetrachloroethene	42	1.0	50.00	0	83.8	45	136	39.38	6.22	20	
Toluene	42	1.0	50.00	0	84.4	43	134	38.16	10.1	20	
trans-1,2-Dichloroethene	44	1.0	50.00	0	88.4	42	135	39.84	10.4	20	
trans-1,3-Dichloropropene	37	1.0	50.00	0	74.4	37	133	31.26	17.4	20	
Trichloroethene	43	1.0	50.00	0	86.2	43	140	39.79	8.03	20	
Trichlorofluoromethane	50	1.0	50.00	0	99.7	50	148	44.22	12.0	20	

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
LOD		Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
R		RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808217
Project: Rowe

ANALYTICAL QC SUMMARY REPORT
TestCode: 8260MTBE113_W

Sample ID: 0808217-08AMSD	SampleType: MSD	TestCode: 8260MTBE11	Units: µg/L	Prep Date:	RunNo: 37836						
Client ID: GWQ081208:1140N	Batch ID: R37836	TestNo: SW8260B		Analysis Date: 8/21/2008	SeqNo: 498467						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Vinyl chloride	50	1.0	50.00	0	100	35	142	45.73	9.12	20	
Surr: 4-Bromofluorobenzene	48		50.00		96.6	54	134		0	0	
Surr: Dibromofluoromethane	50		50.00		101	52	132		0	0	
Surr: Toluene-d8	49		50.00		97.3	51	127		0	0	

Qualifiers:	E	Value above quantitation range		H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
	LOD	Limit of Detection		LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
	R	RPD outside accepted recovery limits		S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808217
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: FE_D

Sample ID: PBW-081908A	SampleType: MBLK	TestCode: FE_D	Units: mg/L	Prep Date:	RunNo: 37749						
Client ID: PBW	Batch ID: 22654	TestNo: E200.7	SW3010A	Analysis Date: 8/20/2008	SeqNo: 496211						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Iron	U	0.0200									

Sample ID: LCSW-081908A	SampleType: LCS	TestCode: FE_D	Units: mg/L	Prep Date:	RunNo: 37749						
Client ID: LCSW	Batch ID: 22654	TestNo: E200.7	SW3010A	Analysis Date: 8/20/2008	SeqNo: 496212						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Iron	1.96	0.0200	2.000	0	98.2	68	122				

Qualifiers:	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded	J	Analyte detected below quantitation li
LOD		Limit of Detection	LOQ	Limit of Quantitation	ND	Not Detected at the Reporting Limit
R		RPD outside accepted recovery limits	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed

CLIENT: Leggette Brashears & Graham Inc.
Work Order: 0808217
Project: Rowe

ANALYTICAL QC SUMMARY REPORT

TestCode: FE_T

Sample ID: PBW-081908A	SampType: MBLK	TestCode: FE_T	Units: mg/L	Prep Date:	RunNo: 37749						
Client ID: PBW	Batch ID: 22654	TestNo: E200.7	SW3010A	Analysis Date: 8/20/2008	SeqNo: 496130						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Iron	U	0.0200									

Sample ID: LCSW-081908A	SampType: LCS	TestCode: FE_T	Units: mg/L	Prep Date:	RunNo: 37749						
Client ID: LCSW	Batch ID: 22654	TestNo: E200.7	SW3010A	Analysis Date: 8/20/2008	SeqNo: 496131						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Iron	1.96	0.0200	2.000	0	98.2	68	122				

Sample ID: 0808217-08B-MS	SampType: MS	TestCode: FE_T	Units: mg/L	Prep Date: 8/19/2008	RunNo: 37749						
Client ID: GWQ081208:1140N	Batch ID: 22654	TestNo: E200.7	SW3010A	Analysis Date: 8/20/2008	SeqNo: 496644						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Iron	2.50	0.0200	1.000	1.573	92.4	68	122				

Sample ID: 0808217-08B-MSD	SampType: MSD	TestCode: FE_T	Units: mg/L	Prep Date: 8/19/2008	RunNo: 37749						
Client ID: GWQ081208:1140N	Batch ID: 22654	TestNo: E200.7	SW3010A	Analysis Date: 8/20/2008	SeqNo: 496645						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Iron	2.50	0.0200	1.000	1.573	92.4	68	122	2.498	0.0132	20	

Qualifiers: E Value above quantitation range
LOD Limit of Detection
R RPD outside accepted recovery limits

H Holding times for preparation or analysis exceeded
LOQ Limit of Quantitation
S Spike Recovery outside accepted recovery limits

J Analyte detected below quantitation li
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed

H8H200110 Analytical Report	1
Sample Receipt Documentation	15
Total Number of Pages	17

ANALYTICAL REPORT


Rowe-NABSAG 0401

Lot #: H8H200110

Mark Goldberg

Leggette, Brashears & Graham,
4 Research Drive
Suite #301
Shelton, CT 06484

TESTAMERICA LABORATORIES, INC.

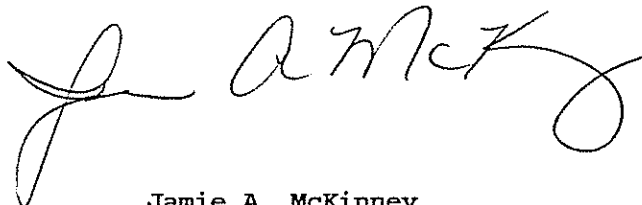

Jamie A. McKinney
Project Manager

August 27, 2008

ANALYTICAL METHODS SUMMARY

H8H200110

<u>PARAMETER</u>	<u>ANALYTICAL METHOD</u>
Volatile Organics by TO15	EPA-2 TO-15

References:

EPA-2 "Compendium of Methods for the Determination of Toxic
Organic Compounds in Ambient Air", EPA-625/R-96/010b,
January 1999.

SAMPLE SUMMARY

H8H200110

WO #	SAMPLE#	CLIENT SAMPLE ID	SAMPLED DATE	SAMP TIME
KVFCH	001	AQ081908:1200NP4-1	08/19/08	12:00
KVFCJ	002	AQ081908:1205NP4-2	08/19/08	12:05
KVFCK	003	AQ081908:1210NP4-3	08/19/08	12:10

NOTE(S) :

- The analytical results of the samples listed above are presented on the following pages.
- All calculations are performed before rounding to avoid round-off errors in calculated results.
- Results noted as "ND" were not detected at or above the stated limit.
- This report must not be reproduced, except in full, without the written approval of the laboratory.
- Results for the following parameters are never reported on a dry weight basis: color, corrosivity, density, flashpoint, ignitability, layers, odor, paint filter test, pH, porosity pressure, reactivity, redox potential, specific gravity, spot tests, solids, solubility, temperature, viscosity, and weight.

PROJECT NARRATIVE

H8H200110

The results reported herein are applicable to the samples submitted for analysis only.

This report shall not be reproduced except in full, without the written approval of the laboratory.

The original chain of custody documentation is included with this report.

Sample Receipt

There were no problems with the condition of the samples received.

Quality Control and Data Interpretation

Unless otherwise noted, all holding times and QC criteria were met and the test results shown in this report meet all applicable NELAC requirements.

The EPA method requires that all target analytes in the continuing calibration verification standard be within 30% difference from the initial calibration. The laboratory standard operating procedure allows up to four analytes in the calibration verification to be $\leq 40\%$ difference from the initial calibration. The calibration verification analyzed on 8/21/08 exhibited a %difference of $>30\%$ but $\leq 40\%$ for chloromethane and bromodichloromethane.

The samples were received on 08/20/08 in Tedlar bags and analyzed within 72 hours of sampling.

TestAmerica Knoxville maintains the following certifications, approvals and accreditations: Arkansas DEQ Cert. #05-043-0, California DHS ELAP Cert. #2423, Colorado DPHE, Connecticut DPH Cert. #PH-0223, Florida DOH Cert. #E87177, Georgia DNR Cert. #906, Hawaii DOH, Illinois EPA Cert. #000687, Indiana DOH Cert. #C-TN-02, Iowa DNR Cert. #375, Kansas DHE Cert. #E-10349, Kentucky DEP Lab ID #90101, Louisiana DEQ Cert. #03079, Louisiana DOHH Cert. #LA030024, Maryland DHMH Cert. #277, Massachusetts DEP Cert. #M-TN009, Michigan DEQ Lab ID #9933, New Jersey DEP Cert. #TN001, New York DOH Lab #10781, North Carolina DPH Lab ID #21705, North Carolina DEHNR Cert. #64, Ohio EPA VAP Cert. #CL0059, Oklahoma DEQ ID #9415, Pennsylvania DEP Cert. #68-00576, South Carolina DHEC Lab ID #84001001, Tennessee DOH Lab ID #02014, Utah DOH Cert. #QUAN3, Virginia DGS Lab ID #00165, Washington DOE Lab #C120, West Virginia DEP Cert. #345, Wisconsin DNR Lab ID #998044300, Naval Facilities Engineering Service Center and USDA Soil Permit #S-46424. This list of approvals is subject to change and does not imply that laboratory certification is available for all parameters reported in this environmental sample data report.

Sample Data Summary

Leggette, Brashears & Graham, Inc.
 Client Sample ID: AQ081908:1200NP4-1
 GC/MS Volatiles

Lot-Sample # H8H200110 - 001 Work Order # KVFCH1AA Matrix.....: AIR

Date Sampled...: 08/19/2008 Date Received...: 08/20/2008
 Prep Date.....: 08/21/2008 Analysis Date...: 08/21/2008
 Prep Batch #.....: 8235079
 Dilution Factor.: 5 Method.....: TO-15

PARAMETER	RESULTS (ppb(v/v))	REPORTING LIMIT (ppb(v/v))	RESULTS (ug/m3)	REPORTING LIMIT (ug/m3)
Benzene	0.28	1.0	0.91 J	3.2
Bromodichloromethane	ND	1.0	ND	6.7
Bromoform	ND	1.0	ND	10
Bromomethane	ND	1.0	ND	3.9
Carbon disulfide	4.7	2.5	15	7.8
Carbon tetrachloride	ND	1.0	ND	6.3
Chlorobenzene	ND	1.0	ND	4.6
Dibromochloromethane	ND	1.0	ND	8.5
Chloroethane	ND	1.0	ND	2.6
Chloroform	1.0	1.0	5.0	4.9
Chloromethane	1.3	2.5	2.8 J	5.2
1,1-Dichloroethane	3.0	1.0	12	4.0
1,2-Dichloroethane	ND	1.0	ND	4.0
cis-1,2-Dichloroethene	ND	1.0	ND	4.0
trans-1,2-Dichloroethene	ND	1.0	ND	4.0
1,1-Dichloroethene	0.62	1.0	2.5 J	4.0
1,2-Dichloropropane	ND	1.0	ND	4.6
cis-1,3-Dichloropropene	ND	1.0	ND	4.5
trans-1,3-Dichloropropene	ND	1.0	ND	4.5
Ethylbenzene	ND	1.0	ND	4.3
Methylene chloride	1.0	2.5	3.6 J B	8.7
Styrene	ND	1.0	ND	4.3
1,1,2,2-Tetrachloroethane	ND	1.0	ND	6.9
Tetrachloroethene	8.1	1.0	55	6.8
Toluene	1.3	1.0	4.9	3.8
1,1,1-Trichloroethane	9.5	1.0	52	5.5
1,1,2-Trichloroethane	ND	1.0	ND	5.5
Trichloroethene	1.8	1.0	9.5	5.4
Vinyl chloride	ND	1.0	ND	2.6
m-Xylene & p-Xylene	ND	1.0	ND	4.3
o-Xylene	ND	1.0	ND	4.3

SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
1,2-Dichloroethane-d4	116	70 - 130
Toluene-d8	95	70 - 130
4-Bromofluorobenzene	111	70 - 130

Leggette, Brashears & Graham, Inc.

Client Sample ID: AQ081908:1200NP4-1

GC/MS Volatiles

Lot-Sample # H8H200110 - 001 Work Order # KVFCH1AA Matrix.....: AIR

Qualifiers

B Method blank contamination. The associated method blank contains the target analyte at a reportable level.
J Estimated result. Result is less than RL.

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting
Limit(before rounding) * Dilution Factor) * (Molecular Weight/24.45)

Leggette, Brashears & Graham, Inc.
 Client Sample ID: AQ081908:1205NP4-2
 GC/MS Volatiles

Lot-Sample # H8H200110 - 002 Work Order # KVFCJ1AA Matrix.....: AIR

Date Sampled...: 08/19/2008 Date Received...: 08/20/2008
 Prep Date.....: 08/21/2008 Analysis Date...: 08/21/2008
 Prep Batch #....: 8235079
 Dilution Factor.: 5 Method.....: TO-15

PARAMETER	RESULTS (ppb(v/v))	REPORTING LIMIT (ppb(v/v))	RESULTS (ug/m3)	REPORTING LIMIT (ug/m3)
Benzene	ND	1.0	ND	3.2
Bromodichloromethane	ND	1.0	ND	6.7
Bromoform	ND	1.0	ND	10
Bromomethane	ND	1.0	ND	3.9
Carbon disulfide	5.0	2.5	16	7.8
Carbon tetrachloride	ND	1.0	ND	6.3
Chlorobenzene	ND	1.0	ND	4.6
Dibromochloromethane	ND	1.0	ND	8.5
Chloroethane	ND	1.0	ND	2.6
Chloroform	1.2	1.0	5.9	4.9
Chloromethane	1.4	2.5	2.9 J	5.2
1,1-Dichloroethane	2.5	1.0	10	4.0
1,2-Dichloroethane	ND	1.0	ND	4.0
cis-1,2-Dichloroethene	0.39	1.0	1.5 J	4.0
trans-1,2-Dichloroethene	ND	1.0	ND	4.0
1,1-Dichloroethene	0.53	1.0	2.1 J	4.0
1,2-Dichloropropane	ND	1.0	ND	4.6
cis-1,3-Dichloropropene	ND	1.0	ND	4.5
trans-1,3-Dichloropropene	ND	1.0	ND	4.5
Ethylbenzene	ND	1.0	ND	4.3
Methylene chloride	1.3	2.5	4.4 J B	8.7
Styrene	ND	1.0	ND	4.3
1,1,2,2-Tetrachloroethane	ND	1.0	ND	6.9
Tetrachloroethene	38	1.0	260	6.8
Toluene	0.58	1.0	2.2 J	3.8
1,1,1-Trichloroethane	17	1.0	90	5.5
1,1,2-Trichloroethane	ND	1.0	ND	5.5
Trichloroethene	7.6	1.0	41	5.4
Vinyl chloride	ND	1.0	ND	2.6
m-Xylene & p-Xylene	ND	1.0	ND	4.3
o-Xylene	ND	1.0	ND	4.3

SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
1,2-Dichloroethane-d4	115	70 - 130
Toluene-d8	89	70 - 130
4-Bromofluorobenzene	116	70 - 130

Leggette, Brashears & Graham, Inc.
Client Sample ID: AQ081908:1205NP4-2
GC/MS Volatiles

Lot-Sample # H8H200110 - 002 Work Order # KVFCJ1AA Matrix.....: AIR

Qualifiers

B Method blank contamination. The associated method blank contains the target analyte at a reportable level.
J Estimated result. Result is less than RL.

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting
Limit(before rounding) * Dilution Factor) * (Molecular Weight/24.45)

Leggette, Brashears & Graham, Inc.
 Client Sample ID: AQ081908:1210NP4-3
 GC/MS Volatiles

Lot-Sample # H8H200110 - 003 Work Order # KVFCCK1AA Matrix.....: AIR

Date Sampled...: 08/19/2008 Date Received...: 08/20/2008
 Prep Date.....: 08/21/2008 Analysis Date...: 08/21/2008
 Prep Batch #.....: 8235079
 Dilution Factor.: 5 Method.....: TO-15

PARAMETER	RESULTS (ppb(v/v))	REPORTING LIMIT (ppb(v/v))	RESULTS (ug/m3)	REPORTING LIMIT (ug/m3)
Benzene	ND	1.0	ND	3.2
Bromodichloromethane	ND	1.0	ND	6.7
Bromoform	ND	1.0	ND	10
Bromomethane	ND	1.0	ND	3.9
Carbon disulfide	5.1	2.5	16	7.8
Carbon tetrachloride	ND	1.0	ND	6.3
Chlorobenzene	ND	1.0	ND	4.6
Dibromochloromethane	ND	1.0	ND	8.5
Chloroethane	ND	1.0	ND	2.6
Chloroform	0.68	1.0	3.3 J	4.9
Chloromethane	1.8	2.5	3.7 J	5.2
1,1-Dichloroethane	2.1	1.0	8.4	4.0
1,2-Dichloroethane	ND	1.0	ND	4.0
cis-1,2-Dichloroethene	ND	1.0	ND	4.0
trans-1,2-Dichloroethene	ND	1.0	ND	4.0
1,1-Dichloroethene	0.60	1.0	2.4 J	4.0
1,2-Dichloropropane	ND	1.0	ND	4.6
cis-1,3-Dichloropropene	ND	1.0	ND	4.5
trans-1,3-Dichloropropene	ND	1.0	ND	4.5
Ethylbenzene	ND	1.0	ND	4.3
Methylene chloride	1.5	2.5	5.1 J B	8.7
Styrene	ND	1.0	ND	4.3
1,1,2,2-Tetrachloroethane	ND	1.0	ND	6.9
Tetrachloroethene	ND	1.0	ND	6.8
Toluene	0.73	1.0	2.8 J	3.8
1,1,1-Trichloroethane	3.4	1.0	18	5.5
1,1,2-Trichloroethane	ND	1.0	ND	5.5
Trichloroethene	ND	1.0	ND	5.4
Vinyl chloride	ND	1.0	ND	2.6
m-Xylene & p-Xylene	ND	1.0	ND	4.3
o-Xylene	ND	1.0	ND	4.3

SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
1,2-Dichloroethane-d4	107	70 - 130
Toluene-d8	89	70 - 130
4-Bromofluorobenzene	121	70 - 130

Leggette, Brashears & Graham, Inc.
Client Sample ID: AQ081908:1210NP4-3
GC/MS Volatiles

Lot-Sample # H8H200110 - 003 Work Order # KVFCK1AA Matrix.....: AIR

Qualifiers

B Method blank contamination. The associated method blank contains the target analyte at a reportable level.
J Estimated result. Result is less than RL.

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting
Limit(before rounding) * Dilution Factor) * (Molecular Weight/24.45)

Leggette, Brashears & Graham, Inc.
 Client Sample ID: INTRA-LAB BLANK
 GC/MS Volatiles

Lot-Sample # H8H220000 - 079B Work Order # KVK7J1AA Matrix.....: AIR

Prep Date.....: 08/14/2008 Date Received..: 08/15/2008
 Prep Batch #.....: 08/21/2008 Analysis Date...: 08/21/2008
 Dilution Factor.: 8235079
 Method.....: TO-15

PARAMETER	RESULTS (ppb(v/v))	REPORTING LIMIT (ppb(v/v))	RESULTS (ug/m3)	REPORTING LIMIT (ug/m3)
Benzene	ND	0.20	ND	0.64
Bromodichloromethane	ND	0.20	ND	1.3
Bromoform	ND	0.20	ND	2.1
Bromomethane	ND	0.20	ND	0.78
Carbon disulfide	ND	0.50	ND	1.6
Carbon tetrachloride	ND	0.20	ND	1.3
Chlorobenzene	ND	0.20	ND	0.92
Dibromochloromethane	ND	0.20	ND	1.7
Chloroethane	ND	0.20	ND	0.53
Chloroform	ND	0.20	ND	0.98
Chloromethane	ND	0.50	ND	1.0
1,1-Dichloroethane	ND	0.20	ND	0.81
1,2-Dichloroethane	ND	0.20	ND	0.81
cis-1,2-Dichloroethene	ND	0.20	ND	0.79
trans-1,2-Dichloroethene	ND	0.20	ND	0.79
1,1-Dichloroethene	ND	0.20	ND	0.79
1,2-Dichloropropane	ND	0.20	ND	0.92
cis-1,3-Dichloropropene	ND	0.20	ND	0.91
trans-1,3-Dichloropropene	ND	0.20	ND	0.91
Ethylbenzene	ND	0.20	ND	0.87
Methylene chloride	0.37	0.50	1.3 J	1.7
Styrene	ND	0.20	ND	0.85
1,1,2,2-Tetrachloroethane	ND	0.20	ND	1.4
Tetrachloroethene	ND	0.20	ND	1.4
Toluene	ND	0.20	ND	0.75
1,1,1-Trichloroethane	ND	0.20	ND	1.1
1,1,2-Trichloroethane	ND	0.20	ND	1.1
Trichloroethene	ND	0.20	ND	1.1
Vinyl chloride	ND	0.20	ND	0.51
m-Xylene & p-Xylene	ND	0.20	ND	0.87
o-Xylene	ND	0.20	ND	0.87

SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
1,2-Dichloroethane-d4	105	70 - 130
Toluene-d8	103	70 - 130
4-Bromofluorobenzene	101	70 - 130

Leggette, Brashears & Graham, Inc.

Client Sample ID: INTRA-LAB BLANK

GC/MS Volatiles

Lot-Sample # H8H220000 - 079B

Work Order # KVK7J1AA

Matrix.....: AIR

Qualifiers

J Estimated result. Result is less than RL.

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting Limit(before rounding) * Dilution Factor) * (Molecular Weight/24.45)

Leggette, Brashears & Graham, Inc.
 Client Sample ID: CHECK SAMPLE
 GC/MS Volatiles

Lot-Sample # H8H220000 - 079C Work Order # KVK7J1AC Matrix.....: AIR

Prep Date.....: 08/14/2008 Date Received...: 08/15/2008
 Prep Date.....: 08/21/2008 Analysis Date...: 08/21/2008
 Prep Batch #.....: 8235079
 Dilution Factor.: 1 Method.....: TO-15

PARAMETER	SPIKE AMOUNT (ppb(v/v))	MEASURED AMOUNT (ppb(v/v))	SPIKE AMOUNT (ug/m3)	MEASURED AMOUNT (ug/m3)	PERCENT RECOVERY	RECOVERY LIMITS
Benzene	2.50	2.37	8.0	7.6	95	70 - 130
Chlorobenzene	2.50	2.47	12	11	99	70 - 130
1,1-Dichloroethene	2.50	2.83	9.9	11	113	70 - 130
Toluene	2.50	2.55	9.4	9.6	102	70 - 130
Trichloroethene	2.50	3.18	13	17	127	70 - 130

SURROGATE	PERCENT RECOVERY	LABORATORY CONTROL LIMITS (%)
1,2-Dichloroethane-d4	101	70 - 130
Toluene-d8	98	70 - 130
4-Bromofluorobenzene	114	70 - 130

The 'Result' in ug/m3 is calculated using the following equation: Amount Found(before rounding)*(Molecular Weight/24.45)

The 'Reporting Limit' in ug/m3 is calculated using the following equation: (Reporting
 Limit(before rounding) * Dilution Factor) * (Molecular Weight/24.45)

Sample Receipt Documentation

STL Knoxville

5815 Middlebrook Pike • Knoxville, TN 37921-5947
Phone: (865) 291-3000 • Fax: (865) 584-4315
Receiving: (865) 291-3031

ANALYSIS REQUEST AND CHAIN OF CUSTODY RECORD*

Reference Document No.

Page 1 of

Bill to: 5 LBG

Project Name/No. 1 NASSAG / Rose
Sample Team Members 2 Sit
Profit Center No. 3
Project Manager 4 M. Goldberg
Purchase Order No. 6 NASSAG
Required Report Date 11

Samples Shipment Date 7 8/19/08
Lab Destination 8
Lab Contact 9 S. McKinney
Project Contact / Phone 12
Carrier / Waybill No. 13

4 Research Dr. Suite 301
Shelton, CT 06484
Report to: 10 M. Goldberg
MGoldberg@ubgct.com

ONE CONTAINER PER LINE

Sample 14 Number	Sample 15 Type	Date/Time 16 Collected	Container 17 Type	Sample 18 Volume	Pre- 19 servative	Requested Testing 20 Program	Condition on Receipt 21 Lab use only
A0081908-1200NP4-1	Air	8/19/08 1200	Tedlar Bag	1 liter	None	TD-15	Custody seals intact <u>ON NA</u>
A0081908-1205NP4-2		1205				TD-15	Temperature received at <u>ambient</u>
A0081908-1210NP4-3		1210				TD-15	Received by <u>SS</u> Date <u>8-20-08</u>
							Number of packages <u>1000</u>
							Tracking # <u>710055933226</u>

Special Instructions: 23

Possible Hazard Identification: 24

Non-Hazard ☒ Flammable ☐ Skin Irritant ☐ Poison B ☐ Unknown ☐ Sample Disposal: 25 Return to Client ☐ Disposal by Lab ☒ Archive (mos.)

Turnaround Time Required: 26

Normal ☒ Rush ☐ QC Level: 27 I. ☐ II. ☐ III. ☐ Project Specific (specify):

1. Relinquished by 28 [Signature] Date: 8-20-08
(Signature / Affiliation) Time: 09:15

1. Relinquished by [Signature] Date: 8-20-08
(Signature / Affiliation) Time: 09:15

Comments: 29

TESTAMERICA KNOXVILLE SAMPLE RECEIPT/CONDITION UPON RECEIPT ANOMALY CHECKLIST

Client: LSC

Project: _____

Lot Number: H8120011D

Review Items	Yes	No	NA	If No, what was the problem?	Comments/Actions Taken
1. Do sample container labels match COC? (IDs, Dates, Times)	☒			☐ 1a Do not match COC ☐ 1b Incomplete information ☐ 1c Marking smeared ☐ 1d Label torn ☐ 1e No label ☐ 1f COC not received ☐ 1g Other: _____	
2. Is the cooler temperature within limits? (> freezing temp. of water to 6 °C; NC, 1668, 1613B: 0-4 °C; VOST: 10 °C; MA: 2-6 °C)				☐ 2a Temp Blank = _____ ☐ 2b Cooler Temp = _____	
3. Were samples received with correct chemical preservative (excluding Encore)?				☐ 3a Sample preservative = _____	
4. Were custody seals present/intact on cooler and/or containers?				☐ 4a Not present ☐ 4b Not intact ☐ 4c Other: _____	
5. Were all of the samples listed on the COC received?				☐ 5a Samples received-not on COC ☐ 5b Samples not received-on COC	
6. Were all of the sample containers received intact?				☐ 6a Leaking ☐ 6b Broken	
7. Were VOA samples received without headspace?				☐ 7a Headspace (VOA only)	
8. Were samples received in appropriate containers?				☐ 8a Improper container	
9. Did you check for residual chlorine, if necessary?				☐ 9a Could not be determined due to matrix interference	
10. Were samples received within holding time?				☐ 10a Holding time expired	
11. For rad samples, was sample activity info. provided?				☐ Incomplete information	
12. For SOG water samples (1613B, 1668A, 8290, LR PAHs), do samples have visible solids present?				If yes & appears to be >1%, was SOG notified? _____	
13. Are the shipping containers intact?				☐ 13a Leaking ☐ 13b Other: _____	
14. Was COC relinquished? (Signed/Dated/Timed)				☐ 14a Not relinquished	
15. Are tests/parameters listed for each sample?				☐ 15a Incomplete information	
16. Is the matrix of the samples noted?				☐ 15a Incomplete information	
17. Is the date/time of sample collection noted?				☐ 15a Incomplete information	
18. Is the client and project name/# identified?				☐ 15a Incomplete information	
19. Was the sampler identified on the COC?				☐ 15a Incomplete information	
Quote #: <u>69611D</u> PM Instructions: _____					

Sample Receiving Associate: [Signature]

Date: 8-20-08

QA026R19.doc, 080707