



PROJECT STATUS MEMORANDUM

TO: Pamela Tames, USEPA

FROM: Mark M. Goldberg, P.E.
Tunde H. Komuves-Sandor, PG, CPG

SUBJECT: Rowe Industries Superfund Site
NYS Site ID No. 152106
Groundwater Recovery and Treatment System
DRAFT March 2021 Status Report

DATE: May 4, 2021

WSP USA (WSP) commenced operation of the Full-Scale Pump and Treat (FSP&T) groundwater remediation system at the above-referenced site on December 17, 2002. Starting in September 2008, the groundwater recovered by the Focus Pump and Treat (FP&T) system was routed to the FSP&T system for treatment. As of 2014, the FSP&T system only treats water extracted from RW-2; the other FSP&T recovery wells (RW-1, 3, 4, 5, 6, 7, 8, and 9) have been shut down with USEPA approval after achieving remediation standards. In February 2020, the FP&T system, which consists of four focused recover wells (FRW-1, FRW-2, FRW-3 and FRW-4), was turned off with EPA approval to conduct in-situ injection to treat contaminants in the former drum storage area (FDSA). This status report presents a summary of performance, operation and maintenance for the FSP&T system and monitoring activities for the site from March 1, 2021 through March 31, 2021. The report includes a summary of system performance parameters, system operation parameters, and analytical results for groundwater, system effluent samples and air-quality results.

SUMMARY OF SYSTEM PERFORMANCE AND OPERATION

(March 1, 2021 through March 31, 2021)

- | | |
|---|----------------------------|
| 1. Hours of operation during the reporting period: | 743 hours (99.8%) |
| 2. Alarm conditions during the reporting period: | See Table 1 |
| 3. Were the State Pollutant Discharge Elimination System (SPDES) volatile organic compounds (VOC) discharge permit criteria achieved: | Yes, (see Table 2, App. I) |
| 4. Total volume of water pumped during the reporting period: | 1,135,370 gal. |
| 5. Was the system effluent flow below the SPDES limit of 1,023,000 gpd: | Yes, (see Graph 1) |
| 6. Mass of VOCs recovered during the reporting period: | <0.01 pound (see Graph 2) |
| 7. Cumulative mass of VOCs recovered since startup on 12/17/02:
(calculations can be provided upon request) | 230.1 pounds |



PUMP AND TREAT SYSTEM STATUS SUMMARY

Continued to observe the leaky flange in the booster blower duct and noisy operation of the air-stripper blower during the March site visits. Repairs for the leaky flange are scheduled during the annual O&M cleaning event scheduled for late spring. The remaining O&M activities for the FSP&T system are included in Table 1.

SUMMARY OF SAMPLING ACTIVITIES

March 2021 groundwater quality sampling was completed for the following wells:

- A monthly groundwater sample was collected from RW-2 on March 2, 2021.

Table 3 presents a summary of the quality results for water samples collected from downgradient recovery well RW-2. Graph 3 presents tetrachloroethylene (PCE) concentrations for samples collected from RW-2 for the last 24 months. The laboratory analytical report for the water sample collected from the recovery well is included as Appendix I. Because RW-2 is the only well operating, the sample from that well also serves as the influent system sample.

The PCE, trichloroethylene (TCE), cis-1,2-dichloroethylene (cis-DCE), vinyl chloride (VC) and trichloroethane (TCA) concentrations in the groundwater sample collected from RW-2 were below the respective Applicable or Relevant and Appropriate Requirements (ARARs); concentrations at RW-2 have been below the ARARs for over 10 years. A groundwater sample from RW-2 will continue to be collected and analyzed monthly.

FUTURE O&M ACTIVITIES

O&M activities scheduled for April 2021 include:

- monitor air stripper main blower operation and leak at flange for booster blower air duct; and
- normal bi-weekly/monthly O&M activities.

Attachments

cc: Brian Shuttleworth - Kraft Heinz Foods Company (as successor to Kraft Foods Group, Inc.) -.pdf
Kevin Kyrias-Gann, Ramboll -.pdf
Rebecca Spellissy, Ramboll -.pdf
Payson Long, NYSDEC -.pdf
Chief-Operation Maintenance and Support Section, NYSDEC -.pdf
Anthony Leung, RWM, R-1, NYSDEC -.pdf
Sundy Schermeyer, Town of Southampton, Town Clerk -.pdf
Mark Sergott, NYSDOH -.pdf

H:\NABIS\2021\Monthly Reports\March\Draft Status Report - March 2021.docx

TABLES

TABLE 1

**GROUNDWATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

**MAINTENANCE LOG
(March 1, 2021 through March 31, 2021)**

Date	Time	System Changes/Modifications	Personnel
3/2/21		Air-stripper main blower operation continues to operate at variable speed. Continue to monitor blower operation.	SP
		Collected a sample from RW-2 and the effluent of the system.	SP
		Same leaky gasket at booster blower flange scheduled for repair during annual well rehabilitation and spring O&M event.	SP
3/16/21		Changed the multi-bag filter bags (400 um) in Banks 1 and 2, seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed. Cleaned filter baskets and housings.	SP
		Re-mark below-grade utilities to respond to multiple NY One Call tickets.	SP
		Similar observations to 3/2/21.	SP

Notes:

SP

Scott Philbrick, WSP USA

H:\NABIS\2021\Monthly Reports\March\Table 1 Maintenance Record - March 2021.docx

TABLE 2

**GROUNDWATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

Effluent Water Quality Results

Date Sampled ^{2/}	pH ^{1/}	TDS ^{4/} (mg/l)	PCE (ug/l)	1,1,1-TCA (ug/l)	TCE (ug/l)	1,1-DCA (ug/l)	1,1-DCE (ug/l)	cis- 1,2-DCE (ug/l)	trans- 1,2-DCE (ug/l)	Xylene (ug/l)	Toluene (ug/l)	Ethyl- benzene (ug/l)	Methylene Chloride (ug/l)	Freon 113 (ug/l)	Naphthalene (ug/l)	Chloroform (ug/l)
SPDES Limits	6.5 to 8.5	---	5	5	5	5	5	5	5	5	5	5	5	---	10	7
4-Feb-20	7.0	122	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
2-Mar-20	7.0	137	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
2-Apr-20	7.0	161	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
7-May-20	7.0	299	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
2-Jun-20	6.8	174	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
7-Jul-20	7.0	125	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
7-Aug-20	6.8	178	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
1-Sep-20	6.8	145	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
1-Oct-20	6.8	148	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
2-Nov-20	7.0	889	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
2-Dec-20	7.0	105	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
5-Jan-21	7.0	206	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
3-Feb-21	6.8	139	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
2-Mar-21	6.8	158	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5

SPDES: State Pollutant Discharge Elimination System

mg/l: Milligrams per liter

ug/l: Micrograms per liter

----: Not established

J: Analyte detected below quantitation limits, value shown is a laboratory estimate.

B: Analyte was found in the associated analysis batch blank. For volatiles, methylene chloride and acetone are common lab contaminants.

ND: Not detected NA: Not Analyzed

C = CCV-E: The value reported is estimated The value is estimated due to its behavior during continuing calibration verification.

Q = QL-02: This LCS analyte is outside Laboratory Recovery limits due to the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.

NM: Not Measured

TDS: Total dissolved solids

PCE: Tetrachloroethylene

1,1,1-TCA: 1,1,1-Trichloroethane

TCE: Trichloroethene

1,1-DCA: 1,1-Dichloroethane

1,1-DCE: 1,1-Dichloroethene

cis-1,2-DCE: cis-1,2-Dichloroethene

trans-1,2,-DCE: trans-1,2-Dichloroethene

Notes:

- Based on the SPDES criteria from an NYSDEC letter dated on May 6, 2016, the allowable pH range for the Rowe Site is between 6.5 and 8.5. The effluent pH was 6.8 on March 16, 2021. Historic pH measurements from recovery wells indicate that natural background pH concentrations are less than 6.5.
- "Effluent" samples were collected from sample port labeled NP2-10 unless otherwise noted.
- Starting in October 2016, FSP&T system samples are collected monthly instead of once every two weeks. The pH of the effluent water is measured two times per month in accordance with the SPDES requirements.

TABLE 3

**GROUNDWATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

Recovery Well Water Quality Results

Recovery Well ^{1/}	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	1,1-Dichloro-ethane (ug/L)	cis-1,2-Dichloro-ethene (ug/L)	1,1-Dichloro-ethene (ug/L)	Methylene Chloride (ug/L)	Toluene (ug/L)	Benzene (ug/L)	m,p-Xylene (ug/L)	o-Xylene (ug/L)
	ARAR's	5	5	5	7	NE	5	5	5	5	NE	NE	5	5
RW-2	4-Feb-20	0.270 Q	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	2-Mar-20	1.67 C	0.250	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	2-Apr-20	0.230	0.230 Q	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	7-May-20	0.240	ND<0.5	ND<0.5	0.210	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	2-Jun-20	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	7-Jul-20	0.220	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	7-Aug-20	ND<0.5	ND<0.5	ND<0.5	0.260	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	1-Sep-20	ND<0.5	0.310	ND<0.5	0.330	ND<0.5	ND<0.5	0.260	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	1-Oct-20	ND<0.5	0.330	ND<0.5	0.210	ND<0.5	ND<0.5	0.210	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	2-Nov-20	0.350	ND<0.5	ND<0.5	0.220	ND<0.5	ND<0.5	1.42	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	2-Dec-20	0.400	0.480	ND<0.5	0.230	ND<0.5	ND<0.5	0.640	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	5-Jan-21	ND<0.5	0.490	ND<0.5	ND<0.5	ND<0.5	ND<0.5	0.460	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	3-Feb-21	ND<0.5	0.380	ND<0.5	ND<0.5	ND<0.5	ND<0.5	0.270	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	2-Mar-21	ND<0.5	0.360	ND<0.5	ND<0.5	ND<0.5	ND<0.5	0.200	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5

PCE: Tetrachloroethylene
MTBE: Methyl tertiary-butyl ether

TCE: Trichloroethylene
NS: Not sampled

TCA: 1,1,1-Trichloroethane

ND: Not detected.

<#: Less than method detection limit.

ug/L: Micrograms per liter

-: Not analyzed.

J: Analyte detected below quantitation limits, value shown is a laboratory estimate.

B: Analyte was found in the associated analysis batch blank. For volatiles, methylene chloride and acetone are common lab contaminants.

C = CCV-E: The value reported is estimated. The value is estimated due to its behavior during continuing calibration verification.

S = SCAL-E: The value reported is estimated. The value is estimated due to its behavior during initial calibration.

Q = QL-02: This LCS analyte is outside Laboratory Recovery limits due to the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.

ARAR's are chemical specific aquifer restoration goals for groundwater at the Former Rowe Industries Superfund Site.

NE indicates that the ARAR goal was not established for this compound by the EPA.


Bold values indicate an exceedance of the ARAR standard established for the site.

^{1/} In September 2016, the EPA granted approval to discontinue groundwater sampling at RW-1, RW-5, RW-7, RW-8 and RW-9.

GRAPHS


GRAPH 1
GROUNDWATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

Effluent Flow Data
(March 1, 2021 to March 31, 2021)

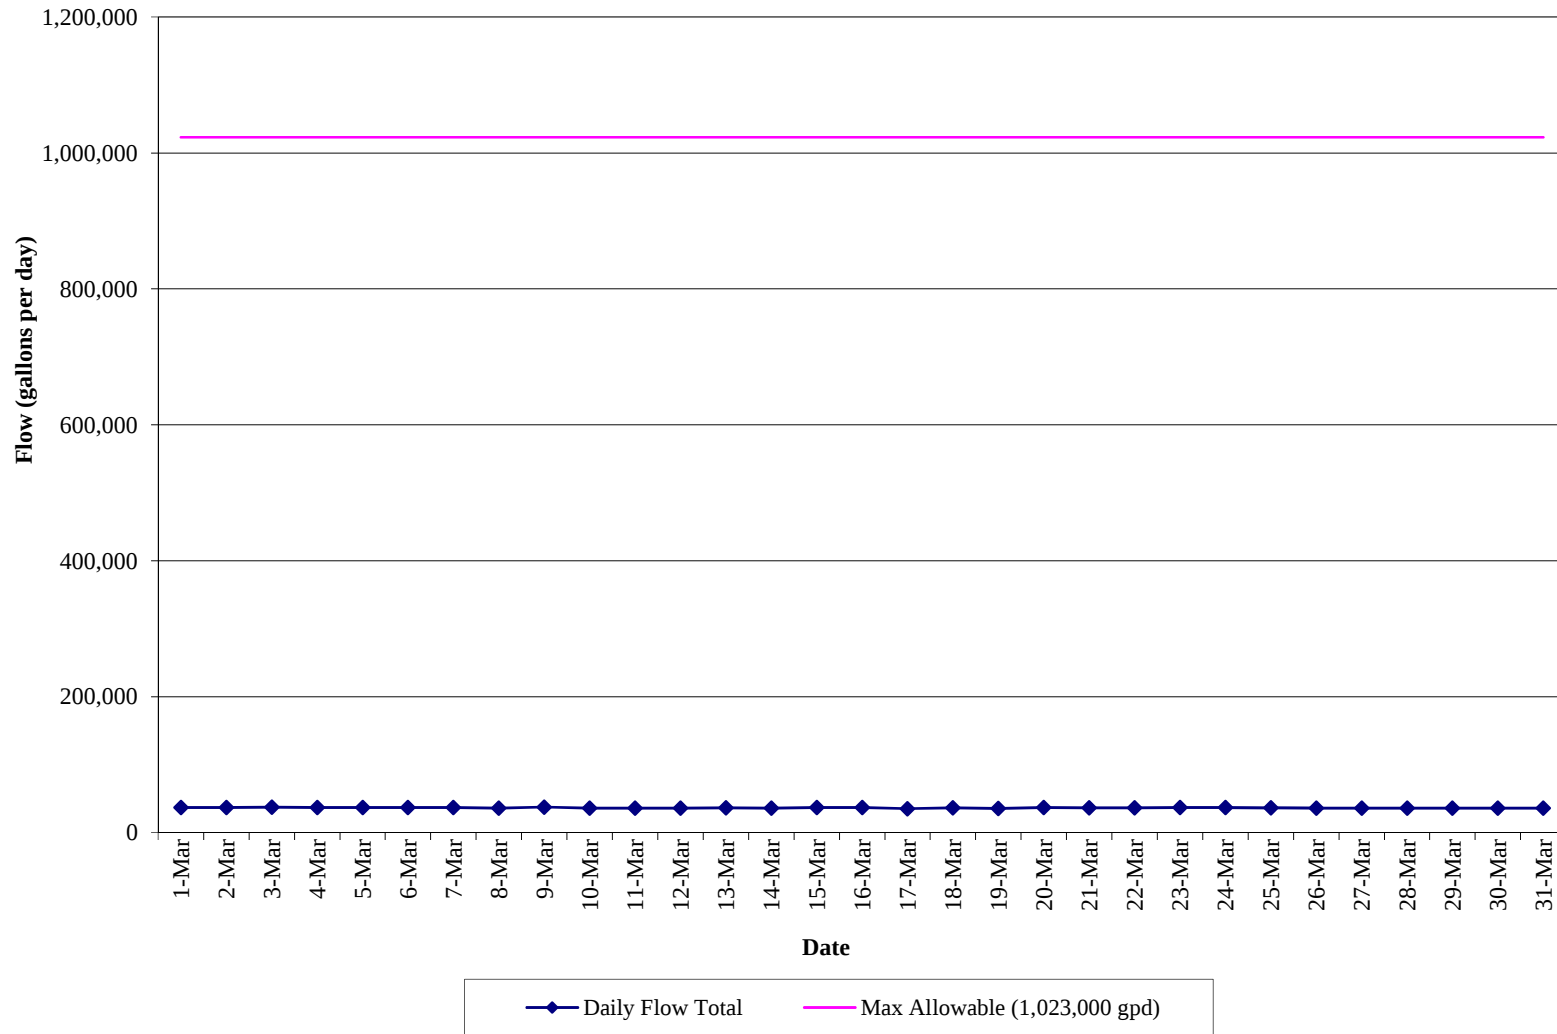

GRAPH 2
GROUNDWATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

FSP&T System Cumulative VOC Recovery and Influent PCE Concentrations vs. Time

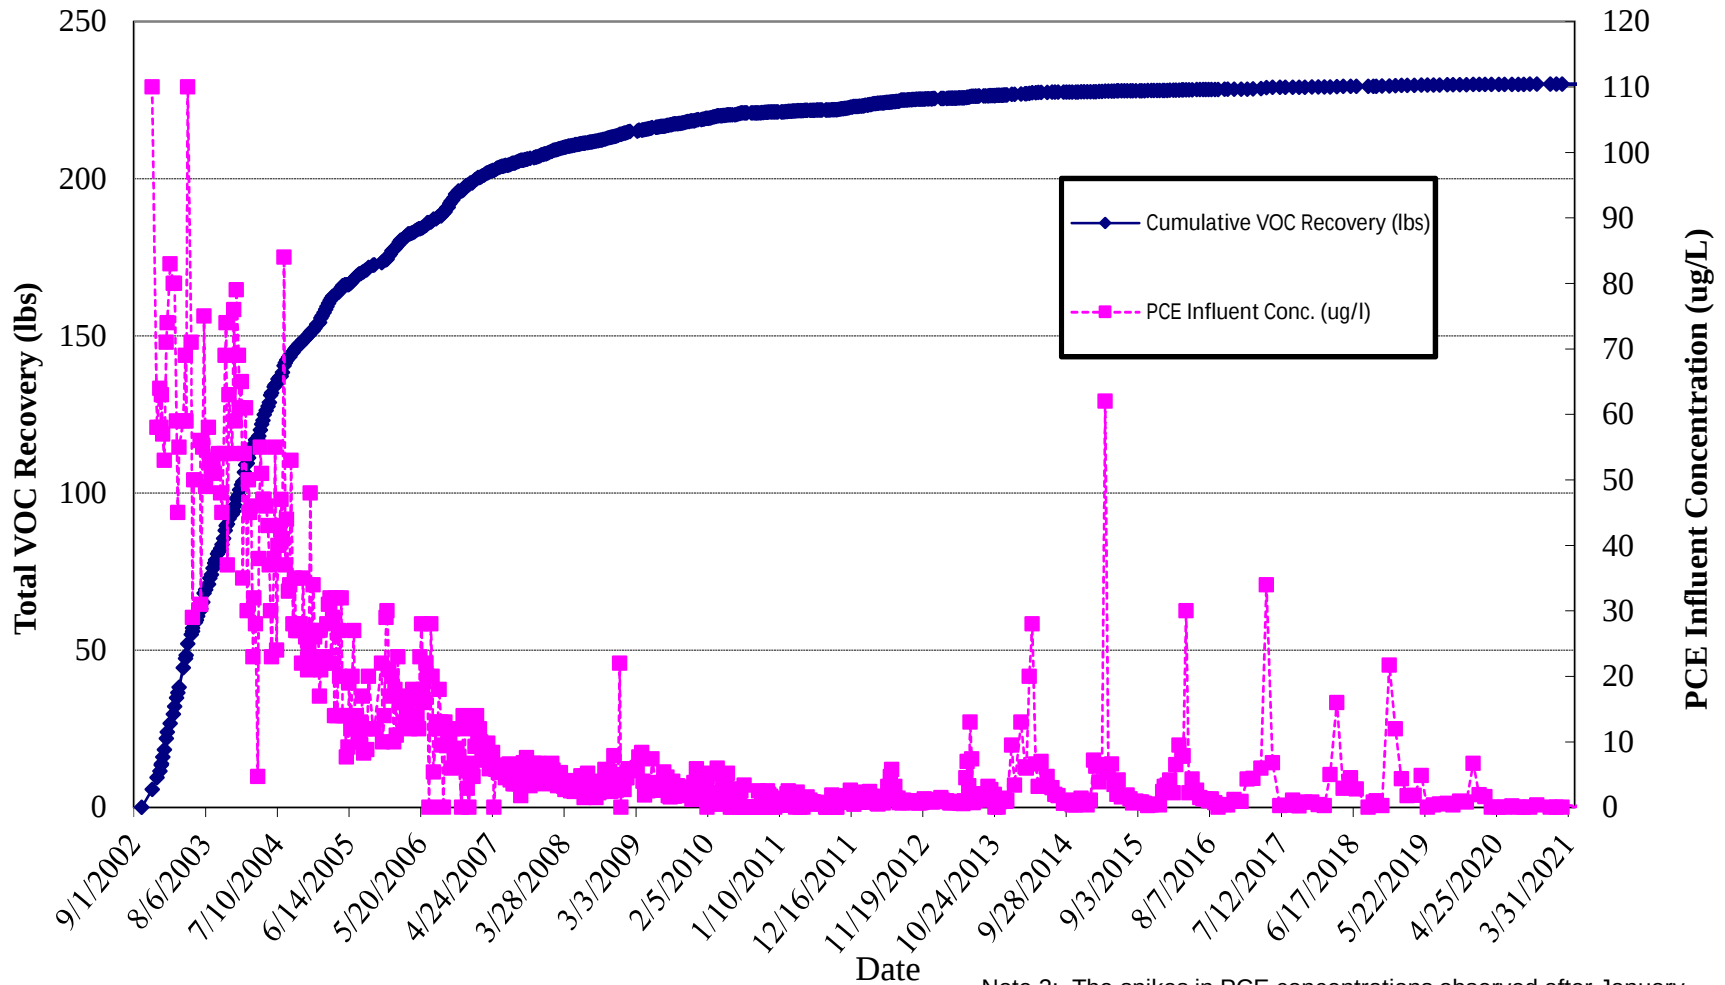


Note 1 : After September 22, 2008, the water recovered from the FP&T System is included in the results shown in this graph.

Note 2: The spikes in PCE concentrations observed after January 2014 coincide with well rehabilitation and annual maintenance events. During well rehabilitation and annual maintenance work, FSP&T system samples are collected when water from the FP&T system is not diluted with water extracted from RW-2.

GRAPH 3 **GROUNDWATER REMEDIAL ACTION** **ROWE INDUSTRIES SUPERFUND SITE** **SAG HARBOR, NEW YORK**

FSP&T Recovery Well PCE Concentration

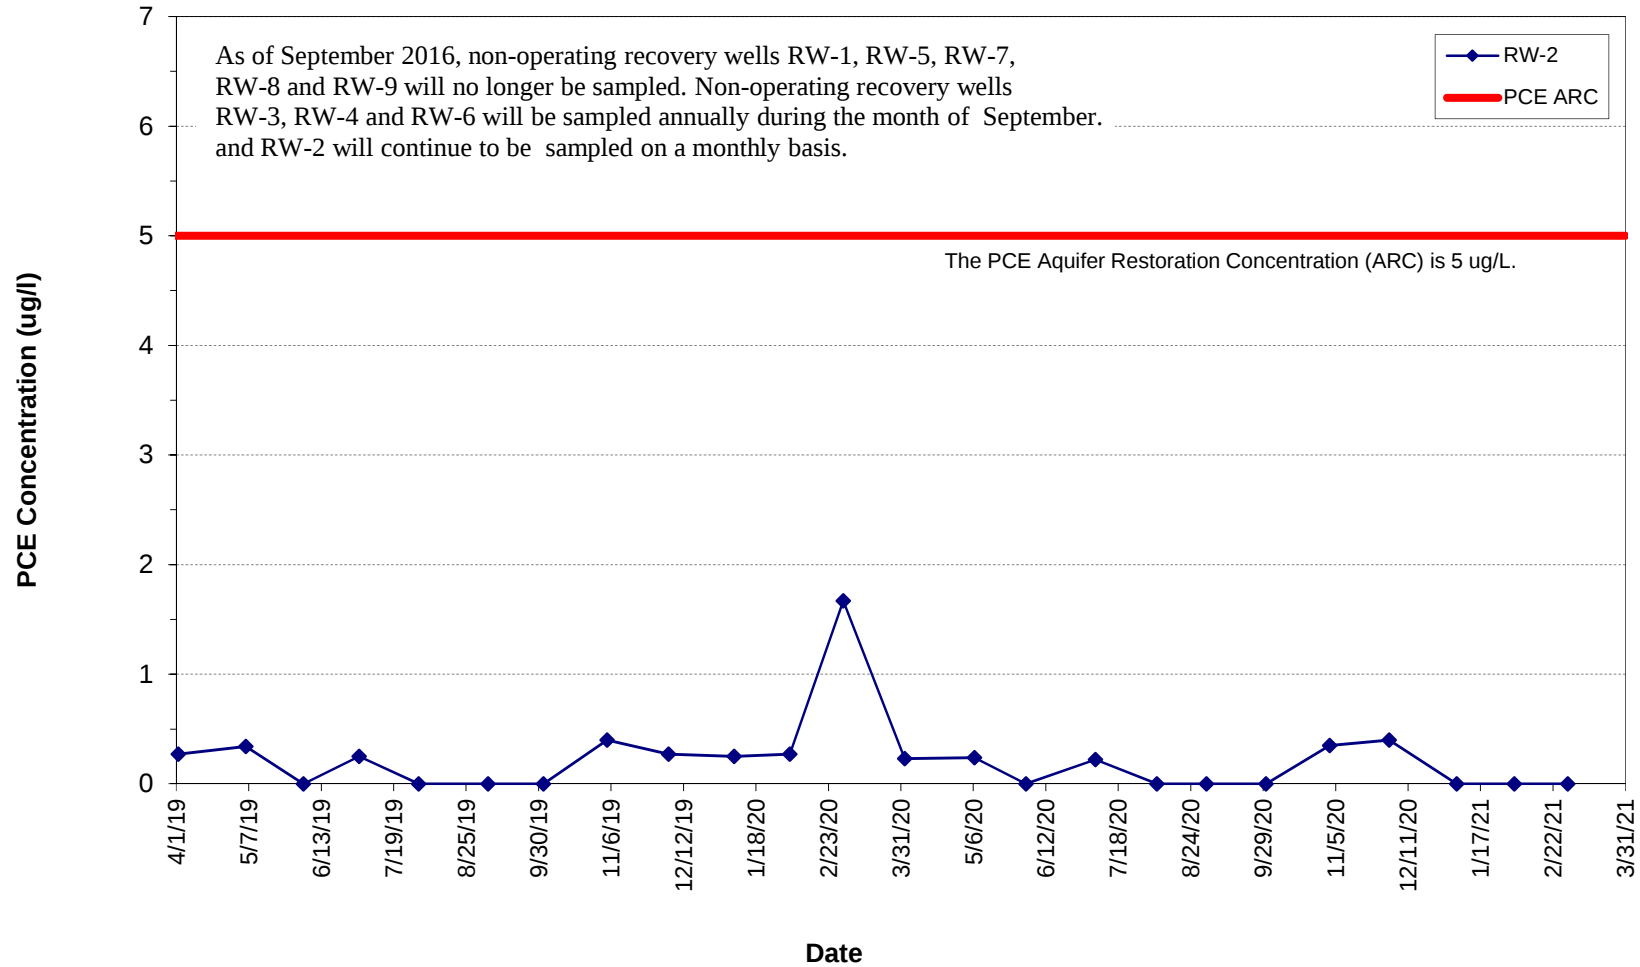

APPENDIX I
MARCH 2021 LABORATORY ANALYTICAL REPORT
FOR FSP&T SYSTEM AND RW-2



Technical Report

prepared for:

WSP USA, Inc. (Shelton)
4 Research Drive, Suite 204
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Report Date: 04/21/2021
Client Project ID: 31401451.000 Task 01.00 Rowe Industries
York Project (SDG) No.: 21C0092

Revision No. 1.0

CT Cert. No. PH-0723

New Jersey Cert. No. CT005 and NY037



New York Cert. Nos. 10854 and 12058

PA Cert. No. 68-04440

120 RESEARCH DRIVE
www.YORKLAB.com

STRATFORD, CT 06615
(203) 325-1371

132-02 89th AVENUE
FAX (203) 357-0166

RICHMOND HILL, NY 11418
ClientServices@yorklab.com

Report Date: 04/21/2021
Client Project ID: 31401451.000 Task 01.00 Rowe Industries
York Project (SDG) No.: 21C0092

WSP USA, Inc. (Shelton)
4 Research Drive, Suite 204
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on March 02, 2021 and listed below. The project was identified as your project: **31401451.000 Task 01.00 Rowe Industries**.

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Sample and Analysis Qualifiers section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the Sample and Data Qualifiers Relating to This Work Order section of this report and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
21C0092-01	WQ030221:0815 NP1-1-2	Water	03/02/2021	03/02/2021
21C0092-02	WQ030221:0830 NP2-10	Water	03/02/2021	03/02/2021

General Notes for York Project (SDG) No.: 21C0092

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All analyses conducted met method or Laboratory SOP requirements. See the Sample and Data Qualifiers Section for further information.
6. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
7. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.
8. Analyses conducted at York Analytical Laboratories, Inc. Stratford, CT are indicated by NY Cert. No. 10854; those conducted at York Analytical Laboratories, Inc., Richmond Hill, NY are indicated by NY Cert. No. 12058.

Approved By:



Benjamin Gulizia
Laboratory Director

Date: 04/21/2021





Sample Information

Client Sample ID: WQ030221:0815 NP1-1-2

York Sample ID: 21C0092-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

21C0092

31401451.000 Task 01.00 Rowe Industries

Water

March 2, 2021 8:15 am

03/02/2021


Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
75-34-3	1,1-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP	03/03/2021 12:30	03/04/2021 01:54	NRT
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
106-93-4	1,2-Dibromoethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
107-06-2	1,2-Dichloroethane	0.750		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
78-87-5	1,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
142-28-9	1,3-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
594-20-7	2,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT



Sample Information

Client Sample ID: WQ030221:0815 NP1-1-2

York Sample ID: 21C0092-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

21C0092

31401451.000 Task 01.00 Rowe Industries

Water

March 2, 2021 8:15 am

03/02/2021

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
95-49-8	2-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
591-78-6	2-Hexanone	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
106-43-4	4-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
67-64-1	Acetone	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
71-43-2	Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
108-86-1	Bromobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
74-97-5	Bromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
75-27-4	Bromodichloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
75-25-2	Bromoform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
74-83-9	Bromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
56-23-5	Carbon tetrachloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
108-90-7	Chlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
75-00-3	Chloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
67-66-3	Chloroform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
74-87-3	Chloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
156-59-2	cis-1,2-Dichloroethylene	0.200		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
124-48-1	Dibromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
74-95-3	Dibromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
100-41-4	Ethyl Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
87-68-3	Hexachlorobutadiene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT
98-82-8	Isopropylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 01:54	NRT



Sample Information

Client Sample ID: WQ030221:0815 NP1-1-2

York Sample ID: 21C0092-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

21C0092

31401451.000 Task 01.00 Rowe Industries

Water

March 2, 2021 8:15 am

03/02/2021


Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
75-09-2	Methylene chloride	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
91-20-3	Naphthalene	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
104-51-8	n-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
103-65-1	n-Propylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
95-47-6	o-Xylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
179601-23-1	p- & m- Xylenes	ND		ug/L	0.500	1.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
99-87-6	p-Isopropyltoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
135-98-8	sec-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
100-42-5	Styrene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
98-06-6	tert-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
127-18-4	Tetrachloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
108-88-3	Toluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
79-01-6	Trichloroethylene	0.360		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
75-69-4	Trichlorofluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
75-01-4	Vinyl Chloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 01:54	NRT
1330-20-7	Xylenes, Total	ND		ug/L	0.600	1.50	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP	03/03/2021 12:30	03/04/2021 01:54	NRT
Surrogate Recoveries		Result	Acceptance Range								
17060-07-0	Surrogate: SURRE: 1,2-Dichloroethane-d4	110 %	69-130								
2037-26-5	Surrogate: SURRE: Toluene-d8	103 %	81-117								
460-00-4	Surrogate: SURRE: p-Bromofluorobenzene	107 %	79-122								



Sample Information

Client Sample ID: WQ030221:0830 NP2-10

York Sample ID: 21C0092-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

21C0092

31401451.000 Task 01.00 Rowe Industries

Water

March 2, 2021 8:30 am

03/02/2021

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
75-34-3	1,1-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP	03/03/2021 12:30	03/04/2021 02:20	NRT
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
106-93-4	1,2-Dibromoethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
107-06-2	1,2-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
78-87-5	1,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
142-28-9	1,3-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
594-20-7	2,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
95-49-8	2-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT



Sample Information

Client Sample ID: WQ030221:0830 NP2-10

York Sample ID: 21C0092-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

21C0092

31401451.000 Task 01.00 Rowe Industries

Water

March 2, 2021 8:30 am

03/02/2021


Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
591-78-6	2-Hexanone	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
106-43-4	4-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
67-64-1	Acetone	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
71-43-2	Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
108-86-1	Bromobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
74-97-5	Bromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
75-27-4	Bromodichloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
75-25-2	Bromoform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
74-83-9	Bromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
56-23-5	Carbon tetrachloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
108-90-7	Chlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
75-00-3	Chloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
67-66-3	Chloroform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
74-87-3	Chloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
124-48-1	Dibromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
74-95-3	Dibromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
100-41-4	Ethyl Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
87-68-3	Hexachlorobutadiene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
98-82-8	Isopropylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications:	03/03/2021 12:30 CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/04/2021 02:20	NRT



Sample Information

Client Sample ID: WQ030221:0830 NP2-10

York Sample ID: 21C0092-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

21C0092

31401451.000 Task 01.00 Rowe Industries

Water

March 2, 2021 8:30 am

03/02/2021

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
75-09-2	Methylene chloride	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
91-20-3	Naphthalene	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
104-51-8	n-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
103-65-1	n-Propylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
95-47-6	o-Xylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
179601-23-1	p- & m- Xylenes	ND		ug/L	0.500	1.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
99-87-6	p-Isopropyltoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
135-98-8	sec-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
100-42-5	Styrene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
98-06-6	tert-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
127-18-4	Tetrachloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
108-88-3	Toluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
79-01-6	Trichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
75-69-4	Trichlorofluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
75-01-4	Vinyl Chloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/03/2021 12:30	03/04/2021 02:20	NRT
1330-20-7	Xylenes, Total	ND		ug/L	0.600	1.50	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP	03/03/2021 12:30	03/04/2021 02:20	NRT
Surrogate Recoveries		Result	Acceptance Range								
17060-07-0	Surrogate: SURR: 1,2-Dichloroethane-d4	112 %	69-130								
2037-26-5	Surrogate: SURR: Toluene-d8	102 %	81-117								
460-00-4	Surrogate: SURR: p-Bromofluorobenzene	109 %	79-122								

Total Dissolved Solids

Log-in Notes:

Sample Notes:



Sample Information

Client Sample ID: WQ030221:0830 NP2-10

York Sample ID: 21C0092-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

21C0092

31401451.000 Task 01.00 Rowe Industries

Water

March 2, 2021 8:30 am

03/02/2021

Sample Prepared by Method: % Solids Prep

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
	Total Dissolved Solids	158		mg/L	10.0	1	SM 2540C	03/03/2021 18:34	03/03/2021 18:34	AA
							Certifications:	NELAC-NY10854,CTDOH,NJDEP,PADEP		



Analytical Batch Summary

Batch ID: BC10216

Preparation Method: EPA 5030B

Prepared By: LM

YORK Sample ID	Client Sample ID	Preparation Date
21C0092-01	WQ030221:0815 NP1-1-2	03/03/21
21C0092-02	WQ030221:0830 NP2-10	03/03/21
BC10216-BLK1	Blank	03/03/21
BC10216-BS1	LCS	03/03/21
BC10216-BSD1	LCS Dup	03/03/21

Batch ID: BC10231

Preparation Method: % Solids Prep

Prepared By: AA

YORK Sample ID	Client Sample ID	Preparation Date
21C0092-02	WQ030221:0830 NP2-10	03/03/21
BC10231-BLK1	Blank	03/03/21
BC10231-DUP1	Duplicate	03/03/21
BC10231-DUP2	Duplicate	03/03/21



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BC10216 - EPA 5030B											
Blank (BC10216-BLK1)										Prepared & Analyzed: 03/03/2021	
1,1,1,2-Tetrachloroethane	ND	0.500	ug/L								
1,1,1-Trichloroethane	ND	0.500	"								
1,1,2,2-Tetrachloroethane	ND	0.500	"								
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.500	"								
1,1,2-Trichloroethane	ND	0.500	"								
1,1-Dichloroethane	ND	0.500	"								
1,1-Dichloroethylene	ND	0.500	"								
1,1-Dichloropropylene	ND	0.500	"								
1,2,3-Trichlorobenzene	ND	0.500	"								
1,2,3-Trichloropropane	ND	0.500	"								
1,2,4-Trichlorobenzene	ND	0.500	"								
1,2,4-Trimethylbenzene	ND	0.500	"								
1,2-Dibromo-3-chloropropane	ND	0.500	"								
1,2-Dibromoethane	ND	0.500	"								
1,2-Dichlorobenzene	ND	0.500	"								
1,2-Dichloroethane	ND	0.500	"								
1,2-Dichloropropane	ND	0.500	"								
1,3,5-Trimethylbenzene	ND	0.500	"								
1,3-Dichlorobenzene	ND	0.500	"								
1,3-Dichloropropane	ND	0.500	"								
1,4-Dichlorobenzene	ND	0.500	"								
2,2-Dichloropropane	ND	0.500	"								
2-Chlorotoluene	ND	0.500	"								
2-Hexanone	ND	0.500	"								
4-Chlorotoluene	ND	0.500	"								
Acetone	ND	2.00	"								
Benzene	ND	0.500	"								
Bromobenzene	ND	0.500	"								
Bromochloromethane	ND	0.500	"								
Bromodichloromethane	ND	0.500	"								
Bromoform	ND	0.500	"								
Bromomethane	ND	0.500	"								
Carbon tetrachloride	ND	0.500	"								
Chlorobenzene	ND	0.500	"								
Chloroethane	ND	0.500	"								
Chloroform	ND	0.500	"								
Chloromethane	ND	0.500	"								
cis-1,2-Dichloroethylene	ND	0.500	"								
cis-1,3-Dichloropropylene	ND	0.500	"								
Dibromochloromethane	ND	0.500	"								
Dibromomethane	ND	0.500	"								
Dichlorodifluoromethane	ND	0.500	"								
Ethyl Benzene	ND	0.500	"								
Hexachlorobutadiene	ND	0.500	"								
Isopropylbenzene	ND	0.500	"								
Methyl tert-butyl ether (MTBE)	ND	0.500	"								
Methylene chloride	ND	2.00	"								
Naphthalene	ND	2.00	"								
n-Butylbenzene	ND	0.500	"								



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BC10216 - EPA 5030B											
Blank (BC10216-BLK1)											
Prepared & Analyzed: 03/03/2021											
n-Propylbenzene	ND	0.500	ug/L								
o-Xylene	ND	0.500	"								
p- & m- Xylenes	ND	1.00	"								
p-Isopropyltoluene	ND	0.500	"								
sec-Butylbenzene	ND	0.500	"								
Styrene	ND	0.500	"								
tert-Butylbenzene	ND	0.500	"								
Tetrachloroethylene	ND	0.500	"								
Toluene	ND	0.500	"								
trans-1,2-Dichloroethylene	ND	0.500	"								
trans-1,3-Dichloropropylene	ND	0.500	"								
Trichloroethylene	ND	0.500	"								
Trichlorofluoromethane	ND	0.500	"								
Vinyl Chloride	ND	0.500	"								
Xylenes, Total	ND	1.50	"								
Surrogate: SURR: 1,2-Dichloroethane-d4	10.5		"	10.0		105	69-130				
Surrogate: SURR: Toluene-d8	10.3		"	10.0		103	81-117				
Surrogate: SURR: p-Bromofluorobenzene	11.0		"	10.0		110	79-122				
LCS (BC10216-BS1)											
Prepared & Analyzed: 03/03/2021											
1,1,1,2-Tetrachloroethane	9.78		ug/L	10.0		97.8	82-126				
1,1,1-Trichloroethane	10.6		"	10.0		106	78-136				
1,1,2,2-Tetrachloroethane	10.7		"	10.0		107	76-129				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	11.9		"	10.0		119	54-165				
1,1,2-Trichloroethane	9.94		"	10.0		99.4	82-123				
1,1-Dichloroethane	10.3		"	10.0		103	82-129				
1,1-Dichloroethylene	11.6		"	10.0		116	68-138				
1,1-Dichloropropylene	10.6		"	10.0		106	83-133				
1,2,3-Trichlorobenzene	10.5		"	10.0		105	76-136				
1,2,3-Trichloropropane	9.89		"	10.0		98.9	77-128				
1,2,4-Trichlorobenzene	11.3		"	10.0		113	76-137				
1,2,4-Trimethylbenzene	10.6		"	10.0		106	82-132				
1,2-Dibromo-3-chloropropane	7.30		"	10.0		73.0	45-147				
1,2-Dibromoethane	10.1		"	10.0		101	83-124				
1,2-Dichlorobenzene	10.3		"	10.0		103	79-123				
1,2-Dichloroethane	10.6		"	10.0		106	73-132				
1,2-Dichloropropane	9.95		"	10.0		99.5	78-126				
1,3,5-Trimethylbenzene	10.5		"	10.0		105	80-131				
1,3-Dichlorobenzene	10.2		"	10.0		102	86-122				
1,3-Dichloropropane	10.1		"	10.0		101	81-125				
1,4-Dichlorobenzene	10.2		"	10.0		102	85-124				
2,2-Dichloropropane	9.79		"	10.0		97.9	56-150				
2-Chlorotoluene	10.2		"	10.0		102	79-130				
2-Hexanone	9.24		"	10.0		92.4	51-146				
4-Chlorotoluene	10.2		"	10.0		102	79-128				
Acetone	8.65		"	10.0		86.5	14-150				
Benzene	10.4		"	10.0		104	85-126				
Bromobenzene	10.2		"	10.0		102	78-129				
Bromochloromethane	10.8		"	10.0		108	77-128				
Bromodichloromethane	9.73		"	10.0		97.3	79-128				



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	--------------------	-------	----------------	-------------------	------	----------------	------	-----	--------------	------

Batch BC10216 - EPA 5030B

LCS (BC10216-BS1)

Prepared & Analyzed: 03/03/2021

Bromoform	7.44		ug/L	10.0		74.4	78-133	Low Bias			
Bromomethane	7.12		"	10.0		71.2	43-168				
Carbon tetrachloride	10.2		"	10.0		102	77-141				
Chlorobenzene	10.1		"	10.0		101	88-120				
Chloroethane	11.0		"	10.0		110	65-136				
Chloroform	10.4		"	10.0		104	82-128				
Chloromethane	9.28		"	10.0		92.8	43-155				
cis-1,2-Dichloroethylene	10.4		"	10.0		104	83-129				
cis-1,3-Dichloropropylene	9.96		"	10.0		99.6	80-131				
Dibromochloromethane	8.72		"	10.0		87.2	80-130				
Dibromomethane	9.79		"	10.0		97.9	72-134				
Dichlorodifluoromethane	10.9		"	10.0		109	44-144				
Ethyl Benzene	10.3		"	10.0		103	80-131				
Hexachlorobutadiene	14.2		"	10.0		142	67-146				
Isopropylbenzene	9.86		"	10.0		98.6	76-140				
Methyl tert-butyl ether (MTBE)	10.3		"	10.0		103	76-135				
Methylene chloride	10.7		"	10.0		107	55-137				
Naphthalene	10.2		"	10.0		102	70-147				
n-Butylbenzene	12.7		"	10.0		127	79-132				
n-Propylbenzene	10.0		"	10.0		100	78-133				
o-Xylene	10.2		"	10.0		102	78-130				
p- & m- Xylenes	20.6		"	20.0		103	77-133				
p-Isopropyltoluene	11.2		"	10.0		112	81-136				
sec-Butylbenzene	10.9		"	10.0		109	79-137				
Styrene	10.5		"	10.0		105	67-132				
tert-Butylbenzene	9.26		"	10.0		92.6	77-138				
Tetrachloroethylene	8.28		"	10.0		82.8	82-131				
Toluene	10.3		"	10.0		103	80-127				
trans-1,2-Dichloroethylene	11.2		"	10.0		112	80-132				
trans-1,3-Dichloropropylene	9.88		"	10.0		98.8	78-131				
Trichloroethylene	10.4		"	10.0		104	82-128				
Trichlorofluoromethane	10.6		"	10.0		106	67-139				
Vinyl Chloride	11.0		"	10.0		110	58-145				
Surrogate: SURR: 1,2-Dichloroethane-d4	10.8		"	10.0		108	69-130				
Surrogate: SURR: Toluene-d8	10.2		"	10.0		102	81-117				
Surrogate: SURR: p-Bromofluorobenzene	9.79		"	10.0		97.9	79-122				



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BC10216 - EPA 5030B											
LCS Dup (BC10216-BSD1)						Prepared & Analyzed: 03/03/2021					
1,1,1,2-Tetrachloroethane	9.43		ug/L	10.0		94.3	82-126		3.64	30	
1,1,1-Trichloroethane	9.93		"	10.0		99.3	78-136		6.81	30	
1,1,2,2-Tetrachloroethane	10.3		"	10.0		103	76-129		3.99	30	
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	11.1		"	10.0		111	54-165		6.79	30	
1,1,2-Trichloroethane	9.53		"	10.0		95.3	82-123		4.21	30	
1,1-Dichloroethane	9.73		"	10.0		97.3	82-129		5.69	30	
1,1-Dichloroethylene	10.7		"	10.0		107	68-138		7.45	30	
1,1-Dichloropropylene	9.90		"	10.0		99.0	83-133		6.73	30	
1,2,3-Trichlorobenzene	10.4		"	10.0		104	76-136		0.575	30	
1,2,3-Trichloropropane	9.86		"	10.0		98.6	77-128		0.304	30	
1,2,4-Trichlorobenzene	10.9		"	10.0		109	76-137		3.87	30	
1,2,4-Trimethylbenzene	10.2		"	10.0		102	82-132		3.56	30	
1,2-Dibromo-3-chloropropane	6.96		"	10.0		69.6	45-147		4.77	30	
1,2-Dibromoethane	9.79		"	10.0		97.9	83-124		2.72	30	
1,2-Dichlorobenzene	10.1		"	10.0		101	79-123		1.77	30	
1,2-Dichloroethane	10.2		"	10.0		102	73-132		3.56	30	
1,2-Dichloropropane	9.56		"	10.0		95.6	78-126		4.00	30	
1,3,5-Trimethylbenzene	10.0		"	10.0		100	80-131		4.48	30	
1,3-Dichlorobenzene	9.88		"	10.0		98.8	86-122		3.38	30	
1,3-Dichloropropane	9.59		"	10.0		95.9	81-125		4.78	30	
1,4-Dichlorobenzene	9.91		"	10.0		99.1	85-124		2.79	30	
2,2-Dichloropropane	9.07		"	10.0		90.7	56-150		7.64	30	
2-Chlorotoluene	9.81		"	10.0		98.1	79-130		4.19	30	
2-Hexanone	8.96		"	10.0		89.6	51-146		3.08	30	
4-Chlorotoluene	9.73		"	10.0		97.3	79-128		4.42	30	
Acetone	8.12		"	10.0		81.2	14-150		6.32	30	
Benzene	9.83		"	10.0		98.3	85-126		6.11	30	
Bromobenzene	9.83		"	10.0		98.3	78-129		3.89	30	
Bromochloromethane	10.3		"	10.0		103	77-128		4.94	30	
Bromodichloromethane	9.35		"	10.0		93.5	79-128		3.98	30	
Bromoform	7.24		"	10.0		72.4	78-133	Low Bias	2.72	30	
Bromomethane	7.25		"	10.0		72.5	43-168		1.81	30	
Carbon tetrachloride	9.40		"	10.0		94.0	77-141		7.87	30	
Chlorobenzene	9.68		"	10.0		96.8	88-120		4.44	30	
Chloroethane	10.4		"	10.0		104	65-136		5.61	30	
Chloroform	9.77		"	10.0		97.7	82-128		5.96	30	
Chloromethane	8.74		"	10.0		87.4	43-155		5.99	30	
cis-1,2-Dichloroethylene	9.83		"	10.0		98.3	83-129		6.11	30	
cis-1,3-Dichloropropylene	9.56		"	10.0		95.6	80-131		4.10	30	
Dibromochloromethane	8.29		"	10.0		82.9	80-130		5.06	30	
Dibromomethane	9.56		"	10.0		95.6	72-134		2.38	30	
Dichlorodifluoromethane	10.0		"	10.0		100	44-144		7.75	30	
Ethyl Benzene	9.68		"	10.0		96.8	80-131		5.82	30	
Hexachlorobutadiene	14.0		"	10.0		140	67-146		1.42	30	
Isopropylbenzene	9.43		"	10.0		94.3	76-140		4.46	30	
Methyl tert-butyl ether (MTBE)	9.83		"	10.0		98.3	76-135		4.96	30	
Methylene chloride	10.4		"	10.0		104	55-137		2.65	30	
Naphthalene	9.98		"	10.0		99.8	70-147		1.89	30	
n-Butylbenzene	12.2		"	10.0		122	79-132		4.26	30	
n-Propylbenzene	9.64		"	10.0		96.4	78-133		3.97	30	



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	--------------------	-------	----------------	-------------------	------	----------------	------	-----	--------------	------

Batch BC10216 - EPA 5030B

LCS Dup (BC10216-BSD1)

Prepared & Analyzed: 03/03/2021

o-Xylene	9.64		ug/L	10.0		96.4	78-130		5.15	30	
p- & m- Xylenes	19.4		"	20.0		97.0	77-133		6.00	30	
p-Isopropyltoluene	10.8		"	10.0		108	81-136		4.19	30	
sec-Butylbenzene	10.5		"	10.0		105	79-137		4.11	30	
Styrene	10.0		"	10.0		100	67-132		4.76	30	
tert-Butylbenzene	8.88		"	10.0		88.8	77-138		4.19	30	
Tetrachloroethylene	7.86		"	10.0		78.6	82-131	Low Bias	5.20	30	
Toluene	9.80		"	10.0		98.0	80-127		4.88	30	
trans-1,2-Dichloroethylene	10.5		"	10.0		105	80-132		6.43	30	
trans-1,3-Dichloropropylene	9.40		"	10.0		94.0	78-131		4.98	30	
Trichloroethylene	9.72		"	10.0		97.2	82-128		6.28	30	
Trichlorofluoromethane	9.84		"	10.0		98.4	67-139		7.53	30	
Vinyl Chloride	10.3		"	10.0		103	58-145		6.19	30	
Surrogate: SURR: 1,2-Dichloroethane-d4	10.6		"	10.0		106	69-130				
Surrogate: SURR: Toluene-d8	10.1		"	10.0		101	81-117				
Surrogate: SURR: p-Bromofluorobenzene	9.90		"	10.0		99.0	79-122				



Miscellaneous Physical Parameters - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	--------------------	-------	----------------	-------------------	------	----------------	------	-----	--------------	------

Batch BC10231 - % Solids Prep

Blank (BC10231-BLK1)

Prepared & Analyzed: 03/03/2021

Total Dissolved Solids ND 10.0 mg/L

Duplicate (BC10231-DUP1)

*Source sample: 21C0047-01 (Duplicate)

Prepared & Analyzed: 03/03/2021

Total Dissolved Solids 390 10.0 mg/L 384 1.55 15

Duplicate (BC10231-DUP2)

*Source sample: 21C0100-01 (Duplicate)

Prepared & Analyzed: 03/03/2021

Total Dissolved Solids 198 10.0 mg/L 191 3.60 15



Volatile Analysis Sample Containers

Lab ID	Client Sample ID	Volatile Sample Container
21C0092-01	WQ030221:0815 NP1-1-2	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C
21C0092-02	WQ030221:0830 NP2-10	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C



Sample and Data Qualifiers Relating to This Work Order

QL-02	This LCS analyte is outside Laboratory Recovery limits due the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.
ICV-E	The value reported is ESTIMATED. The value is estimated due to its behavior during initial calibration verification (recovery exceeded 30% of expected value).
CCV-E	The value reported is ESTIMATED. The value is estimated due to its behavior during continuing calibration verification (>20% Difference for average Rf or >20% Drift for quadratic fit).

Definitions and Other Explanations

*	Analyte is not certified or the state of the samples origination does not offer certification for the Analyte.
ND	NOT DETECTED - the analyte is not detected at the Reported to level (LOQ/RL or LOD/MDL)
RL	REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.
LOQ	LIMIT OF QUANTITATION - the minimum concentration of a target analyte that can be reported within a specified degree of confidence. This is the lowest point in an analyte calibration curve that has been subjected to all steps of the processing/analysis and verified to meet defined criteria. This is based upon NELAC 2009 Standards and applies to all analyses.
LOD	LIMIT OF DETECTION - a verified estimate of the minimum concentration of a substance in a given matrix that an analytical process can reliably detect. This is based upon NELAC 2009 Standards and applies to all analyses conducted under the auspices of EPA SW-846.
MDL	METHOD DETECTION LIMIT - a statistically derived estimate of the minimum amount of a substance an analytical system can reliably detect with a 99% confidence that the concentration of the substance is greater than zero. This is based upon 40 CFR Part 136 Appendix B and applies only to EPA 600 and 200 series methods.
Reported to	This indicates that the data for a particular analysis is reported to either the LOD/MDL, or the LOQ/RL. In cases where the "Reported to" is located above the LOD/MDL, any value between this and the LOQ represents an estimated value which is "J" flagged accordingly. This applies to volatile and semi-volatile target compounds only.
NR	Not reported
RPD	Relative Percent Difference
Wet	The data has been reported on an as-received (wet weight) basis
Low Bias	Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
High Bias	High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
Non-Dir.	Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.


If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two. For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the LOD/MDL, with values between the LOD/MDL and the LOQ being "J" flagged as estimated results.



For analyses by EPA SW-846-8270D, the Limit of Quantitation (LOQ) reported for benzidine is based upon the lowest standard used for calibration and is not a verified LOQ due to this compound's propensity for oxidative losses during extraction/concentration procedures and non-reproducible chromatographic performance.

Revision Description: This report has been revised to switch Sample IDs and attach a new Chain of Custody.





www.yorklab.com

NOTE: YORK's Standard Terms & Conditions are listed on the back side of this document.
This document serves as your written authorization for YORK to proceed with the analyses requested below.
Your signature binds you to YORK's Standard Terms & Conditions.

Page 1 of 1

YOUR Information		Report To:		Invoice To:		YOUR Project Number		Turn-Around Time									
Company:	WSP USA	Company:	Same	Company:	WSP USA Accounting	31401451.000 Task 01.00		RUSH - Next Day									
Address:	4 Research Drive, Suite 204 Shelton, CT 06484	Address:		Address:		YOUR Project Name		RUSH - Two Day									
Phone:	203-929-8555	Phone:		Phone:		Rowe Industries		RUSH - Three Day									
Contact:	Tunde Komuves-Sandor	Contact:		Contact:				RUSH - Four Day									
E-mail:	tunde.sandor@wsp.com	E-mail:		E-mail:		YOUR PO#: 31401451.000 Task 01.00		Standard (5-7 Day) X									
Please print clearly and legibly. All information must be complete. Samples will not be logged in and the turn-around-time clock will not begin until any questions by YORK are resolved.				Matrix Codes		Samples From		Report / EDD Type (circle selections)		YORK Reg. Comp.							
Samples Collected by: (print your name above and sign below)				S - soil / solid		New York		X Summary Report		CT RCP		Standard Excel EDD		Compared to the following Regulation(s): (please fill in)			
				GW - groundwater		New Jersey				QA Report		CT RCP DQA/DUE				EQuIS (Standard)	
				DW - drinking water		Connecticut				NY ASP A Package		NJDEP Reduced Deliverables				NYSDEC EQuIS	
				WW - wastewater		Pennsylvania				NY ASP B Package						NJDEP SRP HazSite	
				O - Oil ; Other		Other						NJDQKP				Other:	
Sample Identification				Sample Matrix		Date/Time Sampled		Analysis Requested				Container Description					
WQ030221:0815 NP2-10				NP1-1-2		GW		3-2-21 8:15		VOCs 8260 full list + freon 113				3 HCl VOA			
WQ030221:0830 NP1-1-2				NP2-10		GW		3-2-21 8:30		VOCs 8260 full list + freon 113: TDS				3 HCl VOA; 1 plastic			
Edit to COC made by Mark Goldberg on April 21, 2021 after discussing with the sampler (Scott Philbrick), who indicated that labels on the sample bottles were reversed by accident.																	
Comments:								Preservation: (check all that apply)				Special Instruction					
								HCl ___ MeOH ___ HNO3 ___ H2SO4 ___ NaOH ___ ZnAc ___				Field Filtered ___					
								Ascorbic Acid ___ Other: ___				Lab to Filter ___					
Samples Relinquished by / Company		Date/Time		Samples Received by / Company		Date/Time		Samples Relinquished by / Company		Date/Time							
[Signature] WSP		3-2-21 1420															
Samples Received by / Company		Date/Time		Samples Relinquished by / Company		Date/Time		Samples Received by / Company		Date/Time							
Samples Relinquished by / Company		Date/Time		Samples Received by / Company		Date/Time		Samples Received in LAB by		Date/Time		Temp. Received at Lab					
								[Signature]		3/2/21 1420		3.0 Degrees C					