



PROJECT STATUS MEMORANDUM

TO: Pamela Tames, USEPA

FROM: Mark M. Goldberg, P.E.
Tunde H. Komuves-Sandor, PG, CPG

SUBJECT: Rowe Industries Superfund Site
NYS Site ID No. 152106
Groundwater Recovery and Treatment System
DRAFT April 2021 Status Report

DATE: June 4, 2021

WSP USA (WSP) commenced operation of the Full-Scale Pump and Treat (FSP&T) groundwater remediation system at the above-referenced site on December 17, 2002. Starting in September 2008, the groundwater recovered by the Focus Pump and Treat (FP&T) system was routed to the FSP&T system for treatment. As of 2014, the FSP&T system only treats water extracted from RW-2; the other FSP&T recovery wells (RW-1, 3, 4, 5, 6, 7, 8, and 9) have been shut down with USEPA approval after achieving remediation standards. In February 2020, the FP&T system, which consists of four focused recover wells (FRW-1, FRW-2, FRW-3 and FRW-4), was turned off with EPA approval to conduct in-situ injection to treat contaminants in the former drum storage area (FDSA). This status report presents a summary of performance, operation and maintenance for the FSP&T system and monitoring activities for the site from April 1, 2021 through April 30, 2021. The report includes a summary of system performance parameters, system operation parameters, and analytical results for groundwater, system effluent samples and air-quality results.

SUMMARY OF SYSTEM PERFORMANCE AND OPERATION

(April 1, 2021 through April 30, 2021)

- | | |
|---|---|
| 1. Hours of operation during the reporting period: | 720 hours (100%) |
| 2. Alarm conditions during the reporting period: | None (see Table 1) |
| 3. Were the State Pollutant Discharge Elimination System (SPDES) volatile organic compounds (VOC) discharge permit criteria achieved: | Yes, (see Table 2, App. I) |
| 4. Total volume of water pumped during the reporting period: | 1,113,066 gal. |
| 5. Was the system effluent flow below the SPDES limit of 1,023,000 gpd: | Yes, (see Graph 1) |
| 6. Mass of VOCs recovered during the reporting period: | <0.01 pound (see Graph 2) |
| 7. Cumulative mass of VOCs recovered since startup on 12/17/02:
(calculations can be provided upon request) | 230.1 pounds |
| 8. Effluent VOC vapor concentration for the reporting period: | 0.02 mg/m ³ (see Table 4, App. II) |
| 9. Was the effluent VOC vapor emission rate below 0.022 lbs./hr.:
(calculations can be provided upon request) | Yes (0.00024 lbs./hr.) |



PUMP AND TREAT SYSTEM STATUS SUMMARY

As noted above, the system was in operation continuously during the month of April. WSP continued to observe the leaky flange in the booster blower duct and noisy operation of the air-stripper blower during the April site visits. Repairs for the leaky flange are scheduled during the annual O&M cleaning event scheduled for June. An air leak was observed from a manway at the top of the vapor phase carbon vessel. The manway cover appears to be corroding. During the annual O&M cleaning event, the contractor will evaluate the issue and try to repair the leak with a gasket, caulking, tape or other suitable means. The remaining O&M activities for the FSP&T system are included in Table 1.

SUMMARY OF SAMPLING ACTIVITIES

April 2021 groundwater quality sampling was completed for the following wells:

- A monthly groundwater sample was collected from RW-2 on April 5, 2021.

Table 3 presents a summary of the quality results for water samples collected from downgradient recovery well RW-2. Graph 3 presents tetrachloroethylene (PCE) concentrations for samples collected from RW-2 for the last 24 months. The laboratory analytical report for the water sample collected from the recovery well is included as Appendix I. Because RW-2 is the only well operating, the sample from that well also serves as the influent system sample.

The PCE, trichloroethylene (TCE), cis-1,2-dichloroethylene (cis-DCE), vinyl chloride (VC) and trichloroethane (TCA) concentrations in the groundwater sample collected from RW-2 were below the respective Applicable or Relevant and Appropriate Requirements (ARARs); concentrations at RW-2 have been below the ARARs for over 10 years. A groundwater sample from RW-2 will continue to be collected and analyzed monthly.

FUTURE O&M ACTIVITIES

O&M activities scheduled for May 2021 include:

- monitor air stripper main blower operation and leak at flange for booster blower air duct;
- evaluation and repair of the rear garage door; and
- normal bi-weekly/monthly O&M activities.

Attachments

cc: Brian Shuttleworth - Kraft Heinz Foods Company (as successor to Kraft Foods Group, Inc.) -.pdf
Kevin Kyrias-Gann, Ramboll -.pdf
Rebecca Spellissy, Ramboll -.pdf
Payson Long, NYSDEC -.pdf
Chief-Operation Maintenance and Support Section, NYSDEC -.pdf
Chris Engelhardt, Regional Remediation Division, R-1, NYSDEC -.pdf
Sundy Schermeyer, Town of Southampton, Town Clerk -.pdf
Mark Sergott, NYSDOH -.pdf

H:\NABIS\2021\Monthly Reports\April\Draft Status Report - April 2021.docx

TABLES

TABLE 1

**GROUNDWATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

**MAINTENANCE LOG
(April 1, 2021 through April 30, 2021)**

Date	Time	System Changes/Modifications	Personnel
4/5/21		Air-stripper main blower operation continues to operate at variable speed. Continue to monitor blower operation.	SP
		Lubricated transfer pumps with grease.	SP
		Collected a sample from RW-2 and the effluent of the system.	SP
		Observed air leak from manway at the top of the vapor phase carbon vessel. During well rehab and system cleaning, Cisco will evaluate the issue and try to repair with a gasket, caulking, tape or other suitable means.	SP
		Same leaky gasket at booster blower flange scheduled for repair during annual well rehabilitation and spring O&M event.	SP
4/22/21		Changed the multi-bag filter bags (400 um) in Banks 1 and 2, seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed. Cleaned filter baskets and housings.	SP
		Quarterly system air samples collected.	SP
		Similar observations to 4/5/21.	SP

Notes:

SP

Scott Philbrick, WSP USA

H:\NABIS\2021\Monthly Reports\April\Table 1 Maintenance Record - April 2021 .docx

TABLE 2

**GROUNDWATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

Effluent Water Quality Results

Date Sampled ^{2/}	pH ^{1/}	TDS ^{4/} (mg/l)	PCE (ug/l)	1,1,1-TCA (ug/l)	TCE (ug/l)	1,1-DCA (ug/l)	1,1-DCE (ug/l)	cis- 1,2-DCE (ug/l)	trans- 1,2-DCE (ug/l)	Xylene (ug/l)	Toluene (ug/l)	Ethyl- benzene (ug/l)	Methylene Chloride (ug/l)	Freon 113 (ug/l)	Naphthalene (ug/l)	Chloroform (ug/l)
SPDES Limits	6.5 to 8.5	---	5	5	5	5	5	5	5	5	5	5	5	---	10	7
2-Apr-20	7.0	161	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
7-May-20	7.0	299	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
2-Jun-20	6.8	174	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
7-Jul-20	7.0	125	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
7-Aug-20	6.8	178	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
1-Sep-20	6.8	145	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
1-Oct-20	6.8	148	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
2-Nov-20	7.0	889	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
2-Dec-20	7.0	105	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
5-Jan-21	7.0	206	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
3-Feb-21	6.8	139	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
2-Mar-21	6.8	158	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
5-Apr-21	6.8	205	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5

SPDES: State Pollutant Discharge Elimination System

mg/l: Milligrams per liter

ug/l: Micrograms per liter

----: Not established

J: Analyte detected below quantitation limits, value shown is a laboratory estimate.

B: Analyte was found in the associated analysis batch blank. For volatiles, methylene chloride and acetone are common lab contaminants.

ND: Not detected NA: Not Analyzed

C = CCV-E: The value reported is estimated The value is estimated due to its behavior during continuing calibration verification.

Q = QL-02: This LCS analyte is outside Laboratory Recovery limits due to the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.

NM: Not Measured

TDS: Total dissolved solids

PCE: Tetrachloroethylene

1,1,1-TCA: 1,1,1-Trichloroethane

TCE: Trichloroethene

1,1-DCA: 1,1-Dichloroethane

1,1-DCE: 1,1-Dichloroethene

cis-1,2-DCE: cis-1,2-Dichloroethene

trans-1,2,-DCE: trans-1,2-Dichloroethene

Notes:

1. Based on the SPDES criteria from an NYSDEC letter dated on May 6, 2016, the allowable pH range for the Rowe Site is between 6.5 and 8.5. The effluent pH was 6.8 on April 22, 2021.

Historic pH measurements from recovery wells indicate that natural background pH concentrations are less than 6.5.

2. "Effluent" samples were collected from sample port labeled NP2-10 unless otherwise noted.

3. Starting in October 2016, FSP&T system samples are collected monthly instead of once every two weeks. The pH of the effluent water is measured two times per month in accordance with the SPDES requirements.

TABLE 3

**GROUNDWATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

Recovery Well Water Quality Results

Recovery Well ^{1/}	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	1,1-Dichloro-ethane (ug/L)	cis-1,2-Dichloro-ethene (ug/L)	1,1-Dichloro-ethene (ug/L)	Methylene Chloride (ug/L)	Toluene (ug/L)	Benzene (ug/L)	m,p-Xylene (ug/L)	o-Xylene (ug/L)
	ARAR's	5	5	5	7	NE	5	5	5	5	NE	NE	5	5
RW-2	2-Apr-20	0.230	0.230 Q	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	7-May-20	0.240	ND<0.5	ND<0.5	0.210	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	2-Jun-20	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	7-Jul-20	0.220	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	7-Aug-20	ND<0.5	ND<0.5	ND<0.5	0.260	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	1-Sep-20	ND<0.5	0.310	ND<0.5	0.330	ND<0.5	ND<0.5	0.260	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	1-Oct-20	ND<0.5	0.330	ND<0.5	0.210	ND<0.5	ND<0.5	0.210	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	2-Nov-20	0.350	ND<0.5	ND<0.5	0.220	ND<0.5	ND<0.5	1.42	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	2-Dec-20	0.400	0.480	ND<0.5	0.230	ND<0.5	ND<0.5	0.640	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	5-Jan-21	ND<0.5	0.490	ND<0.5	ND<0.5	ND<0.5	ND<0.5	0.460	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	3-Feb-21	ND<0.5	0.380	ND<0.5	ND<0.5	ND<0.5	ND<0.5	0.270	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	2-Mar-21	ND<0.5	0.360	ND<0.5	ND<0.5	ND<0.5	ND<0.5	0.200	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5
	5-Apr-21	ND<0.5	0.310	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<1	ND<0.5

PCE: Tetrachloroethylene
MTBE: Methyl tertiary-butyl ether

TCE: Trichloroethylene
NS: Not sampled

TCA: 1,1,1-Trichloroethane

ND: Not detected

<#: Less than method detection limit

ug/L: Micrograms per liter

-: Not analyzed

J: Analyte detected below quantitation limits, value shown is a laboratory estimate.

B: Analyte was found in the associated analysis batch blank. For volatiles, methylene chloride and acetone are common lab contaminants.

C = CCV-E: The value reported is estimated. The value is estimated due to its behavior during continuing calibration verification.

S = SCAL-E: The value reported is estimated. The value is estimated due to its behavior during initial calibration.

Q = QL-02: This LCS analyte is outside Laboratory Recovery limits due to the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.

ARAR's are chemical specific aquifer restoration goals for groundwater at the Former Rowe Industries Superfund Site.

NE indicates that the ARAR goal was not established for this compound by the EPA.

Bold values indicate an exceedance of the ARAR standard established for the site.

^{1/} In September 2016, the EPA granted approval to discontinue groundwater sampling at RW-1, RW-5, RW-7, RW-8 and RW-9.

TABLE 4

**GROUNDWATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

Carbon Unit System Air Quality Results

Precarbon			Parameters (mg/m3)													TOTAL
Sample Name	Date	Time	PCE	TCE	TCA	DCA	cis-DCE	trans-DCE	Toluene	m&p-Xylenes	o-Xylene	CF	MC	EB	Freon 113	VOCs
AQ041619:1300NP4-1	4/16/2019	13:00	0.0056	0.0047	0.0011	ND	0.0010	ND	ND	ND	ND	0.0047	0.0008	ND	ND	0.03
AQ071919:1055NP4-1	7/19/2019	10:55	0.0290	0.0074	ND	ND	0.0006	ND	0.0079	0.0050	0.0017	0.0017	0.0420	0.0019	ND	0.17
AQ101519:0812NP4-1	10/15/2019	8:12	ND	ND	ND	ND	ND	ND	0.0390	0.0041	0.0014	ND	ND	0.0013	ND	0.09
AQ012120NP4-1	1/21/2020		0.0290	0.0036	0.0085	ND	0.0022	ND	0.0009	ND	ND	0.0015	0.0011	ND	ND	1.09
AQ041620:930NP4-1	4/16/2020	9:30	ND	ND	ND	ND	ND	ND	0.0006	ND	ND	ND	ND	ND	ND	0.04
AQ072120:930NP4-1	7/21/2020	9:30	0.0190	0.0009	ND	ND	0.00077	ND	0.0099	0.0035	0.0011	ND	0.0026	0.0011	ND	0.18
AQ101520:815NP4-1	10/15/2020	8:15	ND	ND	ND	ND	0.00166	ND	ND	ND	ND	ND	ND	ND	ND	0.05
AQ011521:1045NP4-1	1/15/2021	10:45	0.00059	0.00038	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.01
AQ042221:1010NP4-1	4/22/2021	10:10	0.00209	0.00377	ND	ND	0.00179	ND	ND	ND	ND	0.0021	ND	ND	ND	0.08

Postcarbon			Parameters (mg/m3)													TOTAL
Sample Name	Date	Time	PCE	TCE	TCA	DCA	cis-DCE	trans-DCE	Toluene	m&p-Xylenes	o-Xylene	CF	MC	EB	Freon 113	VOCs
AQ041619:1305NP4-3	4/16/2019	13:05	0.0031	ND	0.0009	ND	0.0030	ND	0.0210	0.0120	0.0047	0.0011	0.0045	0.0035	ND	0.10
AQ071919:1100NP4-3	7/19/2019	11:00	ND	ND	ND	ND	0.0011	ND	0.0032	0.0013	0.0006	ND	0.0037	ND	ND	0.05
AQ101519:0814NP4-3	10/15/2019	8:14	ND	ND	0.0013	ND	0.0029	ND	0.0420	0.0120	0.0040	0.0009	0.0036	0.0040	0.0013	0.13
AQ01210NP4-3	1/21/2020		ND	ND	ND	ND	0.0012	ND	ND	ND	ND	ND	0.0027	ND	ND	0.07
AQ041620:940NP4-3	4/16/2020	9:40	0.0021	0.00024	ND	ND	0.0014	ND	0.0050	0.0035	0.0009	ND	ND	0.0011	ND	0.14
AQ072120:935NP4-3	7/21/2020	9:35	0.0051	ND	ND	ND	0.00089	ND	0.0220	0.0074	0.0020	ND	0.0011	0.0023	ND	0.50
AQ101520:0822NP4-3	10/15/2020	8:22	0.0004	ND	ND	ND	ND	ND	0.0020	0.0011	ND	ND	ND	ND	ND	0.09
AQ011521:1050NP4-3	1/15/2021	10:50	ND	ND	ND	ND	0.00157	ND	ND	ND	ND	ND	ND	ND	ND	0.03
AQ042221:1010NP4-3	4/22/2021	10:10	0.00475	0.00028	ND	ND	0.00111	ND	ND	ND	ND	ND	ND	ND	ND	0.02

PCE: Tetrachloroethylene

DCA: 1,1-Dichloroethane

MC: Methylene Chloride

TCE: Trichloroethene

cis-DCE: cis-1,2-Dichloroethene

EB: Ethylbenzene

TCA: 1,1,1-Trichloroethane

trans-DCE: trans-1,2-Dichloroethylene

DCE: 1,1-Dichloroethene

CF: Chloroform

Notes: NA - Not Applicable.

NS - Not Sampled

ND - Not Detected


B - Method blank contamination, the associated method blank contains the target analyte at a reportable level.

The air quality results summarized above are for the compounds listed in the FSP&T groundwater discharge permit. Low concentrations of additional compounds are accounted for in the Total VOCs column, however, are not listed.

GRAPHS


GRAPH 1
GROUNDWATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

Effluent Flow Data
(April 1, 2021 to April 30, 2021)

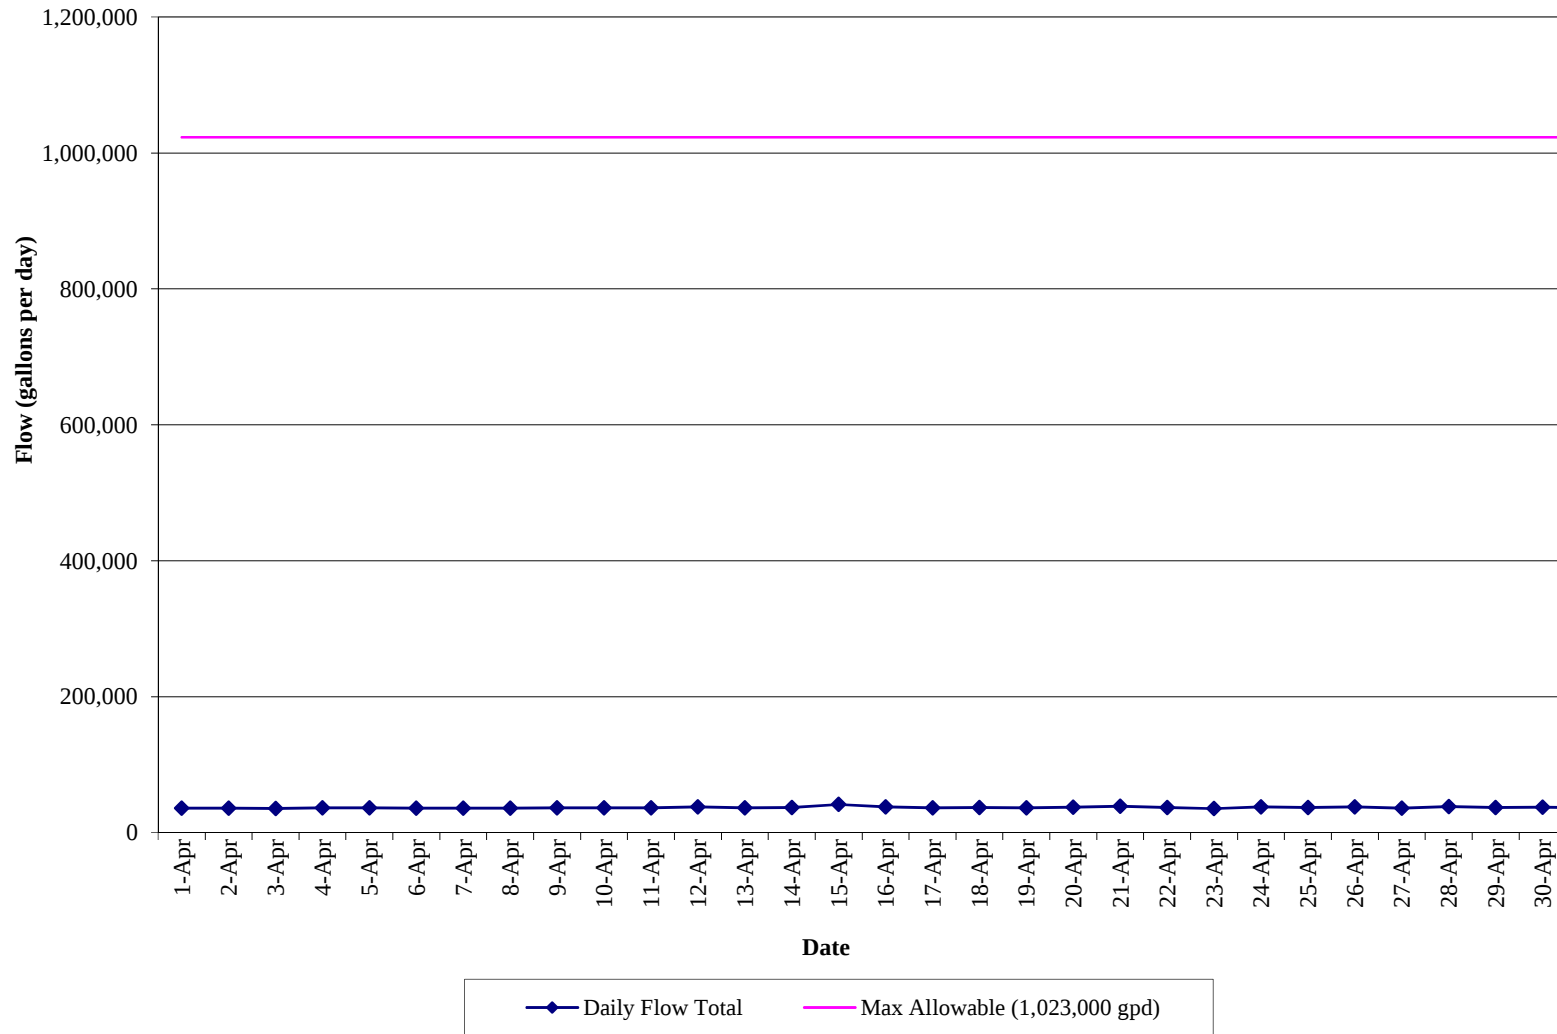

GRAPH 2
GROUNDWATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

FSP&T System Cumulative VOC Recovery and Influent PCE Concentrations vs. Time

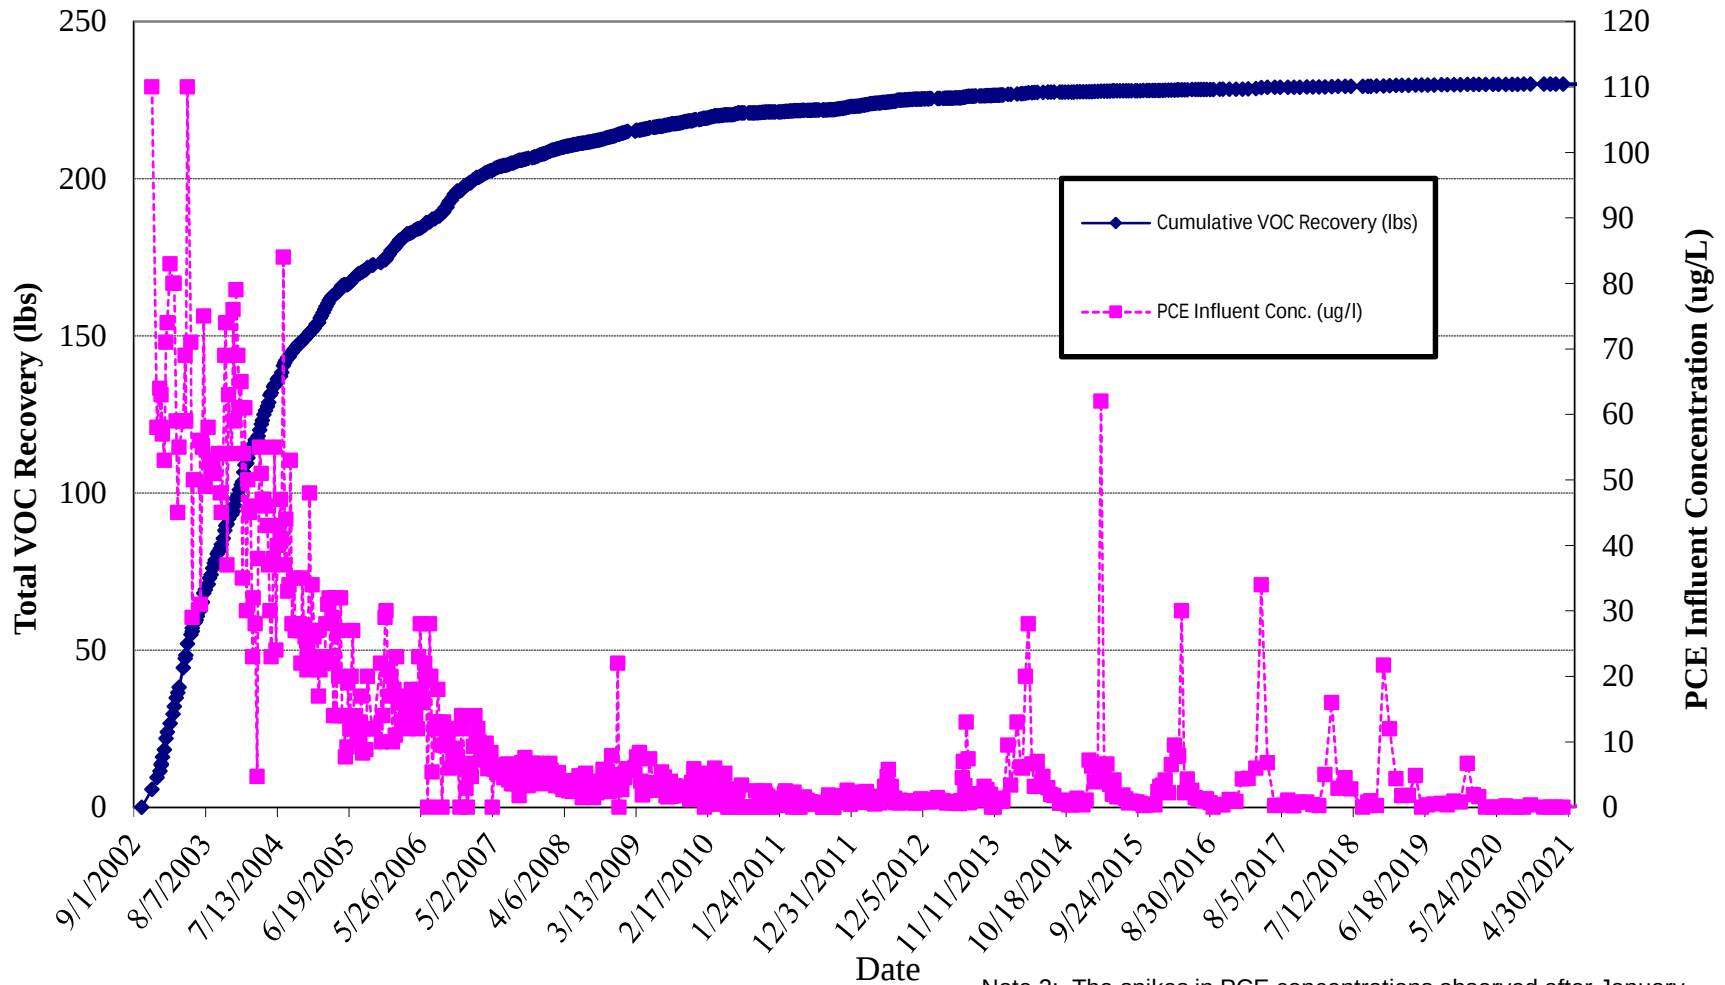


Note 1 : After September 22, 2008, the water recovered from the FP&T System is included in the results shown in this graph.


Note 2: The spikes in PCE concentrations observed after January 2014 coincide with well rehabilitation and annual maintenance events. During well rehabilitation and annual maintenance work, FSP&T system samples are collected when water from the FP&T system is not diluted with water extracted from RW-2.

GRAPH 3 **GROUNDWATER REMEDIAL ACTION** **ROWE INDUSTRIES SUPERFUND SITE** **SAG HARBOR, NEW YORK**

FSP&T Recovery Well PCE Concentration

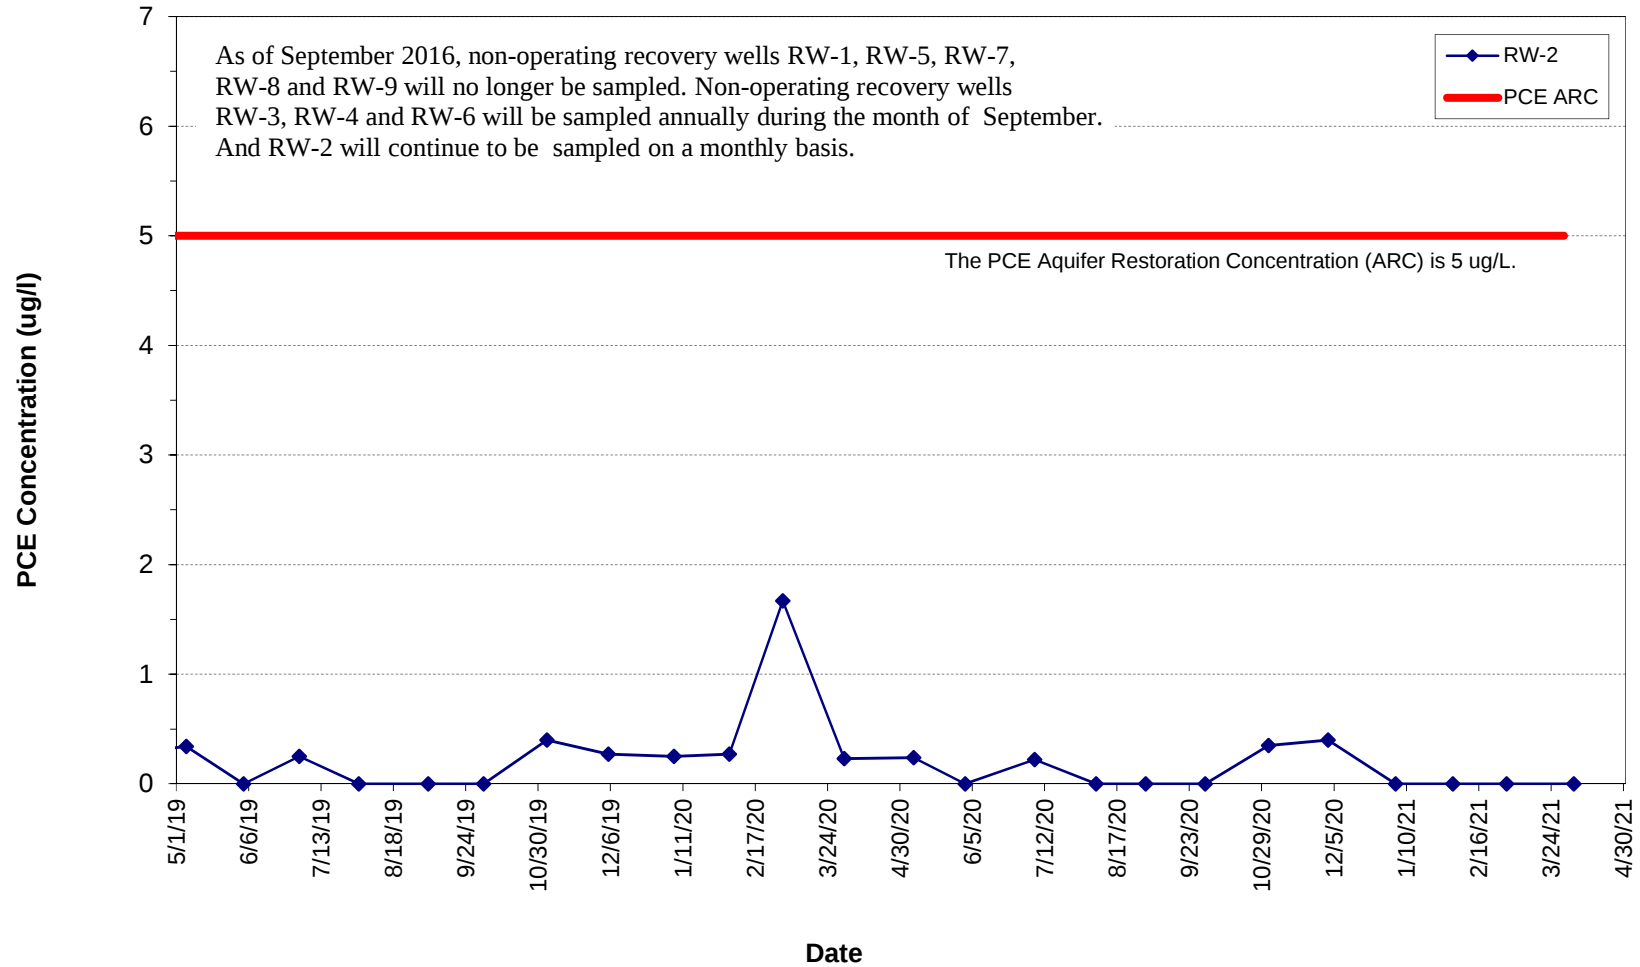

APPENDIX I
APRIL 2021 LABORATORY ANALYTICAL REPORT
FOR FSP&T SYSTEM AND RW-2



Technical Report

prepared for:

WSP USA, Inc. (Shelton)
4 Research Drive, Suite 204
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Report Date: 04/13/2021
Client Project ID: 31401451.000 Task 01.00 Rowe Industries
York Project (SDG) No.: 21D0173

CT Cert. No. PH-0723

New Jersey Cert. No. CT005 and NY037



New York Cert. Nos. 10854 and 12058

PA Cert. No. 68-04440

120 RESEARCH DRIVE
www.YORKLAB.com

STRATFORD, CT 06615
(203) 325-1371



132-02 89th AVENUE
FAX (203) 357-0166

RICHMOND HILL, NY 11418
ClientServices@yorklab.com

Report Date: 04/13/2021
Client Project ID: 31401451.000 Task 01.00 Rowe Industries
York Project (SDG) No.: 21D0173

WSP USA, Inc. (Shelton)
4 Research Drive, Suite 204
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on April 06, 2021 and listed below. The project was identified as your project: **31401451.000 Task 01.00 Rowe Industries**.

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Sample and Analysis Qualifiers section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the Sample and Data Qualifiers Relating to This Work Order section of this report and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
21D0173-01	WQ040521:0945 NP1-1-2	Water	04/05/2021	04/06/2021
21D0173-02	WQ040521:0930 NP2-10	Water	04/05/2021	04/06/2021

General Notes for York Project (SDG) No.: 21D0173

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All analyses conducted met method or Laboratory SOP requirements. See the Sample and Data Qualifiers Section for further information.
6. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
7. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.
8. Analyses conducted at York Analytical Laboratories, Inc. Stratford, CT are indicated by NY Cert. No. 10854; those conducted at York Analytical Laboratories, Inc., Richmond Hill, NY are indicated by NY Cert. No. 12058.


Approved By:



Benjamin Gulizia
Laboratory Director

Date: 04/13/2021





Sample Information

Client Sample ID: WQ040521:0945 NP1-1-2

York Sample ID: 21D0173-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

21D0173

31401451.000 Task 01.00 Rowe Industries

Water

April 5, 2021 9:45 am

04/06/2021


Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
75-34-3	1,1-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP	04/12/2021 12:30	04/13/2021 01:08	NRT
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
106-93-4	1,2-Dibromoethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
107-06-2	1,2-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
78-87-5	1,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
142-28-9	1,3-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
594-20-7	2,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT



Sample Information

Client Sample ID: WQ040521:0945 NP1-1-2

York Sample ID: 21D0173-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

21D0173

31401451.000 Task 01.00 Rowe Industries

Water

April 5, 2021 9:45 am

04/06/2021

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
95-49-8	2-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
591-78-6	2-Hexanone	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
106-43-4	4-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
67-64-1	Acetone	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
71-43-2	Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
108-86-1	Bromobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
74-97-5	Bromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
75-27-4	Bromodichloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
75-25-2	Bromoform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
74-83-9	Bromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
56-23-5	Carbon tetrachloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
108-90-7	Chlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
75-00-3	Chloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
67-66-3	Chloroform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
74-87-3	Chloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
124-48-1	Dibromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
74-95-3	Dibromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
100-41-4	Ethyl Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
87-68-3	Hexachlorobutadiene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
98-82-8	Isopropylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT



Sample Information

Client Sample ID: WQ040521:0945 NP1-1-2

York Sample ID: 21D0173-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

21D0173

31401451.000 Task 01.00 Rowe Industries

Water

April 5, 2021 9:45 am

04/06/2021

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
75-09-2	Methylene chloride	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
91-20-3	Naphthalene	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
104-51-8	n-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
103-65-1	n-Propylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
95-47-6	o-Xylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
179601-23-1	p- & m- Xylenes	ND		ug/L	0.500	1.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
99-87-6	p-Isopropyltoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
135-98-8	sec-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
100-42-5	Styrene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
98-06-6	tert-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
127-18-4	Tetrachloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
108-88-3	Toluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
79-01-6	Trichloroethylene	0.310		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
75-69-4	Trichlorofluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
75-01-4	Vinyl Chloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:08	NRT
1330-20-7	Xylenes, Total	ND		ug/L	0.600	1.50	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP	04/12/2021 12:30	04/13/2021 01:08	NRT
Surrogate Recoveries		Result	Acceptance Range								
17060-07-0	Surrogate: SURRE: 1,2-Dichloroethane-d4	95.1 %	69-130								
2037-26-5	Surrogate: SURRE: Toluene-d8	95.2 %	81-117								
460-00-4	Surrogate: SURRE: p-Bromofluorobenzene	109 %	79-122								



Sample Information

Client Sample ID: WQ040521:0930 NP2-10

York Sample ID: 21D0173-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

21D0173

31401451.000 Task 01.00 Rowe Industries

Water

April 5, 2021 9:30 am

04/06/2021

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
75-34-3	1,1-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP	04/12/2021 12:30	04/13/2021 01:37	NRT
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
106-93-4	1,2-Dibromoethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
107-06-2	1,2-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
78-87-5	1,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
142-28-9	1,3-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
594-20-7	2,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
95-49-8	2-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT



Sample Information

Client Sample ID: WQ040521:0930 NP2-10

York Sample ID: 21D0173-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

21D0173

31401451.000 Task 01.00 Rowe Industries

Water

April 5, 2021 9:30 am

04/06/2021


Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
591-78-6	2-Hexanone	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
106-43-4	4-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
67-64-1	Acetone	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
71-43-2	Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
108-86-1	Bromobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
74-97-5	Bromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
75-27-4	Bromodichloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
75-25-2	Bromoform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
74-83-9	Bromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
56-23-5	Carbon tetrachloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
108-90-7	Chlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
75-00-3	Chloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
67-66-3	Chloroform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
74-87-3	Chloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
124-48-1	Dibromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
74-95-3	Dibromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
100-41-4	Ethyl Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
87-68-3	Hexachlorobutadiene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
98-82-8	Isopropylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT



Sample Information

Client Sample ID: WQ040521:0930 NP2-10

York Sample ID: 21D0173-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

21D0173

31401451.000 Task 01.00 Rowe Industries

Water

April 5, 2021 9:30 am

04/06/2021

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
75-09-2	Methylene chloride	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
91-20-3	Naphthalene	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
104-51-8	n-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
103-65-1	n-Propylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
95-47-6	o-Xylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
179601-23-1	p- & m- Xylenes	ND		ug/L	0.500	1.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
99-87-6	p-Isopropyltoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
135-98-8	sec-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
100-42-5	Styrene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
98-06-6	tert-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
127-18-4	Tetrachloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
108-88-3	Toluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
79-01-6	Trichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
75-69-4	Trichlorofluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
75-01-4	Vinyl Chloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	04/12/2021 12:30	04/13/2021 01:37	NRT
1330-20-7	Xylenes, Total	ND		ug/L	0.600	1.50	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP	04/12/2021 12:30	04/13/2021 01:37	NRT
Surrogate Recoveries		Result	Acceptance Range								
17060-07-0	Surrogate: SURR: 1,2-Dichloroethane-d4	95.0 %	69-130								
2037-26-5	Surrogate: SURR: Toluene-d8	94.6 %	81-117								
460-00-4	Surrogate: SURR: p-Bromofluorobenzene	108 %	79-122								

Total Dissolved Solids

Log-in Notes:

Sample Notes:



Sample Information

Client Sample ID: WQ040521:0930 NP2-10

York Sample ID: 21D0173-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

21D0173

31401451.000 Task 01.00 Rowe Industries

Water

April 5, 2021 9:30 am

04/06/2021

Sample Prepared by Method: % Solids Prep

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
	Total Dissolved Solids	205		mg/L	10.0	1	SM 2540C	04/07/2021 18:41	04/07/2021 18:41	AA
							Certifications:	NELAC-NY10854,CTDOH,NJDEP,PADEP		



Analytical Batch Summary

Batch ID: BD10359

Preparation Method: % Solids Prep

Prepared By: AA

YORK Sample ID	Client Sample ID	Preparation Date
21D0173-02	WQ040521:0930 NP2-10	04/07/21
BD10359-BLK1	Blank	04/07/21
BD10359-DUP1	Duplicate	04/07/21
BD10359-DUP2	Duplicate	04/07/21

Batch ID: BD10596

Preparation Method: EPA 5030B

Prepared By: NT

YORK Sample ID	Client Sample ID	Preparation Date
21D0173-01	WQ040521:0945 NP1-1-2	04/12/21
21D0173-02	WQ040521:0930 NP2-10	04/12/21
BD10596-BLK1	Blank	04/12/21
BD10596-BS1	LCS	04/12/21
BD10596-BSD1	LCS Dup	04/12/21



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BD10596 - EPA 5030B											
Blank (BD10596-BLK1)						Prepared & Analyzed: 04/12/2021					
1,1,1,2-Tetrachloroethane	ND	0.500	ug/L								
1,1,1-Trichloroethane	ND	0.500	"								
1,1,2,2-Tetrachloroethane	ND	0.500	"								
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.500	"								
1,1,2-Trichloroethane	ND	0.500	"								
1,1-Dichloroethane	ND	0.500	"								
1,1-Dichloroethylene	ND	0.500	"								
1,1-Dichloropropylene	ND	0.500	"								
1,2,3-Trichlorobenzene	ND	0.500	"								
1,2,3-Trichloropropane	ND	0.500	"								
1,2,4-Trichlorobenzene	ND	0.500	"								
1,2,4-Trimethylbenzene	ND	0.500	"								
1,2-Dibromo-3-chloropropane	ND	0.500	"								
1,2-Dibromoethane	ND	0.500	"								
1,2-Dichlorobenzene	ND	0.500	"								
1,2-Dichloroethane	ND	0.500	"								
1,2-Dichloropropane	ND	0.500	"								
1,3,5-Trimethylbenzene	ND	0.500	"								
1,3-Dichlorobenzene	ND	0.500	"								
1,3-Dichloropropane	ND	0.500	"								
1,4-Dichlorobenzene	ND	0.500	"								
2,2-Dichloropropane	ND	0.500	"								
2-Chlorotoluene	ND	0.500	"								
2-Hexanone	ND	0.500	"								
4-Chlorotoluene	ND	0.500	"								
Acetone	ND	2.00	"								
Benzene	ND	0.500	"								
Bromobenzene	ND	0.500	"								
Bromochloromethane	ND	0.500	"								
Bromodichloromethane	ND	0.500	"								
Bromoform	ND	0.500	"								
Bromomethane	ND	0.500	"								
Carbon tetrachloride	ND	0.500	"								
Chlorobenzene	ND	0.500	"								
Chloroethane	ND	0.500	"								
Chloroform	ND	0.500	"								
Chloromethane	ND	0.500	"								
cis-1,2-Dichloroethylene	ND	0.500	"								
cis-1,3-Dichloropropylene	ND	0.500	"								
Dibromochloromethane	ND	0.500	"								
Dibromomethane	ND	0.500	"								
Dichlorodifluoromethane	ND	0.500	"								
Ethyl Benzene	ND	0.500	"								
Hexachlorobutadiene	ND	0.500	"								
Isopropylbenzene	ND	0.500	"								
Methyl tert-butyl ether (MTBE)	ND	0.500	"								
Methylene chloride	ND	2.00	"								
Naphthalene	ND	2.00	"								
n-Butylbenzene	ND	0.500	"								



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BD10596 - EPA 5030B											
Blank (BD10596-BLK1)						Prepared & Analyzed: 04/12/2021					
n-Propylbenzene	ND	0.500	ug/L								
o-Xylene	ND	0.500	"								
p- & m- Xylenes	ND	1.00	"								
p-Isopropyltoluene	ND	0.500	"								
sec-Butylbenzene	ND	0.500	"								
Styrene	ND	0.500	"								
tert-Butylbenzene	ND	0.500	"								
Tetrachloroethylene	ND	0.500	"								
Toluene	ND	0.500	"								
trans-1,2-Dichloroethylene	ND	0.500	"								
trans-1,3-Dichloropropylene	ND	0.500	"								
Trichloroethylene	ND	0.500	"								
Trichlorofluoromethane	ND	0.500	"								
Vinyl Chloride	ND	0.500	"								
Xylenes, Total	ND	1.50	"								
Surrogate: SURR: 1,2-Dichloroethane-d4	9.67		"	10.0		96.7	69-130				
Surrogate: SURR: Toluene-d8	9.42		"	10.0		94.2	81-117				
Surrogate: SURR: p-Bromofluorobenzene	10.5		"	10.0		105	79-122				
LCS (BD10596-BS1)						Prepared & Analyzed: 04/12/2021					
1,1,1,2-Tetrachloroethane	8.08		ug/L	10.0		80.8	82-126	Low Bias			
1,1,1-Trichloroethane	9.94		"	10.0		99.4	78-136				
1,1,2,2-Tetrachloroethane	8.21		"	10.0		82.1	76-129				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.9		"	10.0		109	54-165				
1,1,2-Trichloroethane	7.95		"	10.0		79.5	82-123	Low Bias			
1,1-Dichloroethane	10.1		"	10.0		101	82-129				
1,1-Dichloroethylene	11.0		"	10.0		110	68-138				
1,1-Dichloropropylene	10.2		"	10.0		102	83-133				
1,2,3-Trichlorobenzene	7.56		"	10.0		75.6	76-136	Low Bias			
1,2,3-Trichloropropane	7.55		"	10.0		75.5	77-128	Low Bias			
1,2,4-Trichlorobenzene	7.73		"	10.0		77.3	76-137				
1,2,4-Trimethylbenzene	8.68		"	10.0		86.8	82-132				
1,2-Dibromo-3-chloropropane	7.92		"	10.0		79.2	45-147				
1,2-Dibromoethane	7.99		"	10.0		79.9	83-124	Low Bias			
1,2-Dichlorobenzene	7.83		"	10.0		78.3	79-123	Low Bias			
1,2-Dichloroethane	8.93		"	10.0		89.3	73-132				
1,2-Dichloropropane	8.78		"	10.0		87.8	78-126				
1,3,5-Trimethylbenzene	8.84		"	10.0		88.4	80-131				
1,3-Dichlorobenzene	7.87		"	10.0		78.7	86-122	Low Bias			
1,3-Dichloropropane	8.24		"	10.0		82.4	81-125				
1,4-Dichlorobenzene	7.90		"	10.0		79.0	85-124	Low Bias			
2,2-Dichloropropane	9.41		"	10.0		94.1	56-150				
2-Chlorotoluene	8.58		"	10.0		85.8	79-130				
2-Hexanone	7.18		"	10.0		71.8	51-146				
4-Chlorotoluene	8.34		"	10.0		83.4	79-128				
Acetone	5.00		"	10.0		50.0	14-150				
Benzene	10.2		"	10.0		102	85-126				
Bromobenzene	8.24		"	10.0		82.4	78-129				
Bromochloromethane	9.80		"	10.0		98.0	77-128				
Bromodichloromethane	8.48		"	10.0		84.8	79-128				



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	--------------------	-------	----------------	-------------------	------	----------------	------	-----	--------------	------

Batch BD10596 - EPA 5030B

LCS (BD10596-BS1)

Prepared & Analyzed: 04/12/2021

Bromoform	7.76		ug/L	10.0		77.6	78-133	Low Bias			
Bromomethane	9.76		"	10.0		97.6	43-168				
Carbon tetrachloride	9.78		"	10.0		97.8	77-141				
Chlorobenzene	8.43		"	10.0		84.3	88-120	Low Bias			
Chloroethane	9.72		"	10.0		97.2	65-136				
Chloroform	9.62		"	10.0		96.2	82-128				
Chloromethane	10.6		"	10.0		106	43-155				
cis-1,2-Dichloroethylene	9.91		"	10.0		99.1	83-129				
cis-1,3-Dichloropropylene	8.46		"	10.0		84.6	80-131				
Dibromochloromethane	8.20		"	10.0		82.0	80-130				
Dibromomethane	7.95		"	10.0		79.5	72-134				
Dichlorodifluoromethane	5.48		"	10.0		54.8	44-144				
Ethyl Benzene	9.01		"	10.0		90.1	80-131				
Hexachlorobutadiene	10.4		"	10.0		104	67-146				
Isopropylbenzene	8.81		"	10.0		88.1	76-140				
Methyl tert-butyl ether (MTBE)	9.19		"	10.0		91.9	76-135				
Methylene chloride	10.9		"	10.0		109	55-137				
Naphthalene	7.71		"	10.0		77.1	70-147				
n-Butylbenzene	9.47		"	10.0		94.7	79-132				
n-Propylbenzene	9.06		"	10.0		90.6	78-133				
o-Xylene	8.55		"	10.0		85.5	78-130				
p- & m- Xylenes	17.8		"	20.0		88.8	77-133				
p-Isopropyltoluene	9.46		"	10.0		94.6	81-136				
sec-Butylbenzene	10.2		"	10.0		102	79-137				
Styrene	8.67		"	10.0		86.7	67-132				
tert-Butylbenzene	8.98		"	10.0		89.8	77-138				
Tetrachloroethylene	5.75		"	10.0		57.5	82-131	Low Bias			
Toluene	9.06		"	10.0		90.6	80-127				
trans-1,2-Dichloroethylene	11.1		"	10.0		111	80-132				
trans-1,3-Dichloropropylene	7.98		"	10.0		79.8	78-131				
Trichloroethylene	8.78		"	10.0		87.8	82-128				
Trichlorofluoromethane	9.50		"	10.0		95.0	67-139				
Vinyl Chloride	10.8		"	10.0		108	58-145				
Surrogate: SURR: 1,2-Dichloroethane-d4	9.64		"	10.0		96.4	69-130				
Surrogate: SURR: Toluene-d8	9.37		"	10.0		93.7	81-117				
Surrogate: SURR: p-Bromofluorobenzene	10.4		"	10.0		104	79-122				



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.


Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BD10596 - EPA 5030B											
LCS Dup (BD10596-BSD1)						Prepared & Analyzed: 04/12/2021					
1,1,1,2-Tetrachloroethane	7.88		ug/L	10.0		78.8	82-126	Low Bias	2.51	30	
1,1,1-Trichloroethane	9.61		"	10.0		96.1	78-136		3.38	30	
1,1,2,2-Tetrachloroethane	8.10		"	10.0		81.0	76-129		1.35	30	
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.4		"	10.0		104	54-165		4.04	30	
1,1,2-Trichloroethane	7.89		"	10.0		78.9	82-123	Low Bias	0.758	30	
1,1-Dichloroethane	9.90		"	10.0		99.0	82-129		1.90	30	
1,1-Dichloroethylene	10.7		"	10.0		107	68-138		3.13	30	
1,1-Dichloropropylene	9.96		"	10.0		99.6	83-133		2.87	30	
1,2,3-Trichlorobenzene	7.40		"	10.0		74.0	76-136	Low Bias	2.14	30	
1,2,3-Trichloropropane	7.47		"	10.0		74.7	77-128	Low Bias	1.07	30	
1,2,4-Trichlorobenzene	7.57		"	10.0		75.7	76-137	Low Bias	2.09	30	
1,2,4-Trimethylbenzene	8.34		"	10.0		83.4	82-132		4.00	30	
1,2-Dibromo-3-chloropropane	7.83		"	10.0		78.3	45-147		1.14	30	
1,2-Dibromoethane	7.79		"	10.0		77.9	83-124	Low Bias	2.53	30	
1,2-Dichlorobenzene	7.62		"	10.0		76.2	79-123	Low Bias	2.72	30	
1,2-Dichloroethane	8.96		"	10.0		89.6	73-132		0.335	30	
1,2-Dichloropropane	8.53		"	10.0		85.3	78-126		2.89	30	
1,3,5-Trimethylbenzene	8.53		"	10.0		85.3	80-131		3.57	30	
1,3-Dichlorobenzene	7.68		"	10.0		76.8	86-122	Low Bias	2.44	30	
1,3-Dichloropropane	8.11		"	10.0		81.1	81-125		1.59	30	
1,4-Dichlorobenzene	7.68		"	10.0		76.8	85-124	Low Bias	2.82	30	
2,2-Dichloropropane	9.04		"	10.0		90.4	56-150		4.01	30	
2-Chlorotoluene	8.27		"	10.0		82.7	79-130		3.68	30	
2-Hexanone	7.14		"	10.0		71.4	51-146		0.559	30	
4-Chlorotoluene	8.05		"	10.0		80.5	79-128		3.54	30	
Acetone	5.10		"	10.0		51.0	14-150		1.98	30	
Benzene	10.0		"	10.0		100	85-126		1.59	30	
Bromobenzene	7.99		"	10.0		79.9	78-129		3.08	30	
Bromochloromethane	9.71		"	10.0		97.1	77-128		0.923	30	
Bromodichloromethane	8.26		"	10.0		82.6	79-128		2.63	30	
Bromoform	7.62		"	10.0		76.2	78-133	Low Bias	1.82	30	
Bromomethane	10.6		"	10.0		106	43-168		8.35	30	
Carbon tetrachloride	9.55		"	10.0		95.5	77-141		2.38	30	
Chlorobenzene	8.20		"	10.0		82.0	88-120	Low Bias	2.77	30	
Chloroethane	9.36		"	10.0		93.6	65-136		3.77	30	
Chloroform	9.42		"	10.0		94.2	82-128		2.10	30	
Chloromethane	10.2		"	10.0		102	43-155		3.66	30	
cis-1,2-Dichloroethylene	9.80		"	10.0		98.0	83-129		1.12	30	
cis-1,3-Dichloropropylene	8.25		"	10.0		82.5	80-131		2.51	30	
Dibromochloromethane	8.01		"	10.0		80.1	80-130		2.34	30	
Dibromomethane	7.79		"	10.0		77.9	72-134		2.03	30	
Dichlorodifluoromethane	4.90		"	10.0		49.0	44-144		11.2	30	
Ethyl Benzene	8.70		"	10.0		87.0	80-131		3.50	30	
Hexachlorobutadiene	9.74		"	10.0		97.4	67-146		6.46	30	
Isopropylbenzene	8.48		"	10.0		84.8	76-140		3.82	30	
Methyl tert-butyl ether (MTBE)	9.23		"	10.0		92.3	76-135		0.434	30	
Methylene chloride	11.1		"	10.0		111	55-137		1.45	30	
Naphthalene	7.59		"	10.0		75.9	70-147		1.57	30	
n-Butylbenzene	9.19		"	10.0		91.9	79-132		3.00	30	
n-Propylbenzene	8.65		"	10.0		86.5	78-133		4.63	30	



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BD10596 - EPA 5030B											
LCS Dup (BD10596-BSD1)						Prepared & Analyzed: 04/12/2021					
o-Xylene	8.30		ug/L	10.0		83.0	78-130		2.97	30	
p- & m- Xylenes	17.2		"	20.0		86.0	77-133		3.20	30	
p-Isopropyltoluene	9.04		"	10.0		90.4	81-136		4.54	30	
sec-Butylbenzene	9.79		"	10.0		97.9	79-137		4.49	30	
Styrene	8.42		"	10.0		84.2	67-132		2.93	30	
tert-Butylbenzene	8.64		"	10.0		86.4	77-138		3.86	30	
Tetrachloroethylene	5.50		"	10.0		55.0	82-131	Low Bias	4.44	30	
Toluene	8.71		"	10.0		87.1	80-127		3.94	30	
trans-1,2-Dichloroethylene	10.8		"	10.0		108	80-132		3.02	30	
trans-1,3-Dichloropropylene	7.83		"	10.0		78.3	78-131		1.90	30	
Trichloroethylene	8.41		"	10.0		84.1	82-128		4.30	30	
Trichlorofluoromethane	9.15		"	10.0		91.5	67-139		3.75	30	
Vinyl Chloride	5.24		"	10.0		52.4	58-145	Low Bias	69.1	30	Non-dir.
Surrogate: SURR: 1,2-Dichloroethane-d4	9.64		"	10.0		96.4	69-130				
Surrogate: SURR: Toluene-d8	9.39		"	10.0		93.9	81-117				
Surrogate: SURR: p-Bromofluorobenzene	10.2		"	10.0		102	79-122				



Miscellaneous Physical Parameters - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	--------------------	-------	----------------	-------------------	------	----------------	------	-----	--------------	------

Batch BD10359 - % Solids Prep

Blank (BD10359-BLK1)

Prepared & Analyzed: 04/07/2021

Total Dissolved Solids ND 10.0 mg/L

Duplicate (BD10359-DUP1)

*Source sample: 21D0100-03 (Duplicate)

Prepared & Analyzed: 04/07/2021

Total Dissolved Solids 1680 10.0 mg/L 1720 1.82 15

Duplicate (BD10359-DUP2)

*Source sample: 21D0173-02 (WQ040521:0930 NP2-10)

Prepared & Analyzed: 04/07/2021

Total Dissolved Solids 195 10.0 mg/L 205 5.00 15



Volatile Analysis Sample Containers

Lab ID	Client Sample ID	Volatile Sample Container
21D0173-01	WQ040521:0945 NP1-1-2	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C
21D0173-02	WQ040521:0930 NP2-10	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C



Sample and Data Qualifiers Relating to This Work Order

QR-04	The RPD exceeded control limits for the LCS/LCSD QC.
QL-02	This LCS analyte is outside Laboratory Recovery limits due the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.
CCV-E	The value reported is ESTIMATED. The value is estimated due to its behavior during continuing calibration verification (>20% Difference for average Rf or >20% Drift for quadratic fit).

Definitions and Other Explanations

*	Analyte is not certified or the state of the samples origination does not offer certification for the Analyte.
ND	NOT DETECTED - the analyte is not detected at the Reported to level (LOQ/RL or LOD/MDL)
RL	REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.
LOQ	LIMIT OF QUANTITATION - the minimum concentration of a target analyte that can be reported within a specified degree of confidence. This is the lowest point in an analyte calibration curve that has been subjected to all steps of the processing/analysis and verified to meet defined criteria. This is based upon NELAC 2009 Standards and applies to all analyses.
LOD	LIMIT OF DETECTION - a verified estimate of the minimum concentration of a substance in a given matrix that an analytical process can reliably detect. This is based upon NELAC 2009 Standards and applies to all analyses conducted under the auspices of EPA SW-846.
MDL	METHOD DETECTION LIMIT - a statistically derived estimate of the minimum amount of a substance an analytical system can reliably detect with a 99% confidence that the concentration of the substance is greater than zero. This is based upon 40 CFR Part 136 Appendix B and applies only to EPA 600 and 200 series methods.
Reported to	This indicates that the data for a particular analysis is reported to either the LOD/MDL, or the LOQ/RL. In cases where the "Reported to" is located above the LOD/MDL, any value between this and the LOQ represents an estimated value which is "J" flagged accordingly. This applies to volatile and semi-volatile target compounds only.
NR	Not reported
RPD	Relative Percent Difference
Wet	The data has been reported on an as-received (wet weight) basis
Low Bias	Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
High Bias	High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
Non-Dir.	Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.

If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two. For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the LOD/MDL, with values between the LOD/MDL and the LOQ being "J" flagged as estimated results.



For analyses by EPA SW-846-8270D, the Limit of Quantitation (LOQ) reported for benzidine is based upon the lowest standard used for calibration and is not a verified LOQ due to this compound's propensity for oxidative losses during extraction/concentration procedures and non-reproducible chromatographic performance.





YORK
ANALYTICAL LABORATORIES INC.

York Analytical Laboratories, Inc.

120 Research Drive 132-02 89th Ave
Stratford, CT 06615 Queens, NY 11418

clientservices@yorklab.com

www.yorklab.com

Field Chain-of-Custody Record

YORK Project No.

21D0173

Page 1 of 1

NOTE: YORK's Standard Terms & Conditions are listed on the back side of this document.

This document serves as your written authorization for YORK to proceed with the analyses requested below.
Your signature binds you to YORK's Standard Terms & Conditions.

YOUR Information		Report To:	Invoice To:		YOUR Project Number		Turn-Around Time			
Company:	WSP USA	Company:	Same		Company:	WSP USA Accounting		31401451.000 Task 01.00	RUSH - Next Day	
Address:	4 Research Drive, Suite 204 Shelton, CT 06484	Address:			Address:				RUSH - Two Day	
Phone:	203-929-8555	Phone:			Phone:				RUSH - Three Day	
Contact:	Tunde Komuves-Sandor	Contact:			Contact:				RUSH - Four Day	
E-mail:	tunde.sandor@wsp.com	E-mail:			E-mail:				Standard (5-7 Day) ☒	
					YOUR Project Name					
					Rowe Industries					
					YOUR PO#: 31401451.000 Task 01.00					
Please print clearly and legibly. All information must be complete. Samples will not be logged in and the turn-around-time clock will not begin until any questions by YORK are resolved. Scott Philbrick Samples Collected by: (print your name above and sign below) Scott Philbrick			Matrix Codes		Samples From		Report / EDD Type (circle selections)			YORK Reg. Comp.
			S - soil / solid	New York	☒	Summary Report	CT RCP	Standard Excel EDD	Compared to the following Regulation(s): (please fill in)	
			GW - groundwater	New Jersey		QA Report	CT RCP DQA/DUE	EQulS (Standard)		
			DW - drinking water	Connecticut		NY ASP A Package	NJDEP Reduced Deliverables	NYSDEC EQulS		
			WW - wastewater	Pennsylvania		NY ASP B Package	NJDEP SRP HazSite			
O - Oil : Other	Other			NJDKQP	Other:					
Sample Identification		Sample Matrix	Date/Time Sampled		Analysis Requested			Container Description		
WQ040521:0945 NP1-1-2		GW	4-5-21 09:45		VOCs 8260 full list + freon 113			3 HCl VOA		
WQ040521:0930 NP2-10			4-5-21 09:30		P + TDS			3 HCl VOA + 1 Plastic		
Comments:					Preservation: (check all that apply)			Special Instruction		
					HCl ☒ MeOH ___ HNO ₃ ___ H ₂ SO ₄ ___ NaOH ___ ZnAc ___ Ascorbic Acid ___ Other: <u>cool</u>			Field Filtered ___ Lab to Filter ___		
Samples Relinquished by / Company		Date/Time	Samples Received by / Company		Date/Time	Samples Relinquished by / Company		Date/Time		
Scott Philbrick WSP		4-5-21	[Signature]		4/6/21 1150	[Signature]		4/6/21 1228		
Samples Received by / Company		Date/Time	Samples Relinquished by / Company		Date/Time	Samples Received by / Company		Date/Time		
Samples Relinquished by / Company		Date/Time	Samples Received by / Company		Date/Time	Samples Received in LAB by		Date/Time	Temp. Received at Lab	
						[Signature]		4/6/21 1228	3.4	

Degrees C

APPENDIX II
APRIL 2021 LABORATORY ANALYTICAL REPORT
FOR AIR SAMPLES



Wednesday, April 28, 2021

Attn: Tunde Sandor
WSP USA
4 Research Dr Suite 204
Shelton, CT 06484

Project ID: FORMER ROWE INDUSTRIES
SDG ID: GCI14579
Sample ID#s: CI14579 - CI14580

This laboratory is in compliance with the NELAC requirements of procedures used except where indicated.

This report contains results for the parameters tested, under the sampling conditions described on the Chain Of Custody, as received by the laboratory. This report is incomplete unless all pages indicated in the pagination at the bottom of the page are included.

A scanned version of the COC form accompanies the analytical report and is an exact duplicate of the original.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Sincerely yours,

A handwritten signature in black ink, appearing to read "Phyllis Shiller".

Phyllis Shiller

Laboratory Director

NELAC - #NY11301
CT Lab Registration #PH-0618
MA Lab Registration #M-CT007
ME Lab Registration #CT-007
NH Lab Registration #213693-A,B

NJ Lab Registration #CT-003
NY Lab Registration #11301
PA Lab Registration #68-03530
RI Lab Registration #63
UT Lab Registration #CT00007
VT Lab Registration #VT11301



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



**NY ANALYTICAL SERVICES PROTOCOL
DATA PACKAGE**

Client: WSP USA
Project: FORMER ROWE INDUSTRIES
Laboratory Project: GCI14579



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06040
Tel. (860) 645-1102 Fax (860) 645-0823



NY Analytical Services Protocol Format

April 28, 2021

SDG I.D.: GCI14579

WSP USA FORMER ROWE INDUSTRIES

Methodology Summary

Volatiles in Air

Compendium of Methods for the Determination of Toxic Organic Compounds in Ambient Air: Method TO-15, Second Edition, U. S. Environmental Protection Agency, January 1999.



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06040
Tel. (860) 645-1102 Fax (860) 645-0823



NY Analytical Services Protocol Format

April 28, 2021

SDG I.D.: GCI14579

WSP USA FORMER ROWE INDUSTRIES

Laboratory Chronicle

Sample	Analysis	Collection Date	Prep Date	Analysis Date	Analyst	Hold Time Met
CI14579	Volatiles (TO15)	04/22/21	04/26/21	04/26/21	KCA	Y
CI14580	Volatiles (TO15)	04/22/21	04/26/21	04/26/21	KCA	Y



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



SDG Comments

April 28, 2021

SDG I.D.: GCI14579

Any compound that is not detected above the MDL/LOD is reported as ND on the report and is reported in the electronic deliverables (EDD) as <RL or U at the RL per state and EPA guidance.

Version 1: Analysis results minus raw data.

Version 2: Complete report with raw data.



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Sample Id Cross Reference

April 28, 2021

SDG I.D.: GCI14579

Project ID: FORMER ROWE INDUSTRIES

Client Id	Lab Id	Matrix
AQ042221-10:10 NP4-1	CI14579	AIR
AQ042221-10:10 NP4-3	CI14580	AIR



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

April 28, 2021

FOR: Attn: Tunde Sandor
WSP USA
4 Research Dr Suite 204
Shelton, CT 06484

Sample Information

Matrix: AIR
Location Code: WSP
Rush Request: Standard
P.O.#:
Canister Id: 784

Custody Information

Collected by: SP
Received by: LB
Analyzed by: see "By" below

Date

04/22/21 10:00
04/23/21 14:02

Time

Laboratory Data

SDG ID: GCI14579
Phoenix ID: CI14579

Project ID: FORMER ROWE INDUSTRIES
Client ID: AQ042221-10:10 NP4-1

Parameter	ppbv Result	ppbv RL	LOD/ MDL	ug/m3 Result	ug/m3 RL	LOD/ MDL	Date/Time	By	Dilution
<u>Volatiles (TO15)</u>									
1,1,1,2-Tetrachloroethane	ND	0.146	0.146	ND	1.00	1.00	04/26/21	KCA	1
1,1,1-Trichloroethane	ND	0.183	0.183	ND	1.00	1.00	04/26/21	KCA	1
1,1,2,2-Tetrachloroethane	ND	0.146	0.146	ND	1.00	1.00	04/26/21	KCA	1
1,1,2-Trichloroethane	ND	0.183	0.183	ND	1.00	1.00	04/26/21	KCA	1
1,1-Dichloroethane	ND	0.247	0.247	ND	1.00	1.00	04/26/21	KCA	1
1,1-Dichloroethene	ND	0.051	0.051	ND	0.20	0.20	04/26/21	KCA	1
1,2,4-Trichlorobenzene	ND	0.135	0.135	ND	1.00	1.00	04/26/21	KCA	1
1,2,4-Trimethylbenzene	ND	0.204	0.204	ND	1.00	1.00	04/26/21	KCA	1
1,2-Dibromoethane(EDB)	ND	0.130	0.130	ND	1.00	1.00	04/26/21	KCA	1
1,2-Dichlorobenzene	ND	0.166	0.166	ND	1.00	1.00	04/26/21	KCA	1
1,2-Dichloroethane	ND	0.247	0.247	ND	1.00	1.00	04/26/21	KCA	1
1,2-dichloropropane	ND	0.217	0.217	ND	1.00	1.00	04/26/21	KCA	1
1,2-Dichlorotetrafluoroethane	ND	0.143	0.143	ND	1.00	1.00	04/26/21	KCA	1
1,3,5-Trimethylbenzene	ND	0.204	0.204	ND	1.00	1.00	04/26/21	KCA	1
1,3-Butadiene	ND	0.452	0.452	ND	1.00	1.00	04/26/21	KCA	1
1,3-Dichlorobenzene	ND	0.166	0.166	ND	1.00	1.00	04/26/21	KCA	1
1,4-Dichlorobenzene	ND	0.166	0.166	ND	1.00	1.00	04/26/21	KCA	1
1,4-Dioxane	ND	0.278	0.278	ND	1.00	1.00	04/26/21	KCA	1
2-Hexanone(MBK)	ND	0.244	0.244	ND	1.00	1.00	04/26/21	KCA	1
4-Ethyltoluene	ND	0.204	0.204	ND	1.00	1.00	04/26/21	KCA	1
4-Isopropyltoluene	ND	0.182	0.182	ND	1.00	1.00	04/26/21	KCA	1
4-Methyl-2-pentanone(MIBK)	ND	0.244	0.244	ND	1.00	1.00	04/26/21	KCA	1
Acetone	7.05	0.421	0.421	16.7	1.00	1.00	04/26/21	KCA	1
Acrylonitrile	ND	0.461	0.461	ND	1.00	1.00	04/26/21	KCA	1
Benzene	ND	0.313	0.313	ND	1.00	1.00	04/26/21	KCA	1
Benzyl chloride	ND	0.193	0.193	ND	1.00	1.00	04/26/21	KCA	1

Parameter	ppbv Result	ppbv RL	LOD/ MDL	ug/m3 Result	ug/m3 RL	LOD/ MDL	Date/Time	By	Dilution
Bromodichloromethane	ND	0.149	0.149	ND	1.00	1.00	04/26/21	KCA	1
Bromoform	ND	0.097	0.097	ND	1.00	1.00	04/26/21	KCA	1
Bromomethane	ND	0.258	0.258	ND	1.00	1.00	04/26/21	KCA	1
Carbon Disulfide	ND	0.321	0.321	ND	1.00	1.00	04/26/21	KCA	1
Carbon Tetrachloride	0.073	0.032	0.032	0.46	0.20	0.20	04/26/21	KCA	1
Chlorobenzene	ND	0.217	0.217	ND	1.00	1.00	04/26/21	KCA	1
Chloroethane	ND	0.379	0.379	ND	1.00	1.00	04/26/21	KCA	1
Chloroform	0.431	0.205	0.205	2.10	1.00	1.00	04/26/21	KCA	1
Chloromethane	ND	0.485	0.485	ND	1.00	1.00	04/26/21	KCA	1
Cis-1,2-Dichloroethene	0.451	0.051	0.051	1.79	0.20	0.20	04/26/21	KCA	1
cis-1,3-Dichloropropene	ND	0.221	0.221	ND	1.00	1.00	04/26/21	KCA	1
Cyclohexane	ND	0.291	0.291	ND	1.00	1.00	04/26/21	KCA	1
Dibromochloromethane	ND	0.118	0.118	ND	1.00	1.00	04/26/21	KCA	1
Dichlorodifluoromethane	0.345	0.202	0.202	1.71	1.00	1.00	04/26/21	KCA	1
Ethanol	8.64	0.531	0.531	16.3	1.00	1.00	04/26/21	KCA	1
Ethyl acetate	ND	0.278	0.278	ND	1.00	1.00	04/26/21	KCA	1
Ethylbenzene	ND	0.230	0.230	ND	1.00	1.00	04/26/21	KCA	1
Heptane	ND	0.244	0.244	ND	1.00	1.00	04/26/21	KCA	1
Hexachlorobutadiene	ND	0.094	0.094	ND	1.00	1.00	04/26/21	KCA	1
Hexane	ND	0.284	0.284	ND	1.00	1.00	04/26/21	KCA	1
Isopropylalcohol	11.8	0.407	0.407	29.0	1.00	1.00	04/26/21	KCA	1
Isopropylbenzene	ND	0.204	0.204	ND	1.00	1.00	04/26/21	KCA	1
m,p-Xylene	ND	0.230	0.230	ND	1.00	1.00	04/26/21	KCA	1
Methyl Ethyl Ketone	0.428	0.339	0.339	1.26	1.00	1.00	04/26/21	KCA	1
Methyl tert-butyl ether(MTBE)	ND	0.278	0.278	ND	1.00	1.00	04/26/21	KCA	1
Methylene Chloride	ND	0.864	0.864	ND	3.00	3.00	04/26/21	KCA	1
n-Butylbenzene	ND	0.182	0.182	ND	1.00	1.00	04/26/21	KCA	1
o-Xylene	ND	0.230	0.230	ND	1.00	1.00	04/26/21	KCA	1
Propylene	ND	0.581	0.581	ND	1.00	1.00	04/26/21	KCA	1
sec-Butylbenzene	ND	0.182	0.182	ND	1.00	1.00	04/26/21	KCA	1
Styrene	ND	0.235	0.235	ND	1.00	1.00	04/26/21	KCA	1
Tetrachloroethene	0.308	0.037	0.037	2.09	0.25	0.25	04/26/21	KCA	1
Tetrahydrofuran	ND	0.339	0.339	ND	1.00	1.00	04/26/21	KCA	1
Toluene	ND	0.266	0.266	ND	1.00	1.00	04/26/21	KCA	1
Trans-1,2-Dichloroethene	ND	0.252	0.252	ND	1.00	1.00	04/26/21	KCA	1
trans-1,3-Dichloropropene	ND	0.221	0.221	ND	1.00	1.00	04/26/21	KCA	1
Trichloroethene	0.702	0.037	0.037	3.77	0.20	0.20	04/26/21	KCA	1
Trichlorofluoromethane	0.238	0.178	0.178	1.34	1.00	1.00	04/26/21	KCA	1
Trichlorotrifluoroethane	ND	0.131	0.131	ND	1.00	1.00	04/26/21	KCA	1
Vinyl Chloride	ND	0.078	0.078	ND	0.20	0.20	04/26/21	KCA	1
<u>QA/OC Surrogates/Internals</u>									
% Bromofluorobenzene	100	%	%	100	%	%	04/26/21	KCA	1
% IS-1,4-Difluorobenzene	95	%	%	95	%	%	04/26/21	KCA	1
% IS-Bromochloromethane	96	%	%	96	%	%	04/26/21	KCA	1
% IS-Chlorobenzene-d5	94	%	%	94	%	%	04/26/21	KCA	1

Parameter	ppbv Result	ppbv RL	LOD/ MDL	ug/m3 Result	ug/m3 RL	LOD/ MDL	Date/Time	By	Dilution
-----------	----------------	------------	-------------	-----------------	-------------	-------------	-----------	----	----------

1 = This parameter is not certified by the primary accrediting authority (NY NELAC) for this matrix. NY NELAC does not offer certification for all parameters at this time.

RL/PQL=Reporting/Practical Quantitation Level (Equivalent to NELAC LOQ, Limit of Quantitation) ND=Not Detected BRL=Below Reporting Level L=Biased Low LOD=Limit of Detection MDL=Method Detection Limit1

QA/QC Surrogates: Surrogates are compounds (preceded with a %) added by the lab to determine analysis efficiency. Surrogate results(%) listed in the report are not "detected" compounds.

Comments:

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.



Phyllis Shiller, Laboratory Director

April 28, 2021

Reviewed and Released by: Rashmi Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

April 28, 2021

FOR: Attn: Tunde Sandor
WSP USA
4 Research Dr Suite 204
Shelton, CT 06484

Sample Information

Matrix: AIR
Location Code: WSP
Rush Request: Standard
P.O.#:
Canister Id: 810

Custody Information

Collected by: SP
Received by: LB
Analyzed by: see "By" below

Date

04/22/21 10:10
04/23/21 14:02

Time

Laboratory Data

SDG ID: GCI14579
Phoenix ID: CI14580

Project ID: FORMER ROWE INDUSTRIES
Client ID: AQ042221-10:10 NP4-3

Parameter	ppbv Result	ppbv RL	LOD/ MDL	ug/m3 Result	ug/m3 RL	LOD/ MDL	Date/Time	By	Dilution
<u>Volatiles (TO15)</u>									
1,1,1,2-Tetrachloroethane	ND	0.146	0.146	ND	1.00	1.00	04/26/21	KCA	1
1,1,1-Trichloroethane	ND	0.183	0.183	ND	1.00	1.00	04/26/21	KCA	1
1,1,2,2-Tetrachloroethane	ND	0.146	0.146	ND	1.00	1.00	04/26/21	KCA	1
1,1,2-Trichloroethane	ND	0.183	0.183	ND	1.00	1.00	04/26/21	KCA	1
1,1-Dichloroethane	ND	0.247	0.247	ND	1.00	1.00	04/26/21	KCA	1
1,1-Dichloroethene	ND	0.051	0.051	ND	0.20	0.20	04/26/21	KCA	1
1,2,4-Trichlorobenzene	ND	0.135	0.135	ND	1.00	1.00	04/26/21	KCA	1
1,2,4-Trimethylbenzene	ND	0.204	0.204	ND	1.00	1.00	04/26/21	KCA	1
1,2-Dibromoethane(EDB)	ND	0.130	0.130	ND	1.00	1.00	04/26/21	KCA	1
1,2-Dichlorobenzene	ND	0.166	0.166	ND	1.00	1.00	04/26/21	KCA	1
1,2-Dichloroethane	ND	0.247	0.247	ND	1.00	1.00	04/26/21	KCA	1
1,2-dichloropropane	ND	0.217	0.217	ND	1.00	1.00	04/26/21	KCA	1
1,2-Dichlorotetrafluoroethane	ND	0.143	0.143	ND	1.00	1.00	04/26/21	KCA	1
1,3,5-Trimethylbenzene	ND	0.204	0.204	ND	1.00	1.00	04/26/21	KCA	1
1,3-Butadiene	ND	0.452	0.452	ND	1.00	1.00	04/26/21	KCA	1
1,3-Dichlorobenzene	ND	0.166	0.166	ND	1.00	1.00	04/26/21	KCA	1
1,4-Dichlorobenzene	ND	0.166	0.166	ND	1.00	1.00	04/26/21	KCA	1
1,4-Dioxane	ND	0.278	0.278	ND	1.00	1.00	04/26/21	KCA	1
2-Hexanone(MBK)	ND	0.244	0.244	ND	1.00	1.00	04/26/21	KCA	1
4-Ethyltoluene	ND	0.204	0.204	ND	1.00	1.00	04/26/21	KCA	1
4-Isopropyltoluene	ND	0.182	0.182	ND	1.00	1.00	04/26/21	KCA	1
4-Methyl-2-pentanone(MIBK)	ND	0.244	0.244	ND	1.00	1.00	04/26/21	KCA	1
Acetone	1.47	0.421	0.421	3.49	1.00	1.00	04/26/21	KCA	1
Acrylonitrile	ND	0.461	0.461	ND	1.00	1.00	04/26/21	KCA	1
Benzene	ND	0.313	0.313	ND	1.00	1.00	04/26/21	KCA	1
Benzyl chloride	ND	0.193	0.193	ND	1.00	1.00	04/26/21	KCA	1

Parameter	ppbv Result	ppbv RL	LOD/ MDL	ug/m3 Result	ug/m3 RL	LOD/ MDL	Date/Time	By	Dilution
Bromodichloromethane	ND	0.149	0.149	ND	1.00	1.00	04/26/21	KCA	1
Bromoform	ND	0.097	0.097	ND	1.00	1.00	04/26/21	KCA	1
Bromomethane	ND	0.258	0.258	ND	1.00	1.00	04/26/21	KCA	1
Carbon Disulfide	ND	0.321	0.321	ND	1.00	1.00	04/26/21	KCA	1
Carbon Tetrachloride	0.075	0.032	0.032	0.47	0.20	0.20	04/26/21	KCA	1
Chlorobenzene	ND	0.217	0.217	ND	1.00	1.00	04/26/21	KCA	1
Chloroethane	ND	0.379	0.379	ND	1.00	1.00	04/26/21	KCA	1
Chloroform	ND	0.205	0.205	ND	1.00	1.00	04/26/21	KCA	1
Chloromethane	ND	0.485	0.485	ND	1.00	1.00	04/26/21	KCA	1
Cis-1,2-Dichloroethene	0.279	0.051	0.051	1.11	0.20	0.20	04/26/21	KCA	1
cis-1,3-Dichloropropene	ND	0.221	0.221	ND	1.00	1.00	04/26/21	KCA	1
Cyclohexane	ND	0.291	0.291	ND	1.00	1.00	04/26/21	KCA	1
Dibromochloromethane	ND	0.118	0.118	ND	1.00	1.00	04/26/21	KCA	1
Dichlorodifluoromethane	0.350	0.202	0.202	1.73	1.00	1.00	04/26/21	KCA	1
Ethanol	3.25	0.531	0.531	6.12	1.00	1.00	04/26/21	KCA	1
Ethyl acetate	ND	0.278	0.278	ND	1.00	1.00	04/26/21	KCA	1
Ethylbenzene	ND	0.230	0.230	ND	1.00	1.00	04/26/21	KCA	1
Heptane	ND	0.244	0.244	ND	1.00	1.00	04/26/21	KCA	1
Hexachlorobutadiene	ND	0.094	0.094	ND	1.00	1.00	04/26/21	KCA	1
Hexane	ND	0.284	0.284	ND	1.00	1.00	04/26/21	KCA	1
Isopropylalcohol	0.772	0.407	0.407	1.90	1.00	1.00	04/26/21	KCA	1
Isopropylbenzene	ND	0.204	0.204	ND	1.00	1.00	04/26/21	KCA	1
m,p-Xylene	ND	0.230	0.230	ND	1.00	1.00	04/26/21	KCA	1
Methyl Ethyl Ketone	ND	0.339	0.339	ND	1.00	1.00	04/26/21	KCA	1
Methyl tert-butyl ether(MTBE)	ND	0.278	0.278	ND	1.00	1.00	04/26/21	KCA	1
Methylene Chloride	ND	0.864	0.864	ND	3.00	3.00	04/26/21	KCA	1
n-Butylbenzene	ND	0.182	0.182	ND	1.00	1.00	04/26/21	KCA	1
o-Xylene	ND	0.230	0.230	ND	1.00	1.00	04/26/21	KCA	1
Propylene	ND	0.581	0.581	ND	1.00	1.00	04/26/21	KCA	1
sec-Butylbenzene	ND	0.182	0.182	ND	1.00	1.00	04/26/21	KCA	1
Styrene	ND	0.235	0.235	ND	1.00	1.00	04/26/21	KCA	1
Tetrachloroethene	0.701	0.037	0.037	4.75	0.25	0.25	04/26/21	KCA	1
Tetrahydrofuran	ND	0.339	0.339	ND	1.00	1.00	04/26/21	KCA	1
Toluene	ND	0.266	0.266	ND	1.00	1.00	04/26/21	KCA	1
Trans-1,2-Dichloroethene	ND	0.252	0.252	ND	1.00	1.00	04/26/21	KCA	1
trans-1,3-Dichloropropene	ND	0.221	0.221	ND	1.00	1.00	04/26/21	KCA	1
Trichloroethene	0.053	0.037	0.037	0.28	0.20	0.20	04/26/21	KCA	1
Trichlorofluoromethane	ND	0.178	0.178	ND	1.00	1.00	04/26/21	KCA	1
Trichlorotrifluoroethane	ND	0.131	0.131	ND	1.00	1.00	04/26/21	KCA	1
Vinyl Chloride	ND	0.078	0.078	ND	0.20	0.20	04/26/21	KCA	1
<u>QA/OC Surrogates/Internals</u>									
% Bromofluorobenzene	98	%	%	98	%	%	04/26/21	KCA	1
% IS-1,4-Difluorobenzene	93	%	%	93	%	%	04/26/21	KCA	1
% IS-Bromochloromethane	95	%	%	95	%	%	04/26/21	KCA	1
% IS-Chlorobenzene-d5	93	%	%	93	%	%	04/26/21	KCA	1

Parameter	ppbv Result	ppbv RL	LOD/ MDL	ug/m3 Result	ug/m3 RL	LOD/ MDL	Date/Time	By	Dilution
-----------	----------------	------------	-------------	-----------------	-------------	-------------	-----------	----	----------

1 = This parameter is not certified by the primary accrediting authority (NY NELAC) for this matrix. NY NELAC does not offer certification for all parameters at this time.

RL/PQL=Reporting/Practical Quantitation Level (Equivalent to NELAC LOQ, Limit of Quantitation) ND=Not Detected BRL=Below Reporting Level L=Biased Low LOD=Limit of Detection MDL=Method Detection Limit1

QA/QC Surrogates: Surrogates are compounds (preceded with a %) added by the lab to determine analysis efficiency. Surrogate results(%) listed in the report are not "detected" compounds.

Comments:

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.



Phyllis Shiller, Laboratory Director

April 28, 2021

Reviewed and Released by: Rashmi Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Canister Sampling Information

April 28, 2021

FOR: Attn: Tunde Sandor
WSP USA
4 Research Dr Suite 204
Shelton, CT 06484

Location Code: WSP

SDG I.D.: GCI14579

Project ID: FORMER ROWE INDUSTRIES

Client Id	Lab Id	Canister		Reg. Id	Chk Out Date	Laboratory					Field			
		Id	Type			Out Hg	In Hg	Out Flow	In Flow	Flow RPD	Start Hg	End Hg	Sampling Start Date	Sampling End Date
AQ042221-10:10 NP4-	CI14579	784	1.4L		04/16/21	-30	-1		B SAM		-29	-3	04/22/21 10:00	04/22/21 10:00
AQ042221-10:10 NP4-	CI14580	810	1.4L		04/16/21	-30	0		B SAM		-30	-3	04/22/21 10:10	04/22/21 10:10

Wednesday, April 28, 2021


Criteria: None
State: NY

Sample Criteria Exceedances Report
GCI14579 - WSP

SampNo	Acode	Phoenix Analyte	Criteria	Result	RL	Criteria	RL Criteria	Analysis Units
--------	-------	-----------------	----------	--------	----	----------	----------------	-------------------

*** No Data to Display ***

Phoenix Laboratories does not assume responsibility for the data contained in this exceedance report. It is provided as an additional tool to identify requested criteria exceedences. All efforts are made to ensure the accuracy of the data (obtained from appropriate agencies). A lack of exceedence information does not necessarily suggest conformance to the criteria. It is ultimately the site professional's responsibility to determine appropriate compliance.



800-827-5426

email: greg@phoenixlabs.com

Page 1 of 1

Fax #:

 Email

☒ Email: Tongle, Sander ewsp.com

Phone #

203-929-8555

Report to: Scott Philbrick	Project Name: Former Rowe Industries	Data Format: (Circle) Equis <u>Excel</u> Other:	ir ite (C)
Customer: WSP	Invoice to: WSP USA Accounting	Requested Deliverable: RCP ASP CAT B	
Address: 4 Research Drive		NYASP B Package MCP NJ Deliverables	
Shelfton, CT 06484	Sampled by: SP	Quote Number:	

[illegible]

Relinquished by:	Accepted by:	Date:	Time:	I attest that all media released by Phoenix Environmental Laboratories, Inc. have been received in good working condition and agree to the terms and conditions as listed on the back of this document:
 	 	4-23-21 4/23/21	8:42 1402	
		Signature: 		Date: 4-22-21

State Where Samples Collected: <u>NY</u>	Turnaround Time: 1 Day ☐	Requested Criteria: CT:	(Please Circle) MA:	NJ:	NY:	PA:	VT:
SPECIAL INSTRUCTIONS, QC REQUIREMENTS, REGULATORY INFORMATION: (2) lot CERAS	2 Day ☐	TAC I/C	<u>Indoor Air:</u>	<u>Indoor Air:</u>	Vapor Intrusion	<u>Indoor Air</u>	<u>Indoor Air</u>
	3 Day ☐	TAC RES	Residential	Residential	ASP B Package	Residential	Residential
	4 Day ☐	SVVC I/C	Ind/Commercial	Ind/Commercial	QA Report	Non-	Industrial
	5 Day ☒	SVVC RES	<u>Soil Gas:</u>	<u>Soil Gas:</u>	Summary Report	residential	<u>Sub-slab</u>
		GWV I/C	Residential	Residential			Residential
		GWV CES	Ind/Commercial	Ind/Commercial			Industrial