


Date:

This Daily Air Monitoring Report summarizes perimeter air monitoring data collected during the referenced period in accordance with the Community Air Monitoring Plan (CAMP) which was included as part of the requirements of Spec Section 01 57 00 Temporary Controls for the Gowanus CSO-GC-SFS-RH3 CP2 Contract. Note: the information included in this daily summary is based on preliminary results and is subject to change based on data validation.

Reporting Period:	
Weather	Temperature: °F Wind Speed: Precipitation: Prevailing Wind Direction: Relative Humidity:
Summary of Site Activities	1. CAMP monitoring approximately from 6AM to 2AM(next day). 2. Slurry Wall Excavation Operations. 3. AMS-1 was triggered while the contractor was refilling the jet grout silos with dry cement which is directly adjacent to silo.

Figure 1 - CAMP Station Locations

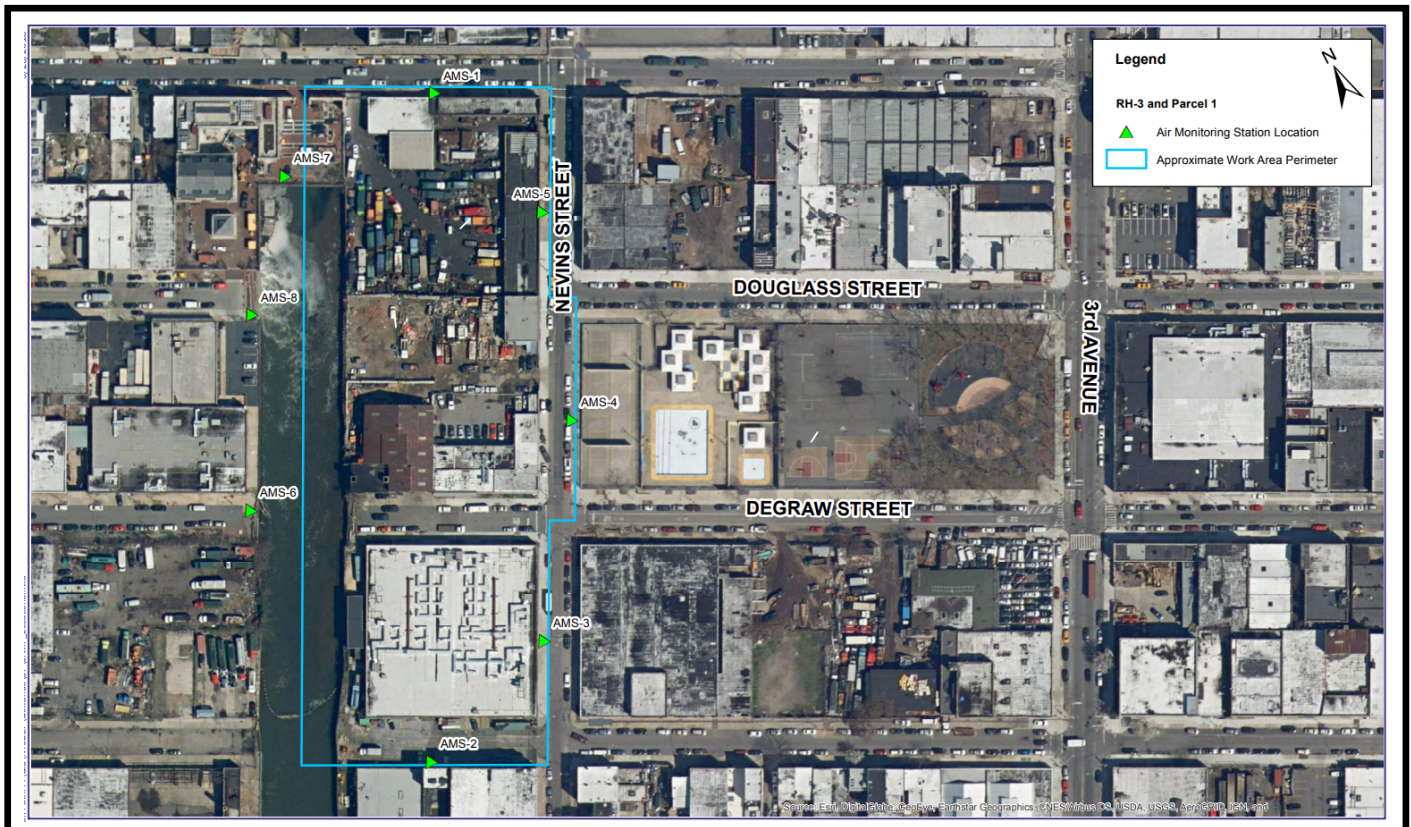

Daily Readings - VOCs

Data export


01/12/2024 00:00:00 to 01/12/2024 23:59:00

Averaging period: 15 minutes

Time	AMS-1	AMS-2	AMS-3	AMS-4	AMS-5	AMS-6	AMS-7	AMS-8
	VOC - AQS1 13032023-2241 (ppm)	VOC - AQS1 13032023-2244 (ppm)	VOC - AQS1 13032023-2240 (ppm)	VOC - AQS1 13032023-2238 (ppm)	VOC - AQS1 13032023-2239 (ppm)	VOC - AQS1 13032023-2237 (ppm)	VOC - AQS1 13032023-2243 (ppm)	VOC - AQS1 13032023-2242 (ppm)
1/12/2024 0:00	0.01	0	0.01	0.12	0.01	0.01	0.01	0.01
1/12/2024 0:15	0	0	0.01	0.08	0.01	0.01	0	0.01
1/12/2024 0:30	0.01	0.01	0.01	0.09	0.01	0.02	0.01	0.01
1/12/2024 0:45	0.01	0.01	0.02	0.16	0.01	0.02	0.01	0.01
1/12/2024 1:00	0.01	0.01	0.02	0.04	0.01	0.02	0.01	0.01
1/12/2024 1:15	0.01	0.01	0.02	0.04	0.02	0.03	0.02	0.02
1/12/2024 1:30	0.01	0.02	0.02	0.03	0.02	0.03	0.02	0.02
1/12/2024 1:45	0.01	0.01	0.02	0.07	0.02	0.03	0.02	0.01
1/12/2024 2:00	0.01	0.01	0.02	0.06	0.02	0.03	0.02	0.01
1/12/2024 5:00	0.02	0.03	0.03	0.06	0.03	0.04	0.03	0.03
1/12/2024 5:15	0.01	0.04	0.03	0.06	0.02	0.04	0.03	0.02
1/12/2024 5:30	0.01	0.03	0.03	0.05	0.03	0.03	0.03	0.01
1/12/2024 5:45	0.01	0.02	0.02	0.06	0.04	0.03	0.02	0.02
1/12/2024 6:00	0.01	0.03	0.04	0.09	0.03	0.05	0.02	0.02
1/12/2024 6:15	0.01	0.03	0.03	0.07	0.03	0.04	0.02	0.02
1/12/2024 6:30	0.02	0.04	0.03	0.07	0.04	0.04	0.03	0.02
1/12/2024 6:45	0.02	0.03	0.03	0.06	0.03	0.05	0.02	0.02
1/12/2024 7:00	0.01	0.02	0.02	0.04	0.03	0.05	0.02	0.02
1/12/2024 7:15	0.02	0.02	0.02	0.05	0.02	0.03	0.02	0.03
1/12/2024 7:30	0.02	0.02	0.02	0.04	0.02	0.03	0.03	0.02
1/12/2024 7:45	0.02	0.02	0.02	0.04	0.02	0.03	0.02	0.02
1/12/2024 8:00	0.02	0.03	0.02	0.04	0.03	0.03	0.03	0.02
1/12/2024 8:15	0.02	0.03	0.02	0.04	0.03	0.04	0.03	0.03
1/12/2024 8:30	0.03	0.04	0.03	0.05	0.03	0.03	0.03	0.02
1/12/2024 8:45	0.05	0.03	0.02	0.05	0.03	0.04	0.02	0.02
1/12/2024 9:00	0.04		0.03	0.04	0.03	0.03	0.02	0.02
1/12/2024 9:15	0.03	0.02	0.02	0.04	0.02	0.02	0.01	0.01
1/12/2024 9:30	0.01	0.02	0.01	0.03	0.01	0.02	0	0.01
1/12/2024 9:45	0.01	0	0	0.01	0.01	0.01	0	0
1/12/2024 10:00	0.01	0	0	0.01	0	0	0	0
1/12/2024 10:15	0	0.01	0.01	0.01	0	0	0	0
1/12/2024 10:30	0	0	0.01	0.02	0	0.01	0	0
1/12/2024 10:45	0	0.01	0.02	0	0	0	0	0
1/12/2024 11:00	0	0	0.02	0.03	0	0.01	0	0
1/12/2024 11:15	0	0	0	0.02	0.01	0.01	0	0
1/12/2024 11:30	0	0	0.01	0.02	0	0.03	0	0
1/12/2024 11:45	0	0.01	0.01	0.01	0	0.01	0	0
1/12/2024 12:00	0.01	0	0.02	0.01	0	0.01	0	0
1/12/2024 12:15	0.01	0.01	0.06	0.04	0.01	0.01	0	0.01
1/12/2024 12:30	0	0.01	0	0	0	0	0	0.01
1/12/2024 12:45	0	0	0	0	0	0	0	0
1/12/2024 13:00	0	0	0	0	0			
1/12/2024 13:15	0.01	0	0	0	0			
1/12/2024 13:30	0	0	0	0	0	0	0	0.01
1/12/2024 13:45	0	0	0	0	0	0	0	0.01
1/12/2024 14:00	0	0	0	0	0	0	0	0
1/12/2024 14:15	0	0	0	0	0	0	0	0
1/12/2024 14:30	0	0	0	0	0	0	0	0
1/12/2024 14:45	0	0	0	0	0	0	0	0
1/12/2024 15:00	0	0	0	0	0	0.01	0	0
1/12/2024 15:15	0	0	0	0	0	0	0	0
1/12/2024 15:30	0	0	0	0	0	0	0	0
1/12/2024 15:45	0	0	0	0	0	0.01	0	0
1/12/2024 16:00	0	0	0	0	0	0.02	0	0
1/12/2024 16:15	0	0	0	0	0	0.01	0	0
1/12/2024 16:30	0	0	0	0	0	0.03	0	0
1/12/2024 16:45	0	0	0	0	0	0.03	0	0.01
1/12/2024 17:00	0	0	0	0	0	0.01	0	0
1/12/2024 17:15	0	0	0	0	0	0	0	0
1/12/2024 17:30	0	0.1	0	0	0	0.03	0	0
1/12/2024 17:45	0	0.04	0	0.03	0	0.02	0	0.01
1/12/2024 18:00	0	0	0	0.01	0	0.01	0	0

Daily Readings - VOCs
 Data export
 01/12/2024 00:00:00 to 01/12/2024 23:59:00
 Averaging period: 15 minutes

Time	AMS-1	AMS-2	AMS-3	AMS-4	AMS-5	AMS-6	AMS-7	AMS-8
	VOC - AQS1 13032023-2241 (ppm)	VOC - AQS1 13032023-2244 (ppm)	VOC - AQS1 13032023-2240 (ppm)	VOC - AQS1 13032023-2238 (ppm)	VOC - AQS1 13032023-2239 (ppm)	VOC - AQS1 13032023-2237 (ppm)	VOC - AQS1 13032023-2243 (ppm)	VOC - AQS1 13032023-2242 (ppm)
1/12/2024 18:15	0	0	0	0.05	0	0	0	0.01
1/12/2024 18:30	0	0	0	0.04	0	0	0	0
1/12/2024 18:45	0	0	0	0.03	0	0.01	0	0
1/12/2024 19:00	0	0	0	0.03	0	0	0	0
1/12/2024 19:15	0	0	0	0.01	0	0	0	0
1/12/2024 19:30	0	0	0	0.03	0	0.01	0	0
1/12/2024 19:45	0	0	0	0.03	0	0.01	0	0
1/12/2024 20:00	0	0	0	0.02	0	0.01	0	0
1/12/2024 20:15	0	0	0	0.02	0	0.02	0	0.01
1/12/2024 20:30	0	0	0	0.02	0	0.02	0	0
1/12/2024 20:45	0	0	0	0.03	0	0.01	0	0
1/12/2024 21:00	0	0	0	0.01	0	0.01	0	0
1/12/2024 21:15	0	0	0	0.01	0	0	0	0
1/12/2024 21:30	0	0	0	0.01	0	0.01	0	0.01
1/12/2024 21:45	0	0	0	0.01	0	0.01	0	0
1/12/2024 22:00	0	0	0	0.01	0	0.01	0	0
1/12/2024 22:15	0	0	0	0.01	0	0.02	0	0
1/12/2024 22:30	0	0	0	0.02	0	0.02	0	0
1/12/2024 22:45	0	0	0	0.02	0	0.01	0	0
1/12/2024 23:00	0	0	0	0.01	0	0	0	0
1/12/2024 23:15	0	0	0	0.01	0	0.04	0	0
1/12/2024 23:30	0	0	0	0.01	0	0.03	0	0
1/12/2024 23:45	0	0	0	0	0	0.02	0	0

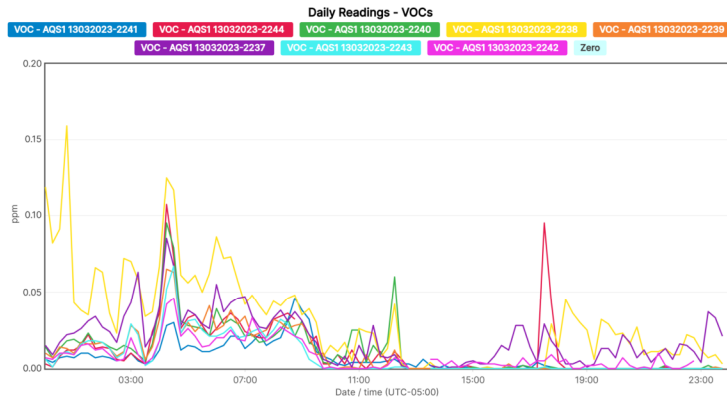


Target Analyte	Admin Level	Normal (green)	Alert Limit (yellow)	Response Limit (orange)	Action Limit (red)
Volatile Organic Compounds *	Between 0.3 and < 0.5 ppm as a 15 minute TWA	Below or equal to 0.5 ppm as a 15 minute TWA	>0.5 ppm and <=0.75 ppm as a 15 minute TWA or odors are observed	>0.75 to < 1.0 ppm as a 15 minute TWA or odors are observed	>=1 ppm as a 15 minute TWA or if odors are observed**

Daily Readings - PM10
 Data export
 01/12/2024 00:00:00 to 01/12/2024 23:59:00
 Averaging period: 15 minutes

Time	AMS-1	AMS-2	AMS-3	AMS-4	AMS-5	AMS-6	AMS-7	AMS-8
	PM10 - AQS1 13032023-2241 (µg/m³)	PM10 - AQS1 13032023-2244 (µg/m³)	PM10 - AQS1 13032023-2240 (µg/m³)	PM10 - AQS1 13032023-2238 (µg/m³)	PM10 - AQS1 13032023-2239 (µg/m³)	PM10 - AQS1 13032023-2237 (µg/m³)	PM10 - AQS1 13032023-2243 (µg/m³)	PM10 - AQS1 13032023-2242 (µg/m³)
1/12/2024 0:00	5.17	3.83	5.16	4.32	5.89	6.59	3.84	4.81
1/12/2024 0:15	5.1	3.75	4.84	4.3	5.85	6.43	4.02	5.02
1/12/2024 0:30	5.52	3.98	5.09	5.33	6.03	6.62	3.98	5.17
1/12/2024 0:45	5.71	4.2	5.51	5.03	6.29	7.31	4.12	5.49
1/12/2024 1:00	5.88	4.39	5.75	5.12	6.29	7.2	4.25	5.58
1/12/2024 1:15	5.6	4.09	5.38	4.6	6.04	6.8	3.87	5.37
1/12/2024 1:30	5.65	4.04	5.63	4.4	6.05	6.87	3.95	5.53
1/12/2024 1:45	6.06	4.12	5.82	4.58	6.17	6.85	4.63	5.75
1/12/2024 2:00	6.02	4.67	6.44	5.73	6.4	7.49	4.18	6.07
1/12/2024 5:00	6.12	4.63	7.5	7.57	11.58	6.91	4.34	5.97
1/12/2024 5:15	6.23	5.45	12.24	6.71	30.58	6.93	4.27	5.63
1/12/2024 5:30	7.31	5.08	18.02	7.32	42.29	6.83	4.34	5.5
1/12/2024 5:45	7.56	5.57	13.33	6.41	30.49	7.43	4.34	6.07
1/12/2024 6:00	6.49	4.87	25.25	10.33	10.72	7.68	4.56	6.5
1/12/2024 6:15	7.71	4.72	14.66	11.68	12.68	7.33	4.69	6.25
1/12/2024 6:30	6.45	4.7	10.51	9.08	19.15	7.57	4.3	6.04
1/12/2024 6:45	6.07	4.78	7.45	9.26	21.96	7.44	3.97	5.63
1/12/2024 7:00	10.52	4.74	9	7.67	18.99	7.49	4.42	5.75
1/12/2024 7:15	10.4	4.87	8.95	7.78	14.99	8.02	4.91	6.24
1/12/2024 7:30	9.6	5.08	6.86	6.53	9.11	8.42	5.1	6.49
1/12/2024 7:45	8.99	6.59	10.08	8.74	8.91	8.46	4.97	6.6
1/12/2024 8:00	9.86	10.23	10.33	9.27	10.12	10.99	5.81	7.72
1/12/2024 8:15	10.22	7.07	8.91	7.66	9.15	9.67	6.9	9.85
1/12/2024 8:30	11.03	7.81	9.6	8.08	11.99	10.69	7.3	10.55
1/12/2024 8:45	17.91	7.91	8.16	10.13	17.63	10.6	6.18	7.65
1/12/2024 9:00	20.7		8.34	8.09	12.97	8.4	5.31	6.87
1/12/2024 9:15	9.13	11.91	14.42	7.39	7.96	8.13	4.85	6.28
1/12/2024 9:30	8.4	6.06	14.27	6.83	6.64	8.1	4.36	5.81
1/12/2024 9:45	6.9	4.83	7.22	5.43	5.63	6.69	3.23	4.28
1/12/2024 10:00	100.48	4.9	6.08	6.41	5.91	7.67	3.54	4.65
1/12/2024 10:15	6.46	6.27	11.7	5.9	6.28	7.2	3.65	4.75
1/12/2024 10:30	6.57	7.6	10.76	6.68	6.66	8.11	4.04	5.26
1/12/2024 10:45	6.83	11.34	12.92	5.66	7.01	8.29	4.84	5.71
1/12/2024 11:00	7.54	6.29	11.92	7.74	7.34	8.83	4.73	5.93
1/12/2024 11:15	8.42	10.53	7.56	7.45	8.24	9.38	5.22	6.61
1/12/2024 11:30	20.14	10.21	15.01	7.27	8.48	9.32	5.68	7.97
1/12/2024 11:45	8.82	6.93	15.7	7.25	8.15	9.33	5.53	7.12
1/12/2024 12:00	9.33	6.76	19.52	7.84	8.92	9.56	6.2	7.59
1/12/2024 12:15	9.07	8.05	16.06	7.37	8.83	10.54	6.54	8.32
1/12/2024 12:30	5.89	5.02	6.23	5	6.81	7.49	4.61	5.93
1/12/2024 12:45	5.66	3.57	5.58	3.06	5.39	6.28	2.14	3.12
1/12/2024 13:00	7.26	3.7	5.21	2.79	5.7			
1/12/2024 13:15	5	4.05	5.96	2.96	6.02			
1/12/2024 13:30	4.57	3.9	5.16	3.47	5.6	10.23	3.61	4.52
1/12/2024 13:45	4.36	3.82	4.66	3.64	5.76	9.34	3.5	4.8
1/12/2024 14:00	4.75	3.43	4.11	3.1	5.73	6.85	3.18	4.41
1/12/2024 14:15	5.27	3.8	4.99	3.58	5.59	7	3.38	4.91
1/12/2024 14:30	6.03	4.44	5.38	3.3	5.9	7.04	3.64	4.67
1/12/2024 14:45	8.61	3.87	4.77	3.45	6.11	8.54	3.74	4.78
1/12/2024 15:00	6.16	4.69	5.82	4.02	6.18	12.81	4.81	5.35
1/12/2024 15:15	6.22	4.22	5.37	3.99	6.02	10.2	5.53	5.37
1/12/2024 15:30	5.76	3.88	5.07	3.7	5.89	8.93	4.02	5.28
1/12/2024 15:45	4.97	3.53	4.55	3.52	5.19	7.6	3.68	4.64
1/12/2024 16:00	5.34	3.86	5.08	3.65	5.31	6.8	4.32	4.7
1/12/2024 16:15	5.25	3.89	5.19	3.54	5.38	6.75	3.52	4.73
1/12/2024 16:30	5.27	3.8	5.12	3.36	5.29	7.21	3.42	4.75

Daily Readings - PM10
 Data export
 01/12/2024 00:00:00 to 01/12/2024 23:59:00
 Averaging period: 15 minutes

Time	AMS-1	AMS-2	AMS-3	AMS-4	AMS-5	AMS-6	AMS-7	AMS-8
	PM10 - AQS1 13032023-2241 (µg/m³)	PM10 - AQS1 13032023-2244 (µg/m³)	PM10 - AQS1 13032023-2240 (µg/m³)	PM10 - AQS1 13032023-2238 (µg/m³)	PM10 - AQS1 13032023-2239 (µg/m³)	PM10 - AQS1 13032023-2237 (µg/m³)	PM10 - AQS1 13032023-2243 (µg/m³)	PM10 - AQS1 13032023-2242 (µg/m³)
1/12/2024 16:45	6	3.76	5.09	3.64	5.74	7	4.45	5.27
1/12/2024 17:00	5.9	3.89	5.37	3.58	5.49	7.07	3.94	5.04
1/12/2024 17:15	6.07	4.33	6.09	4.43	5.73	7.63	4.05	7.43
1/12/2024 17:30	5.56	5.47	7.62	5.89	5.88	9.54	3.66	12.49
1/12/2024 17:45	6.3	5.21	7.32	6.09	6.44	8.94	3.93	6.93
1/12/2024 18:00	5.86	3.73	5.3	3.77	5.89	7.34	3.66	5.48
1/12/2024 18:15	5.07	3.22	4.37	3.3	5.38	9.12	3.15	4.98
1/12/2024 18:30	4.9	3.36	4.75	3.61	5.67	9.14	3.36	6.83
1/12/2024 18:45	5.07	3.62	5.06	3.76	5.4	11.39	3.15	6.45
1/12/2024 19:00	4.93	3.84	5.42	4.16	5.58	7.73	3.22	5.37
1/12/2024 19:15	5.31	5.38	7.32	4.15	5.54	7.36	3.33	5.21
1/12/2024 19:30	6.49	5.37	7.75	4.89	6.24	8.65	4.04	6.48
1/12/2024 19:45	7.86	5.85	8.64	5.4	7.01	10.46	4.76	7.61
1/12/2024 20:00	7.61	5.43	7.91	5.01	6.75	10.06	4.52	7.31
1/12/2024 20:15	7.81	7.25	10.44	6.34	7.05	9.7	4.83	7.88
1/12/2024 20:30	7.63	4.94	7.43	5.38	7.02	9.57	4.61	7.33
1/12/2024 20:45	7.83	4.76	7.23	4.76	7.1	8.44	4.14	6.61
1/12/2024 21:00	6.54	4.83	7.14	4.5	6.05	7.94	3.89	6.27
1/12/2024 21:15	6.8	4.53	6.71	4.3	6.55	7.71	3.87	6.21
1/12/2024 21:30	6.92	4.32	6.7	4.31	6.14	7.49	4.01	6.62
1/12/2024 21:45	7.04	4.37	6.88	4.42	6.18	8.42	4.07	6.55
1/12/2024 22:00	7.03	4.39	6.93	4.42	6.3	8.85	3.98	6.58
1/12/2024 22:15	6.92	4.19	6.87	4.38	6.05	8.27	3.89	6.64
1/12/2024 22:30	6.71	4.07	6.82	4.31	5.93	8.15	3.71	6.51
1/12/2024 22:45	7.39	4.35	7.34	4.41	6.04	7.75	3.84	7.22
1/12/2024 23:00	7.96	4.44	7.93	4.81		7.87	5.57	
1/12/2024 23:15	8.36	4.61	8.57	5.07	7.44	8.03	4.49	8.57
1/12/2024 23:30	8.78	4.89	9.07	5.18	7.89	8.55	4.61	
1/12/2024 23:45	9.33	5.16	9.81	5.5	7.26	9.02	4.95	11.8

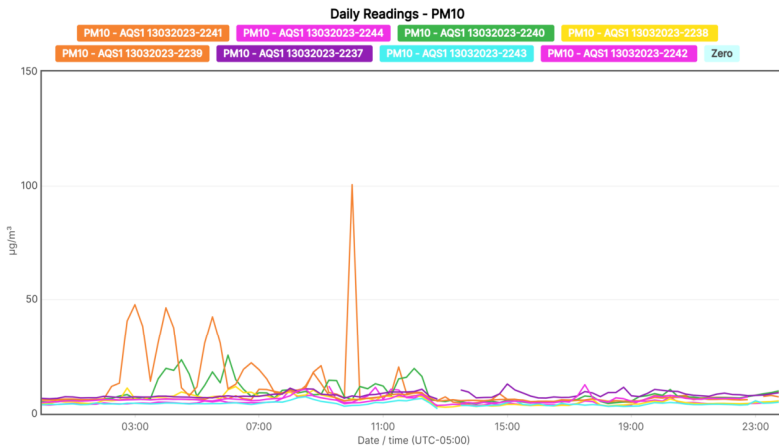

Target Analyte	Admin Level	Normal (green)	Alert Limit (yellow)	Response Limit (orange)	Action Limit (red)
Respirable particulate matter (PM10) *	>75 ug/m3 to 100 ug/m3 as a 15 minute TWA	<=100 ug/m3 as a 15 minute TWA	>100 ug/m3 and <=150 µg/m3 as a 15 minute TWA	See Alert Limit criteria	>150 µg/m3 as a 15 minute TWA