



Former Fulton MGP Site – Parcel III and Portion of Parcel IV

Daily CAMP Report

DATE: 09/20/25
FILE NO: 03.0034060.10

Daily Report No.: 1132

This Daily Air Monitoring Report summarizes perimeter air monitoring data collected during the referenced period in accordance with the Community Air Monitoring Plan (CAMP) which was included as part of the NYSDEC approved Remedial Action Work Plan for the Former Fulton Manufactured Gas Plant (MGP) Site – Parcel III and Portion of Parcel IV. Note: the information included in this daily summary is based on preliminary results and is subject to change based on data validation.

Reporting Period:	Saturday, September 20, 2025		
Weather	Temperature: 62.20 – 72.20°F	Precipitation: 0.00 in	Relative Humidity: 54.22%
	Wind Speed: 0.36 – 8.10 mph	Prevailing Wind Direction: E	
Concentrations detected above the Action Level	AMS-1: None	AMS-4: None	
	AMS-2: None	AMS-5: None	
	AMS-3: None	HH-1 (handheld readings along Degraw St): None	
Summary of Site Activities	Remediation-related Activities: - GZA continued CAMP monitoring 24 hours per day. - ENTACT excavated for final subgrade in Parcel III and transported five truckloads of non-hazardous swell to WM Fairless landfill for disposal. - ENTACT collected one ISS performance core. - ENTACT and performed general housekeeping		
Other	Eddy Nunez (WSP) visited the Site.		

Figure 1 – CAMP Station Locations





Former Fulton MGP Site – Parcel III and Portion of Parcel IV
Daily CAMP Report

DATE: 09/20/25
FILE NO: 03.0034060.10

Daily Report No.: 1132

TABLE 1 – OFFSITE HANDHELD AIR MONITORING DATA

DATE	TIME	LOCATION	TVOC ppm	PM ₁₀ mg/m ³	NOTES
09/20/2025	8:30 AM	HH-1	0.0	0.031	-
09/20/2025	10:30 AM	HH-1	0.0	0.022	-
09/20/2025	12:30 PM	HH-1	0.0	0.027	-
09/20/2025	2:30 PM	HH-1	0.0	0.030	-

TABLE 2 – ODOR AND VISIBLE DUST MONITORING LOG

DATE	TIME	NUISANCE ODORS (YES/NO)	VISIBLE DUST (YES/NO)	NOTES
09/20/2025	8:30 AM	NO	NO	-
09/20/2025	10:30 AM	NO	NO	-
09/20/2025	12:30 PM	NO	NO	-
09/20/2025	2:30 PM	NO	NO	-

Attachments:


Daily Data Summary – Air Monitoring Stations 1 through 5

Prepared by: Geder Mena
Construction Manager II


Reviewed by: Dan Amate
Associate Principal

AirLogics LLC Perimeter Air Monitoring Systems
Former Fulton MGP Site
Parcel III and Portion of Parcel IV
Brooklyn, NY

AMS 1

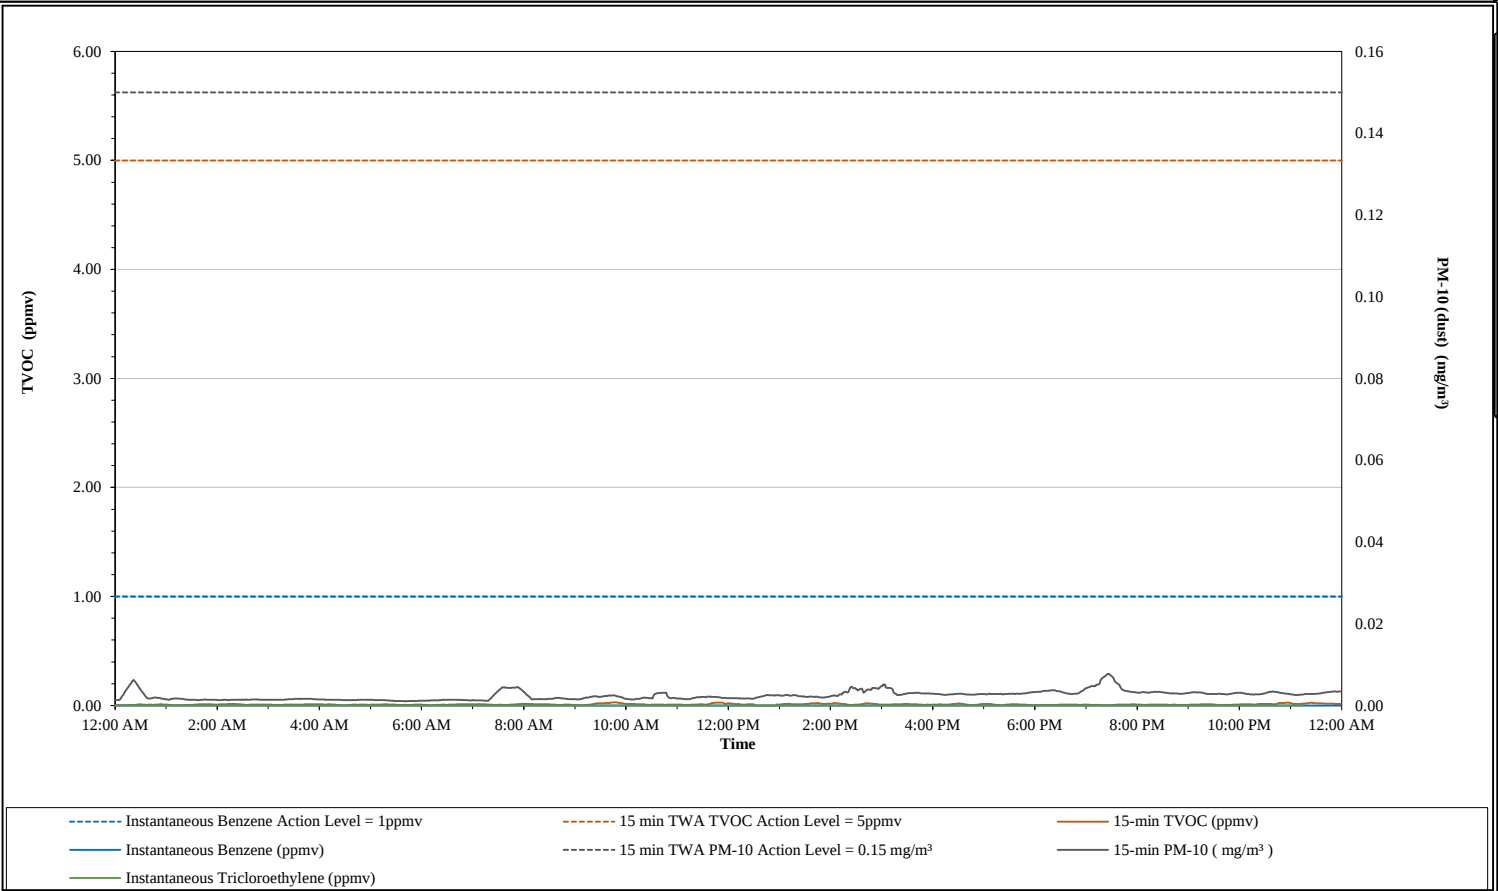


15 Minute TWA Data Summary Statistics				Instantaneous Compound Specific Data			
TVOC min =	0.00	PM-10 min =	0.00	Benzene min =	0.00	TCE min =	0.00
TVOC max =	0.03	PM-10 max =	0.01	Benzene max =	0.00	TCE max =	0.00
TVOC 24hr Avg =	0.01	PM-10 24hr Avg =	0.00				

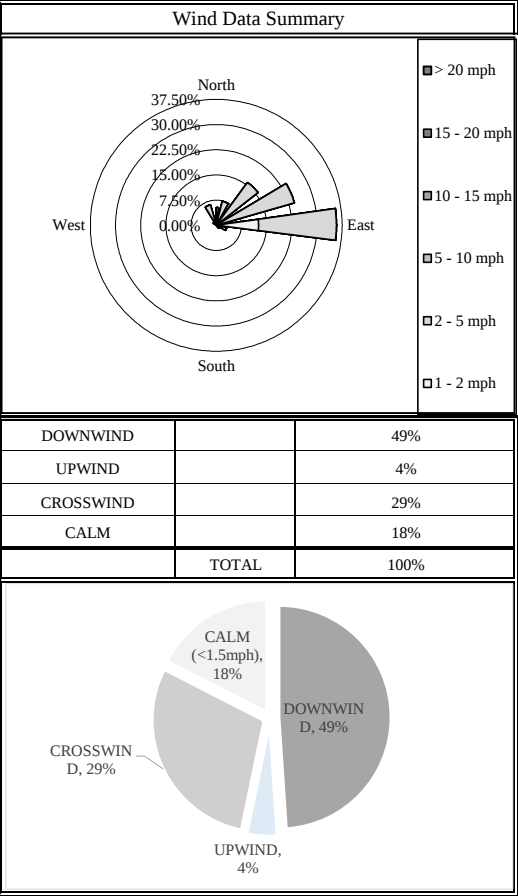


AirLogics LLC Perimeter Air Monitoring Systems
Former Fulton MGP Site
Parcel III and Portion of Parcel IV
Brooklyn, NY

AMS 2

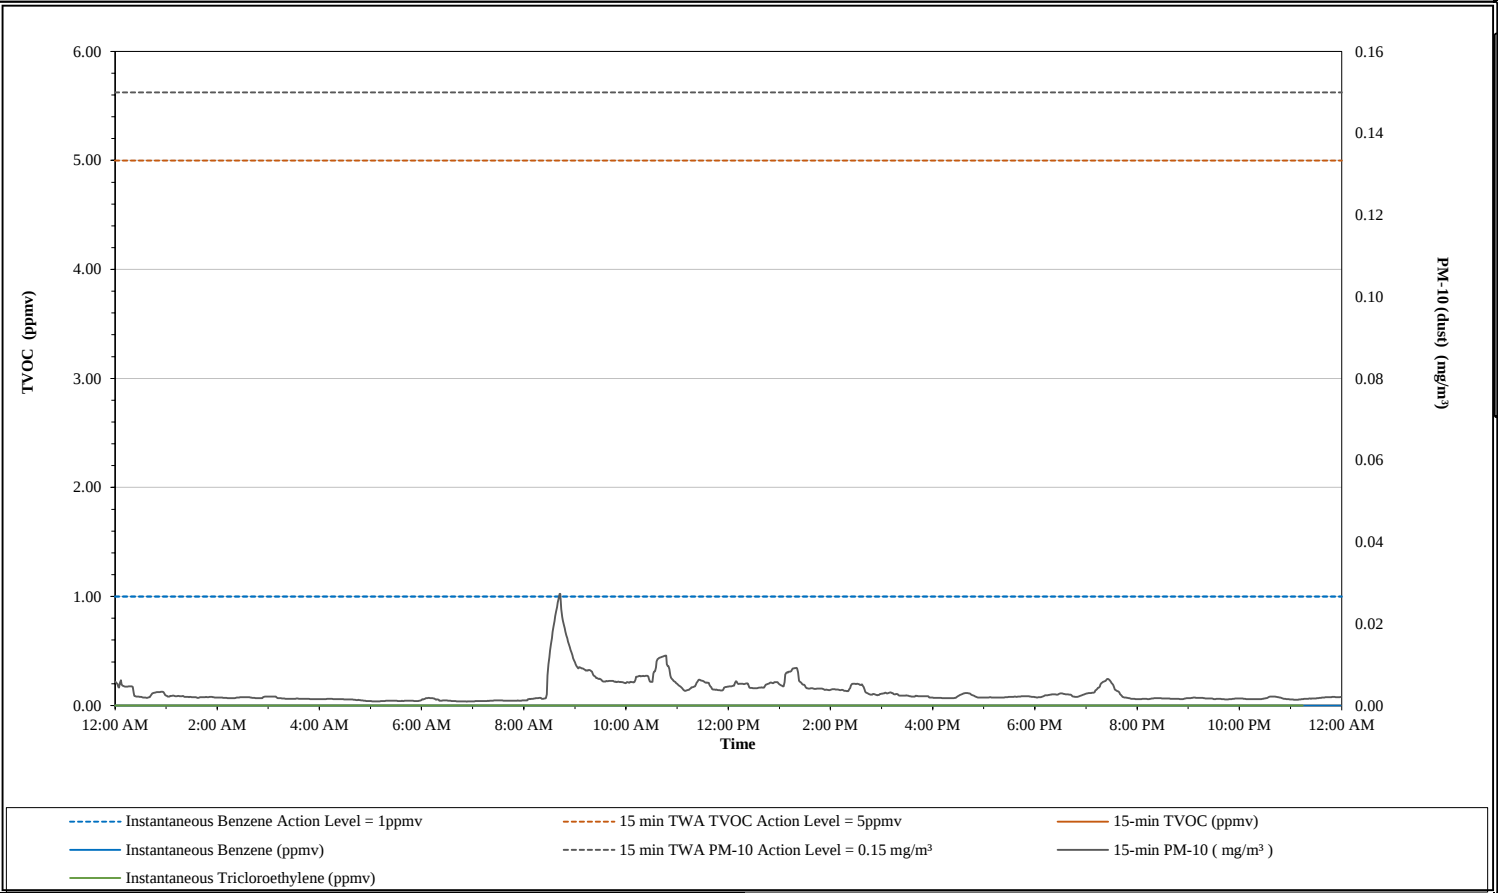


15 Minute TWA Data Summary Statistics				Instantaneous Compound Specific Data			
TVOC min =	0.00	PM-10 min =	0.00	Benzene min =	0.00	TCE min =	0.00
TVOC max =	0.00	PM-10 max =	0.03	Benzene max =	0.00	TCE max =	0.00
TVOC 24hr Avg =	0.00	PM-10 24hr Avg =	0.00				

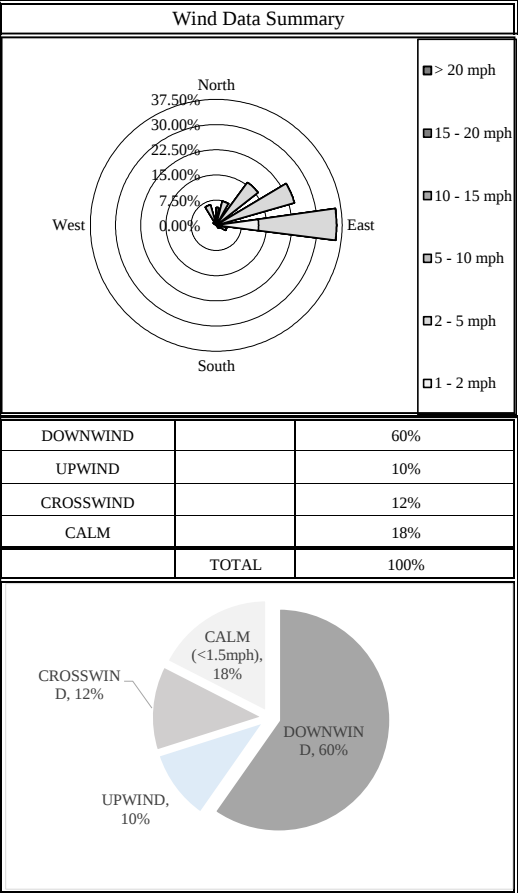


AirLogics LLC Perimeter Air Monitoring Systems
Former Fulton MGP Site
Parcel III and Portion of Parcel IV
Brooklyn, NY

AMS 3

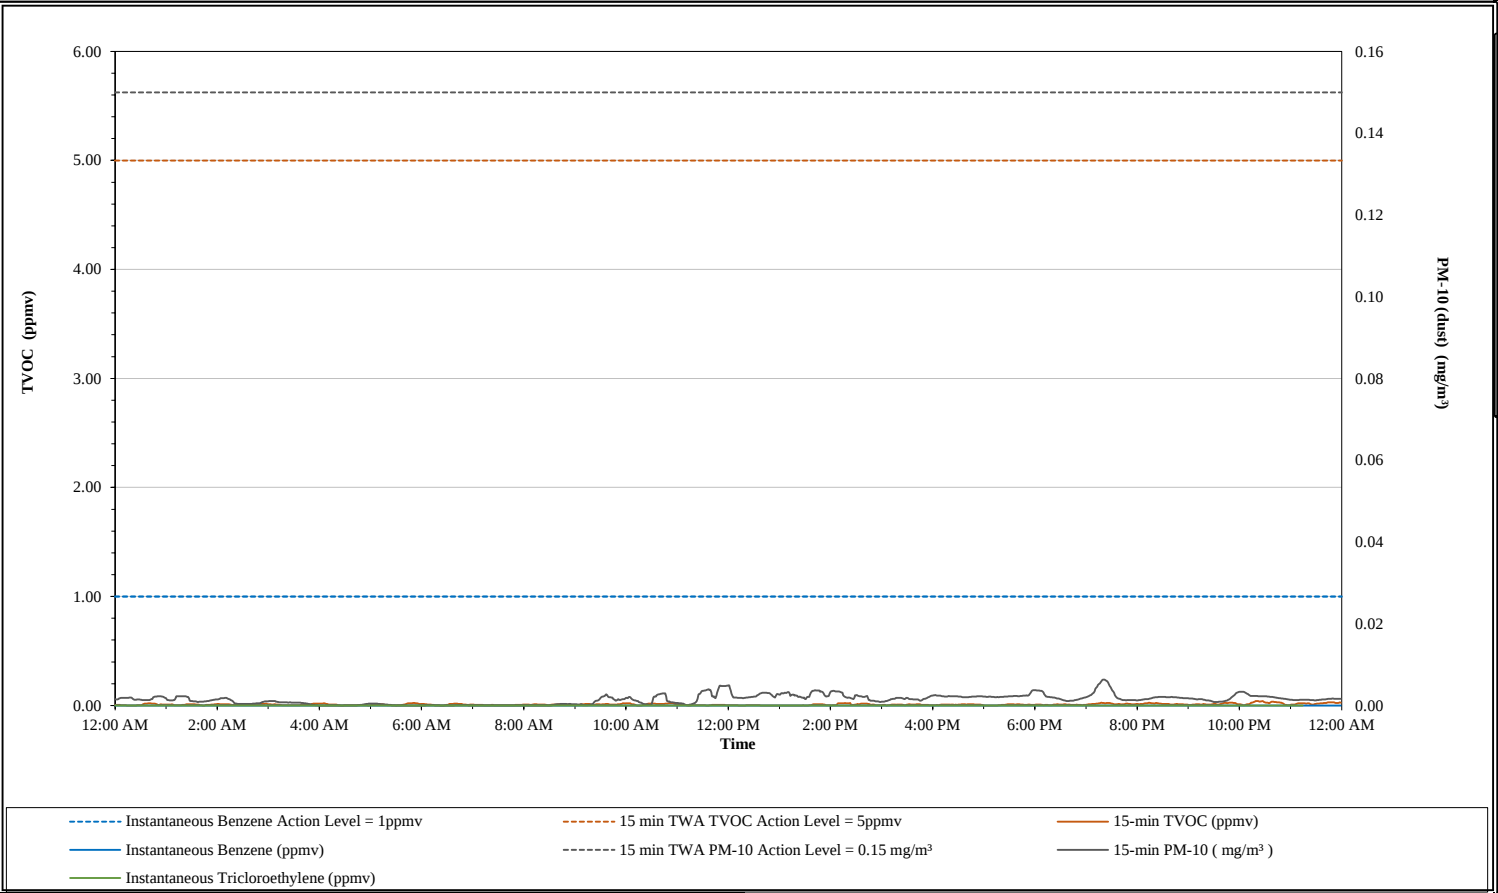


15 Minute TWA Data Summary Statistics				Instantaneous Compound Specific Data			
TVOC min =	0.00	PM-10 min =	0.00	Benzene min =	0.00	TCE min =	0.00
TVOC max =	0.04	PM-10 max =	0.01	Benzene max =	0.00	TCE max =	0.00
TVOC 24hr Avg =	0.01	PM-10 24hr Avg =	0.00				

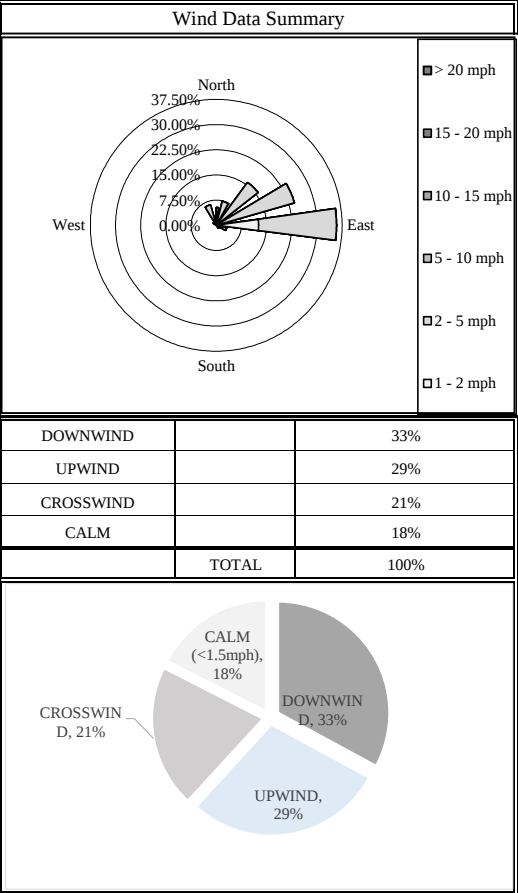


AirLogics LLC Perimeter Air Monitoring Systems
Former Fulton MGP Site
Parcel III and Portion of Parcel IV
Brooklyn, NY

AMS 4


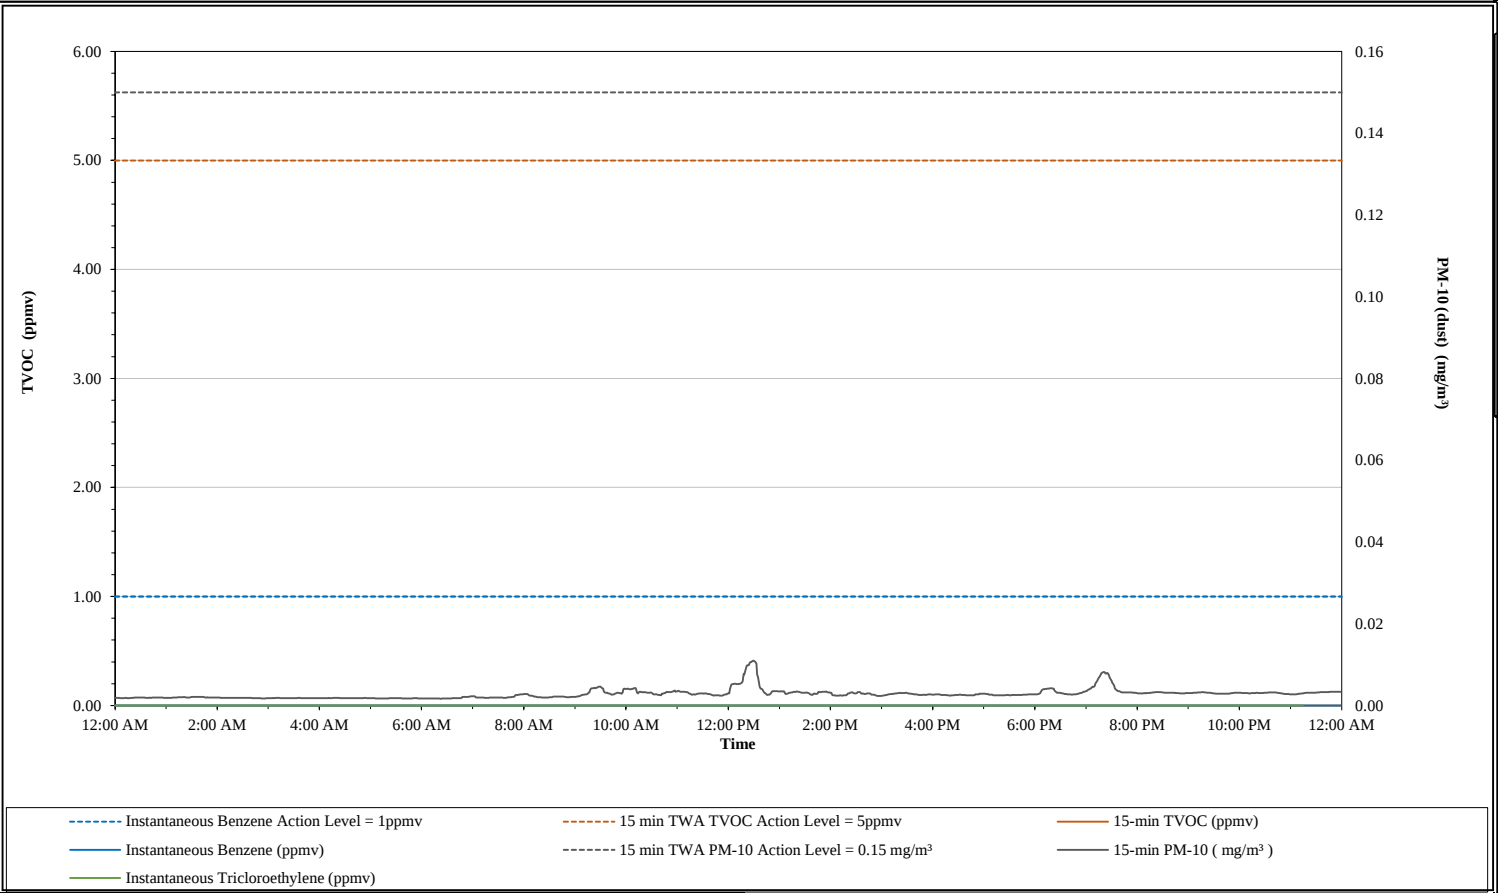


15 Minute TWA Data Summary Statistics				Instantaneous Compound Specific Data			
TVOC min =	0.00	PM-10 min =	0.00	Benzene min =	0.00	TCE min =	0.00
TVOC max =	0.00	PM-10 max =	0.01	Benzene max =	0.00	TCE max =	0.00
TVOC 24hr Avg =	0.00	PM-10 24hr Avg =	0.00				

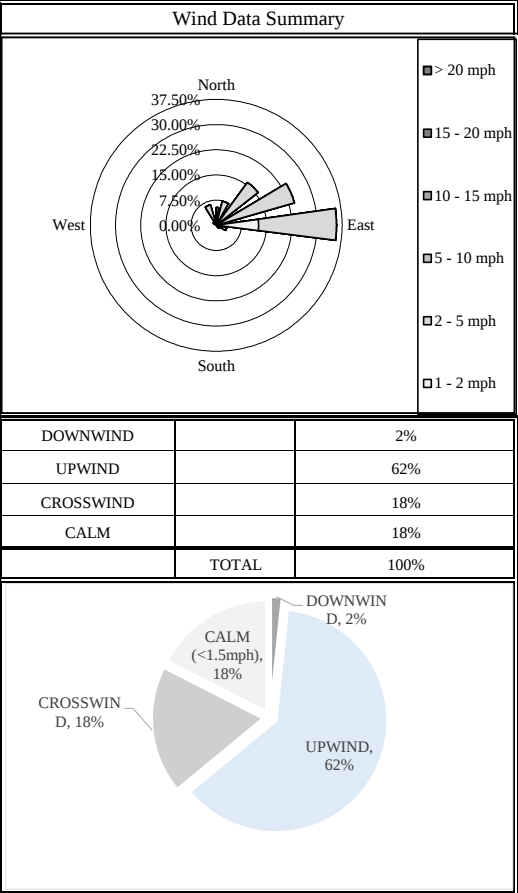

AirLogics LLC Perimeter Air Monitoring Systems
Former Fulton MGP Site
Parcel III and Portion of Parcel IV
Brooklyn, NY

AMS 5

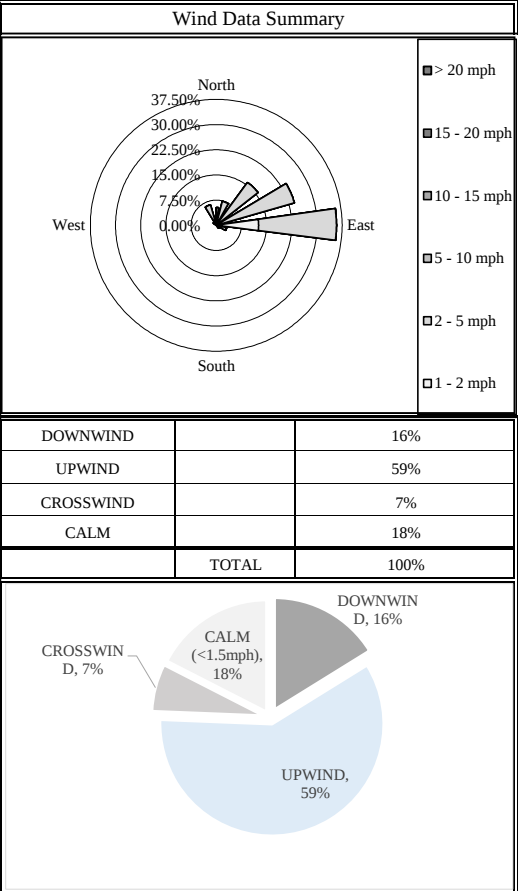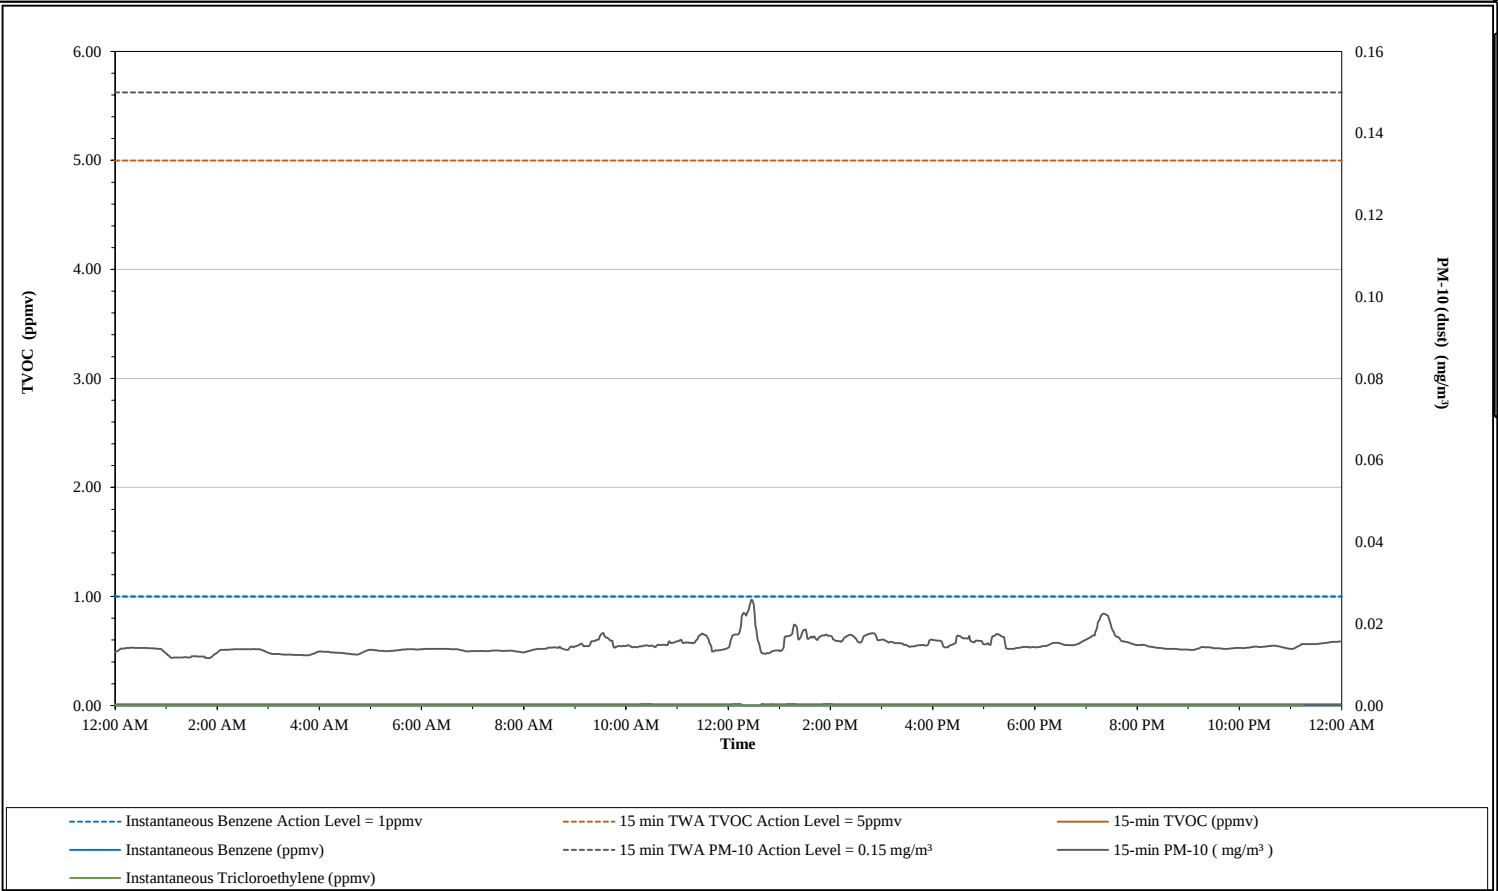

15 Minute TWA Data Summary Statistics				Instantaneous Compound Specific Data			
TVOC min =	0.01	PM-10 min =	0.01	Benzene min =	0.00	TCE min =	0.00
TVOC max =	0.01	PM-10 max =	0.03	Benzene max =	0.00	TCE max =	0.00
TVOC 24hr Avg =	0.01	PM-10 24hr Avg =	0.01				