

Table 1
Summary of DNAPL Gauging
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08		NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13
Date	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet
9/12/2014	0.10		6.90	NM	NM	NM	ND	13.70	6.55		12.00		14.50	Blebs		4.10	ND
9/25/2014	ND		5.30	NM	NM	NM	ND	14.30	1.46		3.00		12.10	ND		ND	ND
10/9/2014	ND		1.40	NM	NM	NM	ND	16.15	2.06		2.41		6.63	ND		ND	ND
10/16/2014	ND		ND	ND	ND	ND	ND	9.35	0.70		1.10		2.75	ND		0.70	ND
10/23/2014	ND		1.30	6.20	8.80	ND	ND	8.80	0.40		2.00		2.45	ND		0.60	ND
10/30/2014	ND		2.20	NM	NM	NM	ND	8.80	0.80		2.90		2.30	ND		0.70	ND
11/6/2014	ND		0.80	NM	NM	NM	ND	6.00	0.20		2.40		1.80	ND		0.50	ND
11/13/2014	ND		0.80	6.80	6.20	ND	ND	6.00	0.60		1.00		1.50	ND		ND	ND
11/20/2014	ND		0.50	1.90	1.70	ND	ND	7.50	ND		1.00		2.00	ND		ND	ND
11/26/2014	NM		NM	NM	NM	NM	ND	6.20	0.20		0.30		ND	ND		0.30	ND
12/4/2014	ND		1.30	0.60	0.50	ND	ND	7.20	4.30		1.20		3.40	ND		ND	ND
12/8/2014	NM		NM	NM	NM	NM	NM	3.20	NM		NM		NM	NM		NM	NM
12/11/2014	Blebs		0.60	Blebs	0.30	ND	ND	3.50	0.20		1.10		1.80	Blebs		Blebs	ND
12/15/2014	NM		NM	NM	NM	NM	NM	3.40	NM		NM		NM	NM		NM	NM
12/18/2014	ND		1.40	0.70	1.10	ND	ND	3.00	ND		ND		1.60	ND		ND	ND
12/24/2014	NM		NM	NM	NM	NM	ND	4.70	2.00		1.80		0.80	ND		ND	ND
12/31/2014	ND		2.20	0.50	0.60	ND	ND	6.30	0.60		0.60		3.10	ND		ND	ND
1/8/2015	Blebs		0.50	0.50	0.60	ND	ND	4.00	Blebs		0.20		1.00	ND		Blebs	ND
1/15/2015	Blebs		0.50	Blebs	0.30	ND	ND	5.70	Blebs		0.80		1.40	ND		0.05	ND
1/22/2015	ND		0.60	0.30	0.35	ND	ND	5.30	0.40		0.67		1.45	ND		ND	ND
1/29/2015	NM		0.90	NM	NM	NM	NM	5.10	ND		1.00		1.60	NM		NM	NM
2/19/2015	NM		NM	NM	NM	NM	NM	15.00	NM		NM		2.70	NM		NM	NM
2/23/2015	Blebs		1.20	NM	NM	NM	NM	8.30	Blebs		2.80		0.30	ND		Blebs	NM
2/27/2015	NM		NM	NM	NM	NM	NM	4.50	0.35		0.80		0.90	ND		Blebs	NM
3/3/2015	ND		2.10	NM	NM	NM	NM	5.40	Blebs		Blebs		0.70	ND		Blebs	ND
3/6/2015	NM		NM	NM	NM	NM	NM	4.00	NM		NM		1.00	NM		NM	NM
3/10/2015	NM		NM	NM	NM	NM	NM	4.00	0.50		1.20		Blebs	ND		Blebs	ND
3/13/2015	NM		NM	NM	NM	NM	NM	2.50	NM		NM		NM	NM		NM	NM
3/17/2015	NM		NM	NM	NM	NM	ND	5.50	0.50		1.10		1.75	ND		ND	ND
3/20/2015	NM		NM	NM	NM	NM	ND	3.80	0.70		0.50		1.10	ND		ND	ND
3/24/2015	NM		NM	NM	NM	NM	ND	2.20	0.80		0.60		1.80	ND		ND	ND
3/27/2015	NM		NM	NM	NM	NM	ND	3.80	1.90		1.20		1.90	ND		ND	ND
3/31/2015	NM		NM	NM	NM	NM	NM	6.10	NM		NM		NM	NM		NM	NM
4/3/2015	NM		NM	NM	NM	NM	ND	4.60	ND		ND		ND	ND		ND	ND
4/9/2015	NM		NM	NM	NM	NM	ND	1.00	ND		0.20		0.20	ND		ND	ND
4/15/2015	NM		NM	NM	NM	NM	ND	3.30	0.30		1.70		0.30	ND		0.10	ND
4/17/2015	NM		NM	NM	NM	NM	ND	5.50	ND		ND		5.00	ND		ND	ND
4/22/2015	ND		3.50	NM	NM	NM	ND	4.00	0.25		0.75		0.40	ND		ND	ND
4/24/2015	ND		1.00	NM	NM	NM	ND	3.30	0.40		1.00		0.60	ND		0.10	ND
4/29/2015	ND		1.50	NM	NM	NM	ND	4.00	0.60		1.10		0.80	ND		0.20	ND
5/11/2015	ND		0.50	NM	NM	NM	ND	3.30	0.90		2.40		0.80	ND		0.20	ND
5/15/2015	ND		0.80	NM	NM	NM	ND	3.80	1.10		4.00		0.90	ND		0.20	ND
5/19/2015	ND		1.20	NM	NM	NM	ND	6.11	0.60		0.25		3.40	ND		0.20	ND
5/22/2015	ND		1.80	NM	NM	NM	ND	6.70	0.70		0.25		3.70	ND		0.20	ND
5/26/2015	ND		2.10	NM	NM	NM	ND	6.70	1.00		0.60		0.80	ND		0.20	ND
5/29/2015	ND		0.20	NM	NM	NM	ND	5.75	1.20		0.75		2.20	ND		0.20	ND
6/2/2015	ND		1.00	NM	NM	NM	ND	5.40	0.60		0.90		1.67	ND		0.20	ND
6/5/2015	ND		0.30	NM	NM	NM	ND	3.60	0.80		1.10		1.00	ND		0.20	ND
6/9/2015	ND		0.70	NM	NM	NM	ND	4.45	0.80		2.25		3.50	ND		0.20	ND
6/12/2015	ND		0.75	NM	NM	NM	ND	3.82	1.30		0.50		1.20	ND		0.20	ND
6/16/2015	ND		0.75	NM	NM	NM	ND	3.40	ND		0.80		2.70	ND		0.20	ND
6/19/2015	ND		0.90	NM	NM	NM	ND	3.20	ND		0.80		4.00	ND		0.20	ND
6/23/2015	ND		1.00	NM	NM	NM	ND	3.50	ND		1.30		1.50	ND		0.20	ND
6/26/2015	ND		1.50	NM	NM	NM	ND	3.00	0.20		0.50		0.60	ND		0.20	ND
6/30/2015	ND		3.00	3.50	NM	NM	ND	3.80	0.40		0.40		1.20	ND		0.90	ND
7/3/2015	NM		3.40	NM	NM	NM	NM	2.00	NM		NM		NM	NM		NM	NM
7/7/2015	ND		0.80	NM	NM	NM	ND	5.30	0.30		0.70		2.10	ND		0.20	ND
7/9/2015	0.10		4.90	3.30	0.60	ND	ND	14.50	4.00		14.90		17.20	ND		4.00	ND
7/10/2015	ND		0.80	NM	NM	NM	ND	3.20	0.30		0.90		0.50	ND		0.20	ND
7/14/2015	ND		1.20	NM	NM	NM	ND	3.80	0.50		1.10		2.20	ND		0.20	ND
7/17/2015	ND		0.20	NM	NM	NM	ND	2.95	0.20		0.20		1.10	ND		0.20	ND
7/20/2015	ND		0.40	NM	NM	NM	ND	3.71	0.30		0.40		1.40	ND		0.20	ND
7/24/2015	ND		0.50	NM	NM	NM	ND	3.10	0.30		0.50		0.80	ND		0.20	ND
7/28/2015	ND		0.60	NM	NM	NM	ND	4.00	0.60		0.70		1.20	ND		0.20	ND
7/31/2015	ND		1.80	NM	NM	NM	ND	2.80	ND		0.90		1.90	ND		ND	ND
8/4/2015	ND		0.50	NM	NM	NM	ND	4.20	0.30		0.20		0.70	ND		0.20	ND
8/7/2015	ND		0.50	NM	NM	NM	ND	2.30	0.30		1.00		1.30	ND		0.20	ND
8/11/2015	ND		0.70	NM	NM	NM	ND	3.60	0.40		0.20		1.00	ND		0.20	ND
8/14/2015	ND		1.00	NM	NM	NM	ND	2.85	0.40		0.30		0.20	ND		0.20	ND
8/18/2015	ND		0.30	NM	NM	NM	ND	3.50	0.60		0.50		1.10	ND		0.20	ND
8/21/2015	ND		1.20	NM	NM	NM	ND	2.50	1.00		1.00		0.40	ND		0.20	ND
8/25/2015	ND		0.10	NM	NM	NM	ND	2.90	0.20		3.10		1.10	ND		ND	ND
8/27/2015	ND		0.10	NM	NM	NM	ND	3.10	ND		3.40		1.30	ND		ND	ND
9/4/2015	ND		ND	NM	NM	NM	ND	5.40	0.30		2.00		4.70	ND		ND	ND
9/8/2015	ND		ND	NM	NM	NM	ND	3.70	0.50		3.10		1.40	ND		ND	ND
9/10/2015	ND		0.50	NM	NM	NM	ND	3.20	0.20		0.50		2.10	ND		ND	ND
9/15/2015	ND		1.40	0.60	NM	NM	ND	4.30	1.10		1.10		2.70	ND		ND	ND
9/17/2015	ND		1.40	NM	NM	NM	ND	5.20	0.60		1.10		0.70	ND		ND	ND
9/22/2015	ND		1.50	1.30	NM	NM	ND	5.10	0								

Table 1
Summary of DNAPL Gauging
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13
Date	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet
2/2/2016	ND		0.20	NM	NM	NM	ND	5.00	0.20		0.30		1.10	ND		0.20	ND
2/5/2016	ND		0.20	NM	NM	NM	ND	2.50	0.30		0.50		0.90	ND		0.20	ND
2/8/2016	ND		ND	NM	NM	NM	ND	2.70	ND		0.50		0.80	ND		ND	ND
2/11/2016	ND		0.30	NM	NM	NM	ND	3.10	ND		0.20		0.50	ND		ND	ND
2/16/2016	ND		1.20	NM	NM	NM	ND	3.80	0.60		1.60		2.30	0.40		0.40	ND
2/18/2016	ND		1.10	NM	NM	NM	ND	2.10	0.70		1.80		0.50	0.40		0.40	ND
2/22/2016	ND		1.20	NM	NM	NM	ND	2.60	0.60		0.50		1.10	0.50		0.40	ND
2/26/2016	ND		1.50	NM	NM	NM	ND	3.10	0.90		1.10		1.80	0.40		0.50	ND
2/29/2016	ND		1.70	NM	NM	ND	ND	2.30	1.00		1.30		2.10	0.40		0.50	ND
3/3/2016	ND		1.80	NM	NM	ND	ND	2.60	1.70		1.70		0.80	0.40		0.50	ND
3/8/2016	ND		0.30	NM	NM	ND	ND	4.20	1.80		2.00		1.80	0.40		0.50	ND
3/11/2016	ND		0.90	NM	NM	ND	ND	3.00	1.80		1.20		1.10	0.40		0.50	ND
3/16/2016	ND		1.20	NM	NM	ND	ND	4.20	1.40		1.50		2.30	0.40		0.50	ND
3/18/2016	ND		1.40	NM	NM	ND	ND	2.30	1.40		1.60		0.90	0.40		0.50	ND
3/22/2016	ND		1.50	NM	NM	ND	ND	3.60	1.40		1.60		1.90	0.50		0.50	ND
3/25/2016	ND		1.50	NM	NM	ND	ND	3.30	1.40		1.70		2.20	0.50		0.50	ND
3/29/2016	ND		1.50	NM	NM	ND	ND	3.90	1.10		2.00		2.80	0.50		0.50	ND
4/1/2016	ND		1.90	NM	NM	ND	ND	3.00	1.80		1.90		1.20	0.50		0.50	ND
4/6/2016	ND		1.80	NM	NM	ND	ND	4.80	1.90		2.50		1.80	0.50		0.50	ND
4/8/2016	ND		1.50	NM	NM	ND	ND	2.10	ND		0.50		2.00	0.50		0.50	ND
4/11/2016	ND		1.70	NM	NM	ND	ND	4.00	0.30		1.10		3.20	0.50		0.50	ND
4/15/2016	NM		NM	NM	NM	NM	NM	4.20	NM		NM		NM	NM		NM	NM
4/18/2016	ND		2.00	NM	7.10	NM	ND	3.10	0.70		1.30		3.40	0.50		0.50	ND
4/22/2016	NM		NM	6.00	1.10	ND	ND	4.10	0.50		2.00		4.00	0.50		0.50	ND
4/26/2016	NM		NM	0.80	0.50	ND	ND	3.40	NM		NM		NM	NM		NM	NM
4/28/2016	NM		NM	0.80	0.50	ND	ND	3.20	0.50		0.10		2.90	0.50		0.50	ND
5/3/2016	NM		NM	0.90	0.70	ND	ND	1.50	0.80		0.80		1.75	0.50		0.50	ND
5/6/2016	NM		NM	NM	NM	NM	ND	3.50	ND		0.50		2.20	0.50		0.50	ND
5/10/2016	ND		ND	ND	NM	ND	ND	3.00	ND		0.50		1.50	0.50		0.50	ND
5/13/2016	ND		ND	ND	0.50	0.25	ND	5.50	ND		0.50		1.50	0.50		NM	NM
5/17/2016	NM		NM	4.00	NM	ND	ND	7.50	ND		0.30		18.00	ND		NM	ND
5/20/2016	ND		4.20	ND	0.30	NM	NM	3.00	NM		1.90		10.00	NM		NM	NM
5/24/2016	NM		NM	ND	0.50	0.50	ND	7.50	ND		0.50		10.50	NM		NM	NM
5/27/2016	NM		NM	ND	0.50	0.50	ND	ND	ND		0.50		7.50	NM		NM	NM
5/31/2016	NM		NM	ND	0.50	0.50	ND	3.00	ND		0.50		3.50	ND		1.00	ND
6/7/2016	NM		NM	NM	NM	NM	ND	10.00	0.60		0.70		3.00	0.50		0.50	ND
6/9/2016	NM		6.00	NM	NM	NM	ND	4.00	0.60		0.60		0.50	ND		ND	ND
6/14/2016	ND		6.00	NM	NM	NM	ND	6.00	0.50		3.00		5.20	ND		ND	ND
6/17/2016	ND		6.00	NM	ND	ND	ND	6.00	NM		NM		NM	NM		ND	ND
6/21/2016	ND		3.10	NM	NM	NM	ND	11.20	NM		NM		NM	NM		NM	NM
7/6/2016	ND		2.50	NM	ND	ND	ND	7.00	2.00		1.00		5.00	ND		5.00	ND
7/8/2016	NM		NM	NM	NM	NM	NM	NM	NM		NM		20.20	NM		15.10	NM
7/12/2016	ND		3.00	NM	NM	Nm	ND	12.00	0.50		1.00		7.00	ND		10.00	ND
7/15/2016	ND		1.50	NM	NM	NM	ND	6.00	0.50		1.00		15.00	ND		15.00	ND
7/19/2016	ND		0.50	NM	NM	NM	ND	7.00	0.50		1.50		12.00	ND		4.50	ND
7/22/2016	ND		0.50	NM	NM	NM	ND	2.50	0.70		0.80		10.00	ND		2.50	ND
7/26/2016	NM		NM	NM	NM	NM	ND	5.50	0.90		2.00		6.00	ND		3.00	ND
7/29/2016	ND		0.70	NM	NM	NM	ND	3.00	0.50		2.00		1.00	ND		1.50	ND
8/2/2016	ND		0.80	NM	NM	NM	ND	4.50	0.50		1.80		1.00	ND		2.00	ND
8/5/2016	ND		1.00	NM	NM	NM	ND	3.00	0.50		2.00		1.50	ND		NM	ND
8/9/2016	ND		0.40	NM	NM	NM	NM	5.00	0.50		1.00		0.80	ND		2.00	ND
8/12/2016	ND		1.50	NM	NM	NM	ND	3.20	ND		0.50		1.00	ND		0.80	ND
8/17/2016	ND		1.70	NM	NM	NM	ND	4.50	0.80		3.30		1.70	1.50		0.30	ND
8/19/2016	ND		2.30	NM	NM	NM	NM	2.50	0.80		0.10		0.30	NM		0.30	ND
8/23/2016	ND		0.20	NM	NM	NM	ND	4.00	ND		0.50		1.00	1.50		0.50	ND
8/25/2016	ND		0.50	NM	NM	NM	ND	2.20	ND		0.50		1.00	1.50		0.70	ND
8/30/2016	ND		1.00	NM	NM	NM	ND	5.30	0.20		0.50		0.90	1.50		0.50	ND
9/2/2016	ND		1.50	NM	NM	NM	ND	3.30	0.20		0.40		1.00	1.10		0.50	ND
9/6/2016	ND		0.30	NM	NM	NM	ND	4.80	ND		1.50		1.60	0.50		0.80	ND
9/9/2016	ND		0.70	NM	NM	NM	ND	3.50	ND		1.20		1.00	0.60		0.70	ND
9/12/2016	NM		NM	NM	NM	NM	ND	3.50	0.30		1.70		2.40	0.50		1.10	ND
9/15/2016	ND		1.70	NM	NM	NM	ND	2.80	1.70		2.10		1.10	1.10		1.30	ND
9/21/2016	ND		1.90	NM	NM	NM	ND	5.50	0.40		2.20		1.80	1.00		1.50	ND
9/26/2016	ND		2.20	NM	NM	NM	ND	4.00	ND		2.00		2.00	0.50		1.00	ND
9/29/2016	ND		1.00	NM	NM	NM	ND	4.50	ND		0.70		1.30	0.50		1.00	ND
10/4/2016	ND		2.80	NM	NM	NM	ND	6.50	ND		2.90		2.50	0.20		4.40	ND
10/7/2016	NM		3.10	NM	NM	NM	NM	6.20	NM		NM		2.80	NM		NM	NM
10/11/2016	ND		0.30	NM	NM	NM	ND	4.10	ND		2.50		0.50	ND		8.80	ND
10/14/2016	NM		NM	NM	NM	NM	NM	3.20	NM		3.30		NM	NM		5.50	NM
10/17/2016	ND		1.00	NM	NM	NM	ND	3.50	ND		0.30		0.80	0.50		2.40	ND
10/21/2016	ND		ND	NM	NM	NM	ND	3.90	ND		0.70		1.20	NM		2.80	ND
10/26/2016	ND		ND	NM	NM	NM	ND	7.10	ND		0.90		1.80	NM		9.90	ND
10/31/2016	ND		2.70	NM	NM	NM	ND	5.00	ND		0.30		2.60	NM		10.00	ND
11/3/2016	ND		3.10	NM	NM	NM	ND	2.60	0.50		0.80		0.90	NM		10.00	ND
11/7/2016	ND		2.00	NM	NM	NM	ND	2.50	0.30		0.90		1.20	NM		10.00	ND
11/10/2016	ND		1.50	NM	NM	NM	ND	2.90	0.30		1.10		1.80	NM		10.00	ND
11/16/2016	ND		NM	NM	NM	NM	ND	5.90	0.30		0.90		0.50	ND		12.80	ND
11/18/2016</																	

Table 1
Summary of DNAPL Gauging
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																	
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13	
Date	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	
1/25/2017	ND		2.20	NM	NM	NM	ND	3.00	1.00			NM		2.00	NM		4.00	ND
1/27/2017	ND		2.00	NM	NM	NM	ND	5.00	1.00			NM		1.00	NM		7.10	ND
1/30/2017	ND		1.20	NM	NM	NM	ND	5.20	1.00			NM		1.50	NM		6.80	ND
2/1/2017	ND		3.00	NM	NM	NM	ND	5.00	1.00			NM		2.00	NM		4.60	ND
2/3/2017	ND		ND	NM	NM	NM	ND	4.80	1.00			NM		2.50	NM		5.10	ND
2/6/2017	ND		1.50	NM	NM	NM	ND	7.50	1.00			NM		2.50	NM		2.50	ND
2/8/2017	ND		1.00	NM	NM	NM	ND	5.00	1.50			NM		3.00	NM		1.50	ND
2/10/2017	ND		2.00	NM	NM	NM	ND	5.50	1.50			NM		1.50	NM		3.00	ND
2/14/2017	ND		3.00	NM	NM	NM	ND	7.00	1.50			NM		2.00	NM		5.00	ND
2/15/2017	ND		1.00	NM	NM	NM	ND	4.00	1.70			NM		1.50	NM		4.00	ND
2/17/2017	ND		0.50	NM	NM	NM	ND	4.00	1.70			NM		1.70	NM		3.00	0.30
2/21/2017	ND		1.00	NM	NM	NM	ND	6.60	1.70			NM		2.00	NM		5.00	0.50
2/22/2017	ND		1.00	NM	NM	NM	ND	3.50	1.70			NM		2.00	NM		4.00	0.50
2/24/2017	ND		1.00	NM	NM	NM	ND	5.50	1.70			NM		2.00	NM		4.00	1.00
2/27/2017	ND		1.00	NM	NM	NM	ND	5.70	1.70			NM		2.00	NM		3.50	0.80
3/1/2017	ND		1.00	NM	NM	NM	ND	4.00	1.70			NM		0.20	NM		2.50	0.20
3/3/2017	ND		1.00	NM	NM	NM	ND	4.00	1.00			NM		0.30	NM		2.50	0.20
3/6/2017	ND		1.00	NM	NM	NM	ND	5.00	2.00			NM		0.40	NM		3.50	0.30
3/8/2017	ND		1.00	NM	NM	NM	ND	5.00	3.00			NM		0.50	NM		3.00	0.50
3/13/2017	ND		1.00	NM	NM	NM	ND	7.00	2.50			NM		0.50	NM		4.50	0.50
3/15/2017	ND		2.00	NM	NM	NM	ND	5.00	0.80			NM		0.80	NM		2.50	0.50
3/17/2017	ND		ND	NM	NM	NM	ND	6.00	NM			NM		ND	NM		2.00	0.50
3/22/2017	ND		4.00	NM	NM	NM	ND	7.00	2.00			NM		1.00	NM		7.00	0.50
3/24/2017	ND		1.00	NM	NM	NM	ND	7.50	2.00			NM		1.00	NM		NM	0.50
3/29/2017	ND		1.00	NM	NM	NM	ND	7.00	2.00			NM		1.00	NM		5.00	0.50
3/30/2017	ND		1.00	NM	NM	NM	ND	2.00	2.00			NM		1.00	NM		2.50	0.50
3/31/2017	ND		1.00	NM	NM	NM	ND	3.00	2.50			NM		1.00	NM		0.50	0.50
4/3/2017	ND		1.00	NM	NM	NM	ND	7.00	NM			NM		1.50	NM		1.50	1.00
4/5/2017	ND		1.00	NM	NM	NM	ND	4.00	1.00			NM		1.50	NM		1.00	0.50
4/7/2017	ND		1.00				ND	2.00	4.00				ND	1.00		4.00	1.50	0.50
4/10/2017	ND		0.50				ND	7.00	2.00				0.50	1.00		4.50	2.00	0.50
4/12/2017	ND		0.40				ND	6.00	1.00				0.50	0.50		4.00	0.90	0.50
4/14/2017	ND		0.40				ND	4.20	1.00				0.70	1.00		4.00	1.00	0.30
4/18/2017	ND		ND				ND	7.00	0.30				0.50	1.50		5.00	0.50	0.40
4/21/2017	ND		ND				ND	3.00	1.50				0.50	1.50		5.00	0.50	0.40
4/24/2017	0.10		ND				ND	8.00	0.30				0.60	0.20		5.00	0.50	0.50
4/26/2017	0.10		2.00				ND	4.00	1.00				0.20	1.00		5.00	0.20	1.00
4/28/2017	0.10		1.00				ND	3.50	0.40				0.50	1.00		5.00	0.50	0.50
5/1/2017	0.10		0.70				ND	6.00	0.50				0.50	1.00		2.50	2.00	1.00
5/3/2017	ND		0.40				ND	9.00	1.00				0.40	1.00		5.00	1.00	0.50
5/5/2017	ND		0.50				ND	3.00	1.00				0.50	2.50		2.50	1.00	0.70
5/8/2017	ND		0.70				ND	3.50	0.70				0.50	1.00		5.00	1.00	0.80
5/10/2017	ND		0.70				ND	4.00	0.80				0.50	0.80		3.50	1.50	2.00
5/12/2017	ND		0.80				ND	2.00	0.80				0.50	1.00		6.00	1.00	0.60
5/16/2017	ND		0.50				ND	6.00	ND				0.20	0.50		2.00	1.00	0.80
5/19/2017	ND		0.50				ND	2.00	0.40				0.00	1.50		0.50	2.50	0.60
5/22/2017	ND		0.30				ND	5.00	0.80				0.00	0.80		7.50	3.00	1.00
5/25/2017	ND		0.50				ND	7.00	1.00				0.00	0.80		4.50	1.00	0.20
5/31/2017	NM		ND				ND	3.50	ND				1.00	ND		3.00	1.50	ND
6/1/2017	NM		0.80				ND	5.00	ND				0.00	0.20		3.00	1.00	1.50
6/5/2017	NM		1.00				ND	4.00	0.40				0.00	1.50		0.50	2.50	0.80
6/7/2017	NM		0.30				ND	2.00	1.50				0.00	1.50		4.50	3.50	1.00
6/9/2017	NM		0.50				ND	3.00	0.20				0.00	1.20		4.00	0.60	1.50
6/12/2017	NM		0.80				ND	3.50	2.00				0.00	1.00		3.50	0.80	0.40
6/14/2017	NM		1.00				ND	2.00	1.00				0.60	0.80		1.30	1.50	0.50
6/16/2017	NM		0.30				ND	2.00	1.00				0.60	1.00		0.50	2.00	0.50
6/19/2017	NM		0.50				ND	3.00	1.20				0.60	1.20		3.20	0.50	1.00
6/21/2017	NM		ND				ND	2.00	0.60				0.40	1.50		0.70	2.50	0.80
6/23/2017	NM		0.50				ND	3.00	1.00				0.20	1.00		5.00	1.00	0.50
6/26/2017	NM		2.00				ND	3.50	1.00				1.00	0.80		5.00	1.00	2.00
6/28/2017	NM		0.60				ND	3.00	1.00				1.00	1.00		4.00	4.00	0.40
6/30/2017	NM		0.80				ND	3.00	1.00				1.00	1.00		3.50	0.50	0.60
7/5/2017	NM		1.00				ND	3.50	1.00				0.00	2.00		3.00	0.80	0.60
7/7/2017	NM		1.00				ND	2.00	1.00				0.40	1.00		2.00	1.00	0.80
7/10/2017	NM		0.50				ND	2.50	0.30				0.40	1.00		3.50	0.50	1.30
7/12/2017	NM		0.80				ND	3.00	0.60				0.50	1.50		3.00	0.60	0.30
7/14/2017	NM		2.00				ND	3.00	0.80				0.60	2.00		4.00	0.60	0.60
7/17/2017	NM		0.60				ND	3.50	2.00				1.50	1.00		6.00	2.00	1.00
7/19/2017	NM		1.00				ND	3.00	2.00				1.50	2.00		4.50	0.80	1.50
7/21/2017	NM		2.00				ND	3.50	2.00				1.60	2.00		5.00	1.00	1.70
7/24/2017	NM		1.00				ND	4.00	2.00				NM	2.00		6.00	2.00	2.00
7/26/2017	NM		1.40				ND	4.50	2.00				1.80	2.00		6.00	1.00	1.30
7/31/2017	NM		2.00				ND	5.00	1.00				0.50	0.50		6.00	4.00	2.00
8/2/2017	NM		1.00				ND	4.00	1.00				0.80	1.30		6.00	0.50	0.80
8/4/2017	NM		1.40				ND	3.00	2.00				0.60	0.70		4.50	2.00	0.80

Table 1
Summary of DNAPL Gauging
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13
Date	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet
10/13/2017	NM		1.00				ND	3.50	1.00			0.60	0.50		6.00	2.00	1.30
10/16/2017	NM		1.50				ND	4.50	1.40			0.90	0.90		6.00	0.30	1.50
10/18/2017	NM		1.80				ND	5.00	1.60			1.20	1.10		4.50	0.60	1.40
10/201/17	NM		2.20				ND	4.50	1.80			1.40	1.30		5.00	0.70	1.80
10/23/2017	NM		0.40				ND	3.50	2.00			1.80	1.50		5.00	1.00	2.00
10/25/2017	NM		0.50				ND	4.50	0.20			0.20	0.20		5.00	1.10	2.00
10/27/2017	NM		0.60				ND	3.50	0.50			0.40	0.40		4.50	1.60	0.30
10/30/2017	NM		0.80				ND	3.00	0.50			0.70	0.60		5.00	1.70	0.40
11/1/2017	NM		1.00				ND	NM	0.70			0.80	0.70		4.50	1.90	0.60
11/3/2017	NM		1.20				ND	5.50	0.90			1.00	0.90		5.00	2.00	0.70
11/6/2017	NM		1.50				ND	4.30	1.10			1.30	1.20		4.50	0.20	0.90
11/8/2017	NM		1.70				ND	3.50	1.20			1.50	1.30		4.00	0.40	1.00
11/10/2017	NM		2.00				ND	3.70	1.30			1.60	1.40		3.50	0.60	1.10
11/13/2017	NM		0.30				ND	4.00	1.40			1.70	1.60		3.00	0.80	1.20
11/15/2017	NM		0.50				ND	3.20	1.50			1.80	1.70		4.00	1.00	1.30
11/17/2017	NM		0.70				ND	3.00	1.70			2.00	1.90		3.50	1.10	1.40
11/20/2017	NM		0.90				ND	3.00	2.00			0.20	2.20		4.00	1.30	1.60
11/22/2017	NM		1.00				ND	3.80	0.20			0.30	0.20		3.00	1.50	1.70
11/27/2017	NM		1.30				ND	5.00	0.40			0.60	0.50		4.50	0.30	0.40
11/29/2017	NM		1.80				ND	3.60	0.50			0.70	0.50		3.50	0.70	0.50
12/1/2017	NM		0.40				ND	3.00	0.80			1.40	0.90		3.50	1.00	0.80
12/4/2017	NM		0.70				ND	3.80	1.00			0.30	1.10		3.00	0.20	1.00
12/6/2017	NM		0.90				ND	3.70	1.10			0.50	1.30		3.30	0.40	1.10
12/8/2017	NM		1.10				ND	3.20	1.30			0.70	1.40		3.40	0.60	1.30
12/11/2017	NM		1.40				ND	3.50	1.60			1.00	1.70		NM	0.90	1.50
12/13/2017	NM		1.70				ND	3.20	1.80			1.20	1.90		4.00	1.00	1.60
12/15/2017	NM		1.80				ND	3.20	2.00			1.40	2.00		3.70	1.20	1.70
12/18/2017	NM		0.30				ND	4.20	0.30			1.70	0.20		4.50	1.50	2.00
12/20/2017	NM		0.50				ND	3.20	0.50			2.00	0.40		4.20	1.70	0.30
12/22/2017	NM		0.70				ND	3.00	0.70			0.20	0.60		4.00	1.90	0.50
12/27/2017	NM		1.10				ND	5.00	0.90			0.50	1.00		4.50	0.40	0.80
12/29/2017	NM		1.40				ND	3.50	1.00			0.70	1.20		4.00	0.60	1.00
1/8/2018	NM		2.50				ND	10.00	2.00			1.50	2.00		11.00	1.80	2.00
1/10/2018	NM		2.70				ND	3.50	2.20			1.70	2.20		5.00	2.00	2.20
1/12/2018	NM		3.10				ND	3.50	0.30			0.30	0.20		4.30	0.30	0.20
1/15/2018	NM		3.50				ND	3.50	0.60			0.50	0.50		4.50	0.50	0.40
1/17/2018	NM		0.30				ND	3.00	0.80			0.70	0.80		4.00	0.70	0.60
1/19/2018	NM		0.50				ND	3.50	1.00			0.90	1.00		4.30	0.90	0.80
1/22/2018	NM		0.70				ND	3.70	1.30			1.20	1.30		4.30	1.10	1.10
1/24/2018	NM		0.90				ND	3.20	1.50			1.50	1.50		4.00	1.30	1.30
1/26/2018	NM		1.10				ND	3.50	1.70			1.70	1.60		4.00	1.50	1.50
1/29/2018	NM		1.30				ND	3.70	2.00			2.00	1.80		4.50	0.30	0.30
1/31/2018	NM		1.50				ND	3.00	0.30			0.30	2.00		4.00	0.50	0.50
2/2/2018	NM		1.70				ND	3.00	0.50			0.40	0.30		4.00	0.40	0.60
2/5/2018	NM		2.00				ND	3.20	0.70			0.70	0.40		3.50	0.90	0.80
2/7/2018	NM		0.30				ND	3.00	1.00			1.00	0.70		3.00	1.00	1.00
2/9/2018	NM		0.40				ND	3.00	1.10			1.20	0.90		3.50	1.20	1.20
2/12/2018	NM		0.70				ND	4.00	1.40			1.50	1.10		4.50	1.50	1.50
2/19/2018	NM		1.50				ND	4.00	0.30			0.30	1.80		4.80	0.30	0.20
2/21/2018	NM		1.70				ND	3.00	0.50			0.50	2.00		4.00	0.50	0.40
2/23/2018	NM		1.90				ND	3.00	0.70			0.70	0.20		4.00	0.70	0.60
2/26/2018	NM		2.10				ND	4.00	1.00			1.00	0.40		4.50	0.90	0.70
2/28/2018	NM		0.20				ND	3.50	1.10			1.20	0.50		4.00	1.00	0.80
3/2/2018	NM		0.30				ND	3.00	1.20			1.30	0.60		4.00	1.10	0.90
3/5/2018	NM		1.70				NM	2.25	NM			NM	NM		NM	NM	0.80
3/9/2018	NM		1.10				ND	3.80	0.55			0.50	0.50		3.70	0.40	0.60
3/12/2018	NM		1.10				ND	5.30	0.70			0.35	0.30		3.60	0.35	0.50
3/14/2018	NM		1.30				ND	7.30	0.80			NM	0.35		2.80	1.10	0.50
3/16/2018	NM		0.90				ND	5.80	0.50			0.75	0.80		3.40	0.40	1.50
3/19/2018	NM		1.30				ND	5.20	0.60			0.80	0.80		2.10	0.35	0.60
3/23/2018	NM		1.20				ND	4.80	0.30			1.00	1.00		2.10	0.80	0.75
3/26/2018	NM		1.40				ND	2.40	0.30			0.85	0.50		1.30	0.90	0.55
3/28/2018	NM		0.90				ND	1.80	0.00			0.90	0.50		2.00	0.60	0.60
3/30/2018	NM		1.00				ND	1.70	0.10			0.60	0.60		0.90	0.70	0.60
4/2/2018	NM		1.00				ND	2.40	0.10			0.60	0.70		1.20	0.50	0.70
4/4/2018	NM		1.10				ND	1.50	NM			0.40	0.70		0.90	0.60	0.60
4/6/2018	NM		0.60				ND	1.60	NM			0.40	0.70		0.70	0.60	0.60
4/9/2018	NM		0.70				ND	2.30	NM			0.60	0.90		1.00	0.70	0.60
4/11/2018	NM		0.70				ND	1.40	NM			0.60	0.90		0.60	0.70	0.60
4/13/2018	NM		0.70				ND	1.40	NM			0.60	0.90		1.00	0.70	0.60
4/16/2018	NM		0.70				ND	2.50	NM			0.60	0.90		0.35	0.70	0.60
4/18/2018	NM		0.70				ND	0.80	NM			0.60	0.90		1.00	0.70	0.60
4/20/2018	NM		0.80				ND	1.40	NM			0.60	0.90		1.40	1.00	1.20
4/23/2018	NM		0.80				ND	1.90	NM			0.60	0.90		0.90	1.00	1.20
4/25/2018	NM		0.80				ND	1.80	NM			0.60	0.90		1.50	1.00	1.20
4/27/2018	NM		1.10				ND	1.80	NM			0.60	0.90		1.50	1.00	1.20
4/30/2018	NM		1.10				ND	2.00	NM			0.60	0.90		1.60	1.00	1.1

Table 1
Summary of DNAPL Gauging
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13
Date	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet
7/9/2018	NM		0.10				ND	2.00	NM			0.30	0.20		0.60	0.20	ND
7/11/2018	NM		0.30				ND	0.80	NM			0.30	0.30		0.50	0.80	ND
7/13/2018	NM		0.80				ND	0.80	NM			0.30	0.50		0.80	0.30	ND
7/16/2018	NM		1.00				ND	1.50	NM			0.80	1.00		0.30	0.50	ND
7/18/2018	NM		1.50				ND	1.00	NM			0.30	0.50		0.30	0.20	ND
7/20/2018	NM		1.00				ND	0.80	NM			0.50	0.30		0.50	0.20	ND
7/23/2018	NM		1.30				ND	1.30	NM			0.30	0.10		0.30	0.30	ND
7/25/2018	NM		0.80				ND	0.80	NM			0.10	0.50		0.30	0.30	0.10
7/27/2018	NM		0.50				ND	0.80	NM			0.10	0.10		0.30	0.10	0.10
7/30/2018	NM		0.80				ND	1.00	NM			0.10	0.10		0.30	0.10	0.10
8/1/2018	NM		NM				ND	1.00	NM			0.30	0.10		NM	0.10	0.10
8/3/2018	NM		0.50				ND	1.50	NM			0.30	0.10		0.30	0.30	ND
8/6/2018	NM		0.80				ND	0.80	NM			0.30	0.50		0.50	0.10	ND
8/8/2018	NM		1.00				ND	1.00	NM			0.30	0.30		0.50	0.10	ND
8/10/2018	NM		0.30				ND	0.70	NM			0.30	ND		0.30	0.20	ND
8/13/2018	NM		0.40				ND	0.70	NM			0.30	0.00		0.30	0.20	ND
8/15/2018	NM		0.50				ND	0.80	NM			0.40	0.20		0.50	0.20	ND
8/17/2018	NM		0.40				ND	0.70	NM			0.20	ND		0.40	0.50	ND
8/20/2018	NM		0.40				ND	1.00	NM			0.30	ND		0.30	0.10	ND
8/22/2018	NM		0.40				ND	0.70	NM			0.20	ND		0.30	0.10	ND
8/24/2018	NM		0.60				ND	0.90	NM			0.30	0.20		0.40	0.40	ND
8/27/2018	NM		0.40				ND	0.90	NM			0.20	ND		0.40	0.20	ND
8/29/2018	NM		0.50				ND	0.80	NM			0.10	0.20		0.10	0.20	ND
8/31/2018	NM		0.50				ND	0.90	NM			0.10	0.20		0.10	0.10	ND
9/5/2018	NM		0.50				ND	2.00	NM			0.10	0.10		NM	0.30	0.10
9/7/2018	NM		0.50				ND	0.50	NM			0.10	0.10		0.30	0.10	0.10
9/10/2018	NM		0.30				ND	0.50	NM			0.10	0.10		0.30	0.30	ND
9/12/2018	NM		0.30				ND	0.50	NM			0.10	0.10		1.00	0.30	ND
9/14/2018	NM		0.10				ND	0.30	NM			0.10	0.10		0.50	0.80	ND
9/17/2018	NM		0.10				ND	0.50	NM			0.30	0.10		0.30	0.10	ND
9/19/2018	NM		0.10				ND	0.30	NM			0.30	0.10		0.50	0.10	ND
9/21/2018	NM		0.30				ND	0.50	NM			0.30	0.10		0.30	0.10	ND
9/24/2018	NM		0.10				ND	0.30	NM			0.30	0.10		0.50	0.10	ND
9/26/2018	NM		0.30				ND	0.80	NM			0.30	0.10		1.00	0.10	ND
9/28/2018	NM		0.50				ND	0.50	NM			0.30	0.10		0.50	0.10	ND
10/1/2018	NM		0.10				ND	0.80	NM			0.10	0.10		0.80	0.30	ND
10/3/2018	NM		0.10				ND	0.50	NM			0.10	0.10		0.30	0.10	ND
10/5/2018	NM		0.10				ND	0.50	NM			0.10	0.10		0.30	0.30	ND
10/8/2018	NM		0.10				ND	0.50	NM			0.10	0.10		0.30	0.10	ND
10/10/2018	NM		0.10				ND	0.50	NM			0.10	0.10		0.30	0.10	0.10
10/12/2018	NM		0.30				ND	1.00	NM			0.10	0.08		1.00	0.10	ND
10/15/2018	NM		0.30				ND	0.80	NM			0.10	0.10		0.50	0.30	0.04
10/17/2018	NM		0.10				ND	0.50	NM			0.07	NM		0.40	0.30	ND
10/19/2018	NM		NM				ND	0.50	NM			0.04	0.10		0.50	0.30	ND
10/22/2018	NM		0.10				ND	0.80	NM			0.10	0.10		0.80	0.04	ND
10/24/2018	NM		0.30				ND	0.80	NM			0.04	0.10		0.50	0.02	ND
10/26/2018	NM		0.30				ND	1.00	NM			0.10	0.10		0.30	0.10	ND
10/29/2018	NM		0.30				ND	0.50	NM			0.20	0.10		0.80	0.30	ND
10/31/2018	NM		0.30				ND	0.80	NM			0.10	0.10		1.00	0.10	ND
11/2/2018	NM		0.20				ND	1.00	NM			0.10	0.01		0.50	0.10	ND
11/5/2018	NM		0.20				ND	0.80	NM			0.10	0.10		1.00	0.20	ND
11/7/2018	NM		0.10				ND	0.50	NM			0.10	0.20		0.80	0.30	0.01
11/9/2018	NM		0.10				ND	0.50	NM			0.20	0.20		0.50	0.30	ND
11/12/2018	NM		NM				ND	0.80	NM			0.10	0.10		1.00	0.10	ND
11/14/2018	NM		0.20				ND	0.80	NM			0.10	0.10		0.50	0.20	ND
11/19/2018	NM		0.04				ND	0.80	NM			0.10	0.30		0.50	0.30	ND
11/21/2018	NM		0.10				ND	0.80	NM			0.10	0.10		0.80	0.20	ND
11/26/2018	NM		0.10				ND	1.00	NM			0.10	0.20		1.20	0.30	ND
11/28/2018	NM		0.10				ND	0.50	NM			0.20	0.10		0.80	0.20	ND
12/3/2018	NM		0.10				ND	1.00	NM			0.10	0.04		1.00	0.10	ND
12/5/2018	NM		0.20				ND	0.80	NM			0.10	0.10		0.80	0.20	ND
12/7/2018	NM		0.04				ND	0.50	NM			0.04	0.10		0.80	0.20	ND
12/10/2018	NM		0.10				ND	0.80	NM			0.10	0.04		0.80	0.10	ND
12/12/2018	NM		0.20				ND	0.50	NM			0.10	0.04		0.50	0.20	ND
12/14/2018	NM		0.10				ND	0.80	NM			0.20	0.10		0.80	0.30	ND
12/17/2018	NM		0.20				ND	0.70	NM			0.30	0.10		0.80	0.30	ND
12/19/2018	NM		0.10				ND	0.70	NM			0.10	0.10		0.60	0.30	ND
12/21/2018	NM		0.10				ND	0.60	NM			0.10	0.10		0.50	0.40	ND
12/26/2018	NM		0.30				ND	1.00	NM			0.10	0.20		1.00	0.30	ND
12/28/2018	NM		0.10				ND	0.60	NM			0.20	0.10		0.60	0.30	ND
1/2/2019	NM		0.10				ND	1.00	NM			0.20	0.20		2.00	0.20	ND
1/4/2019	NM		0.10				ND	0.70	NM			0.30	0.04		1.20	0.30	ND
1/7/2019	NM		0.20				ND	0.50	NM			0.10	0.20		1.00	0.20	ND
1/9/2019	NM		0.02				ND	0.50	NM			0.08	0.10		1.00	0.08	ND
1/11/2019	NM		0.02				ND	0.30	NM			0.08	0.10		1.00	0.08	ND
1/14/2019	NM		0.02				ND	0.80	NM			0.10	0.10		1.00	0.08	ND
1/16/2019	NM		0.10				ND	0.50	NM			0.08	0.08		1.00	0.13	ND
1/18/2019	NM		0.10				ND	0.30	NM			0.08	0.04		1.00	0.10	ND
1/21/2019	NM		0.08				ND	0.50	NM			0.08	0.08		0.60	0.08	ND
1/23/2019	NM		0.08				ND	0.50	NM			0.10	0.08		1.00	0.04	ND
1/25/2019	NM		0														

Table 1
Summary of DNAPL Gauging
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13
Date	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet
3/20/2019	NM		0.10				ND	0.60	NM			0.10	0.10		0.80	0.10	ND
3/22/2019	NM		0.10				ND	0.50	NM			0.10	0.10		0.80	0.08	ND
3/25/2019	NM		0.10				ND	1.00	NM			0.20	0.10		1.00	0.08	ND
3/27/2019	NM		0.10				ND	1.00	NM			0.10	0.10		0.50	0.08	ND
3/29/2019	NM		0.10				ND	1.00	NM			0.10	0.10		0.80	0.08	ND
4/1/2019	NM		0.10				ND	1.00	NM			0.20	0.10		0.50	0.10	ND
4/3/2019	NM		0.10				ND	0.50	NM			0.10	0.10		0.80	0.10	ND
4/5/2019	NM		0.10				ND	1.00	NM			0.10	0.20		0.80	0.10	ND
4/8/2019	NM		0.10				ND	0.80	NM			0.20	0.10		1.00	0.20	ND
4/10/2019	NM		0.10				ND	1.00	NM			0.10	0.10		0.80	0.20	ND
4/12/2019	NM		0.10				ND	1.60	NM			0.20	0.10		1.00	0.20	ND
4/15/2019	NM		0.20				ND	1.80	NM			0.20	0.20		1.10	0.20	ND
4/17/2019	NM		0.20				ND	1.40	NM			0.10	0.10		1.00	0.20	ND
4/19/2019	NM		0.20				ND	1.40	NM			0.20	0.10		1.20	0.20	ND
4/22/2019	NM		0.10				ND	1.30	NM			0.10	0.20		1.10	0.20	ND
4/24/2019	NM		0.10				ND	1.40	NM			0.10	0.20		1.10	0.10	ND
4/26/2019	NM		0.10				ND	1.30	NM			0.10	0.10		0.80	0.10	ND
4/29/2019	NM		0.10				ND	1.30	NM			0.10	0.10		0.80	0.10	ND
5/1/2019	NM		0.10				ND	0.80	NM			0.20	0.20		0.50	0.08	ND
5/3/2019	NM		0.10				ND	1.00	NM			0.10	0.20		0.50	0.10	ND
5/6/2019	NM		0.10				ND	0.50	NM			0.10	0.08		0.40	0.10	ND
5/8/2019	NM		NM				ND	0.60	NM			0.10	0.10		0.40	0.10	ND
5/10/2019	NM		0.08				ND	NM	NM			NM	0.04		NM	0.04	ND
5/15/2019			ND				ND	0.10	NM			ND	0.08		0.10	0.08	ND
5/22/2019			ND				ND	0.80	NM			ND	0.10		0.40	ND	ND
5/29/2019		0.30	ND				ND	0.50		ND		ND	ND		0.20	0.08	ND
5/31/2019		0.80	ND				ND	1.00		ND		ND	ND		0.10	ND	ND
6/5/2019		0.80	0.30				ND	1.00		ND		ND	ND		1.00	0.10	ND
6/12/2019		0.80	0.10				ND	1.00		ND		ND	ND		0.80	ND	ND
6/17/2019		0.40	ND				ND	1.50		ND		ND	ND		0.50	ND	ND
6/19/2019		0.80	ND				ND	0.50		ND		ND	ND		0.40	ND	ND
6/26/2019		0.10	0.50				ND	1.00		ND		ND	ND		0.60	ND	ND
7/3/2019		0.30	ND				ND	1.00		ND		ND	0.20		0.40	ND	ND
7/10/2019		0.40	ND				ND	1.00		ND		ND	ND		0.60	0.10	ND
7/17/2019		0.30	0.10				ND	1.50		ND		ND	ND		0.80	ND	ND
7/24/2019		0.40	ND				ND	2.00		ND		ND	ND		0.40	0.10	ND
7/31/2019		0.50	ND				ND	1.70		ND		ND	ND		0.50	0.10	ND
8/7/2019		0.40	ND				ND	1.50		ND		ND	ND		0.60	0.10	ND
8/14/2019		0.30	ND				ND	1.60		ND		ND	ND		0.50	0.10	ND
8/21/2019		0.40	0.10				ND	2.00		0.10		ND	ND		0.60	ND	ND
8/28/2019		0.30	ND				ND	1.00		ND		ND	ND		0.40	ND	ND
9/4/2019		0.30	ND				ND	1.00		ND		ND	ND		0.20	ND	ND
9/11/2019		ND	ND				ND	0.80		ND		ND	ND		0.20	ND	ND
9/17/2019		0.40	ND				ND	1.00		ND		ND	ND		0.30	0.10	ND
9/25/2019		0.30	ND				ND	1.30		ND		ND	ND		0.30	0.10	ND
10/2/2019		0.30	ND				ND	1.00		ND		ND	ND		0.30	ND	ND
10/9/2019		0.70	ND				ND	0.90		ND		ND	ND		0.30	0.10	ND
10/16/2019		0.30	0.20				ND	1.50		ND		ND	ND		0.20	0.10	ND
10/23/2019		0.30	0.10				ND	1.60		ND		ND	0.30		0.30	ND	ND
10/30/2019		0.30	ND				ND	1.70		ND		ND	ND		0.20	0.10	ND
11/7/2019		0.30	ND				ND	1.40		ND		ND	0.10		0.20	ND	ND
11/13/2019		0.40	ND				ND	1.10		ND		ND	0.20		0.20	ND	ND
11/20/2019		0.50	ND				ND	1.50		ND		ND	ND		0.30	0.20	ND
11/26/2019		0.20	ND				ND	1.40		ND		ND	0.20		0.20	ND	ND
12/4/2019		0.30	ND				ND	1.50		ND		ND	ND		0.30	0.20	ND
12/11/2019		0.30	ND				ND	1.60		ND		ND	ND		0.20	0.20	ND
12/18/2019		0.20	ND				ND	1.20		ND		ND	0.20		0.50	ND	ND
12/24/2019		0.20	ND				ND	1.10		ND		ND	0.20		0.30	ND	ND
1/2/2020		0.30	ND				ND	1.50		ND		ND	0.20		0.40	ND	ND
1/8/2020		0.40	0.30				ND	1.20		0.10		ND	0.30		0.40	0.10	ND
1/15/2020		0.20	ND				ND	1.40		ND		ND	0.20		0.30	ND	ND
1/22/2020		0.20	ND				ND	1.60		ND		ND	0.30		0.40	0.10	ND
1/29/2020		0.30	0.10				ND	1.20		0.20		ND	0.20		0.20	0.10	ND
2/5/2020		0.30	0.10				ND	1.10		Blebs		ND	0.30		0.60	Blebs	ND
2/12/2020		0.50	0.30				ND	1.00		ND		ND	0.20		0.30	0.10	ND
2/18/2020		0.10	Blebs				ND	1.30		ND		ND	Blebs		Blebs	Blebs	ND
2/25/2020		0.10	0.20				ND	1.40		Blebs		Blebs	Blebs		0.50	Blebs	ND
3/3/2020		0.40	0.80				ND	2.20		0.60		0.30	0.40		0.30	0.60	ND
3/11/2020		0.30	0.30				ND	1.50		ND		ND	0.20		0.40	0.10	ND
3/17/2020		0.10	0.10				ND	1.70		ND		ND	ND		0.40	Blebs	ND
3/25/2020		0.20	0.20				ND	1.50		ND		ND	0.30		0.40	0.10	ND
4/1/2020		0.10	0.10				ND	1.00		ND		ND	ND		0.40	ND	ND
4/8/2020		0.10	0.10				ND	1.50		0.10		ND	ND		0.50	ND	ND
4/14/2020		0.10	0.10				ND	1.20		ND		ND	ND		0.20	ND	ND
4/22/2020		0.20	0.30				ND	1.20		ND		ND	ND		ND	ND	ND
4/29/2020		0.20	0.10				ND	1.00		ND		ND	ND		ND	ND	ND
5/6/2020		0.10	0.10				ND	1.10		ND		ND	ND		0.10	ND	ND
5/13/2020		0.20	0.10				ND	1.00		0.10		ND	ND		0.50	ND	ND
5/20/2020		0.30	0.30				ND	1.10		ND		ND	ND		ND	ND	ND
5/27/2020		0.20	0.20				ND	1.00		0.10		ND	0.10		0.30	ND	ND
6/3/2020		0.30	0.10				ND	1.60		ND		ND	0.10		0.20	ND	ND
6/10/2020		0.20	0.20				ND	1.60		0.10		ND	ND		0.20	ND	ND
6/17/2020		0.30	0.20				ND	1.80		0.30		ND	0.30		0.50	ND	ND
6/24/2020		0.20	0.20				ND	1.50		0.10		ND	0.10		0.20	ND	ND
Max Thickness	0.10	0.80	6.90	0.00	8.80	0.50	0.00	16.15	6.55	0.60	14.90	2.00	20.20	1.50	11.00	15.10	2.20
Average Thickness	0.10	0.32	1.02	2.19	1.58	0.44	ND	3.14	1.06	0.18	1.35	0.53	1.37	0.62	2.06	1.48	0.88
Overall Median Value	0.10	0.30	0.80	1.45	0.50	0.50	ND	3.00	1.00	0.10	1.00	0.30	0.90	0.50	1.00	0.50	0.80
Last Quarter Median Value ¹	NC	0.20	0.10	NC	NC	NC	ND	1.20	NC	0.10	NC	ND	0.10	NC	0.25	ND	ND

Notes:

1. Last quarter April through June 2020

NC - Not Calculated

NM - Not Measured

ND - No Product Detected


Blebs - Blebs were present in the well

Well not operational


NRW-01, -03, -04, -05, -08, -09, and -11 are decommissioned.


Replacement recovery wells NRW-09R and NRW-11R were installed on March 27, 2017 and March 23, 2017 respectively.


Replacement recovery wells NRW-01R and NRW-08R were installed on May 21, 2019 and May 24, 2019 respectively.

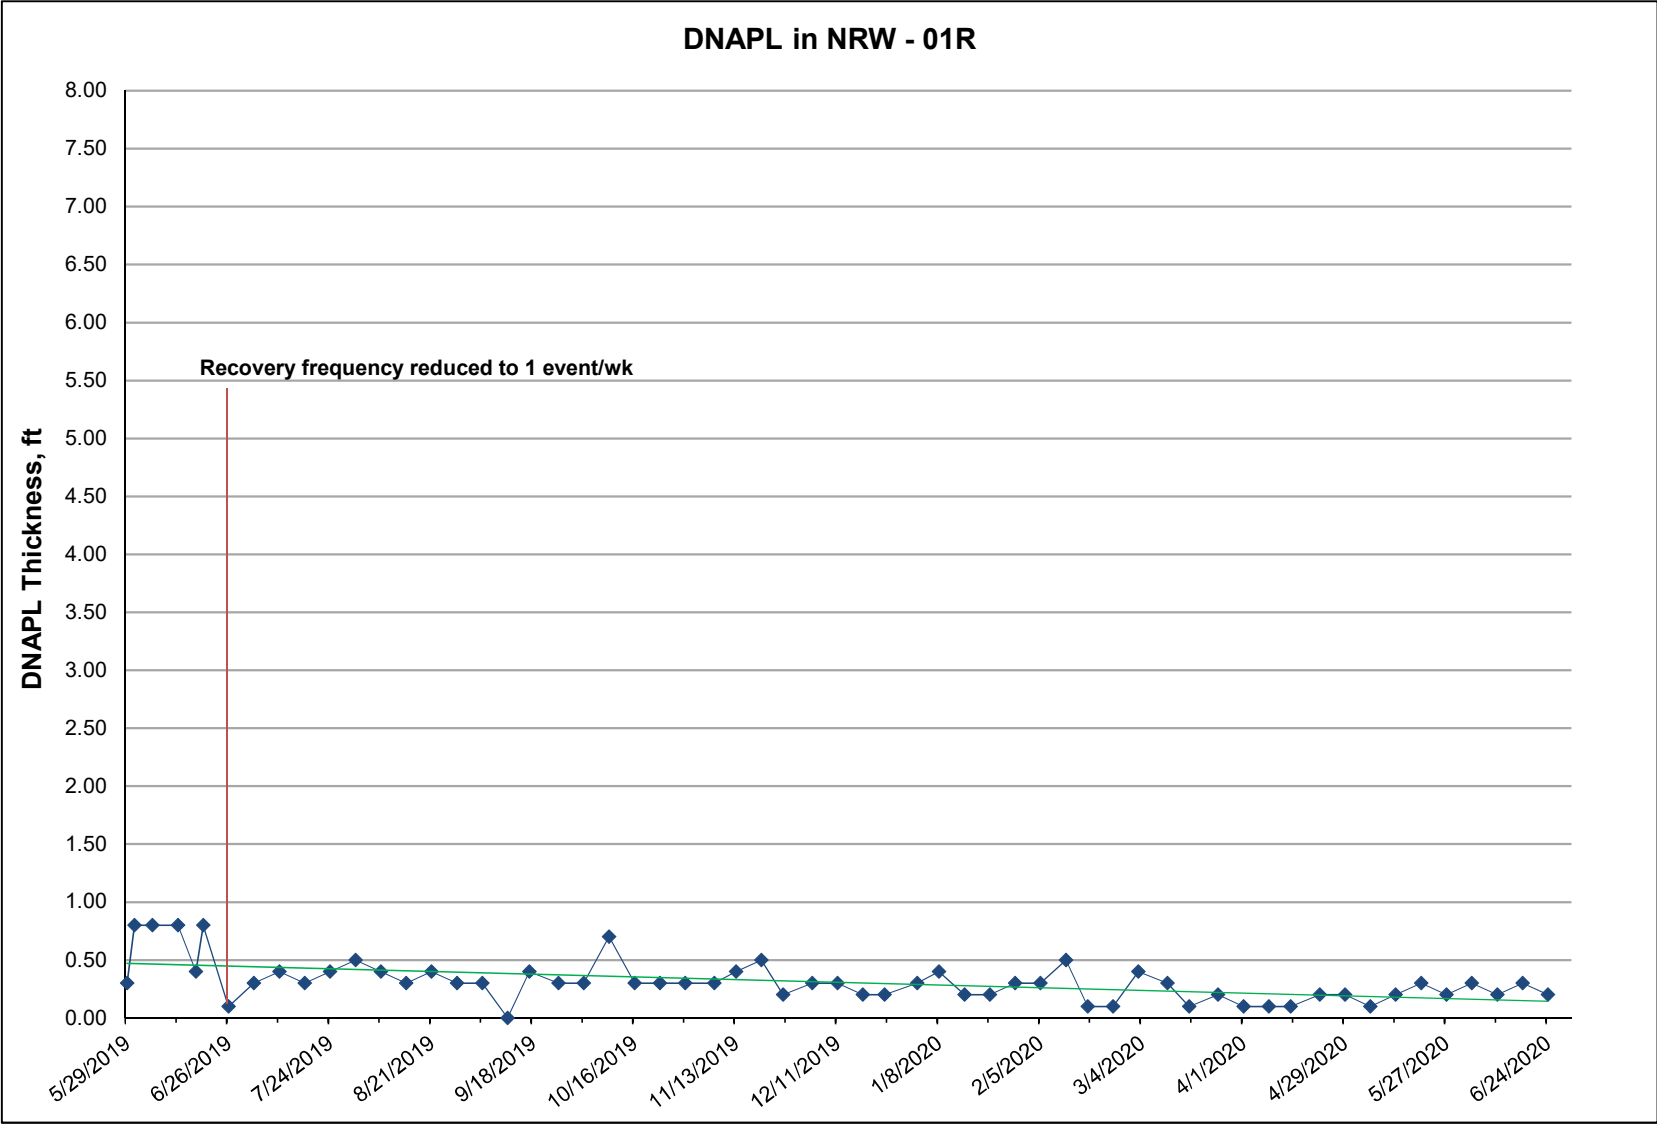


Note: NRW - 01R installed May 21, 2019.

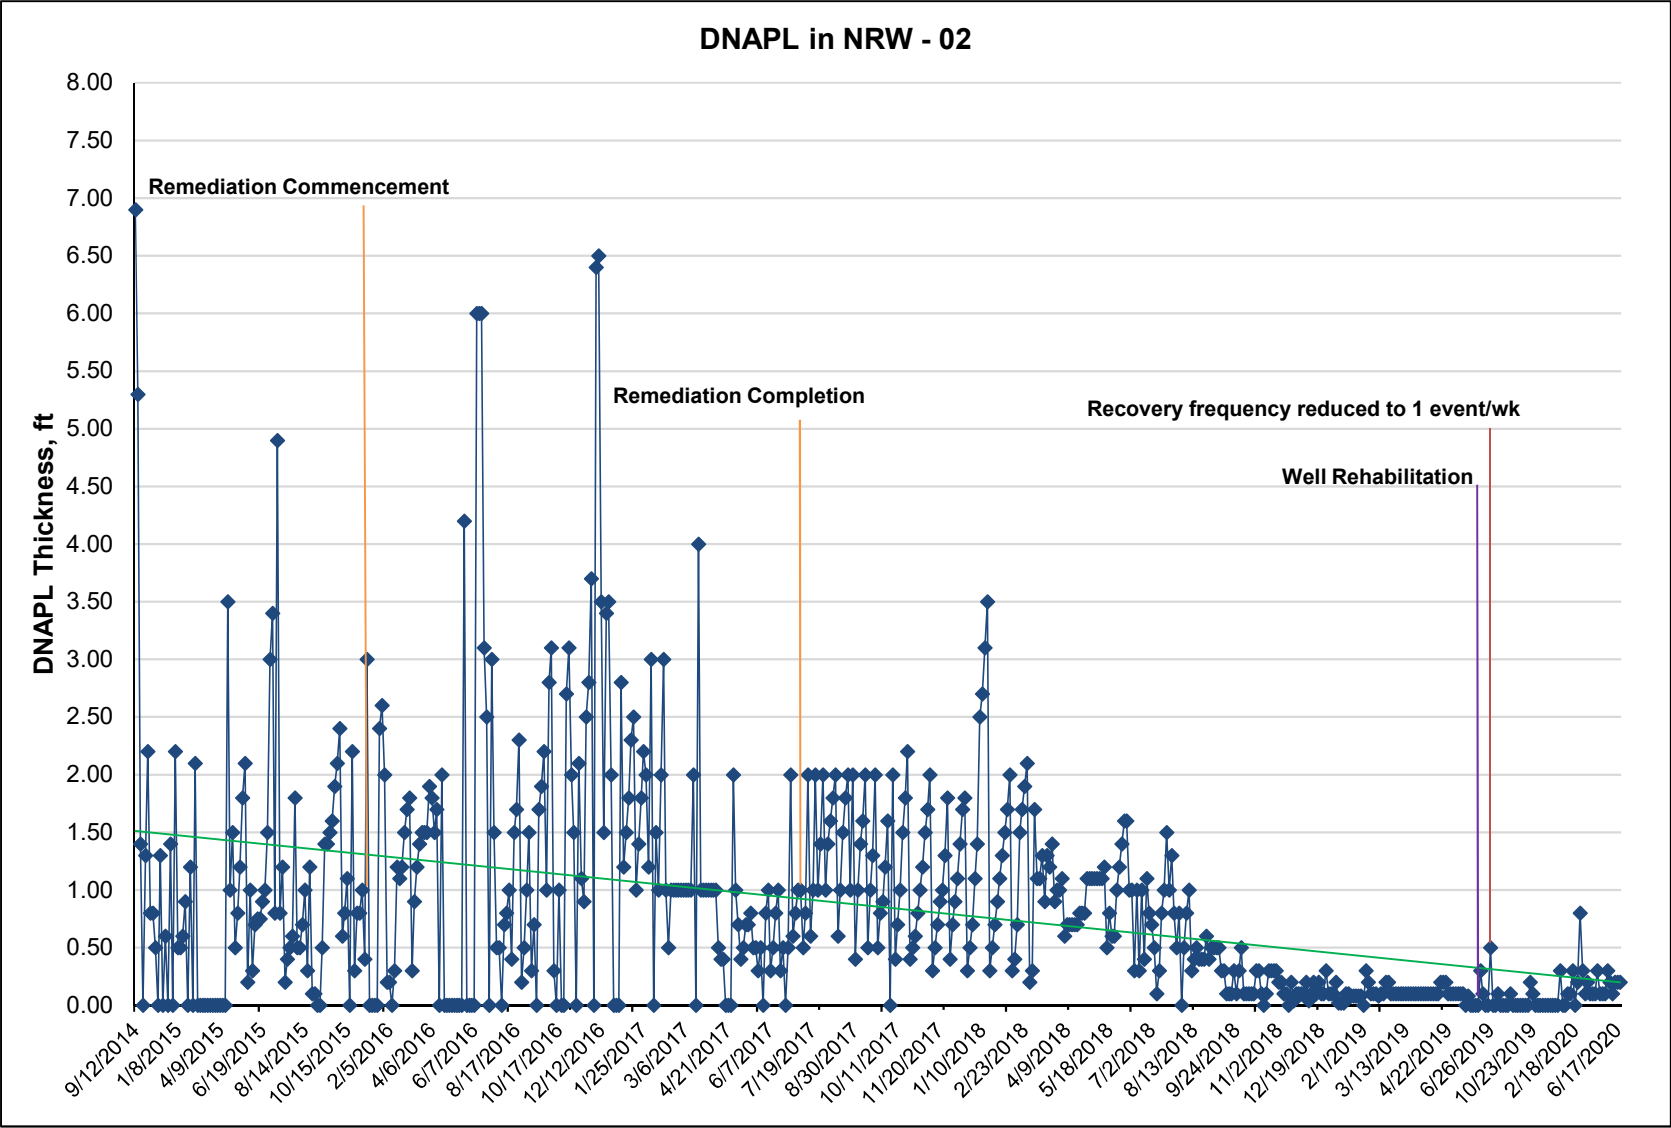

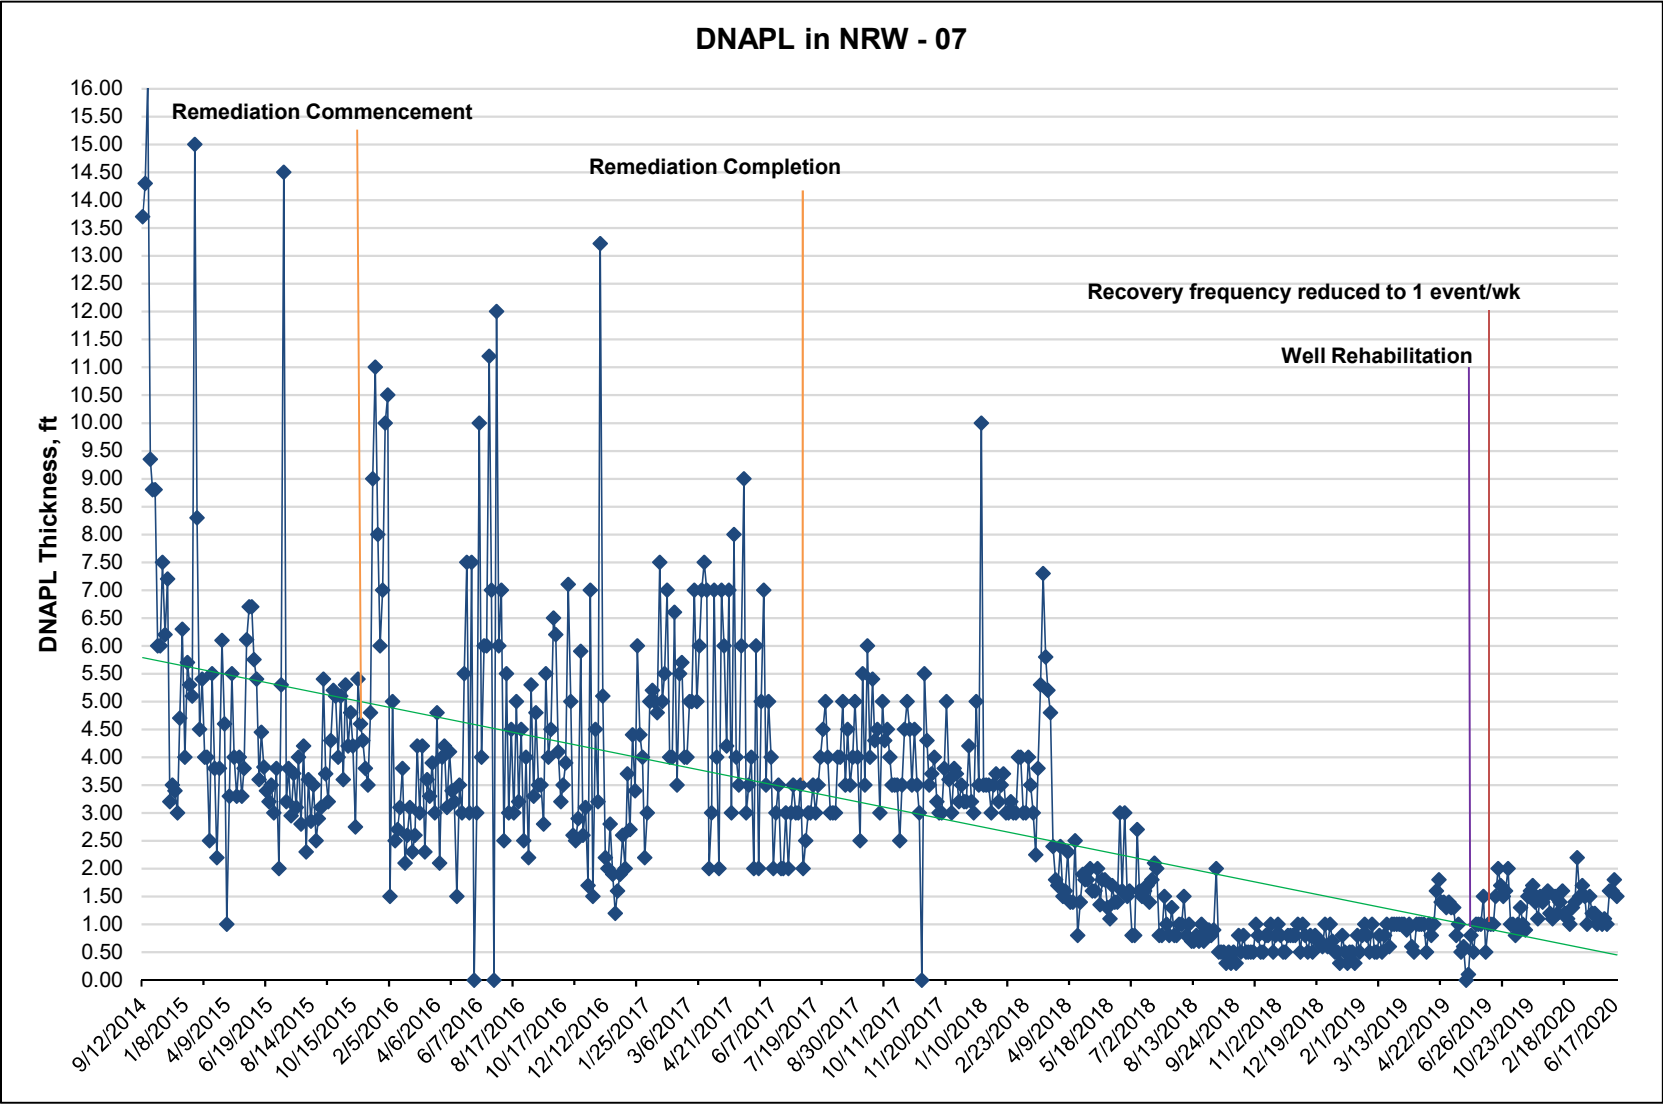


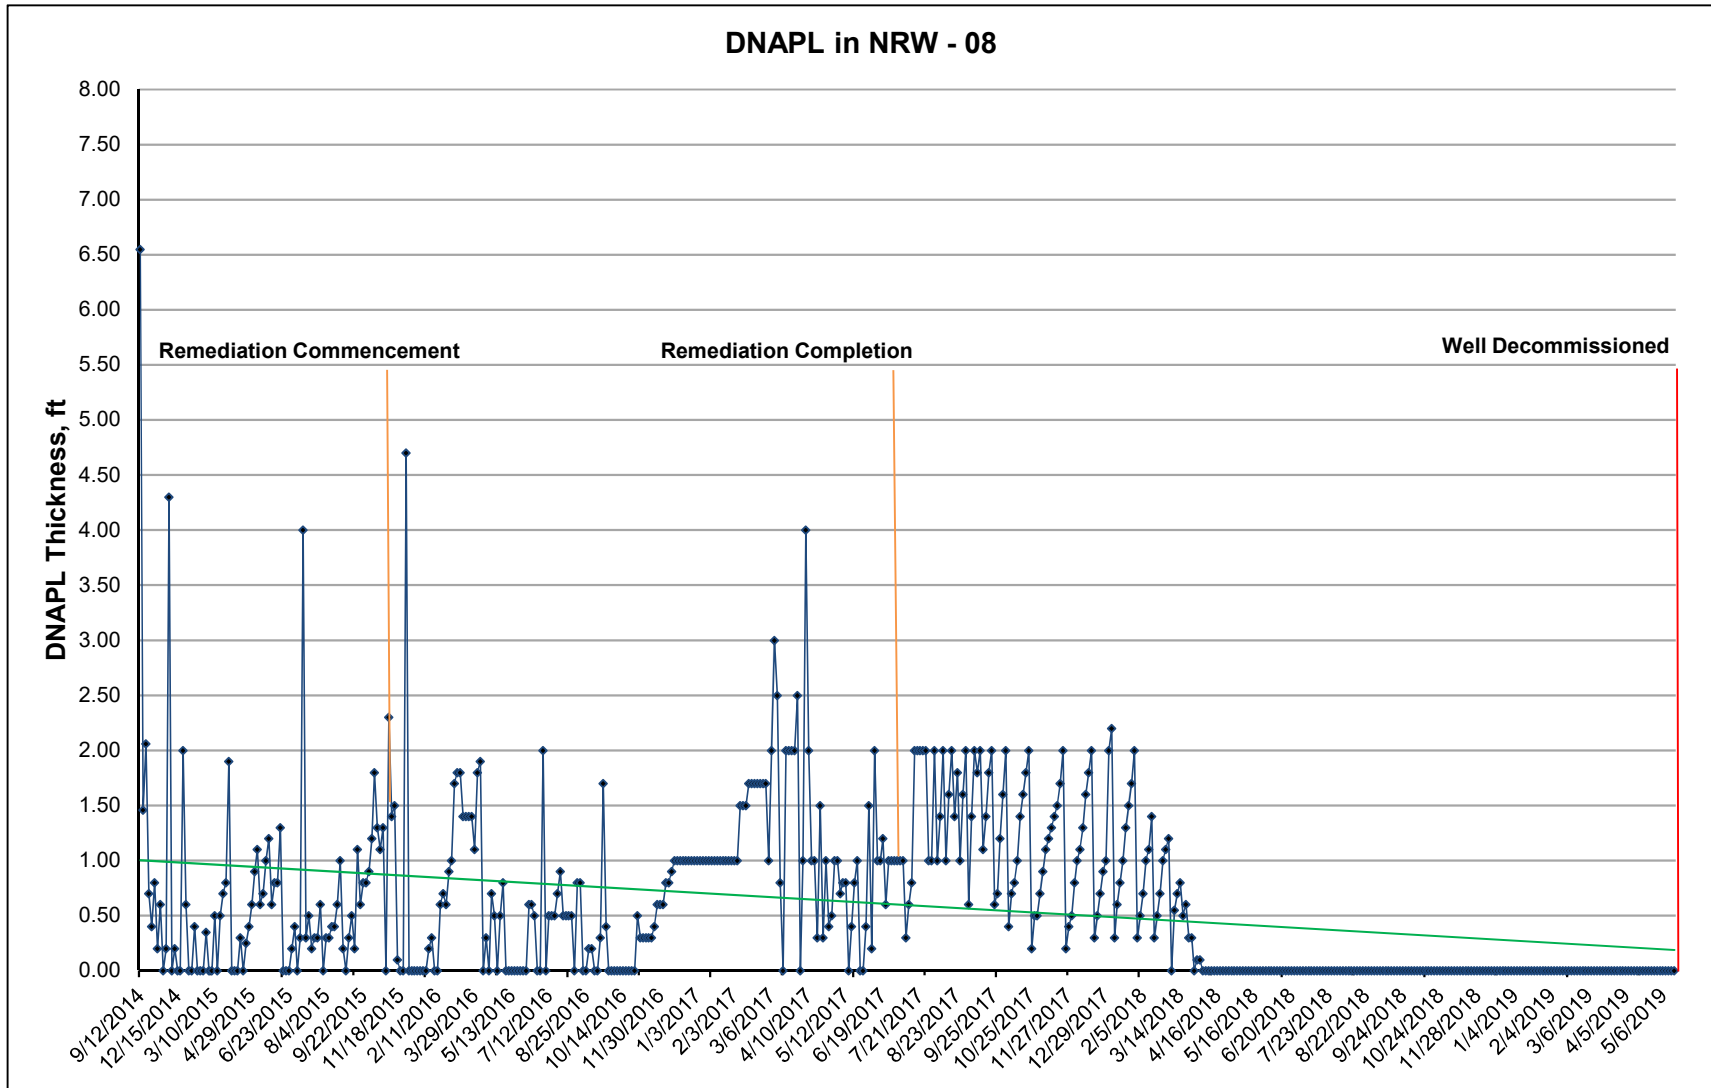


Note: NRW - 08 decommissioned on May 22, 2019 and replaced with NRW-08R.

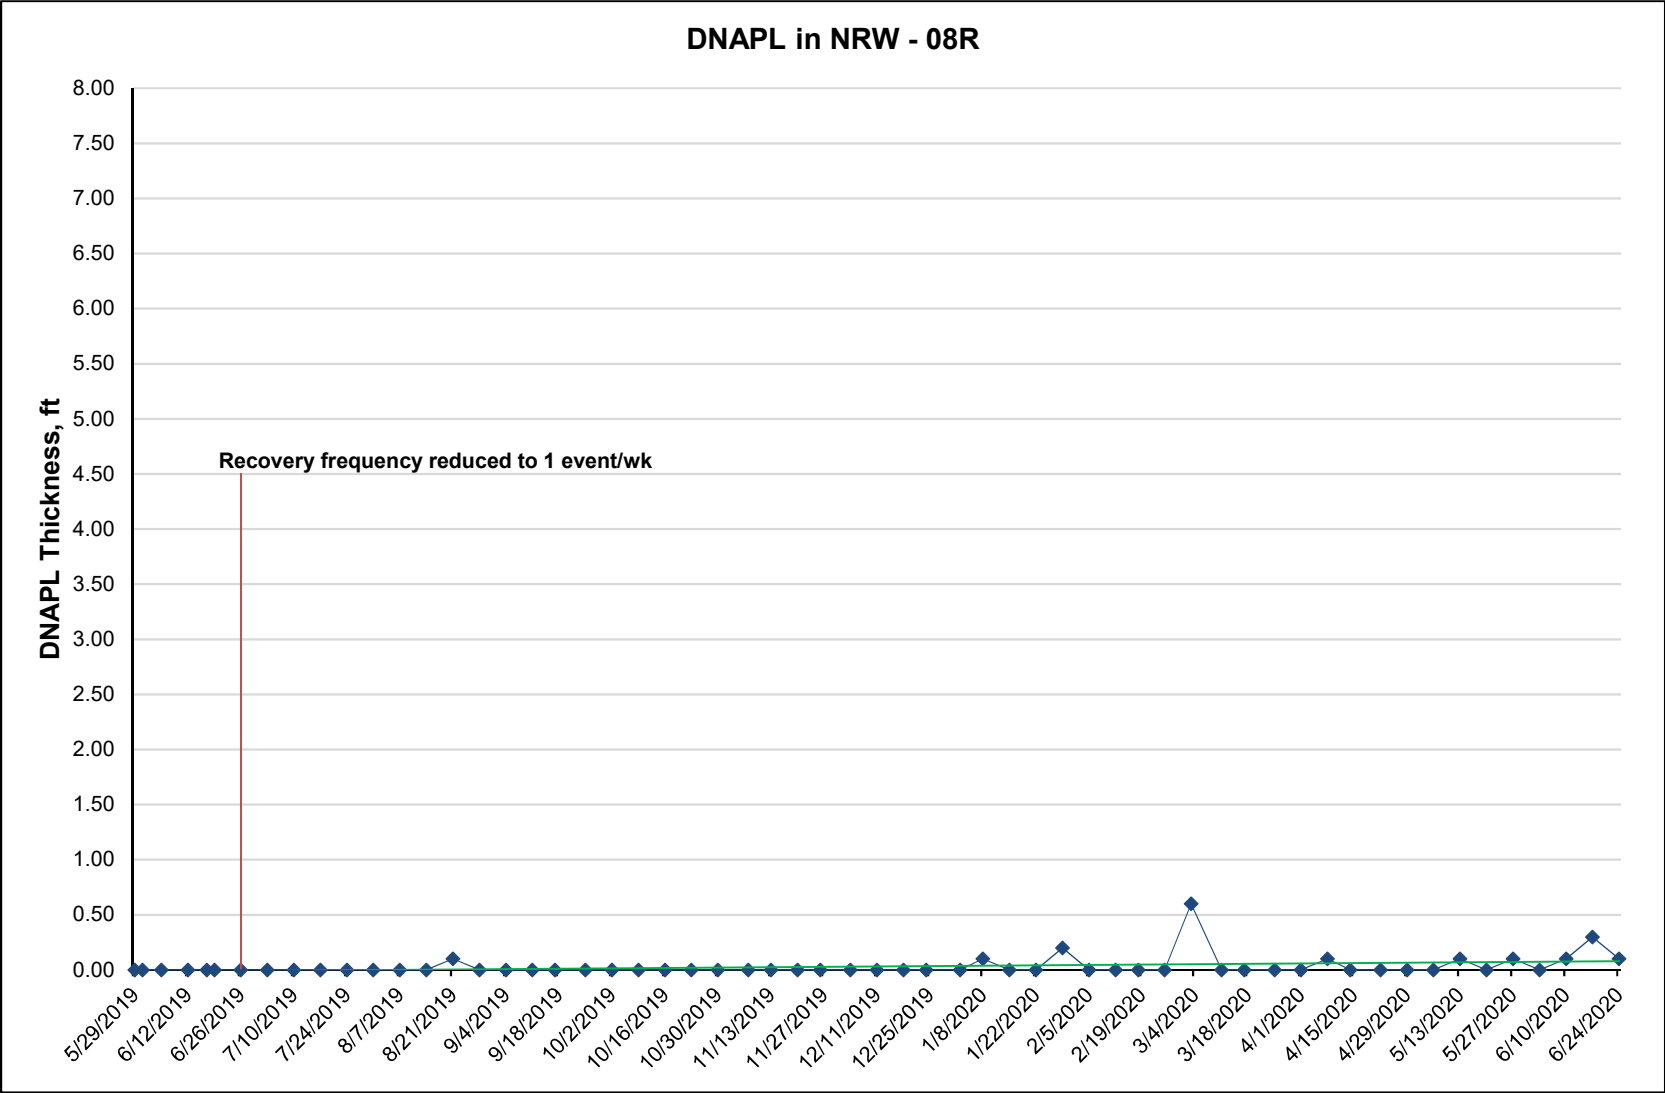


Note: NRW - 08R installed May 24, 2019.

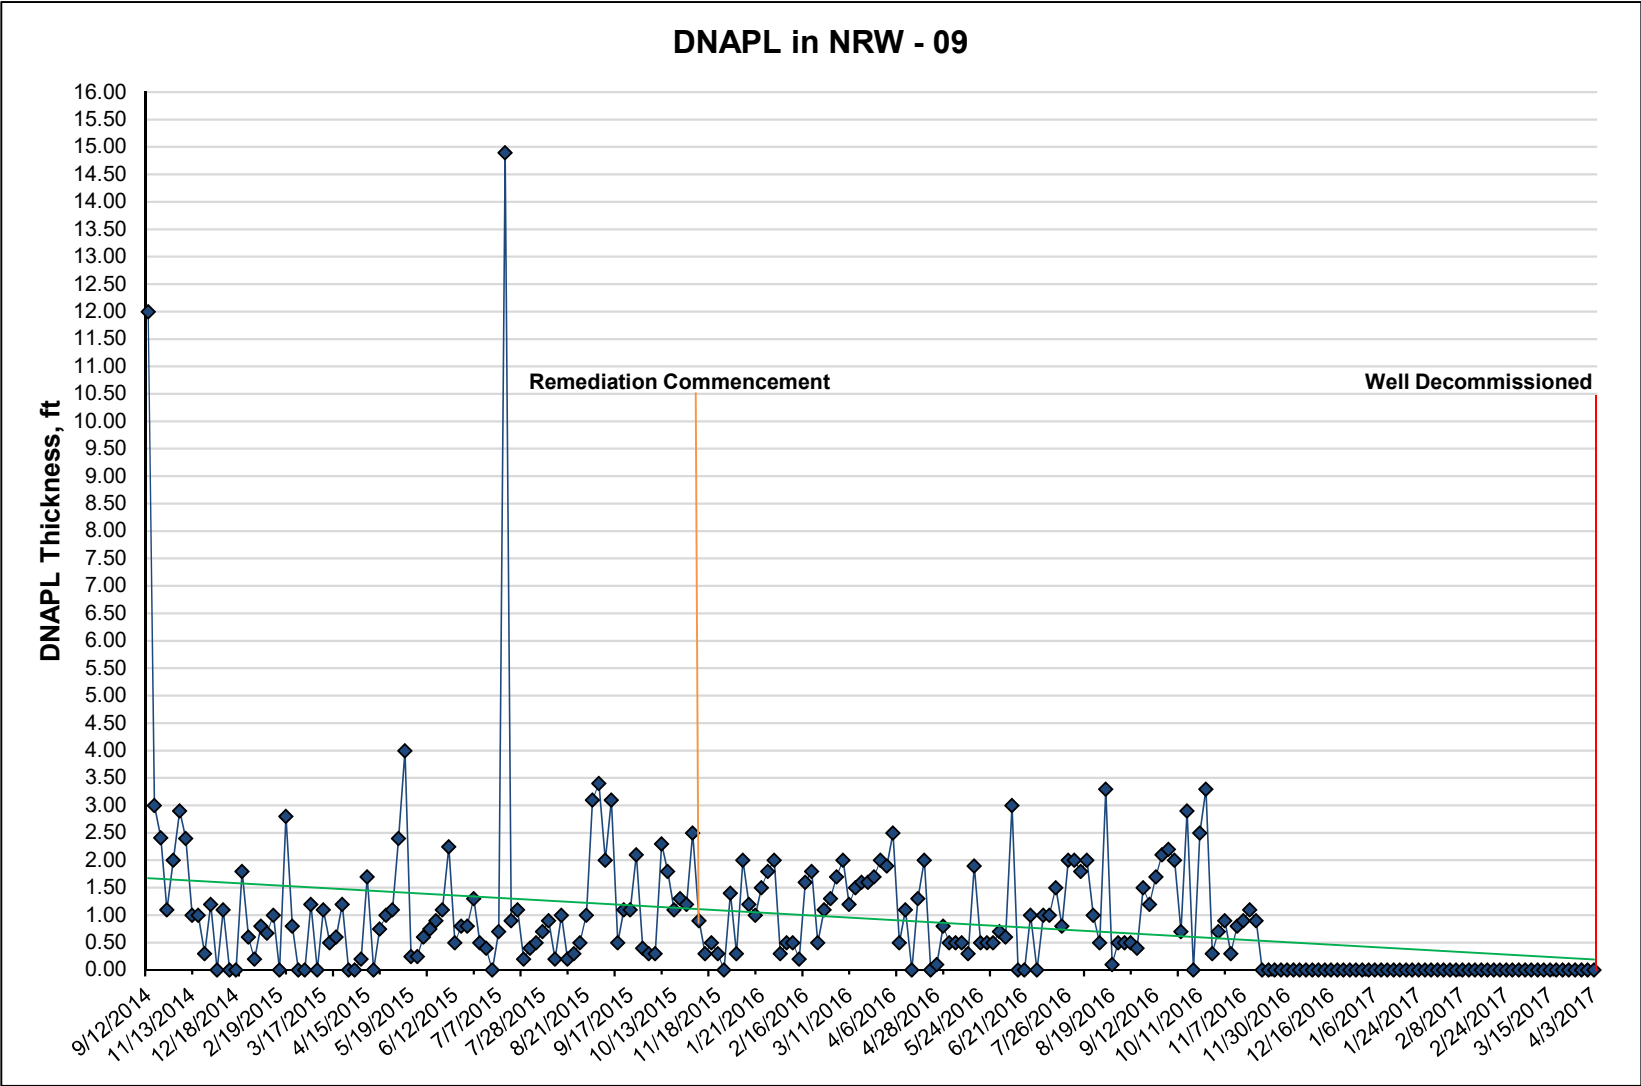


Note: NRW - 09 decommissioned on April 3, 2017 and replaced with NRW - 09R.

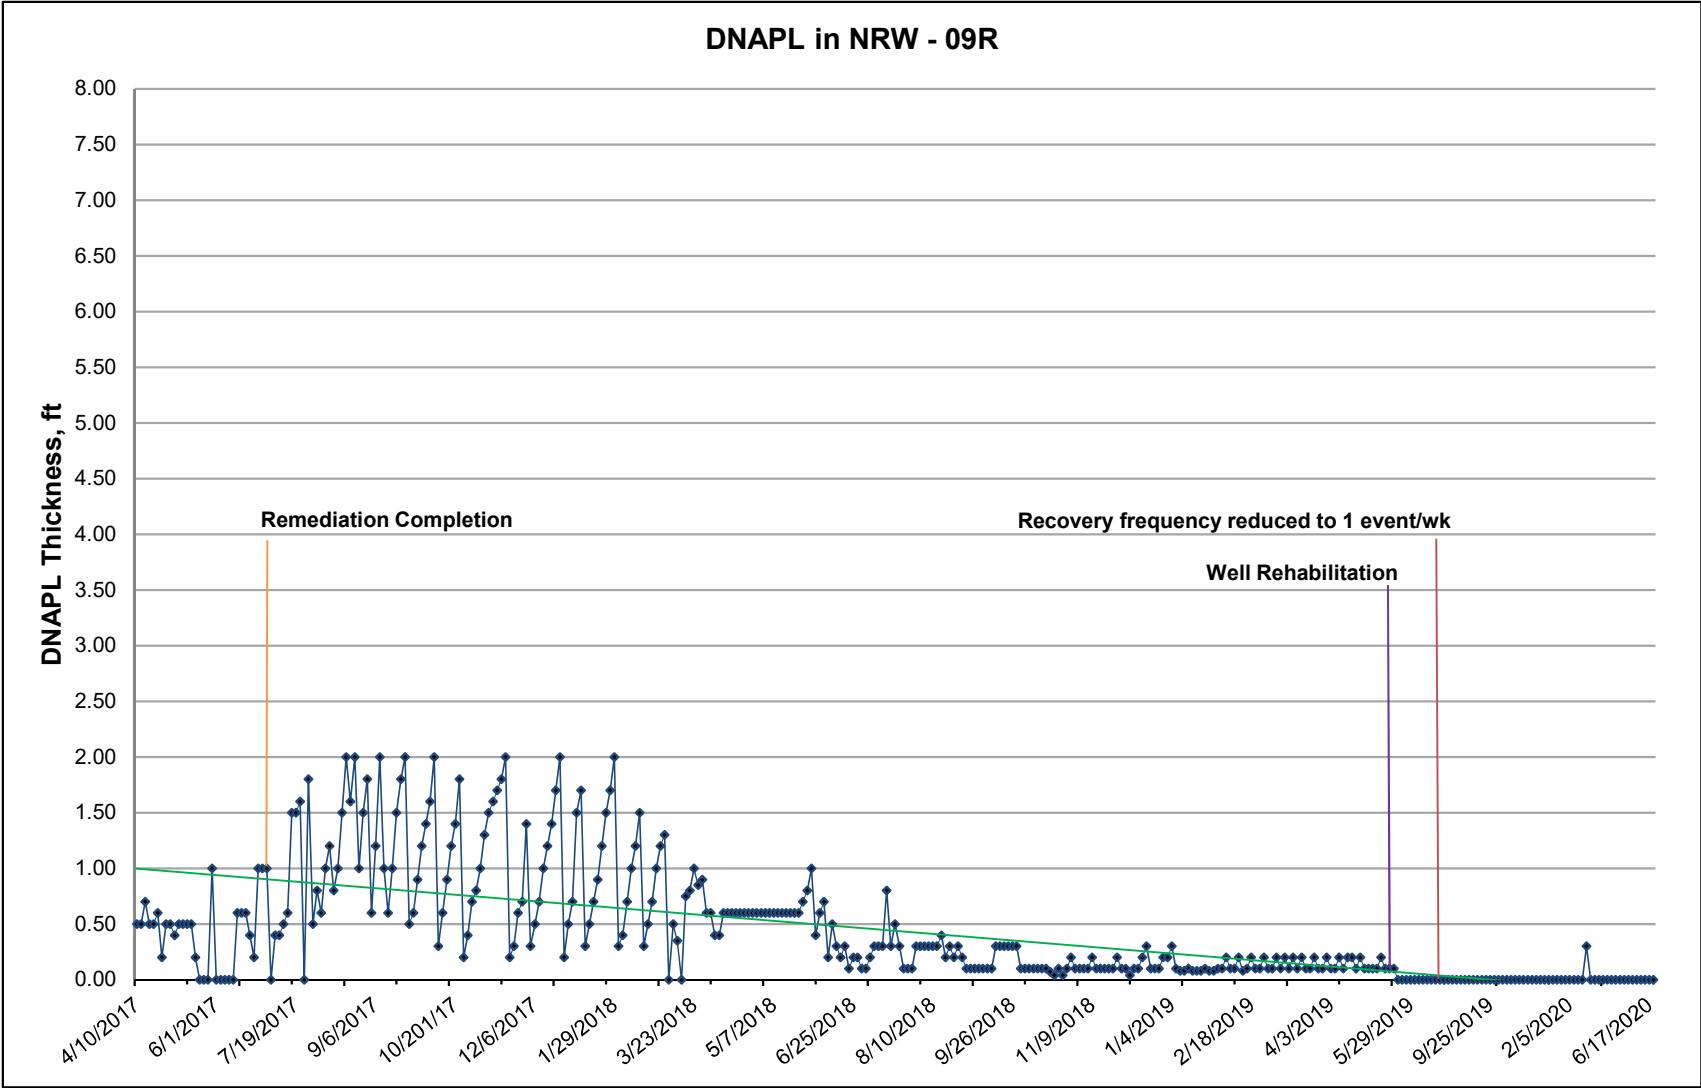


Note: NRW - 09R installed March 27, 2017.

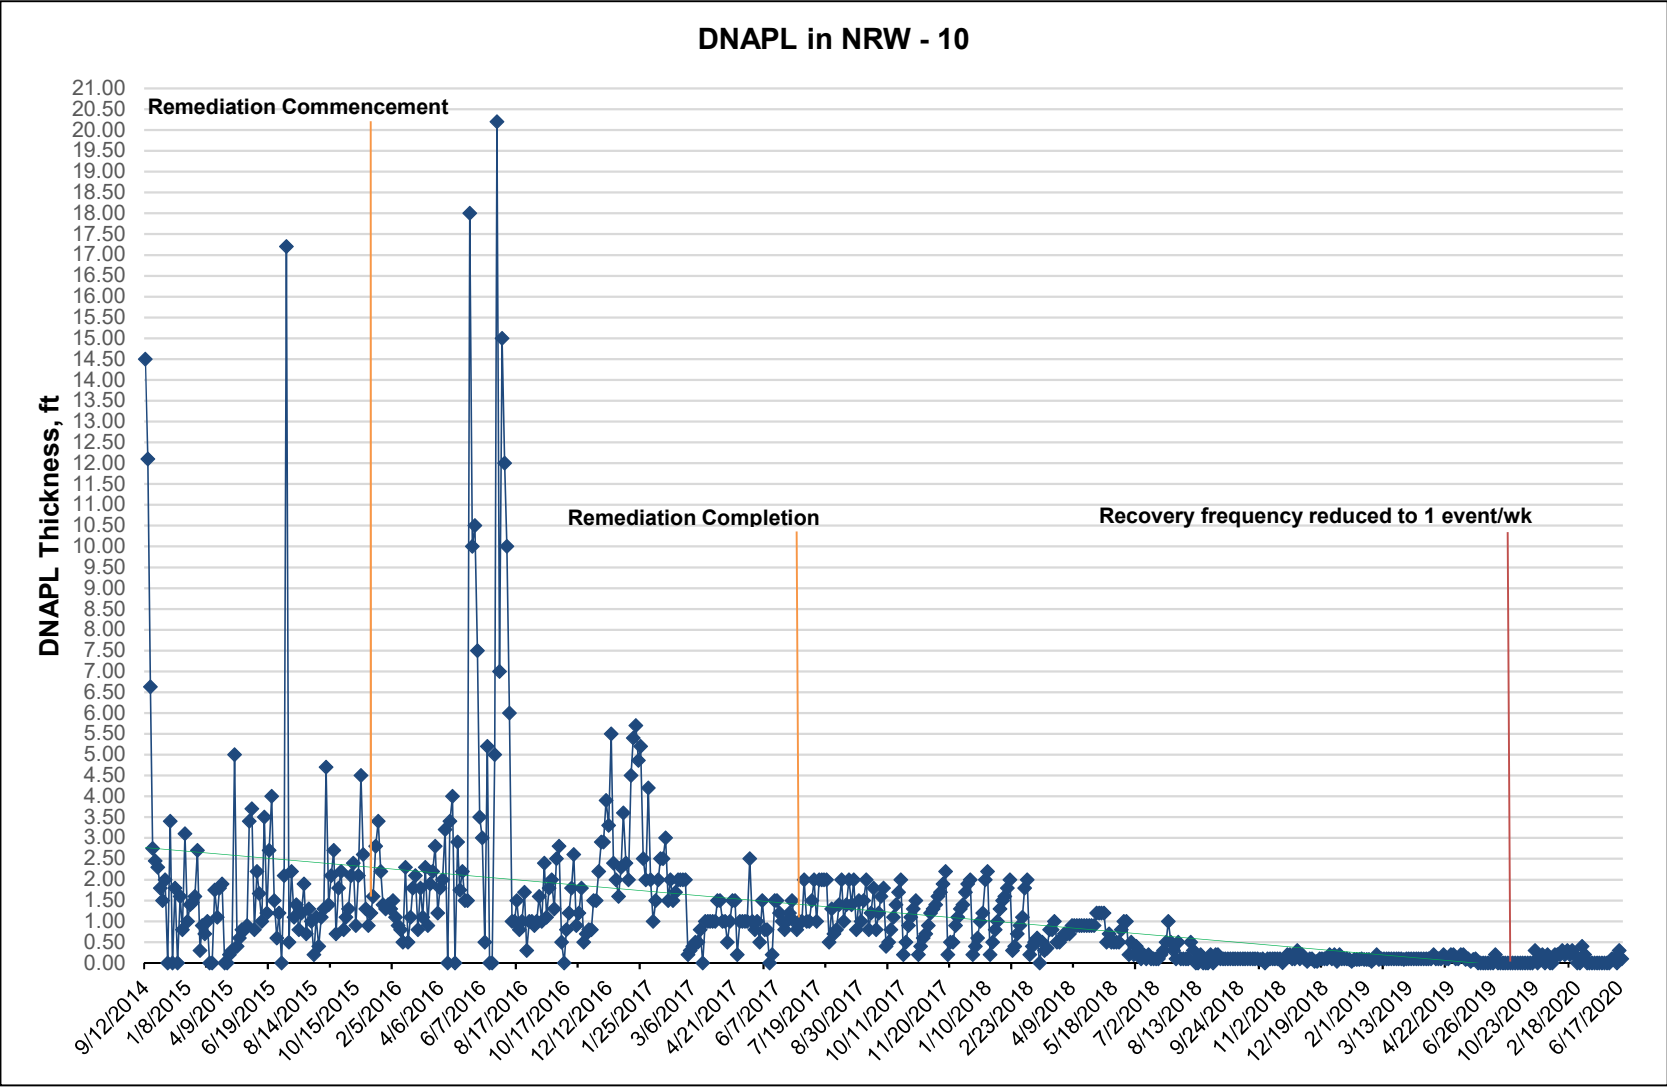


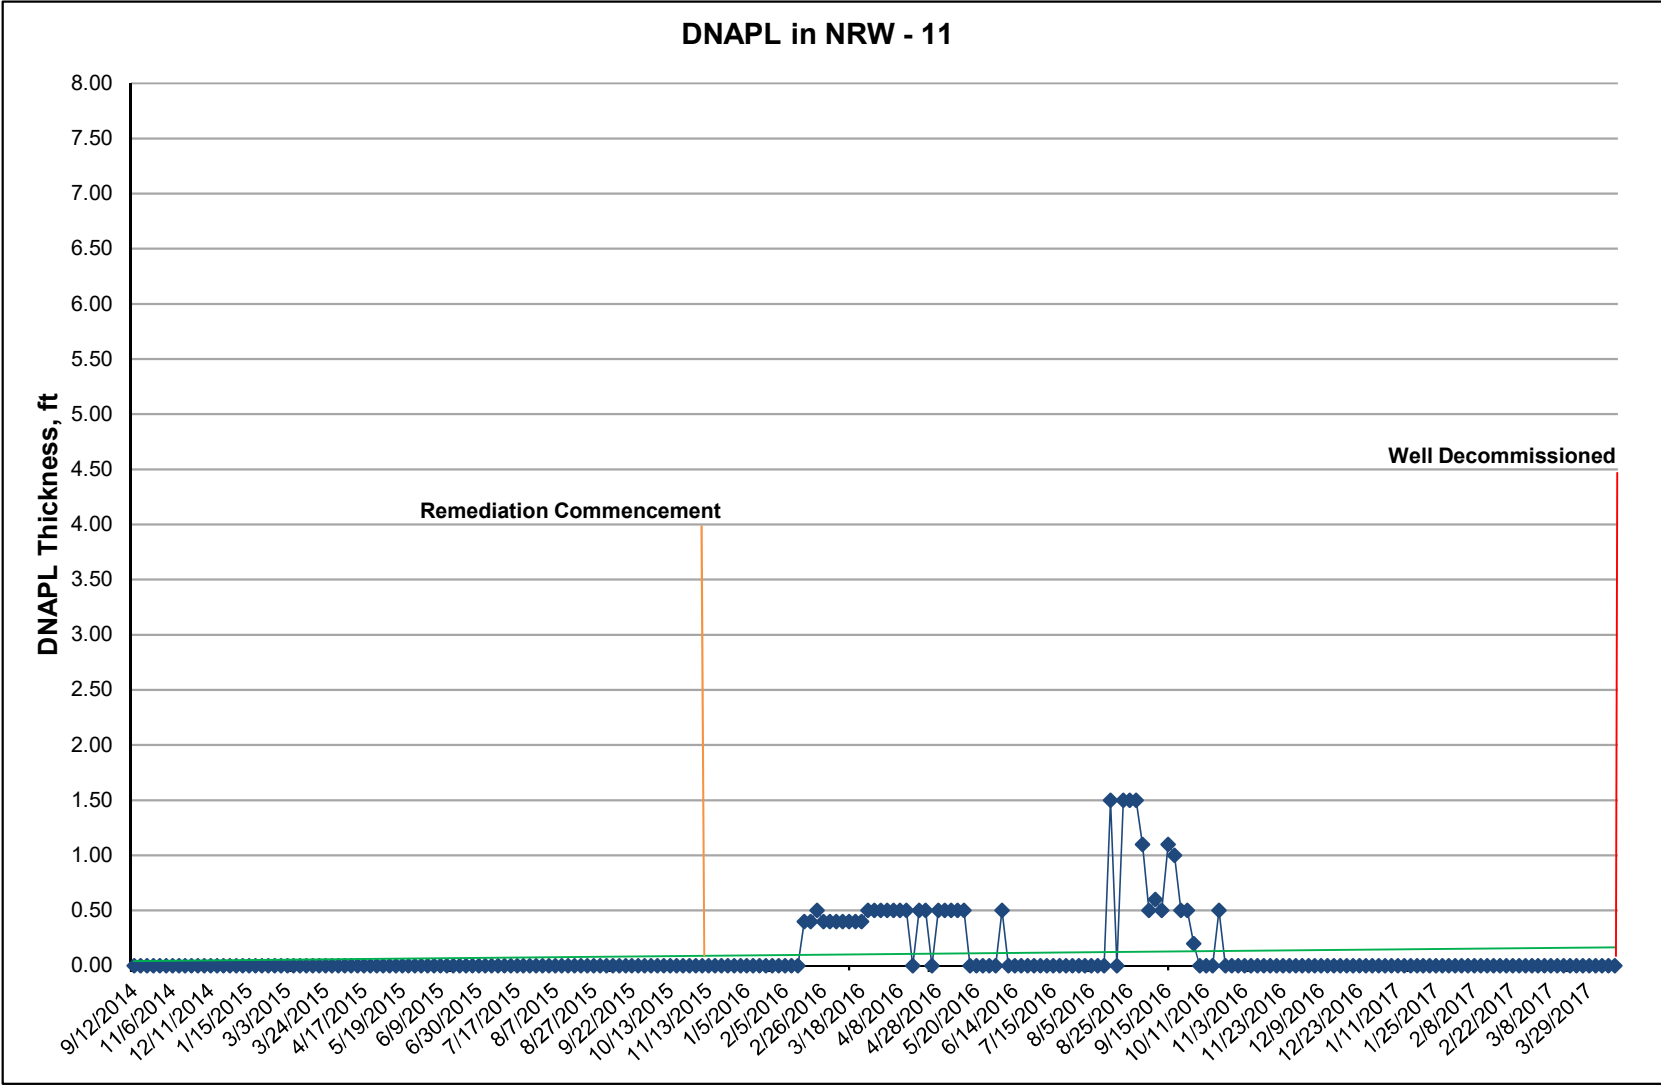

Note: NRW - 11 decommissioned on April 4, 2017 and replaced with NRW - 11R.

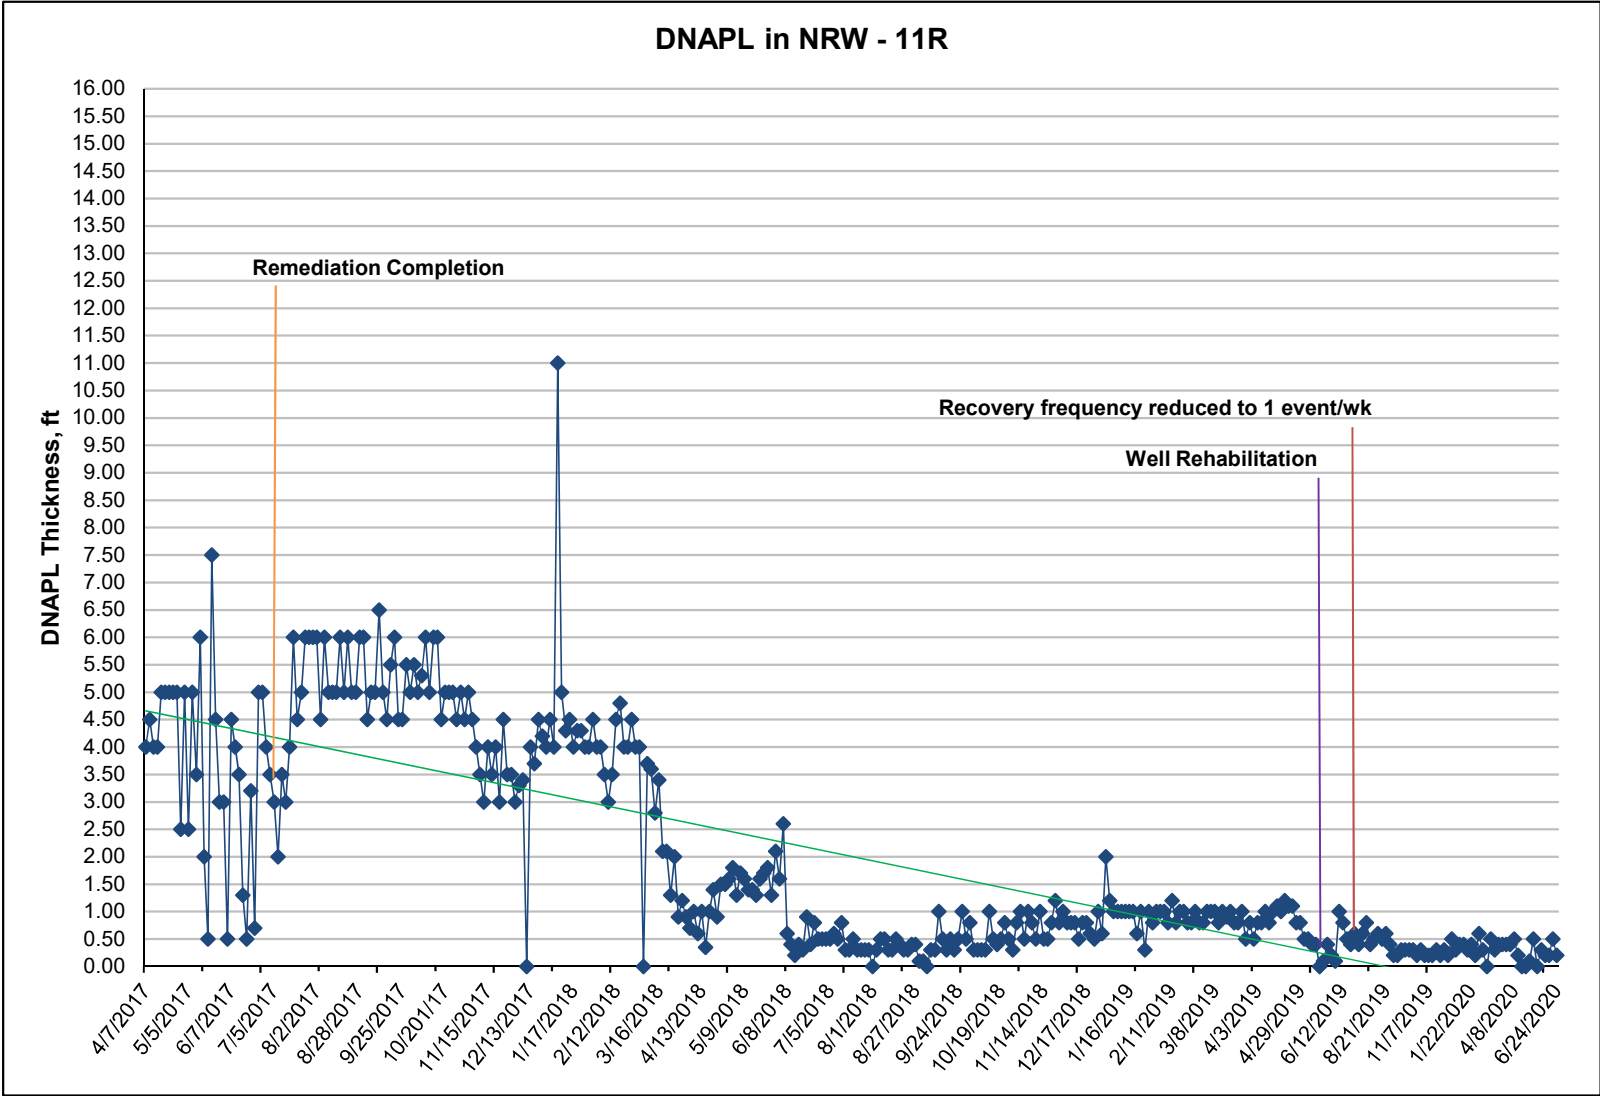

Note: NRW - 11R installed March 23, 2017.

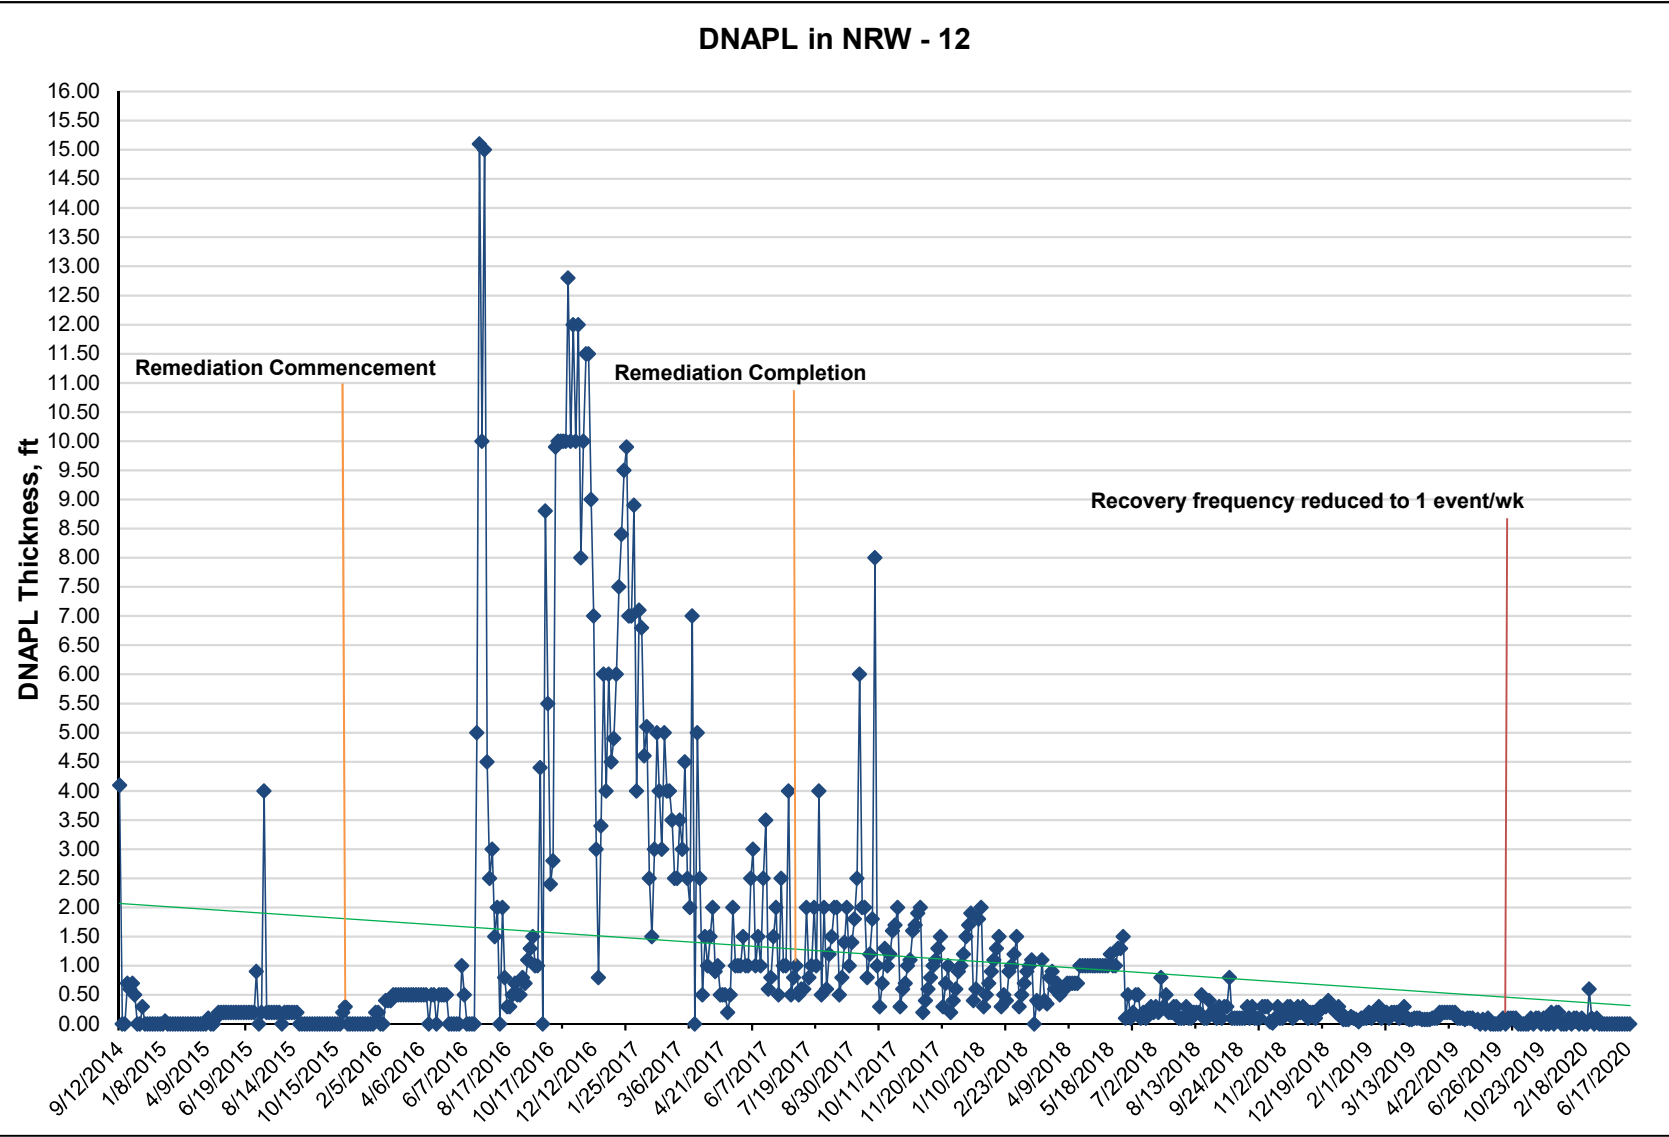

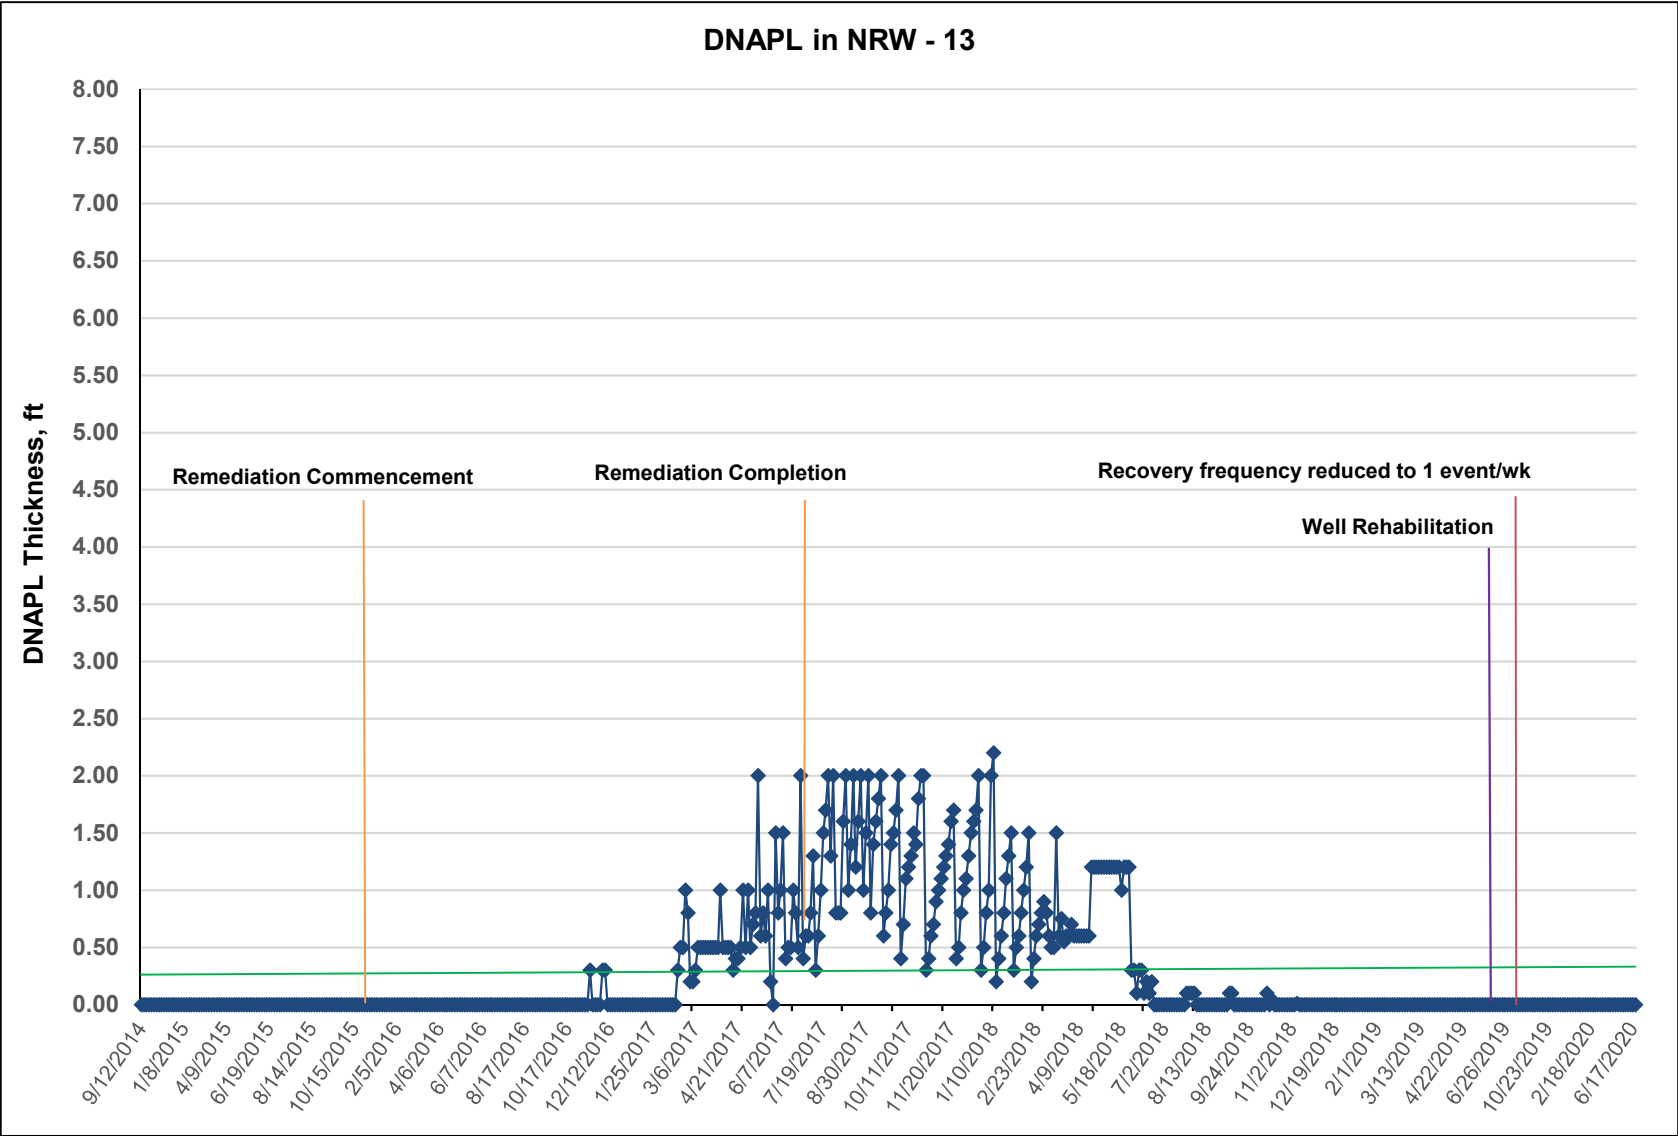


Table 2
Summary of DNAPL Water Removal
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																	Event Volume
Date	NRW-01 Gallons	NRW-01R Gallons	NRW-02 Gallons	NRW-03 Gallons	NRW-04 Gallons	NRW-05 Gallons	NRW-06 Gallons	NRW-07 Gallons	NRW-08 Gallons	NRW-08R Gallons	NRW-09 Gallons	NRW-09R Gallons	NRW-10 Gallons	NRW-11 Gallons	NRW-11R Gallons	NRW-12 Gallons	NRW-13 Gallons	Gallons
9/12/2014	--	--	8	--	--	--	--	15	10.5	--	20	--	18	--	--	8	--	79
9/25/2014	--	--	10	--	--	--	--	27	--	--	4.5	--	19	--	--	--	--	61
10/9/2014	--	--	6	--	--	--	--	24	4	--	4	--	13	--	--	--	--	51
10/16/2014	--	--	--	--	--	--	--	19	--	--	2	--	--	--	--	--	--	21
10/23/2014	--	--	9	--	27	--	--	38	1	--	4	--	6	--	--	1	--	86
10/30/2014	--	--	9	--	--	--	--	44	7	--	22	--	7	--	--	2	--	91
11/6/2014	--	--	5	--	--	--	--	17	2	--	3	--	5	--	--	4	--	36
11/13/2014	--	--	5	11	14	--	--	24	2	--	8	--	8	--	--	--	--	72
11/20/2014	--	--	1	6.5	8	--	--	19	--	--	5	--	7	--	--	--	--	47
11/26/2014	--	--	--	--	--	--	--	34	3	--	5	--	--	--	--	4	--	46
12/4/2014	--	--	11	3	3	--	--	64	7	--	7	--	10	--	--	--	--	105
12/8/2014	--	--	--	--	--	--	--	8	--	--	--	--	--	--	--	--	--	8
12/11/2014	--	--	--	--	--	--	--	7	--	--	3	--	4	--	--	--	--	14
12/15/2014	--	--	--	--	--	--	--	9	--	--	--	--	--	--	--	--	--	9
12/18/2014	--	--	3	3	--	--	--	7	--	--	--	--	4	--	--	--	--	17
12/24/2014	--	--	--	--	--	--	--	10	6	--	5	--	--	--	--	--	--	21
12/31/2014	--	--	5	2	2	--	--	14	2	--	2	--	6	--	--	--	--	33
1/8/2015	--	--	1	1	1	--	--	13	--	--	3	--	5	--	--	--	--	23
1/15/2015	--	--	1	--	1	--	--	18	--	--	3	--	3	--	--	--	--	25
1/22/2015	--	--	--	1	1	--	--	17	2	--	2	--	9	--	--	--	--	31
1/29/2015	--	--	2	--	--	--	--	12	--	--	2	--	3	--	--	--	--	17
2/19/2015	--	--	--	--	--	--	--	20	--	--	--	--	4	--	--	--	--	24
2/23/2015	--	--	--	--	--	--	--	12	--	--	4	--	--	--	--	--	--	17
2/27/2015	--	--	--	--	--	--	--	6	1	--	2	--	2.5	--	--	--	--	11
3/3/2015	--	--	--	--	--	--	--	10	--	--	--	--	--	--	--	--	--	10
3/6/2015	--	--	--	--	--	--	--	7	--	--	--	--	2	--	--	--	--	9
3/10/2015	--	--	--	--	--	--	--	6	1	--	2	--	--	--	--	--	--	9
3/13/2015	--	--	--	--	--	--	--	4	--	--	--	--	--	--	--	--	--	4
3/17/2015	--	--	--	--	--	--	--	12	--	--	2	--	3	--	--	--	--	17
3/20/2015	--	--	--	--	--	--	--	7	--	--	--	--	2	--	--	--	--	8
3/24/2015	--	--	--	--	--	--	--	3	--	--	--	--	2	--	--	--	--	4
3/27/2015	--	--	--	--	--	--	--	12	--	--	--	--	--	--	--	--	--	12
3/31/2015	--	--	--	--	--	--	--	9	--	--	--	--	--	--	--	--	--	9
4/3/2015	--	--	9	--	--	--	--	7	--	--	--	--	--	--	--	--	--	16
4/15/2015	--	--	--	--	--	--	--	7	--	--	4	--	--	--	--	--	--	11
4/17/2015	--	--	--	--	--	--	--	9	--	--	--	--	2	--	--	--	--	11
4/22/2015	--	--	5	--	--	--	--	6	--	--	--	--	--	--	--	--	--	11
4/24/2015	--	--	--	--	--	--	--	5	--	--	--	--	--	--	--	--	--	5
4/29/2015	--	--	2	--	--	--	--	6	--	--	2	--	1	--	--	--	--	10
5/11/2015	--	--	--	--	--	--	--	7	--	--	--	--	--	--	--	--	--	7
5/15/2015	--	--	--	--	--	--	--	20	--	--	8	--	--	--	--	--	--	28
5/19/2015	--	--	--	--	--	--	--	5	--	--	--	--	--	--	--	--	--	5
5/22/2015	--	--	--	--	--	--	--	15	--	--	--	--	10	--	--	--	--	25
5/26/2015	--	--	4	--	--	--	--	15	--	--	--	--	--	--	--	--	--	19
5/29/2015	--	--	--	--	--	--	--	12	3	--	--	--	5	--	--	--	--	20
6/2/2015	--	--	3	--	--	--	--	15	--	--	--	--	4	--	--	--	--	22
6/5/2015	--	--	--	--	--	--	--	10	--	--	3	--	3	--	--	--	--	16
6/9/2015	--	--	--	--	--	--	--	12	--	--	5	--	7	--	--	--	--	24
6/12/2015	--	--	--	--	--	--	--	10	--	--	4	--	4	--	--	--	--	18
6/16/2015	--	--	--	--	--	--	--	10	--	--	--	--	8	--	--	--	--	18
6/19/2015	--	--	--	--	--	--	--	10	--	--	--	--	12	--	--	--	--	22
6/23/2015	--	--	--	--	--	--	--	12	--	--	5	--	5	--	--	--	--	22
6/26/2015	--	--	5	--	--	--	--	10	--	--	--	--	--	--	--	--	--	15
6/30/2015	--	--	5	6	--	--	--	8	--	--	--	--	2	--	--	1.5	--	22
7/3/2015	--	--	5	--	--	--	--	4	--	--	--	--	--	--	--	--	--	9
7/7/2015	--	--	--	--	--	--	--	15	--	--	--	--	5	--	--	--	--	20
7/10/2015	--	--	--	--	--	--	--	12	--	--	--	--	--	--	--	--	--	12
7/14/2015	--	--	3	--	--	--	--	12	--	--	3	--	8	--	--	--	--	26
7/17/2015	--	--	--	--	--	--	--	10	--	--	--	--	5	--	--	--	--	15
7/20/2015	--	--	--	--	--	--	--	12	--	--	--	--	8	--	--	--	--	20
7/24/2015	--	--	--	--	--	--	--	10	--	--	--	--	--	--	--	--	--	10
7/28/2015	--	--	--	--	--	--	--	15	--	--	--	--	5	--	--	--	--	20
7/31/2015	--	--	--	--	--	--	--	4	--	--	--	--	--	--	--	--	--	4
8/4/2015	--	--	--	--	--	--	--	15	--	--	--	--	--	--	--	--	--	15
8/7/2015	--	--	--	--	--	--	--	8	--	--	3	--	5	--	--	--	--	16
8/11/2015	--	--	--	--	--	--	--	15	--	--	--	--	5	--	--	--	--	20
8/14/2015	--	--	3	--	--	--	--	12	--	--	--	--	--	--	--	--	--	15
8/18/2015	--	--	--	--	--	--	--	15	--	--	--	--	5	--	--	--	--	20
8/21/2015	--	--	5	--	--	--	--	10	3	--	3	--	--	--	--	--	--	21
8/25/2015	--	--	--	--	--	--	--	5	--	--	3	--	--	--	--	--	--	8
8/27/2015	--	--	--	--	--	--	--	5	--	--	5	--	--	--	--	--	--	10
9/4/2015	--	--	--	--	--	--	--	12	--	--	--	--	8	--	--	--	--	20
9/8/2015	--	--	--	--	--	--	--	8	--	--	7	--	--	--	--	--	--	15
9/10/2015	--	--	--	--	--	--	--	7	--	--	--	--	2	--	--	--	--	9
9/15/2015	--	--	--	--	--	--	--	10	--	--	--	--	10	--	--	--	--	20
9/17/2015	--	--	--	--	--	--	--	12	--	--	--	--	--	--	--	--	--	12
9/22/2015	--	--	--	--	--	--	--	15	--	--	10	--	--	--	--	--	--	25
9/24/2015	--	--	--	--	--	--	--	15	--	--	--	--	10	--	--	--	--	25
9/29/2015	--	--	--	--	--	--	--	15	--	--	--	--	--	--	--	--	--	15
10/1/2015	--	--	--	--	--	--	--	10	--	--	--	--	--	--	--	--	--	10
10/6/2015	--	--	2	--	--	--	--	10	--	--	--	--	--	--	--	--	--	12
10/8/2015	--	--	--	--	--	--	--	10	--	--	5	--	10	--	--	--	--	25
10/13/2015	--	--	--	--	--	--	--	15	--	--	--	--	10	--	--	--	--	25
10/15/2015	--	--	--	--	--	--	--	15	--	--	--	--	--	--	--	--	--	15
10/22/2015	--	--	--	--	--	--	--	10	--	--	--	--	--	--	--	--	--	10
10/29/2015	--	--	4	--	--	--	--	12	4	--	6	--	10	--	--	--	--	36
11/4/2015	--	--	2	--	--	--	--	15	5	--	2	--	6	--	--	1	--	31
11/9/2015	--	--	--	--	--	--	--	10	2	--	2.5	--	4	--	--	--	--	18
11/13/2015	--	--	2	--	--	--	--	15	--	--	1	--	2	--	--	--	--	20
11/18/2015	--	--	2	--														

Table 2
Summary of DNAPL Water Removal
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																	Event Volume Gallons
	NRW-01 Gallons	NRW-01R Gallons	NRW-02 Gallons	NRW-03 Gallons	NRW-04 Gallons	NRW-05 Gallons	NRW-06 Gallons	NRW-07 Gallons	NRW-08 Gallons	NRW-08R Gallons	NRW-09 Gallons	NRW-09R Gallons	NRW-10 Gallons	NRW-11 Gallons	NRW-11R Gallons	NRW-12 Gallons	NRW-13 Gallons	
2/5/2016	--			--	--	--		6	--				2	--		--	--	8
2/8/2016	--			--	--	--		6	--				2	--		--	--	8
2/11/2016	--			--	--	--		7	--				1	--		--	--	8
2/16/2016	--			--	--	--		9	--				5	--		--	--	14
2/18/2016	--			--	--	--		4	--				3	--		--	--	7
2/22/2016	--			--	--	--		7	--				--	--		--	--	7
2/26/2016	--			--	--	--		7	--				--	--		--	--	7
2/29/2016	--			--	--	--		6.0	--				4	--		--	--	10
3/3/2016	--		4	--	--	--		7	--				--	--		--	--	11
3/8/2016	--			--	--	--		9	--		4		3	--		--	--	15
3/11/2016	--			--	--	--		5	--				--	--		--	--	5
3/16/2016	--			--	--	--		8	--				4	--		--	--	11
3/18/2016	--			--	--	--		4	--				--	--		--	--	4
3/22/2016	--			--	--	--		6	--				--	--		--	--	6
3/25/2016	--			--	--	--		6	--				--	--		--	--	6
3/29/2016	--			--	--	--		7	--				5	--		--	--	12
4/1/2016	--			--	--	--		5	--				--	--		--	--	5
4/6/2016	--			--	--	--		8	2		2		--	--		--	--	11
4/11/2016	--			--	--	--		7	--				6	--		--	--	12
4/15/2016	--			--	--	--		7	--				--	--		--	--	7
4/18/2016	--			--	--	14		7	--				7	--		--	--	27
4/22/2016	--			--	--	--		7	--		3		7	--		--	--	16
4/26/2016	--			--	--	--		7	--				--	--		--	--	7
4/28/2016	--			--	--	--		6	--				6	--		--	--	12
5/3/2016	--			--	--	--		3	--				4	--		--	--	6
5/6/2016	--			--	--	--		5	--				3	--		--	--	8
5/10/2016	--			--	--	--		4	--				2	--		--	--	6
5/13/2016	--			--	--	--		8	--				2	--		--	--	10
5/17/2016	--			--	--	--		19	--				14	--		--	--	33
5/20/2016	--			--	--	--		8	--		0.5		11	--		--	--	19
5/24/2016	--			--	--	--		--	--				4	--		--	--	4
5/27/2016	--			--	--	--		--	--				11.5	--		--	--	12
5/31/2016	--			--	--	--		6.5	--				7.5	--		--	--	14
6/7/2016	--			--	--	--		15	--				5	--		--	--	20
6/9/2016	--			--	--	--		6	--				--	--		--	--	6
6/14/2016	--			--	--	--		9.5	--		7.5		8	--		--	--	25
6/17/2016	--		11	--	--	--		15.5	--				--	--		--	--	27
6/21/2016	--			--	--	--		21	--				--	--		--	--	21
7/6/2016	--		1.5	--	--	--		12	2.5				5	--		6	--	27
7/8/2016	--			--	--	--		--	--				15	--		2	--	17
7/12/2016	--		4	--	--	--		15	--				7	--		8	--	34
7/15/2016	--			--	--	--		5	--				11	--		21	--	37
7/19/2016	--			--	--	--		10	--				14	--		8	--	32
7/22/2016	--			--	--	--		5	--				16	--		5	--	26
7/26/2016	--			--	--	--		12	--				9	--		5	--	26
7/29/2016	--			--	--	--		7	--		2		2.5	--		2	--	14
8/2/2016	--			--	--	--		7.5	--		1.5		1	--		4	--	14
8/5/2016	--		2	--	--	--		6	--		2		1.5	--		--	--	12
8/9/2016	--			--	--	--		9	--		1		1	--		4	--	15
8/12/2016	--		2	--	--	--		6	--				2	--		--	--	10
8/17/2016	--			--	--	--		6.5	--		5		2.5	--		--	--	14
8/19/2016	--		3	--	--	--		3.5	1.5				--	--		--	--	8
8/23/2016	--			--	--	--		7	--				2	--		--	--	9
8/25/2016	--			--	--	--		4	--				2	--		--	--	6
8/30/2016	--		1	--	--	--		7	--				1	1		--	--	10
9/2/2016	--		1.5	--	--	--		6	--				1	2		--	--	11
9/6/2016	--			--	--	--		6	--		1		1.5	--		--	--	9
9/9/2016	--			--	--	--		6	--		1.5		1	--		--	--	9
9/12/2016	--			--	--	--		6	--		2.0		--	--		--	--	8
9/15/2016	--			--	--	--		5.5	3				--	--		--	--	9
9/21/2016	--		3	--	--	--		9	--		3.0		2	--		--	--	17
9/26/2016	--		2.5	--	--	--		6	--		2.0		2.5	--		--	--	13
9/29/2016	--			--	--	--		3.5	--				2	--		1	--	7
10/4/2016	--			--	--	--		7.5	--				--	--		--	--	8
10/7/2016	--		5.5	--	--	--		11.5	--				4.5	--		--	--	22
10/11/2016	--			--	--	--		8	--				--	--		16	--	24
10/14/2016	--			--	--	--		7	--		5.5		--	--		11	--	24
10/17/2016	--			--	--	--		7.5	--				--	--		5	--	13
10/21/2016	--			--	--	--		4	--				--	--		--	--	4
10/26/2016	--			--	--	--		12.5	--				--	--		16.5	--	29
10/31/2016	--			--	--	--		8	--				3.5	--		16.5	--	28
11/3/2016	--		2	--	--	--		4.5	--				--	--		10	--	17
11/7/2016	--		2	--	--	--		5	--				--	--		12	--	19
11/10/2016	--		1	--	--	--		5.5	--				3	--		12	--	21
11/16/2016	--			--	--	--		9.5	--		1.5		--	--		21	--	32
11/18/2016	--		2.5	--	--	--		5	--				--	--		16	--	24
11/21/2016	--		1	--	--	--		6	--				--	--		15	--	22
11/23/2016	--		1	--	--	--		4	--				--	--		12.5	--	18
11/28/2016	--			--	--	--		13	--				--	--		17	--	30
11/30/2016	--		5	--	--	--		3	--				--	--		15	--	23
12/2/2016	--		2	--	--	--		9	--				2	--		13	--	26
12/5/2016	--			--	--	--		--	--				--	--		20	--	20
12/7/2016	--			--	--	--		2.5	--				--	--		16	--	19
12/9/2016	--		5	--	--	--		7	--				4	--		13	--	29
12/12/2016	--		5	--	--	--		3	--				5	--		12	--	25
12/14/2016	--			--	--	--		3	--				8	--		6	--	17
12/16/2016	--		7	--	--	--		6	--				4	--		1.5	--	19
12/19/2016	--		5	--	--	--		4	--				3	--		5.5	--	18
12/21/2016	--		2	--	--	--		1.5	--				1	--		8	--	13
12/23/2016	--			--	--	--		2.5	--				4.5	--		8	--	15
12/27/2016	--			--	--	--		3	--				6	--		10	--	19
12/29/2016	--			--	--	--		6	--				5	--		9	--	20
1/3/2017	--		3															

Table 2
Summary of DNAPL Water Removal
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																	Event Volume Gallons
	NRW-01 Gallons	NRW-01R Gallons	NRW-02 Gallons	NRW-03 Gallons	NRW-04 Gallons	NRW-05 Gallons	NRW-06 Gallons	NRW-07 Gallons	NRW-08 Gallons	NRW-08R Gallons	NRW-09 Gallons	NRW-09R Gallons	NRW-10 Gallons	NRW-11 Gallons	NRW-11R Gallons	NRW-12 Gallons	NRW-13 Gallons	
1/27/2017	--	--	4	--	--	--	--	10	--	--	--	--	--	--	--	10	--	24
1/30/2017	--	--	2	--	--	--	--	7	--	--	--	--	--	--	--	10	--	19
2/1/2017	--	--	4	--	--	--	--	7	--	--	--	--	--	--	--	7	--	18
2/3/2017	--	--	--	--	--	--	--	9	--	--	--	--	--	--	--	10	--	19
2/6/2017	--	--	3	--	--	--	--	12	--	--	--	--	--	--	--	5	--	20
2/8/2017	--	--	--	--	--	--	--	10	--	--	--	--	7	--	--	3	--	20
2/10/2017	--	--	3	--	--	--	--	11	--	--	--	--	--	--	--	6	--	20
2/14/2017	--	--	6	--	--	--	--	11	--	--	--	--	4	--	--	6	--	27
2/15/2017	--	--	1	--	--	--	--	6.5	--	--	--	--	--	--	--	8	--	16
2/17/2017	--	--	--	--	--	--	--	6.5	--	--	--	--	--	--	--	8	--	15
2/21/2017	--	--	--	--	--	--	--	12	--	--	--	--	--	--	--	10	--	22
2/22/2017	--	--	--	--	--	--	--	7	--	--	--	--	--	--	--	6.5	--	14
2/24/2017	--	--	--	--	--	--	--	11	--	--	--	--	--	--	--	6	2	19
2/27/2017	--	--	--	--	--	--	--	12	--	--	--	--	5	--	--	5	1	23
3/1/2017	--	--	--	--	--	--	--	8	4	--	--	--	--	--	--	5	--	17
3/3/2017	--	--	--	--	--	--	--	7.5	--	--	--	--	--	--	--	5	--	13
3/6/2017	--	--	--	--	--	--	--	8	--	--	--	--	--	--	--	6	--	14
3/8/2017	--	--	--	--	--	--	--	10	5	--	--	--	--	--	--	5	--	20
3/13/2017	--	--	--	--	--	--	--	15	4	--	--	--	--	--	--	7	--	26
3/15/2017	--	--	4	--	--	--	--	7	--	--	--	--	--	--	--	4	--	15
3/17/2017	--	--	--	--	--	--	--	10	--	--	--	--	--	--	--	3.5	--	14
3/22/2017	--	--	6	--	--	--	--	--	--	--	--	--	--	--	--	16	--	22
3/24/2017	--	--	--	--	--	--	--	12	4	--	--	--	--	--	--	--	--	16
3/29/2017	--	--	--	--	--	--	--	14	2	--	--	--	--	--	--	6	--	22
3/30/2017	--	--	--	--	--	--	--	4	2	--	--	--	--	--	--	5	--	11
3/31/2017	--	--	--	--	--	--	--	8	6	--	--	--	--	--	--	--	--	14
4/3/2017	--	--	--	--	--	--	--	8	--	--	--	--	2	--	--	2	2	14
4/5/2017	--	--	--	--	--	--	--	8	2	--	--	--	2	--	--	3	--	15
4/7/2017	--	--	--	--	--	--	--	4	--	--	--	--	2	--	--	2	--	7
4/10/2017	--	--	--	--	--	--	--	12	2	--	--	--	2	--	--	3	--	18
4/12/2017	--	--	--	--	--	--	--	10	2	--	--	--	--	--	--	1	--	13
4/14/2017	--	--	--	--	--	--	--	8	1	--	--	--	1	--	--	2	--	12
4/18/2017	--	--	--	--	--	--	--	10	--	--	--	--	2	--	--	--	--	12
4/21/2017	--	--	--	--	--	--	--	5	1	--	--	--	1.5	--	--	--	--	8
4/24/2017	--	--	--	--	--	--	--	15	--	--	--	--	--	--	--	--	--	15
4/26/2017	--	--	--	--	--	--	--	8	1	--	--	--	1	--	--	--	1	11
4/28/2017	--	--	1	--	--	--	--	7	--	--	--	--	1	--	8	--	--	17
5/3/2017	--	--	--	--	--	--	--	18	1	--	--	--	1	--	6	1	--	27
5/5/2017	--	--	--	--	--	--	--	6	2	--	--	--	5	--	5	1	--	19
5/8/2017	--	--	--	--	--	--	--	7	--	--	--	--	2	--	5	3	--	17
5/10/2017	--	--	--	--	--	--	--	7	--	--	--	--	--	--	7	3	5	22
5/12/2017	--	--	--	--	--	--	--	5	--	--	--	--	1	--	6	1	--	13
5/16/2017	--	--	--	--	--	--	--	11	--	--	--	--	1	--	5	1	--	18
5/19/2017	--	--	--	--	--	--	--	5	--	--	--	--	3	--	--	5	--	13
5/22/2017	--	--	--	--	--	--	--	--	--	--	--	--	--	--	15	5	2	22
5/25/2017	--	--	--	--	--	--	--	13	2	--	--	--	1	--	8	1	--	25
5/31/2017	--	--	--	--	--	--	--	13	--	--	--	1	--	--	5	4	--	23
6/1/2017	--	--	--	--	--	--	--	7	--	--	--	--	2	--	4	0	2	17
6/5/2017	--	--	1	--	--	--	--	6	--	--	--	--	--	--	--	--	--	8
6/7/2017	--	--	--	--	--	--	--	4	1	--	--	--	2	--	8	6	0	23
6/9/2017	--	--	--	--	--	--	--	4	--	--	--	--	0	--	5	--	2	13
6/12/2017	--	--	--	--	--	--	--	7	3	--	--	--	0	--	5	--	--	17
6/14/2017	--	--	0	--	--	--	--	2	0	--	--	--	--	--	2	2	--	8
6/16/2017	--	--	--	--	--	--	--	2	0.4	--	--	--	0.4	--	--	3	--	7
6/19/2017	--	--	1	--	--	--	--	5	1	--	--	--	1	--	6	--	0.4	16
6/21/2017	--	--	--	--	--	--	--	3	--	--	--	--	--	--	--	--	--	3
6/23/2017	--	--	--	--	--	--	--	6	0.4	--	--	--	0.4	--	9	0.4	--	17
6/26/2017	--	--	4	--	--	--	--	6	1	--	--	--	1	--	8	1	4	26
6/28/2017	--	--	--	--	--	--	--	4	0.4	--	--	--	1	0.4	8	0	--	15
6/30/2017	--	--	--	--	--	--	--	5	0.4	--	--	--	1	0.4	7	--	--	14
7/5/2017	--	--	2	--	--	--	--	10	2	--	--	--	3	--	5	--	--	24
7/7/2017	--	--	0.4	--	--	--	--	3	1	--	--	--	0.4	--	3	0.4	--	9
7/10/2017	--	--	--	--	--	--	--	4	--	--	--	--	0.4	--	7	--	1	14
7/12/2017	--	--	--	--	--	--	--	6	--	--	--	--	1	--	6	--	--	14
7/14/2017	--	--	4	--	--	--	--	6	--	--	--	--	1	--	7	--	--	20
7/17/2017	--	--	--	--	--	--	--	6	0.4	--	--	--	2	0.4	9	1	--	20
7/19/2017	--	--	--	--	--	--	--	6	2	--	--	--	0.4	--	7	--	--	17
7/21/2017	--	--	2	--	--	--	--	6	3	--	--	--	3	--	7	--	--	23
7/24/2017	--	--	--	--	--	--	--	6	1	--	--	--	1	--	8	1	1	20
7/26/2017	--	--	--	--	--	--	--	8	3	--	--	--	2	1	9	--	--	24
7/31/2017	--	--	1	--	--	--	--	9	--	--	--	--	--	--	11	7	1	31
8/2/2017	--	--	--	--	--	--	--	7	--	--	--	--	--	--	11	--	--	19
8/4/2017	--	--	--	--	--	--	--	3	0.4	--	--	--	--	--	8	2	--	15
8/7/2017	--	--	--	--	--	--	--	5	--	--	--	--	--	--	11	--	--	17
8/9/2017	--	--	2	--	--	--	--	5	--	--	--	--	--	--	9	--	--	17
8/11/2017	--	--	3	--	--	--	--	6	1	--	--	--	1	--	9	1	1	24
8/14/2017	--	--	--	--	--	--	--	7	0.4	--	--	--	--	--	8	4	--	21
8/16/2017	--	--	--	--	--	--	--	9	--	--	--	--	--	--	10	2	--	22
8/18/2017	--	--	--	--	--	--	--	6	3	--	--	--	3	3	9	--	3	28
8/21/2017	--	--	--	--	--	--	--	11	--	--	--	--	--	--	12	--	--	24
8/23/2017	--	--	3	--	--	--	--	6	1	--	--	--	2	1	9	--	--	24
8/25/2017	--	--	--	--	--	--	--	6	--	--	--	--	--	--	9	2	1	20
8/28/2017	--	--	4	--	--	--	--	9	--	--	--	--	--	--	10	--	--	24
8/30/2017	--	--	--	--	--	--	--	6	1	--	--	--	2	0.4	10	--	--	20
9/1/2017	--	--	--	--	--	--	--	4	--	--	--	--	--	--	11	2	1	20
9/6/2017	--	--	--	--	--	--	--	12	--	--	--	--	3	--	9	4	--	30
9/8/2017	--	--	--	--	--	--	--	7	3	--</								

Table 2
Summary of DNAPL Water Removal
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																	Event Volume Gallons
	NRW-01 Gallons	NRW-01R Gallons	NRW-02 Gallons	NRW-03 Gallons	NRW-04 Gallons	NRW-05 Gallons	NRW-06 Gallons	NRW-07 Gallons	NRW-08 Gallons	NRW-08R Gallons	NRW-09 Gallons	NRW-09R Gallons	NRW-10 Gallons	NRW-11 Gallons	NRW-11R Gallons	NRW-12 Gallons	NRW-13 Gallons	
Date																		
10/16/2017	--		--				--	9	--			--	--		11	--	--	21
10/18/2017	--						--	11	--			--	--		9	--	--	21
10/20/2017	--		5				--	9	--			--	--		11	--	--	26
10/23/2017	--		--				--	7	1			2	1		9	--	1	22
10/25/2017	--		--				--	10	--			--	--		9	--	1	21
10/27/2017	--		--				--	6	--			--	--		8	--	--	15
10/30/2017	--		--				--	5	--			--	--		9	--	--	15
11/1/2017	--		--				--	--	--			--	--		7	--	--	7
11/3/2017	--		--				--	12	--			--	--		11	2	--	26
11/6/2017	--		--				--	2	--			--	--		9	--	--	11
11/8/2017	--		--				--	7	--			--	--		9	--	--	17
11/10/2017	--		2				--	7	--			--	--		8	--	--	18
11/13/2017	--		--				--	7	--			--	--		7	--	--	14
11/15/2017	--		--				--	6	--			--	--		8	--	--	15
11/17/2017	--		--				--	5	--			2	--		7	--	--	14
11/20/2017	--		--				--	6	2			--	2		8	--	--	19
11/22/2017	--		--				--	8	--			--	--		7	0.4	1	17
11/27/2017	--		--				--	11	--			--	--		8	--	--	20
11/29/2017	--		1				--	8	--			--	--		8	--	--	18
12/1/2017	--		--				--	6	--			1	--		7	1	--	16
12/4/2017	--		--				--	8	--			--	--		6	--	--	15
12/6/2017	--		--				--	8	--			--	--		7	--	--	16
12/8/2017	--		--				--	7	--			--	--		8	--	--	16
12/11/2017	--		--				--	7	--			--	--		--	--	--	7
12/13/2017	--		--				--	6	--			--	--		8	--	--	15
12/15/2017	--		1				--	6	1			--	2		7	--	--	18
12/18/2017	--		--				--	8	--			--	--		9	--	1	19
12/20/2017	--		--				--	7	--			2	--		9	--	--	18
12/22/2017	--		--				--	5	--			--	--		8	1	--	15
12/27/2017	--		--				--	14	--			--	--		12	--	--	27
12/29/2017	--		--				--	7	--			--	--		8	--	--	16
1/8/2018	--		--				--	21	--			--	--		23	--	--	45
1/10/2018	--		--				--	7	1			1	2		10	1	1	24
1/12/2018	--		--				--	6	--			--	--		8	--	--	15
1/15/2018	--		6				--	7	--			--	--		8	--	--	22
1/17/2018	--		--				--	6	--			--	--		8	--	--	15
1/19/2018	--		--				--	7	--			--	--		9	--	--	17
1/22/2018	--		--				--	7	--			--	--		9	--	--	17
1/24/2018	--		--				--	6	--			--	--		7	--	--	14
1/26/2018	--		--				--	6	--			--	--		7	0.4	0.4	15
1/29/2018	--		--				--	7	1			2	--		8	--	--	18
1/31/2018	--		--				--	6	--			--	2		7	--	--	15
2/2/2018	--		--				--	6	--			--	--		7	--	--	14
2/5/2018	--		1				--	6	--			--	--		6	--	--	14
2/7/2018	--		--				--	6	--			--	--		6	--	--	13
2/9/2018	--		--				--	6	--			--	--		7	--	--	14
2/12/2018	--		--				--	8	--			--	--		9	--	--	18
2/19/2018	--		--				--	7	--			--	--		8	--	--	16
2/21/2018	--		--				--	6	--			--	2		7	--	--	15
2/23/2018	--		--				--	6	--			--	--		7	--	--	14
2/26/2018	--		3				--	7	--			--	--		8	--	--	19
2/28/2018	--		--				--	6	--			--	--		7	--	--	14
3/2/2018	--		--				--	5	--			--	--		7	--	--	13
3/5/2018	--		6				--	3	--			--	--		--	--	--	9
3/12/2018	--		2				--	5	--			--	--		5	--	--	11
3/14/2018	--		--				--	8	--			--	--		4	--	--	12
3/16/2018	--		--				--	8	--			--	--		3	--	--	10
3/19/2018	--		--				--	6	--			--	--		6	--	--	12
3/23/2018	--		--				--	10	--			--	--		9	--	--	19
3/26/2018	--		3				--	9	--			--	--		2	--	--	13
3/28/2018	--		--				--	7	--			3	--		3	--	--	12
3/30/2018	--		--				--	8	--			--	--		8	--	--	16
4/2/2018	--		--				--	8	--			--	--		4	--	--	12
4/4/2018	--		4				--	7	--			--	--		5	--	--	15
4/6/2018	--		--				--	6	--			--	--		4	--	--	9
4/9/2018	--		--				--	5	--			--	--		3	--	--	7
4/11/2018	--		--				--	4	--			--	--		2	--	--	5
4/13/2018	--		--				--	4	--			--	--		6	--	--	9
4/16/2018	--		--				--	12	--			--	--		7	--	--	19
4/18/2018	--		--				--	4	--			--	--		4	--	--	7
4/20/2018	--		--				--	4	--			--	--		4	--	--	7
4/23/2018	--		--				--	6	--			--	--		4	--	--	9
4/25/2018	--		--				--	5	--			--	--		5	--	--	9
4/27/2018	--		--				--	6	--			--	--		6	--	--	12
4/30/2018	--		--				--	8	--			--	--		6	--	--	14
5/2/2018	--		--				--	6	--			--	--		6	--	--	12
5/4/2018	--		--				--	6	--			--	--		4	--	--	9
5/7/2018	--		--				--	8	--			--	--		6	--	--	14
5/9/2018	--		--				--	6	--			--	5		6	--	--	16
5/11/2018	--		--				--	8	--			--	--		6	--	--	14
5/14/2018	--		6				--	8	--			--	--		6	--	--	19
5/16/2018	--		--				--	5	--			--	--		5	--	--	9
5/18/2018	--		--				--	5	--			--	--		6	--	--	10
5/21/2018	--		--				--	6	--			--	--		6	--	--	12
5/23/2018	--		--				--	5	--			--	--		6	--	--	10
5/25/2018	--		--				--	6	--			--	--		6	--	4	15
5/30/2018	--		--				--	12	--			4	--		8	--	--	24
6/1/2018	--		--				--	6	--			--	4		6	6	--	21
6/6/2018	--		--				--	12	--			--	--		8	--	--	20
6/8/2018	--		6				--	6	--			4	2		4	2	--	22
6/11/2018	--		4				--	6	--			--	--		2	--	2	12
6/13/2018	--		4				--	4	--			2	2		2	--	--	12
6/15/2018	--		--				--	4	--			2	2		2	2	--	10
6/18/2018	--		4				--	10	--									

Table 2
Summary of DNAPL Water Removal
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																	Event Volume Gallons
	NRW-01 Gallons	NRW-01R Gallons	NRW-02 Gallons	NRW-03 Gallons	NRW-04 Gallons	NRW-05 Gallons	NRW-06 Gallons	NRW-07 Gallons	NRW-08 Gallons	NRW-08R Gallons	NRW-09 Gallons	NRW-09R Gallons	NRW-10 Gallons	NRW-11 Gallons	NRW-11R Gallons	NRW-12 Gallons	NRW-13 Gallons	
7/11/2018	--		2				--	10	--			6	2		6	10	--	35
7/13/2018	--		10				--	16	--			2	6		10	2	--	45
7/16/2018	--		16				--	16	--			10	10		2	6	--	60
7/18/2018	--		21				--	16	--			2	6		2	2	--	47
7/20/2018	--		16				--	10	--			6	2		6	2	--	41
7/23/2018	--		16				--	21	--			2	2		2	--	--	42
7/25/2018	--		10				--	10	--			2	6		2	2	2	32
7/27/2018	--		6				--	6	--			2	2		2	2	2	19
7/30/2018	--		10				--	10	--			2	2		2	2	2	28
8/1/2018	--		--				--	10	--			2	2		--	2	2	16
8/3/2018	--		6				--	6	--			2	2		2	2	--	18
8/6/2018	--		10				--	6	--			--	2		6	2	--	25
8/8/2018	--		10				--	16	--			--	2		6	2	--	35
8/10/2018	--		--				--	6	--			--	--		--	--	--	6
8/13/2018	--		6				--	--	--			--	--		--	--	--	6
8/15/2018	--		6				--	6	--			2	2		6	--	--	20
8/17/2018	--		2				--	6	--			--	--		3	6	--	16
8/20/2018	--		4				--	10	--			2	--		2	--	--	17
8/22/2018	--		4				--	8	--			2	--		2	--	--	15
8/24/2018	--		8				--	10	--			4	2		4	4	--	30
8/27/2018	--		4				--	10	--			2	--		4	2	--	20
8/29/2018	--		6				--	10	--			2	2		2	2	--	22
8/31/2018	--		6				--	12	--			--	2		--	2	--	21
9/5/2018	--		4				--	21	--			2	2		--	6	2	35
9/7/2018	--		6				--	6	--			2	--		--	2	2	16
9/10/2018	--		2				--	6	--			2	2		--	2	--	12
9/12/2018	--		2				--	6	--			2	2		16	2	--	28
9/14/2018	--		2				--	2	--			2	2		6	10	--	22
9/17/2018	--		2				--	6	--			2	2		2	2	--	13
9/19/2018	--		2				--	2	--			2	2		6	2	--	13
9/21/2018	--		2				--	6	--			2	2		2	2	--	13
9/24/2018	--		2				--	2	--			2	2		2	2	--	9
9/26/2018	--		2				--	10	--			2	2		16	1	--	32
9/28/2018	--		6				--	6	--			2	2		6	2	--	22
10/1/2018	--		2				--	10	--			2	2		10	2	--	26
10/3/2018	--		2				--	6	--			2	2		2	2	--	13
10/5/2018	--		2				--	6	--			2	2		2	2	--	13
10/8/2018	--		2				--	6	--			2	2		6	2	--	18
10/10/2018	--		2				--	6	--			2	2		2	2	--	13
10/12/2018	--		0				--	11	--			0	0		9	0	--	22
10/15/2018	--		2				--	10	--			0	0		6	2	0	19
10/17/2018	--		--				--	6	--			0	--		6	2	--	13
10/19/2018	--		--				--	6	--			0	0		6	2	--	13
10/22/2018	--		0				--	10	--			0	0		10	0	--	21
10/24/2018	--		0				--	10	--			0	0		6	0	--	16
10/26/2018	--		0				--	10	--			0	0		2	0	--	13
10/29/2018	--		0				--	6	--			0	0		10	2	--	18
10/31/2018	--		0				--	10	--			0	0		11	0	--	22
11/2/2018	--		0				--	16	--			0	0		6	0	--	23
11/5/2018	--		2				--	7	--			0	0		9	2	--	20
11/7/2018	--		0				--	6	--			0	2		10	6	0	24
11/9/2018	--		0				--	6	--			2	2		4	2	--	14
11/12/2018	--		--				--	7	--			0	0		11	0	--	20
11/14/2018	--		2				--	10	--			0	0		6	2	--	19
11/19/2018	--		0				--	10	--			0	4		6	4	--	23
11/21/2018	--		0				--	10	--			0	0		10	2	--	22
11/26/2018	--		0				--	9	--			0	2		9	4	--	24
11/28/2018	--		0				--	6	--			2	0		10	2	--	19
12/3/2018	--		0				--	11	--			0	0		11	0	--	24
12/5/2018	--		2				--	10	--			0	0		10	2	--	24
12/7/2018	--		0				--	6	--			0	0		10	2	--	18
12/10/2018	--		0				--	10	--			0	0		10	0	--	21
12/12/2018	--		0				--	6	--			0	0		6	2	--	14
12/14/2018	--		0				--	10	--			2	0		10	4	--	26
12/17/2018	--		0				--	12	--			1	0		12	4	--	30
12/19/2018	--		0				--	10	--			0	0		6	4	--	20
12/21/2018	--		0				--	10	--			0	0		10	6	--	27
12/26/2018	--		4				--	7	--			0	2		9	4	--	26
12/28/2018	--		0				--	10	--			2	0		6	4	--	22
1/2/2019	--		0				--	4	--			2	2		9	2	--	19
1/4/2019	--		0				--	8	--			0	0		8	0	--	17
1/7/2019	--		0				--	4	--			0	0		6	0	--	11
1/9/2019	--		0				--	2	--			0	0		6	0	--	8
1/11/2019	--		0				--	1	--			0	0		4	0	--	5
1/14/2019	--		0				--	8	--			0	0		10	0	--	19
1/16/2019	--		0				--	4	--			0	0		6	1	--	11
1/18/2019	--		0				--	6	--			0	0		6	1	--	13
1/21/2019	--		0				--	6	--			0	0		6	0	--	13
1/23/2019	--		0				--	6	--			1	0		8	0	--	15
1/25/2019	--		0				--	2	--			0	0		2	1	--	5
1/28/2019	--		0				--	6	--			0	0		8	0	--	15
1/30/2019	--		0				--	2	--			0	0		6	0	--	8
2/1/2019	--		0				--	6	--			0	0		8	1	--	15
2/4/2019	--		0				--	8	--			1	0		8	0	--	17
2/6/2019	--		0				--	6	--			0	0		8	1	--	15
2/8/2019	--		0				--	2	--			0	0		6	1	--	9
2/11/2019	--		0				--	8	--			1	1		12	2	--	24
2/13/2019	--		1				--	4	--			0	0		6	1	--	12
2/15/2019	--		0				--	4	--			0	0		10	1	--	15
2/18/2019	--		0				--	8	--			1	0		10	1	--	21
2/20/2019	--		0				--	4	--			0	0		8	0	--	13
2/22/2019	--		1				--	8	--			0	0		8	1	--	18
2/25/2019	--		1				--	8	--			0	0		10	1	--	21
2/27/2019	--		0				--	6	--									

Table 2
Summary of DNAPL Water Removal
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																	Event
	NRW-01 Gallons	NRW-01R Gallons	NRW-02 Gallons	NRW-03 Gallons	NRW-04 Gallons	NRW-05 Gallons	NRW-06 Gallons	NRW-07 Gallons	NRW-08 Gallons	NRW-08R Gallons	NRW-09 Gallons	NRW-09R Gallons	NRW-10 Gallons	NRW-11 Gallons	NRW-11R Gallons	NRW-12 Gallons	NRW-13 Gallons	Volume Gallons
Date																		
3/20/2019	--		0				--	2	--			0	0		6	1	--	9
3/22/2019	--						--	2	--			0	0		4	0	--	6
3/25/2019	--		0				--	6	--			1	0		4	0	--	11
3/27/2019	--		0				--	6	--			1	1		2	0	--	10
3/29/2019	--		0				--	6	--			1	1		4	0	--	12
4/1/2019	--		0				--	4	--			1	0		2	0	--	7
4/3/2019	--		0				--	2	--			0	0		4	1	--	7
4/5/2019	--		0				--	6	--			1	1		4	0	--	12
4/8/2019	--		0				--	2	--			1	1		4	1	--	9
4/10/2019	--		0				--	6	--			1	1		4	1	--	13
4/12/2019	--		1				--	4	--			2	1		3	2	--	13
4/15/2019	--		2				--	8	--			2	2		6	2	--	20
4/17/2019	--		2				--	6	--			1	1		4	2	--	15
4/19/2019	--		2				--	6	--			2	1		6	1	--	17
4/22/2019	--		1				--	6	--			1	2		6	2	--	17
4/24/2019	--		1				--	8	--			1	2		6	1	--	18
4/26/2019	--		1				--	8	--			1	0		6	0	--	16
4/29/2019	--		1				--	8	--			1	0		6	0	--	16
5/1/2019	--		1				--	4	--			1	1		4	0	--	11
5/3/2019	--		1				--	6	--			1	1		4	0	--	13
5/6/2019	--		1				--	6	--			1	0		4	1	--	13
5/8/2019	--		--				--	6	--			1	1		2	0	--	10
5/10/2019	--		--				--	--	--			--	--		--	--	--	0
5/15/2019			--				--	--	--			--	--		--	--	--	0
5/22/2019			--				--	8	--			0	2		4	--	--	13
5/29/2019		--	--				--	2		--		--	--		1	0	--	3
5/31/2019		6	--				--	8		1	--	--	--		2	--	--	17
6/5/2019		4	2				--	6		--		--	--		4	0	--	15
6/12/2019		2	1				--	6		--		--	--		4	--	--	12
6/17/2019		4	--				--	10		--		--	--		4	--	--	17
6/19/2019		9	--				--	4		--		--	--		4	--	--	16
6/26/2019		2	1				--	6		--		--	--		2	--	--	10
7/3/2019		2	--				--	8		--		--	1		2	--	--	12
7/10/2019		4	--				--	6		--		--	--		2	1	--	12
7/17/2019		2	--				--	10		--		--	--		4	--	--	15
7/24/2019		2	--				--	16		--		--	--		2	1	--	20
7/31/2019		4	--				--	14		--		--	--		2	1	--	20
8/7/2019		4	--				--	10		--		--	--		4	1	--	18
8/14/2019		2	--				--	10		--		--	--		4	1	--	16
8/21/2019		4	1				--	12		--		--	--		4	--	--	20
8/28/2019		2	--				--	12		--		--	--		4	--	--	17
9/4/2019		2	--				--	10		--		--	--		1	--	--	13
9/11/2019		--	--				--	6		--		--	--		2	--	--	7
9/17/2019		4	--				--	8		--		--	--		2	1	--	14
9/25/2019		2	--				--	10		--		--	--		2	1	--	14
10/2/2019		2	--				--	8		--		--	--		2	--	--	11
10/9/2019		8	--				--	8		--		--	--		4	1	--	20
10/16/2019		2	2				--	10		--		--	--		2	1	--	16
10/23/2019		2	1				--	10		--		--	2		4	--	--	18
10/30/2019		2	---				--	12		--		---	---		2	1	--	16
11/7/2019		2	---				--	10		--		---	1		2	---	--	14
11/13/2019		4	---				--	8		--		---	2		2	---	--	15
11/20/2019		6	---				--	10		--		---	---		2	2	--	19
11/26/2019		4	---				--	10		--		---	1		4	--	--	18
12/4/2019		2	---				--	10		--		---	---		4	2	--	17
12/11/2019		2	---				--	12		--		---	---		2	2	--	17
12/18/2019		2	---				--	8		--		---	1		4	--	--	14
12/24/2019		1	---				--	8		--		---	1		2	--	--	12
1/2/2020		2	---				--	10		--		--	2		4	--	--	17
1/8/2020		4	---				--	8		--		--	2		4	--	--	17
1/15/2020		1	---				--	10		--		--	2		2	--	--	14
1/22/2020		1	---				--	12		--		--	2		4	1	--	19
1/29/2020		2	1				--	8		1		--	2		2	1	--	16
2/5/2020		2	1				--	8		--		--	2		6	--	--	18
2/12/2020		4	2				--	8		--		--	1		2	1	--	17
2/18/2020		---	---				--	6		--		--	--		--	--	--	6
2/25/2020		---	---				--	6		--		--	--		3	--	--	9
3/3/2020		1	2				--	5		1		1	1		1	--	--	11
3/11/2020		2	2				--	10		--		--	1		4	1	--	19
3/17/2020		---	---				--	11		--		--	--		1	--	--	13
3/25/2020		1	1				--	10		--		--	2		4	1	--	18
4/1/2020		1	1				--	10		--		--	--		2	--	--	14
4/8/2020		1	1				--	12		1		--	--		4	--	--	19
4/14/2020		1	1				--	6		--		--	--		2	--	--	9
4/22/2020		1	2				--	8		--		--	--		--	--	--	11
4/29/2020		1	1				--	6		--		--	--		--	--	--	8
5/6/2020		1	1				--	6		--		--	--		1	--	--	9
5/13/2020		1	1				--	4		1		--	--		2	--	--	8
5/20/2020		2	2				--	6		--		--	--		--	--	--	9
5/27/2020		1	1				--	6		1		--	1		2	--	--	12
6/3/2020		2	1				--	8		--		--	2		2	--	--	14
6/10/2020		1	1				--	8		1		--	--		2	--	--	13
6/17/2020		2	1				--	8		2		--	2		4	--	--	17
6/24/2020		1	1				--	8		1		--	1		2	--	--	14
Total Gallons To Date	0	121	676	33	70	0	0	4,875	165	10	254	173	956	3	2,027	1,018	60	10,442
Percent of Total	0%	1%	6%	0%	1%	0%	0%	47%	2%	0%	2%	2%	9%	0%	19%	10%	1%	100%
Total Gallons - Last Quarter ¹	--	16	15	--	--	--	0	94	--	7	--	0	5	--	19	0	0	--

Notes:

1. Last quarter April through June 2020

-- DNAPL was not pumped

Volumes in the table include DNAPL volume as well as the volume of groundwater that may have been pumped along with DNAPL.


Volume of water in the tube at the beginning of recovery is deducted from the total fluid recovery volume after June 1, 2017.

Well not operational

NRW-01, -03, -04, -05, -08, -09, and -11 are decommissioned.

Replacement recovery wells NRW-09R and NRW-11R were installed on March 27, 2017 and March 23, 2017 respectively.

Replacement recovery wells NRW-01R and NRW-08R were installed on May 21, 2019 and May 24, 2019 respectively.

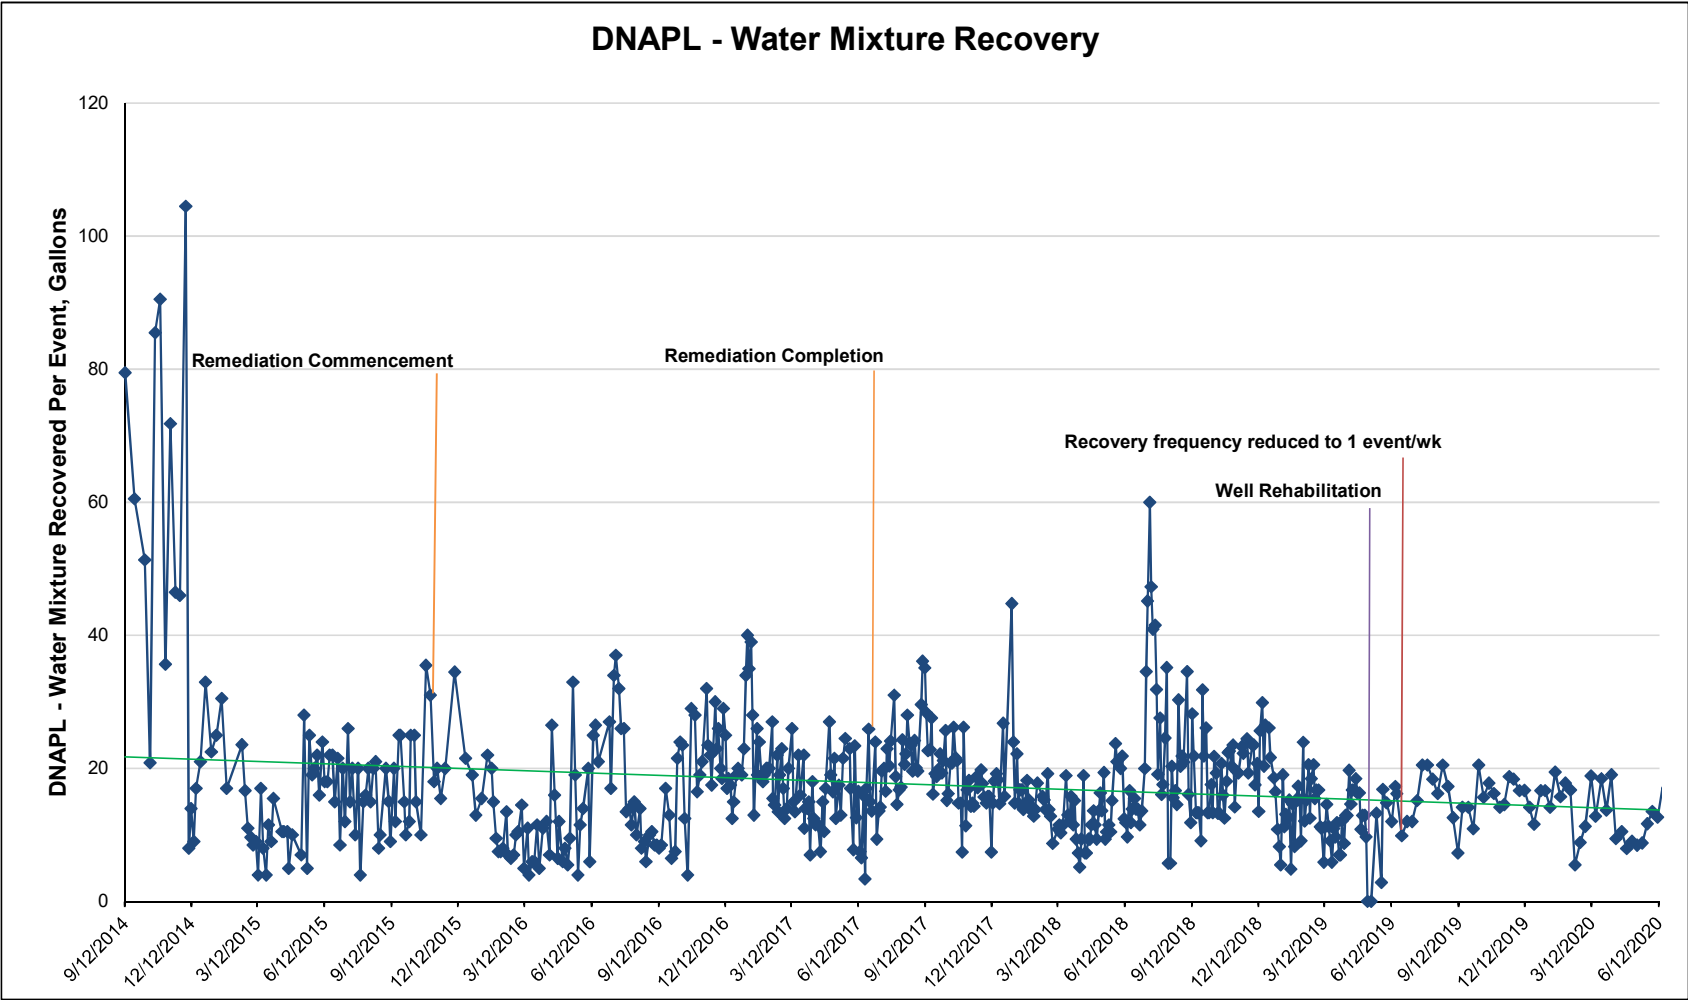

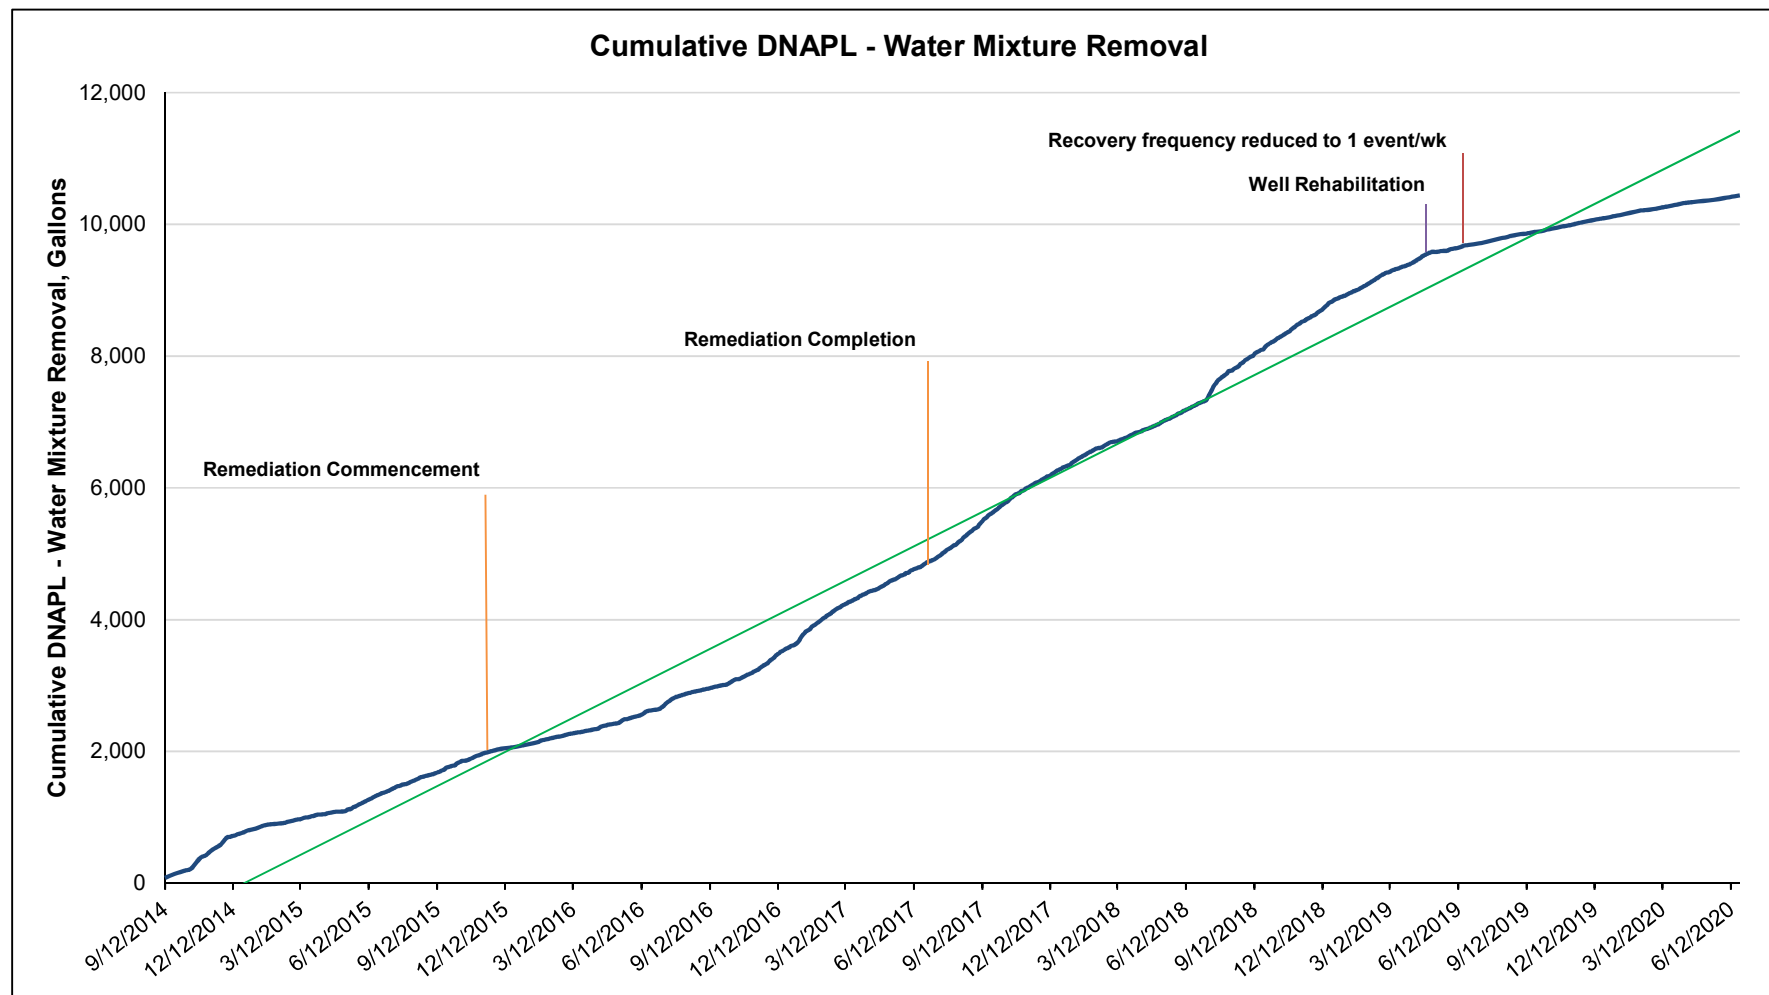


Table 3
Summary of Depth to Bottom Measurements
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area											
	NRW-01	NRW-01R	NRW-02	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09R	NRW-10	NRW-11R	NRW-12	NRW-13
Date	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet
As-Installed	60.00	58.50	65.00	67.00	63.00	59.00	60.50	60.00	55.00	63.00	60.00	60.00
9/11/2014	60.11		64.52	66.37	61.65	58.31			53.88		59.36	59.45
12/18/2014	60.10		64.50	66.40	61.70	58.30			53.90		59.40	59.50
1/8/2015	60.10		64.50	66.50	61.70	58.30			54.30		59.40	59.50
1/15/2015	60.00		64.70	66.30	61.70	58.50			54.30		59.50	59.60
3/10/2015	NM		NM	NM	61.70	58.30			53.90		59.40	59.50
10/4/2016	59.60		64.50	66.40	NM	58.20			54.50		59.50	59.60
4/26/2017	59.50		62.80	66.40	61.90	57.80		53.50	54.30	58.20	59.40	59.60
5/31/2017	30.70*		62.40	66.50	61.30	57.80		53.20	54.10	59.40	59.40	58.40
7/5/2017	30.70*		62.45	66.45	59.35	57.61		52.96	54.28	58.74	59.47	58.58
8/28/2017	30.70*		62.40	66.50	59.50	57.50		53.10	53.90	58.80	59.60	58.50
11/1/2017	29.80*		62.60	66.30	61.22	56.10		53.50	54.00	58.43	59.85	59.83
11/10/2017	30.75*		62.50	66.31	59.35	57.34		53.33	53.81	58.21	59.14	58.21
1/12/2018	29.45*		62.97	66.50	59.42	58.55		53.11	54.00	58.45	59.00	58.58
2/12/2018	29.55*		62.59	66.50	59.80	57.48		53.00	54.10	58.53	59.70	58.61
3/16/2018	NM		NM	NM	59.50	NM		52.95	NM	58.53	59.40	58.50
4/11/2018	30.70*		62.46	66.41	59.38	28.75*		52.96	53.96	58.48	59.48	58.42
5/2/2018	30.70*		62.30	66.40	59.40	27.00*		52.93	53.94	58.62	54.65	58.49
6/13/2018	30.70*		62.50	66.40	59.40	NM		53.10	54.70	58.80	59.60	58.50
8/8/2018	30.80*		62.55	66.50	59.40	28.55*		53.29	53.89	58.60	59.84	59.96
9/24/2018	30.90*		62.51	66.48	59.45	28.78*		53.28	53.91	59.00	59.84	59.98
10/12/2018	30.80*		62.61	66.60	59.49	28.75*		53.38	53.90	58.97	59.73	59.90
11/2/2018	30.78*		62.20	66.50	59.48	28.70*		53.40	54.01	58.95	59.75	59.96
12/3/2018	30.81*		62.69	66.51	59.30	28.40*		53.39	53.88	58.97	59.63	59.89
1/2/2019	30.72*		62.79	66.53	59.41	28.41*		53.39	54.01	58.99	59.59	59.90
2/4/2019	30.73*		62.31	66.61	59.51	28.69*		53.24	54.04	59.94	59.39	59.60
3/6/2019	30.70*		62.42	66.61	59.50	28.72*		53.28	54.17	59.81	59.71	58.60
4/5/2019	30.73*		62.50	67.00	59.71	28.43*		53.23	54.50	59.68	59.70	58.60
5/1/2019	30.80*		62.60	66.46	59.51	28.70*		53.27	54.30	59.66	59.69	58.60
5/10/2019			64.12	NM	59.50			57.85	53.99	62.50	59.56	NM
5/29/2019		58.35	64.02	66.40	61.30		59.90	58.50	54.85	62.35	59.55	59.20
6/5/2019		58.30	64.10	66.39	61.41		59.60	58.47	54.80	62.55	59.55	59.15
6/26/2019		58.64	64.24	66.40	61.76		59.75	58.50	53.95	62.54	59.50	59.20
7/3/2019		58.60	64.12	66.40	61.73		59.71	58.44	53.94	62.54	59.52	59.18
7/10/2019		58.55	64.15	66.40	61.40		59.75	58.35	53.95	62.55	59.50	59.15
7/17/2019		58.60	64.25	66.40	61.40		59.80	58.35	53.95	62.55	59.55	59.15
7/24/2019		58.60	64.25	66.40	61.40		59.80	58.35	53.95	62.55	59.55	59.15
7/31/2019		58.65	64.20	66.40	61.50		59.80	58.35	53.95	62.55	59.50	59.15
8/7/2019		58.55	64.20	66.40	61.45		59.80	58.35	53.90	62.55	59.50	59.15
8/14/2019		58.55	64.22	66.40	61.40		59.88	58.35	53.95	62.55	59.50	59.15
8/21/2019		58.56	64.20	66.40	61.42		59.88	58.35	53.95	62.55	59.55	59.15
8/28/2019		58.55	64.20	66.40	61.40		59.80	58.30	53.90	62.55	59.55	59.15
9/4/2019		58.55	64.20	66.40	61.45		59.80	58.35	53.90	62.55	59.50	59.15
9/11/2019		58.55	64.25	66.40	61.45		59.80	58.35	53.90	62.55	59.50	59.15
9/17/2019		58.55	64.20	66.40	61.45		59.80	58.35	53.95	62.55	59.55	59.15
9/25/2019		58.55	64.20	66.40	61.40		59.80	58.35	53.90	62.50	59.50	59.15
10/2/2019		58.55	64.20	66.40	61.35		59.80	58.35	53.90	62.50	59.50	59.15
10/9/2019		58.30	64.20	66.40	61.20		59.65	58.35	53.80	62.30	59.50	59.15
10/16/2019		58.45	64.00	66.40	61.05		59.55	58.30	53.80	62.40	59.35	59.10
10/23/2019		58.50	64.15	66.40	61.30		58.60	58.40	54.00	62.50	59.50	59.20
10/30/2019		58.40	63.95	66.40	61.40		58.75	58.25	53.90	62.35	59.40	59.10
11/7/2019		58.50	63.80	66.40	61.55		59.60	59.15	53.70	63.40	59.30	59.10
11/13/2019		58.35	63.95	66.40	61.60		59.70	58.35	53.75	62.30	59.20	59.00
11/20/2019		58.35	63.95	66.40	61.75		59.60	58.40	53.70	62.20	59.25	58.90
11/26/2019		58.30	63.85	66.40	61.75		59.55	58.35	53.70	62.40	59.20	59.00
12/4/2019		58.15	63.60	66.40	61.25		59.60	58.25	53.55	62.20	59.10	58.90
12/11/2019		58.25	63.50	66.40	61.40		59.60	58.30	53.40	62.35	59.15	58.80
12/18/2019		58.35	63.50	66.40	61.60		58.25	58.15	53.80	62.30	59.00	58.75
12/24/2019		58.25	63.40	66.40	61.45		58.15	58.10	53.65	62.15	59.00	58.65
1/2/2020		58.15	63.40	66.40	61.55		58.00	58.05	53.85	62.30	58.90	58.60
1/8/2020		58.35	64.00	66.40	61.50		58.60	58.35	53.75	62.35	59.00	58.50
1/15/2020		58.50	64.25	66.40	61.65		58.55	58.50	53.65	62.50	59.10	58.45
1/22/2020		58.50	64.20	66.40	61.55		58.50	58.55	53.75	62.60	59.05	58.40
1/29/2020		58.50	64.05	66.40	61.40		59.60	58.55	53.70	62.50	59.40	58.70
2/5/2020		58.40	64.00	66.40	61.30		59.50	58.50	54.60	62.40	59.60	59.00
2/12/2020		58.35	64.10	66.40	61.35		59.40	58.50	54.50	62.35	59.55	59.00
2/18/2020		58.55	64.09	66.48	61.35		59.75	58.46	53.95	62.41	59.63	59.14
2/25/2020		58.60	64.15	66.40	61.35		59.75	58.50	53.95	62.31	59.60	59.19
3/3/2020		58.62	64.08	66.40	61.35		59.75	58.49	54.05	62.45	59.53	59.23
3/11/2020		58.60	64.05	66.40	61.35		59.70	58.50	54.10	62.45	58.60	59.00
3/17/2020		58.62	64.07	66.40	61.35		59.75	58.50	54.02	62.41	59.61	59.20
3/25/2020		58.65	64.00	66.40	61.40		59.75	58.50	54.05	62.40	58.60	59.20
4/1/2020		58.60	64.00	66.40	61.35		59.75	58.50	54.10	62.40	59.55	59.00

Table 3
Summary of Depth to Bottom Measurements
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area											
	NRW-01	NRW-01R	NRW-02	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09R	NRW-10	NRW-11R	NRW-12	NRW-13
Date	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet
4/8/2020		58.55	64.05	66.40	61.40		59.75	58.50	54.05	62.45	59.60	59.20
4/14/2020		58.57	64.03	66.40	61.40		59.76	58.50	54.10	62.45	59.55	59.00
4/22/2020		58.60	63.91	66.40	61.30		59.70	58.50	53.60	62.45	59.45	58.65
4/29/2020		58.62	63.90	66.40	61.30		59.72	58.50	53.60	62.46	59.45	58.65
5/6/2020		58.60	63.90	66.40	61.30		59.70	58.50	53.60	62.45	59.45	58.65
5/13/2020		58.60	63.90	66.40	61.30		59.70	58.50	53.65	62.45	59.45	58.65
5/20/2020		59.40	64.10	66.40	61.50		59.80	58.45	53.95	62.60	59.70	59.30
5/27/2020		59.45	64.10	66.40	61.45		59.80	58.45	53.90	62.55	58.70	59.30
6/3/2020		59.45	64.10	66.40	61.40		59.75	58.45	53.80	62.45	59.70	59.30
6/10/2020		59.30	64.00	66.40	61.35		59.75	58.45	53.75	62.35	59.70	59.25
6/17/2020		59.30	63.95	66.40	61.40		59.70	58.45	53.70	62.40	59.70	59.25
6/24/2020		59.25	63.90	66.40	61.30		59.65	58.40	53.70	62.45	59.70	59.25

Notes:

NM - Not Measured

Well not operational

NRW-01, -03, -04, -05, -08, -09, and -11 are decommissioned.