

Table 1
Summary of DNAPL Gauging
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13
6/26/2019		0.10	0.50				ND	1.00		ND		ND	ND		0.60	ND	ND
7/3/2019		0.30	ND				ND	1.00		ND		ND	0.20		0.40	ND	ND
7/10/2019		0.40	ND				ND	1.00		ND		ND	ND		0.60	0.10	ND
7/17/2019		0.30	0.10				ND	1.50		ND		ND	ND		0.80	ND	ND
7/24/2019		0.40	ND				ND	2.00		ND		ND	ND		0.40	0.10	ND
7/31/2019		0.50	ND				ND	1.70		ND		ND	ND		0.50	0.10	ND
8/7/2019		0.40	ND				ND	1.50		ND		ND	ND		0.60	0.10	ND
8/14/2019		0.30	ND				ND	1.60		ND		ND	ND		0.50	0.10	ND
8/21/2019		0.40	0.10				ND	2.00		0.10		ND	ND		0.60	ND	ND
8/28/2019		0.30	ND				ND	1.00		ND		ND	ND		0.40	ND	ND
9/4/2019		0.30	ND				ND	1.00		ND		ND	ND		0.20	ND	ND
9/11/2019		ND	ND				ND	0.80		ND		ND	ND		0.20	ND	ND
9/17/2019		0.40	ND				ND	1.00		ND		ND	ND		0.30	0.10	ND
9/25/2019		0.30	ND				ND	1.30		ND		ND	ND		0.30	0.10	ND
10/2/2019		0.30	ND				ND	1.00		ND		ND	ND		0.30	ND	ND
10/9/2019		0.70	ND				ND	0.90		ND		ND	ND		0.30	0.10	ND
10/16/2019		0.30	0.20				ND	1.50		ND		ND	ND		0.20	0.10	ND
10/23/2019		0.30	0.10				ND	1.60		ND		ND	0.30		0.30	ND	ND
10/30/2019		0.30	ND				ND	1.70		ND		ND	ND		0.20	0.10	ND
11/7/2019		0.30	ND				ND	1.40		ND		ND	0.10		0.20	ND	ND
11/13/2019		0.40	ND				ND	1.10		ND		ND	0.20		0.20	ND	ND
11/20/2019		0.50	ND				ND	1.50		ND		ND	ND		0.30	0.20	ND
11/26/2019		0.20	ND				ND	1.40		ND		ND	0.20		0.20	ND	ND
12/4/2019		0.30	ND				ND	1.50		ND		ND	ND		0.30	0.20	ND
12/11/2019		0.30	ND				ND	1.60		ND		ND	ND		0.20	0.20	ND
12/18/2019		0.20	ND				ND	1.20		ND		ND	0.20		0.50	ND	ND
12/24/2019		0.20	ND				ND	1.10		ND		ND	0.20		0.30	ND	ND
1/2/2020		0.30	ND				ND	1.50		ND		ND	0.20		0.40	ND	ND
1/8/2020		0.40	0.30				ND	1.20		0.10		ND	0.30		0.40	0.10	ND
1/15/2020		0.20	ND				ND	1.40		ND		ND	0.20		0.30	ND	ND
1/22/2020		0.20	ND				ND	1.60		ND		ND	0.30		0.40	0.10	ND
1/29/2020		0.30	0.10				ND	1.20		0.20		ND	0.20		0.20	0.10	ND
2/5/2020		0.30	0.10				ND	1.10		Blebs		ND	0.30		0.60	Blebs	ND
2/12/2020		0.50	0.30				ND	1.00		ND		ND	0.20		0.30	0.10	ND
2/18/2020		0.10	Blebs				ND	1.30		ND		ND	Blebs		Blebs	Blebs	ND
2/25/2020		0.10	0.20				ND	1.40		Blebs		Blebs	Blebs		0.50	Blebs	ND
3/3/2020		0.40	0.80				ND	2.20		0.60		0.30	0.40		0.30	0.60	ND
3/11/2020		0.30	0.30				ND	1.50		ND		ND	0.20		0.40	0.10	ND
3/17/2020		0.10	0.10				ND	1.70		ND		ND	ND		0.40	Blebs	ND
3/25/2020		0.20	0.20				ND	1.50		ND		ND	0.30		0.40	0.10	ND
4/1/2020		0.10	0.10				ND	1.00		ND		ND	ND		0.40	ND	ND
4/8/2020		0.10	0.10				ND	1.50		0.10		ND	ND		0.50	ND	ND
4/14/2020		0.10	0.10				ND	1.20		ND		ND	ND		0.20	ND	ND
4/22/2020		0.20	0.30				ND	1.20		ND		ND	ND		ND	ND	ND
4/29/2020		0.20	0.10				ND	1.00		ND		ND	ND		ND	ND	ND
5/6/2020		0.10	0.10				ND	1.10		ND		ND	ND		0.10	ND	ND
5/13/2020		0.20	0.10				ND	1.00		0.10		ND	ND		0.50	ND	ND
5/20/2020		0.30	0.30				ND	1.10		ND		ND	ND		ND	ND	ND
5/27/2020		0.20	0.20				ND	1.00		0.10		ND	0.10		0.30	ND	ND
6/3/2020		0.30	0.10				ND	1.60		ND		ND	0.10		0.20	ND	ND
6/10/2020		0.20	0.20				ND	1.60		0.10		ND	ND		0.20	ND	ND
6/17/2020		0.30	0.20				ND	1.80		0.30		ND	0.30		0.50	ND	ND
6/24/2020		0.20	0.20				ND	1.50		0.10		ND	0.10		0.20	ND	ND
7/1/2020		0.10	0.10				ND	1.80		0.40		ND	ND		0.40	ND	ND
7/8/2020		0.10	0.20				ND	1.60		0.20		ND	ND		0.30	ND	ND
7/15/2020		0.20	0.50				ND	2.30		0.20		0.20	ND		0.10	ND	ND
7/22/2020		0.10	0.20				ND	3.10		0.30		ND	ND		0.10	ND	ND
7/29/2020		0.10	0.20				ND	1.90		0.40		ND	ND		0.30	ND	ND
8/5/2020		0.20	0.20				ND	1.80		0.30		ND	ND		0.40	ND	ND
8/12/2020		0.10	0.40				ND	2.00		0.30		ND	ND		0.20	ND	ND
8/19/2020		0.10	0.20				ND	1.80		0.50		ND	ND		0.20	ND	ND
8/26/2020		0.20	0.20				ND	2.20		0.40		ND	ND		0.30	ND	ND
9/2/2020		0.20	0.10				ND	2.10		0.30		ND	ND		0.20	ND	ND
9/9/2020		0.10	0.10				ND	2.20		0.35		ND	ND		0.20	ND	ND
9/16/2020		0.10	0.20				ND	1.90		0.30		ND	ND		0.20	ND	ND
9/23/2020		0.10	0.10				ND	2.20		0.10		ND	ND		0.20	ND	ND
9/30/2020		0.20	0.20				ND	2.00		0.20		ND	ND		0.30	ND	ND
10/7/2020		0.10	0.10				ND	2.10		0.10		ND	ND		0.20	ND	ND
10/14/2020		0.20	0.20				ND	1.60		0.30		ND	ND		0.30	ND	ND
10/21/2020		0.10	0.20				ND	1.95		0.30		ND	ND		0.50	ND	ND
10/28/2020		0.20	0.20				ND	2.00		0.20		ND	ND		0.40	ND	ND
11/4/2020		0.10	0.30				ND	1.60		0.30		ND	ND		0.40	ND	ND
11/11/2020		0.10	0.20				ND	1.70		0.20		ND	ND		0.20	ND	ND
11/18/2020		0.10	0.20				ND	1.60		0.20		ND	ND		0.20	ND	ND
11/25/2020		0.20	0.20				ND	1.70		0.30		ND	ND		0.30	ND	ND
12/2/2020		0.20	0.40				ND	1.80		0.40		ND	ND		0.10	ND	ND
12/9/2020		0.10	0.30				ND	1.90		0.30		ND	ND		0.40	ND	ND
12/16/2020		0.20	0.30				ND	1.60		0.20		ND	ND		0.30	ND	ND
12/23/2020		0.20	0.20				ND	2.30		0.30		ND	ND		0.30	ND	ND
12/30/2020		0.20	0.30				ND	2.10		0.30		ND	ND		0.50	ND	ND
1/6/2021		0.30	0.30				ND	2.20		0.20		ND	ND		0.50	ND	ND
1/13/2021		0.30	0.70				ND	2.40		0.50		ND	ND		0.50	ND	ND
1/20/2021		0.10	0.20				ND	2.00		0.50		ND	ND		0.10	ND	ND
1/27/2021		0.10	0.30				ND	2.10		0.40		ND	ND		0.40	ND	ND
2/3/2021		ND	ND				ND	1.80		0.40		ND	ND		0.40	ND	ND
2/10/2021		0.10	0.50				ND	2.30		0.50		ND	ND		0.50	ND	ND
2/17/2021		0.20	0.30				ND	2.30		0.60		ND	ND		0.70	ND	ND

Table 1
Summary of DNAPL Gauging
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13
2/24/2021		0.20	0.50				ND	2.00		0.40		ND	ND		0.50	ND	ND
3/3/2021		0.10	0.70				ND	2.60		0.30		ND	ND		0.50	ND	ND
3/10/2021		0.10	0.20				ND	1.90		0.40		ND	ND		0.50	ND	ND
3/17/2021		0.20	0.30				ND	2.50		0.30		ND	ND		0.50	ND	ND
3/24/2021		0.10	0.50				ND	2.30		0.60		ND	ND		0.40	ND	ND
3/31/2021		0.10	0.50				ND	2.20		0.10		ND	ND		0.30	ND	ND
4/7/2021		0.10	0.50				ND	2.40		0.10		ND	ND		0.30	ND	ND
4/14/2021		0.10	0.50				ND	2.40		0.10		ND	ND		0.30	ND	ND
4/21/2021		0.04	0.50				ND	2.40		0.10		ND	ND		0.30	ND	ND
4/28/2021		0.04	0.04				ND	2.71		ND		ND	ND		0.40	ND	ND
5/5/2021		0.10	0.10				ND	1.60		ND		ND	ND		0.40	ND	ND
5/12/2021		0.10	0.10				ND	2.20		0.30		ND	ND		0.30	ND	ND
5/19/2021		0.04	0.50				ND	2.75		ND		ND	ND		ND	ND	ND
5/26/2021		0.17	0.50				ND	2.17		ND		ND	ND		ND	ND	ND
6/2/2021		0.04	0.04				ND	1.92		ND		ND	ND		0.17	ND	ND
6/10/2021		0.04	0.25				ND	1.38		ND		ND	0.16		0.25	ND	ND
6/15/2021		0.10	0.10				ND	2.80		0.50		ND	ND		0.30	ND	ND
6/23/2021		0.42	0.58				ND	1.92		ND		ND	ND		ND	ND	ND
6/30/2021		ND	0.08				ND	2.25		ND		ND	ND		ND	ND	ND
7/7/2021		ND	0.17				ND	1.75		ND		ND	NA		ND	ND	ND
7/14/2021		ND	ND				ND	2.17		ND		ND	NA		ND	ND	ND
7/21/2021		ND	ND				ND	2.08		ND		ND	NA		ND	ND	ND
7/28/2021		ND	ND				ND	2.42		ND		ND	ND		ND	ND	ND
8/4/2021		ND	ND				ND	2.50		1.42		ND	ND		ND	ND	ND
8/11/2021		ND	0.16				ND	1.33		ND		ND	ND		0.16	ND	ND
8/18/2021		ND	ND				ND	2.42		0.08		ND	ND		ND	ND	ND
8/25/2021		ND	ND				ND	1.92		ND		ND	ND		ND	ND	ND
9/1/2021		ND	ND				ND	2.92		ND		ND	ND		ND	ND	ND
9/8/2021		ND	ND				ND	2.00		ND		ND	ND		ND	ND	ND
9/15/2021		ND	0.92				ND	1.50		ND		ND	ND		ND	ND	ND
9/22/2021		ND	ND				ND	2.67		ND		ND	ND		ND	ND	ND
9/29/2021		ND	ND				ND	2.83		ND		ND	ND		ND	ND	ND
10/6/2021		ND	ND				ND	2.25		1.17		ND	ND		NA	NA	ND
10/13/2021		ND	0.50				ND	2.46		0.63		0.58	1.17		1.67	NA	ND
10/20/2021		ND	0.70				ND	2.70		0.60		0.60	1.10		0.05	0.05	ND
10/27/2021		ND	0.75				ND	2.67		0.05		0.42	0.75		0.04	0.25	ND
11/3/2021		0.04	0.04				ND	2.00		0.50		0.25	ND		0.04	0.08	ND
11/10/2021		0.04	0.13				ND	1.50		0.75		0.71	0.04		0.38	0.21	ND
11/17/2021		0.04	0.27				ND	2.08		0.04		0.80	0.08		0.53	0.40	ND
11/24/2021		0.04	0.31				ND	2.55		0.04		0.75	0.55		0.69	NA	ND
12/1/2021		0.35	0.77				ND	2.50		0.23		0.77	0.01		0.76	0.38	ND
12/8/2021		0.21	0.42				ND	1.00		0.75		0.25	0.17		0.25	0.21	ND
12/15/2021		0.30	0.74				ND	2.75		0.19		0.39	0.12		0.85	0.49	ND
12/22/2021		0.32	0.78				ND	2.30		0.22		0.20	0.10		0.91	0.45	ND
12/29/2021		0.21	0.50				ND	1.80		0.50		0.60	0.13		0.25	0.17	ND
1/5/2022		0.29	0.45				ND	2.70		0.65		0.04	0.11		0.23	0.18	ND
1/12/2022		0.20	0.85				ND	2.30		0.35		0.47	0.68		0.10	0.25	ND
1/19/2022		0.20	1.10				ND	1.70		0.35		0.25	0.35		0.20	0.40	ND
1/26/2022		0.18	0.04				ND	2.90		0.40		0.28	0.35		0.31	0.45	ND
2/2/2022		0.20	0.12				ND	2.55		0.52		0.31	0.47		0.38	0.63	ND
2/9/2022		0.20	0.15				ND	2.50		0.52		0.13	0.38		0.35	0.58	ND
2/16/2022		0.23	0.28				ND	2.35		0.10		0.47	0.40		0.52	0.04	ND
2/23/2022		0.25	0.30				ND	2.17		0.15		0.18	0.53		0.09	0.12	ND
3/2/2022		0.31	0.45				ND	2.20		0.27		0.20	0.06		0.12	0.10	ND
3/9/2022		0.04	0.12				ND	2.60		0.09		0.15	0.15		0.20	0.10	ND
3/16/2022		0.04	0.18				ND	2.60		0.35		0.15	0.10		0.31	0.10	ND
3/23/2022		0.04	0.20				ND	2.60		0.09		0.18	0.15		0.25	0.10	ND
3/30/2022		0.15	0.45				ND	2.40		0.26		0.15	0.15		0.42	0.12	ND
4/6/2022		0.15	0.57				ND	2.30		0.42		0.10	0.20		0.05	0.15	ND
4/13/2022		0.15	0.04				ND	2.25		0.35		0.10	0.25		0.10	0.18	ND
4/20/2022		0.12	0.10				ND	2.35		0.42		0.04	0.04		0.10	0.21	ND
4/27/2022		0.10	0.30				ND	2.25		0.16		0.05	0.42		0.12	0.21	ND
5/4/2022		0.15	0.48				ND	2.70		0.34		0.15	0.13		0.21	0.22	ND
5/11/2022		0.13	0.04				ND	2.50		0.35		0.15	0.12		0.21	0.20	ND
5/18/2022		0.15	0.10				ND	2.30		0.10		0.12	0.05		0.31	0.04	ND
5/25/2022		0.21	0.16				ND	2.45		0.40		0.04	0.10		0.04	0.04	ND
6/1/2022		0.26	0.45				ND	3.32		0.46		0.13	0.12		0.05	0.04	ND
6/8/2022		0.23	0.47				ND	2.10		0.12		0.15	0.13		0.05	0.05	ND
6/15/2022		0.22	0.05				ND	2.25		0.24		0.05	0.13		0.07	0.04	ND
6/22/2022		0.10	0.05				ND	2.33		0.33		0.05	0.10		0.10	0.04	ND
6/29/2022		0.10	0.12				ND	2.90		0.04		0.05	0.10		0.13	0.04	ND
7/6/2022		0.10	0.15				ND	3.10		0.04		0.07	0.10		0.21	0.04	ND
7/13/2022		0.10	0.18				ND	2.80		0.47		0.05	0.10		0.35	0.04	ND
7/20/2022		0.13	0.26				ND	2.85		0.09		0.04	0.10		0.47	0.08	ND
7/27/2022		0.15	0.34				ND	2.85		0.18		0.15	0.10		0.04	0.1	ND
8/3/2022		0.15	0.49				ND	2.65		0.38		0.13	0.10		0.12	0.1	ND
8/10/2022		0.15	0.1				ND	4.40		0.04		0.1	0.13		0.15	0.1	ND
8/17/2022		0.15	0.13				ND	3.20		0.16		0.12	0.15		0.17	0.1	ND
8/24/2022		0.15	0.18				ND	3.00		0.42		0.1	0.15		0.15	0.12	ND
8/31/2022		0.15	0.2				ND	3.15		0.19		0.1	0.15		0.18	0.1	ND
9/7/2022		0.18	0.38				ND	2.40		0.39		0.12	0.15		0.26	0.12	ND
9/14/2022		0.28	0.49				ND	2.20		0.46		0.1	0.15		0.32	ND	ND
9/21/2022		0.26	0.1				ND	2.30		0.68		0.1	0.16		0.28	0.01	ND
9/28/2022		0.21	0.12				ND	2.97		0.04		0.1	0.17		0.3	0.1	ND
10/5/2022		0.25	0.37				ND	2.45		0.28		0.15	0.31		0.42	0.13	ND
10/12/2022		0.28	0.52				ND	2.7		0.09		0.19	ND		0.04	0.15	ND
10/13/2022		ND	0.04				ND	3.1		0.31		0.22	0.04		0.12	0.15	ND
10/19/2022		ND	0.16				ND	2.55		0.20		0.30	0.04		0.11	0.1	ND
10/26/2022		0.12	0.19				ND	2.3		0.60		0.25	0.17		0.15	0.1	ND


Table 1
Summary of DNAPL Gauging
50 Kent Avenue Property Holder Area
Brooklyn, New York





Well ID	50 Kent Avenue Property Holder Area																
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13
11/2/2022		0.10	0.25				ND	2.5		0.20		0.22	ND		0.2	0.18	ND
11/9/2022		0.10	0.5				ND	2.7		0.40		0.25	0.3		0.2	0.2	ND
11/16/2022		0.12	0.71				ND	2.65		0.87		0.55	0.3		0.27	0.2	ND
11/23/2022		0.12	0.175				ND	2.85		0.96		0.42	0.3		0.32	0.2	ND
11/30/2022		0.00	0.1				ND	2.5		0.30		0.00	ND		ND	0.1	0.1
12/7/2022		0.00	0.2				ND	2.4		1.50		0.00	0.3		0.3	0.1	ND
12/14/2022		0.10	0.6				ND	2.1		0.15		0.00	0.04		0.04	0.1	ND
12/21/2022		0.10	0.75				ND	2.45		0.35		0.10	0.25		0.15	0.23	ND
12/28/2022		0.15	1.1				ND	2.3		0.70		0.10	0.47		0.2	0.25	ND
1/4/2023		0.18	0.04				ND	2.65		0.10		0.10	0.65		0.29	0.1	ND
1/11/2023		0.35	0.3				ND	2.95		0.27		0.15	0.04		0.04	0.1	ND
1/13/2023		0.38	0.35				ND	1.15		0.30		0.15	0.04		0.1	0.13	ND
1/18/2023		0.40	0.42				ND	2.15		0.45		0.15	0.1		0.13	0.15	ND
1/25/2023		0.00	0.04				ND	2.75		0.49		0.15	0.15		0.22	0.18	ND
2/1/2023		0.20	0.37				ND	2.8		0.04		0.10	0.15		0.2	0.1	ND
2/8/2023		0.25	0.39				ND	2.55		0.35		0.15	0.18		0.2	0.13	ND
2/15/2023		0.04	0.12				ND	2.7		0.75		0.10	0.15		0.25	0.15	ND
2/22/2023		0.12	0.36				ND	2.53		0.35		0.12	0.1		0.41	0.13	ND
3/1/2023		0.15	0.5				ND	2.8		0.45		0.10	0.15		0.04	0.13	ND
3/8/2023		0.16	0.75				ND	2.6		0.10		0.12	0.18		0.15	0.13	ND
3/15/2023		0.18	0.1				ND	2.55		0.32		0.12	0.23		0.2	0.15	ND
3/22/2023		0.15	0.22				ND	2.45		0.08		0.15	0.1		0.15	0.1	ND
3/29/2023		0.15	0.25				ND	2.5		0.10		0.15	0.1		0.17	0.13	ND
Max Thickness	0.00	0.70	1.10	0.00	0.00	0.00	0.00	4.40	0.00	1.50	0.00	0.80	1.17	0.00	1.67	0.63	0.10
Average Thickness	0.00	0.19	0.30	0.00	0.00	0.00	0.00	2.06	0.00	0.33	0.00	0.21	0.22	0.00	0.30	0.16	0.10
Overall Median Value	0.00	0.20	0.20	0.00	0.00	0.00	0.00	2.17	0.00	0.30	0.00	0.15	0.15	0.00	0.30	0.10	0.10
Last Quarter Median ¹	NC	0.17	0.33	NC	NC	NC	ND	2.58	NC	0.31	NC	0.14	0.15	NC	0.19	0.13	ND


Notes:


1. Last quarter January through March 2023.
2. Reported dataset commences on June 26, 2019 when NAPL recovery frequency was reduced to one event per week.
3. Historical dataset is presented in **Appendix A**.
4. NRW-01, -03, -04, -05, -08, -09, and -11 are decommissioned.
5. Replacement recovery wells NRW-09R and NRW-11R were installed on March 27, 2017 and March 23, 2017 respectively.
6. Replacement recovery wells NRW-01R and NRW-08R were installed on May 21, 2019 and May 24, 2019 respectively.
7. NC - Not calculated
8. NM - Not Measured
9. ND - No Product Detected
10. NA - No Access
11. Blebs - Blebs were present in the well
12. Well not operational during monitoring period.
13. Unit of measurement: Feet

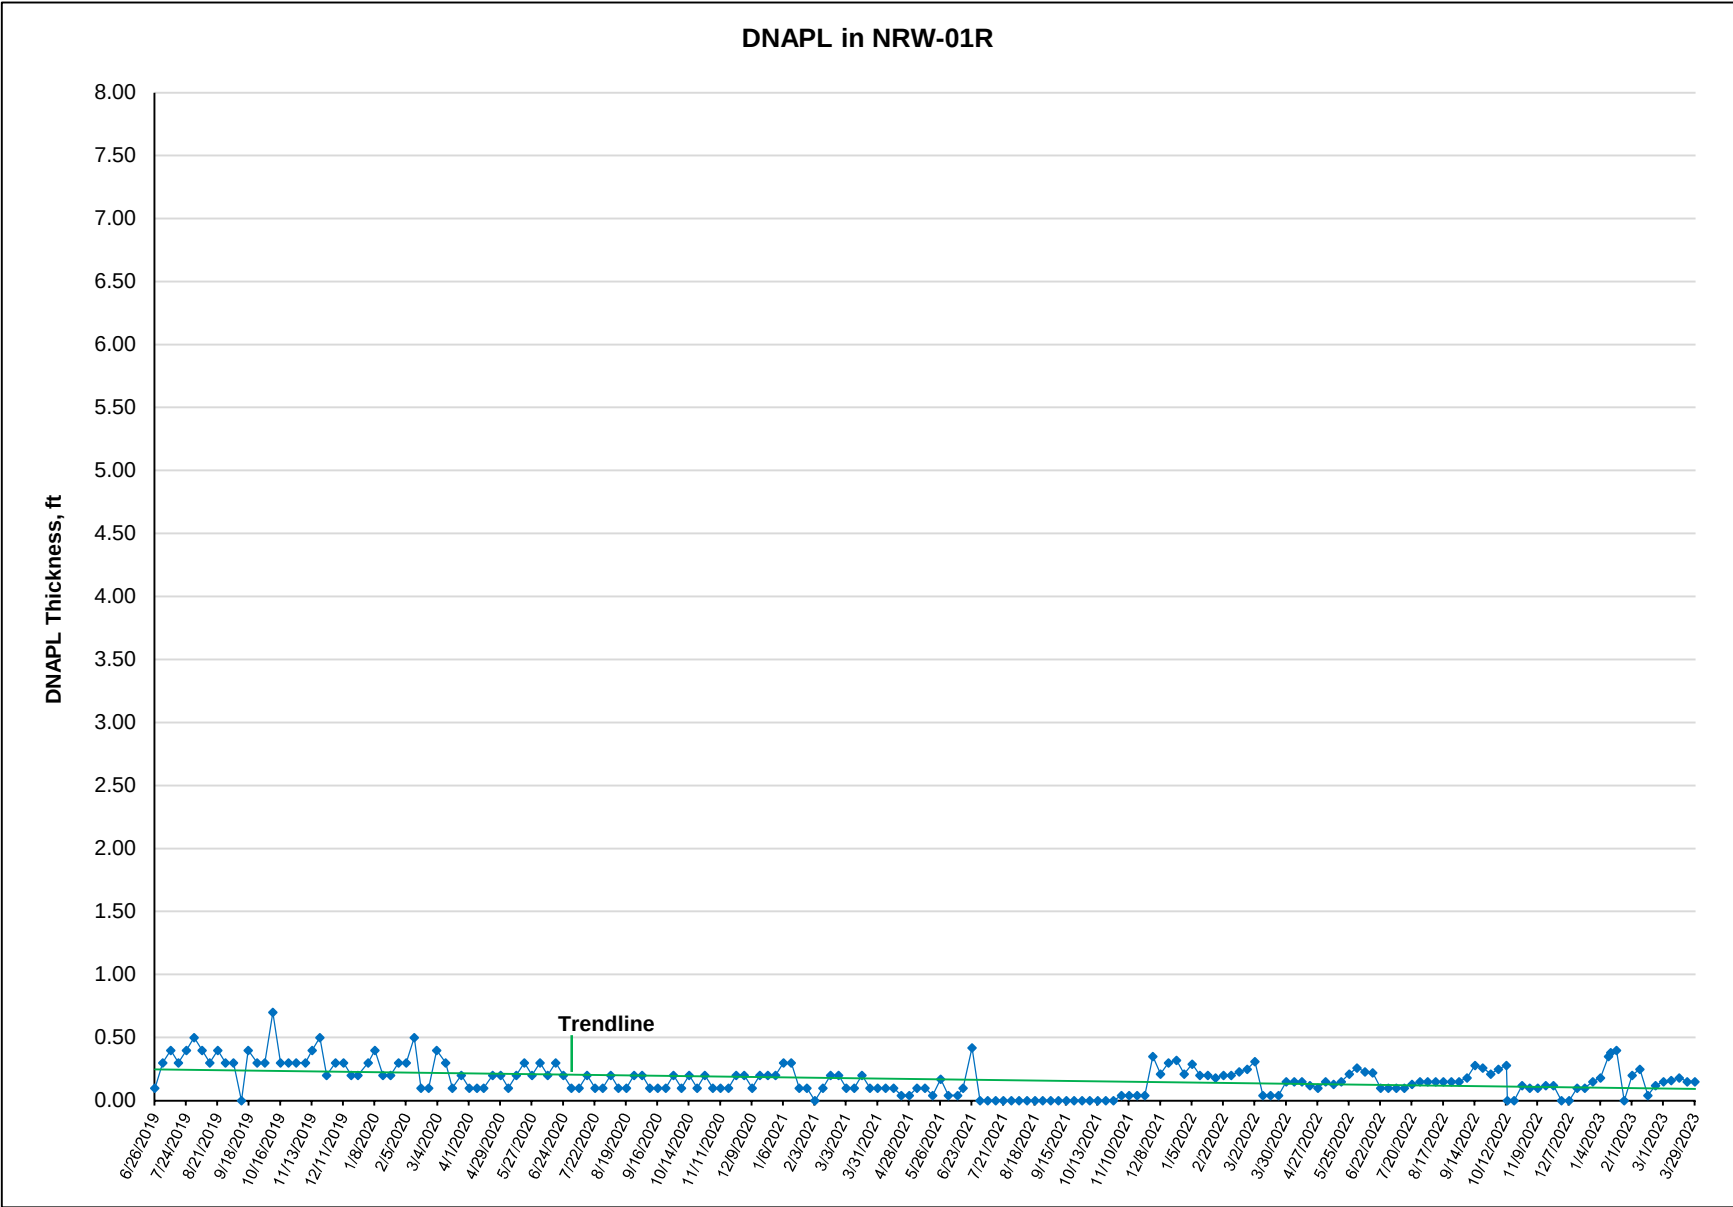


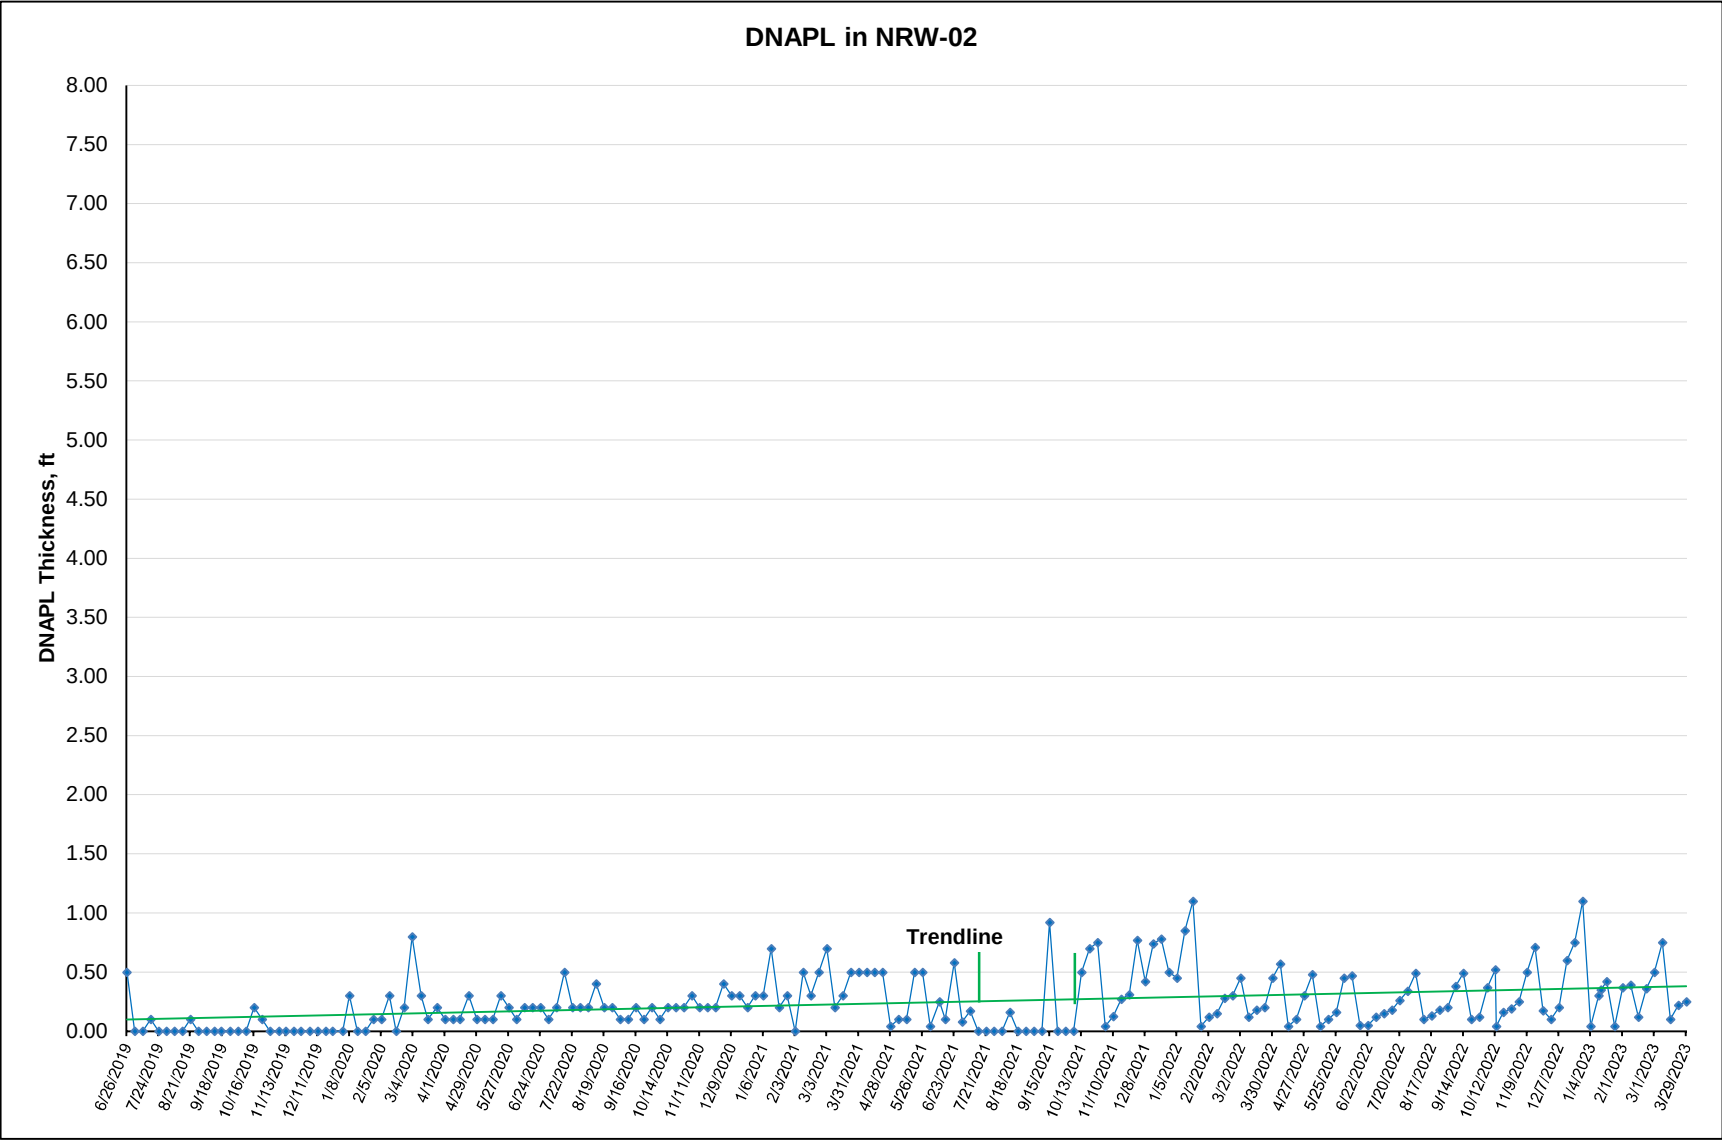


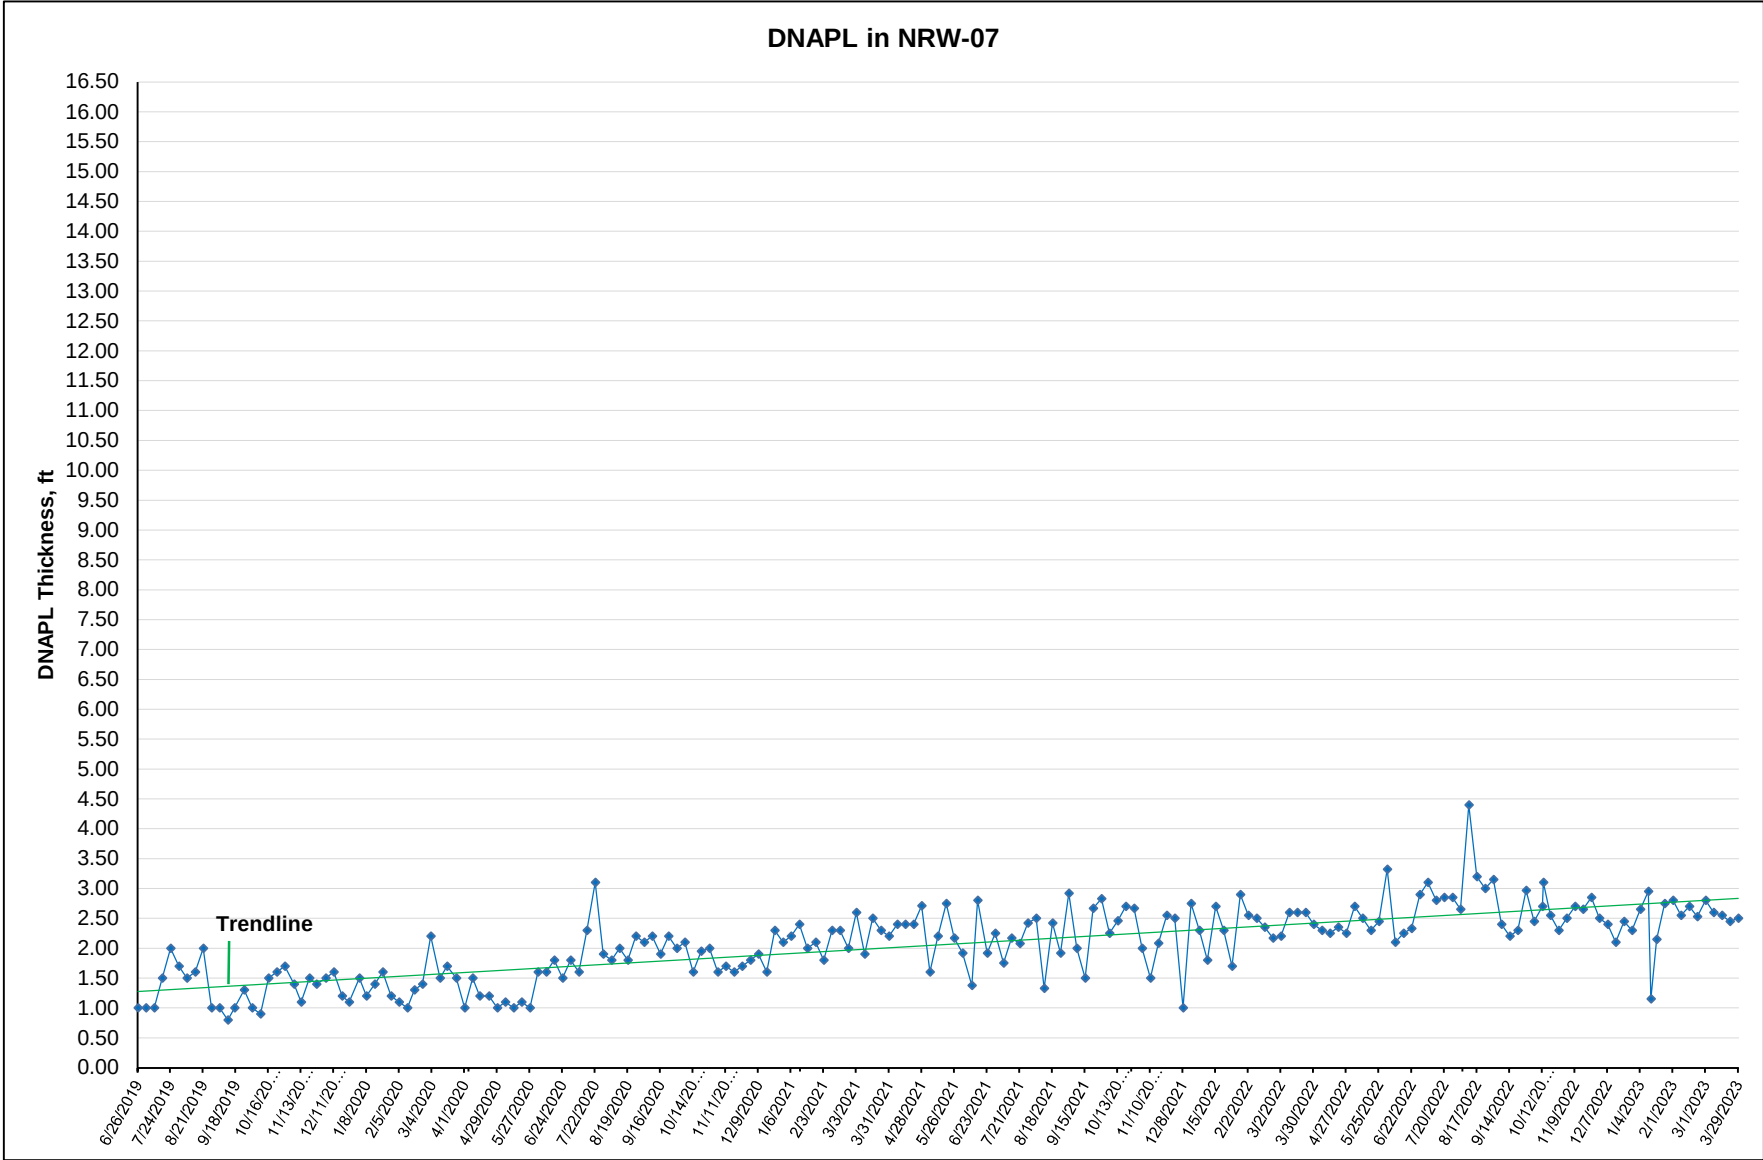


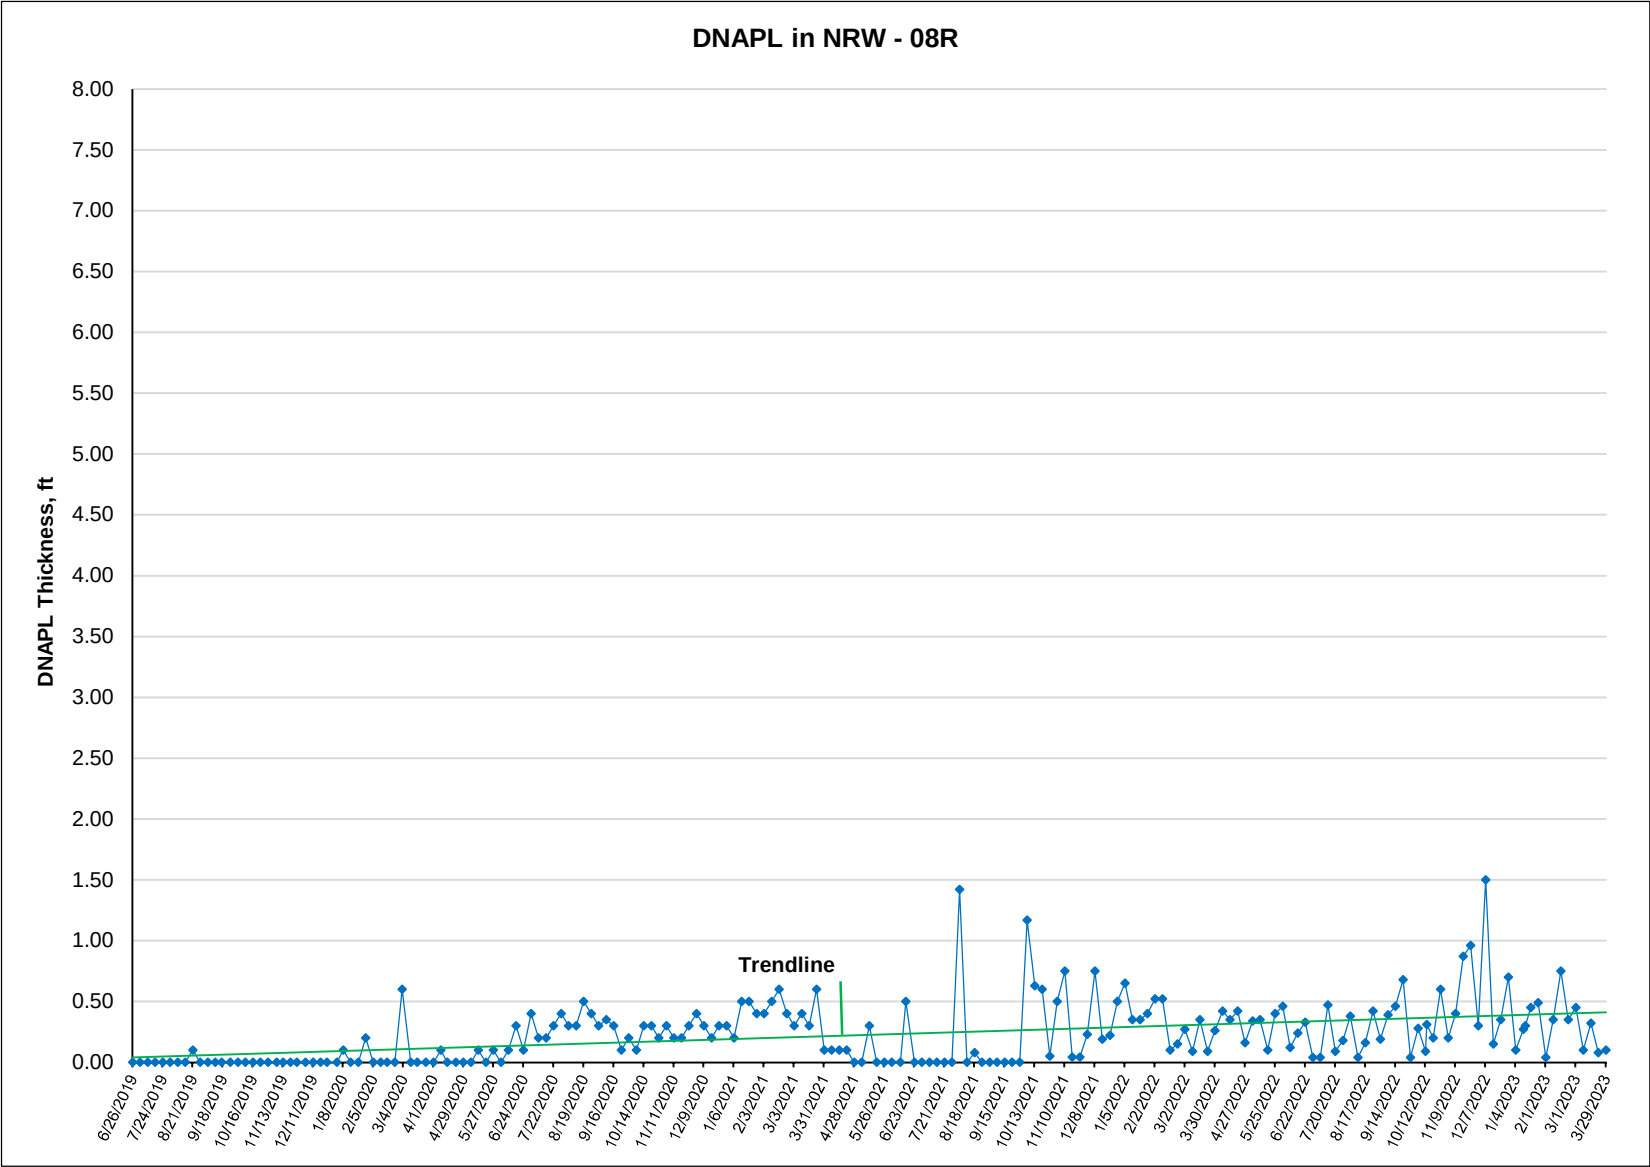

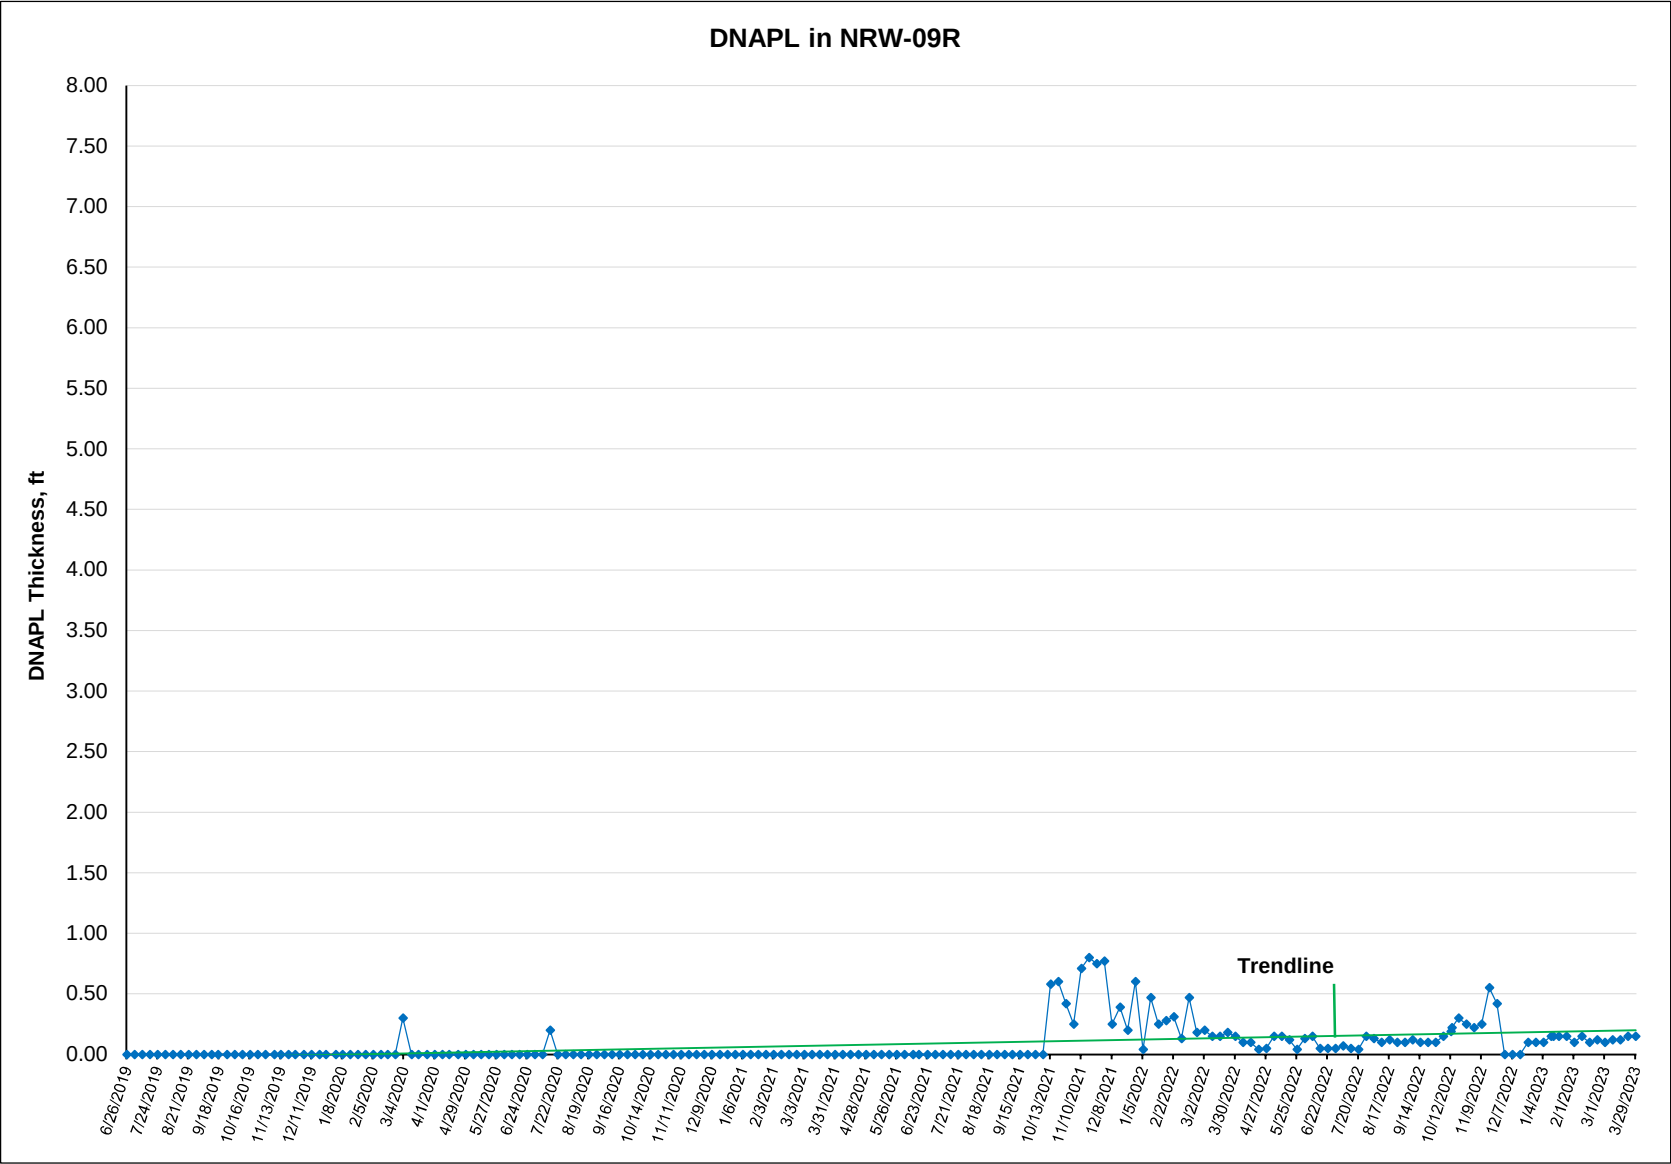

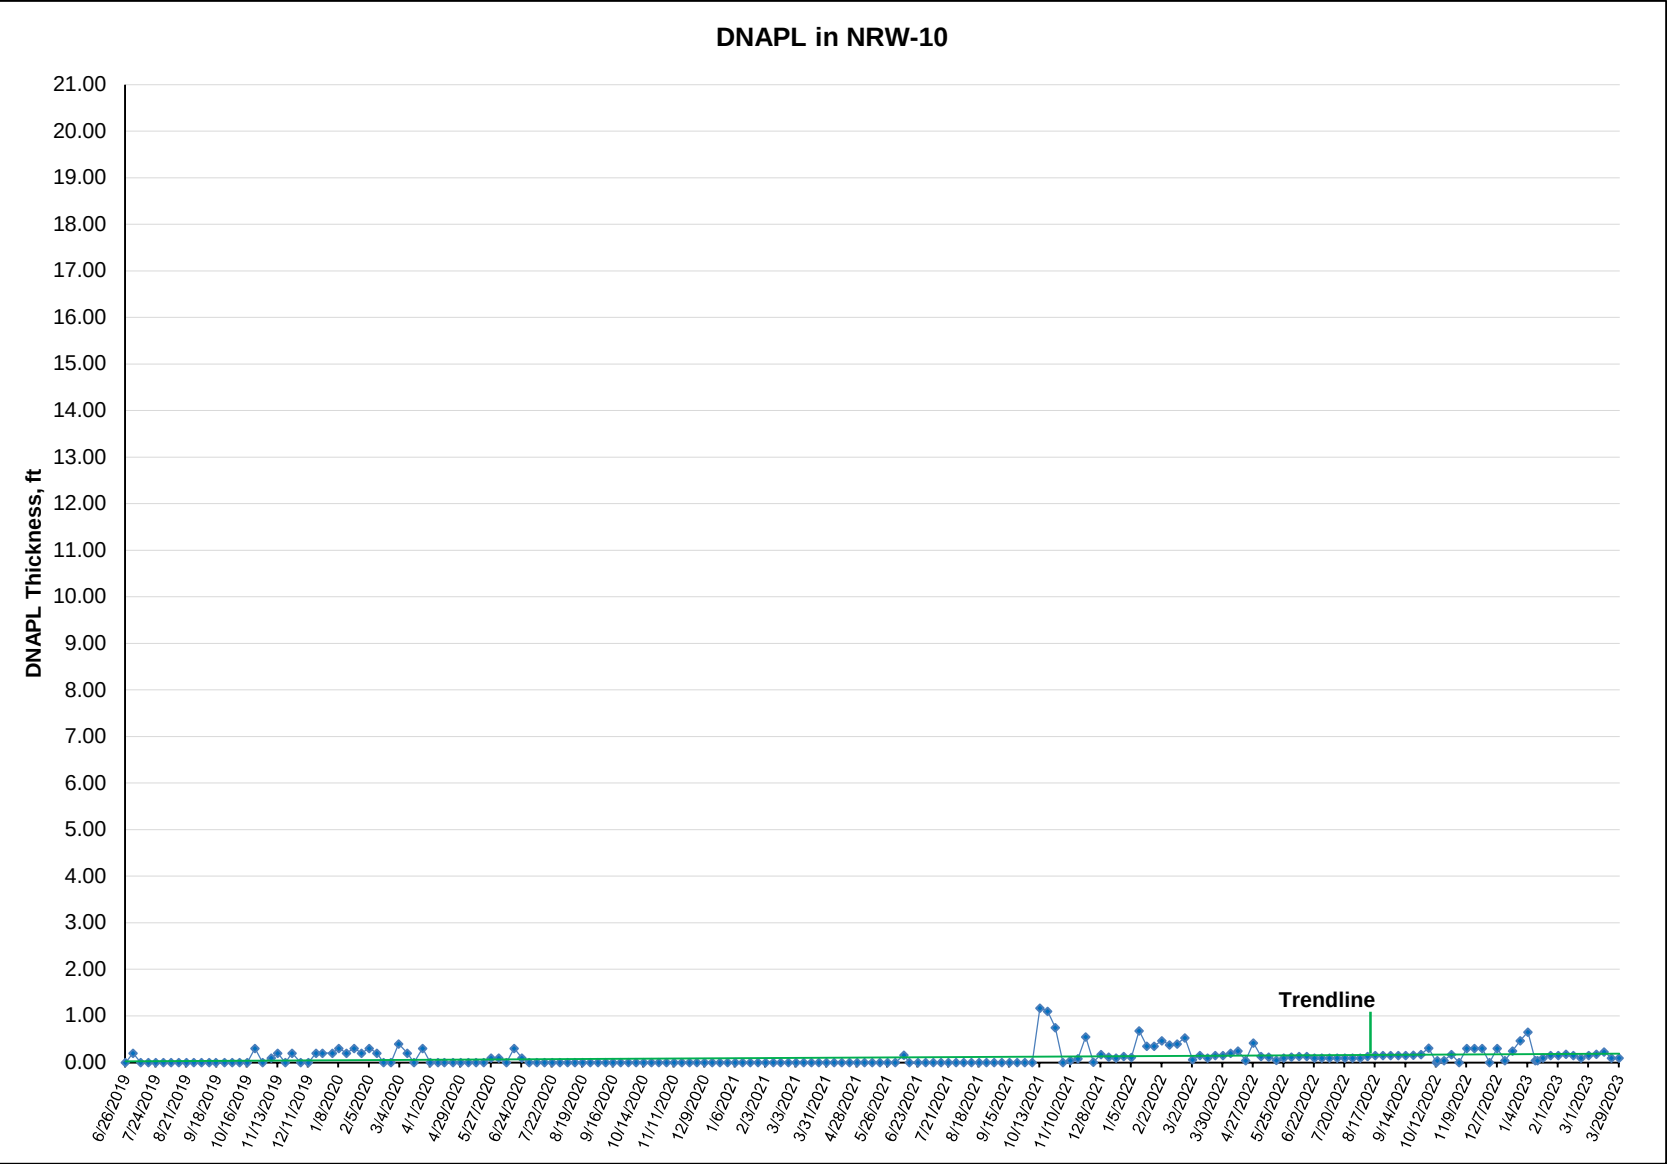

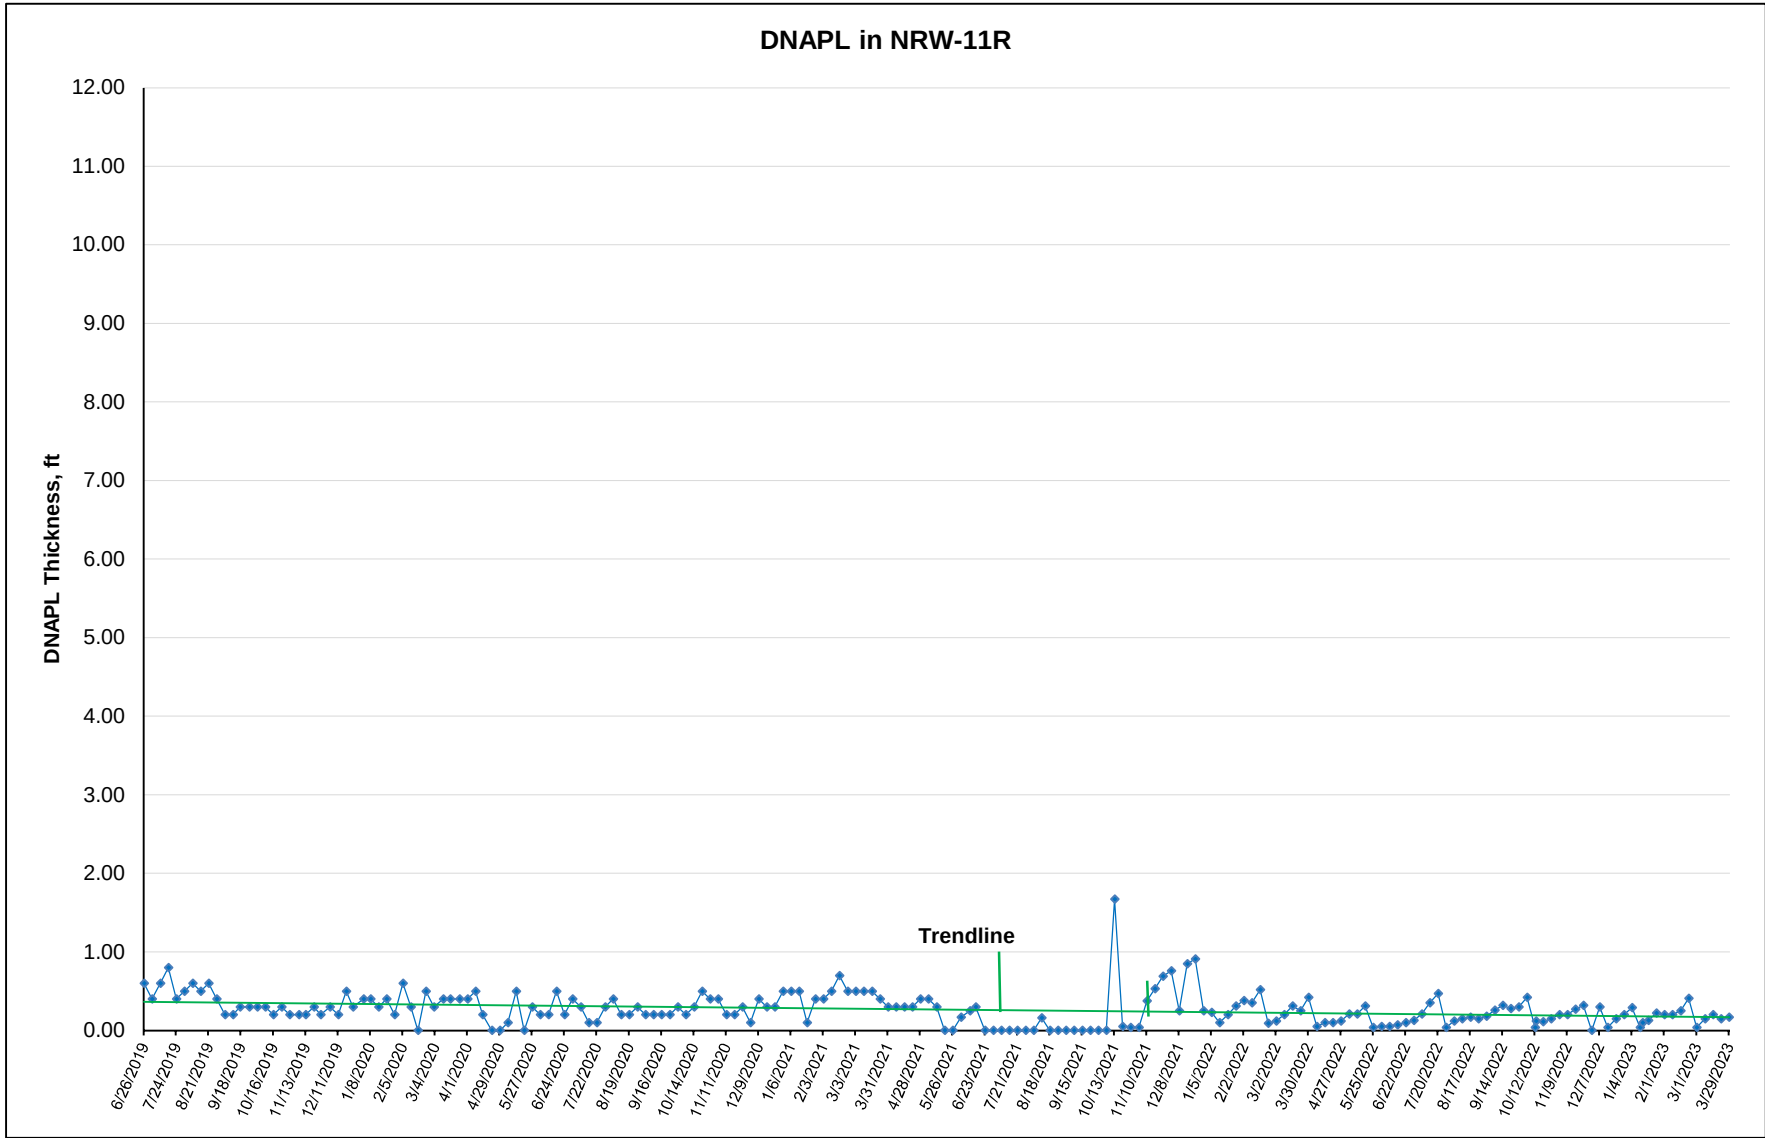

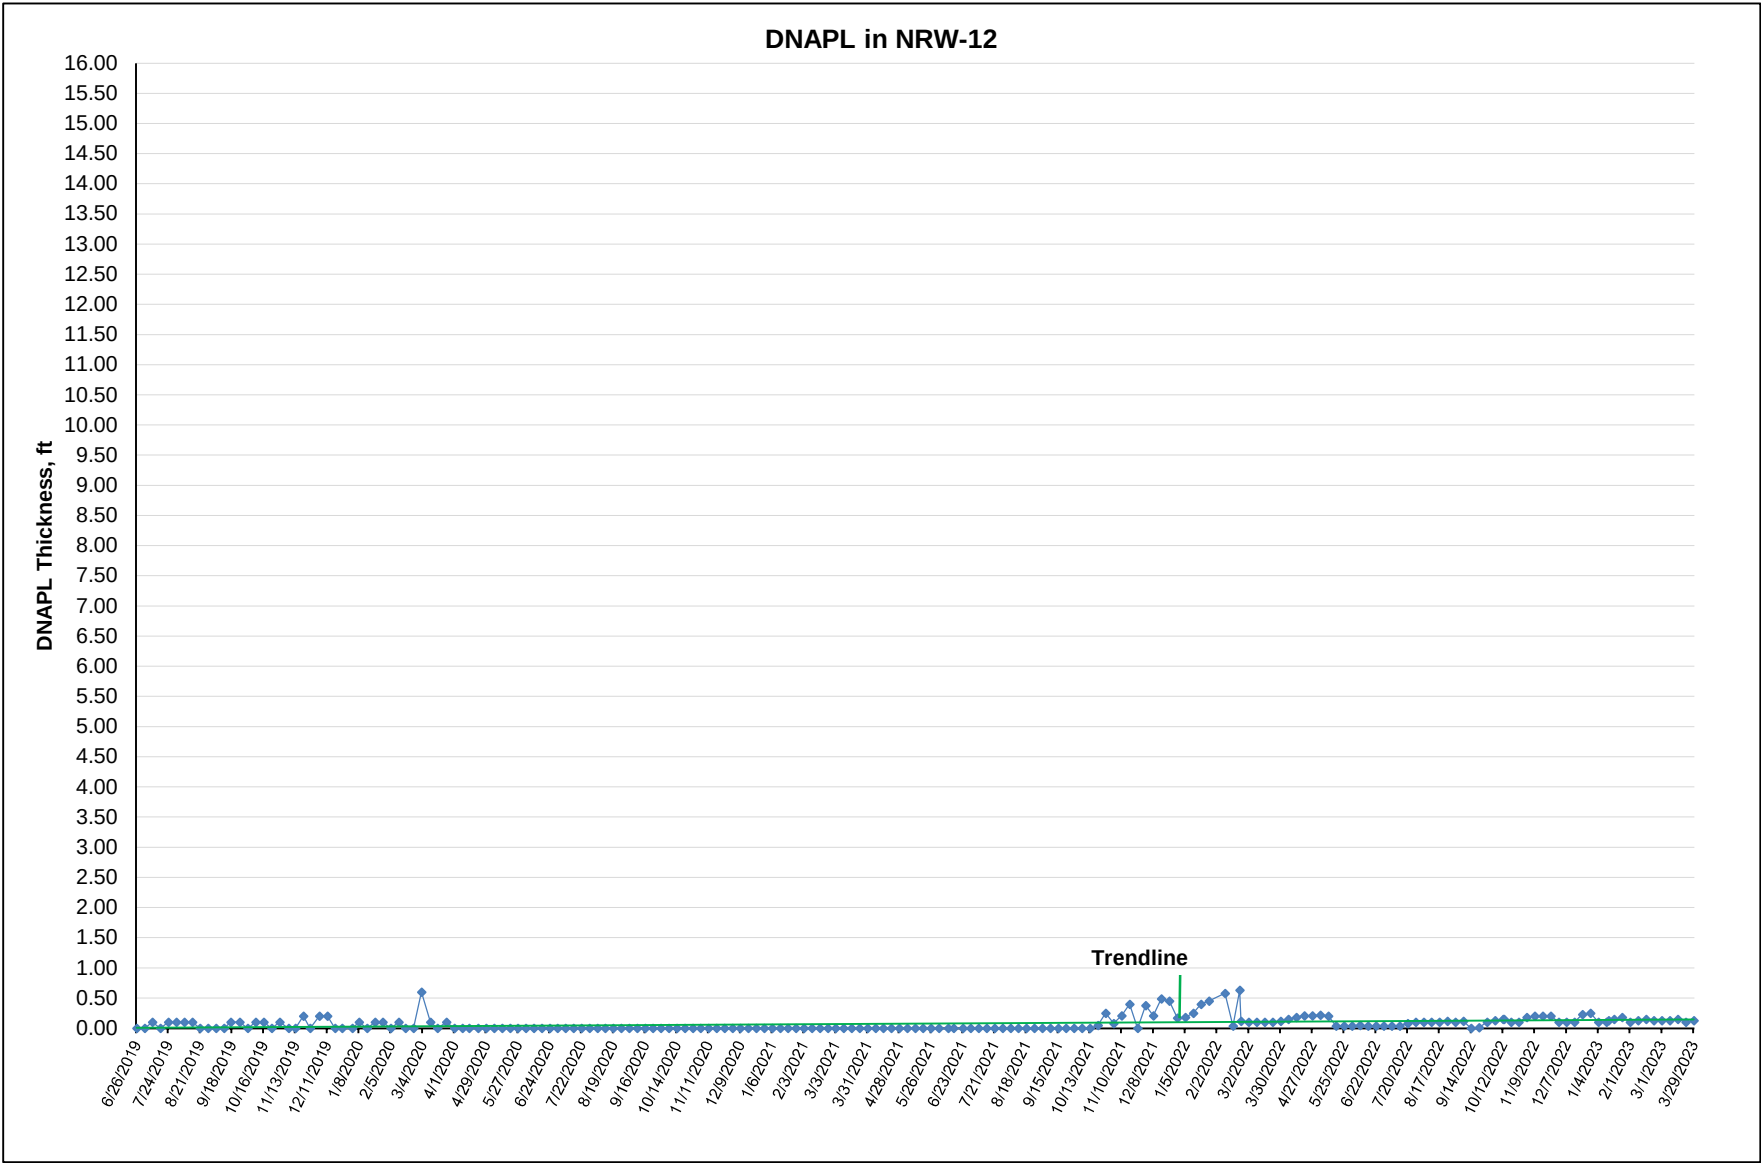

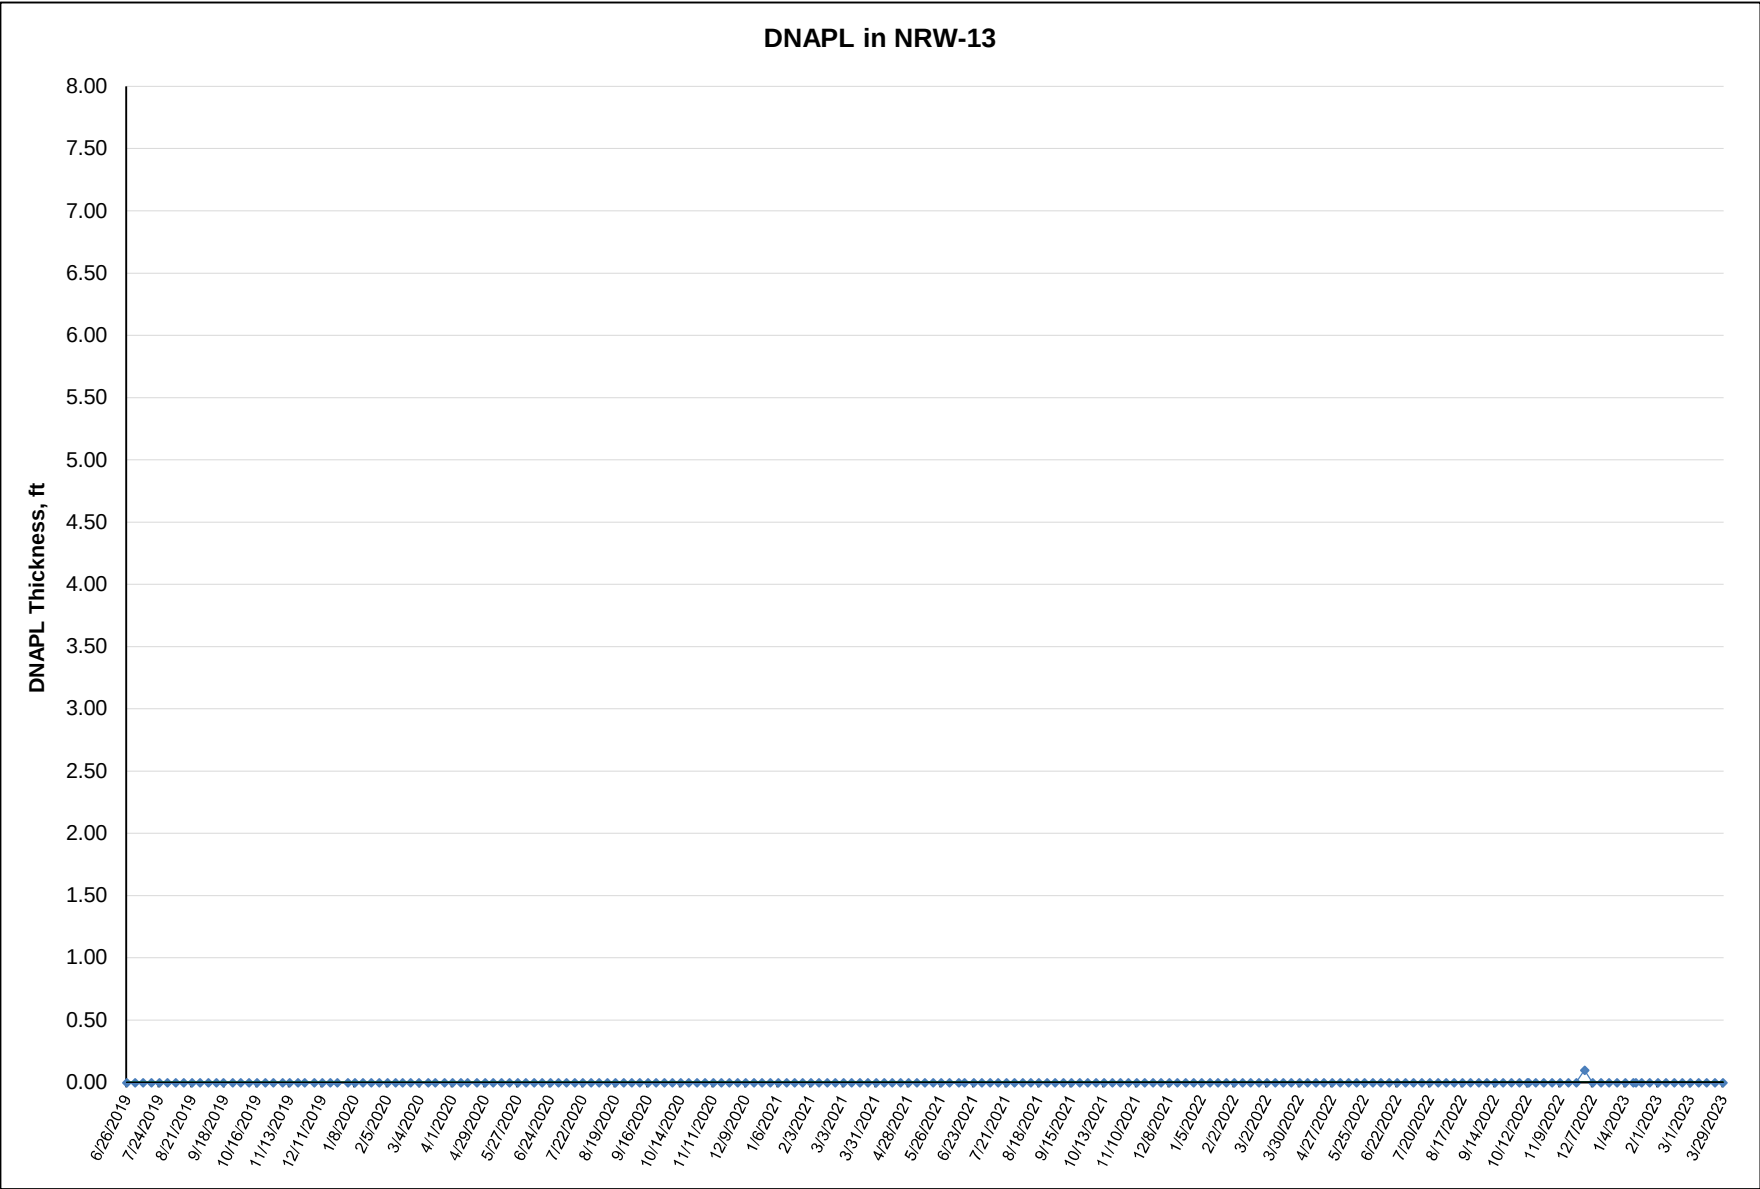


Table 2
Summary of DNAPL-Water Removal
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																	Event Volume
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13	
Date	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons
6/26/2019		1.5	1.1				--	5.8		0.0		0.0	0.0		1.5	0.0	--	9.9
7/3/2019		1.5	0.0				--	7.9		0.0		0.0	1.1		1.5	0.0	--	12.0
7/10/2019		3.6	0.0				--	5.8		0.0		0.0	0.0		1.5	1.1	--	12.0
7/17/2019		1.5	0.0				--	10.0		0.0		0.0	0.0		3.6	0.0	--	15.2
7/24/2019		1.5	0.0				--	16.4		0.0		0.0	0.0		1.5	1.1	--	20.5
7/31/2019		3.6	0.0				--	14.2		0.0		0.0	0.0		1.5	1.1	--	20.5
8/7/2019		3.6	0.0				--	10.0		0.0		0.0	0.0		3.6	1.1	--	18.4
8/14/2019		1.5	0.0				--	10.0		0.0		0.0	0.0		3.6	1.1	--	16.3
8/21/2019		3.6	1.1				--	12.1		0.0		0.0	0.0		3.6	0.0	--	20.5
8/28/2019		1.5	0.0				--	12.1		0.0		0.0	0.0		3.6	0.0	--	17.3
9/4/2019		1.5	0.0				--	10.0		0.0		0.0	0.0		1.1	0.0	--	12.6
9/11/2019		0.0	0.0				--	5.8		0.0		0.0	0.0		1.5	0.0	--	7.3
9/17/2019		3.6	0.0				--	7.9		0.0		0.0	0.0		1.5	1.1	--	14.1
9/25/2019		1.5	0.0				--	10.0		0.0		0.0	0.0		1.5	1.1	--	14.1
10/2/2019		1.5	0.0				--	7.9		0.0		0.0	0.0		1.5	0.0	--	10.9
10/9/2019		7.9	0.0				--	7.9		0.0		0.0	0.0		3.6	1.1	--	20.5
10/16/2019		1.5	1.5				--	10.0		0.0		0.0	0.0		1.5	1.1	--	15.7
10/23/2019		1.5	1.1				--	10.0		0.0		0.0	1.5		3.6	0.0	--	17.8
10/30/2019		1.5	0.0				--	12.1		0.0		0.0	0.0		1.5	1.1	--	16.3
11/7/2019		1.5	0.0				--	10.0		0.0		0.0	1.1		1.5	0.0	--	14.1
11/13/2019		3.6	0.0				--	7.9		0.0		0.0	1.5		1.5	0.0	--	14.6
11/20/2019		5.8	0.0				--	10.0		0.0		0.0	0.0		1.5	1.5	--	18.8
11/26/2019		3.6	0.0				--	10.0		0.0		0.0	1.1		3.6	0.0	--	18.4
12/4/2019		1.5	0.0				--	10.0		0.0		0.0	0.0		3.6	1.5	--	16.7
12/11/2019		1.5	0.0				--	12.1		0.0		0.0	0.0		1.5	1.5	--	16.7
12/18/2019		1.5	0.0				--	7.9		0.0		0.0	1.1		3.6	0.0	--	14.1
12/24/2019		1.1	0.0				--	7.9		0.0		0.0	1.1		1.5	0.0	--	11.6
1/2/2020		1.5	0.0				--	10.0		0.0		0.0	1.5		3.6	0.0	--	16.7
1/8/2020		3.6	0.0				--	7.9		0.0		0.0	1.5		3.6	0.0	--	16.7
1/15/2020		1.1	0.0				--	10.0		0.0		0.0	1.5		1.5	0.0	--	14.1
1/22/2020		1.1	0.0				--	12.1		0.0		0.0	1.5		3.6	1.1	--	19.5
1/29/2020		1.5	1.1				--	7.9		1.1		0.0	1.5		1.5	1.1	--	15.7
2/5/2020		1.5	1.1				--	7.9		0.0		0.0	1.5		5.8	0.0	--	17.8
2/12/2020		3.6	1.5				--	7.9		0.0		0.0	1.1		1.5	1.1	--	16.8
2/18/2020		0.0	0.0				--	5.5		0.0		0.0	0.0		0.0	0.0	--	5.5
2/25/2020		0.0	0.0				--	5.5		0.0		0.0	0.0		3.4	0.0	--	8.9
3/3/2020		0.9	1.9				--	4.9		0.9		0.9	0.9		0.9	0.0	--	11.3
3/11/2020		1.5	1.5				--	10.0		0.0		0.0	1.1		3.6	1.1	--	18.9
3/17/2020		0.0	0.0				--	11.4		0.0		0.0	0.0		1.4	0.0	--	12.8
3/25/2020		1.1	1.1				--	10.0		0.0		0.0	1.5		3.6	1.1	--	18.5
4/1/2020		1.1	1.1				--	10.0		0.0		0.0	0.0		1.5	0.0	--	13.7
4/8/2020		1.1	1.1				--	12.1		1.1		0.0	0.0		3.6	0.0	--	19.1
4/14/2020		1.1	1.1				--	5.8		0.0		0.0	0.0		1.5	0.0	--	9.5
4/22/2020		1.1	1.5				--	7.9		0.0		0.0	0.0		0.0	0.0	--	10.5
4/29/2020		1.1	1.1				--	5.8		0.0		0.0	0.0		0.0	0.0	--	8.0
5/6/2020		1.1	1.1				--	5.8		0.0		0.0	0.0		1.1	0.0	--	9.1
5/13/2020		1.1	1.1				--	3.6		1.1		0.0	0.0		1.5	0.0	--	8.5
5/20/2020		1.5	1.5				--	5.8		0.0		0.0	0.0		0.0	0.0	--	8.8
5/27/2020		1.1	1.1				--	5.8		1.1		0.0	1.1		1.5	0.0	--	11.7
6/3/2020		1.5	1.1				--	7.9		0.0		0.0	1.5		1.5	0.0	--	13.5
6/10/2020		1.1	1.1				--	7.9		1.1		0.0	0.0		1.5	0.0	--	12.7
6/17/2020		1.5	1.1				--	7.9		1.5		0.0	1.5		3.6	0.0	--	17.2
6/24/2020		1.1	1.1				--	7.9		1.1		0.0	1.1		1.5	0.0	--	13.8
7/1/2020		1.1	1.1				--	7.9		1.5		0.0	0.0		1.5	0.0	--	13.1
7/8/2020		1.1	1.1				--	7.9		1.1		0.0	0.0		1.5	0.0	--	12.7
7/15/2020		1.1	3.6				--	10.0		1.1		1.1	0.0		1.1	0.0	--	18.0
7/22/2020		1.1	1.1				--	10.0		1.5		0.0	0.0		1.1	0.0	--	14.8
7/29/2020		1.1	1.1				--	5.8		1.5		0.0	0.0		1.5	0.0	--	11.0
8/5/2020		1.1	1.1				--	7.9		1.1		0.0	0.0		1.5	0.0	--	12.7
8/12/2020		1.1	1.5				--	7.9		1.5		0.0	0.0		1.1	0.0	--	13.1
8/19/2020		1.1	1.1				--	7.9		1.5		0.0	0.0		1.1	0.0	--	12.7
8/26/2020		1.1	1.1				--	7.9		1.5		0.0	0.0		1.5	0.0	--	13.1
9/2/2020		1.1	1.1				--	10.0		1.5		0.0	0.0		1.1	0.0	--	14.8
9/9/2020		1.1	1.1				--	10.0		1.5		0.0	0.0		1.5	0.0	--	15.2
9/16/2020		1.1	1.5				--	10.0		1.5		0.0	0.0		1.1	0.0	--	15.2
9/23/2020		1.1	1.1				--	10.0		1.1		0.0	0.0		1.5	0.0	--	14.8
9/30/2020		1.5	1.5				--	10.0		1.5		0.0	0.0		1.5	0.0	--	16.1
10/7/2020		1.1	1.1				--	10.0		1.1		0.0	0.0		1.5	0.0	--	14.8
10/14/2020		1.1	1.1				--	7.9		1.5		0.0	0.0		1.5	0.0	--	13.1
10/21/2020		1.1	1.1				--	10.0		1.5		0.0	0.0		3.6	0.0	--	17.4
10/28/2020		1.1	1.1				--	10.0		1.1		0.0	0.0		3.6	0.0	--	16.9
11/4/2020		1.1	1.5				--	7.9		1.5		0.0	0.0		3.6	0.0	--	15.7
11/11/2020		1.1	1.1				--	7.9		1.1		0.0	0.0		1.1	0.0	--	12.3
11/18/2020		1.1	1.1				--	7.9		1.1		0.0	0.0		1.1	0.0	--	12.3
11/25/2020		1.1	1.1				--	7.9		1.1		0.0	0.0		1.1	0.0	--	12.3
12/2/2020		1.1	1.5				--	7.9		1.5		0.0	0.0		1.1	0.0	--	13.1
12/9/2020		1.1	1.1				--	10.0		1.1		0.0	0.0		3.6	0.0	--	16.9
12/16/2020		1.1	1.1				--	7.9		1.1		0.0	0.0		1.1	0.0	--	12.3
12/23/2020		1.1	1.1				--	10.0		1.1		0.0	0.0		1.1	0.0	--	14.4
12/30/2020		1.1	1.1				--	10.0		1.1		0.0	0.0		3.6	0.0	--	16.9
1/6/2021		1.1	1.1				--	10.0		1.1		0.0	0.0		1.1	0.0	--	14.4
1/13/2021		1.1	3.6				--	10.0		1.5		0.0	0.0		1.5	0.0	--	17.8
1/20/2021		1.1	1.1				--	7.9		1.5		0.0	1.1		1.1	0.0	--	13.8
1/27/2021		1.1	1.1				--	7.9		1.5		0.0	0.0		1.5	0.0	--	13.1
2/3/2021		0.0	0.0				--	7.9		1.5		0.0	0.0		1.5	0.0	--	10.9
2/10/2021		1.1	1.5				--	10.0		1.5		0.0	1.1		1.5	0.0	--	16.8
2/17/2021		1.1	1.1				--	10.0		1.5		0.0	0.0		1.5	0.0	--	15.2

Table 2
Summary of DNAPL-Water Removal
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																	Event Volume
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13	
Date	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons
2/24/2021		1.1	1.5				--	7.9		1.5		0.0	0.0		1.5	0.0	--	13.5
3/3/2021		1.0	3.6				--	10.0		1.1		1.1	0.0		1.5	1.1	--	19.5
3/10/2021		1.1	1.1				--	7.9		1.5		0.0	0.0		1.5	0.0	--	13.1
3/17/2021		1.1	1.1				--	10.0		1.5		0.0	0.0		1.5	0.0	--	15.2
3/24/2021		1.1	1.5				--	10.0		1.5		0.0	0.0		1.5	0.0	--	15.7
3/31/2021		1.1	2.0				--	2.6		1.5		0.0	0.0		1.5	0.0	--	8.7
4/7/2021		1.7	2.1				--	3.2		1.7		0.0	0.0		2.1	0.0	--	10.8
4/14/2021		1.7	2.1				--	3.6		0.9		0.0	0.0		0.9	0.0	--	9.1
4/21/2021		0.2	0.2				--	14.6		0.0		0.0	0.0		0.0	0.0	--	14.9
4/28/2021		0.0	0.0				--	18.7		0.0		0.0	0.0		0.9	0.0	--	19.5
5/5/2021		1.7	1.7				--	6.4		0.0		0.0	0.0		2.1	0.0	--	11.9
5/12/2021		1.7	1.7				--	10.6		1.7		0.0	0.0		1.7	0.0	--	17.4
5/19/2021		0.0	2.1				--	3.6		0.0		0.0	0.0		0.0	0.0	--	5.7
5/26/2021		0.0	4.5				--	25.7		0.0		0.0	0.0		0.0	0.0	--	30.1
6/2/2021		0.0	0.0				--	18.7		0.0		0.0	0.0		0.9	0.0	--	19.5
6/10/2021		0.0	0.0				--	2.0		0.0		0.0	0.0		4.0	0.0	--	6.0
6/15/2021		1.7	1.7				--	12.7		2.1		0.0	0.0		2.1	0.0	--	20.4
6/23/2021		4.5	5.3				--	13.3		0.0		0.0	0.0		0.0	0.0	--	23.0
6/30/2021		0.0	0.0				--	31.8		0.0		0.0	0.0		0.0	0.0	--	31.8
7/7/2021		0.0	0.0				--	30.1		0.0		0.0	0.0		0.0	0.0	--	30.1
7/14/2021		0.0	0.0				--	26.5		0.0		0.0	0.0		0.0	0.0	--	26.5
7/21/2021		0.0	0.0				--	28.2		0.0		0.0	0.0		0.0	0.0	--	28.2
7/28/2021		0.0	0.0				--	26.5		0.0		0.0	0.0		0.0	0.0	--	26.5
8/4/2021		0.0	0.0				--	10.6		8.9		0.0	0.0		0.0	0.0	--	19.5
8/11/2021		0.0	0.9				--	7.0		0.0		0.0	0.0		0.9	0.0	--	8.7
8/18/2021		0.0	0.0				--	8.9		0.0		0.0	0.0		0.0	0.0	--	8.9
8/25/2021		0.0	0.0				--	5.3		0.0		0.0	0.0		0.0	0.0	--	5.3
9/1/2021		0.0	0.0				--	21.2		0.0		0.0	0.0		0.0	0.0	--	21.2
9/8/2021		0.0	0.0				--	12.4		0.0		0.0	0.0		0.0	0.0	--	12.4
9/15/2021		0.0	3.5				--	10.6		0.0		0.0	0.0		0.0	0.0	--	14.1
9/22/2021		0.0	0.0				--	36.3		0.0		0.0	0.0		0.0	0.0	--	36.3
9/29/2021		0.0	0.0				--	40.7		0.0		0.0	0.0		0.0	0.0	--	40.7
10/6/2021		0.0	0.0				--	24.7		12.4		0.0	0.0		0.0	0.0	--	37.1
10/13/2021		0.0	0.0				--	8.0		3.5		0.0	0.0		0.0	0.0	--	11.5
10/20/2021		0.0	0.0				--	6.8		0.0		0.0	0.0		0.0	0.0	--	6.8
10/27/2021		0.0	1.7				--	7.0		0.0		0.0	1.7		0.0	0.0	--	10.4
11/3/2021		0.0	0.0				--	4.5		0.0		0.0	0.0		0.0	0.0	--	4.5
11/10/2021		0.0	0.0				--	7.0		4.5		0.0	0.0		0.0	0.0	--	11.5
11/17/2021		0.0	0.0				--	6.2		0.0		0.0	0.0		0.0	0.0	--	6.2
11/24/2021		0.0	0.0				--	7.1		0.0		0.0	0.9		0.0	0.0	--	8.0
12/1/2021		0.0	0.0				--	8.0		0.0		0.0	0.0		0.0	0.0	--	8.0
12/8/2021		0.0	0.0				--	7.0		1.7		0.0	0.0		0.0	0.0	--	8.7
12/15/2021		0.0	0.0				--	7.0		0.0		0.0	0.0		0.0	0.0	--	7.0
12/22/2021		0.0	2.7				--	7.1		0.0		0.0	0.0		4.4	0.0	--	14.1
12/29/2021		0.0	0.0				--	13.3		0.0		0.0	0.0		0.0	0.0	--	13.3
1/5/2022		0.0	0.0				--	8.4		5.7		0.0	0.0		0.0	0.0	--	14.1
1/12/2022		0.0	0.0				--	12.7		0.0		8.5	5.7		0.0	0.0	--	26.9
1/19/2022		0.0	3.2				--	16.3		0.0		0.0	0.0		0.0	0.0	--	19.5
1/26/2022		0.0	0.0				--	11.4		0.0		0.0	0.0		0.0	0.0	--	11.4
2/2/2022		0.0	0.0				--	10.8		0.0		0.0	0.0		0.0	0.0	--	10.8
2/9/2022		0.0	0.0				--	11.0		2.5		0.0	0.0		0.0	5.9	--	19.5
2/16/2022		0.0	0.0				--	9.1		0.0		4.2	0.0		7.4	0.0	--	20.7
2/23/2022		0.0	0.0				--	10.6		0.0		0.0	8.0		0.0	0.0	--	18.6
3/2/2022		2.7	3.5				--	9.7		5.3		0.0	0.0		0.0	0.0	--	21.2
3/9/2022		0.0	0.0				--	11.5		0.0		0.0	0.0		0.0	0.0	--	11.5
3/16/2022		0.0	0.0				--	10.6		5.3		0.0	0.0		4.2	0.0	--	20.1
3/23/2022		0.0	0.0				--	15.1		0.0		0.0	0.0		0.0	0.0	--	15.1
3/30/2022		0.0	0.0				--	9.5		0.0		0.0	0.0		4.2	0.0	--	13.8
4/6/2022		0.0	4.2				--	10.0		5.3		0.0	0.0		0.0	0.0	--	19.5
4/13/2022		0.0	0.0				--	11.5		0.0		0.0	3.2		0.0	0.0	--	14.6
4/20/2022		0.0	0.0				--	11.0		4.2		0.0	0.0		0.0	0.0	--	15.3
4/27/2022		0.0	0.0				--	11.0		0.0		0.0	0.0		0.0	0.0	--	11.0
5/4/2022		0.0	4.7				--	7.8		0.0		0.0	0.0		0.0	3.4	--	15.9
5/11/2022		0.0	0.0				--	7.1		3.5		0.0	0.0		0.0	0.0	--	10.6
5/18/2022		0.0	0.0				--	8.9		0.0		0.0	0.0		5.3	0.0	--	14.2
5/25/2022		0.0	0.0				--	10.6		0.0		0.0	0.0		0.0	0.0	--	10.6
6/1/2022		0.0	0.0				--	8.9		3.4		0.0	0.0		0.0	0.0	--	12.3
6/8/2022		0.0	4.5				--	9.3		0.0		0.0	0.0		0.0	0.0	--	13.8
6/15/2022		0.0	0.0				--	10.2		0.0		0.0	0.0		0.0	0.0	--	10.2
6/22/2022		0.0	0.0				--	9.5		5.9		0.0	0.0		0.0	0.0	--	15.5
6/29/2022		0.0	0.0				--	12.7		0.0		0.0	0.0		0.0	0.0	--	12.7
7/6/2022		0.0	0.0				--	13.2		0.0		0.0	0.0		0.0	0.0	--	13.2
7/13/2022		0.0	0.0				--	12.1		6.8		0.0	0.0		0.0	0.0	--	18.9
7/20/2022		0.0	0.0				--	11.1		0.0		0.0	0.0		4.7	0.0	--	15.8
7/27/2022		0.0	0.0				--	10.0		0.0		0.0	0.0		0.0	0.0	--	10.0
8/3/2022		0.0	6.8				--	8.9		5.8		0.0	0.0		0.0	0.0	--	21.5
8/10/2022		0.0	0.0				--	13.6		0.0		0.0	0.0		0.0	0.0	--	13.6
8/17/2022		0.0	0.0				--	10.0		0.0		0.0	0.0		0.0	0.0	--	10.0
8/24/2022		0.0	0.0				--	9.6		6.8		0.0	0.0		0.0	0.0	--	16.4
8/31/2022		0.0	0.0				--	11.1		0.0		0.0	0.0		0.0	0.0	--	11.1
9/7/2022		0.0	0.0				--	6.0		4.3		0.0	0.0		0.0	0.0	--	10.3
9/14/2022		0.0	2.6				--	7.9		0.0		0.0	0.0		0.0	0.0	--	10.5
9/21/2022		0.0	0.0				--	8.5		4.9		0.0	0.0		0.0	0.0	--	13.4
9/28/2022		0.0	0.0				--	9.8		0.0		0.0	0.0		0.0	0.0	--	9.8
10/5/2022		0.0	0.0				--	10.0		0.0		0.0	5.3		6.8	0.0	--	22.2


Table 2
Summary of DNAPL-Water Removal
50 Kent Avenue Property Holder Area
Brooklyn, New York




Well ID	50 Kent Avenue Property Holder Area																	Event Volume
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13	
Date	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons
10/12/2022		3.9	5.8				--	0.0		0.0		0.0	0.0		0.0	0.0	--	9.6
10/13/2022		0.0	0.0				--	10.9		3.6		0.0	0.0		0.0	0.0	--	14.5
10/19/2022		0.0	0.0				--	7.7		0.0		0.0	0.0		0.0	0.0	--	7.7
10/26/2022		0.0	0.0				--	6.8		3.6		0.0	0.0		0.0	0.0	--	10.5
11/2/2022		0.0	0.0				--	8.2		0.0		0.0	0.0		0.0	0.0	--	8.2
11/9/2022		0.0	0.0				--	11.7		0.0		0.0	0.0		0.0	0.0	--	11.7
11/16/2022		0.0	3.9				--	10.0		0.0		0.0	0.0		0.0	0.0	--	13.9
11/23/2022		0.0	0.0				--	11.1		5.1		3.6	0.0		0.0	0.0	--	19.8
11/30/2022		0.0	0.0				--	8.9		0.0		0.0	0.0		0.0	0.0	--	8.9
12/7/2022		0.0	0.0				--	5.8		1.5		0.0	1.5		3.6	0.0	--	12.4
12/14/2022		0.0	0.0				--	8.3		0.0		0.0	0.0		0.0	0.0	--	8.3
12/21/2022		0.0	0.0				--	11.1		0.0		0.0	0.0		0.0	0.0	--	11.1
12/28/2022		0.0	7.9				--	11.5		2.6		0.0	0.0		0.0	0.0	--	21.9
1/4/2023		0.0	0.0				--	10.0		0.0		0.0	4.7		1.5	0.0	--	16.2
1/11/2023		0.0	0.0				--	6.8		0.0		0.0	0.0		0.0	0.0	--	6.8
1/13/2023		0.0	0.0				--	10.0		0.0		0.0	0.0		0.0	0.0	--	10.0
1/18/2023		2.6	5.8				--	9.2		0.0		0.0	0.0		0.0	0.0	--	17.5
1/25/2023		0.0	0.0				--	9.4		2.6		0.0	0.0		0.0	0.0	--	11.9
2/1/2023		0.0	0.0				--	8.9		0.0		0.0	0.0		0.0	0.0	--	8.9
2/8/2023		1.5	4.7				--	8.5		0.0		0.0	0.0		0.0	0.0	--	14.7
2/15/2023		0.0	0.0				--	10.0		3.0		0.0	0.0		0.0	0.0	--	13.0
2/22/2023		0.0	0.0				--	8.3		0.0		0.0	0.0		3.6	0.0	--	11.9
3/1/2023		0.0	0.0				--	9.4		3.2		0.0	0.0		0.0	0.0	--	12.6
3/8/2023		0.0	3.6				--	7.9		0.0		0.0	0.0		0.0	0.0	--	11.5
3/15/2023		0.0	0.0				--	8.5		4.7		0.0	0.0		0.0	0.0	--	13.2
3/22/2023		0.0	0.0				--	9.4		0.0		0.0	0.0		0.0	0.0	--	9.4
3/29/2023		0.0	3.0				--	8.5		0.0		0.0	0.0		0.0	0.0	--	11.5
Total Gallons	0.0	164.6	177.1	0.0	0.0	0.0	0.0	2012.4	0.0	200.7	0.0	19.4	60.7	0.0	242.0	31.5	0.0	2908.3
Percent of Total Gallons	0%	6%	6%	0%	0%	0%	0%	69%	0%	7%	0%	1%	2%	0%	8%	1%	0%	100%
Total Gallons - Last Quarter	--	4.1	17.1	--	--	--	0.0	124.7	--	13.5	--	0.0	4.7	--	5.2	0.0	--	169.3

Notes:

1. Last quarter January through March 2023.
2. Reported dataset commences on June 26, 2019 when NAPL recovery frequency was reduced to one event per week.
3. Historical dataset is presented in **Appendix A**.
4. Volumes in the table include DNAPL volume as well as the volume of groundwater that may have been pumped along with DNAPL.
5. Volume of water in the tube at the beginning of recovery is deducted from the total fluid recovery volume after June 1, 2017.
6. Percent of Total Gallons applied to Total Gallons.
7. NRW-01, -03, -04, -05, -08, -09, and -11 are decommissioned.
8. Replacement recovery wells NRW-09R and NRW-11R were installed on March 27, 2017 and March 23, 2017 respectively.
9. Replacement recovery wells NRW-01R and NRW-08R were installed on May 21, 2019 and May 24, 2019 respectively.
10. -- DNAPL not pumped from location.
11. Well not operational during monitoring period.

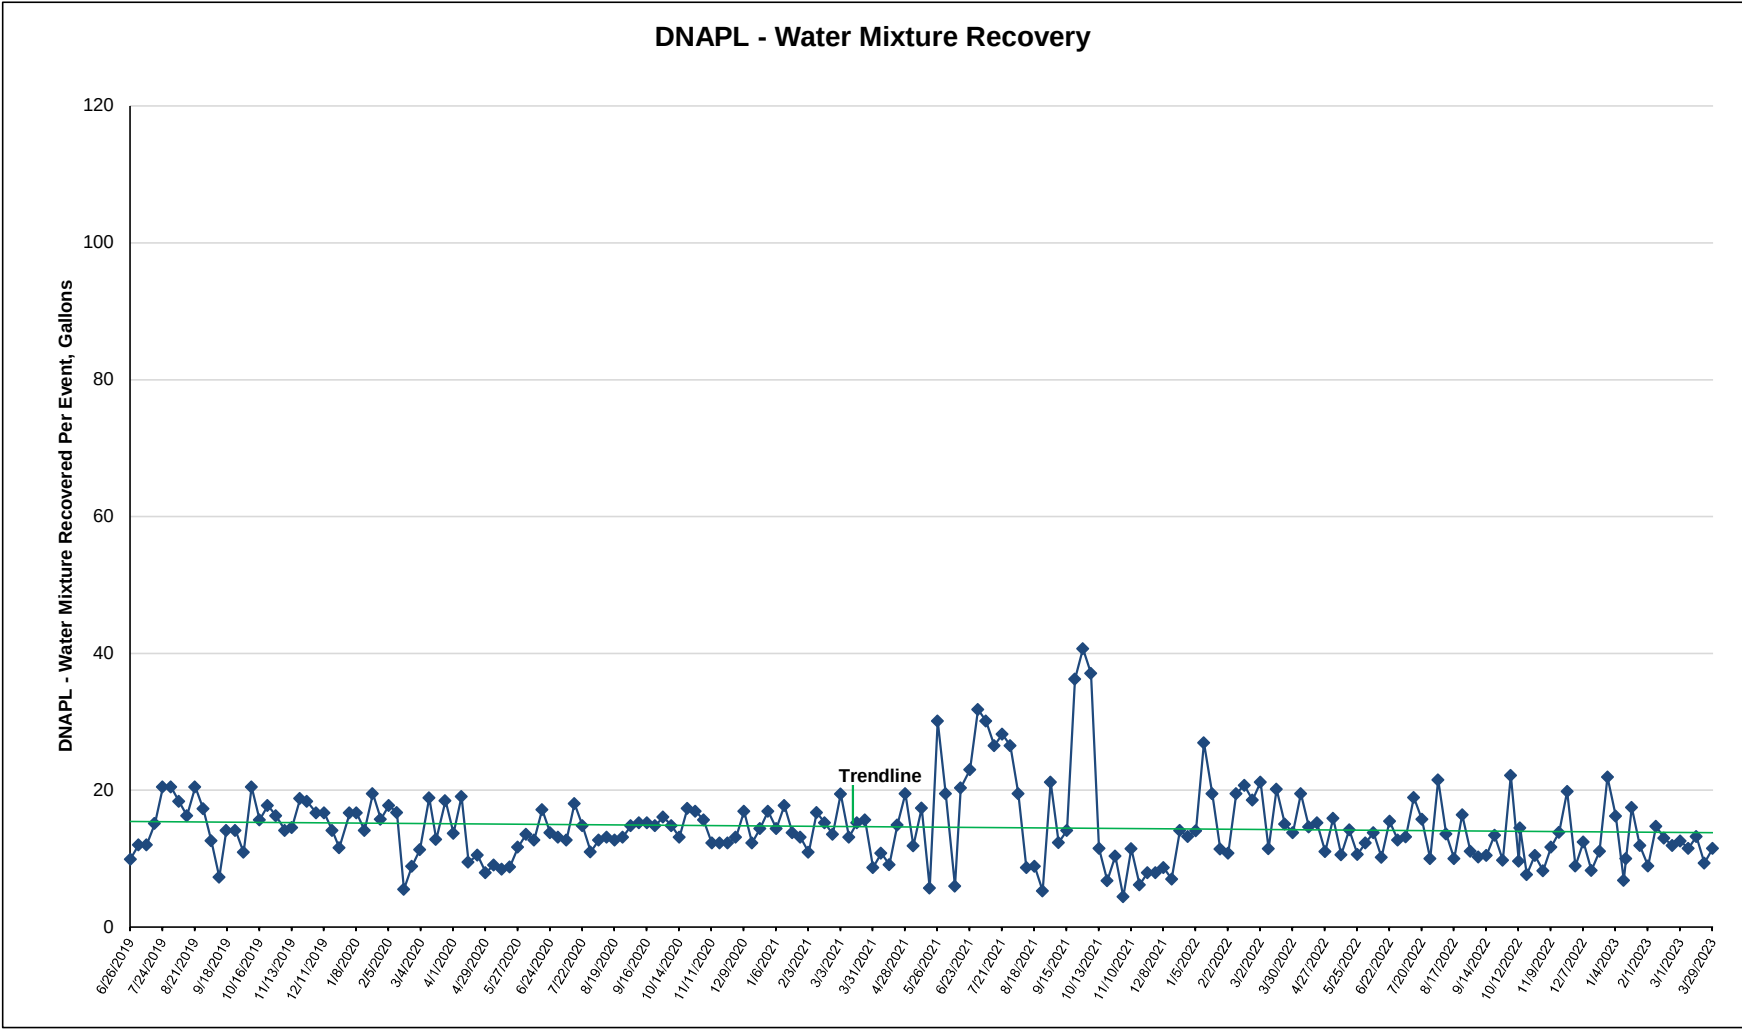

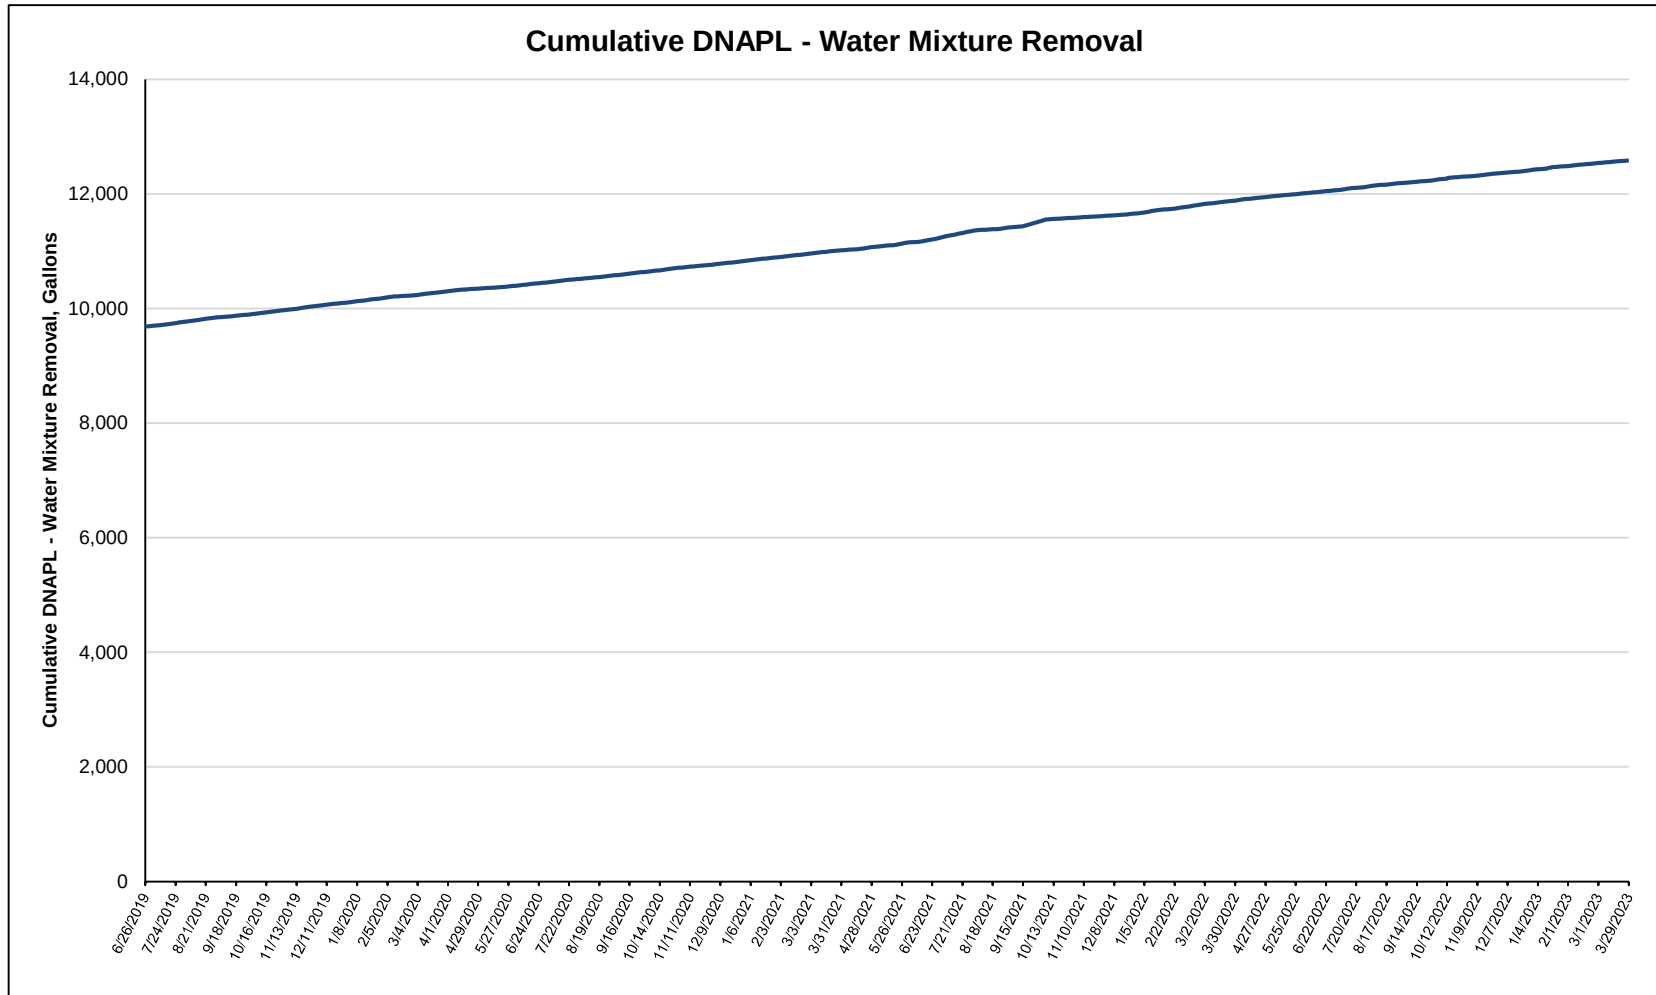

Note: Cumulative volume includes data from the commencement of NAPL recovery activities on 9/12/2014. As at 6/26/2019, 9,686 gallons had been removed.

Table 3
Summary of Depth to Bottom Measurements
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area											
	NRW-01	NRW-01R	NRW-02	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09R	NRW-10	NRW-11R	NRW-12	NRW-13
Date	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet
As-Installed	60.00	58.50	65.00	67.00	63.00	59.00	60.50	60.00	55.00	63.00	60.00	60.00
6/26/2019		58.64	64.24	66.40	61.76		59.75	58.50	53.95	62.54	59.50	59.20
7/3/2019		58.60	64.12	66.40	61.73		59.71	58.44	53.94	62.54	59.52	59.18
7/10/2019		58.55	64.15	66.40	61.40		59.75	58.35	53.95	62.55	59.50	59.15
7/17/2019		58.60	64.25	66.40	61.40		59.80	58.35	53.95	62.55	59.55	59.15
7/24/2019		58.60	64.25	66.40	61.40		59.80	58.35	53.95	62.55	59.55	59.15
7/31/2019		58.65	64.20	66.40	61.50		59.80	58.35	53.95	62.55	59.50	59.15
8/7/2019		58.55	64.20	66.40	61.45		59.80	58.35	53.90	62.55	59.50	59.15
8/14/2019		58.55	64.22	66.40	61.40		59.88	58.35	53.95	62.55	59.50	59.15
8/21/2019		58.56	64.20	66.40	61.42		59.88	58.35	53.95	62.55	59.55	59.15
8/28/2019		58.55	64.20	66.40	61.40		59.80	58.30	53.90	62.55	59.55	59.15
9/4/2019		58.55	64.20	66.40	61.45		59.80	58.35	53.90	62.55	59.50	59.15
9/11/2019		58.55	64.25	66.40	61.45		59.80	58.35	53.90	62.55	59.50	59.15
9/17/2019		58.55	64.20	66.40	61.45		59.80	58.35	53.95	62.55	59.55	59.15
9/25/2019		58.55	64.20	66.40	61.40		59.80	58.35	53.90	62.50	59.50	59.15
10/2/2019		58.55	64.20	66.40	61.35		59.80	58.35	53.90	62.50	59.50	59.15
10/9/2019		58.30	64.20	66.40	61.20		59.65	58.35	53.80	62.30	59.50	59.15
10/16/2019		58.45	64.00	66.40	61.05		59.55	58.30	53.80	62.40	59.35	59.10
10/23/2019		58.50	64.15	66.40	61.30		58.60	58.40	54.00	62.50	59.50	59.20
10/30/2019		58.40	63.95	66.40	61.40		58.75	58.25	53.90	62.35	59.40	59.10
11/7/2019		58.50	63.80	66.40	61.55		59.60	59.15	53.70	63.40	59.30	59.10
11/13/2019		58.35	63.95	66.40	61.60		59.70	58.35	53.75	62.30	59.20	59.00
11/20/2019		58.35	63.95	66.40	61.75		59.60	58.40	53.70	62.20	59.25	58.90
11/26/2019		58.30	63.85	66.40	61.75		59.55	58.35	53.70	62.40	59.20	59.00
12/4/2019		58.15	63.60	66.40	61.25		59.60	58.25	53.55	62.20	59.10	58.90
12/11/2019		58.25	63.50	66.40	61.40		59.60	58.30	53.40	62.35	59.15	58.80
12/18/2019		58.35	63.50	66.40	61.60		58.25	58.15	53.80	62.30	59.00	58.75
12/24/2019		58.25	63.40	66.40	61.45		58.15	58.10	53.65	62.15	59.00	58.65
1/2/2020		58.15	63.40	66.40	61.55		58.00	58.05	53.85	62.30	58.90	58.60
1/8/2020		58.35	64.00	66.40	61.50		58.60	58.35	53.75	62.35	59.00	58.50
1/15/2020		58.50	64.25	66.40	61.65		58.55	58.50	53.65	62.50	59.10	58.45
1/22/2020		58.50	64.20	66.40	61.55		58.50	58.55	53.75	62.60	59.05	58.40
1/29/2020		58.50	64.05	66.40	61.40		59.60	58.55	53.70	62.50	59.40	58.70
2/5/2020		58.40	64.00	66.40	61.30		59.50	58.50	54.60	62.40	59.60	59.00
2/12/2020		58.35	64.10	66.40	61.35		59.40	58.50	54.50	62.35	59.55	59.00
2/18/2020		58.55	64.09	66.48	61.35		59.75	58.46	53.95	62.41	59.63	59.14
2/25/2020		58.60	64.15	66.40	61.35		59.75	58.50	53.95	62.31	59.60	59.19
3/3/2020		58.62	64.08	66.40	61.35		59.75	58.49	54.05	62.45	59.53	59.23
3/11/2020		58.60	64.05	66.40	61.35		59.70	58.50	54.10	62.45	58.60	59.00
3/17/2020		58.62	64.07	66.40	61.35		59.75	58.50	54.02	62.41	59.61	59.20
3/25/2020		58.65	64.00	66.40	61.40		59.75	58.50	54.05	62.40	58.60	59.20
4/1/2020		58.60	64.00	66.40	61.35		59.75	58.50	54.10	62.40	59.55	59.00
4/8/2020		58.55	64.05	66.40	61.40		59.75	58.50	54.05	62.45	59.60	59.20
4/14/2020		58.57	64.03	66.40	61.40		59.76	58.50	54.10	62.45	59.55	59.00
4/22/2020		58.60	63.91	66.40	61.30		59.70	58.50	53.60	62.45	59.45	58.65
4/29/2020		58.62	63.90	66.40	61.30		59.72	58.50	53.60	62.46	59.45	58.65
5/6/2020		58.60	63.90	66.40	61.30		59.70	58.50	53.60	62.45	59.45	58.65
5/13/2020		58.60	63.90	66.40	61.30		59.70	58.50	53.65	62.45	59.45	58.65
5/20/2020		59.40	64.10	66.40	61.50		59.80	58.45	53.95	62.60	59.70	59.30
5/27/2020		59.45	64.10	66.40	61.45		59.80	58.45	53.90	62.55	58.70	59.30
6/3/2020		58.40	64.10	66.40	61.40		59.75	58.45	53.80	62.45	59.70	59.30
6/10/2020		58.30	64.00	66.40	61.35		59.75	58.45	53.75	62.35	59.70	59.25
6/17/2020		58.30	63.95	66.40	61.40		59.70	58.45	53.70	62.40	59.70	59.25
6/24/2020		58.25	63.90	66.40	61.30		59.65	58.40	53.70	62.45	59.70	59.25
7/1/2020		58.25	63.75	66.40	61.10		59.45	58.10	53.65	62.10	59.20	58.80
7/8/2020		58.25	63.75	66.40	61.20		59.50	58.10	53.65	62.20	59.20	58.80
7/15/2020		58.20	63.90	66.10	61.10		59.35	58.10	53.60	62.20	59.20	58.80
7/22/2020		58.15	63.85	66.10	61.10		59.35	58.10	53.60	62.15	59.20	58.80
7/29/2020		58.15	63.85	66.10	61.10		59.35	58.10	53.60	62.20	59.20	58.80
8/5/2020		58.15	63.85	66.10	61.10		59.35	58.10	53.60	62.20	59.20	58.80
8/12/2020		58.15	63.85	66.10	61.10		59.35	58.10	53.60	62.20	59.20	58.80
8/19/2020		58.15	63.85	66.10	61.10		59.35	58.10	53.60	62.20	59.20	58.80
8/26/2020		58.15	63.85	66.10	61.10		59.35	58.10	53.60	62.20	59.20	58.80
9/2/2020		58.15	63.85	66.10	61.10		59.35	58.10	53.60	62.20	59.20	58.80
9/9/2020		58.28	63.85	66.38	61.30		59.70	58.20	53.76	62.40	59.40	59.01
9/16/2020		58.28	63.85	66.38	61.30		59.70	58.20	53.76	62.40	59.40	59.01
9/23/2020		58.30	63.83	66.38	61.30		59.70	58.20	53.76	62.40	59.40	59.01
9/30/2020		58.29	63.83	66.39	61.30		59.70	58.21	53.75	62.41	59.40	59.02
10/7/2020		58.31	63.84	66.38	61.31		59.71	58.20	53.76	62.41	59.41	59.01
10/14/2020		58.30	63.85	66.40	61.20		59.70	58.20	53.75	62.40	59.40	59.00
10/21/2020		58.30	63.85	66.40	61.20		59.70	58.20	53.75	62.40	59.40	59.00
10/28/2020		58.25	63.80	66.40	61.10		59.65	58.20	53.75	62.35	59.40	59.00
11/4/2020		58.25	63.80	66.40	61.10		59.65	58.20	53.75	62.35	59.40	59.00
11/11/2020		58.28	63.83	66.38	61.30		59.70	58.21	53.75	62.42	59.41	59.02
11/18/2020		58.28	63.83	66.38	61.30		59.70	58.21	53.75	62.42	59.41	59.02
11/25/2020		58.30	63.80	66.40	61.30		59.70	58.20	53.75	62.40	59.40	59.00
12/2/2020		58.30	63.80	66.40	61.30		59.70	58.20	53.75	62.40	59.40	59.00
12/9/2020		58.30	63.80	66.40	61.30		59.70	58.20	53.75	62.40	59.40	59.00
12/16/2020		58.30	63.80	66.40	61.30		59.70	58.20	53.75	62.40	59.40	59.00
12/23/2020		58.30	63.80	66.40	61.30		59.70	58.20	53.75	62.40	59.40	59.00
12/30/2020		58.30	63.80	66.40	61.30		59.70	58.20	53.75	62.40	59.40	59.00
1/6/2021		58.30	63.80	66.40	61.30		59.70	58.20	53.75	62.40	59.40	59.00
1/13/2021		58.30	63.80	66.40	61.30		59.70	58.20	53.75	62.40	59.40	59.00
1/20/2021		58.55	64.10	66.40	61.30		59.92	58.40	54.00	62.38	59.50	59.15
1/27/2021		58.55	64.10	66.40	61.30		59.92	58.40	54.00	62.38	59.50	59.15
2/3/2021		NM	NM	66.40	61.30		59.92	58.40	54.00	62.38	59.50	59.15
2/10/2021		58.55	64.10	66.40	61.30		59.92	58.40	54.00	62.38	59.50	59.15
2/17/2021		58.55	64.10	66.40	61.30		59.92	58.40	54.00	62.38	59.50	59.15
2/24/2021		58.55	64.10	66.40	61.30		59.92	58.40	54.00	62.38	59.50	59.15

Table 3
Summary of Depth to Bottom Measurements
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area											
	NRW-01	NRW-01R	NRW-02	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09R	NRW-10	NRW-11R	NRW-12	NRW-13
Date	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet
3/3/2021		58.55	64.10	66.40	61.30		59.92	58.40	54.00	62.38	59.50	59.15
3/10/2021		58.55	64.10	66.40	61.40		59.90	58.40	53.11	62.55	59.50	59.15
3/17/2021		58.55	64.16	66.40	61.40		59.90	58.40	53.11	62.55	59.50	59.15
3/24/2021		58.55	64.10	66.40	61.40		59.90	58.40	53.11	62.55	59.50	59.15
3/31/2021		58.55	64.10	66.40	61.40		59.90	58.40	53.11	62.55	59.50	59.15
4/7/2021		58.55	64.10	66.40	61.40		59.90	58.40	53.11	62.55	59.50	59.15
4/14/2021		58.55	64.10	66.40	61.40		59.90	58.40	53.11	62.55	59.50	59.15
4/21/2021		58.60	64.05	66.75	61.75		60.10	58.70	53.45	62.90	59.85	59.50
4/28/2021		58.60	64.05	66.75	61.75		60.10	58.70	53.45	62.90	59.85	59.50
5/5/2021		58.60	64.05	66.75	61.75		60.10	58.70	53.45	62.90	59.85	59.50
5/12/2021		58.60	64.05	66.75	61.75		60.10	58.70	53.45	62.90	59.85	59.50
5/19/2021		58.60	64.05	66.75	61.75		60.10	58.70	53.45	62.90	59.85	59.50
5/26/2021		58.60	64.05	66.75	61.75		60.10	58.70	53.45	62.90	59.85	59.50
6/2/2021		58.60	64.05	66.75	61.75		60.10	58.70	53.45	62.90	59.85	59.50
6/10/2021		58.87	64.47	NM	NM		NM	NM	NM	62.66	59.91	59.43
6/16/2021		58.60	64.04	66.75	61.75		60.10	58.70	53.45	62.90	59.85	59.50
6/23/2021		58.60	64.05	66.75	61.75		60.10	58.70	53.45	62.90	59.85	59.50
6/30/2021		58.25	63.75	66.10	61.10		59.30	57.95	52.70	53.50	58.75	57.15
7/7/2021		57.95	62.50	65.85	60.80		59.40	57.75	NM	53.40	59.85	58.70
7/14/2021		57.95	62.50	65.85	60.80		59.40	57.75	NM	53.40	59.85	58.70
7/21/2021		57.95	62.50	65.85	60.80		59.40	57.75	NM	53.40	59.85	58.70
7/28/2021		57.95	62.60	65.85	60.79		59.42	57.77	53.38	61.10	59.83	58.70
8/4/2021		57.98	63.55	65.83	60.84		59.42	57.79	53.35	61.88	59.83	58.60
8/11/2021		58.10	63.48	65.85	60.75		59.38	57.75	53.35	61.63	59.83	58.70
8/18/2021		57.97	63.42	65.85	60.80		59.40	57.77	53.37	61.72	59.80	58.65
8/25/2021		57.95	63.55	65.82	60.35		59.40	57.74	53.33	61.85	59.82	58.60
9/1/2021		57.95	63.53	65.80	61.36		59.79	57.75	53.33	61.85	59.82	58.60
9/8/2021		57.98	63.55	65.85	61.39		59.81	57.80	53.35	61.85	59.85	58.63
9/15/2021		58.43	63.98	65.89	61.31		59.85	57.81	53.35	61.83	59.85	58.65
9/22/2021		57.95	63.53	65.78	61.34		59.75	57.72	53.30	61.82	59.80	58.55
9/29/2021		58.03	63.73	65.78	61.32		59.77	57.71	53.30	61.81	59.78	58.58
10/6/2021		58.45	63.97	66.37	61.28		59.83	58.29	53.87	NA	NA	59.11
10/13/2021		58.48	64.09	66.32	61.28		59.94	58.34	53.86	62.27	NA	59.08
10/20/2021		58.43	64.03	66.33	61.26		60.04	58.39	53.82	62.34	58.38	59.05
10/27/2021		58.32	63.80	66.30	61.26		59.69	58.30	53.55	62.40	59.19	58.90
11/3/2021		58.20	63.79	66.10	60.95		59.68	58.05	53.58	62.08	59.16	58.82
11/10/2021		58.30	63.79	66.10	60.97		59.68	58.07	53.58	62.10	59.18	58.75
11/17/2021		58.20	63.71	66.11	61.04		59.65	58.10	53.60	62.10	59.15	58.85
11/24/2021		58.35	63.75	66.39	61.35		59.45	58.35	53.88	62.42	NA	59.00
12/1/2021		58.53	64.05	66.38	61.26		59.98	58.36	53.88	62.43	59.40	58.90
12/8/2021		58.53	64.06	66.40	61.38		60.01	58.35	53.90	62.22	59.56	59.06
12/15/2021		58.54	64.10	66.38	61.39		59.59	58.35	53.90	62.45	59.53	59.00
12/22/2021		58.51	64.08	66.40	61.25		59.70	58.35	53.88	62.42	59.40	59.00
12/29/2021		58.50	64.01	66.40	61.21		59.95	58.10	53.86	62.31	59.35	59.08
1/5/2022		58.50	63.75	66.40	61.38		59.95	58.30	53.80	62.42	59.40	59.00
1/12/2022		58.50	63.55	66.42	61.35		59.90	58.30	53.85	62.40	59.50	59.00
1/19/2022		58.40	63.95	66.46	61.20		59.88	58.26	53.87	62.28	59.36	59.00
1/26/2022		58.45	63.80	66.35	61.30		59.90	58.25	53.90	62.40	59.50	59.00
2/2/2022		58.50	63.80	66.40	61.30		59.92	58.17	53.90	62.30	59.45	59.00
2/9/2022		58.50	63.70	66.45	61.30		59.90	58.30	53.80	62.40	59.45	59.00
2/16/2022		58.50	63.50	66.45	61.35		60.00	58.35	53.85	62.40	59.40	59.00
2/23/2022		58.55	63.50	66.35	61.25		59.65	58.15	53.80	62.43	59.20	59.00
3/2/2022		58.50	63.70	66.10	61.00		59.65	58.15	53.65	62.15	59.50	59.00
3/9/2022		58.35	63.75	66.35	61.25		59.65	58.25	54.50	62.45	59.50	59.00
3/16/2022		58.40	64.00	66.35	61.30		60.00	58.35	53.85	62.30	59.40	59.00
3/23/2022		58.40	64.00	66.35	61.25		60.00	58.35	54.50	62.30	59.35	59.00
3/30/2022		58.45	64.00	66.30	61.21		59.90	58.35	53.85	62.20	59.42	59.00
4/6/2022		58.38	63.98	66.30	61.25		59.93	58.25	53.83	62.30	59.40	59.05
4/13/2022		58.40	64.00	66.30	61.27		59.98	58.40	53.95	62.40	59.40	59.00
4/20/2022		58.54	64.05	66.30	61.27		59.97	58.40	53.90	62.30	59.38	59.00
4/27/2022		58.55	64.05	66.30	61.30		60.00	58.40	53.85	62.30	59.45	59.10
5/4/2022		58.39	63.98	66.29	61.24		59.90	58.30	53.80	62.28	59.48	59.04
5/11/2022		58.45	63.95	66.35	61.23		59.90	58.30	53.85	62.30	59.45	59.00
5/18/2022		58.48	64.00	66.35	61.25		59.90	58.31	53.83	62.40	59.40	59.00
5/25/2022		58.45	64.00	66.35	61.27		59.90	58.31	53.85	62.28	59.41	59.05
6/1/2022		58.45	64.01	66.28	61.28		59.90	58.29	53.84	62.32	59.42	59.04
6/8/2022		58.44	64.00	66.32	61.26		59.90	58.29	53.85	62.30	59.42	59.05
6/15/2022		58.43	64.00	66.33	61.25		59.92	58.32	53.84	62.33	59.41	59.06
6/22/2022		58.45	64.00	NM	61.25		59.90	58.31	53.85	62.30	59.40	59.00
6/29/2022		58.45	64.00	66.35	61.20		59.93	58.38	53.82	62.30	59.41	59.00
7/6/2022		58.48	64.00	66.35	61.25		59.95	58.38	53.80	62.35	59.45	59.00
7/13/2022		58.48	64.00	66.35	61.25		59.85	58.32	53.81	62.35	59.40	59.00
7/20/2022		58.48	64.00	66.35	61.25		59.85	58.35	53.80	62.35	59.45	59.00
7/27/2022		58.48	64.00	66.35	61.25		59.85	58.32	53.80	62.35	59.45	59.00
8/3/2022		58.48	64.00	66.35	61.25		59.85	58.35	53.80	62.35	59.45	59.00
8/10/2022		58.48	64.00	66.35	61.21		59.85	58.33	53.80	62.37	59.45	59.00
8/17/2022		58.48	64.00	66.35	61.25		59.85	58.35	53.82	62.35	59.45	59.00
8/24/2022		58.45	64.00	66.35	61.25		59.85	58.35	53.82	62.38	59.45	59.00
8/31/2022		58.45	64.00	66.35	61.20		59.89	58.35	53.83	62.40	59.43	59.00
9/7/2022		58.46	64.00	66.35	61.25		59.85	58.35	53.83	62.35	59.43	59.00
9/14/2022		58.53	64.00	66.36	61.25		59.89	58.28	53.84	62.41	59.43	59.00
9/21/2022		58.52	64.00	66.35	61.25		59.86	58.27	53.85	62.41	59.45	59.00
9/28/2022		58.45	64.00	66.35	61.25		59.83	58.35	53.85	62.35	59.45	59.00
10/5/2022		58.45	64.00	66.35	61.25		59.83	58.35	53.85	62.35	59.45	59.00
10/12/2022		58.45	64.05	66.35	61.25		59.85	58.28	53.83	62.35	59.43	59.00
10/13/2022		58.45	64.00	66.35	61.25		59.85	58.35	53.83	62.35	59.43	59.00
10/19/2022		58.41	64.00	66.30	61.25		59.87	58.39	53.85	62.40	59.46	59.00
10/26/2022		58.45	64.00	66.30	61.20		59.87	58.30	53.80	62.40	59.45	59.00
11/2/2022		58.45	63.95	66.28	61.20		59.92	58.35	53.80	62.30	59.45	59.04
11/9/2022		58.50	63.95	66.30	61.26		59.95	58.30	53.80	62.35	59.45	59.05
11/16/2022		58.45	64.00	66.35	61.25		59.85	58.30	53.82	62.40	59.40	59.00
11/23/2022		58.49	64.05	66.35	61.25		59.87	58.32	53.84	62.40	59.41	59.00
11/30/2022		58.45	64.00	66.40	61.20		59.85	58.33	53.84	62.30	59.40	59.10
12/7/2022		58.45	64.00	66.32								

Table 3
Summary of Depth to Bottom Measurements
50 Kent Avenue Property Holder Area
Brooklyn, New York



Well ID	50 Kent Avenue Property Holder Area											
	NRW-01	NRW-01R	NRW-02	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09R	NRW-10	NRW-11R	NRW-12	NRW-13
Date	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet
12/21/2022		58.45	64.00	66.35	61.20		59.89	58.32	53.85	62.40	59.40	59.00
12/28/2022		58.45	64.00	66.35	61.25		59.85	58.35	53.85	62.40	59.40	59.00
1/4/2023		58.45	64.00	66.35	61.25		59.87	58.30	53.80	62.40	59.45	59.00
1/11/2023		58.45	64.00	66.35	61.25		59.85	58.30	53.80	62.40	59.45	59.00
1/13/2023		58.45	64.00	66.35	61.25		59.85	58.30	53.80	62.40	59.45	59.00
1/18/2023		58.45	64.00	66.35	61.25		59.85	58.30	53.41	62.40	59.40	59.00
1/25/2023		58.45	64.00	66.35	61.20		59.85	58.30	53.83	62.40	59.45	59.00
2/1/2023		58.45	64.00	66.35	61.20		59.85	58.30	53.80	62.40	59.45	59.00
2/8/2023		58.45	64.00	66.35	61.25		59.80	58.30	53.80	62.40	59.45	59.00
2/15/2023		58.45	64.00	66.35	61.25		59.85	58.30	53.80	62.40	59.45	59.00
2/22/2023		58.45	64.00	66.35	61.20		59.80	58.30	53.85	62.20	59.45	59.00
3/1/2023		58.43	64.00	66.35	61.25		59.83	58.30	53.85	62.20	59.45	59.00
3/8/2023		58.45	64.00	66.35	61.20		59.83	58.30	53.85	62.20	59.45	59.00
3/15/2023		58.45	64.00	66.35	61.20		59.85	58.30	53.80	62.20	59.45	59.00
3/22/2023		58.45	64.00	66.35	61.20		59.85	58.30	53.83	62.25	59.40	59.00
3/29/2023		58.45	64.00	66.35	61.20		59.85	58.30	53.80	62.20	59.40	59.00

Notes:

1. NRW-01, -03, -04, -05, -08, -09, and -11 are decommissioned.
2. Reported dataset commences on June 26, 2019 when NAPL recovery frequency was reduced to one event per week.
3. Historical dataset is presented in **Appendix A**.
4. Replacement recovery wells NRW-09R and NRW-11R were installed on March 27, 2017 and March 23, 2017 respectively.
5. Replacement recovery wells NRW-01R and NRW-08R were installed on May 21, 2019 and May 24, 2019 respectively.
6. NM - Not Measured
7. NA - No Access
8. Well not operational during monitoring period.
9. All measurements taken from the top of well casing.

Appendix A - Historical Data

Table 1
Summary of DNAPL Gauging
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area															
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12
Date	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet
9/12/2014	0.10		6.90	NM	NM	NM	ND	13.70	6.55		12.00		14.50	Blebs		4.10
9/25/2014	ND		5.30	NM	NM	NM	ND	14.30	1.46		3.00		12.10	ND		ND
10/9/2014	ND		1.40	NM	NM	NM	ND	16.15	2.06		2.41		6.63	ND		ND
10/16/2014	ND		ND	ND	ND	ND	ND	9.35	0.70		1.10		2.75	ND		0.70
10/23/2014	ND		1.30	6.20	8.80	ND	ND	8.80	0.40		2.00		2.45	ND		0.60
10/30/2014	ND		2.20	NM	NM	NM	ND	8.80	0.80		2.90		2.30	ND		0.70
11/6/2014	ND		0.80	NM	NM	NM	ND	6.00	0.20		2.40		1.80	ND		0.50
11/13/2014	ND		0.80	6.80	6.20	ND	ND	6.00	0.60		1.00		1.50	ND		ND
11/20/2014	ND		0.50	1.90	1.70	ND	ND	7.50	ND		1.00		2.00	ND		ND
11/26/2014	NM		NM	NM	NM	NM	ND	6.20	0.20		0.30		ND	ND		0.30
12/4/2014	ND		1.30	0.60	0.50	ND	ND	7.20	4.30		1.20		3.40	ND		ND
12/8/2014	NM		NM	NM	NM	NM	NM	3.20	NM		NM		NM	NM		NM
12/11/2014	Blebs		0.60	Blebs	0.30	ND	ND	3.50	0.20		1.10		1.80	Blebs		Blebs
12/15/2014	NM		NM	NM	NM	NM	NM	3.40	NM		NM		NM	NM		NM
12/18/2014	ND		1.40	0.70	1.10	ND	ND	3.00	ND		ND		1.60	ND		ND
12/24/2014	NM		NM	NM	NM	NM	ND	4.70	2.00		1.80		0.80	ND		ND
12/31/2014	ND		2.20	0.50	0.60	ND	ND	6.30	0.60		0.60		3.10	ND		ND
1/8/2015	Blebs		0.50	0.50	0.60	ND	ND	4.00	Blebs		0.20		1.00	ND		Blebs
1/15/2015	Blebs		0.50	Blebs	0.30	ND	ND	5.70	Blebs		0.80		1.40	ND		0.05
1/22/2015	ND		0.60	0.30	0.35	ND	ND	5.30	0.40		0.67		1.45	ND		ND
1/29/2015	NM		0.90	NM	NM	NM	NM	5.10	ND		1.00		1.60	NM		NM
2/19/2015	NM		NM	NM	NM	NM	NM	15.00	NM		NM		2.70	NM		NM
2/23/2015	Blebs		1.20	NM	NM	NM	NM	8.30	Blebs		2.80		0.30	ND		Blebs
2/27/2015	NM		NM	NM	NM	NM	NM	4.50	0.35		0.80		0.90	ND		Blebs
3/3/2015	ND		2.10	NM	NM	NM	NM	5.40	Blebs		Blebs		0.70	ND		Blebs
3/6/2015	NM		NM	NM	NM	NM	NM	4.00	NM		NM		1.00	NM		NM
3/10/2015	NM		NM	NM	NM	NM	NM	4.00	0.50		1.20		Blebs	ND		Blebs
3/13/2015	NM		NM	NM	NM	NM	NM	2.50	NM		NM		NM	NM		NM
3/17/2015	NM		NM	NM	NM	NM	ND	5.50	0.50		1.10		1.75	ND		ND
3/20/2015	NM		NM	NM	NM	NM	ND	3.80	0.70		0.50		1.10	ND		ND
3/24/2015	NM		NM	NM	NM	NM	ND	2.20	0.80		0.60		1.80	ND		ND
3/27/2015	NM		NM	NM	NM	NM	ND	3.80	1.90		1.20		1.90	ND		ND
3/31/2015	NM		NM	NM	NM	NM	NM	6.10	NM		NM		NM	NM		NM
4/3/2015	NM		NM	NM	NM	NM	ND	4.60	ND		ND		ND	ND		ND
4/9/2015	NM		NM	NM	NM	NM	ND	1.00	ND		0.20		0.20	ND		ND
4/15/2015	NM		NM	NM	NM	NM	ND	3.30	0.30		1.70		0.30	ND		0.10
4/17/2015	NM		NM	NM	NM	NM	ND	5.50	ND		ND		5.00	ND		ND
4/22/2015	ND		3.50	NM	NM	NM	ND	4.00	0.25		0.75		0.40	ND		ND
4/24/2015	ND		1.00	NM	NM	NM	ND	3.30	0.40		1.00		0.60	ND		0.10
4/29/2015	ND		1.50	NM	NM	NM	ND	4.00	0.60		1.10		0.80	ND		0.20
5/11/2015	ND		0.50	NM	NM	NM	ND	3.30	0.90		2.40		0.80	ND		0.20
5/15/2015	ND		0.80	NM	NM	NM	ND	3.80	1.10		4.00		0.90	ND		0.20
5/19/2015	ND		1.20	NM	NM	NM	ND	6.11	0.60		0.25		3.40	ND		0.20
5/22/2015	ND		1.80	NM	NM	NM	ND	6.70	0.70		0.25		3.70	ND		0.20
5/26/2015	ND		2.10	NM	NM	NM	ND	6.70	1.00		0.60		0.80	ND		0.20
5/29/2015	ND		0.20	NM	NM	NM	ND	5.75	1.20		0.75		2.20	ND		0.20
6/2/2015	ND		1.00	NM	NM	NM	ND	5.40	0.60		0.90		1.67	ND		0.20
6/5/2015	ND		0.30	NM	NM	NM	ND	3.60	0.80		1.10		1.00	ND		0.20
6/9/2015	ND		0.70	NM	NM	NM	ND	4.45	0.80		2.25		3.50	ND		0.20
6/12/2015	ND		0.75	NM	NM	NM	ND	3.82	1.30		0.50		1.20	ND		0.20
6/16/2015	ND		0.75	NM	NM	NM	ND	3.40	ND		0.80		2.70	ND		0.20
6/19/2015	ND		0.90	NM	NM	NM	ND	3.20	ND		0.80		4.00	ND		0.20
6/23/2015	ND		1.00	NM	NM	NM	ND	3.50	ND		1.30		1.50	ND		0.20
6/26/2015	ND		1.50	NM	NM	NM	ND	3.00	0.20		0.50		0.60	ND		0.20
6/30/2015	ND		3.00	3.50	NM	NM	ND	3.80	0.40		0.40		1.20	ND		0.90
7/3/2015	NM		3.40	NM	NM	NM	NM	2.00	NM		NM		NM	NM		NM
7/7/2015	ND		0.80	NM	NM	NM	ND	5.30	0.30		0.70		2.10	ND		0.20
7/9/2015	0.10		4.90	3.30	0.60	ND	ND	14.50	4.00		14.90		17.20	ND		4.00
7/10/2015	ND		0.80	NM	NM	NM	ND	3.20	0.30		0.90		0.50	ND		0.20
7/14/2015	ND		1.20	NM	NM	NM	ND	3.80	0.50		1.10		2.20	ND		0.20
7/17/2015	ND		0.20	NM	NM	NM	ND	2.95	0.20		0.20		1.10	ND		0.20
7/20/2015	ND		0.40	NM	NM	NM	ND	3.71	0.30		0.40		1.40	ND		0.20
7/24/2015	ND		0.50	NM	NM	NM	ND	3.10	0.30		0.50		0.80	ND		0.20
7/28/2015	ND		0.60	NM	NM	NM	ND	4.00	0.60		0.70		1.20	ND		0.20
7/31/2015	ND		1.80	NM	NM	NM	ND	2.80	ND		0.90		1.90	ND		ND
8/4/2015	ND		0.50	NM	NM	NM	ND	4.20	0.30		0.20		0.70	ND		0.20
8/7/2015	ND		0.50	NM	NM	NM	ND	2.30	0.30		1.00		1.30	ND		0.20
8/11/2015	ND		0.70	NM	NM	NM	ND	3.60	0.40		0.20		1.00	ND		0.20
8/14/2015	ND		1.00	NM	NM	NM	ND	2.85	0.40		0.30		0.20	ND		0.20
8/18/2015	ND		0.30	NM	NM	NM	ND	3.50	0.60		0.50		1.10	ND		0.20
8/21/2015	ND		1.20	NM	NM	NM	ND	2.50	1.00		1.00		0.40	ND		0.20
8/25/2015	ND		0.10	NM	NM	NM	ND	2.90	0.20		3.10		1.10	ND		ND
8/27/2015	ND		0.10	NM	NM	NM	ND	3.10	ND		3.40		1.30	ND		ND
9/4/2015	ND		ND	NM	NM	NM	ND	5.40	0.30		2.00		4.70	ND		ND
9/8/2015	ND		ND	NM	NM	NM	ND	3.70	0.50		3.10		1.40	ND		ND
9/10/2015	ND		0.50	NM	NM	NM	ND	3.20	0.20		0.50		2.10	ND		ND
9/15/2015	ND		1.40	0.60	NM	NM	ND	4.30	1.10		1.10		2.70	ND		ND
9/17/2015	ND		1.40	NM	NM	NM	ND	5.20	0.60		1.10		0.70	ND		ND
9/22/2015	ND		1.50	1.30	NM	NM	ND	5.10	0.80		2.10		1.80	ND		ND
9/24/2015	ND		1.60	NM	NM	NM	ND	4.00	0.80		0.40		2.20	ND		ND
9/29/2015	ND		1.90	1.60	NM	NM	ND	5.10	0.90		0.30		0.80	ND		ND
10/1/2015	ND		2.10	NM	NM	NM	ND	3.60	1.20		0.30		1.10	ND		ND
10/6/2015	ND		2.40	1.70	NM	NM	ND	5.30	1.80		2.30		1.30	ND		ND
10/8/2015	ND		0.60	NM	NM	NM	ND	4.20	1.30		1.80		2.10	ND		ND
10/13/2015	ND		0.80	1.70	NM	NM	ND	4.80	1.10		1.10		2.40	ND		ND
10/15/2015	ND		1.10	NM	NM	NM	ND	4.20	1.30		1.30		0.90	ND		ND
10/22/2015	NM		NM	NM	NM	NM	NM	2.75	NM		1.20		2.10	NM		NM
10/29/2015	ND		2.20	NM	NM	NM	ND	5.40	2.30		2.50		4.50	ND		ND
11/4/2015	ND		0.30	NM	NM	NM	ND	4.60	1.40		0.90		2.60	ND		0.20
11/9/2015	ND		0.80	NM	NM	NM	ND	4.30	1.50		0.30		1.30	ND		0.30
11/13/2015	ND		0.80	NM	NM	NM	ND	3.80	0.10		0.50		0.90	ND		ND

Table 1
Summary of DNAPL Gauging
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13
Date	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet
11/18/2015	ND		1.00	NM	NM	NM	ND	3.50	ND		0.30		1.20	ND		ND	ND
11/24/2015	ND		0.40	NM	NM	NM	ND	4.80	ND		ND		1.60	ND		ND	ND
12/7/2015	ND		3.00	NM	NM	NM	ND	9.00	4.70		1.40		2.80	ND		ND	ND
12/22/2015	NM		NM	NM	NM	NM	ND	11.00	ND		0.30		3.40	ND		ND	ND
12/31/2015	NM		NM	NM	NM	NM	ND	8.00	ND		2.00		2.20	ND		ND	ND
1/5/2016	NM		NM	NM	NM	NM	ND	6.00	ND		1.20		1.40	ND		ND	ND
1/13/2016	NM		NM	NM	NM	NM	ND	7.00	ND		1.00		1.30	ND		ND	ND
1/21/2016	ND		2.40	NM	NM	NM	ND	10.00	ND		1.50		1.40	ND		ND	ND
1/27/2016	ND		2.60	NM	NM	NM	ND	10.50	ND		1.80		1.30	ND		ND	ND
1/29/2016	NM		2.00	NM	NM	NM	NM	1.50	NM		2.00		1.50	NM		NM	NM
2/2/2016	ND		0.20	NM	NM	NM	ND	5.00	0.20		0.30		1.10	ND		0.20	ND
2/5/2016	ND		0.20	NM	NM	NM	ND	2.50	0.30		0.50		0.90	ND		0.20	ND
2/8/2016	ND		ND	NM	NM	NM	ND	2.70	ND		0.50		0.80	ND		ND	ND
2/11/2016	ND		0.30	NM	NM	NM	ND	3.10	ND		0.20		0.50	ND		ND	ND
2/16/2016	ND		1.20	NM	NM	NM	ND	3.80	0.60		1.60		2.30	0.40		0.40	ND
2/18/2016	ND		1.10	NM	NM	NM	ND	2.10	0.70		1.80		0.50	0.40		0.40	ND
2/22/2016	ND		1.20	NM	NM	NM	ND	2.60	0.60		0.50		1.10	0.50		0.40	ND
2/26/2016	ND		1.50	NM	NM	NM	ND	3.10	0.90		1.10		1.80	0.40		0.50	ND
2/29/2016	ND		1.70	NM	NM	NM	ND	2.30	1.00		1.30		2.10	0.40		0.50	ND
3/3/2016	ND		1.80	NM	NM	ND	ND	2.60	1.70		1.70		0.80	0.40		0.50	ND
3/8/2016	ND		0.30	NM	NM	ND	ND	4.20	1.80		2.00		1.80	0.40		0.50	ND
3/11/2016	ND		0.90	NM	NM	ND	ND	3.00	1.80		1.20		1.10	0.40		0.50	ND
3/16/2016	ND		1.20	NM	NM	ND	ND	4.20	1.40		1.50		2.30	0.40		0.50	ND
3/18/2016	ND		1.40	NM	NM	ND	ND	2.30	1.40		1.60		0.90	0.40		0.50	ND
3/22/2016	ND		1.50	NM	NM	ND	ND	3.60	1.40		1.60		1.90	0.50		0.50	ND
3/25/2016	ND		1.50	NM	NM	ND	ND	3.30	1.40		1.70		2.20	0.50		0.50	ND
3/29/2016	ND		1.50	NM	NM	ND	ND	3.90	1.10		2.00		2.80	0.50		0.50	ND
4/1/2016	ND		1.90	NM	NM	ND	ND	3.00	1.80		1.90		1.20	0.50		0.50	ND
4/6/2016	ND		1.80	NM	NM	ND	ND	4.80	1.90		2.50		1.80	0.50		0.50	ND
4/8/2016	ND		1.50	NM	NM	ND	ND	2.10	ND		0.50		2.00	0.50		0.50	ND
4/11/2016	ND		1.70	NM	NM	ND	ND	4.00	0.30		1.10		3.20	0.50		0.50	ND
4/15/2016	NM		NM	NM	NM	NM	NM	4.20	NM		NM		NM	NM		NM	NM
4/18/2016	ND		2.00	NM	7.10	NM	ND	3.10	0.70		1.30		3.40	0.50		0.50	ND
4/22/2016	NM		NM	6.00	1.10	ND	ND	4.10	0.50		2.00		4.00	0.50		0.50	ND
4/26/2016	NM		NM	0.80	0.50	ND	ND	3.40	NM		NM		NM	NM		NM	NM
4/28/2016	NM		NM	0.80	0.50	ND	ND	3.20	0.50		0.10		2.90	0.50		0.50	ND
5/3/2016	NM		NM	0.90	0.70	ND	ND	1.50	0.80		0.80		1.75	0.50		0.50	ND
5/6/2016	NM		NM	NM	NM	NM	ND	3.50	ND		0.50		2.20	0.50		0.50	ND
5/10/2016	ND		ND	ND	NM	ND	ND	3.00	ND		0.50		1.50	0.50		0.50	ND
5/13/2016	ND		ND	ND	0.50	0.25	ND	5.50	ND		0.50		1.50	0.50		NM	NM
5/17/2016	NM		NM	4.00	NM	ND	ND	7.50	ND		0.30		18.00	ND		NM	ND
5/20/2016	ND		4.20	ND	0.30	NM	NM	3.00	NM		1.90		10.00	NM		NM	NM
5/24/2016	NM		NM	ND	0.50	0.50	ND	7.50	ND		0.50		10.50	NM		NM	NM
5/27/2016	NM		NM	ND	0.50	0.50	ND	ND	ND		0.50		7.50	NM		NM	NM
5/31/2016	NM		NM	ND	0.50	0.50	ND	3.00	ND		0.50		3.50	ND		1.00	ND
6/7/2016	NM		NM	NM	NM	NM	ND	10.00	0.60		0.70		3.00	0.50		0.50	ND
6/9/2016	NM		6.00	NM	NM	NM	ND	4.00	0.60		0.60		0.50	ND		ND	ND
6/14/2016	ND		6.00	NM	NM	NM	ND	6.00	0.50		3.00		5.20	ND		ND	ND
6/17/2016	ND		6.00	NM	ND	ND	ND	6.00	NM		NM		NM	NM		ND	ND
6/21/2016	ND		3.10	NM	NM	NM	ND	11.20	NM		NM		NM	NM		NM	NM
7/6/2016	ND		2.50	NM	ND	ND	ND	7.00	2.00		1.00		5.00	ND		5.00	ND
7/8/2016	NM		NM	NM	NM	NM	NM	NM	NM		NM		20.20	NM		15.10	NM
7/12/2016	ND		3.00	NM	NM	NM	ND	12.00	0.50		1.00		7.00	ND		10.00	ND
7/15/2016	ND		1.50	NM	NM	NM	ND	6.00	0.50		1.00		15.00	ND		15.00	ND
7/19/2016	ND		0.50	NM	NM	NM	ND	7.00	0.50		1.50		12.00	ND		4.50	ND
7/22/2016	ND		0.50	NM	NM	NM	ND	2.50	0.70		0.80		10.00	ND		2.50	ND
7/26/2016	NM		NM	NM	NM	NM	ND	5.50	0.90		2.00		6.00	ND		3.00	ND
7/29/2016	ND		0.70	NM	NM	NM	ND	3.00	0.50		2.00		1.00	ND		1.50	ND
8/2/2016	ND		0.80	NM	NM	NM	ND	4.50	0.50		1.80		1.00	ND		2.00	ND
8/5/2016	ND		1.00	NM	NM	NM	ND	3.00	0.50		2.00		1.50	ND		NM	ND
8/9/2016	ND		0.40	NM	NM	NM	NM	5.00	0.50		1.00		0.80	ND		2.00	ND
8/12/2016	ND		1.50	NM	NM	NM	ND	3.20	ND		0.50		1.00	ND		0.80	ND
8/17/2016	ND		1.70	NM	NM	NM	ND	4.50	0.80		3.30		1.70	1.50		0.30	ND
8/19/2016	ND		2.30	NM	NM	NM	NM	2.50	0.80		0.10		0.30	NM		0.30	ND
8/23/2016	ND		0.20	NM	NM	NM	ND	4.00	ND		0.50		1.00	1.50		0.50	ND
8/25/2016	ND		0.50	NM	NM	NM	ND	2.20	ND		0.50		1.00	1.50		0.70	ND
8/30/2016	ND		1.00	NM	NM	NM	ND	5.30	0.20		0.50		0.90	1.50		0.50	ND
9/2/2016	ND		1.50	NM	NM	NM	ND	3.30	0.20		0.40		1.00	1.10		0.50	ND
9/6/2016	ND		0.30	NM	NM	NM	ND	4.80	ND		1.50		1.60	0.50		0.80	ND
9/9/2016	ND		0.70	NM	NM	NM	ND	3.50	ND		1.20		1.00	0.60		0.70	ND
9/12/2016	NM		NM	NM	NM	NM	ND	3.50	0.30		1.70		2.40	0.50		1.10	ND
9/15/2016	ND		1.70	NM	NM	NM	ND	2.80	1.70		2.10		1.10	1.10		1.30	ND
9/21/2016	ND		1.90	NM	NM	NM	ND	5.50	0.40		2.20		1.80	1.00		1.50	ND
9/26/2016	ND		2.20	NM	NM	NM	ND	4.00	ND		2.00		2.00	0.50		1.00	ND
9/29/2016	ND		1.00	NM	NM	NM	ND	4.50	ND		0.70		1.30	0.50		1.00	ND
10/4/2016	ND		2.80	NM	NM	NM	ND	6.50	ND		2.90		2.50	0.20		4.40	ND
10/7/2016	NM		3.10	NM	NM	NM	NM	6.20	NM		NM		2.80	NM		NM	NM
10/11/2016	ND		0.30	NM	NM	NM	ND	4.10	ND		2.50		0.50	ND		8.80	ND
10/14/2016	NM		NM	NM	NM	NM	NM	3.20	NM		3.30		NM	NM		5.50	NM
10/17/2016	ND		1.00	NM	NM	NM	ND	3.50	ND		0.30		0.80	0.50		2.40	ND
10/21/2016	ND		ND	NM	NM	NM	ND	3.90	ND		0.70		1.20	NM		2.80	ND
10/26/2016	ND		ND	NM	NM	NM	ND	7.10	ND		0.90		1.80	NM		9.90	ND
10/31/2016	ND		2.70	NM	NM	NM	ND	5.00	ND		0.30		2.60	NM		10.00	ND
11/3/2016	ND		3.10	NM	NM	NM	ND	2.60	0.50		0.80		0.90	NM		10.00	ND
11/7/2016	ND		2.00	NM	NM	NM	ND	2.50	0.30		0.90		1.20	NM		10.00	ND
11/10/2016	ND		1.50	NM	NM	NM	ND	2.90	0.30		1.10		1.80	NM		10.00	ND
11/16/2016	ND		NM	NM	NM	NM	ND	5.90	0.30		0.90		0.50	ND		12.80	ND
11/18/2016	ND		2.10	NM	NM	NM	ND	2.60	0.30		NM		0.70	NM		10.00	ND
11/21/2016	ND		1.10	NM	NM	NM	ND	3.10	0.30		NM		0.80	NM		12.00	0.30
11/23/2016	ND		0.90	NM	NM	NM	ND	1.70	0.40		NM		0.80	NM		10.00	ND
11/28/2016	ND		2.50	N													

Table 1
Summary of DNAPL Gauging
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13
Date	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet
12/5/2016	ND		ND	NM	NM	NM	ND	3.20	0.80		NM		2.90	NM		11.50	0.30
12/7/2016	ND		6.40	NM	NM	NM	ND	13.22	0.80		NM		2.90	NM		11.50	0.30
12/9/2016	ND		6.50	NM	NM	NM	ND	5.10	0.90		NM		3.90	NM		9.00	ND
12/12/2016	ND		3.50	NM	NM	NM	ND	2.20	1.00		NM		3.30	NM		7.00	ND
12/14/2016	ND		1.50	NM	NM	NM	ND	2.00	1.00		NM		5.50	NM		3.00	ND
12/16/2016	ND		3.40	NM	NM	NM	ND	2.80	1.00		NM		2.40	NM		0.80	ND
12/19/2016	ND		3.50	NM	NM	NM	ND	1.90	1.00		NM		2.00	NM		3.40	ND
12/21/2016	ND		2.00	NM	NM	NM	ND	1.20	1.00		NM		1.60	NM		6.00	ND
12/23/16	NM		NM	NM	NM	NM	ND	1.60	1.00		NM		2.30	NM		4.00	ND
12/27/2016	NM		NM	NM	NM	NM	ND	1.90	1.00		NM		3.60	NM		6.00	ND
12/29/2016	NM		NM	NM	NM	NM	ND	2.60	1.00		NM		2.40	NM		4.50	ND
1/3/2017	ND		2.80	NM	NM	NM	ND	2.00	1.00		NM		2.00	NM		4.90	ND
1/6/2017	ND		1.20	NM	NM	NM	ND	3.70	1.00		NM		4.50	NM		6.00	ND
1/9/2017	ND		1.50	NM	NM	NM	ND	2.70	1.00		NM		5.40	NM		7.50	ND
1/11/2017	ND		1.80	NM	NM	NM	ND	4.40	1.00		NM		5.70	NM		8.40	ND
1/13/2017	ND		2.30	NM	NM	NM	ND	3.40	1.00		NM		4.86	NM		9.50	ND
1/16/2017	ND		2.50	NM	NM	NM	ND	6.00	1.00		NM		5.20	NM		9.90	ND
1/18/2017	ND		1.00	NM	NM	NM	ND	4.40	1.00		NM		2.50	NM		7.00	ND
1/20/2017	ND		1.40	NM	NM	NM	ND	4.00	1.00		NM		2.00	NM		7.00	ND
1/24/2017	ND		1.80	NM	NM	NM	ND	2.20	1.00		NM		4.20	NM		8.90	ND
1/25/2017	ND		2.20	NM	NM	NM	ND	3.00	1.00		NM		2.00	NM		4.00	ND
1/27/2017	ND		2.00	NM	NM	NM	ND	5.00	1.00		NM		1.00	NM		7.10	ND
1/30/2017	ND		1.20	NM	NM	NM	ND	5.20	1.00		NM		1.50	NM		6.80	ND
2/1/2017	ND		3.00	NM	NM	NM	ND	5.00	1.00		NM		2.00	NM		4.60	ND
2/3/2017	ND		ND	NM	NM	NM	ND	4.80	1.00		NM		2.50	NM		5.10	ND
2/6/2017	ND		1.50	NM	NM	NM	ND	7.50	1.00		NM		2.50	NM		2.50	ND
2/8/2017	ND		1.00	NM	NM	NM	ND	5.00	1.50		NM		3.00	NM		1.50	ND
2/10/2017	ND		2.00	NM	NM	NM	ND	5.50	1.50		NM		1.50	NM		3.00	ND
2/14/2017	ND		3.00	NM	NM	NM	ND	7.00	1.50		NM		2.00	NM		5.00	ND
2/15/2017	ND		1.00	NM	NM	NM	ND	4.00	1.70		NM		1.50	NM		4.00	ND
2/17/2017	ND		0.50	NM	NM	NM	ND	4.00	1.70		NM		1.70	NM		3.00	0.30
2/21/2017	ND		1.00	NM	NM	NM	ND	6.60	1.70		NM		2.00	NM		5.00	0.50
2/22/2017	ND		1.00	NM	NM	NM	ND	3.50	1.70		NM		2.00	NM		4.00	0.50
2/24/2017	ND		1.00	NM	NM	NM	ND	5.50	1.70		NM		2.00	NM		4.00	1.00
2/27/2017	ND		1.00	NM	NM	NM	ND	5.70	1.70		NM		2.00	NM		3.50	0.80
3/1/2017	ND		1.00	NM	NM	NM	ND	4.00	1.70		NM		0.20	NM		2.50	0.20
3/3/2017	ND		1.00	NM	NM	NM	ND	4.00	1.00		NM		0.30	NM		2.50	0.20
3/6/2017	ND		1.00	NM	NM	NM	ND	5.00	2.00		NM		0.40	NM		3.50	0.30
3/8/2017	ND		1.00	NM	NM	NM	ND	5.00	3.00		NM		0.50	NM		3.00	0.50
3/13/2017	ND		1.00	NM	NM	NM	ND	7.00	2.50		NM		0.50	NM		4.50	0.50
3/15/2017	ND		2.00	NM	NM	NM	ND	5.00	0.80		NM		0.80	NM		2.50	0.50
3/17/2017	ND		ND	NM	NM	NM	ND	6.00	NM		NM		ND	NM		2.00	0.50
3/22/2017	ND		4.00	NM	NM	NM	ND	7.00	2.00		NM		1.00	NM		7.00	0.50
3/24/2017	ND		1.00	NM	NM	NM	ND	7.50	2.00		NM		1.00	NM		NM	0.50
3/29/2017	ND		1.00	NM	NM	NM	ND	7.00	2.00		NM		1.00	NM		5.00	0.50
3/30/2017	ND		1.00	NM	NM	NM	ND	2.00	2.00		NM		1.00	NM		2.50	0.50
3/31/2017	ND		1.00	NM	NM	NM	ND	3.00	2.50		NM		1.00	NM		0.50	0.50
4/3/2017	ND		1.00	NM	NM	NM	ND	7.00	NM		NM		1.50	NM		1.50	1.00
4/5/2017	ND		1.00	NM	NM	NM	ND	4.00	1.00		NM		1.50	NM		1.00	0.50
4/7/2017	ND		1.00				ND	2.00	4.00			ND	1.00		4.00	1.50	0.50
4/10/2017	ND		0.50				ND	7.00	2.00			0.50	1.00		4.50	2.00	0.50
4/12/2017	ND		0.40				ND	6.00	1.00			0.50	0.50		4.00	0.90	0.50
4/14/2017	ND		0.40				ND	4.20	1.00			0.70	1.00		4.00	1.00	0.30
4/18/2017	ND		ND				ND	7.00	0.30			0.50	1.50		5.00	0.50	0.40
4/21/2017	ND		ND				ND	3.00	1.50			0.50	1.50		5.00	0.50	0.40
4/24/2017	0.10		ND				ND	8.00	0.30			0.60	0.20		5.00	0.50	0.50
4/26/2017	0.10		2.00				ND	4.00	1.00			0.20	1.00		5.00	0.20	1.00
4/28/2017	0.10		1.00				ND	3.50	0.40			0.50	1.00		5.00	0.50	0.50
5/1/2017	0.10		0.70				ND	6.00	0.50			0.50	1.00		2.50	2.00	1.00
5/3/2017	ND		0.40				ND	9.00	1.00			0.40	1.00		5.00	1.00	0.50
5/5/2017	ND		0.50				ND	3.00	1.00			0.50	2.50		2.50	1.00	0.70
5/8/2017	ND		0.70				ND	3.50	0.70			0.50	1.00		5.00	1.00	0.80
5/10/2017	ND		0.70				ND	4.00	0.80			0.50	0.80		3.50	1.50	2.00
5/12/2017	ND		0.80				ND	2.00	0.80			0.50	1.00		6.00	1.00	0.60
5/16/2017	ND		0.50				ND	6.00	ND			0.20	0.50		2.00	1.00	0.80
5/19/2017	ND		0.50				ND	2.00	0.40			0.00	1.50		0.50	2.50	0.60
5/22/2017	ND		0.30				ND	5.00	0.80			0.00	0.80		7.50	3.00	1.00
5/25/2017	ND		0.50				ND	7.00	1.00			0.00	0.80		4.50	1.00	0.20
5/31/2017	NM		ND				ND	3.50	ND			1.00	ND		3.00	1.50	ND
6/1/2017	NM		0.80				ND	5.00	ND			0.00	0.20		3.00	1.00	1.50
6/5/2017	NM		1.00				ND	4.00	0.40			0.00	1.50		0.50	2.50	0.80
6/7/2017	NM		0.30				ND	2.00	1.50			0.00	1.50		4.50	3.50	1.00
6/9/2017	NM		0.50				ND	3.00	0.20			0.00	1.20		4.00	0.60	1.50
6/12/2017	NM		0.80				ND	3.50	2.00			0.00	1.00		3.50	0.80	0.40
6/14/2017	NM		1.00				ND	2.00	1.00			0.60	0.80		1.30	1.50	0.50
6/16/2017	NM		0.30				ND	2.00	1.00			0.60	1.00		0.50	2.00	0.50
6/19/2017	NM		0.50				ND	3.00	1.20			0.60	1.20		3.20	0.50	1.00
6/21/2017	NM		ND				ND	2.00	0.60			0.40	1.50		0.70	2.50	0.80
6/23/2017	NM		0.50				ND	3.00	1.00			0.20	1.00		5.00	1.00	0.50
6/26/2017	NM		2.00				ND	3.50	1.00			1.00	0.80		5.00	1.00	2.00
6/28/2017	NM		0.60				ND	3.00	1.00			1.00	1.00		4.00	4.00	0.40
6/30/2017	NM		0.80				ND	3.00	1.00			1.00	1.00		3.50	0.50	0.60
7/5/2017	NM		1.00				ND	3.50	1.00			0.00	2.00		3.00	0.80	0.60
7/7/2017	NM		1.00				ND	2.00	1.00			0.40	1.00		2.00	1.00	0.80
7/10/2017	NM		0.50				ND	2.50	0.30			0.40	1.00		3.50	0.50	1.30
7/12/2017	NM		0.80				ND	3.00	0.60			0.50	1.50		3.00	0.60	0.30
7/14/2017	NM		2.00				ND	3.00	0.80			0.60	2.00		4.00	0.60	0.60
7/17/2017	NM		0.60				ND	3.50	2.00			1.50	1.00		6.00	2.00	1.00
7/19/2017	NM		1.00				ND	3.00	2.00			1.50	2.00		4.50	0.80	1.50
7/21/2017	NM		2.00				ND	3.50	2.00			1.60	2.00		5.00	1.00	1.70
7/24/2017	NM		1.00				ND	4.00</									

Table 1
Summary of DNAPL Gauging
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13
Date	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet
8/2/2017	NM		1.00				ND	4.00	1.00			0.80	1.30		6.00	0.50	0.80
8/4/2017	NM		1.40				ND	3.00	2.00			0.60	0.70		4.50	2.00	0.80
8/7/2017	NM		1.60				ND	3.00	1.00			1.00	0.80		6.00	0.60	0.80
8/9/2017	NM		1.80				ND	3.00	1.40			1.20	1.40		5.00	1.20	1.60
8/11/2017	NM		2.00				ND	4.00	2.00			0.80	2.00		5.00	1.50	2.00
8/14/2017	NM		0.60				ND	4.00	1.00			1.00	1.00		5.00	2.00	1.00
8/16/2017	NM		1.00				ND	5.00	1.60			1.50	1.40		6.00	2.00	1.40
8/18/2017	NM		1.50				ND	3.50	2.00			2.00	2.00		5.00	0.50	2.00
8/21/2017	NM		1.80				ND	4.50	1.40			1.60	1.40		6.00	0.80	1.20
8/23/2017	NM		2.00				ND	3.50	1.80			2.00	2.00		5.00	1.40	1.60
8/25/2017	NM		1.00				ND	4.00	1.00			1.00	0.80		5.00	2.00	2.00
8/28/2017	NM		2.00				ND	5.00	1.60			1.50	1.50		6.00	1.00	1.00
8/30/2017	NM		0.40				ND	4.00	2.00			1.80	1.00		6.00	1.40	1.50
9/1/2017	NM		1.00				ND	2.50	0.60			0.60	1.50		4.50	1.80	2.00
9/6/2017	NM		1.40				ND	5.50	1.40			1.20	2.00		5.00	2.50	0.80
9/8/2017	NM		1.60				ND	3.50	2.00			2.00	0.80		5.00	6.00	1.40
9/11/2017	NM		2.00				ND	6.00	1.80			1.00	1.20		6.50	2.00	1.60
9/13/2017	NM		0.50				ND	4.00	2.00			0.60	1.80		5.00	2.00	1.80
9/15/2017	NM		1.00				ND	5.40	1.10			1.00	0.80		4.50	0.80	2.00
9/18/2017	NM		1.30				ND	4.30	1.40			1.50	1.20		5.50	1.20	0.60
9/20/2017	NM		2.00				ND	4.50	1.80			1.80	1.60		6.00	1.80	0.80
9/22/2017	NM		0.50				ND	3.00	2.00			2.00	1.80		4.50	8.00	1.00
9/25/2017	NM		0.80				ND	5.00	0.60			0.50	0.40		4.50	1.00	1.40
9/27/2017	NM		0.90				ND	4.30	0.70			0.60	0.50		5.50	0.30	1.50
9/29/2017	NM		1.20				ND	4.50	1.20			0.90	0.80		5.00	0.70	1.70
10/2/2017	NM		1.60				ND	4.00	1.60			1.20	1.10		5.50	1.30	2.00
10/4/2017	NM		1.8				ND	3.50	2.00			1.40	1.40		5.00	1.00	0.40
10/6/2017	NM		2.00				ND	3.50	0.40			1.60	1.70		5.30	1.20	0.70
10/9/2017	NM		0.40				ND	3.50	0.70			2.00	2.00		6.00	1.60	1.10
10/11/2017	NM		0.70				ND	2.50	0.80			0.30	0.20		5.00	1.70	1.20
10/13/2017	NM		1.00				ND	3.50	1.00			0.60	0.50		6.00	2.00	1.30
10/16/2017	NM		1.50				ND	4.50	1.40			0.90	0.90		6.00	0.30	1.50
10/18/2017	NM		1.80				ND	5.00	1.60			1.20	1.10		4.50	0.60	1.40
10/20/17	NM		2.20				ND	4.50	1.80			1.40	1.30		5.00	0.70	1.80
10/23/2017	NM		0.40				ND	3.50	2.00			1.80	1.50		5.00	1.00	2.00
10/25/2017	NM		0.50				ND	4.50	0.20			0.20	0.20		5.00	1.10	2.00
10/27/2017	NM		0.60				ND	3.50	0.50			0.40	0.40		4.50	1.60	0.30
10/30/2017	NM		0.80				ND	3.00	0.50			0.70	0.60		5.00	1.70	0.40
11/1/2017	NM		1.00				ND	NM	0.70			0.80	0.70		4.50	1.90	0.60
11/3/2017	NM		1.20				ND	5.50	0.90			1.00	0.90		5.00	2.00	0.70
11/6/2017	NM		1.50				ND	4.30	1.10			1.30	1.20		4.50	0.20	0.90
11/8/2017	NM		1.70				ND	3.50	1.20			1.50	1.30		4.00	0.40	1.00
11/10/2017	NM		2.00				ND	3.70	1.30			1.60	1.40		3.50	0.60	1.10
11/13/2017	NM		0.30				ND	4.00	1.40			1.70	1.60		3.00	0.80	1.20
11/15/2017	NM		0.50				ND	3.20	1.50			1.80	1.70		4.00	1.00	1.30
11/17/2017	NM		0.70				ND	3.00	1.70			2.00	1.90		3.50	1.10	1.40
11/20/2017	NM		0.90				ND	3.00	2.00			0.20	2.20		4.00	1.30	1.60
11/22/2017	NM		1.00				ND	3.80	0.20			0.30	0.20		3.00	1.50	1.70
11/27/2017	NM		1.30				ND	5.00	0.40			0.60	0.50		4.50	0.30	0.40
11/29/2017	NM		1.80				ND	3.60	0.50			0.70	0.50		3.50	0.70	0.50
12/1/2017	NM		0.40				ND	3.00	0.80			1.40	0.90		3.50	1.00	0.80
12/4/2017	NM		0.70				ND	3.80	1.00			0.30	1.10		3.00	0.20	1.00
12/6/2017	NM		0.90				ND	3.70	1.10			0.50	1.30		3.30	0.40	1.10
12/8/2017	NM		1.10				ND	3.20	1.30			0.70	1.40		3.40	0.60	1.30
12/11/2017	NM		1.40				ND	3.50	1.60			1.00	1.70		NM	0.90	1.50
12/13/2017	NM		1.70				ND	3.20	1.80			1.20	1.90		4.00	1.00	1.60
12/15/2017	NM		1.80				ND	3.20	2.00			1.40	2.00		3.70	1.20	1.70
12/18/2017	NM		0.30				ND	4.20	0.30			1.70	0.20		4.50	1.50	2.00
12/20/2017	NM		0.50				ND	3.20	0.50			2.00	0.40		4.20	1.70	0.30
12/22/2017	NM		0.70				ND	3.00	0.70			0.20	0.60		4.00	1.90	0.50
12/27/2017	NM		1.10				ND	5.00	0.90			0.50	1.00		4.50	0.40	0.80
12/29/2017	NM		1.40				ND	3.50	1.00			0.70	1.20		4.00	0.60	1.00
1/8/2018	NM		2.50				ND	10.00	2.00			1.50	2.00		11.00	1.80	2.00
1/10/2018	NM		2.70				ND	3.50	2.20			1.70	2.20		5.00	2.00	2.20
1/12/2018	NM		3.10				ND	3.50	0.30			0.30	0.20		4.30	0.30	0.20
1/15/2018	NM		3.50				ND	3.50	0.60			0.50	0.50		4.50	0.50	0.40
1/17/2018	NM		0.30				ND	3.00	0.80			0.70	0.80		4.00	0.70	0.60
1/19/2018	NM		0.50				ND	3.50	1.00			0.90	1.00		4.30	0.90	0.80
1/22/2018	NM		0.70				ND	3.70	1.30			1.20	1.30		4.30	1.10	1.10
1/24/2018	NM		0.90				ND	3.20	1.50			1.50	1.50		4.00	1.30	1.30
1/26/2018	NM		1.10				ND	3.50	1.70			1.70	1.60		4.00	1.50	1.50
1/29/2018	NM		1.30				ND	3.70	2.00			2.00	1.80		4.50	0.30	0.30
1/31/2018	NM		1.50				ND	3.00	0.30			0.30	2.00		4.00	0.50	0.50
2/2/2018	NM		1.70				ND	3.00	0.50			0.40	0.30		4.00	0.40	0.60
2/5/2018	NM		2.00				ND	3.20	0.70			0.70	0.40		3.50	0.90	0.80
2/7/2018	NM		0.30				ND	3.00	1.00			1.00	0.70		3.00	1.00	1.00
2/9/2018	NM		0.40				ND	3.00	1.10			1.20	0.90		3.50	1.20	1.20
2/12/2018	NM		0.70				ND	4.00	1.40			1.50	1.10		4.50	1.50	1.50
2/19/2018	NM		1.50				ND	4.00	0.30			0.30	1.80		4.80	0.30	0.20
2/21/2018	NM		1.70				ND	3.00	0.50			0.50	2.00		4.00	0.50	0.40
2/23/2018	NM		1.90				ND	3.00	0.70			0.70	0.20		4.00	0.70	0.60
2/26/2018	NM		2.10				ND	4.00	1.00			1.00	0.40		4.50	0.90	0.70
2/28/2018	NM		0.20				ND	3.50	1.10			1.20	0.50		4.00	1.00	0.80
3/2/2018	NM		0.30				ND	3.00	1.20			1.30	0.60		4.00	1.10	0.90
3/5/2018	NM		1.70				NM	2.25	NM			NM	NM		NM	NM	0.80
3/9/2018	NM		1.10				ND	3.80	0.55			0.50	0.50		3.70	0.40	0.60
3/12/2018	NM		1.10				ND	5.30	0.70			0.35	0.30		3.60	0.35	0.50
3/14/2018	NM		1.30				ND	7.30	0.80			NM	0.35		2.80	1.10	0.50
3/16/2018	NM		0.90				ND	5.80	0.50			0.75	0.80		3.40	0.40	1.50
3/19/2018	NM		1.30				ND	5									

Table 1
Summary of DNAPL Gauging
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13
Date	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet
3/30/2018	NM		1.00				ND	1.70	0.10			0.60	0.60		0.90	0.70	0.60
4/2/2018	NM		1.00				ND	2.40	0.10			0.60	0.70		1.20	0.50	0.70
4/4/2018	NM		1.10				ND	1.50	NM			0.40	0.70		0.90	0.60	0.60
4/6/2018	NM		0.60				ND	1.60	NM			0.40	0.70		0.70	0.60	0.60
4/9/2018	NM		0.70				ND	2.30	NM			0.60	0.90		1.00	0.70	0.60
4/11/2018	NM		0.70				ND	1.40	NM			0.60	0.90		0.60	0.70	0.60
4/13/2018	NM		0.70				ND	1.40	NM			0.60	0.90		1.00	0.70	0.60
4/16/2018	NM		0.70				ND	2.50	NM			0.60	0.90		0.35	0.70	0.60
4/18/2018	NM		0.70				ND	0.80	NM			0.60	0.90		1.00	0.70	0.60
4/20/2018	NM		0.80				ND	1.40	NM			0.60	0.90		1.40	1.00	1.20
4/23/2018	NM		0.80				ND	1.90	NM			0.60	0.90		0.90	1.00	1.20
4/25/2018	NM		0.80				ND	1.80	NM			0.60	0.90		1.50	1.00	1.20
4/27/2018	NM		1.10				ND	1.80	NM			0.60	0.90		1.50	1.00	1.20
4/30/2018	NM		1.10				ND	2.00	NM			0.60	0.90		1.60	1.00	1.20
5/2/2018	NM		1.10				ND	1.60	NM			0.60	1.20		1.80	1.00	1.20
5/4/2018	NM		1.10				ND	1.60	NM			0.60	1.20		1.30	1.00	1.20
5/7/2018	NM		1.10				ND	2.00	NM			0.60	1.20		1.70	1.00	1.20
5/9/2018	NM		1.10				ND	1.35	NM			0.60	1.20		1.60	1.00	1.20
5/11/2018	NM		1.10				ND	1.80	NM			0.60	0.50		1.40	1.00	1.20
5/14/2018	NM		1.20				ND	1.80	NM			0.60	0.70		1.40	1.00	1.20
5/16/2018	NM		0.50				ND	1.30	NM			0.60	0.50		1.30	1.00	1.20
5/18/2018	NM		0.80				ND	1.10	NM			0.60	0.50		1.60	1.20	1.00
5/21/2018	NM		0.60				ND	1.70	NM			0.60	0.50		1.70	1.00	1.20
5/23/2018	NM		0.60				ND	1.40	NM			0.70	0.50		1.80	1.00	1.20
5/25/2018	NM		1.00				ND	1.40	NM			0.80	0.80		1.30	1.30	1.20
5/30/2018	NM		1.20				ND	3.00	NM			1.00	1.00		2.10	1.30	0.30
6/1/2018	NM		1.40				ND	1.60	NM			0.40	1.00		1.60	1.50	0.30
6/6/2018	NM		1.60				ND	3.00	NM			0.60	0.20		2.60	0.10	0.10
6/8/2018	NM		1.60				ND	1.50	NM			0.70	0.50		0.60	0.50	0.30
6/11/2018	NM		1.00				ND	1.60	NM			0.20	0.20		0.40	0.10	0.30
6/13/2018	NM		1.00				ND	0.80	NM			0.50	0.40		0.20	0.20	0.10
6/15/2018	NM		0.30				ND	0.80	NM			0.30	0.30		0.40	0.50	0.20
6/18/2018	NM		1.00				ND	2.70	NM			0.20	0.10		0.30	0.50	0.10
6/20/2018	NM		0.30				ND	1.60	NM			0.30	0.20		0.90	0.10	0.20
6/22/2018	NM		1.00				ND	1.50	NM			0.10	0.10		0.40	0.20	ND
6/25/2018	NM		0.40				ND	1.60	NM			0.20	0.20		0.80	0.10	ND
6/27/2018	NM		1.10				ND	1.70	NM			0.20	0.10		0.50	0.20	ND
6/29/2018	NM		0.80				ND	1.40	NM			0.10	0.10		0.50	0.30	ND
7/2/2018	NM		0.70				ND	1.80	NM			0.10	0.10		0.50	0.20	ND
7/5/2018	NM		0.50				ND	2.10	NM			0.20	0.10		0.50	0.30	ND
7/9/2018	NM		0.10				ND	2.00	NM			0.30	0.20		0.60	0.20	ND
7/11/2018	NM		0.30				ND	0.80	NM			0.30	0.30		0.50	0.80	ND
7/13/2018	NM		0.80				ND	0.80	NM			0.30	0.50		0.80	0.30	ND
7/16/2018	NM		1.00				ND	1.50	NM			0.80	1.00		0.30	0.50	ND
7/18/2018	NM		1.50				ND	1.00	NM			0.30	0.50		0.30	0.20	ND
7/20/2018	NM		1.00				ND	0.80	NM			0.50	0.30		0.50	0.20	ND
7/23/2018	NM		1.30				ND	1.30	NM			0.30	0.10		0.30	0.30	ND
7/25/2018	NM		0.80				ND	0.80	NM			0.10	0.50		0.30	0.30	0.10
7/27/2018	NM		0.50				ND	0.80	NM			0.10	0.10		0.30	0.10	0.10
7/30/2018	NM		0.80				ND	1.00	NM			0.10	0.10		0.30	0.10	0.10
8/1/2018	NM		NM				ND	1.00	NM			0.30	0.10		NM	0.10	0.10
8/3/2018	NM		0.50				ND	1.50	NM			0.30	0.10		0.30	0.30	ND
8/6/2018	NM		0.80				ND	0.80	NM			0.30	0.50		0.50	0.10	ND
8/8/2018	NM		1.00				ND	1.00	NM			0.30	0.30		0.50	0.10	ND
8/10/2018	NM		0.30				ND	0.70	NM			0.30	ND		0.30	0.20	ND
8/13/2018	NM		0.40				ND	0.70	NM			0.30	0.00		0.30	0.20	ND
8/15/2018	NM		0.50				ND	0.80	NM			0.40	0.20		0.50	0.20	ND
8/17/2018	NM		0.40				ND	0.70	NM			0.20	ND		0.40	0.50	ND
8/20/2018	NM		0.40				ND	1.00	NM			0.30	ND		0.30	0.10	ND
8/22/2018	NM		0.40				ND	0.70	NM			0.20	ND		0.30	0.10	ND
8/24/2018	NM		0.60				ND	0.90	NM			0.30	0.20		0.40	0.40	ND
8/27/2018	NM		0.40				ND	0.90	NM			0.20	ND		0.40	0.20	ND
8/29/2018	NM		0.50				ND	0.80	NM			0.10	0.20		0.10	0.20	ND
8/31/2018	NM		0.50				ND	0.90	NM			0.10	0.20		0.10	0.10	ND
9/5/2018	NM		0.50				ND	2.00	NM			0.10	0.10		NM	0.30	0.10
9/7/2018	NM		0.50				ND	0.50	NM			0.10	0.10		0.30	0.10	0.10
9/10/2018	NM		0.30				ND	0.50	NM			0.10	0.10		0.30	0.30	ND
9/12/2018	NM		0.30				ND	0.50	NM			0.10	0.10		1.00	0.30	ND
9/14/2018	NM		0.10				ND	0.30	NM			0.10	0.10		0.50	0.80	ND
9/17/2018	NM		0.10				ND	0.50	NM			0.30	0.10		0.30	0.10	ND
9/19/2018	NM		0.10				ND	0.30	NM			0.30	0.10		0.50	0.10	ND
9/21/2018	NM		0.30				ND	0.50	NM			0.30	0.10		0.30	0.10	ND
9/24/2018	NM		0.10				ND	0.30	NM			0.30	0.10		0.50	0.10	ND
9/26/2018	NM		0.30				ND	0.80	NM			0.30	0.10		1.00	0.10	ND
9/28/2018	NM		0.50				ND	0.50	NM			0.30	0.10		0.50	0.10	ND
10/1/2018	NM		0.10				ND	0.80	NM			0.10	0.10		0.80	0.30	ND
10/3/2018	NM		0.10				ND	0.50	NM			0.10	0.10		0.30	0.10	ND
10/5/2018	NM		0.10				ND	0.50	NM			0.10	0.10		0.30	0.30	ND
10/8/2018	NM		0.10				ND	0.50	NM			0.10	0.10		0.30	0.10	ND
10/10/2018	NM		0.10				ND	0.50	NM			0.10	0.10		0.30	0.10	0.10
10/12/2018	NM		0.30				ND	1.00	NM			0.10	0.08		1.00	0.10	ND
10/15/2018	NM		0.30				ND	0.80	NM			0.10	0.10		0.50	0.30	0.04
10/17/2018	NM		0.10				ND	0.50	NM			0.07	NM		0.40	0.30	ND
10/19/2018	NM		NM				ND	0.50	NM			0.04	0.10		0.50	0.30	ND
10/22/2018	NM		0.10				ND	0.80	NM			0.10	0.10		0.80	0.04	ND
10/24/2018	NM		0.30				ND	0.80	NM			0.04	0.10		0.50	0.02	ND
10/26/2018	NM		0.30				ND	1.00	NM			0.10	0.10		0.30	0.10	ND
10/29/2018	NM		0.30				ND	0.50	NM			0.20	0.10		0.80	0.30	ND
10/31/2018	NM		0.30				ND	0.80	NM			0.10	0.10		1.00	0.10	ND
11/2/2018	NM		0.20				ND	1.00	NM			0.10	0.01		0.50	0.10	ND
11/5/2018	NM		0.20				ND	0.80	NM			0.10	0.10		1.00	0.20	ND
11/7/2018	NM		0.10				ND	0.50	NM			0.10	0.20		0.80	0.30	0.01
11/9/2018	NM		0.10				ND	0.50	NM			0.20	0.20				

Table 1
Summary of DNAPL Gauging
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13
Date	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet
11/12/2018	NM		NM				ND	0.80	NM			0.10	0.10		1.00	0.10	ND
11/14/2018	NM		0.20				ND	0.80	NM			0.10	0.10		0.50	0.20	ND
11/19/2018	NM		0.04				ND	0.80	NM			0.10	0.30		0.50	0.30	ND
11/21/2018	NM		0.10				ND	0.80	NM			0.10	0.10		0.80	0.20	ND
11/26/2018	NM		0.10				ND	1.00	NM			0.10	0.20		1.20	0.30	ND
11/28/2018	NM		0.10				ND	0.50	NM			0.20	0.10		0.80	0.20	ND
12/3/2018	NM		0.10				ND	1.00	NM			0.10	0.04		1.00	0.10	ND
12/5/2018	NM		0.20				ND	0.80	NM			0.10	0.10		0.80	0.20	ND
12/7/2018	NM		0.04				ND	0.50	NM			0.04	0.10		0.80	0.20	ND
12/10/2018	NM		0.10				ND	0.80	NM			0.10	0.04		0.80	0.10	ND
12/12/2018	NM		0.20				ND	0.50	NM			0.10	0.04		0.50	0.20	ND
12/14/2018	NM		0.10				ND	0.80	NM			0.20	0.10		0.80	0.30	ND
12/17/2018	NM		0.20				ND	0.70	NM			0.30	0.10		0.80	0.30	ND
12/19/2018	NM		0.10				ND	0.70	NM			0.10	0.10		0.60	0.30	ND
12/21/2018	NM		0.10				ND	0.60	NM			0.10	0.10		0.50	0.40	ND
12/26/2018	NM		0.30				ND	1.00	NM			0.10	0.20		1.00	0.30	ND
12/28/2018	NM		0.10				ND	0.60	NM			0.20	0.10		0.60	0.30	ND
1/2/2019	NM		0.10				ND	1.00	NM			0.20	0.20		2.00	0.20	ND
1/4/2019	NM		0.10				ND	0.70	NM			0.30	0.04		1.20	0.30	ND
1/7/2019	NM		0.20				ND	0.50	NM			0.10	0.20		1.00	0.20	ND
1/9/2019	NM		0.02				ND	0.50	NM			0.08	0.10		1.00	0.08	ND
1/11/2019	NM		0.02				ND	0.30	NM			0.08	0.10		1.00	0.08	ND
1/14/2019	NM		0.02				ND	0.80	NM			0.10	0.10		1.00	0.08	ND
1/16/2019	NM		0.10				ND	0.50	NM			0.08	0.08		1.00	0.13	ND
1/18/2019	NM		0.10				ND	0.30	NM			0.08	0.04		1.00	0.10	ND
1/21/2019	NM		0.08				ND	0.50	NM			0.08	0.08		0.60	0.08	ND
1/23/2019	NM		0.08				ND	0.50	NM			0.10	0.08		1.00	0.04	ND
1/25/2019	NM		0.08				ND	0.30	NM			0.08	0.08		0.30	0.10	ND
1/28/2019	NM		0.08				ND	0.80	NM			0.08	0.10		1.00	0.10	ND
1/30/2019	NM		0.08				ND	0.50	NM			0.10	0.08		0.80	0.10	ND
2/1/2019	NM		NM				ND	0.80	NM			0.10	0.08		1.00	0.20	ND
2/4/2019	NM		0.30				ND	1.00	NM			0.20	0.08		1.00	0.10	ND
2/6/2019	NM		0.20				ND	0.80	NM			0.10	0.04		1.00	0.20	ND
2/8/2019	NM		0.10				ND	0.50	NM			0.10	0.10		0.80	0.20	ND
2/11/2019	NM		0.10				ND	1.00	NM			0.20	0.20		1.20	0.30	ND
2/13/2019	NM		0.10				ND	0.50	NM			0.08	0.08		0.80	0.10	ND
2/15/2019	NM		0.08				ND	0.50	NM			0.10	0.10		1.00	0.20	ND
2/18/2019	NM		0.10				ND	0.80	NM			0.20	0.10		1.00	0.20	ND
2/20/2019	NM		0.10				ND	0.50	NM			0.10	0.10		0.80	0.10	ND
2/22/2019	NM		0.20				ND	0.80	NM			0.10	0.10		0.80	0.20	ND
2/25/2019	NM		0.20				ND	1.00	NM			0.20	0.10		1.00	0.20	ND
2/27/2019	NM		0.10				ND	0.60	NM			0.10	0.10		0.80	0.20	ND
3/1/2019	NM		0.10				ND	1.00	NM			0.10	0.10		0.80	0.10	ND
3/4/2019	NM		0.10				ND	1.00	NM			0.20	0.10		1.00	0.20	ND
3/6/2019	NM		0.10				ND	1.00	NM			0.10	0.10		1.00	0.30	ND
3/8/2019	NM		0.10				ND	1.00	NM			0.20	0.08		1.00	0.10	ND
3/11/2019	NM		0.10				ND	1.00	NM			0.10	0.10		0.80	0.08	ND
3/13/2019	NM		0.10				ND	1.00	NM			0.20	0.10		1.00	0.08	ND
3/15/2019	NM		0.10				ND	0.90	NM			0.10	0.10		0.90	0.10	ND
3/18/2019	NM		0.10				ND	1.00	NM			0.20	0.10		1.00	0.10	ND
3/20/2019	NM		0.10				ND	0.60	NM			0.10	0.10		0.80	0.10	ND
3/22/2019	NM		0.10				ND	0.50	NM			0.10	0.10		0.80	0.08	ND
3/25/2019	NM		0.10				ND	1.00	NM			0.20	0.10		1.00	0.08	ND
3/27/2019	NM		0.10				ND	1.00	NM			0.10	0.10		0.50	0.08	ND
3/29/2019	NM		0.10				ND	1.00	NM			0.10	0.10		0.80	0.08	ND
4/1/2019	NM		0.10				ND	1.00	NM			0.20	0.10		0.50	0.10	ND
4/3/2019	NM		0.10				ND	0.50	NM			0.10	0.10		0.80	0.10	ND
4/5/2019	NM		0.10				ND	1.00	NM			0.10	0.20		0.80	0.10	ND
4/8/2019	NM		0.10				ND	0.80	NM			0.20	0.10		1.00	0.20	ND
4/10/2019	NM		0.10				ND	1.00	NM			0.10	0.10		0.80	0.20	ND
4/12/2019	NM		0.10				ND	1.60	NM			0.20	0.10		1.00	0.20	ND
4/15/2019	NM		0.20				ND	1.80	NM			0.20	0.20		1.10	0.20	ND
4/17/2019	NM		0.20				ND	1.40	NM			0.10	0.10		1.00	0.20	ND
4/19/2019	NM		0.20				ND	1.40	NM			0.20	0.10		1.20	0.20	ND
4/22/2019	NM		0.10				ND	1.30	NM			0.10	0.20		1.10	0.20	ND
4/24/2019	NM		0.10				ND	1.40	NM			0.10	0.20		1.10	0.10	ND
4/26/2019	NM		0.10				ND	1.30	NM			0.10	0.10		0.80	0.10	ND
4/29/2019	NM		0.10				ND	1.30	NM			0.10	0.10		0.80	0.10	ND
5/1/2019	NM		0.10				ND	0.80	NM			0.20	0.20		0.50	0.08	ND
5/3/2019	NM		0.10				ND	1.00	NM			0.10	0.20		0.50	0.10	ND
5/6/2019	NM		0.10				ND	0.50	NM			0.10	0.08		0.40	0.10	ND
5/8/2019	NM		NM				ND	0.60	NM			0.10	0.10		0.40	0.10	ND
5/10/2019	NM		0.08				ND	NM	NM			NM	0.04		NM	0.04	ND
5/15/2019			ND				ND	0.10	NM			ND	0.08		0.10	0.08	ND
5/22/2019			ND				ND	0.80	NM			ND	0.10		0.40	ND	ND
5/29/2019		0.30	ND				ND	0.50		ND		ND	ND		0.20	0.08	ND
5/31/2019		0.80	ND				ND	1.00		ND		ND	ND		0.10	ND	ND
6/5/2019		0.80	0.30				ND	1.00		ND		ND	ND		1.00	0.10	ND
6/12/2019		0.80	0.10				ND	1.00		ND		ND	ND		0.80	ND	ND
6/17/2019		0.40	ND				ND	1.50		ND		ND	ND		0.50	ND	ND
6/19/2019		0.80	ND				ND	0.50		ND		ND	ND		0.40	ND	ND
Max Thickness	0.10	0.80	6.90	6.80	8.80	0.50	0.00	16.15	6.55	0.00	14.90	2.00	20.20	1.50	11.00	15.10	2.20
Average Thickness	0.10	0.65	1.07	2.19	1.58	0.44	ND	3.32	1.06	ND	1.35	0.53	1.42	0.62	2.33	1.54	0.88
Overall Median Value	0.10	0.80	0.85	1.45	0.50	0.50	ND	3.10	1.00	ND	1.00	0.30	1.00	0.50	1.20	0.50	0.80

Notes:

NC- Not calculated

NM - Not Measured


ND - No Product Detected

Blebs - Blebs were present in the well


Well not operational


NRW-03, -04, -05, -09, and -11 were abandoned and replacement recovery wells NRW-09R and NRW-11R were installed in April 2017.


NRW-01 and NRW-08 were abandoned and replacement recovery wells NRW-01R and NRW-08R were installed in May 2019.

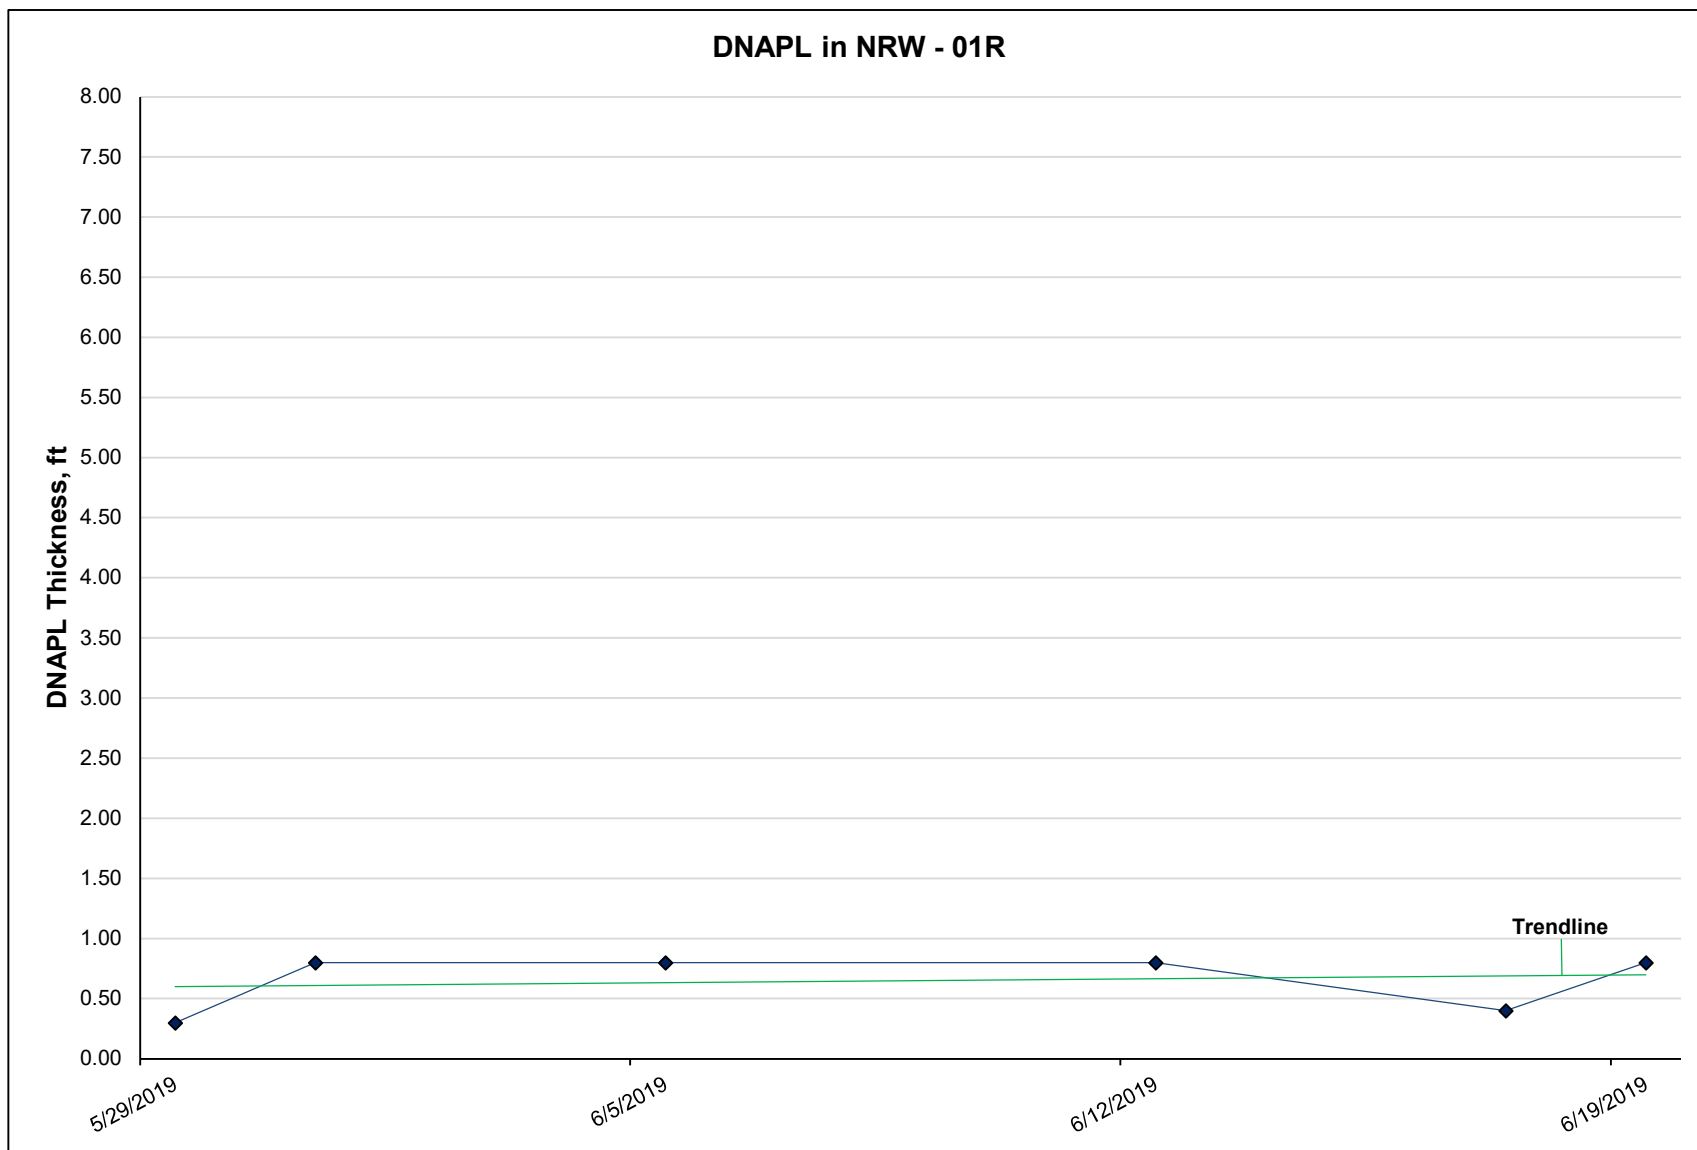


Note: NRW - 01R installed May 21, 2019.

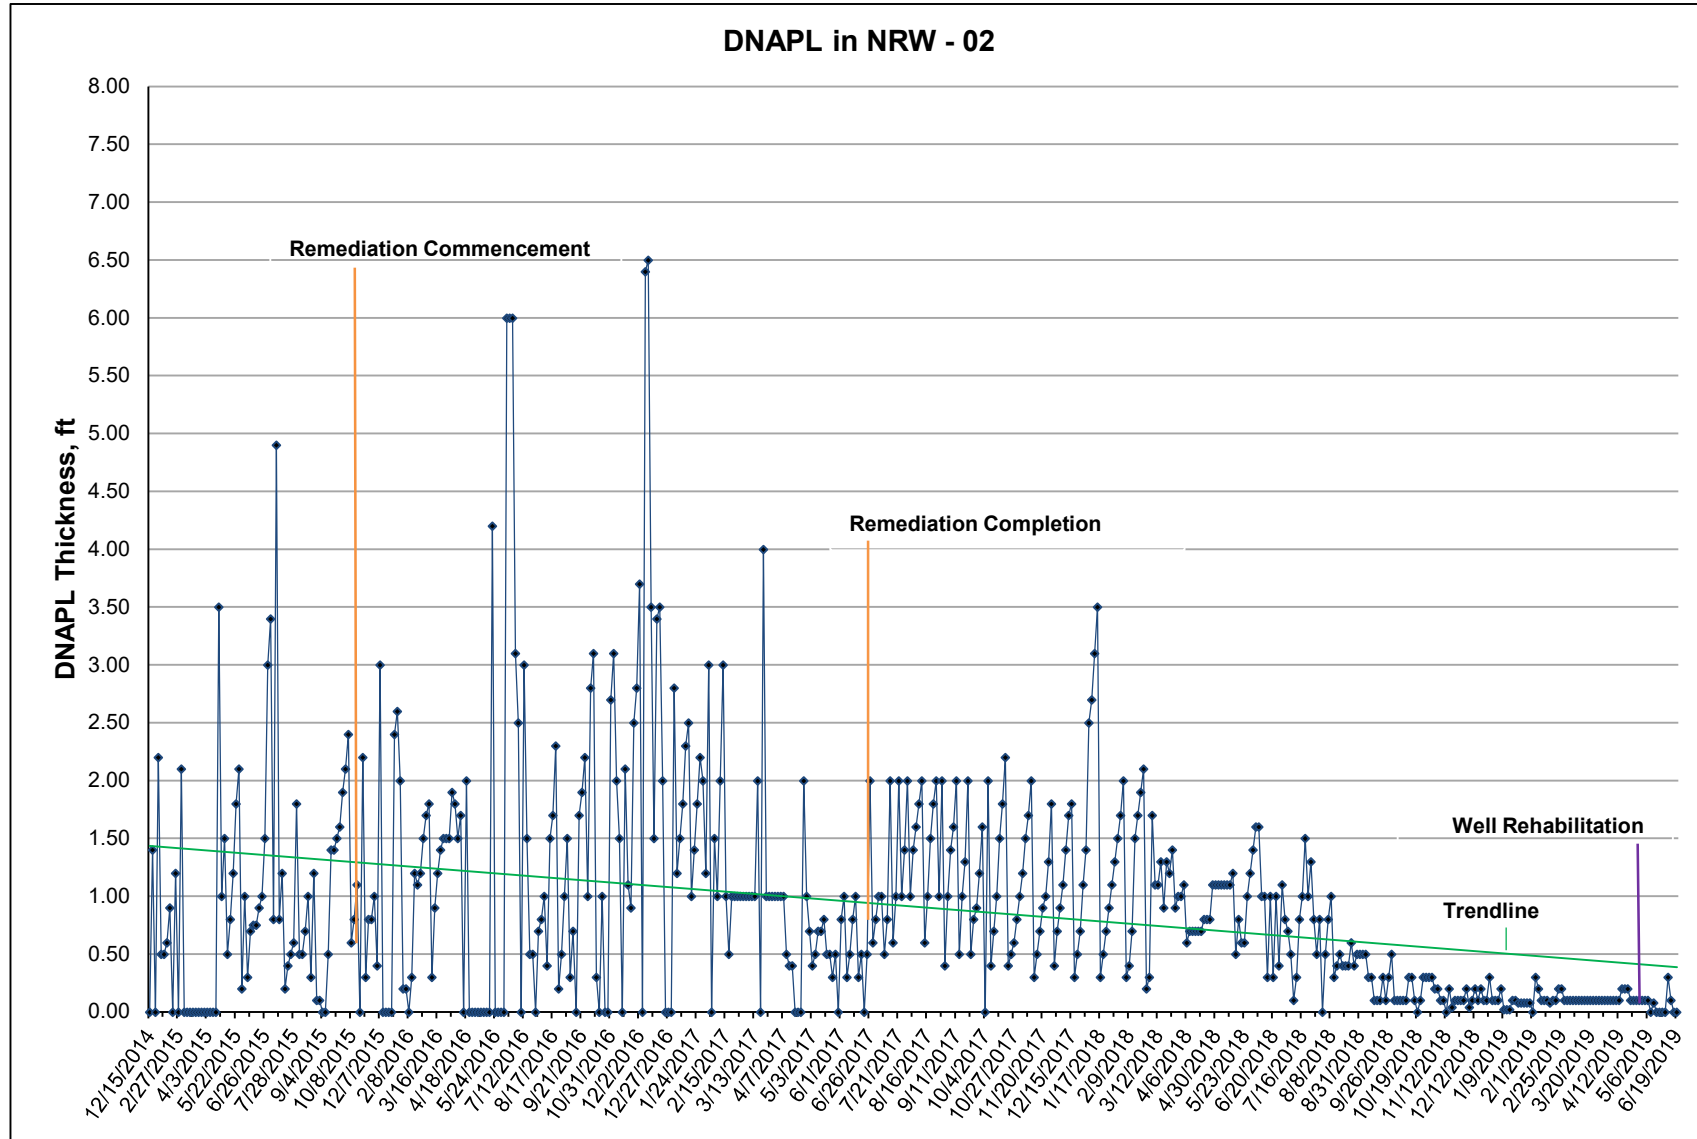

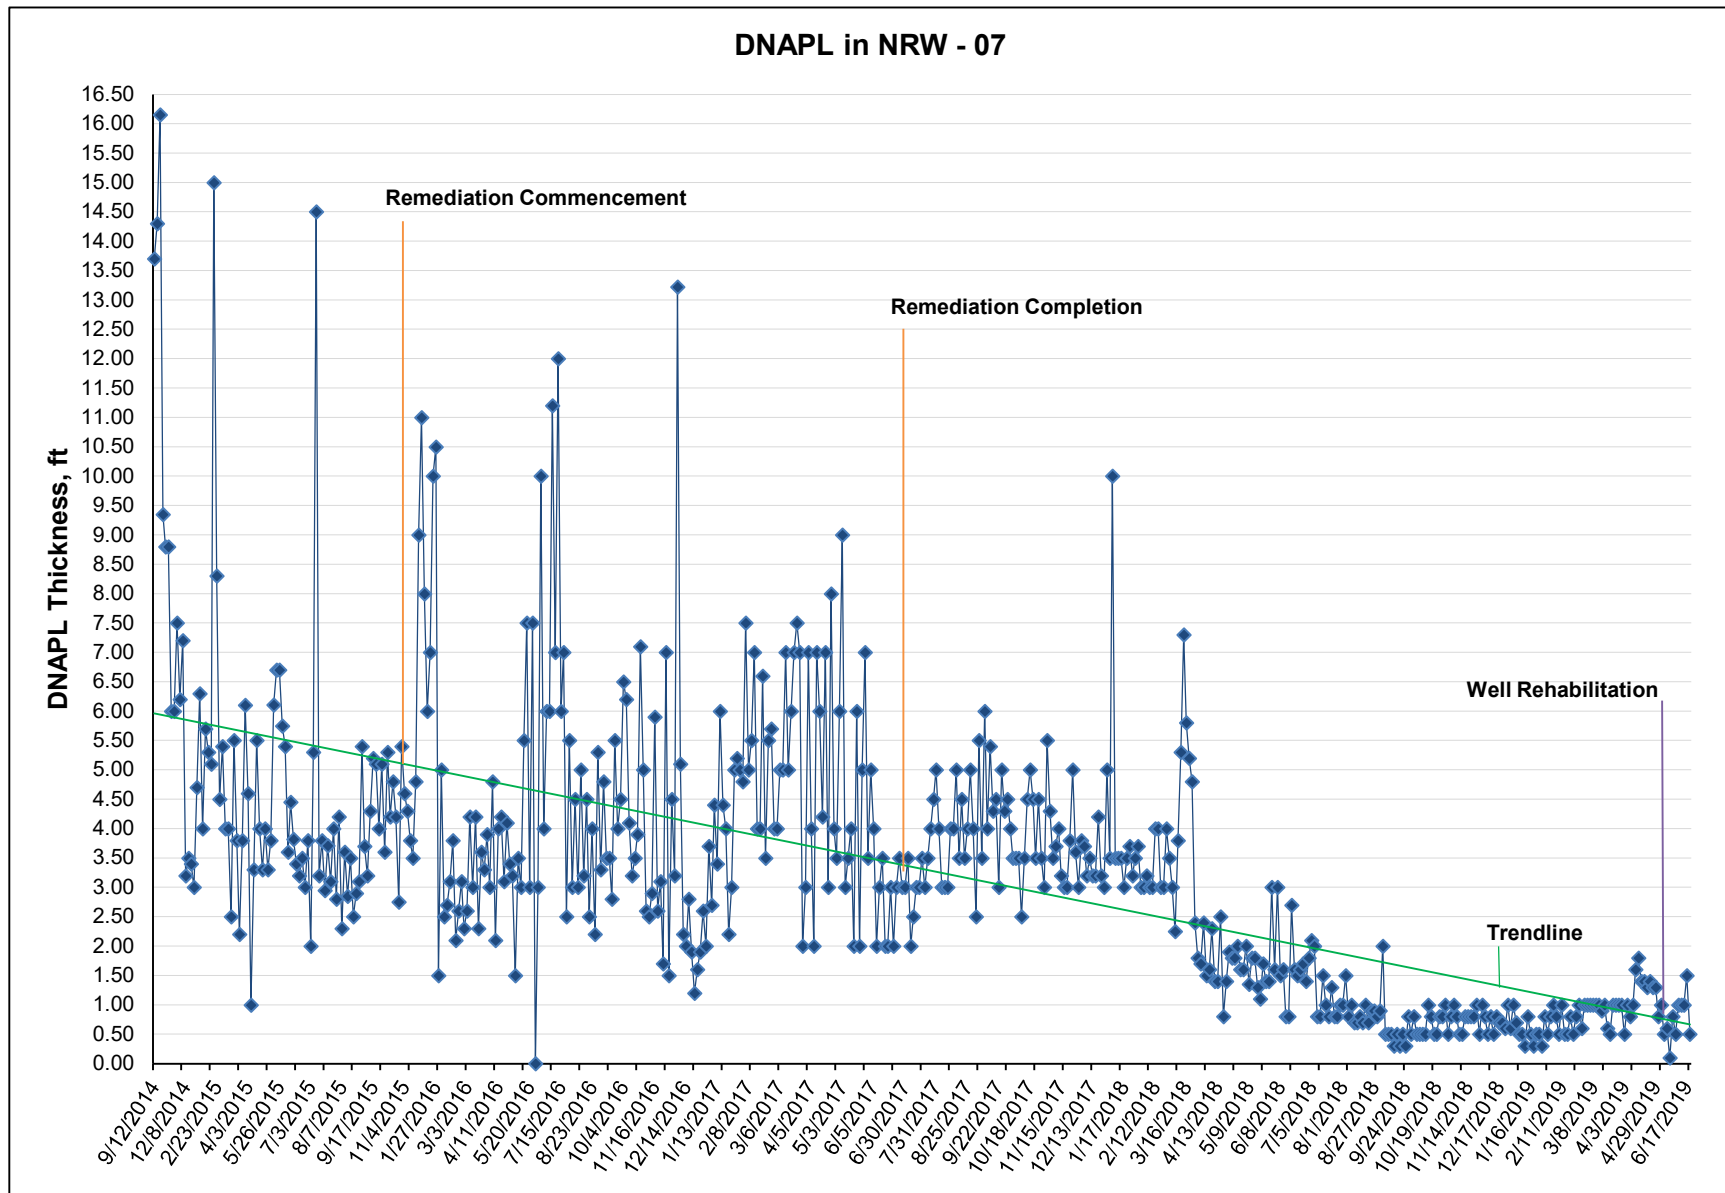


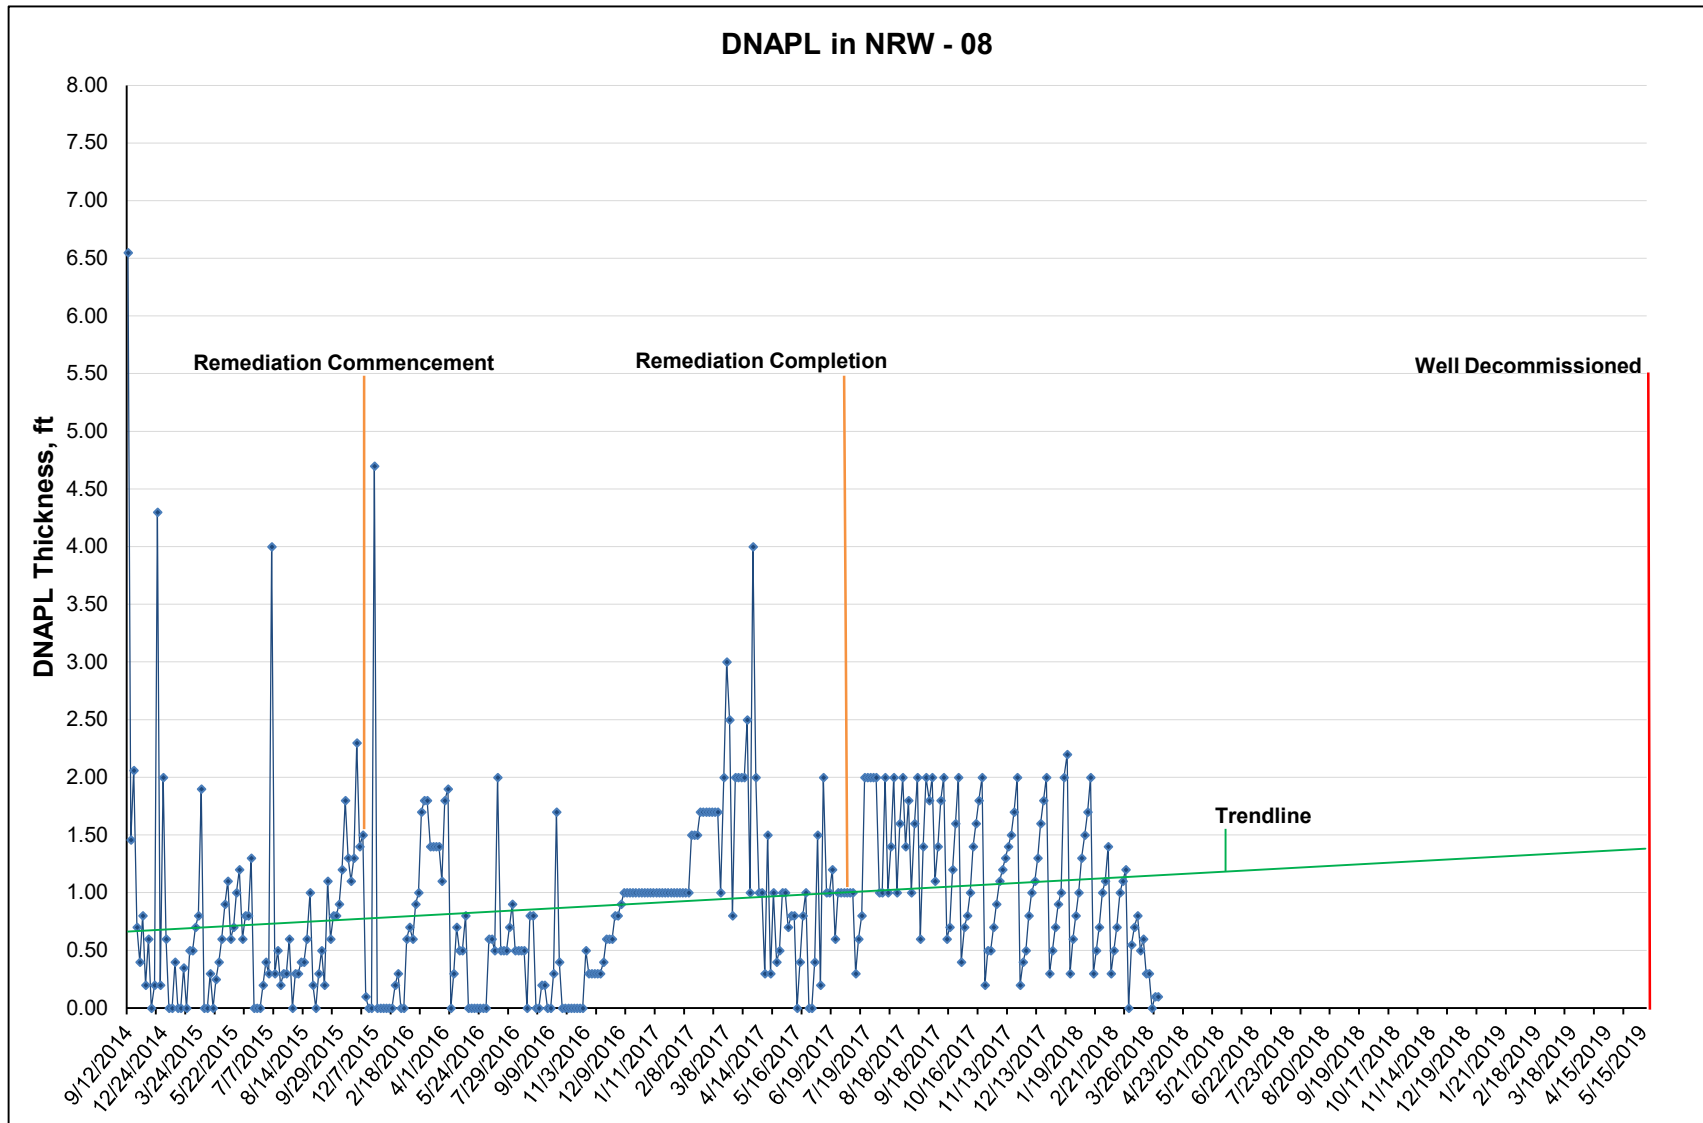


Note: NRW - 08 decommissioned on May 22, 2019 and replaced with NRW - 08R.

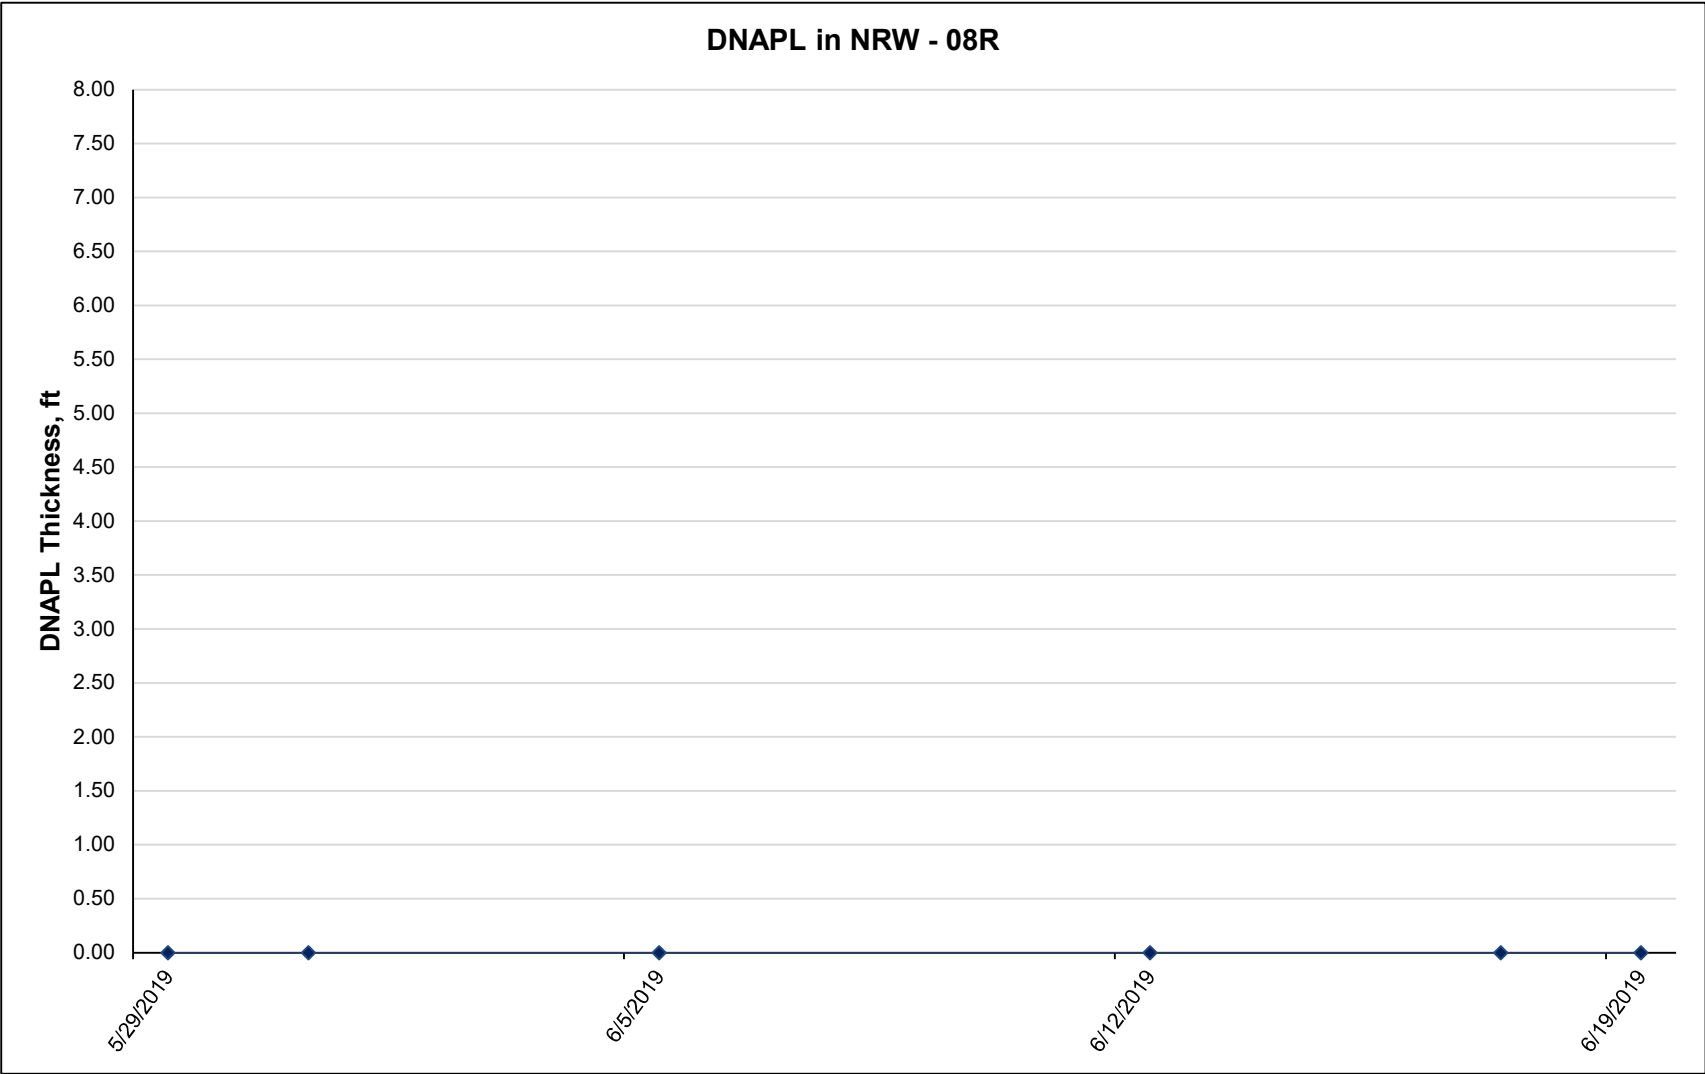


Note: NRW - 08R installed May 24, 2019.

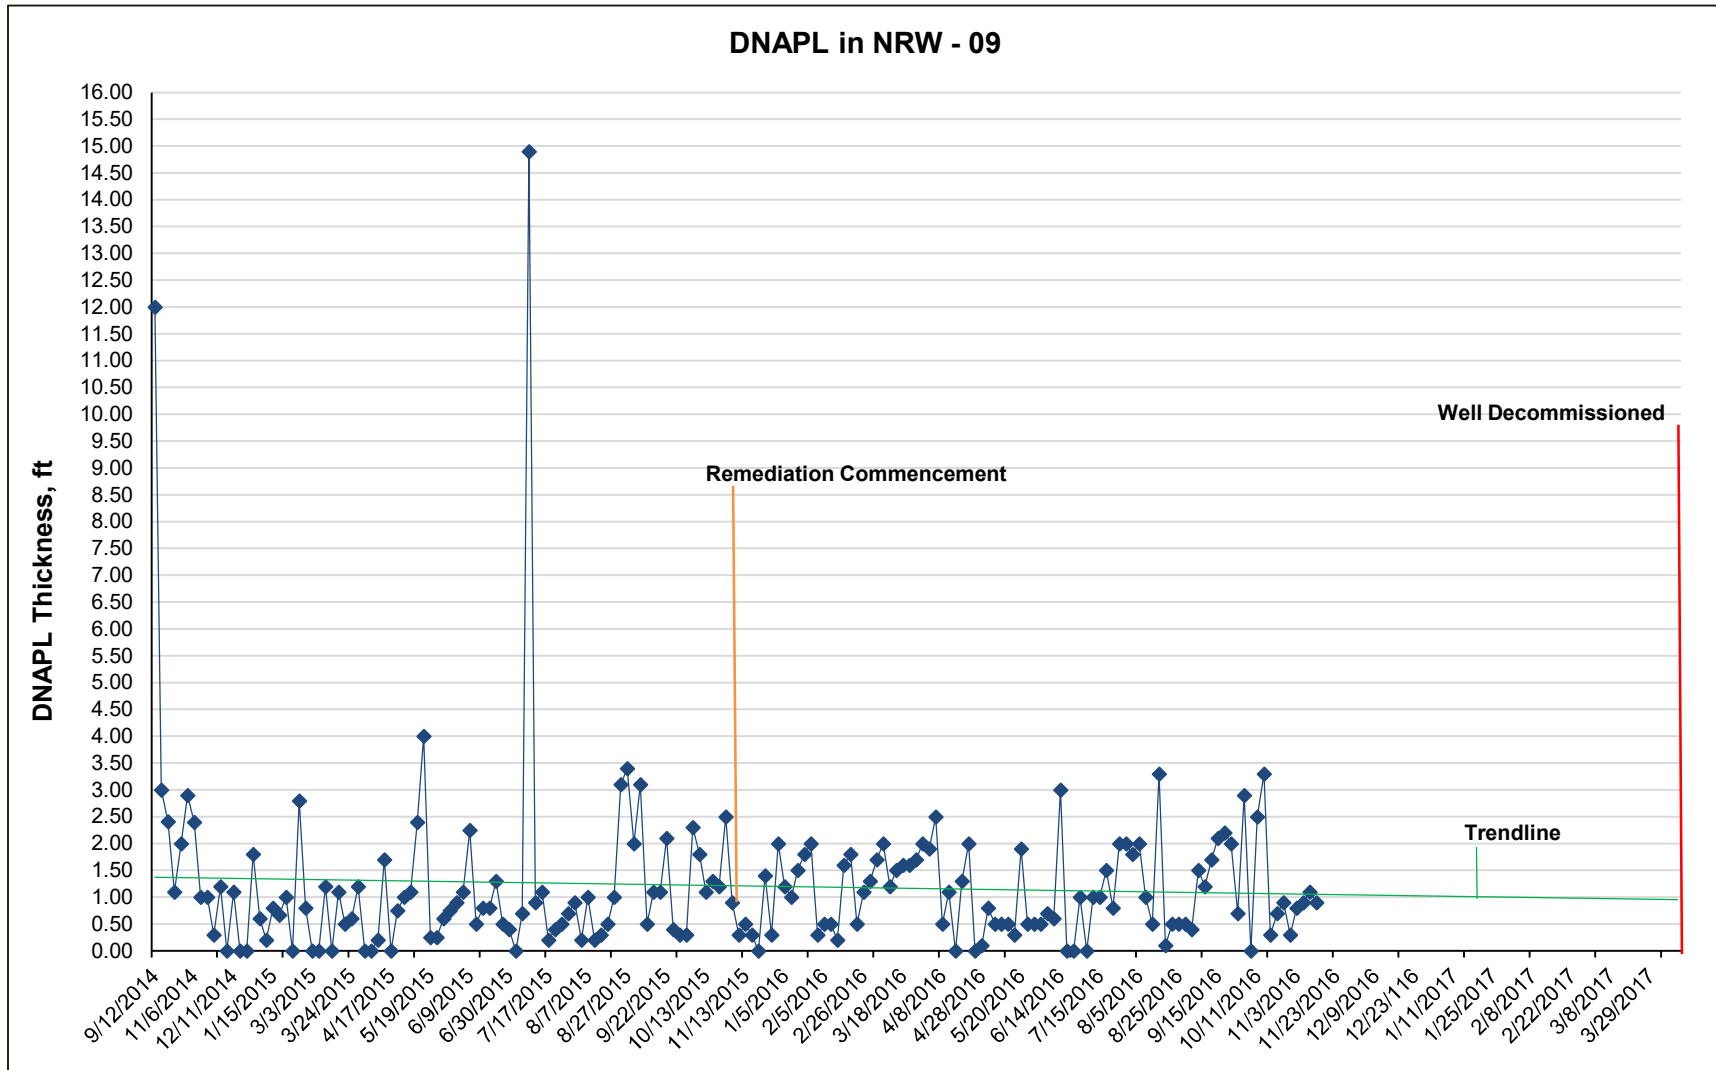


Note: NRW - 09 decommissioned on April 3, 2017 and replaced with NRW - 09R.

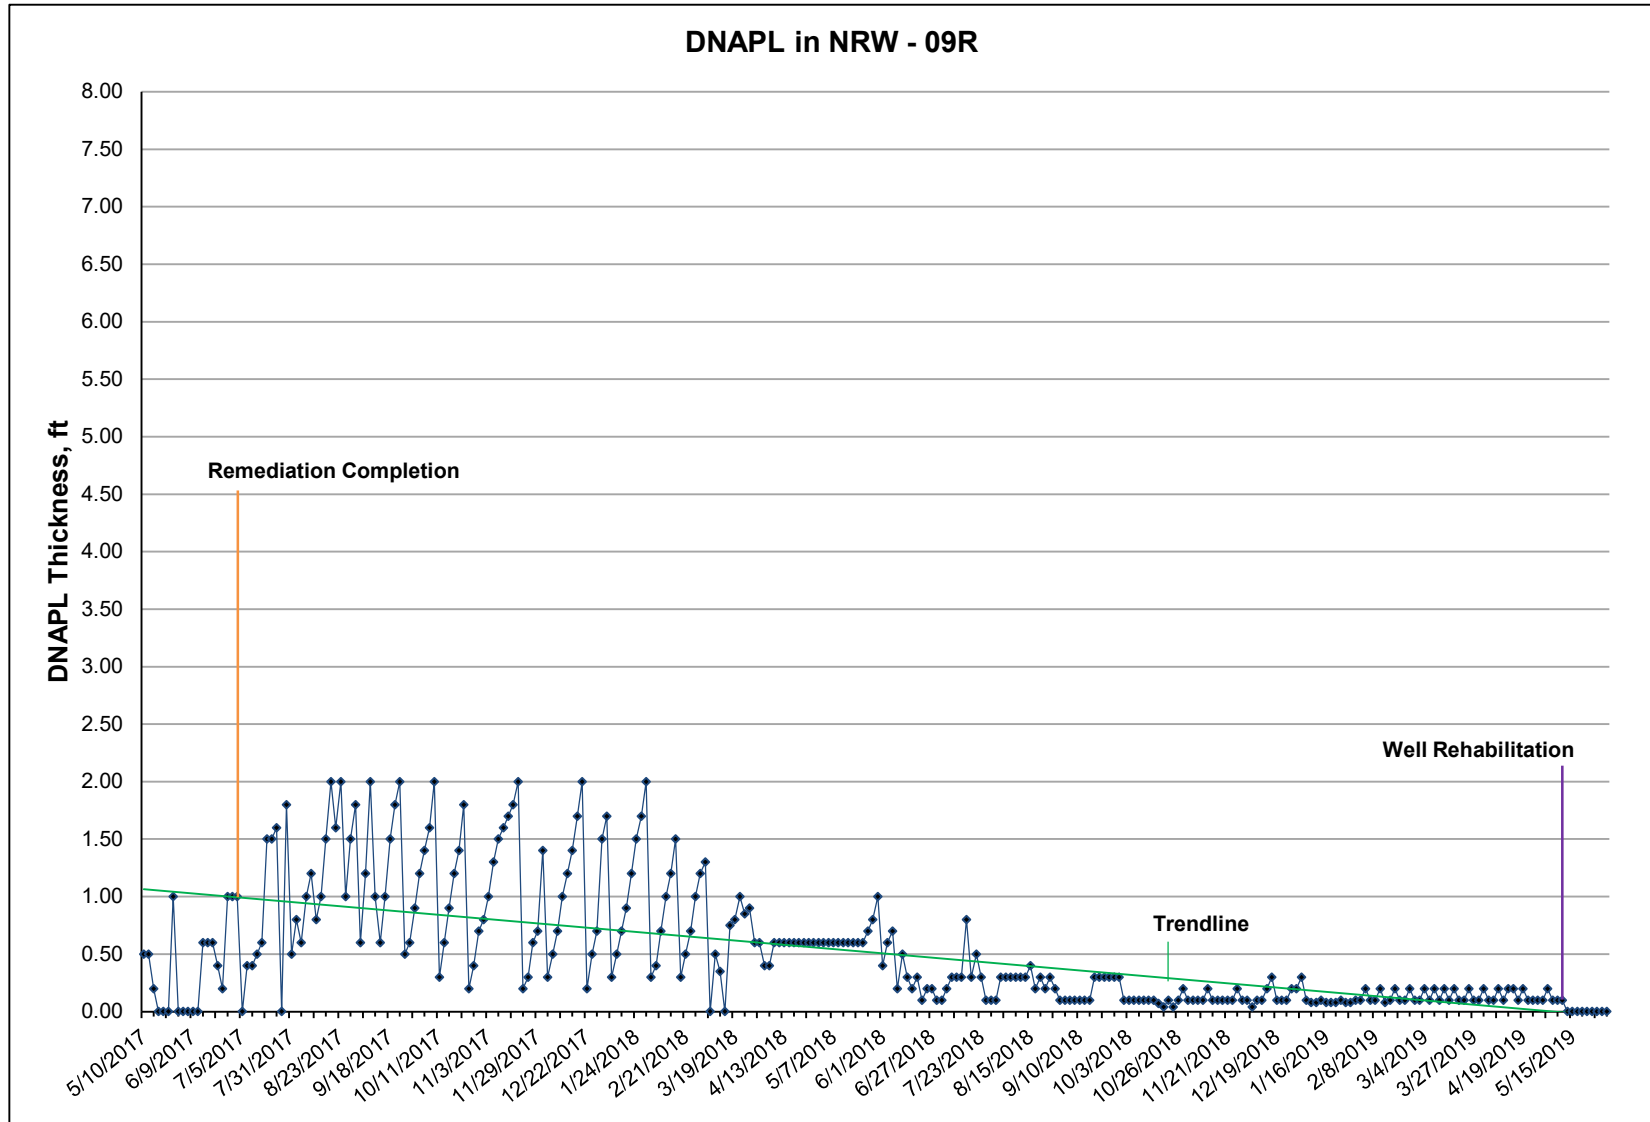


Note: NRW - 09R installed March 27, 2017.

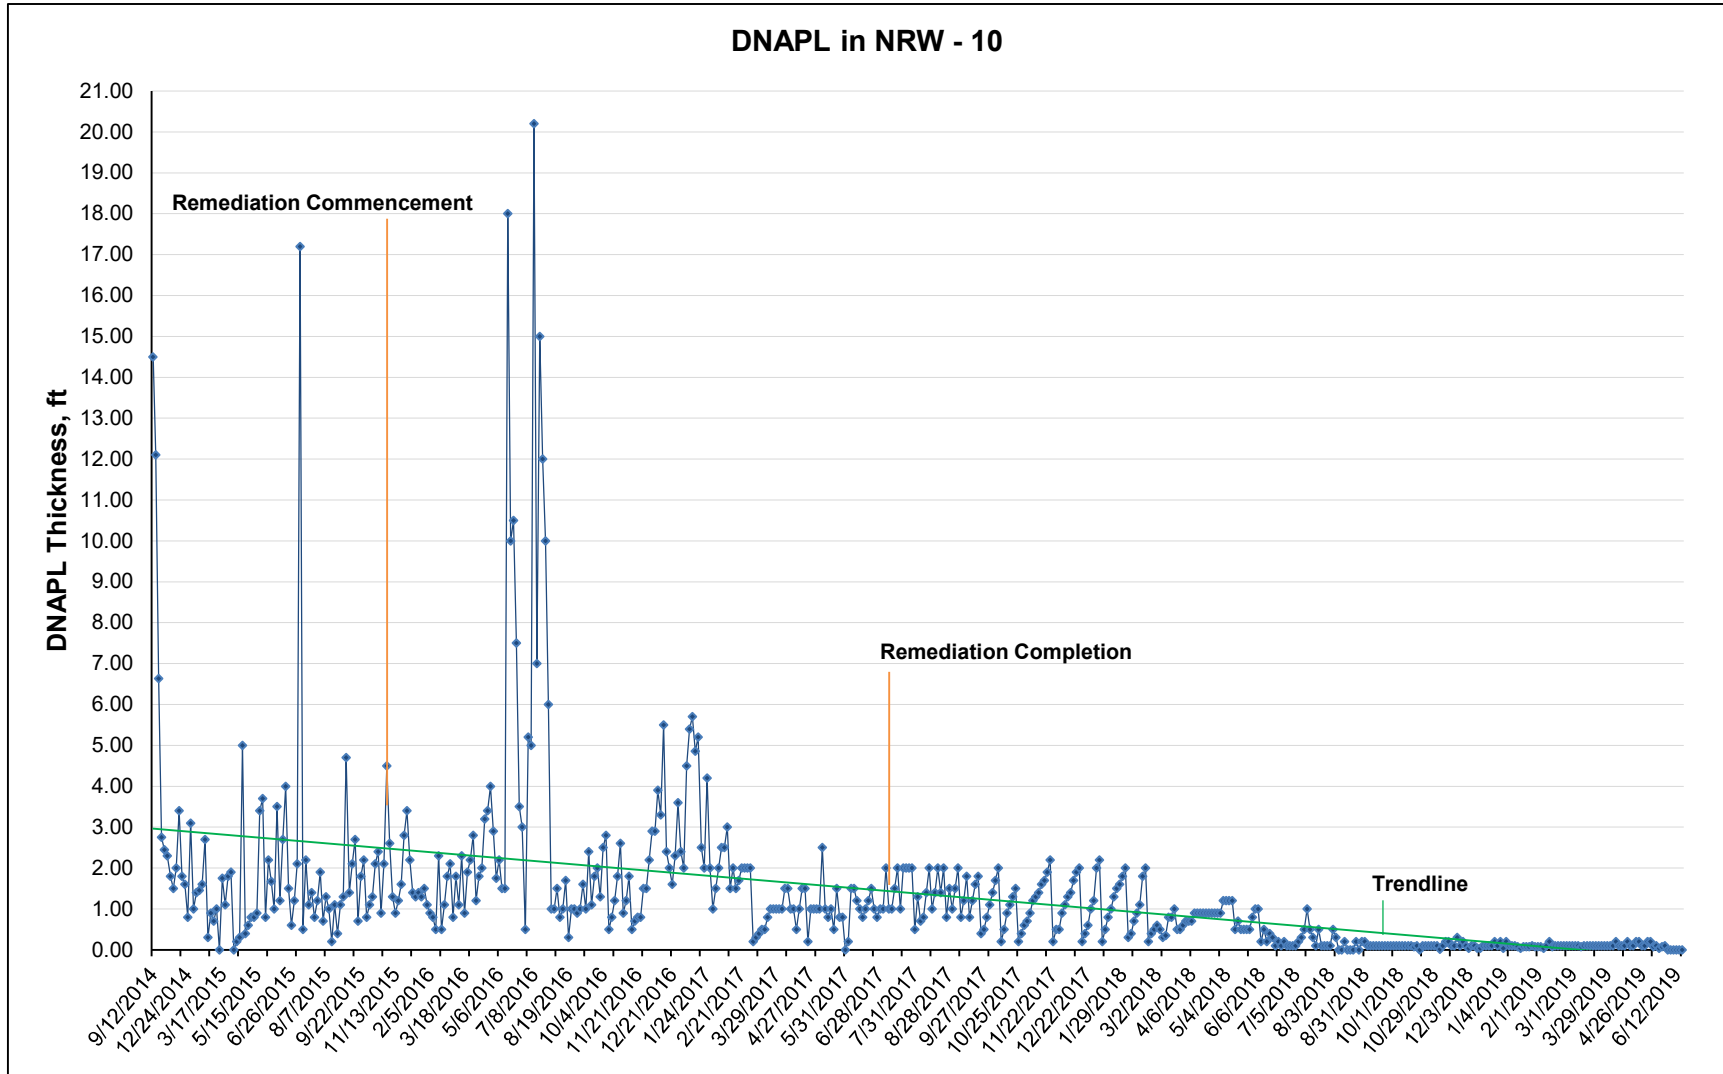


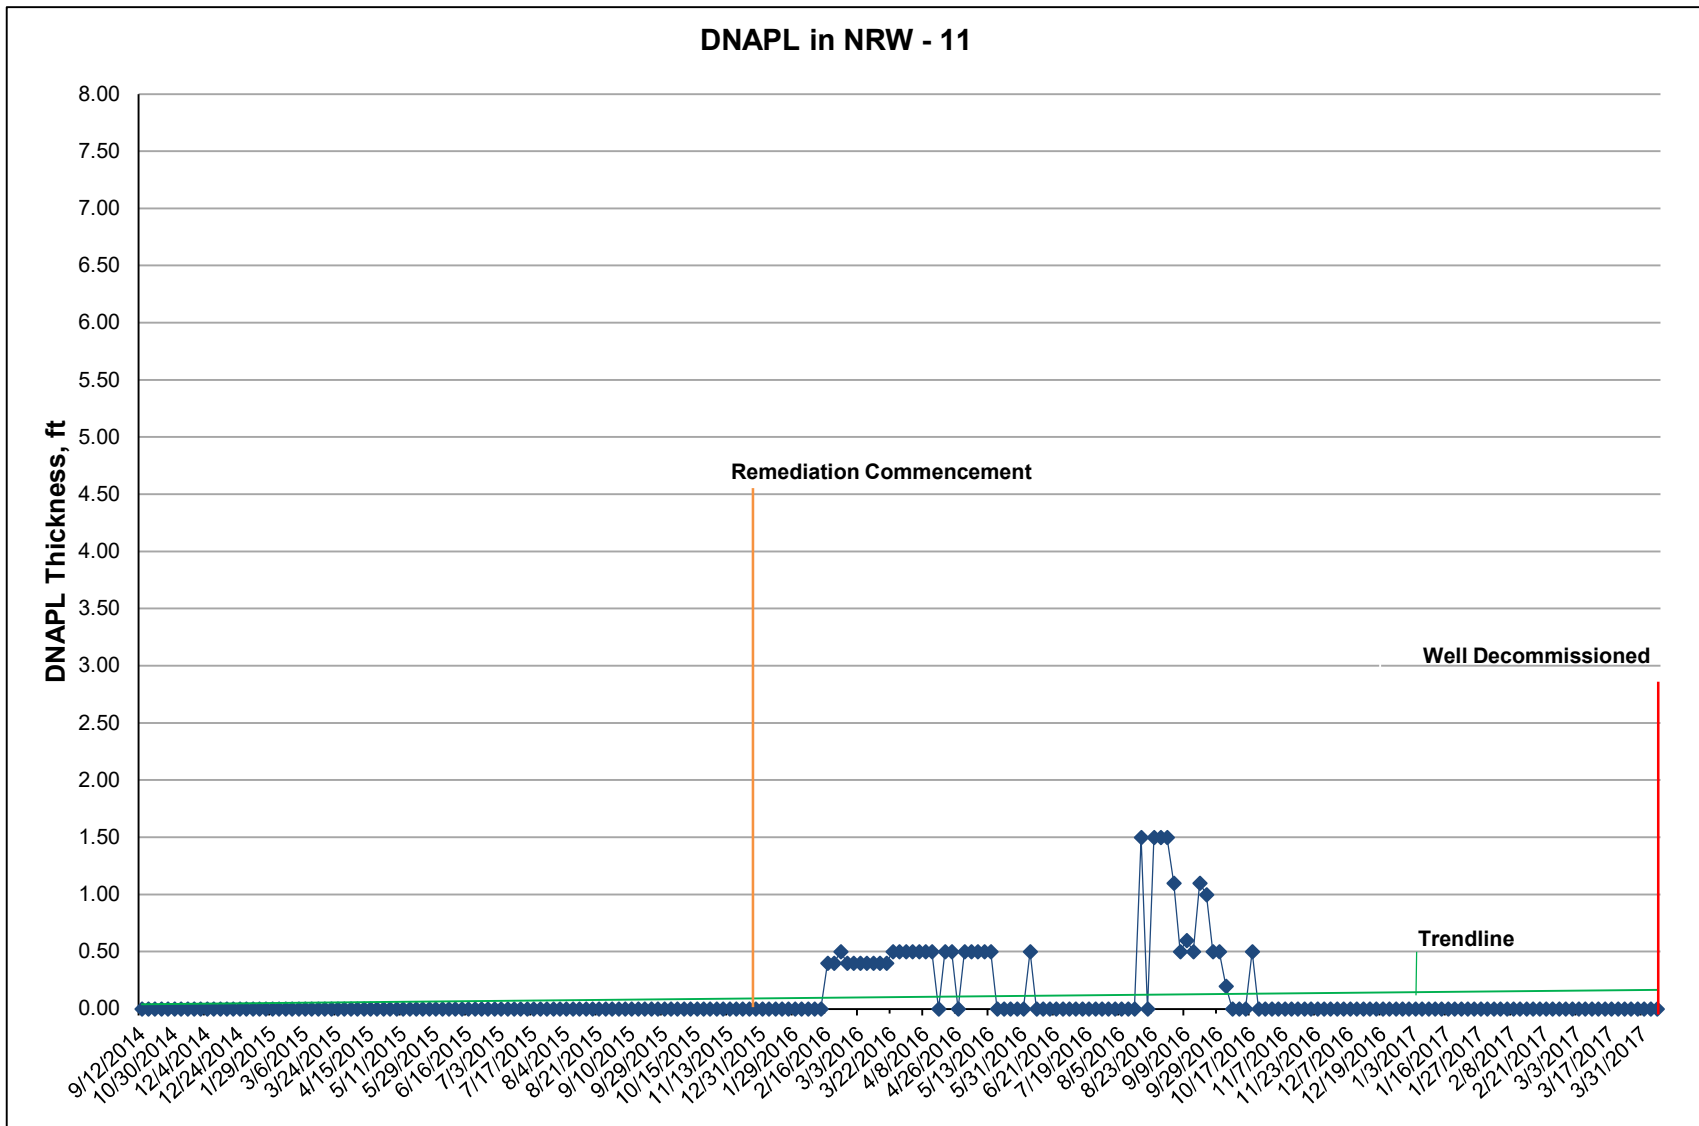

Note: NRW - 11 decommissioned on April 4, 2017 and replaced with NRW-11R.

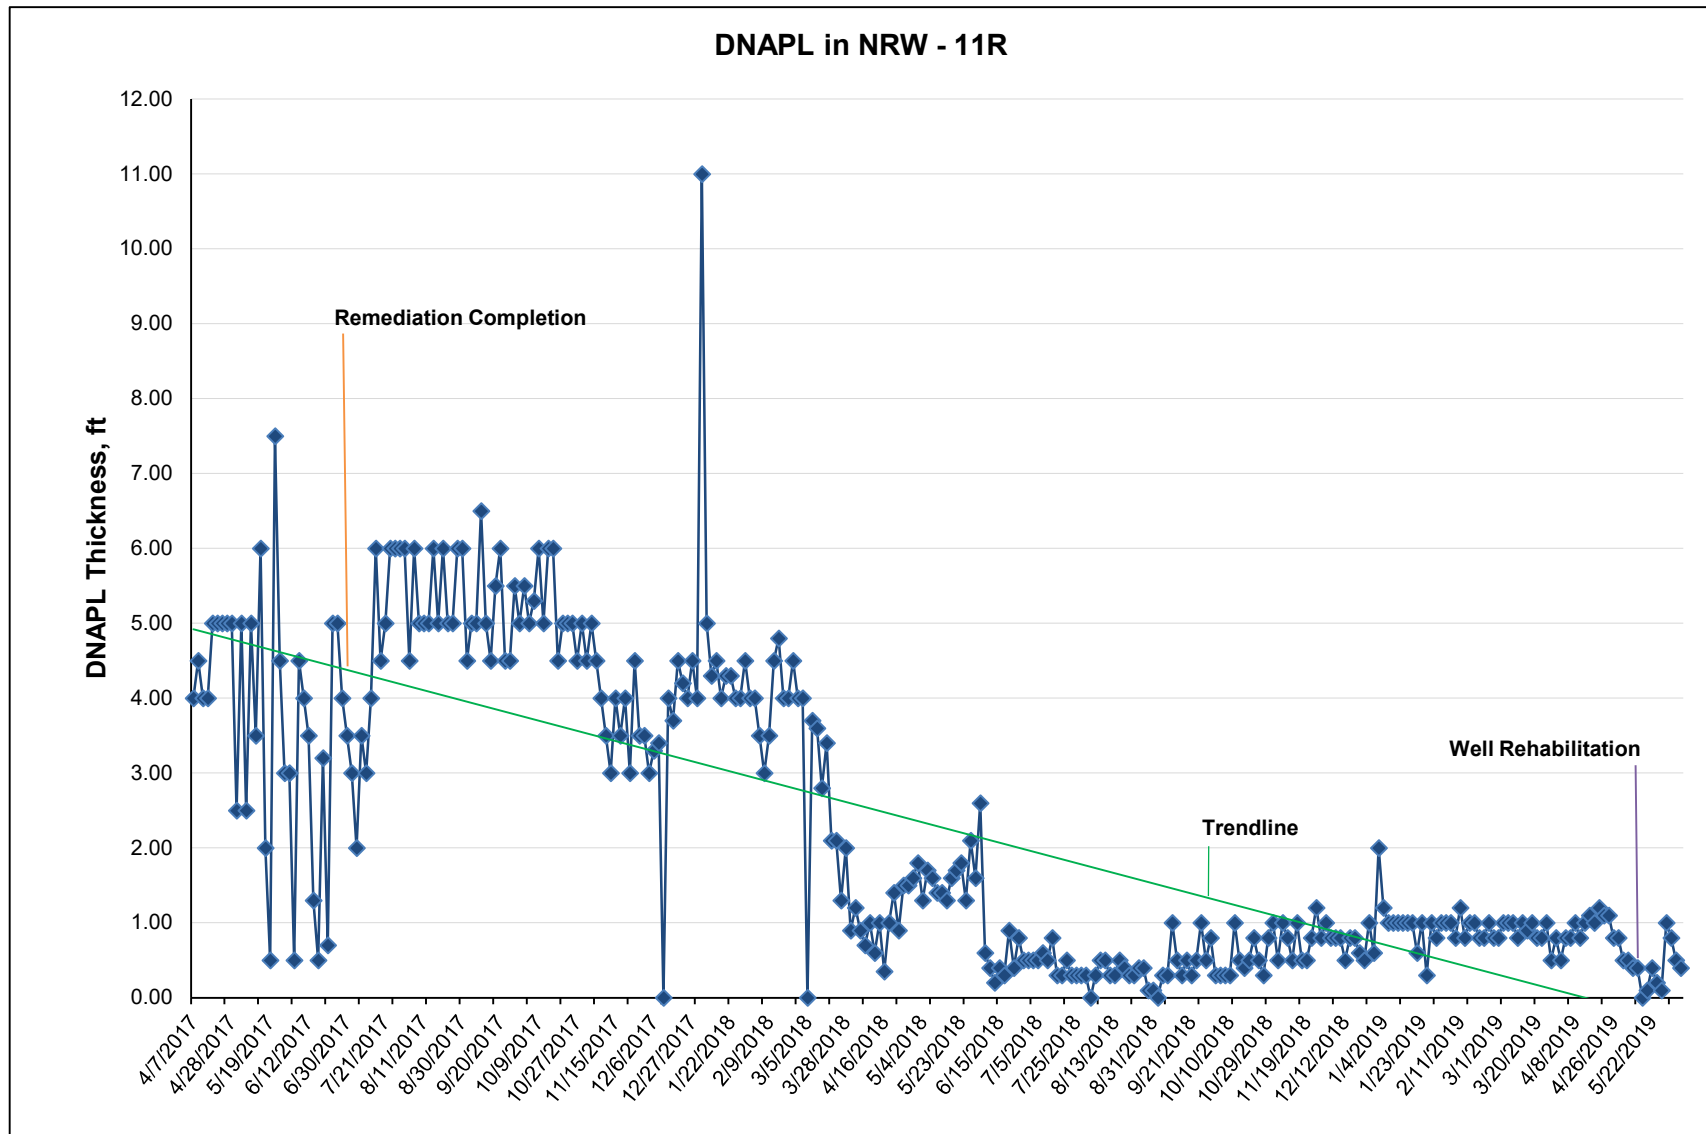

Note: NRW - 11R installed March 23, 2017.

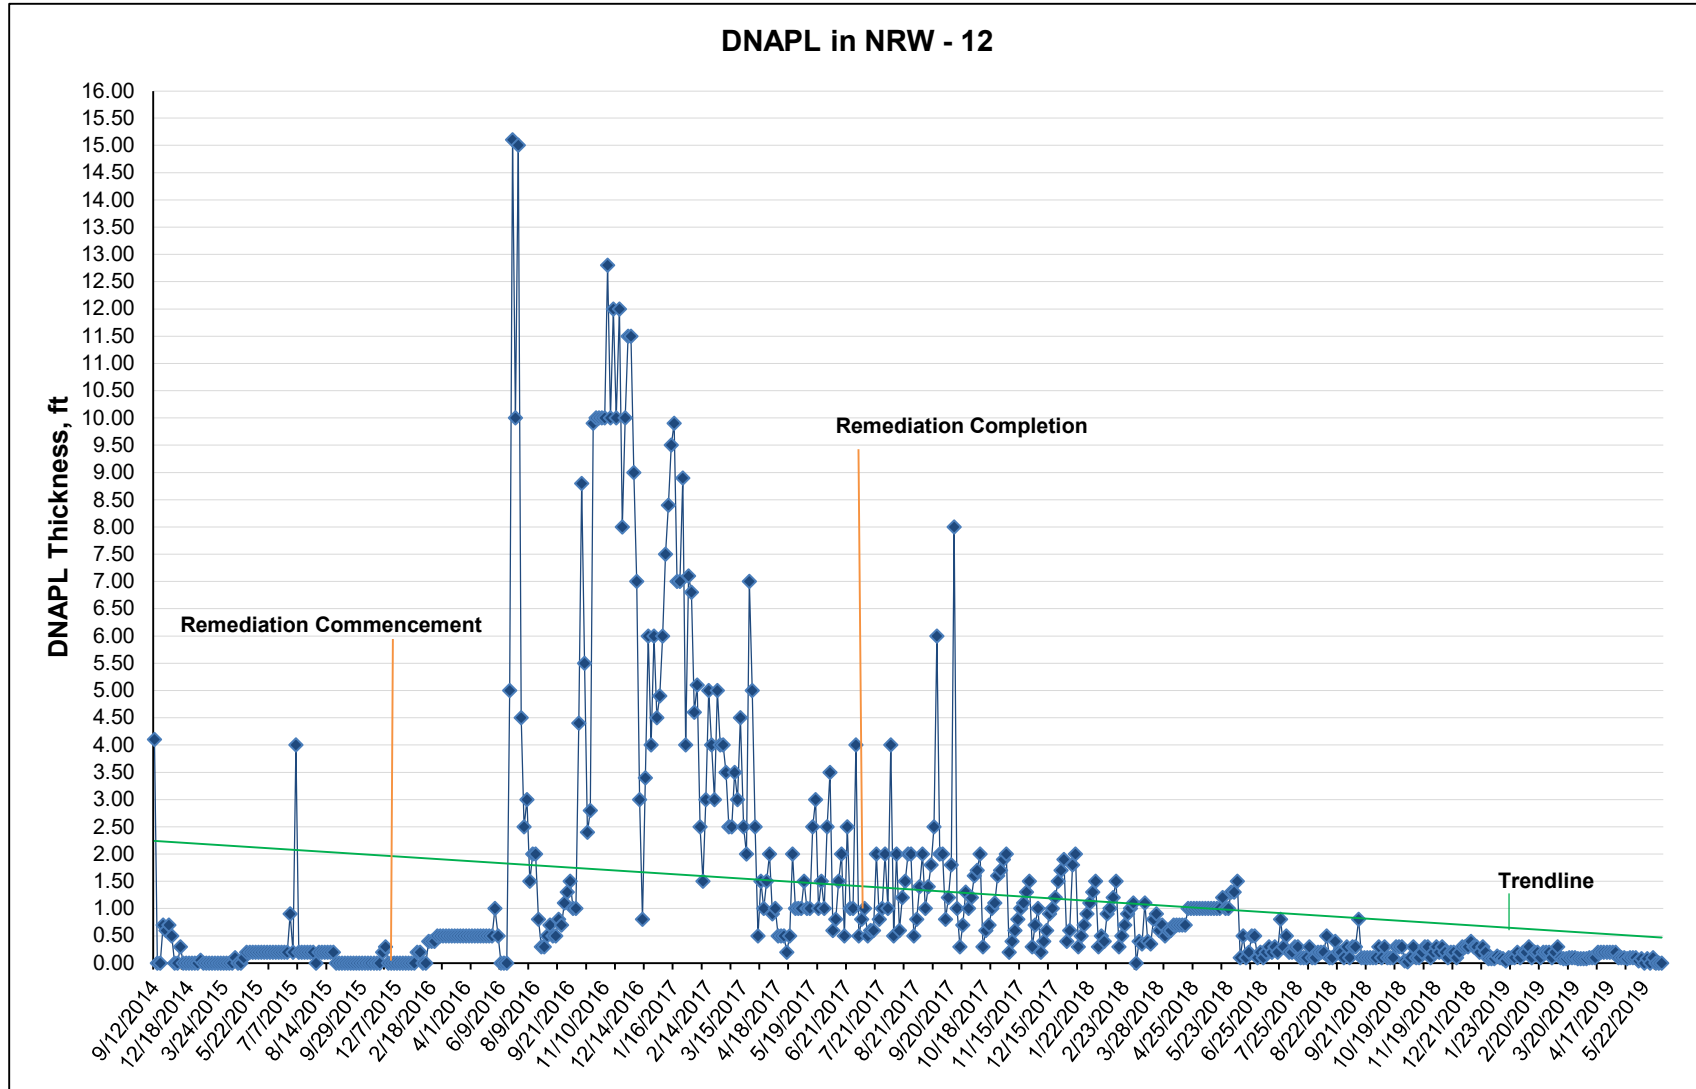

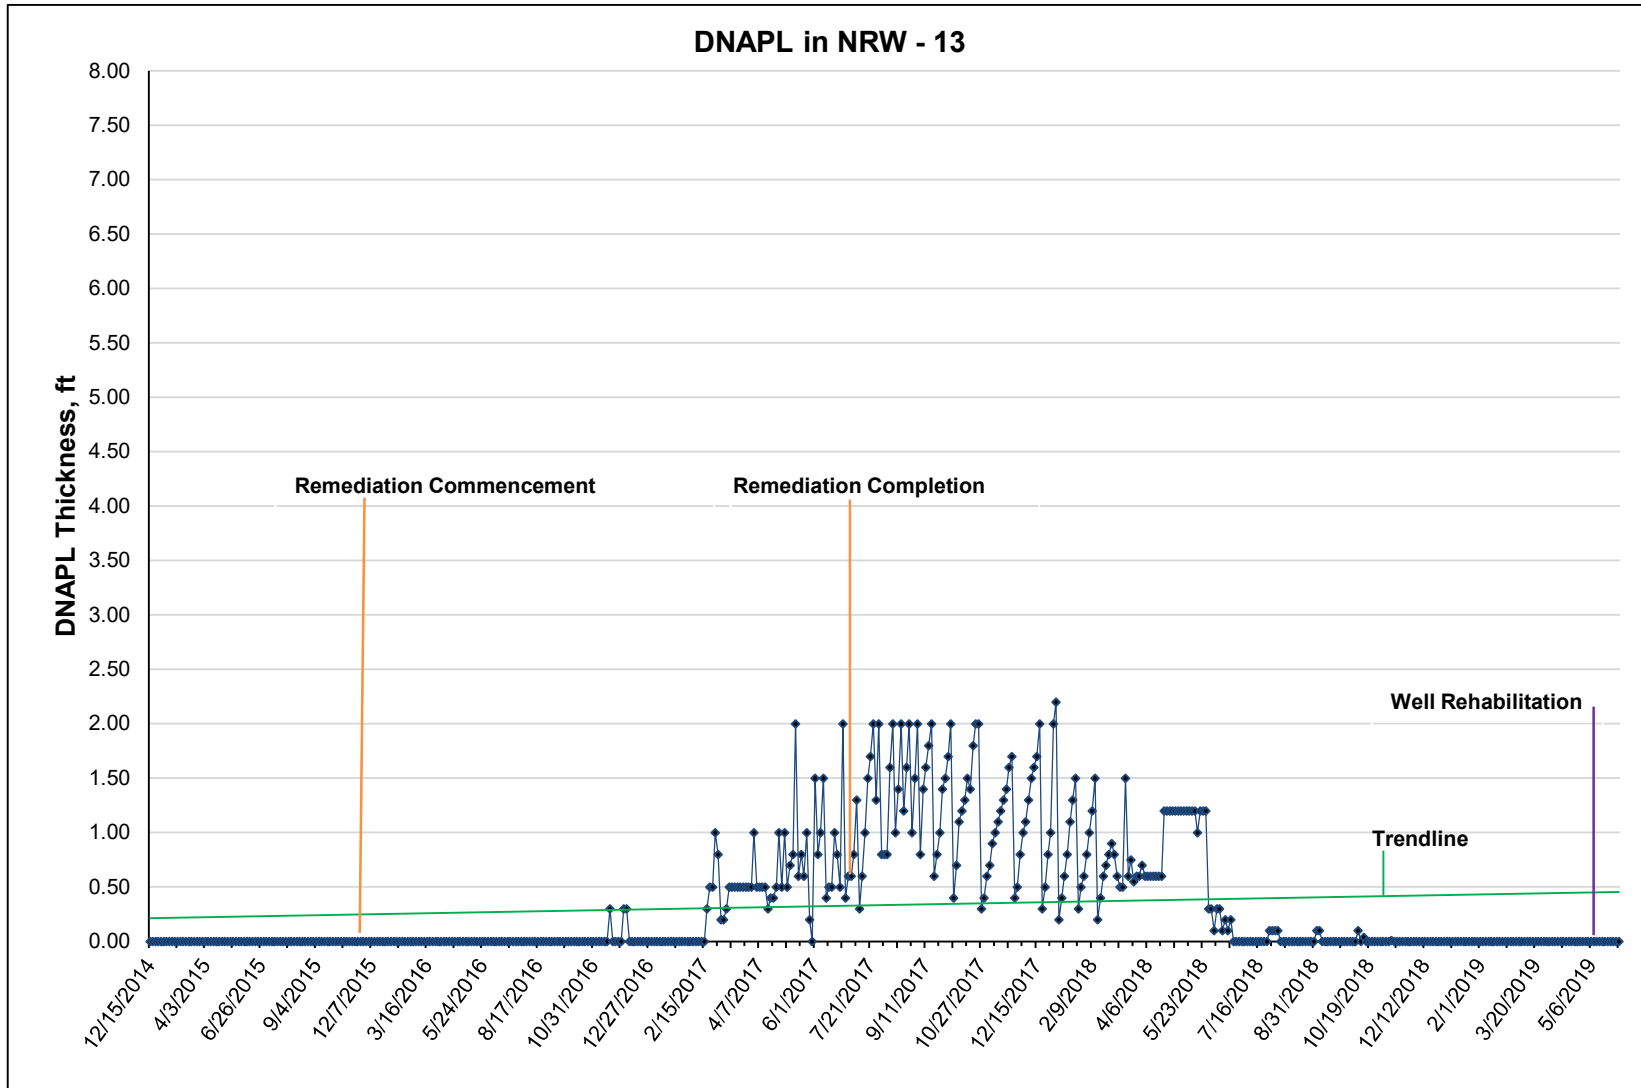


Table 2
Summary of DNAPL-Water Removal
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																Event	
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13	Volume
Date	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons
9/12/2014	--	--	8.0	--	--	--	--	15.2	10.5	--	20.2	--	17.6	--	--	8.0	--	79.5
9/25/2014	--	--	10.0	--	--	--	--	27.0	--	--	4.5	--	19.0	--	--	--	--	60.5
10/9/2014	--	--	6.0	--	--	--	--	23.9	4.2	--	3.8	--	13.4	--	--	--	--	51.3
10/16/2014	--	--	--	--	--	--	--	19.2	--	--	1.7	--	--	--	--	--	--	20.9
10/23/2014	--	--	9.0	--	27.0	--	--	38.0	0.5	--	4.0	--	6.0	--	--	1.0	--	85.5
10/30/2014	--	--	9.0	--	--	--	--	44.0	7.0	--	22.0	--	6.5	--	--	2.0	--	90.5
11/6/2014	--	--	4.8	--	--	--	--	17.3	1.6	--	3.2	--	4.8	--	--	4.0	--	35.7
11/13/2014	--	--	4.8	10.6	14.4	--	--	24.0	2.0	--	8.0	--	8.0	--	--	--	--	71.8
11/20/2014	--	--	1.0	6.5	8.0	--	--	19.0	--	--	5.0	--	7.0	--	--	--	--	46.5
11/26/2014	--	--	--	--	--	--	--	34.0	3.0	--	5.0	--	--	--	--	4.0	--	46.0
12/4/2014	--	--	10.5	3.0	3.0	--	--	64.0	7.0	--	7.0	--	10.0	--	--	--	--	104.5
12/8/2014	--	--	--	--	--	--	--	8.0	--	--	--	--	--	--	--	--	--	8.0
12/11/2014	--	--	--	--	--	--	--	7.0	--	--	3.0	--	4.0	--	--	--	--	14.0
12/15/2014	--	--	--	--	--	--	--	9.0	--	--	--	--	--	--	--	--	--	9.0
12/18/2014	--	--	3.0	3.0	--	--	--	7.0	--	--	--	--	4.0	--	--	--	--	17.0
12/24/2014	--	--	--	--	--	--	--	10.0	6.0	--	5.0	--	--	--	--	--	--	21.0
12/31/2014	--	--	5.0	2.0	2.0	--	--	14.0	2.0	--	2.0	--	6.0	--	--	--	--	33.0
1/8/2015	--	--	1.0	1.0	0.5	--	--	12.5	--	--	2.5	--	5.0	--	--	--	--	22.5
1/15/2015	--	--	0.5	--	1.0	--	--	18.0	--	--	2.5	--	3.0	--	--	--	--	25.0
1/22/2015	--	--	--	1.0	1.0	--	--	16.5	1.5	--	1.5	--	9.0	--	--	--	--	30.5
1/29/2015	--	--	1.5	--	--	--	--	11.5	--	--	1.5	--	2.5	--	--	--	--	17.0
2/19/2015	--	--	--	--	--	--	--	19.5	--	--	--	--	4.1	--	--	--	--	23.6
2/23/2015	--	--	--	--	--	--	--	12.5	--	--	4.2	--	--	--	--	--	--	16.7
2/27/2015	--	--	--	--	--	--	--	6.0	0.5	--	2.0	--	2.5	--	--	--	--	11.0
3/3/2015	--	--	--	--	--	--	--	9.7	--	--	--	--	--	--	--	--	--	9.7
3/6/2015	--	--	--	--	--	--	--	6.5	--	--	--	--	2.0	--	--	--	--	8.5
3/10/2015	--	--	--	--	--	--	--	6.0	1.0	--	2.0	--	--	--	--	--	--	9.0
3/13/2015	--	--	--	--	--	--	--	4.0	--	--	--	--	--	--	--	--	--	4.0
3/17/2015	--	--	--	--	--	--	--	12.0	--	--	2.0	--	3.0	--	--	--	--	17.0
3/20/2015	--	--	--	--	--	--	--	6.5	--	--	--	--	1.5	--	--	--	--	8.0
3/24/2015	--	--	--	--	--	--	--	2.5	--	--	--	--	1.5	--	--	--	--	4.0
3/27/2015	--	--	--	--	--	--	--	11.5	--	--	--	--	--	--	--	--	--	11.5
3/31/2015	--	--	--	--	--	--	--	9.0	--	--	--	--	--	--	--	--	--	9.0
4/3/2015	--	--	9.0	--	--	--	--	6.5	--	--	--	--	--	--	--	--	--	15.5
4/15/2015	--	--	--	--	--	--	--	7.0	--	--	3.5	--	--	--	--	--	--	10.5
4/17/2015	--	--	--	--	--	--	--	9.0	--	--	--	--	1.5	--	--	--	--	10.5
4/22/2015	--	--	5.0	--	--	--	--	5.5	--	--	--	--	--	--	--	--	--	10.5
4/24/2015	--	--	--	--	--	--	--	5.0	--	--	--	--	--	--	--	--	--	5.0
4/29/2015	--	--	2.0	--	--	--	--	5.5	--	--	1.5	--	1.0	--	--	--	--	10.0
5/11/2015	--	--	--	--	--	--	--	7.0	--	--	--	--	--	--	--	--	--	7.0
5/15/2015	--	--	--	--	--	--	--	20.0	--	--	8.0	--	--	--	--	--	--	28.0
5/19/2015	--	--	--	--	--	--	--	5.0	--	--	--	--	--	--	--	--	--	5.0
5/22/2015	--	--	--	--	--	--	--	15.0	--	--	--	--	10.0	--	--	--	--	25.0
5/26/2015	--	--	4.0	--	--	--	--	15.0	--	--	--	--	--	--	--	--	--	19.0
5/29/2015	--	--	--	--	--	--	--	12.0	3.0	--	--	--	5.0	--	--	--	--	20.0
6/2/2015	--	--	3.0	--	--	--	--	15.0	--	--	--	--	4.0	--	--	--	--	22.0
6/5/2015	--	--	--	--	--	--	--	10.0	--	--	3.0	--	3.0	--	--	--	--	16.0
6/9/2015	--	--	--	--	--	--	--	12.0	--	--	5.0	--	7.0	--	--	--	--	24.0
6/12/2015	--	--	--	--	--	--	--	10.0	--	--	4.0	--	4.0	--	--	--	--	18.0
6/16/2015	--	--	--	--	--	--	--	10.0	--	--	--	--	8.0	--	--	--	--	18.0
6/19/2015	--	--	--	--	--	--	--	10.0	--	--	--	--	12.0	--	--	--	--	22.0
6/23/2015	--	--	--	--	--	--	--	12.0	--	--	5.0	--	5.0	--	--	--	--	22.0
6/26/2015	--	--	5.0	--	--	--	--	10.0	--	--	--	--	--	--	--	--	--	15.0
6/30/2015	--	--	4.5	6.0	--	--	--	8.0	--	--	--	--	1.5	--	--	1.5	--	21.5
7/3/2015	--	--	5.0	--	--	--	--	3.5	--	--	--	--	--	--	--	--	--	8.5
7/7/2015	--	--	--	--	--	--	--	15.0	--	--	--	--	5.0	--	--	--	--	20.0
7/10/2015	--	--	--	--	--	--	--	12.0	--	--	--	--	--	--	--	--	--	12.0
7/14/2015	--	--	3.0	--	--	--	--	12.0	--	--	3.0	--	8.0	--	--	--	--	26.0
7/17/2015	--	--	--	--	--	--	--	10.0	--	--	--	--	5.0	--	--	--	--	15.0
7/20/2015	--	--	--	--	--	--	--	12.0	--	--	--	--	8.0	--	--	--	--	20.0
7/24/2015	--	--	--	--	--	--	--	10.0	--	--	--	--	--	--	--	--	--	10.0
7/28/2015	--	--	--	--	--	--	--	15.0	--	--	--	--	5.0	--	--	--	--	20.0
7/31/2015	--	--	--	--	--	--	--	4.0	--	--	--	--	--	--	--	--	--	4.0
8/4/2015	--	--	--	--	--	--	--	15.0	--	--	--	--	--	--	--	--	--	15.0
8/7/2015	--	--	--	--	--	--	--	8.0	--	--	3.0	--	5.0	--	--	--	--	16.0
8/11/2015	--	--	--	--	--	--	--	15.0	--	--	--	--	5.0	--	--	--	--	20.0
8/14/2015	--	--	3.0	--	--	--	--	12.0	--	--	--	--	--	--	--	--	--	15.0
8/18/2015	--	--	--	--	--	--	--	15.0	--	--	--	--	5.0	--	--	--	--	20.0
8/21/2015	--	--	5.0	--	--	--	--	10.0	3.0	--	3.0	--	--	--	--	--	--	21.0
8/25/2015	--	--	--	--	--	--	--	5.0	--	--	3.0	--	--	--	--	--	--	8.0
8/27/2015	--	--	--	--	--	--	--	5.0	--	--	5.0	--	--	--	--	--	--	10.0
9/4/2015	--	--	--	--	--	--	--	12.0	--	--	--	--	8.0	--	--	--	--	20.0
9/8/2015	--	--	--	--	--	--	--	8.0	--	--	7.0	--	--	--	--	--	--	15.0
9/10/2015	--	--	--	--	--	--	--	7.0	--	--	--	--	2.0	--	--	--	--	9.0
9/15/2015	--	--	--	--	--	--	--	10.0	--	--	--	--	10.0	--	--	--	--	20.0
9/17/2015	--	--	--	--	--	--	--	12.0	--	--	--	--	--	--	--	--	--	12.0
9/22/2015	--	--	--	--	--	--	--	15.0	--	--	10.0	--	--	--	--	--	--	25.0
9/24/2015	--	--	--	--	--	--	--	15.0	--	--	--	--	10.0	--	--	--	--	25.0
9/29/2015	--	--	--	--	--	--	--	15.0	--	--	--	--	--	--	--	--	--	15.0
10/1/2015	--	--	--	--	--	--	--	10.0	--	--	--	--	--	--	--	--	--	10.0
10/6/2015	--	--	2.0	--	--	--	--	10.0	--	--	--	--	--	--	--	--	--	12.0
10/8/2015	--	--	--	--	--	--	--	10.0	--	--	5.0	--	10.0	--	--	--	--	25.0
10/13/2015	--	--	--	--	--	--	--	15.0	--	--	--	--	10.0	--	--	--	--	25.0
10/15/2015	--	--	--	--	--	--	--	15.0	--	--	--	--	--	--	--	--	--	15.0
10/22/2015	--	--	--	--	--	--	--	10.0	--	--	--	--	--	--	--	--	--	10.0
10/29/2015	--	--	3.5	--	--	--	--	12.0	4.0	--	6.0	--	10.0	--	--	--	--	35.5
11/4/2015	--	--	2.0	--	--	--	--	15.0	5.0	--	2.0	--	6.0	--	--	1.0	--	31.0
11/9/2015	--	--	--	--	--	--	--	10.0	2.0	--	2.5	--	3.5	--	--	--	--	18.0
11/13/2015	--	--	2.0	--	--	--	--	15.0	--	--	1.0	--	2.0	--	--	--	--	20.0
11/18/2015	--	--	2.0	--	--	--	--	10.0	--	--	0.5	--	3.0	--	--	--	--	15.5
11/24/2015	--	--	2.0	--	--	--	--	15.0	--	--	--	--	3.0	--	--	--	--	20.0
12/7/2015	--	--	2.0	--	--	--	--	19.0	3.0	--	4.5	--	6.0	--	--	--	--	34.5
12/22/2015	--	--	--	--	--	--	--	15.0	--	--	--	--	6.5	--	--	--	--	21.5

Table 2
Summary of DNAPL-Water Removal
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																	Event
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13	Volume	
Date	Gallons		Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	
12/31/2015	--			--	--	--	--	12.0	--		3.0		4.0			--	--	19.0
1/5/2016	--			--	--	--	--	9.0	--		2.0		2.0	--		--	--	13.0
1/13/2016	--			--	--	--	--	12.0	--		1.5		2.0	--		--	--	15.5
1/21/2016	--		3.0	--	--	--	--	15.0	--		2.0		2.0			--	--	22.0
1/27/2016	--			--	--	--	--	20.0	--		--		--	--		--	--	20.0
1/29/2016	--		4.5	--	--	--	--	5.0	--		3.0		2.5			--	--	15.0
2/2/2016	--			--	--	--	--	8.0	--		--		1.5	--		--	--	9.5
2/5/2016	--			--	--	--	--	6.0	--		--		1.5	--		--	--	7.5
2/8/2016	--			--	--	--	--	6.0	--		--		1.5	--		--	--	7.5
2/11/2016	--			--	--	--	--	7.0	--		--		1.0	--		--	--	8.0
2/16/2016	--			--	--	--	--	8.5	--		--		5.0	--		--	--	13.5
2/18/2016	--			--	--	--	--	4.0	--		--		3.0	--		--	--	7.0
2/22/2016	--			--	--	--	--	6.5	--		--		--	--		--	--	6.5
2/26/2016	--			--	--	--	--	7.0	--		--		--	--		--	--	7.0
2/29/2016	--			--	--	--	--	6.0	--		--		4.0	--		--	--	10.0
3/3/2016	--		4.0	--	--	--	--	6.5	--		--		--	--		--	--	10.5
3/8/2016	--			--	--	--	--	8.5	--		3.5		2.5	--		--	--	14.5
3/11/2016	--			--	--	--	--	5.0	--		--		--	--		--	--	5.0
3/16/2016	--			--	--	--	--	7.5	--		--		3.5	--		--	--	11.0
3/18/2016	--			--	--	--	--	4.0	--		--		--	--		--	--	4.0
3/22/2016	--			--	--	--	--	6.0	--		--		--	--		--	--	6.0
3/25/2016	--			--	--	--	--	6.0	--		--		--	--		--	--	6.0
3/29/2016	--			--	--	--	--	6.5	--		--		5.0	--		--	--	11.5
4/1/2016	--			--	--	--	--	5.0	--		--		--	--		--	--	5.0
4/6/2016	--			--	--	--	--	7.5	1.5		2.0		--	--		--	--	11.0
4/11/2016	--	NRW-01R		--	--	--	--	6.5	--		--		5.5	--		--	--	12.0
4/15/2016	--			--	--	--	--	7.0	--		--		--	--		--	--	7.0
4/18/2016	--			--	--	13.5	--	6.5	--		--		6.5	--		--	--	26.5
4/22/2016	--			--	--		--	6.5	--		2.5		7.0	--		--	--	16.0
4/26/2016	--			--	--	--	--	6.5	--		--		--	--		--	--	6.5
4/28/2016	--			--	--	--	--	6.0	--		--		6.0	--		--	--	12.0
5/3/2016	--			--	--	--	--	2.5	--		--		3.5	--		--	--	6.0
5/6/2016	--			--	--	--	--	5.0	--		--		3.0	--		--	--	8.0
5/10/2016	--			--	--	--	--	4.0	--		--		1.5	--		--	--	5.5
5/13/2016	--			--	--	--	--	7.5	--		--		2.0	--		--	--	9.5
5/17/2016	--			--	--	--	--	19.0	--		--		14.0	--		--	--	33.0
5/20/2016	--			--	--	--	--	7.5	--		0.5		11.0	--		--	--	19.0
5/24/2016	--			--	--	--	--	--	--		--		4.0	--		--	--	4.0
5/27/2016	--			--	--	--	--	--	--		--		11.5	--		--	--	11.5
5/31/2016	--			--	--	--	--	6.5	--		--		7.5	--		--	--	14.0
6/7/2016	--			--	--	--	--	15.0	--		--		5.0	--		--	--	20.0
6/9/2016	--			--	--	--	--	6.0	--		--		--	--		--	--	6.0
6/14/2016	--			--	--	--	--	9.5	--		7.5		8.0	--		--	--	25.0
6/17/2016	--		11.0	--	--	--	--	15.5	--		--		--	--		--	--	26.5
6/21/2016	--			--	--	--	--	21.0	--		--		--	--		--	--	21.0
7/6/2016	--		1.5	--	--	--	--	12.0	2.5		--		5.0	--		6.0	--	27.0
7/8/2016	--			--	--	--	--	--	--		--		15.0	--		2.0	--	17.0
7/12/2016	--		4.0	--	--	--	--	15.0	--		--		7.0	--		8.0	--	34.0
7/15/2016	--			--	--	--	--	5.0	--		--		11.0	--		21.0	--	37.0
7/19/2016	--			--	--	--	--	10.0	--		--		14.0	--		8.0	--	32.0
7/22/2016	--			--	--	--	--	5.0	--		--		16.0	--		5.0	--	26.0
7/26/2016	--			--	--	--	--	12.0	--		--		9.0	--		5.0	--	26.0
7/29/2016	--			--	--	--	--	7.0	--		2.0		2.5	--		2.0	--	13.5
8/2/2016	--			--	--	--	--	7.5	--		1.5		1.0	--		4.0	--	14.0
8/5/2016	--		2.0	--	--	--	--	6.0	--		2.0		1.5	--		--	--	11.5
8/9/2016	--			--	--	--	--	9.0	--		1.0		1.0	--		4.0	--	15.0
8/12/2016	--		2.0	--	--	--	--	6.0	--		--		2.0	--		--	--	10.0
8/17/2016	--			--	--	--	--	6.5	--		5.0		2.5	--		--	--	14.0
8/19/2016	--		3.0	--	--	--	--	3.5	1.5		--		--	--		--	--	8.0
8/23/2016	--			--	--	--	--	7.0	--		--		2.0	--		--	--	9.0
8/25/2016	--			--	--	--	--	4.0	--		--		2.0	--		--	--	6.0
8/30/2016	--		1.0	--	--	--	--	7.0	--		--		1.0	1.0		--	--	10.0
9/2/2016	--		1.5	--	--	--	--	6.0	--		--		1.0	2.0		--	--	10.5
9/6/2016	--			--	--	--	--	6.0	--		1.0		1.5	--		--	--	8.5
9/9/2016	--			--	--	--	--	6.0	--		1.5		1.0	--		--	--	8.5
9/12/2016	--			--	--	--	--	6.0	--		2.0		--	--		--	--	8.0
9/15/2016	--			--	--	--	--	5.5	3.0		--		--	--		--	--	8.5
9/21/2016	--		3.0	--	--	--	--	9.0	--		3.0		2.0	--		--	--	17.0
9/26/2016	--		2.5	--	--	--	--	6.0	--		2.0		2.5	--		--	--	13.0
9/29/2016	--			--	--	--	--	3.5	--		--		2.0	--		1.0	--	6.5
10/4/2016	--			--	--	--	--	7.5	--		--		--	--		--	--	7.5
10/7/2016	--		5.5	--	--	--	--	11.5	--		--		4.5	--		--	--	21.5
10/11/2016	--			--	--	--	--	8.0	--		--		--	--		16.0	--	24.0
10/14/2016	--			--	--	--	--	7.0	--		5.5		--	--		11.0	--	23.5
10/17/2016	--			--	--	--	--	7.5	--		--		--	--		5.0	--	12.5
10/21/2016	--			--	--	--	--	4.0	--		--		--	--		--	--	4.0
10/26/2016	--			--	--	--	--	12.5	--		--		--	--		16.5	--	29.0
10/31/2016	--			--	--	--	--	8.0	--		--		3.5	--		16.5	--	28.0
11/3/2016	--		2.0	--	--	--	--	4.5	--		--		--	--		10.0	--	16.5
11/7/2016	--		2.0	--	--	--	--	5.0	--		--		--	--		12.0	--	19.0
11/10/2016	--		1.0	--	--	--	--	5.5	--		--		2.5	--		12.0	--	21.0
11/16/2016	--			--	--	--	--	9.5	--		1.5		--	--		21.0	--	32.0
11/18/2016	--		2.5	--	--	--	--	5.0	--		--		--	--		16.0	--	23.5
11/21/2016	--		1.0	--	--	--	--	6.0	--		--		--	--		15.0	--	22.0
11/23/2016	--		1.0	--	--	--	--	4.0	--		--		--	--		12.5	--	17.5
11/28/2016	--			--	--	--	--											

Table 2
Summary of DNAPL-Water Removal
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																	Event
	NRW-01 Gallons	NRW-01R Gallons	NRW-02 Gallons	NRW-03 Gallons	NRW-04 Gallons	NRW-05 Gallons	NRW-06 Gallons	NRW-07 Gallons	NRW-08 Gallons	NRW-08R Gallons	NRW-09 Gallons	NRW-09R Gallons	NRW-10 Gallons	NRW-11 Gallons	NRW-11R Gallons	NRW-12 Gallons	NRW-13 Gallons	Volume Gallons
12/21/2016	--		2.0	--	--	--	--	1.5	--		--		1.0	--		8.0	--	12.5
12/23/2016	--		--	--	--	--	--	2.5	--		--		4.5	--		8.0	--	15.0
12/27/2016	--		--	--	--	--	--	3.0	--		--		6.0	--		10.0	--	19.0
12/29/2016	--		--	--	--	--	--	6.0	--		--		5.0	--		9.0	--	20.0
1/3/2017	--		3.0	--	--	--	--	4.0	--		--		3.0	--		9.0	--	19.0
1/6/2017	--		--	--	--	--	--	6.0	--		--		6.0	--		11.0	--	23.0
1/9/2017	--		--	--	--	--	--	5.0	--		--		12.0	--		17.0	--	34.0
1/11/2017	--		--	--	--	--	--	15.0	--		--		10.0	--		15.0	--	40.0
1/13/2017	--		--	--	--	--	--	5.0	--		--		15.0	--		15.0	--	35.0
1/16/2017	--		4.0	--	--	--	--	10.0	--		--		10.0	--		15.0	--	39.0
1/18/2017	--		--	--	--	--	--	10.0	--		--		4.0	--		14.0	--	28.0
1/20/2017	--		--	--	--	--	--	4.0	--		--		--	--		9.0	--	13.0
1/24/2017	--		--	--	--	--	--	3.0	--		--		8.0	--		15.0	--	26.0
1/25/2017	--		4.0	--	--	--	--	5.0	--		--		4.0	--		6.0	--	19.0
1/27/2017	--		4.0	--	--	--	--	10.0	--		--		--	--		10.0	--	24.0
1/30/2017	--		2.0	--	--	--	--	7.0	--		--		--	--		10.0	--	19.0
2/1/2017	--		4.0	--	--	--	--	7.0	--		--		--	--		7.0	--	18.0
2/3/2017	--		--	--	--	--	--	9.0	--		--		--	--		10.0	--	19.0
2/6/2017	--		3.0	--	--	--	--	12.0	--		--		--	--		5.0	--	20.0
2/8/2017	--		--	--	--	--	--	10.0	--		--		7.0	--		3.0	--	20.0
2/10/2017	--		3.0	--	--	--	--	11.0	--		--		--	--		6.0	--	20.0
2/14/2017	--		6.0	--	--	--	--	11.0	--		--		4.0	--		6.0	--	27.0
2/15/2017	--		1.0	--	--	--	--	6.5	--		--		--	--		8.0	--	15.5
2/17/2017	--		--	--	--	--	--	6.5	--		--		--	--		8.0	--	14.5
2/21/2017	--		--	--	--	--	--	12.0	--		--		--	--		10.0	--	22.0
2/22/2017	--		--	--	--	--	--	7.0	--		--		--	--		6.5	--	13.5
2/24/2017	--		--	--	--	--	--	11.0	--		--		--	--		6.0	2.0	19.0
2/27/2017	--		--	--	--	--	--	12.0	--		--		5.0	--		5.0	1.0	23.0
3/1/2017	--		--	--	--	--	--	8.0	4.0		--		--	--		5.0	--	17.0
3/3/2017	--		--	--	--	--	--	7.5	--		--		--	--		5.0	--	12.5
3/6/2017	--		--	--	--	--	--	8.0	--		--		--	--		6.0	--	14.0
3/8/2017	--		--	--	--	--	--	10.0	5.0		--		--	--		5.0	--	20.0
3/13/2017	--		--	--	--	--	--	15.0	4.0		--		--	--		7.0	--	26.0
3/15/2017	--		4.0	--	--	--	--	7.0	--		--		--	--		4.0	--	15.0
3/17/2017	--		--	--	--	--	--	10.0	--		--		--	--		3.5	--	13.5
3/22/2017	--		6.0	--	--	--	--	--	--		--		--	--		16.0	--	22.0
3/24/2017	--		--	--	--	--	--	12.0	4.0		--		--	--		--	--	16.0
3/29/2017	--		--	--	--	--	--	14.0	2.0		--		--	--		6.0	--	22.0
3/30/2017	--		--	--	--	--	--	4.0	2.0		--		--	--		5.0	--	11.0
3/31/2017	--		--	--	--	--	--	8.0	6.0		--		--	--		--	--	14.0
4/3/2017	--		--	--	--	--	--	8.0	--		--		2.0	--		2.0	2.0	14.0
4/5/2017	--		--	--	--	--	--	8.0	2.0		--		2.0	--		3.0	--	15.0
4/7/2017	--		--	--	--	--	--	4.0	--		--		1.5	--		1.5	--	7.0
4/10/2017	--		--	--	--	--	--	12.0	1.5		--		1.5	--		3.0	--	18.0
4/12/2017	--		--	--	--	--	--	10.0	2.0		--		--	--		0.5	--	12.5
4/14/2017	--		--	--	--	--	--	7.5	1.0		--		1.0	--		2.0	--	11.5
4/18/2017	--		--	--	--	--	--	10.0	--		--		1.5	--		--	--	11.5
4/21/2017	--		--	--	--	--	--	5.0	1.0		--		1.5	--		--	--	7.5
4/24/2017	--		--	--	--	--	--	15.0	--		--		--	--		--	--	15.0
4/26/2017	--		--	--	--	--	--	7.5	1.0		--		1.0	--		--	1.0	10.5
4/28/2017	--		1.0	--	--	--	--	7.0	--		--		1.0	--	8.0	--	--	17.0
5/3/2017	--		--	--	--	--	--	18.0	1.0		--		1.0	--	6.0	1.0	--	27.0
5/5/2017	--		--	--	--	--	--	6.0	2.0		--		5.0	--	5.0	1.0	--	19.0
5/8/2017	--		--	--	--	--	--	7.0	--		--		1.5	--	5.0	3.0	--	16.5
5/10/2017	--		--	--	--	--	--	7.0	--		--		--	--	7.0	2.5	5.0	21.5
5/12/2017	--		--	--	--	--	--	4.5	--		--		1.0	--	6.0	1.0	--	12.5
5/16/2017	--		--	--	--	--	--	11.0	--		--		1.0	--	5.0	0.5	--	17.5
5/19/2017	--		--	--	--	--	--	5.0	--		--		3.0	--	--	5.0	--	13.0
5/22/2017	--		--	--	--	--	--	--	--		--		--	--	15.0	5.0	1.5	21.5
5/25/2017	--		--	--	--	--	--	13.0	2.0		--		1.0	--	8.0	0.5	--	24.5
5/31/2017	--		--	--	--	--	--	13.0	--		--	1.0	--	--	5.0	4.0	--	23.0
6/1/2017	--		--	--	--	--	--	7.4	--		--	--	2.4	--	4.4	0.4	2.4	17.0
6/5/2017	--		1.4	--	--	--	--	6.4	--		--	--	--	--	--	--	--	7.8
6/7/2017	--		--	--	--	--	--	4.4	1.4		--	--	2.4	--	8.4	6.4	0.4	23.4
6/9/2017	--		--	--	--	--	--	4.4	--		--	--	0.4	--	5.4	--	2.4	12.6
6/12/2017	--		--	--	--	--	--	7.4	3.4		--	--	0.4	--	5.4	--	--	16.6
6/14/2017	--		0.4	--	--	--	--	2.4	0.4		--	--	--	--	2.4	1.9	--	7.5
6/16/2017	--		--	--	--	--	--	2.4	0.4		--	--	0.4	--	--	3.4	--	6.6
6/19/2017	--		1.4	--	--	--	--	5.4	1.4		--	--	0.9	--	6.4	--	0.4	15.9
6/21/2017	--		--	--	--	--	--	3.4	--		--	--	--	--	--	--	--	3.4
6/23/2017	--		--	--	--	--	--	6.4	0.4		--	--	0.4	--	9.4	0.4	--	17.0
6/26/2017	--		4.4	--	--	--	--	6.4	0.9		--	0.5	--	--	8.4	0.9	4.4	25.9
6/28/2017	--		--	--	--	--	--	4.4	0.4		--	1.0	0.4	--	8.4	0.4	--	15.0
6/30/2017	--		--	--	--	--	--	5.4	0.4		--	0.5	0.4	--	6.9	--	--	13.6
7/5/2017	--		2.4	--	--	--	--	10.4	2.4		--	--	3.4	--	5.4	--	--	24.0
7/7/2017	--		0.4	--	--	--	--	3.4	1.4		--	--	0.4	--	3.4	0.4	--	9.4
7/10/2017	--		--	--	--	--	--	4.4	--		--	--	0.4	--	7.4	--	1.4	13.6
7/12/2017	--		--	--	--	--	--	6.4	--		--	--	1.4	--	6.4	--	--	14.2
7/14/2017	--		4.4	--	--	--	--	6.4	--		--	--	1.4	--	7.4	--	--	19.6
7/17/2017	--		--	--	--	--	--	6.4	0.4		--	2.0	0.4	--	9.4	1.4	--	20.0
7/19/2017	--		--	--	--	--	--	6.4										

Table 2
Summary of DNAPL-Water Removal
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																	Event
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13	Volume
Date	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons
8/25/2017	--		--				--	6.4	--			--	--		9.4	2.4	1.4	19.6
8/28/2017	--		4.4				--	9.4	--			--	--		10.4	--	--	24.2
8/30/2017	--		--				--	6.4	1.4			1.5	0.4		10.4	--	--	20.1
9/1/2017	--		--				--	4.4	--			--	--		11.4	2.4	1.4	19.6
9/6/2017	--		--				--	12.4	--			--	3.4		9.4	4.4	--	29.6
9/8/2017	--		--				--	7.4	3.4			3.5	--		10.4	11.4	--	36.1
9/11/2017	--		3.4				--	11.4	--			2.5	--		14.4	3.4	--	35.1
9/13/2017	--		--				--	8.4	3.4			--	1.4		11.4	2.4	1.4	28.4
9/15/2017	--		--				--	12.4	--			--	--		8.4	--	1.9	22.7
9/18/2017	--		--				--	8.4	--			--	--		14.4	--	--	22.8
9/20/2017	--		5.4				--	8.4	--			--	--		11.4	2.4	--	27.6
9/22/2017	--		--				--	4.4	1.4			1.5	1.4		7.4	--	--	16.1
9/25/2017	--		--				--	10.4	--			--	--		8.4	0.4	--	19.2
9/27/2017	--		--				--	10.4	--			--	--		8.4	--	--	18.8
9/29/2017	--		--				--	11.4	--			--	--		8.4	--	--	19.8
10/2/2017	--		--				--	8.4	--			--	--		12.4	--	1.4	22.2
10/4/2017	--		--				--	7.4	1.5			--	--		10.4	--	--	19.3
10/6/2017	--		3.4				--	7.4	--			--	--		10.4	--	--	21.2
10/9/2017	--		--				--	7.4	--			2.5	3.4		12.4	--	--	25.7
10/11/2017	--		--				--	5.4	--			--	--		8.4	1.4	--	15.2
10/13/2017	--		--				--	4.4	--			--	--		10.4	1.4	--	16.2
10/16/2017	--		--				--	9.4	--			--	--		11.4	--	--	20.8
10/18/2017	--		--				--	11.4	--			--	--		9.4	--	--	20.8
10/20/2017	--		5.4				--	9.4	--			--	--		11.4	--	--	26.2
10/23/2017	--		--				--	7.4	1.4			1.5	0.5		9.4	--	1.4	21.6
10/25/2017	--		--				--	10.4	--			--	--		9.4	--	1.4	21.2
10/27/2017	--		--				--	6.4	--			--	--		8.4	--	--	14.8
10/30/2017	--		--				--	5.4	--			--	--		9.4	--	--	14.8
11/1/2017	--		--				--	--	--			--	--		7.4	--	--	7.4
11/3/2017	--		--				--	12.4	--			--	--		11.4	2.4	--	26.2
11/6/2017	--		--				--	2.0	--			--	--		9.4	--	--	11.4
11/8/2017	--		--				--	7.4	--			--	--		9.4	--	--	16.8
11/10/2017	--		2.4				--	7.4	--			--	--		8.4	--	--	18.2
11/13/2017	--		--				--	6.9	--			--	--		7.4	--	--	14.3
11/15/2017	--		--				--	6.4	--			--	--		8.4	--	--	14.8
11/17/2017	--		--				--	5.4	--			1.5	--		7.4	--	--	14.3
11/20/2017	--		--				--	6.4	1.5			--	2.4		8.4	--	--	18.7
11/22/2017	--		--				--	8.4	--			--	--		7.4	0.4	0.9	17.1
11/27/2017	--		--				--	11.4	--			--	--		8.4	--	--	19.8
11/29/2017	--		0.9				--	8.4	--			--	--		8.4	--	--	17.7
12/1/2017	--		--				--	6.4	--			1.0	--		7.4	0.9	--	15.7
12/4/2017	--		--				--	8.4	--			--	--		6.4	--	--	14.8
12/6/2017	--		--				--	8.4	--			--	--		7.4	--	--	15.8
12/8/2017	--		--				--	7.4	--			--	--		8.4	--	--	15.8
12/11/2017	--		--				--	7.4	--			--	--		--	--	--	7.4
12/13/2017	--		--				--	6.4	--			--	--		8.4	--	--	14.8
12/15/2017	--		1.4				--	6.4	1.4			--	1.5		7.4	--	--	18.1
12/18/2017	--		--				--	8.4	--			--	--		9.4	--	1.4	19.2
12/20/2017	--		--				--	7.4	--			1.5	--		9.4	--	--	18.3
12/22/2017	--		--				--	4.9	--			--	--		8.4	1.4	--	14.7
12/27/2017	--		--				--	14.4	--			--	--		12.4	--	--	26.8
12/29/2017	--		--				--	7.4	--			--	--		8.4	--	--	15.8
1/8/2018	--		--				--	21.4	--			--	--		23.4	--	--	44.8
1/10/2018	--		--				--	7.4	1.4			0.5	1.5		10.4	1.4	1.4	24.0
1/12/2018	--		--				--	6.4	--			--	--		8.4	--	--	14.8
1/15/2018	--		6.4				--	7.4	--			--	--		8.4	--	--	22.2
1/17/2018	--		--				--	6.4	--			--	--		8.4	--	--	14.8
1/19/2018	--		--				--	7.4	--			--	--		9.4	--	--	16.8
1/22/2018	--		--				--	7.4	--			--	--		9.4	--	--	16.8
1/24/2018	--		--				--	6.4	--			--	--		7.4	--	--	13.8
1/26/2018	--		--				--	6.4	--			--	--		7.4	0.4	0.4	14.6
1/29/2018	--		--				--	6.9	1.4			1.5	--		8.4	--	--	18.2
1/31/2018	--		--				--	6.4	--			--	1.5		7.4	--	--	15.3
2/2/2018	--		--				--	6.4	--			--	--		7.4	--	--	13.8
2/5/2018	--		1.4				--	6.4	--			--	--		6.4	--	--	14.2
2/7/2018	--		--				--	6.4	--			--	--		6.4	--	--	12.8
2/9/2018	--		--				--	6.4	--			--	--		7.4	--	--	13.8
2/12/2018	--		--				--	8.4	--			--	--		9.4	--	--	17.8
2/19/2018	--		--				--	7.4	--			--	--		8.4	--	--	15.8
2/21/2018	--		--				--	6.4	--			--	1.5		7.4	--	--	15.3
2/23/2018	--		--				--	6.4	--			--	--		7.4	--	--	13.8
2/26/2018	--		3.4				--	7.4	--			--	--		8.4	--	--	19.2
2/28/2018	--		--				--	6.4	--			--	--		7.4	--	--	13.8
3/2/2018	--		--				--	5.4	--			--	--		7.4	--	--	12.8
3/5/2018	--		5.7				--	3.0	--			--	--		--	--	--	8.7
3/12/2018	--		1.5				--	4.7	--			--	--		4.7	--	--	10.9
3/14/2018	--		--				--	7.9	--			--	--		3.6	--	--	11.5
3/16/2018	--		--				--	7.8	--			--	--		2.5	--	--	10.3
3/19/2018	--		--				--	5.8	--			--	--		5.8	--	--	11.5
3/23/2018	--		--				--	10.4	--			--	--		8.5	--	--	18.9
3/26/2018	--		2.6				--	8.9	--			--	--		1.5	--	--	13.0
3/28/2018	--		--				--	6.8	--			2.7	--		2.6	--	--	12.1
3/30/2018	--		--				--	7.9	--			--	--		7.9	--	--	15.8
4/2/2018	--		--				--	7.9	--			--	--		3.6	--	--	11.5
4/4/2018	--		3.6				--	6.8	--			--	--		4.7	--	--	15.2
4/6/2018	--		--				--	5.8	--			--	--		3.6	--		

Table 2
Summary of DNAPL-Water Removal
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																	Event
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13	Volume
Date	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons
4/30/2018	--		--				--	7.9				--	--		5.8	--	--	13.6
5/2/2018	--		--				--	5.8	--			--	--		5.8	--	--	11.5
5/4/2018	--		--				--	5.8	--			--	--		3.6	--	--	9.4
5/7/2018	--		--				--	7.9	--			--	--		5.8	--	--	13.6
5/9/2018	--		--				--	5.8	--			--	4.8		5.8	--	--	16.3
5/11/2018	--		--				--	7.9	--			--	--		5.8	--	--	13.6
5/14/2018	--		5.8				--	7.9	--			--	--		5.8	--	--	19.4
5/16/2018	--		--				--	4.7	--			--	--		4.7	--	--	9.4
5/18/2018	--		--				--	4.7	--			--	--		5.8	--	--	10.5
5/21/2018	--		--				--	5.8	--			--	--		5.8	--	--	11.5
5/23/2018	--		--				--	4.7	--			--	--		5.8	--	--	10.5
5/25/2018	--		--				--	5.8	--			--	--		5.8	--	3.6	15.2
5/30/2018	--		--				--	12.1	--			3.7	--		7.9	--	--	23.7
6/1/2018	--		--				--	5.8	--			--	3.7		5.8	5.8	--	21.0
6/6/2018	--		--				--	12.1	--			--	--		7.9	--	--	20.0
6/8/2018	--		5.8				--	5.8	--			3.6	1.5		3.6	1.5	--	21.8
6/11/2018	--		3.6				--	5.8	--			--	--		1.5	--	1.5	12.4
6/13/2018	--		3.6				--	3.6	--			1.5	1.5		1.5	--	--	11.8
6/15/2018	--		--				--	3.6	--			1.5	1.5		1.5	1.5	--	9.7
6/18/2018	--		3.6				--	10.0	--			--	--		1.5	1.5	--	16.7
6/20/2018	--		1.5				--	5.8	--			1.5	1.5		1.5	--	--	11.8
6/22/2018	--		3.6				--	5.8	--			1.0	1.0		1.5	1.0	--	13.9
6/25/2018	--		1.5				--	5.8	--			1.5	1.5		3.6	1.5	--	15.5
6/27/2018	--		3.6				--	5.8	--			1.0	1.0		1.5	1.0	--	13.9
6/29/2018	--		3.6				--	5.8	--			1.0	1.0		1.5	1.0	--	13.9
7/2/2018	--		1.5				--	5.8	--			0.9	0.9		1.5	0.9	--	11.5
7/5/2018	--		1.5				--	7.9	--			0.9	0.9		1.5	0.9	--	13.6
7/9/2018	--		3.6				--	10.0	--			0.9	0.9		3.6	0.9	--	20.0
7/11/2018	--		1.5				--	10.0	--			5.8	1.5		5.8	10.0	--	34.6
7/13/2018	--		10.0				--	16.4	--			1.5	5.8		10.0	1.5	--	45.2
7/16/2018	--		16.4				--	16.4	--			10.0	10.0		1.5	5.8	--	60.0
7/18/2018	--		20.6				--	16.4	--			1.5	5.8		1.5	1.5	--	47.3
7/20/2018	--		16.4				--	10.0	--			5.8	1.5		5.8	1.5	--	40.9
7/23/2018	--		16.4				--	20.6	--			1.5	1.5		1.5	--	--	41.5
7/25/2018	--		10.0				--	10.0	--			1.5	5.8		1.5	1.5	1.5	31.8
7/27/2018	--		5.8				--	5.8	--			1.5	1.5		1.5	1.5	1.5	19.1
7/30/2018	--		10.0				--	10.0	--			1.5	1.5		1.5	1.5	1.5	27.6
8/1/2018	--		--				--	10.0	--			1.5	1.5		--	1.5	1.5	16.1
8/3/2018	--		5.8				--	5.8	--			1.5	1.5		1.5	1.5	--	17.6
8/6/2018	--		10.0				--	5.8	--			--	1.5		5.8	1.5	--	24.6
8/8/2018	--		10.0				--	16.4	--			--	1.5		5.8	1.5	--	35.2
8/10/2018	--		--				--	5.8	--			--	--		--	--	--	5.8
8/13/2018	--		5.8				--	--	--			--	--		--	--	--	5.8
8/15/2018	--		5.8				--	5.8	--			1.5	1.5		5.8	--	--	20.3
8/17/2018	--		1.5				--	5.8	--			--	--		2.6	5.8	--	15.6
8/20/2018	--		3.6				--	10.0	--			1.5	--		1.5	--	--	16.7
8/22/2018	--		3.6				--	7.9	--			1.5	--		1.5	--	--	14.6
8/24/2018	--		7.9				--	10.0	--			3.6	1.5		3.6	3.6	--	30.3
8/27/2018	--		3.6				--	10.0	--			1.5	--		3.6	1.5	--	20.3
8/29/2018	--		5.8				--	10.0	--			1.5	1.5		1.5	1.5	--	21.8
8/31/2018	--		5.8				--	12.1	--			--	1.5		--	1.5	--	20.9
9/5/2018	--		3.6				--	20.6	--			1.5	1.5		--	5.8	1.5	34.6
9/7/2018	--		5.8				--	5.8	--			1.5	--		--	1.5	1.5	16.1
9/10/2018	--		1.5				--	5.8	--			1.5	1.5		--	1.5	--	11.8
9/12/2018	--		1.5				--	5.8	--			1.5	1.5		16.4	1.5	--	28.2
9/14/2018	--		1.5				--	1.5	--			1.5	1.5		5.8	10.0	--	21.8
9/17/2018	--		1.5				--	5.8	--			1.5	1.5		1.5	1.5	--	13.4
9/19/2018	--		1.5				--	1.5	--			1.5	1.5		5.8	1.5	--	13.4
9/21/2018	--		1.5				--	5.8	--			1.5	1.5		1.5	1.5	--	13.4
9/24/2018	--		1.5				--	1.5	--			1.5	1.5		1.5	1.5	--	9.1
9/26/2018	--		1.5				--	10.0	--			1.5	1.5		16.4	0.9	--	31.8
9/28/2018	--		5.8				--	5.8	--			1.5	1.5		5.8	1.5	--	21.8
10/1/2018	--		1.5				--	10.0	--			1.5	1.5		10.0	1.5	--	26.1
10/3/2018	--		1.5				--	5.8	--			1.5	1.5		1.5	1.5	--	13.4
10/5/2018	--		1.5				--	5.8	--			1.5	1.5		1.5	1.5	--	13.4
10/8/2018	--		1.5				--	5.8	--			1.5	1.5		5.8	1.5	--	17.6
10/10/2018	--		1.5				--	5.8	--			1.5	1.5		1.5	1.5	--	13.4
10/12/2018	--		0.2				--	11.4	--			0.2	0.2		9.4	0.2	--	21.8
10/15/2018	--		1.5				--	10.0	--			0.2	0.2		5.8	1.5	0.0	19.3
10/17/2018	--		--				--	5.8	--			0.2	--		5.8	1.5	--	13.3
10/19/2018	--		--				--	5.8	--			0.0	0.2		5.8	1.5	--	13.3
10/22/2018	--		0.2				--	10.0	--			0.2	0.2		10.0	0.0	--	20.7
10/24/2018	--		0.0				--	10.0	--			0.0	0.2		5.8	0.0	--	16.0
10/26/2018	--		0.2				--	10.0	--			0.2	0.2		1.5	0.2	--	12.5
10/29/2018	--		0.2				--	5.8	--			0.2	0.2		10.0	1.5	--	18.0
10/31/2018	--		0.2				--	10.0	--			0.2	0.2		11.4	0.2	--	22.4
11/2/2018	--		0.0				--	16.4	--			0.2	0.0		5.8	0.2	--	22.6
11/5/2018	--		1.5				--	7.4	--			0.2	0.2		9.4	1.5	--	20.3
11/7/2018	--		0.2				--	5.8	--			0.2	1.5		10.0	5.8	0.0	23.5
11/9/2018	--		0.2															

Table 2
Summary of DNAPL-Water Removal
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area																	Event Volume
	NRW-01	NRW-01R	NRW-02	NRW-03	NRW-04	NRW-05	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09	NRW-09R	NRW-10	NRW-11	NRW-11R	NRW-12	NRW-13	
Date	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons	Gallons
12/26/2018	--		3.6				--	7.4	--			0.5	1.5		9.4	3.6	--	26.1
12/28/2018	--		0.2				--	10.0	--			1.5	0.5		5.8	3.6	--	21.6
1/2/2019	--		0.2				--	4.4	--			1.5	1.5		9.4	1.5	--	18.6
1/4/2019	--		0.2				--	7.9	--			0.2	0.0		7.9	0.2	--	16.5
1/7/2019	--		0.2				--	3.6	--			0.0	0.3		6.4	0.3	--	10.9
1/9/2019	--		0.0				--	1.5	--			0.2	0.5		5.8	0.2	--	8.2
1/11/2019	--		0.0				--	1.1	--			0.2	0.2		3.6	0.2	--	5.5
1/14/2019	--		0.0				--	7.9	--			0.5	0.5		10.0	0.2	--	19.0
1/16/2019	--		0.2				--	3.6	--			0.2	0.2		5.8	1.1	--	11.2
1/18/2019	--		0.2				--	5.8	--			0.2	0.0		5.8	1.1	--	13.1
1/21/2019	--		0.2				--	5.8	--			0.2	0.2		5.8	0.2	--	12.5
1/23/2019	--		0.2				--	5.8	--			1.1	0.2		7.9	0.0	--	15.2
1/25/2019	--		0.2				--	1.5	--			0.2	0.2		1.5	1.1	--	4.9
1/28/2019	--		0.2				--	5.8	--			0.2	0.2		7.9	0.2	--	14.6
1/30/2019	--		0.2				--	1.5	--			0.2	0.2		5.8	0.2	--	8.3
2/1/2019	--		0.0				--	5.8	--			0.2	0.2		7.9	1.1	--	15.2
2/4/2019	--		0.2				--	7.9	--			1.1	0.0		7.9	0.2	--	17.4
2/6/2019	--		0.2				--	5.8	--			0.2	0.0		7.9	1.1	--	15.2
2/8/2019	--		0.2				--	1.5	--			0.2	0.2		5.8	1.1	--	9.1
2/11/2019	--		0.2				--	7.9	--			1.1	1.1		12.1	1.5	--	24.0
2/13/2019	--		1.1				--	3.6	--			0.2	0.2		5.8	1.1	--	12.1
2/15/2019	--		0.0				--	3.6	--			0.2	0.2		10.0	1.1	--	15.2
2/18/2019	--		0.2				--	7.9	--			1.1	0.2		10.0	1.1	--	20.6
2/20/2019	--		0.2				--	3.6	--			0.2	0.2		7.9	0.2	--	12.5
2/22/2019	--		1.1				--	7.9	--			0.2	0.2		7.9	1.1	--	18.4
2/25/2019	--		1.1				--	7.9	--			0.2	0.2		10.0	1.1	--	20.6
2/27/2019	--		0.2				--	5.8	--			0.2	0.2		7.9	1.1	--	15.5
3/1/2019	--		0.2				--	7.9	--			0.2	0.2		7.9	0.2	--	16.8
3/4/2019	--		0.2				--	7.9	--			0.2	0.2		7.9	0.2	--	16.8
3/6/2019	--		0.2				--	5.8	--			0.2	0.2		3.6	1.1	--	11.2
3/8/2019	--		0.2				--	5.8	--			1.1	0.0		3.6	0.2	--	11.0
3/11/2019	--		0.2				--	1.5	--			0.2	0.2		3.6	0.0	--	5.9
3/13/2019	--		0.2				--	5.8	--			1.1	0.2		3.6	0.2	--	11.2
3/15/2019	--		0.2				--	7.9	--			0.2	0.2		5.8	0.2	--	14.6
3/18/2019	--		0.2				--	5.8	--			1.1	0.2		3.6	0.2	--	11.2
3/20/2019	--		0.2				--	1.5	--			0.2	0.2		5.8	1.1	--	9.1
3/22/2019	--		0.2				--	1.5	--			0.2	0.2		3.6	0.0	--	5.9
3/25/2019	--		0.2				--	5.8	--			1.1	0.2		3.6	0.0	--	11.0
3/27/2019	--		0.2				--	5.8	--			1.1	1.1		1.5	0.0	--	9.7
3/29/2019	--		0.2				--	5.8	--			1.1	1.1		3.6	0.0	--	11.8
4/1/2019	--		0.3				--	3.6	--			1.1	0.3		1.5	0.3	--	7.0
4/3/2019	--		0.3				--	1.5	--			0.3	0.3		3.6	1.1	--	7.0
4/5/2019	--		0.3				--	5.8	--			1.1	1.1		3.6	0.3	--	12.1
4/8/2019	--		0.3				--	1.5	--			1.1	1.1		3.6	1.1	--	8.7
4/10/2019	--		0.3				--	5.8	--			1.1	1.1		3.6	1.1	--	13.0
4/12/2019	--		1.1				--	4.1	--			1.9	1.1		2.8	1.9	--	12.9
4/15/2019	--		1.5				--	7.9	--			1.5	1.5		5.8	1.5	--	19.7
4/17/2019	--		1.5				--	5.8	--			1.1	1.1		3.6	1.5	--	14.6
4/19/2019	--		1.5				--	5.8	--			1.5	1.1		5.8	1.1	--	16.8
4/22/2019	--		1.1				--	5.8	--			1.1	1.5		5.8	1.5	--	16.8
4/24/2019	--		1.1				--	7.9	--			1.1	1.5		5.8	1.1	--	18.5
4/26/2019	--		1.1				--	7.9	--			1.1	0.3		5.8	0.3	--	16.3
4/29/2019	--		1.1				--	7.9	--			1.1	0.3		5.8	0.3	--	16.3
5/1/2019	--		1.1				--	3.6	--			1.1	1.1		3.6	0.3	--	10.8
5/3/2019	--		1.1				--	5.8	--			1.1	1.1		3.6	0.3	--	13.0
5/6/2019	--		1.1				--	5.8	--			1.1	0.3		3.6	1.1	--	13.0
5/8/2019	--		--				--	5.8	--			1.1	1.1		1.5	0.3	--	9.7
5/10/2019	--		--				--	--	--			--	--		--	--	--	0.0
5/15/2019	--		--				--	--	--			--	--		--	--	--	0.0
5/22/2019	--		--				--	7.9	--			0.3	1.5		3.6	--	--	13.3
5/29/2019	--		--				--	1.5	--	--		--	--		1.1	0.3	--	2.9
5/31/2019	--		6.0				--	7.9	--	1.0		--	--		2.0	--	--	16.9
6/5/2019	--		3.6	1.5			--	5.8	--	--		--	--		3.6	0.3	--	14.8
6/12/2019	--		1.5	1.1			--	5.8	--	--		--	--		3.6	--	--	12.0
6/17/2019	--		3.6	--			--	10.0	--	--		--	--		3.6	--	--	17.3
6/19/2019	--		8.9	--			--	3.6	--	--		--	--		3.6	--	--	16.2
Total Gallons	0.0	23.7	647.8	33.1	70.4	0.0	0.0	4409.0	164.9	1.0	253.6	172.3	928.6	3.0	1912.3	996.5	60.2	9676.4
Percent of Total	0.0%	0.2%	6.7%	0.3%	0.7%	0.0%	0.0%	45.6%	1.7%	0.0%	2.6%	1.8%	9.6%	0.0%	19.8%	10.3%	0.6%	100.0%

Notes:

-- DNAPL was not pumped

Volumes in the table include DNAPL volume as well as the volume of groundwater that may have been pumped along with DNAPL.


Volume of water in the tube at the beginning of recovery is deducted from the total fluid recovery volume after June 1, 2017.

Well not operational

NRW-01, -03, -04, -05, -08, -09, and -11 are decommissioned.

Replacement recovery wells NRW-09R and NRW-11R were installed on March 27, 2017 and March 23, 2017 respectively.

Replacement recovery wells NRW-01R and NRW-08R were installed on May 21, 2019 and May 24, 2019 respectively.

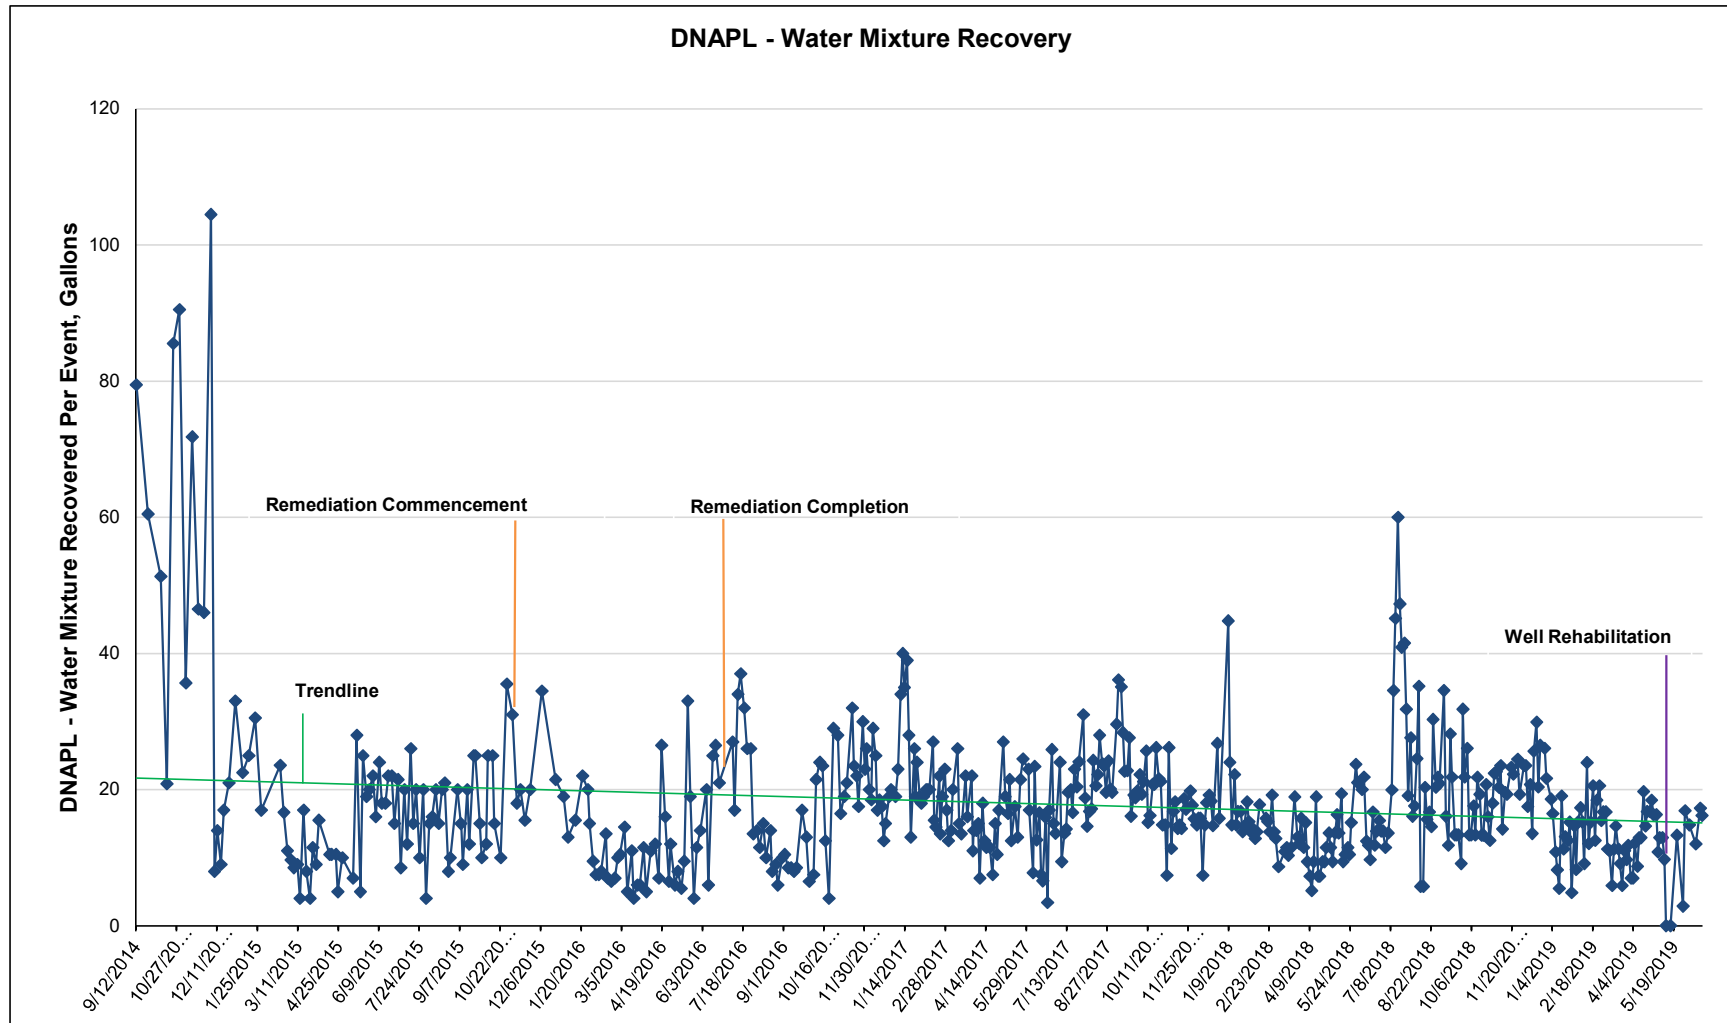

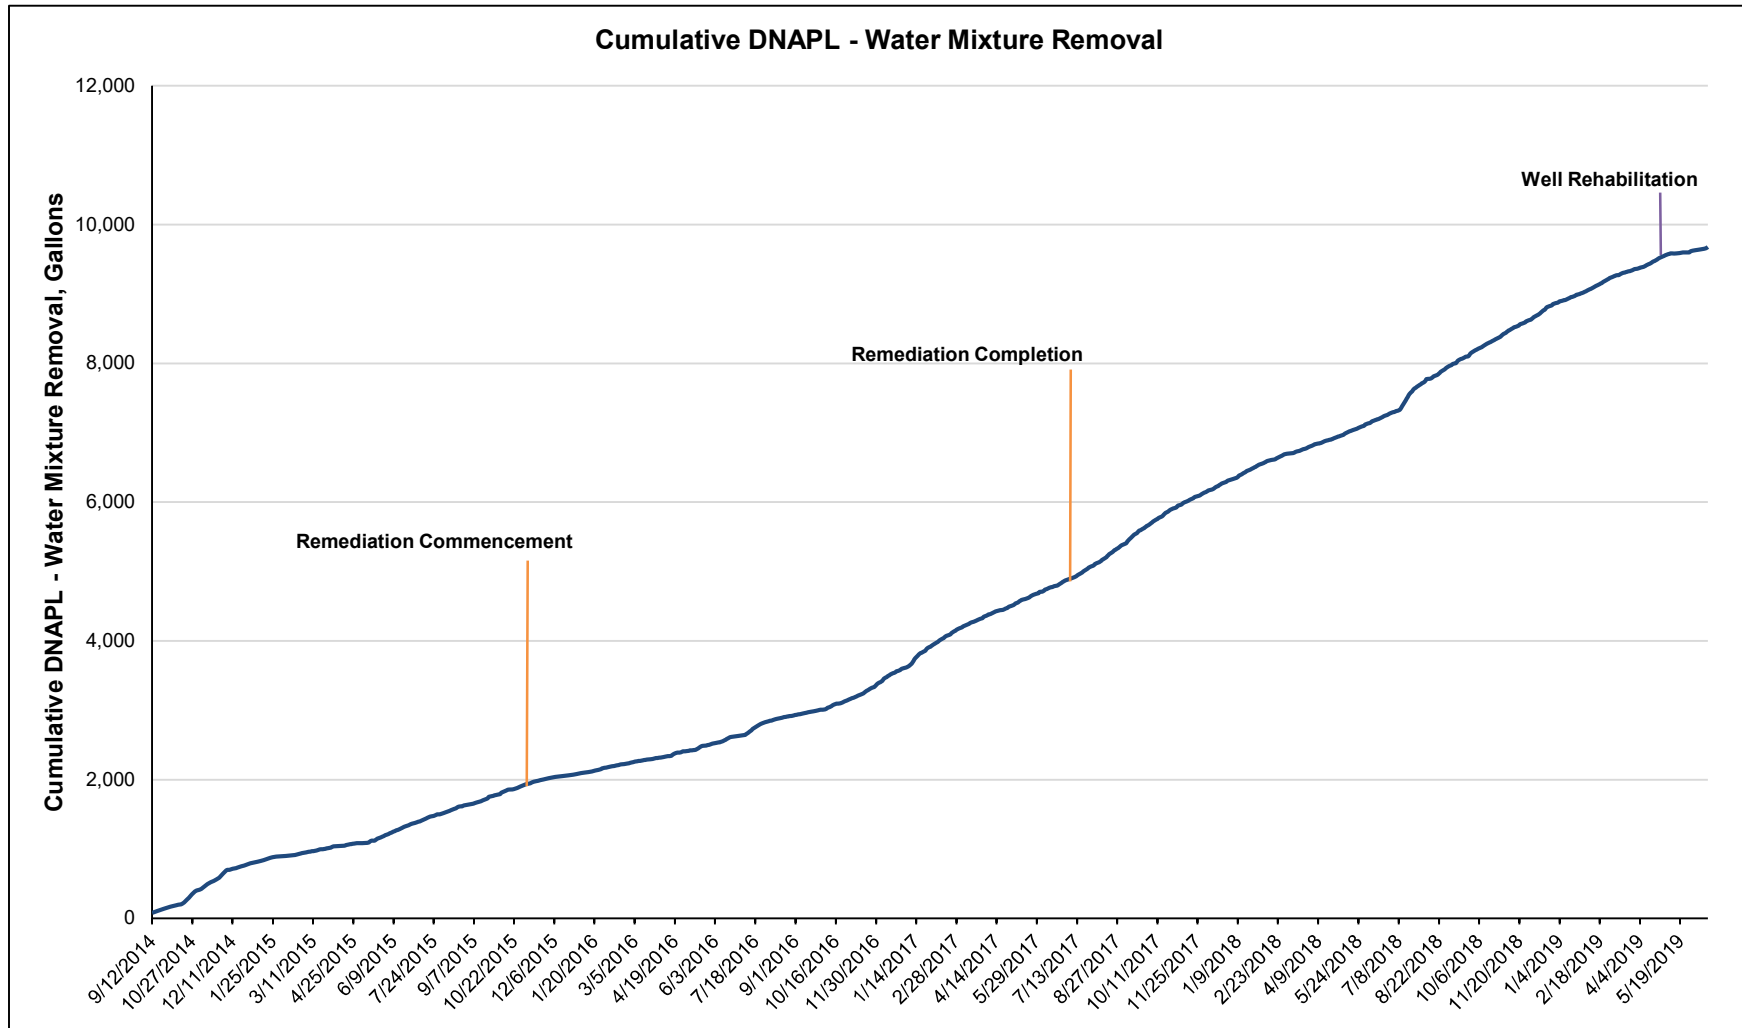


Table 3
Summary of Depth to Bottom Measurements
50 Kent Avenue Property Holder Area
Brooklyn, New York

Well ID	50 Kent Avenue Property Holder Area											
	NRW-01	NRW-01R	NRW-02	NRW-06	NRW-07	NRW-08	NRW-08R	NRW-09R	NRW-10	NRW-11R	NRW-12	NRW-13
Date	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet	feet
As-Installed	60.00	58.50	65.00	67.00	63.00	59.00	60.50	60.00	55.00	63.00	60.00	60.00
9/11/2014	60.11		64.52	66.37	61.65	58.31			53.88		59.36	59.45
12/18/2014	60.10		64.50	66.40	61.70	58.30			53.90		59.40	59.50
1/8/2015	60.10		64.50	66.50	61.70	58.30			54.30		59.40	59.50
1/15/2015	60.00		64.70	66.30	61.70	58.50			54.30		59.50	59.60
3/10/2015	NM		NM	NM	61.70	58.30			53.90		59.40	59.50
10/4/2016	59.60		64.50	66.40	NM	58.20			54.50		59.50	59.60
4/26/2017	59.50		62.80	66.40	61.90	57.80		53.50	54.30	58.20	59.40	59.60
5/31/2017	30.70*		62.40	66.50	61.30	57.80		53.20	54.10	59.40	59.40	58.40
7/5/2017	30.70*		62.45	66.45	59.35	57.61		52.96	54.28	58.74	59.47	58.58
8/28/2017	30.70*		62.40	66.50	59.50	57.50		53.10	53.90	58.80	59.60	58.50
11/1/2017	29.80*		62.60	66.30	61.22	56.10		53.50	54.00	58.43	59.85	59.83
11/10/2017	30.75*		62.50	66.31	59.35	57.34		53.33	53.81	58.21	59.14	58.21
1/12/2018	29.45*		62.97	66.50	59.42	58.55		53.11	54.00	58.45	59.00	58.58
2/12/2018	29.55*		62.59	66.50	59.80	57.48		53.00	54.10	58.53	59.70	58.61
3/16/2018	NM		NM	NM	59.50	NM		52.95	NM	58.53	59.40	58.50
4/11/2018	30.70*		62.46	66.41	59.38	28.75*		52.96	53.96	58.48	59.48	58.42
5/2/2018	30.70*		62.30	66.40	59.40	27.00*		52.93	53.94	58.62	54.65	58.49
6/13/2018	30.70*		62.50	66.40	59.40	NM		53.10	54.70	58.80	59.60	58.50
8/8/2018	30.80*		62.55	66.50	59.40	28.55*		53.29	53.89	58.60	59.84	59.96
9/24/2018	30.90*		62.51	66.48	59.45	28.78*		53.28	53.91	59.00	59.84	59.98
10/12/2018	30.80*		62.61	66.60	59.49	28.75*		53.38	53.90	58.97	59.73	59.90
11/2/2018	30.78*		62.20	66.50	59.48	28.70*		53.40	54.01	58.95	59.75	59.96
12/3/2018	30.81*		62.69	66.51	59.30	28.40*		53.39	53.88	58.97	59.63	59.89
1/2/2019	30.72*		62.79	66.53	59.41	28.41*		53.39	54.01	58.99	59.59	59.90
2/4/2019	30.73*		62.31	66.61	59.51	28.69*		53.24	54.04	59.94	59.39	59.60
3/6/2019	30.70*		62.42	66.61	59.50	28.72*		53.28	54.17	59.81	59.71	58.60
4/5/2019	30.73*		62.50	67.00	59.71	28.43*		53.23	54.50	59.68	59.70	58.60
5/1/2019	30.80*		62.60	66.46	59.51	28.70*		53.27	54.30	59.66	59.69	58.60
5/10/2019			64.12	NM	59.50			57.85	53.99	62.50	59.56	NM
5/29/2019		58.35	64.02	66.40	61.30		59.90	58.50	54.85	62.35	59.55	59.20
6/5/2019		58.30	64.10	66.39	61.41		59.60	58.47	54.80	62.55	59.55	59.15
6/12/2019		58.32	64.20	NM	NM		NM	NM	NM	62.55	59.55	59.15
6/17/2019		58.45	64.15	66.40	61.85		59.70	58.45	54.00	62.60	59.50	59.15
6/19/2019		58.65	64.10	66.40	61.75		59.70	58.45	53.95	62.55	59.50	59.15

Notes:

NM - Not Measured

Well not operational

NRW-03, -04, -05, -09, and -11 were abandoned and replacement recovery wells NRW-09R and NRW-11R were installed in April 2017.

*NRW-01 and NRW-08 were abandoned on 5/14/19 and 5/22/19, respectively, due to obstructions that were unable to be removed. NRW-01R and NRW-08R were installed on 5/21/19 and 5/24/19, respectively, to replace NRW-01 and NRW-08, in location approved by the NYSDEC.