

BUILDING 730 (338) VAPOR MITIGATION SYSTEM BASIS OF DESIGN

AT

**IPARK 84
FORMER IBM EAST FISHKILL FACILITY**

APRIL 2020

PREPARED FOR:

**JESSICA LACLAIR
NEW YORK STATE DEPT. OF ENVIRONMENTAL CONSERVATION
DEPT. OF ENVIRONMENTAL REMEDIATION
625 BROADWAY
ALBANY, NEW YORK 12233-7013**

WALDEN ENVIRONMENTAL ENGINEERING, PLLC
Industry Leader in Environmental Engineering Consulting

———— PROACTIVE SOLUTIONS SINCE 1995 ————



Sent via email to jess.laclair@dec.ny.gov and julia.kenney@health.ny.gov

April 15, 2020

iPark0118.47

Ms. Jessica LaClair
Environmental Engineer
Division of Environmental Remediation
New York State Department of Environmental Conservation
625 Broadway
Albany, NY 12233-7013

Re: iPark 84
Former IBM East Fishkill Facility
Building 730 (338) Vapor Mitigation
System Basis of Design

Dear Ms. LaClair:

This submittal has been prepared by Walden Environmental Engineering, PLLC (“Walden”) on behalf of iPark East Fishkill LLC (iPark) to present the basis of design for the vapor mitigation system to be installed at Building 730 (formerly Building 338), located at 2070 State Route 52 in Hopewell Junction, New York, herein after referred to as the “Site”. The Site location map is presented as Figure 1. The results of an investigation conducted at Building 730 (338) in March 2019 indicated the presence of volatile organic compound (VOC) vapors below the slab and the potential for soil vapor intrusion (SVI). The results of this SVI investigation are presented in *Building 338 Sub-Slab Vapor Investigation* (GZA, September 16, 2019), which is included as an attachment in Appendix A. Therefore, a mitigation system will be installed as a preventive measure to ensure protection against soil vapor intrusion at Building 730 (338).

Site Description and Well Point Construction

iPark plans to fit-up Building 730 (338) for future occupancy by a gym, a bakery manufacturing operation, and other tenant uses to be determined. Each tenant space will be modified to suit the individual tenant needs.

A pilot mitigation test was conducted in accordance with the *Building 730 (338) Vapor Mitigation System Pilot Testing Plan* (Walden, February 11, 2020) which was verbally approved



by NYSDEC on February 12th. A copy of the Work Plan is included in Appendix A. The pilot test results establish the basis of the proposed full-scale mitigation system design.

Four (4) vacuum extraction well points were installed for the pilot test at the approximate locations shown on Figure 2 of this design plan. Twenty-four (24) vacuum pressure monitoring points were also installed, at distances of 5 ft, 10 ft, 20 ft, 30 ft, 40 ft and 50 ft from each well point. A utility mark-out was performed to clear these locations before drilling through the slab.

- The pilot test well points (PTP-1, PTP-2, PTP-3 and PTP-4) were constructed of 2-inch slotted PVC pipe connected to a solid PVC riser extending approximately one (1) foot below the bottom of the existing slab at each location. The bottom of the screened interval was capped with solid PVC. The pilot test well points were set in coarse sand and sealed with bentonite and cement.
- The pilot test microwell monitoring points consist of six-inch long stainless-steel mesh screens set in coarse sand and connected to 1/4-inch inert polyethylene tubing.

The construction details for the pilot test well points and monitoring points are provided on Figure 3 of the Work Plan. When drilling to install the pilot test points, the concrete floor slab in certain areas of Building 730 (338) (refer to the areas noted on Figure 2) were determined to be more than 30 inches thick. Therefore, no extraction points or monitoring points were installed in these areas. The floor slab thickness in the other parts of the building ranged from approximately 6 to 12 inches.

Pilot Test

Once the test well points and monitoring points were installed, a pilot test was performed on February 19, 2020 to determine the area of influence each well is capable of producing. The pilot test results help to establish the basis for the full-scale mitigation system design to ensure that the installed system will depressurize the building slab. The pilot testing was performed in accordance with the New York State Department of Health *Final Guidance for Evaluating Soil Vapor Intrusion in the State of New York* (October 2006), and the United States Environmental Protection Agency Office of Solid Waste and Emergency Response *Technical Guide for Assessing and Mitigating the Vapor Intrusion Pathway from Subsurface Vapor Sources to Indoor Air* (June 2015). These documents do not contain a specific value to define effective sub-slab depressurization. However, based on available industry guidance, achieving a pressure differential of -0.004 inches of water column (WC) across a slab is generally considered sufficient to prevent soil vapor intrusion. Therefore, the objective of the mitigation system design is to achieve and maintain a minimum differential pressure of -0.004 inches of WC across the



slab of Building 730 (338), regardless of weather conditions, barometric pressure, or HVAC operations.

Photographs taken during the pilot test are presented in Appendix B. Background pressure readings of the subsurface were taken prior to testing and are included in the pilot test data tables presented in Appendix C. During the course of the test, a regenerative blower (1 horsepower capable of delivering 40" of WC vacuum) was connected to the four pilot test points. The blower was set to varying vacuum settings and flow rates. Maximum vacuum and flow at each point depended on the integrity/seal of the floor slab in the vicinity of the point. All vacuum measurements were recorded using an Infiltec DM1 Micro-Manometer.

The raised slab area (as noted on Figure 2) was too thick to drill through even using an extension bit, therefore PTP-1 and PTP-2 were relocated outside the limits of the raised area. The floor near PTP-2 had many cracks and an open drain that limited how much vacuum and flow could be applied to the point. Based on the condition of the floor slab, mitigation efforts will include sealing cracks and penetrations in the floor to eliminate vapor intrusion pathways and provide a good seal to promote the propagation of the vacuum beneath the slab.

The vacuum readings collected during the pilot test are included in the tables in Appendix C. The data from each pilot test point was plotted under an applied vacuum ranging from 5 to 40 inches of WC with accompanying trendlines; these plots are also included in Appendix C. Based upon the results, each pilot test point produced an approximate radius of influence of 30 feet at an applied vacuum of only 15 inches of WC.

Soil Vapor Mitigation System Design

Based on the pilot test results, the proposed full-scale vacuum extraction system design includes the following:

- Sealing cracks, seams and penetrations in the floor slab to eliminate vapor intrusion pathways, increase propagation of the sub-slab vacuum and maximize the area of influence produced by each leg of the mitigation system. A floor sealer or polyurethane caulk may be used to seal visible cracks. iPark will consult with the Building 730 (338) tenants to determine other floor sealing methods.
- 17 vacuum extraction well points as shown on Drawing 2, based on a 40-foot radius of influence at each point as discussed below.
- At least 10 monitoring points from currently installed locations to remain.



- Each well point will be equipped with a RadonAway HS5000 fan capable of producing approximately 40" of WC and a RadonAway Checkpoint IIAR Mitigation System Monitor Remote Alarm P#28001-4 (refer to the cut sheets provided in Appendix D).
- Pressure gauges and system controls to manage each well point.

The radon fans, alarms and system gauges/controls will be mounted on the existing building columns and enclosures will be installed to protect and restrict access to the system components. All of the vacuum extraction points and monitoring points will be located outside the raised floor slab area, as it is not feasible to install these points through the 30+-inch thick slab in this area. Given the extent of the raised floor area, the vacuum extraction wells may not create a continuous vacuum beneath the entire raised area. However, considering the thickness of the raised slab and the elimination of all cracks, seams and penetrations in the slab, there will be no pathway for soil vapor intrusion through the slab.

Based on the 30-foot radius of influence observed during the pilot testing, approximately 25 vacuum extraction well points would be needed to depressurize the slab. However, once the floor is sealed and the full-scale system is in operation, the radius of influence at each point is expected to be at least 40 feet; the proposed design layout shown on Drawing 2 is based on a 40-foot radius of influence. Walden proposes to test the radius of influence after the floor is sealed to determine the actual radius; the number of vacuum extraction points and locations will be adjusted accordingly based on actual field conditions and the tenant space layout. As-built drawings for the full-scale system installation will be submitted to NYSDEC/NYSDOH after construction is completed. In addition, start-up testing results documenting the systems effectiveness will be submitted to NYSDEC/NYSDOH.

Operation and Maintenance

All mechanical aspects of the mitigation system will be visually inspected on a routine basis, and repaired as needed, to ensure proper function. Following the initial startup of the system and stabilization of vacuum readings, routine inspections, monitoring, and maintenance will be conducted on a periodic basis.

The vacuum at the monitoring points will be measured at the time of startup to confirm that the mitigation system effectively depressurizes the slab beneath Building 730 (338). All system PID screening and gauge readings will be collected for subsequent reporting. The frequency of the monitoring shall be evaluated at start-up and/or as directed by NYSDEC/NYSDOH.

Given the tenants' desire to take occupancy as soon as possible, iPark is ready to move forward with the installation of the system described herein upon authorization from the State. Therefore,

Ms. Jessica LaClair
Building 730 (338) Basis of Design
April 15, 2020

- 5 -



we respectfully request that NYSDEC and NYSDOH prioritize issuing its authorization to proceed with the finalization of the system described within this report.

Please call me at (516) 624-7200 if you have any questions or need any additional information.

Very truly yours,
Walden Environmental Engineering, PLLC

Nora M. Brew, P.E.
Senior Project Manager

cc: J. Kenney, NYSDOH
M. Buckley, iPark
C. Monheit, iPark
D. Chartrand, IBM

Enclosures

Figure 1 – Site Location Map
Figure 2 – Pilot Test Well Point and Monitoring Point Locations
Figure 3 – Well Point and Monitoring Point Details

Appendix A – *Building 730 (338) Vapor Mitigation System Pilot Testing Plan* (Walden, February 11, 2020)

Appendix B – Building 338 Pilot Test Photo Log (February 19, 2020)

Appendix C – Pilot Test Results Table and Plots (February 19, 2020)

Appendix D – RadonAway HS5000 Cut Sheet and Alarm

Z:\iPark0118\iPark0118.47 - B338 SSDS Testing and Design\Vapor Mitigation System\Building 730 (338) Vapor Mitigation System Basis of Design 4.15.2020.docx



SITE PLAN
NOT TO SCALE

REVISION		COMMENTS
No.	DATE	

FOR: BUILDING 730 (FORMER 338)
iPark 84 Campus
2070 State Route 52
Hopewell Junction, NY 12533

DESIGNED BY: NMB
APPROVED BY: JMH



DRAWN BY: EJK
SCALE: AS NOTED

DRAWING TITLE:
SITE PLAN
BUILDING 338-VAPOR MITIGATION
SYSTEM

JOB NO: IPARK118.47
DATE: 4/13/20
CAD FILE NAME: Z:\IPARK\0118\IPark0118.47 - 5338 SDDs Testing and Design\ACAD\IPark Building Building 730 338_SDDs_JMS.dwg

FIGURE NO:
1
REVISION NO:
0

ISSUED

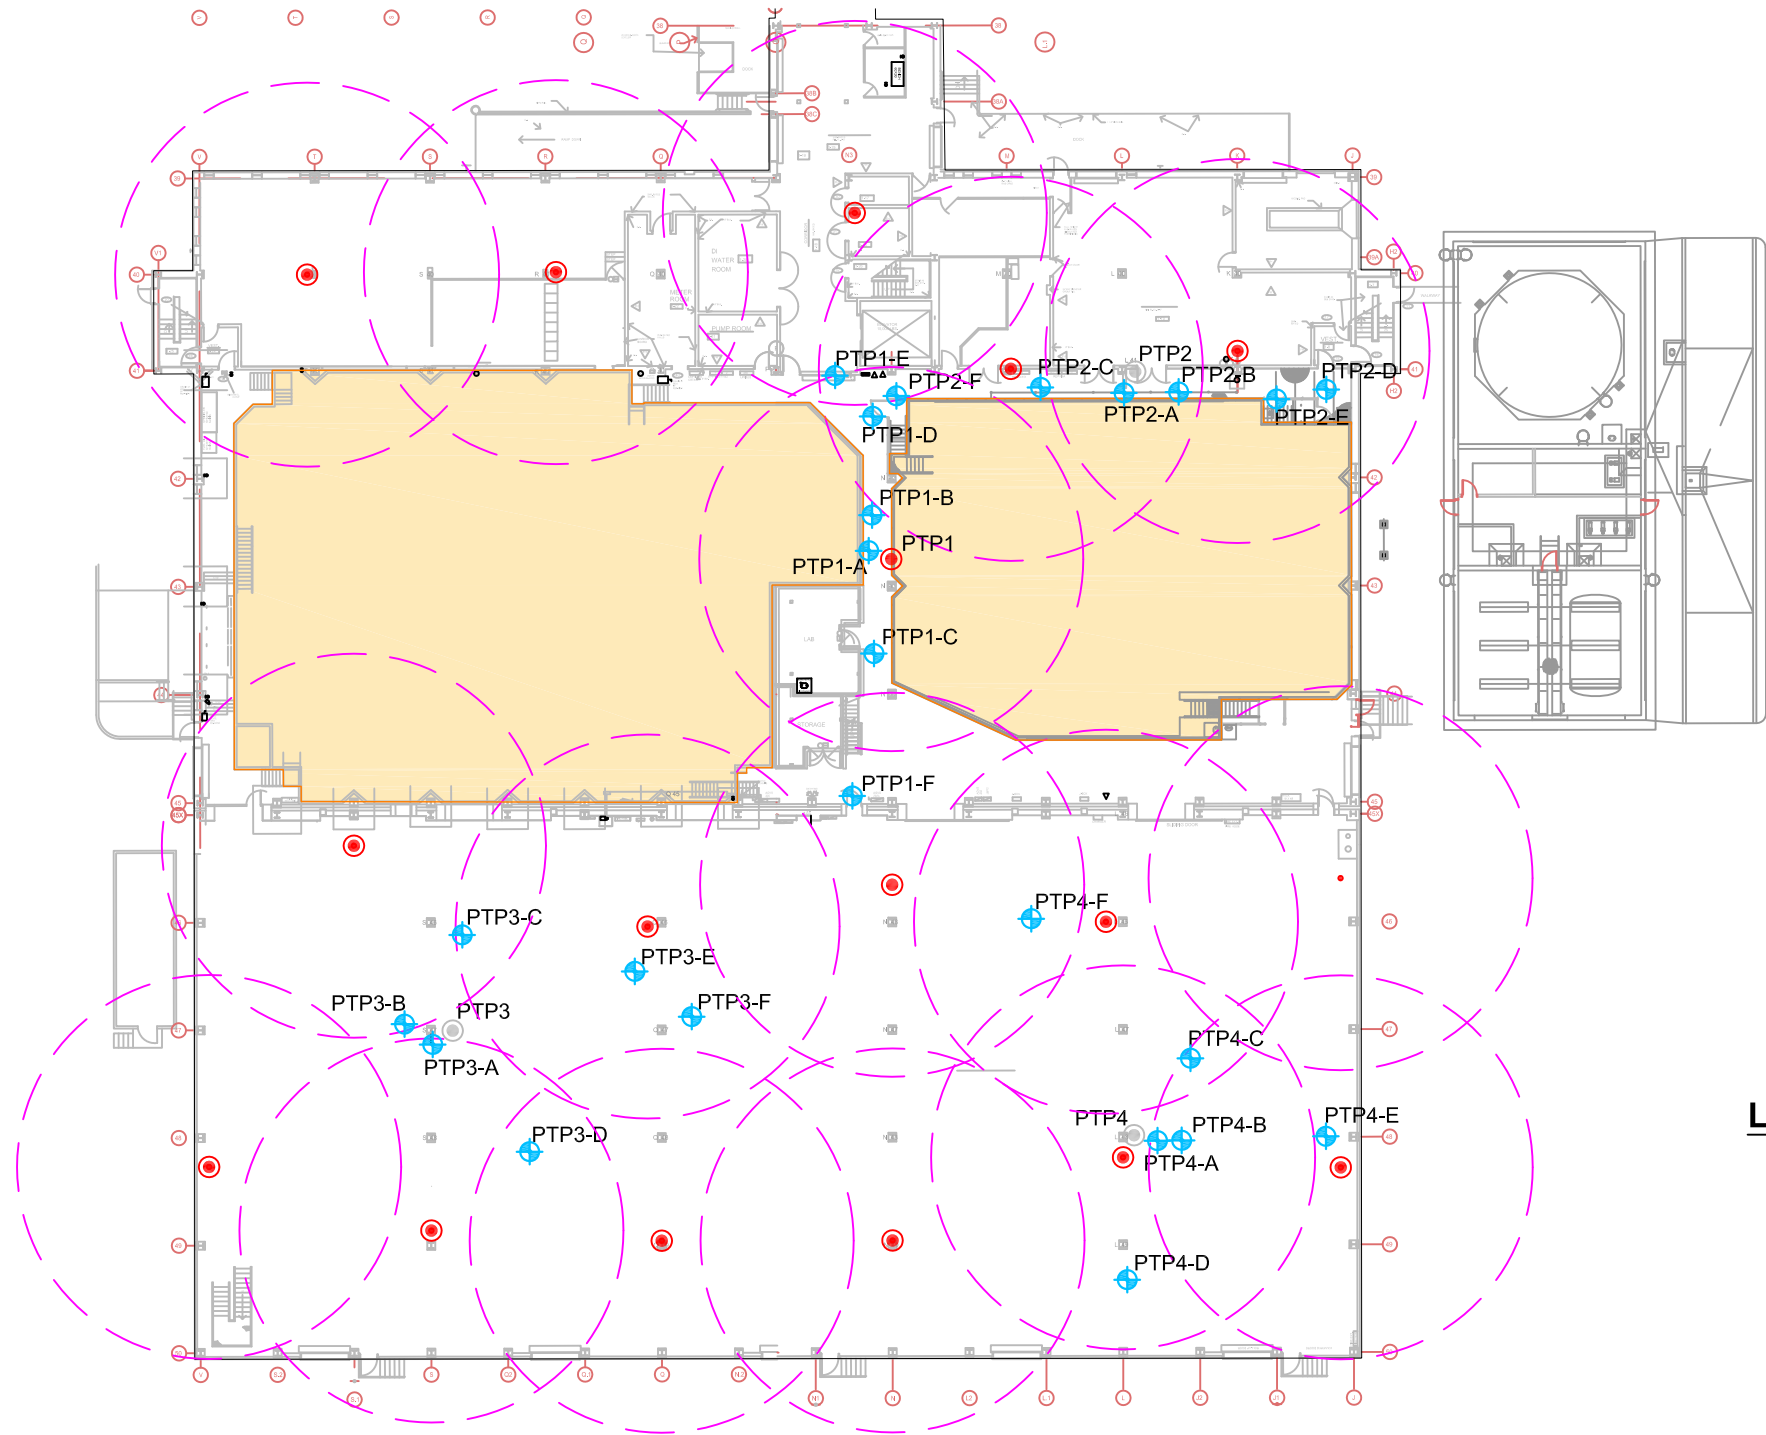

LEGEND

- CURRENTLY INSTALLED MONITORING POINTS
- PROPOSED EXTRACTION WELL POINTS
- 40 FOOT RADIUS OF INFLUENCE
- PILOT TEST WELL POINTS
- RAISED SLAB AREA

BLDG 730 (FORMERLY 338)
PROPOSED WELL POINT LOCATIONS
SCALE=1"=40'



WALDEN ENVIRONMENTAL ENGINEERING, PLLC
16 SPRING STREET
OYSTER BAY, NEW YORK 11771
P: (516) 624-7200 F: (516) 624-3219
WWW.WALDENENVIRONMENTALENGINEERING.COM

• UNAUTHORIZED ALTERATION OR ADDITION TO THIS PLAN IS A VIOLATION OF SECTION 7209 OF NEW YORK STATE EDUCATION LAW.
• COPIES OF THIS PLAN NOT BEARING THE PROFESSIONAL ENGINEER'S INKED SEAL OR EMBOSSED SEAL SHALL NOT BE CONSIDERED TO BE A VALID TRUE COPY.

REVISION		COMMENTS
No.	DATE	

FOR: BUILDING 730 (FORMER 338)
iPark 84 Campus
2070 State Route 52
Hopewell Junction, NY 12533

DESIGNED BY: NMB DRAWN BY: JMS
APPROVED BY: JMH SCALE: AS NOTED

DRAWING TITLE:
PROPOSED WELL POINT LOCATIONS
BUILDING 338-


JOB NO: IPARK118.47 DATE: 4/16/2020 11x17 SHEET NO: 2 OF 2
CAD FILE NAME: Z:\IPARK\0118\IPark\0118.47 - 6338 SDDS Testing and Design\ACAD\IPark Building Building 730 338_SDDS_RMS_041620.dwg

FIGURE NO:

2

ISSUED


REVISION NO:
0

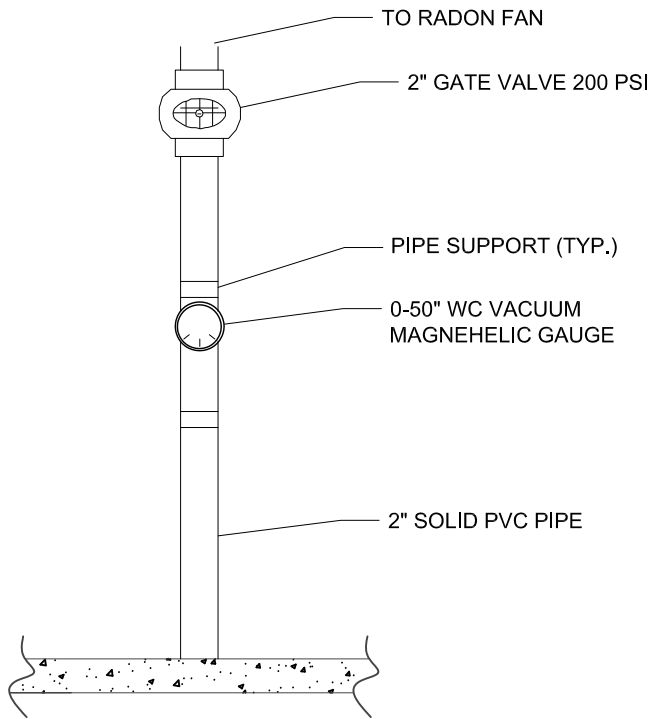


PIPING CONFIGURATION DETAIL
NOT TO SCALE

TYPICAL EXTRACTION POINT DETAIL NOTES:

- 1. MAGNEHELIC GAUGE SHALL BE DWYER INSTRUMENTS MODEL #2050 OR APPROVED EQUAL, AND SHALL INCLUDE A-610 PIPE MOUNT KIT OR APPROVED EQUAL.
- 2. THREADED JOINTS SHALL BE MADE WITH TEFLON THREAD SEALANT TAPE TO BE VACUUM AND/OR PRESSURE TIGHT. THREAD SEALANT LIQUIDS OR PASTES SHALL NOT BE USED.
- 3. INSTALL SUITABLE HANGERS/SUPPORTS WITHIN 2 FEET OF EACH SIDE OF A PIPE JOINT. HANGERS AND/OR SUPPORTS SHOULD BE INSTALLED EVERY 10 FEET OF STRAIGHT PIPE.

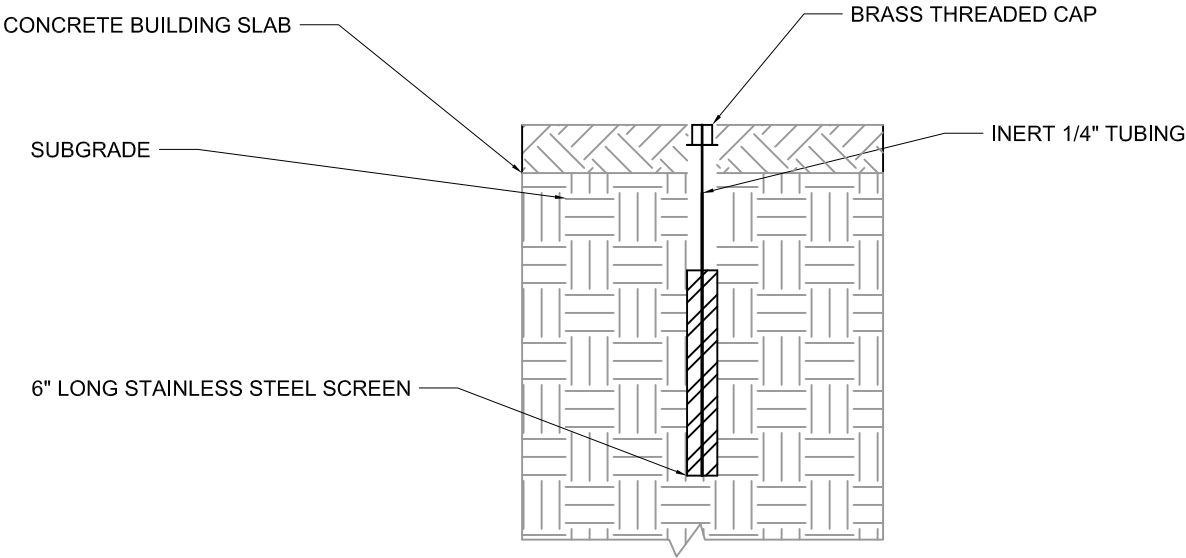

TYPICAL MONITORING POINT DETAIL
NOT TO SCALE

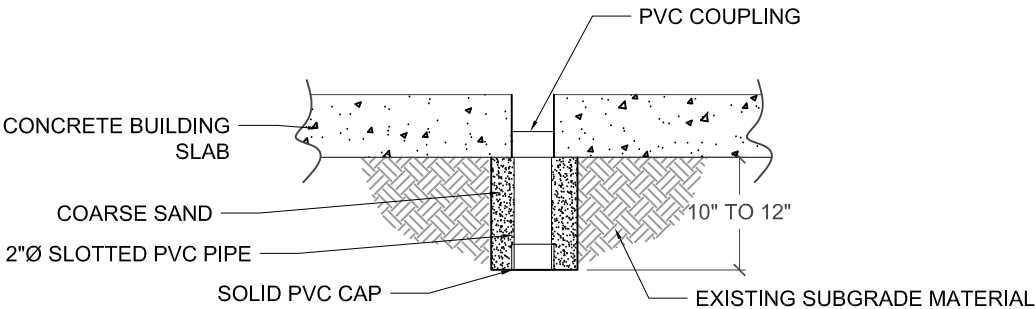

TYPICAL EXTRACTION POINT DETAIL
NOT TO SCALE

- 1. ACTUAL PIPE RUNS TO BE DETERMINED IN FIELD

REVISION		
No.	DATE	COMMENTS

FOR: BUILDING 730 (FORMER 338)	
iPark 84 Campus	
2070 State Route 52	
Hopewell Junction, NY 12533	
DESIGNED BY: NMB	DRAWN BY: JMS
APPROVED BY: JMH	SCALE: AS NOTED

DRAWING TITLE:			FIGURE NO:		ISSUED	
<u>VAPOR EXTRACTION WELL</u> <u>AND MONITORING WELL</u> <u>DETAILS</u>			3		REVISION NO:	
					0	
JOB NO: IPARK118.47		DATE: 4/16/2020	11x17	SHEET NO: 2 OF 2		
CAD FILE NAME: Z:\Park0118\Park0118.47 - 5338 SSDS Testing and Design\ACAD\Park Building Building 730 338_SSDS_RMS_041620.dwg						

APPENDIX A

BUILDING 730 (338) VAPOR MITIGATION SYSTEM PILOT TESTING PLAN
(Walden, February 11, 2020)

**BUILDING 730 (FORMERLY BUILDING 338)
VAPOR MITIGATION SYSTEM TESTING PLAN**

AT

**IPARK 84
FORMER IBM EAST FISHKILL FACILITY**

FEBRUARY 2020

PREPARED FOR:

**JESSICA LACLAIR
NEW YORK STATE DEPT. OF ENVIRONMENTAL CONSERVATION
DEPT. OF ENVIRONMENTAL REMEDIATION
625 BROADWAY
ALBANY, NEW YORK 12233-7013**

WALDEN ENVIRONMENTAL ENGINEERING, PLLC

Industry Leader in Environmental Engineering Consulting

———— PROACTIVE SOLUTIONS SINCE 1995 ————



Sent via email to jess.laclair@dec.ny.gov and julia.kenney@health.ny.gov

February 11, 2020
iPark0118.47

Ms. Jessica LaClair
Environmental Engineer
Division of Environmental Remediation
New York State Department of Environmental Conservation
625 Broadway
Albany, NY 12233-7013

Re: iPark 84
Former IBM East Fishkill Facility
Building 730 (338) Vapor Mitigation
System Pilot Testing Plan

Dear Ms. LaClair:

This submittal has been prepared by Walden Environmental Engineering, PLLC (“Walden”) on behalf of iPark East Fishkill LLC (iPark) to present the pilot testing plan as part of the mitigation system design for Building 730 (formerly Building 338), located at 2070 State Route 52 in Hopewell Junction, New York, herein after referred to as the “Site”. The Site location map is presented as Figure 1. The results of an investigation conducted at Building 730 (338) in March 2019 indicated the presence of volatile organic compound (VOC) vapors below the slab and the potential for soil vapor intrusion (SVI). The results of this SVI investigation are presented in Attachment A: *Building 338 Sub-Slab Vapor Investigation* (GZA, September 16, 2019). Therefore, a mitigation system will be installed as a preventive measure to ensure protection against soil vapor intrusion at Building 730 (338).

iPark plans to fit-up Building 730 (338) for future occupancy by a gym, a bakery manufacturing operation, and other tenant uses to be determined. Each tenant space will be modified to suit the individual tenant needs. A pilot mitigation test will be conducted as described below to establish the basis of the full-scale mitigation system design.

Four (4) vacuum extraction well points will be installed for the pilot test at the approximate locations shown on Figure 2. Approximately 24 vacuum pressure monitoring points (installed at



distances of 5 ft, 10 ft, 20 ft, 30 ft, 40 ft and 50 ft from each well point). A utility mark-out will be performed to clear these locations before drilling through the slab.

- The pilot test well points will be constructed of 2-inch slotted PVC pipe connected to a solid PVC riser extending approximately one (1) foot below the bottom of the existing slab at each location. The bottom of the screened interval will be capped with solid PVC. The Building 730 (338) slab is expected to range from 6 to 12 inches thick based on the site conditions encountered during the March 2019 SVI investigation. The pilot test well points will be set in coarse sand and sealed with bentonite and cement.
- The pilot test microwell monitoring points will consist of six-inch long stainless-steel mesh screens set in coarse sand and connected to 1/4-inch inert polyethylene tubing.

The construction details for the pilot test well points and monitoring points are provided on Figure 3. The locations of the well points and monitoring points will be adjusted as needed based on field conditions.

Once the test well points and monitoring points are installed, a pilot test will be performed to determine the area of influence each well is capable of producing. The pilot test results will establish the basis for the full-scale mitigation system design to ensure that the installed system will depressurize the entire building slab. The pilot testing will be performed in accordance with the New York State Department of Health *Final Guidance for Evaluating Soil Vapor Intrusion in the State of New York* (October 2006), and the United States Environmental Protection Agency Office of Solid Waste and Emergency Response *Technical Guide for Assessing and Mitigating the Vapor Intrusion Pathway from Subsurface Vapor Sources to Indoor Air* (June 2015). These documents do not contain a specific value to define effective sub-slab depressurization. However, based on available industry guidance, achieving a pressure differential of -0.004 inches of water column (WC) across a slab is generally considered sufficient to prevent soil vapor intrusion. Therefore, the objective of the mitigation system design will be to achieve and maintain a minimum differential pressure of -0.004 inches of WC across the slab of Building 730 (338), regardless of weather conditions, barometric pressure, or HVAC operations.

Atmospheric conditions during the pilot test will be recorded along with any observations that may impact interpretation of the pilot test results. Background pressure readings will be collected prior to the testing. A vacuum blower (1.5 horsepower capable of delivering 59" inches of WC vacuum and a maximum flow rate of 120 SCFM) will be connected to the vacuum extraction well points during the test. The blower will be set to varying pressures and flow rates. Pressure readings will be recorded from each monitoring point utilizing a micromanometer.

Ms. Jessica LaClair
Building 730 (338) Pilot Test Plan
February 11, 2020

- 3 -



Based on the radius of influence observed during the pilot testing, the full-scale mitigation system will be designed to depressurize the entire slab. The pilot test results and full-scale system design will be submitted to NYSDEC/NYSDOH for review and approval.

iPark and its subcontractors shall adhere to the HASP that is provided in Attachment B for all activities that will be conducted under this pilot testing plan. Health and Safety air monitoring will take place during work to monitor workers' exposure. Only on-Site personnel who have received 40-hour OSHA Hazardous Waste Operations and Emergency Response (HAZWOPER) training and annual 8-hour refresher training (and have proof of certified HAZWOPER training) will be allowed in the exclusion zone and contaminant reduction zone per the HASP. Because Building 730 (338) is vacant and the proposed pilot test work will be conducted indoors, CAMP air monitoring is not required.

Given the tenant's desire to take occupancy as soon as possible, iPark is ready to move forward with the pilot testing upon authorization from the State. Therefore, we respectfully request that NYSDEC and NYSDOH prioritize issuing its authorization to proceed with the pilot test.

Please call me at (516) 624-7200 if you have any questions or need any additional information.

Very truly yours,

Walden Environmental Engineering, PLLC

Nora M. Brew, P.E.
Senior Project Manager

cc: J. Kenney, NYSDOH
M. Buckley, iPark
C. Monheit, iPark
D. Chartrand, IBM

Enclosures

- Figure 1 – Site Location Map
- Figure 2 – Proposed Well Point and Monitoring Point Locations
- Figure 3 – Well Point and Monitoring Point Details

Attachment A - Building 338 Sub-Slab Vapor Investigation (GZA, September 16, 2019)
Attachment B – Health and Safety Plan



SITE PLAN
NOT TO SCALE

REVISION		COMMENTS
No.	DATE	

FOR: **BUILDING 730 (FORMER 338)**
iPark 84 Campus
2070 State Route 52
Hopewell Junction, NY 12533

DESIGNED BY: NMB
APPROVED BY: JMH


DRAWN BY: EJK
SCALE: AS NOTED

DRAWING TITLE:
SITE PLAN
BUILDING 338-PILOT TEST

JOB NO: IPARK118.47
DATE: 2/11/20
CAD FILE NAME: Z:\iPark\0118\iPark\0118.47 - B338 5500\iPark Building Building 730 338 Pilot test.dwg


FIGURE NO:
1
REVISION NO:
0

SHEET NO: 1 OF 2

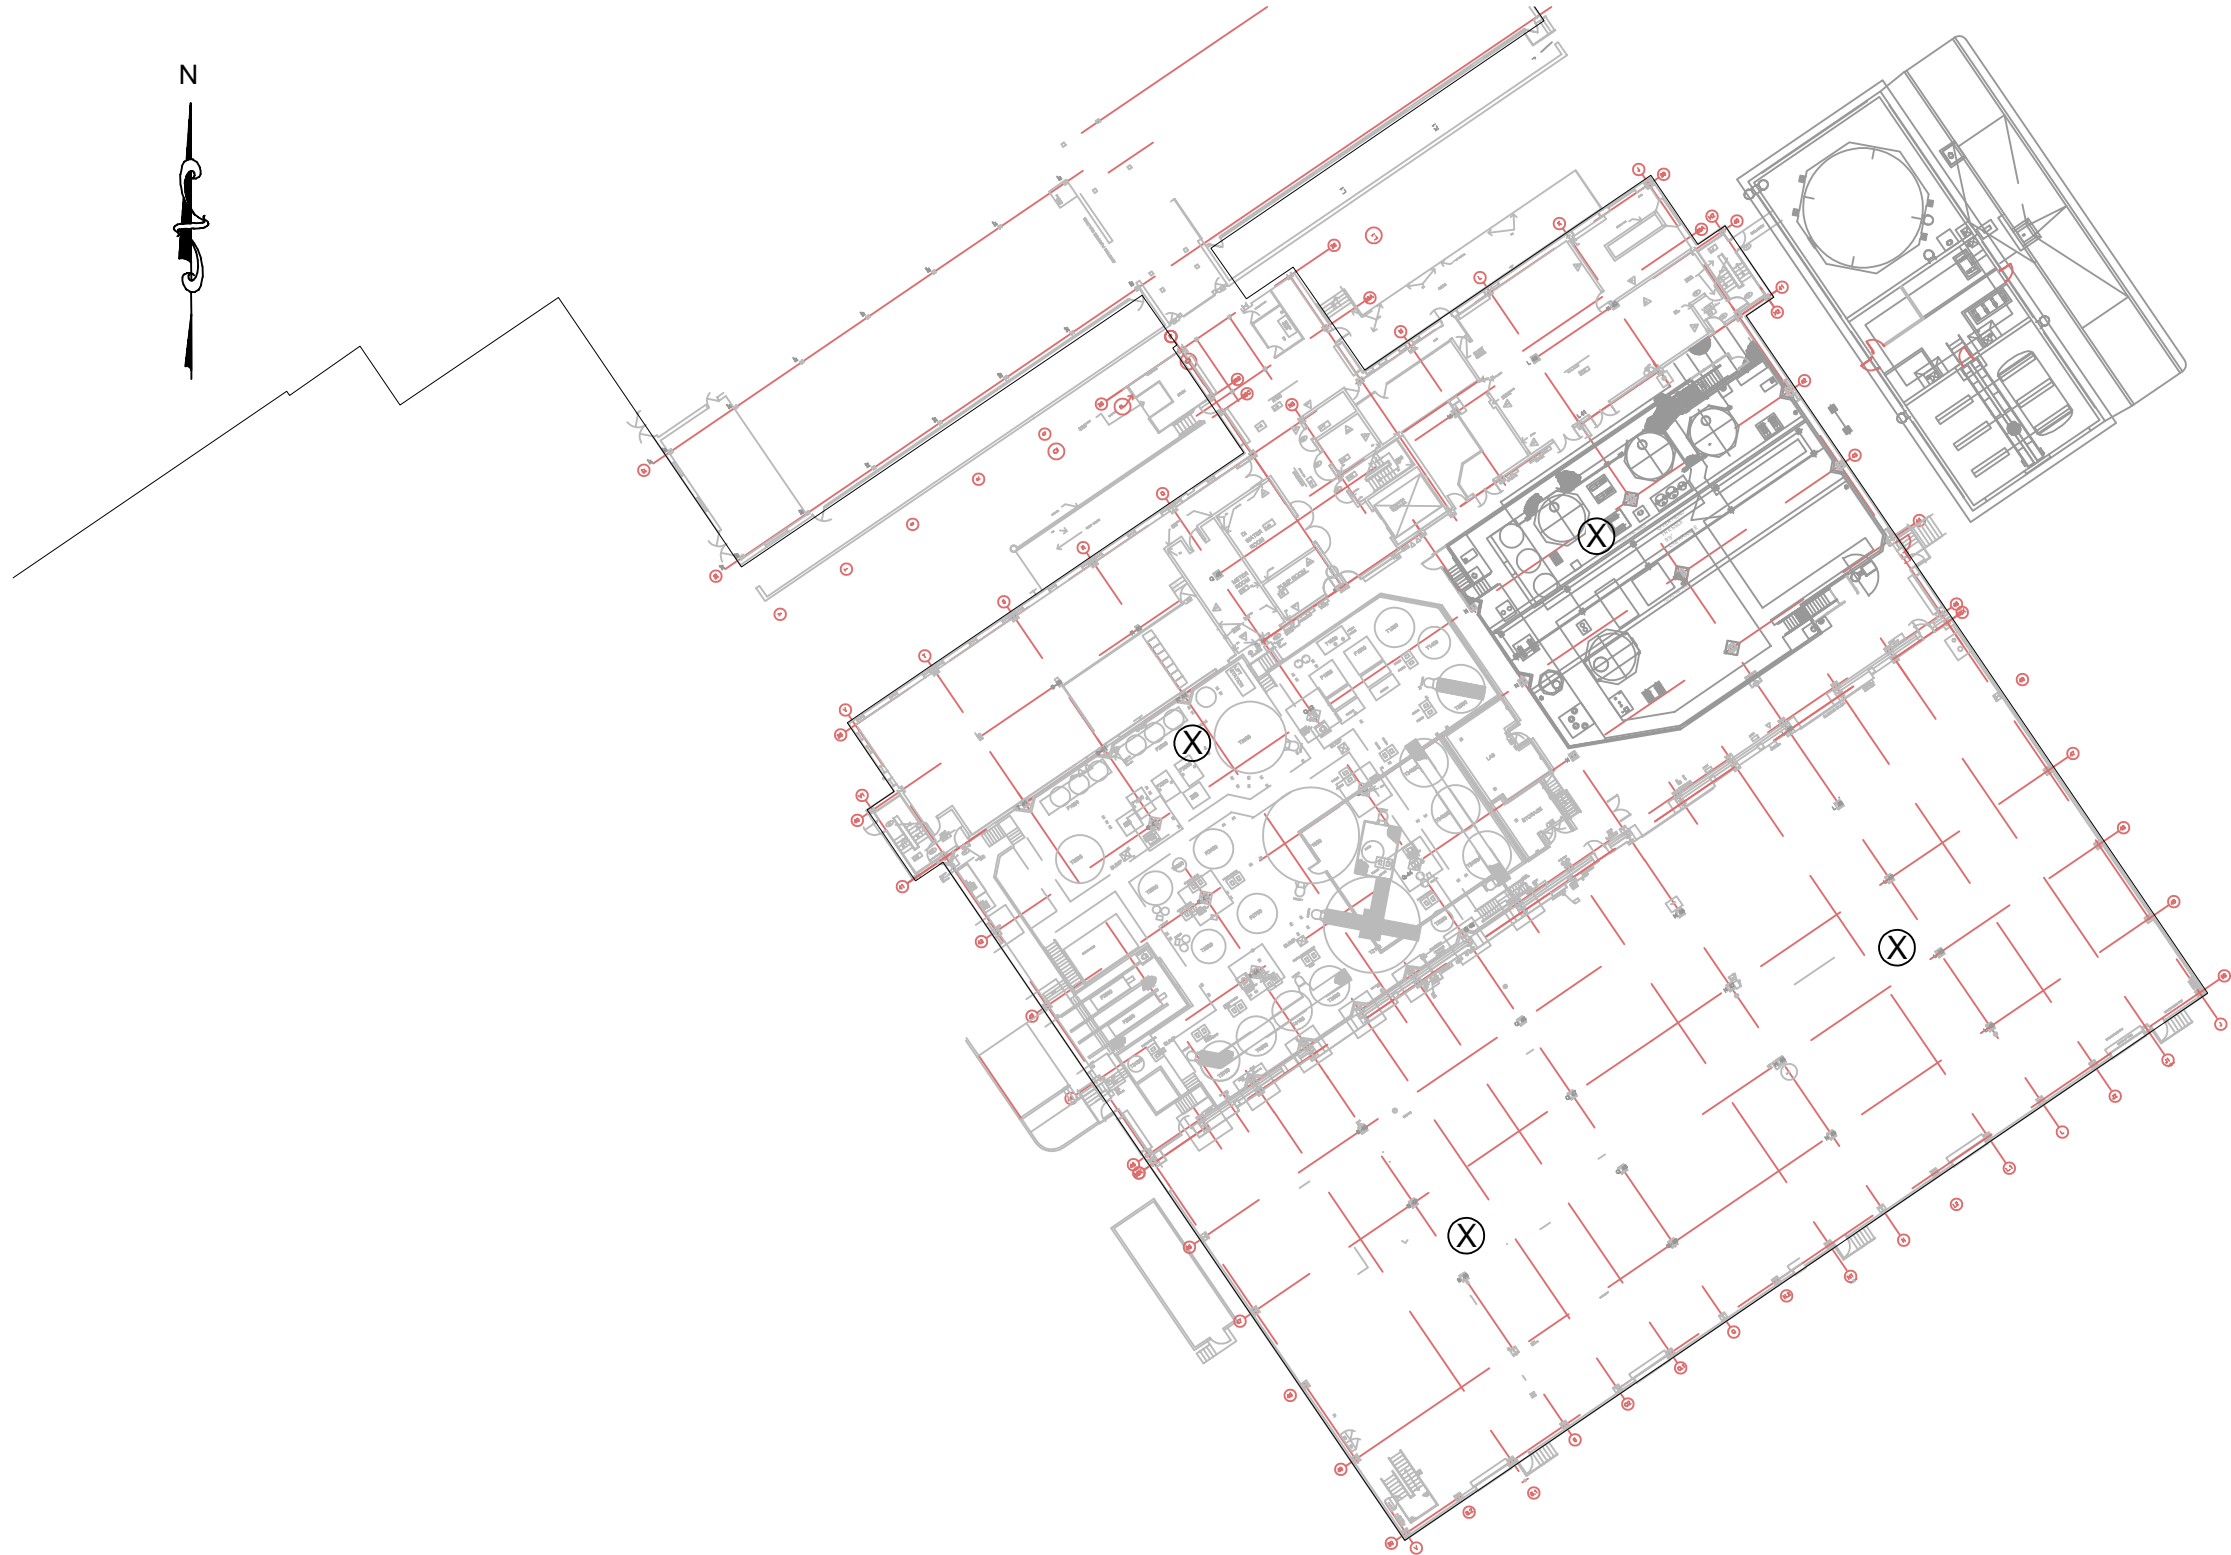

LEGEND
⊗ PROPOSED TEST WELL POINTS

BLDG 730 (FORMERLY 338)
PILOT TEST WELL POINT LOCATIONS
NOT TO SCALE



WALDEN ENVIRONMENTAL ENGINEERING, PLLC
16 SPRING STREET
OYSTER BAY, NEW YORK 11771
P: (516) 624-7200 F: (516) 624-3219
WWW.WALDENENVIRONMENTALENGINEERING.COM

• UNAUTHORIZED ALTERATION OR ADDITION TO THIS PLAN IS A VIOLATION OF SECTION 7209 OF NEW YORK STATE EDUCATION LAW.
• COPIES OF THIS PLAN NOT BEARING THE PROFESSIONAL ENGINEER'S INKED SEAL OR EMBOSSED SEAL SHALL NOT BE CONSIDERED TO BE A VALID TRUE COPY.

REVISION		
No.	DATE	COMMENTS

FOR: **BUILDING 730 (FORMER 338)**
iPark 84 Campus
2070 State Route 52
Hopewell Junction, NY 12533

DESIGNED BY: NMB
APPROVED BY: JMH

DRAWN BY: EJK
SCALE: AS NOTED

DRAWING TITLE:
WELL POINT LOCATIONS
BUILDING 338- PILOT TEST


FIGURE NO:
2

ISSUED
0

REVISION NO:
0


JOB NO: IPARK118.47
DATE: 2/11/20
SHEET NO: 2 OF 2

CAD FILE NAME: Z:\IPark\0118\IPark\0118.47 - B338 SSOS\IPark Building Building 730 338 Pilot test.dwg

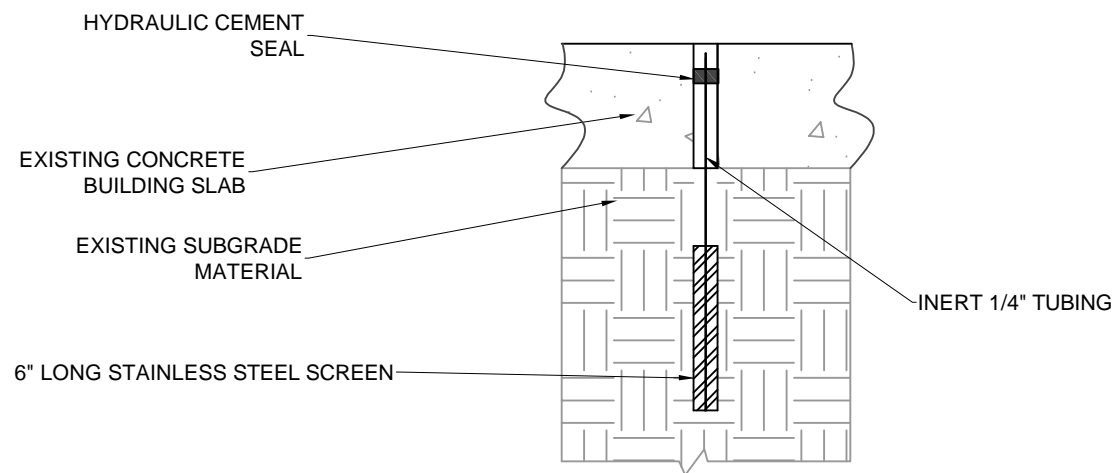

TYPICAL MONITORING POINT DETAIL

SCALE: N.T.S.

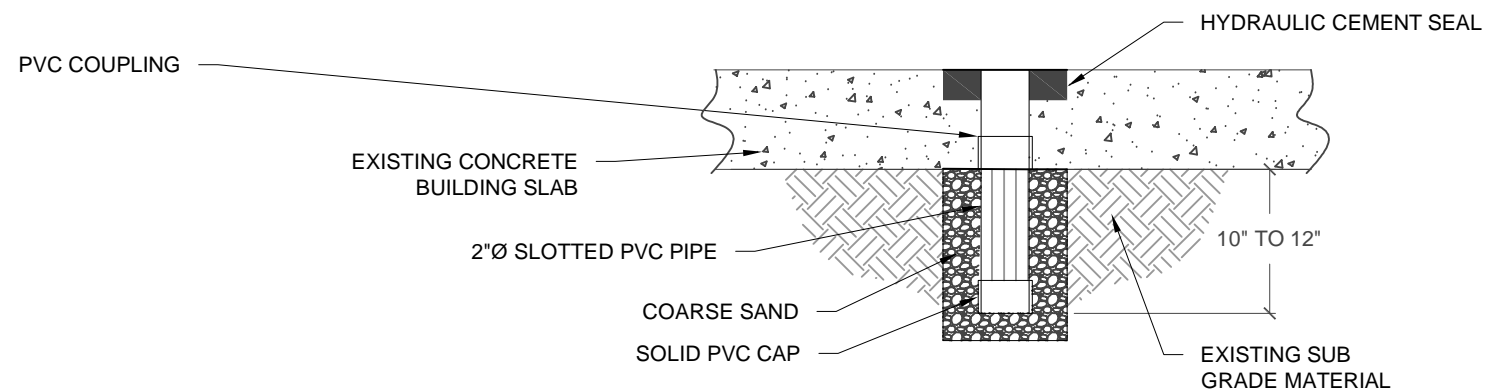

TYPICAL TEST WELL POINT DETAIL

SCALE: N.T.S.



WALDEN ENVIRONMENTAL ENGINEERING, PLLC
16 SPRING STREET
OYSTER BAY, NEW YORK 11771
P: (516) 624-7200 F: (516) 624-3219

WWW.WALDENENVIRONMENTALENGINEERING.COM

• UNAUTHORIZED ALTERATION OR ADDITION TO THIS PLAN IS A VIOLATION OF SECTION 7209 OF NEW YORK STATE EDUCATION LAW.
• COPIES OF THIS PLAN NOT BEARING THE PROFESSIONAL ENGINEER'S INKED SEAL OR EMBOSSED SEAL SHALL NOT BE CONSIDERED TO BE A VALID TRUE COPY.

REVISION		
No.	DATE	COMMENTS

FOR: **BUILDING 730 (FORMER 338)**
iPark 84 Campus
2070 State Route 52
Hopewell Junction, NY 12533

DESIGNED BY: NMB
APPROVED BY: JMH

DRAWN BY: EJK
SCALE: AS NOTED

DRAWING TITLE:
FIGURE 3 - DETAILS
BUILDING 338- PILOT TEST

JOB NO: IPARK118.47
DATE: 2/11/20

DRAWING NO:
3
SHEET NO: 3 OF 3

ISSUED
REVISION NO:
0

ATTACHMENT A

BUILDING 338 SUB-SLAB VAPOR INVESTIGATION (GZA, SEPTEMBER 16, 2019)



Known for excellence.
Built on trust.

GEOTECHNICAL
ENVIRONMENTAL
ECOLOGICAL
WATER
CONSTRUCTION
MANAGEMENT

GZA GeoEnvironmental of
New York
104 West 29th Street
10th Floor
New York, NY 10001
T: 212.594.8140
F: 212.279.8180
www.gza.com



September 16, 2019
File No. 12.0076252.10

Jessica LaClair
Environmental Engineer
Division of Environmental Remediation
New York State Department of Environmental Conservation
625 Broadway
Albany, NY 12233-7013

Re: Building 338 Sub-Slab Vapor Investigation
Former IBM East Fishkill Facility, Hopewell Junction, NY
NYSDEC Site No. 314054, EPA ID NYD000707901

Dear Ms. LaClair

GZA GeoEnvironmental of New York (GZA) has prepared this letter on behalf of i.park84, LLC to detail the collection of sub-slab soil gas and indoor air samples within Building 338 at the Former IBM East Fishkill Facility located at 2070 Route 52, Hopewell Junction, NY (Site). The objective of the sampling was to evaluate the sub-slab soil vapor and indoor air within Building 338 in order to assess the potential for soil vapor intrusion. Future sampling will be conducted to evaluate the potential exposures to Site-related contaminants via the soil vapor intrusion pathway for future occupants once the building remodeled and the heating ventilation and air conditioning (HVAC) is operational. Investigation activities were conducted in accordance GZA's March 6, 2019 Sub-Slab Vapor Investigation Work Plan – Building 338 (Work Plan) approved by the New York State Department of Environmental Conservation (NYSDEC) on March 15, 2019, except where otherwise noted.

FIELD INVESTIGATION ACTIVITIES

The field investigation activities included a pre-sampling building inspection, installation of permanent sub-slab vapor monitoring points, and the collection and analysis of sub-slab soil vapor, indoor air and ambient air samples.

BUILDING INSPECTION

GZA conducted a pre-sampling inspection of Building 338 on June 16, 2019 to evaluate the condition of the slab as well as to identify materials currently or historically stored or used within the building that have a potential to be a source of volatile chemicals.



The interior building slab was observed to be in good condition with minimal cracking. GZA observed raised areas constructed of concrete within the first floor of the building (**Figure 1**). It is unknown if these raised areas are filled with concrete or other fill material (e.g., soil). These areas were elevated approximately 24 inches above the slab.

During the inspection, GZA observed metal working operations in the eastern portion of the building. GZA did not observe other operations involving materials/chemicals that could interfere with the proposed sampling. GZA did observe a supply of cleaning materials in the southern portion of the Building in the vicinity of SS-01. These materials were moved to the western portion of the Building to be kept at a distance from the proposed indoor air sampling locations during sampling. A copy of the completed New York State Department of Health (NYSDOH) Indoor Air Quality Questionnaire and Building Inventory can be found in **Attachment A**.

SUB-SLAB VAPOR MONITORING POINT INSTALLATION

On June 16, 2019, permanent sub-slab vapor monitoring points (SS-01 through SS-04) were installed within Building 338. The locations of SS-02 and SS-03 were relocated from the locations identified in the Work Plan due to the presence of the elevated concrete surfaces.

The sub-slab vapor monitoring points were constructed by coring an approximate 3-inch diameter hole through the concrete floor slab and installing a 2-inch-diameter by approximately 1.5-ft-long 20-slot schedule 40 PVC screen equipped with a capped port flush with the existing slab. Sub-slab vapor monitoring points were installed approximately 12-inches below the slab. The sub-slab vapor monitoring points were sealed with a mixture of bentonite and cement and installed flush with the existing slab. **Figure 1** depicts the location of the sub-slab vapor monitoring points.

SAMPLING AND ANALYSIS

On June 17, 2019, GZA mobilized to the Site to perform leak testing and to collect air samples. Helium integrity testing was performed on each sub-slab vapor monitoring points in accordance with the Work Plan.

Following completion of leak testing, the following samples were collected:

- One sub-slab soil vapor sample from each sub-slab vapor monitoring point (SS-01 through SS-04);
- One co-located indoor air sample in the vicinity of each sub-slab vapor monitoring point (IA-01 through IA-04);
- Two ambient air samples on the exterior of Building 338 (AA-01 and AA-02); and
- One duplicate ambient air sample (DUP-06181) at sample location AA-01.

Sampling was conducted in accordance with the NYSDEC-approved Work Plan. Collection of sub-slab vapor samples and indoor air samples was conducted over 30 minutes. During sampling, GZA noted that multiple loading dock doors on the east, west and south walls of Building 338 were periodically opened/closed. GZA



requested that this activity be kept to a minimum and continued with the indoor air sampling. Ambient air samples were collected from an upwind (AA-01) and downwind (AA-02) location over 30 minutes. A duplicate sample was collected at location AA-01. Samples were analyzed by Alpha Analytical by U.S. Environmental Protection Agency (EPA) method TO-15. **Figure 1** depicts the sample locations.

RESULTS

The analytical results of the sub-slab soil vapor and indoor air samples were compared to the Soil Vapor/Indoor Air Matrices provided in NYSDOH's Guidance for Evaluating Soil Vapor Intrusion in the State of New York. Based on the concentrations detected in sub-slab soil vapor and indoor air, the Soil Vapor/Indoor Air Matrix indicates no further action for constituents other than PCE.

Tetrachloroethene (PCE) exceeded the sub-slab vapor matrix value of $100 \mu\text{g}/\text{m}^3$ at all samples (SS-01 through SS-04) with detected concentrations of 104, 204, 213 and $1010 \mu\text{g}/\text{m}^3$, respectively. However, PCE was below the indoor air matrix value of $3 \mu\text{g}/\text{m}^3$ in all samples (IA-01 through IA-04) with concentrations of 0.305, 0.278, 0.332 and $0.305 \mu\text{g}/\text{m}^3$ respectively. Based on the PCE concentrations detected at SS-04 ($1010 \mu\text{g}/\text{m}^3$) and IA-04 ($0.305 \mu\text{g}/\text{m}^3$), the recommended action indicated on the Soil Vapor/Indoor Air Matrix is mitigation. Based on the PCE concentrations detected at SS-01 through SS-03 and IA-01 through IA-03, no further action is indicated on the Soil Vapor/Indoor Air Matrix. However, as noted earlier, possible interference (increased ventilation from the opening of the loading dock doors) occurred during the indoor air sampling.

The results of the indoor air samples (IA-01 through IA-04) were compared to Table C-1 2003 Upper Fence Study of Volatile Organic Chemicals in air of Fuel Oil Heated Homes for Indoor Air, Table C-2 2001 USEPA BASE 90th Percentile for Indoor Air, Table C-5 Health Effects Institute 95th Percentile for Indoor Air (Indoor Air Background Values), and the NYSDOH Air Guidance Values (AGV). Concentrations of tetrahydrofuran, trichlorofluoromethane and n-hexane exceeded one or more of the Indoor Air Background Values at one or more of the indoor air sampling locations. The results indicated no exceedances of the NYSDOH AGVs for any indoor air sample. The results are presented in **Table 1**.

DISCUSSION

The results of this investigation indicate there is the potential for vapor intrusion within Building 338 based on the elevated concentrations of PCE identified in the sub-slab soil vapors, most notably in the northern portion of the building. However, the indoor air concentrations of PCE do not indicate current exposure. As noted above, the indoor air concentrations could have been affected by the opening/closing of loading dock doors during sampling. Although tetrahydrofuran, trichlorofluoromethane and n-hexane were detected above Indoor Air Background Values concentrations in indoor air were generally higher than the sub-slab soil vapor concentrations indicating that there are other potential sources of these compounds contributing to the detected concentrations rather than sub-slab soil vapor.



GZA recommends further evaluation once the final proposed layout of Building 338 is complete. Based on the proposed use of the building and areas to be occupied following redevelopment, an evaluation should be conducted to determine whether mitigation is needed in portions of the building and the most appropriate mitigation methods.

If you have any questions regarding the above, please contact Meredith Hayes at 973.774.3332 or meredith.hayes@gza.com.

Very truly yours,
GZA GEOENVIRONMENTAL OF NEW YORK, INC.

A handwritten signature in black ink, appearing to read 'M. Hayes'.


Meredith Hayes
Senior Project Manager

A handwritten signature in black ink, appearing to read 'Ernest Hanna'.

Ernest Hanna, P.E.
Consultant/Reviewer

A handwritten signature in blue ink, appearing to read 'David Winslow'.

David Winslow, P.G., Ph.D.
Senior Vice President

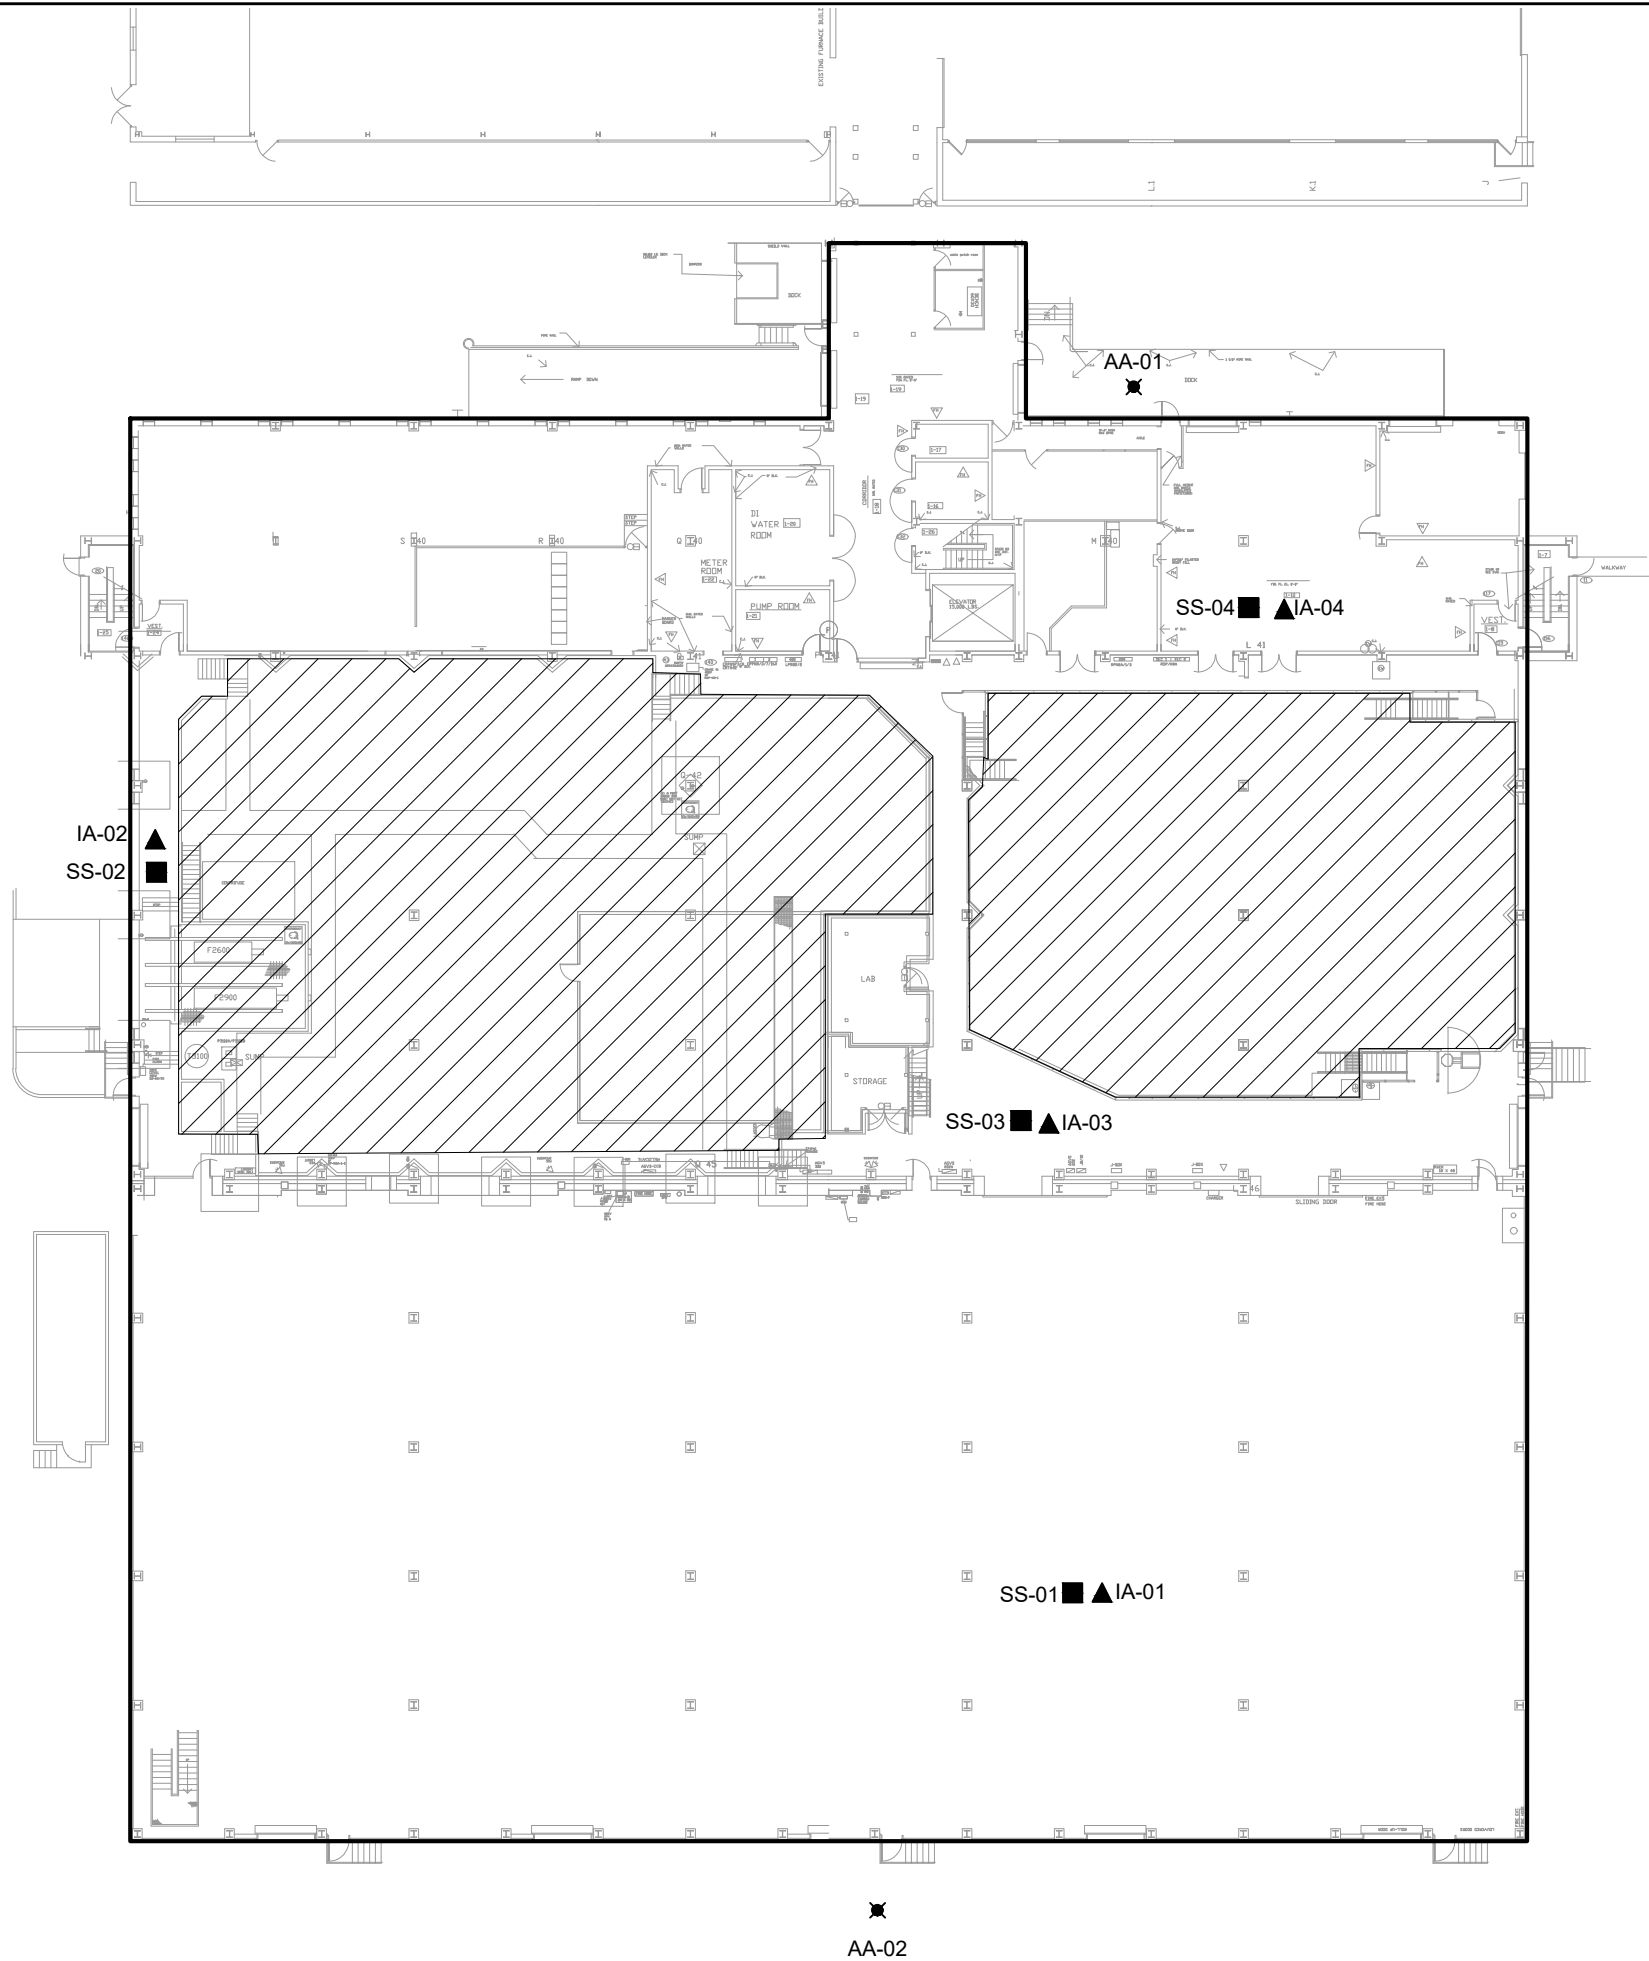

LEGEND:

- BUILDING 338 FOOTPRINT
- APPROXIMATE AREA OF RAISED SLAB
- SUB-SLAB SAMPLE LOCATION
- INDOOR AIR SAMPLE LOCATION
- AMBIENT AIR SAMPLE LOCATION



NO.	ISSUE/DESCRIPTION	BY	DATE
UNLESS SPECIFICALLY STATED BY WRITTEN AGREEMENT, THIS DRAWING IS THE SOLE PROPERTY OF GZA GEOENVIRONMENTAL, INC. (GZA). THE INFORMATION SHOWN ON THE DRAWING IS SOLELY FOR USE BY GZA'S CLIENT OR THE CLIENT'S DESIGNATED REPRESENTATIVE FOR THE SPECIFIC PROJECT AND LOCATION IDENTIFIED ON THE DRAWING. THE DRAWING SHALL NOT BE TRANSFERRED, REUSED, COPIED, OR ALTERED IN ANY MANNER FOR USE AT ANY OTHER LOCATION OR FOR ANY OTHER PURPOSE WITHOUT THE PRIOR WRITTEN CONSENT OF GZA. ANY TRANSFER, REUSE, OR MODIFICATION TO THE DRAWING BY THE CLIENT OR OTHERS, WITHOUT THE PRIOR WRITTEN EXPRESS CONSENT OF GZA, WILL BE AT THE USER'S SOLE RISK AND WITHOUT ANY RISK OR LIABILITY TO GZA.			
SOIL VAPOR INTRUSION ASSESSMENT REPORT - BUILDING 338			
SAMPLE LOCATION MAP			
PREPARED BY: GZA GeoEnvironmental, Inc. Engineers and Scientists www.gza.com		PREPARED FOR: I.PARK84, LLC. GREENWICH, CT	
PROJ MGR: BP	REVIEWED BY: BR	CHECKED BY: BP	FIGURE 1 SHEET NO.
DESIGNED BY: BR	DRAWN BY: MT	SCALE: 1" = 400'	
DATE: JULY, 2019	PROJECT NO. 12.0076252.10	REVISION NO.	

TABLE 1
ANALYTICAL RESULTS
Building 338 Sub-slab Vapor Investigation
2070 Route 52
Hopewell Junction, New York 12533

SAMPLE ID:	NYSDOH AGV ¹	Fuel Oil 2003 Upper Indoor ²	BASE Data 90th ³	2005 95th Percentile Indoor ⁴	SS-04			IA-04			SS-03			IA-03			SS-02			IA-02		
LAB ID:					L1926771-01			L1926771-08			L1926771-03			L1926771-07			L1926771-02			L1926771-06		
COLLECTION DATE:					6/18/2019			6/18/2019			6/18/2019			6/18/2019			6/18/2019			6/18/2019		
SAMPLE MATRIX:					SOIL_VAPOR			AIR			SOIL_VAPOR			AIR			SOIL_VAPOR			AIR		
					Conc	Q	RL	Conc	Q	RL	Conc	Q	RL	Conc	Q	RL	Conc	Q	RL	Conc	Q	RL
VOLATILE ORGANICS IN AIR																						
Dichlorodifluoromethane		10	16.5		9.25	1.98		5.04	0.989		6.13	0.989		4.92	0.989		4190	0.989		5.09	0.989	
Chloromethane		4.2	3.7		1.66	0.826		1.51	0.413		2.46	0.413		1.42	0.413		ND	0.413		1.48	0.413	
Freon-114		0.4			ND	2.8		ND	1.4		ND	1.4		ND	1.4		ND	1.4		ND	1.4	
Vinyl chloride		0.4	1.9		ND	1.02		-	-	-	ND	0.511		-	-	-	ND	0.511		-	-	-
1,3-Butadiene			3		51.3	0.885		ND	0.442		ND	0.442		ND	0.442		ND	0.442		ND	0.442	
Bromomethane		0.5	1.7		ND	1.55		ND	0.777		ND	0.777		ND	0.777		ND	0.777		ND	0.777	
Chloroethane		0.4	1.1		ND	1.06		ND	0.528		ND	0.528		ND	0.528		ND	0.528		ND	0.528	
Ethanol		1300	210		31.1	18.8		ND	9.42		38.3	9.42		ND	9.42		23.9	9.42		12	9.42	
Vinyl bromide					ND	1.75		ND	0.874		ND	0.874		ND	0.874		ND	0.874		ND	0.874	
Acetone		115	98.9	45.8	71.5	4.75		9.38	2.38		116	2.38		11.6	2.38		30.6	2.38		15.5	2.38	
Trichlorofluoromethane		12	18.1		10.2	2.25		11.7	1.12		10.5	1.12		10.5	1.12		9.44	1.12		12	1.12	
Isopropanol			250		ND	2.46		1.57	1.23		2.75	1.23		1.42	1.23		2.17	1.23		2.15	1.23	
1,1-Dichloroethene		0.4	1.4		ND	1.59		-	-	-	ND	0.793		-	-	-	ND	0.793		-	-	-
Tertiary butyl Alcohol					5.18	3.03		ND	1.52		6.03	1.52		ND	1.52		2.6	1.52		ND	1.52	
Methylene chloride	60	16	10	7.5	ND	3.47		ND	1.74		ND	1.74		ND	1.74		ND	1.74		ND	1.74	
3-Chloropropene					ND	1.25		ND	0.626		ND	0.626		ND	0.626		ND	0.626		ND	0.626	
Carbon disulfide			4.2		8.19	1.25		ND	0.623		9.93	0.623		ND	0.623		4.11	0.623		ND	0.623	
Freon-113			3.5		ND	3.07		ND	1.53		ND	1.53		ND	1.53		ND	1.53		ND	1.53	
trans-1,2-Dichloroethene					ND	1.59		2.85	0.793		1.53	0.793		2.7	0.793		1.97	0.793		2.67	0.793	
1,1-Dichloroethane		0.4	0.7		ND	1.62		ND	0.809		ND	0.809		ND	0.809		ND	0.809		ND	0.809	
Methyl tert butyl ether		14	11.5	36	ND	1.44		ND	0.721		ND	0.721		ND	0.721		ND	0.721		ND	0.721	
2-Butanone			12		14.4	2.95		ND	1.47		21.6	1.47		ND	1.47		6.08	1.47		1.72	1.47	
cis-1,2-Dichloroethene		0.4	1.9		ND	1.59		-	-	-	ND	0.793		-	-	-	ND	0.793		-	-	-
Ethyl Acetate			5.4		ND	3.6		ND	1.8		ND	1.8		ND	1.8		ND	1.8		ND	1.8	
Chloroform		1.2	1.1	6.34	6.06	1.95		ND	0.977		36.9	0.977		ND	0.977		17.9	0.977		ND	0.977	
Tetrahydrofuran		0.8			19.5	2.95		1.7	1.47		19.1	1.47		ND	1.47		7.37	1.47		ND	1.47	
1,2-Dichloroethane		0.4	0.9		ND	1.62		ND	0.809		ND	0.809		ND	0.809		ND	0.809		ND	0.809	
n-Hexane		14	10.2		ND	1.41		ND	0.705		2.21	0.705		ND	0.705		1.07	0.705		ND	0.705	
1,1,1-Trichloroethane		2.5	20.6		ND	2.18		-	-	-	ND	1.09		-	-	-	ND	1.09		-	-	-
Benzene		13	9.4	10	1.66	1.28		ND	0.639		1.5	0.639		ND	0.639		0.834	0.639		ND	0.639	
Carbon tetrachloride		1.3	1.3	1.1	ND	2.52		-	-	-	ND	1.26		-	-	-	ND	1.26		-	-	-
Cyclohexane		6.3			ND	1.38		ND	0.688		1.03	0.688		ND	0.688		ND	0.688		ND	0.688	
1,2-Dichloropropane		0.4	1.6		ND	1.85		ND	0.924		ND	0.924		ND	0.924		ND	0.924		ND	0.924	
Bromodichloromethane					ND	2.68		ND	1.34		1.63	1.34		ND	1.34		2.72	1.34		ND	1.34	
1,4-Dioxane					ND	1.44		ND	0.721		ND	0.721		ND	0.721		ND	0.721		ND	0.721	
Trichloroethene	2	0.5	4.2	1.36	2.26	2.15		-	-	-	ND	1.07		-	-	-	ND	1.07		-	-	-
2,2,4-Trimethylpentane		5			ND	1.87		ND	0.934		ND	0.934		ND	0.934		ND	0.934		ND	0.934	
Heptane					ND	1.64		ND	0.82		2.16	0.82		ND	0.82		ND	0.82		ND	0.82	
cis-1,3-Dichloropropene		0.4	2.3		ND	1.82		ND	0.908		ND	0.908		ND	0.908		ND	0.908		ND	0.908	
4-Methyl-2-pentanone		1.9	6		ND	4.1		ND	2.05		ND	2.05		ND	2.05		2.72	2.05		ND	2.05	
trans-1,3-Dichloropropene			1.3		ND	1.82		ND	0.908		ND	0.908		ND	0.908		ND	0.908		ND	0.908	
1,1,2-Trichloroethane		0.4	1.5		ND	2.18		ND	1.09		ND	1.09		ND	1.09		ND	1.09		ND	1.09	
Toluene		57	43	39.8	5.09	1.51		1.77	0.754		5.13	0.754		1.04	0.754		4.33	0.754		1.39	0.754	
2-Hexanone					ND	1.64		ND	0.82		ND	0.82		ND	0.82		1.27	0.82		ND	0.82	
Dibromochloromethane					ND	3.41		ND	1.7		ND	1.7		ND	1.7		ND	1.7		ND	1.7	
1,2-Dibromoethane		0.4	1.5		ND	3.07		ND	1.54		ND	1.54		ND	1.54		ND	1.54		ND	1.54	
Tetrachloroethene	30	2.5	15.9	6.01	1010	2.71		-	-	-	213	1.36		-	-	-	204	1.36		-	-	-

TABLE 1
ANALYTICAL RESULTS
Building 338 Sub-slab Vapor Investigation
2070 Route 52
Hopewell Junction, New York 12533

SAMPLE ID:	NYSDOH AGV ¹	Fuel Oil 2003 Upper Indoor ²	BASE Data 90th ³	2005 95th Percentile Indoor ⁴	SS-04			IA-04			SS-03			IA-03			SS-02			IA-02		
LAB ID:					L1926771-01			L1926771-08			L1926771-03			L1926771-07			L1926771-02			L1926771-06		
COLLECTION DATE:					6/18/2019			6/18/2019			6/18/2019			6/18/2019			6/18/2019			6/18/2019		
SAMPLE MATRIX:					SOIL_VAPOR			AIR			SOIL_VAPOR			AIR			SOIL_VAPOR			AIR		
					Conc	Q	RL	Conc	Q	RL	Conc	Q	RL	Conc	Q	RL	Conc	Q	RL	Conc	Q	RL
Chlorobenzene		0.4	0.9		ND		1.84	ND		0.921	ND		0.921	ND		0.921	ND		0.921	ND		0.921
Ethylbenzene		6.4	5.7	7.62	10.9		1.74	ND		0.869	2.68		0.869	ND		0.869	2.32		0.869	ND		0.869
p/m-Xylene		11	22.2	22.2	8.34		3.47	ND		1.74	5.47		1.74	ND		1.74	6.91		1.74	ND		1.74
Bromoform					ND		4.14	ND		2.07	ND		2.07	ND		2.07	ND		2.07	ND		2.07
Styrene		1.4	1.9	5.13	ND		1.7	ND		0.852	ND		0.852	ND		0.852	ND		0.852	ND		0.852
1,1,2,2-Tetrachloroethane		0.4			ND		2.75	ND		1.37	ND		1.37	ND		1.37	ND		1.37	ND		1.37
o-Xylene		7.1	7.9	7.24	3.9		1.74	ND		0.869	2.51		0.869	ND		0.869	2.69		0.869	ND		0.869
4-Ethyltoluene			3.6		2.6		1.97	ND		0.983	2		0.983	ND		0.983	2.38		0.983	ND		0.983
1,3,5-Trimethylbenzene		3.9	3.7		3.17		1.97	ND		0.983	2.69		0.983	ND		0.983	2.76		0.983	ND		0.983
1,2,4-Trimethylbenzene		9.8	9.5		17		1.97	ND		0.983	13.4		0.983	ND		0.983	16.5		0.983	ND		0.983
Benzyl chloride			6.8		ND		2.07	ND		1.04	ND		1.04	ND		1.04	ND		1.04	ND		1.04
1,3-Dichlorobenzene		0.5	2.4		ND		2.4	ND		1.2	ND		1.2	ND		1.2	ND		1.2	ND		1.2
1,4-Dichlorobenzene		1.2	5.5	344	ND		2.4	ND		1.2	ND		1.2	ND		1.2	ND		1.2	ND		1.2
1,2-Dichlorobenzene		0.5	1.2		ND		2.4	ND		1.2	ND		1.2	ND		1.2	ND		1.2	ND		1.2
1,2,4-Trichlorobenzene		0.5	6.8		ND		2.97	ND		1.48	ND		1.48	ND		1.48	ND		1.48	ND		1.48
Hexachlorobutadiene		0.5	6.8		ND		4.27	ND		2.13	ND		2.13	ND		2.13	ND		2.13	ND		2.13
VOLATILE ORGANICS IN AIR BY SIM																						
Vinyl chloride		0.4	1.9		*		*	ND		0.051	*		*	ND		0.051	*		*	ND		0.051
1,1-Dichloroethene		0.4	1.4		*		*	ND		0.079	*		*	ND		0.079	*		*	ND		0.079
cis-1,2-Dichloroethene		0.4	1.9		*		*	ND		0.079	*		*	ND		0.079	*		*	ND		0.079
1,1,1-Trichloroethane		2.5	20.6		*		*	ND		0.109	*		*	ND		0.109	*		*	ND		0.109
Carbon tetrachloride		1.3	1.3	1.1	*		*	0.503		0.126	*		*	0.604		0.126	*		*	0.503		0.126
Trichloroethene	2	0.5	4.2	1.36	*		*	ND		0.107	*		*	ND		0.107	*		*	ND		0.107
Tetrachloroethene	30	2.5	15.9	6.01	*		*	0.305		0.136	*		*	0.332		0.136	*		*	0.278		0.136

Notes:

- 1 - NYSDOH Air Guidance Value (indoor air samples only)
2 - Table C-1 2003 Upper Fence Study of Volatile Organic Chemicals in air of Fuel Oil Heated Homes for Indoor Air (indoor air samples only)
3 - Table C-2 2001 USEPA BASE 90th Percentile for Indoor Air (indoor air sample only)
4 - Table C-5 2005 Health Effects Institute 95th Percentile for Indoor Air (indoor air samples only)

4	This value exceeds NYSDOH AGV
6	This value exceeds one or more of the Indoor Air Background Values
2	This detection limit exceeds the applicable criteria

- Compound analyzed by SIM, See "Volatile Organics in Air by SIM"

- Compound List

* Compound not analyzed by SIM, See "Volatile Organics in Air"

- Compound List

Q - Laboratory data qualifier

ND - The compound was not detected above the method detection limit

J - Data indicates the presence of a compound that meets the identification criteria. The result is less than the quantitation limit but greater than MDL. The concentration given is an approximate value.

RL - Reporting limit

TABLE 1
ANALYTICAL RESULTS
Building 338 Sub-slab Vapor Investigation
2070 Route 52
Hopewell Junction, New York 12533

SAMPLE ID:	NYSDOH AGV ¹	Fuel Oil 2003 Upper Indoor ²	BASE Data 90th ³	2005 95th Percentile Indoor ⁴	SS-01			IA-01			AA-01			AA-02			DUP-061819		
LAB ID:					L1926771-04			L1926771-05			L1926771-09			L1926771-10			L1926771-11		
COLLECTION DATE:					6/18/2019			6/18/2019			6/18/2019			6/18/2019			6/18/2019		
SAMPLE MATRIX:					SOIL_VAPOR			AIR			AIR			AIR			AIR		
					Conc	Q	RL	Conc	Q	RL	Conc	Q	RL	Conc	Q	RL	Conc	Q	RL
VOLATILE ORGANICS IN AIR																			
Dichlorodifluoromethane		10	16.5		72.7	0.989		3.79	0.989		2.76	0.989		2.71	0.989		3		0.989
Chloromethane		4.2	3.7		6.03	0.413		2.13	0.413		1.54	0.413		1.85	0.413		1.5		0.413
Freon-114		0.4			ND	1.4		ND	1.4		ND	1.4		ND	1.4		ND		1.4
Vinyl chloride		0.4	1.9		ND	0.511		-	-	-	-	-	-	-	-	-	-	-	-
1,3-Butadiene			3		4.76	0.442		ND	0.442		ND	0.442		ND	0.442		ND		0.442
Bromomethane		0.5	1.7		ND	0.777		ND	0.777		ND	0.777		ND	0.777		ND		0.777
Chloroethane		0.4	1.1		0.752	0.528		ND	0.528		ND	0.528		ND	0.528		ND		0.528
Ethanol		1300	210		11.1	9.42		86.9	9.42		ND	9.42		ND	9.42		ND		9.42
Vinyl bromide					ND	0.874		ND	0.874		ND	0.874		ND	0.874		ND		0.874
Acetone		115	98.9	45.8	43.2	2.38		36.8	2.38		8.22	2.38		25.7	2.38		10		2.38
Trichlorofluoromethane		12	18.1		10.5	1.12		16.8	1.12		1.43	1.12		1.45	1.12		1.54		1.12
Isopropanol			250		1.99	1.23		6.71	1.23		ND	1.23		3.07	1.23		ND		1.23
1,1-Dichloroethene		0.4	1.4		ND	0.793		-	-	-	-	-	-	-	-	-	-	-	-
Tertiary butyl Alcohol					5.12	1.52		ND	1.52		ND	1.52		ND	1.52		ND		1.52
Methylene chloride	60	16	10	7.5	ND	1.74		8.62	1.74		ND	1.74		ND	1.74		ND		1.74
3-Chloropropene					ND	0.626		ND	0.626		ND	0.626		ND	0.626		ND		0.626
Carbon disulfide			4.2		22.8	0.623		0.878	0.623		ND	0.623		ND	0.623		ND		0.623
Freon-113			3.5		3.34	1.53		ND	1.53		ND	1.53		ND	1.53		ND		1.53
trans-1,2-Dichloroethene					1.09	0.793		1.15	0.793		ND	0.793		ND	0.793		ND		0.793
1,1-Dichloroethane		0.4	0.7		ND	0.809		ND	0.809		ND	0.809		ND	0.809		ND		0.809
Methyl tert butyl ether		14	11.5	36	ND	0.721		ND	0.721		ND	0.721		ND	0.721		ND		0.721
2-Butanone			12		96.1	1.47		6.58	1.47		ND	1.47		2.42	1.47		ND		1.47
cis-1,2-Dichloroethene		0.4	1.9		ND	0.793		-	-	-	-	-	-	-	-	-	-	-	-
Ethyl Acetate			5.4		ND	1.8		ND	1.8		ND	1.8		ND	1.8		ND		1.8
Chloroform		1.2	1.1	6.34	130	0.977		ND	0.977		ND	0.977		ND	0.977		ND		0.977
Tetrahydrofuran		0.8			128	1.47		79	1.47		2.72	1.47		ND	1.47		ND		1.47
1,2-Dichloroethane		0.4	0.9		ND	0.809		ND	0.809		ND	0.809		ND	0.809		ND		0.809
n-Hexane		14	10.2		4.86	0.705		20.4	0.705		ND	0.705		ND	0.705		ND		0.705
1,1,1-Trichloroethane		2.5	20.6		ND	1.09		-	-	-	-	-	-	-	-	-	-	-	-
Benzene		13	9.4	10	2.39	0.639		2.26	0.639		ND	0.639		ND	0.639		ND		0.639
Carbon tetrachloride		1.3	1.3	1.1	ND	1.26		-	-	-	-	-	-	-	-	-	-	-	-
Cyclohexane		6.3			1.42	0.688		1.45	0.688		ND	0.688		ND	0.688		ND		0.688
1,2-Dichloropropane		0.4	1.6		ND	0.924		ND	0.924		ND	0.924		ND	0.924		ND		0.924
Bromodichloromethane					6.24	1.34		ND	1.34		ND	1.34		ND	1.34		ND		1.34
1,4-Dioxane					ND	0.721		ND	0.721		ND	0.721		ND	0.721		ND		0.721
Trichloroethene	2	0.5	4.2	1.36	ND	1.07		-	-	-	-	-	-	-	-	-	-	-	-
2,2,4-Trimethylpentane		5			2.96	0.934		2.06	0.934		ND	0.934		ND	0.934		ND		0.934
Heptane					4.34	0.82		2.66	0.82		ND	0.82		ND	0.82		ND		0.82
cis-1,3-Dichloropropene		0.4	2.3		ND	0.908		ND	0.908		ND	0.908		ND	0.908		ND		0.908
4-Methyl-2-pentanone		1.9	6		3.28	2.05		ND	2.05		ND	2.05		ND	2.05		ND		2.05
trans-1,3-Dichloropropene			1.3		ND	0.908		ND	0.908		ND	0.908		ND	0.908		ND		0.908
1,1,2-Trichloroethane		0.4	1.5		ND	1.09		ND	1.09		ND	1.09		ND	1.09		ND		1.09
Toluene		57	43	39.8	6.1	0.754		11	0.754		1.54	0.754		1.22	0.754		1.32		0.754
2-Hexanone					ND	0.82		ND	0.82		ND	0.82		ND	0.82		ND		0.82
Dibromochloromethane					1.94	1.7		ND	1.7		ND	1.7		ND	1.7		ND		1.7
1,2-Dibromoethane		0.4	1.5		ND	1.54		ND	1.54		ND	1.54		ND	1.54		ND		1.54
Tetrachloroethene	30	2.5	15.9	6.01	104	1.36		-	-	-	-	-	-	-	-	-	-	-	-

TABLE 1
ANALYTICAL RESULTS
Building 338 Sub-slab Vapor Investigation
2070 Route 52
Hopewell Junction, New York 12533

SAMPLE ID:	NYSDOH AGV ¹	Fuel Oil 2003 Upper Indoor ²	BASE Data 90th ³	2005 95th Percentile Indoor ⁴	SS-01			IA-01			AA-01			AA-02			DUP-061819		
LAB ID:					L1926771-04			L1926771-05			L1926771-09			L1926771-10			L1926771-11		
COLLECTION DATE:					6/18/2019			6/18/2019			6/18/2019			6/18/2019			6/18/2019		
SAMPLE MATRIX:					SOIL_VAPOR			AIR			AIR			AIR			AIR		
					Conc	Q	RL	Conc	Q	RL	Conc	Q	RL	Conc	Q	RL	Conc	Q	RL
Chlorobenzene		0.4	0.9		ND		0.921	ND		0.921	ND		0.921	ND		0.921	ND		0.921
Ethylbenzene		6.4	5.7	7.62	6.12		0.869	1.08		0.869	ND		0.869	ND		0.869	ND		0.869
p/m-Xylene		11	22.2	22.2	9.21		1.74	3.58		1.74	ND		1.74	ND		1.74	ND		1.74
Bromoform					ND		2.07	ND		2.07	ND		2.07	ND		2.07	ND		2.07
Styrene		1.4	1.9	5.13	ND		0.852	ND		0.852	ND		0.852	ND		0.852	ND		0.852
1,1,2,2-Tetrachloroethane		0.4			ND		1.37	ND		1.37	ND		1.37	ND		1.37	ND		1.37
o-Xylene		7.1	7.9	7.24	3.55		0.869	1.39		0.869	ND		0.869	ND		0.869	ND		0.869
4-Ethyltoluene			3.6		2.2		0.983	ND		0.983	ND		0.983	ND		0.983	ND		0.983
1,3,5-Trimethylbenzene		3.9	3.7		2.66		0.983	ND		0.983	ND		0.983	ND		0.983	ND		0.983
1,2,4-Trimethylbenzene		9.8	9.5		13.9		0.983	1.82		0.983	ND		0.983	ND		0.983	ND		0.983
Benzyl chloride			6.8		ND		1.04	ND		1.04	ND		1.04	ND		1.04	ND		1.04
1,3-Dichlorobenzene		0.5	2.4		ND		1.2	ND		1.2	ND		1.2	ND		1.2	ND		1.2
1,4-Dichlorobenzene		1.2	5.5	344	ND		1.2	ND		1.2	ND		1.2	ND		1.2	ND		1.2
1,2-Dichlorobenzene		0.5	1.2		ND		1.2	ND		1.2	ND		1.2	ND		1.2	ND		1.2
1,2,4-Trichlorobenzene		0.5	6.8		ND		1.48	ND		1.48	ND		1.48	ND		1.48	ND		1.48
Hexachlorobutadiene		0.5	6.8		ND		2.13	ND		2.13	ND		2.13	ND		2.13	ND		2.13
VOLATILE ORGANICS IN AIR BY SIM																			
Vinyl chloride		0.4	1.9		*		*	ND		0.051	ND		0.051	ND		0.051	ND		0.051
1,1-Dichloroethene		0.4	1.4		*		*	ND		0.079	ND		0.079	ND		0.079	ND		0.079
cis-1,2-Dichloroethene		0.4	1.9		*		*	0.19		0.079	ND		0.079	ND		0.079	ND		0.079
1,1,1-Trichloroethane		2.5	20.6		*		*	ND		0.109	ND		0.109	ND		0.109	ND		0.109
Carbon tetrachloride		1.3	1.3	1.1	*		*	0.503		0.126	0.484		0.126	0.491		0.126	0.51		0.126
Trichloroethene	2	0.5	4.2	1.36	*		*	0.279		0.107	ND		0.107	ND		0.107	ND		0.107
Tetrachloroethene	30	2.5	15.9	6.01	*		*	0.305		0.136	0.278		0.136	0.298		0.136	0.305		0.136

Notes:

- 1 - NYSDOH Air Guidance Value (indoor air samples only)
2 - Table C-1 2003 Upper Fence Study of Volatile Organic Chemicals in air of Fuel Oil Heated Homes for Indoor Air (indoor air samples only)
3 - Table C-2 2001 USEPA BASE 90th Percentile for Indoor Air (indoor air sample only)
4 - Table C-5 2005 Health Effects Institute 95th Percentile for Indoor Air (indoor air samples only)

4	This value exceeds NYSDOH AGV
6	This value exceeds one or more of the Indoor Air Background Values
2	This detection limit exceeds the applicable criteria
-	Compound analyzed by SIM, See "Volatile Organics in Air by SIM" Compound List
*	Compound not analyzed by SIM, See "Volatile Organics in Air" Compound List
Q	- Laboratory data qualifier
ND	- The compound was not detected above the method detection limit
J	- Data indicates the presence of a compound that meets the identification criteria. The result is less than the quantitation limit but greater than MDL. The concentration given is an approximate value.
RL	- Reporting limit

Appendix B

Indoor air quality questionnaire and building inventory

As discussed in Section 2.11, products in buildings should be inventoried every time indoor air is sampled to provide an accurate assessment of the potential contribution of volatile chemicals. In addition, the type of structure, floor layout and physical conditions of the building being studied should be noted to identify (and minimize) conditions that may interfere with the proposed testing.

Toward this end, a blank copy of the NYSDOH Center for Environmental Health's Indoor Air Quality Questionnaire and Building Inventory is provided in this appendix. Also provided is an example that demonstrates how the form should be completed properly.

**NEW YORK STATE DEPARTMENT OF HEALTH
INDOOR AIR QUALITY QUESTIONNAIRE AND BUILDING INVENTORY
CENTER FOR ENVIRONMENTAL HEALTH**

This form must be completed for each residence involved in indoor air testing.

Preparer's Name Ben Romagnolo Date/Time Prepared 6/17/19
Preparer's Affiliation GZA GeoEnvironmental Phone No. 973-774-3300
Purpose of Investigation SUI Assessment

1. OCCUPANT:

Interviewed: Y / ☒ N

Last Name: _____ First Name: _____

Address: _____

County: _____

Home Phone: _____ Office Phone: _____

Number of Occupants/persons at this location _____ Age of Occupants _____

2. OWNER OR LANDLORD: (Check if same as occupant ☐)

Interviewed: Y / ☒ N

Last Name: _____ First Name: _____

Address: _____

County: _____

Home Phone: _____ Office Phone: _____

3. BUILDING CHARACTERISTICS

Type of Building: (Circle appropriate response)

Residential
Industrial

School
Church

Commercial/Multi-use
Other: _____

5. BASEMENT AND CONSTRUCTION CHARACTERISTICS (Circle all that apply)

- a. Above grade construction: wood frame concrete stone brick
- b. Basement type: full crawlspace slab other N/A
- c. Basement floor: concrete dirt stone other N/A
- d. Basement floor: uncovered covered covered with N/A
- e. Concrete floor: unsealed sealed sealed with _____
- f. Foundation walls: poured block stone other _____
- g. Foundation walls: unsealed sealed sealed with N/A unknown
- h. The basement is: wet damp dry moldy N/A
- i. The basement is: finished unfinished partially finished N/A
- j. Sump present? (Y)/N → in 1st floor
- k. Water in sump? Y/(N) not applicable

 Basement/Lowest level depth below grade: N/A (feet)

Identify potential soil vapor entry points and approximate size (e.g., cracks, utility ports, drains)

Multiple cracks observed throughout Building,

Trench drains, grates

6. HEATING, VENTING and AIR CONDITIONING (Circle all that apply)

Type of heating system(s) used in this building: (circle all that apply – note primary)

Hot air circulation	Heat pump	Hot water baseboard	Other <u>High temp</u> air circulation.
Space Heaters	Stream radiation	Radiant floor	
Electric baseboard	Wood stove	Outdoor wood boiler	

The primary type of fuel used is:

Natural Gas	Fuel Oil	Kerosene
Electric	Propane	Solar
Wood	Coal	

Domestic hot water tank fueled by: _____

Boiler/furnace located in: Basement Outdoors Main Floor Other _____

Air conditioning: Central Air Window units Open Windows None

- j. Has painting/staining been done in the last 6 months? Y / ☒ N Where & When? _____
- k. Is there new carpet, drapes or other textiles? Y / ☒ N Where & When? _____
- l. Have air fresheners been used recently? Y / ☒ N When & Type? _____
- m. Is there a kitchen exhaust fan? Y / ☒ N If yes, where vented? _____
- n. Is there a bathroom exhaust fan? Y / ☒ N If yes, where vented? _____
- o. Is there a clothes dryer? Y / ☒ N If yes, is it vented outside? Y / N
- p. Has there been a pesticide application? Y / ☒ N When & Type? _____

Are there odors in the building?

Y / ☒ N

If yes, please describe: _____

Do any of the building occupants use solvents at work?

Y / ☒ N

(e.g., chemical manufacturing or laboratory, auto mechanic or auto body shop, painting, fuel oil delivery, boiler mechanic, pesticide application, cosmetologist)

If yes, what types of solvents are used? _____

If yes, are their clothes washed at work?

Y / ☒ N

Do any of the building occupants regularly use or work at a dry-cleaning service? (Circle appropriate response)

Yes, use dry-cleaning regularly (weekly)

Yes, use dry-cleaning infrequently (monthly or less)

Yes, work at a dry-cleaning service

No
☒ Unknown

Is there a radon mitigation system for the building/structure? Y / ☒ N Date of Installation: _____

Is the system active or passive? Active/Passive

9. WATER AND SEWAGE

Water Supply: Public Water Drilled Well Driven Well Dug Well Other: _____

Sewage Disposal: Public Sewer Septic Tank Leach Field Dry Well Other: _____

10. RELOCATION INFORMATION (for oil spill residential emergency)

N/A

a. Provide reasons why relocation is recommended: _____

b. Residents choose to: remain in home relocate to friends/family relocate to hotel/motel


c. Responsibility for costs associated with reimbursement explained? Y / N

d. Relocation package provided and explained to residents? Y / N

12. OUTDOOR PLOT

Draw a sketch of the area surrounding the building being sampled. If applicable, provide information on spill locations, potential air contamination sources (industries, gas stations, repair shops, landfills, etc.), outdoor air sampling location(s) and PID meter readings.

Also indicate compass direction, wind direction and speed during sampling, the locations of the well and septic system, if applicable, and a qualifying statement to help locate the site on a topographic map.

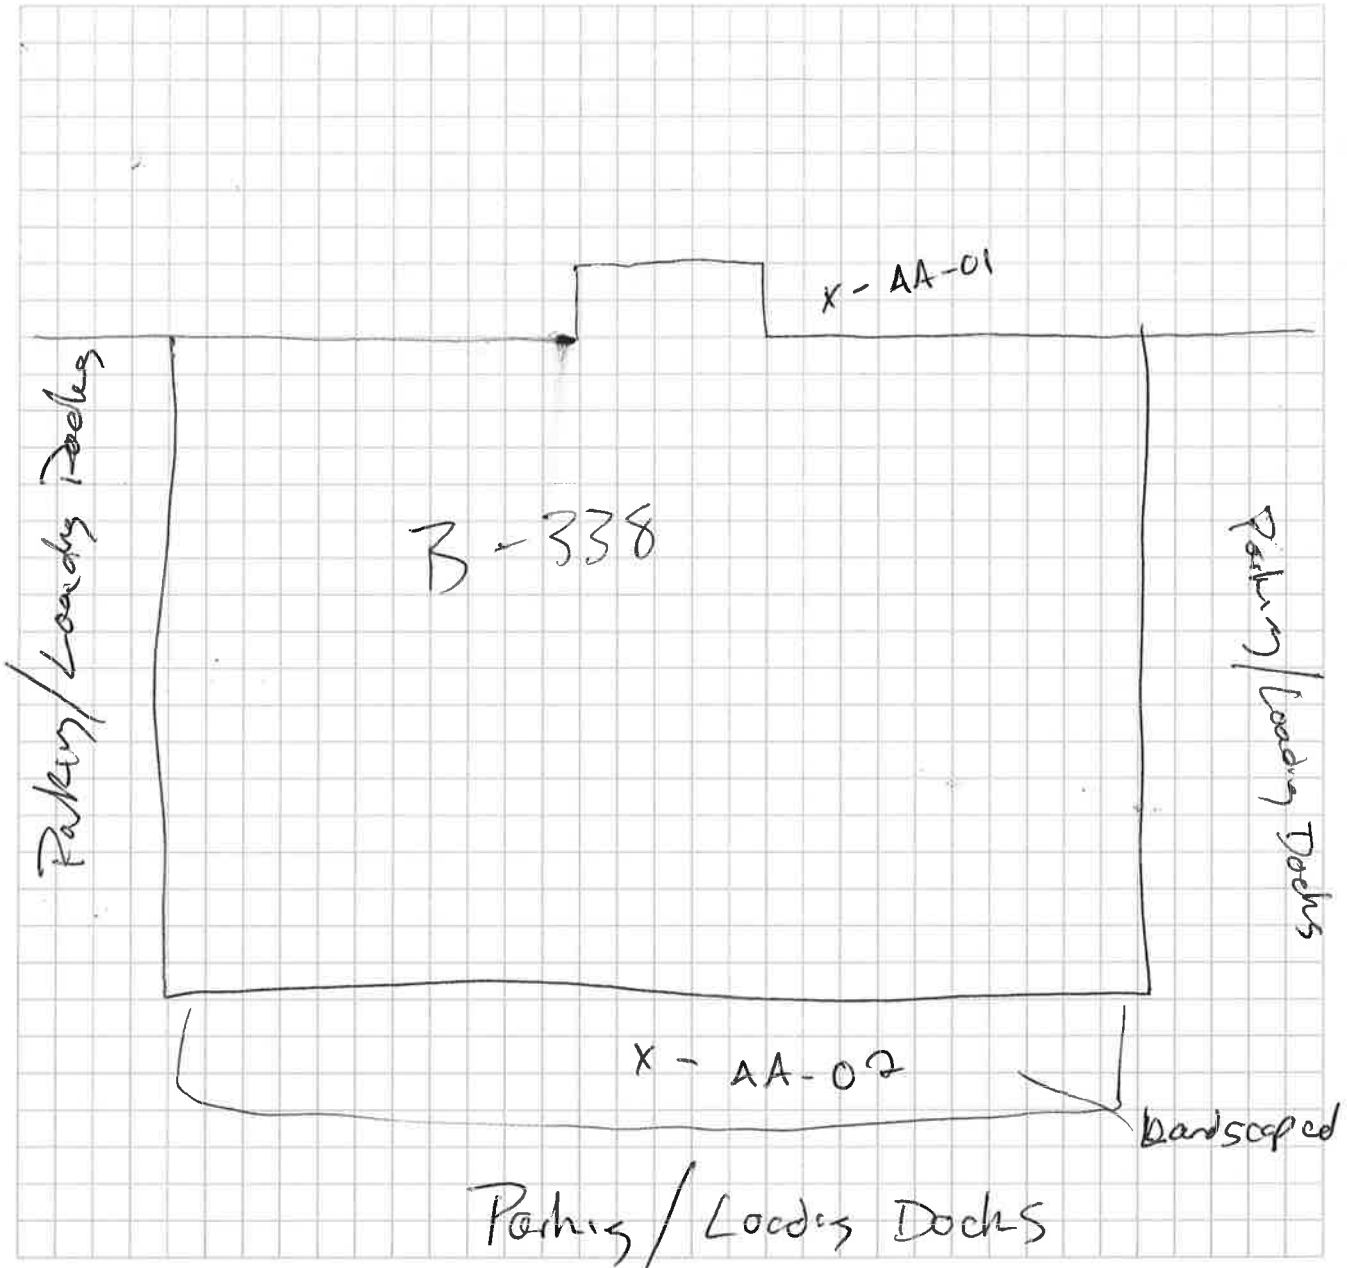

Example

1

Correct

NEW YORK STATE DEPARTMENT OF HEALTH
INDOOR AIR QUALITY QUESTIONNAIRE AND BUILDING INVENTORY
CENTER FOR ENVIRONMENTAL HEALTH

This form must be completed for each residence involved in indoor air testing.

Preparer's Name Mary Jones Date/Time Prepared 10/22/04 10:00 am

Preparer's Affiliation XYZ Consulting Phone No. 518-555-1212

Purpose of Investigation Thomasville Soil Vapor Intrusion Investigation (Site #32141)

1. OCCUPANT:

Interviewed: ☒ Y ☐ N

Last Name: Smith First Name: Carol

Address: 25 Main Street Thomasville, New York 25230

County: Albany

Home Phone: 518-556-2222 Office Phone: 518-556-2400

Number of Occupants/persons at this location 2 Age of Occupants 36, 10

2. OWNER OR LANDLORD: (Check if same as occupant ☐)

Interviewed: Y ☒ N ☐

Last Name: White First Name: Frank

Address: 64 Mountain Road Bainbridge, New York 26390

County: Dutchess

Home Phone: 845-876-1301 Office Phone: 845-227-2430

3. BUILDING CHARACTERISTICS

Type of Building: (Circle appropriate response)

☒ Residential
☐ Industrial

☐ School
☐ Church

☐ Commercial/Multi-Use
Other:

Example Correct

3

5. BASEMENT AND CONSTRUCTION CHARACTERISTICS (Circle all that apply)

- a. Above grade construction: wood frame concrete stone brick
- b. Basement type: full crawlspace slab other _____
- c. Basement floor: concrete dirt stone other _____
- d. Basement floor: uncovered covered covered with _____
- e. Concrete floor: unsealed sealed sealed with _____
- f. Foundation walls: poured block stone other _____
- g. Foundation walls: unsealed sealed sealed with _____
- h. The basement is: wet damp dry moldy
- i. The basement is: finished unfinished partially finished
- j. Sump present? Y N
- k. Water in sump? Y / N not applicable

Basement/Lowest level depth below grade: 6 (feet)

Identify potential soil vapor entry points and approximate size (e.g., cracks, utility ports, drains)

Floor drain in laundry area

6. HEATING, VENTING and AIR CONDITIONING (Circle all that apply)

Type of heating system(s) used in this building: (circle all that apply – note primary)

<u>Hot air circulation</u>	Heat pump	Hot water baseboard
Space Heaters	Stream radiation	Radiant floor
Electric baseboard	Wood stove	Outdoor wood boiler Other _____

The primary type of fuel used is:

Natural Gas	<u>Fuel Oil</u>	Kerosene
Electric	Propane	Solar
Wood	Coal	

Domestic hot water tank fueled by: gas

Boiler/furnace located in: Basement Outdoors Main Floor Other _____

Air Conditioning: Central Air Window units Open Windows None

Example Correct

5

j. Has painting/staining been done in the last 6 months? Y / ☒ N Where & When? _____

k. Is there new carpet, drapes or other textiles?

☒ Y / ☐ N Where & When? carpet in dining room

l. Have air fresheners been used recently?

Y / ☒ N When & Type? _____

m. Is there a kitchen exhaust fan?

☒ Y / ☐ N If yes, where vented? outside

n. Is there a bathroom exhaust fan?

Y / ☒ N If yes, where vented? _____

o. Is there a clothes dryer?

☒ Y / ☐ N If yes, is it vented outside? ☒ Y / ☐ N

p. Has there been a pesticide application?

Y / ☒ N When & Type? _____

Are there odors in the building?

Y / ☒ N

If yes, please describe: _____

Do any of the building occupants use solvents at work?

☒ Y / ☐ N

(e.g., chemical manufacturing or laboratory, automechanic or autobody shop, painting, fuel oil delivery, boiler mechanic, pesticide application, cosmetologist etc.)

If yes, what types of solvents are used? hair salon dyes, alcohols, peroxides, acetone

If yes, are their clothes washed at work?

Y / ☒ N

Do any of the building occupants regularly use or work at a dry-cleaning service? (Circle appropriate response)

☒ Yes, use dry-cleaning regularly (weekly)

☒ Yes, use dry-cleaning infrequently (monthly or less)

☐ Yes, work at a dry-cleaning service

☐ No

☐ Unknown

Is there a radon mitigation system for the building/structure? ☒ Y / ☐ N Date of Installation: June 2000

Is the system active or passive? ☒ Active / ☐ Passive

9. WATER AND SEWAGE

Water Supply: Public Water ☒ Drilled Well ☐ Driven Well ☐ Dug Well ☐ Other: _____

Sewage Disposal: Public Sewer ☒ Septic Tank ☐ Leach Field ☐ Dry Well ☐ Other: _____

10. RELOCATION INFORMATION (for oil spill residential emergency)

a. Provide reasons why relocation is recommended: not applicable

b. Residents choose to: remain in home ☐ relocate to friends/family ☐ relocate to hotel/motel ☐

c. Responsibility for costs associated with reimbursement explained? Y / N


d. Relocation package provided and explained to residents? Y / N

Example Correct 7

12. OUTDOOR PLOT

Draw a sketch of the area surrounding the building being sampled. If applicable, provide information on spill locations, potential air contamination sources (industries, gas stations, repair shops, landfills, etc.), outdoor air sampling location(s) and PID meter readings.


Also indicate compass direction, wind direction and speed during sampling, the locations of the well and septic system, if applicable, and a qualifying statement to help locate the site on a topographic map.

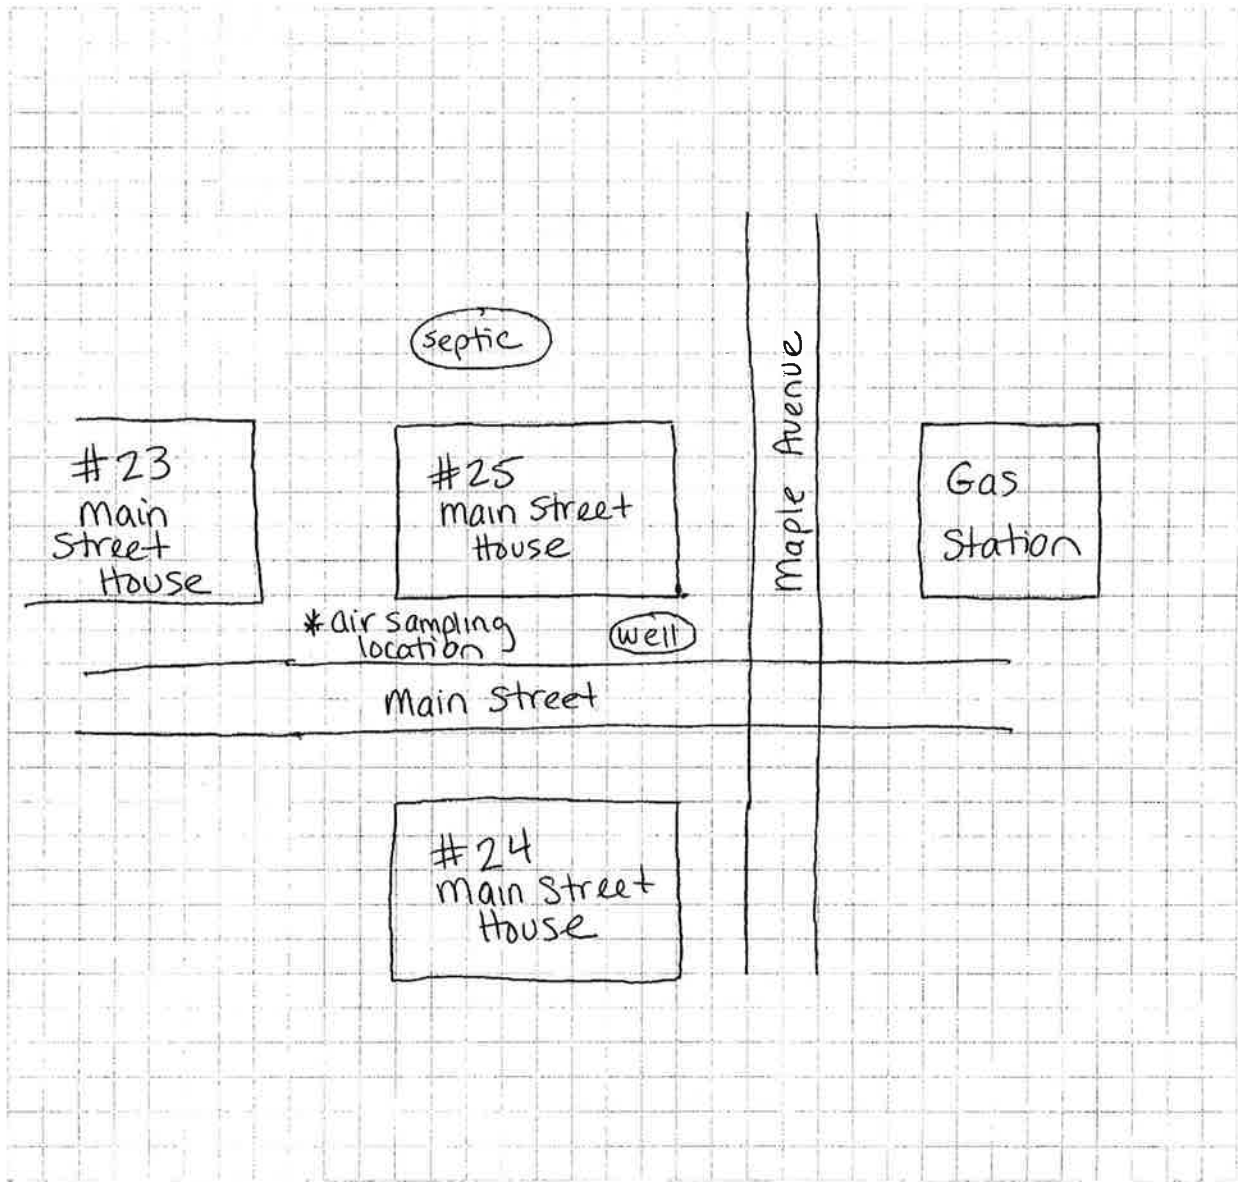

↑ N
Wind direction = NE

Product Inventory Attachment — 25 Main Street, City

WD-40 FRONT

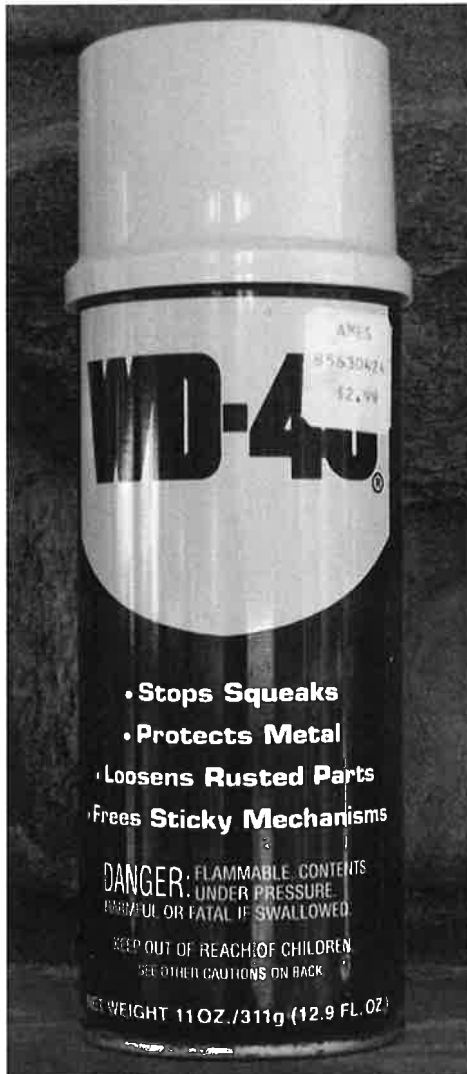

WD-40 INGREDIENTS

HARMFUL OR FATAL IF SWALLOWED:
Contains petroleum distillates. If
swallowed, **DO NOT** induce vomit-
ing. Call physician immediately.
Use in a well-ventilated area.
**DELIBERATE OR DIRECT INHALATION
OF VAPOR OR SPRAY MIST MAY BE
HARMFUL OR FATAL.**

ATTACHMENT B
HEALTH AND SAFETY PLAN

HEALTH AND SAFETY PLAN

AT

IPARK 84

FORMER IBM EAST FISHKILL FACILITY

FEBRUARY 2020

**PREPARED FOR:
IPARK EAST FISHKILL LLC
200 NORTH DRIVE
HOPEWELL JUNCTION, NEW YORK 12533**

**PREPARED BY:
WALDEN ENVIRONMENTAL ENGINEERING, PLLC
2070 ROUTE 52
HOPEWELL JUNCTION, NEW YORK 12533**

WALDEN ENVIRONMENTAL ENGINEERING, PLLC

Industry Leader in Environmental Engineering Consulting

PROACTIVE SOLUTIONS SINCE 1995

TABLE OF CONTENTS

1.0	INTRODUCTION	1
2.0	SCOPE.....	3
2.1	Generic Scope.....	3
2.2	Project-Specific Scope of Work	4
2.3	Equipment.....	4
2.4	Site Access.....	5
2.5	Controlled Work Areas.....	5
	2.5.1 Exclusion Zone	5
	2.5.2 Contaminant Reduction Zone	5
	2.5.3 Support Zone	6
3.0	ORGANIZATIONAL STRUCTURE.....	7
3.1	Project Manager.....	7
3.2	Site Safety Officer	7
3.3	Employees	8
3.4	Subcontractors	8
3.5	Visitors	9
4.0	EMERGENCY RESPONSE.....	10
4.1	Emergency Facilities and Telephone Numbers	10
4.2	Response Procedures	11
4.3	First Aid Kit and Medical Emergencies	11
	4.3.1 Burns.....	12
	4.3.2 Eye Wounds	13
4.4	Fire: Hazards, Prevention, Protection and Extinguishers	13
	4.4.1 Fire Prevention.....	14
	4.4.2 Fire Protection	15
4.5	Evacuation Procedures	15
4.6	Spill Containment	16
4.7	Incident Reporting	16
5.0	GENERAL HEALTH AND SAFETY REQUIREMENTS.....	18
5.1	Qualifications and Training.....	18
	5.1.1 Hazardous Communication Training (29 CFR 1910.1200).....	19

5.1.2	<i>Visitor Training</i>	19
5.2	General Safety	19
5.2.1	<i>Tailgate Safety Meetings</i>	20
5.2.2	<i>Housekeeping</i>	20
5.2.3	<i>Hazardous, Solid or Municipal Waste</i>	21
5.2.4	<i>Smoking, Eating and Drinking</i>	21
5.2.5	<i>Personal Hygiene</i>	21
5.2.6	<i>Stop Work Authority</i>	22
5.2.7	<i>Severe Weather</i>	22
5.3	Communication Procedures.....	22
5.4	Hazard Communication.....	23
5.5	Medical Monitoring.....	23
5.6	Logs, Reports and Record Keeping.....	24
6.0	HAZARD ASSESSMENT	25
6.1	Physical Hazards	25
6.1.1	<i>Site Mobilization/Demobilization</i>	25
6.1.2	<i>General Work Activities</i>	25
6.2	Chemical Hazards.....	29
6.3	Biological Hazards	30
6.3.1	<i>Animals</i>	30
6.3.2	<i>Insects</i>	31
6.3.3	<i>Blood-borne Pathogens</i>	31
7.0	EXPOSURE MONITORING.....	32
7.1	Noise.....	32
7.1.1	<i>Hearing Conservation Program</i>	33
7.2	Chemical Contaminants.....	33
7.2.1	<i>Air Monitoring</i>	33
7.3	Calibration	36
8.0	PERSONAL PROTECTIVE EQUIPMENT	37
8.1	Head Protection	37
8.2	Foot Protection	37
8.3	Hand Protection	37
8.4	Eye Protection	38
8.5	Hearing Protection.....	38

8.6	Respiratory Protection	38
8.7	PPE Program	39
8.7.1	<i>Inspections</i>	39
8.7.2	<i>Donning/Doffing of Personal Protective Equipment</i>	39
9.0	RECORD OF HASP ACKNOWLEDGEMENT	41

Attachments

Attachment A: iPark 84 Facility Site Map

Attachment B: Emergency Room Directions

Attachment C: Safety Data Sheets & General Chemical Information

Attachment D: Heat Stress

Attachment E: Cold Stress

1.0 INTRODUCTION

Walden Environmental Engineering, PLLC (Walden) employees may be exposed to risks from site-related hazardous conditions while performing field activities at the iPark 84 Site (the Former IBM East Fishkill Facility, the “Site” or “Facility”) located in Hopewell Junction, New York (refer to **Attachment A**) which is owned by iPark East Fishkill LLC (“iPark” or “Owner”). Walden’s policy is to minimize the possibility of work-related injury through aware and qualified supervision, health and safety training, medical monitoring and the use of appropriate personal protective equipment (PPE). Walden has established a guidance program to implement this corporate policy in a manner that protects personnel to the maximum reasonable extent.

This Health and Safety Plan (HASP) applies to all Walden personnel, iPark representatives, subcontractors, the New York State Department of Environmental Conservation (NYSDEC), the New York State Department of Health (NYSDOH), and any other individuals on the job-site where operations involve actual or potential physical and chemical hazards that have been identified by Walden or others during activities including but not limited to the following:

- Shallow soil sampling;
- Sediment sampling;
- Groundwater sampling;
- Construction or demolition work that disturbs surface or subsurface soils, groundwater, sediment, etc. at the Facility; and
- Construction or demolition work involving equipment, piping, etc. currently or formerly containing hazardous materials or wastes at the Facility.

This HASP is also intended to inform and guide all personnel (Walden employees and/or owner representatives, subcontractors or State/local regulatory agency representatives) entering the exclusion zone, ensuring that each person sign and acknowledge the Site hazards on the Acknowledgement Form, provided in Section 9.0. Walden and/or the owner’s subcontractors are retained as independent contractors and, as such, are responsible for ensuring the safety of their employees.

Walden may require that its personnel take certain precautions in accordance with this HASP, and Walden requests that others protect their personnel in a manner that they deem necessary or sufficient.

This HASP is based on the best available information to date. Should a conflict occur between this document and any other related Health and Safety Plans, Operating Procedures, regulations,

etc., workers shall follow the most stringent/protective requirements. HASP Supplements will be generated, as necessary, to address any new information, change in conditions or activities. While it is not possible to discover, evaluate, and protect in advance against all possible hazards which may be encountered throughout the course of this project, adherence to the requirements of this HASP will significantly reduce the potential for occupational injury.

2.0 SCOPE

2.1 Generic Scope

This HASP is intended to be utilized during removal of solid waste management units (SWMUs) and any intrusive work performed at the Facility, including but not limited to the following:

- Cleaning/demolition/removal of SWMUs and associated piping and troughs;
- Removal/installation/modification of piping and drainage structures;
- Collection of waste water samples;
- Collection of soil samples via hand auger or similar methods;
- Installation of soil borings;
- Installation and pilot testing of mitigation system components;
- Collection of groundwater samples;
- Collection of soil gas and sub-slab vapor samples;
- Collection of air samples;
- Non-hazardous and hazardous soil/solids management;
- Non-hazardous and hazardous liquid management;
- Real-time air monitoring using instrumentation;
- Cutting and handling of concrete slabs;
- Construction, installation and maintenance of engineering controls to reduce chemical exposure;
- Excavation;
- Stockpiling;
- Grading;
- Trenching;
- Interior building renovations;
- Installation of pavement and concrete; and
- General site construction and building activities.

Previous site investigations have identified soil, soil vapor and groundwater contamination at various locations at the Facility associated with historic site activities. Contaminants associated with the site include volatile organic compounds (VOCs), semi-volatile organic compounds (SVOCs) and inorganics. Therefore, precautions shall be taken to prevent exposure to contaminants and ensure that appropriate and safe procedures are followed when potentially contaminated media and hazardous materials and wastes may be encountered and handled during the work. Work at the Facility shall be performed by employees who are properly trained and experienced in dealing with the hazards which may arise from these types of tasks, which are

defined as toxic effects, including threshold limit values (TLVs), immediately dangerous to life and health (IDLH), reactivity, stability, flammability, and operational hazards with sampling, decontaminating, etc.

2.2 Project-Specific Scope of Work

iPark shall perform pilot testing as part of the mitigation system design for Building 730 (338). The pilot test work is detailed in the “*Building 730 (338) Vapor Mitigation System Pilot Testing Plan*” (Walden, February 2020). The work includes but is not limited to the following: drilling through the concrete floor slab to install vapor extraction well points and vacuum monitoring points for the pilot test, and other tasks related to mitigating potential vapor intrusion impacts and verifying that the tenant spaces are safe prior to tenant occupancy.

2.3 Equipment

The following equipment may be utilized during work at the Facility:

- Hand auger;
- Portable generator;
- Battery;
- Peristaltic pump;
- Bailer;
- Water quality meter;
- Water level indicator;
- Scrub brush;
- Photoionization detector (PID);
- MultiRAE multi-gas meter;
- Ventilation devices (fans);
- Concrete saw;
- 55-gallon drums, both metal and plastic;
- Plastic chemical totes;
- Excavation machinery (e.g. mini-excavator);
- Hand shovels;
- Plastic sheeting;
- Air sampling canisters;
- Water sampling containers;
- Soil/Solids sampling containers;
- Chemical-resistant, leather, and/or cut-resistant gloves; and
- Miscellaneous hand tools (screwdriver, socket driver).

2.4 Site Access

The Facility includes occupied and unoccupied building spaces and undeveloped areas. Authorized Facility owner personnel, tenants and subcontractors have access to buildings at the Facility depending on security clearance designations. In the event of an emergency, personnel and subcontractors should assemble at a predetermined assembly area, designated by the Site Safety Officer (SSO) for the task.

Access to work areas will be denied to the general public via the SSO or designated personnel, thus establishing the perimeter of controlled work areas, minimizing potential exposure to unauthorized individuals, protecting the public from hazards and preventing vandalism. All equipment and materials will be secured during non-work hours. Continuous communication (via portable radios, hand signals, telephones, etc.) shall be maintained between the SSO and key personnel associated with this project at all times during field operations.

2.5 Controlled Work Areas

Controlled work areas will be established prior to and for each work area, depending on the task, and shall float (move around) depending on the tasks being performed on any given day. Each controlled work area will consist of three (3) zones: the exclusion zone, the contaminant reduction zone and the support zone based on the degree of danger present. To the extent possible, the support and contaminant reduction zones will be established outside of the exclusion zone.

2.5.1 Exclusion Zone

The exclusion zone consists of the primary activity area, as defined by the SSO. Only personnel directly involved with performance of a job task within that area and meeting the required qualifications (40 Hour HAZWOPER trained) may be allowed entry. Before entering the exclusion zone, all personnel must be familiar with emergency response procedures, Site safety locations, first aid and communication equipment, and the locations of the map to the hospital and the list of emergency telephone numbers. Attempts will be made so that equipment and site activities taking place in the exclusion zone are situated so that personnel are upwind of potential contaminant sources.

2.5.2 Contaminant Reduction Zone

The contaminant reduction zone shall be located between the exclusion zone and the support zone. In this area authorized personnel (those with 40 Hour HAZWOPER training) will don protective equipment, as needed in the exclusion zone. When exiting the restricted area, personnel will remove contaminated PPE.

2.5.3 *Support Zone*

The support zone shall extend beyond the exclusion and contaminant reduction zones, where other support activities shall occur, such as first aid, equipment supply, etc., and where vendors, subcontractors and inspectors, and the like, shall be allowed. The support zone shall be established prior to commencement of activities and shall serve as the entry point for controlling access.

Trespassers shall be immediately escorted outside of these established areas and all work within these areas shall halt until the trespasser has been removed.

3.0 ORGANIZATIONAL STRUCTURE

The following Walden personnel are the main parties involved with the project at hand.

<u>POSITION/TITLE</u>	<u>NAME/AFFILIATION</u>	<u>PHONE NUMBER/PAGER</u>
Project Manager(s)	Joseph M. Heaney III, P.E.	516-624-7200 (Office)
	Nora Brew, P.E.	516-732-5378 (Mobile)
	Ted Nitza, P.E.	260-416-6188 (Mobile)
Site Safety Officer(s)	Kerri Wright	845-207-3043 (Mobile)
	Erica Johnston	631-521-1266 (Mobile)
	Louis Goldstein	845-406-8242 (Mobile)

3.1 Project Manager

The Project Manager has the responsibility and authority to direct all operations related to this project. The Project Manager is responsible to observe and provide guidance to employees, subcontractors and visitors with regard to safe work behavior and safety training, discuss deviations from the work plan and any safety issues that arise, assist the SSO with the development and implementation of corrective actions for Site safety deficiencies, the implementation of this HASP and ensuring compliance.

3.2 Site Safety Officer

A qualified SSO will be continuously on the jobsite during the period of work and will have the authority to receive and execute any directions given by the owner representative in the absence of the Project Manager. The SSO will establish the necessary controlled work areas. The SSO will ensure that task areas are kept in a clean condition, free of rubbish and all undue accumulations and surplus materials while the work progresses. The SSO and/or Project Manager shall guarantee that all employees are fit for duty and that material and equipment is protected to prevent damage to employees and visitors, as well as, at the end of each work day, all rubbish and unused materials are removed and any damage done is repaired. These individuals will enforce this HASP, ensuring required safety equipment is on-site, clean and operable.

The SSO will coordinate all relevant health and safety issues, and may conduct specialized training and compliance inspections, as required. It will be the duty of the SSO to provide emergency training to associated personnel and, in the event of an emergency situation, to inform the local authorities as to the nature of the incident. In case of an emergency incident, the SSO

will be contacted immediately. The SSO is to work with the Project Manager to develop and implement any corrective actions that may be necessary.

The Project Manager and the SSO are responsible for periodically reviewing the HASP and its Attachments and any Supplements and, as necessary, amending them to keep current with new or changing conditions.

3.3 Employees

Employees are responsible for understanding and abiding by the policies and procedures specified in this HASP and other applicable safety policies, and clarifying those areas where understanding is incomplete; providing feedback to health and safety management relating to omissions and modifications in the HASP or other safety policies; and, notifying the SSO, in writing, of unsafe conditions and acts. Each employee shall sign this HASP (Section 9.0) in acknowledgement of such.

The health and safety authority of each employee assigned to the Facility includes the right to refuse to work and/or stop work authority when the employee feels that the work is unsafe (including subcontractors), or where specified safety precautions are not adequate or fully understood; the right to refuse to work on any task where the safety procedures specified in this HASP or other safety policies are not being followed; the right to contact the SSO at any time to discuss potential concerns; the right and duty to stop work when conditions are unsafe, and to assist in correcting these conditions.

3.4 Subcontractors

Subcontractors shall submit to the SSO a copy of their own health and safety plan or shall review and sign this document acknowledging acceptance and understanding of the information contained herein. Subcontractors are responsible for assigning specific work tasks to their employees. Subcontractors shall provide qualified employees equipped with the necessary PPE and training required for the task. Each subcontractor is responsible for compliance with the regulatory requirements that pertain to those services. Each subcontractor is expected to perform operations in accordance with their own unique safety policies and procedures, or those documented herein, in order to ensure that hazards associated with the performance of the work activities are properly controlled. Copies of any required safety documentation/certification for a subcontractor's work activities will be provided to Walden for review prior to the start of onsite activities, if required. Hazards not listed herein but known to any subcontractor must be identified to Walden prior to commencing any on-site activity. The Project Manager and SSO have the authority to halt any subcontractor operations, and to remove any subcontractor or

subcontractor employee for failure to comply with established health and safety procedures or for operating in an unsafe manner.

3.5 Visitors

Authorized visitors requiring entry to any work location on-site shall be briefed by the SSO on the hazards present prior to entry and acknowledge receipt of this briefing by signing this HASP. Visitors shall be escorted at all times within the controlled zones and shall be responsible for compliance with all health and safety policies. All visitors shall hold the appropriate qualifications, training and PPE which are required for entry to any controlled work area. Should a visitor requiring entry to an exclusion zone fail to meet the qualifications for that zone, all work activities within the exclusion zone shall halt while the visitor is within the controlled zone.

4.0 EMERGENCY RESPONSE

Site personnel must be prepared in the event of an emergency. Emergencies can take many forms including: illnesses, injuries, chemical exposure, fires, spills, leaks, releases of harmful contaminants, or sudden changes in the weather. Walden employees shall not participate in any emergency response where there are potential safety or health hazards (i.e., fire, explosion or chemical exposure); their actions will thus be limited to evacuation. Predetermined safe areas shall be determined and relayed by the SSO to all on-site personnel at the start of each shift and will be based on prevailing wind direction. Evacuation routes established by work area locations will be highlighted on a Site map and periodically reviewed. As the work areas change, the evacuation route and map will be altered accordingly, and the new route will be reviewed.

Emergency telephone numbers and a map to the nearest hospital shall be on-hand at the Facility. The hospital with an emergency room closest to the Facility is St. Luke's Cornwall Hospital at 70 Dubois Street, Newburgh, New York 12550. A map of the route to St. Luke's Cornwall Hospital is provided herein as **Attachment B**. Personnel shall be familiar with the emergency procedures, and the locations of safety, first aid and communication equipment.

4.1 Emergency Facilities and Telephone Numbers

<u>COMPANY</u>	<u>NAME</u>	<u>PHONE #</u>
Walden Project Manager(s)	Joseph M. Heaney III, P.E.	516-624-7200 (Office)
	Nora Brew, P.E.	516-732-5378 (Mobile)
	Ted Nitza, P.E.	260-416-6188 (Mobile)
Walden Site Safety Officer(s)	Kerri Wright	845-207-3043 (Mobile)
	Erica Johnston	631-521-1266 (Mobile)
	Louis Goldstein	845-406-8242 (Mobile)
iPark	Mike Buckley	203-430-9211 (Mobile)
Emergency Response	Police/Fire/Medical	911
	iPark Campus Emergency #	845-894-3333
St. Luke's Cornwall Hospital		845-568-2305
NYSDEC Spill Hotline		518-457-7362
American Association of Poison Control Centers		800-222-1222

First Aid Kit Locations: Within work vehicles on-site; Walden office on Facility grounds.

Fire Extinguishers: Walden office on Facility grounds and various locations throughout the Facility; the fire extinguisher location nearest to the work area will be identified before work commences.

4.2 Response Procedures

A communication network shall be established prior to commencement of any on-site tasks. At least one (1) on-site person shall have a phone accessible and in good working order at all times. Hand signals shall be used in instances when verbal communication is not feasible. The Project Manager, followed by the SSO, will immediately coordinate any and all emergency situations with the proper local medical/emergency organizations and personnel at the Facility. In the event of a fire, use of fire-fighting equipment available on-site may be administered, if appropriate; removing or isolating flammable or other hazardous materials that may contribute to the fire will be performed. The personnel on-site will coordinate evacuation procedures (if necessary) and remain a safe distance away from the area of health and safety concern. Personnel on-site may need to perform basic first aid as warranted by the emergency situation. Personnel with suspected neck or back injuries must not be moved. A detailed written report of the emergency situation will be provided within 24 hours to Walden by the Project Manager or SSO. Site security and control will be enforced by the SSO with consent for undertaken measures from the Project Manager. The SSO is responsible for pre-emergency planning, as well as emergency recognition and prevention.

4.3 First Aid Kit and Medical Emergencies

A basic first aid kit will be maintained and readily available (never locked up) at the Facility and within easy access to work areas (in personnel vehicles on-site). At a minimum, the first aid kit will include the following as per ANSI Z308.1-1978: aspirin, bandage compresses, adhesive/triangular bandages (to keep wounds clean), medical tape, gauze, scissors, tweezers, sterilization lotion/cream, eye dressing, and antibacterial lotion/soap or pads. Items are to be replaced as they are used. Sterile items must be wrapped, sealed and used only once. Reusable items, such as scissors and tape, shall be kept clean. Should plentiful amounts of clean water not be available, eye flush shall be utilized. The number of first aid kits on-site shall be:

<u>Number of Persons Assigned to the Facility</u>	<u>Minimum First Aid Supplies</u>
1-5	10 Package Kit
6-15	16 Package Kit

Professional medical assistance is to be called in the event of a medical emergency. In the event of a medical emergency:

- Stay calm and seek help, do not delay in calling for more assistance;
- Do not provide medical assistance unless you are trained to do so;
- Do not move the injured party unnecessarily;
- Do not attempt to remove any object that may have impaled the victim;
- Check to ensure the victim has an open airway, is breathing and has a heartbeat (if not, immediate action is required prior to taking care of any additional injuries);
- Promptly control any bleeding;
- Treat the injured party gently and keep them calm and quiet, reassuring them that additional help is on the way;
- Do not administer any food or drink and never provide the injured party with alcohol;
- Gather as much information as you can about the accident/injury and the victim's condition and be prepared to report that to first responders, as well as any medical actions already taken; and
- Let emergency responders do their job and aid them in keeping others out of their way.

4.3.1 Burns

For minor burns (redness or blisters over a small area), flush the wound with cold water and apply a sterile dressing; do not use butter or similar substance on any burn and do not break open blisters.

For major burns (white or charred skin; redness or blisters over a large area; burns on face, hands or genital area), cover the wound with sterile dressing and seek immediate emergency medical attention.

In the event of a chemical burn (spilled liquid or dry chemical on skin), promptly seek medical attention. For a liquid chemical burn, flush the wound with large amounts of water immediately and keep the water at a gentle flow. For dry chemical burns, brush off as much as possible before flushing with water. In both instances, flush the wound for at least five (5) minutes before covering with sterile dressing. Never use anything but water on a burned area and do not break open blisters.

4.3.2 *Eye Wounds*

Should an individual find/feel they have a foreign object in their eye, do not rub the eye; have them pull their upper eyelid over their lower eyelid or run plain water over the eye. If the object persists, cover both eyes with a gauze dressing and aid them in seeking immediate emergency medical attention.

If the eye is wounded (eyelid or eyeball; pain; history of blow to eye area; discoloration), seek immediate emergency medical attention and apply loose sterile dressing over both eyes. For bruising, a cold compress or ice pack should be used to relieve pain and reduce swelling. Do not try to remove any imbedded object or apply any pressure to an injured eye.

If the eye has sustained a chemical burn, seek immediate emergency medical attention. Flush the open eye (it may be necessary to hold the patient's eyelid open) immediately with water for at least ten (10) minutes, twenty (20) minutes if the substance was alkali. Cover both eyes with sterile dressing. Never put anything but water in the eye.

4.4 Fire: Hazards, Prevention, Protection and Extinguishers

Many potential ignition hazards may exist on-site, including internal combustion engines, combustible materials and smoking. Combustible materials shall be kept well away from the exhaust of any internal combustion engine powered equipment. Smoking is prohibited except in designated areas, as determined by the SSO. Operations which constitute a fire hazard shall be identified as such, with signs conspicuously posted, stating: "No Smoking or Open Flame". Flammable gases and liquids shall be stored and handled in approved containers, places and as per the requirements described on the applicable Safety Data Sheet (SDS).

All employees who will use a fire extinguisher shall be trained on the use and hazards involved with firefighting initially and annually thereafter. All fire extinguishers shall be visually inspected monthly for general condition and adequate charge and serviced, tested, and certified by qualified personnel at least annually. Fire extinguisher inspection and maintenance are the responsibility of the Facility owner. Records of the annual maintenance check must be maintained. Only those employees designated as capable of using fire extinguishers shall be allowed to do so. Extinguishers shall be located and identified for easy accessibility.

It is imperative to use the proper extinguisher for a fire, as using the wrong one can spread the fire. Portable extinguishers shall be suitable for ABC class fires. The following table provides further information on types of fire extinguishers and their use:

Class	Distribution	Notes
A ("A" on a green triangle)	75' or less travel distance between the employee and the extinguisher	Use on wood, paper, trash
B ("B" on a red square)	50' or less travel distance between hazard area and the employee	Use on flammable liquid, gas
C ("C" on a blue circle)	Based on the appropriate pattern for the existing Class A or Class B hazards	Use on electrical fires
D ("D" on a yellow star)	75' or less travel distance between the combustible metal working area and the extinguisher or other containers of Class D extinguishing agent	Use on combustible metals

4.4.1 Fire Prevention

The best method of protection against fire is prevention. The following rules are to be adhered to in an effort to prevent fire:

- Smoking is prohibited except in designated areas, as determined by the SSO. All smoking materials are to be totally extinguished and placed in appropriate receptacles;
- SDS's shall be referred and adhered to prior to the moving, handling and storage of any chemical product;
- In order to prevent accidental ignition of combustible materials, heat producing equipment is to be properly maintained and operated as per the manufacturer's instructions;
- All chemicals and combustibles must be stored in approved containers;
- Materials that severely react or combust when mixed must not be stored near each other;
- Chemical spills must immediately be cleaned, particularly in the case of spilled combustible or reactive materials. Damaged containers and cleaning materials must be properly disposed;
- Combustible materials and refuse must be segregated and kept from sources of ignition;
- All employees shall be made aware of the locations of fire extinguishers and hydrants and access to those resources shall be kept clear;
- The SSO shall notify all employees of any unusual fire hazard condition; and
- Good housekeeping practices are to be followed.

4.4.2 *Fire Protection*

All personnel shall be notified if a fire occurs; the local fire department shall also be notified. When notifying the local fire department: remain calm and speak clearly and slowly; give the exact location of the fire and describe the situation; give a phone number for the location you are calling from; and, do not hang up until you are told to do so.

4.5 **Evacuation Procedures**

In the event of an emergency which necessitates evacuation of the work area, personnel will notify other personnel verbally or otherwise. All personnel will immediately evacuate the work area, keeping upwind of smoke, vapors or spill location, to a predetermined safe area, without regard for equipment. The predetermined safe area will be specified to all personnel by the SSO prior to the start of field work. Personnel will not re-enter the area until all health and safety issues return to a satisfactory level. The SSO is responsible for selecting the most effective evacuation route, as well as designating safe distances and places of refuge. The SSO shall conduct a roll call to ensure that all personnel have been evacuated safely.

Evacuation procedures in case of personal injury of personnel will be conducted as follows:

- Another team member (buddy) should signal the SSO that the injury has occurred;
- A field team member trained in first aid can administer treatment to an injured worker;
- The victim should then be transported to the nearest emergency room (see **Attachment B**). If necessary, an ambulance should be called to transport the victim; and
- The SSO is responsible for making certain that an Accident Report Form is completed. This form is to be submitted to the Project Manager. Follow-up action should be taken to correct the situation that caused the accident.

If a member of the field crew demonstrates symptoms of chemical exposure, the procedures outlined below shall be followed:

- Another team member (buddy) is to remove the individual from the immediate area of contamination if it is safe for them to do so. The buddy shall communicate to the SSO (via voice/hand signals) about the chemical exposure. The SSO will then contact the appropriate emergency response agency;
- Precautions must be taken to avoid exposure of other individuals to the chemical;
- If the chemical is on the individual's clothing, the chemical shall be neutralized or removed if it is safe to do so;

- If the chemical has contacted the skin, the skin shall be washed with copious amounts of water; and
- In case of eye contact, an emergency eye wash is to be used. Eyes should be washed for at least fifteen (15) minutes.

All chemical exposure incidents must be reported in writing to the Project Manager. The SSO is responsible for completing the accident report.

4.6 Spill Containment

In an effort to prevent spills, all hazardous material will be stored in appropriate containers and the tops/lids will be placed back on the containers after use. Hazardous materials brought on-site shall come with the appropriate SDS (the SDS sheets for chemicals that are most likely to be encountered on-site are attached to this HASP in **Attachment C**), will be stored appropriately, with labels, and away from moving equipment. Containers will be lifted/moved utilizing equipment appropriate for the task and secured and handled in a manner which minimizes spillage and reduces the risk of personal injury. At least one (1) spill response kit shall be available at the Facility.

All environmental spills or releases of hazardous materials are to be immediately reported to the SSO and dealt with according to the chemical manufacturers recommended procedures, which can be found on the SDS. The SDS for chemicals/contaminants identified during historic site investigations and known to be associated with the Facility are provided in **Attachment C**; an SDS for TMAH is also included. If any materials brought on-site during the work come with an SDS, that SDS will be added to **Attachment C**.

4.7 Incident Reporting

If an accident, fire, or release of toxic materials occurs during the course of work, the Project Manager shall be telephoned immediately and receive written notification within 24 hours. That notification shall include the following information:

- Name, organization, telephone number, and location of the Contractor;
- Name and title of the person(s) reporting;
- Date and time of the accident/incident;
- Location of the accident/incident (i.e. site location, facility name);
- Brief summary of the accident/incident giving pertinent details including type of operation ongoing at the time of the accident/incident;
- Cause of the accident/incident, if known;

- Casualties (fatalities, disabling injuries);
- Details of any existing chemical hazard or contamination;
- Estimated property damage and effect on contract schedule;
- Action taken by Contractor to ensure safety and security; and
- Other damage or injuries sustained, public, or private.

If any employee of a subcontractor is injured, documentation of the incident will be recorded in accordance with the subcontractor's procedures; however, copies of all documentation (which at a minimum must include the OSHA Form 301 or equivalent) must be provided to the SSO within 24 hours after the accident has occurred. All accidents/incidents will be investigated. Copies of all subcontractor accident investigations will be provided to the SSO within five (5) days of the accident/incident.

5.0 GENERAL HEALTH AND SAFETY REQUIREMENTS

All personnel shall conduct themselves in a safe manner and maintain a working environment that is free of additional hazards.

5.1 Qualifications and Training

All personnel performing work at the Facility must be qualified for their assigned project task, as determined by the Project Manager. They must meet the training and medical monitoring requirements necessary for the task and as described herein. If possible, exposure above an OSHA permissible exposure limit (PEL) has or is expected to occur, employees must be required to receive supplemental medical testing to document any symptoms that may be specific to the particular materials present.

Training programs instruct employees on the intent of the OSHA standards, health and safety principles and procedures, proper operation of monitoring instruments, use of personal protective equipment, decontamination, and specific emergency plans. All personnel are required to remain current in all of their required training and evaluate their need for additional training when there is a change in work. In addition to the general health and safety training programs, personnel will be required to complete any supplemental task specific training (e.g. OSHA 40 Hour HAZWOPER training) developed for the tasks to be performed. Administration and compliance with the requirements for additional task-specific training will be the responsibility of the Project Manager. Any additional required training that is completed will be documented and tracked in the project files. Additional training will be provided to any employees responsible for responding to emergencies.

A copy of this HASP will also be made available to all personnel for review. All employees on-site will sign the Record of HASP Acknowledgement form (refer to Section 9.0) to verify they have reviewed this Plan. Any subcontractors involved in implementing the work plan will be required to acknowledge that their employees have received adequate training.

All on-site personnel involved with the project will attend a pre-entry briefing on the contents of this HASP, including chemical and physical hazards associated with the Facility. The initial health and safety briefing will consist of the following information:

- Names of personnel and alternates responsible for worker safety and health;
- Injury, illness, and other potential project hazards;
- Safe use of engineering controls and equipment on-site;
- Work practices by which the employee can minimize risks from hazards;

- Selection, use, care, and maintenance of PPE; and
- Standard operation safety procedures.

Documentation of all training, testing and medical monitoring certificates (if applicable) will be maintained by Walden.

5.1.1 Hazardous Communication Training (29 CFR 1910.1200)

Hazardous materials that may be encountered as existing on-site environmental or physical/health contaminants during the work activities are addressed in this HASP and their properties, hazards and associated required controls will be communicated to all affected employees and subcontractors, as per OSHA's Hazard Communication Standard. All personnel shall be briefed on the hazards of any chemical product they use and shall be aware of and have access to all SDS; these employees must be 40 Hour HAZWOPER trained.

All containers on-site shall be properly labeled in compliance with the Globally Harmonized System to indicate their contents. Labeling on any containers not intended for single day, individual use shall contain additional information indicating potential health and safety hazards (flammability, reactivity, etc.). SDS for chemicals/contaminants known to be associated with the Facility are provided in **Attachment C**. If any materials brought on-site during the work come with an SDS, that SDS will be added to **Attachment C**.

5.1.2 Visitor Training

All visitors to work areas will be informed of the hazards and necessary personal protective equipment associated with those areas, should they require entry to controlled work areas. Visitors shall also be briefed on emergency procedures.

5.2 General Safety

The SSO shall inspect work areas prior to commencement of daily activities. The SSO will take all corrective measures necessary to perform safe work at the Facility. All inspections and corrective measures will be documented and communicated to Site workers at the initial safety meeting and subsequent safety meetings.

Employees will practice contamination avoidance to include not walking through puddles or mud unnecessarily, avoiding kneeling on the ground or leaning on equipment whenever possible, or setting equipment on the ground while outside. Weather conditions that may escalate potential hazards, such as lightning, rain or extreme temperatures, will be recorded in the project files.

Employees will use extreme caution in inclined areas. Ground surfaces may be wet and slippery and may have hazardous objects protruding from the surface.

Dependent on the season in which the work will be performed, employees should exercise caution when encountering animals (e.g. snakes, spiders, bees, wasps, ticks, mosquitoes, ants, etc.) at the Facility. Employees who are known to be highly sensitive to insect stings should carry a “sting kit” and notify the SSO. All employees are encouraged to use permethrin (0.5%) clothing repellent and DEET (30%) skin repellent for protection against ticks and mosquitoes.

Hearing protection devices will be available to be worn by all field personnel in work areas where noise levels are at or above 85 decibels (dBA). The use of hearing protection devices when the noise levels exceed 85 dBA on an 8-hour average is a condition of employment.

5.2.1 Tailgate Safety Meetings

The SSO will conduct an informational safety meeting at the start of each workday to ensure that all on-site personnel (those entering the exclusion, contaminant reduction and support zones) understand changing conditions and daily operating procedures, and to address safety questions and concerns; these topics shall typically require ten (10) minutes to discuss and shall be recorded in the field notebook. Additional meetings may be conducted, as required. Attendance is mandatory and an attendance record shall be kept by the SSO. Any person who observes safety concerns or potential hazards that have not been addressed in the daily safety meeting should immediately report observations/concerns to the SSO. Meetings will include pertinent information regarding the day’s work and include, but will not be limited to, the following:

- The whereabouts of any hazardous chemicals near specific work areas;
- Methods used to detect the presence or release of hazardous chemicals;
- The physical and chemical health hazards of the Facility;
- Protective measures such as safe work practices, emergency procedures, and PPE;
- Details regarding the proper use of protective measures and SDS’s;
- Target activities for the day’s work;
- Changes in observed exposure levels; and
- Staff changes (e.g., due to vacations, reassignments, etc.) and responsibilities.

5.2.2 Housekeeping

During project activities, work areas will be continuously policed for identification of excess trash and unnecessary debris. Excess trash and debris will be collected and stored in an

appropriate container (e.g., plastic trash bags, garbage can, roll-off bin) prior to disposal. All electrical equipment must be grounded.

5.2.3 Hazardous, Solid or Municipal Waste

If hazardous, solid, and/or municipal wastes are generated, the waste shall be accumulated, labeled, and disposed of in accordance with all applicable Federal, State and/or local regulations. If equipment or materials that will be used (i.e., calibration gases, lithium batteries, etc.) need to be shipped but fall under criteria that define them as hazardous materials under Department of Transportation (DOT) regulations 49 Code of Federal Regulations (CFR) Parts 171-177, then they must be shipped in accordance with those regulations by an individual who is certified as having been “function-specific” trained, as required under the DOT regulations.

5.2.4 Smoking, Eating and Drinking

Eating, drinking, or smoking is permitted only in designated areas in the support zone. An exception is made for the replacement of fluids as a preventive measure for heat stress. Workers will first wash hands and face immediately after leaving controlled work areas (and always prior to eating or drinking).

5.2.5 Personal Hygiene

The following personal hygiene requirements will be observed:

- No contact lenses shall be worn in the exclusion zone without the use of additional eye protection;
- If work is to be performed outdoors on a building perimeter, protective clothing that is loose fitting and covers arms and legs to protect against sunlight during times of high levels of ultraviolet exposure (May through September) shall be worn; hats, sunscreen that provides UVA and UVB protection and sunglasses shall also be donned, as appropriate;
- A water supply meeting the following requirements will be utilized:
 - *Potable Water* - An adequate supply of potable water will be available for personnel consumption. Potable water can be provided in the form of water bottles, canteens, water coolers, or drinking fountains. Where drinking fountains are not available, individual-use cups will be provided as well as adequate disposal containers. Potable water containers will be properly identified in order to distinguish them from non-potable water sources; and
 - *Non-Potable Water* - Non-potable water may be used for job tasks and cleaning activities only. Non-potable water will not be used for drinking purposes or for

hand washing. All containers of non-potable water will be marked with a label stating: “***Non-Potable Water - Not Intended for Drinking Water Consumption***”.

- Access to nearby toilet facilities shall be maintained; and
- Employees will be provided washing facilities (e.g., buckets with water and soap). The use of water and hand soap (or similar substance) will be required by all employees following exit from the exclusion zone, prior to breaks, and at the end of daily work activities.

5.2.6 Stop Work Authority

All employees have the right and duty to stop work when conditions are unsafe and to assist in correcting these conditions. Whenever the SSO determines that workplace conditions present an uncontrolled risk of injury or illness to employees, immediate resolution shall be sought. Stop work shall be immediately binding on all affected employees and subcontractors. Upon issuing the stop work order, the SSO shall implement corrective actions so that operations may be safely resumed. Resumption of safe operations is the primary objective; however, operations shall not resume until the SSO and Project Manager concur that workplace conditions meet acceptable safety standards.

5.2.7 Severe Weather

Severe weather can occur with little warning. Employees will be vigilant for the potentials for storms, lightning, high winds, and flash flood events. The SSO will be attentive to daily weather forecasts for the project area each morning. For activities occurring outdoors, the following conditions will be observed:

- Condition #1 – Storm threat within 24 hours: stow non-essential gear indoors and maintain a six (6) hour weather watch; and
- Condition #2 – Storm threat within 12 hours: securely lash down all moveable gear, drums, pipes, tools, etc. and maintain a three (3) hour weather watch.

5.3 Communication Procedures

Personnel will be informed of all known Facility hazards during an initial safety meeting and will be kept informed of hazards discovered during work activities.

- Personnel within the exclusion zone will remain in constant communication or within sight of other personnel. Failure of communication requires evacuation of the exclusion zone until communication is reestablished;

- The emergency signal will be one of the following:
 - Any blast from a pressurized air horn or vehicle horn; and
 - Verbal notification.
- The following standard hand signals will be used:
 - Hand gripping throat -- Out of air and cannot breathe;
 - Grip buddy's wrist -- Leave area immediately;
 - Both hands on buddy's waist -- Leave area immediately;
 - Hands on top of head -- Need assistance;
 - Thumb down -- No/negative; and
 - Thumb up -- Yes/I am OK/I am alright.

5.4 Hazard Communication

SDSs, along with a list of those materials covered by the SDSs, will be available to all personnel (including subcontractors) for all hazardous substances brought on-site. SDS for chemicals/contaminants known to be associated with the Facility are provided in **Attachment C**. SDS's for materials later brought on-site shall come with an SDS, which is to be included in **Attachment C**. Any employee or subcontractor intending to bring a hazardous material onto the job-site must first provide a copy of the SDS to the SSO for review and filing. Should an SDS be necessary but not available for the material in question, the material may not be brought onto the Facility.

All containers on-site shall be properly labeled to indicate their contents. Labeling on any containers not intended for single-day, individual use shall contain additional information indicating potential health and safety hazards (flammability, reactivity, etc.). Prior to starting work, personnel, including any subcontractors, will be briefed by the SSO regarding hazardous chemicals and their properties, hazards and associated required controls present at the work-site that personnel could use or be exposed to.

5.5 Medical Monitoring

OSHA has established requirements for a medical surveillance program designed to monitor and reduce health risks for employees who may potentially be exposed to hazardous materials. The medical surveillance program has been designed to provide baseline medical data for each employee involved in hazardous material operations. Each employee must undergo testing and training, and a determination of his/her ability to wear PPE and carry out certain tasks. Medical examinations must be administered during pre-employment, on an annual basis, upon employment termination, and as warranted for potential chemical exposure. These examinations shall be provided by employers without cost or loss of pay to the employee. In accordance with 29 CFR 1910.1020, medical surveillance records should be maintained for thirty (30) years past employment and shall be available to the employee, owner, or regulatory agencies, as required.

Due to potential exposure to hazardous materials, all contractors, employees, subcontractors and other prime contractors involved in Facility activities within the exclusion zone will be informed about the medical monitoring program meeting specifications of 29 CFR Part 1926.1153. Each contractor shall assume the responsibility of maintaining a medical surveillance program (if needed) as well as maintaining personnel medical records, as regulated by 29 CFR 1910.1020, for all personnel, including subcontractors, who will be on-site. Subcontractors working on the job must provide the SSO with documentation on their medical monitoring programs.

5.6 Logs, Reports and Record Keeping

Walden shall keep a permanently bound logbook containing as a minimum the following information:

- Agency property number, facility name, address, location and project duration;
- Contractor name, address, phone number;
- A list of Contractor personnel assigned to the project; and
- A day-to-day record of personnel entering the work area, short description of the day's work, and a record of any significant or unusual events occurring during the course of work, including but not limited to inspections, observations, unusual incidents, (e.g. damage, unexpected visitors, etc.). The project narrative is to be kept by the Project Manager.

The SSO and Project Manager will ensure that all records are kept up to date and maintained in accordance with applicable regulations. The following items will be recorded in the daily field log in waterproof, permanent ink:

- Daily list of field personnel;
- Record of all visitors;
- Training logs;
- Levels of PPE worn by workers and, as appropriate, visitors;
- Exposure work-hours and a log of occupational injuries and illnesses;
- Accident investigations;
- Daily record of all first aid treatments not otherwise reportable; and
- Daily health and safety inspection report.

6.0 HAZARD ASSESSMENT

This section identifies the general and activity-specific hazards associated with Facility operations and what should be implemented to reduce the hazards; identifies general physical hazards that can be expected; and presents a summary of documented or potential chemical hazards that may be encountered during the work, as well as biological hazards. Every effort must be made to reduce or eliminate these hazards. Those which cannot be eliminated must be guarded against by using engineering controls and/or personal protective equipment.

6.1 Physical Hazards

The following physical hazards may be associated with the project at hand:

6.1.1 Site Mobilization/Demobilization

Mobilization and demobilization activities may cause health injuries during traffic accidents. Manual materials handling and manual site preparation may cause blisters, sore muscles and joints, and skeletal injuries. It may also present the potential for eye hazards, contusions and lacerations. Slippery work surfaces can increase the likelihood of back injuries, overexertion injuries, slips and falls.

Underground utilities must be identified before commencing any subsurface work.

6.1.2 General Work Activities

Tasks required for this project may involve exposure to slipping/tripping/falling, manual lifting, noise, heat/cold stress, electrical, hand and power tools, operation of motorized vehicles, and other physical hazards associated with activities including soil and groundwater investigation, construction, building renovations, etc. All work at this Facility will be conducted during daylight hours, or with adequate lighting provided for indoor work.

Slipping/Falling: Slips, trips and falls are the most common workplace incidents and can result in serious injuries, even death. General housekeeping of the Site, PPE, attention to your surroundings, minimizing distractions and warding off fatigue can all help to minimize risk of slips, trips and falls. Work areas shall be kept free of any materials, obstructions and substances that could cause a hazardous situation. Workers shall ensure clear footing and avoid obstructions, holes, protruding objects or other tripping hazards and look out for uneven, unstable and slippery terrain. Designated routes shall be taken, not shortcuts, and makeshift substitutes of equipment must not be used. Workers are prohibited from horse-play and shall ensure a clear path prior to carrying/moving equipment.

Manual Lifting: Lifting/carrying of equipment and materials may cause strains, particularly back injuries, fatigue and over-exertion. Proper lifting techniques should be exercised; bend at the knees, let your legs do the lifting, do not twist while lifting, bring the load as close to you as possible prior to lifting, be sure there is a clear walking path, use mechanical devices for heavier objects, team lift.

Noise: The operation of certain equipment (e.g., generator, nearby construction work, etc.) may result in momentary high noise levels which could result in temporary to permanent hearing loss and interference in communication. Hearing protection (e.g. ear plugs, ear muffs) will be used as necessary; as a rule of thumb, if it becomes necessary to shout at someone three (3) feet away, hearing protection should be worn.

Eye Protection: All Facility-related operations involving possible eye injury (chemical splash, etc.), must have approved eye wash units readily available. Protective eyewear shall be donned in Level D, when directed by the SSO.

Heat Stress: Monitoring of personnel wearing personal protective clothing should commence when the ambient temperature is 72°F or above. Monitoring frequency should increase as ambient temperature increases or as slow recovery rates are observed. Heat stress monitoring should be performed by the SSO, who shall be able to recognize symptoms of heat stress; refer to **Attachment D**.

Proper training and preventive measures will aid in averting loss of worker productivity and serious illness. Heat stress prevention is particularly important because once a person suffers from heat stroke or heat exhaustion, that person may be predisposed to additional heat-related illness. To avoid heat stress, the following steps should be taken:

- Adjust work schedules;
- Mandate work slowdowns as needed;
- Perform work during cooler hours of the day if possible or at night if adequate lighting can be provided;
- Provide shelter (air conditioned, if possible) or shaded areas to protect personnel during rest periods; and
- Maintain workers' body fluids at normal levels. This is necessary to ensure that the cardiovascular system functions adequately. Daily fluid intake must approximately equal the amount of water lost in sweat, i.e. eight (8) fluid ounces (0.23 liters) of water must be ingested for approximately every eight (8) ounces (0.23 kg) of weight lost. When heavy

sweating occurs, encourage workers to drink more. The following strategies may be useful:

- Maintain water temperature between 50° and 60°F (10° to 16.6°C);
- Provide small disposal cups that hold about four ounces (0.1 liter);
- Have workers drink sixteen (16) ounces (0.5 liter) of fluid (preferably water or dilute drinks) before beginning work;
- Urge workers to drink one (1) or two (2) cups every 15 to 20 minutes, or at each monitoring break. A total of 1 to 1.6 gallons (4 to 6 liters) of fluid per day are recommended, but more may be necessary to maintain body weight; and
- Train workers to recognize the symptoms of heat-related illness.

Should an employee display signs of heat exhaustion (fatigue, weakness, profuse sweating, normal temperature, pale clammy skin, headache, cramps, vomiting, fainting), they are to be immediately removed from the hot area and lay down with their feet raised. Their clothing should be loosened or removed and cool, wet clothes applied. If the victim is not vomiting, they should be encouraged to take small sips of water.

Should an employee display signs of heat stroke (dizziness, nausea, severe headache, hot and dry skin, confusion, collapse, delirium, coma and death), seek immediate emergency medical attention. Remove the victim from the hot area and remove clothing, lay them down and cool their body (shower, cool wet clothes); do not give stimulants to the victim. Refer to **Attachment D** for further instruction.

Cold Stress: Cold stress is a result of cold, wetness, and wind. A worker's susceptibility to cold stress can vary according to their physical fitness, degree of acclimatization to cold weather, age, and diet. If work on this project occurs during winter months, thermal injury due to cold exposure can become a problem for on-site personnel. A cold-stress monitoring program shall be implemented, as appropriate. Workers should be aware of the local cold exposure hazard (frostbite) and the overall cold exposure hazard (hypothermia). Refer to **Attachment E** for further information on Cold Stress.

To prevent cold-related illness:

- Educate workers to recognize the symptoms of frostbite and hypothermia;
- Identify and limit known risk factors;
- Assure the availability of enclosed, heated environments on or adjacent to the Site;
- Assure the availability of dry changes of clothing;
- Assure the availability of warm drinks; and

- Start oral temperature recording at the Site:
 - At the SSO or Project Manager's discretion when changes in a worker's performance or mental status are suspected;
 - At a worker's request;
 - As a screening measure, two (2) times per shift, under unusually hazardous conditions (e.g. wind chill less than 20°F or wind chill less than 30°F with precipitation); and
 - As a screening measure whenever any worker at the Facility develops hypothermia.

Electrical: Hazards associated with electricity include shock, electrocution, burns, fires and explosions, as well as trip and fall hazards from power cords, and including electrical hazards and exposure to carbon monoxide from the use of portable generators. No work is to be performed on electrical equipment or near any part of an electrical circuit unless the worker is protected against shock by guarding or de-energizing and grounding the circuit. Ground Fault Circuit Interrupters (GFCIs) are required for portable tools. Extension cords shall be rated for hard or extra hard use and must be capable of grounding. All cords shall be inspected prior to use for wear and exposed wiring, strain, rips, tears, cuts or burns; defective cords shall be taken out of commission. Generators shall be fueled only after being shut down and allowed to cool, in addition, portable generators shall not be utilized indoors; the exhaust is to pointed downwind from workers.

Hand and Power Tools: The use of hand and power tools can present a variety of hazards, including physical harm from being struck by flying objects, being cut or struck by the tool, sparks, fire, abrasions, contusions and electrocution, or being exposed to harmful dusts, fumes, mists, vapors or gases. Ground Fault Circuit Interrupters are required for portable tools. Workers shall confirm that all tools are in proper operating condition and that they are used in accordance with applicable manufacturers' recommendations. All appropriate PPE must be provided and utilized throughout the duration of applicable tasks.

Operation of Motorized Vehicles: Moving vehicles can be a danger whether one is within or outside of a vehicle. Distracted drivers, drivers under the influence of drugs/alcohol, tired drivers can all lead to injury, damage or death. Only authorized workers may operate motorized vehicles. Site conditions may include off-road surfaces and operation should be performed according to ground conditions. Authorized drivers must comply with all applicable state laws while operating the vehicle and possess the appropriate qualifications. Loads shall be secured and within the appropriate weight limit for the vehicle (including the number of passengers). Vehicles shall be inspected prior to use and taken out of commission if deemed unsafe. The vehicles shall be properly maintained. Operators are not to be distracted, should wear seatbelts anytime a vehicle is in motion and headlights shall be used during operation. Operation by an

employee who has recently partaken in consumption of alcoholic beverages and/or illegal drugs is prohibited.

6.2 Chemical Hazards

Previously identified chemicals used at various locations throughout the Facility, thus potentially contained in soil and groundwater, include:

Chemical	OSHA Permissible Exposure Limit (PEL), 8-Hour Time-Weighted Average (TWA)	OSHA Short-term Exposure Limit (STEL)
Tetrachloroethylene	25 ppm*	100 ppm
Trichloroethylene	25 ppm	100 ppm
1,2-Dichloroethene	200 ppm	n/a
Vinyl Chloride	1 ppm	n/a
Freon-113	500 ppm	n/a

*ppm = parts per million

In addition, the following site-related chemicals may be encountered during the SWMU removal work. General information on these chemicals is included in Attachment C:

- Tetramethylammonium hydroxide (TMAH)
- Hydrogen Chloride
- Sodium Hydroxide
- Sulfuric Acid
- Hydrofluoric Acid
- Nitric Acid
- Methanol
- Ethylene Glycol
- Acetic Acid
- Acetone
- Isopropanol
- 1,2-Propanediol
- Butyl Acetate
- Ethanol
- Potassium Hydroxide
- General Solvent Wastewater

The major route of exposure to these contaminants will be respiratory in nature, however dermal exposure is also possible. Inhalation of vapors and contaminated dusts would provide the mechanism for respiratory exposure. Skin contact with soils and groundwater would result in dermal exposure. Facility-related work will use engineering controls, work practices, air monitoring and personnel protective equipment to reduce the amount of potential exposure. The tasks to be performed covered under this HASP present a low health risk for inhalation and dermal exposure given the anticipated potential to encounter contaminated material. Restricting access to controlled work areas, staying upwind of potential sources, adhering to personal hygiene practices and wearing proper safety equipment will reduce risk of injuries.

During construction, excavation, sampling and soil management activities, air monitoring shall be performed with a PID and/or multi-gas meter to determine if workers are at risk for chemical exposure. Air monitoring equipment shall be calibrated daily and noted in a log book. Air monitoring shall be performed by trained Walden individuals, only. If concentrations exceed the TWA values listed in the table above, the SSO shall immediately instruct the workers to stop work. Once everyone is removed from the work area, the SSO shall consider the following measures, listed in order from most desirable to least desirable:

- Installation of engineering controls (e.g. ventilation, containment of source);
- Administrative controls; and
- Donning of PPE; upgrading PPE.

The SSO shall decide which of the above options are feasible and make a rational decision based on available resources. Workers shall not be allowed back into the work zone until the chemical hazard is properly mitigated, with no exceptions. Refer to Section 7.2 below for further information.

6.3 Biological Hazards

Potential biological hazards include illnesses and/or injuries transmitted by animals, insects, and pathogenic agents.

6.3.1 Animals

During operations at the Facility, animals such as dogs, pigeons, sea gulls, mice, and rats may be encountered. Contact with such animals can cause rabies (dog's or squirrel's bite); Hantavirus (rat and mice droppings); psittacosis, cryptococcosis, and histoplasmosis (dried bird droppings). Workers will use discretion and avoid all contact with animals.

6.3.2 *Insects*

Bees, wasps, hornets, mosquitoes, ticks and spiders may be present at the Facility. Some individuals may have severe allergic reactions to an insect bite or sting that can result in a life-threatening condition. In addition, mosquito bites may lead to St. Louis encephalitis or West Nile encephalitis. Personnel that have been bitten or stung by an insect during work at the Facility should notify the SSO or Project Manager of such an incident immediately. Workers will wear protective clothing and footwear, apply insect repellent prior to work, and avoid contact while outside with bushes, tall grass, or brush to the extent possible. Field personnel who may have insect allergies should provide this information to the SSO or Project Manager in advance and will have allergy medication on-hand.

6.3.3 *Blood-borne Pathogens*

Blood-borne pathogens (BBPs) include diseases that can be transmitted by contact with blood or other bodily fluids as well as contaminated items which may be encountered (e.g., used syringes, medical pads, etc.). Universal precautions shall be used when administering first aid. Good hygiene practices and proper decontamination of non-disposable PPE will minimize potential for transmission of BBPs.

7.0 EXPOSURE MONITORING

The following is a discussion of the hazards presented to worker personnel during work at this Facility from on-site physical and chemical hazards known, suspected or anticipated to be present on-site at the time this HASP was prepared.

7.1 Noise

Noise levels are measured in units of dBA, which matches the response of the human ear, and are measured on the A-scale of a standard sound level meter at slow response. Normal conversation produces a noise level of 60 dBA, while power tools often produce levels between 90-110 dBA. If two people standing an arm's length apart must raise their voices to talk, the noise level is over 85 dBA. Noise levels above 140 dBA cause pain immediately and produce hearing damage. Decibels are a logarithmic scale, meaning that 100 dBA is ten (10) times as loud as 90 dBA, 100 times as loud as 80 dBA, and 1,000 times as loud as 70 dBA.

Hearing protection (disposable or reusable type) will be utilized by any on-site personnel potentially exposed to either continuous or impact noise levels exceeding 90 dBA (slow response) for an 8-hour work shift. Should employees be exposed to such sound levels, all feasible administrative and engineering controls shall be utilized. If such controls fail to reduce sound levels within the specified sound levels provided in the table below, PPE shall be provided and used to reduce sound levels within the levels provided in the table. A sound is considered if the variations in noise level involve maxima intervals of one (1) second or less. Exposure to impulsive or impact noise should not exceed 140 dB peak sound pressure level.

Permissible Noise Exposure Table

<u>Duration Per Day (Hours)</u>	<u>Sound Level (dBA)</u>
8	90
6	92
4	95
3	97
2	100
1.5	102
1	105
0.5	110
0.25	115

7.1.1 Hearing Conservation Program

In all cases where the sound levels exceed the values shown in the table above, a continuing, effective hearing conservation program shall be administered. The program shall equip employees with the knowledge and hearing protection devices necessary to safeguard themselves from occupational hearing loss. The program shall consist of the following elements:

- Monitoring of employee noise exposures;
- The institution of engineering, work practice, and administrative controls for excessive noise;
- The provision of each overexposed employee with an individually fitted hearing protector with an adequate noise reduction rating;
- Employee training and education regarding noise hazards and protection measures;
- Baseline and annual audiometry;
- Procedures for preventing further occupational hearing loss by an employee whenever such an event has been identified; and
- Record keeping.

7.2 Chemical Contaminants

OSHA Permissible Exposure Limits (PEL) and American Conference of Governmental Industrial Hygienists (ACGIH) Threshold Limit Values (TLV) may be exceeded during soil and groundwater investigative activities or when contaminated media are exposed or disturbed during construction or other activities, including SWMU removal. Even though the anticipated risk of exposure to chemical contaminants is considered to be low for the activities covered under this HASP, these activities will be closely monitored and evaluated to determine potential for exceeding standards and the need to implement control measures to protect personnel and the environment.

7.2.1 Air Monitoring

Direct reading instruments will be used in active work areas in order to enable rapid field decisions regarding levels of respiratory protection, as well as indicate the need for increased monitoring frequency at the edge of the exclusion zone. Walden staff will conduct air monitoring during SWMU removal and all intrusive activities.

A MiniRAE or equivalent PID, which is calibrated daily and adjusted to give maximum sensitivity to the contaminants of concern will be used to monitor the air on a continuous basis while SWMU removal and intrusive activities are performed. Should the meter read 0.5 parts per million (ppm) or greater above background in the breathing zone for more than one (1)

minute and the source of the reading is unknown, work will be stopped until PPE is upgraded; the same holds true if the meter reads greater than five (5) ppm above background levels in the breathing zone for more than thirty (30) continuous seconds.

PPE requirements and upgrade thresholds are summarized in the tables presented below.

Personal Protective Equipment Requirements Table

Location	Level of Protection/Tasks	Description
Support Zone	D	Steel toe boots and work clothes
Exclusion Zone and Contaminant Reduction Zone	To be determined by the site safety officer based on contamination present	
	D (modified)	Steel toe boots, nitrile or latex gloves, hard hat, safety glasses
	C	Full face respirator fitted with organic vapor cartridge and Level D PPE.
	B	Positive pressure, pressure demand self-contained breathing apparatus or positive pressure, pressure demand supplied air and Level C PPE.

Air Monitoring Action Levels Table

Instrument	Hazard Monitored	Instrument Reading	Action Required
PID	Organic Vapors	0.5 ppm or greater above background in the breathing zone for 1 minute and the source of the reading is unknown. 5 ppm or greater above background in the breathing zone for 30 continuous seconds	PPE will be upgraded to Level C. Stop work. Evaluate the source and upgrade Level C to Level B.
Combustible Gas Indicator	Explosive Vapors	>10% LEL	Explosion hazard! Withdraw from the area immediately until LEL <10%.
Oxygen Meter	Oxygen	<19.5% O ₂	Stop work and withdraw from area until oxygen levels increase.

The following are examples of actions that can be implemented in addition to PPE upgrades to reduce the potential for contaminant release and exposure:

- Cover areas of exposed soils;
- Increase ventilation; and
- Install measures to contain areas of contaminant release.

7.3 Calibration

Any exposure monitoring instruments used will be calibrated at the beginning of each work shift, in accordance with the manufacturer's recommendations. If the owner's manual is not available, the personnel operating the equipment will contact the applicable office representative, rental agency or manufacturer for technical guidance for proper calibration. If equipment cannot be pre-calibrated to specifications, operations requiring monitoring for worker exposure will be postponed or temporarily ceased until this requirement is completed.

8.0 PERSONAL PROTECTIVE EQUIPMENT

The purpose of PPE is to provide a barrier, which will shield or isolate individuals from the chemical and/or physical hazards that may be encountered during work activities. The level of worker protection can be increased or reduced if determined by an employee exposure assessment. Until an employee exposure assessment is complete, the following procedures and PPE shall be made available:

- Head protection;
- Foot protection;
- Hand protection;
- Eye protection;
- Hearing protection; and
- Respiratory protection.

By signing this HASP (Section 9.0) the employee agrees to having been trained in the use, limitations, care and maintenance of the PPE to be used by the employee at this project. If training has not been provided, request same of the SSO for the proper training before signing.

8.1 Head Protection

Workers and individuals within work areas where overhead work is being performed must wear protective helmets. The protective helmets will reduce the potential for permanent injury to the head from falling and/or sharp edged objects. The head protection shall comply with the ANSI and the International Safety Equipment Association (ISEA) latest standard ANSI/ISEA Z89.1-2014, "Industrial Head Protection".

8.2 Foot Protection

All personnel and individuals in the work areas will wear steel-toed or equivalent protective footwear to help prevent foot injuries from falling or rolling objects, objects piercing the footwear sole, and/or exposure to electrical hazards. The footwear will be properly secured to the feet at all times. Protective footwear will comply with the American National Standard for Safety-Toe Footwear, Z41.1-1967.

8.3 Hand Protection

All workers entering the work areas will use hand protection to prevent injuries caused from exposure, abrasions, lacerations, and burns of any type. The performance characteristics of the

hand protection will reflect the task(s) of the individual worker. If worn, protective disposable clothing will cover the hand protection as much as possible.

8.4 Eye Protection

All workers and individuals within the work areas will use appropriate eye protection to reduce the potential of damage caused by splashing, falling or flying objects/materials. The eye protection should fit securely on the face so the objects/materials will not enter from any side of the protection (goggles that seal to the face using an elastic headband are recommended). Eye protection will comply with ANSI/ISEA Z87.1-2015 Standards.

8.5 Hearing Protection

All workers and individuals within the work areas will use appropriate hearing protection if operations produce noise levels that exceed levels given in the permissible noise exposure table provided in Section 7.1. Exposure to impulsive or impact noise should not exceed 140 dBA peak sound pressure level. Hearing protection will be recommended if either continuous or impact noise levels exceed 90 dBA (slow response) for an 8-hour work shift. If unable to carry out conversation at an arm length or at three (3) feet distance, hearing protection such as ear plugs or muffs will be used. Hearing protection selected must control employee exposures to comply with OSHA permissible noise standards if noise levels exceed OSHA permissible noise levels. Where disposable earplugs are selected, sufficient supplies will be maintained on-site to allow for multiple changeovers per day, per worker. A non-“roll-down” type earplug, such as the E-A-R Pod Plug, should be considered to reduce the potential for ear canal contamination.

8.6 Respiratory Protection

All personnel and individuals in the work areas will wear respiratory protective equipment when needed, to help prevent exposure to any fumes, vapors, dust, and other respiratory hazards that may be encountered during on-site activities. The respirators (if needed) will be properly fitted and employees who wear or may wear respiratory protection will undergo fit-testing. Respiratory protection will comply with applicable National Institute for Occupational Safety and Health (NIOSH) and American Society for Testing and Materials (ASTM) International Standards depending on the type of PPE to be worn.

During work activities including, but not limited to, saw-cutting of concrete and the operation of power tools such as jackhammers, grinders or drills on concrete or cement (none presently anticipated as part of the SWMU removal work), personnel will wear protective equipment to prevent the inhalation of dust and silica particles.

8.7 PPE Program

PPE will be required when work activities generate and/or involve known or suspected atmospheric vapors, gases, liquids, or particulates at or above satisfactory health and safety levels or regulatory action limits. Protective equipment shall be ANSI/ISEA/NIOSH-approved.

For the work covered under this HASP, PPE should typically comprise Level D or Level C protection. Should air monitoring indicate that Level D fails to meet protection requirements, work shall be stopped and PPE shall be upgraded to Level C. Level D PPE consists of:

- Standard work uniform with coveralls or tyvek, as needed;
- Steel-toe and steel shank work boots;
- Hard hat;
- Gloves, as needed;
- Safety glasses; and
- Hearing protection, as needed.

Level C PPE consists of:

- Full face respirator fitted with appropriate organic vapor cartridge and Level D PPE.

8.7.1 Inspections

Before use of protective clothing, all personnel shall determine that the clothing material is correct for the specified task at hand. The clothing is to be visually inspected for imperfect seams, non-uniform coatings, tears and malfunctioning closures.

Before using gloves, they are to be checked for pinhole leaks. It is imperative that any equipment found to be defective be replaced immediately.

8.7.2 Donning/Doffing of Personal Protective Equipment

The following information is to provide on-site personnel with helpful hints that, when applied, make donning and doffing of PPE a safer and more manageable task:

- Have a “buddy” check your ensemble to ensure proper donning before entering controlled work areas. Without mirrors, the most obvious discrepancies can go unnoticed and may result in a potential exposure situation;
- Never perform personal decontamination with a pressure washer;
- Decontamination of equipment with water and a detergent shall be performed while PPE is still worn; and

- PPE will be removed and personnel will thoroughly wash their hands prior to leaving the Facility.

All PPE is to be bagged and contained in the proper receptacle prior to proper off-site disposal.

9.0 RECORD OF HASP ACKNOWLEDGEMENT


I certify that I have thoroughly read and fully understand the information in this HASP for SWMU removal and intrusive activities performed at the iPark 84 Facility. I understand the associated potential health and safety hazards and issues.

I certify that I have been trained in the use, care, and limitations of the PPE that could be used.

My signature below is official record that I comply with provisions of the HASP and federal, state, and local health and safety regulations and guidelines.

[illegible]

ATTACHMENT A
iPARK 84 FACILITY SITE MAP

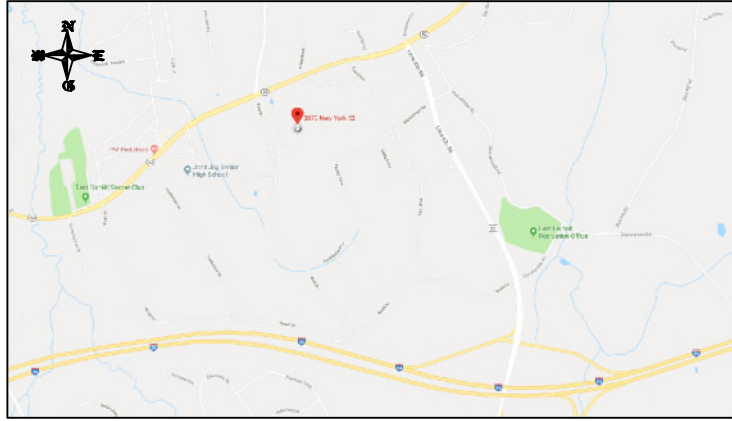

SITE LOCATION

NOT TO SCALE

SOURCE: GOOGLEMAPS.COM



SITE PLAN

1" = 800'-0"



SCALE: 1"=800'

LEGEND

PROPERTY LINE

SITE BASEMAP: CHAZAN ENGINEERING, LAND SURVEYING & LANDSCAPE ARCHITECTURE CO. D.P.C.
POUGHKEEPSIE, NY (XBASE-SVY_51421-00.DWG 8/10/15); PARCELS: XSUBD_51539-00.DWG.

- UNAUTHORIZED ALTERATION OR ADDITION TO THIS PLAN IS A VIOLATION OF SECTION 7209 OF NEW YORK STATE EDUCATION LAW.
- COPIES OF THIS PLAN NOT BEARING THE PROFESSIONAL ENGINEER'S INKED SEAL OR EMBOSSED SEAL SHALL NOT BE CONSIDERED TO BE A VALID TRUE COPY.



WALDEN ENVIRONMENTAL ENGINEERING, PLLC
16 SPRING STREET
OYSTER BAY, NEW YORK 11771
P: (516) 624-7200 F: (516) 624-3219

WWW.WALDENENVIRONMENTALENGINEERING.COM

NO	DATE	REVISION COMMENTS
0	1/22/19	HEALTH & SAFETY PLAN

FOR:
IPARK CAMPUS
2070 ROUTE 52
Hopewell Junction, New York

DESIGNED BY: LL
APPROVED BY: JMH

DRAWN BY: LTG
SCALE: AS NOTED

DRAWING TITLE:
HEALTH AND SAFETY PLAN
iPARK CAMPUS

JOB NO: iPARK0118.23
DATE: January 22, 2019
SHEET NO: 1 OF 1

DRAWING NO:
1
REVISION NO:
0

ATTACHMENT B
EMERGENCY ROOM DIRECTIONS

Google Maps

2070 NY-52, Hopewell Junction, NY 12533 to St Luke's Cornwall Hospital

Drive 15.4 miles, 22 min

Map data ©2018 Google 2 mi

2070 NY-52

Hopewell Junction, NY 12533

- Get on I-84 from NY-52 E and Lime Kiln Rd
- ↑

1. Head southeast toward North Dr

⚠

Restricted usage road

5 min (2.4 mi)

↙

2. Slight left onto North Dr

⚠

Restricted usage road

443 ft

↘

3. Turn right onto West Dr

⚠

Restricted usage road

52 ft

↘

4. Turn right onto NY-52 E

0.2 mi

↘

5. Turn right onto Lime Kiln Rd

0.5 mi

⤴



6. Use the right 2 lanes to take the I-84 W ramp

1.1 mi








0.5 mi

Follow I-84 to NY-32 S/N Plank Rd in Balmville. Take exit 10S from I-84

11 min (11.3 mi)

-  7. Merge onto I-84 11.1 mi
-
-  8. Take exit 10S for NY-32 toward US-9W S/Newburgh 0.2 mi
-

Take Robinson Ave and Dubois St to your destination in Newburgh

-  9. Turn right onto NY-32 S/N Plank Rd (signs for Route 9w S) 6 min (1.7 mi)
-
-  10. Use the right 2 lanes to turn right onto Robinson Ave 0.2 mi
-
-  11. Turn left onto South St 0.9 mi
-
-  12. Turn right onto Dubois St 0.3 mi
-
-  13. Turn left 0.3 mi
-
-  14. Turn left 246 ft
-  Destination will be on the left
-
- 125 ft

St Luke's Cornwall Hospital

70 Dubois St, Newburgh, NY 12550

These directions are for planning purposes only. You may find that construction projects, traffic, weather, or other events may cause conditions to differ from the map results, and you should plan your route accordingly. You must obey all signs or notices regarding your route.

ATTACHMENT C
SAFETY DATA SHEETS & GENERAL CHEMICAL INFORMATION

SAFETY DATA SHEET

Version 6.2
Revision Date 06/17/2019
Print Date 01/05/2020

SECTION 1: Identification of the substance/mixture and of the company/undertaking**1.1 Product identifiers**

Product name : Tetramethylammonium hydroxide solution

Product Number : 331635

Brand : Sigma-Aldrich

1.2 Relevant identified uses of the substance or mixture and uses advised against

Identified uses : Laboratory chemicals, Synthesis of substances

1.3 Details of the supplier of the safety data sheet

Company : Sigma-Aldrich Inc.
3050 Spruce Street
ST. LOUIS MO 63103
UNITED STATES

Telephone : +1 314 771-5765

Fax : +1 800 325-5052

1.4 Emergency telephone number

Emergency Phone # : +1-703-527-3887

SECTION 2: Hazards identification**2.1 Classification of the substance or mixture****GHS Classification in accordance with 29 CFR 1910 (OSHA HCS)**

Acute toxicity, Oral (Category 2), H300
Acute toxicity, Dermal (Category 2), H310
Skin corrosion (Category 1), H314
Serious eye damage (Category 1), H318
Specific target organ toxicity - single exposure (Category 1), Central nervous system, H370
Specific target organ toxicity - repeated exposure, Dermal (Category 1), thymus gland, Liver, H372
Short-term (acute) aquatic hazard (Category 2), H401
Long-term (chronic) aquatic hazard (Category 2), H411

For the full text of the H-Statements mentioned in this Section, see Section 16.

2.2 GHS Label elements, including precautionary statements

Pictogram



Signal word

Danger

Hazard statement(s)	
H300 + H310	Fatal if swallowed or in contact with skin.
H314	Causes severe skin burns and eye damage.
H370	Causes damage to organs (Central nervous system).
H372	Causes damage to organs (thymus gland, Liver) through prolonged or repeated exposure in contact with skin.
H411	Toxic to aquatic life with long lasting effects.
Precautionary statement(s)	
P260	Do not breathe dust/ fume/ gas/ mist/ vapours/ spray.
P262	Do not get in eyes, on skin, or on clothing.
P264	Wash skin thoroughly after handling.
P270	Do not eat, drink or smoke when using this product.
P273	Avoid release to the environment.
P280	Wear protective gloves/ protective clothing/ eye protection/ face protection.
P301 + P310 + P330	IF SWALLOWED: Immediately call a POISON CENTER/doctor. Rinse mouth.
P301 + P330 + P331	IF SWALLOWED: Rinse mouth. Do NOT induce vomiting.
P302 + P350 + P310	IF ON SKIN: Gently wash with plenty of soap and water. Immediately call a POISON CENTER or doctor/ physician.
P303 + P361 + P353	IF ON SKIN (or hair): Take off immediately all contaminated clothing. Rinse skin with water/shower.
P304 + P340 + P310	IF INHALED: Remove person to fresh air and keep comfortable for breathing. Immediately call a POISON CENTER/doctor.
P305 + P351 + P338 + P310	IF IN EYES: Rinse cautiously with water for several minutes. Remove contact lenses, if present and easy to do. Continue rinsing. Immediately call a POISON CENTER/doctor.
P307 + P311	IF exposed: Call a POISON CENTER or doctor/ physician.
P362	Take off contaminated clothing and wash before reuse.
P391	Collect spillage.
P405	Store locked up.
P501	Dispose of contents/ container to an approved waste disposal plant.

2.3 Hazards not otherwise classified (HNOC) or not covered by GHS

Rapidly absorbed through skin.

SECTION 3: Composition/information on ingredients

3.2 Mixtures

Molecular weight : 91.15 g/mol

Component		Classification	Concentration
Tetramethylammonium hydroxide			
CAS-No.	75-59-2	Acute Tox. 2; Acute Tox. 1; Skin Corr. 1B; Eye Dam. 1; STOT SE 1; STOT RE 1; Aquatic Acute 2; Aquatic Chronic 2; H300, H310, H314, H318, H370, H372, H401, H411 Concentration limits:	>= 30 - < 50 %
EC-No.	200-882-9		

	>= 25 %: Acute Tox. 1, H310; 6.25 - < 25 %: Acute Tox. 2, H310; 1.25 - < 6.25 %: Acute Tox. 3, H311; 0.625 - 1.25 %: Acute Tox. 4, H312;	
--	---	--

For the full text of the H-Statements mentioned in this Section, see Section 16.

SECTION 4: First aid measures

4.1 Description of first aid measures

General advice

Consult a physician. Show this safety data sheet to the doctor in attendance. Move out of dangerous area.

If inhaled

If breathed in, move person into fresh air. If not breathing, give artificial respiration. Consult a physician.

In case of skin contact

Take off contaminated clothing and shoes immediately. Wash off with soap and plenty of water. Take victim immediately to hospital. Consult a physician.

In case of eye contact

Rinse thoroughly with plenty of water for at least 15 minutes and consult a physician. Continue rinsing eyes during transport to hospital.

If swallowed

Do NOT induce vomiting. Never give anything by mouth to an unconscious person. Rinse mouth with water. Consult a physician.

4.2 Most important symptoms and effects, both acute and delayed

The most important known symptoms and effects are described in the labelling (see section 2.2) and/or in section 11

4.3 Indication of any immediate medical attention and special treatment needed

No data available

SECTION 5: Firefighting measures

5.1 Extinguishing media

Suitable extinguishing media

Use water spray, alcohol-resistant foam, dry chemical or carbon dioxide.

5.2 Special hazards arising from the substance or mixture

Carbon oxides, Nitrogen oxides (NOx), Hydrogen chloride gas

5.3 Advice for firefighters

Wear self-contained breathing apparatus for firefighting if necessary.

5.4 Further information

No data available

SECTION 6: Accidental release measures

6.1 Personal precautions, protective equipment and emergency procedures

Wear respiratory protection. Avoid breathing vapours, mist or gas. Ensure adequate ventilation. Evacuate personnel to safe areas.

For personal protection see section 8.

6.2 Environmental precautions

Prevent further leakage or spillage if safe to do so. Do not let product enter drains. Discharge into the environment must be avoided.

6.3 Methods and materials for containment and cleaning up

Soak up with inert absorbent material and dispose of as hazardous waste. Keep in suitable, closed containers for disposal.

6.4 Reference to other sections

For disposal see section 13.

SECTION 7: Handling and storage

7.1 Precautions for safe handling

Avoid contact with skin and eyes. Avoid inhalation of vapour or mist.

For precautions see section 2.2.

7.2 Conditions for safe storage, including any incompatibilities

Keep container tightly closed in a dry and well-ventilated place. Containers which are opened must be carefully resealed and kept upright to prevent leakage.

Storage class (TRGS 510): 6.1A: Combustible, acute toxic Cat. 1 and 2 / very toxic hazardous materials

7.3 Specific end use(s)

Apart from the uses mentioned in section 1.2 no other specific uses are stipulated

SECTION 8: Exposure controls/personal protection

8.1 Control parameters

Components with workplace control parameters

Contains no substances with occupational exposure limit values.

8.2 Exposure controls

Appropriate engineering controls

Avoid contact with skin, eyes and clothing. Wash hands before breaks and immediately after handling the product.

Personal protective equipment

Eye/face protection

Tightly fitting safety goggles. Faceshield (8-inch minimum). Use equipment for eye protection tested and approved under appropriate government standards such as NIOSH (US) or EN 166(EU).

Skin protection

Handle with gloves. Gloves must be inspected prior to use. Use proper glove removal technique (without touching glove's outer surface) to avoid skin contact

with this product. Dispose of contaminated gloves after use in accordance with applicable laws and good laboratory practices. Wash and dry hands.

Full contact

Material: Nitrile rubber

Minimum layer thickness: 0.11 mm

Break through time: 480 min

Material tested: Dermatrill® (KCL 740 / Aldrich Z677272, Size M)

Splash contact

Material: Nitrile rubber

Minimum layer thickness: 0.11 mm

Break through time: 480 min

Material tested: Dermatrill® (KCL 740 / Aldrich Z677272, Size M)

data source: KCL GmbH, D-36124 Eichenzell, phone +49 (0)6659 87300, e-mail sales@kcl.de, test method: EN374

If used in solution, or mixed with other substances, and under conditions which differ from EN 374, contact the supplier of the CE approved gloves. This recommendation is advisory only and must be evaluated by an industrial hygienist and safety officer familiar with the specific situation of anticipated use by our customers. It should not be construed as offering an approval for any specific use scenario.

Body Protection

Complete suit protecting against chemicals, The type of protective equipment must be selected according to the concentration and amount of the dangerous substance at the specific workplace.

Respiratory protection

Where risk assessment shows air-purifying respirators are appropriate use a full-face respirator with multi-purpose combination (US) or type ABEK (EN 14387) respirator cartridges as a backup to engineering controls. If the respirator is the sole means of protection, use a full-face supplied air respirator. Use respirators and components tested and approved under appropriate government standards such as NIOSH (US) or CEN (EU).

Control of environmental exposure

Prevent further leakage or spillage if safe to do so. Do not let product enter drains. Discharge into the environment must be avoided.

SECTION 9: Physical and chemical properties

9.1 Information on basic physical and chemical properties

- | | |
|--|----------------------------------|
| a) Appearance | Form: liquid |
| b) Odour | No data available |
| c) Odour Threshold | No data available |
| d) pH | > 13 at 20 °C (68 °F) |
| e) Melting point/freezing point | No data available |
| f) Initial boiling point and boiling range | No data available |
| g) Flash point | > 100 °C (> 212 °F) - closed cup |
| h) Evaporation rate | No data available |

i)	Flammability (solid, gas)	No data available
j)	Upper/lower flammability or explosive limits	No data available
k)	Vapour pressure	23.33 hPa at 20 °C (68 °F)
l)	Vapour density	No data available
m)	Relative density	No data available
n)	Water solubility	No data available
o)	Partition coefficient: n-octanol/water	No data available
p)	Auto-ignition temperature	No data available
q)	Decomposition temperature	No data available
r)	Viscosity	No data available
s)	Explosive properties	No data available
t)	Oxidizing properties	No data available

9.2 Other safety information

No data available

SECTION 10: Stability and reactivity

10.1 Reactivity

No data available

10.2 Chemical stability

Stable under recommended storage conditions.

10.3 Possibility of hazardous reactions

No data available

10.4 Conditions to avoid

No data available

10.5 Incompatible materials

Aluminium, Alkali metals, Strong oxidizing agents, Acids, Acid chlorides, Acid anhydrides, Halogens

10.6 Hazardous decomposition products

Hazardous decomposition products formed under fire conditions. - Carbon oxides, Nitrogen oxides (NO_x), Hydrogen chloride gas

Other decomposition products - No data available

In the event of fire: see section 5

SECTION 11: Toxicological information

11.1 Information on toxicological effects

Acute toxicity

No data available

Inhalation: No data available

LD50 Dermal - Rat - 449 mg/kg

LD50 Dermal - Rat - 112 mg/kg

Dermal: No data available

No data available

Skin corrosion/irritation

No data available

Serious eye damage/eye irritation

No data available

Respiratory or skin sensitisation

No data available

Germ cell mutagenicity

No data available

Carcinogenicity

IARC: No component of this product present at levels greater than or equal to 0.1% is identified as probable, possible or confirmed human carcinogen by IARC.

NTP: No component of this product present at levels greater than or equal to 0.1% is identified as a known or anticipated carcinogen by NTP.

OSHA: No component of this product present at levels greater than or equal to 0.1% is on OSHA's list of regulated carcinogens.

Reproductive toxicity

No data available

No data available

Specific target organ toxicity - single exposure

No data available

Specific target organ toxicity - repeated exposure

No data available

Aspiration hazard

No data available

Additional Information

RTECS: Not available

Material is extremely destructive to tissue of the mucous membranes and upper respiratory tract, eyes, and skin., Symptoms of exposure may include burning sensation, coughing, wheezing, laryngitis, shortness of breath, headache, nausea, and vomiting., Inhalation of vapors may cause:, pulmonary edema, spasm, inflammation and edema of the bronchi, spasm, inflammation and edema of the larynx, To the best of our knowledge, the chemical, physical, and toxicological properties have not been thoroughly investigated.

SECTION 12: Ecological information

12.1 Toxicity

No data available

Toxicity to daphnia and other aquatic invertebrates EC50 - Daphnia magna (Water flea) - 3.0 mg/l - 48 h

12.2 Persistence and degradability

No data available

12.3 Bioaccumulative potential

No data available

12.4 Mobility in soil

No data available

12.5 Results of PBT and vPvB assessment

PBT/vPvB assessment not available as chemical safety assessment not required/not conducted

12.6 Other adverse effects

An environmental hazard cannot be excluded in the event of unprofessional handling or disposal.

Toxic to aquatic life with long lasting effects.

SECTION 13: Disposal considerations

13.1 Waste treatment methods

Product

Offer surplus and non-recyclable solutions to a licensed disposal company. Contact a licensed professional waste disposal service to dispose of this material. Dissolve or mix the material with a combustible solvent and burn in a chemical incinerator equipped with an afterburner and scrubber.

Contaminated packaging

Dispose of as unused product.

SECTION 14: Transport information

DOT (US)

UN number: 1835 Class: 8

Packing group: II

Proper shipping name: Tetramethylammonium hydroxide solution

Reportable Quantity (RQ):

Poison Inhalation Hazard: No

IMDG

UN number: 1835 Class: 8

Packing group: II

EMS-No: F-A, S-B

Proper shipping name: TETRAMETHYLAMMONIUM HYDROXIDE SOLUTION

IATA

SECTION 15: Regulatory information**SARA 302 Components**

No chemicals in this material are subject to the reporting requirements of SARA Title III, Section 302.

SARA 313 Components

This material does not contain any chemical components with known CAS numbers that exceed the threshold (De Minimis) reporting levels established by SARA Title III, Section 313.

SARA 311/312 Hazards

Acute Health Hazard

Massachusetts Right To Know Components

No components are subject to the Massachusetts Right to Know Act.

Pennsylvania Right To Know Components

	CAS-No.	Revision Date
Water	7732-18-5	
Tetramethylammonium hydroxide	75-59-2	2007-03-01
Chloride	-	

SECTION 16: Other information**Further information**

Copyright 2018 Sigma-Aldrich Co. LLC. License granted to make unlimited paper copies for internal use only.

The above information is believed to be correct but does not purport to be all inclusive and shall be used only as a guide. The information in this document is based on the present state of our knowledge and is applicable to the product with regard to appropriate safety precautions. It does not represent any guarantee of the properties of the product. Sigma-Aldrich Corporation and its Affiliates shall not be held liable for any damage resulting from handling or from contact with the above product. See www.sigma-aldrich.com and/or the reverse side of invoice or packing slip for additional terms and conditions of sale.

The branding on the header and/or footer of this document may temporarily not visually match the product purchased as we transition our branding. However, all of the information in the document regarding the product remains unchanged and matches the product ordered. For further information please contact mlsbranding@sial.com.

Version: 6.2

Revision Date: 06/17/2019

Print Date: 01/05/2020

SAFETY DATA SHEET

Creation Date 22-Sep-2009

Revision Date 23-Jan-2018

Revision Number 3

1. Identification

Product Name cis-1,2-Dichloroethylene

Cat No. : AC113380000; AC113380025; AC113380100; AC113380500

Synonyms cis-Acetylene dichloride.

Recommended Use Laboratory chemicals.

Uses advised against Not for food, drug, pesticide or biocidal product use

Details of the supplier of the safety data sheet

Company

Fisher Scientific
One Reagent Lane
Fair Lawn, NJ 07410
Tel: (201) 796-7100

Acros Organics
One Reagent Lane
Fair Lawn, NJ 07410

Emergency Telephone Number

For information **US** call: 001-800-ACROS-01 / **Europe** call: +32 14 57 52 11

Emergency Number **US**:001-201-796-7100 / **Europe**: +32 14 57 52 99

CHEMTREC Tel. No.**US**:001-800-424-9300 / **Europe**:001-703-527-3887

2. Hazard(s) identification

Classification

This chemical is considered hazardous by the 2012 OSHA Hazard Communication Standard (29 CFR 1910.1200)

Flammable liquids	Category 2
Acute oral toxicity	Category 4
Acute Inhalation Toxicity - Vapors	Category 4
Skin Corrosion/irritation	Category 2
Serious Eye Damage/Eye Irritation	Category 2
Specific target organ toxicity (single exposure)	Category 3
Target Organs - Respiratory system.	

Label Elements

Signal Word

Danger

Hazard Statements

Highly flammable liquid and vapor
Harmful if swallowed
Harmful if inhaled
Causes serious eye irritation
Causes skin irritation
May cause respiratory irritation

**Precautionary Statements****Prevention**

Wear protective gloves/protective clothing/eye protection/face protection

Use only outdoors or in a well-ventilated area

Avoid breathing dust/fume/gas/mist/vapors/spray

Keep away from heat/sparks/open flames/hot surfaces. - No smoking

Keep container tightly closed

Ground/bond container and receiving equipment

Take precautionary measures against static discharge

Do not eat, drink or smoke when using this product

Response

Call a POISON CENTER or doctor/physician if you feel unwell

Inhalation

IF INHALED: Remove victim to fresh air and keep at rest in a position comfortable for breathing

Call a POISON CENTER or doctor/physician if you feel unwell

Skin

IF ON SKIN: Wash with plenty of soap and water

Take off contaminated clothing and wash before reuse

If skin irritation occurs: Get medical advice/attention

Eyes

IF IN EYES: Rinse cautiously with water for several minutes. Remove contact lenses, if present and easy to do. Continue rinsing

If eye irritation persists: Get medical advice/attention

Ingestion

Rinse mouth

IF SWALLOWED: Call a POISON CENTER or doctor/physician if you feel unwell

Fire

Explosion risk in case of fire

Fight fire with normal precautions from a reasonable distance

Evacuate area

Storage

Store in a well-ventilated place. Keep cool

Store in a closed container

Store locked up

Disposal

Dispose of contents/container to an approved waste disposal plant

Hazards not otherwise classified (HNOC)

None identified

3. Composition/Information on Ingredients

Component	CAS-No	Weight %
cis-1,2-Dichloroethylene	156-59-2	97

4. First-aid measures

Eye Contact

Rinse immediately with plenty of water, also under the eyelids, for at least 15 minutes. Get medical attention.

Skin Contact

Wash off immediately with plenty of water for at least 15 minutes. Obtain medical attention.

Inhalation	Move to fresh air. Obtain medical attention. If not breathing, give artificial respiration.
Ingestion	Do not induce vomiting. Obtain medical attention.
Most important symptoms and effects	Breathing difficulties. Inhalation of high vapor concentrations may cause symptoms like headache, dizziness, tiredness, nausea and vomiting
Notes to Physician	Treat symptomatically

5. Fire-fighting measures

Suitable Extinguishing Media	Water spray. Carbon dioxide (CO ₂). Dry chemical. Use water spray to cool unopened containers. Chemical foam. Cool closed containers exposed to fire with water spray.
Unsuitable Extinguishing Media	No information available
Flash Point	6 °C / 42.8 °F
Method -	No information available
Autoignition Temperature	440 °C / 824 °F
Explosion Limits	
Upper	12.80%
Lower	9.70%
Sensitivity to Mechanical Impact	No information available
Sensitivity to Static Discharge	No information available

Specific Hazards Arising from the Chemical

Flammable. Vapors may travel to source of ignition and flash back. Containers may explode when heated. Vapors may form explosive mixtures with air.

Hazardous Combustion Products

Hydrogen chloride gas Carbon monoxide (CO) Carbon dioxide (CO₂)

Protective Equipment and Precautions for Firefighters

As in any fire, wear self-contained breathing apparatus pressure-demand, MSHA/NIOSH (approved or equivalent) and full protective gear.

NFPA

Health	Flammability	Instability	Physical hazards
2	3	0	N/A

6. Accidental release measures

Personal Precautions	Ensure adequate ventilation. Use personal protective equipment. Remove all sources of ignition. Take precautionary measures against static discharges. Avoid contact with skin, eyes and clothing.
Environmental Precautions	See Section 12 for additional ecological information. Do not flush into surface water or sanitary sewer system.
Methods for Containment and Clean Up	Soak up with inert absorbent material (e.g. sand, silica gel, acid binder, universal binder, sawdust). Keep in suitable, closed containers for disposal. Remove all sources of ignition. Use spark-proof tools and explosion-proof equipment.

7. Handling and storage

Handling	Ensure adequate ventilation. Wear personal protective equipment. Use explosion-proof equipment. Use only non-sparking tools. Avoid contact with skin, eyes and clothing. Avoid breathing dust/fume/gas/mist/vapors/spray. Avoid ingestion and inhalation. Keep away from open flames, hot surfaces and sources of ignition. Take precautionary measures against static discharges. To avoid ignition of vapors by static electricity discharge, all metal parts of the equipment must be grounded.
-----------------	--

Storage

Keep in a dry, cool and well-ventilated place. Keep container tightly closed. Keep away from heat and sources of ignition. Flammables area. Keep container tightly closed in a dry and well-ventilated place.

8. Exposure controls / personal protection

Exposure Guidelines

Component	ACGIH TLV	OSHA PEL	NIOSH IDLH	Mexico OEL (TWA)
cis-1,2-Dichloroethylene	TWA: 200 ppm			

Legend

ACGIH - American Conference of Governmental Industrial Hygienists

Engineering Measures

Ensure adequate ventilation, especially in confined areas. Use explosion-proof electrical/ventilating/lighting/equipment. Ensure that eyewash stations and safety showers are close to the workstation location.

Personal Protective Equipment**Eye/face Protection**

Wear appropriate protective eyeglasses or chemical safety goggles as described by OSHA's eye and face protection regulations in 29 CFR 1910.133 or European Standard EN166.

Skin and body protection

Wear appropriate protective gloves and clothing to prevent skin exposure.

Respiratory Protection

No protective equipment is needed under normal use conditions.

Hygiene Measures

Handle in accordance with good industrial hygiene and safety practice.

9. Physical and chemical properties

Physical State	Liquid
Appearance	Colorless
Odor	aromatic
Odor Threshold	No information available
pH	No information available
Melting Point/Range	-80 °C / -112 °F
Boiling Point/Range	60 °C / 140 °F @ 760 mmHg
Flash Point	6 °C / 42.8 °F
Evaporation Rate	No information available
Flammability (solid,gas)	Not applicable
Flammability or explosive limits	
Upper	12.80%
Lower	9.70%
Vapor Pressure	201 mmHg @ 25 °C
Vapor Density	3.34 (Air = 1.0)
Specific Gravity	1.280
Solubility	No information available
Partition coefficient; n-octanol/water	No data available
Autoignition Temperature	440 °C / 824 °F
Decomposition Temperature	No information available
Viscosity	No information available
Molecular Formula	C ₂ H ₂ Cl ₂
Molecular Weight	96.94

10. Stability and reactivity

Reactive Hazard	None known, based on information available
Stability	Stable under normal conditions.
Conditions to Avoid	Keep away from open flames, hot surfaces and sources of ignition. Exposure to air. Exposure to light. Incompatible products. Exposure to moist air or water.
Incompatible Materials	Bases
Hazardous Decomposition Products	Hydrogen chloride gas, Carbon monoxide (CO), Carbon dioxide (CO ₂)
Hazardous Polymerization	Hazardous polymerization does not occur.
Hazardous Reactions	None under normal processing.

11. Toxicological information

Acute Toxicity

Product Information

Component Information

Toxicologically Synergistic Products No information available

Delayed and immediate effects as well as chronic effects from short and long-term exposure

Irritation	Irritating to eyes, respiratory system and skin
Sensitization	No information available
Carcinogenicity	The table below indicates whether each agency has listed any ingredient as a carcinogen.

Component	CAS-No	IARC	NTP	ACGIH	OSHA	Mexico
cis-1,2-Dichloroethylene	156-59-2	Not listed	Not listed	Not listed	Not listed	Not listed

Mutagenic Effects No information available

Reproductive Effects No information available.

Developmental Effects No information available.

Teratogenicity No information available.

STOT - single exposure Respiratory system

STOT - repeated exposure None known

Aspiration hazard No information available

Symptoms / effects, both acute and delayed Inhalation of high vapor concentrations may cause symptoms like headache, dizziness, tiredness, nausea and vomiting

Endocrine Disruptor Information No information available

Other Adverse Effects The toxicological properties have not been fully investigated.

12. Ecological information

Ecotoxicity

Do not empty into drains. Do not flush into surface water or sanitary sewer system. Harmful to aquatic organisms, may cause long-term adverse effects in the aquatic environment. The product contains following substances which are hazardous for the environment.

Component	Freshwater Algae	Freshwater Fish	Microtox	Water Flea
-----------	------------------	-----------------	----------	------------

cis-1,2-Dichloroethylene	Not listed	Not listed	EC50 = 721 mg/L 5 min EC50 = 905 mg/L 30 min	Not listed
--------------------------	------------	------------	---	------------

Persistence and Degradability Persistence is unlikely based on information available.

Bioaccumulation/ Accumulation No information available.

Mobility Will likely be mobile in the environment due to its volatility.

13. Disposal considerations

Waste Disposal Methods Chemical waste generators must determine whether a discarded chemical is classified as a hazardous waste. Chemical waste generators must also consult local, regional, and national hazardous waste regulations to ensure complete and accurate classification.

14. Transport information

DOT

UN-No UN1150
 Proper Shipping Name 1,2-DICHLOROETHYLENE
 Hazard Class 3
 Packing Group II

TDG

UN-No UN1150
 Proper Shipping Name 1,2-DICHLOROETHYLENE
 Hazard Class 3
 Packing Group II

IATA

UN-No 1150
 Proper Shipping Name 1,2-DICHLOROETHYLENE
 Hazard Class 3
 Packing Group II

IMDG/IMO

UN-No 1150
 Proper Shipping Name 1,2-DICHLOROETHYLENE
 Hazard Class 3
 Packing Group II

15. Regulatory information

International Inventories

Component	TSCA	DSL	NDSL	EINECS	ELINCS	NLP	PICCS	ENCS	AICS	IECSC	KECL
cis-1,2-Dichloroethylene	X	-	X	205-859-7	-		-	X	X	X	X

Legend:

X - Listed

E - Indicates a substance that is the subject of a Section 5(e) Consent order under TSCA.

F - Indicates a substance that is the subject of a Section 5(f) Rule under TSCA.

N - Indicates a polymeric substance containing no free-radical initiator in its inventory name but is considered to cover the designated polymer made with any free-radical initiator regardless of the amount used.

P - Indicates a commenced PMN substance

R - Indicates a substance that is the subject of a Section 6 risk management rule under TSCA.

S - Indicates a substance that is identified in a proposed or final Significant New Use Rule

T - Indicates a substance that is the subject of a Section 4 test rule under TSCA.

XU - Indicates a substance exempt from reporting under the Inventory Update Rule, i.e. Partial Updating of the TSCA Inventory Data Base Production and Site Reports (40 CFR 710(B)).

Y1 - Indicates an exempt polymer that has a number-average molecular weight of 1,000 or greater.

Y2 - Indicates an exempt polymer that is a polyester and is made only from reactants included in a specified list of low concern reactants that comprises one of the eligibility criteria for the exemption rule.

U.S. Federal Regulations

TSCA 12(b) Not applicable

SARA 313 Not applicable

SARA 311/312 Hazard Categories See section 2 for more information

CWA (Clean Water Act) Not applicable

Clean Air Act Not applicable

OSHA Occupational Safety and Health Administration
Not applicable

CERCLA

California Proposition 65 This product does not contain any Proposition 65 chemicals

U.S. State Right-to-Know Regulations

Component	Massachusetts	New Jersey	Pennsylvania	Illinois	Rhode Island
cis-1,2-Dichloroethylene	X	-	X	-	-

U.S. Department of Transportation

Reportable Quantity (RQ): N
DOT Marine Pollutant N
DOT Severe Marine Pollutant N

U.S. Department of Homeland Security

This product does not contain any DHS chemicals.

Other International Regulations

Mexico - Grade No information available

16. Other information

Prepared By Regulatory Affairs
Thermo Fisher Scientific
Email: EMSDS.RA@thermofisher.com

Creation Date 22-Sep-2009

Revision Date 23-Jan-2018

Print Date 23-Jan-2018

Revision Summary This document has been updated to comply with the US OSHA HazCom 2012 Standard replacing the current legislation under 29 CFR 1910.1200 to align with the Globally Harmonized System of Classification and Labeling of Chemicals (GHS).

Disclaimer

The information provided in this Safety Data Sheet is correct to the best of our knowledge, information and belief at the date of its publication. The information given is designed only as a guidance for safe handling, use, processing, storage, transportation, disposal and release and is not to be considered a warranty or quality specification. The information relates only to the specific material designated and may not be valid for such material used in combination with any other materials or in any process, unless specified in the text

End of SDS

SAFETY DATA SHEET

Revision Date 17-Jan-2018

Revision Number 3

1. Identification

Product Name 1,1,2-Trichloro-1,2,2-trifluoroethane

Cat No. : T178-1; T178-4

Synonyms Fluorocarbon 113; Freon 113; 1,1,2-Trichlorotrifluoroethane

Recommended Use Laboratory chemicals.

Uses advised against Not for food, drug, pesticide or biocidal product use

Details of the supplier of the safety data sheet

Company

Fisher Scientific
One Reagent Lane
Fair Lawn, NJ 07410
Tel: (201) 796-7100

Emergency Telephone Number

CHEMTREC®, Inside the USA: 800-424-9300
CHEMTREC®, Outside the USA: 001-703-527-3887

2. Hazard(s) identification

Classification

Classification under 2012 OSHA Hazard Communication Standard (29 CFR 1910.1200)

Based on available data, the classification criteria are not met

Label Elements

None required

Hazards not otherwise classified (HNOC)

None identified

3. Composition/Information on Ingredients

Component	CAS-No	Weight %
1,1,2-Trichloro-1,2,2-trifluoroethane	76-13-1	99

4. First-aid measures

Eye Contact Rinse immediately with plenty of water, also under the eyelids, for at least 15 minutes.

Skin Contact Wash off immediately with plenty of water for at least 15 minutes.

Inhalation	Move to fresh air.
Ingestion	Do not induce vomiting.
Most important symptoms and effects	No information available.
Notes to Physician	Treat symptomatically

5. Fire-fighting measures

Unsuitable Extinguishing Media	No information available
Flash Point	No information available
Method -	No information available
Autoignition Temperature	770 °C
Explosion Limits	
Upper	No data available
Lower	No data available
Sensitivity to Mechanical Impact	No information available
Sensitivity to Static Discharge	No information available

Specific Hazards Arising from the Chemical

Keep product and empty container away from heat and sources of ignition.

Hazardous Combustion Products

No information available

Protective Equipment and Precautions for Firefighters

As in any fire, wear self-contained breathing apparatus pressure-demand, MSHA/NIOSH (approved or equivalent) and full protective gear.

NFPA

Health	Flammability	Instability	Physical hazards
1	0	0	N/A

6. Accidental release measures

Personal Precautions	Ensure adequate ventilation. Use personal protective equipment.
Environmental Precautions	See Section 12 for additional ecological information.

Methods for Containment and Clean Up No information available.

7. Handling and storage

Handling	Ensure adequate ventilation.
Storage	Keep containers tightly closed in a dry, cool and well-ventilated place.

8. Exposure controls / personal protection

<u>Exposure Guidelines</u>	This product does not contain any hazardous materials with occupational exposure limits established by the region specific regulatory bodies.
----------------------------	---

Component	ACGIH TLV	OSHA PEL	NIOSH IDLH	Mexico OEL (TWA)
1,1,2-Trichloro-1,2,2-trifluoroethane	TWA: 1000 ppm STEL: 1250 ppm	(Vacated) TWA: 1000 ppm (Vacated) TWA: 7600 mg/m ³ (Vacated) STEL: 1250 ppm (Vacated) STEL: 9500 mg/m ³ TWA: 1000 ppm TWA: 7600 mg/m ³	IDLH: 2000 ppm TWA: 1000 ppm TWA: 7600 mg/m ³ STEL: 1250 ppm STEL: 9500 mg/m ³	TWA: 1000 ppm TWA: 1600 mg/m ³ STEL: 1250 ppm STEL: 9500 mg/m ³

Legend

ACGIH - American Conference of Governmental Industrial Hygienists

OSHA - Occupational Safety and Health Administration

NIOSH IDLH: The National Institute for Occupational Safety and Health Immediately Dangerous to Life or Health

Engineering Measures Ensure adequate ventilation, especially in confined areas.

Personal Protective Equipment

Eye/face Protection Wear appropriate protective eyeglasses or chemical safety goggles as described by OSHA's eye and face protection regulations in 29 CFR 1910.133 or European Standard EN166.

Skin and body protection Wear appropriate protective gloves and clothing to prevent skin exposure.

Respiratory Protection Follow the OSHA respirator regulations found in 29 CFR 1910.134 or European Standard EN 149. Use a NIOSH/MSHA or European Standard EN 149 approved respirator if exposure limits are exceeded or if irritation or other symptoms are experienced.

Hygiene Measures Handle in accordance with good industrial hygiene and safety practice.

9. Physical and chemical properties

Physical State	Liquid
Appearance	Clear
Odor	aromatic
Odor Threshold	No information available
pH	No information available
Melting Point/Range	-36 °C
Boiling Point/Range	48 °C
Flash Point	No information available
Evaporation Rate	> 1.0 (Ether = 1.0)
Flammability (solid,gas)	No information available
Flammability or explosive limits	
Upper	No data available
Lower	No data available
Vapor Pressure	363 hPa @ 20 °C
Vapor Density	6.5 (Air = 1.0)
Specific Gravity	1.47 @ 21°C
Solubility	Insoluble in water
Partition coefficient; n-octanol/water	No data available
Autoignition Temperature	770 °C
Decomposition Temperature	No information available
Viscosity	No information available
Molecular Formula	C ₂ Cl ₃ F ₃
Molecular Weight	187.38

10. Stability and reactivity

Reactive Hazard None known, based on information available

Stability	Stable under normal conditions.
Conditions to Avoid	Incompatible products.
Incompatible Materials	Strong acids, Powdered metals
Hazardous Decomposition Products	No information available
Hazardous Polymerization	Hazardous polymerization does not occur.
Hazardous Reactions	None under normal processing.

11. Toxicological information

Acute Toxicity

Component Information

Component	LD50 Oral	LD50 Dermal	LC50 Inhalation
1,1,2-Trichloro-1,2,2-trifluoroethane	LD50 = 43 g/kg (Rat)	Not listed	LC50 = 38000 ppm (Rat) 4 h LC50 = 38500 mg/kg (Rat) 4 h

Toxicologically Synergistic Products No information available

Delayed and immediate effects as well as chronic effects from short and long-term exposure

Irritation No information available

Sensitization No information available

Carcinogenicity The table below indicates whether each agency has listed any ingredient as a carcinogen.

Component	CAS-No	IARC	NTP	ACGIH	OSHA	Mexico
1,1,2-Trichloro-1,2,2-trifluoroethane	76-13-1	Not listed	Not listed	Not listed	Not listed	Not listed

Mutagenic Effects No information available

Reproductive Effects No information available.

Developmental Effects No information available.

Teratogenicity No information available.

STOT - single exposure None known

STOT - repeated exposure None known

Aspiration hazard No information available

Symptoms / effects, both acute and delayed No information available

Endocrine Disruptor Information No information available

Other Adverse Effects The toxicological properties have not been fully investigated.

12. Ecological information

Ecotoxicity

Do not empty into drains. Chlorotrifluoromethane (CFC-13) is a Class I ozone-depleting chlorofluorocarbon. It is stable in the atmosphere. The half-life for degradation by reaction with photochemically-produced hydroxyl radicals is about 62 years. Following gradual diffusion into the stratosphere above the ozone layer, it slowly degrades (est. half-life of 180-450 years) due to direct photolysis and contributes to the catalytic removal of atmosphere ozone.

Component	Freshwater Algae	Freshwater Fish	Microtox	Water Flea
1,1,2-Trichloro-1,2,2-trifluoroethane	Not listed	LC50: 7 - 14 mg/L, 96h static (Brachydanio rerio) LC50: = 1250 mg/L, 96h (Pimephales promelas) LC50: = 6240 mg/L, 96h (Oryzias latipes)	Not listed	EC50: = 71 mg/L, 48h (Daphnia magna)

Persistence and Degradability No information available

Bioaccumulation/ Accumulation No information available.

Mobility No information available.

13. Disposal considerations

Waste Disposal Methods Chemical waste generators must determine whether a discarded chemical is classified as a hazardous waste. Chemical waste generators must also consult local, regional, and national hazardous waste regulations to ensure complete and accurate classification.

14. Transport information

DOT Not regulated
TDG Not regulated
IATA Not regulated
IMDG/IMO Not regulated

15. Regulatory information

International Inventories

Component	TSCA	DSL	NDSL	EINECS	ELINCS	NLP	PICCS	ENCS	AICS	IECSC	KECL
1,1,2-Trichloro-1,2,2-trifluoroethane	X	X	-	200-936-1	-		X	X	X	X	X

Legend:

X - Listed

E - Indicates a substance that is the subject of a Section 5(e) Consent order under TSCA.

F - Indicates a substance that is the subject of a Section 5(f) Rule under TSCA.

N - Indicates a polymeric substance containing no free-radical initiator in its inventory name but is considered to cover the designated polymer made with any free-radical initiator regardless of the amount used.

P - Indicates a commenced PMN substance

R - Indicates a substance that is the subject of a Section 6 risk management rule under TSCA.

S - Indicates a substance that is identified in a proposed or final Significant New Use Rule

T - Indicates a substance that is the subject of a Section 4 test rule under TSCA.

XU - Indicates a substance exempt from reporting under the Inventory Update Rule, i.e. Partial Updating of the TSCA Inventory Data Base Production and Site Reports (40 CFR 710(B)).

Y1 - Indicates an exempt polymer that has a number-average molecular weight of 1,000 or greater.

Y2 - Indicates an exempt polymer that is a polyester and is made only from reactants included in a specified list of low concern reactants that comprises one of the eligibility criteria for the exemption rule.

U.S. Federal Regulations

TSCA 12(b) Not applicable

SARA 313 Not applicable

Component	CAS-No	Weight %	SARA 313 - Threshold Values %
1,1,2-Trichloro-1,2,2-trifluoroethane	76-13-1	99	1.0

SARA 311/312 Hazard Categories See section 2 for more information

CWA (Clean Water Act) Not applicable

Clean Air Act Not applicable

Component	HAPS Data	Class 1 Ozone Depletors	Class 2 Ozone Depletors
1,1,2-Trichloro-1,2,2-trifluoroethane	-	X	-

OSHA Occupational Safety and Health Administration
Not applicable

CERCLA Not applicable

Component	Hazardous Substances RQs	CERCLA EHS RQs
1,1,2-Trichloro-1,2,2-trifluoroethane	5000 lb	-

California Proposition 65 This product does not contain any Proposition 65 chemicals

U.S. State Right-to-Know Regulations
Not applicable

Component	Massachusetts	New Jersey	Pennsylvania	Illinois	Rhode Island
1,1,2-Trichloro-1,2,2-trifluoroethane	X	X	X	-	X

U.S. Department of Transportation

Reportable Quantity (RQ): N
DOT Marine Pollutant N
DOT Severe Marine Pollutant N

U.S. Department of Homeland Security

This product does not contain any DHS chemicals.

Other International Regulations

Mexico - Grade No information available

16. Other information

Prepared By Regulatory Affairs
Thermo Fisher Scientific
Email: EMSDS.RA@thermofisher.com

Revision Date 17-Jan-2018

Print Date 17-Jan-2018

Revision Summary This document has been updated to comply with the US OSHA HazCom 2012 Standard replacing the current legislation under 29 CFR 1910.1200 to align with the Globally Harmonized System of Classification and Labeling of Chemicals (GHS).

Disclaimer

The information provided in this Safety Data Sheet is correct to the best of our knowledge, information and belief at the date of its publication. The information given is designed only as a guidance for safe handling, use, processing, storage, transportation, disposal and release and is not to be considered a warranty or quality specification. The information relates only to the specific material designated and may not be valid for such material used in combination with any other materials or in any process, unless specified in the text

End of SDS

SAFETY DATA SHEET

Creation Date 10-Dec-2009

Revision Date 23-Jan-2018

Revision Number 5

1. Identification

Product Name Tetrachloroethylene

Cat No. : AC445690000; ACR445690010; AC445690025; AC445691000

CAS-No 127-18-4
Synonyms Perchloroethylene

Recommended Use Laboratory chemicals.
Uses advised against Not for food, drug, pesticide or biocidal product use

Details of the supplier of the safety data sheet

Company

Fisher Scientific
One Reagent Lane
Fair Lawn, NJ 07410
Tel: (201) 796-7100

Acros Organics
One Reagent Lane
Fair Lawn, NJ 07410

Emergency Telephone Number

For information **US** call: 001-800-ACROS-01 / **Europe** call: +32 14 57 52 11

Emergency Number **US**:001-201-796-7100 / **Europe**: +32 14 57 52 99

CHEMTREC Tel. No.**US**:001-800-424-9300 / **Europe**:001-703-527-3887

2. Hazard(s) identification

Classification

This chemical is considered hazardous by the 2012 OSHA Hazard Communication Standard (29 CFR 1910.1200)

Skin Corrosion/irritation	Category 2
Serious Eye Damage/Eye Irritation	Category 2
Skin Sensitization	Category 1
Carcinogenicity	Category 1B
Specific target organ toxicity (single exposure)	Category 3
Target Organs - Central nervous system (CNS).	
Specific target organ toxicity - (repeated exposure)	Category 2
Target Organs - Kidney, Liver, Blood.	

Label Elements

Signal Word

Danger

Hazard Statements

Causes skin irritation

Causes serious eye irritation

May cause an allergic skin reaction

May cause drowsiness or dizziness

May cause cancer

May cause damage to organs through prolonged or repeated exposure

**Precautionary Statements****Prevention**

Obtain special instructions before use
Do not handle until all safety precautions have been read and understood
Use personal protective equipment as required
Wash face, hands and any exposed skin thoroughly after handling
Contaminated work clothing should not be allowed out of the workplace
Do not breathe dust/fume/gas/mist/vapors/spray
Use only outdoors or in a well-ventilated area
Wear protective gloves/protective clothing/eye protection/face protection

Response

IF exposed or concerned: Get medical attention/advice

Inhalation

IF INHALED: Remove victim to fresh air and keep at rest in a position comfortable for breathing

Skin

IF ON SKIN: Wash with plenty of soap and water
Take off contaminated clothing and wash before reuse
If skin irritation or rash occurs: Get medical advice/attention

Eyes

IF IN EYES: Rinse cautiously with water for several minutes. Remove contact lenses, if present and easy to do. Continue rinsing
If eye irritation persists: Get medical advice/attention

Storage

Store locked up
Store in a well-ventilated place. Keep container tightly closed

Disposal

Dispose of contents/container to an approved waste disposal plant

Hazards not otherwise classified (HNOC)

Toxic to aquatic life with long lasting effects

WARNING. Cancer - <https://www.p65warnings.ca.gov/>.

3. Composition/Information on Ingredients

Component	CAS-No	Weight %
Tetrachloroethylene	127-18-4	>95

4. First-aid measures

General Advice

If symptoms persist, call a physician.

Eye Contact

Rinse immediately with plenty of water, also under the eyelids, for at least 15 minutes. Get medical attention.

Skin Contact

Wash off immediately with plenty of water for at least 15 minutes. If skin irritation persists, call a physician.

Inhalation

Move to fresh air. If not breathing, give artificial respiration. Get medical attention if symptoms occur.

Ingestion

Clean mouth with water and drink afterwards plenty of water.

Most important symptoms and effects

None reasonably foreseeable. May cause allergic skin reaction. Inhalation of high vapor concentrations may cause symptoms like headache, dizziness, tiredness, nausea and vomiting: Symptoms of allergic reaction may include rash, itching, swelling, trouble breathing, tingling of the hands and feet, dizziness, lightheadedness, chest pain, muscle pain or flushing

Notes to Physician

Treat symptomatically

5. Fire-fighting measures

Suitable Extinguishing Media Use water spray, alcohol-resistant foam, dry chemical or carbon dioxide.

Unsuitable Extinguishing Media No information available

Flash Point No information available

Method - No information available

Autoignition Temperature No information available

Explosion Limits

Upper No data available

Lower No data available

Sensitivity to Mechanical Impact No information available

Sensitivity to Static Discharge No information available

Specific Hazards Arising from the Chemical

Thermal decomposition can lead to release of irritating gases and vapors. Containers may explode when heated.

Hazardous Combustion Products

Chlorine Hydrogen chloride gas Phosgene

Protective Equipment and Precautions for Firefighters

As in any fire, wear self-contained breathing apparatus pressure-demand, MSHA/NIOSH (approved or equivalent) and full protective gear.

NFPA

Health
2

Flammability
0

Instability
0

Physical hazards
N/A

6. Accidental release measures

Personal Precautions Use personal protective equipment. Ensure adequate ventilation.

Environmental Precautions Do not flush into surface water or sanitary sewer system.

Methods for Containment and Clean Up Soak up with inert absorbent material. Keep in suitable, closed containers for disposal.

7. Handling and storage

Handling Wear personal protective equipment. Do not get in eyes, on skin, or on clothing. Ensure adequate ventilation. Avoid ingestion and inhalation.

Storage Keep containers tightly closed in a dry, cool and well-ventilated place. Protect from sunlight.

8. Exposure controls / personal protection

Exposure Guidelines

Component	ACGIH TLV	OSHA PEL	NIOSH IDLH	Mexico OEL (TWA)
Tetrachloroethylene	TWA: 25 ppm STEL: 100 ppm	(Vacated) TWA: 25 ppm (Vacated) TWA: 170 mg/m ³ Ceiling: 200 ppm TWA: 100 ppm	IDLH: 150 ppm	TWA: 100 ppm TWA: 670 mg/m ³ TWA: 200 ppm TWA: 1250 mg/m ³ STEL: 200 ppm STEL: 1340 mg/m ³

Legend

ACGIH - American Conference of Governmental Industrial Hygienists

OSHA - Occupational Safety and Health Administration

NIOSH IDLH: The National Institute for Occupational Safety and Health Immediately Dangerous to Life or Health

Engineering Measures

Use only under a chemical fume hood. Ensure adequate ventilation, especially in confined areas. Ensure that eyewash stations and safety showers are close to the workstation location.

Personal Protective Equipment**Eye/face Protection**

Wear appropriate protective eyeglasses or chemical safety goggles as described by OSHA's eye and face protection regulations in 29 CFR 1910.133 or European Standard EN166.

Skin and body protection

Long sleeved clothing.

Respiratory Protection

Follow the OSHA respirator regulations found in 29 CFR 1910.134 or European Standard EN 149. Use a NIOSH/MSHA or European Standard EN 149 approved respirator if exposure limits are exceeded or if irritation or other symptoms are experienced.

Hygiene Measures

Handle in accordance with good industrial hygiene and safety practice.

9. Physical and chemical properties

Physical State	Liquid
Appearance	Colorless
Odor	Characteristic, sweet
Odor Threshold	No information available
pH	No information available
Melting Point/Range	-22 °C / -7.6 °F
Boiling Point/Range	120 - 122 °C / 248 - 251.6 °F @ 760 mmHg
Flash Point	No information available
Evaporation Rate	6.0 (Ether = 1.0)
Flammability (solid,gas)	Not applicable
Flammability or explosive limits	
Upper	No data available
Lower	No data available
Vapor Pressure	18 mbar @ 20 °C
Vapor Density	No information available
Density	1.619
Specific Gravity	1.625
Solubility	0.15 g/L water (20°C)
Partition coefficient; n-octanol/water	No data available
Autoignition Temperature	No information available
Decomposition Temperature	> 150°C
Viscosity	0.89 mPa s at 20 °C
Molecular Formula	C ₂ Cl ₄
Molecular Weight	165.83

10. Stability and reactivity

Reactive Hazard	None known, based on information available
Stability	Stable under normal conditions.
Conditions to Avoid	Incompatible products. Excess heat. Exposure to moist air or water.
Incompatible Materials	Strong acids, Strong oxidizing agents, Strong bases, Metals, Zinc, Amines, Aluminium
Hazardous Decomposition Products	Chlorine, Hydrogen chloride gas, Phosgene
Hazardous Polymerization	Hazardous polymerization does not occur.
Hazardous Reactions	None under normal processing.

11. Toxicological information

Acute Toxicity

Product Information Component Information

Component	LD50 Oral	LD50 Dermal	LC50 Inhalation
Tetrachloroethylene	LD50 = 2629 mg/kg (Rat)	LD50 > 10000 mg/kg (Rat)	LC50 = 27.8 mg/L (Rat) 4 h

Toxicologically Synergistic Products No information available

Delayed and immediate effects as well as chronic effects from short and long-term exposure

Irritation Irritating to eyes and skin

Sensitization No information available

Carcinogenicity The table below indicates whether each agency has listed any ingredient as a carcinogen.

Component	CAS-No	IARC	NTP	ACGIH	OSHA	Mexico
Tetrachloroethylene	127-18-4	Group 2A	Reasonably Anticipated	A3	X	A3

IARC: (International Agency for Research on Cancer)

NTP: (National Toxicity Program)

ACGIH: (American Conference of Governmental Industrial Hygienists)

Mexico - Occupational Exposure Limits - Carcinogens

IARC: (International Agency for Research on Cancer)

Group 1 - Carcinogenic to Humans

Group 2A - Probably Carcinogenic to Humans

Group 2B - Possibly Carcinogenic to Humans

NTP: (National Toxicity Program)

Known - Known Carcinogen

Reasonably Anticipated - Reasonably Anticipated to be a Human Carcinogen

A1 - Known Human Carcinogen

A2 - Suspected Human Carcinogen

A3 - Animal Carcinogen

ACGIH: (American Conference of Governmental Industrial Hygienists)

Mexico - Occupational Exposure Limits - Carcinogens

A1 - Confirmed Human Carcinogen

A2 - Suspected Human Carcinogen

A3 - Confirmed Animal Carcinogen

A4 - Not Classifiable as a Human Carcinogen

A5 - Not Suspected as a Human Carcinogen

Mutagenic Effects No information available

Reproductive Effects No information available.

Developmental Effects No information available.

Teratogenicity No information available.

STOT - single exposure Central nervous system (CNS)

STOT - repeated exposure Kidney Liver Blood

Aspiration hazard No information available

Symptoms / effects, both acute and delayed Inhalation of high vapor concentrations may cause symptoms like headache, dizziness, tiredness, nausea and vomiting: Symptoms of allergic reaction may include rash, itching, swelling, trouble breathing, tingling of the hands and feet, dizziness, lightheadedness, chest pain, muscle pain or flushing

Endocrine Disruptor Information

Component	EU - Endocrine Disruptors Candidate List	EU - Endocrine Disruptors - Evaluated Substances	Japan - Endocrine Disruptor Information
Tetrachloroethylene	Group II Chemical	Not applicable	Not applicable

Other Adverse Effects Tumorigenic effects have been reported in experimental animals.

12. Ecological information

Ecotoxicity

Toxic to aquatic organisms, may cause long-term adverse effects in the aquatic environment. The product contains following substances which are hazardous for the environment.

Component	Freshwater Algae	Freshwater Fish	Microtox	Water Flea
Tetrachloroethylene	EC50: > 500 mg/L, 96h (Pseudokirchneriella subcapitata)	LC50: 4.73 - 5.27 mg/L, 96h flow-through (Oncorhynchus mykiss) LC50: 11.0 - 15.0 mg/L, 96h static (Lepomis macrochirus) LC50: 8.6 - 13.5 mg/L, 96h static (Pimephales promelas) LC50: 12.4 - 14.4 mg/L, 96h flow-through (Pimephales promelas)	EC50 = 100 mg/L 24 h EC50 = 112 mg/L 24 h EC50 = 120.0 mg/L 30 min	EC50: 6.1 - 9.0 mg/L, 48h Static (Daphnia magna)

Persistence and Degradability Insoluble in water Persistence is unlikely based on information available.

Bioaccumulation/ Accumulation No information available.

Mobility . Is not likely mobile in the environment due its low water solubility. Will likely be mobile in the environment due to its volatility.

Component	log Pow
Tetrachloroethylene	2.53 - 2.88

13. Disposal considerations

Waste Disposal Methods Chemical waste generators must determine whether a discarded chemical is classified as a hazardous waste. Chemical waste generators must also consult local, regional, and national hazardous waste regulations to ensure complete and accurate classification.

Component	RCRA - U Series Wastes	RCRA - P Series Wastes
Tetrachloroethylene - 127-18-4	U210	-

14. Transport information

DOT

UN-No UN1897
 Proper Shipping Name TETRACHLOROETHYLENE
 Hazard Class 6.1
 Packing Group III

TDG

UN-No UN1897

Proper Shipping Name TETRACHLOROETHYLENE
 Hazard Class 6.1
 Packing Group III

IATA

UN-No UN1897
 Proper Shipping Name TETRACHLOROETHYLENE
 Hazard Class 6.1
 Packing Group III

IMDG/IMO

UN-No UN1897
 Proper Shipping Name TETRACHLOROETHYLENE
 Hazard Class 6.1
 Subsidiary Hazard Class P
 Packing Group III

15. Regulatory information

All of the components in the product are on the following Inventory lists: X = listed

International Inventories

Component	TSCA	DSL	NDSL	EINECS	ELINCS	NLP	PICCS	ENCS	AICS	IECSC	KECL
Tetrachloroethylene	X	X	-	204-825-9	-		X	X	X	X	X

Legend:

X - Listed

E - Indicates a substance that is the subject of a Section 5(e) Consent order under TSCA.

F - Indicates a substance that is the subject of a Section 5(f) Rule under TSCA.

N - Indicates a polymeric substance containing no free-radical initiator in its inventory name but is considered to cover the designated polymer made with any free-radical initiator regardless of the amount used.

P - Indicates a commenced PMN substance

R - Indicates a substance that is the subject of a Section 6 risk management rule under TSCA.

S - Indicates a substance that is identified in a proposed or final Significant New Use Rule

T - Indicates a substance that is the subject of a Section 4 test rule under TSCA.

XU - Indicates a substance exempt from reporting under the Inventory Update Rule, i.e. Partial Updating of the TSCA Inventory Data Base Production and Site Reports (40 CFR 710(B)).

Y1 - Indicates an exempt polymer that has a number-average molecular weight of 1,000 or greater.

Y2 - Indicates an exempt polymer that is a polyester and is made only from reactants included in a specified list of low concern reactants that comprises one of the eligibility criteria for the exemption rule.

U.S. Federal Regulations

TSCA 12(b) Not applicable

SARA 313

Component	CAS-No	Weight %	SARA 313 - Threshold Values %
Tetrachloroethylene	127-18-4	>95	0.1

SARA 311/312 Hazard Categories See section 2 for more information

CWA (Clean Water Act)

Component	CWA - Hazardous Substances	CWA - Reportable Quantities	CWA - Toxic Pollutants	CWA - Priority Pollutants
Tetrachloroethylene	-	-	X	X

Clean Air Act

Component	HAPS Data	Class 1 Ozone Depletors	Class 2 Ozone Depletors
Tetrachloroethylene	X		-

OSHA Occupational Safety and Health Administration
 Not applicable

CERCLA

This material, as supplied, contains one or more substances regulated as a hazardous substance under the Comprehensive Environmental Response Compensation and Liability Act (CERCLA) (40 CFR 302)

Component	Hazardous Substances RQs	CERCLA EHS RQs
Tetrachloroethylene	100 lb 1 lb	-

California Proposition 65 This product contains the following proposition 65 chemicals

Component	CAS-No	California Prop. 65	Prop 65 NSRL	Category
Tetrachloroethylene	127-18-4	Carcinogen	14 µg/day	Carcinogen

U.S. State Right-to-Know Regulations

Component	Massachusetts	New Jersey	Pennsylvania	Illinois	Rhode Island
Tetrachloroethylene	X	X	X	X	X

U.S. Department of Transportation

Reportable Quantity (RQ): Y
DOT Marine Pollutant Y
DOT Severe Marine Pollutant N

U.S. Department of Homeland Security

This product does not contain any DHS chemicals.

Other International Regulations

Mexico - Grade No information available

16. Other information

Prepared By Regulatory Affairs
Thermo Fisher Scientific
Email: EMSDS.RA@thermofisher.com

Creation Date 10-Dec-2009

Revision Date 23-Jan-2018

Print Date 23-Jan-2018

Revision Summary This document has been updated to comply with the US OSHA HazCom 2012 Standard replacing the current legislation under 29 CFR 1910.1200 to align with the Globally Harmonized System of Classification and Labeling of Chemicals (GHS).

Disclaimer

The information provided in this Safety Data Sheet is correct to the best of our knowledge, information and belief at the date of its publication. The information given is designed only as a guidance for safe handling, use, processing, storage, transportation, disposal and release and is not to be considered a warranty or quality specification. The information relates only to the specific material designated and may not be valid for such material used in combination with any other materials or in any process, unless specified in the text

End of SDS

SAFETY DATA SHEET

Creation Date 03-Feb-2010

Revision Date 14-Jul-2016

Revision Number 2

1. Identification

Product Name Trichloroethylene

Cat No. : T340-4; T341-4; T341-20; T341-500; T403-4

Synonyms Trichloroethene (Stabilized/Technical/Electronic/Certified ACS)

Recommended Use Laboratory chemicals.

Uses advised against

Details of the supplier of the safety data sheet

Company

Fisher Scientific
One Reagent Lane
Fair Lawn, NJ 07410
Tel: (201) 796-7100

Emergency Telephone Number

CHEMTREC®, Inside the USA: 800-424-9300
CHEMTREC®, Outside the USA: 001-703-527-3887

2. Hazard(s) identification

Classification

This chemical is considered hazardous by the 2012 OSHA Hazard Communication Standard (29 CFR 1910.1200)

Skin Corrosion/irritation	Category 2
Serious Eye Damage/Eye Irritation	Category 2
Skin Sensitization	Category 1
Germ Cell Mutagenicity	Category 2
Carcinogenicity	Category 1A
Specific target organ toxicity (single exposure)	Category 3
Target Organs - Central nervous system (CNS).	
Specific target organ toxicity - (repeated exposure)	Category 2
Target Organs - Kidney, Liver, Heart, spleen, Blood.	

Label Elements**Signal Word**

Danger

Hazard Statements

Causes skin irritation
Causes serious eye irritation
May cause an allergic skin reaction
May cause drowsiness or dizziness
Suspected of causing genetic defects
May cause cancer
May cause damage to organs through prolonged or repeated exposure

**Precautionary Statements****Prevention**

Obtain special instructions before use
Do not handle until all safety precautions have been read and understood
Use personal protective equipment as required
Wash face, hands and any exposed skin thoroughly after handling
Contaminated work clothing should not be allowed out of the workplace
Do not breathe dust/fume/gas/mist/vapors/spray
Use only outdoors or in a well-ventilated area
Wear protective gloves/protective clothing/eye protection/face protection

Response

IF exposed or concerned: Get medical attention/advice

Inhalation

IF INHALED: Remove victim to fresh air and keep at rest in a position comfortable for breathing

Skin

IF ON SKIN: Wash with plenty of soap and water
Take off contaminated clothing and wash before reuse
If skin irritation or rash occurs: Get medical advice/attention

Eyes

IF IN EYES: Rinse cautiously with water for several minutes. Remove contact lenses, if present and easy to do. Continue rinsing
If eye irritation persists: Get medical advice/attention

Storage

Store locked up
Store in a well-ventilated place. Keep container tightly closed

Disposal

Dispose of contents/container to an approved waste disposal plant

Hazards not otherwise classified (HNOC)

Harmful to aquatic life with long lasting effects
WARNING! This product contains a chemical known in the State of California to cause cancer, birth defects or other reproductive harm.

3. Composition / information on ingredients

Component	CAS-No	Weight %
Trichloroethylene	79-01-6	100

4. First-aid measures

General Advice

Show this safety data sheet to the doctor in attendance. Immediate medical attention is required.

Eye Contact

Rinse immediately with plenty of water, also under the eyelids, for at least 15 minutes. In the case of contact with eyes, rinse immediately with plenty of water and seek medical advice.

Skin Contact

Wash off immediately with plenty of water for at least 15 minutes. Immediate medical attention is required.

Inhalation

Move to fresh air. If not breathing, give artificial respiration. Do not use mouth-to-mouth method if victim ingested or inhaled the substance; give artificial respiration with the aid of a

pocket mask equipped with a one-way valve or other proper respiratory medical device. Immediate medical attention is required.

Ingestion Do not induce vomiting. Call a physician or Poison Control Center immediately.

Most important symptoms/effects None reasonably foreseeable. May cause allergic skin reaction. Inhalation of high vapor concentrations may cause symptoms like headache, dizziness, tiredness, nausea and vomiting: Symptoms of allergic reaction may include rash, itching, swelling, trouble breathing, tingling of the hands and feet, dizziness, lightheadedness, chest pain, muscle pain or flushing

Notes to Physician Treat symptomatically

5. Fire-fighting measures

Suitable Extinguishing Media Use water spray, alcohol-resistant foam, dry chemical or carbon dioxide.

Unsuitable Extinguishing Media No information available

Flash Point No information available
Method - No information available

Autoignition Temperature 410 °C / 770 °F

Explosion Limits

Upper 10.5 vol %

Lower 8 vol %

Oxidizing Properties Not oxidising

Sensitivity to Mechanical Impact No information available

Sensitivity to Static Discharge No information available

Specific Hazards Arising from the Chemical

Thermal decomposition can lead to release of irritating gases and vapors. Containers may explode when heated. Keep product and empty container away from heat and sources of ignition.

Hazardous Combustion Products

Hydrogen chloride gas Chlorine Phosgene Carbon monoxide (CO) Carbon dioxide (CO₂)

Protective Equipment and Precautions for Firefighters

As in any fire, wear self-contained breathing apparatus pressure-demand, MSHA/NIOSH (approved or equivalent) and full protective gear. Thermal decomposition can lead to release of irritating gases and vapors.

NFPA

Health
2

Flammability
1

Instability
0

Physical hazards
N/A

6. Accidental release measures

Personal Precautions Ensure adequate ventilation. Use personal protective equipment. Keep people away from and upwind of spill/leak. Evacuate personnel to safe areas.

Environmental Precautions Should not be released into the environment. Do not flush into surface water or sanitary sewer system.

Methods for Containment and Clean Up Soak up with inert absorbent material. Keep in suitable, closed containers for disposal.

7. Handling and storage

Handling Wear personal protective equipment. Do not get in eyes, on skin, or on clothing. Use only under a chemical fume hood. Do not breathe vapors or spray mist. Do not ingest.

Storage Keep containers tightly closed in a dry, cool and well-ventilated place. Protect from light. Do not store in aluminum containers.

8. Exposure controls / personal protection

Exposure Guidelines

Component	ACGIH TLV	OSHA PEL	NIOSH IDLH	Mexico OEL (TWA)
Trichloroethylene	TWA: 10 ppm STEL: 25 ppm	(Vacated) TWA: 50 ppm (Vacated) TWA: 270 mg/m ³ Ceiling: 200 ppm (Vacated) STEL: 200 ppm (Vacated) STEL: 1080 mg/m ³ TWA: 100 ppm	IDLH: 1000 ppm	TWA: 100 ppm TWA: 535 mg/m ³ STEL: 200 ppm STEL: 1080 mg/m ³

Legend

ACGIH - American Conference of Governmental Industrial Hygienists

OSHA - Occupational Safety and Health Administration

NIOSH IDLH: The National Institute for Occupational Safety and Health Immediately Dangerous to Life or Health

Engineering Measures

Use only under a chemical fume hood. Ensure adequate ventilation, especially in confined areas. Ensure that eyewash stations and safety showers are close to the workstation location.

Personal Protective Equipment

Eye/face Protection

Wear appropriate protective eyeglasses or chemical safety goggles as described by OSHA's eye and face protection regulations in 29 CFR 1910.133 or European Standard EN166.

Skin and body protection

Long sleeved clothing.

Respiratory Protection

Follow the OSHA respirator regulations found in 29 CFR 1910.134 or European Standard EN 149. Use a NIOSH/MSHA or European Standard EN 149 approved respirator if exposure limits are exceeded or if irritation or other symptoms are experienced.

Hygiene Measures

Handle in accordance with good industrial hygiene and safety practice.

9. Physical and chemical properties

Physical State	Liquid
Appearance	Colorless
Odor	Characteristic
Odor Threshold	No information available
pH	No information available
Melting Point/Range	-85 °C / -121 °F
Boiling Point/Range	87 °C / 188.6 °F
Flash Point	No information available
Evaporation Rate	0.69 (Carbon Tetrachloride = 1.0)
Flammability (solid,gas)	Not applicable
Flammability or explosive limits	
Upper	10.5 vol %
Lower	8 vol %
Vapor Pressure	77.3 mbar @ 20 °C
Vapor Density	4.5 (Air = 1.0)
Specific Gravity	1.460
Solubility	Slightly soluble in water
Partition coefficient; n-octanol/water	No data available
Autoignition Temperature	410 °C / 770 °F
Decomposition Temperature	> 120°C
Viscosity	0.55 mPa.s (25°C)

Molecular Formula
Molecular Weight

C₂ H Cl₃
131.39

10. Stability and reactivity

Reactive Hazard	None known, based on information available
Stability	Light sensitive.
Conditions to Avoid	Incompatible products. Excess heat. Exposure to light. Exposure to moist air or water.
Incompatible Materials	Strong oxidizing agents, Strong bases, Amines, Alkali metals, Metals,
Hazardous Decomposition Products	Hydrogen chloride gas, Chlorine, Phosgene, Carbon monoxide (CO), Carbon dioxide (CO ₂)
Hazardous Polymerization	Hazardous polymerization does not occur.
Hazardous Reactions	None under normal processing.

11. Toxicological information

Acute Toxicity

Product Information Component Information

Component	LD50 Oral	LD50 Dermal	LC50 Inhalation
Trichloroethylene	LD50 = 4290 mg/kg (Rat) LD50 = 4920 mg/kg (Rat)	LD50 > 20 g/kg (Rabbit) LD50 = 29000 mg/kg (Rabbit)	LC50 = 26 mg/L (Rat) 4 h

Toxicologically Synergistic Products No information available

Delayed and immediate effects as well as chronic effects from short and long-term exposure

Irritation Irritating to eyes and skin

Sensitization No information available

Carcinogenicity The table below indicates whether each agency has listed any ingredient as a carcinogen.

Component	CAS-No	IARC	NTP	ACGIH	OSHA	Mexico
Trichloroethylene	79-01-6	Group 1	Reasonably Anticipated	A2	X	Not listed

IARC: (International Agency for Research on Cancer)

NTP: (National Toxicity Program)

ACGIH: (American Conference of Governmental Industrial Hygienists)

IARC: (International Agency for Research on Cancer)

Group 1 - Carcinogenic to Humans

Group 2A - Probably Carcinogenic to Humans

Group 2B - Possibly Carcinogenic to Humans

NTP: (National Toxicity Program)

Known - Known Carcinogen

Reasonably Anticipated - Reasonably Anticipated to be a Human Carcinogen

A1 - Known Human Carcinogen

A2 - Suspected Human Carcinogen

A3 - Animal Carcinogen

ACGIH: (American Conference of Governmental Industrial Hygienists)

Mutagenic Effects Mutagenic effects have occurred in humans.

Reproductive Effects No information available.

Developmental Effects No information available.

Teratogenicity No information available.

STOT - single exposure	Central nervous system (CNS)
STOT - repeated exposure	Kidney Liver Heart spleen Blood
Aspiration hazard	No information available
Symptoms / effects, both acute and delayed	Inhalation of high vapor concentrations may cause symptoms like headache, dizziness, tiredness, nausea and vomiting. Symptoms of allergic reaction may include rash, itching, swelling, trouble breathing, tingling of the hands and feet, dizziness, lightheadedness, chest pain, muscle pain or flushing
Endocrine Disruptor Information	No information available
Other Adverse Effects	The toxicological properties have not been fully investigated.

12. Ecological information

Ecotoxicity

Harmful to aquatic organisms, may cause long-term adverse effects in the aquatic environment. Do not empty into drains. The product contains following substances which are hazardous for the environment. Contains a substance which is: Harmful to aquatic organisms. Toxic to aquatic organisms.

Component	Freshwater Algae	Freshwater Fish	Microtox	Water Flea
Trichloroethylene	EC50: = 175 mg/L, 96h (Pseudokirchneriella subcapitata) EC50: = 450 mg/L, 96h (Desmodesmus subspicatus)	LC50: 39 - 54 mg/L, 96h static (Lepomis macrochirus) LC50: 31.4 - 71.8 mg/L, 96h flow-through (Pimephales promelas)	EC50 = 0.81 mg/L 24 h EC50 = 115 mg/L 10 min EC50 = 190 mg/L 15 min EC50 = 235 mg/L 24 h EC50 = 410 mg/L 24 h EC50 = 975 mg/L 5 min	EC50: = 2.2 mg/L, 48h (Daphnia magna)

Persistence and Degradability Persistence is unlikely based on information available.

Bioaccumulation/ Accumulation No information available.

Mobility Will likely be mobile in the environment due to its volatility.

Component	log Pow
Trichloroethylene	2.4

13. Disposal considerations

Waste Disposal Methods Chemical waste generators must determine whether a discarded chemical is classified as a hazardous waste. Chemical waste generators must also consult local, regional, and national hazardous waste regulations to ensure complete and accurate classification.

Component	RCRA - U Series Wastes	RCRA - P Series Wastes
Trichloroethylene - 79-01-6	U228	-

14. Transport information

DOT

UN-No	UN1710
Proper Shipping Name	TRICHLOROETHYLENE
Hazard Class	6.1
Packing Group	III

TDG

UN-No	UN1710
Proper Shipping Name	TRICHLOROETHYLENE
Hazard Class	6.1
Packing Group	III

IATA

UN-No	UN1710
Proper Shipping Name	TRICHLOROETHYLENE

Hazard Class	6.1
Packing Group	III
IMDG/IMO	
UN-No	UN1710
Proper Shipping Name	TRICHLOROETHYLENE
Hazard Class	6.1
Packing Group	III

15. Regulatory information

All of the components in the product are on the following Inventory lists: X = listed

International Inventories

Component	TSCA	DSL	NDSL	EINECS	ELINCS	NLP	PICCS	ENCS	AICS	IECSC	KECL
Trichloroethylene	X	X	-	201-167-4	-		X	X	X	X	X

Legend:

X - Listed

E - Indicates a substance that is the subject of a Section 5(e) Consent order under TSCA.

F - Indicates a substance that is the subject of a Section 5(f) Rule under TSCA.

N - Indicates a polymeric substance containing no free-radical initiator in its inventory name but is considered to cover the designated polymer made with any free-radical initiator regardless of the amount used.

P - Indicates a commenced PMN substance

R - Indicates a substance that is the subject of a Section 6 risk management rule under TSCA.

S - Indicates a substance that is identified in a proposed or final Significant New Use Rule

T - Indicates a substance that is the subject of a Section 4 test rule under TSCA.

XU - Indicates a substance exempt from reporting under the Inventory Update Rule, i.e. Partial Updating of the TSCA Inventory Data Base Production and Site Reports (40 CFR 710(B)).

Y1 - Indicates an exempt polymer that has a number-average molecular weight of 1,000 or greater.

Y2 - Indicates an exempt polymer that is a polyester and is made only from reactants included in a specified list of low concern reactants that comprises one of the eligibility criteria for the exemption rule.

U.S. Federal Regulations

TSCA 12(b) Not applicable

Component	TSCA 12(b)
Trichloroethylene	Section 5

SARA 313

Component	CAS-No	Weight %	SARA 313 - Threshold Values %
Trichloroethylene	79-01-6	100	0.1

SARA 311/312 Hazard Categories

Acute Health Hazard	Yes
Chronic Health Hazard	Yes
Fire Hazard	No
Sudden Release of Pressure Hazard	No
Reactive Hazard	No

CWA (Clean Water Act)

Component	CWA - Hazardous Substances	CWA - Reportable Quantities	CWA - Toxic Pollutants	CWA - Priority Pollutants
Trichloroethylene	X	100 lb	X	X

Clean Air Act

Component	HAPS Data	Class 1 Ozone Depletors	Class 2 Ozone Depletors
Trichloroethylene	X		-

OSHA Occupational Safety and Health Administration
Not applicable

CERCLA

This material, as supplied, contains one or more substances regulated as a hazardous substance under the Comprehensive Environmental Response Compensation and Liability Act (CERCLA) (40 CFR 302)

Component	Hazardous Substances RQs	CERCLA EHS RQs
Trichloroethylene	100 lb 1 lb	-

California Proposition 65 This product contains the following proposition 65 chemicals

Component	CAS-No	California Prop. 65	Prop 65 NSRL	Category
Trichloroethylene	79-01-6	Carcinogen Developmental Male Reproductive	14 µg/day 50 µg/day	Developmental Carcinogen

U.S. State Right-to-Know Regulations

Component	Massachusetts	New Jersey	Pennsylvania	Illinois	Rhode Island
Trichloroethylene	X	X	X	X	X

U.S. Department of Transportation

Reportable Quantity (RQ): Y
DOT Marine Pollutant N
DOT Severe Marine Pollutant N

U.S. Department of Homeland Security

This product does not contain any DHS chemicals.

Other International Regulations

Mexico - Grade No information available

16. Other information

Prepared By Regulatory Affairs
Thermo Fisher Scientific
Email: EMSDS.RA@thermofisher.com

Creation Date 03-Feb-2010

Revision Date 14-Jul-2016

Print Date 14-Jul-2016

Revision Summary This document has been updated to comply with the US OSHA HazCom 2012 Standard replacing the current legislation under 29 CFR 1910.1200 to align with the Globally Harmonized System of Classification and Labeling of Chemicals (GHS).

Disclaimer

The information provided in this Safety Data Sheet is correct to the best of our knowledge, information and belief at the date of its publication. The information given is designed only as a guidance for safe handling, use, processing, storage, transportation, disposal and release and is not to be considered a warranty or quality specification. The information relates only to the specific material designated and may not be valid for such material used in combination with any other materials or in any process, unless specified in the text

End of SDS

SAFETY DATA SHEET

Revision Date 19-Jan-2018

Revision Number 3

1. Identification

Product Name Poly(vinyl chloride), high molecular weight

Cat No. : AC183320000; AC183320010; AC183325000

Synonyms Chlorethene homopolymer; Ethylene, chloro-, polymer; PVC

Recommended Use Laboratory chemicals.

Uses advised against Not for food, drug, pesticide or biocidal product use

Details of the supplier of the safety data sheet

Company

Fisher Scientific
One Reagent Lane
Fair Lawn, NJ 07410
Tel: (201) 796-7100

Acros Organics
One Reagent Lane
Fair Lawn, NJ 07410

Emergency Telephone Number

For information **US** call: 001-800-ACROS-01 / **Europe** call: +32 14 57 52 11
Emergency Number **US**:001-201-796-7100 / **Europe**: +32 14 57 52 99
CHEMTREC Tel. No.**US**:001-800-424-9300 / **Europe**:001-703-527-3887

2. Hazard(s) identification

Classification

Classification under 2012 OSHA Hazard Communication Standard (29 CFR 1910.1200)

Based on available data, the classification criteria are not met

Label Elements

None required

Hazards not otherwise classified (HNOC)

None identified

3. Composition/Information on Ingredients

Component	CAS-No	Weight %
PVC (Chloroethylene, polymer)	9002-86-2	100

4. First-aid measures

Eye Contact Rinse immediately with plenty of water, also under the eyelids, for at least 15 minutes.

Skin Contact	Wash off immediately with plenty of water for at least 15 minutes.
Inhalation	Move to fresh air.
Ingestion	Do not induce vomiting.
Most important symptoms and effects	No information available.
Notes to Physician	Treat symptomatically

5. Fire-fighting measures

Unsuitable Extinguishing Media	No information available
Flash Point	
Method -	No information available
Autoignition Temperature	435 °C
Explosion Limits	
Upper	No data available
Lower	No data available
Sensitivity to Mechanical Impact	No information available
Sensitivity to Static Discharge	No information available

Specific Hazards Arising from the Chemical

Keep product and empty container away from heat and sources of ignition.

Hazardous Combustion Products

None known

Protective Equipment and Precautions for Firefighters

As in any fire, wear self-contained breathing apparatus pressure-demand, MSHA/NIOSH (approved or equivalent) and full protective gear.

NFPA

Health
1

Flammability
1

Instability
0

Physical hazards
N/A

6. Accidental release measures

Personal Precautions	Ensure adequate ventilation. Use personal protective equipment.
Environmental Precautions	See Section 12 for additional ecological information.

Methods for Containment and Clean Up No information available.

7. Handling and storage

Handling	Ensure adequate ventilation.
Storage	Keep containers tightly closed in a dry, cool and well-ventilated place.

8. Exposure controls / personal protection

Exposure Guidelines

Component	ACGIH TLV	OSHA PEL	NIOSH IDLH	Mexico OEL (TWA)
PVC (Chloroethylene, polymer)	TWA: 1 mg/m ³			

Legend

ACGIH - American Conference of Governmental Industrial Hygienists

Engineering Measures Ensure adequate ventilation, especially in confined areas.

Personal Protective Equipment

Eye/face Protection Wear appropriate protective eyeglasses or chemical safety goggles as described by OSHA's eye and face protection regulations in 29 CFR 1910.133 or European Standard EN166.

Skin and body protection Wear appropriate protective gloves and clothing to prevent skin exposure.

Respiratory Protection Follow the OSHA respirator regulations found in 29 CFR 1910.134 or European Standard EN 149. Use a NIOSH/MSHA or European Standard EN 149 approved respirator if exposure limits are exceeded or if irritation or other symptoms are experienced.

Hygiene Measures Handle in accordance with good industrial hygiene and safety practice.

9. Physical and chemical properties

Physical State	Powder Solid
Appearance	Off-white
Odor	Odorless
Odor Threshold	No information available
pH	
Melting Point/Range	No data available
Boiling Point/Range	
Flash Point	
Evaporation Rate	No information available
Flammability (solid,gas)	No information available
Flammability or explosive limits	
Upper	No data available
Lower	No data available
Vapor Pressure	No information available
Vapor Density	No information available
Specific Gravity	1.4000
Solubility	No information available
Partition coefficient; n-octanol/water	No data available
Autoignition Temperature	435 °C
Decomposition Temperature	No information available
Viscosity	No information available

10. Stability and reactivity

Reactive Hazard None known, based on information available

Stability Stable under normal conditions.

Conditions to Avoid Incompatible products.

Incompatible Materials Strong oxidizing agents

Hazardous Decomposition Products None under normal use conditions

Hazardous Polymerization Hazardous polymerization does not occur.

Hazardous Reactions None under normal processing.

11. Toxicological information

Acute Toxicity

Component Information**Toxicologically Synergistic** No information available**Products****Delayed and immediate effects as well as chronic effects from short and long-term exposure****Irritation** No information available**Sensitization** No information available**Carcinogenicity** The table below indicates whether each agency has listed any ingredient as a carcinogen.

Component	CAS-No	IARC	NTP	ACGIH	OSHA	Mexico
PVC (Chloroethylene, polymer)	9002-86-2	Not listed	Not listed	Not listed	Not listed	Not listed

Mutagenic Effects No information available**Reproductive Effects** No information available.**Developmental Effects** No information available.**Teratogenicity** No information available.**STOT - single exposure** None known**STOT - repeated exposure** None known**Aspiration hazard** No information available**Symptoms / effects, both acute and delayed** No information available**Endocrine Disruptor Information** No information available**Other Adverse Effects** The toxicological properties have not been fully investigated.

12. Ecological information

Ecotoxicity

Do not empty into drains.

Persistence and Degradability No information available**Bioaccumulation/ Accumulation** No information available.**Mobility** No information available.

13. Disposal considerations

Waste Disposal Methods Chemical waste generators must determine whether a discarded chemical is classified as a hazardous waste. Chemical waste generators must also consult local, regional, and national hazardous waste regulations to ensure complete and accurate classification.

14. Transport information

DOT Not regulated**TDG** Not regulated**IATA** Not regulated**IMDG/IMO** Not regulated

15. Regulatory information

International Inventories

Component	TSCA	DSL	NDSL	EINECS	ELINCS	NLP	PICCS	ENCS	AICS	IECSC	KECL
PVC (Chloroethylene, polymer)	X	X	-	-	420-490-3		X	X	X	X	X

Legend:

X - Listed

E - Indicates a substance that is the subject of a Section 5(e) Consent order under TSCA.

F - Indicates a substance that is the subject of a Section 5(f) Rule under TSCA.

N - Indicates a polymeric substance containing no free-radical initiator in its inventory name but is considered to cover the designated polymer made with any free-radical initiator regardless of the amount used.

P - Indicates a commenced PMN substance

R - Indicates a substance that is the subject of a Section 6 risk management rule under TSCA.

S - Indicates a substance that is identified in a proposed or final Significant New Use Rule

T - Indicates a substance that is the subject of a Section 4 test rule under TSCA.

XU - Indicates a substance exempt from reporting under the Inventory Update Rule, i.e. Partial Updating of the TSCA Inventory Data Base Production and Site Reports (40 CFR 710(B)).

Y1 - Indicates an exempt polymer that has a number-average molecular weight of 1,000 or greater.

Y2 - Indicates an exempt polymer that is a polyester and is made only from reactants included in a specified list of low concern reactants that comprises one of the eligibility criteria for the exemption rule.

U.S. Federal Regulations

TSCA 12(b) Not applicable

SARA 313 Not applicable

SARA 311/312 Hazard Categories See section 2 for more information

CWA (Clean Water Act) Not applicable

Clean Air Act Not applicable

OSHA Occupational Safety and Health Administration
Not applicable

CERCLA Not applicable

California Proposition 65 This product does not contain any Proposition 65 chemicals

U.S. State Right-to-Know Regulations Not applicable

Component	Massachusetts	New Jersey	Pennsylvania	Illinois	Rhode Island
PVC (Chloroethylene, polymer)	-	X	-	-	-

U.S. Department of Transportation

Reportable Quantity (RQ): N

DOT Marine Pollutant N

DOT Severe Marine Pollutant N

U.S. Department of Homeland Security

This product does not contain any DHS chemicals.

Other International Regulations

Mexico - Grade No information available

16. Other information**Prepared By**Regulatory Affairs
Thermo Fisher Scientific
Email: EMSDS.RA@thermofisher.com

Revision Date 19-Jan-2018

Print Date 19-Jan-2018

Revision Summary This document has been updated to comply with the US OSHA HazCom 2012 Standard replacing the current legislation under 29 CFR 1910.1200 to align with the Globally Harmonized System of Classification and Labeling of Chemicals (GHS).

Disclaimer

The information provided in this Safety Data Sheet is correct to the best of our knowledge, information and belief at the date of its publication. The information given is designed only as a guidance for safe handling, use, processing, storage, transportation, disposal and release and is not to be considered a warranty or quality specification. The information relates only to the specific material designated and may not be valid for such material used in combination with any other materials or in any process, unless specified in the text

End of SDS

Hydrogen bonds are only one-tenth to one-thirtieth as strong as covalent bonds but they have pronounced effects on the properties of substances in which they occur, especially as regards melting point, boiling point, and crystalline structure. They are found in compounds containing such strongly electronegative atoms as nitrogen, oxygen, and fluorine. They play an important part in the bonding of cellulosic compounds, e.g., in the paper industry, and occur also in many complex structures of biochemical importance, e.g., adenine-uracil linkage in DNA.

hydrogen bromide. CAS: 10035-10-6. HBr.

Properties: Colorless gas, d 2.71 (air = 1.00), fp -86°C , bp -66.4°C , specific volume 4.8 cu ft/lb (70F, 1 atm), soluble in water and alcohol, non-flammable.

Derivation: (1) By passing hydrogen with bromine vapor over warm platinum sponge which acts as a catalyst. (2) As a by-product in the bromination of organic compounds.

Grade: Up to 99.8% min purity.

Hazard: Toxic by inhalation, strong irritant to eyes and skin. TLV: ceiling 3 ppm in air.

Use: Organic synthesis, makes bromides by direct reaction with alcohols, pharmaceutical intermediate; alkylation and oxidation catalyst, reducing agent.

See also hydrobromic acid.

hydrogen chloride. CAS: 7647-01-0. HCl.

Properties: Colorless, fuming, with a suffocating odor, D 1.268 (air = 1.00), fp -114°C , bp -85°C , specific volume 10.9 cu ft/lb (21.1C, 1 atm), very soluble in water, soluble in alcohol and ether. Non-flammable.

Derivation: (1) By-product of organic chlorination reactions (approximately 90%), (2) reaction of sodium chloride and sulfuric acid, (3) burning hydrogen in an atmosphere of chlorine in absence of air.

Hazard: Toxic by inhalation, strong irritant to eyes and skin. TLV: ceiling 5 ppm in air.

Use: Production of vinyl chloride from acetylene and alkyl chlorides from olefins, hydrochlorination (see rubber hydrochloride), polymerization, isomerization, alkylation, and nitration reactions.

See also hydrochloric acid.

hydrogen cyanide. See hydrocyanic acid.

hydrogen dioxide. See hydrogen peroxide.

hydrogen electrode. See electrode, hydrogen.

hydrogen fluoride. CAS: 7664-39-3. HF.

Properties: Colorless, fuming gas or liquid; very soluble in water; the liquid and gas consist of as-

sociated molecules; the vapor density corresponds to hydrogen fluoride only at high temperatures; fp -83°C , bp 19.5°C , d (liquid) 0.988 (14C), sp vol 17 cu ft/lb (21.1C, 1 atm). Non-flammable.

Derivation: Distillation from the reaction product of calcium fluoride and sulfuric acid, also from fluosilicic acid.

Grade: To 99.9% min purity.

Hazard: Toxic by ingestion and inhalation, strong irritant to eyes, skin, and mucous membranes. TLV: ceiling 3 ppm in air.

Use: Catalyst in alkylation, isomerization, condensation, dehydration, and polymerization reactions; fluorinating agent in organic and inorganic reactions; production of fluorine and aluminum fluoride; additive in liquid rocket propellants; refining of uranium.

See also hydrofluoric acid.

hydrogen hexafluorosilicate. See fluosilicic acid.

hydrogen iodide. CAS: 10034-85-2. HI.

Properties: Colorless gas, bp -35°C , fp -51°C , fumes in moist air, d 5.2 (25C), freely soluble in water. Non-flammable.

Hazard: Strong irritant. Poison.

Use: Making hydriodic acid.

hydrogen ion concentration. See pH.

hydrogenolysis. (destructive hydrogenation).

A type of hydrogenation reaction in which molecular cleavage of an organic compound occurs with addition of hydrogen to each portion. An important application is hydrocracking (hydrogenative splitting) of large organic molecules, with formation of fragments that react with hydrogen by use of catalysts and high temperatures. Hydrogenolysis of coal to gaseous and liquid fuels was used in Germany in the 1940s; a similar method (oil/gas process) is under development in the U.S. The German process used pulverized coal made into a paste with heavy oil and a metallic catalyst. The mixture plus the necessary hydrogen was subjected to 300-700 atm at approximately 500°C . The coal was converted into heavy oil, distillable oil, gasoline, and hydrocarbon gases. Large quantities of hydrogen are necessary.

See also gasification, hydrogenation.

hydrogen overvoltage. The difference between actual cathode potential for hydrogen evolution and the equilibrium (theoretical) potential of hydrogen in the same electrolyte.

hydrogen peroxide. CAS: 7722-84-1. H_2O_2 (molecular formula); $\text{H}-\text{O}-\text{O}-\text{H}$ (structural formula).

Properties: (pure anhydrous) density of solid,

optical activity; most effective between pH 6 and 8.

Derivation: (1) Alkaline hydrolysis of the waste liquor from beet sugar refining, (2) a similar hydrolysis of wheat or corn gluten, (3) organic synthesis based on acrylonitrile.

Grade: Technical, 99%, ND, FCC.

Use: Flavor enhancer for foods in concentration of about 0.3%.

See also flavor, glutamic acid.

sodium glycolate. (sodium hydroxyacetate).

$\text{NaOOCCH}_2\text{OH}$.

Properties: White powder.

Use: Buffer in electrodeless plating and textile finishing.

sodium gold chloride. (sodium aurichloride; sodium chloraurate; sodium chloroaurate; gold sodium chloride; gold salts). $\text{NaAuCl}_4 \cdot 2\text{H}_2\text{O}$.
Properties: Yellow crystals, soluble in water and alcohol.

Derivation: By neutralizing chloroauric acid with sodium carbonate.

Use: Photography, staining fine glass, decorating porcelain, medicine.

sodium gold cyanide. (sodium cyanoaurite; sodium aurocyanide; gold sodium cyanide). $\text{NaAu}(\text{CN})_2$.

Properties: Yellow powder, soluble in water, contains 46% gold (min).

Hazard: Toxic. TLV (as CN): 5 mg/m³ of air.

Use: For gold-plating electronic components.

sodium guanylate. (GMP; disodium guanylate).

CAS: 5550-12-9. $\text{Na}_2\text{C}_{10}\text{H}_{12}\text{N}_5\text{O}_8\text{P} \cdot 2\text{H}_2\text{O}$.

A 5'-nucleotide.

Properties: Crystals, soluble in cold water, very soluble in hot water.

Derivation: From a seaweed or from dried fish.

Use: Flavor potentiator in foods.

See also guanylic acid.

sodium heparin. See heparin.

sodium heptametaphosphate. See sodium metaphosphate.

sodium hexachloroosmate. (osmium-sodium chloride; sodium-osmium chloride). Na_2OsCl_6 .

Properties: Orange, rhombic prisms, contains 40.3% osmium, unstable, soluble in alcohol, water.

Grade: Technical.

Use: Catalyst (oxidation).

sodium hexachloroplatinate. See sodium chloroplatinate.

sodium hexylene glycol monoborate.

$\text{C}_6\text{H}_{12}\text{O}_3\text{BNa}$.

Properties: Amorphous, white solid; bulk d 0.25; mp 426C; soluble in nonpolar solvents.

Purity: Min 98%.

Use: Corrosion inhibitor in organic systems, additive to lubricating oils, flame-retardant, siloxane resin additive.

sodium hexachloroplatinate. See sodium chloroplatinate.

sodium hexafluorosilicate. See sodium fluoro-silicate.

sodium hexametaphosphate. See "Calgon."

sodium hydrate. See sodium hydroxide.

sodium hydride. CAS: 7646-69-7. NaH .

Properties: Practically odorless powder, d 0.92, mp 800C (decomposes), must be kept cool and dry, particle size range 5-50 μm , starts to decompose with evolution of hydrogen at about 255C.

Preparation: Reaction of sodium metal with hydrogen. A microcrystalline dispersion of gray powder in oil containing 50 or 25% by weight.

Hazard: Dangerous fire risk, reacts violently with water, evolving hydrogen. Irritant.

Use: Condensing or alkylating agent, especially for amines, descaling metals.

sodium hydrogen sulfide. See sodium hydrosulfide.

sodium hydrogen sulfite. See sodium bisulfite.

sodium hydrosulfide. (sodium sulphhydrate; sodium bisulfide; sodium hydrogen sulfide).

CAS: 16721-80-5. $\text{NaSH} \cdot 2\text{H}_2\text{O}$.

Properties: Colorless needles to lemon-colored flakes; soluble in water, alcohol, and ether; 70-72% NaSH ; mp 55C; water of crystallization 26-28%.

Derivation: From calcium sulfide by treating it in the cold with sodium bisulfate.

Grade: Technical, flake, 70-72%, soluble 40-44%.

Hazard: Contact with acids causes evolution of toxic gases.

Use: Paper pulping, dyestuffs processing, rayon and cellophane desulfurizing, unhairing hides, bleaching reagent.

sodium hydrosulfite. See sodium dithionite.

sodium hydroxide. (caustic soda; sodium hydrate; lye; white caustic). CAS: 1310-73-2.

The most important commercial caustic. Eighth

highest-volume chemical produced in U.S. (1991).

Properties: White, deliquescent solid; chiefly in form of beads or pellets, also 50% and 73% aqueous solutions. Absorbs water and carbon dioxide from the air, d 2.13, mp 318C, bp 1390C, soluble in water, alcohol, and glycerol.

Derivation: Electrolysis of sodium chloride (brines) (electrolytic cell), reaction of calcium hydroxide and sodium carbonate.

Grade: Commercial, ground, flake, beads, FCC, granulated (60% and 75% Na₂O), rayon (low in iron, copper, and manganese), purified by alcohol (sticks, lumps, and drops), reagent, highest purity, CP, USP.

Hazard: Corrosive to tissue in presence of moisture, strong irritant to tissue (eyes, skin, mucous membranes), by ingestion. TLV: ceiling of 2 mg/m³ of air.

Use: Chemical manufacture, rayon and cellophane, neutralizing agent in petroleum refining; pulp and paper, aluminum, detergents, soap, textile processing, vegetable oil refining, reclaiming rubber, regenerating ion exchange resins, organic fusions, peeling of fruits and vegetables in food industry, lab reagent, etching and electroplating, food additive.

sodium hypochlorite. CAS: 7681-52-9.

NaOCl·5H₂O.

Properties: Unstable in air unless mixed with sodium hydroxide. Strong oxidizing agent, usually stored and used in solution, disagreeable, sweetish odor and pale greenish color, soluble in cold water, decomposed by hot water, mp 18C.

Derivation: Addition of chlorine to cold dilute solution of sodium hydroxide.

Grade: Technical.

Hazard: Fire risk in contact with organic materials. Toxic by ingestion, strong irritant to tissue.

Use: Bleaching paper pulp, textiles, etc., intermediate, organic chemicals, water purification, medicine, fungicides, swimming-pool disinfectant laundering, reagent, germicide.

sodium hypophosphite. CAS: 7681-53-0.

NaH₂PO₂·H₂O.

Properties: Colorless, pearly, crystalline plates or white granular powder; saline taste; deliquescent. Soluble in water, partially soluble in alcohol.

Derivation: By neutralizing hypophosphoric acid with sodium carbonate.

Grade: Technical, CP.

Hazard: Explosion risk when mixed with strong oxidizing agents, decomposes to phosphine on heating, store in cool, dry place, away from oxidizing materials.

Use: Pharmaceuticals, reducing agent in electrodeless nickel plating of plastics and metals,

lab reagent, substitute for sodium nitrite in smoked meats.

sodium hyposulfate. See sodium dithionate.

sodium inosinate. CAS: 4691-65-0.

C₁₀H₁₁Na₂N₄O₈P. A 5'-nucleotide derived from seaweed or dried fish. Sodium guanylate is a by-product.

Use: Flavor potentiator in foods.

See also inosinic acid.

sodium iodate. CAS: 7681-55-2. NaIO₃.

Properties: White crystals, d 4.28, soluble in water and acetone, insoluble in alcohol.

Derivation: Interaction of sodium chlorate and iodine in presence of nitric acid.

Grade: CP, reagent, technical.

Hazard: Oxidizing agent, fire risk near organic materials.

Use: Antiseptic, disinfectant, feed additive reagent.

sodium iodide. CAS: 7681-82-5.

(1) NaI (2) NaI·2H₂O.

Properties: White, cubical crystals or powder, or colorless, odorless crystals; slowly becomes brown in air, deliquescent, saline, somewhat bitter taste; soluble in water, alcohol, and glycerol; d (1) 3.665, (2) 2.448 (21C), mp (1) 653C, bp (1) 1304C.

Grade: Technical, CP, USP, single crystals.

Use: Photography, solvent for iodine, organic chemicals, reagent, feed additive, cloud seeding, scintillation (thallium-activated form), expectorant.

sodium iodide (I-131). (sodium radio-iodide).

A radioactive form of sodium iodide containing iodine-131, which can be used as a tracer.

Grade: USP (as capsules or solution).

See iodine-131.

sodium iodipamide. N,N'-adipolybis(3-amino-2,4,6-triiodobenzoic acid) disodium salt.

C₂₀H₁₂I₆N₂NaO₆.

Properties: Radiopaque, water-soluble, available as a 20% solution for injection as a clear, colorless to pale-yellow, slightly viscous liquid.

Derivation: By dissolving the free acid in dilute sodium hydroxide and buffering to pH 6.5-7.7.

Grade: USP.

Use: X-ray contrast medium.

sodium iodomethanesulfonate. See sodium methiodal.

sodium iothalamate. (sodium-5-acetamido-2,4,6-triiodo-N-methylisophthalamate).

CAS: 1225-20-3. C₆I₃(CONHCH₃)₂COONa.

Grade: USP (for injection).

Use: Medicine (radiopaque medium).

sulfur dichloride. SCl_2 .

Properties: Reddish-brown, fuming liquid with pungent chlorine odor. D 1.638 (15.5C), fp -78°C , bp decomposes above 59°C on rapid heating, boils near 60°C , decomposes in water and alcohol, soluble in benzene, refr index 1.567 (20C).

Derivation: Chlorine is passed into sulfur monochloride to saturation at $6-10^\circ\text{C}$ followed by carbon dioxide to drive off the excess chlorine.

Grade: Technical.

Hazard: Toxic by inhalation and ingestion, strong irritant to tissue.

Use: Chlorine carrier or chlorinating agent, rubber vulcanizing, vulcanized oils, purifying sugar juices, sulfur solvent, chloridizing agent in metallurgy, manufacture of organic chemicals and insecticides.

sulfur dioxide. CAS: 7446-09-5. SO_2 .

Properties: Colorless gas or liquid with sharp, pungent odor; soluble in water, alcohol, and ether; forms sulfurous acid (H_2SO_3). D 1.4337, liquid at 0°C , fp -76.1°C , bp -10°C , vap press 3.2 atmosphere at 20°C , refr index (liquid) 1.410 (24C), an outstanding oxidizing and reducing agent. Non-combustible.

Derivation: (1) By roasting pyrites in special furnaces. The gas is readily liquefied by cooling with ice and salt or at a pressure of three atmospheres. (2) By purifying and compressing sulfur dioxide gas from smelting operations. (3) By burning sulfur.

Grade: Commercial, USP, technical, refrigeration, anhydrous 99.98% min.

Hazard: Toxic by inhalation, strong irritant to eyes and mucous membranes, especially under pressure. Dangerous air contaminant and constituent of smog. Not permitted in meats and other sources of vitamin B₁. TLV: 2 ppm in air, U.S. atmospheric standard 0.140 ppm.

Use: Chemicals (H_2SO_4 , salt cake, sulfites, hydrosulfites of potassium and sodium, thiosulfates, alum from shale, recovery of volatile substances), sulfite paper pulp, ore and metal refining, soybean protein, intermediates, solvent extraction of lubricating oils, bleaching agent for oils and starch, sulfonation of oils, disinfecting and fumigating, food additive (inhibition of browning, of enzyme-catalyzed reactions, bacterial growth), reducing agent, anti-oxidant.

sulfur dye. See sulfide dye.

sulfuretted hydrogen. See hydrogen sulfide.

sulfur hexafluoride. CAS: 2551-62-4. SF_6 .

Properties: Colorless gas, fp -64°C (sublimes), d (gas) 6.5 g/L, d (liquid) 1.67, specific volume 2.5 cu ft/lb (21.1C), slightly soluble in water, solu-

ble in alcohol and ether, odorless. Non-combustible.

Hazard: TLV: 1000 ppm in air.


Use: Dielectric (gaseous insulator for electrical equipment and radar wave guides).

sulfuric acid. (hydrogen sulfate; battery acid electrolyte acid). CAS: 7664-93-9. H_2SO_4 . By far the most widely used industrial chemical its production was 79.23 billion pounds in 1985. Highest-volume chemical produced in U.S. (1991).


Properties: Strongly corrosive, dense, oily liquid; colorless to dark brown depending on purity; miscible with water. Very reactive, dissolves most metals; concentrated acid oxidizes, dehydrates, or sulfonates most organic compounds, often causes charring; d of pure material 1.84; mp 10.4°C ; bp varies over range $315-338^\circ\text{C}$ due to loss of sulfur trioxide during heating to 300°C or higher.

Note: Use great caution in mixing with water because of heat evolution that causes explosive spattering. Always add the acid to water, *never* the reverse.

Derivation: From sulfur, pyrite (FeS_2), hydrogen sulfide, or sulfur-containing smelter gases by the contact process (vanadium pentoxide catalyst). The first step is combustion of elemental sulfur or roasting of iron pyrites to yield sulfur dioxide. Then follows the critical reaction—catalytic oxidation of sulfur dioxide to sulfur trioxide



in a four-stage converter at $425-450^\circ\text{C}$ with evolution of heat. After cooling to 160°C , the sulfur trioxide is absorbed in a circulating stream of 98-99% sulfuric acid, where it unites with the small excess of water in the acid to form more sulfuric acid.



Sulfuric acid can also be made by the "Cat-Ox" process and from gypsum (calcium sulfate).

Grade: Commercial 60 degrees Bé: (d 1.71, 77.7% sulfuric acid); 66 degrees Bé (d 1.84, 93.2% sulfuric acid); 98% (d 1.84); 99% (d 1.84). 100% (d: 1.84), depending on supplier; reagent ACS, CP.

Hazard: Strong irritant to tissue. TLV: 1 mg/m³ of air.

See note above.

Use: Fertilizers, chemicals, dyes and pigments, etchant, alkylation catalyst, electroplating baths, iron and steel, rayon and film, industrial explosives, lab reagent, nonferrous metallurgy. See also sulfuric acid, fuming.

iponitrile, cyanide salts, dyes, chelates, rodenticides, pesticides.

"Hydro-Darco" [*American Norit*]. TM for activated carbon based adsorbent.

Use: For purification of water, fine chemicals, waste water, air, and pharmaceuticals. Used for recovery of valuable products as in gold and organic solvents.

hydrodealkylation. (HDA). A type of hydrogenation used in petroleum refining in which heat and pressure in the presence of hydrogen are used to remove methyl or larger alkyl groups from hydrocarbon molecules, or to change the position of such groups. The process is used to upgrade products of low value, such as heavy reformat fractions, naphthenic crudes, or recycle stocks from catalytic cracking. Also toluene and pyrolysis gasoline are converted to benzene and methyl naphthalenes to naphthalene by this process.

See also transalkylation.

hydrodistillation. (steam distillation). Removal of essential oils from plant components (flowers, leaves, bark, etc.) by the use of high-temperature steam. The process is used chiefly in the perfume and fragrance industry.

hydrofining. A petroleum refining process in which a limited amount of hydrogenation converts the sulfur and nitrogen in a petroleum fraction to forms in which they can be easily removed. Hydrofining is generally a separate treatment prior to more extensive hydrogenation. The usual catalysts are oxides of cobalt and molybdenum. Desulfurization, ultrafining, and catfining have a similar meaning.

hydroflumethiazide. (trifluoromethylhydrothiazide). CAS: 135-09-1. $C_8H_8F_3N_3O_4S_2$.

Properties: White, crystalline, odorless solid. Mp 260-275C, insoluble in water and acid, soluble in dilute alkali but unstable in alkaline solutions. Grade: NF.

Use: Medicine (antihypertensive).

hydrofluoric acid. CAS: 7664-39-3. Hydrogen fluoride in aqueous solution.

Properties: Colorless, fuming, mobile liquid; bp (38% solution) 112C. Will attack glass and any silicon-containing material.

Derivation: Dissolving hydrogen fluoride in water to various concentrations.

Grade: CP, technical, 38%, 47%, 53%, 70%.

Hazard: Toxic by ingestion and inhalation, highly corrosive to skin and mucous membranes. TLV: ceiling 3 ppm.

Use: Aluminum production, fluorocarbons, pickling stainless steel, etching glass, acidizing

oil wells, fluorides, gasoline production (alkylation), processing uranium.
See also hydrogen fluoride.

hydrofluorosilicic acid. Legal label name (Rail) for fluosilicic acid.

hydrofluosilicic acid. See fluosilicic acid.

"Hydrofol" [*Sherex*]. (behenic acid).

CAS: 112-85-6. TM for synthetic waxes.

Use: For lubricants, esters, chemical synthesis, and specialties.

"Hydrofol" [*Ashland*]. (stearic acid).

CAS: 57-11-4. TM for an additive.

Use: In esters, greases, candles, crayons, cosmetics, metallic salts, mono- and diglyceride, shaving creams, textile auxiliaries, white stearates, waxes, and rubber compounding.

hydroforming. The use of hydrogen in the presence of heat, pressure, and catalysts (usually platinum) to convert olefinic hydrocarbons to branched-chain paraffins (isomerization) to yield high-octane gasoline. Catforming and similar terms are often used in the same sense.

hydrofuramide. (furfuramide). CAS: 494-47-3. $OC_4H_3CH(NCHC_4H_3O)_2$.

Properties: Light brown to white powder, mp 117C, boils about 250C with decomposition, insoluble in cold water, soluble in alcohol and ether.

Derivation: Treatment of furfural with ammonia.

Use: Rubber accelerator, hardening agent for resins, rodenticides, fungicides.

hydrogasification. Production of gaseous or liquid fuels by direct addition of hydrogen to coal. See also gasification.

hydrogen. CAS: 1333-74-0. H_2 . Nonmetallic element of atomic number 1, group IA of periodic table, atomic weight 1.0079, valence of 1. Molecular formula is H_2 . Isotopes: deuterium (2D), tritium (3T). Hydrogen discovered by Cavendish in 1766, named by Lavoisier in 1783.

Properties: A diatomic gas, density 0.08999 g/L, d 0.0694 (air = 1.0), specific volume 193 cu ft/lb (21.1C), fp -259C, bp -252C, autoign temperature 1075F (580C). Very slightly soluble in water, alcohol, and ether; Noncorrosive; can exist in crystalline state at from 4-1 K; classed as an asphyxiant gas; rate of permeation through solids is approximately four times that of air.

Occurrence: Chiefly in combined form (water, hydrocarbons, and other organic compounds),

ple is the nitration of cellulose to nitrocellulose. It is widely used in aromatic reactions to form such compounds as nitrobenzene, trinitrotoluene, nitroglycerin, and other explosives. Aromatic nitrations are usually effected with mixed acid, a mixture of nitric and sulfuric acids, at 0–120°C. Aliphatic nitration is less common than aromatic, but propane can be nitrated under pressure to yield nitroparaffins.

nitrene. Electron-deficient, uncharged monovalent nitrogen species with either singlet or triplet electronic configurations; analog of carbene.

nitric acid. (aqua fortis; engraver's acid; azotic acid). CAS: 7697-37-2. HNO_3 . 13th highest-volume chemical produced in U.S. (1991).

Properties: Transparent, colorless or yellowish, fuming, suffocating, hygroscopic, corrosive liquid. Will attack almost all metals. The yellow color is due to release of nitrogen dioxide on exposure to light; strong oxidizing agent, miscible with water, decomposes in alcohol, bp (decomposes) 78°C, fp -42°C , d 1.504 (25/4°C), vap press 62 mm Hg (25°C), refr index 1.3970 (24°C), viscosity 0.761 cP (25°C).

Derivation: (1) Oxidation of ammonia by air or oxygen with platinum catalyst. (Note: A pelleted catalyst not containing platinum or other noble metals is available.) Air oxidation yields 60% acid; concentration is achieved by (1) distillation with sulfuric acid, (2) extractive distillation with magnesium nitrate, or (3) by neutralizing the weak acid with soda ash, evaporating to dryness, and treating with sulfuric acid. Method (3) yields synthetic niter cake (NaHSO_4) as a by-product. (2) High-pressure oxidation of nitrogen tetroxide (yields 98% acid). (3) Reaction of nitrogen and oxygen in nuclear reactors; two tons of nitric acid are said to be produced from one gram of enriched uranium. Not in commercial use.

Strength of solutions: 36, 38, 40, 42 degrees Bé; 58–63.5%; 95%.

Hazard: Dangerous fire risk in contact with organic materials. Highly toxic by inhalation, corrosive to skin and mucous membranes, strong oxidizing agent. TLV: 2 ppm in air.

Use: Manufacture of ammonium nitrate for fertilizer and explosives, organic synthesis (dyes, drugs, explosives, cellulose nitrate, nitrate salts), metallurgy, photo-engraving, etching steel, ore flotation, urethanes, rubber chemicals, reprocessing spent nuclear fuel.

nitric acid, fuming. (1) White fuming nitric acid (WFNA) contains more than 97.5% nitric acid, less than 2% water, and less than 0.5% NO_x . It is a colorless or pale yellow liquid which fumes strongly. It is decomposed by light or elevated

temperatures, becoming red in color from nitrogen dioxide.

(2) Red fuming nitric acid (RFNA) contains more than 85% nitric acid, approximately 6–15% NO_x (as nitrogen dioxide), and less than 5% water.

Derivation: From dilute nitric acid, nitrogen dioxide, and oxygen.

Hazard: Toxic by inhalation, corrosive to skin and mucous membranes. Strong oxidizing agent, may explode in contact with strong reducing agents. Dangerous fire risk.

Use: Preparation of nitro-compounds, rocket fuels, laboratory reagent.

nitric oxide. CAS: 10102-43-9. NO .

Properties: Colorless gas (readily reacts with oxygen at room temperature to form nitrogen dioxide, NO_2 , a reddish-brown gas), bp -152°C , fp -164°C , d at bp 1.27, slightly soluble in water. Non-combustible.

Derivation: Oxidation of ammonia above 500°C, decomposition of nitrous acid (aqueous solution). Also from atmospheric oxygen and nitrogen in the electric-arc process for fixation of nitrogen.

Grade: Pure (99%).

Hazard: Supports combustion. Toxic by inhalation, strong irritant to skin and mucous membranes. TLV: 25 ppm in air.

Use: Intermediate in production of nitric acid from ammonia, preparation of nitrosyl carbonyls, bleaching rayon.

See also nitrogen dioxide.

nitride. A compound of metal and nitrogen, as in aluminum nitride.

nitriding. A process of case hardening in which a ferrous alloy, usually of special composition, is heated in an atmosphere of ammonia or in contact with nitrogenous material to produce surface hardening by absorption of the nitrogen without quenching. The alloys used for nitriding are known as nitroalloys. Several types are available with ranges of composition.

nit
-
(1
Ha
fla
ga
aci

nitrite
trile
-NBI

p-nitro-
Proper-
ether, ve.
in hot wa
tion, mp 214
Derivation: By
Use: Manufacture
liquid, partially
ature, mp approxi-
sol. Combustible.
ation.

methylacetopyranone. See dehydroacetic acid.

methylacetylene. (allylene; propyne).

CAS: 74-99-7. $\text{CH}_2\text{C}\equiv\text{CH}$.

Properties: Colorless, liquefied gas. Bp -23.1°C , fp -101.5°C , sp vol 9.7 cu ft/lb (70F).

Hazard: Flammable, dangerous fire risk. Toxic by inhalation. TLV: 1000 ppm in air.

Use: Specialty fuel, chemical intermediate.

methylacetylene-propadiene, stabilized.

(MAPP).

Properties: Colorless, liquefied gas. D (liquid): 0.576 (15/15C), boiling range -39 to -20°C , flame temperature (in oxygen) 2925°C . A mixture containing 60–66.5% methylacetylene and propadiene, balance propane and butane.

Hazard: Flammable, dangerous fire risk. Toxic by inhalation. TLV: 1000 ppm in air.

Use: Industrial fuel gas for cutting, welding, brazing, heat treating, metallizing.

See also "Mapp."

methyl acetylricinoleate.

$\text{C}_{17}\text{H}_{32}(\text{OCOCH}_3)\text{COOCH}_3$.

Properties: Pale yellow, low viscosity, oily liquid. Mild odor, d 0.938 (25/25C), solidifies at -26°C , soluble in most organic liquids, insoluble in water. Combustible.

Derivation: Castor oil, methanol and acetic anhydride.

Use: Plasticizer, lubricant, protective coatings, synthetic rubbers, vinyl compounds.

methyl acetylsalicylate. CAS: 580-02-9.

$\text{CH}_3\text{COOC}_6\text{H}_4\text{COOCH}_3$.

Properties: White crystals, mp 52°C , 134 – 136°C (9 mm Hg).

Derivation: By heating methyl salicylate with a slight excess of acetic anhydride, adding alcohol, then water, and separating the resulting precipitate.

Use: Perfumery (fixative).

methyl acid phosphate. See methylphosphoric acid.

β -methylacrolein. See crotonaldehyde.

methyl acrylate. CAS: 96-33-3.

$\text{CH}_2=\text{CHCOOCH}_3$.

Properties: Colorless, volatile liquid. Bp 80.5°C , fp -76.5°C , vap press 65 mm Hg (20C), d 0.9574 (20/20C), bulk d 8.0 lb/gal, slightly soluble in water, readily polymerized, flash p 25°F (-3.8°C) (TOC).

Derivation: (1) Ethylene cyanohydrin, methanol, and dilute sulfuric acid; (2) Oxo reaction of acetylene, carbon monoxide, and methanol in the presence of nickel or cobalt catalyst; (3) from β -propiolactone.

Grade: Technical (inhibited).

Hazard: Flammable, dangerous fire and explosion risk. Toxic by inhalation, ingestion, and skin absorption; irritant to skin and eyes. TLV: 10 ppm in air.

Use: Acrylic polymers, amphoteric surfactants, vitamin B₁, chemical intermediate.

See also acrylate.

β -methylacrylic acid. See crotonic acid.

methylal. (dimethoxymethane; formal).

CAS: 109-87-5. $\text{CH}_3\text{OCH}_2\text{OCH}_3$.

Properties: Colorless, volatile liquid; chloroform-like odor; pungent taste; fp -105°C ; d 0.86 (20/4C); bp 42.3°C ; soluble in water at 20°C to extent of 32 wt%; miscible in alcohol, ether, and hydrocarbons; flash p (OC) approximately 0°F (-17.7°C); autoign temp 459°F (237°C).

Hazard: Flammable, dangerous fire and explosion risk. Toxic by ingestion and inhalation.

TLV: 1000 ppm in air.

Use: Solvent, organic synthesis, perfumes, adhesives, and protective coatings; special fuel.

2-methylalanine. See aminoisobutyric acid.

methyl alcohol. (methanol; wood alcohol).

CAS: 67-56-1. CH_3OH . 22nd highest-volume chemical produced in U.S. (1991).

Properties: Clear, colorless, mobile, highly polar liquid; miscible with water, alcohols, and ether. D 0.7924, fp -97.8°C , bp 64.5°C , bulk d 6.59 lb/gal (20C), refr index 1.329 (20C), surface tension 22.6 dynes/dm (20C), viscosity 0.00593 poise (20C), vap press 92 mm Hg (20C), flash p 54°F (12.2C) (OC), autoign temp 867°F (464C).

Derivation: (1) By high-pressure catalytic synthesis from carbon monoxide and hydrogen; (2) partial oxidation of natural gas hydrocarbons; (3) several processes for making methanol by gasification of wood, peat, and lignite have been developed but have not yet proved out commercially; (4) from methane with molybdenum catalyst (experimental).

Method of purification: Rectification.

Grade: Technical, CP (99.85%), electronic (used to cleanse and dry components), fuel.

Hazard: Flammable, dangerous fire risk. Explosive limits in air 6–36.5% by volume. Toxic by ingestion (causes blindness). TLV: 200 ppm in air.

Use: Manufacture of formaldehyde, acetic acid, and dimethyl terephthalate; chemical synthesis (methyl amines, methyl chloride, methyl methacrylate); antifreeze; solvent for nitrocellulose, ethylcellulose, polyvinyl butyral, shellac, rosin, manila resin, dyes; denaturant for ethanol; dehydrator for natural gas; fuel for utility plants (methyl fuel); feedstock for manufacture of synthetic proteins by continuous fermentation;

Derivation: (1) Addition of sodium cyanide and formaldehyde to a basic solution of ethylenediamine (forms the tetrasodium salt), (2) heating tetrahydroxyethylethylenediamine with sodium hydroxide or potassium hydroxide with cadmium oxide catalyst.

Use: Detergents, liquid soaps, shampoos, agricultural chemical sprays; metal cleaning and plating, metal chelating agent, treatment of chlorosis, decontamination of radioactive surfaces; metal deactivator in vegetable oils, oil emulsions, pharmaceutical products, etc.; anticoagulant of blood, eluting agent in ion exchange; to remove insoluble deposits of calcium and magnesium soaps; in textiles to improve dyeing, scouring, and detergent operations; antioxidant; clarification of liquids; analytical chemistry, spectrophotometric titration; aid in reducing blood cholesterol; in medicine to treat lead poisoning and calcinosis; food additive (preservative).

Note: A number of salts of EDTA are available with uses identical or similar to the acid. The USP salts are called edetates (calcium disodium, disodium edetates), others are usually abbreviated to EDTA (tetrasodium, trisodium EDTA). Other salts, known chiefly under trademark names, are the sodium ferric, dihydrogen ferrous and a range of disodium salts with magnesium, divalent cobalt, manganese, copper, zinc, and nickel.

ethylenediaminetetraacetoneitrile. (EDTAN). $[-CH_2NCH_2CN]_2$.

Properties: White, crystalline solid. Melting range 126–132°C, bulk d 48.4 lb/cu ft, slightly soluble in water, soluble in acetone.

Hazard: Toxic by ingestion and inhalation.

Use: Chelating agent and intermediate.

ethylene dibromide. (EDB; 1,2-dibromoethane; ethylene bromide). CAS: 106-93-4. $BrCH_2CH_2Br$.

Properties: Colorless, non-flammable liquid. Sweetish odor, emulsifiable, miscible with most solvents and thinners, slightly soluble in water, d 2.17–2.18 (20°C), bulk d 18.1 lb/gal, bp 131°C, vap press 17.4 mm Hg (30°C), fp 9°C, refr index 1.5337 (25°C), flash p none.

Derivation: Action of bromine on ethylene.

Hazard: TLV: suspected human carcinogen. Toxic by inhalation, ingestion, and skin absorption, strong irritant to eyes and skin.

Use: Scavenger for lead in gasoline, grain fumigant, general solvent, waterproofing preparations, organic synthesis, fumigant for tree crops.

Note: May poison platinum catalysts.

ethylene dichloride. (sym-dichloroethane; 1,2-dichloroethane; ethylene chloride; Dutch oil).

CAS:107-06-2. $ClCH_2CH_2Cl$. 15th highest-volume chemical produced in U.S. (1991).

Properties: Colorless, oily liquid. Chloroform-like odor, sweet taste. Stable to water, alkalies, acids, or active chemicals; resistant to oxidation, will not corrode metals, miscible with most common solvents, slightly soluble in water, bp 83.5°C, fp –35.5°C, d 1.2554 (20/4°C), 10.4 lb/gal, refr index 1.444, flash p 56°C (13.3°C).

Derivation: Action of chlorine on ethylene with subsequent distillation with metallic catalyst, also by reaction of acetylene and hydrochloric acid.

Grade: Technical, spectrophotometric.

Hazard: Toxic by ingestion, inhalation, and skin absorption; strong irritant to eyes and skin, a carcinogen. Flammable, dangerous fire risk, explosive limits in air 6–16%. TLV: 10 ppm in air.

Use: Production of vinyl chloride, trichloroethylene, vinylidene chloride, and trichloroethane; lead scavenger in antiknock gasoline; paint, varnish, and finish removers; metal degreasing; soaps and scouring compounds, wetting and penetrating agents; organic synthesis, ore flotation; solvent, fumigant.

ethylene dicyanide. See ethylene cyanide.

ethylenedinitrilotetraacetic acid. See ethylenediaminetetraacetic acid.

ethylenedinitrilotetra-2-propanol. See N,N,N',N'-tetrakis(2-hydroxypropyl)ethylenediamine.

ethylenediphenyldiamine. See N,N-diphenylethylenediamine.

1,1'-ethylene-2,2'-dipyridinium dibromide. See diquat.

ethylene glycol. (ethylene alcohol; glycol; 1,2-ethanediol). CAS: 107-21-1.

CH_2OHCH_2OH . The simplest glycol; 30th highest-volume chemical produced in U.S. (1991).

Properties: Clear, colorless, syrupy liquid. Sweet taste, hygroscopic, lowers fp of water, relatively non-volatile, odorless. Soluble in water, alcohol, and acetone. D 1.1155 (20°C), bp 197.2°C, fp –13.5°C, bulk d 9.31 lb/gal (15/15°C), refr index 1.430 (25°C), flash p 240.8°F (116°C), autoign temperature 775°F (412°C). Combustible.

Derivation: (1) Air oxidation of ethylene followed by hydration of the ethylene oxide formed, (2) acetoxylation, (3) from carbon monoxide and hydrogen (synthesis gas) from coal gasification, (4) Oxirane process.

Grade: Technical.

Hazard: TLV: (vapor) ceiling 50 ppm. Toxic by ingestion and inhalation. Lethal dose reported to be 100 cc.

acetate fiber, saponified. Regenerated cellulose fibers obtained by complete saponification of highly oriented cellulose acetate fibers. Available in continuous filament form having a high degree of crystallinity and great strength.

Properties: Tensile strength (psi) 136,000–155,000; elongation 6%; d 1.5–1.6; moisture regain 9.6–10.7%; decomposes about 149C. Similar to cotton in chemical resistance, dyeing, and resistance to insects and mildew. Combustible.

Use: Cargo parachutes; typewriter ribbons; belts; webbing; tapes; carpet backing.

acetate film. A durable, highly transparent film with non-deforming characteristics, produced from cellulose acetate resin. It is grease-, oil-, dust-, and air-proof and hygienic. Combustible. Available forms: Rolls and cut-to-size sheets.

Use: Laminates; support for photographic film; document preservation; pressure-sensitive tape; magnetic sound recording tape; window cartons and envelopes packaging.

acetate of lime. Commercial term for calcium acetate made from pyroligneous acid and milk of lime. There are brown and gray acetates of lime. See also calcium acetate.

acetate process. See cellulose acetate.

acetate rayon. The yarn made from refined wood cellulose by the acetate process. See acetate fiber

acetate rayon process. In this process cellulose is combined with acetic anhydride to make cellulose acetate, which is dissolved in acetone and forced through spinnerette holes into a precipitating bath. See acetate fiber.

acethydrazidepyridinium chloride. See Girard's reagent.

acetic acid. (ethanoic acid; vinegar acid; methanecarboxylic acid). CAS: 64-19-7. (CH_3COOH). Glacial acetic acid is the pure compound (99.8% min), as distinguished from the usual water solutions known as acetic acid. 34th highest-volume chemical produced in U.S. (1991).

Properties: Clear, colorless liquid; pungent odor. Mp 16.63C; bp 118C (765 mmHg), 80C (202 mmHg); d 1.0492 (20/4C); wt/gal (20C) 8.64 lb; viscosity (20C) 1.22 cps; flash p (OC) 110F (43C); refr index 1.3715 (20C). Miscible with water, alcohol, glycerol, and ether; insoluble in carbon disulfide; autoign temperature 800F (426C). Combustible.

Derivation: (a) Liquid- and vapor-phase oxidation of petroleum gases (with catalyst); (b) oxidation of acetaldehyde; (c) reaction of methanol

and carbon monoxide (with catalyst; this is the most cost-efficient method and has been in general use for some years); (d) fermentative oxidation of ethanol.

Grade: USP (glacial, 99.4 wt %, and dilute, 36–37 wt %); CP; technical (80; 99.5%); commercial (6, 28, 30, 36, 56, 60, 70, 80, and 99.5%); NF (diluted; 6.0 g/100 mL).

Hazard: Moderate fire risk. Pure acetic acid is moderately toxic by ingestion and inhalation, but dilute material is approved by FDA for food use. Strong irritant to skin and tissue. TLV: 10 ppm in air.

Use: Manufacturing of acetic anhydride, cellulose acetate, and vinyl acetate monomer; acetic esters; chloroacetic acid; production of plastics, pharmaceuticals, dyes, insecticides, photographic chemicals, etc.; food additive (acidulant); latex coagulant; oil-well acidizer; textile printing.

See also vinegar.

acetic acid amine. See acetamide.

acetic acid, glacial. See acetic acid.

acetic aldehyde. See acetaldehyde.

acetic anhydride. (acetyl oxide; acetic oxide).

CAS: 108-24-7. (CH_3CO)₂O.

Properties: Colorless, mobile, strongly refractive liquid; strong odor; d 1.0830 (20/20C); bp 139.9C; fp –73.1C; flash p 121F (49.4C) (CC). Autoign temperature 732F (385C); wt/gal (20C) 9.01 lb. Miscible with alcohol, ether, and acetic acid; soluble in cold water; decomposes in hot water to form acetic acid. Combustible.

Derivation: (1) Oxidation of acetaldehyde with air or oxygen with catalyst; (2) by catalyzed thermal decomposition of acetic acid to ketone; (3) reaction of ethyl acetate and carbon monoxide; (4) from carbon monoxide and methanol.

Grade: C.P., technical (75, 85, 90–95%).

Hazard: Strong irritant and corrosive; may cause burns and eye damage. TLV: Ceiling 5 ppm in air. Moderate fire risk.

Use: Cellulose acetate fibers and plastics; vinyl acetate; dehydrating and acetylating agent in production of pharmaceuticals, dyes, perfumes, explosives; etc.; aspirin. Esterifying agent for food starch (5% max).

acetic ester. See ethyl acetate.

acetic ether. See ethyl acetate.

acetic oxide. See acetic anhydride.

acetin. (monoacetin; glyceryl monoacetate).


CAS: 102-76-1. $\text{C}_3\text{H}_5(\text{OH})_2\text{OOCCH}_3$.

Hazard: Toxic by ingestion.

Use: Medicine (antiseptic, solution 1:1000).

acetone. (dimethylketone; 2-propanone).

CAS: 67-64-1. CH_3COCH_3 . 44th highest-volume chemical produced in U.S. (1991).



Properties: Colorless, volatile liquid; sweetish odor. Mp -94.3°C ; bp 56.2°C ; refr index (20C) 1.3591; d 0.792 (20/20C); wt/gal 6.64 lb (15C); flash p (OC) 15F (-9.4°C). Autoign temperature 1000F (537C). Miscible with water, alcohol, ether, chloroform, and most oils.

Derivation: (1) Oxidation of cumene; (2) dehydrogenation or oxidation of isopropyl alcohol with metallic catalyst; (3) vapor phase oxidation of butane; (4) by-product of synthetic glycerol production.

Grade: Technical; CP; NF; electronic; spectrophotometric.

Hazard: Flammable; dangerous fire risk. Explosive limits in air 2.6–12.8%. TLV: 750 ppm in air. Narcotic in high concentrations. Moderately toxic by ingestion and inhalation.

Use: Chemicals (methyl isobutyl ketone; methyl isobutyl carbinol; methyl methacrylate; bisphenol-A); paint, varnish and lacquer solvent; cellulose acetate, especially as spinning solvent; to clean and dry parts of precision equipment; solvent for potassium iodide and permanganate; delusterant for cellulose acetate fibers; specification testing of vulcanized rubber products.

acetone bromoform. See tribromo-tert-butyl alcohol.

acetonecarboxylic acid. See acetoacetic acid.

acetone chloroform. See chlorobutanol.

acetone cyanohydrin. (α -hydroxyisobutyronitrile; 2-methylactonitrile). CAS: 75-86-5. $(\text{CH}_3)_2\text{COHCN}$.

Properties: Colorless liquid; bp 82°C (23 mm Hg); mp -20°C ; d 0.932 (19C); refr index 1.3996 (20C); flash p 165F (73.9C); soluble in alcohol and ether. Combustible; autoign temperature 1270F (685C).

Derivation: Condensing acetone with hydrocyanic acid.

Grade: Technical (97–98% pure).

Hazard: Toxic. Readily decomposes to hydrocyanic acid and acetone.

Use: Insecticides; intermediate for organic synthesis, especially methyl methacrylate.

acetonedicarboxylic acid.

See β -ketoglutaric acid.

acetone number. The degree of polymerization of a bodied vegetable oil, measured by the amount of matter which is insoluble in acetone.

acetone oxime. See acetoxime.

acetone semicarbazone. $(\text{CH}_3)_2\text{CNNHCONH}_2$.

A chemical intermediate.

Properties: White powder; mp 188°C .

acetone sodium bisulfate. See sodium acetone bisulfate.

acetonitrile. (methyl cyanide).

CAS: 75-05-8. CH_3CN .

Properties: Colorless, limpid liquid; aromatic odor; d 0.783; mp -41°C ; bp 82°C ; flash p 42F (5.56C). Soluble in water and alcohol; high dielectric constant; high polarity; strongly reactive.

Derivation: By-product of propylene-ammonia process for acrylonitrile.

Grade: Technical; nanograde; spectrophotometric.

Hazard: Flammable, dangerous fire risk. TLV: 40 ppm in air, toxic action by skin absorption and inhalation.

Use: Solvent in hydrocarbon extraction processes, especially for butadiene; specialty solvent; intermediate; catalyst; separation of fatty acids from vegetable oils; manufacturing of synthetic pharmaceuticals.

acetonylacetone. (1,2-diacetylene; hexanedione-2,5; 2,5-diketohexane).

CAS: 110-13-4. $\text{CH}_3\text{COCH}_2\text{CH}_2\text{COCH}_3$.

Properties: Colorless liquid, soluble in water, d 0.9734 (20/20C), bp 192.2°C , vap press 0.43 mm Hg at 20C, fp -5.4°C , flash p 185F (85C), bulk d 8.2 lb/gal (20C), autoign temperature 920F (493C). Combustible.

Derivation: By-product in the production of acetaldehyde from acetylene.

Grade: Technical.

Hazard: Irritant to eyes and skin.

Use: Solvent for cellulose acetate, roll-coating inks, lacquers, stains; intermediate for pharmaceuticals and photographic chemicals; electroplating.

acetonyl alcohol.

See hydroxy-2-propanone.

3-(α -acetonylbenzyl)-4-hydroxycoumarin.

See "Warfarin."

3-(α -acetonylfurfuryl)-4-hydroxycoumarin.

(sodium salt also used). A rodenticide.

Hazard: Highly toxic by ingestion and inhalation.

N-isopropylacrylamide. (NIPAM). Crystalline solid; homopolymers and copolymers prepared with this material show inverse solubility in water.

Use: Binders in textiles, paper, adhesives, detergents, cosmetics.

See also acrylic resin.

isopropyl alcohol. (IPA; dimethylcarbinol; sec propyl alcohol; isopropanol; 2-propanol).

CAS: 67-63-0. $(\text{CH}_3)_2\text{CH}_2\text{O}$. 48th highest-volume chemical produced in U.S. (1991).

Properties: Colorless liquid, pleasant odor, bp 82.4C, d 0.7863 (20/20C), refr index 1.3756 (20C), sp ht 0.65 cal/g, fp -86C, critical temperature 235C, critical pressure 53 atm, vap press 33 mm Hg at 20C, flash p 53F (11.7C) (TOC), heat of combustion 14,346 Btu/lb, heat of vaporization 288 Btu/lb, viscosity 2.1 cP (25C), autoign temperature 850F (453C). Soluble in water, alcohol, and ether.

Derivation: By treatment of propylene with sulfuric acid and hydrolyzing.

Method of purification: Rectification.

Grade: 91%, 95%, 99%, NF (99%), nanograde.

Hazard: Flammable, dangerous fire risk, explosive limits in air 2-12%. Toxic by ingestion and inhalation. TLV: 400 ppm in air.

Use: Manufacture of acetone and its derivatives, manufacture of glycerol and isopropyl acetate, solvent for essential and other oils, alkaloids, gums, resins, etc.; latent solvent for cellulose derivatives, coatings solvent, deicing agent for liquid fuels, lacquers, extraction processes, dehydrating agent, preservative, lotions, denaturant.

isopropylamine. (2-aminopropane).

CAS: 75-31-0. $(\text{CH}_3)_2\text{CHNH}_2$.

Properties: Colorless, volatile liquid. Amine odor, strong alkaline reaction, bp 32.4C, fp -101C, d 0.6881 (20/20C), bulk d 5.7 lb/gal (20C), refr index 1.3770 (15C), flash p (OC) -35F (-37.2C), autoign temperature 756F (402C). Miscible with water, alcohol, and ether. Derivation: From acetone and ammonia under pressure.

Hazard: Highly flammable, dangerous fire risk. Strong irritant to tissue. TLV: 5 ppm in air.

Use: Solvent, intermediate in synthesis of rubber accelerators, pharmaceuticals, dyes, insecticides, bactericides, textile specialties, and surface-active agents, dehairing agent, solubilizer for 2,4-D acid.

p-isopropylaminodiphenylamine. See N-isopropyl-N'-phenyl-p-phenylenediamine.

isopropylaminoethanol. (IPAE).

CAS: 109-56-8. A commercial mixture of approximately 60% isopropylethanolamine,

$(\text{CH}_3)_2\text{CHNHCH}_2\text{CH}_2\text{OH}$, and 40% isopropyl diethanolamine, $(\text{CH}_3)_2\text{CHN}(\text{CH}_2\text{CH}_2\text{OH})_2$. Properties: Amber to straw-colored liquid, distillation range 110-165C, fp approximately -50C, d 0.91-0.94 (20/20C), flash p 145-155F (62.7-68.3C) (OC). Combustible.

Use: Synthesis of emulsifiers.

N-isopropylaniline. CAS: 768-52-5.

$\text{C}_6\text{H}_5\text{NHCH}(\text{CH}_3)_2$.

Properties: Yellowish liquid, bp 206C, pour point below -67C, refr index 1.5365 (20C), flash p 190F (87.7C) (COC). Combustible.

Hazard: Toxic by inhalation and skin absorption. TLV: 2 ppm in air.

Use: Dyeing acrylic fibers, chemical intermediate.

p-isopropylaniline. See cumidine.

isopropyl antimonite. $[(\text{CH}_3)_2\text{CHO}]_3\text{Sb}$.

Properties: Colorless liquid, bp 82C at 7 mm Hg pressure.

Derivation: Reaction of antimony trichloride with isopropanol.

Use: Cross-linking agent, flameproofing agent.

isopropylarsine. See "Epigrade" [Advanced].

p-isopropylbenzaldehyde. See cuminic aldehyde.

isopropylbenzene. See cumene.

p-isopropylbenzyl alcohol. See cuminic alcohol.

isopropylbiphenyl. See "Tanacol CG" [Sybron].

isopropyl bromide. CAS: 75-26-3.

$\text{CH}_3\text{CHBrCH}_3$.

Properties: Colorless liquid, d 1.304 (25/25C), bp 58.5-60.5C, fp -90C, refr index 1.422 (25C), flash p none, slightly soluble in water, soluble in ethanol and ether. Non-flammable.

Use: Synthesis of pharmaceuticals, dyes, other organics.

isopropyl butyrate. CAS: 638-11-9.

$(\text{CH}_3)_2\text{CHOOCC}_3\text{H}_7$.

Properties: Colorless liquid, d 0.8652 (13C), bp 128C.

Use: Solvent for cellulose ethers, flavoring.

isopropylcarbinol. See isobutyl alcohol.

isopropyl chloride. CAS: 75-29-6.

$\text{CH}_3\text{CHClCH}_3$.

Properties: Colorless liquid, d 0.858 (25/25C), bp 34.8C, fp -117.6C, refr index 1.374 (25C), flash p -26F (-32.3C), autoign temperature 1100F (593C), slightly soluble in water, soluble in ethanol and ether.

Hazard: Flammable, moderate fire risk.
Use: Solvent for cellulose acetate, dyeing textiles.

propyl butyrate. CAS: 105-66-8.

$C_3H_7OOCCH_2CH_2CH_3$.
Properties: Colorless liquid, d 0.8789 (15C), bp 142.7C, fp -95.2C, slightly soluble in water, soluble in alcohol and ether. Combustible.
Hazard: Irritant to mucous membranes, narcotic in high concentration.
Use: Solvent mixture for cellulose ethers.

propyl chloride. (1-chloropropane).

CAS: 540-54-5. $CH_3CH_2CH_2Cl$.
Properties: Liquid, fp -122.8C, bp 46.6C, refr index 1.3886 (20C), soluble in alcohol and ether, slightly soluble in water, flash p 0F (-17.7C).
Hazard: Highly flammable, dangerous fire risk, explosive limits in air 2.5-11%. Irritant and narcotic.
See also isopropyl chloride.

propyl chlorosulfonate. CAS: 109-61-5.

$CH_3CH_2CH_2OSO_2Cl$.
Properties: Liquid, bp 70-72C (20 mm Hg).
Derivation: Interaction of n-propyl alcohol and sulfuryl chloride.
Hazard: Toxic by inhalation and ingestion, strong irritant to eyes.
Use: Organic synthesis, military poison gas (lachrymator).

n-propyl cyanide. See n-butyronitrile.

propyl-3,5-diiodo-4-oxo-1(4H)pyridineacetate.
See propyliodone.

propylene. (propene). CAS: 115-07-1.

$CH_3CH=CH_2$. 10th highest-volume chemical produced in U.S. (1991).
Properties: Colorless gas, soluble in alcohol and ether, slightly soluble in water, bp -47.7C, fp -185.2C, d (liquid) 0.5139 (20/4C), vap d at 0C (air = 1) 1.46, flash p -162F (-108C), autoign temp 927F (497C).
Derivation: Catalytic and thermal cracking of ethylene with zeolite catalyst, from naphtha.
Grade: 95%, 99%, and research.
Hazard: Highly flammable, dangerous fire risk, explosive limits in air 2-11%. An asphyxiant gas.
Use: Manufacture of isopropyl alcohol, polypropylene, synthetic glycerol, acrylonitrile, propylene oxide, heptene, cumene, polymer gasoline, acrylic acid, vinyl resins, oxo chemicals.

propylene carbonate.

$C_4H_6O_3$ or $OCOCH_2CH(CH_3)O$.
Properties: Odorless, colorless liquid; fp -49.2C (easily super-cooled); bp 241.7C; d 1.2057

(20/4C); bulk d 10 lb/gal (20C); refr index 1.4209 (20C); flash p 270F (132C). Miscible with acetone, benzene, chloroform, ether, ethyl acetate; moderately soluble in water and carbon tetrachloride. Combustible.

Use: Solvent extraction, plasticizer, organic synthesis, natural gas purification, synthetic fiber spinning solvent.

propylene chloride. See propylene dichloride.

propylene chlorohydrin. (chloro-isopropyl alcohol; 1-chloro-2-propanol). CAS: 78-89-7.
 $CH_2ClCH_2OCH_3$.

Properties: Colorless liquid, mild odor, non-residual, bp 127.5C, vap press 4.9 mm Hg (20C), flash p (CC) 125F (51.6C), bulk d 9.3 lb/gal (20C), d 1.1128 at 20/20C, soluble in water and alcohol.
Grade: Technical.

Hazard: Moderate fire risk. Toxic by ingestion and skin absorption.

Use: Organic synthesis (introducing hydroxypropyl group), manufacture of propylene oxide.

propylenediamine. Legal label name for 1,2-diaminopropane.

propylene dichloride. (1,2-dichloropropane; propylene chloride). CAS: 78-87-5.
 $CH_3CHClCH_2Cl$.

Properties: Colorless, stable liquid; chloroform-like odor. Bp 96.3C, d 1.1583 at 20/20C, bulk d 9.6 lb/gal (20C), refr index 1.4068 (20C), flash p 61F (16.1C), soluble in water 0.26% by wt (20C), fp -80C, miscible with most common solvents, autoign temp 1035F (557C).
Derivation: Action of chlorine on propylene.

Grade: Refined.
Hazard: Flammable, dangerous fire risk, explosive limits in air 3.4-14.5%. Toxic by ingestion and inhalation. TLV: 75 ppm in air.

Use: Intermediate for perchloroethylene and carbon tetrachloride; lead scavenger for antiknock fluids; solvents for fats, oils, waxes, gums, and resins; solvent mixture for cellulose esters and ethers; scouring compounds; spotting agents; metal degreasing agents; soil fumigant for nematodes.

1,2-propylene glycol. (1,2-dihydroxypropane; 1,2-propanediol; methylene glycol; methyl glycol). CAS: 57-55-6. $CH_3CHOHCH_2OH$.

Properties: Colorless, viscous, stable, hygroscopic liquid; practically odorless and tasteless; miscible with water, alcohols, and many organic solvents. Bp 187.3C, fp -60C, d 1.0381 at 20/20C, bulk d 8.64 lb/gal (20C), refr index 1.4293 (27C), surface tension 40.1 dynes/cm (25C), viscosity 0.581 poise (20C), vap press 0.07 mm Hg (20C), specific heat 0.590 cal/g

(20C), latent heat of evaporation 168.6 cal/g at bp, flash p (OC) 210F (99C), autoign temp 780F (415C), heat of combustion 431.0 kg cal/mole. Combustible.

Derivation: By hydration of propylene oxide.

Method of purification: By distillation.

Grade: Refined, technical, USP, FCC, feed.

Use: Organic synthesis, especially polypropylene glycol and polyester resins, cellophane, anti-freeze solution. Solvent for fats, oils, waxes, resins, flavoring extracts, perfumes, colors, soft-drink syrups, antioxidants. Hygroscopic agent, coolant in refrigeration systems, plasticizers, hydraulic fluids, bactericide, textile conditioners. In foods as solvent, wetting agent, humectant. Emulsifier, feed additive, anticaking agent, preservative (retards molds and fungi), cleansing creams, sun tan lotions, pharmaceuticals, brake fluids, deicing fluids for airport runways, tobacco.

See also polypropylene glycol.

1,3-propylene glycol. See trimethylene glycol.

propylene glycol alginate. (hydroxypropyl alginate). ($C_9H_{14}O_7$).

Properties: Vary with degree of esterification.

White powder, practically tasteless and odorless, soluble in water and dilute organic acids.

Grade: FCC.

Use: Stabilizer, thickener, emulsifier, food additive.

propylene glycol dinitrate. (PGDN).

CAS: 6423-43-4. $C_3H_6N_2O_6$.

Properties: Colorless liquid with unpleasant odor, mw 166.09, d 1.232 g/ml at 25C, fp -27.7C, bp decomposes above 121C, slightly soluble in water.

Hazard: Toxic by inhalation and skin contact.

TLV: 0.05 ppm in air.

Use: Torpedo propellant in Otto Fuel II.

propylene glycol distearate. See propylene glycol monostearate.

propylene glycol monomethyl ether. (polypropylene glycol methyl ether). CAS: 107-98-2.

$CH_3OCH_2CH_2OCH_3$.

Properties: Colorless liquid, fp -95C (sets to glass), bp 120.1C, d 0.9234 (20/20C) bulk d 7.65 lb/gal (25C), refr index 1.402 (25C), flash p 97F (36.1C). Soluble in water, methanol, ether.

Hazard: Flammable, moderate fire risk. TLV: 100 ppm

Use: Solvent for celluloses, acrylics, dyes, inks, stains; solvent-sealing of cellophane.

propylene glycol monoricinoleate.

$C_{17}H_{32}(OH)COOCH_2CH_2OCH_3$.

Properties: Pale yellow, moderately viscous, oily

liquid; mild odor. D 0.960 (25/25C), saponification value 160, hydroxyl value 285, solidifies at -26C, soluble in most organic solvents, insoluble in water. Combustible.

Derivation: Castor oil and propylene glycol.

Grade: Technical.

Use: Plasticizer, dye solvents, lubricant, cosmetics, urethane polymers, and hydraulic fluids.

propylene glycol monostearate. The FCC grade is a mixture of propylene glycol mono- and diesters of stearic and palmitic acids. White beads or flakes, bland odor and taste, insoluble in water, soluble in alcohol, ethyl acetate, chloroform and other chlorinated hydrocarbons. Combustible.

Use: Emulsifier, stabilizer.

propylene glycol phenyl ether.

$C_6H_5OCH_2CHOHCH_3$.

Properties: Colorless liquid, d 1.060-1.070 (25/25C), boiling range 5.95%, 237-242C, flash p 275F (135C). Combustible.

Use: High-boiling solvent, bactericidal agent, fixative for soaps and perfumes, intermediate for plasticizers.

propyleneimine. (2-methylaziridine; propyleneimine). CAS: 75-55-8.




Properties: Water-white liquid, bp 66-67C, d 0.8039-0.8070 (25/25C), 1.4094-1.4109 (25C), soluble in water and most organic solvents.

Hazard: Flammable, dangerous fire risk. Toxic by ingestion, inhalation, and skin absorption. A suspected carcinogen. TLV: 2 ppm in air.

Use: Organic intermediate whose derivatives are used in the paper, textile, rubber and pharmaceutical industries.

propylene oxide. CAS: 75-56-9.



35st highest-volume chemical produced in U.S. (1991).

Properties: Colorless liquid, ethereal odor, d 0.8304 at 20/20C, bp 33.9C, vap press 445 mm Hg (20C), flash p -35F (-37.2C), bulk d 6.9 lb/gal (20C), fp -104.4C, partially soluble in water, soluble in alcohol and ether.

Derivation: (1) Chlorohydration of propylene followed by saponification with lime, (2) peroxidation of propylene, (3) epoxidation of propylene by a hydroperoxide complex with molybdenum catalyst.

Hazard: Highly flammable, dangerous fire risk,

bp 230.3C, fp -90C, soluble in water, wt/gal 7.8 lb, flash p 250F (121C). Combustible.

Use: Solvent, hydraulic-fluid components, anti-stall additive for automotive fuels, plasticizer, intermediate.

butoxyethyl laurate. See ethylene glycol monobutyl ether laurate.

butoxyethyl oleate. See ethylene glycol monobutyl ether oleate.

butoxyethyl stearate. See ethylene glycol monobutyl ether stearate.

p-butoxyphenol. $\text{HOC}_6\text{H}_4\text{OC}_4\text{H}_9$.

Properties: White to faint yellow, crystalline powder; mp 61-65C. Soluble in alcohol, acetone, ether, benzene, aqueous alkali; insoluble in water. Combustible.

Grade: 93% pure.

Use: Synthesis.

butoxy polypropylene glycol. (generic name for polypropylene glycol monobutyl ether).

$\text{CH}_3\text{CH}_2\text{O}(\text{CH}_2\text{OCHCH}_3)_n\text{CH}_2\text{OC}_4\text{H}_9$. Colorless liquid.

Use: An insect repellent.

n-butoxypropanol. CAS: 63716-40-5.

Properties: Colorless liquid, d 0.8801 (20/20C), bp 170.2C, fp -80C (sets to glass), soluble in water, flash p 154F (67.7C). Combustible.

Use: Solvent for water-based enamels.

b-butoxy- β' -thiocyanodiethyl ether. [2-(2-butoxyethoxy)ethyl thiocyanate].

$\text{CH}_3(\text{CH}_2)_3\text{OCH}_2\text{OCH}_2\text{CH}_2\text{SCN}$.

Hazard: Toxic by ingestion and skin absorption. Skin irritant.

Use: Insecticide.

butoxytriglycol. (triethylene glycol monobutyl ether).

CAS: 143-22-6. $\text{C}_4\text{H}_9\text{O}(\text{C}_2\text{H}_4\text{O})_3\text{H}$.

Properties: Liquid, d 1.0021 (20/20C), bp (decomposes), fp -47.6C, miscible in water, flash p 290F (143C). Combustible.

Use: Plasticizer, intermediate.

butter. (1) A colloidal system (emulsion) in which the continuous phase is composed of liquid fat from fat globules disintegrated by mechanical agitation and the dispersed phase is composed of finely divided water droplets and undamaged fat globules. (2) Outmoded term for hygroscopic metallic chlorides of viscous consistency, e.g., butter of zinc, etc.

buttercup yellow. See zinc yellow.

butterfat. The oily portion of the milk of mammals.

Properties: Composition is largely glycerides of oleic, stearic, and palmitic acids, with smaller amounts of the glycerides of butyric, caproic, caprylic, and capric acids, d range 0.910-0.914. Cow's milk contains approximately 4% butterfat.

See also milk.

butter yellow. See dimethylaminoazobenzene.

"Butvar" [Monsanto]. TM for polyvinyl butyral resins with various hydroxy content whose solutions provide a range of viscosities.

Use: For film clarity, flexibility, abrasion, and water resistance; for use in primers, structural hot-metal adhesives, inks, and waterproof coatings.

butyl. (1) The group C_4H_9 ; (2) butyl rubber.

n-butyl acetate. CAS: 123-86-4.

$\text{CH}_3\text{COOCH}_2\text{CH}_2\text{CH}_2\text{CH}_3$.

Properties: Colorless liquid, fruity odor. Soluble in alcohol, ether, and hydrocarbons; slightly soluble in water. Vapor is heavier than air, d 0.8826 at 20/20C, bp 126.3C, vap press 8.7 mm Hg (20C), fp -75C, refr index 1.2951 (20C), wt/gal 7.35 lb (20C), flash p 98F (36.6C) (TOC). Autoign temperature 790F (421C).

Derivation: Esterification and then distillation after contact of butyl alcohol with acetic acid in the presence of a catalyst such as sulfuric acid.

Hazard: Skin irritant, toxic. Flammable, moderate fire risk. TLV: 150 ppm in air.

sec-butyl acetate. CAS: 105-46-4.

$\text{CH}_3\text{COOCH}(\text{CH}_3)\text{C}_2\text{H}_5$.

Properties: Colorless liquid, bp 112.2C, d 0.8905 at 0/4C, 0.870 at 20/4C, refr index 1.389 (20C), wt/gal 7.21 lb, flash p 88F (31C) (OC). Miscible with alcohol and ether, insoluble in water.

Derivation: Esterification of sec-butyl alcohol.

Hazard: Flammable, dangerous fire risk. TLV: 200 ppm in air.

Use: Solvent for nitrocellulose lacquers, thinners, nail enamels, leather finishes.

tert-butyl acetate. CAS: 540-88-5.

$\text{CH}_3\text{COOC}(\text{CH}_3)_2$.

Properties: Colorless liquid, bp 96C, d 0.896 (20C). Insoluble in water, soluble in alcohol and ether.

Hazard: Flammable, moderate fire risk. TLV: 200 ppm in air.

Use: Solvent, gasoline additive.

butyl acetate dilution ratio. Measure of approximate tolerance of nitrocellulose solutions for pe-

Grade: Commercial 85–88%, 95–98%, 99%, NF (99%), FCC.

Hazard: Toxic by inhalation and skin absorption; irritant to eyes and skin. Flammable; dangerous fire and explosion risk, flammable limits in air 2.2–9%. TLV: 400 ppm in air.

Use: General solvent in coatings and plastics, organic synthesis, smokeless powders, pharmaceuticals, synthetic fruit essences.

ethyl-o-acetate. $\text{CH}_3\text{C}(\text{OC}_2\text{H}_5)_3$.

Properties: Colorless liquid, bp 144–148°C, refr index 1.395 (25°C), insoluble in water, soluble in alcohol and ether, flash p 131°F (55°C). Combustible.

Hazard: Moderate fire risk.

Use: Intermediate.

ethyl acetate, anhydrous. ethyl acetate, grade 99%.

ethyl acetic acid. See butyric acid.

ethyl acetoacetate. (diacetic ester; acetoacetic ester). $\text{CH}_3\text{COCH}_2\text{COOC}_2\text{H}_5$ (keto form), $\text{CH}_3\text{C}(\text{OH})\text{:CHCOOC}_2\text{H}_5$ (enol form). This compound is a tautomer at room temperature consisting of about 93% keto form and 7% enol form.

Properties: Colorless liquid, fruity odor, soluble in water and common organic solvents, d 1.0250 (20/4°C), fp (enol) -80°C; (keto) -39°C, bp 180–181°C, bulk d 8.5 lb/gal, vap press 0.8 mm Hg (20°C), flash p 185°F (85°C) (COC), coefficient of expansion 0.00101/°C. Combustible.

Derivation: Action of metallic sodium on ethyl acetate with subsequent distillation.

Grade: Technical, 98%.

Hazard: Toxic by ingestion and inhalation; irritant to skin and eyes.

Use: Organic synthesis; antipyrine, lacquers, dopes, plastics; manufacture of dyes, pharmaceuticals antimalarials, vitamin B; flavoring.

ethyl acetone. See methyl propyl ketone.

ethyl-n-acetyl- α -cyanoglycine. See ethyl acetamidocyanacetate.

ethylacetylene. (1-butyne). CAS: 107-00-6. $\text{C}_2\text{H}_5\text{C}\equiv\text{CH}$.

Properties: Available as liquefied gas, bp 8.3°C, d 0.669 (0/0°C), fp -130°C, flash p < 20°F (-6.6°C) (TOC), specific volume 7.2 cu ft/lb (21.2°C), insoluble in water.

Hazard: Flammable, dangerous fire risk.

Use: Specialty fuel, chemical intermediate.

ethyl acrylate. CAS: 140-88-5.

$\text{CH}_2\text{:CHCOOC}_2\text{H}_5$.

Properties: Colorless liquid, bp 99.4°C, fp

-72.0°C, d 0.9230 (20/20°C), refr index 1.4037 (25°C), bulk d 7.6 lb/gal (20°C), soluble in alcohol and ether, readily polymerized, flash p 60°F (15.5°C) (OC).

Derivation: (1) Ethylene cyanohydrin, ethyl alcohol, and dilute sulfuric acid; (2) Oxo reaction of acetylene, carbon monoxide, and ethyl alcohol in the presence of nickel or cobalt catalyst.

Grade: Technical (inhibited, usually with hydroquinone or its monomethyl ether), pure uninhibited.

Hazard: Toxic by ingestion, inhalation, skin absorption; irritant to skin and eyes. Flammable, dangerous fire and explosion hazard. TLV: 5 ppm in air; suspected human carcinogen.

Use: Monomer for acrylic resins.

See also acrylate; acrylic resin.

ethyl alcohol. (alcohol; grain alcohol; ethanol; EtOH). CAS: 64-17-5. $\text{C}_2\text{H}_5\text{OH}$.

Properties: (pure 100% absolute alcohol, dehydrated): Colorless, limpid, volatile liquid. Bp 78.3°C, fp -117.3°C, ethereal vinous odor, pungent taste. Miscible with water, methanol, ether, chloroform, and acetone. (95% alcohol): Refr index 1.3651 (15°C), surface tension 22.3 dynes/cm (20°C), viscosity 0.0141 poise (20°C), vap press 43 mm Hg (20°C), specific heat 0.618 cal/g K (23°C), flash p 55°F (12.7°C), d 0.816 (15.56°C), bp 78°C, fp -114°C, autoign temperature 793°F (422°C).

Derivation: (1) From ethylene by direct catalytic hydration or with ethyl sulfate as intermediate; (2) fermentation of biomass, especially agricultural wastes; (3) enzymatic hydrolysis of cellulose (see also cellulase).

Grade: USP (95% by volume), absolute, pure, completely denatured, specially denatured, industrial, various proofs (one-half the proof number is the percentage of alcohol by volume).

Hazard: Is classified as a depressant drug. Though it is rapidly oxidized in the body and is therefore noncumulative, ingestion of even moderate amounts causes lowering of inhibitions, often succeeded by dizziness, headache, or nausea. Larger intake causes loss of motor nerve control, shallow respiration, and in extreme cases unconsciousness and even death. Degree of intoxication is determined by concentration of alcohol in the brain. Of primary importance is the fact that intake of even moderate amounts together with barbiturates or similar drugs is extremely dangerous and may even be fatal. Flammable, dangerous fire risk; flammable limits in air 3.3–19%. TLV: 1000 ppm in air.

Use: Solvent for resins, fats, fatty acids, oils, hydrocarbons; extraction medium; manufacture of acetaldehyde, acetic acid, ethylene, butadiene, 2-ethyl hexanol, dyes, pharmaceuticals, elastomers, detergents, cleaning preparations, surface coatings, cosmetics, explosives; anti-

potassium-2,4-hexadienoate. See potassium sorbate.

potassium hexafluorophosphate. KPF_6 .

Properties: Solid, mp 575C, bp decomposes, soluble in water.

Grade: 98-100%.

Hazard: Toxic by ingestion.

Use: Maintenance of fluoride atmospheres, preparation of bactericides and fungicides, lab reagent.

potassium hexanitrocobaltate III. See cobalt potassium nitrite.

potassium hexyl xanthane. $C_6H_{13}OCSSK$.

Use: Flotation agent.

potassium hydrate. See potassium hydroxide.

potassium hydride. KH. Marketed as a semi-dispersion of gray powder in oil.

Properties: The solid decomposes on heating or in contact with moisture.

Hazard: Dangerous fire and explosion risk, evolves toxic and flammable gases on heating and on exposure to moisture.

Use: Organic condensations and alkylations.

See also hydride.

potassium hydrogen fluoride. See potassium bifluoride.

potassium hydrogen phosphate. See potassium phosphate dibasic.

potassium hydrogen phthalate. (potassium biphthalate). $HOOC C_6H_4 COOK$.

Properties: Colorless crystals, soluble in water, d 1.636.

Derivation: Potassium hydroxide and phthalic anhydride.

Grade: CP, analytical.

Use: Alkalimetric standard, buffering agent.

potassium hydrosulfide. (potassium sulfhydrate; potassium bisulfide). KHS.

Properties: White to yellow crystals, hydrogen sulfide odor. Forms the polysulfide when exposed to air. Hygroscopic, soluble in alcohol and water, d 1.69, mp 455C.

Grade: Technical.

Use: Separation of heavy metals.

potassium hydroxide. (caustic potash; potassium hydrate; lye). CAS: 1310-58-3. KOH.

Properties: White, deliquescent pieces, lumps, sticks, pellets, or flakes having a crystalline fracture. Keep well stoppered, absorbs water and carbon dioxide from the air; soluble in water, al-

cohol, glycerol; slightly soluble in ether; d 2.044; mp 405C (varies with water content).

Derivation: Electrolysis of concentrated potassium chloride solution.

Method of purification: Sulfur compounds are removed by the addition of potassium nitrate to the fused caustic. The purest form is obtained by solution in alcohol, filtration, and evaporation.

Grade: Commercial, ground, flake, fused (88-92%), purified by alcohol (sticks, lumps, and drops), reagent, highest purity, USP, liquid (45%), FCC.

Hazard: Toxic by ingestion and inhalation, strong caustic, handle with gloves or tongs, corrosive to tissue. TLV: ceiling of 2 mg/m³ of air.

Use: Soap manufacture, bleaching, manufacture of potassium carbonate and tetrapotassium pyrophosphate, electrolyte in alkaline storage batteries and some fuel cells, absorbent for carbon dioxide and hydrogen sulfide, dyestuffs, liquid fertilizers, food additive, herbicides, electroplating, mercerizing, paint removers, reagent.

potassium hypophosphite. (potassium hypophosphite, monobasic). CAS: 77-82-87-8. KH_2PO_2 .

Properties: White, opaque crystals or powder with pungent saline taste; very deliquescent. Soluble in water and alcohol, decomposed by heat.

Derivation: Interaction of calcium hypophosphite and potassium carbonate.

Hazard: Moderate fire risk, may explode if ground with chlorates, nitrates, or other strong oxidizing agents.

potassium hyposulfate. See potassium dithionate.

potassium hyposulfite. See potassium thiosulfate.

potassium iodate. CAS: 7758-05-6. KIO_3 .

Properties: White, crystalline powder; odorless. Soluble in water, sulfuric acid (dilute); insoluble in alcohol. D 3.9, mp 560C (partial decomposition).

Grade: Technical, CP, FCC.

Use: Analysis (testing for zinc and arsenic), iodometry, reagent, feed additive, in foods as maturing agent and dough conditioner, medicine (topical antiseptic).

potassium iodide. CAS: 7681-11-0. KI.

Properties: White crystals, granules, or powder; strong, bitter, saline taste; soluble in water, alcohol, acetone, and glycerol; d 3.123; mp 686C; bp 1330C.

Grade: Reagent, USP, single crystals, FCC.

Use: Reagent in analytical chemistry, photographic emulsions (precipitating Ag), feed additive, spectroscopy, infrared transmission, scin-

ATTACHMENT D
HEAT STRESS

HEAT STRESS

1. Heart rate (HR) should be monitored by the radial pulse for 30 seconds as soon as possible in the resting period.

If at the beginning of the rest period a worker's radial pulse is measure and his heart rate exceeds 100 beats per minute, the worker's next work period should be reduced by 33%. Therefore, if the original work period was one hour, the following work cycle should be reduced to 40 minutes.

2. Heat Stroke is a true medical emergency. First aid should be directed toward immediate measures to cool the body quickly, as well as seeing that the victim receives medical attention as soon as possible.

Prior to medical treatment, remove as much clothing as possible and proceed to cool the victim's body, taking care not to over chill the victim once his temperature falls below 102°F. One of the following cooling measures should be taken: (a) sponge the bare skin with cool water; (b) apply cold packs continuously; (c) wrap the victim in a sheet soaked with water; or (d) immerse the victim in a tub of cold water, while closely monitoring the victim's level of consciousness.

3. Prior to site activity, the Site Safety Officer may make arrangements for heat stress monitoring (i.e., monitoring heart rate, body temperature and body water loss) during actual site work if conditions warrant these measures. In addition, the Site Safety Officer would want to ensure that the team members have been acclimatized to the particular environmental conditions and that personnel are aware of the signs and symptoms of heat sickness and have been adequately trained in first aid procedures. As Site Safety Officer, one could also make sure there is sufficient personnel on-site, so as to rotate work assignments, schedule work during hours of reduced temperatures and ensure personnel do not consume alcoholic or caffeinated beverages but rather drink moderate levels of an electrolyte solution and eat well prior to commencing site work.
4. The worker could be experiencing a condition of heat rash. Allow workers to rest and relieve the itching associated with heat rash rather than return to work too soon. Itching

workers may not follow stringent decontamination procedures or scratch where it itches on-site and risk cross contamination.

Keeping the skin clean and dry will reduce the incidence of heat rash. This can be accomplished by wearing cotton garments (or other materials that absorb perspiration) underneath protective clothing. Upon removal of the protective clothing, the worker should wash and dry his skin thoroughly.

5. The sense of thirst is not an adequate regulator of water replacement during heat exposure. Therefore, as a general rule, the amount of water administered should replace the amount of water lost, and it should be administered at regular intervals throughout the day. For every 1/2 pound of water loss, 8 ounces of water should be ingested. Water should be replaced by drinking 2-4 ounce servings during every rest period. A recommended alternative to water is an electrolyte drink split 50/50 with water.
6. Although there is no specific test given during a baseline physical that would identify a person's intolerance to heat, there are physical factors and personal habits which may indicate possible intolerance to heat, such as, whether or not an individual smokes, one's dietary habit, body weight, as well as predisposed physical conditions such as high blood pressure, heavier conditions, diabetes or one's medication, that may influence an individual's ability to tolerate excessive heat.
7. Heat cramps are caused by profuse perspiration with inadequate fluid intake and salt replacement. Heat cramps most often afflict people in good physical condition who overwork in conditions of high temperature and humidity. Heat cramps usually come on suddenly during vigorous activity. Untreated, heat cramps may progress directly to heat exhaustion or heat stroke. First aid treatment: remove victim to a cool place and give sips of salted water (1 teaspoon of salt to 1 quart of water) - 4 ounces every 15 minutes over a period of one hour. A commercial preparation, e.g., Gatorade, may be used if split 50/50 with water.

The salted water or solution should mitigate the cramps. Manual pressure should not be applied to the cramped muscles.

TABLE C-1

REQUIRED FREQUENCY OF HEAT STRESS MONITORING
FOR WORKERS IN IMPERMEABLE CLOTHING

Adjusted ⁽²⁾ Temperature (°F)	Work Time Allowed Before Monitoring Break (min.)
90 or above	15
87.5-90	30
82.5-87.5	60
77.5-82.5	90
72.5-77.5	120

- (1) Adapted from Eastern Research Group and National Institute for Occupational Safety and Health, Occupational Safety and Health Guidance Manual for Super Activities. September 26, 1984, pp. 8-75.
- (2) Calculate the adjusted air temperature (Ta adj) by using this equation:

$$Ta \text{ adj } ^\circ F = Ta \text{ } ^\circ F + (13 \times \% \text{ sunshine})$$

Measure air temperature (Ta) with a standard thermometer, with the bulb shielded from radiant heat. Then estimate percent sunshine (100 percent sunshine = no cloud cover and a sharp, distinct shadow; 0 percent sunshine = no shadows).

TABLE C-2

HEAT STRESS SIGNS AND SYMPTOMS

Heat Stress Indicator	When to Measure	If Exceeds	Action
heart rate (pulse)	beginning of rest period	110 beats per minute	shorten next work period by 33%
oral temperature	beginning of rest period	99 °F (after thermometer is under tongue for 3 minutes) 100.6 °F or greater	shorten next work period by 33% prohibit work in impermeable clothing and shorten next work period by 33%
body weight	1. before workday begins (a.m.) 2. after workday ends (p.m.)	Decreases more than 5%	increase fluid intake

ATTACHMENT E
COLD STRESS

COLD STRESS (Hypothermia)

Cold stress is a function of cold, wetness and wind. A worker's susceptibility to cold stress can vary according to his/her physical fitness, degree of acclimatization to cold weather, age and diet.

Prevention

Institute the following steps to prevent or overexposure of workers to cold:

1. Maintain body core temperature at 96.8° F or above by encouraging workers to drink warm liquids during breaks (preferably not coffee) and wear several layers of clothing. Wool is recommended since it can keep the body warm even when the wool is wet.
2. Avoid frostbite by adequately covering hands, feet and other extremities. Clothing such as insulated gloves or mittens, earmuffs and hat liners should be worn. To prevent contact frostbite (from touching metal and cold surfaces below 20° F) workers should wear anti-contact gloves. Tool handles and control bars should be covered with insulating material.
3. Adjust work schedules if necessary, providing adequate rest periods. When feasible, rotate personnel and perform work during the warmer hours of the day.
4. Provide a heated enclosure for workers close to their work area. Workers should remove their outer layer(s) of clothing while in the shelter to allow for sweat evaporation.
5. In the event that wind barriers are constructed around an intrusive operation (such as drilling), the enclosure must be properly vented to prevent the build-up of toxic or explosive gases or vapors. Care must be taken to keep any heat source away from flammable substances.
6. Using a wind chill chart such as the one in Table D-1, obtain the equivalent chill temperature (ECT) based on actual wind speed and temperature. Refer to the ECT when setting up work warm-up schedules, planning appropriate clothing, etc. Workers should use warming shelters at regular intervals at or below an ECT or 20° F. For exposure skin, continuous exposure should not be permitted at or below an ECT of -35° F.
7. Workers who become immersed in water or whose clothing becomes wet (from perspiration, rain, etc) must immediately be provided a change of dry clothing whenever the air temperature is 25.6° F or below.

8. Maintain an optimal level of worker fitness by encouraging regular exercise, proper diet, etc. If possible, acclimatize workers to site conditions for several days before work begins.

Monitoring

Personnel should be aware of the symptoms of cold stress. If the following symptoms of systemic hypothermia are noticed in any worker, he/she should immediately go the warm shelter:

Heavy, uncontrollable shivering;
Excessive fatigue or drowsiness;
Loss of coordination;
Difficulty in speaking; and,
Frostbite (see below).

Frostbite is the generic term for local injury resulting from cold. The stages of frostbite and their symptoms are as follows:

1. Frostbite or incipient frostbite: sudden blanching or whitening of the skin.
2. Superficial frostbite: waxy or white skin, which is firm to the touch (tissue underneath is still resilient).
3. Deep frostbite: tissues are cold, pale and solid.

TABLE D-1

WINDCHILL CHART

Wind Speed (mph)	Actual thermometer Reading (°F)									
	50	40	30	20	10	0	-10	-20	-30	-40
	Equivalent Temperature (°F)									
Calm	50	40	30	20	10	0	-10	-20	-30	-40
5	48	37	27	16	6	-5	-15	-26	-36	-47
10	40	28	16	4	-9	-21	-33	-46	-58	-70
15	36	22	9	-5	-18	-36	-45	-58	-72	-85
20	32	18	4	-10	-25	-39	-53	-67	-82	-96
25	30	16	0	-15	-29	-44	-59	-74	-88	-104
30	28	13	-2	-18	-33	-48	-63	-79	-94	-109
35	27	11	-4	-20	-35	-49	-67	-82	-98	-113
40	26	10	-6	-21	-37	-53	-69	-85	-100	-116
>40 (Little added effect)	Little Danger (For properly clothed person)				Increasing Danger (Danger from freezing of exposed flesh)			Great Danger		

APPENDIX B

BUILDING 338 PILOT TEST PHOTO LOG (February 19, 2020)

**Building 338 Vapor Mitigation Pilot Test Photographs
February 2020**

Photograph #1



Drilling for monitoring microwell installation.

Photograph #2



Microwell screen and tubing for monitoring point.

Photograph #3



Monitoring point brass fitting assembly.

Photograph #4



Thickness of cored slab in southern end of building.

APPENDIX C

PILOT TEST RESULTS TABLE AND PLOTS (February 19, 2020)


Pilot Test Findings

Pilot Test Point 1														
		Baseline	5 in WC	Δp at 5	10 in WC	Δp at 10	15 in WC	Δp at 15	20 in WC	Δp at 20	30 in WC	Δp at 30	40 in WC	Δp at 40
Flow (cfm)			8	8	17	17	24	24	32	32	57	57	70	70
Test Point	Distance from Extraction Point (ft)													
A	5	0.000	-0.012	0.012	-0.035	0.035	-0.054	0.054	-0.084	0.084	-0.129	0.129	-0.177	0.177
B	10	0.000	-0.001	0.001	-0.002	0.002	-0.006	0.006	-0.006	0.006	-0.010	0.010	-0.014	0.014
C	20	0.000	0.000	0.000	-0.002	0.002	-0.005	0.005	-0.005	0.005	-0.008	0.008	-0.010	0.010
D	30	0.000	0.000	0.000	-0.002	0.002	-0.008	0.008	-0.008	0.008	-0.013	0.013	-0.016	0.016
E	40	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.003	-0.003	0.000	0.000
F	50	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	-0.002	0.002	-0.004	0.004


Pilot Test Point 2						
		Baseline	5 in WC	ΔP at 5	10 in WC	ΔP at 10
Flow (cfm)			32	32	54	54
Test Point	Distance from Extraction Point (ft)					
A	5	0.000	-0.102	0.102	-0.173	0.173
B	10	0.001	-0.020	0.021	-0.036	0.037
C	20	0.000	-0.008	0.008	-0.012	0.012
D	30	0.001	0.000	0.001	0.003	-0.002
E	40	0.000	0.001	-0.001	0.000	0.000
F	50	0.000	0.006	-0.006	0.002	-0.002

[illegible][illegible]


PTP 1 @ 15 in WC

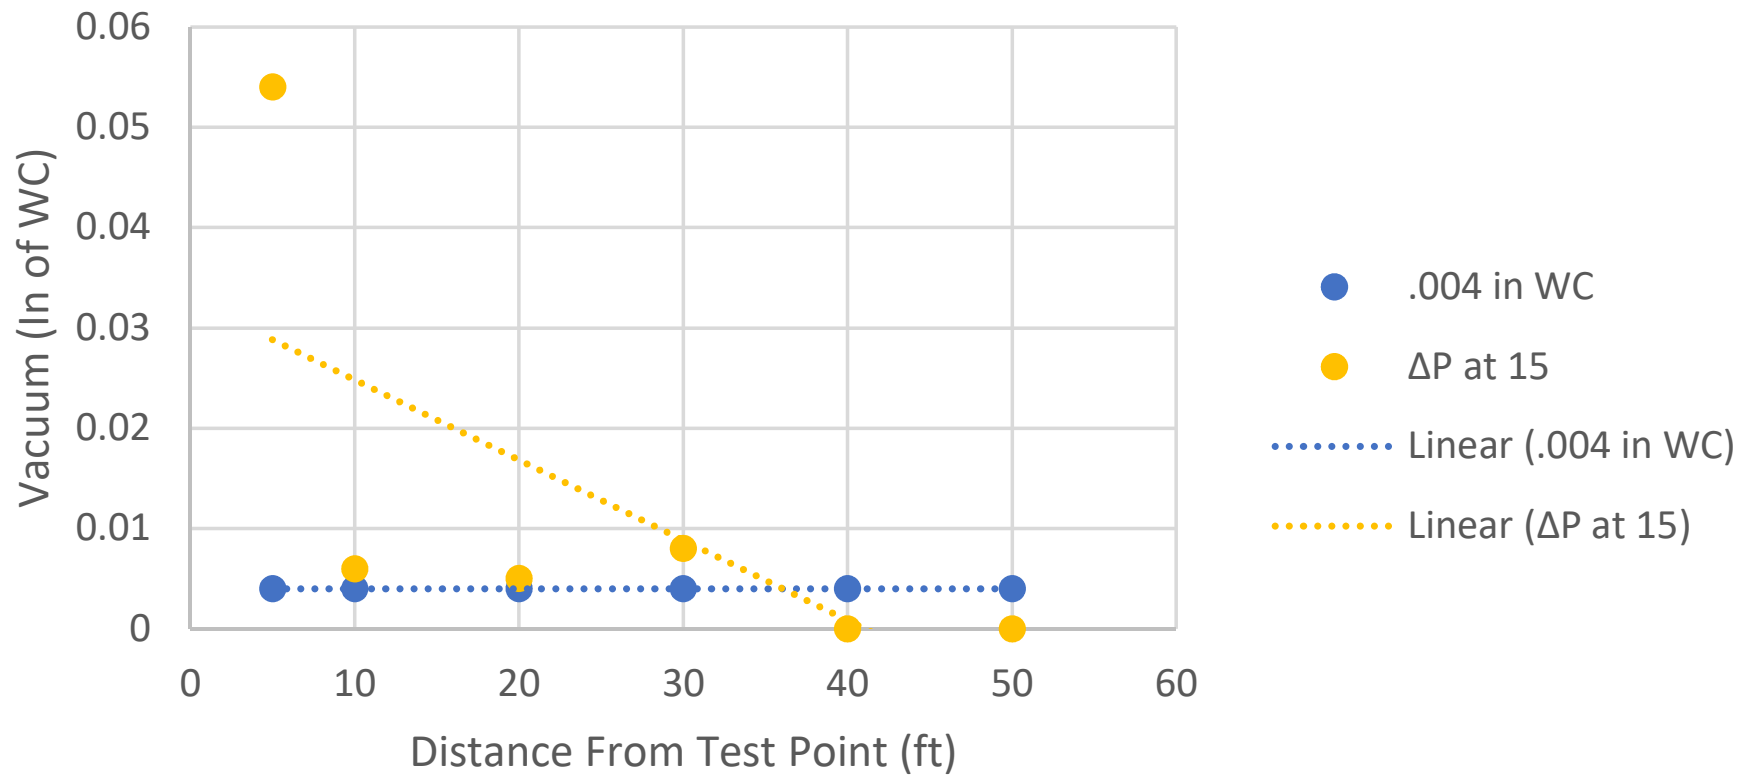


PTP 2 @ 10 in WC

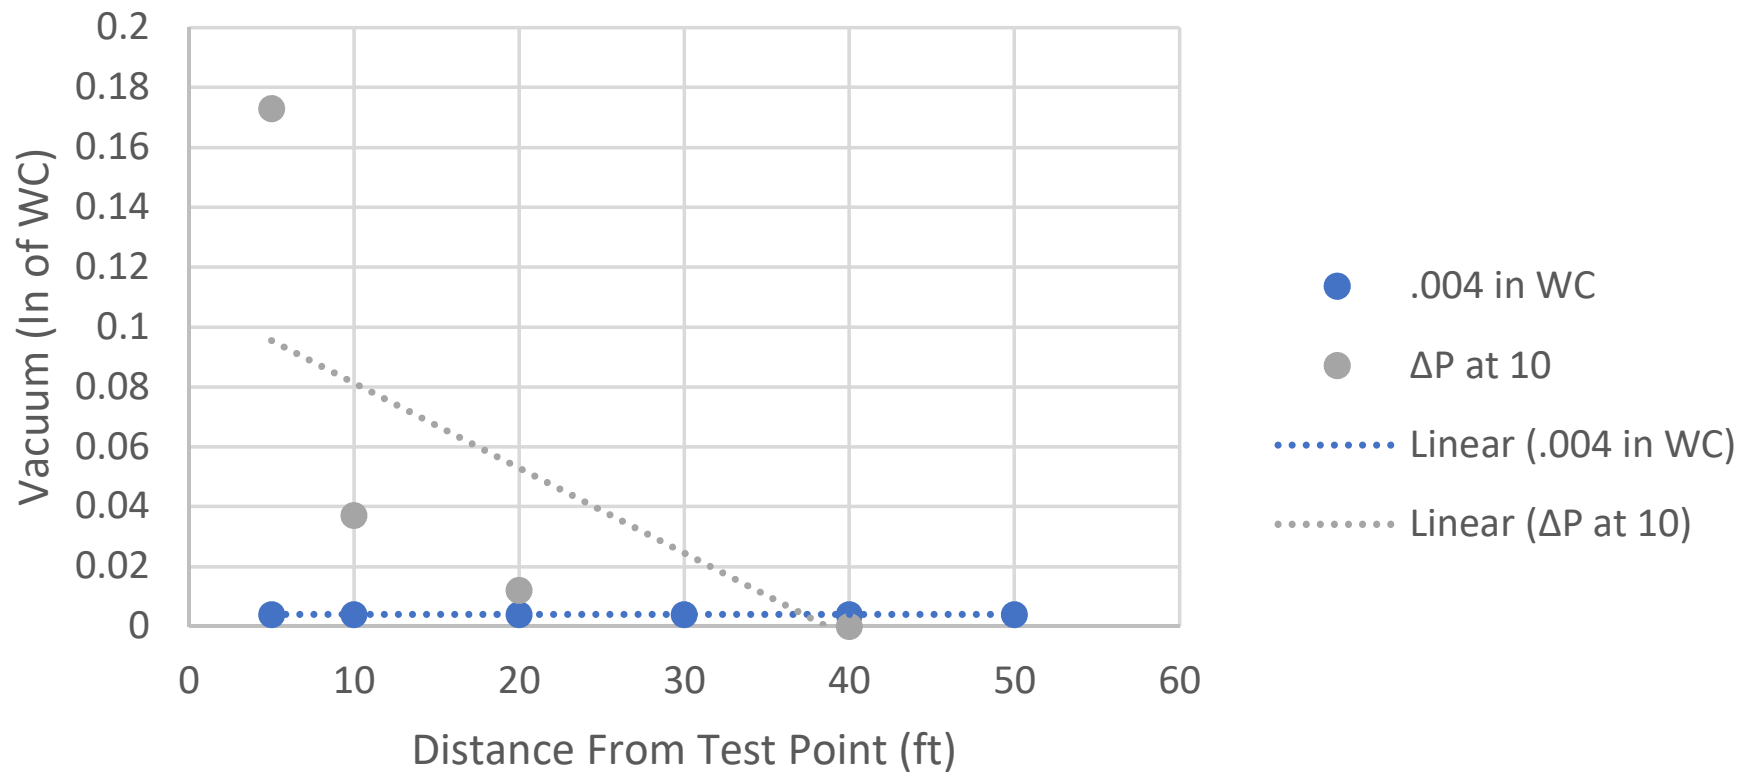

PTP 3 @ 15 in WC

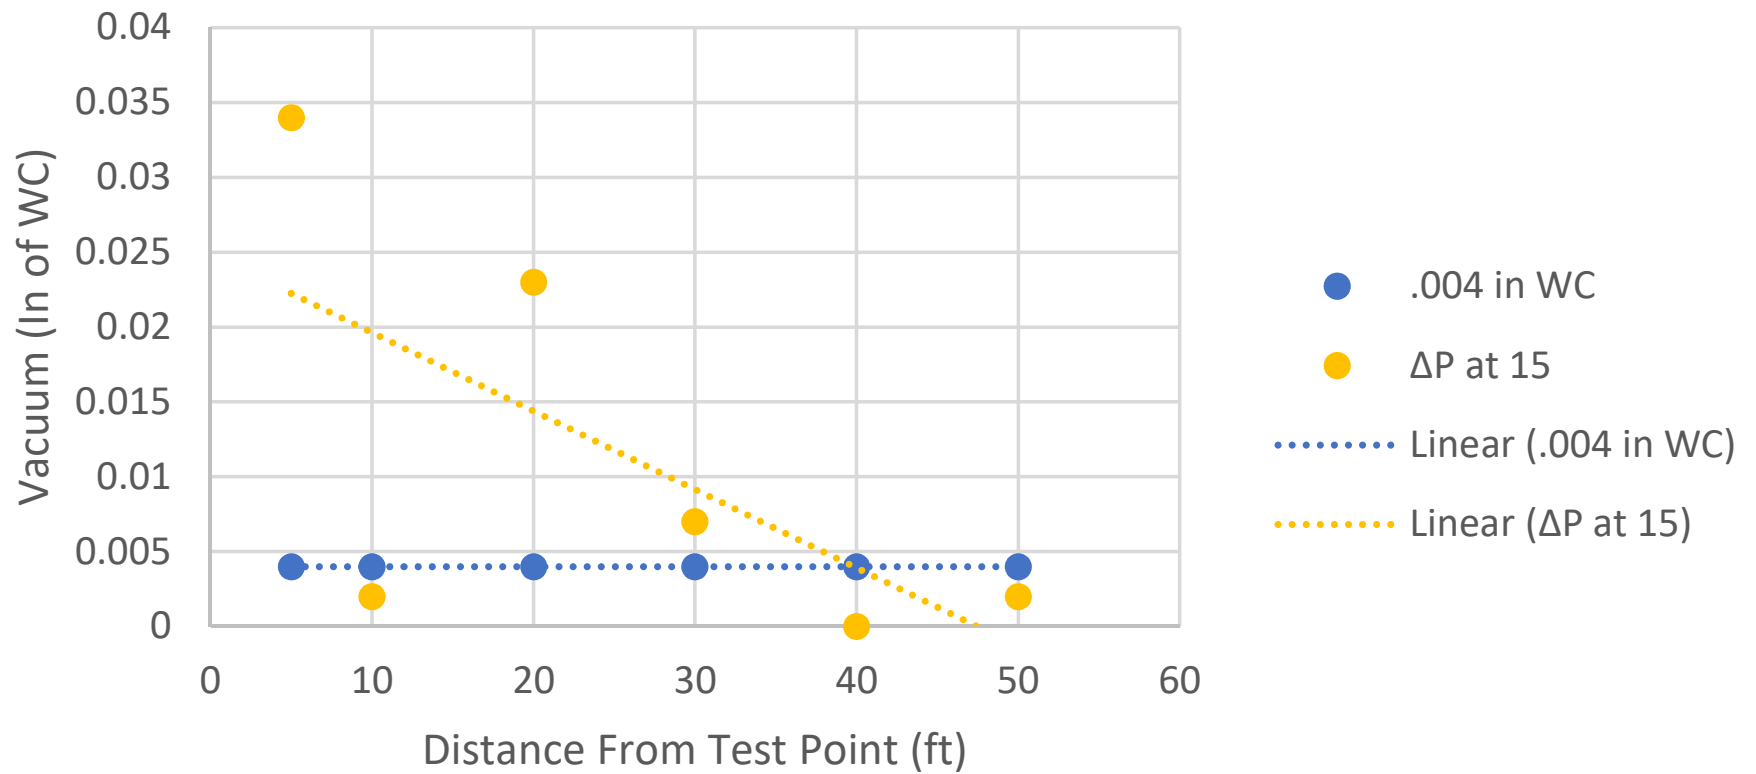


PTP 4 @ 15 in WC

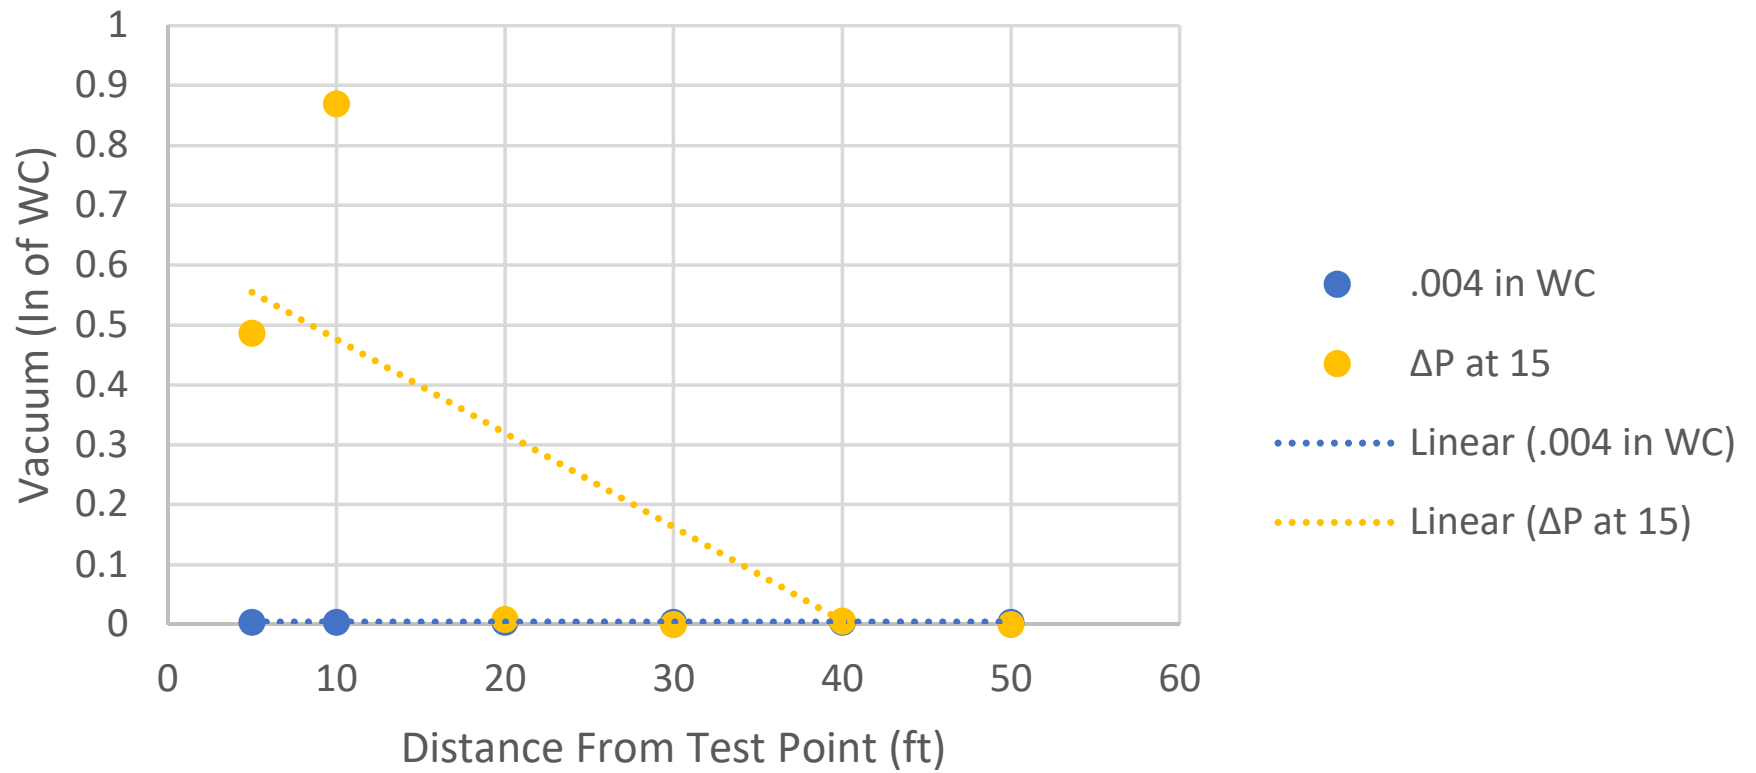

APPENDIX D

RADONAWAY HS5000 CUT SHEET AND ALARM

HS FANS

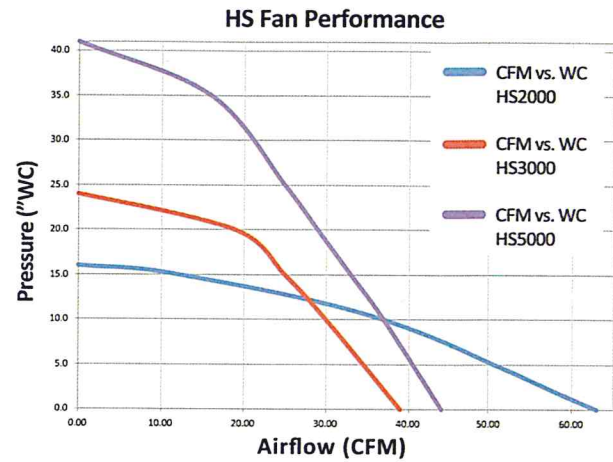

SPECIFICATIONS

MODEL	WATTS	SOUND RATING MID (dBA)	RECOM. MAX. OP. PRESSURE \"WC	TYPICAL CFM vs. STATIC PRESSURE WC					
				0"	10"	15"	20"	25"	35"
HS2000 w/ Cord	153-314	56.2	14	62	40	23	-	-	-
HS3000 w/ Cord	120-250	48.0	21	39	30	25	19	-	-
HS5000 w/ Cord	349-381	55.3	35	43	35	32	28	24	18
HS2000E w/ Switch Box	153-314	56.2	14	62	40	23	-	-	-
HS3000E w/ Switch Box	120-250	48.0	21	39	30	25	19	-	-
HS5000E w/ Switch Box	349-381	55.3	35	43	35	32	28	24	18



Made in the USA with U.S. and imported parts.



RadonAway® inline radon fans are covered by our 1-year, hassle-free warranty.

See p. 22 for fan dimensions.

PRICING

ITEM	P/N	UNIT PRICE	
		1-4	5+
HS2000 w/ Cord	23004-1		
HS3000 w/ Cord	23004-2		
HS5000 w/ Cord	23004-3		
HS2000E w/ Switch Box	23004-4		
HS3000E w/ Switch Box	23004-5		
HS5000E w/ Switch Box	23004-6		
3-YR Warranty	HS3YR		

Quantity discounts determined by number of RadonAway® fans (any model) per order.



Flex Coupling
79010



Magnehelic Gauge
50001-2



Muffler
24002



Minihelic Gauge
50027

FEATURES

- Internal condensate bypass
- Brackets for vertical mounting indoors and outdoors
- Inlet: 3.0" PVC / Outlet: 2.0" PVC
- Weight: 18 lbs.

ITEM	P/N	UNIT PRICE
2" Schedule 40 Vent Muffler	24002	
Magnehelic Manometer 0-50" WC	50001-2	
Minihelic Manometer 0-40" WC	50027	
2 x 2 Flex Coupling (black) ¹	79020	
2 x 3 Flex Coupling (black) ¹	79027	
3 x 3 Flex Coupling (black) ¹	79010	

¹Coupling sizes are for selection only, actual sizes may vary fractionally. See Flexible Coupling Sizing Chart on p. 24. Also available in white.

SYSTEM ALARMS



Checkpoint IIA
28001-2



Checkpoint IIAR (remote)
28001-4



Pressure Switch
73023

PRICING & DESCRIPTIONS

ITEM	P/N	DESCRIPTION	PRICE
Checkpoint IIA Mitigation System Monitor/Alarm	28001-2	Audible alarm; green and red LED lights; factory preset to activate at .25"WC vacuum pressure; low voltage.	
Checkpoint IIAR Mitigation System Monitor with Remote Alarm	28001-4	Provides all the features of the Checkpoint II plus can be wired to a remote location where the homeowner is more likely to hear an alarm (50' of wire included).	
Pressure Switch	73023	Suitable to activate light or alarm for monitoring fan operation; activates at .25"WC; UL/CSA recognized (wire and probe not included).	

Need a more sensitive alarm? 0.10 alarm available. Call for details.

RADONAWAY® RSA-1 ALARM



RadonAway's new vacuum monitoring alarm utilizes piezoresistive pressure sensor (PPS) technology and provides audible and visual indications when the radon system is not moving sufficient air to be effective. It is designed for use on 2", 3", 4" or 6" pipe, or flat surfaces. Some of the RSA-1's additional features are:

- Easy installation
- Battery operated
- Alarm and Service Delay functions
- Hush & Test buttons

RADON GAS DETECTOR



PRICING & DESCRIPTION

ITEM*	P/N	DESCRIPTION	PRICE
Pro Series 3 Radon Gas Detector	28221	Numeric LED indicator, .1-999.9 pCi/L; displays updates hourly; daily self-test of electronics and sensor.	

*Not approved for radon testing.



INSTALLATION & OPERATING INSTRUCTIONS
Instruction P/N IN015 Rev E
FOR CHECKPOINT IIa™ P/N 28001-2 & 28001-3
RADON SYSTEM ALARM

INSTALLATION INSTRUCTIONS
(WALL MOUNTING)

Select a suitable wall location near a vertical section of the suction pipe. The unit should be mounted about four or five feet above the floor and as close to the suction pipe as possible. Keep in mind that with the plug-in transformer provided, the unit must also be within six feet of a 120V receptacle. **NOTE: The Checkpoint IIa is calibrated for vertical mounting, horizontal mounting will affect switchpoint calibration.**

Drill two ¼" holes 4" apart horizontally where the unit is to be mounted.


Install the two ¼" wall anchors provided.

Hang the CHECKPOINT IIa from the two mounting holes located on the mounting bracket. Tighten the mounting screws so the unit fits snugly and securely against the wall.

Drill a 5/16" hole into the side of the vent pipe about 6" higher than the top of the unit.

Insert the vinyl tubing provided about 1" inside the suction pipe.

Cut a suitable length of vinyl tubing and attach it to the pressure switch connector on the CHECKPOINT IIa.

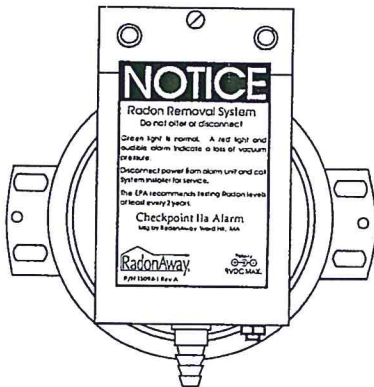

CALIBRATION AND OPERATION.

The CHECKPOINT IIa units are calibrated and sealed at the factory to alarm when the vacuum pressure falls below the factory setting and should not normally require field calibration. Factory Settings are:

28001-2 -.25" WC Vacuum

28001-3 -.10" WC Vacuum

To Verify Operation:

With the exhaust fan off or the pressure tubing disconnected and the CHECKPOINT IIa plugged in, both the red indicator light and the audible alarm should be on.

Turn the fan system on or connect the pressure tubing to the fan piping. The red light and the audible alarm should go off. The green light should come on.

Now turn the fan off. The red light and audible alarm should come on in about two or three seconds and the green light should go out.

WARRANTY INFORMATION

Subject to applicable consumer protection legislation, RadonAway warrants that the CHECKPOINT IIa will be free from defective material and workmanship for a period of (1) year from the date of purchase. Warranty is contingent on installation in accordance with the instructions provided. This warranty does not apply where repairs or alterations have been made or attempted by others; or the unit has been abused or misused. Warranty does not include damage in shipment unless the damage is due to the negligence of RadonAway. All other warranties, expressed or written, are not valid. To make a claim under these limited warranties, you must return the defective item to RadonAway with a copy of the purchase receipt. RadonAway is not responsible for installation or removal cost associated with this warranty. In no case is RadonAway liable beyond the repair or replacement of the defective product FOB RadonAway.

THERE ARE NO WARRANTIES WHICH EXTEND BEYOND THE DESCRIPTION ON THE FACE HEREOF. THERE IS NO WARRANTY OF MERCHANTABILITY. ALL OTHER WARRANTIES, EXPRESSED OR WRITTEN, ARE NOT VALID.

For service under these warranties, contact RadonAway for a Return Material Authorization (RMA) number and shipping information. **No returns can be accepted without an RMA.** If factory return is required, the customer assumes all shipping costs to and from factory.

Manufactured by:
RadonAway
Ward Hill, MA
(978)-521-3703

HS Series



Radon Mitigation Fan

HS fans offer a proven solution for tough radon mitigation jobs, providing up to 25 times the suction of inline tube fans to deal with sand, tight soil or clay sub-slab material.

Features

- Internal condensate bypass
- Brackets for vertical mounting indoors and outdoors
- Inlet: 3.0" PVC / Outlet: 2.0" PVC
- Weight: 18 lbs.
- Size: 15.5"W x 13.3"H x 8.2"D
- Warranty: 1 year (3-year option available)

MODEL	WATTS	SOUND RATING (dBA)			RECOM. MAX. OP. PRESSURE "WC	TYPICAL CFM* vs. STATIC PRESSURE WC					
		OPEN	1/2	CLOSED		0"	10"	15"	20"	25"	35"
HS2000 with cord	174-307	56.5	56.2	51.9	14	63	37	12	-	-	-
HS3000 with cord	120-250	47.9	48.0	46.2	21	39	30	25	19	-	-
HS5000 with cord	223-385	56.0	55.3	53.1	35	44	37	33	29	25	16
HS2000E with switch box	174-307	56.5	56.2	51.9	14	63	37	12	-	-	-
HS3000E with switch box	120-250	47.9	48.0	46.2	21	39	30	25	19	-	-
HS5000E with switch box	223-385	56.0	55.3	53.1	35	44	37	33	29	25	16



* Made in the USA with U.S. and imported parts.

* CFM measured through suction.

For Further Information, Contact Your Radon Professional: