




11000 N. MoPac Expressway, Suite 500
Austin, Texas 78759
Phone: (512) 451-6334
Fax: (512) 459-1459

Date Printed and Mailed: 5/26/2026

DEC-SCHENECTADY
REGION 4
1130 NORTH WESTCOTT ROAD
SCHENECTADY, NY 12306

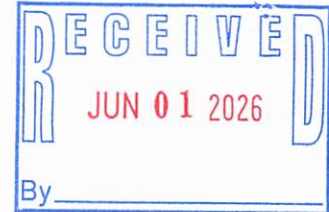

Test Date: 5/19/2026
Order Number: 8617717

Dear Regulator,

Enclosed are the results of recent testing performed at the following facility:

BJ's Wholesale #7
1440 Central Ave.
PBS# 4-600700
Albany, NY 12205

Testing conducted in accordance with paragraph 613-2.3(d)(2) of NYCRR. Technician is a certified Vacutect tank tester and/or a certified TLD-1 line tester in accordance with company protocol. Technician address on file at Tanknology corporate office: 11000 N. MoPac Expressway, Suite 500, Austin, TX 78759

Testing performed:
IMPACT VALVE
LEAK DETECTOR
MONITOR CERTIFICATION

Sincerely,

A handwritten signature in black ink that reads 'Dawn Kohlmeier'.

Dawn Kohlmeier
Manager, Field Reporting



LDT 5000 Field Test Apparatus
Line Leak Detector Test

Work Order: 8617717 Date: 5/19/2026
 Site Name / ID: BJ's Wholesale #7 / 007
 Address: 1440 Central Ave. PBS# 4-600700
 City: Albany State: NY Zip: 12205

Tank ID	1 RUL NYDEC 001	2 PUL NYDEC 002B			
Product	RUL	PREMIUM			
Product Line	1	1			
Tested From	10	10			
Existing/New	Existing	Existing			
Mechanical/Electronic	Electronic	Electronic			
Manufacturer/Model	Veeder Root PLLD	Veeder Root PLLD			
Serial No.					
Pump Operating Pressure (psi)	30.00	30.00			
Calibrated Leak (ml/min)	189.0	189.0			
Calibrated Leak (gph)	3.00	3.00			
Holding PSI *N/A for Electronic LD's					
Resiliency (ml) *N/A for Electronic LD's					
Metering PSI *N/A for Electronic LD's					
Opening Time (sec) *N/A for Electronic LD's					
Test Results	Pass	Pass			

Technician Comments:

Technician Name: Jeffrey Claeys Certification #: 133137
 Technician Signature: Expire Date: 6/18/2026



Impact Valve Inspection


Impact Valve Operational Inspection

Work Order: 8617717 Date: 5/19/2026
 Site Name/ID: BJ's Wholesale #7
 Address: 1440 Central Ave. PBS# 4-600700
 City: Albany State: NY Zip: 12205

How Inspected: Line Test NFPA 30A PEI RP1200 Other

Dispenser Number	Grade	Secure Mount?	Valve Lock?	Pass/ Fail	Comments
1/2	87	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/> Pass <input type="checkbox"/> Fail <input type="checkbox"/> Not Tested	
1/2	93	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/> Pass <input type="checkbox"/> Fail <input type="checkbox"/> Not Tested	
3/4	87	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/> Pass <input type="checkbox"/> Fail <input type="checkbox"/> Not Tested	
3/4	93	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/> Pass <input type="checkbox"/> Fail <input type="checkbox"/> Not Tested	
5/6	87	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/> Pass <input type="checkbox"/> Fail <input type="checkbox"/> Not Tested	
5/6	93	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/> Pass <input type="checkbox"/> Fail <input type="checkbox"/> Not Tested	
7/8	87	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/> Pass <input type="checkbox"/> Fail <input type="checkbox"/> Not Tested	
7/8	93	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/> Pass <input type="checkbox"/> Fail <input type="checkbox"/> Not Tested	
9/10	87	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/> Pass <input type="checkbox"/> Fail <input type="checkbox"/> Not Tested	
9/10	93	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/> Pass <input type="checkbox"/> Fail <input type="checkbox"/> Not Tested	
11/12	87	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/> Pass <input type="checkbox"/> Fail <input type="checkbox"/> Not Tested	
11/12	93	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/> Pass <input type="checkbox"/> Fail <input type="checkbox"/> Not Tested	

Technician Comments:

Technician Name: Jeffrey Claey
 Signature: 

MONITORING SYSTEM CERTIFICATION

This form is used to document testing and servicing of tank and piping leak monitoring equipment. If required by applicable law, a copy of the completed form must be provided by the Testing Contractor or owner to the governing UST agency as required by regulation.

A. General Information


Facility Name: BJ's Wholesale #7 Bldg. No.: _____
 Site Address: 1440 Central Ave. PBS# 4-600700 City: Albany State: NY Zip: 12205
 Facility Contact Person: _____ Contact Phone No.: -
 Make/Model of Monitoring System: Veeder Root TLS-350 Date of Testing/Servicing: 5/19/2026

B. Inventory of Equipment Tested/Certified Check the appropriate boxes to indicate specific equipment inspected/serviced:

<p>Tank ID: <u>1 RUL NYDEC 001 - RUL</u></p> <p><input checked="" type="checkbox"/> In-Tank Gauging Probe. Model: <u>846390-109</u></p> <p><input checked="" type="checkbox"/> Annular Space or Vault Sensor. Model: <u>794380-303</u></p> <p><input checked="" type="checkbox"/> Piping Sump / Trench Sensor(s). Model: <u>794380-208</u></p> <p><input type="checkbox"/> Fill Sump Sensor(s). Model: _____</p> <p><input type="checkbox"/> Mechanical Line Leak Detector. Model: _____</p> <p><input checked="" type="checkbox"/> Electronic Line Leak Detector. Model: <u>Veeder Root PLLD -</u></p> <p><input type="checkbox"/> Tank Overfill / High-Level Sensor. Model: _____</p> <p><input type="checkbox"/> Other (specify equipment type and model in Section E on Page 2).</p>	<p>Tank ID: <u>2 PUL NYDEC 002B - PREMIUM</u></p> <p><input checked="" type="checkbox"/> In-Tank Gauging Probe. Model: <u>846390-109</u></p> <p><input checked="" type="checkbox"/> Annular Space or Vault Sensor. Model: <u>794380-303</u></p> <p><input checked="" type="checkbox"/> Piping Sump / Trench Sensor(s). Model: <u>794380-208</u></p> <p><input type="checkbox"/> Fill Sump Sensor(s). Model: _____</p> <p><input type="checkbox"/> Mechanical Line Leak Detector. Model: _____</p> <p><input checked="" type="checkbox"/> Electronic Line Leak Detector. Model: <u>Veeder Root PLLD -</u></p> <p><input type="checkbox"/> Tank Overfill / High-Level Sensor. Model: _____</p> <p><input type="checkbox"/> Other (specify equipment type and model in Section E on Page 2).</p>
<p>Tank ID: <u>3 RUL NYDEC 002A - RUL 2</u></p> <p><input checked="" type="checkbox"/> In-Tank Gauging Probe. Model: <u>846390-109</u></p> <p><input checked="" type="checkbox"/> Annular Space or Vault Sensor. Model: <u>794380-303</u></p> <p><input checked="" type="checkbox"/> Piping Sump / Trench Sensor(s). Model: <u>794380-208</u></p> <p><input type="checkbox"/> Fill Sump Sensor(s). Model: _____</p> <p><input type="checkbox"/> Mechanical Line Leak Detector. Model: _____</p> <p><input type="checkbox"/> Electronic Line Leak Detector. Model: _____</p> <p><input type="checkbox"/> Tank Overfill / High-Level Sensor. Model: _____</p> <p><input type="checkbox"/> Other (specify equipment type and model in Section E on Page 2).</p>	<p>Tank ID: _____</p> <p><input type="checkbox"/> In-Tank Gauging Probe. Model: _____</p> <p><input type="checkbox"/> Annular Space or Vault Sensor. Model: _____</p> <p><input type="checkbox"/> Piping Sump / Trench Sensor(s). Model: _____</p> <p><input type="checkbox"/> Fill Sump Sensor(s). Model: _____</p> <p><input type="checkbox"/> Mechanical Line Leak Detector. Model: _____</p> <p><input type="checkbox"/> Electronic Line Leak Detector. Model: _____</p> <p><input type="checkbox"/> Tank Overfill / High-Level Sensor. Model: _____</p> <p><input type="checkbox"/> Other (specify equipment type and model in Section E on Page 2).</p>
<p>Dispenser ID: <u>1/2</u></p> <p><input checked="" type="checkbox"/> Dispenser Containment Sensor(s). Model: <u>794380-208</u></p> <p><input checked="" type="checkbox"/> Shear Valve(s).</p> <p><input type="checkbox"/> Dispenser Containment Float(s) and Chain(s).</p>	<p>Dispenser ID: <u>3/4</u></p> <p><input checked="" type="checkbox"/> Dispenser Containment Sensor(s). Model: <u>794380-208</u></p> <p><input checked="" type="checkbox"/> Shear Valve(s).</p> <p><input type="checkbox"/> Dispenser Containment Float(s) and Chain(s).</p>
<p>Dispenser ID: <u>5/6</u></p> <p><input checked="" type="checkbox"/> Dispenser Containment Sensor(s). Model: <u>794380-208</u></p> <p><input checked="" type="checkbox"/> Shear Valve(s).</p> <p><input type="checkbox"/> Dispenser Containment Float(s) and Chain(s).</p>	<p>Dispenser ID: <u>7/8</u></p> <p><input checked="" type="checkbox"/> Dispenser Containment Sensor(s). Model: <u>794380-208</u></p> <p><input checked="" type="checkbox"/> Shear Valve(s).</p> <p><input type="checkbox"/> Dispenser Containment Float(s) and Chain(s).</p>
<p>Dispenser ID: <u>9/10</u></p> <p><input checked="" type="checkbox"/> Dispenser Containment Sensor(s). Model: <u>794380-208</u></p> <p><input checked="" type="checkbox"/> Shear Valve(s).</p> <p><input type="checkbox"/> Dispenser Containment Float(s) and Chain(s).</p>	<p>Dispenser ID: <u>11/12</u></p> <p><input checked="" type="checkbox"/> Dispenser Containment Sensor(s). Model: <u>794380-208</u></p> <p><input checked="" type="checkbox"/> Shear Valve(s).</p> <p><input type="checkbox"/> Dispenser Containment Float(s) and Chain(s).</p>

*If the facility contains more tanks or dispensers, copy this form. Include information for every tank and dispenser at the facility.

C. Certification - I certify that the equipment identified in this document was inspected/serviced in accordance with the manufacturers' guidelines. Attached to this Certification is a Plot Plan showing the layout of monitoring equipment. For any equipment capable of generating such reports, I have also attached a copy of the report; (check all that apply): System set-up Alarm history report

Technician Name (print): Jeffrey Claeys Signature: 

Certification No.: B48818 License No.: _____

Testing Company Name: Tanknology Phone No.: (800) 800-4633

Testing Company Address: 11000 N. MoPac Expressway Suite 500 Date of Testing/Servicing: 5/19/2026

D. Results of Testing/Serviceing

Software Version Installed: 119.05

Complete the following checklist:

<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No* <input type="checkbox"/> N/A	Is the visual alarm on the console operational?
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No* <input type="checkbox"/> N/A	Is the audible alarm on the console operational?
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	Is the external visual overfill alarm (light unit) present?
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No* <input type="checkbox"/> N/A	Is the external visual overfill alarm operating properly?
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	Is the external audible overfill alarm present?
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No* <input type="checkbox"/> N/A	Is the external audible overfill alarm operating properly?
90 %	<input type="checkbox"/> N/A	At what percent of tank(s) capacity is the external alarm programmed to trigger? <i>If different % between tanks, clarify in section E.</i>
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No* <input type="checkbox"/> N/A	Were all sensors visually inspected, functionally tested, and confirmed operational?
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No* <input type="checkbox"/> N/A	Were all sensors installed at lowest point of secondary containment and positioned so that other equipment will not interfere with their proper operation?
<input type="checkbox"/> Yes	<input type="checkbox"/> No* <input checked="" type="checkbox"/> N/A	For pressurized piping systems, does the turbine automatically shut down if the piping secondary containment monitoring system detects a leak, fails to operate, or is electrically disconnected? If yes: which sensors initiate positive shut-down? <i>(Check all that apply)</i> <input type="checkbox"/> Sump/Trench Sensors; <input type="checkbox"/> Dispenser Containment Sensors. Did you confirm positive shut-down due to leaks <u>and</u> sensor failure/disconnection? <input type="checkbox"/> Yes; <input type="checkbox"/> No
<input type="checkbox"/> Yes*	<input checked="" type="checkbox"/> No	Was any monitoring equipment replaced? If yes, identify specific sensors, probes, or other equipment replaced and list the manufacturer name and model for all replacement parts in Section E, below.
<input type="checkbox"/> Yes*	<input checked="" type="checkbox"/> No	Was liquid found inside any secondary containment systems designed as dry systems? <i>(Check all that apply)</i> <input type="checkbox"/> Product; <input type="checkbox"/> Water. If yes, describe causes in Section E, below.
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No*	Was monitoring system set-up reviewed to ensure proper settings? Attach set up reports, if applicable
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No*	Is all monitoring equipment operational per manufacturer's specifications?

* In Section E below, describe how and when these deficiencies were or will be corrected.

E. Comments:

Backup Battery reading, if applicable (Required for VR TLS 300/350):3.66v

F. In-Tank Gauging / SIR Equipment:

- Check this box if tank gauging is used only for inventory control.
- Check this box if no tank gauging or SIR equipment is installed.

This section must be completed if in-tank gauging equipment is used to perform leak detection monitoring.

Complete the following checklist:

<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No*	Were all tank gauging probes visually inspected for damage and residue buildup?
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No*	Was accuracy of system product level readings tested?
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No*	Was accuracy of system water level readings tested?
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No*	Were all probes reinstalled properly?
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No*	Were all items on the equipment manufacturer's maintenance checklist completed?

* In the Section G, below, describe how and when these deficiencies were or will be corrected.

G. Comments:

DID OVERALL MONITOR SYSTEM TESTING PASS (Check One)? YES NO
INCONCLUSIVE





Site Diagram


(This site diagram is for reference only and is not drawn to scale)

Work Order: 8617717
Site ID / Name: 007 / BJ's Wholesale #7
Address: 1440 Central Ave. PBS# 4-600700
City: Albany

State: NY

Zip: 12205

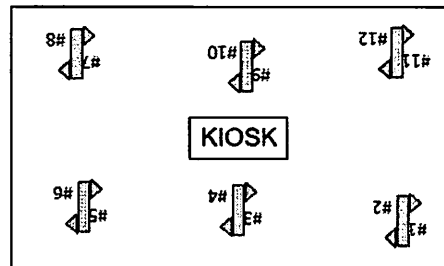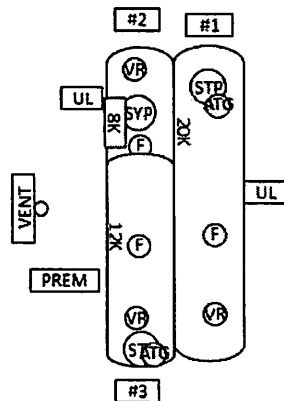

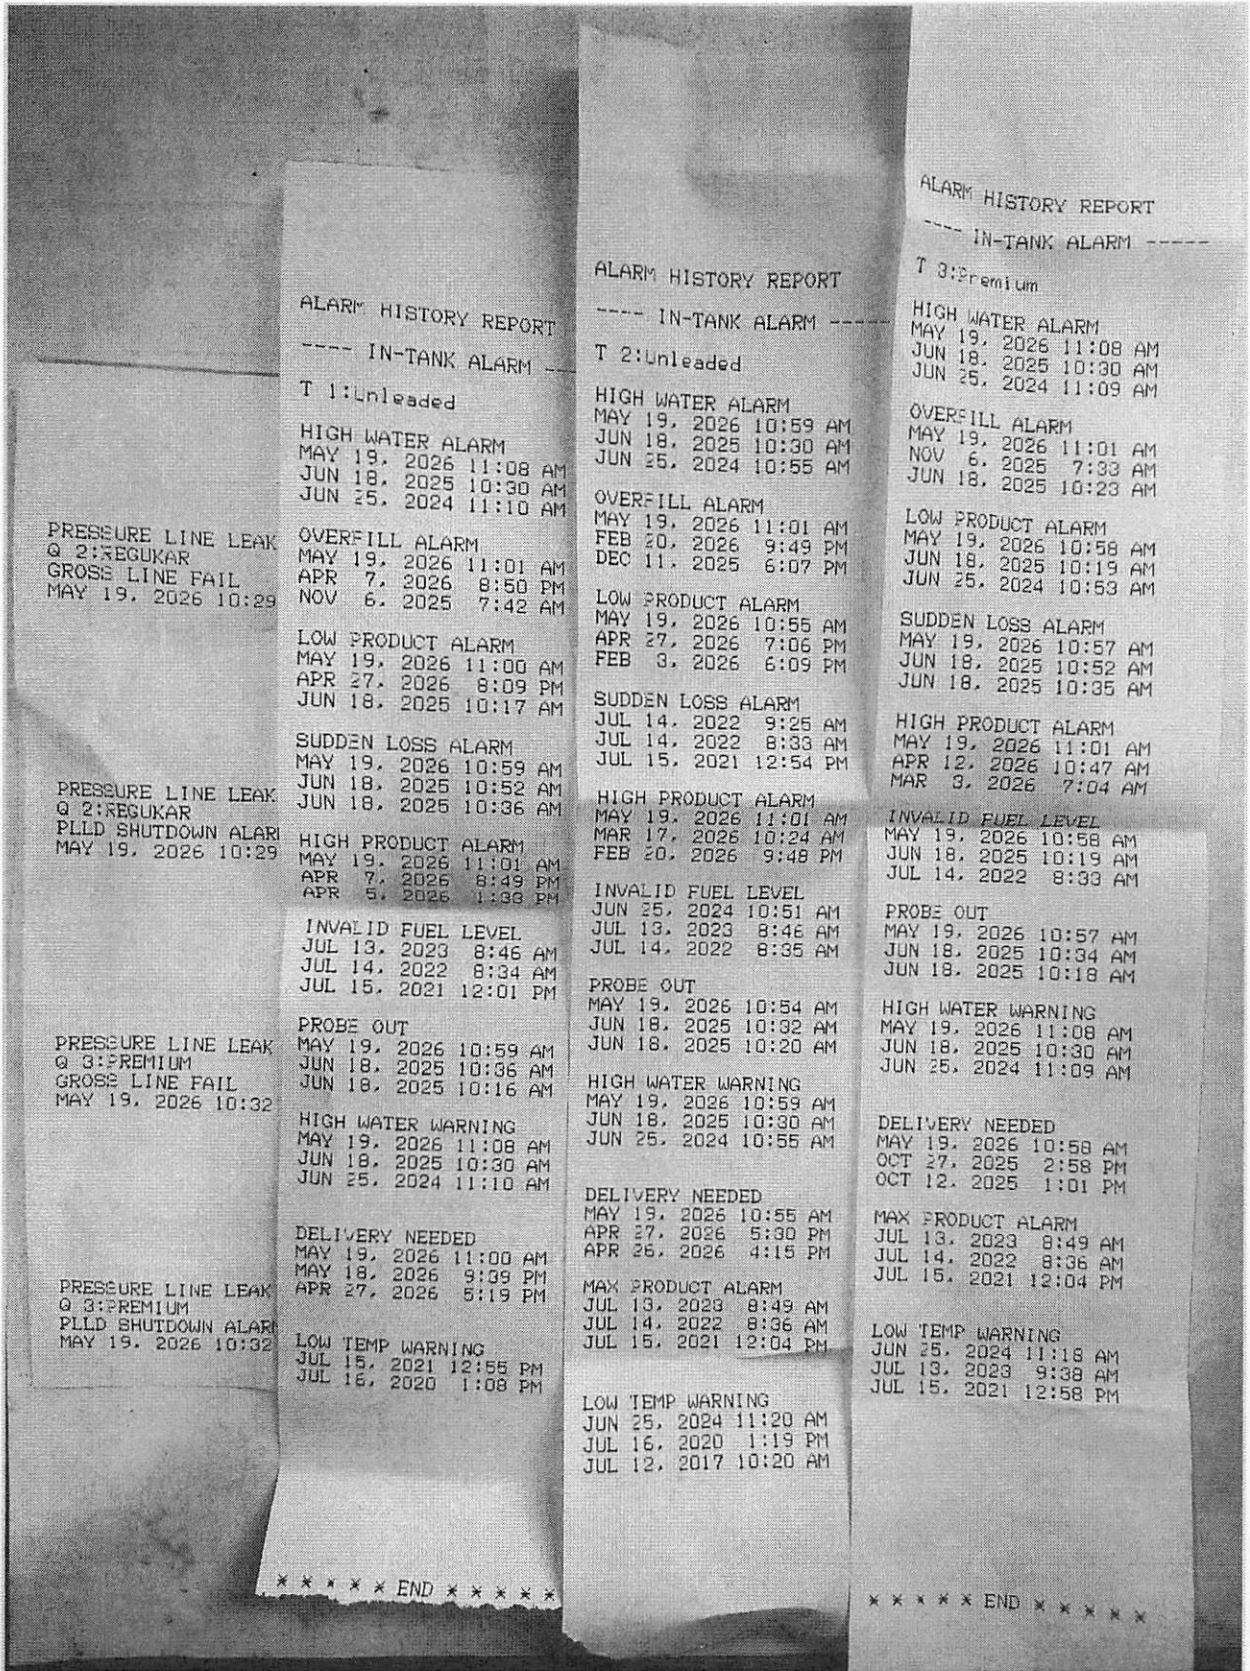

ALARM HISTORY REPORT

IN-TANK ALARM

T 3:Premium

HIGH WATER ALARM
MAY 19, 2026 11:08 AM
JUN 18, 2025 10:30 AM
JUN 25, 2024 11:09 AM

OVERFILL ALARM
MAY 19, 2026 11:01 AM
NOV 6, 2025 7:33 AM
JUN 18, 2025 10:23 AM

LOW PRODUCT ALARM
MAY 19, 2026 10:58 AM
JUN 18, 2025 10:19 AM
JUN 25, 2024 10:53 AM

SUDDEN LOSS ALARM
MAY 19, 2026 10:57 AM
JUN 18, 2025 10:52 AM
JUN 18, 2025 10:35 AM

HIGH PRODUCT ALARM
MAY 19, 2026 11:01 AM
APR 12, 2026 10:47 AM
MAR 3, 2026 7:04 AM

INVALID FUEL LEVEL
MAY 19, 2026 10:58 AM
JUN 18, 2025 10:19 AM
JUL 14, 2022 8:33 AM

PROBE OUT
MAY 19, 2026 10:57 AM
JUN 18, 2025 10:34 AM
JUN 18, 2025 10:18 AM

HIGH WATER WARNING
MAY 19, 2026 11:08 AM
JUN 18, 2025 10:30 AM
JUN 25, 2024 11:09 AM

DELIVERY NEEDED
MAY 19, 2026 10:58 AM
OCT 27, 2025 2:58 PM
OCT 12, 2025 1:01 PM

MAX PRODUCT ALARM
JUL 13, 2023 8:49 AM
JUL 14, 2022 8:36 AM
JUL 15, 2021 12:04 PM

LOW TEMP WARNING
JUN 25, 2024 11:18 AM
JUL 13, 2023 9:38 AM
JUL 15, 2021 12:58 PM

ALARM HISTORY REPORT

IN-TANK ALARM

T 2:Unleaded

HIGH WATER ALARM
MAY 19, 2026 10:59 AM
JUN 18, 2025 10:30 AM
JUN 25, 2024 10:55 AM

OVERFILL ALARM
MAY 19, 2026 11:01 AM
FEB 20, 2026 9:49 PM
DEC 11, 2025 6:07 PM

LOW PRODUCT ALARM
MAY 19, 2026 10:55 AM
APR 27, 2026 7:06 PM
FEB 3, 2026 6:09 PM

SUDDEN LOSS ALARM
JUL 14, 2022 9:25 AM
JUL 14, 2022 8:33 AM
JUL 15, 2021 12:54 PM

HIGH PRODUCT ALARM
MAY 19, 2026 11:01 AM
MAR 17, 2026 10:24 AM
FEB 20, 2026 9:48 PM

INVALID FUEL LEVEL
JUN 25, 2024 10:51 AM
JUL 13, 2023 8:46 AM
JUL 14, 2022 8:35 AM

PROBE OUT
MAY 19, 2026 10:54 AM
JUN 18, 2025 10:32 AM
JUN 18, 2025 10:20 AM

HIGH WATER WARNING
MAY 19, 2026 10:59 AM
JUN 18, 2025 10:30 AM
JUN 25, 2024 10:55 AM

DELIVERY NEEDED
MAY 19, 2026 10:55 AM
APR 27, 2026 5:30 PM
APR 26, 2026 4:15 PM

MAX PRODUCT ALARM
JUL 13, 2023 8:49 AM
JUL 14, 2022 8:36 AM
JUL 15, 2021 12:04 PM

LOW TEMP WARNING
JUN 25, 2024 11:20 AM
JUL 16, 2020 1:19 PM
JUL 12, 2017 10:20 AM

ALARM HISTORY REPORT

IN-TANK ALARM

T 1:Unleaded

HIGH WATER ALARM
MAY 19, 2026 11:08 AM
JUN 18, 2025 10:30 AM
JUN 25, 2024 11:10 AM

OVERFILL ALARM
MAY 19, 2026 11:01 AM
APR 7, 2026 8:50 PM
NOV 6, 2025 7:42 AM

LOW PRODUCT ALARM
MAY 19, 2026 11:00 AM
APR 27, 2026 8:09 PM
JUN 18, 2025 10:17 AM

SUDDEN LOSS ALARM
MAY 19, 2026 10:59 AM
JUN 18, 2025 10:52 AM
JUN 18, 2025 10:36 AM

HIGH PRODUCT ALARM
MAY 19, 2026 11:01 AM
APR 7, 2026 8:49 PM
APR 5, 2026 1:36 PM

INVALID FUEL LEVEL
JUL 13, 2023 8:46 AM
JUL 14, 2022 8:34 AM
JUL 15, 2021 12:01 PM

PROBE OUT
MAY 19, 2026 10:59 AM
JUN 18, 2025 10:36 AM
JUN 18, 2025 10:16 AM

HIGH WATER WARNING
MAY 19, 2026 11:08 AM
JUN 18, 2025 10:30 AM
JUN 25, 2024 11:10 AM

DELIVERY NEEDED
MAY 19, 2026 11:00 AM
MAY 18, 2026 9:39 PM
APR 27, 2026 5:19 PM

LOW TEMP WARNING
JUL 15, 2021 12:55 PM
JUL 16, 2020 1:08 PM

PRESSURE LINE LEAK Q 2:REGUKAR GROSS LINE FAIL MAY 19, 2026 10:29

PRESSURE LINE LEAK Q 2:REGUKAR PLLD SHUTDOWN ALARM MAY 19, 2026 10:29

PRESSURE LINE LEAK Q 3:PREMIUM GROSS LINE FAIL MAY 19, 2026 10:32

PRESSURE LINE LEAK Q 3:PREMIUM PLLD SHUTDOWN ALARM MAY 19, 2026 10:32

***** END *****

***** END *****

ALARM HISTORY REPORT

----- SENSOR ALARM -----
L 1:DISP 1-2
DISPENSER PAN
FUEL ALARM
MAY 19, 2026 10:41 AM

FUEL ALARM
JUN 18, 2025 9:49 AM

FUEL ALARM
JUN 25, 2024 10:29 AM

***** END *****

ALARM HISTORY REPORT

----- SENSOR ALARM -----
L 2:
OTHER SENSORS
SENSOR OUT ALARM
JUL 16, 2020 12:42 PM

SETUP DATA WARNING
JUL 16, 2020 12:42 PM

***** END *****

ALARM HISTORY REPORT

----- SENSOR ALARM -----
L 3:DISP 5-6
DISPENSER PAN
FUEL ALARM
MAY 19, 2026 10:24 AM

FUEL ALARM
JUN 18, 2025 9:51 AM

FUEL ALARM
JUN 25, 2024 10:08 AM

ALARM HISTORY REPORT

----- SENSOR ALARM -----
L 4:DISP 7-8
DISPENSER PAN
FUEL ALARM
MAY 19, 2026 10:40 AM

FUEL ALARM
JUN 18, 2025 9:51 AM

FUEL ALARM
JUN 25, 2024 10:28 AM

***** END *****

ALARM HISTORY REPORT

----- SENSOR ALARM -----
L 5:DISP 9-10
DISPENSER PAN
FUEL ALARM
MAY 19, 2026 10:40 AM

FUEL ALARM
JUN 18, 2025 9:50 AM

FUEL ALARM
JUN 25, 2024 10:28 AM

***** END *****

ALARM HISTORY REPORT

----- SENSOR ALARM -----
L 6:DISP 11-12
DISPENSER PAN
FUEL ALARM
MAY 19, 2026 10:41 AM

FUEL ALARM
JUN 18, 2025 9:49 AM

FUEL ALARM
JUN 25, 2024 10:29 AM

ALARM HISTORY REPORT

----- SENSOR ALARM -----
L 7:REG INTERSTITIAL
ANNULAR SPACE
HIGH LIQUID ALARM
MAY 19, 2026 11:00 AM

LOW LIQUID ALARM
MAY 19, 2026 11:00 AM

HIGH LIQUID ALARM
JUN 18, 2025 10:17 AM

ALARM HISTORY REPORT

----- SENSOR ALARM -----
L 8:PREM INTERSTITIAL
ANNULAR SPACE
LOW LIQUID ALARM
MAY 19, 2026 10:56 AM

HIGH LIQUID ALARM
MAY 19, 2026 10:56 AM

LOW LIQUID ALARM
MAY 19, 2026 10:56 AM

***** END *****

ALARM HISTORY REPORT

----- SENSOR ALARM -----
L 9:REG 20K STP
STP SUMP
FUEL ALARM
MAY 19, 2026 10:53 AM

FUEL ALARM
JUN 18, 2025 10:22 AM

FUEL ALARM
JUN 25, 2024 10:50 AM

* * * * * END * * * * *

ALARM HISTORY REPORT

----- SENSOR ALARM -----
L10:REG BK STP SUMP
STP SUMP
FUEL ALARM
MAY 19, 2026 10:54 AM

FUEL ALARM
JUN 18, 2025 10:20 AM

FUEL ALARM
JUN 25, 2024 10:50 AM

* * * * * END * * * * *

ALARM HISTORY REPORT

----- SENSOR ALARM -----
L11:PREM STP SUMP
STP SUMP
FUEL ALARM
MAY 19, 2026 10:57 AM

FUEL ALARM
JUN 18, 2025 10:18 AM

FUEL ALARM
JUN 25, 2024 10:52 AM

* * * * * END * * * * *

ALARM HISTORY REPORT

----- SENSOR ALARM -----
L12:DISP 3-4
DISPENSER PAN
FUEL ALARM
MAY 19, 2026 10:41 AM

FUEL ALARM
JUN 18, 2025 9:50 AM

FUEL ALARM
JUN 25, 2024 10:28 AM

* * * * * END * * * * *