

**New York State Department of
Environmental Conservation**

Site Number 7-04-009A


**Vestal Water Supply Site Quarterly
Report**

Third Quarter 2011

March 201G



Bruce Nelson, CPG
Principal Geologist / Associate Vice President



Jeremy Wyckoff
Staff Geologist

**Vestal Water Supply Site
Quarterly Report**

Third Quarter 2011

Site Number 7-04-009A

Prepared for:
New York State Department of
Environmental Conservation

Prepared by:
Malcolm Pirnie, Inc.
855 Route 146
Suite 210
Clifton Park
New York 12065
Tel 518 250 7300
Fax 518 250 7301

Our Ref.:
00266352.0000

Date:
March 2012

This document is intended only for the use of the individual or entity for which it was prepared and may contain information that is privileged, confidential and exempt from disclosure under applicable law. Any dissemination, distribution or copying of this document is strictly prohibited.

| | |
|-------------------------------------|----------|
| 1. Introduction | 1 |
| 2. Site Description | 2 |
| 3. Operation and Maintenance | 3 |
| 3.1 System Operation | 3 |
| 3.2 Influent – Effluent Sampling | 4 |
| 4. Groundwater Monitoring | 6 |
| 5. Recommendations | 7 |
| 6. Summary | 8 |
| 7. References | 9 |

Figures

| | |
|-----|--|
| 2-1 | Site Location |
| 3-1 | Well 1-1A Treatment Plant Flow |
| 3-2 | Well 1-1A Treatment Plant Total VOCs Concentration |

Tables

| | |
|-----|---|
| 3-1 | Well 1-1A Flow Summary |
| 3-2 | Summary of Groundwater Treatment System VOCs (Influent) |
| 3-3 | Summary of Groundwater Treatment System VOCs (Effluent) |

Appendices

| | |
|---|---|
| A | Monthly Reports and System Operation and Maintenance Logs |
| B | Analytical Reporting Forms |
| C | June 2011 Iso-Concentration Map |

1. Introduction

The New York State Department of Environmental Conservation (NYSDEC) has issued a Work Assignment (# D004443-4) to Malcolm Pirnie, Inc. (Malcolm Pirnie) for Operation, Maintenance, and Monitoring at the Vestal Water Supply Site in New York State (Site # 7-04-009A). Malcolm Pirnie has prepared this Quarterly Report in accordance with the NYSDEC-approved Work Plan to summarize site activities.

2. Site Description

The Vestal Water Supply (Site 1-1) Site is located on Pumphouse Road, Vestal, Broome County, New York (Figure 2-1), along the southern bank of the Susquehanna River. Well 1-1 is located just south of the Susquehanna River and northwest of an industrial park located along Stage Road. Until 1980, Well 1-1 was the main source of water for Water District 1, which provides drinking water for several areas of the Town of Vestal. Currently, there are two other production wells, Wells 1-2A and 1-3 that function as the main source of water for Water District 1. Well 1-1A was installed in 1993 to replace Well 1-1 and is currently being used to pump and treat groundwater, which is then discharged to the Susquehanna River.

3. Operation and Maintenance

Malcolm Pirnie has maintained continuous operation of the groundwater treatment plant at the Vestal Water Supply Site. This includes the operation, maintenance, and influent/effluent sampling in accordance with the operations and maintenance (O&M) manual (Final Operation and Maintenance Manual, Long-Term Response, Operable Unit 1, Vestal Well 1-1 Site, Vestal, New York) (Tetra Tech EC, Inc., 2006) (Final O&M Manual). However, as indicated in the Work Assignment, no work was performed on the Vestal Water Supply (Site 1-1) soil vapor extraction system.

As part of managing the Vestal Water Supply Site, Malcolm Pirnie has a subcontract with Environmental Compliance, Inc. (ECI), who has unique knowledge of operating the groundwater treatment plant. ECI provides materials, labor, equipment, and supervision to maintain continuous operation of the groundwater treatment plant.

A variable frequency drive (VFD) was installed in February 2009 to provide soft-start operation for the Well 1-1A replacement well pump motor and reduced torque on the Certa-Lock® PVC drop pipe. The VFD also provides energy savings by allowing the well pump motor to be operated at a reduced speed. Compared to the full load rating of the pump motor and at an estimated energy cost of \$0.083 per kilo-watt (KW) the VFD (at the current setting of 51 hertz) has the potential to provide an estimated annual energy cost savings up to \$9,000.

3.1 System Operation

As indicated in the ECI Monthly Reports and O&M Logs (Appendix A), the groundwater treatment system was shut down for three days in July due to power disruptions. The system was also shut down for two days in August and five days in September at the request of the NYSDEC Division of Water (Division of Water) due to flooding on the Susquehanna River. During the September flood, the Division of Water cut the lock for the entry gate to gain access to the site. The Division of Water used the site as a staging area for flood control pumps. The entry gate lock was replaced by Malcolm Pirnie on September 29, 2011. The September flood caused the basement of the Well 1-1 pump house to flood. Water was subsequently pumped from the basement by ECI; no damage was reported.

Table 3-1 and Figure 3-1 summarize groundwater treatment system flow rates from the Monthly Reports and System O&M Logs. As shown in Table 3-1, the groundwater treatment system flow rate for Well 1-1A decreased from an average of 254 gallons per

minute (GPM) in July 2011 to an average of 234 GPM in September 2011. As shown on Table 3-1, approximately 29,179,000 gallons of water were treated during the third quarter 2011 operating period.

Due to continued reductions in yield, Well 1-1A will be developed quarterly as presented in the NYSDEC-approved budget addendum and Schedule 211 forms (June 2011). Quarterly well maintenance will proceed in the first quarter 2011.

The chain-link fencing in the entry gate to the treatment facility is damaged and needs to be repaired. The damage was noted during the Second Quarter, 2011. The cause of the damage is unknown, but appears to be the result of contact with heavy-equipment (possibly a front-end-loader). The repairs are scheduled to be performed by ECI during the fourth quarter, 2011.

3.2 Influent – Effluent Sampling

Third quarter 2011 influent and effluent groundwater samples were collected from the Well 1-1A treatment system in accordance with the Work Plan. Influent and effluent groundwater samples were sent to TestAmerica Laboratories following chain-of-custody protocols for analysis of volatile organic compounds (VOCs) by United States Environmental Protection Agency (USEPA) Method 8260B. The laboratory analytical reporting forms are provided in Appendix B. The laboratory analytical data for the treatment plan samples are summarized in Tables 3-2 (influent VOCs) and Table 3-3 (effluent VOCs); Figure 3-2 presents the Well 1-1A treatment plant total influent VOC concentrations over time.

As shown in Table 3-2, maximum influent sample concentrations of 1,1,1-trichloroethane (200 µg/L), 1,1-dichloroethane (24 µg/L), 1,1-dichloroethene (17 µg/L), cis-1,2-dichloroethene (37 µg/L), trichloroethene (39 µg/L), and vinyl chloride (7.8 µg/L) occurred in August 2011. These results are consistent with previous sampling results. In each of the samples collected during the third quarter 2011, the concentrations of 1,1,1 trichloroethane, 1,1 dichloroethene, 1,1, dichloroethene, cis-1,2 dichloroethene, trichloroethene, and vinyl chloride exceeded the corresponding NYSDEC Class GA Standards. Figure 3-2 shows that the total VOC concentrations detected in the July, August, and September Well 1-1A influent samples (316 µg/L, 365 µg/L, and 230 µg/L, respectively) were within the range of previous sampling events.

Table 3-3 shows that VOCs were not detected in any of the third quarter 2011 effluent samples collected from the treatment system.

Based on influent sample concentrations and total flow volumes from the Well 1-1A treatment system, approximately 74 pounds of VOCs were removed by the treatment system during the third quarter 2011 operating period. This quantity is less than the second quarter 2011 removal mass of 118 pounds, primarily due to the reduction of flow through the treatment system caused by power disruptions and flooding during the third quarter 2011 operating period.

4. Groundwater Monitoring

Groundwater monitoring wells were sampled in accordance with the Work Plan during the second quarter, 2011. The results of the sampling event were submitted to the NYSDEC with the second quarter 2011 Vestal Water Supply Site Quarterly Report and Annual Groundwater Monitoring Summary. An iso-concentration map showing the total VOCs concentrations in June 2011 samples collected from the wells in the shallow groundwater monitoring well network is provided in Appendix C. The next annual groundwater monitoring event is scheduled for the third quarter of 2012.

5. Recommendations

Recommendations for revised instrumentation and controls have been presented to the NYSDEC in the PRR (Malcolm Pirnie, 2010).

The effluent discharge line from the clear well to the NYSDEC Flood Management Area has a significant accumulation of precipitate and should be replaced. A scope of work and bid proposal package was prepared and submitted to the NYSDEC in October 2011 for review.

Based on well inspections performed during the second quarter, 2011 (Vestal Water Supply Site Quarterly Report and Annual Groundwater Monitoring Summary, 2011), the protective casings for groundwater monitoring wells 4009-1 and 4009-6 are damaged and should be replaced.

Due to continued reductions in flow from Well 1-1A, AquaGard well maintenance should be performed quarterly.

6. Summary

The Vestal Well 1-1A groundwater treatment system was shut down for three days in July, two days in August and five days in September due to power disruptions and flooding. The system operated with minimal interruption during the remainder of the third quarter, 2011 operation and maintenance period. The average flow rate through the treatment system during this period was 244 GPM, a decrease of approximately 83 GPM from the previous quarter. Total flow through the treatment system from July to September 2011 was approximately 29.2-million gallons. Based on monthly influent and effluent sampling, the treatment system successfully removes VOCs from groundwater extracted from the capture zone. Approximately 74 pounds of VOCs were removed by the treatment system during the third quarter, 2011 operational period.

Due to continued reductions in well yield, Well 1-1A will be redeveloped quarterly, beginning with the fourth quarter, 2011

The next groundwater sampling event is scheduled to be completed during the third quarter, 2012.

7. References

ARCADIS / Malcolm Pirnie, 2011. Vestal Water Supply Site Quarterly Report and Annual Groundwater Monitoring Summary, Second Quarter 2011. Site Number 7-04-009A.


Malcolm Pirnie, 2010, Periodic Review Report, Vestal Water Supply Site, Site Number 7-04-009A.

Tetra Tech EC, Inc., 2006, Final Operation and Maintenance Manual, Long-Term Response, Operable Unit 1, Vestal Well 1-1 Site, Vestal, New York.

Figure 2-1
SITE LOCATION

Vestal Water Supply Site
Vestal, New York
Site Number 7-04-009A

0  2,000 ft

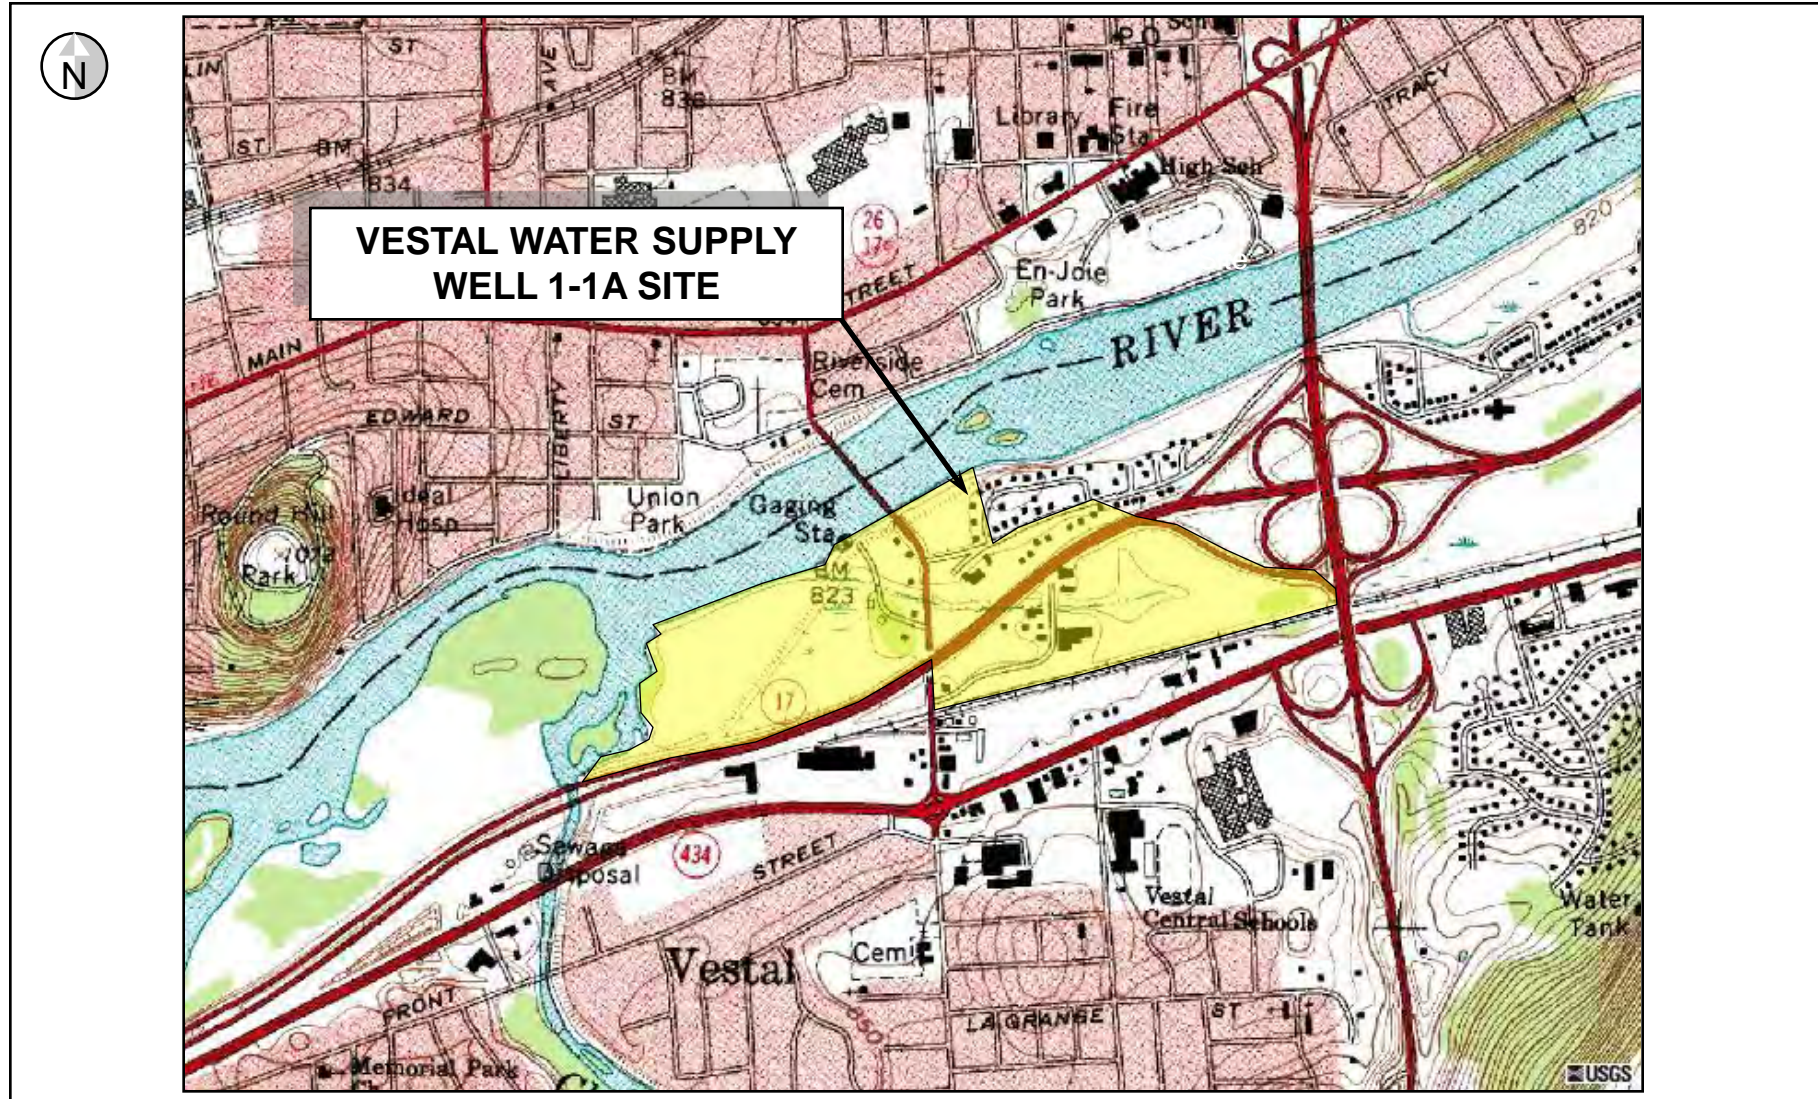

Source: USGS 7.5-minute Series Topographic Quadrangle, Endicott (1988).

Figure 3-1
Well 1-1A Treatment Plant Flow
Vestal Water Supply Site
NYSDEC Site Number 7-04-009A

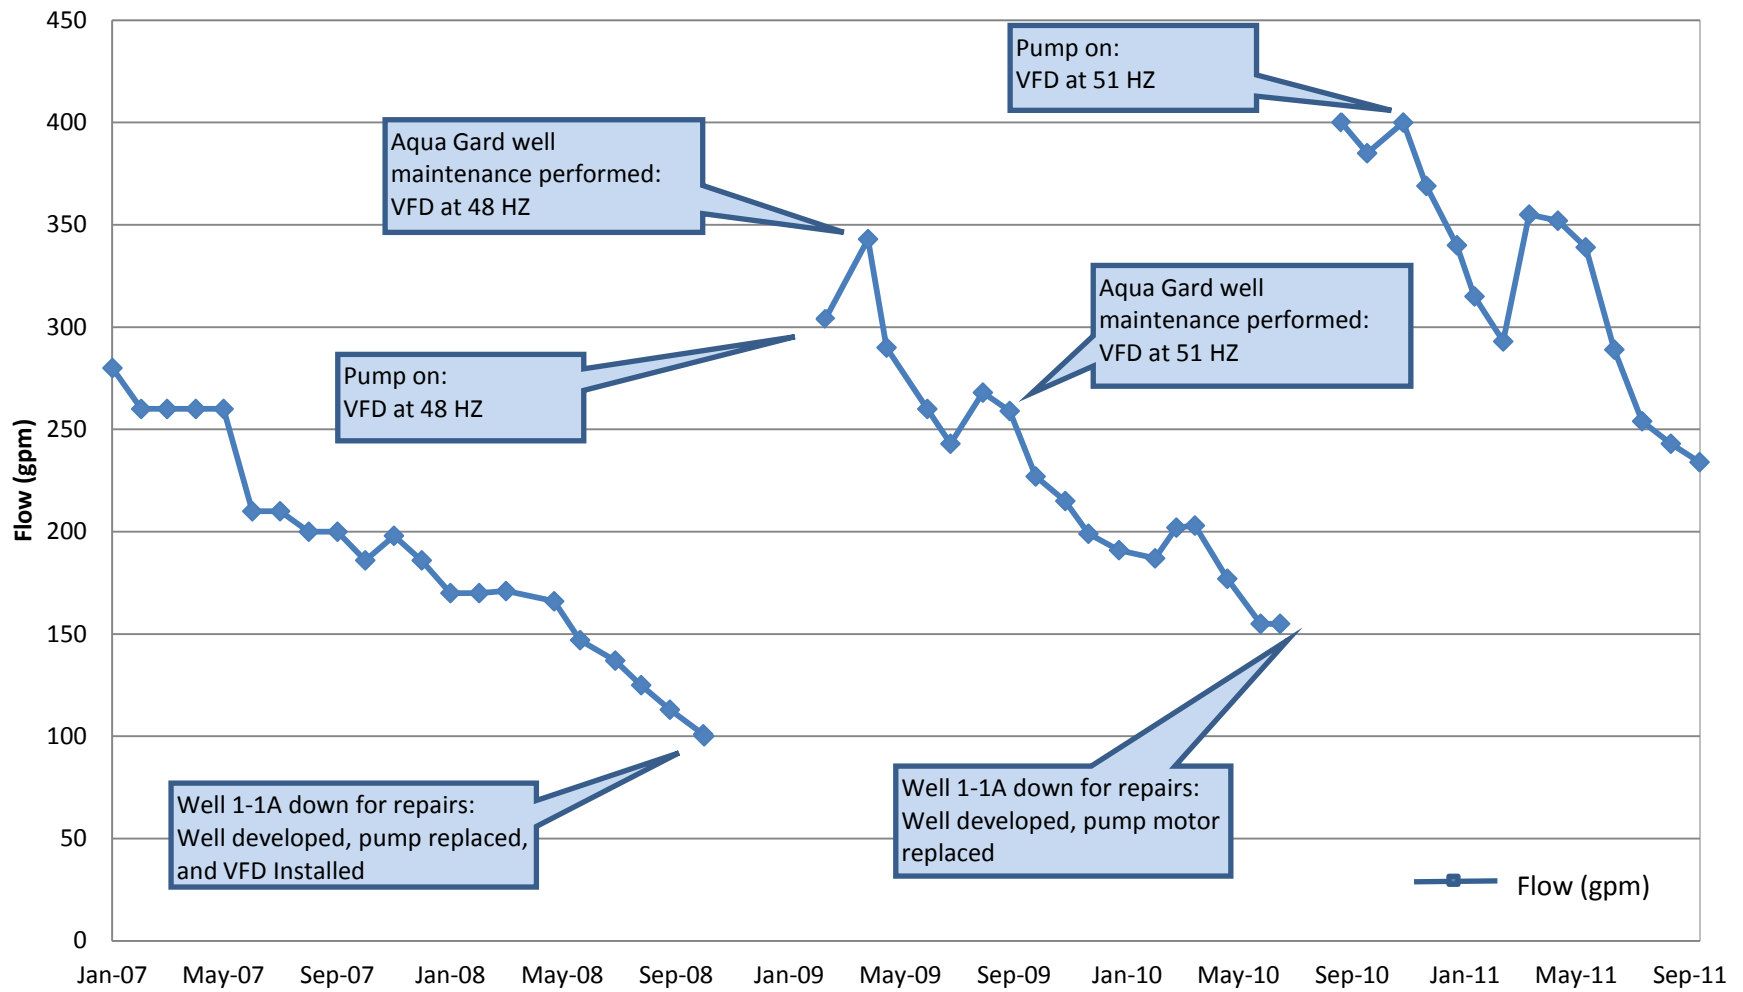
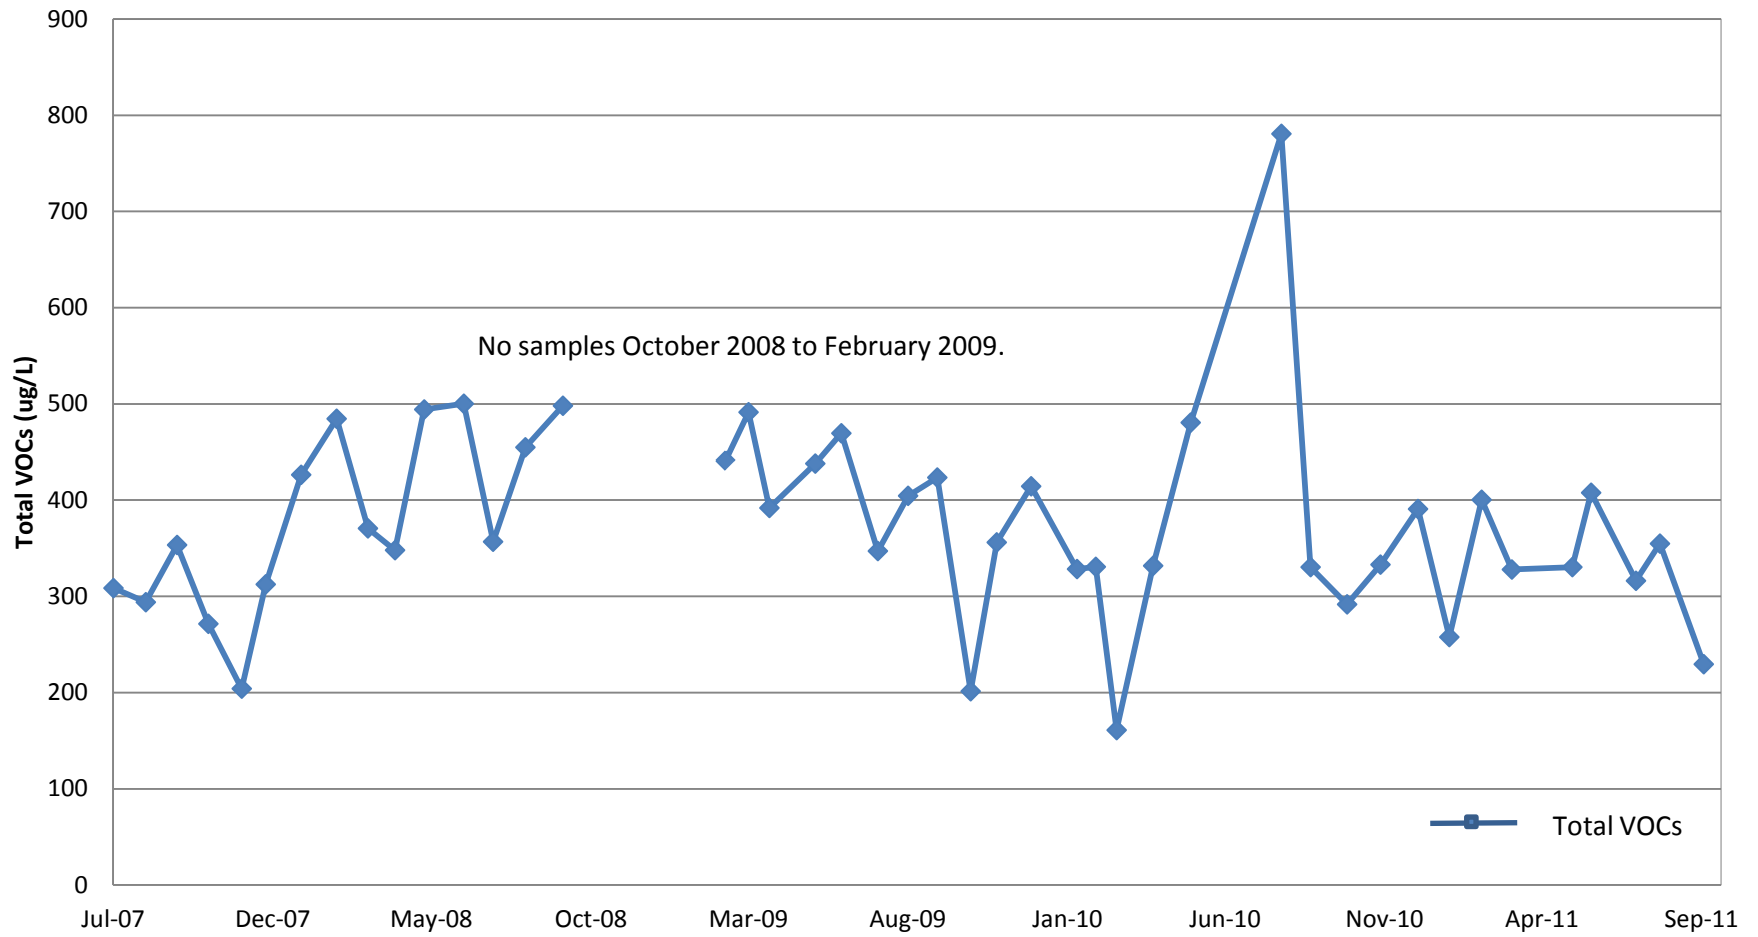


Figure 3-2
Well 1-1A Treatment Plant Total VOCs Concentrations
Vestal Water Supply Site
NYSDEC Site Number 7-04-009A



**TABLE 3-1
WELL 1-1A FLOW SUMMARY
VESTAL WATER SUPPLY
VESTAL, NEW YORK
NYSDEC SITE NO. 7-04-009A**

| Date | System Operation⁽¹⁾ (days/month) | Pumping Rate⁽¹⁾ (gpm) | Total Flow⁽²⁾ (gallons) | Quarterly Flow (gallons) |
|--------------|--|---|---|-------------------------------------|
| January-07 | 31 | 280 | 12,499,200 | 33,840,000 |
| February-07 | 28 | 260 | 10,483,200 | |
| March-07 | 29 (3) | 260 | 10,857,600 | |
| April-07 | 30 | 260 | 11,232,000 | 31,910,400 |
| May-07 | 31 | 260 | 11,606,400 | |
| June-07 | 30 | 210 | 9,072,000 | |
| July-07 | 31 | 210 | 9,374,400 | 26,942,400 |
| August-07 | 31 | 200 | 8,928,000 | |
| September-07 | 30 | 200 | 8,640,000 | |
| October-07 | 31 | 186 | 8,303,040 | 24,874,560 |
| November-07 | 29 | 198 | 8,268,480 | |
| December-07 | 31 | 186 | 8,303,040 | |
| January-08 | 31 | 170 | 7,588,800 | 22,321,440 |
| February-08 | 29 | 170 | 7,099,200 | |
| March-08 | 31 | 171 | 7,633,440 | |
| April-08 | 30 | 166 | 7,171,200 | 19,651,680 |
| May-08 | 31 | 147 | 6,562,080 | |
| June-08 | 30 | 137 | 5,918,400 | |
| July-08 | 31 | 125 | 5,580,000 | 14,987,520 |
| August-08 | 31 | 113 | 5,044,320 | |
| September-08 | 30 | 101 | 4,363,200 | |
| October-08 | 6 (4) | 100 | 864,000 | 864,000 |
| November-08 | 0 (4) | 0 | 0 | |
| December-08 | 0 (4) | 0 | 0 | |
| January-09 | 0 (4) | 0 | 0 | 22,641,120 |
| February-09 | 19 (4) | 304 | 8,317,440 | |
| March-09 | 29 (3) | 343 | 14,323,680 | |
| April-09 | 30 | 290 | 12,528,000 | 34,257,600 |
| May-09 | 30 (5) | 260 | 11,232,000 | |
| June-09 | 30 | 243 | 10,497,600 | |
| July-09 | 29 (4) | 268 | 11,191,680 | 31,160,160 |
| August-09 | 29 (5) | 259 | 10,815,840 | |
| September-09 | 28 (5) | 227 | 9,152,640 | |
| October-09 | 31 | 215 | 9,597,600 | 26,720,640 |
| November-09 | 30 (5) | 199 | 8,596,800 | |
| December-09 | 31 | 191 | 8,526,240 | |

**TABLE 3-1
WELL 1-1A FLOW SUMMARY
VESTAL WATER SUPPLY
VESTAL, NEW YORK
NYSDEC SITE NO. 7-04-009A**

| Date | System Operation⁽¹⁾ (days/month) | Pumping Rate⁽¹⁾ (gpm) | Total Flow⁽²⁾ (gallons) | Quarterly Flow (gallons) |
|--------------------------|--|---|---|-------------------------------------|
| January-10 | 25 (3) | 187 | 6,732,000 | 23,938,560 |
| February-10 | 28 | 202 | 8,144,640 | |
| March-10 | 31 | 203 | 9,061,920 | |
| April-10 | 30 | 177 | 7,646,400 | 16,128,000 |
| May-10 | 31 | 155 | 6,919,200 | |
| June-10 | 7 (4) | 155 | 1,562,400 | |
| July-10 | 0 (4) | 0 | 0 | 23,544,000 |
| August-10 | 12 (4) | 400 | 6,912,000 | |
| September-10 | 30 | 385 | 16,632,000 | |
| October-10 | 31 | 400 | 17,856,000 | 47,911,680 |
| November-10 | 28 (5) | 369 | 14,878,080 | |
| December-10 | 31 | 340 | 15,177,600 | |
| January-11 | 31 | 315 | 14,061,600 | 40,278,240 |
| February-11 | 27 (5) | 293 | 11,391,840 | |
| March-11 | 29 (3) | 355 | 14,824,800 | |
| April-11 | 26 (3) | 352 | 13,178,880 | 39,820,320 |
| May-11 | 29 (3) | 339 | 14,156,640 | |
| June-11 | 30 | 289 | 12,484,800 | |
| July-11 | 29 (5) | 254 | 10,607,040 | 29,178,720 |
| August-11 | 29 (3) | 243 | 10,147,680 | |
| September-11 | 25 (3) | 234 | 8,424,000 | |
| Total Flow (2007) | | | 117,567,360 | |
| Total Flow (2008) | | | 65,750,400 | |
| Total Flow (2009) | | | 93,790,080 | |
| Total Flow (2010) | | | 111,522,240 | |
| Total Flow (2011) | | | 109,277,280 | |

Notes:

- 1 - From Environmental Compliance, Inc. O&M Reports and Malcolm Pirnie, Inc. field notes.
 - 2 - Calculated assuming system operating 24-hours per day
 - 3 - System shut down for flooding
 - 4 - System shut down for repairs
 - 5 - System down due to power failure
- gpm - Gallons per minute

**TABLE 3-2
SUMMARY OF GROUNDWATER TREATMENT SYSTEM VOCS (INFLUENT)
VESTAL WATER SUPPLY
VESTAL, NEW YORK
NYSDEC SITE #7-04-009A**

| Sample ID Sampling Date Matrix Units | NYSDEC GA Standard ug/L | WELL 1A-INF 7/27/2007 WATER ug/L | WELL 1A-INF 8/27/2007 WATER ug/L | WELL 1A-INF 9/26/2007 WATER ug/L | WELL 1A-INF 10/26/2007 WATER ug/L | WELL 1A-INF 11/27/2007 WATER ug/L | WELL 1A-INF 12/20/2007 WATER ug/L | WELL 1A-INF 1/23/2008 WATER ug/L | WELL 1A-INF 2/26/2008 WATER ug/L | WELL 1A-INF 3/27/2008 WATER ug/L | WELL 1A-INF 4/22/2008 WATER ug/L | WELL 1A-INF 5/20/2008 WATER ug/L | WELL 1A-INF 6/27/2008 WATER ug/L |
|---|----------------------------------|---|---|---|--|--|--|---|---|---|---|---|---|
| VOCS | | | | | | | | | | | | | |
| 1,1,1-Trichloroethane | 5 | 170 | 160 | 200 | 140 | 110 | 170 | 230 | 250 | 180 | 180 | 300 E | 290 |
| 1,1,2,2-Tetrachloroethane | 5 | 10 U | 5 U | 20 U | 5 U | 10 U | 20 U | 10 U | 10 U | 5 U | 10 U | 10 U | 20 U |
| 1,1,2-Trichloroethane | 1 | 10 U | 5 U | 20 U | 5 U | 10 U | 20 U | 10 U | 10 U | 5 U | 10 U | 10 U | 20 U |
| 1,1-Dichloroethane | 5 | 20 | 19 | 23 | 22 | 15 | 24 | 30 | 31 | 27 | 26 | 27 | 28 |
| 1,1-Dichloroethene | 5 | 12 | 10 | 14 J | 11 | 8.2 J | 13 J | 18 M | 18 | 17 | 9.7 J | 17 | 20 J |
| 1,2-Dichloroethane | 0.6 | 10 U | 5 U | 20 U | 5 U | 10 U | 20 U | 10 U | 10 U | 5 U | 10 U | 10 U | 20 U |
| 1,2-Dichloropropane | 5 | 10 U | 5 U | 20 U | 5 U | 10 U | 20 U * | 10 U | 10 U | 5 U | 10 U | 10 U | 20 U |
| 2-Hexanone | | 20 U | 10 U | 40 U | 10 U | 20 U | 40 U | 20 U * | 20 U | 10 U | 20 U | 10 U | 40 U |
| Acetone | | 20 U | 10 U | 40 U | 10 U | 20 U | 40 UM | 20 U * | 20 U | 10 U | 20 U | 0.5 J B | 11 J B |
| Benzene | 1 | 10 U | 0.39 J | 20 U | 5 U | 10 U | 20 U | 0.6 J | 10 U | 0.38 J | 10 U | 10 U | 20 U |
| Bromodichloromethane | 50 | 10 U | 5 U | 20 U | 5 U | 10 U | 20 U | 10 U | 10 U | 5 U | 10 U | 10 U | 20 U |
| Bromoform | | 10 U | 5 U | 20 U | 5 U | 10 U | 20 U | 10 U | 10 U | 5 U | 10 U | 10 U | 20 U |
| Bromomethane | 5 | 10 U | 5 U | 20 U | 5 U | 10 U | 20 U | 10 U * | 10 U | 5 U | 10 U | 10 U | 20 U |
| Carbon disulfide | | 10 U | 5 U | 20 U | 5 U | 10 U | 20 U | 10 U | 10 U | 5 U | 10 U | 10 U | 20 U |
| Carbon tetrachloride | 5 | 10 U | 5 U | 20 U | 5 U | 10 U | 20 U | 10 U | 35 | 5 U | 10 U | 10 U | 20 U |
| Chlorobenzene | 5 | 10 U | 5 U | 20 U | 5 U | 10 U | 20 U | 10 U | 10 U | 5 U | 10 U | 10 U | 20 U |
| Chloroethane | 5 | 10 U | 5 U | 20 U | 5 U | 10 U | 20 U * | 10 U | 10 U | 0.79 J | 10 U | 10 U | 20 U |
| Chloroform | 7 | 10 U | 5 U | 20 U | 5 U | 10 U | 20 U | 10 U | 10 U | 5 U | 10 U | 10 U | 20 U |
| Chloromethane | | 10 U | 5 U | 20 U | 5 U * | 10 U | 20 U * | 10 U | 10 U | 5 U | 10 U | 10 U | 20 U |
| cis-1,2-Dichloroethene | 5 | 55 | 54 | 58 | 50 | 39 | 57 | 71 | 73 | 76 | 72 | 78 | 77 |
| cis-1,3-Dichloropropene | 0.4 | 10 U | 5 U | 20 U | 5 U | 10 U | 20 U | 10 U | 10 U | 5 U | 10 U | 10 U | 20 U |
| Dibromochloromethane | 50 | 10 U | 5 U | 20 U | 5 U | 10 U | 20 U | 10 U | 10 U | 5 U | 10 U | 10 U | 20 U |
| Ethylbenzene | 5 | 10 U | 5 U | 20 U | 5 U | 10 U | 20 U | 10 U | 10 U | 5 U | 10 U | 10 U | 20 U |
| Methyl Ethyl Ketone | 50 | 20 U | 10 U | 40 U | 10 U | 20 U | 40 U | 20 U * | 20 U | 10 U | 20 U | 10 U | 40 U |
| Methyl Isobutyl Ketone | | 20 U | 10 U | 40 U | 10 U | 20 U | 40 U | 20 U | 20 U | 10 U | 20 U | 10 U | 40 U |
| Methylene Chloride | 5 | 10 U | 5 U | 20 U * | 5 U | 10 U M | 2.2 JMB | 0.94 J | 10 U | 5 U | 2.2 J B | 0.32 J B | 3.5 J B |
| Styrene | 5 | 10 U | 5 U | 20 U | 5 U | 10 U | 20 U | 10 U | 10 U | 5 U | 10 U | 10 U | 20 U |
| Tetrachloroethene | 5 | 1.3 J | 5 U | 20 U | 0.97 J | 10 U | 20 U | 10 U | 10 U | 5 U | 10 U | 10 U | 20 U |
| Toluene | 5 | 10 U | 0.15 J | 20 U | 5 U | 10 U | 20 U | 10 U | 10 U | 5 U | 10 U | 10 U | 20 U |
| trans-1,2-Dichloroethene | 5 | 10 U | 5 U | 20 U | 5 U | 10 U | 20 U | 10 U | 10 U | 5 U | 10 U | 10 U | 20 U |
| trans-1,3-Dichloropropene | 0.4 | 10 U | 5 U | 20 U | 5 U | 10 U | 20 U | 10 U | 10 U | 5 U | 10 U | 10 U | 20 U |
| Trichloroethene | 5 | 46 | 47 | 53 | 41 B | 29 | 37 | 62 | 69 | 62 | 54 * B | 65 | 64 |
| Vinyl chloride | 2 | 4.3 J | 3.4 J | 5.4 J | 6.5 * | 2.9 J | 9.3 JM | 11 | 8.6 J | 7.5 | 4.1 J | 6.4 J | 6.7 J |
| Xylenes, Total | 5 | 10 U | 5 U | 20 U | 5 U | 10 U | 20 U | 2.8 J | 10 U | 5 U | 10 U | 10 U | 20 U |
| Total VOCs | | 309 | 294 | 353 | 271 | 204 | 313 | 426 | 485 | 371 | 348 | 494 | 500 |

Notes

- Concentration exceeds corresponding NYSDEC Class GA Standard.
- U - Not detected at the indicated concentration.
- J - Estimated concentration.
- M - Manual integrated compound.
- B - Analyte found in associated blank as well as the sample.
- E - Concentration exceeds instrument calibration range.
- * - MS or MSD exceeded control limits.

**TABLE 3-2
SUMMARY OF GROUNDWATER TREATMENT SYSTEM VOCS (INFLUENT)
VESTAL WATER SUPPLY
VESTAL, NEW YORK
NYSDEC SITE #7-04-009A**

| Sample ID Sampling Date Matrix Units | NYSDEC GA Standard ug/L | WELL 1A-INF 7/25/2008 WATER ug/L | WELL 1A-INF 8/25/2008 WATER ug/L | WELL 1A-INF 9/30/2008 WATER ug/L | WELL 1A-INF 3/5/2009 WATER ug/L | WELL 1A-INF 3/27/2009 WATER ug/L | WELL 1A-INF 4/16/2009 WATER ug/L | WELL 1A-INF 5/30/2009 WATER ug/L | WELL 1A-INF 6/24/2009 WATER ug/L | WELL 1A-INF 7/29/2009 WATER ug/L | WELL 1A-INF 8/27/2009 WATER ug/L | WELL 1A-INF 9/24/2009 WATER ug/L | WELL 1A-INF 10/26/2009 WATER ug/L |
|---|----------------------------------|---|---|---|--|---|---|---|---|---|---|---|--|
| VOCS | | | | | | | | | | | | | |
| 1,1,1-Trichloroethane | 5 | 220 | 270 | 300 | 260 | 280 | 220 | 250 | 270 | 190 | 220 | 230 | 110 |
| 1,1,2,2-Tetrachloroethane | 5 | 20 U | 20 U | 25 U | 25 U | 2 U | 10 U | 20 U | 2 U | 2 U | 2 U | 10 U | 10 U |
| 1,1,2-Trichloroethane | 1 | 20 U | 20 U | 25 U * | 25 U | 2 U | 10 U | 20 U | 2 U | 2 U | 2 U | 10 U | 10 U |
| 1,1-Dichloroethane | 5 | 23 | 27 | 28 | 28 | 31 | 25 | 27 | 27 | 21 | 23 | 26 | 14 |
| 1,1-Dichloroethene | 5 | 13 J | 19 J | 19 J | 19 J | 22 * | 20 | 24 * | 22 | 18 * | 19 | 19 | 8.7 J |
| 1,2-Dichloroethane | 0.6 | 20 U | 20 U | 25 U | 25 U | 2 U | 10 U | 20 U | 2 U | 2 U | 2 U | 10 U | 10 U |
| 1,2-Dichloropropane | 5 | 20 U | 20 U | 25 U | 25 U | 2 U | 10 U | 20 U | 2 U | 2 U | 2 U | 10 U | 10 U |
| 2-Hexanone | | 40 U | 40 U | 50 U | 50 U | 8 U | 20 U | 40 U | 8 U | 8 U | 8 U | 20 U | 20 U |
| Acetone | | 40 U | 4.7 J | 5.2 J | 50 U | 2.3 J * | 20 U * | 12 J | 10 | 13 B | 23 | 20 U | 4.2 J |
| Benzene | 1 | 20 U | 20 U | 25 U | 25 U | 2 U | 10 U | 20 U | 2 U | 2 U | 2 U | 10 U | 10 U |
| Bromodichloromethane | 50 | 20 U | 20 U | 25 U | 25 U | 2 U | 10 U | 20 U | 2 U | 2 U | 2 U | 10 U | 10 U |
| Bromoform | | 20 U | 20 U | 25 U | 25 U | 2 U | 10 U | 20 U | 2 U | 2 U | 2 U | 10 U | 10 U |
| Bromomethane | 5 | 20 U | 20 U | 25 U | 25 U | 4 U | 10 U | 20 U | 4 U | 4 U | 4 U | 10 U | 10 U |
| Carbon disulfide | | 20 U | 20 U | 25 U | 25 U | 2 U | 10 U | 20 U | 2 U | 2 U | 2 U | 10 U | 10 U |
| Carbon tetrachloride | 5 | 20 U | 20 U | 25 U | 25 U | 2 U | 10 U | 20 U | 2 U | 2 U | 2 U | 10 U | 10 U |
| Chlorobenzene | 5 | 20 U | 20 U | 25 U | 25 U | 2 U | 10 U | 20 U | 2 U | 2 U | 2 U | 10 U | 10 U |
| Chloroethane | 5 | 20 U | 20 U | 25 U | 25 U | 4 U | 10 U | 20 U | 4 U * | 4 U * | 4 U | 10 U | 10 U |
| Chloroform | 7 | 20 U | 20 U | 25 U * | 25 U | 0.67 J B | 10 U | 20 U | 2 U | 2 U | 2 U | 10 U | 10 U |
| Chloromethane | | 20 U | 20 U | 25 U | 25 U | 2 U | 10 U | 20 U | 2 U * | 2 U | 2 U | 10 U | 10 U |
| cis-1,2-Dichloroethene | 5 | 50 | 68 | 75 | 65 | 63 | 60 | 53 | 55 | 49 | 51 | 70 | 31 |
| cis-1,3-Dichloropropene | 0.4 | 20 U | 20 U | 25 U | 25 U | 2 U | 10 U | 20 U | 2 U | 2 U | 2 U | 10 U | 10 U |
| Dibromochloromethane | 50 | 20 U | 20 U | 25 U | 25 U | 2 U | 10 U | 20 U | 2 U | 2 U | 2 U | 10 U | 10 U |
| Ethylbenzene | 5 | 20 U | 20 U | 25 U | 25 U | 2 U | 10 U | 20 U | 2 U | 2 U | 2 U | 10 U | 10 U |
| Methyl Ethyl Ketone | 50 | 40 U | 40 U | 50 U | 50 U | 8 U | 20 U | 40 U | 8 U | 8 U | 8 U | 20 U | 20 U |
| Methyl Isobutyl Ketone | | 40 U | 40 U | 50 U | 50 U | 8 U | 20 U | 40 U | 8 U | 8 U | 8 U | 20 U | 20 U |
| Methylene Chloride | 5 | 20 U | 20 U | 25 U | 25 U | 7.9 J B | 2.3 J B | 11 J B | 14 | 9.1 | 4.9 J B | 3.9 J B | 10 U |
| Styrene | 5 | 20 U * | 20 U | 25 U | 25 U | 2 U | 10 U | 20 U | 2 U | 2 U | 2 U | 10 U | 10 U |
| Tetrachloroethene | 5 | 20 U | 20 U | 25 U | 25 U | 2 U | 10 U | 20 U | 2 U | 2 U | 2 U | 10 U | 10 U |
| Toluene | 5 | 20 U | 20 U | 25 U | 25 U | 2 U | 10 U | 20 U | 2 U | 2 U | 2 U | 10 U | 10 U |
| trans-1,2-Dichloroethene | 5 | 20 U | 20 U | 25 U | 25 U | 0.51 J | 10 U | 20 U | 1.5 J | 2 U * | 2 U | 10 U | 10 U |
| trans-1,3-Dichloropropene | 0.4 | 20 U | 20 U | 25 U | 25 U | 2 U | 10 U | 20 U | 2 U | 2 U | 2 U | 10 U | 10 U |
| Trichloroethene | 5 | 45 | 59 | 64 | 59 | 58 | 55 | 50 | 59 | 47 | 56 | 66 | 29 |
| Vinyl chloride | 2 | 5.8 J | 7.2 J | 6.9 J | 10 J | 14 | 9.6 J | 11 J | 11 | 2 U | 7.6 | 8.6 J | 4.5 J |
| Xylenes, Total | 5 | 20 U | 20 U | 25 U | 25 U | 12 | 10 U | 20 U | 4 U | 4 U | 4 U | 10 U | 10 U |
| Total VOCs | | 357 | 455 | 498 | 441 | 491 | 392 | 438 | 470 | 347 | 405 | 424 | 201 |

Notes

- Concentration exceeds corresponding NYSDEC Class GA Standard.
- U - Not detected at the indicated concentration.
- J - Estimated concentration.
- M - Manual integrated compound.
- B - Analyte found in associated blank as well as the sample.
- E - Concentration exceeds instrument calibration range.
- * - MS or MSD exceeded control limits.

**TABLE 3-2
SUMMARY OF GROUNDWATER TREATMENT SYSTEM VOCS (INFLUENT)
VESTAL WATER SUPPLY
VESTAL, NEW YORK
NYSDEC SITE #7-04-009A**

| Sample ID Sampling Date Matrix Units | NYSDEC GA Standard ug/L | WELL 1A-INF 11/20/2009 WATER ug/L | WELL 1A-INF 12/23/2009 WATER ug/L | WELL 1A-INF 2/5/2010 WATER ug/L | WELL 1A-INF 2/23/2010 WATER ug/L | WELL 1A-INF 3/15/2010 WATER ug/L | WELL 1A-INF 4/19/2010 WATER ug/L | WELL 1A-INF 5/25/2010 WATER ug/L | WELL 1A-INF 8/20/2010 WATER ug/L | WELL 1A-INF 9/17/2010 WATER ug/L | WELL 1A-INF 10/22/2010 WATER ug/L | WELL 1A-INF 11/23/2010 WATER ug/L | WELL 1A-INF 12/29/2010 WATER ug/L |
|---|----------------------------------|--|--|--|---|---|---|---|---|---|--|--|--|
| VOCS | | | | | | | | | | | | | |
| 1,1,1-Trichloroethane | 5 | 200 | 240 | 170 | 170 | 91 | 180 | 270 | 420 | 180 | 150 | 180 | 220 |
| 1,1,2,2-Tetrachloroethane | 5 | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| 1,1,2-Trichloroethane | 1 | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| 1,1-Dichloroethane | 5 | 24 | 27 | 23 | 22 | 14 | 22 | 30 | 48 | 23 | 18 | 23 | 28 |
| 1,1-Dichloroethene | 5 | 16 J | 20 | 16 | 17 | 7.5 | 16 | 21 | 34 | 15 | 15 | 14 | 19 J |
| 1,2-Dichloroethane | 0.6 | 20 U | 20 U | 5 U | 5 U | 5 U * | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| 1,2-Dichloropropane | 5 | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| 2-Hexanone | | 40 U | 40 U * | 10 U | 10 U | 10 U | 10 U | 20 U | 40 U | 10 U | 10 U | 20 U | 40 U |
| Acetone | | 40 U | 5.8 J | 10 U | 10 U | 10 U | 10 U | 20 U | 40 U | 10 U | 10 U | 2.6 J | 40 U |
| Benzene | 1 | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| Bromodichloromethane | 50 | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| Bromoform | | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| Bromomethane | 5 | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| Carbon disulfide | | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| Carbon tetrachloride | 5 | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| Chlorobenzene | 5 | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| Chloroethane | 5 | 20 U | 20 U | 5 U | 5 U | 5 U * | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| Chloroform | 7 | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| Chloromethane | | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U * | 5 U * | 10 U | 20 U |
| cis-1,2-Dichloroethene | 5 | 54 | 55 | 56 | 57 | 22 | 53 | 75 | 140 | 52 | 47 | 48 | 57 |
| cis-1,3-Dichloropropene | 0.4 | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| Dibromochloromethane | 50 | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| Ethylbenzene | 5 | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| Methyl Ethyl Ketone | 50 | 40 U | 40 U | 10 U | 10 U | 10 U | 10 U | 20 U | 40 U | 10 U | 10 U | 20 U | 40 U |
| Methyl Isobutyl Ketone | | 40 U | 40 U | 10 U | 10 U | 10 U | 10 U | 20 U | 40 U * | 10 U | 10 U | 20 U | 40 U |
| Methylene Chloride | 5 | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 1.6 J B | 4.7 J B | 5 U | 5 U | 10 U | 20 U |
| Styrene | 5 | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| Tetrachloroethene | 5 | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| Toluene | 5 | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| trans-1,2-Dichloroethene | 5 | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| trans-1,3-Dichloropropene | 0.4 | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| Trichloroethene | 5 | 53 | 58 | 56 | 58 | 23 | 52 | 71 | 120 | 51 | 47 | 49 | 58 |
| Vinyl chloride | 2 | 9.1 J | 8.6 J | 7.4 | 6.7 | 3.5 J | 8.8 | 12 | 14 J | 9.4 | 9.7 | 9 J | 8.8 J |
| Xylenes, Total | 5 | 20 U | 20 U | 5 U | 5 U | 5 U | 5 U | 10 U | 20 U | 5 U | 5 U | 10 U | 20 U |
| Total VOCs | | 356 | 414 | 328 | 331 | 161 | 332 | 481 | 781 | 330 | 292 | 333 | 391 |

Notes

- Concentration exceeds corresponding NYSDEC Class GA Standard.
- U - Not detected at the indicated concentration.
- J - Estimated concentration.
- M - Manual integrated compound.
- B - Analyte found in associated blank as well as the sample.
- E - Concentration exceeds instrument calibration range.
- * - MS or MSD exceeded control limits.

**TABLE 3-2
SUMMARY OF GROUNDWATER TREATMENT SYSTEM VOCS (INFLUENT)
VESTAL WATER SUPPLY
VESTAL, NEW YORK
NYSDEC SITE #7-04-009A**

| Sample ID Sampling Date Matrix Units | NYSDEC GA Standard ug/L | WELL 1A-INF 1/28/2011 WATER ug/L | WELL 1A-INF 2/28/2011 WATER ug/L | WELL 1A-INF 3/29/2011 WATER ug/L | WELL 1A-INF 5/26/2011 WATER ug/L | WELL 1A-INF 6/13/2011 WATER ug/L | WELL 1A-INF 7/26/2011 WATER ug/L | WELL 1A-INF 8/18/2011 WATER ug/L | WELL 1A-INF 9/29/2011 WATER ug/L |
|---|----------------------------------|---|---|---|---|---|---|---|---|
| VOCs | | | | | | | | | |
| 1,1,1-Trichloroethane | 5 | 140 | 220 | 170 | 180 | 240 | 180 | 200 | 120 |
| 1,1,2,2-Tetrachloroethane | 5 | 10 | 20 U | 5 U | 5 U | 2 U | 10 U | 10 U | 5 U |
| 1,1,2-Trichloroethane | 1 | 10 | 20 U | 5 U | 5 U | 2 U | 10 U | 10 U | 5 U |
| 1,1-Dichloroethane | 5 | 19 | 27 | 25 | 23 | 26 | 20 | 24 | 17 |
| 1,1-Dichloroethene | 5 | 13 | 22 | 18 | 15 | 20 | 13 | 17 | 11 |
| 1,2-Dichloroethane | 0.6 | 10 U | 20 U | 5 U | 5 U | 2 U | 10 U | 10 U | 5 U |
| 1,2-Dichloropropane | 5 | 10 U | 20 U | 5 U | 5 U | 2 U | 10 U | 10 U | 5 U |
| 2-Hexanone | | 20 U | 40 U | 10 U | 10 U | 8 U | 20 U | 20 U | 10 U |
| Acetone | | 3.1 J | 14 J B | 10 U | 10 U | 4.8 J B | 20 U | 11 J | 10 U |
| Benzene | 1 | 10 U | 20 U | 5 U | 5 U | 2 U | 10 U | 10 U | 5 U |
| Bromodichloromethane | 50 | 10 U | 20 U | 5 U | 5 U | 2 U | 10 U | 10 U | 5 U |
| Bromoform | | 10 U | 20 U | 5 U | 5 U | 2 U | 10 U | 10 U | 5 U |
| Bromomethane | 5 | 10 U | 20 U | 5 U* | 5 U | 4 U | 10 U | 10 U | 5 U |
| Carbon disulfide | | 10 U | 20 U | 5 U | 5 U | 2 U | 10 U | 10 U | 5 U |
| Carbon tetrachloride | 5 | 10 U | 20 U | 5 U | 5 U | 2 U* | 10 U | 10 U* | 5 U |
| Chlorobenzene | 5 | 10 U | 20 U | 5 U | 5 U | 2 U | 10 U | 10 U | 5 U |
| Chloroethane | 5 | 10 U | 20 U | 5 U | 5 U | 4 U | 10 U | 10 U | 5 U |
| Chloroform | 7 | 10 U | 20 U | 5 U | 5 U | 0.71 J B | 10 U | 10 U | 5 U |
| Chloromethane | | 10 U | 20 U | 5 U | 5 U | 2 U | 10 U | 10 U | 5 U |
| cis-1,2-Dichloroethene | 5 | 39 | 63 | 53 | 52 | 52 | 46 | 51 | 37 |
| cis-1,3-Dichloropropene | 0.4 | 10 U | 20 U | 5 U | 5 U | 2 U | 10 U | 10 U | 5 U |
| Dibromochloromethane | 50 | 10 U | 20 U | 5 U | 5 U | 2 U | 10 U | 10 U | 5 U |
| Ethylbenzene | 5 | 10 U | 20 U | 5 U | 5 U | 2 U | 10 U | 10 U | 5 U |
| Methyl Ethyl Ketone | 50 | 20 U | 40 U | 10 U | 10 U | 8 U | 20 U | 20 U | 10 U |
| Methyl Isobutyl Ketone | | 20 U | 40 U | 10 U | 10 U | 8 U | 20 U | 9.7 J | 10 U |
| Methylene Chloride | 5 | 2.5 J B | 3.4 J B | 5 U | 5 U | 8 U | 10 U | 4 J B | 5 U |
| Styrene | 5 | 10 U | 20 U | 5 U | 5 U | 2 U | 10 U | 10 U | 5 U |
| Tetrachloroethene | 5 | 10 U | 20 U | 5 U | 5 U | 2 U* | 10 U | 10 U | 5 U |
| Toluene | 5 | 10 U | 20 U | 5 U | 5 U | 2 U* | 10 U | 10 U | 5 U |
| trans-1,2-Dichloroethene | 5 | 10 U | 20 U | 5 U | 5 U | 2 U | 10 U | 10 U | 5 U |
| trans-1,3-Dichloropropene | 0.4 | 10 U | 20 U | 5 U | 5 U | 2 U | 10 U | 10 U | 5 U |
| Trichloroethene | 5 | 40 | 62 | 53 | 54 | 61 | 51 | 55 | 39 |
| Vinyl chloride | 2 | 6.7 J | 6.4 J | 8.9 | 6.4 | 8.7 | 6.2 J | 7.8 J | 5.5 |
| Xylenes, Total | 5 | 10 U | 20 U | 5 U | 5 U | 4 U | 10 U | 10 U | 5 U |
| Total VOCs | | 258 | 400 | 328 | 330 | 408 | 316 | 355 | 230 |

Notes

- Concentration exceeds corresponding NYSDEC Class GA Standard.
- U - Not detected at the indicated concentration.
- J - Estimated concentration.
- M - Manual integrated compound.
- B - Analyte found in associated blank as well as the sample.
- E - Concentration exceeds instrument calibration range.
- * - MS or MSD exceeded control limits.

**TABLE 3-3
SUMMARY OF GROUNDWATER TREATMENT SYSTEM VOCS (EFFLUENT)
VESTAL WATER SUPPLY
VESTAL, NEW YORK
NYSDEC SITE #7-04-009A**

| Sample ID Sampling Date Matrix Units | NYSDEC GA Standard ug/L | WELL 1A-EFF 7/27/2007 WATER ug/L | WELL 1A-EFF 8/27/2007 WATER ug/L | WELL 1A-EFF 9/26/2007 WATER ug/L | WELL 1A-EFF 10/26/2007 WATER ug/L | WELL 1A-EFF 11/27/2007 WATER ug/L | WELL 1A-EFF 12/20/2007 WATER ug/L | WELL 1A-EFF 1/23/2008 WATER ug/L | WELL 1A-EFF 2/26/2008 WATER ug/L | WELL 1A-EFF 3/27/2008 WATER ug/L | WELL 1A-EFF 4/22/2008 WATER ug/L | WELL 1A-EFF 5/20/2008 WATER ug/L | WELL 1A-EFF 6/27/2008 WATER ug/L |
|---|----------------------------------|---|---|---|--|--|--|---|---|---|---|---|---|
| 1,1,1-Trichloroethane | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| 1,1,2,2-Tetrachloroethane | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| 1,1,2-Trichloroethane | 1 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| 1,1-Dichloroethane | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| 1,1-Dichloroethene | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U* |
| 1,2-Dichloroethane | 0.6 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| 1,2-Dichloropropane | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| 2-Hexanone | | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U |
| Acetone | | 10 U | 10 U | 10 U | 10 U | 10 U | 10 UM | 10 U | 10 U | 10 U | 1.8 J | 1.2 JB | 10 U |
| Benzene | 1 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| Bromodichloromethane | 50 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U* | 5 U | 5 U | 5 U | 10 U | 5 U |
| Bromoform | | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| Bromomethane | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U* | 5 U | 5 U | 5 U | 10 U | 5 U |
| Carbon disulfide | | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U* | 5 U | 5 U | 5 U | 10 U | 5 U* |
| Carbon tetrachloride | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| Chlorobenzene | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| Chloroethane | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U* |
| Chloroform | 7 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| Chloromethane | | 5 U | 5 U | 5 U | 5 U* | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| cis-1,2-Dichloroethene | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 0.3 J | 5 U |
| cis-1,3-Dichloropropene | 0.4 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| Dibromochloromethane | 50 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| Ethylbenzene | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| Methyl Ethyl Ketone | 50 | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U |
| Methyl Isobutyl Ketone | | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U |
| Methylene Chloride | 5 | 5 U | 5 U | 5 U* | 5 U | 5 U | 0.38 JB | 5 U | 5 U | 1.2 JB | 5 U | 0.34 JB | 5 U |
| Styrene | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| Tetrachloroethene | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| Toluene | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| trans-1,2-Dichloroethene | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| trans-1,3-Dichloropropene | 0.4 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| Trichloroethene | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 1.1 J*B | 10 U | 5 U |
| Vinyl chloride | 2 | 5 U | 5 U | 5 U | 5 U* | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |
| Xylenes, Total | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 10 U | 5 U |

Notes

U - Not detected at the indicated concentration.

J - Estimated concentration.

M - Manual integrated compound.

B - Analyte found in associated blank as well as the sample.

* - MS or MSD exceeded control limits.

**TABLE 3-3
SUMMARY OF GROUNDWATER TREATMENT SYSTEM VOCS (EFFLUENT)
VESTAL WATER SUPPLY
VESTAL, NEW YORK
NYSDEC SITE #7-04-009A**

| Sample ID Sampling Date Matrix Units | NYSDEC GA Standard ug/L | WELL 1A-EFF 7/25/2008 WATER ug/L | WELL 1A-EFF 8/25/2008 WATER ug/L | WELL 1A-EFF 9/30/2008 WATER ug/L | WELL 1A-EFF 3/5/2009 WATER ug/L | WELL 1A-EFF 3/27/2009 WATER ug/L | WELL 1A-EFF 4/16/2009 WATER ug/L | WELL 1A-EFF 5/30/2009 WATER ug/L | WELL 1A-EFF 6/24/2009 WATER ug/L | WELL 1A-EFF 7/29/2009 WATER ug/L | WELL 1A-EFF 8/27/2009 WATER ug/L | WELL 1A-EFF 9/24/2009 WATER ug/L | WELL 1A-EFF 10/26/2009 WATER ug/L |
|---|----------------------------------|---|---|---|--|---|---|---|---|---|---|---|--|
| 1,1,1-Trichloroethane | 5 | 5 U | 5 U | 5 U | 1.5 J | 0.5 U | 5 U | 5 U | 5 U | 0.96 | 0.5 U | 5 U | 5 U |
| 1,1,2,2-Tetrachloroethane | 5 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U | 0.5 U | 0.5 U | 5 U | 5 U |
| 1,1,2-Trichloroethane | 1 | 5 U | 5 U | 5 U* | 5 U | 0.5 U | 5 U | 5 U | 5 U | 0.5 U | 0.5 U | 5 U | 5 U |
| 1,1-Dichloroethane | 5 | 5 U | 5 U | 5 U | 5 U | 0.27 J | 5 U | 5 U | 5 U | 0.5 U | 0.5 U | 5 U | 5 U |
| 1,1-Dichloroethene | 5 | 5 U | 5 U | 5 U | 5 U | 0.16 J* | 5 U | 5 U* | 5 U* | 0.5 U* | 0.5 U | 5 U | 5 U |
| 1,2-Dichloroethane | 0.6 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U | 0.5 U | 0.5 U | 5 U | 5 U |
| 1,2-Dichloropropane | 5 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U | 0.5 U | 0.5 U | 5 U | 5 U |
| 2-Hexanone | | 10 U | 10 U | 10 U | 10 U | 2 U | 10 U | 10 U | 10 U* | 2 U | 2 U | 10 U | 10 U |
| Acetone | | 1 J B | 10 U | 10 U | 1.1 J | 2 U* | 10 U* | 10 U | 10 U | 1.8 J B | 2 U | 10 U | 10 U |
| Benzene | 1 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U | 0.5 U | 0.5 U | 5 U | 5 U |
| Bromodichloromethane | 50 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U | 0.5 U | 0.5 U | 5 U | 5 U |
| Bromoform | | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U | 0.5 U | 0.5 U | 5 U | 5 U |
| Bromomethane | 5 | 5 U | 5 U | 5 U | 5 U | 1 U | 5 U | 5 U | 5 U | 1 U | 1 U | 5 U | 5 U |
| Carbon disulfide | | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U | 0.5 U | 0.5 U | 5 U | 5 U |
| Carbon tetrachloride | 5 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U | 0.5 U | 0.5 U | 5 U | 5 U |
| Chlorobenzene | 5 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U | 0.5 U | 0.5 U | 5 U | 5 U |
| Chloroethane | 5 | 5 U | 5 U | 5 U | 5 U | 1 U | 5 U | 5 U | 5 U | 1 U* | 1 U | 5 U | 5 U |
| Chloroform | 7 | 5 U | 5 U | 5 U* | 5 U | 0.5 U | 5 U | 5 U | 5 U | 0.5 U | 0.5 U | 5 U | 5 U |
| Chloromethane | | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U* | 0.5 U | 0.5 U | 5 U | 5 U |
| cis-1,2-Dichloroethene | 5 | 5 U | 5 U | 5 U | 5 U | 0.82 | 5 U | 5 U | 5 U | 0.45 J | 0.46 J | 5 U | 5 U |
| cis-1,3-Dichloropropene | 0.4 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U | 0.5 U | 0.5 U | 5 U | 5 U |
| Dibromochloromethane | 50 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U | 0.5 U | 0.5 U | 5 U | 5 U |
| Ethylbenzene | 5 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U | 0.5 U | 0.5 U | 5 U | 5 U |
| Methyl Ethyl Ketone | 50 | 10 U | 10 U | 10 U | 10 U | 2 U | 10 U | 10 U | 10 U | 2 U | 2 U | 10 U | 10 U |
| Methyl Isobutyl Ketone | | 10 U | 10 U | 10 U | 10 U | 2 U | 10 U | 10 U | 10 U | 2 U | 2 U | 10 U | 10 U |
| Methylene Chloride | 5 | 5 U | 5 U | 5 U | 5 U | 2 U | 5 U | 5 U | 5 U | 2 U | 2 U | 5 U | 5 U |
| Styrene | 5 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U | 0.5 U | 0.5 U | 5 U | 5 U |
| Tetrachloroethene | 5 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U | 0.5 U | 0.5 U | 5 U | 5 U |
| Toluene | 5 | 5 U | 5 U | 5 U | 5 U | 0.33 J | 5 U | 5 U | 5 U | 0.5 U | 0.5 U | 5 U | 5 U |
| trans-1,2-Dichloroethene | 5 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U* | 0.5 U* | 0.5 U | 5 U | 5 U |
| trans-1,3-Dichloropropene | 0.4 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U | 0.5 U | 0.5 U | 5 U | 5 U |
| Trichloroethene | 5 | 5 U | 5 U | 5 U | 5 U | 0.5 J | 5 U | 5 U | 5 U | 0.37 J | 0.29 J | 5 U | 5 U |
| Vinyl chloride | 2 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U | 0.5 U | 0.5 U | 5 U | 5 U |
| Xylenes, Total | 5 | 5 U | 5 U | 5 U | 5 U | 3.4 | 5 U | 5 U | 5 U | 1 U | 1 U | 5 U | 5 U |

Notes

U - Not detected at the indicated concentration.

J - Estimated concentration.

M - Manual integrated compound.

B - Analyte found in associated blank as well as the sample.

* - MS or MSD exceeded control limits.

**TABLE 3-3
SUMMARY OF GROUNDWATER TREATMENT SYSTEM VOCS (EFFLUENT)
VESTAL WATER SUPPLY
VESTAL, NEW YORK
NYSDEC SITE #7-04-009A**

| Sample ID Sampling Date Matrix Units | NYSDEC GA Standard ug/L | WELL 1A-EFF 11/20/2009 WATER ug/L | WELL 1A-EFF 12/23/2009 WATER ug/L | WELL 1A-EFF 2/5/2010 WATER ug/L | WELL 1A-EFF 2/23/2010 WATER ug/L | WELL 1A-EFF 3/15/2010 WATER ug/L | WELL 1A-EFF 4/19/2010 WATER ug/L | WELL 1A-EFF 5/25/2010 WATER ug/L | WELL 1A-EFF 8/20/2010 WATER ug/L | WELL 1A-EFF 9/17/2010 WATER ug/L | WELL 1A-EFF 10/22/2010 WATER ug/L | WELL 1A-EFF 11/23/2010 WATER ug/L | WELL 1A-EFF 12/29/2010 WATER ug/L |
|---|----------------------------------|--|--|--|---|---|---|---|---|---|--|--|--|
| 1,1,1-Trichloroethane | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 2.1 J | 5 U | 5 U | 5 U | 3 J |
| 1,1,2,2-Tetrachloroethane | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| 1,1,2-Trichloroethane | 1 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| 1,1-Dichloroethane | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| 1,1-Dichloroethene | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| 1,2-Dichloroethane | 0.6 | 5 U | 5 U | 5 U | 5 U | 5 U * | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| 1,2-Dichloropropane | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| 2-Hexanone | | 10 U | 10 U * | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U |
| Acetone | | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U |
| Benzene | 1 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| Bromodichloromethane | 50 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| Bromoform | | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| Bromomethane | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| Carbon disulfide | | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| Carbon tetrachloride | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| Chlorobenzene | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| Chloroethane | 5 | 5 U | 5 U | 5 U | 5 U | 5 U * | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| Chloroform | 7 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| Chloromethane | | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U * | 5 U * | 5 U | 5 U |
| cis-1,2-Dichloroethene | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 2 J | 5 U | 5 U | 5 U | 2.3 J |
| cis-1,3-Dichloropropene | 0.4 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| Dibromochloromethane | 50 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| Ethylbenzene | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| Methyl Ethyl Ketone | 50 | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U |
| Methyl Isobutyl Ketone | | 10 U | 10 U * | 10 U | 10 U | 10 U | 10 U | 10 U | 10 U * | 10 U | 10 U | 10 U | 10 U |
| Methylene Chloride | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| Styrene | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| Tetrachloroethene | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| Toluene | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| trans-1,2-Dichloroethene | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| trans-1,3-Dichloropropene | 0.4 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| Trichloroethene | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 0.67 J | 5 U | 5 U | 5 U | 1.4 J |
| Vinyl chloride | 2 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |
| Xylenes, Total | 5 | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U | 5 U |

Notes

U - Not detected at the indicated concentration.

J - Estimated concentration.

M - Manual integrated compound.

B - Analyte found in associated blank as well as the sample.

* - MS or MSD exceeded control limits.

**TABLE 3-3
SUMMARY OF GROUNDWATER TREATMENT SYSTEM VOCS (EFFLUENT)
VESTAL WATER SUPPLY
VESTAL, NEW YORK
NYSDEC SITE #7-04-009A**

| Sample ID Sampling Date Matrix Units | NYSDEC GA Standard ug/L | WELL 1A-EFF 1/28/2011 WATER ug/L | WELL 1A-EFF 2/28/2011 WATER ug/L | WELL 1A-EFF 3/29/2011 WATER ug/L | WELL 1A-EFF 5/26/2011 WATER ug/L | WELL 1A-EFF 6/16/2011 WATER ug/L | WELL 1A-EFF 7/26/2011 WATER ug/L | WELL 1A-EFF 8/18/2011 WATER ug/L | WELL 1A-EFF 9/29/2011 WATER ug/L |
|---|----------------------------------|---|---|---|---|---|---|---|---|
| 1,1,1-Trichloroethane | 5 | 5 U | 5 U | 5 U | 5 U | 0.99 | 5 U | 5 U | 5 U |
| 1,1,2,2-Tetrachloroethane | 5 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| 1,1,2-Trichloroethane | 1 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| 1,1-Dichloroethane | 5 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| 1,1-Dichloroethene | 5 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| 1,2-Dichloroethane | 0.6 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| 1,2-Dichloropropane | 5 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| 2-Hexanone | | 10 U | 10 U | 10 U | 10 U | 2 U | 10 U | 10 U | 10 U |
| Acetone | | 10 U | 10 U | 10 U | 10 U | 2 U | 10 U | 10 U | 10 U |
| Benzene | 1 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| Bromodichloromethane | 50 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| Bromoform | | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| Bromomethane | 5 | 5 U | 5 U | 5 U | 5 U | 1 U | 5 U | 5 U | 5 U |
| Carbon disulfide | | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| Carbon tetrachloride | 5 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U* | 5 U |
| Chlorobenzene | 5 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| Chloroethane | 5 | 5 U | 5 U | 5 U | 5 U | 1 U | 5 U | 5 U | 5 U |
| Chloroform | 7 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| Chloromethane | | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| cis-1,2-Dichloroethene | 5 | 5 U | 5 U | 5 U | 5 U | 0.32 J | 5 U | 5 U | 5 U |
| cis-1,3-Dichloropropene | 0.4 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| Dibromochloromethane | 50 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| Ethylbenzene | 5 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| Methyl Ethyl Ketone | 50 | 10 U | 10 U | 10 U | 10 U | 2 U | 10 U | 10 U | 10 U |
| Methyl Isobutyl Ketone | | 10 U | 10 U | 10 U | 10 U | 2 U | 10 U | 10 U | 10 U |
| Methylene Chloride | 5 | 5 U | 5 U | 5 U | 5 U | 2 U | 5 U | 5 U | 5 U |
| Styrene | 5 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| Tetrachloroethene | 5 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| Toluene | 5 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| trans-1,2-Dichloroethene | 5 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| trans-1,3-Dichloropropene | 0.4 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| Trichloroethene | 5 | 5 U | 5 U | 5 U | 5 U | 0.19 J | 5 U | 5 U | 5 U |
| Vinyl chloride | 2 | 5 U | 5 U | 5 U | 5 U | 0.5 U | 5 U | 5 U | 5 U |
| Xylenes, Total | 5 | 5 U | 5 U | 5 U | 5 U | 1 U | 5 U | 5 U | 5 U |

Notes

U - Not detected at the indicated concentration.

J - Estimated concentration.

M - Manual integrated compound.

B - Analyte found in associated blank as well as the sample.

* - MS or MSD exceeded control limits.

Appendix A

Monthly Reports and System
Operation and Maintenance Logs



ENVIRONMENTAL COMPLIANCE, INC.

101 Mount Bethel Rd.
Warren, New Jersey 07059
908-754-1700
908-754-1866 (fax)
<http://www.eci-nj.com>
j.jimenez@eci-nj.com (email)

**Vestal Well 1-1 Monthly Report
July 2011**

SECTION I – SUMMARY OF ACTIVITIES

System went down three times during month due to power disruptions caused by thunderstorms. System was restarted by following day in each instance. Otherwise system operated continuously without any issues. Actual flow meter recordings ranged between 257 GPM at beginning of month and 250 GPM at end of the month.

SECTION II – MONTHLY OPERATIONS & MAINTENANCE

- Checked and adjusted belts
- Lubricated equipment, as needed
- Routine inspection of site
- Cleaned up grounds
- Mowed and trimmed lawn

SECTION III – REPAIR WORK COMPLETED

- None

SECTION IV – REPAIR WORK NEEDED

- None

SECTION V – RECOMMENDATIONS

- None



ENVIRONMENTAL COMPLIANCE, INC.

101 Mount Bethel Rd.
Warren, New Jersey 07059
908-754-1700
908-754-1866 (fax)
<http://www.eci-nj.com>
j.jimenez@eci-nj.com (email)

**Vestal Well 1-1 Monthly Report
August 2011**

SECTION I – SUMMARY OF ACTIVITIES

System operated continuously entire month except for two (2) days down due to flooding. Actual flow meter recordings ranged between 238 GPM and 251 GPM.

SECTION II – MONTHLY OPERATIONS & MAINTENANCE

- Checked and adjusted belts
- Lubricated equipment, as needed
- Routine inspection of site
- Cleaned up grounds
- Mowed and trimmed lawn

SECTION III – REPAIR WORK COMPLETED

- None

SECTION IV – REPAIR WORK NEEDED

- None

SECTION V – RECOMMENDATIONS

- None



ENVIRONMENTAL COMPLIANCE, INC.

101 Mount Bethel Rd.
Warren, New Jersey 07059
908-754-1700
908-754-1866 (fax)
<http://www.eci-nj.com>
j.jimenez@eci-nj.com (email)

**Vestal Well 1-1 Monthly Report
September 2011**

SECTION I – SUMMARY OF ACTIVITIES

System was down for five (5) days due to flooding caused by heavy rains. Basement was flooded with approximately 40 inches of water which was pumped out by Richard Green. NYSDEC cut off lock from gate and installed pumps on site. Lock was replaced by Jeremy Wyckoff. Rest of time system operated without issues at a rate of 230 GPM to 242 GPM.

SECTION II – MONTHLY OPERATIONS & MAINTENANCE

- Checked and adjusted belts
- Lubricated equipment, as needed
- Routine inspection of site
- Cleaned up grounds
- Mowed and trimmed lawn
- Pumped out water in basement

SECTION III – REPAIR WORK COMPLETED

- None

SECTION IV – REPAIR WORK NEEDED

- None

SECTION V – RECOMMENDATIONS

- None

ENVIRONMENTAL COMPLIANCE, INC.

VESTAL WELL 1-1 MONTHLY O & M LOG

July 2011

| DAY TIME | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
|--------------------------|---|---|---|-----|---|---|---|---|---|----|-----|----|----|----|----|----|----|----|----|----|-----|----|----|----|----|----|-----|----|----|----|----|
| WELL HOUSE | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | | X | X | X | X | X | X | X | |
| PRE LUBE LINE | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| PUMP MOTOR OIL | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| CHEMICAL BUILDING | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SUMP PUMP | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | |
| DISCHARGE VALVES | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | |
| FLOW METER (GPM)* | | | | 257 | | | | | | | 255 | | | | | | | | | | 253 | | | | | | 250 | | | | |
| CHLORINE ROOM | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| GENERAL CONDITION | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | |
| TOWER PACKING INSP. | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | |
| MAIN PUMPHOUSE | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| BLOWER AND MOTOR | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | |
| BLOWER AIR FILTERS | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | |
| ALARM / CONTROL PANEL | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | |
| CLEARWELL LEVEL | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | |
| OTHER* | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| GROUNDS | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | |
| INGROUND TANK LEVEL | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | |

*Unadjusted Meter Reading

| ENVIRONMENTAL COMPLIANCE, INC. | | | VESTAL WELL 1-1 MONTHLY O & M LOG | | | | | | | | | | | | | | | | | | August 2011 | | | | | | | | | | |
|--------------------------------|---|---|-----------------------------------|-----|---|---|---|---|---|----|----|----|-----|----|----|----|----|----|----|----|-------------|----|----|----|----|----|----|----|----|-----|----|
| DAY | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
| TIME | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| WELL HOUSE | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X |
| PRE LUBE LINE | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| PUMP MOTOR OIL | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| CHEMICAL BUILDING | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SUMP PUMP | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X |
| DISCHARGE VALVES | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X |
| FLOW METER (GPM)* | | | | 243 | | | | | | | | | 240 | | | | | | | | 238 | | | | | | | | | 251 | |
| CHLORINE ROOM | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| GENERAL CONDITION | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X |
| TOWER PACKING INSP. | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X |
| MAIN PUMPHOUSE | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| BLOWER AND MOTOR | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X |
| BLOWER AIR FILTERS | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X |
| ALARM / CONTROL PANEL | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X |
| CLEARWELL LEVEL | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X |
| OTHER* | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| GROUNDS | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X |
| INGROUND TANK LEVEL | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X |

*Unadjusted Meter Reading

ENVIRONMENTAL COMPLIANCE, INC.

VESTAL WELL 1-1 MONTHLY O & M LOG

September 2011

| DAY TIME | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
|--------------------------|---|-----|---|---|---|---|---|---|-----|----|----|----|----|----|-----|----|----|----|----|----|----|----|----|----|----|----|-----|----|----|----|----|
| WELL HOUSE | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | |
| PRE LUBE LINE | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| PUMP MOTOR OIL | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| CHEMICAL BUILDING | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SUMP PUMP | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | |
| DISCHARGE VALVES | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | |
| FLOW METER (GPM)* | | 232 | | | | | | | 230 | | | | | | 232 | | | | | | | | | | | | 242 | | | | |
| CHLORINE ROOM | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| GENERAL CONDITION | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | |
| TOWER PACKING INSP. | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | |
| MAIN PUMPHOUSE | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| BLOWER AND MOTOR | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | |
| BLOWER AIR FILTERS | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | |
| ALARM / CONTROL PANEL | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | |
| CLEARWELL LEVEL | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | |
| OTHER* | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| GROUNDS | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | |
| INGROUND TANK LEVEL | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | X | | X | X | X | X | X | |

*Unadjusted Meter Reading

Appendix B

Analytical Reporting Forms

ANALYTICAL REPORT

Job Number: 220-16116-1

Job Description: NYSDEC Standby - Vestal Water Supply

For:


Malcolm Pirnie, Inc.

855 Route 146

Suite 210

Clifton Park, NY 12065

Attention: Mr. Jeremy Wyckoff

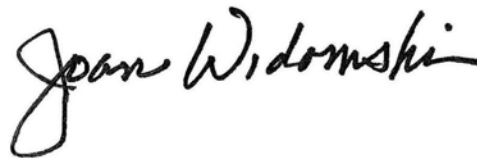

Approved for release.
Joan Widomski
Project Manager I
8/8/2011 3:46 PM

Designee for
Jackie Trudell
Project Manager I
jackie.trudell@testamericainc.com
08/08/2011

The test results in this report meet all NELAP requirements unless specified within the case narrative. Pursuant to NELAP, this report may not be reproduced, except in full, without the written approval of the laboratory. All questions regarding this report should be directed to the TestAmerica Project Manager.

TestAmerica Connecticut Certifications and Approvals: CTDOH PH-047, MADEP CT023, RIDOH A43, NYDOH 10602, NY NELAP 10602, NHDES 2528, NJDEP CT410, ME DOH CT023, UT DOH 2032614458

TestAmerica Laboratories, Inc.

TestAmerica Connecticut 128 Long Hill Cross Road, Shelton, CT 06484

Tel (203) 929-8140 Fax (203) 929-8142 www.testamericainc.com



Job Number: 220-16116-1

Job Description: NYSDEC Standby - Vestal Water Supply

I certify that this data package is in compliance with the terms and conditions of the contract, both technically and for completeness, for other than the conditions detailed within the body of this report. Release of the data contained in this sample data package and in the electronic data deliverable has been authorized by the Laboratory Manager or his/her designee, as verified by the following signature.



Approved for release.
Joan Widomski
Project Manager I
8/8/2011 3:46 PM

Designee for
Jackie Trudell

Table of Contents

| | |
|--------------------------------------|-----|
| Cover Title Page | 1 |
| Data Summaries | 5 |
| Report Narrative | 5 |
| Sample Calculation Summary | 6 |
| Sample Summary | 7 |
| Executive Summary | 8 |
| Method Summary | 9 |
| Method / Analyst Summary | 10 |
| Sample Datasheets | 11 |
| Surrogate Summary | 14 |
| QC Data Summary | 15 |
| Data Qualifiers | 19 |
| QC Association Summary | 20 |
| Lab Chronicle | 21 |
| Organic Sample Data | 22 |
| GC/MS VOA | 22 |
| Method 8260B | 22 |
| Method 8260B QC Summary | 23 |
| Method 8260B Sample Data | 32 |
| Standards Data | 51 |
| Method 8260B ICAL Data | 51 |
| Method 8260B CCAL Data | 182 |
| Raw QC Data | 192 |
| Method 8260B Tune Data | 192 |
| Method 8260B Blank Data | 202 |
| Method 8260B LCS/LCSD Data | 212 |

Table of Contents

| | |
|--|-----|
| Method 8260B Run Logs | 227 |
| Shipping and Receiving Documents | 229 |
| Client Chain of Custody | 230 |
| Sample Receipt Checklist | 231 |

Job Narrative
220-16116-1

Comments

No additional comments.

Receipt

All samples were received in good condition within temperature requirements.

GC/MS VOA

No analytical or quality issues were noted.

FORMULAS FOR NYSDEC SAMPLE CALCULATIONS

Volatiles

$$\frac{(AX)(IS)(DF)}{(AIS)(RRF)(V)(\% \text{ solids})} = C$$

$$\frac{(AX)(IS)(VT)(1000)(DF)}{(AIS)(RRF)(VA)(V)(\% \text{ solids})} = C \quad (\text{for medium level soils})$$

SemiVolatiles

$$\frac{(AX)(IS)(VE)(DF)(\text{GPC factor is 2 if needed})}{(AIS)(RRF)(\text{volume injected})(V)(\% \text{ solids})} = C$$

Pesticides

$$\frac{(AX)(VE)(DF)}{(RRF)(V)(\% \text{ solids})(\text{volume injected})} = C$$

PCBs for compound/retention time

$$\frac{(AX)(VE)(DF)}{(\text{RRF of compound at the stated retention time})(V)(\% \text{ solids})(\text{volume injected})} = C$$

DRO/CTETPH

$$\frac{(AX)(VE)(DF)}{(RRF)(V)(\% \text{ solids})(\text{volume injected})} = C$$

AX = area of the target Ion

AIS = Area of Internal standard

C = concentration as ug/L or ug/Kg

DF = dilution

IS = Internal standard concentration (ng)

RRF = average RF (from initial cal except CLP methods from continuing cal)

V = sample volume for liquids in mls or sample weight for solids in grams

VA = volume of aliquot for medium level soils

VE = volume of concentrated extract

VT = volume of methanol for volatile medium level soils

SAMPLE SUMMARY

Client: Malcolm Pirnie, Inc.

Job Number: 220-16116-1

| Lab Sample ID | Client Sample ID | Client Matrix | Date/Time Sampled | Date/Time Received |
|----------------------|-------------------------|----------------------|------------------------------|-------------------------------|
| 220-16116-1 | Well 1-1A EFF | Water | 07/26/2011 0945 | 07/27/2011 0950 |
| 220-16116-2 | Well 1-1A INF | Water | 07/26/2011 0950 | 07/27/2011 0950 |
| 220-16116-3TB | Trip Blank | Water | 07/26/2011 0945 | 07/27/2011 0950 |

EXECUTIVE SUMMARY - Detections

Client: Malcolm Pirnie, Inc.

Job Number: 220-16116-1

| Lab Sample ID Analyte | Client Sample ID | Result | Qualifier | Reporting Limit | Units | Method |
|--------------------------|----------------------|--------|-----------|--------------------|-------|--------|
| 220-16116-2 | WELL 1-1A INF | | | | | |
| 1,1-Dichloroethane | | 20 | | 10 | ug/L | 8260B |
| 1,1-Dichloroethene | | 13 | | 10 | ug/L | 8260B |
| 1,1,1-Trichloroethane | | 180 | | 10 | ug/L | 8260B |
| Trichloroethene | | 51 | | 10 | ug/L | 8260B |
| Vinyl chloride | | 6.2 | J | 10 | ug/L | 8260B |
| cis-1,2-Dichloroethene | | 46 | | 10 | ug/L | 8260B |
| 220-16116-3TB | TRIP BLANK | | | | | |
| Methylene Chloride | | 1.9 | J B | 5.0 | ug/L | 8260B |

METHOD SUMMARY

Client: Malcolm Pirnie, Inc.

Job Number: 220-16116-1

| Description | Lab Location | Method | Preparation Method |
|------------------------------------|---------------------|---------------|---------------------------|
| Matrix: Water | | | |
| Volatile Organic Compounds (GC/MS) | TAL CT | SW846 8260B | |
| Purge and Trap | TAL CT | | SW846 5030B |

Lab References:

TAL CT = TestAmerica Connecticut

Method References:

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

METHOD / ANALYST SUMMARY

Client: Malcolm Pirnie, Inc.

Job Number: 220-16116-1

| Method | Analyst | Analyst ID |
|---------------|----------------------|-------------------|
| SW846 8260B | Kostrzewska, Barbara | BK |

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 220-16116-1

Client Sample ID: Well 1-1A EFF

Lab Sample ID: 220-16116-1

Date Sampled: 07/26/2011 0945

Client Matrix: Water

Date Received: 07/27/2011 0950

8260B Volatile Organic Compounds (GC/MS)

| | | |
|--------------------------------|---------------------------|-----------------------------|
| Analysis Method: 8260B | Analysis Batch: 220-53407 | Instrument ID: MSV |
| Prep Method: 5030B | Prep Batch: N/A | Lab File ID: V2555.D |
| Dilution: 1.0 | | Initial Weight/Volume: 5 mL |
| Analysis Date: 07/28/2011 0251 | | Final Weight/Volume: 5 mL |
| Prep Date: 07/28/2011 0251 | | |

| Analyte | Result (ug/L) | Qualifier | MDL | RL |
|---------------------------|---------------|-----------|------|-----|
| Acetone | 10 | U | 1.0 | 10 |
| Benzene | 5.0 | U | 0.74 | 5.0 |
| Bromodichloromethane | 5.0 | U | 0.48 | 5.0 |
| Bromoform | 5.0 | U | 0.46 | 5.0 |
| Bromomethane | 5.0 | U | 2.1 | 5.0 |
| Methyl Ethyl Ketone | 10 | U | 1.1 | 10 |
| Carbon disulfide | 5.0 | U | 0.90 | 5.0 |
| Carbon tetrachloride | 5.0 | U | 1.1 | 5.0 |
| Chlorobenzene | 5.0 | U | 0.72 | 5.0 |
| Chloroethane | 5.0 | U | 1.1 | 5.0 |
| Chloroform | 5.0 | U | 0.67 | 5.0 |
| Chloromethane | 5.0 | U | 1.1 | 5.0 |
| Dibromochloromethane | 5.0 | U | 0.55 | 5.0 |
| 1,1-Dichloroethane | 5.0 | U | 1.0 | 5.0 |
| 1,2-Dichloroethane | 5.0 | U | 0.72 | 5.0 |
| 1,1-Dichloroethene | 5.0 | U | 0.83 | 5.0 |
| 1,2-Dichloropropane | 5.0 | U | 0.71 | 5.0 |
| cis-1,3-Dichloropropene | 5.0 | U | 0.28 | 5.0 |
| trans-1,3-Dichloropropene | 5.0 | U | 0.57 | 5.0 |
| Ethylbenzene | 5.0 | U | 0.87 | 5.0 |
| 2-Hexanone | 10 | U | 1.1 | 10 |
| Methylene Chloride | 5.0 | U | 0.78 | 5.0 |
| methyl isobutyl ketone | 10 | U | 0.38 | 10 |
| Styrene | 5.0 | U | 0.64 | 5.0 |
| 1,1,2,2-Tetrachloroethane | 5.0 | U | 0.81 | 5.0 |
| Tetrachloroethene | 5.0 | U | 0.81 | 5.0 |
| Toluene | 5.0 | U | 0.72 | 5.0 |
| 1,1,1-Trichloroethane | 5.0 | U | 0.69 | 5.0 |
| 1,1,2-Trichloroethane | 5.0 | U | 0.65 | 5.0 |
| Trichloroethene | 5.0 | U | 0.62 | 5.0 |
| Vinyl chloride | 5.0 | U | 0.99 | 5.0 |
| Xylenes, Total | 5.0 | U | 2.3 | 5.0 |
| cis-1,2-Dichloroethene | 5.0 | U | 0.99 | 5.0 |
| trans-1,2-Dichloroethene | 5.0 | U | 0.76 | 5.0 |

| Surrogate | %Rec | Qualifier | Acceptance Limits |
|------------------------------|------|-----------|-------------------|
| 1,2-Dichloroethane-d4 (Surr) | 85 | | 65 - 136 |
| 4-Bromofluorobenzene | 93 | | 51 - 142 |
| Dibromofluoromethane | 85 | | 68 - 132 |
| Toluene-d8 (Surr) | 81 | | 63 - 127 |

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 220-16116-1

Client Sample ID: Well 1-1A INF

Lab Sample ID: 220-16116-2

Date Sampled: 07/26/2011 0950

Client Matrix: Water

Date Received: 07/27/2011 0950

8260B Volatile Organic Compounds (GC/MS)

| | | | | | |
|------------------|-----------------|-----------------|-----------|------------------------|---------|
| Analysis Method: | 8260B | Analysis Batch: | 220-53443 | Instrument ID: | MSV |
| Prep Method: | 5030B | Prep Batch: | N/A | Lab File ID: | V2586.D |
| Dilution: | 2.0 | | | Initial Weight/Volume: | 5 mL |
| Analysis Date: | 07/28/2011 2216 | | | Final Weight/Volume: | 5 mL |
| Prep Date: | 07/28/2011 2216 | | | | |

| Analyte | Result (ug/L) | Qualifier | MDL | RL |
|---------------------------|---------------|-----------|------|----|
| Acetone | 20 | U | 2.1 | 20 |
| Benzene | 10 | U | 1.5 | 10 |
| Bromodichloromethane | 10 | U | 0.96 | 10 |
| Bromoform | 10 | U | 0.92 | 10 |
| Bromomethane | 10 | U | 4.2 | 10 |
| Methyl Ethyl Ketone | 20 | U | 2.2 | 20 |
| Carbon disulfide | 10 | U | 1.8 | 10 |
| Carbon tetrachloride | 10 | U | 2.1 | 10 |
| Chlorobenzene | 10 | U | 1.4 | 10 |
| Chloroethane | 10 | U | 2.1 | 10 |
| Chloroform | 10 | U | 1.3 | 10 |
| Chloromethane | 10 | U | 2.2 | 10 |
| Dibromochloromethane | 10 | U | 1.1 | 10 |
| 1,1-Dichloroethane | 20 | | 2.1 | 10 |
| 1,2-Dichloroethane | 10 | U | 1.4 | 10 |
| 1,1-Dichloroethene | 13 | | 1.7 | 10 |
| 1,2-Dichloropropane | 10 | U | 1.4 | 10 |
| cis-1,3-Dichloropropene | 10 | U | 0.56 | 10 |
| trans-1,3-Dichloropropene | 10 | U | 1.1 | 10 |
| Ethylbenzene | 10 | U | 1.7 | 10 |
| 2-Hexanone | 20 | U | 2.2 | 20 |
| Methylene Chloride | 10 | U | 1.6 | 10 |
| methyl isobutyl ketone | 20 | U | 0.76 | 20 |
| Styrene | 10 | U | 1.3 | 10 |
| 1,1,2,2-Tetrachloroethane | 10 | U | 1.6 | 10 |
| Tetrachloroethene | 10 | U | 1.6 | 10 |
| Toluene | 10 | U | 1.4 | 10 |
| 1,1,1-Trichloroethane | 180 | | 1.4 | 10 |
| 1,1,2-Trichloroethane | 10 | U | 1.3 | 10 |
| Trichloroethene | 51 | | 1.2 | 10 |
| Vinyl chloride | 6.2 | J | 2.0 | 10 |
| Xylenes, Total | 10 | U | 4.5 | 10 |
| cis-1,2-Dichloroethene | 46 | | 2.0 | 10 |
| trans-1,2-Dichloroethene | 10 | U | 1.5 | 10 |

| Surrogate | %Rec | Qualifier | Acceptance Limits |
|------------------------------|------|-----------|-------------------|
| 1,2-Dichloroethane-d4 (Surr) | 84 | | 65 - 136 |
| 4-Bromofluorobenzene | 86 | | 51 - 142 |
| Dibromofluoromethane | 79 | | 68 - 132 |
| Toluene-d8 (Surr) | 77 | | 63 - 127 |

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 220-16116-1

Client Sample ID: Trip Blank

Lab Sample ID: 220-16116-3TB

Date Sampled: 07/26/2011 0945

Client Matrix: Water

Date Received: 07/27/2011 0950

8260B Volatile Organic Compounds (GC/MS)

| | | | | | |
|------------------|-----------------|-----------------|-----------|------------------------|---------|
| Analysis Method: | 8260B | Analysis Batch: | 220-53407 | Instrument ID: | MSV |
| Prep Method: | 5030B | Prep Batch: | N/A | Lab File ID: | V2546.D |
| Dilution: | 1.0 | | | Initial Weight/Volume: | 5 mL |
| Analysis Date: | 07/27/2011 2246 | | | Final Weight/Volume: | 5 mL |
| Prep Date: | 07/27/2011 2246 | | | | |

| Analyte | Result (ug/L) | Qualifier | MDL | RL |
|---------------------------|---------------|-----------|------|-----|
| Acetone | 10 | U | 1.0 | 10 |
| Benzene | 5.0 | U | 0.74 | 5.0 |
| Bromodichloromethane | 5.0 | U | 0.48 | 5.0 |
| Bromoform | 5.0 | U | 0.46 | 5.0 |
| Bromomethane | 5.0 | U | 2.1 | 5.0 |
| Methyl Ethyl Ketone | 10 | U | 1.1 | 10 |
| Carbon disulfide | 5.0 | U | 0.90 | 5.0 |
| Carbon tetrachloride | 5.0 | U | 1.1 | 5.0 |
| Chlorobenzene | 5.0 | U | 0.72 | 5.0 |
| Chloroethane | 5.0 | U | 1.1 | 5.0 |
| Chloroform | 5.0 | U | 0.67 | 5.0 |
| Chloromethane | 5.0 | U | 1.1 | 5.0 |
| Dibromochloromethane | 5.0 | U | 0.55 | 5.0 |
| 1,1-Dichloroethane | 5.0 | U | 1.0 | 5.0 |
| 1,2-Dichloroethane | 5.0 | U | 0.72 | 5.0 |
| 1,1-Dichloroethene | 5.0 | U | 0.83 | 5.0 |
| 1,2-Dichloropropane | 5.0 | U | 0.71 | 5.0 |
| cis-1,3-Dichloropropene | 5.0 | U | 0.28 | 5.0 |
| trans-1,3-Dichloropropene | 5.0 | U | 0.57 | 5.0 |
| Ethylbenzene | 5.0 | U | 0.87 | 5.0 |
| 2-Hexanone | 10 | U | 1.1 | 10 |
| Methylene Chloride | 1.9 | J B | 0.78 | 5.0 |
| methyl isobutyl ketone | 10 | U | 0.38 | 10 |
| Styrene | 5.0 | U | 0.64 | 5.0 |
| 1,1,2,2-Tetrachloroethane | 5.0 | U | 0.81 | 5.0 |
| Tetrachloroethene | 5.0 | U | 0.81 | 5.0 |
| Toluene | 5.0 | U | 0.72 | 5.0 |
| 1,1,1-Trichloroethane | 5.0 | U | 0.69 | 5.0 |
| 1,1,2-Trichloroethane | 5.0 | U | 0.65 | 5.0 |
| Trichloroethene | 5.0 | U | 0.62 | 5.0 |
| Vinyl chloride | 5.0 | U | 0.99 | 5.0 |
| Xylenes, Total | 5.0 | U | 2.3 | 5.0 |
| cis-1,2-Dichloroethene | 5.0 | U | 0.99 | 5.0 |
| trans-1,2-Dichloroethene | 5.0 | U | 0.76 | 5.0 |

| Surrogate | %Rec | Qualifier | Acceptance Limits |
|------------------------------|------|-----------|-------------------|
| 1,2-Dichloroethane-d4 (Surr) | 83 | | 65 - 136 |
| 4-Bromofluorobenzene | 87 | | 51 - 142 |
| Dibromofluoromethane | 84 | | 68 - 132 |
| Toluene-d8 (Surr) | 85 | | 63 - 127 |

Client: Malcolm Pirnie, Inc.

Job Number: 220-16116-1

Surrogate Recovery Report

8260B Volatile Organic Compounds (GC/MS)

Client Matrix: Water

| Lab Sample ID | Client Sample ID | DBFM %Rec | DCA %Rec | TOL %Rec | BFB %Rec |
|------------------|------------------|--------------|-------------|-------------|-------------|
| 220-16116-1 | Well 1-1A EFF | 85 | 85 | 81 | 93 |
| 220-16116-2 | Well 1-1A INF | 79 | 84 | 77 | 86 |
| 220-16116-3 | Trip Blank | 84 | 83 | 85 | 87 |
| MB 220-53407/11 | | 88 | 83 | 87 | 88 |
| MB 220-53443/3 | | 82 | 86 | 78 | 88 |
| LCS 220-53407/10 | | 85 | 80 | 85 | 87 |
| LCS 220-53443/2 | | 79 | 84 | 86 | 92 |

| Surrogate | Acceptance Limits |
|------------------------------------|-------------------|
| DBFM = Dibromofluoromethane | 68-132 |
| DCA = 1,2-Dichloroethane-d4 (Surr) | 65-136 |
| TOL = Toluene-d8 (Surr) | 63-127 |
| BFB = 4-Bromofluorobenzene | 51-142 |

Quality Control Results

Client: Malcolm Pirnie, Inc.

Job Number: 220-16116-1

Method Blank - Batch: 220-53407

**Method: 8260B
Preparation: 5030B**

Lab Sample ID: MB 220-53407/11
 Client Matrix: Water
 Dilution: 1.0
 Analysis Date: 07/27/2011 2219
 Prep Date: 07/27/2011 2219
 Leach Date: N/A

Analysis Batch: 220-53407
 Prep Batch: N/A
 Leach Batch: N/A
 Units: ug/L

Instrument ID: MSV
 Lab File ID: V2545.D
 Initial Weight/Volume: 5 mL
 Final Weight/Volume: 5 mL

| Analyte | Result | Qual | MDL | RL |
|---------------------------|--------|------|------|-----|
| Acetone | 10 | U | 1.0 | 10 |
| Benzene | 5.0 | U | 0.74 | 5.0 |
| Bromodichloromethane | 5.0 | U | 0.48 | 5.0 |
| Bromoform | 5.0 | U | 0.46 | 5.0 |
| Bromomethane | 5.0 | U | 2.1 | 5.0 |
| Methyl Ethyl Ketone | 10 | U | 1.1 | 10 |
| Carbon disulfide | 5.0 | U | 0.90 | 5.0 |
| Carbon tetrachloride | 5.0 | U | 1.1 | 5.0 |
| Chlorobenzene | 5.0 | U | 0.72 | 5.0 |
| Chloroethane | 5.0 | U | 1.1 | 5.0 |
| Chloroform | 5.0 | U | 0.67 | 5.0 |
| Chloromethane | 5.0 | U | 1.1 | 5.0 |
| Dibromochloromethane | 5.0 | U | 0.55 | 5.0 |
| 1,1-Dichloroethane | 5.0 | U | 1.0 | 5.0 |
| 1,2-Dichloroethane | 5.0 | U | 0.72 | 5.0 |
| 1,1-Dichloroethene | 5.0 | U | 0.83 | 5.0 |
| 1,2-Dichloropropane | 5.0 | U | 0.71 | 5.0 |
| cis-1,3-Dichloropropene | 5.0 | U | 0.28 | 5.0 |
| trans-1,3-Dichloropropene | 5.0 | U | 0.57 | 5.0 |
| Ethylbenzene | 5.0 | U | 0.87 | 5.0 |
| 2-Hexanone | 10 | U | 1.1 | 10 |
| Methylene Chloride | 1.88 | J | 0.78 | 5.0 |
| methyl isobutyl ketone | 10 | U | 0.38 | 10 |
| Styrene | 5.0 | U | 0.64 | 5.0 |
| 1,1,2,2-Tetrachloroethane | 5.0 | U | 0.81 | 5.0 |
| Tetrachloroethene | 5.0 | U | 0.81 | 5.0 |
| Toluene | 5.0 | U | 0.72 | 5.0 |
| 1,1,1-Trichloroethane | 5.0 | U | 0.69 | 5.0 |
| 1,1,2-Trichloroethane | 5.0 | U | 0.65 | 5.0 |
| Trichloroethene | 5.0 | U | 0.62 | 5.0 |
| Vinyl chloride | 5.0 | U | 0.99 | 5.0 |
| Xylenes, Total | 5.0 | U | 2.3 | 5.0 |
| cis-1,2-Dichloroethene | 5.0 | U | 0.99 | 5.0 |
| trans-1,2-Dichloroethene | 5.0 | U | 0.76 | 5.0 |

| Surrogate | % Rec | Acceptance Limits |
|------------------------------|-------|-------------------|
| 1,2-Dichloroethane-d4 (Surr) | 83 | 65 - 136 |
| 4-Bromofluorobenzene | 88 | 51 - 142 |
| Dibromofluoromethane | 88 | 68 - 132 |
| Toluene-d8 (Surr) | 87 | 63 - 127 |

Quality Control Results

Client: Malcolm Pirnie, Inc.

Job Number: 220-16116-1

Lab Control Sample - Batch: 220-53407

**Method: 8260B
Preparation: 5030B**

| | | |
|---------------------------------|---------------------------|-----------------------------|
| Lab Sample ID: LCS 220-53407/10 | Analysis Batch: 220-53407 | Instrument ID: MSV |
| Client Matrix: Water | Prep Batch: N/A | Lab File ID: V2542.D |
| Dilution: 1.0 | Leach Batch: N/A | Initial Weight/Volume: 5 mL |
| Analysis Date: 07/27/2011 2057 | Units: ug/L | Final Weight/Volume: 5 mL |
| Prep Date: 07/27/2011 2057 | | |
| Leach Date: N/A | | |

| Analyte | Spike Amount | Result | % Rec. | Limit | Qual |
|------------------------------|--------------|--------|--------|-------------------|------|
| Acetone | 10.0 | 8.48 | 85 | 41 - 150 | J |
| Benzene | 10.0 | 10.6 | 106 | 66 - 131 | |
| Bromodichloromethane | 10.0 | 9.74 | 97 | 78 - 120 | |
| Bromoform | 10.0 | 9.49 | 95 | 66 - 120 | |
| Bromomethane | 10.0 | 8.31 | 83 | 47 - 150 | |
| Methyl Ethyl Ketone | 10.0 | 8.69 | 87 | 42 - 150 | J |
| Carbon disulfide | 10.0 | 9.82 | 98 | 55 - 150 | |
| Carbon tetrachloride | 10.0 | 10.9 | 109 | 69 - 135 | |
| Chlorobenzene | 10.0 | 9.67 | 97 | 68 - 120 | |
| Chloroethane | 10.0 | 11.0 | 110 | 49 - 150 | |
| Chloroform | 10.0 | 9.53 | 95 | 77 - 126 | |
| Chloromethane | 10.0 | 9.13 | 91 | 33 - 150 | |
| Dibromochloromethane | 10.0 | 9.10 | 91 | 75 - 120 | |
| 1,1-Dichloroethane | 10.0 | 9.70 | 97 | 75 - 130 | |
| 1,2-Dichloroethane | 10.0 | 9.60 | 96 | 73 - 127 | |
| 1,1-Dichloroethene | 10.0 | 11.1 | 111 | 65 - 142 | |
| 1,2-Dichloropropane | 10.0 | 9.68 | 97 | 69 - 129 | |
| cis-1,3-Dichloropropene | 10.0 | 9.60 | 96 | 63 - 120 | |
| trans-1,3-Dichloropropene | 10.0 | 9.50 | 95 | 73 - 120 | |
| Ethylbenzene | 10.0 | 10.3 | 103 | 62 - 120 | |
| 2-Hexanone | 10.0 | 8.25 | 83 | 46 - 150 | J |
| Methylene Chloride | 10.0 | 10.7 | 107 | 56 - 138 | |
| methyl isobutyl ketone | 10.0 | 9.21 | 92 | 70 - 122 | J |
| Styrene | 10.0 | 10.2 | 102 | 47 - 120 | |
| 1,1,2,2-Tetrachloroethane | 10.0 | 9.22 | 92 | 75 - 124 | |
| Tetrachloroethene | 10.0 | 9.04 | 90 | 50 - 120 | |
| Toluene | 10.0 | 10.0 | 100 | 66 - 120 | |
| 1,1,1-Trichloroethane | 10.0 | 9.78 | 98 | 73 - 135 | |
| 1,1,2-Trichloroethane | 10.0 | 11.3 | 113 | 76 - 125 | |
| Trichloroethene | 10.0 | 11.0 | 110 | 60 - 122 | |
| Vinyl chloride | 10.0 | 10.7 | 107 | 61 - 150 | |
| Xylenes, Total | 30.0 | 30.2 | 101 | 58 - 120 | |
| cis-1,2-Dichloroethene | 10.0 | 10.0 | 100 | 65 - 120 | |
| trans-1,2-Dichloroethene | 10.0 | 9.93 | 99 | 58 - 120 | |
| Surrogate | | % Rec | | Acceptance Limits | |
| 1,2-Dichloroethane-d4 (Surr) | | 80 | | 65 - 136 | |
| 4-Bromofluorobenzene | | 87 | | 51 - 142 | |
| Dibromofluoromethane | | 85 | | 68 - 132 | |
| Toluene-d8 (Surr) | | 85 | | 63 - 127 | |

Quality Control Results

Client: Malcolm Pirnie, Inc.

Job Number: 220-16116-1

Method Blank - Batch: 220-53443

**Method: 8260B
Preparation: 5030B**

Lab Sample ID: MB 220-53443/3
 Client Matrix: Water
 Dilution: 1.0
 Analysis Date: 07/28/2011 1312
 Prep Date: 07/28/2011 1312
 Leach Date: N/A

Analysis Batch: 220-53443
 Prep Batch: N/A
 Leach Batch: N/A
 Units: ug/L

Instrument ID: MSV
 Lab File ID: V2566.D
 Initial Weight/Volume: 5 mL
 Final Weight/Volume: 5 mL

| Analyte | Result | Qual | MDL | RL |
|---------------------------|--------|------|------|-----|
| Acetone | 10 | U | 1.0 | 10 |
| Benzene | 5.0 | U | 0.74 | 5.0 |
| Bromodichloromethane | 5.0 | U | 0.48 | 5.0 |
| Bromoform | 5.0 | U | 0.46 | 5.0 |
| Bromomethane | 5.0 | U | 2.1 | 5.0 |
| Methyl Ethyl Ketone | 10 | U | 1.1 | 10 |
| Carbon disulfide | 5.0 | U | 0.90 | 5.0 |
| Carbon tetrachloride | 5.0 | U | 1.1 | 5.0 |
| Chlorobenzene | 5.0 | U | 0.72 | 5.0 |
| Chloroethane | 5.0 | U | 1.1 | 5.0 |
| Chloroform | 5.0 | U | 0.67 | 5.0 |
| Chloromethane | 5.0 | U | 1.1 | 5.0 |
| Dibromochloromethane | 5.0 | U | 0.55 | 5.0 |
| 1,1-Dichloroethane | 5.0 | U | 1.0 | 5.0 |
| 1,2-Dichloroethane | 5.0 | U | 0.72 | 5.0 |
| 1,1-Dichloroethene | 5.0 | U | 0.83 | 5.0 |
| 1,2-Dichloropropane | 5.0 | U | 0.71 | 5.0 |
| cis-1,3-Dichloropropene | 5.0 | U | 0.28 | 5.0 |
| trans-1,3-Dichloropropene | 5.0 | U | 0.57 | 5.0 |
| Ethylbenzene | 5.0 | U | 0.87 | 5.0 |
| 2-Hexanone | 10 | U | 1.1 | 10 |
| Methylene Chloride | 0.911 | J | 0.78 | 5.0 |
| methyl isobutyl ketone | 10 | U | 0.38 | 10 |
| Styrene | 5.0 | U | 0.64 | 5.0 |
| 1,1,2,2-Tetrachloroethane | 5.0 | U | 0.81 | 5.0 |
| Tetrachloroethene | 5.0 | U | 0.81 | 5.0 |
| Toluene | 5.0 | U | 0.72 | 5.0 |
| 1,1,1-Trichloroethane | 5.0 | U | 0.69 | 5.0 |
| 1,1,2-Trichloroethane | 5.0 | U | 0.65 | 5.0 |
| Trichloroethene | 5.0 | U | 0.62 | 5.0 |
| Vinyl chloride | 5.0 | U | 0.99 | 5.0 |
| Xylenes, Total | 5.0 | U | 2.3 | 5.0 |
| cis-1,2-Dichloroethene | 5.0 | U | 0.99 | 5.0 |
| trans-1,2-Dichloroethene | 5.0 | U | 0.76 | 5.0 |

| Surrogate | % Rec | Acceptance Limits |
|------------------------------|-------|-------------------|
| 1,2-Dichloroethane-d4 (Surr) | 86 | 65 - 136 |
| 4-Bromofluorobenzene | 88 | 51 - 142 |
| Dibromofluoromethane | 82 | 68 - 132 |
| Toluene-d8 (Surr) | 78 | 63 - 127 |

Quality Control Results

Client: Malcolm Pirnie, Inc.

Job Number: 220-16116-1

Lab Control Sample - Batch: 220-53443

**Method: 8260B
Preparation: 5030B**

| | | | | | |
|----------------|-----------------|-----------------|-----------|------------------------|---------|
| Lab Sample ID: | LCS 220-53443/2 | Analysis Batch: | 220-53443 | Instrument ID: | MSV |
| Client Matrix: | Water | Prep Batch: | N/A | Lab File ID: | V2563.D |
| Dilution: | 1.0 | Leach Batch: | N/A | Initial Weight/Volume: | 5 mL |
| Analysis Date: | 07/28/2011 1150 | Units: | ug/L | Final Weight/Volume: | 5 mL |
| Prep Date: | 07/28/2011 1150 | | | | |
| Leach Date: | N/A | | | | |

| Analyte | Spike Amount | Result | % Rec. | Limit | Qual |
|------------------------------|--------------|--------|--------|-------------------|------|
| Acetone | 10.0 | 8.42 | 84 | 41 - 150 | J |
| Benzene | 10.0 | 9.75 | 97 | 66 - 131 | |
| Bromodichloromethane | 10.0 | 10.1 | 101 | 78 - 120 | |
| Bromoform | 10.0 | 9.72 | 97 | 66 - 120 | |
| Bromomethane | 10.0 | 10.5 | 105 | 47 - 150 | |
| Methyl Ethyl Ketone | 10.0 | 10.2 | 102 | 42 - 150 | |
| Carbon disulfide | 10.0 | 10.9 | 109 | 55 - 150 | |
| Carbon tetrachloride | 10.0 | 10.8 | 108 | 69 - 135 | |
| Chlorobenzene | 10.0 | 9.13 | 91 | 68 - 120 | |
| Chloroethane | 10.0 | 13.2 | 132 | 49 - 150 | |
| Chloroform | 10.0 | 9.21 | 92 | 77 - 126 | |
| Chloromethane | 10.0 | 12.1 | 121 | 33 - 150 | |
| Dibromochloromethane | 10.0 | 9.21 | 92 | 75 - 120 | |
| 1,1-Dichloroethane | 10.0 | 9.95 | 100 | 75 - 130 | |
| 1,2-Dichloroethane | 10.0 | 10.3 | 103 | 73 - 127 | |
| 1,1-Dichloroethene | 10.0 | 11.4 | 114 | 65 - 142 | |
| 1,2-Dichloropropane | 10.0 | 8.44 | 84 | 69 - 129 | |
| cis-1,3-Dichloropropene | 10.0 | 9.48 | 95 | 63 - 120 | |
| trans-1,3-Dichloropropene | 10.0 | 9.04 | 90 | 73 - 120 | |
| Ethylbenzene | 10.0 | 9.31 | 93 | 62 - 120 | |
| 2-Hexanone | 10.0 | 9.46 | 95 | 46 - 150 | J |
| Methylene Chloride | 10.0 | 11.2 | 112 | 56 - 138 | |
| methyl isobutyl ketone | 10.0 | 10.4 | 104 | 70 - 122 | |
| Styrene | 10.0 | 9.08 | 91 | 47 - 120 | |
| 1,1,2,2-Tetrachloroethane | 10.0 | 10.5 | 105 | 75 - 124 | |
| Tetrachloroethene | 10.0 | 9.31 | 93 | 50 - 120 | |
| Toluene | 10.0 | 9.60 | 96 | 66 - 120 | |
| 1,1,1-Trichloroethane | 10.0 | 10.3 | 103 | 73 - 135 | |
| 1,1,2-Trichloroethane | 10.0 | 10.4 | 104 | 76 - 125 | |
| Trichloroethene | 10.0 | 10.1 | 101 | 60 - 122 | |
| Vinyl chloride | 10.0 | 10.9 | 109 | 61 - 150 | |
| Xylenes, Total | 30.0 | 26.9 | 90 | 58 - 120 | |
| cis-1,2-Dichloroethene | 10.0 | 9.14 | 91 | 65 - 120 | |
| trans-1,2-Dichloroethene | 10.0 | 9.98 | 100 | 58 - 120 | |
| Surrogate | | | % Rec | Acceptance Limits | |
| 1,2-Dichloroethane-d4 (Surr) | | | 84 | 65 - 136 | |
| 4-Bromofluorobenzene | | | 92 | 51 - 142 | |
| Dibromofluoromethane | | | 79 | 68 - 132 | |
| Toluene-d8 (Surr) | | | 86 | 63 - 127 | |

DATA REPORTING QUALIFIERS

Client: Malcolm Pirnie, Inc.

Job Number: 220-16116-1

| Lab Section | Qualifier | Description |
|--------------------|------------------|---|
| GC/MS VOA | | |
| | U | Analyzed for but not detected. |
| | J | Indicates an estimated value. |
| | B | The analyte was found in an associated blank, as well as in the sample. |

Quality Control Results

Client: Malcolm Pirnie, Inc.

Job Number: 220-16116-1

QC Association Summary

| Lab Sample ID | Client Sample ID | Report Basis | Client Matrix | Method | Prep Batch |
|---------------------------------|--------------------|--------------|---------------|--------|------------|
| GC/MS VOA | | | | | |
| Analysis Batch:220-53407 | | | | | |
| LCS 220-53407/10 | Lab Control Sample | T | Water | 8260B | |
| MB 220-53407/11 | Method Blank | T | Water | 8260B | |
| 220-16116-1 | Well 1-1A EFF | T | Water | 8260B | |
| 220-16116-3TB | Trip Blank | T | Water | 8260B | |
| Analysis Batch:220-53443 | | | | | |
| LCS 220-53443/2 | Lab Control Sample | T | Water | 8260B | |
| MB 220-53443/3 | Method Blank | T | Water | 8260B | |
| 220-16116-2 | Well 1-1A INF | T | Water | 8260B | |

Report Basis

T = Total

Quality Control Results

Client: Malcolm Pirnie, Inc.

Job Number: 220-16116-1

Laboratory Chronicle

Lab ID: 220-16116-1

Client ID: Well 1-1A EFF

Sample Date/Time: 07/26/2011 09:45 Received Date/Time: 07/27/2011 09:50

| Method | Bottle ID | Run | Analysis Batch | Prep Batch | Date Prepared / Analyzed | Dil | Lab | Analyst |
|---------|---------------|-----|----------------|------------|--------------------------|-----|--------|---------|
| P:5030B | 220-16116-A-1 | | 220-53407 | | 07/28/2011 02:51 | 1 | TAL CT | BK |
| A:8260B | 220-16116-A-1 | | 220-53407 | | 07/28/2011 02:51 | 1 | TAL CT | BK |

Lab ID: 220-16116-2

Client ID: Well 1-1A INF

Sample Date/Time: 07/26/2011 09:50 Received Date/Time: 07/27/2011 09:50

| Method | Bottle ID | Run | Analysis Batch | Prep Batch | Date Prepared / Analyzed | Dil | Lab | Analyst |
|---------|---------------|-----|----------------|------------|--------------------------|-----|--------|---------|
| P:5030B | 220-16116-C-2 | | 220-53443 | | 07/28/2011 22:16 | 2 | TAL CT | BK |
| A:8260B | 220-16116-C-2 | | 220-53443 | | 07/28/2011 22:16 | 2 | TAL CT | BK |

Lab ID: 220-16116-3

Client ID: Trip Blank

Sample Date/Time: 07/26/2011 09:45 Received Date/Time: 07/27/2011 09:50

| Method | Bottle ID | Run | Analysis Batch | Prep Batch | Date Prepared / Analyzed | Dil | Lab | Analyst |
|---------|---------------|-----|----------------|------------|--------------------------|-----|--------|---------|
| P:5030B | 220-16116-A-3 | | 220-53407 | | 07/27/2011 22:46 | 1 | TAL CT | BK |
| A:8260B | 220-16116-A-3 | | 220-53407 | | 07/27/2011 22:46 | 1 | TAL CT | BK |

Lab ID: MB

Client ID: N/A

Sample Date/Time: N/A Received Date/Time: N/A

| Method | Bottle ID | Run | Analysis Batch | Prep Batch | Date Prepared / Analyzed | Dil | Lab | Analyst |
|---------|-----------------|-----|----------------|------------|--------------------------|-----|--------|---------|
| P:5030B | MB 220-53407/11 | | 220-53407 | | 07/27/2011 22:19 | 1 | TAL CT | BK |
| A:8260B | MB 220-53407/11 | | 220-53407 | | 07/27/2011 22:19 | 1 | TAL CT | BK |
| P:5030B | MB 220-53443/3 | | 220-53443 | | 07/28/2011 13:12 | 1 | TAL CT | BK |
| A:8260B | MB 220-53443/3 | | 220-53443 | | 07/28/2011 13:12 | 1 | TAL CT | BK |

Lab ID: LCS

Client ID: N/A

Sample Date/Time: N/A Received Date/Time: N/A

| Method | Bottle ID | Run | Analysis Batch | Prep Batch | Date Prepared / Analyzed | Dil | Lab | Analyst |
|---------|------------------|-----|----------------|------------|--------------------------|-----|--------|---------|
| P:5030B | LCS 220-53407/10 | | 220-53407 | | 07/27/2011 20:57 | 1 | TAL CT | BK |
| A:8260B | LCS 220-53407/10 | | 220-53407 | | 07/27/2011 20:57 | 1 | TAL CT | BK |
| P:5030B | LCS 220-53443/2 | | 220-53443 | | 07/28/2011 11:50 | 1 | TAL CT | BK |
| A:8260B | LCS 220-53443/2 | | 220-53443 | | 07/28/2011 11:50 | 1 | TAL CT | BK |

Lab References:

TAL CT = TestAmerica Connecticut

ANALYTICAL REPORT

Job Number: 220-16305-1

Job Description: NYSDEC Standby - Vestal Water Supply

For:

Malcolm Pirnie, Inc.

855 Route 146

Suite 210

Clifton Park, NY 12065

Attention: Mr. Jeremy Wyckoff



Approved for release.
Cheryl Cascella
Project Manager I
9/2/2011 2:55 PM

Designee for
Jackie Trudell
Project Manager I
jackie.trudell@testamericainc.com
09/02/2011

The test results in this report meet all NELAP requirements unless specified within the case narrative. Pursuant to NELAP, this report may not be reproduced, except in full, without the written approval of the laboratory. All questions regarding this report should be directed to the TestAmerica Project Manager.

TestAmerica Connecticut Certifications and Approvals: CTDOH PH-047, MADEP CT023, RIDOH A43, NYDOH 10602, NY NELAP 10602, NHDES 2528, NJDEP CT410, ME DOH CT023, UT DOH 2032614458

TestAmerica Laboratories, Inc.

TestAmerica Connecticut 128 Long Hill Cross Road, Shelton, CT 06484


Tel (203) 929-8140 Fax (203) 929-8142 www.testamericainc.com



Job Number: 220-16305-1

Job Description: NYSDEC Standby - Vestal Water Supply

I certify that this data package is in compliance with the terms and conditions of the contract, both technically and for completeness, for other than the conditions detailed within the body of this report. Release of the data contained in this sample data package and in the electronic data deliverable has been authorized by the Laboratory Manager or his/her designee, as verified by the following signature.

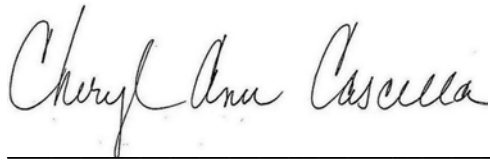

Approved for release.
Cheryl Casella
Project Manager I
9/2/2011 2:55 PM

Designee for
Jackie Trudell

Table of Contents

| | |
|--------------------------------------|-----|
| Cover Title Page | 1 |
| Data Summaries | 5 |
| Report Narrative | 5 |
| Sample Calculation Summary | 6 |
| Sample Summary | 7 |
| Executive Summary | 8 |
| Method Summary | 9 |
| Method / Analyst Summary | 10 |
| Sample Datasheets | 11 |
| Surrogate Summary | 14 |
| QC Data Summary | 15 |
| Data Qualifiers | 17 |
| QC Association Summary | 18 |
| Lab Chronicle | 19 |
| Organic Sample Data | 20 |
| GC/MS VOA | 20 |
| Method 8260B | 20 |
| Method 8260B QC Summary | 21 |
| Method 8260B Sample Data | 27 |
| Standards Data | 51 |
| Method 8260B ICAL Data | 51 |
| Method 8260B CCAL Data | 144 |
| Raw QC Data | 154 |
| Method 8260B Tune Data | 154 |
| Method 8260B Blank Data | 164 |
| Method 8260B LCS/LCSD Data | 169 |

Table of Contents

| | |
|--|-----|
| Method 8260B Run Logs | 175 |
| Shipping and Receiving Documents | 177 |
| Client Chain of Custody | 178 |
| Sample Receipt Checklist | 179 |

Job Narrative
220-16305-1

Comments

No additional comments.

Receipt

Chain of Custody was received without analysis selected. Client was contacted and instructed lab to analyze the samples for TCL VOCs.

The following volatile sample was received with headspace in 2 of 2 sample vials: Trip Blank (220-16305-3) (220-16305-A-3 and 220-16305-B-3) Client was contacted and instructed the lab to proceed with analysis.

All other samples were received in good condition within temperature requirements.

GC/MS VOA

No analytical or quality issues were noted.

FORMULAS FOR NYSDEC SAMPLE CALCULATIONS

Volatiles

$$\frac{(AX)(IS)(DF)}{(AIS)(RRF)(V)(\% \text{ solids})} = C$$

$$\frac{(AX)(IS)(VT)(1000)(DF)}{(AIS)(RRF)(VA)(V)(\% \text{ solids})} = C \quad (\text{for medium level soils})$$

SemiVolatiles

$$\frac{(AX)(IS)(VE)(DF)(\text{GPC factor is 2 if needed})}{(AIS)(RRF)(\text{volume injected})(V)(\% \text{ solids})} = C$$

Pesticides

$$\frac{(AX)(VE)(DF)}{(RRF)(V)(\% \text{ solids})(\text{volume injected})} = C$$

PCBs for compound/retention time

$$\frac{(AX)(VE)(DF)}{(\text{RRF of compound at the stated retention time})(V)(\% \text{ solids})(\text{volume injected})} = C$$

DRO/CTETPH

$$\frac{(AX)(VE)(DF)}{(RRF)(V)(\% \text{ solids})(\text{volume injected})} = C$$

AX = area of the target Ion

AIS = Area of Internal standard

C = concentration as ug/L or ug/Kg

DF = dilution

IS = Internal standard concentration (ng)

RRF = average RF (from initial cal except CLP methods from continuing cal)

V = sample volume for liquids in mls or sample weight for solids in grams

VA = volume of aliquot for medium level soils

VE = volume of concentrated extract

VT = volume of methanol for volatile medium level soils

SAMPLE SUMMARY

Client: Malcolm Pirnie, Inc.

Job Number: 220-16305-1

| Lab Sample ID | Client Sample ID | Client Matrix | Date/Time Sampled | Date/Time Received |
|----------------------|-------------------------|----------------------|------------------------------|-------------------------------|
| 220-16305-1 | Well 1-1A Inf | Water | 08/18/2011 1455 | 08/19/2011 0932 |
| 220-16305-2 | Well 1-1A Eff | Water | 08/18/2011 1305 | 08/19/2011 0932 |
| 220-16305-3TB | Trip Blank | Water | 08/18/2011 1305 | 08/19/2011 0932 |

EXECUTIVE SUMMARY - Detections

Client: Malcolm Pirnie, Inc.

Job Number: 220-16305-1

| Lab Sample ID Analyte | Client Sample ID | Result | Qualifier | Reporting Limit | Units | Method |
|--------------------------|----------------------|--------|-----------|--------------------|-------|--------|
| 220-16305-1 | WELL 1-1A INF | | | | | |
| Acetone | | 11 | J | 20 | ug/L | 8260B |
| 1,1-Dichloroethane | | 24 | | 10 | ug/L | 8260B |
| 1,1-Dichloroethene | | 17 | | 10 | ug/L | 8260B |
| Methylene Chloride | | 4.0 | J B | 10 | ug/L | 8260B |
| methyl isobutyl ketone | | 9.7 | J | 20 | ug/L | 8260B |
| 1,1,1-Trichloroethane | | 200 | | 10 | ug/L | 8260B |
| Trichloroethene | | 55 | | 10 | ug/L | 8260B |
| Vinyl chloride | | 7.8 | J | 10 | ug/L | 8260B |
| cis-1,2-Dichloroethene | | 51 | | 10 | ug/L | 8260B |
| 220-16305-3TB | TRIP BLANK | | | | | |
| Methylene Chloride | | 4.8 | J B | 5.0 | ug/L | 8260B |

METHOD SUMMARY

Client: Malcolm Pirnie, Inc.

Job Number: 220-16305-1

| Description | Lab Location | Method | Preparation Method |
|------------------------------------|---------------------|---------------|---------------------------|
| Matrix Water | | | |
| Volatile Organic Compounds (GC/MS) | TAL CT | SW846 8260B | |
| Purge and Trap | TAL CT | | SW846 5030B |

Lab References:

TAL CT = TestAmerica Connecticut

Method References:

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

METHOD / ANALYST SUMMARY

Client: Malcolm Pirnie, Inc.

Job Number: 220-16305-1

| Method | Analyst | Analyst ID |
|---------------|----------------------|-------------------|
| SW846 8260B | Kostrzewska, Barbara | BK |

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 220-16305-1

Client Sample ID: Well 1-1A Inf

Lab Sample ID: 220-16305-1

Date Sampled: 08/18/2011 1455

Client Matrix: Water

Date Received: 08/19/2011 0932

8260B Volatile Organic Compounds (GC/MS)

| | | | | | |
|------------------|-----------------|-----------------|-----------|------------------------|---------|
| Analysis Method: | 8260B | Analysis Batch: | 220-54151 | Instrument ID: | MSB |
| Prep Method: | 5030B | Prep Batch: | N/A | Lab File ID: | B2953.D |
| Dilution: | 2.0 | | | Initial Weight/Volume: | 5 mL |
| Analysis Date: | 08/22/2011 1606 | | | Final Weight/Volume: | 5 mL |
| Prep Date: | 08/22/2011 1606 | | | | |

| Analyte | Result (ug/L) | Qualifier | MDL | RL |
|---------------------------|---------------|-----------|------|----|
| Acetone | 11 | J | 2.1 | 20 |
| Benzene | 10 | U | 1.5 | 10 |
| Bromodichloromethane | 10 | U | 0.96 | 10 |
| Bromoform | 10 | U | 0.92 | 10 |
| Bromomethane | 10 | U | 4.2 | 10 |
| Methyl Ethyl Ketone | 20 | U | 2.2 | 20 |
| Carbon disulfide | 10 | U | 1.8 | 10 |
| Carbon tetrachloride | 10 | U * | 2.1 | 10 |
| Chlorobenzene | 10 | U | 1.4 | 10 |
| Chloroethane | 10 | U | 2.1 | 10 |
| Chloroform | 10 | U | 1.3 | 10 |
| Chloromethane | 10 | U | 2.2 | 10 |
| Dibromochloromethane | 10 | U | 1.1 | 10 |
| 1,1-Dichloroethane | 24 | | 2.1 | 10 |
| 1,2-Dichloroethane | 10 | U | 1.4 | 10 |
| 1,1-Dichloroethene | 17 | | 1.7 | 10 |
| 1,2-Dichloropropane | 10 | U | 1.4 | 10 |
| cis-1,3-Dichloropropene | 10 | U | 0.56 | 10 |
| trans-1,3-Dichloropropene | 10 | U | 1.1 | 10 |
| Ethylbenzene | 10 | U | 1.7 | 10 |
| 2-Hexanone | 20 | U | 2.2 | 20 |
| Methylene Chloride | 4.0 | J B | 1.6 | 10 |
| methyl isobutyl ketone | 9.7 | J | 0.76 | 20 |
| Styrene | 10 | U | 1.3 | 10 |
| 1,1,2,2-Tetrachloroethane | 10 | U | 1.6 | 10 |
| Tetrachloroethene | 10 | U | 1.6 | 10 |
| Toluene | 10 | U | 1.4 | 10 |
| 1,1,1-Trichloroethane | 200 | | 1.4 | 10 |
| 1,1,2-Trichloroethane | 10 | U | 1.3 | 10 |
| Trichloroethene | 55 | | 1.2 | 10 |
| Vinyl chloride | 7.8 | J | 2.0 | 10 |
| Xylenes, Total | 10 | U | 4.5 | 10 |
| cis-1,2-Dichloroethene | 51 | | 2.0 | 10 |
| trans-1,2-Dichloroethene | 10 | U | 1.5 | 10 |

| Surrogate | %Rec | Qualifier | Acceptance Limits |
|------------------------------|------|-----------|-------------------|
| 1,2-Dichloroethane-d4 (Surr) | 94 | | 65 - 136 |
| 4-Bromofluorobenzene | 81 | | 51 - 142 |
| Dibromofluoromethane | 91 | | 68 - 132 |
| Toluene-d8 (Surr) | 79 | | 63 - 127 |

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 220-16305-1

Client Sample ID: Well 1-1A Eff

Lab Sample ID: 220-16305-2

Date Sampled: 08/18/2011 1305

Client Matrix: Water

Date Received: 08/19/2011 0932

8260B Volatile Organic Compounds (GC/MS)

| | | |
|--------------------------------|---------------------------|-----------------------------|
| Analysis Method: 8260B | Analysis Batch: 220-54151 | Instrument ID: MSB |
| Prep Method: 5030B | Prep Batch: N/A | Lab File ID: B2948.D |
| Dilution: 1.0 | | Initial Weight/Volume: 5 mL |
| Analysis Date: 08/22/2011 1402 | | Final Weight/Volume: 5 mL |
| Prep Date: 08/22/2011 1402 | | |

| Analyte | Result (ug/L) | Qualifier | MDL | RL |
|---------------------------|---------------|-----------|------|-----|
| Acetone | 10 | U | 1.0 | 10 |
| Benzene | 5.0 | U | 0.74 | 5.0 |
| Bromodichloromethane | 5.0 | U | 0.48 | 5.0 |
| Bromoform | 5.0 | U | 0.46 | 5.0 |
| Bromomethane | 5.0 | U | 2.1 | 5.0 |
| Methyl Ethyl Ketone | 10 | U | 1.1 | 10 |
| Carbon disulfide | 5.0 | U | 0.90 | 5.0 |
| Carbon tetrachloride | 5.0 | U * | 1.1 | 5.0 |
| Chlorobenzene | 5.0 | U | 0.72 | 5.0 |
| Chloroethane | 5.0 | U | 1.1 | 5.0 |
| Chloroform | 5.0 | U | 0.67 | 5.0 |
| Chloromethane | 5.0 | U | 1.1 | 5.0 |
| Dibromochloromethane | 5.0 | U | 0.55 | 5.0 |
| 1,1-Dichloroethane | 5.0 | U | 1.0 | 5.0 |
| 1,2-Dichloroethane | 5.0 | U | 0.72 | 5.0 |
| 1,1-Dichloroethene | 5.0 | U | 0.83 | 5.0 |
| 1,2-Dichloropropane | 5.0 | U | 0.71 | 5.0 |
| cis-1,3-Dichloropropene | 5.0 | U | 0.28 | 5.0 |
| trans-1,3-Dichloropropene | 5.0 | U | 0.57 | 5.0 |
| Ethylbenzene | 5.0 | U | 0.87 | 5.0 |
| 2-Hexanone | 10 | U | 1.1 | 10 |
| Methylene Chloride | 5.0 | U | 0.78 | 5.0 |
| methyl isobutyl ketone | 10 | U | 0.38 | 10 |
| Styrene | 5.0 | U | 0.64 | 5.0 |
| 1,1,2,2-Tetrachloroethane | 5.0 | U | 0.81 | 5.0 |
| Tetrachloroethene | 5.0 | U | 0.81 | 5.0 |
| Toluene | 5.0 | U | 0.72 | 5.0 |
| 1,1,1-Trichloroethane | 5.0 | U | 0.69 | 5.0 |
| 1,1,2-Trichloroethane | 5.0 | U | 0.65 | 5.0 |
| Trichloroethene | 5.0 | U | 0.62 | 5.0 |
| Vinyl chloride | 5.0 | U | 0.99 | 5.0 |
| Xylenes, Total | 5.0 | U | 2.3 | 5.0 |
| cis-1,2-Dichloroethene | 5.0 | U | 0.99 | 5.0 |
| trans-1,2-Dichloroethene | 5.0 | U | 0.76 | 5.0 |

| Surrogate | %Rec | Qualifier | Acceptance Limits |
|------------------------------|------|-----------|-------------------|
| 1,2-Dichloroethane-d4 (Surr) | 109 | | 65 - 136 |
| 4-Bromofluorobenzene | 88 | | 51 - 142 |
| Dibromofluoromethane | 105 | | 68 - 132 |
| Toluene-d8 (Surr) | 89 | | 63 - 127 |

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 220-16305-1

Client Sample ID: Trip Blank

Lab Sample ID: 220-16305-3TB

Date Sampled: 08/18/2011 1305

Client Matrix: Water

Date Received: 08/19/2011 0932

8260B Volatile Organic Compounds (GC/MS)

| | | | | | |
|------------------|-----------------|-----------------|-----------|------------------------|---------|
| Analysis Method: | 8260B | Analysis Batch: | 220-54151 | Instrument ID: | MSB |
| Prep Method: | 5030B | Prep Batch: | N/A | Lab File ID: | B2946.D |
| Dilution: | 1.0 | | | Initial Weight/Volume: | 5 mL |
| Analysis Date: | 08/22/2011 1313 | | | Final Weight/Volume: | 5 mL |
| Prep Date: | 08/22/2011 1313 | | | | |

| Analyte | Result (ug/L) | Qualifier | MDL | RL |
|---------------------------|---------------|-----------|------|-----|
| Acetone | 10 | U | 1.0 | 10 |
| Benzene | 5.0 | U | 0.74 | 5.0 |
| Bromodichloromethane | 5.0 | U | 0.48 | 5.0 |
| Bromoform | 5.0 | U | 0.46 | 5.0 |
| Bromomethane | 5.0 | U | 2.1 | 5.0 |
| Methyl Ethyl Ketone | 10 | U | 1.1 | 10 |
| Carbon disulfide | 5.0 | U | 0.90 | 5.0 |
| Carbon tetrachloride | 5.0 | U * | 1.1 | 5.0 |
| Chlorobenzene | 5.0 | U | 0.72 | 5.0 |
| Chloroethane | 5.0 | U | 1.1 | 5.0 |
| Chloroform | 5.0 | U | 0.67 | 5.0 |
| Chloromethane | 5.0 | U | 1.1 | 5.0 |
| Dibromochloromethane | 5.0 | U | 0.55 | 5.0 |
| 1,1-Dichloroethane | 5.0 | U | 1.0 | 5.0 |
| 1,2-Dichloroethane | 5.0 | U | 0.72 | 5.0 |
| 1,1-Dichloroethene | 5.0 | U | 0.83 | 5.0 |
| 1,2-Dichloropropane | 5.0 | U | 0.71 | 5.0 |
| cis-1,3-Dichloropropene | 5.0 | U | 0.28 | 5.0 |
| trans-1,3-Dichloropropene | 5.0 | U | 0.57 | 5.0 |
| Ethylbenzene | 5.0 | U | 0.87 | 5.0 |
| 2-Hexanone | 10 | U | 1.1 | 10 |
| Methylene Chloride | 4.8 | J B | 0.78 | 5.0 |
| methyl isobutyl ketone | 10 | U | 0.38 | 10 |
| Styrene | 5.0 | U | 0.64 | 5.0 |
| 1,1,2,2-Tetrachloroethane | 5.0 | U | 0.81 | 5.0 |
| Tetrachloroethene | 5.0 | U | 0.81 | 5.0 |
| Toluene | 5.0 | U | 0.72 | 5.0 |
| 1,1,1-Trichloroethane | 5.0 | U | 0.69 | 5.0 |
| 1,1,2-Trichloroethane | 5.0 | U | 0.65 | 5.0 |
| Trichloroethene | 5.0 | U | 0.62 | 5.0 |
| Vinyl chloride | 5.0 | U | 0.99 | 5.0 |
| Xylenes, Total | 5.0 | U | 2.3 | 5.0 |
| cis-1,2-Dichloroethene | 5.0 | U | 0.99 | 5.0 |
| trans-1,2-Dichloroethene | 5.0 | U | 0.76 | 5.0 |

| Surrogate | %Rec | Qualifier | Acceptance Limits |
|------------------------------|------|-----------|-------------------|
| 1,2-Dichloroethane-d4 (Surr) | 106 | | 65 - 136 |
| 4-Bromofluorobenzene | 88 | | 51 - 142 |
| Dibromofluoromethane | 101 | | 68 - 132 |
| Toluene-d8 (Surr) | 90 | | 63 - 127 |

Client: Malcolm Pirnie, Inc.

Job Number: 220-16305-1

Surrogate Recovery Report

8260B Volatile Organic Compounds (GC/MS)

Client Matrix: Water

| Lab Sample ID | Client Sample ID | DBFM %Rec | DCA %Rec | TOL %Rec | BFB %Rec |
|-----------------|------------------|--------------|-------------|-------------|-------------|
| 220-16305-1 | Well 1-1A Inf | 91 | 94 | 79 | 81 |
| 220-16305-2 | Well 1-1A Eff | 105 | 109 | 89 | 88 |
| 220-16305-3 | Trip Blank | 101 | 106 | 90 | 88 |
| MB 220-54151/3 | | 93 | 100 | 90 | 90 |
| LCS 220-54151/2 | | 97 | 100 | 92 | 93 |

| Surrogate | Acceptance Limits |
|------------------------------------|-------------------|
| DBFM = Dibromofluoromethane | 68-132 |
| DCA = 1,2-Dichloroethane-d4 (Surr) | 65-136 |
| TOL = Toluene-d8 (Surr) | 63-127 |
| BFB = 4-Bromofluorobenzene | 51-142 |

Quality Control Results

Client: Malcolm Pirnie, Inc.

Job Number: 220-16305-1

Method Blank - Batch: 220-54151

Method: 8260B
Preparation: 5030B

Lab Sample ID: MB 220-54151/3
Client Matrix: Water
Dilution: 1.0
Analysis Date: 08/22/2011 1248
Prep Date: 08/22/2011 1248
Leach Date: N/A

Analysis Batch: 220-54151
Prep Batch: N/A
Leach Batch: N/A
Units: ug/L

Instrument ID: MSB
Lab File ID: B2945.D
Initial Weight/Volume: 5 mL
Final Weight/Volume: 5 mL

| Analyte | Result | Qual | MDL | RL |
|---------------------------|--------|------|------|-----|
| Acetone | 10 | U | 1.0 | 10 |
| Benzene | 5.0 | U | 0.74 | 5.0 |
| Bromodichloromethane | 5.0 | U | 0.48 | 5.0 |
| Bromoform | 5.0 | U | 0.46 | 5.0 |
| Bromomethane | 5.0 | U | 2.1 | 5.0 |
| Methyl Ethyl Ketone | 10 | U | 1.1 | 10 |
| Carbon disulfide | 5.0 | U | 0.90 | 5.0 |
| Carbon tetrachloride | 5.0 | U | 1.1 | 5.0 |
| Chlorobenzene | 5.0 | U | 0.72 | 5.0 |
| Chloroethane | 5.0 | U | 1.1 | 5.0 |
| Chloroform | 5.0 | U | 0.67 | 5.0 |
| Chloromethane | 5.0 | U | 1.1 | 5.0 |
| Dibromochloromethane | 5.0 | U | 0.55 | 5.0 |
| 1,1-Dichloroethane | 5.0 | U | 1.0 | 5.0 |
| 1,2-Dichloroethane | 5.0 | U | 0.72 | 5.0 |
| 1,1-Dichloroethene | 5.0 | U | 0.83 | 5.0 |
| 1,2-Dichloropropane | 5.0 | U | 0.71 | 5.0 |
| cis-1,3-Dichloropropene | 5.0 | U | 0.28 | 5.0 |
| trans-1,3-Dichloropropene | 5.0 | U | 0.57 | 5.0 |
| Ethylbenzene | 5.0 | U | 0.87 | 5.0 |
| 2-Hexanone | 10 | U | 1.1 | 10 |
| Methylene Chloride | 3.38 | J | 0.78 | 5.0 |
| methyl isobutyl ketone | 10 | U | 0.38 | 10 |
| Styrene | 5.0 | U | 0.64 | 5.0 |
| 1,1,2,2-Tetrachloroethane | 5.0 | U | 0.81 | 5.0 |
| Tetrachloroethene | 5.0 | U | 0.81 | 5.0 |
| Toluene | 5.0 | U | 0.72 | 5.0 |
| 1,1,1-Trichloroethane | 5.0 | U | 0.69 | 5.0 |
| 1,1,2-Trichloroethane | 5.0 | U | 0.65 | 5.0 |
| Trichloroethene | 5.0 | U | 0.62 | 5.0 |
| Vinyl chloride | 5.0 | U | 0.99 | 5.0 |
| Xylenes, Total | 5.0 | U | 2.3 | 5.0 |
| cis-1,2-Dichloroethene | 5.0 | U | 0.99 | 5.0 |
| trans-1,2-Dichloroethene | 5.0 | U | 0.76 | 5.0 |

| Surrogate | % Rec | Acceptance Limits |
|------------------------------|-------|-------------------|
| 1,2-Dichloroethane-d4 (Surr) | 100 | 65 - 136 |
| 4-Bromofluorobenzene | 90 | 51 - 142 |
| Dibromofluoromethane | 93 | 68 - 132 |
| Toluene-d8 (Surr) | 90 | 63 - 127 |

Quality Control Results

Client: Malcolm Pirnie, Inc.

Job Number: 220-16305-1

Lab Control Sample - Batch: 220-54151

Method: 8260B
Preparation: 5030B

| | | | | | |
|----------------|-----------------|-----------------|-----------|------------------------|---------|
| Lab Sample ID: | LCS 220-54151/2 | Analysis Batch: | 220-54151 | Instrument ID: | MSB |
| Client Matrix: | Water | Prep Batch: | N/A | Lab File ID: | B2942.D |
| Dilution: | 1.0 | Leach Batch: | N/A | Initial Weight/Volume: | 5 mL |
| Analysis Date: | 08/22/2011 1133 | Units: | ug/L | Final Weight/Volume: | 5 mL |
| Prep Date: | 08/22/2011 1133 | | | | |
| Leach Date: | N/A | | | | |

| Analyte | Spike Amount | Result | % Rec. | Limit | Qual |
|------------------------------|--------------|--------|--------|-------------------|------|
| Acetone | 20.0 | 16.0 | 80 | 41 - 150 | |
| Benzene | 20.0 | 23.2 | 116 | 66 - 131 | |
| Bromodichloromethane | 20.0 | 24.1 | 120 | 78 - 120 | |
| Bromoform | 20.0 | 22.7 | 114 | 66 - 120 | |
| Bromomethane | 20.0 | 18.3 | 92 | 47 - 150 | |
| Methyl Ethyl Ketone | 20.0 | 19.3 | 96 | 42 - 150 | |
| Carbon disulfide | 20.0 | 21.6 | 108 | 55 - 150 | |
| Carbon tetrachloride | 20.0 | 27.4 | 137 | 69 - 135 | * |
| Chlorobenzene | 20.0 | 22.1 | 110 | 68 - 120 | |
| Chloroethane | 20.0 | 20.8 | 104 | 49 - 150 | |
| Chloroform | 20.0 | 24.9 | 125 | 77 - 126 | |
| Chloromethane | 20.0 | 14.5 | 73 | 33 - 150 | |
| Dibromochloromethane | 20.0 | 22.7 | 113 | 75 - 120 | |
| 1,1-Dichloroethane | 20.0 | 24.5 | 122 | 75 - 130 | |
| 1,2-Dichloroethane | 20.0 | 25.4 | 127 | 73 - 127 | |
| 1,1-Dichloroethene | 20.0 | 24.4 | 122 | 65 - 142 | |
| 1,2-Dichloropropane | 20.0 | 22.4 | 112 | 69 - 129 | |
| cis-1,3-Dichloropropene | 20.0 | 23.0 | 115 | 63 - 120 | |
| trans-1,3-Dichloropropene | 20.0 | 23.4 | 117 | 73 - 120 | |
| Ethylbenzene | 20.0 | 22.9 | 114 | 62 - 120 | |
| 2-Hexanone | 20.0 | 18.4 | 92 | 46 - 150 | |
| Methylene Chloride | 20.0 | 22.9 | 114 | 56 - 138 | |
| methyl isobutyl ketone | 20.0 | 20.7 | 103 | 70 - 122 | |
| Styrene | 20.0 | 21.9 | 109 | 47 - 120 | |
| 1,1,2,2-Tetrachloroethane | 20.0 | 21.9 | 110 | 75 - 124 | |
| Tetrachloroethene | 20.0 | 22.8 | 114 | 50 - 120 | |
| Toluene | 20.0 | 22.2 | 111 | 66 - 120 | |
| 1,1,1-Trichloroethane | 20.0 | 26.4 | 132 | 73 - 135 | |
| 1,1,2-Trichloroethane | 20.0 | 22.0 | 110 | 76 - 125 | |
| Trichloroethene | 20.0 | 22.7 | 114 | 60 - 122 | |
| Vinyl chloride | 20.0 | 17.7 | 89 | 61 - 150 | |
| Xylenes, Total | 60.0 | 66.7 | 111 | 58 - 120 | |
| cis-1,2-Dichloroethene | 20.0 | 22.4 | 112 | 65 - 120 | |
| trans-1,2-Dichloroethene | 20.0 | 22.8 | 114 | 58 - 120 | |
| Surrogate | | | % Rec | Acceptance Limits | |
| 1,2-Dichloroethane-d4 (Surr) | | | 100 | 65 - 136 | |
| 4-Bromofluorobenzene | | | 93 | 51 - 142 | |
| Dibromofluoromethane | | | 97 | 68 - 132 | |
| Toluene-d8 (Surr) | | | 92 | 63 - 127 | |

DATA REPORTING QUALIFIERS

Client: Malcolm Pirnie, Inc.

Job Number: 220-16305-1

| Lab Section | Qualifier | Description |
|--------------------|------------------|---|
| GC/MS VOA | | |
| | U | Analyzed for but not detected. |
| | J | Indicates an estimated value. |
| | * | LCS or LCSD exceeds the control limits |
| | B | The analyte was found in an associated blank, as well as in the sample. |

Quality Control Results

Client: Malcolm Pirnie, Inc.

Job Number: 220-16305-1

QC Association Summary

| <u>Lab Sample ID</u> | <u>Client Sample ID</u> | <u>Report Basis</u> | <u>Client Matrix</u> | <u>Method</u> | <u>Prep Batch</u> |
|---------------------------------|-------------------------|---------------------|----------------------|---------------|-------------------|
| GC/MS VOA | | | | | |
| Analysis Batch:220-54151 | | | | | |
| LCS 220-54151/2 | Lab Control Sample | T | Water | 8260B | |
| MB 220-54151/3 | Method Blank | T | Water | 8260B | |
| 220-16305-1 | Well 1-1A Inf | T | Water | 8260B | |
| 220-16305-2 | Well 1-1A Eff | T | Water | 8260B | |
| 220-16305-3TB | Trip Blank | T | Water | 8260B | |

Report Basis

T = Total

Quality Control Results

Client: Malcolm Pirnie, Inc.

Job Number: 220-16305-1

Laboratory Chronicle

Lab ID: 220-16305-1

Client ID: Well 1-1A Inf

Sample Date/Time: 08/18/2011 14:55 Received Date/Time: 08/19/2011 09:32

| Method | Bottle ID | Run | Analysis Batch | Prep Batch | Date Prepared / Analyzed | Dil | Lab | Analyst |
|---------|---------------|-----|----------------|------------|--------------------------|-----|--------|---------|
| P:5030B | 220-16305-A-1 | | 220-54151 | | 08/22/2011 16:06 | 2 | TAL CT | BK |
| A:8260B | 220-16305-A-1 | | 220-54151 | | 08/22/2011 16:06 | 2 | TAL CT | BK |

Lab ID: 220-16305-2

Client ID: Well 1-1A Eff

Sample Date/Time: 08/18/2011 13:05 Received Date/Time: 08/19/2011 09:32

| Method | Bottle ID | Run | Analysis Batch | Prep Batch | Date Prepared / Analyzed | Dil | Lab | Analyst |
|---------|---------------|-----|----------------|------------|--------------------------|-----|--------|---------|
| P:5030B | 220-16305-A-2 | | 220-54151 | | 08/22/2011 14:02 | 1 | TAL CT | BK |
| A:8260B | 220-16305-A-2 | | 220-54151 | | 08/22/2011 14:02 | 1 | TAL CT | BK |

Lab ID: 220-16305-3

Client ID: Trip Blank

Sample Date/Time: 08/18/2011 13:05 Received Date/Time: 08/19/2011 09:32

| Method | Bottle ID | Run | Analysis Batch | Prep Batch | Date Prepared / Analyzed | Dil | Lab | Analyst |
|---------|---------------|-----|----------------|------------|--------------------------|-----|--------|---------|
| P:5030B | 220-16305-A-3 | | 220-54151 | | 08/22/2011 13:13 | 1 | TAL CT | BK |
| A:8260B | 220-16305-A-3 | | 220-54151 | | 08/22/2011 13:13 | 1 | TAL CT | BK |

Lab ID: MB

Client ID: N/A

Sample Date/Time: N/A

Received Date/Time: N/A

| Method | Bottle ID | Run | Analysis Batch | Prep Batch | Date Prepared / Analyzed | Dil | Lab | Analyst |
|---------|----------------|-----|----------------|------------|--------------------------|-----|--------|---------|
| P:5030B | MB 220-54151/3 | | 220-54151 | | 08/22/2011 12:48 | 1 | TAL CT | BK |
| A:8260B | MB 220-54151/3 | | 220-54151 | | 08/22/2011 12:48 | 1 | TAL CT | BK |

Lab ID: LCS

Client ID: N/A

Sample Date/Time: N/A

Received Date/Time: N/A

| Method | Bottle ID | Run | Analysis Batch | Prep Batch | Date Prepared / Analyzed | Dil | Lab | Analyst |
|---------|-----------------|-----|----------------|------------|--------------------------|-----|--------|---------|
| P:5030B | LCS 220-54151/2 | | 220-54151 | | 08/22/2011 11:33 | 1 | TAL CT | BK |
| A:8260B | LCS 220-54151/2 | | 220-54151 | | 08/22/2011 11:33 | 1 | TAL CT | BK |

Lab References:

TAL CT = TestAmerica Connecticut

ANALYTICAL REPORT

Job Number: 220-16654-1

Job Description: NYSDEC Standby - Vestal Water Supply

For:

Malcolm Pirnie, Inc. Invoice to Arcadis
855 Route 146
Suite 210
Clifton Park, NY 12065

Attention: Mr. Jeremy Wyckoff



Approved for release.
Joan Widomski
Project Manager I
10/13/2011 1:58 PM

Designee for
Jackie Trudell
Project Manager I
jackie.trudell@testamericainc.com
10/13/2011

The test results in this report meet all NELAP requirements unless specified within the case narrative. Pursuant to NELAP, this report may not be reproduced, except in full, without the written approval of the laboratory. All questions regarding this report should be directed to the TestAmerica Project Manager.

TestAmerica Connecticut Certifications and Approvals: CTDOH PH-047, MADEP CT023, RIDOH A43, NYDOH 10602, NY NELAP 10602, NHDES 2528, NJDEP CT410, ME DOH CT023, UT DOH 2032614458

TestAmerica Laboratories, Inc.


TestAmerica Connecticut 128 Long Hill Cross Road, Shelton, CT 06484
Tel (203) 929-8140 Fax (203) 929-8142 www.testamericainc.com



Job Number: 220-16654-1

Job Description: NYSDEC Standby - Vestal Water Supply

I certify that this data package is in compliance with the terms and conditions of the contract, both technically and for completeness, for other than the conditions detailed within the body of this report. Release of the data contained in this sample data package and in the electronic data deliverable has been authorized by the Laboratory Manager or his/her designee, as verified by the following signature.



Approved for release.
Joan Widomski
Project Manager I
10/13/2011 1:58 PM

Designee for
Jackie Trudell

Table of Contents

| | |
|----------------------------------|-----|
| Cover Title Page | 1 |
| Data Summaries | 5 |
| Report Narrative | 5 |
| Sample Calculation Summary | 6 |
| Sample Summary | 7 |
| Executive Summary | 8 |
| Method Summary | 9 |
| Method / Analyst Summary | 10 |
| Sample Datasheets | 11 |
| Surrogate Summary | 14 |
| QC Data Summary | 15 |
| Data Qualifiers | 17 |
| QC Association Summary | 18 |
| Lab Chronicle | 19 |
| Organic Sample Data | 20 |
| GC/MS VOA | 20 |
| Method 8260B | 20 |
| Method 8260B QC Summary | 21 |
| Method 8260B Sample Data | 27 |
| Standards Data | 46 |
| Method 8260B ICAL Data | 46 |
| Method 8260B CCAL Data | 124 |
| Raw QC Data | 134 |
| Method 8260B Tune Data | 134 |
| Method 8260B Blank Data | 142 |
| Method 8260B LCS/LCSD Data | 147 |

Table of Contents

| | |
|--|-----|
| Method 8260B Run Logs | 154 |
| Shipping and Receiving Documents | 156 |
| Client Chain of Custody | 157 |
| Sample Receipt Checklist | 158 |

Job Narrative
220-16654-1

Comments

No additional comments.

Receipt

The container label for the following sample does not match the information listed on the Chain-of-Custody (COC): Well 1-1A INF (220-16654-1). The container labels list the collection time as 14:05, whereas the COC lists the collection time as 14:00. Client was contact and instructed the lab to use a collection time of 14:00.

The following samples were received at the laboratory outside the required temperature criteria: TB (220-16654-3), Well 1-1A EFF (220-16654-2), Well 1-1A INF (220-16654-1). The client was contacted regarding this issue, and the laboratory was instructed to proceed with analysis.

All other samples were received in good condition within temperature requirements.

GC/MS VOA

No analytical or quality issues were noted.

FORMULAS FOR NYSDEC SAMPLE CALCULATIONS

Volatiles

$$\frac{(AX)(IS)(DF)}{(AIS)(RRF)(V)(\% \text{ solids})} = C$$

$$\frac{(AX)(IS)(VT)(1000)(DF)}{(AIS)(RRF)(VA)(V)(\% \text{ solids})} = C \quad (\text{for medium level soils})$$

SemiVolatiles

$$\frac{(AX)(IS)(VE)(DF)(\text{GPC factor is 2 if needed})}{(AIS)(RRF)(\text{volume injected})(V)(\% \text{ solids})} = C$$

Pesticides

$$\frac{(AX)(VE)(DF)}{(RRF)(V)(\% \text{ solids})(\text{volume injected})} = C$$

PCBs for compound/retention time

$$\frac{(AX)(VE)(DF)}{(RRF \text{ of compound at the stated retention time})(V)(\% \text{ solids})(\text{volume injected})} = C$$

DRO/CTETPH

$$\frac{(AX)(VE)(DF)}{(RRF)(V)(\% \text{ solids})(\text{volume injected})} = C$$

AX = area of the target Ion

AIS = Area of Internal standard

C = concentration as ug/L or ug/Kg

DF = dilution

IS = Internal standard concentration (ng)

RRF = average RF (from initial cal except CLP methods from continuing cal)

V = sample volume for liquids in mls or sample weight for solids in grams

VA = volume of aliquot for medium level soils

VE = volume of concentrated extract

VT = volume of methanol for volatile medium level soils

SAMPLE SUMMARY

Client: Malcolm Pirnie, Inc. Invoice to Arcadis

Job Number: 220-16654-1

| Lab Sample ID | Client Sample ID | Client Matrix | Date/Time Sampled | Date/Time Received |
|----------------------|-------------------------|----------------------|------------------------------|-------------------------------|
| 220-16654-1 | Well 1-1A INF | Water | 09/29/2011 1400 | 09/30/2011 1020 |
| 220-16654-2 | Well 1-1A EFF | Water | 09/29/2011 1405 | 09/30/2011 1020 |
| 220-16654-3TB | TB | Water | 09/29/2011 1400 | 09/30/2011 1020 |

EXECUTIVE SUMMARY - Detections

Client: Malcolm Pirnie, Inc. Invoice to Arcadis

Job Number: 220-16654-1

| Lab Sample ID | Client Sample ID | Result | Qualifier | Reporting Limit | Units | Method |
|------------------------|----------------------|--------|-----------|-----------------|-------|--------|
| 220-16654-1 | WELL 1-1A INF | | | | | |
| 1,1-Dichloroethane | | 17 | | 5.0 | ug/L | 8260B |
| 1,1-Dichloroethene | | 11 | | 5.0 | ug/L | 8260B |
| 1,1,1-Trichloroethane | | 120 | | 5.0 | ug/L | 8260B |
| Trichloroethene | | 39 | | 5.0 | ug/L | 8260B |
| Vinyl chloride | | 5.5 | | 5.0 | ug/L | 8260B |
| cis-1,2-Dichloroethene | | 37 | | 5.0 | ug/L | 8260B |
| 220-16654-3TB | TB | | | | | |
| Methylene Chloride | | 3.6 | J B | 5.0 | ug/L | 8260B |

METHOD SUMMARY

Client: Malcolm Pirnie, Inc. Invoice to Arcadis

Job Number: 220-16654-1

| Description | Lab Location | Method | Preparation Method |
|------------------------------------|---------------------|---------------|---------------------------|
| Matrix: Water | | | |
| Volatile Organic Compounds (GC/MS) | TAL CT | SW846 8260B | |
| Purge and Trap | TAL CT | | SW846 5030B |

Lab References:

TAL CT = TestAmerica Connecticut

Method References:

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

METHOD / ANALYST SUMMARY

Client: Malcolm Pirnie, Inc. Invoice to Arcadis

Job Number: 220-16654-1

| Method | Analyst | Analyst ID |
|---------------|----------------|-------------------|
| SW846 8260B | Lynch, Eon | EL |

Analytical Data

Client: Malcolm Pirnie, Inc. Invoice to Arcadis

Job Number: 220-16654-1

Client Sample ID: Well 1-1A INF

Lab Sample ID: 220-16654-1

Date Sampled: 09/29/2011 1400

Client Matrix: Water

Date Received: 09/30/2011 1020

8260B Volatile Organic Compounds (GC/MS)

| | | |
|--------------------------------|---------------------------|-----------------------------|
| Analysis Method: 8260B | Analysis Batch: 220-55424 | Instrument ID: MSL |
| Prep Method: 5030B | Prep Batch: N/A | Lab File ID: L0986.D |
| Dilution: 1.0 | | Initial Weight/Volume: 5 mL |
| Analysis Date: 10/04/2011 1316 | | Final Weight/Volume: 5 mL |
| Prep Date: 10/04/2011 1316 | | |

| Analyte | Result (ug/L) | Qualifier | MDL | RL |
|---------------------------|---------------|-----------|------|-----|
| Acetone | 10 | U | 1.0 | 10 |
| Benzene | 5.0 | U | 0.74 | 5.0 |
| Bromodichloromethane | 5.0 | U | 0.48 | 5.0 |
| Bromoform | 5.0 | U | 0.46 | 5.0 |
| Bromomethane | 5.0 | U | 2.1 | 5.0 |
| Methyl Ethyl Ketone | 10 | U | 1.1 | 10 |
| Carbon disulfide | 5.0 | U | 0.90 | 5.0 |
| Carbon tetrachloride | 5.0 | U | 1.1 | 5.0 |
| Chlorobenzene | 5.0 | U | 0.72 | 5.0 |
| Chloroethane | 5.0 | U | 1.1 | 5.0 |
| Chloroform | 5.0 | U | 0.67 | 5.0 |
| Chloromethane | 5.0 | U | 1.1 | 5.0 |
| Dibromochloromethane | 5.0 | U | 0.55 | 5.0 |
| 1,1-Dichloroethane | 17 | | 1.0 | 5.0 |
| 1,2-Dichloroethane | 5.0 | U | 0.72 | 5.0 |
| 1,1-Dichloroethene | 11 | | 0.83 | 5.0 |
| 1,2-Dichloropropane | 5.0 | U | 0.71 | 5.0 |
| cis-1,3-Dichloropropene | 5.0 | U | 0.28 | 5.0 |
| trans-1,3-Dichloropropene | 5.0 | U | 0.57 | 5.0 |
| Ethylbenzene | 5.0 | U | 0.87 | 5.0 |
| 2-Hexanone | 10 | U | 1.1 | 10 |
| Methylene Chloride | 5.0 | U | 0.78 | 5.0 |
| methyl isobutyl ketone | 10 | U | 0.38 | 10 |
| Styrene | 5.0 | U | 0.64 | 5.0 |
| 1,1,2,2-Tetrachloroethane | 5.0 | U | 0.81 | 5.0 |
| Tetrachloroethene | 5.0 | U | 0.81 | 5.0 |
| Toluene | 5.0 | U | 0.72 | 5.0 |
| 1,1,1-Trichloroethane | 120 | | 0.69 | 5.0 |
| 1,1,2-Trichloroethane | 5.0 | U | 0.65 | 5.0 |
| Trichloroethene | 39 | | 0.62 | 5.0 |
| Vinyl chloride | 5.5 | | 0.99 | 5.0 |
| Xylenes, Total | 5.0 | U | 2.3 | 5.0 |
| cis-1,2-Dichloroethene | 37 | | 0.99 | 5.0 |
| trans-1,2-Dichloroethene | 5.0 | U | 0.76 | 5.0 |

| Surrogate | %Rec | Qualifier | Acceptance Limits |
|------------------------------|------|-----------|-------------------|
| 1,2-Dichloroethane-d4 (Surr) | 74 | | 65 - 136 |
| 4-Bromofluorobenzene | 83 | | 51 - 142 |
| Dibromofluoromethane | 80 | | 68 - 132 |
| Toluene-d8 (Surr) | 76 | | 63 - 127 |

Analytical Data

Client: Malcolm Pirnie, Inc. Invoice to Arcadis

Job Number: 220-16654-1

Client Sample ID: Well 1-1A EFF

Lab Sample ID: 220-16654-2
 Client Matrix: Water

Date Sampled: 09/29/2011 1405
 Date Received: 09/30/2011 1020

8260B Volatile Organic Compounds (GC/MS)

| | | |
|--------------------------------|---------------------------|-----------------------------|
| Analysis Method: 8260B | Analysis Batch: 220-55424 | Instrument ID: MSL |
| Prep Method: 5030B | Prep Batch: N/A | Lab File ID: L0987.D |
| Dilution: 1.0 | | Initial Weight/Volume: 5 mL |
| Analysis Date: 10/04/2011 1340 | | Final Weight/Volume: 5 mL |
| Prep Date: 10/04/2011 1340 | | |

| Analyte | Result (ug/L) | Qualifier | MDL | RL |
|---------------------------|---------------|-----------|------|-----|
| Acetone | 10 | U | 1.0 | 10 |
| Benzene | 5.0 | U | 0.74 | 5.0 |
| Bromodichloromethane | 5.0 | U | 0.48 | 5.0 |
| Bromoform | 5.0 | U | 0.46 | 5.0 |
| Bromomethane | 5.0 | U | 2.1 | 5.0 |
| Methyl Ethyl Ketone | 10 | U | 1.1 | 10 |
| Carbon disulfide | 5.0 | U | 0.90 | 5.0 |
| Carbon tetrachloride | 5.0 | U | 1.1 | 5.0 |
| Chlorobenzene | 5.0 | U | 0.72 | 5.0 |
| Chloroethane | 5.0 | U | 1.1 | 5.0 |
| Chloroform | 5.0 | U | 0.67 | 5.0 |
| Chloromethane | 5.0 | U | 1.1 | 5.0 |
| Dibromochloromethane | 5.0 | U | 0.55 | 5.0 |
| 1,1-Dichloroethane | 5.0 | U | 1.0 | 5.0 |
| 1,2-Dichloroethane | 5.0 | U | 0.72 | 5.0 |
| 1,1-Dichloroethene | 5.0 | U | 0.83 | 5.0 |
| 1,2-Dichloropropane | 5.0 | U | 0.71 | 5.0 |
| cis-1,3-Dichloropropene | 5.0 | U | 0.28 | 5.0 |
| trans-1,3-Dichloropropene | 5.0 | U | 0.57 | 5.0 |
| Ethylbenzene | 5.0 | U | 0.87 | 5.0 |
| 2-Hexanone | 10 | U | 1.1 | 10 |
| Methylene Chloride | 5.0 | U | 0.78 | 5.0 |
| methyl isobutyl ketone | 10 | U | 0.38 | 10 |
| Styrene | 5.0 | U | 0.64 | 5.0 |
| 1,1,2,2-Tetrachloroethane | 5.0 | U | 0.81 | 5.0 |
| Tetrachloroethene | 5.0 | U | 0.81 | 5.0 |
| Toluene | 5.0 | U | 0.72 | 5.0 |
| 1,1,1-Trichloroethane | 5.0 | U | 0.69 | 5.0 |
| 1,1,2-Trichloroethane | 5.0 | U | 0.65 | 5.0 |
| Trichloroethene | 5.0 | U | 0.62 | 5.0 |
| Vinyl chloride | 5.0 | U | 0.99 | 5.0 |
| Xylenes, Total | 5.0 | U | 2.3 | 5.0 |
| cis-1,2-Dichloroethene | 5.0 | U | 0.99 | 5.0 |
| trans-1,2-Dichloroethene | 5.0 | U | 0.76 | 5.0 |

| Surrogate | %Rec | Qualifier | Acceptance Limits |
|------------------------------|------|-----------|-------------------|
| 1,2-Dichloroethane-d4 (Surr) | 75 | | 65 - 136 |
| 4-Bromofluorobenzene | 82 | | 51 - 142 |
| Dibromofluoromethane | 79 | | 68 - 132 |
| Toluene-d8 (Surr) | 77 | | 63 - 127 |

Analytical Data

Client: Malcolm Pirnie, Inc. Invoice to Arcadis

Job Number: 220-16654-1

Client Sample ID: TB

Lab Sample ID: 220-16654-3TB

Date Sampled: 09/29/2011 1400

Client Matrix: Water

Date Received: 09/30/2011 1020

8260B Volatile Organic Compounds (GC/MS)

| | | | | | |
|------------------|-----------------|-----------------|-----------|------------------------|---------|
| Analysis Method: | 8260B | Analysis Batch: | 220-55424 | Instrument ID: | MSL |
| Prep Method: | 5030B | Prep Batch: | N/A | Lab File ID: | L0985.D |
| Dilution: | 1.0 | | | Initial Weight/Volume: | 5 mL |
| Analysis Date: | 10/04/2011 1252 | | | Final Weight/Volume: | 5 mL |
| Prep Date: | 10/04/2011 1252 | | | | |

| Analyte | Result (ug/L) | Qualifier | MDL | RL |
|---------------------------|---------------|-----------|------|-----|
| Acetone | 10 | U | 1.0 | 10 |
| Benzene | 5.0 | U | 0.74 | 5.0 |
| Bromodichloromethane | 5.0 | U | 0.48 | 5.0 |
| Bromoform | 5.0 | U | 0.46 | 5.0 |
| Bromomethane | 5.0 | U | 2.1 | 5.0 |
| Methyl Ethyl Ketone | 10 | U | 1.1 | 10 |
| Carbon disulfide | 5.0 | U | 0.90 | 5.0 |
| Carbon tetrachloride | 5.0 | U | 1.1 | 5.0 |
| Chlorobenzene | 5.0 | U | 0.72 | 5.0 |
| Chloroethane | 5.0 | U | 1.1 | 5.0 |
| Chloroform | 5.0 | U | 0.67 | 5.0 |
| Chloromethane | 5.0 | U | 1.1 | 5.0 |
| Dibromochloromethane | 5.0 | U | 0.55 | 5.0 |
| 1,1-Dichloroethane | 5.0 | U | 1.0 | 5.0 |
| 1,2-Dichloroethane | 5.0 | U | 0.72 | 5.0 |
| 1,1-Dichloroethene | 5.0 | U | 0.83 | 5.0 |
| 1,2-Dichloropropane | 5.0 | U | 0.71 | 5.0 |
| cis-1,3-Dichloropropene | 5.0 | U | 0.28 | 5.0 |
| trans-1,3-Dichloropropene | 5.0 | U | 0.57 | 5.0 |
| Ethylbenzene | 5.0 | U | 0.87 | 5.0 |
| 2-Hexanone | 10 | U | 1.1 | 10 |
| Methylene Chloride | 3.6 | J B | 0.78 | 5.0 |
| methyl isobutyl ketone | 10 | U | 0.38 | 10 |
| Styrene | 5.0 | U | 0.64 | 5.0 |
| 1,1,2,2-Tetrachloroethane | 5.0 | U | 0.81 | 5.0 |
| Tetrachloroethene | 5.0 | U | 0.81 | 5.0 |
| Toluene | 5.0 | U | 0.72 | 5.0 |
| 1,1,1-Trichloroethane | 5.0 | U | 0.69 | 5.0 |
| 1,1,2-Trichloroethane | 5.0 | U | 0.65 | 5.0 |
| Trichloroethene | 5.0 | U | 0.62 | 5.0 |
| Vinyl chloride | 5.0 | U | 0.99 | 5.0 |
| Xylenes, Total | 5.0 | U | 2.3 | 5.0 |
| cis-1,2-Dichloroethene | 5.0 | U | 0.99 | 5.0 |
| trans-1,2-Dichloroethene | 5.0 | U | 0.76 | 5.0 |

| Surrogate | %Rec | Qualifier | Acceptance Limits |
|------------------------------|------|-----------|-------------------|
| 1,2-Dichloroethane-d4 (Surr) | 72 | | 65 - 136 |
| 4-Bromofluorobenzene | 82 | | 51 - 142 |
| Dibromofluoromethane | 78 | | 68 - 132 |
| Toluene-d8 (Surr) | 74 | | 63 - 127 |

Surrogate Recovery Report

8260B Volatile Organic Compounds (GC/MS)

Client Matrix: Water

| Lab Sample ID | Client Sample ID | DBFM %Rec | DCA %Rec | TOL %Rec | BFB %Rec |
|-----------------|------------------|--------------|-------------|-------------|-------------|
| 220-16654-1 | Well 1-1A INF | 80 | 74 | 76 | 83 |
| 220-16654-2 | Well 1-1A EFF | 79 | 75 | 77 | 82 |
| 220-16654-3 | TB | 78 | 72 | 74 | 82 |
| MB 220-55424/3 | | 87 | 81 | 86 | 95 |
| LCS 220-55424/2 | | 85 | 76 | 79 | 88 |

| Surrogate | Acceptance Limits |
|------------------------------------|-------------------|
| DBFM = Dibromofluoromethane | 68-132 |
| DCA = 1,2-Dichloroethane-d4 (Surr) | 65-136 |
| TOL = Toluene-d8 (Surr) | 63-127 |
| BFB = 4-Bromofluorobenzene | 51-142 |

Quality Control Results

Client: Malcolm Pirnie, Inc. Invoice to Arcadis

Job Number: 220-16654-1

Method Blank - Batch: 220-55424

**Method: 8260B
Preparation: 5030B**

Lab Sample ID: MB 220-55424/3
 Client Matrix: Water
 Dilution: 1.0
 Analysis Date: 10/04/2011 1216
 Prep Date: 10/04/2011 1216
 Leach Date: N/A

Analysis Batch: 220-55424
 Prep Batch: N/A
 Leach Batch: N/A
 Units: ug/L

Instrument ID: MSL
 Lab File ID: L0984.D
 Initial Weight/Volume: 5 mL
 Final Weight/Volume: 5 mL

| Analyte | Result | Qual | MDL | RL |
|---------------------------|--------|------|------|-----|
| Acetone | 10 | U | 1.0 | 10 |
| Benzene | 5.0 | U | 0.74 | 5.0 |
| Bromodichloromethane | 5.0 | U | 0.48 | 5.0 |
| Bromoform | 5.0 | U | 0.46 | 5.0 |
| Bromomethane | 5.0 | U | 2.1 | 5.0 |
| Methyl Ethyl Ketone | 10 | U | 1.1 | 10 |
| Carbon disulfide | 5.0 | U | 0.90 | 5.0 |
| Carbon tetrachloride | 5.0 | U | 1.1 | 5.0 |
| Chlorobenzene | 5.0 | U | 0.72 | 5.0 |
| Chloroethane | 5.0 | U | 1.1 | 5.0 |
| Chloroform | 5.0 | U | 0.67 | 5.0 |
| Chloromethane | 5.0 | U | 1.1 | 5.0 |
| Dibromochloromethane | 5.0 | U | 0.55 | 5.0 |
| 1,1-Dichloroethane | 5.0 | U | 1.0 | 5.0 |
| 1,2-Dichloroethane | 5.0 | U | 0.72 | 5.0 |
| 1,1-Dichloroethene | 5.0 | U | 0.83 | 5.0 |
| 1,2-Dichloropropane | 5.0 | U | 0.71 | 5.0 |
| cis-1,3-Dichloropropene | 5.0 | U | 0.28 | 5.0 |
| trans-1,3-Dichloropropene | 5.0 | U | 0.57 | 5.0 |
| Ethylbenzene | 5.0 | U | 0.87 | 5.0 |
| 2-Hexanone | 10 | U | 1.1 | 10 |
| Methylene Chloride | 3.20 | J | 0.78 | 5.0 |
| methyl isobutyl ketone | 10 | U | 0.38 | 10 |
| Styrene | 5.0 | U | 0.64 | 5.0 |
| 1,1,2,2-Tetrachloroethane | 5.0 | U | 0.81 | 5.0 |
| Tetrachloroethene | 5.0 | U | 0.81 | 5.0 |
| Toluene | 5.0 | U | 0.72 | 5.0 |
| 1,1,1-Trichloroethane | 5.0 | U | 0.69 | 5.0 |
| 1,1,2-Trichloroethane | 5.0 | U | 0.65 | 5.0 |
| Trichloroethene | 5.0 | U | 0.62 | 5.0 |
| Vinyl chloride | 5.0 | U | 0.99 | 5.0 |
| Xylenes, Total | 5.0 | U | 2.3 | 5.0 |
| cis-1,2-Dichloroethene | 5.0 | U | 0.99 | 5.0 |
| trans-1,2-Dichloroethene | 5.0 | U | 0.76 | 5.0 |

| Surrogate | % Rec | Acceptance Limits |
|------------------------------|-------|-------------------|
| 1,2-Dichloroethane-d4 (Surr) | 81 | 65 - 136 |
| 4-Bromofluorobenzene | 95 | 51 - 142 |
| Dibromofluoromethane | 87 | 68 - 132 |
| Toluene-d8 (Surr) | 86 | 63 - 127 |

Quality Control Results

Client: Malcolm Pirnie, Inc. Invoice to Arcadis

Job Number: 220-16654-1

Lab Control Sample - Batch: 220-55424

**Method: 8260B
Preparation: 5030B**

| | | |
|--------------------------------|---------------------------|-----------------------------|
| Lab Sample ID: LCS 220-55424/2 | Analysis Batch: 220-55424 | Instrument ID: MSL |
| Client Matrix: Water | Prep Batch: N/A | Lab File ID: L0982.D |
| Dilution: 1.0 | Leach Batch: N/A | Initial Weight/Volume: 5 mL |
| Analysis Date: 10/04/2011 1107 | Units: ug/L | Final Weight/Volume: 5 mL |
| Prep Date: 10/04/2011 1107 | | |
| Leach Date: N/A | | |

| Analyte | Spike Amount | Result | % Rec. | Limit | Qual |
|------------------------------|--------------|--------|--------|-------------------|------|
| Acetone | 20.0 | 24.0 | 120 | 41 - 150 | |
| Benzene | 20.0 | 18.5 | 92 | 66 - 131 | |
| Bromodichloromethane | 20.0 | 17.9 | 90 | 78 - 120 | |
| Bromoform | 20.0 | 15.0 | 75 | 66 - 120 | |
| Bromomethane | 20.0 | 15.4 | 77 | 47 - 150 | |
| Methyl Ethyl Ketone | 20.0 | 20.3 | 102 | 42 - 150 | |
| Carbon disulfide | 20.0 | 14.6 | 73 | 55 - 150 | |
| Carbon tetrachloride | 20.0 | 18.8 | 94 | 69 - 135 | |
| Chlorobenzene | 20.0 | 17.5 | 88 | 68 - 120 | |
| Chloroethane | 20.0 | 20.5 | 102 | 49 - 150 | |
| Chloroform | 20.0 | 19.0 | 95 | 77 - 126 | |
| Chloromethane | 20.0 | 17.7 | 89 | 33 - 150 | |
| Dibromochloromethane | 20.0 | 15.8 | 79 | 75 - 120 | |
| 1,1-Dichloroethane | 20.0 | 19.8 | 99 | 75 - 130 | |
| 1,2-Dichloroethane | 20.0 | 18.5 | 93 | 73 - 127 | |
| 1,1-Dichloroethene | 20.0 | 20.1 | 100 | 65 - 142 | |
| 1,2-Dichloropropane | 20.0 | 19.4 | 97 | 69 - 129 | |
| cis-1,3-Dichloropropene | 20.0 | 18.1 | 90 | 63 - 120 | |
| trans-1,3-Dichloropropene | 20.0 | 18.0 | 90 | 73 - 120 | |
| Ethylbenzene | 20.0 | 17.6 | 88 | 62 - 120 | |
| 2-Hexanone | 20.0 | 18.2 | 91 | 46 - 150 | |
| Methylene Chloride | 20.0 | 20.8 | 104 | 56 - 138 | |
| methyl isobutyl ketone | 20.0 | 17.2 | 86 | 70 - 122 | |
| Styrene | 20.0 | 16.9 | 85 | 47 - 120 | |
| 1,1,2,2-Tetrachloroethane | 20.0 | 17.5 | 88 | 75 - 124 | |
| Tetrachloroethene | 20.0 | 16.2 | 81 | 50 - 120 | |
| Toluene | 20.0 | 17.2 | 86 | 66 - 120 | |
| 1,1,1-Trichloroethane | 20.0 | 19.5 | 98 | 73 - 135 | |
| 1,1,2-Trichloroethane | 20.0 | 18.7 | 94 | 76 - 125 | |
| Trichloroethene | 20.0 | 18.8 | 94 | 60 - 122 | |
| Vinyl chloride | 20.0 | 17.7 | 88 | 61 - 150 | |
| Xylenes, Total | 60.0 | 52.9 | 88 | 58 - 120 | |
| cis-1,2-Dichloroethene | 20.0 | 19.1 | 96 | 65 - 120 | |
| trans-1,2-Dichloroethene | 20.0 | 18.5 | 93 | 58 - 120 | |
| Surrogate | | % Rec | | Acceptance Limits | |
| 1,2-Dichloroethane-d4 (Surr) | | 76 | | 65 - 136 | |
| 4-Bromofluorobenzene | | 88 | | 51 - 142 | |
| Dibromofluoromethane | | 85 | | 68 - 132 | |
| Toluene-d8 (Surr) | | 79 | | 63 - 127 | |

DATA REPORTING QUALIFIERS

Client: Malcolm Pirnie, Inc. Invoice to Arcadis

Job Number: 220-16654-1

| Lab Section | Qualifier | Description |
|--------------------|------------------|---|
| GC/MS VOA | | |
| | U | Analyzed for but not detected. |
| | J | Indicates an estimated value. |
| | B | The analyte was found in an associated blank, as well as in the sample. |

Quality Control Results

Client: Malcolm Pirnie, Inc. Invoice to Arcadis

Job Number: 220-16654-1

QC Association Summary

| Lab Sample ID | Client Sample ID | Report Basis | Client Matrix | Method | Prep Batch |
|---------------------------------|--------------------|--------------|---------------|--------|------------|
| GC/MS VOA | | | | | |
| Analysis Batch:220-55424 | | | | | |
| LCS 220-55424/2 | Lab Control Sample | T | Water | 8260B | |
| MB 220-55424/3 | Method Blank | T | Water | 8260B | |
| 220-16654-1 | Well 1-1A INF | T | Water | 8260B | |
| 220-16654-2 | Well 1-1A EFF | T | Water | 8260B | |
| 220-16654-3TB | TB | T | Water | 8260B | |

Report Basis

T = Total

Quality Control Results

Client: Malcolm Pirnie, Inc. Invoice to Arcadis

Job Number: 220-16654-1

Laboratory Chronicle

Lab ID: 220-16654-1

Client ID: Well 1-1A INF

Sample Date/Time: 09/29/2011 14:00 Received Date/Time: 09/30/2011 10:20

| Method | Bottle ID | Run | Analysis Batch | Prep Batch | Date Prepared / Analyzed | Dil | Lab | Analyst |
|---------|---------------|-----|----------------|------------|--------------------------|-----|--------|---------|
| P:5030B | 220-16654-B-1 | | 220-55424 | | 10/04/2011 13:16 | 1 | TAL CT | EL |
| A:8260B | 220-16654-B-1 | | 220-55424 | | 10/04/2011 13:16 | 1 | TAL CT | EL |

Lab ID: 220-16654-2

Client ID: Well 1-1A EFF

Sample Date/Time: 09/29/2011 14:05 Received Date/Time: 09/30/2011 10:20

| Method | Bottle ID | Run | Analysis Batch | Prep Batch | Date Prepared / Analyzed | Dil | Lab | Analyst |
|---------|---------------|-----|----------------|------------|--------------------------|-----|--------|---------|
| P:5030B | 220-16654-B-2 | | 220-55424 | | 10/04/2011 13:40 | 1 | TAL CT | EL |
| A:8260B | 220-16654-B-2 | | 220-55424 | | 10/04/2011 13:40 | 1 | TAL CT | EL |

Lab ID: 220-16654-3

Client ID: TB

Sample Date/Time: 09/29/2011 14:00 Received Date/Time: 09/30/2011 10:20

| Method | Bottle ID | Run | Analysis Batch | Prep Batch | Date Prepared / Analyzed | Dil | Lab | Analyst |
|---------|---------------|-----|----------------|------------|--------------------------|-----|--------|---------|
| P:5030B | 220-16654-C-3 | | 220-55424 | | 10/04/2011 12:52 | 1 | TAL CT | EL |
| A:8260B | 220-16654-C-3 | | 220-55424 | | 10/04/2011 12:52 | 1 | TAL CT | EL |

Lab ID: MB

Client ID: N/A

Sample Date/Time: N/A

Received Date/Time: N/A

| Method | Bottle ID | Run | Analysis Batch | Prep Batch | Date Prepared / Analyzed | Dil | Lab | Analyst |
|---------|----------------|-----|----------------|------------|--------------------------|-----|--------|---------|
| P:5030B | MB 220-55424/3 | | 220-55424 | | 10/04/2011 12:16 | 1 | TAL CT | EL |
| A:8260B | MB 220-55424/3 | | 220-55424 | | 10/04/2011 12:16 | 1 | TAL CT | EL |

Lab ID: LCS

Client ID: N/A

Sample Date/Time: N/A

Received Date/Time: N/A

| Method | Bottle ID | Run | Analysis Batch | Prep Batch | Date Prepared / Analyzed | Dil | Lab | Analyst |
|---------|-----------------|-----|----------------|------------|--------------------------|-----|--------|---------|
| P:5030B | LCS 220-55424/2 | | 220-55424 | | 10/04/2011 11:07 | 1 | TAL CT | EL |
| A:8260B | LCS 220-55424/2 | | 220-55424 | | 10/04/2011 11:07 | 1 | TAL CT | EL |


Lab References:

TAL CT = TestAmerica Connecticut

Appendix C

June 2011 Iso-Concentration Map

XREFS: I:\ACAD\STANDARD-ARCADIS\Logos\ARCADIS-LOGO-ENG-COLOR.dwg I:\ACAD\PROJ\0266\352\X-Refs\Basemap.dwg IMAGES: None
 User: lewandowski Spec: PIRNIE_STANDARD File: I:\ACAD\PROJ\0266\352\Figures\FIGURE 4-4 JUNE 2011.DWG Scale: 1:1 Date: 11/01/2011 Time: 08:37 Layout: Layout1

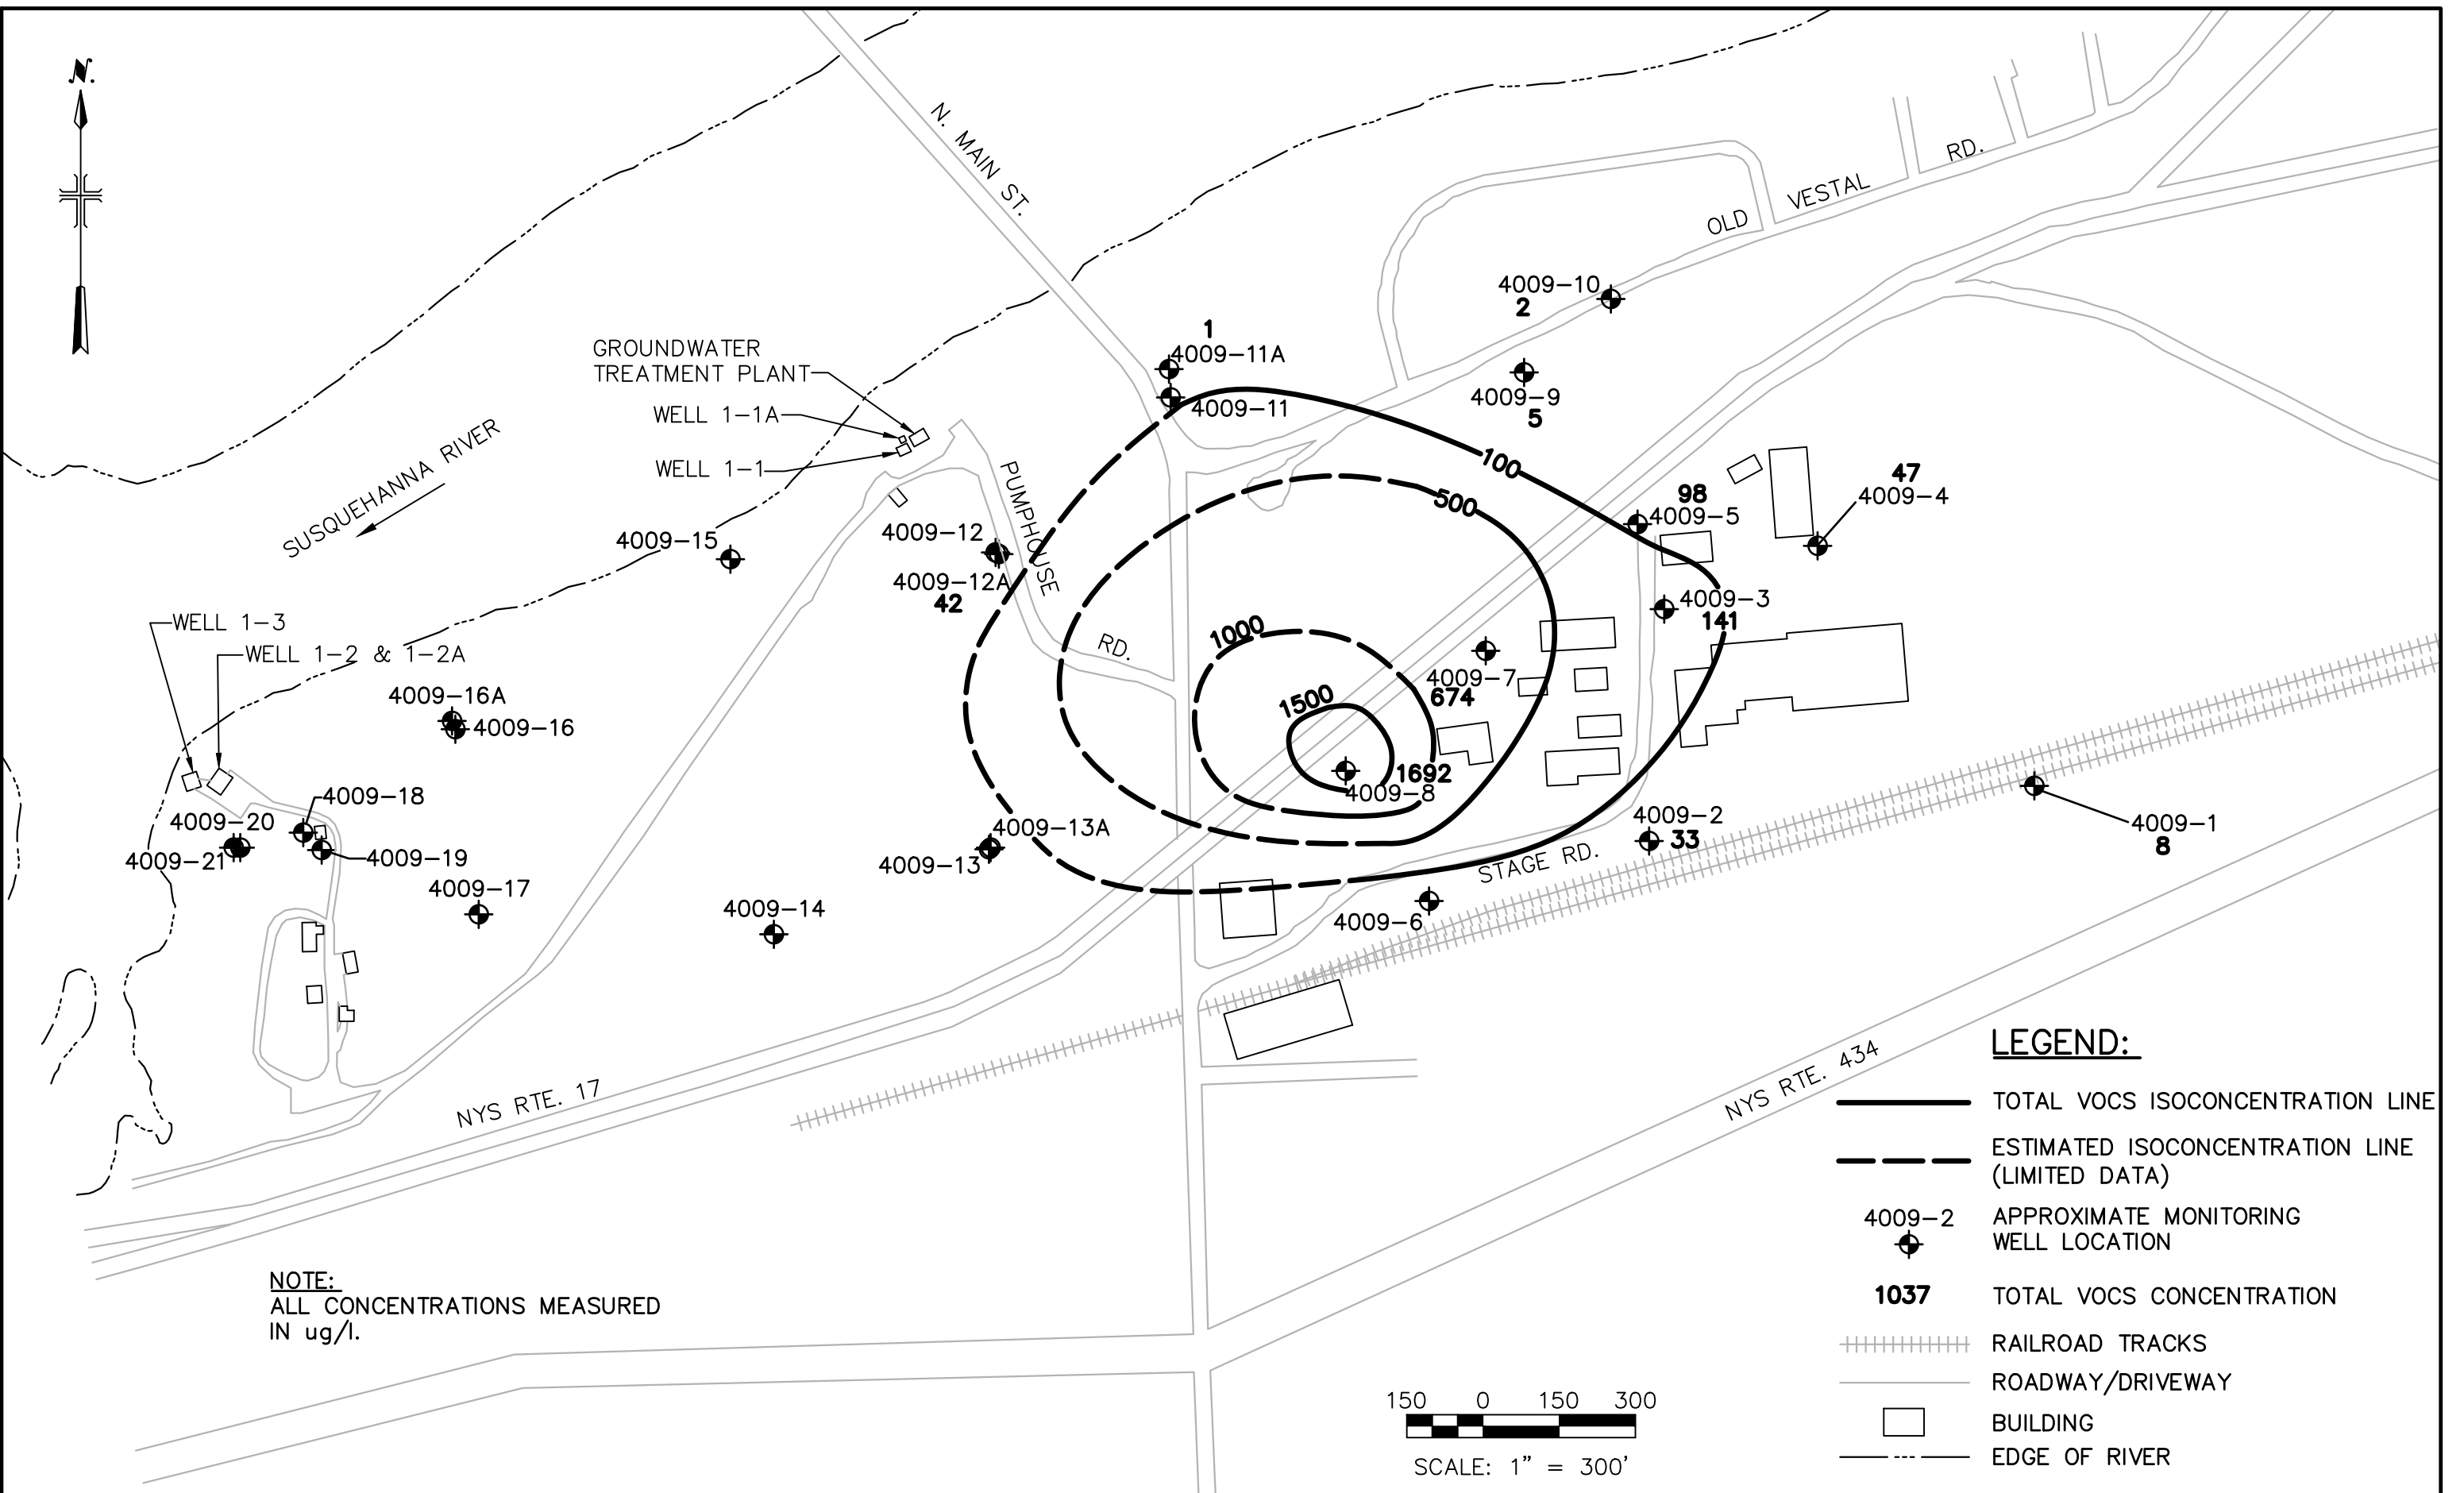

NOTE:
ALL CONCENTRATIONS MEASURED
IN ug/l.

LEGEND:

- TOTAL VOCS ISOCONCENTRATION LINE
- - - - - ESTIMATED ISOCONCENTRATION LINE (LIMITED DATA)
- 4009-2 APPROXIMATE MONITORING WELL LOCATION
- 1037** TOTAL VOCS CONCENTRATION
- +++++ RAILROAD TRACKS
- — — ROADWAY/DRIVEWAY
- BUILDING
- · - · - · EDGE OF RIVER

150 0 150 300
SCALE: 1" = 300'



NYSDEC STANDBY CONTRACT NO. D004443-4
NYSDEC SITE NO. 7-04-009
VESTAL WATER SUPPLY
VESTAL, NEW YORK

TOTAL VOC CONCENTRATIONS (JUNE 2011)
SCALE: 1" = 300'

ARCADIS-US, INC.
SEPTEMBER 2011
FIGURE 4-4