



Crompco LLC, an OWL Services Affiliated Company
1815 Gallagher Rd
Plymouth Meeting, PA 19462

7-Eleven Stores, Inc
Location #40133

3930 Dewey Avenue
Rochester, NY 14624
+1 585-663-6850

W-175667 Visit #178206 3/13/2026

Federal Stage I Pressure Decay 2-inch

Form Name			Result
Federal Stage I Pressure Decay 2-inch			● Pass
Overfill			
Equipment #	Grade	Overfill Type	Result
005	Regular	Overfill Drop Tube	● Pass

Nicholas Christina

Seth Boesel

Pressure Decay Test			
Stage 1 Type	Last Fuel Delivery	Is a swivel/rotatable or locking clamp style equipment installed on all gasoline fill ports?	Is a swivel/rotatable or locking clamp style equipment installed on all gasoline Stage 1 Vapor Adapters?
<input type="checkbox"/> Co-Axial <input checked="" type="checkbox"/> Dual Point <input type="checkbox"/> Combination Are tanks manifolded in the vapor space? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Date & Time ¹ <div style="border: 1px solid black; padding: 5px; width: fit-content;">03/09/2026 04:00pm</div>	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No

Pressure Decay Test Results

Tank Number	005	006	007		Total
1. Product Grade	Regular	Regular	Premium		
2. Distance of Drop Tube from Tank Bottom (<i>inches</i>)	2	2	2		
3. Actual Tank Capacity (<i>gallons</i>)	9684	9684	9684		29052
4. Gasoline Volume (<i>gallons</i>)	3488	3479	2839		9806
5. Ullage ² (<i>gallons</i>) (Ullage = Line #4 – Lines #5)	6196	6205	6845		19246
Start Time of Test					03/16/2026 04:00pm
6. Initial Pressure (<i>inches H₂O</i>)					2.00
7. Pressure After 1 Minute (<i>inches H₂O</i>)					2.00
8. Pressure After 2 Minutes (<i>inches H₂O</i>)					1.99
9. Pressure After 3 Minutes (<i>inches H₂O</i>)					1.98
10. Pressure After 4 Minutes (<i>inches H₂O</i>)					1.97
11. Pressure After 5 Minutes (<i>inches H₂O</i>)					1.96
12. Allowable Pressure ³ (<i>inches H₂O</i>)					1.9486
Result					<input checked="" type="checkbox"/> Pass <input type="checkbox"/> Fail

Comments

UST Registration # 8-065560

Confidential Business Information

Location Phone #: 5856636850

Location PBS #: 8-065560






Tank #	Grade	Capacity	Install Date
005	Regular	9684	6/1/1994
006	Regular (drone)	9684	6/1/1994
007	Premium	9684	6/1/1994

Annual Gasoline Throughput

Regular: 652,584
Plus: 48,671
Premium: 37,216
Ultra: 25,972



Diagram - Site Diagram (v1)

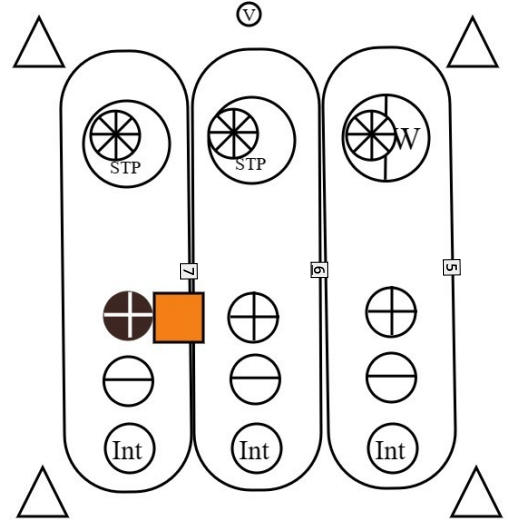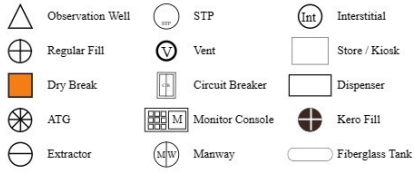

1: Dispenser - 5/6

2: Dispenser - 3/4

3: Dispenser - 1/2

4: Dispenser - 7/8

5: Fiberglass Tank - Reg Siphon

6: Fiberglass Tank - Reg Master

7: Fiberglass Tank - Prem



Visit Verification

CUSTOMER
 7-Eleven Stores, Inc

LOCATION
 #40133
 3930 Dewey Avenue
 Rochester, NY 14624

CONTACT
 7-Eleven Stores, Inc

SCHEDULED
 03/13/2026 12:00am (EDT)

ASSIGNED TO
 Nicholas Christina, Seth Boesel

SERVICE REASON
 Compliance Retest

PRODUCTS & SERVICES

Item	Qty
Services	
Overfill Verification	1.00
Federal Stage I Pressure Decay	1.00

CONFIRMATION

By signing this verification you are agreeing that we have performed and/or provided services and parts listed above.

Approver's Name
 Nsb

Email

Signature Status
 Captured