



GTE Operations Support Incorporated
One Verizon Way (VC34W414)
Basking Ridge, NJ 07920-1097
(908) 559-3691

August 22, 2011

Mr. Thomas Festa
New York State Department of Environmental Conservation
Division of Environmental Remediation
625 Broadway, 12th Floor
Albany, NY 12233-7017

Re: *June 2011 Indoor Air Sampling Report*

Dear Mr. Festa:

Attached are the June 2011 indoor air sampling results for the former Philips Display Components facility in Seneca Falls, New York. Volatile organic compounds (VOC), primarily trichloroethene, were detected in subslab vapor and indoor air. Three subslab depressurization (SSD) and two ventilation systems have been effective in reducing VOC concentrations.

GTE Operations Support Incorporated will continue to collect samples quarterly to monitor the effectiveness of the systems. The next sampling event will be conducted during the week of September 19, 2011.

Please call me at (908) 559-3691 if you have any questions.

Sincerely,

Pam M. Cox /MAF

Pam M. Cox
Manager – Workplace Safety & Environmental Compliance

ATTACHMENTS

Attachment A – June 2011 Indoor Air Sampling Event Summary
Attachment B – Figures
Attachment C – Tables
Attachment D – Data Validation Report

c:	Ms. Denise Radtke NYS Dept of Environmental Conservation 625 Broadway Albany, NY 12233-7252	Mr. Daniel Lang ARCADIS U.S., Inc. 855 Route 146, Suite 210 Clifton Park, NY 12065
	Ms. Melissa A. Menetti New York State Department of Health 547 River Street Troy, NY 12180	Mr. Scott Foti NYSDEC, Region 8 6274 East Avon-Lima Road Avon, NY 14414
	Mr. James Reidy USEPA, Region 2 290 Broadway New York, NY 10007-1866	Mr. Sam Ezekwo USEPA, Region 2 290 Broadway New York, NY 10007-1866
	Mr. Ray Larkin Philips Components Environmental Consultant 9 Hawthorne Court North Kingstown, RI 02852-4646	Ms. Marzi Sharfaei ARCADIS U.S., Inc. 1515 E. Woodfield Road Suite 360 Schaumburg, IL 60173
	Mr. Michael Hanna H.P. Neun 75 North Main Street Fairport, NY 14450	Ms. Patricia Jones Seneca County IDA 1 DiPronio Drive Waterloo, NY 13165-1681

Attachment A
June 2011 Indoor Air Sampling Event Summary

Introduction

In June 2011, indoor air and subslab vapor samples were collected at the former Philips Display Components facility in Seneca Falls, New York (Figure 1). Indoor air samples are collected and analyzed quarterly to monitor concentrations of volatile organic compounds (VOC), primarily trichloroethene (TCE).

To minimize VOC concentrations in subslab vapor and indoor air, the following subslab depressurization (SSD) and ventilation systems have been installed:

- Building 9 Office Area crawl space ventilation system in November 2004,
- Building 11 Area SSD system in November 2005,
- Building 7 Area SSD system in October 2006,
- Building 10 Area SSD system in October 2010, and
- Building 1A sump/trench ventilation system in December 2010.

The Building 9 Office Area crawl space ventilation system operated from November 2004 to June 2010. The system stopped operating in June 2010 because of an electrical issue causing the fan motor to overheat. The Building 9 Area indoor air quality continues to be monitored to evaluate if the Building 9 ventilation system needs to be reactivated.

Either a digital manometer or U-tube vacuum indicator are used to confirm the Building 11, 7, and 10 SSD systems and the Building 1A sump/trench ventilation system are operating as designed. The digital manometer measures pressure at subslab monitoring points near the SSD systems. The U-tube vacuum indicator measures the pressure in the Building 1A sump/trench ventilation system piping.

On June 22, 2011, the following air samples were collected:

- Eleven indoor air samples and one duplicate indoor air sample,
- One crawl space air sample,
- One subslab vapor sample, and
- Two outdoor (ambient) air samples.

The sample locations are shown on Figures 2 through 6. Samples were analyzed by TestAmerica Laboratories, Inc. of Burlington, Vermont for 16 site-specific VOCs. The subslab sample was analyzed using United States Environmental Protection Agency (USEPA) Method TO-15. Crawl space and indoor- and outdoor-air samples were analyzed using low-level USEPA Method TO-15. Analytical results are provided in Tables 1 through 6 and displayed graphically on Figures 7 through 11.

Sampling, laboratory analysis, quality assurance and quality control, and data validation were conducted in accordance with the *Soil Vapor Intrusion Pathway Investigation Work Plan and Quality Assurance Project Plan* dated May 7, 2003. Data Validation Services, Inc. of North Creek, New York performed third-party data validation. Sample analysis and reporting were completed in compliance with project requirements.

Contaminant Trends

The June 2011 indoor air TCE concentrations ranged from 0.15 to 2.4 micrograms per cubic meter ($\mu\text{g}/\text{m}^3$), which are within the range measured since the ventilation and SSD systems began operating. The TCE concentration range was narrower than in June 2010 (0.091 to $6.4 \mu\text{g}/\text{m}^3$).

Building 9 Area

The TCE concentration in the Building 9 office indoor air ($2.1 \mu\text{g}/\text{m}^3$) was higher than the June 2010 concentration ($0.91 \mu\text{g}/\text{m}^3$) but was within the previous concentration range (0.12 to $30 \mu\text{g}/\text{m}^3$). The TCE concentration in the Building 9 warehouse indoor air ($0.15 \mu\text{g}/\text{m}^3$) was slightly higher than the June 2010 concentration ($0.091 \mu\text{g}/\text{m}^3$) but was within the previous concentration range (0.091 to $51 \mu\text{g}/\text{m}^3$). The TCE concentration in the Building 9 crawlspace air ($48 \mu\text{g}/\text{m}^3$) was within the previous concentration range (5.4 to $210 \mu\text{g}/\text{m}^3$). The Building 9 office indoor air concentration remains below the New York State Department of Health Air guideline value of $5 \mu\text{g}/\text{m}^3$.

Building 11 Area

The Building 11 Area comprises parts of Buildings 11, 11A, 13, and 13A. TCE concentrations in Building 11 Area indoor air ranged from 0.86 to $2.4 \mu\text{g}/\text{m}^3$, which were within the previous concentration range (0.70 to $81 \mu\text{g}/\text{m}^3$) during system operation. As shown in the following table, the June 2011 Building 11 Area indoor air TCE concentrations were less than the respective June 2010 concentrations.

Building	June 2011 TCE Concentration in Indoor Air ($\mu\text{g}/\text{m}^3$)	June 2010 TCE Concentration in Indoor Air ($\mu\text{g}/\text{m}^3$)
11	0.98	2.8
11A	0.86	2.5
13	1.5	6.4
13A	2.4	4.7

Subslab vapor samples in the Building 11 Area are collected each December. The Building 11 Area SSD system continues to sustain negative pressures in the subslab greater than 100 feet from the extraction wells.

Building 7 Area

The TCE concentration in the indoor air was $1.0 \mu\text{g}/\text{m}^3$, within the previous concentration range (0.64 to $18 \mu\text{g}/\text{m}^3$) during system operation, and slightly less than the concentration in June 2010 ($1.1 \mu\text{g}/\text{m}^3$). TCE concentrations in the subslab vapor beneath Building 7 have decreased by two orders of magnitude since July 2003, from 3,300 to $43 \mu\text{g}/\text{m}^3$ (Figure 8). The Building 7 SSD system continues to sustain negative pressures in the subslab greater than 45 feet from the extraction wells.

Building 10 Area

The TCE concentrations in the Buildings 10 and 10A indoor air samples were 0.61 and $0.91 \mu\text{g}/\text{m}^3$, respectively. These concentrations were lower than the Building 10 and 10A June 2010 TCE concentrations ($4.4 \mu\text{g}/\text{m}^3$ and $6.4 \mu\text{g}/\text{m}^3$, respectively). The Building 10 SSD system sustains negative pressures in the subslab greater than 100 feet from the extraction wells.


Building 1A Area

The TCE concentration in the Building 1A first floor indoor air ($0.26 \mu\text{g}/\text{m}^3$) was two orders of magnitude less than the June 2010 concentration ($27 \mu\text{g}/\text{m}^3$) and was within the previous concentration range (0.059 to $27 \mu\text{g}/\text{m}^3$). The TCE concentration in the Building 1A basement indoor air ($0.43 \mu\text{g}/\text{m}^3$) was significantly less than the June 2010 concentration ($120 \mu\text{g}/\text{m}^3$) and within the previous concentration range (0.081 to $160 \mu\text{g}/\text{m}^3$). The Building 1A sump/trench ventilation system was installed in December 2010 and modified with the addition of a subslab vapor extraction point in April 2011.

Conclusions


The analytical results and field measurements indicate that the ventilation and SSD systems are effective at sustaining negative differential pressures. Operation of the ventilation and SSD systems has continued to lower the concentrations of VOCs in the subslab vapor and indoor air.


Attachment B
Figures

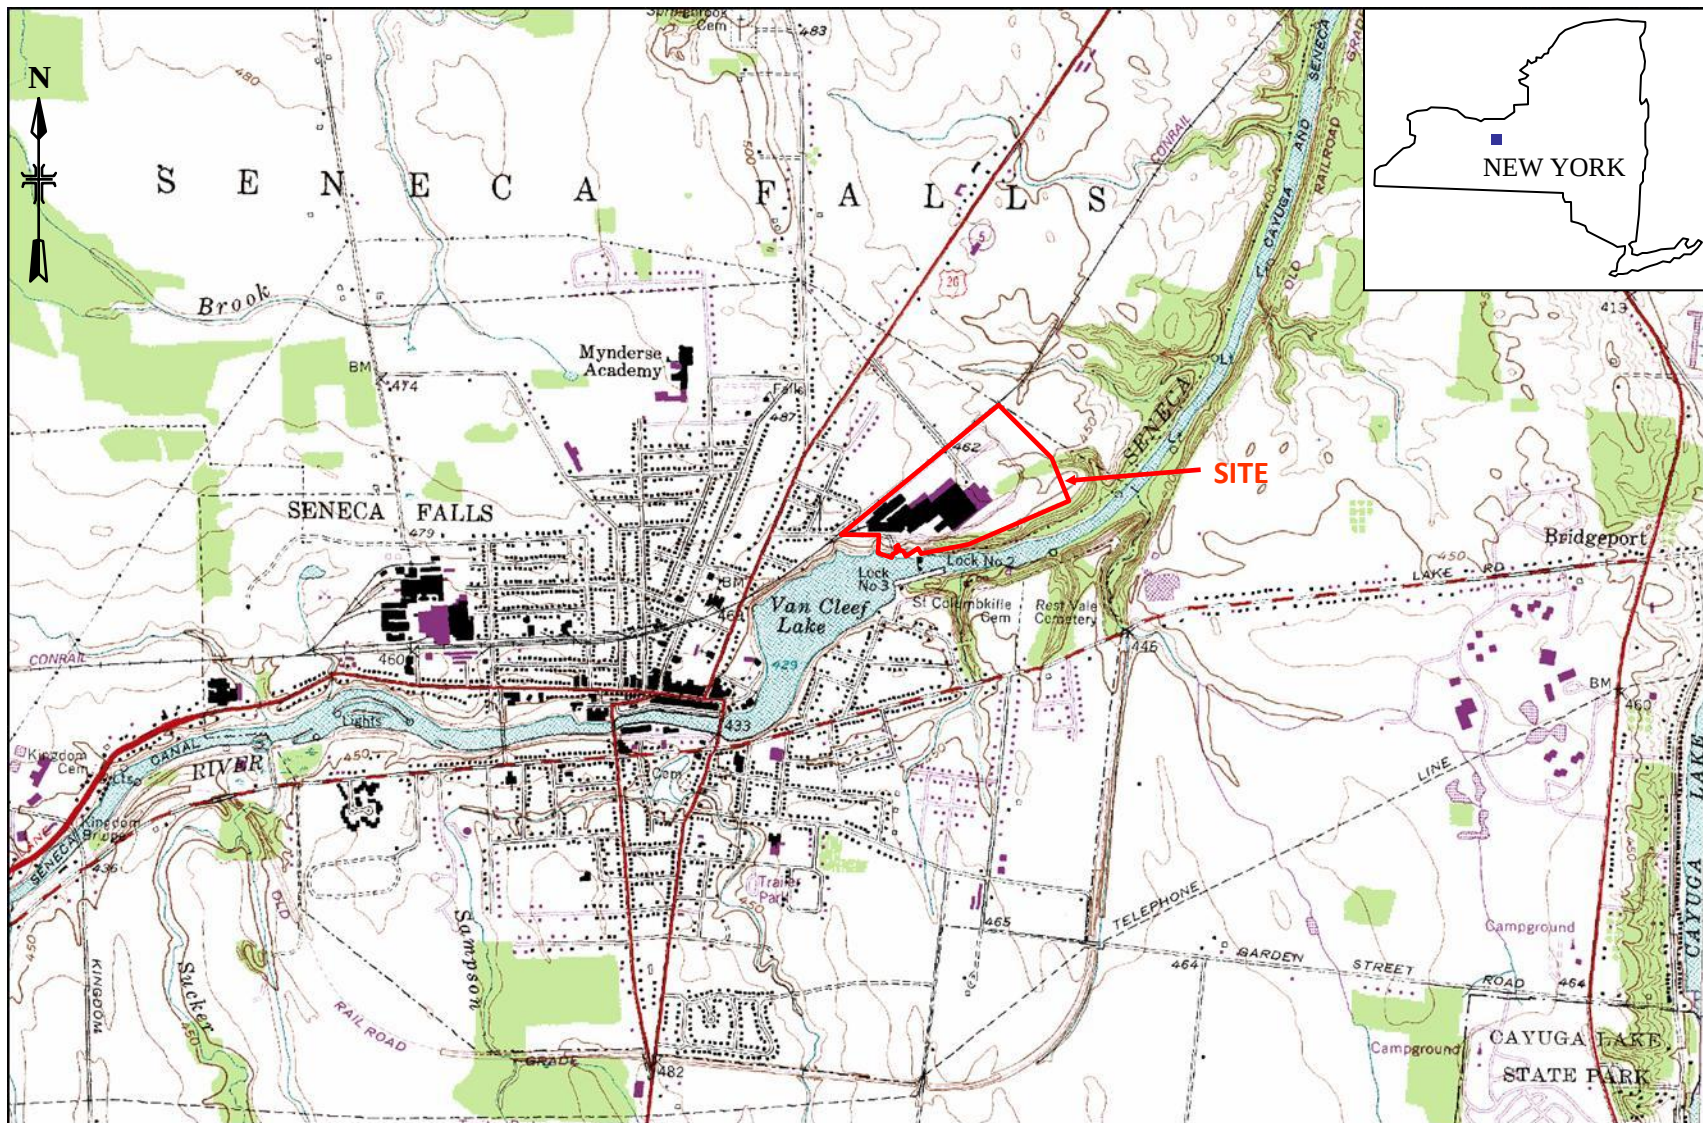



MAP SOURCE: USGS 7.5 MINUTE TOPOGRAPHIC SERIES, SENECA FALLS QUADRANGLE


APPROXIMATE SCALE IN MILES



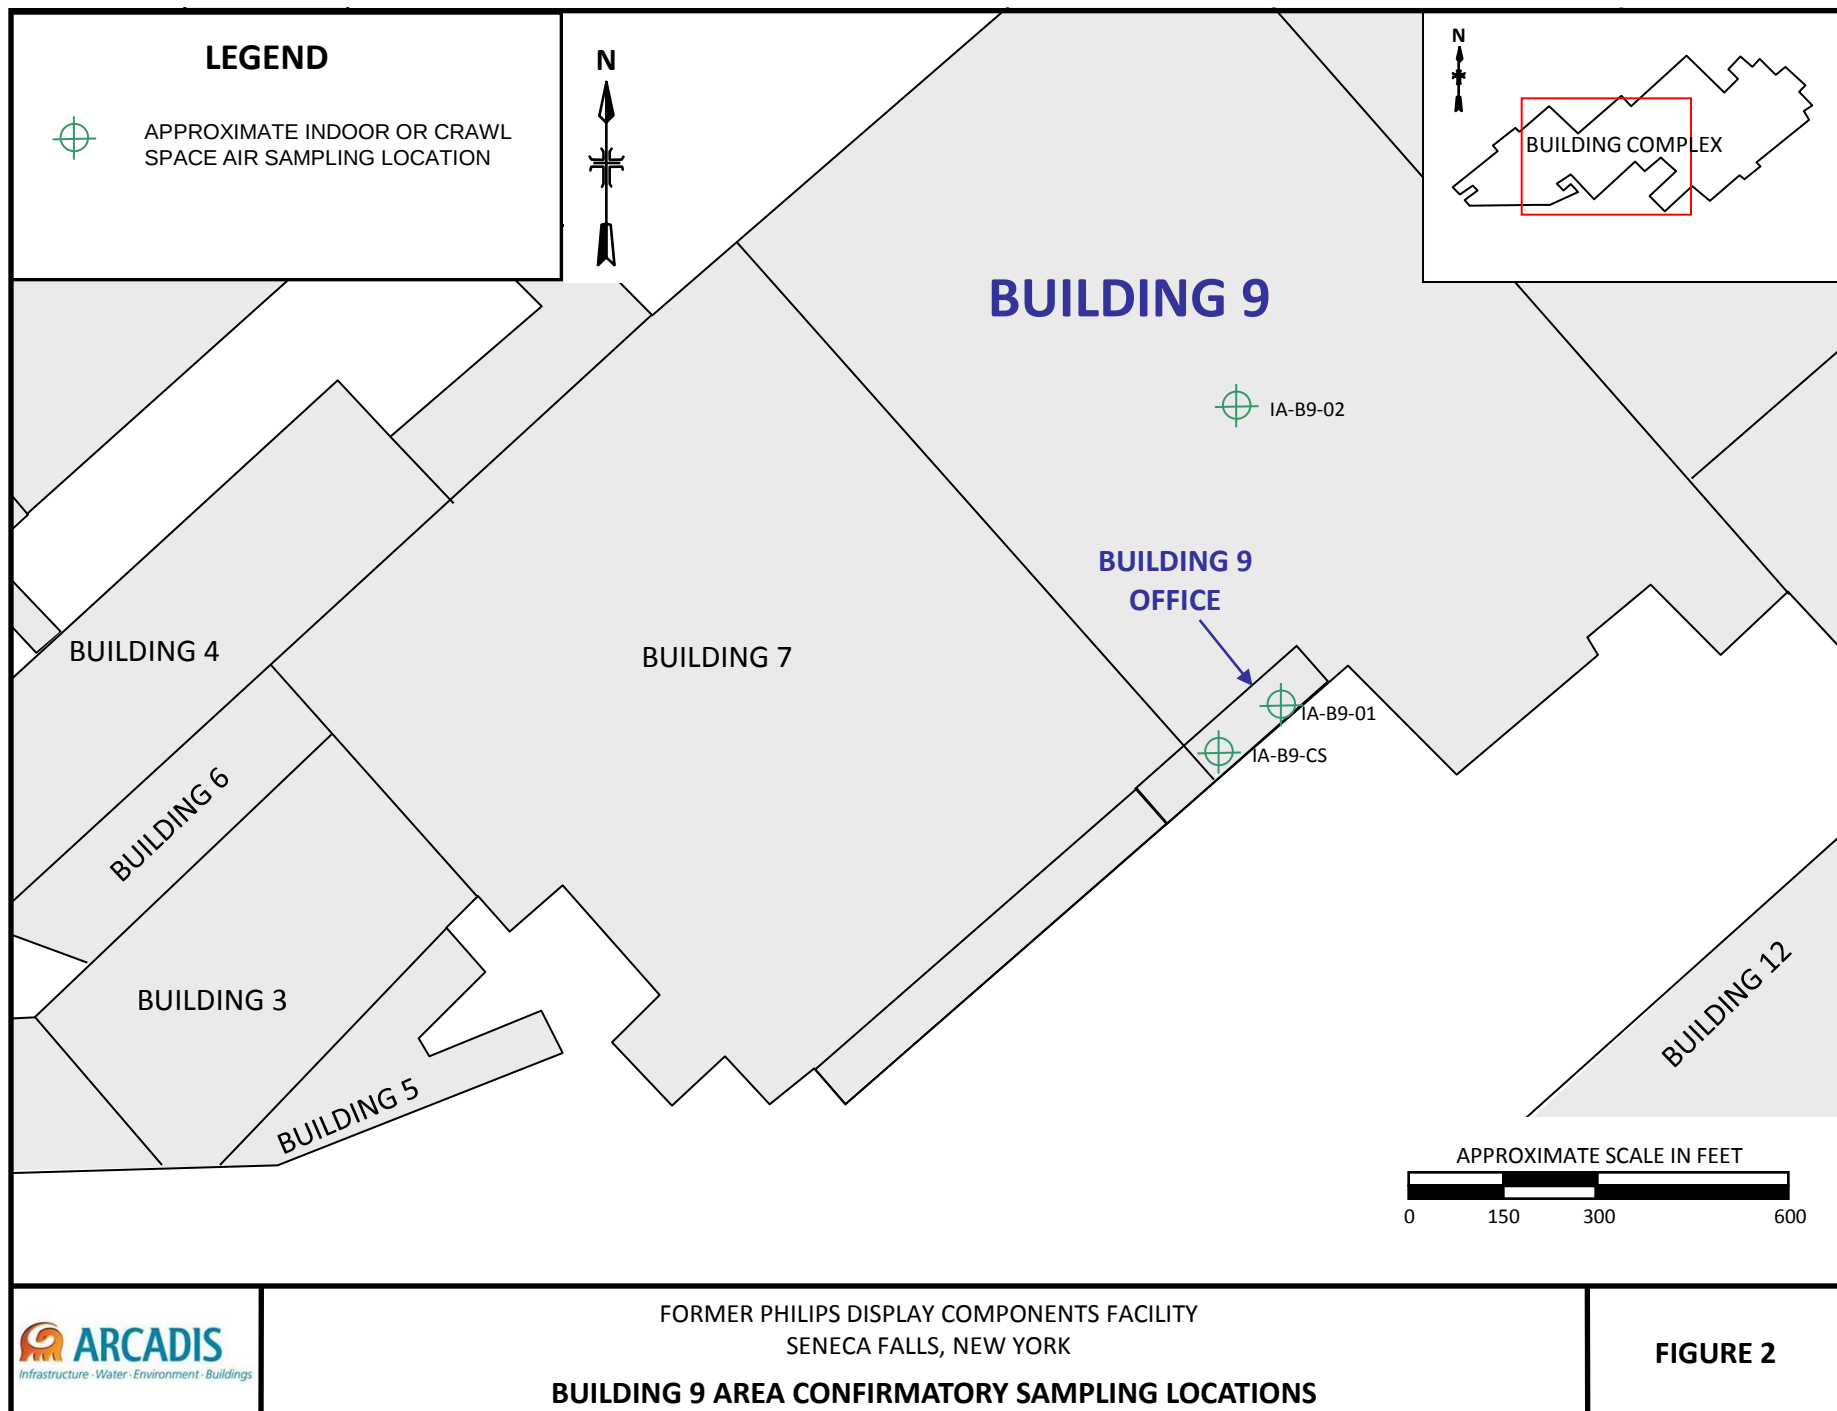

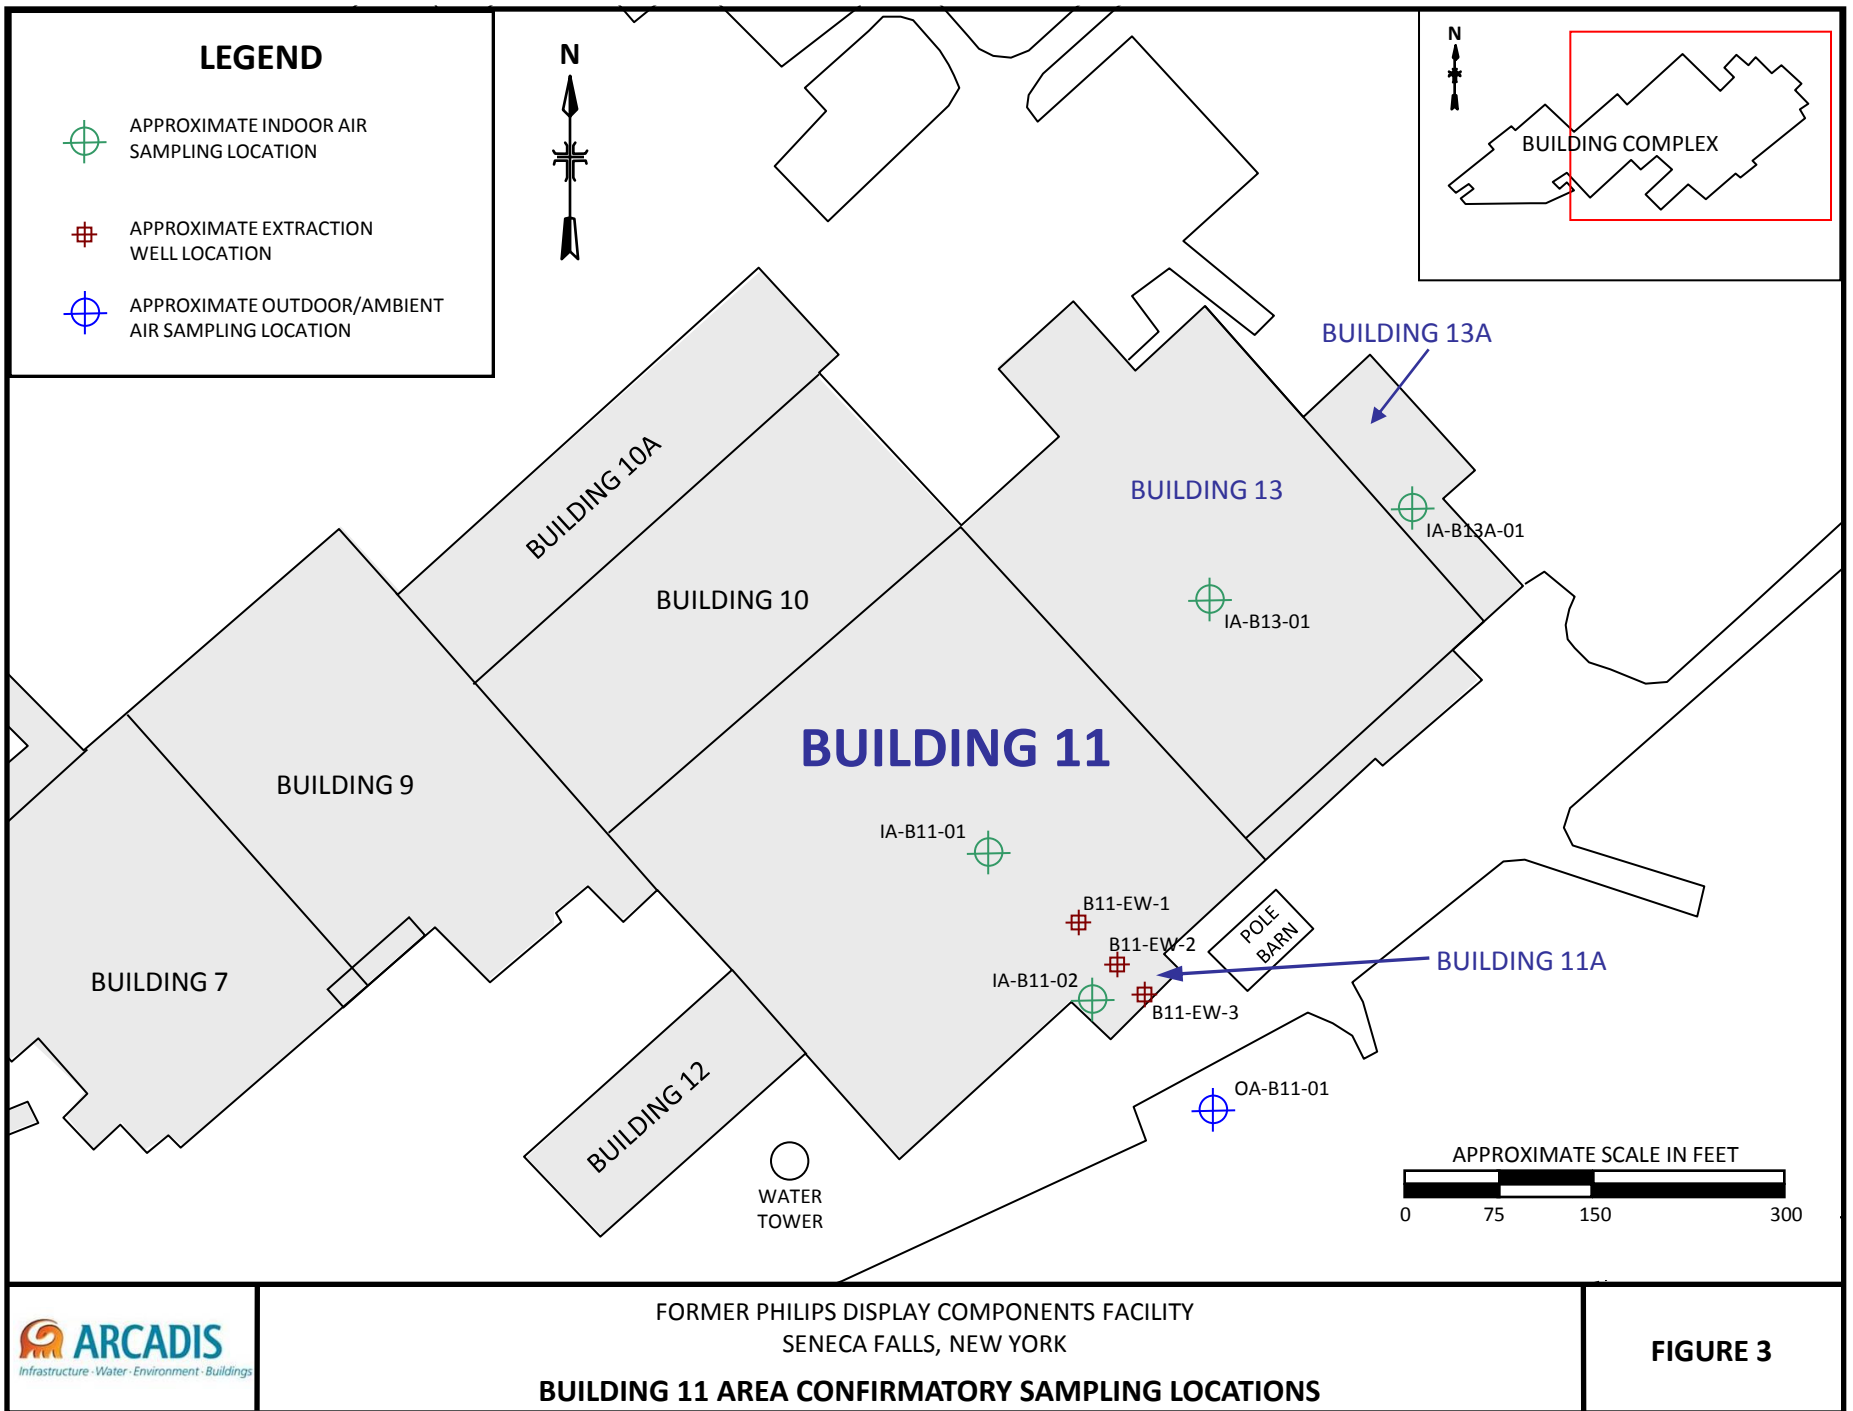

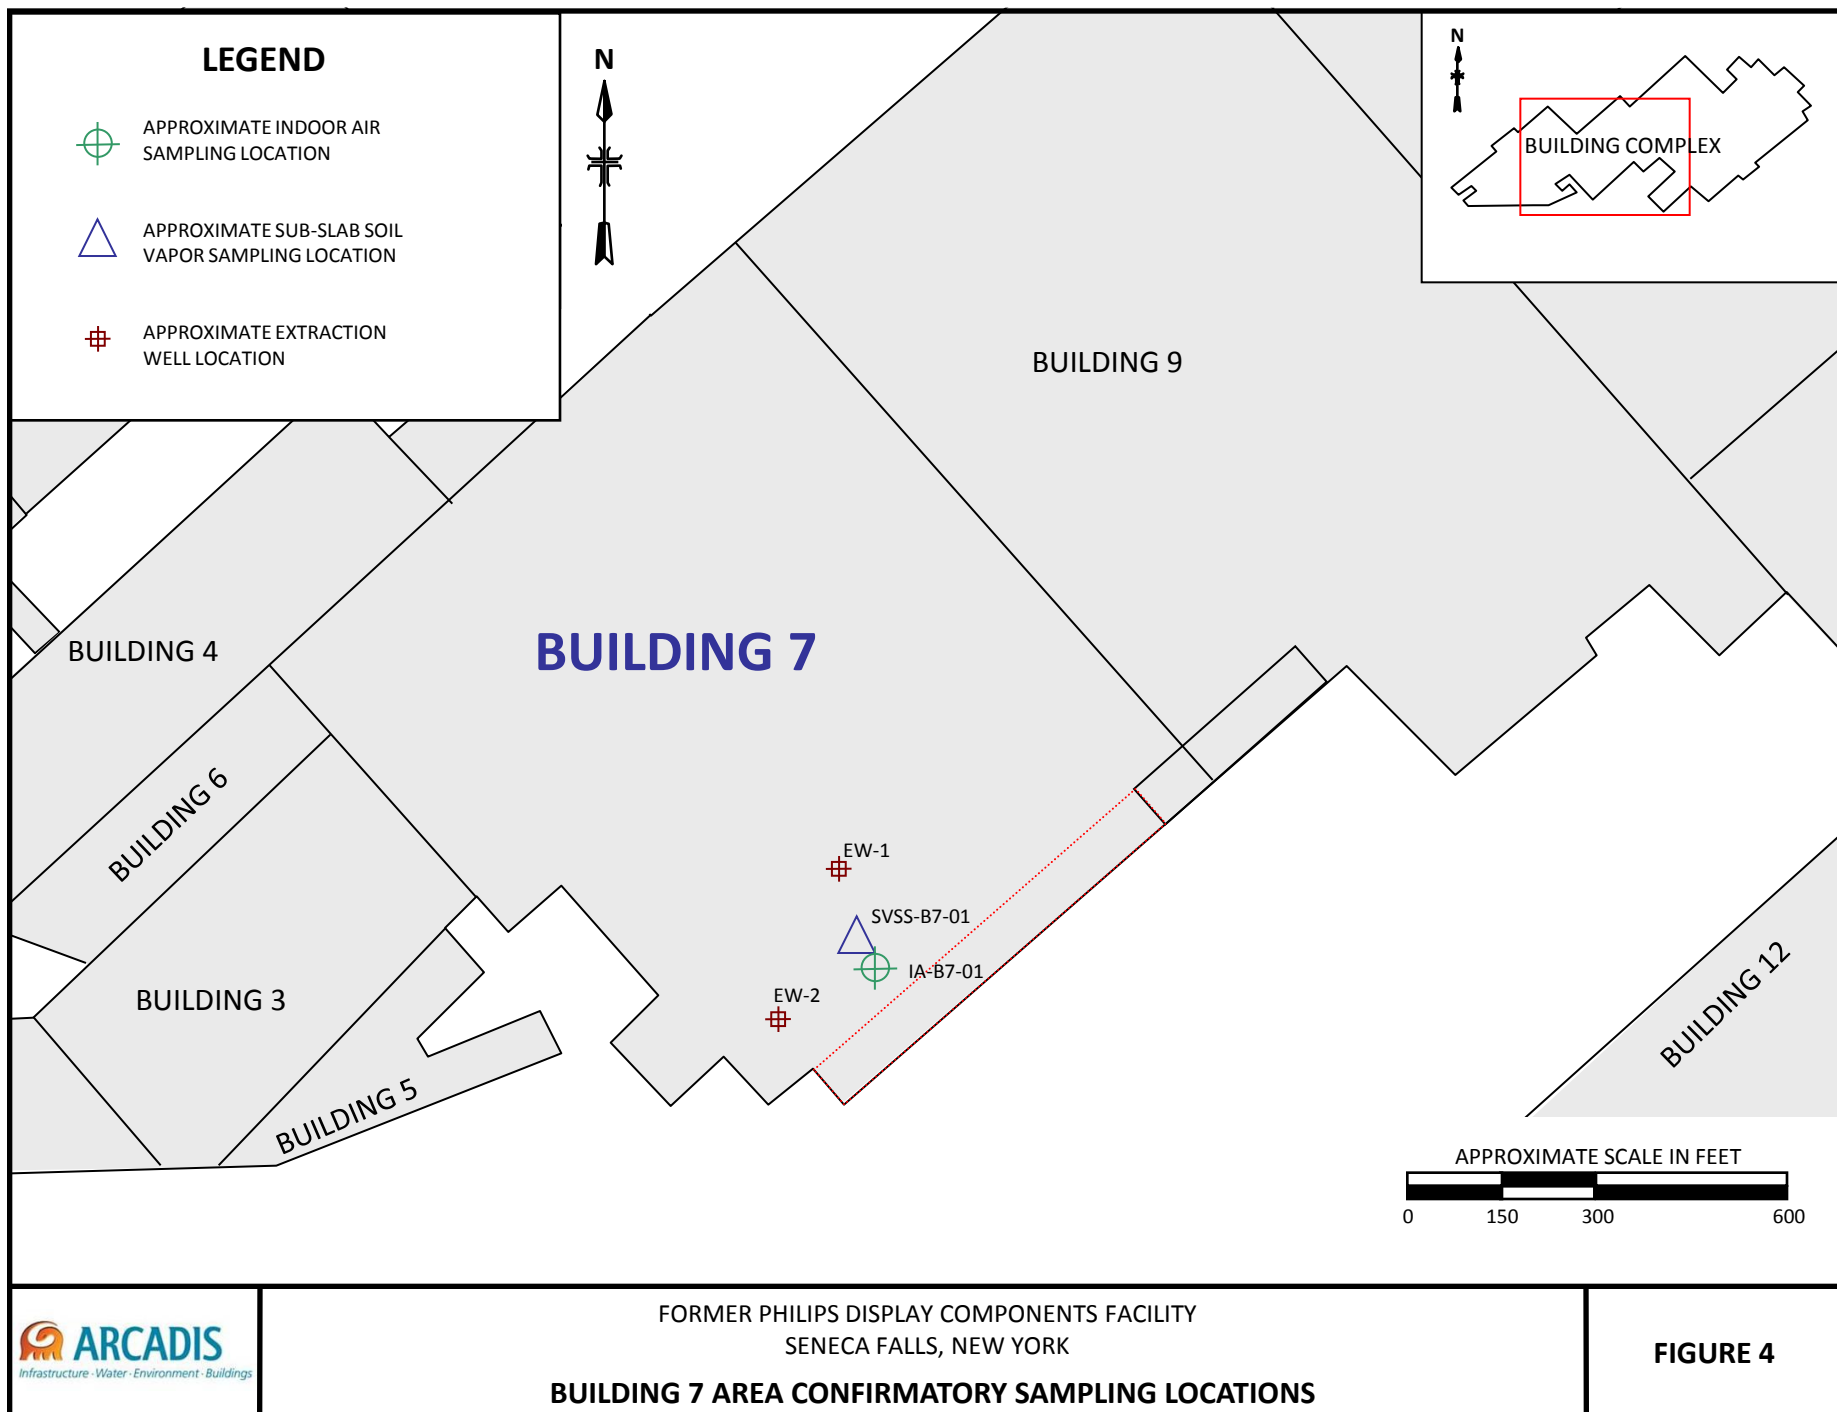

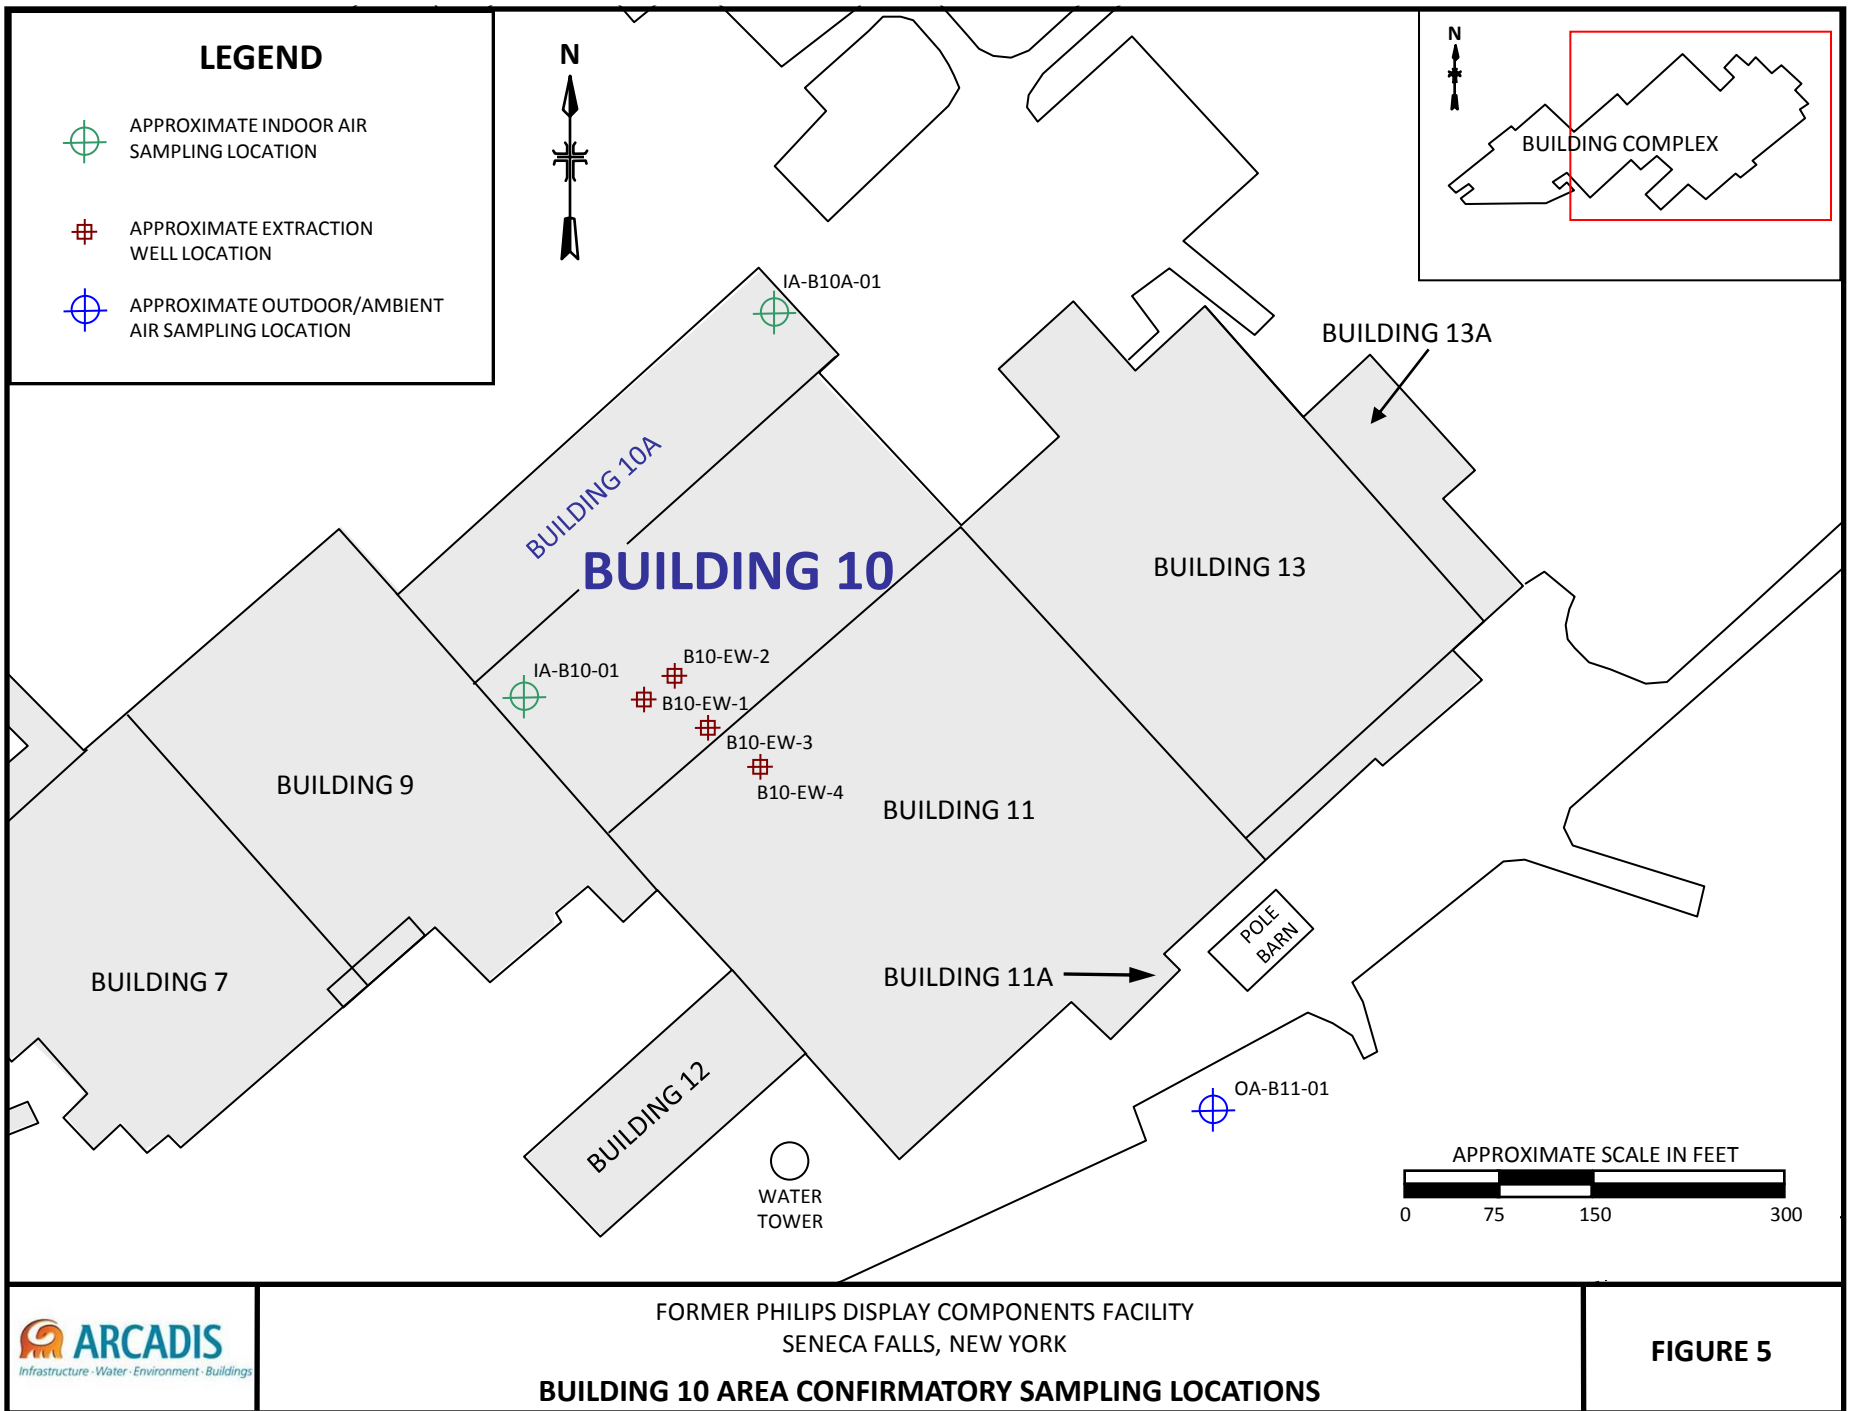

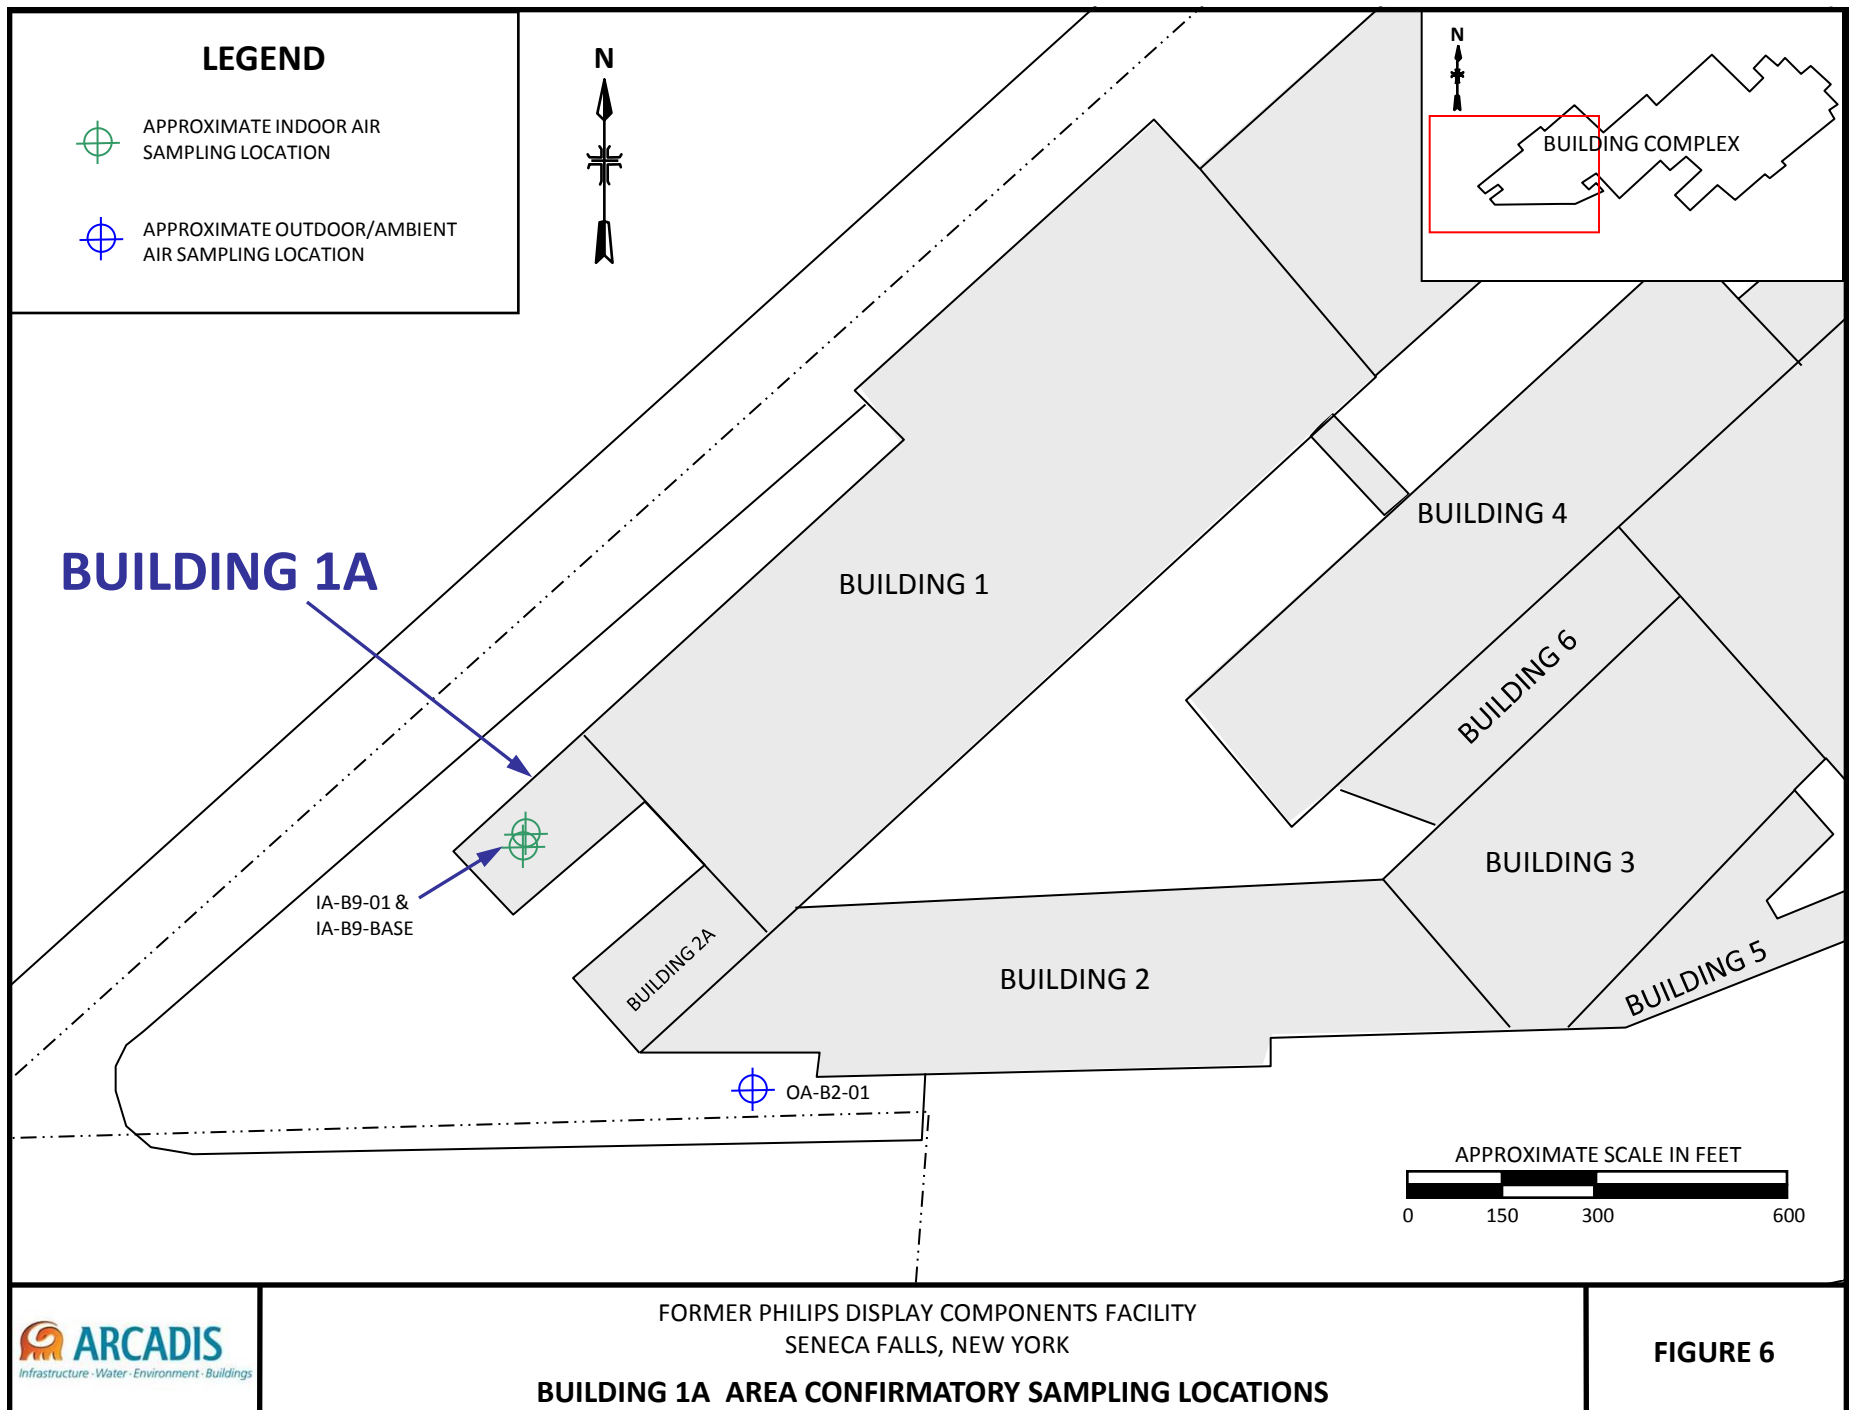


Figure 7: Building 9 Area TCE Concentrations

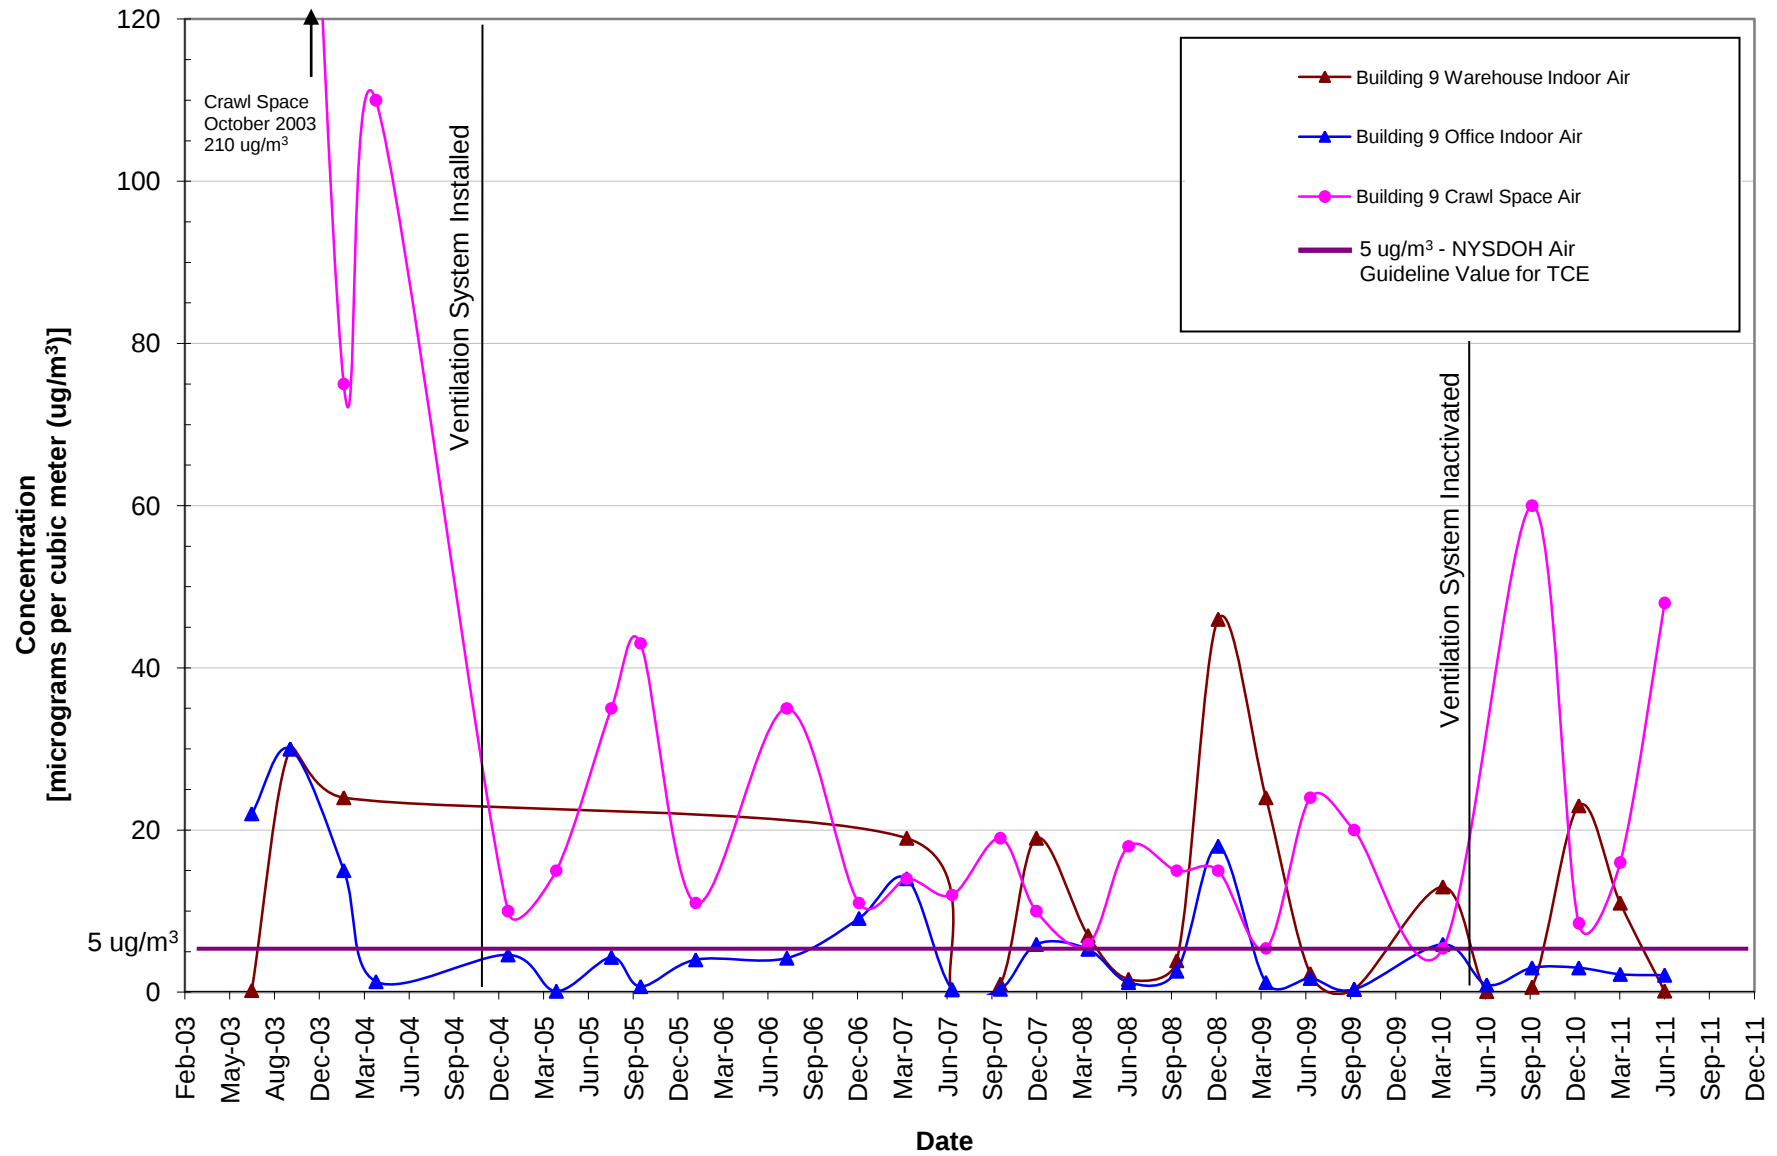


Figure 8: Building 11 Area TCE Concentrations

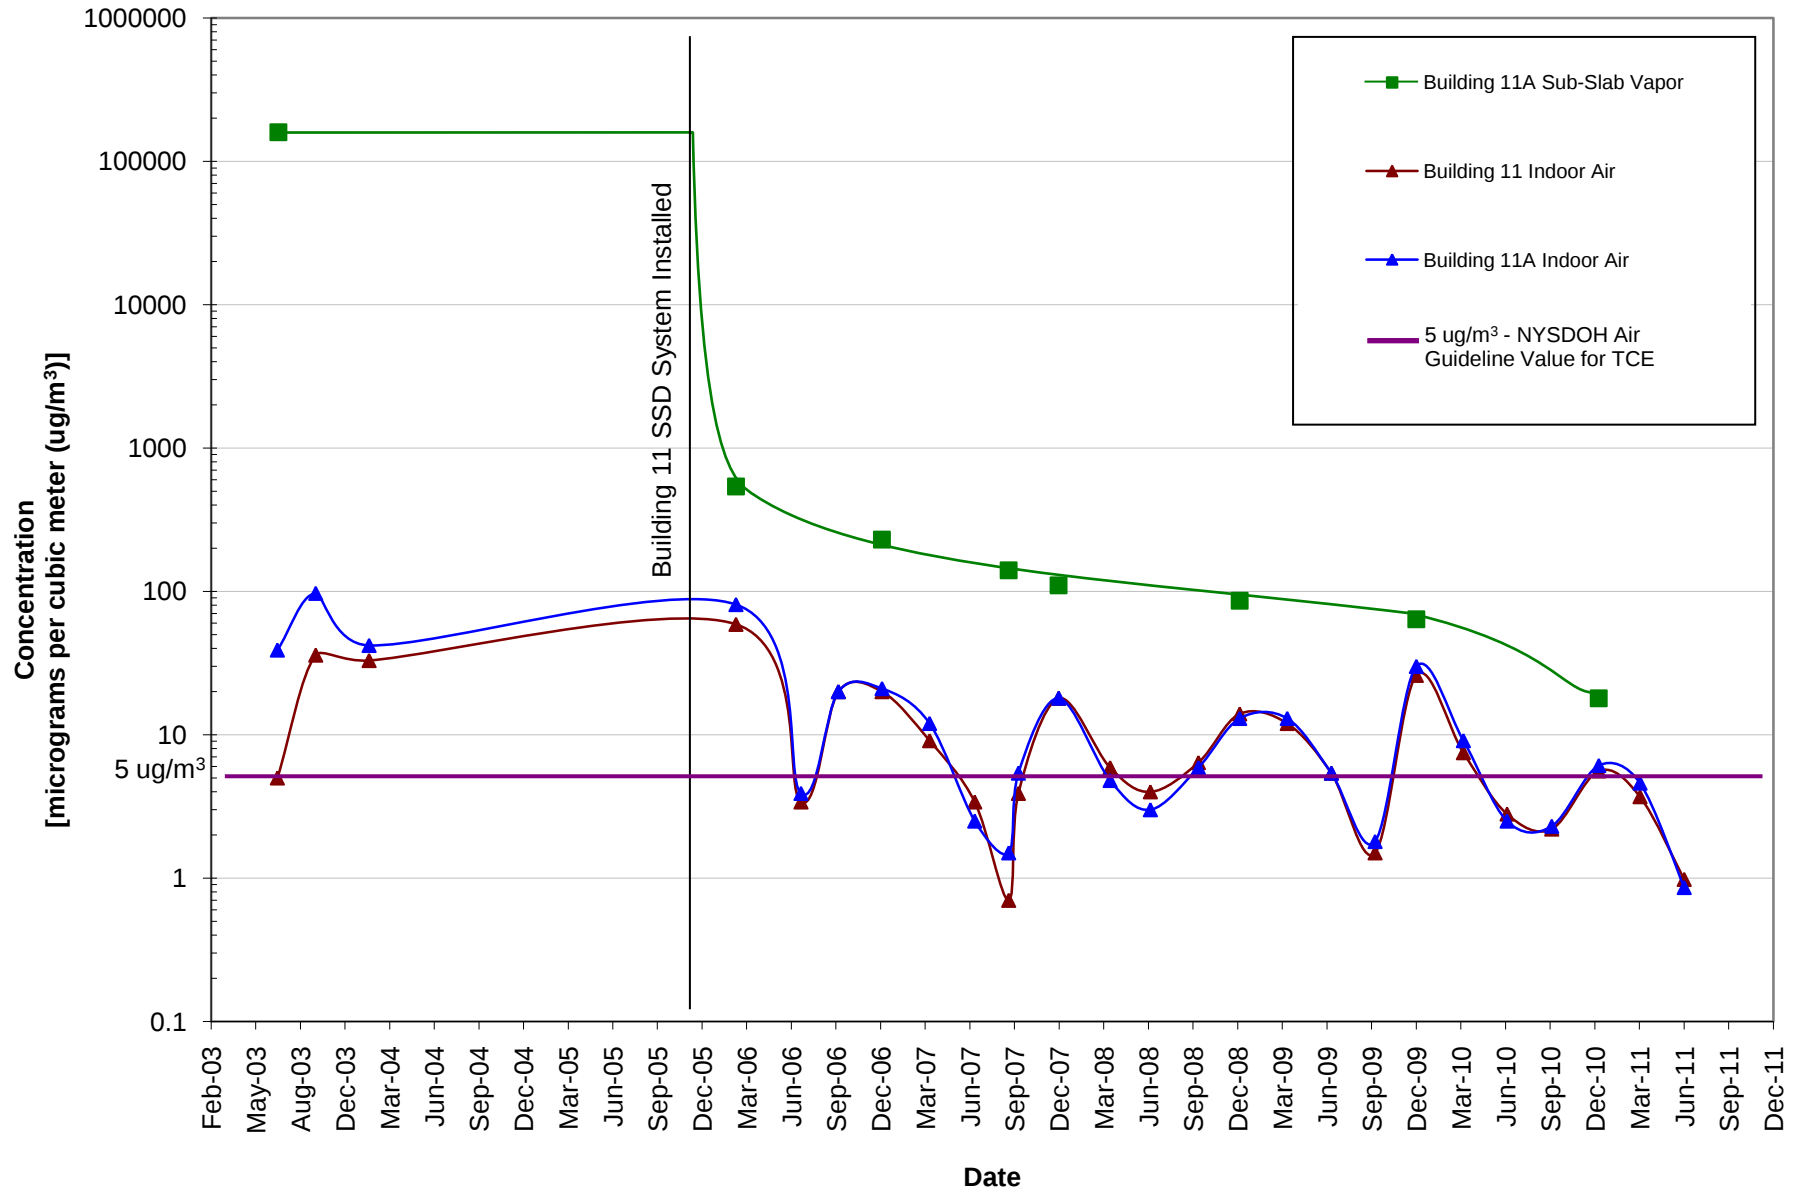


Figure 9: Building 7 Area TCE Concentrations

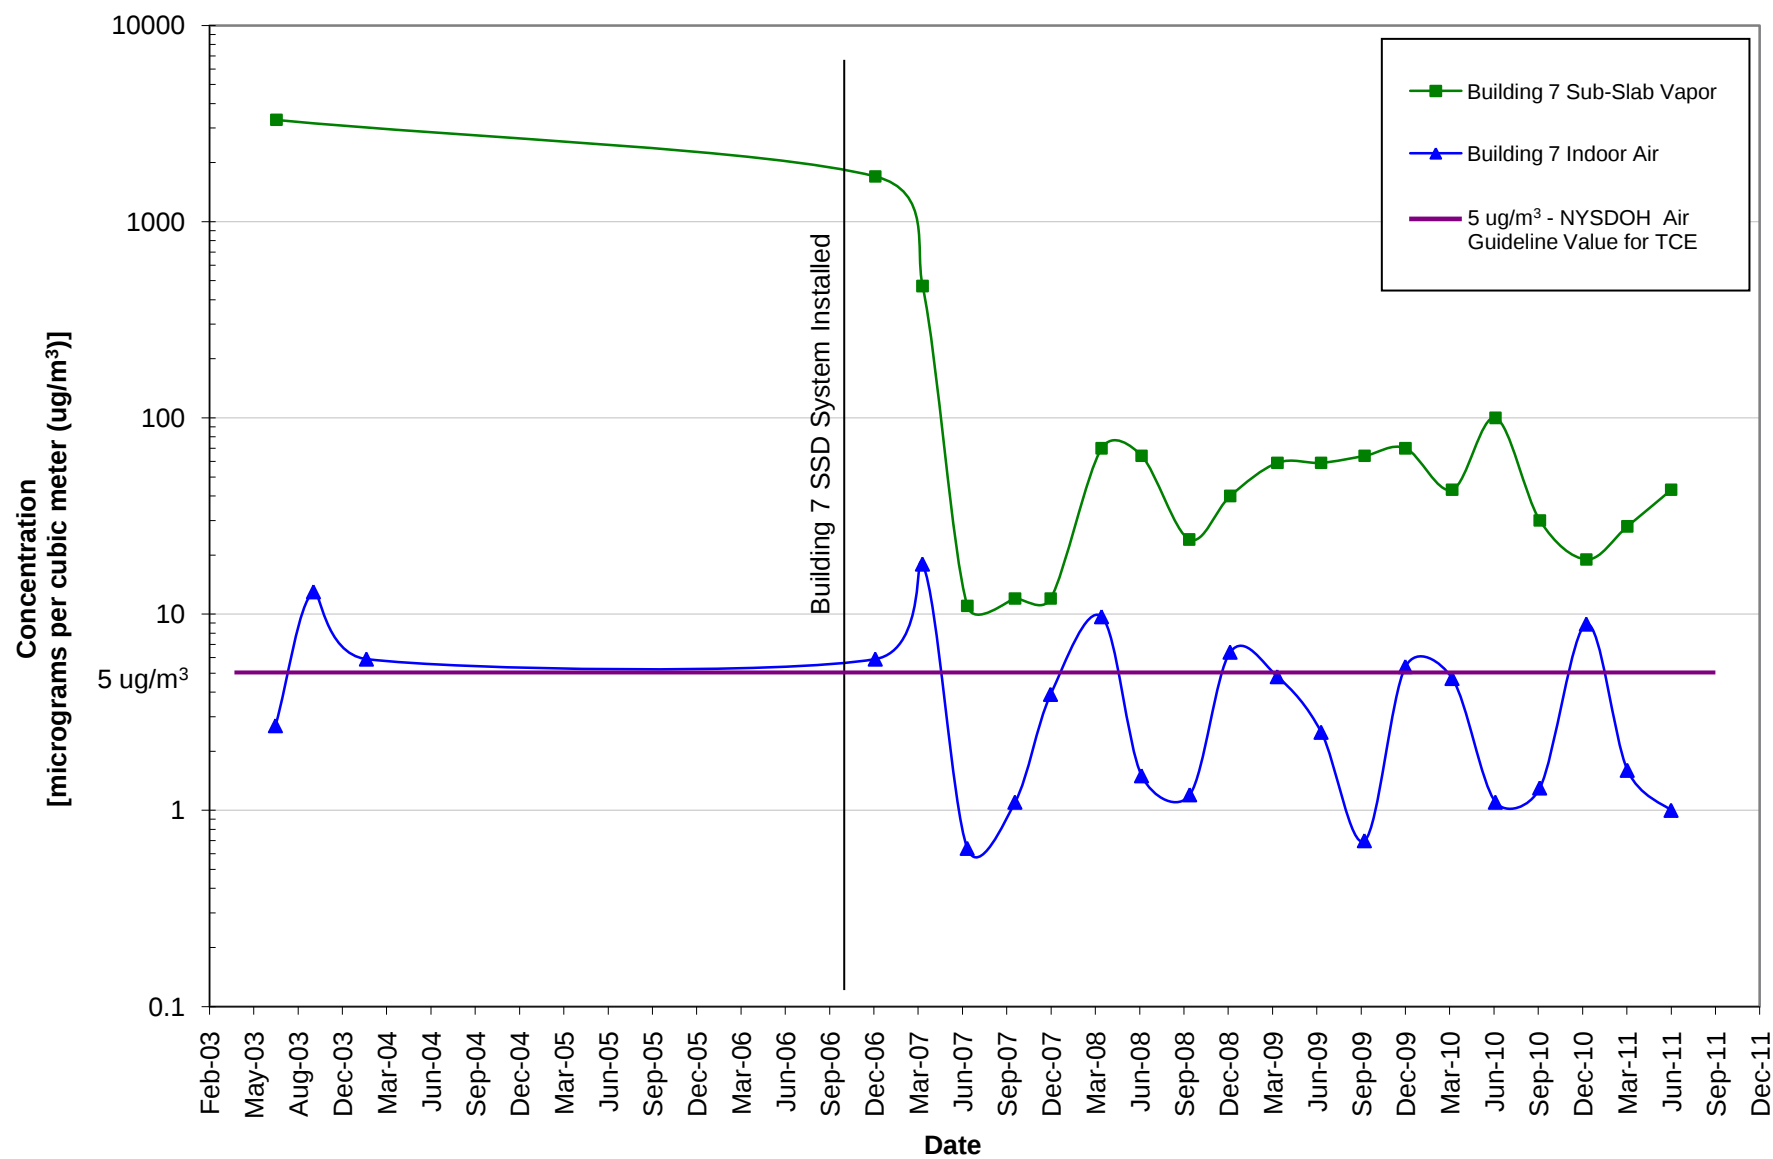


Figure 10: Building 10 Area TCE Concentrations


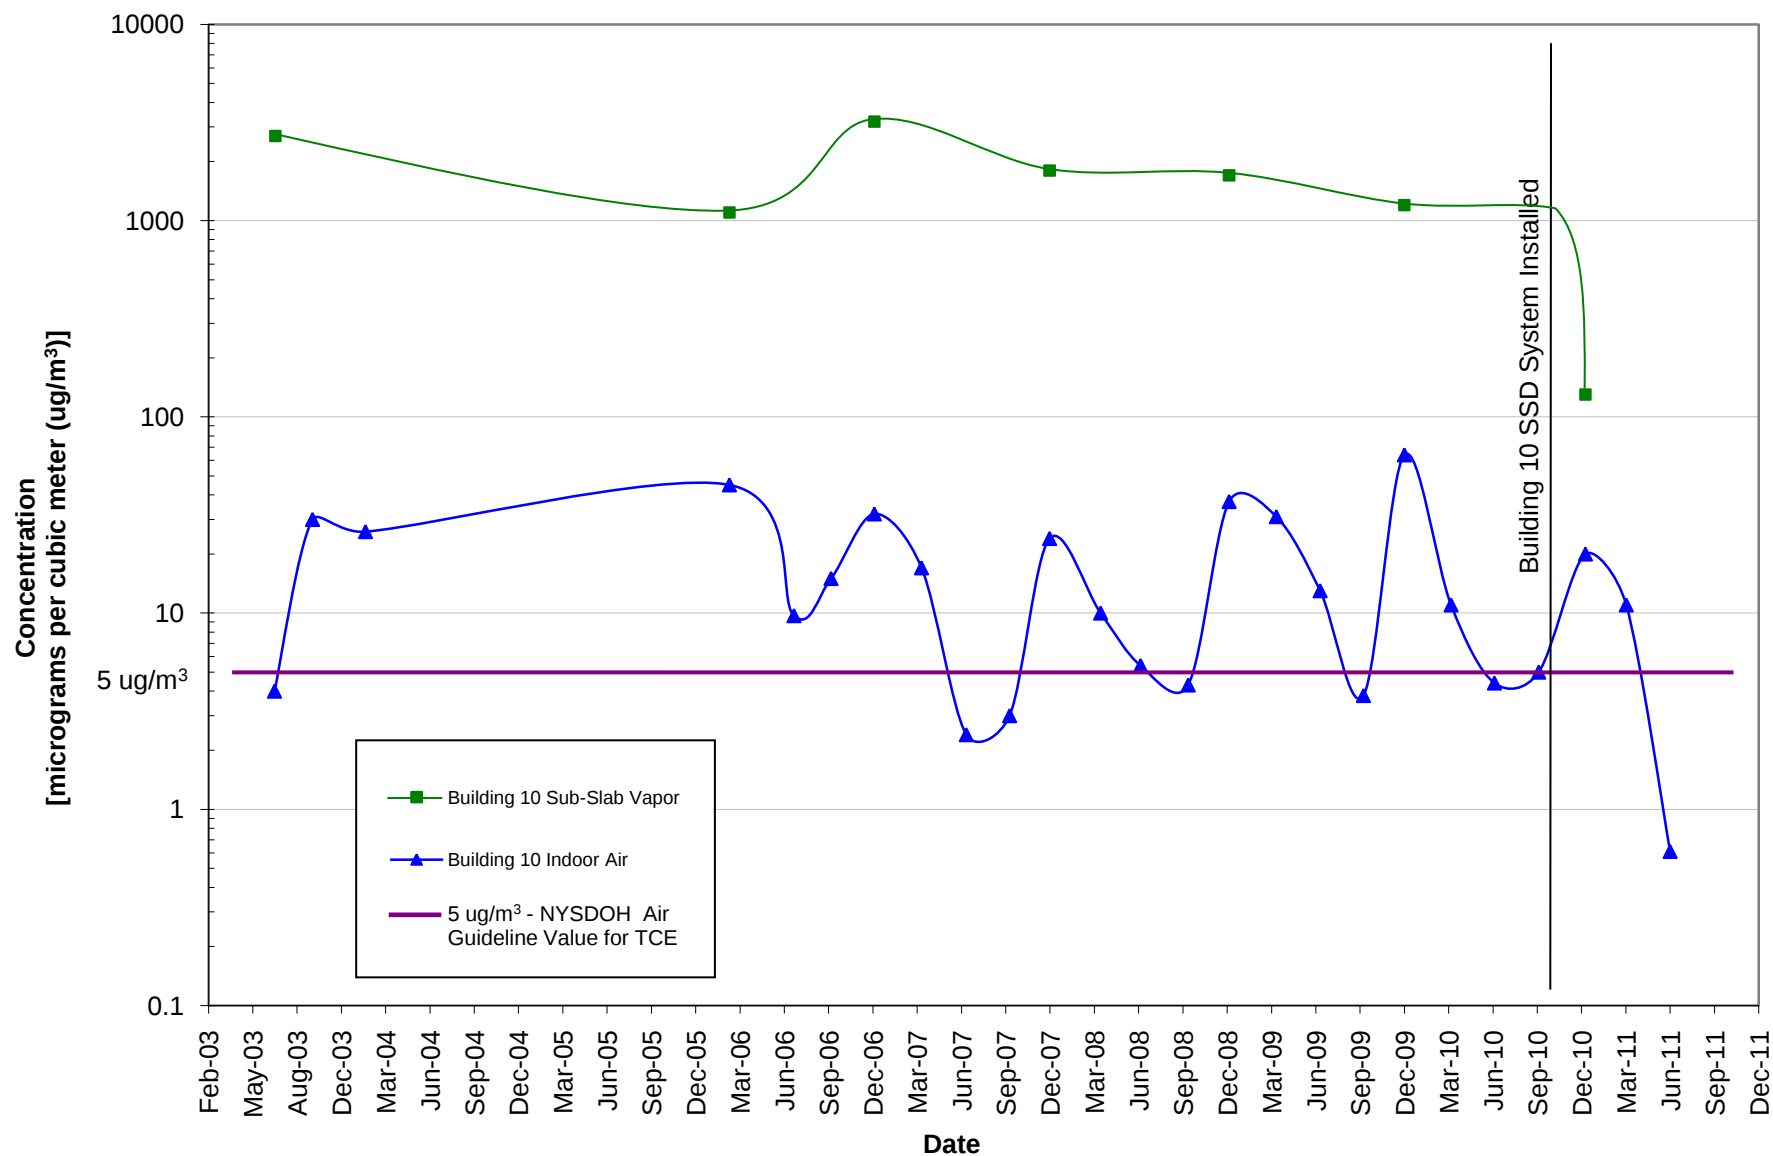


Figure 11: Building 1A Area TCE Concentrations

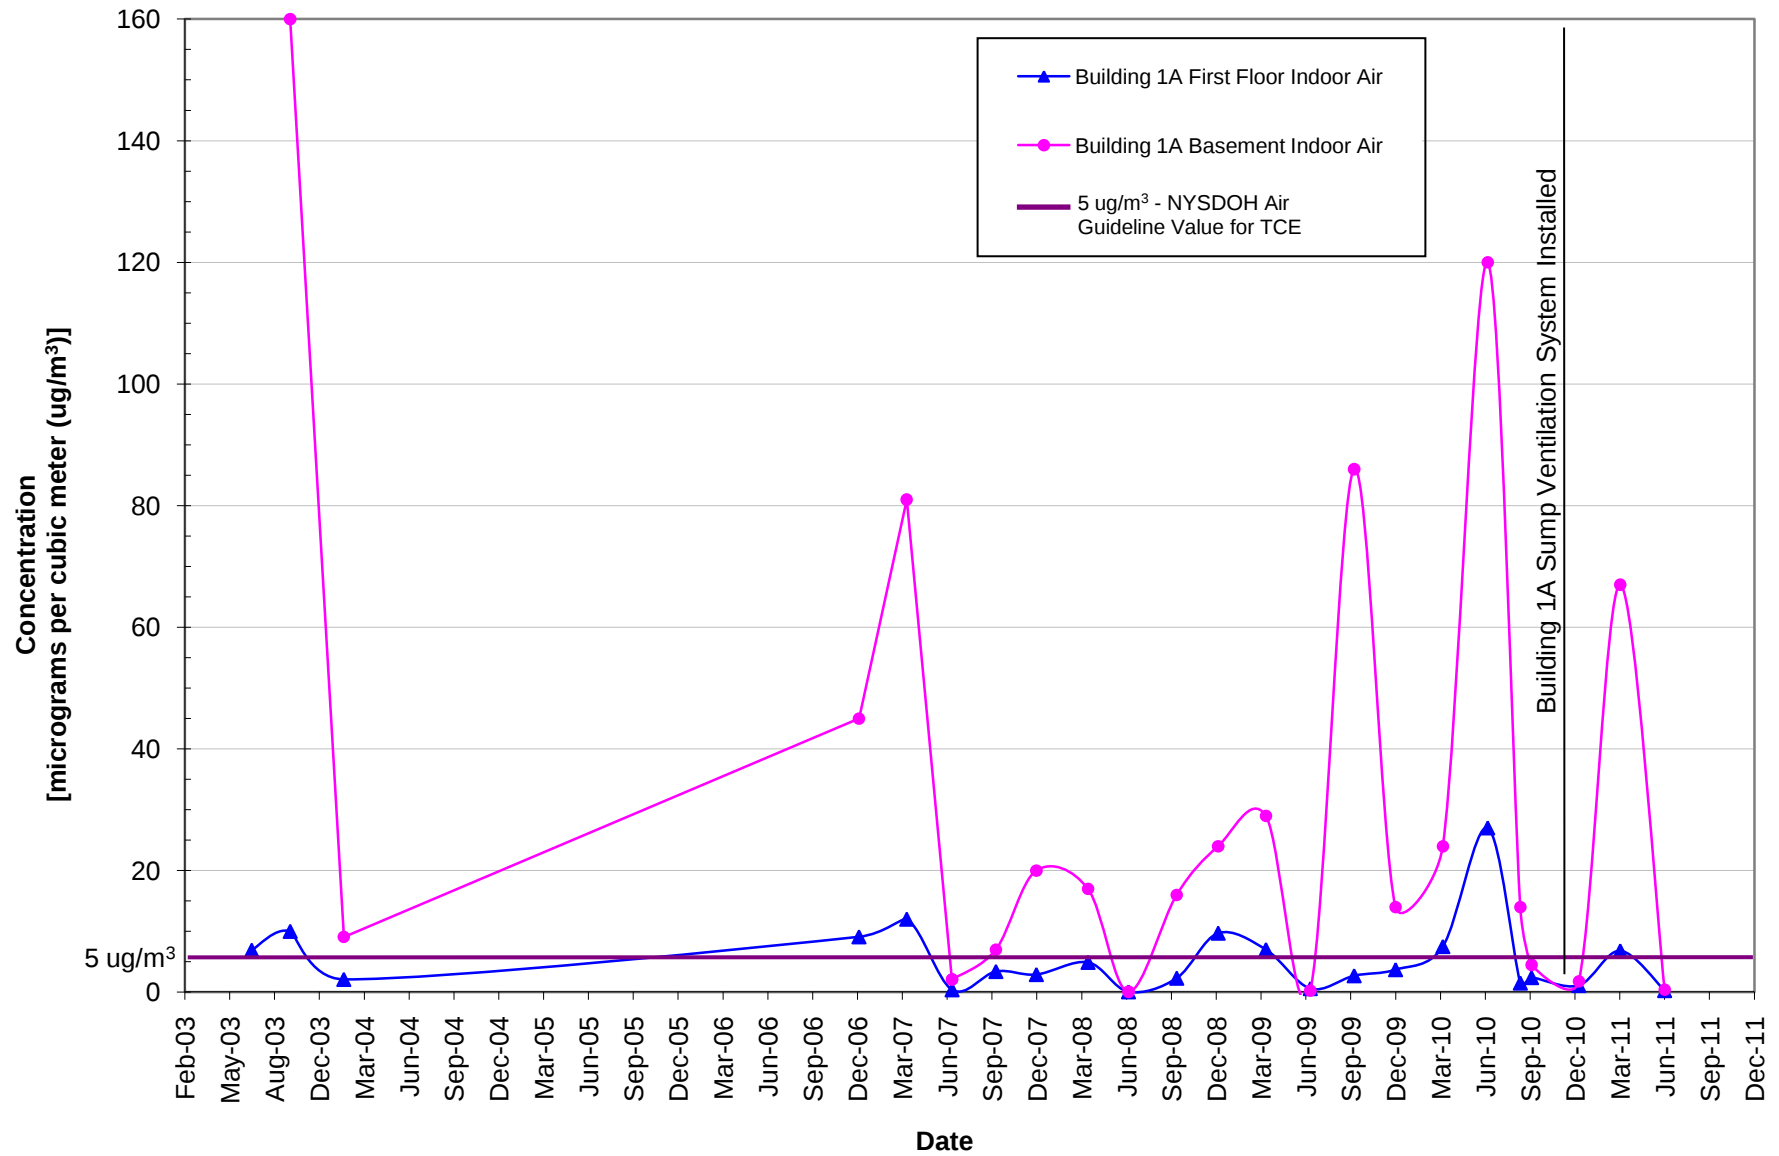

Attachment C
Tables

Table 1
Building 9 Area Analytical Data Summary
Former Philips Display Facility - Seneca Falls, New York

Sample Description	BUILDING 9 OFFICE INDOOR AIR																												
Sample ID	IA-B9-01																												
Date Collected	7/15/03	10/2/03	1/20/04	3/26/04	12/22/04	3/31/05	7/22/05	9/20/05	1/11/06	7/17/06	12/12/06	3/20/07	6/21/07	9/28/07	12/11/07	3/26/08	6/17/08	9/24/08	12/18/08	3/26/09	6/25/09	9/23/09	12/17/09	3/24/10	6/22/10	9/23/10	12/28/10	3/23/11	6/22/11
1,1,1-Trichloroethane	0.22	0.55 U	0.27 U	0.15 U	0.17	0.076	0.10	0.12	0.13	0.23	0.21	0.44	0.065	0.071	0.25	0.14	0.22 U	0.18	0.34	0.38	0.39	0.22 U	NS	0.27 U	0.16 U	0.11 U	0.82 U	0.055 U	0.11 U
1,1,2,2-Tetrachloroethane	0.14 U	0.69 U	0.34 U	0.069 U	0.069 U	0.069 U	0.069 U	0.14 U	0.069 U	0.21 U	0.14 U	0.27 U	0.069 U	0.069 U	0.10 U	0.14 U	0.27 U	0.069 U	0.38 UJ	0.082 U	0.34 U	0.27 U	NS	0.34 U	0.21 U	0.14 U	0.10 U	0.069 U	0.14 U
1,1,2-Trichloroethane	0.10 U	0.55 U	0.27 U	0.055 U	0.055 U	0.055 U	0.055 U	0.11 U	0.055 U	0.16 U	0.11 U	0.22 U	0.055 U	0.055 U	0.082 U	0.11 U	0.22 U	0.055 U	0.31 U	0.065 U	0.27 U	0.22 U	NS	0.27 U	0.16 U	0.11 U	0.082 U	0.055 U	0.11 U
1,1-Dichloroethane	0.080 U	0.40 U	0.20 U	0.040 U	0.040 U	0.040 U	0.040 U	0.081 U	0.040 U	0.12 U	0.081 U	0.16 U	0.040 U	0.040 U	0.061 U	0.081 U	0.160 U	0.040 U	0.230 U	0.049 U	0.20 U	0.16 U	NS	0.20 U	0.12 U	0.081 U	0.061 U	0.040 U	0.081 U
1,1-Dichloroethene	0.040 U	0.40 U	0.20 U	0.040 U	0.040 U	0.040 U	0.040 U	0.16 U	0.040 U	0.12 U	0.079 U	0.16 U	0.040 U	0.040 U	0.059 U	0.079 U	0.160 U	0.040 U	0.220 U	0.048 U	0.20 U	0.16 U	NS	0.20 U	0.12 U	0.079 U	0.059 U	0.040 U	0.079 U
1,2-Dichloroethane	0.087	0.40 U	0.20 U	0.093	0.077	0.049	0.04 U	0.081 U	0.093	0.34	0.16 U	0.32 U	0.081 U	0.081 U	0.12 U	0.16 U	0.32 U	0.081 U	0.45 U	0.11	0.4 U	0.32 U	NS	0.40 U	0.24 U	0.16 U	0.12 U	0.081 U	0.16 U
Benzene	1.3	2.2	2.3	2.7	2.7	0.77	2.0	1.3	3.5	3.1	2.9	3.1	0.42	0.51	1.5	1.4	0.61	0.51	2.8	1.1	1.4	0.96	NS	1.7	0.67	0.87	0.65	0.40	0.43
cis-1,2-Dichloroethene	0.22	0.67	0.2 U	0.38	0.27	0.04 U	0.16	0.16	0.17	1.1	0.27	0.52	0.040 NJ	0.040 U	0.31	0.40	0.52	0.075	0.67 NJ	0.12	0.24	0.16 U	NS	0.87	0.12 U	0.13	0.14	0.063	0.078
Ethylbenzene	1.4	1.1	2.7	0.91	0.87	0.28	2.9	0.96	2.0	4.0	1.3	1.1	0.43	0.32	0.52	0.48	0.69	0.43	1.4	0.43	1.5	0.91	NS	1.1	0.69	0.58	0.22	0.27	0.54
Tetrachloroethene	0.77	0.68 U	0.75	0.6	3.1	0.088	0.52	2.6	0.51	8.8	2.0	2.0	0.35	0.31	1.6	0.52	1.1	1.6	0.38 U	0.16	0.34 U	0.27 U	NS	1.1	0.20 U	0.14	0.10 U	0.088	0.18
Toluene	9.6	4.1	11	7.5	5.7	1.4	9.4	2.9	9.4	10	6.8	4.5	1.5	1.8	3.1	4.1	11	2.8	8.3	4.1	12	14	NS	12	5.7	4.2	3.2	1.9	3.5
trans-1,2-Dichloroethene	0.056 U	0.40 U	0.20 U	0.040 U	0.040 U	0.040 U	0.040 U	0.079 U	0.04 U	0.12 U	0.079 U	0.16 U	0.040 U	0.040 U	0.059 U	0.079 U	0.160 U	0.040 U	0.220 U	0.048 U	0.20 U	0.16 U	NS	0.20 U	0.12 U	0.079 U	0.059 U	0.040 U	0.079 U
Trichloroethene	22	30	15	1.3	4.6	0.12	4.3	0.70	4.0	4.2	9.1	14	0.34	0.37	5.9	5.3	1.2	2.6	18	1.2	1.7	0.34	NS	5.9	0.91	3.0	3.0	2.2	2.1
Vinyl chloride	0.020 U	0.26 U	0.13 U	0.026 U	0.028	0.026 U	0.026 U	0.051 U	0.026 U	0.15 U	0.1 U	0.2 U	0.051 U	0.051 U	0.077 U	0.10 U	0.20 U	0.051 U	0.28 U	0.064 U	0.26 U	0.20 U	NS	0.26 U	0.15 U	0.10 U	0.077 U	0.051 U	0.10 U
m-Xylene & p-Xylene	5.0	2.8	10	3.1	3.3	0.91	8.3	3.6	5.6	18	4.3	3.8	1.8	1.0	1.6	1.8	2.6	1.6	5.2	1.4	5.6	3.3	NS	4.0	2.5	1.9	0.69	0.78	1.6
o-Xylene	2.0	1.2	3.2	1.2	1.2	0.33	2.4	1.2	3.0	6.5	1.6	1.3	0.61	0.36	0.56	0.65	0.91	0.56	1.8	0.52	2.1	1.3	NS	1.4	1.0 J	0.70	0.25	0.26	0.65

Sample Description	BUILDING 9 CRAWL SPACE AIR																												
Sample ID	IA-B9-CS																												
Date Collected	7/15/03	10/2/03	1/20/04	3/26/04	12/22/04	3/31/05	7/22/05	9/20/05	1/11/06	7/17/06	12/12/06	3/20/07	6/21/07	9/28/07	12/11/07	3/26/08	6/17/08	9/24/08	12/18/08	3/26/09	6/25/09	9/23/09	12/17/09	3/24/10	6/22/10	9/22/10	12/28/10	3/23/11	6/22/11
Differential Pressure (inches water)	NA	NA	NA	NA	-0.03	-0.07	-0.15*	-0.15	-0.15	-0.15	-0.15	-0.11	-0.10	-0.08	-0.04	-0.03	-0.03	-0.03	-0.03	-0.03	-0.03	-0.03	0	-0.12	0	0	0	0	0
1,1,1-Trichloroethane	NS	0.55 U	0.27 U	0.18	0.14	0.040 U	0.093	0.55 U	0.12	0.44 U	0.17	0.27	0.22 U	0.27 U	0.16 U	0.082 U	0.27 U	0.22 U	0.22 U	0.11 U	0.43 U	0.27 U	NS	0.060	NS	0.68 U	0.11 U	0.27 U	0.55 U
1,1,2,2-Tetrachloroethane	NS	0.69 U	0.34 U	0.069 U	0.069 U	0.069 U	0.069 U	0.69 U	0.069 U	0.55 U	0.21 U	0.21 U	0.27 U	0.34 U	0.21 U	0.10 U	0.34 U	0.27 U	0.27 U	0.14 U	0.54 U	0.34 U	NS	0.069 U	NS	0.86 U	0.14 U	0.34 U	0.69 U
1,1,2-Trichloroethane	NS	0.55 U	0.27 U	0.055 U	0.055 U	0.055 U	0.055 U	0.55 U	0.055 U	0.44 U	0.16 U	0.16 U	0.22 U	0.27 U	0.16 U	0.082 U	0.27 U	0.22 U	0.22 U	0.11 U	0.43 U	0.27 U	NS	0.055 U	NS	0.68 U	0.11 U	0.27 U	0.55 U
1,1-Dichloroethane	NS	0.40 U	0.20 U	0.040 U	0.040 U	0.040 U	0.040 U	0.40 U	0.040 U	0.32 U	0.12 U	0.12 U	0.16 U	0.20 U	0.12 U	0.061 U	0.200 U	0.16 U	0.16 U	0.081 U	0.32 U	0.20 U	NS	0.040 U	NS	0.51 U	0.081 U	0.20 U	0.40 U
1,1-Dichloroethene	NS	0.40 U	0.20 U	0.040 U	0.040 U	0.040 U	0.040 U	0.79 U	0.040 U	0.32 U	0.12 U	0.12 U	0.16 U	0.20 U	0.12 U	0.059 U	0.200 U	0.16 U	0.16 U	0.079 U	0.31 U	0.20 U	NS	0.040 U	NS	0.50 U	0.079 U	0.20 U	0.40 U
1,2-Dichloroethane	NS	0.40 U	0.20 U	0.081	0.057	0.040	0.040 U	0.40 U	0.040 U	0.65 U	0.24 U	0.24 U	0.32 U	0.40 U	0.24 U	0.12 U	0.40 U	0.32 U	0.32 U	0.16 U	0.65 U	0.40 U	NS	0.081 NJ	NS	1.0 U	0.16 U	0.40 U	0.81 U
Benzene	NS	0.64	1.6	1.7	1.7	0.51	0.96	0.96	2.4	2.9	2.8	2.1	0.13 U	0.38	1.1	1.1	0.42	0.38	1.6	0.8	1.5	0.99	NS	1.2	NS	0.99	0.489	0.45	0.39
cis-1,2-Dichloroethene	NS	1.6	0.95 NJ	2.4	0.24	0.19	0.87	1.1	0.29	1.2	0.29	0.56	0.44	0.48	0.21	0.23	0.87	0.18 NJ	0.31 NJ	0.18	0.39 NJ	0.40	NS	0.29	NS	0.69	0.12	0.20 U	0.42
Ethylbenzene	NS	0.48	1.4	0.78	0.61	0.22	1.7	0.83	1.2	3.5	1.6	0.65	0.17 U	0.24	0.32	0.38	0.56	0.25	0.78	0.28	1.4	0.69	NS	0.61	NS	0.65	0.11	0.22 U	0.52
Tetrachloroethene	NS	0.88	0.54	3.7	1.2	0.14	0.41	1.4	0.35	4.8	1.5	1.0	0.27 U	0.55	0.75	0.23	0.62	0.37	0.27 U	0.22	0.54 U	0.34 U	NS	0.38	NS	0.85 U	0.14 U	0.34 U	0.68 U
Toluene	NS	1.3	7.2	9.8	4.1	0.90	4.5	3.0	6.4	16	7.5	3.1	0.15 U	0.87	1.9	2.8	3.5	1.8	4.5	1.7	17	5.7	NS	3.5	NS	4.5	0.71	0.44	4.6
trans-1,2-Dichloroethene	NS	0.40 U	0.20 U	0.040 U	0.040 U	0.040 U	0.040 U	0.40 U	0.040 U	0.32 U	0.12 U	0.12 U	0.16 U	0.20 U	0.12 U	0.059 U	0.200 U	0.16 U	0.16 U	0.079 U	0.31 U	0.20 U	NS	0.04 U	NS	0.50 U	0.079 U	0.20 U	0.40 U
Trichloroethene	NS	210	75	110	10	15	35	43	11	35	11	14	12	19	10	5.9	18	15	15	5.4	24	20	NS	5.4	NS	60	8.5	16	48
Vinyl chloride	NS	0.26 U	0.13 U	0.026 U	0.026 U	0.026 U	0.026 U	0.26 U	0.026 U	0.41 U	0.15 U	0.15 U	0.20 U	0.26 U	0.15 U	0.077 U	0.260 U	0.20 U	0.20 U	0.10 U	0.41 U	0.26 U	NS	0.051 U	NS	0.64 U	0.10 U	0.26 U	0.51 U
m-Xylene & p-Xylene	NS	1.2	4.8	2.7	2.1	0.65	5.2	3.0	3.8	15	5.2	2.4	0.35 U	0.61	1.0	1.3	1.9	0.87	2.6	0.91	4.8	2.5	NS	2.4	NS	2.4	0.29	0.43 U	1.4
o-Xylene	NS	0.52	1.7	1.1	0.87	0.22	2.7	1.0	1.6	5.6	1.9	0.83	0.17 U	0.25	0.40	0.48	0.65	0.33	0.96	0.37	1.7	0.83	NS	0.87	NS	0.83	0.11	0.22 U	0.50

Notes:
All values are shown in units of micrograms per cubic meter (µg/m³).
U - Not detected above reporting limit
E - Estimated
NA - Not Applicable
NJ - Tentative in identification and estimated in value due to poor mass spectral quality
NS - Not Sampled
* - This differential pressure was maintained during the sampling event, but the ventilation system operated intermittently and was inoperable for one week prior to the sampling event.

Table 1
Building 9 Area Analytical Data Summary
Former Philips Display Facility - Seneca Falls, New York

Sample Description	BUILDING 9 WAREHOUSE INDOOR AIR																				
Sample ID	IA-B9-02																				
Date Collected	7/15/2003	10/2/2003	1/20/2004	3/20/2007	6/21/2007	9/28/2007	12/11/2007	3/26/2008	6/17/2008	9/24/2008	12/18/2008	3/26/2009	6/25/2009	9/23/2009	12/17/2009	3/24/2010	6/22/2010	9/22/2010	12/28/2010	3/23/2011	6/22/2011
1,1,1-Trichloroethane	0.15	0.55 U	0.41 U	0.49	0.055 U	0.060	0.33 U	0.14	0.10	0.11 U	0.55 U	0.43 U	0.43 U	0.065	0.87 U	0.22 U	0.055 U	0.068 U	0.34 U	0.11	0.055 U
1,1,2,2-Tetrachloroethane	0.14 U	0.69 U	0.51 U	0.34 U	0.069 U	0.069 U	0.41 U	0.14 U	0.069 U	0.14 U	0.69 UJ	0.54 U	0.54 U	0.069 U	1.1 U	0.27 U	0.069 U	0.086 U	0.43 U	0.14 U	0.069 U
1,1,2-Trichloroethane	0.10 U	0.55 U	0.41 U	0.27 U	0.055 U	0.055 U	0.33 U	0.11 U	0.055 U	0.11 U	0.55 U	0.43 U	0.43 U	0.055 U	0.87 U	0.22 U	0.055 U	0.068 U	0.34 U	0.11 U	0.055 U
1,1-Dichloroethane	0.080 U	0.40 U	0.30 U	0.20 U	0.040 U	0.040 U	0.24 U	0.081 U	0.040 U	0.081 U	0.40 U	0.32 U	0.32 U	0.040 U	0.65 U	0.16 U	0.040 U	0.051 U	0.25 U	0.081 U	0.040 U
1,1-Dichloroethene	0.040 U	0.40 U	0.30 U	0.20 U	0.040 U	0.040 U	0.24 U	0.079 U	0.040 U	0.079 U	0.40 U	0.31 U	0.31 U	0.040 U	0.63 U	0.16 U	0.040 U	0.050 U	0.25 U	0.079 U	0.040 U
1,2-Dichloroethane	0.080 U	0.40 U	0.30 U	0.40 U	0.081 U	0.081 U	0.49 U	0.16 U	0.081 U	0.16 U	0.81 U	0.65	0.65 U	0.081 U	1.3 U	0.32 U	0.081 U	0.10 U	0.51 U	0.16 U	0.081 U
Benzene	1.1	3.1	5.1	3.8	0.45	0.51	2.5	0.83	0.58	0.83	4.8	3.8 U	3.5	1.2	2.4	2.8	0.38	3.0	3.1	3.3	0.62
cis-1,2-Dichloroethene	0.056 U	2.2	3.0	0.87	0.083 NJ	0.040 U	0.99	1.1	0.79	0.14	1.8 NJ	1.1	0.79	0.04 U	1.7	1.9	0.040 U	0.11	1.7	0.67	0.040 U
Ethylbenzene	0.35	0.65	16	1.1	0.48	0.20	0.74	0.087 U	0.83	0.52	2.0	1.1	3.5	0.40	0.87	1.5	0.16	0.73	0.67	1.6	0.54
Tetrachloroethene	1.9	2.0	7.5	2.8	0.39	0.21	5.5	0.14	0.56	12	0.68 U	0.54 U	0.75	0.11	1.1 U	2.0	0.088	0.12	0.68	0.58	0.19
Toluene	2.1	2.4	9.8	3.8	2.1	0.83	4.5	0.21	2.3	3.0	12	6.8	26	1.9	4.1	5.3	0.68	4.6	3.7	4.1	0.99
trans-1,2-Dichloroethene	0.056 U	0.40 U	0.30 U	0.20 U	0.040 U	0.040 U	0.24 U	0.079 U	0.040 U	0.079 U	0.40 U	0.31 U	0.31 U	0.04 U	0.63 U	0.16 U	0.040 U	0.050 U	0.25 U	0.079 U	0.040 U
Trichloroethene	0.22	30	24	19	0.30	1.0	19	7.0	1.6	3.9	46	24	2.3	0.39	51	13	0.091	0.63	23	11	0.15
Vinyl chloride	0.020 U	0.26 U	0.19 U	0.26 U	0.051 U	0.051 U	0.31 U	0.10 U	0.051 U	0.1 U	0.51 U	0.41 U	0.41 U	0.051 U	0.82 U	0.20 U	0.051 U	0.064 U	0.32 U	0.10 U	0.051 U
m-Xylene & p-Xylene	0.93	1.7	65	3.6	1.4	0.43	2.4	0.17 U	2.8	1.7	6.9	3.3	12	1.2	2.9	5.6	0.48	2.2	2.0	3.6	0.98
o-Xylene	0.34	0.61	16	1.1	0.37	0.15	0.87	0.087 U	0.91	0.56	2.7	1.2	4.0	0.40	1.0	1.9	0.21 J	0.72	0.76	1.2	0.35

Notes:
All values are shown in units of micrograms per cubic meter (µg/m³).
U - Not detected above reporting limit
NA - Not Applicable
NJ - Tentative in identification and estimated in value due to poor mass spectral quality

Table 2
Building 11 Area Analytical Data Summary
Former Philips Display Components Facility - Seneca Falls, New York

Sample Description	BUILDING 11 INDOOR AIR																									
Sample ID	IA-B11-01																									
Date Collected	7/15/03	10/2/03	1/20/04	2/14/06	6/28/06	9/13/06	12/12/06	3/20/07	6/21/07	8/30/07	9/19/07	12/11/07	3/26/08	6/17/08	9/24/08	12/18/08	3/26/09	6/25/09	9/23/09	12/17/09	3/24/10	6/22/10	9/22/10	12/28/10	3/23/11	6/22/11
1,1,1-Trichloroethane	0.29	2.0	0.65	0.65	0.24	0.40	0.82	0.87	0.25	0.093	0.15	0.87 J	0.25	0.25	0.16	0.60	0.22 U	0.37	0.14	0.55	0.37	0.12	0.11 NJ	0.34	0.34	0.15 U
1,1,2,2-Tetrachloroethane	0.14 U	0.69 U	0.51 U	0.069 U	0.27 U	0.34 U	0.27 U	0.21 U	0.10 U	0.069 U	0.069 U	0.34 U	0.12 U	0.12 U	0.10 U	0.21 UJ	0.27 U	0.43 U	0.069 U	0.62 U	0.14 U	0.082 U	0.11 U	0.14 U	0.14 U	0.19 U
1,1,2-Trichloroethane	0.10 U	0.55 U	0.41 U	0.055 U	0.22 U	0.27 U	0.22 U	0.16 U	0.082 U	0.055 U	0.055 U	0.27 U	0.093 U	0.093 U	0.082 U	0.16 U	0.22 U	0.34 U	0.055 U	0.50 U	0.11 U	0.065 U	0.091 U	0.11 U	0.11 U	0.15 U
1,1-Dichloroethane	0.080 U	0.40 U	0.30 U	0.040 UJ	0.16 U	0.20 U	0.16 U	0.12 U	0.061 U	0.04 U	0.040 U	0.20 U	0.069 U	0.069 U	0.061 U	0.12 U	0.16 U	0.25 U	0.04 U	0.37 U	0.081 U	0.049 U	0.068 U	0.81 U	0.081 U	0.11 U
1,1-Dichloroethene	0.040 U	0.40 U	0.30 U	0.099	0.16 U	0.20 U	0.16 U	0.23 J	0.059 U	0.04 U	0.040 U	0.20 U	0.067 U	0.067 U	0.059 U	0.15 NJ	0.16 U	0.25 U	0.04 U	0.36 U	0.12	0.048 U	0.066 U	0.79 U	0.094	0.11 U
1,2-Dichloroethane	0.080 U	0.40 U	0.30 U	0.040 U	0.32 U	0.40 U	0.32 U	0.24 U	0.12 U	0.081 U	0.081 U	0.40 U	0.14 U	0.13 U	0.12 U	0.24 U	0.32 U	0.49 U	0.081 U	0.73 U	0.16 U	0.10 U	0.14 U	0.16 U	0.16 U	0.23 U
Benzene	1.1	3.8	3.2	3.0	2.1	2.6	7.0	4.5	0.89	0.58	0.77	2.9	2.4	1.2	0.96	2.9	3.8	3.1	1.5	2.4	1.9	0.99	1.7	2.4	1.9	0.99
cis-1,2-Dichloroethene	0.55	4.8	2.5	1.6	0.91	0.83 NJ	1.6	1.5	1.2	0.25	0.52	2.3	1.2	2.1	0.95	1.9	2.1	2.6	0.35	3.2	3.3	1.0	0.78	1.2	1.1	0.47
Ethylbenzene	1.4	1.0	3.0	1.9	1.6	0.74	2.6	1.1	0.69	0.52	0.30	1.0	0.91	1.80	0.19	1.1	3.2	3.6	0.96	1.5	2.7	1.1	0.83	0.63	1.1	1.5
Tetrachloroethene	7.8	6.8	4.7	6.6	14	6.0	6.4	3.5	7.5	1.8	0.75	8.8	1.5	2.7	1.8	0.64	0.75	1.2	0.37	0.62 U	0.68	0.42	0.82	1.1	1.3	1.6
Toluene	12	11	6.0	5.3 J	3.7	3.6	11	7.5	2.2	1.5	1.2	5.3	5.3	2.5	1.4	5.3	7.9	17	3.4	6.0	5.7	3.0	4.6	2.6	2.7	4.5
trans-1,2-Dichloroethene	0.056 U	0.40 U	0.30 U	0.040 U	0.16 U	0.20 U	0.16 U	0.12 U	0.059 U	0.04 U	0.040 U	0.20 U	0.067 U	0.067 U	0.059 U	0.12 U	0.16 U	0.25 U	0.04 U	0.36 U	0.079 U	0.048 U	0.066 U	0.79 U	0.079 U	0.11 U
Trichloroethene	5.0	36	33	59	3.4	20	20	9.1	3.4	0.70	3.9	18	5.9	4.0	6.4	14	12	5.4	1.5	26	7.5	2.8	2.2	5.6	3.7	0.98
Vinyl chloride	0.020 U	0.26 U	0.19 U	0.064 J	0.20 U	0.26 U	0.20 U	0.15 U	0.077 U	0.051 U	0.051 U	0.26 U	0.087 U	0.084 U	0.077 U	0.15 U	0.2 U	0.31 U	0.051 U	0.46 U	0.10 U	0.064 U	0.085 U	0.10 U	0.10 U	0.14 U
m,p-Xylene	3.5	3.0	11	4.3	7.4	2.2	7.4	4.3	2.2	1.4	0.91	3.7	3.5	6.9	0.25	3.8	13	13	3.5	5.6	12	4.3	3.2	2.3	4.2	5.9
o-Xylene	1.2	1.0	2.9	2.6	2.9	0.83	2.4	1.4	0.83	0.52	0.31	1.3	1.2	2.3	0.078	1.3	4.3	4.8	1.3	2.0	4.3	1.5 J	1.1	0.85	1.6	2.3

Sample Description	BUILDING 11A INDOOR AIR																									
Sample ID	IA-B11-02																									
Date Collected	7/15/03	10/2/03	1/20/04	2/14/06	6/28/06	9/13/06	12/12/06	3/20/07	6/21/07	8/30/07	9/19/07	12/11/07	3/26/08	6/17/08	9/24/08	12/18/08	3/26/09	6/25/09	9/23/09	12/17/09	3/24/10	6/22/10	9/22/10	12/28/10	3/23/11	6/22/11
1,1,1-Trichloroethane	0.56	2.2	0.65	0.65	0.23	0.49	0.87	0.98	0.22	0.11	0.21	0.82 J	0.23	0.21	0.15	0.49	0.19 NJ	0.51	0.12	0.65	0.40	0.14	0.11 U	0.39	0.43	0.079 NJ
1,1,2,2-Tetrachloroethane	0.14 U	0.69 U	0.34 U	0.069 U	0.21 U	0.34 U	0.27 U	0.21 U	0.096 U	0.069 U	0.10 U	0.34 U	0.21 U	0.21 U	0.10 U	0.27 UJ	0.23 U	0.43 U	0.10 U	0.62 U	0.14 U	0.069 U	0.14 U	0.10 U	0.14 U	0.069 U
1,1,2-Trichloroethane	0.10 U	0.55 U	0.27 U	0.055 U	0.16 U	0.27 U	0.22 U	0.16 U	0.076 U	0.055 U	0.082 U	0.27 U	0.16 U	0.16 U	0.082 U	0.22 U	0.18 U	0.34 U	0.082 U	0.50 U	0.11 U	0.055 U	0.11 U	0.082 U	0.11 U	0.055 U
1,1-Dichloroethane	0.08 U	0.40 U	0.20 U	0.040 UJ	0.12 U	0.20 U	0.16 U	0.12 U	0.057 U	0.04 U	0.061 U	0.20 U	0.12 U	0.12 U	0.061 U	0.16 U	0.13 U	0.25 U	0.061 U	0.37 U	0.081 U	0.040 U	0.081 U	0.061 U	0.081 U	0.040 U
1,1-Dichloroethene	0.04 U	0.40 U	0.20 U	0.079	0.12 U	0.20 U	0.16 U	0.12 U	0.056 U	0.04 U	0.059 U	0.20 U	0.12 U	0.12 U	0.059 U	0.16 U	0.13 U	0.40 NJ	0.059 U	0.36 U	0.13	0.040 U	0.079 U	0.11 U	0.13 U	0.040 U
1,2-Dichloroethane	0.08 U	0.40 U	0.20 U	0.040 U	0.24 U	0.40 U	0.32 U	0.24 U	0.12 U	0.081 U	0.12 U	0.40 U	0.24 U	0.24 U	0.12 U	0.32 U	0.27 U	0.49 U	0.12 U	0.73 U	0.16 U	0.085 NJ	0.16 U	0.12 U	0.16 U	0.081 U
Benzene	1.6	3.5	3.0	4.2	1.9	2.9	7.3	4.8	1.2	0.61	0.80	3.8	3.1	1.1	1.2	3.2	4.5	1.9	1.3	2.8	2.3	1.2	1.6	2.8	2.4	0.80
cis-1,2-Dichloroethene	1.8	5.6	3.0	1.5	1.1	1.1 NJ	2.0	1.7	0.71	0.39	0.79	2.3	1.1	1.3	0.87	2.1	2.3	0.95 NJ	0.30	3.5	3.8	1.3	0.90	1.2	1.4	0.38
Ethylbenzene	4.7	1.0	3.0	2.0	1.8	0.91	2.6	1.3	0.87	0.74	0.52	1.1	1.0	2.2 NJ	1.0	1.4	3.3	2.4 J	0.87	1.4	3.3	1.7	0.86	0.72	1.3	1.7
Tetrachloroethene	18	8.1	5.4	14 J	14	6.8	6.8	4.5	5.6	3	1.3	8.8	1.3	1.2	0.75	0.68	0.81	0.81	0.31	0.62 U	0.81	0.59	0.93	1.3	1.6	1.3
Toluene	10	9.8	6	7.5 J	4.5	3.8	9.8	7.9	2.9	2.1	2.1	7.5	7.9	2.9	3.0	6.8	9.0	11	3.2	6.0	6.8	3.8 J	4.8	3.3	3.3	2.7
trans-1,2-Dichloroethene	0.056 U	0.40 U	0.20 U	0.040 U	0.12 U	0.20 U	0.16 U	0.12 U	0.056 U	0.04 U	0.059 U	0.20 U	0.12 U	0.12 U	0.059 U	0.16 U	0.13 U	0.25 U	0.12	0.36 U	0.079 U	0.040 U	0.079 U	0.059 U	0.079 U	0.040 U
Trichloroethene	39	97	42	81	3.9	20	21	12	2.5	1.5	5.4	18	4.8	3.0	5.9	13	13	5.4	1.8	30	9.1	2.5	2.3	6.1	4.6	0.86
Vinyl chloride	0.020 U	0.26 U	0.13 U	0.072 J	0.15 U	0.26 U	0.20 U	0.15 U	0.074 U	0.051 U	0.077 U	0.26 U	0.15 U	0.15 U	0.077 U	0.20 U	0.17 U	0.31 U	0.077 U	0.46 U	0.10 U	0.051 U	0.10 U	0.77 U	0.10 U	0.051 U
m,p-Xylene	15	3.2	12	6.9 J	6.9	2.8	6.9	4.8	2.9	2.4	2.0	4.1	3.8	8.7	4.0	5.2	13	7.8 J	3.2	5.6	15	7.8	3.3	2.6	5.2	6.0
o-Xylene	3.7	1.0	3.0	3.0 J	2.9	1.1	2.3	1.6	1.0	0.78	0.61	1.4	1.3	2.8	1.7	1.8	4.2	2.3 J	1.2	2.0	5.2	2.8 J	1.1	0.89	1.9	2.2

Sample Description	BUILDING 11A SUB-SLAB VAPOR																									
Sample ID	SVSS-B11-01																									
Date Collected	7/17/03	10/2/03	1/20/04	2/14/06	6/28/06	9/13/06	12/12/06	3/20/07	6/21/07	8/30/07	9/19/07	12/11/07	3/26/08	6/17/08	9/24/08	12/18/08	3/26/09	6/25/09	9/23/09	12/17/09	3/24/10	6/22/10	9/22/10	12/28/10	3/23/11	6/22/11
1,1,1-Trichloroethane	1900 U	NS	NS	11 U	NS	NS	1.6 U	NS	NS	1.1 U	1.6 U	1.1 U	NS	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS
1,1,2,2-Tetrachloroethane	2400 U	NS	NS	14 U	NS	NS	2.1 U	NS	NS	1.4 U	2.1 U	1.4 U	NS	NS	NS	1.4 U	NS	NS	NS	1.4 U	NS	NS	NS	1.4 U	NS	NS
1,1,2-Trichloroethane	1900 U	NS	NS	11 U	NS	NS	1.6 U	NS	NS	1.1 U	1.6 U	1.1 U	NS	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS
1,1-Dichloroethane	1400 U	NS	NS	8.1 U	NS	NS	1.2 U																			

Table 2
Building 11 Area Analytical Data Summary
Former Philips Display Components Facility - Seneca Falls, New York

Sample Description	BUILDING 13 INDOOR AIR																								
Sample ID	IA-B13-01																								
Date Collected	7/15/03	10/2/03	1/20/04	2/14/06	6/28/06	9/13/06	12/12/06	3/20/07	6/21/07	9/19/07	12/11/07	3/26/08	6/17/08	9/24/08	12/18/08	3/26/09	6/25/09	9/23/09	12/17/09	3/24/10	6/22/10	9/22/10	12/28/10	3/23/11	6/22/11
1,1,1-Trichloroethane	0.55	2.8	1.0	1.0	0.22 U	1.6	1.1	0.82	0.38	0.45	0.87 J	0.20	0.21	1.6	1.4	0.65	0.53	0.39	1.4	1.2	0.93	0.27 J	0.59	0.72	0.21
1,1,2,2-Tetrachloroethane	0.14 U	0.34 U	0.14 U	0.069 U	0.27 U	0.21 U	0.27 U	0.14 U	0.10 U	0.14 U	0.27 U	0.12 U	0.12 U	0.10 U	0.14 UJ	0.14 U	0.27 U	0.14 U	0.069 U	0.069 U	0.14 U	0.27 UJ	0.14 U	0.069 U	0.10 U
1,1,2-Trichloroethane	0.10 U	0.27 U	0.11 U	0.055 U	0.22 U	0.16 U	0.22 U	0.11 U	0.082 U	0.11 U	0.22 U	0.093 U	0.093 U	0.082 U	0.11 U	0.11 U	0.22 U	0.11 U	0.055 U	0.055 U	0.110 U	0.22 UJ	0.11 U	0.055 U	0.082 U
1,1-Dichloroethane	0.080 U	0.20 U	0.081 U	0.040 UJ	0.16 U	0.12 U	0.16 U	0.081 U	0.061 U	0.081 U	0.16 U	0.069 U	0.069 U	0.061 U	0.081 U	0.081 U	0.16 U	0.081 U	0.053	0.049	0.081 U	0.16 UJ	0.081 U	0.040 U	0.061 U
1,1-Dichloroethene	0.044	0.52	0.23	0.14	0.16 U	0.12 U	0.16 U	0.17 J	0.067	0.079 U	0.16 U	0.067 U	0.079	0.39	0.29 NJ	0.14	0.27	0.079 U	0.40	0.34	0.31	0.16 UJ	0.21	0.18	0.058
1,2-Dichloroethane	0.080 U	0.20 U	0.12	0.040 U	0.32 U	0.24 U	0.32 U	0.16 U	0.12 U	0.16 U	0.32 U	0.14 U	0.13 U	0.12 U	0.16 U	0.16 U	0.32 U	0.16 U	0.081 U	0.081 U	0.16 U	0.32 UJ	0.16 U	0.081 U	0.12 U
Benzene	2.3	1.9	1.5	3.1	2.1	3.8	7.7	3.8	1.4	1.3	2.9	2.7	1.5	0.80	2.0	1.9	1.9	2.2	0.48	0.73	1.5	3.5 J	2.1	0.79	2.2
cis-1,2-Dichloroethene	1.1	4.0	2.1	1.1	0.44	1.5 NJ	2.1	0.83	0.95	1.3	1.7	0.48	0.52	0.63	0.56	1.3	0.95	0.95	0.19	0.33	1.3	1.1 J	0.25	0.44	0.39
Ethylbenzene	2.4	0.69	0.74	3.9	4.2	2.9	3.6	1.3	2.0	2.0	1.3	0.83	2.9 NJ	0.96	0.74	1.4	2.6	1.8	0.16	0.48	2.1	1.3 J	0.54	0.45	1.4
Tetrachloroethene	19	4.8	2.6	3.8	5.2	9.5	7.5	1.8	4.5	1.3	7.5	0.61	8.1	0.31	0.22	0.63	0.75	0.66	0.068 U	0.16	0.51	1.2 J	0.54	0.67	2.2
Toluene	11	3.8	3.1	6.8 J	4.1	5.7	9.8	7.5 EJ	4.1	2.9	6.0	3.7	3.3	3.8	3.8	5.3	11	6.4	0.60	2.1	4.5	7.3 J	5.2	1.3	4.6
trans-1,2-Dichloroethene	0.056 U	0.20 U	0.079 U	0.040 U	0.16 U	0.12 U	0.16 U	0.079 U	0.059 U	0.079 U	0.16 U	0.067 U	0.067 U	0.059 U	0.079 U	0.079 U	0.16 U	0.079 U	0.04 U	0.040 U	0.079 U	0.16 UJ	0.079 U	0.040 U	0.059 U
Trichloroethene	11	13	8.6	41	1.6	16	21	5.4	2.6	6.4	12	2.6	1.5	4.1	5.2	7.5	5.4	3.5	2.4	1.8	6.4	3.7 J	6.9	2.1	1.5
Vinyl chloride	0.026	0.13 U	0.051 U	0.056 J	0.2 U	0.15 U	0.20 U	0.10 U	0.077 U	0.10 U	0.20 U	0.087 U	0.084 U	0.077 U	0.10 U	0.10 U	0.20 U	0.10 U	0.051 U	0.051 U	0.10 U	0.20 UJ	0.10 U	0.051 U	0.077 U
m,p-Xylene	7.5	2.0	2.6	9.6	19	10	9.1	4.3	6.5	6.9	4.3	3.0	11 EJ	3.5	2.3	5.2	8.7	6.9	0.52	1.7	7.8	4.6 J	1.6	1.7	5.0
o-Xylene	2.4	0.74	0.74	3.4	7.8	4.3	3.2	1.5	2.4	2.5	1.7	1.1	3.8	1.1	0.78	1.7	2.6	2.2	0.18	0.56	2.4 J	1.5 J	0.58	0.60	1.5

Building Number	BUILDING 13 SUB-SLAB VAPOR																								
Sample ID	SVSS-B13-01																								
Date Collected	7/17/03	10/2/03	1/20/04	2/14/06	6/28/06	9/13/06	12/12/06	3/20/07	6/21/07	9/19/07	12/11/07	3/26/08	6/17/08	9/24/08	12/18/08	3/26/09	6/25/09	9/23/09	12/17/09	3/24/10	6/22/10	9/22/10	12/28/10	3/23/11	6/22/11
1,1,1-Trichloroethane	18	NS	NS	11 U	NS	NS	8.2	NS	NS	NS	3.9	NS	NS	NS	3.5	NS	NS	NS	3.2	NS	NS	NS	2.1	NS	NS
1,1,2,2-Tetrachloroethane	0.14 U	NS	NS	14 U	NS	NS	1.4 U	NS	NS	NS	1.4 U	NS	NS	NS	1.4 U	NS	NS	NS	1.4 U	NS	NS	NS	1.4 U	NS	NS
1,1,2-Trichloroethane	0.1 U	NS	NS	11 U	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS
1,1-Dichloroethane	0.08 U	NS	NS	8.1 U	NS	NS	0.81 U	NS	NS	NS	0.81 U	NS	NS	NS	0.81 U	NS	NS	NS	0.81 U	NS	NS	NS	0.81 U	NS	NS
1,1-Dichloroethene	0.04 U	NS	NS	7.9 U	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS
1,2-Dichloroethane	0.08 U	NS	NS	8.1 U	NS	NS	0.81 U	NS	NS	NS	0.81 U	NS	NS	NS	0.81 U	NS	NS	NS	0.81 U	NS	NS	NS	0.81 U	NS	NS
Benzene	3.6	NS	NS	6.4 U	NS	NS	0.64 U	NS	NS	NS	0.64 U	NS	NS	NS	0.67	NS	NS	NS	0.64 U	NS	NS	NS	0.68	NS	NS
cis-1,2-Dichloroethene	0.056 U	NS	NS	7.9 U	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS
Ethylbenzene	1.5	NS	NS	8.7 U	NS	NS	0.87 U	NS	NS	NS	0.87 U	NS	NS	NS	0.87 U	NS	NS	NS	0.87 U	NS	NS	NS	0.87 U	NS	NS
Tetrachloroethene	37	NS	NS	14 U	NS	NS	13	NS	NS	NS	5.8	NS	NS	NS	3.5	NS	NS	NS	3.3	NS	NS	NS	2.6	NS	NS
Toluene	11	NS	NS	7.5 U	NS	NS	0.75 U	NS	NS	NS	0.75 U	NS	NS	NS	1.3	NS	NS	NS	0.75 U	NS	NS	NS	1.1	NS	NS
trans-1,2-Dichloroethene	0.056 U	NS	NS	7.9 U	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS
Trichloroethene	2.8	NS	NS	11 U	NS	NS	1.3	NS	NS	NS	1.1	NS	NS	NS	1.6	NS	NS	NS	1.1	NS	NS	NS	2.1	NS	NS
Vinyl chloride	0.02 U	NS	NS	5.1 U	NS	NS	0.51 U	NS	NS	NS	0.51 U	NS	NS	NS	0.51 U	NS	NS	NS	0.51 U	NS	NS	NS	0.51 U	NS	NS
m,p-Xylene	22	NS	NS	22 U	NS	NS	2.2 U	NS	NS	NS	2.2 U	NS	NS	NS	2.2 U	NS	NS	NS	2.2 U	NS	NS	NS	2.2 U	NS	NS
o-Xylene	6.6	NS	NS	8.7 U	NS	NS	0.87 U	NS	NS	NS	0.87 U	NS	NS	NS	0.87 U	NS	NS	NS	0.87 U	NS	NS	NS	0.87 U	NS	NS

Notes:
All values are shown in units of micrograms per cubic meter (µg/m³).
U - Not detected above reporting limit
J - Estimated
E - Result exceeded upper limit of calibration range
NJ - Tentative in identification and estimated in value due to poor mass spectral quality
NS - Not Sampled

Table 2
Building 11 Area Analytical Data Summary
Former Philips Display Components Facility - Seneca Falls, New York

Sample Description	BUILDING 13A INDOOR AIR																								
Sample ID	IA-B13A-01																								
Date Collected	7/15/03	10/2/03	1/20/04	2/14/06	6/28/06	9/13/06	12/12/06	3/20/07	6/21/07	9/19/07	12/11/07	3/26/08	6/17/08	9/24/08	12/18/08	3/26/09	6/25/09	9/23/09	12/17/09	3/24/10	6/22/10	9/22/10	12/28/10	3/23/11	6/22/11
1,1,1-Trichloroethane	0.58	1.9	1.0	0.93	0.23	1.5	1.1	1.1	0.41	0.45	0.93 J	0.27	0.25	1.3	1.3	0.65	0.35	0.35	1.5	1.3	0.82	0.26	0.75	0.54	0.33 NJ
1,1,2,2-Tetrachloroethane	0.14 U	0.069 U	0.21 U	0.069 U	0.27 U	0.27 U	0.27 U	0.21 U	0.082 U	0.14 U	0.27 U	0.14 U	0.14 U	0.069 U	0.14 UJ	0.10 U	0.17 U	0.14 U	0.069 U	0.069 U	0.10 U	0.17 U	0.069 U	0.069 U	0.14 U
1,1,2-Trichloroethane	0.10 U	0.055 U	0.16 U	0.055 U	0.22 U	0.22 U	0.22 U	0.16 U	0.065 U	0.11 U	0.22 U	0.11 U	0.11 U	0.055 U	0.11 U	0.082 U	0.14 U	0.11 U	0.055 U	0.055 U	0.082 U	0.14 U	0.055 U	0.055 U	0.11 U
1,1-Dichloroethane	0.080 U	0.040 U	0.12 U	0.040 UJ	0.16 U	0.16 U	0.16 U	0.12 U	0.049 U	0.081 U	0.16 U	0.081 U	0.081 U	0.040 U	0.081 U	0.061 U	0.10 U	0.081 U	0.065	0.061	0.061 U	0.10 U	0.041 NJ	0.040 U	0.081 U
1,1-Dichloroethene	0.054	0.25	0.12 U	0.12	0.16 U	0.16 U	0.16 U	0.12 U	0.095	0.079 U	0.16 U	0.079 U	0.079 U	0.33	0.28 NJ	0.14	0.11	0.11	0.37	0.40	0.25	0.10 U	0.20	0.12	0.079 U
1,2-Dichloroethane	0.080 U	0.040 U	0.12 U	0.040 U	0.32 U	0.32 U	0.32 U	0.24 U	0.10 U	0.16 U	0.32 U	0.16 U	0.16 U	0.081 U	0.16 U	0.12 U	0.20 U	0.16 U	0.081 U	0.081 U	0.12 U	0.20 U	0.081 U	0.081 U	0.16 U
Benzene	2.6	1.8	1.2	2.7	2.4	3.5	6.7	3.5	1.2	1.3	2.5	1.9	1.7	0.70	1.30	2.1	1.9	2.3	0.54	0.67	1.2	3.1	1.3	0.75	1.5
cis-1,2-Dichloroethene	1.2	3.1	1.5	0.91	0.67	1.8 NJ	1.8	1.4	1.1	1.3	1.7	0.95	0.75	0.48	0.56	1.2	0.48	0.59	0.25	0.40	0.67	1.1	0.10	0.39	0.40
Ethylbenzene	3.1	0.78	0.56	3.9	4.8	3.0	3.7	1.9	3.7	2.6	1.3	1.4	4.3	0.96	0.52	1.6	2.7	2.0	0.36	0.61	2.8	1.4	0.26	0.47	1.8
Tetrachloroethene	20	3.9	2.2	2.9	8.1	8.1	6.8	3.0	5.2	1.3	8.1	1.2	0.75	0.25	0.22	0.88	0.50	0.54	0.095	0.19	0.41	1.2	0.14	0.62	2.9
Toluene	12	4.1	2.6	6.8 J	4.5	6.0	9.0	8.7 J	4.1	3.5	4.5	4.9	4.5	3.3	2.4	4.1	7.9	5.3	0.94	1.9	4.5	7.1	1.4	1.2	3.0
trans-1,2-Dichloroethene	0.056 U	0.04 U	0.12 U	0.040 U	0.16 U	0.16 U	0.16 U	0.12 U	0.048 U	0.079 U	0.16 U	0.079 U	0.079 U	0.040 U	0.079 U	0.059 U	0.099 U	0.079 U	0.04 U	0.040 U	0.059 U	0.10 U	0.040 U	0.040 U	0.079 U
Trichloroethene	11	12	7.0	15	2.2	15	19	10	3.1	6.4	12	5.2	1.9	3.3	4.7	8.1	3.3	3.4	2.7	2.1	4.7	3.4	2.3	1.8	2.4
Vinyl chloride	0.020 U	0.026 U	0.077 U	0.049 J	0.20 U	0.20 U	0.20 U	0.15 U	0.064 U	0.10 U	0.20 U	0.10 U	0.10 U	0.051 U	0.10 U	0.08 U	0.13 U	0.10 U	0.051 U	0.051 U	0.077 U	0.13 U	0.51 U	0.051 U	0.10 U
m,p-Xylene	9.6	2.6	1.7	12	21	11	9.1	6.1	9.6	9.1	4.3	5.2	17 E	3.5	1.7	5.6	9.1	6.9	1.2	2.0	9.6	4.6	0.67 U	1.7	6.8
o-Xylene	3.1	0.043 U	0.56	3.9	8.3	4.3	3.0	2.1	3.5	3.1	1.5	1.8	6.1	1.1	0.61	1.8	2.6	2.2	0.38	0.65	3.0 J	1.6	0.24	0.59	2.2

Building Number	BUILDING 13A SUB-SLAB VAPOR																								
Sample ID	SVSS-B13A-01																								
Date Collected	7/17/03	10/2/03	1/20/04	2/14/06	6/28/06	9/13/06	12/12/06	3/20/07	6/21/07	9/19/07	12/11/07	3/26/08	6/17/08	9/24/08	12/18/08	3/26/09	6/25/09	9/23/09	12/17/09	3/24/10	6/22/10	9/22/10	12/28/10	3/23/11	6/22/11
1,1,1-Trichloroethane	1.4	NS	NS	11 U	NS	NS	1.9	NS	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS
1,1,2,2-Tetrachloroethane	0.28 U	NS	NS	14 U	NS	NS	1.4 U	NS	NS	NS	1.4 U	NS	NS	NS	1.4 U	NS	NS	NS	1.4 U	NS	NS	NS	1.4 U	NS	NS
1,1,2-Trichloroethane	0.2 U	NS	NS	11 U	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS
1,1-Dichloroethane	0.16 U	NS	NS	8.1 U	NS	NS	0.81 U	NS	NS	NS	0.81 U	NS	NS	NS	0.81 U	NS	NS	NS	0.81 U	NS	NS	NS	0.81 U	NS	NS
1,1-Dichloroethene	0.08 U	NS	NS	7.9 U	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS
1,2-Dichloroethane	0.16 U	NS	NS	8.1 U	NS	NS	0.81 U	NS	NS	NS	0.81 U	NS	NS	NS	0.81 U	NS	NS	NS	0.81 U	NS	NS	NS	0.81 U	NS	NS
Benzene	0.32	NS	NS	6.4 U	NS	NS	0.64 U	NS	NS	NS	0.64 U	NS	NS	NS	0.64 U	NS	NS	NS	0.64 U	NS	NS	NS	0.64 U	NS	NS
cis-1,2-Dichloroethene	1.2	NS	NS	7.9 U	NS	NS	11	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS
Ethylbenzene	0.17 U	NS	NS	8.7 U	NS	NS	0.87 U	NS	NS	NS	0.87 U	NS	NS	NS	0.87 U	NS	NS	NS	0.87 U	NS	NS	NS	0.87 U	NS	NS
Tetrachloroethene	5.1	NS	NS	14 U	NS	NS	1.4 U	NS	NS	NS	1.4 U	NS	NS	NS	1.4 U	NS	NS	NS	1.4 U	NS	NS	NS	1.4 U	NS	NS
Toluene	0.35	NS	NS	7.5 U	NS	NS	0.75 U	NS	NS	NS	0.75 U	NS	NS	NS	0.75 U	NS	NS	NS	0.75 U	NS	NS	NS	0.75 U	NS	NS
trans-1,2-Dichloroethene	0.11 U	NS	NS	7.9 U	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS
Trichloroethene	53	NS	NS	34	NS	NS	64	NS	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS
Vinyl chloride	0.04 U	NS	NS	5.1 U	NS	NS	0.51 U	NS	NS	NS	0.51 U	NS	NS	NS	0.51 U	NS	NS	NS	0.51 U	NS	NS	NS	0.51 U	NS	NS
m,p-Xylene	0.59	NS	NS	22 U	NS	NS	2.2 U	NS	NS	NS	2.2 U	NS	NS	NS	2.2 U	NS	NS	NS	2.2 U	NS	NS	NS	2.2 U	NS	NS
o-Xylene	0.24	NS	NS	8.7 U	NS	NS	0.87 U	NS	NS	NS	0.87 U	NS	NS	NS	0.87 U	NS	NS	NS	0.87 U	NS	NS	NS	0.87 U	NS	NS

Notes:
All values are shown in units of micrograms per cubic meter (µg/m³).
U - Not detected above reporting limit
J - Estimated
E - Result exceeded upper limit of calibration range
NJ - Tentative in identification and estimated in value due to poor mass spectral quality
NS - Not Sampled

Table 3
Building 7 Area Analytical Data Summary
Former Philips Display Facility - Seneca Falls, New York

Sample Description	BUILDING 7 INDOOR AIR																					
Sample ID	IA-B7-01																					
Date Collected	7/15/03	10/2/03	1/20/04	12/12/06	3/20/07	6/21/07	9/28/07	12/11/07	3/26/08	6/17/08	9/25/08	12/18/08	3/26/09	6/25/09	9/23/09	12/17/09	3/24/10	6/22/10	9/22/10	12/28/10	3/23/11	6/22/11
1,1,1-Trichloroethane	0.42	0.45	0.35	0.28	0.43	0.055	0.060	0.16 U	0.14	0.11 U	0.16 UJ	0.60 U	0.18 U	0.27 U	0.082 U	0.11 U	0.16 U	0.14 U	0.33 U	0.16 U	0.11 U	0.22 U
1,1,2,2-Tetrachloroethane	0.14 U	0.34 U	0.21 U	0.34 U	0.34 U	0.069 U	0.069 U	0.21 U	0.14 U	0.14 U	0.21 UJ	0.76 UJ	0.23 U	0.34 U	0.10 U	0.14 U	0.21 U	0.17 U	0.41 U	0.21 U	0.14 U	0.27 U
1,1,2-Trichloroethane	0.1 U	0.27 U	0.16 U	0.27 U	0.27 U	0.055 U	0.055 U	0.16 U	0.11 U	0.11 U	0.16 UJ	0.60 U	0.18 U	0.27 U	0.082 U	0.11 U	0.16 U	0.14 U	0.33 U	0.16 U	0.11 U	0.22 U
1,1-Dichloroethane	0.08 U	0.2 U	0.12 U	0.2 U	0.2 U	0.040 U	0.040 U	0.12 U	0.081 U	0.081 U	0.12 UJ	0.45 U	0.13 U	0.20 U	0.061 U	0.081 U	0.12 U	0.10 U	0.24 U	0.12 U	0.08 U	0.16 U
1,1-Dichloroethene	0.04 U	0.2 U	0.12 U	0.2 U	0.2 U	0.040 U	0.040 U	0.12 U	0.079 U	0.079 U	0.12 UJ	0.44 U	0.13 U	0.20 U	0.059 U	0.079 U	0.12 U	0.1 U	0.24 U	0.12 U	0.08 U	0.16 U
1,2-Dichloroethane	0.08 U	0.2 U	0.12 U	0.4 U	0.4 U	0.081 U	0.081 U	0.24 U	0.16 U	0.16 U	0.24 UJ	0.89 U	0.27 U	0.40 U	0.12 U	0.16 U	0.24 U	0.20 U	0.49 U	0.24 U	0.16 U	0.32 U
Benzene	1.1	1.4	2.5	6.1	3.5	0.29 NJ	0.42	2.0	2.2	1.2	1.2 J	5.8	2.1	2.8	1.1	2.8	3.2	0.73	1.7	2.0	1.7	1.1
cis-1,2-Dichloroethene	0.21	0.95	1.0	0.52	0.95	0.095 NJ	0.075	0.63	0.75	0.44	0.12 J	0.52	4.4	0.34 NJ	0.067	0.26	0.75	0.1	0.24 U	0.66	0.14	0.16 U
Ethylbenzene	1.1	1.6	2.6	2.6	0.87	0.24	0.23	0.78	0.87	1.3	1.1 J	4.3	0.91	2.1	0.74	1.5	1.9	0.61	1.1	0.79	0.89	1.5
Tetrachloroethene	0.62	0.62	2.2	4.5	2.4	0.19	0.14	3.0	0.75	0.35	0.28 J	0.75 U	0.36	0.34 U	0.10 U	0.14 U	1.2	0.17 U	0.41 U	0.38	0.19	0.30
Toluene	7.0	2.5	9.4	16	5.3	1.4	1.4	5.3	7.2	6.8	8.3 J	27	8.3	13	4.5	7.2	11	4.9	9.7	6.3	4.2	9.9
trans-1,2-Dichloroethene	0.056 U	0.2 U	0.12 U	0.2 U	0.2 U	0.040 U	0.040 U	0.12 U	0.079 U	0.079 U	0.12 UJ	0.44 U	0.13 U	0.20 U	0.059 U	0.079 U	0.12 U	0.1 U	0.24 U	0.12 U	0.08 U	0.16 U
Trichloroethene	2.7	13	5.9	5.9	18	0.64	1.1	3.9	9.7	1.5	1.2 J	6.4	4.8	2.5	0.70	5.4	4.7	1.1	1.3	8.9	1.6	1.0
Vinyl chloride	0.02 U	0.13 U	0.077 U	0.26 U	0.26 U	0.051 U	0.051 U	0.15 U	0.10 U	0.10 U	0.15 UJ	0.56 U	0.95	0.26 U	0.077 U	0.10 U	0.15 U	0.13 U	0.31 U	0.15 U	0.10 U	0.20 U
m-Xylene & p-Xylene	3.6	3.0	10	9.1	2.8	0.74	0.56	2.5	3.2	4.8	4.0 J	14	3.1	6.5	2.2	5.6	6.9	2.0	3.4	2.5	3.0	5.3
o-Xylene	1.3	0.87	3.1	3.2	1.0	0.24	0.22	0.87	1.1	1.7	1.6 J	4.8	1.2	2.4	0.83	2.1	2.4	0.87 J	1.3	0.85	0.98	2.0

Sample Description	BUILDING 7 SUB-SLAB VAPOR																					
Sample ID	SVSS-B7-01																					
Date Collected	7/17/03	10/2/03	1/20/04	12/12/06	3/20/07	6/21/07	9/28/07	12/11/07	3/26/08	6/17/08	9/24/08	12/18/08	3/26/09	6/25/09	9/23/09	12/17/09	3/24/10	6/22/10	9/22/10	12/28/10	3/23/11	6/22/11
1,1,1-Trichloroethane	33 U	NS	NS	11 U	4.4 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U
1,1,2,2-Tetrachloroethane	41 U	NS	NS	14 U	5.5 U	1.4 U	1.4 U	1.4 U	1.4 U	1.4 U	1.4 U	1.4 U	1.4 U	1.4 U	1.4 U	1.4 U	1.4 U	1.4 U	1.4 U	1.4 U	1.4 U	1.4 U
1,1,2-Trichloroethane	33 U	NS	NS	11 U	4.4 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U	1.1 U
1,1-Dichloroethane	24 U	NS	NS	8.1 U	3.2 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U
1,1-Dichloroethene	24 U	NS	NS	7.9 U	3.2 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U
1,2-Dichloroethane	24 U	NS	NS	8.1 U	3.2 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U	0.81 U
Benzene	19 U	NS	NS	6.4 U	2.6 U	0.64 U	0.64 U	0.64 U	0.64 U	0.64 U	0.64 U	0.64 U	0.64 U	0.64 U	0.64 U	0.67	0.64 U	0.64 U	0.64 U	0.64 U	0.64 U	0.64 U
cis-1,2-Dichloroethene	24 U	NS	NS	7.9 U	3.2 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U
Ethylbenzene	26 U	NS	NS	8.7 U	3.5 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U
Tetrachloroethene	40	NS	NS	17	8.1	1.7	1.4 U	1.4 U	1.4 U	2.0	1.4 U	1.4 U	2.0	2.2	1.5	1.4 U	1.4 U	2.6	1.4 U	2.2	1.7	2.8
Toluene	22 U	NS	NS	7.5 U	3.0 U	1.2	0.79	0.75 U	0.75 U	0.75 U	1.2	0.75 U	0.75 U	1.1	0.75 U	2.5	0.75 U	0.75 U	0.75 U	0.75 U	0.94	1.7
trans-1,2-Dichloroethene	24 U	NS	NS	7.9 U	3.2 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U	0.79 U
Trichloroethene	3300	NS	NS	1700	470	11	12	12	70	64	24	40	59	59	64	70	43	100	30	19	28	43
Vinyl chloride	15 U	NS	NS	5.1 U	2.0 U	0.51 U	0.51 U	0.51 U	0.51 U	0.51 U	0.51 U	0.51 U	0.51 U	0.51 U	0.51 U	0.51 U	0.51 U	0.51 U	0.51 U	0.51 U	0.51 U	0.51 U
m-Xylene & p-Xylene	26 U	NS	NS	22 U	8.7 U	2.2 U	2.2 U	2.2 U	2.2 U	2.2 U	2.2 U	2.2 U	2.2 U	2.2 U	2.2 U	2.2 U	1.7 U	1.7 U	2.2 U	2.2 U	2.2 U	2.7
o-Xylene	27 U	NS	NS	8.7 U	3.5 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.87 U	0.85

Notes:

All values are shown in units of micrograms per cubic meter (µg/m3).

U - Not detected above reporting limit

NJ - Tentative in identification and estimated in value due to poor mass spectral quality

NS - Not Sampled

J - Estimated

Table 4
Building 10 Area Analytical Data Summary
Former Philips Display Components Facility - Seneca Falls, New York

Sample Description	BUILDING 10 INDOOR AIR																								
Sample ID	IA-B10-01																								
Date Collected	7/15/03	10/2/03	1/20/04	2/14/06	6/28/06	9/13/06	12/12/06	3/20/07	6/21/07	9/19/07	12/11/07	3/26/08	6/17/08	9/24/08	12/18/08	3/26/09	6/25/09	9/23/09	12/17/09	3/24/10	6/22/10	9/22/10	12/28/10	3/23/11	6/22/11
1,1,1-Trichloroethane	0.20	1.4	0.50	0.55	0.25	0.29 NJ	1.0	0.76	0.13	0.082	0.65 J	0.27	0.24	0.14 U	0.55 U	0.43 U	0.43	0.12	1.1 U	0.25	0.16	0.13 NJ	0.34 U	0.14 U	0.11 U
1,1,2,2-Tetrachloroethane	0.14 U	0.69 U	0.34 U	0.069 U	0.27 U	0.27 U	0.55 U	0.27 U	0.069 U	0.069 U	0.55 U	0.17 U	0.17 U	0.17 U	0.69 UJ	0.54 U	0.54 U	0.069 U	1.4 U	0.21 U	0.069 U	0.14 U	0.43 U	0.17 U	0.14 U
1,1,2-Trichloroethane	0.10 U	0.55 U	0.27 U	0.055 U	0.22 U	0.22 U	0.44 U	0.22 U	0.055 U	0.055 U	0.44 U	0.14 U	0.14 U	0.14 U	0.55 U	0.43 U	0.43 U	0.055 U	1.1 U	0.16 U	0.055 U	0.11 U	0.34 U	0.14 U	0.11 U
1,1-Dichloroethane	0.08 U	0.4 U	0.20 U	0.040 UJ	0.16 U	0.16 U	0.32 U	0.16 U	0.040 U	0.040 U	0.32 U	0.10 U	0.10 U	0.10 U	0.40 U	0.32 U	0.32 U	0.040 U	0.81 U	0.12 U	0.040 U	0.081 U	0.25 U	0.10 U	0.081 U
1,1-Dichloroethene	0.04 U	0.4 U	0.20 U	0.075	0.16 U	0.16 U	0.32 U	0.16 U	0.040 U	0.040 U	0.32 U	0.099 U	0.099 U	0.099 U	0.40 U	0.31 U	0.31 U	0.040 U	0.79 U	0.12 U	0.040 U	0.079 U	0.25 U	0.10 U	0.079 U
1,2-Dichloroethane	0.08 U	0.4 U	0.20 U	0.040 U	0.32 U	0.32 U	0.65 U	0.32 U	0.081 U	0.081 U	0.65 U	0.20 U	0.20 U	0.20 U	0.81 U	0.65 U	0.65 U	0.081 U	1.6 U	0.24 U	0.081 U	0.16 U	0.51 U	0.20 U	0.16 U
Benzene	0.90	3.1	3.5	3.8	3.2	2.2	7.0	6.4	0.67	0.58	2.6	2.8	0.77	0.70	4.2	4.2	4.5	1.4	3.2	2.5	1.2	1.7	4.1	2.6	1.3
cis-1,2-Dichloroethene	0.70	4.0	4.4	1.4	4.0	0.95 NJ	2.6	1.9	0.63	0.38	2.8	2.5	3.2	0.75	2.9	3.2	7.5	2.2	3.5	4.4	1.8	1.8	2.3	0.96	0.31
Ethylbenzene	0.59	0.91	6.9	1.7	1.6	0.65	2.4	1.0	0.39	0.24	0.74	0.74	1.90	0.42	1.7	2.1	4.8	0.69	1.4	2.1	0.83	0.89	0.72	1.1	0.74
Tetrachloroethene	6.4	5.2	8.1	22	20	4.1	10	6.2	2.5	0.43	9.5	2.8	1.7	12	1.0	1.2	3.1	0.66	1.4 U	1.5	0.75	0.50	0.71	0.64	0.79
Toluene	4.3	5.3	8.7	4.9 J	4.5	3.5	9.4	6.0 J	1.6	1.1	3.8	4.5	2.6	2.2	11	11	28	2.8	7.2	7.2	2.2	5.1	3.9	3.7	3.8
trans-1,2-Dichloroethene	0.056 U	0.40 U	0.20 U	0.044	0.16 U	0.16 U	0.32 U	0.16 U	0.040 U	0.040 U	0.32 U	0.099 U	0.099 U	0.099 U	0.40 U	0.31 U	0.31 U	0.040 U	0.79 U	0.12 U	0.040 U	0.079 U	0.25 U	0.10 U	0.079 U
Trichloroethene	4.0	30	26	45	9.7	15	32	17	2.4	3.0	24	10	5.4	4.3	37	31	13	3.8	64	11	4.4	5.0	20	11	0.61
Vinyl chloride	0.020 U	0.26 U	0.13 U	0.074 J	0.20 U	0.20 U	0.41 U	0.20 U	0.051 U	0.051 U	0.41 U	0.13 U	0.13 U	0.13 U	0.51 U	0.41 U	0.41 U	0.087	1.0 U	0.15 U	0.056 NJ	0.10 U	0.32 U	0.13 U	0.10 U
m,p-Xylene	1.8	2.8	29	4.3	6.1	2.0	6.9	3.5	1.3	0.61	2.5	2.8	6.9	1.4	6.5	7.4	18	2.3	4.3	8.7	3.0	3.2	2.2	2.9	2.4
o-Xylene	0.69	1.0	6.9	2.3	2.5	0.74	2.5	1.1	0.43	0.21	0.91	0.87	2.3	0.52	2.1	2.4	6.1	0.87	1.6	2.9	1.0 J	1.0	0.84	1.0	0.84

Building Number	BUILDING 10 SUB-SLAB VAPOR																								
Sample ID	SVSS-B10-01																								
Date Collected	7/17/03	10/2/03	1/20/04	2/14/06	6/28/06	9/13/06	12/12/06	3/20/07	6/21/07	9/19/07	12/11/07	3/26/08	6/17/08	9/24/08	12/18/08	3/26/09	6/25/09	9/23/09	12/17/09	3/24/10	6/22/10	9/22/10	12/28/10	3/23/11	6/22/11
1,1,1-Trichloroethane	26 U	NS	NS	11 U	NS	NS	16 U	NS	NS	NS	11 U	NS	NS	NS	8.7 U	NS	NS	NS	8.7 U	NS	NS	NS	1.1 U	NS	NS
1,1,2,2-Tetrachloroethane	32 U	NS	NS	14 U	NS	NS	21 U	NS	NS	NS	14 U	NS	NS	NS	11 U	NS	NS	NS	11 U	NS	NS	NS	1.4 U	NS	NS
1,1,2-Trichloroethane	26 U	NS	NS	11 U	NS	NS	16 U	NS	NS	NS	11 U	NS	NS	NS	8.7 U	NS	NS	NS	8.7 U	NS	NS	NS	1.1 U	NS	NS
1,1-Dichloroethane	19 U	NS	NS	8.1 U	NS	NS	12 U	NS	NS	NS	8.1 U	NS	NS	NS	6.5 U	NS	NS	NS	6.5 U	NS	NS	NS	0.81 U	NS	NS
1,1-Dichloroethene	19 U	NS	NS	7.9 U	NS	NS	12 U	NS	NS	NS	7.9 U	NS	NS	NS	6.3 U	NS	NS	NS	6.3 U	NS	NS	NS	0.79 U	NS	NS
1,2-Dichloroethane	19 U	NS	NS	8.1 U	NS	NS	12 U	NS	NS	NS	8.1 U	NS	NS	NS	6.5 U	NS	NS	NS	6.5 U	NS	NS	NS	0.81 U	NS	NS
Benzene	15 U	NS	NS	6.4 U	NS	NS	9.6 U	NS	NS	NS	6.4 U	NS	NS	NS	5.1 U	NS	NS	NS	5.1 U	NS	NS	NS	0.6 U	NS	NS
cis-1,2-Dichloroethene	38	NS	NS	11	NS	NS	26	NS	NS	NS	14	NS	NS	NS	6.7 NJ	NS	NS	NS	6.3	NS	NS	NS	2.9	NS	NS
Ethylbenzene	20 U	NS	NS	8.7 U	NS	NS	13 U	NS	NS	NS	8.7 U	NS	NS	NS	6.9 U	NS	NS	NS	6.9 U	NS	NS	NS	0.87 U	NS	NS
Tetrachloroethene	32 U	NS	NS	14 U	NS	NS	20 U	NS	NS	NS	14 U	NS	NS	NS	11 U	NS	NS	NS	11 U	NS	NS	NS	3.6	NS	NS
Toluene	18 U	NS	NS	7.5 U	NS	NS	11 U	NS	NS	NS	7.5 U	NS	NS	NS	6.0 U	NS	NS	NS	6.0 U	NS	NS	NS	3.7	NS	NS
trans-1,2-Dichloroethene	19 U	NS	NS	7.9 U	NS	NS	12 U	NS	NS	NS	7.9 U	NS	NS	NS	6.3 U	NS	NS	NS	6.3 U	NS	NS	NS	0.79 U	NS	NS
Trichloroethene	2700	NS	NS	1100	NS	NS	3200	NS	NS	NS	1800	NS	NS	NS	1700	NS	NS	NS	1200	NS	NS	NS	130	NS	NS
Vinyl chloride	12 U	NS	NS	5.1 U	NS	NS	7.7 U	NS	NS	NS	5.1 U	NS	NS	NS	4.1 U	NS	NS	NS	4.1 U	NS	NS	NS	0.51 U	NS	NS
m,p-Xylene	20 U	NS	NS	22 U	NS	NS	33 U	NS	NS	NS	22 U	NS	NS	NS	17 U	NS	NS	NS	17 U	NS	NS	NS	2.2 U	NS	NS
o-Xylene	21 U	NS	NS	8.7 U	NS	NS	13 U	NS	NS	NS	8.7 U	NS	NS	NS	6.9 U	NS	NS	NS	6.9 U	NS	NS	NS	0.87 U	NS	NS

Notes:
All values are shown in units of micrograms per cubic meter (µg/m³).
U - Not detected above reporting limit
J - Estimated
NJ - Tentative in identification and estimated in value due to poor mass spectral quality
NS - Not Sampled

Table 4
Building 10 Area Analytical Data Summary
Former Philips Display Components Facility - Seneca Falls, New York

Sample Description	BUILDING 10A INDOOR AIR																								
Sample ID	IA-B10A-01																								
Date Collected	7/15/03	10/2/03	1/20/04	2/14/06	6/28/06	9/13/06	12/12/06	3/20/07	6/21/07	9/19/07	12/11/07	3/26/08	6/17/08	9/24/08	12/18/08	3/26/09	6/25/09	9/23/09	12/17/09	3/24/10	6/22/10	9/22/10	12/28/10	3/23/11	6/22/11
1,1,1-Trichloroethane	0.30	1.1	0.49	0.49	0.29	0.34	1.4	0.76	0.21	0.27	0.82 J	0.28	0.19	0.19	0.51	0.43 U	0.65	0.28	0.43 U	0.28	0.34	0.17	0.29	0.24	0.14 NJ
1,1,2,2-Tetrachloroethane	0.14 U	0.34 U	0.21 U	0.069 U	0.34 U	0.14 U	0.55 U	0.27 U	0.069 U	0.082 U	0.41 U	0.14 U	0.14 U	0.10 U	0.41 UJ	0.54 U	0.54 U	0.10 U	0.54 U	0.21 U	0.10 U	0.21 U	0.21 U	0.14 U	0.069 U
1,1,2-Trichloroethane	0.10 U	0.27 U	0.16 U	0.055 U	0.27 U	0.11 U	0.44 U	0.22 U	0.055 U	0.065 U	0.33 U	0.11 U	0.11 U	0.082 U	0.33 U	0.43 U	0.43 U	0.082 U	0.43 U	0.16 U	0.082 U	0.16 U	0.17 U	0.11 U	0.055 U
1,1-Dichloroethane	0.08 U	0.20 U	0.12 U	0.040 UJ	0.20 U	0.081 U	0.32 U	0.16 U	0.040 U	0.049 U	0.24 U	0.081 U	0.081 U	0.061 U	0.24 U	0.32 U	0.32 U	0.061 U	0.32 U	0.12 U	0.061 U	0.12 U	0.13 U	0.081 U	0.040 U
1,1-Dichloroethene	0.04 U	0.20 U	0.12 U	0.056	0.20 U	0.079 U	0.32 U	0.16 U	0.040 U	0.048 U	0.24 U	0.079 U	0.079 U	0.059 U	0.24 U	0.31 U	0.31 U	0.059 U	0.31 U	0.12 U	0.059 U	0.12 U	0.12 U	0.079 U	0.040 U
1,2-Dichloroethane	0.08 U	0.20 U	0.15	0.040 U	0.40 U	0.16 U	0.65 U	0.32 U	0.081 U	0.10 U	3.1 J	0.16 U	0.16 U	0.12 U	0.49 U	0.65 U	0.65 U	0.12 U	0.65 U	0.24 U	0.12 U	0.24 U	0.25 U	0.16 U	0.081 U
Benzene	2.3	1.5	2.7	2.8	2.7	1.4	7.7	3.8	0.64	0.70	2.6	2.7	0.64	0.83	3.5	4.2	4.5	2.6	2.9	2.7	1.3	1.9	5.9	2.2	1.9
cis-1,2-Dichloroethene	0.89	2.2	4.8	1.1	4.8	0.38 NJ	3.0	1.9	1.3	1.2	3.3	3.2	1.4	1.5	3.3	5.2	8.7	4.0	4.0	5.2	4.4	1.9	3.6	1.9	0.51
Ethylbenzene	2.1	0.65	2.3	1.3	2.3	0.69	2.8	0.78	0.52	0.42	0.78	0.87	1.4 NJ	0.48	1.5	2.3	5.2	1.0	1.3	2.5	1.2	0.91	1.1	1.1	0.75
Tetrachloroethene	7.6	2.7	5.4	6.0	22	3.0	12	6.1	3.2	0.81	12	2.6	1.2	3.1	1.3	1.8	4.1	1.8	0.88	1.1	1.4	0.72	0.97	0.80	1.2
Toluene	11	3.3	6.0	3.8 J	6.4	2.8	10	4.9 J	2.4	1.5	4.1	4.5	2.1	2.3	8.7	12	28	4.5	7.2	8.3	4.1	5.3	6.4	4.9	2.2
trans-1,2-Dichloroethene	0.056 U	0.20 U	0.12 U	0.040 U	0.20 U	0.079 U	0.32 U	0.16 U	0.040 U	0.048 U	0.24 U	0.079 U	0.079 U	0.059 U	0.24 U	0.31 U	0.31 U	0.059 U	0.31 U	0.12 U	0.059 U	0.12 U	0.12 U	0.079 U	0.040 U
Trichloroethene	4.5	12	19	32	9.1	7.0	32	15	3.0	4.9	23	9.7	2.8	4.8	19	21	15	4.6	25	9.7	6.4	3.8	13	5.7	0.91
Vinyl chloride	0.020 U	0.13 U	0.10 NJ	0.066 J	0.26 U	0.10 U	0.41 U	0.20 U	0.051 U	0.064 U	0.31 U	0.10 U	0.10 U	0.077 U	0.31 U	0.41 U	0.41 U	0.12	0.41 U	0.15 U	0.095 NJ	0.15 U	0.16 U	0.1 U	0.051 U
m,p-Xylene	7.5	2.0	9.1	3.4	9.1	2.3	7.8	2.9	1.7	1.3	2.2	3.2	5.2	1.8	6.1	9.6	17	3.4	4.8	10	4.8	3.2	3.4	3.6	2.6
o-Xylene	2.7	0.74	2.4	1.8	3.6	0.78	2.5	1.0	0.56	0.48	0.69	1.1	1.8	0.65	1.9	3.0	5.2	1.2	1.6	3.6	1.6 J	1.1	1.2	1.2	0.93

Building Number	BUILDING 10A SUB-SLAB VAPOR																								
Sample ID	SVSS-B10A-01																								
Date Collected	7/17/03	10/2/03	1/20/04	2/14/06	6/28/06	9/13/06	12/12/06	3/20/07	6/21/07	9/19/07	12/11/07	3/26/08	6/17/08	9/24/08	12/18/08	3/26/09	6/25/09	9/23/09	12/17/09	3/24/10	6/22/10	9/22/10	12/28/10	3/23/11	6/22/11
1,1,1-Trichloroethane	14	NS	NS	11 U	NS	NS	3.4	NS	NS	NS	1.1	NS	NS	NS	2.5	NS	NS	NS	2.2	NS	NS	NS	2.5	NS	NS
1,1,2,2-Tetrachloroethane	3.2 U	NS	NS	14 U	NS	NS	1.4 U	NS	NS	NS	1.4 U	NS	NS	NS	1.4 U	NS	NS	NS	1.4 U	NS	NS	NS	1.4 U	NS	NS
1,1,2-Trichloroethane	2.3 U	NS	NS	11 U	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS	NS	1.1 U	NS	NS
1,1-Dichloroethane	2.5	NS	NS	8.1 U	NS	NS	2.1	NS	NS	NS	0.81 U	NS	NS	NS	1.5	NS	NS	NS	1.4	NS	NS	NS	1.8	NS	NS
1,1-Dichloroethene	0.9 U	NS	NS	7.9 U	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS
1,2-Dichloroethane	1.8 U	NS	NS	8.1 U	NS	NS	0.81 U	NS	NS	NS	0.81 U	NS	NS	NS	0.81 U	NS	NS	NS	0.81 U	NS	NS	NS	0.81 U	NS	NS
Benzene	3.4 U	NS	NS	6.4 U	NS	NS	0.64 U	NS	NS	NS	0.64 U	NS	NS	NS	0.64 U	NS	NS	NS	0.64 U	NS	NS	NS	0.64 U	NS	NS
cis-1,2-Dichloroethene	10	NS	NS	7.9 U	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS
Ethylbenzene	2 U	NS	NS	8.7 U	NS	NS	0.87 U	NS	NS	NS	0.87 U	NS	NS	NS	0.87 U	NS	NS	NS	0.87 U	NS	NS	NS	1.0	NS	NS
Tetrachloroethene	920	NS	NS	44	NS	NS	140	NS	NS	NS	81	NS	NS	NS	95	NS	NS	NS	100	NS	NS	NS	49	NS	NS
Toluene	3.2	NS	NS	7.5 U	NS	NS	2.6	NS	NS	NS	0.75 U	NS	NS	NS	0.75 U	NS	NS	NS	0.75 U	NS	NS	NS	3.3	NS	NS
trans-1,2-Dichloroethene	1.3 U	NS	NS	7.9 U	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS	NS	0.79 U	NS	NS
Trichloroethene	120	NS	NS	11 U	NS	NS	20	NS	NS	NS	9.1	NS	NS	NS	10	NS	NS	NS	13	NS	NS	NS	13	NS	NS
Vinyl chloride	0.45 U	NS	NS	5.1 U	NS	NS	0.51 U	NS	NS	NS	0.51 U	NS	NS	NS	0.51 U	NS	NS	NS	0.51 U	NS	NS	NS	0.51 U	NS	NS
m,p-Xylene	3.8 U	NS	NS	22 U	NS	NS	2.2 U	NS	NS	NS	2.2 U	NS	NS	NS	2.2 U	NS	NS	NS	2.2 U	NS	NS	NS	4.0	NS	NS
o-Xylene	2 U	NS	NS	8.7 U	NS	NS	0.87 U	NS	NS	NS	0.9 U	NS	NS	NS	0.87 U	NS	NS	NS	0.87 U	NS	NS	NS	1.7	NS	NS

Notes:
All values are shown in units of micrograms per cubic meter (µg/m³).
U - Not detected above reporting limit
J - Estimated
NJ - Tentative in identification and estimated in value due to poor mass spectral quality
NS - Not Sampled

Table 5
Building 1A Basement and First Floor Indoor Air Sample Analytical Data Summary
Former Philips Display Facility - Seneca Falls, New York

Sample Location	BUILDING 1A FIRST FLOOR																						
Sample ID	IA-B1A-01																						
Date Collected	7/15/03	10/2/03	1/20/04	12/12/06	3/20/07	6/21/07	9/19/07	12/11/07	3/26/08	6/17/08	9/24/08	12/18/08	3/26/09	6/25/09	9/23/09	12/17/09	3/24/10	6/24/10	8/30/10	9/22/10	12/28/10	3/23/11	6/22/11
1,1,1-Trichloroethane	0.63	0.35 JT	0.19	0.21	0.26	0.06	1.0	0.093	0.098	0.055 U	0.22 U	0.16 U	0.18 U	0.18 U	0.82 U	0.11 U	0.11 U	0.44 U	0.069	0.33 U	0.055 U	0.11 U	0.055 U
1,1,2,2-Tetrachloroethane	0.14 U	0.34 U	0.14 U	0.21 U	0.27 U	0.069 U	0.69 U	0.10 U	0.100 U	0.069 U	0.27 U	0.21 U	0.23 U	0.23 U	1 U	0.14 U	0.14 U	0.56 U	0.069 U	0.41 U	0.069 U	0.14 U	0.069 U
1,1,2-Trichloroethane	0.1 U	0.27 U	0.11 U	0.16 U	0.22 U	0.055 U	0.55 U	0.082 U	0.082 U	0.055 U	0.22 U	0.16 U	0.18 U	0.18 U	0.82 U	0.11 U	0.11 U	0.44 U	0.055 U	0.33 U	0.055 U	0.11 U	0.055 U
1,1-Dichloroethane	0.08 U	0.2 U	0.081 U	0.12 U	0.16 U	0.04 U	0.4 U	0.061 U	0.061 U	0.040 U	0.16 U	0.12 U	0.13 U	0.13 U	0.61 U	0.081 U	0.081 U	0.33 U	0.040 U	0.24 U	0.040 U	0.081 U	0.040 U
1,1-Dichloroethene	0.04 U	0.2 U	0.079 U	0.12 U	0.16 U	0.04 U	0.4 U	0.059 U	0.059 U	0.040 U	0.16 U	0.12 U	0.13 U	0.13 U	0.59 U	0.079 U	0.079 U	0.32 U	0.040 U	0.24 U	0.040 U	0.079 U	0.040 U
1,2-Dichloroethane	0.95	0.2 U	0.14	0.24 U	0.32 U	0.081 U	0.97	0.12 U	0.12 U	0.081 U	0.32 U	0.24 U	0.27 U	0.27 U	1.2 U	0.16 U	0.16 U	0.65 U	0.081 U	0.49 U	0.081 U	0.16 U	0.081 U
Benzene	1.8	1.3	0.89	3.5	2.3	0.24	1.2	1.4	1.4	0.14	0.89	4.8	3.8	1.7	2.4	2.7	1.3	1.9	0.70	1.6	1.8	2.0	0.35
cis-1,2-Dichloroethene	0.89	1.5	0.59	0.71	0.75	0.04 U	0.67	0.32	0.280	0.040 U	0.48	0.59	1.0	0.27	0.59 U	0.52	1.0	2.7	0.094	0.24 U	0.071	0.59	0.040 U
Ethylbenzene	3.4	0.91	0.61	2.0	0.78	0.21	3.8	0.61	0.74	0.65	1.0	0.78	1.1	1.1	6.1	0.69	1.0	2.0	0.67	2.4	0.17	0.45	0.48
Tetrachloroethene	25	1.9	8.1	3.6	0.88	0.095	2.4	1.6	0.75	0.068 U	0.88	0.56	0.46	0.22 U	1.0 U	0.58	0.60	0.75	0.13	0.43	0.10	0.58	0.11
Toluene	52	11	2.8	8.7	3.4	1.5	17	2.9	1.9	2.1	11	6.8	8.7	7.2	37	4.5	4.9	9.0	3.4	16	1.6	2.5	3.5
trans-1,2-Dichloroethene	0.06 U	0.2 U	0.079 U	0.12 U	0.16 U	0.04 U	0.4 U	0.059 U	0.059 U	0.04 U	0.16 U	0.12 U	0.13 U	0.13 U	0.59 U	0.079 U	0.079 U	0.32 U	0.040 U	0.24 U	0.040 U	0.079 U	0.040 U
Trichloroethene	6.9	10	2.1	9.1	12	0.39	3.4	2.9	4.9	0.059	2.3	9.7	7.0	0.59	2.7	3.7	7.5	27	1.5	2.4	1.1	6.8	0.26
Vinyl chloride	0.02 U	0.13 U	0.051 U	0.15 U	0.2 U	0.051 U	1.6	0.077 U	0.077 U	0.051 U	0.20 U	0.15 U	0.17 U	0.17 U	0.77 U	0.10 U	0.10 U	0.41 U	0.051 U	0.31 U	0.51 U	0.10 U	0.05 U
m-Xylene & p-Xylene	12	2.6	1.7	6.1	2.6	0.74	12	1.7	2.6	2.6	3.2	2.9	3.7	3.8	17	2.3	3.2	6.5	2.0	11	0.35	1.3	1.3
o-Xylene	3.5	0.74	0.56	1.4	0.61	0.18	2.1	0.4	0.69	0.74	0.96	1.0	1.2	1.1	3.9	1.1	0.8	1.8	0.67	2.9	0.19	0.46	0.47

Sample Location	BUILDING 1A BASEMENT																						
Sample ID	IA-B1A-BASE																						
Date Collected	7/15/03	10/2/03	1/20/04	12/12/06	3/20/07	6/21/07	9/19/07	12/11/07	3/26/08	6/17/08	9/24/08	12/18/08	3/26/09	6/25/09	9/23/09	12/17/09	3/24/10	6/24/10	8/30/10	9/22/10	12/28/10	3/23/11	6/22/11
1,1,1-Trichloroethane	NS	0.6 JT	0.27 U	0.55 U	1.1 U	0.11 U	0.43	0.22 U	0.22 U	0.055 U	0.27 U	0.35 U	0.55 U	0.071	1.4 U	0.33 U	0.27 U	2.2 U	0.19 U	0.22 U	0.055 U	0.82 U	0.055 U
1,1,2,2-Tetrachloroethane	NS	0.69 U	0.34 U	0.69 U	1.4 U	0.14 U	0.14 U	0.27 U	0.27 U	0.069 U	0.34 U	0.45 U	0.69 U	0.069 U	1.7 U	0.41 U	0.34 U	2.7 U	0.24 U	0.27 U	0.069 U	1.0 U	0.069 U
1,1,2-Trichloroethane	NS	0.55 U	0.27 U	0.55 U	1.1 U	0.11 U	0.11 U	0.22 U	0.22 U	0.055 U	0.27 U	0.35 U	0.55 U	0.055 U	1.4 U	0.33 U	0.27 U	2.2 U	0.19 U	0.22 U	0.055 U	0.82 U	0.055 U
1,1-Dichloroethane	NS	0.4 U	0.2 U	0.4 U	0.81 U	0.081 U	0.081 U	0.16 U	0.16 U	0.040 U	0.20 U	0.26 U	0.40 U	0.04 U	1.00 U	0.24 U	0.20 U	1.6 U	0.14 U	0.16 U	0.040 U	0.61 U	0.040 U
1,1-Dichloroethene	NS	0.4 U	0.2 U	0.4 U	0.79 U	0.079 U	0.079 U	0.16 U	0.16 U	0.040 U	0.20 U	0.26 U	0.40 U	0.04 U	0.99 U	0.24 U	0.20 U	1.6 U	0.14 U	0.16 U	0.040 U	0.59 U	0.040 U
1,2-Dichloroethane	NS	0.4 U	0.2 U	0.81 U	1.6 U	0.16 U	0.16 U	0.32 U	0.32 U	0.081 U	0.40 U	0.53 U	0.81 U	0.08 U	2.00 U	0.49 U	0.40 U	3.3 U	0.28 U	0.32 U	0.081 U	1.2 U	0.081 U
Benzene	NS	0.77	1.1	2.7	3.5	0.35	0.45	1.1	0.73	0.14	0.70	2.0	1.7	1.5	2.8	1.1	0.86	2.3	1.9	1.8	0.96	4.4	0.28
cis-1,2-Dichloroethene	NS	5.2	0.71	2.8	4.8	0.14	0.29	1.5	1.1	0.040 U	0.83	1.5	1.9	0.079	3.8	0.91	1.7	12	0.77	0.16 U	0.074	5.2	0.040 U
Ethylbenzene	NS	0.43 U	0.3	1.7	0.87 U	1.4	0.48	0.48	0.32	0.091	0.48	0.56	0.56	0.43	2.9	0.26 U	0.52	1.7 U	1.1	0.91	0.17 NJ	0.65 U	0.32
Tetrachloroethene	NS	1.8	3.1	3.8	1.4 U	0.24	1.1	1.2	0.56	0.068 U	0.81	0.52	0.68 U	0.095	1.7 U	0.54	0.68	2.7 U	0.26	0.27 U	0.18	1.0 U	0.12
Toluene	NS	3.1	1.5	6	3.3	4.5	2.2	1.9	1.0	1.8	5.7	4.5	4.1	3.1	18	1.5	1.7	6.0	7.2	9.4	2.0	1.0	2.7
trans-1,2-Dichloroethene	NS	0.4 U	0.2 U	0.4 U	0.79 U	0.079 U	0.079 U	0.16 U	0.16 U	0.04 U	0.20 U	0.26 U	0.40 U	0.04 U	0.99 U	0.24 U	0.20 U	1.6 U	0.14 U	0.16 U	0.040 U	0.59 U	0.040 U
Trichloroethene	NS	160	9.1	45	81	2.1	7	20	17	0.081	16	24	29	0.27	86	14	24	120	14	4.5	1.8	67	0.43
Vinyl chloride	NS	0.26 U	0.13 U	0.51 U	1.0 U	0.10 U	0.10 U	0.20 U	0.20 U	0.05 U	0.26 U	0.33 U	0.51 U	0.051 U	1.3 U	0.31 U	0.26 U	2.1 U	0.18 U	0.20 U	0.051 U	0.77 U	0.051 U
m-Xylene & p-Xylene	NS	1	0.74	5.2	2.1	3.7	1.4	1.4	0.91	0.33	1.7	2.1	2.2	1.6	7.8	0.78	1.6	4.8	3.5	3.9	0.53	1.3 U	1.1
o-Xylene	NS	0.43 U	0.27	1.3	0.87 U	0.83	0.32	0.37	0.30	0.10	0.56	0.78	1.1	0.52	2	0.28	0.40	1.7 U	1.1	1.1	0.17	0.65 U	0.39

Notes:
All values are shown in units of micrograms per cubic meter (µg/m³).
U - Not detected above reporting limit shown
J - Estimated by data validator
T - Tentative in identification due to poor mass spectral quality
NS - Not sampled

Table 6
Ambient Air Sample Analytical Data Summary
Former Philips Display Facility - Seneca Falls, New York

Sample Description	AMBIENT AIR OUTSIDE OF BUILDING 2																					
Sample ID	OA-B2-01																					
Date Collected	7/15/03	10/2/03	1/20/04	3/20/07	6/21/07	8/30/07	9/28/07	12/11/07	3/26/08	6/17/08	9/24/08	12/18/08	3/26/09	6/25/09	9/23/09	12/17/09	3/24/10	6/22/10	9/22/10	12/28/10	3/23/11	6/22/11
1,1,1-Trichloroethane	0.21	0.16	0.12	0.15	0.060	NS	0.055 U	0.065	0.055 U	0.060	0.055 U	0.055	0.065	0.11 U	0.065	0.055 U	0.082 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U
1,1,2,2-Tetrachloroethane	0.14 U	0.069 U	0.069 U	0.069 U	0.069 U	NS	0.069 U	0.069 U	0.069 U	0.069 U	0.069 U	0.069 UJ	0.069 U	0.14 U	0.069 U	0.069 U	0.10 U	0.069 U	0.069 U	0.069 U	0.069 U	0.069 U
1,1,2-Trichloroethane	0.10 U	0.055 U	0.055 U	0.055 U	0.055 U	NS	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U	0.11 U	0.055 U	0.055 U	0.082 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U
1,1-Dichloroethane	0.080 U	0.040 U	0.040 U	0.040 U	0.040 U	NS	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.081 U	0.040 U	0.040 U	0.061 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U
1,1-Dichloroethene	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	NS	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.079 U	0.040 U	0.040 U	0.059 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U
1,2-Dichloroethane	0.080 U	0.040 U	0.040 U	0.089	0.081 U	NS	0.081 U	0.085	0.081 U	0.081 U	0.081 U	0.081 U	0.081	0.16 U	0.081 U	0.081 U	0.12 U	0.081 U	0.081 U	0.081 U	0.081 U	0.081 U
Benzene	0.44	0.38	0.45	0.58	0.21	NS	0.32	0.51	0.28	0.24	0.16	0.70	0.08	0.54	0.42	0.42	1.0	0.22	0.58	0.49	0.41	0.28
cis-1,2-Dichloroethene	0.056 U	0.040 U	0.040 U	0.040 U	0.040 U	NS	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.120	0.079 U	0.040 U	0.040 U	0.059 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U
Ethylbenzene	0.35	0.13	0.19	0.043 U	0.087	NS	0.15	0.10	0.078	0.16	0.091	0.22	0.25	0.69	0.48	0.061	0.52	0.069	0.29	0.11	0.084	0.32
Tetrachloroethene	0.30	0.068 U	0.075	0.088	0.068 U	NS	0.11	0.068 U	0.068 U	0.068 U	0.068 U	0.088	0.14	0.14 U	0.075	0.068 U	0.26	0.068	0.077	0.068 U	0.071 U	0.12
Toluene	3.2	0.64	0.90	0.22	0.49	NS	1.0	0.53	0.36	1.7	0.57	1.2	0.98	5.3	1.2	0.35	4.1	0.45	2.4	0.65	0.48	3.3
trans-1,2-Dichloroethene	0.056 U	0.04 U	0.04 U	0.04 U	0.040 U	NS	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.079 U	0.075	0.040 U	0.059 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U
Trichloroethene	0.58	0.52	0.81	2.8	0.70	NS	0.31	0.054 U	0.054 U	0.054 U	0.054 U	0.11	0.086	0.86	0.91	0.054 U	0.081 U	0.075	0.066	0.21	0.054 U	0.066
Vinyl chloride	0.020 U	0.026 U	0.026 U	0.051 U	0.051 U	NS	0.051 U	0.051 U	0.051 U	0.051 U	0.051 U	0.051 U	0.051 U	0.10 U	0.051 U	0.051 U	0.077 U	0.051 U	0.051 U	0.051 U	0.051 U	0.051 U
m-Xylene & p-Xylene	1.1	0.35	0.48	0.087 U	0.23	NS	0.38	0.26	0.20	0.52	0.26	0.69	1.3	1.7	0.74	0.15	1.8	0.11	0.90	0.26 U	0.20	0.96
o-Xylene	0.35	0.13	0.19	0.043 U	0.083	NS	0.13	0.10	0.078	0.20	0.091	0.29	0.65	0.56	0.26	0.056	0.52	0.043 U	0.32	0.10	0.079	0.33

Sample Description	AMBIENT AIR OUTSIDE OF BUILDING 11																					
Sample ID	OA-B11-01																					
Date Collected	7/15/03	10/2/03	1/20/04	3/20/07	6/21/07	8/30/07	9/28/07	12/11/07	3/26/08	6/17/08	9/24/08	12/18/08	3/26/09	6/25/09	9/23/09	12/17/09	3/24/10	6/22/10	9/22/10	12/28/10	3/23/11	6/22/11
1,1,1-Trichloroethane	0.18	0.15	0.11	0.15	0.055 U	0.055 U	0.055	0.065	0.060	0.055 U	0.055 U	0.055 U	0.071	0.071	0.060	0.055 U	0.055 U	0.065	0.055 U	0.055 U	0.055 U	0.055 U
1,1,2,2-Tetrachloroethane	0.14 U	0.069 U	0.069 U	0.069 U	0.069 U	0.069 U	0.069 U	0.069 U	0.069 U	0.069 U	0.069 U	0.069 UJ	0.069 U	0.069 U	0.069 U	0.069 U	0.069 U	0.069 U	0.069 U	0.069 U	0.069 U	0.069 U
1,1,2-Trichloroethane	0.10 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U	0.055 U
1,1-Dichloroethane	0.080 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U
1,1-Dichloroethene	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U
1,2-Dichloroethane	0.080 U	0.040 U	0.040 U	0.081 U	0.081 U	0.081 U	0.081 U	0.085	0.081 U	0.081 U	0.081 U	0.081 U	0.085	0.081 U	0.081 U	0.081 U	0.081 NJ	0.081 U	0.081 U	0.081 U	0.081 U	0.081 U
Benzene	0.32	0.30	0.45	0.54	0.15	0.17	0.29	0.58	0.31	0.13	0.14	0.54	0.67	0.32	0.26	0.38	0.51	0.31	0.42	0.73	0.39	0.20
cis-1,2-Dichloroethene	0.056 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.083	0.040 U	0.040 U	0.040 NJ	0.040 U	0.079	0.040 U	0.14	0.040 U	0.040 U
Ethylbenzene	0.16	0.091	0.15	0.10	0.061	0.091	0.15	0.19	0.065	0.12	0.096	0.18	0.18	0.23	0.14	0.065	0.15	0.16	0.19	0.28	0.061	0.10
Tetrachloroethene	0.14 U	0.068 U	0.068	0.075	0.068 U	0.081	0.12	0.068 U	0.068 U	0.068 U	0.068 U	0.095	0.14	0.088	0.068 U	0.068 U	0.095	0.081	0.068 U	0.33	0.068 U	0.068 U
Toluene	1.4	0.45	0.68	0.38	0.32	0.49	0.60	0.72	0.37	0.75	0.64	1.1	0.94	1.4	0.83	0.35	1.1	0.79	1.1	2.3	0.30	0.55
trans-1,2-Dichloroethene	0.056 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U	0.040 U
Trichloroethene	0.074	0.13	0.12	0.14	0.12	0.12	0.11	0.086	0.054 U	0.086	0.07	0.13	0.075	0.075	0.51	0.11	0.081	0.22	0.077	3.4	0.068	0.054 U
Vinyl chloride	0.020 U	0.026 U	0.026 U	0.051 U	0.051 U	0.051 U	0.051 U	0.051 U	0.051 U	0.051 U	0.051 U	0.051 U	0.051 U	0.051 U	0.051 U	0.051 U	0.051 U	0.051 U	0.051 U	0.051 U	0.051 U	0.051 U
m,p-Xylene	0.32	0.26	0.34	0.29	0.16	0.22	0.43	0.56	0.20	0.38	0.24	0.48	0.41	0.69	0.43	0.18	0.43	0.48	0.46	0.72	0.18	0.30
o-Xylene	0.14	0.10	0.13	0.11	0.052	0.078	0.13	0.21	0.083	0.11	0.083	0.21	0.16	0.23	0.17	0.074	0.16	0.19 J	0.17	0.25	0.077	0.12

Notes:
All values are shown in units of micrograms per cubic meter (µg/m³).
U - Not detected above reporting limit
NS - Not Sampled
J - Estimated
NJ - Tentative in identification and estimated in value due to poor mass spectral quality

Attachment D
Data Validation Report

Data Validation Services

120 Cobble Creek Road P.O. Box 208
North Creek, NY 12853

Phone 518-251-4429
Facsimile 518-251-4428

July 15, 2011

Mark Flusche
ARCADIS Malcolm Pirnie, Inc.
855 Route 146 Suite 210
Clifton Park, NY 12065

RE: Validation of the Former Philips Display Components Facility, Seneca Falls Site Data Package
Indoor Air and Soil Vapor samples- June 2011
TestAmerica-VT SDG No. 220-5677-1

Dear Mr. Flusche:

Review has been completed for the data package generated by TestAmerica Laboratories (TAL-VT) that pertains to air samples collected on 06/22/11 at the Seneca Falls, NY site. Fourteen 6-L summa canister indoor/outdoor air samples, an indoor air field duplicate, and one 6-L summa canister soil gas samples were analyzed for sixteen site-specific volatile analytes using USEPA method TO-15 (for soil gas samples) and low level USEPA method TO-15 (for indoor/outdoor air samples).

Data validation was performed using guidance from the 2006 USEPA Region II validation SOP HW-31, with consideration for the specific requirements of the analytical methodology. The following items were reviewed:

- * Data Completeness
- * Case Narrative
- * Custody Documentation
- * Holding Times
- * Blind Field Duplicate Correlations
- * Internal Standard Recoveries
- * Method and Canister Blanks
- * Laboratory Control Samples (LCSs)
- * Instrumental Tunes
- * Initial and Continuing Calibration Standards
- * Method Compliance
- * Sample Result Verification

Those items showing deficiencies are discussed in the following sections of this report. All others were found to be acceptable as outlined in the above-mentioned validation procedures, and as applicable for the methodology. Unless noted specifically in the following text, reported results are substantiated by the raw data, and generated in compliance with project requirements.

In summary, sample processing was conducted in compliance with project requirements. All sample results are usable either as reported or with minor qualification.

A copy of the laboratory case narrative is attached to this text, and should be reviewed in conjunction with this report. Also attached are the laboratory sample result forms edited to reflect the qualifiers recommended in this report.

Chain-of-Custody/Sample Receipt

The laboratory login form indicates that there were some discrepancies between canister IDs and custody entries. The custody entries were used.

Volatile Analyses by EPA TO-15

The detected results for 1,1,1-trichloroethane in IA-B10A-01, IA-B11-02, IA-DUPE, and IA-B13A-01 are qualified as tentative in identification and estimated in value ("NJ") due to interferences in the mass spectra.

Holding times and instrument tunes meet requirements. Internal standard recoveries are acceptable.

The blind field duplicate correlations for sample IA-B11-02 are acceptable.

Method and canister blanks show no contamination. The clean canister certification raw data documentation were reviewed during validation.


Initial and continuing calibration standard responses were acceptable, with all response factors (RRFs) above 0.05, linearity within the 30%RSD limit, and continuing responses not above 30%D.

Laboratory Control Samples show acceptable recoveries.

Following a laboratory screening, some of the samples were processed at initial dilution due to detected target analyte concentrations. Therefore, reporting limits for the compounds that were not detected are elevated in those samples.

Please do not hesitate to contact me if questions or comments arise during your review of this report.

Very truly yours,

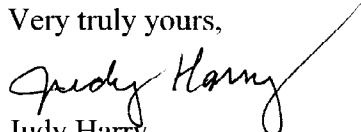

Judy Harry

VALIDATION DATA QUALIFIER DEFINITIONS

- U** The analyte was analyzed for, but was not detected above the level of the associated reported quantitation limit.
- J** The analyte was positively identified; the associated numerical value is an approximate concentration of the analyte in the sample.
- UJ** The analyte was not detected. The associated reported quantitation limit is an estimate and may be inaccurate or imprecise.
- NJ** The detection is tentative in identification and estimated in value. Although there is presumptive evidence of the analyte, the result should be used with caution as a potential false positive and/or elevated quantitative value.
- R** The data are unusable. The analyte may or may not be present.
- EMPC** The results do not meet all criteria for a confirmed identification. The quantitative value represents the Estimated Maximum Possible Concentration of the analyte in the sample.

**CLIENT and LABORATORY SAMPLE IDs
and CASE NARRATIVE**

SAMPLE SUMMARY

Client: Malcolm Pirnie, Inc.

Job Number: 200-5677-1

Sdg Number: 200-5677

Lab Sample ID	Client Sample ID	Client Matrix	Date/Time Sampled	Date/Time Received
200-5677-1	SVSS-B7-01	Air	06/22/2011 1148	06/23/2011 1020
200-5677-2	OA-B2-01	Air	06/22/2011 1528	06/23/2011 1020
200-5677-3	OA-B11-01	Air	06/22/2011 1530	06/23/2011 1020
200-5677-4	IA-B10-01	Air	06/22/2011 1502	06/23/2011 1020
200-5677-5	IA-B10A-01	Air	06/22/2011 1500	06/23/2011 1020
200-5677-6	IA-B11-02	Air	06/22/2011 1508	06/23/2011 1020
200-5677-7	IA-B7-01	Air	06/22/2011 1521	06/23/2011 1020
200-5677-8	IA-B1A-BASE	Air	06/22/2011 1535	06/23/2011 1020
200-5677-9	IA-B1A-01	Air	06/22/2011 1531	06/23/2011 1020
200-5677-10	IA-B11-01	Air	06/22/2011 1540	06/23/2011 1020
200-5677-11	IA-DUPE	Air	06/22/2011 1508	06/23/2011 1020
200-5677-12	IA-B13A-01	Air	06/22/2011 1517	06/23/2011 1020
200-5677-13	IA-B9-CS	Air	06/22/2011 1526	06/23/2011 1020
200-5677-14	IA-B9-01	Air	06/22/2011 1518	06/23/2011 1020
200-5677-15	IA-B9-02	Air	06/22/2011 1522	06/23/2011 1020
200-5677-16	IA-B13-01	Air	06/22/2011 1543	06/23/2011 1020

CASE NARRATIVE

Client: Malcolm Pirnie, Inc.

Project: Seneca Falls

Report Number: 200-5677-1

With the exceptions noted as flags or footnotes, standard analytical protocols were followed in the analysis of the samples and no problems were encountered or anomalies observed. In addition all laboratory quality control samples were within established control limits, with any exceptions noted below. Each sample was analyzed to achieve the lowest possible reporting limit within the constraints of the method. In some cases, due to interference or analytes present at high concentrations, samples were diluted. For diluted samples, the reporting limits are adjusted relative to the dilution required.

Calculations are performed before rounding to avoid round-off errors in calculated results.

All holding times were met and proper preservation noted for the methods performed on these samples, unless otherwise detailed in the individual sections below.

RECEIPT

The samples were received on 06/23/2011; the samples arrived in good condition.

VOLATILE ORGANIC COMPOUNDS

Sample SVSS-B7-01 was analyzed for Volatile Organic Compounds in accordance with EPA Method TO-15. The samples were analyzed on 06/27/2011.

No difficulties were encountered during the VOC analysis.

All quality control parameters were within the acceptance limits.

LOW LEVEL VOLATILE ORGANIC COMPOUNDS

Samples OA-B2-01, OA-B11-01, IA-B10-01, IA-B10A-01, IA-B11-02, IA-B7-01, IA-B1A-BASE, IA-B1A-01, IA-B11-01, IA-DUPE, IA-B13A-01, IA-B9-CS, IA-B9-01, IA-B9-02 and IA-B13-01 were analyzed for Low Level Volatile Organic Compounds in accordance with EPA Method TO-15. The samples were analyzed on 06/29/2011 and 06/30/2011.

Samples IA-B10-01[2X], IA-B7-01[4X], IA-B11-01[3X], IA-B13A-01[2X], IA-B9-CS[10X], IA-B9-01[2X] and IA-B13-01[2X] required dilution prior to analysis. The reporting limits have been adjusted accordingly.

No difficulties were encountered during the Low Level VOC analyses.

All quality control parameters were within the acceptance limits.

QUALIFIED SAMPLE RESULTS FORMS

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 200-5677-1

Sdg Number: 200-5677

Client Sample ID: SVSS-B7-01

Lab Sample ID: 200-5677-1

Date Sampled: 06/22/2011 1148

Client Matrix: Air

Date Received: 06/23/2011 1020

TO-15 Volatile Organic Compounds in Ambient Air

Analysis Method:	TO-15	Analysis Batch:	200-20404	Instrument ID:	C.i
Prep Method:	Summa Canister	Prep Batch:	N/A	Lab File ID:	cjvf006.d
Dilution:	1.0			Initial Weight/Volume:	200 mL
Analysis Date:	06/27/2011 1339			Final Weight/Volume:	200 mL
Prep Date:	06/27/2011 1339			Injection Volume:	200 mL

Analyte	Result (ppb v/v)	Qualifier	MDL	RL
Vinyl chloride	0.20	U	0.029	0.20
1,1-Dichloroethene	0.20	U	0.030	0.20
trans-1,2-Dichloroethene	0.20	U	0.032	0.20
1,1-Dichloroethane	0.20	U	0.035	0.20
cis-1,2-Dichloroethene	0.20	U	0.014	0.20
1,1,1-Trichloroethane	0.20	U	0.035	0.20
Benzene	0.20	U	0.018	0.20
1,2-Dichloroethane	0.20	U	0.031	0.20
Trichloroethene	7.9		0.030	0.20
Toluene	0.44		0.018	0.20
1,1,2-Trichloroethane	0.20	U	0.019	0.20
Tetrachloroethene	0.41		0.011	0.20
Ethylbenzene	0.20	U	0.022	0.20
m-Xylene & p-Xylene	0.61		0.048	0.50
o-Xylene	0.20		0.022	0.20
1,1,2,2-Tetrachloroethane	0.20	U	0.040	0.20

Analyte	Result (ug/m3)	Qualifier	MDL	RL
Vinyl chloride	0.51	U	0.074	0.51
1,1-Dichloroethene	0.79	U	0.12	0.79
trans-1,2-Dichloroethene	0.79	U	0.13	0.79
1,1-Dichloroethane	0.81	U	0.14	0.81
cis-1,2-Dichloroethene	0.79	U	0.056	0.79
1,1,1-Trichloroethane	1.1	U	0.19	1.1
Benzene	0.64	U	0.058	0.64
1,2-Dichloroethane	0.81	U	0.13	0.81
Trichloroethene	43		0.16	1.1
Toluene	1.7		0.068	0.75
1,1,2-Trichloroethane	1.1	U	0.10	1.1
Tetrachloroethene	2.8		0.075	1.4
Ethylbenzene	0.87	U	0.096	0.87
m-Xylene & p-Xylene	2.7		0.21	2.2
o-Xylene	0.85		0.096	0.87
1,1,2,2-Tetrachloroethane	1.4	U	0.27	1.4

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 200-5677-1

Sdg Number: 200-5677

Client Sample ID: OA-B2-01

Lab Sample ID: 200-5677-2

Date Sampled: 06/22/2011 1528

Client Matrix: Air

Date Received: 06/23/2011 1020

TO15 LL Volatile Organic Compounds in Ambient Air, Low Concentration (GC/MS)

Analysis Method:	TO15 LL	Analysis Batch:	200-20568	Instrument ID:	E.i
Prep Method:	Summa Canister	Prep Batch:	N/A	Lab File ID:	eelc007.d
Dilution:	1.0			Initial Weight/Volume:	500 mL
Analysis Date:	06/29/2011 1411			Final Weight/Volume:	500 mL
Prep Date:	06/29/2011 1411			Injection Volume:	500 mL

Analyte	Result (ppb v/v)	Qualifier	MDL	RL
Vinyl chloride	0.020	U	0.020	0.020
1,1-Dichloroethene	0.010	U	0.010	0.010
trans-1,2-Dichloroethene	0.010	U	0.010	0.010
1,1-Dichloroethane	0.010	U	0.010	0.010
cis-1,2-Dichloroethene	0.010	U	0.010	0.010
1,1,1-Trichloroethane	0.010	U	0.010	0.010
Benzene	0.088		0.010	0.010
1,2-Dichloroethane	0.020	U	0.020	0.020
Trichloroethene	0.012		0.010	0.010
Toluene	0.88		0.010	0.010
1,1,2-Trichloroethane	0.010	U	0.010	0.010
Tetrachloroethene	0.018		0.010	0.010
Ethylbenzene	0.074		0.010	0.010
o-Xylene	0.075		0.010	0.010
1,1,2,2-Tetrachloroethane	0.010	U	0.010	0.010
m-Xylene & p-Xylene	0.22		0.020	0.020

Analyte	Result (ug/m3)	Qualifier	MDL	RL
Vinyl chloride	0.051	U	0.051	0.051
1,1-Dichloroethene	0.040	U	0.040	0.040
trans-1,2-Dichloroethene	0.040	U	0.040	0.040
1,1-Dichloroethane	0.040	U	0.040	0.040
cis-1,2-Dichloroethene	0.040	U	0.040	0.040
1,1,1-Trichloroethane	0.055	U	0.055	0.055
Benzene	0.28		0.032	0.032
1,2-Dichloroethane	0.081	U	0.081	0.081
Trichloroethene	0.066		0.054	0.054
Toluene	3.3		0.038	0.038
1,1,2-Trichloroethane	0.055	U	0.055	0.055
Tetrachloroethene	0.12		0.068	0.068
Ethylbenzene	0.32		0.043	0.043
o-Xylene	0.33		0.043	0.043
1,1,2,2-Tetrachloroethane	0.069	U	0.069	0.069
m-Xylene & p-Xylene	0.96		0.087	0.087

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 200-5677-1

Sdg Number: 200-5677

Client Sample ID: OA-B11-01

Lab Sample ID: 200-5677-3

Date Sampled: 06/22/2011 1530

Client Matrix: Air

Date Received: 06/23/2011 1020

TO15 LL Volatile Organic Compounds in Ambient Air, Low Concentration (GC/MS)

Analysis Method:	TO15 LL	Analysis Batch:	200-20568	Instrument ID:	E.i
Prep Method:	Summa Canister	Prep Batch:	N/A	Lab File ID:	eelc008.d
Dilution:	1.0			Initial Weight/Volume:	500 mL
Analysis Date:	06/29/2011 1505			Final Weight/Volume:	500 mL
Prep Date:	06/29/2011 1505			Injection Volume:	500 mL

Analyte	Result (ppb v/v)	Qualifier	MDL	RL
Vinyl chloride	0.020	U	0.020	0.020
1,1-Dichloroethene	0.010	U	0.010	0.010
trans-1,2-Dichloroethene	0.010	U	0.010	0.010
1,1-Dichloroethane	0.010	U	0.010	0.010
cis-1,2-Dichloroethene	0.010	U	0.010	0.010
1,1,1-Trichloroethane	0.010	U	0.010	0.010
Benzene	0.064		0.010	0.010
1,2-Dichloroethane	0.020	U	0.020	0.020
Trichloroethene	0.010	U	0.010	0.010
Toluene	0.15		0.010	0.010
1,1,2-Trichloroethane	0.010	U	0.010	0.010
Tetrachloroethene	0.010	U	0.010	0.010
Ethylbenzene	0.024		0.010	0.010
o-Xylene	0.027		0.010	0.010
1,1,2,2-Tetrachloroethane	0.010	U	0.010	0.010
m-Xylene & p-Xylene	0.070		0.020	0.020

Analyte	Result (ug/m3)	Qualifier	MDL	RL
Vinyl chloride	0.051	U	0.051	0.051
1,1-Dichloroethene	0.040	U	0.040	0.040
trans-1,2-Dichloroethene	0.040	U	0.040	0.040
1,1-Dichloroethane	0.040	U	0.040	0.040
cis-1,2-Dichloroethene	0.040	U	0.040	0.040
1,1,1-Trichloroethane	0.055	U	0.055	0.055
Benzene	0.20		0.032	0.032
1,2-Dichloroethane	0.081	U	0.081	0.081
Trichloroethene	0.054	U	0.054	0.054
Toluene	0.55		0.038	0.038
1,1,2-Trichloroethane	0.055	U	0.055	0.055
Tetrachloroethene	0.068	U	0.068	0.068
Ethylbenzene	0.10		0.043	0.043
o-Xylene	0.12		0.043	0.043
1,1,2,2-Tetrachloroethane	0.069	U	0.069	0.069
m-Xylene & p-Xylene	0.30		0.087	0.087

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 200-5677-1

Sdg Number: 200-5677

Client Sample ID: IA-B10-01

Lab Sample ID: 200-5677-4

Date Sampled: 06/22/2011 1502

Client Matrix: Air

Date Received: 06/23/2011 1020

TO15 LL Volatile Organic Compounds in Ambient Air, Low Concentration (GC/MS)

Analysis Method:	TO15 LL	Analysis Batch:	200-20568	Instrument ID:	E.i
Prep Method:	Summa Canister	Prep Batch:	N/A	Lab File ID:	celc024.d
Dilution:	2.0			Initial Weight/Volume:	250 mL
Analysis Date:	06/30/2011 0822			Final Weight/Volume:	500 mL
Prep Date:	06/30/2011 0822			Injection Volume:	500 mL

Analyte	Result (ppb v/v)	Qualifier	MDL	RL
Vinyl chloride	0.040	U	0.040	0.040
1,1-Dichloroethene	0.020	U	0.020	0.020
trans-1,2-Dichloroethene	0.020	U	0.020	0.020
1,1-Dichloroethane	0.020	U	0.020	0.020
cis-1,2-Dichloroethene	0.079		0.020	0.020
1,1,1-Trichloroethane	0.020	U	0.020	0.020
Benzene	0.41		0.020	0.020
1,2-Dichloroethane	0.040	U	0.040	0.040
Trichloroethene	0.11		0.020	0.020
Toluene	1.0		0.020	0.020
1,1,2-Trichloroethane	0.020	U	0.020	0.020
Tetrachloroethene	0.12		0.020	0.020
Ethylbenzene	0.17		0.020	0.020
o-Xylene	0.19		0.020	0.020
1,1,2,2-Tetrachloroethane	0.020	U	0.020	0.020
m-Xylene & p-Xylene	0.56		0.040	0.040

Analyte	Result (ug/m3)	Qualifier	MDL	RL
Vinyl chloride	0.10	U	0.10	0.10
1,1-Dichloroethene	0.079	U	0.079	0.079
trans-1,2-Dichloroethene	0.079	U	0.079	0.079
1,1-Dichloroethane	0.081	U	0.081	0.081
cis-1,2-Dichloroethene	0.31		0.079	0.079
1,1,1-Trichloroethane	0.11	U	0.11	0.11
Benzene	1.3		0.064	0.064
1,2-Dichloroethane	0.16	U	0.16	0.16
Trichloroethene	0.61		0.11	0.11
Toluene	3.8		0.075	0.075
1,1,2-Trichloroethane	0.11	U	0.11	0.11
Tetrachloroethene	0.79		0.14	0.14
Ethylbenzene	0.74		0.087	0.087
o-Xylene	0.84		0.087	0.087
1,1,2,2-Tetrachloroethane	0.14	U	0.14	0.14
m-Xylene & p-Xylene	2.4		0.17	0.17

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 200-5677-1

Sdg Number: 200-5677

Client Sample ID: IA-B10A-01

Lab Sample ID: 200-5677-5

Client Matrix: Air

Date Sampled: 06/22/2011 1500

Date Received: 06/23/2011 1020

TO15 LL Volatile Organic Compounds in Ambient Air, Low Concentration (GC/MS)

Analysis Method:	TO15 LL	Analysis Batch:	200-20568	Instrument ID:	E.i
Prep Method:	Summa Canister	Prep Batch:	N/A	Lab File ID:	eelc010.d
Dilution:	1.0			Initial Weight/Volume:	500 mL
Analysis Date:	06/29/2011 1652			Final Weight/Volume:	500 mL
Prep Date:	06/29/2011 1652			Injection Volume:	500 mL

Analyte	Result (ppb v/v)	Qualifier	MDL	RL
Vinyl chloride	0.020	U	0.020	0.020
1,1-Dichloroethene	0.010	U	0.010	0.010
trans-1,2-Dichloroethene	0.010	U	0.010	0.010
1,1-Dichloroethane	0.010	U	0.010	0.010
cis-1,2-Dichloroethene	0.13		0.010	0.010
1,1,1-Trichloroethane	0.026	NJ	0.010	0.010
Benzene	0.59		0.010	0.010
1,2-Dichloroethane	0.020	U	0.020	0.020
Trichloroethene	0.17		0.010	0.010
Toluene	0.59		0.010	0.010
1,1,2-Trichloroethane	0.010	U	0.010	0.010
Tetrachloroethene	0.17		0.010	0.010
Ethylbenzene	0.17		0.010	0.010
o-Xylene	0.21		0.010	0.010
1,1,2,2-Tetrachloroethane	0.010	U	0.010	0.010
m-Xylene & p-Xylene	0.59		0.020	0.020

Analyte	Result (ug/m3)	Qualifier	MDL	RL
Vinyl chloride	0.051	U	0.051	0.051
1,1-Dichloroethene	0.040	U	0.040	0.040
trans-1,2-Dichloroethene	0.040	U	0.040	0.040
1,1-Dichloroethane	0.040	U	0.040	0.040
cis-1,2-Dichloroethene	0.51		0.040	0.040
1,1,1-Trichloroethane	0.14	NJ	0.055	0.055
Benzene	1.9		0.032	0.032
1,2-Dichloroethane	0.081	U	0.081	0.081
Trichloroethene	0.91		0.054	0.054
Toluene	2.2		0.038	0.038
1,1,2-Trichloroethane	0.055	U	0.055	0.055
Tetrachloroethene	1.2		0.068	0.068
Ethylbenzene	0.75		0.043	0.043
o-Xylene	0.93		0.043	0.043
1,1,2,2-Tetrachloroethane	0.069	U	0.069	0.069
m-Xylene & p-Xylene	2.6		0.087	0.087

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 200-5677-1

Sdg Number: 200-5677

Client Sample ID: IA-B11-02

Lab Sample ID: 200-5677-6

Date Sampled: 06/22/2011 1508

Client Matrix: Air

Date Received: 06/23/2011 1020

TO15 LL Volatile Organic Compounds in Ambient Air, Low Concentration (GC/MS)

Analysis Method:	TO15 LL	Analysis Batch:	200-20568	Instrument ID:	E.i
Prep Method:	Summa Canister	Prep Batch:	N/A	Lab File ID:	eelc011.d
Dilution:	1.0			Initial Weight/Volume:	500 mL
Analysis Date:	06/29/2011 1746			Final Weight/Volume:	500 mL
Prep Date:	06/29/2011 1746			Injection Volume:	500 mL

Analyte	Result (ppb v/v)	Qualifier	MDL	RL
Vinyl chloride	0.020	U	0.020	0.020
1,1-Dichloroethene	0.010	U	0.010	0.010
trans-1,2-Dichloroethene	0.010	U	0.010	0.010
1,1-Dichloroethane	0.010	U	0.010	0.010
cis-1,2-Dichloroethene	0.095		0.010	0.010
1,1,1-Trichloroethane	0.014	NJ	0.010	0.010
Benzene	0.25		0.010	0.010
1,2-Dichloroethane	0.020	U	0.020	0.020
Trichloroethene	0.16		0.010	0.010
Toluene	0.73		0.010	0.010
1,1,2-Trichloroethane	0.010	U	0.010	0.010
Tetrachloroethene	0.19		0.010	0.010
Ethylbenzene	0.38		0.010	0.010
o-Xylene	0.51		0.010	0.010
1,1,2,2-Tetrachloroethane	0.010	U	0.010	0.010
m-Xylene & p-Xylene	1.4		0.020	0.020

Analyte	Result (ug/m3)	Qualifier	MDL	RL
Vinyl chloride	0.051	U	0.051	0.051
1,1-Dichloroethene	0.040	U	0.040	0.040
trans-1,2-Dichloroethene	0.040	U	0.040	0.040
1,1-Dichloroethane	0.040	U	0.040	0.040
cis-1,2-Dichloroethene	0.38		0.040	0.040
1,1,1-Trichloroethane	0.079	NJ	0.055	0.055
Benzene	0.80		0.032	0.032
1,2-Dichloroethane	0.081	U	0.081	0.081
Trichloroethene	0.86		0.054	0.054
Toluene	2.7		0.038	0.038
1,1,2-Trichloroethane	0.055	U	0.055	0.055
Tetrachloroethene	1.3		0.068	0.068
Ethylbenzene	1.7		0.043	0.043
o-Xylene	2.2		0.043	0.043
1,1,2,2-Tetrachloroethane	0.069	U	0.069	0.069
m-Xylene & p-Xylene	6.0		0.087	0.087

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 200-5677-1

Sdg Number: 200-5677

Client Sample ID: IA-B7-01

Lab Sample ID: 200-5677-7

Date Sampled: 06/22/2011 1521

Client Matrix: Air

Date Received: 06/23/2011 1020

TO15 LL Volatile Organic Compounds in Ambient Air, Low Concentration (GC/MS)

Analysis Method:	TO15 LL	Analysis Batch:	200-20568	Instrument ID:	E.i
Prep Method:	Summa Canister	Prep Batch:	N/A	Lab File ID:	eelc012.d
Dilution:	4.0			Initial Weight/Volume:	125 mL
Analysis Date:	06/29/2011 1840			Final Weight/Volume:	500 mL
Prep Date:	06/29/2011 1840			Injection Volume:	500 mL

Analyte	Result (ppb v/v)	Qualifier	MDL	RL
Vinyl chloride	0.080	U	0.080	0.080
1,1-Dichloroethene	0.040	U	0.040	0.040
trans-1,2-Dichloroethene	0.040	U	0.040	0.040
1,1-Dichloroethane	0.040	U	0.040	0.040
cis-1,2-Dichloroethene	0.040	U	0.040	0.040
1,1,1-Trichloroethane	0.040	U	0.040	0.040
Benzene	0.36		0.040	0.040
1,2-Dichloroethane	0.080	U	0.080	0.080
Trichloroethene	0.19		0.040	0.040
Toluene	2.6		0.040	0.040
1,1,2-Trichloroethane	0.040	U	0.040	0.040
Tetrachloroethene	0.044		0.040	0.040
Ethylbenzene	0.35		0.040	0.040
o-Xylene	0.46		0.040	0.040
1,1,2,2-Tetrachloroethane	0.040	U	0.040	0.040
m-Xylene & p-Xylene	1.2		0.080	0.080

Analyte	Result (ug/m3)	Qualifier	MDL	RL
Vinyl chloride	0.20	U	0.20	0.20
1,1-Dichloroethene	0.16	U	0.16	0.16
trans-1,2-Dichloroethene	0.16	U	0.16	0.16
1,1-Dichloroethane	0.16	U	0.16	0.16
cis-1,2-Dichloroethene	0.16	U	0.16	0.16
1,1,1-Trichloroethane	0.22	U	0.22	0.22
Benzene	1.1		0.13	0.13
1,2-Dichloroethane	0.32	U	0.32	0.32
Trichloroethene	1.0		0.21	0.21
Toluene	9.9		0.15	0.15
1,1,2-Trichloroethane	0.22	U	0.22	0.22
Tetrachloroethene	0.30		0.27	0.27
Ethylbenzene	1.5		0.17	0.17
o-Xylene	2.0		0.17	0.17
1,1,2,2-Tetrachloroethane	0.27	U	0.27	0.27
m-Xylene & p-Xylene	5.3		0.35	0.35

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 200-5677-1

Sdg Number: 200-5677

Client Sample ID: IA-B1A-BASE

Lab Sample ID: 200-5677-8

Date Sampled: 06/22/2011 1535

Client Matrix: Air

Date Received: 06/23/2011 1020

TO15 LL Volatile Organic Compounds in Ambient Air, Low Concentration (GC/MS)

Analysis Method:	TO15 LL	Analysis Batch:	200-20568	Instrument ID:	E.i
Prep Method:	Summa Canister	Prep Batch:	N/A	Lab File ID:	eelc013.d
Dilution:	1.0			Initial Weight/Volume:	500 mL
Analysis Date:	06/29/2011 1934			Final Weight/Volume:	500 mL
Prep Date:	06/29/2011 1934			Injection Volume:	500 mL

Analyte	Result (ppb v/v)	Qualifier	MDL	RL
Vinyl chloride	0.020	U	0.020	0.020
1,1-Dichloroethene	0.010	U	0.010	0.010
trans-1,2-Dichloroethene	0.010	U	0.010	0.010
1,1-Dichloroethane	0.010	U	0.010	0.010
cis-1,2-Dichloroethene	0.010	U	0.010	0.010
1,1,1-Trichloroethane	0.010	U	0.010	0.010
Benzene	0.089		0.010	0.010
1,2-Dichloroethane	0.020	U	0.020	0.020
Trichloroethene	0.080		0.010	0.010
Toluene	0.73		0.010	0.010
1,1,2-Trichloroethane	0.010	U	0.010	0.010
Tetrachloroethene	0.018		0.010	0.010
Ethylbenzene	0.073		0.010	0.010
o-Xylene	0.089		0.010	0.010
1,1,2,2-Tetrachloroethane	0.010	U	0.010	0.010
m-Xylene & p-Xylene	0.26		0.020	0.020

Analyte	Result (ug/m3)	Qualifier	MDL	RL
Vinyl chloride	0.051	U	0.051	0.051
1,1-Dichloroethene	0.040	U	0.040	0.040
trans-1,2-Dichloroethene	0.040	U	0.040	0.040
1,1-Dichloroethane	0.040	U	0.040	0.040
cis-1,2-Dichloroethene	0.040	U	0.040	0.040
1,1,1-Trichloroethane	0.055	U	0.055	0.055
Benzene	0.28		0.032	0.032
1,2-Dichloroethane	0.081	U	0.081	0.081
Trichloroethene	0.43		0.054	0.054
Toluene	2.7		0.038	0.038
1,1,2-Trichloroethane	0.055	U	0.055	0.055
Tetrachloroethene	0.12		0.068	0.068
Ethylbenzene	0.32		0.043	0.043
o-Xylene	0.39		0.043	0.043
1,1,2,2-Tetrachloroethane	0.069	U	0.069	0.069
m-Xylene & p-Xylene	1.1		0.087	0.087

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 200-5677-1

Sdg Number: 200-5677

Client Sample ID: IA-B1A-01

Lab Sample ID: 200-5677-9

Date Sampled: 06/22/2011 1531

Client Matrix: Air

Date Received: 06/23/2011 1020

TO15 LL Volatile Organic Compounds in Ambient Air, Low Concentration (GC/MS)

Analysis Method:	TO15 LL	Analysis Batch:	200-20697	Instrument ID:	E.i
Prep Method:	Summa Canister	Prep Batch:	N/A	Lab File ID:	eeld005.d
Dilution:	1.0			Initial Weight/Volume:	500 mL
Analysis Date:	06/30/2011 1407			Final Weight/Volume:	500 mL
Prep Date:	06/30/2011 1407			Injection Volume:	500 mL

Analyte	Result (ppb v/v)	Qualifier	MDL	RL
Vinyl chloride	0.020	U	0.020	0.020
1,1-Dichloroethene	0.010	U	0.010	0.010
trans-1,2-Dichloroethene	0.010	U	0.010	0.010
1,1-Dichloroethane	0.010	U	0.010	0.010
cis-1,2-Dichloroethene	0.010	U	0.010	0.010
1,1,1-Trichloroethane	0.010	U	0.010	0.010
Benzene	0.11		0.010	0.010
1,2-Dichloroethane	0.020	U	0.020	0.020
Trichloroethene	0.049		0.010	0.010
Toluene	0.92		0.010	0.010
1,1,2-Trichloroethane	0.010	U	0.010	0.010
Tetrachloroethene	0.016		0.010	0.010
Ethylbenzene	0.11		0.010	0.010
o-Xylene	0.11		0.010	0.010
1,1,2,2-Tetrachloroethane	0.010	U	0.010	0.010
m-Xylene & p-Xylene	0.31		0.020	0.020

Analyte	Result (ug/m3)	Qualifier	MDL	RL
Vinyl chloride	0.051	U	0.051	0.051
1,1-Dichloroethene	0.040	U	0.040	0.040
trans-1,2-Dichloroethene	0.040	U	0.040	0.040
1,1-Dichloroethane	0.040	U	0.040	0.040
cis-1,2-Dichloroethene	0.040	U	0.040	0.040
1,1,1-Trichloroethane	0.055	U	0.055	0.055
Benzene	0.35		0.032	0.032
1,2-Dichloroethane	0.081	U	0.081	0.081
Trichloroethene	0.26		0.054	0.054
Toluene	3.5		0.038	0.038
1,1,2-Trichloroethane	0.055	U	0.055	0.055
Tetrachloroethene	0.11		0.068	0.068
Ethylbenzene	0.48		0.043	0.043
o-Xylene	0.47		0.043	0.043
1,1,2,2-Tetrachloroethane	0.069	U	0.069	0.069
m-Xylene & p-Xylene	1.3		0.087	0.087

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 200-5677-1

Sdg Number: 200-5677

Client Sample ID: IA-B11-01

Lab Sample ID: 200-5677-10

Date Sampled: 06/22/2011 1540

Client Matrix: Air

Date Received: 06/23/2011 1020

TO15 LL Volatile Organic Compounds in Ambient Air, Low Concentration (GC/MS)

Analysis Method:	TO15 LL	Analysis Batch:	200-20568	Instrument ID:	E.i
Prep Method:	Summa Canister	Prep Batch:	N/A	Lab File ID:	eelc022.d
Dilution:	2.8			Initial Weight/Volume:	180 mL
Analysis Date:	06/30/2011 0339			Final Weight/Volume:	500 mL
Prep Date:	06/30/2011 0339			Injection Volume:	500 mL

Analyte	Result (ppb v/v)	Qualifier	MDL	RL
Vinyl chloride	0.056	U	0.056	0.056
1,1-Dichloroethene	0.028	U	0.028	0.028
trans-1,2-Dichloroethene	0.028	U	0.028	0.028
1,1-Dichloroethane	0.028	U	0.028	0.028
cis-1,2-Dichloroethene	0.12		0.028	0.028
1,1,1-Trichloroethane	0.028	U	0.028	0.028
Benzene	0.31		0.028	0.028
1,2-Dichloroethane	0.056	U	0.056	0.056
Trichloroethene	0.18		0.028	0.028
Toluene	1.2		0.028	0.028
1,1,2-Trichloroethane	0.028	U	0.028	0.028
Tetrachloroethene	0.23		0.028	0.028
Ethylbenzene	0.35		0.028	0.028
o-Xylene	0.53		0.028	0.028
1,1,2,2-Tetrachloroethane	0.028	U	0.028	0.028
m-Xylene & p-Xylene	1.4		0.056	0.056

Analyte	Result (ug/m3)	Qualifier	MDL	RL
Vinyl chloride	0.14	U	0.14	0.14
1,1-Dichloroethene	0.11	U	0.11	0.11
trans-1,2-Dichloroethene	0.11	U	0.11	0.11
1,1-Dichloroethane	0.11	U	0.11	0.11
cis-1,2-Dichloroethene	0.47		0.11	0.11
1,1,1-Trichloroethane	0.15	U	0.15	0.15
Benzene	0.99		0.089	0.089
1,2-Dichloroethane	0.23	U	0.23	0.23
Trichloroethene	0.98		0.15	0.15
Toluene	4.5		0.11	0.11
1,1,2-Trichloroethane	0.15	U	0.15	0.15
Tetrachloroethene	1.6		0.19	0.19
Ethylbenzene	1.5		0.12	0.12
o-Xylene	2.3		0.12	0.12
1,1,2,2-Tetrachloroethane	0.19	U	0.19	0.19
m-Xylene & p-Xylene	5.9		0.24	0.24

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 200-5677-1

Sdg Number: 200-5677

Client Sample ID: IA-DUPE

Lab Sample ID: 200-5677-11

Date Sampled: 06/22/2011 1508

Client Matrix: Air

Date Received: 06/23/2011 1020

TO15 LL Volatile Organic Compounds in Ambient Air, Low Concentration (GC/MS)

Analysis Method:	TO15 LL	Analysis Batch:	200-20568	Instrument ID:	E.i
Prep Method:	Summa Canister	Prep Batch:	N/A	Lab File ID:	eelc016.d
Dilution:	1.11			Initial Weight/Volume:	450 mL
Analysis Date:	06/29/2011 2214			Final Weight/Volume:	500 mL
Prep Date:	06/29/2011 2214			Injection Volume:	500 mL

Analyte	Result (ppb v/v)	Qualifier	MDL	RL
Vinyl chloride	0.022	U	0.022	0.022
1,1-Dichloroethene	0.011	U	0.011	0.011
trans-1,2-Dichloroethene	0.011	U	0.011	0.011
1,1-Dichloroethane	0.011	U	0.011	0.011
cis-1,2-Dichloroethene	0.092		0.011	0.011
1,1,1-Trichloroethane	0.013	NJ	0.011	0.011
Benzene	0.25		0.011	0.011
1,2-Dichloroethane	0.022	U	0.022	0.022
Trichloroethene	0.16		0.011	0.011
Toluene	0.57		0.011	0.011
1,1,2-Trichloroethane	0.011	U	0.011	0.011
Tetrachloroethene	0.17		0.011	0.011
Ethylbenzene	0.39		0.011	0.011
o-Xylene	0.64		0.011	0.011
1,1,2,2-Tetrachloroethane	0.011	U	0.011	0.011
m-Xylene & p-Xylene	1.6		0.022	0.022

Analyte	Result (ug/m3)	Qualifier	MDL	RL
Vinyl chloride	0.057	U	0.057	0.057
1,1-Dichloroethene	0.044	U	0.044	0.044
trans-1,2-Dichloroethene	0.044	U	0.044	0.044
1,1-Dichloroethane	0.045	U	0.045	0.045
cis-1,2-Dichloroethene	0.36		0.044	0.044
1,1,1-Trichloroethane	0.072	NJ	0.061	0.061
Benzene	0.81		0.035	0.035
1,2-Dichloroethane	0.090	U	0.090	0.090
Trichloroethene	0.87		0.060	0.060
Toluene	2.1		0.042	0.042
1,1,2-Trichloroethane	0.061	U	0.061	0.061
Tetrachloroethene	1.2		0.075	0.075
Ethylbenzene	1.7		0.048	0.048
o-Xylene	2.8		0.048	0.048
1,1,2,2-Tetrachloroethane	0.076	U	0.076	0.076
m-Xylene & p-Xylene	6.9		0.096	0.096

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 200-5677-1

Sdg Number: 200-5677

Client Sample ID: IA-B13A-01

Lab Sample ID: 200-5677-12

Date Sampled: 06/22/2011 1517

Client Matrix: Air

Date Received: 06/23/2011 1020

TO15 LL Volatile Organic Compounds in Ambient Air, Low Concentration (GC/MS)

Analysis Method:	TO15 LL	Analysis Batch:	200-20697	Instrument ID:	E.i
Prep Method:	Summa Canister	Prep Batch:	N/A	Lab File ID:	eeld006.d
Dilution:	2.0			Initial Weight/Volume:	250 mL
Analysis Date:	06/30/2011 1501			Final Weight/Volume:	500 mL
Prep Date:	06/30/2011 1501			Injection Volume:	500 mL

Analyte	Result (ppb v/v)	Qualifier	MDL	RL
Vinyl chloride	0.040	U	0.040	0.040
1,1-Dichloroethene	0.020	U	0.020	0.020
trans-1,2-Dichloroethene	0.020	U	0.020	0.020
1,1-Dichloroethane	0.020	U	0.020	0.020
cis-1,2-Dichloroethene	0.10	NJ	0.020	0.020
1,1,1-Trichloroethane	0.061		0.020	0.020
Benzene	0.45		0.020	0.020
1,2-Dichloroethane	0.040	U	0.040	0.040
Trichloroethene	0.44		0.020	0.020
Toluene	0.79		0.020	0.020
1,1,2-Trichloroethane	0.020	U	0.020	0.020
Tetrachloroethene	0.43		0.020	0.020
Ethylbenzene	0.42		0.020	0.020
o-Xylene	0.51		0.020	0.020
1,1,2,2-Tetrachloroethane	0.020	U	0.020	0.020
m-Xylene & p-Xylene	1.6		0.040	0.040

Analyte	Result (ug/m3)	Qualifier	MDL	RL
Vinyl chloride	0.10	U	0.10	0.10
1,1-Dichloroethene	0.079	U	0.079	0.079
trans-1,2-Dichloroethene	0.079	U	0.079	0.079
1,1-Dichloroethane	0.081	U	0.081	0.081
cis-1,2-Dichloroethene	0.40	NJ	0.079	0.079
1,1,1-Trichloroethane	0.33		0.11	0.11
Benzene	1.5		0.064	0.064
1,2-Dichloroethane	0.16	U	0.16	0.16
Trichloroethene	2.4		0.11	0.11
Toluene	3.0		0.075	0.075
1,1,2-Trichloroethane	0.11	U	0.11	0.11
Tetrachloroethene	2.9		0.14	0.14
Ethylbenzene	1.8		0.087	0.087
o-Xylene	2.2		0.087	0.087
1,1,2,2-Tetrachloroethane	0.14	U	0.14	0.14
m-Xylene & p-Xylene	6.8		0.17	0.17

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 200-5677-1

Sdg Number: 200-5677

Client Sample ID: IA-B9-CS

Lab Sample ID: 200-5677-13

Date Sampled: 06/22/2011 1526

Client Matrix: Air

Date Received: 06/23/2011 1020

TO15 LL Volatile Organic Compounds in Ambient Air, Low Concentration (GC/MS)

Analysis Method:	TO15 LL	Analysis Batch:	200-20568	Instrument ID:	E.i
Prep Method:	Summa Canister	Prep Batch:	N/A	Lab File ID:	eelc018.d
Dilution:	10			Initial Weight/Volume:	50 mL
Analysis Date:	06/30/2011 0002			Final Weight/Volume:	500 mL
Prep Date:	06/30/2011 0002			Injection Volume:	500 mL

Analyte	Result (ppb v/v)	Qualifier	MDL	RL
Vinyl chloride	0.20	U	0.20	0.20
1,1-Dichloroethene	0.10	U	0.10	0.10
trans-1,2-Dichloroethene	0.10	U	0.10	0.10
1,1-Dichloroethane	0.10	U	0.10	0.10
cis-1,2-Dichloroethene	0.11		0.10	0.10
1,1,1-Trichloroethane	0.10	U	0.10	0.10
Benzene	0.12		0.10	0.10
1,2-Dichloroethane	0.20	U	0.20	0.20
Trichloroethene	9.0		0.10	0.10
Toluene	1.2		0.10	0.10
1,1,2-Trichloroethane	0.10	U	0.10	0.10
Tetrachloroethene	0.10	U	0.10	0.10
Ethylbenzene	0.12		0.10	0.10
o-Xylene	0.12		0.10	0.10
1,1,2,2-Tetrachloroethane	0.10	U	0.10	0.10
m-Xylene & p-Xylene	0.33		0.20	0.20

Analyte	Result (ug/m3)	Qualifier	MDL	RL
Vinyl chloride	0.51	U	0.51	0.51
1,1-Dichloroethene	0.40	U	0.40	0.40
trans-1,2-Dichloroethene	0.40	U	0.40	0.40
1,1-Dichloroethane	0.40	U	0.40	0.40
cis-1,2-Dichloroethene	0.42		0.40	0.40
1,1,1-Trichloroethane	0.55	U	0.55	0.55
Benzene	0.39		0.32	0.32
1,2-Dichloroethane	0.81	U	0.81	0.81
Trichloroethene	48		0.54	0.54
Toluene	4.6		0.38	0.38
1,1,2-Trichloroethane	0.55	U	0.55	0.55
Tetrachloroethene	0.68	U	0.68	0.68
Ethylbenzene	0.52		0.43	0.43
o-Xylene	0.50		0.43	0.43
1,1,2,2-Tetrachloroethane	0.69	U	0.69	0.69
m-Xylene & p-Xylene	1.4		0.87	0.87

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 200-5677-1

Sdg Number: 200-5677

Client Sample ID: IA-B9-01

Lab Sample ID: 200-5677-14

Date Sampled: 06/22/2011 1518

Client Matrix: Air

Date Received: 06/23/2011 1020

TO15 LL Volatile Organic Compounds in Ambient Air, Low Concentration (GC/MS)

Analysis Method:	TO15 LL	Analysis Batch:	200-20697	Instrument ID:	E.i
Prep Method:	Summa Canister	Prep Batch:	N/A	Lab File ID:	eeld007.d
Dilution:	2.0			Initial Weight/Volume:	250 mL
Analysis Date:	06/30/2011 1555			Final Weight/Volume:	500 mL
Prep Date:	06/30/2011 1555			Injection Volume:	500 mL

Analyte	Result (ppb v/v)	Qualifier	MDL	RL
Vinyl chloride	0.040	U	0.040	0.040
1,1-Dichloroethene	0.020	U	0.020	0.020
trans-1,2-Dichloroethene	0.020	U	0.020	0.020
1,1-Dichloroethane	0.020	U	0.020	0.020
cis-1,2-Dichloroethene	0.020		0.020	0.020
1,1,1-Trichloroethane	0.020	U	0.020	0.020
Benzene	0.14		0.020	0.020
1,2-Dichloroethane	0.040	U	0.040	0.040
Trichloroethene	0.39		0.020	0.020
Toluene	0.93		0.020	0.020
1,1,2-Trichloroethane	0.020	U	0.020	0.020
Tetrachloroethene	0.026		0.020	0.020
Ethylbenzene	0.12		0.020	0.020
o-Xylene	0.15		0.020	0.020
1,1,2,2-Tetrachloroethane	0.020	U	0.020	0.020
m-Xylene & p-Xylene	0.38		0.040	0.040

Analyte	Result (ug/m3)	Qualifier	MDL	RL
Vinyl chloride	0.10	U	0.10	0.10
1,1-Dichloroethene	0.079	U	0.079	0.079
trans-1,2-Dichloroethene	0.079	U	0.079	0.079
1,1-Dichloroethane	0.081	U	0.081	0.081
cis-1,2-Dichloroethene	0.078		0.079	0.079
1,1,1-Trichloroethane	0.11	U	0.11	0.11
Benzene	0.43		0.064	0.064
1,2-Dichloroethane	0.16	U	0.16	0.16
Trichloroethene	2.1		0.11	0.11
Toluene	3.5		0.075	0.075
1,1,2-Trichloroethane	0.11	U	0.11	0.11
Tetrachloroethene	0.18		0.14	0.14
Ethylbenzene	0.54		0.087	0.087
o-Xylene	0.65		0.087	0.087
1,1,2,2-Tetrachloroethane	0.14	U	0.14	0.14
m-Xylene & p-Xylene	1.6		0.17	0.17

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 200-5677-1

Sdg Number: 200-5677

Client Sample ID: IA-B9-02

Lab Sample ID: 200-5677-15

Date Sampled: 06/22/2011 1522

Client Matrix: Air

Date Received: 06/23/2011 1020

TO15 LL Volatile Organic Compounds in Ambient Air, Low Concentration (GC/MS)

Analysis Method:	TO15 LL	Analysis Batch:	200-20568	Instrument ID:	E.i
Prep Method:	Summa Canister	Prep Batch:	N/A	Lab File ID:	eelc020.d
Dilution:	1.0			Initial Weight/Volume:	500 mL
Analysis Date:	06/30/2011 0150			Final Weight/Volume:	500 mL
Prep Date:	06/30/2011 0150			Injection Volume:	500 mL

Analyte	Result (ppb v/v)	Qualifier	MDL	RL
Vinyl chloride	0.020	U	0.020	0.020
1,1-Dichloroethene	0.010	U	0.010	0.010
trans-1,2-Dichloroethene	0.010	U	0.010	0.010
1,1-Dichloroethane	0.010	U	0.010	0.010
cis-1,2-Dichloroethene	0.010	U	0.010	0.010
1,1,1-Trichloroethane	0.010	U	0.010	0.010
Benzene	0.19		0.010	0.010
1,2-Dichloroethane	0.020	U	0.020	0.020
Trichloroethene	0.027		0.010	0.010
Toluene	0.26		0.010	0.010
1,1,2-Trichloroethane	0.010	U	0.010	0.010
Tetrachloroethene	0.028		0.010	0.010
Ethylbenzene	0.12		0.010	0.010
o-Xylene	0.081		0.010	0.010
1,1,2,2-Tetrachloroethane	0.010	U	0.010	0.010
m-Xylene & p-Xylene	0.22		0.020	0.020

Analyte	Result (ug/m3)	Qualifier	MDL	RL
Vinyl chloride	0.051	U	0.051	0.051
1,1-Dichloroethene	0.040	U	0.040	0.040
trans-1,2-Dichloroethene	0.040	U	0.040	0.040
1,1-Dichloroethane	0.040	U	0.040	0.040
cis-1,2-Dichloroethene	0.040	U	0.040	0.040
1,1,1-Trichloroethane	0.055	U	0.055	0.055
Benzene	0.62		0.032	0.032
1,2-Dichloroethane	0.081	U	0.081	0.081
Trichloroethene	0.15		0.054	0.054
Toluene	0.99		0.038	0.038
1,1,2-Trichloroethane	0.055	U	0.055	0.055
Tetrachloroethene	0.19		0.068	0.068
Ethylbenzene	0.54		0.043	0.043
o-Xylene	0.35		0.043	0.043
1,1,2,2-Tetrachloroethane	0.069	U	0.069	0.069
m-Xylene & p-Xylene	0.98		0.087	0.087

Analytical Data

Client: Malcolm Pirnie, Inc.

Job Number: 200-5677-1

Sdg Number: 200-5677

Client Sample ID: IA-B13-01

Lab Sample ID: 200-5677-16

Date Sampled: 06/22/2011 1543

Client Matrix: Air

Date Received: 06/23/2011 1020

TO15 LL Volatile Organic Compounds in Ambient Air, Low Concentration (GC/MS)

Analysis Method:	TO15 LL	Analysis Batch:	200-20568	Instrument ID:	E.i
Prep Method:	Summa Canister	Prep Batch:	N/A	Lab File ID:	eelc023.d
Dilution:	1.5			Initial Weight/Volume:	339 mL
Analysis Date:	06/30/2011 0434			Final Weight/Volume:	500 mL
Prep Date:	06/30/2011 0434			Injection Volume:	500 mL

Analyte	Result (ppb v/v)	Qualifier	MDL	RL
Vinyl chloride	0.030	U	0.030	0.030
1,1-Dichloroethene	0.015		0.015	0.015
trans-1,2-Dichloroethene	0.015	U	0.015	0.015
1,1-Dichloroethane	0.015	U	0.015	0.015
cis-1,2-Dichloroethene	0.097		0.015	0.015
1,1,1-Trichloroethane	0.039		0.015	0.015
Benzene	0.69		0.015	0.015
1,2-Dichloroethane	0.030	U	0.030	0.030
Trichloroethene	0.28		0.015	0.015
Toluene	1.2		0.015	0.015
1,1,2-Trichloroethane	0.015	U	0.015	0.015
Tetrachloroethene	0.33		0.015	0.015
Ethylbenzene	0.33		0.015	0.015
o-Xylene	0.35		0.015	0.015
1,1,2,2-Tetrachloroethane	0.015	U	0.015	0.015
m-Xylene & p-Xylene	1.1		0.030	0.030

Analyte	Result (ug/m3)	Qualifier	MDL	RL
Vinyl chloride	0.077	U	0.077	0.077
1,1-Dichloroethene	0.058		0.059	0.059
trans-1,2-Dichloroethene	0.059	U	0.059	0.059
1,1-Dichloroethane	0.061	U	0.061	0.061
cis-1,2-Dichloroethene	0.39		0.059	0.059
1,1,1-Trichloroethane	0.21		0.082	0.082
Benzene	2.2		0.048	0.048
1,2-Dichloroethane	0.12	U	0.12	0.12
Trichloroethene	1.5		0.081	0.081
Toluene	4.6		0.057	0.057
1,1,2-Trichloroethane	0.082	U	0.082	0.082
Tetrachloroethene	2.2		0.10	0.10
Ethylbenzene	1.4		0.065	0.065
o-Xylene	1.5		0.065	0.065
1,1,2,2-Tetrachloroethane	0.10	U	0.10	0.10
m-Xylene & p-Xylene	5.0		0.13	0.13