

**PERIODIC REVIEW REPORT
2011
PFOHL BROTHERS LANDFILL
CHEEKTOWAGA, NY**

Submitted to:

**NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION
270 MICHIGAN AVENUE
BUFFALO, NEW YORK 14203**

Prepared by:

**URS CORPORATION
77 GOODELL STREET
BUFFALO, NEW YORK 14203**

Prepared for:

**TOWN OF CHEEKTOWAGA
ENGINEERING DEPARTMENT
275 ALEXANDER AVE
CHEEKTOWAGA, NEW YORK 14211**

MARCH 2012

TABLE OF CONTENTS

1.0	Introduction	1
1.1	Background	1
1.2	Effectiveness of Remedial Program.....	1
1.3	Compliance	1
1.4	Recommendations.....	2
2.0	Site Overview	2
2.1	Site Description.....	2
2.2	Chronology	2
3.0	Remedy Performance, Effectiveness and Protectiveness	2
3.1	Groundwater Monitoring	3
3.2	Surface Water/Sediment Sampling	3
3.3	Effluent Monitoring	3
3.4	Hydraulic Monitoring	4
3.5	Wetlands Monitoring	4
3.6	General Physical and Mechanical Maintenance	4
4.0	IC/EC Plan Compliance	5
4.1	Institutional Controls.....	5
4.2	Engineering Controls	5
5.0	Operation & Maintenance and Monitoring Plan Compliance	5
6.0	Conclusions and Recommendations.....	6

FIGURES

Figure 2-1 Site Plan

ATTACHMENTS

Attachment A January 2011 – June 2011 Semi Annual Report
Attachment B July 2011 – December 2011 Semi Annual Report
Attachment C IC/EC Certification

1.0 INTRODUCTION

1.1 Background

This Pfohl Brothers Landfill Site (No. 915043) is a 130 acre landfill located on the north and south sides of Aero Drive in the Town of Cheektowaga, Erie County. The site is located in a commercial area just west of Transit Road. The landfill was operated between 1940 and 1969 receiving household and industrial wastes. The industrial waste materials included paints, waste solvents, thinners, pine tar pitch, cellulose, rubber, scrap metal and phenolic tars. A Remedial Investigation and Feasibility Study was completed in 1991. The data showed that on-site soils, groundwater, seeps, and sediments were contaminated with Volatile and Semi-Volatile Organic Compounds, and metals at various concentrations. The data did not show any significant off-site impact. A Record of Decision (ROD) was issued in 1992 requiring the landfill to be consolidated and closed. A second ROD was issued in 1994 which removed the northern portion of the site (located immediately south of Interstate 90) from the site description. The ROD also stated that there will be no action in regard to off-site groundwater. The final remedial design for the site was completed in 2000. The remedial construction consisted of waste consolidation; capping of landfills on either side of Aero Drive; providing leachate collection around these areas; restoring wetlands; and fencing the landfill. Work commenced in 2001 and was completed in 2002. The consolidated landfill was reduced to 94 acres. Deed restrictions have been filed by the Potentially Responsible Parties (PRPs). The Operation, Maintenance and Monitoring (OM&M) Plan was approved in March 2006 and is being implemented by the Town of Cheektowaga.

1.2 Effectiveness of Remedial Program

During 2011, the capping and remedial action remedy continued to successfully prevent exposure of buried waste to human health or environmental receptors. Effectiveness has been demonstrated through maintenance of the landfill cap, effective hydraulic control of groundwater beneath the cap, and regular semiannual groundwater sampling.

1.3 Compliance

The management of the site is in compliance with the OM&M Plan. Institutional controls in the form of deed restrictions remain in place.

1.4 Recommendations

No changes to the operation, maintenance, and monitoring of the site are recommended.

2.0 SITE OVERVIEW

2.1 Site Description

The boundaries of the site are shown on Figure 2-1. The site is located immediately southwest of the intersection of Interstate 90 and Transit Road in the Town of Cheektowaga. The site is bisected by the east/west Aero Drive. Each of the two portions of the landfill are covered with a cap comprising a gas venting layer, a low permeability synthetic membrane, and a barrier protection fill layer. Surrounding the entire site is a groundwater/leachate collection system consisting of a collection trench that drains into six wetwells. Leachate and groundwater collected in the wetwells is pumped via submersible pumps in the wetwells to a fifteen-inch sanitary sewer line on the south side of Aero Drive. This sanitary sewer, installed as part of the remedy, connects to the existing fifteen-inch sanitary sewer on Rein Road south of Aero Drive. The collected groundwater/leachate discharges to the sanitary sewer under a permit from the Buffalo Sewer Authority (BSA).

2.2 Chronology

The principal elements of the remedy were consolidation of waste materials, construction of a landfill cap and construction of a perimeter leachate collection system. Construction of the remedy was completed in 2002.

OM&M commenced in 2002 upon completion of construction. These efforts are performed in accordance with the OM&M plan issued as draft in 2002 and approved as final in 2006. Based upon the results of the first three years of surface water, sediment and monitoring results, the surface water/sediment sampling was discontinued in 2008, and the list of parameters evaluated during groundwater sampling was reduced in 2006 (limiting the list of VOC and SVOC parameters and metals) and 2007 (discontinuing dioxin and radionuclide analyses).

3.0 REMEDY PERFORMANCE, EFFECTIVENESS AND PROTECTIVENESS

The principal elements of the OM&M are:

- ▶ Groundwater Monitoring

- ▶ Surface Water/Sediment Sampling
- ▶ Effluent Monitoring
- ▶ Hydraulic Monitoring
- ▶ Wetlands Monitoring
- ▶ General physical and mechanical maintenance.

The Town of Cheektowaga submits OM&M reports to NYSDEC twice per year reporting on the performance, effectiveness, and protectiveness of each of these elements. The two reports covering the calendar year of 2011 are attached to this Periodic Review Report. A summary of the findings of performance, effectiveness, and protectiveness for 2011 is presented in the sections below.

3.1 Groundwater Monitoring

As the OM&M contractor for the Town of Cheektowaga, URS Corporation (URS) has performed sixteen rounds of semi-annual groundwater sampling. Sampling was conducted in May and November 2011. Results of this sampling continue to show no impacts to groundwater from the landfill. In brief, no VOCs or SVOCs were detected except for bis(2-ethylhexyl)phthalate detected at a concentration that exceeded its groundwater quality standard (in upgradient monitoring well GW-07D) in May 2011, and metals detected are at concentrations similar to previous sampling events and are attributable to naturally occurring or offsite (e.g. road salting operations) sources. The attached semi-annual reports present the data from this sampling in tables, graphs, and charts.

3.2 Surface Water/Sediment Sampling

Surface water and sediment sampling was discontinued in 2008 after three years of sampling showed that no site-related contaminants were present in these media. This sampling was eliminated in accordance with the approved OM&M plan and as approved by NYSDEC.

3.3 Effluent Monitoring

URS performed effluent monitoring on a quarterly basis during 2011. The results of the sampling are reported in the attached semiannual reports. The parameter values in the effluent

have always been well below the discharge criteria for all quarterly sampling events conducted since the start of the OM&M.

3.4 Hydraulic Monitoring

URS performed hydraulic monitoring on a quarterly basis during 2011. Hydraulic monitoring is performed through measuring the water elevation in each of the six wetwells and in nine manholes associated with the perimeter collection system, and comparing each of these elevations with the groundwater elevations in paired monitoring wells adjacent to each wetwell or manhole. Hydraulic control is demonstrated by an inward hydraulic gradient from the monitoring wells to the collection system. The hydraulic gradient has been towards the groundwater collection system for every quarterly measurement taken with one exception. The pairing of WW-6 and GW-34S exhibited an outward gradient during the September 22, 2011 monitoring event when the GW-34S groundwater elevation was unusually low. However, the gradient returned to an inward gradient during the November 1, 2011 and December 20, 2011 measurements.

3.5 Wetlands Monitoring

The monitoring of wetlands mitigation has not gone as originally planned in the OM&M manual. Initially, the wetlands species planted for mitigation fared poorly due to trampling from geese and deer. Fences were erected in 2004 to keep this wildlife out. Some wetland vegetation was also lost during landfill cap mowing in 2005 when the mowing contractor mowed a greater area than had been specified. The wetland vegetation species were replanted in 2005. However, in the time since construction ended in 2002, the *Phragmites sp.* vegetation that is quite abundant in this area has spread and established itself throughout the areas formerly disturbed during construction. *Phragmites sp.* does not provide robust food source for wildlife, but does act to stabilize soil in the interface zone between the landfill and the existing pond and wetland.

3.6 General Physical and Mechanical Maintenance

The Town of Cheektowaga performs the necessary general physical and mechanical maintenance as needed. Example maintenance items are routine maintenance and replacement of pumps and instrumentation used for groundwater/leachate collection, annual cap mowing, snow plowing, etc. A summary of the general maintenance activities performed during 2011 is provided in the attached semiannual reports.

4.0 IC/EC PLAN COMPLIANCE

There is no formal Institutional Control/Engineering Control (IC/EC) plan for this site. However, there are institutional and engineering controls in place and they are functioning as intended. These are discussed below.

4.1 Institutional Controls

Institutional controls (ICs) consist of restrictions on land use for the various parcels that comprise this site. The parcels subject and their restrictions are listed on the attached Site Management Periodic Review Report Notice Institutional and Engineering Controls Certification Form. The restrictions address building use, groundwater use, and land use. Compliance with these ICs is evaluated by observation to see if any infringing activities are occurring on these parcels. These ICs remain in effect, as certified in Attachment C.

4.2 Engineering Controls

Engineering controls (ECs) consist of the landfill cap, fencing and access control, collection of the groundwater/leachate, and vapor mitigation. Compliance with these ECs is evaluated at a minimum through inspection of these elements during each semiannual monitoring event. In most cases, inspection is more frequent. For example collection of the groundwater/leachate is monitored continuously by Town of Cheektowaga personnel and effluent compliance reports are submitted quarterly. These ECs remain in effect, as certified in Attachment C.


5.0 OPERATION & MAINTENANCE AND MONITORING PLAN COMPLIANCE

The components of the OM&M Plan are discussed above in Section 3.0. Summaries of OM&M activities performed during 2011 are provided in the attached semiannual reports. The OM&M activities show that the landfill and its groundwater/leachate collection system are operating as intended, and receive repairs and maintenance as needed in a timely fashion. Sampling of the groundwater in monitoring wells and the effluent generated by the groundwater/leachate collection system show that no landfill contamination is migrating to these media, and therefore the wastes remain effectively contained. No changes to the OM&M for this site are recommended.

6.0 CONCLUSIONS AND RECOMMENDATIONS

The remedy at the Pfohl Brothers Site Landfill is operating as designed and remains protective of human health and the environment. No changes to the OM&M for this site are recommended.

FIGURES

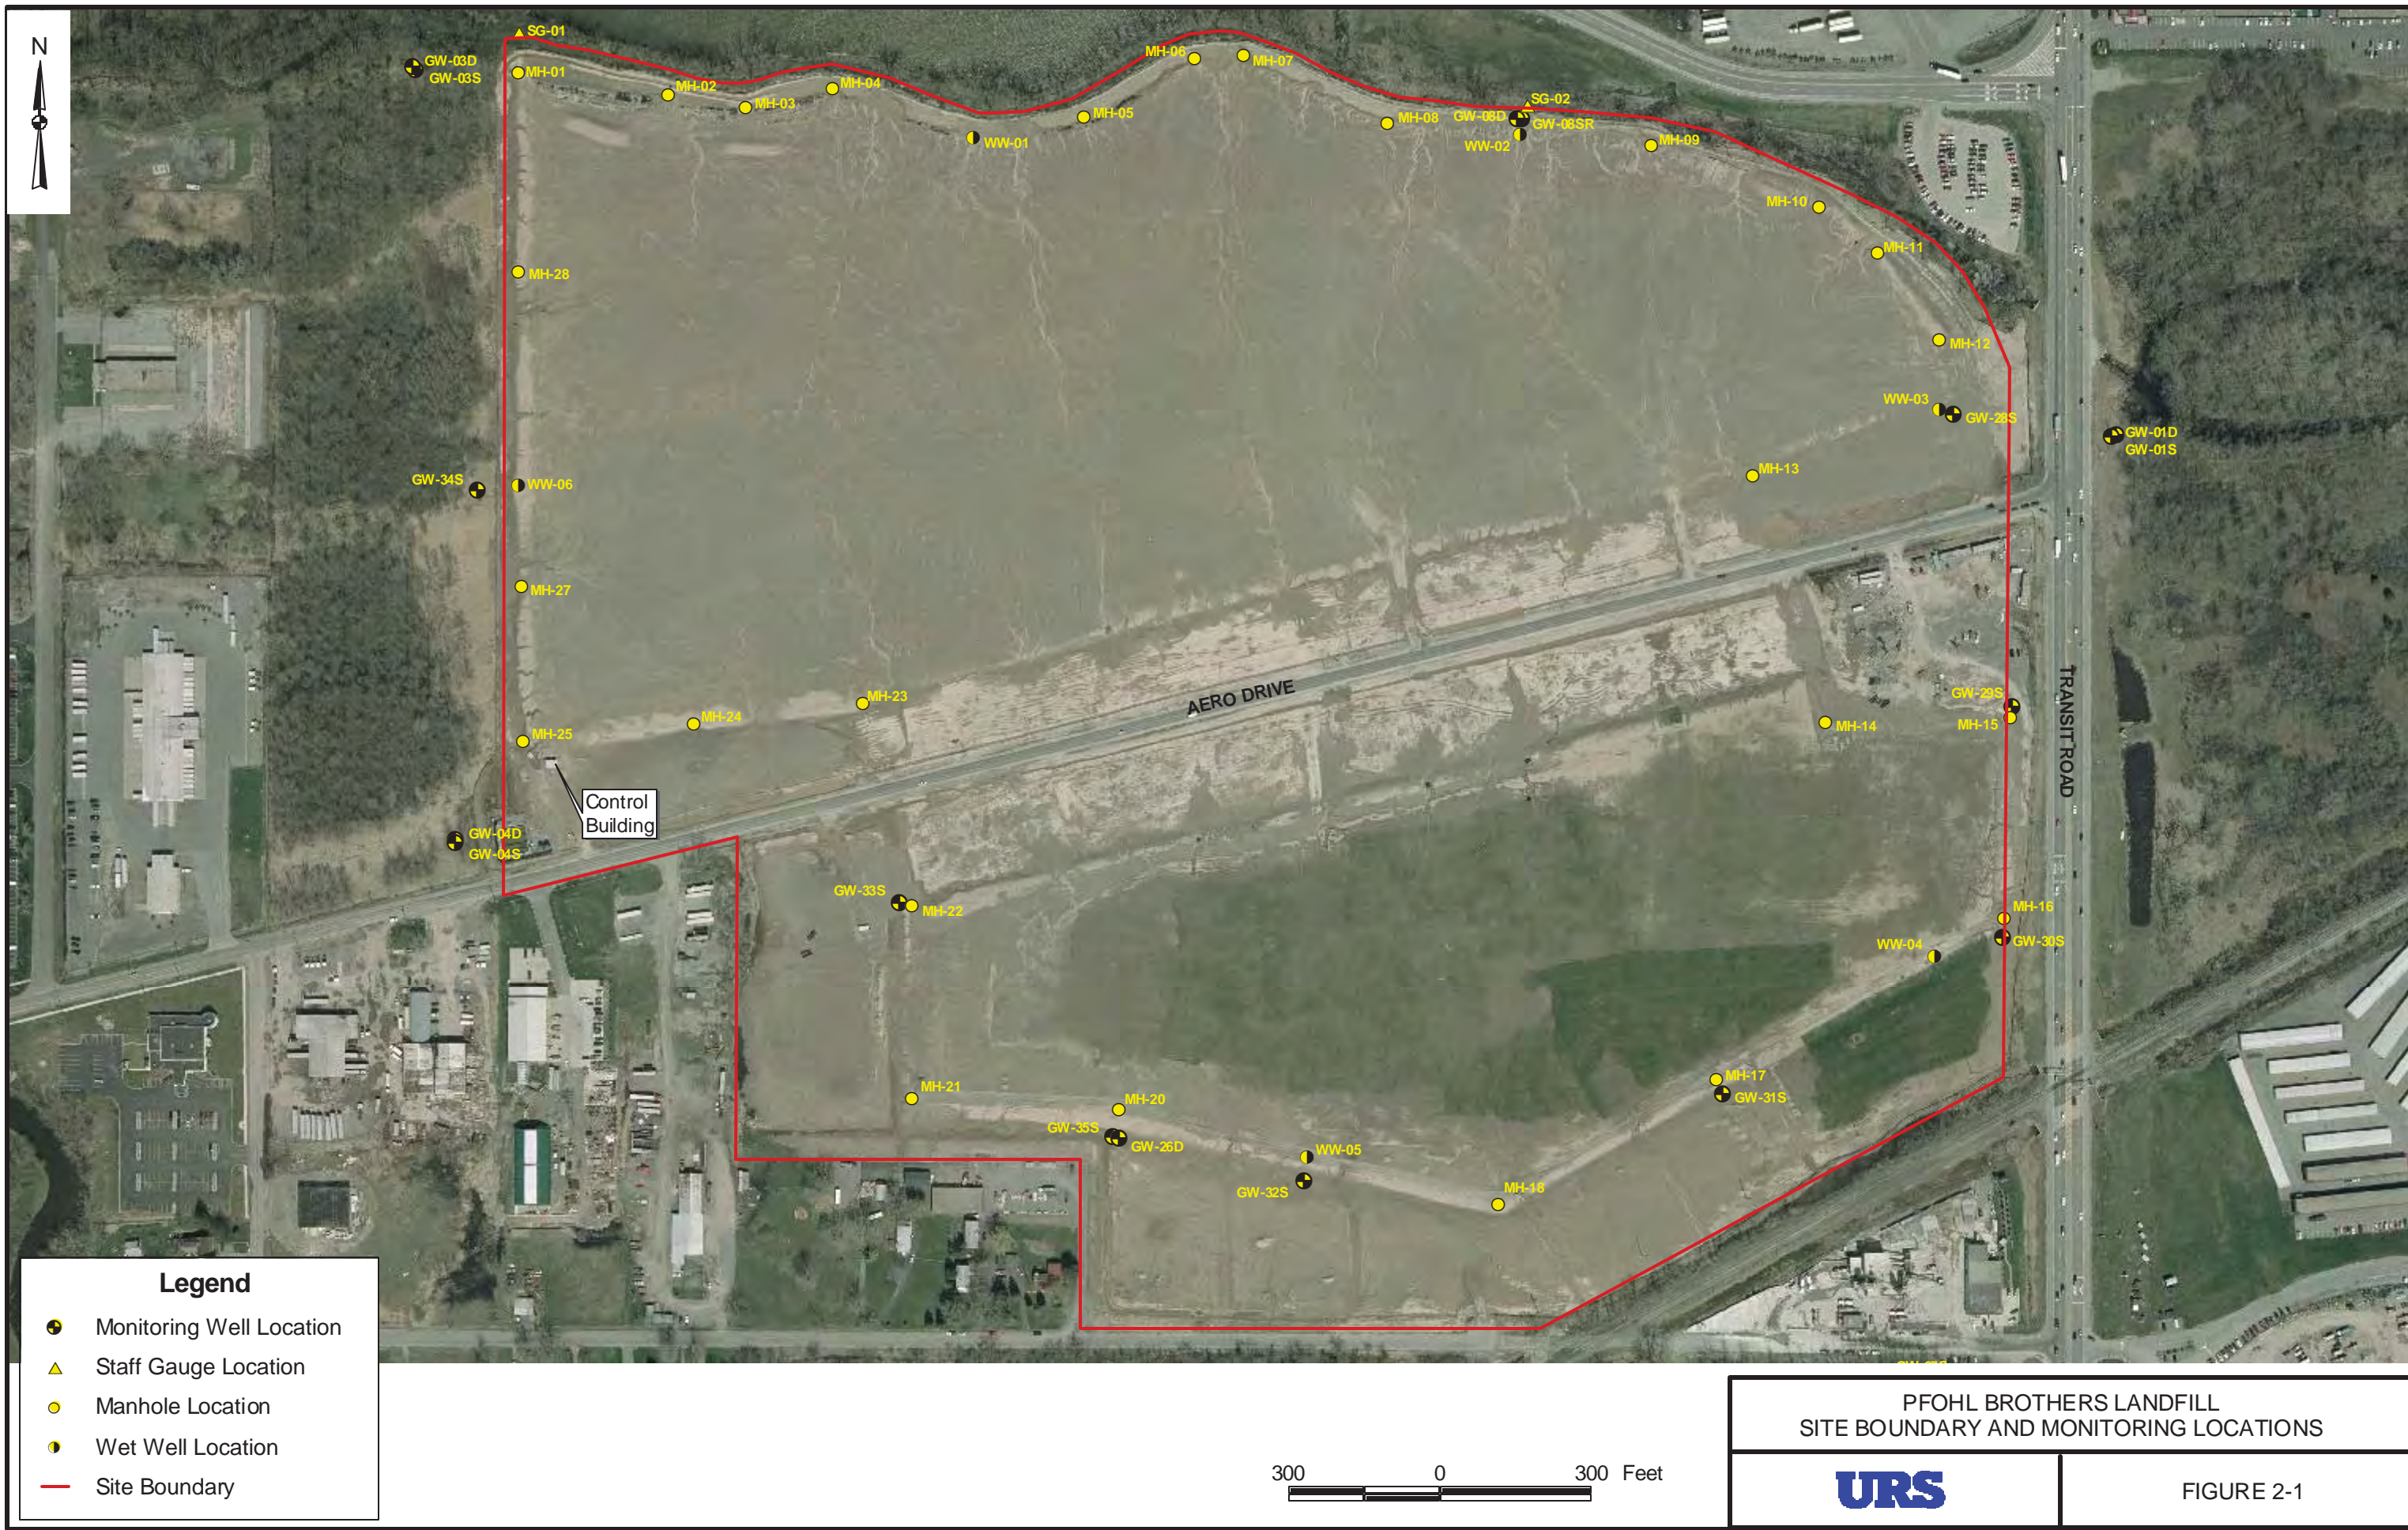

ATTACHMENTS

ATTACHMENT A

January 2011 – June 2011

Semi Annual Report

**SEMI ANNUAL REPORT
OPERATION AND MAINTENANCE
JANUARY 2011 TO JUNE 2011
PFOHL BROTHERS LANDFILL
CHEEKTOWAGA, NY**

Submitted to:

**NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION
270 MICHIGAN AVENUE
BUFFALO, NEW YORK 14203**

Prepared by:

**URS CORPORATION
77 GOODELL STREET
BUFFALO, NEW YORK 14203**

Prepared for:

**TOWN OF CHEEKTOWAGA
ENGINEERING DEPARTMENT
275 ALEXANDER AVE
CHEEKTOWAGA, NEW YORK 14211**

**NOVEMBER
2011**



November 11, 2011

Mr. Jaspal Singh Walia, P.E.
New York State Department of Environmental Conservation
270 Michigan Ave.
Buffalo, NY 14203

**Re: Semi-Annual Report
Pfohl Brothers Landfill, Town of Cheektowaga, New York**

Dear Mr. Walia:

Enclosed is one copy of the fifteenth Semi-Annual Report for the Pfohl Brothers Landfill in Cheektowaga, New York. A copy has also been sent to Ms. Pamela Tames, P.E. of the United States Environmental Protection Agency. Also enclosed is the Data Applicability Report for laboratory analyses associated with the Semi-Annual Report. PDF copies of the reports are also enclosed.

If you have any questions on this report, please feel free to contact me.

Sincerely,

URS CORPORATION

A handwritten signature in black ink, appearing to read "Jon Sundquist", is positioned above the printed name.

Jon Sundquist, Ph.D.
Project Manager

Enclosures

cc: Pamela Tames, P.E. - USEPA (w/attachments)
William Pugh, P.E. - Town of Cheektowaga (w/attachments)
File 11172700 (C-1)

TABLE OF CONTENTS

	<u>Page No.</u>
1.0 INTRODUCTION	1-1
1.1 Background.....	1-1
1.2 Operation and Maintenance Activities.....	1-1
2.0 GENERAL MAINTENANCE ACTIVITIES.....	2-1
3.0 MONITORING ACTIVITIES.....	3-1
3.1 Groundwater Hydraulic Monitoring	3-1
3.2 Groundwater Quality Monitoring	3-1
3.3 Groundwater Discharge Monitoring.....	3-4
3.4 Monitoring Well Inspections	3-5
4.0 SUMMARY AND RECOMMENDATIONS.....	4-1

TABLES

Table 3-1	Groundwater Sample Analytical Results
Table 3-2	Approved Revision Of Table 3.2 From The O&M Plan

FIGURES

Figure 1-1	Site Location Map
Figure 3-1	Monitoring Locations

APPENDICES

Appendix A	Example Daily Inspection Sheets
Appendix B	Monthly Flow Summaries (January 2011 – June 2011)
Appendix C	Hydraulic Monitoring Tables
Appendix D	Groundwater Purge and Sample Collection Logs
Appendix E	Historical Analytical Results
Appendix F	BSA Permit No. 10-11-CH016
Appendix G	Discharge Report Summary Tables
Appendix H	Monitoring Well Inspection Logs

1.0 INTRODUCTION

1.1 Background

The Pfohl Brothers Landfill is located on Aero Drive in the Town of Cheektowaga, New York (Figure 1-1). The site is listed as site No. 9-15-043 on the New York State Department of Environmental Conservation's (NYSDEC's) Registry of Inactive Hazardous Waste Disposal Sites. A Consent Order between NYSDEC and potentially responsible parties (PRPs) for closure of the site was signed in 2001 and remedial construction commenced in 2001. The remedy included consolidation of waste material, capping of the waste disposal and consolidation areas, and encircling the landfill areas with a groundwater collection system to prevent off-site migration. The remedial action was completed in 2002.

Responsibility for implementing the remedy was divided between a "steering committee" of industrial PRPs and the Town of Cheektowaga. The steering committee responsibilities lay generally with the capital construction activities of the remedy including waste consolidation, cap and drainage system installation, etc. The Town of Cheektowaga, which was named as a PRP for disposal of municipal waste at the Pfohl Brothers Landfill when it was operating, is performing the operation and maintenance (O&M) activities at the landfill, pursuant to a settlement agreement between the Town and the steering committee.

1.2 Operation and Maintenance Activities

While construction of the remedy was substantially complete by late 2002, the final O&M manual was not approved by the NYSDEC until March 10, 2006. However, the Town of Cheektowaga and its consultant (URS Corporation) assumed most of the operational responsibilities since 2002. This includes a variety of general maintenance activities as outlined in Section 2 and sampling and other monitoring activities outlined in Section 3.

Beginning in 2004, the Town and URS assumed all of the O&M activities described in the O&M plan. This report is the fifteenth semi-annual report as called for by Section 3.6 of the O&M plan.

2.0 GENERAL MAINTENANCE ACTIVITIES

Since completion of construction activities in 2002, personnel from the Town of Cheektowaga Engineering Department have performed general activities to ensure the physical operation of the landfill as intended by the design. The various O&M activities performed by the Town from January 2011 through June 2011 include the following actions.

- The amount of groundwater discharged through the collection system was recorded on a daily basis. The flow rate displayed by each wet well pump at the time of daily inspection and the total cumulative volume of flow was recorded for each wet well on daily inspection sheets. Examples of the daily inspection sheet are attached in Appendix A.
- Total cumulative effluent flow rates and volumes were summarized on a monthly basis starting in February 2003. The monthly totals for the period of January 2011 through June 2011, including graphs showing daily total discharge (gallons) as a function of calendar day, are presented in Appendix B.
- The wet well pumps were shutdown during wet weather flow conditions throughout the year to reduce hydraulic loading to the sewer. Such actions were only taken upon request of the Buffalo Sewer Authority during heavy storm events in order to reduce the hydraulic load on the BSA treatment system during such events. Shutdown events are recorded and included with the monthly flow data as previously requested by NYSDEC.
- Plowed snow to access the Control Building when necessary.
- Cleaned/replaced check valves as necessary at all wet wells.
- Replaced surge suppressors and fuses as needed for pump station instrumentation equipment.
- Installed replacement repair parts and re-installed the Toshiba magnetic flow meter at WW-4 on January 29, 2011.

- Replaced defective pump and installed new ball check valve in WW-6 on January 29, 2011.
- Ordered two (2) $\frac{3}{4}$ HP pumps and six (6) ball check valves for replacement inventory and stored the in the Site Control Building on June 10, 2011.
- Wildlife trapper engaged as needed to control ground burrowing animals in active burrows located west of Control Building and along south perimeter road of Area C (June 25, 2011).

3.0 MONITORING ACTIVITIES

The Town of Cheektowaga retained URS Corporation to perform monitoring activities as outlined in Section 3.1 of the O&M plan. During the period of January 2004 through the present, URS performed groundwater hydraulic monitoring (Section 3.1.1.2 of the O&M plan) and effluent monitoring (Section 3.1.4 of the O&M plan) on a quarterly basis. URS also performed the fifteenth semi-annual groundwater quality monitoring event (Section 3.1.1.3 of the O&M plan). A summary of the monitoring activities is presented in the following subsections. Hydraulic and groundwater sampling locations are shown on Figure 3-1.

3.1 Groundwater Hydraulic Monitoring

Groundwater and surface water elevations were monitored on a quarterly basis at all locations listed in Table 3.1 of the O&M Plan. The hydraulic monitoring data tables showing groundwater elevations are presented in Appendix C. Table 1 of this appendix lists the measured elevations. Table 2 provides a comparison of the measured levels in the wells and corresponding manholes/wet wells.

The data presented in Appendix C indicate that groundwater levels outside the collection system were higher than the levels measured in the corresponding wet well or manhole for each measurement date. Therefore, these data demonstrate that the collection system is operating as designed.

3.2 Groundwater Quality Monitoring

The fifteenth semi-annual round of groundwater sampling was conducted between May 16, 2011 and May 18, 2011. All wells listed in Table 3.2 of the O&M plan were purged and sampled using dedicated/disposable equipment. Figure 3-1 shows the well locations. Low flow sampling techniques were used on most wells.

Passive diffusion bags (PDBs) were placed in three wells with low recharge rates (GW-4S, GW-7S, and GW-7D) on April 16, 2011. The PDBs were removed from the wells during the sampling event and their contents were analyzed for VOCs. Following removal of the PDBs the three wells were purged dry. These wells were sampled for the other required parameters after their water levels recovered.

Purge logs and sampling summary sheets are provided in Appendix D. Measurements of pH, specific conductivity, temperature, dissolved oxygen, oxidation reduction potential, and turbidity taken during purging are provided in Appendix D. The samples were packed with ice in coolers and transported under chain-of-custody (CoC) control to Test America Laboratories of Amherst, New York.

Groundwater samples were analyzed for the parameters listed in Table 3.2 of the O&M plan as revised in accordance with Table 3-6 in the Semi Annual Report dated September 2007 (January through June 2007) and as approved by the December 6, 2006 and November 29, 2007 correspondence from the NYSDEC authorizing a reduction in the parameters list (this table is included in this report as Table 3-2). Table 3-1 of this report presents the groundwater sample results compared with NYSDEC Ambient Water Quality Standards and Guidance Values and Groundwater Effluent Limitations Class GA water quality standards.

Results

No VOCs were detected at concentrations above the Class GA water quality standards at any location. Only one SVOC, bis(2-ethylhexyl)phthalate, was detected at a concentration that exceeded its groundwater quality standard (in monitoring well GW-07D).

Among the metals, iron, magnesium, manganese, and sodium routinely exceed Class GA standards in most site wells. Chromium and nickel were detected at concentrations exceeding their respective groundwater standards in wells GW-03S and GW-07D. Lead was also detected at a concentration exceeding Class GA standards in well GW-07D.

Comparison to Historical Results

No significant changes in metals concentrations were observed when compared to previous sampling event analytical results. The concentration of iron, magnesium, manganese, and sodium in most site wells was similar to the concentrations found during previous sampling events.

The concentrations of chromium and nickel at GW-07D and GW-03S, and lead at GW-07D were within the historical range of concentrations observed for these compounds at these wells.

Sodium concentrations were generally higher in bedrock wells (GW-1D, GW-3D, GW-8D and GW-26D) and shallow wells adjacent to roads (GW-1S and GW-30S). The sodium concentration was also elevated in GW-08SR. The higher sodium concentrations in the bedrock wells may be attributed to the local bedrock composition and the elevated concentration in the shallow wells may be the result of seasonal road de-icing activities.

Trend Analysis

Appendix E, Figures E-1 through E-19 presents a trend analysis of groundwater parameters that routinely exceed Class GA groundwater standards. A review of the trend analysis indicated that no significant changes or trends in concentrations of any of the parameters exceeding groundwater standards have occurred over the fifteen semi-annual sampling events except as described below. Figure E-2 for GW-01S, indicates a consistent drop in sodium concentration over the fifteen sampling events. Figure E-4 for GW-03S indicates an upward trend for nickel since monitoring began (although concentrations were significantly lower during the last three events) Figure E-4 also indicates an upward trend for magnesium in GW-03S since monitoring began. Figure E-5 for GW-04D, indicates a slight increasing trend for magnesium. Figure E-9 for GW-08D shows a decreasing trend for both iron and manganese since monitoring began. Figure E-10 for GW-08SR shows an upward trend in sodium concentration over recent events. Figure E-12 for GW-28S, indicates decreasing trend for sodium since monitoring began.

Figure E-13 for GW-29S, indicates a slight increasing trend in iron concentration from 2005 through 2008 with a decreasing trend since then. Also at GW-29S, arsenic has been detected at concentrations exceeding its groundwater standard for 5 of the last 8 sampling events.

Laboratory Report

The groundwater analytical data package was prepared by Test America in accordance with NYSDEC Category A deliverable requirements. It was reviewed for compliance with analytical method requirements and the following guidelines: USEPA *Contract Laboratory Program (CLP) National Functional Guidelines for Organic Data Review*, EPA-540-R-99-008, October 1999; USEPA *CLP National Functional Guidelines for Inorganic Data Review*, EPA-540-R-01-008, July 2002; and USEPA *Region II Data Validation SOP for SW-846 Method 8290, PCDDs and PCDFs by High Resolution Gas Chromatography/High-Resolution Mass Spectrometry (HRGC/HRMS)*, SOP No. HW-19, Revision 1, October 1994. Qualifications applied to the data include “J/UJ” (estimated concentration/estimated quantitation limit), “J+” (estimated concentration with possible high bias), “J-” (estimated concentration with possible low bias), and “U” (not detected).

A Data Applicability Report (DAR) was prepared following the guidelines provided in NYSDEC Division of Environmental Remediation (DER-10) *Technical Guidance for Site Investigation and Remediation, Appendix 2B*, dated May 2010. The DAR dated June 2011 is submitted separately from this report.

3.3 Groundwater Discharge Monitoring

URS completed two quarterly sampling events (March 2011 and June 2011) of the groundwater collection system discharge since the previous semi-annual report. The sampling was performed in accordance with the requirements of Discharge Permit No. 10-11-CH016 between the Buffalo Sewer Authority and the Town of Cheektowaga. A copy of Permit No. 10-11-CH016 is included as Appendix F.

During the sampling events in March 2011 and June 2011, each regulated parameter was below the limits set by the permit. Copies of the data summary tables that were included with the monitoring reports are included as Appendix G.

3.4 Monitoring Well Inspections

During the May 2011 groundwater sampling event, a well inspection was performed. All wells appeared to be in good condition with the exception of previously existing damage to the risers on GW-07D, GW-01S, and GW-01D. The monitoring well inspection logs may be found in Appendix H.

4.0 SUMMARY AND RECOMMENDATIONS

General Maintenance: The Town will continue to maintain mechanical equipment at the landfill on an as-needed basis and operate the groundwater collection and discharge system as designed. The Town will also continue regular inspections, mow the cap once per year, and plow access to the control building during winter months as necessary.

Groundwater Hydraulic Monitoring: Hydraulic monitoring has been performed on a quarterly basis in conjunction with the discharge monitoring. Water level measurement data demonstrates that the hydraulic gradient is from outside the landfill towards the collection trench. Continued quarterly monitoring is recommended.

Groundwater Quality Monitoring: Groundwater sample results indicate that only low levels of organic compounds and metals are present. Similar concentrations of most parameters were found during previous sampling events. The sixteenth round of groundwater sampling will be conducted in November 2011. Low flow sampling techniques will be used. Passive diffusion bags will be used again for VOC analyses at the three wells (GW-4S, GW-7S, and GW-7D) that go dry even using low flow sampling techniques.

Groundwater Discharge Monitoring: Groundwater discharges remain within permit limits. Continued quarterly monitoring is recommended.

Surface Water and Sediment Sampling: URS asked that the NYSDEC consider the discontinuation of surface water and sediment sampling at the site in the January to June 2008 Semiannual Report. No future surface water or sediment sampling is planned.

TABLES

TABLE 3-2

APPROVED REVISION OF TABLE 3.2 FROM THE O&M PLAN

**GROUNDWATER SAMPLING SUMMARY
OPERATION AND MAINTENANCE PLAN
PFOHL BROTHERS LANDFILL SITE, CHEEKTOWAGA, NEW YORK**

LOCATIONS

GW-1D/1S
GW- 3D/3S
GW- 4D/4S
GW- 7D/7S
GW- 8D/8S(R)
GW- 26D/35S
GW- 28S
GW- 29S
GW- 30S
GW- 31S
GW- 32S
GW- 33S
GW- 34S

FREQUENCY

semi-annually for overburden and bedrock groundwater

PARAMETERS

<i>Field</i>	pH conductivity temperature turbidity
<i>VOCs</i>	Acetone Benzene 1,2-Dichloroethene (total) 1,1,2-Trichloroethane Vinyl chloride
<i>SVOCs</i>	Phenol 1,3-Dichlorobenzene 1,4-Dichlorobenzene bis(2-Ethylhexyl)phthalate

TABLE 3-2 (continued)


APPROVED REVISION OF TABLE 3.2 FROM THE O&M PLAN


**GROUNDWATER SAMPLING SUMMARY
OPERATION AND MAINTENANCE PLAN
PFOHL BROTHERS LANDFILL SITE, CHEEKTOWAGA, NEW YORK**

PARAMETERS (cont'd)

<i>Metals</i>	Antimony
	Arsenic
	Barium
	Cadmium
	Chromium
	Copper
	Iron
	Lead
	Magnesium
	Manganese
	Mercury
	Nickel
	Silver
	Sodium
	Zinc

FIGURES

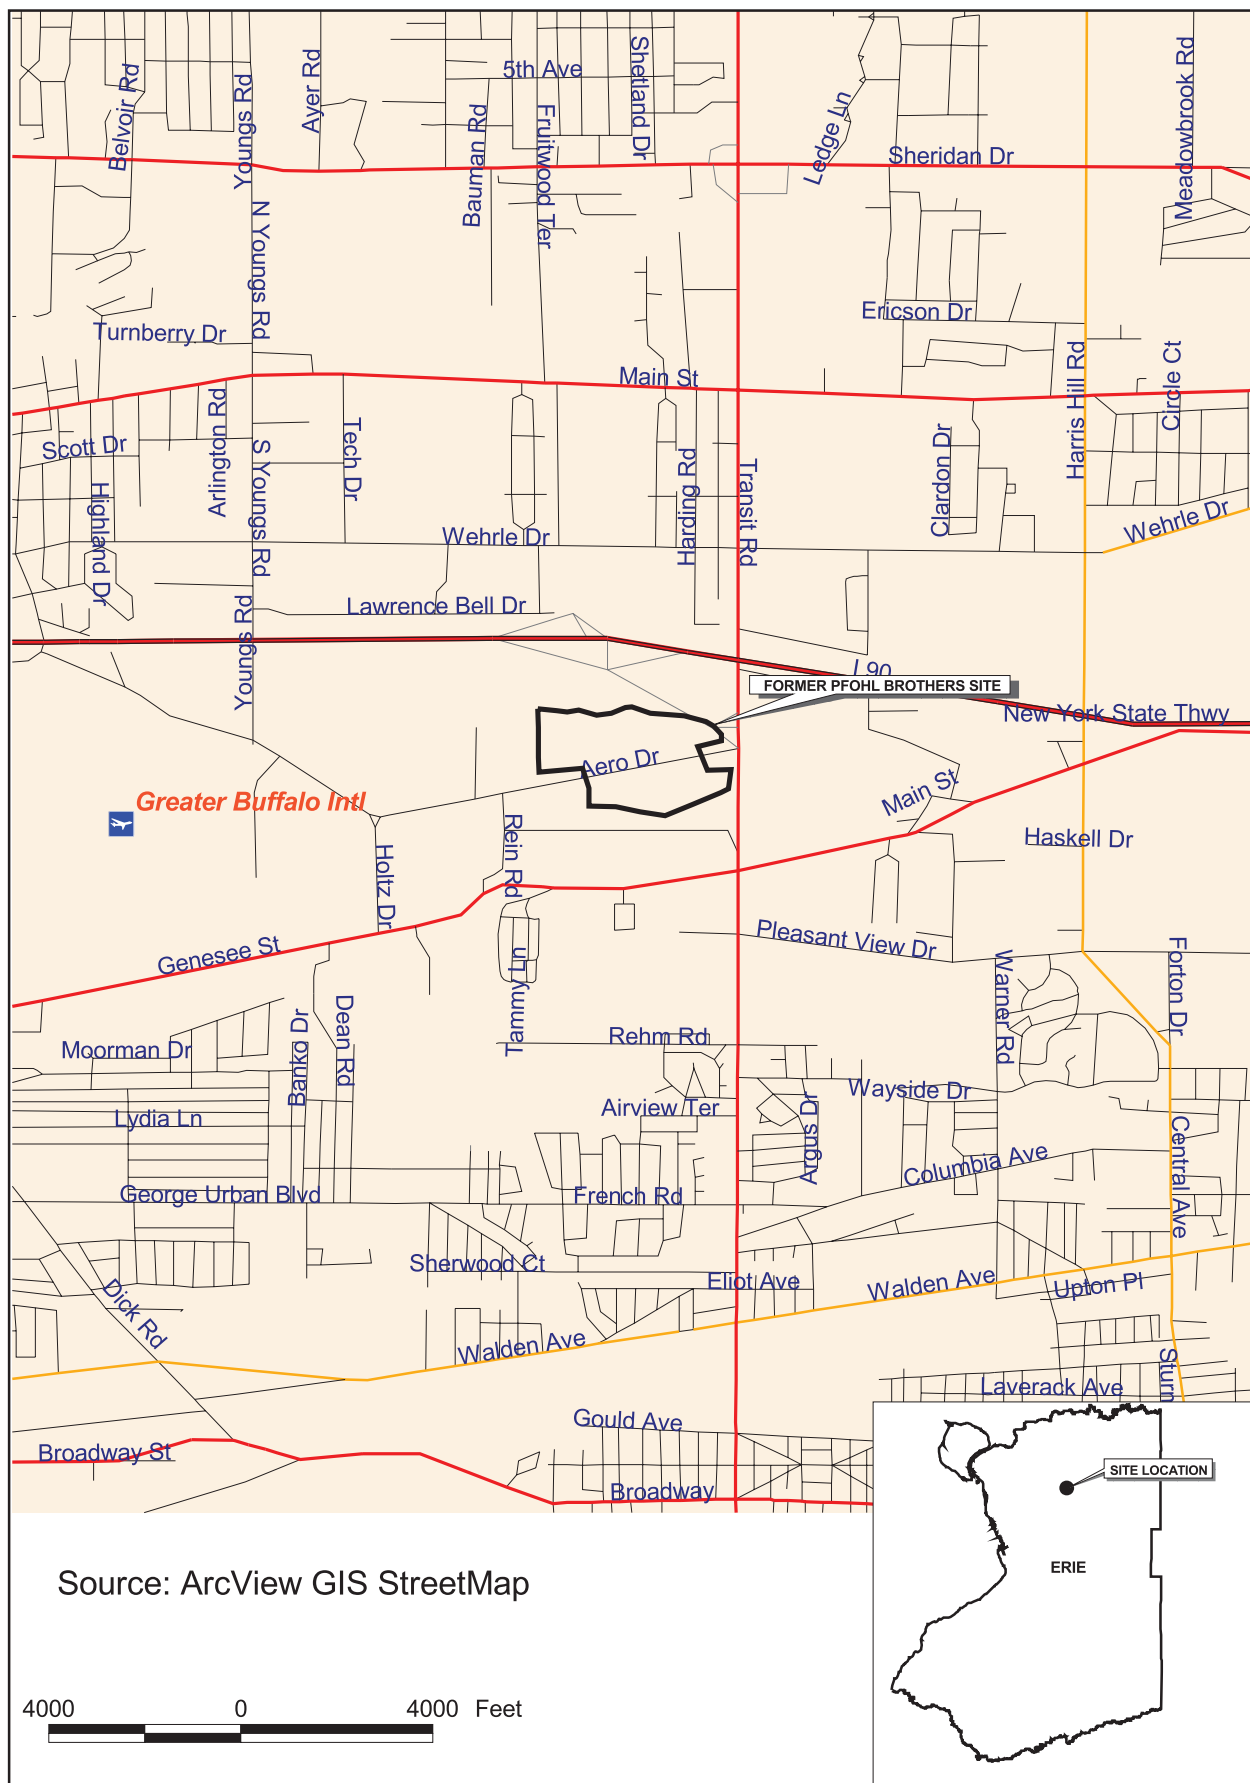

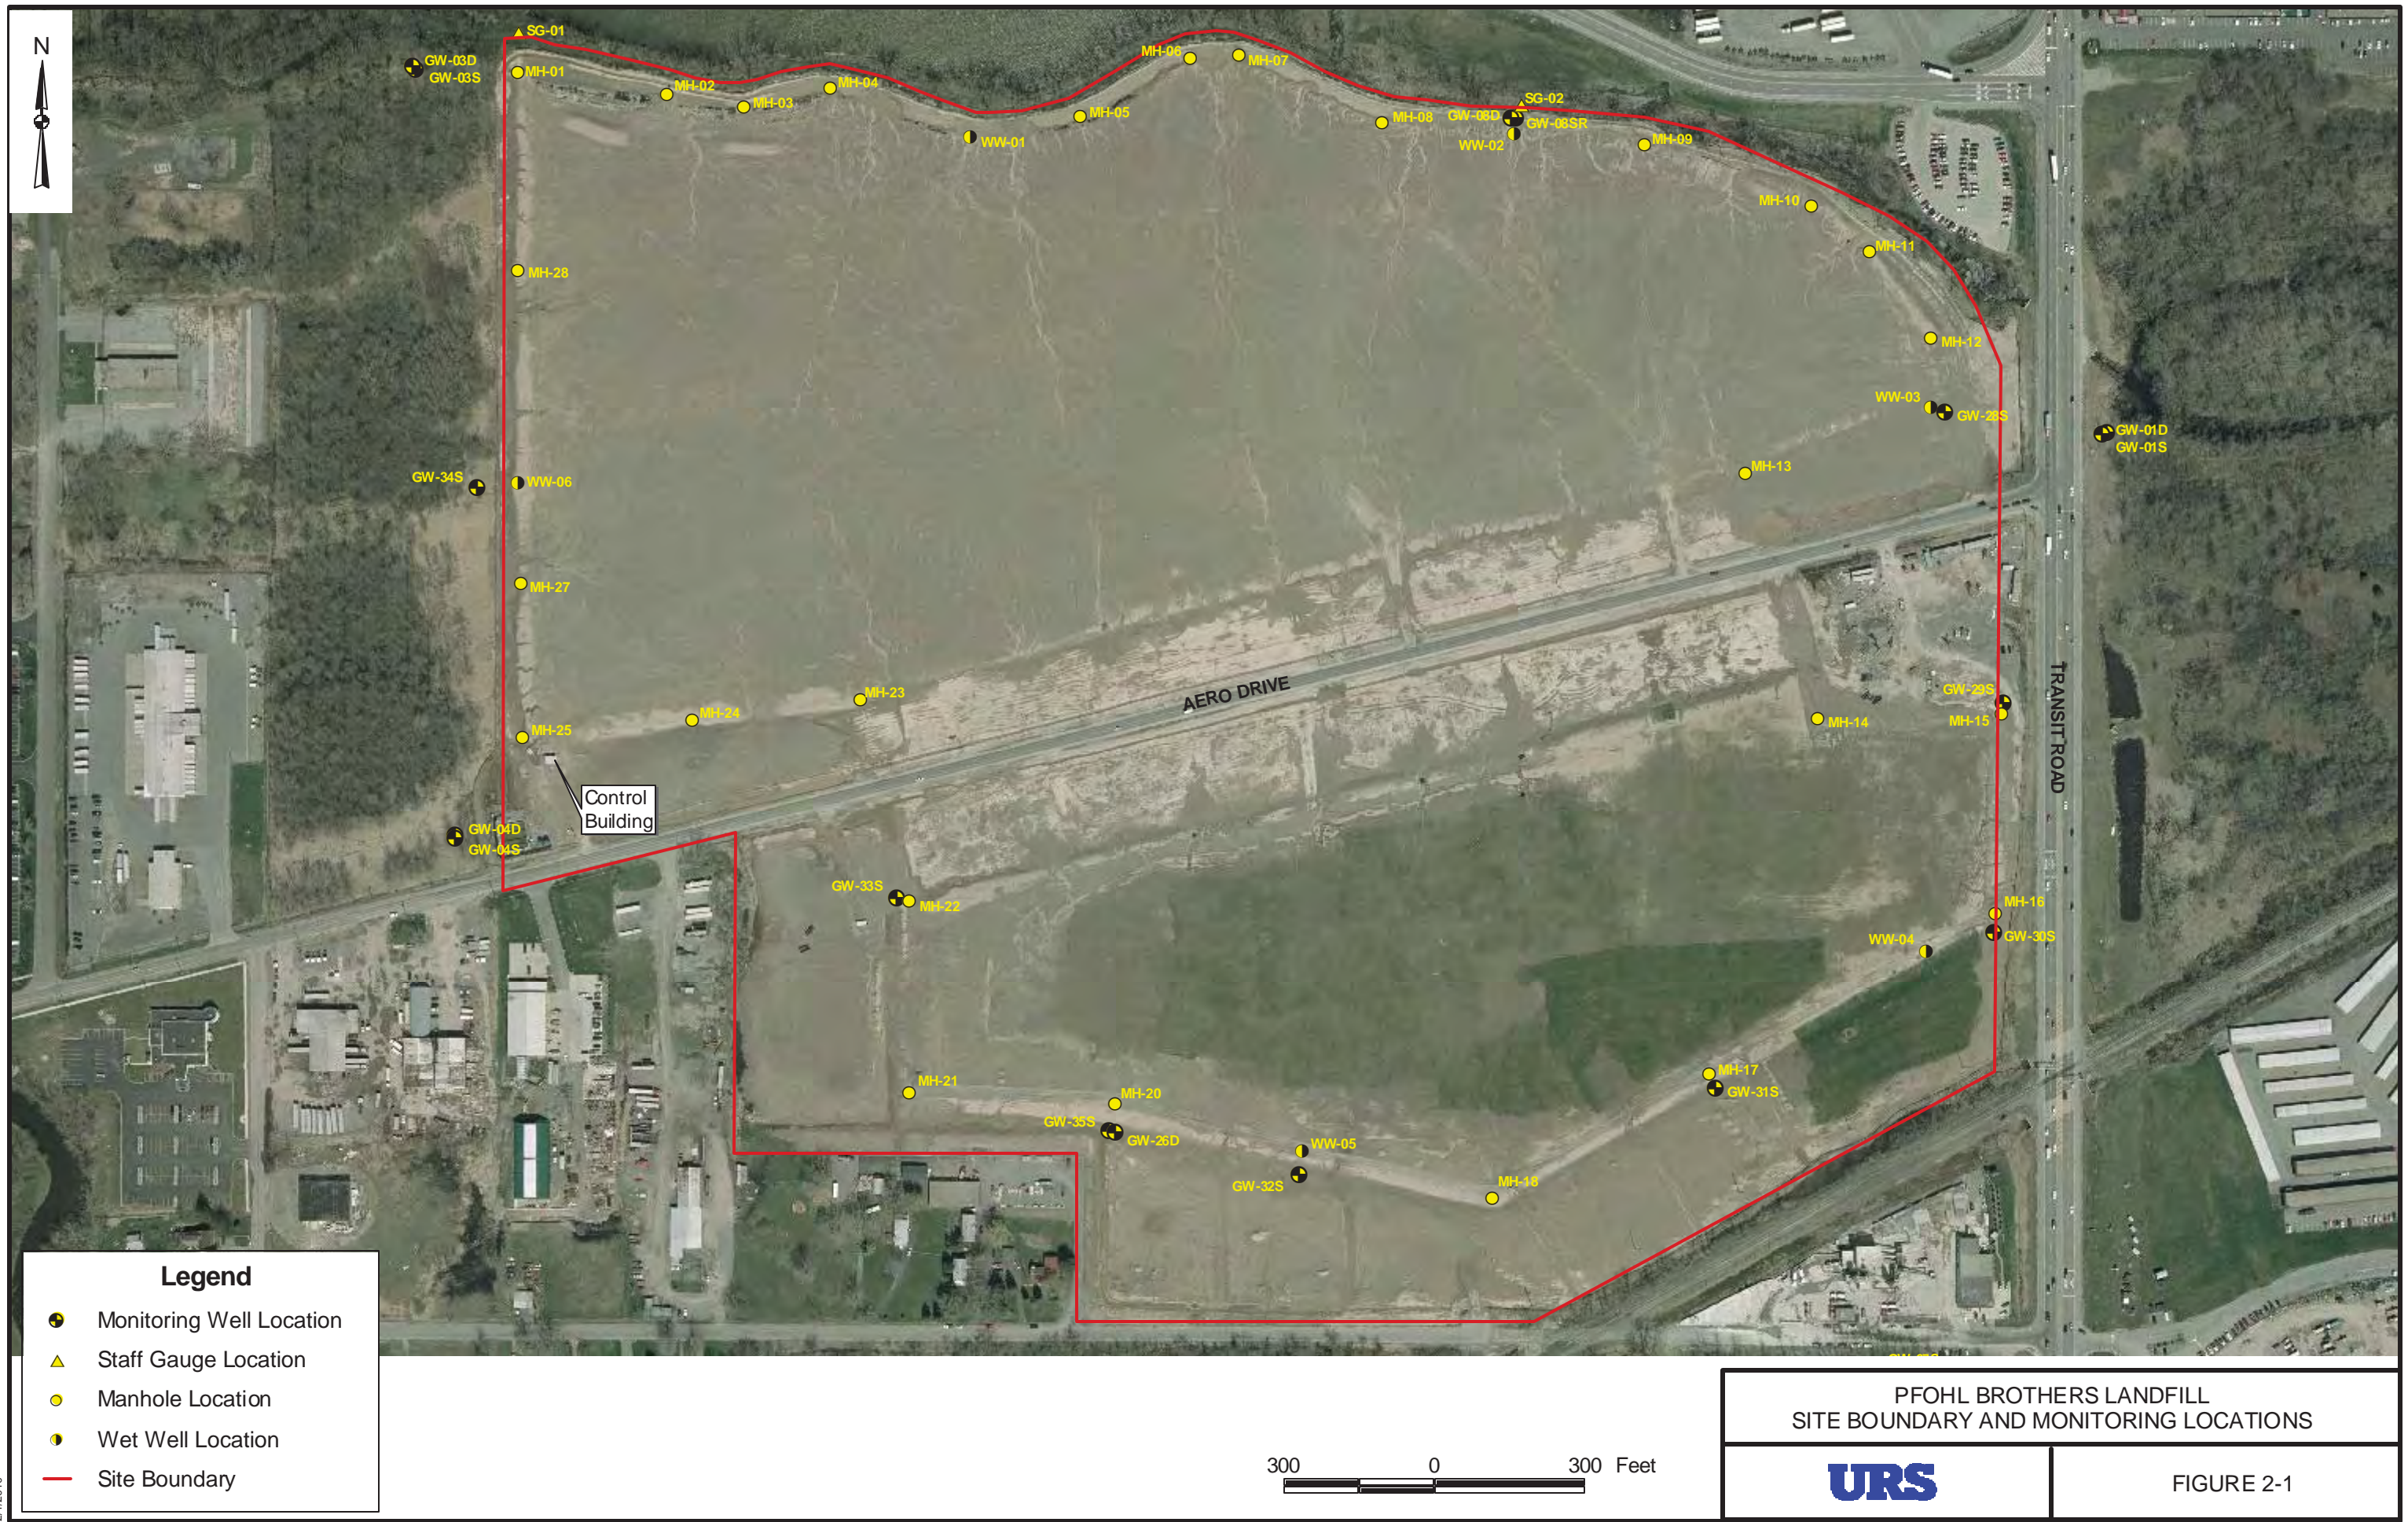

APPENDIX A

EXAMPLE DAILY INSPECTION SHEETS

Pfohl Brothers Landfill Site

Daily Logsheet

Town of Cheektowaga

Date 6-27-11
Time 2:20 PM

Weather conditions ^{80°} Clear, Sunny
Read by: BILL PUGH

	Level of Water from bottom (ft.)	Flow gallons / minute	Flow Totals gallons	Pump Run Time Hrs.
WW-3	4.6	0	290,722	1467
WW-2	4.6	0	14,839	120
WW-1	99	0	3,478,353	1248
WW-6	6.7	0	1,256,405	6016
WW-4	6.8	0	1,665,536	4812
WW-5	6.5	0	1,260,884	7555

Flow Totalizer at Meter chamber 28,328,184

Heat Trace

Outside temp T = 80°
Current A = 0

Set point SP = 40

Large Suppressor events 414,502

Motor Control Center

Volts 480 volts
Amps 8 amps

Which WW was running?

1 ☐ 2 ☐ 3 ☐ 4 ☐ 5 ☐ 6 ☐

Ø

Filter

Checked ☐

Changed ☐

Comments and/or Current Conditions

WW-1 ALARMS - LEVEL INVALID, FLOW INVALID

WILL NOT RESET - T. PESTKA TO CHECK

DELIVERED TWO (2) 3/4 H.P. PUMPS TO SITE

FOR INVENTORY (PICKUP FROM FLUID KINETICS 6/24/11)

Pfohl Brothers Landfill Site

Daily Logsheet

Town of Cheektowaga

Date 2/24/11
Time 1:25

Weather conditions Cloudy 28°
Read by: Bill PUGH

	Level of Water from bottom (ft.)	Flow gallons / minute	Flow Totals gallons	Pump Run Time Hrs.
WW-3	5.6	0	190,552	1416
WW-2	4.6	0	34,143	117
WW-1	4.1	0	2,712,893	862
WW-6	7.1	52.9	8,649,531	5178
WW-4	7.1	0	805,846	4165
WW-5	7.8	0	9,213,098	6321

Flow Totalizer at Meter chamber

21,923,346

Heat Trace

Outside temp T = 28°
Current A = 2.1

Set point SP = 40°

Large Suppressor events

414,469

Motor Control Center

Volts 480 volts
Amps 5 amps

Which WW was running?

1 ☐ 2 ☐ 3 ☐ 4 ☐ 5 ☒ 6 ☐

Filter

Checked ☐

Changed ☐

Comments and/or Current Conditions

RESET W.W. 3 NEG. FLOW ALARM

OK

APPENDIX B

MONTHLY FLOW SUMMARIES
JANUARY 2011 – JUNE 2011

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

February 5, 2011

Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga


Re: Pfohl Bros. Flow Data

Dear Mr. Pugh,

Enclosed for your review, please find a copy of the **January 2011** Direct Discharge Flow Data Report, prepared by Jon W. Nichy.

Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.


Yours truly,


Jon W. Nichy
Superintendent
Main Pump Station

Direct Discharge Flow Data

12/31/2010		19439748	5,644	19,093,435	
January-11	Time; 11:58pm unless otherwise stated	Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	Notes
1		19517896	78,148	19,171,583	1046 inhibit 2038 enable
2		19656018	138,122	19,309,705	
3		19751546	95,528	19,405,233	
4		19810324	58,778	19,464,011	
5		19835446	25,122	19,489,133	
6		19868910	33,464	19,522,597	
7		20000586	131,676	19,654,273	
8		20037996	37,410	19,691,683	
9		20050080	12,084	19,703,767	
10		20068612	18,532	19,722,299	
11		20078860	10,248	19,732,547	
12		20151606	72,746	19,805,293	
13		20191422	39,816	19,845,109	
14		20196120	4,698	19,849,807	
15		20238822	42,702	19,892,509	
16		20248844	10,022	19,902,531	
17		20304872	56,028	19,958,559	
18		20377294	72,422	20,030,981	
19		20396804	19,510	20,050,491	
20		20435872	39,068	20,089,559	
21		20561694	125,822	20,215,381	
22		20584338	22,644	20,238,025	
23		20592990	8,652	20,246,677	
24		20606094	13,104	20,259,781	
25		20625400	19,306	20,279,087	
26		20697490	72,090	20,351,177	
27		20746304	48,814	20,399,991	
28		20772104	25,800	20,425,791	
29		20773034	930	20,426,721	
30		20783840	10,806	20,437,527	
31		20877682	93,842	20,531,369	
		1,437,934	1,437,934	1,437,934	

January
2011

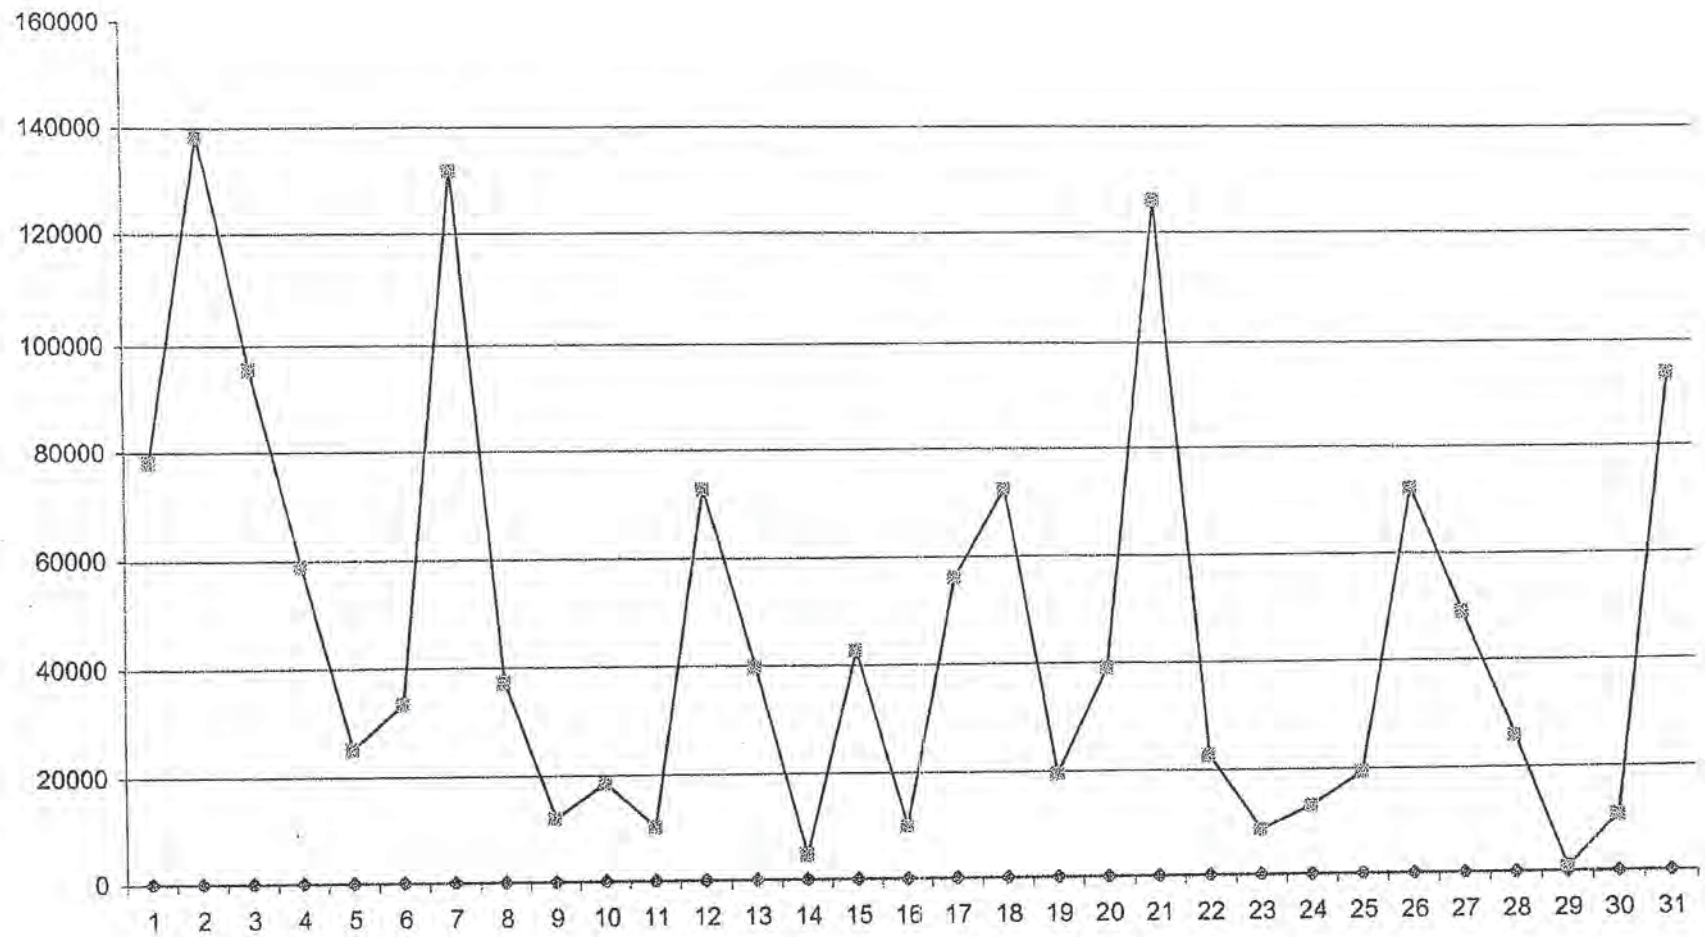

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

March 4, 2011

Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga


Re: Pfohl Bros. Flow Data

Dear Mr. Pugh,


Enclosed for your review, please find a copy of the **February 2011 Direct Discharge Flow Data Report**, prepared by Jon W. Nichy.

Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.

Yours truly,

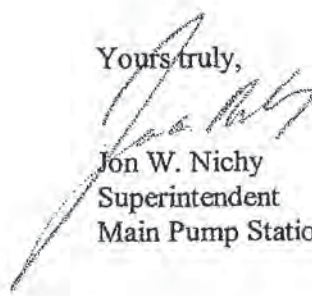
Jon W. Nichy
Superintendent
Main Pump Station

February
2011

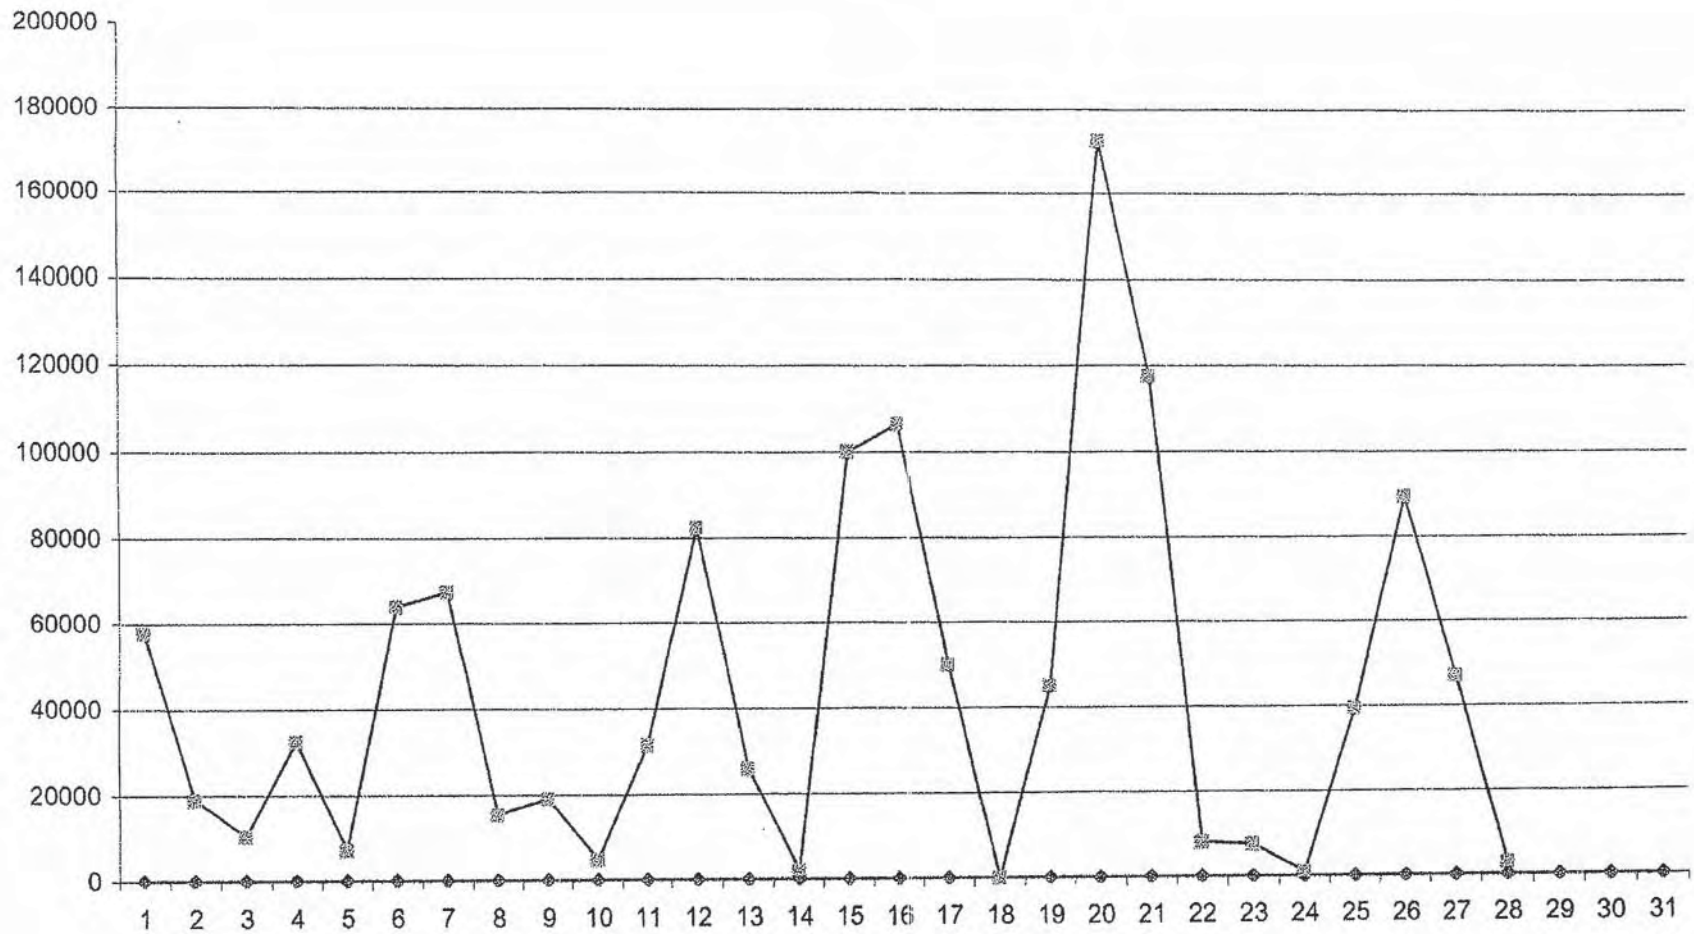

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

April 7, 2011

Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga


Re: Pfohl Bros. Flow Data

Dear Mr. Pugh,

Enclosed for your review, please find a copy of the **March 2011** Direct Discharge Flow Data Report, prepared by Jon W. Nichy.

Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.


Yours truly,

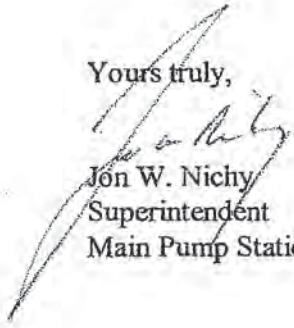
Jon W. Nichy
Superintendent
Main Pump Station

Direct Discharge Flow Data

2/28/2011		22102644	2,978	21,756,331	
March-11	Time; 11:58pm unless otherwise stated	Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	Notes
1		22207172	104,528	21,860,859	
2		22307220	100,048	21,960,907	
3		22350560	43,340	22,004,247	
4		22374134	23,574	22,027,821	
5		22393498	19,364	22,047,185	0808 inhibit
6		22460026	66,528	22,113,713	
7		22577854	117,828	22,231,541	1012 enable
8		22668590	90,736	22,322,277	
9		22749216	80,626	22,402,903	1612 inhibit
10		22749216	0	22,402,903	
11		22832130	82,914	22,485,817	0703 enable
12		22960570	128,440	22,614,257	
13		23049304	88,734	22,702,991	
14		23157148	107,844	22,810,835	
15		23199752	42,604	22,853,439	
16		23202972	3,220	22,856,659	
17		23260626	57,654	22,914,313	
18		23342804	82,178	22,996,491	
19		23366562	23,758	23,020,249	
20		23396444	29,882	23,050,131	
21		23403732	7,288	23,057,419	0146inhibit 2303enable
22		23524606	120,874	23,178,293	
23		23580432	55,826	23,234,119	
24		23606472	26,040	23,260,159	
25		23623642	17,170	23,277,329	
26		23712418	88,776	23,366,105	
27		23768006	55,588	23,421,693	
28		23787306	19,300	23,440,993	
29		23809722	22,416	23,463,409	
30		23904428	94,706	23,558,115	
31		24003900	99,472	23,657,587	
		1,901,256	1,901,256	1,901,256	

March
2011

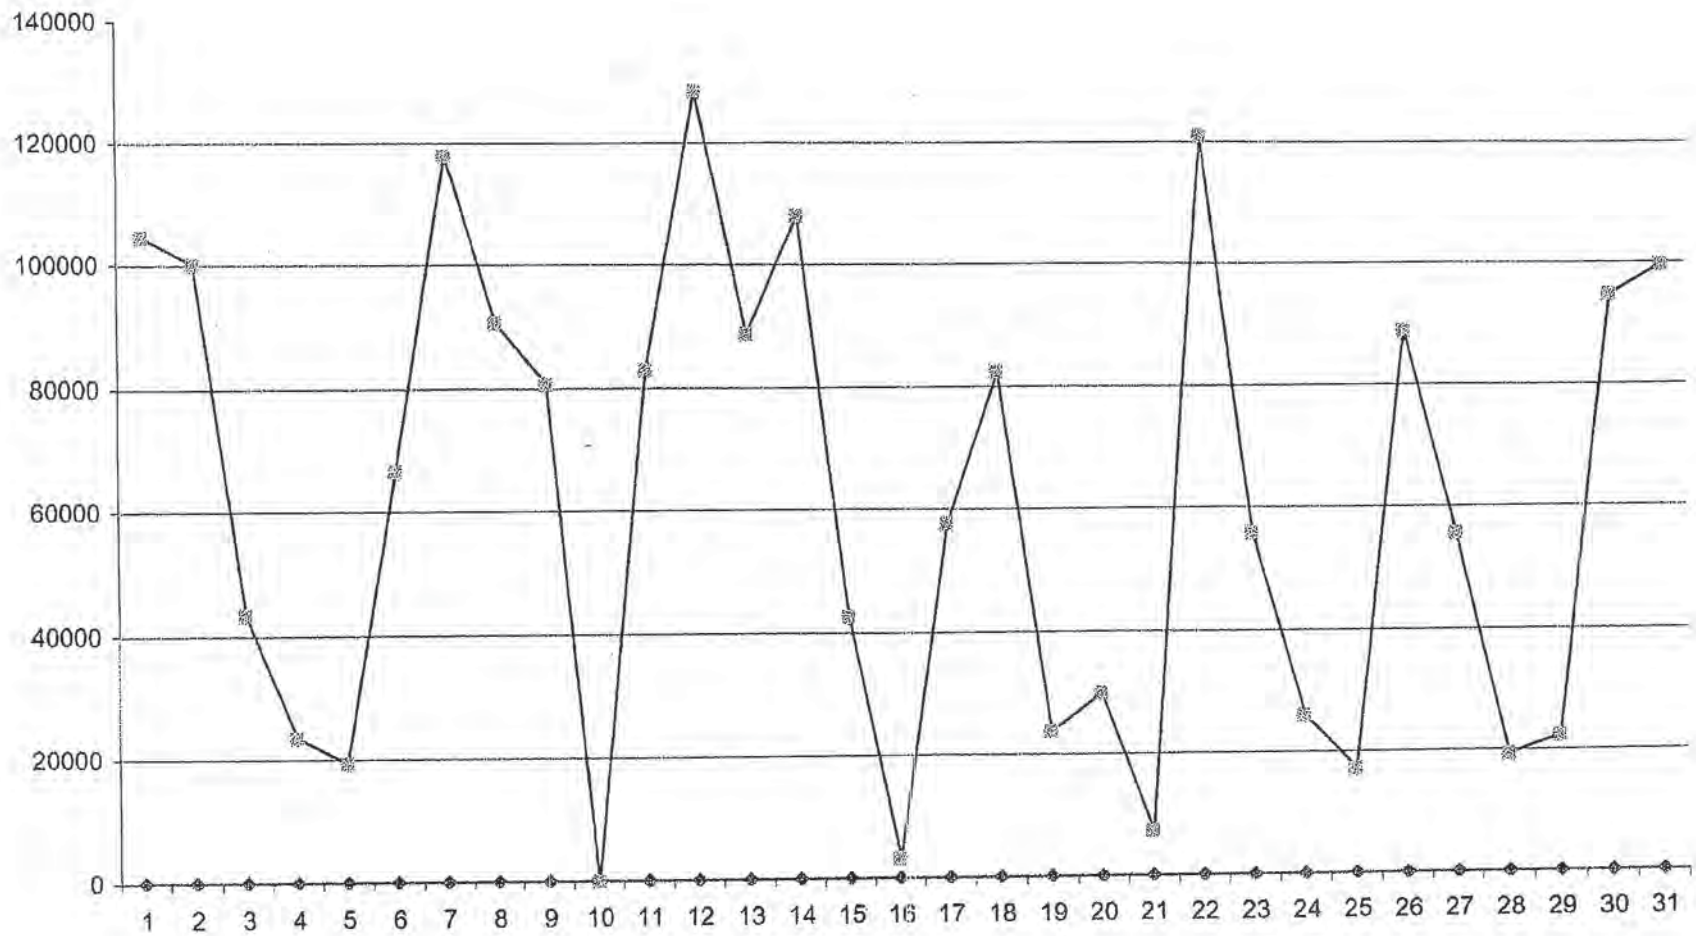

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

May 5, 2011

Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga


Re: Pfohl Bros. Flow Data

Dear Mr. Pugh,


Enclosed for your review, please find a copy of the **April 2011** Direct Discharge Flow Data Report, prepared by Jon W. Nichy.

Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.

Yours truly,

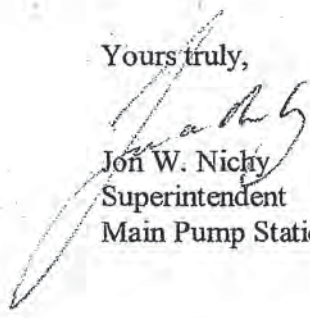
Jon W. Nichy
Superintendent
Main Pump Station

April
2011

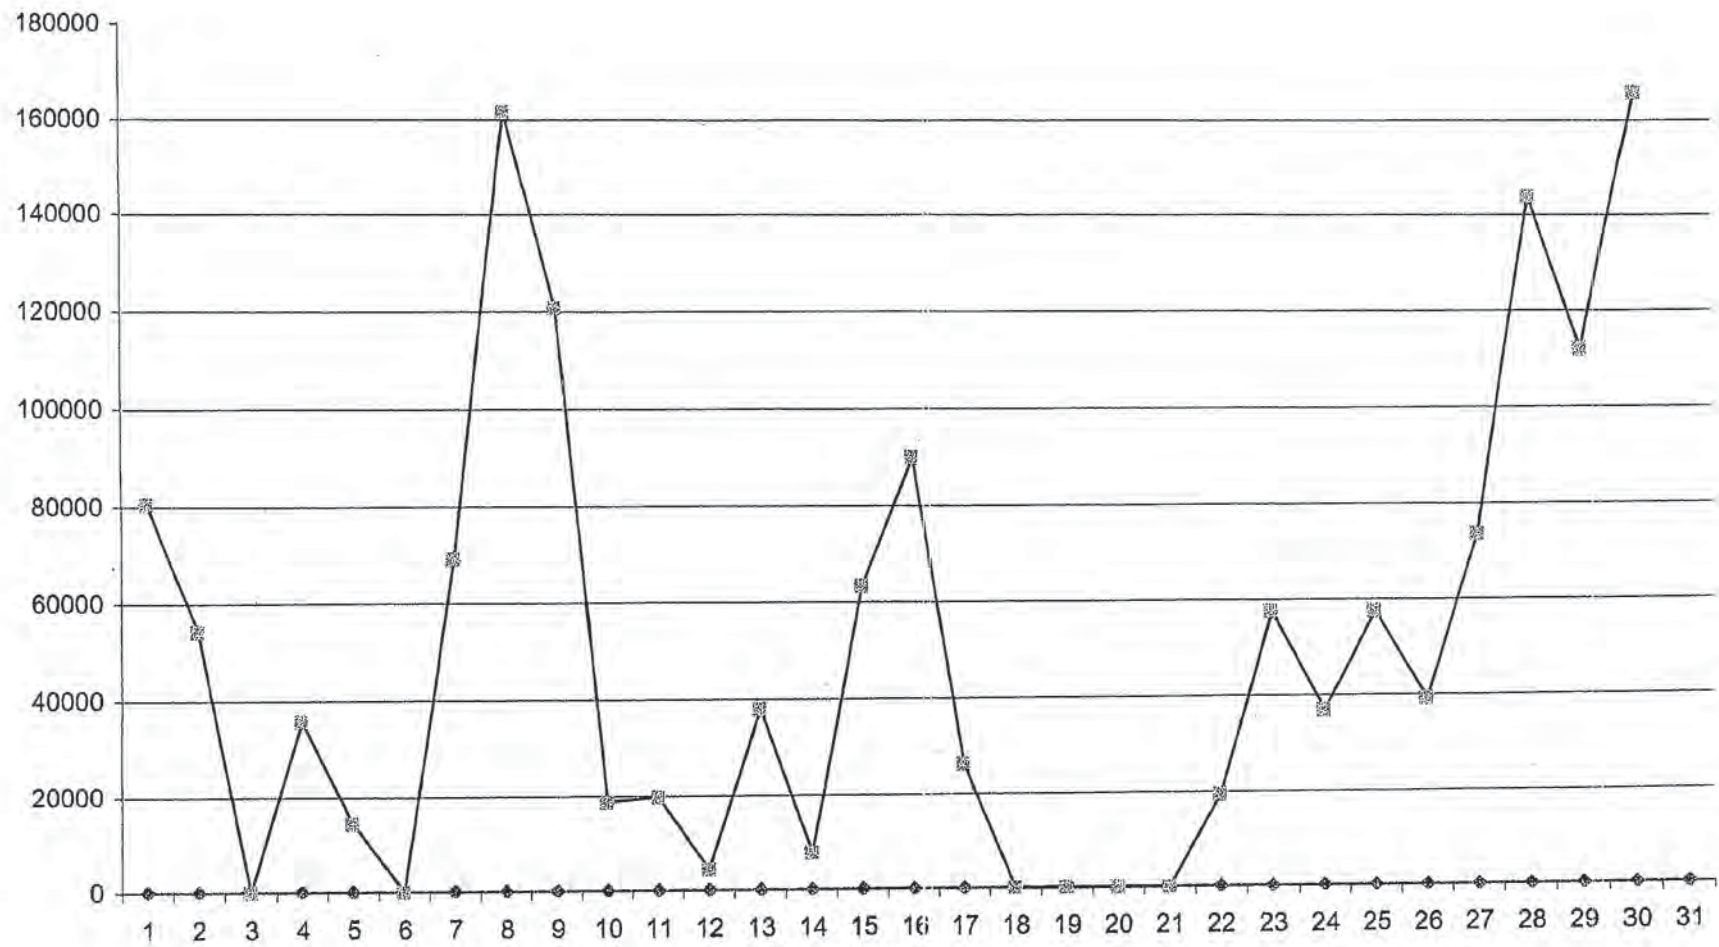

Direct Discharge Flow Data

3/31/2011		24003900	99,472	23,657,587	
April-11	Time; 11:58pm unless otherwise stated	Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	Notes
1		24084484	80,584	23,738,171	
2		24138716	54,232	23,792,403	
3		24138716	0	23,792,403	
4		24174630	35,914	23,828,317	0746 inhibit
5		24189062	14,432	23,842,749	
6		24189062	0	23,842,749	1426 enable
7		24258278	69,216	23,911,965	
8		24419806	161,528	24,073,493	
9		24540664	120,858	24,194,351	
10		24559456	18,792	24,213,143	
11		24579170	19,714	24,232,857	
12		24583550	4,380	24,237,237	
13		24621600	38,050	24,275,287	0422 inhibit
14		24629454	7,854	24,283,141	1241 enable
15		24692828	63,374	24,346,515	
16		24782802	89,974	24,436,489	1016 inhibit
17		24809178	26,376	24,462,865	
18		24809178	0	24,462,865	
19		24809178	0	24,462,865	
20		24809178	0	24,462,865	
21		24809178	0	24,462,865	1626 enable
22		24828668	19,490	24,482,355	
23		24886278	57,610	24,539,965	0724 inhibit 1559 enable
24		24923264	36,986	24,576,951	
25		24980864	57,600	24,634,551	1706 inhibit
26		25020154	39,290	24,673,841	1045 enable
27		25093654	73,500	24,747,341	
28		25237380	143,726	24,891,067	0110 inhibit 0935 enable
29		25349410	112,030	25,003,097	
30		25515210	165,800	25,168,897	
31					
		1,511,310	1,511,310	1,511,310	

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

June 4, 2011

Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga


Re: Pfohl Bros. Flow Data

Dear Mr. Pugh,

Enclosed for your review, please find a copy of the **May 2011** Direct Discharge Flow Data Report, prepared by Jon W. Nichy.

Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.

Yours truly,



Jon W. Nichy
Superintendent
Main Pump Station

Direct Discharge Flow Data

4/31/2011

May-11	Time; 11:58pm unless otherwise stated	25515210	165,800	25,168,897	Notes
		Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	
1		25515210	0	25,168,897	
2		25585022	69,812	25,238,709	0411inhibit 1707enable
3		25662106	77,084	25,315,793	1055inhibit
4		25726552	64,446	25,380,239	1343enable
5		25804074	77,522	25,457,761	
6		25976994	172,920	25,630,681	
7		26093892	116,898	25,747,579	
8		26104722	10,830	25,758,409	
9		26107448	2,726	25,761,135	
10		26151080	43,632	25,804,767	
11		26159096	8,016	25,812,783	
12		26180942	21,846	25,834,629	
13		26193182	12,240	25,846,869	
14		26193182	0	25,846,869	
15		26198304	5,122	25,851,991	0001inhibit
16		26198304	0	25,851,991	2311enable
17		26208068	9,764	25,861,755	
18		26377424	169,356	26,031,111	0913inhibit
19		26438474	61,050	26,092,161	1333enable
20		26517542	79,068	26,171,229	1447inhibit
21		26618732	101,190	26,272,419	1346enable
22		26697196	78,464	26,350,883	
23		26869996	172,800	26,523,683	
24		26975432	105,436	26,629,119	1247inhibit
25		26975522	90	26,629,209	
26		26975522	0	26,629,209	1414enable--2104inhibit
27		27002194	26,672	26,655,881	
28		27002194	0	26,655,881	
29		27002194	0	26,655,881	
30		27002194	0	26,655,881	1203enable
31		27091864	89,670	26,745,551	
		1,576,654	1,576,654	1,576,654	

May
2011

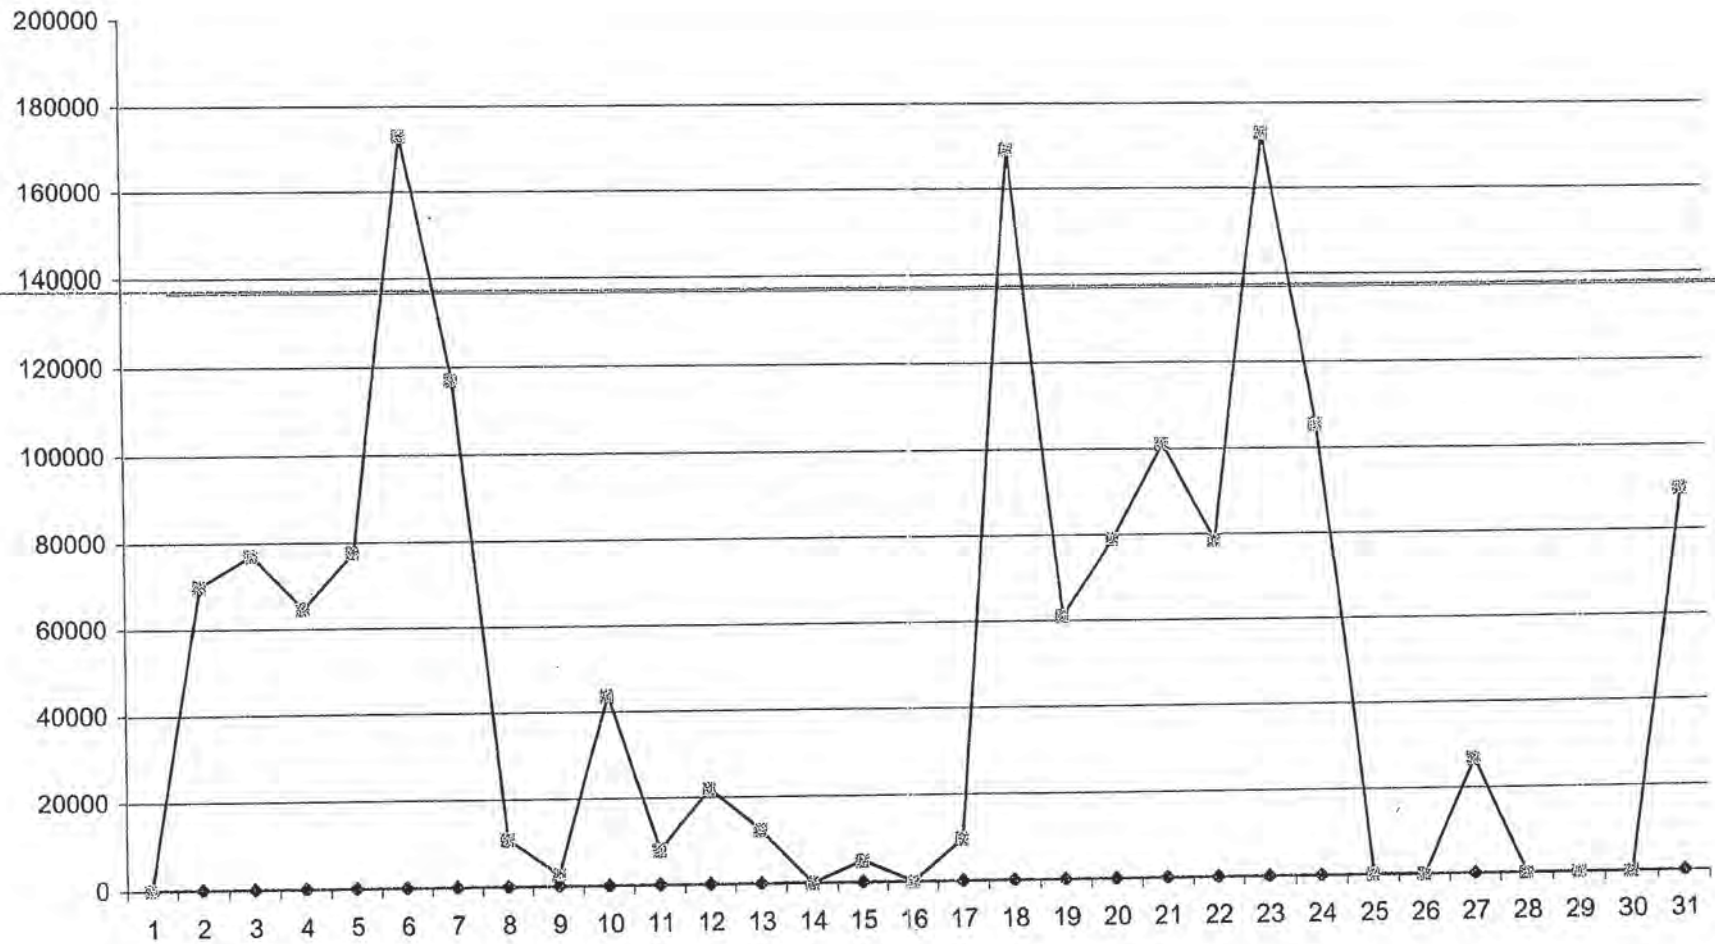

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

July 5, 2011

Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga

Re: Pfohl Bros. Flow Data


Dear Mr. Pugh,

Enclosed for your review, please find a copy of the **June 2011** Direct Discharge Flow Data Report, prepared by Jon W. Nichy.

On July 1, 2011 the Flow Totalizers were reset to zero.

Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.


Yours truly,


Jon W. Nichy
Superintendent
Main Pump Station

Direct Discharge Flow Data

5/31/2011		27091864	89,670	26,745,551	
June-11	Time; 11:58pm unless otherwise stated	Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	Notes
1		27264784	172,920	26,918,471	
2		27371556	106,772	27,025,243	
3		27431676	60,120	27,085,363	
4		27489326	57,650	27,143,013	1447inhibit
5		27523006	33,680	27,176,693	
6		27523006	0	27,176,693	
7		27523006	0	27,176,693	
8		27523006	0	27,176,693	
9		27523006	0	27,176,693	1125enable
10		27594844	71,838	27,248,531	
11		27724652	129,808	27,378,339	
12		27804212	79,560	27,457,899	
13		27840566	36,354	27,494,253	
14		27840566	0	27,494,253	
15		27840566	0	27,494,253	
16		27888798	48,232	27,542,485	
17		27914512	25,714	27,568,199	
18		27926016	11,504	27,579,703	
19		27952348	26,332	27,606,035	
20		28005518	53,170	27,659,205	
21		28034332	28,814	27,688,019	
22		28058012	23,680	27,711,699	0106inhibit
23		28066962	8,950	27,720,649	0942enable 1821off 2250on
24		28092334	25,372	27,746,021	1034inhibit
25		28115904	23,570	27,769,591	0832enable
26		28223364	107,460	27,877,051	
27		28325302	101,938	27,978,989	
28		28328184	2,882	27,981,871	
29		28339512	11,328	27,993,199	
30		28349550	10,038	28,003,237	
31					
		1,257,686	1,257,686	1,257,686	

June
2011

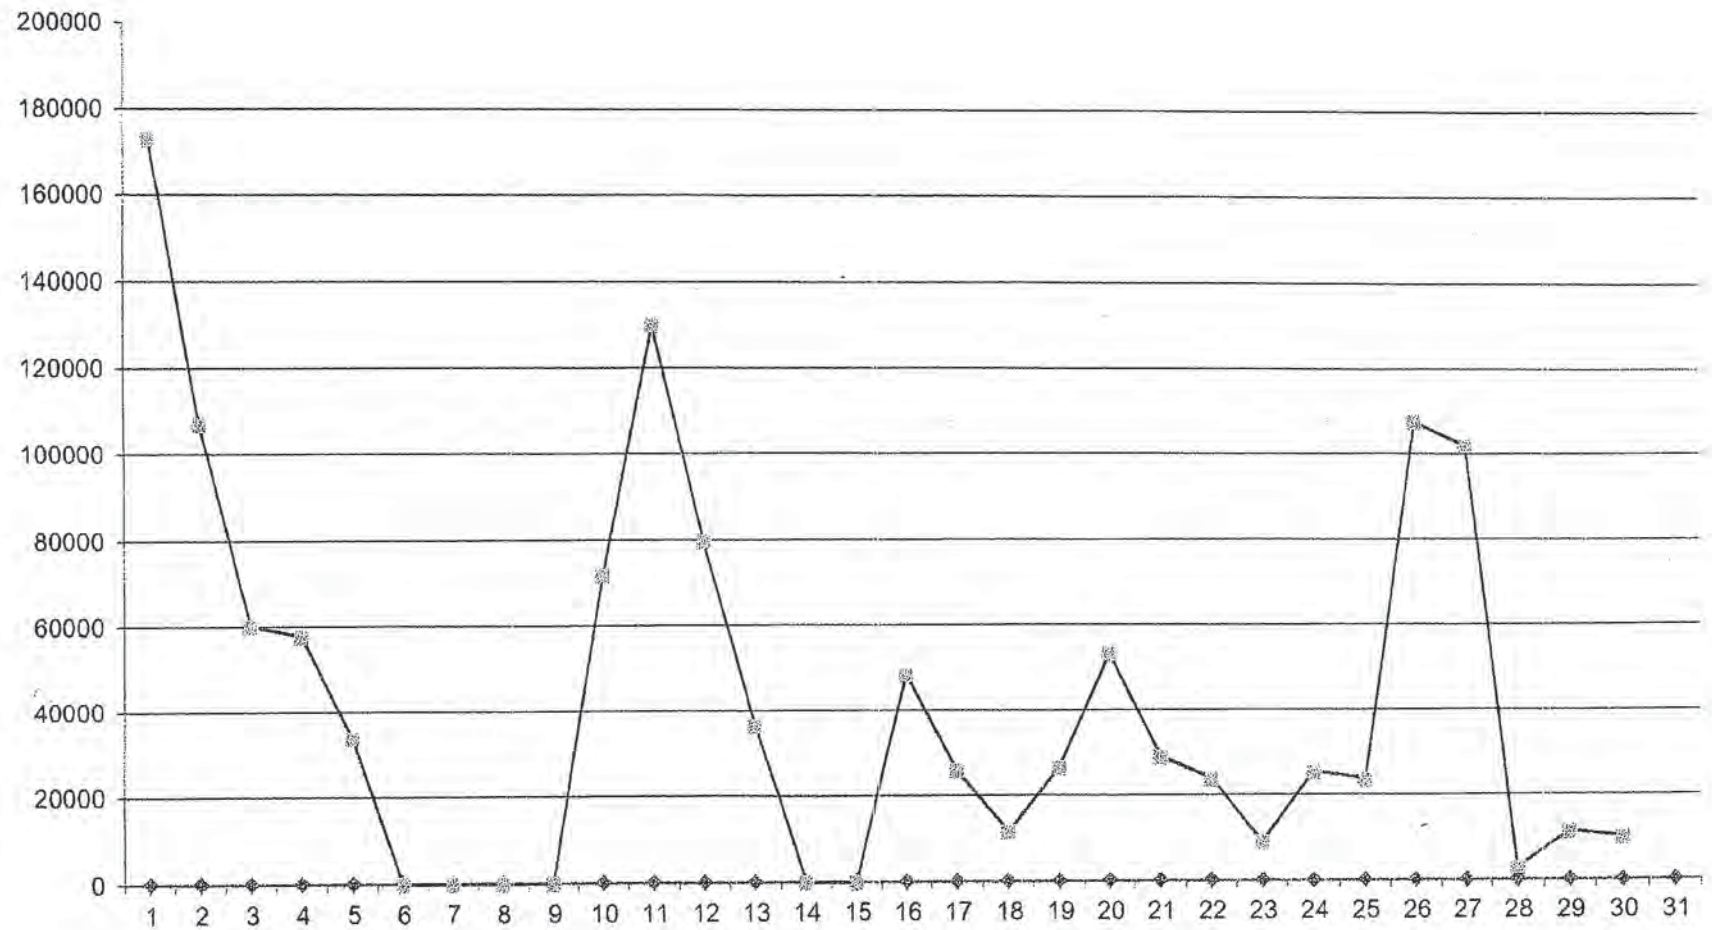

APPENDIX C

HYDRAULIC MONITORING TABLES

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JANUARY - JUNE 2011

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
GW-01D	1073088.634	1117968.213	694.41	NM	696.12	D	1						
MNW								3/30/2011 0000	2.38	693.74	0.00	693.74	
MNW								5/16/2011 0000	1.03	695.09	0.00	695.09	
MNW								6/23/2011 0000	2.81	693.31	0.00	693.31	
GW-01S	1073087.779	1117961.500	694.53	NM	696.19	S	1						
MNW								3/30/2011 0000	3.12	693.07	0.00	693.07	
MNW								5/16/2011 0000	1.95	694.24	0.00	694.24	
MNW								6/23/2011 0000	3.58	692.61	0.00	692.61	
GW-03D	1073819.106	1114602.426	692.35	NM	693.88	D	1						
MNW								3/30/2011 0000	1.90	691.98	0.00	691.98	
MNW								5/16/2011 0000	1.16	692.72	0.00	692.72	
MNW								6/23/2011 0000	4.85	689.03	0.00	689.03	
GW-03S	1073812.622	1114605.762	692.61	NM	693.80	S	1						
MNW								3/30/2011 0000	2.11	691.69	0.00	691.69	
MNW								5/16/2011 0000	2.02	691.78	0.00	691.78	
MNW								6/23/2011 0000	4.30	689.50	0.00	689.50	
GW-04D	1072289.432	1114685.625	690.89	NM	692.75	D	1						
MNW								3/30/2011 0000	12.55	680.20	0.00	680.20	
MNW								5/16/2011 0000	12.33	680.42	0.00	680.42	
MNW								6/23/2011 0000	12.62	680.13	0.00	680.13	
GW-04S	1072284.456	1114685.127	690.76	NM	692.72	S	1						
MNW								3/30/2011 0000	4.28	688.44	0.00	688.44	
MNW								5/16/2011 0000	3.96	688.76	0.00	688.76	
MNW								6/23/2011 0000	5.09	687.63	0.00	687.63	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH

MNW

SG

Manhole Monitoring Point

Monitoring Well

Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JANUARY - JUNE 2011

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
GW-07D	1071242.458	1117669.925	697.15	NM	699.94	D	1						
MNW								3/30/2011 0000	48.00	651.94	0.00	651.94	
MNW								5/16/2011 0000	44.77	655.17	0.00	655.17	
MNW								6/23/2011 0000	57.34	642.60	0.00	642.60	
GW-07S	1071238.157	1117666.265	697.47	NM	699.51	S	1						
MNW								3/30/2011 0000	5.21	694.30	0.00	694.30	
MNW								5/16/2011 0000	3.83	695.68	0.00	695.68	
MNW								6/23/2011 0000	5.00	694.51	0.00	694.51	
GW-08D	1073713.617	1116795.328	695.28	NM	697.79	D	1						
MNW								3/30/2011 0000	5.58	692.21	0.00	692.21	
MNW								5/16/2011 0000	5.07	692.72	0.00	692.72	
MNW								6/23/2011 0000	5.85	691.94	0.00	691.94	
GW-08SR	1073714.172	1116786.343	695.08	NM	697.50	S	1						
MNW								3/30/2011 0000	5.17	692.33	0.00	692.33	
MNW								5/16/2011 0000	4.74	692.76	0.00	692.76	
MNW								6/23/2011 0000	5.20	692.30	0.00	692.30	
GW-26D	1071698.573	1115997.470	696.01	NM	698.50	D	1						
MNW								3/30/2011 0000	6.73	691.77	0.00	691.77	
MNW								5/16/2011 0000	5.97	692.53	0.00	692.53	
MNW								6/23/2011 0000	6.69	691.81	0.00	691.81	
GW-28S	1073129.479	1117648.927	698.60	NM	700.95	S	1						
MNW								3/30/2011 0000	8.35	692.60	0.00	692.60	
MNW								5/16/2011 0000	8.31	692.64	0.00	692.64	
MNW								6/23/2011 0000	9.75	691.20	0.00	691.20	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH

MNW

SG

Manhole Monitoring Point

Monitoring Well

Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JANUARY - JUNE 2011

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
GW-29S	1072552.638	1117761.993	697.50	NM	699.63	S	1						
MNW								3/30/2011 0000	7.09	692.54	0.00	692.54	
MNW								5/16/2011 0000	5.65	693.98	0.00	693.98	
MNW								6/23/2011 0000	9.05	690.58	0.00	690.58	
GW-30S	1072096.109	1117743.563	693.67	NM	696.58	S	1						
MNW								3/30/2011 0000	7.82	688.76	0.00	688.76	
MNW								5/16/2011 0000	4.81	691.77	0.00	691.77	
MNW								6/23/2011 0000	7.96	688.62	0.00	688.62	
GW-31S	1071786.280	1117191.441	695.84	NM	698.62	S	1						
MNW								3/30/2011 0000	NM	-	NM	-	Frozen @2.50'
MNW								5/16/2011 0000	2.03	696.59	0.00	696.59	
MNW								6/23/2011 0000	3.92	694.70	0.00	694.70	
GW-32S	1071613.793	1116364.200	696.19	NM	698.37	S	1						
MNW								3/30/2011 0000	2.34	696.03	0.00	696.03	
MNW								5/16/2011 0000	1.83	696.54	0.00	696.54	
MNW								6/23/2011 0000	3.82	694.55	0.00	694.55	
GW-33S	1072165.625	1115561.866	695.94	NM	698.24	S	1						
MNW								3/30/2011 0000	3.22	695.02	0.00	695.02	
MNW								5/16/2011 0000	2.75	695.49	0.00	695.49	
MNW								6/23/2011 0000	5.98	692.26	0.00	692.26	
GW-34S	1072979.205	1114730.200	692.51	NM	694.77	S	1						
MNW								3/30/2011 0000	2.53	692.24	0.00	692.24	
MNW								5/16/2011 0000	2.58	692.19	0.00	692.19	
MNW								6/23/2011 0000	2.64	692.13	0.00	692.13	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH	Manhole Monitoring Point
MNW	Monitoring Well
SG	Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JANUARY - JUNE 2011

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
GW-35S	1071701.925	1115985.585	696.19	NM	697.39	S	1						
MNW								3/30/2011 0000	2.87	694.52	0.00	694.52	
MNW								5/16/2011 0000	2.68	694.71	0.00	694.71	
MNW								6/23/2011 0000	4.02	693.37	0.00	693.37	
MH-01	1073806.665	1114810.501	698.62	NM	698.62	NA	1						
MH								3/30/2011 0000	10.18	688.44	0.00	688.44	
MH								5/16/2011 0000	9.07	689.55	0.00	689.55	
MH								6/23/2011 0000	9.95	688.67	0.00	688.67	
MH-03	1073736.789	1115259.334	699.40	NM	699.40	NA	1						
MH								3/30/2011 0000	11.05	688.35	0.00	688.35	
MH								5/16/2011 0000	9.92	689.48	0.00	689.48	
MH								6/23/2011 0000	10.85	688.55	0.00	688.55	
MH-07	1073838.229	1116243.757	696.82	NM	696.82	NA	1						
MH								3/30/2011 0000	9.23	687.59	0.00	687.59	
MH								5/16/2011 0000	8.19	688.63	0.00	688.63	
MH								6/23/2011 0000	9.06	687.76	0.00	687.76	
MH-10	1073540.729	1117381.524	703.01	NM	703.01	NA	1						
MH								3/30/2011 0000	14.52	688.49	0.00	688.49	
MH								5/16/2011 0000	14.58	688.43	0.00	688.43	
MH								6/23/2011 0000	14.82	688.19	0.00	688.19	
MH-15	1072531.567	1117761.125	699.02	NM	699.02	NA	1						
MH								3/30/2011 0000	14.68	684.34	0.00	684.34	
MH								5/16/2011 0000	12.95	686.07	0.00	686.07	
MH								6/23/2011 0000	15.00	684.02	0.00	684.02	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH

MNW

SG

Manhole Monitoring Point

Monitoring Well

Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JANUARY - JUNE 2011

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
MH-16 MH	1072133.714	1117748.238	698.57	NM	698.57	NA	1	3/30/2011 0000	14.39	684.18	0.00	684.18	
								5/16/2011 0000	12.43	686.14	0.00	686.14	
								6/23/2011 0000	14.60	683.97	0.00	683.97	
MH-17 MH	1071813.137	1117180.019	702.16	NM	702.16	NA	1	3/30/2011 0000	18.10	684.06	0.00	684.06	
								5/16/2011 0000	16.01	686.15	0.00	686.15	
								6/23/2011 0000	18.25	683.91	0.00	683.91	
MH-20 MH	1071756.395	1115997.024	706.20	NM	706.20	NA	1	3/30/2011 0000	19.76	686.44	0.00	686.44	
								5/16/2011 0000	19.45	686.75	0.00	686.75	
								6/23/2011 0000	19.72	686.48	0.00	686.48	
MH-22 MH	1072158.023	1115589.309	698.05	NM	698.05	NA	1	3/30/2011 0000	8.99	689.06	0.00	689.06	
								5/16/2011 0000	8.38	689.67	0.00	689.67	
								6/23/2011 0000	9.02	689.03	0.00	689.03	
MH-25 MH	1072483.928	1114820.313	698.17	NM	698.17	NA	1	3/30/2011 0000	9.63	688.54	0.00	688.54	
								5/16/2011 0000	8.53	689.64	0.00	689.64	
								6/23/2011 0000	9.54	688.63	0.00	688.63	
SG-01 SG	1073882.887	1114813.101	NM	NM	690.00	NA	1	3/30/2011 0000	-1.20	691.20	0.00	691.20	
								5/16/2011 0000	-1.70	691.70	0.00	691.70	
								6/23/2011 0000	-1.12	691.12	0.00	691.12	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH

MNW

SG

Manhole Monitoring Point

Monitoring Well

Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JANUARY - JUNE 2011

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
SG-02	1073738.27	1116805.85	NM	NM	690.00	NA	1						
SG								3/30/2011 0000	-3.34	693.34	0.00	693.34	
SG								5/16/2011 0000	-3.80	693.80	0.00	693.80	
SG								6/23/2011 0000	-3.3	693.30	0.00	693.30	
WW-01	1073676.903	1115710.476	NM	NM	684.02	NA	1						
MH								3/30/2011 0000	-4.2	688.22	0.00	688.22	
MH								5/16/2011 0000	-5.3	689.32	0.00	689.32	
MH								6/23/2011 0000	NM	-	NM	-	PLC ERROR
WW-02	1073684.724	1116792.311	NM	NM	684.18	NA	1						
MH								3/30/2011 0000	-4.6	688.78	0.00	688.78	
MH								5/16/2011 0000	-4.5	688.68	0.00	688.68	
MH								6/23/2011 0000	-4.4	688.58	0.00	688.58	
WW-03	1073140.339	1117618.499	NM	NM	683.80	NA	1						
MH								3/30/2011 0000	-5.6	689.40	0.00	689.40	
MH								5/16/2011 0000	-5.8	689.60	0.00	689.60	
MH								6/23/2011 0000	-5.7	689.50	0.00	689.50	
WW-04	1072057.563	1117610.508	NM	NM	676.62	NA	1						
MH								3/30/2011 0000	-7.0	683.62	0.00	683.62	
MH								5/16/2011 0000	-9.0	685.62	0.00	685.62	
MH								6/23/2011 0000	-6.9	683.52	0.00	683.52	
WW-05	1071661.368	1116370.876	NM	NM	676.14	NA	1						
MH								3/30/2011 0000	-5.6	681.74	0.00	681.74	
MH								5/16/2011 0000	-9.8	685.94	0.00	685.94	
MH								6/23/2011 0000	-7.6	683.74	0.00	683.74	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH

MNW

SG

Manhole Monitoring Point

Monitoring Well

Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JANUARY - JUNE 2011

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
WW-06	1072988.420	1114811.518	NM	NM	681.89	NA	1						
MH								3/30/2011 0000	-7.1	688.99	0.00	688.99	
MH								5/16/2011 0000	-8.3	690.19	0.00	690.19	
MH								6/23/2011 0000	-7.1	688.99	0.00	688.99	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH	Manhole Monitoring Point
MNW	Monitoring Well
SG	Staff Gauge

TABLE 2
PFOHL BROTHERS LANDFILL SITE
OVERBURDEN HYDRAULIC GRADIENT

WELL PAIR:	WW-1	*	Level	WW-2	GW-8SR	Level	SG-02	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft)
3/30/2011	688.42	---	---	688.78	692.33	3.55	693.34	4.56
5/16/2011	689.32	---	---	688.68	692.76	4.08	693.80	5.12
6/23/2011	PLC Error	---	---	688.58	692.30	3.72	693.30	4.72

WELL PAIR:	WW-3	GW-28S	Level	WW-4	*	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)
3/30/2011	689.40	692.60	3.20	683.62	---	---
5/16/2011	689.60	692.64	3.04	685.62	---	---
6/23/2011	689.50	691.20	1.70	683.52	---	---

WELL PAIR:	WW-5	GW-32S	Level	WW-6	GW-34S	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)
3/30/2011	681.74	696.03	14.29	688.99	692.24	3.25
5/16/2011	685.94	696.54	10.60	690.19	692.19	2.00
6/23/2011	683.74	694.55	10.81	688.99	692.13	3.14

WELL PAIR:	MH-1	SG-1	Level	MH-15	GW-29S	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)
3/30/2011	688.44	691.20	2.76	684.34	692.54	8.20
5/16/2011	689.55	691.70	2.15	686.07	693.98	7.91
6/23/2011	688.67	691.12	2.45	684.02	690.58	6.56

WELL PAIR:	MH-16	GW-30S	Level	MH-17	GW-31S	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)
3/30/2011	684.18	688.76	4.58	684.06	NM	NA
5/16/2011	686.14	691.77	5.63	686.15	696.59	10.44
6/23/2011	683.97	688.62	4.65	683.91	694.70	10.79

WELL PAIR:	MH-20	GW-35S	Level	MH-22	GW-33S	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)
3/30/2011	686.44	694.52	8.08	689.06	695.02	5.96
5/16/2011	686.75	694.71	7.96	689.67	695.49	5.82
6/23/2011	686.48	693.37	6.89	689.03	692.26	3.23

Notes:

* = No corresponding monitoring well.
NA = Not applicable

APPENDIX D

**GROUNDWATER PURGE AND SAMPLE COLLECTION
LOGS**

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-1S

Date: 5/17/2011 Sampling Personnel: Rob Murphy, Kevin McGovern Company: URS Corporation

Purging/ Sampling				Pump/Tubing Inlet	
Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Location:	Screen midpoint

Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.21'	Depth to Well Bottom:	14.94'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	7.9	Estimated Purge Volume (liters):	6.7
--------------	-----------------	-----------------------------------	-----	----------------------------------	-----

Sample ID:	GW-1S	Sample Time:	12:37	QA/QC:	None
------------	-------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information: Riser pipe is bulged inwards, could not remove stainless steel bailer from within well, sampled around it. Orange floc. in water initially.

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($\text{vol}_{\text{cyl}} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-1D

Date: 5/17/2011 Sampling Personnel: Rob Murphy, Kevin McGovern Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	1.45'	Depth to Well Bottom:	39.65'	Well Diameter:	4"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	94.4	Estimated Purge Volume (liters):	70.0
--------------	-----------------	-----------------------------------	------	----------------------------------	------

Sample ID:	GW-1D	Sample Time:	14:02	QA/QC:	None
------------	-------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information: Sulfur odor

Dark Tint

PURGE PARAMETERS

TIME	pH	TEMP (°C)	COND. (mS/cm)	DISS. O ₂ (mg/l)	TURB. (NTU)	ORP (mV)	FLOW RATE (ml/min.)	DEPTH TO WATER (btor)
12:52	7.41	9.80	0.820	0.84	18	-107.3	1000	1.45
12:57	7.41	9.82	0.818	0.15	2	-123.9	1000	1.54
13:02	7.41	9.76	0.817	0.12	2	-138.3	1000	1.54
13:07	7.41	9.63	0.814	0.10	2	-147.8	1000	1.54
13:12	7.41	9.57	0.813	0.10	1	-160.3	1000	1.54
13:17	7.40	9.50	0.811	0.11	1	-184.4	1000	1.54
13:22	7.38	9.44	0.809	0.06	1	-203.2	1000	1.54
13:27	7.38	9.36	0.806	0.05	1	-219.8	1000	1.54
13:32	7.37	9.39	0.807	0.04	1	-232.9	1000	1.54
13:37	7.36	9.38	0.806	0.03	1	-244.3	1000	1.54
13:42	7.35	9.34	0.805	0.01	1	-257.8	1000	1.54
13:47	7.34	9.27	0.803	0.01	1	-273.7	1000	1.54
13:52	7.34	9.31	0.804	0.01	1	-279.8	1000	1.54
13:57	7.34	9.28	0.803	0.00	1	-284.5	1000	1.54
14:02	7.34	9.28	0.803	0.00	1	-287.3	1000	1.54
Tolerance:	0.1	---	3%	10%	10%	+ or - 10	---	

Information: WATER VOLUMES—0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($\text{vol}_{\text{cyl}} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-3S

Date: 5/16/2011 Sampling Personnel: Rob Murphy, Kevin McGovern Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.02'	Depth to Well Bottom:	13.22'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	6.9	Estimated Purge Volume (liters):	6.1
--------------	-----------------	-----------------------------------	-----	----------------------------------	-----

Sample ID:	GW-3S	Sample Time:	15:15	QA/QC:	None
------------	-------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES—0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($\text{vol}_{\text{cyl}} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-3D

Date: 5/16/2011 Sampling Personnel: Rob Murphy, Kevin McGovern Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	1.28'	Depth to Well Bottom:	35.70'	Well Diameter:	4"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	85.0	Estimated Purge Volume (liters):	45.0
--------------	-----------------	-----------------------------------	------	----------------------------------	------

Sample ID:	GW-3D	Sample Time:	14:15	QA/QC:	MS/MSD
------------	-------	--------------	-------	--------	--------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES—0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($\text{vol}_{\text{cyl}} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-4S

Date: 5/17/2011 Sampling Personnel: Rob Murphy, Kevin McGovern Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	3.73'	Depth to Well Bottom:	16.23'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	7.7	Estimated Purge Volume (liters):	25.0
--------------	-----------------	-----------------------------------	-----	----------------------------------	------

Sample ID:	GW-4S	Sample Time:	9:20 VOCs/ 11:25 SVOCs & Metals	QA/QC:	None
------------	-------	--------------	------------------------------------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information: Placed passive diffusion bag (PDB) in well 4/26/11, sampled VOCs from PDB at 9:20 on 5/17/11
Well historically goes dry at very low purge rates (<75ml/min). Pumped dry and sampled for SVOCs and Metals after recovery at 11:25.

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES—0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($\text{vol}_{\text{cyl}} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-4D

Date: 5/17/2011 Sampling Personnel: Rob Murphy, Kevin McGovern Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	12.44'	Depth to Well Bottom:	45.57'	Well Diameter:	4"	Screen Length:	
------------------	--------------------	-------------------------	--------	-----------------------	--------	----------------	----	----------------	--

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	81.8	Estimated Purge Volume (liters):	10.6
--------------	-----------------	-----------------------------------	------	----------------------------------	------

Sample ID: GW-4D Sample Time: 11:04 QA/QC: None

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information: _____

PURGE PARAMETERS

	TIME	pH	TEMP (°C)	COND. (mS/cm)	DISS. O ₂ (mg/l)	TURB. (NTU)	ORP (mV)	FLOW RATE (ml/min.)	DEPTH TO WATER (btor)
	10:08	7.56	8.89	0.950	3.56	5.9	-100.2	190	12.44
	10:13	7.51	9.11	0.975	0.69	1.6	-116.5	190	13.04
	10:18	7.51	9.13	0.976	0.45	1.7	-120.4	190	13.21
	10:23	7.50	9.13	0.976	0.34	1.5	-126.7	190	13.35
	10:28	7.49	9.06	0.975	0.31	1.5	-133.3	190	13.46
	10:33	7.49	9.06	0.976	0.29	1.5	-138.0	190	13.55
	10:38	7.48	9.06	0.977	0.26	1.0	-145.0	190	13.66
	10:43	7.48	9.12	0.978	0.23	1.0	-150.3	190	13.76
	10:48	7.48	9.11	0.978	0.21	1.0	-158.0	190	13.86
	10:53	7.46	9.16	0.981	0.20	1.0	-165.9	190	13.97
	10:58	7.46	9.29	0.986	0.16	1.0	-180.7	190	14.00
	11:01	7.45	9.27	0.987	0.17	1.0	-185.4	190	14.03
	11:04	7.42	9.25	0.995	0.14	1.0	-190.7	190	14.06
Tolerance:	0.1	---	3%	10%	10%	+ or - 10	---		

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft; 4 inch diameter well = 2470 ml/ft ($\text{vol}_{\text{cyl}} = \pi r^2 h$)

WELL PURGING LOG

URS Corporation

SITE NAME:	Pfohl Brothers Landfill	WELL NO.:	GW-7S
PROJECT NO.:	11175616.00000		
STAFF:	Rob Murphy, Kevin McGovern		
DATE(S):	5/16/2011, 5/17/11		

			WELL ID.	VOL. (GAL/FT)
1. TOTAL CASING AND SCREEN LENGTH (FT.)	=	35.04	1"	0.040
2. WATER LEVEL BELOW TOP OF CASING (FT.)	=	3.83	2"	0.17
3. NUMBER OF FEET STANDING WATER (#1 - #2)	=	31.21	3"	0.38
4. VOLUME OF WATER/FOOT OF CASING (GAL.)	=	0.17	4"	0.66
5. VOLUME OF WATER IN CASING (GAL.)(#3 x #4)	=	5.3	5"	1.04
6. VOLUME OF WATER TO REMOVE (GAL.)(#5 x 3)	=		6"	1.50
7. VOLUME OF WATER ACTUALLY REMOVED (GAL.)	=	8.0	8"	2.60

V=0.0408 x (CASING DIAMETER [INCHES])²

PARAMETERS	ACCUMULATED VOLUME PURGED (GALLONS)										
	Initial	3.0	5.0	7.0	8.0						
pH	8.16	8.14	8.05	8.06	8.07						
SPEC. COND. (mS/cm)	0.458	0.435	0.443	0.446	0.448						
DO (mg/l)	8.26	9.47	6.07	10.19	10.20						
TEMPERATURE (°C)	10.21	8.82	9.88	10.07	10.08						
TURBIDITY (NTU)	8.0	6.6	32.2	108	122						
ORP (millivolts)	-76.8	-38.2	-22.9	-98.2	-102.6						
TIME	11:47	11:53	11:58	12:07	12:15						

COMMENTS: 11:40 - Fill VOCs from passive diffusion bag (PDB), PDB was installed back on 4/26/11
 11:47 - Begin handbailing well.
 12:15 - Well dry after removing 8.0 gallons
 5/17/2011 16:55 - return to well, depth to water = 3.83 feet.
 17:50 - Collect sample for SVOCs and Metals.

WELL PURGING LOG

URS Corporation

SITE NAME:	Pfohl Brothers Landfill	WELL NO.:	GW-7D
PROJECT NO.:	11175616.00000		
STAFF:	Rob Murphy, Kevin McGovern		
DATE(S):	5/16/11, 5/17/11		

			WELL ID.	VOL. (GAL/FT)
1. TOTAL CASING AND SCREEN LENGTH (FT.)	=	60.45	1"	0.040
2. WATER LEVEL BELOW TOP OF CASING (FT.)	=	44.77	2"	0.17
3. NUMBER OF FEET STANDING WATER (#1 - #2)	=	15.68	3"	0.38
4. VOLUME OF WATER/FOOT OF CASING (GAL.)	=	0.66	4"	0.66
5. VOLUME OF WATER IN CASING (GAL.)(#3 x #4)	=	10.3	5"	1.04
6. VOLUME OF WATER TO REMOVE (GAL.)(#5 x 3)	=		6"	1.50
7. VOLUME OF WATER ACTUALLY REMOVED (GAL.)	=	10.5	8"	2.60

V=0.0408 x (CASING DIAMETER [INCHES])²

PARAMETERS	ACCUMULATED VOLUME PURGED (GALLONS)										
	Init	3	6	9	10.5						
pH	8.30	8.00	7.98	8.02	8.22						
SPEC. COND. (mS/cm)	0.570	0.525	0.571	0.613	0.647						
DO (mg/)	4.99	7.67	7.44	8.09	7.40						
TEMPERATURE (°C)	11.03	11.00	10.97	10.82	10.47						
TURBIDITY (NTU)	10.0	25	21	32.7	34.8						
ORP (millivolts)	36.4	-31.9	-102.2	-127.6	-115.5						
TIME	10:40	10:52	11:02	11:14	11:30						

COMMENTS: 10:25 - Fill VOCs from passive diffusion bag (PDB), PDB was installed back on 4/26/11
 10:40 - Begin handbailing well.
 11:30 - Well dry after removing 10.5 gallons
 5/17/2011 16:55 - return to well, depth to water = 59.59 feet.
 17:05 - Collect sample for SVOCs and Metals, only enough volume to fill 1 metals container and 1-1 liter Amber container.

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-8SR

Date: 5/16/2011 Sampling Personnel: Rob Murphy, Kevin McGovern Company: URS Corporation

Purging/
Sampling
Device: Geopump 2 Tubing Type: LDPE/Silicone Pump/Tubing
Inlet
Location: Screen midpoint

Measuring Point:	Below Top of Riser	Initial Depth to Water:	4.76'	Depth to Well Bottom:	13.02'	Well Diameter:	2"	Screen Length:	
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------	--

Casing Type:	<u>Stainless Steel</u>	Volume in 1 Well Casing (liters):	<u>5.1</u>	Estimated Purge Volume (liters):	<u>7.7</u>
--------------	------------------------	-----------------------------------	------------	----------------------------------	------------

Sample ID:	GW-8SR	Sample Time:	17:25	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft; 4 inch diameter well = 2470 ml/ft ($\text{vol}_{\text{cyl}} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-8D

Date: 5/16/2011 Sampling Personnel: Rob Murphy, Kevin McGovern Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	5.06'	Depth to Well Bottom:	36.54'	Well Diameter:	4"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	77.8	Estimated Purge Volume (liters):	40.0
--------------	-----------------	-----------------------------------	------	----------------------------------	------

Sample ID:	GW-8D	Sample Time:	16:35	QA/QC:	Duplicate (ID=Duplicate)
------------	-------	--------------	-------	--------	--------------------------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES—0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($\text{vol}_{\text{cyl}} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-26D

Date: 5/18/2011 Sampling Personnel: Rob Murphy, Kevin McGovern Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	6.33'	Depth to Well Bottom:	40.70'	Well Diameter:	4"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	84.9	Estimated Purge Volume (liters):	40.0
--------------	-----------------	-----------------------------------	------	----------------------------------	------

Sample ID:	GW-26D	Sample Time:	13:10	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

Occasional pulses of iron stained particulates in purge water.

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES—0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($\text{vol}_{\text{cyl}} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-28S

Date: 5/17/2011 Sampling Personnel: Rob Murphy, Kevin McGovern Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	7.81'	Depth to Well Bottom:	15.54'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	4.8	Estimated Purge Volume (liters):	7.2
--------------	-----------------	-----------------------------------	-----	----------------------------------	-----

Sample ID:	GW-28S	Sample Time:	15:05	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES—0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($\text{vol}_{\text{cyl}} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-29S

Date: 5/17/2011 Sampling Personnel: Rob Murphy, Kevin McGovern Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	5.70'	Depth to Well Bottom:	20.02'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	8.8	Estimated Purge Volume (liters):	10.3
--------------	-----------------	-----------------------------------	-----	----------------------------------	------

Sample ID:	GW-29S	Sample Time:	16:25	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES—0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($\text{vol}_{\text{cyl}} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-30S

Date: 5/18/2011 Sampling Personnel: Rob Murphy, Kevin McGovern Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	7.25'	Depth to Well Bottom:	17.97'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	6.6	Estimated Purge Volume (liters):	25.0
--------------	-----------------	-----------------------------------	-----	----------------------------------	------

Sample ID:	GW-30S	Sample Time:	8:29	QA/QC:	None
------------	--------	--------------	------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft; 4 inch diameter well = 2470 ml/ft ($\text{vol}_{\text{cyl}} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-31S

Date: 5/18/2011 Sampling Personnel: Rob Murphy, Kevin McGovern Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.06'	Depth to Well Bottom:	9.57'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	-------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	4.6	Estimated Purge Volume (liters):	6.2
--------------	-----------------	-----------------------------------	-----	----------------------------------	-----

Sample ID:	GW-31S	Sample Time:	9:35	QA/QC:	None
------------	--------	--------------	------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES—0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($\text{vol}_{\text{cyl}} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-32S

Date: 5/18/2011 Sampling Personnel: Rob Murphy, Kevin McGovern Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.00'	Depth to Well Bottom:	9.93'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	-------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	4.9	Estimated Purge Volume (liters):	7.7
--------------	-----------------	-----------------------------------	-----	----------------------------------	-----

Sample ID:	GW-32S	Sample Time:	10:57	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES—0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($\text{vol}_{\text{cyl}} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-33S

Date: 5/18/2011 Sampling Personnel: Rob Murphy, Kevin McGovern Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.83'	Depth to Well Bottom:	8.21'	Well Diameter:	2"	Screen Length:	
------------------	--------------------	-------------------------	-------	-----------------------	-------	----------------	----	----------------	--

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	3.3	Estimated Purge Volume (liters):	6.1
--------------	-----------------	-----------------------------------	-----	----------------------------------	-----

Sample ID: GW-33S Sample Time: 14:17 QA/QC: None

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information: _____

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft; 4 inch diameter well = 2470 ml/ft ($\text{vol}_{\text{cyl}} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-34S

Date: 5/17/2011 Sampling Personnel: Rob Murphy, Kevin McGovern Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.60'	Depth to Well Bottom:	10.00'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	4.6	Estimated Purge Volume (liters):	6.7
--------------	-----------------	-----------------------------------	-----	----------------------------------	-----

Sample ID:	GW-34S	Sample Time:	8:47	QA/QC:	None
------------	--------	--------------	------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES—0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($\text{vol}_{\text{cyl}} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-35S

Date: 5/18/2011 Sampling Personnel: Rob Murphy, Kevin McGovern Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.49'	Depth to Well Bottom:	7.46'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	-------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	3.1	Estimated Purge Volume (liters):	6.8
--------------	-----------------	-----------------------------------	-----	----------------------------------	-----

Sample ID:	GW-35S	Sample Time:	12:10	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES—0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($\text{vol}_{\text{cyl}} = \pi r^2 h$)

GROUNDWATER SAMPLING - SAMPLE COLLECTION DATA SHEET

Project Name: Pfohl Brothers

Project Number: 11175616.00000

Sampling Crew Members: R. Murphy, K. McGovern

Supervisor: J. Sundquist

Date of Sampling: May 16, 2011

Sample I.D. Number	Well Number	Well Volume (liters)	Volume Purged (liters)	Sample Time	Sample Description	Analysis Required	Chain-of-Custody Number
GW-7D	GW-7D	39.0	39.7	10:25	Groundwater	VOCs	Not Applicable
GW-7S	GW-7S	20.1	30.3	11:40	Groundwater		Not Applicable
GW-3D	GW-3D	85.0	45.0	14:15	Groundwater	VOCs/SVOCs/ Metals	Not Applicable
GW-3D-MS	GW-3D	85.0	45.0	14:15	Matrix Spike		Not Applicable
GW-3D-MSD	GW-3D	85.0	45.0	14:15	Matrix Spike Duplicate		Not Applicable
GW-3S	GW-3S	6.9	6.1	15:15	Groundwater		Not Applicable
GW-8D	GW-8D	77.8	40.0	16:35	Groundwater		Not Applicable

Additional Comments:

GW-7D and GW-7S were sampled for VOCs using passive diffusion bags.

GW-7D and GW-7S were purged dry following collection of the VOC samples.

All other wells were purged using low flow methods until parameter stabilization.

GROUNDWATER SAMPLING - SAMPLE COLLECTION DATA SHEET

Project Name: Pfohl Brothers

Project Number: 11175616.00000

Sampling Crew Members: R. Murphy, K. McGovern

Supervisor: J. Sundquist

Date of Sampling: November 1, 2010

Sample I.D. Number	Well Number	Well Volume (liters)	Volume Purged (liters)	Sample Time	Sample Description	Analysis Required	Chain-of-Custody Number
DUPLICATE	GW-8D	77.8	40.0	16:35	Blind Duplicate	VOCs/SVOCs/ Metals	Not Applicable
GW-8SR	GW-8SR	5.1	7.7	17:25	Groundwater		Not Applicable
TB-051611	---	---	---	---	Trip Blank	VOCs	Not Applicable

Additional Comments: All wells were purged using low flow methods until parameter stabilization.

GROUNDWATER SAMPLING - SAMPLE COLLECTION DATA SHEET

Project Name: Pfohl Brothers

Project Number: 11175616.00000

Sampling Crew Members: R. Murphy, K. McGovern

Supervisor: J. Sundquist

Date of Sampling: May 17, 2011

Sample I.D. Number	Well Number	Well Volume (liters)	Volume Purged (liters)	Sample Time	Sample Description	Analysis Required	Chain-of-Custody Number
GW-34S	GW-34S	4.6	6.7	8:47	Groundwater	VOCs/SVOCs/ Metals	Not Applicable
GW-4S	GW-4S	7.7	25.0	9:20 & 11:25	Groundwater		Not Applicable
GW-4D	GW-4D	81.8	10.6	11:04	Groundwater		Not Applicable
GW-1S	GW-1S	7.9	6.7	12:37	Groundwater		Not Applicable
GW-1D	GW-1D	94.4	70.0	14:02	Groundwater		Not Applicable
GW-28S	GW-28S	4.8	7.2	15:05	Groundwater		Not Applicable
GW-29S	GW-29S	8.8	10.3	16:25	Groundwater		Not Applicable

Additional Comments: GW-4S was sampled for VOCs using a passive diffusion bag and then purged dry/allowed to recharge for collection of other parameters
All other wells were purged using low flow methods until parameter stabilization.

GROUNDWATER SAMPLING - SAMPLE COLLECTION DATA SHEET

Project Name: Pfohl Brothers

Project Number: 11175616.00000

Sampling Crew Members: R. Murphy, K. McGovern

Supervisor: J. Sundquist

Date of Sampling: May 17, 2011

Sample I.D. Number	Well Number	Well Volume (liters)	Volume Purged (liters)	Sample Time	Sample Description	Analysis Required	Chain-of-Custody Number
GW-7D	GW-7D	39.0	39.7	17:05	Groundwater	SVOCs/ Metals	Not Applicable
GW-7S	GW-7S	20.1	30.3	17:50	Groundwater		Not Applicable
TB-051711	---	---	---	---	Trip Blank	VOCs	Not Applicable

Additional Comments: GW-7D and GW-7S were sampled for SVOCs and Metals after recharging overnight.

GROUNDWATER SAMPLING - SAMPLE COLLECTION DATA SHEET

Project Name: Pfohl Brothers

Project Number: 11175616.00000

Sampling Crew Members: R. Murphy, K. McGovern

Supervisor: J. Sundquist

Date of Sampling: May 18, 2011

Sample I.D. Number	Well Number	Well Volume (liters)	Volume Purged (liters)	Sample Time	Sample Description	Analysis Required	Chain-of-Custody Number
GW-30S	GW-30S	6.6	25.0	8:29	Groundwater	VOCs/SVOCs/ Metals	Not Applicable
GW-31S	GW-31S	4.6	6.2	9:35	Groundwater		Not Applicable
GW-32S	GW-32S	4.9	7.7	10:57	Groundwater		Not Applicable
GW-35S	GW-35S	3.1	6.8	12:10	Groundwater		Not Applicable
GW-26D	GW-26D	84.9	40.0	13:10	Groundwater		Not Applicable
GW-33S	GW-33S	3.3	6.1	14:17	Groundwater		Not Applicable
TB-051811	---	---	---	---	Trip Blank	VOCs	Not Applicable

Additional Comments: All wells were purged using low flow methods until parameter stabilization.

APPENDIX E

HISTORICAL ANALYTICAL RESULTS

FIGURE E-1
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-01D

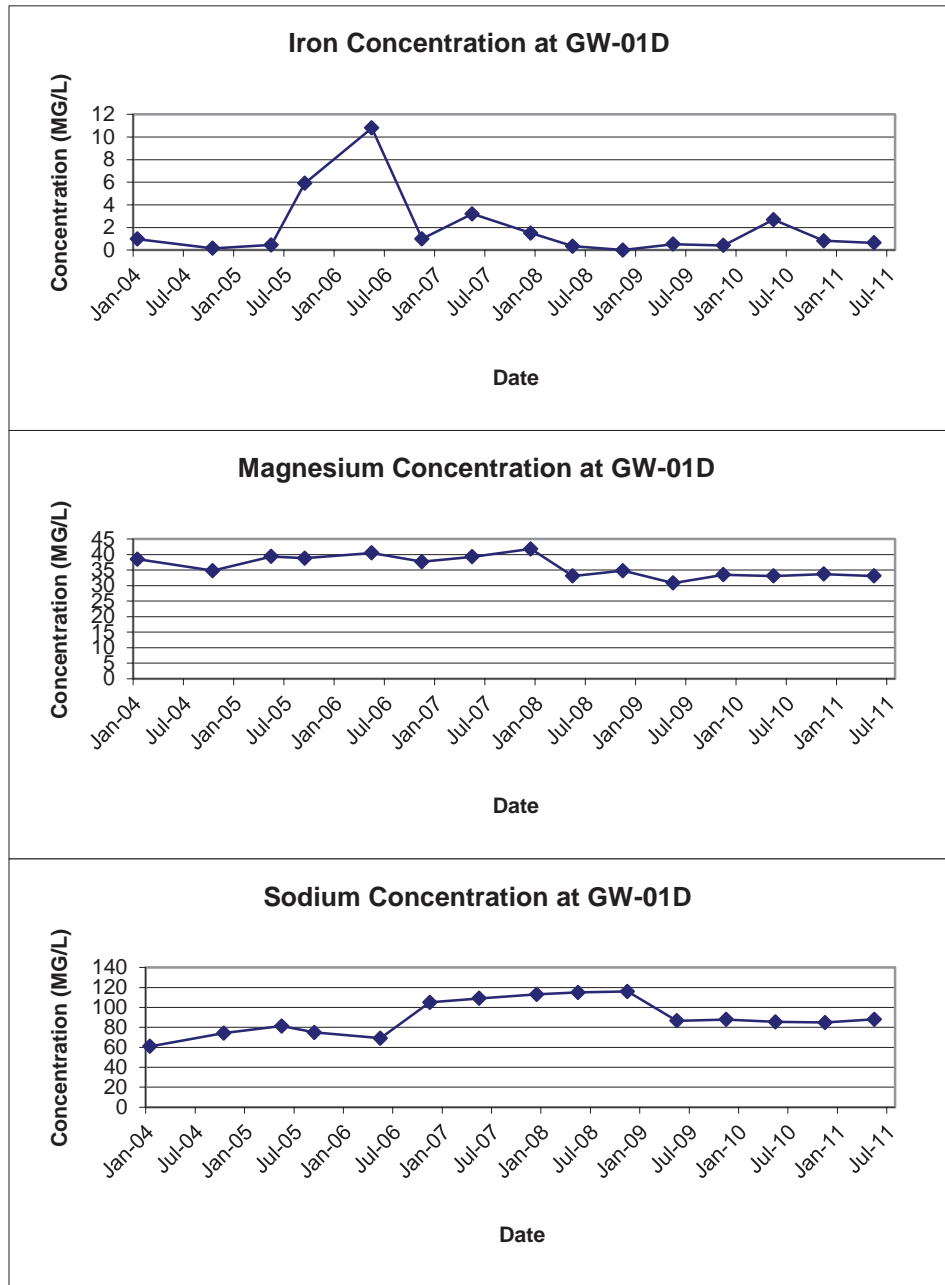


FIGURE E-2
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-1S

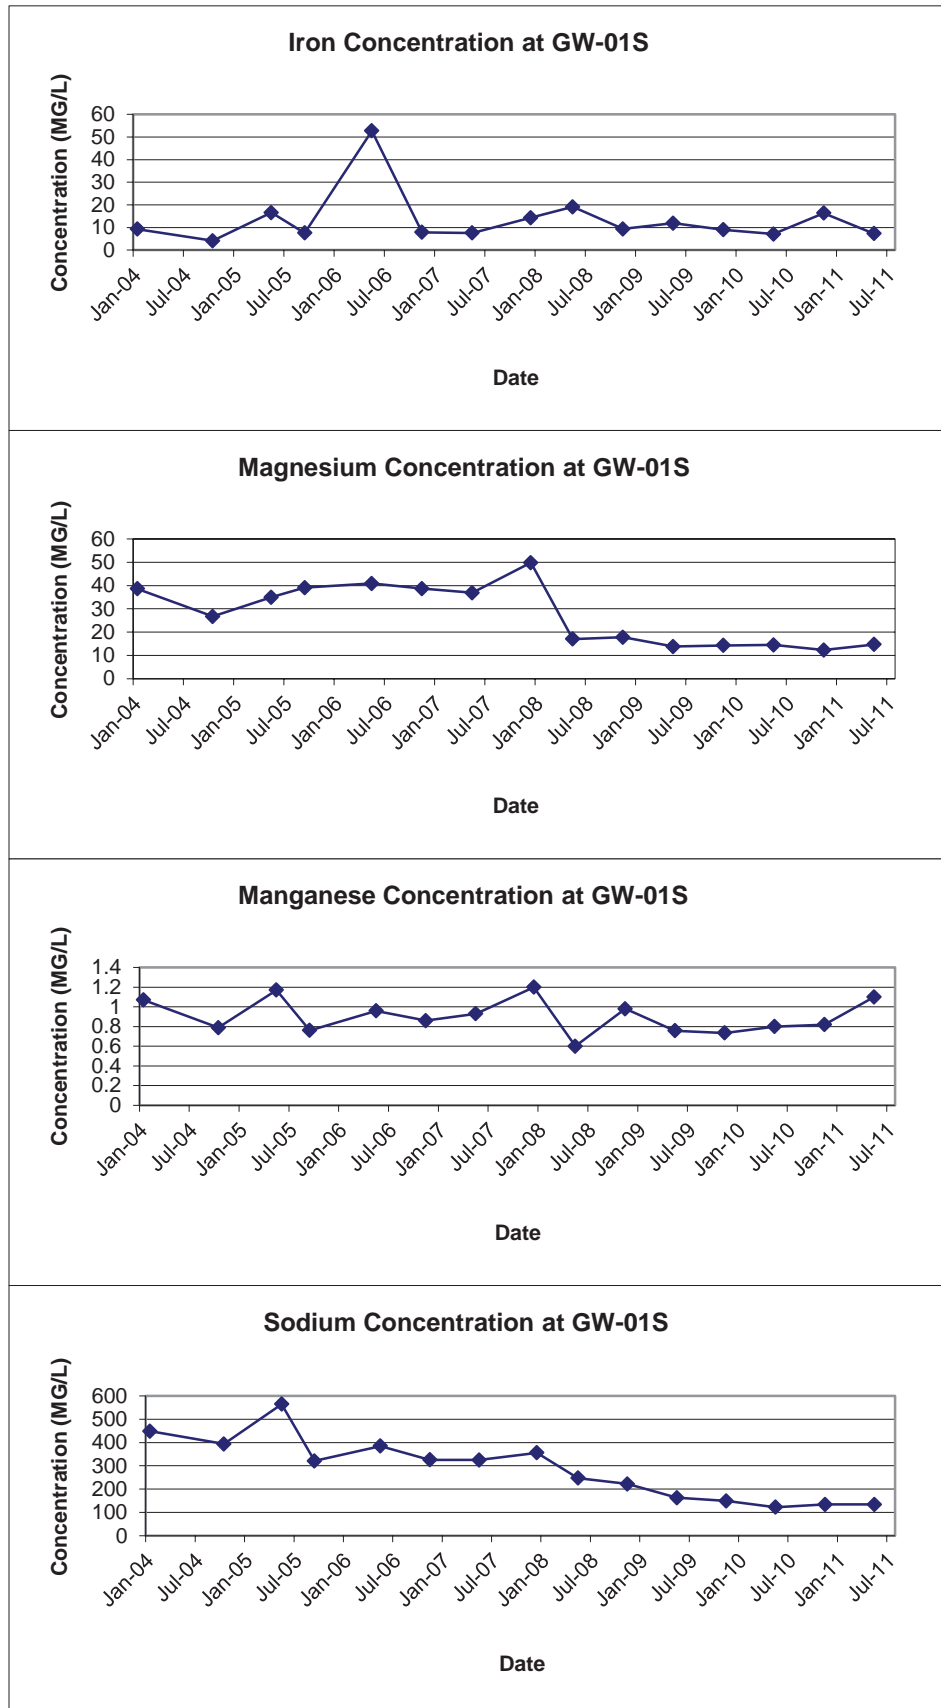


FIGURE E-3
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-3D

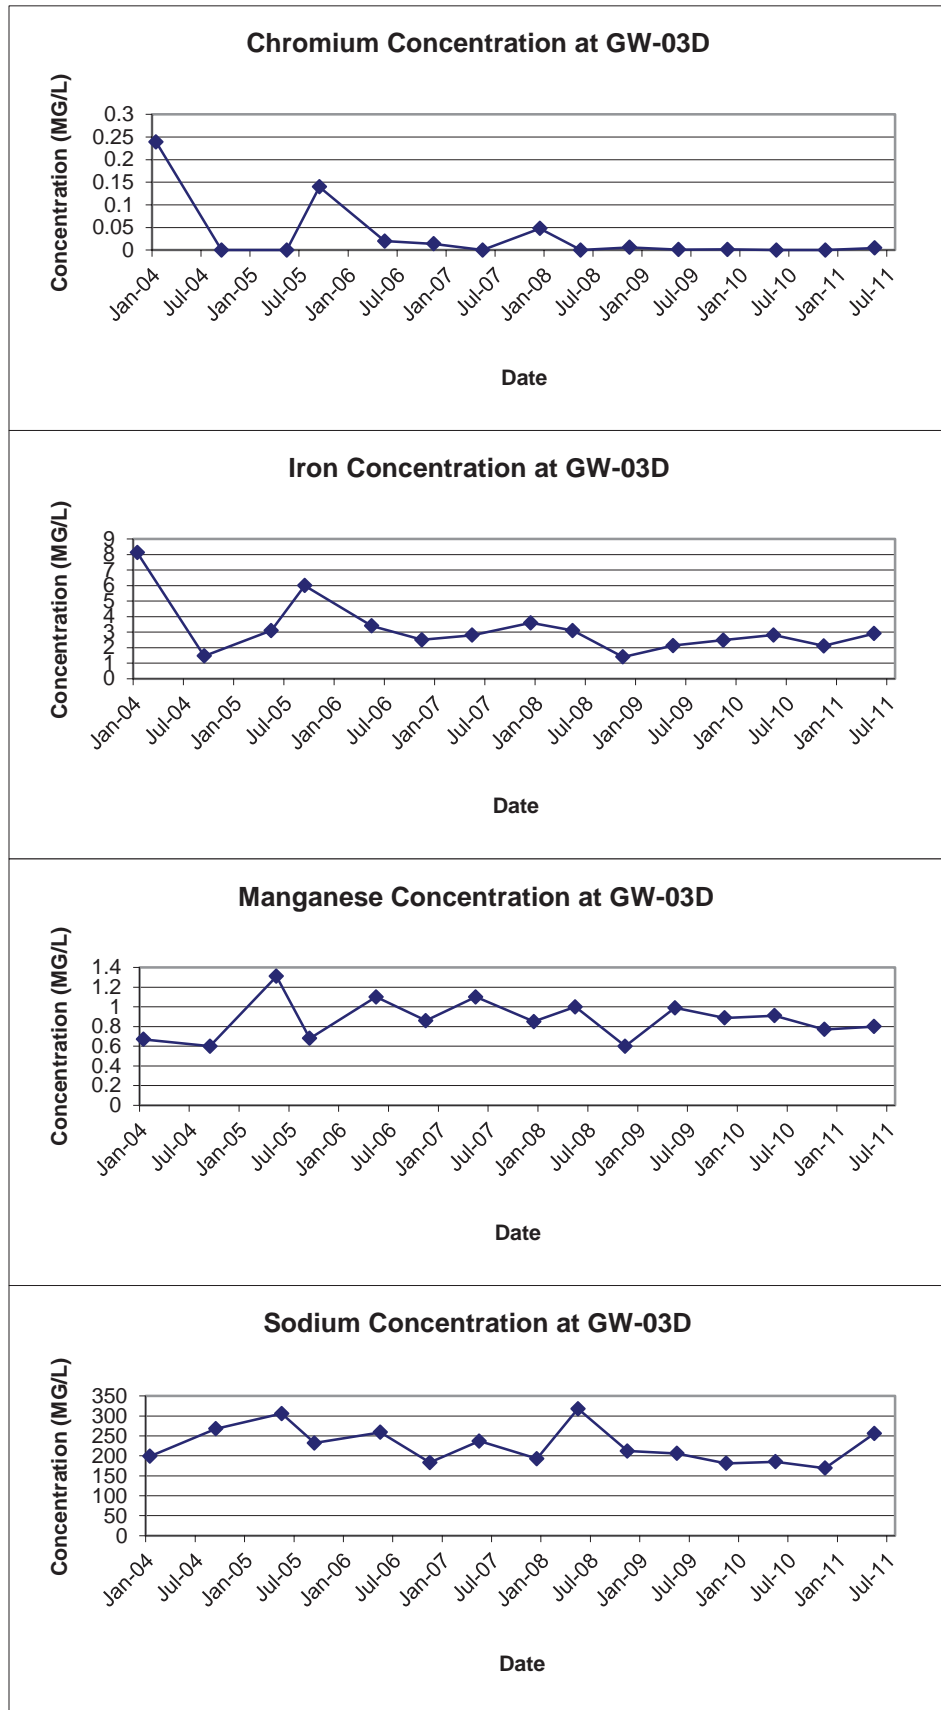


FIGURE E-4
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-03S

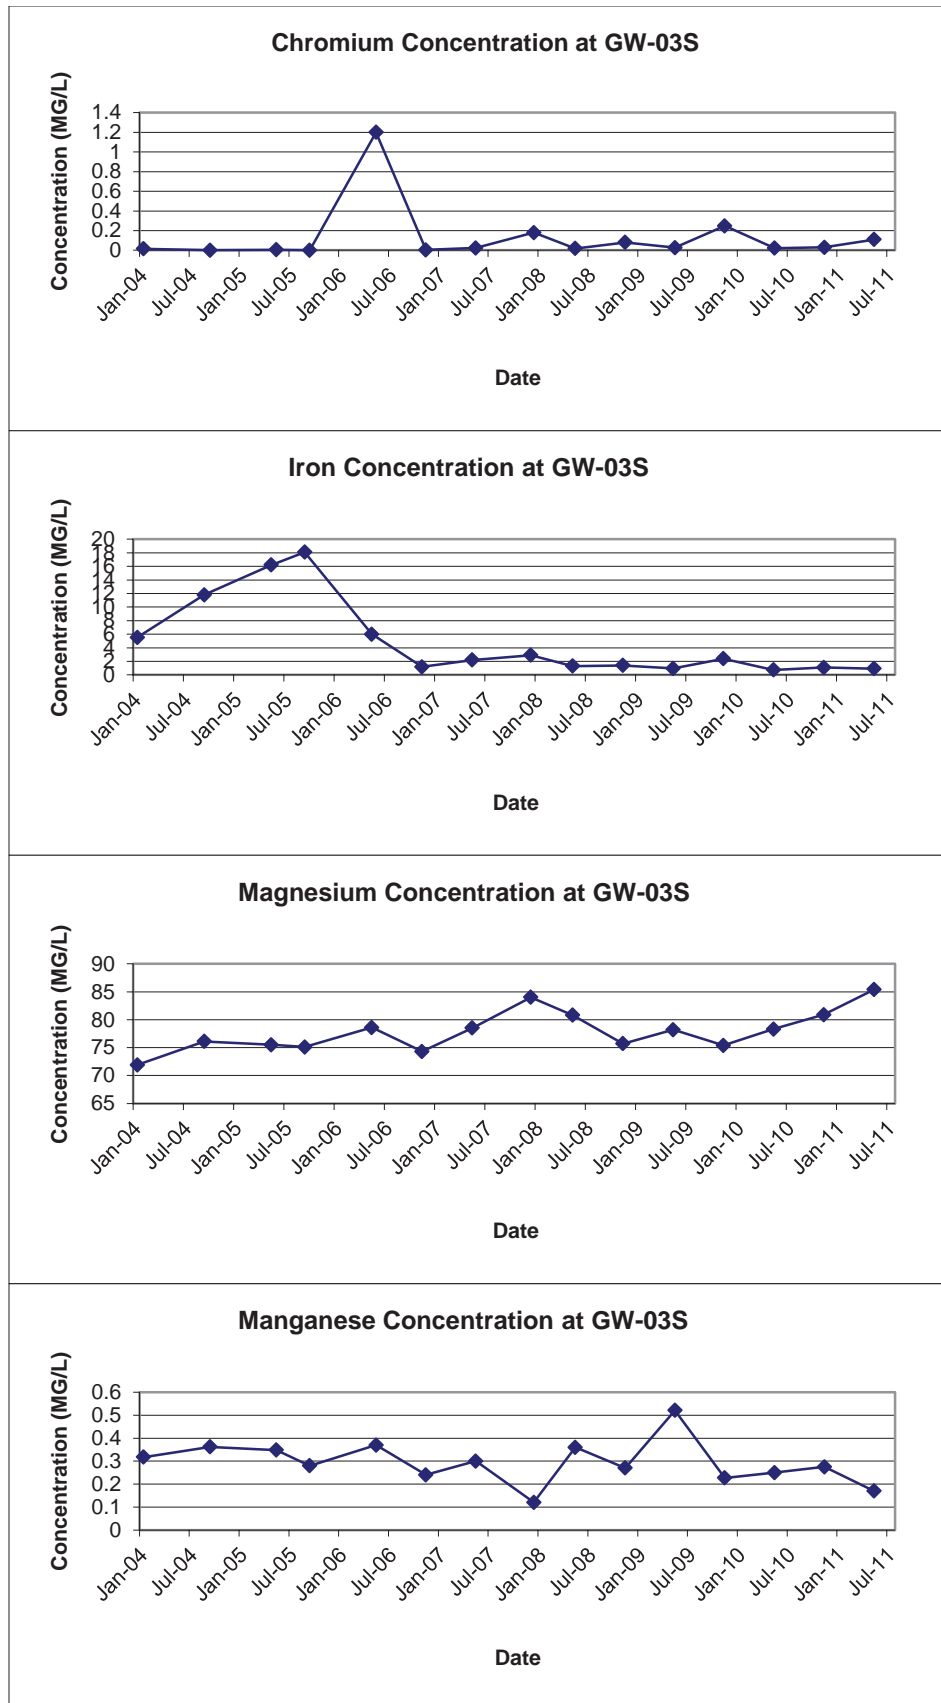


FIGURE E-4
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-3S

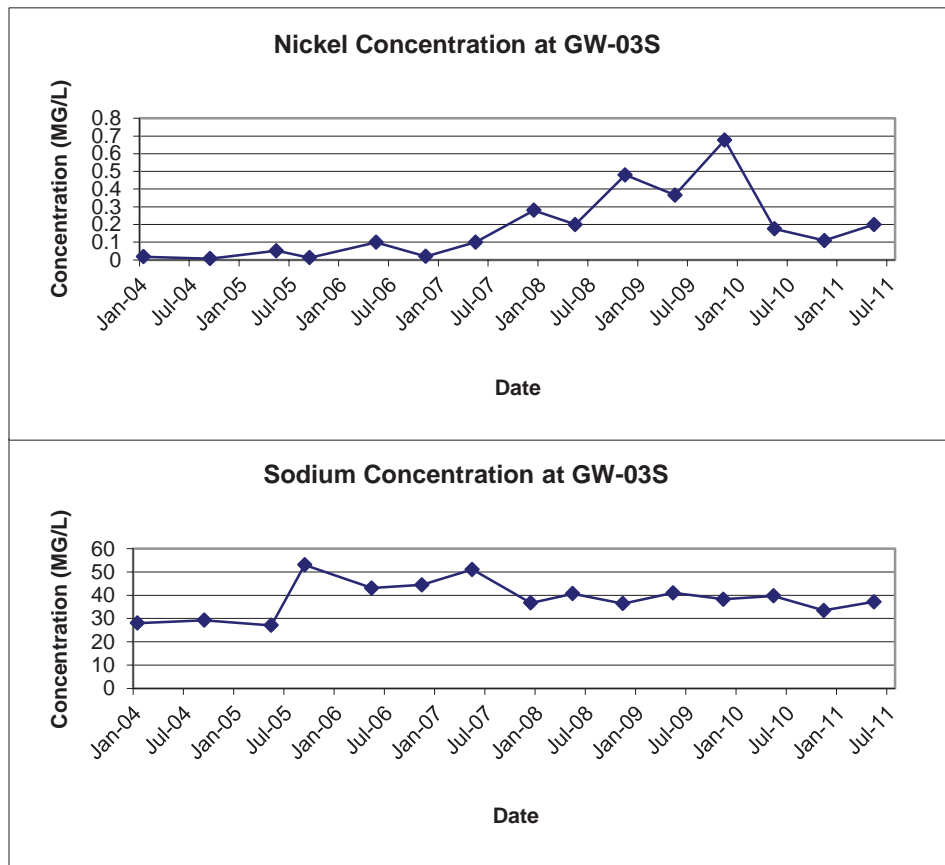


FIGURE E-5
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-04D

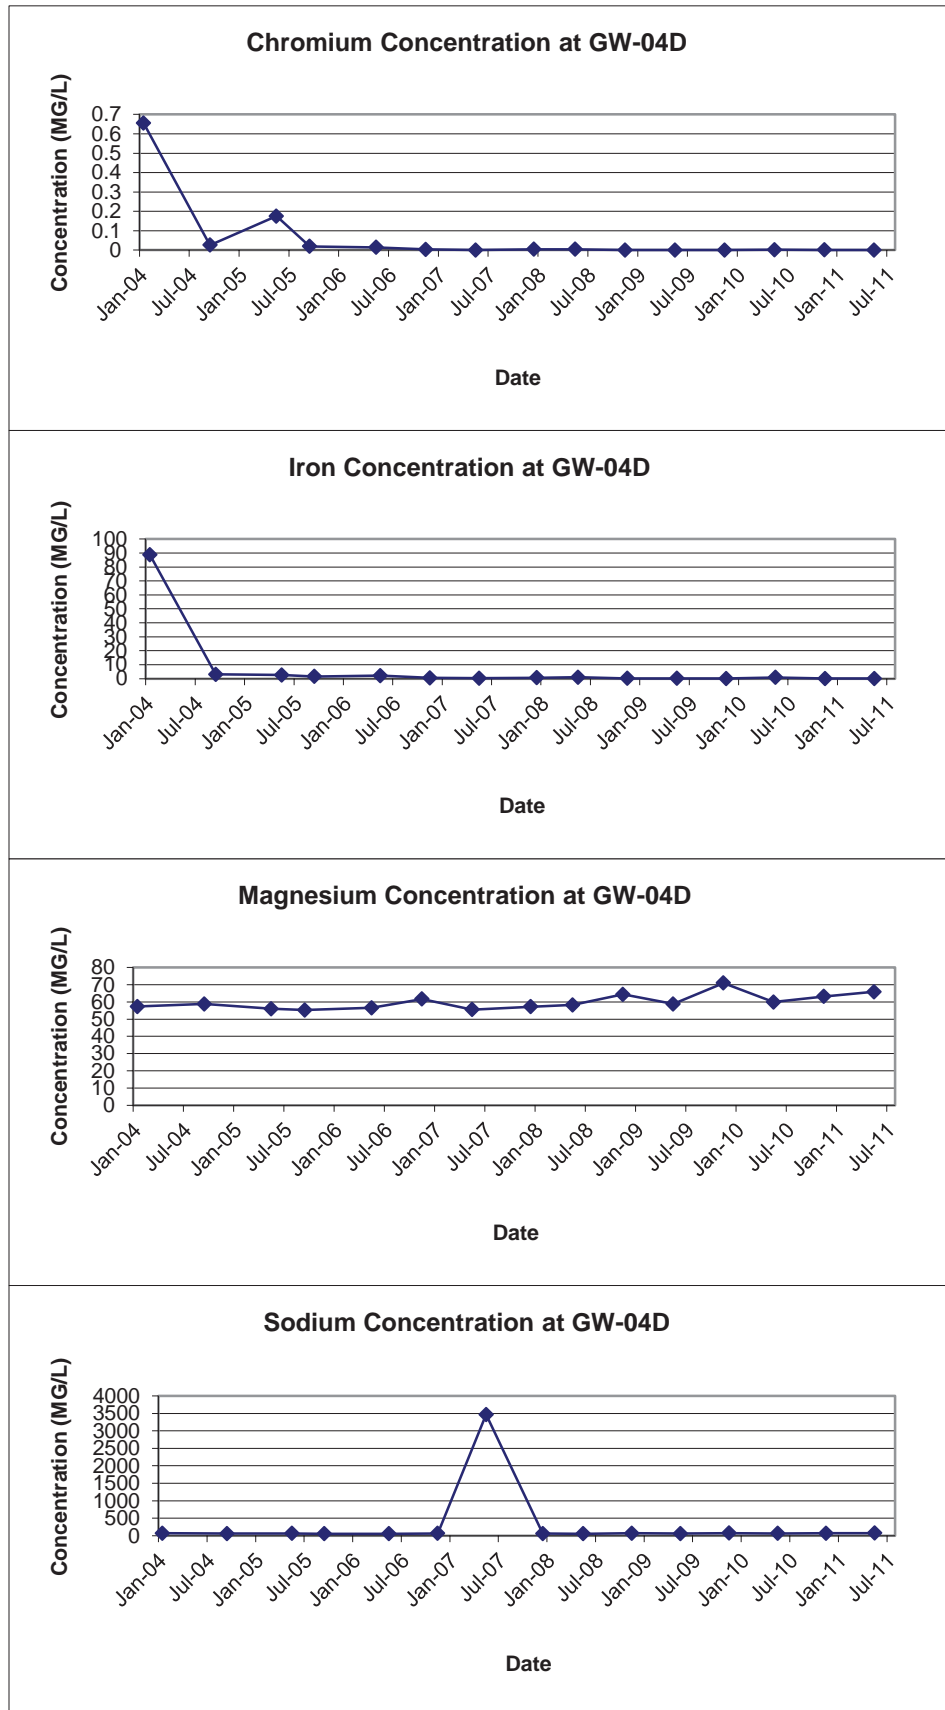


FIGURE E-6
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-04S

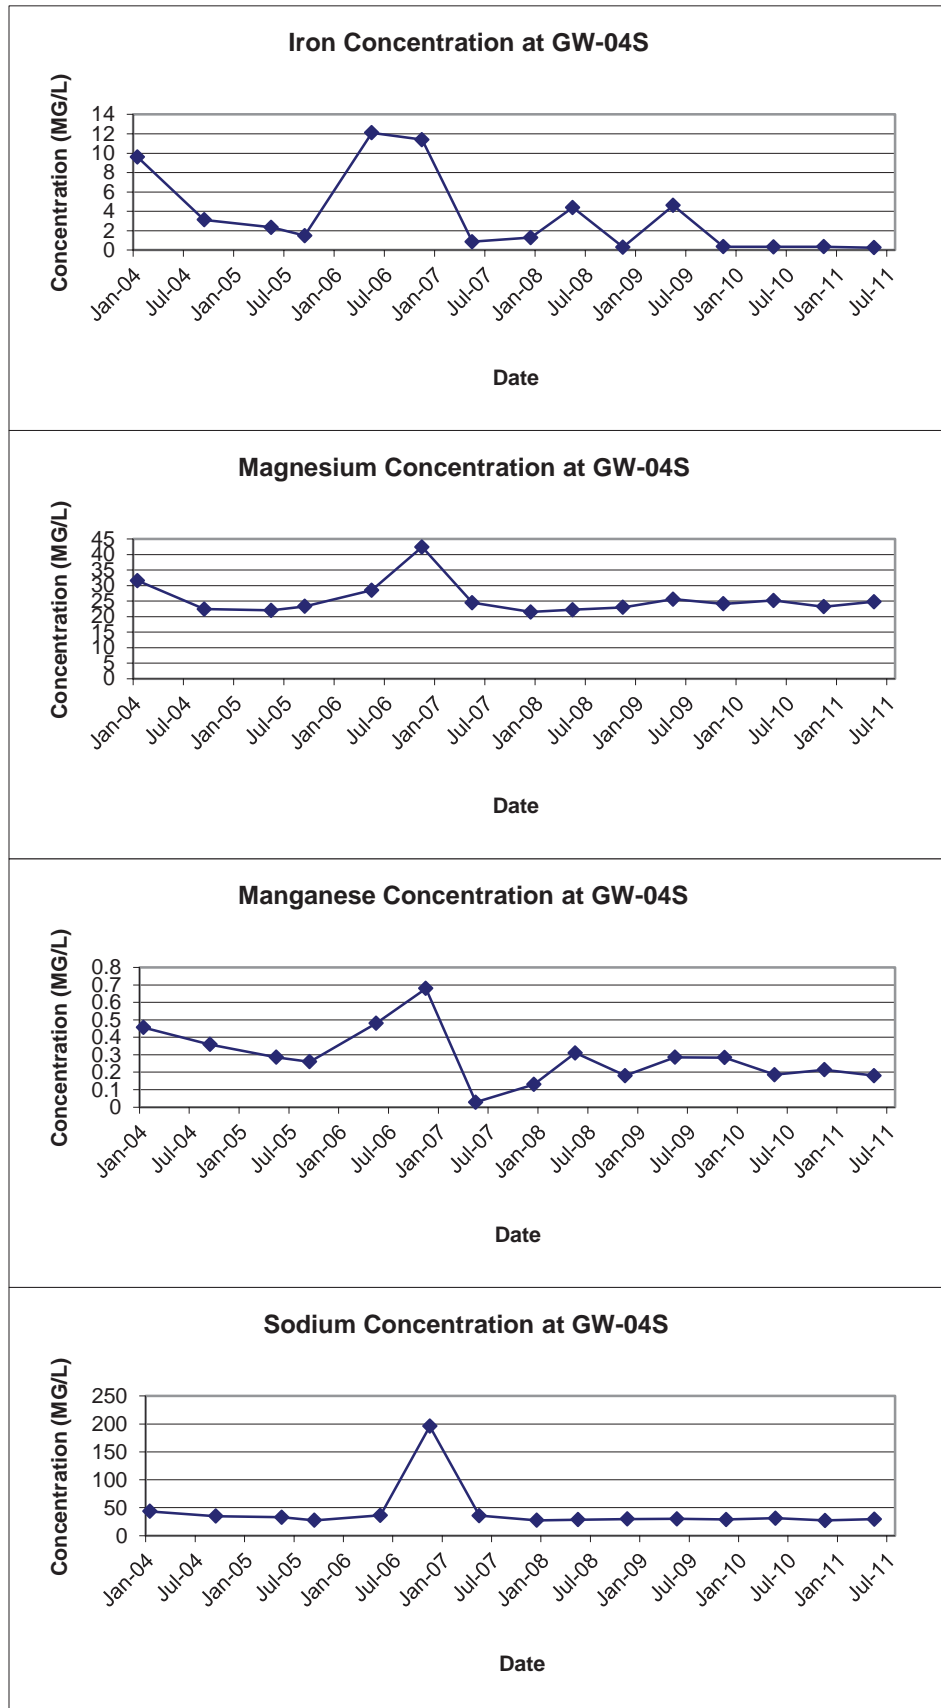


FIGURE E-7
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-7D

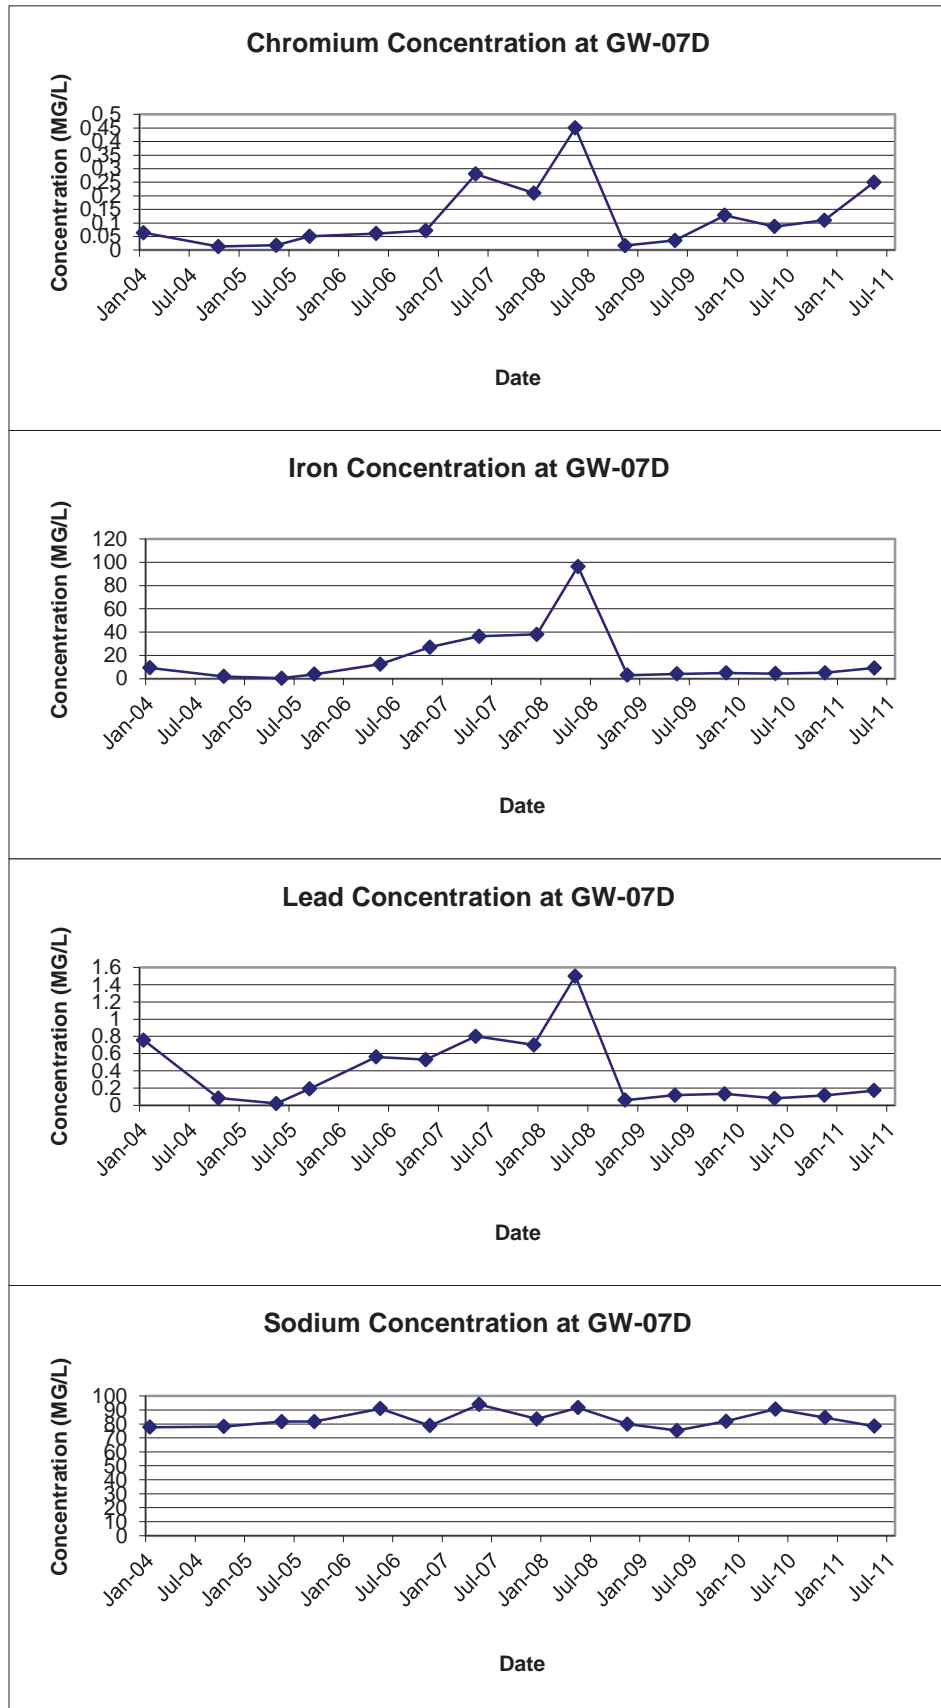


FIGURE E-8
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-7S

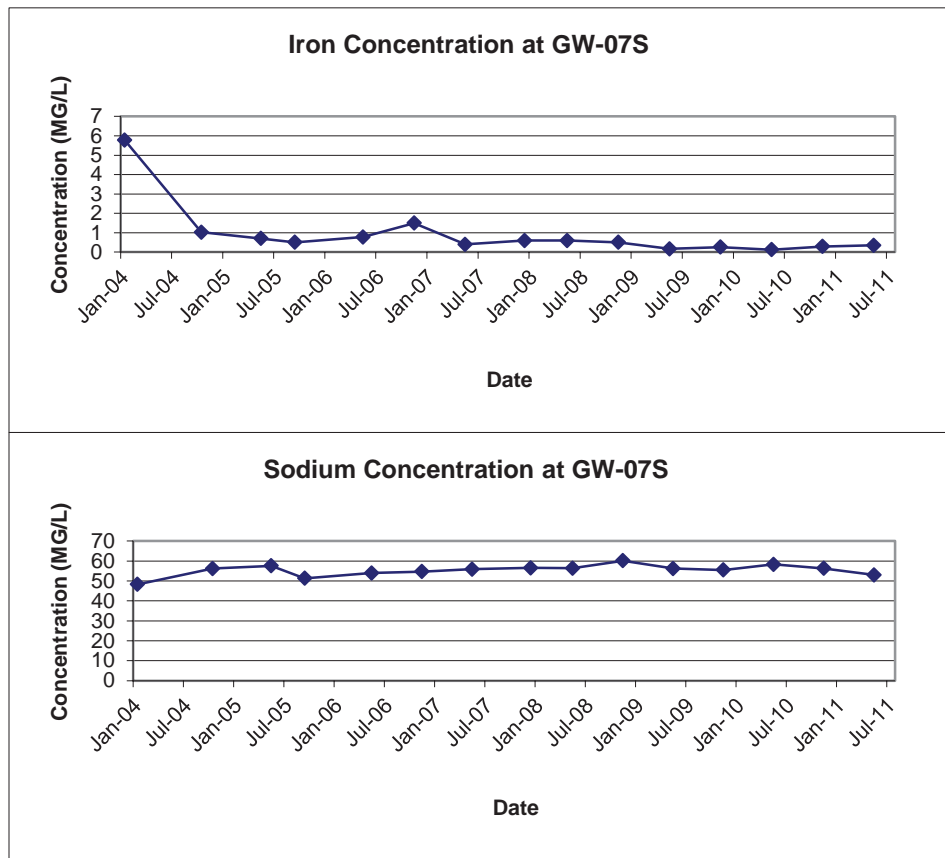


FIGURE E-9
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-8D

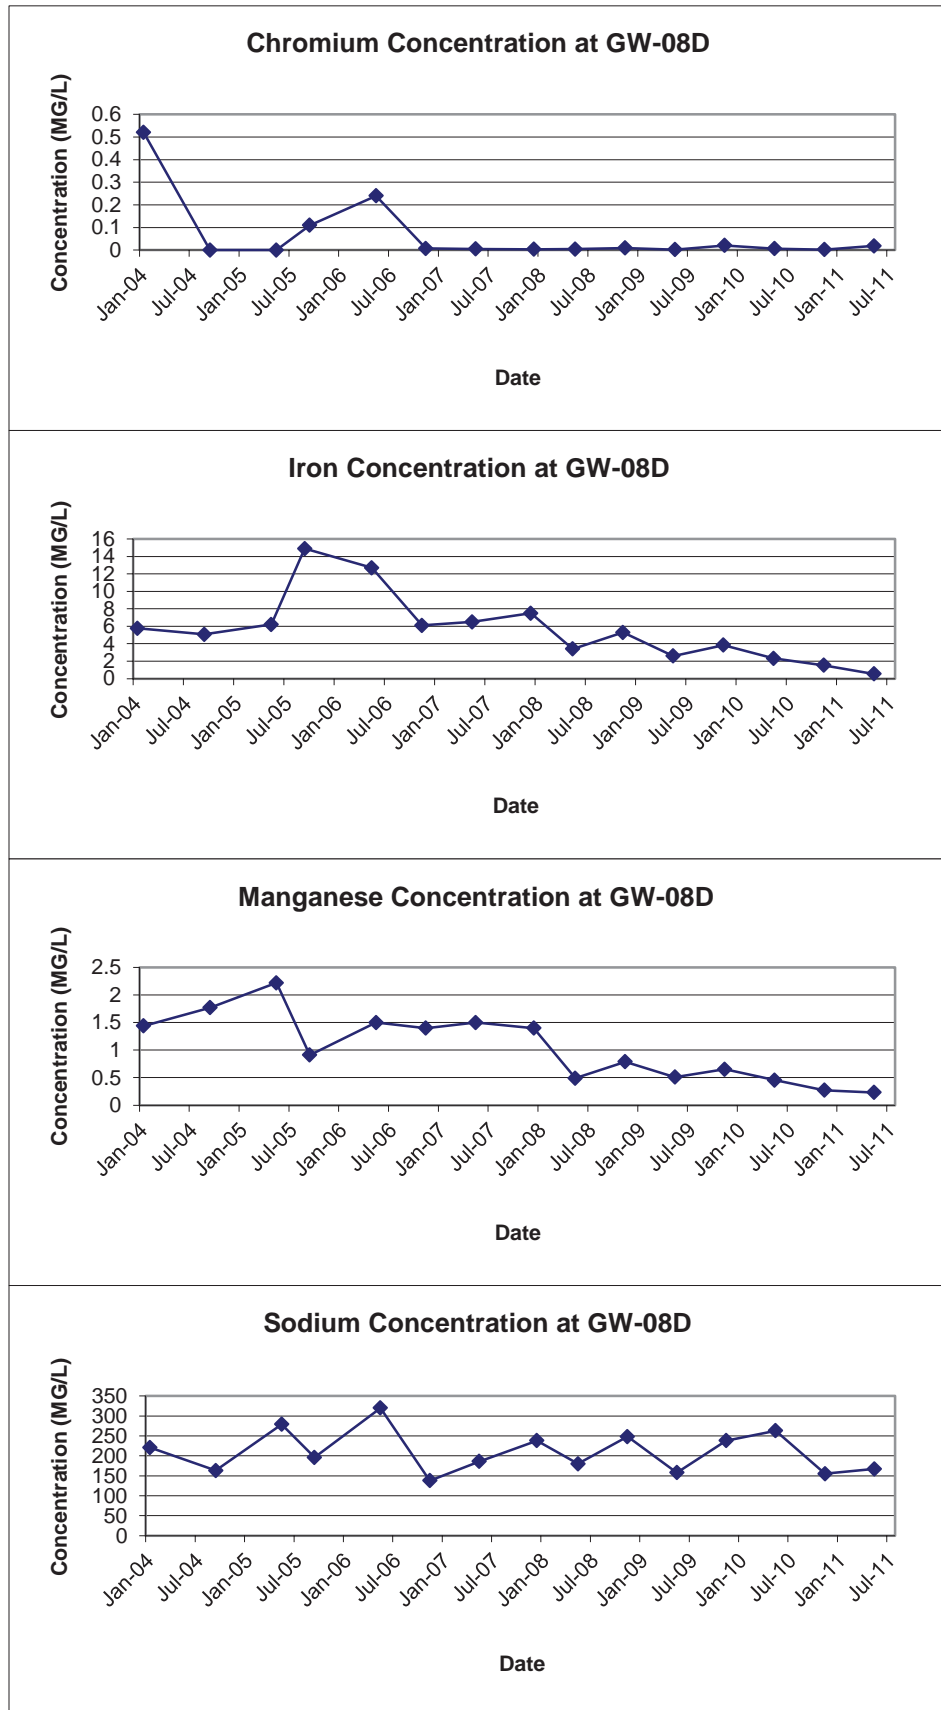


FIGURE E-10
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-8SR

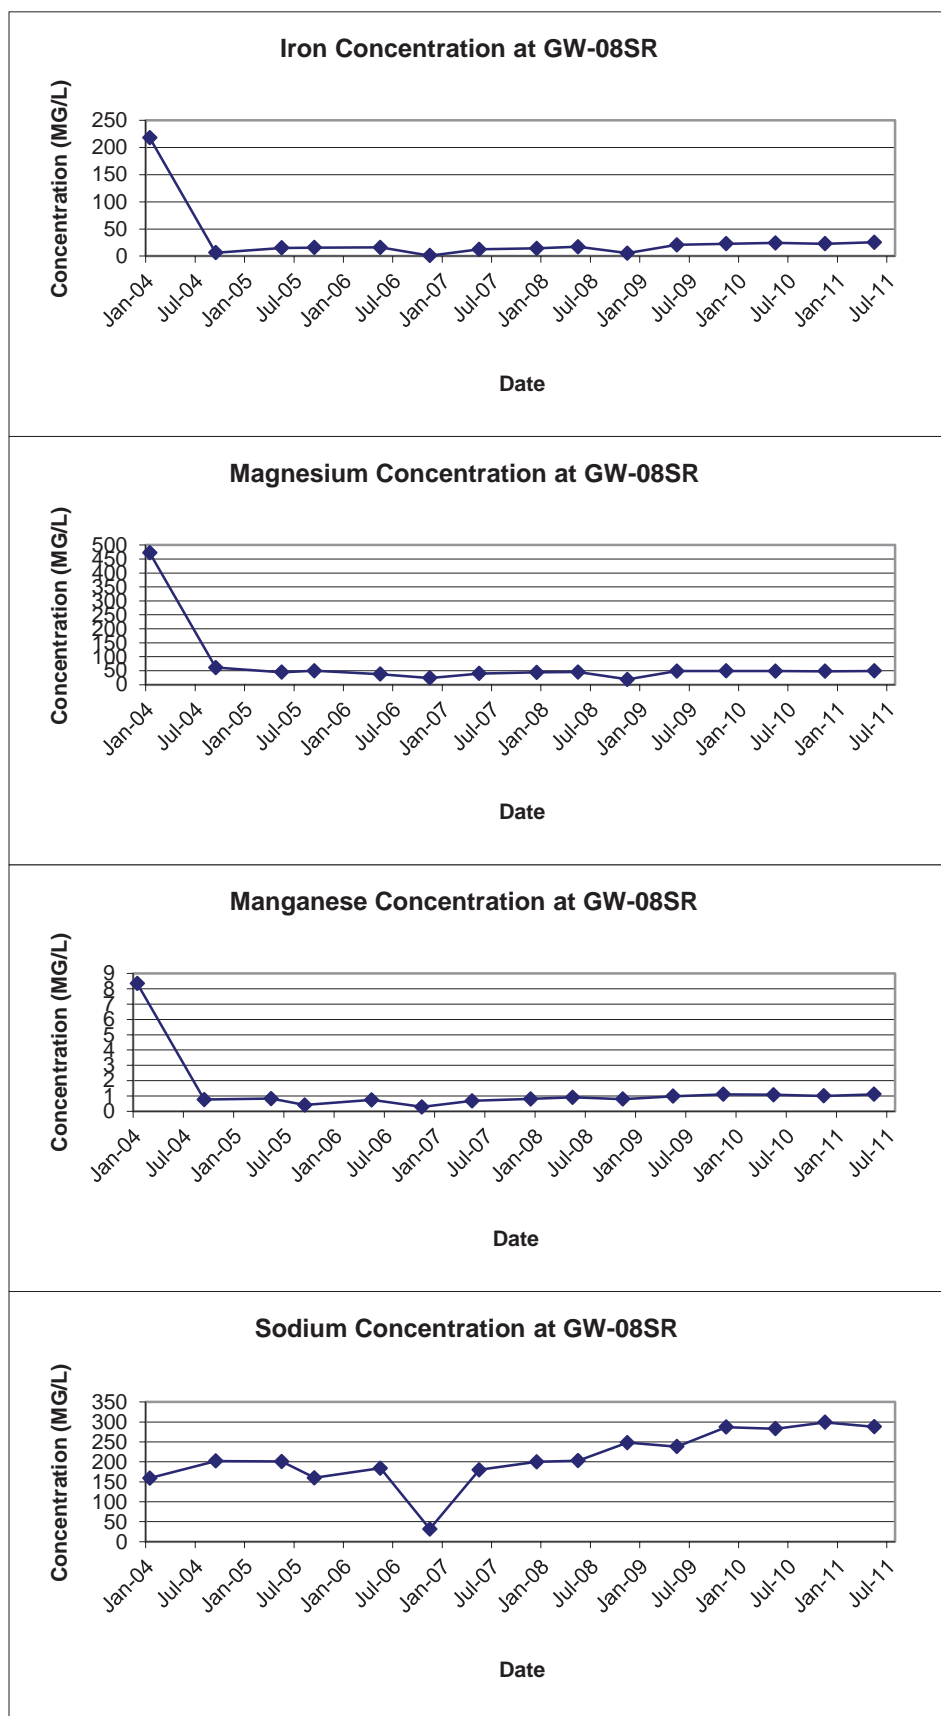


FIGURE E-11
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-26D

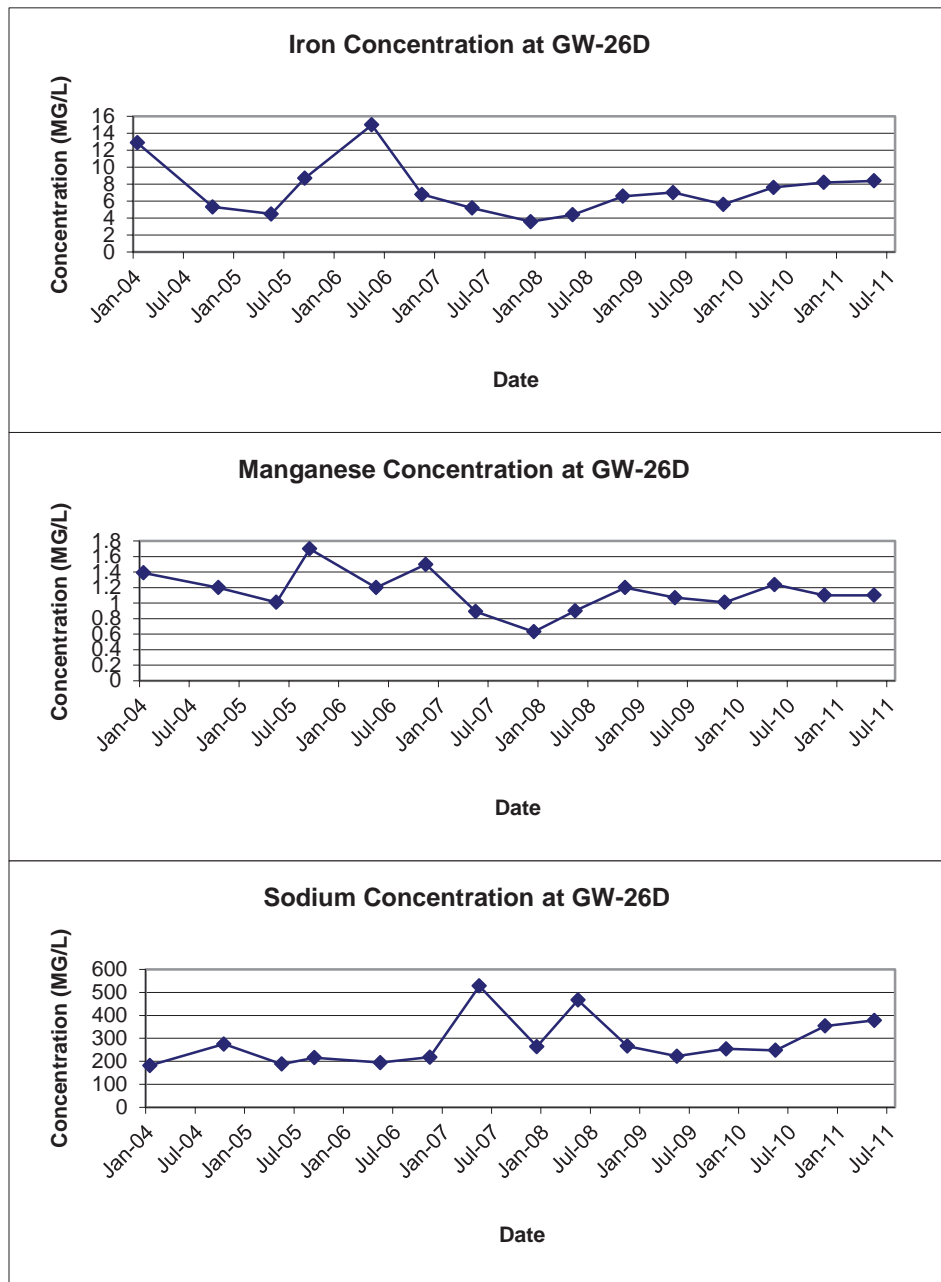


FIGURE E-12
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-28S

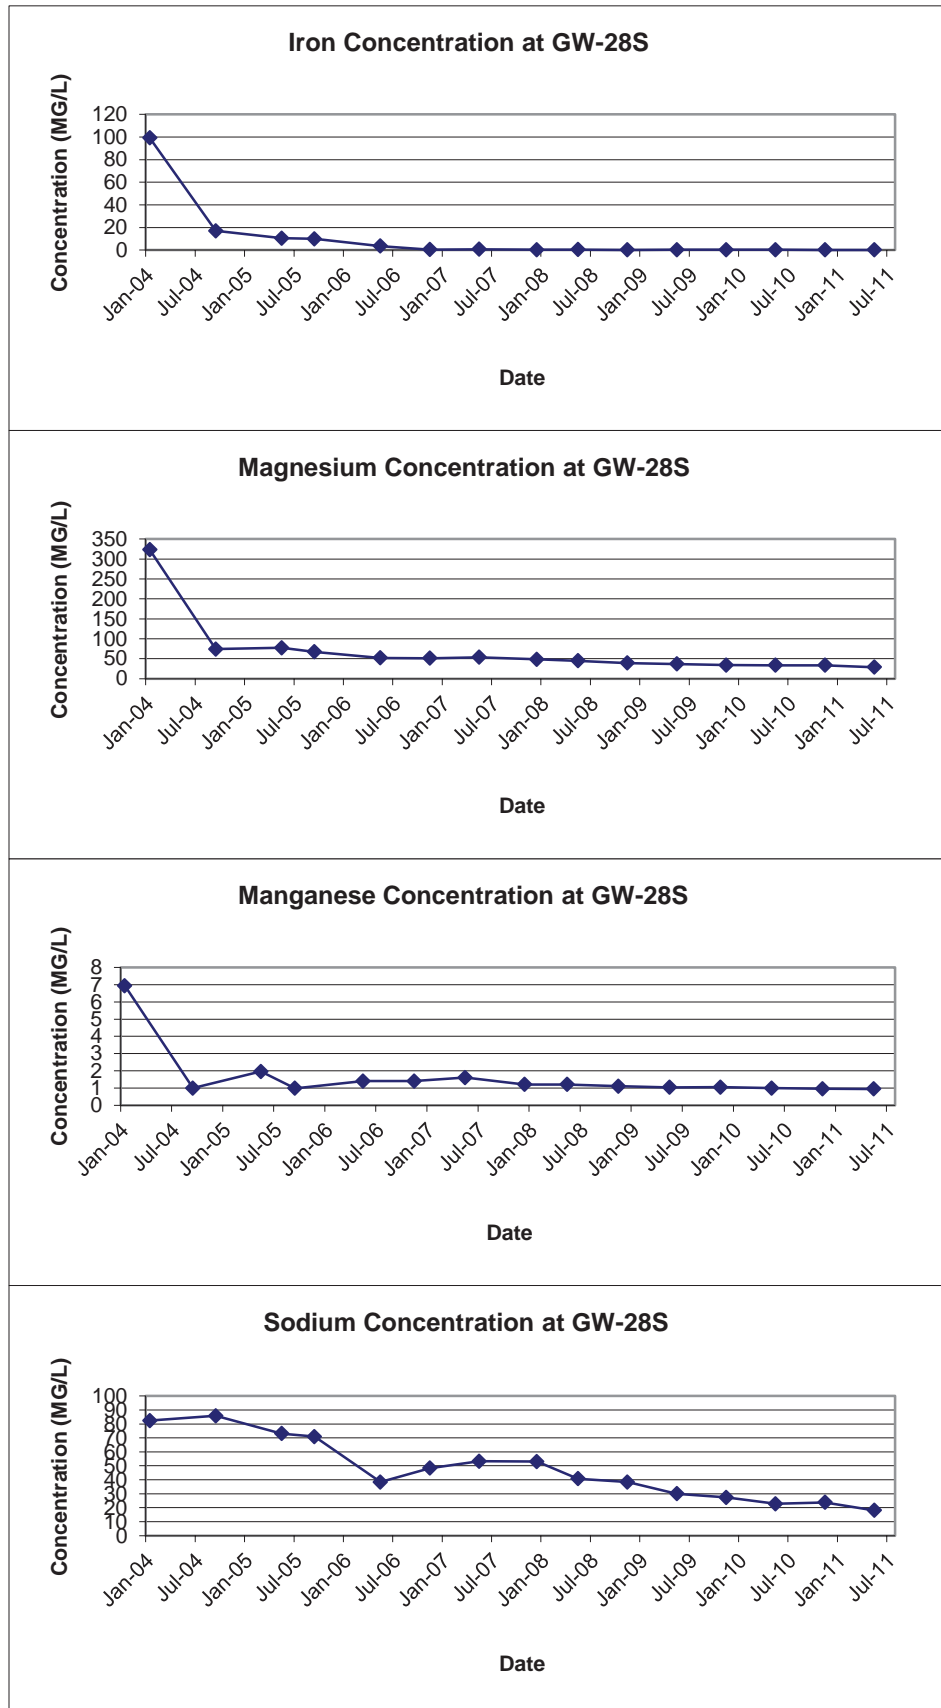


FIGURE E-13
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-29S

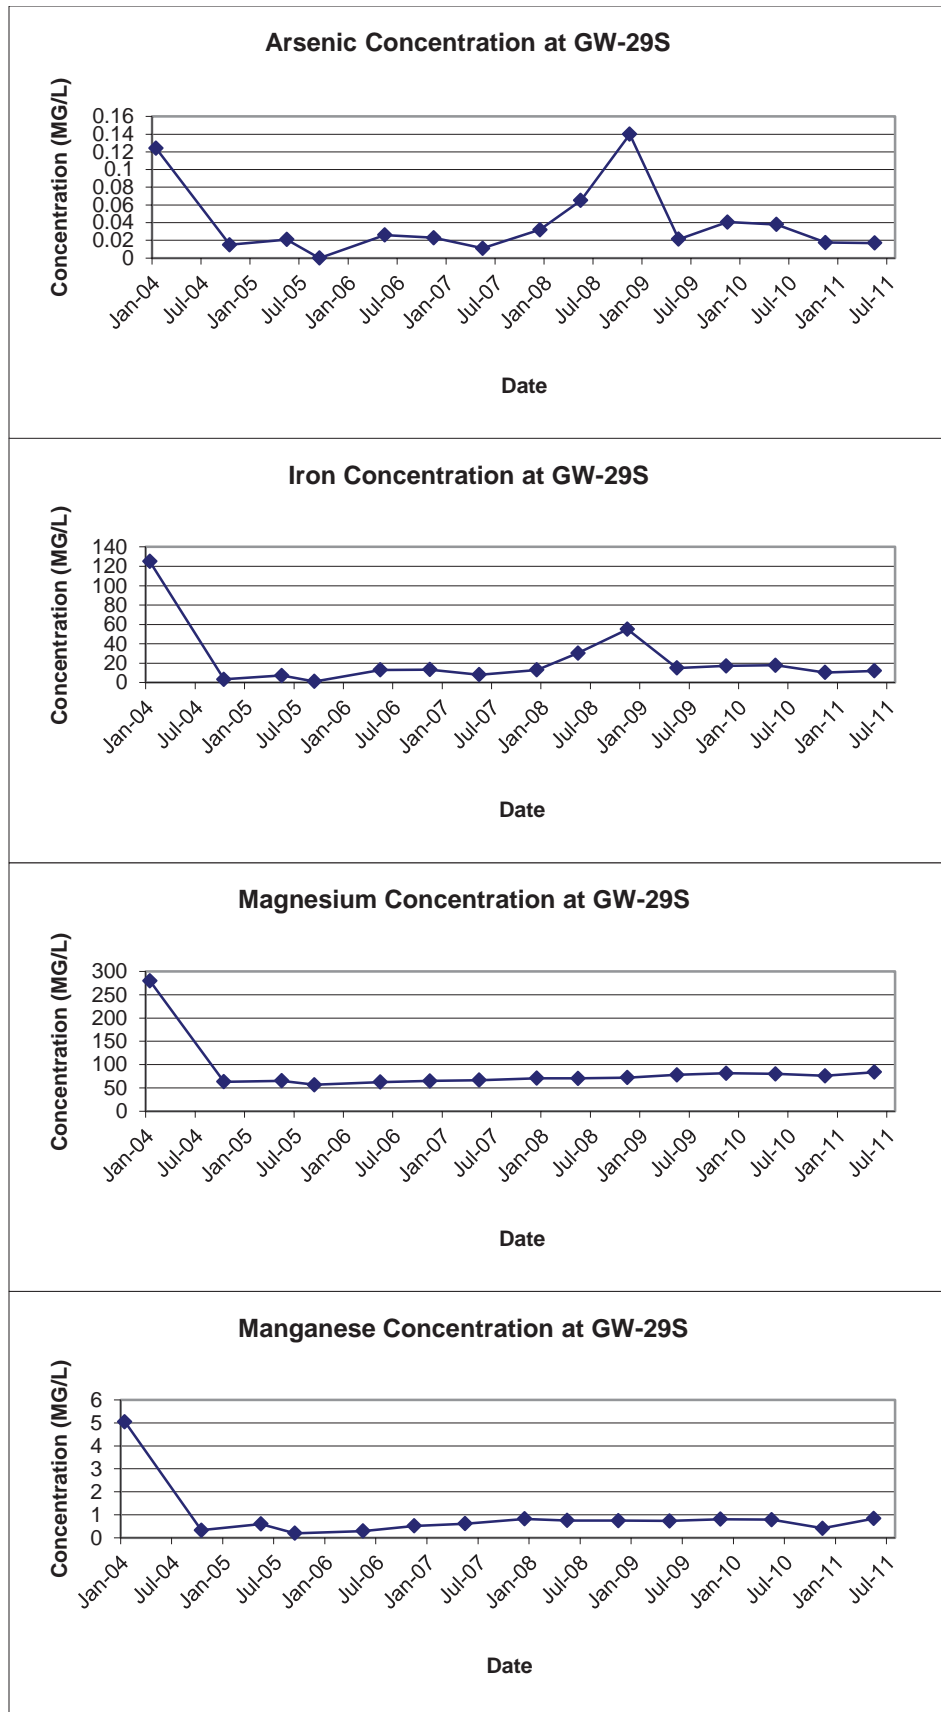


FIGURE E-13
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-29S

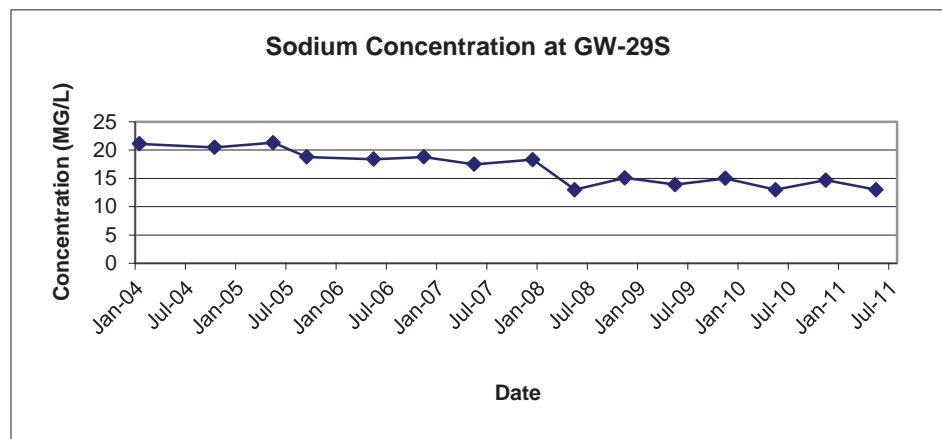


FIGURE E-14
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-30S

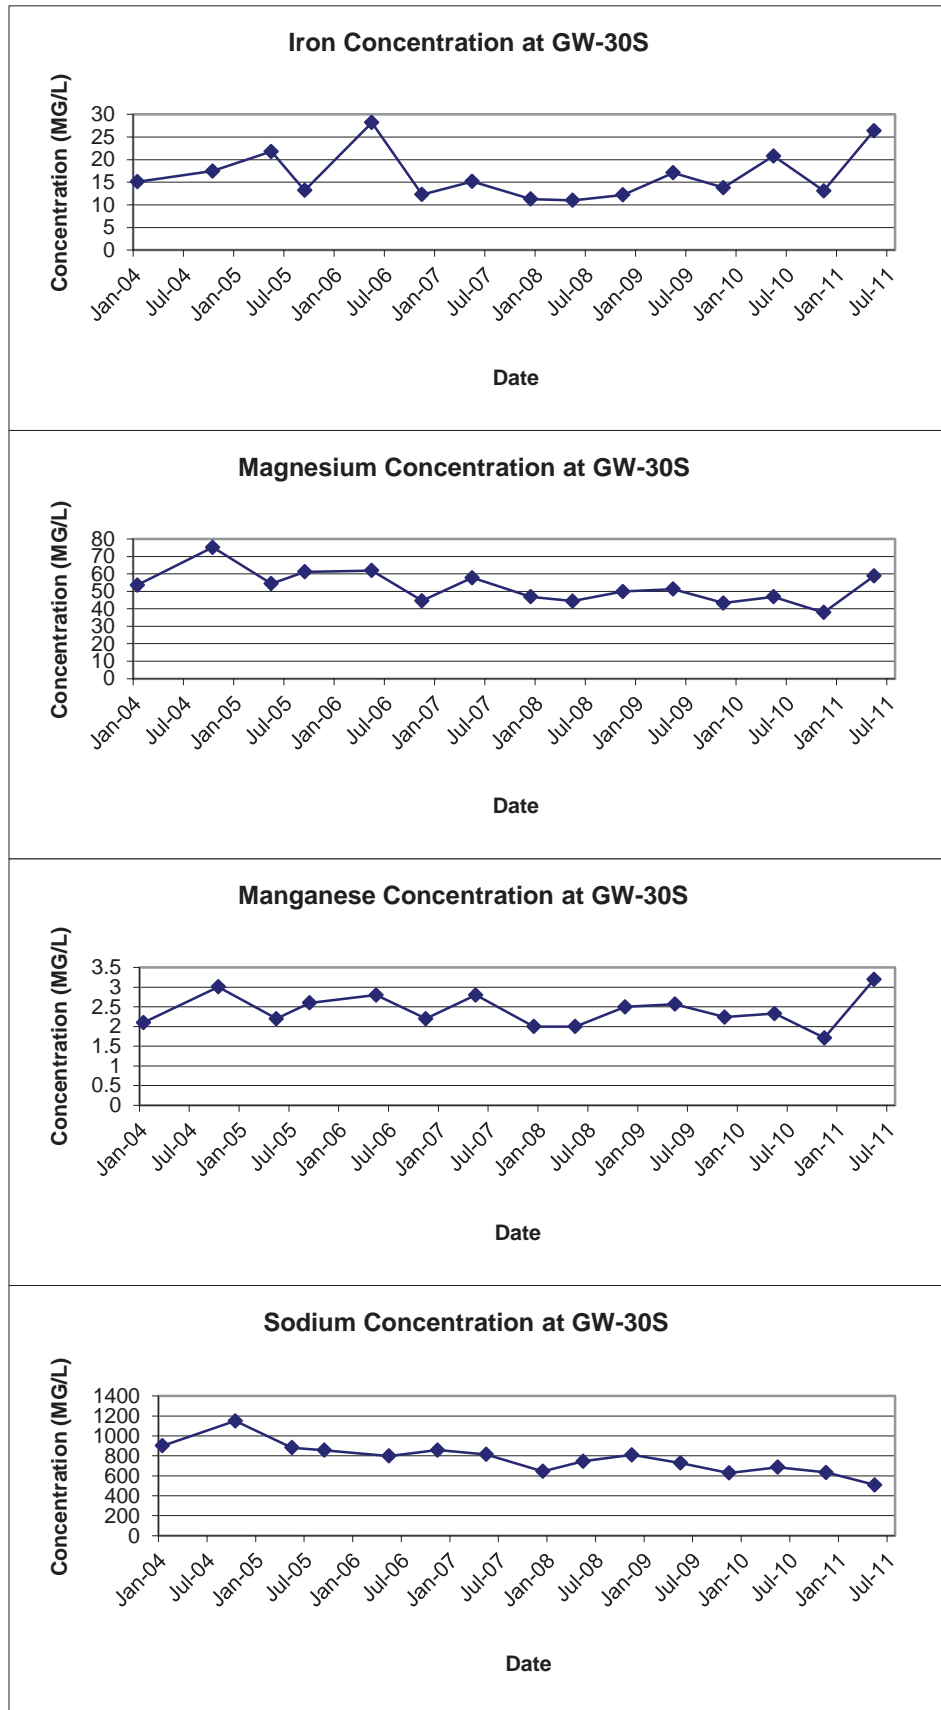


FIGURE E-15
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-31S

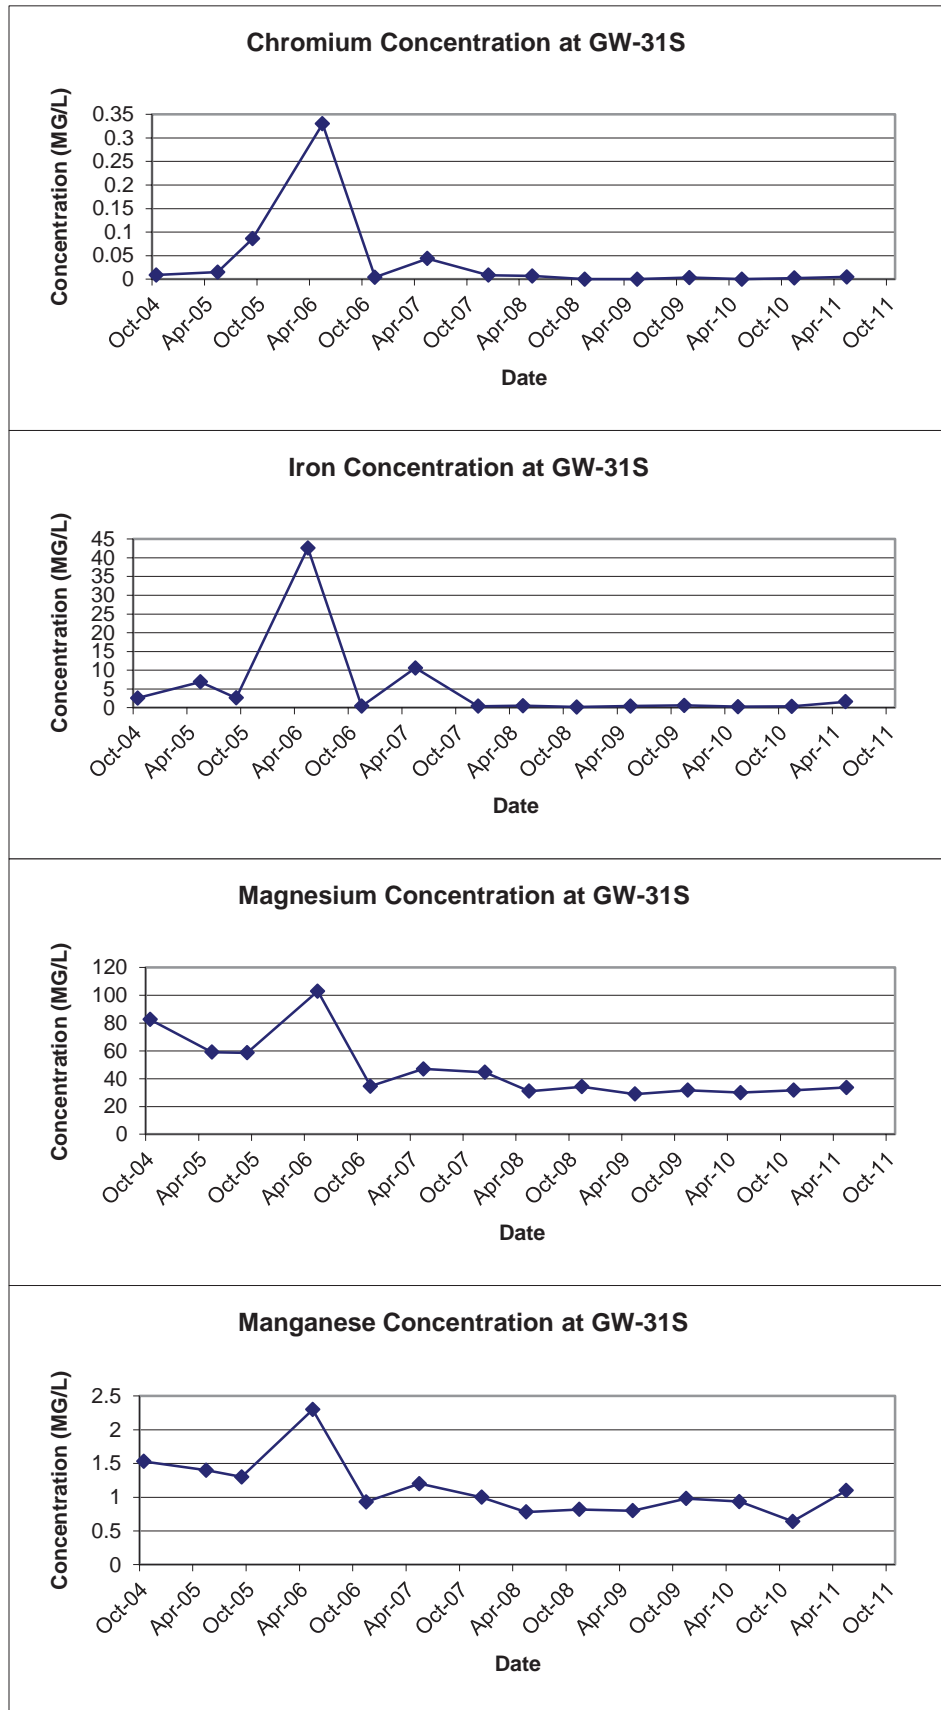


FIGURE E-16
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-32S

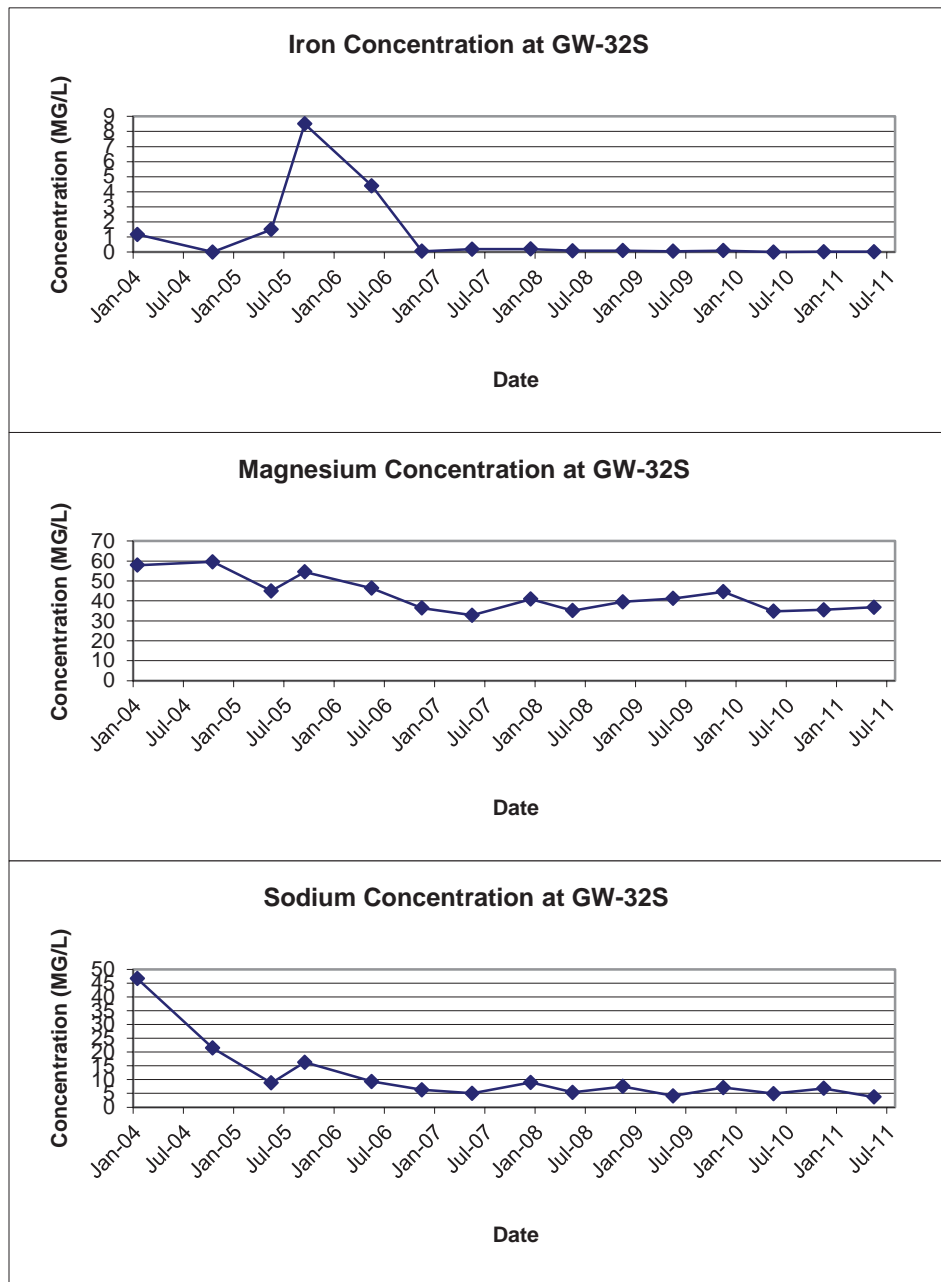


FIGURE E-17
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-33S

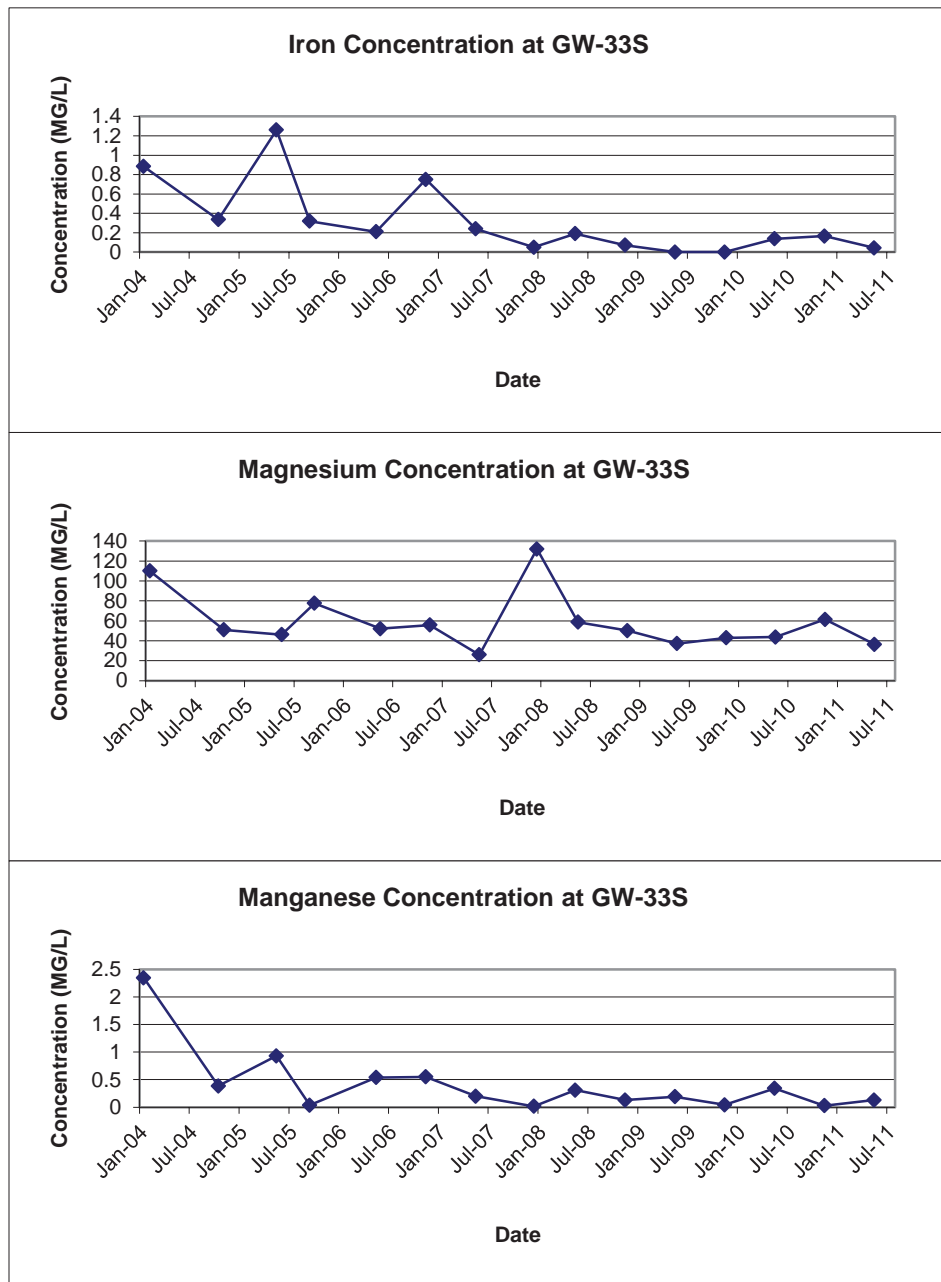


FIGURE E-18
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-34S


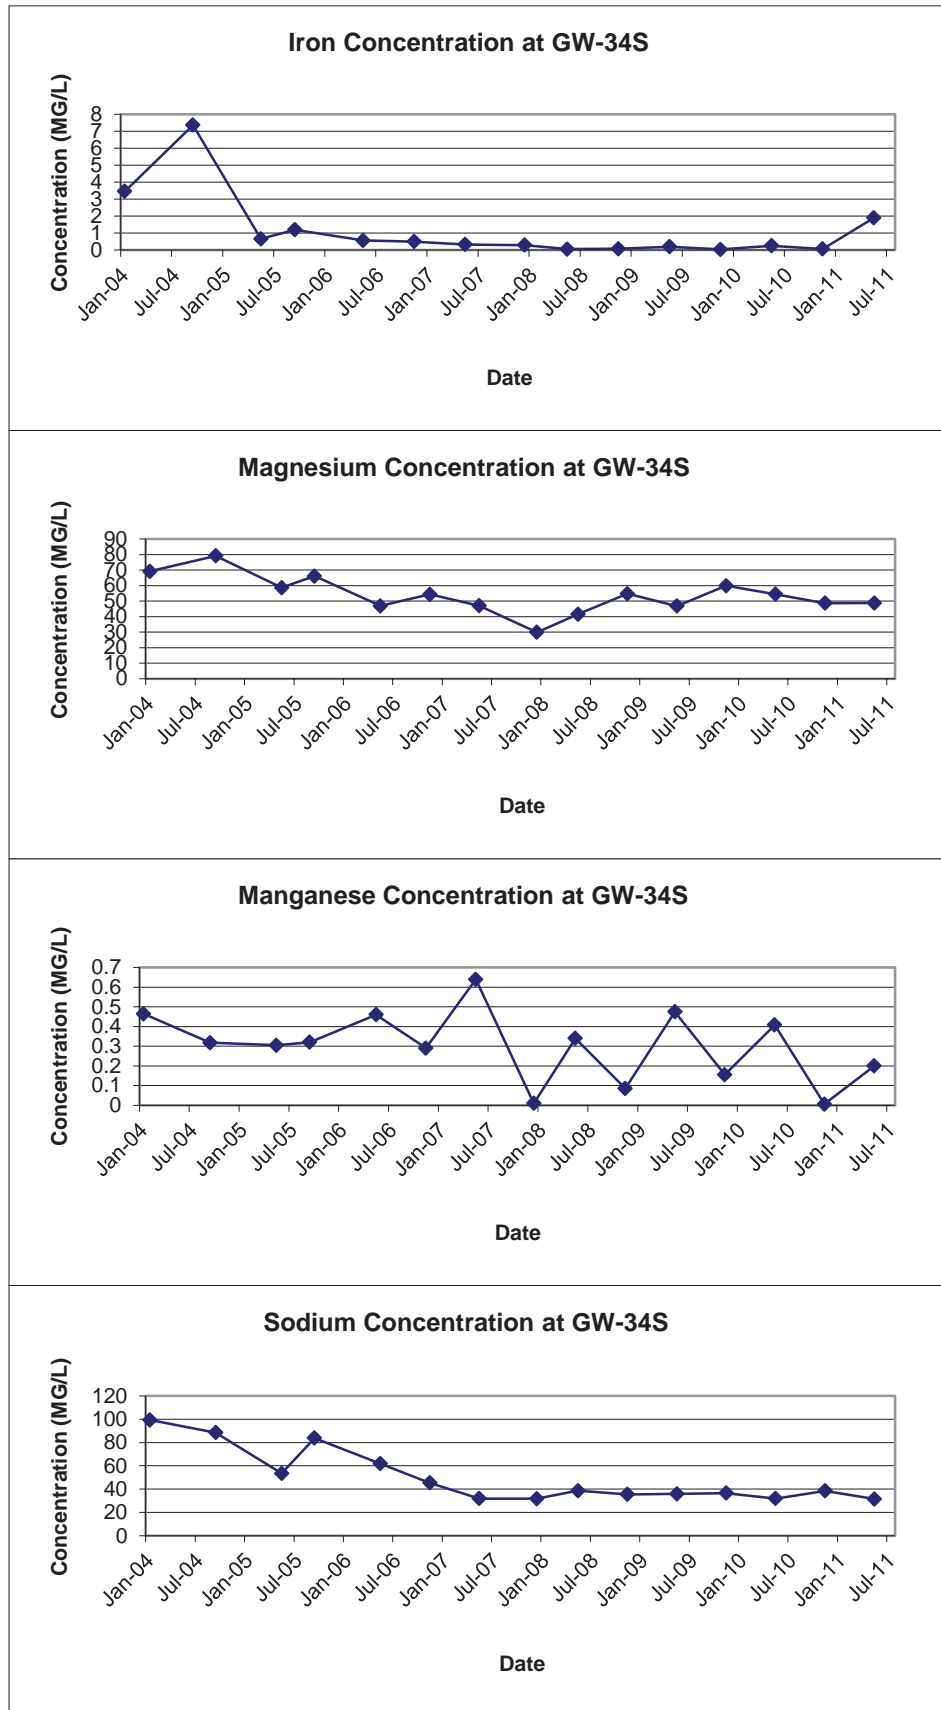


FIGURE E-19
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-35S

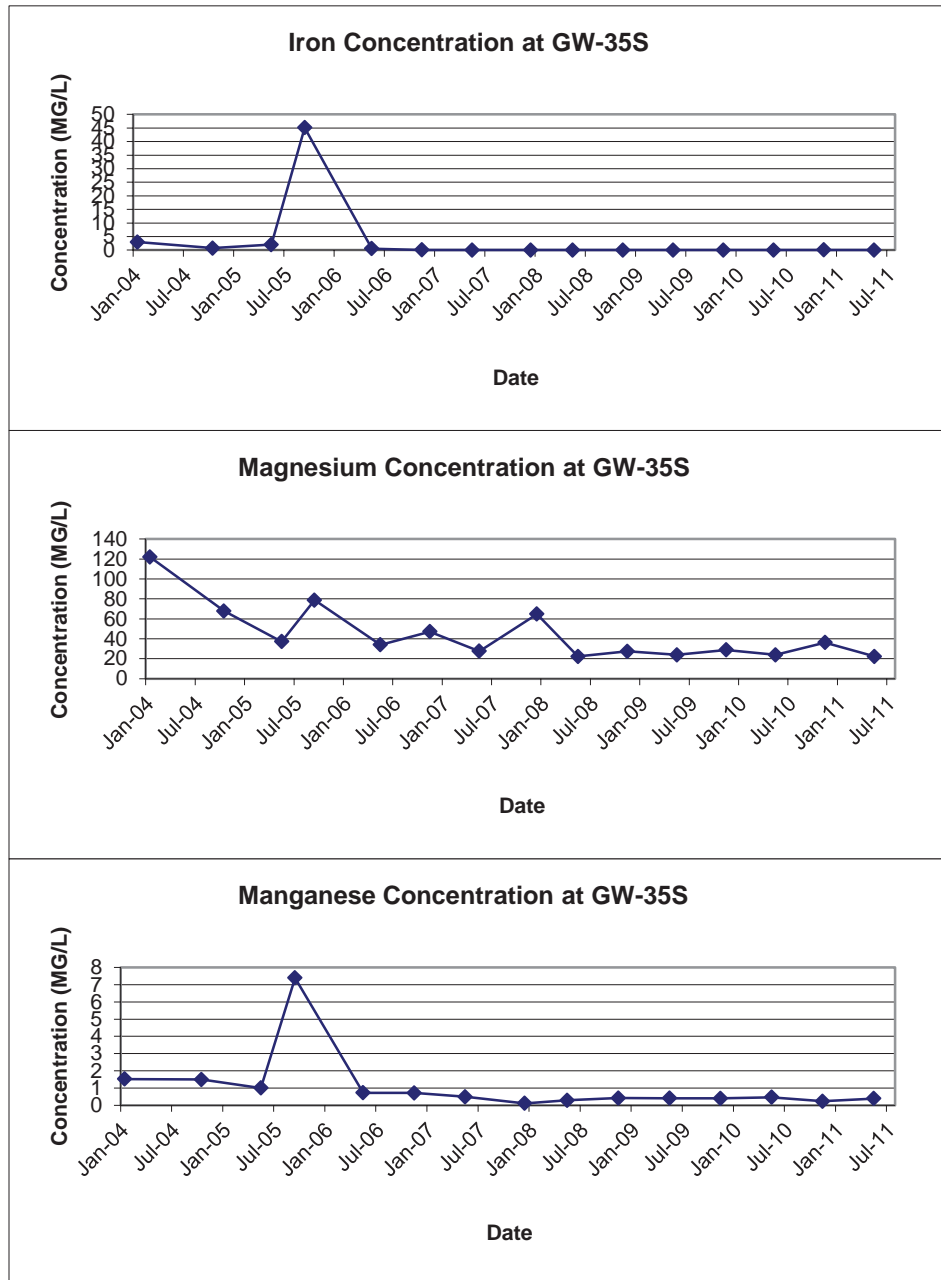

APPENDIX F

BSA PERMIT NO. 10-11-CH016

**AUTHORIZATION TO DISCHARGE UNDER THE BUFFALO
POLLUTANT DISCHARGE ELIMINATION SYSTEM**

**PERMIT NO. 10-11-CH016
USEPA Category 40 CFR Part 403**

In accordance with the provisions of the Federal Water Pollution Control Act, as amended, and the Sewer Regulations of the Buffalo Sewer Authority, authorization is hereby granted to:

THE TOWN OF CHEEKTOWAGA

to discharge wastewater from a facility located at:

PFOHL BROTHERS LANDFILL REMEDIATION SITE

1000 AERO DRIVE


CHEEKTOWAGA, NEW YORK 14225

The wastewater permitted herein shall be discharged to the Town of Cheektowaga sewer system, which is connected to the Buffalo Municipal Sewer System and Treatment facilities, and which wastewater will be treated at the Buffalo Sewer Authority's Treatment Plant.

Issuance of this permit is based upon a permit application filed on **November 3, 2005** analytical data. This permit is granted in accordance with discharge limitations, monitoring requirements and other conditions set forth in Parts I and II hereof.

Effective this 1st^{day} of November, 2010

To Expire the 31st day of March, 2013



General Manager

Signed this 30th day of September, 2010

PART I: SPECIFIC CONDITIONS**A. DISCHARGE LIMITATIONS & MONITORING REQUIREMENTS**

During the period beginning the effective date of this Permit and lasting until the expiration date, discharge from the permitted facility outfall (see attached map) shall be limited and monitored quarterly by the permittee as specified below.

Sample Point	Parameter	Discharge Limitations ⁽¹⁾	Sampling Requirements	
		Daily Max	Period	Type
001	pH	5.0 - 12.0 S.U.	1 day	Composite ²
	Total Cadmium	1.17 lbs.	1 day	Composite ²
	Total Chromium	1.17 lbs.	1 day	Composite ²
	Total Copper	3.74 lbs.	1 day	Composite ²
	Total Lead	1.17 lbs.	1 day	Composite ²
	Total Nickel	3.27 lbs.	1 day	Composite ²
	Total Zinc	5.84 lbs.	1 day	Composite ²
	Total Barium	2.34 lbs.	1 day	Composite ²
	Total Suspended Solids ⁵	250 mg/l	1 day	Composite ²
	Total Flow	140,100 gallons ⁶	1 day	Discharge meter reading

Footnotes are explained on page 5.

PART I: SPECIFIC CONDITIONS**A. DISCHARGE LIMITATIONS & MONITORING REQUIREMENTS**

During the period beginning the effective date of this Permit and lasting until the expiration date, discharge from the permitted facility outfall (see attached map) shall be limited and monitored **once** by the permittee as specified below.

Sample Point	Parameter	Discharge Limitations ⁽¹⁾	Sampling Requirements	
		Daily Max	Period	Type
001	Total Mercury	0.001 lbs.	1 day	Composite ²
	USEPA Test Method 608 ⁴	To be monitored	1 day	Grab ³
	USEPA Test Method 624 ⁴	To be monitored	1 day	Grab ³
	USEPA Test Method 625 ⁴	To be monitored	1 day	Grab ³

Footnotes are explained on page 5.

PART I: SPECIFIC CONDITIONS

B. DISCHARGE MONITORING REPORTING REQUIREMENTS


During the period beginning the effective date of this permit and lasting until the expiration date, discharge monitoring results shall be summarized and reported **quarterly** by the permittee on the days specified below:

Sample Point	Parameter	Reporting Requirements	
		Initial Report	Subsequent Reports
001	All except USEPA Test Methods 608, 624, 625 & T Mercury	March 31, 2011	Every March 31 st , June 30 th , September 30 th and December 31 st
	USEPA Test Methods 608, 624 and 625 & T Mercury	March 31, 2011	

PART I: SPECIFIC CONDITIONS

C. SPECIAL REQUIREMENTS

1. Mass limits based on an average discharge of 140,100 gpd.
2. Composite samples may be time proportioned.
3. Four grab samples must be collected at equally spaced intervals throughout the sample day. The four (4) grab samples must be composited by a NYSDOH certified laboratory prior to analysis.
4. The permittee must report any compound whose concentration is equal to or greater than 0.01 mg/L. The permittee is not authorized to discharge any of the parameters evaluated by these test procedures which may cause or contribute to a violation of water quality standards or harm the sewerage system. Any parameter detected may, at the discretion of the BSA, be specifically limited and incorporated in this permit.
5. Surchargeable over 250 mg/L.
6. Flow is an action level only. If the permittee consistently exceeds this level, the BSA must be notified so that this permit can be modified.

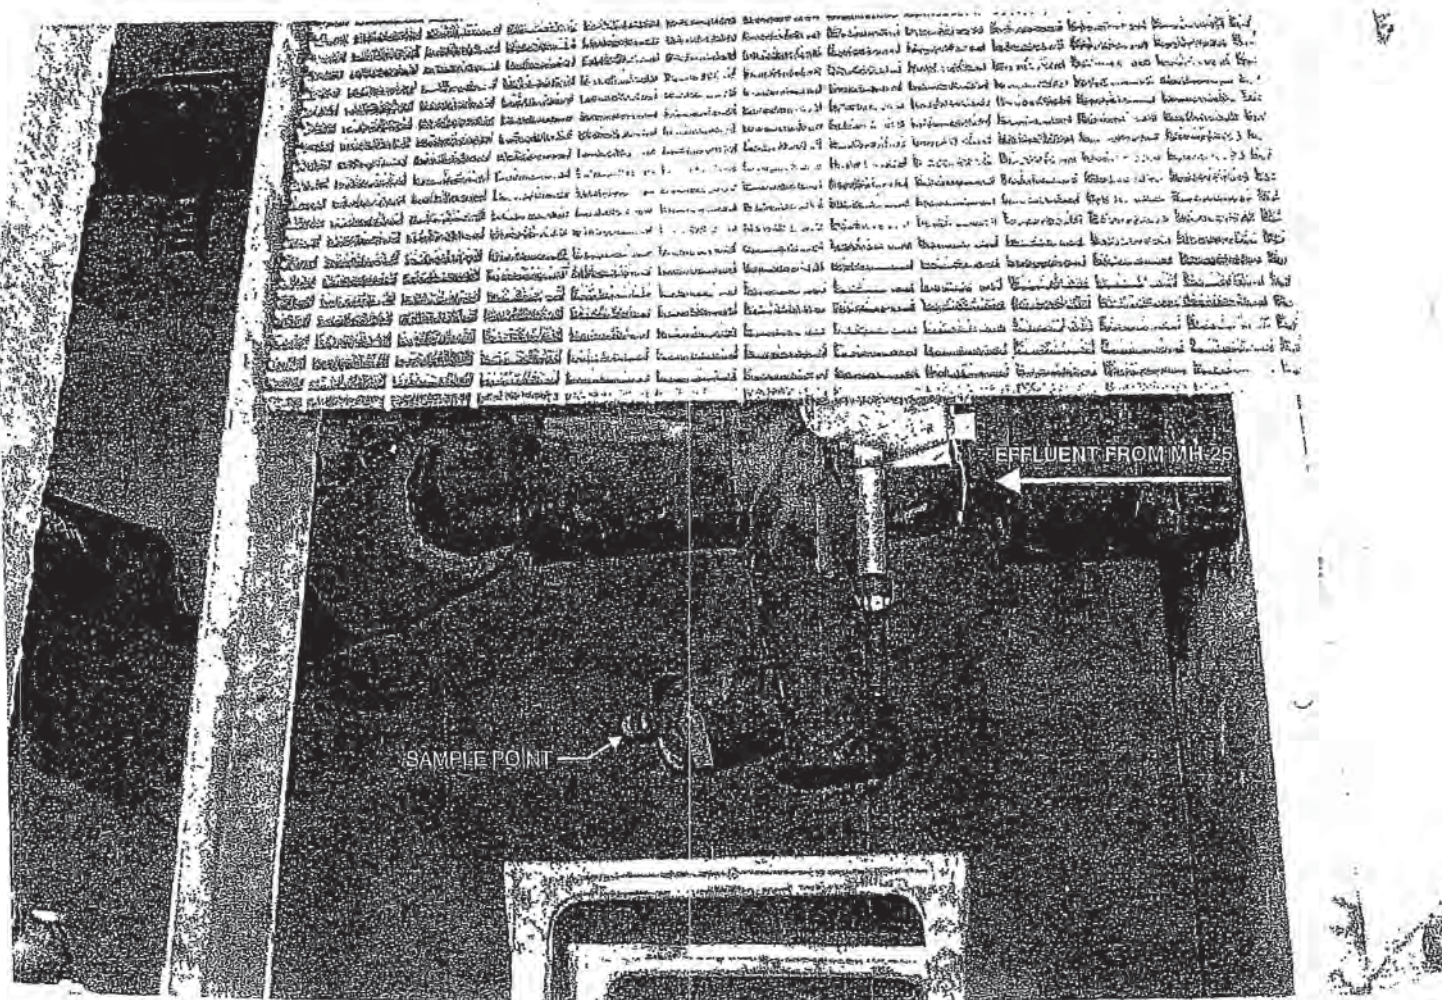**URS**

PFOHL BROTHERS LANDFILL
EFFLUENT SAMPLE POINT

FIGURE 1

TOWN OF CHEEKTOWAGA/BUFFALO POLLUTANT DISCHARGE ELIMINATION SYSTEM
PERMIT

PART II GENERAL CONDITIONS

A. **MONITORING AND REPORTING**

1. **Local Limits**

Except as otherwise specified in this permit, the permit holder shall comply with all specific prohibitions, limits on pollutants or pollutant parameters set forth in the Buffalo Sewer Authority Sewer Use Regulations, as amended from time to time, and such prohibitions, limits and parameters shall be deemed pretreatment standards for purposes of the Clean Water Act

2. **Definitions**

Definitions of terms contained in this permit are as defined in the Town of Cheektowaga Local Law No. 2 and the Buffalo Sewer Authority Sewer Use Regulations.

3. **Discharge Sampling Analysis**

All Wastewater discharge samples and analyses and flow measurements shall be representative of the volume and character of the monitored discharge. Methods employed for flow measurements and sample collections and analyses shall conform to the Buffalo Sewer Authority "Sampling Measurement and Analytical Guidelines Sheet."

4. **Recording of Results**

For each measurement or sample taken pursuant to the requirements of the permit, the Permittee shall record the information as required in the "Sampling Measurement and Analytical Guidelines Sheet."

5. **Additional Monitoring by Permittee**

If the Permittee monitors any pollutants at the location(s) designated herein more frequently than required by this permit, using approved analytical methods as specified in 40 CFR Part 136 the results of such monitoring shall be included in the calculation and reporting of values required under Part I, B. Such increased frequency shall also be indicated.

6. **Reporting**

All reports prepared in accordance with this Permit shall be submitted to:

Mr. William Pugh, P.E.
Town Engineer
275 Alexander Ave.
Cheektowaga, New York, 14211

All self-monitoring reports shall be prepared in accordance with the BSA "Sampling Measurement and Analytical Guidelines Sheet." These reporting requirements shall not relieve the Permittee of any other reports, which may be required by the

N.Y.S.D.E.C. or the U.S.E.P.A.

B. PERMITTEE REQUIREMENTS

1. Change in Discharge

All discharges authorized herein shall be consistent with the terms and conditions of this permit and with the information contained in the TC/BPDES Permit Application on which basis this permit is granted. In the event of any facility expansions, production increases, process modifications or the installation, modification or repair of any pretreatment equipment which may result in new, different or increased discharges of pollutants, a new TC/BPDES Permit Application must be submitted prior to any change. Following receipt of an amended application, the BSA may modify this permit to specify and limit any pollutants not previously limited. In the event that the proposed change will be covered under an applicable Categorical Standard, a Baseline Monitoring Report must be submitted at least ninety (90) days prior to any discharge.

2. Records Retention

All records and information resulting from the monitoring activities required by this permit including all records of analyses performed, calibration and maintenance of instrumentation, and recordings from continuous monitoring instrumentation shall be retained at this facility for a minimum of three (3) years, or longer if requested by the General Manager and/or Town Engineer.

3. Notification of Slug, Accidental Discharge or Spill

In the event that a slug, accidental discharge or any spill occurs at the facility for which this permit is issued, it is the responsibility of the Permittee to immediately notify the B.S.A. Treatment Plant at 883-1820 of the quantity and character of such discharge. If requested by the B.S.A., within five (5) days following all such discharges, the Permittee shall submit a report describing the character and duration of the discharge, the cause of the discharge, and measures taken or that will be taken to prevent a recurrence of such discharge.

4. Noncompliance Notification

If, for any reason, the Permittee does not comply with or will be unable to comply with any discharge limitation specified in this permit, the Permittee or their assigns must verbally notify the Industrial Waste Section at 883-1820 within twenty-four (24) hours of becoming aware of the violation. The Permittee shall provide the Industrial Waste Section with the following information, in writing, within five (5) days of becoming aware of such condition:

- a. a description of the discharge and cause of noncompliance and;
- b. the period of noncompliance, including exact dates and times; or, if not corrected, the anticipated time the noncompliance is expected to continue, and steps being taken to reduce, eliminate and prevent recurrence of the noncomplying discharge.

5. Adverse Impact

The Permittee shall take all reasonable steps to minimize any adverse impact to the Buffalo and Town Sewerage System resulting from noncompliance with any discharge limitations specified in this permit, including such accelerated or additional monitoring as necessary to determine the nature and impact of the noncomplying discharge.

6. Waste Residuals

Solids, sludges, filter backwash or other pollutants removed in the course of treatment or control of wastewaters and/or the treatment of intake waters, shall be disposed of in a manner such as to prevent any pollutant from such materials from entering the Buffalo or Town Sewer System.

7. Power Failures

In order to maintain compliance with the discharge limitations and prohibitions of this permit, the Permittee shall provide an alternative power source sufficient to operate the wastewater control facilities; or, if such alternative power source is not provided the Permittee shall halt, reduce or otherwise control production and/or controlled discharges upon the loss of power to the wastewater control facilities.

8. Treatment Upsets

- a. Any industrial user which experiences an upset in operations that places it in a temporary state of noncompliance, which is not the result of operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation, shall inform the Industrial Waste Section immediately upon becoming aware of the upset. Where such information is given verbally, a written report shall be filed by the user within five (5) days. The report shall contain:
 - (i) A description of the upset, its cause(s) and impact on the discharger's compliance status.
 - (ii) The duration of noncompliance, including exact dates and times of noncompliance, and if the noncompliance is continuing, the time by which compliance is reasonably expected to be restored
 - (iii) All steps taken or planned to reduce, eliminate, and prevent recurrence of such an upset.
- b. An industrial user which complies with the notification provisions of this Section in a timely manner shall have an affirmative defense to any enforcement action brought by the Industrial Waste Section/Town Engineer for any noncompliance of the limits in this permit, which arises out of violations attributable to and alleged to have occurred during the period of the documented and verified upset.

9. Treatment Bypasses

- a. A bypass of the treatment system is prohibited unless the following conditions are met:
 - (i) The bypass was unavoidable to prevent loss of life, personal injury, or severe property damage; or
 - (ii) There was no feasible alternative to the bypass, including the use of auxiliary treatment or retention of the wastewater; and
 - (iii) The industrial user properly notified the Industrial Waste Section as described in paragraph b. below.
- b. Industrial users must provide immediate notice to the Industrial Waste Section upon delivery of an unanticipated bypass. If necessary, the Industrial Waste Section may require the industrial user to submit a written report explaining the cause(s), nature, and duration of the bypass, and the steps being taken to prevent its recurrence.
- c. An industrial user may allow a bypass to occur which does not cause pretreatment standards or requirements to be violated, but only if it is for essential maintenance to ensure efficient operation of the treatment system. Industrial users anticipating a bypass must submit notice to the Industrial Waste Section at least ten (10) days in advance. The Industrial Waste Section may only approve the anticipated bypass if the circumstances satisfy those set forth in paragraph a. above.

C. PERMITTEE RESPONSIBILITIES

1. Permit Availability

The originally signed permit must be available upon request at all times for review at the address stated on the first page of this permit.

2. Inspections

The Permittee shall allow the representatives of the Buffalo Sewer Authority or Town of Cheektowaga upon the presentation of credentials and during normal working hours or at any other reasonable times, to have access to and copy any records required in this permit; and to sample any discharge of pollutants.

3. Transfer of Ownership or Control

In the event of any change in control or ownership of facilities for which this permit has been issued the permit shall become null and void. The succeeding owner shall submit a completed Town of Cheektowaga/ Buffalo Sewer Authority permit application prior to discharge to the sewer system.

D. PERMITTEE LIABILITIES

1. Permit Modification

After notice and opportunity for a hearing, this permit may be modified, suspended, or revoked in whole or in part during its term for cause including, but not limited to the following:

- a. Violation of any terms or conditions of this permit,
- b. Obtaining this permit by misrepresentation or failure to disclose fully all relevant facts,
- c. A change in any condition that requires either a temporary or permanent reduction or elimination of the authorized discharge.

2. Imminent Danger

In the event there exists an imminent danger to health or property, the permitter reserves the right to take immediate action to halt the permitted discharge to the sewerage works.

3. Civil and Criminal Liability

Nothing in this permit shall relieve the Permittee from any requirements, liabilities, or penalties under provisions of the Town of Cheektowaga Local Law No. 2, the "Sewer Regulations of the Buffalo Sewer Authority" or any Federal, State and/or local laws or regulations.

4. Penalties for Violations of Permit Conditions

The "Sewer Regulations of the Buffalo Sewer Authority" and Town of Cheektowaga Local Law No. 2, provide that any person who violates a B.P.D.E.S. permit condition is liable to the Authority and/or the Town for a civil penalty of up to \$10,000 per day for each violation. Any person who willfully or negligently violates permit conditions will be referred to the New York State Attorney General.

E. NATIONAL PRETREATMENT STANDARDS

If a pretreatment standard or prohibition (including any Schedule of Compliance specified in such pretreatment standard or prohibition) is established under Section 307 (b) of the Act for a pollutant which is present in the discharge and such standard or prohibition is more stringent than any limitation for such pollutant in this permit, this permit shall be revised or modified in accordance with such pretreatment standard or prohibition.

F. PLANT CLOSURE

In the event of plant closure, the Permittee is required to notify the Industrial Waste Section/Town Engineer in writing as soon as an anticipated closure date is determined, but in no case later than five (5) days of the actual closure.

G. CONFIDENTIALITY

Except for data determined to be confidential under Section 308 of the Act, all reports prepared in accordance with the terms of this permit shall be available for public inspection at the offices of the Buffalo Sewer Authority or Town Engineer of the Town of Cheektowaga. As required by the Act, effluent data shall not be considered confidential. Knowingly making any false statement on any such report may result in the imposition of criminal penalties as provided for in Section 309 of the Act.

H. SEVERABILITY

The provisions of this permit are severable, and if any provision of this permit, or the application of any provision of this permit to any circumstance, is held invalid, the application of such provision to other circumstances, and the remainder of this permit, shall not be affected thereby.

APPENDIX G

DISCHARGE REPORT SUMMARY TABLES

TABLE 1

**PFOHL BROTHERS LANDFILL - EFFLUENT MONITORING
ANALYTICAL RESULTS, TOTAL FLOW, AND MASS LOADINGS
MARCH 2011**

Sample ID	EFF-033111			
Matrix	Effluent Water			
Date Sampled	3/31/2011			
Parameter	Result	Mass Loading	Discharge Limitation	Violations
	(mg/L)	(lbs/day)	(lbs/day)	(Y/N)
Total Barium	0.17	0.14	2.34	No
Total Cadmuim	ND ⁽¹⁾	NA ⁽²⁾	1.17	No
Total Chromium	0.0024	0.002	1.17	No
Total Copper	0.0031	0.003	3.74	No
Total Lead	ND	NA	1.17	No
Total Mercury*	ND	NA	0.001	No
Total Nickel	0.0043	0.004	3.27	No
Total Zinc	0.011	0.009	5.84	No
Total Suspended Solids	ND	NA	250 ⁽³⁾	No
pH ⁽⁴⁾	7.2	NA	5.0 - 12.0	No
Chlorobenzene*	0.0012	NA	NA	No
Trichloroethene*	0.0014	NA	NA	No
Total Flow ⁽⁵⁾		101,020	140,000	No

Notes:

(1) ND = Not Detected

(2) NA = Not Applicable

(3) Discharge Limitation in units of mg/L

(4) pH measurement and Discharge Limitation in Standard Units

(5) Total Flow reported in gallons, sample was collected over a 24 hour period

* Mercury and organics analysis performed once per permit duration

$$\text{Calculation: } \left(\frac{x \text{ mg}}{\text{L}} \right) \left(\frac{y \text{ gal}}{\text{day}} \right) \left(\frac{1 \text{ lb}}{453,600 \text{ mg}} \right) \left(\frac{3.785 \text{ L}}{\text{gal}} \right) = \frac{x \times y}{119,841} \frac{\text{lb}}{\text{day}}$$

SAMPLING FIELD SHEET



Client Name: Pfohl Brothers Landfill

Address: Aero Drive, Cheektowaga, NY

Contact: Bill Pugh, P.E. Phone: 716-897-7288

Installation:

Sample Point: SP-001

Sample Location: Meter Chamber - ball valve on 6" HDPE forcemain

Date: 3/30/11 Crew: R. Murphy, S. McCabe, T. Ifkovich

Weather: 23° F, Clear

Sampling Device: NA

Time of Installation: 8:50 Type of Sample: Composite

Sample Interval: NA Sample Volume: NA

Comments and Observations: Wells WW-5 and WW-6 running at the time of sample setup.
PLC display volumes: WW-01 (2,712,893 gals), WW-02 (33,924 gals), WW-03 (190,551 gals),
WW-04 (806,013 gals), WW-05 (9,931,482 gals), WW-06 (9,851,884 gals) & MH-25 (23,848,728 gals).

Date: 3/31/11 Crew: R. Murphy, T. Ifkovich, T. Urban

Weather: 33° F, light snow/rain

Time of Collection: 8:50

Field Measurements:

8:55/RJM pH Calibration: Buffer 7- 7 Buffer 4- 4 Buffer 10- 10
(time/initial)

pH Measurement: 7.2

Temperature: 11.0°C

Identification: EFF-033111

Physical Observations: _____

Laboratory: TestAmerica, Buffalo, NY

Comments: Wells WW-5 and WW-6 running at the time of sample collection.
PLC display volumes: WW-01 (2,712,893 gals), WW-02 (33,924 gals), WW-03 (190,551 gals),
WW-04 (806,013 gals), WW-05 (9,952,430 gals), WW-06 (9,930,718 gals) & MH-25 (23,949,748 gals).

Reviewed By: _____ Date: _____
(Supervisor)

TABLE 1

**PFOHL BROTHERS LANDFILL - EFFLUENT MONITORING
ANALYTICAL RESULTS, TOTAL FLOW, AND MASS LOADINGS
JUNE 2011**

Sample ID	EFF-062411			
Matrix	Effluent Water			
Date Sampled	6/24/2011			
Parameter	Result	Mass Loading	Discharge Limitation	Violations
	(mg/L)	(lbs/day)	(lbs/day)	(Y/N)
Total Barium	0.30	0.12	2.34	No
Total Cadmuim	0.00044	0.0002	1.17	No
Total Chromium	0.0019	0.001	1.17	No
Total Copper	0.01	0.004	3.74	No
Total Lead	0.0068	0.003	1.17	No
Total Nickel	0.0065	0.003	3.27	No
Total Zinc	0.032	0.01	5.84	No
Total Suspended Solids	76.4	NA ⁽¹⁾	250 ⁽²⁾	No
pH ⁽³⁾	7.5	NA	5.0 - 12.0	No
Total Flow ⁽⁴⁾		47,224	140,000	No

Notes:

(1) NA = Not Applicable

(2) Discharge Limitation in units of mg/L

(3) pH measurement and Discharge Limitation in Standard Units

(4) Total Flow reported in gallons, sample was collected over a 24 hour period

$$\text{Calculation: } \left(\frac{x \text{ mg}}{\text{L}} \right) \left(\frac{y \text{ gal}}{\text{day}} \right) \left(\frac{1 \text{ lb}}{453,600 \text{ mg}} \right) \left(\frac{3.785 \text{ L}}{\text{gal}} \right) = \frac{x \times y}{119,841} \frac{\text{lb}}{\text{day}}$$

SAMPLING FIELD SHEET



Client Name: Pfohl Brothers Landfill

Address: Aero Drive, Cheektowaga, NY

Contact: Bill Pugh, P.E. Phone: 716-897-7288

Installation:

Sample Point: SP-001

Sample Location: Meter Chamber - ball valve on 6" HDPE forcemain

Date: 6/23/11 Crew: R. Murphy, T. Urban, S. Conway

Weather: 72° F, Partly Cloudy

Sampling Device: NA

Time of Installation: 9:05 Type of Sample: Composite

Sample Interval: NA Sample Volume: NA

Comments and Observations: Wells WW-4 and WW-5 were running at the time of sample setup.
PLC display volumes: WW-01 (3,478,353 gals), WW-02 (15,022 gals), WW-03 (243,638 gals),
WW-04 (1,621,884 gals), WW-05 (1,220,454 gals), WW-06 (1,125,715 gals) & MH-25 (28,067,160 gals).

Date: 6/24/11 Crew: R. Murphy, T. Urban, S. Conway

Weather: 67° F, Rain

Time of Collection: 9:05

Field Measurements:

9:05/RJM
(time/initial)

pH Calibration: Buffer 7- 7 Buffer 4- 4 Buffer 10- 10

pH Measurement: 7.5

Temperature: 18.5°C

Identification: EFF-062411

Physical Observations: _____

Laboratory: TestAmerica, Buffalo, NY

Comments: Wells WW-4 and WW-5 were running at the time of sample collection.
PLC display volumes: WW-01 (3,478,353 gals), WW-02 (15,022 gals), WW-03 (243,638 gals),
WW-04 (1,648,545 gals), WW-05 (1,241,811 gals), WW-06 (1,125,715 gals) & MH-25 (28,114,384 gals).

Reviewed By: _____ Date: _____
(Supervisor)

APPENDIX H

MONITORING WELL INSPECTION LOGS

WELL INSPECTION SUMMARY

Project Name: Pfohl Brothers Landfill

Project Number: 11175616.00000

Inspection Crew Members: R. Murphy, K. McGovern

Supervisor: J. Sundquist

Date(s) of Inspection: May 16, 2011

<i>Well I.D. Number</i>	<i>Lock</i>	<i>Surface Seal</i>	<i>Protective Casing</i>	<i>Riser</i>	<i>Water Level (ft. BTOC)</i>	<i>Well Depth (ft. BTOC)</i>	<i>Other Comments</i>
GW-1S	OK	OK	OK	Bulged	1.95	14.94	
GW-1D	OK	OK	OK	Bulged	1.03	39.65	
GW-3S	OK	OK	OK	OK	2.02	13.22	
GW-3D	OK	OK	OK	OK	1.16	35.70	
GW-4S	OK	OK	OK	OK	3.96	16.23	
GW-4D	OK	OK	OK	OK	12.33	45.57	
GW-7S	OK	OK	OK	OK	3.83	35.04	
GW-7D	OK	OK	OK	Damaged	44.77	60.45	

Additional Comments:

WELL INSPECTION SUMMARY

Project Name: Pfohl Brothers Landfill Project Number: 11175616.00000

Inspection Crew Members: R. Murphy, K. McGovern Supervisor: J. Sundquist

Date(s) of Inspection: May 16, 2011

<i>Well I.D. Number</i>	<i>Lock</i>	<i>Surface Seal</i>	<i>Protective Casing</i>	<i>Riser</i>	<i>Water Level (ft. BTOC)</i>	<i>Well Depth (ft. BTOC)</i>	<i>Other Comments</i>
GW-8SR	OK	OK	OK	OK	4.74	13.02	
GW-8D	OK	OK	OK	OK	5.07	36.54	
GW-26D	OK	OK	OK	OK	5.97	40.70	
GW-28S	OK	OK	OK	OK	8.31	15.54	
GW-29S	OK	OK	OK	OK	5.65	20.02	
GW-30S	OK	OK	OK	OK	4.81	17.97	
GW-31S	OK	OK	OK	OK	2.03	9.57	
GW-32S	OK	OK	OK	OK	1.83	9.93	

Additional Comments:

WELL INSPECTION SUMMARY

Project Name: Pfohl Brothers Landfill

Project Number: 11175616.00000

Inspection Crew Members: R. Murphy, K. McGovern

Supervisor: J. Sundquist

Date(s) of Inspection: May 16, 2011

<i>Well I.D. Number</i>	<i>Lock</i>	<i>Surface Seal</i>	<i>Protective Casing</i>	<i>Riser</i>	<i>Water Level (ft. BTOC)</i>	<i>Well Depth (ft. BTOC)</i>	<i>Other Comments</i>
GW-33S	OK	OK	OK	OK	2.75	8.21	
GW-34S	OK	OK	OK	OK	2.58	10.00	
GW-35S	OK	OK	OK	OK	2.68	7.46	

Additional Comments:

ATTACHMENT B

July 2011 – December 2011

Semi Annual Report

**SEMI ANNUAL REPORT
OPERATION AND MAINTENANCE
JULY 2011 TO DECEMBER 2011
PFOHL BROTHERS LANDFILL
CHEEKTOWAGA, NY**

Submitted to:

**NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION
270 MICHIGAN AVENUE
BUFFALO, NEW YORK 14203**

Prepared by:

**URS CORPORATION
77 GOODELL STREET
BUFFALO, NEW YORK 14203**

Prepared for:

**TOWN OF CHEEKTOWAGA
ENGINEERING DEPARTMENT
275 ALEXANDER AVE
CHEEKTOWAGA, NEW YORK 14211**

**MARCH
2012**



March 12, 2012

Mr. Jaspal Singh Walia, P.E.
New York State Department of Environmental Conservation
270 Michigan Ave.
Buffalo, NY 14203

**Re: Semi-Annual Report
 Pfohl Brothers Landfill, Town of Cheektowaga, New York**

Dear Mr. Walia:

Enclosed is one copy of the sixteenth Semi-Annual Report for the Pfohl Brothers Landfill in Cheektowaga, New York. A copy has also been sent to Ms. Pamela Tames, P.E. of the United States Environmental Protection Agency. Also enclosed is the Data Applicability Report for laboratory analyses associated with the Semi-Annual Report. PDF copies of the reports are also enclosed.

If you have any questions on this report, please feel free to contact me.

Sincerely,

URS CORPORATION

A handwritten signature in black ink, appearing to read "Jon Sundquist", is positioned above the printed name.

Jon Sundquist, Ph.D.
Project Manager

Enclosures

cc: Pamela Tames, P.E. - USEPA (w/attachments)
 William Pugh, P.E. – Town of Cheektowaga (w/attachments)
 File 11172700 (C-1)

TABLE OF CONTENTS

	<u>Page No.</u>
1.0 INTRODUCTION	1-1
1.1 Background.....	1-1
1.2 Operation and Maintenance Activities.....	1-1
2.0 GENERAL MAINTENANCE ACTIVITIES.....	2-1
3.0 MONITORING ACTIVITIES.....	3-1
3.1 Groundwater Hydraulic Monitoring	3-1
3.2 Groundwater Quality Monitoring	3-1
3.3 Groundwater Discharge Monitoring	3-5
3.4 Monitoring Well Inspections	3-6
4.0 SUMMARY AND RECOMMENDATIONS.....	4-1

TABLES

Table 3-1	Groundwater Sample Analytical Results
Table 3-2	Approved Revision Of Table 3.2 From The O&M Plan

FIGURES

Figure 1-1	Site Location Map
Figure 3-1	Monitoring Locations

APPENDICES

Appendix A	Example Daily Inspection Sheets
Appendix B	Monthly Flow Summaries (July 2011 – December 2011)
Appendix C	Hydraulic Monitoring Tables
Appendix D	Groundwater Purge and Sample Collection Logs
Appendix E	Historical Analytical Results
Appendix F	BSA Permit No. 10-11-CH016
Appendix G	Discharge Report Summary Tables
Appendix H	Monitoring Well Inspection Logs

1.0 INTRODUCTION

1.1 Background

The Pfohl Brothers Landfill is located on Aero Drive in the Town of Cheektowaga, New York (Figure 1-1). The site is listed as site No. 9-15-043 on the New York State Department of Environmental Conservation's (NYSDEC's) Registry of Inactive Hazardous Waste Disposal Sites. A Consent Order between NYSDEC and potentially responsible parties (PRPs) for closure of the site was signed in 2001 and remedial construction commenced in 2001. The remedy included consolidation of waste material, capping of the waste disposal and consolidation areas, and encircling the landfill areas with a groundwater collection system to prevent off-site migration. The remedial action was completed in 2002.

Responsibility for implementing the remedy was divided between a "steering committee" of industrial PRPs and the Town of Cheektowaga. The steering committee responsibilities lay generally with the capital construction activities of the remedy including waste consolidation, cap and drainage system installation, etc. The Town of Cheektowaga, which was named as a PRP for disposal of municipal waste at the Pfohl Brothers Landfill when it was operating, is performing the operation and maintenance (O&M) activities at the landfill, pursuant to a settlement agreement between the Town and the steering committee.

1.2 Operation and Maintenance Activities

While construction of the remedy was substantially complete by late 2002, the final O&M manual was not approved by the NYSDEC until March 10, 2006. However, the Town of Cheektowaga and its consultant (URS Corporation) assumed most of the operational responsibilities since 2002. This includes a variety of general maintenance activities as outlined in Section 2 and sampling and other monitoring activities outlined in Section 3.

Beginning in 2004, the Town and URS assumed all of the O&M activities described in the O&M plan. This report is the sixteenth semi-annual report as called for by Section 3.6 of the O&M plan.

2.0 GENERAL MAINTENANCE ACTIVITIES

Since completion of construction activities in 2002, personnel from the Town of Cheektowaga Engineering Department have performed general activities to ensure the physical operation of the landfill as intended by the design. The various O&M activities performed by the Town from July 2011 through December 2011 include the following actions.

- The amount of groundwater discharged through the collection system was recorded on a daily basis. The flow rate displayed by each wet well pump at the time of daily inspection and the total cumulative volume of flow was recorded for each wet well on daily inspection sheets. Examples of the daily inspection sheet are attached in Appendix A.
- Total cumulative effluent flow rates and volumes were summarized on a monthly basis starting in February 2003. The monthly totals for the period of July 2011 through December 2011, including graphs showing daily total discharge (gallons) as a function of calendar day, are presented in Appendix B.
- The wet well pumps were shutdown during wet weather flow conditions throughout the year to reduce hydraulic loading to the sewer. Such actions were only taken upon request of the Buffalo Sewer Authority during heavy storm events in order to reduce the hydraulic load on the BSA treatment system during such events. Shutdown events are recorded and included with the monthly flow data as previously requested by NYSDEC.
- Plowed snow to access the Control Building when necessary.
- Cleaned/replaced check valves as necessary at all wet wells.
- Replaced surge suppressors and fuses as needed for pump station instrumentation equipment.
- Performed annual mowing and trimming of landfill cap in September 2011.

- Engaged contractor to apply Roundup herbicide to control vegetation growth the stone access road (applied on September 22, 2011).
- Purchased a supply of surge protection devices for inventory.
- Wildlife trapper engaged as needed to control ground burrowing animals. A total of 13 woodchucks were trapped during August and September 2011.

3.0 MONITORING ACTIVITIES

The Town of Cheektowaga retained URS Corporation to perform monitoring activities as outlined in Section 3.1 of the O&M plan. During the period of January 2004 through the present, URS performed groundwater hydraulic monitoring (Section 3.1.1.2 of the O&M plan) and effluent monitoring (Section 3.1.4 of the O&M plan) on a quarterly basis. URS also performed the sixteenth semi-annual groundwater quality monitoring event (Section 3.1.1.3 of the O&M plan). A summary of the monitoring activities is presented in the following subsections. Hydraulic and groundwater sampling locations are shown on Figure 3-1.

3.1 Groundwater Hydraulic Monitoring

Groundwater and surface water elevations were monitored on a quarterly basis at all locations listed in Table 3.1 of the O&M Plan. The hydraulic monitoring data tables showing groundwater elevations are presented in Appendix C. Table 1 of this appendix lists the measured elevations. Table 2 provides a comparison of the measured levels in the wells and corresponding manholes/wet wells.

The data presented in Appendix C indicate that groundwater levels outside the collection system were higher than the levels measured in the corresponding wet well or manhole for each measurement date with one exception. The pairing of WW-6 and GW-34S exhibited an outward gradient during the September 22, 2011 monitoring event. However, the groundwater elevation recorded at GW-34S was unusually low during this measurement, and the gradient returned to an inward gradient during the November 1, 2011 and December 20, 2011 measurements. Therefore, these data demonstrate that the collection system is operating as designed.

3.2 Groundwater Quality Monitoring

The sixteenth semi-annual round of groundwater sampling was conducted between November 1, 2011 and November 3, 2011. All wells listed in Table 3.2 of the O&M plan were

purged and sampled using dedicated/disposable equipment. Figure 3-1 shows the well locations. Low flow sampling techniques were used on most wells.

Passive diffusion bags (PDBs) were placed in three wells with low recharge rates (GW-4S, GW-7S, and GW-7D) on September 23, 2011. The PDBs were removed from the wells during the sampling event and their contents were analyzed for VOCs. Following removal of the PDBs the three wells were purged dry. These wells were sampled for the other required parameters after their water levels recovered.

Purge logs and sampling summary sheets are provided in Appendix D. Measurements of pH, specific conductivity, temperature, dissolved oxygen, oxidation reduction potential, and turbidity taken during purging are provided in Appendix D. The samples were packed with ice in coolers and transported under chain-of-custody (CoC) control to Test America Laboratories of Amherst, New York.

Groundwater samples were analyzed for the parameters listed in Table 3.2 of the O&M plan as revised in accordance with Table 3-6 in the Semi Annual Report dated September 2007 (January through June 2007) and as approved by the December 6, 2006 and November 29, 2007 correspondence from the NYSDEC authorizing a reduction in the parameters list (this table is included in this report as Table 3-2). Table 3-1 of this report presents the groundwater sample results compared with NYSDEC Ambient Water Quality Standards and Guidance Values and Groundwater Effluent Limitations Class GA water quality standards.

Results

No VOCs or SVOCs were detected at concentrations above the Class GA water quality standards at any location.

Among the metals, iron, magnesium, manganese, and sodium routinely exceed Class GA standards in most site wells. Chromium was detected at concentrations exceeding Class GA standards in wells GW-04S and GW-07D. Lead was detected at a concentration exceeding Class GA standards in well GW-07D. Mercury was detected at a concentration exceeding Class GA

standards in well GW-04S. Nickel was detected at concentrations exceeding groundwater standards in wells GW-03S and GW-07D.

Comparison to Historical Results

No significant changes in metals concentrations were observed when compared to previous sampling event analytical results. The concentration of iron, magnesium, manganese, and sodium in most site wells was similar to the concentrations found during previous sampling events with the exception of location GW-04S. Concentrations of iron, magnesium, and manganese in this well were the highest they have been in the last five years.

The concentrations of chromium and nickel at GW-07D and GW-03S, and lead at GW-07D were within the historical range of concentrations observed for these compounds at these wells.

Sodium concentrations were generally higher in bedrock wells (GW-01D, GW-3D, GW-8D and GW-26D) and shallow wells adjacent to roads (GW-01S and GW-30S). The sodium concentration was also elevated in GW-08SR. The higher sodium concentrations in the bedrock wells may be attributed to the local bedrock composition and the elevated concentration in the shallow wells may be the result of seasonal road de-icing activities.

Trend Analysis

Appendix E, Figures E-1 through E-19 presents a trend analysis of groundwater parameters that routinely exceed Class GA groundwater standards. A review of the trend analysis indicated that no significant changes or trends in concentrations of any of the parameters exceeding groundwater standards have occurred over the sixteen semi-annual sampling events except as described below. Figure E-2 for GW-01S, indicates a consistent drop in sodium concentration over the sixteen sampling events. Figure E-4 for GW-03S indicates an upward trend for nickel since monitoring began (although concentrations were significantly lower during the last four events) Figure E-4 also indicates an upward trend for magnesium in GW-03S since monitoring began. Figure E-5 for GW-04D, indicates a slight increasing trend for magnesium. Figure E-9 for GW-08D shows a decreasing trend for both iron and manganese since monitoring began. Figure E-10 for GW-08SR shows an upward trend in sodium concentration since

monitoring began. Figure E-12 for GW-28S, indicates a decreasing trend for sodium since monitoring began.

Laboratory Report

The groundwater analytical data package was prepared by Test America in accordance with NYSDEC Category A deliverable requirements. It was reviewed for compliance with analytical method requirements and the following guidelines: USEPA *Contract Laboratory Program (CLP) National Functional Guidelines for Organic Data Review*, EPA-540-R-99-008, October 1999; USEPA *CLP National Functional Guidelines for Inorganic Data Review*, EPA-540-R-01-008, July 2002; and USEPA *Region II Data Validation SOP for SW-846 Method 8290, PCDDs and PCDFs by High Resolution Gas Chromatography/High-Resolution Mass Spectrometry (HRGC/HRMS)*, SOP No. HW-19, Revision 1, October 1994. Qualifications applied to the data include “J/UJ” (estimated concentration/estimated quantitation limit), “J+” (estimated concentration with possible high bias), “J-” (estimated concentration with possible low bias), and “U” (not detected).

A Data Applicability Report (DAR) was prepared following the guidelines provided in NYSDEC Division of Environmental Remediation (DER-10) *Technical Guidance for Site Investigation and Remediation, Appendix 2B*, dated May 2010. The DAR dated January 2012 is submitted separately from this report.

3.3 Groundwater Discharge Monitoring

URS completed two quarterly sampling events (September 2011 and December 2011) of the groundwater collection system discharge since the previous semi-annual report. The sampling was performed in accordance with the requirements of Discharge Permit No. 10-11-CH016 between the Buffalo Sewer Authority and the Town of Cheektowaga. A copy of Permit No. 10-11-CH016 is included as Appendix F.

During the sampling events in September 2011 and December 2011, each regulated parameter was below the limits set by the permit. Copies of the data summary tables that were included with the monitoring reports are included as Appendix G.

3.4 Monitoring Well Inspections

During the November 2011 groundwater sampling event, a well inspection was performed. All wells appeared to be in good condition with the exception of previously existing damage to the risers on GW-07D, GW-01S, and GW-01D. The monitoring well inspection logs may be found in Appendix H.

4.0 SUMMARY AND RECOMMENDATIONS

General Maintenance: The Town will continue to maintain mechanical equipment at the landfill on an as-needed basis and operate the groundwater collection and discharge system as designed. The Town will also continue regular inspections, mow the cap once per year, and plow access to the control building during winter months as necessary.

Groundwater Hydraulic Monitoring: Hydraulic monitoring has been performed on a quarterly basis in conjunction with the discharge monitoring. Water level measurement data demonstrates that the hydraulic gradient is from outside the landfill towards the collection trench. Continued quarterly monitoring is recommended.

Groundwater Quality Monitoring: Groundwater sample results indicate that only low levels of organic compounds and metals are present. Similar concentrations of most parameters were found during previous sampling events. The seventeenth round of groundwater sampling will be conducted in May 2012. Low flow sampling techniques will be used. Passive diffusion bags will be used again for VOC analyses at the three wells (GW-4S, GW-7S, and GW-7D) that go dry even using low flow sampling techniques.

Groundwater Discharge Monitoring: Groundwater discharges remain within permit limits. Continued quarterly monitoring is recommended.

Surface Water and Sediment Sampling: URS asked that the NYSDEC consider the discontinuation of surface water and sediment sampling at the site in the January to June 2008 Semiannual Report. No future surface water or sediment sampling is planned.

TABLES

TABLE 3-1
GROUNDWATER SAMPLE ANALYTICAL RESULTS
PFOHL BROTHERS LANDFILL SITE
NOVEMBER 2011

Location ID			GW-01D	GW-01S	GW-03D	GW-03S	GW-04D
Sample ID			GW-1D	GW-1S	GW-3D	GW-3S	GW-04D
Matrix			Groundwater	Groundwater	Groundwater	Groundwater	Groundwater
Depth Interval (ft)			-	-	-	-	-
Date Sampled			11/03/11	11/03/11	11/01/11	11/01/11	11/02/11
Parameter	Units	*					
Volatile Organic Compounds							
1,2-Dichloroethene (total)	UG/L	5					
Semivolatile Organic Compounds							
1,3-Dichlorobenzene	UG/L	3			1.5 J		
1,4-Dichlorobenzene	UG/L	3			1.8 J		
bis(2-Ethylhexyl)phthalate	UG/L	5					
Arsenic	MG/L	0.025					
Barium	MG/L	1	0.069	0.19	0.072	0.16	0.066
Cadmium	MG/L	0.005				0.00056 J	
Chromium	MG/L	0.05				0.039	0.0011 J
Copper	MG/L	0.2				0.0030 J	0.0019 J
Iron	MG/L	0.3	0.10	7.0	1.5	0.15	0.49
Lead	MG/L	0.025					
Magnesium	MG/L	35	33.5	15.5	15.5	79.8	66.0
Manganese	MG/L	0.3	0.017	1.2	0.52	0.052	0.020
Mercury	MG/L	7.00E-04					
Nickel	MG/L	0.1			0.0035 J	0.13	
Silver	MG/L	0.05				0.0020 J	
Sodium	MG/L	20	85.1	109	159	28.4	71.8
Zinc	MG/L	2	0.0020 J	0.0017 J		0.0090 J	0.0060 J

* - NYSDEC TOGS (1.1.1), Ambient Water Quality Standards and Guidance Values and Groundwater Effluent Limitations. June 1998 (includes 4/2000 Addendum). Class GA. * - PCB Criteria based on sum of the aroclors.

Flags assigned during chemistry validation are shown.



Concentration Exceeds

J - The analyte was positively identified, the quantitation is an estimation.

Blank - not detected. - = No criteria.

Only Detected Results Reported.

TABLE 3-1
GROUNDWATER SAMPLE ANALYTICAL RESULTS
PFOHL BROTHERS LANDFILL SITE
NOVEMBER 2011

Location ID			GW-04S	GW-07D	GW-07D	GW-07S	GW-07S
Sample ID			GW-04S	GW-7D	GW-7D	GW-7S	GW-7S
Matrix			Groundwater	Groundwater	Groundwater	Groundwater	Groundwater
Depth Interval (ft)			-	-	-	-	-
Date Sampled			11/02/11	11/01/11	11/02/11	11/01/11	11/02/11
Parameter	Units	*					
Volatile Organic Compounds							
1,2-Dichloroethene (total)	UG/L	5			NA		NA
Semivolatile Organic Compounds							
1,3-Dichlorobenzene	UG/L	3		NA		NA	
1,4-Dichlorobenzene	UG/L	3		NA		NA	
bis(2-Ethylhexyl)phthalate	UG/L	5		NA	3.8 J	NA	2.1 J
Arsenic	MG/L	0.025	0.0070 J	NA	0.0068 J	NA	
Barium	MG/L	1	0.24	NA	0.068	NA	0.25
Cadmium	MG/L	0.005	0.00086 J	NA	0.0021	NA	0.00063 J
Chromium	MG/L	0.05	0.084	NA	0.26	NA	0.0092
Copper	MG/L	0.2	0.032	NA	0.037	NA	
Iron	MG/L	0.3	18.4	NA	21.1	NA	0.31
Lead	MG/L	0.025		NA	0.20	NA	
Magnesium	MG/L	35	35.8	NA	32.1	NA	33.3
Manganese	MG/L	0.3	0.66	NA	0.13	NA	0.052
Mercury	MG/L	7.00E-04	0.00076	NA		NA	
Nickel	MG/L	0.1	0.047	NA	0.13	NA	0.023
Silver	MG/L	0.05		NA		NA	
Sodium	MG/L	20	26.9	NA	84.2	NA	55.9
Zinc	MG/L	2	0.11	NA	0.088	NA	0.0070 J

* - NYSDEC TOGS (1.1.1), Ambient Water Quality Standards and Guidance Values and Groundwater Effluent Limitations. June 1998 (includes 4/2000 Addendum). Class GA. * - PCB Criteria based on sum of the aroclors.

Flags assigned during chemistry validation are shown.



Concentration Exceeds

J - The analyte was positively identified, the quantitation is an estimation.

Blank - not detected. - = No criteria.

Only Detected Results Reported.

TABLE 3-1
GROUNDWATER SAMPLE ANALYTICAL RESULTS
PFOHL BROTHERS LANDFILL SITE
NOVEMBER 2011

Location ID			GW-08D	GW-08D	GW-08SR	GW-26D	GW-28S
Sample ID			DUPLICATE	GW-8D	GW-8SR	GW-26D	GW-28S
Matrix			Groundwater	Groundwater	Groundwater	Groundwater	Groundwater
Depth Interval (ft)			-	-	-	-	-
Date Sampled			11/01/11	11/01/11	11/01/11	11/02/11	11/02/11
Parameter	Units	*	Field Duplicate (1-1)				
Volatile Organic Compounds							
1,2-Dichloroethene (total)	UG/L	5				1.4 J	
Semivolatile Organic Compounds							
1,3-Dichlorobenzene	UG/L	3					
1,4-Dichlorobenzene	UG/L	3					
bis(2-Ethylhexyl)phthalate	UG/L	5					
Arsenic	MG/L	0.025			0.0065 J	0.0070 J	
Barium	MG/L	1	0.12	0.12	0.53	0.17	0.083
Cadmium	MG/L	0.005	0.00039 J	0.00045 J	0.00059 J		0.00044 J
Chromium	MG/L	0.05	0.0096	0.0087	0.0022 J		
Copper	MG/L	0.2	0.0050 J	0.0050 J	0.0023 J	0.0018 J	0.0019 J
Iron	MG/L	0.3	0.24	0.22	26.1	7.2	0.10
Lead	MG/L	0.025			0.0035 J		
Magnesium	MG/L	35	19.4	18.9	55.9	23.9	29.9
Manganese	MG/L	0.3	0.24	0.23	1.5	0.92	0.86
Mercury	MG/L	7.00E-04					
Nickel	MG/L	0.1	0.0046 J	0.0043 J	0.0056 J	0.0034 J	0.0021 J
Silver	MG/L	0.05					
Sodium	MG/L	20	198	191	390	340	19.4
Zinc	MG/L	2	0.018	0.017	0.0062 J		0.0040 J

* - NYSDEC TOGS (1.1.1), Ambient Water Quality Standards and Guidance Values and Groundwater Effluent Limitations. June 1998 (includes 4/2000 Addendum). Class GA. * - PCB Criteria based on sum of the aroclors.

Flags assigned during chemistry validation are shown.



Concentration Exceeds

J - The analyte was positively identified, the quantitation is an estimation.

Blank - not detected. - = No criteria.

Only Detected Results Reported.

TABLE 3-1
GROUNDWATER SAMPLE ANALYTICAL RESULTS
PFOHL BROTHERS LANDFILL SITE
NOVEMBER 2011

Location ID			GW-29S	GW-30S	GW-31S	GW-32S	GW-33S
Sample ID			GW-29S	GW-30S	GW-31S	GW-32S	GW-33S
Matrix			Groundwater	Groundwater	Groundwater	Groundwater	Groundwater
Depth Interval (ft)			-	-	-	-	-
Date Sampled			11/02/11	11/03/11	11/03/11	11/03/11	11/03/11
Parameter	Units	*					
Volatile Organic Compounds							
1,2-Dichloroethene (total)	UG/L	5					
Semivolatile Organic Compounds							
1,3-Dichlorobenzene	UG/L	3					
1,4-Dichlorobenzene	UG/L	3					
bis(2-Ethylhexyl)phthalate	UG/L	5					
Arsenic	MG/L	0.025	0.021				
Barium	MG/L	1	0.30	0.30	0.069	0.060	0.030
Cadmium	MG/L	0.005	0.00043 J		0.00060 J		0.00034 J
Chromium	MG/L	0.05					
Copper	MG/L	0.2		0.0020 J	0.0030 J	0.0018 J	0.0017 J
Iron	MG/L	0.3	11.1	13.4	0.49	0.038 J	
Lead	MG/L	0.025					
Magnesium	MG/L	35	79.5	37.8	30.6	35.7	56.3
Manganese	MG/L	0.3	0.71	1.9	0.99	0.22	0.010
Mercury	MG/L	7.00E-04					
Nickel	MG/L	0.1			0.034	0.0020 J	0.0014 J
Silver	MG/L	0.05					
Sodium	MG/L	20	14.6	578	6.0	6.9	5.1
Zinc	MG/L	2	0.0019 J	0.0018 J	0.010	0.0036 J	0.0033 J

* - NYSDEC TOGS (1.1.1), Ambient Water Quality Standards and Guidance Values and Groundwater Effluent Limitations. June 1998 (includes 4/2000 Addendum). Class GA. * - PCB Criteria based on sum of the aroclors.

Flags assigned during chemistry validation are shown.



Concentration Exceeds

J - The analyte was positively identified, the quantitation is an estimation.

Blank - not detected. - = No criteria.

Only Detected Results Reported.

TABLE 3-1
GROUNDWATER SAMPLE ANALYTICAL RESULTS
PFOHL BROTHERS LANDFILL SITE
NOVEMBER 2011

Location ID			GW-34S	GW-35S
Sample ID			GW-34S	GW-35S
Matrix			Groundwater	Groundwater
Depth Interval (ft)			-	-
Date Sampled			11/02/11	11/02/11
Parameter	Units	*		
Volatile Organic Compounds				
1,2-Dichloroethene (total)	UG/L	5		
Semivolatile Organic Compounds				
1,3-Dichlorobenzene	UG/L	3		
1,4-Dichlorobenzene	UG/L	3		
bis(2-Ethylhexyl)phthalate	UG/L	5		
Arsenic	MG/L	0.025		
Barium	MG/L	1	0.13	0.10
Cadmium	MG/L	0.005	0.00051 J	
Chromium	MG/L	0.05	0.026	
Copper	MG/L	0.2	0.0036 J	0.0022 J
Iron	MG/L	0.3	0.32	0.098
Lead	MG/L	0.025		
Magnesium	MG/L	35	47.9	28.4
Manganese	MG/L	0.3	0.010	0.17
Mercury	MG/L	7.00E-04		
Nickel	MG/L	0.1	0.013	0.0015 J
Silver	MG/L	0.05		
Sodium	MG/L	20	29.3	3.0
Zinc	MG/L	2	0.0040 J	0.0046 J

* - NYSDEC TOGS (1.1.1), Ambient Water Quality Standards and Guidance Values and Groundwater Effluent Limitations. June 1998 (includes 4/2000 Addendum). Class GA. * - PCB Criteria based on sum of the aroclors.

Flags assigned during chemistry validation are shown.



Concentration Exceeds

J - The analyte was positively identified, the quantitation is an estimation.

Blank - not detected. - = No criteria.

Only Detected Results Reported.

TABLE 3-2

APPROVED REVISION OF TABLE 3.2 FROM THE O&M PLAN

**GROUNDWATER SAMPLING SUMMARY
OPERATION AND MAINTENANCE PLAN
PFOHL BROTHERS LANDFILL SITE, CHEEKTOWAGA, NEW YORK**

LOCATIONS

GW-1D/1S
GW- 3D/3S
GW- 4D/4S
GW- 7D/7S
GW- 8D/8S(R)
GW- 26D/35S
GW- 28S
GW- 29S
GW- 30S
GW- 31S
GW- 32S
GW- 33S
GW- 34S

FREQUENCY

semi-annually for overburden and bedrock groundwater

PARAMETERS

<i>Field</i>	pH conductivity temperature turbidity
<i>VOCs</i>	Acetone Benzene 1,2-Dichloroethene (total) 1,1,2-Trichloroethane Vinyl chloride
<i>SVOCs</i>	Phenol 1,3-Dichlorobenzene 1,4-Dichlorobenzene bis(2-Ethylhexyl)phthalate

TABLE 3-2 (continued)


APPROVED REVISION OF TABLE 3.2 FROM THE O&M PLAN

**GROUNDWATER SAMPLING SUMMARY
OPERATION AND MAINTENANCE PLAN
PFOHL BROTHERS LANDFILL SITE, CHEEKTOWAGA, NEW YORK**

PARAMETERS (cont'd)

<i>Metals</i>	Antimony
	Arsenic
	Barium
	Cadmium
	Chromium
	Copper
	Iron
	Lead
	Magnesium
	Manganese
	Mercury
	Nickel
	Silver
	Sodium
	Zinc

FIGURES

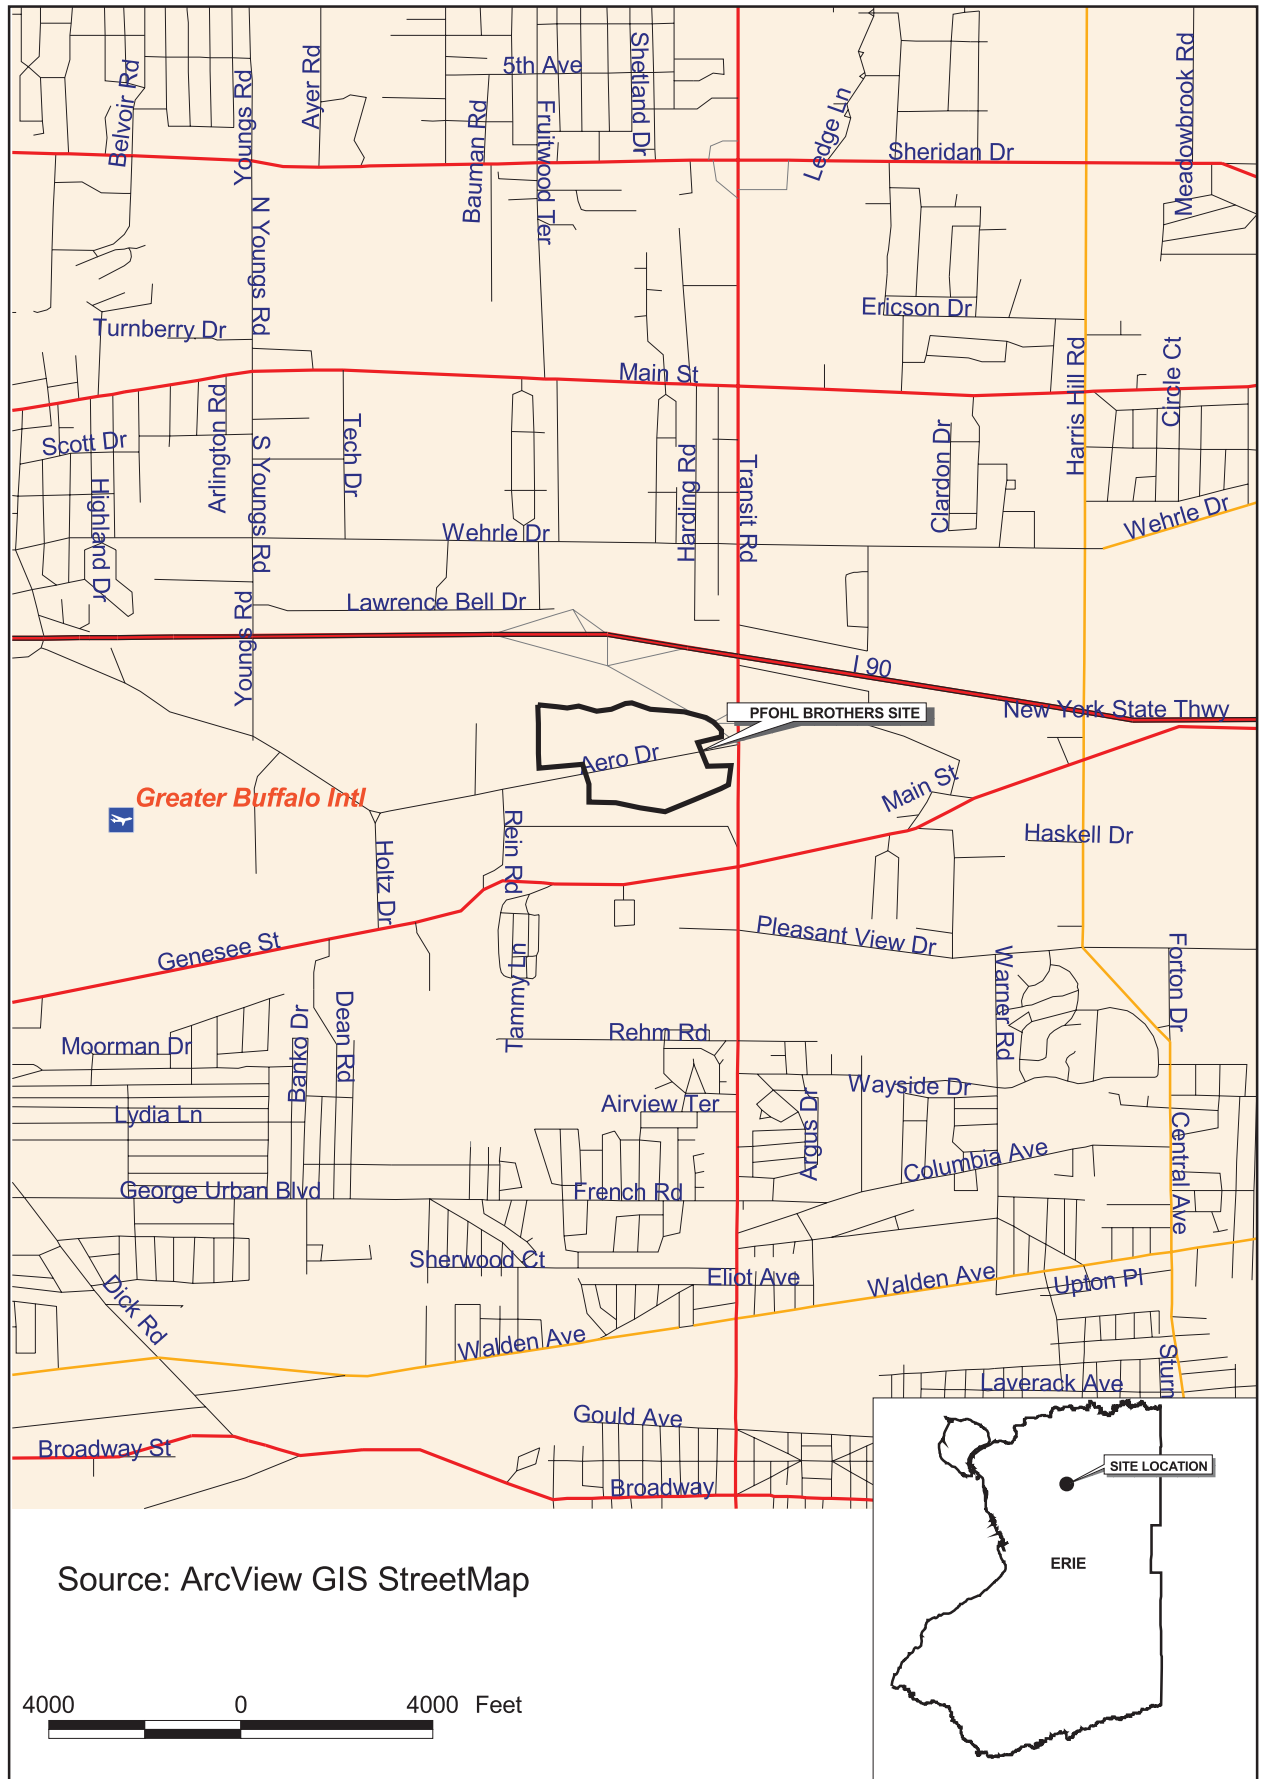

N:\1172700\000000\GIS\ArcView\pfohl.apr WELL LOCATIONS
12/15/2005



Legend

- Monitoring Well Location
- Staff Gauge Location
- Manhole Location
- Wet Well Location

400 0 400 Feet

PFOHL BROTHERS LANDFILL
MONITORING LOCATIONS

URS

FIGURE 3-1

APPENDIX A

EXAMPLE DAILY INSPECTION SHEETS

Pfohl Brothers Landfill Site

Daily Logsheet

Town of Cheektowaga

Date 9/2/11
Time 3:20

Weather conditions SUNNY 88° ±
Read by: B. PUGH

	Level of Water from bottom (ft.)	Flow gallons / minute	Flow Totals gallons	Pump Run Time Hrs.
WW-3	5.9	0	109,335	1521
WW-2	9.9	0	-650	120
WW-1	4.4	0	389,865	1422
WW-6	7.0	0	100,611	6042
WW-4	7.0	0	13,190	4866
WW-5	7.7	0	646,989	7850

Flow Totalizer at Meter chamber 1,331,261

Heat Trace

Outside temp T = 93°
Current A = 0

Set point SP = 40

Large Suppressor events 414,749

Motor Control Center

Volts 480 volts
Amps 6 amps

Which WW was running?

☐ 1 ☐ 2 ☐ 3 ☐ 4 ☐ 5 ☐ 6 ☒ NONE

Filter Checked ☐ Changed ☐

Comments and/or Current Conditions

RESET ALARMS WW3 - FLOW INVALID (OK)

WW 2 FLOW INVALID & LEVEL INVALID

* W.W. 2 LEVEL INVALID WOULD NOT RESET

NIAGARA GRASS ON-SITE

N. SIDE 90% COMPLETE - NEEDS TRIMMING

S. SIDE 50% COMPLETE

Prohl Brothers Landfill Site

Daily Logsheet

Town of Cheektowaga

Date 10/6/11
Time 2:05

Weather conditions Sunny 68°
Read by: Bill PUGH

	Level of Water from bottom (ft.)	Flow gallons / minute	Flow Totals gallons	Pump Run Time Hrs.
WW-3	5.6	0	205,066	1565
WW-2	4.7	43.1	-623	120
WW-1	3.9	0	444,233	1453
WW-6	6.0	0	614,842	6169
WW-4	7.0	0	13,190	4866
WW-5	7.6	0	992,711	7974

Flow Totalizer at Meter chamber 2,341,423

Heat Trace
Outside temp T = 68°
Current A = 0
Set point SP = 40°

Large Suppressor events 414,763

Motor Control Center
Volts 480 volts
Amps 5 amps
Which WW was running?
1 ☐ 2 ☒ 3 ☐ 4 ☐ 5 ☐ 6 ☐

Filter Checked ☐ Changed ☐

Comments and/or Current Conditions

- RAN PUMP NO. 2 ON MANUAL IN EFFORT TO RESET BALL CHECK (NEGATIVE FLOW)
- CLEARED WW 2 NEGATIVE FLOW ALARM
- TOOK LOG SHEETS FROM 1/11 TO 6/11 TO ENCL. OFFICE

Pfohl Brothers Landfill Site

Daily Logsheet

Town of Cheektowaga

Date 11-10-11
Time 11:30

Weather conditions LT. RAIN 45°
Read by: Bill PUGH

	Level of Water from bottom (ft.)	Flow gallons / minute	Flow Totals gallons	Pump Run Time Hrs.
WW-3	4.3	0	297,182	1601
WW-2	4.6	41.7	139	121
WW-1	4.0	0	629,991	1527
WW-6	6.9	0	1,462,385	6387
WW-4	6.9	0	97,288	4913
WW-5	7.0	0	1,597,617	8193

Flow Totalizer at Meter chamber

4,157,413

Heat Trace

Outside temp T = 45°
Current A = 0

Set point SP = 40

Large Suppressor events

414,771

Motor Control Center

Volts 480 volts
Amps 5 amps

Which WW was running?

1 ☐ 2 ☒ 3 ☐ 4 ☐ 5 ☐ 6 ☐

Filter

Checked ☐

Changed ☐

Comments and/or Current Conditions

- CLEARED NEGATIVE FLOW ALARM WW2.
- RAN PUMP 2 ON MANUAL IN ATTEMPT TO
RESET BALL VALVE

APPENDIX B

MONTHLY FLOW SUMMARIES
JULY 2011 – DECEMBER 2011

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

August 3, 2011

Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga

Re: Pfohl Bros. Flow Data


Dear Mr. Pugh,

Enclosed for your review, please find a copy of the **July 2011 Direct Discharge Flow Data Report**, prepared by Jon W. Nichy.


On July 1, 2011 the Flow Totalizers were reset to zero.

Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.

Yours truly,

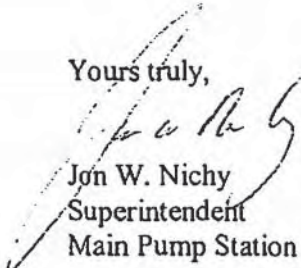
Jon W. Nichy
Superintendent
Main Pump Station

July
2011

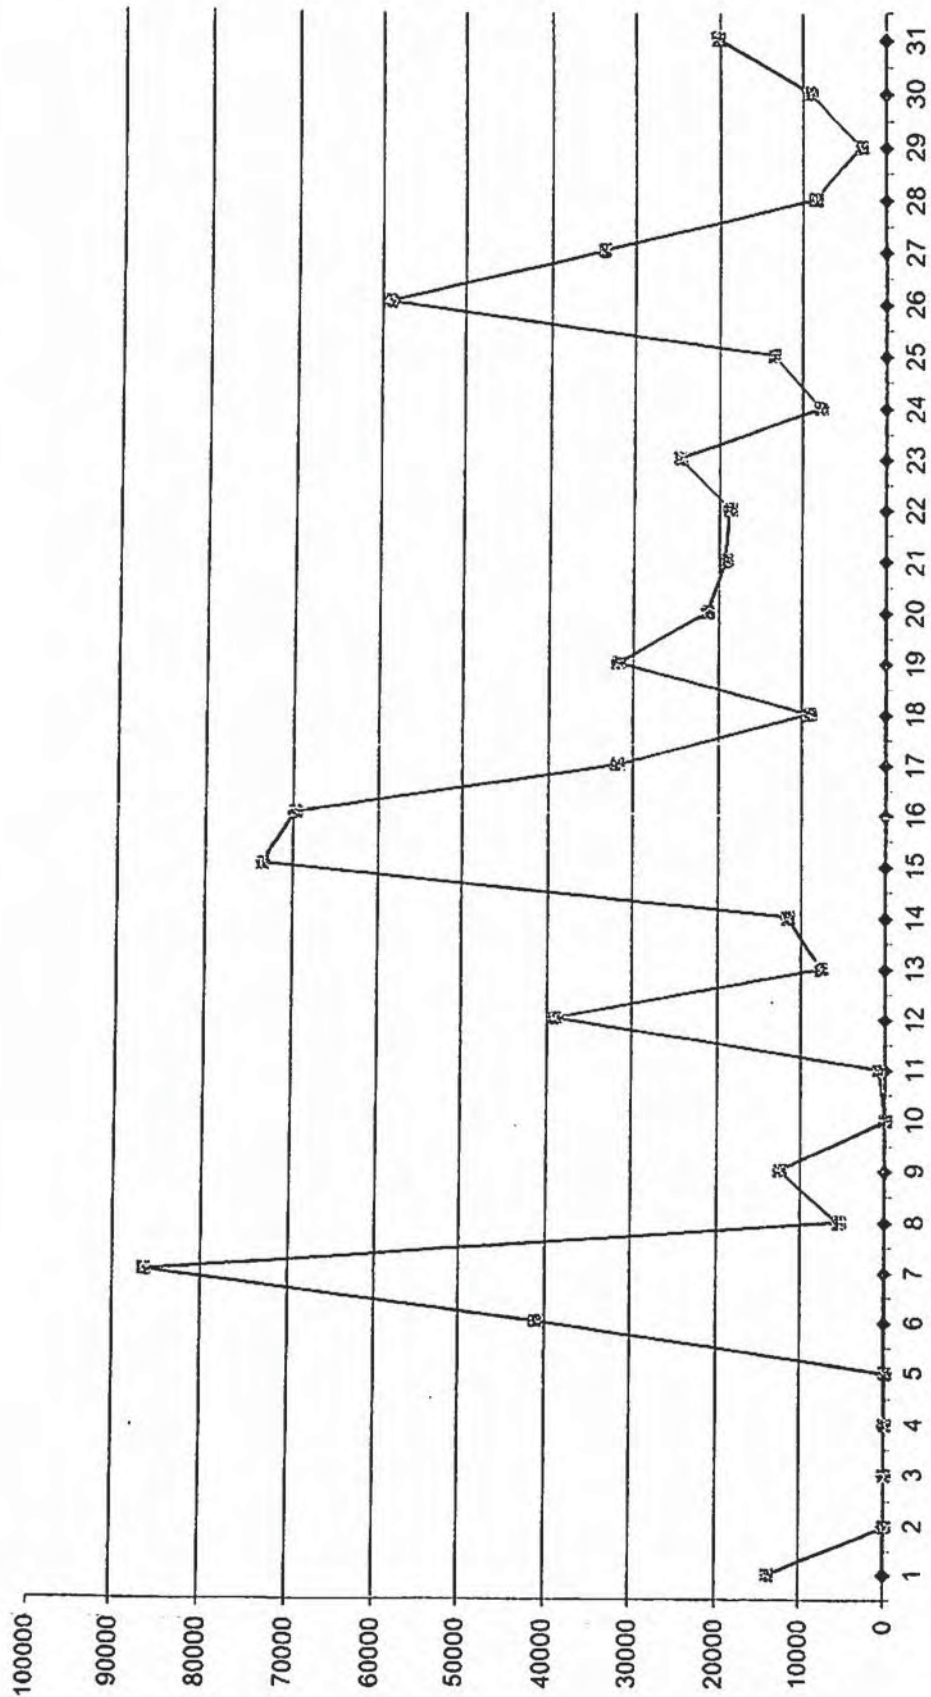

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

September 8, 2011

Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga


Re: Pfohl Bros. Flow Data

Dear Mr. Pugh,

Enclosed for your review, please find a copy of the August 2011 Direct Discharge Flow Data Report, prepared by Jon W. Nichy.

Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.


Yours truly,

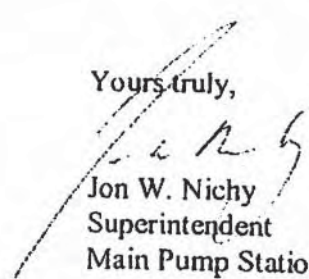
Jon W. Nichy
Superintendent
Main Pump Station

Direct Discharge Flow Data

7/31/2011		659864	20,220	659,864	
August-11	Time; 11:58pm unless otherwise stated	Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	Notes
1		675737	15,874	675,738	
2		765522	89,785	765,523	
3		784496	18,974	784,497	0406 inhibit
4		796143	11,647	796,144	0100 enable
5		843482	47,339	843,483	
6		859278	15,796	859,279	
7		879470	20,192	879,471	1532 inhibit
8		884816	5,346	884,817	1233 enable
9		918366	33,550	918,367	1810 inhibit
10		925393	7,027	925,394	0108 enable
11		935078	9,684	935,078	
12		943679	8,601	943,679	
13		953365	9,686	953,365	
14		984829	31,464	984,829	
15		1007051	22,223	1,007,052	
16		1043016	22,768	1,029,820	
17		1063841	20,826	1,050,646	
18		1074455	10,614	1,061,260	
19		1086825	12,370	1,073,630	
20		1095948	9,123	1,082,753	
21		1095948	0	1,082,753	0411 inhibit
22		1116858	20,910	1,103,663	1613 enable
23		1146919	30,061	1,133,724	
24		1147305	387	1,134,111	2250 inhibit
25		1172121	24,816	1,158,927	1540 enable
26		1191953	19,832	1,178,759	
27		1281725	89,772	1,268,531	
28		1288373	6,649	1,275,180	
29		1296312	7,939	1,283,119	
30		1308334	12,022	1,295,141	
31		1320489	12,156	1,307,297	
		644,752	647,433	647,433	

August
2011

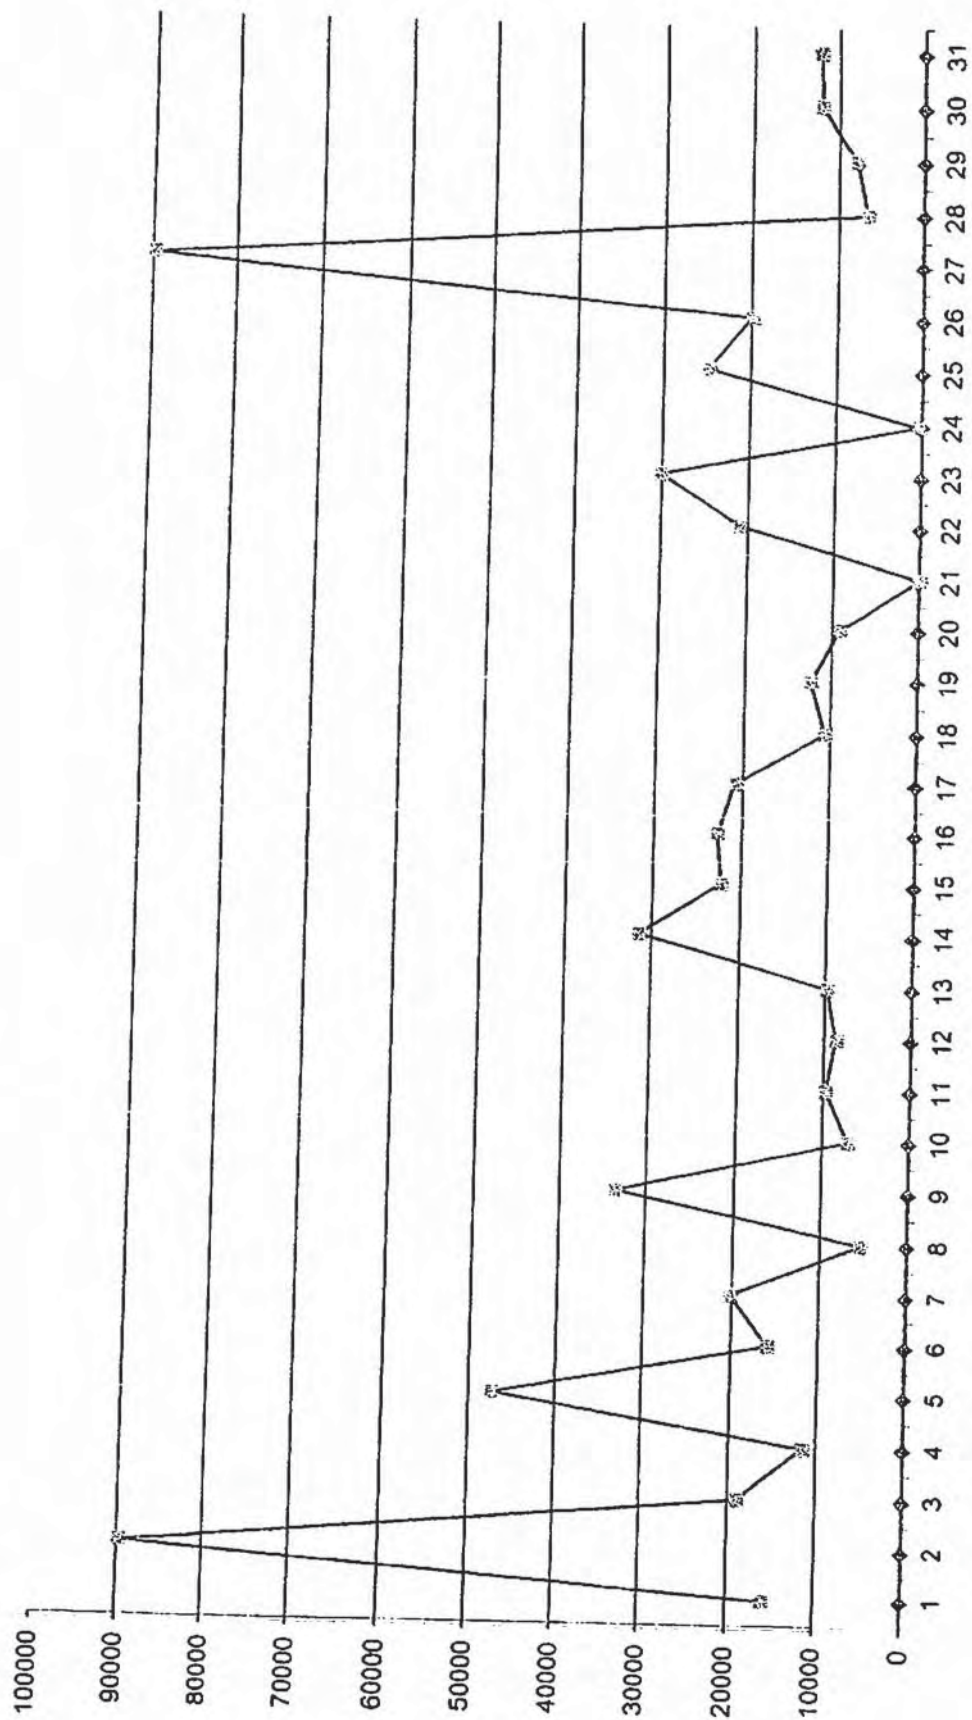

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent
Joseph Glab
Asst. Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

October 13, 2011

Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga


Re: Pfohl Bros. Flow Data

Dear Mr. Pugh,

Enclosed for your review, please find a copy of the September 2011 Direct Discharge Flow Data Report, prepared by Jon W. Nichy.

Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.

Yours truly,

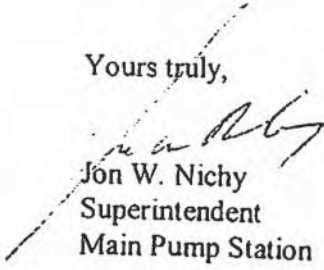

Jon W. Nichy
Superintendent
Main Pump Station

Direct Discharge Flow Data

8/31/2011

September-11	Time; 11:58pm unless otherwise stated	1320489	12,156	1,307,297	Notes
		Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	
1		1331024	10,535	1,317,832	
2		1360180	29,156	1,346,988	
3		1434849	74,669	1,421,657	
4		1434849	0	1,421,657	0435 inhibit
5		1469617	34,769	1,456,426	1116 enable
6		1479260	9,643	1,466,069	
7		1491910	12,650	1,478,719	
8		1502236	10,327	1,489,046	
9		1502236	0	1,489,046	
10		1502825	589	1,489,635	
11		1532660	29,834	1,519,469	
12		1545804	13,145	1,532,614	
13		1552188	6,384	1,538,998	
14		1559473	7,285	1,546,283	
15		1615048	55,575	1,601,858	0248inhibit 1102enable
16		1683400	68,352	1,670,210	
17		1683400	0	1,670,210	
18		1683400	0	1,670,210	
19		1685889	2,489	1,672,699	
20		1713663	27,774	1,700,473	0150inhibit 1553enable
21		1733120	19,457	1,719,930	
22		1733342	223	1,720,153	
23		1733342	0	1,720,153	1936 inhibit
24		1771385	38,043	1,758,196	1013 enable
25		1784416	13,032	1,771,228	
26		1799898	15,482	1,786,710	
27		1845596	45,698	1,832,408	
28		1904405	58,809	1,891,217	0457inhibit 1511enable
29		1956749	52,344	1,943,561	0208inhibit 1316enable
30		2018532	61,783	2,005,344	0003inhibit 1433enable
31					
		687,508	698,047	698,047	

September
2011

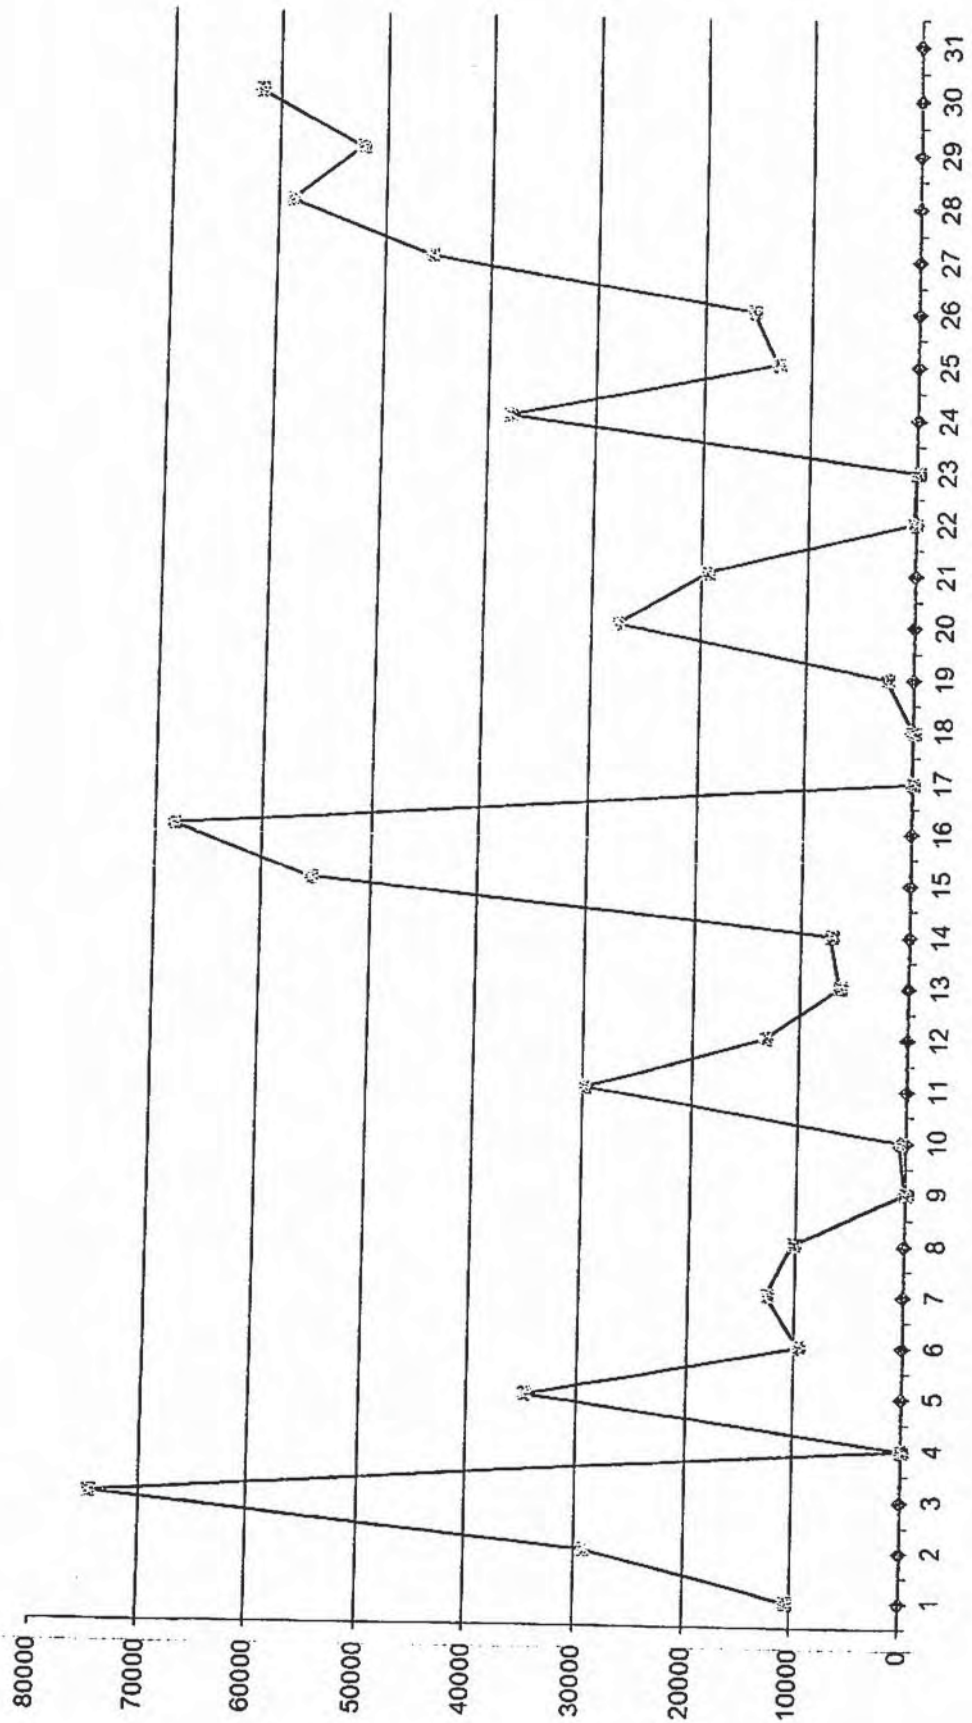

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent
Joseph Glab
Asst. Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

November 4, 2011

Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga

Re: Pfohl Bros. Flow Data


Dear Mr. Pugh,

Enclosed for your review, please find a copy of the **October 2011** Direct Discharge Flow Data Report, prepared by Jon W. Nichy.

Please note that on 10/25/11 Factory Technicians from Emerson Process Management were on site to diagnose and repair the Flow Meter for Wet Well #3.

Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.


Yours truly,


Jon W. Nichy
Superintendent
Main Pump Station

Direct Discharge Flow Data

9/30/2011		2018532	61,783	2,005,344	
October-11	Time; 11:58pm unless otherwise stated	Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	Notes
1		2123175	104,643	2,109,987	
2		2145106	21,931	2,131,918	1321 inhibit
3		2187084	41,978	2,173,896	1219 enable
4		2212662	25,578	2,199,474	0223 inhibit 2155 enable
5		2319756	107,094	2,306,568	
6		2343537	23,781	2,330,349	
7		2343537	0	2,330,349	
8		2344925	1,388	2,331,737	
9		2389505	44,580	2,376,317	
10		2398340	8,835	2,385,152	
11		2441026	42,686	2,427,838	
12		2465951	24,925	2,452,763	1959 inhibit
13		2482880	16,928	2,469,691	0735 enable
14		2483811	932	2,470,623	0005 inhibit
15		2483811	0	2,470,623	
16		2528748	44,937	2,515,560	
17		2611492	82,744	2,598,304	1505 enable
18		2846228	234,735	2,833,039	
19		2956421	110,194	2,943,233	
20		2968022	11,601	2,954,834	
21		3048058	80,036	3,034,870	
22		3171156	123,099	3,157,969	
23		3303340	132,183	3,290,152	
24		3335746	32,407	3,322,559	
25		3350396	14,650	3,337,209	
26		3412569	62,172	3,399,381	1452 inhibit
27		3505538	92,969	3,492,350	1314 enable
28		3673741	168,204	3,660,554	
29		3736127	62,386	3,722,940	1447 inhibit
30		3806301	70,174	3,793,114	1244 enable
31		3843928	37,627	3,830,741	
		1,825,396	1,825,397	1,825,397	

October
2011

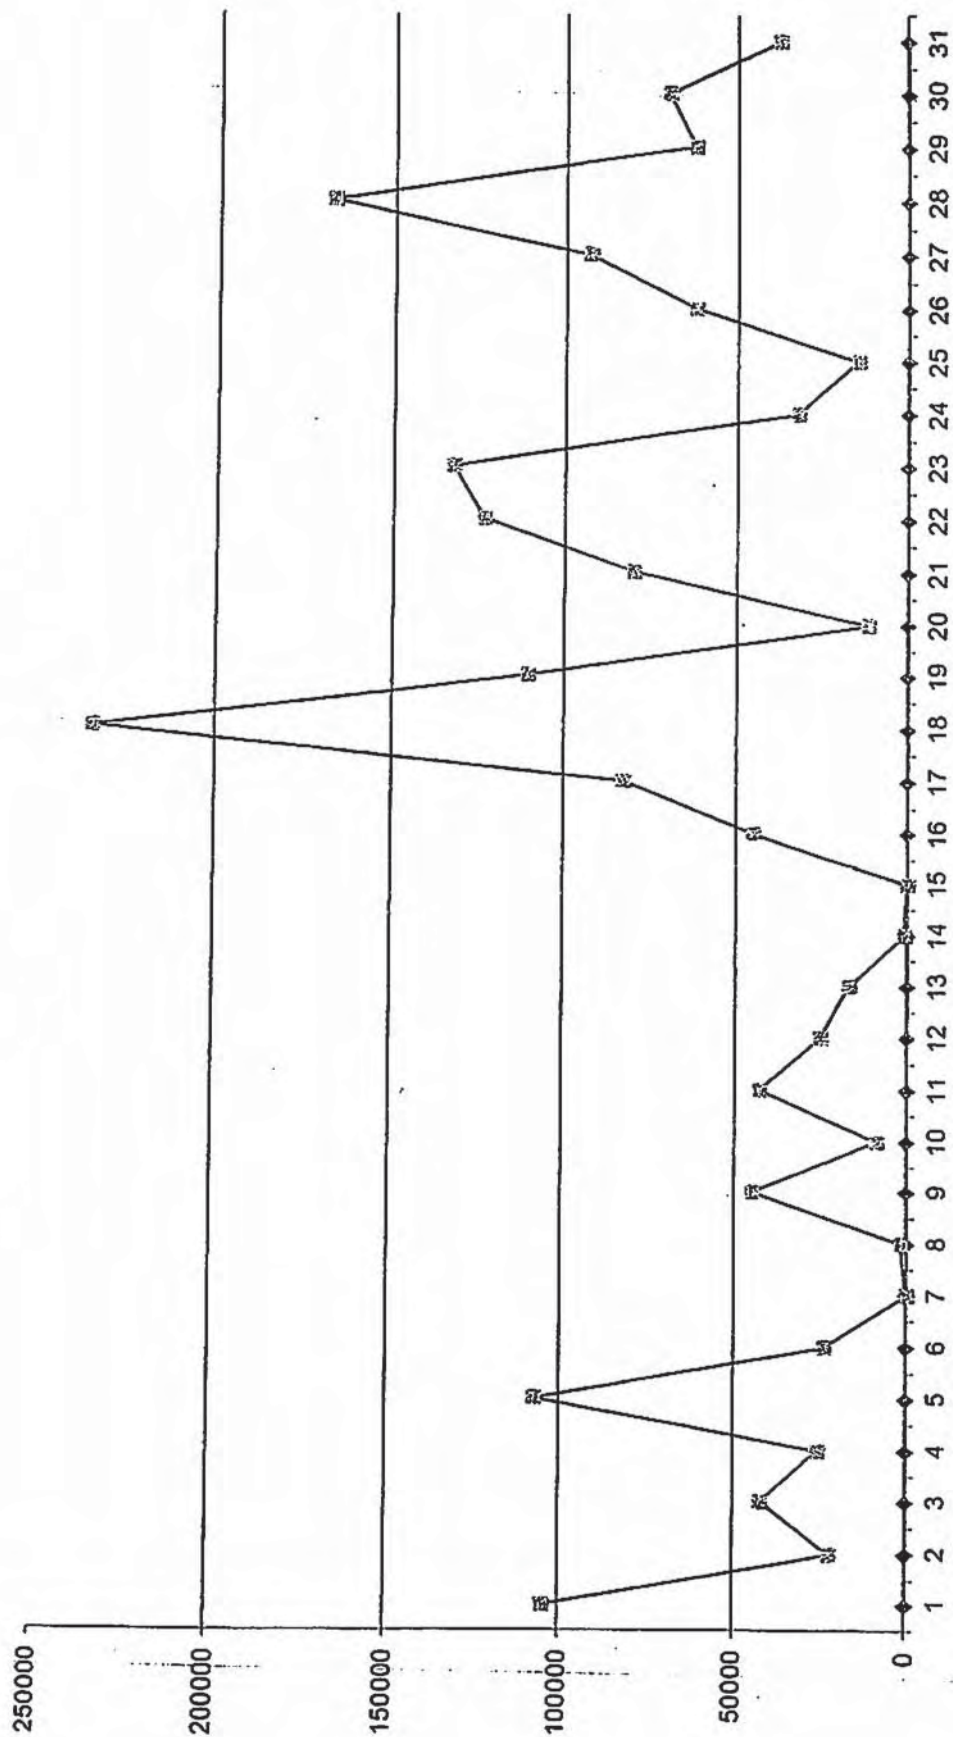

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent
Joseph Glab
Asst. Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

December 7, 2011

Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga


Re: Pfohl Bros. Flow Data

Dear Mr. Pugh,

Enclosed for your review, please find a copy of the November 2011 Direct Discharge Flow Data Report, prepared by Jon W. Nichy.

Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.

Yours truly,

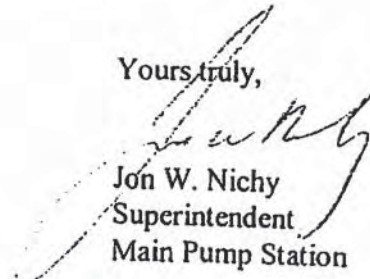
Jon W. Nichy
Superintendent
Main Pump Station


Direct Discharge Flow Data

10/31/2011

November-11	Time; 11:58pm unless otherwise stated	3843928	37,627	3,830,741	Notes
		Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	
1		3860	16,195	3,846,936	
2		3880724	20,601	3,867,537	
3		3894568	13,844	3,881,381	
4		3894568	0	3,881,381	
5		3936843	42,276	3,923,657	
6		4038803	101,960	4,025,617	
7		4061901	23,098	4,048,715	
8		4078661	16,760	4,065,475	
9		4144672	66,011	4,131,486	
10		4159161	14,489	4,145,975	
11		4166725	7,564	4,153,539	
12		4166725	0	4,153,539	
13		4166725	0	4,153,539	
14		4201028	34,303	4,187,842	1753 inhibit
15		4284518	83,490	4,271,332	1029 enable
16		4392205	107,687	4,379,019	
17		4463545	71,340	4,450,359	
18		4463545	0	4,450,359	
19		4474107	10,562	4,460,921	
20		4504215	30,108	4,491,029	
21		4504215	0	4,491,029	
22		4520112	15,897	4,506,926	2212 inhibit
23		4571228	51,117	4,558,043	1609 enable
24		4704458	133,230	4,691,273	
25		4801887	97,429	4,788,702	
26		4868011	66,125	4,854,827	
27		4870228	2,217	4,857,044	2239 inhibit
28		4914067	43,839	4,900,883	1608 enable
29		4994982	80,915	4,981,798	1229 inhibit
30		5054286	59,304	5,041,102	1536 enable
31					
		1,210,358	1,210,361	1,210,361	

The graph illustrates the population growth of the USSR over a 31-year period. The Y-axis is labeled with values from 0 to 140,000 in increments of 20,000. The X-axis is labeled with years from 1 to 31. The data points are connected by lines, showing a series of peaks and troughs. Notable features include a sharp increase around year 16 (1927) reaching approximately 125,000, followed by a decline to around 100,000 by year 21 (1931). There are also smaller peaks around year 10 (1922) and year 20 (1930).

Year	Population (Millions)
1	10,000
2	15,000
3	12,000
4	18,000
5	15,000
6	20,000
7	18,000
8	22,000
9	20,000
10	25,000
11	22,000
12	28,000
13	25,000
14	30,000
15	28,000
16	125,000
17	100,000
18	95,000
19	100,000
20	105,000
21	100,000
22	105,000
23	100,000
24	105,000
25	110,000
26	115,000
27	120,000
28	115,000
29	110,000
30	105,000
31	100,000

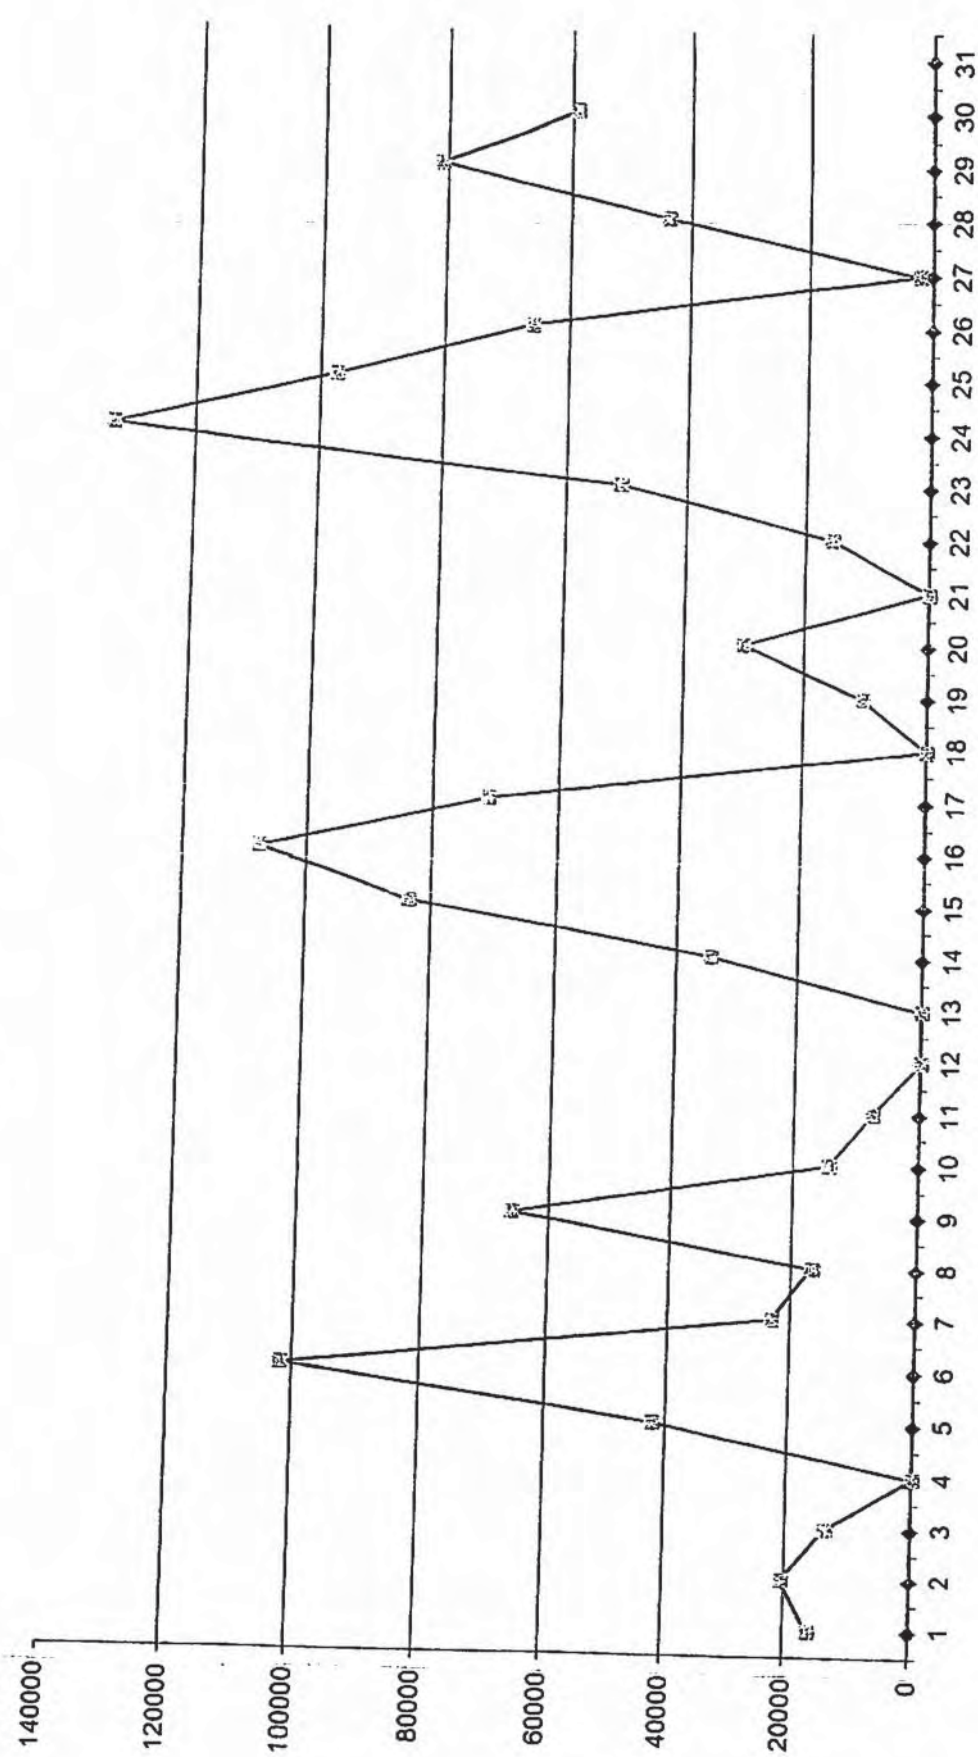

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent
Joseph Glab
Asst. Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

January 10, 2012

Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga


Re: Pfohl Bros. Flow Data

Dear Mr. Pugh,

Enclosed for your review, please find a copy of the **December 2011 Direct Discharge Flow Data Report**, prepared by Jon W. Nichy.

Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.

Yours truly,

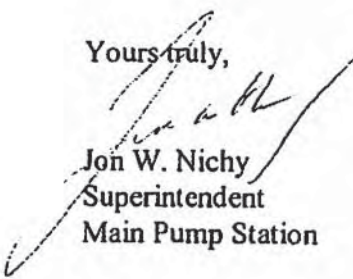
Jon W. Nichy
Superintendent
Main Pump Station

Direct Discharge Flow Data

11/30/2011

		5054286	59,304	5,041,102	
December-11	Time; 11:58pm unless otherwise stated	Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	Notes
1		5255738	201,452	5,242,554	
2		5381021	125,284	5,367,838	
3		5498069	117,048	5,484,886	
4		5538804	40,735	5,525,621	
5		5547943	9,139	5,534,760	1044 inhibit
6		5630582	82,639	5,617,399	1244 enable
7		5797095	166,514	5,783,913	
8		5911537	114,442	5,898,355	
9		5926057	14,520	5,912,875	
10		5948826	22,770	5,935,645	
11		6046882	98,056	6,033,701	
12		6093028	46,146	6,079,847	
13		6110650	17,622	6,097,469	
14		6124375	13,725	6,111,194	2332 inhibit
15		6124375	0	6,111,194	
16		6233887	109,512	6,220,706	1007 enable
17		6438645	204,758	6,425,464	
18		6507505	68,861	6,494,325	
19		6519761	12,256	6,506,581	
20		6532270	12,509	6,519,090	2300 inhibit
21		6533057	788	6,519,878	
22		6533057	0	6,519,878	
23		6533057	0	6,519,878	
24		6533057	0	6,519,878	
25		6533057	0	6,519,878	
26		6533057	0	6,519,878	
27		6549122	16,065	6,535,943	2058 enable
28		6769204	220,082	6,756,025	
29		6986635	217,432	6,973,457	
30		7153620	166,985	7,140,442	2126 inhibit
31		7252183	98,563	7,239,005	0908 enable
		2,197,897	2,197,903	2,197,903	

The graph illustrates the population growth of the Republic of Armenia over a 31-year period. The population starts at approximately 190,000 in 1976 and shows a steady increase, with a more rapid growth rate starting around 1980. The population reaches its highest point of approximately 240,000 in 1996.

Year	Population (thousands)
1	190
2	190
3	190
4	190
5	190
6	190
7	190
8	190
9	190
10	190
11	190
12	190
13	190
14	190
15	190
16	190
17	190
18	190
19	190
20	190
21	190
22	190
23	190
24	190
25	190
26	190
27	190
28	190
29	190
30	190
31	190

APPENDIX C

HYDRAULIC MONITORING TABLES

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JULY - DECEMBER 2011

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
GW-01D	1073088.634	1117968.213	694.41	NM	696.12	D	1						
MNW								9/22/2011 1035	3.77	692.35	0.00	692.35	
MNW								11/1/2011 0931	2.69	693.43	0.00	693.43	
MNW								12/20/2011 1647	2.42	693.70	0.00	693.70	
GW-01S	1073087.779	1117961.500	694.53	NM	696.19	S	1						
MNW								9/22/2011 1030	5.28	690.91	0.00	690.91	
MNW								11/1/2011 0930	3.70	692.49	0.00	692.49	
MNW								12/20/2011 1647	3.52	692.67	0.00	692.67	
GW-03D	1073819.106	1114602.426	692.35	NM	693.88	D	1						
MNW								9/22/2011 0940	2.42	691.46	0.00	691.46	
MNW								11/1/2011 0834	2.19	691.69	0.00	691.69	
MNW								12/20/2011 1601	2.05	691.83	0.00	691.83	
GW-03S	1073812.622	1114605.762	692.61	NM	693.80	S	1						
MNW								9/22/2011 0939	11.46	682.34	0.00	682.34	
MNW								11/1/2011 0833	6.27	687.53	0.00	687.53	
MNW								12/20/2011 1601	2.31	691.49	0.00	691.49	
GW-04D	1072289.432	1114685.625	690.89	NM	692.75	D	1						
MNW								9/22/2011 1043	14.01	678.74	0.00	678.74	
MNW								11/1/2011 0919	13.50	679.25	0.00	679.25	
MNW								12/20/2011 1655	12.88	679.87	0.00	679.87	
GW-04S	1072284.456	1114685.127	690.76	NM	692.72	S	1						
MNW								9/22/2011 1042	8.31	684.41	0.00	684.41	
MNW								11/1/2011 0919	4.81	687.91	0.00	687.91	
MNW								12/20/2011 1655	4.36	688.36	0.00	688.36	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH	Manhole Monitoring Point
MNW	Monitoring Well
SG	Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JULY - DECEMBER 2011

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
GW-07D	1071242.458	1117669.925	697.15	NM	699.94	D	1						
MNW								9/22/2011 1028	48.27	651.67	0.00	651.67	
MNW								11/1/2011 0939	45.26	654.68	0.00	654.68	
MNW								12/20/2011 1641	55.53	644.41	0.00	644.41	
GW-07S	1071238.157	1117666.265	697.47	NM	699.51	S	1						
MNW								9/22/2011 1029	7.16	692.35	0.00	692.35	
MNW								11/1/2011 0939	4.57	694.94	0.00	694.94	
MNW								12/20/2011 1643	4.26	695.25	0.00	695.25	
GW-08D	1073713.617	1116795.328	695.28	NM	697.79	D	1						
MNW								9/22/2011 0954	6.47	691.32	0.00	691.32	
MNW								11/1/2011 0843	6.15	691.64	0.00	691.64	
MNW								12/20/2011 1610	5.99	691.80	0.00	691.80	
GW-08SR	1073714.172	1116786.343	695.08	NM	697.50	S	1						
MNW								9/22/2011 0955	5.42	692.08	0.00	692.08	
MNW								11/1/2011 0844	5.27	692.23	0.00	692.23	
MNW								12/20/2011 1610	5.25	692.25	0.00	692.25	
GW-26D	1071698.573	1115997.470	696.01	NM	698.50	D	1						
MNW								9/22/2011 1022	7.30	691.20	0.00	691.20	
MNW								11/1/2011 0910	7.02	691.48	0.00	691.48	
MNW								12/20/2011 1632	6.85	691.65	0.00	691.65	
GW-28S	1073129.479	1117648.927	698.60	NM	700.95	S	1						
MNW								9/22/2011 0959	10.99	689.96	0.00	689.96	
MNW								11/1/2011 0850	8.64	692.31	0.00	692.31	
MNW								12/20/2011 1614	8.39	692.56	0.00	692.56	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH	Manhole Monitoring Point
MNW	Monitoring Well
SG	Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JULY - DECEMBER 2011

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
GW-29S	1072552.638	1117761.993	697.50	NM	699.63	S	1						
MNW								9/22/2011 1008	10.40	689.23	0.00	689.23	
MNW								11/1/2011 0857	7.42	692.21	0.00	692.21	
MNW								12/20/2011 1622	7.04	692.59	0.00	692.59	
GW-30S	1072096.109	1117743.563	693.67	NM	696.58	S	1						
MNW								9/22/2011 1010	8.40	688.18	0.00	688.18	
MNW								11/1/2011 0859	8.04	688.54	0.00	688.54	
MNW								12/20/2011 1624	7.92	688.66	0.00	688.66	
GW-31S	1071786.280	1117191.441	695.84	NM	698.62	S	1						
MNW								9/22/2011 1015	7.28	691.34	0.00	691.34	
MNW								11/1/2011 0904	2.62	696.00	0.00	696.00	
MNW								12/20/2011 1627	2.46	696.16	0.00	696.16	
GW-32S	1071613.793	1116364.200	696.19	NM	698.37	S	1						
MNW								9/22/2011 1017	6.53	691.84	0.00	691.84	
MNW								11/1/2011 0908	2.64	695.73	0.00	695.73	
MNW								12/20/2011 1630	2.47	695.90	0.00	695.90	
GW-33S	1072165.625	1115561.866	695.94	NM	698.24	S	1						
MNW								9/22/2011 1024	7.81	690.43	0.00	690.43	
MNW								11/1/2011 0915	4.06	694.18	0.00	694.18	
MNW								12/20/2011 1635	3.85	694.39	0.00	694.39	
GW-34S	1072979.205	1114730.200	692.51	NM	694.77	S	1						
MNW								9/22/2011 0929	8.50	686.27	0.00	686.27	
MNW								11/1/2011 0825	2.91	691.86	0.00	691.86	
MNW								12/20/2011 1554	2.65	692.12	0.00	692.12	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH Manhole Monitoring Point
 MNW Monitoring Well
 SG Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JULY - DECEMBER 2011

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
GW-35S	1071701.925	1115985.585	696.19	NM	697.39	S	1						
MNW								9/22/2011 1021	6.64	690.75	0.00	690.75	
MNW								11/1/2011 0911	3.20	694.19	0.00	694.19	
MNW								12/20/2011 1632	2.85	694.54	0.00	694.54	
MH-01	1073806.665	1114810.501	698.62	NM	698.62	NA	1						
MH								9/22/2011 0933	10.15	688.47	0.00	688.47	
MH								11/1/2011 0829	10.51	688.11	0.00	688.11	
MH								12/20/2011 1557	10.08	688.54	0.00	688.54	
MH-03	1073736.789	1115259.334	699.40	NM	699.40	NA	1						
MH								9/22/2011 0948	11.02	688.38	0.00	688.38	
MH								11/1/2011 0837	11.26	688.14	0.00	688.14	
MH								12/20/2011 1604	11.00	688.40	0.00	688.40	
MH-07	1073838.229	1116243.757	696.82	NM	696.82	NA	1						
MH								9/22/2011 0950	9.22	687.60	0.00	687.60	
MH								11/1/2011 0839	9.45	687.37	0.00	687.37	
MH								12/20/2011 1607	9.22	687.60	0.00	687.60	
MH-10	1073540.729	1117381.524	703.01	NM	703.01	NA	1						
MH								9/22/2011 0958	14.52	688.49	0.00	688.49	
MH								11/1/2011 0847	14.50	688.51	0.00	688.51	
MH								12/20/2011 1613	14.51	688.50	0.00	688.50	
MH-15	1072531.567	1117761.125	699.02	NM	699.02	NA	1						
MH								9/22/2011 1007	15.01	684.01	0.00	684.01	
MH								11/1/2011 0856	14.88	684.14	0.00	684.14	
MH								12/20/2011 1620	14.76	684.26	0.00	684.26	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH	Manhole Monitoring Point
MNW	Monitoring Well
SG	Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JULY - DECEMBER 2011

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
MH-16	1072133.714	1117748.238	698.57	NM	698.57	NA	1						
MH								9/22/2011 1009	14.54	684.03	0.00	684.03	
MH								11/1/2011 0859	14.52	684.05	0.00	684.05	
MH								12/20/2011 1623	14.48	684.09	0.00	684.09	
MH-17	1071813.137	1117180.019	702.16	NM	702.16	NA	1						
MH								9/22/2011 1013	18.13	684.03	0.00	684.03	
MH								11/1/2011 0903	18.15	684.01	0.00	684.01	
MH								12/20/2011 1626	18.10	684.06	0.00	684.06	
MH-20	1071756.395	1115997.024	706.20	NM	706.20	NA	1						
MH								9/22/2011 1020	19.74	686.46	0.00	686.46	
MH								11/1/2011 0910	19.74	686.46	0.00	686.46	
MH								12/20/2011 1632	19.75	686.45	0.00	686.45	
MH-22	1072158.023	1115589.309	698.05	NM	698.05	NA	1						
MH								9/22/2011 1023	9.03	689.02	0.00	689.02	
MH								11/1/2011 0914	8.98	689.07	0.00	689.07	
MH								12/20/2011 1635	9.01	689.04	0.00	689.04	
MH-25	1072483.928	1114820.313	698.17	NM	698.17	NA	1						
MH								9/22/2011 0923	9.79	688.38	0.00	688.38	
MH								11/1/2011 0816	10.10	688.07	0.00	688.07	
MH								12/20/2011 1550	9.69	688.48	0.00	688.48	
SG-01	1073882.887	1114813.101	NM	NM	690.00	NA	1						
SG								9/22/2011 0933	NM	-	0.00	-	Dry
SG								11/1/2011 0830	-1.16	691.16	0.00	691.16	
SG								12/20/2011 1559	-1.22	691.22	0.00	691.22	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH Manhole Monitoring Point
 MNW Monitoring Well
 SG Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JULY - DECEMBER 2011

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
SG-02	1073738.27	1116805.85	NM	NM	690.00	NA	1						
SG								9/22/2011 0955	-3.10	693.10	0.00	693.10	
SG								11/1/2011 0845	-3.20	693.20	0.00	693.20	
SG								12/20/2011 1610	-3.24	693.24	0.00	693.24	
WW-01	1073676.903	1115710.476	NM	NM	684.02	NA	1						
MH								9/22/2011 0845	-4.2	688.22	0.00	688.22	
MH								11/1/2011 0745	-3.9	687.92	0.00	687.92	
MH								12/20/2011 1520	-4.2	688.22	0.00	688.22	
WW-02	1073684.724	1116792.311	NM	NM	684.18	NA	1						
MH								9/22/2011 0845	-4.7	688.88	0.00	688.88	
MH								11/1/2011 0745	-4.6	688.78	0.00	688.78	
MH								12/20/2011 1520	-4.6	688.78	0.00	688.78	
WW-03	1073140.339	1117618.499	NM	NM	683.80	NA	1						
MH								9/22/2011 0845	-5.9	689.70	0.00	689.70	
MH								11/1/2011 0745	-5.6	689.40	0.00	689.40	
MH								12/20/2011 1520	-5.9	689.70	0.00	689.70	
WW-04	1072057.563	1117610.508	NM	NM	676.62	NA	1						
MH								9/22/2011 0845	-6.9	683.52	0.00	683.52	
MH								11/1/2011 0745	-7.0	683.62	0.00	683.62	
MH								12/20/2011 1520	-7.0	683.62	0.00	683.62	
WW-05	1071661.368	1116370.876	NM	NM	676.14	NA	1						
MH								9/22/2011 0845	-7.6	683.74	0.00	683.74	
MH								11/1/2011 0745	-7.0	683.14	0.00	683.14	
MH								12/20/2011 1520	-7.7	683.84	0.00	683.84	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH	Manhole Monitoring Point
MNW	Monitoring Well
SG	Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JULY - DECEMBER 2011

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
WW-06	1072988.420	1114811.518	NM	NM	681.89	NA	1						
MH								9/22/2011 0845	-7.0	688.89	0.00	688.89	
MH								11/1/2011 0745	-6.7	688.59	0.00	688.59	
MH								12/20/2011 1520	-7.2	689.09	0.00	689.09	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH Manhole Monitoring Point
 MNW Monitoring Well
 SG Staff Gauge

TABLE 2
PFOHL BROTHERS LANDFILL SITE
OVERBURDEN HYDRAULIC GRADIENT

WELL PAIR:	WW-1	*	Level	WW-2	GW-8SR	Level	SG-02	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft)
9/22/2011	688.32	---	---	688.88	692.08	3.20	693.10	4.22
11/1/2011	681.92	---	---	688.78	692.23	3.45	693.20	4.42
12/20/2011	688.22	---	---	688.78	692.25	3.47	693.24	4.46

WELL PAIR:	WW-3	GW-28S	Level	WW-4	*	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)
9/22/2011	689.70	689.96	0.26	683.52	---	---
11/1/2011	689.40	692.31	2.91	683.62	---	---
12/20/2011	689.70	692.56	2.86	683.62	---	---

WELL PAIR:	WW-5	GW-32S	Level	WW-6	GW-34S	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)
9/22/2011	683.74	691.84	8.10	688.89	686.27	-2.62
11/1/2011	683.14	695.73	12.59	688.59	691.86	3.27
12/20/2011	683.84	695.90	12.06	689.09	692.12	3.03

WELL PAIR:	MH-1	SG-1	Level	MH-15	GW-29S	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)
9/22/2011	688.47	DRY	NA	684.01	689.23	5.22
11/1/2011	688.11	691.16	3.05	684.14	692.21	8.07
12/20/2011	688.54	691.22	2.68	684.26	692.59	8.33

WELL PAIR:	MH-16	GW-30S	Level	MH-17	GW-31S	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)
9/22/2011	684.03	688.18	4.15	684.03	691.34	7.31
11/1/2011	684.05	688.54	4.49	684.01	696.00	11.99
12/20/2011	684.09	688.66	4.57	684.06	696.16	12.10

WELL PAIR:	MH-20	GW-35S	Level	MH-22	GW-33S	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)
9/22/2011	686.46	690.75	4.29	689.02	690.43	1.41
11/1/2011	686.46	694.19	7.73	689.07	694.18	5.11
12/20/2011	686.45	694.54	8.09	689.04	694.39	5.35

Notes:

* = No corresponding monitoring well.
NA = Not applicable

APPENDIX D

**GROUNDWATER PURGE AND SAMPLE COLLECTION
LOGS**

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-1S

Date: 11/3/2011 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	3.88'	Depth to Well Bottom:	14.94'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	6.8	Estimated Purge Volume (liters):	11.0
--------------	-----------------	-----------------------------------	-----	----------------------------------	------

Sample ID:	GW-1S	Sample Time:	13:33	QA/QC:	None
------------	-------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information: Riser pipe is bulged inwards, could not remove stainless steel bailer from within well, sampled around it.
Orange floc. in water initially.

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vol_d = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-1D

Date: 11/3/2011 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/
Sampling
Device: Geopump 2 Tubing Type: LDPE/Silicone Pump/Tubing
Inlet
Location: Screen midpoint

Measuring Below Top of Initial Depth Depth to Well Diameter: Screen
Point: Riser to Water: 2.81' Bottom: 39.65' 4" Length:

Casing Volume in 1 Estimated
Type: Stainless Steel Well Casing (liters): 91.0 Purge Volume (liters): 58.4

Sample ID: GW-1D Sample Time: 15:10 QA/QC: None

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information: Sulfur odor

Dark Tint

PURGE PARAMETERS

TIME	pH	TEMP (°C)	COND. (mS/cm)	DISS. O ₂ (mg/l)	TURB. (NTU)	ORP (mV)	FLOW RATE (ml/min.)	DEPTH TO WATER (btor)
13:45	7.21	12.72	0.960	0.76	17.7	-135	630	2.81
13:50	7.35	12.09	0.962	0.00	2.8	-133	690	2.85
13:55	7.36	12.06	0.961	0.00	2.0	-128	690	2.85
14:00	7.37	12.04	0.961	0.00	0.3	-123	690	2.85
14:05	7.36	12.18	0.960	0.00	0.2	-121	690	2.85
14:10	7.37	12.18	0.960	0.00	0.3	-120	690	2.85
14:15	7.36	12.18	0.959	0.00	0.2	-120	690	2.85
14:20	7.32	12.10	0.956	0.00	0.0	-126	690	2.85
14:25	7.28	12.12	0.953	0.00	0.0	-138	690	2.85
14:30	7.22	12.12	0.950	0.00	0.5	-150	690	2.85
14:35	7.19	12.11	0.950	0.00	0.3	-161	690	2.85
14:40	7.17	12.15	0.951	0.00	0.1	-171	690	2.85
14:45	7.15	12.19	0.952	0.00	0.1	-180	690	2.85
14:50	7.14	12.19	0.953	0.00	0.0	-185	690	2.85
14:55	7.13	12.12	0.957	0.00	0.0	-191	690	2.85
15:00	7.12	12.01	0.960	0.00	0.0	-197	690	2.85
15:05	7.12	11.98	0.963	0.00	0.0	-203	690	2.85
15:10	7.11	12.00	0.965	0.00	0.0	-207	690	2.85
Tolerance:	0.1	---	3%	10%	10%	+ or - 10	---	

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vq_{d1} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-3S

Date: 11/1/2011 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	6.27'	Depth to Well Bottom:	13.22'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	4.3	Estimated Purge Volume (liters):	6.3
--------------	-----------------	-----------------------------------	-----	----------------------------------	-----

Sample ID:	GW-3S	Sample Time:	12:40	QA/QC:	None
------------	-------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/t; 1 inch diameter well = 154 ml/t; 2 inch diameter well = 617 ml/t;
4 inch diameter well = 2470 ml/t ($vql_w = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-3D

Date: 11/1/2011 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.20'	Depth to Well Bottom:	35.70'	Well Diameter:	4"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	82.7	Estimated Purge Volume (liters):	34.8
--------------	-----------------	-----------------------------------	------	----------------------------------	------

Sample ID:	GW-3D	Sample Time:	14:05	QA/QC:	MS/MSD
------------	-------	--------------	-------	--------	--------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vol = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-4S

Date: 11/2/2011 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	4.83'	Depth to Well Bottom:	16.23'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	7.0	Estimated Purge Volume (liters):
--------------	-----------------	-----------------------------------	-----	----------------------------------

Sample ID:	GW-4S	Sample Time:	9:05 VOCs/ 10:50 SVOCs & Metals	QA/QC:	None
------------	-------	--------------	------------------------------------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information: Placed passive diffusion bag (PDB) in well 9/23/11, sampled VOCs from PDB at 9:05 on 11/2/11

Well historically goes dry at very low purge rates (<75ml/min). Bailed dry and sampled for SVOCs and Metals after recovery at 10:50.

PURGE PARAMETERS

TIME	pH	TEMP (°C)	COND. (mS/cm)	DISS. O₂ (mg/l)	TURB. (NTU)	ORP (mV)	FLOW RATE (ml/min.)	DEPTH TO WATER (btor)
9:08	7.46	10.96	0.433	5.12	18.5	119	Initial	4.83
9:10	7.59	11.84	0.425	4.83	62.6	76	2 Gal. Purged	-
9:13	7.58	12.14	0.422	5.42	338	-46	3 Gal. Purged	-
9:17	7.58	12.08	0.425	6.14	>1000	-91	5 Gal. Purged	Dry
Tolerance:	0.1	---	3%	10%	10%	+ or - 10	---	

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/t; 1 inch diameter well = 154 ml/t; 2 inch diameter well = 617 ml/t;
4 inch diameter well = 2470 ml/t ($vql_w = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-4D

Date: 11/2/2011 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	13.47'	Depth to Well Bottom:	45.57'	Well Diameter:	4"	Screen Length:
------------------	--------------------	-------------------------	--------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	79.3	Estimated Purge Volume (liters):	12.7
--------------	-----------------	-----------------------------------	------	----------------------------------	------

Sample ID:	GW-4D	Sample Time:	10:41	QA/QC:	None
------------	-------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

	TIME	pH	TEMP (°C)	COND. (mS/cm)	DISS. O ₂ (mg/l)	TURB. (NTU)	ORP (mV)	FLOW RATE (ml/min.)	DEPTH TO WATER (btor)
	9:35	7.27	10.81	1.13	6.56	39.3	-69	230	13.47
	9:40	7.19	10.76	1.13	6.75	28.3	-91	190	13.95
	9:45	7.17	10.90	1.14	0.00	40.5	-106	190	14.23
	9:50	7.16	11.05	1.14	0.00	38.3	-117	190	14.47
	9:55	7.15	11.15	1.14	0.00	34.3	-129	190	14.62
	10:00	7.15	11.22	1.15	0.00	32.4	-137	190	14.75
	10:05	7.14	11.29	1.15	0.00	24.6	-154	190	14.82
	10:10	7.13	11.43	1.16	0.00	23.2	-175	190	14.95
	10:15	7.12	11.52	1.15	0.00	21.5	-193	190	15.00
	10:20	7.11	11.61	1.17	0.00	19.2	-216	190	15.04
	10:25	7.10	11.72	1.17	0.00	16.1	-236	190	15.12
	10:30	7.10	11.81	1.18	0.00	16.2	-248	190	15.18
	10:35	7.09	11.90	1.20	0.00	13.3	-258	190	15.20
	10:38	7.09	11.93	1.20	0.00	12.8	-262	190	15.21
	10:41	7.09	12.03	1.21	0.00	11.9	-266	190	15.26
Tolerance:	0.1	---	3%	10%	10%	+ or - 10	---		

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vol_d = \pi r^2 h$)

WELL PURGING LOG

URS Corporation

SITE NAME:	Pfohl Brothers Landfill	WELL NO.:	GW-7S
PROJECT NO.:	11175616.00000		
STAFF:	Rob Murphy, Tom Urban		
DATE(S):	11/1/2011, 11/2/11		

1. TOTAL CASING AND SCREEN LENGTH (FT.)	=	<u>35.04</u>	WELL ID. 1"	VOL. (GAL/FT) 0.040
2. WATER LEVEL BELOW TOP OF CASING (FT.)	=	<u>4.57</u>	2"	0.17
3. NUMBER OF FEET STANDING WATER (#1 - #2)	=	<u>30.47</u>	3"	0.38
4. VOLUME OF WATER/FOOT OF CASING (GAL.)	=	<u>0.17</u>	4"	0.66
5. VOLUME OF WATER IN CASING (GAL.)(#3 x #4)	=	<u>5.2</u>	5"	1.04
6. VOLUME OF WATER TO REMOVE (GAL.)(#5 x 3)	=	<u></u>	6"	1.50
7. VOLUME OF WATER ACTUALLY REMOVED (GAL.)	=	<u>8.0</u>	8"	2.60

$V=0.0408 \times (\text{CASING DIAMETER [INCHES]})^2$

PARAMETERS	ACCUMULATED VOLUME PURGED (GALLONS)									
	Initial	2.0	4.0	6.0	8.0					
pH	7.87	7.76	7.71	7.74	7.73					
SPEC. COND. (mS/cm)	0.542	0.536	0.536	0.533	0.518					
DO (mg/l)	9.69	1.87	6.04	7.05	4.48					
TEMPERATURE (°C)	11.63	11.59	12.03	11.64	11.31					
TURBIDITY (NTU)	46.5	75.1	26.2	203	687					
ORP (millivolts)	-110	-61	-89.0	-52	-48					
TIME	10:58	11:02	11:05	11:12	11:19					

COMMENTS: 9:55 - Fill VOCs from passive diffusion bag (PDB), PDB was installed on 9/23/11
 10:58 - Begin handbailing well.
 11:19 - Well dry after removing 8.0 gallons.
 11/2/2011 15:42 - return to well, depth to water = 4.78 feet.
 15:45 - Collect sample for SVOCs and Metals.

WELL PURGING LOG

URS Corporation

SITE NAME:	Pfohl Brothers Landfill	WELL NO.:	GW-7D
PROJECT NO.:	11175616.00000		
STAFF:	Rob Murphy, Tom Urban		
DATE(S):	11/1/11, 11/2/11		

			WELL ID.	VOL. (GAL/FT)
1. TOTAL CASING AND SCREEN LENGTH (FT.)	=	60.45	1"	0.040
2. WATER LEVEL BELOW TOP OF CASING (FT.)	=	45.26	2"	0.17
3. NUMBER OF FEET STANDING WATER (#1 - #2)	=	15.19	3"	0.38
4. VOLUME OF WATER/FOOT OF CASING (GAL.)	=	0.66	4"	0.66
5. VOLUME OF WATER IN CASING (GAL.)(#3 x #4)	=	10.0	5"	1.04
6. VOLUME OF WATER TO REMOVE (GAL.)(#5 x 3)	=		6"	1.50
7. VOLUME OF WATER ACTUALLY REMOVED (GAL.)	=	10.1	8"	2.60

$V=0.0408 \times (\text{CASING DIAMETER [INCHES]})^2$

PARAMETERS	ACCUMULATED VOLUME PURGED (GALLONS)									
	Init	3	6	9	10.1					
pH	8.02	7.48	7.36	7.43	7.74					
SPEC. COND. (mS/cm)	0.678	0.642	0.705	0.746	0.745					
DO (mg/)	12.53	10.60	4.40	9.30	3.73					
TEMPERATURE (°C)	11.76	11.44	11.41	11.38	11.40					
TURBIDITY (NTU)	9.4	30.5	31.4	45.7	105					
ORP (millivolts)	-69	-69	-72	-106	-60					
TIME	10:15	10:25	10:35	10:43	10:52					

COMMENTS: 9:50 - Fill VOCs from passive diffusion bag (PDB), PDB was installed on 9/23/11
 10:15 - Begin handbailing well.
 10:52 - Well dry after removing 10.1 gallons
 5/17/2011 15:14 - return to well, depth to water = 59.75 feet.
 15:15 - Collect sample for SVOCs and Metals, only enough volume to fill 1 metals container and 1-1 liter Amber container.

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-8SR

Date: 11/1/2011 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	5.27'	Depth to Well Bottom:	13.02'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	4.8	Estimated Purge Volume (liters):	9.5
--------------	-----------------	-----------------------------------	-----	----------------------------------	-----

Sample ID:	GW-8SR	Sample Time:	16:17	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/t; 1 inch diameter well = 154 ml/t; 2 inch diameter well = 617 ml/t;
4 inch diameter well = 2470 ml/t ($vql_w = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-8D

Date: 11/1/2011 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	6.16'	Depth to Well Bottom:	36.54'	Well Diameter:	4"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	75.0	Estimated Purge Volume (liters):	44.2
--------------	-----------------	-----------------------------------	------	----------------------------------	------

Sample ID:	GW-8D	Sample Time:	15:30	QA/QC:	Duplicate (ID=Duplicate)
------------	-------	--------------	-------	--------	--------------------------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vol_d = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-26D

Date: 11/2/2011 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	7.05'	Depth to Well Bottom:	40.70'	Well Diameter:	4"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	83.1	Estimated Purge Volume (liters):	31.5
--------------	-----------------	-----------------------------------	------	----------------------------------	------

Sample ID:	GW-26D	Sample Time:	13:03	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

Occasional pulses of iron stained particulates in purge water.

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/t; 1 inch diameter well = 154 ml/t; 2 inch diameter well = 617 ml/t;
4 inch diameter well = 2470 ml/t ($vql_w = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-28S

Date: 11/2/2011 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	8.73'	Depth to Well Bottom:	15.52'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	4.2	Estimated Purge Volume (liters):	8.1
--------------	-----------------	-----------------------------------	-----	----------------------------------	-----

Sample ID:	GW-28S	Sample Time:	11:59	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/t; 1 inch diameter well = 154 ml/t; 2 inch diameter well = 617 ml/t;
4 inch diameter well = 2470 ml/t ($vql_w = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-29S

Date: 11/2/2011 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	7.67'	Depth to Well Bottom:	20.04'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	7.6	Estimated Purge Volume (liters):	7.1
--------------	-----------------	-----------------------------------	-----	----------------------------------	-----

Sample ID:	GW-29S	Sample Time:	14:50	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vol_d = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-30S

Date: 11/3/2011 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	8.07'	Depth to Well Bottom:	17.97'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	6.1	Estimated Purge Volume (liters):	29.1
--------------	-----------------	-----------------------------------	-----	----------------------------------	------

Sample ID:	GW-30S	Sample Time:	8:50	QA/QC:	None
------------	--------	--------------	------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/t; 1 inch diameter well = 154 ml/t; 2 inch diameter well = 617 ml/t;
4 inch diameter well = 2470 ml/t ($vol_w = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-31S

Date: 11/3/2011 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.70'	Depth to Well Bottom:	9.57'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	-------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	4.2	Estimated Purge Volume (liters):	6.7
--------------	-----------------	-----------------------------------	-----	----------------------------------	-----

Sample ID:	GW-31S	Sample Time:	9:47	QA/QC:	None
------------	--------	--------------	------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

TIME	pH	TEMP (°C)	COND. (mS/cm)	DISS. O₂ (mg/l)	TURB. (NTU)	ORP (mV)	FLOW RATE (ml/min.)	DEPTH TO WATER (btor)
9:07	7.38	12.76	0.704	0.99	39.2	-34	190	2.70
9:12	7.12	12.53	0.690	0.50	32.0	-13	165	4.07
9:17	7.06	12.47	0.686	0.34	31.3	3	165	4.65
9:22	7.04	12.55	0.686	0.34	32.7	12	165	4.81
9:27	7.02	12.60	0.686	0.33	30.1	15	165	5.04
9:32	7.01	12.67	0.686	0.25	26.6	17	165	5.18
9:37	6.99	12.78	0.689	0.17	22.4	17	165	5.43
9:42	6.99	12.87	0.687	0.18	22.9	15	165	5.65
9:47	6.98	12.93	0.687	0.16	23.2	13	165	5.76
Tolerance:	0.1	---	3%	10%	10%	+ or - 10	---	

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/t; 1 inch diameter well = 154 ml/t; 2 inch diameter well = 617 ml/t;
4 inch diameter well = 2470 ml/t ($vql_w = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-32S

Date: 11/3/2011 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.80'	Depth to Well Bottom:	9.93'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	-------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	4.4	Estimated Purge Volume (liters):	7.9
--------------	-----------------	-----------------------------------	-----	----------------------------------	-----

Sample ID:	GW-32S	Sample Time:	11:00	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/t; 1 inch diameter well = 154 ml/t; 2 inch diameter well = 617 ml/t;
4 inch diameter well = 2470 ml/t ($vql_w = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-33S

Date: 11/3/2011 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	4.22'	Depth to Well Bottom:	8.21'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	-------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	2.5	Estimated Purge Volume (liters):	5.2
--------------	-----------------	-----------------------------------	-----	----------------------------------	-----

Sample ID:	GW-33S	Sample Time:	12:00	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/t; 1 inch diameter well = 154 ml/t; 2 inch diameter well = 617 ml/t;
4 inch diameter well = 2470 ml/t ($vql_w = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-34S

Date: 11/1/2011 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.82'	Depth to Well Bottom:	10.01'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	4.4	Estimated Purge Volume (liters):	5.2
--------------	-----------------	-----------------------------------	-----	----------------------------------	-----

Sample ID: GW-34S Sample Time: 8:20 QA/QC: None

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/t; 1 inch diameter well = 154 ml/t; 2 inch diameter well = 617 ml/t;
4 inch diameter well = 2470 ml/t ($vql_w = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-35S

Date: 11/2/2011 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	3.20'	Depth to Well Bottom:	7.46'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	-------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	2.6	Estimated Purge Volume (liters):	7.2
--------------	-----------------	-----------------------------------	-----	----------------------------------	-----

Sample ID:	GW-35S	Sample Time:	13:48	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($v_{ol} = \pi r^2 h$)

APPENDIX E

HISTORICAL ANALYTICAL RESULTS

FIGURE E-1
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-01D

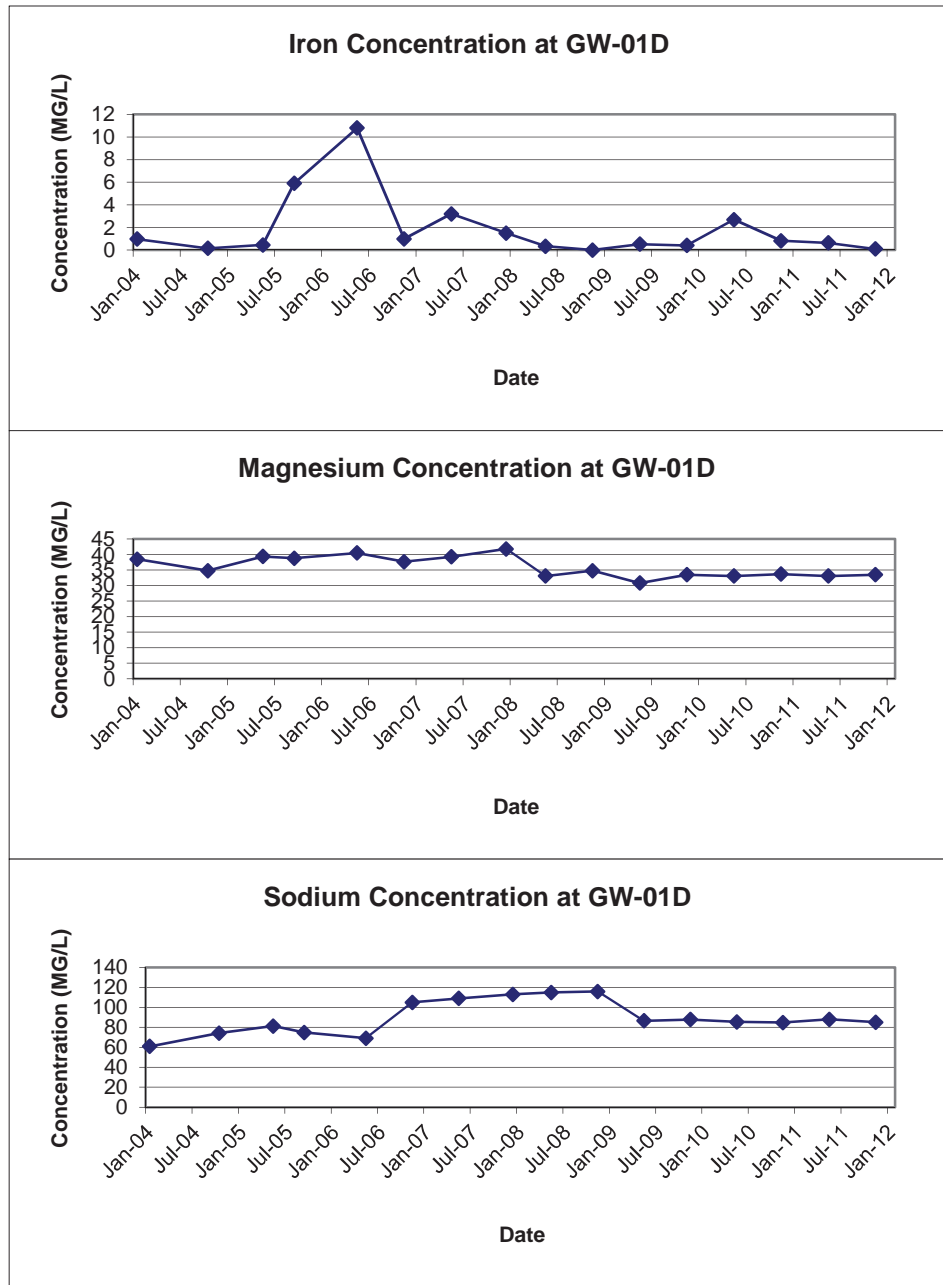


FIGURE E-2
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-1S

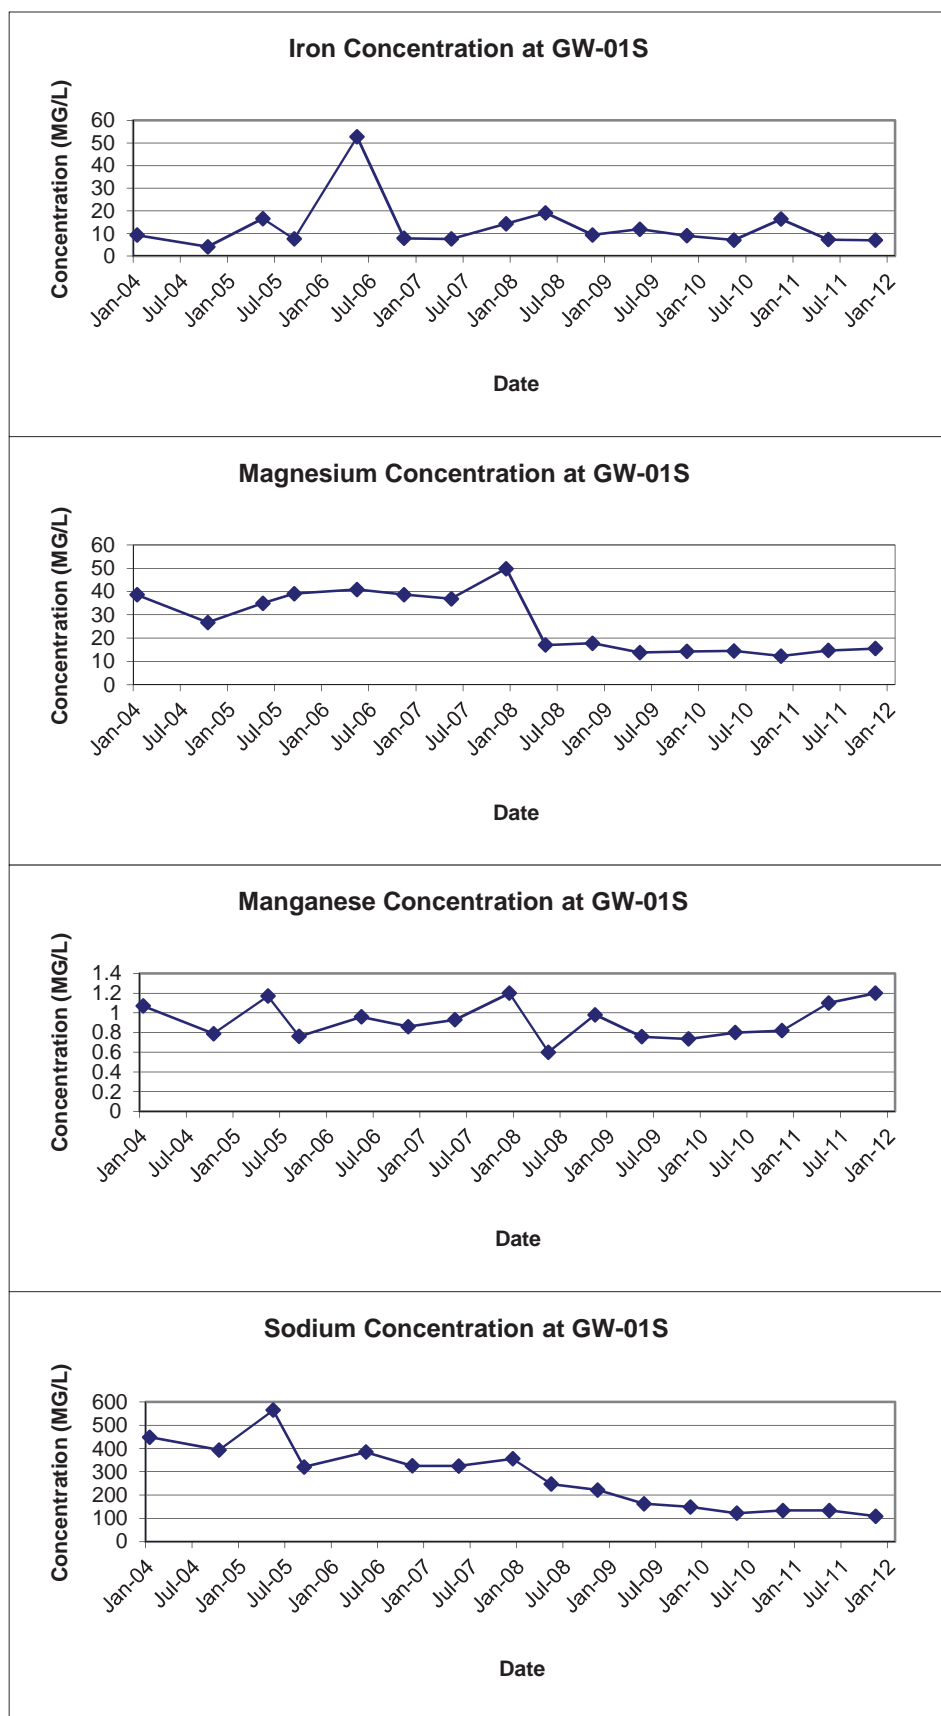


FIGURE E-3
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-3D

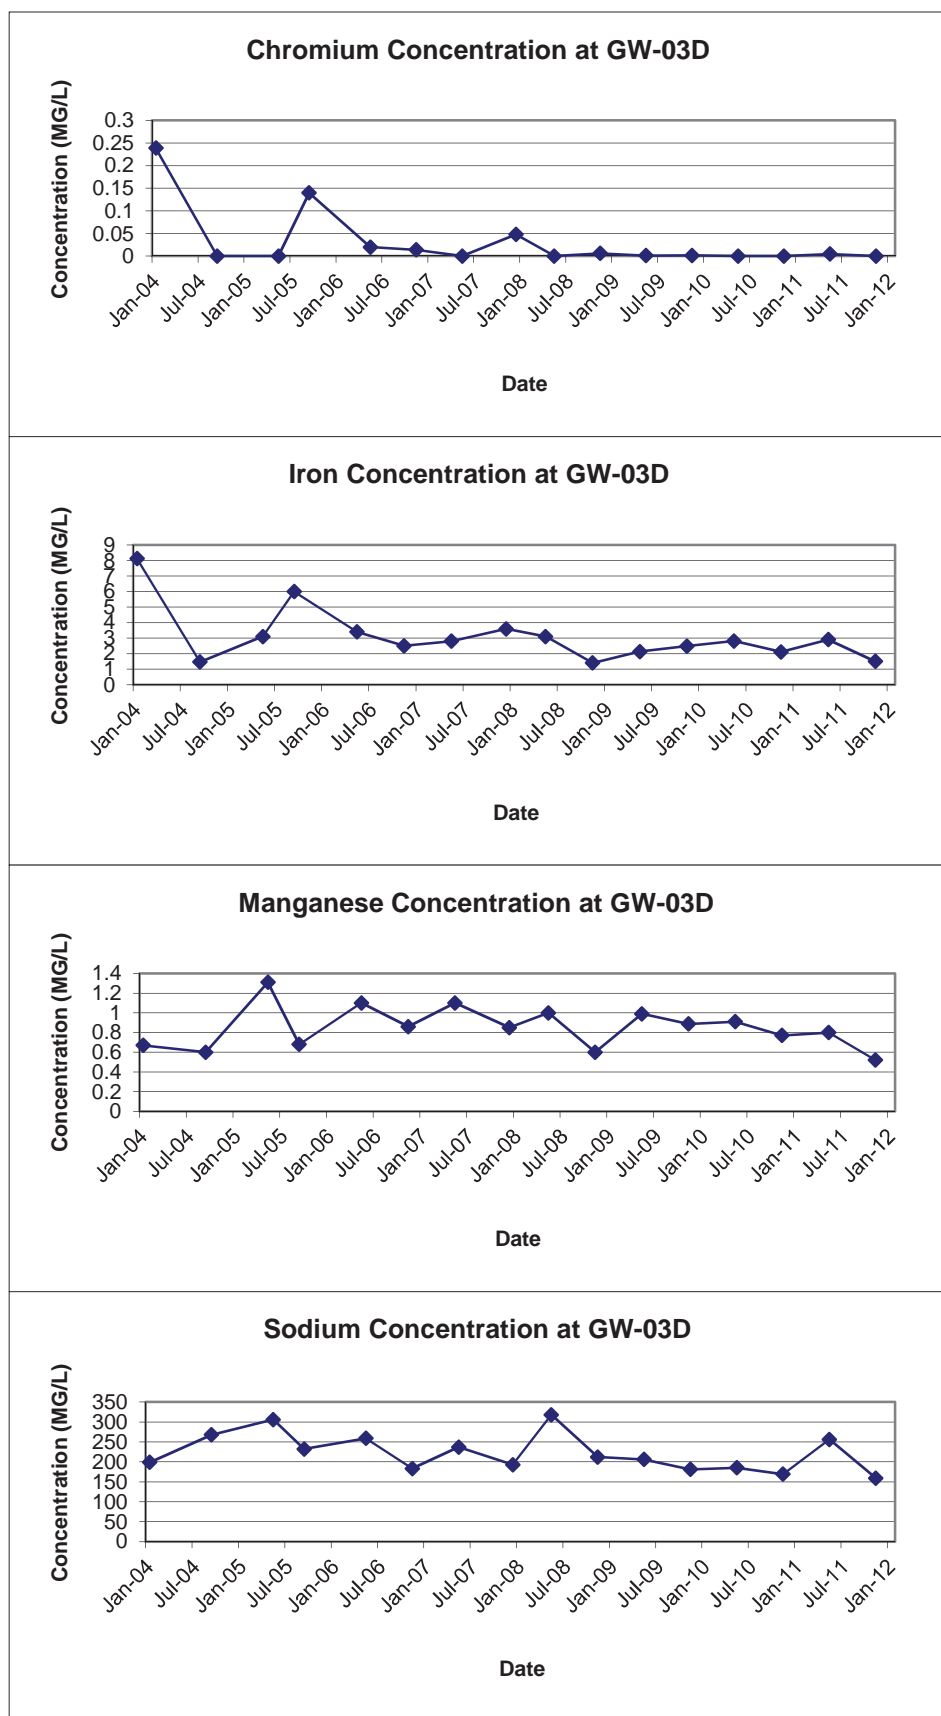


FIGURE E-4
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-3S

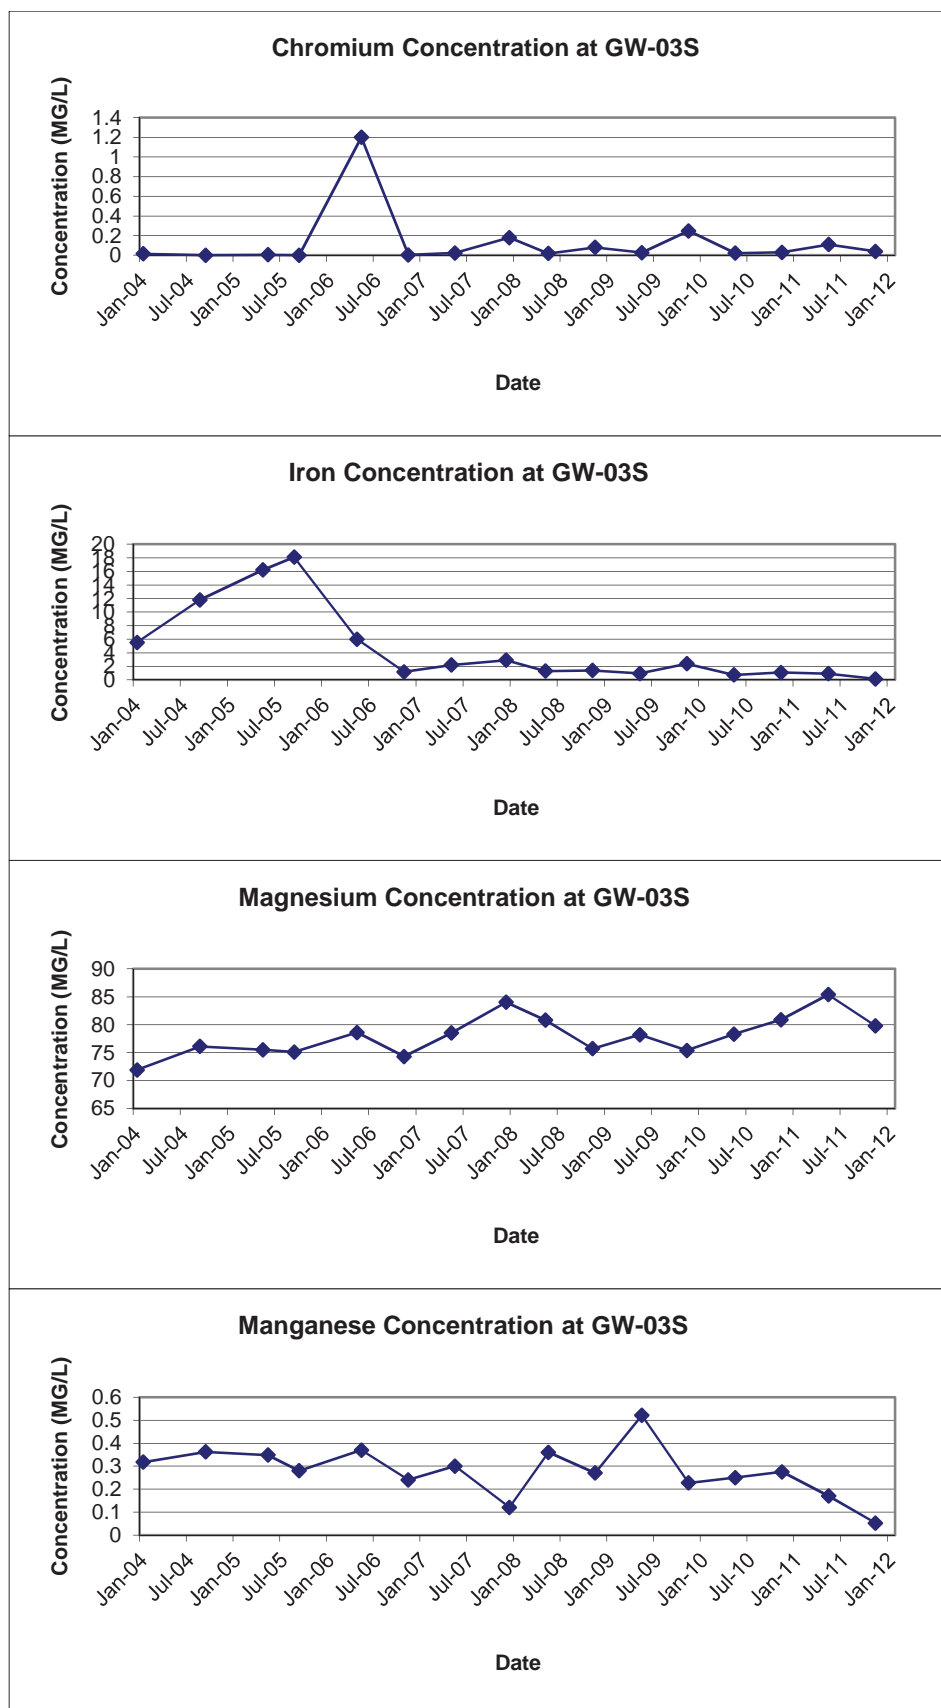


FIGURE E-4
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-3S

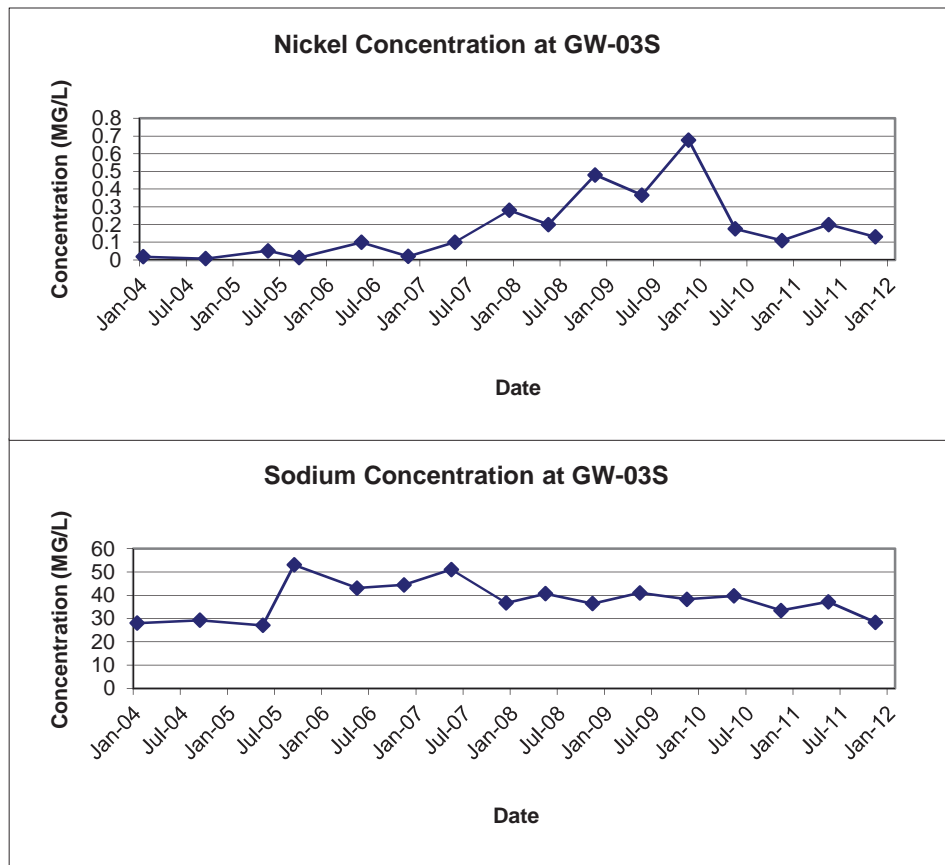


FIGURE E-5
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-04D

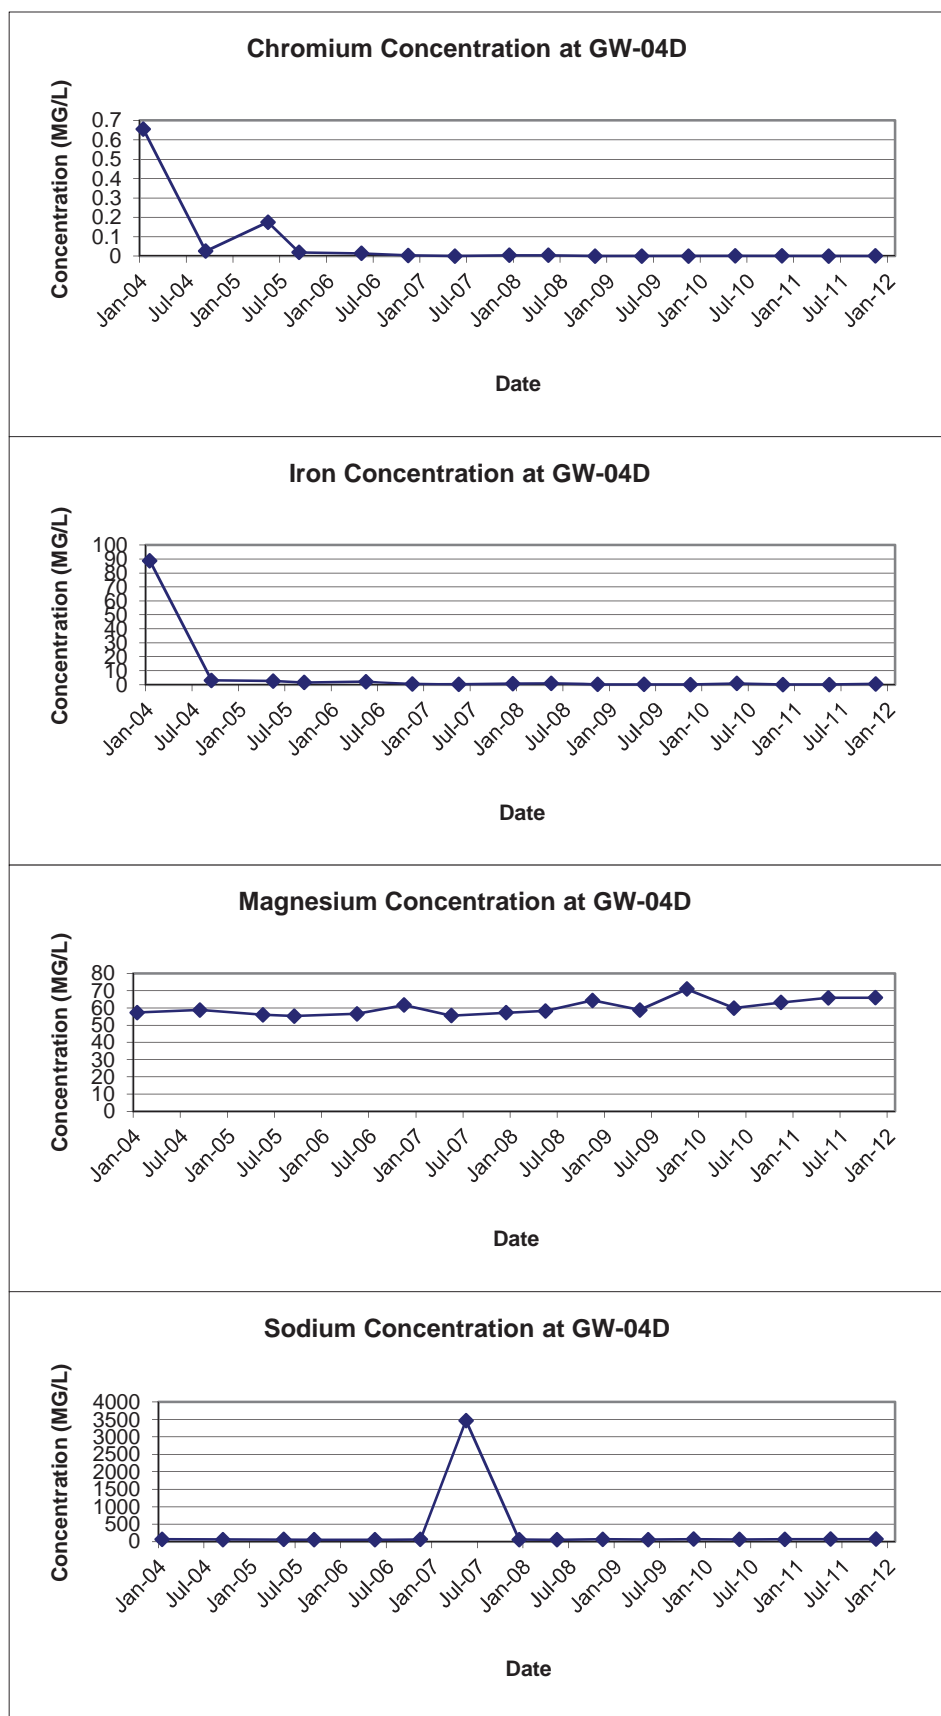


FIGURE E-6
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-04S

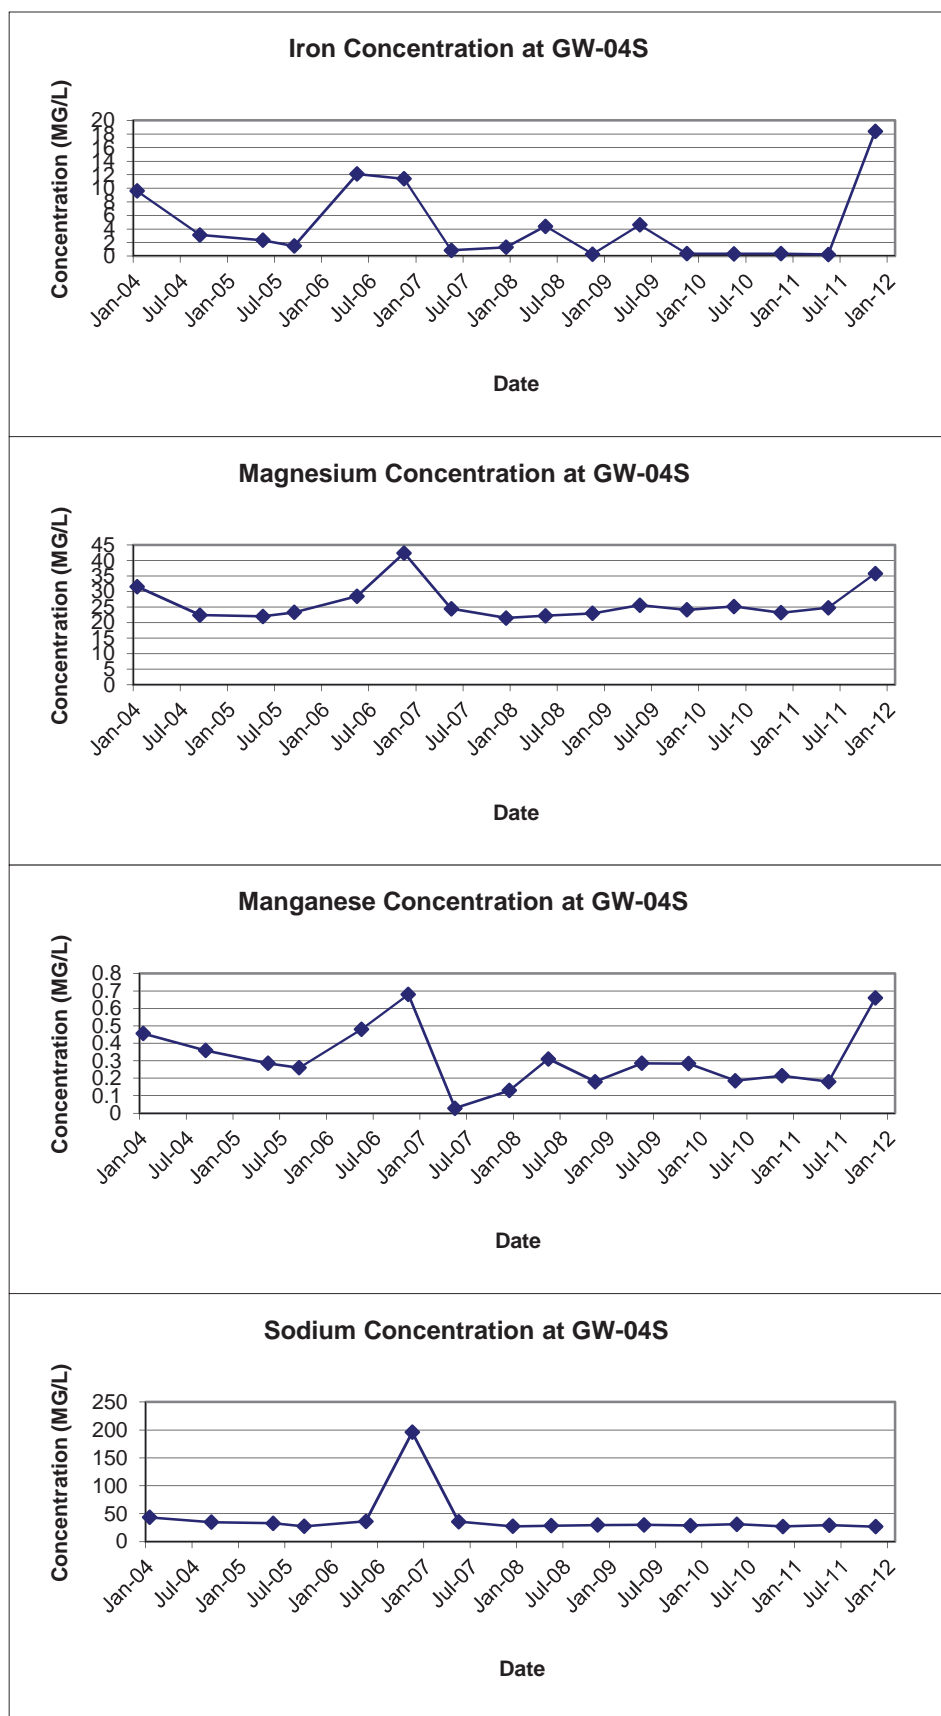


FIGURE E-7
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-7D

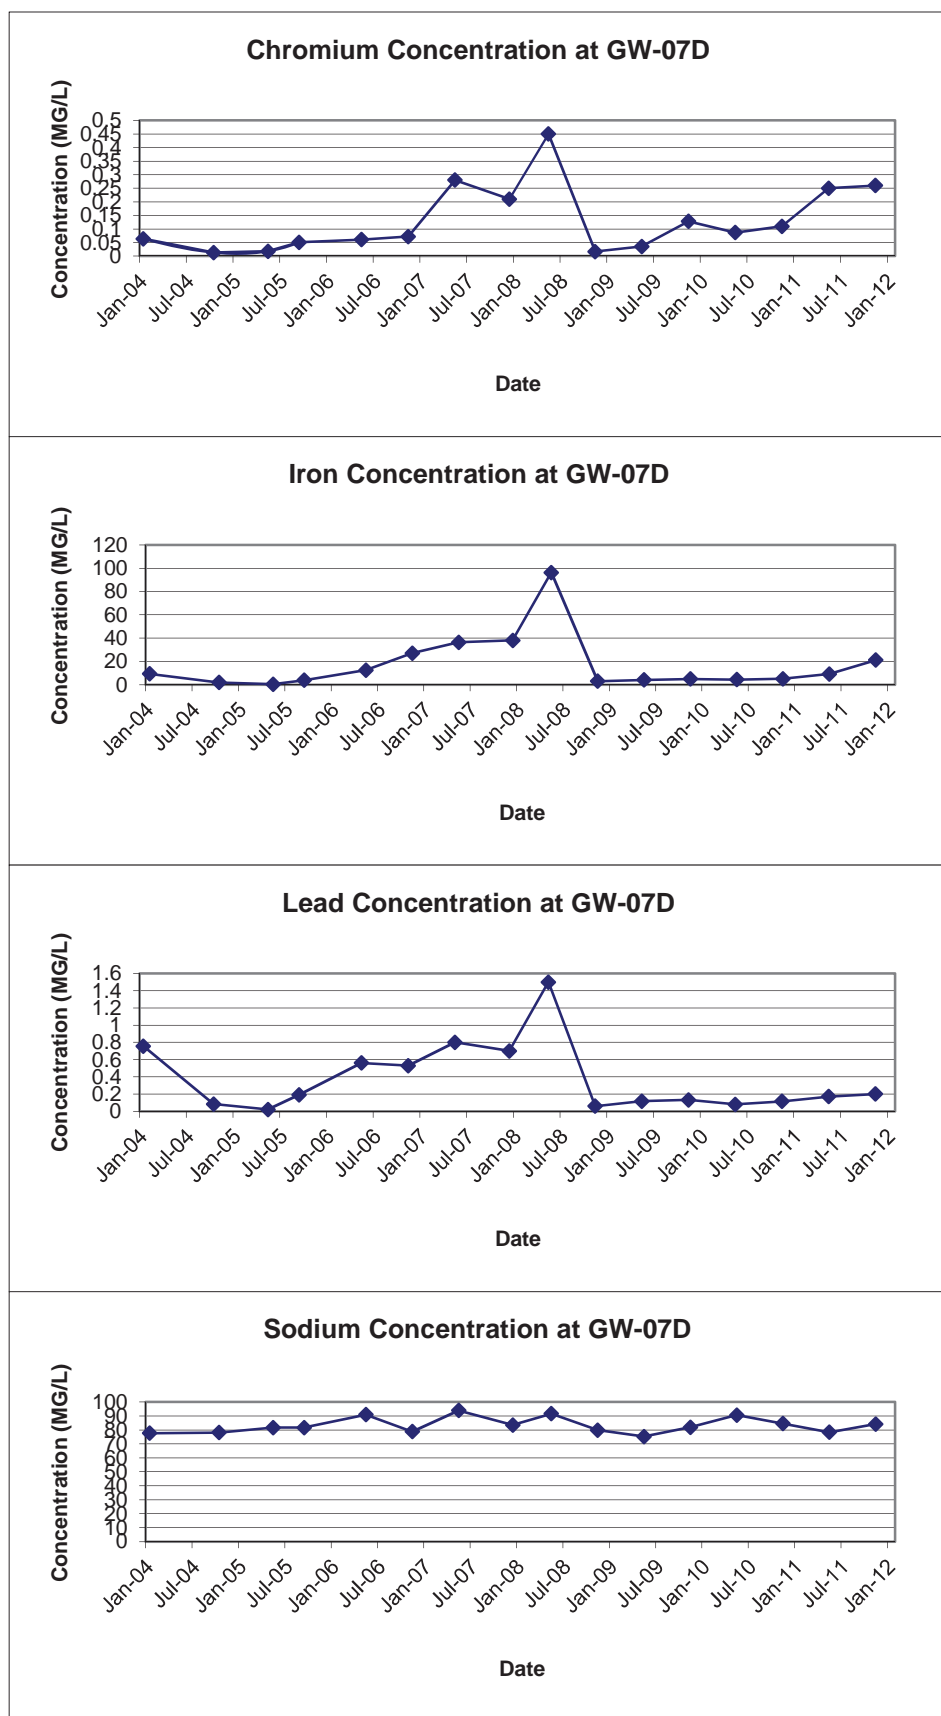


FIGURE E-8
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-7S

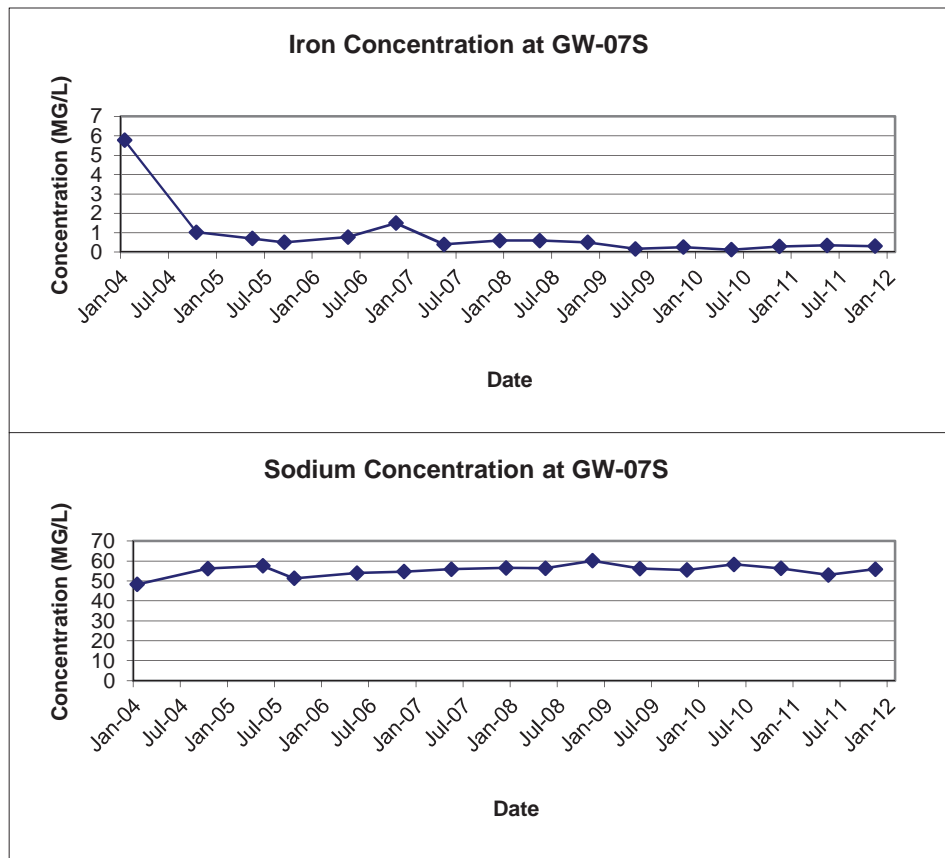


FIGURE E-9
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-8D

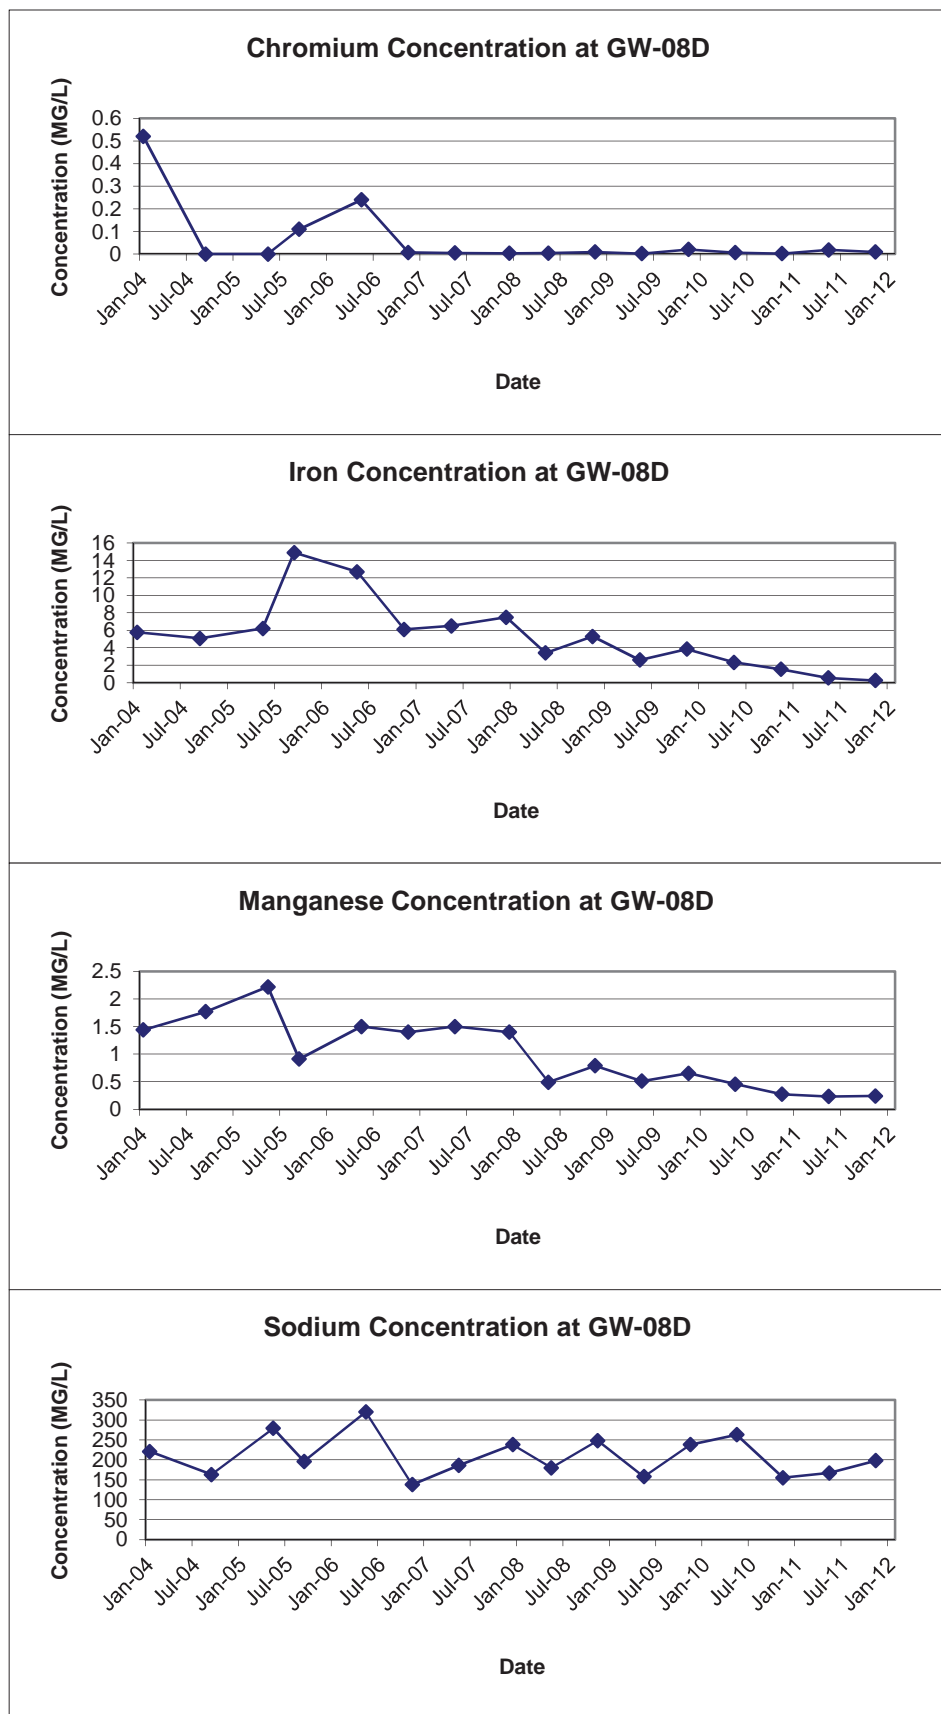


FIGURE E-10
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-08SR

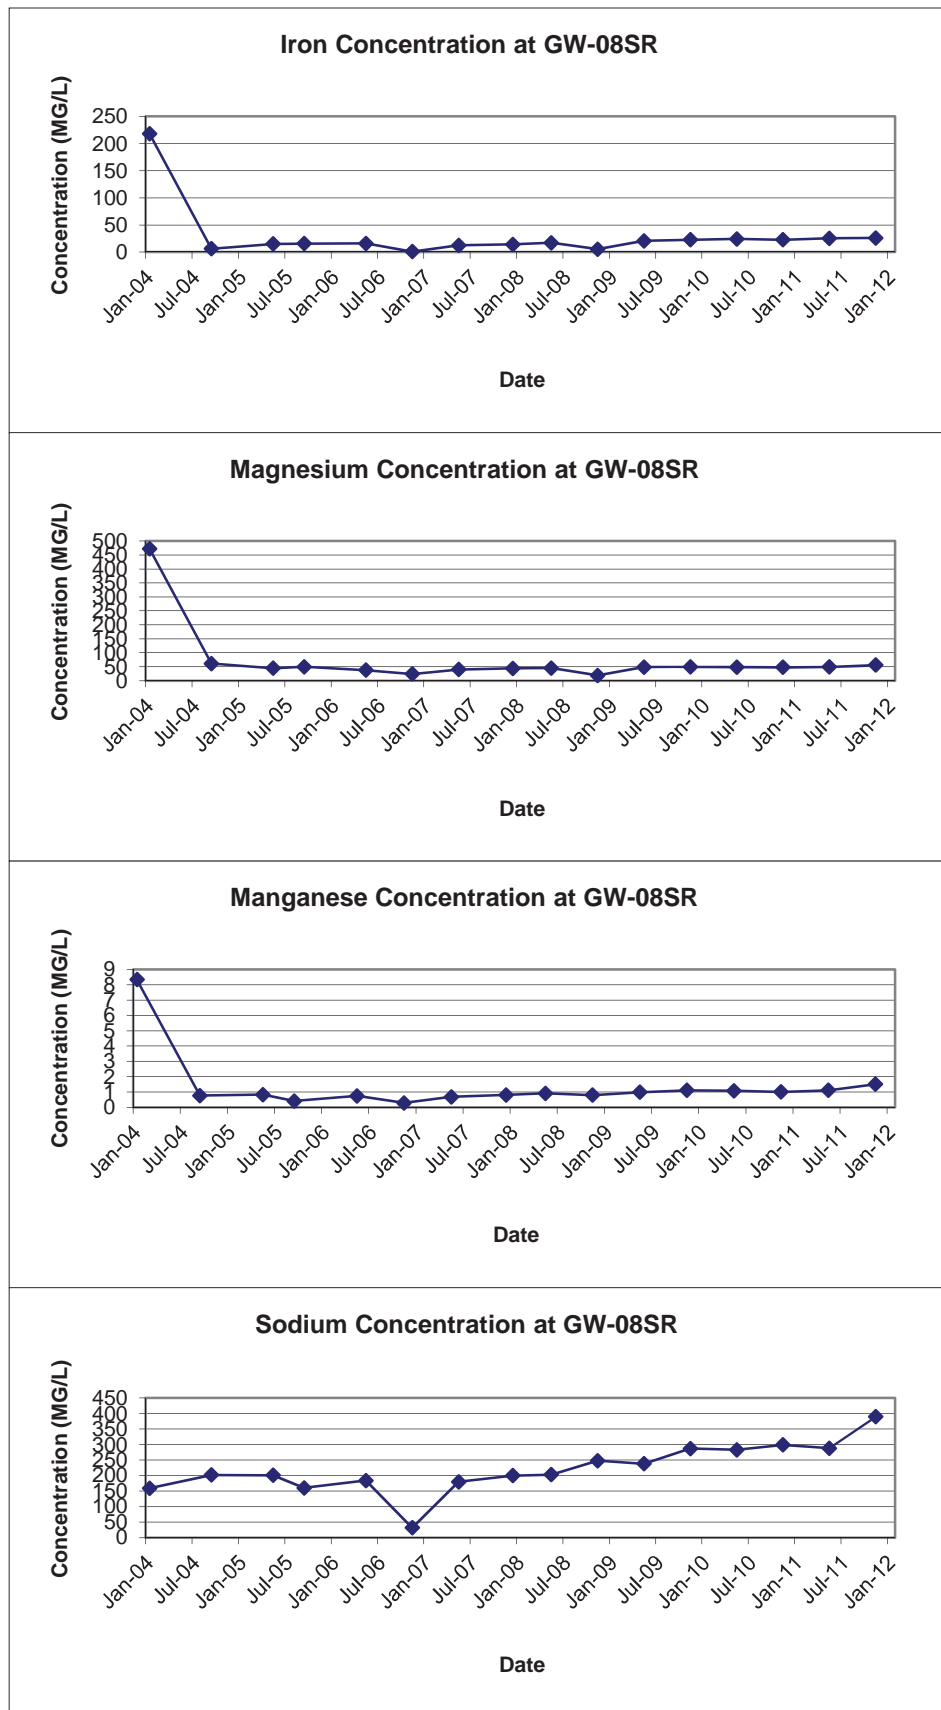


FIGURE E-11
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-26D

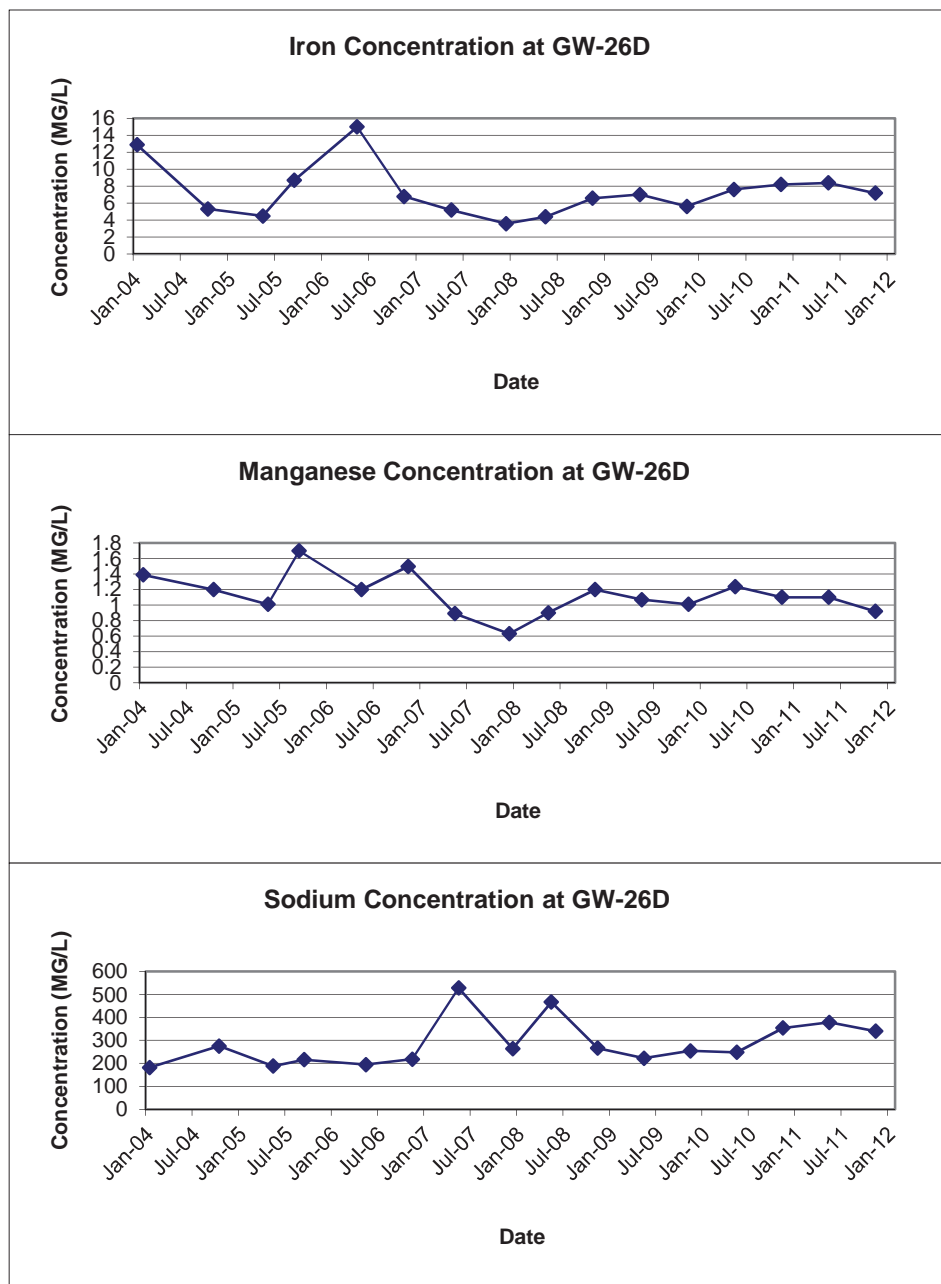


FIGURE E-12
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-28S

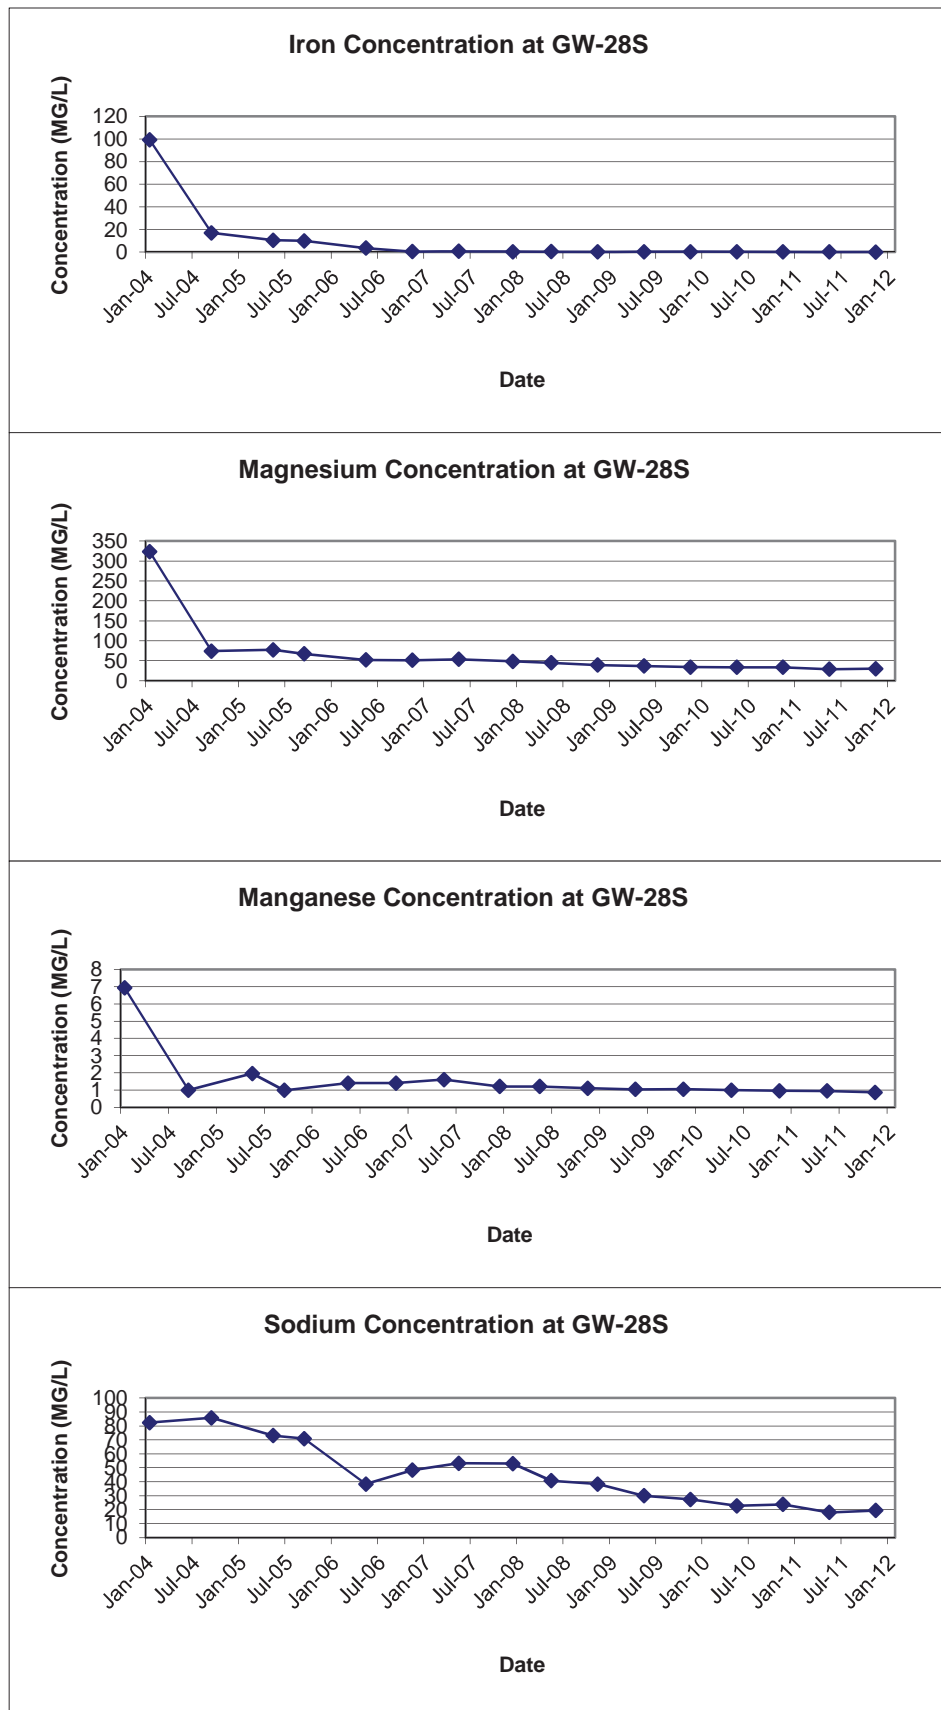


FIGURE E-13
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-29S

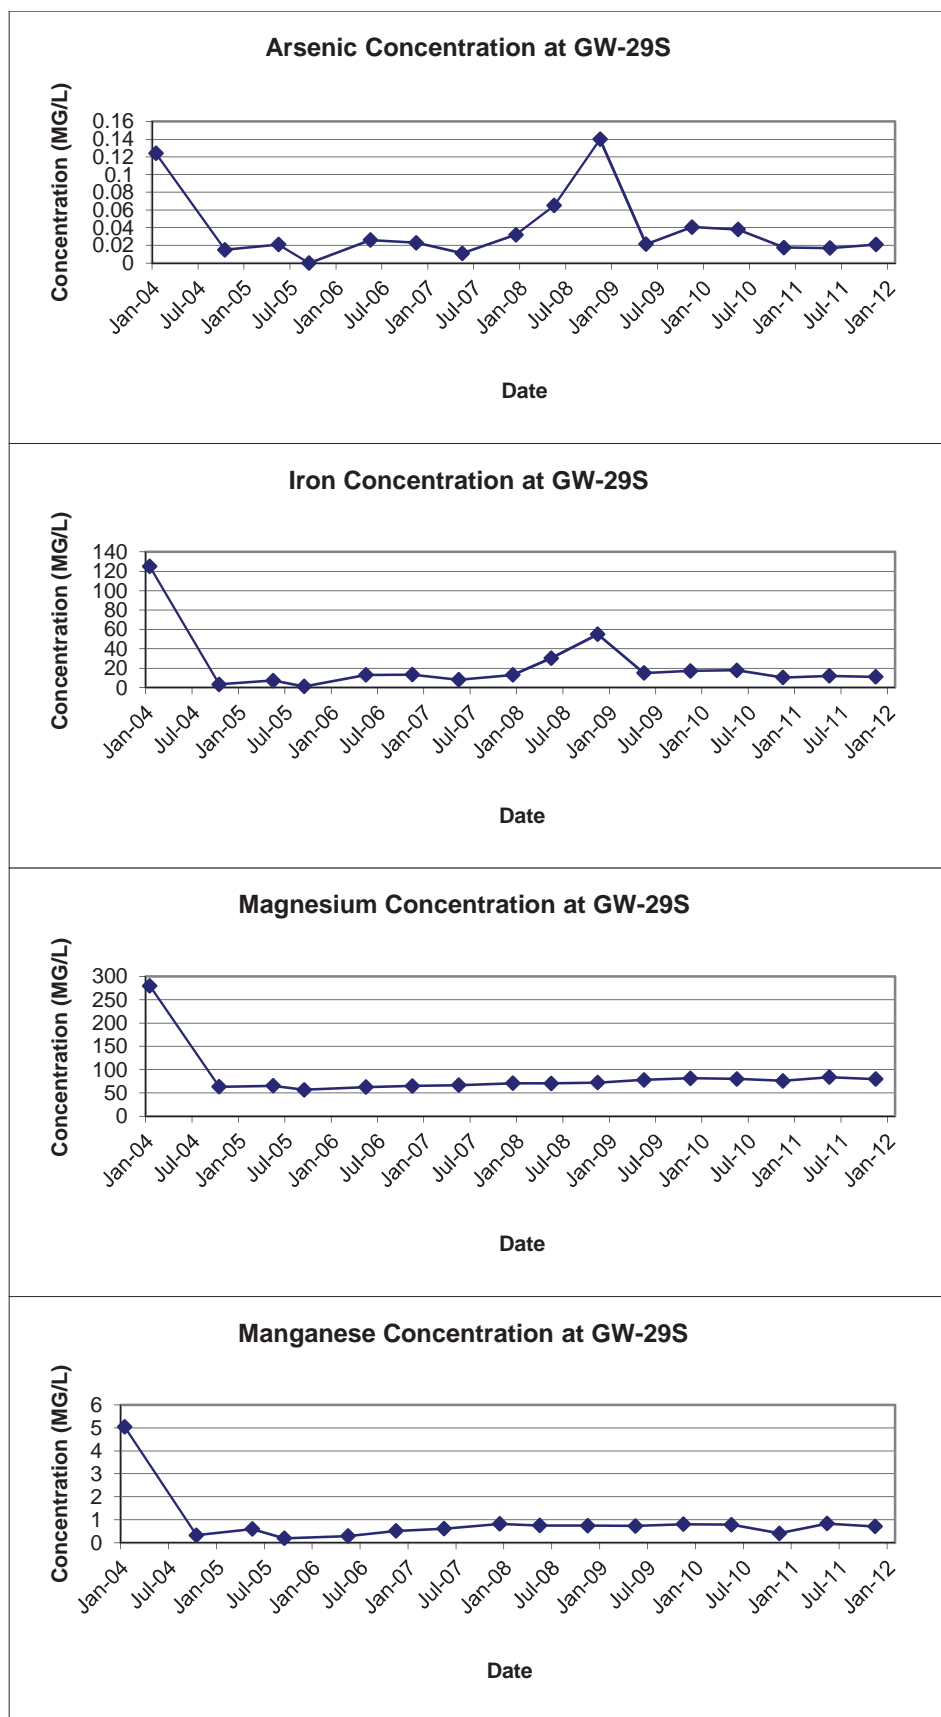


FIGURE E-13
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-29S

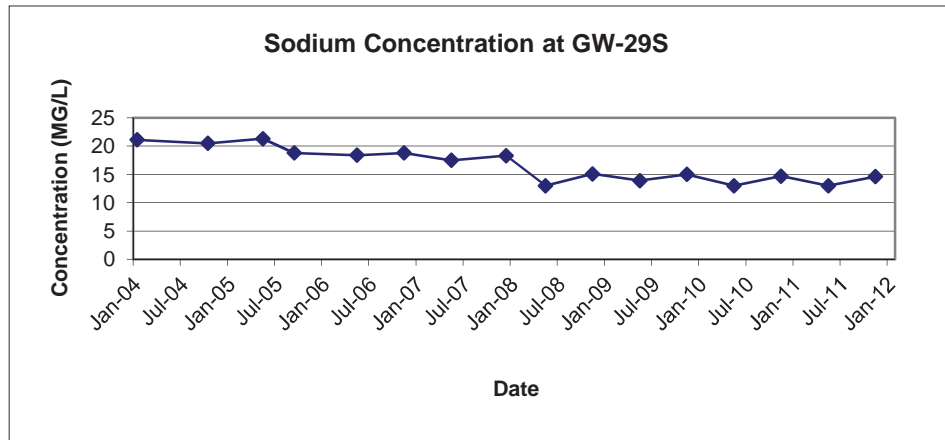


FIGURE E-14
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-30S

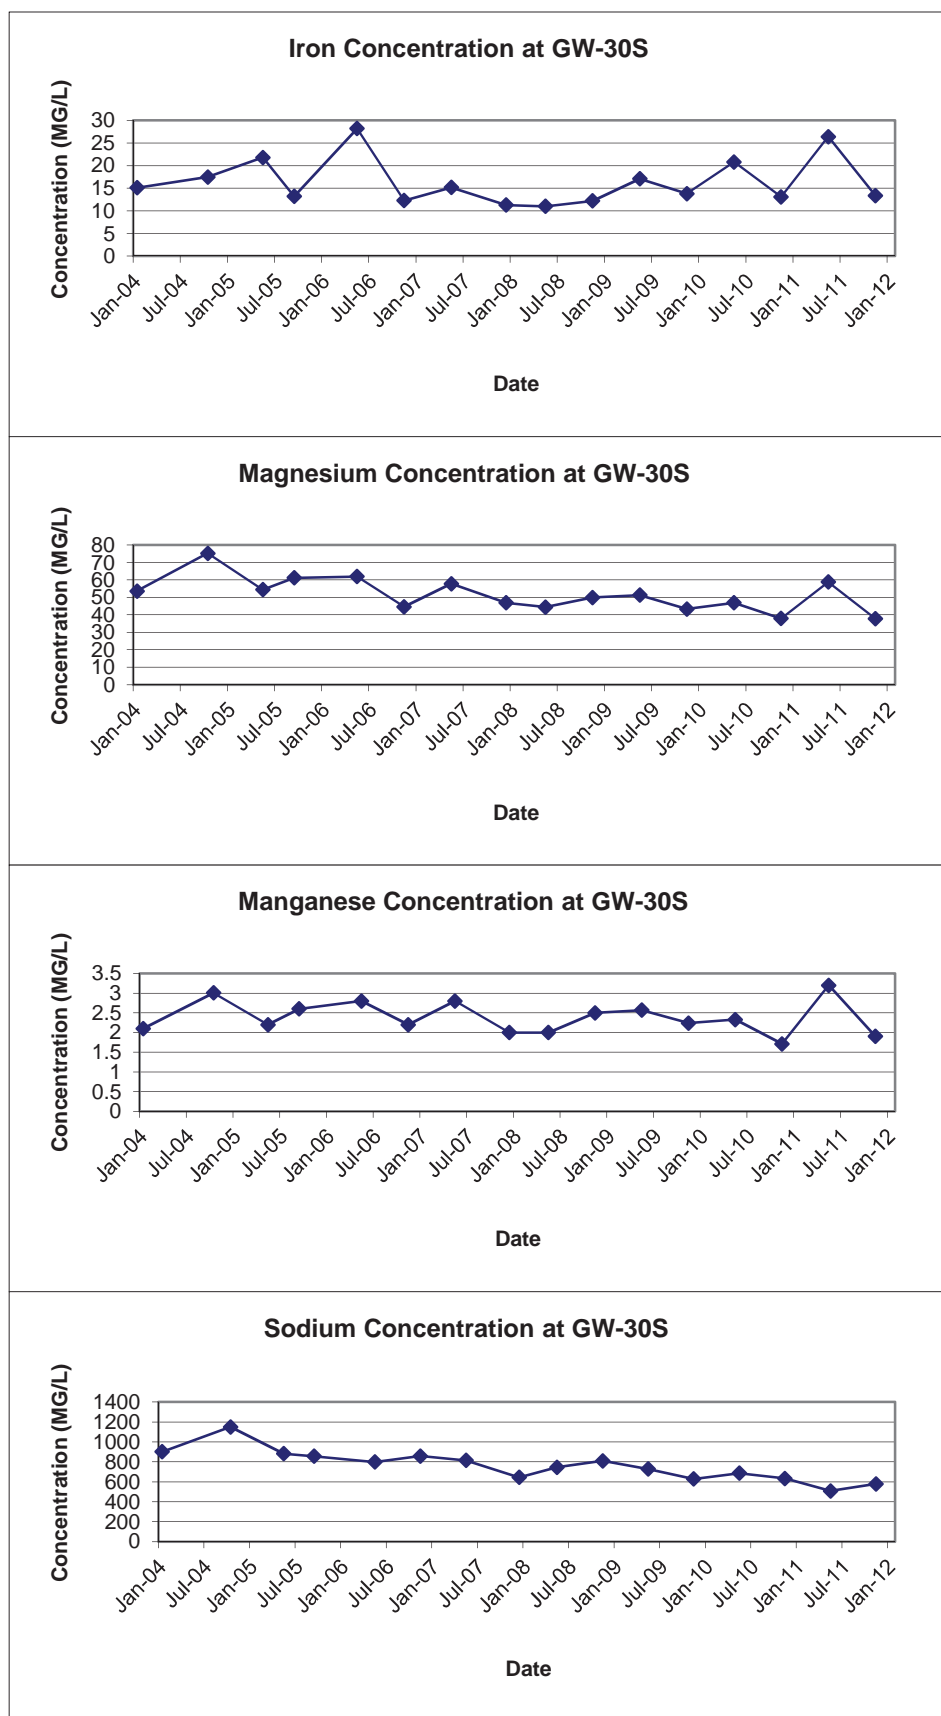


FIGURE E-15
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-31S

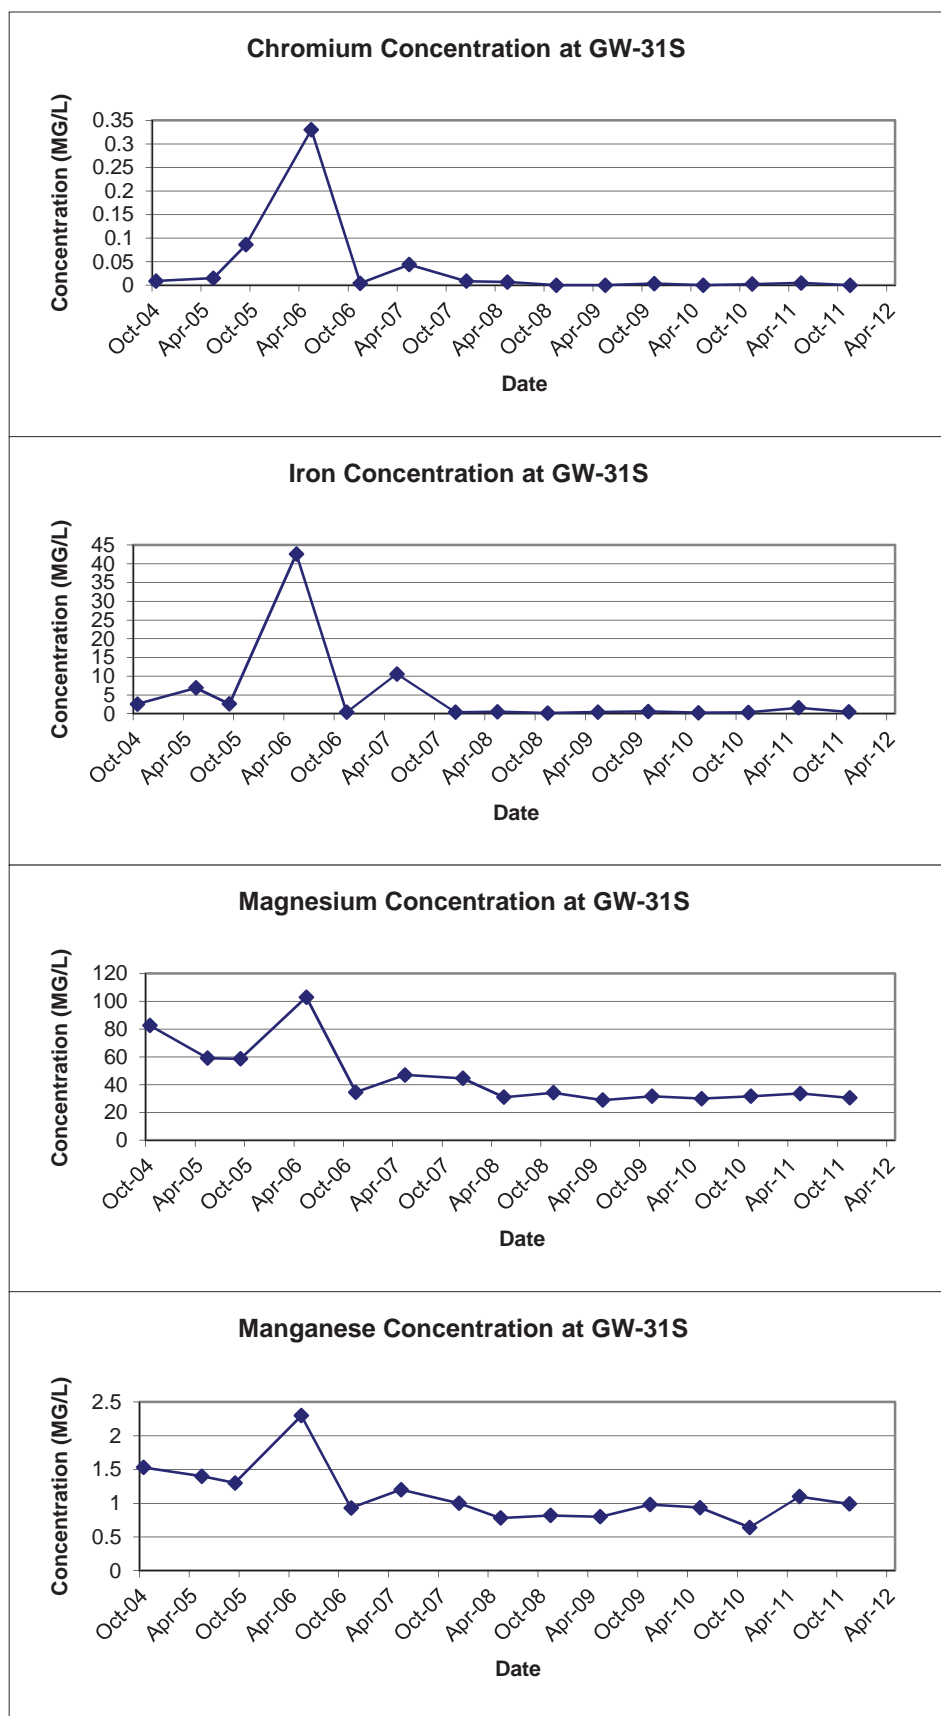


FIGURE E-16
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-32S

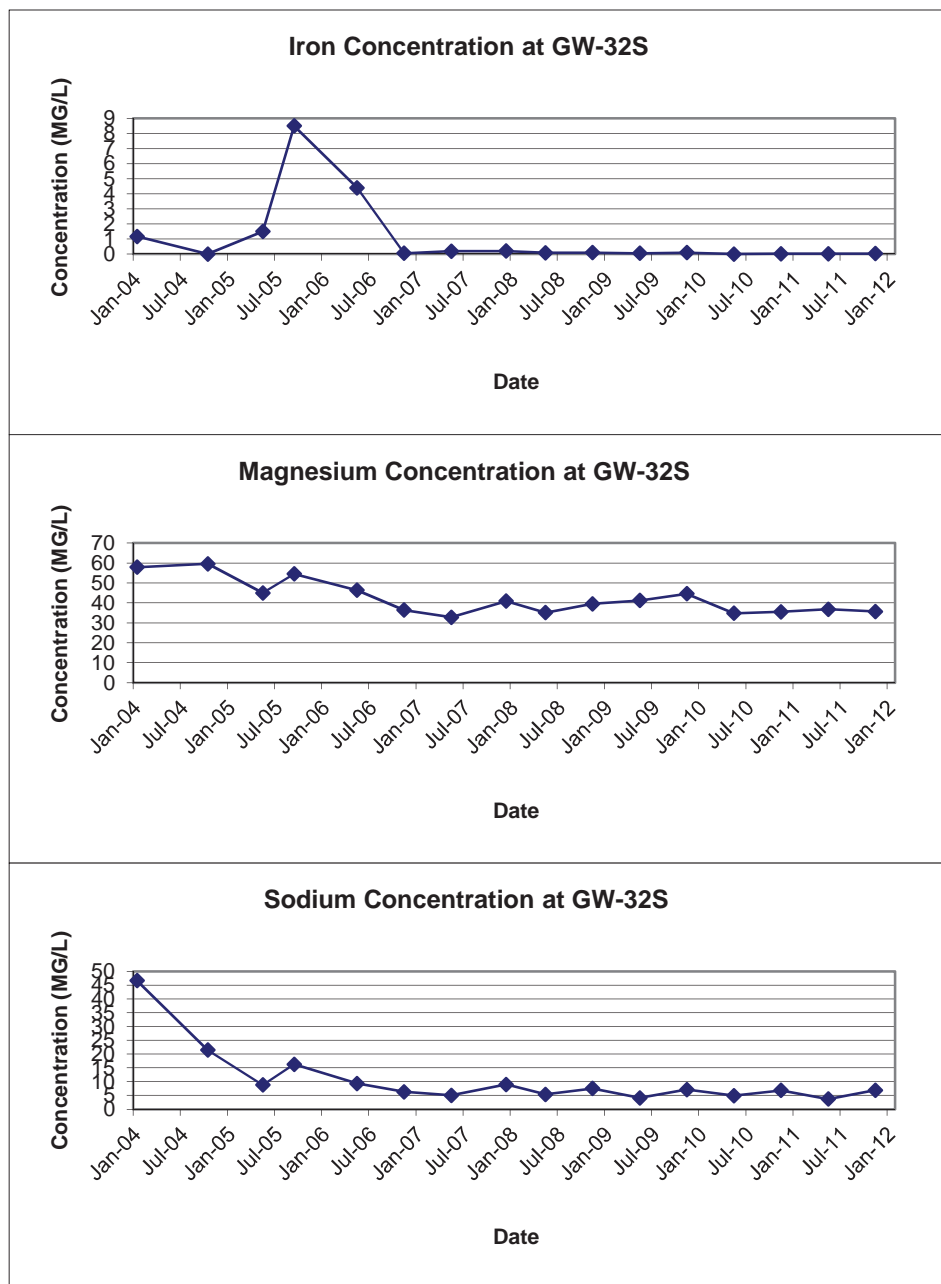


FIGURE E-17
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-33S

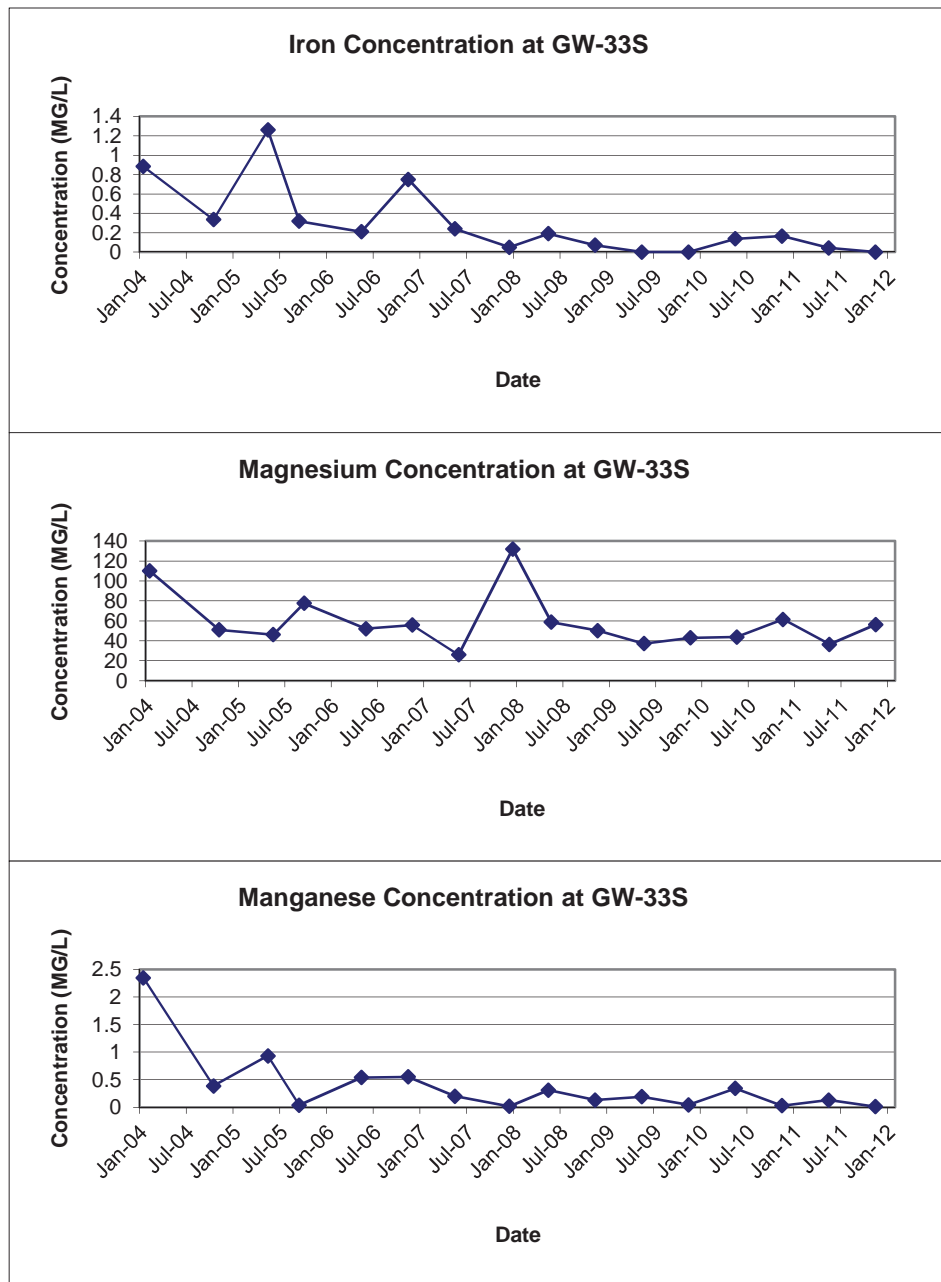


FIGURE E-18
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-34S


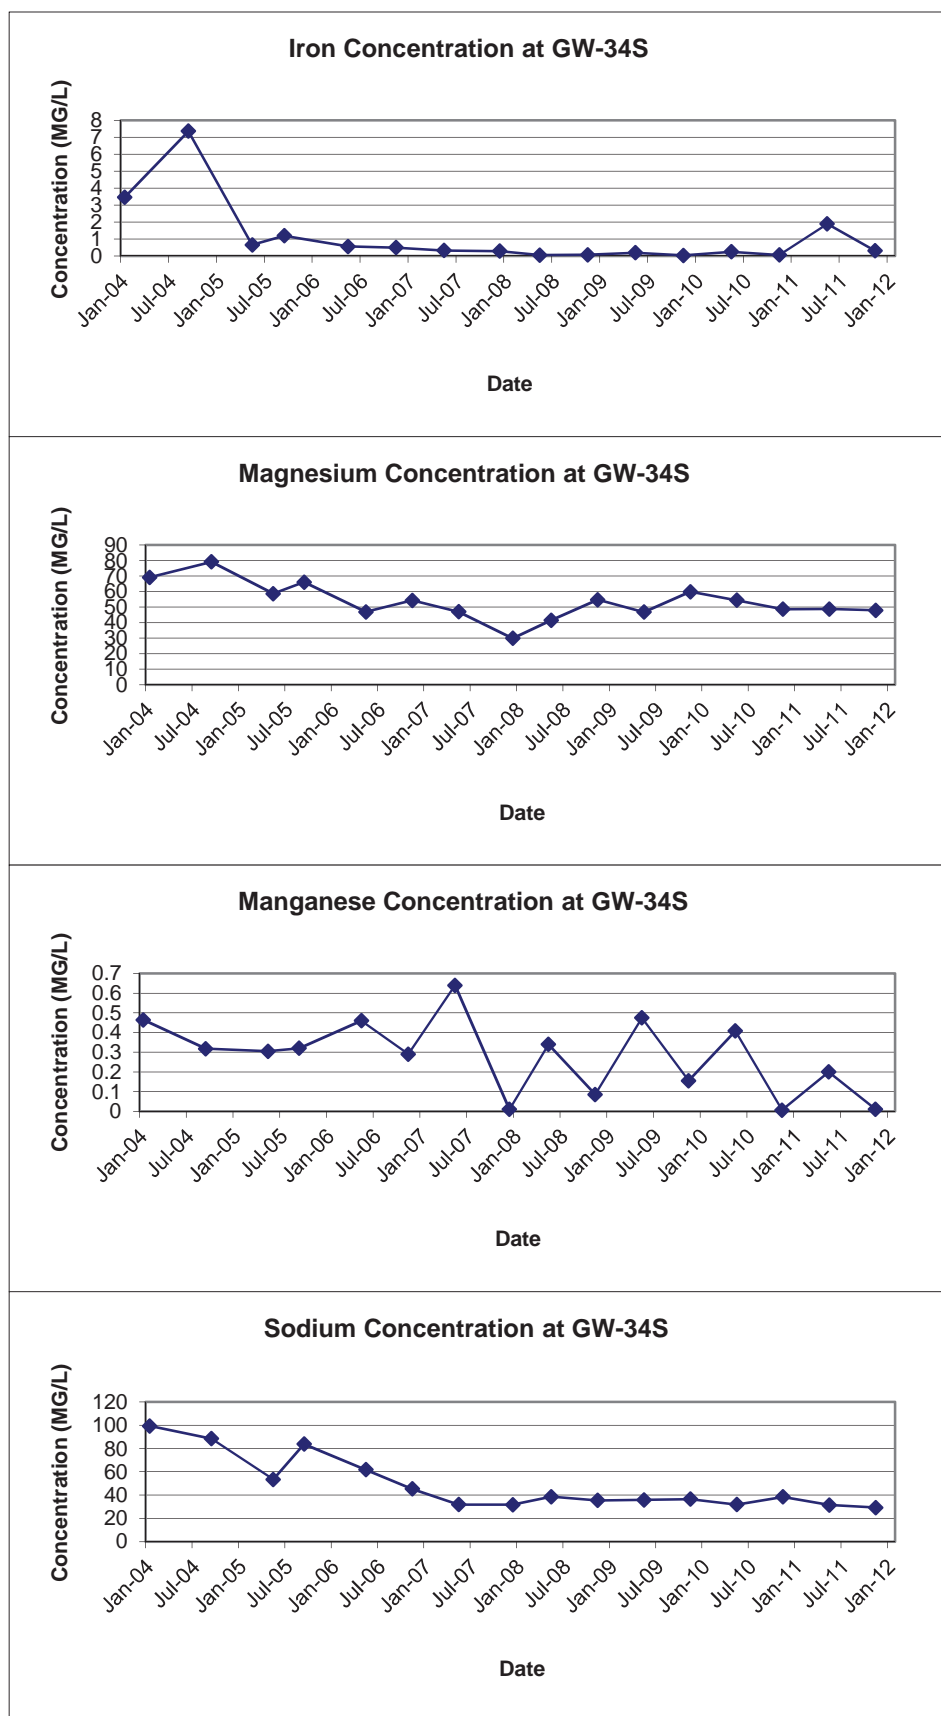


FIGURE E-19
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-35S

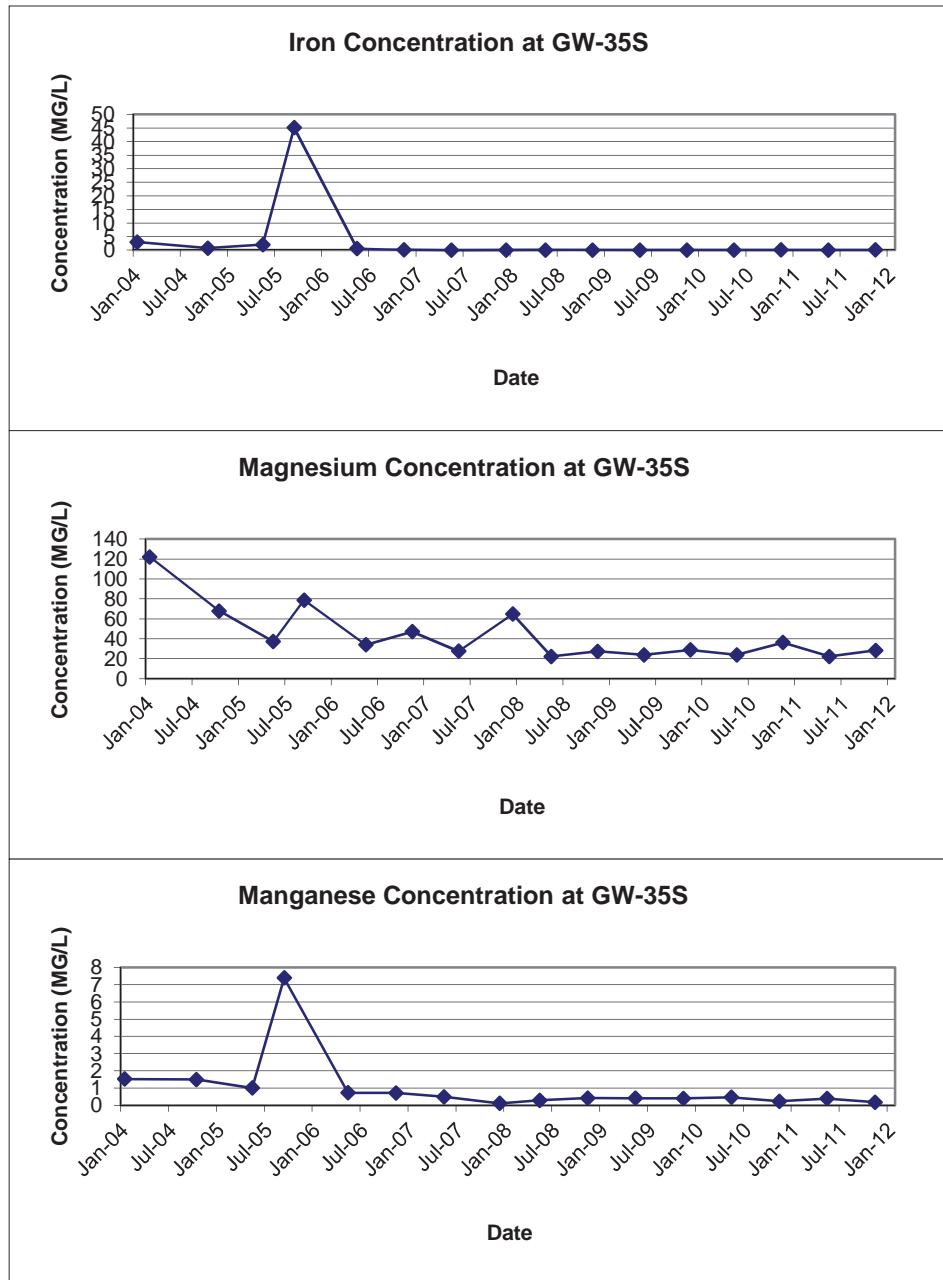

APPENDIX F

BSA PERMIT NO. 10-11-CH016

**AUTHORIZATION TO DISCHARGE UNDER THE BUFFALO
POLLUTANT DISCHARGE ELIMINATION SYSTEM**

PERMIT NO. 10-11-CH016

USEPA Category 40 CFR Part 403

In accordance with the provisions of the Federal Water Pollution Control Act, as amended, and the Sewer Regulations of the Buffalo Sewer Authority, authorization is hereby granted to:

THE TOWN OF CHEEKTOWAGA

to discharge wastewater from a facility located at:

PFOHL BROTHERS LANDFILL REMEDIATION SITE

1000 AERO DRIVE


CHEEKTOWAGA, NEW YORK 14225

The wastewater permitted herein shall be discharged to the Town of Cheektowaga sewer system, which is connected to the Buffalo Municipal Sewer System and Treatment facilities, and which wastewater will be treated at the Buffalo Sewer Authority's Treatment Plant.

Issuance of this permit is based upon a permit application filed on **November 3, 2005** analytical data. This permit is granted in accordance with discharge limitations, monitoring requirements and other conditions set forth in Parts I and II hereof.

Effective this 1st^{day} of November, 2010

To Expire the 31st day of March, 2013



General Manager

Signed this 30th day of September, 2010

PART I: SPECIFIC CONDITIONS

A. DISCHARGE LIMITATIONS & MONITORING REQUIREMENTS

During the period beginning the effective date of this Permit and lasting until the expiration date, discharge from the permitted facility outfall (see attached map) shall be limited and monitored quarterly by the permittee as specified below.

Sample Point	Parameter	Discharge Limitations ⁽¹⁾	Sampling Requirements	
		Daily Max	Period	Type
001	pH	5.0 – 12.0 S.U.	1 day	Composite ²
	Total Cadmium	1.17 lbs.	1 day	Composite ²
	Total Chromium	1.17 lbs.	1 day	Composite ²
	Total Copper	3.74 lbs.	1 day	Composite ²
	Total Lead	1.17 lbs.	1 day	Composite ²
	Total Nickel	3.27 lbs.	1 day	Composite ²
	Total Zinc	5.84 lbs.	1 day	Composite ²
	Total Barium	2.34 lbs.	1 day	Composite ²
	Total Suspended Solids ⁵	250 mg/l	1 day	Composite ²
	Total Flow	140,100 gallons ⁶	1 day	Discharge meter reading

Footnotes are explained on page 5.

PART I: SPECIFIC CONDITIONS**A. DISCHARGE LIMITATIONS & MONITORING REQUIREMENTS**

During the period beginning the effective date of this Permit and lasting until the expiration date, discharge from the permitted facility outfall (see attached map) shall be limited and monitored **once** by the permittee as specified below.

Sample Point	Parameter	Discharge Limitations ⁽¹⁾	Sampling Requirements	
		Daily Max	Period	Type
001	Total Mercury	0.001 lbs.	1 day	Composite ²
	USEPA Test Method 608 ⁴	To be monitored	1 day	Grab ³
	USEPA Test Method 624 ⁴	To be monitored	1 day	Grab ³
	USEPA Test Method 625 ⁴	To be monitored	1 day	Grab ³

Footnotes are explained on page 5.

PART I: SPECIFIC CONDITIONS

B. DISCHARGE MONITORING REPORTING REQUIREMENTS


During the period beginning the effective date of this permit and lasting until the expiration date, discharge monitoring results shall be summarized and reported **quarterly** by the permittee on the days specified below:

Sample Point	Parameter	Reporting Requirements	
		Initial Report	Subsequent Reports
001	All except USEPA Test Methods 608, 624, 625 & T Mercury	March 31, 2011	Every March 31 st , June 30 th , September 30 th and December 31 st
	USEPA Test Methods 608, 624 and 625 & T Mercury	March 31, 2011	

PART I: SPECIFIC CONDITIONS

C. SPECIAL REQUIREMENTS

1. Mass limits based on an average discharge of 140,100 gpd.
2. Composite samples may be time proportioned.
3. Four grab samples must be collected at equally spaced intervals throughout the sample day. The four (4) grab samples must be composited by a NYSDOH certified laboratory prior to analysis.
4. The permittee must report any compound whose concentration is equal to or greater than 0.01 mg/L. The permittee is not authorized to discharge any of the parameters evaluated by these test procedures which may cause or contribute to a violation of water quality standards or harm the sewerage system. Any parameter detected may, at the discretion of the BSA, be specifically limited and incorporated in this permit.
5. Surchargeable over 250 mg/L.
6. Flow is an action level only. If the permittee consistently exceeds this level, the BSA must be notified so that this permit can be modified.

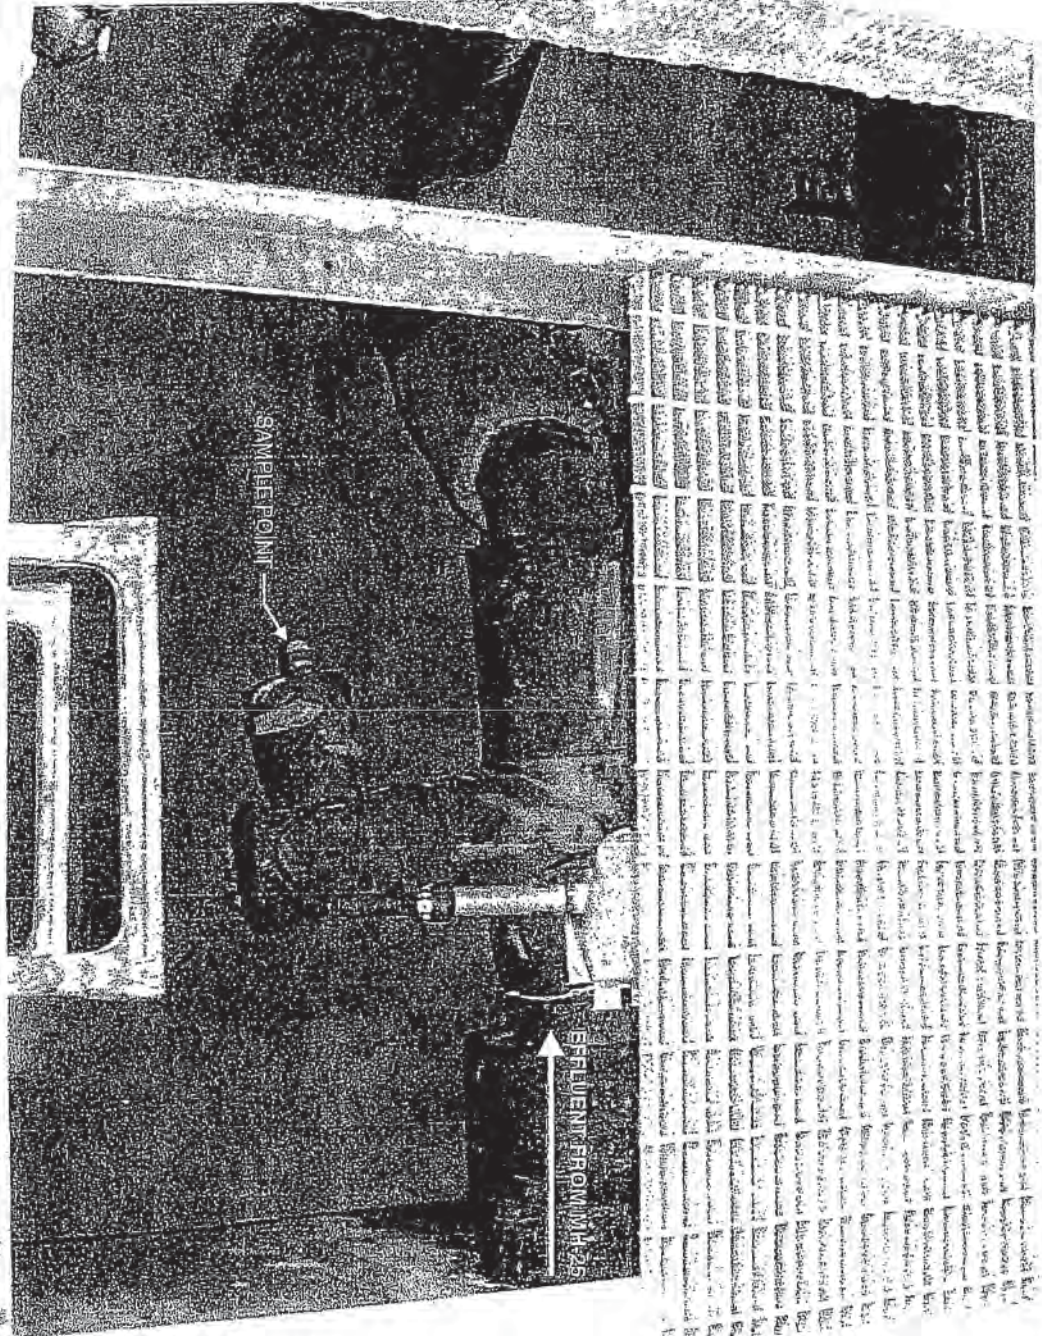

URS

PFOHL BROTHERS LANDFILL
EFFLUENT SAMPLE POINT

FIGURE 1

TOWN OF CHEEKTOWAGA/BUFFALO POLLUTANT DISCHARGE ELIMINATION SYSTEM
PERMIT

PART II GENERAL CONDITIONS

A. MONITORING AND REPORTING

1. Local Limits

Except as otherwise specified in this permit, the permit holder shall comply with all specific prohibitions, limits on pollutants or pollutant parameters set forth in the Buffalo Sewer Authority Sewer Use Regulations, as amended from time to time, and such prohibitions, limits and parameters shall be deemed pretreatment standards for purposes of the Clean Water Act

2. Definitions

Definitions of terms contained in this permit are as defined in the Town of Cheektowaga Local Law No. 2 and the Buffalo Sewer Authority Sewer Use Regulations.

3. Discharge Sampling Analysis

All Wastewater discharge samples and analyses and flow measurements shall be representative of the volume and character of the monitored discharge. Methods employed for flow measurements and sample collections and analyses shall conform to the Buffalo Sewer Authority "Sampling Measurement and Analytical Guidelines Sheet."

4. Recording of Results

For each measurement or sample taken pursuant to the requirements of the permit, the Permittee shall record the information as required in the "Sampling Measurement and Analytical Guidelines Sheet."

5. Additional Monitoring by Permittee

If the Permittee monitors any pollutants at the location(s) designated herein more frequently than required by this permit, using approved analytical methods as specified in 40 CFR Part 136 the results of such monitoring shall be included in the calculation and reporting of values required under Part I, B. Such increased frequency shall also be indicated.

6. Reporting

All reports prepared in accordance with this Permit shall be submitted to:

Mr. William Pugh, P.E.
Town Engineer
275 Alexander Ave.
Cheektowaga, New York, 14211

All self-monitoring reports shall be prepared in accordance with the BSA "Sampling Measurement and Analytical Guidelines Sheet." These reporting requirements shall not relieve the Permittee of any other reports, which may be required by the

N.Y.S.D.E.C. or the U.S.E.P.A.

B. PERMITTEE REQUIREMENTS

1. Change in Discharge

All discharges authorized herein shall be consistent with the terms and conditions of this permit and with the information contained in the TC/BPDES Permit Application on which basis this permit is granted. In the event of any facility expansions, production increases, process modifications or the installation, modification or repair of any pretreatment equipment which may result in new, different or increased discharges of pollutants, a new TC/BPDES Permit Application must be submitted prior to any change. Following receipt of an amended application, the BSA may modify this permit to specify and limit any pollutants not previously limited. In the event that the proposed change will be covered under an applicable Categorical Standard, a Baseline Monitoring Report must be submitted at least ninety (90) days prior to any discharge.

2. Records Retention

All records and information resulting from the monitoring activities required by this permit including all records of analyses performed, calibration and maintenance of instrumentation, and recordings from continuous monitoring instrumentation shall be retained at this facility for a minimum of three (3) years, or longer if requested by the General Manager and/or Town Engineer.

3. Notification of Slug, Accidental Discharge or Spill

In the event that a slug, accidental discharge or any spill occurs at the facility for which this permit is issued, it is the responsibility of the Permittee to immediately notify the B.S.A. Treatment Plant at 883-1820 of the quantity and character of such discharge. If requested by the B.S.A., within five (5) days following all such discharges, the Permittee shall submit a report describing the character and duration of the discharge, the cause of the discharge, and measures taken or that will be taken to prevent a recurrence of such discharge.

4. Noncompliance Notification

If, for any reason, the Permittee does not comply with or will be unable to comply with any discharge limitation specified in this permit, the Permittee or their assigns must verbally notify the Industrial Waste Section at 883-1820 within twenty-four (24) hours of becoming aware of the violation. The Permittee shall provide the Industrial Waste Section with the following information, in writing, within five (5) days of becoming aware of such condition:

- a. a description of the discharge and cause of noncompliance and;
- b. the period of noncompliance, including exact dates and times; or, if not corrected, the anticipated time the noncompliance is expected to continue, and steps being taken to reduce, eliminate and prevent recurrence of the noncomplying discharge.

5. Adverse Impact

The Permittee shall take all reasonable steps to minimize any adverse impact to the Buffalo and Town Sewerage System resulting from noncompliance with any discharge limitations specified in this permit, including such accelerated or additional monitoring as necessary to determine the nature and impact of the noncomplying discharge.

6. Waste Residuals

Solids, sludges, filter backwash or other pollutants removed in the course of treatment or control of wastewaters and/or the treatment of intake waters, shall be disposed of in a manner such as to prevent any pollutant from such materials from entering the Buffalo or Town Sewer System.

7. Power Failures

In order to maintain compliance with the discharge limitations and prohibitions of this permit, the Permittee shall provide an alternative power source sufficient to operate the wastewater control facilities; or, if such alternative power source is not provided the Permittee shall halt, reduce or otherwise control production and/or controlled discharges upon the loss of power to the wastewater control facilities.

8. Treatment Upsets

- a. Any industrial user which experiences an upset in operations that places it in a temporary state of noncompliance, which is not the result of operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation, shall inform the Industrial Waste Section immediately upon becoming aware of the upset. Where such information is given verbally, a written report shall be filed by the user within five (5) days. The report shall contain:
 - (i) A description of the upset, its cause(s) and impact on the discharger's compliance status.
 - (ii) The duration of noncompliance, including exact dates and times of noncompliance, and if the noncompliance is continuing, the time by which compliance is reasonably expected to be restored
 - (iii) All steps taken or planned to reduce, eliminate, and prevent recurrence of such an upset.
- b. An industrial user which complies with the notification provisions of this Section in a timely manner shall have an affirmative defense to any enforcement action brought by the Industrial Waste Section/Town Engineer for any noncompliance of the limits in this permit, which arises out of violations attributable to and alleged to have occurred during the period of the documented and verified upset.

9. Treatment Bypasses

- a. A bypass of the treatment system is prohibited unless the following conditions are met:
 - (i) The bypass was unavoidable to prevent loss of life, personal injury, or severe property damage; or
 - (ii) There was no feasible alternative to the bypass, including the use of auxiliary treatment or retention of the wastewater; and
 - (iii) The industrial user properly notified the Industrial Waste Section as described in paragraph b. below.
- b. Industrial users must provide immediate notice to the Industrial Waste Section upon delivery of an unanticipated bypass. If necessary, the Industrial Waste Section may require the industrial user to submit a written report explaining the cause(s), nature, and duration of the bypass, and the steps being taken to prevent its recurrence.
- c. An industrial user may allow a bypass to occur which does not cause pretreatment standards or requirements to be violated, but only if it is for essential maintenance to ensure efficient operation of the treatment system. Industrial users anticipating a bypass must submit notice to the Industrial Waste Section at least ten (10) days in advance. The Industrial Waste Section may only approve the anticipated bypass if the circumstances satisfy those set forth in paragraph a. above.

C. PERMITTEE RESPONSIBILITIES

1. Permit Availability

The originally signed permit must be available upon request at all times for review at the address stated on the first page of this permit.

2. Inspections

The Permittee shall allow the representatives of the Buffalo Sewer Authority or Town of Cheektowaga upon the presentation of credentials and during normal working hours or at any other reasonable times, to have access to and copy any records required in this permit; and to sample any discharge of pollutants.

3. Transfer of Ownership or Control

In the event of any change in control or ownership of facilities for which this permit has been issued the permit shall become null and void. The succeeding owner shall submit a completed Town of Cheektowaga/ Buffalo Sewer Authority permit application prior to discharge to the sewer system.

D. PERMITTEE LIABILITIES

1. Permit Modification

After notice and opportunity for a hearing, this permit may be modified, suspended, or revoked in whole or in part during its term for cause including, but not limited to the following:

- a. Violation of any terms or conditions of this permit,
- b. Obtaining this permit by misrepresentation or failure to disclose fully all relevant facts,
- c. A change in any condition that requires either a temporary or permanent reduction or elimination of the authorized discharge.

2. Imminent Danger

In the event there exists an imminent danger to health or property, the permitter reserves the right to take immediate action to halt the permitted discharge to the sewerage works.

3. Civil and Criminal Liability

Nothing in this permit shall relieve the Permittee from any requirements, liabilities, or penalties under provisions of the Town of Cheektowaga Local Law No. 2, the "Sewer Regulations of the Buffalo Sewer Authority" or any Federal, State and/or local laws or regulations.

4. Penalties for Violations of Permit Conditions

The "Sewer Regulations of the Buffalo Sewer Authority" and Town of Cheektowaga Local Law No. 2, provide that any person who violates a B.P.D.E.S. permit condition is liable to the Authority and/or the Town for a civil penalty of up to \$10,000 per day for each violation. Any person who willfully or negligently violates permit conditions will be referred to the New York State Attorney General.

E. NATIONAL PRETREATMENT STANDARDS

If a pretreatment standard or prohibition (including any Schedule of Compliance specified in such pretreatment standard or prohibition) is established under Section 307 (b) of the Act for a pollutant which is present in the discharge and such standard or prohibition is more stringent than any limitation for such pollutant in this permit, this permit shall be revised or modified in accordance with such pretreatment standard or prohibition.

F. PLANT CLOSURE

In the event of plant closure, the Permittee is required to notify the Industrial Waste Section/Town Engineer in writing as soon as an anticipated closure date is determined, but in no case later than five (5) days of the actual closure.

G. CONFIDENTIALITY

Except for data determined to be confidential under Section 308 of the Act, all reports prepared in accordance with the terms of this permit shall be available for public inspection at the offices of the Buffalo Sewer Authority or Town Engineer of the Town of Cheektowaga. As required by the Act, effluent data shall not be considered confidential. Knowingly making any false statement on any such report may result in the imposition of criminal penalties as provided for in Section 309 of the Act.

H. SEVERABILITY

The provisions of this permit are severable, and if any provision of this permit, or the application of any provision of this permit to any circumstance, is held invalid, the application of such provision to other circumstances, and the remainder of this permit, shall not be affected thereby.

APPENDIX G

DISCHARGE REPORT SUMMARY TABLES

TABLE 1

**PFOHL BROTHERS LANDFILL - EFFLUENT MONITORING
ANALYTICAL RESULTS, TOTAL FLOW, AND MASS LOADINGS
SEPTEMBER 2011**

Sample ID	EFF-092711			
Matrix	Effluent Water			
Date Sampled	9/27/2011			
Parameter	Result	Mass Loading	Discharge Limitation	Violations
	(mg/L)	(lbs/day)	(lbs/day)	(Y/N)
Total Barium	0.52	0.06	2.34	No
Total Cadmuim	0.00038	0.00004	1.17	No
Total Chromium	0.0019	0.0002	1.17	No
Total Copper	0.0099	0.001	3.74	No
Total Lead	0.0048	0.001	1.17	No
Total Nickel	0.0042	0.0005	3.27	No
Total Zinc	0.078	0.01	5.84	No
Total Suspended Solids	68.8	NA ⁽¹⁾	250 ⁽²⁾	No
pH ⁽³⁾	7.2	NA	5.0 - 12.0	No
Total Flow ⁽⁴⁾		13,455	140,000	No

Notes:

- (1) NA = Not Applicable
 (2) Discharge Limitation in units of mg/L
 (3) pH measurement and Discharge Limitation in Standard Units
 (4) Total Flow reported in gallons, sample was collected over a 24 hour period

$$\text{Calculation: } \left(\frac{x \text{ mg}}{\text{L}} \right) \left(\frac{y \text{ gal}}{\text{day}} \right) \left(\frac{1 \text{ lb}}{453,600 \text{ mg}} \right) \left(\frac{3.785 \text{ L}}{\text{gal}} \right) = \frac{x \times y}{119,841} \frac{\text{lb}}{\text{day}}$$

SAMPLING FIELD SHEET



Client Name: Pfohl Brothers Landfill

Address: Aero Drive, Cheektowaga, NY

Contact: Bill Pugh, P.E. Phone: 716-897-7288

Installation:

Sample Point: SP-001

Sample Location: Meter Chamber - ball valve on 6" HDPE forcemain

Date: 9/26/11 Crew: R. Murphy, M. Kandefer, K. McGovern

Weather: 76° F, Partly Cloudy

Sampling Device: NA

Time of Installation: 9:45 Type of Sample: Composite

Sample Interval: NA Sample Volume: NA

Comments and Observations: No wells were running at the time of sample setup.

PLC display volumes: WW-01 (444,233 gals), WW-02 (-603 gals), WW-03 (158,760 gals),

WW-04 (13,190 gals), WW-05 (897,351 gals), WW-06 (207,887 gals) & MH-25 (1,792,604 gals).

Date: 9/27/11 Crew: R. Murphy, T. Urban, M. Kandefer

Weather: 74° F, Light Rain

Time of Collection: 9:45

Field Measurements:

9:45/RJM
(time/initial)

pH Calibration: Buffer 7- 7 Buffer 4- 4 Buffer 10- 10

pH Measurement: 7.2

Temperature: 20.3°C

Identification: EFF-092711

Physical Observations: _____

Laboratory: TestAmerica, Buffalo, NY

Comments: Well WW-3 was running at the time of sample collection.

PLC display volumes: WW-01 (444,233 gals), WW-02 (-603 gals), WW-03 (158,919 gals),

WW-04 (13,190 gals), WW-05 (910,520 gals), WW-06 (207,986 gals) & MH-25 (1,806,059 gals).

Reviewed By: _____ Date: _____

(Supervisor)

TABLE 1

**PFOHL BROTHERS LANDFILL - EFFLUENT MONITORING
ANALYTICAL RESULTS, TOTAL FLOW, AND MASS LOADINGS
DECEMBER 2011**

Sample ID	EFF-122111			
Matrix	Effluent Water			
Date Sampled	12/21/2011			
Parameter	Result	Mass Loading	Discharge Limitation	Violations
	(mg/L)	(lbs/day)	(lbs/day)	(Y/N)
Total Barium	0.24	0.01	2.34	No
Total Cadmuim	0.00033	0.00001	1.17	No
Total Chromium	0.0014	0.0001	1.17	No
Total Copper	0.014	0.001	3.74	No
Total Lead	0.0038	0.000	1.17	No
Total Nickel	0.0048	0.0002	3.27	No
Total Zinc	0.034	0.001	5.84	No
Total Suspended Solids	46.8	NA ⁽¹⁾	250 ⁽²⁾	No
pH ⁽³⁾	7.9	NA	5.0 - 12.0	No
Total Flow ⁽⁴⁾		5,158	140,000	No

Notes:

- (1) NA = Not Applicable
 (2) Discharge Limitation in units of mg/L
 (3) pH measurement and Discharge Limitation in Standard Units
 (4) Total Flow reported in gallons, sample was collected over a 24 hour period

$$\text{Calculation: } \left(\frac{x \text{ mg}}{\text{L}} \right) \left(\frac{y \text{ gal}}{\text{day}} \right) \left(\frac{1 \text{ lb}}{453,600 \text{ mg}} \right) \left(\frac{3.785 \text{ L}}{\text{gal}} \right) = \frac{x \times y}{119,841} \frac{\text{lb}}{\text{day}}$$

SAMPLING FIELD SHEET



Client Name: Pfohl Brothers Landfill

Address: Aero Drive, Cheektowaga, NY

Contact: Bill Pugh, P.E. Phone: 716-897-7288

Installation:

Sample Point: SP-001

Sample Location: Meter Chamber - ball valve on 6" HDPE forcemain

Date: 12/20/11 Crew: R. Murphy, T. Ifkovich, T. Urban

Weather: 40° F, Cloudy

Sampling Device: NA

Time of Installation: 15:30 Type of Sample: Composite

Sample Interval: NA Sample Volume: NA

Comments and Observations: No wells were running at the time of sample setup.

PLC display volumes: WW-01 (893,916 gals), WW-02 (-1,412 gals), WW-03 (353,631 gals),

WW-04 (157,274 gals), WW-05 (2,282,586 gals), WW-06 (2,768,665 gals) & MH-25 (6,527,899 gals).

Date: 10/21/11 Crew: R. Murphy, S. Moeller, T. Urban

Weather: 50° F, Light Rain

Time of Collection: 15:45

Field Measurements:

15:45/RJM pH Calibration: Buffer 7- 7 Buffer 4- 4 Buffer 10- 10
(time/initial)

pH Measurement: 7.9

Temperature: 13.3°C

Identification: EFF-122111

Physical Observations: _____

Laboratory: TestAmerica, Buffalo, NY

Comments: No wells were running at the time of sample collection.

PLC display volumes: WW-01 (893,916 gals), WW-02 (-1,412 gals), WW-03 (353,631 gals),

WW-04 (157,274 gals), WW-05 (2,287,754 gals), WW-06 (2,768,665 gals) & MH-25 (6,533,057 gals).

Reviewed By: _____ Date: _____

(Supervisor)

APPENDIX H

MONITORING WELL INSPECTION LOGS

WELL INSPECTION SUMMARY

Project Name: Pfohl Brothers Landfill

Project Number: 11175616.00000

Inspection Crew Members: R. Murphy, T. Urban

Supervisor: J. Sundquist

Date(s) of Inspection: November 1, 2011

Well I.D. Number	Lock	Surface Seal	Protective Casing	Riser	Water Level (ft. BTOC)	Well Depth (ft. BTOC)	Other Comments
GW-1S	OK	OK	OK	Bulged	3.70	14.94	
GW-1D	OK	OK	OK	Bulged	2.69	39.65	
GW-3S	OK	OK	OK	OK	6.27	13.22	
GW-3D	OK	OK	OK	OK	2.19	35.70	
GW-4S	OK	OK	OK	OK	4.81	16.23	
GW-4D	OK	OK	OK	OK	13.50	45.57	
GW-7S	OK	OK	OK	OK	4.57	35.04	
GW-7D	OK	OK	OK	Damaged	45.26	60.45	

Additional Comments:

WELL INSPECTION SUMMARY

Project Name: Pfohl Brothers Landfill

Project Number: 11175616.00000

Inspection Crew Members: R. Murphy, T. Urban

Supervisor: J. Sundquist

Date(s) of Inspection: November 1, 2011

Well I.D. Number	Lock	Surface Seal	Protective Casing	Riser	Water Level (ft. BTOC)	Well Depth (ft. BTOC)	Other Comments
GW-8SR	OK	OK	OK	OK	5.27	13.02	
GW-8D	OK	OK	OK	OK	6.15	36.54	
GW-26D	OK	OK	OK	OK	7.02	40.70	
GW-28S	OK	OK	OK	OK	8.64	15.52	
GW-29S	OK	OK	OK	OK	7.42	20.04	
GW-30S	OK	OK	OK	OK	8.04	17.97	
GW-31S	OK	OK	OK	OK	2.62	9.57	
GW-32S	OK	OK	OK	OK	2.64	9.93	

Additional Comments:

WELL INSPECTION SUMMARY

Project Name: Pfohl Brothers Landfill

Project Number: 11175616.00000

Inspection Crew Members: R. Murphy, T. Urban

Supervisor: J. Sundquist

Date(s) of Inspection: November 1, 2011

<i>Well I.D. Number</i>	<i>Lock</i>	<i>Surface Seal</i>	<i>Protective Casing</i>	<i>Riser</i>	<i>Water Level (ft. BTOC)</i>	<i>Well Depth (ft. BTOC)</i>	<i>Other Comments</i>
GW-33S	OK	OK	OK	OK	4.06	8.21	
GW-34S	OK	OK	OK	OK	2.91	10.01	
GW-35S	OK	OK	OK	OK	3.20	7.46	

Additional Comments:

GROUNDWATER SAMPLING - SAMPLE COLLECTION DATA SHEET

Project Name: Pfohl Brothers

Project Number: 11175616.00000

Sampling Crew Members: R. Murphy, T. Urban

Supervisor: J. Sundquist

Date of Sampling: November 1, 2011

Sample I.D. Number	Well Number	Well Volume (liters)	Volume Purged (liters)	Sample Time	Sample Description	Analysis Required	Chain-of-Custody Number
GW-7D	GW-7D		PDB	10:25	Groundwater	VOCs	Not Applicable
GW-7S	GW-7S		PDB	11:40	Groundwater		Not Applicable
GW-3S	GW-3S			12:40	Groundwater	VOCs/SVOCs/ Metals	Not Applicable
GW-3D	GW-3D			14:05	Groundwater		Not Applicable
GW-3D-MS	GW-3D			14:05	Matrix Spike		Not Applicable
GW-3D-MSD	GW-3D			14:05	Matrix Spike Duplicate		Not Applicable
GW-8D	GW-8D			15:30	Groundwater		Not Applicable

Additional Comments: GW-7D and GW-7S were sampled for VOCs using passive diffusion bags (PDBs).
GW-7D and GW-7S were purged dry following collection of the VOC samples.
All other wells were purged using low flow methods until parameter stabilization.

GROUNDWATER SAMPLING - SAMPLE COLLECTION DATA SHEET

Project Name: Pfohl Brothers

Project Number: 11175616.00000

Sampling Crew Members: R. Murphy, T. Urban

Supervisor: J. Sundquist

Date of Sampling: November 1, 2010

Sample I.D. Number	Well Number	Well Volume (liters)	Volume Purged (liters)	Sample Time	Sample Description	Analysis Required	Chain-of-Custody Number
DUPLICATE	GW-8D			15:30	Blind Duplicate	VOCs/SVOCs/ Metals	Not Applicable
GW-8SR	GW-8SR			16:17	Groundwater		Not Applicable
TB-110111	---	---	---	---	Trip Blank	VOCs	Not Applicable

Additional Comments: All wells were purged using low flow methods until parameter stabilization.

GROUNDWATER SAMPLING - SAMPLE COLLECTION DATA SHEET

Project Name: Pfohl Brothers

Project Number: 11175616.00000

Sampling Crew Members: R. Murphy, T. Urban

Supervisor: J. Sundquist

Date of Sampling: November 2, 2011

Sample I.D. Number	Well Number	Well Volume (liters)	Volume Purged (liters)	Sample Time	Sample Description	Analysis Required	Chain-of-Custody Number
GW-34S	GW-34S			8:28	Groundwater	VOCs/SVOCs/ Metals	Not Applicable
GW-4S	GW-4S			9:05 & 10:50	Groundwater		Not Applicable
GW-4D	GW-4D			10:41	Groundwater		Not Applicable
GW-28S	GW-28S			11:59	Groundwater		Not Applicable
GW-26D	GW-26D			13:03	Groundwater		Not Applicable
GW-35S	GW-35S			13:48	Groundwater		Not Applicable
GW-29S	GW-29S			14:50	Groundwater		Not Applicable

Additional Comments: GW-4S was sampled for VOCs using a passive diffusion bag and then purged dry/allowed to recharge for collection of other parameters
All other wells were purged using low flow methods until parameter stabilization.

GROUNDWATER SAMPLING - SAMPLE COLLECTION DATA SHEET

Project Name: Pfohl Brothers

Project Number: 11175616.00000

Sampling Crew Members: R. Murphy, T. Urban

Supervisor: J. Sundquist

Date of Sampling: May 17, 2011

Sample I.D. Number	Well Number	Well Volume (liters)	Volume Purged (liters)	Sample Time	Sample Description	Analysis Required	Chain-of-Custody Number
GW-7D	GW-7D			15:15	Groundwater	SVOCs/ Metals	Not Applicable
GW-7S	GW-7S			15:45	Groundwater		Not Applicable
TB-110211	---	---	---	---	Trip Blank	VOCs	Not Applicable

Additional Comments: GW-7D and GW-7S were sampled for SVOCs and Metals after recharging overnight.

GROUNDWATER SAMPLING - SAMPLE COLLECTION DATA SHEET

Project Name: Pfohl Brothers

Project Number: 11175616.00000

Sampling Crew Members: R. Murphy, T. Urban

Supervisor: J. Sundquist

Date of Sampling: May 18, 2011

Sample I.D. Number	Well Number	Well Volume (liters)	Volume Purged (liters)	Sample Time	Sample Description	Analysis Required	Chain-of-Custody Number
GW-30S	GW-30S			8:50	Groundwater	VOCs/SVOCs/ Metals	Not Applicable
GW-31S	GW-31S			9:47	Groundwater		Not Applicable
GW-32S	GW-32S			11:00	Groundwater		Not Applicable
GW-33S	GW-33S			12:00	Groundwater		Not Applicable
GW-1S	GW-1S			13:33	Groundwater		Not Applicable
GW-1D	GW-1D			15:10	Groundwater		Not Applicable
TB-110311	---	---	---	---	Trip Blank	VOCs	Not Applicable

Additional Comments: All wells were purged using low flow methods until parameter stabilization.

ATTACHMENT C

IC/EC CERTIFICATION



Enclosure 2
NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION
Site Management Periodic Review Report Notice
Institutional and Engineering Controls Certification Form



Site Details

Box 1

Site No. 915043

Site Name Pfohl Brothers Landfill

Site Address: Aero Drive and Transit Road **Zip Code:** 14225

City/Town: Cheektowaga

County: Erie

Site Acreage: 94.0

Reporting Period: February 12, 2011 to February 12, 2012

- | | YES | NO |
|--|-------------------------------------|-------------------------------------|
| 1. Is the information above correct? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| If NO, include handwritten above or on a separate sheet. | | |
| 2. Has some or all of the site property been sold, subdivided, merged, or undergone a tax map amendment during this Reporting Period? | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| 3. Has there been any change of use at the site during this Reporting Period (see 6NYCRR 375-1.11(d))? | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| 4. Have any federal, state, and/or local permits (e.g., building, discharge) been issued for or at the property during this Reporting Period? | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| If you answered YES to questions 2 thru 4, include documentation or evidence that documentation has been previously submitted with this certification form. | | |
| 5. Is the site currently undergoing development? | <input type="checkbox"/> | <input checked="" type="checkbox"/> |

Box 2

- | | YES | NO |
|--|-------------------------------------|--------------------------|
| 6. Is the current site use consistent with the use(s) listed below?
Closed Landfill | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 7. Are all ICs/ECs in place and functioning as designed? | <input checked="" type="checkbox"/> | <input type="checkbox"/> |

**IF THE ANSWER TO EITHER QUESTION 6 OR 7 IS NO, sign and date below and
DO NOT COMPLETE THE REST OF THIS FORM. Otherwise continue.**

A Corrective Measures Work Plan must be submitted along with this form to address these issues.

Signature of Owner, Remedial Party or Designated Representative

Date

Description of Institutional Controls

<u>Parcel</u>	<u>Owner</u>	<u>Institutional Control</u>
82.03-4-9.11	Aero Land, Inc. c/o Jerome Hirsh	Building Use Restriction Ground Water Use Restriction Landuse Restriction
82.03-4-9.2	Aero Land, Inc. c/o Jerome Hirsh	Building Use Restriction Ground Water Use Restriction Landuse Restriction
82.03-4-10	Elizabeth L. McBride	Building Use Restriction Ground Water Use Restriction Landuse Restriction
82.03-4-5	Paul Pfohl	Building Use Restriction Ground Water Use Restriction Landuse Restriction
81.04-1-27	Paul Pfohl	Building Use Restriction Ground Water Use Restriction Landuse Restriction
81.04-1-28.1	Paul Pfohl	Building Use Restriction Ground Water Use Restriction Landuse Restriction
81.04-2-9.1	Paul Pfohl	Building Use Restriction Ground Water Use Restriction Landuse Restriction

81.04-2-10.1

Paul Pfohl

Building Use Restriction
Ground Water Use Restriction
Landuse Restriction

81.04-2-11

Paul Pfohl

Building Use Restriction
Ground Water Use Restriction
Landuse Restriction

82.03-4-11

Paul Pfohl

Building Use Restriction
Ground Water Use Restriction
Landuse Restriction

82.03-4-6

Paul Pfohl

Building Use Restriction
Ground Water Use Restriction
Landuse Restriction

82.03-4-8

Paul Pfohl

Building Use Restriction
Ground Water Use Restriction
Landuse Restriction

82.03-4-9.12

Stuart Jenkins

Building Use Restriction
Ground Water Use Restriction
Landuse Restriction

81.04-1-26

William A. Pfohl

Building Use Restriction
Ground Water Use Restriction
Landuse Restriction
Soil Management Plan
Surface Water Use Restriction

Box 4

Description of Engineering Controls

Parcel

Engineering Control

82.03-4-9.11

Cover System
Fencing/Access Control
Leachate Collection
Vapor Mitigation

82.03-4-9.2

Cover System
Fencing/Access Control
Leachate Collection
Vapor Mitigation

82.03-4-10

Cover System
Fencing/Access Control
Leachate Collection
Vapor Mitigation

82.03-4-5

Cover System
Fencing/Access Control
Leachate Collection
Vapor Mitigation

81.04-1-27

Cover System
Fencing/Access Control
Leachate Collection
Vapor Mitigation

81.04-1-28.1

Cover System
Fencing/Access Control
Leachate Collection
Vapor Mitigation

81.04-2-9.1

Cover System
Fencing/Access Control
Leachate Collection
Vapor Mitigation

81.04-2-10.1

Cover System
Fencing/Access Control
Leachate Collection
Vapor Mitigation

81.04-2-11

Cover System
Fencing/Access Control
Leachate Collection
Vapor Mitigation

82.03-4-11

<u>Parcel</u>	<u>Engineering Control</u>
	Cover System Fencing/Access Control Leachate Collection Vapor Mitigation
82.03-4-6	
	Cover System Fencing/Access Control Leachate Collection Vapor Mitigation
82.03-4-8	
	Cover System Fencing/Access Control Leachate Collection Vapor Mitigation
82.03-4-9.12	
	Cover System Fencing/Access Control Leachate Collection Vapor Mitigation
81.04-1-26	
	Cover System Fencing/Access Control Leachate Collection Vapor Mitigation

Engineering Control Details for Site No. 915043

Parcel: 81.04-1-26

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

Parcel: 81.04-1-27

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

Parcel: 81.04-1-28.1

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

Parcel: 81.04-2-10.1

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

Engineering Control Details for Site No. 915043

Parcel: 81.04-2-11

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

Parcel: 81.04-2-9.1

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

Parcel: 82.03-4-10

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

Parcel: 82.03-4-11

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

Parcel: 82.03-4-5

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

Parcel: 82.03-4-6

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

Parcel: 82.03-4-8

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

Engineering Control Details for Site No. 915043

Parcel: 82.03-4-9.11

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

Parcel: 82.03-4-9.12

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

Parcel: 82.03-4-9.2

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

Periodic Review Report (PRR) Certification Statements

1. I certify by checking "YES" below that:

a) the Periodic Review report and all attachments were prepared under the direction of, and reviewed by, the party making the certification;

b) to the best of my knowledge and belief, the work and conclusions described in this certification are in accordance with the requirements of the site remedial program, and generally accepted engineering practices; and the information presented is accurate and complete.

YES NO

☒ ☐

2. If this site has an IC/EC Plan (or equivalent as required in the Decision Document), for each Institutional or Engineering control listed in Boxes 3 and/or 4, I certify by checking "YES" below that all of the following statements are true:

(a) the Institutional Control and/or Engineering Control(s) employed at this site is unchanged since the date that the Control was put in-place, or was last approved by the Department;

(b) nothing has occurred that would impair the ability of such Control, to protect public health and the environment;

(c) access to the site will continue to be provided to the Department, to evaluate the remedy, including access to evaluate the continued maintenance of this Control;

(d) nothing has occurred that would constitute a violation or failure to comply with the Site Management Plan for this Control; and

(e) if a financial assurance mechanism is required by the oversight document for the site, the mechanism remains valid and sufficient for its intended purpose established in the document.

YES NO

☒ ☐

**IF THE ANSWER TO QUESTION 2 IS NO, sign and date below and
DO NOT COMPLETE THE REST OF THIS FORM. Otherwise continue.**

A Corrective Measures Work Plan must be submitted along with this form to address these issues.

Signature of Owner, Remedial Party or Designated Representative

Date

IC CERTIFICATIONS
SITE NO. 915043

Box 6

~~OWNER~~ **SITE O&M MANAGER**

~~SITE OWNER~~ OR DESIGNATED REPRESENTATIVE SIGNATURE

I certify that all information and statements in Boxes 1, 2, and 3 are true. I understand that a false statement made herein is punishable as a Class "A" misdemeanor, pursuant to Section 210.45 of the Penal Law.

I WILLIAM R. PUGH, P.E. at TOWN OF CHEEKTOWAGA ENGINEER
275 ALEXANDER AVE.
CHEEKTOWAGA N.Y. 14211
print name print business address

am certifying as SITE O&M MANAGER (~~Owner~~ or ~~Remedial~~ Party)

for the Site named in the Site Details Section of this form.

W-R. Pugh
~~Signature of Owner, Remedial Party, or Designated Representative~~
Rendering Certification SITE O&M MANAGER

2/14/12
Date

IC/EC CERTIFICATIONS

Box 7

Professional Engineer Signature

I certify that all information in Boxes 4 and 5 are true. I understand that a false statement made herein is punishable as a Class "A" misdemeanor, pursuant to Section 210.45 of the Penal Law.

I WILLIAM R. PUGH, P.E. at TOWN OF CHEEKTOWAGA ENGINEER
print name 275 ALEXANDER AVE.
CHEEKTOWAGA N.Y. 14211
print business address

am certifying as a Professional Engineer for the

TOWN OF CHEEKTOWAGA

(Owner or Remedial Party)



SITE

OF M PROVIDER/MANAGER

W-R. Pugh

Signature of Professional Engineer, for the Owner or Remedial Party, Rendering Certification

Stamp
(Required for PE)

2/14/12
Date

SITE OF M PROVIDER