


The electronic version of this file/report should have the file name:

Type of document . Site Number . Year-Month . File *Year-Year* or Report name . pdf

_____ . File _____ . pdf

example: *letter . Year-Month . File Year-Year . pdf*

Report . HW, 915043 . 2014-03-26 . PRR_and-IC-EC_CERT . pdf

example: *report . Site Number . Year-Month . Report Name . pdf*

Project Site numbers will be proceeded by the following:

Municipal Brownfields - B

Superfund - HW

Spills - SP

ERP - E

VCP - V

BCP - C



March 24, 2014

RECEIVED
NYSDEC - REGION 9

MAR 26 2014

☒ REL ☐ FOIL ☐ UNREL

Mr. David Szymanski
New York State Department of Environmental Conservation
270 Michigan Ave.
Buffalo, NY 14203

**Re: 2013 Periodic Review Report
Pfohl Brothers Landfill, Town of Cheektowaga, New York
Site 915043**

Dear Mr. Szymanski:

Enclosed is the 2013 Periodic Review Report for the Pfohl Brothers Landfill in Cheektowaga, New York. URS has prepared this report on the behalf of the Town of Cheektowaga in accordance with your correspondence to Mr. William Pugh, Town of Cheektowaga Engineer, received January 4, 2010.

If you have any questions on this report, please feel free to contact me.

Sincerely,

URS CORPORATION

Jon Sundquist, Ph.D.
Project Manager

Enclosures

cc: William Pugh, P.E. – Town of Cheektowaga (w/attachments)
File 11172700 (C-1)

**PERIODIC REVIEW REPORT
2013
PFOHL BROTHERS LANDFILL
CHEEKTOWAGA, NY**

Submitted to:

**NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION
270 MICHIGAN AVENUE
BUFFALO, NEW YORK 14203**

Prepared by:

**URS CORPORATION
77 GOODELL STREET
BUFFALO, NEW YORK 14203**

RECEIVED
NYSDEC - REGION 9

MAR 26 2014

FOIL
____REL____UNREL

Prepared for:

**TOWN OF CHEEKTOWAGA
ENGINEERING DEPARTMENT
275 ALEXANDER AVE
CHEEKTOWAGA, NEW YORK 14211**

MARCH 2014

TABLE OF CONTENTS

1.0	Introduction.....	1
1.1	Background	1
1.2	Effectiveness of Remedial Program	1
1.3	Compliance.....	1
1.4	Recommendations	2
2.0	Site Overview	2
2.1	Site Description	2
2.2	Chronology.....	2
3.0	Remedy Performance, Effectiveness and Protectiveness	2
3.1	Groundwater Monitoring.....	3
3.2	Surface Water/Sediment Sampling.....	4
3.3	Effluent Monitoring.....	4
3.4	Hydraulic Monitoring.....	4
3.5	Wetlands Monitoring.....	4
3.6	General Physical and Mechanical Maintenance.....	5
4.0	IC/EC Plan Compliance.....	5
4.1	Institutional Controls.....	5
4.2	Engineering Controls.....	5
5.0	Operation & Maintenance and Monitoring Plan Compliance	5
6.0	Conclusions and Recommendations	6

FIGURES

Figure 2-1 Site Plan

ATTACHMENTS

Attachment A January 2013 – June 2013 Semi Annual Report
Attachment B July 2013 – December 2013 Semi Annual Report
Attachment C IC/EC Certification

1.0 INTRODUCTION

1.1 Background

This Pfohl Brothers Landfill Site (No. 915043) is a 130 acre landfill located on the north and south sides of Aero Drive in the Town of Cheektowaga, Erie County. The site is located in a commercial area just west of Transit Road. The landfill was operated between 1940 and 1969 receiving household and industrial wastes. The industrial waste materials included paints, waste solvents, thinners, pine tar pitch, cellulose, rubber, scrap metal and phenolic tars. A Remedial Investigation and Feasibility Study was completed in 1991. The data showed that on-site soils, groundwater, seeps, and sediments were contaminated with Volatile and Semi-Volatile Organic Compounds, and metals at various concentrations. The data did not show any significant off-site impact. A Record of Decision (ROD) was issued in 1992 requiring the landfill to be consolidated and closed. A second ROD was issued in 1994 which removed the northern portion of the site (located immediately south of Interstate 90) from the site description. The ROD also stated that there will be no action in regard to off-site groundwater. The final remedial design for the site was completed in 2000. The remedial construction consisted of waste consolidation; capping of landfills on either side of Aero Drive; providing leachate collection around these areas; restoring wetlands; and fencing the landfill. Work commenced in 2001 and was completed in 2002. The consolidated landfill was reduced to 94 acres. Deed restrictions have been filed by the Potentially Responsible Parties (PRPs). The Operation, Maintenance and Monitoring (OM&M) Plan was approved in March 2006 and is being implemented by the Town of Cheektowaga.

1.2 Effectiveness of Remedial Program

During 2013, the capping and remedial action remedy continued to successfully prevent exposure of buried waste to human health or environmental receptors. Effectiveness has been demonstrated through maintenance of the landfill cap, effective hydraulic control of groundwater beneath the cap, and regular semi-annual groundwater sampling.

1.3 Compliance

The management of the site is in compliance with the OM&M Plan. Institutional controls in the form of deed restrictions remain in place.

1.4 Recommendations

No changes to the operation, maintenance, and monitoring of the site are recommended.

2.0 SITE OVERVIEW

2.1 Site Description

The boundaries of the site are shown on Figure 2-1. The site is located immediately southwest of the intersection of Interstate 90 and Transit Road in the Town of Cheektowaga. The site is bisected by the east/west Aero Drive. Each of the two portions of the landfill are covered with a cap comprising a gas venting layer, a low permeability synthetic membrane, and a barrier protection fill layer. Surrounding the entire site is a groundwater/leachate collection system consisting of a collection trench that drains into six wetwells. Leachate and groundwater collected in the wetwells is pumped via submersible pumps in the wetwells to a fifteen-inch sanitary sewer line on the south side of Aero Drive. This sanitary sewer, installed as part of the remedy, connects to the existing fifteen-inch sanitary sewer on Rein Road south of Aero Drive. The collected groundwater/leachate discharges to the sanitary sewer under a permit from the Buffalo Sewer Authority (BSA).

2.2 Chronology

The principal elements of the remedy were consolidation of waste materials, construction of a landfill cap and construction of a perimeter leachate collection system. Construction of the remedy was completed in 2002.

OM&M commenced in 2002 upon completion of construction. These efforts are performed in accordance with the OM&M plan issued as draft in 2002 and approved as final in 2006. Based upon the results of the first three years of surface water, sediment and monitoring results, the surface water/sediment sampling was discontinued in 2008, and the list of parameters evaluated during groundwater sampling was reduced in 2006 (limiting the list of VOC and SVOC parameters and metals) and 2007 (discontinuing dioxin and radionuclide analyses).

3.0 REMEDY PERFORMANCE, EFFECTIVENESS AND PROTECTIVENESS

The principal elements of the OM&M are:

- ▶ Groundwater Monitoring

- ▶ Surface Water/Sediment Sampling
- ▶ Effluent Monitoring
- ▶ Hydraulic Monitoring
- ▶ Wetlands Monitoring
- ▶ General physical and mechanical maintenance.

The Town of Cheektowaga submits OM&M reports to NYSDEC twice per year reporting on the performance, effectiveness, and protectiveness of each of these elements. The two reports covering the calendar year of 2013 are attached to this Periodic Review Report. A summary of the findings of performance, effectiveness, and protectiveness for 2013 is presented in the sections below.

3.1 Groundwater Monitoring

As the OM&M contractor for the Town of Cheektowaga, URS Corporation (URS) has performed twenty rounds of semi-annual groundwater sampling. The most recent sampling was conducted in May and November 2013. Results of this sampling continue to show no impacts to groundwater from the landfill. In brief, no VOCs were detected above Class GA water quality standards except vinyl chloride at location GW-30S in May 2013. This is the second time vinyl chloride has been detected in this well since O&M sampling began in 2004. The first time it was detected was in May 2012. No SVOCs were detected at concentrations above the Class GA water quality standards at any location during either sampling event.

Among the metals, iron, magnesium, manganese, and sodium routinely exceed Class GA standards in most site wells. Chromium and nickel were detected at concentrations exceeding their Class A standards at well GW-03S. Antimony, chromium, lead, and nickel were detected at concentrations exceeding Class GA standards in well GW-07D. It is noted that GW-07D is located upgradient of the site. Arsenic was detected at a concentration exceeding its Class GA standard at well GW-29S in the first sampling event. No significant changes in metals concentrations were observed when compared to previous sampling event analytical results and were within the historical range of concentrations observed for these compounds at these wells. The attached semi-annual reports present the data from this sampling in tables, graphs, and charts.

3.2 Surface Water/Sediment Sampling

Surface water and sediment sampling was discontinued in 2008 after three years of sampling showed that no site-related contaminants were present in these media. This sampling was eliminated in accordance with the approved OM&M plan and as approved by NYSDEC.

3.3 Effluent Monitoring

URS performed effluent monitoring on a quarterly basis during 2013. The results of the sampling are reported in the attached semi-annual reports. The parameter values in the effluent have always been well below the discharge criteria for all quarterly sampling events conducted since the start of the OM&M.

3.4 Hydraulic Monitoring

URS performed hydraulic monitoring on a quarterly basis during 2013. Hydraulic monitoring is performed through measuring the water elevation in each of the six wetwells and in nine manholes associated with the perimeter collection system, and comparing each of these elevations with the groundwater elevations in paired monitoring wells adjacent to each wetwell or manhole. Hydraulic control is demonstrated by an inward hydraulic gradient from the monitoring wells to the collection system. The hydraulic gradient has been towards the groundwater collection system for every quarterly measurement taken during 2013 with the exception of the water elevation in WW-6 was slightly higher (0.07') than the nearest monitoring well GW-34S on September 10, 2013.

3.5 Wetlands Monitoring

The monitoring of wetlands mitigation has not gone as originally planned in the OM&M manual. Initially, the wetlands species planted for mitigation faired poorly due to trampling from geese and deer. Fences were erected in 2004 to keep this wildlife out. Some wetland vegetation was also lost during landfill cap mowing in 2005 when the mowing contractor mowed a greater area than had been specified. The wetland vegetation species were replanted in 2005. However, in the time since construction ended in 2002, the *Phragmites sp.* vegetation that is quite abundant in this area has spread and established itself throughout the areas formerly disturbed during construction. *Phragmites sp.* does not provide robust food source for wildlife, but does act to stabilize soil in the interface zone between the landfill and the existing pond and wetland.

3.6 General Physical and Mechanical Maintenance

The Town of Cheektowaga performs the necessary general physical and mechanical maintenance as needed. Example maintenance items are routine maintenance and replacement of pumps and instrumentation used for groundwater/leachate collection, annual cap mowing, snow plowing, etc. A summary of the general maintenance activities performed during 2013 is provided in the attached semi-annual reports.

4.0 IC/EC PLAN COMPLIANCE

There is no formal Institutional Control/Engineering Control (IC/EC) plan for this site. However, there are institutional and engineering controls in place and they are functioning as intended. These are discussed below.

4.1 Institutional Controls

Institutional controls (ICs) consist of restrictions on land use for the various parcels that comprise this site. The parcels subject and their restrictions are listed on the attached Site Management Periodic Review Report Notice Institutional and Engineering Controls Certification Form. The restrictions address building use, groundwater use, and land use. Compliance with these ICs is evaluated by observation to see if any infringing activities are occurring on these parcels. These ICs remain in effect, as certified in Attachment C.

4.2 Engineering Controls

Engineering controls (ECs) consist of the landfill cap, fencing and access control, collection of the groundwater/leachate, and vapor mitigation. Compliance with these ECs is evaluated at a minimum through inspection of these elements during each semi-annual monitoring event. In most cases, inspection is more frequent. For example, collection of the groundwater/leachate is monitored continuously by Town of Cheektowaga personnel and effluent compliance reports are submitted quarterly. These ECs remain in effect, as certified in Attachment C.

5.0 OPERATION & MAINTENANCE AND MONITORING PLAN COMPLIANCE

The components of the OM&M Plan are discussed above in Section 3.0. Summaries of OM&M activities performed during 2013 are provided in the attached semi-annual reports. The

OM&M activities show that the landfill and its groundwater/leachate collection system are operating as intended, and receive repairs and maintenance as needed in a timely fashion. Sampling of the groundwater in monitoring wells and the effluent generated by the groundwater/leachate collection system show that no landfill contamination is migrating to these media, and therefore the wastes remain effectively contained. No changes to the OM&M for this site are recommended.

6.0 CONCLUSIONS AND RECOMMENDATIONS

The remedy at the Pfohl Brothers Site Landfill is operating as designed and remains protective of human health and the environment. No changes to the OM&M for this site are recommended.

FIGURES



Legend

- * Monitoring Well Location
- T Staff Gauge Location
- S Manhole Location
- W Wet Well Location
- Site Boundary

PFOHL BROTHERS LANDFILL
SITE BOUNDARY AND MONITORING LOCATIONS

URS

FIGURE 2-1

ATTACHMENTS

ATTACHMENT A

January 2013 – June 2013

Semi Annual Report

**SEMI ANNUAL REPORT
OPERATION AND MAINTENANCE
JANUARY 2013 TO JUNE 2013
PFOHL BROTHERS LANDFILL
CHEEKTOWAGA, NY**

Submitted to:

**NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION
270 MICHIGAN AVENUE
BUFFALO, NEW YORK 14203**

Prepared by:

**URS CORPORATION
77 GOODELL STREET
BUFFALO, NEW YORK 14203**

Prepared for:

**TOWN OF CHEEKTOWAGA
ENGINEERING DEPARTMENT
275 ALEXANDER AVE
CHEEKTOWAGA, NEW YORK 14211**

FEBRUARY

2014



February 12, 2014

Mr. Jaspal Singh Walia, P.E.
New York State Department of Environmental Conservation
270 Michigan Ave.
Buffalo, NY 14203

**Re: Semi-Annual Report
 Pfohl Brothers Landfill, Town of Cheektowaga, New York**

Dear Mr. Walia:

Enclosed is one copy of the nineteenth Semi-Annual Report for the Pfohl Brothers Landfill in Cheektowaga, New York. A copy has also been sent to Ms. Pamela Tames, P.E. of the United States Environmental Protection Agency. Also enclosed is the Data Applicability Report for laboratory analyses associated with the Semi-Annual Report. PDF copies of the reports are also enclosed.

If you have any questions on this report, please feel free to contact me.

Sincerely,

URS CORPORATION

Jon Sundquist, Ph.D.
Project Manager

Enclosures

cc: Pamela Tames, P.E. - USEPA (w/attachments)
 William Pugh, P.E. - Town of Cheektowaga (w/attachments)
 File 11172700 (C-1)

TABLE OF CONTENTS

	<u>Page No.</u>
1.0 INTRODUCTION	1-1
1.1 Background.....	1-1
1.2 Operation and Maintenance Activities.....	1-1
2.0 GENERAL MAINTENANCE ACTIVITIES.....	2-1
3.0 MONITORING ACTIVITIES	3-1
3.1 Groundwater Hydraulic Monitoring	3-1
3.2 Groundwater Quality Monitoring	3-1
3.3 Groundwater Discharge Monitoring.....	3-5
3.4 Monitoring Well Inspections	3-5
4.0 SUMMARY AND RECOMMENDATIONS.....	4-1

TABLES

Table 3-1	Groundwater Sample Analytical Results
Table 3-2	Approved Revision Of Table 3.2 From The O&M Plan

FIGURES

Figure 1-1	Site Location Map
Figure 3-1	Monitoring Locations

APPENDICES

Appendix A	Example Daily Inspection Sheets
Appendix B	Monthly Flow Summaries (January 2013 – June 2013)
Appendix C	Hydraulic Monitoring Tables
Appendix D	Groundwater Purge and Sample Collection Logs
Appendix E	Groundwater Trend Analysis
Appendix F	BSA Permit No. 13-04-CH016
Appendix G	Discharge Report Summary Tables
Appendix H	Monitoring Well Inspection Logs

1.0 INTRODUCTION

1.1 Background

The Pfohl Brothers Landfill is located on Aero Drive in the Town of Cheektowaga, New York (Figure 1-1). The site is listed as site No. 915043 on the New York State Department of Environmental Conservation's (NYSDEC's) Registry of Inactive Hazardous Waste Disposal Sites. A Consent Order between NYSDEC and potentially responsible parties (PRPs) for closure of the site was signed in 2001 and remedial construction commenced in 2001. The remedy included consolidation of waste material, capping of the waste disposal and consolidation areas, and encircling the landfill areas with a groundwater collection system to prevent off-site migration. The remedial action was completed in 2002.

Responsibility for implementing the remedy was divided between a "steering committee" of industrial PRPs and the Town of Cheektowaga. The steering committee responsibilities lay generally with the capital construction activities of the remedy including waste consolidation, cap and drainage system installation, etc. The Town of Cheektowaga, which was named as a PRP for disposal of municipal waste at the Pfohl Brothers Landfill when it was operating, is performing the operation and maintenance (O&M) activities at the landfill, pursuant to a settlement agreement between the Town and the steering committee.

1.2 Operation and Maintenance Activities

While construction of the remedy was substantially complete by late 2002, the final O&M manual was not approved by the NYSDEC until March 10, 2006. However, the Town of Cheektowaga and its consultant (URS Corporation – New York) assumed most of the operational responsibilities since 2002. This includes a variety of general maintenance activities as outlined in Section 2 and sampling and other monitoring activities outlined in Section 3.

Beginning in 2004, the Town and URS assumed all of the O&M activities described in the O&M plan. This report is the nineteenth semi-annual report as called for by Section 3.6 of the O&M plan.

2.0 GENERAL MAINTENANCE ACTIVITIES

Since completion of construction activities in 2002, personnel from the Town of Cheektowaga Engineering Department have performed general activities to ensure the physical operation of the landfill as intended by the design. The various O&M activities performed by the Town from January 2013 through June 2013 include the following actions.

- The amount of groundwater discharged through the collection system was recorded on a daily basis. The flow rate displayed by each wet well pump at the time of daily inspection and the total cumulative volume of flow was recorded for each wet well on daily inspection sheets. Examples of the daily inspection sheet are attached in Appendix A.
- Total cumulative effluent flow rates and volumes were summarized on a monthly basis starting in February 2003. The monthly totals for the period of January 2013 through June 2013, including graphs showing daily total discharge (gallons) as a function of calendar day, are presented in Appendix B.
- The wet well pumps were shutdown during wet weather flow conditions throughout the year to reduce hydraulic loading to the sewer. Such actions were only taken upon request of the Buffalo Sewer Authority during heavy storm events in order to reduce the hydraulic load on the BSA treatment system during such events. Shutdown events are recorded and included with the monthly flow data as previously requested by NYSDEC.
- Plowed snow to access the Control Building when necessary.
- Cleaned/replaced check valves as necessary at all wet wells.
- Replaced surge suppressors and fuses as needed for pump station instrumentation equipment.
- Engaged contractor to apply Roundup herbicide to control vegetation growth through the stone access road. Applied herbicide on both Area B and C (i.e., along the

perimeter access road around the landfill areas north and south of Aero Drive) in June 2013.

- Replaced defective level transmitter equipment at WW-3 (April 2013).
- Replaced discharge hose at WW-1 (June 2013).

3.0 MONITORING ACTIVITIES

The Town of Cheektowaga retained URS Corporation to perform monitoring activities as outlined in Section 3.1 of the O&M plan. During the period of January 2004 through the present, URS performed groundwater hydraulic monitoring (Section 3.1.1.2 of the O&M plan) and effluent monitoring (Section 3.1.4 of the O&M plan) on a quarterly basis. URS also performed the nineteenth semi-annual groundwater quality monitoring event (Section 3.1.1.3 of the O&M plan). A summary of the monitoring activities is presented in the following subsections. Hydraulic and groundwater sampling locations are shown on Figure 3-1.

3.1 Groundwater Hydraulic Monitoring

Groundwater and surface water elevations were monitored on a quarterly basis at all locations listed in Table 3.1 of the O&M Plan. The hydraulic monitoring data tables showing groundwater elevations are presented in Appendix C. Table 1 of this appendix lists the measured elevations. Table 2 provides a comparison of the measured levels in the wells and corresponding manholes/wet wells.

The data presented in Appendix C indicate that groundwater levels outside the collection system were higher than the levels measured in the corresponding wet well or manhole for each measurement date. Therefore, these data demonstrate that the collection system is operating as designed.

3.2 Groundwater Quality Monitoring

The nineteenth semi-annual round of groundwater sampling was conducted between May 8, 2013 and May 10, 2013. All wells listed in Table 3.2 of the O&M plan were purged and sampled using dedicated/disposable equipment. Figure 3-1 shows the well locations. Low flow sampling techniques were used at most monitoring well locations.

Passive diffusion bags (PDBs) were placed in three monitoring wells with low recharge rates (GW-4S, GW-7S, and GW-7D) on March 27, 2013. The PDBs were removed from the wells during the sampling event and their contents were analyzed for VOCs. Following removal of the PDBs the three wells were purged dry. These wells were sampled for the other required parameters after their water levels recovered.

Purge logs and sampling summary sheets are provided in Appendix D. Measurements of pH, specific conductivity, temperature, dissolved oxygen, oxidation reduction potential, and turbidity taken during purging are provided in Appendix D. The samples were packed with ice in coolers and transported under chain-of-custody (CoC) control to Test America Laboratories of Amherst, New York.

Table 3-1 of this report presents the groundwater sample results compared with NYSDEC Ambient Water Quality Standards and Guidance Values and Groundwater Effluent Limitations Class GA water quality standards. Groundwater samples were analyzed for the parameters listed in Table 3.2 of the O&M plan as revised in accordance with Table 3-6 in the Semi Annual Report dated September 2007 (January through June 2007) and as approved by the December 6, 2006 and November 29, 2007 correspondence from the NYSDEC authorizing a reduction in the parameters list (this table is included in this report as Table 3-2).

Results

The VOC vinyl chloride was detected in one sample (from GW-30S) at a concentration of 2.2 micrograms per liter ($\mu\text{g/L}$), slightly exceeding its Class GA water quality standard of 2.0 $\mu\text{g/L}$. This is the second time vinyl chloride has been detected in this well since sampling began in 2004. It was detected in May 2012 at a concentration of 5.3 $\mu\text{g/L}$. No SVOCs were detected at concentrations above the Class GA water quality standards at any location.

Among the metals, iron, magnesium, manganese, and sodium routinely exceed Class GA standards in most site wells. Nickel was detected at a concentration exceeding its Class A standard at well GW-03S. Antimony, chromium, lead, and nickel were detected at concentrations exceeding Class GA standards in well GW-07D. It is noted that GW-07D is located upgradient

of the site. Arsenic was detected at a concentration exceeding its Class GA standard at well GW-29S.

Comparison to Historical Results

No significant changes in metals concentrations were observed when compared to previous sampling event analytical results. The concentration of iron, magnesium, manganese, and sodium in most site wells was similar to the concentrations found during previous sampling events.

The concentrations of chromium and nickel at GW-03S, nickel at GW-07D, and lead at GW-07D were within the historical range of concentrations observed for these compounds at these wells. The concentration of chromium at GW-07D was the highest it has been since sampling began.

Sodium concentrations were generally higher in bedrock wells (GW-01D, GW-03D, GW-08D and GW-26D) and shallow wells adjacent to roads (GW-01S and GW-30S). The sodium concentration was also elevated in GW-08SR. The higher sodium concentrations in the bedrock wells may be attributed to the local bedrock composition and the elevated concentration in the shallow wells may be the result of seasonal road de-icing activities.

Trend Analysis

A trend analysis of groundwater parameters that routinely exceed Class GA groundwater standards was performed and is presented in Figures E-1 through E-19 of Appendix E. A review of the trend analysis indicated that no significant changes or trends in concentrations of any of the parameters exceeding groundwater standards have occurred over the nineteen semi-annual sampling events except as described below. Figure E-2 for GW-01S, indicates an upward trend in iron over the last four sampling events, a recent upward trend in manganese concentrations, and a downward trend in sodium concentration over the nineteen sampling events. Figure E-3 for GW-03D indicates seasonal variations and a slight downward trend for manganese over the last nine sample events. Figure E-4 indicates a slight upward trend for magnesium in GW-03S since

monitoring began. Figure E-5 for GW-04D, indicates a slight increasing trend for magnesium. Figure E-6 for GW-04S shows a slight upward trend for magnesium over the last 12 events. Figure E-7 for GW-07D shows an upward trend for chromium. Figure E-9 for GW-08D shows a decreasing trend for both iron and manganese since monitoring began. Figures E-10 and E-11 for GW-08SR and GW-26D, respectively, show an upward trend in sodium concentrations since monitoring began. Figure E-10 for GW-08SR also indicates an upward trend for manganese. Figures E-12 for GW-28S indicates a decreasing trend for sodium since monitoring began. Figure E-13 for GW-29S shows a slight increasing trend for magnesium over the last 16 events. Figure E-14 for GW-30S indicates a downward trend for magnesium, manganese, and sodium. Figure E-16 shows there is a seasonal variation in sodium concentration in monitoring well GW-32S. Figures E-17 and E-18 for GW-33S and GW-34S indicate a seasonal fluctuation in manganese concentration.

Laboratory Report

The groundwater analytical data package was prepared by Test America in accordance with NYSDEC Category A deliverable requirements. It was reviewed for compliance with analytical method requirements and the following guidelines: USEPA *Contract Laboratory Program (CLP) National Functional Guidelines for Organic Data Review*, EPA-540-R-99-008, October 1999; USEPA *CLP National Functional Guidelines for Inorganic Data Review*, EPA-540-R-01-008, July 2002; and USEPA *Region II Data Validation SOP for SW-846 Method 8290, PCDDs and PCDFs by High Resolution Gas Chromatography/High-Resolution Mass Spectrometry (HRGC/HRMS)*, SOP No. HW-19, Revision 1, October 1994. Qualifications applied to the data include "J/UJ" (estimated concentration/estimated quantitation limit), "J+" (estimated concentration with possible high bias), "J-" (estimated concentration with possible low bias), and "U" (not detected).

A Data Applicability Report (DAR) was prepared following the guidelines provided in NYSDEC Division of Environmental Remediation (DER-10) *Technical Guidance for Site Investigation and Remediation, Appendix 2B*, dated May 2010. The DAR dated June 2013 is submitted separately from this report.

3.3 Groundwater Discharge Monitoring

URS completed two quarterly sampling events (March 2013 and June 2013) of the groundwater collection system discharge since the previous semi-annual report. The sampling was performed in accordance with the requirements of Discharge Permit No. 13-04-CH016 between the Buffalo Sewer Authority and the Town of Cheektowaga. A copy of Permit No. 13-04-CH016 is included as Appendix F.

During the sampling events in March 2013 and June 2013, each regulated parameter was below the limits set by the permit. Copies of the data summary tables that were included with the monitoring reports are included as Appendix G.

3.4 Monitoring Well Inspections

During the May 2013 groundwater sampling event, a well inspection was performed. All wells appeared to be in good condition with the exception of previously existing damage to the risers on GW-07D, GW-01S, and GW-01D. The monitoring well inspection logs may be found in Appendix H.

4.0 SUMMARY AND RECOMMENDATIONS

General Maintenance: The Town will continue to maintain mechanical equipment at the landfill on an as-needed basis and operate the groundwater collection and discharge system as designed. The Town will also continue regular inspections, mow the cap once per year, and plow access to the control building during winter months as necessary.

Groundwater Hydraulic Monitoring: Hydraulic monitoring has been performed on a quarterly basis in conjunction with the discharge monitoring. Water level measurement data demonstrates that the hydraulic gradient is from outside the landfill towards the collection trench. Continued quarterly monitoring is recommended.

Groundwater Quality Monitoring: Groundwater sample results indicate that only low levels of organic compounds and metals are present. Similar concentrations of most parameters were found during previous sampling events. The twentieth round of groundwater sampling will be conducted in November 2013. Low flow sampling techniques will be used. Passive diffusion bags will be used again for VOC analyses at the three wells (GW-4S, GW-7S, and GW-7D) that go dry even using low flow sampling techniques.

Groundwater Discharge Monitoring: Groundwater discharges remain within permit limits. Continued quarterly monitoring is recommended.


TABLES

TABLE 3-1
GROUNDWATER SAMPLE ANALYTICAL RESULTS
PFOHL BROTHERS LANDFILL SITE
MAY 2013

Location ID			GW-01D	GW-01S	GW-03D	GW-03S	GW-04D
Sample ID			GW-1D	GW-1S	GW-3D	GW-3S	GW-4D
Matrix			Groundwater	Groundwater	Groundwater	Groundwater	Groundwater
Depth Interval (ft)			-	-	-	-	-
Date Sampled			05/10/13	05/10/13	05/08/13	05/08/13	05/09/13
Parameter	Units	*					
Volatile Organic Compounds							
1,2-Dichloroethene (total)	UG/L	5					
Vinyl chloride	UG/L	2					
Semivolatile Organic Compounds							
bis(2-Ethylhexyl)phthalate	UG/L	5					
Metals							
Antimony	MG/L	0.003					
Arsenic	MG/L	0.025		0.0098 J		0.0065 J	
Barium	MG/L	1	0.076	0.18	0.079	0.18	0.078
Cadmium	MG/L	0.005				0.00064 J	
Chromium	MG/L	0.05	0.016	0.0040		0.027	0.0014 J
Copper	MG/L	0.2				0.0026 J	
Iron	MG/L	0.3	1.9	23.3	1.3	0.29	0.10
Lead	MG/L	0.025					
Magnesium	MG/L	35	35.6	17.6	16.1	82.0	71.9
Manganese	MG/L	0.3	0.025	1.7	0.48	0.13	0.019
Nickel	MG/L	0.1			0.0034 J	0.18	
Sodium	MG/L	20	101	86.3	167	100	83.4
Zinc	MG/L	2	0.011	0.0065 J		0.017	0.0042 J

* - NYSDEC TOGS (1.1.1), Ambient Water Quality Standards and Guidance Values and Groundwater Effluent Limitations, June 1998 (includes 4/2000 Addendum), Class GA. * - PCB Criteria based on sum of the arachnids.

Flags assigned during chemistry validation are shown.

 Concentration Exceeds

J - The analyte was positively identified, the quantitation is an estimation.

Blank - not detected. - = No criteria.


Only Detected Results Reported.

TABLE 3-1
GROUNDWATER SAMPLE ANALYTICAL RESULTS
PFOHL BROTHERS LANDFILL SITE
MAY 2013

Location ID			GW-04S	GW-07D	GW-07D	GW-07S	GW-07S
Sample ID			GW-4S	GW-7D	GW-7D	GW-7S	GW-7S
Matrix			Groundwater	Groundwater	Groundwater	Groundwater	Groundwater
Depth Interval (ft)			-	-	-	-	-
Date Sampled			05/09/13	05/08/13	05/09/13	05/08/13	05/09/13
Parameter	Units	*					
Volatile Organic Compounds							
1,2-Dichloroethene (total)	UG/L	5			NA		NA
Vinyl chloride	UG/L	2			NA		NA
Semivolatile Organic Compounds							
bis(2-Ethylhexyl)phthalate	UG/L	5		NA	4.2 J	NA	4.8
Metals							
Antimony	MG/L	0.003		NA	0.0075 J	NA	
Arsenic	MG/L	0.025		NA		NA	
Barium	MG/L	1	0.12	NA	0.090	NA	0.28
Cadmium	MG/L	0.005		NA	0.0028	NA	0.0035
Chromium	MG/L	0.05	0.0068	NA	0.53	NA	0.0042
Copper	MG/L	0.2	0.0034 J	NA	0.051	NA	
Iron	MG/L	0.3	2.9	NA	14.3	NA	0.21
Lead	MG/L	0.025		NA	0.22	NA	
Magnesium	MG/L	35	27.8	NA	32.2	NA	35.0
Manganese	MG/L	0.3	0.20	NA	0.13	NA	0.043
Nickel	MG/L	0.1	0.0095 J	NA	0.27	NA	0.0088 J
Sodium	MG/L	20	29.6	NA	80.6	NA	56.1
Zinc	MG/L	2	0.019	NA	0.11	NA	0.0061 J

* - NYSDEC TOGS (1.1.1), Ambient Water Quality Standards and Guidance Values and Groundwater Effluent Limitations. June 1998 (includes 4/2000 Addendum). Class GA. * - PCB Criteria based on sum of the arylchlor.

Flags assigned during chemistry validation are shown.



Concentration Exceeds

J - The analyte was positively identified, the quantitation is an estimation.

Blank - not detected. - = No criteria.


Only Detected Results Reported.

TABLE 3-1
GROUNDWATER SAMPLE ANALYTICAL RESULTS
PFOHL BROTHERS LANDFILL SITE
MAY 2013

Location ID			GW-08D	GW-08D	GW-08SR	GW-26D	GW-28S
Sample ID			FD-050813	GW-8D	GW8SR	GW-26D	GW-28S
Matrix			Groundwater	Groundwater	Groundwater	Groundwater	Groundwater
Depth Interval (ft)			-	-	-	-	-
Date Sampled			05/08/13	05/08/13	05/08/13	05/09/13	05/09/13
Parameter	Units	*	Field Duplicate (1-1)				
Volatile Organic Compounds							
1,2-Dichloroethene (total)	UG/L	5				1.4 J	
Vinyl chloride	UG/L	2					
Semivolatile Organic Compounds							
bis(2-Ethylhexyl)phthalate	UG/L	5					
Metals							
Antimony	MG/L	0.003					
Arsenic	MG/L	0.025			0.018		
Barium	MG/L	1	0.090	0.092	0.52	0.14	0.081
Cadmium	MG/L	0.005			0.00051 J		
Chromium	MG/L	0.05	0.0094 J	0.0063 J	0.0045		0.0011 J
Copper	MG/L	0.2	0.0039 J	0.0036 J	0.0021 J		
Iron	MG/L	0.3	0.18	0.22	33.4	5.2	0.13
Lead	MG/L	0.025			0.0038 J		
Magnesium	MG/L	35	16.3	16.4	53.6	18.7	29.9
Manganese	MG/L	0.3	0.19	0.20	1.6	0.66	0.95
Nickel	MG/L	0.1	0.0067 J	0.0070 J	0.0069 J	0.0017 J	0.0016 J
Sodium	MG/L	20	201	204	416	335	15.1
Zinc	MG/L	2	0.0061 J	0.0070 J	0.0043 J	0.0017 J	0.0059 J

* - NYSDEC TOGS (1.1.1), Ambient Water Quality Standards and Guidance Values and Groundwater Effluent Limitations. June 1998 (includes 4/2000 Addendum). Class GA. * - PCB Criteria based on sum of the arachnids.

Flags assigned during chemistry validation are shown.

 Concentration Exceeds

J - The analyte was positively identified, the quantitation is an estimation.

Blank - not detected. - = No criteria.


Only Detected Results Reported.

TABLE 3-1
GROUNDWATER SAMPLE ANALYTICAL RESULTS
PFOHL BROTHERS LANDFILL SITE
MAY 2013

Location ID			GW-29S	GW-30S	GW-31S	GW-32S	GW-33S
Sample ID			GW-29S	GW-30S	GW-31S	GW-32S	GW-33S
Matrix			Groundwater	Groundwater	Groundwater	Groundwater	Groundwater
Depth Interval (ft)			-	-	-	-	-
Date Sampled			05/09/13	05/10/13	05/10/13	05/10/13	05/10/13
Parameter	Units	*					
Volatile Organic Compounds							
1,2-Dichloroethene (total)	UG/L	5					
Vinyl chloride	UG/L	2		2.2			
Semivolatile Organic Compounds							
bis(2-Ethylhexyl)phthalate	UG/L	5					
Metals							
Antimony	MG/L	0.003					
Arsenic	MG/L	0.025	0.027				
Barium	MG/L	1	0.20	0.14	0.057	0.056	0.019
Cadmium	MG/L	0.005					
Chromium	MG/L	0.05					
Copper	MG/L	0.2					
Iron	MG/L	0.3	14.8	8.5	0.51		0.036 J
Lead	MG/L	0.025					
Magnesium	MG/L	35	91.7	38.1	27.1	32.4	35.7
Manganese	MG/L	0.3	0.76	1.0	0.86	0.39	0.081
Nickel	MG/L	0.1			0.0050 J		
Sodium	MG/L	20	9.3	56.1	3.9	4.1	3.1
Zinc	MG/L	2	0.0036 J		0.012	0.0035 J	0.0032 J

* - NYSDEC TOGS (1.1.1), Ambient Water Quality Standards and Guidance Values and Groundwater Effluent Limitations, June 1998 (includes 4/2000 Addendum). Class GA. * - PCB Criteria based on sum of the arylchlor. J - The analyte was positively identified, the quantitation is an estimation.

Flags assigned during chemistry validation are shown.

 Concentration Exceeds

J - The analyte was positively identified, the quantitation is an estimation.

Blank - not detected. - = No criteria.


Only Detected Results Reported.

TABLE 3-1
GROUNDWATER SAMPLE ANALYTICAL RESULTS
PFOHL BROTHERS LANDFILL SITE
MAY 2013

Location ID			GW-34S	GW-35S
Sample ID			GW-34S	GW-35S
Matrix			Groundwater	Groundwater
Depth Interval (ft)			-	-
Date Sampled			05/09/13	05/09/13
Parameter	Units	*		
Volatile Organic Compounds				
1,2-Dichloroethene (total)	UG/L	5		
Vinyl chloride	UG/L	2		
Semivolatile Organic Compounds				
bis(2-Ethylhexyl)phthalate	UG/L	5		
Metals				
Antimony	MG/L	0.003		
Arsenic	MG/L	0.025		
Barium	MG/L	1	0.12	0.080
Cadmium	MG/L	0.005		
Chromium	MG/L	0.05		
Copper	MG/L	0.2		
Iron	MG/L	0.3	0.22	0.065
Lead	MG/L	0.025		
Magnesium	MG/L	35	39.9	23.9
Manganese	MG/L	0.3	0.23	0.16
Nickel	MG/L	0.1	0.0051 J	0.0013 J
Sodium	MG/L	20	26.3	2.9
Zinc	MG/L	2	0.0062 J	0.0044 J

* - NYSDEC TOGS (1.1.1), Ambient Water Quality Standards and Guidance Values and Groundwater Effluent Limitations. June 1998 (includes 4/2000 Addendum). Class GA. * - PCB Criteria based on sum of the arylchlor. .

Flags assigned during chemistry validation are shown.

 Concentration Exceeds

J - The analyte was positively identified, the quantitation is an estimation.

Blank - not detected. - = No criteria. .

Only Detected Results Reported.

TABLE 3-2

APPROVED REVISION OF TABLE 3.2 FROM THE O&M PLAN

GROUNDWATER SAMPLING SUMMARY
OPERATION AND MAINTENANCE PLAN
PFOHL BROTHERS LANDFILL SITE, CHEEKTOWAGA, NEW YORK

LOCATIONS

GW-1D/1S
GW- 3D/3S
GW- 4D/4S
GW- 7D/7S
GW- 8D/8S(R)
GW- 26D/35S
GW- 28S
GW- 29S
GW- 30S
GW- 31S
GW- 32S
GW- 33S
GW- 34S

FREQUENCY

semi-annually for overburden and bedrock groundwater

PARAMETERS

<i>Field</i>	pH conductivity temperature turbidity
<i>VOCs</i>	Acetone Benzene 1,2-Dichloroethene (total) 1,1,2-Trichloroethane Vinyl chloride
<i>SVOCs</i>	Phenol 1,3-Dichlorobenzene 1,4-Dichlorobenzene bis(2-Ethylhexyl)phthalate

TABLE 3-2 (continued)


APPROVED REVISION OF TABLE 3.2 FROM THE O&M PLAN


GROUNDWATER SAMPLING SUMMARY
OPERATION AND MAINTENANCE PLAN
PFOHL BROTHERS LANDFILL SITE, CHEEKTOWAGA, NEW YORK

PARAMETERS (cont'd)

<i>Metals</i>	Antimony
	Arsenic
	Barium
	Cadmium
	Chromium
	Copper
	Iron
	Lead
	Magnesium
	Manganese
	Mercury
	Nickel
	Silver
	Sodium
	Zinc

FIGURES

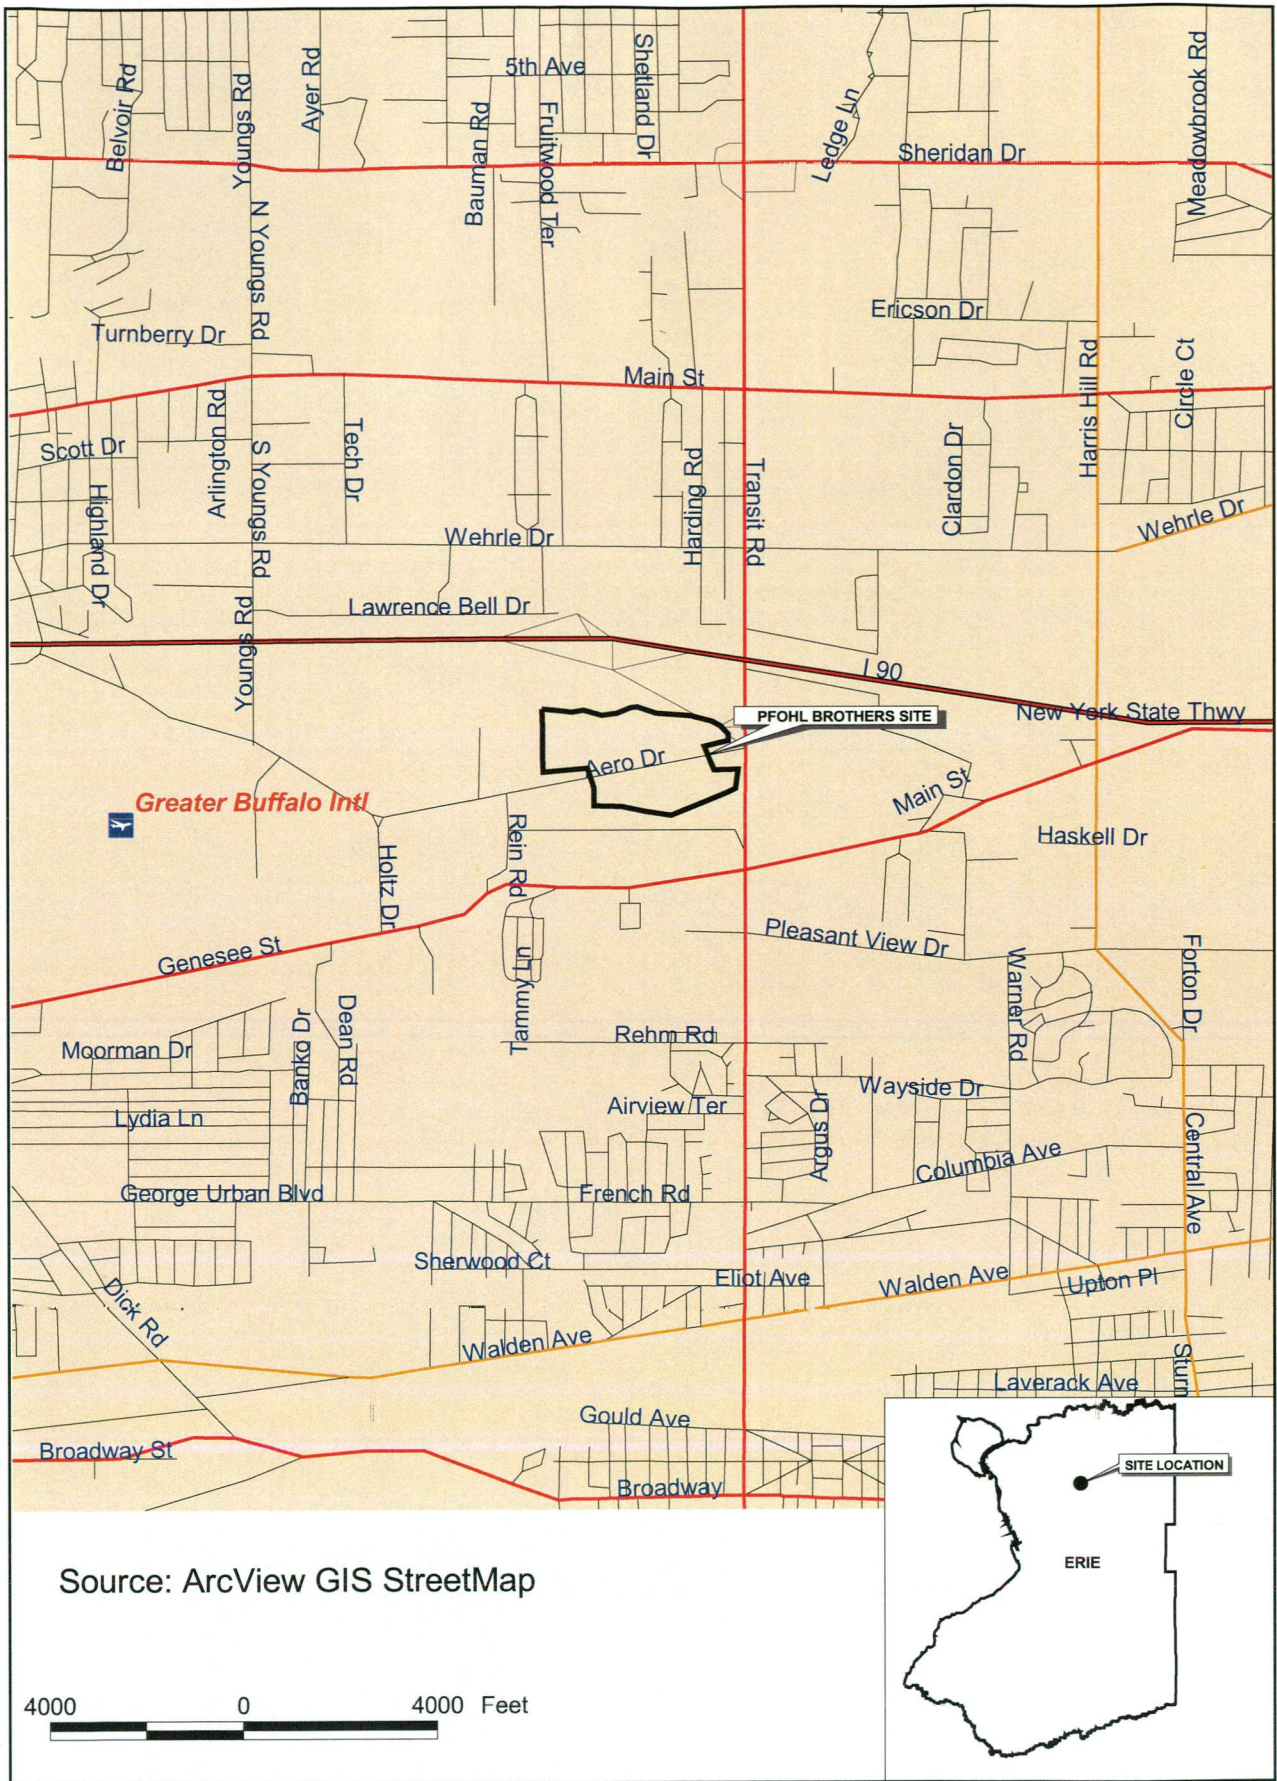

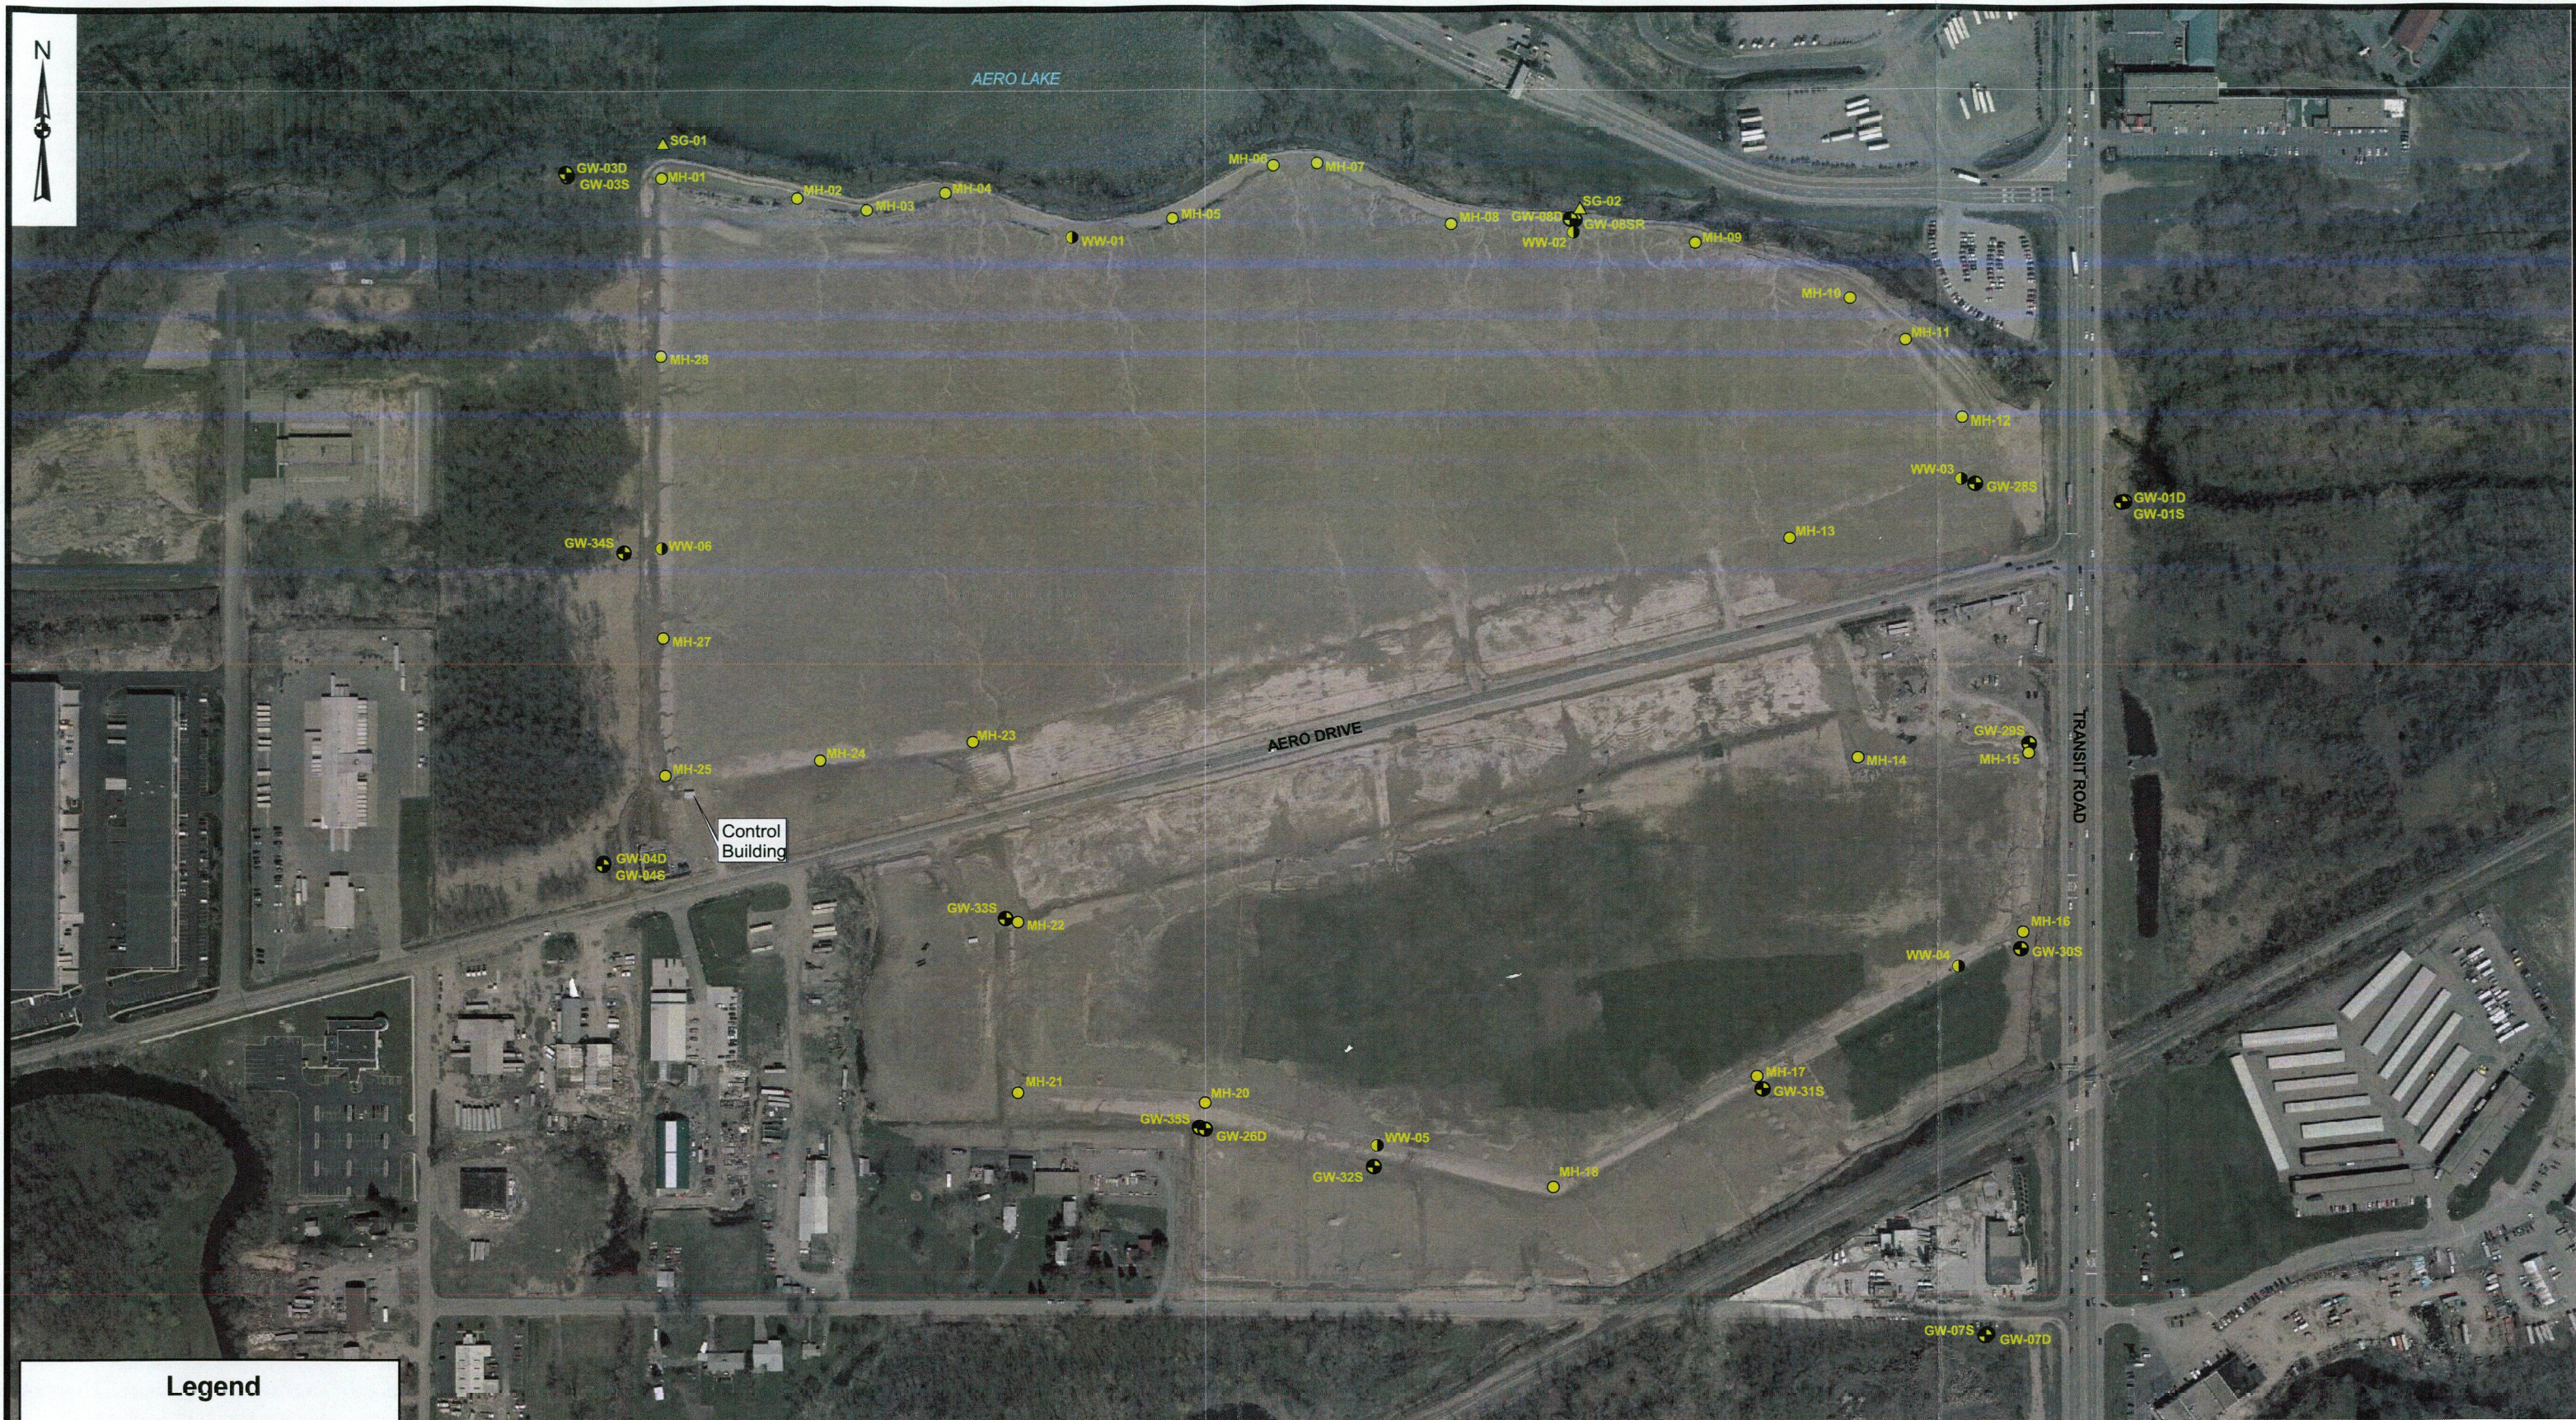

Legend

- Monitoring Well Location
- Staff Gauge Location
- Manhole Location
- Wet Well Location

400 0 400 Feet

PFOHL BROTHERS LANDFILL
MONITORING LOCATIONS

URS

FIGURE 3-1

APPENDIX A

EXAMPLE DAILY INSPECTION SHEETS

Pfohl Brothers Landfill Site

Daily Logsheet

Town of Cheektowaga

Date 3/8/13
Time 2:55

Weather conditions SUNNY 41°
Read by: B. PUGH

	Level of Water from bottom (ft.)	Flow gallons / minute	Flow Totals gallons	Pump Run Time Hrs.
WW-3	6.3	30.5	683,826	2434
WW-2	4.6	0	12,821	131
WW-1	3.9	0	826,536	2447
WW-6	5.9	53.1	4,519,157	8981
WW-4	6.9	0	360,935	5416
WW-5	6.7	0	2,789,571	10,396

Flow Totalizer at Meter chamber

9,184,307

Heat Trace

Outside temp T = 41°
Current A = 2.2

Set point SP = 40

Large Suppressor events

415,299

Motor Control Center

Volts 480 volts
Amps 10 amps

Which WW was running?

1 ☐ 2 ☐ 3 ☒ 4 ☐ 5 ☐ 6 ☒

Filter

Checked ☐

Changed ☐

Comments and/or Current Conditions

RESET LEVEL INVALID ALARM WW3

RAN WW3 ON HAND X 20 MIN. AND

RETURNED TO AUTO.

DROVE PERIMETER ROAD - AREA B - OK

Pfohl Brothers Landfill Site

Daily Logsheet

Town of Cheektowaga

Date 5-16-13
Time 3:20

Weather conditions SUNNY 73°
Read by: Bill PUGH

	Level of Water from bottom (ft.)	Flow gallons / minute	Flow Totals gallons	Pump Run Time Hrs.
WW-3	99.0	0	763,128	2522
WW-2	4.7	0	12,830	131
WW-1	4.0	0	912,050	2560
WW-6	6.2	0	5,695,863	9312
WW-4	6.9	0	865,680	5611
WW-5	99	0	333,4933	10,587

Flow Totalizer at Meter chamber

11,586,400

Heat Trace

Outside temp T = 73
Current A = 0

Set point SP = 40°

Large Suppressor events

415,320

Motor Control Center

Volts 480 volts
Amps 2 amps

Which WW was running?

1 ☐ 2 ☐ 3 ☐ 4 ☐ 5 ☐ 6 ☐

Filter

Checked ☐

Changed ☐

Comments and/or Current Conditions

WW 3

WW 5

LEVEL INVALID ALARMS -

WILL NOT RESET.

Pfohl Brothers Landfill Site

Daily Logsheet

Town of Cheektowaga

Date 6-18-13
Time 2:10

Weather conditions OVERCAST 70°
Read by: BILL PUGH

	Level of Water from bottom (ft.)	Flow gallons / minute	Flow Totals gallons	Pump Run Time Hrs.
WW-3	99 (DEFAULT)	0	818,919	2549
WW-2	4.4	0	37,023	144
WW-1	4.1	0	1,036,496	2572
WW-6	6.8	0	6,288,144	9474
WW-4	7.0	0	971,939	5658
WW-5	6.7	0	3,608,428	10,676

Flow Totalizer at Meter chamber

Heat Trace

Outside temp T = 70°
Current A = 0

Set point SP = 40°

Large Suppressor events 415,328

Motor Control Center

Volts 480 volts
Amps 3 amps

Which WW was running?

1 ☐ 2 ☐ 3 ☐ 4 ☐ 5 ☐ 6 ☒

Filter

Checked ☐

Changed ☐

Comments and/or Current Conditions

WW 3 IN ALARM MODE
REPAIR TO INSTRUMENTATION U.G. CABLE
BEING SCHEDULED

APPENDIX B

MONTHLY FLOW SUMMARIES
JANUARY 2013 – JUNE 2013

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent
Joseph Glab
Asst. Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

July 5, 2013


Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga

Re: Pfohl Bros. Flow Data

Dear Mr. Pugh,

Enclosed for your review, please find a copy of the June 2013 Direct Discharge Flow Data Report, prepared by Jon W. Nichy. Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.


Yours truly,

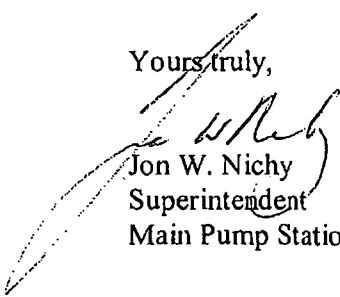
Jon W. Nichy
Superintendent
Main Pump Station

Direct Discharge Flow Data

5/31/2013		11907271	0	11,907,291	
June-13	Time; 11:58pm unless otherwise stated	Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	Notes
1		11944155	36,884	11,944,175	21:35 inhibit
2		11949896	5,741	11,949,916	12:20 enable
3		12042056	92,160	12,042,076	
4		12133928	91,872	12,133,948	
5		12153048	19,120	12,153,068	12:47 inhibit
6		12153048	0	12,153,068	
7		12241242	88,194	12,241,262	06:00 enable
8		12334952	93,710	12,334,972	
9		12376712	41,760	12,376,732	23:57 inhibit
10		12393427	16,715	12,393,447	18:45 enable
11		12432442	39,015	12,432,462	07:41inhibit 13:18enable
12		12432442	0	12,432,462	
13		12436632	4,190	12,436,652	02:56 inhibit
14		12531343	94,711	12,531,363	12:06 enable
15		12702128	170,785	12,702,148	
16		12720546	18,418	12,720,566	
17		12753438	32,892	12,753,458	
18		12765075	11,637	12,765,095	
19		12808043	42,968	12,808,063	
20		12823076	15,033	12,823,096	
21		12844799	21,723	12,844,819	
22		12862824	18,025	12,862,844	
23		12876855	14,031	12,876,875	
24		12881115	4,260	12,881,135	
25		12904061	22,946	12,904,081	
26		12919101	15,040	12,919,121	23:52 inhibit
27		12925710	6,609	12,925,730	07:26 enable
28		12941822	16,112	12,941,842	00:00 inhibit
29		13061954	120,132	13,061,974	07:54 enable
30		13212773	150,819	13,212,793	
31					
		1,305,502	1,305,502	1,305,502	

June
2013

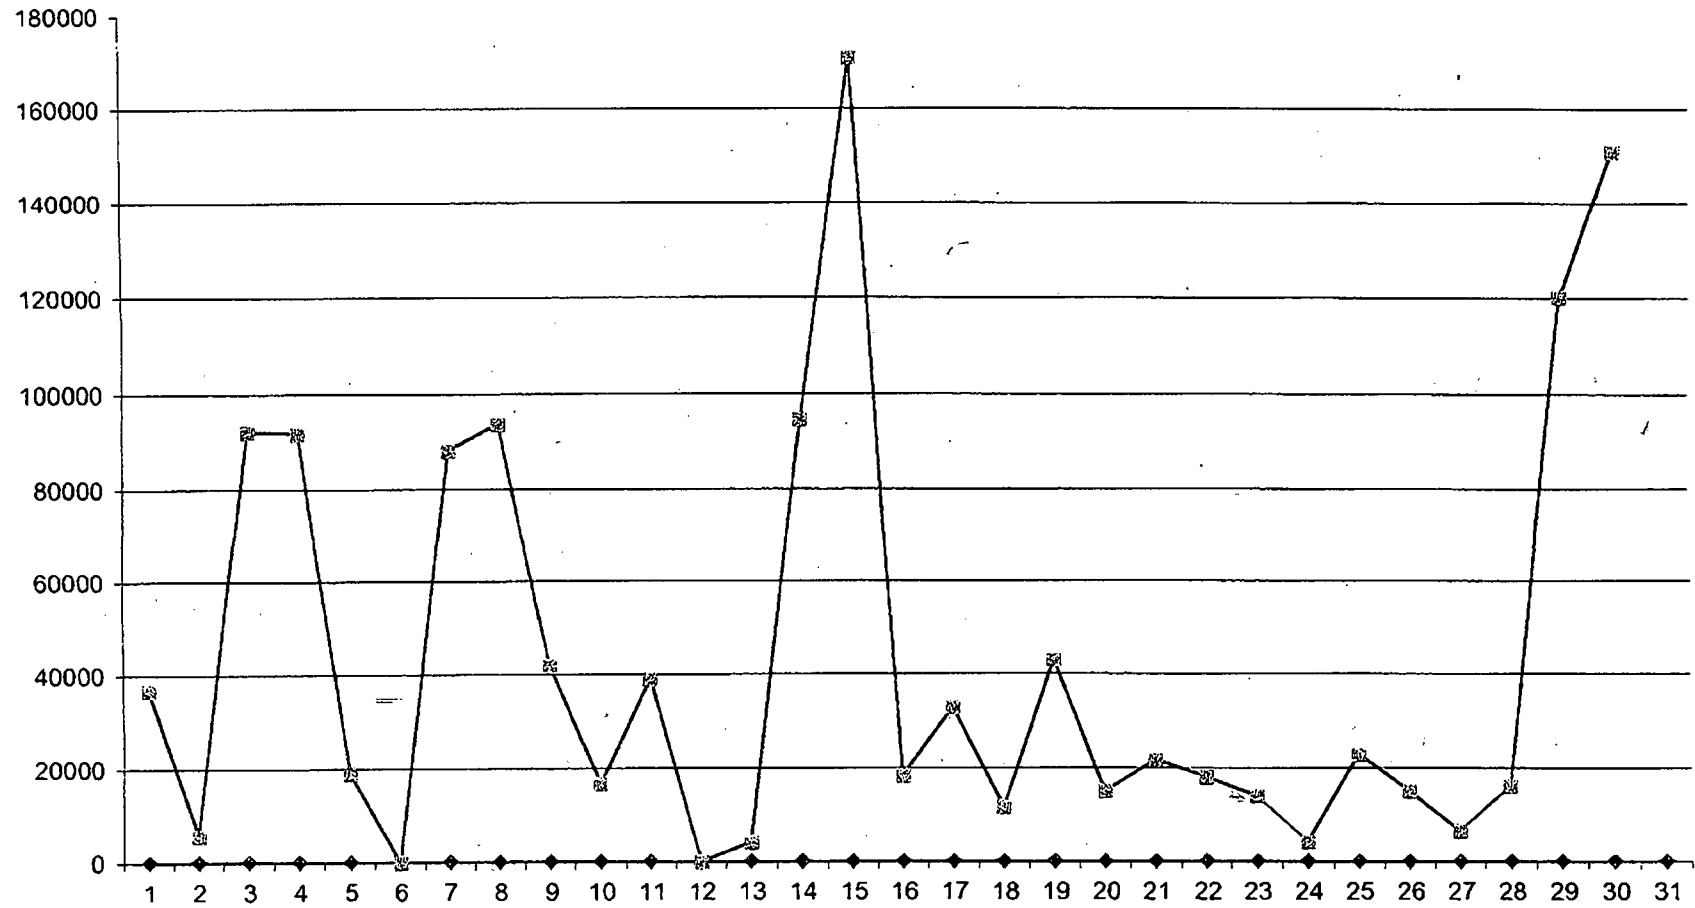

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent
Joseph Glab
Asst. Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

June 11, 2013


Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga

Re: Pfohl Bros. Flow Data

Dear Mr. Pugh,

Enclosed for your review, please find a copy of the May 2013 Direct Discharge Flow Data Report, prepared by Jon W. Nichy. Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.


Yours truly,

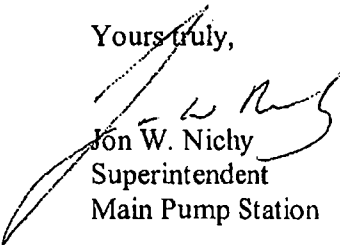
Jon W. Nichy
Superintendent
Main Pump Station

Direct Discharge Flow Data

4/30/2013		11086044	0	11,086,064	
May-13	Time; 11:58pm unless otherwise stated	Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	Notes
1		11086044	0	11,086,064	
2		11086044	0	11,086,064	
3		11086044	0	11,086,064	
4		11210512	124,468	11,210,532	
5		11250293	39,781	11,250,313	
6		11250293	0	11,250,313	
7		11250293	0	11,250,313	
8		11250293	0	11,250,313	
9		11250293	0	11,250,313	
10		11295581	45,288	11,295,601	1909 inhibit
11		11309766	14,185	11,309,786	1752 enable
12		11329400	19,634	11,329,420	
13		11329400	0	11,329,420	
14		11393389	63,989	11,393,409	
15		11573481	180,092	11,573,501	
16		11586400	12,919	11,586,420	
17		11586981	581	11,587,001	
18		11586981	0	11,587,001	
19		11588255	1,274	11,588,275	
20		11588255	0	11,588,275	
21		11588255	0	11,588,275	
22		11588255	0	11,588,275	
23		11588255	0	11,588,275	
24		11618686	30,431	11,618,706	
25		11623744	5,058	11,623,764	
26		11625639	1,895	11,625,659	
27		11629335	3,696	11,629,355	
28		11664183	34,848	11,664,203	1000 inhibit
29		11752800	88,617	11,752,820	1241 enable
30		11907271	154,471	11,907,291	
31		11907271	0	11,907,291	
		821,227	821,227	821,227	

May
2013

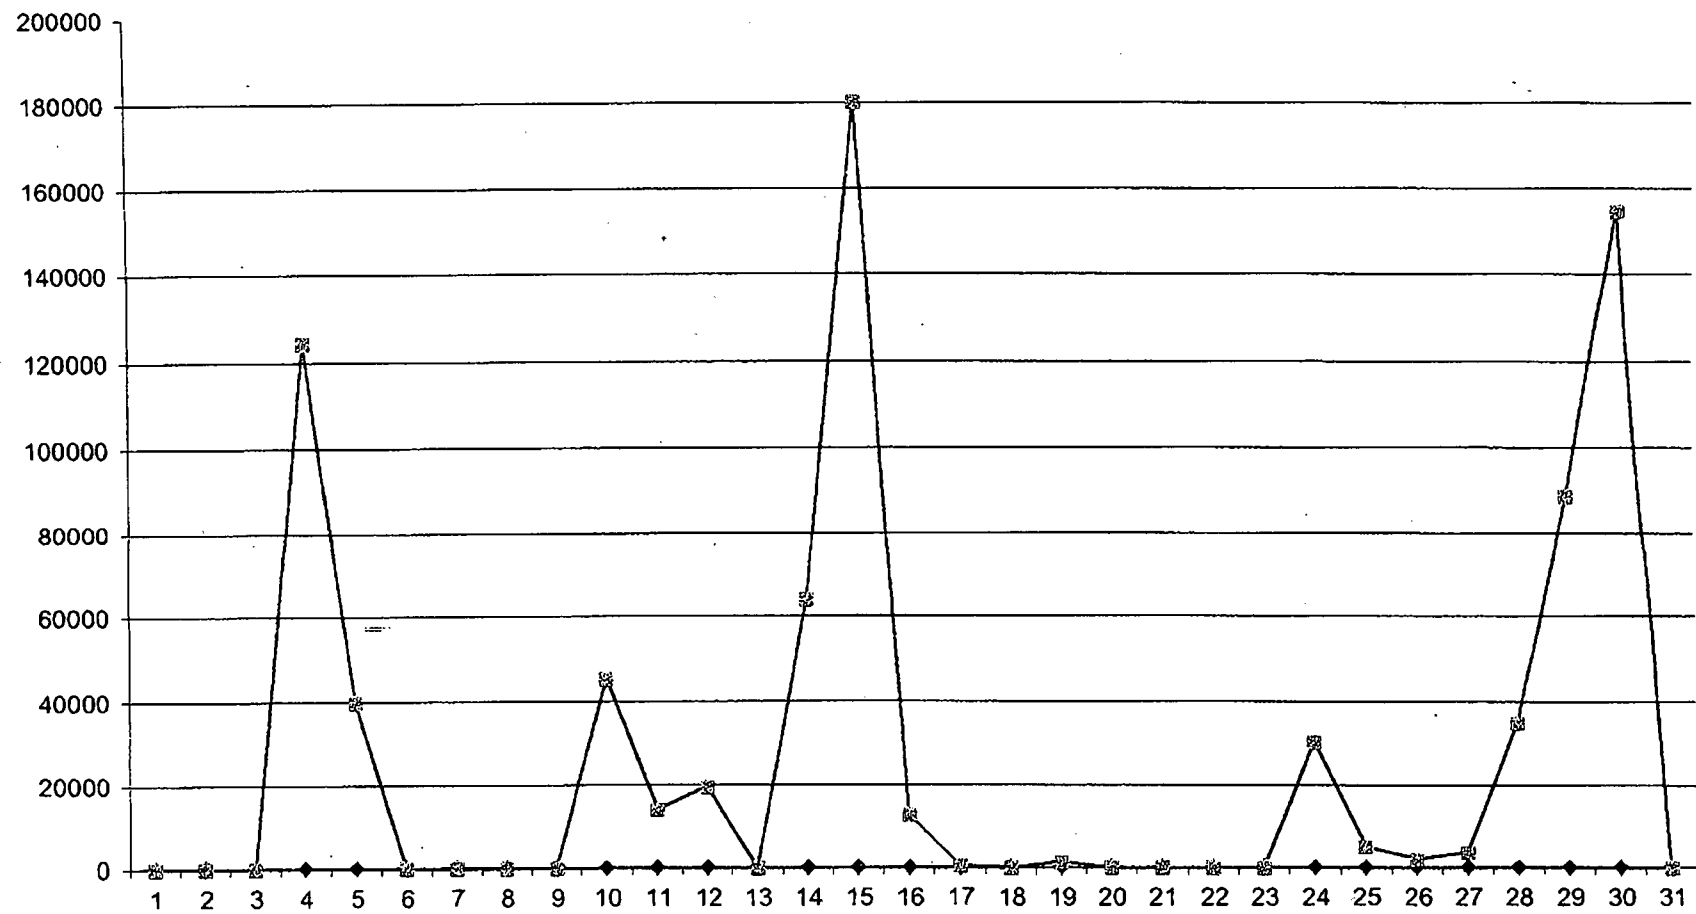

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent
Joseph Glab
Asst. Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

May 10, 2013


Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga

Re: Pfohl Bros. Flow Data

Dear Mr. Pugh,

Enclosed for your review, please find a copy of the April 2013 Direct Discharge Flow Data Report, prepared by Jon W. Nichy. Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.


Yours truly,


Jon W. Nichy
Superintendent
Main Pump Station

Direct Discharge Flow Data

3/31/2013		10125301	10,678	10,125,321	
April-13	Time; 11:58pm unless otherwise stated	Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	Notes
1		10137941	12,640	10,137,961	
2		10140740	2,799	10,140,760	
3		10168687	27,947	10,168,707	
4		10177279	8,592	10,177,299	
5		10264851	87,572	10,264,871	
6		10301001	36,150	10,301,021	
7		10314595	13,594	10,314,615	
8		10326345	11,750	10,326,365	
9		10327138	793	10,327,158	
10		10327138	0	10,327,158	
11		10327138	0	10,327,158	
12		10327138	0	10,327,158	
13		10445112	117,974	10,445,132	
14		10623672	178,560	10,623,692	
15		10763522	139,850	10,763,542	
16		10826882	63,360	10,826,902	
17		10837552	10,670	10,837,572	
18		10837552	0	10,837,572	
19		10837552	0	10,837,572	
20		10896365	58,813	10,896,385	
21		10903726	7,361	10,903,746	
22		10988479	84,753	10,988,499	
23		11024712	36,233	11,024,732	
24		11024712	0	11,024,732	
25		11024712	0	11,024,732	
26		11024712	0	11,024,732	
27		11055860	31,148	11,055,880	
28		11086044	30,184	11,086,064	
29		11086044	0	11,086,064	
30		11086044	0	11,086,064	
31					
		960,743	960,743	960,743	

April
2013

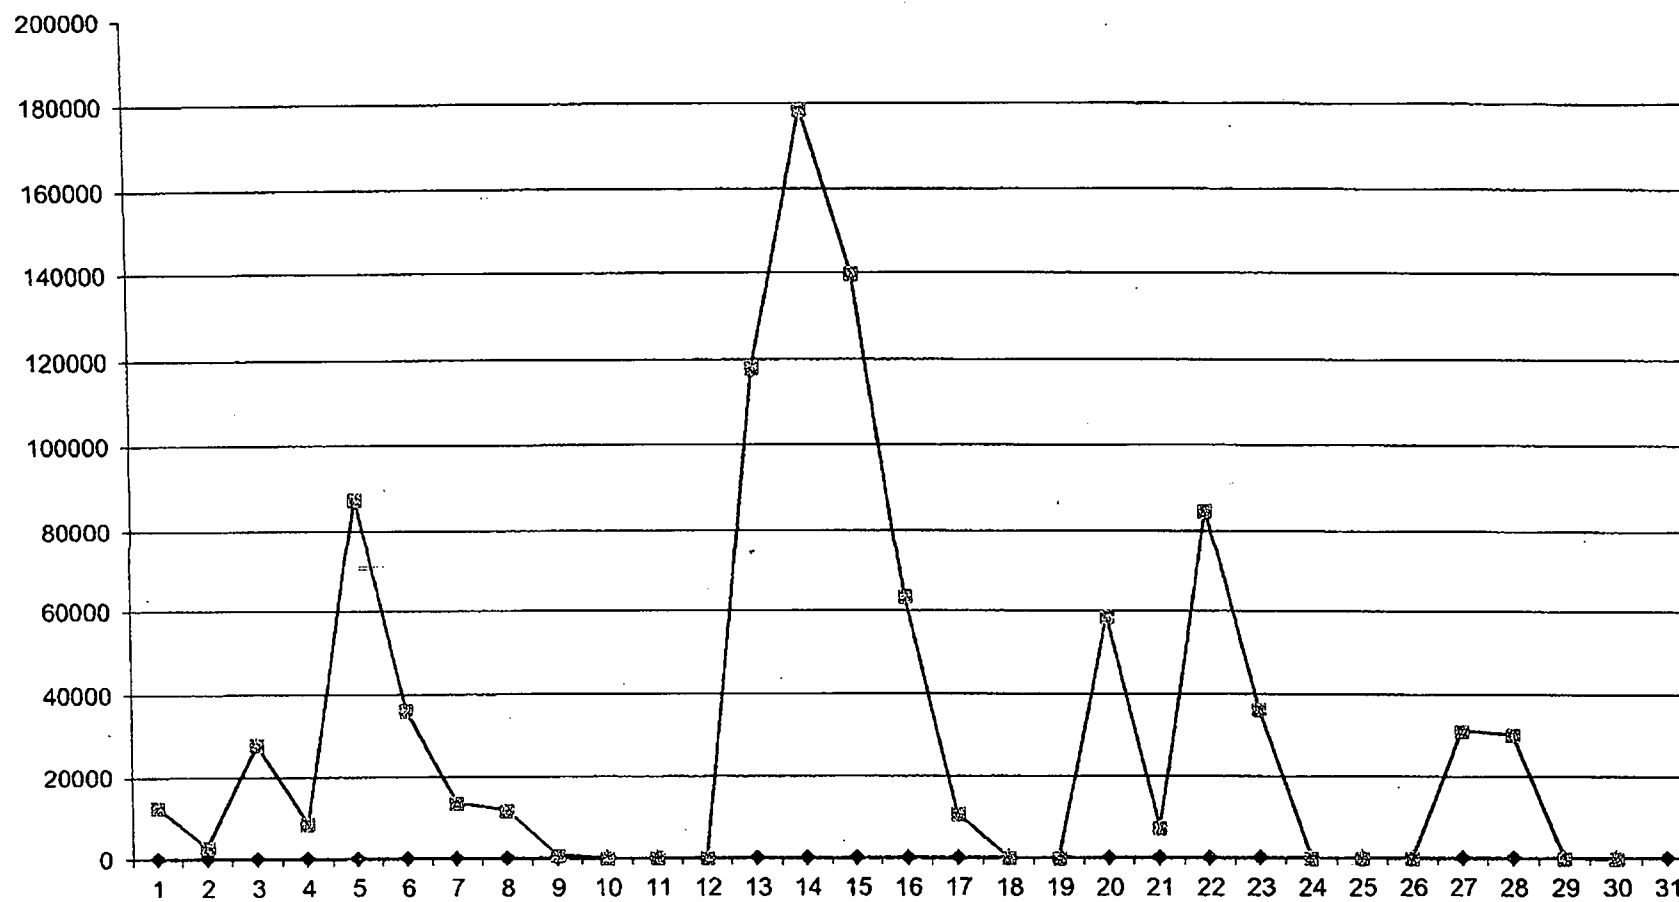

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent
Joseph Glab
Asst. Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

April 6, 2013


Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga

Re: Pfohl Bros. Flow Data

Dear Mr. Pugh,

Enclosed for your review, please find a copy of the March 2013 Direct Discharge Flow Data Report, prepared by Jon W. Nichy. Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.


Yours truly,


Jon W. Nichy
Superintendent
Main Pump Station

Direct Discharge Flow Data

2/28/2013		8640522	89,397	8,640,542	
March-13	Time; 11:58pm unless otherwise stated	Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	Notes
1		8831345	190,823	8,831,365	
2		8930939	99,594	8,930,959	
3		8941559	10,620	8,941,579	
4		8960042	18,483	8,960,062	
5		8966305	6,263	8,966,325	
6		8996035	29,730	8,996,055	
7		9106819	110,784	9,106,839	
8		9212639	105,820	9,212,659	
9		9254291	41,652	9,254,311	
10		9269683	15,392	9,269,703	
11		9334325	64,642	9,334,345	
12		9448599	114,274	9,448,619	
13		9511369	62,770	9,511,389	
14		9522788	11,419	9,522,808	
15		9537706	14,918	9,537,726	
16		9554257	16,551	9,554,277	
17		9590195	35,938	9,590,215	
18		9673969	83,774	9,673,989	
19		9688722	14,753	9,688,742	
20		9707448	18,726	9,707,468	
21		9717600	10,152	9,717,620	
22		9733545	15,945	9,733,565	
23		9761730	28,185	9,761,750	
24		9854298	92,568	9,854,318	
25		9884883	30,585	9,884,903	
26		9894064	9,181	9,894,084	
27		9912606	18,542	9,912,626	
28		9954785	42,179	9,954,805	
29		10063784	108,999	10,063,804	
30		10114623	50,839	10,114,643	
31		10125301	10,678	10,125,321	
		1,484,779	1,484,779	1,484,779	

March
2013

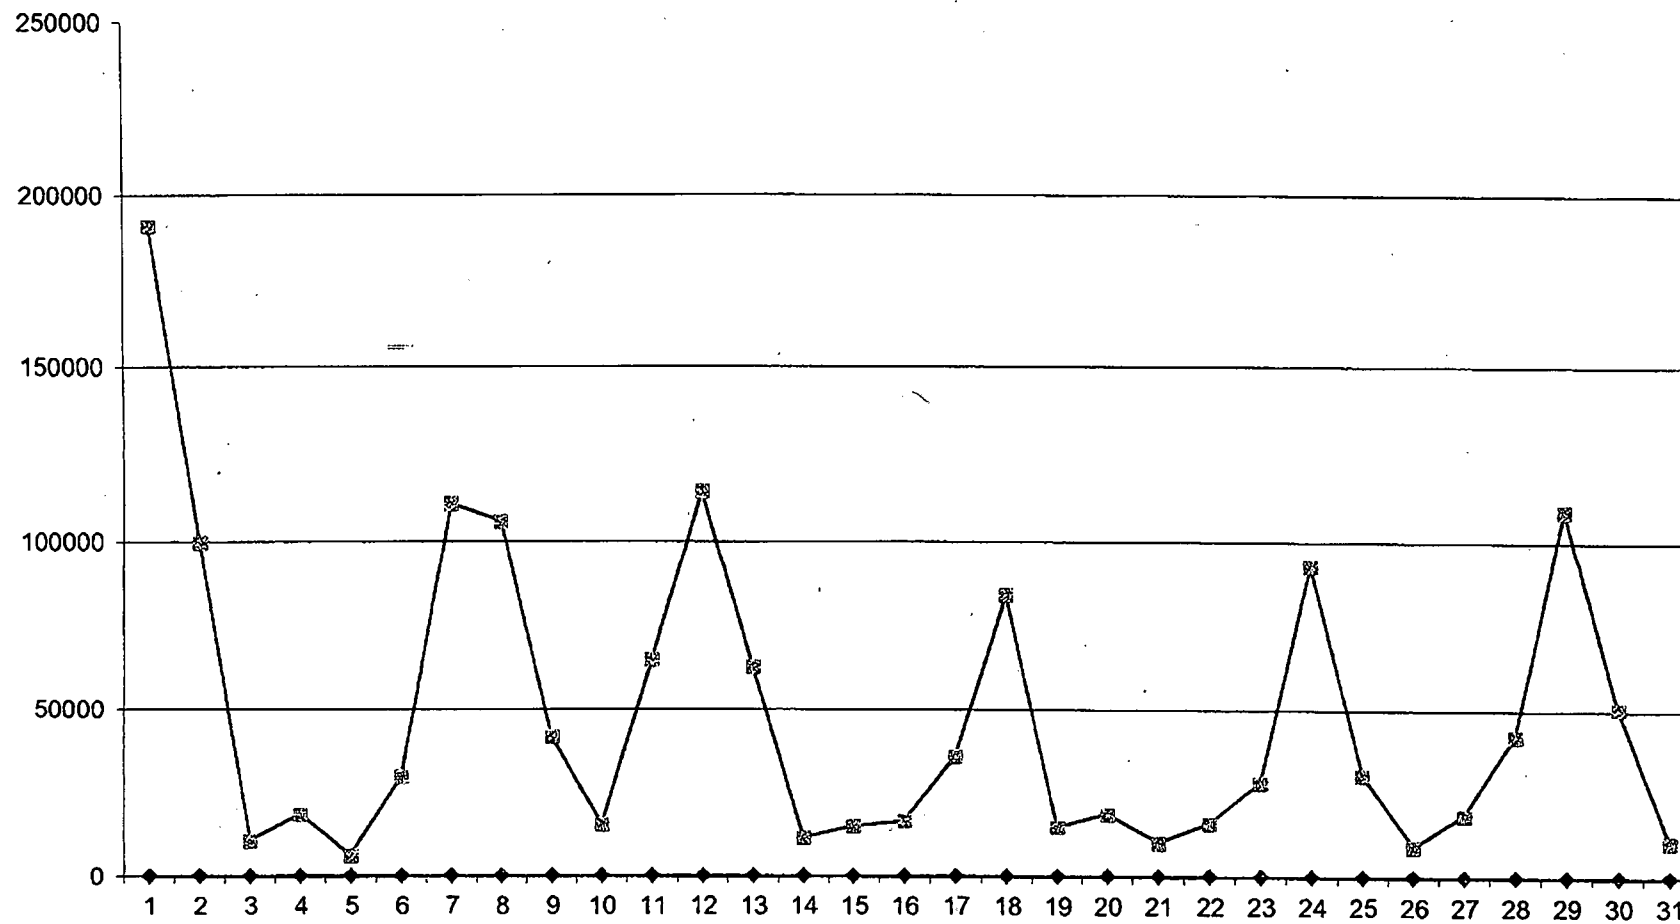

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent
Joseph Glab
Asst. Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

March 2, 2013


Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga

Re: Pfohl Bros. Flow Data

Dear Mr. Pugh,

Enclosed for your review, please find a copy of the February 2013 Direct Discharge Flow Data Report, prepared by Jon W. Nichy. Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.


Yours truly,

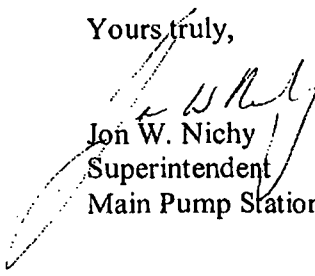
Jon W. Nichy
Superintendent
Main Pump Station

Direct Discharge Flow Data

1/31/2013		7291492	70,179	7,291,508	
February-13	Time; 11:58pm unless otherwise stated	Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	Notes
1		7502867	211,376	7,502,884	
2		7639962	137,095	7,639,979	
3		7647382	7,420	7,647,399	
4		7658224	10,842	7,658,241	
5		7668603	10,379	7,668,620	
6		7685567	16,964	7,685,584	
7		7696931	11,364	7,696,948	
8		7696931	0	7,696,948	
9		7751867	54,936	7,751,884	
10		7826311	74,444	7,826,328	
11		7835360	9,049	7,835,377	0302 inhibit
12		7915635	80,276	7,915,653	0615 enable
13		8025641	110,006	8,025,659	
14		8119925	94,284	8,119,943	2128 inhibit
15		8181107	61,183	8,181,126	1328 enable
16		8283363	102,256	8,283,382	
17		8320912	37,549	8,320,931	
18		8331137	10,225	8,331,156	
19		8374551	43,414	8,374,570	0841inhibit 1832enable
20		8471802	97,252	8,471,822	
21		8480745	8,943	8,480,765	
22		8496742	15,997	8,496,762	
23		8510014	13,272	8,510,034	
24		8513684	3,670	8,513,704	
25		8538612	24,928	8,538,632	
26		8551125	12,513	8,551,145	2002 inhibit
27		8551125	0	8,551,145	
28		8640522	89,397	8,640,542	1159 enable
29					
30					
31					
		1,349,030	1,349,034	1,349,034	

February
2013

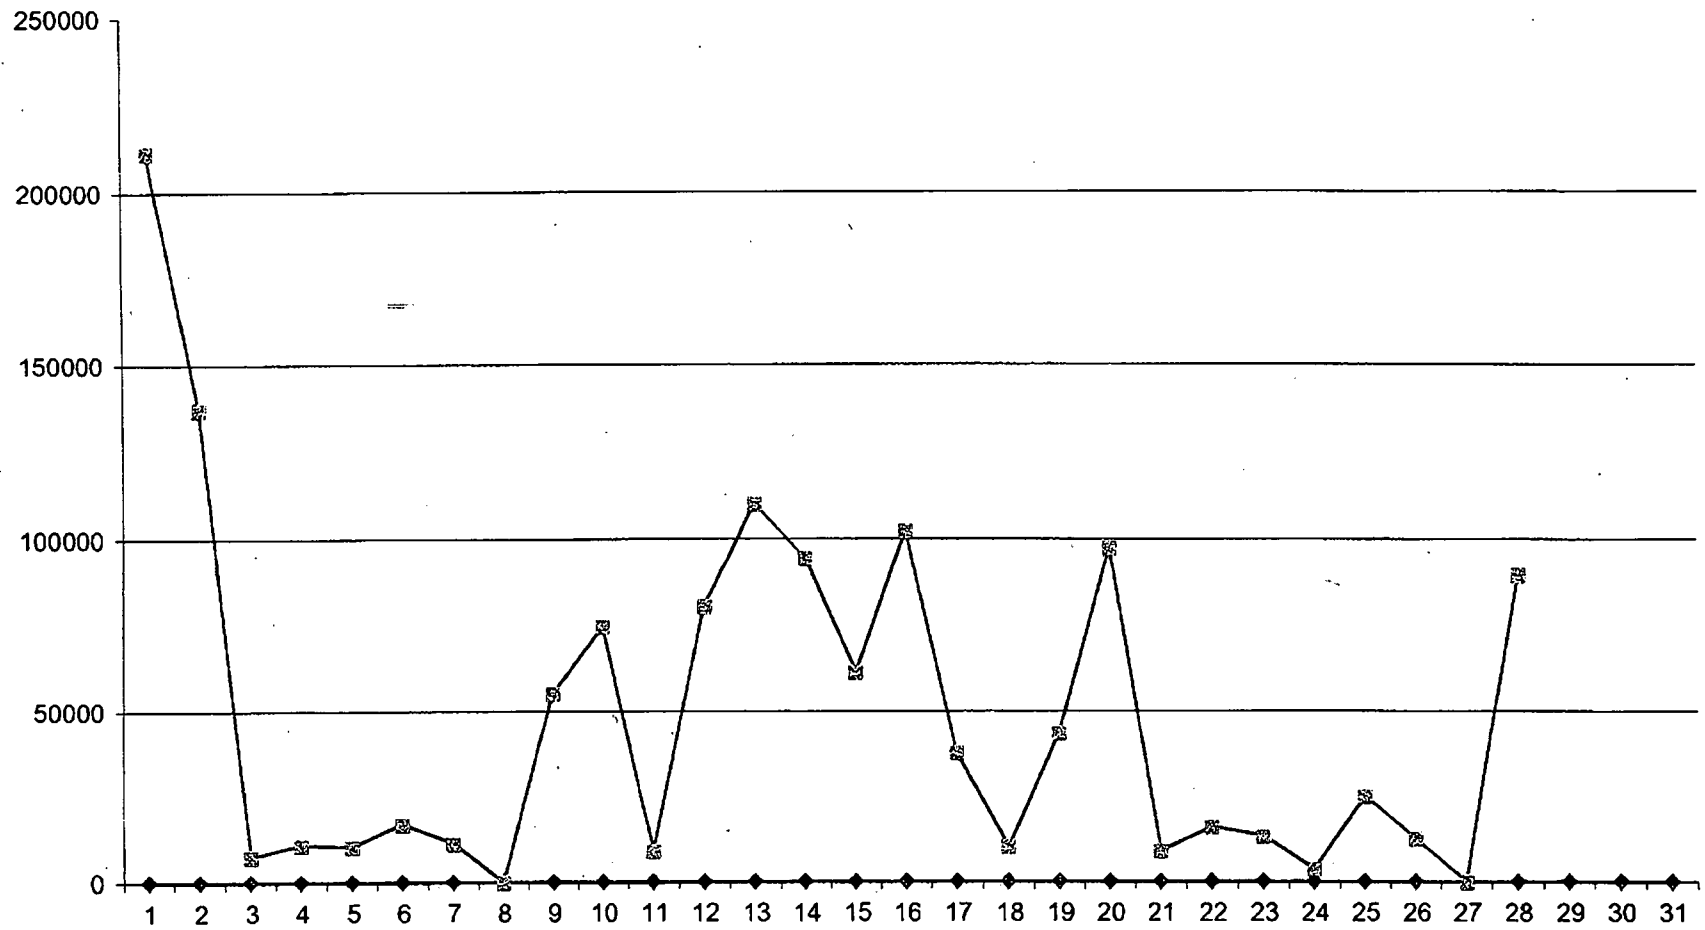

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent
Joseph Glab
Asst. Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

February 7, 2013


Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga

Re: Pfohl Bros. Flow Data

Dear Mr. Pugh,

Enclosed for your review, please find a copy of the January 2013 Direct Discharge Flow Data Report, prepared by Jon W. Nichy. Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.

Yours truly,

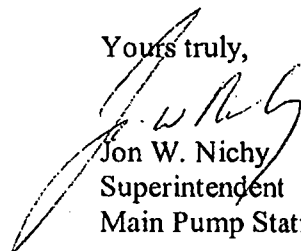

Jon W. Nichy
Superintendent
Main Pump Station

Direct Discharge Flow Data

12/31/2012


5760787

30,294

5,760,799

January-13	Time; 11:58pm unless otherwise stated	Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	Notes
1		5767997	7,210	5,768,009	
2		5835467	67,470	5,835,479	
3		5932350	96,884	5,932,363	
4		5951536	19,186	5,951,549	
5		5955797	4,262	5,955,811	
6		6020989	65,192	6,021,003	
7		6122854	101,866	6,122,869	
8		6129908	7,054	6,129,923	
9		6139683	9,776	6,139,699	1555inhibit
10		6240327	100,644	6,240,343	
11		6261606	21,279	6,261,622	1306enable1504inhibit
12		6364392	102,786	6,364,408	1047enable
13		6447080	82,688	6,447,096	0439inhibit 1902enable
14		6654571	207,491	6,654,587	
15		6804376	149,806	6,804,393	
16		6855853	51,477	6,855,870	
17		6859536	3,683	6,859,553	
18		6885671	26,136	6,885,689	
19		6927658	41,987	6,927,676	
20		6927658	0	6,927,676	
21		6927658	0	6,927,676	
22		6927658	0	6,927,676	
23		6927658	191,160	7,118,836	
24		6927658	0	7,118,836	
25		6927658	0	7,118,836	
26		7144353	25,532	7,144,368	
27		7149298	4,946	7,149,314	
28		7181516	32,218	7,181,532	1358inhibit
29		7181516	0	7,181,532	
30		7221313	39,797	7,221,329	0724enable 1221inhibit
31		7291492	70,179	7,291,508	1446enable
		1,530,705	1,530,709	1,530,709	

January
2013

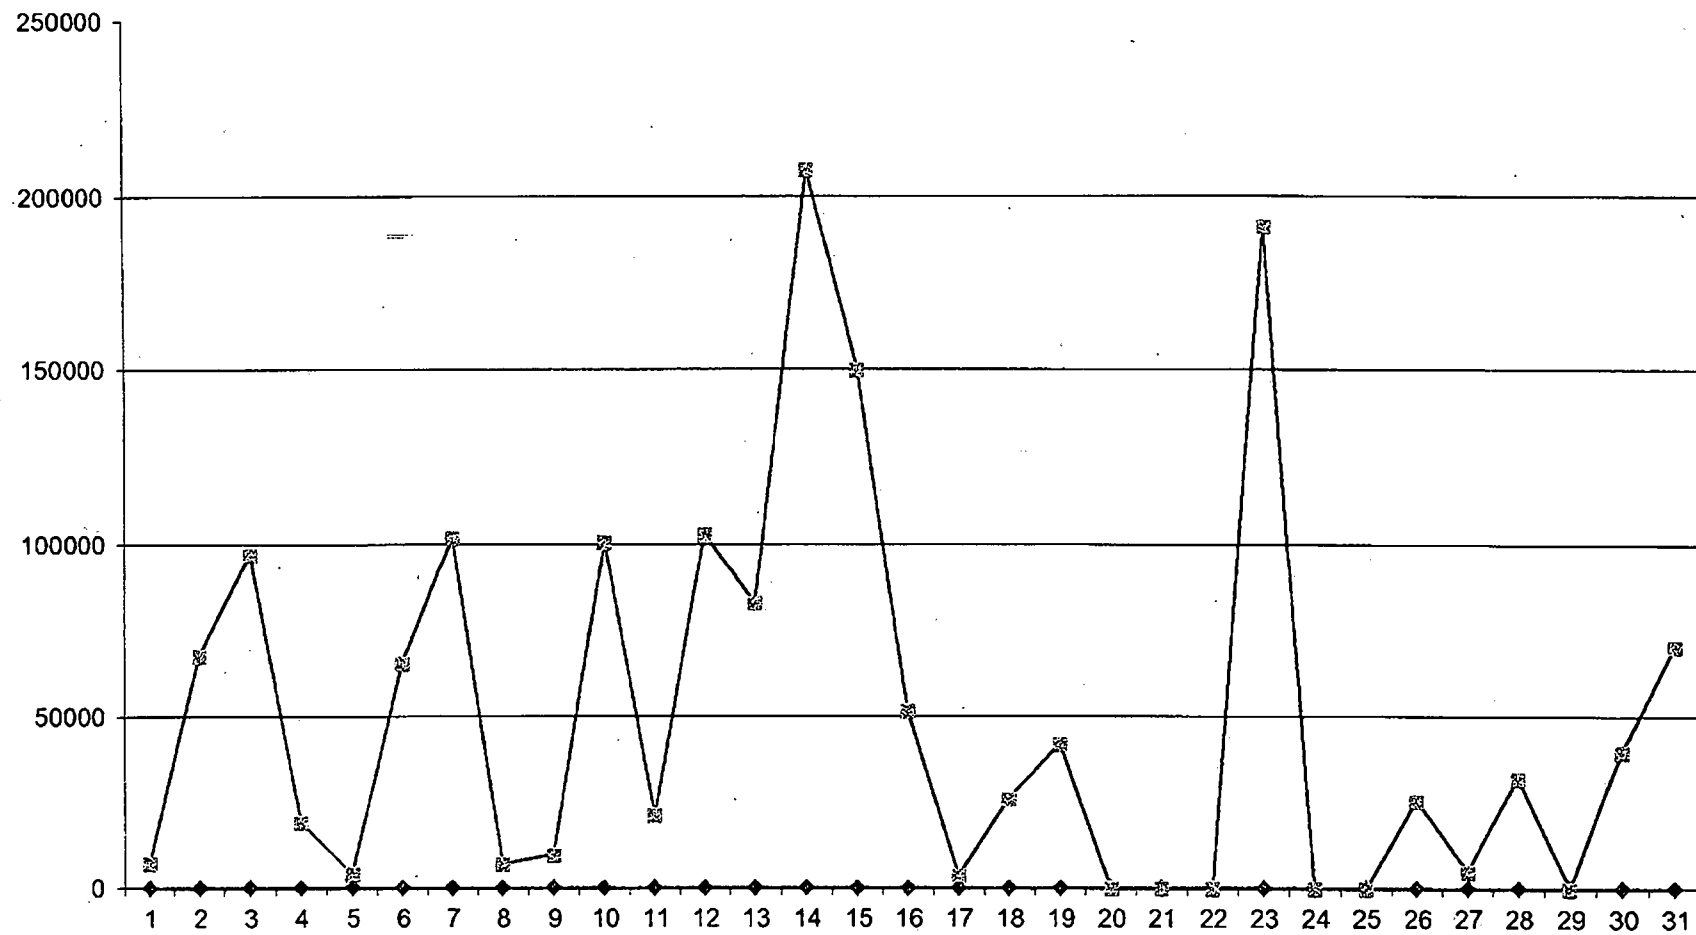

APPENDIX C

HYDRAULIC MONITORING TABLES

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JANUARY - JUNE 2013

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser) Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
GW-01D MNW	1073088.634	1117968.213	694.41	NM	696.12	D	1	3/27/2013 1421	2.80	693.32	0.00	693.32	
								5/8/2013 0947	3.48	692.64	0.00	692.64	
								6/24/2013 1621	3.17	692.95	0.00	692.95	
GW-01S MNW	1073087.779	1117961.500	694.53	NM	696.19	S	1	3/27/2013 1421	3.75	692.44	0.00	692.44	
								5/8/2013 0949	4.29	691.90	0.00	691.90	
								6/24/2013 1621	4.42	691.77	0.00	691.77	
GW-03D MNW	1073819.106	1114602.426	692.35	NM	693.88	D	1	3/27/2013 1258	2.15	691.73	0.00	691.73	
								5/8/2013 0843	2.35	691.53	0.00	691.53	
								6/24/2013 1524	2.20	691.68	0.00	691.68	
GW-03S MNW	1073812.622	1114605.762	692.61	NM	693.80	S	1	3/27/2013 1257	2.52	691.28	0.00	691.28	
								5/8/2013 0842	2.99	690.81	0.00	690.81	
								6/24/2013 1524	6.89	686.91	0.00	686.91	
GW-04D MNW	1072289.432	1114685.625	690.89	NM	692.75	D	1	3/27/2013 1432	12.95	679.80	0.00	679.80	
								5/8/2013 0957	12.88	679.87	0.00	679.87	
								6/24/2013 1628	12.91	679.84	0.00	679.84	
GW-04S MNW	1072284.456	1114685.127	690.76	NM	692.72	S	1	3/27/2013 1423	4.58	688.14	0.00	688.14	
								5/8/2013 0958	4.90	687.82	0.00	687.82	
								6/24/2013 1628	4.69	688.03	0.00	688.03	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH Manhole Monitoring Point
 MNW Monitoring Well
 SG Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JANUARY - JUNE 2013

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
GW-07D	1071242.458	1117669.925	697.15	NM	699.94	D	1						
MNW								3/27/2013 1350	48.08	651.86	0.00	651.86	
MNW								5/8/2013 1005	45.33	654.61	0.00	654.61	
MNW								6/24/2013 1611	55.57	644.37	0.00	644.37	
GW-07S	1071238.157	1117666.265	697.47	NM	699.51	S	1						
MNW								3/27/2013 1350	4.93	694.58	0.00	694.58	
MNW								5/8/2013 1005	5.3	694.21	0.00	694.21	
MNW								6/24/2013 1611	4.87	694.64	0.00	694.64	
GW-08D	1073713.617	1116795.328	695.28	NM	697.79	D	1						
MNW								3/27/2013 1315	6.12	691.67	0.00	691.67	
MNW								5/8/2013 0902	6.36	691.43	0.00	691.43	
MNW								6/24/2013 1535	6.20	691.59	0.00	691.59	
GW-08SR	1073714.172	1116786.343	695.08	NM	697.50	S	1						
MNW								3/27/2013 1315	5.31	692.19	0.00	692.19	
MNW								5/8/2013 0902	5.48	692.02	0.00	692.02	
MNW								6/24/2013 1535	5.35	692.15	0.00	692.15	
GW-26D	1071698.573	1115997.470	696.01	NM	698.50	D	1						
MNW								3/27/2013 1341	6.96	691.54	0.00	691.54	
MNW								5/8/2013 0935	7.19	691.31	0.00	691.31	
MNW								6/24/2013 1600	7.03	691.47	0.00	691.47	
GW-28S	1073129.479	1117648.927	698.60	NM	700.95	S	1						
MNW								3/27/2013 1322	9.08	691.87	0.00	691.87	
MNW								5/8/2013 0910	9.68	691.27	0.00	691.27	
MNW								6/24/2013 1542	9.23	691.72	0.00	691.72	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH Manhole Monitoring Point
 MNW Monitoring Well
 SG Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JANUARY - JUNE 2013

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
GW-29S	1072552.638	1117761.993	697.50	NM	699.63	S	1						
MNW								3/27/2013 1331	8.21	691.42	0.00	691.42	
MNW								5/8/2013 0917	9.00	690.63	0.00	690.63	
MNW								6/24/2013 1550	8.43	691.20	0.00	691.20	
GW-30S	1072096.109	1117743.563	693.67	NM	696.58	S	1						
MNW								3/27/2013 1334	7.93	688.65	0.00	688.65	
MNW								5/8/2013 0919	8.10	688.48	0.00	688.48	
MNW								6/24/2013 1551	8.04	688.54	0.00	688.54	
GW-31S	1071786.280	1117191.441	695.84	NM	698.62	S	1						
MNW								3/27/2013 1336	3.02	695.60	0.00	695.60	
MNW								5/8/2013 0924	4.65	693.97	0.00	693.97	
MNW								6/24/2013 1555	3.72	694.90	0.00	694.90	
GW-32S	1071613.793	1116364.200	696.19	NM	698.37	S	1						
MNW								3/27/2013 1338	3.07	695.30	0.00	695.30	
MNW								5/8/2013 0927	4.51	693.86	0.00	693.86	
MNW								6/24/2013 1558	3.89	694.48	0.00	694.48	
GW-33S	1072165.625	1115561.866	695.94	NM	698.24	S	1						
MNW								3/27/2013 1345	4.50	693.74	0.00	693.74	
MNW								5/8/2013 0939	6.30	691.94	0.00	691.94	
MNW								6/24/2013 1603	5.47	692.77	0.00	692.77	
GW-34S	1072979.205	1114730.200	692.51	NM	694.77	S	1						
MNW								3/27/2013 1250	2.62	692.15	0.00	692.15	
MNW								5/8/2013 0836	3.21	691.56	0.00	691.56	
MNW								6/24/2013 1518	3.33	691.44	0.00	691.44	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH Manhole Monitoring Point
 MNW Monitoring Well
 SG Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JANUARY - JUNE 2013

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
GW-35S	1071701.925	1115985.585	696.19	NM	697.39	S	1						
MNW								3/27/2013 1342	3.54	693.85	0.00	693.85	
MNW								5/8/2013 0935	4.16	693.23	0.00	693.23	
MNW								6/24/2013 1600	4.26	693.13	0.00	693.13	
MH-01	1073806.665	1114810.501	698.62	NM	698.62	NA	1						
MH								3/27/2013 1306	10.35	688.27	0.00	688.27	
MH								5/8/2013 0839	10.47	688.15	0.00	688.15	
MH								6/24/2013 1521	9.95	688.67	0.00	688.67	
MH-03	1073736.789	1115259.334	699.40	NM	699.40	NA	1						
MH								3/27/2013 1302	11.22	688.18	0.00	688.18	
MH								5/8/2013 0848	11.23	688.17	0.00	688.17	
MH								6/24/2013 1528	10.82	688.58	0.00	688.58	
MH-07	1073838.229	1116243.757	696.82	NM	696.82	NA	1						
MH								3/27/2013 1309	9.41	687.41	0.00	687.41	
MH								5/8/2013 0859	9.46	687.36	0.00	687.36	
MH								6/24/2013 1530	9.03	687.79	0.00	687.79	
MH-10	1073540.729	1117381.524	703.01	NM	703.01	NA	1						
MH								3/27/2013 1317	14.47	688.54	0.00	688.54	
MH								5/8/2013 0907	14.46	688.55	0.00	688.55	
MH								6/24/2013 1538	14.55	688.46	0.00	688.46	
MH-15	1072531.567	1117761.125	699.02	NM	699.02	NA	1						
MH								3/27/2013 1331	14.70	684.32	0.00	684.32	
MH								5/8/2013 0917	14.29	684.73	0.00	684.73	
-MH								6/24/2013 1550	14.70	684.32	0.00	684.32	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH	Manhole Monitoring Point
MNW	Monitoring Well
SG	Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JANUARY - JUNE 2013

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thck. (ft)	Corrected Water Elev. (ft)	Remark
MH-16	1072133.714	1117748.238	698.57	NM	698.57	NA	1						
MH								3/27/2013 1333	14.49	684.08	0.00	684.08	
MH								5/8/2013 0919	13.87	684.70	0.00	684.70	
MH								6/24/2013 1551	14.47	684.10	0.00	684.10	
MH-17	1071813.137	1117180.019	702.16	NM	702.16	NA	1						
MH								3/27/2013 1335	18.10	684.06	0.00	684.06	
MH								5/8/2013 0924	17.47	684.69	0.00	684.69	
MH								6/24/2013 1555	18.12	684.04	0.00	684.04	
MH-20	1071756.395	1115997.024	706.20	NM	706.20	NA	1						
MH								3/27/2013 1340	19.75	686.45	0.00	686.45	
MH								5/8/2013 0935	19.72	686.48	0.00	686.48	
MH								6/24/2013 1600	19.74	686.46	0.00	686.46	
MH-22	1072158.023	1115589.309	698.05	NM	698.05	NA	1						
MH								3/27/2013 1344	9.00	689.05	0.00	689.05	
MH								5/8/2013 0939	9.05	689.00	0.00	689.00	
MH								6/24/2013 1603	9.04	689.01	0.00	689.01	
MH-25	1072483.928	1114820.313	698.17	NM	698.17	NA	1						
MH								3/27/2013 1234	9.98	688.19	0.00	688.19	
MH								5/8/2013 0830	10.10	688.07	0.00	688.07	
MH								6/24/2013 1514	9.54	688.63	0.00	688.63	
SG-01	1073882.887	1114813.101	NM	NM	690.00	NA	1						
SG								3/27/2013 1255	-0.94	690.94	0.00	690.94	
SG								5/8/2013 0830	NM	-	NM	-	DRY
SG								6/24/2013 1521	NM	-	NM	-	DRY

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH Manhole Monitoring Point
 MNW Monitoring Well
 SG Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JANUARY - JUNE 2013

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
SG-02 SG	1073738.27	1116805.85	NM	NM	690.00	NA	1	3/27/2013 1313	-3.98	693.98	0.00	693.98	
								5/8/2013 0901	-2.90	692.90	0.00	692.90	
								6/24/2013 1534	-3.00	693.00	0.00	693.00	
WW-01 MH	1073676.903	1115710.476	NM	NM	684.02	NA	1	3/27/2013 1145	-4.0	688.02	0.00	688.02	
								5/8/2013 0730	-3.9	687.92	0.00	687.92	
								6/24/2013 1440	-4.4	688.42	0.00	688.42	
WW-02 MH	1073684.724	1116792.311	NM	NM	684.18	NA	1	3/27/2013 1145	-4.70	688.88	0.00	688.88	
								5/8/2013 0730	-4.7	688.88	0.00	688.88	
								6/24/2013 1440	-4.6	688.78	0.00	688.78	
WW-03 MH	1073140.339	1117618.499	NM	NM	683.80	NA	1	3/27/2013 1145	-4.75	688.55	0.00	688.55	
								5/8/2013 0852	-4.13	687.93	0.00	687.93	
								6/24/2013 1440	-4.58	688.38	0.00	688.38	
WW-04 MH	1072057.563	1117610.508	NM	NM	676.62	NA	1	3/27/2013 1145	-7.0	683.62	0.00	683.62	
								5/8/2013 0730	-7.6	684.22	0.00	684.22	
								6/24/2013 1440	-7.0	683.62	0.00	683.62	
WW-05 MH	1071661.368	1116370.876	NM	NM	676.14	NA	1	3/27/2013 1145	-6.6	682.74	0.00	682.74	
								5/8/2013 0931	-8.58	684.72	0.00	684.72	
								6/24/2013 1440	-6.8	682.94	0.00	682.94	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH
MNW
SG

Manhole Monitoring Point
Monitoring Well
Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JANUARY - JUNE 2013

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
WW-06	1072988.420	1114811.518	NM	NM	681.89	NA	1						
MH								3/27/2013 1145	-6.9	688.79	0.00	688.79	
MH								5/8/2013 0730	-6.5	688.39	0.00	688.39	
MH								6/24/2013 1440	-7.0	688.89	0.00	688.89	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH	Manhole Monitoring Point
MNW	Monitoring Well
SG	Staff Gauge

**TABLE 2
PFOHL BROTHERS LANDFILL SITE
OVERBURDEN HYDRAULIC GRADIENT**

WELL PAIR:	WW-1	*	Level	WW-2	GW-8SR	Level	SG-02	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft)
3/27/2013	688.02	---	---	688.88	692.19	3.31	693.98	5.10
5/8/2013	687.92	---	---	688.88	692.02	3.14	692.90	4.02
6/24/2013	688.42	---	---	688.78	692.15	3.37	693.00	4.22

WELL PAIR:	WW-3	GW-28S	Level	WW-4	*	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)
3/27/2013	688.55	691.87	3.32	683.62	---	---
5/8/2013	687.93	691.27	3.34	684.22	---	---
6/24/2013	688.38	691.72	3.34	683.62	---	---

WELL PAIR:	WW-5	GW-32S	Level	WW-6	GW-34S	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)
3/27/2013	682.74	695.30	12.56	688.79	692.15	3.36
5/8/2013	684.72	693.86	9.14	688.39	691.56	3.17
6/24/2013	682.94	694.48	11.54	688.89	691.44	2.55

WELL PAIR:	MH-1	SG-1	Level	MH-15	GW-29S	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)
3/27/2013	688.27	690.94	2.67	684.32	691.42	7.10
5/8/2013	688.15	DRY	NA	684.73	690.63	5.90
6/24/2013	688.67	DRY	NA	684.32	691.20	6.88

WELL PAIR:	MH-16	GW-30S	Level	MH-17	GW-31S	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)
3/27/2013	684.08	688.65	4.57	684.06	695.60	11.54
5/8/2013	684.70	688.48	3.78	684.69	693.97	9.28
6/24/2013	684.10	688.54	4.44	684.04	694.90	10.86

WELL PAIR:	MH-20	GW-35S	Level	MH-22	GW-33S	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)
3/27/2013	686.45	693.85	7.40	689.05	693.74	4.69
5/8/2013	686.48	693.23	6.75	689.00	691.94	2.94
6/24/2013	686.46	693.13	6.67	689.01	692.77	3.76

Notes:

* = No corresponding monitoring well.
NA = Not applicable

APPENDIX D

**GROUNDWATER PURGE AND SAMPLE COLLECTION
LOGS**

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-1S

Date: 5/10/2013 Sampling Personnel: Rob Murphy, Tim Ifkovich Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	3.88'	Depth to Well Bottom:	14.94'	Well Diameter:	2"	Screen Length:	
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------	--

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	6.8	Purge Volume (liters):	8.6
--------------	-----------------	-----------------------------------	-----	------------------------	-----

Sample ID:	GW-1S	Sample Time:	14:42	QA/QC:	None
------------	-------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information: Riser pipe is bulged inwards, could not remove stainless steel bailer from within well, sampled around it.
Orange stain in water initially.

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($v_{QH} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-1D

Date: 5/10/2013 Sampling Personnel: Rob Murphy, Tim Ifkovich Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.85'	Depth to Well Bottom:	39.65'	Well Diameter:	4"	Screen Length:	
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------	--

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	90.9	Estimated Purge Volume (liters):	66.0
--------------	-----------------	-----------------------------------	------	----------------------------------	------

Sample ID:	GW-1D	Sample Time:	13:59	QA/QC:	None
------------	-------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information: Sulfur odor

PURGE PARAMETERS

	TIME	pH	TEMP (°C)	COND. (mS/cm)	DISS. O ₂ (mg/l)	TURB. (NTU)	ORP (mV)	FLOW RATE (ml/min.)	DEPTH TO WATER (btor)
	12:53	7.12	12.93	1.13	0.00	1.4	-116	1000	2.85
	12:58	7.15	11.70	1.14	0.00	0.0	-129	1000	2.91
	13:03	6.95	11.45	1.14	0.00	0.0	-122	1000	2.91
	13:08	6.90	11.35	1.14	0.00	0.0	-120	1000	2.91
	13:13	6.83	11.25	1.14	0.00	0.0	-119	1000	2.91
	13:18	6.74	11.23	1.14	0.00	0.0	-122	1000	2.91
	13:23	6.86	11.17	1.14	0.00	0.0	-154	1000	2.91
	13:28	6.97	11.16	1.14	0.00	0.0	-167	1000	2.91
	13:33	7.07	11.26	1.14	0.00	0.0	-185	1000	2.91
	13:38	7.10	11.14	1.13	0.00	0.0	-197	1000	2.91
	13:43	7.10	11.18	1.14	0.00	0.0	-207	1000	2.91
	13:48	7.16	11.09	1.13	0.00	0.0	-216	1000	2.91
	13:53	7.13	11.12	1.13	0.00	0.0	-222	1000	2.91
	13:56	7.12	11.13	1.13	0.00	0.0	-225	1000	2.91
	13:59	7.12	11.17	1.14	0.00	0.0	-228	1000	2.91
Tolerance:	0.1	---	3%	10%	10%	+ or - 10	---		

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vol_c = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-3S

Date: 5/8/2013 Sampling Personnel: Rob Murphy, Tim Ifkovich Company: URS Corporation

Purging/
Sampling
Device: Geopump 2 Tubing Type: LDPE/Silicone Pump/Tubing
Inlet
Location: Screen midpoint

Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.99'	Depth to Well Bottom:	13.22'	Well Diameter:	2"	Screen Length:	
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------	--

Casing Type:	<u>Stainless Steel</u>	Volume in 1 Well Casing (liters):	<u>6.3</u>	Estimated Purge Volume (liters):	<u>7.4</u>
--------------	------------------------	-----------------------------------	------------	----------------------------------	------------

Sample ID:	GW-3S	Sample Time:	12:50	QA/QC:	None
------------	-------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($v_{qt} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-3D

Date: 5/8/2013 Sampling Personnel: Rob Murphy, Tim Ifkovich Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.35'	Depth to Well Bottom:	35.70'	Well Diameter:	4"	Screen Length:	
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------	--

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	82.4	Estimated Purge Volume (liters):	60.0
--------------	-----------------	-----------------------------------	------	----------------------------------	------

Sample ID:	GW-3D	Sample Time:	14:15	QA/QC:	MS/MSD
------------	-------	--------------	-------	--------	--------

Sample Parameters: VOCs, SVOCs, and TAL Metals

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vq_d = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-4S
Date: 5/9/2013 Sampling Personnel: Rob Murphy, Tim Iľkovich Company: URS Corporation

Purging/ Sampling Device:	Geopump 2		Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint			
Measuring Point:	Below Top of Riser	Initial Depth to Water:	4.90'	Depth to Well Bottom:	16.23'	Well Diameter:	2"	Screen Length:	
Casing Type:	Stainless Steel		Volume in 1 Well Casing (liters):	7.0	Estimated Purge Volume (liters):	15.1			

Sample ID:	GW-4S	Sample Time:	11:45 VOCs/ 13:30 SVOCs & Metals	QA/QC:	None
------------	-------	--------------	-------------------------------------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information: Placed passive diffusion bag (PDB) in well 3/27/13, sampled VOCs from PDB at 11:45 on 5/9/13.
Well historically goes dry at very low purge rates (<75ml/min). Bailed dry and sampled for SVOCs and
Metals after recovery at 13:30.

PURGE PARAMETERS

	TIME	pH	TEMP (°C)	COND. (mS/cm)	DISS. O ₂ (mg/l)	TURB. (NTU)	ORP (mV)	FLOW RATE (ml/min.)	DEPTH TO WATER (btor)
	11:47	7.79	13.69	0.497	2.76	29.1	99	Initial	4.90
	11:50	7.68	11.25	0.490	1.67	212	94	2 Gal. Purged	-
	11:53	7.51	10.68	0.490	1.45	642	39	4 Gal. Purged	Dry
								/	
Tolerance:	0.1	---	3%	10%	10%	+ or - 10	---		

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vol_w = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-4D

Date: 5/9/2013 Sampling Personnel: Tim Ifkovich, Kevin McGovern Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	12.79'	Depth to Well Bottom:	45.57'	Well Diameter:	4"	Screen Length:	
------------------	--------------------	-------------------------	--------	-----------------------	--------	----------------	----	----------------	--

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	81.0	Estimated Purge Volume (liters):	10.8
--------------	-----------------	-----------------------------------	------	----------------------------------	------

Sample ID:	GW-4D	Sample Time:	13:09	QA/QC:	None
------------	-------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vq_m = \pi r^2 h$)

WELL PURGING LOG

URS Corporation

SITE NAME: Pfohl Brothers Landfill WELL NO.: GW-7S
 PROJECT NO.: 11175616.00000
 STAFF: Rob Murphy, Tim Ifkovich
 DATE(S): 5/8/13, 5/9/13

1. TOTAL CASING AND SCREEN LENGTH (FT.)	=	<u>35.04</u>	WELL ID.	VOL. (GAL/FT)
2. WATER LEVEL BELOW TOP OF CASING (FT.)	=	<u>5.30</u>	1"	0.040
3. NUMBER OF FEET STANDING WATER (#1 - #2)	=	<u>29.74</u>	2"	0.17
4. VOLUME OF WATER/FOOT OF CASING (GAL.)	=	<u>0.17</u>	3"	0.38
5. VOLUME OF WATER IN CASING (GAL.)(#3 x #4)	=	<u>5.1</u>	4"	0.66
6. VOLUME OF WATER TO REMOVE (GAL.)(#5 x 3)	=		5"	1.04
7. VOLUME OF WATER ACTUALLY REMOVED (GAL.)	=	<u>7.5</u>	6"	1.50
			7"	
			8"	2.60

V=0.0408 x (CASING DIAMETER [INCHES])²

PARAMETERS	ACCUMULATED VOLUME PURGED (GALLONS)									
	Initial	2	3	4	5	7				
pH	8.66	8.31	7.89	7.46	7.25	7.47				
SPEC. COND. (mS/cm)	0.626	0.599	0.600	0.601	0.603	0.584				
DO (mg/l)	6.02	4.62	4.60	6.55	2.39	2.74				
TEMPERATURE (°C)	13.11	12.27	11.89	12.41	12.82	14.12				
TURBIDITY (NTU)	20.6	18.9	21.4	37.8	131	225				
ORP (millivolts)	68	57	56	69	56	36				
TIME	10:29	10:33	10:35	10:37	10:39	10:43				

COMMENTS: 10:15 - Fill VOCs from passive diffusion bag (PDB), PDB was installed on 3/27/13
 10:29 - Begin handbailing well.
 10:43 - Well dry after removing 7 gallons.
 5/9/2013 11:00 - Return to well, depth to water = 5.35 feet.
 11:05 - Collect sample for SVOCs and Metals.

WELL PURGING LOG

URS Corporation

SITE NAME: Pfohl Brothers Landfill WELL NO.: GW-7D
 PROJECT NO.: 11175616.00000
 STAFF: Rob Murphy, Tim Ifkovich
 DATE(S): 5/8/13, 5/9/13

			WELL ID.	VOL. (GAL/FT)
1. TOTAL CASING AND SCREEN LENGTH (FT.)	=	<u>60.45</u>	1"	0.040
2. WATER LEVEL BELOW TOP OF CASING (FT.)	=	<u>45.33</u>	2"	0.17
3. NUMBER OF FEET STANDING WATER (#1 - #2)	=	<u>15.12</u>	3"	0.38
4. VOLUME OF WATER/FOOT OF CASING (GAL.)	=	<u>0.66</u>	4"	<u>0.66</u>
5. VOLUME OF WATER IN CASING (GAL.)(#3 x #4)	=	<u>10.0</u>	5"	1.04
6. VOLUME OF WATER TO REMOVE (GAL.)(#5 x 3)	=	<u> </u>	6"	1.50
7. VOLUME OF WATER ACTUALLY REMOVED (GAL.)	=	<u>10.0</u>	8"	2.60

$V=0.0408 \times (\text{CASING DIAMETER [INCHES]})^2$

PARAMETERS	ACCUMULATED VOLUME PURGED (GALLONS)									
	Init	2	4	6	8	10				
pH	7.24	7.33	7.30	7.35	7.30	7.68				
SPEC. COND. (mS/cm)	0.820	0.690	0.738	0.770	0.810	0.826				
DO (mg/l)	0.00	1.46	1.93	2.22	1.80	3.55				
TEMPERATURE (°C)	14.74	14.26	14.20	14.29	14.07	14.61				
TURBIDITY (NTU)	11.5	13.8	15.0	17.7	20.2	56.3				
ORP (millivolts)	-84	-77	-75	-79	-94	-93				
TIME	11:00	11:07	11:13	11:19	11:24	11:31				

COMMENTS: 10:25 - Fill VOCs from passive diffusion bag (PDB), PDB was installed on 3/27/13
 11:00 - Begin handbailing well.
 11:31 - Well dry after removing 10 gallons
 5/9/2013 10:50 - return to well, depth to water = 59.13 feet.
 10:55 - Collect sample for SVOCs and Metals, only enough volume to fill 1 metals container and 1-1 liter Amber container.

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-8SR

Date: 5/8/2013 Sampling Personnel: Rob Murphy, Tim Ifkovich Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	5.48'	Depth to Well Bottom:	13.02'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	4.7	Estimated Purge Volume (liters):	5.6
--------------	-----------------	-----------------------------------	-----	----------------------------------	-----

Sample ID:	GW-8SR	Sample Time:	16:33	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vq_{w1} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-8D
Date: 5/8/2013 Sampling Personnel: Rob Murphy, Tim Ifkovich Company: URS Corporation

Purging/ Sampling Device:	Geopump 2		Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint	
Measuring Point:	Below Top of Riser	Initial Depth to Water:	6.36'	Depth to Well Bottom:	36.54'	Well Diameter:	4"
							Screen Length:
Casing Type:	Stainless Steel		Volume in 1 Well Casing (liters):	74.5	Estimated Purge Volume (liters):	57.0	

Sample ID:	GW-8D	Sample Time:	15:50	QA/QC:	Duplicate (FD-050813)
------------	-------	--------------	-------	--------	-----------------------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vql_1 = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-26D
Date: 5/9/2013 Sampling Personnel: Rob Murphy, Tim Ifkovich Company: URS Corporation

Purging/ Sampling Device:	Geopump 2		Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint			
Measuring Point:	Below Top of Riser	Initial Depth to Water:	6.92'	Depth to Well Bottom:	40.70'	Well Diameter:	4"	Screen Length:	
Casing Type:	Stainless Steel		Volume in 1 Well Casing (liters):	83.4	Estimated Purge Volume (liters):	56.4			

Sample ID:	GW-26D	Sample Time:	14:58	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

Occasional pulses of iron stained particulates in purge water.

PURGE PARAMETERS

	TIME	pH	TEMP (°C)	COND. (mS/cm)	DISS. O ₂ (mg/l)	TURB. (NTU)	ORP (mV)	FLOW RATE (ml/min.)	DEPTH TO WATER (btor)
	13:58	7.24	13.11	2.41	0.53	588	-85	940	6.92
	14:03	6.88	12.77	2.43	0.00	242	-78	940	6.92
	14:08	6.69	12.46	2.44	0.00	76.4	-70	940	6.92
	14:13	6.62	12.47	2.44	0.00	27.2	-68	940	6.92
	14:18	6.50	12.47	2.44	0.00	0.0	-62	940	6.92
	14:23	6.35	12.43	2.44	0.00	0.0	-57	940	6.92
	14:28	6.33	12.43	2.44	0.00	0.0	-57	940	6.92
	14:33	6.31	12.44	2.44	0.00	0.0	-56	940	6.92
	14:38	6.28	12.45	2.44	0.00	0.0	-55	940	6.92
	14:43	6.31	12.45	2.44	0.00	0.0	-58	940	6.92
	14:48	6.40	12.44	2.44	0.00	0.0	-62	940	6.92
	14:53	6.45	12.43	2.44	0.00	0.0	-65	940	6.92
	14:58	6.46	12.51	2.44	0.00	0.0	-66	940	6.92
Tolerance:	0.1	--	3%	10%	10%	+ or - 10	--		

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vol_c = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-28S

Date: 5/9/2013 Sampling Personnel: Rob Murphy, Tim Ifkovich Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet: Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	------------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	9.67'	Depth to Well Bottom:	15.52'	Well Diameter:	2"	Screen Length:	
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------	--

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	3.6	Purge Volume (liters):	<u>8.8</u>
--------------	-----------------	-----------------------------------	-----	------------------------	------------

Sample ID: GW-28S Sample Time: 9:14 QA/QC: None

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($v_{qt} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-29S
Date: 5/9/2013 Sampling Personnel: Rob Murphy, Tim Ifkovich Company: URS Corporation

Purging/ Sampling Device:	Geopump 2		Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint			
Measuring Point:	Below Top of Riser	Initial Depth to Water:	8.89'	Depth to Well Bottom:	20.04'	Well Diameter:	2"	Screen Length:	
Casing Type:	Stainless Steel		Volume in 1 Well Casing (liters):	6.9	Estimated Purge Volume (liters):	8.0			

Sample ID:	GW-29S	Sample Time:	16:51	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

Orange iron particulates at start of purge

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($v_{\text{well}} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-30S
Date: 5/10/2013 Sampling Personnel: Rob Murphy, Tim Ifkovich Company: URS Corporation

Purging/ Sampling Device:	Geopump 2		Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint			
Measuring Point:	Below Top of Riser	Initial Depth to Water:	8.05'	Depth to Well Bottom:	17.97'	Well Diameter:	2"	Screen Length:	
Casing Type:	Stainless Steel		Volume in 1 Well Casing (liters):	6.1	Estimated Purge Volume (liters):	21.0			

Sample ID:	GW-30S	Sample Time:	8:46	QA/QC:	None
------------	--------	--------------	------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($v_{q1} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-31S

Date: 5/10/2013 Sampling Personnel: Rob Murphy, Tim Ifkovich Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	4.21'	Depth to Well Bottom:	9.57'	Well Diameter:	2"	Screen Length:	
------------------	--------------------	-------------------------	-------	-----------------------	-------	----------------	----	----------------	--

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	3.3	Purge Volume (liters):	3.7
--------------	-----------------	-----------------------------------	-----	------------------------	-----

Sample ID:	GW-31S	Sample Time:	9:31	QA/QC:	None
------------	--------	--------------	------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vol_w = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-32S

Date: 5/10/2013 Sampling Personnel: Rob Murphy, Tim Ifkovich Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	4.11'	Depth to Well Bottom:	9.93'	Well Diameter:	2"	Screen Length:	
------------------	--------------------	-------------------------	-------	-----------------------	-------	----------------	----	----------------	--

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	3.6	Purge Volume (liters):	6.9
--------------	-----------------	-----------------------------------	-----	------------------------	-----

Sample ID:	GW-32S	Sample Time:	10:39	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals
Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vq_{d_i} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-33S
Date: 5/10/2013 Sampling Personnel: Rob Murphy, Tim Ifkovich Company: URS Corporation

Purging/ Sampling Device:	Geopump 2		Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint			
Measuring Point:	Below Top of Riser	Initial Depth to Water:	5.52'	Depth to Well Bottom:	8.21'	Well Diameter:	2"	Screen Length:	
Casing Type:	Stainless Steel		Volume in 1 Well Casing (liters):	1.7	Estimated Purge Volume (liters):	6.9			

Sample ID:	GW-33S	Sample Time:	11:59	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

TIME	pH	TEMP (°C)	COND. (mS/cm)	DISS. O ₂ (mg/l)	TURB. (NTU)	ORP (mV)	FLOW RATE (ml/min.)	DEPTH TO WATER (btor)
11:04	6.84	12.74	0.714	0.00	0.8	110	220	5.52
11:09	6.82	12.36	0.680	0.00	2.0	107	115	6.48
11:14	6.66	12.84	0.712	0.00	0.6	119	115	6.58
11:19	6.63	13.19	0.683	0.00	0.0	118	115	6.67
11:24	6.65	13.32	0.659	0.00	0.0	113	115	6.76
11:29	6.67	13.62	0.676	0.00	0.0	107	115	6.84
11:34	6.68	13.98	0.715	0.00	0.0	100	115	6.91
11:39	6.74	14.05	0.668	0.00	0.0	92	115	6.98
11:44	6.79	14.27	0.662	0.00	0.0	85	115	7.04
11:49	6.83	14.67	0.661	0.00	0.0	79	115	7.12
11:54	6.84	14.81	0.672	0.00	0.0	74	115	7.18
11:59	6.84	15.11	0.671	0.00	0.0	72	115	7.24
Tolerance:	0.1	--	3%	10%	10%	+ or - 10	--	

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vq_d = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-34S
Date: 5/9/2013 Sampling Personnel: Rob Murphy, Tim Ifkovich Company: URS Corporation

Purging/ Sampling Device:	Geopump 2		Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint	
Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.70'	Depth to Well Bottom:	10.01'	Well Diameter:	2"
							Screen Length:
Casing Type:	Stainless Steel		Volume in 1 Well Casing (liters):	4.5	Estimated Purge Volume (liters):	5.4	

Sample ID:	GW-34S	Sample Time:	10:24	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($v_{qt} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-35S

Date: 5/9/2013 Sampling Personnel: Rob Murphy, Tim Ifkovich Company: URS Corporation

Purging/ Sampling Device:	Geopump 2		Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint			
Measuring Point:	Below Top of Riser	Initial Depth to Water:	4.16'	Depth to Well Bottom:	7.46'	Well Diameter:	2"	Screen Length:	
Casing Type:	Stainless Steel		Volume in 1 Well Casing (liters):	2.0	Estimated Purge Volume (liters):	6.4			

Sample ID:	GW-35S	Sample Time:	15:39	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vq_d = \pi r^2 h$)

APPENDIX E

GROUNDWATER TREND ANALYSIS

FIGURE E-1
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-01D

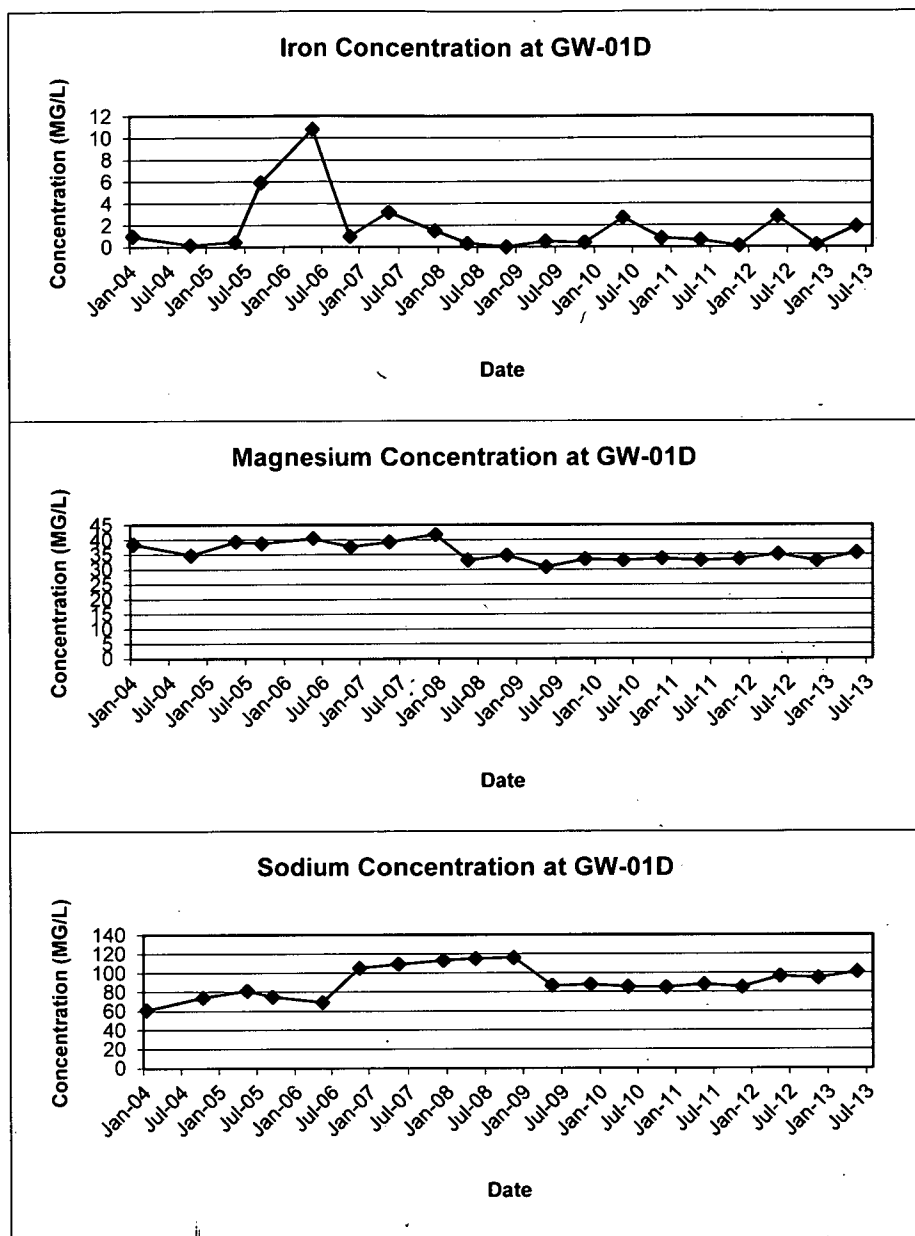


FIGURE E-2
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-1S

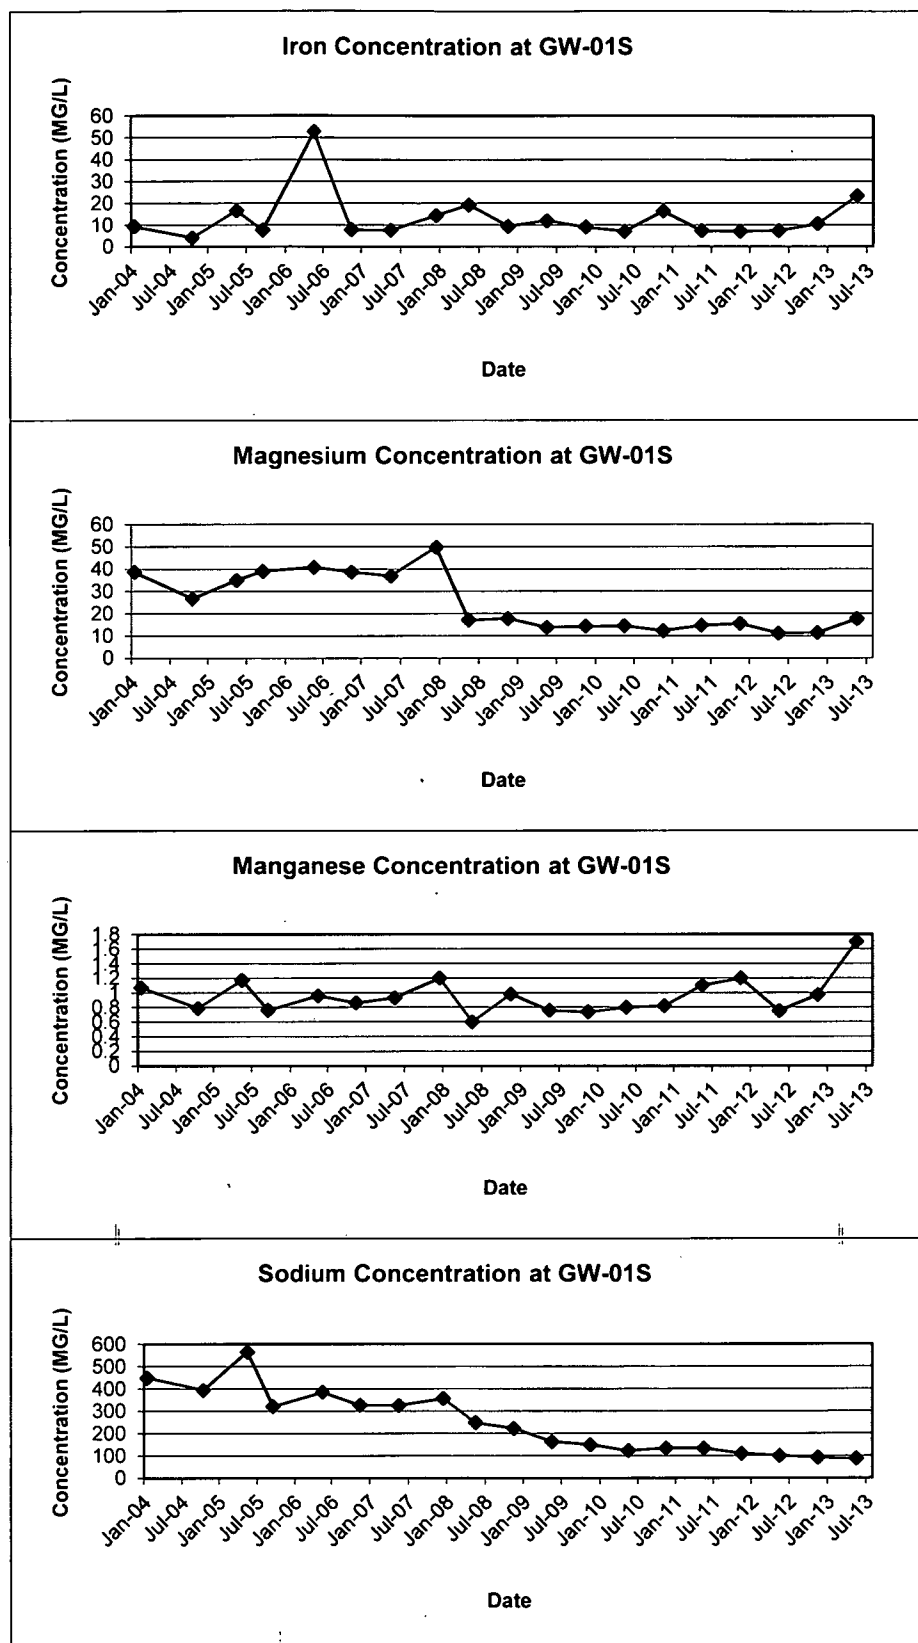


FIGURE E-3
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-3D

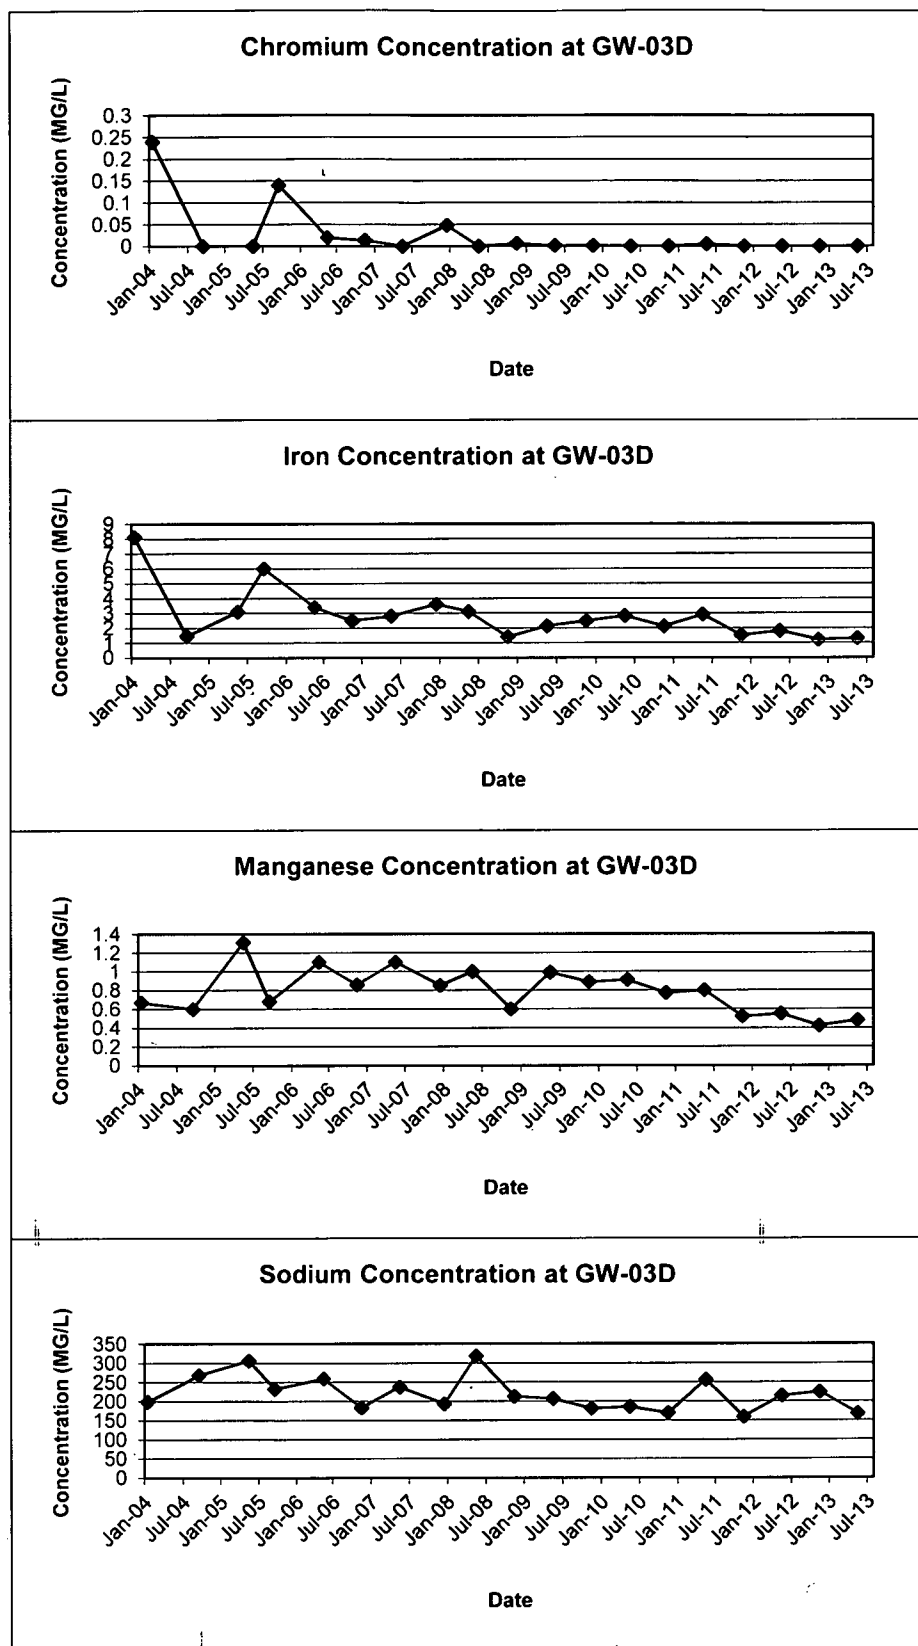


FIGURE E-4
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-03S

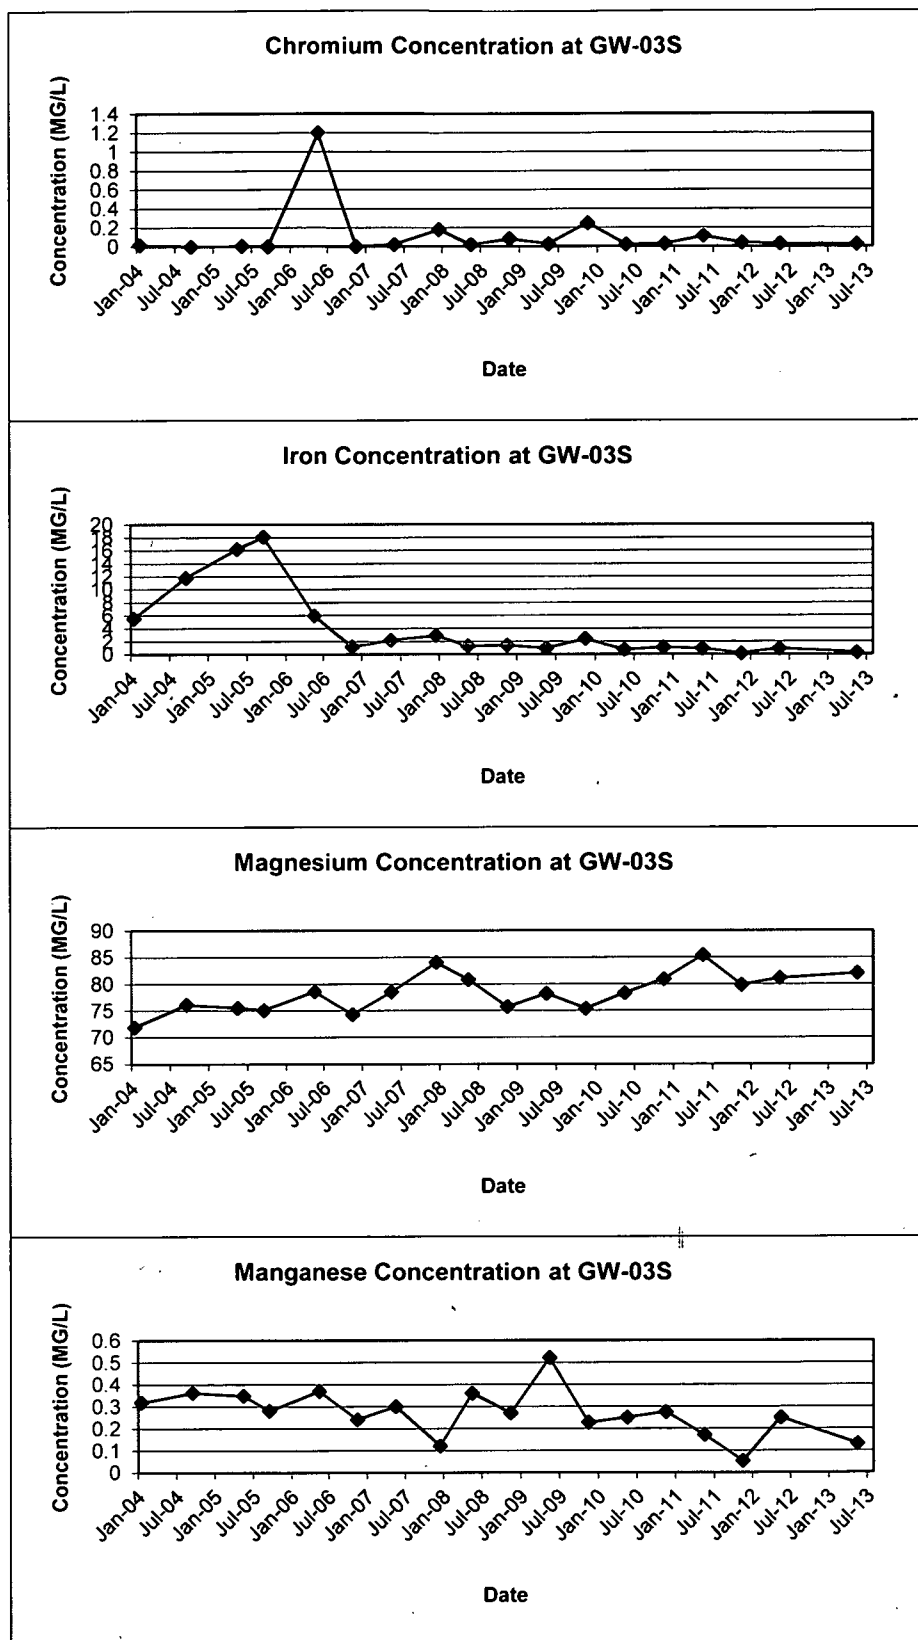


FIGURE E-4
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-3S

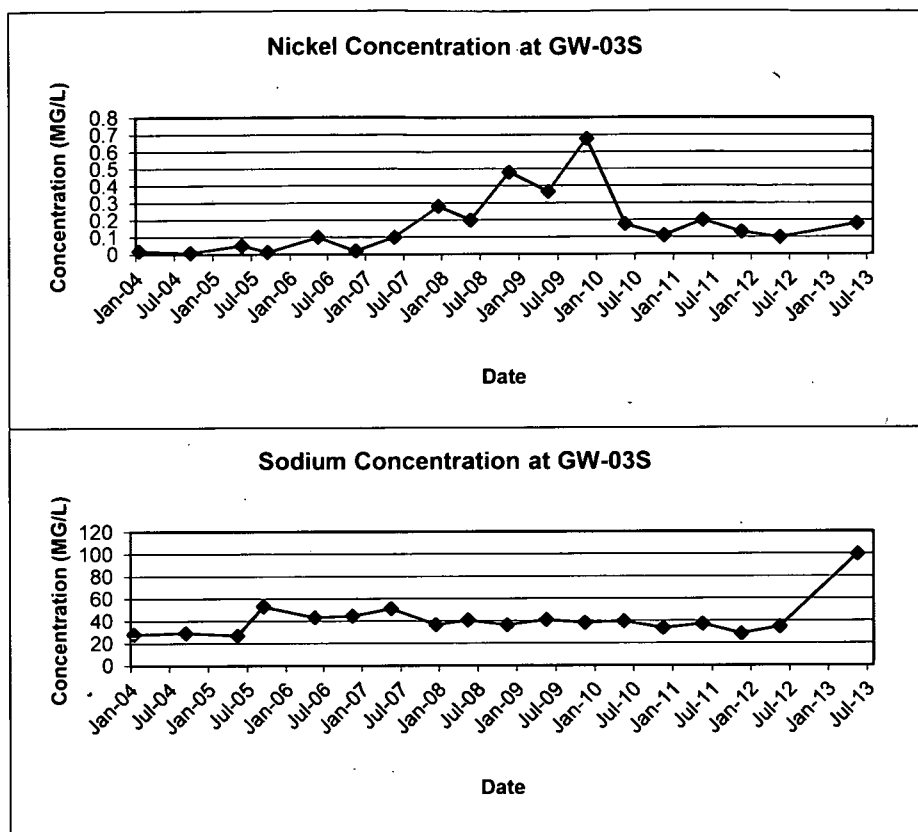


FIGURE E-5
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-04D

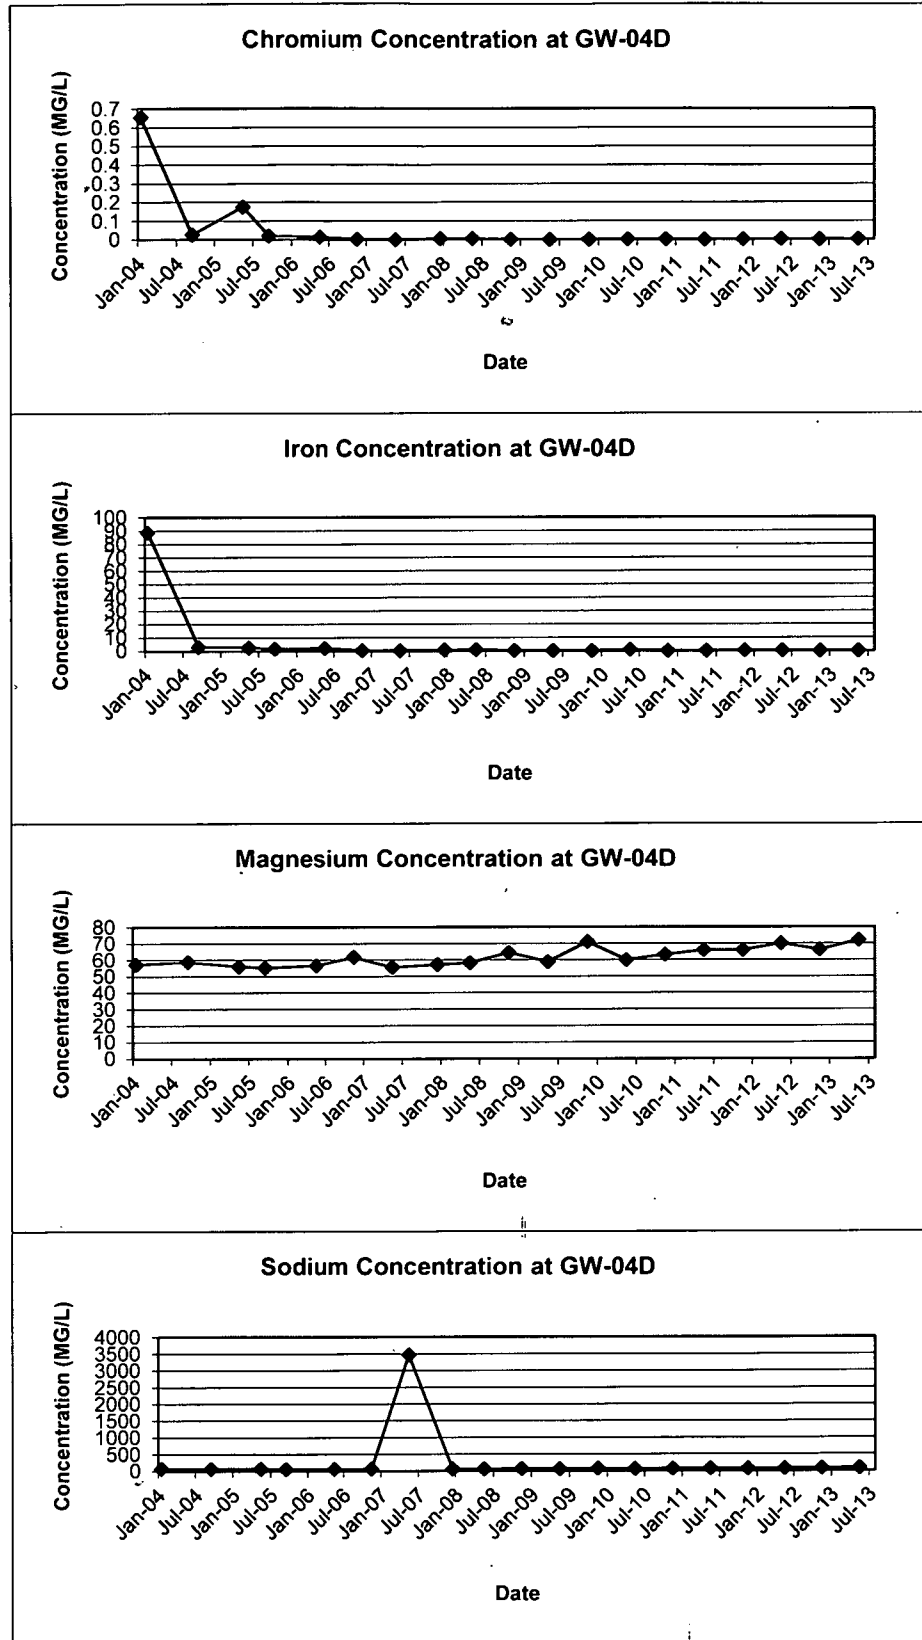


FIGURE E-6
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-4S

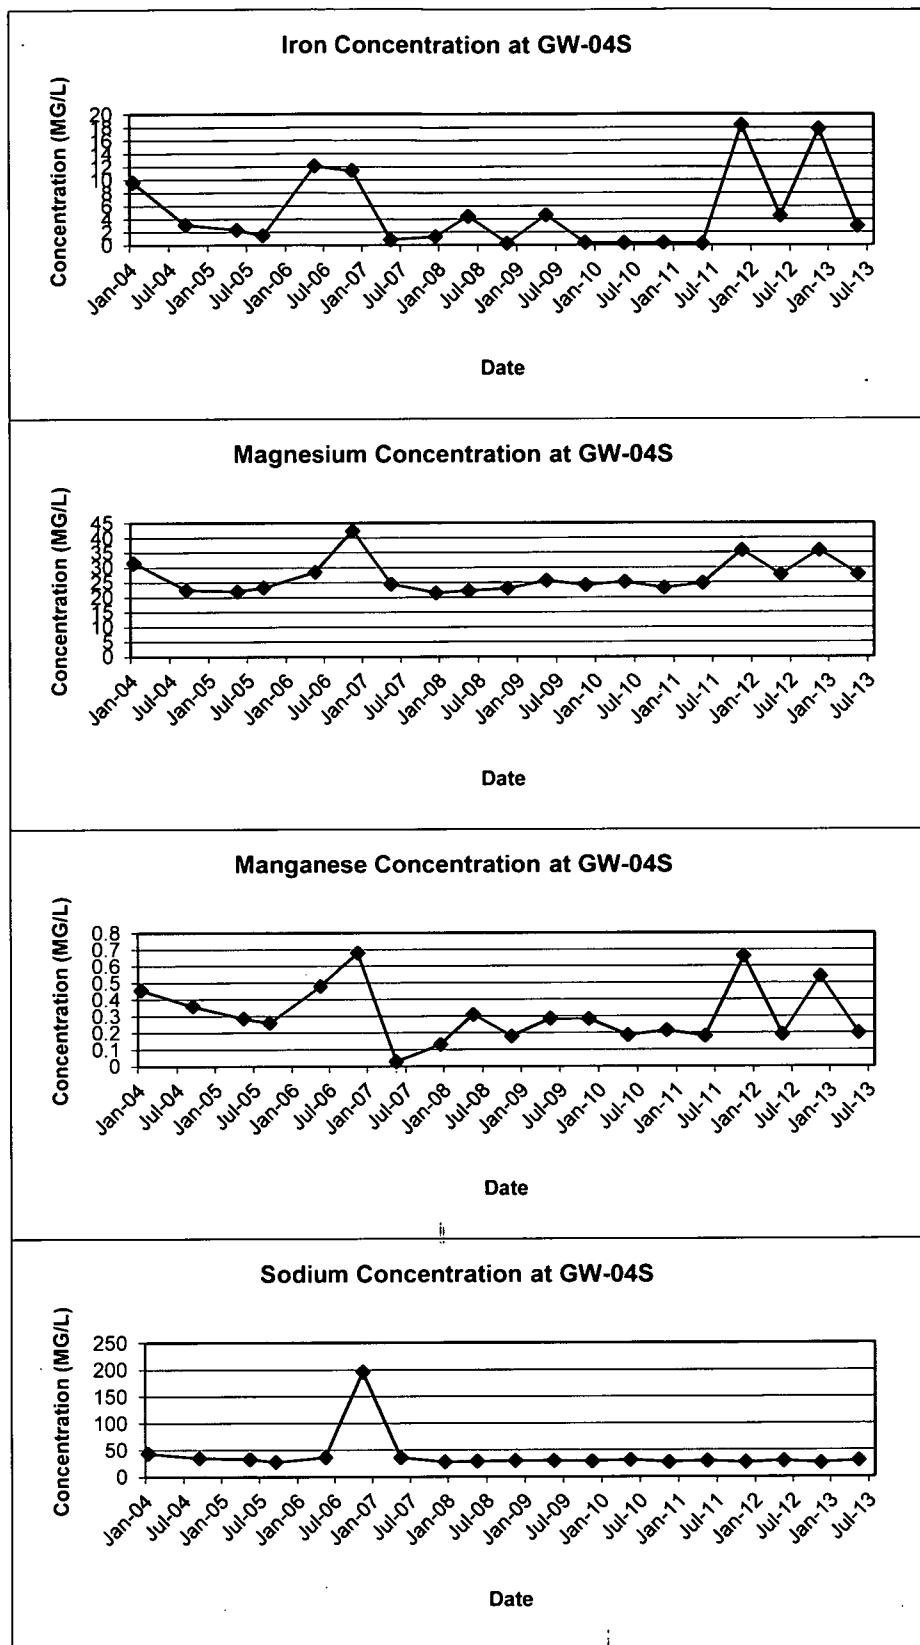


FIGURE E-7
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-7D

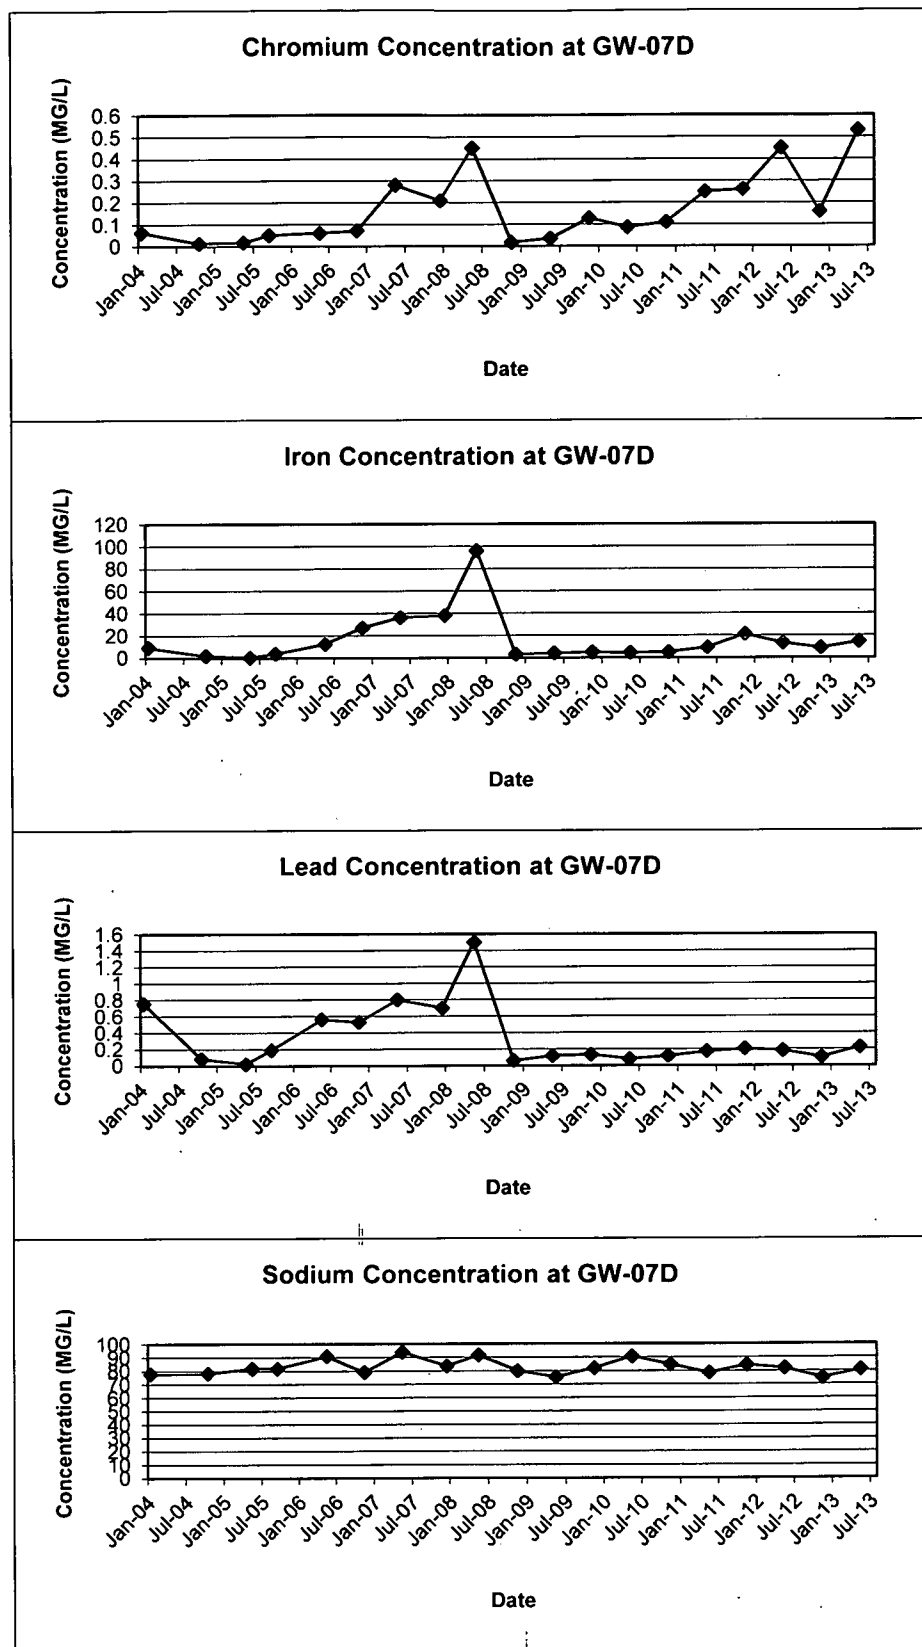


FIGURE E-8
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-7S

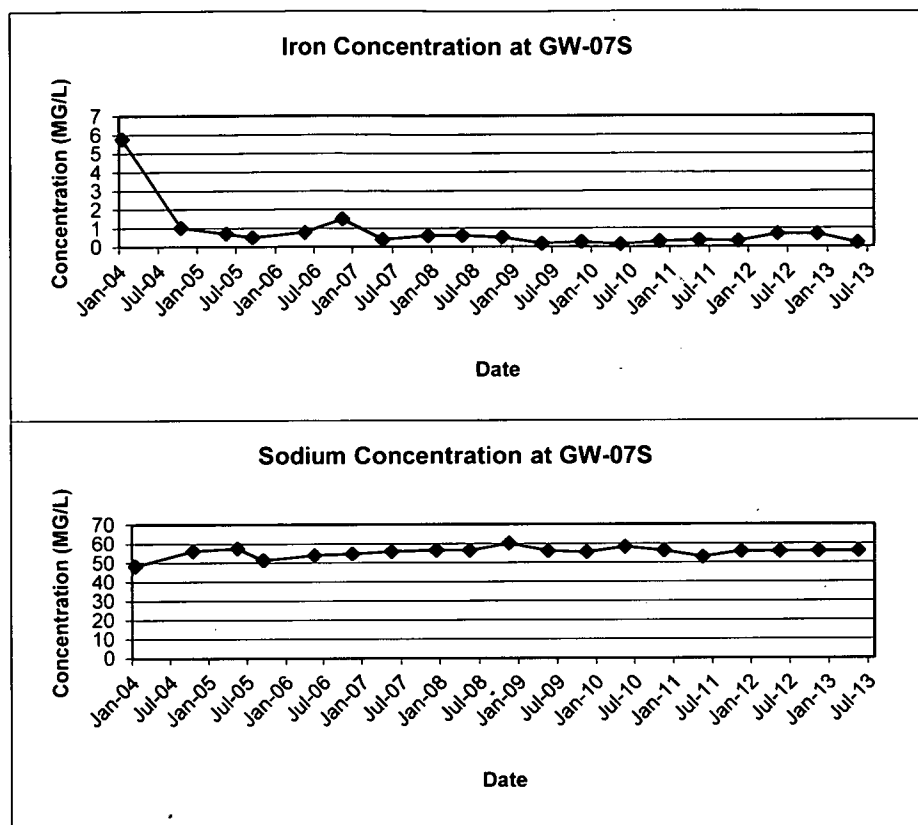


FIGURE E-9
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-8D

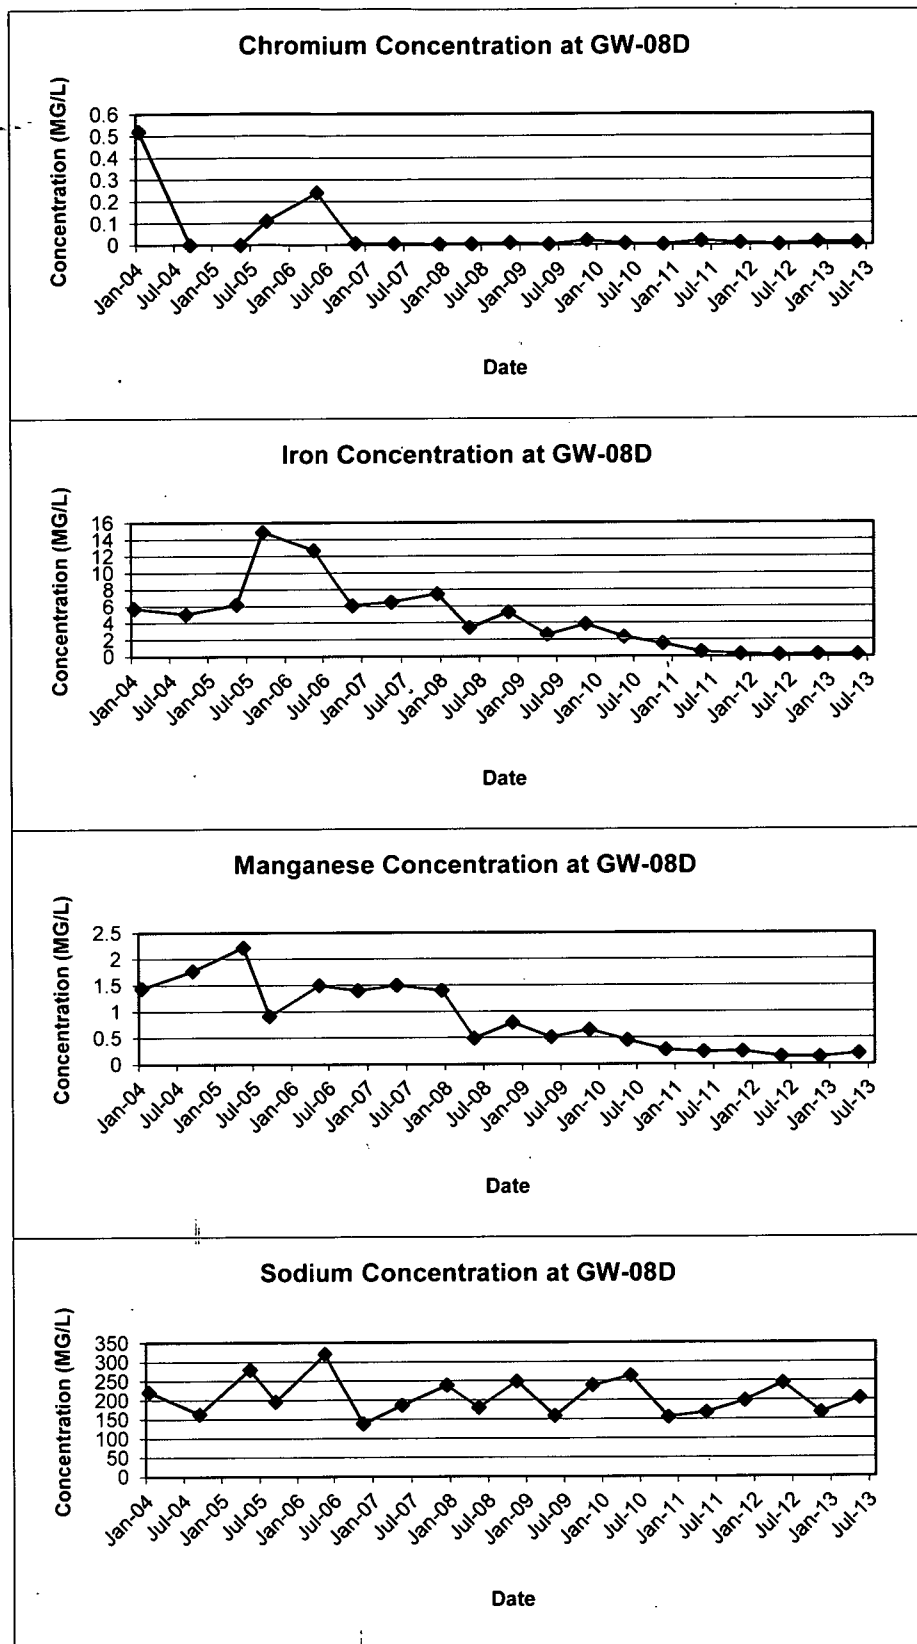


FIGURE E-10
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-08SR

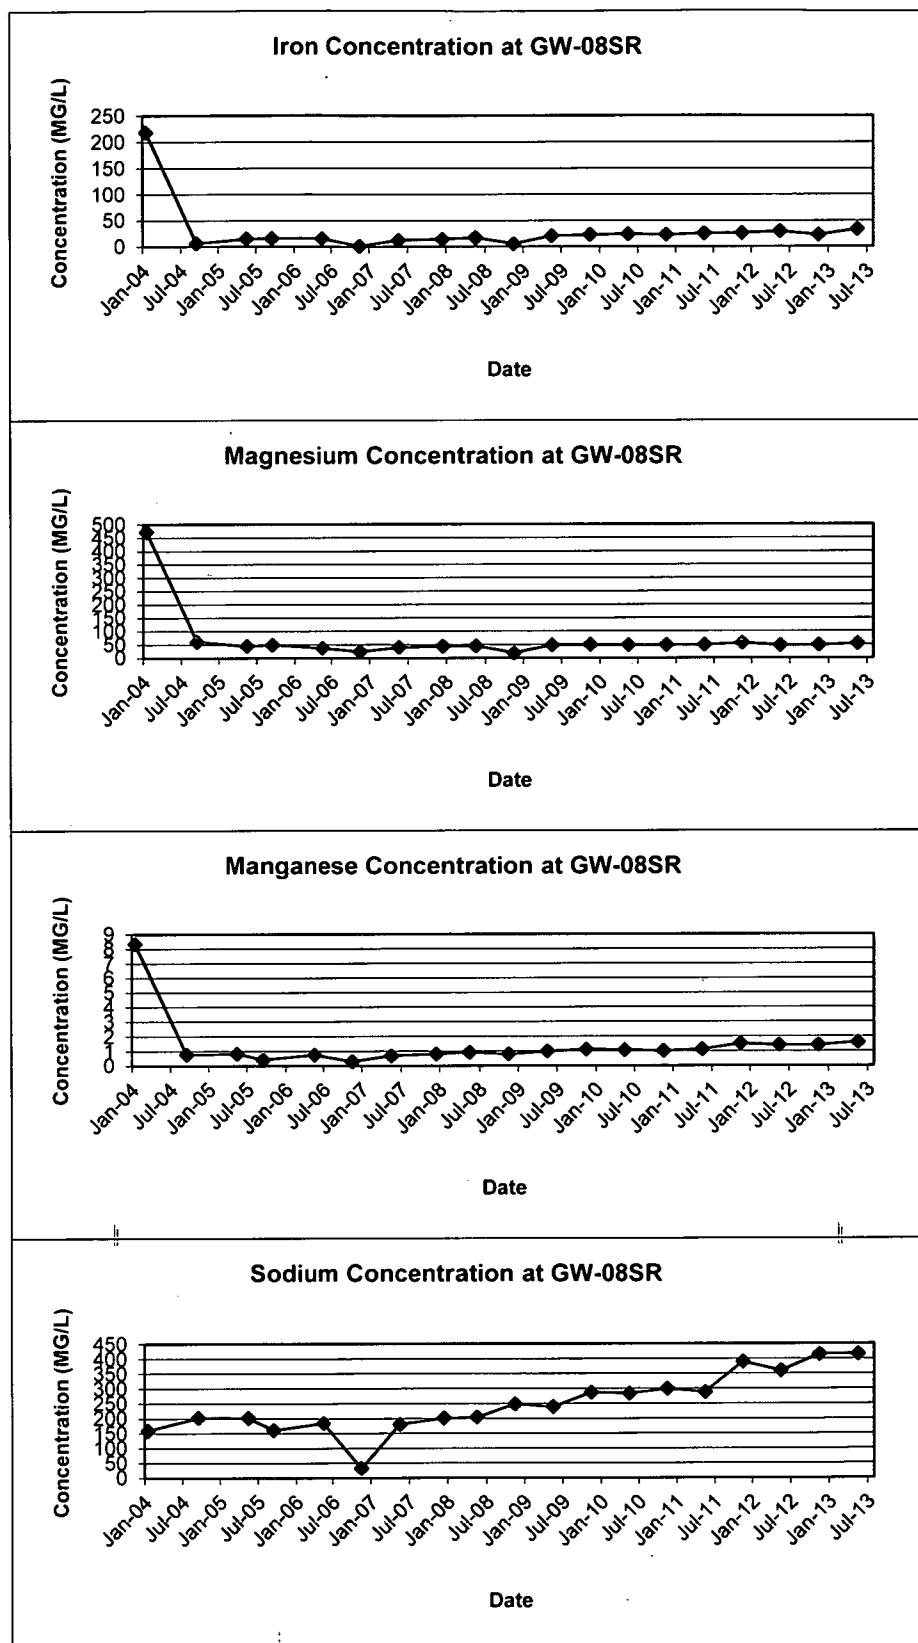


FIGURE E-11
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-26D

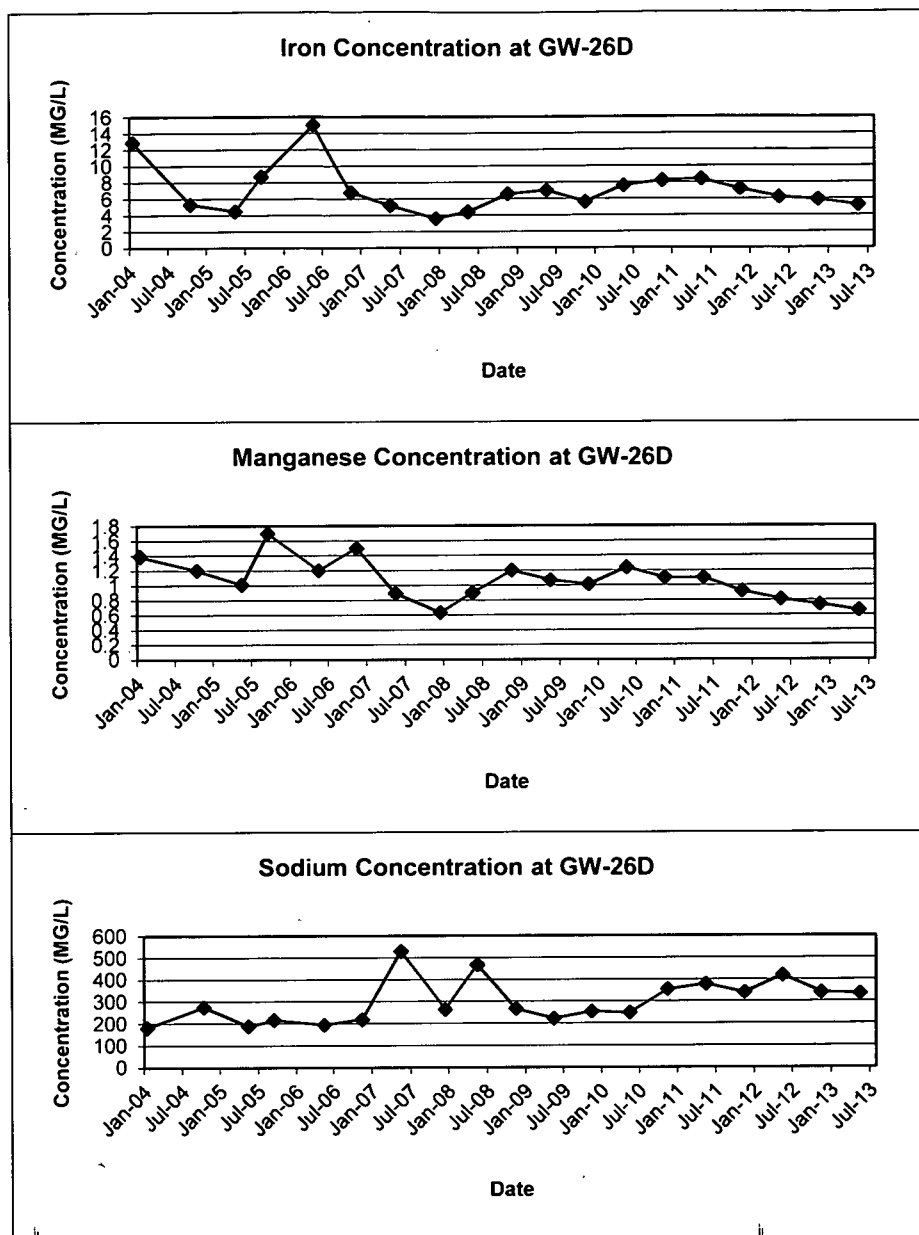


FIGURE E-12
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-28S

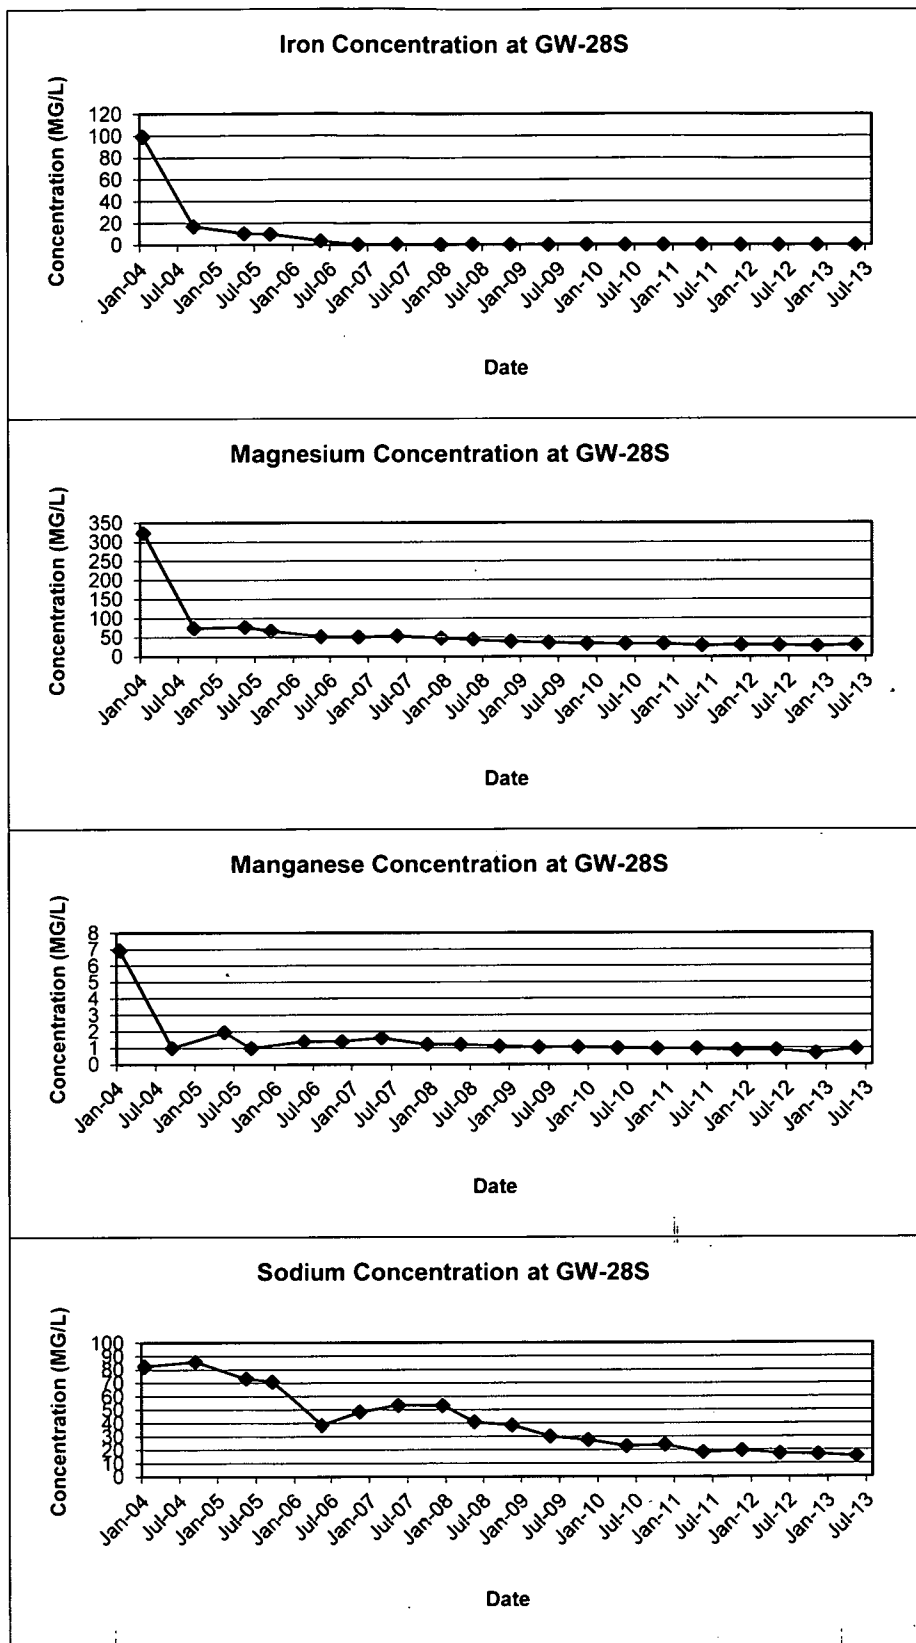


FIGURE E-13
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-29S

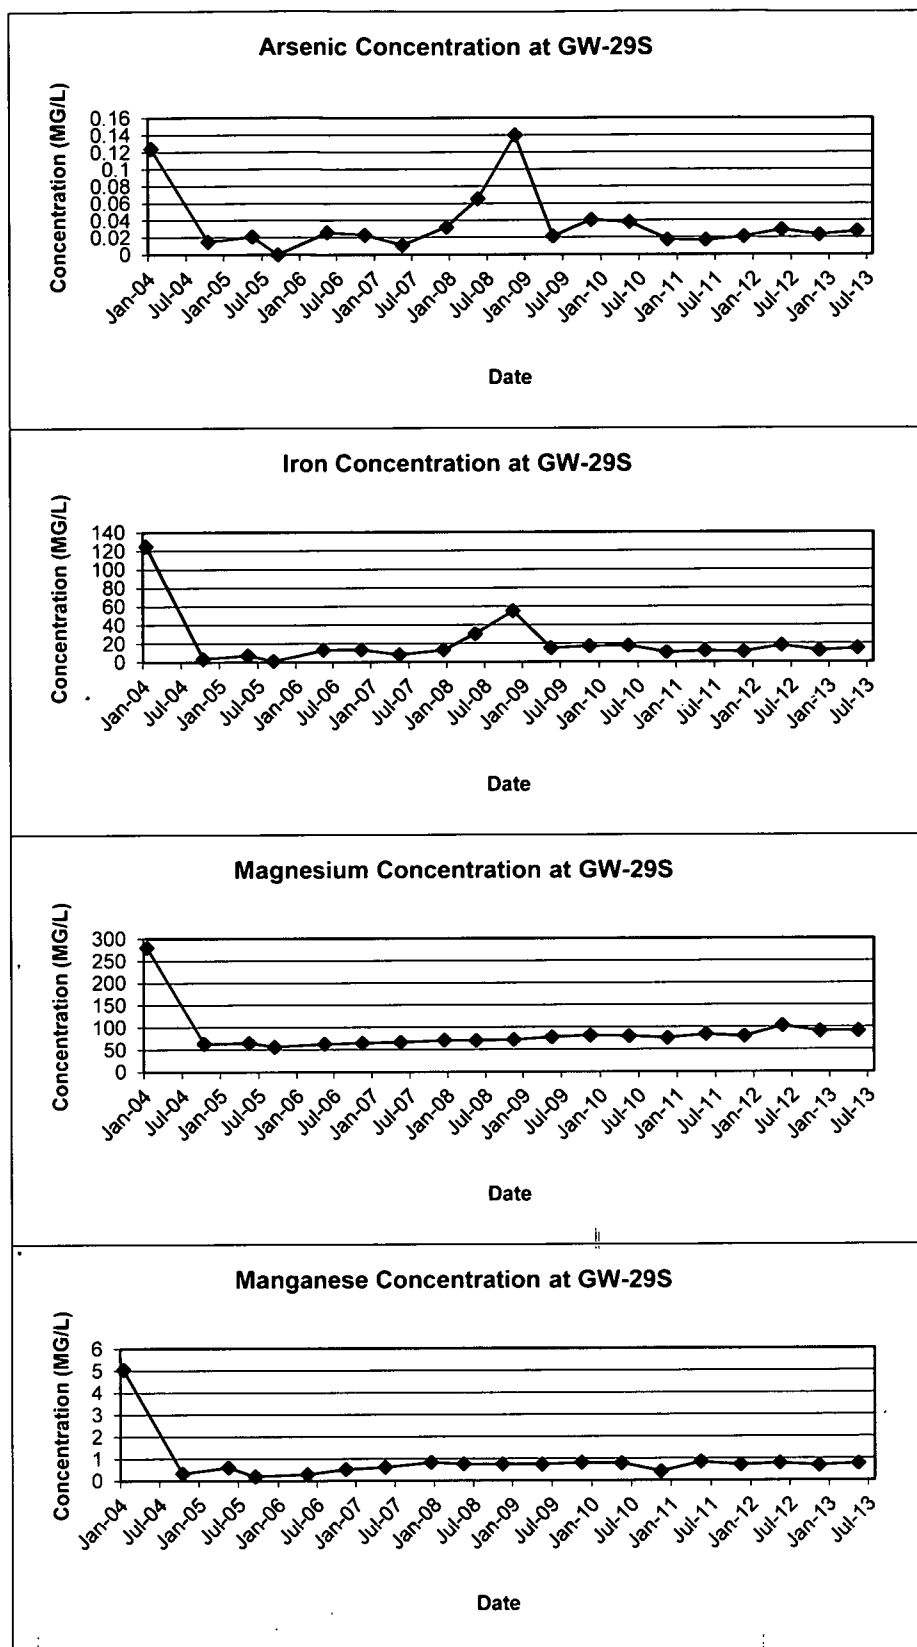


FIGURE E-13
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-29S

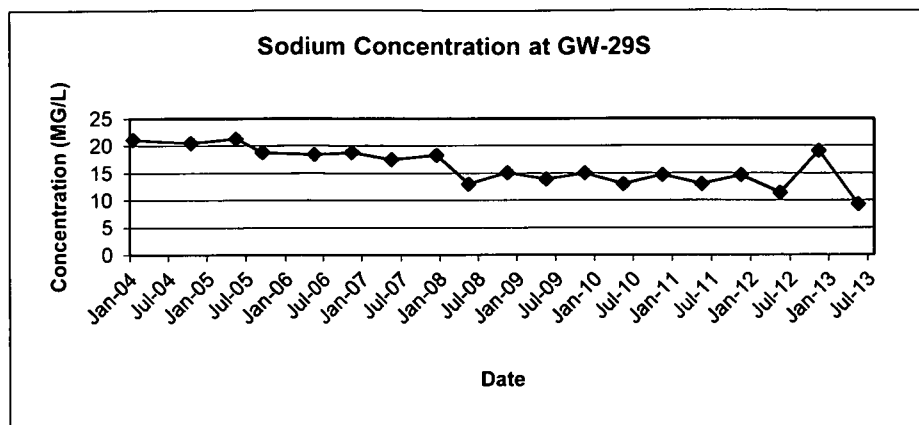


FIGURE E-14
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-30S

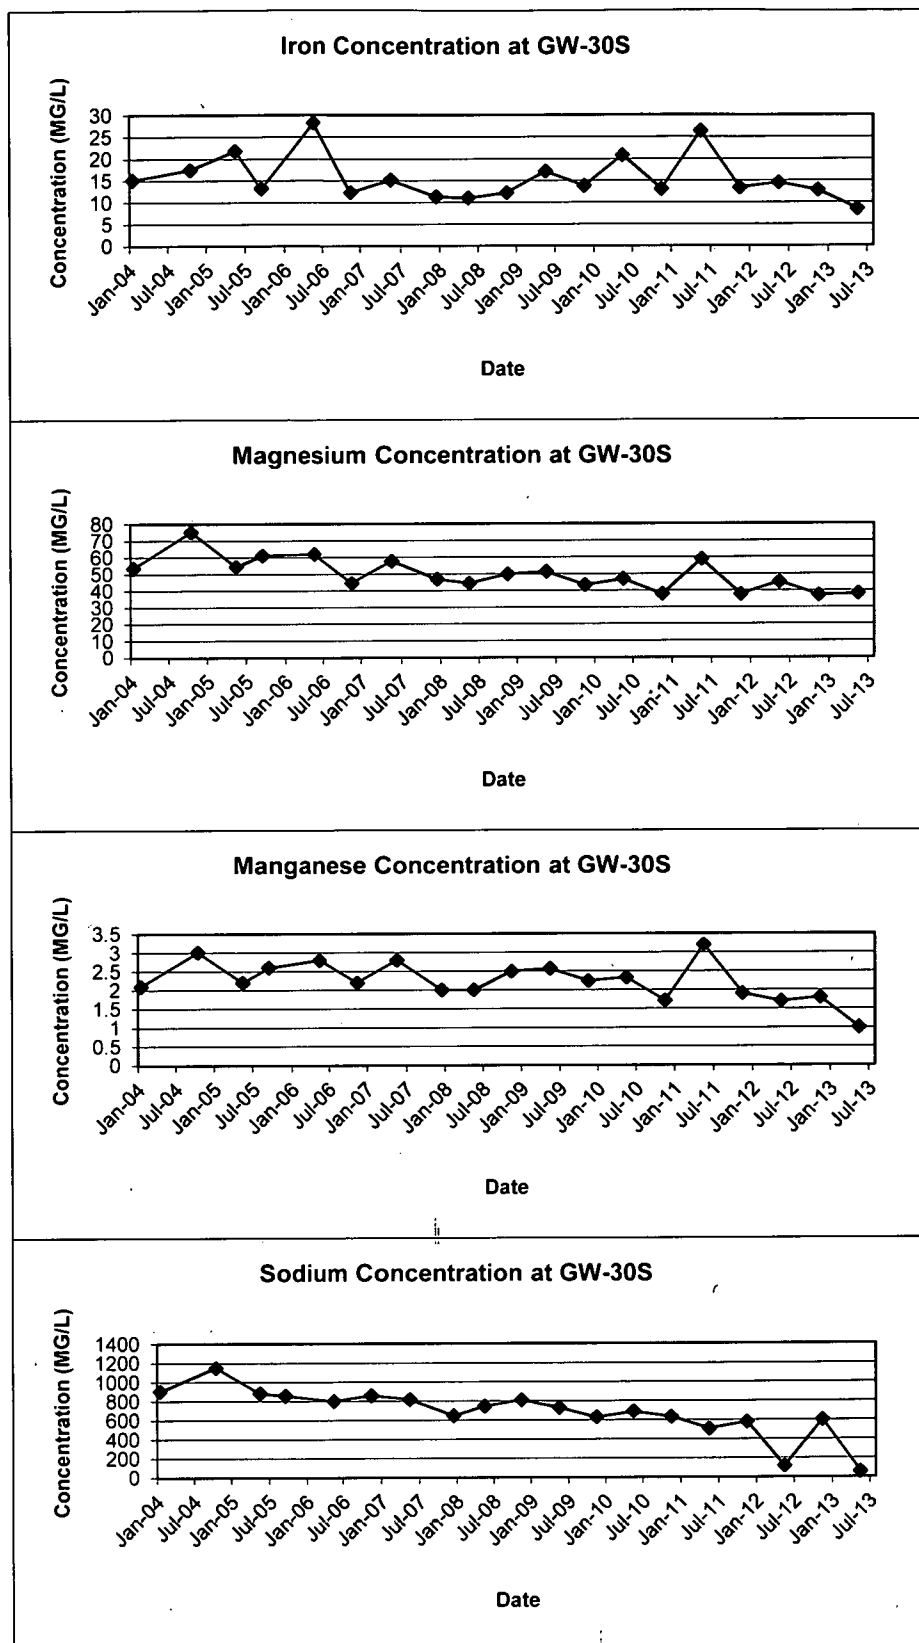


FIGURE E-15
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-31S

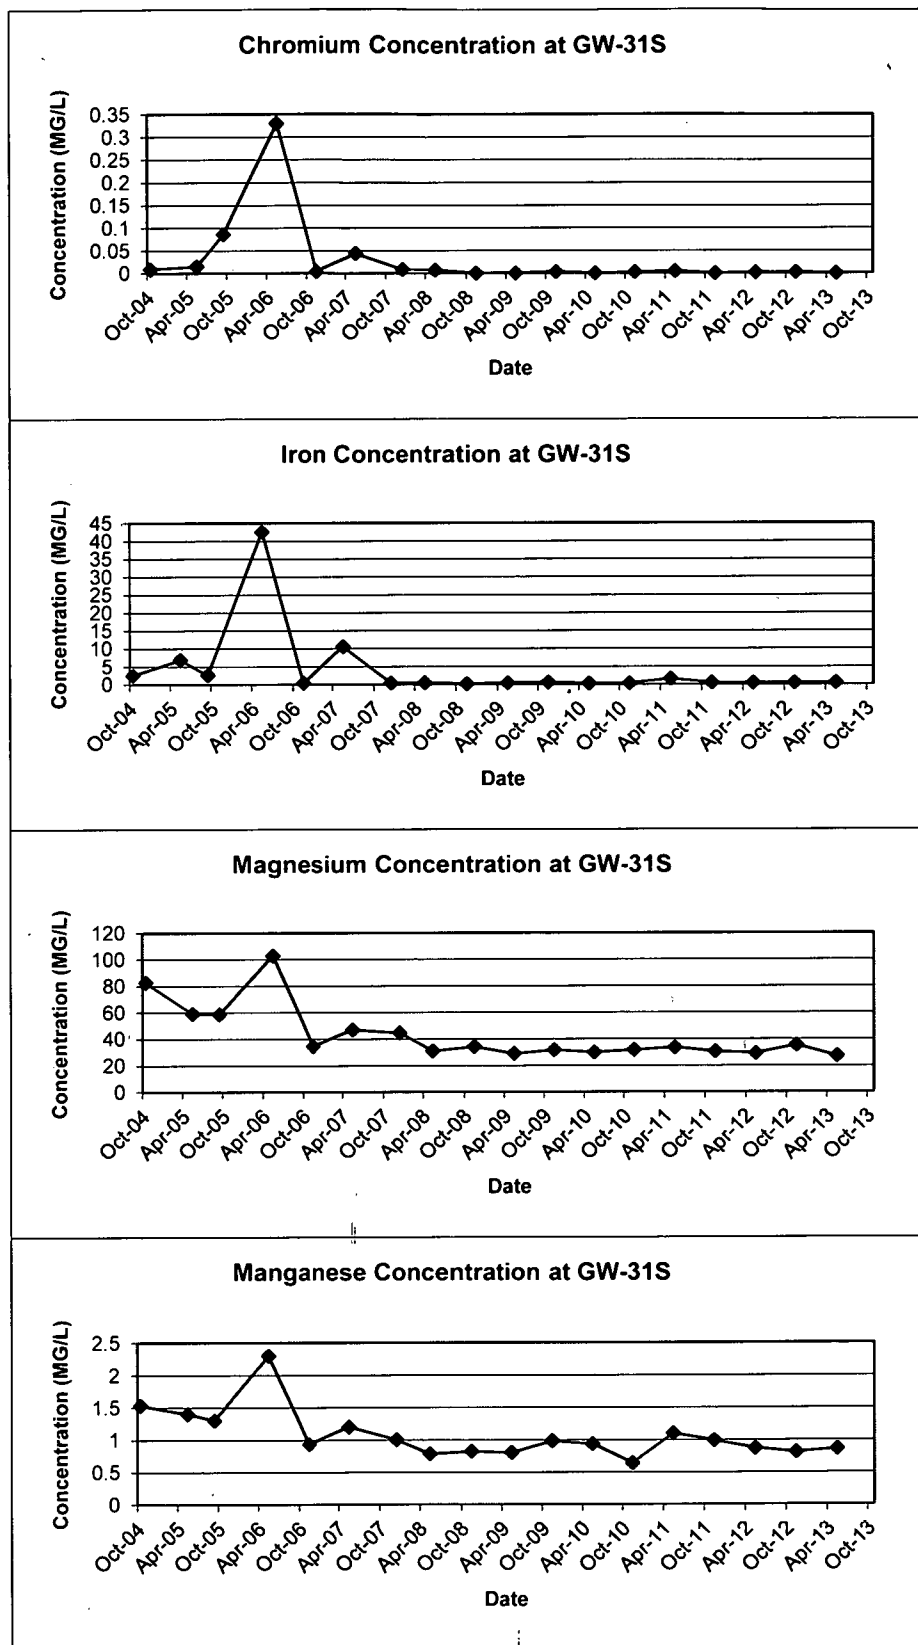


FIGURE E-16
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-32S

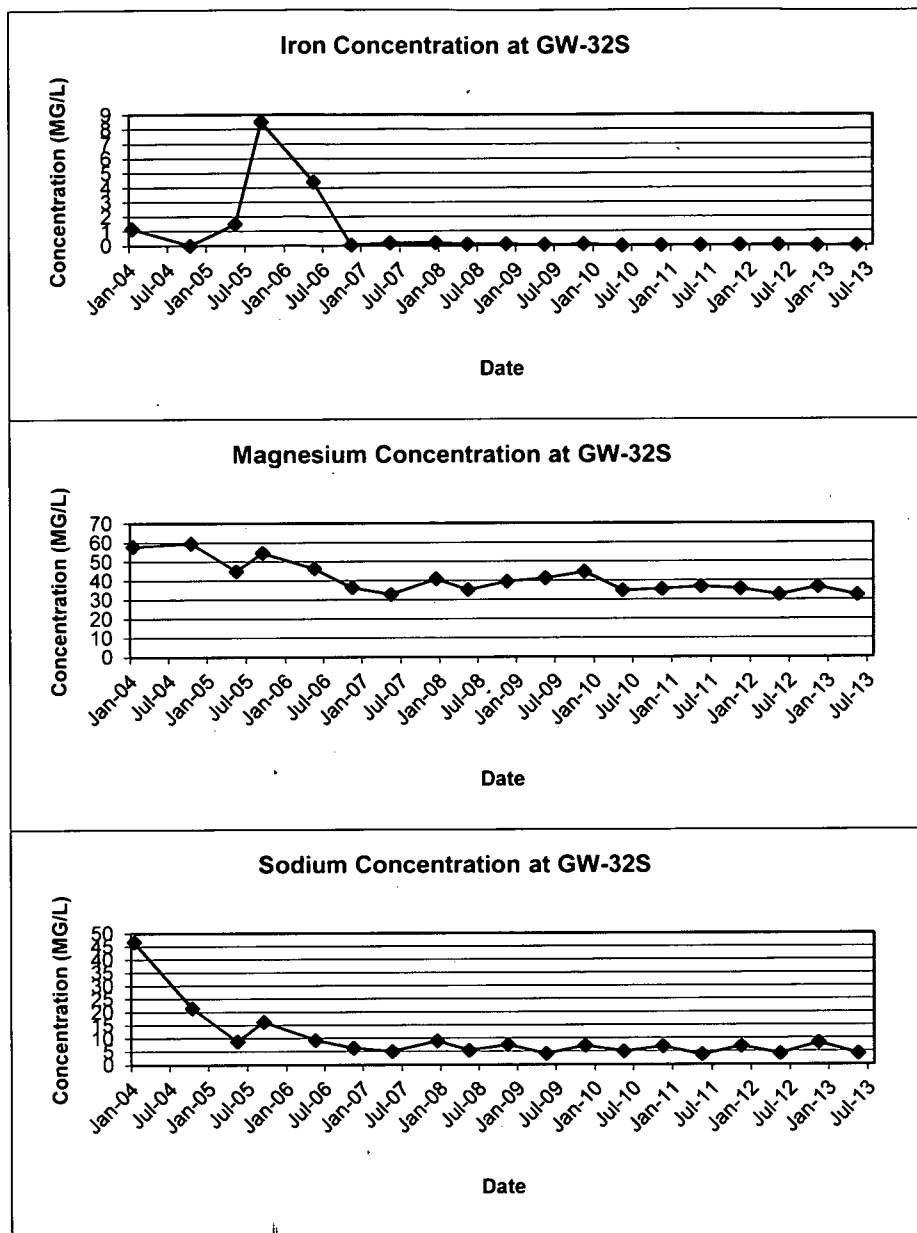


FIGURE E-17
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-33S

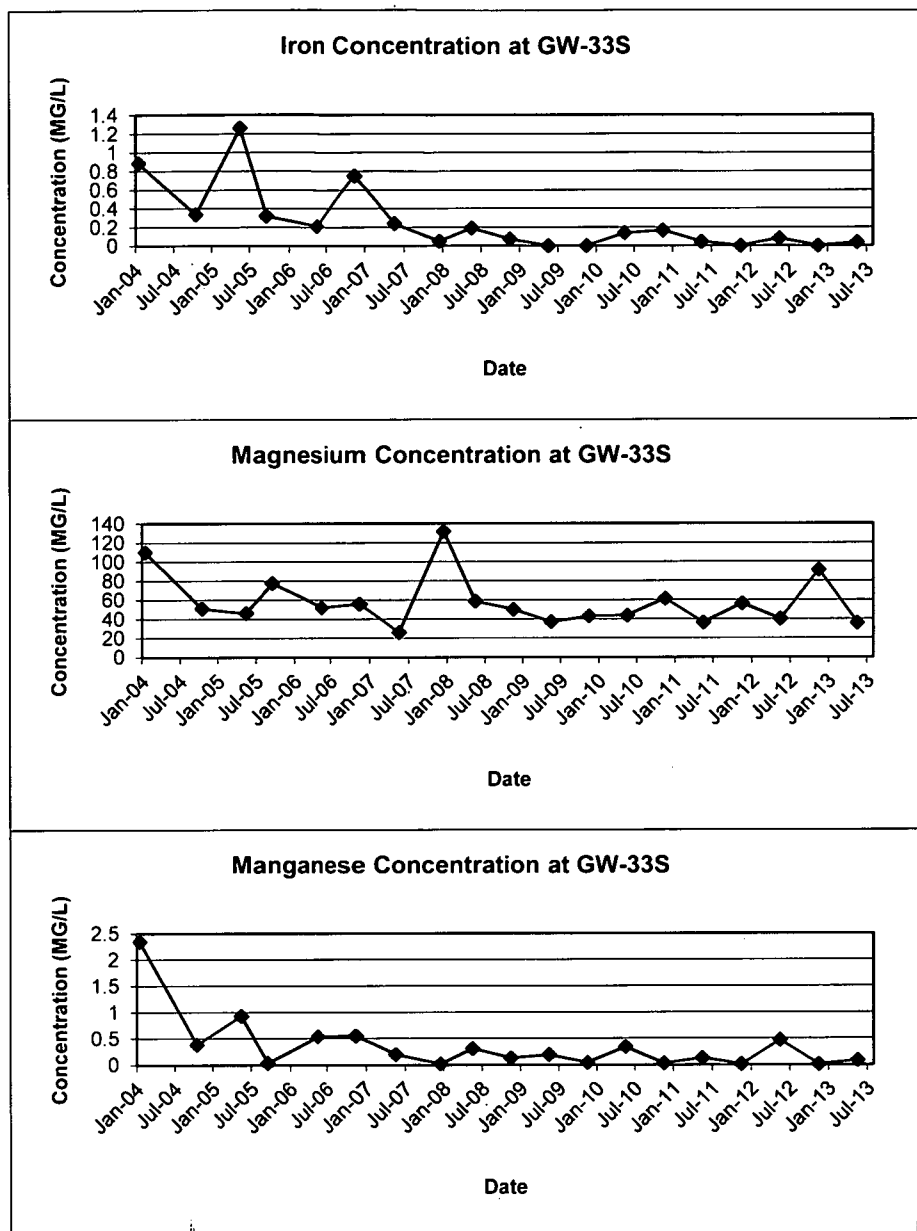


FIGURE E-18
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-34S


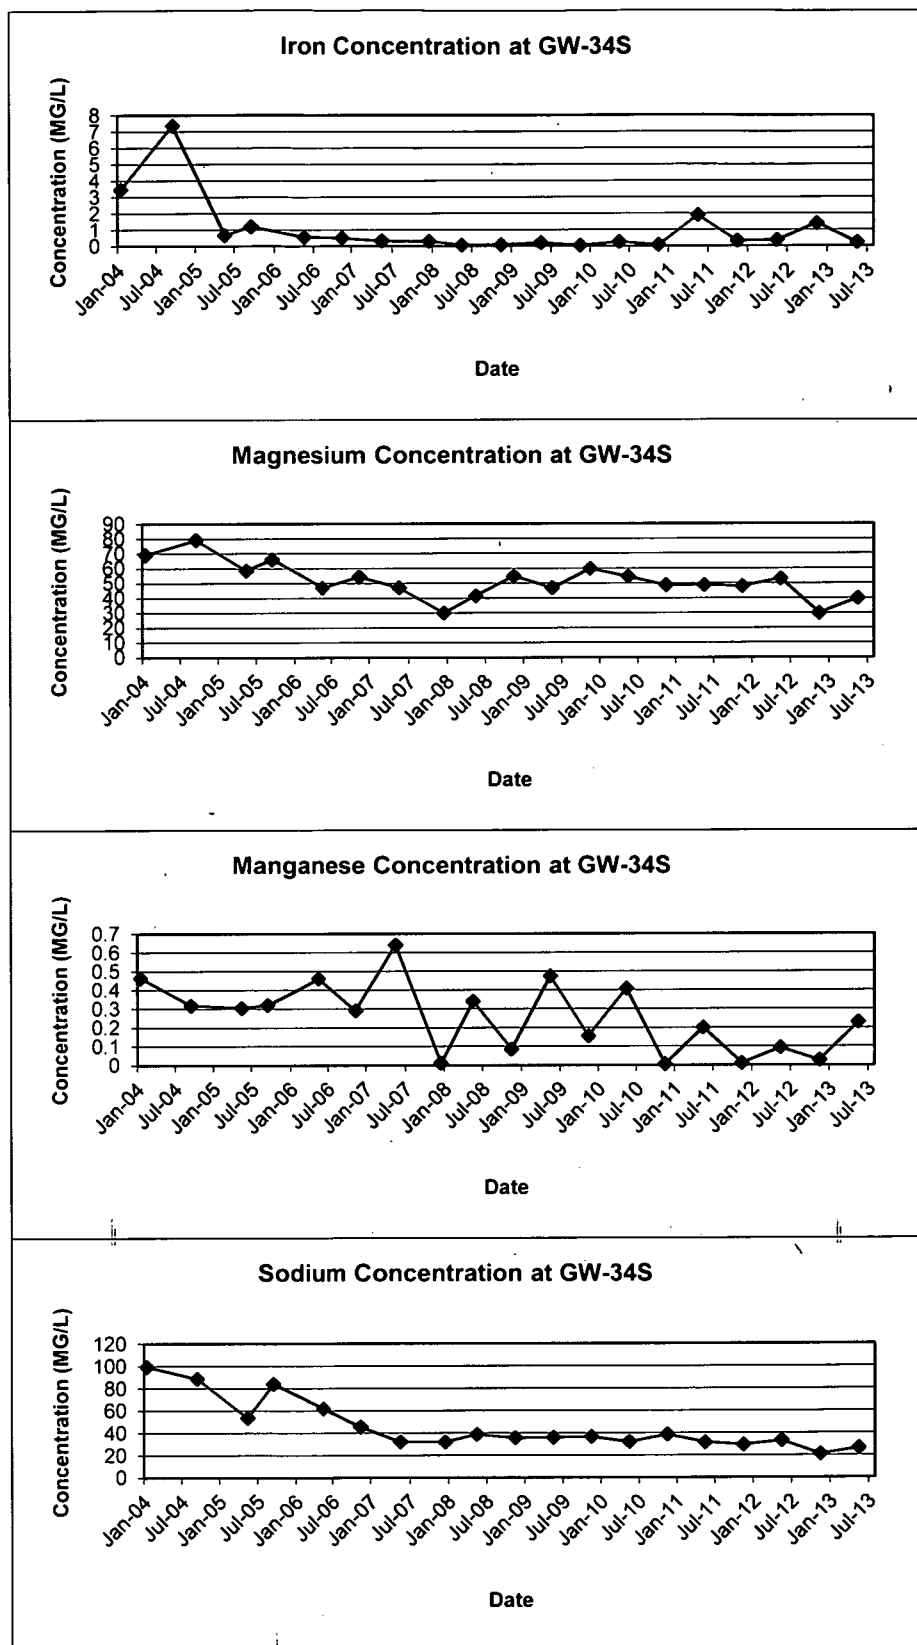


FIGURE E-19
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-35S

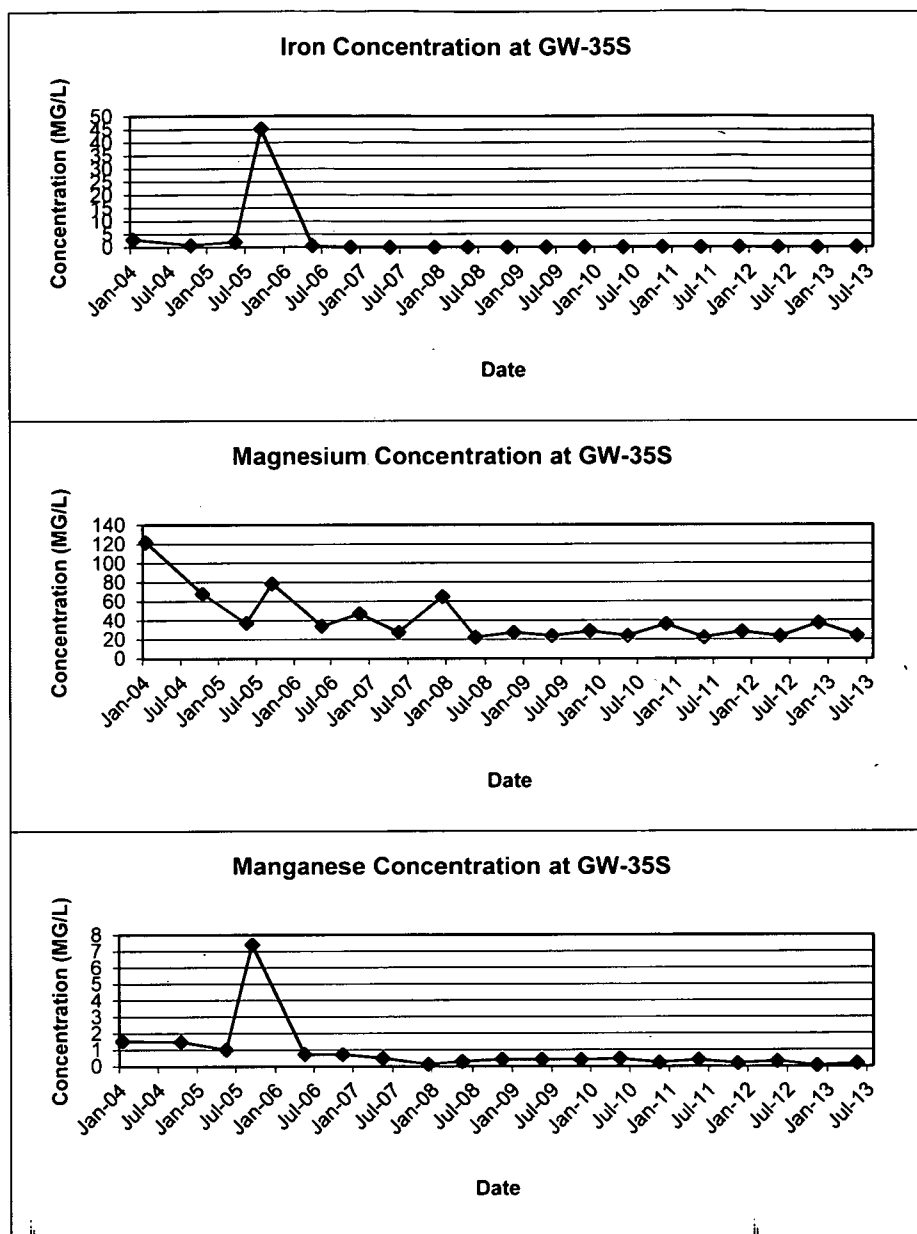

APPENDIX F

BSA PERMIT NO. 13-04-CH016

**AUTHORIZATION TO DISCHARGE UNDER THE BUFFALO
POLLUTANT DISCHARGE ELIMINATION SYSTEM**

**PERMIT NO. 13-04-CH016
USEPA Category 40 CFR Part 403**

In accordance with the provisions of the Federal Water Pollution Control Act, as amended, and the
Sewer Regulations of the Buffalo Sewer Authority, authorization is hereby granted to:

THE TOWN OF CHEEKTOWAGA

to discharge wastewater from a facility located at:


**PFOHL BROTHERS LANDFILL REMEDIATION SITE
1000 AERO DRIVE
CHEEKTOWAGA, NEW YORK 14225**

The wastewater permitted herein shall be discharged to the Town of Cheektowaga sewer system,
which is connected to the Buffalo Municipal Sewer System and Treatment facilities, and which
wastewater will be treated at the Buffalo Sewer Authority's Treatment Plant.

Issuance of this permit is based upon a permit application filed on **February 11, 2013** analytical
data. This permit is granted in accordance with discharge limitations, monitoring requirements and
other conditions set forth in Parts I and II hereof.

Effective this 1st^{day} of April, 2013

To Expire the 31st day of March, 2016



General Manager

Signed this 12th day of March, 2013

PART I: SPECIFIC CONDITIONS**A. DISCHARGE LIMITATIONS & MONITORING REQUIREMENTS**

During the period beginning the effective date of this Permit and lasting until the expiration date, discharge from the permitted facility outfall (see attached map) shall be limited and monitored quarterly by the permittee as specified below.

Sample Point	Parameter	Discharge Limitations ⁽¹⁾		Sampling Requirements	
		Daily Max		Period	Type
001	pH	5.0 - 12.0 S.U.		1 day	Composite ²
	Total Cadmium	1.17 lbs.		1 day	Composite ²
	Total Chromium	1.17 lbs.		1 day	Composite ²
	Total Copper	3.74 lbs.		1 day	Composite ²
	Total Lead	1.17 lbs.		1 day	Composite ²
	Total Nickel	3.27 lbs.		1 day	Composite ²
	Total Zinc	5.84 lbs.		1 day	Composite ²
	Total Barium	2.34 lbs.		1 day	Composite ²
	Total Suspended Solids ⁵	250 mg/l		1 day	Composite ²
	Total Flow	140,100 gallons ⁶		1 day	Discharge meter reading

Footnotes are explained on page 5.

PART I: SPECIFIC CONDITIONS**A. DISCHARGE LIMITATIONS & MONITORING REQUIREMENTS**

During the period beginning the effective date of this Permit and lasting until the expiration date, discharge from the permitted facility outfall (see attached map) shall be limited and monitored **once** by the permittee as specified below.

Sample Point	Parameter	Discharge Limitations ⁽¹⁾	Sampling Requirements	
		Daily Max	Period	Type
001	Total Mercury	0.001 lbs.	1 day	Composite ²
	USEPA Test Method 608 ⁴	To be monitored	1 day	Grab ³
	USEPA Test Method 624 ⁴	To be monitored	1 day	Grab ³
	USEPA Test Method 625 ⁴	To be monitored	1 day	Grab ³

Footnotes are explained on page 5.

PART I: SPECIFIC CONDITIONS

B. DISCHARGE MONITORING REPORTING REQUIREMENTS

During the period beginning the effective date of this permit and lasting until the expiration date, discharge monitoring results shall be summarized and reported **quarterly** by the permittee on the days specified below:


Sample Point	Parameter	Reporting Requirements	
		Initial Report	Subsequent Reports
001	All except USEPA Test Methods 608, 624, 625 & T Mercury	March 31, 2011	Every March 31 st , June 30 th , September 30 th and December 31 st
	USEPA Test Methods 608, 624 and 625 & T Mercury	March 31, 2011	

PART I: SPECIFIC CONDITIONS

C. SPECIAL REQUIREMENTS

1. Mass limits based on an average discharge of 140,100 gpd.
2. Composite samples may be time proportioned.
3. Four grab samples must be collected at equally spaced intervals throughout the sample day. The four (4) grab samples must be composited by a NYSDOH certified laboratory prior to analysis.
4. The permittee must report any compound whose concentration is equal to or greater than 0.01 mg/L. The permittee is not authorized to discharge any of the parameters evaluated by these test procedures which may cause or contribute to a violation of water quality standards or harm the sewerage system. Any parameter detected may, at the discretion of the BSA, be specifically limited and incorporated in this permit.
5. Surchargeable over 250 mg/L.
6. Flow is an action level only. If the permittee consistently exceeds this level, the BSA must be notified so that this permit can be modified.

Permit No. 13-04-CH016
Part I
Page 6 of 6

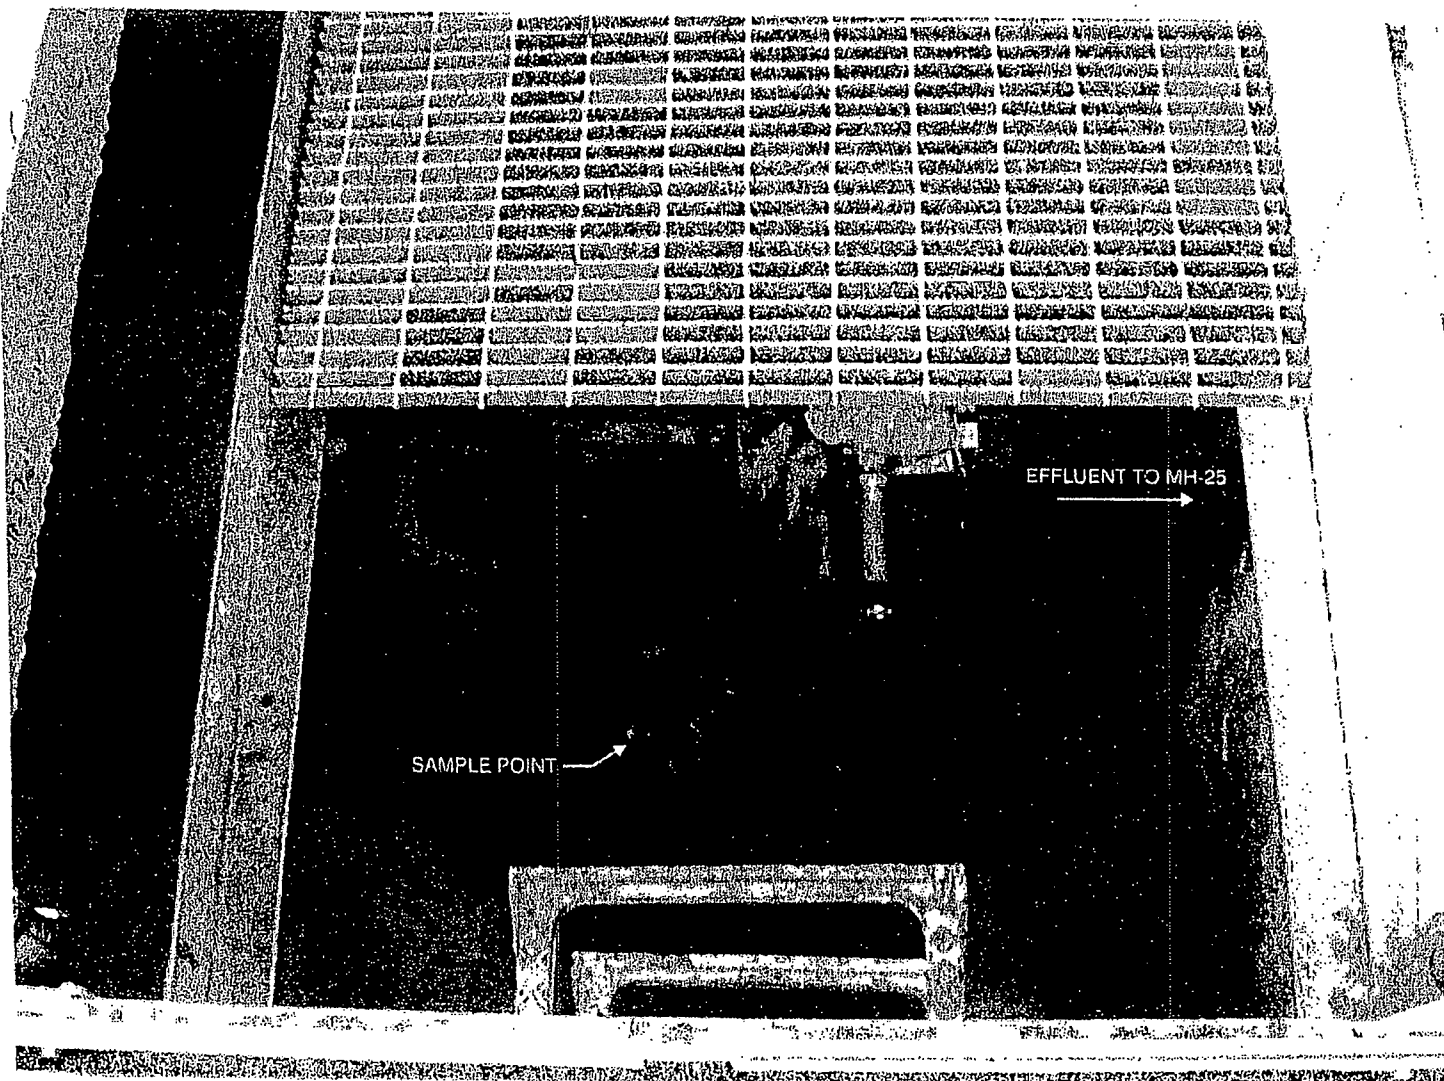

URS

PFOHL BROTHERS LANDFILL
EFFLUENT SAMPLE POINT

FIGURE 1

**TOWN OF CHEEKTOWAGA/BUFFALO POLLUTANT DISCHARGE ELIMINATION SYSTEM
PERMIT**

PART II GENERAL CONDITIONS

A. MONITORING AND REPORTING

1. Local Limits

Except as otherwise specified in this permit, the permit holder shall comply with all specific prohibitions, limits on pollutants or pollutant parameters set forth in the Buffalo Sewer Authority Sewer Use Regulations, as amended from time to time; and such prohibitions, limits and parameters shall be deemed pretreatment standards for purposes of the Clean Water Act

2. Definitions

Definitions of terms contained in this permit are as defined in the Town of Cheektowaga Local Law No. 2 and the Buffalo Sewer Authority Sewer Use Regulations.

3. Discharge Sampling Analysis

All Wastewater discharge samples and analyses and flow measurements shall be representative of the volume and character of the monitored discharge. Methods employed for flow measurements and sample collections and analyses shall conform to the Buffalo Sewer Authority "Sampling Measurement and Analytical Guidelines Sheet."

4. Recording of Results

For each measurement or sample taken pursuant to the requirements of the permit, the Permittee shall record the information as required in the "Sampling Measurement and Analytical Guidelines Sheet."

5. Additional Monitoring by Permittee

If the Permittee monitors any pollutants at the location(s) designated herein more frequently than required by this permit, using approved analytical methods as specified in 40 CFR Part 136 the results of such monitoring shall be included in the calculation and reporting of values required under Part I, B. Such increased frequency shall also be indicated.

6. Reporting

All reports prepared in accordance with this Permit shall be submitted to:

**Mr. William Pugh, P.E.
Town Engineer
275 Alexander Ave.
Cheektowaga, New York, 14211**

All self-monitoring reports shall be prepared in accordance with the BSA "Sampling Measurement and Analytical Guidelines Sheet." These reporting requirements shall not relieve the Permittee of any other reports, which may be required by the

N.Y.S.D.E.C. or the U.S.E.P.A.

B. PERMITTEE REQUIREMENTS

1. Change in Discharge

All discharges authorized herein shall be consistent with the terms and conditions of this permit and with the information contained in the TC/BPDES Permit Application on which basis this permit is granted. In the event of any facility expansions, production increases, process modifications or the installation, modification or repair of any pretreatment equipment which may result in new, different or increased discharges of pollutants, a new TC/BPDES Permit Application must be submitted prior to any change. Following receipt of an amended application, the BSA may modify this permit to specify and limit any pollutants not previously limited. In the event that the proposed change will be covered under an applicable Categorical Standard, a Baseline Monitoring Report must be submitted at least ninety (90) days prior to any discharge.

2. Records Retention

All records and information resulting from the monitoring activities required by this permit including all records of analyses performed, calibration and maintenance of instrumentation, and recordings from continuous monitoring instrumentation shall be retained at this facility for a minimum of three (3) years, or longer if requested by the General Manager and/or Town Engineer.

3. Notification of Slug, Accidental Discharge or Spill

In the event that a slug, accidental discharge or any spill occurs at the facility for which this permit is issued, it is the responsibility of the Permittee to immediately notify the B.S.A. Treatment Plant at 883-1820 of the quantity and character of such discharge. If requested by the B.S.A., within five (5) days following all such discharges, the Permittee shall submit a report describing the character and duration of the discharge, the cause of the discharge, and measures taken or that will be taken to prevent a recurrence of such discharge.

4. Noncompliance Notification

If, for any reason, the Permittee does not comply with or will be unable to comply with any discharge limitation specified in this permit, the Permittee or their assigns must verbally notify the Industrial Waste Section at 883-1820 within twenty-four (24) hours of becoming aware of the violation. The Permittee shall provide the Industrial Waste Section with the following information, in writing, within five (5) days of becoming aware of such condition:

- a. a description of the discharge and cause of noncompliance and;
- b. the period of noncompliance, including exact dates and times; or, if not corrected, the anticipated time the noncompliance is expected to continue, and steps being taken to reduce, eliminate and prevent recurrence of the noncomplying discharge.

5. Adverse Impact

The Permittee shall take all reasonable steps to minimize any adverse impact to the Buffalo and Town Sewerage System resulting from noncompliance with any discharge limitations specified in this permit, including such accelerated or additional monitoring as necessary to determine the nature and impact of the noncomplying discharge.

6. Waste Residuals

Solids, sludges, filter backwash or other pollutants removed in the course of treatment or control of wastewaters and/or the treatment of intake waters, shall be disposed of in a manner such as to prevent any pollutant from such materials from entering the Buffalo or Town Sewer System.

7. Power Failures

In order to maintain compliance with the discharge limitations and prohibitions of this permit, the Permittee shall provide an alternative power source sufficient to operate the wastewater control facilities; or, if such alternative power source is not provided the Permittee shall halt, reduce or otherwise control production and/or controlled discharges upon the loss of power to the wastewater control facilities.

8. Treatment Upsets

a. Any industrial user which experiences an upset in operations that places it in a temporary state of noncompliance, which is not the result of operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation, shall inform the Industrial Waste Section immediately upon becoming aware of the upset. Where such information is given verbally, a written report shall be filed by the user within five (5) days. The report shall contain:

- (i) A description of the upset, its cause(s) and impact on the discharger's compliance status.
- (ii) The duration of noncompliance, including exact dates and times of noncompliance, and if the noncompliance is continuing, the time by which compliance is reasonably expected to be restored
- (iii) All steps taken or planned to reduce, eliminate, and prevent recurrence of such an upset.

b. An industrial user which complies with the notification provisions of this Section in a timely manner shall have an affirmative defense to any enforcement action brought by the Industrial Waste Section/Town Engineer for any noncompliance of the limits in this permit, which arises out of violations attributable to and alleged to have occurred during the period of the documented and verified upset.

9. Treatment Bypasses

- a. A bypass of the treatment system is prohibited unless the following conditions are met:
 - (i) The bypass was unavoidable to prevent loss of life, personal injury, or severe property damage; or
 - (ii) There was no feasible alternative to the bypass, including the use of auxiliary treatment or retention of the wastewater; and
 - (iii) The industrial user properly notified the Industrial Waste Section as described in paragraph b. below.
- b. Industrial users must provide immediate notice to the Industrial Waste Section upon delivery of an unanticipated bypass. If necessary, the Industrial Waste Section may require the industrial user to submit a written report explaining the cause(s), nature, and duration of the bypass, and the steps being taken to prevent its recurrence.
- c. An industrial user may allow a bypass to occur which does not cause pretreatment standards or requirements to be violated, but only if it is for essential maintenance to ensure efficient operation of the treatment system. Industrial users anticipating a bypass must submit notice to the Industrial Waste Section at least ten (10) days in advance. The Industrial Waste Section may only approve the anticipated bypass if the circumstances satisfy those set forth in paragraph a. above.

C. PERMITTEE RESPONSIBILITIES

1. Permit Availability

The originally signed permit must be available upon request at all times for review at the address stated on the first page of this permit.

2. Inspections

The Permittee shall allow the representatives of the Buffalo Sewer Authority or Town of Cheektowaga upon the presentation of credentials and during normal working hours or at any other reasonable times, to have access to and copy any records required in this permit; and to sample any discharge of pollutants.

3. Transfer of Ownership or Control

In the event of any change in control or ownership of facilities for which this permit has been issued the permit shall become null and void. The succeeding owner shall submit a completed Town of Cheektowaga/ Buffalo Sewer Authority permit application prior to discharge to the sewer system.

D. PERMITTEE LIABILITIES

1. Permit Modification

After notice and opportunity for a hearing, this permit may be modified, suspended, or revoked in whole or in part during its term for cause including, but not limited to the following:

- a. Violation of any terms or conditions of this permit,
- b. Obtaining this permit by misrepresentation or failure to disclose fully all relevant facts,
- c. A change in any condition that requires either a temporary or permanent reduction or elimination of the authorized discharge.

2. Imminent Danger

In the event there exists an imminent danger to health or property, the permitter reserves the right to take immediate action to halt the permitted discharge to the sewerage works.

3. Civil and Criminal Liability

Nothing in this permit shall relieve the Permittee from any requirements, liabilities, or penalties under provisions of the Town of Cheektowaga Local Law No. 2, the "Sewer Regulations of the Buffalo Sewer Authority" or any Federal, State and/or local laws or regulations.

4. Penalties for Violations of Permit Conditions

The "Sewer Regulations of the Buffalo Sewer Authority" and Town of Cheektowaga Local Law No. 2, provide that any person who violates a B.P.D.E.S. permit condition is liable to the Authority and/or the Town for a civil penalty of up to \$10,000 per day for each violation. Any person who willfully or negligently violates permit conditions will be referred to the New York State Attorney General.

E. NATIONAL PRETREATMENT STANDARDS

If a pretreatment standard or prohibition (including any Schedule of Compliance specified in such pretreatment standard or prohibition) is established under Section 307 (b) of the Act for a pollutant which is present in the discharge and such standard or prohibition is more stringent than any limitation for such pollutant in this permit, this permit shall be revised or modified in accordance with such pretreatment standard or prohibition.

F. PLANT CLOSURE

In the event of plant closure, the Permittee is required to notify the Industrial Waste Section/Town Engineer in writing as soon as an anticipated closure date is determined, but in no case later than five (5) days of the actual closure.

G. CONFIDENTIALITY

Except for data determined to be confidential under Section 308 of the Act, all reports prepared in accordance with the terms of this permit shall be available for public inspection at the offices of the Buffalo Sewer Authority or Town Engineer of the Town of Cheektowaga. As required by the Act, effluent data shall not be considered confidential. Knowingly making any false statement on any such report may result in the imposition of criminal penalties as provided for in Section 309 of the Act.

H. SEVERABILITY

The provisions of this permit are severable, and if any provision of this permit, or the application of any provision of this permit to any circumstance, is held invalid, the application of such provision to other circumstances, and the remainder of this permit, shall not be affected thereby.

APPENDIX G

DISCHARGE REPORT SUMMARY TABLES

SAMPLING FIELD SHEET

URS

Client Name: Pfohl Brothers Landfill
 Address: Aero Drive, Cheektowaga, NY
 Contact: Bill Pugh, P.E. Phone: 716-897-7288

Installation:

Sample Point: SP-001
 Sample Location: Meter Chamber - ball valve on 6" HDPE forcemain
 Date: 6/24/13 Crew: R. Murphy, S. Moeller, T. Ifkovich
 Weather: 85° F, Clear
 Sampling Device: NA
 Time of Installation: 15:05 Type of Sample: Composite
 Sample Interval: NA Sample Volume: NA

Comments and Observations: No wells were running at the time of sample setup.
PLC display volumes: WW-01 (1,062,839 gals), WW-02 (37,022 gals), WW-03 (818,919 gals),
WW-04 (972,031 gals), WW-05 (3,696,970 gals), WW-06 (6,288,144 gals) & MH-25 (12,880,882 gals).

Date: 6/25/13 Crew: R. Murphy, S. Moeller, K. McGovern
 Weather: 80° F, Cloudy
 Time of Collection: 15:05

Field Measurements:

15:05/RJM pH Calibration: Buffer 7- 7 Buffer 4- 4 Buffer 10- 10
 (time/initial) pH Measurement: 7.7
 Temperature: 19.2°C

Identification: EFF-062513
 Physical Observations:

Laboratory: TestAmerica, Buffalo, NY

Comments: No wells were running at the time of sample collection.
PLC display volumes: WW-01 (1,062,839 gals), WW-02 (37,022 gals), WW-03 (818,919 gals),
WW-04 (972,031 gals), WW-05 (3,698,226 gals), WW-06 (6,288,144 gals) & MH-25 (12,882,176 gals).

Reviewed By: _____ Date: _____
 (Supervisor)

TABLE 1

**PFOHL BROTHERS LANDFILL - EFFLUENT MONITORING
ANALYTICAL RESULTS, TOTAL FLOW, AND MASS LOADINGS
JUNE 2013**

Sample ID	EFF-062513			
Matrix	Effluent Water			
Date Sampled	6/25/2013			
Parameter	Result	Mass Loading	Discharge Limitation	Violations
	(mg/L)	(lbs/day)	(lbs/day)	(Y/N)
Total Barium	0.25	0.003	2.34	No
Total Cadmuim	< ⁽¹⁾ 0.0005	< 0.000005	1.17	No
Total Chromium	< 0.001	< 0.00001	1.17	No
Total Copper	0.0048	0.0001	3.74	No
Total Lead	< 0.003	< 0.00003	1.17	No
Total Nickel	0.004	0.00004	3.27	No
Total Zinc	0.012	0.0001	5.84	No
Total Suspended Solids	12.0	NA	250 ⁽³⁾	No
pH ⁽⁴⁾	7.7	NA	5.0 - 12.0	No
Total Flow ⁽⁵⁾		1,294	140,100	No

Notes:

- (1) < = Compound not detected, method detection limit shown
 (2) NA = Not Applicable
 (3) Discharge Limitation in units of mg/L
 (4) pH measurement and Discharge Limitation in Standard Units
 (5) Total Flow reported in gallons, sample was collected over a 24 hour period

$$\text{Calculation: } \left(\frac{x \text{ mg}}{L} \right) \left(\frac{y \text{ gal}}{\text{day}} \right) \left(\frac{1 \text{ lb}}{453,600 \text{ mg}} \right) \left(\frac{3.785 L}{\text{gal}} \right) = \frac{x \times y}{119,841} \frac{\text{lb}}{\text{day}}$$

SAMPLING FIELD SHEET

URS

Client Name: Pfohl Brothers Landfill

Address: Aero Drive, Cheektowaga, NY

Contact: Bill Pugh, P.E. Phone: 716-897-7288

Installation:

Sample Point: SP-001

Sample Location: Meter Chamber - ball valve on 6" HDPE forcemain

Date: 9/10/13 Crew: R. Murphy, K. McGovern, T. Ifkovich

Weather: 89° F, Partly Cloudy

Sampling Device: NA

Time of Installation: 13:55 Type of Sample: Composite

Sample Interval: NA Sample Volume: NA

Comments and Observations: WW-4 was running at the time of sample set-up.
PLC display volumes: WW-01 (271,783 gals), WW-02 (-900 gals), WW-03 (24,193 gals),
WW-04 (49,097 gals), WW-05 (829,770 gals), WW-06 (293,406 gals) & MH-25 (1,512,843 gals).

Date: 9/11/13 Crew: R. Murphy, S. Moeller, T. Ifkovich

Weather: 90° F, Clear

Time of Collection: 14:30

Field Measurements:

14:35/RJM
(time/initial)

pH Calibration: Buffer 7- 7 Buffer 4- 4 Buffer 10- 10

pH Measurement: 7.5

Temperature: 23.4°C

Identification: EFF-091113

Physical Observations: _____

Laboratory: TestAmerica, Buffalo, NY

Comments: No wells were running at the time of sample collection.
PLC display volumes: WW-01 (271,783 gals), WW-02 (-901 gals), WW-03 (24,193 gals),
WW-04 (49,204 gals), WW-05 (829,770 gals), WW-06 (293,590 gals) & MH-25 (1,513,063 gals).

Reviewed By: _____ Date: _____
(Supervisor)

TABLE 1

**PFOHL BROTHERS LANDFILL - EFFLUENT MONITORING
ANALYTICAL RESULTS, TOTAL FLOW, AND MASS LOADINGS
SEPTEMBER 2013**

Sample ID	EFF-091113			
Matrix	Effluent Water			
Date Sampled	9/11/2013			
Parameter	Result	Mass Loading	Discharge Limitation	Violations
	(mg/L)	(lbs/day)	(lbs/day)	(Y/N)
Total Barium	0.58	0.001	2.34	No
Total Cadmuim	< ⁽¹⁾ 0.0005	< 0.000001	1.17	No
Total Chromium	0.0018	0.000003	1.17	No
Total Copper	0.069	0.0001	3.74	No
Total Lead	0.0083	0.00002	1.17	No
Total Nickel	0.0082	0.00002	3.27	No
Total Zinc	0.11	0.0002	5.84	No
Total Suspended Solids	68.9	NA	250 ⁽³⁾	No
pH ⁽⁴⁾	7.5	NA	5.0 - 12.0	No
Total Flow ⁽⁵⁾		220	140,100	No

Notes:

- (1) < = Compound not detected, method detection limit shown
 (2) NA = Not Applicable
 (3) Discharge Limitation in units of mg/L
 (4) pH measurement and Discharge Limitation in Standard Units
 (5) Total Flow reported in gallons, sample was collected over a 24 hour period

$$\text{Calculation: } \left(\frac{x \text{ mg}}{\text{L}} \right) \left(\frac{y \text{ gal}}{\text{day}} \right) \left(\frac{1 \text{ lb}}{453,600 \text{ mg}} \right) \left(\frac{3.785 \text{ L}}{\text{gal}} \right) = \frac{x \times y}{119,841} \frac{\text{lb}}{\text{day}}$$

APPENDIX H

MONITORING WELL INSPECTION LOGS

WELL INSPECTION SUMMARY

Project Name: Pfohl Brothers Landfill

Project Number: 11175616.00000

Inspection Crew Members: R. Murphy, T. Ifkovich

Supervisor: J. Sundquist

Date(s) of Inspection: May 8, 2013

<i>Well I.D. Number</i>	<i>Lock</i>	<i>Surface Seal</i>	<i>Protective Casing</i>	<i>Riser</i>	<i>Water Level (ft. BTOC)</i>	<i>Well Depth (ft. BTOC)</i>	<i>Other Comments</i>
GW-1S	OK	OK	OK	Bulged	4.29	14.94	
GW-1D	OK	OK	OK	Bulged	3.48	39.65	
GW-3S	OK	OK	OK	OK	2.99	13.22	
GW-3D	OK	OK	OK	OK	2.35	35.70	
GW-4S	OK	OK	OK	OK	4.9	16.23	
GW-4D	OK	OK	OK	OK	12.88	45.57	
GW-7S	OK	OK	OK	OK	5.30	35.04	
GW-7D	OK	OK	OK	Damaged	45.33	60.45	

Additional Comments:

WELL INSPECTION SUMMARY

Project Name: Pfohl Brothers Landfill

Project Number: 11175616.00000

Inspection Crew Members: R. Murphy, T. Ifkovich

Supervisor: J. Sundquist

Date(s) of Inspection: May 8, 2013

<i>Well I.D. Number</i>	<i>Lock</i>	<i>Surface Seal</i>	<i>Protective Casing</i>	<i>Riser</i>	<i>Water Level (ft. BTOC)</i>	<i>Well Depth (ft. BTOC)</i>	<i>Other Comments</i>
GW-8SR	OK	OK	OK	OK	5.48	13.02	
GW-8D	OK	OK	OK	OK	6.36	36.54	
GW-26D	OK	OK	OK	OK	7.19	40.70	
GW-28S	OK	OK	OK	OK	9.68	15.52	
GW-29S	OK	OK	OK	OK	9.00	20.04	
GW-30S	OK	OK	OK	OK	8.10	17.97	
GW-31S	OK	OK	OK	OK	4.65	9.57	
GW-32S	OK	OK	OK	OK	4.51	9.93	

Additional Comments:

WELL INSPECTION SUMMARY

Project Name: Pfohl Brothers Landfill

Project Number: 11175616.00000

Inspection Crew Members: R. Murphy, T. Ifkovich

Supervisor: J. Sundquist

Date(s) of Inspection: May 8, 2013

<i>Well I.D. Number</i>	<i>Lock</i>	<i>Surface Seal</i>	<i>Protective Casing</i>	<i>Riser</i>	<i>Water Level (ft. BTOC)</i>	<i>Well Depth (ft. BTOC)</i>	<i>Other Comments</i>
GW-33S	OK	OK	OK	OK	6.30	8.21	
GW-34S	OK	OK	OK	OK	3.21	10.01	
GW-35S	OK	OK	OK	OK	4.16	7.46	

Additional Comments:

ATTACHMENT B

July 2013 – December 2013

Semi Annual Report

**SEMI ANNUAL REPORT
OPERATION AND MAINTENANCE
JULY 2013 TO DECEMBER 2013
PFOHL BROTHERS LANDFILL
CHEEKTOWAGA, NY**

Submitted to:

**NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION
270 MICHIGAN AVENUE
BUFFALO, NEW YORK 14203**

Prepared by:

**URS CORPORATION
77 GOODELL STREET
BUFFALO, NEW YORK 14203**

Prepared for:

**TOWN OF CHEEKTOWAGA
ENGINEERING DEPARTMENT
275 ALEXANDER AVE
CHEEKTOWAGA, NEW YORK 14211**

**MARCH
2014**



March 24, 2014

Mr. Jaspal Singh Walia, P.E.
New York State Department of Environmental Conservation
270 Michigan Ave.
Buffalo, NY 14203

**Re: Semi-Annual Report July 2013 – December 2013
Pfohl Brothers Landfill, Town of Cheektowaga, New York**

Dear Mr. Walia:

Enclosed is one copy of the twentieth Semi-Annual Report for the Pfohl Brothers Landfill in Cheektowaga, New York. A copy has also been sent to Ms. Pamela Tames, P.E. of the United States Environmental Protection Agency. Also enclosed is the Data Applicability Report for laboratory analyses associated with the Semi-Annual Report. PDF copies of the reports are also enclosed.

If you have any questions on this report, please feel free to contact me.

Sincerely,

URS CORPORATION

Jon Sundquist, Ph.D.
Project Manager

Enclosures

cc: Pamela Tames, P.E. - USEPA (w/attachments)
William Pugh, P.E. - Town of Cheektowaga (w/attachments)
File 11172700 (C-1)

TABLE OF CONTENTS

	<u>Page No.</u>
1.0 INTRODUCTION	1-1
1.1 Background.....	1-1
1.2 Operation and Maintenance Activities.....	1-1
2.0 GENERAL MAINTENANCE ACTIVITIES.....	2-1
3.0 MONITORING ACTIVITIES.....	3-1
3.1 Groundwater Hydraulic Monitoring	3-1
3.2 Groundwater Quality Monitoring	3-1
3.3 Groundwater Discharge Monitoring	3-5
3.4 Monitoring Well Inspections	3-5
4.0 SUMMARY AND RECOMMENDATIONS.....	4-1

TABLES

Table 3-1	Groundwater Sample Analytical Results
Table 3-2	Approved Revision Of Table 3.2 From The O&M Plan

FIGURES

Figure 1-1	Site Location Map
Figure 3-1	Monitoring Locations

APPENDICES

Appendix A	Example Daily Inspection Sheets
Appendix B	Monthly Flow Summaries (July 2013 – December 2013)
Appendix C	Hydraulic Monitoring Tables
Appendix D	Groundwater Purge and Sample Collection Logs
Appendix E	Groundwater Trend Analysis
Appendix F	BSA Permit No. 13-04-CH016
Appendix G	Discharge Report Summary Tables
Appendix H	Monitoring Well Inspection Logs

1.0 INTRODUCTION

1.1 Background

The Pfohl Brothers Landfill is located on Aero Drive in the Town of Cheektowaga, New York (Figure 1-1). The site is listed as site No. 915043 on the New York State Department of Environmental Conservation's (NYSDEC's) Registry of Inactive Hazardous Waste Disposal Sites. A Consent Order between NYSDEC and potentially responsible parties (PRPs) for closure of the site was signed in 2001 and remedial construction commenced in 2001. The remedy included consolidation of waste material, capping of the waste disposal and consolidation areas, and encircling the landfill areas with a groundwater collection system to prevent off-site migration. The remedial action was completed in 2002.

Responsibility for implementing the remedy was divided between a "steering committee" of industrial PRPs and the Town of Cheektowaga. The steering committee responsibilities lay generally with the capital construction activities of the remedy including waste consolidation, cap and drainage system installation, etc. The Town of Cheektowaga, which was named as a PRP for disposal of municipal waste at the Pfohl Brothers Landfill when it was operating, is performing the operation and maintenance (O&M) activities at the landfill, pursuant to a settlement agreement between the Town and the steering committee.

1.2 Operation and Maintenance Activities

While construction of the remedy was substantially complete by late 2002, the final O&M manual was not approved by the NYSDEC until March 10, 2006. However, the Town of Cheektowaga and its consultant (URS Corporation – New York) assumed most of the operational responsibilities since 2002. This includes a variety of general maintenance activities as outlined in Section 2 and sampling and other monitoring activities outlined in Section 3.

Beginning in 2004, the Town and URS assumed all of the O&M activities described in the O&M plan. This report is the twentieth semi-annual report as called for by Section 3.6 of the O&M plan.

2.0 GENERAL MAINTENANCE ACTIVITIES

Since completion of construction activities in 2002, personnel from the Town of Cheektowaga Engineering Department have performed general activities to ensure the physical operation of the landfill as intended by the design. The various O&M activities performed by the Town from July 2013 through December 2013 include the following actions.

- The amount of groundwater discharged through the collection system was recorded on a daily basis. The flow rate displayed by each wet well pump at the time of daily inspection and the total cumulative volume of flow was recorded for each wet well on daily inspection sheets. Examples of the daily inspection sheet are attached in Appendix A.
- Total cumulative effluent flow rates and volumes were summarized on a monthly basis starting in February 2003. The monthly totals for the period of July 2013 through December 2013, including graphs showing daily total discharge (gallons) as a function of calendar day, are presented in Appendix B.
- The wet well pumps were shutdown during wet weather flow conditions throughout the year to reduce hydraulic loading to the sewer. Such actions were only taken upon request of the Buffalo Sewer Authority during heavy storm events in order to reduce the hydraulic load on the BSA treatment system during such events. Shutdown events are recorded and included with the monthly flow data as previously requested by NYSDEC.
- Plowed snow to access the Control Building when necessary.
- Cleaned/replaced check valves as necessary at all wet wells.
- Replaced surge suppressors and fuses as needed for pump station instrumentation equipment.
- Contractor mowed entire cap and perimeter areas and trimmed along fence (September 2013).

- Engaged wildlife control trapper and trapped six (6) woodchucks in area south of stone access road between WW-4 and WW-5 (October 2013).
- Purchased supply of surge suppression devices for inventory (October 2013).
- Engaged electrical contractor to repair and re-splice electrical cable connections for WW-3 instrumentation (October 2013).
- Replaced discharge hose at WW-3 (December 2013).

3.0 MONITORING ACTIVITIES

The Town of Cheektowaga retained URS Corporation to perform monitoring activities as outlined in Section 3.1 of the O&M plan. During the period of January 2004 through the present, URS performed groundwater hydraulic monitoring (Section 3.1.1.2 of the O&M plan) and effluent monitoring (Section 3.1.4 of the O&M plan) on a quarterly basis. URS also performed the twentieth semi-annual groundwater quality monitoring event (Section 3.1.1.3 of the O&M plan). A summary of the monitoring activities is presented in the following subsections. Hydraulic and groundwater sampling locations are shown on Figure 3-1.

3.1 Groundwater Hydraulic Monitoring

Groundwater and surface water elevations were monitored on a quarterly basis at all locations listed in Table 3.1 of the O&M Plan. The hydraulic monitoring data tables showing groundwater elevations are presented in Appendix C. Table 1 of this appendix lists the measured elevations. Table 2 provides a comparison of the measured levels in the wells and corresponding manholes/wet wells.

The data presented in Appendix C indicate that groundwater levels outside the collection system were higher than the levels measured in the corresponding wet well or manhole for each measurement date with only one exception. The water elevation in WW-6 was slightly higher (0.07') than the nearest monitoring well GW-34S on September 10, 2013. Therefore, these data demonstrate that the collection system is generally operating as designed.

3.2 Groundwater Quality Monitoring

The twentieth semi-annual round of groundwater sampling was conducted between November 13, 2013 and November 15, 2013. All wells listed in Table 3.2 of the O&M plan were purged and sampled using dedicated/disposable equipment. Figure 3-1 shows the well locations. Low flow sampling techniques were used at most monitoring well locations.

Passive diffusion bags (PDBs) were placed in three monitoring wells with low recharge rates (GW-4S, GW-7S, and GW-7D) on October 12, 2013. The PDBs were removed from the wells during the sampling event and their contents were analyzed for VOCs. Following removal of the PDBs the three wells were purged dry. These wells were sampled for the other required parameters after their water levels recovered.

Purge logs and sampling summary sheets are provided in Appendix D. Measurements of pH, specific conductivity, temperature, dissolved oxygen, oxidation reduction potential, and turbidity taken during purging are provided in Appendix D. The samples were packed with ice in coolers and transported under chain-of-custody (CoC) control to Test America Laboratories of Amherst, New York.

Table 3-1 of this report presents the groundwater sample results compared with NYSDEC Ambient Water Quality Standards and Guidance Values and Groundwater Effluent Limitations Class GA water quality standards. Groundwater samples were analyzed for the parameters listed in Table 3.2 of the O&M plan as revised in accordance with Table 3-6 in the Semi Annual Report dated September 2007 (January through June 2007) and as approved by the December 6, 2006 and November 29, 2007 correspondence from the NYSDEC authorizing a reduction in the parameters list (this table is included in this report as Table 3-2).

Results

No VOCs or SVOCs were detected at concentrations above the Class GA water quality standards at any location.

Among the metals, iron, magnesium, manganese, and sodium routinely exceed Class GA standards in most site wells. Chromium and nickel were detected at concentrations exceeding their Class A standards at well GW-03S. Antimony, chromium, lead, and nickel were detected at concentrations exceeding Class GA standards in well GW-07D. It is noted that GW-07D is located upgradient of the site.

Comparison to Historical Results

No significant changes in metals concentrations were observed when compared to previous sampling event analytical results. The concentration of iron, magnesium, manganese, and sodium in most site wells was similar to the concentrations found during previous sampling events.

The concentrations of chromium and nickel at GW-03S and GW-07D, and concentrations of antimony, lead, and nickel at GW-07D, were within the historical range of concentrations observed for these compounds at these wells. The concentration of chromium at GW-07D was the highest it has been since sampling began.

Sodium concentrations were generally higher in bedrock wells (GW-01D, GW-03D, GW-08D and GW-26D) and shallow wells adjacent to roads (GW-01S and GW-30S). The sodium concentration was also elevated in GW-08SR. The higher sodium concentrations in the bedrock wells may be attributed to the local bedrock composition and the elevated concentration in the shallow wells may be the result of seasonal road de-icing activities.

Trend Analysis

A trend analysis of groundwater parameters that routinely exceed Class GA groundwater standards was performed and is presented in Figures E-1 through E-19 of Appendix E. A review of the trend analysis indicated that no significant changes or trends in concentrations of any of the parameters exceeding groundwater standards have occurred over the twenty semi-annual sampling events except as described below. Figure E-2 for GW-01S, indicates an upward trend in iron over the last five sampling events, a recent upward trend in manganese concentrations, and a downward trend in sodium concentration over the twenty sampling events. Figure E-3 for GW-03D indicates a downward trend for manganese. Figure E-4 indicates a slight upward trend for magnesium in GW-03S since monitoring began and magnesium and manganese were detected at their highest concentrations since monitoring began during this event. Figure E-5 for GW-04D, indicates a slight increasing trend for magnesium. Figure E-6 for GW-04S shows a slight upward trend for magnesium over the last 12 events. Figure E-7 for GW-07D shows upward trends for

chromium, iron, and lead over the last eleven events. Figure E-9 for GW-08D shows a decreasing trend for both iron and manganese since monitoring began. Figures E-10 and E-11 for GW-08SR and GW-26D, respectively, show an upward trend in sodium concentrations since monitoring began. Figure E-10 for GW-08SR also indicates a slight upward trend for manganese. Figure E-11 for GW-26D indicates a downward trend for manganese. Figures E-12 for GW-28S indicates a decreasing trend for sodium since monitoring began. Figure E-13 for GW-29S shows a slight increasing trend for magnesium over the last 17 events and a downward trend for sodium since monitoring began. Figure E-14 for GW-30S indicates a downward trend for iron, magnesium, manganese, and sodium. Figure E-16 shows there is a seasonal variation in sodium concentration in monitoring well GW-32S. Figures E-17 and E-18 for GW-33S and GW-34S indicate a seasonal fluctuation in manganese concentration.

Laboratory Report

The groundwater analytical data package was prepared by Test America in accordance with NYSDEC Category A deliverable requirements. It was reviewed for compliance with analytical method requirements and the following guidelines: USEPA *Contract Laboratory Program (CLP) National Functional Guidelines for Organic Data Review*, EPA-540-R-99-008, October 1999; USEPA *CLP National Functional Guidelines for Inorganic Data Review*, EPA-540-R-01-008, July 2002; and USEPA *Region II Data Validation SOP for SW-846 Method 8290, PCDDs and PCDFs by High Resolution Gas Chromatography/High-Resolution Mass Spectrometry (HRGC/HRMS)*, SOP No. HW-19, Revision 1, October 1994. Qualifications applied to the data include "J/UJ" (estimated concentration/estimated quantitation limit), "J+" (estimated concentration with possible high bias), "J-" (estimated concentration with possible low bias), and "U" (not detected).

A Data Applicability Report (DAR) was prepared following the guidelines provided in NYSDEC Division of Environmental Remediation (DER-10) *Technical Guidance for Site Investigation and Remediation, Appendix 2B*, dated May 2010. The DAR dated June 2013 is submitted separately from this report.

3.3 Groundwater Discharge Monitoring

URS completed two quarterly sampling events (September 2013 and December 2013) of the groundwater collection system discharge since the previous semi-annual report. The sampling was performed in accordance with the requirements of Discharge Permit No. 13-04-CH016 between the Buffalo Sewer Authority and the Town of Cheektowaga. A copy of Permit No. 13-04-CH016 is included as Appendix F.

During the sampling events in September 2013 and December 2013, each regulated parameter was below the limits set by the permit. Copies of the data summary tables that were included with the monitoring reports are included as Appendix G.

3.4 Monitoring Well Inspections

During the November 2013 groundwater sampling event, a well inspection was performed. All wells appeared to be in good condition with the exception of previously existing damage to the risers on GW-07D, GW-01S, and GW-01D. The monitoring well inspection logs may be found in Appendix H.

4.0 SUMMARY AND RECOMMENDATIONS

General Maintenance: The Town will continue to maintain mechanical equipment at the landfill on an as-needed basis and operate the groundwater collection and discharge system as designed. The Town will also continue regular inspections, mow the cap once per year, and plow access to the control building during winter months as necessary.

Groundwater Hydraulic Monitoring: Hydraulic monitoring has been performed on a quarterly basis in conjunction with the discharge monitoring. Water level measurement data demonstrates that the hydraulic gradient is from outside the landfill towards the collection trench. Continued quarterly monitoring is recommended.

Groundwater Quality Monitoring: Groundwater sample results indicate that only low levels of organic compounds and metals are present. Similar concentrations of most parameters were found during previous sampling events. The twenty-first round of groundwater sampling will be conducted in May 2014. Low flow sampling techniques will be used. Passive diffusion bags will be used again for VOC analyses at the three wells (GW-4S, GW-7S, and GW-7D) that go dry even using low flow sampling techniques.

Groundwater Discharge Monitoring: Groundwater discharges remain within permit limits. Continued quarterly monitoring is recommended.


TABLES

TABLE 3-1
GROUNDWATER SAMPLE ANALYTICAL RESULTS
PFOHL BROTHERS LANDFILL SITE
NOVEMBER 2013

Location ID			GW-01D	GW-01S	GW-03D	GW-03S	GW-04D
Sample ID			GW-01D	GW-01S	GW-03D	GW-03S	GW-04D
Matrix			Groundwater	Groundwater	Groundwater	Groundwater	Groundwater
Depth Interval (ft)			-	-	-	-	-
Date Sampled			11/15/13	11/15/13	11/13/13	11/13/13	11/14/13
Parameter	Units	*					
Volatile Organic Compounds						1	
1,2-Dichloroethene (total)	UG/L	5					
Acetone	UG/L	50					
Semivolatile Organic Compounds							
1,3-Dichlorobenzene	UG/L	3			1.2 J		
1,4-Dichlorobenzene	UG/L	3			1.7 J		
bis(2-Ethylhexyl)phthalate	UG/L	5					
Metals							
Antimony	MG/L	0.003					
Arsenic	MG/L	0.025		0.0062 J			
Barium	MG/L	1	0.072	0.17	0.066	0.16	0.082
Cadmium	MG/L	0.005				0.00096 J	
Chromium	MG/L	0.05	0.015	0.0039 J	0.0088	0.085	0.0017 J
Copper	MG/L	0.2		0.0020 J	0.0016 J	0.0083 J	
Iron	MG/L	0.3	0.21	12.7	1.3	2.0	0.23
Lead	MG/L	0.025					0.0041 J
Magnesium	MG/L	35	34.0	16.0	14.3	126	77.9
Manganese	MG/L	0.3	0.017	1.3	0.38	0.60	0.021
Nickel	MG/L	0.1	0.013	0.0024 J	0.0036 J	0.19	
Sodium	MG/L	20	97.3	84.6	138	69.0	82.0
Zinc	MG/L	2	0.0021 J	0.0046 J	0.0024 J	0.033	0.0038 J

* - NYSDEC TOGS (1.1.1), Ambient Water Quality Standards and Guidance Values and Groundwater Effluent Limitations, June 1998 (includes 4/2000 Addendum), Class GA. * - PCB Criteria based on sum of the aroclors.

Flags assigned during chemistry validation are shown.

 Concentration Exceeds

J - The analyte was positively identified, the quantitation is an estimation with possible low bias.

NA - Not Analyzed


Only Detected Results Reported.

TABLE 3-1
GROUNDWATER SAMPLE ANALYTICAL RESULTS
PFOHL BROTHERS LANDFILL SITE
NOVEMBER 2013

Location ID			GW-04S	GW-04S	GW-07D	GW-07D	GW-07S
Sample ID			GW-04S	GW-04S	GW-07D	GW-07D	GW-07S
Matrix			Groundwater	Groundwater	Groundwater	Groundwater	Groundwater
Depth Interval (ft)			-	-	-	-	-
Date Sampled			11/14/13	11/14/13	11/13/13	11/14/13	11/13/13
Parameter	Units	*					
Volatile Organic Compounds							
1,2-Dichloroethene (total)	UG/L	5		NA		NA	
Acetone	UG/L	50		NA		NA	
Semivolatile Organic Compounds							
1,3-Dichlorobenzene	UG/L	3	NA		NA		NA
1,4-Dichlorobenzene	UG/L	3	NA		NA		NA
bis(2-Ethylhexyl)phthalate	UG/L	5	NA		NA	2.7 J	NA
Metals							
Antimony	MG/L	0.003	NA		NA	0.0086 J	NA
Arsenic	MG/L	0.025	NA		NA	0.0095 J	NA
Barium	MG/L	1	NA	0.092	NA	0.14	NA
Cadmium	MG/L	0.005	NA		NA	0.0050	NA
Chromium	MG/L	0.05	NA	0.0041	NA	1.0	NA
Copper	MG/L	0.2	NA	0.0019 J	NA	0.15	NA
Iron	MG/L	0.3	NA	1.0	NA	70.6	NA
Lead	MG/L	0.025	NA		NA	0.65	NA
Magnesium	MG/L	35	NA	27.5	NA	37.1	NA
Manganese	MG/L	0.3	NA	0.11	NA	0.32	NA
Nickel	MG/L	0.1	NA	0.0039 J	NA	0.52	NA
Sodium	MG/L	20	NA	28.0	NA	73.1	NA
Zinc	MG/L	2	NA	0.0094 J	NA	0.39	NA

* - NYSDEC TOGS (1.1.1), Ambient Water Quality Standards and Guidance Values and Groundwater Effluent Limitations, June 1998 (includes 4/2000 Addendum). Class GA. * - PCB Criteria based on sum of the aroclors.

Flags assigned during chemistry validation are shown.

 Concentration Exceeds

J - The analyte was positively identified, the quantitation is an estimation with possible low bias.

NA - Not Analyzed


Only Detected Results Reported.

TABLE 3-1
GROUNDWATER SAMPLE ANALYTICAL RESULTS
PFOHL BROTHERS LANDFILL SITE
NOVEMBER 2013

Location ID			GW-07S	GW-08D	GW-08D	GW-08SR	GW-26D
Sample ID			GW-07S	FD-111313	GW-08D	GW-08SR	GW-26D
Matrix			Groundwater	Groundwater	Groundwater	Groundwater	Groundwater
Depth Interval (ft)			-	-	-	-	-
Date Sampled			11/14/13	11/13/13	11/13/13	11/13/13	11/14/13
Parameter	Units	*		Field Duplicate (1-1)			
Volatile Organic Compounds							
1,2-Dichloroethene (total)	UG/L	5	NA				1.4 J
Acetone	UG/L	50	NA				4.0 J
Semivolatile Organic Compounds							
1,3-Dichlorobenzene	UG/L	3					
1,4-Dichlorobenzene	UG/L	3					
bis(2-Ethylhexyl)phthalate	UG/L	5					
Metals							
Antimony	MG/L	0.003					
Arsenic	MG/L	0.025				0.0093 J	
Barium	MG/L	1	0.26	0.090	0.094	0.41	0.15
Cadmium	MG/L	0.005	0.00080 J				
Chromium	MG/L	0.05	0.014	0.0066	0.0066	0.0034 J	
Copper	MG/L	0.2	0.0024 J	0.0037 J	0.0042 J	0.0018 J	
Iron	MG/L	0.3	0.34	0.17	0.19	25.9	5.5
Lead	MG/L	0.025				0.0044 J	
Magnesium	MG/L	35	36.1	17.4	18.1	48.2	23.1
Manganese	MG/L	0.3	0.072	0.096	0.092	1.4	0.65
Nickel	MG/L	0.1	0.015	0.0046 J	0.0051 J	0.0039 J	0.0049 J
Sodium	MG/L	20	52.3	165	171	363	307
Zinc	MG/L	2	0.011	0.0064 J	0.0081 J	0.0066 J	0.0028 J

* - NYSDEC TOGS (1.1.1), Ambient Water Quality Standards and Guidance Values and Groundwater Effluent Limitations, June 1998 (includes 4/2000 Addendum), Class GA. * - PCB Criteria based on sum of the aroclors.

Flags assigned during chemistry validation are shown.

 Concentration Exceeds

J - The analyte was positively identified, the quantitation is an estimation with possible low bias.

NA - Not Analyzed


Only Detected Results Reported.

TABLE 3-1
GROUNDWATER SAMPLE ANALYTICAL RESULTS
PFOHL BROTHERS LANDFILL SITE
NOVEMBER 2013

Location ID			GW-28S	GW-29S	GW-30S	GW-31S	GW-32S
Sample ID			GW-28S	GW-29S	GW-30S	GW-31S	GW-32S
Matrix			Groundwater	Groundwater	Groundwater	Groundwater	Groundwater
Depth Interval (ft)			-	-	-	-	-
Date Sampled			11/14/13	11/14/13	11/15/13	11/15/13	11/15/13
Parameter	Units	*					
Volatile Organic Compounds							
1,2-Dichloroethene (total)	UG/L	5					
Acetone	UG/L	50					
Semivolatile Organic Compounds							
1,3-Dichlorobenzene	UG/L	3					
1,4-Dichlorobenzene	UG/L	3					
bis(2-Ethylhexyl)phthalate	UG/L	5					
Metals							
Antimony	MG/L	0.003					
Arsenic	MG/L	0.025		0.022			
Barium	MG/L	1	0.086	0.19	0.14	0.068	0.064
Cadmium	MG/L	0.005					
Chromium	MG/L	0.05				0.0016 J	
Copper	MG/L	0.2			0.0022 J	0.0023 J	
Iron	MG/L	0.3	0.25	11.7	7.5	0.25	0.11
Lead	MG/L	0.025					
Magnesium	MG/L	35	28.4	72.8	36.2	33.1	33.7
Manganese	MG/L	0.3	1.1	0.65	1.0	0.86	0.35
Nickel	MG/L	0.1	0.0023 J	0.0015 J	0.0030 J	0.0069 J	0.0032 J
Sodium	MG/L	20	13.8	8.7	59.5	5.3	5.2
Zinc	MG/L	2	0.0045 J	0.0026 J	0.0015 J	0.0062 J	0.0055 J

* - NYSDEC TOGS (1.1.1), Ambient Water Quality Standards and Guidance Values and Groundwater Effluent Limitations, June 1998 (includes 4/2000 Addendum). Class GA. * - PCB Criteria based on sum of the arachnids.

Flags assigned during chemistry validation are shown.

 Concentration Exceeds

J - The analyte was positively identified, the quantitation is an estimation with possible low bias.

NA - Not Analyzed


Only Detected Results Reported.

TABLE 3-1
GROUNDWATER SAMPLE ANALYTICAL RESULTS
PFOHL BROTHERS LANDFILL SITE
NOVEMBER 2013

Location ID			GW-33S	GW-34S	GW-35S
Sample ID			GW-33S	GW-34S	GW-35S
Matrix			Groundwater	Groundwater	Groundwater
Depth Interval (ft)			-	-	-
Date Sampled			11/15/13	11/14/13	11/14/13
Parameter	Units	*			
Volatile Organic Compounds					
1,2-Dichloroethene (total)	UG/L	5			
Acetone	UG/L	50			
Semivolatile Organic Compounds					
1,3-Dichlorobenzene	UG/L	3			
1,4-Dichlorobenzene	UG/L	3			
bis(2-Ethylhexyl)phthalate	UG/L	5	2.9 J		
Metals					
Antimony	MG/L	0.003			
Arsenic	MG/L	0.025			
Barium	MG/L	1	0.039	0.14	0.082
Cadmium	MG/L	0.005			
Chromium	MG/L	0.05	0.0016 J	0.0029 J	
Copper	MG/L	0.2	0.0017 J	0.0021 J	
Iron	MG/L	0.3		0.12	0.067
Lead	MG/L	0.025			
Magnesium	MG/L	35	38.8	52.4	24.6
Manganese	MG/L	0.3	0.013	0.12	0.13
Nickel	MG/L	0.1	0.0019 J	0.0054 J	0.0018 J
Sodium	MG/L	20	4.3	23.7	2.6
Zinc	MG/L	2	0.0032 J	0.0022 J	0.0042 J

* - NYSDEC TOGS (1.1.1), Ambient Water Quality Standards and Guidance Values and Groundwater Effluent Limitations, June 1998 (includes 4/2000 Addendum). Class GA. * - PCB Criteria based on sum of the aroclors.

Flags assigned during chemistry validation are shown.

 Concentration Exceeds

J - The analyte was positively identified, the quantitation is an estimation with possible low bias.

NA - Not Analyzed

Only Detected Results Reported.

TABLE 3-2

APPROVED REVISION OF TABLE 3.2 FROM THE O&M PLAN

GROUNDWATER SAMPLING SUMMARY
OPERATION AND MAINTENANCE PLAN
PFOHL BROTHERS LANDFILL SITE, CHEEKTOWAGA, NEW YORK

LOCATIONS

GW-1D/1S
GW- 3D/3S
GW- 4D/4S
GW- 7D/7S
GW- 8D/8S(R)
GW- 26D/35S
GW- 28S
GW- 29S
GW- 30S
GW- 31S
GW- 32S
GW- 33S
GW- 34S

FREQUENCY

semi-annually for overburden and bedrock groundwater

PARAMETERS

<i>Field</i>	pH conductivity temperature turbidity
<i>VOCs</i>	Acetone Benzene 1,2-Dichloroethene (total) 1,1,2-Trichloroethane Vinyl chloride
<i>SVOCs</i>	Phenol 1,3-Dichlorobenzene 1,4-Dichlorobenzene bis(2-Ethylhexyl)phthalate

TABLE 3-2 (continued)


APPROVED REVISION OF TABLE 3.2 FROM THE O&M PLAN

**GROUNDWATER SAMPLING SUMMARY
OPERATION AND MAINTENANCE PLAN
PFOHL BROTHERS LANDFILL SITE, CHEEKTOWAGA, NEW YORK**

PARAMETERS (cont'd)

<i>Metals</i>	Antimony
	Arsenic
	Barium
	Cadmium
	Chromium
	Copper
	Iron
	Lead
	Magnesium
	Manganese
	Mercury
	Nickel
	Silver
	Sodium
	Zinc

FIGURES

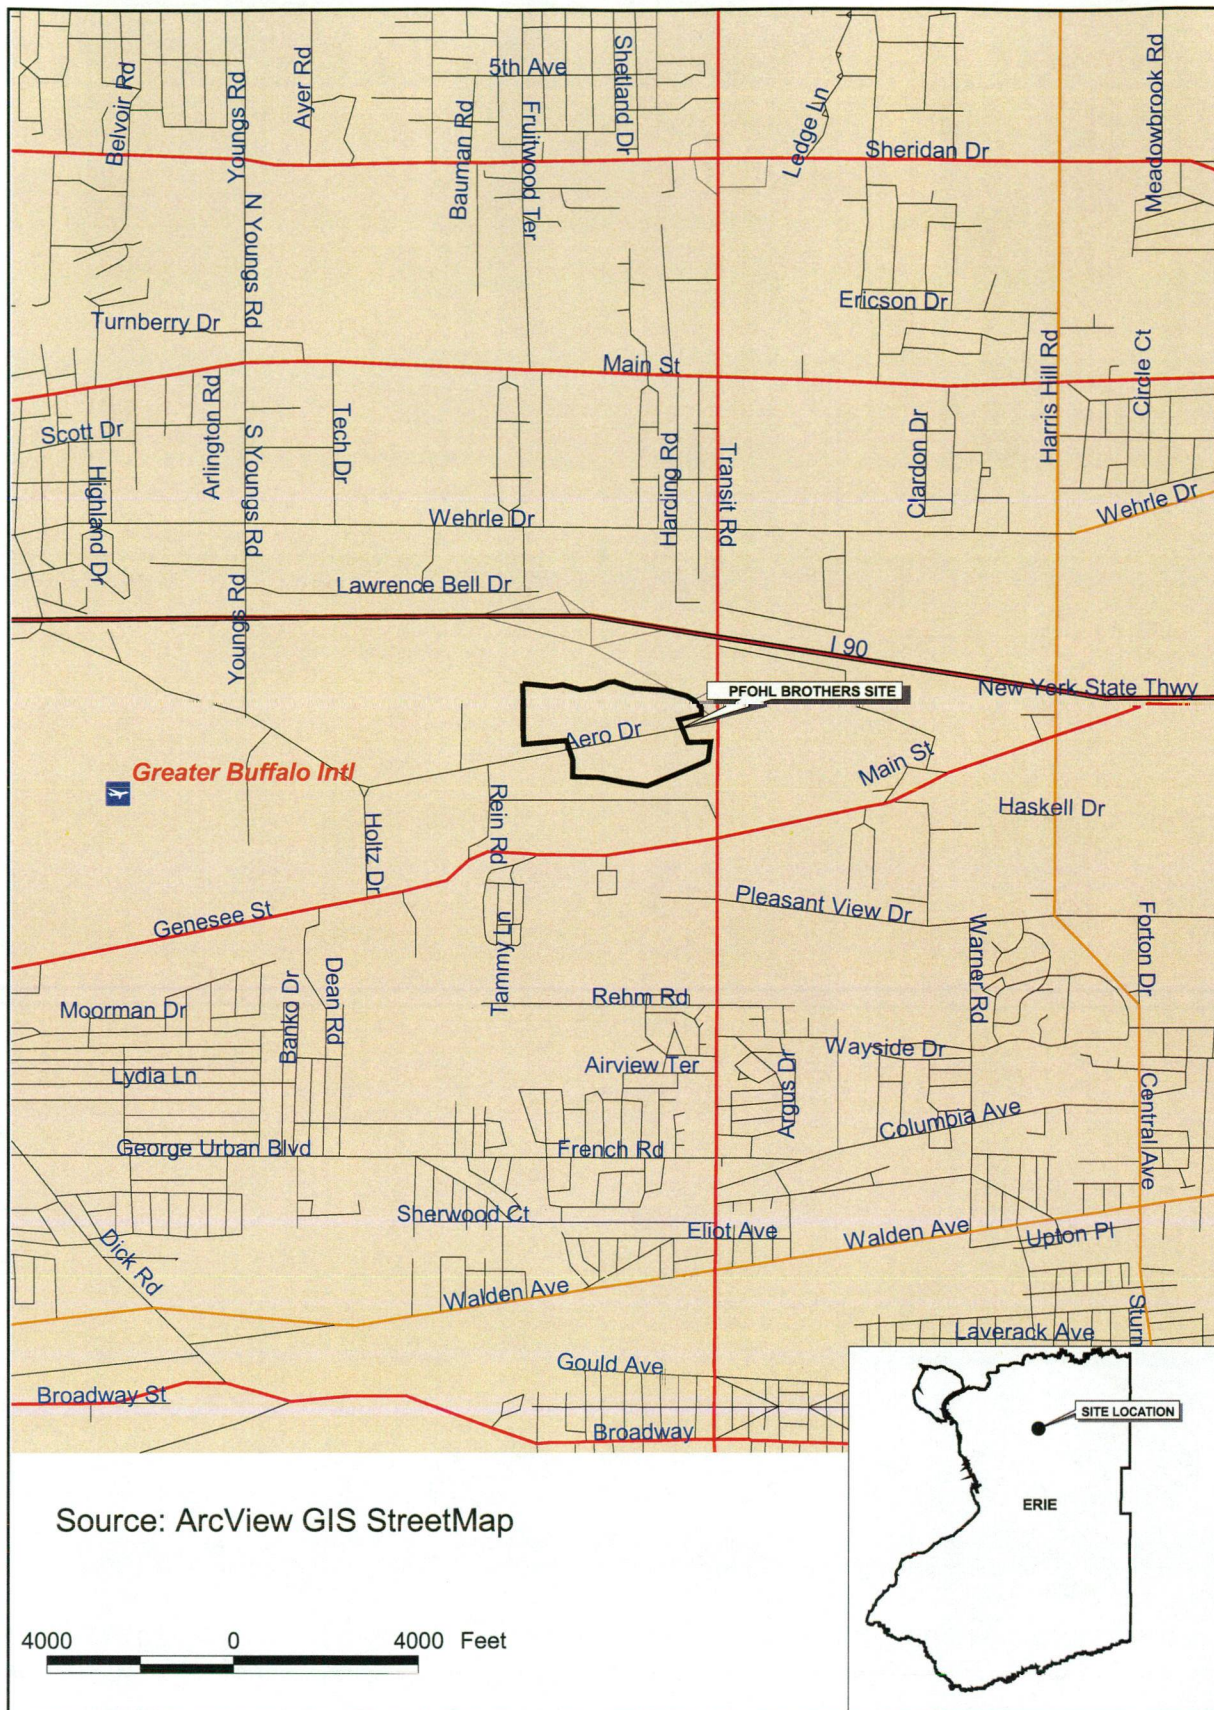


URS

PFOHL BROTHERS LANDFILL
SITE LOCATION MAP


FIGURE 1-1

\\NA1172700\000000\GIS\ArcView\pfohl.apr WELL LOCATIONS
-2/15/2005

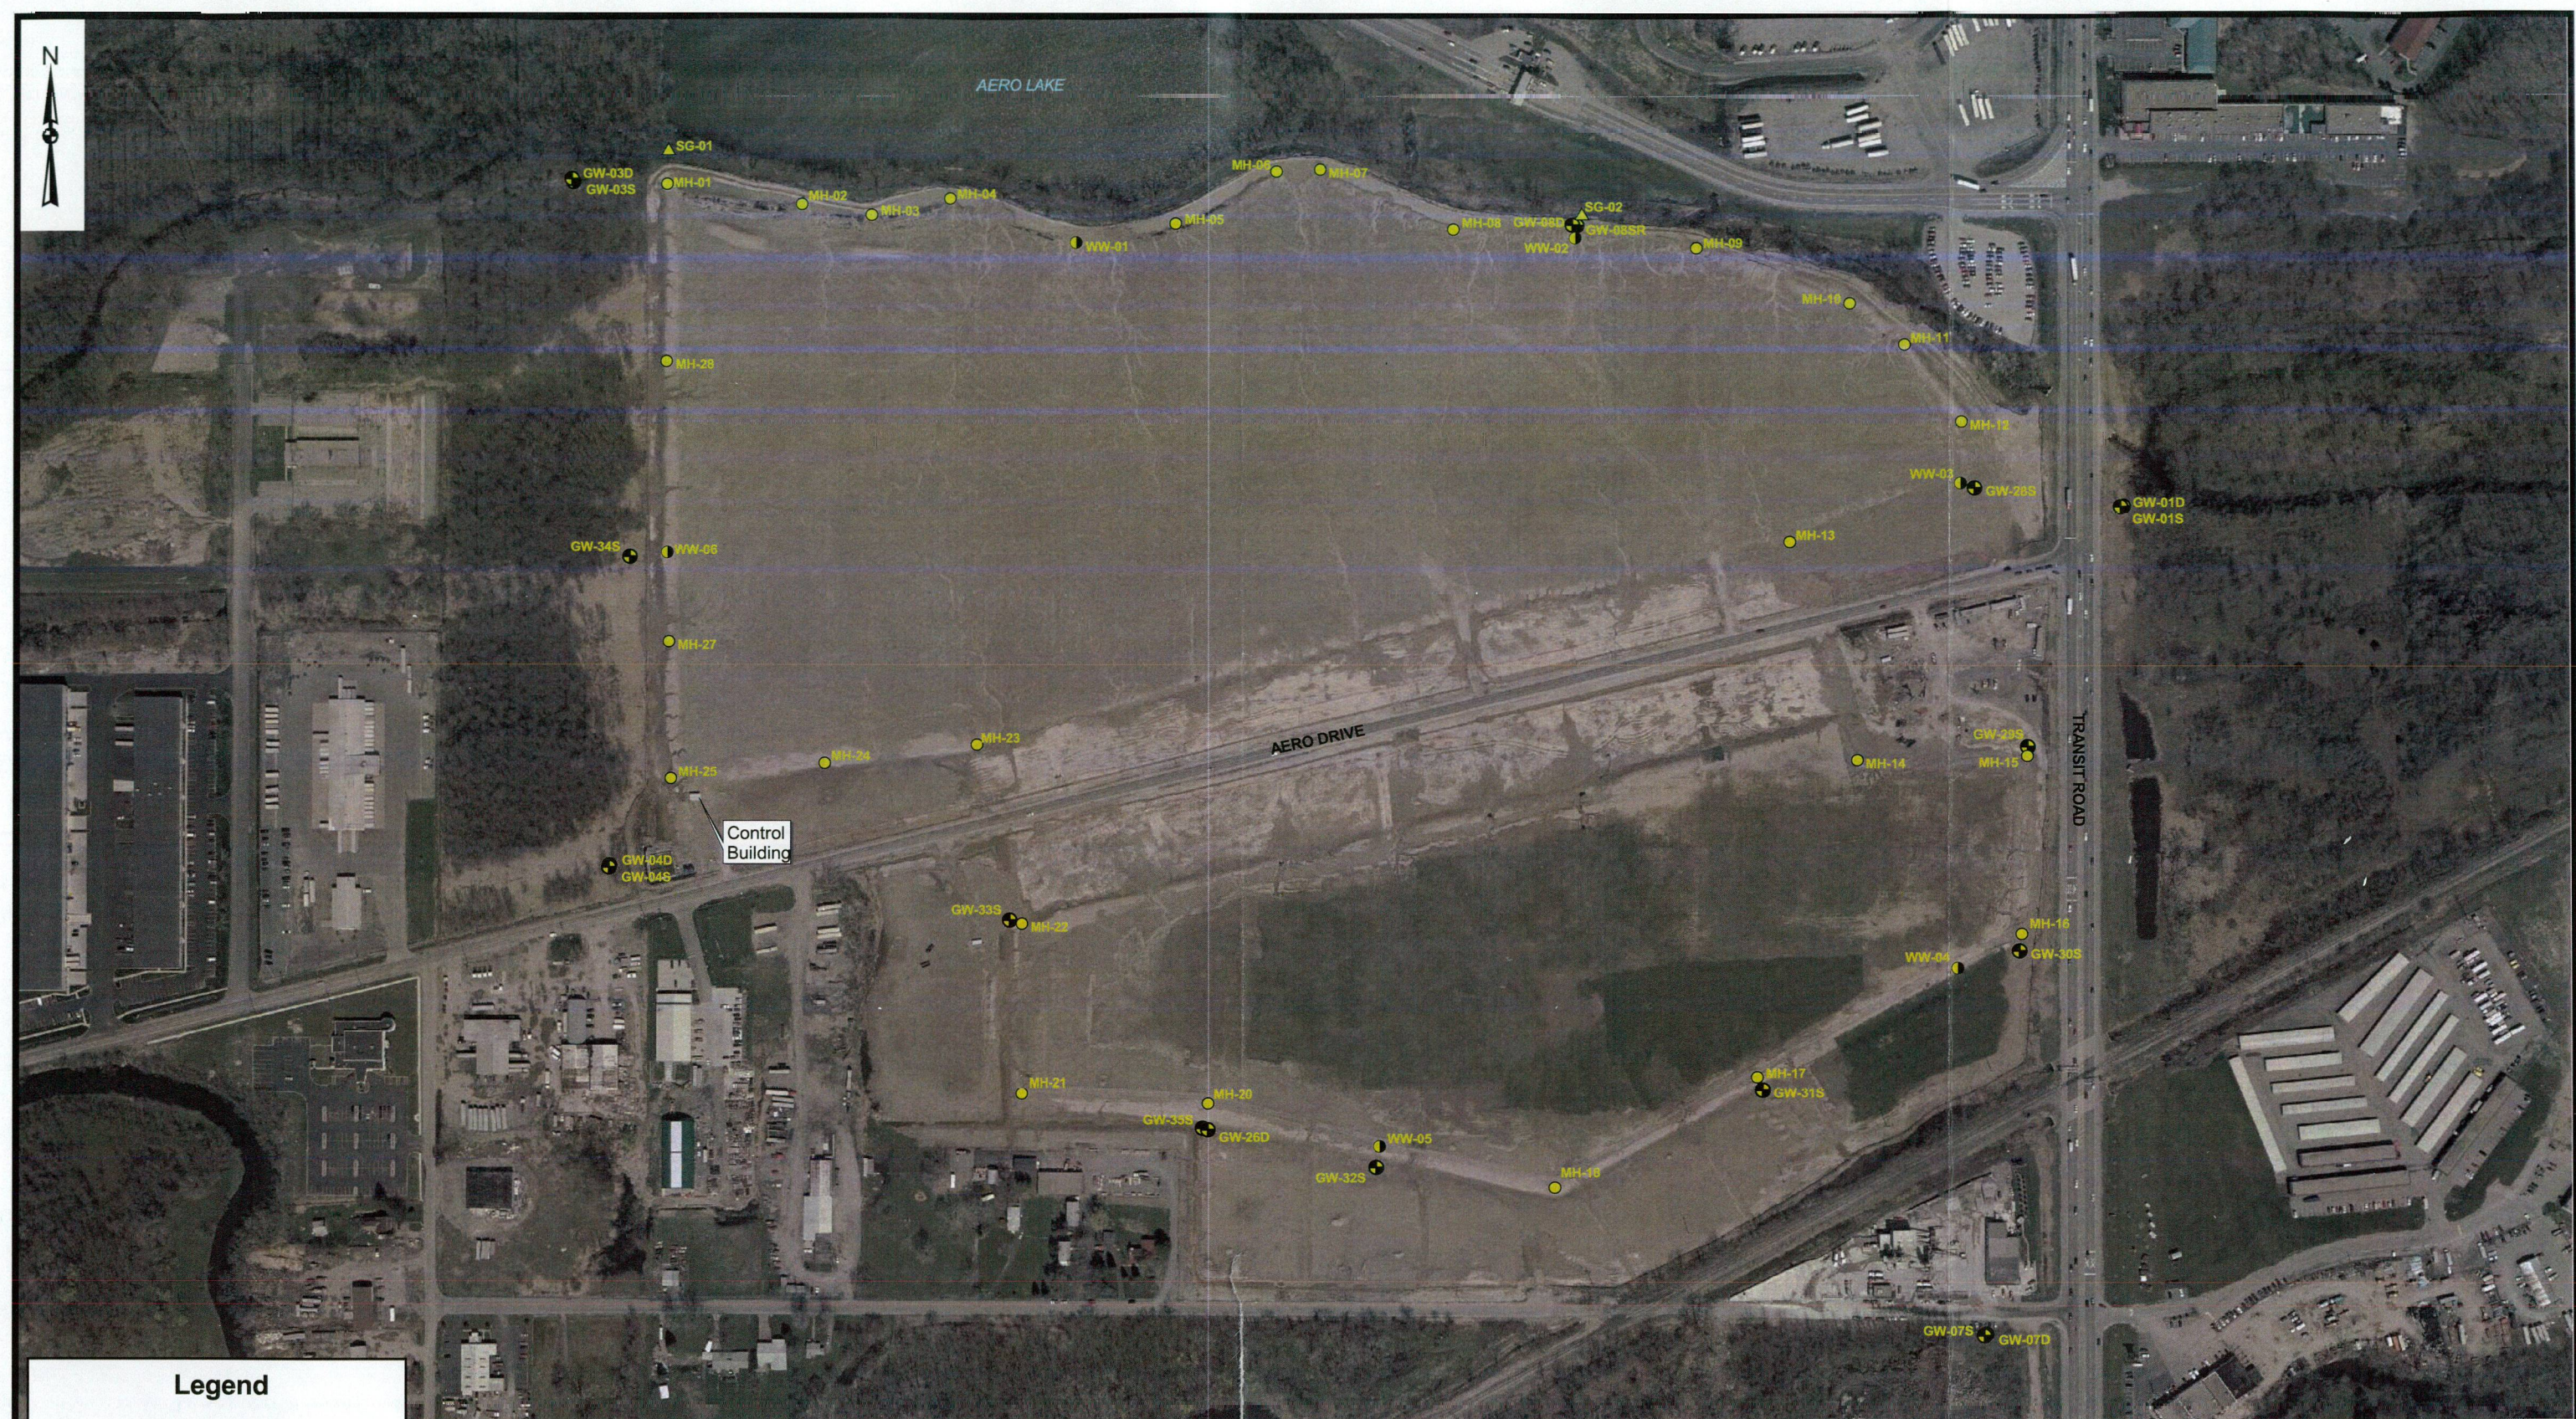

Legend

- Monitoring Well Location
- Staff Gauge Location
- Manhole Location
- Wet Well Location



PFOHL BROTHERS LANDFILL
MONITORING LOCATIONS



FIGURE 3-1

APPENDIX A

EXAMPLE DAILY INSPECTION SHEETS

Pfohl Brothers Landfill Site

Daily Logsheet

Town of Cheektowaga

Date 7/23/13
Time 2:06

Weather conditions B. PUGH
Read by: 80° SUNNY, NICE

	Level of Water from bottom (ft.)	Flow gallons / minute	Flow Totals gallons	Pump Run Time Hrs.
WW-3	7.7	0	23,000	2561
WW-2	4.7	0	-855	144
WW-1	4.1	0	226,177	2702
WW-6	6.6	0	0	9514
WW-4	7.0	0	19,787	5666
WW-5	5.6	54.3	271,646	10,826

Flow Totalizer at Meter chamber 537,717

Heat Trace

Outside temp T = 80
Current A = 0

Set point SP = 40

Surge Suppressor events 415,572

Motor Control Center

Volts 480 volts
Amps 9 amps

Which WW was running?

1 ☐ 2 ☐ 3 ☐ 4 ☐ 5 ☒ 6 ☐

Filter

Checked ☐

Changed ☐

Comments and/or Current Conditions

- RESET FLOW INVALID ALARMS

WW 3, 2, 6, 4

- INCREASE IN NEG. FLOW TO WW2 - NEED TO
INSPECT BALL CHECK VALVE.

- REMOVED SITE LOG SHEETS JAN - JUNE 2013
TO ENG. OFFICE

Pfohl Brothers Landfill Site

Daily Logsheet

Town of Cheektowaga

Date

8/29/13

Weather conditions

Clear 82°

Time

2:45

Read by:

Bill Pugh

	Level of Water from bottom (ft.)	Flow gallons / minute	Flow Totals gallons	Pump Run Time Hrs.
WW-3	99.0	0	23,339	2561
WW-2	4.7	0	-893	144
WW-1	4.7	0	201,358	2702
WW-6	7.3	0	293,353	9588
WW-4	7.0	0	54,452	5680
WW-5	7.2	0	682,310	10,954

Flow Totalizer at Meter chamber

1,276,342

Heat Trace

Outside temp T = 82

Set point SP = 40°

Current A = 0

Surge Suppressor events

415,605

Motor Control Center

Volts 460 volts

Which WW was running?

Amps 3 amps

1 2 3 4 5 6 0

Filter

Checked ☐

Changed ☐

Comments and/or Current Conditions

Delivered - (4) new 2" ball/check valves
to cabinet in control bldg.

Pfohl Brothers Landfill Site

Town of Cheektowaga

Daily Logsheets

Date 9-17-13
Time 2:05

Weather conditions SUNNY, 65°
Read by: BILL PUGH

	Level of Water from bottom (ft.)	Flow gallons / minute	Flow Totals gallons	Pump Run Time Hrs.
WW-3	6.3	0	24,193	2562
WW-2	4.7	0	-903	144
WW-1	4.0	51.7	342,830	2750
WW-6	99.0	0	293,590	9588
WW-4	6.9	0	49,204	5688
WW-5	7.1	0	875,331	11,018

Flow Totalizer at Meter chamber

1,629,791

Heat Trace

Outside temp T = 63°
Current A = 0

Set point SP = 40°

Large Suppressor events

415625

Motor Control Center

Volts 480 volts
Amps 5 amps

Which WW was running?

☒ 1 ☐ 2 ☐ 3 ☐ 4 ☐ 5 ☐ 6

Filter

Checked ☐

Changed ☐

Comments and/or Current Conditions

WW6 LEVEL INVALID ALARM - WILL NOT
RESET.

MOWCON ON SITE - FINISHING MOWING
IN AREA C - S. SIDE AERO

WILL BE HAND TRIMMING FENCE LINES
ETC. TOMORROW.

Pfohl Brothers Landfill Site

Daily Logsheet

Town of Cheektowaga

Date 10-15-13
Time 8:45

Weather conditions CLEAR, COOL 50
Read by: BILL PUGH

	Level of Water from bottom (ft.)	Flow gallons / minute	Flow Totals gallons	Pump Run Time Hrs.
WW-3	5.6	0	24,578	2562
WW-2	4.6	0	-11,231	144
WW-1	4.1	0	697,742	2873
WW-6	7.0	0	577,376	9665
WW-4	99.0	0	129,927	5726
WW-5	6.4	0	1,282,333	11164

Flow Totalizer at Meter chamber

2,762,426

Heat Trace

Outside temp T = 48
Current A = 0

Set point SP = 40

Surge Suppressor events

415,651

Motor Control Center

Volts 480 volts
Amps 3 amps

Which WW was running?

1 ☐ 2 ☐ 3 ☐ 4 ☐ 5 ☐ 6 ☒

Filter

Checked ☐

Changed ☒

Comments and/or Current Conditions

TOM PESTKA AT SITE, INVESTIGATING
WW4 ALARMS

APPENDIX B

MONTHLY FLOW SUMMARIES
JULY 2013 – DECEMBER 2013

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent
Joseph Glab
Asst. Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

August 3, 2013

Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga

Re: Pfohl Bros. Flow Data


Dear Mr. Pugh,

Enclosed for your review, please find a copy of the July 2013 Direct Discharge Flow Data Report, prepared by Jon W. Nichy.

On July 1, 2013 the Flow Totalizers were reset to zero.

Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.


Yours truly,


Jon W. Nichy
Superintendent
Main Pump Station

Direct Discharge Flow Data

6/30/2013		13212773	150,819	13,212,793	
July-13	Time; 11:58pm unless otherwise stated	Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	Notes
1		0	0	0	
2		30269	30,269	30,269	
3		63562	33,293	63,562	2307 inhibit
4		71315	7,753	71,315	1307 enable
5		91622	20,307	91,622	
6		125867	34,245	125,867	
7		144004	18,137	144,004	
8		158657	14,653	158,657	
9		159222	564	159,221	
10		178840	19,618	178,839	
11		198180	19,340	198,179	
12		208319	10,138	208,317	
13		241958	33,639	241,956	
14		328012	86,055	328,011	
15		353050	25,038	353,049	
16		372883	19,833	372,882	
17		392855	19,972	392,854	
18		410697	17,842	410,696	
19		424226	13,529	424,225	2142 inhibit
20		426109	1,883	426,108	0902 enable
21		469271	43,162	469,270	
22		531445	62,174	531,444	
23		563541	32,096	563,540	2206 inhibit
24		565953	2,411	565,951	1246 enable
25		572238	6,286	572,237	
26		584050	11,812	584,049	
27		584050	0	584,049	2138 inhibit
28		584050	0	584,049	1809 enable
29		593065	9,015	593,064	
30		629387	36,322	629,386	
31		635107	5,720	635,106	
		635,107	635,106	635,106	

July
2013

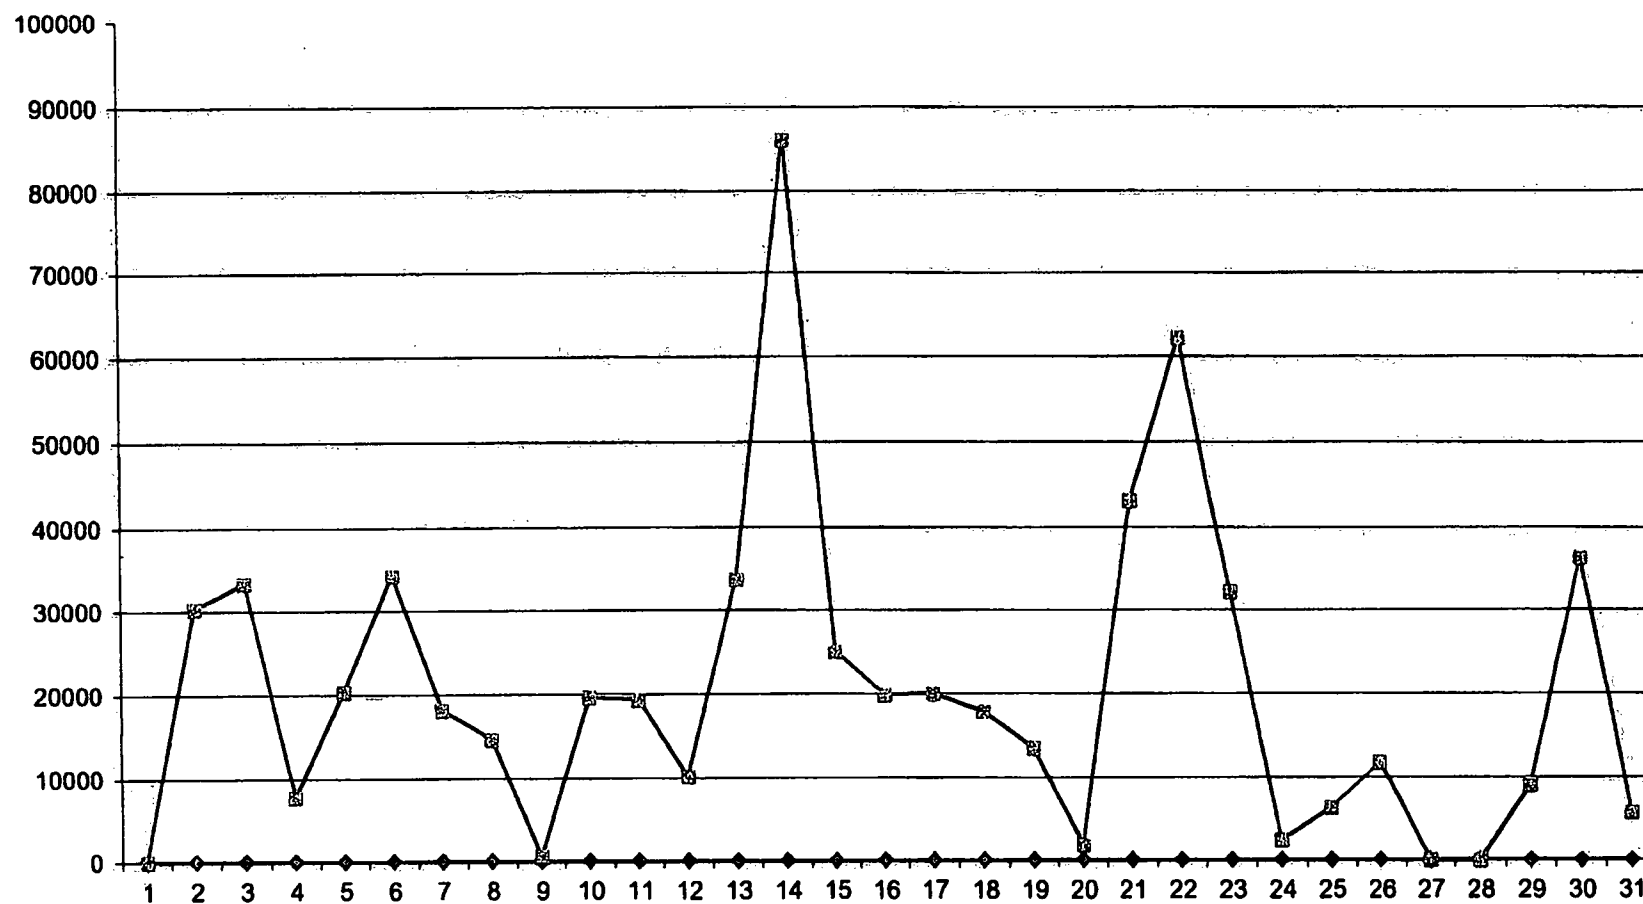

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent
Joseph Glab
Asst. Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

September 4, 2013

Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga


Re: Pfohl Bros. Flow Data

Dear Mr. Pugh,

Enclosed for your review, please find a copy of the August 2013 Direct Discharge Flow Data Report, prepared by Jon W. Nichy.

Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.

Yours truly,



Jon W. Nichy
Superintendent
Main Pump Station

Direct Discharge Flow Data

7/31/2013

		635107	5,720	635,106	
August-13	Time; 11:58pm unless otherwise stated	Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	Notes
1		643629	8,522	643,628	
2		700043	56,414	700,042	
3		719758	19,715	719,757	
4		730142	10,384	730,141	
5		828053	97,911	828,052	
6		877545	49,492	877,544	
7		899807	22,262	899,806	
8		909519	9,711	909,517	0216 inhibit 1156 enable
9		922667	13,148	922,665	0430 inhibit 1241 enable
10		922667	0	922,665	
11		941294	18,627	941,292	
12		960433	19,139	960,431	
13		969666	9,233	969,664	
14		988257	18,592	988,256	
15		1001326	13,089	1,001,325	
16		1084862	83,537	1,084,862	
17		1144813	59,950	1,144,812	
18		1153217	8,404	1,153,216	
19		1164939	11,723	1,164,939	
20		1184835	19,896	1,184,835	
21		1191087	6,252	1,191,087	
22		1201187	10,100	1,201,187	1639 inhibit 2348 enable
23		1220773	19,586	1,220,773	
24		1220773	0	1,220,773	
25		1242227	21,454	1,242,227	
26		1243662	1,435	1,243,662	1515 inhibit 2351 enable
27		1260398	16,736	1,260,398	0826 inhibit
28		1276342	15,945	1,276,343	0726 enable
29		1300333	23,991	1,300,334	
30		1346857	46,524	1,346,858	
31		1383122	36,265	1,383,123	
		748,015	748,017	748,017	

August
2013

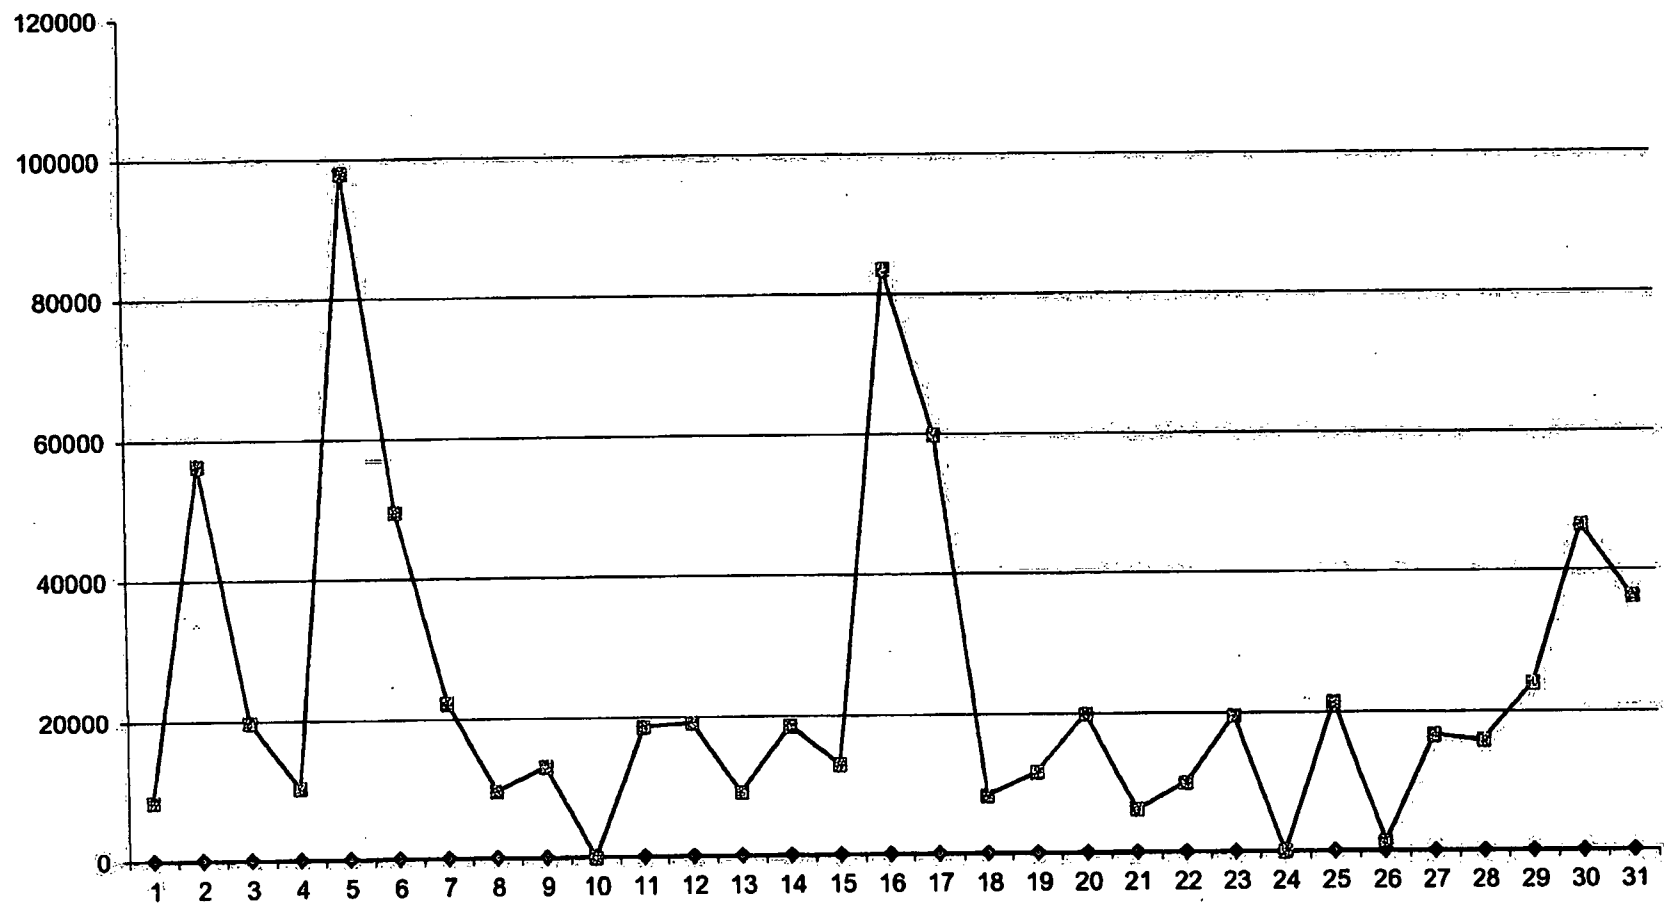

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent
Joseph Glab
Asst. Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

October 1, 2013

Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga


Re: Pfohl Bros. Flow Data

Dear Mr. Pugh,

Enclosed for your review, please find a copy of the September 2013 Direct Discharge Flow Data Report, prepared by Jon W. Nichy.

Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.

Yours truly,

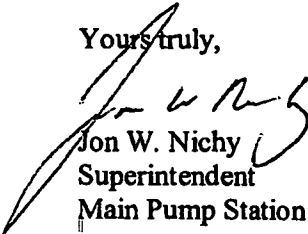

Jon W. Nichy
Superintendent
Main Pump Station

Direct Discharge Flow Data

8/31/2013

		1383122	36,265	1,383,123	
Sep-13	Time; 11:58pm unless otherwise stated	Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	Notes
1		1383122	0	1,383,123	
2		1383122	0	1,383,123	
3		1399304	16,182	1,399,305	
4		14233405	24,101	1,423,406	
5		1434967	11,563	1,434,969	
6		1445525	10,558	1,445,527	
7		1455720	10,194	1,455,721	
8		1467213	11,493	1,467,214	
9		1468491	1,278	1,468,492	
10		1513063	44,572	1,513,064	
11		1513063	0	1,513,064	2317 inhibit
12		1521395	8,332	1,521,396	0626 enable
13		1521395	0	1,521,396	
14		1521395	0	1,521,396	
15		1521395	0	1,521,396	
16		1584102	62,707	1,584,103	
17		1666196	82,094	1,666,197	
18		1685046	18,849	1,685,046	
19		1697873	12,827	1,697,873	
20		1709126	11,253	1,709,126	2146 inhibit
21		1709126	0	1,709,126	
22		1709126	0	1,709,126	
23		1709126	0	1,709,126	
24		1806618	97,492	1,806,618	0749 enable
25		1914529	107,911	1,914,529	
26		1942802	28,273	1,942,802	
27		1972632	29,830	1,972,632	
28		1972632	0	1,972,632	
29		1975302	2,671	1,975,303	
30		2023045	47,743	2,023,046	
31					
		639,923	639,923	639,923	

September
2013

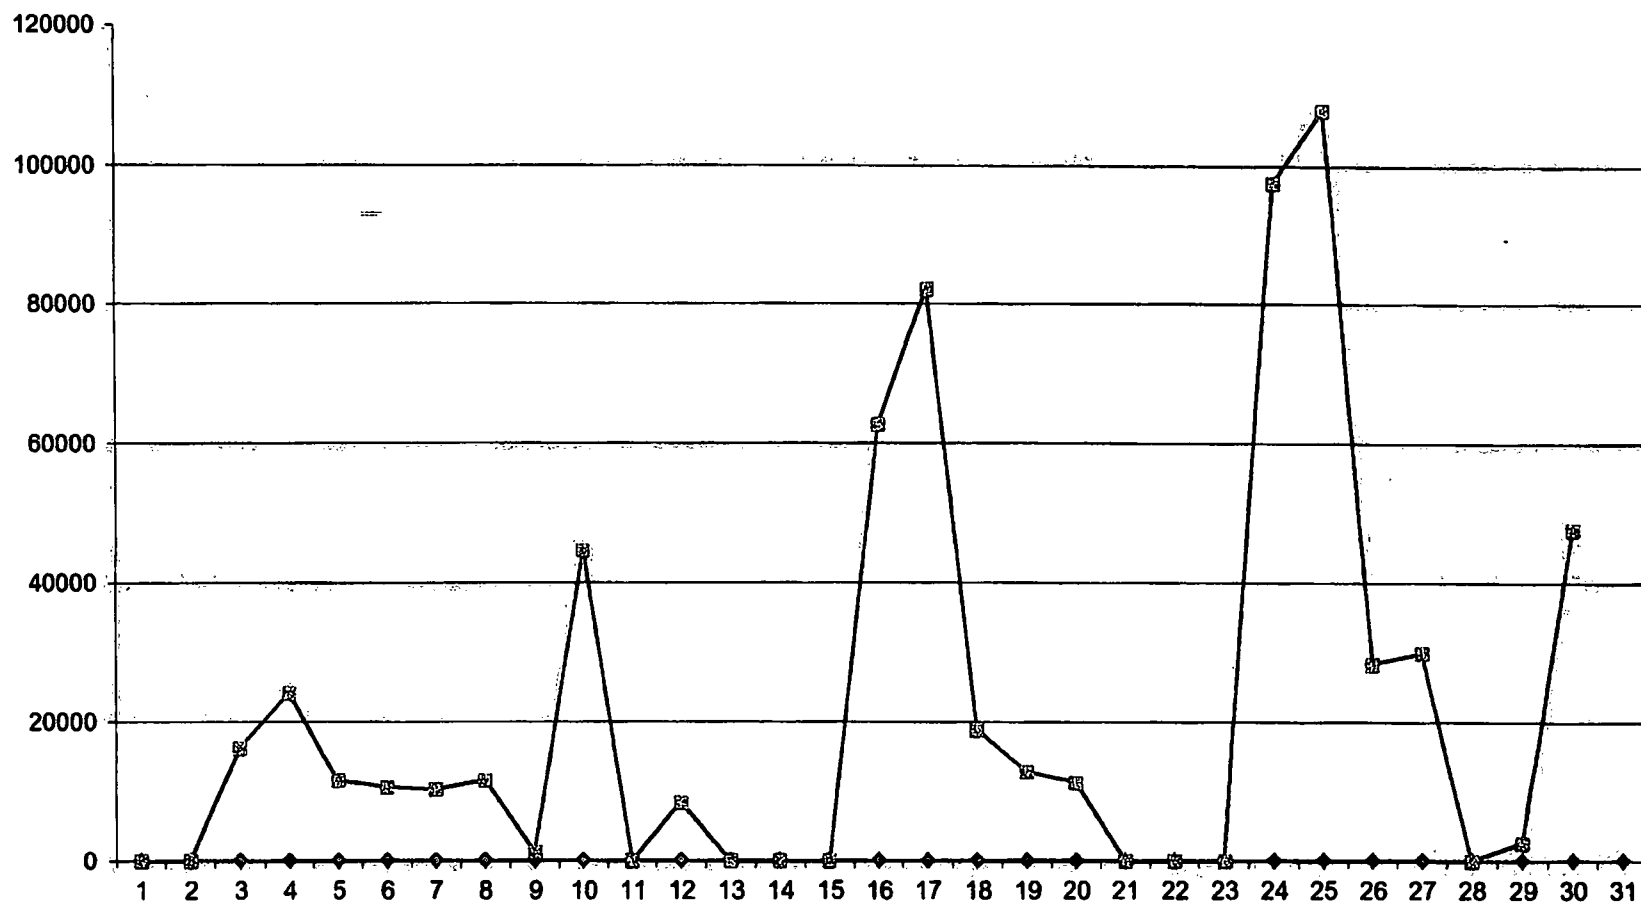

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent
Joseph Glab
Asst. Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

November 6, 2013

Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga


Re: Pfohl Bros. Flow Data

Dear Mr. Pugh,

Enclosed for your review, please find a copy of the October 2013 Direct Discharge Flow Data Report, prepared by Jon W. Nichy.

Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.

Yours truly,

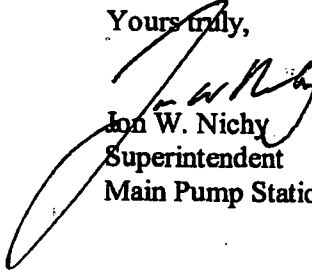

Jon W. Nichy
Superintendent
Main Pump Station

Direct Discharge Flow Data

9/30/2013

		2023045	47,743	2,023,046	
Oct-13	Time; 11:58pm unless otherwise stated	Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	Notes
1		2023186	141	2,023,187	
2		2028219	5,033	2,028,220	
3		2138849	110,630	2,138,850	
4		2141790	2,941	2,141,791	
5		2234008	92,218	2,234,009	
6		2244865	10,857	2,244,866	
7		2263529	18,664	2,263,530	0111 inhibit
8		2483378	219,849	2,483,379	2141 enable
9		2617650	134,272	2,617,651	
10		2661449	43,800	2,661,451	
11		2661449	0	2,661,451	
12		2666955	5,505	2,666,956	
13		2701787	34,832	2,701,788	
14		2737300	35,513	2,737,301	0106 inhibit 1345 enable
15		2769663	32,364	2,769,665	
16		2769663	0	2,769,665	1931 inhibit
17		2877335	107,672	2,877,337	0030 enable 1937 inhibit
18		2877335	0	2,877,337	
19		2877335	0	2,877,337	
20		3015534	138,199	3,015,536	0909 enable
21		3244561	229,027	3,244,563	
22		3249258	4,697	3,249,260	0016 inhibit 2353 enable
23		3436757	187,499	3,436,759	
24		3512590	75,833	3,512,592	
25		3513740	1,151	3,513,743	
26		3544392	30,652	3,544,395	2219 inhibit
27		3544392	0	3,544,395	
28		3544392	0	3,544,395	
29		3544392	0	3,544,395	
30		3544392	0	3,544,395	
31		3544392	0	3,544,395	
		1,521,347	1,521,349	1,521,349	

October
2013

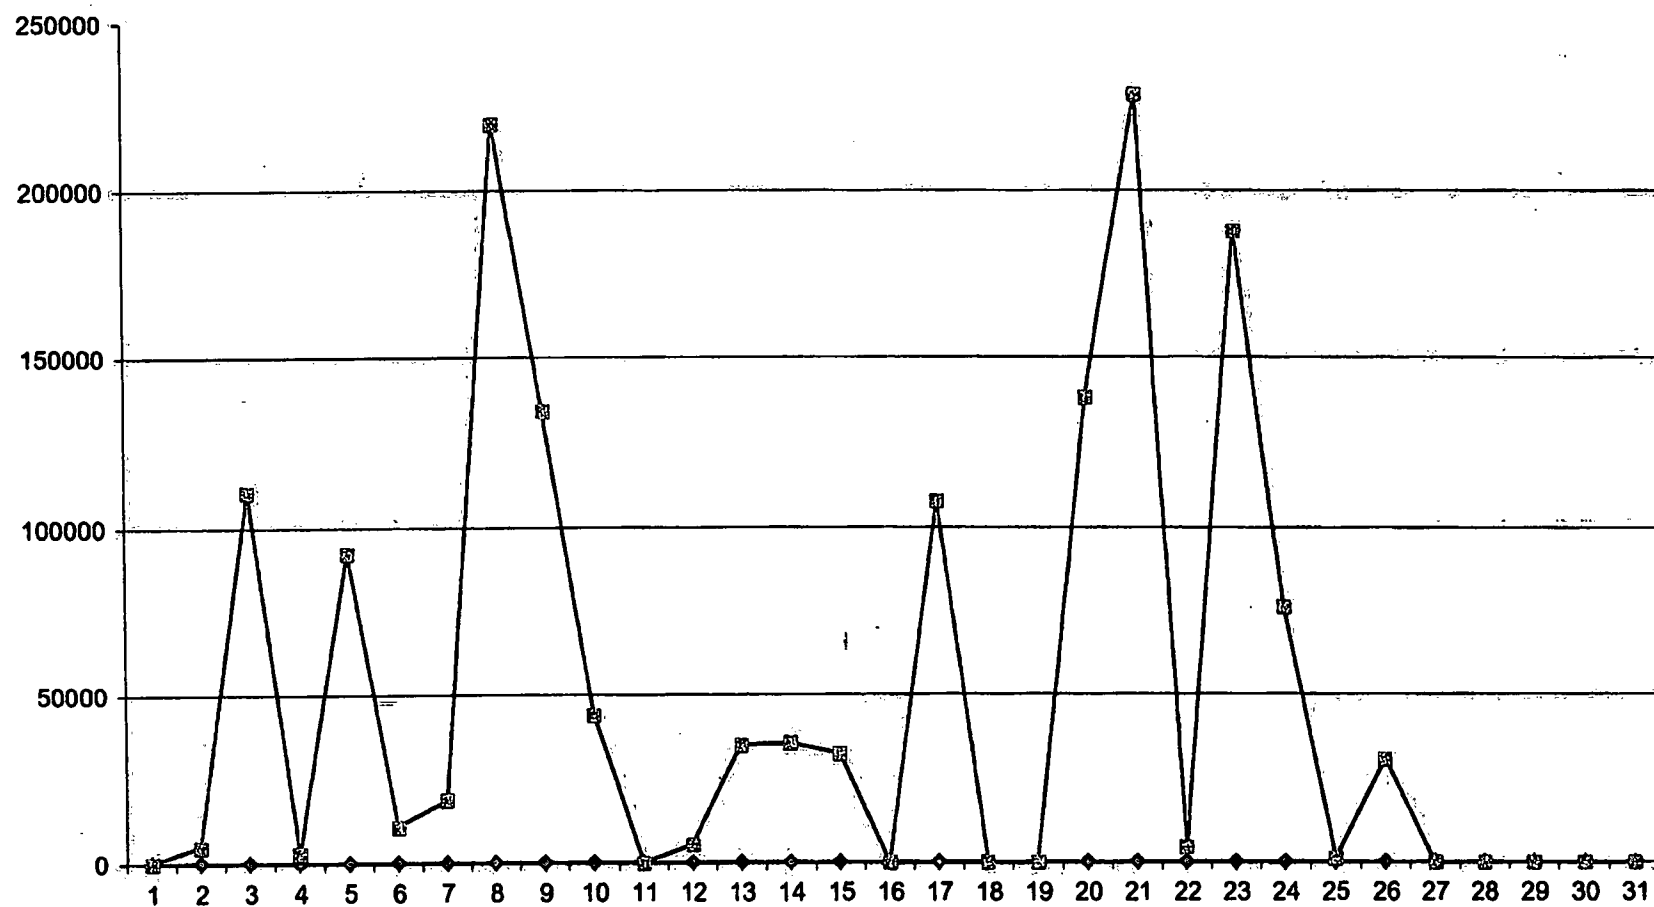

**The Following
Image(s) are
the Best Copy
Available**

BIEL'S

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent
Joseph Glab
Asst. Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

December 6, 2013

Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga


Re: Pfohl Bros. Flow Data

Dear Mr. Pugh,

Enclosed for your review, please find a copy of the November 2013 Direct Discharge Flow Data Report, prepared by Jon W. Nichy.

Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.

Yours truly,

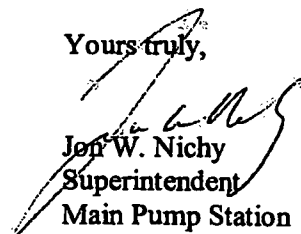

Jon W. Nichy
Superintendent
Main Pump Station

Direct Discharge Flow Data

10/31/2013

		3544392	0	3,544,395	
Nov-13	Time; 11:58pm unless otherwise stated	Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	Notes
1		3544392	0	3,544,395	
2		3681180	136,788	3,681,183	0724 enable
3		3882521	201,341	3,882,524	
4		4072506	189,985	4,072,509	
5		4184974	112,468	4,184,977	
6		4253072	68,098	4,253,075	2135 inhibit
7		4253072	0	4,253,075	
8		4253072	0	4,253,075	
9		4253072	0	4,253,075	
10		4253072	0	4,253,075	
11		4253072	0	4,253,075	
12		4253072	0	4,253,075	
13		4386958	133,886	4,386,961	0804 enable
14		4605186	218,228	4,605,189	
15		4793020	187,834	4,793,023	
16		4826668	32,648	4,825,671	
17		4825668	0	4,825,671	1425 inhibit
18		4862784	37,116	4,862,787	1054 enable
19		4991282	128,499	4,991,286	
20		5026235	34,953	5,026,239	
21		5043507	17,272	5,043,511	
22		5060964	17,457	5,060,968	
23		5142806	81,842	5,142,810	
24		4269603	126,797	5,269,607	
25		4271356	1,753	5,271,360	
26		5305835	34,480	5,305,840	
27		5305835	0	5,305,840	
28		5310576	4,741	5,310,581	
29		5391484	80,909	5,391,490	
30		5472104	80,620	5,472,110	
31					
		1,927,712	1,927,715	1,927,715	

November
2013

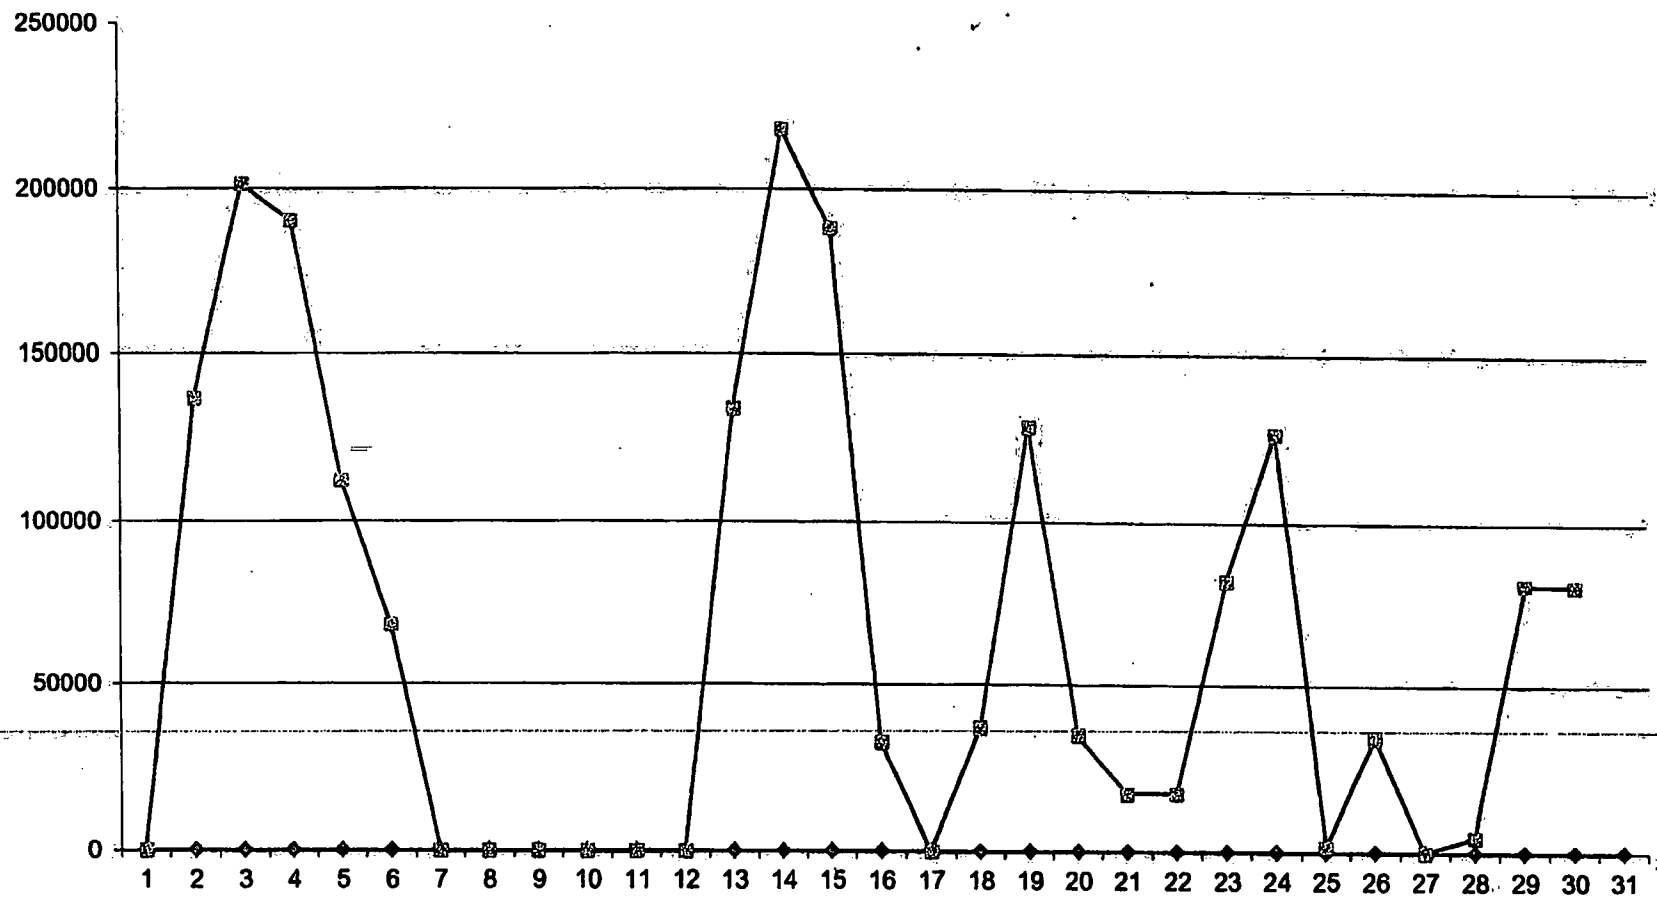

The
TOWN OF
CHEEKTOWAGA



Jon W. Nichy
Superintendent
Joseph Glab
Asst. Superintendent

Main Pump Station
171 Central Blvd.
Cheektowaga, NY 14225
Phone: 716-896-1777
Fax: 716-896-6437

January 15, 2014

Mr. William R. Pugh, P.E.
Town Engineer
Town of Cheektowaga


Re: Pfohl Bros. Flow Data

Dear Mr. Pugh,

Enclosed for your review, please find a copy of the December 2013 Direct Discharge Flow Data Report, prepared by Jon W. Nichy.

Should you have any other questions or comments regarding this submittal, please contact this office @ 896-1777.

Yours truly,

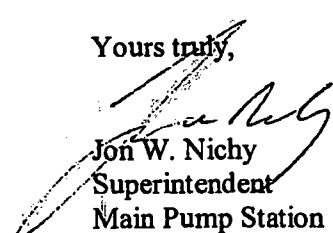

Jon W. Nichy
Superintendent
Main Pump Station

Direct Discharge Flow Data

11/30/2013

		5472104	80,620	5,472,110	
Dec-13	Time; 11:58pm unless otherwise stated	Totalizer Reading (Gallons)	Daily Total Discharge (Gallons)	Total Direct Discharge (Gallons)	Notes
1		5505986	33,883	5,505,993	
2		5515736	9,750	5,515,743	
3		5540000	24,264	5,540,007	
4		5650942	110,942	5,650,949	
5		5799873	148,931	5,799,880	
6		5913448	113,575	5,913,455	
7		5980014	66,567	5,980,022	
8		5993089	13,075	5,993,097	
9		5998775	5,687	5,998,784	
10		6016842	18,067	6,016,851	
11		6020776	3,934	6,020,785	
12		6080881	60,106	6,080,891	
13		6150515	69,634	6,150,525	
14		6160822	10,307	6,160,832	
15		6161852	1,030	6,161,862	
16		6187713	25,861	6,187,723	
17		6201428	13,716	6,201,439	
18		6249716	48,288	6,249,727	
19		6308530	58,814	6,308,541	
20		6330058	21,528	6,330,069	1219 inhibit
21		6330058	0	6,330,069	
22		6330058	0	6,330,069	
23		6425432	95,374	6,425,443	1108 enable
24		6624120	198,689	6,624,132	
25		6808354	184,234	6,808,366	
26		6880219	71,866	6,880,232	
27		6880219	0	6,880,232	
28		6947708	67,489	6,947,721	
29		7051362	103,654	7,051,375	
30		7163054	111,692	7,163,067	
31		7198832	35,778	7,198,845	
		1,726,728	1,726,735	1,726,735	

December
2013

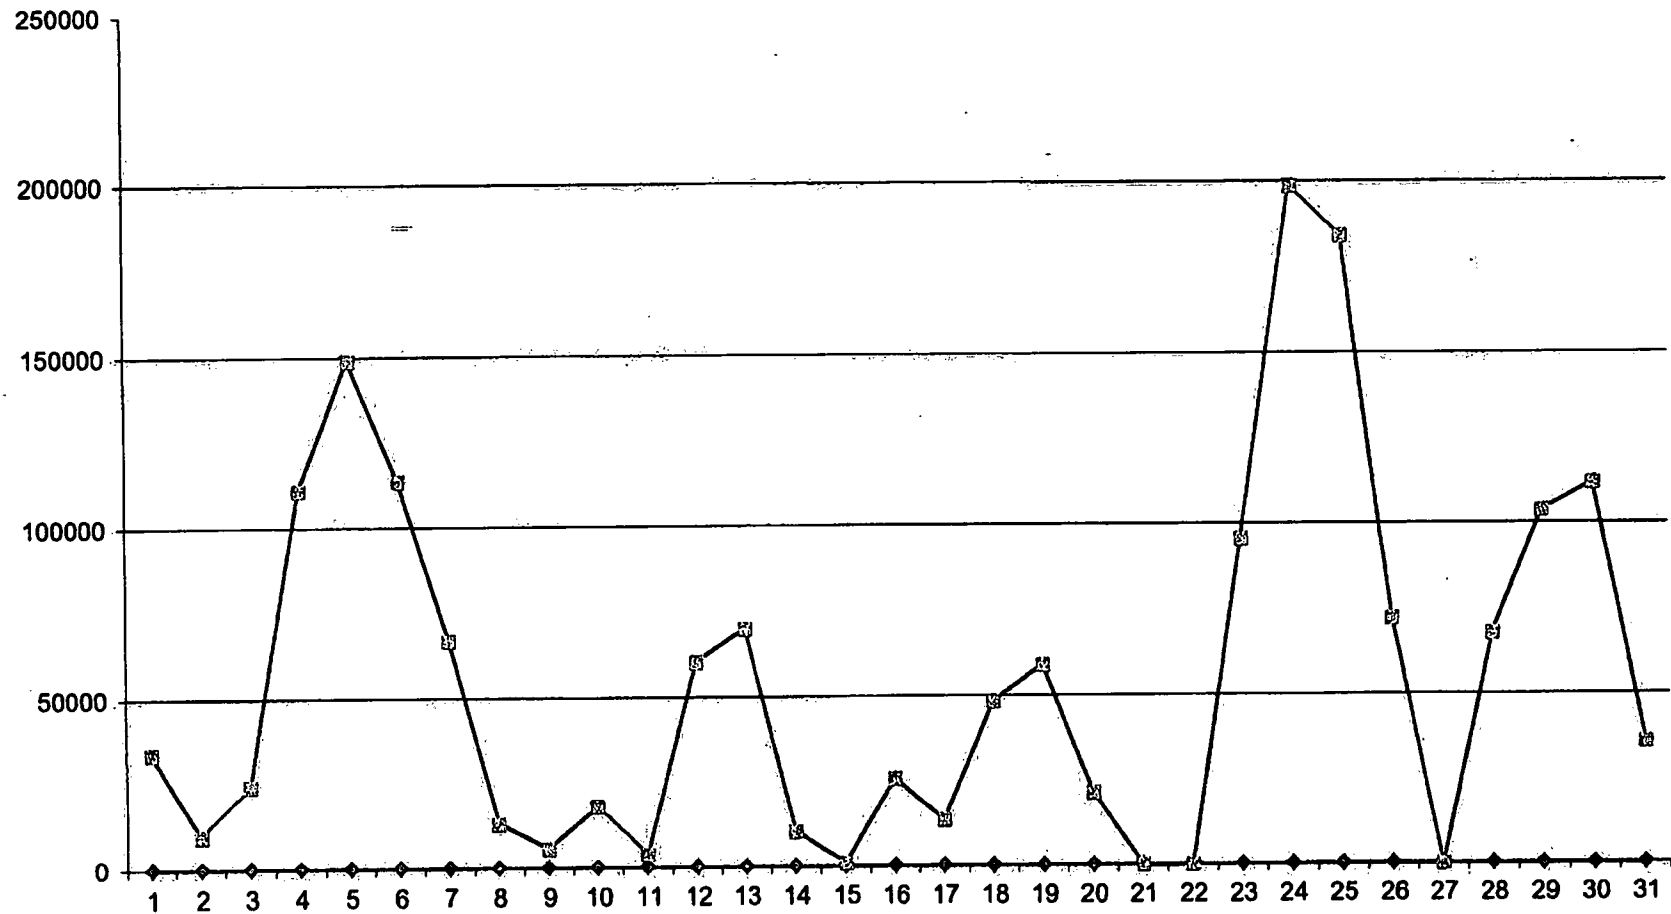

APPENDIX C

HYDRAULIC MONITORING TABLES

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JULY - DECEMBER 2013

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser) Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
GW-01D MNW	1073088.634	1117968.213	694.41	NM	696.12	D	1	9/10/2013 1518	4.00	692.12	0.00	692.12	
								11/13/2013 0935	2.07	694.05	0.00	694.05	
								12/10/2013 1222	2.64	693.48	0.00	693.48	
GW-01S MNW	1073087.779	1117961.500	694.53	NM	696.19	S	1	9/10/2013 1518	4.70	691.49	0.00	691.49	
								11/13/2013 0935	3.24	692.95	0.00	692.95	
								12/10/2013 1223	3.84	692.35	0.00	692.35	
GW-03D MNW	1073819.106	1114602.426	692.35	NM	693.88	D	1	9/10/2013 1421	2.38	691.50	0.00	691.50	
								11/13/2013 0848	1.71	692.17	0.00	692.17	
								12/10/2013 1127	1.85	692.03	0.00	692.03	
GW-03S MNW	1073812.622	1114605.762	692.61	NM	693.80	S	1	9/10/2013 1421	7.45	686.35	0.00	686.35	
								11/13/2013 0848	2.68	691.12	0.00	691.12	
								12/10/2013 1126	2.75	691.05	0.00	691.05	
GW-04D MNW	1072289.432	1114685.625	690.89	NM	692.75	D	1	9/10/2013 1528	13.39	679.36	0.00	679.36	
								11/13/2013 0945	13.10	679.65	0.00	679.65	
								12/10/2013 1150	12.70	680.05	0.00	680.05	
GW-04S MNW	1072284.456	1114685.127	690.76	NM	692.72	S	1	9/10/2013 1528	5.85	686.87	0.00	686.87	
								11/13/2013 0944	4.16	688.56	0.00	688.56	
								12/10/2013 1149	4.27	688.45	0.00	688.45	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH
MNW
SG

Manhole Monitoring Point
Monitoring Well
Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JULY - DECEMBER 2013

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
GW-07D	1071242.458	1117669.925	697.15	NM	699.94	D	1						
MNW								9/10/2013 1514	49.48	650.46	0.00	650.46	
MNW								11/13/2013 0930	45.45	654.49	0.00	654.49	
MNW								12/10/2013 1218	57.82	642.12	0.00	642.12	
GW-07S	1071238.157	1117666.265	697.47	NM	699.51	S	1						
MNW								9/10/2013 1514	6.89	692.62	0.00	692.62	
MNW								11/13/2013 0931	4.13	695.38	0.00	695.38	
MNW								12/10/2013 1217	4.65	694.86	0.00	694.86	
GW-08D	1073713.617	1116795.328	695.28	NM	697.79	D	1						
MNW								9/10/2013 1439	6.43	691.36	0.00	691.36	
MNW								11/13/2013 0900	5.65	692.14	0.00	692.14	
MNW								12/10/2013 1135	5.81	691.98	0.00	691.98	
GW-08SR	1073714.172	1116786.343	695.08	NM	697.50	S	1						
MNW								9/10/2013 1439	5.73	691.77	0.00	691.77	
MNW								11/13/2013 0859	5.17	692.33	0.00	692.33	
MNW								12/10/2013 1136	5.22	692.28	0.00	692.28	
GW-26D	1071698.573	1115997.470	696.01	NM	698.50	D	1						
MNW								9/10/2013 1503	7.25	691.25	0.00	691.25	
MNW								11/13/2013 0923	6.52	691.98	0.00	691.98	
MNW								12/10/2013 1201	6.67	691.83	0.00	691.83	
GW-28S	1073129.479	1117648.927	698.60	NM	700.95	S	1						
MNW								9/10/2013 1443	10.63	690.32	0.00	690.32	
MNW								11/13/2013 0904	8.30	692.65	0.00	692.65	
MNW								12/10/2013 1139	8.72	692.23	0.00	692.23	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH

MNW

SG

Manhole Monitoring Point

Monitoring Well

Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JULY - DECEMBER 2013

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
GW-29S	1072552.638	1117761.993	697.50	NM	699.63	S	1						
MNW								9/10/2013 1451	9.91	689.72	0.00	689.72	
MNW								11/13/2013 0913	6.08	693.55	0.00	693.55	
MNW								12/10/2013 1211	7.43	692.20	0.00	692.20	
GW-30S	1072096.109	1117743.563	693.67	NM	696.58	S	1						
MNW								9/10/2013 1453	8.35	688.23	0.00	688.23	
MNW								11/13/2013 0915	7.30	689.28	0.00	689.28	
MNW								12/10/2013 1208	7.92	688.66	0.00	688.66	
GW-31S	1071786.280	1117191.441	695.84	NM	698.62	S	1						
MNW								9/10/2013 1456	6.52	692.10	0.00	692.10	
MNW								11/13/2013 0917	2.42	696.20	0.00	696.20	
MNW								12/10/2013 1206	2.65	695.97	0.00	695.97	
GW-32S	1071613.793	1116364.200	696.19	NM	698.37	S	1						
MNW								9/10/2013 1501	6.08	692.29	0.00	692.29	
MNW								11/13/2013 0919	2.30	696.07	0.00	696.07	
MNW								12/10/2013 1203	2.61	695.76	0.00	695.76	
GW-33S	1072165.625	1115561.866	695.94	NM	698.24	S	1						
MNW								9/10/2013 1509	7.43	690.81	0.00	690.81	
MNW								11/13/2013 0925	3.45	694.79	0.00	694.79	
MNW								12/10/2013 1159	3.83	694.41	0.00	694.41	
GW-34S	1072979.205	1114730.200	692.51	NM	694.77	S	1						
MNW								9/10/2013 1414	5.95	688.82	0.00	688.82	
MNW								11/13/2013 0838	2.61	692.16	0.00	692.16	
MNW								12/10/2013 1115	2.61	692.16	0.00	692.16	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH
 MNW
 SG

Manhole Monitoring Point
 Monitoring Well
 Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JULY - DECEMBER 2013

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
GW-35S MNW	1071701.925	1115985.585	696.19	NM	697.39	S	1	9/10/2013 1503	6.20	691.19	0.00	691.19	
								11/13/2013 0922	2.88	694.51	0.00	694.51	
								12/10/2013 1202	3.15	694.24	0.00	694.24	
MH-01 MH	1073806.665	1114810.501	698.62	NM	698.62	NA	1	9/10/2013 1415	9.66	688.96	0.00	688.96	
								11/13/2013 0845	9.03	689.59	0.00	689.59	
								12/10/2013 1122	10.12	688.50	0.00	688.50	
MH-03 MH	1073736.789	1115259.334	699.40	NM	699.40	NA	1	9/10/2013 1424	10.51	688.89	0.00	688.89	
								11/13/2013 0852	9.90	689.50	0.00	689.50	
								12/10/2013 1130	11.02	688.38	0.00	688.38	
MH-07 MH	1073838.229	1116243.757	696.82	NM	696.82	NA	1	9/10/2013 1433	8.73	688.09	0.00	688.09	
								11/13/2013 0855	8.13	688.69	0.00	688.69	
								12/10/2013 1132	9.23	687.59	0.00	687.59	
MH-10 MH	1073540.729	1117381.524	703.01	NM	703.01	NA	1	9/10/2013 1440	14.50	688.51	0.00	688.51	
								11/13/2013 0902	14.47	688.54	0.00	688.54	
								12/10/2013 1137	14.46	688.55	0.00	688.55	
MH-15 MH	1072531.567	1117761.125	699.02	NM	699.02	NA	1	9/10/2013 1451	15.10	683.92	0.00	683.92	
								11/13/2013 0913	11.42	687.60	0.00	687.60	
								12/10/2013 1210	14.92	684.10	0.00	684.10	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH
MNW
SG

Manhole Monitoring Point
Monitoring Well
Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JULY - DECEMBER 2013

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
MH-16	1072133.714	1117748.238	698.57	NM	698.57	NA	1						
MH								9/10/2013 1453	15.48	683.09	0.00	683.09	
MH								11/13/2013 0915	11.15	687.42	0.00	687.42	
MH								12/10/2013 1207	14.50	684.07	0.00	684.07	
MH-17	1071813.137	1117180.019	702.16	NM	702.16	NA	1						
MH								9/10/2013 1456	18.33	683.83	0.00	683.83	
MH								11/13/2013 0917	14.69	687.47	0.00	687.47	
MH								12/10/2013 1205	18.16	684.00	0.00	684.00	
MH-20	1071756.395	1115997.024	706.20	NM	706.20	NA	1						
MH								9/10/2013 1503	19.72	686.48	0.00	686.48	
MH								11/13/2013 0922	18.61	687.59	0.00	687.59	
MH								12/10/2013 1200	19.76	686.44	0.00	686.44	
MH-22	1072158.023	1115589.309	698.05	NM	698.05	NA	1						
MH								9/10/2013 1509	9.04	689.01	0.00	689.01	
MH								11/13/2013 0925	8.45	689.60	0.00	689.60	
MH								12/10/2013 1158	8.97	689.08	0.00	689.08	
MH-25	1072483.928	1114820.313	698.17	NM	698.17	NA	1						
MH								9/10/2013 1408	9.23	688.94	0.00	688.94	
MH								11/13/2013 0834	8.57	689.60	0.00	689.60	
MH								12/10/2013 1112	9.73	688.44	0.00	688.44	
SG-01	1073882.887	1114813.101	NM	NM	690.00	NA	1						
SG								9/10/2013 1420	NM	-	NM	-	DRY
SG								11/13/2013 0845	-0.82	690.82	0.00	690.82	
SG								12/10/2013 1122	-0.80	690.80	0.00	690.80	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH
MNW
SG

Manhole Monitoring Point
Monitoring Well
Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JULY - DECEMBER 2013

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser) Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
SG-02	1073738.27	1116805.85	NM	NM	690.00	NA	1						
SG								9/10/2013 1439	NM	-	NM	-	DRY
SG								11/13/2013 0858	-3.20	693.20	0.00	693.20	
SG								12/10/2013 1134	-3.14	693.14	0.00	693.14	
WW-01	1073676.903	1115710.476	NM	NM	684.02	NA	1						
MH								9/10/2013 1335	-4.7	688.72	0.00	688.72	
MH								11/13/2013 0800	-5.3	689.32	0.00	689.32	
MH								12/10/2013 1035	-4.2	688.22	0.00	688.22	
WW-02	1073684.724	1116792.311	NM	NM	684.18	NA	1						
MH								9/10/2013 1335	-4.7	688.88	0.00	688.88	
MH								11/13/2013 0800	-4.7	688.88	0.00	688.88	
MH								12/10/2013 1035	-4.7	688.88	0.00	688.88	
WW-03	1073140.339	1117618.499	NM	NM	683.80	NA	1						
MH								9/10/2013 1335	-6.3	690.10	0.00	690.10	
MH								11/13/2013 0800	-6.5	690.30	0.00	690.30	
MH								12/10/2013 1035	-5.1	688.90	0.00	688.90	
WW-04	1072057.563	1117610.508	NM	NM	676.62	NA	1						
MH								9/10/2013 1335	-5.5	682.12	0.00	682.12	
MH								11/13/2013 0800	-10.5	687.12	0.00	687.12	
MH								12/10/2013 1035	-6.9	683.52	0.00	683.52	
WW-05	1071661.368	1116370.876	NM	NM	676.14	NA	1						
MH								9/10/2013 1335	-6.1	682.24	0.00	682.24	
MH								11/13/2013 0800	-11.3	687.44	0.00	687.44	
MH								12/10/2013 1035	-6.9	683.04	0.00	683.04	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH
MNH
SG

Manhole Monitoring Point
Monitoring Well
Staff Gauge

TABLE 1
PFOHL BROTHERS LANDFILL SITE
GROUNDWATER ELEVATIONS
JULY - DECEMBER 2013

Location ID / Type	Northing	Easting	Ground Elevation (ft)	Casing Elevation (ft)	Meas.point (Riser)Elev.(ft)	Geol. Zone	Specific Gravity	Date / Time	Depth to Water (ft)	Water Elev. (ft)	Product Thick. (ft)	Corrected Water Elev. (ft)	Remark
WW-06	1072988.420	1114811.518	NM	NM	681.89	NA	1						
MH								9/10/2013 1427	-7.0	688.89	0.00	688.89	
MH								11/13/2013 0800	-8.3	690.19	0.00	690.19	
MH								12/10/2013 1119	-6.42	688.31	0.00	688.31	

NM - No Measurement

The value noted in the column labeled Specific Gravity is an assumed value for free product, if found.

Type:

MH
MNW
SG

Manhole Monitoring Point
Monitoring Well
Staff Gauge

TABLE 2
PFOHL BROTHERS LANDFILL SITE
OVERBURDEN HYDRAULIC GRADIENT

WELL PAIR:	WW-1	*	Level	WW-2	GW-8SR	Level	SG-02	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft)
9/10/2013	688.72	---	---	688.88	691.77	2.89	DRY	NA
11/13/2013	689.32	---	---	688.88	692.33	3.45	693.20	4.32
12/10/2013	688.22	---	---	688.88	692.28	3.40	693.14	4.26

WELL PAIR:	WW-3	GW-28S	Level	WW-4	*	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)
9/10/2013	690.10	690.32	0.22	682.12	---	---
11/13/2013	690.30	692.65	2.35	687.12	---	---
12/10/2013	688.90	692.23	3.33	683.52	---	---

WELL PAIR:	WW-5	GW-32S	Level	WW-6	GW-34S	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)
9/10/2013	682.24	692.29	10.05	688.89	688.82	-0.07
11/13/2013	687.44	696.07	8.63	690.19	692.16	1.97
12/10/2013	683.04	695.76	12.72	688.31	692.16	3.85

WELL PAIR:	MH-1	SG-1	Level	MH-15	GW-29S	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)
9/10/2013	688.96	DRY	NA	683.92	689.72	5.80
11/13/2013	689.59	690.82	1.23	687.60	693.55	5.95
12/10/2013	688.50	690.80	2.30	684.10	692.20	8.10

WELL PAIR:	MH-16	GW-30S	Level	MH-17	GW-31S	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)
9/10/2013	683.09	688.23	5.14	683.83	692.10	8.27
11/13/2013	687.42	689.28	1.86	687.47	696.20	8.73
12/10/2013	684.07	688.66	4.59	684.00	695.97	11.97

WELL PAIR:	MH-20	GW-35S	Level	MH-22	GW-33S	Level
	Water Level	Water Level	Difference	Water Level	Water Level	Difference
DATE	(ft amsl)	(ft amsl)	(ft)	(ft amsl)	(ft amsl)	(ft)
9/10/2013	686.48	691.19	4.71	689.01	690.81	1.80
11/13/2013	687.59	694.51	6.92	689.60	694.79	5.19
12/10/2013	686.44	694.24	7.80	689.08	694.41	5.33

Notes:

* = No corresponding monitoring well.
 NA = Not applicable

APPENDIX D

**GROUNDWATER PURGE AND SAMPLE COLLECTION
LOGS**

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-1S

Date: 11/15/2013 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/
Sampling
Device: Geopump 2 Tubing Type: LDPE/Silicone Pump/Tubing
Inlet Location: Screen midpoint

Measuring Point:	Below Top of Riser	Initial Depth to Water:	3.44'	Depth to Well Bottom:	14.94'	Well Diameter:	2"	Screen Length:	
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------	--

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	<u>7.1</u>	Estimated Purge Volume (liters):	<u>11.3</u>
--------------	-----------------	-----------------------------------	------------	----------------------------------	-------------

Sample ID: GW-01S Sample Time: 13:10 QA/QC: None

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information: Riser pipe is bulged inwards, could not remove stainless steel bailer from within well, sampled around it.
Orange stain in water initially.

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vq_d = \pi^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-1D

Date: 11/15/2013 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.43'	Depth to Well Bottom:	39.65'	Well Diameter:	4"	Screen Length:	
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------	--

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	91.9	Estimated Purge Volume (liters):	66.0
--------------	-----------------	-----------------------------------	------	----------------------------------	------

Sample ID: GW-01D Sample Time: 14:31 QA/QC: None

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information: Sulfur odor

PURGE PARAMETERS

TIME	pH	TEMP (°C)	COND. (mS/cm)	DISS. O ₂ (mg/l)	TURB. (NTU)	ORP (mV)	FLOW RATE (ml/min.)	DEPTH TO WATER (btor)
13:25	7.30	12.14	1.04	0.00	12.1	-18	1000	2.43
13:30	7.29	12.20	1.04	0.00	10.0	-92	1000	2.50
13:35	7.27	12.22	1.03	0.00	2.6	-137	1000	2.50
13:40	7.37	12.22	1.03	0.00	2.3	-151	1000	2.50
13:45	7.31	12.21	1.03	0.00	1.3	-161	1000	2.50
13:50	7.30	12.19	1.03	0.00	3.3	-174	1000	2.50
13:55	7.32	12.17	1.03	0.00	3.0	-186	1000	2.50
14:00	7.30	12.17	1.03	0.00	3.1	-199	1000	2.50
14:05	7.30	12.16	1.03	0.00	2.4	-214	1000	2.50
14:10	7.30	12.16	1.03	0.00	3.6	-228	1000	2.50
14:15	7.30	12.16	1.03	0.00	1.5	-239	1000	2.50
14:20	7.30	12.17	1.03	0.00	2.7	-245	1000	2.50
14:25	7.30	12.19	1.03	0.00	3.1	-253	1000	2.50
14:28	7.29	12.20	1.03	0.00	2.4	-254	1000	2.50
14:31	7.29	12.19	1.03	0.00	2.0	-256	1000	2.50
Tolerance:	0.1	---	3%	10%	10%	+ or - 10	---	

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vq_d = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-3S

Date: 11/13/2013 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/
Sampling
Device: Geopump 2 Tubing Type: LDPE/Silicone Pump/Tubing
Inlet
Location: Screen midpoint

Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.68'	Depth to Well Bottom:	13.22'	Well Diameter:	2"	Screen Length:	
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------	--

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	<u>6.5</u>	Estimated Purge Volume (liters):	<u>6.6</u>
--------------	-----------------	-----------------------------------	------------	----------------------------------	------------

Sample ID: GW-03S Sample Time: 10:57 QA/QC: None

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

Turbidity was visibly <50 NTUs.

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vq_d = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-3D
Date: 11/13/2013 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2		Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint			
Measuring Point:	Below Top of Riser	Initial Depth to Water:	1.71'	Depth to Well Bottom:	35.70'	Well Diameter:	4"	Screen Length:	
Casing Type:	Stainless Steel		Volume in 1 Well Casing (liters):	84.0	Estimated Purge Volume (liters):	55.2			

Sample ID:	GW-03D	Sample Time:	12:18	QA/QC:	MS/MSD
------------	--------	--------------	-------	--------	--------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES—0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vq_d = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-4S

Date: 11/14/2013 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/
Sampling
Device: Geopump 2 Tubing Type: LDPE/Silicone Pump/Tubing
Inlet
Location: Screen midpoint

Measuring Point:	Below Top of Riser	Initial Depth to Water:	4.03'	Depth to Well Bottom:	16.23'	Well Diameter:	2"	Screen Length:	
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------	--

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	<u>7.5</u>	Estimated Purge Volume (liters):	<u>15.1</u>
--------------	-----------------	-----------------------------------	------------	----------------------------------	-------------

Sample ID:	GW-04S	Sample Time:	10:45 VOCs/ 12:15 SVOCs & Metals	QA/QC:	None
------------	--------	--------------	-------------------------------------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information: Placed passive diffusion bag (PDB) in well 10/12/13, sampled VOCs from PDB at 10:45 on 11/14/13.

Well historically goes dry at very low purge rates (<75ml/min). Bailed dry and sampled for SVOCs and Metals after recovery at 12:15.

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vol_d = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-4D

Date: 11/14/2013 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/
Sampling
Device: Geopump 2 Tubing Type: LDPE/Silicone Pump/Tubing
Inlet
Location: Screen midpoint

Measuring Point:	Below Top of Riser	Initial Depth to Water:	12.77'	Depth to Well Bottom:	45.57'	Well Diameter:	4"	Screen Length:	
------------------	--------------------	-------------------------	--------	-----------------------	--------	----------------	----	----------------	--

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	<u>81.0</u>	Estimated Purge Volume (liters):	<u>9.3</u>
--------------	-----------------	-----------------------------------	-------------	----------------------------------	------------

Sample ID: GW-04D Sample Time: 12:10 QA/QC: None

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

TIME	pH	TEMP (°C)	COND. (mS/cm)	DISS. O ₂ (mg/l)	TURB. (NTU)	ORP (mV)	FLOW RATE (ml/min.)	DEPTH TO WATER (btor)
11:10	7.69	11.01	1.68	0.27	57.7	-120	155	12.77
11:15	7.39	11.08	1.69	0.00	28.3	-192	155	13.06
11:20	7.37	11.05	1.70	0.00	27.6	-212	155	13.17
11:25	7.35	11.03	1.70	0.00	26.4	-234	155	13.32
11:30	7.33	11.01	1.71	0.00	30.8	-252	155	13.45
11:35	7.32	11.00	1.71	0.00	31.4	-268	155	13.61
11:40	7.10	11.08	1.72	0.00	34.7	-272	155	13.70
11:45	7.30	11.04	1.71	0.00	32.3	-279	155	13.78
11:50	7.29	11.00	1.71	0.00	29.4	-283	155	13.88
11:55	7.28	10.99	1.72	0.00	28.2	-289	155	13.95
12:00	7.28	10.97	1.73	0.00	27.1	-295	155	14.00
12:05	7.28	10.99	1.72	0.00	28.8	-299	155	14.03
12:10	7.27	11.01	1.72	0.00	29.1	-305	155	14.06
Tolerance:	0.1	---	3%	10%	10%	+ or - 10	--	

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vq_d = \pi r^2 h$)

WELL PURGING LOG

URS Corporation

SITE NAME:	Pfohl Brothers Landfill	WELL NO.:	GW-7S
PROJECT NO.:	11175616.00000		
STAFF:	Rob Murphy, Tom Urban		
DATE(S):	11/13/13, 11/14/13		

		WELL ID.	VOL. (GAL/FT)
1. TOTAL CASING AND SCREEN LENGTH (FT.)	=	35.04	1" 0.040
2. WATER LEVEL BELOW TOP OF CASING (FT.)	=	4.13	2" 0.17
3. NUMBER OF FEET STANDING WATER (#1 - #2)	=	30.91	3" 0.38
4. VOLUME OF WATER/FOOT OF CASING (GAL.)	=	0.17	4" 0.66
5. VOLUME OF WATER IN CASING (GAL.)(#3 x #4)	=	5.3	5" 1.04
6. VOLUME OF WATER TO REMOVE (GAL.)(#5 x 3)	=		6" 1.50
7. VOLUME OF WATER ACTUALLY REMOVED (GAL.)	=	8.0	8" 2.60

V=0.0408 x (CASING DIAMETER [INCHES])²

PARAMETERS	ACCUMULATED VOLUME PURGED (GALLONS)									
	Initial	2	4	6	8					
pH	8.14	8.08	8.07	8.06	8.03					
SPEC. COND. (mS/cm)	0.637	0.628	0.626	0.622	0.613					
DO (mg/l)	5.19	4.05	3.67	5.63	5.95					
TEMPERATURE (°C)	10.22	11.25	11.40	11.22	10.89					
TURBIDITY (NTU)	31.7	23.0	26.5	91.3	360					
ORP (millivolts)	-101	-84	-71	-53	-32					
TIME	16:47	16:50	16:52	16:55	17:01					

COMMENTS: 15:50 - Fill VOCs from passive diffusion bag (PDB), PDB was installed on 10/12/13
 16:47 - Begin hand bailing well.
 17:01 - Well dry after removing 8 gallons.
 11/14/2013 16:25 - Return to well, depth to water = 4.15 feet.
 16:30 - Collect sample for SVOCs and Metals.

WELL PURGING LOG

URS Corporation

SITE NAME: <u>Pfohl Brothers Landfill</u>	WELL NO.: <u>GW-7D</u>
PROJECT NO.: <u>11175616.00000</u>	
STAFF: <u>Rob Murphy, Tom Urban</u>	
DATE(S): <u>11/13/13, 11/14/13</u>	

		WELL ID.	VOL. (GAL/FT)
1. TOTAL CASING AND SCREEN LENGTH (FT.)	= <u>60.45</u>	1"	0.040
2. WATER LEVEL BELOW TOP OF CASING (FT.)	= <u>45.45</u>	2"	0.17
3. NUMBER OF FEET STANDING WATER (#1 - #2)	= <u>15.00</u>	3"	0.38
4. VOLUME OF WATER/FOOT OF CASING (GAL.)	= <u>0.66</u>	4"	0.66
5. VOLUME OF WATER IN CASING (GAL.)(#3 x #4)	= <u>9.9</u>	5"	1.04
6. VOLUME OF WATER TO REMOVE (GAL.)(#5 x 3)	= <u> </u>	6"	1.50
7. VOLUME OF WATER ACTUALLY REMOVED (GAL.)	= <u>9.9</u>	8"	2.60

$V=0.0408 \times (\text{CASING DIAMETER [INCHES]})^2$

PARAMETERS	ACCUMULATED VOLUME PURGED (GALLONS)									
	Init	2	4	6	8	9.9				
pH	7.68	7.71	7.70	7.78	7.87	8.19				
SPEC. COND. (mS/cm)	0.949	0.751	0.795	0.821	0.847	0.834				
DO (mg/l)	1.03	5.01	3.64	4.09	3.14	4.49				
TEMPERATURE (°C)	9.81	10.30	9.75	9.79	10.05	9.69				
TURBIDITY (NTU)	40.5	30.0	26.7	45.3	105	315				
ORP (millivolts)	-193	-133	-129	-129	-147	-127				
TIME	16:15	16:24	16:28	16:34	16:39	16:45				

COMMENTS: 15:45 - Fill VOCs from passive diffusion bag (PDB), PDB was installed on 10/12/13
 16:15 - Begin hand bailing well.
 16:45 - Well dry after removing 9.9 gallons
 11/14/2013 16:10 - return to well, depth to water = 59.48 feet.
 16:10 - Collect sample for SVOCs and Metals, only enough volume to fill 1 metals container and 1-1 liter Amber container.

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-8SR

Date: 11/13/2013 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	5.17'	Depth to Well Bottom:	13.02'	Well Diameter:	2"	Screen Length:	
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------	--

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	<u>4.8</u>	Estimated Purge Volume (liters):	<u>8.1</u>
--------------	-----------------	-----------------------------------	------------	----------------------------------	------------

Sample ID: GW-08SR Sample Time: 14:55 QA/QC: None

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES—0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vq_d = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-8D

Date: 11/13/2013 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/
Sampling
Device: Geopump 2 Tubing Type: LDPE/Silicone Pump/Tubing
Inlet Location: Screen midpoint

Measuring Point: Below Top of Riser Initial Depth to Water: 5.65' Depth to Well Bottom: 36.54' Well Diameter: 4" Screen Length:

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	<u>76.3</u>	Estimated Purge Volume (liters):	<u>57.0</u>
--------------	-----------------	-----------------------------------	-------------	----------------------------------	-------------

Sample ID:	GW-08D	Sample Time:	13:55	QA/QC:	Duplicate (FD-111313)
------------	--------	--------------	-------	--------	-----------------------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vol_d = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-26D

Date: 11/14/2013 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	6.61'	Depth to Well Bottom:	40.70'	Well Diameter:	4"	Screen Length:	
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------	--

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	<u>84.2</u>	Estimated Purge Volume (liters):	<u>60.0</u>
--------------	-----------------	-----------------------------------	-------------	----------------------------------	-------------

Sample ID: GW-26D Sample Time: 14:35 QA/QC: None

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

Occasional pulses of iron stained particulates in purge water.

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vq_w = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-28S

Date: 11/14/2013 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/
Sampling
Device: Geopump 2 Tubing Type: LDPE/Silicone Pump/Tubing
Inlet Location: Screen midpoint

Measuring Point:	Below Top of Riser	Initial Depth to Water:	8.27'	Depth to Well Bottom:	15.52'	Well Diameter:	2"	Screen Length:	
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------	--

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	4.5	Estimated Purge Volume (liters):	5.1
--------------	-----------------	-----------------------------------	-----	----------------------------------	-----

Sample ID: GW-28S Sample Time: 10:13 QA/QC: None

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

Information: WATER VOLUMES—0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vol_w = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-29S
Date: 11/14/2013 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2		Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint			
Measuring Point:	Below Top of Riser	Initial Depth to Water:	6.45'	Depth to Well Bottom:	20.04'	Well Diameter:	2"	Screen Length:	
Casing Type:	Stainless Steel		Volume in 1 Well Casing (liters):	8.4	Estimated Purge Volume (liters):	8.4			

Sample ID: GW-29S Sample Time: 15:40 QA/QC: None

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

Orange iron particulates at start of purge

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($v_{ql} = \pi r^2 h$)

1

Date: 11/15/2013 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Measuring Point:	Below Top of Riser	Initial Depth to Water:	7.89'	Depth to Well Bottom:	17.97'	Well Diameter:	2" -	Screen Length:	
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	------	----------------	--

Sample ID: GW-30S Sample Time: 8:38 QA/QC: None

Other Information:

PURGE PARAMETERS

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vol_w = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-31S

Date: 11/15/2013 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.55'	Depth to Well Bottom:	9.57'	Well Diameter:	2"	Screen Length:	
------------------	--------------------	-------------------------	-------	-----------------------	-------	----------------	----	----------------	--

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	<u>4.3</u>	Estimated Purge Volume (liters):	<u>5.3</u>
--------------	-----------------	-----------------------------------	------------	----------------------------------	------------

Sample ID:	GW-31S	Sample Time:	9:33	QA/QC:	None
------------	--------	--------------	------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($v_{q1} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-32S
Date: 11/15/2013 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2		Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint			
Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.50'	Depth to Well Bottom:	9.93'	Well Diameter:	2"	Screen Length:	
Casing Type:	Stainless Steel		Volume in 1 Well Casing (liters):	4.6	Estimated Purge Volume (liters):	9.0			

Sample ID: GW-32S Sample Time: 10:35 QA/QC: None

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

[illegible]

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vol = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-33S

Date: 11/15/2013 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/ Sampling Device:	Geopump 2	Tubing Type:	LDPE/Silicone	Pump/Tubing Inlet Location:	Screen midpoint
---------------------------------	-----------	--------------	---------------	-----------------------------------	-----------------

Measuring Point:	Below Top of Riser	Initial Depth to Water:	4.01'	Depth to Well Bottom:	8.21'	Well Diameter:	2"	Screen Length:
------------------	--------------------	-------------------------	-------	-----------------------	-------	----------------	----	----------------

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	2.6	Estimated Purge Volume (liters):	5.1
--------------	-----------------	-----------------------------------	-----	----------------------------------	-----

Sample ID: GW-33S Sample Time: 11:35 QA/QC: None

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($v_{Q_1} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-34S

Date: 11/14/2013 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/
Sampling
Device: Geopump 2 Tubing Type: LDPE/Silicone Pump/Tubing
Inlet
Location: Screen midpoint

Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.60'	Depth to Well Bottom:	10.01'	Well Diameter:	2"	Screen Length:	
------------------	--------------------	-------------------------	-------	-----------------------	--------	----------------	----	----------------	--

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	<u>4.6</u>	Estimated Purge Volume (liters):	<u>8.9</u>
--------------	-----------------	-----------------------------------	------------	----------------------------------	------------

Sample ID: GW-34S Sample Time: 9:14 QA/QC: None

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($V_{\text{well}} = \pi r^2 h$)

LOW FLOW GROUNDWATER PURGING/SAMPLING LOG

Project: 11175616.00000 Site: Pfohl Brothers Well I.D.: GW-35S

Date: 11/14/2013 Sampling Personnel: Rob Murphy, Tom Urban Company: URS Corporation

Purging/
Sampling
Device: Geopump 2 Tubing Type: LDPE/Silicone Pump/Tubing Inlet Location: Screen midpoint

Measuring Point:	Below Top of Riser	Initial Depth to Water:	2.86'	Depth to Well Bottom:	7.46'	Well Diameter:	2"	Screen Length:	
------------------	--------------------	-------------------------	-------	-----------------------	-------	----------------	----	----------------	--

Casing Type:	Stainless Steel	Volume in 1 Well Casing (liters):	<u>2.8</u>	Estimated Purge Volume (liters):	<u>7.4</u>
--------------	-----------------	-----------------------------------	------------	----------------------------------	------------

Sample ID:	GW-35S	Sample Time:	13:22	QA/QC:	None
------------	--------	--------------	-------	--------	------

Sample Parameters: VOCs, SVOCs, and TAL Metals

Other Information:

PURGE PARAMETERS

Information: WATER VOLUMES--0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vol_w = \pi r^2 h$)

Information: WATER VOLUMES—0.75 inch diameter well = 87 ml/ft; 1 inch diameter well = 154 ml/ft; 2 inch diameter well = 617 ml/ft;
4 inch diameter well = 2470 ml/ft ($vol_c = \pi r^2 h$)

GROUNDWATER SAMPLING - SAMPLE COLLECTION DATA SHEET

Project Name: Pfohl Brothers Landfill

Project Number: 11175616.00000

Sampling Crew Members: R. Murphy, T. Urban

Supervisor: J. Sundquist

Date of Sampling: November 13, 2013

Sample I.D. Number	Well Number	Well Volume (liters)	Volume Purged (liters)	Sample Time	Sample Description	Analysis Required	Chain-of-Custody Number
GW-03S	GW-3S	6.5	6.6	10:57	Groundwater	VOCs/SVOCs/ Metals	Not Applicable
GW-03D	GW-3D	84.0	55.2	12:18	Groundwater		Not Applicable
GW-03D-MS	GW-3D	84.0	55.2	12:18	Matrix Spike		Not Applicable
GW-03D-MSD	GW-3D	84.0	55.2	12:18	Matrix Spike Duplicate		Not Applicable
GW-08D	GW-8D	76.3	57.0	13:55	Groundwater		Not Applicable
FD-111313	GW-8D	76.3	57.0	13:55	Duplicate		Not Applicable
GW-08SR	GW-8SR	4.8	8.1	14:55	Groundwater		Not Applicable

Additional Comments: All wells were purged using low flow methods until parameter stabilization.

GROUNDWATER SAMPLING - SAMPLE COLLECTION DATA SHEET

Project Name: Pfohl Brothers Landfill

Project Number: 11175616.00000

Sampling Crew Members: R. Murphy, T. Urban

Supervisor: J. Sundquist

Date of Sampling: November 13, 2013

Sample I.D. Number	Well Number	Well Volume (liters)	Volume Purged (liters)	Sample Time	Sample Description	Analysis Required	Chain-of-Custody Number
GW-07D	GW-7D	37.5	PDB	15:45	Groundwater	VOCs	Not Applicable
GW-07S	GW-7S	20.1	PDB	15:50	Groundwater		Not Applicable
TB-111313	---	---	---	---	Trip Blank	VOCs	Not Applicable

Additional Comments:

GW-7D and GW-7S were sampled for VOCs using passive diffusion bags (PDBs).

GW-7D and GW-7S were then purged dry, remaining parameters collected November 14, 2013.

GROUNDWATER SAMPLING - SAMPLE COLLECTION DATA SHEET

Project Name: Pfohl Brothers Landfill Project Number: 11175616.00000

Sampling Crew Members: R. Murphy, T. Urban Supervisor: J. Sundquist

Date of Sampling: November 14, 2013

<i>Sample I.D. Number</i>	<i>Well Number</i>	<i>Well Volume (liters)</i>	<i>Volume Purged (liters)</i>	<i>Sample Time</i>	<i>Sample Description</i>	<i>Analysis Required</i>	<i>Chain-of- Custody Number</i>
GW-34S	GW-34S	4.6	8.9	9:14	Groundwater	VOCs/SVOCs/ Metals	Not Applicable
GW-28S	GW-28S	4.5	5.1	10:13	Groundwater		Not Applicable
GW-04S	GW-4S	7.5	15.1	10:45 & 12:15	Groundwater		Not Applicable
GW-04D	GW-4D	81.0	9.3	12:10	Groundwater		Not Applicable
GW-35S	GW-35S	2.8	7.4	13:22	Groundwater		Not Applicable
GW-26D	GW-26D	84.2	60.0	14:35	Groundwater		Not Applicable
GW-29S	GW-29S	8.4	8.4	15:40	Groundwater		Not Applicable

Additional Comments: GW-4S was sampled for VOCs using a passive diffusion bag and then purged dry/allowed to recharge
for collection of other parameters.
All other wells were purged using low flow methods until parameter stabilization.

GROUNDWATER SAMPLING - SAMPLE COLLECTION DATA SHEET

Project Name: Pfohl Brothers Landfill

Project Number: 11175616.00000

Sampling Crew Members: R. Murphy, T. Urban

Supervisor: J. Sundquist

Date of Sampling: November 14, 2013

Sample I.D. Number	Well Number	Well Volume (liters)	Volume Purged (liters)	Sample Time	Sample Description	Analysis Required	Chain-of-Custody Number
GW-07D	GW-7D	37.5	37.5	16:10	Groundwater	SVOCs/ Metals	Not Applicable
GW-07S	GW-7S	20.1	30.3	16:30	Groundwater		Not Applicable
TB-111413	---	---	---	---	Trip Blank	VOCs	Not Applicable

Additional Comments:

GW-7D and GW-7S were sampled for SVOCs and Metals after recharging overnight.

All other wells were purged using low flow methods until parameter stabilization.

GROUNDWATER SAMPLING - SAMPLE COLLECTION DATA SHEET

Project Name: Pfohl Brothers Landfill

Project Number: 11175616.00000

Sampling Crew Members: R. Murphy, T. Urban

Supervisor: J. Sundquist

Date of Sampling: November 15, 2013

Sample I.D. Number	Well Number	Well Volume (liters)	Volume Purged (liters)	Sample Time	Sample Description	Analysis Required	Chain-of-Custody Number
GW-30S	GW-30S	6.2	18.3	8:38	Groundwater	VOCs/SVOCs/ Metals	Not Applicable
GW-31S	GW-31S	4.3	5.3	9:33	Groundwater		Not Applicable
GW-32S	GW-32S	4.6	9.0	10:35	Groundwater		Not Applicable
GW-33S	GW-33S	2.6	5.1	11:35	Groundwater		Not Applicable
GW-01S	GW-1S	7.1	11.3	13:10	Groundwater		Not Applicable
GW-01D	GW-1D	91.9	66.0	14:31	Groundwater		Not Applicable
TB-111513	---	---	---	---	Trip Blank	VOCs	Not Applicable

Additional Comments: All wells were purged using low flow methods until parameter stabilization.

APPENDIX E

GROUNDWATER TREND ANALYSIS

FIGURE E-1
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-1D

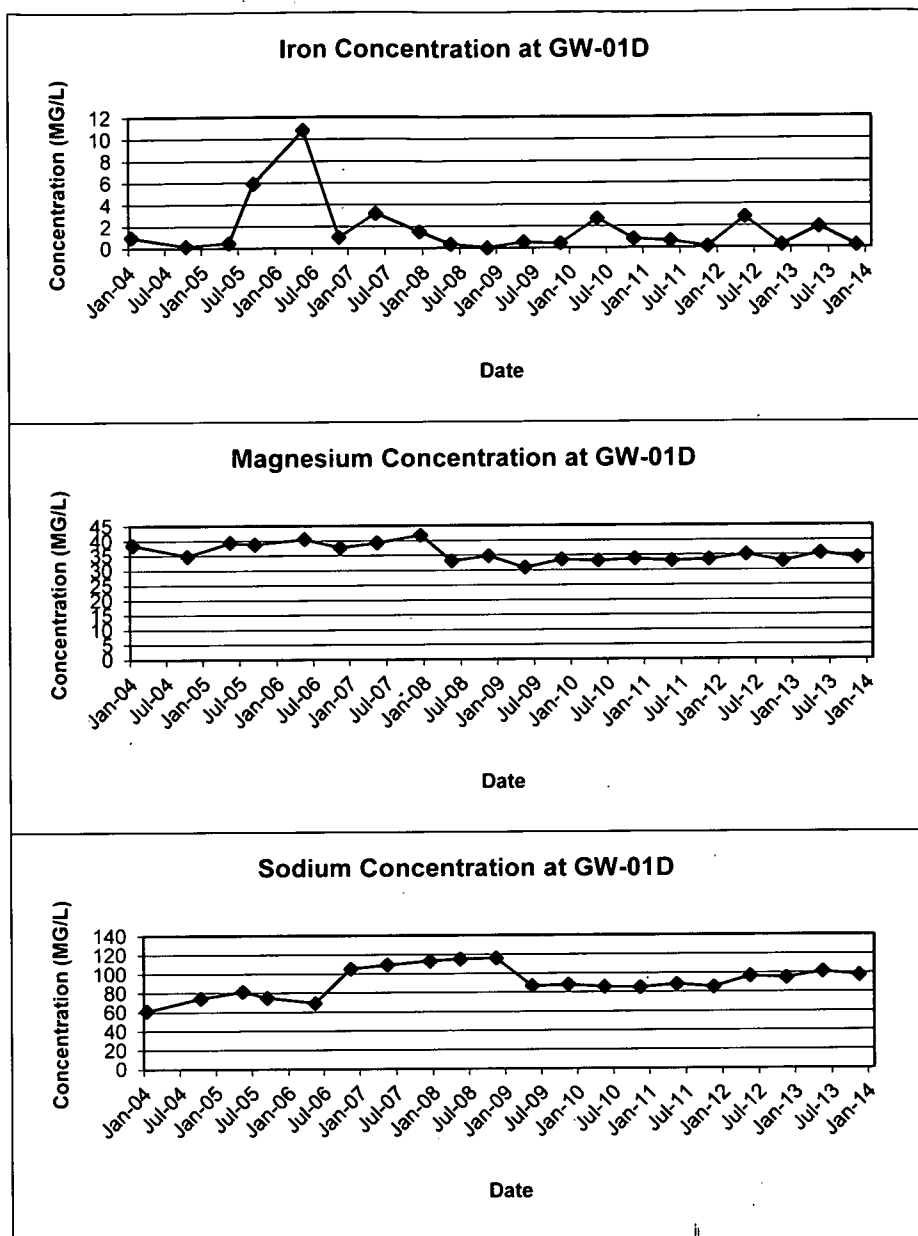


FIGURE E-2
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-1S

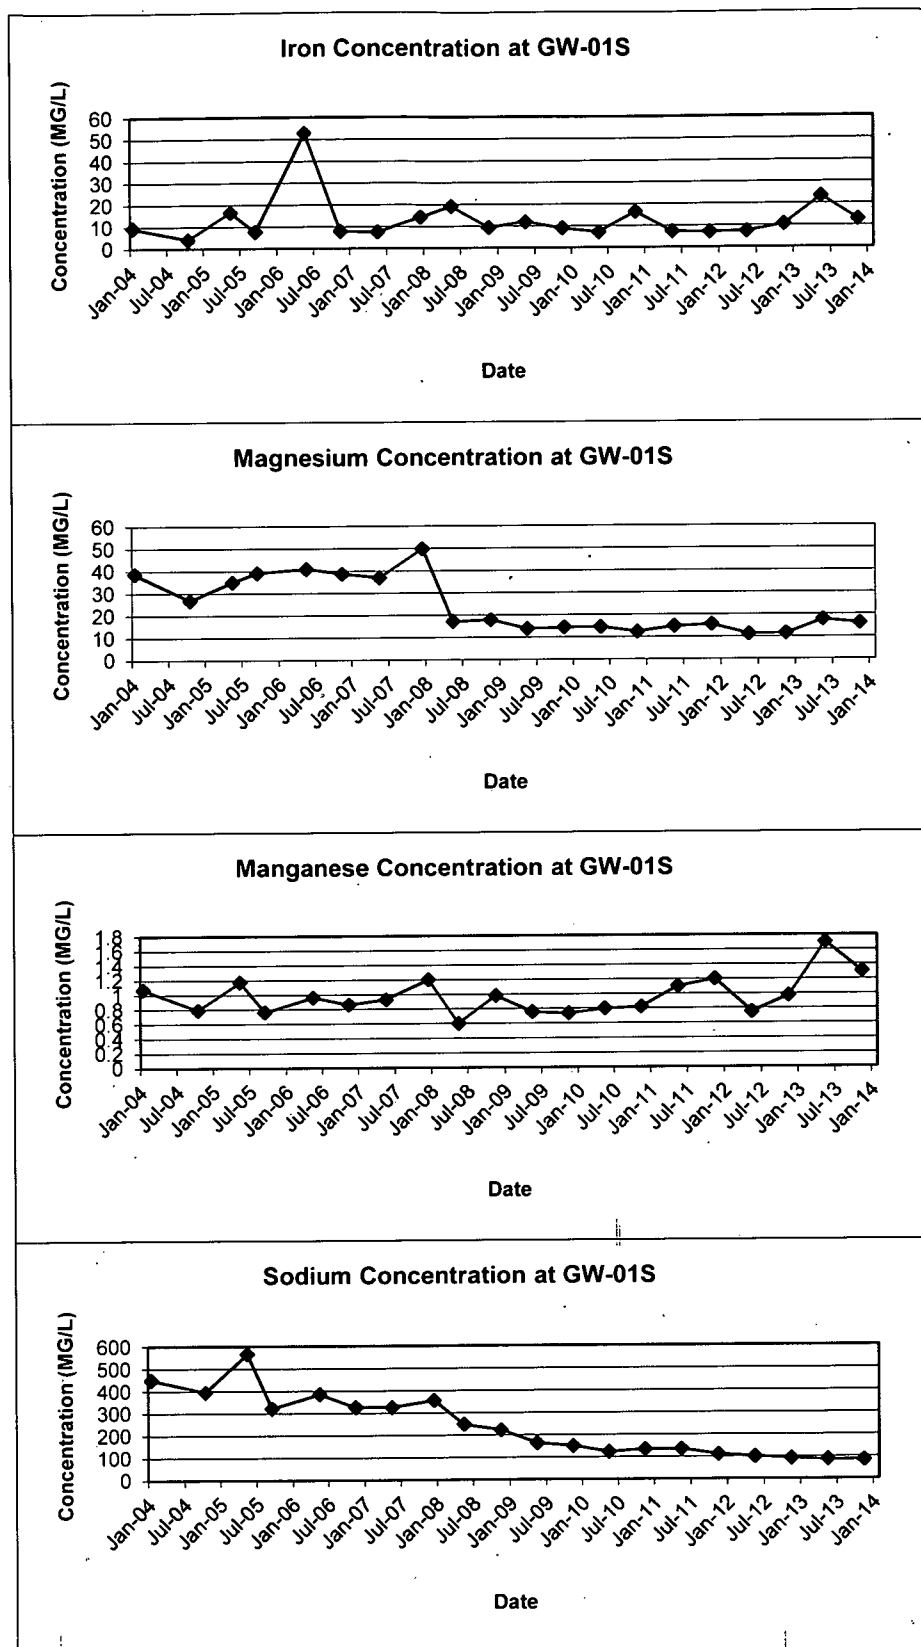


FIGURE E-3
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-3D

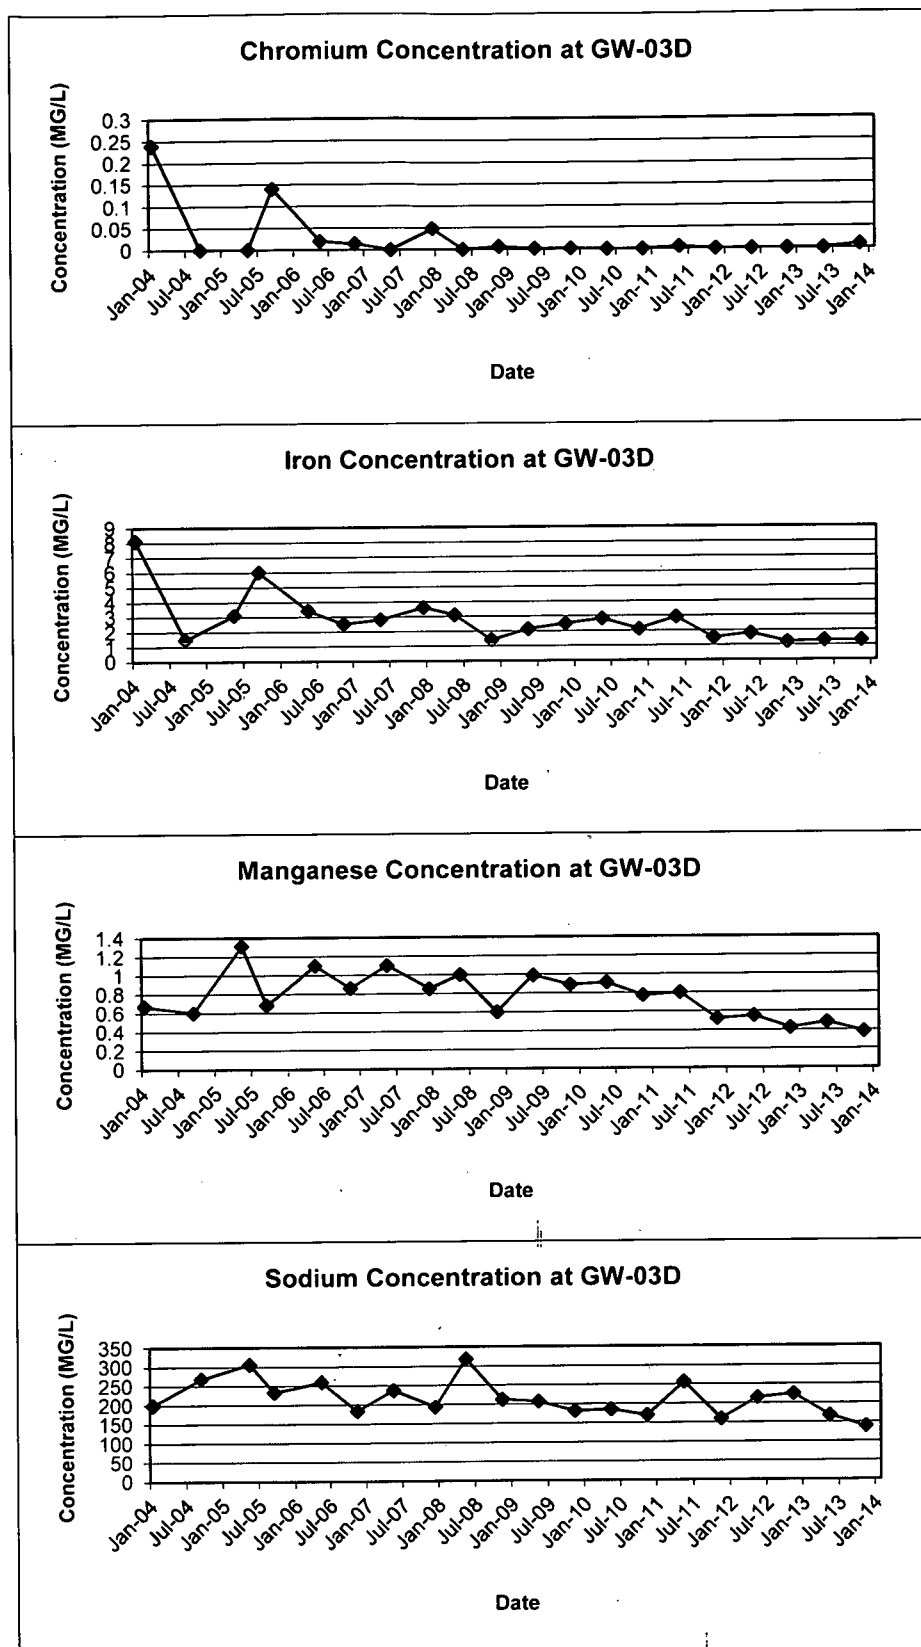


FIGURE E-4
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-3S

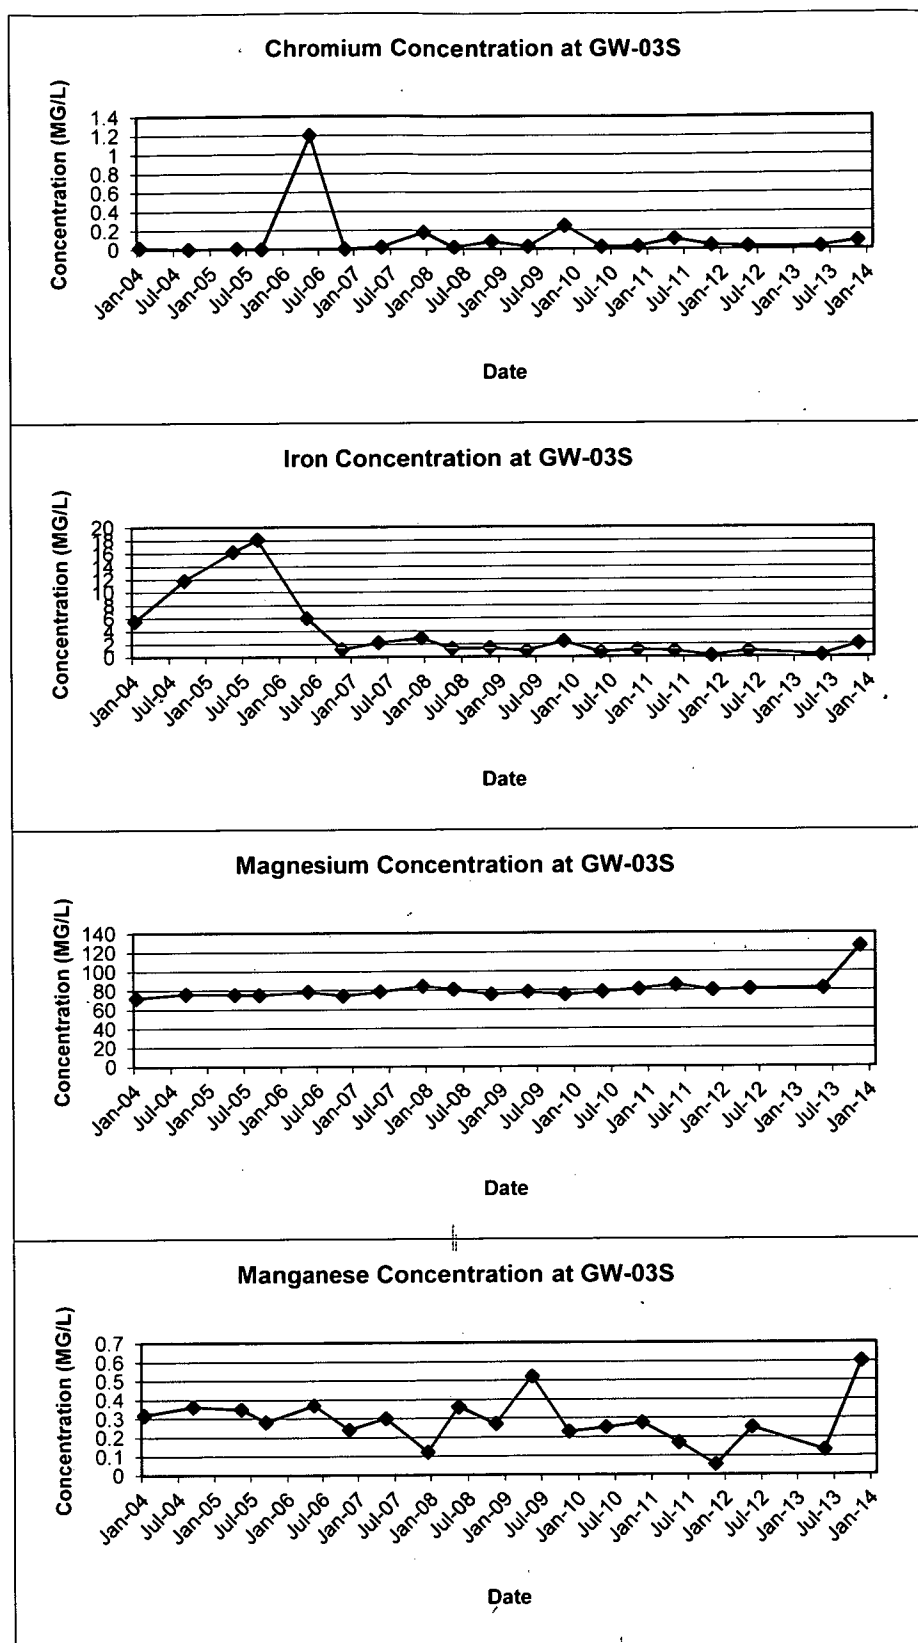


FIGURE E-4
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-3S

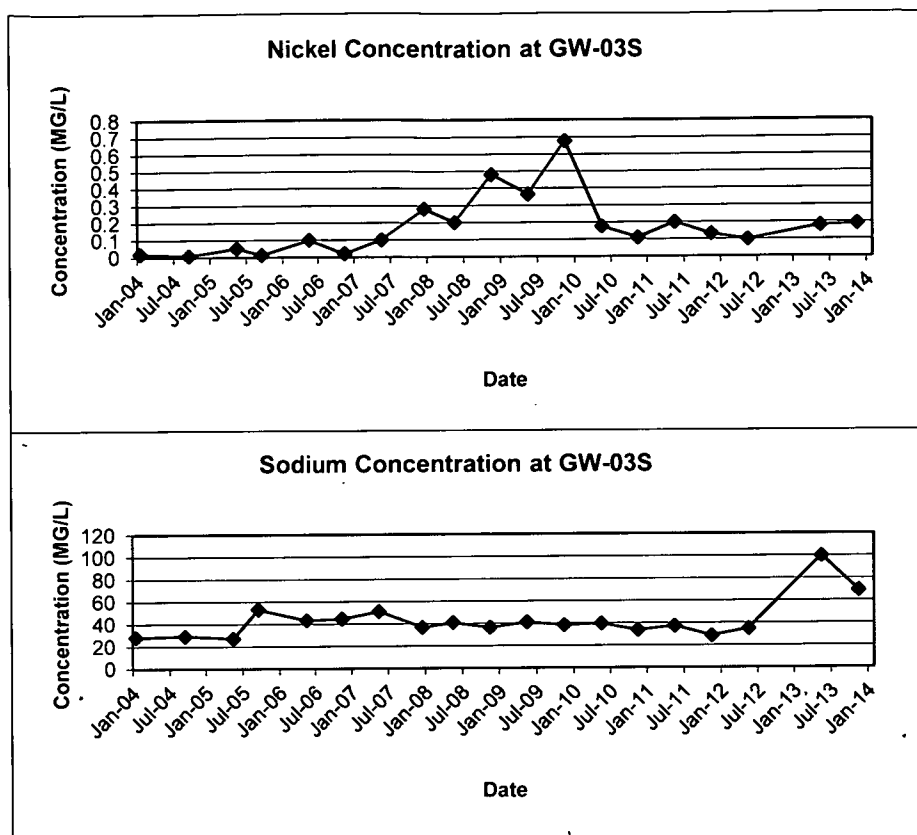


FIGURE E-5
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-4D

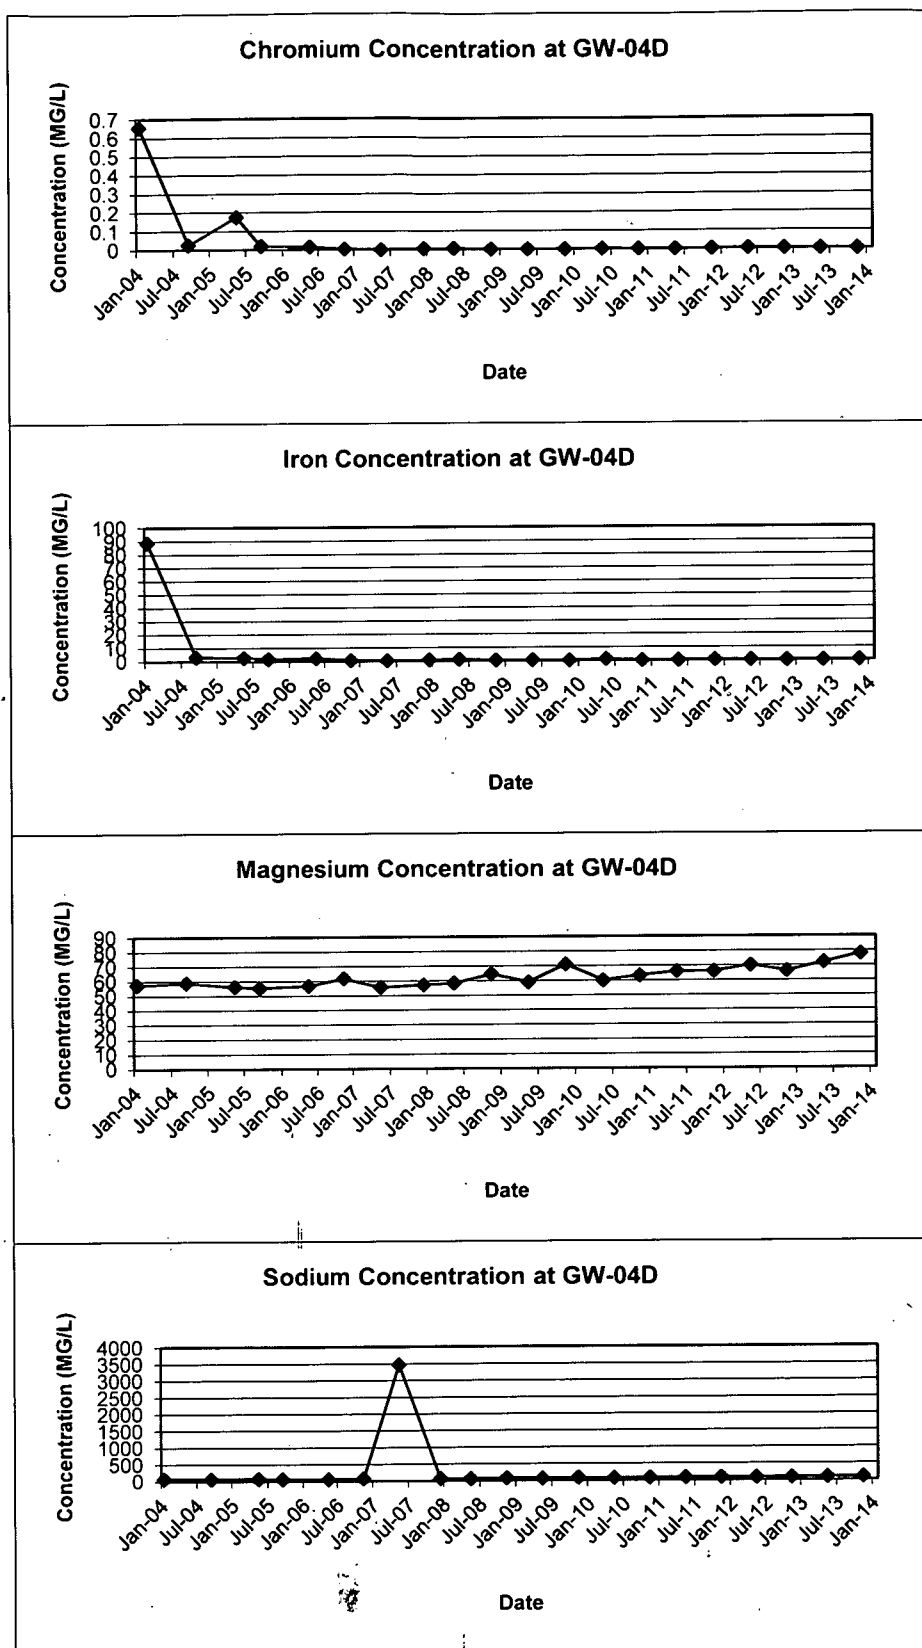


FIGURE E-6
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-4S

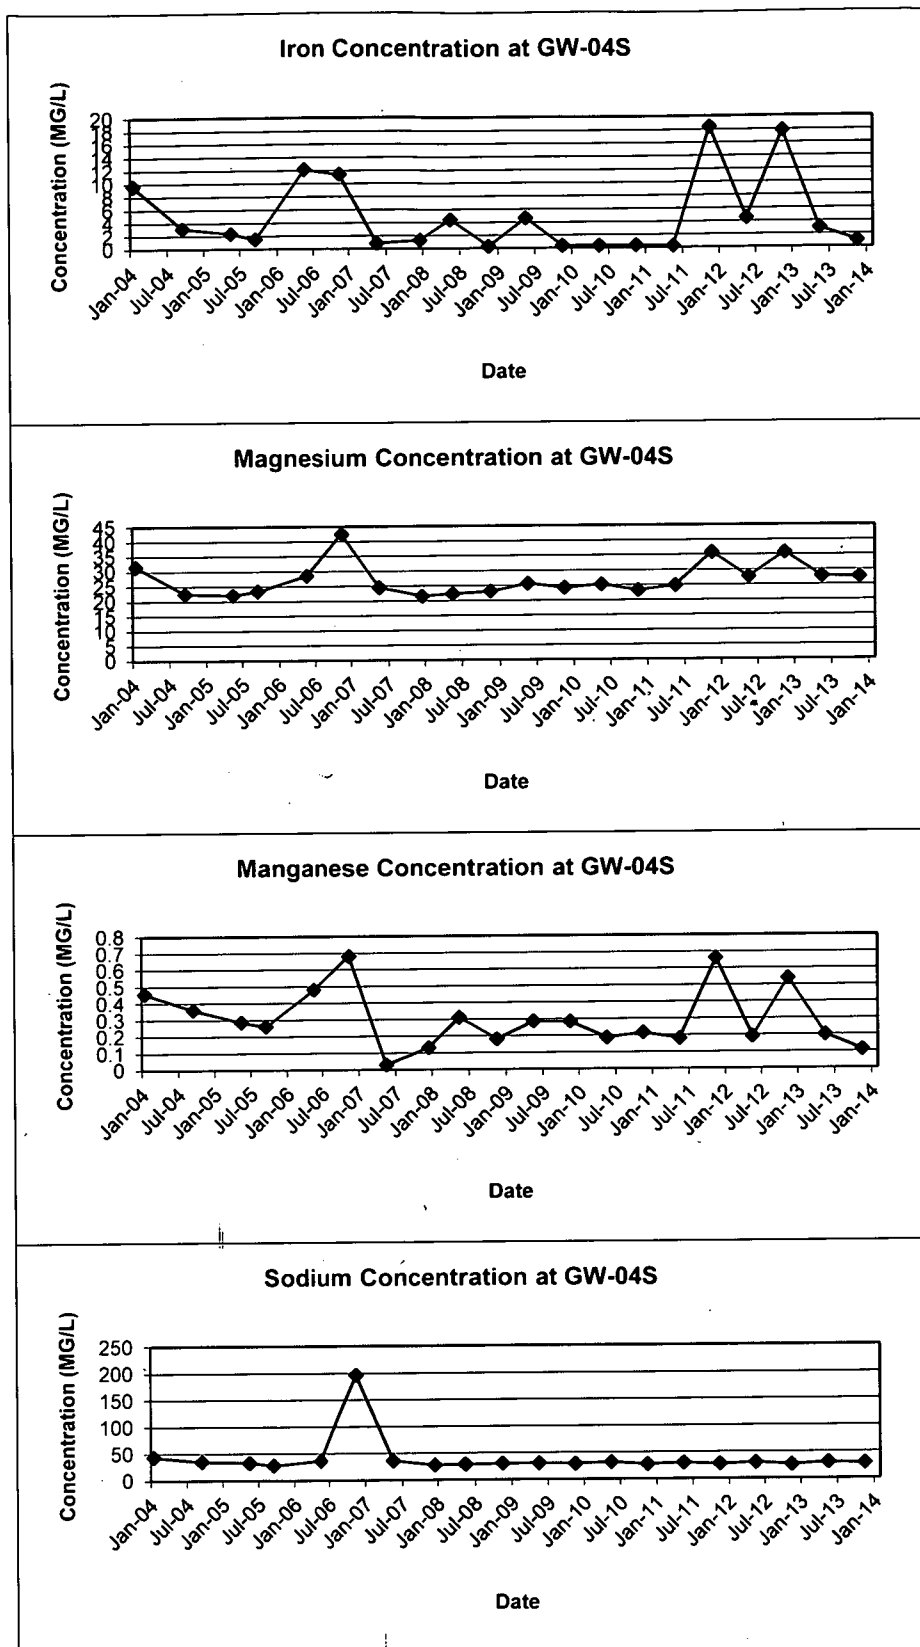


FIGURE E-7
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-07D

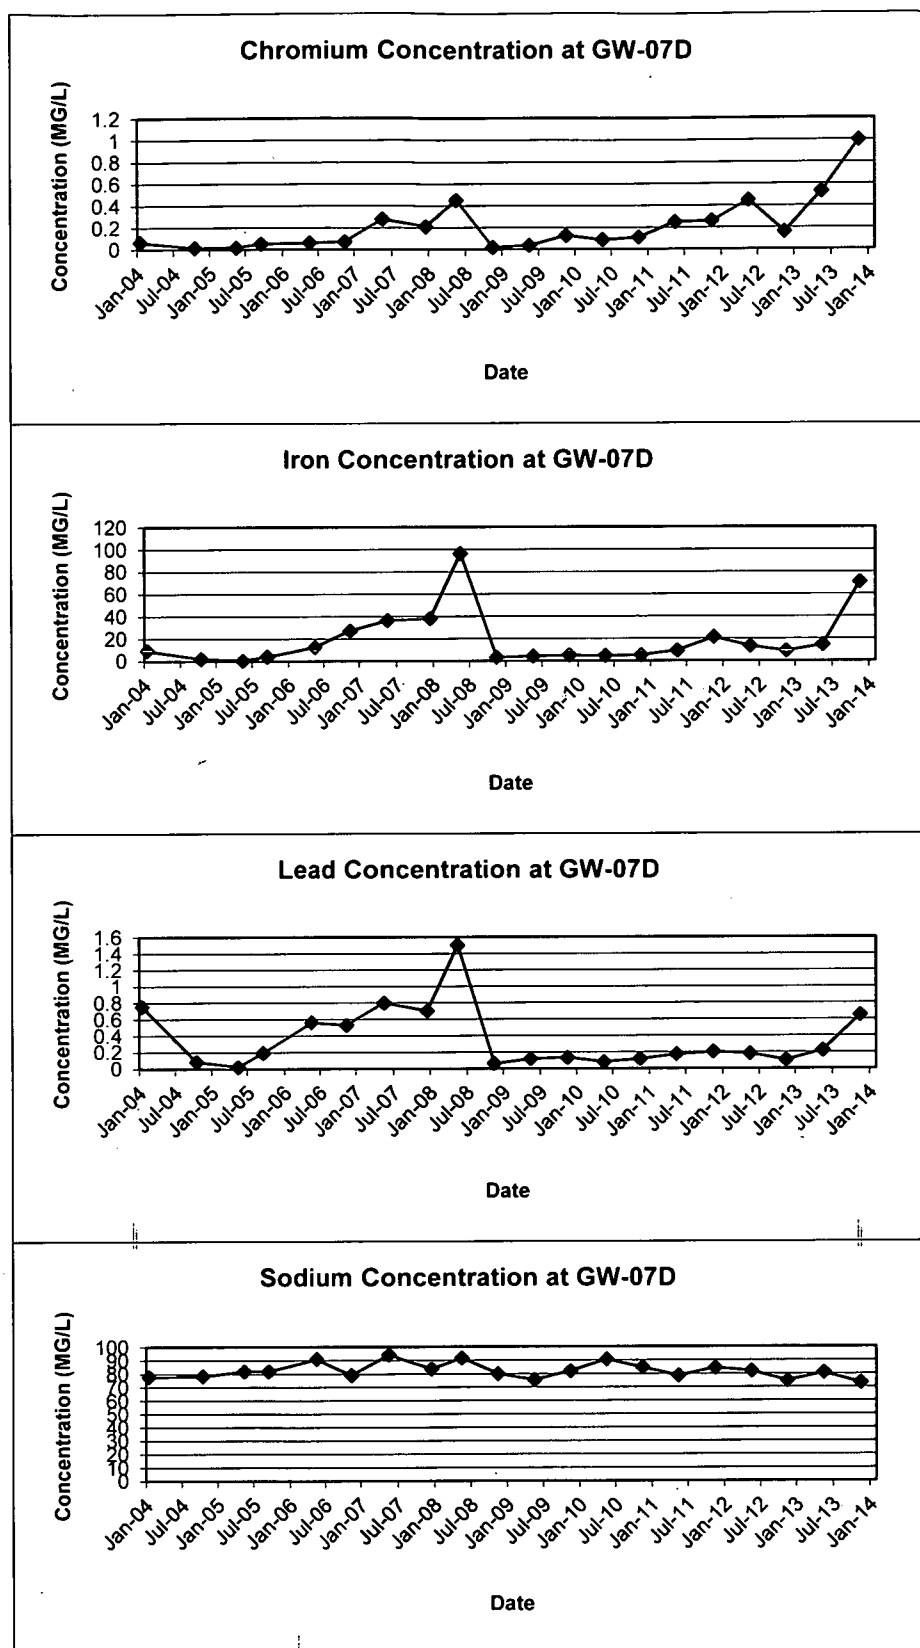


FIGURE E-8
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-7S

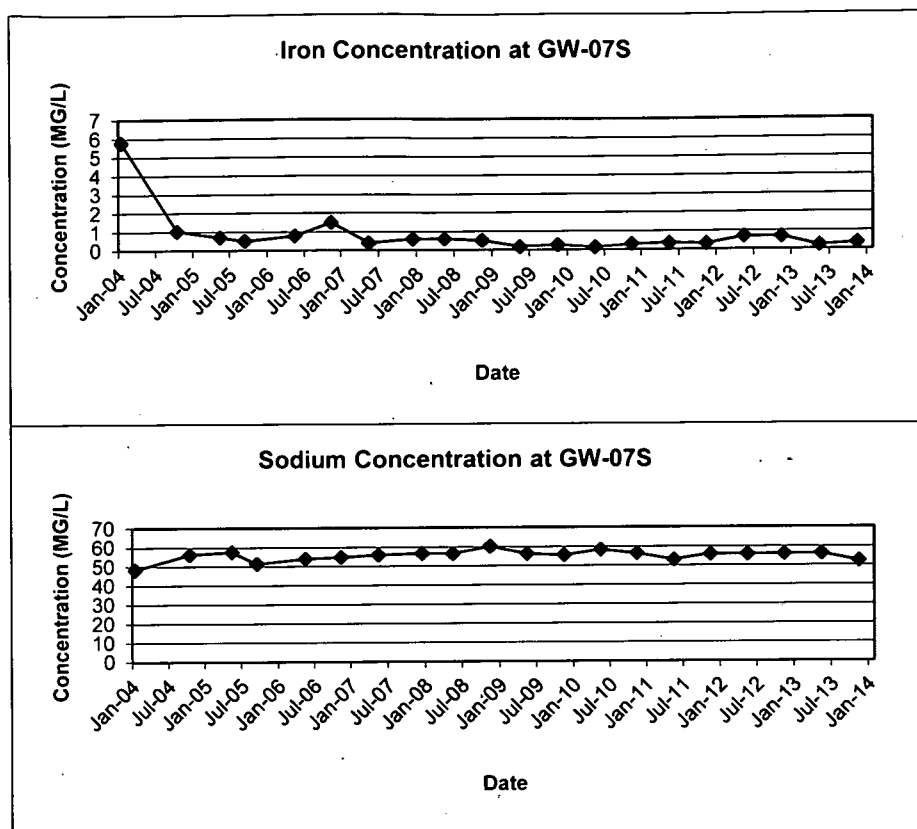


FIGURE E-9
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-8D

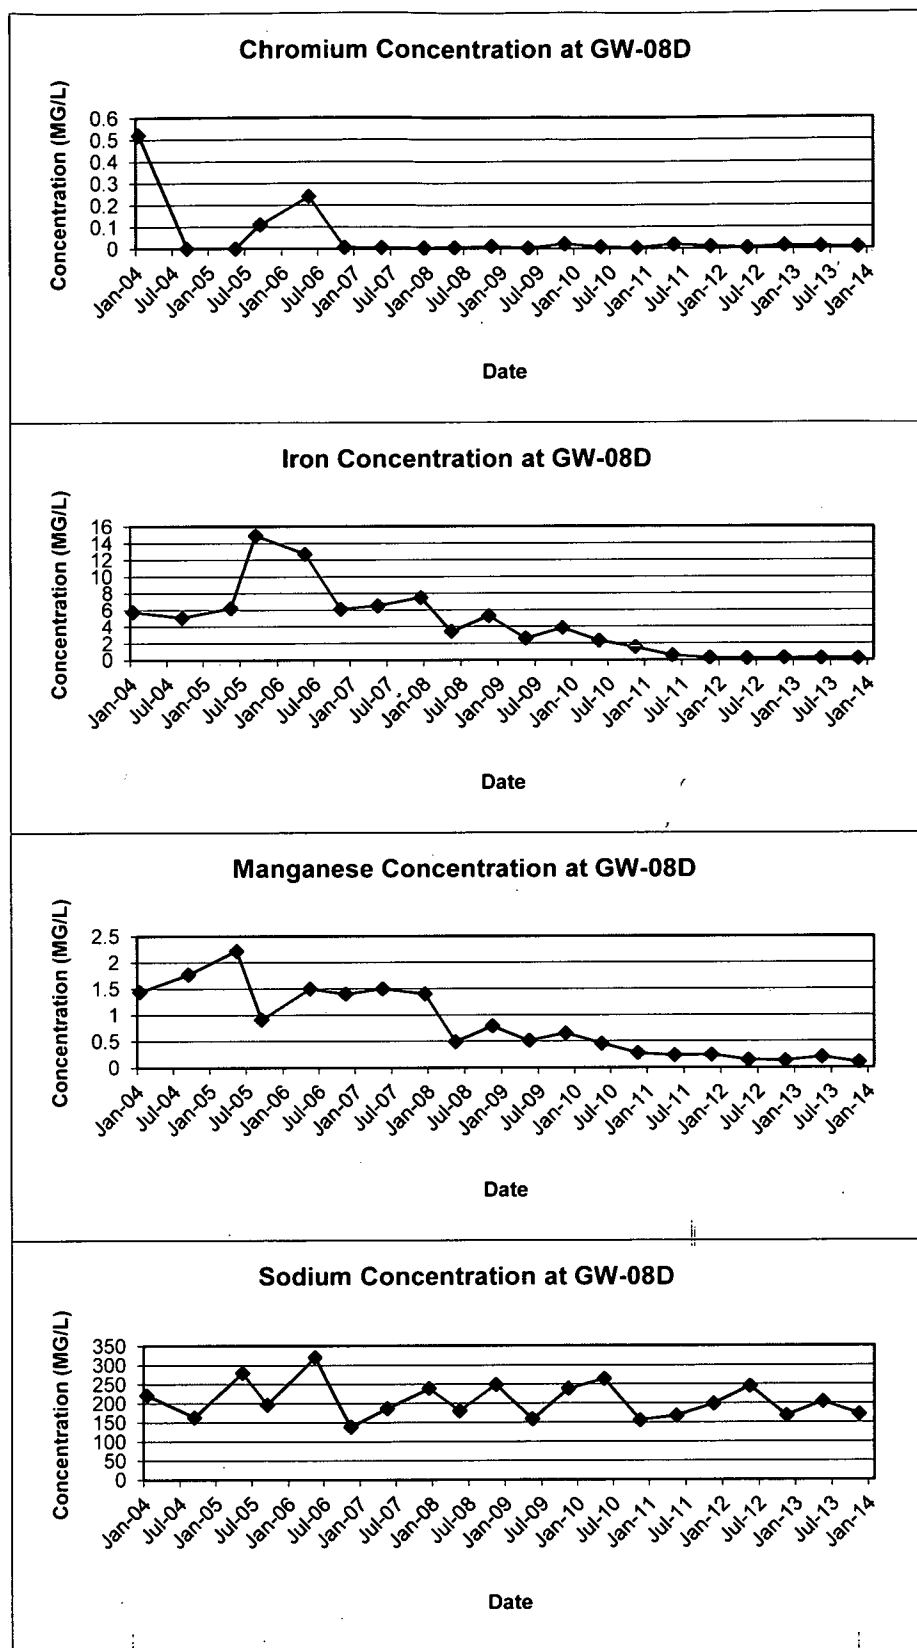


FIGURE E-10
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-8SR

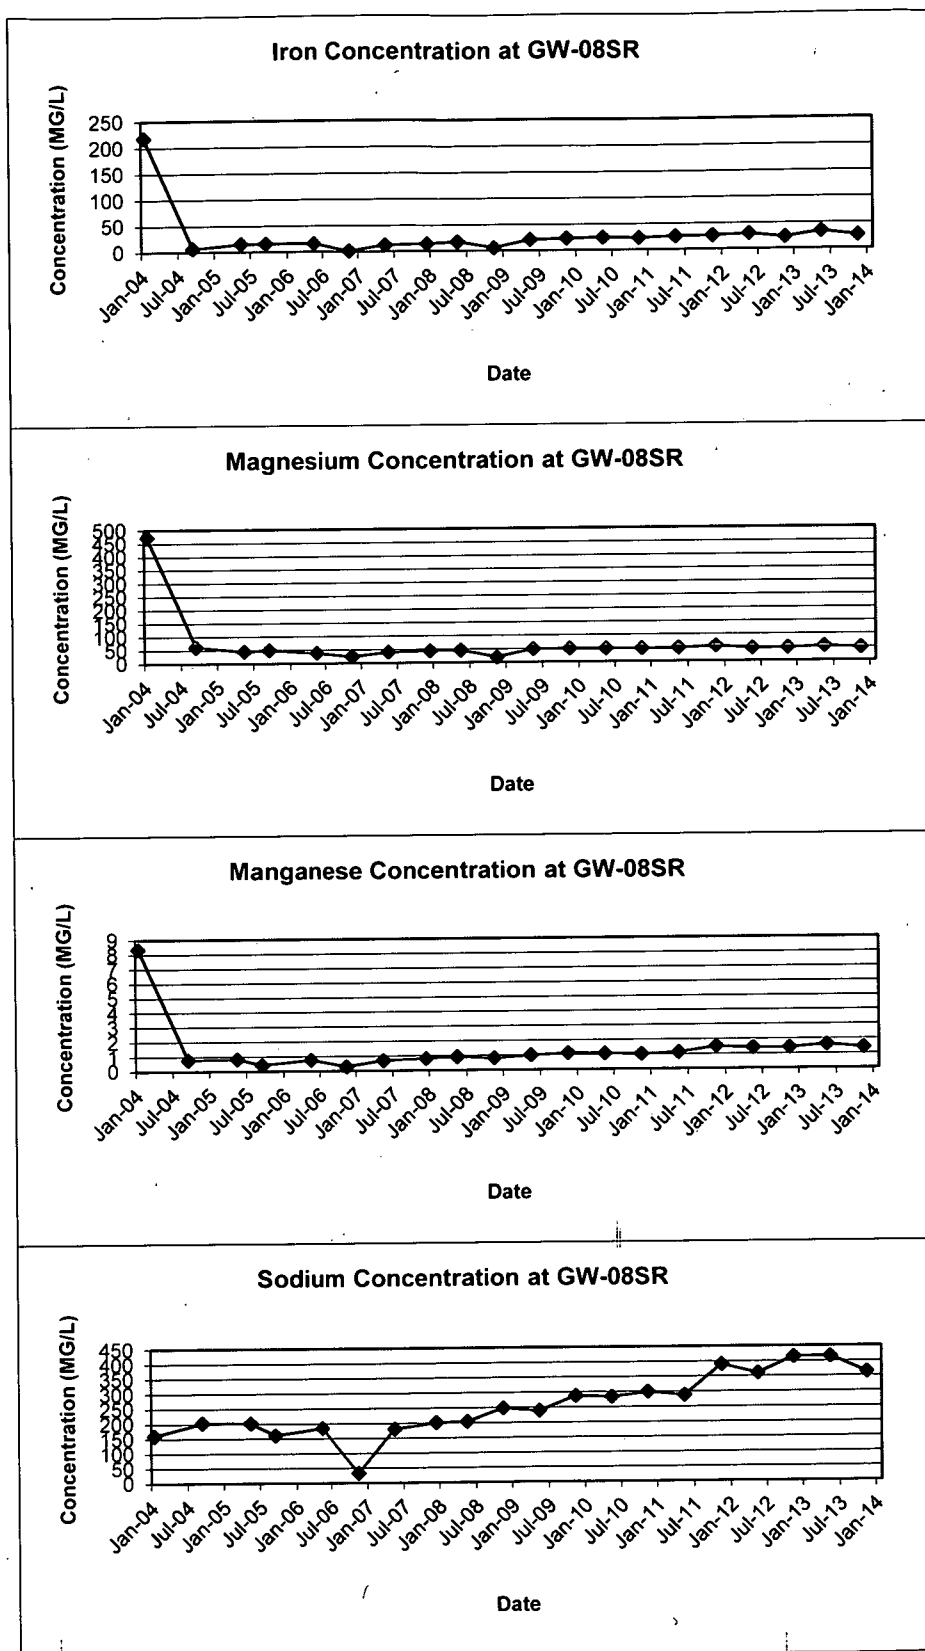


FIGURE E-11
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-26D

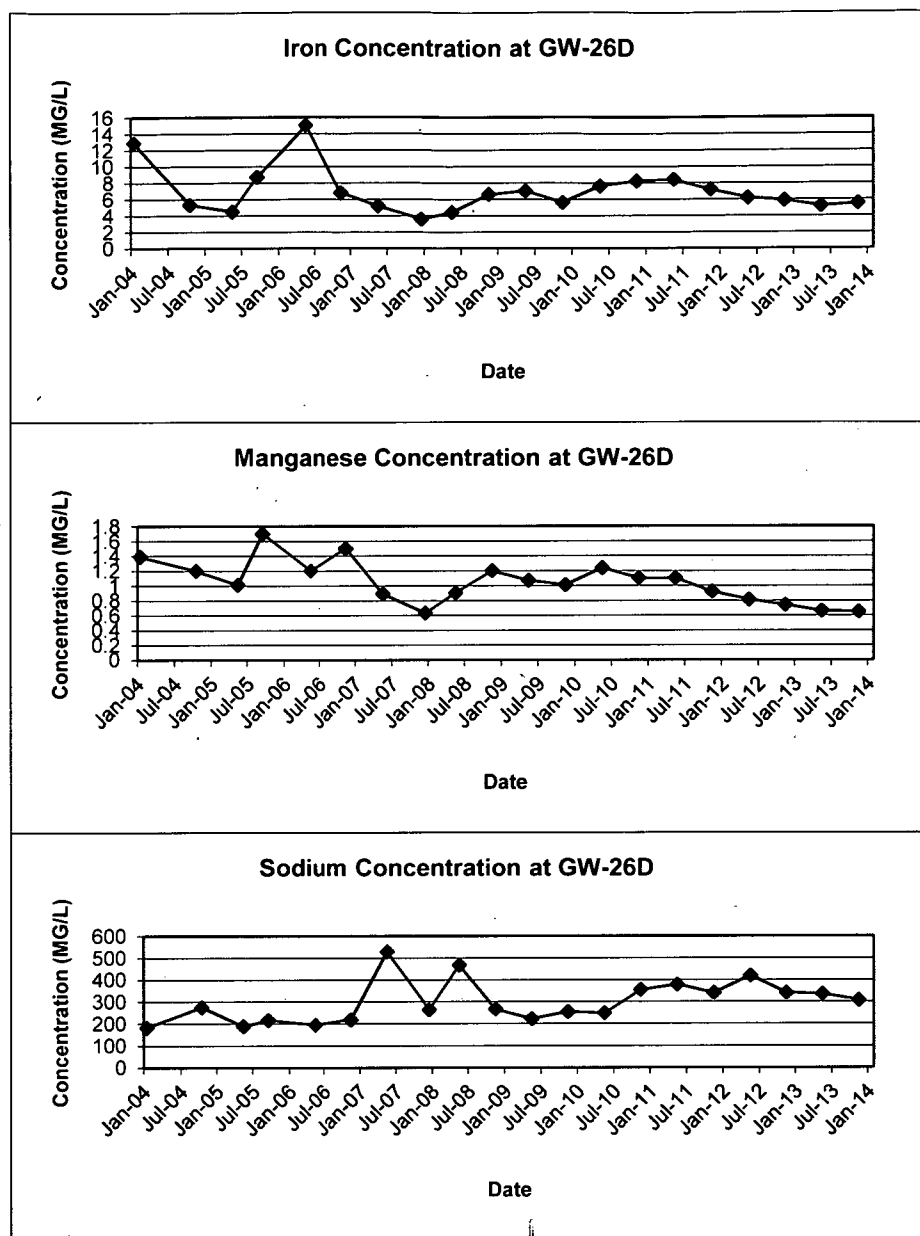


FIGURE E-12
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-28S

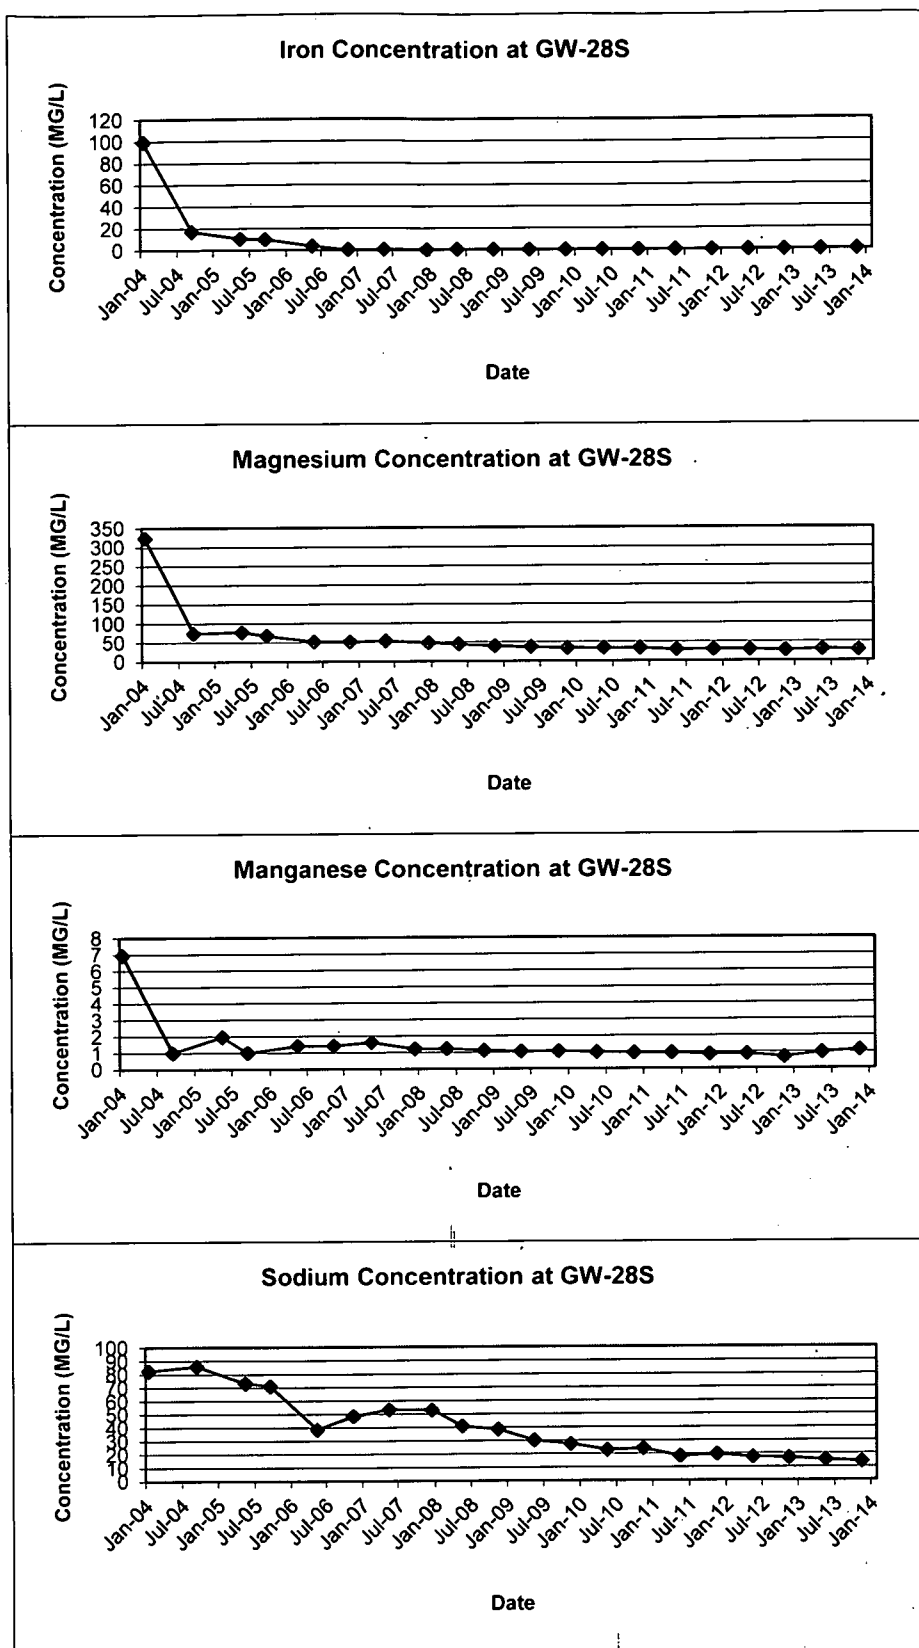


FIGURE E-13
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-29S

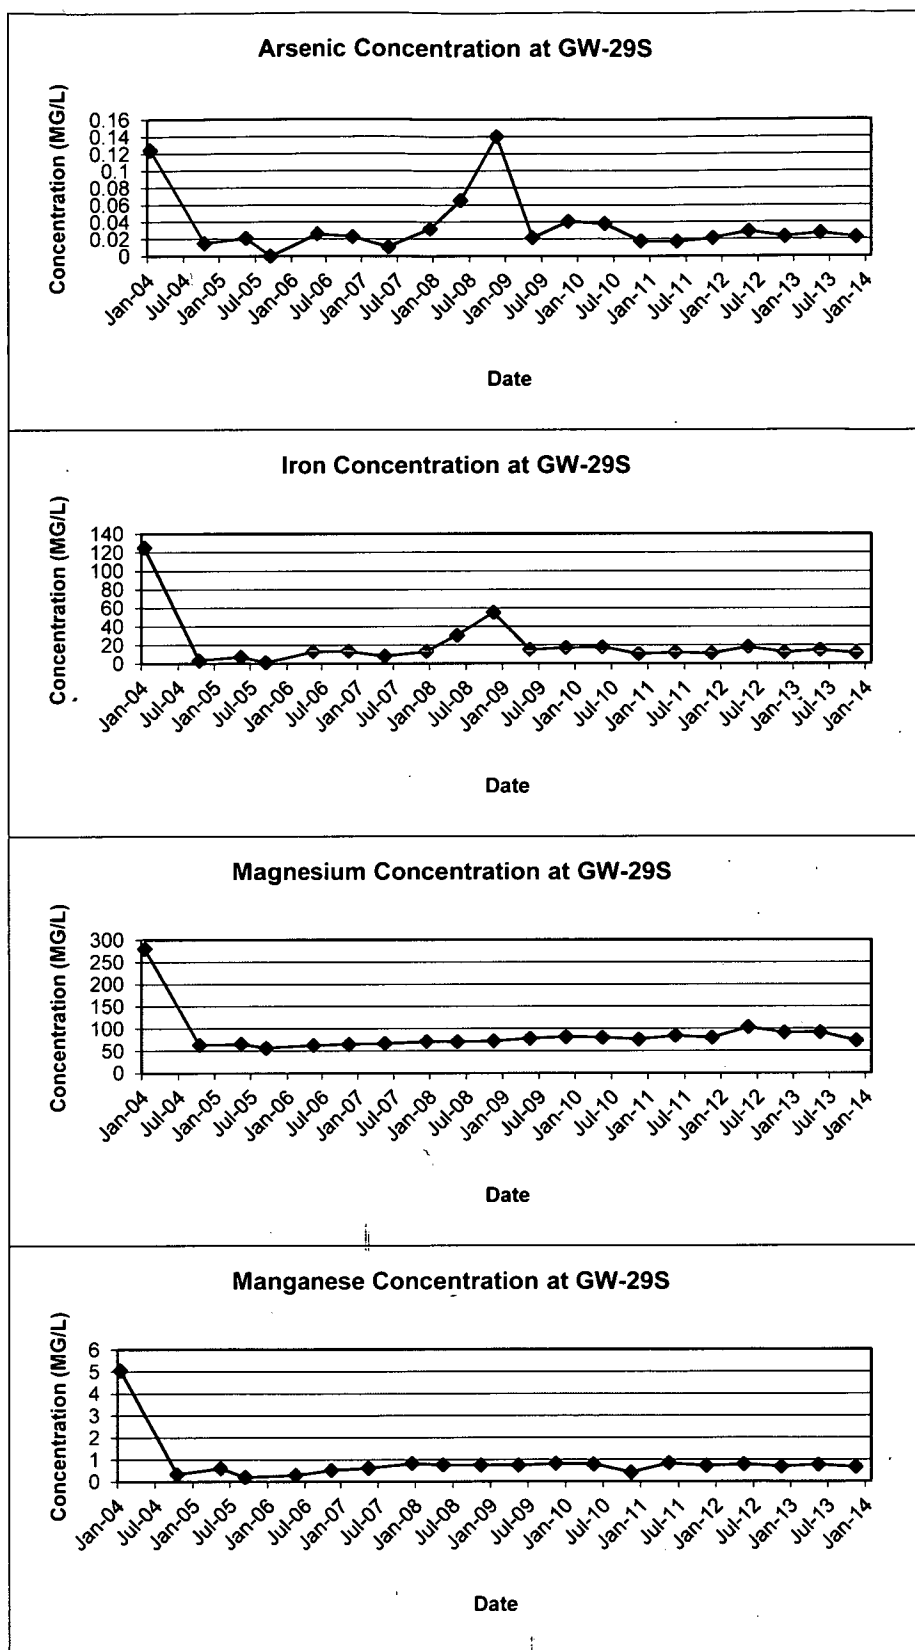


FIGURE E-13
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-29S

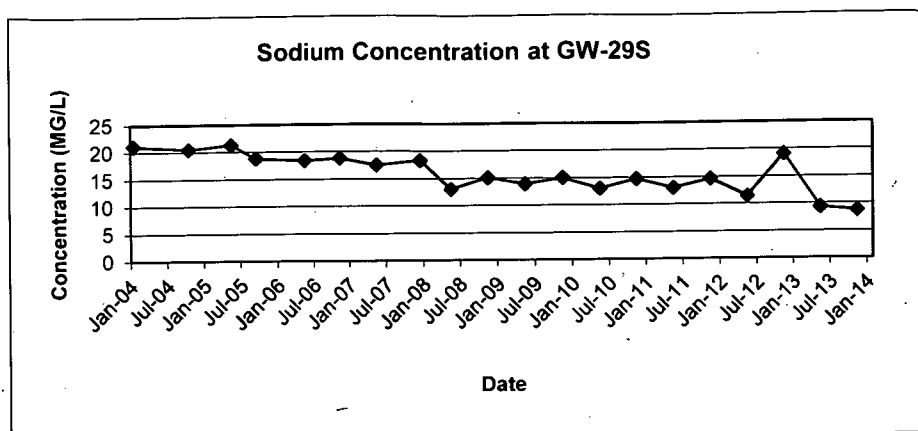


FIGURE E-14
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-30S

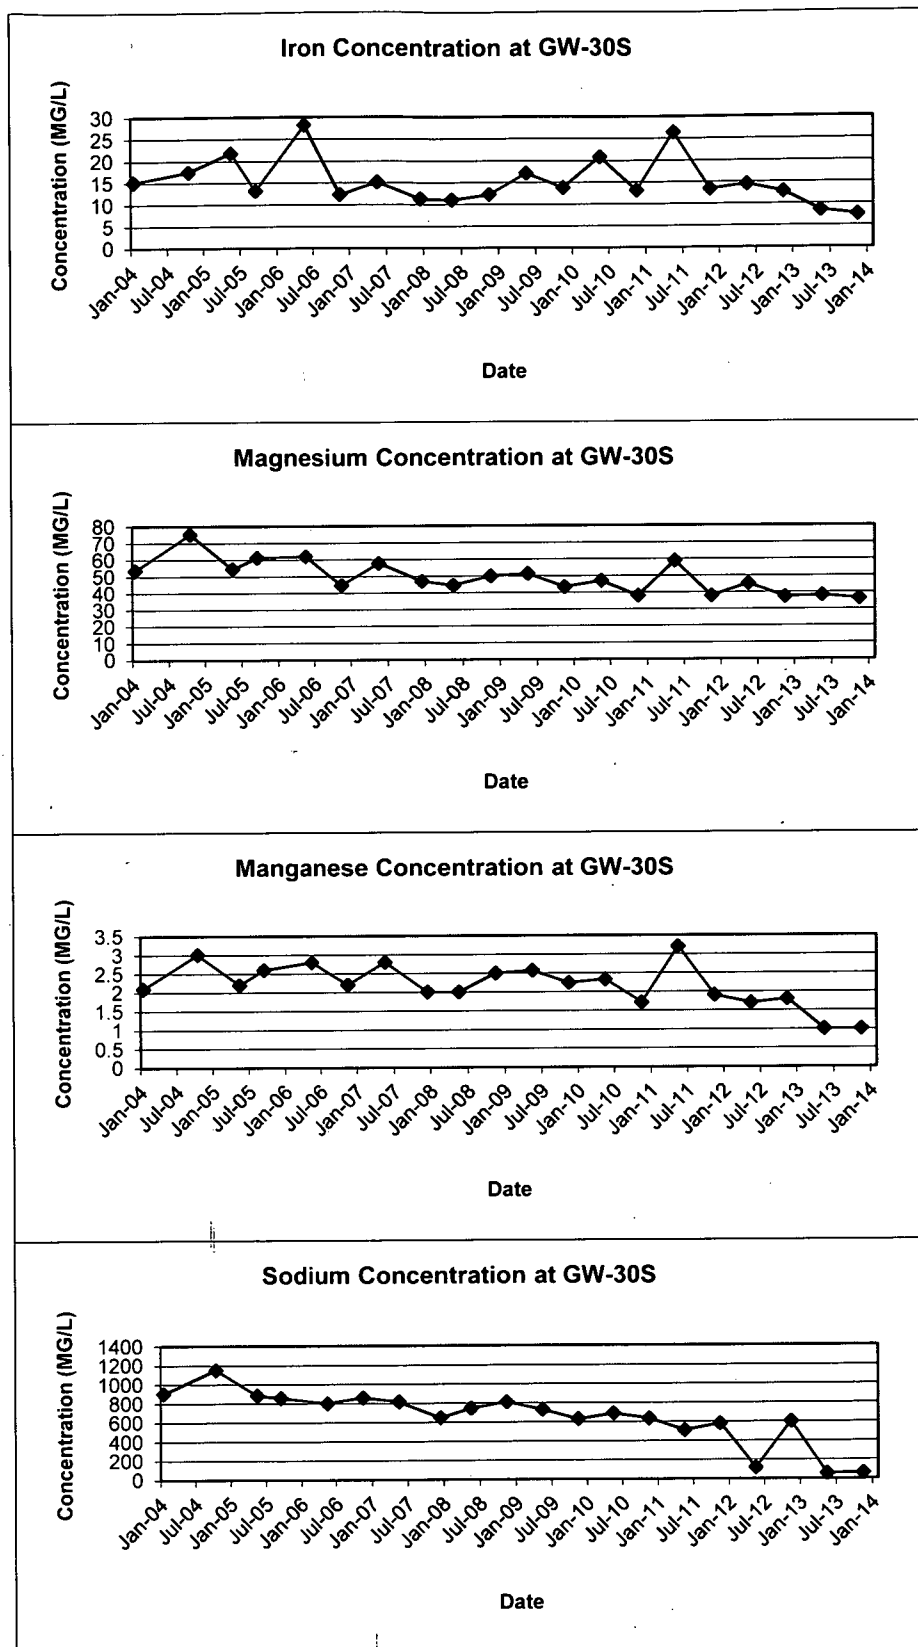


FIGURE E-15
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-31S

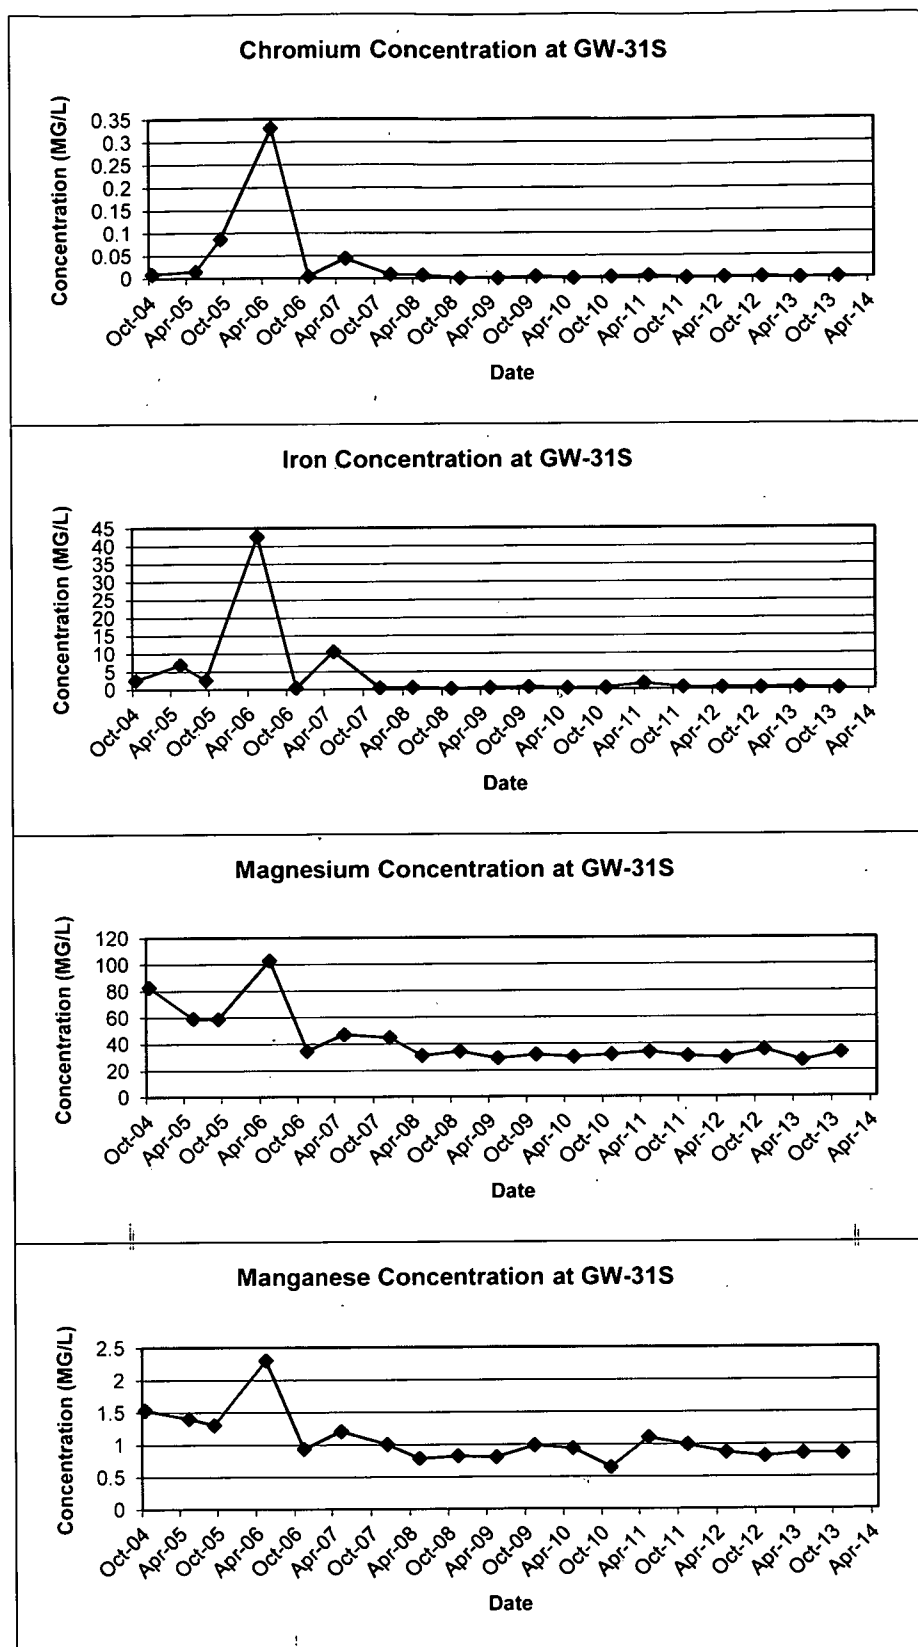


FIGURE E-16
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-32S

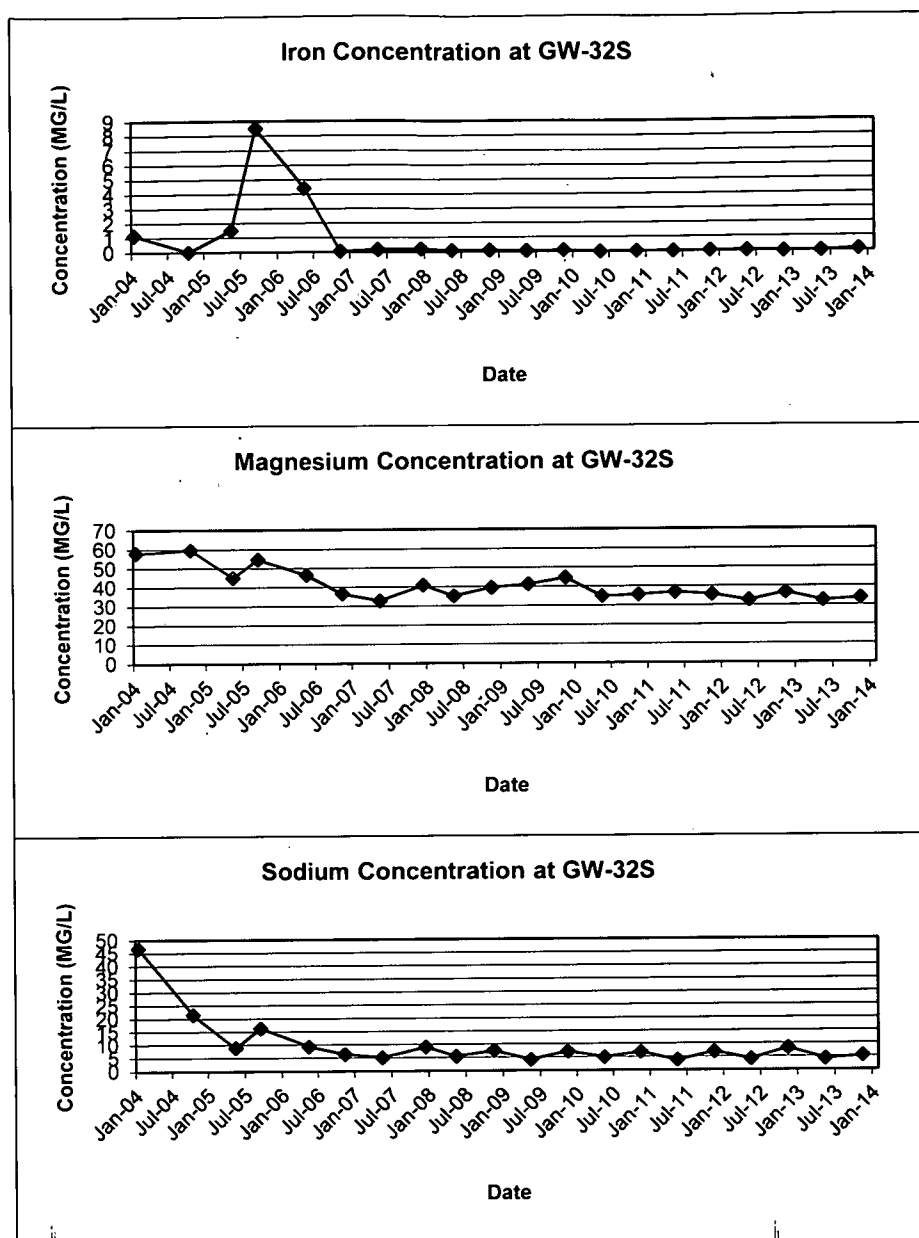


FIGURE E-17
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-33S

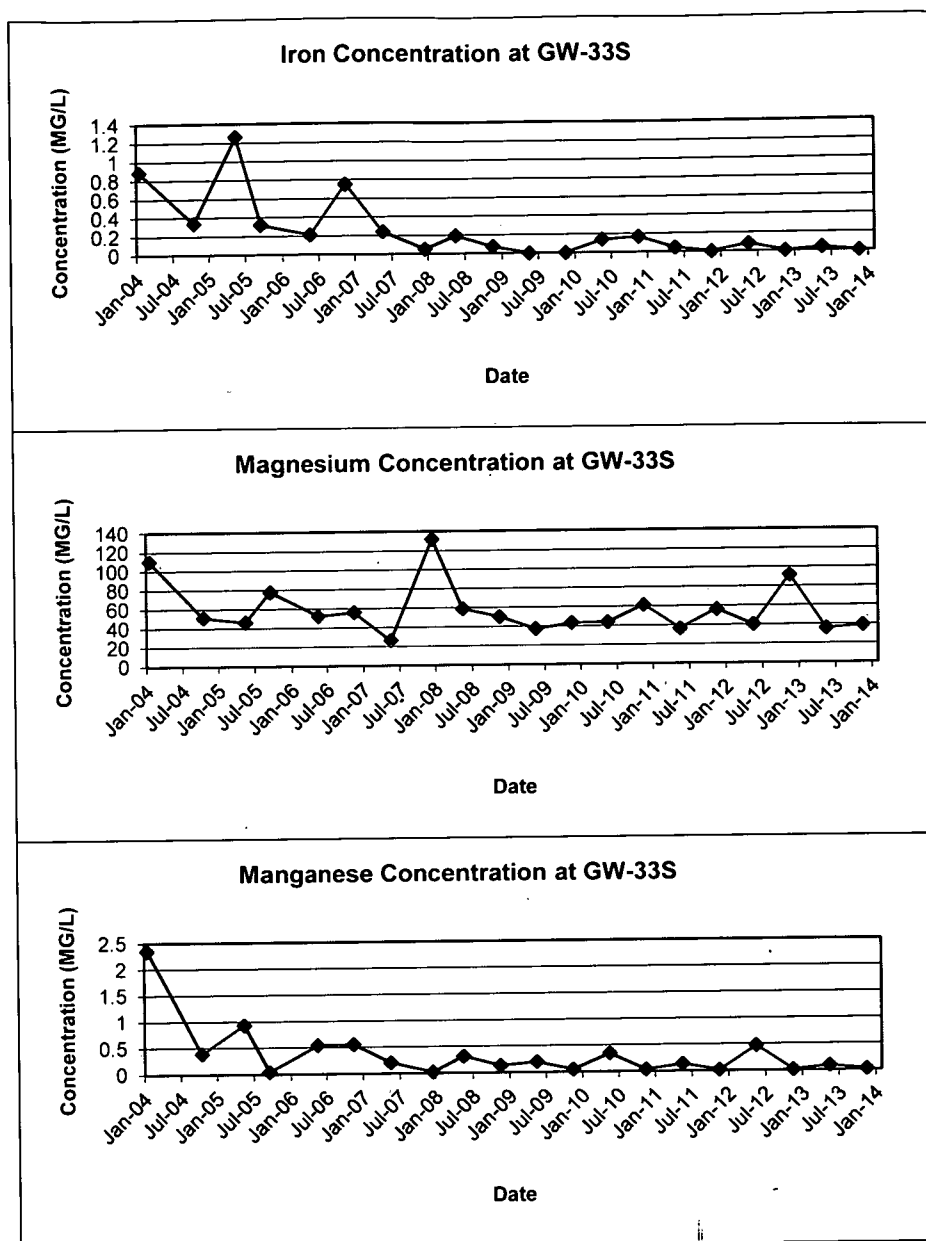


FIGURE E-18
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-34S


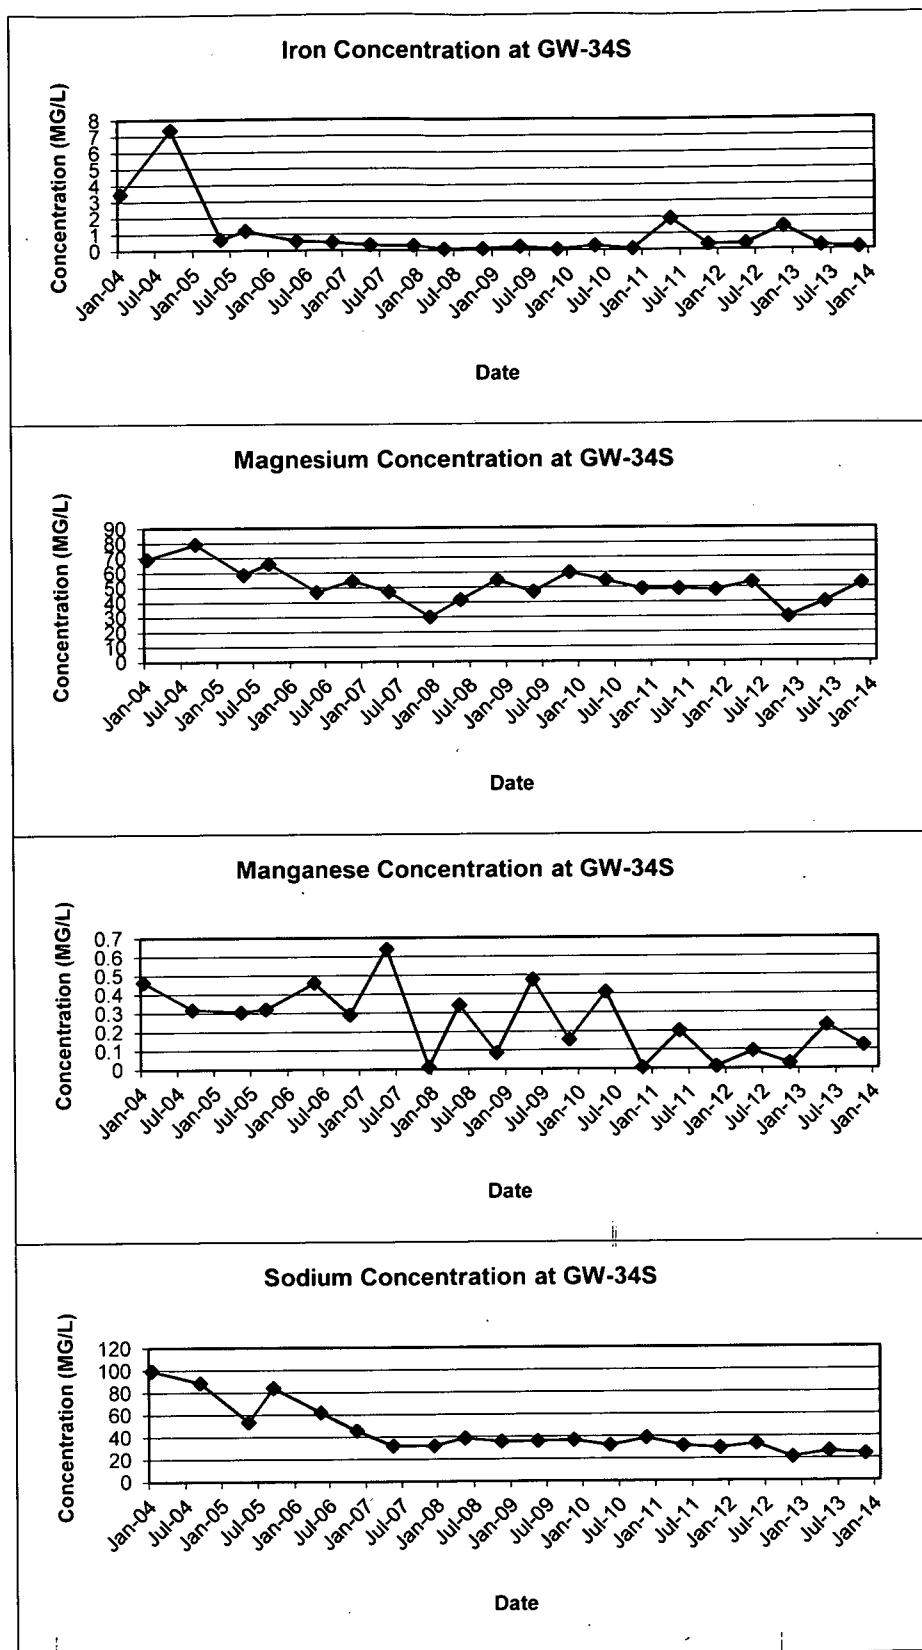


FIGURE E-19
TRENDS OF PARAMETERS ROUTINELY EXCEEDING GROUNDWATER STANDARDS
IN MONITORING WELL GW-35S

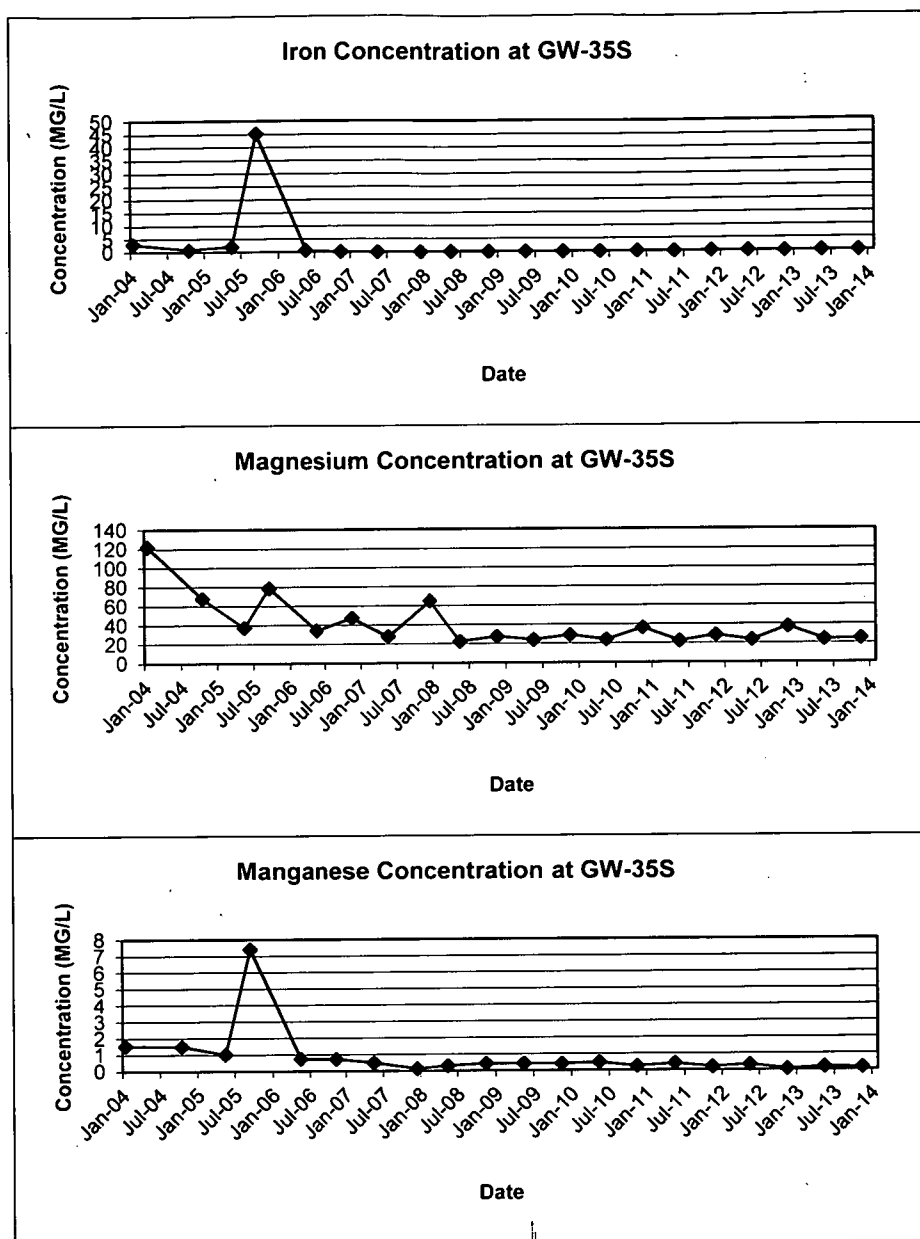

APPENDIX F

BSA PERMIT NO. 13-04-CH016

The Town of Cheektowaga
275 Alexander Street
Cheektowaga NY 14211



WILLIAM R. PUGH, P.E.
TOWN ENGINEER

Engineering Department
Office: 716-897-7288
Fax: 716-897-7299

October 8, 2013

Mr. Jon Sundquist, PhD
Project Manager
URS Corporation
77 Goodell Street
Buffalo, New York 14203

Re: Pfohl Bros. Landfill
Site Discharge Permit

Dear Mr. Sundquist:

Enclosed please find a copy of the Buffalo Sewer Authority Discharge Permit, BPDES 13-04-0CH16, for your file for the referenced site which was renewed earlier this year having an expiration date of March 31, 2016. All discharge limitations and sampling requirements remain the same as the most recent expired permit.

Should you have any questions, please contact this office at 897-7288.

Very truly yours,

TOWN OF CHEEKTOWAGA

A handwritten signature in black ink, appearing to read "W. R. Pugh", is written over the printed name.

William R. Pugh, P.E.
Town Engineer

WRP/mj

enc.

**AUTHORIZATION TO DISCHARGE UNDER THE BUFFALO
POLLUTANT DISCHARGE ELIMINATION SYSTEM**

**PERMIT NO. 13-04-CH016
USEPA Category 40 CFR Part 403**

In accordance with the provisions of the Federal Water Pollution Control Act, as amended, and the
Sewer Regulations of the Buffalo Sewer Authority, authorization is hereby granted to:

THE TOWN OF CHEEKTOWAGA

to discharge wastewater from a facility located at:

PFOHL BROTHERS LANDFILL REMEDIATION SITE

1000 AERO DRIVE


CHEEKTOWAGA, NEW YORK 14225

The wastewater permitted herein shall be discharged to the Town of Cheektowaga sewer system,
which is connected to the Buffalo Municipal Sewer System and Treatment facilities, and which
wastewater will be treated at the Buffalo Sewer Authority's Treatment Plant.

Issuance of this permit is based upon a permit application filed on **February 11, 2013** analytical
data. This permit is granted in accordance with discharge limitations, monitoring requirements and
other conditions set forth in Parts I and II hereof.

Effective this 1st^{day} of April, 2013

To Expire the 31st day of March, 2016



General Manager

Signed this 12th day of March, 2013

PART I: SPECIFIC CONDITIONS**A. DISCHARGE LIMITATIONS & MONITORING REQUIREMENTS**

During the period beginning the effective date of this Permit and lasting until the expiration date, discharge from the permitted facility outfall (see attached map) shall be limited and monitored quarterly by the permittee as specified below.

Sample Point	Parameter	Discharge Limitations ⁽¹⁾	Sampling Requirements	
		Daily Max	Period	Type
001	pH	5.0 - 12.0 S.U.	1 day	Composite ²
	Total Cadmium	1.17 lbs.	1 day	Composite ²
	Total Chromium	1.17 lbs.	1 day	Composite ²
	Total Copper	3.74 lbs.	1 day	Composite ²
	Total Lead	1.17 lbs.	1 day	Composite ²
	Total Nickel	3.27 lbs.	1 day	Composite ²
	Total Zinc	5.84 lbs.	1 day	Composite ²
	Total Barium	2.34 lbs.	1 day	Composite ²
	Total Suspended Solids ⁵	250 mg/l	1 day	Composite ²
	Total Flow	140,100 gallons ⁶	1 day	Discharge meter reading

Footnotes are explained on page 5.

PART I: SPECIFIC CONDITIONS**A. DISCHARGE LIMITATIONS & MONITORING REQUIREMENTS**

During the period beginning the effective date of this Permit and lasting until the expiration date, discharge from the permitted facility outfall (see attached map) shall be limited and monitored once by the permittee as specified below.

Sample Point	Parameter	Discharge Limitations ⁽¹⁾	Sampling Requirements	
		Daily Max	Period	Type
001	Total Mercury	0.001 lbs.	1 day	Composite ²
	USEPA Test Method 608 ⁴	To be monitored	1 day	Grab ³
	USEPA Test Method 624 ⁴	To be monitored	1 day	Grab ³
	USEPA Test Method 625 ⁴	To be monitored	1 day	Grab ³

Footnotes are explained on page 5.

PART I: SPECIFIC CONDITIONS

B. DISCHARGE MONITORING REPORTING REQUIREMENTS

During the period beginning the effective date of this permit and lasting until the expiration date, discharge monitoring results shall be summarized and reported **quarterly** by the permittee on the days specified below:


Sample Point	Parameter	Reporting Requirements	
		Initial Report	Subsequent Reports
001	All except USEPA Test Methods 608, 624, 625 & T Mercury	March 31, 2011	Every March 31 st , June 30 th , September 30 th and December 31 st
	USEPA Test Methods 608, 624 and 625 & T Mercury	March 31, 2011	

PART I: SPECIFIC CONDITIONS

C. SPECIAL REQUIREMENTS

1. Mass limits based on an average discharge of 140,100 gpd.
2. Composite samples may be time proportioned.
3. Four grab samples must be collected at equally spaced intervals throughout the sample day. The four (4) grab samples must be composited by a NYSDOH certified laboratory prior to analysis.
4. The permittee must report any compound whose concentration is equal to or greater than 0.01 mg/L. The permittee is not authorized to discharge any of the parameters evaluated by these test procedures which may cause or contribute to a violation of water quality standards or harm the sewerage system. Any parameter detected may, at the discretion of the BSA, be specifically limited and incorporated in this permit.
5. Surchargeable over 250 mg/L.
6. Flow is an action level only. If the permittee consistently exceeds this level, the BSA must be notified so that this permit can be modified.

Permit No. 13-04-CH016
Part I
Page 6 of 6

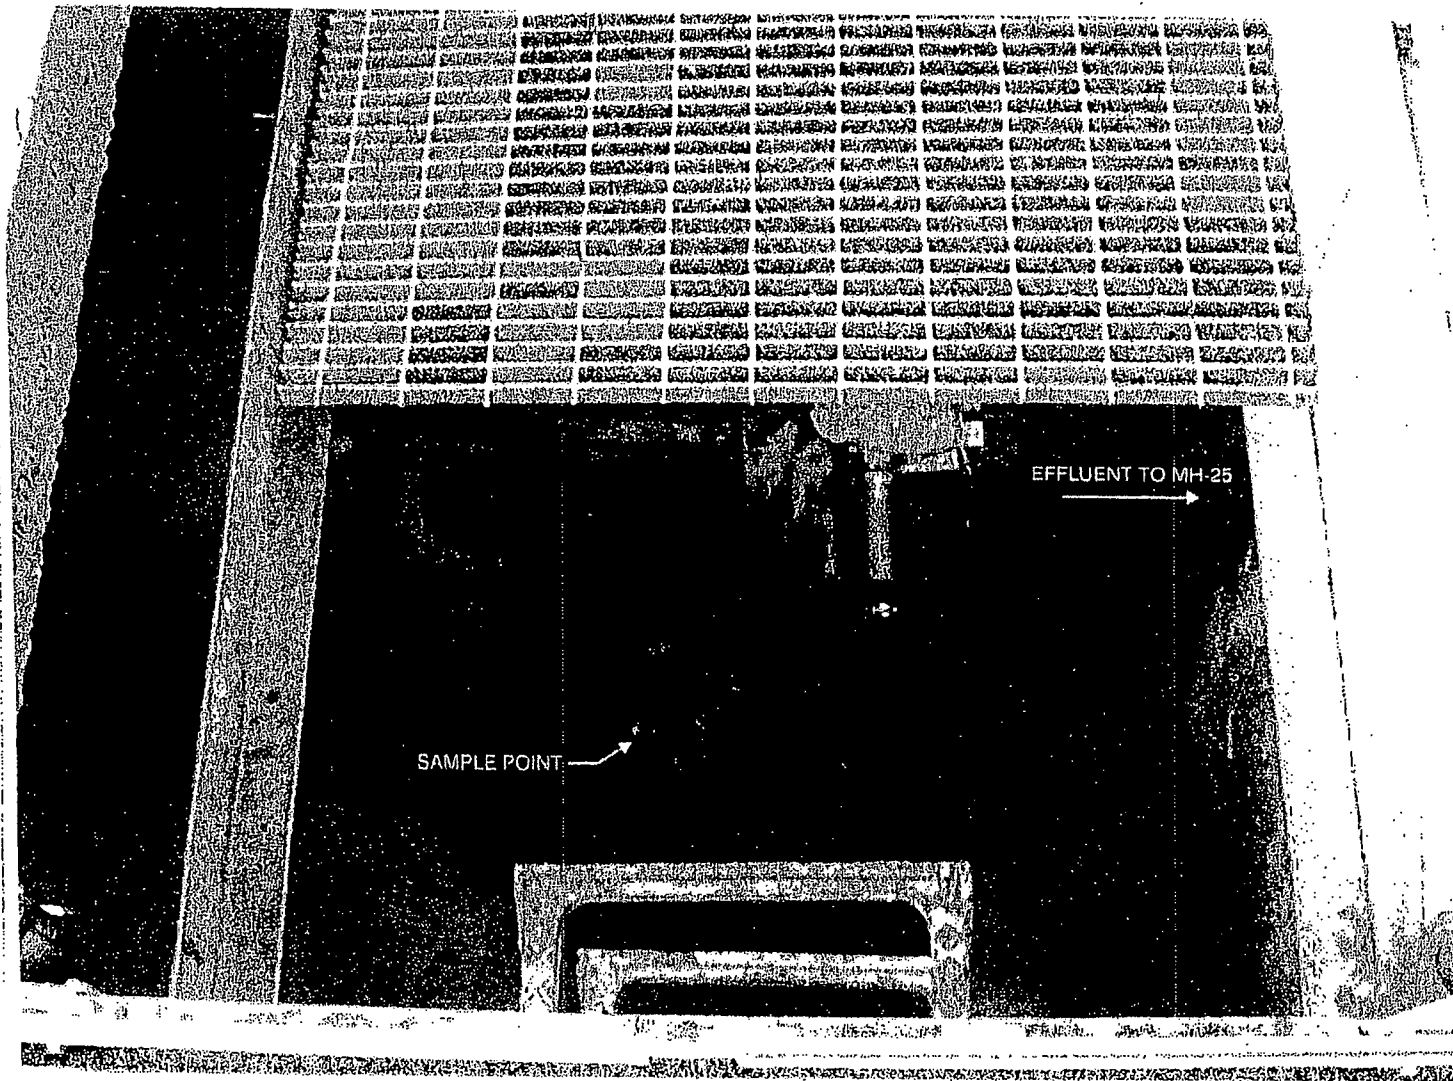

URS

PFOHL BROTHERS LANDFILL
EFFLUENT SAMPLE POINT

FIGURE 1

**TOWN OF CHEEKTOWAGA/BUFFALO POLLUTANT DISCHARGE ELIMINATION SYSTEM
PERMIT**

PART II GENERAL CONDITIONS

A. MONITORING AND REPORTING

1. Local Limits

Except as otherwise specified in this permit, the permit holder shall comply with all specific prohibitions, limits on pollutants or pollutant parameters set forth in the Buffalo Sewer Authority Sewer Use Regulations, as amended from time to time, and such prohibitions, limits and parameters shall be deemed pretreatment standards for purposes of the Clean Water Act

2. Definitions

Definitions of terms contained in this permit are as defined in the Town of Cheektowaga Local Law No. 2 and the Buffalo Sewer Authority Sewer Use Regulations.

3. Discharge Sampling Analysis

All Wastewater discharge samples and analyses and flow measurements shall be representative of the volume and character of the monitored discharge. Methods employed for flow measurements and sample collections and analyses shall conform to the Buffalo Sewer Authority "Sampling Measurement and Analytical Guidelines Sheet."

4. Recording of Results

For each measurement or sample taken pursuant to the requirements of the permit, the Permittee shall record the information as required in the "Sampling Measurement and Analytical Guidelines Sheet."

5. Additional Monitoring by Permittee

If the Permittee monitors any pollutants at the location(s) designated herein more frequently than required by this permit, using approved analytical methods as specified in 40 CFR Part 136 the results of such monitoring shall be included in the calculation and reporting of values required under Part I, B. Such increased frequency shall also be indicated.

6. Reporting

All reports prepared in accordance with this Permit shall be submitted to:

**Mr. William Pugh, P.E.
Town Engineer
275 Alexander Ave.
Cheektowaga, New York, 14211**

All self-monitoring reports shall be prepared in accordance with the BSA "Sampling Measurement and Analytical Guidelines Sheet." These reporting requirements shall not relieve the Permittee of any other reports, which may be required by the

N.Y.S.D.E.C. or the U.S.E.P.A.

B. PERMITTEE REQUIREMENTS

1. Change in Discharge

All discharges authorized herein shall be consistent with the terms and conditions of this permit and with the information contained in the TC/BPDES Permit Application on which basis this permit is granted. In the event of any facility expansions, production increases, process modifications or the installation, modification or repair of any pretreatment equipment which may result in new, different or increased discharges of pollutants, a new TC/BPDES Permit Application must be submitted prior to any change. Following receipt of an amended application, the BSA may modify this permit to specify and limit any pollutants not previously limited. In the event that the proposed change will be covered under an applicable Categorical Standard, a Baseline Monitoring Report must be submitted at least ninety (90) days prior to any discharge.

2. Records Retention

All records and information resulting from the monitoring activities required by this permit including all records of analyses performed, calibration and maintenance of instrumentation, and recordings from continuous monitoring instrumentation shall be retained at this facility for a minimum of three (3) years, or longer if requested by the General Manager and/or Town Engineer.

3. Notification of Slug, Accidental Discharge or Spill

In the event that a slug, accidental discharge or any spill occurs at the facility for which this permit is issued, it is the responsibility of the Permittee to immediately notify the B.S.A. Treatment Plant at 883-1820 of the quantity and character of such discharge. If requested by the B.S.A., within five (5) days following all such discharges, the Permittee shall submit a report describing the character and duration of the discharge, the cause of the discharge, and measures taken or that will be taken to prevent a recurrence of such discharge.

4. Noncompliance Notification

If, for any reason, the Permittee does not comply with or will be unable to comply with any discharge limitation specified in this permit, the Permittee or their assigns must verbally notify the Industrial Waste Section at 883-1820 within twenty-four (24) hours of becoming aware of the violation. The Permittee shall provide the Industrial Waste Section with the following information, in writing, within five (5) days of becoming aware of such condition:

- a. a description of the discharge and cause of noncompliance and;
- b. the period of noncompliance, including exact dates and times; or, if not corrected, the anticipated time the noncompliance is expected to continue, and steps being taken to reduce, eliminate and prevent recurrence of the noncomplying discharge.

5. Adverse Impact

The Permittee shall take all reasonable steps to minimize any adverse impact to the Buffalo and Town Sewerage System resulting from noncompliance with any discharge limitations specified in this permit, including such accelerated or additional monitoring as necessary to determine the nature and impact of the noncomplying discharge.

6. Waste Residuals

Solids, sludges, filter backwash or other pollutants removed in the course of treatment or control of wastewaters and/or the treatment of intake waters, shall be disposed of in a manner such as to prevent any pollutant from such materials from entering the Buffalo or Town Sewer System.

7. Power Failures

In order to maintain compliance with the discharge limitations and prohibitions of this permit, the Permittee shall provide an alternative power source sufficient to operate the wastewater control facilities; or, if such alternative power source is not provided the Permittee shall halt, reduce or otherwise control production and/or controlled discharges upon the loss of power to the wastewater control facilities.

8. Treatment Upsets

a. Any industrial user which experiences an upset in operations that places it in a temporary state of noncompliance, which is not the result of operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation, shall inform the Industrial Waste Section immediately upon becoming aware of the upset. Where such information is given verbally, a written report shall be filed by the user within five (5) days. The report shall contain:

- (i) A description of the upset, its cause(s) and impact on the discharger's compliance status.
- (ii) The duration of noncompliance, including exact dates and times of noncompliance, and if the noncompliance is continuing, the time by which compliance is reasonably expected to be restored
- (iii) All steps taken or planned to reduce, eliminate, and prevent recurrence of such an upset.

b. An industrial user which complies with the notification provisions of this Section in a timely manner shall have an affirmative defense to any enforcement action brought by the Industrial Waste Section/Town Engineer for any noncompliance of the limits in this permit, which arises out of violations attributable to and alleged to have occurred during the period of the documented and verified upset.

9. Treatment Bypasses

- a. A bypass of the treatment system is prohibited unless the following conditions are met:
 - (i) The bypass was unavoidable to prevent loss of life, personal injury, or severe property damage; or
 - (ii) There was no feasible alternative to the bypass, including the use of auxiliary treatment or retention of the wastewater; and
 - (iii) The industrial user properly notified the Industrial Waste Section as described in paragraph b. below.
- b. Industrial users must provide immediate notice to the Industrial Waste Section upon delivery of an unanticipated bypass. If necessary, the Industrial Waste Section may require the industrial user to submit a written report explaining the cause(s), nature, and duration of the bypass, and the steps being taken to prevent its recurrence.
- c. An industrial user may allow a bypass to occur which does not cause pretreatment standards or requirements to be violated, but only if it is for essential maintenance to ensure efficient operation of the treatment system. Industrial users anticipating a bypass must submit notice to the Industrial Waste Section at least ten (10) days in advance. The Industrial Waste Section may only approve the anticipated bypass if the circumstances satisfy those set forth in paragraph a. above.

C. PERMITTEE RESPONSIBILITIES

1. Permit Availability

The originally signed permit must be available upon request at all times for review at the address stated on the first page of this permit.

2. Inspections

The Permittee shall allow the representatives of the Buffalo Sewer Authority or Town of Cheektowaga upon the presentation of credentials and during normal working hours or at any other reasonable times, to have access to and copy any records required in this permit; and to sample any discharge of pollutants.

3. Transfer of Ownership or Control

In the event of any change in control or ownership of facilities for which this permit has been issued the permit shall become null and void. The succeeding owner shall submit a completed Town of Cheektowaga/ Buffalo Sewer Authority permit application prior to discharge to the sewer system.

D. PERMITTEE LIABILITIES

1. Permit Modification

After notice and opportunity for a hearing, this permit may be modified, suspended, or revoked in whole or in part during its term for cause including, but not limited to the following:

- a. Violation of any terms or conditions of this permit,
- b. Obtaining this permit by misrepresentation or failure to disclose fully all relevant facts,
- c. A change in any condition that requires either a temporary or permanent reduction or elimination of the authorized discharge.

2. Imminent Danger

In the event there exists an imminent danger to health or property, the permitter reserves the right to take immediate action to halt the permitted discharge to the sewerage works.

3. Civil and Criminal Liability

Nothing in this permit shall relieve the Permittee from any requirements, liabilities, or penalties under provisions of the Town of Cheektowaga Local Law No. 2, the "Sewer Regulations of the Buffalo Sewer Authority" or any Federal, State and/or local laws or regulations.

4. Penalties for Violations of Permit Conditions

The "Sewer Regulations of the Buffalo Sewer Authority" and Town of Cheektowaga Local Law No. 2, provide that any person who violates a B.P.D.E.S. permit condition is liable to the Authority and/or the Town for a civil penalty of up to \$10,000 per day for each violation. Any person who willfully or negligently violates permit conditions will be referred to the New York State Attorney General.

E. NATIONAL PRETREATMENT STANDARDS

If a pretreatment standard or prohibition (including any Schedule of Compliance specified in such pretreatment standard or prohibition) is established under Section 307 (b) of the Act for a pollutant which is present in the discharge and such standard or prohibition is more stringent than any limitation for such pollutant in this permit, this permit shall be revised or modified in accordance with such pretreatment standard or prohibition.

F. PLANT CLOSURE

In the event of plant closure, the Permittee is required to notify the Industrial Waste Section/Town Engineer in writing as soon as an anticipated closure date is determined, but in no case later than five (5) days of the actual closure.

G. CONFIDENTIALITY

Except for data determined to be confidential under Section 308 of the Act, all reports prepared in accordance with the terms of this permit shall be available for public inspection at the offices of the Buffalo Sewer Authority or Town Engineer of the Town of Cheektowaga. As required by the Act, effluent data shall not be considered confidential. Knowingly making any false statement on any such report may result in the imposition of criminal penalties as provided for in Section 309 of the Act.

H. SEVERABILITY

The provisions of this permit are severable, and if any provision of this permit, or the application of any provision of this permit to any circumstance, is held invalid, the application of such provision to other circumstances, and the remainder of this permit, shall not be affected thereby.

APPENDIX G

DISCHARGE REPORT SUMMARY TABLES

SAMPLING FIELD SHEET

URS

Client Name: <u>Pfohl Brothers Landfill</u>	
Address: <u>Aero Drive, Cheektowaga, NY</u>	
Contact: <u>Bill Pugh, P.E.</u>	Phone: <u>716-897-7288</u>
Installation:	
Sample Point: <u>SP-001</u>	
Sample Location: <u>Meter Chamber - ball valve on 6" HDPE forcemain</u>	
Date: <u>9/10/13</u>	Crew: <u>R. Murphy, K. McGovern, T. Ifkovich</u>
Weather: <u>89° F, Partly Cloudy</u>	
Sampling Device: <u>NA</u>	
Time of Installation: <u>13:55</u>	Type of Sample: <u>Composite</u>
Sample Interval: <u>NA</u>	Sample Volume: <u>NA</u>
Comments and Observations: <u>* WW-4 was running at the time of sample set-up.</u>	
<u>PLC display volumes: WW-01 (271,783 gals), WW-02 (-900 gals), WW-03 (24,193 gals),</u>	
<u>WW-04 (49,097 gals), WW-05 (829,770 gals), WW-06 (293,406 gals) & MH-25 (1,512,843 gals).</u>	
Date: <u>9/11/13</u> Crew: <u>R. Murphy, S. Moeller, T. Ifkovich</u>	
Weather: <u>90° F, Clear</u>	
Time of Collection: <u>14:30</u>	
Field Measurements:	
<u>14:35/RJM</u> (time/initial)	pH Calibration: Buffer 7- <u>7</u> Buffer 4- <u>4</u> Buffer 10- <u>10</u>
	pH Measurement: <u>7.5</u>
	Temperature: <u>23.4°C</u>
Identification: <u>EFF-091113</u>	
Physical Observations: _____	
Laboratory: <u>TestAmerica, Buffalo, NY</u>	
Comments: <u>No wells were running at the time of sample collection.</u>	
<u>PLC display volumes: WW-01 (271,783 gals), WW-02 (-901 gals), WW-03 (24,193 gals),</u>	
<u>WW-04 (49,204 gals), WW-05 (829,770 gals), WW-06 (293,590 gals) & MH-25 (1,513,063 gals).</u>	
Reviewed By: _____	Date: _____
(Supervisor)	

TABLE 1

**PFOHL BROTHERS LANDFILL - EFFLUENT MONITORING
ANALYTICAL RESULTS, TOTAL FLOW, AND MASS LOADINGS
SEPTEMBER 2013**

Sample ID	EFF-091113			
Matrix	Effluent Water			
Date Sampled	9/11/2013			
Parameter	Result	Mass Loading	Discharge Limitation	Violations
	(mg/L)	(lbs/day)	(lbs/day)	(Y/N)
Total Barium	0.58	0.001	2.34	No
Total Cadmuim	< ⁽¹⁾ 0.0005	< 0.000001	1.17	No
Total Chromium	0.0018	0.000003	1.17	No
Total Copper	0.069	0.0001	3.74	No
Total Lead	0.0083	0.00002	1.17	No
Total Nickel	0.0082	0.00002	3.27	No
Total Zinc	0.11	0.0002	5.84	No
Total Suspended Solids	68.9	NA	250 ⁽³⁾	No
pH ⁽⁴⁾	7.5	NA	5.0 - 12.0	No
Total Flow ⁽⁵⁾		220	140,100	No

Notes:

- (1) < = Compound not detected, method detection limit shown
 (2) NA = Not Applicable
 (3) Discharge Limitation in units of mg/L
 (4) pH measurement and Discharge Limitation in Standard Units
 (5) Total Flow reported in gallons, sample was collected over a 24 hour period

$$\text{Calculation: } \left(\frac{x \text{ mg}}{\text{L}} \right) \left(\frac{y \text{ gal}}{\text{day}} \right) \left(\frac{1 \text{ lb}}{453,600 \text{ mg}} \right) \left(\frac{3.785 \text{ L}}{\text{gal}} \right) = \frac{x \times y}{119,841} \frac{\text{lb}}{\text{day}}$$

SAMPLING FIELD SHEET



Client Name: Pfohl Brothers Landfill

Address: Aero Drive, Cheektowaga, NY

Contact: Bill Pugh, P.E. Phone: 716-897-7288

Installation:

Sample Point: SP-001

Sample Location: Meter Chamber - ball valve on 6" HDPE forcemain

Date: 12/10/13 Crew: R. Murphy, T. Urban, J. Boyd

Weather: 26° F, Partly Cloudy

Sampling Device: NA

Time of Installation: 11:00 Type of Sample: Composite

Sample Interval: NA Sample Volume: NA

Comments and Observations: No wells were running at the time of sample set-up.
PLC display volumes: WW-01 (979,172 gals), WW-02 (-20,625 gals), WW-03 (239,925 gals),
WW-04 (565,199 gals), WW-05 (1,956,638 gals), WW-06 (2,078,821 gals) & MH-25 (6,006,529 gals).

Date: 12/11/13 Crew: R. Murphy, T. Urban, J. Boyd

Weather: 28° F, Cloudy

Time of Collection: 11:00

Field Measurements:

11:05/RJM
(time/initial)

pH Calibration: Buffer 7- 7 Buffer 4- 4 Buffer 10- 10

pH Measurement: 7.67

Temperature: 10.5°C

Identification: EFF-121113

Physical Observations: _____

Laboratory: TestAmerica, Buffalo, NY

Comments: No wells were running at the time of sample collection.
PLC display volumes: WW-01 (979,172 gals), WW-02 (-20,625 gals), WW-03 (239,925 gals),
WW-04 (565,199 gals), WW-05 (1,969,785 gals), WW-06 (2,078,821 gals) & MH-25 (6,019,644 gals).

Reviewed By: _____ Date: _____
(Supervisor)

TABLE 1

**PFOHL BROTHERS LANDFILL - EFFLUENT MONITORING
ANALYTICAL RESULTS, TOTAL FLOW, AND MASS LOADINGS
DECEMBER 2013**

Sample ID	EFF-121113			
Matrix	Effluent Water			
Date Sampled	12/11/2013			
Parameter	Result	Mass Loading	Discharge Limitation	Violations
	(mg/L)	(lbs/day)	(lbs/day)	(Y/N)
Total Barium	0.17	0.02	2.34	No
Total Cadmuim	< ⁽¹⁾ 0.0005	< 0.00005	1.17	No
Total Chromium	< 0.0010	< 0.0001	1.17	No
Total Copper	0.016	0.002	3.74	No
Total Lead	< 0.003	< 0.0003	1.17	No
Total Nickel	0.0045	0.0005	3.27	No
Total Zinc	0.15	0.02	5.84	No
Total Suspended Solids	4.4	NA ⁽²⁾	250 ⁽³⁾	No
pH ⁽⁴⁾	7.67	NA	5.0 - 12.0	No
Total Flow ⁽⁵⁾		13,115	140,100	No

Notes:

- (1) < = Compound not detected, method detection limit shown
 (2) NA = Not Applicable
 (3) Discharge Limitation in units of mg/L
 (4) pH measurement and Discharge Limitation in Standard Units
 (5) Total Flow reported in gallons, sample was collected over a 24 hour period

$$\text{Calculation: } \left(\frac{x \text{ mg}}{\text{L}} \right) \left(\frac{y \text{ gal}}{\text{day}} \right) \left(\frac{1 \text{ lb}}{453,600 \text{ mg}} \right) \left(\frac{3.785 \text{ L}}{\text{gal}} \right) = \frac{x \times y}{119,841} \frac{\text{lb}}{\text{day}}$$

APPENDIX H

MONITORING WELL INSPECTION LOGS

WELL INSPECTION SUMMARY

Project Name: Pfohl Brothers Landfill

Project Number: 11175616.00000

Inspection Crew Members: R. Murphy, T. Urban

Supervisor: J. Sundquist

Date(s) of Inspection: November 13, 2013

<i>Well I.D. Number</i>	<i>Lock</i>	<i>Surface Seal</i>	<i>Protective Casing</i>	<i>Riser</i>	<i>Water Level (ft. BTOC)</i>	<i>Well Depth (ft. BTOC)</i>	<i>Other Comments</i>
GW-1S	OK	OK	OK	Bulged	3.24	14.94	
GW-1D	OK	OK	OK	Bulged	2.07	39.65	
GW-3S	OK	OK	OK	OK	2.68	13.22	
GW-3D	OK	OK	OK	OK	1.71	35.70	
GW-4S	OK	OK	OK	OK	4.16	16.23	
GW-4D	OK	OK	OK	OK	13.10	45.57	
GW-7S	OK	OK	OK	OK	4.13	35.04	
GW-7D	OK	OK	OK	Damaged	45.45	60.45	

Additional Comments:

WELL INSPECTION SUMMARY

Project Name: Pfohl Brothers Landfill Project Number: 11175616.00000

Inspection Crew Members: R. Murphy, T. Urban Supervisor: J. Sundquist

Date(s) of Inspection: November 13, 2013

<i>Well I.D. Number</i>	<i>Lock</i>	<i>Surface Seal</i>	<i>Protective Casing</i>	<i>Riser</i>	<i>Water Level (ft. BTOC)</i>	<i>Well Depth (ft. BTOC)</i>	<i>Other Comments</i>
GW-8SR	OK	OK	OK	OK	5.17	13.02	
GW-8D	OK	OK	OK	OK	5.65	36.54	
GW-26D	OK	OK	OK	OK	6.52	40.70	
GW-28S	OK	OK	OK	OK	8.30	15.52	
GW-29S	OK	OK	OK	OK	6.08	20.04	
GW-30S	OK	OK	OK	OK	7.30	17.97	
GW-31S	OK	OK	OK	OK	2.42	9.57	
GW-32S	OK	OK	OK	OK	2.30	9.93	

Additional Comments:

WELL INSPECTION SUMMARY

Project Name: Pfohl Brothers Landfill

Project Number: 11175616.00000

Inspection Crew Members: R. Murphy, T. Urban

Supervisor: J. Sundquist

Date(s) of Inspection: November 13, 2013

<i>Well I.D. Number</i>	<i>Lock</i>	<i>Surface Seal</i>	<i>Protective Casing</i>	<i>Riser</i>	<i>Water Level (ft. BTOC)</i>	<i>Well Depth (ft. BTOC)</i>	<i>Other Comments</i>
GW-33S	OK	OK	OK	OK	3.45	8.21	
GW-34S	OK	OK	OK	OK	2.61	10.01	
GW-35S	OK	OK	OK	OK	2.88	7.46	

Additional Comments:

ATTACHMENT C

IC/EC CERTIFICATION



Enclosure 2
NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION
Site Management Periodic Review Report Notice
Institutional and Engineering Controls Certification Form



Site Details

Box 1

Site No. 915043

Site Name Pfohl Brothers Landfill

Site Address: Aero Drive and Transit Road **Zip Code:** 14225

City/Town: Cheektowaga

County: Erie

Site Acreage: .94.0

Reporting Period: February 12, 2013 to February 12, 2014

- | | YES | NO |
|---|-------------------------------------|-------------------------------------|
| 1. Is the information above correct? | ☒ | ☐ |
| If NO, include handwritten above or on a separate sheet. | | |
| 2. Has some or all of the site property been sold, subdivided, merged, or undergone a tax map amendment during this Reporting Period? | ☐ | ☒ |
| 3. Has there been any change of use at the site during this Reporting Period (see 6NYCRR 375-1.11(d))? | ☐ | ☒ |
| 4. Have any federal, state, and/or local permits (e.g., building, discharge) been issued for or at the property during this Reporting Period? | ☐ | ☒ |
| If you answered YES to questions 2 thru 4, include documentation or evidence that documentation has been previously submitted with this certification form. | | |
| 5. Is the site currently undergoing development? | ☐ | ☒ |

Box 2

- | | YES | NO |
|--|-------------------------------------|--------------------------|
| 6. Is the current site use consistent with the use(s) listed below?
Closed Landfill | ☒ | ☐ |
| 7. Are all ICs/ECs in place and functioning as designed? | ☒ | ☐ |

**IF THE ANSWER TO EITHER QUESTION 6 OR 7 IS NO, sign and date below and
DO NOT COMPLETE THE REST OF THIS FORM. Otherwise continue.**

A Corrective Measures Work Plan must be submitted along with this form to address these issues.

Signature of Owner, Remedial Party or Designated Representative

Date

SITE NO. 915043

Box 3

Description of Institutional Controls

<u>Parcel</u>	<u>Owner</u>	<u>Institutional Control</u>
81.04-1-26	William A. Pfohl	Ground Water Use Restriction Soil Management Plan Landuse Restriction Building Use Restriction Surface Water Use Restriction

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

81.04-1-27 Paul Pfohl

Ground Water Use Restriction
Landuse Restriction

Building Use Restriction

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

81.04-1-28.1 Paul Pfohl

Ground Water Use Restriction
Landuse Restriction
Building Use Restriction

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

81.04-2-10.1 Paul Pfohl

Ground Water Use Restriction
Landuse Restriction
Building Use Restriction

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's

Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

81.04-2-11

Paul Pfohl

Ground Water Use Restriction.
Landuse Restriction
Building Use Restriction

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

81.04-2-9.1

Paul Pfohl

Ground Water Use Restriction.
Landuse Restriction
Building Use Restriction

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

82.03-4-10

Elizabeth L. McBride

Ground Water Use Restriction
Landuse Restriction
Building Use Restriction

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

82.03-4-11

Paul Pfohl

Ground Water Use Restriction
Landuse Restriction
Building Use Restriction

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the

following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

82.03-4-5

Paul Pfohl

Ground Water Use Restriction
Landuse Restriction
Building Use Restriction

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

82.03-4-6

Paul Pfohl

Ground Water Use Restriction
Landuse Restriction
Building Use Restriction

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

82.03-4-8

Paul Pfohl

Ground Water Use Restriction
Landuse Restriction
Building Use Restriction

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

- A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
- B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
- C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

82.03-4-9.11

Aero Land, Inc. c/o Jerome Hirsh

Ground Water Use Restriction
Landuse Restriction
Building Use Restriction

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
 B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
 C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

82.03-4-9.12

Stuart Jenkins

Ground Water Use Restriction
 Landuse Restriction
 Building Use Restriction

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
 B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
 C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

82.03-4-9.2

Aero Land, Inc. c/o Jerome Hirsh

Ground Water Use Restriction
 Landuse Restriction
 Building Use Restriction

In accordance with the Declaration of Covenants and Restrictions filed with the Erie County Clerk's Office on 4/25/03 and included as Appendix P in the Remedial Action Construction Report, Vol. II, the following Controls are in place:

A. Entire Site: i) Groundwater use prohibition, ii) Surface water use prohibition.
 B. Capped Area: i) Fencing, ii) No Excavation, iii) Planting trees/shrubs prohibited.
 C. Cleared Portion within the Perimeter Barrier System: i) Only Commercial/Industrial Development is allowed. Construction restrictions.

Box 4

Description of Engineering Controls

Parcel

Engineering Control

81.04-1-26

Vapor Mitigation
 Fencing/Access Control
 Cover System
 Leachate Collection

81.04-1-27

Cover System
 Leachate Collection
 Fencing/Access Control
 Vapor Mitigation

For Declaration of Covenants and Restrictions, see Appendix P in the Remedial Action Construction Report, Vol. II

81.04-1-28.1

Vapor Mitigation
 Cover System
 Leachate Collection
 Fencing/Access Control

For Declaration of Covenants and Restrictions, see Appendix P in the Remedial Action Construction Report, Vol. II

81.04-2-10.1

Vapor Mitigation
 Cover System

Parcel

Engineering Control

Leachate Collection
Fencing/Access Control

For Declaration of Covenants and Restrictions, see Appendix P in the Remedial Action Construction Report, Vol. II

81.04-2-11

Vapor Mitigation
Cover System
Leachate Collection
Fencing/Access Control

For Declaration of Covenants and Restrictions, see Appendix P in the Remedial Action Construction Report, Vol. II

81.04-2-9.1

Vapor Mitigation
Cover System
Leachate Collection
Fencing/Access Control

For Declaration of Covenants and Restrictions, see Appendix P in the Remedial Action Construction Report, Vol. II

82.03-4-10

Vapor Mitigation
Cover System
Leachate Collection
Fencing/Access Control

82.03-4-11

Vapor Mitigation
Cover System
Leachate Collection
Fencing/Access Control

For Declaration of Covenants and Restrictions, see Appendix P in the Remedial Action Construction Report, Vol. II

82.03-4-5

Vapor Mitigation
Cover System
Leachate Collection
Fencing/Access Control

For Declaration of Covenants and Restrictions, see Appendix P in the Remedial Action Construction Report, Vol. II

82.03-4-6

Vapor Mitigation
Cover System
Leachate Collection
Fencing/Access Control

For Declaration of Covenants and Restrictions, see Appendix P in the Remedial Action Construction Report, Vol. II

82.03-4-8

Vapor Mitigation
Cover System
Leachate Collection
Fencing/Access Control

For Declaration of Covenants and Restrictions, see Appendix P in the Remedial Action Construction Report, Vol. II

82.03-4-9.11

Vapor Mitigation
Cover System
Leachate Collection
Fencing/Access Control

For Declaration of Covenants and Restrictions, see Appendix P in the Remedial Action Construction Report, Vol. II

82.03-4-9.12

Vapor Mitigation

Parcel

Engineering Control

Cover System

Leachate Collection

Fencing/Access Control

For Declaration of Covenants and Restrictions, see Appendix P in the Remedial Action Construction Report, Vol. II

82.03-4-9.2

Vapor Mitigation

Cover System

Leachate Collection

Fencing/Access Control

For Declaration of Covenants and Restrictions, see Appendix P in the Remedial Action Construction Report, Vol. II

Periodic Review Report (PRR) Certification Statements

1. I certify by checking "YES" below that:

a) the Periodic Review report and all attachments were prepared under the direction of, and reviewed by, the party making the certification;

b) to the best of my knowledge and belief, the work and conclusions described in this certification are in accordance with the requirements of the site remedial program, and generally accepted engineering practices; and the information presented is accurate and complete.

YES NO

☒ ☐

2. If this site has an IC/EC Plan (or equivalent as required in the Decision Document), for each Institutional or Engineering control listed in Boxes 3 and/or 4, I certify by checking "YES" below that all of the following statements are true:

(a) the Institutional Control and/or Engineering Control(s) employed at this site is unchanged since the date that the Control was put in-place, or was last approved by the Department;

(b) nothing has occurred that would impair the ability of such Control, to protect public health and the environment;

(c) access to the site will continue to be provided to the Department, to evaluate the remedy, including access to evaluate the continued maintenance of this Control;

(d) nothing has occurred that would constitute a violation or failure to comply with the Site Management Plan for this Control; and

(e) if a financial assurance mechanism is required by the oversight document for the site, the mechanism remains valid and sufficient for its intended purpose established in the document.

YES NO

☒ ☐

**IF THE ANSWER TO QUESTION 2 IS NO, sign and date below and
DO NOT COMPLETE THE REST OF THIS FORM. Otherwise continue.**

A Corrective Measures Work Plan must be submitted along with this form to address these issues.

Signature of Owner, Remedial Party or Designated Representative

Date

IC CERTIFICATIONS
SITE NO. 915043

Box 6

O&M Manager

SITE OWNER OR DESIGNATED REPRESENTATIVE SIGNATURE

I certify that all information and statements in Boxes 1, 2, and 3 are true. I understand that a false statement made herein is punishable as a Class "A" misdemeanor, pursuant to Section 210.45 of the Penal Law.

I William R. Pugh, P.E. at Town of Cheektowaga
275 Alexander Ave, Cheektowaga, NY 14211
print name print business address

am certifying as Site O&M Manager (Owner or Remedial Party)

for the Site named in the Site Details Section of this form.

W. R. Pugh
Signature of Owner, Remedial Party, or Designated Representative
Rendering Certification Site O&M Manager

2/10/14
Date

IC/EC CERTIFICATIONS


Box 7

Professional Engineer Signature

I certify that all information in Boxes 4 and 5 are true. I understand that a false statement made herein is punishable as a Class "A" misdemeanor, pursuant to Section 210.45 of the Penal Law.

I, William R. Pugh, P.E. at Town of Cheektowaga
275 Alexander Ave, Cheektowaga, NY 14211
print name print business address

am certifying as a Professional Engineer for the Town of Cheektowaga
(Owner or Remedial Party)
Site O&M Provider/Manager

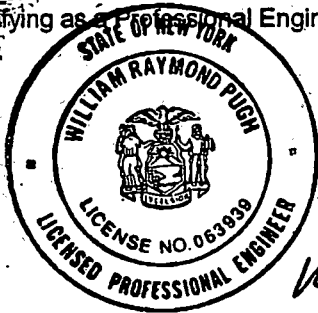

W-R. Pugh

Signature of Professional Engineer, for the ~~Owner or~~
~~Remedial Party~~, Rendering Certification
Site O&M Provider/Manager

Stamp
(Required for PE)

2/10/14
Date