



December 13, 2021
OP-4376

Erie County Department of Environment and Planning
Division of Sewerage Management
Erie County Sewer District #6
260 Lehigh Avenue
Lackawanna, New York 14218

Attn: Laura Surdej
Industrial Wastewater Specialist

Subject: Quarterly Discharge Monitoring Report Submittal
(4th Quarter: October to December 2021)
Union Road Site, 333 Losson Road, Cheektowaga, Erie County, NY
Inactive Hazardous Waste Disposal Site No. 915128

Ref: Authorization to Discharge Under Erie County/Buffalo Pollutant
Discharge Elimination System, Permit Number 19-08-E1016

Dear Ms. Surdej:

As required by Part I, Section B of the referenced permit, Unicorn Management Consultants, LLC (UMC) is submitting the Quarterly Discharge Monitoring Report (4th Quarter: October to December 2021) for the subject site.

The information required for the Discharge Monitoring Report from the subject site is enclosed as follows:

- A summary of analyses with laboratory data which includes date, time, and method used for each analysis;
- Chain of Custody forms;
- Daily Sampling Activity Sheets;
- Analysis Summary Table;
- Quantity of water discharged to the sanitary sewer for the 4th Quarter 2021;
- Conversion of mg/l to lbs/gal for wastewater discharge mass calculations;
- Map indicating the location of the sampling point (Figure 1);
- Certification from the NYS Department of Health for ALS Group USA Corp. dba ALS Environmental (Formerly Columbia Analytical Services, Inc.); and
- A copy of the certification letter, dated May 25, 1995, from American Premier Underwriters, Inc. which authorizes Unicorn Management Consultants, to collect samples and prepare the monitoring reports for the referenced permit.

Ms. Surdej
OP-4376
Page 2



I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the systems, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violation.

If you should have any questions or comments, please do not hesitate to call me at 203-205-9000, ext. 13.

Sincerely,
Unicorn Management Consultants, LLC

Michael O'Connor
Manager of Environmental Projects
Union Road Remediation Project

Enclosures

cc: A. Alagna
M. Kuzcka (electronic copy only)
D. Skaros (electronic copy only)
C. Staniszewski (electronic copy only)
M. Hill, Esq. (electronic copy only)
L. Lackner (electronic copy only)



December 01, 2021

Service Request No:R2112279

Mr. Michael Persico
Unicorn Management Consultants
52 Federal Road
Suite 2C
Danbury, CT 06810

Laboratory Results for: Union Road

Dear Mr.Persico,

Enclosed are the results of the sample(s) submitted to our laboratory November 19, 2021
For your reference, these analyses have been assigned our service request number **R2112279**.

All testing was performed according to our laboratory's quality assurance program and met the requirements of the TNI standards except as noted in the case narrative report. Any testing not included in the lab's accreditation is identified on a Non-Certified Analytes report. All results are intended to be considered in their entirety. ALS Environmental is not responsible for use of less than the complete report. Results apply only to the individual samples submitted to the lab for analysis, as listed in the report. The measurement uncertainty of the results included in this report is within that expected when using the prescribed method(s), and represented by Laboratory Control Sample control limits. Any events, such as QC failures or Holding Time exceedances, which may add to the uncertainty are explained in the report narrative or are flagged with qualifiers. The flags are explained in the Report Qualifiers and Definitions page of this report.

Please contact me if you have any questions. My extension is 7475. You may also contact me via email at Meghan.Pedro@alsglobal.com.

Respectfully submitted,

ALS Group USA, Corp. dba ALS Environmental

Meghan Pedro
Project Manager

ADDRESS 1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
PHONE +1 585 288 5380 | **FAX** +1 585 288 8475
ALS Group USA, Corp.
dba ALS Environmental



Narrative Documents

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com



Client: Unicorn Management Consultants
Project: Union Road
Sample Matrix: Water

Service Request: R2112279
Date Received: 11/19/2021

CASE NARRATIVE

All analyses were performed consistent with the quality assurance program of ALS Environmental. This report contains analytical results for samples for the Tier II level requested by the client.

Sample Receipt:

One water sample was received for analysis at ALS Environmental on 11/19/2021. Any discrepancies upon initial sample inspection are annotated on the sample receipt and preservation form included within this report. The samples were stored at minimum in accordance with the analytical method requirements.

Metals:

No significant anomalies were noted with this analysis.

General Chemistry:

No significant anomalies were noted with this analysis.

A handwritten signature in black ink that reads 'Meghan Pedro'.

Approved by _____

Date 12/01/2021



SAMPLE DETECTION SUMMARY

CLIENT ID: 4Q21 Effluent **Lab ID: R2112279-001**

Analyte	Results	Flag	MDL	MRL	Units	Method
Solids, Total Suspended (TSS)	1.2			1.0	mg/L	SM 2540 D-1997 (2011)



Sample Receipt Information

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com

Client: Unicorn Management Consultants
Project: Union Road/2011-100

Service Request:R2112279

SAMPLE CROSS-REFERENCE

<u>SAMPLE #</u>	<u>CLIENT SAMPLE ID</u>	<u>DATE</u>	<u>TIME</u>
R2112279-001	4Q21 Effluent	11/18/2021	1623



CHAIN OF CUSTODY/LABORATORY ANALYSIS REQUEST FORM 061843

1565 Jefferson Road, Building 300, Suite 360 • Rochester, NY 14623 | +1 585 288 5380 +1 585 288 8475 (fax) PAGE 1 OF 1

Project Name Union Road		Project Number 2011-100		ANALYSIS REQUESTED (Include Method Number and Container Preservative)															
Project Manager Mike Persico		Report CC Frojo + mawry @unicornmt.com		PRESERVATIVE															
Company/Address Unicorn Management Consultants, LLC 52 Federal Road, Suite 2C Danbury, CT 06810		NUMBER OF CONTAINERS	GC/MS VOAs • 8260 • 824 • CLP	GC/MS SVOAs • 8270 • 825	GC VOAs • 8021 • 801/802	PESTICIDES • 8081 • 808	PCBs • 8082 • 808	METALS, TOTAL (List in comments below)	METALS, DISSOLVED (List in comments below)	Total Phosphate 155	Total Nitrate 4204 Phosph Total Pb	3	03	2	Preservative Key 0. NONE 1. HCL 2. HNO3 3. H2SO4 4. NaOH 5. Zn. Acetate 6. MeOH 7. NaHSO4 8. Other _____				
Phone # 203-205-9000																Email mpersico@unicornmt.com		REMARKS/ ALTERNATE DESCRIPTION	
Sampler's Signature [Signature]																Sampler's Printed Name Ryan Mawry			
CLIENT SAMPLE ID 4021 Effluent																FOR OFFICE USE ONLY LAB ID	DATE 11/18/21	TIME 1623	MATRIX AQ
SPECIAL INSTRUCTIONS/COMMENTS Metals Total lead - Not filtered in field				TURNAROUND REQUIREMENTS RUSH (SURCHARGES APPLY) 1 day ____ 2 day ____ 3 day ____ 4 day ____ 5 day ____ <input checked="" type="checkbox"/> Standard (10 business days-No Surcharge) REQUESTED REPORT DATE _____				REPORT REQUIREMENTS I. Results Only <input checked="" type="checkbox"/> II. Results + QC Summaries (LCS, DUP, MS/MSD as required) III. Results + QC and Calibration Summaries IV. Data Validation Report with Raw Data NYSDEC Form 1 Edata <input checked="" type="checkbox"/> Yes ____ No				INVOICE INFORMATION PO: 2011-100 BILL TO: Isabel Miller imiller@unicornmt.com							
STATE WHERE SAMPLES WERE COLLECTED NY				RELINQUISHED BY				RECEIVED BY				RELINQUISHED BY				RECEIVED BY			
Signature [Signature]		Signature [Signature]		Signature		Signature		Signature		Signature		Signature		Signature					
Printed Name Ryan Mawry		Printed Name [Name]		Printed Name		Printed Name		Printed Name		Printed Name		Printed Name		Printed Name					
Firm VMC		Firm [Firm]		Firm		Firm		Firm		Firm		Firm		Firm					
Date/Time 11/18/21 0831		Date/Time 11/19/21 0831		Date/Time		Date/Time		Date/Time		Date/Time		Date/Time		Date/Time					

R2112279 5
Unicorn Management Consultants
Union Road



Cooler Receipt and Preservation Check Form

R2112279 5
Unicorn Management Consultants
Unlon Road



Project/Client Unicorn Folder Number _____

Cooler received on 11/19/21 by: ⓐ COURIER: ALS UPS FEDEX VELOCITY CLIENT

1	Were Custody seals on outside of cooler?	Y <input checked="" type="checkbox"/> N <input type="checkbox"/>
2	Custody papers properly completed (ink, signed)?	Y <input checked="" type="checkbox"/> N <input type="checkbox"/>
3	Did all bottles arrive in good condition (unbroken)?	Y <input checked="" type="checkbox"/> N <input type="checkbox"/>
4	Circle: <u>Wet Ice</u> Dry Ice Gel packs present?	Y <input checked="" type="checkbox"/> N <input type="checkbox"/>

5a	Perchlorate samples have required headspace?	Y <input type="checkbox"/> N <input checked="" type="checkbox"/> NA <input type="checkbox"/>
5b	Did VOA vials, Alk, or Sulfide have sig* bubbles?	Y <input type="checkbox"/> N <input checked="" type="checkbox"/> NA <input type="checkbox"/>
6	Where did the bottles originate?	<u>ALS/ROC</u> CLIENT
7	Soil VOA received as: Bulk Encore 5035set	<u>NA</u>

8. Temperature Readings Date: 11/19/21 Time: 0915 ID: IR#7 IR#N From: Temp Blank Sample Bottle

Observed Temp (°C)	<u>1.5</u>							
Within 0-6°C?	Y <input checked="" type="checkbox"/> N <input type="checkbox"/>	Y <input type="checkbox"/> N <input type="checkbox"/>						
If <0°C, were samples frozen?	Y <input type="checkbox"/> N <input type="checkbox"/>	Y <input type="checkbox"/> N <input type="checkbox"/>	Y <input type="checkbox"/> N <input type="checkbox"/>	Y <input type="checkbox"/> N <input type="checkbox"/>	Y <input type="checkbox"/> N <input type="checkbox"/>	Y <input type="checkbox"/> N <input type="checkbox"/>	Y <input type="checkbox"/> N <input type="checkbox"/>	Y <input type="checkbox"/> N <input type="checkbox"/>

If out of Temperature, note packing/ice condition: _____ Ice melted Poorly Packed (described below) Same Day Rule
& Client Approval to Run Samples: _____ Standing Approval Client aware at drop-off Client notified by: _____

All samples held in storage location: Room by e on 11/19/21 at 0916
5035 samples placed in storage location: _____ by _____ on _____ at _____ within 48 hours of sampling? Y N

Cooler Breakdown/Preservation Check**: Date: 11/19/21 Time: 1618 by: ⓐ

- 9. Were all bottle labels complete (i.e. analysis, preservation, etc.)? YES NO
- 10. Did all bottle labels and tags agree with custody papers? YES NO
- 11. Were correct containers used for the tests indicated? YES NO
- 12. Were 5035 vials acceptable (no extra labels, not leaking)? YES NO
- 13. Air Samples: Cassettes / Tubes Intact Y/N with MS Y/N Canisters Pressurized Tedlar® Bags Inflated N/A

pH	Lot of test paper	Reagent	Preserved?		Lot Received	Exp	Sample ID Adjusted	Vol. Added	Lot Added	Final pH
			Yes	No						
≥12		NaOH								
≤2	<u>205370</u>	HNO ₃	<input checked="" type="checkbox"/>		<u>1121061</u>					
≤2		H ₂ SO ₄	<input checked="" type="checkbox"/>		<u>220021</u>	<u>10/21</u>				
<4		NaHSO ₄								
5-9		For 608pest			No=Notify for 3day					
Residual Chlorine (-)		For CN, Phenol, 625, 608pest, 522			If +, contact PM to add Na ₂ S ₂ O ₃ (625, 608, CN), ascorbic (phenol).					
		Na ₂ S ₂ O ₃								
		ZnAcetate	-	-						
		HCl	**	**						

**VOAs and 1664 Not to be tested before analysis. Otherwise, all bottles of all samples with chemical preservatives are checked (not just representatives).

Bottle lot numbers: 21-10-20, 76626-02742, 80901-09
Explain all Discrepancies/ Other Comments: _____

HPROD	BULK
HTR	FLDT
SUB	HGFB
ALS	LL3541

Labels secondary reviewed by: ⓐ
PC Secondary Review: _____

*significant air bubbles: VOA > 5-6 mm : WC > 1 in. diameter



Miscellaneous Forms

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com

REPORT QUALIFIERS AND DEFINITIONS

<p>U Analyte was analyzed for but not detected. The sample quantitation limit has been corrected for dilution and for percent moisture, unless otherwise noted in the case narrative.</p> <p>J Estimated value due to either being a Tentatively Identified Compound (TIC) or that the concentration is between the MRL and the MDL. Concentrations are not verified within the linear range of the calibration. For DoD: concentration >40% difference between two GC columns (pesticides/Aroclors).</p> <p>B Analyte was also detected in the associated method blank at a concentration that may have contributed to the sample result.</p> <p>E Inorganics- Concentration is estimated due to the serial dilution was outside control limits.</p> <p>E Organics- Concentration has exceeded the calibration range for that specific analysis.</p> <p>D Concentration is a result of a dilution, typically a secondary analysis of the sample due to exceeding the calibration range or that a surrogate has been diluted out of the sample and cannot be assessed.</p> <p>* Indicates that a quality control parameter has exceeded laboratory limits. Under the “Notes” column of the Form I, this qualifier denotes analysis was performed out of Holding Time.</p> <p>H Analysis was performed out of hold time for tests that have an “immediate” hold time criteria.</p> <p># Spike was diluted out.</p>	<p>+ Correlation coefficient for MSA is <0.995.</p> <p>N Inorganics- Matrix spike recovery was outside laboratory limits.</p> <p>N Organics- Presumptive evidence of a compound (reported as a TIC) based on the MS library search.</p> <p>S Concentration has been determined using Method of Standard Additions (MSA).</p> <p>W Post-Digestion Spike recovery is outside control limits and the sample absorbance is <50% of the spike absorbance.</p> <p>P Concentration >40% difference between the two GC columns.</p> <p>C Confirmed by GC/MS</p> <p>Q DoD reports: indicates a pesticide/Aroclor is not confirmed ($\geq 100\%$ Difference between two GC columns).</p> <p>X See Case Narrative for discussion.</p> <p>MRL Method Reporting Limit. Also known as:</p> <p>LOQ Limit of Quantitation (LOQ) The lowest concentration at which the method analyte may be reliably quantified under the method conditions.</p> <p>MDL Method Detection Limit. A statistical value derived from a study designed to provide the lowest concentration that will be detected 99% of the time. Values between the MDL and MRL are estimated (see J qualifier).</p> <p>LOD Limit of Detection. A value at or above the MDL which has been verified to be detectable.</p> <p>ND Non-Detect. Analyte was not detected at the concentration listed. Same as U qualifier.</p>
---	--

Rochester Lab ID # for State Accreditations¹



NELAP States
Florida ID # E87674
New Hampshire ID # 2941
New York ID # 10145
Pennsylvania ID# 68-786
Virginia #460167

Non-NELAP States
Connecticut ID #PH0556
Delaware Approved
Maine ID #NY01587
North Carolina #36701
North Carolina #676
Rhode Island LAO00333

¹ Analyses were performed according to our laboratory’s NELAP-approved quality assurance program and any applicable state or agency requirements. The test results meet requirements of the current NELAP/TNI standards or state or agency requirements, where applicable, except as noted in the case narrative. Since not all analyte/method/matrix combinations are offered for state/NELAC accreditation, this report may contain results which are not accredited. For a specific list of accredited analytes, contact the laboratory or go to <https://www.alsglobal.com/locations/americas/north-america/usa/new-york/rochester-environmental>

ALS Laboratory Group

Acronyms

ASTM	American Society for Testing and Materials
A2LA	American Association for Laboratory Accreditation
CARB	California Air Resources Board
CAS Number	Chemical Abstract Service registry Number
CFC	Chlorofluorocarbon
CFU	Colony-Forming Unit
DEC	Department of Environmental Conservation
DEQ	Department of Environmental Quality
DHS	Department of Health Services
DOE	Department of Ecology
DOH	Department of Health
EPA	U. S. Environmental Protection Agency
ELAP	Environmental Laboratory Accreditation Program
GC	Gas Chromatography
GC/MS	Gas Chromatography/Mass Spectrometry
LUFT	Leaking Underground Fuel Tank
M	Modified
MCL	Maximum Contaminant Level is the highest permissible concentration of a substance allowed in drinking water as established by the USEPA.
MDL	Method Detection Limit
MPN	Most Probable Number
MRL	Method Reporting Limit
NA	Not Applicable
NC	Not Calculated
NCASI	National Council of the Paper Industry for Air and Stream Improvement
ND	Not Detected
NIOSH	National Institute for Occupational Safety and Health
PQL	Practical Quantitation Limit
RCRA	Resource Conservation and Recovery Act
SIM	Selected Ion Monitoring
TPH	Total Petroleum Hydrocarbons
tr	Trace level is the concentration of an analyte that is less than the PQL but greater than or equal to the MDL.

ALS Group USA, Corp.

dba ALS Environmental

Analyst Summary report

Client: Unicorn Management Consultants
Project: Union Road/2011-100

Service Request: R2112279

Sample Name: 4Q21 Effluent
Lab Code: R2112279-001
Sample Matrix: Water

Date Collected: 11/18/21
Date Received: 11/19/21

Analysis Method

1664B
420.4
6010C
SM 2540 D-1997(2011)

Extracted/Digested By

BDIAMOND

Analyzed By

STALARICO
BBOWE
KMCLAEN
KAWONG



INORGANIC PREPARATION METHODS

The preparation methods associated with this report are found in these tables unless discussed in the case narrative.

Water/Liquid Matrix

Analytical Method	Preparation Method
200.7	200.2
200.8	200.2
6010C	3005A/3010A
6020A	ILM05.3
9034 Sulfide Acid Soluble	9030B
SM 4500-CN-E Residual Cyanide	SM 4500-CN-G
SM 4500-CN-E WAD Cyanide	SM 4500-CN-I

Solid/Soil/Non-Aqueous Matrix

Analytical Method	Preparation Method
6010C	3050B
6020A	3050B
6010C TCLP (1311) extract	3005A/3010A
6010 SPLP (1312) extract	3005A/3010A
7199	3060A
300.0 Anions/ 350.1/ 353.2/ SM 2320B/ SM 5210B/ 9056A Anions	DI extraction
For analytical methods not listed, the preparation method is the same as the analytical method reference.	



Sample Results

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com



Metals

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Unicorn Management Consultants
Project: Union Road/2011-100
Sample Matrix: Water
Sample Name: 4Q21 Effluent
Lab Code: R2112279-001

Service Request: R2112279
Date Collected: 11/18/21 16:23
Date Received: 11/19/21 08:31
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Date Extracted	Q
Lead, Total	6010C	ND U	mg/L	0.0050	1	11/25/21 00:54	11/22/21	



General Chemistry

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Unicorn Management Consultants
Project: Union Road/2011-100
Sample Matrix: Water
Sample Name: 4Q21 Effluent
Lab Code: R2112279-001

Service Request: R2112279
Date Collected: 11/18/21 16:23
Date Received: 11/19/21 08:31
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Oil and Grease, Total (HEM)	1664B	ND U	mg/L	4.8	1	11/23/21 09:30	
Phenolics, Total Recoverable	420.4	ND U	mg/L	0.0050	1	11/22/21 15:15	
Solids, Total Suspended (TSS)	SM 2540 D-1997(2011)	1.2	mg/L	1.0	1	11/21/21 09:45	



QC Summary Forms

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com



Metals

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Unicorn Management Consultants
Project: Union Road/2011-100
Sample Matrix: Water
Sample Name: Method Blank
Lab Code: R2112279-MB

Service Request: R2112279
Date Collected: NA
Date Received: NA
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Date Extracted	Q
Lead, Total	6010C	ND U	mg/L	0.0050	1	11/24/21 23:29	11/22/21	

ALS Group USA, Corp.
dba ALS Environmental

QA/QC Report

Client: Unicorn Management Consultants
Project: Union Road/2011-100
Sample Matrix: Water

Service Request: R2112279
Date Analyzed: 11/24/21

Duplicate Lab Control Sample Summary
Inorganic Parameters

Units:mg/L
Basis:NA

Analyte Name	Analytical Method	Result	Lab Control Sample R2112279-LCS			Duplicate Lab Control Sample R2112279-DLCS			RPD	RPD Limit
			Spike Amount	% Rec	Result	Spike Amount	% Rec	% Rec Limits		
Lead, Total	6010C	0.504	0.500	101	0.509	0.500	102	80-120	1	20



General Chemistry

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Unicorn Management Consultants
Project: Union Road/2011-100
Sample Matrix: Water
Sample Name: Method Blank
Lab Code: R2112279-MB

Service Request: R2112279
Date Collected: NA
Date Received: NA
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Oil and Grease, Total (HEM)	1664B	ND U	mg/L	5.0	1	11/23/21 09:30	
Phenolics, Total Recoverable	420.4	ND U	mg/L	0.0050	1	11/22/21 13:07	
Solids, Total Suspended (TSS)	SM 2540 D-1997(2011)	ND U	mg/L	1.0	1	11/21/21 09:45	

ALS Group USA, Corp.
dba ALS Environmental

QA/QC Report

Client: Unicorn Management Consultants
Project: Union Road/2011-100
Sample Matrix: Water

Service Request: R2112279
Date Analyzed: 11/21/21 - 11/22/21

Lab Control Sample Summary
General Chemistry Parameters

Units:mg/L
Basis:NA

Lab Control Sample
R2112279-LCS2

Analyte Name	Analytical Method	Result	Spike Amount	% Rec	% Rec Limits
Phenolics, Total Recoverable	420.4	0.0392	0.0400	98	90-110
Solids, Total Suspended (TSS)	SM 2540 D-1997(2011)	206	214	96	80-120

ALS Group USA, Corp.
dba ALS Environmental

QA/QC Report

Client: Unicorn Management Consultants
Project: Union Road/2011-100
Sample Matrix: Water

Service Request: R2112279
Date Analyzed: 11/23/21

Duplicate Lab Control Sample Summary
General Chemistry Parameters

Units:mg/L
Basis:NA

Analyte Name	Analytical Method	Result	Lab Control Sample R2112279-LCS1		Duplicate Lab Control Sample R2112279-DLCS1		% Rec Limits	RPD	RPD Limit	
			Spike Amount	% Rec	Result	Spike Amount				% Rec
Oil and Grease, Total (HEM)	1664B	34.2	41.0	84	34.4	40.8	84	78-114	<1	18



Summary of Sampling Activity

A. Sample Point: Discharge pipe in wet well

B. Date: November 18, 2021

C. Time, temperature, and pH of samples:
(Pump started at 1538)

First Sample:	1553	51.44 °F	7.30 pH
Second Sample:	1608	50.90 °F	7.68 pH
Third Sample:	1623	50.00 °F	7.76 pH

(Pump stopped at 1638)

Total run time: 60-Minutes

D. Total water consumption during sampling period:

Meter reading at start:	2745499-gallons*
Meter reading at stop:	2745499-gallons*

Flow for the 60-minutes is 1320-gallons*.

*The ultrasonic flow meter did not update the total number of gallons pumped during the 4Q21 discharge sampling. Total flow for sampling period was estimated by multiplying the runtime by 22 gallons per minute.

E. Physical observations (sight, smell, etc.) of the discharge during sample effort: Water is clear and odorless throughout the sampling effort.

F. Weather conditions during entire sampling period: Cloudy, ~45 °F

G. Miscellaneous notes: None

H. UMC Field tech: Ryan Mowrey



**ANALYSIS SUMMARY TABLE
QUARTERLY
DISCHARGE SAMPLING EVENT**

November 18, 2021

DATE	Composite TIME	Ave. Temp °F	ANALYTES			PHENOLS	LEAD	FLOW
			Average pH	TSS	Total Extractable Hydrocarbons			
BSA LIMITS			5 TO 12	250 mg/L	100 mg/L	20 mg/L	65 mg/L	NONE
						0.25 LBS	0.83 LBS	
11/18/2021	1538 to 1638	50.78	7.58	1.2	ND	ND	ND	1,320
MASS FOR SAMPLE VOLUME						0.000	0.000	

MASS is reported in pounds
concentrations are reported in mg/L

FLOW is reported in gallons
ND = analyte was not detected

NOTE: If analyte was not detected, the detection limit was used to calculate mass loading (reported in pounds)

Detection Limital Suspended Solids = 1.00 mg/L
 Total Extractable Hydrocarbons = 4.80 mg/L
 Total Phenols = 0.005 mg/L
 Total Lead = 0.005 mg/L



2021 Discharge Summary

Quarter	Date	Total Gallons Pumped (Totalizer)	Gallons Pumped per Quarter
1Q21	2/22/21	2,750,907*	17,314*
2Q21	5/18/21	2,766,813*	15,906*
3Q21	8/18/21	2,783,753*	16,940*
4Q21	11/18/21	2,804,565*	20,812*
		Yearly Total Gallons	70,972*

*Estimated based on alarm times due to issue with ultrasonic flow meter during 1Q21, 2Q21, 3Q21, and 4Q21 discharge sampling. See tables below.

1Q21		
Date/Time	Run Time (minutes)	Estimated Discharge (gallons)
11/17/20 06:45 PM	40	880
11/17/20 07:25 PM		
12/01/20 03:36 AM	69	1518
12/01/20 04:45 AM		
12/14/20 12:20 PM	88	1936
12/14/20 01:48 PM		
12/27/20 09:03 PM	96	2112
12/27/20 10:39 PM		
01/10/21 05:48 AM	108	2376
01/10/21 07:36 AM		
01/23/21 02:34 PM	112	2464
01/23/21 04:26 PM		
02/05/21 11:17 PM	111	2442
02/06/21 01:08 AM		
02/19/21 07:59 AM	103	2266
02/19/21 09:42 AM		
02/22/21 05:03 PM	60	1320
02/22/21 06:03 PM		
Total		17314



2021 Discharge Summary

2Q21		
Date/Time	Run Time (minutes)	Estimated Discharge (gallons)
03/04/21 04:43 PM	75	1650
03/04/21 05:58 PM		
03/18/21 03:10 AM	58	1276
03/18/21 04:08 AM		
03/29/21 06:06 PM	61	1342
03/29/21 07:07 PM		
03/31/21 11:05 AM	66	1452
03/31/21 12:11 PM		
04/13/21 07:46 PM	110	2420
04/13/21 09:36 PM		
04/27/21 04:27 PM	120	2640
04/27/21 06:27 PM		
05/10/21 01:09 PM	130	2860
05/10/21 03:19 PM		
05/17/21 04:38 PM	4	88
05/17/21 04:42 PM		
05/18/21 08:46 AM	71	1562
05/18/21 09:57 AM		
05/18/21 01:16 PM	28	616
05/18/21 01:44 PM		
	Total	15906



2021 Discharge Summary

3Q21		
Date/Time	Run Time (minutes)	Estimated Discharge (gallons)
05/20/21 06:16 PM		
05/20/21 06:55 PM	39	858
05/23/21 09:51 PM		
05/23/21 10:55 PM	64	1408
06/06/21 06:33 AM		
06/06/21 08:12 AM	99	2178
06/19/21 03:15 PM		
06/19/21 04:58 PM	103	2266
07/02/21 11:58 PM		
07/03/21 01:38 AM	100	2200
07/16/21 08:43 AM		
07/16/21 10:21 AM	98	2156
07/29/21 05:29 PM		
07/29/21 07:03 PM	94	2068
08/12/21 02:12 AM		
08/12/21 03:41 AM	89	1958
08/15/21 04:03 AM		
08/15/21 04:42 AM	39	858
08/18/21 07:25 AM		
08/18/21 08:10 AM	45	990
	Total	16940



2021 Discharge Summary


4Q21		
Date/Time	Run Time (minutes)	Estimated Discharge (gallons)
08/28/21 12:48 PM	52	1144
08/28/21 01:40 PM		
09/10/21 09:32 PM	69	1518
09/10/21 10:41 PM		
09/17/21 11:57 PM	49	1078
09/18/21 12:46 AM		
09/18/21 05:03 AM	6	132
09/18/21 05:09 AM		
10/01/21 01:47 PM	68	1496
10/01/21 02:55 PM		
10/14/21 10:32 PM	83	1826
10/14/21 11:55 PM		
10/28/21 07:18 AM	98	2156
10/28/21 08:56 AM		
11/10/21 03:03 PM	117	2574
11/10/21 05:00 PM		
11/18/21 03:36 AM	60	1320
11/18/21 04:36 AM		
11/22/21 01:35 AM	71	1562
11/22/21 02:46 AM		
12/02/21 06:06 PM	111	2442
12/02/21 07:57 PM		
12/06/21 02:48 PM	57	1254
12/06/21 03:45 PM		
12/11/21 03:00 PM	105	2310
12/11/21 04:45 PM		
	Total	20812




Conversion Formula

Conversion of mg/L to lbs/gal for Wastewater Discharge:

$$\frac{1mg}{L} * \frac{1g}{1000mg} * \frac{1Kg}{1000g} * \frac{2.205lbs}{1Kg} * \frac{3.78L}{1gal} = \frac{1lb}{119.977gal}$$

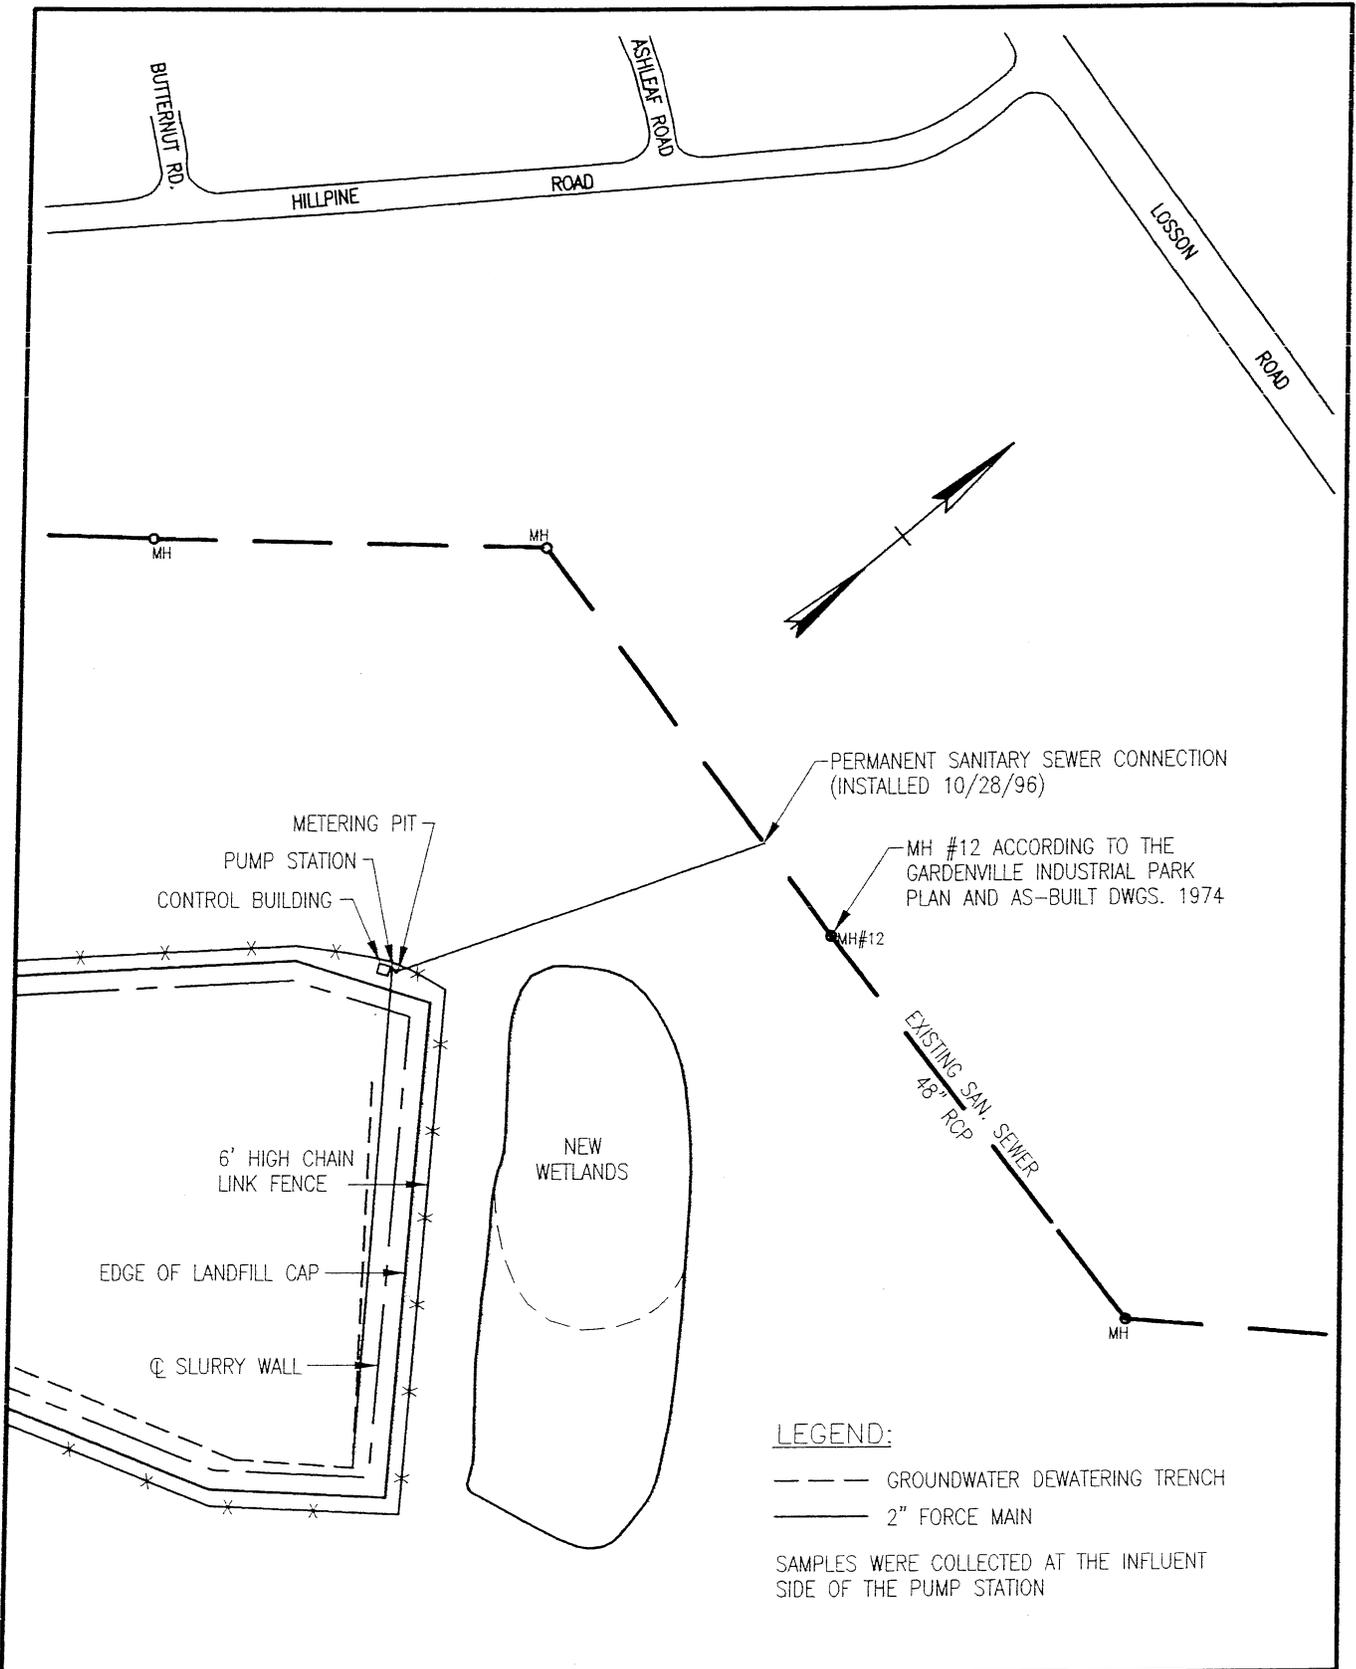

REVISION NO.		PROJECT	UNION ROAD SITE TOWN OF CHEEKTOWAGA, NEW YORK	 Unicorn Management Consultants, LLC 52 FEDERAL ROAD DANBURY, CT (203) 205-9000	PROJECT #
NO.	DATE				2045-100
DRAWING		LANDFILL DEWATERING LOCATION			FILENAME:
					2045100E
					SCALE:
					1" = 200'
					DATE:
					11/20/01
					BY: AD
					CK:
					FIGURE #
					1

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:

Bacteriology

Coliform, Total / E. coli (Qualitative) SM 20, 21-23 9223B (-04) (Collert)

Disinfection By-products

Bromide EPA 300.0 Rev. 2.1

Dissolved Gases

Acetylene RSK-175

Ethane RSK-175

Ethene (Ethylene) RSK-175

Methane RSK-175

Propane RSK-175

Metals I

Arsenic, Total EPA 200.8 Rev. 5.4

Barium, Total EPA 200.8 Rev. 5.4

Cadmium, Total EPA 200.8 Rev. 5.4

Chromium, Total EPA 200.7 Rev. 4.4

EPA 200.8 Rev. 5.4

Copper, Total EPA 200.7 Rev. 4.4

EPA 200.8 Rev. 5.4

Iron, Total EPA 200.7 Rev. 4.4

Lead, Total EPA 200.8 Rev. 5.4

Manganese, Total EPA 200.7 Rev. 4.4

EPA 200.8 Rev. 5.4

Mercury, Total EPA 245.1 Rev. 3.0

Selenium, Total EPA 200.8 Rev. 5.4

Silver, Total EPA 200.7 Rev. 4.4

Metals I

Silver, Total EPA 200.8 Rev. 5.4

Zinc, Total EPA 200.7 Rev. 4.4

EPA 200.8 Rev. 5.4

Metals II

Aluminum, Total EPA 200.7 Rev. 4.4

Antimony, Total EPA 200.8 Rev. 5.4

Beryllium, Total EPA 200.7 Rev. 4.4

EPA 200.8 Rev. 5.4

Molybdenum, Total EPA 200.7 Rev. 4.4

EPA 200.8 Rev. 5.4

Nickel, Total EPA 200.8 Rev. 5.4

Thallium, Total EPA 200.8 Rev. 5.4

Vanadium, Total EPA 200.7 Rev. 4.4

Metals III

Boron, Total EPA 200.7 Rev. 4.4

Calcium, Total EPA 200.7 Rev. 4.4

Magnesium, Total EPA 200.7 Rev. 4.4

Potassium, Total EPA 200.7 Rev. 4.4

Sodium, Total EPA 200.7 Rev. 4.4

Miscellaneous

1,4-Dioxane EPA 522

Organic Carbon, Dissolved SM 21-23 5310C (-00)

Organic Carbon, Total SM 21-23 5310B (-00)

SM 21-23 5310C (-00)

Serial No.: 62601

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

*is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES POTABLE WATER*

All approved analytes are listed below:

Miscellaneous

Turbidity EPA 180.1 Rev. 2.0
UV 254 SM 21-23 5910B (-00,-11)

Non-Metals

Alkalinity SM 21-23 2320B (-97)
Calcium Hardness SM 18-22 2340B (-97)
Chloride EPA 300.0 Rev. 2.1
Color SM 21-23 2120B (-01)
Corrosivity SM 18-22 2330
Cyanide Kelada 01, Rev. 1.2
EPA 335.4 Rev. 1.0
Fluoride, Total EPA 300.0 Rev. 2.1
Nitrate (as N) EPA 353.2 Rev. 2.0
Nitrite (as N) EPA 353.2 Rev. 2.0
Orthophosphate (as P) EPA 365.1 Rev. 2.0
Solids, Total Dissolved SM 21-23 2540C (-97)
Specific Conductance EPA 120.1 Rev. 1982
Sulfate (as SO4) EPA 300.0 Rev. 2.1

Serial No.: 62601

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES NON POTABLE WATER
All approved analytes are listed below:

Acrylates

Acrolein (Propenal)	EPA 8260C
	EPA 624.1
Acrylonitrile	EPA 8260C
	EPA 624.1
Ethyl methacrylate	EPA 8260C
Methyl acrylonitrile	EPA 8260C
Methyl methacrylate	EPA 8260C

Amines

1,2-Diphenylhydrazine	EPA 625.1
	EPA 8270D
1,4-Phenylenediamine	EPA 8270D
1-Naphthylamine	EPA 8270D
2-Naphthylamine	EPA 8270D
2-Nitroaniline	EPA 8270D
3-Nitroaniline	EPA 8270D
4-Chloroaniline	EPA 8270D
4-Nitroaniline	EPA 8270D
5-Nitro-o-toluidine	EPA 8270D
Aniline	EPA 625.1
	EPA 8270D
Carbazole	EPA 625.1
	EPA 8270D
Diphenylamine	EPA 8270D
Methapyrilene	EPA 8270D
Pronamide	EPA 8270D

Amines

Propionitrile	EPA 8260C
Pyridine	EPA 625.1
	EPA 8270D

Benzidines

3,3'-Dichlorobenzidine	EPA 625.1
	EPA 8270D
3,3'-Dimethylbenzidine	EPA 8270D
Benzidine	EPA 625.1
	EPA 8270D

Chlorinated Hydrocarbon Pesticides

4,4'-DDD	EPA 8081B
	EPA 608.3
4,4'-DDE	EPA 8081B
	EPA 608.3
4,4'-DDT	EPA 8081B
	EPA 608.3
Aldrin	EPA 8081B
	EPA 608.3
alpha-BHC	EPA 8081B
	EPA 608.3
alpha-Chlordane	EPA 8081B
	EPA 608.3
beta-BHC	EPA 8081B
	EPA 608.3
Chlordane Total	EPA 8081B

Serial No.: 62602

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES NON POTABLE WATER
All approved analytes are listed below:

Chlorinated Hydrocarbon Pesticides

Chlordane Total	EPA 608.3
Chlorobenzilate	EPA 8270D
delta-BHC	EPA 8081B
	EPA 608.3
Diallate	EPA 8270D
Dieldrin	EPA 8081B
	EPA 608.3
Endosulfan I	EPA 8081B
	EPA 608.3
Endosulfan II	EPA 8081B
	EPA 608.3
Endosulfan sulfate	EPA 8081B
	EPA 608.3
Endrin	EPA 8081B
	EPA 608.3
Endrin aldehyde	EPA 8081B
	EPA 608.3
Endrin Ketone	EPA 8081B
gamma-Chlordane	EPA 8081B
	EPA 608.3
Heptachlor	EPA 8081B
	EPA 608.3
Heptachlor epoxide	EPA 8081B
	EPA 608.3
Isodrin	EPA 8270D
Kepone	EPA 8270D

Chlorinated Hydrocarbon Pesticides

Lindane	EPA 8081B
	EPA 608.3
Methoxychlor	EPA 8081B
	EPA 608.3
Mirex	EPA 8081B
PCNB	EPA 8270D
Toxaphene	EPA 8081B
	EPA 608.3

Chlorinated Hydrocarbons

1,2,3-Trichlorobenzene	EPA 8260C
1,2,4,5-Tetrachlorobenzene	EPA 8270D
1,2,4-Trichlorobenzene	EPA 625.1
	EPA 8270D
2-Chloronaphthalene	EPA 625.1
	EPA 8270D
Hexachlorobenzene	EPA 625.1
	EPA 8270D
Hexachlorobutadiene	EPA 625.1
	EPA 8270D
Hexachlorocyclopentadiene	EPA 625.1
	EPA 8270D
Hexachloroethane	EPA 625.1
	EPA 8270D
Hexachloropropene	EPA 8270D
Pentachlorobenzene	EPA 8270D

Serial No.: 62602

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES NON POTABLE WATER
All approved analytes are listed below:

Chlorophenoxy Acid Pesticides

2,4,5-T	EPA 8151A
2,4,5-TP (Silvex)	EPA 8151A
2,4-D	EPA 8151A
Dicamba	EPA 8151A
Dinoseb	EPA 8151A
	EPA 8270D
Pentachlorophenol	EPA 8151A

Demand

Biochemical Oxygen Demand	SM 5210B-2011
Carbonaceous BOD	SM 5210B-2011
Chemical Oxygen Demand	EPA 410.4, Rev. 2.0 (1993)

Dissolved Gases

Acetylene	RSK-175
Ethane	RSK-175
Ethene (Ethylene)	RSK-175
Methane	RSK-175
Propane	RSK-175

Fuel Oxygenates

Di-isopropyl ether	EPA 8260C
	EPA 8015C
Ethanol	EPA 8015C
Methyl tert-butyl ether	EPA 8260C
	EPA 624.1
tert-amyl methyl ether (TAME)	EPA 8260C

Fuel Oxygenates

tert-butyl alcohol	EPA 8260C
	EPA 624.1
tert-butyl ethyl ether (ETBE)	EPA 8260C

Haloethers

2,2'-Oxybis(1-chloropropane)	EPA 625.1
	EPA 8270D
4-Bromophenylphenyl ether	EPA 625.1
	EPA 8270D
4-Chlorophenylphenyl ether	EPA 625.1
	EPA 8270D
Bis(2-chloroethoxy)methane	EPA 625.1
	EPA 8270D
Bis(2-chloroethyl)ether	EPA 625.1
	EPA 8270D

Low Level Polynuclear Aromatics

Acenaphthene Low Level	EPA 610
	EPA 8270D
Acenaphthylene Low Level	EPA 610
	EPA 8270D
Anthracene Low Level	EPA 610
	EPA 8270D
Benzo(a)anthracene Low Level	EPA 610
	EPA 8270D
Benzo(a)pyrene Low Level	EPA 610
	EPA 8270D

Serial No.: 62602

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES NON POTABLE WATER
All approved analytes are listed below:

Low Level Polynuclear Aromatics

Benzo(b)fluoranthene Low Level	EPA 610 EPA 8270D
Benzo(g,h,i)perylene Low Level	EPA 610 EPA 8270D
Benzo(k)fluoranthene Low Level	EPA 610 EPA 8270D
Chrysene Low Level	EPA 8270D
Dibenzo(a,h)anthracene Low Level	EPA 8270D
Fluoranthene Low Level	EPA 610 EPA 8270D
Fluorene Low Level	EPA 610 EPA 8270D
Indeno(1,2,3-cd)pyrene Low Level	EPA 610 EPA 8270D
Naphthalene Low Level	EPA 610 EPA 8270D
Phenanthrene Low Level	EPA 610 EPA 8270D
Pyrene Low Level	EPA 610 EPA 8270D

Metals I

Cadmium, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 6020A EPA 200.8, Rev. 5.4 (1994)
Calcium, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C
Chromium, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 6020A EPA 200.8, Rev. 5.4 (1994)
Copper, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 6020A EPA 200.8, Rev. 5.4 (1994)
Iron, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C
Lead, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 6020A EPA 200.8, Rev. 5.4 (1994)
Magnesium, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C
Manganese, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 6020A EPA 200.8, Rev. 5.4 (1994)

Metals I

Barium, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 6020A EPA 200.8, Rev. 5.4 (1994)
---------------	--

Serial No.: 62602

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES NON POTABLE WATER
All approved analytes are listed below:

Metals I

Nickel, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 6020A EPA 200.8, Rev. 5.4 (1994)
Potassium, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C
Silver, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 6020A EPA 200.8, Rev. 5.4 (1994)
Sodium, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C
Strontium, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C

Metals II

Aluminum, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 200.8, Rev. 5.4 (1994)
Antimony, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 6020A EPA 200.8, Rev. 5.4 (1994)
Arsenic, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 6020A

Metals II

Arsenic, Total	EPA 200.8, Rev. 5.4 (1994)
Beryllium, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 6020A EPA 200.8, Rev. 5.4 (1994)
Chromium VI	EPA 218.6, Rev. 3.3 (1994) EPA 7196A EPA 7199 SM 3500-Cr B-2011
Mercury, Low Level	EPA 1631E
Mercury, Total	EPA 245.1, Rev. 3.0 (1994) EPA 7470A
Selenium, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 6020A EPA 200.8, Rev. 5.4 (1994)
Vanadium, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 6020A EPA 200.8, Rev. 5.4 (1994)
Zinc, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 6020A EPA 200.8, Rev. 5.4 (1994)

Serial No.: 62602

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES NON POTABLE WATER
All approved analytes are listed below:

Metals III		Mineral	
Cobalt, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 6020A EPA 200.8, Rev. 5.4 (1994)	Fluoride, Total	EPA 9056A
Gold, Total	EPA 200.7, Rev. 4.4 (1994)	Hardness, Total	SM 2340C-2011 SM 2340B-2011
Molybdenum, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 6020A EPA 200.8, Rev. 5.4 (1994)	Sulfate (as SO4)	EPA 300.0, Rev. 2.1 (1993) EPA 9056A
Palladium, Total	EPA 200.7, Rev. 4.4 (1994)	Miscellaneous	
Thallium, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 6020A EPA 200.8, Rev. 5.4 (1994)	Boron, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C
Tin, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 6020A EPA 200.8, Rev. 5.4 (1994)	Bromide	EPA 300.0, Rev. 2.1 (1993) EPA 9056A
Titanium, Total	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 6020A	Color	SM 2120B-2011
Uranium (Mass)	EPA 200.7, Rev. 4.4 (1994) EPA 6010C EPA 6020A	Corrosivity	SM 2330
Mineral		Cyanide, Available	SM 4500-CN G-2011
Alkalinity	SM 2320B-2011	Cyanide, Total	Kelada-01 SM 4500-CN E-2011 EPA 335.4, Rev. 1.0 (1993) EPA 9012B
Calcium Hardness	SM 2340B-2011	Formaldehyde	EPA 8315A
Chloride	EPA 300.0, Rev. 2.1 (1993) EPA 9056A	non-Polar Extractable Material (TPH)	EPA 1664B
Fluoride, Total	EPA 300.0, Rev. 2.1 (1993)	Oil and Grease Total Recoverable (HEM)	EPA 1664B
		Organic Carbon, Total	SM 5310B-2011 SM 5310C-2011 EPA 9060A
		Phenols	EPA 420.4, Rev. 1.0 (1993) EPA 9066

Serial No.: 62602

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES NON POTABLE WATER
All approved analytes are listed below:

Miscellaneous

Specific Conductance	EPA 120.1 (Rev. 1982)
Sulfide (as S)	SM 4500-S2- F-2011 EPA 9034
Turbidity	EPA 180.1, Rev. 2.0 (1993)

Nitroaromatics and Isophorone

1,3,5-Trinitrobenzene	EPA 8270D
1,3-Dinitrobenzene	EPA 8270D
1,4-Naphthoquinone	EPA 8270D
2,4-Dinitrotoluene	EPA 625.1 EPA 8270D
2,6-Dinitrotoluene	EPA 625.1 EPA 8270D
4-Nitroquinoline-1-oxide	EPA 8270D
Isophorone	EPA 625.1 EPA 8270D
Nitrobenzene	EPA 625.1 EPA 8270D

Nitrosoamines

N-Nitrosodiethylamine	EPA 8270D
N-Nitrosodimethylamine	EPA 625.1 EPA 8270D
N-Nitrosodi-n-butylamine	EPA 8270D
N-Nitrosodi-n-propylamine	EPA 625.1 EPA 8270D
N-Nitrosodiphenylamine	EPA 625.1

Nitrosoamines

N-Nitrosodiphenylamine	EPA 8270D
N-nitrosomethylethylamine	EPA 8270D
N-nitrosomorpholine	EPA 8270D
N-nitrosopiperidine	EPA 8270D
N-Nitrosopyrrolidine	EPA 8270D

Nutrient

Ammonia (as N)	EPA 350.1, Rev. 2.0 (1993)
Kjeldahl Nitrogen, Total	EPA 351.2, Rev. 2.0 (1993)
Nitrate (as N)	EPA 353.2, Rev. 2.0 (1993) EPA 300.0, Rev. 2.1 (1993) EPA 9056A
Nitrate-Nitrite (as N)	EPA 353.2, Rev. 2.0 (1993)
Nitrite (as N)	EPA 353.2, Rev. 2.0 (1993) EPA 300.0, Rev. 2.1 (1993) EPA 9056A
Orthophosphate (as P)	EPA 365.1, Rev. 2.0 (1993)
Phosphorus, Total	EPA 365.1, Rev. 2.0 (1993)

Organophosphate Pesticides

Atrazine	EPA 8270D
Dimethoate	EPA 8270D
Disulfoton	EPA 8270D
Famphur	EPA 8270D
Parathion ethyl	EPA 8270D
Parathion methyl	EPA 8270D
Phorate	EPA 8270D

Serial No.: 62602

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES NON POTABLE WATER
All approved analytes are listed below:

Organophosphate Pesticides

Sulfotepp EPA 8270D
Thionazin EPA 8270D

Petroleum Hydrocarbons

Diesel Range Organics EPA 8015C

Phthalate Esters

Benzyl butyl phthalate EPA 625.1
EPA 8270D
Bis(2-ethylhexyl) phthalate EPA 625.1
EPA 8270D
Diethyl phthalate EPA 625.1
EPA 8270D
Dimethyl phthalate EPA 625.1
EPA 8270D
Di-n-butyl phthalate EPA 625.1
EPA 8270D
Di-n-octyl phthalate EPA 625.1
EPA 8270D

Polychlorinated Biphenyls

Aroclor 1016 (PCB-1016) EPA 8082A
EPA 608.3
Aroclor 1221 (PCB-1221) EPA 8082A
EPA 608.3
Aroclor 1232 (PCB-1232) EPA 8082A
EPA 608.3

Polychlorinated Biphenyls

Aroclor 1242 (PCB-1242) EPA 8082A
EPA 608.3
Aroclor 1248 (PCB-1248) EPA 8082A
EPA 608.3
Aroclor 1254 (PCB-1254) EPA 8082A
EPA 608.3
Aroclor 1260 (PCB-1260) EPA 8082A
EPA 608.3
Aroclor 1262 (PCB-1262) EPA 8082A
Aroclor 1268 (PCB-1268) EPA 8082A

Polynuclear Aromatics

2-Acetylaminofluorene EPA 8270D
3-Methylcholanthrene EPA 8270D
7,12-Dimethylbenzyl (a) anthracene EPA 8270D
Acenaphthene EPA 625.1
EPA 8270D
Acenaphthylene EPA 625.1
EPA 8270D
Anthracene EPA 625.1
EPA 8270D
Benzo(a)anthracene EPA 625.1
EPA 8270D
Benzo(a)pyrene EPA 625.1
EPA 8270D
Benzo(b)fluoranthene EPA 625.1

Serial No.: 62602

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



**NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER**



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

*is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES NON POTABLE WATER
All approved analytes are listed below:*

Polynuclear Aromatics

Benzo(b)fluoranthene	EPA 8270D
Benzo(g,h,i)perylene	EPA 625.1
	EPA 8270D
Benzo(k)fluoranthene	EPA 625.1
	EPA 8270D
Chrysene	EPA 625.1
	EPA 8270D
Dibenzo(a,h)anthracene	EPA 625.1
	EPA 8270D
Fluoranthene	EPA 625.1
	EPA 8270D
Fluorene	EPA 625.1
	EPA 8270D
Indeno(1,2,3-cd)pyrene	EPA 625.1
	EPA 8270D
Naphthalene	EPA 625.1
	EPA 8270D
Phenanthrene	EPA 625.1
	EPA 8270D
Pyrene	EPA 625.1
	EPA 8270D

Priority Pollutant Phenols

2,4,6-Trichlorophenol	EPA 625.1
	EPA 8270D
2,4-Dichlorophenol	EPA 625.1
	EPA 8270D
2,4-Dimethylphenol	EPA 625.1
	EPA 8270D
2,4-Dinitrophenol	EPA 625.1
	EPA 8270D
2,6-Dichlorophenol	EPA 8270D
2-Chlorophenol	EPA 625.1
	EPA 8270D
2-Methyl-4,6-dinitrophenol	EPA 625.1
	EPA 8270D
2-Methylphenol	EPA 625.1
	EPA 8270D
2-Nitrophenol	EPA 625.1
	EPA 8270D
3-Methylphenol	EPA 625.1
	EPA 8270D
4-Chloro-3-methylphenol	EPA 625.1
	EPA 8270D
4-Methylphenol	EPA 625.1
	EPA 8270D
4-Nitrophenol	EPA 625.1
	EPA 8270D
Cresols, Total	EPA 8270D

Priority Pollutant Phenols

2,3,4,6 Tetrachlorophenol	EPA 8270D
2,4,5-Trichlorophenol	EPA 625.1
	EPA 8270D

Serial No.: 62602

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES NON POTABLE WATER
All approved analytes are listed below:

Priority Pollutant Phenols

Pentachlorophenol	EPA 625.1 EPA 8270D
Phenol	EPA 625.1 EPA 8270D

Residue

Settleable Solids	SM 2540 F-2011
Solids, Total	SM 2540 B-2011
Solids, Total Dissolved	SM 2540 C-2011
Solids, Total Suspended	SM 2540 D-2011
Solids, Volatile	SM 2540 E-2011

Semi-Volatile Organics

1,1'-Biphenyl	EPA 8270D
1,2-Dichlorobenzene, Semi-volatile	EPA 8270D
1,3-Dichlorobenzene, Semi-volatile	EPA 8270D
1,4-Dichlorobenzene, Semi-volatile	EPA 8270D
2-Methylnaphthalene	EPA 8270D
2-Picoline	EPA 8270D
4-Amino biphenyl	EPA 8270D
Acetophenone	EPA 625.1 EPA 8270D
alpha-Terpineol	EPA 625.1
Aramite	EPA 8270D
Benzaldehyde	EPA 8270D
Benzoic Acid	EPA 8270D
Benzyl alcohol	EPA 8270D

Semi-Volatile Organics

Caprolactam	EPA 8270D
Dibenzofuran	EPA 8270D
Ethyl methanesulfonate	EPA 8270D
Isosafrole	EPA 8270D
Methyl methanesulfonate	EPA 8270D
O,O,O-Triethyl phosphorothioate	EPA 8270D
p-Dimethylaminoazobenzene	EPA 8270D
Phenacetin	EPA 8270D
Safrole	EPA 8270D

Volatile Aromatics

1,2,4-Trichlorobenzene, Volatile	EPA 8260C
1,2,4-Trimethylbenzene	EPA 8260C
1,2-Dichlorobenzene	EPA 8260C
	EPA 624.1
1,3,5-Trimethylbenzene	EPA 8260C
1,3-Dichlorobenzene	EPA 8260C
	EPA 624.1
1,4-Dichlorobenzene	EPA 8260C
	EPA 624.1
2-Chlorotoluene	EPA 8260C
4-Chlorotoluene	EPA 8260C
Benzene	EPA 8260C
	EPA 624.1
Bromobenzene	EPA 8260C
Chlorobenzene	EPA 8260C

Serial No.: 62602

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES NON POTABLE WATER
All approved analytes are listed below:

Volatile Aromatics

Chlorobenzene	EPA 624.1
Ethyl benzene	EPA 8260C
	EPA 624.1
Isopropylbenzene	EPA 8260C
m/p-Xylenes	EPA 8260C
	EPA 624.1
Naphthalene, Volatile	EPA 8260C
	EPA 624.1
n-Butylbenzene	EPA 8260C
n-Propylbenzene	EPA 8260C
o-Xylene	EPA 8260C
	EPA 624.1
p-Isopropyltoluene (P-Cymene)	EPA 8260C
sec-Butylbenzene	EPA 8260C
Styrene	EPA 8260C
	EPA 624.1
tert-Butylbenzene	EPA 8260C
Toluene	EPA 8260C
	EPA 624.1
Total Xylenes	EPA 8260C
	EPA 624.1

Volatile Halocarbons

1,1,1,2-Tetrachloroethane	EPA 8260C
1,1,1-Trichloroethane	EPA 8260C
	EPA 624.1

Volatile Halocarbons

1,1,2,2-Tetrachloroethane	EPA 8260C
	EPA 624.1
1,1,2-Trichloro-1,2,2-Trifluoroethane	EPA 8260C
	EPA 624.1
1,1,2-Trichloroethane	EPA 8260C
	EPA 624.1
1,1-Dichloroethane	EPA 8260C
	EPA 624.1
1,1-Dichloroethene	EPA 8260C
	EPA 624.1
1,1-Dichloropropene	EPA 8260C
1,2,3-Trichloropropane	EPA 8260C
1,2-Dibromo-3-chloropropane	EPA 8260C
1,2-Dibromoethane	EPA 8260C
1,2-Dichloro-1,1,2-Trifluoroethane	EPA 8260C
1,2-Dichloroethane	EPA 8260C
	EPA 624.1
1,2-Dichloropropane	EPA 8260C
	EPA 624.1
1,3-Dichloropropane	EPA 8260C
2,2-Dichloropropane	EPA 8260C
2-Chloro-1,3-butadiene (Chloroprene)	EPA 8260C
2-Chloroethylvinyl ether	EPA 8260C
	EPA 624.1
3-Chloropropene (Allyl chloride)	EPA 8260C
Bromochloromethane	EPA 8260C

Serial No.: 62602

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES NON POTABLE WATER
All approved analytes are listed below:

Volatile Halocarbons

Bromodichloromethane	EPA 8260C EPA 624.1
Bromoform	EPA 8260C EPA 624.1
Bromomethane	EPA 8260C EPA 624.1
Carbon tetrachloride	EPA 8260C EPA 624.1
Chloroethane	EPA 8260C EPA 624.1
Chloroform	EPA 8260C EPA 624.1
Chloromethane	EPA 8260C EPA 624.1
cis-1,2-Dichloroethene	EPA 8260C EPA 624.1
cis-1,3-Dichloropropene	EPA 8260C EPA 624.1
Dibromochloromethane	EPA 8260C EPA 624.1
Dibromomethane	EPA 8260C
Dichlorodifluoromethane	EPA 8260C EPA 624.1
Hexachlorobutadiene, Volatile	EPA 8260C
Methyl iodide	EPA 8260C
Methylene chloride	EPA 8260C

Volatile Halocarbons


Methylene chloride	EPA 624.1
Tetrachloroethene	EPA 8260C EPA 624.1
trans-1,2-Dichloroethene	EPA 8260C EPA 624.1
trans-1,3-Dichloropropene	EPA 8260C EPA 624.1
trans-1,4-Dichloro-2-butene	EPA 8260C
Trichloroethene	EPA 8260C EPA 624.1
Trichlorofluoromethane	EPA 8260C EPA 624.1
Vinyl chloride	EPA 8260C EPA 624.1

Volatiles Organics

1,4-Dioxane	EPA 8260C EPA 8270D EPA 8270D SIM
2-Butanone (Methylethyl ketone)	EPA 8260C
2-Hexanone	EPA 8260C
2-Nitropropane	EPA 8260C
4-Methyl-2-Pentanone	EPA 8260C EPA 624.1
Acetone	EPA 8260C EPA 624.1

Serial No.: 62602

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES NON POTABLE WATER
All approved analytes are listed below:

Volatiles Organics

Acetonitrile	EPA 8260C
	EPA 624.1
Carbon Disulfide	EPA 8260C
Cyclohexane	EPA 8260C
Di-ethyl ether	EPA 8260C
Ethyl Acetate	EPA 8260C
	EPA 8015C
Ethylene Glycol	EPA 8015C
Isobutyl alcohol	EPA 8260C
	EPA 8015C
Isopropanol	EPA 8260C
Methanol	EPA 8015C
Methyl acetate	EPA 8260C
Methyl cyclohexane	EPA 8260C
n-Butanol	EPA 8260C
o-Toluidine	EPA 8270D
Propylene Glycol	EPA 8015C
Tetrahydrofuran	EPA 8260C
	EPA 624.1
Vinyl acetate	EPA 8260C
	EPA 624.1

Sample Preparation Methods

EPA 3010A
EPA 3005A
EPA 3510C
EPA 3535A

Sample Preparation Methods

EPA 5030C
EPA 200.2
EPA 9030B

Serial No.: 62602

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES SOLID AND HAZARDOUS WASTE
All approved analytes are listed below:

Acrylates

Acrolein (Propenal)	EPA 8260C
Acrylonitrile	EPA 8260C
Ethyl methacrylate	EPA 8260C
Methyl acrylonitrile	EPA 8260C
Methyl methacrylate	EPA 8260C

Amines

1,2-Diphenylhydrazine	EPA 8270D
1,4-Phenylenediamine	EPA 8270D
1-Naphthylamine	EPA 8270D
2-Naphthylamine	EPA 8270D
2-Nitroaniline	EPA 8270D
3-Nitroaniline	EPA 8270D
4-Chloroaniline	EPA 8270D
4-Nitroaniline	EPA 8270D
5-Nitro-o-toluidine	EPA 8270D
Aniline	EPA 8270D
Carbazole	EPA 8270D
Diphenylamine	EPA 8270D
Methapyrilene	EPA 8270D
Pronamide	EPA 8270D

Benzidines

3,3'-Dichlorobenzidine	EPA 8270D
3,3'-Dimethylbenzidine	EPA 8270D
Benzidine	EPA 8270D

Characteristic Testing

Corrosivity (pH)	EPA 9040C
Free Liquids	EPA 9045D
Synthetic Precipitation Leaching Proc.	EPA 9095B
TCLP	EPA 1312
	EPA 1311

Chlorinated Hydrocarbon Pesticides

4,4'-DDD	EPA 8081B
4,4'-DDE	EPA 8081B
4,4'-DDT	EPA 8081B
Aldrin	EPA 8081B
alpha-BHC	EPA 8081B
alpha-Chlordane	EPA 8081B
Atrazine	EPA 8270D
beta-BHC	EPA 8081B
Chlordane Total	EPA 8081B
Chlorobenzilate	EPA 8270D
delta-BHC	EPA 8081B
Diallate	EPA 8270D
Diieldrin	EPA 8081B
Endosulfan I	EPA 8081B
Endosulfan II	EPA 8081B
Endosulfan sulfate	EPA 8081B
Endrin	EPA 8081B
Endrin aldehyde	EPA 8081B
Endrin Ketone	EPA 8081B

Serial No.: 62603

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

*is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES SOLID AND HAZARDOUS WASTE
All approved analytes are listed below:*

Chlorinated Hydrocarbon Pesticides

gamma-Chlordane	EPA 8081B
Heptachlor	EPA 8081B
Heptachlor epoxide	EPA 8081B
Isodrin	EPA 8270D
Kepone	EPA 8270D
Lindane	EPA 8081B
Methoxychlor	EPA 8081B
Pentachloronitrobenzene	EPA 8270D
Toxaphene	EPA 8081B

Chlorinated Hydrocarbons

1,2,3-Trichlorobenzene	EPA 8260C
1,2,4,5-Tetrachlorobenzene	EPA 8270D
1,2,4-Trichlorobenzene	EPA 8270D
1-Chloronaphthalene	EPA 8270D
2-Chloronaphthalene	EPA 8270D
Hexachlorobenzene	EPA 8270D
Hexachlorobutadiene	EPA 8270D
Hexachlorocyclopentadiene	EPA 8270D
Hexachloroethane	EPA 8270D
Hexachloropropene	EPA 8270D
Pentachlorobenzene	EPA 8270D

Chlorophenoxy Acid Pesticides

2,4,5-T	EPA 8151A
2,4,5-TP (Silvex)	EPA 8151A
2,4-D	EPA 8151A

Chlorophenoxy Acid Pesticides

Dicamba	EPA 8151A
Dinoseb	EPA 8270D
Pentachlorophenol	EPA 8151A

Haloethers

2,2'-Oxybis(1-chloropropane)	EPA 8270D
4-Bromophenylphenyl ether	EPA 8270D
4-Chlorophenylphenyl ether	EPA 8270D
Bis(2-chloroethoxy)methane	EPA 8270D
Bis(2-chloroethyl)ether	EPA 8270D

Low Level Polynuclear Aromatic Hydrocarbons

Acenaphthene Low Level	EPA 8270D
Acenaphthylene Low Level	EPA 8270D
Anthracene Low Level	EPA 8270D
Benzo(a)anthracene Low Level	EPA 8270D
Benzo(a)pyrene Low Level	EPA 8270D
Benzo(b)fluoranthene Low Level	EPA 8270D
Benzo(g,h,i)perylene Low Level	EPA 8270D
Benzo(k)fluoranthene Low Level	EPA 8270D
Chrysene Low Level	EPA 8270D
Dibenzo(a,h)anthracene Low Level	EPA 8270D
Fluoranthene Low Level	EPA 8270D
Fluorene Low Level	EPA 8270D
Indeno(1,2,3-cd)pyrene Low Level	EPA 8270D
Naphthalene Low Level	EPA 8270D
Phenanthrene Low Level	EPA 8270D

Serial No.: 62603

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES SOLID AND HAZARDOUS WASTE
All approved analytes are listed below:

Low Level Polynuclear Aromatic Hydrocarbons

Pyrene Low Level EPA 8270D

Metals I

Barium, Total EPA 6010C

EPA 6020A

Cadmium, Total EPA 6010C

EPA 6020A

Calcium, Total EPA 6010C

Chromium, Total EPA 6010C

EPA 6020A

Copper, Total EPA 6010C

EPA 6020A

Iron, Total EPA 6010C

Lead, Total EPA 6010C

EPA 6020A

Magnesium, Total EPA 6010C

Manganese, Total EPA 6010C

EPA 6020A

Nickel, Total EPA 6010C

EPA 6020A

Potassium, Total EPA 6010C

Silver, Total EPA 6010C

EPA 6020A

Sodium, Total EPA 6010C

Strontium, Total EPA 6010C

Metals II

Aluminum, Total EPA 6010C

Antimony, Total EPA 6010C

EPA 6020A

Arsenic, Total EPA 6010C

EPA 6020A

Beryllium, Total EPA 6010C

EPA 6020A

Chromium VI EPA 7199

Lithium, Total EPA 6010C

Mercury, Total EPA 7471B

Selenium, Total EPA 6010C

EPA 6020A

Vanadium, Total EPA 6010C

EPA 6020A

Zinc, Total EPA 6010C

EPA 6020A

Metals III

Cobalt, Total EPA 6010C

EPA 6020A

Molybdenum, Total EPA 6010C

EPA 6020A

Silica, Dissolved EPA 6010C

Thallium, Total EPA 6010C

EPA 6020A

Tin, Total EPA 6010C

Serial No.: 62603

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES SOLID AND HAZARDOUS WASTE
All approved analytes are listed below:

Metals III

Titanium, Total EPA 6010C

Minerals

Bromide EPA 9056A
Chloride EPA 9056A
Fluoride, Total EPA 9056A
Sulfate (as SO4) EPA 9056A

Miscellaneous

Boron, Total EPA 6010C
Cyanide, Total EPA 9012B
Organic Carbon, Total Lloyd Kahn Method
Phenols EPA 9066
Sulfide (as S) EPA 9034

Nitroaromatics and Isophorone

1,3,5-Trinitrobenzene EPA 8270D
1,3-Dinitrobenzene EPA 8270D
1,4-Naphthoquinone EPA 8270D
2,4-Dinitrotoluene EPA 8270D
2,6-Dinitrotoluene EPA 8270D
4-Dimethylaminoazobenzene EPA 8270D
4-Nitroquinoline-1-oxide EPA 8270D
Isophorone EPA 8270D
Nitrobenzene EPA 8270D
Pyridine EPA 8270D

Nitrosoamines

N-Nitrosodiethylamine EPA 8270D
N-Nitrosodimethylamine EPA 8270D
N-Nitrosodi-n-butylamine EPA 8270D
N-Nitrosodi-n-propylamine EPA 8270D
N-Nitrosodiphenylamine EPA 8270D
N-nitrosomethylethylamine EPA 8270D
N-nitrosomorpholine EPA 8270D
N-nitrosopiperidine EPA 8270D
N-Nitrosopyrrolidine EPA 8270D

Nutrients

Nitrate (as N) EPA 9056A
Nitrite (as N) EPA 9056A

Organophosphate Pesticides

Dimethoate EPA 8270D
Disulfoton EPA 8270D
Famphur EPA 8270D
Parathion ethyl EPA 8270D
Parathion methyl EPA 8270D
Phorate EPA 8270D
Sulfotepp EPA 8270D
Thionazin EPA 8270D

Petroleum Hydrocarbons

Diesel Range Organics EPA 8015C

Serial No.: 62603

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES SOLID AND HAZARDOUS WASTE

All approved analytes are listed below:

Phthalate Esters

Benzyl butyl phthalate	EPA 8270D
Bis(2-ethylhexyl) phthalate	EPA 8270D
Diethyl phthalate	EPA 8270D
Dimethyl phthalate	EPA 8270D
Di-n-butyl phthalate	EPA 8270D
Di-n-octyl phthalate	EPA 8270D

Polychlorinated Biphenyls

Aroclor 1016 (PCB-1016)	EPA 8082A
Aroclor 1016 (PCB-1016) in Oil	EPA 8082A
Aroclor 1221 (PCB-1221)	EPA 8082A
Aroclor 1221 (PCB-1221) in Oil	EPA 8082A
Aroclor 1232 (PCB-1232)	EPA 8082A
Aroclor 1232 (PCB-1232) in Oil	EPA 8082A
Aroclor 1242 (PCB-1242)	EPA 8082A
Aroclor 1242 (PCB-1242) in Oil	EPA 8082A
Aroclor 1248 (PCB-1248)	EPA 8082A
Aroclor 1248 (PCB-1248) in Oil	EPA 8082A
Aroclor 1254 (PCB-1254)	EPA 8082A
Aroclor 1254 (PCB-1254) in Oil	EPA 8082A
Aroclor 1260 (PCB-1260)	EPA 8082A
Aroclor 1260 (PCB-1260) in Oil	EPA 8082A
Aroclor 1262 (PCB-1262)	EPA 8082A
Aroclor 1262 (PCB-1262) in Oil	EPA 8082A
Aroclor 1268 (PCB-1268)	EPA 8082A
Aroclor 1268 (PCB-1268) in Oil	EPA 8082A

Polynuclear Aromatic Hydrocarbons

2-Acetylaminofluorene	EPA 8270D
3-Methylcholanthrene	EPA 8270D
7,12-Dimethylbenzyl (a) anthracene	EPA 8270D
Acenaphthene	EPA 8270D
Acenaphthylene	EPA 8270D
Anthracene	EPA 8270D
Benzo(a)anthracene	EPA 8270D
Benzo(a)pyrene	EPA 8270D
Benzo(b)fluoranthene	EPA 8270D
Benzo(g,h,i)perylene	EPA 8270D
Benzo(k)fluoranthene	EPA 8270D
Chrysene	EPA 8270D
Dibenzo(a,h)anthracene	EPA 8270D
Fluoranthene	EPA 8270D
Fluorene	EPA 8270D
Indeno(1,2,3-cd)pyrene	EPA 8270D
Naphthalene	EPA 8270D
Phenanthrene	EPA 8270D
Pyrene	EPA 8270D

Priority Pollutant Phenols

2,3,4,6 Tetrachlorophenol	EPA 8270D
2,4,5-Trichlorophenol	EPA 8270D
2,4,6-Trichlorophenol	EPA 8270D
2,4-Dichlorophenol	EPA 8270D
2,4-Dimethylphenol	EPA 8270D

Serial No.: 62603

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES SOLID AND HAZARDOUS WASTE
All approved analytes are listed below:

Priority Pollutant Phenols

2,4-Dinitrophenol	EPA 8270D
2,6-Dichlorophenol	EPA 8270D
2-Chlorophenol	EPA 8270D
2-Methyl-4,6-dinitrophenol	EPA 8270D
2-Methylphenol	EPA 8270D
2-Nitrophenol	EPA 8270D
3-Methylphenol	EPA 8270D
4-Chloro-3-methylphenol	EPA 8270D
4-Methylphenol	EPA 8270D
4-Nitrophenol	EPA 8270D
Pentachlorophenol	EPA 8270D
Phenol	EPA 8270D

Semi-Volatile Organics

1,1'-Biphenyl	EPA 8270D
1,2-Dichlorobenzene, Semi-volatile	EPA 8270D
1,3-Dichlorobenzene, Semi-volatile	EPA 8270D
1,4-Dichlorobenzene, Semi-volatile	EPA 8270D
2-Methylnaphthalene	EPA 8270D
2-Picoline	EPA 8270D
4-Amino biphenyl	EPA 8270D
Acetophenone	EPA 8270D
Aramite	EPA 8270D
Benzaldehyde	EPA 8270D
Benzoic Acid	EPA 8270D
Benzyl alcohol	EPA 8270D

Semi-Volatile Organics

Caprolactam	EPA 8270D
Dibenzofuran	EPA 8270D
Ethyl methanesulfonate	EPA 8270D
Isosafrole	EPA 8270D
Methyl methanesulfonate	EPA 8270D
O,O,O-Triethyl phosphorothioate	EPA 8270D
Phenacetin	EPA 8270D
Safrole	EPA 8270D

Volatile Aromatics

1,2,4-Trichlorobenzene, Volatile	EPA 8260C
1,2,4-Trimethylbenzene	EPA 8260C
1,2-Dichlorobenzene	EPA 8260C
1,3,5-Trimethylbenzene	EPA 8260C
1,3-Dichlorobenzene	EPA 8260C
1,4-Dichlorobenzene	EPA 8260C
2-Chlorotoluene	EPA 8260C
4-Chlorotoluene	EPA 8260C
Benzene	EPA 8260C
Bromobenzene	EPA 8260C
Chlorobenzene	EPA 8260C
Ethyl benzene	EPA 8260C
Isopropylbenzene	EPA 8260C
m/p-Xylenes	EPA 8260C
Naphthalene, Volatile	EPA 8260C
n-Butylbenzene	EPA 8260C

Serial No.: 62603

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES SOLID AND HAZARDOUS WASTE
All approved analytes are listed below:

Volatile Aromatics

n-Propylbenzene	EPA 8260C
o-Xylene	EPA 8260C
p-Isopropyltoluene (P-Cymene)	EPA 8260C
sec-Butylbenzene	EPA 8260C
Styrene	EPA 8260C
tert-Butylbenzene	EPA 8260C
Toluene	EPA 8260C
Total Xylenes	EPA 8260C

Volatile Halocarbons

1,1,1,2-Tetrachloroethane	EPA 8260C
1,1,1-Trichloroethane	EPA 8260C
1,1,2,2-Tetrachloroethane	EPA 8260C
1,1,2-Trichloro-1,2,2-Trifluoroethane	EPA 8260C
1,1,2-Trichloroethane	EPA 8260C
1,1-Dichloroethane	EPA 8260C
1,1-Dichloroethene	EPA 8260C
1,1-Dichloropropene	EPA 8260C
1,2,3-Trichloropropene	EPA 8260C
1,2-Dibromo-3-chloropropane	EPA 8260C
1,2-Dibromoethane	EPA 8260C
1,2-Dichloroethane	EPA 8260C
1,2-Dichloropropane	EPA 8260C
1,3-Dichloropropane	EPA 8260C
2,2-Dichloropropane	EPA 8260C
2-Chloro-1,3-butadiene (Chloroprene)	EPA 8260C

Volatile Halocarbons

2-Chloroethylvinyl ether	EPA 8260C
3-Chloropropene (Allyl chloride)	EPA 8260C
Bromochloromethane	EPA 8260C
Bromodichloromethane	EPA 8260C
Bromoform	EPA 8260C
Bromomethane	EPA 8260C
Carbon tetrachloride	EPA 8260C
Chloroethane	EPA 8260C
Chloroform	EPA 8260C
Chloromethane	EPA 8260C
cis-1,2-Dichloroethene	EPA 8260C
cis-1,3-Dichloropropene	EPA 8260C
Dibromochloromethane	EPA 8260C
Dibromomethane	EPA 8260C
Dichlorodifluoromethane	EPA 8260C
Hexachlorobutadiene, Volatile	EPA 8260C
Methyl iodide	EPA 8260C
Methylene chloride	EPA 8260C
Tetrachloroethene	EPA 8260C
trans-1,2-Dichloroethene	EPA 8260C
trans-1,3-Dichloropropene	EPA 8260C
trans-1,4-Dichloro-2-butene	EPA 8260C
Trichloroethene	EPA 8260C
Trichlorofluoromethane	EPA 8260C
Vinyl chloride	EPA 8260C

Serial No.: 62603

Property of the New York State Department of Health. Certificates are valid only at the address shown; must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES SOLID AND HAZARDOUS WASTE
All approved analytes are listed below:

Volatile Organics

1,4-Dioxane	EPA 8260C
	EPA 8270D
2-Butanone (Methylethyl ketone)	EPA 8260C
2-Hexanone	EPA 8260C
2-Nitropropane	EPA 8260C
4-Methyl-2-Pentanone	EPA 8260C
Acetone	EPA 8260C
Acetonitrile	EPA 8260C
Carbon Disulfide	EPA 8260C
Cyclohexane	EPA 8260C
Di-ethyl ether	EPA 8260C
Ethylene Glycol	EPA 8015C
Isobutyl alcohol	EPA 8260C
Isopropanol	EPA 8260C
Methyl acetate	EPA 8260C
Methyl cyclohexane	EPA 8260C
Methyl tert-butyl ether	EPA 8260C
n-Butanol	EPA 8260C
o-Toluidine	EPA 8270D
Propionitrile	EPA 8260C
tert-butyl alcohol	EPA 8260C
Tetrahydrofuran	EPA 8260C
Vinyl acetate	EPA 8260C

Sample Preparation Methods

EPA 5035A-H
EPA 3580A
EPA 9030B
EPA 3050B
EPA 3546
EPA 3060A
EPA 3541

Sample Preparation Methods

EPA 5035A-L

Serial No.: 62603

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

*is hereby APPROVED as an Environmental Laboratory for the category
ENVIRONMENTAL ANALYSES SOLID AND HAZARDOUS WASTE
All approved subcategories and/or analytes are listed below:*

Miscellaneous

Lead in Dust Wipes

EPA 6010C

Sample Preparation Methods

EPA 3050B

Serial No.: 62604

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES AIR AND EMISSIONS
All approved analytes are listed below:

Miscellaneous

Sulfur Dioxide	40 CFR 60 Method 8
Sulfuric Acid	40 CFR 60 Method 8

Serial No.: 62605

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



American Premier Underwriters, Inc.

One East Fourth Street
Cincinnati, Ohio 45202
Telephone (513) 579-6616
Facsimile (513) 579-0108

Michael L. Cioffi
Vice President and
Assistant General Counsel

May 25, 1995

Effective June 1, 1995, I, Mr. Michael Cioffi, Vice President and Assistant General Counsel of American Premier Underwriters, Inc., hereby authorize Mr. John M. Falbo of NES, Inc. to procure samples of the wastewater discharge for analysis pursuant to the wastewater discharge permit granted by the Erie County Department of Environment and Planning on May xx, 1995 (Permit #95-05-E1016). I also authorized Mr. Mark Cambra of NES, Inc. to prepare and submit the monitoring report on my behalf.



Mr. Michael Cioffi

Vice President and Assistant General Counsel
American Premier Underwriters, Inc.

May 26, 1995

Date