



Fire Protection Services

John Perkins
Director
Environment, Health & Safety

Tyco Fire Protection
1501 Yamato Road
Boca Raton, FL 33431USA

Tele: 561-226-3481
Email: johnperkins@tycoint.com

January 31, 2012

Ms. Laura Surdej
Erie County Department of Environment & Planning
Southtowns Sewage Treatment Plant
S-3690 Lakeshore Blvd.
Buffalo, New York 14219

**RE: First Quarter 2012 Discharge Monitoring Report
Scott Technologies, Inc., Groundwater Remediation Site
NYSDEC Site 9-15-149
EC/BPDES Permit No. 11-03-E4045**

Dear Ms. Surdej:

Scott Technologies, Inc. is pleased to provide you with the enclosed First Quarter 2012 Discharge Monitoring Report for the Scott Technologies, Inc., Groundwater Remediation Site located at AVOX Systems Inc., 25A Walter Winter Drive, Lancaster, New York. This report is submitted in partial fulfillment of Erie County/Buffalo Pollution Discharge Elimination System (EC/BPDES) Permit No. 11-03-E4045, effective April 1, 2011. Scott Technologies, Inc. commissioned AECOM, with an office located in Amherst, New York, to perform the required EC/BPDES quarterly sampling during the month of January 2012.

We certify under the penalty of law that this document and all attachments were prepared under our direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on our inquiry of the person or persons who manage the system or those directly responsible for gathering the information, the information submitted is, to the best of our knowledge and belief, true, accurate, and complete. We are aware that there are significant penalties for submitting false information, including the possibility of a fine and imprisonment for known violations. We will continue to monitor the influent and effluent of the active remediation system located at the Site on a quarterly basis. The next scheduled quarterly discharge monitoring report is due by May 31, 2012.

If you have any questions regarding this submission, please do not hesitate to contact me.

Very truly yours,
Scott Technologies, Inc.



John Perkins

Director, Environment, Health, & Safety
Tyco Fire Protection

Ms. Laura Surdej
January 31, 2012
Page 2

\enclosures

cc: Mr. Dennis Young, Buffalo Sewer Authority (electronic copy sent by AECOM)
Mr. Glenn May, NYSDEC Region 9 (electronic copy sent by AECOM)
Ms. Deanna Ripstein, NYSDOH Western Region (electronic copy sent by AECOM)
Mr. Joseph Gabner, AVOX Systems Inc. (hard copy sent by AECOM)
Mr. Eric Frauen, O&M, Inc. (electronic copy sent by AECOM)
Facility File, Lancaster, NY (hard copy sent by AECOM)

TABLE

**Scott Technologies, Inc. - Groundwater Remediation Site
Lancaster, New York**

EC/BPDES Permit No. 11-03-E4045


**First Quarter 2012 Discharge Monitoring Report
Sample Date - January 12, 2012**


Parameter	Units	Discharge Limitations Daily Max	Calculated Daily Value	Within Limits?
pH (method 160.1)	SU	5 - 12	8.16	Y
Total Extractable Hydrocarbons (method 1664 SGT)	mg/L	100	< 5.0	Y
Total Suspended Solids (method 160.2)	mg/L	250	6.4	Y
<u>VOCs (ASP00 method 8260)</u>				
Methylene Chloride	lbs/day	0.12	< 0.000020	Y
1,1,1-Trichloroethane	lbs/day	0.09	< 0.000020	Y
Trichloroethylene	lbs/day	0.04	< 0.000020	Y
Total 1,2-DCE (cis-1,2-DCE and trans-1,2-DCE)	lbs/day	0.02	< 0.000020	Y
1,1-Dichloroethane	lbs/day	0.0025	< 0.000020	Y
Chloroethane	lbs/day	0.025	< 0.000020	Y
Toluene	lbs/day	0.004	< 0.000020	Y
Total Daily Flow (discharge meter reading)	gallons per day	14,000	2,395	Y

Notes:

- SU standard units
- mg/L milligrams per liter
- ug/L micrograms per liter
- lbs/day pounds per day
- J Indicates analyte result was reported as an estimated concentration.
- < (value) Indicates calculated concentration less than the reported value,
using effluent reporting limit as maximum possible concentration
- DPE system was not running during sample collection.

FIGURES

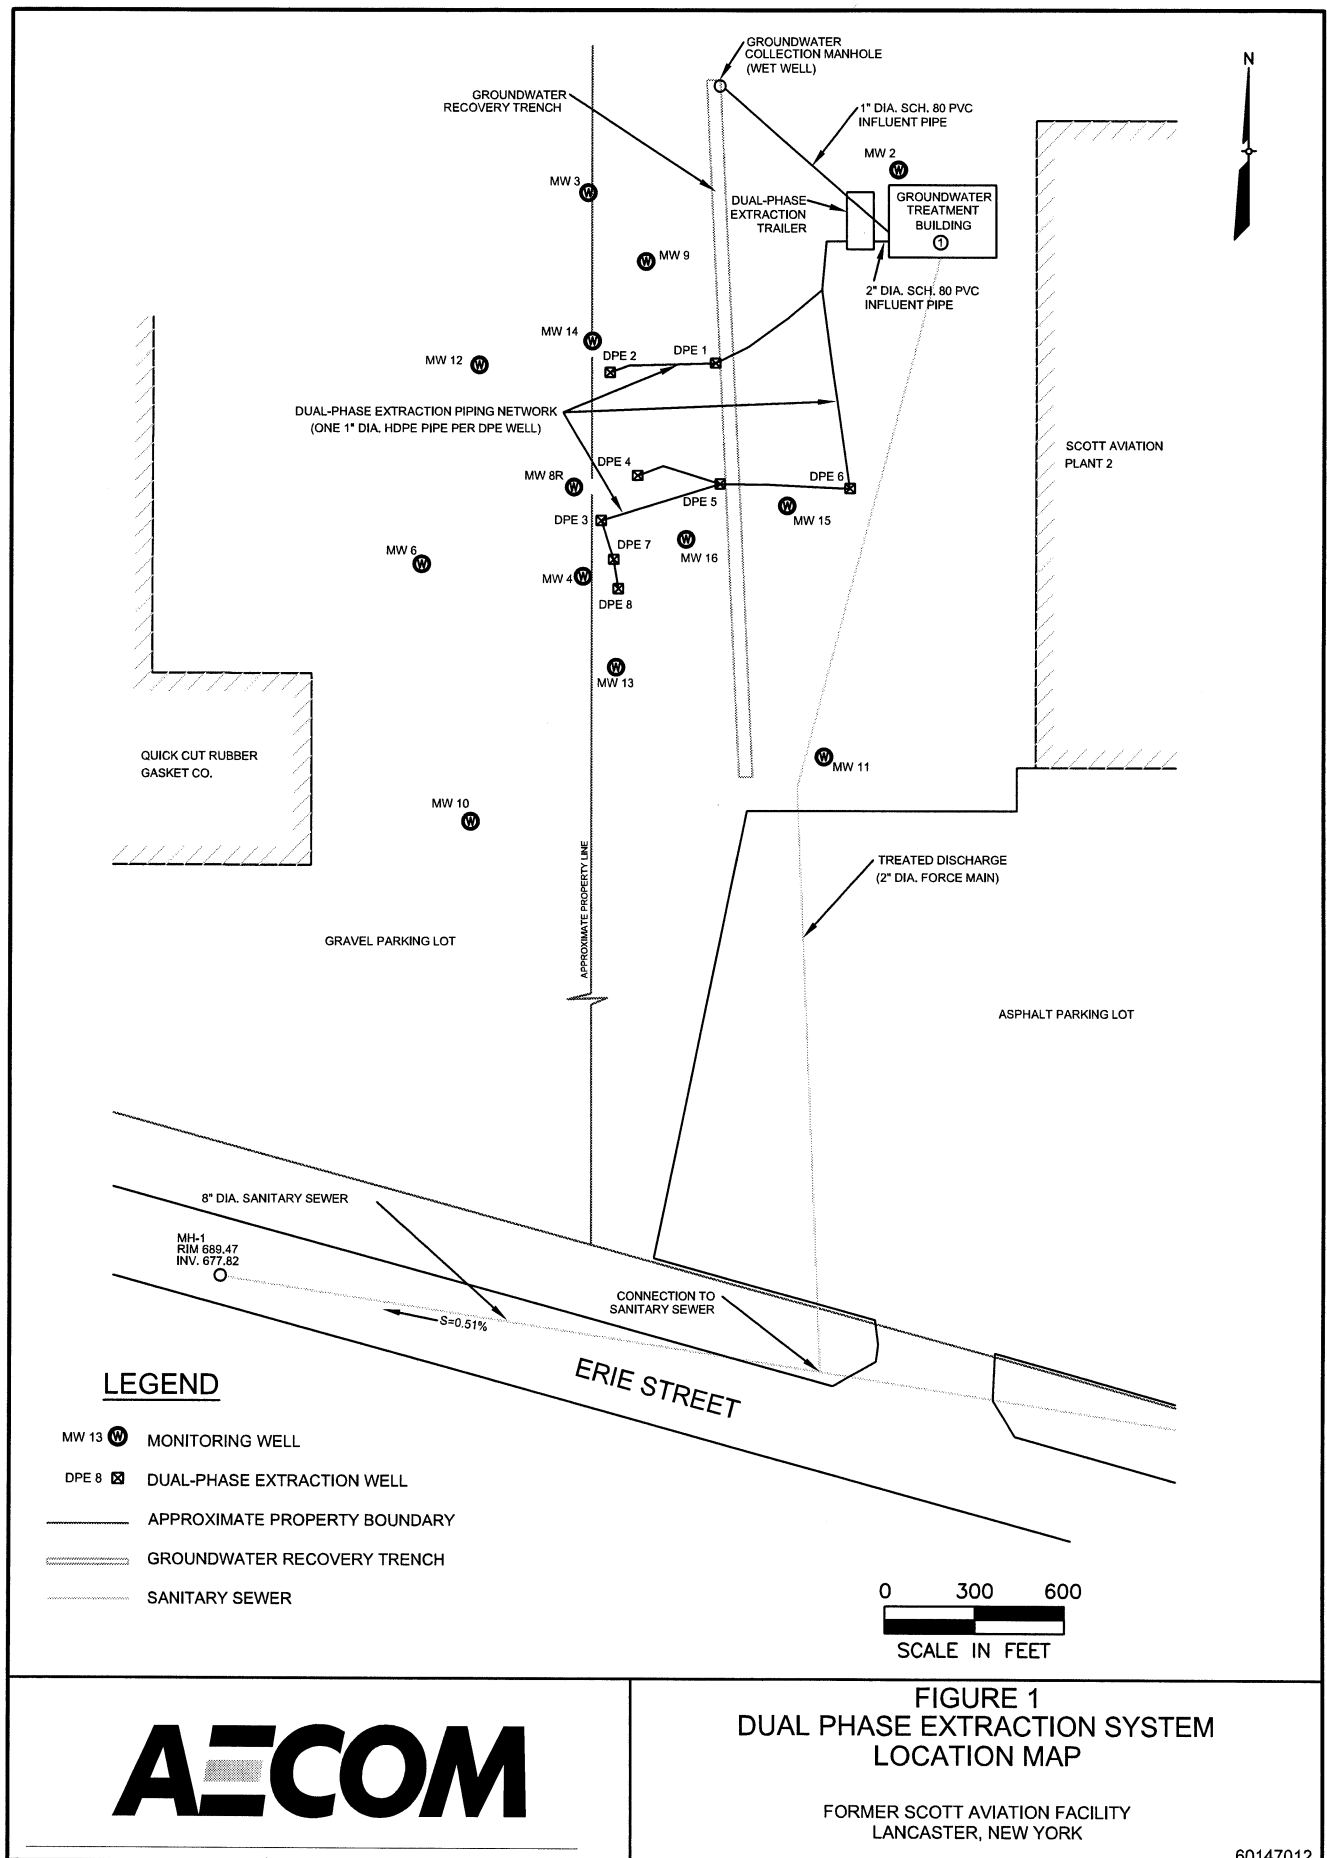

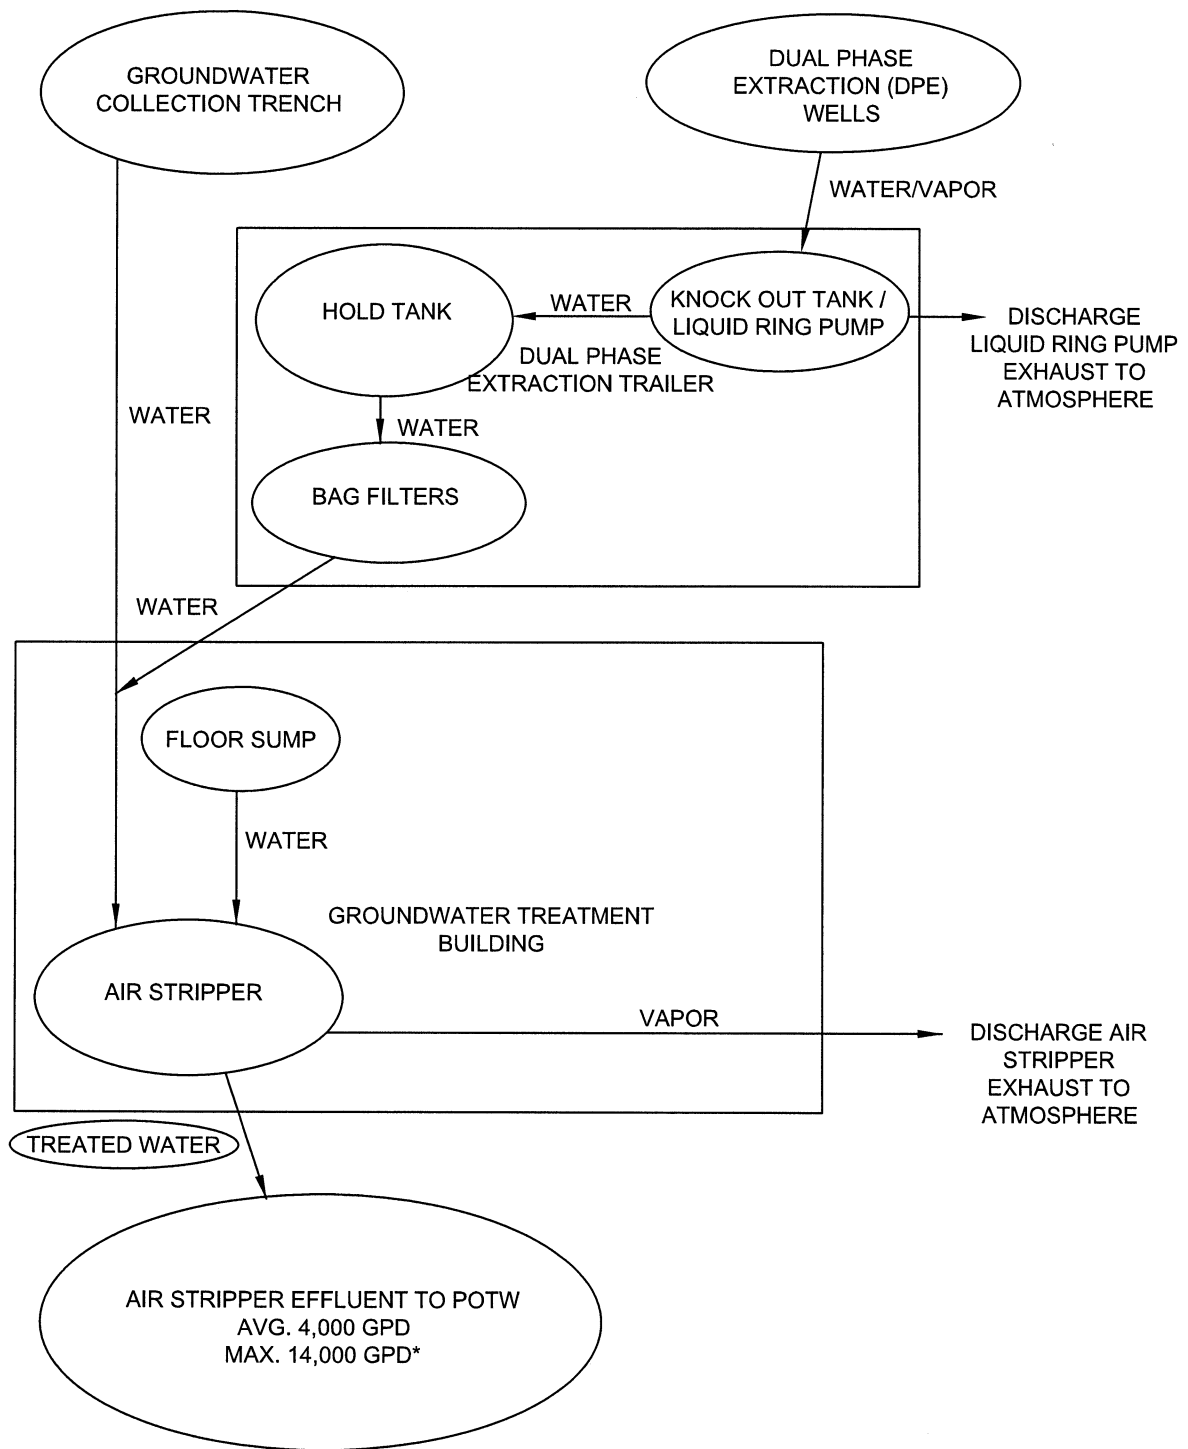

*PER DISCHARGE PERMIT NO. 08-02-E4045

AECOM

**FIGURE 2
COMBINED DUAL PHASE EXTRACTION
REMEDATION SYSTEM FLOW DIAGRAM**

FORMER SCOTT AVIATION FACILITY
LANCASTER, NEW YORK

60147012

DAILY FIELD LOG

DAILY FIELD LOG

AECOM

Project Scott Technologies, Inc., Groundwater Remediation Site, Lancaster, NY
Date 12-Jan-12
Weather Heavy Rain
Temperature Range 35 deg F
AECOM Personnel on Site Dino Zack
Time on Site 07:00 - 16:30 hrs

Air Stripper Totalizer Before Sampling 21,680.3 gallons (08:00 hrs)
Air Stripper Totalizer After Sampling 22,938.9 gallons (16:00 hrs)

Summary of Sample Activities

Time = 08:00 hrs
pH = 8

Fill 2, 40-ml vials (preserved with HCl) from influent sample tap. Fill 1, 1-L clear glass bottle (preserved with H₂SO₄) 1/4 full, from influent tap. Fill 1, 500-ml plastic bottle (unpreserved) 1/4 full from influent tap. Fill 1 250-ml plastic bottle (unpreserved) 1/4 full from influent tap. Water quality is clear with slight odor (no sheen).

Fill 2, 40-ml vials (preserved with HCl) from effluent sample tap. Fill 1, 1-L clear glass bottle (preserved with H₂SO₄) 1/4 full, respectively, from effluent tap. Fill 1, 500-ml plastic bottle (unpreserved) 1/4 full from effluent tap. Fill 1 250-ml plastic bottle (unpreserved) 1/4 full from effluent tap. Water quality is clear with no discernable odor or sheen.

Time = 11:00 hrs
pH = 8

Fill 2, 40-ml vials (preserved with HCl) from influent sample tap. Fill 1, 1-L clear glass bottle (preserved with H₂SO₄) 1/4 full, from influent tap. Fill 1, 500-ml plastic bottle (unpreserved) 1/4 full from influent tap. Fill 1 250-ml plastic bottle (unpreserved) 1/4 full from influent tap. Water quality is clear with slight odor (no sheen).

Fill 2, 40-ml vials (preserved with HCl) from effluent sample tap. Fill 1, 1-L clear glass bottle (preserved with H₂SO₄) 1/4 full, respectively, from effluent tap. Fill 1, 500-ml plastic bottle (unpreserved) 1/4 full from effluent tap. Fill 1 250-ml plastic bottle (unpreserved) 1/4 full from effluent tap. Water quality is clear with no discernable odor or sheen.

Time = 13:30 hrs
pH = 8

Fill 2, 40-ml vials (preserved with HCl) from influent sample tap. Fill 1, 1-L clear glass bottle (preserved with H₂SO₄) 1/4 full, from influent tap. Fill 1, 500-ml plastic bottle (unpreserved) 1/4 full from influent tap. Fill 1 250-ml plastic bottle (unpreserved) 1/4 full from influent tap. Water quality is clear with slight odor (no sheen).

Fill 2, 40-ml vials (preserved with HCl) from effluent sample tap. Fill 1, 1-L clear glass bottle (preserved with H₂SO₄) 1/4 full, respectively, from effluent tap. Fill 1, 500-ml plastic bottle (unpreserved) 1/4 full from effluent tap. Fill 1 250-ml plastic bottle (unpreserved) 1/4 full from effluent tap. Water quality is clear with no discernable odor or sheen.

Time = 16:00 hrs
pH = 8

Fill 2, 40-ml vials (preserved with HCl) from influent sample tap. Fill 1, 1-L clear glass bottle (preserved with H₂SO₄) 1/4 full, from influent tap. Fill 1, 500-ml plastic bottle (unpreserved) 1/4 full from influent tap. Fill 1 250-ml plastic bottle (unpreserved) 1/4 full from influent tap. Water quality is clear with slight odor (no sheen).

Fill 2, 40-ml vials (preserved with HCl) from effluent sample tap. Fill 1, 1-L clear glass bottle (preserved with H₂SO₄) 1/4 full, respectively, from effluent tap. Fill 1, 500-ml plastic bottle (unpreserved) 1/4 full from effluent tap. Fill 1 250-ml plastic bottle (unpreserved) 1/4 full from effluent tap. Water quality is clear with no discernable odor or sheen.


Comments

DPE system and GWCT running at time of sample collection.

Air samples collected on 1/12/12 at 07:30 hrs from AS effluent and LRP effluent for TO-15 analysis.

Maintain samples at 4 degrees C. Hand deliver samples to TestAmerica Laboratories, Inc. (Amherst, NY) under COC on 1/13/12 for analysis. Request laboratory to composite 40-ml samples and analyze for VOCs (8260; TCL and STARS). Request laboratory to analyze influent and effluent samples for TEH (1664), TSS (160.2), and pH.

Signature:



Date: 12-Jan-12

LABORATORY REPORT

ANALYTICAL REPORT

Job Number: 480-14999-1

Job Description: Scott Aviation site

Sampling Event: Influent/Effluent analysis

For:


AECOM, Inc.

100 Corporate Parkway

Suite 341

Amherst, NY 14226

Attention: Mr. Dino Zack

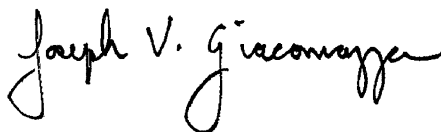

Approved for release.
Joe Giacomazza
Project Administrator
1/27/2012 11:21 AM

Designee for

Brian Fischer

Project Manager II

brian.fischer@testamericainc.com

01/27/2012

The test results in this report meet all NELAP requirements for analytes for which accreditation is required or available. Any exceptions to the NELAP requirements are noted in this report. Pursuant to NELAP, this report may not be reproduced, except in full, without the written approval of the laboratory. All questions regarding this test report should be directed to the TestAmerica Project Manager who has signed this report. TestAmerica Buffalo NELAC Certifications: CADPH 01169CA, FLDOH E87672, ILEPA 200003, KSDOH E-10187, LADEQ 30708, MDH 036-999-337, NHELAP 2973, NJDEP NY455, NHDOH 10026, ORELAP NY200003, PADEP 68-00281, TXCEQ T-104704412-10-1

TestAmerica Laboratories, Inc.

TestAmerica Buffalo 10 Hazelwood Drive, Amherst, NY 14228-2298

Tel (716) 691-2600 Fax (716) 691-7991 www.testamericainc.com



Table of Contents

Cover Title Page	1
Data Summaries	4
Report Narrative	4
Manual Integration Summary	5
Sample Summary	6
Executive Summary	7
Method Summary	8
Method / Analyst Summary	9
Sample Datasheets	10
Surrogate Summary	18
QC Data Summary	19
Data Qualifiers	24
QC Association Summary	25
Lab Chronicle	26
Certification Summary	28
Organic Sample Data	29
GC/MS VOA	29
Method 8260B	29
Method 8260B QC Summary	30
Method 8260B Sample Data	37
Standards Data	59
Method 8260B ICAL Data	59
Method 8260B CCAL Data	95
Raw QC Data	101
Method 8260B Tune Data	101
Method 8260B Blank Data	107

Table of Contents

Method 8260B LCS/LCSD Data	113
Method 8260B Run Logs	116
Inorganic Sample Data	118
General Chemistry Data	118
Gen Chem Cover Page	119
Gen Chem Sample Data	120
Gen Chem QC Data	124
Gen Chem ICV/CCV	124
Gen Chem Blanks	125
Gen Chem LCS/LCSD	126
Gen Chem MDL	127
Gen Chem Preparation Log	133
Gen Chem Analysis Run Log	134
Gen Chem Raw Data	138
Gen Chem Prep Data	156
Shipping and Receiving Documents	160
Client Chain of Custody	161
Sample Receipt Checklist	162

Job Narrative
480-14999-1

Comments

No additional comments.

Receipt

All samples were received in good condition within temperature requirements.

GC/MS VOA

Method 8260B: The following sample(s) was composited by the laboratory on 1/17/12 as requested on the chain-of-custody: EFFLUENT (480-14999-1), INFLUENT (480-14999-2).

No other analytical or quality issues were noted.

General Chemistry

Method SM 4500 H+ B: This analysis is normally performed in the field and has a method-defined holding time of 15 minutes. The following sample(s) has been qualified with the "HF" flag to indicate analysis was performed in the laboratory outside the 15 minute timeframe: EFFLUENT (480-14999-1), INFLUENT (480-14999-2)

No other analytical or quality issues were noted.

SAMPLE SUMMARY

Client: AECOM, Inc.

Job Number: 480-14999-1

Lab Sample ID	Client Sample ID	Client Matrix	Date/Time Sampled	Date/Time Received
480-14999-1	EFFLUENT	Water	01/12/2012 0800	01/13/2012 1745
480-14999-2	INFLUENT	Water	01/12/2012 0800	01/13/2012 1745
480-14999-3TB	Trip Blank	Water	01/12/2012 0800	01/13/2012 1745

EXECUTIVE SUMMARY - Detections

Client: AECOM, Inc.

Job Number: 480-14999-1

Lab Sample ID Analyte	Client Sample ID	Result	Qualifier	Reporting Limit	Units	Method
480-14999-1	EFFLUENT					
Total Suspended Solids		6.4		4.0	mg/L	SM 2540D
pH		8.16	HF	0.100	SU	SM 4500 H+ B
480-14999-2	INFLUENT					
1,1,2,2-Tetrachloroethane		0.52	J	1.0	ug/L	8260B
1,1-Dichloroethane		2.1		1.0	ug/L	8260B
Chloroethane		3.6		1.0	ug/L	8260B
cis-1,2-Dichloroethene		47		1.0	ug/L	8260B
trans-1,2-Dichloroethene		0.95	J	1.0	ug/L	8260B
Trichloroethene		25		1.0	ug/L	8260B
Vinyl chloride		1.2		1.0	ug/L	8260B
Total Suspended Solids		51.2		4.0	mg/L	SM 2540D
pH		7.95	HF	0.100	SU	SM 4500 H+ B

METHOD SUMMARY

Client: AECOM, Inc.

Job Number: 480-14999-1

Description		Lab Location	Method	Preparation Method
Matrix	Water			
Volatile Organic Compounds (GC/MS)		TAL BUF	SW846 8260B	
Purge and Trap		TAL BUF		SW846 5030B
HEM and SGT-HEM		TAL BUF	1664A 1664A	
HEM and SGT-HEM (SPE)				1664A 1664A
Solids, Total Suspended (TSS)		TAL BUF	SM SM 2540D	
pH		TAL BUF	SM SM 4500 H+ B	

Lab References:

TAL BUF = TestAmerica Buffalo

Method References:

1664A = EPA-821-98-002

SM = "Standard Methods For The Examination Of Water And Wastewater",

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

METHOD / ANALYST SUMMARY

Client: AECOM, Inc.

Job Number: 480-14999-1

Method	Analyst	Analyst ID
SW846 8260B	Cwiklinski, Charles D	CDC
1664A 1664A	Stredny, Joseph	JS
SM SM 2540D	Sobol, Kevin	KS
SM SM 4500 H+ B	Nyznyk, Elizabeth G	EGN

Analytical Data

Client: AECOM, Inc.

Job Number: 480-14999-1

Client Sample ID: EFFLUENT

Lab Sample ID: 480-14999-1

Date Sampled: 01/12/2012 0800

Client Matrix: Water

Date Received: 01/13/2012 1745

8260B Volatile Organic Compounds (GC/MS)

Analysis Method:	8260B	Analysis Batch:	480-48180	Instrument ID:	HP5973C
Prep Method:	5030B	Prep Batch:	N/A	Lab File ID:	C16983.D
Dilution:	1.0			Initial Weight/Volume:	5 mL
Analysis Date:	01/17/2012 1807			Final Weight/Volume:	5 mL
Prep Date:	01/17/2012 1807				

Analyte	Result (ug/L)	Qualifier	MDL	RL
1,1,1-Trichloroethane	ND		0.82	1.0
1,1,2,2-Tetrachloroethane	ND		0.21	1.0
1,1,2-Trichloroethane	ND		0.23	1.0
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.31	1.0
1,1-Dichloroethane	ND		0.38	1.0
1,1-Dichloroethene	ND		0.29	1.0
1,2,4-Trichlorobenzene	ND		0.41	1.0
1,2-Dibromo-3-Chloropropane	ND		0.39	1.0
1,2-Dibromoethane	ND		0.73	1.0
1,2-Dichlorobenzene	ND		0.79	1.0
1,2-Dichloroethane	ND		0.21	1.0
1,2-Dichloropropane	ND		0.72	1.0
1,3-Dichlorobenzene	ND		0.78	1.0
1,4-Dichlorobenzene	ND		0.84	1.0
2-Hexanone	ND		1.2	5.0
2-Butanone (MEK)	ND		1.3	10
4-Methyl-2-pentanone (MIBK)	ND		2.1	5.0
Acetone	ND		3.0	10
Benzene	ND		0.41	1.0
Bromodichloromethane	ND		0.39	1.0
Bromoform	ND		0.26	1.0
Bromomethane	ND		0.69	1.0
Carbon disulfide	ND		0.19	1.0
Carbon tetrachloride	ND		0.27	1.0
Chlorobenzene	ND		0.75	1.0
Dibromochloromethane	ND		0.32	1.0
Chloroethane	ND		0.32	1.0
Chloroform	ND		0.34	1.0
Chloromethane	ND		0.35	1.0
cis-1,2-Dichloroethene	ND		0.81	1.0
cis-1,3-Dichloropropene	ND		0.36	1.0
Cyclohexane	ND		0.18	1.0
Dichlorodifluoromethane	ND		0.68	1.0
Ethylbenzene	ND		0.74	1.0
Isopropylbenzene	ND		0.79	1.0
Methyl acetate	ND		0.50	1.0
Methyl tert-butyl ether	ND		0.16	1.0
Methylcyclohexane	ND		0.16	1.0
Methylene Chloride	ND		0.44	1.0
Styrene	ND		0.73	1.0
Tetrachloroethene	ND		0.36	1.0
Toluene	ND		0.51	1.0
trans-1,2-Dichloroethene	ND		0.90	1.0
trans-1,3-Dichloropropene	ND		0.37	1.0
Trichloroethene	ND		0.46	1.0
Trichlorofluoromethane	ND		0.88	1.0

Analytical Data

Client: AECOM, Inc.

Job Number: 480-14999-1

Client Sample ID: EFFLUENT

Lab Sample ID: 480-14999-1

Date Sampled: 01/12/2012 0800

Client Matrix: Water

Date Received: 01/13/2012 1745

8260B Volatile Organic Compounds (GC/MS)

Analysis Method:	8260B	Analysis Batch:	480-48180	Instrument ID:	HP5973C
Prep Method:	5030B	Prep Batch:	N/A	Lab File ID:	C16983.D
Dilution:	1.0			Initial Weight/Volume:	5 mL
Analysis Date:	01/17/2012 1807			Final Weight/Volume:	5 mL
Prep Date:	01/17/2012 1807				

Analyte	Result (ug/L)	Qualifier	MDL	RL
Vinyl chloride	ND		0.90	1.0
Xylenes, Total	ND		0.66	2.0

Surrogate	%Rec	Qualifier	Acceptance Limits
1,2-Dichloroethane-d4 (Surr)	91		66 - 137
Toluene-d8 (Surr)	89		71 - 126
4-Bromofluorobenzene (Surr)	76		73 - 120

Analytical Data

Client: AECOM, Inc.

Job Number: 480-14999-1

Client Sample ID: INFLUENT

Lab Sample ID: 480-14999-2

Date Sampled: 01/12/2012 0800

Client Matrix: Water

Date Received: 01/13/2012 1745

8260B Volatile Organic Compounds (GC/MS)

Analysis Method:	8260B	Analysis Batch:	480-48180	Instrument ID:	HP5973C
Prep Method:	5030B	Prep Batch:	N/A	Lab File ID:	C16984.D
Dilution:	1.0			Initial Weight/Volume:	5 mL
Analysis Date:	01/17/2012 1832			Final Weight/Volume:	5 mL
Prep Date:	01/17/2012 1832				

Analyte	Result (ug/L)	Qualifier	MDL	RL
1,1,1-Trichloroethane	ND		0.82	1.0
1,1,2,2-Tetrachloroethane	0.52	J	0.21	1.0
1,1,2-Trichloroethane	ND		0.23	1.0
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.31	1.0
1,1-Dichloroethane	2.1		0.38	1.0
1,1-Dichloroethene	ND		0.29	1.0
1,2,4-Trichlorobenzene	ND		0.41	1.0
1,2-Dibromo-3-Chloropropane	ND		0.39	1.0
1,2-Dibromoethane	ND		0.73	1.0
1,2-Dichlorobenzene	ND		0.79	1.0
1,2-Dichloroethane	ND		0.21	1.0
1,2-Dichloropropane	ND		0.72	1.0
1,3-Dichlorobenzene	ND		0.78	1.0
1,4-Dichlorobenzene	ND		0.84	1.0
2-Hexanone	ND		1.2	5.0
2-Butanone (MEK)	ND		1.3	10
4-Methyl-2-pentanone (MIBK)	ND		2.1	5.0
Acetone	ND		3.0	10
Benzene	ND		0.41	1.0
Bromodichloromethane	ND		0.39	1.0
Bromoform	ND		0.26	1.0
Bromomethane	ND		0.69	1.0
Carbon disulfide	ND		0.19	1.0
Carbon tetrachloride	ND		0.27	1.0
Chlorobenzene	ND		0.75	1.0
Dibromochloromethane	ND		0.32	1.0
Chloroethane	3.6		0.32	1.0
Chloroform	ND		0.34	1.0
Chloromethane	ND		0.35	1.0
cis-1,2-Dichloroethene	47		0.81	1.0
cis-1,3-Dichloropropene	ND		0.36	1.0
Cyclohexane	ND		0.18	1.0
Dichlorodifluoromethane	ND		0.68	1.0
Ethylbenzene	ND		0.74	1.0
Isopropylbenzene	ND		0.79	1.0
Methyl acetate	ND		0.50	1.0
Methyl tert-butyl ether	ND		0.16	1.0
Methylcyclohexane	ND		0.16	1.0
Methylene Chloride	ND		0.44	1.0
Styrene	ND		0.73	1.0
Tetrachloroethene	ND		0.36	1.0
Toluene	ND		0.51	1.0
trans-1,2-Dichloroethene	0.95	J	0.90	1.0
trans-1,3-Dichloropropene	ND		0.37	1.0
Trichloroethene	25		0.46	1.0
Trichlorofluoromethane	ND		0.88	1.0

Analytical Data

Client: AECOM, Inc.

Job Number: 480-14999-1

Client Sample ID: INFLUENT

Lab Sample ID: 480-14999-2

Client Matrix: Water

Date Sampled: 01/12/2012 0800

Date Received: 01/13/2012 1745

8260B Volatile Organic Compounds (GC/MS)

Analysis Method:	8260B	Analysis Batch:	480-48180	Instrument ID:	HP5973C
Prep Method:	5030B	Prep Batch:	N/A	Lab File ID:	C16984.D
Dilution:	1.0			Initial Weight/Volume:	5 mL
Analysis Date:	01/17/2012 1832			Final Weight/Volume:	5 mL
Prep Date:	01/17/2012 1832				

Analyte	Result (ug/L)	Qualifier	MDL	RL
Vinyl chloride	1.2		0.90	1.0
Xylenes, Total	ND		0.66	2.0

Surrogate	%Rec	Qualifier	Acceptance Limits
1,2-Dichloroethane-d4 (Surr)	94		66 - 137
Toluene-d8 (Surr)	95		71 - 126
4-Bromofluorobenzene (Surr)	83		73 - 120

Analytical Data

Client: AECOM, Inc.

Job Number: 480-14999-1

Client Sample ID: Trip Blank

Lab Sample ID: 480-14999-3TB

Date Sampled: 01/12/2012 0800

Client Matrix: Water

Date Received: 01/13/2012 1745

8260B Volatile Organic Compounds (GC/MS)

Analysis Method:	8260B	Analysis Batch:	480-48180	Instrument ID:	HP5973C
Prep Method:	5030B	Prep Batch:	N/A	Lab File ID:	C16985.D
Dilution:	1.0			Initial Weight/Volume:	5 mL
Analysis Date:	01/17/2012 1857			Final Weight/Volume:	5 mL
Prep Date:	01/17/2012 1857				

Analyte	Result (ug/L)	Qualifier	MDL	RL
1,1,1-Trichloroethane	ND		0.82	1.0
1,1,2,2-Tetrachloroethane	ND		0.21	1.0
1,1,2-Trichloroethane	ND		0.23	1.0
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.31	1.0
1,1-Dichloroethane	ND		0.38	1.0
1,1-Dichloroethene	ND		0.29	1.0
1,2,4-Trichlorobenzene	ND		0.41	1.0
1,2-Dibromo-3-Chloropropane	ND		0.39	1.0
1,2-Dibromoethane	ND		0.73	1.0
1,2-Dichlorobenzene	ND		0.79	1.0
1,2-Dichloroethane	ND		0.21	1.0
1,2-Dichloropropane	ND		0.72	1.0
1,3-Dichlorobenzene	ND		0.78	1.0
1,4-Dichlorobenzene	ND		0.84	1.0
2-Hexanone	ND		1.2	5.0
2-Butanone (MEK)	ND		1.3	10
4-Methyl-2-pentanone (MIBK)	ND		2.1	5.0
Acetone	ND		3.0	10
Benzene	ND		0.41	1.0
Bromodichloromethane	ND		0.39	1.0
Bromoform	ND		0.26	1.0
Bromomethane	ND		0.69	1.0
Carbon disulfide	ND		0.19	1.0
Carbon tetrachloride	ND		0.27	1.0
Chlorobenzene	ND		0.75	1.0
Dibromochloromethane	ND		0.32	1.0
Chloroethane	ND		0.32	1.0
Chloroform	ND		0.34	1.0
Chloromethane	ND		0.35	1.0
cis-1,2-Dichloroethene	ND		0.81	1.0
cis-1,3-Dichloropropene	ND		0.36	1.0
Cyclohexane	ND		0.18	1.0
Dichlorodifluoromethane	ND		0.68	1.0
Ethylbenzene	ND		0.74	1.0
Isopropylbenzene	ND		0.79	1.0
Methyl acetate	ND		0.50	1.0
Methyl tert-butyl ether	ND		0.16	1.0
Methylcyclohexane	ND		0.16	1.0
Methylene Chloride	ND		0.44	1.0
Styrene	ND		0.73	1.0
Tetrachloroethene	ND		0.36	1.0
Toluene	ND		0.51	1.0
trans-1,2-Dichloroethene	ND		0.90	1.0
trans-1,3-Dichloropropene	ND		0.37	1.0
Trichloroethene	ND		0.46	1.0
Trichlorofluoromethane	ND		0.88	1.0

Analytical Data

Client: AECOM, Inc.

Job Number: 480-14999-1

Client Sample ID: Trip Blank

Lab Sample ID: 480-14999-3TB

Date Sampled: 01/12/2012 0800

Client Matrix: Water

Date Received: 01/13/2012 1745

8260B Volatile Organic Compounds (GC/MS)

Analysis Method:	8260B	Analysis Batch:	480-48180	Instrument ID:	HP5973C
Prep Method:	5030B	Prep Batch:	N/A	Lab File ID:	C16985.D
Dilution:	1.0			Initial Weight/Volume:	5 mL
Analysis Date:	01/17/2012 1857			Final Weight/Volume:	5 mL
Prep Date:	01/17/2012 1857				

Analyte	Result (ug/L)	Qualifier	MDL	RL
Vinyl chloride	ND		0.90	1.0
Xylenes, Total	ND		0.66	2.0

Surrogate	%Rec	Qualifier	Acceptance Limits
1,2-Dichloroethane-d4 (Surr)	96		66 - 137
Toluene-d8 (Surr)	96		71 - 126
4-Bromofluorobenzene (Surr)	82		73 - 120

Analytical Data

Client: AECOM, Inc.

Job Number: 480-14999-1

General Chemistry

Client Sample ID: EFFLUENT

Lab Sample ID: 480-14999-1

Date Sampled: 01/12/2012 0800

Client Matrix: Water

Date Received: 01/13/2012 1745

Analyte	Result	Qual	Units	MDL	RL	Dil	Method
Total Petroleum Hydrocarbons (1664A)	ND		mg/L	1.9	4.8	1.0	1664A

Analysis Batch: 480-48721

Analysis Date: 01/20/2012 0957

Prep Batch: 480-48694

Prep Date: 01/20/2012 0811

Analyte	Result	Qual	Units	RL	RL	Dil	Method
Total Suspended Solids	6.4		mg/L	4.0	4.0	1.0	SM 2540D

Analysis Batch: 480-48141

Analysis Date: 01/16/2012 2002

pH

8.16

HF

SU

0.100

0.100

1.0

SM 4500 H+ B

Analysis Batch: 480-48332

Analysis Date: 01/17/2012 1936

Analytical Data

Client: AECOM, Inc.

Job Number: 480-14999-1

General Chemistry

Client Sample ID: INFLUENT

Lab Sample ID: 480-14999-2

Date Sampled: 01/12/2012 0800

Client Matrix: Water

Date Received: 01/13/2012 1745

Analyte	Result	Qual	Units	MDL	RL	Dil	Method
Total Petroleum Hydrocarbons (1664A)	ND		mg/L	2.0	5.1	1.0	1664A

Analysis Batch: 480-48721

Analysis Date: 01/20/2012 0957

Prep Batch: 480-48694

Prep Date: 01/20/2012 0811

Analyte	Result	Qual	Units	RL	RL	Dil	Method
Total Suspended Solids	51.2		mg/L	4.0	4.0	1.0	SM 2540D

Analysis Batch: 480-48141

Analysis Date: 01/16/2012 2005

pH

7.95

HF SU

0.100

0.100

1.0

SM 4500 H+ B

Analysis Batch: 480-48332

Analysis Date: 01/17/2012 1939

Login Sample Receipt Checklist

Client: AECOM, Inc.

Job Number: 480-14999-1

Login Number: 14999

List Source: TestAmerica Buffalo

List Number: 1

Creator: Robitaille, Zach L

Question	Answer	Comment
Radioactivity either was not measured or, if measured, is at or below background	True	
The cooler's custody seal, if present, is intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the sample IDs on the containers and the COC.	True	
Samples are received within Holding Time.	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
VOA sample vials do not have headspace or bubble is <6mm (1/4") in diameter.	True	
If necessary, staff have been informed of any short hold time or quick TAT needs	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	False	voas comp
Sampling Company provided.	False	
Samples received within 48 hours of sampling.	True	
Samples requiring field filtration have been filtered in the field.	N/A	
Chlorine Residual checked.	N/A	