



ecology and environment engineering, p.c.

International Specialists in the Environment

BUFFALO CORPORATE CENTER
368 Pleasant View Drive
Lancaster, New York 14086
Tel: (716) 684-8060, Fax: (716) 684-0844

April 5, 2013

Mr. William Welling, Project Manager
New York State Department of Environmental Conservation
Division of Environmental Remediation
625 Broadway, 12th Floor
Albany, New York 12233 - 7013

Re: Mr. C's Dry Cleaners Site, Contract # D007617, Site # 9-15-157
March 2013 Operations, Maintenance, and Monitoring Report

Dear Mr. Welling:

Ecology and Environment Engineering, P.C. (EEEPC) is pleased to provide the March 2013 Operations, Maintenance, and Monitoring (OM&M) Report for the Mr. C's Dry Cleaners Site, NYSDEC Site # 9-15-157, located in East Aurora, New York. Copies of weekly inspection reports prepared by EEEPC's subcontractor, Iyer Environmental Group, PLLC (IEG) are provided in Attachment A. Selected pages from the individual analytical data package prepared by Spectrum Analytical Inc. (SAI), Warwick, Rhode Island are provided as Attachments B. The full analytical reports along with QA/QC information will be retained by EEEPC. Remedial treatment system utility costs for the Mr. C's site is provided as Attachment C.

In review of the on-site treatment system operations, monitoring and maintenance for March 2013, EEEPC offers the following comments and highlights:

Operational Summary

Mr. C's Site – Remedial Operations Information

- Checklists for system inspections from IEG are provided as Attachment A for 3/4/13, 3/19/13, and 4/3/13. Based on the inspection results performed by IEG, the remedial treatment system had an 100% operational up-time (Table 1) and the treatment of contaminated groundwater totaling of 321,888 gallons (Table 2) for March 2013.
- PW-4 was turned off because the transducer reading remains at 22 on March 4, 2013. The blower #2 motor was removed and delivered to S&S Electric for repair, as well as the blower fan. It was observed that effluent Pump#2 made loud rattle upon start up and shut off.
- On the weekly inspection of March 19, 2013, PW-2, PW-4, PW-6 and PW-8 were off due to maintenance problems. The Redux sequestering agent system was temporarily shut off.
- On the weekly inspection of April 3, 2013, PW-2, PW-4, PW-6 and PW-8 were off due to maintenance problems. Pumps and transducers have been ordered the respective locations and each location will be repaired and put back in service in April 2013.

Mr. William Welling, Project Manager

April 5, 2013

Page 2 of 4

- The monthly compliance sampling occurred on February 4, 2013, with the analytical results received on February 11, 2013. The results of the sampling indicated no compliance issues with the effluent discharge requirements for Tetrachloroethene (PCE) or any other contaminants on the SPDES Equivalency Permit.
- The PCE effluent results for March 2013 were 6.4 µg/L. Based on the detection limits, this value was estimated, but still remains within the SPDES Equivalency daily maximum requirements. The analytical results revealed the influent concentration to be 1306 µg/L or 1306 ppb, and 23.65 µg/L or 23.65 ppb of treated effluent. PCE effluent concentrations were 6.4 µg/L or 6.4 ppb which is under the 10 µg/L or 10 ppb limit. The summary of influent and effluent contaminant concentrations for the March 2013 sampling event is presented in Table 4.
- The cleanup efficiency for the contaminants of concern at the site during the reporting / operating period 3/4/13 to 4/3/13 was 98.19%. The air stripper unit on the Mr. C's property is currently in compliance and SAI continues to provide analytical data to sub-ppb accuracy, supporting the accurate determination of effluent contaminant levels. The summary of Effluent Discharge Criteria & Analytical Compliance Results for March 2013 is presented in Table 3.
- The Mr. C's treatment system based on the total monthly flows has effectively removed 3.44 lbs. of targeted contaminants from the groundwater below the site in the month of March 2013. The calculations and data for the month are presented in Table 5.

Mr. C's Site – Updated Property Information

- Contact information regarding the property owner and party leasing the Mr. C's building was provided to the NYSDEC. The information provided is as follows: Property owner (586 Main Street) – DelTora LLC – Owner - Mr. Paul Bendrowski – 231-313-1954 (Traverse City, MI) – Local Point of Contact – Bob Kowal - . Property Lease – Intrepid Automotive Partners – Dave Kern – 716-481-5703 (East Aurora, NY).

Agway Site Remedial Information

- The Agway facility treatment unit was turned off in December 2011.
- Contact again was made on December 13, 2012, from (Liz Megan, Architect, 716-901-3029) regarding the redevelopment of the former Agway for a single story building without a basement. Information forthcoming on conceptual design for the Agway site. Contact information was passed onto NYSDEC PM regarding the discussion.
- EEEPC performed review of the conceptual plan for a building at the 566 Main Street site. Conflicts are observed with the pumping and monitoring wells at the site. Site documents and calculations regarding the amount of groundwater pumped and concentrations that attribute to the levels of contamination were issued to the NYSDEC PM.

Subslab Depressurization Systems (SSDS) – First Presbyterian Church and 27 Whaley Ave. sites

- Performed annual SSDS inspections at the 1st Presbyterian Church on December 3, 2012. No current operational issues noted. All systems are fully operational.
- Draft SOP sampling procedure submitted to NYSDEC PM, Region 9 NYSDEC and NYSDOH contact for review and comment.
- Site inspection of facility on February 20, 2013, revealed that the south SSDS unit was shut off. System was switched back on by field staff. EEEPC to review the removal of the switch for this fan to provide continuous operations.

Baseline Sampling – Bioaugmentation Work

- Baseline sampling for the bioaugmentation “pilot” study was performed on November 2, 2012 at four monitoring well location around the Mr. C’s site.
- Analytical results due at the end of November and evaluated for incorporation in the procurement document for subcontractor installation.
- Procurement to be performed in March 2013. Bioaugmentation field work injections to be performed in May 2013.
- Monthly monitoring and analyses to be performed for twelve months to evaluate the effectiveness of the “pilot” installation on the groundwater from the local area monitoring wells.

Mr. C’s and Agway Energy Usage Information

- A copy of the site utility costs from the Mr. C’s and Agway remedial operations for January through December 2013 are provided as Attachment C.
- The Agway system power was turned off in December 2011. National Grid has disconnected the power to the Agway system. The meter and wiring are expected to be removed by National Grid in April 2013.

Soil Vapor Intrusion Investigation Program

- Soil vapor intrusion investigation, surveys, and sampling were performed at three out four properties surrounding the Mr. C’s site on March 6, 7, and 20, 2013. The three properties included the Mr. C’s Indoor Air (586 Main Street), The Browschidle building (578-580 Main Street), and the Doeing Building (572-576 Main Street). The Pitt property (19 Whaley Avenue) would not allow access.
- Analytical results have been received for all three locations and a report will be prepared for delivery in April 2013.


Site Management Plan

- Issued the draft Site Management Plan (SMP) on December 28, 2012 for review and comment. The SMP was revised to be consistent with the new NYSDEC template format.

Mr. William Welling, Project Manager
April 5, 2013
Page 4 of 4

If you have questions regarding the March 2013 OM&M report summary, please do not hesitate to contact me at 716-684-8060.

Very Truly Yours,
Ecology and Environment Engineering, P. C.

A handwritten signature in black ink that reads "Michael G. Steffan". The signature is written in a cursive style with a large, prominent initial "M".

Michael G. Steffan
Project Manager

cc: D. Szymanski, Region 9, NYSDEC - Buffalo w/ attachments
D. Iyer, IEG - w/attachments
CTF- EN-003229-0001-03TTO

Table 1
Mr. C's Dry Cleaners Site Remediation
Site #9-15-157
System Operational Time

Month	Reporting Hours	Operational Up-time
(Up-time from inception to 12/31/12)	87,871.50	96.63%
January 7, 2013 - February 4, 2013	576	85.71%
February 4, 2013 - March 4, 2013	594	88.39%
March 4, 2013 - April 3, 2013	720	100.00%
		#DIV/0!
		#DIV/0!
		#DIV/0!
		#DIV/0!
		#DIV/0!
		#DIV/0!
		#DIV/0!
		#DIV/0!
		#DIV/0!
		#DIV/0!
Total Hours from System Startup '2/02'	89,761.50	
Average Operational Up-time from startup =		96.52%
Average Operational Up-time for 2013 =		91.57%

NOTES:

1. Up-time based as percentage of total reporting hours.
2. Treatment system operated by the Tyree Organization Ltd. from 9/02 - 9/03.
3. Treatment system operated by O&M Enterprises Inc. from 10/03 - 7/07.
4. Treatment system operated by Iyer Environmental Group from 7/07 to present.

Table 2
Mr. C's Dry Cleaners Site Remediation
Site #9-15-157
Monthly Process Water Volumes

Month	Actual Period	Gallons (Treated Effluent)
Total - Inception to December 2012	9/5/02 - 12/4/12	118,436,077
January 2013 ³	1/7/13 - 2/4/13	261,527
February 2013 ³	2/4/13 - 3/4/13	242,509
March 2013 ³	3/4/13 - 4/3/13	321,888
April 2013 ³		0
May 2013		0
June 2013		0
July 2013		0
August 2013		0
September 2013		0
October 2013		0
November 2013		0
December 2013		0
Total Gallons Treated in 2013		825,924
Total Gallons Treated To Date:		119,262,001

NOTES:

1. System operated by Tyree Organization Ltd. From 9/02 - 9/03.
2. System operated by O&M Enterprises from 10/03 - 7/07.
3. System operated by IEG PLLC from 7/07 - present.

Table 3
Mr. C's Dry Cleaners Site Remediation
Site #9-15-157
Effluent Discharge Criteria & Analytical Compliance Results

Parameter/Analyte	Daily Maximum ¹	Units	March 4, 2013 - Effluent Analytical Values - Compliance
Flow	N/A	gpd	8,661
pH	6.0 - 9.0	standard units	8.00
1,1 Dichloroethene	10	µg/L	ND(<1.0)
1,1 Dichloroethane	10	µg/L	ND(<1.0)
cis-1,2-dichloroethene	10	µg/L	0.82 J
Trichloroethene	10	µg/L	ND(<1.0)
Tetrachloroethene	10	µg/L	5.0
Vinyl Chloride	10	µg/L	ND(<1.0)
Benzene	5	µg/L	ND(<1.0)
Ethylbenzene	5	µg/L	ND(<1.0)
Methylene Chloride	10	µg/L	ND(<1.0)
1,1,1 Trichloroethane	10	µg/L	ND(<1.0)
Toluene	5	µg/L	ND(<1.0)
Methyl-t-Butyl Ether (MTBE)	NA	ug/L	0.82 J
o-Xylene ²	5	µg/L	NA
m, p-Xylene ²	10	µg/L	NA
Total Xylenes	NA	ug/L	ND(<1.0)
Iron, total	600	µg/L	NA ³
Aluminum	4,000	µg/L	NA ³
Copper	48	µg/L	NA ³
Lead	11	µg/L	NA ³
Manganese	2,000	µg/L	NA ³
Silver	100	µg/L	NA ³
Vanadium	28	µg/L	NA ³
Zinc	230	µg/L	NA ³
Total Dissolved Solids	850	mg/L	NA ³
Total Suspended Solids	20	mg/L	NA ³
Hardness	N/A	mg/L	570
Cyanide, Free	10	µg/L	NA ³

NOTES:

- "Daily Maximum" excerpted from Attachment E of Addendum 1 to the Construction Contract Documents dated October 2000.
- Analytical report did not differentiate between o-Xylene and m, p-Xylene. Total Xylene value reported is given in each line.
- Shaded cells indicate that analytical value exceeds the "Daily Maximum."
- "ND" indicates that the compound was not detected and lists the practical quantitation limit in parentheses.
- "NA" indicates that analyses were not performed and data is unavailable.
- Average flows based on effluent readings taken March 4, 2013 through April 3, 2013. Total gallons: 321,888 divided by 30 operating days.
- "J" indicates an estimated value below the detection limit.
- "B" indicates analyte found in the associated blank.
- Removed from the required analysis list by NYSDEC Region 9 in February 2005.

40 Indicates non-compliance with the NYSDEC effluent discharge requirements
NR Indicates Not Reported by Lab

Table 4
Mr. C's Dry Cleaners Site Remediation
NYSDEC Site #9-15-157
March 2013 VOC Analytical Summary

Compound	Based on the 3/4/13 Effluent Sampling Results		
	Influent Concentration* (ug/L)	Effluent Concentration* (ug/L)	Cleanup Efficiency** (%)
Acetone	ND (<50.0)	U	NA
Benzene	ND (<10.0)	U	NA
2-Butanone	ND (<50.0)	U	NA
cis-1, 2-Dichloroethene	59.0	0.6	98.46%
Chloroform	ND (<10.0)	U	NA
Methylene chloride	ND (<10.0)	U	NA
Methyl tert-butyl ether (MTBE)	ND (<10.0)	U	NA
Tetrachloroethene	1200.0	6.40	99.47%
Toluene	ND (<10.0)	U	NA
Trichloroethene	67.0	0.65	99.03%
Carbon Disulfide	ND (<10.0)	U	NA
1,1,2 Trichloro-1,2,2-trifluoroethane	ND (<10.0)	U	NA
Cyclohexane	ND (<10.0)	U	NA
trans-1,2-dichloroethene	ND (<10.0)	U	NA
Chlorobenzene	ND (<10.0)	U	NA
Methylcyclohexane	ND (<10.0)	U	NA
Methyl acetate	ND (<10.0)	U	NA
Total Xylenes	ND (<10.0)	U	NA
March 2013 TOTALS (in ug/L) =	1306.0	23.65	98.19%

- Notes:
1. "NA" = Not applicable
 2. "U" = Compound analyzed, but was not detected. Detection limit in parentheses.
 3. "DJ" or "J" indicates an estimated value below the practical quantitation limit but above the method detection limit.
 4. Non-detect values are assumed to be equal to zero for calculation of monthly average concentrations.
 5. "D" indicates the compound concentration was obtained from a secondary dilution analysis.

* (<50) - Detection Limit
 ** Contaminants of Concern only

Table 5
Mr. C's Dry Cleaners Site Remediation
Site #9-15-157
Monthly VOCs Removed From Groundwater

Month	Actual Period	Influent VOCs (µg/L)	Effluent VOCs (µg/L)	VOCs Removed (lbs.)
Total pounds of VOCs removed from inception to December 2012 =				1556.45
January 2013	01/7/13 - 2/4/13	1094.9	0.91	2.39
February 2013	2/4/13 - 3/4/13	1112.2	12.44	2.23
March 2013	3/4/13 - 4/3/13	1306.0	23.65	3.44
April 2013				0.00
May 2013				0.00
June 2013				0.00
July 2013				0.00
August 2013				0.00
September 2013				0.00
October 2013				0.00
November 2013				0.00
December 2013				0.00
Total pounds of VOCs removed from inception =				1,564.51
Total pounds of VOCs removed in 2013 =				8.06

HISTORICAL NOTES:

1. Calculations are based on monthly water samples and assumes samples are representative of the entire reporting period.
2. Calculations assume that non-detect values = 0 ug/L.
3. Total VOCs summations include estimated "J" values.
4. Calculations are based on effluent totalizer readings.
5. "Influent VOCs" and "Effluent VOCs" values given above is the summation of values for individual compounds given in monthly analytical reports.
6. No samples were collected in September 2003. August 2003 values are used.
7. Treatment system operated by Tyree Organization, Ltd. from 9/02 to 9/03.
8. Treatment system operated by O&M Enterprises from 10/03 to 7/07.
9. Treatment system operated by IEG from 7/07 to present.

CONVERSIONS:

1 pound = 453.5924 grams
1 gallon = 3.785 liters

Based on the Analytical Results from Each Month:

Pounds of VOCs removed calculated by the following formula:

$$(VOCs_{Influent} - VOCs_{Effluent})(\mu g/L) \cdot (1g/10^6 \mu g) \cdot (1 \text{ lb}/453.5924 \text{ g}) \cdot (\text{Monthly process water})(\text{gal}) \cdot (3.785 \text{ L/gallon})$$

Attachment A
IEG Weekly Inspection Reports
March 2013

Including:

3/4/13

3/19/13

4/3/13

MR. C's DRY CLEANERS SITE
NYSDEC Site #9-15-157
OM&M: SITE INSPECTION FORM

DATE: 4-Mar-13 ACTIVITIES: Site Inspection

INSPECTION PERSONNEL: R. Allen OTHER PERSONNEL: Acome Construction, Ramsey Renovations

WEATHER CONDITIONS: Cloudy, cold OUTSIDE TEMPERATURE (° F): 30

ARE WELL PUMPS OPERATING IN AUTO: YES: NO: If "NO", provide explanation below
PW-6 and PW-8 are OFF due to maintenance problems.

PROVIDE WATER LEVEL READINGS ON CONTROL PANEL

RW-1	ON: <input checked="" type="checkbox"/>	OFF: <input type="checkbox"/>	<u>6</u> ft	PW-5	ON: <input checked="" type="checkbox"/>	OFF: <input type="checkbox"/>	<u>5</u> ft
PW-2	ON: <input type="checkbox"/>	OFF: <input checked="" type="checkbox"/>	<u>6</u> ft	PW-6	ON: <input type="checkbox"/>	OFF: <input checked="" type="checkbox"/>	<u>65507</u> ft
PW-3	ON: <input type="checkbox"/>	OFF: <input checked="" type="checkbox"/>	<u>6</u> ft	PW-7	ON: <input type="checkbox"/>	OFF: <input checked="" type="checkbox"/>	<u>4</u> ft
PW-4	ON: <input checked="" type="checkbox"/>	OFF: <input type="checkbox"/>	<u>22</u> ft	PW-8	ON: <input type="checkbox"/>	OFF: <input checked="" type="checkbox"/>	<u>65508</u> ft

EQUALIZATION TANK: 3 ft Last Alarm D/T/Condition: 2/15/13 Air Stripper Low Level

NOTES: PW-4 - turned OFF because transducer reading remains at 22

INFLUENT FLOW RATE: 5 gpm INFLUENT TOTALIZER READING: 7,093,906.0 gallons

SEQUESTERING AGENT DRUM LEVEL: 6 inches (x 1.7=) AMOUNT OF AGENT REMAINING: 10 gallons
 SEQUESTERING AGENT FEED RATE: ----- ml/min METERING PUMP PRESSURE: ----- psi

		Top	Bottom		Top	Bottom
BAG FILTER PRESSURES:	LEFT:	<u>0</u>	<u>0</u> psi	RIGHT:	<u>6</u>	<u>0</u> psi

INFLUENT FEED PUMP IN USE: #1 #2 INFLUENT PUMP PRESSURE: 12 psi

AIR STRIPPER BLOWER IN USE: #1 #2 AIR STRIPPER PRESSURE: 10.0 in. H₂O
 AIR STRIPPER DIFFERENTIAL PRESSURE: 0.004 in. H₂O DISCHARGE PRESSURE: 3.5 in. H₂O

EFFLUENT PUMP IN USE: #1 #2 EFFLUENT FEED PUMP PRESSURE: 5.0 psi
 EFFLUENT FLOW RATE: 112 gpm EFFLUENT TOTALIZER READING: 70,519,343 14990 gallons

ARE BUILDING HEATERS IN USE? YES: NO: INSIDE TEMPERATURE (° F): 57

IS SUMP PUMP IN USE: YES: NO: ARE ANY LEAKS PRESENT? YES: NO:
 WATER LEVEL IN SUMP: 7.0 in. TREATMENT BUILDING CLEAN & ORGANIZED? YES: NO:

MR. C's DRY CLEANERS SITE
NYSDEC Site #90150157
SITE INSPECTION FORM

4-Mar-13

SAMPLES COLLECTED? YES: NO:

	Sample ID	Time of Sampling	pH	Turbidity	Temp.	Sp. Cond.
AIR STRIPPER INFLUENT:	INF	11:00 AM	7.45	6.25	11.2	2791
AIR STRIPPER EFFLUENT:	EFF	11:00 AM	8.43	6.30	11.6	2848

IS THERE EVIDENCE OF TAMPERING/VANDALISM OF WELLS: ? YES: NO:

WERE MANHOLES INSPECTED? YES: NO:

WERE ELECTRICAL BOXES INSPECTED? YES: NO:

IS WATER PRESENT IN ANY MANHOLES OR ELECTRICAL BOXES? YES: NO:

If yes, provide manhole/electric box ID and description of any corrective measures below:

PW-4 has collapsed inner ring. Snow is covering many MWs and UEs.

INCLUDE REMARKS & DESCRIBE ANY OTHER SYSTEM MAINTENANCE PERFORMED ON MR. C's SITE

Remarks: Need sample kit - cold bottles and HNO3 bottles

Other Actions: Removed Blower #2 motor and delivered to S&S Electric for repair. Delivered blower fan to S&S Electric for repair.

Effluent Pump #2 makes loud rattle upon start up and shut off.

AGWAY

SYSTEM VACUUM: _____ In. H ₂ O			AIR PRESSURE: _____ psi		
SP-1: _____	scfm _____	psi _____	SP-5 _____	scfm _____	psi _____
SP-2: _____	scfm _____	psi _____	SP-6 _____	scfm _____	psi _____
SP-3: _____	scfm _____	psi _____	SP-7 _____	scfm _____	psi _____
SP-4: _____	scfm _____	psi _____	SP-8 _____	scfm _____	psi _____

INCLUDE REMARKS & DESCRIBE ANY OTHER SYSTEM MAINTENANCE PERFORMED ON AGWAY SITE

Remarks: System is OFF until further instructions.

Other Actions:

MR. C's DRY CLEANERS SITE
NYSDEC Site #9-15-157
OM&M: SITE INSPECTION FORM

DATE: 19-Mar-13 ACTIVITIES: Site Inspection

INSPECTION PERSONNEL: R. Allen OTHER PERSONNEL: -----

WEATHER CONDITIONS: Cloudy, cool OUTSIDE TEMPERATURE (°F): 32

ARE WELL PUMPS OPERATING IN AUTO: YES: NO: ✓ If "NO", provide explanation below

PW-2, PW-4, PW-6 and PW-8 are OFF due to maintenance problems.

PROVIDE WATER LEVEL READINGS ON CONTROL PANEL

RW-1	ON: <u> </u>	OFF: <u> ✓ </u>	<u> 7 </u> ft	PW-5	ON: <u> </u>	OFF: <u> ✓ </u>	<u> 4 </u> ft
PW-2	ON: <u> ✓ </u>	OFF: <u> </u>	<u> 10 </u> ft	PW-6	ON: <u> </u>	OFF: <u> ✓ </u>	<u>65507</u> ft
PW-3	ON: <u> </u>	OFF: <u> ✓ </u>	<u> 4 </u> ft	PW-7	ON: <u> </u>	OFF: <u> ✓ </u>	<u> 7 </u> ft
PW-4	ON: <u> ✓ </u>	OFF: <u> </u>	<u> 14 </u> ft	PW-8	ON: <u> </u>	OFF: <u> ✓ </u>	<u>65507</u> ft

EQUALIZATION TANK: 4 ft Last Alarm D/T/Condition: 3/14/13 Air Stripper Low Level

NOTES:

INFLUENT FLOW RATE: 12 gpm INFLUENT TOTALIZER READING: 7,364,110.0 gallons

SEQUESTERING AGENT DRUM LEVEL: 6 inches (x 1.7=) AMOUNT OF AGENT REMAINING: 10 gallons

SEQUESTERING AGENT FEED RATE: ----- ml/min METERING PUMP PRESSURE: ----- psi

		Top	Bottom		Top	Bottom
BAG FILTER PRESSURES:	LEFT:	<u> 0 </u>	<u> 0 </u> psl	RIGHT:	<u> 6 </u>	<u> 0 </u> psi

INFLUENT FEED PUMP IN USE: #1 ✓ #2 INFLUENT PUMP PRESSURE: 12 psi

AIR STRIPPER BLOWER IN USE: #1 ✓ #2 AIR STRIPPER PRESSURE: 10.0 in. H₂O

AIR STRIPPER DIFFERENTIAL PRESSURE: 0.003 in. H₂O DISCHARGE PRESSURE: 3.6 in. H₂O

EFFLUENT PUMP IN USE: #1 #2 ✓ EFFLUENT FEED PUMP PRESSURE: 3.0 psi

EFFLUENT FLOW RATE: 0.003 gpm EFFLUENT TOTALIZER READING: 70,681,284 | 180460 gallons

ARE BUILDING HEATERS IN USE? YES: ✓ NO: INSIDE TEMPERATURE (°F): 60

IS SUMP PUMP IN USE: YES: ✓ NO: ARE ANY LEAKS PRESENT? YES: NO: ✓

WATER LEVEL IN SUMP: 6.5 in. TREATMENT BUILDING CLEAN & ORGANIZED? YES: ✓ NO:

MR. C's DRY CLEANERS SITE
NYSDEC Site #90150157
SITE INSPECTION FORM

19-Mar-13

SAMPLES COLLECTED? YES: _____ NO: √

	Sample ID	Time of Sampling	pH	Turbidity	Temp.	Sp. Cond.
AIR STRIPPER INFLUENT:	_____	_____	_____	_____	_____	_____
AIR STRIPPER EFFLUENT:	_____	_____	_____	_____	_____	_____

IS THERE EVIDENCE OF TAMPERING/VANDALISM OF WELLS? YES: _____ NO: √

WERE MANHOLES INSPECTED? YES: √ NO: _____

WERE ELECTRICAL BOXES INSPECTED? YES: √ NO: _____

IS WATER PRESENT IN ANY MANHOLES OR ELECTRICAL BOXES? YES: √ NO: _____

If yes, provide manhole/electric box ID and description of any corrective measures below:

PW-4 has collapsed inner ring. Snow and water is covering some MWs and UEs.

INCLUDE REMARKS & DESCRIBE ANY OTHER SYSTEM MAINTENANCE PERFORMED ON MR. C's SITE

Remarks: Redux system is temporarily shut off.

Other Actions:

AGWAY

SYSTEM VACUUM: _____ in. H ₂ O			AIR PRESSURE: _____ psi		
SP-1:	_____ scfm	_____ psi	SP-5:	_____ scfm	_____ psi
SP-2:	_____ scfm	_____ psi	SP-6:	_____ scfm	_____ psi
SP-3:	_____ scfm	_____ psi	SP-7:	_____ scfm	_____ psi
SP-4:	_____ scfm	_____ psi	SP-8:	_____ scfm	_____ psi

INCLUDE REMARKS & DESCRIBE ANY OTHER SYSTEM MAINTENANCE PERFORMED ON AGWAY SITE

Remarks: System is OFF until further instructions.

Other Actions:

MR. C's DRY CLEANERS SITE
NYSDEC Site #9-15-157
OM&M: SITE INSPECTION FORM

DATE: 3-Apr-13 ACTIVITIES: Site Inspection

INSPECTION PERSONNEL: R. Allen OTHER PERSONNEL: _____

WEATHER CONDITIONS: Cloudy, snow flurries, cold OUTSIDE TEMPERATURE (° F): 30

ARE WELL PUMPS OPERATING IN AUTO: YES: _____ NO: If "NO", provide explanation below
PW-2, PW-4, PW-6 and PW-8 are OFF due to maintenance problems.

PROVIDE WATER LEVEL READINGS ON CONTROL PANEL

RW-1	ON: _____	OFF: <input checked="" type="checkbox"/> <u>8</u> ft	PW-5	ON: _____	OFF: <input checked="" type="checkbox"/> <u>6</u> ft
PW-2	ON: <input checked="" type="checkbox"/>	OFF: _____ <u>10</u> ft	PW-6	ON: _____	OFF: <input checked="" type="checkbox"/> <u>65507</u> ft
PW-3	ON: _____	OFF: <input checked="" type="checkbox"/> <u>5</u> ft	PW-7	ON: _____	OFF: <input checked="" type="checkbox"/> <u>5</u> ft
PW-4	ON: <input checked="" type="checkbox"/>	OFF: _____ <u>13</u> ft	PW-8	ON: _____	OFF: <input checked="" type="checkbox"/> <u>65507</u> ft

EQUALIZATION TANK: 5 ft Last Alarm D/T/Condition: 3/14/13 Air Stripper Low Level

NOTES: _____

INFLUENT FLOW RATE: 27 gpm INFLUENT TOTALIZER READING: 7,629,082.0 gallons

SEQUESTERING AGENT DRUM LEVEL: 6 Inches (x 1.7=) AMOUNT OF AGENT REMAINING: 10 gallons

SEQUESTERING AGENT FEED RATE: ----- ml/min METERING PUMP PRESSURE: ----- psi

		Top	Bottom		Top	Bottom
BAG FILTER PRESSURES:	LEFT:	<u>0</u>	<u>0</u> psi	RIGHT:	<u>6</u>	<u>0</u> psi

INFLUENT FEED PUMP IN USE: #1 #2 _____ INFLUENT PUMP PRESSURE: 12 psi

AIR STRIPPER BLOWER IN USE: #1 #2 _____ AIR STRIPPER PRESSURE: 15.0 in. H₂O

AIR STRIPPER DIFFERENTIAL PRESSURE: 0.003 in. H₂O DISCHARGE PRESSURE: 3.2 in. H₂O

EFFLUENT PUMP IN USE: #1 _____ #2 EFFLUENT FEED PUMP PRESSURE: 5.0 psi

EFFLUENT FLOW RATE: 116 gpm EFFLUENT TOTALIZER READING: 70,841,231 343780 gallons

ARE BUILDING HEATERS IN USE? YES: NO: _____ INSIDE TEMPERATURE (° F): 58

IS SUMP PUMP IN USE: YES: NO: _____ ARE ANY LEAKS PRESENT? YES: _____ NO:

WATER LEVEL IN SUMP: 6.0 in. TREATMENT BUILDING CLEAN & ORGANIZED? YES: NO: _____

MR. C's DRY CLEANERS SITE
NYSDEC Site #90150157
SITE INSPECTION FORM

3-Apr-13

SAMPLES COLLECTED? YES: NO:

	Sample ID	Time of Sampling	pH	Turbidity	Temp.	Sp. Cond.
AIR STRIPPER INFLUENT:	_____	_____	_____	_____	_____	_____
AIR STRIPPER EFFLUENT:	_____	_____	_____	_____	_____	_____

IS THERE EVIDENCE OF TAMPERING/VANDALISM OF WELLS? YES: NO:

WERE MANHOLES INSPECTED? YES: NO:

WERE ELECTRICAL BOXES INSPECTED? YES: NO:

IS WATER PRESENT IN ANY MANHOLES OR ELECTRICAL BOXES? YES: NO:

If yes, provide manhole/electric box ID and description of any corrective measures below:

PW-4 has collapsed inner ring. Puddles are covering some MWs and UEs.

INCLUDE REMARKS & DESCRIBE ANY OTHER SYSTEM MAINTENANCE PERFORMED ON MR. C's SITE

Remarks: Spectrum Analytical sent (2) sample coolers with only half the required bottles.

Other Actions:

AGWAY

SYSTEM VACUUM: _____ in. H ₂ O			AIR PRESSURE: _____ psi		
SP-1:	_____ scfm	_____ psi	SP-5	_____ scfm	_____ psi
SP-2:	_____ scfm	_____ psi	SP-6	_____ scfm	_____ psi
SP-3:	_____ scfm	_____ psi	SP-7	_____ scfm	_____ psi
SP-4:	_____ scfm	_____ psi	SP-8	_____ scfm	_____ psi

INCLUDE REMARKS & DESCRIBE ANY OTHER SYSTEM MAINTENANCE PERFORMED ON AGWAY SITE

Remarks: System is OFF until further instructions.

Other Actions:

MR. C's DRY CLEANERS SITE

NYSDEC Site #9-15-157

OM&M: PIEZOMETER WATER LEVEL LOG

Date: 11-Mar-13

Measurements taken by: R. Allen

RW-1	17.60 ft	Comments:
PZ-1A	11.06 ft	Comments:
PZ-1B	10.82 ft	Comments:
PZ-1C	11.96 ft	Comments:
PZ-1D	12.09 ft	Comments:
PW-2	16.10 ft	Comments:
PZ-2A	10.63 ft	Comments:
PZ-2B	10.97 ft	Comments:
PZ-2C	10.45 ft	Comments:
MW-7	11.00 ft	Comments: Substitute for 2D
PW-3	15.90 ft	Comments:
PZ-3A	11.12 ft	Comments:
PZ-3B	----- ft	Comments: Covered with snowpile
PZ-3C	11.65 ft	Comments:
PZ-3D	11.18 ft	Comments:
PW-4	----- ft	Comments: Damaged Ring
PZ-4A	11.36 ft	Comments:
PZ-4B	10.48 ft	Comments:
PZ-4C	----- ft	Comments: Sealed Over
PZ-4D	10.10 ft	Comments:

PW-5	14.60 ft	Comments:
PZ-5A	10.51 ft	Comments:
PZ-5B	10.47 ft	Comments:
PZ-5C	10.04 ft	Comments:
PZ-5D	10.89 ft	Comments:
PW-6	6.20 ft	Comments:
PZ-6A	11.28 ft	Comments:
PZ-6B	11.17 ft	Comments:
PZ-6C	11.52 ft	Comments:
PZ-6D	11.09 ft	Comments: Shown as RW-2 on map
PW-7	19.90 ft	Comments:
MPI-6S	10.94 ft	Comments:
PZ-7B	11.16 ft	Comments:
OW-B	11.05 ft	Comments:
PZ-7D	10.81 ft	Comments:
PW-8	7.20 ft	Comments:
PZ-8A	7.85 ft	Comments:
PZ-8B	7.78 ft	Comments:
PZ-8C	7.48 ft	Comments:
PZ-8D	7.71 ft	Comments:

PUMPS IN OPERATION DURING MEASUREMENTS

RW-1 pump on?	Yes	<input checked="" type="checkbox"/>	No
PW-2 pump on?	Yes	<input checked="" type="checkbox"/>	No
PW-3 pump on?	Yes	<input checked="" type="checkbox"/>	No
PW-4 pump on?	Yes	<input type="checkbox"/>	No

PW-5 pump on?	Yes	<input checked="" type="checkbox"/>	No
PW-6 pump on?	Yes	<input checked="" type="checkbox"/>	No
PW-7 pump on?	Yes	<input checked="" type="checkbox"/>	No
PW-8 pump on?	Yes	<input checked="" type="checkbox"/>	No

Mr. C's CLEANERS OM&M

SUMMARY OF FIELD ACTIVITIES BY IEG - 3/2013

DATE	ACTIVITY
1-Mar	Respond to AutoAlarm. Meet with IAE and Ramsey Renovations.
4-Mar	Blower Motor work. Weekly Inspection. Get supplies.
5-Mar	Meet with Ramsey Renovations. Put cement in container. Photograph inside of Electric Boxes. Get Supplies.
6-Mar	Sampling
11-Mar	Piezometer Readings. UM office work.
12-Mar	OM&M Weekly Inspection. Meeting with E&E, Inc. Changed bag filters.
14-Mar	Air Stripper - brush trays through access ports. Record transducer inventory.
19-Mar	OM&M Weekly Inspection. UM office work.
25-Mar	OM&M Weekly Inspection.
26-Mar	Record new Well Pumps
29-Mar	UM office work

Mr. C's CLEANERS OM&M
STATUS OF FIELD ACTIVITIES BY IEG - 3/2013

ACTIVITY	DESCRIPTION	COMPLETION DATE/STATUS
Repair Blower #2	Determined bearing is falling in A.S. blower motor. Replaced motor with new motor - but replacement motor was defective; pulled motor for warranty repair. Balanced blower fan before reinstalling.	Jun-12
PW-4 Well Repair and Level	Asphalt around PW-4 well has sunk, due to collapse of corroded inner ring. Replace inner ring and bring parking lot up to level with asphalt patch.	in progress
PW-4 UE Level	Asphalt around Underground Enclosure has sunk, leaving it vulnerable to damage. Bring parking lot up to level with asphalt patch.	In progress
Rebuild JAC Pump as needed	Jesco America Corp recommends rebuilding the Redux pump when needed. Purchased rebuild kit.	in progress
Brace Effluent Pipe	David Szymanski (NYSDEC) inspected Treatment Room and said that the effluent pipe should be braced in (3) places to the north wall.	in progress
Inspect and clean Manholes	Inspect manholes near operating pumps. Pump out water in manholes and clean out remaining sediment and other material.	in progress
Trim Broken Piezometers	Many of the piezometers are broken. Measuring water levels is not precise when a pipe is broken. Identify and trim all broken piezometers.	in progress
Cool Treatment Room	Temperature in Treatment Room is well above 90 degrees during the summer months. Need to increase outside air inflow to the room.	in progress
Replace Air Stripper Exhaust	Present Air Stripper exhaust is very heavy and leaks moisture. Replace with lighter system.	In progress
Demobilize Agway Shed	Remove all equipment from shed and deliver to owner/recycle/dispose as needed; dismantle electrical installations; disassemble/remove shed structure/base.	on hold
PW-7 pitless adapter	Pitless adapter does not seal well. Repair or replace pitless adapter	in progress
PW-8 pitless adapter	Pitless adapter feels broken/does not seal well. Repair/replace pitless adapter	in progress
PZ-1B Repair	Top cover was knocked off and lost by snowplow. Replace inner ring and lower height so MW will not be as susceptible to snowplow damage.	Oct-12
Adjust Air Stripper	Effluent lab results were below standard. Troubleshoot and adjust Air Stripper to achieve better results.	Nov-12
Mr Cs Building Remodel	The Mr Cs building is being remodeled - In May, it included siding and lights around the Treatment Room. Photo document the remodeling.	Aug-12
Mr Cs Parking Lot Repaving	During early June the paved parking lot is being repaved. Talk to property manager and paving contractors about MWs and UEs. Photo document the remodeling.	Jun-12
Auto Alarm will not program	Remove Verbatim Auto Alarm and send to RACO for repair. Reinstall repaired unit.	Jun-12
Replace Discharge Vent Cap	Air Stripper exhaust vent is not large enough and creates too much backpressure. Replace existing cap with one that has a larger exhaust vent.	Oct-12
Replace Panelview Bulb	OEM bulb burns very hot and is expensive to replace. Replace with aftermarket bulb that burns cooler and lasts longer.	Oct-12
PW-6 and PW-7 are not pumping down	Inspect and clean pump and transducer. Suspect horizontal lines are clogged with iron oxide/sediment. Inspect pitless adapter to gauge condition of horizontal lines; awaiting Work Plan approval to get replacement pumps. Replace existing pumps with stronger units and treat system with CLR.	Nov-12
PW-8 is not pumping down	Inspect/clean pump & transducer. Suspect horizontal lines are clogged with iron oxide/sediment. Inspect pitless adapter to gauge condition of horizontal lines; Replace existing pumps with stronger units and treat system with CLR.	Dec-12
Blower #2 makes loud noise	Fan seems to have slipped off of the motor shaft. Disassemble, inspect and repair.	in progress
Temperature Alarm dials in very cold weather	Moved electric heater from Agway Shed to treatment room to warm Main Control Panel	Jan-13
PW-8 cycles erratically	Transducer appears defective. Inspect/clean transducer and aneroid bellows.	In progress

Mr. C's CLEANERS OM&M
SUMMARY OF WATER PUMP MAINTENANCE BY IEG - 2013

as of Mar 2013

ID	CLEAN & INSPECT PUMP	REPLACED PUMP	REPAIR PUMP	PITLESS ADAPTER	HORIZONTAL PIPE	CLEAN & INSPECT TRANSDUCER	REPLACE TRANSDUCER	REPAIR TRANSDUCER	PUMP OUT WELL	CLEAN OUT & INSPECT ELECTRICAL BOX	ELECTRICAL BOX REPAIR
RW - 1	Jan 08, May 10, Jan 12	Feb 08, Jan 12	May 10, Nov 08			May 10, Jan 12					
PW - 2	Jun 08, Aug 09, May 10	Jul-08				Nov 11, May 10	Sep 09, Dec 11		Aug-09	Nov-11	Sep-09
PW - 3	Jun 08, Aug 09, May 10	Jul 08, Dec 11		Repair adapter		Aug 09, Nov 11	Dec 11		Aug-09	Nov-11	
PW - 4	Dec 07, May 08, Sep 09, May 10, Jan 12	Dec 07, Jan 12				May 10, Nov 11	Dec 11, Mar 08, Sep 08	Sep-08	Jul 09, Sep 09	Sep 09, Nov 11	Sep-09
PW - 5	Jan 12, May 08	Jul 08, Jan 12				Mar-11	Jan 12, Sep 08	Sep-09		Jan-12	
PW - 6	Jun 08, Jul 09, Jul 12, Nov 12	Jun 08, Jul 09, Aug 12, Nov 12			Jul 12, Nov 12	Aug 09, Jul 12, Dec 12	Sep-09	Jun-08	Aug-09	Aug 09, Sep 09	Jul 09, Sep 09
PW - 7	Jun 08, Jul 09, May 10, Oct 10, Aug 11, Mar 12, Jul 12, Nov 12	Nov 07, Jul 09, Oct 10, Nov 12			Jul 12, Nov 12	Oct 10, Aug 11, Mar 12, Jul 12, Dec 12		Jun-08	Aug 09, May 10, Aug 11		
PW - 8	Jun 08, Aug 09, May 10, Aug 11, Jul 12, Dec 12	Jul 08, Sep 09, Aug 11, Dec 12			Pipe 8/09, Jul 12	May 10, Aug 11, Jul 12, Dec 12			Aug 09, May 10, Aug 11		

Mr. C's CLEANERS OM&M

SUMMARY OF WATER PUMP STATUS - 2013

as of Mar 2013

ID	NEEDS CLEANING & INSPECTION	NEEDS NEW PUMP	NEEDS NEW INNER RING	NEEDS P.A. OR PIPE	NEEDS WELL CLEAN-OUT	PITLESS ADAPTER	NEEDS HORIZONTAL LINE PURGE	NEEDS TRANSDUCER INSPECTION	NEEDS NEW TRANSDUCER	NEEDS ANEROID BELLOWS	NEEDS U.E. CLEANED	NEEDS U.E. REPAIR
RW-1	DONE 1/12	NO	PZ-1B		YES			NO	NO	NO	NO	YES - bolts
PW-2	YES	NO	NO		YES			NO		NO	NO	YES - bolts
PW-3	NO	NO	NO	REPAIRED 8/09	DONE 8/09			NO		NO	NO	NO
PW-4	YES	NO	YES		DONE 9/09			NO		NO	NO	YES - Asphalt patch
PW-5	DONE 1/12	NO	NO		YES			NO	DONE 1/12	DONE 1/12	NO	NO
PW-6	Jun 08, Jul 09, Jul 12, Nov 12	YES	NO	Replaced pipe 8/09	DONE 8/09		NO	NO	NO	DONE 9/09	NO	DONE
PW-7	Jun 08, Jul 09, May 10, Oct 10, Aug 11, Mar 12, Jul 12, Nov 12	NO	NO	Replaced pipe 8/09	YES	YES	NO	NO	NO	DONE	NO	NO
PW-8	Jun 08, Aug 09, May 10, Aug 11, Jul 12, Dec 12	DONE 8/11	NO	Replaced pipe 8/09	NO	YES	YES	YES	NO	YES	NO	NO


Attachment B
Analytical Report from
Mitkem Laboratories

Analytical Data Package Work Order ID: M0301

Sampled: March 6, 2013

Received: March 7, 2013

Report Date:
12-Mar-13 17:01



- Final Report
 Re-Issued Report
 Revised Report

Laboratory Report

Ecology and Environment Engineering P.C.
368 Pleasant View Drive
Lancaster, NY 14086

Work Order: M0301
Project : Mr. C's Dry Cleaning
Project #: 4500000623/EN-003229-0001-03TTO

Attn: Michael Steffan

<u>Laboratory ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Sampled</u>	<u>Date Received</u>
M0301-01	INFLUENT	Aqueous	06-Mar-13 11:30	07-Mar-13 09:15
M0301-02	EFFLUENT	Aqueous	06-Mar-13 12:00	07-Mar-13 09:15

I attest that the information contained within the report has been reviewed for accuracy and checked against the quality control requirements for each method. The results relate only to the samples(s) as received. This report may not be reproduced, except in full, without written approval from Spectrum Analytical.

All applicable NELAC or USEPA CLP requirements have been met.

Spectrum Analytical (Rhode Island) is accredited under the National Environmental Laboratory Approval Program (NELAP) and DoD Environmental Laboratory Accreditation Program (ELAP), holds Organic and Inorganic contracts under the USEPA CLP Program and is certified under several states. The current list of our laboratory approvals and certifications is available on the Certifications page on our web site at www.spectrum-analytical.com.

Please contact the Laboratory or Technical Director at 401-732-3400 with any questions regarding the data contained in the laboratory report.

Department of Defense	N/A
Connecticut	PH-0153
Delaware	N/A
Florida	E87664
Maine	2007037
Massachusetts	M-RI907
New Hampshire	2631
New Jersey	RI001
New York	11522
North Carolina	581
Rhode Island	LAI00301
USDA	P330-08-00023
USEPA - ISM	EP-W-09-039
USEPA - SOM	EP-W-11-033




Certificate # L2247 Testing

Authorized by:

Yihai Ding
Laboratory Director

Sample Transmittal Documentation



SPECTRUM ANALYTICAL, INC.
HANBIL TECHNOLOGY

CHAIN OF CUSTODY RECORD

Page 1 of 1

Special Handling: Std
TAT- Indicate Date Needed: _____
• All TATs subject to laboratory approval.
• Min. 24-hour notification needed for rushes.
• Samples disposed of after 30 days unless otherwise instructed.

Report To: E & E Inc
368 Pleasantview Dr
Lancaster, NY 14086
Telephone # (716) 684-8060
Project Mgr.: Mike Steffen

Invoice To: E & E, Inc
P.O. No.: _____ RQN: _____

Project No.: _____
Site Name: MC CS OMRM
Location: East Aurora State: NY
Sampler(s): R. Allen

1=Na₂S₂O₅ 2=HCl 3=H₂SO₄ 4=HNO₃ 5=NaOH 6=Ascorbic Acid 7=CH₃OH
8=NaHSO₄ 9= _____ 10= _____ 11= _____

DW=Drinking Water GW=Groundwater WW=Wastewater
O=Oil SW=Surface Water SO=Soil SL=Sludge A=Air
X1= _____ X2= _____ X3= _____

List preservative code below:

1 4 2

Notes: _____

Containers:

of VOA Vials
of Amber Glass
of Clear Glass
of Plastic

Analyses:

PH
Hardness
VOC

QA/QC Reporting Level

Level I Level II
 Level III Level IV
 Other CAT A

State specific reporting standards: _____

Lab Id:	Sample Id:	Date:	Time:	Type	Matrix
M0301-01	INFLUENT	Mar 6, 2013	11:30 A	G	GW
-01	INFLUENT		11:30 A	G	GW
-01	INFLUENT		11:30 A	G	GW
-02	EFFLUENT		12:00 P	G	GW
-02	EFFLUENT		12:00 P	G	GW
M0301-02	EFFLUENT		12:00 P	G	GW

E-mail to msitehan@ene.com

EDD Format PDF


Condition upon receipt: Iced Ambient 2°C

Relinquished by: Richard C. Allen Jr

Richard C. Allen Jr


Date: 3/7/13

Time: 9:15

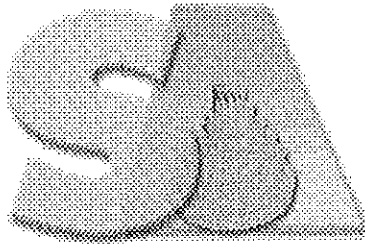

SPECTRUM ANALYTICAL, INC.
Featuring
HANIBAL TECHNOLOGY


*** Volatiles ***

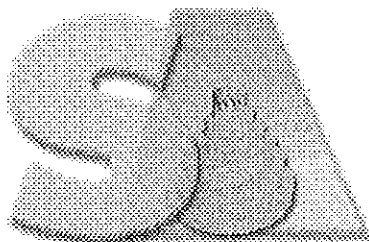

SPECTRUM ANALYTICAL, INC.
Featuring
HANIBAL TECHNOLOGY

Data Flag/Qualifiers:

- U Not Detected. This compound was analyzed-for but not detected. For most analyses the reporting limit (lowest standard concentration) is the value listed. For Department of Defense programs, this is the Limit of Detection (LOD).
- J This flag indicates an estimated value due to either
- the compound was detected below the reporting limit, or
 - estimated concentration for Tentatively Identified Compound
- B This flag indicates the compound was also detected in the associated Method Blank. The B flag has an alternative meaning for Inorganics analyses reported using CLP ILM-type metals forms, indicating a "trace" concentration below the reporting limit and equal to or above the detection limit.
- D For Organics analysis, this flag indicates the compound concentration was obtained from a secondary dilution analysis
- E This flag indicates the compound concentration exceeded the Calibration Range. The E flag has an alternative meaning for Inorganics analyses reported using CLP metals forms, indicating an estimated concentration due to the presence of interferences, as determined by the serial dilution analysis.
- P This flag is used for pesticides/PCB/herbicide compound when there is a greater than 40% difference for detected concentration between the two GC columns used for primary and confirmation analyses. This difference typically indicates an interference, causing one value to be unusually high. The lower of the two values is generally reported on the Form 1, and both values reported on the Form 10.
- A Used to flag semivolatile organic Tentatively Identified Compound library search results for compounds identified as aldol condensation byproducts.
- N Used to flag results for volatile and semivolatile Organics analysis Tentatively Identified Compounds where an analyte has passed the identification criteria, and is considered to be positively identified. For Inorganics analysis the N flag indicates the matrix spike recovery falls outside of the control limit.
- * For Inorganics analysis the * flag indicates Relative Percent Difference for duplicate analyses is outside of the control limit.

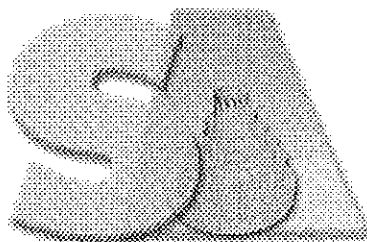

SPECTRUM ANALYTICAL, INC.
Featuring
HANIBAL TECHNOLOGY

Sample ID Suffixes

- DL** Diluted analysis. The sample was diluted and reanalyzed. The DL may be followed by a digit if more than one diluted reanalysis is provided. The DL suffix is not attached to an analysis initially performed at dilution, only to reanalyses performed at dilution
- RE** Reanalysis. Appended to the client sample ID to indicate a reextraction and reanalysis or a reanalysis of the original sample extract.
- RA** Reanalysis. Appended to the laboratory sample ID indicates a reanalysis of the original sample extract.
- RX** Reextraction. Appended to the laboratory sample ID indicates a reextraction of the sample.
- MS** Matrix Spike.
- MSD** Matrix Spike Duplicate
- DUP** Duplicate analysis
- SD** Serial Dilution
- PS** Post-digestion or Post-distillation spike. For metals or inorganic analyses

1A - FORM I VOA-1
VOLATILE ORGANICS ANALYSIS DATA SHEET

CLIENT SAMPLE NO.

INFLUENT

Lab Name: SPECTRUM ANALYTICAL, INC. Contract: _____
 Lab Code: MITKEM Case No.: M0301 Mod. Ref No.: _____ SDG No.: SM0301
 Matrix: (SOIL/SED/WATER) WATER Lab Sample ID: M0301-01A
 Sample wt/vol: 5.00 (g/mL) ML Lab File ID: V8B8593.D
 Level: (TRACE/LOW/MED) LOW Date Received: 03/07/2013
 % Moisture: not dec. Date Analyzed: 03/07/2013
 GC Column: DB-624 ID: 0.25 (mm) Dilution Factor: 10.0
 Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)
 Purge Volume: 5.0 (mL)

CAS NO.	COMPOUND	CONCENTRATION UNITS:		Q
		(ug/L or ug/Kg)	UG/L	
75-71-8	Dichlorodifluoromethane		10	U
74-87-3	Chloromethane		10	U
75-01-4	Vinyl chloride		10	U
74-83-9	Bromomethane		10	U
75-00-3	Chloroethane		10	U
75-69-4	Trichlorofluoromethane		10	U
75-35-4	1,1-Dichloroethene		10	U
67-64-1	Acetone		50	U
75-15-0	Carbon disulfide		10	U
75-09-2	Methylene chloride		10	U
156-60-5	trans-1,2-Dichloroethene		10	U
1634-04-4	Methyl tert-butyl ether		10	U
75-34-3	1,1-Dichloroethane		10	U
78-93-3	2-Butanone		50	U
156-59-2	cis-1,2-Dichloroethene		39	
67-66-3	Chloroform		10	U
71-55-6	1,1,1-Trichloroethane		10	U
56-23-5	Carbon tetrachloride		10	U
107-06-2	1,2-Dichloroethane		10	U
71-43-2	Benzene		10	U
79-01-6	Trichloroethene		67	
78-87-5	1,2-Dichloropropane		10	U
75-27-4	Bromodichloromethane		10	U
10061-01-5	cis-1,3-Dichloropropene		10	U
108-10-1	4-Methyl-2-pentanone		50	U
108-88-3	Toluene		10	U
10061-02-6	trans-1,3-Dichloropropene		10	U
79-00-5	1,1,2-Trichloroethane		10	U
127-18-4	Tetrachloroethene		1200	
591-78-6	2-Hexanone		50	U
124-48-1	Dibromochloromethane		10	U
106-93-4	1,2-Dibromoethane		10	U
108-90-7	Chlorobenzene		10	U
100-41-4	Ethylbenzene		10	U
1330-20-7	Xylene (Total)		10	U

1B - FORM I VOA-2
VOLATILE ORGANICS ANALYSIS DATA SHEET

CLIENT SAMPLE NO.

INFLUENT

Lab Name: SPECTRUM ANALYTICAL, INC. Contract: _____
 Lab Code: MITKEM Case No.: M0301 Mod. Ref No.: _____ SDG No.: SM0301
 Matrix: (SOIL/SED/WATER) WATER Lab Sample ID: M0301-01A
 Sample wt/vol: 5.00 (g/mL) ML Lab File ID: V8B8593.D
 Level: (TRACE/LOW/MED) LOW Date Received: 03/07/2013
 % Moisture: not dec. Date Analyzed: 03/07/2013
 GC Column: DB-624 ID: 0.25 (mm) Dilution Factor: 10.0
 Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)
 Purge Volume: 5.0 (mL)

CAS NO.	COMPOUND	CONCENTRATION UNITS:		Q
		(ug/L or ug/Kg)	UG/L	
100-42-5	Styrene		10	U
75-25-2	Bromoform		10	U
98-82-8	Isopropylbenzene		10	U
79-34-5	1,1,2,2-Tetrachloroethane		10	U
541-73-1	1,3-Dichlorobenzene		10	U
106-46-7	1,4-Dichlorobenzene		10	U
95-50-1	1,2-Dichlorobenzene		10	U
96-12-8	1,2-Dibromo-3-chloropropane		10	U
120-82-1	1,2,4-Trichlorobenzene		10	U
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane		10	U
110-82-7	Cyclohexane		10	U
79-20-9	Methyl acetate		10	U
108-87-2	Methylcyclohexane		10	U

1A - FORM I VOA-1
VOLATILE ORGANICS ANALYSIS DATA SHEET

CLIENT SAMPLE NO.

EFFLUENT

Lab Name: SPECTRUM ANALYTICAL, INC. Contract: _____
 Lab Code: MITKEM Case No.: M0301 Mod. Ref No.: _____ SDG No.: SM0301
 Matrix: (SOIL/SED/WATER) WATER Lab Sample ID: M0301-02A
 Sample wt/vol: 5.00 (g/mL) ML Lab File ID: V8B8592.D
 Level: (TRACE/LOW/MED) LOW Date Received: 03/07/2013
 % Moisture: not dec. Date Analyzed: 03/07/2013
 GC Column: DB-624 ID: 0.25 (mm) Dilution Factor: 1.0
 Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)
 Purge Volume: 5.0 (mL)

CAS NO.	COMPOUND	CONCENTRATION UNITS:		Q
		(ug/L or ug/Kg)	UG/L	
75-71-8	Dichlorodifluoromethane		1.0	U
74-87-3	Chloromethane		1.0	U
75-01-4	Vinyl chloride		1.0	U
74-83-9	Bromomethane		1.0	U
75-00-3	Chloroethane		1.0	U
75-69-4	Trichlorofluoromethane		1.0	U
75-35-4	1,1-Dichloroethene		1.0	U
67-64-1	Acetone		16	
75-15-0	Carbon disulfide		1.0	U
75-09-2	Methylene chloride		1.0	U
156-60-5	trans-1,2-Dichloroethene		1.0	U
1634-04-4	Methyl tert-butyl ether		1.0	U
75-34-3	1,1-Dichloroethane		1.0	U
78-93-3	2-Butanone		5.0	U
156-59-2	cis-1,2-Dichloroethene		0.60	J
67-66-3	Chloroform		1.0	U
71-55-6	1,1,1-Trichloroethane		1.0	U
56-23-5	Carbon tetrachloride		1.0	U
107-06-2	1,2-Dichloroethane		1.0	U
71-43-2	Benzene		1.0	U
79-01-6	Trichloroethene		0.65	J
78-87-5	1,2-Dichloropropane		1.0	U
75-27-4	Bromodichloromethane		1.0	U
10061-01-5	cis-1,3-Dichloropropene		1.0	U
108-10-1	4-Methyl-2-pentanone		5.0	U
108-88-3	Toluene		1.0	U
10061-02-6	trans-1,3-Dichloropropene		1.0	U
79-00-5	1,1,2-Trichloroethane		1.0	U
127-18-4	Tetrachloroethene		6.4	
591-78-6	2-Hexanone		5.0	U
124-48-1	Dibromochloromethane		1.0	U
106-93-4	1,2-Dibromoethane		1.0	U
108-90-7	Chlorobenzene		1.0	U
100-41-4	Ethylbenzene		1.0	U
1330-20-7	Xylene (Total)		1.0	U


1B - FORM I VOA-2
VOLATILE ORGANICS ANALYSIS DATA SHEET

CLIENT SAMPLE NO.

EFFLUENT


Lab Name: SPECTRUM ANALYTICAL, INC. Contract: _____
 Lab Code: MITKEM Case No.: M0301 Mod. Ref No.: _____ SDG No.: SM0301
 Matrix: (SOIL/SED/WATER) WATER Lab Sample ID: M0301-02A
 Sample wt/vol: 5.00 (g/mL) ML Lab File ID: V8B8592.D
 Level: (TRACE/LOW/MED) LOW Date Received: 03/07/2013
 % Moisture: not dec. Date Analyzed: 03/07/2013
 GC Column: DB-624 ID: 0.25 (mm) Dilution Factor: 1.0
 Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)
 Purge Volume: 5.0 (mL)

CAS NO.	COMPOUND	CONCENTRATION UNITS:		Q
		(ug/L or ug/Kg)	UG/L	
100-42-5	Styrene		1.0	U
75-25-2	Bromoform		1.0	U
98-82-8	Isopropylbenzene		1.0	U
79-34-5	1,1,2,2-Tetrachloroethane		1.0	U
541-73-1	1,3-Dichlorobenzene		1.0	U
106-46-7	1,4-Dichlorobenzene		1.0	U
95-50-1	1,2-Dichlorobenzene		1.0	U
96-12-8	1,2-Dibromo-3-chloropropane		1.0	U
120-82-1	1,2,4-Trichlorobenzene		1.0	U
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane		1.0	U
110-82-7	Cyclohexane		1.0	U
79-20-9	Methyl acetate		1.0	U
108-87-2	Methylcyclohexane		1.0	U

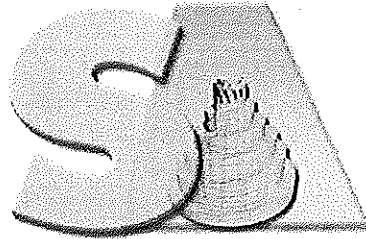

SPECTRUM ANALYTICAL, INC.
Featuring
HANIBAL TECHNOLOGY


*** Wet Chemistry ***

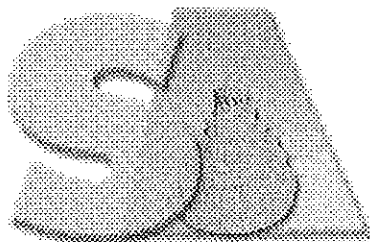

SPECTRUM ANALYTICAL, INC.
Featuring
HANIBAL TECHNOLOGY

Data Flag/Qualifiers:

- U Not Detected. This compound was analyzed-for but not detected. For most analyses the reporting limit (lowest standard concentration) is the value listed. For Department of Defense programs, this is the Limit of Detection (LOD).
- J This flag indicates an estimated value due to either
- the compound was detected below the reporting limit, or
 - estimated concentration for Tentatively Identified Compound
- B This flag indicates the compound was also detected in the associated Method Blank. The B flag has an alternative meaning for Inorganics analyses reported using CLP ILM-type metals forms, indicating a "trace" concentration below the reporting limit and equal to or above the detection limit.
- D For Organics analysis, this flag indicates the compound concentration was obtained from a secondary dilution analysis
- E This flag indicates the compound concentration exceeded the Calibration Range. The E flag has an alternative meaning for Inorganics analyses reported using CLP metals forms, indicating an estimated concentration due to the presence of interferences, as determined by the serial dilution analysis.
- P This flag is used for pesticides/PCB/herbicide compound when there is a greater than 40% difference for detected concentration between the two GC columns used for primary and confirmation analyses. This difference typically indicates an interference, causing one value to be unusually high. The **lower** of the two values is generally reported on the Form 1, and both values reported on the Form 10.
- A Used to flag semivolatile organic Tentatively Identified Compound library search results for compounds identified as aldol condensation byproducts.
- N Used to flag results for volatile and semivolatile Organics analysis Tentatively Identified Compounds where an analyte has passed the identification criteria, and is considered to be positively identified. For Inorganics analysis the N flag indicates the matrix spike recovery falls outside of the control limit.
- * For Inorganics analysis the * flag indicates Relative Percent Difference for duplicate analyses is outside of the control limit.

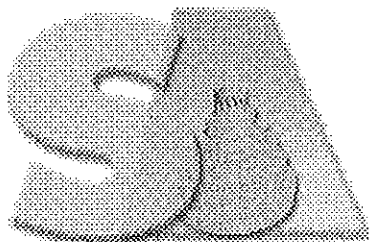

SPECTRUM ANALYTICAL, INC.
Featuring
HANIBAL TECHNOLOGY

Sample ID Suffixes

- DL Diluted analysis. The sample was diluted and reanalyzed. The DL may be followed by a digit if more than one diluted reanalysis is provided. The DL suffix is not attached to an analysis initially performed at dilution, only to reanalyses performed at dilution
- RE Reanalysis. Appended to the client sample ID to indicate a reextraction and reanalysis or a reanalysis of the original sample extract.
- RA Reanalysis. Appended to the laboratory sample ID indicates a reanalysis of the original sample extract.
- RX Reextraction. Appended to the laboratory sample ID indicates a reextraction of the sample.
- MS Matrix Spike.
- MSD Matrix Spike Duplicate
- DUP Duplicate analysis
- SD Serial Dilution
- PS Post-digestion or Post-distillation spike. For metals or inorganic analyses

Client: Ecology and Environment Engineering P.C.

Client Sample ID: INFLUENT

Lab ID: M0301-01

Project: Mr. C's Dry Cleaning

Collection Date: 03/06/13 11:30

Analyses	Result	Qual	RL	Units	DF	Date Analyzed	Batch ID
SM 2340B -- HARDNESS by Calculation							SM2340_W
Hardness, Ca/Mg (As CaCO3)	580		4.0	mg/L CaCO3	1	03/11/2013 9:54	70789
SM 4500 H+ B -- pH VALUE							SM4500_H+
pH	7.3		1.0	S.U.		03/07/2013 11:20	R72758

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 DF - Dilution Factor

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range
 RL - Reporting Limit

Client: Ecology and Environment Engineering P.C.

Client Sample ID: EFFLUENT

Lab ID: M0301-02

Project: Mr. C's Dry Cleaning

Collection Date: 03/06/13 12:00

Analyses	Result	Qual	RL	Units	DF	Date Analyzed	Batch ID
SM 2340B -- HARDNESS by Calculation							SM2340_W
Hardness, Ca/Mg (As CaCO3)	570		4.0	mg/L CaCO3		103/11/2013 9:58	70789
SM 4500 H+ B -- pH VALUE							SM4500_H+
pH	8.0		1.0	S.U.		103/07/2013 11:21	R72758

Qualifiers: ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 DF - Dilution Factor

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range
 RL - Reporting Limit

Attachment C
Summary of Site Utility Costs and Projections
January to December 2013

Mr. C's Dry Cleaners Site - Remedial Treatment Utility Costs

NYSDEC Work Assignment #DC13.02.01.01

12 Months of System Operation and Maintenance

March 2013 Report

Utility Provider	Account #	E&E Cost Center	Description	Utility Budget:												Electric	Telephone	Gas	Total	Ave./Month
				Jan-2012	Feb-2012	Mar-2012	Apr-2012	May-2012	Jun-2012	Jul-2012	Aug-2012	Sep-2012	Oct-2012	Nov-2012	Dec-2012					
New York State E&G	1001-0310-422	EN-003229-0001-03ITTO	Mr. C's Electric Costs	\$ 1,695.55	\$ 1,212.17														\$15,800.00	
New York State E&G	716-311-11-015900-18	EN-003229-0001-03ITTO	Agway Site - Electric	\$46.63	\$ 27.50	\$ 185.46													\$540.00	
National Fuel Gas	5819628-05	EN-003229-0001-03ITTO	Mr. C's Natural Gas Costs	\$ 1,742.18	\$ 1,239.67	\$ 185.46													\$1,120.00	
			Totals	\$ 3,484.36	\$ 2,479.34	\$ 371.92													\$17,460.00	
			Mr. C's Electric Costs																	
			Agway Electric																	
			Mr. C's Natural Gas Costs	\$0.00																
			Totals	\$0.00	\$ -	\$ -														
			Electric (Both sites)		\$2,907.72															
			Natural Gas		\$ 259.59															
			Grand Total - NYSE&G/National Fuel Gas Costs To Date	\$	3,167.31															
Phone																				
Utility Provider	Phone #	E&E Cost Center	Location Description	Jan-2012	Feb-2012	Mar-2012	Apr-2012	May-2012	Jun-2012											
Verizon	716-652-0094	EN-003229-0001-03ITTO	Mr. C's Telephone Costs																	
Account #																				
716 652 0094 416 26 2		EN-003229-0001-03ITTO																		
			Grand Total - Verizon Costs to Date	\$	-															
			Grand Total All Utilities To Date	\$	3,167.31															

Mr. C's Dry Cleaners Site - Remedial Treatment Utility Costs

NYSDEC Work Assignment #DC13

12 Months of System Operation and Maintenance

March 2013 Report

				Budget Remaining:				ATTACHMENT C	
				Electric:	\$12,892.28				
				Telephone:	\$540.00				
				Gas	\$860.41				
				Total:	\$14,292.69				
Optimum Operating Hours	Actual Operating Hours	Up-time Percentage	Capacity	Comments:					
672	576	85.71%	13.8%	Mid January					
672	564	88.39%	8.7%	Mid February					
720	720	100.00%	9.6%	Cold March					
April-13		#DIV/0!							
May-13		#DIV/0!							
June-13		#DIV/0!							
July-13		#DIV/0!							
August-13		#DIV/0!							
September-13		#DIV/0!							
October-13		#DIV/0!							
November-13		#DIV/0!							
December-13		#DIV/0!							
Totals to Date	2064	91.57%							
<p>* Percent Capacity is based on initial operating groundwater flows from the eight installed pumps from 9/02. Evaluated on total gallons discharged for monthly operating time. Maximum pump discharges calculated as an average of 78 gpm as the total for all 8 pumps at the site if all pumps operate 100%. With the exception of groundwater pump RW-1, all others run on a batch basis.</p>									
Monthly Average Costs									
Mr. C's Electric	\$	1,453.86							
Agway Electric	\$	-							
Mr. C's Gas	\$	86.53							
Mr. C's Telephone	\$	-							
Ave. Utility Cost Total	\$	1,540.39	12 Month Estimate	\$20,025.07					