



Glenn Springs Holdings, Inc.

A subsidiary of Occidental Petroleum

Clint Babcock
Project Manager
Direct Dial (972) 687-7506

5005 LBJ Freeway, Suite 1350
Dallas, TX 75244-6119
Facsimile (972) 687-7524

July 23, 2010

Reference No. 001069

Ms. Gloria M. Sosa
USEPA
Region II, Site Investigation & Compliance Branch
290 Broadway, 20th Floor
New York, NY 10007-1866

Mr. Will Welling
NYSDEC
Remedial Bureau D, 12th Floor
625 Broadway
Albany, NY 12233-7013

Dear Ms. Sosa and Mr. Welling:

Re: **Quarterly Operations Report – Second Quarter 2010**
Hyde Park Remedial Program
Bedrock and Overburden Monitoring Programs

In accordance with the July 2006 "Performance Monitoring Plan," the following is the quarterly data report for the Hyde Park Remedial Program for the period April 1, 2010 through June 30, 2010. A total of 8.8 million gallons of aqueous phase liquid (APL) was collected, treated, and discharged in compliance with our City of Niagara Falls Publicly Owned Treatment Works (POTW) permit; no non-aqueous phase liquid (NAPL) was shipped for incineration. The potentiometric contours are consistent with previous interpretations. Flow zones 6, 7, and 9 have large dewatered areas between the landfill and the gorge face. The current data continue to support the interpretation of effective hydraulic containment.

The performance monitoring data are presented as follows:

1. Figures 1-9: Showing groundwater contours for the flow zones and overburden
2. Figure 10: Showing continuously recorded water levels at flow zone piezometer PMW-1M-09
3. Table 1: Water Level Elevation Summary
4. Tables 2, 3, and 4: Daily, Weekly, and Quarterly Treatment System Effluent Monitoring Data
5. Attachment 1: Purge well performance graphs indicating daily level and flow information

July 23, 2010


Reference No. 001069

- 2 -

An electronic copy of this report is included on the attached CD as an Adobe® Acrobat® file. If you have any questions, please feel free to contact me at 972-687-7506 or by email at clint_babcock@oxy.com.

Very truly yours,

GLENN SPRINGS HOLDINGS, INC.



Clint Babcock
Project Manager



Ralph Schupp
Operations Coordinator


CB/JP/adh-31
Encl.

c.c.: M. Anderson, GSH - 1*
M. Forcucci, NYSDOH - 1*
D. Hoyt, CRA - 1
J. Pentilchuk, CRA - 1


T. Raby, AECOM Environmental - 1*
B. Sadowski, NYSDEC - CD Only
G. Sosa, USEPA - 4*
W. Welling, NYSDEC - 1*

*Include one copy on CD

FIGURES

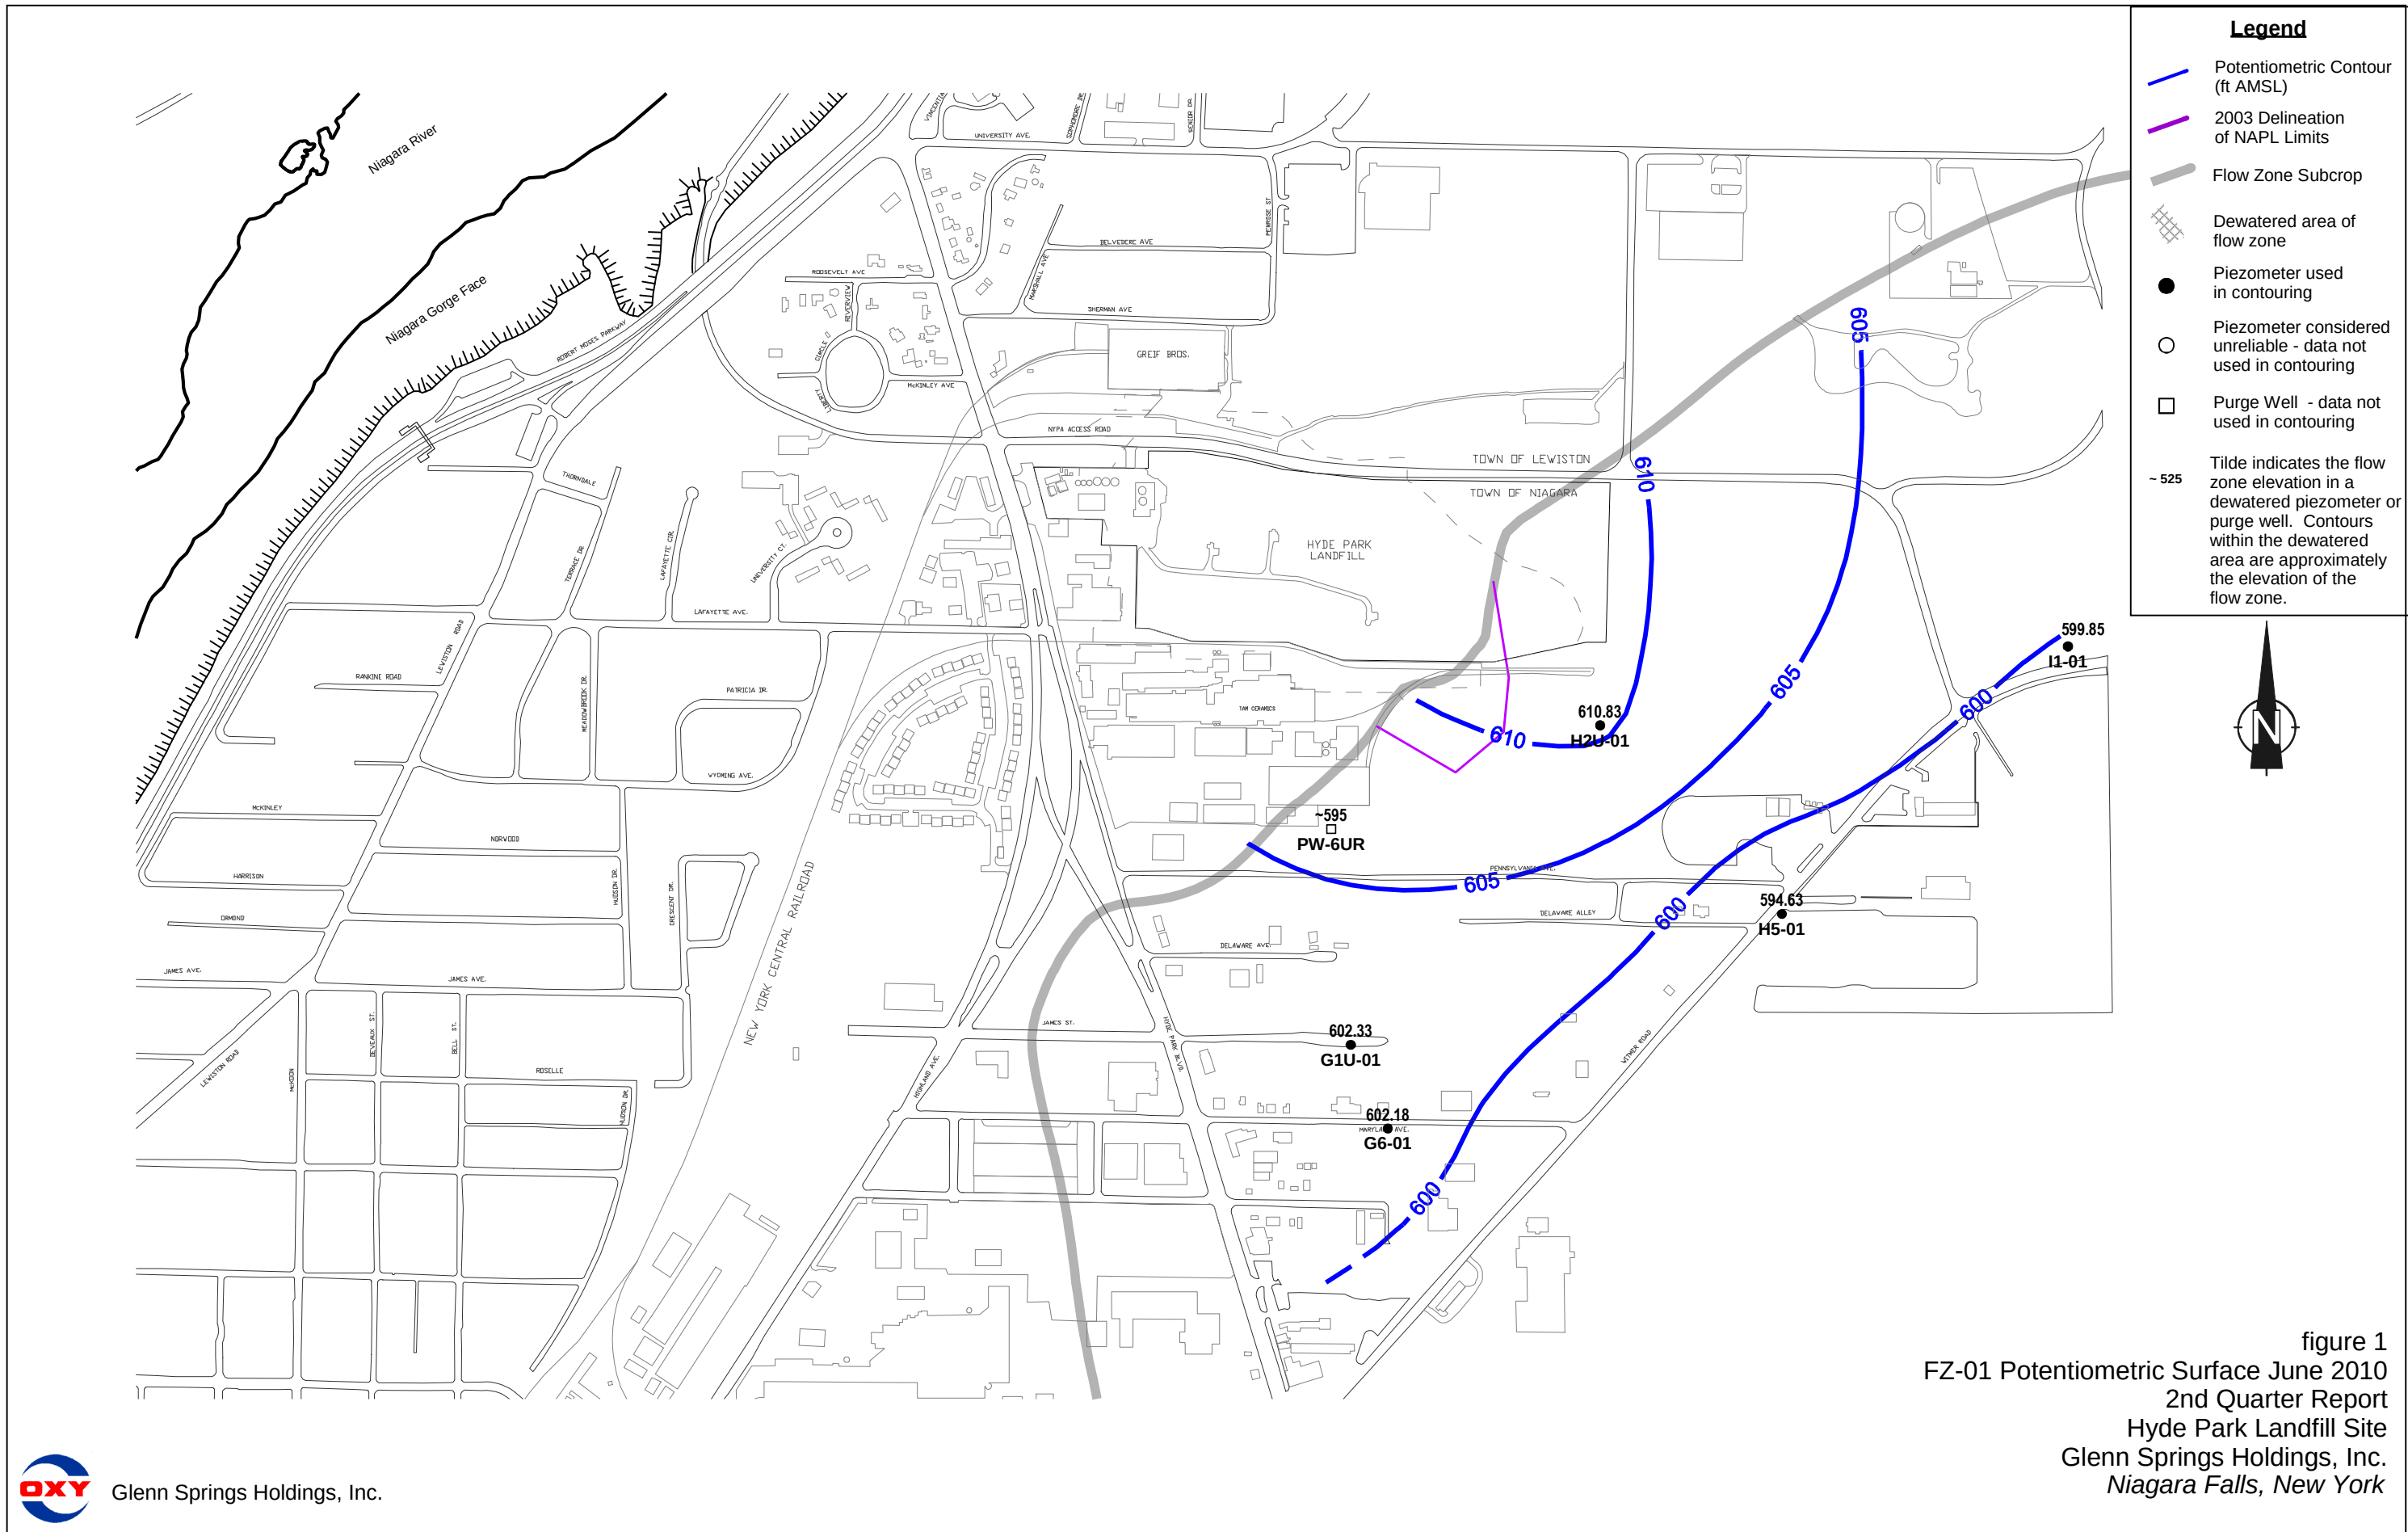

Glenn Springs Holdings, Inc.

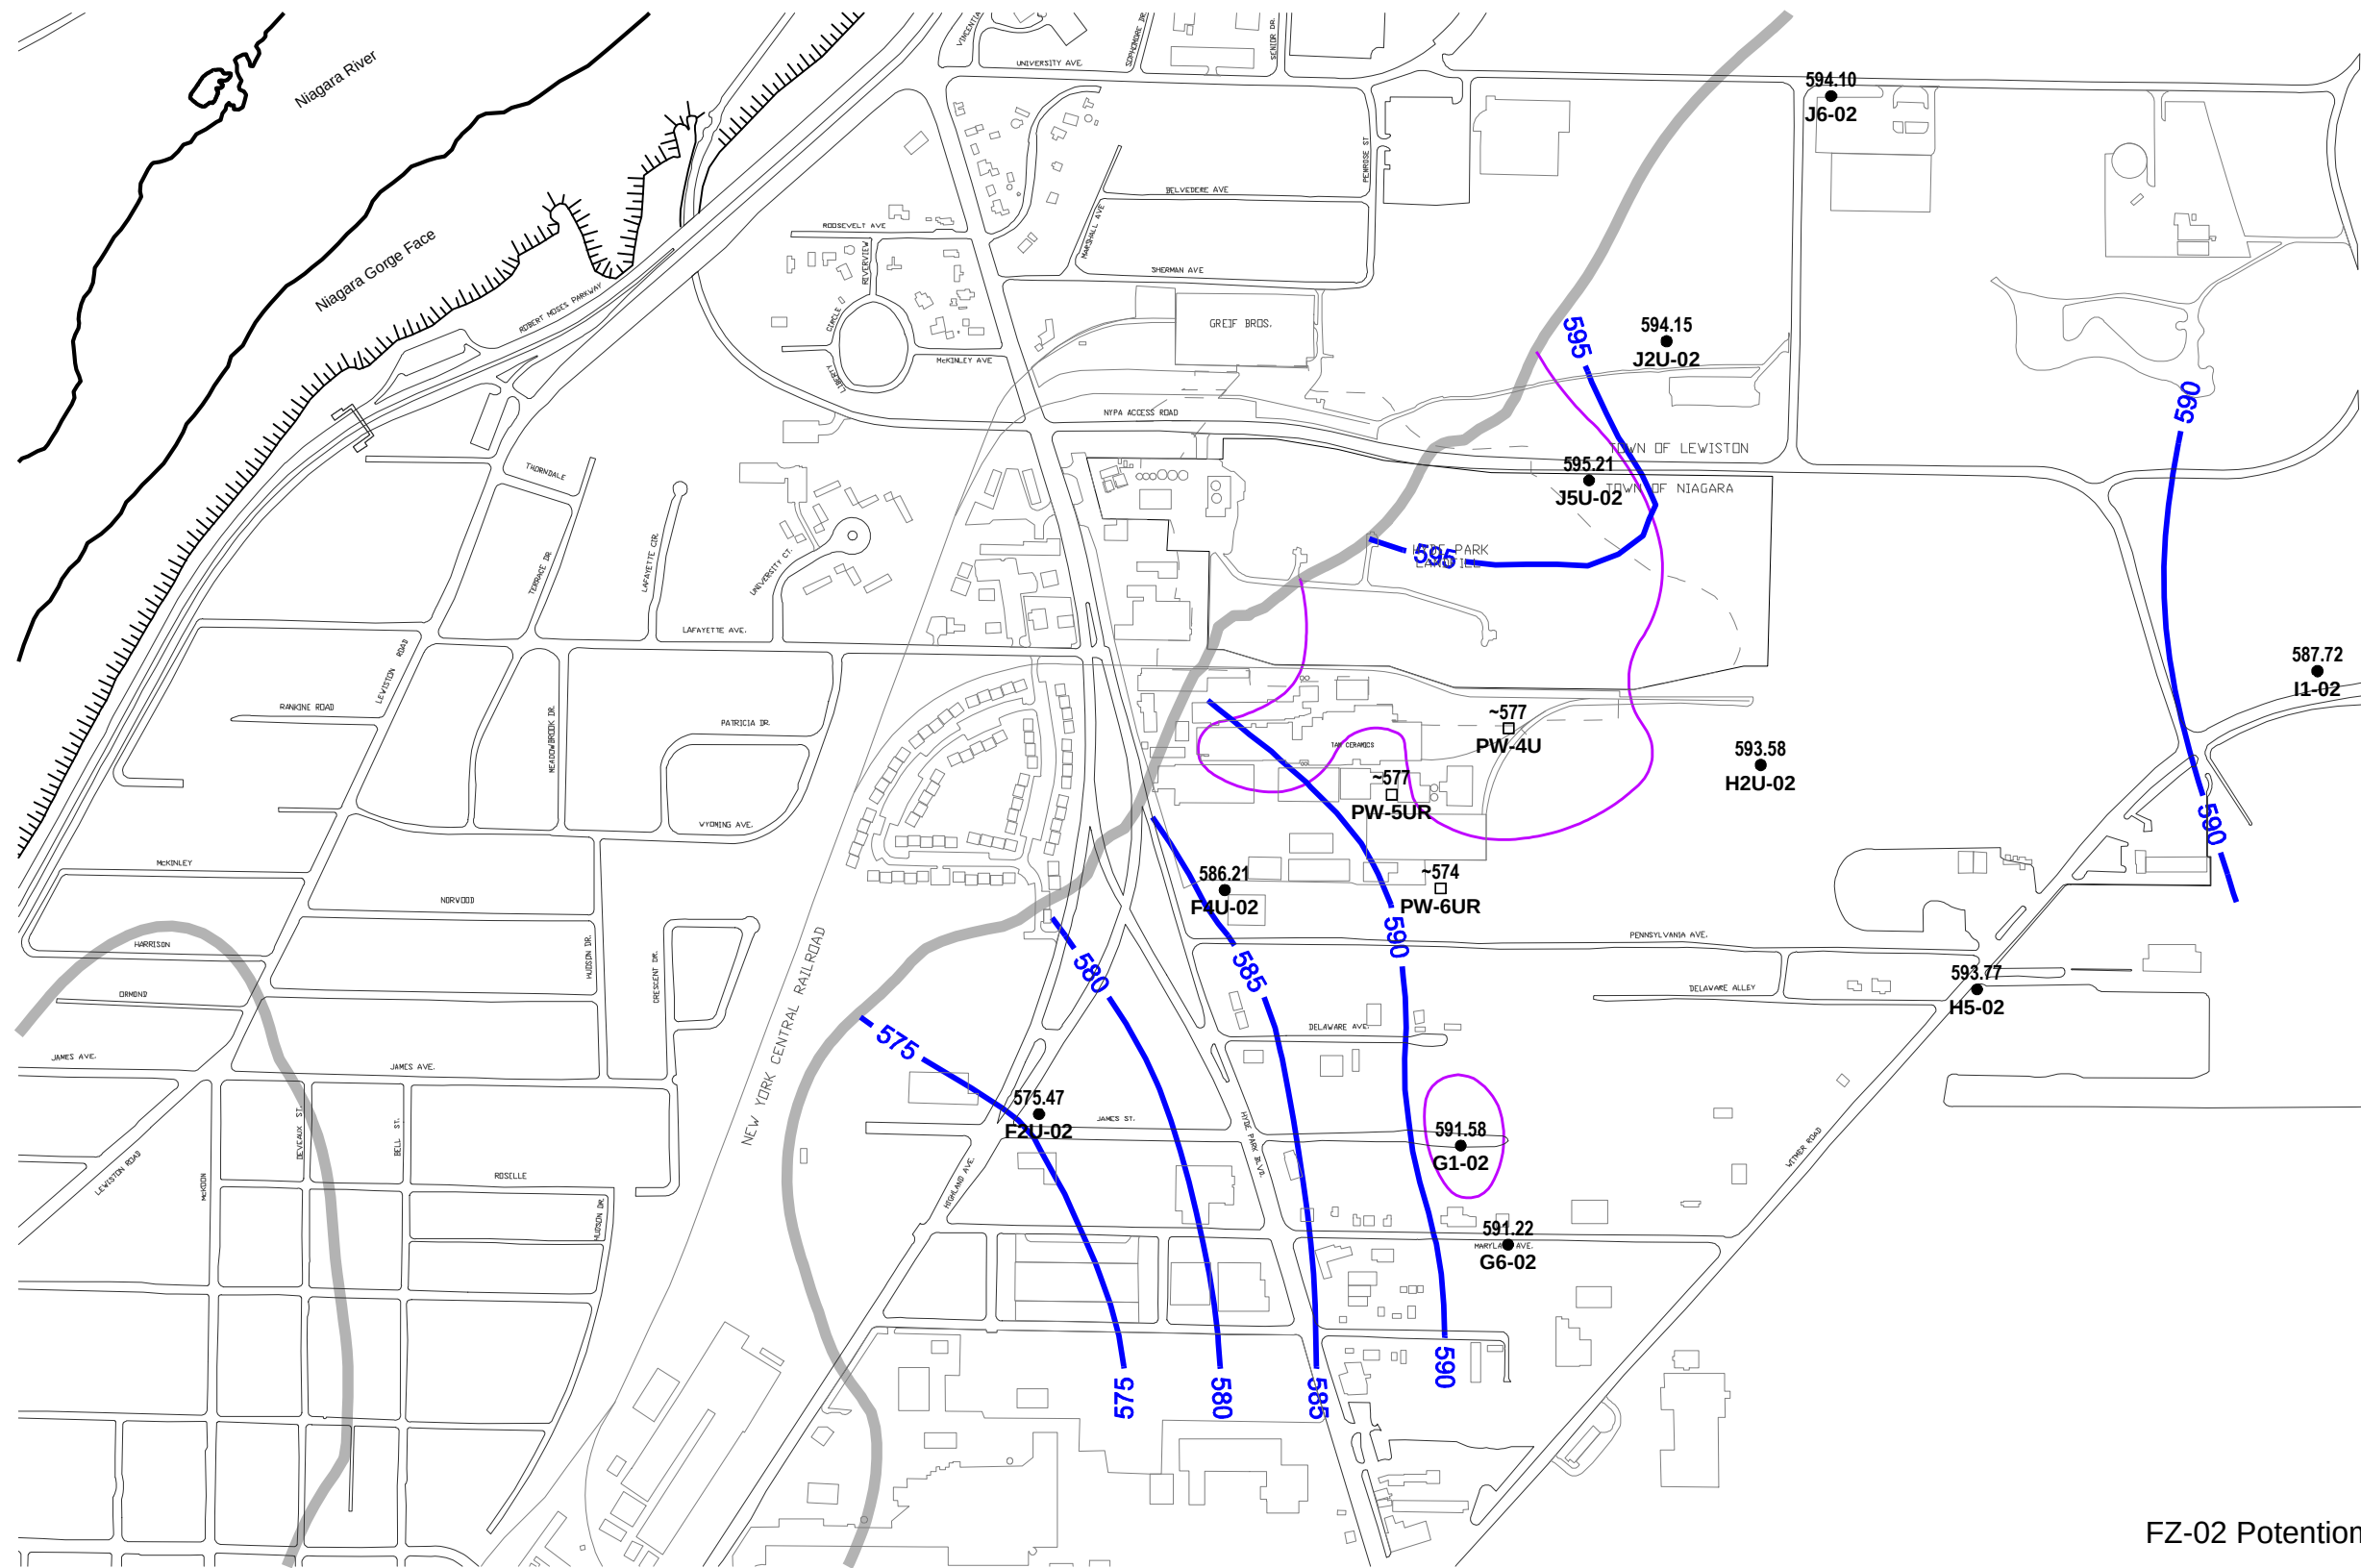


Legend

- Potentiometric Contour (ft AMSL)
- 2003 Delineation of NAPL Limits
- Flow Zone Subcrop
- Dewatered area of flow zone
- Piezometer used in contouring
- Piezometer considered unreliable - data not used in contouring
- Purge Well - data not used in contouring

Tilde indicates the flow zone elevation in a dewatered piezometer or purge well. Contours within the dewatered area are approximately the elevation of the flow zone.



figure 2
FZ-02 Potentiometric Surface June 2010
2nd Quarter Report
Hyde Park Landfill Site
Glenn Springs Holdings, Inc.
Niagara Falls, New York

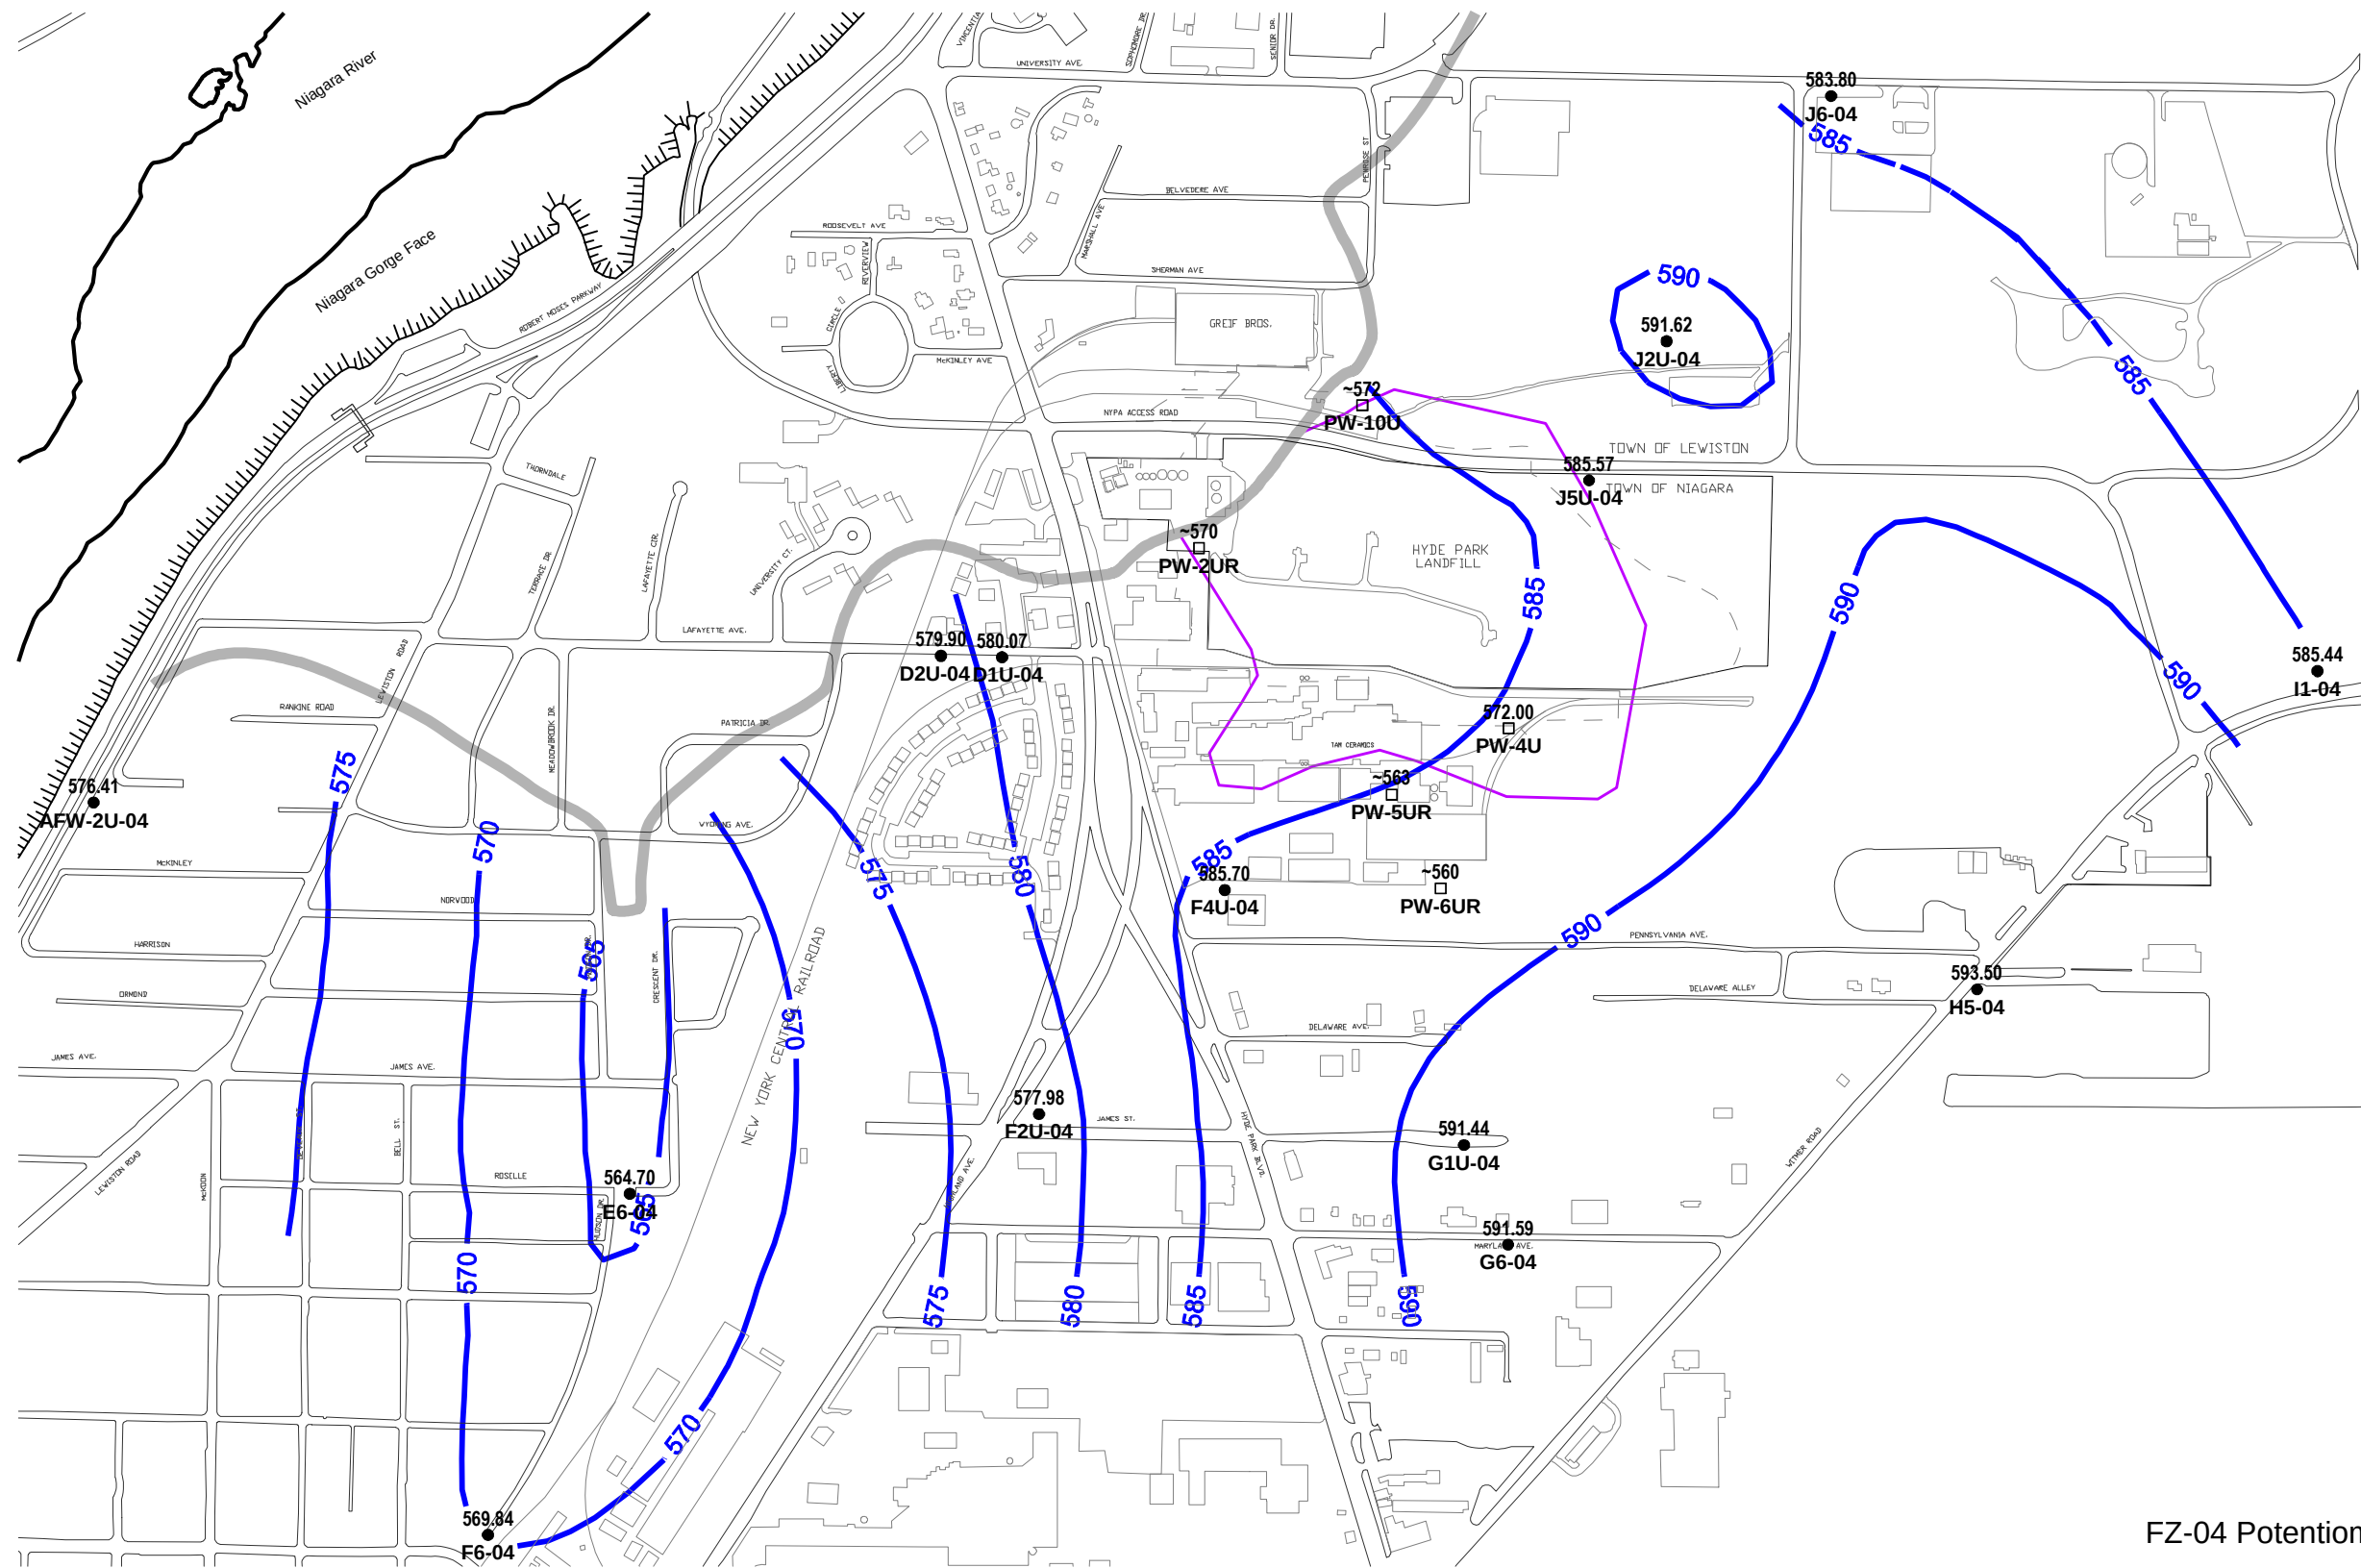

Legend


- Potentiometric Contour (ft AMSL)
- 2003 Delineation of NAPL Limits
- Flow Zone Subcrop
- Dewatered area of flow zone
- Piezometer used in contouring
- Piezometer considered unreliable - data not used in contouring
- Purge Well - data not used in contouring

Tilde indicates the flow zone elevation in a dewatered piezometer or purge well. Contours within the dewatered area are approximately the elevation of the flow zone.

~ 525



figure 3
FZ-04 Potentiometric Surface June 2010
2nd Quarter Report
Hyde Park Landfill Site
Glenn Springs Holdings, Inc.
Niagara Falls, New York

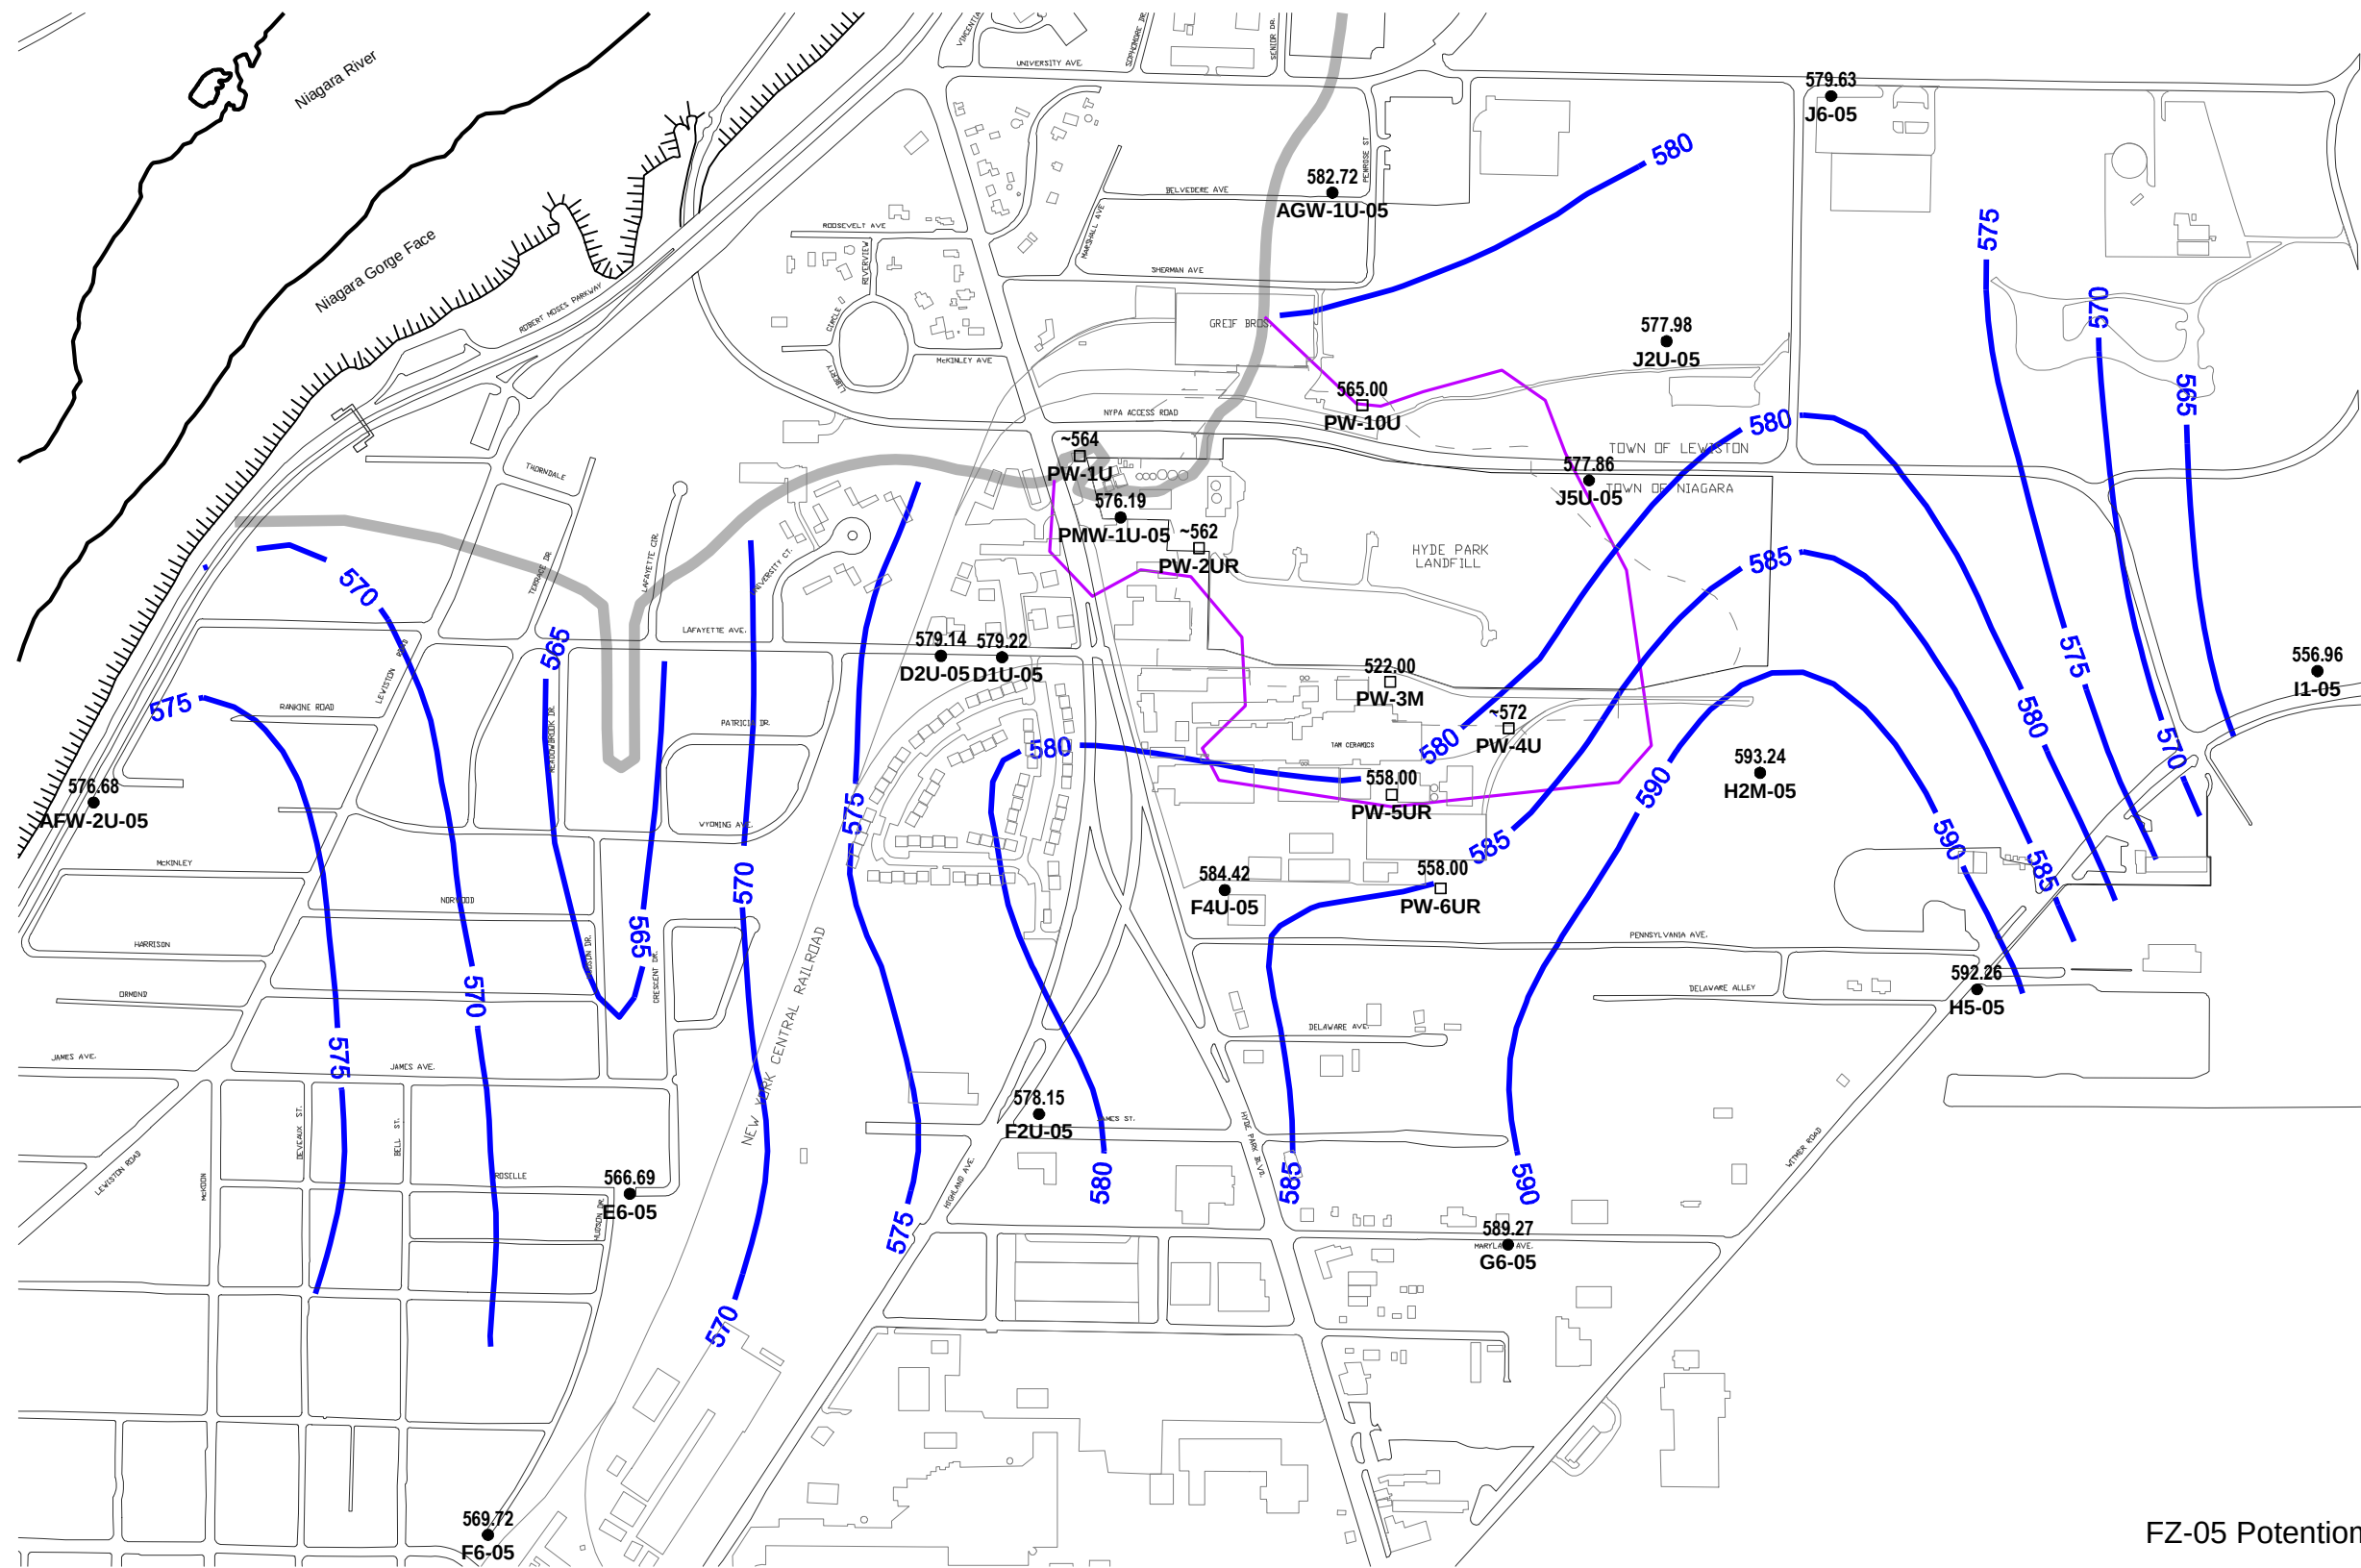

Legend


- Potentiometric Contour (ft AMSL)
- 2003 Delineation of NAPL Limits
- Flow Zone Subcrop
- Dewatered area of flow zone
- Piezometer used in contouring
- Piezometer considered unreliable - data not used in contouring
- Purge Well - data not used in contouring

Tilde indicates the flow zone elevation in a dewatered piezometer or purge well. Contours within the dewatered area are approximately the elevation of the flow zone.

~ 525



figure 4
FZ-05 Potentiometric Surface June 2010
2nd Quarter Report
Hyde Park Landfill Site
Glenn Springs Holdings, Inc.
Niagara Falls, New York

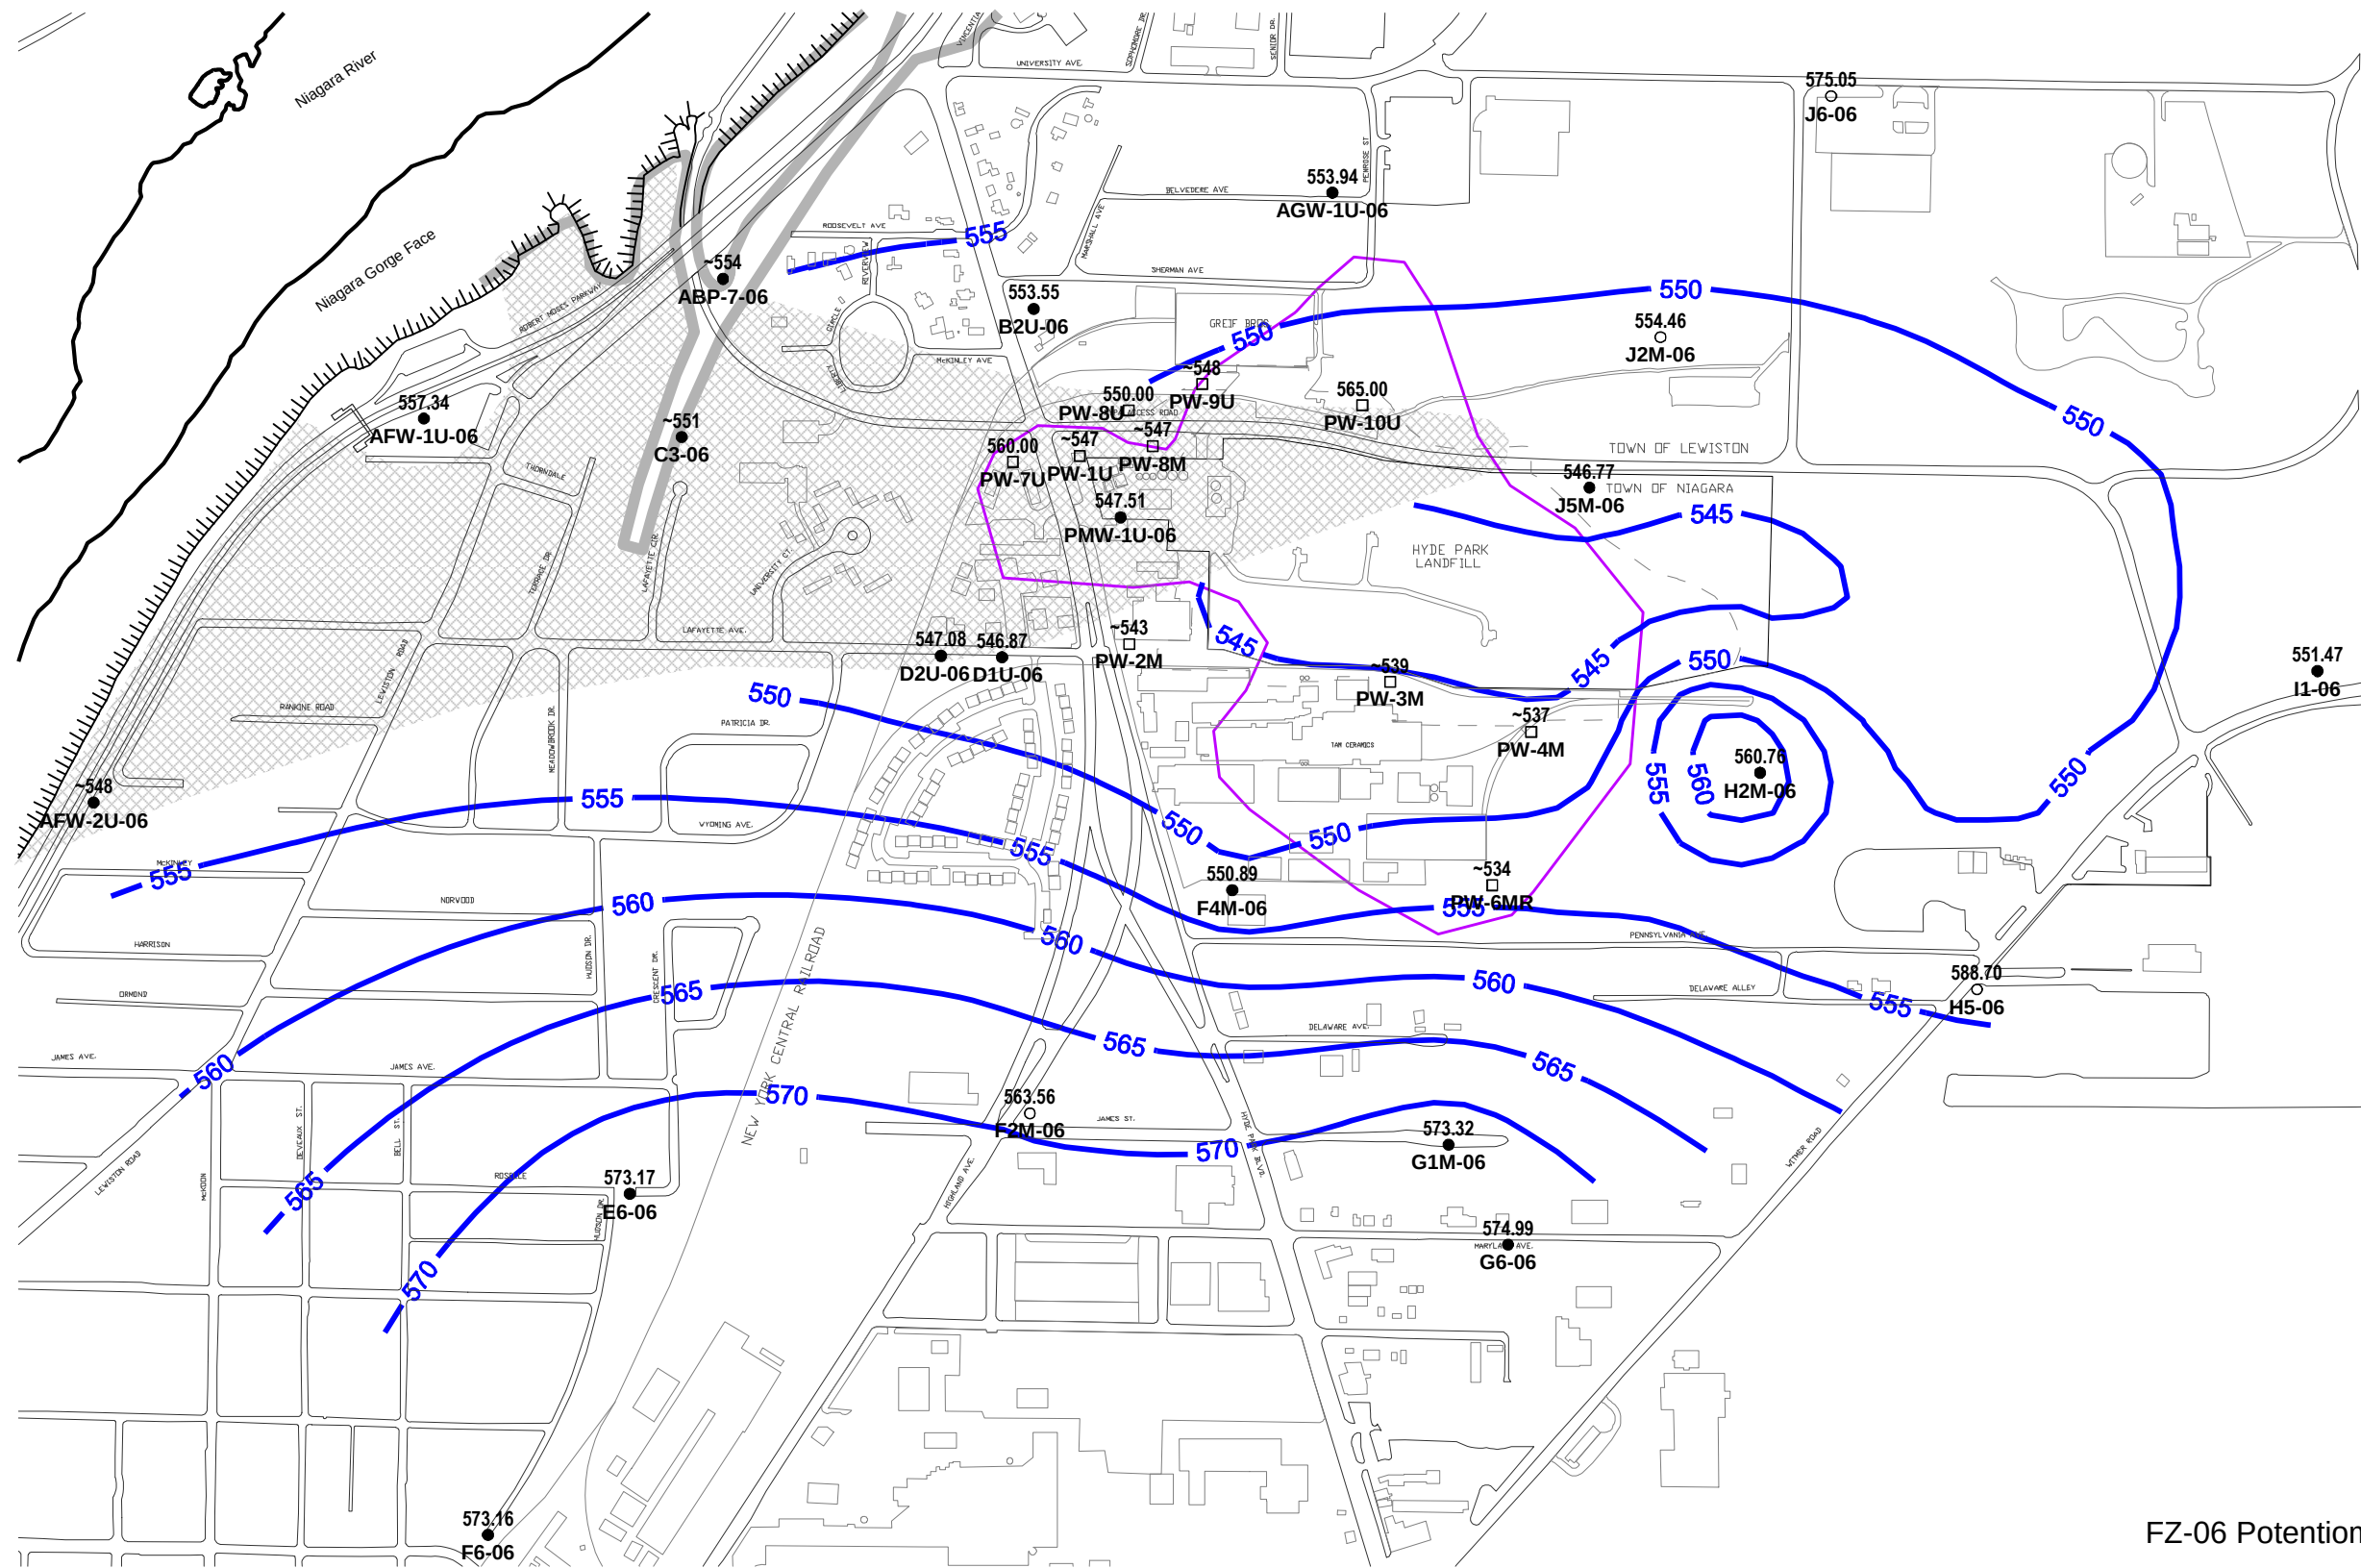

Legend

- Potentiometric Contour (ft AMSL)
- 2003 Delineation of NAPL Limits
- Flow Zone Subcrop
- Dewatered area of flow zone
- Piezometer used in contouring
- Piezometer considered unreliable - data not used in contouring
- Purge Well - data not used in contouring

Tilde indicates the flow zone elevation in a dewatered piezometer or purge well. Contours within the dewatered area are approximately the elevation of the flow zone.

~ 525



figure 5
FZ-06 Potentiometric Surface June 2010
2nd Quarter Report
Hyde Park Landfill Site
Glenn Springs Holdings, Inc.
Niagara Falls, New York


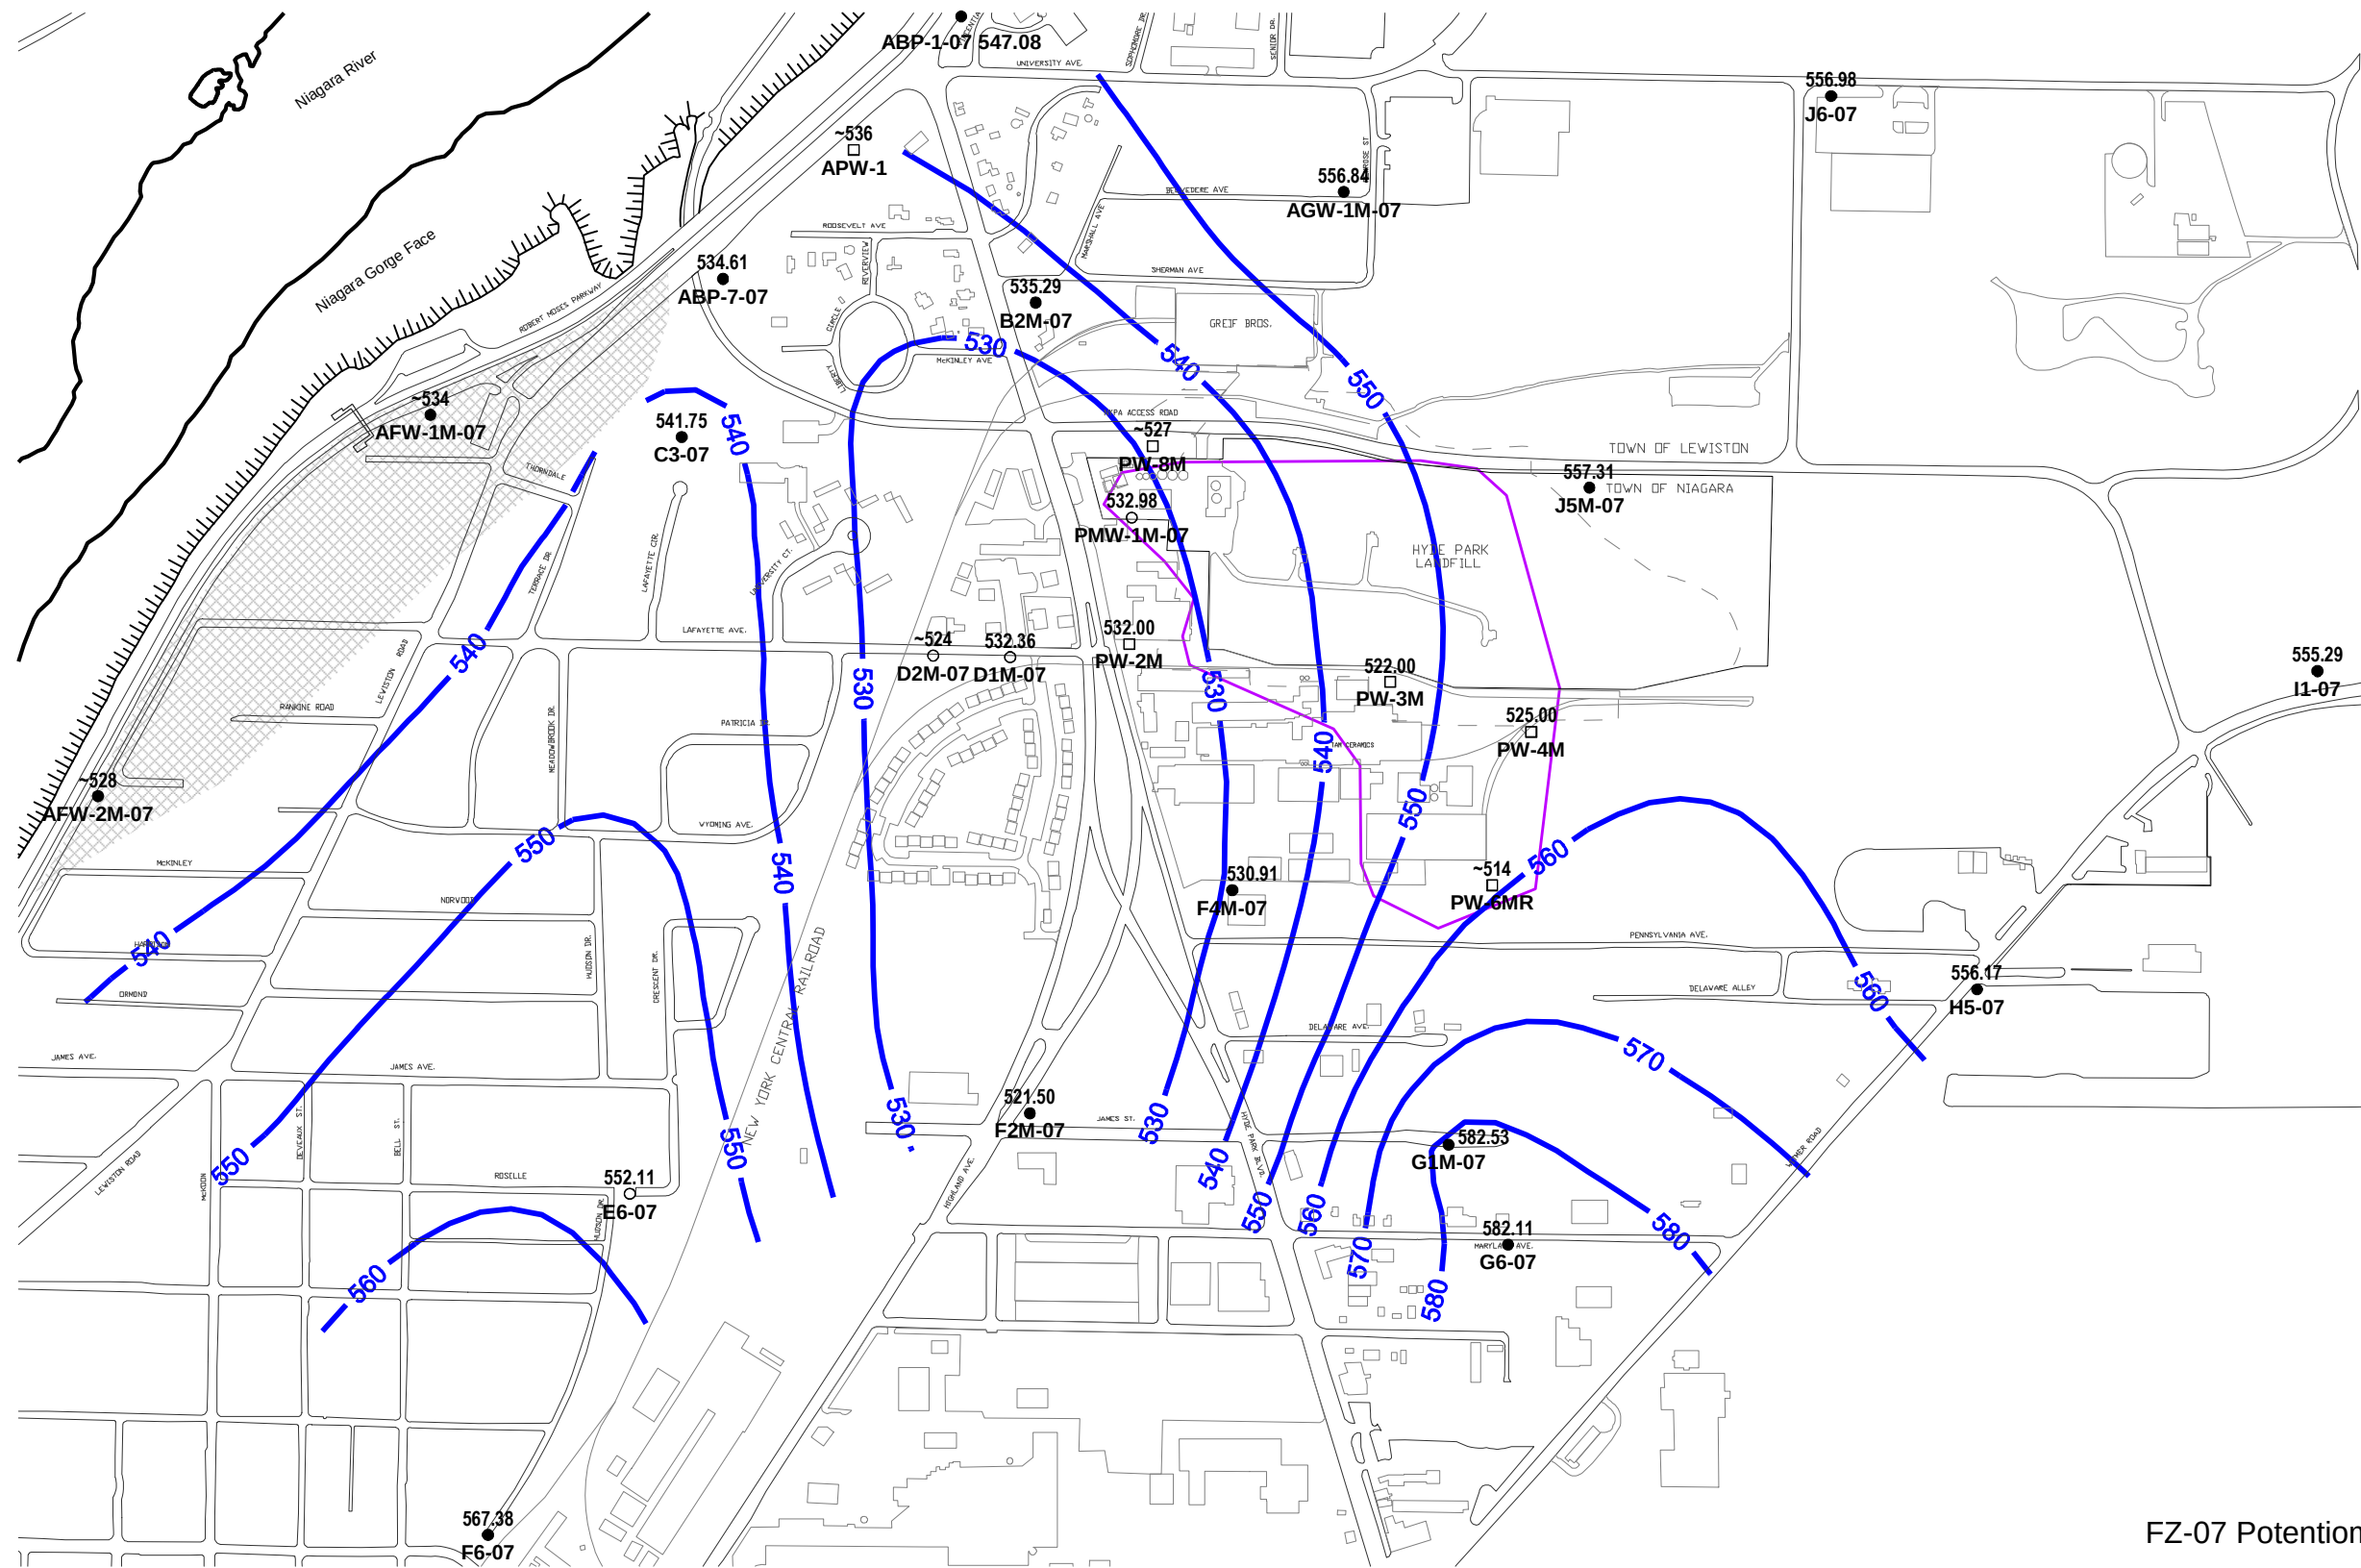


figure 6
FZ-07 Potentiometric Surface June 2010
2nd Quarter Report
Hyde Park Landfill Site
Glenn Springs Holdings, Inc.
Niagara Falls, New York

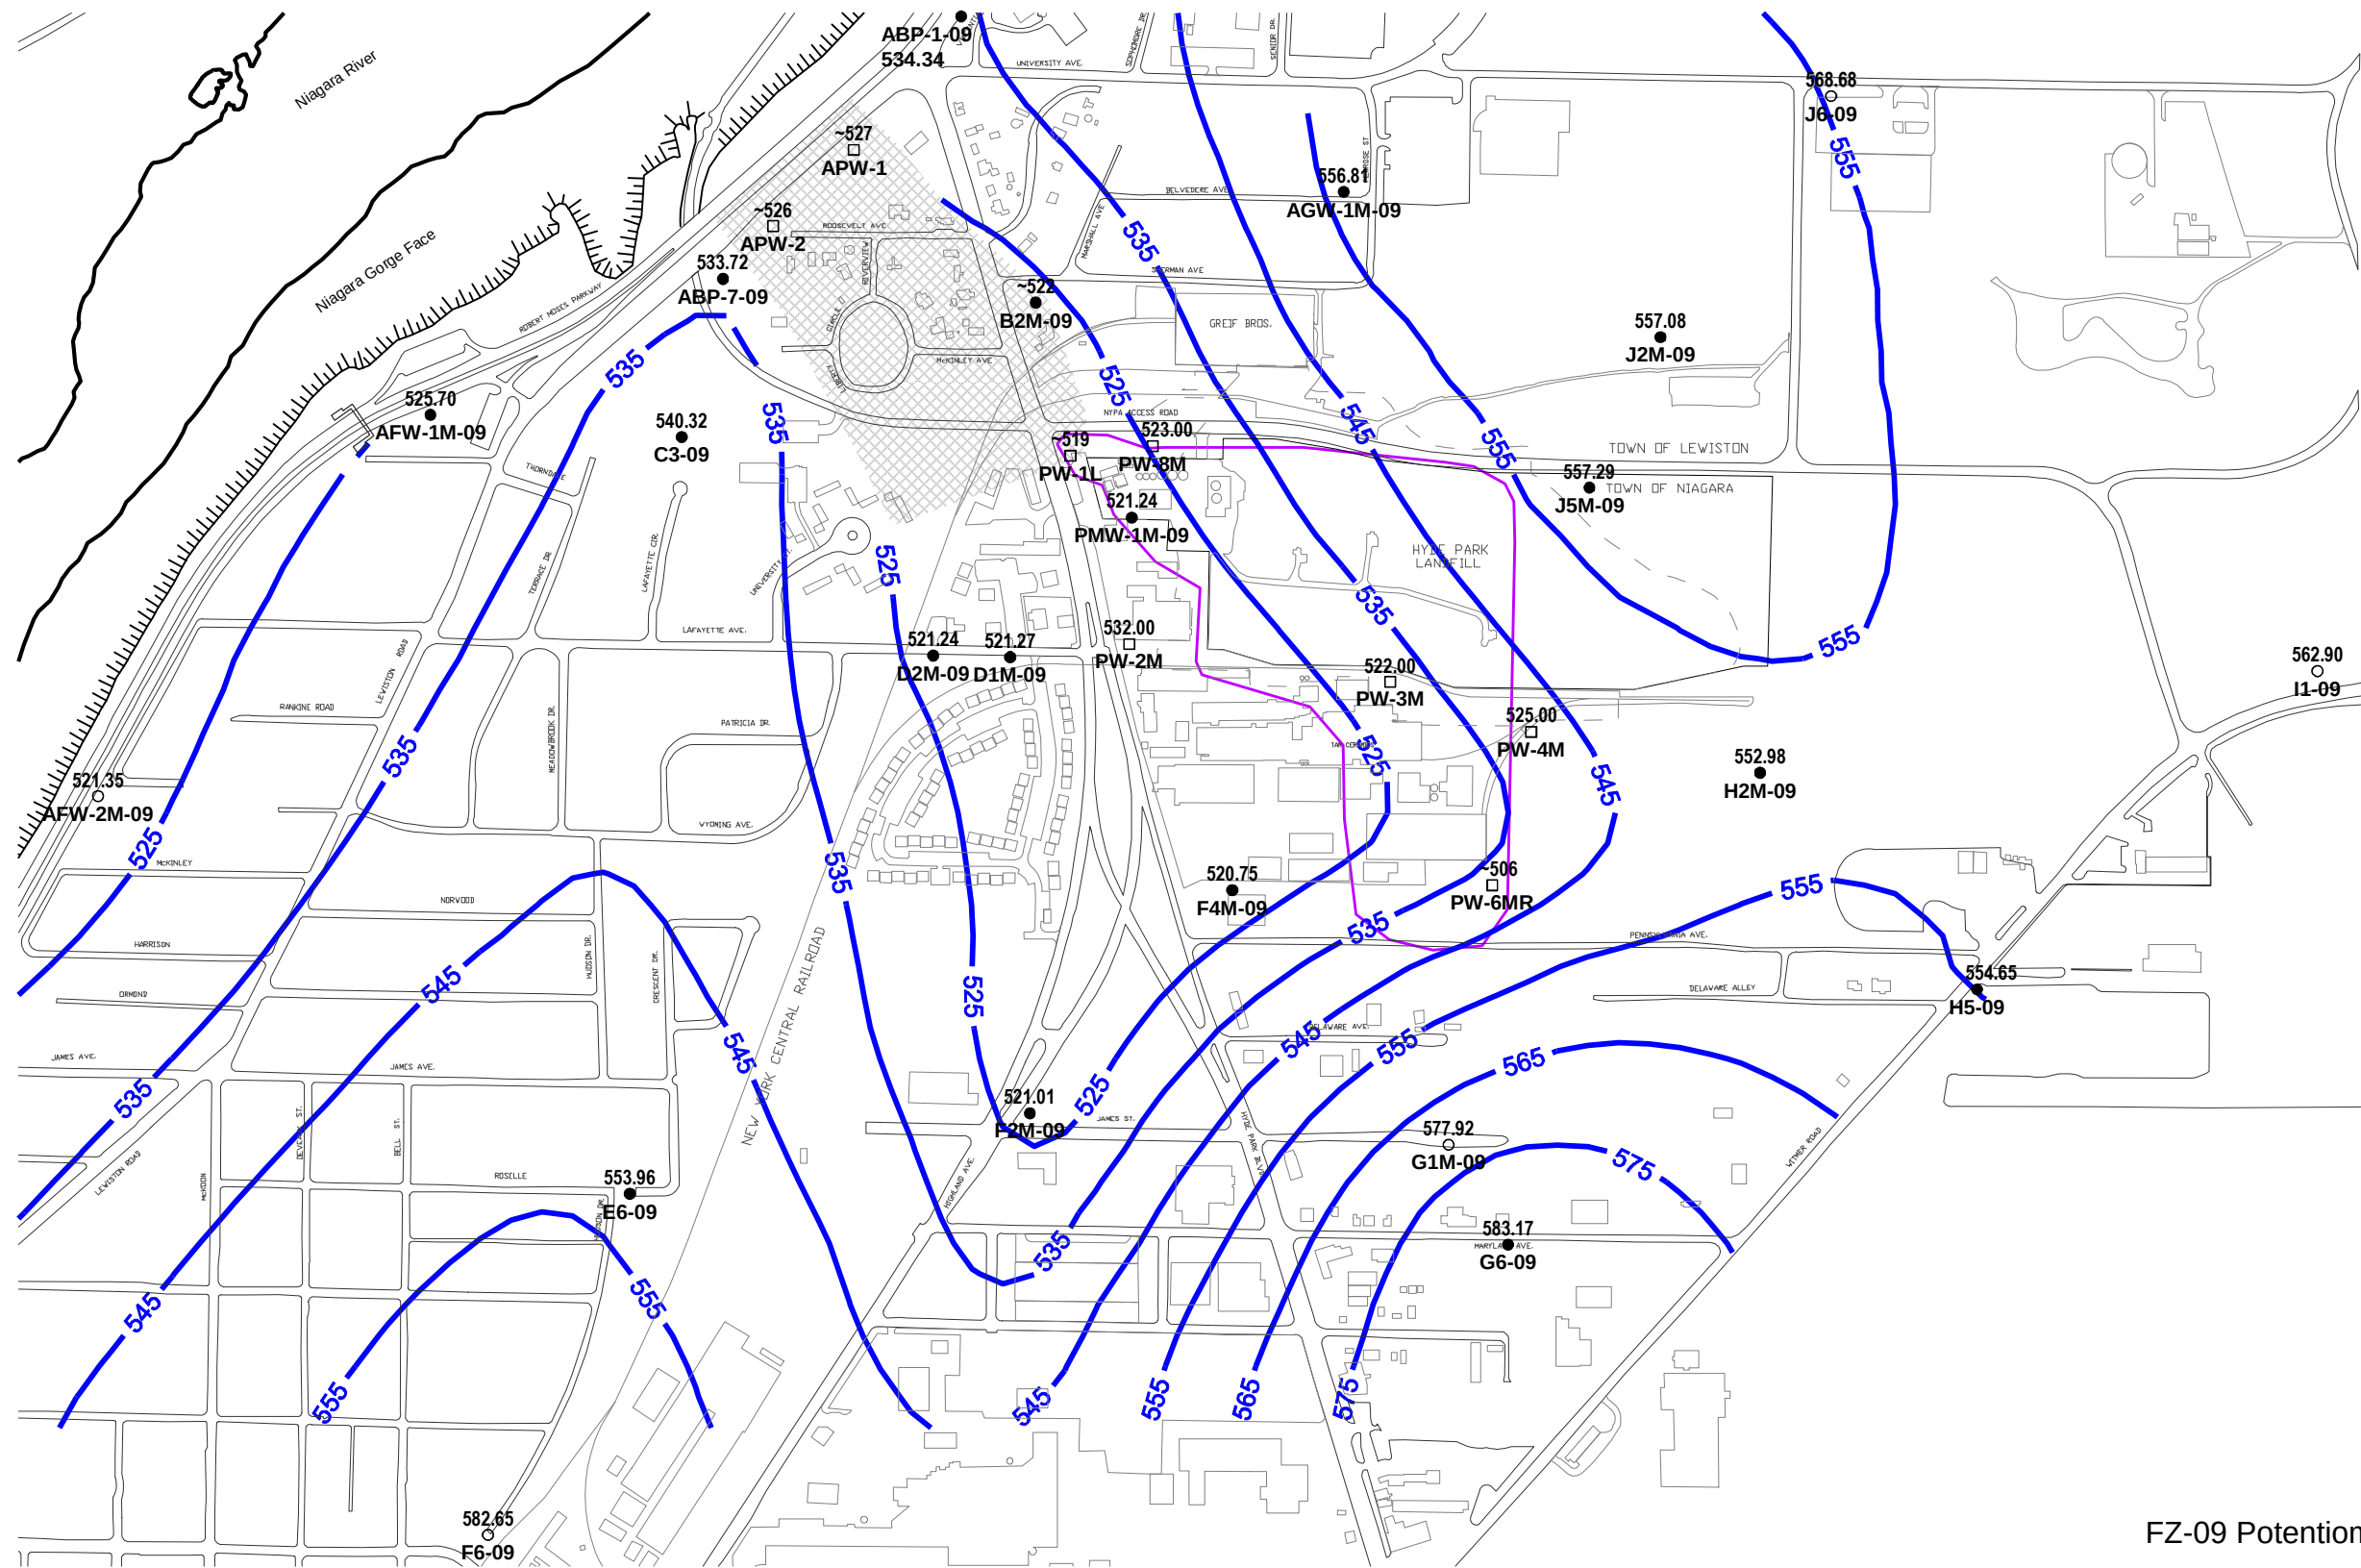

Legend


- Potentiometric Contour (ft AMSL)
- 2003 Delineation of NAPL Limits
- Flow Zone Subcrop
- Dewatered area of flow zone
- Piezometer used in contouring
- Piezometer considered unreliable - data not used in contouring
- Purge Well - data not used in contouring

Tilde indicates the flow zone elevation in a dewatered piezometer or purge well. Contours within the dewatered area are approximately the elevation of the flow zone.

~ 525



figure 7
 FZ-09 Potentiometric Surface June 2010
 2nd Quarter Report
 Hyde Park Landfill Site
 Glenn Springs Holdings, Inc.
 Niagara Falls, New York

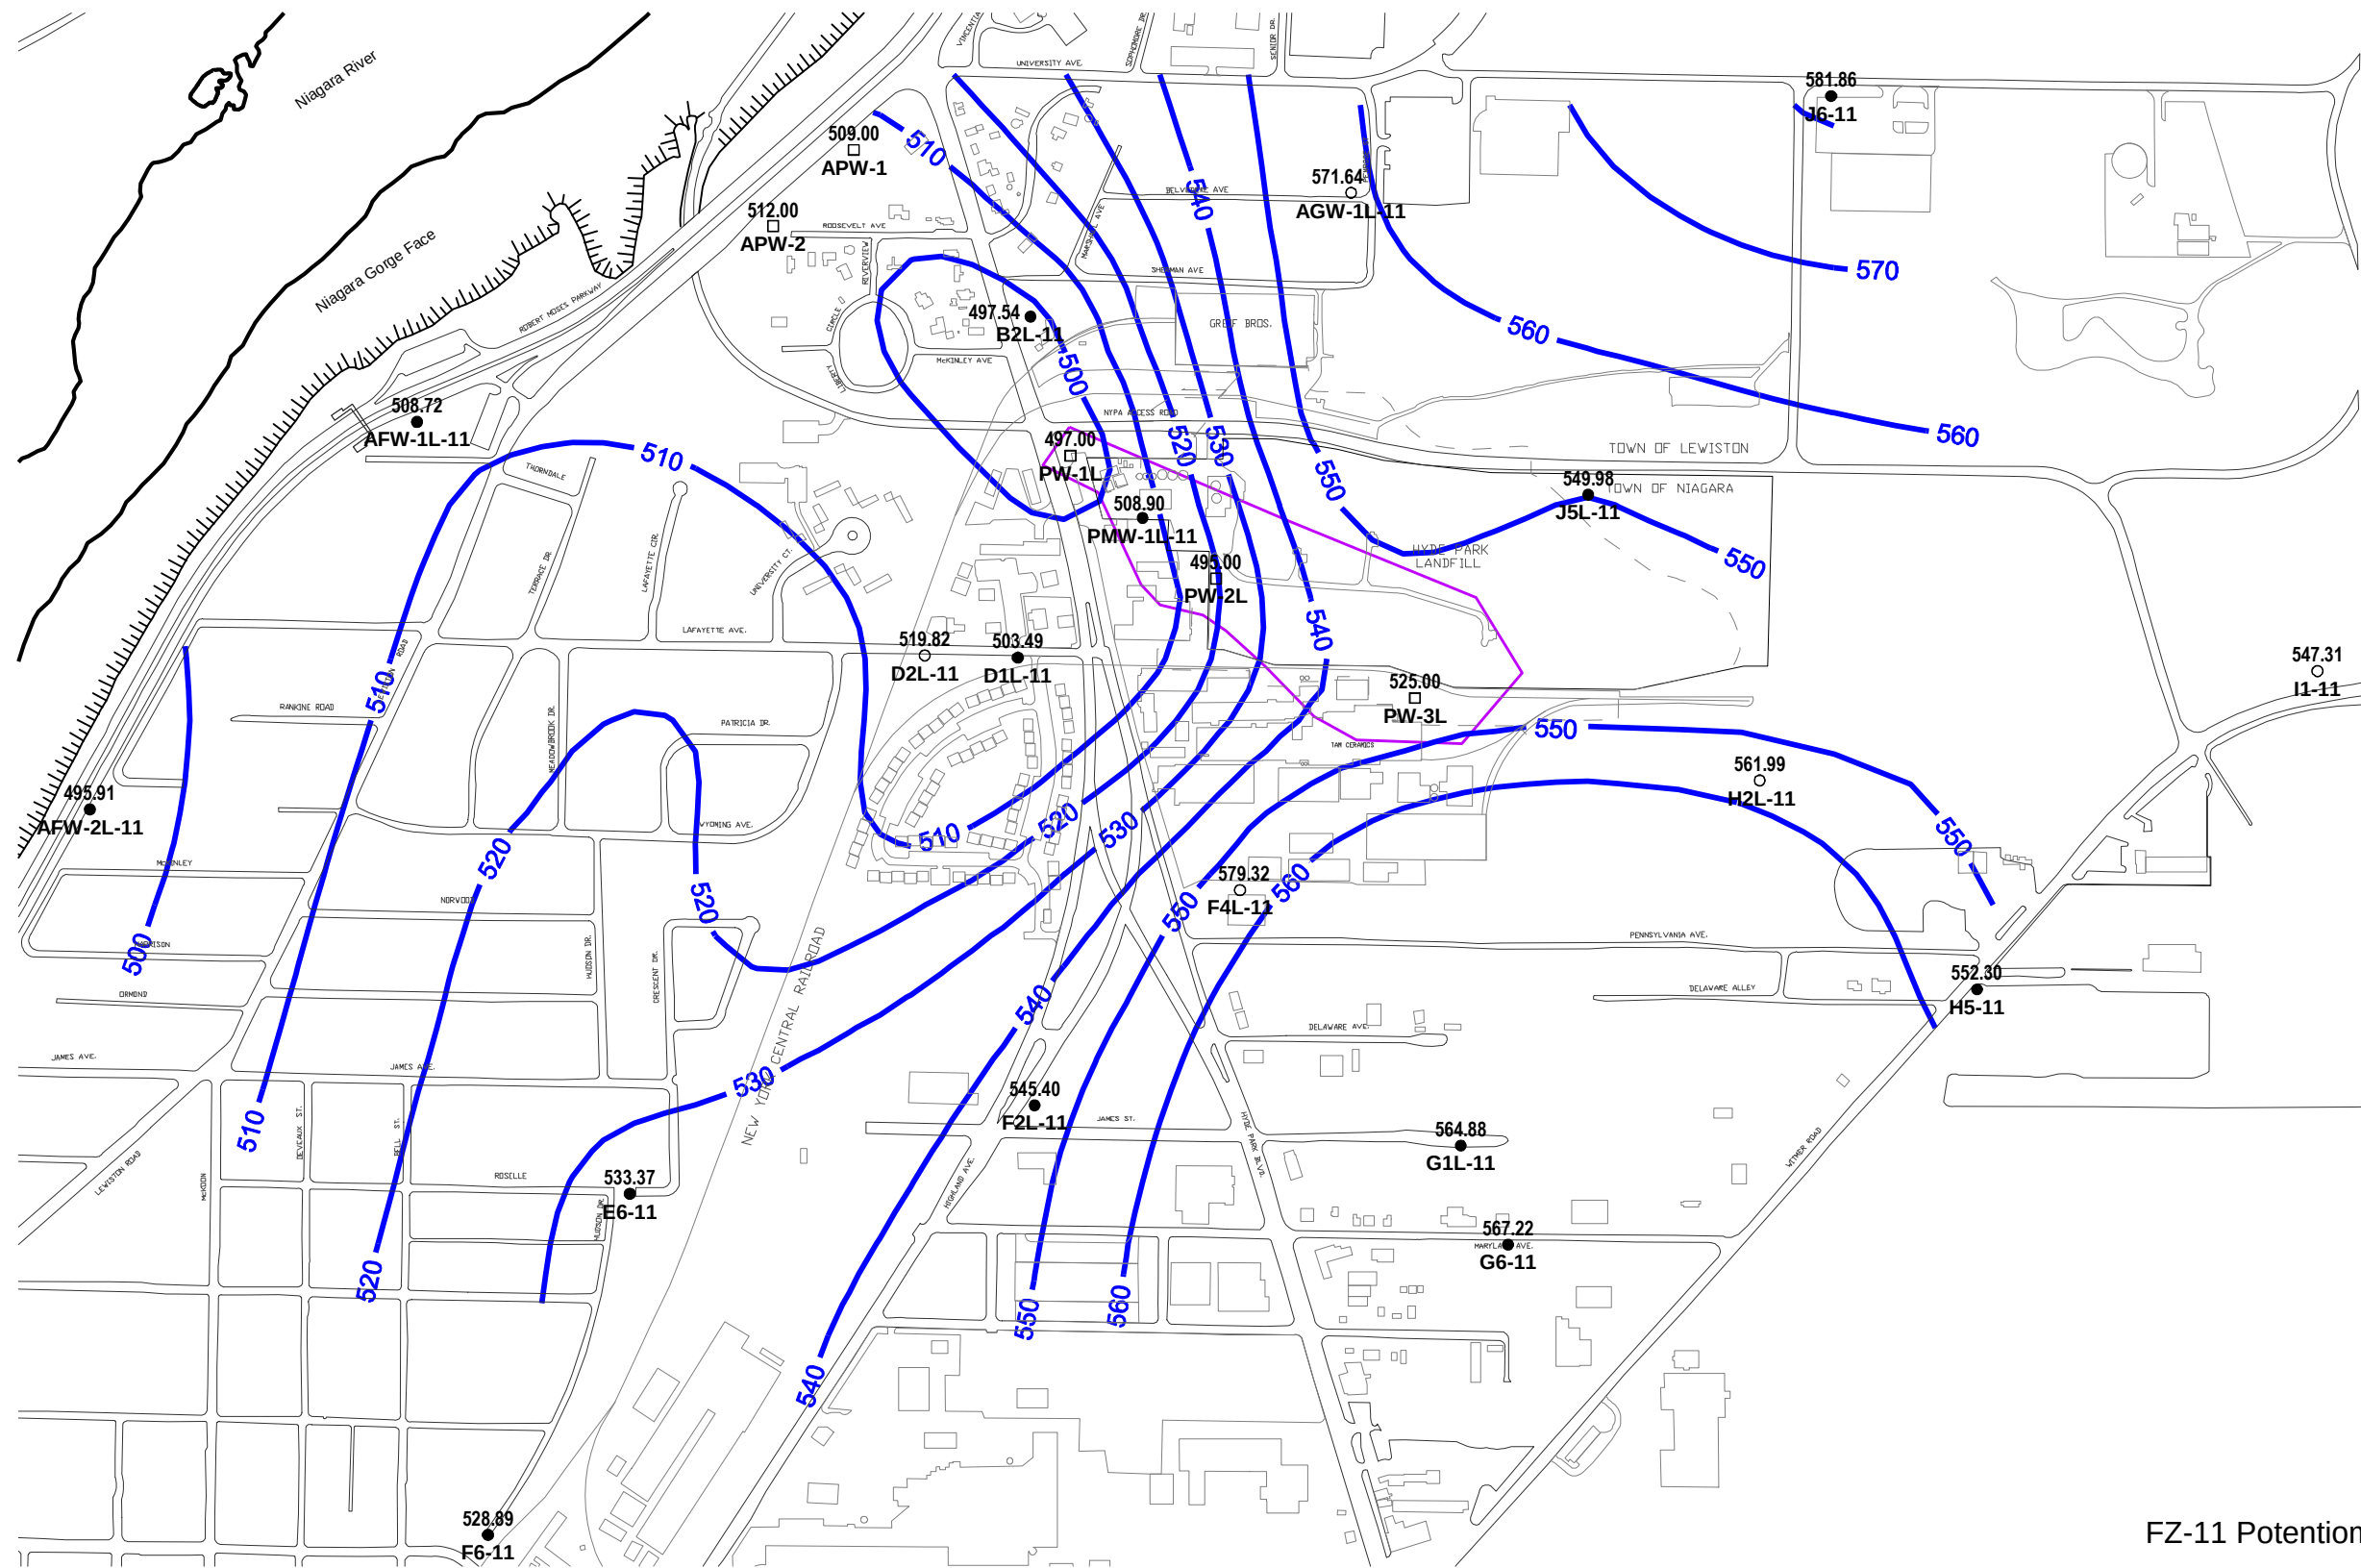


Legend

- Potentiometric Contour (ft AMSL)
- 2003 Delineation of NAPL Limits
- Flow Zone Subcrop
- Dewatered area of flow zone
- Piezometer used in contouring
- Piezometer considered unreliable - data not used in contouring
- Purge Well - data not used in contouring

Tilde indicates the flow zone elevation in a dewatered piezometer or purge well. Contours within the dewatered area are approximately the elevation of the flow zone.



figure 8
 FZ-11 Potentiometric Surface June 2010
 2nd Quarter Report
 Hyde Park Landfill Site
 Glenn Springs Holdings, Inc.
 Niagara Falls, New York

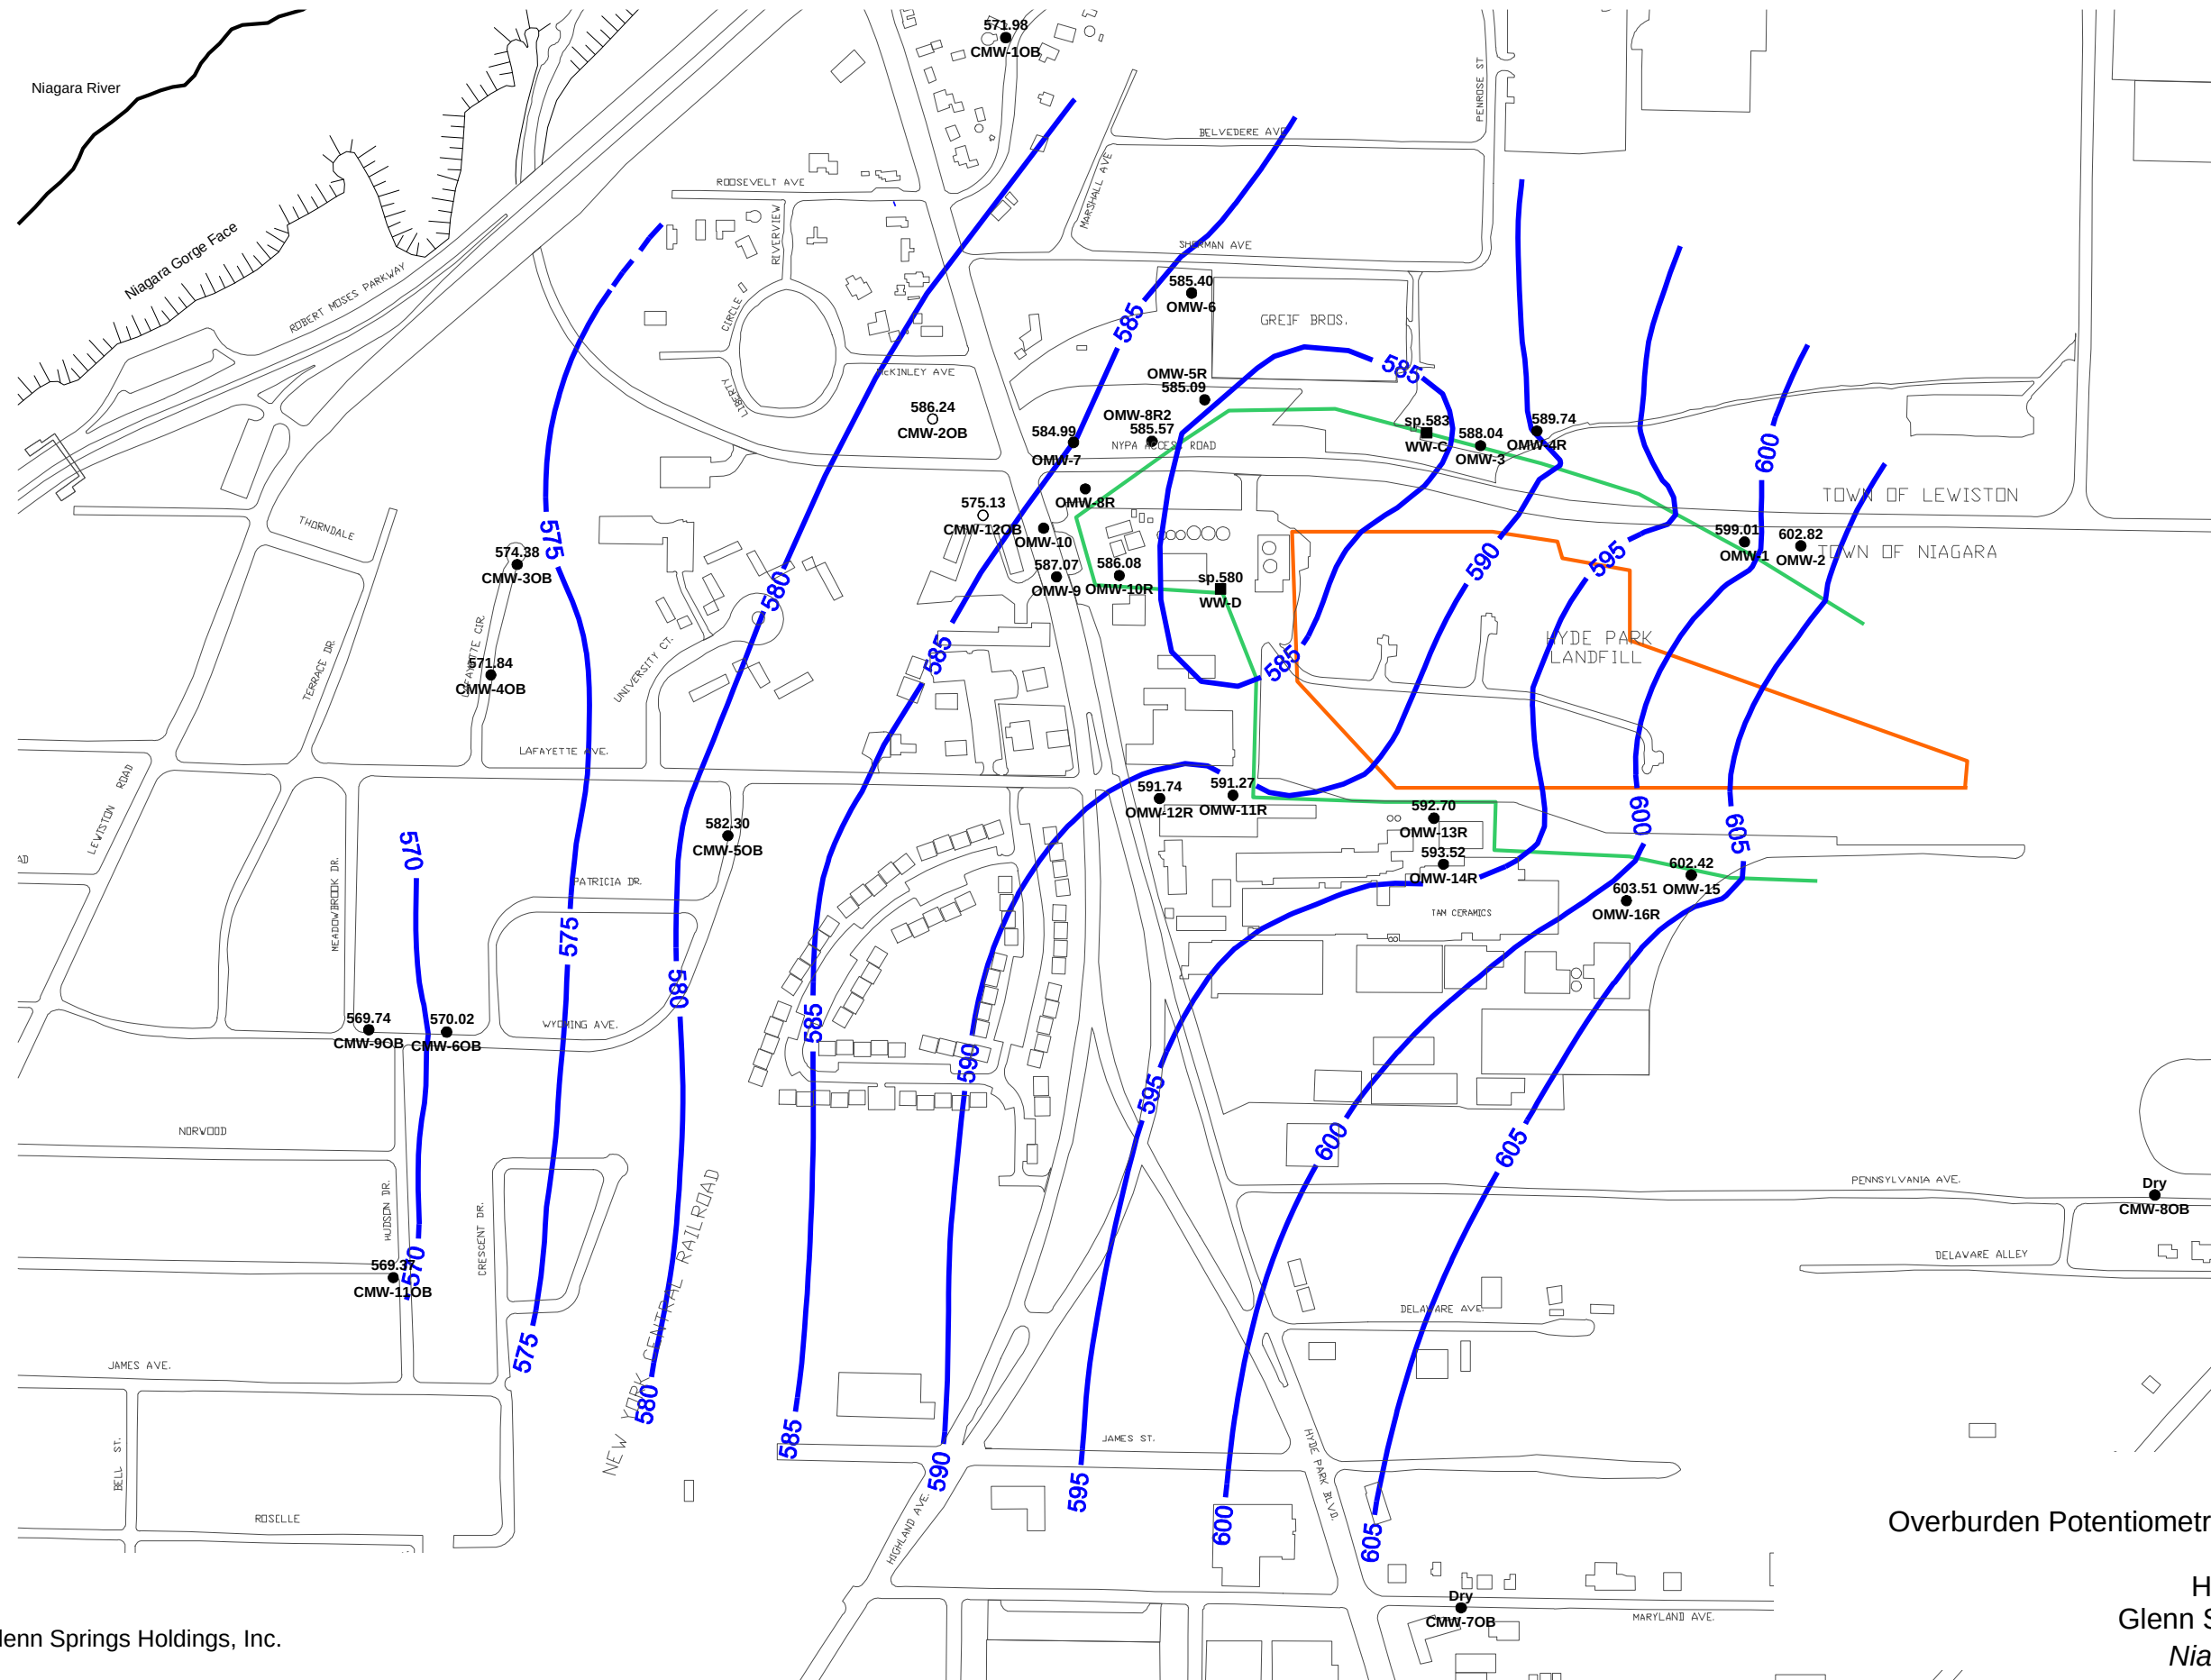

Legend

- Potentiometric Contour (ft AMSL)
- Existing Barrier Collection System
- Overburden Barrier Collection System
- Well used in contouring
- Well considered unreliable - data not used in contouring
- OBCWS Wet Wells pumped for recovery. Posted levels indicate the pumping setpoints. Setpoint levels were used for contouring.
- Indicates the well is dry; the posted value is the bottom of the well screened interval.

Note: Data values may overlap. If illegible, refer to tabulated data in the report.

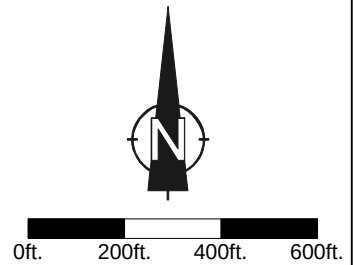


figure 9
Overburden Potentiometric Surface June 2010
2nd Quarter Report
Hyde Park Landfill Site
Glenn Springs Holdings, Inc.
Niagara Falls, New York

PMW-1M-09 2nd Quarter 2010 - Hourly Water Level Elevation

Glenn Springs Holdings, Inc.

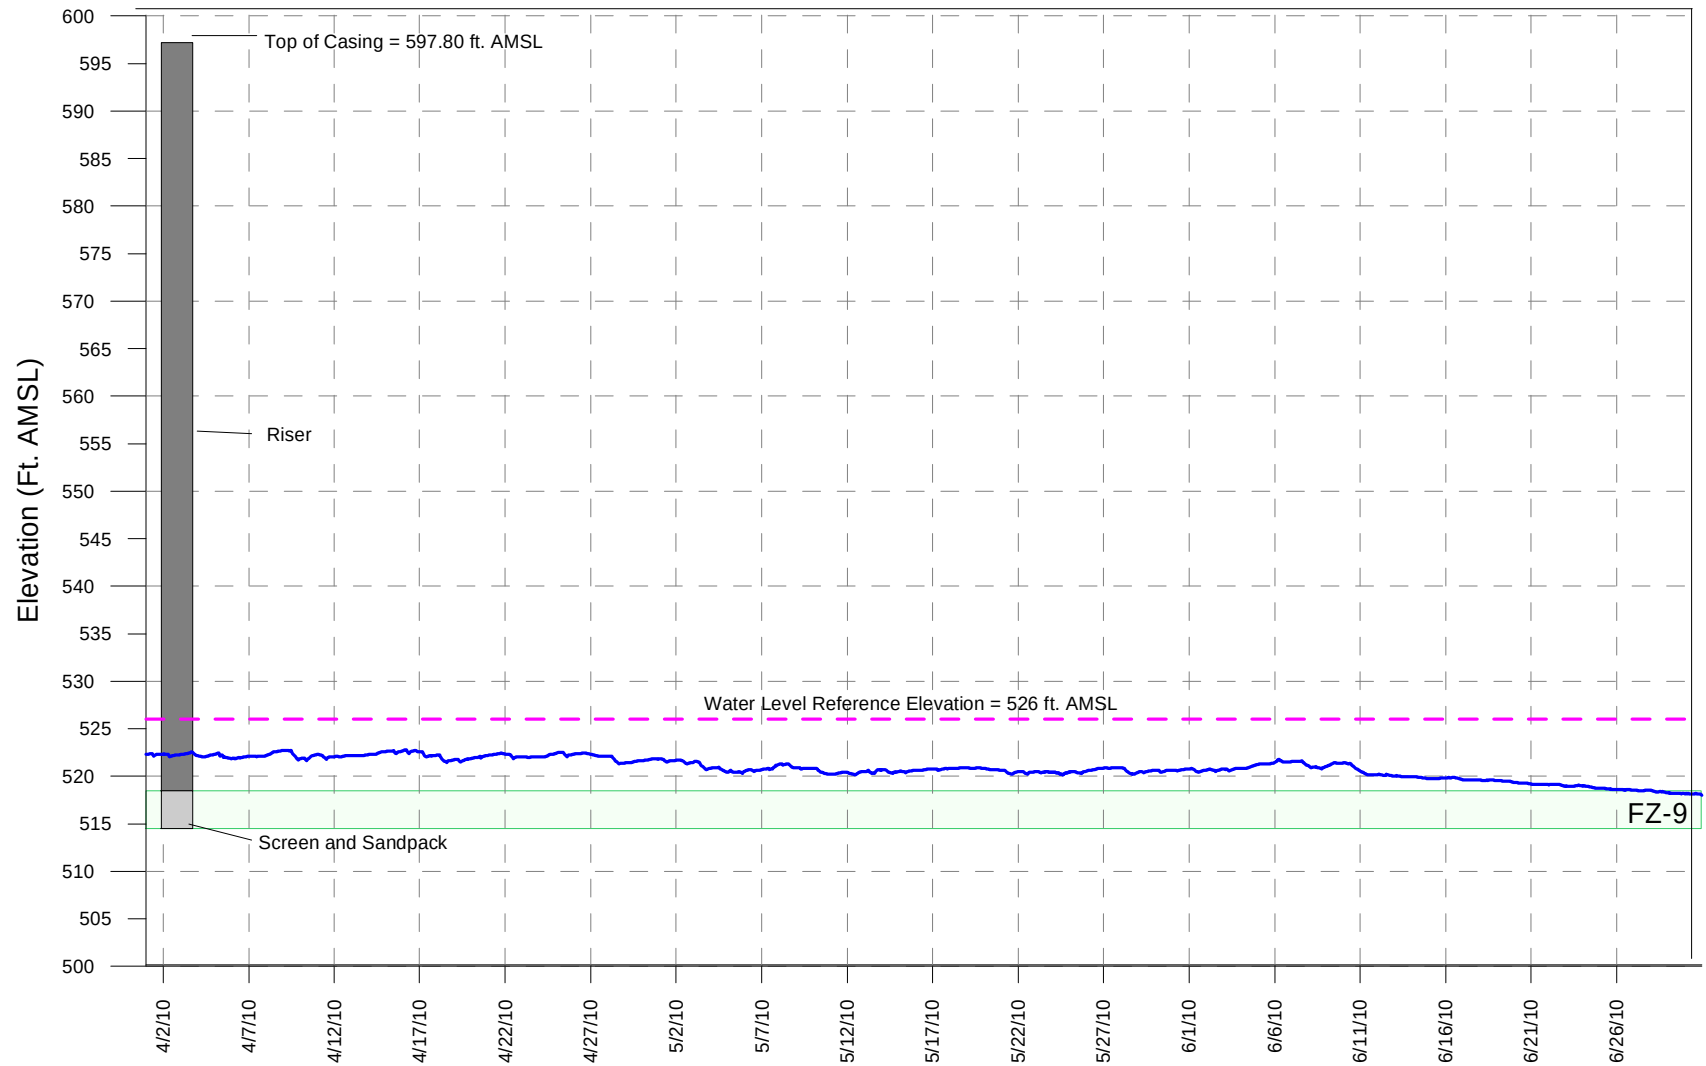


figure 10

TABLES

**WATER LEVEL ELEVATION SUMMARY
SECOND QUARTER - 2010
HYDE PARK RRT PROGRAM**

Well	Reference Elevation (ft AMSL)	Depth to Water (ft)	Water Level Elevation (ft AMSL)
Overburden			
CMW-2OB	590.79	4.55	586.24
CMW-3OB	582.13	7.75	574.38
CMW-4OB	574.28	2.44	571.84
CMW-5OB	583.43	1.13	582.30
CMW-6OB	571.89	1.87	570.02
CMW-7OB	611.00	Dry	-
CMW-8OB	616.11	Dry	-
CMW-9OB	571.76	2.02	569.74
CMW-10B	576.80	4.82	571.98
CMW-11OB	572.85	3.48	569.37
CMW-12OB	594.74	19.61	575.13
OMW-1	605.28	6.27	599.01
OMW-2	605.99	3.17	602.82
OMW-3	598.63	10.59	588.04
OMW-4R	601.17	11.43	589.74
OMW-5R	591.31	6.22	585.09
OMW-6	587.62	2.22	585.40
OMW-7	592.74	7.75	584.99
OMW-8R2	594.67	9.10	585.57
OMW-9	595.52	8.45	587.07
OMW-10R	595.13	9.05	586.08
OMW-11R	597.52	6.25	591.27
OMW-12R	596.79	5.05	591.74
OMW-13R	601.50	8.80	592.70
OMW-14R	599.64	6.12	593.52
OMW-15	607.48	5.06	602.42
OMW-16R	607.62	4.11	603.51
SC-2	625.61	21.91	603.70
SC-3	638.72	39.95	598.77
SC-4	639.35	-	-
SC-5	634.07	Dry	-
SC-6	631.15	16.39	614.76
Shallow Bedrock			
CMW-1SH	576.11	11.88	564.23
CMW-2SH	590.51	19.55	570.96
CMW-3SH	581.91	32.70	549.21
CMW-4SH	574.16	7.85	566.31
CMW-5SH	583.36	7.35	576.01
CMW-6SH	572.05	10.52	561.53
CMW-7SH	610.58	11.65	598.93
CMW-8SH	615.95	7.32	608.63
CMW-9SH	571.96	12.11	559.85
CMW-11SH	573.21	8.25	564.96
CMW-12SH	597.02	27.22	569.80
Flow Zone 1			
G1U-01	617.08	14.75	602.33
G6-01	609.24	7.06	602.18
H2U-01	620.92	10.09	610.83
H5-01	617.61	22.98	594.63
I1-01	621.55	21.70	599.85

**WATER LEVEL ELEVATION SUMMARY
SECOND QUARTER - 2010
HYDE PARK RRT PROGRAM**

Well	Reference Elevation (ft AMSL)	Depth to Water (ft)	Water Level Elevation (ft AMSL)
Flow Zone 2			
F2U-02	599.89	24.42	575.47
F4U-02	602.32	16.11	586.21
G1-02	616.86	25.28	591.58
G6-02	608.65	17.43	591.22
H2U-02	620.88	27.30	593.58
H5-02	617.47	23.70	593.77
I1-02	621.42	33.70	587.72
J2U-02	609.66	15.51	594.15
J5U-02	606.21	11.00	595.21
J6-02	609.23	15.13	594.10
Flow Zone 4			
AFW-2U-04	593.48	17.07	576.41
D1U-04	593.77	13.70	580.07
D2U-04	590.65	10.75	579.90
E6-04	578.23	13.53	564.70
F2U-04	599.76	21.78	577.98
F4U-04	602.19	16.49	585.70
F6-04	588.06	18.22	569.84
G1U-04	616.96	25.52	591.44
G6-04	609.15	17.56	591.59
H5-04	617.40	23.90	593.50
I1-04	621.31	35.87	585.44
J2U-04	609.42	17.80	591.62
J5U-04	606.05	20.48	585.57
J6-04	609.12	25.32	583.80
Flow Zone 5			
AFW-2U-05	593.33	16.65	576.68
AGW-1U-05	591.80	9.08	582.72
D1U-05	593.51	14.29	579.22
D2U-05	590.56	11.42	579.14
E6-05	578.04	11.35	566.69
F2U-05	599.64	21.49	578.15
F4U-05	602.06	17.64	584.42
F6-05	587.85	18.13	569.72
G6-05	609.13	19.86	589.27
H2M-05	621.59	28.35	593.24
H5-05	617.31	25.05	592.26
I1-05	621.21	64.25	556.96
J2U-05	609.30	31.32	577.98
J5U-05	605.87	28.01	577.86
J6-05	609.02	29.39	579.63
PMW-1U-05	598.00	21.81	576.19

**WATER LEVEL ELEVATION SUMMARY
SECOND QUARTER - 2010
HYDE PARK RRT PROGRAM**

Well	Reference Elevation (ft AMSL)	Depth to Water (ft)	Water Level Elevation (ft AMSL)
Flow Zone 6			
ABP-7-06	575.78	Dry	-
AFW-1U-06	571.83	14.49	557.34
AFW-2U-06	593.22	Dry	-
AGW-1U-06	591.66	37.72	553.94
B2U-06	589.29	35.74	553.55
C3-06	585.78	Dry	-
D1U-06	593.25	46.38	546.87
D2U-06	590.38	43.30	547.08
E6-06	577.99	4.82	573.17
F2M-06	599.06	35.50	563.56
F4M-06	602.05	51.16	550.89
F6-06	587.84	14.68	573.16
G1M-06	616.75	43.43	573.32
G6-06	609.09	34.10	574.99
H2M-06	621.42	60.66	560.76
H5-06	617.17	28.47	588.70
I1-06	621.08	69.61	551.47
J2M-06	608.94	54.48	554.46
J5M-06	606.22	59.45	546.77
J6-06	608.93	33.88	575.05
PMW-1U-06	597.92	50.41	547.51
Flow Zone 7			
ABP-1-07	576.44	29.36	547.08
ABP-7-07	575.73	41.12	534.61
AFW-1M-07	571.41	Dry	-
AFW-2M-07	593.44	66.76	526.68
AGW-1M-07	592.91	36.07	556.84
B2M-07	589.52	54.23	535.29
C3-07	585.62	43.87	541.75
D1M-07	594.15	61.79	532.36
D2M-07	590.77	67.39	523.38
E6-07	577.91	25.80	552.11
F2M-07	598.91	77.41	521.50
F4M-07	601.91	71.00	530.91
F6-07	587.68	20.30	567.38
G1M-07	616.68	34.15	582.53
G6-07	609.06	26.95	582.11
H5-07	617.05	60.88	556.17
I1-07	620.97	65.68	555.29
J5M-07	606.07	48.76	557.31
J6-07	608.85	51.87	556.98
PMW-1M-07	598.50	65.52	532.98

**WATER LEVEL ELEVATION SUMMARY
SECOND QUARTER - 2010
HYDE PARK RRT PROGRAM**

Well	Reference Elevation (ft AMSL)	Depth to Water (ft)	Water Level Elevation (ft AMSL)
Flow Zone 9			
ABP-1-09	575.49	41.15	534.34
ABP-7-09	575.67	41.95	533.72
AFW-1M-09	571.12	45.42	525.70
AFW-2M-09	593.32	71.97	521.35
AGW-1M-09	592.75	35.94	556.81
B2M-09	589.34	68.00	521.34
C3-09	585.00	44.68	540.32
D1M-09	594.02	72.75	521.27
D2M-09	590.66	69.42	521.24
E6-09	577.82	23.86	553.96
F2M-09	598.71	77.70	521.01
F4M-09	601.79	81.04	520.75
F6-09	587.53	4.88	582.65
G1M-09	616.58	38.66	577.92
G6-09	608.98	25.81	583.17
H2M-09	621.32	68.34	552.98
H5-09	616.93	62.28	554.65
I1-09	620.86	57.96	562.90
J2M-09	608.77	51.69	557.08
J5M-09	605.82	48.53	557.29
J6-09	608.76	40.08	568.68
PMW-1M-09	598.34	77.10	521.24
Flow Zone 11			
AFW-1L-11	572.10	63.38	508.72
AFW-2L-11	593.43	97.52	495.91
AGW-1L-11	592.71	21.07	571.64
B2L-11	589.65	92.11	497.54
D1L-11	593.80	90.31	503.49
D2L-11	590.21	70.39	519.82
E6-11	577.72	44.35	533.37
F2L-11	598.94	53.54	545.40
F4L-11	602.22	22.90	579.32
F6-11	587.40	58.51	528.89
G1L-11	616.84	51.96	564.88
G6-11	608.89	41.67	567.22
H2L-11	620.73	58.74	561.99
H5-11	616.81	64.51	552.30
I1-11	620.71	73.40	547.31
J5L-11	607.20	57.22	549.98
J6-11	608.68	26.82	581.86
PMW-1L-11	598.84	89.94	508.90

Notes

- Not available.
ft AMSL Feet Above Mean Sea Level.

**LEACHATE TREATMENT SYSTEM DAILY EFFLUENT MONITORING DATA
SECOND QUARTER - 2010
HYDE PARK RRT PROGRAM**

<i>Date</i>	<i>Phenol (mg/L)</i>	<i>pH (su)</i>	<i>Flow (gal)</i>	<i>Effluent</i>	<i>Comments</i>
04/05/10	-	-	173,000		
04/06/10	-	7.00	486,000		
04/07/10	0.012	7.00	117,000		
04/09/10	-	6.90	119,000		
04/11/10	-	-	381,000		
04/12/10	-	-	156,000		
04/13/10	0.012	7.00	104,000		
04/15/10	-	6.90	392,000		
04/16/10	-	6.90	113,000		
04/19/10	-	-	116,000		
04/20/10	-	6.80	136,000		
04/21/10	0.010 U	-	105,000		
04/22/10	-	6.90	329,000		
04/27/10	-	7.20	137,000		
04/28/10	0.010	7.10	117,000		
04/29/10	-	7.00	312,000		
04/30/10	-	7.10	31,000		
05/03/10	-	7.10	128,000		
05/04/10	-	7.00	109,000		
05/05/10	-	7.00	140,000		
05/06/10	0.020	7.20	91,000		
05/07/10	-	7.10	82,000		
05/10/10	-	7.10	151,000		
05/11/10	-	7.00	123,000		
05/12/10	0.010 U	7.00	121,000		
05/13/10	-	7.20	117,000		
05/14/10	-	7.10	85,000		
05/17/10	-	6.90	131,000		
05/18/10	-	7.00	128,000		
05/19/10	0.010 U	7.00	121,000		
05/20/10	-	7.20	121,000		
05/21/10	-	7.20	108,000		
05/24/10	-	7.10	118,000		
05/25/10	0.010 U	7.20	128,000		
05/26/10	-	7.20	128,000		
05/27/10	-	7.10	70,000		
05/28/10	-	7.00	74,000		

**LEACHATE TREATMENT SYSTEM DAILY EFFLUENT MONITORING DATA
SECOND QUARTER - 2010
HYDE PARK RRT PROGRAM**

<i>Date</i>	<i>Phenol (mg/L)</i>	<i>pH (su)</i>	<i>Flow (gal)</i>	<i>Effluent</i>	<i>Comments</i>
06/01/10	-	7.10	117,000		
06/02/10	0.010	7.00	178,000		
06/03/10	-	7.10	99,000		
06/04/10	-	7.00	97,000		
06/07/10	-	7.10	158,000		
06/08/10	-	7.00	135,000		
06/09/10	0.019	7.10	141,000		
06/10/10	-	7.00	140,000		
06/11/10	-	7.10	213,000		
06/14/10	-	7.10	132,000		
06/15/10	-	7.10	125,000		
06/16/10	0.010 U	7.10	117,000		
06/17/10	-	7.20	107,000		
06/18/10	-	7.10	66,000		
06/21/10	-	7.10	115,000		
06/22/10	-	7.10	87,000		
06/23/10	0.010 U	6.60	131,000		
06/24/10	-	6.90	138,000		
06/28/10	-	6.80	148,000		
06/29/10	-	6.80	137,000		
06/30/10	0.010 U	6.70	261,000		

Notes:

gal Gallons
 mg/L Milligram per liter
 su Standard unit
 U Non-detect at associated value
 - Not available

TABLE 3

ANALYTICAL RESULTS SUMMARY
WEEKLY SAMPLING - LEACHATE TREATMENT SYSTEM
SECOND QUARTER - 2010
HYDE PARK RRT PROGRAM

<i>Effluent</i>	<i>Parameter</i>	<i>Units</i>	<i>04/07/10</i>	<i>04/13/10</i>	<i>04/21/10</i>	<i>04/28/10</i>	<i>05/06/10</i>	<i>05/10/10</i>	<i>05/12/10</i>	<i>05/19/10</i>
Volatiles										
	1,1,1-Trichloroethane	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	1,1,2,2-Tetrachloroethane	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	1,1,2-Trichloroethane	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	1,1-Dichloroethane	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	1,1-Dichloroethene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	1,2,4-Trichlorobenzene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	1,2-Dichlorobenzene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	1,2-Dichloroethane	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	1,2-Dichloropropane	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	1,3-Dichlorobenzene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	1,4-Dichlorobenzene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	2-Chlorotoluene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	3-Chlorotoluene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	4-Chlorotoluene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	Benzene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	Bromodichloromethane	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	Bromoform	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	Bromomethane (Methyl Bromide)	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	Carbon disulfide	µg/L	1.0 U	0.68 J	0.28 J	0.57 J	1.0 U	-	1.0 U	1.0 U
	Carbon tetrachloride	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	Chlorobenzene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	Chloroethane	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	Chloroform (Trichloromethane)	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	Chloromethane (Methyl Chloride)	µg/L	0.69 J	0.32 J	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	cis-1,2-Dichloroethene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	cis-1,3-Dichloropropene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	Dichlorodifluoromethane (CFC-12)	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	Ethylbenzene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	Methylene chloride	µg/L	1.0 U	1.0 U	1.0 U	0.22 J	1.0 U	-	1.0 U	1.0 U
	m-Monochlorobenzotrifluoride	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	o-Monochlorobenzotrifluoride	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	p-Monochlorobenzotrifluoride	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	Styrene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	Tetrachloroethene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	Toluene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	trans-1,2-Dichloroethene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	trans-1,3-Dichloropropene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	Trichloroethene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	Trichlorofluoromethane (CFC-11)	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	Vinyl acetate	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	-	1.0 U	1.0 U
	Vinyl chloride	µg/L	140	180	140	160	190	170	210	180
	Xylene (total)	µg/L	15 U	15 U	15 U	15 U	3.0 U	-	3.0 U	15 U

TABLE 3

ANALYTICAL RESULTS SUMMARY
WEEKLY SAMPLING - LEACHATE TREATMENT SYSTEM
SECOND QUARTER - 2010
HYDE PARK RRT PROGRAM

Effluent

<i>Parameter</i>	<i>Units</i>	<u>05/25/10</u>	<u>06/02/10</u>	<u>06/09/10</u>	<u>06/16/10</u>	<u>06/23/10</u>	<u>06/30/10</u>
1,1,1-Trichloroethane	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
1,1,2,2-Tetrachloroethane	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
1,1,2-Trichloroethane	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
1,1-Dichloroethane	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
1,1-Dichloroethene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
1,2,4-Trichlorobenzene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
1,2-Dichlorobenzene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
1,2-Dichloroethane	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	0.26 J	1.0 U
1,2-Dichloropropane	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
1,3-Dichlorobenzene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
1,4-Dichlorobenzene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
2-Chlorotoluene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
3-Chlorotoluene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
4-Chlorotoluene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Benzene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Bromodichloromethane	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Bromoform	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Bromomethane (Methyl Bromide)	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Carbon disulfide	µg/L	14	1.0 U	0.93 J	1.0 U	1.0 U	1.0 U
Carbon tetrachloride	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Chlorobenzene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Chloroethane	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Chloroform (Trichloromethane)	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Chloromethane (Methyl Chloride)	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
cis-1,2-Dichloroethene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	2.0	1.4
cis-1,3-Dichloropropene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Dichlorodifluoromethane (CFC-12)	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Ethylbenzene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Methylene chloride	µg/L	0.21 J	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
m-Monochlorobenzotrifluoride	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
o-Monochlorobenzotrifluoride	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
p-Monochlorobenzotrifluoride	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Styrene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Tetrachloroethene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Toluene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
trans-1,2-Dichloroethene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
trans-1,3-Dichloropropene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Trichloroethene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Trichlorofluoromethane (CFC-11)	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Vinyl acetate	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Vinyl chloride	µg/L	240	310	280	270	13	14
Xylene (total)	µg/L	3.0 U	3.0 U	3.0 U	3.0 U	3.0 U	3.0 U

Notes:

J Estimated at associated value
 U Non-detect at associated value
 µg/L Microgram per liter
 - Not available/not applicable

ANALYTICAL RESULTS SUMMARY
 QUARTERLY SAMPLING - LEACHATE TREATMENT SYSTEM
 SECOND QUARTER - 2010
 HYDE PARK RRT PROGRAM

Effluent

	<i>Sample ID:</i>	<i>HP51010 EFF</i>	<i>EFFLUENT06232010</i>
	<i>Sample Date:</i>	<i>05/10/10</i>	<i>06/23/10</i>
<i>Parameter</i>	<i>Units</i>		
Phosphorus, Total	mg/L	0.279	-
Vinyl chloride	µg/L	-	13

Notes:

mg/L Milligrams per liter


µg/L Micrograms per liter

- Not available/not applicable

ATTACHMENT 1


SECOND QUARTER 2010 - PUMPING LEVELS AND FLOWS
HYDE PARK

Page 1 of 2

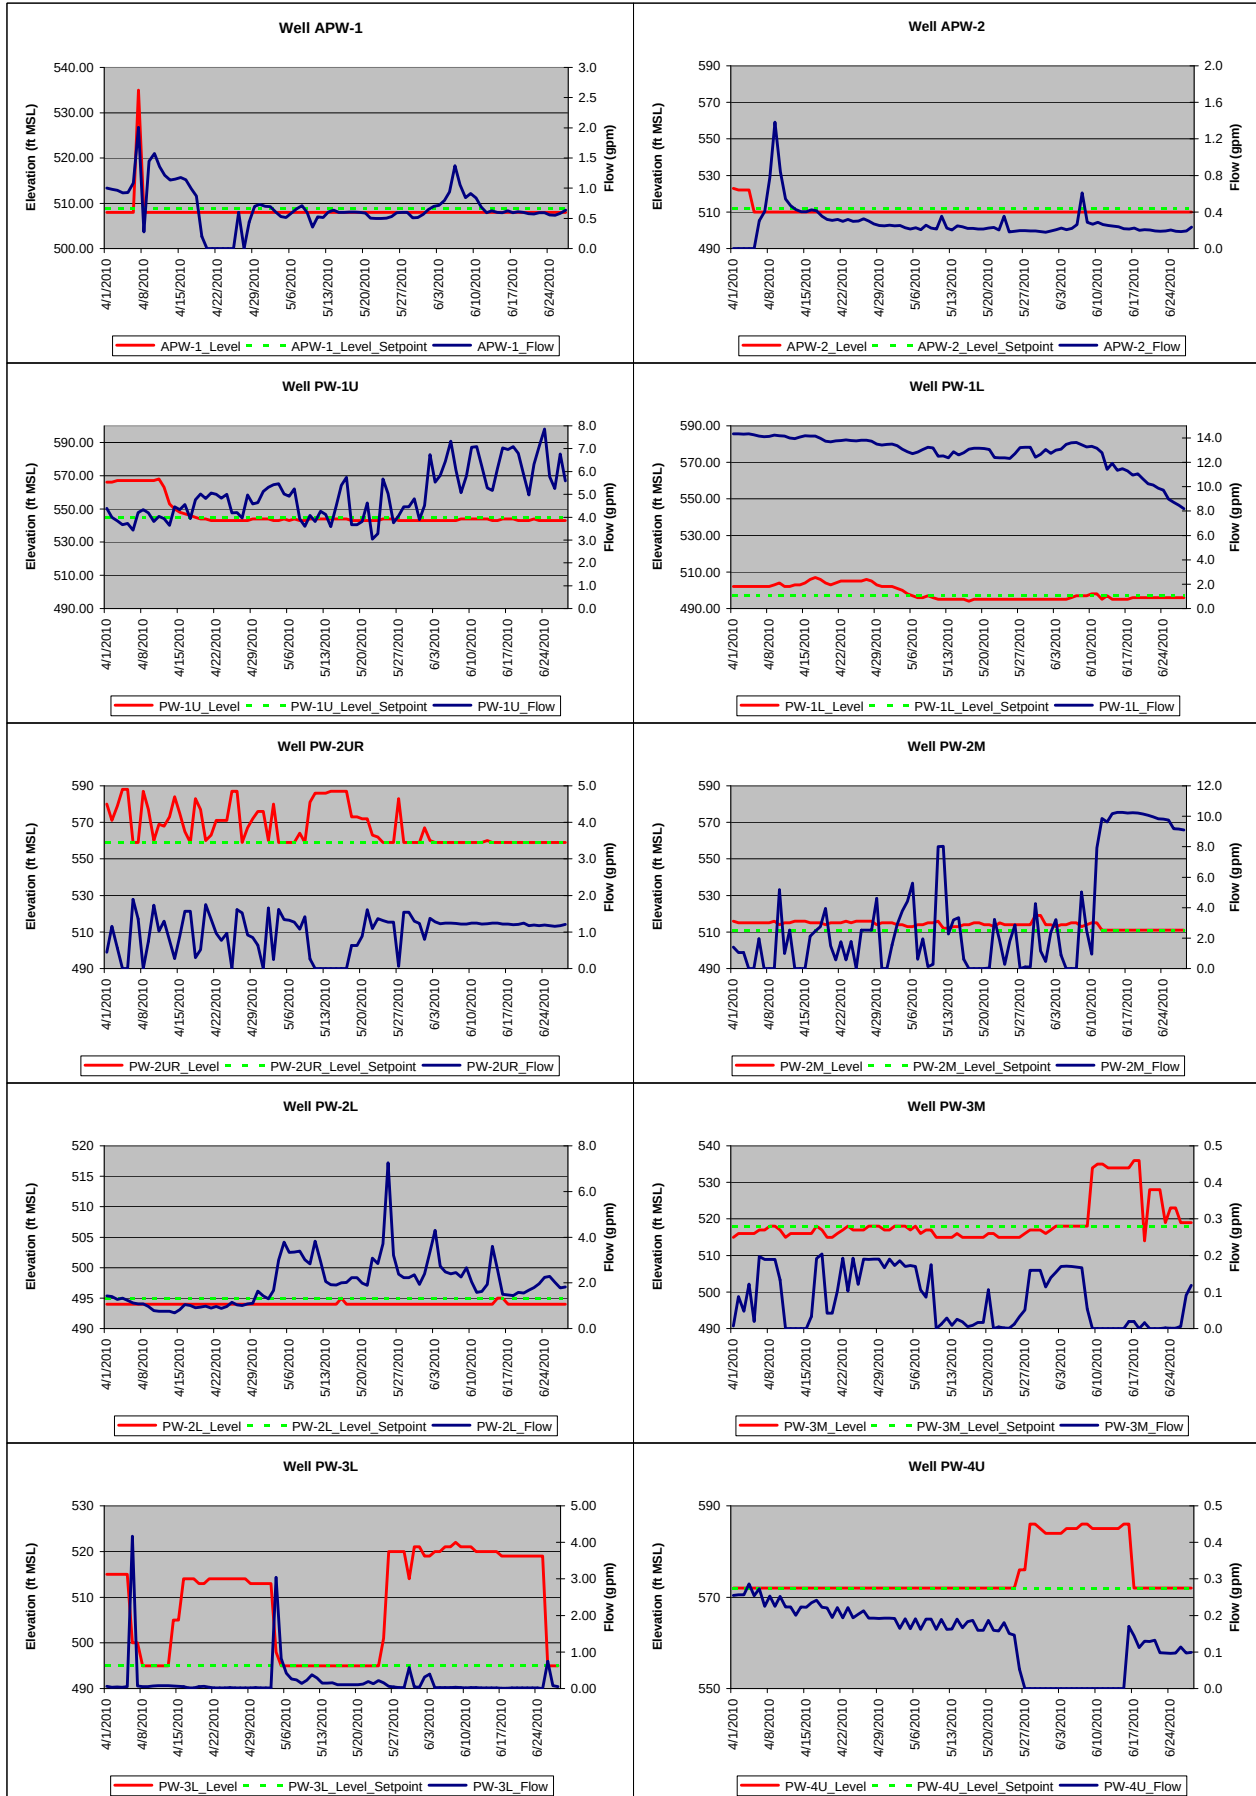

SECOND QUARTER 2010 - PUMPING LEVELS AND FLOWS
HYDE PARK

Page 2 of 2

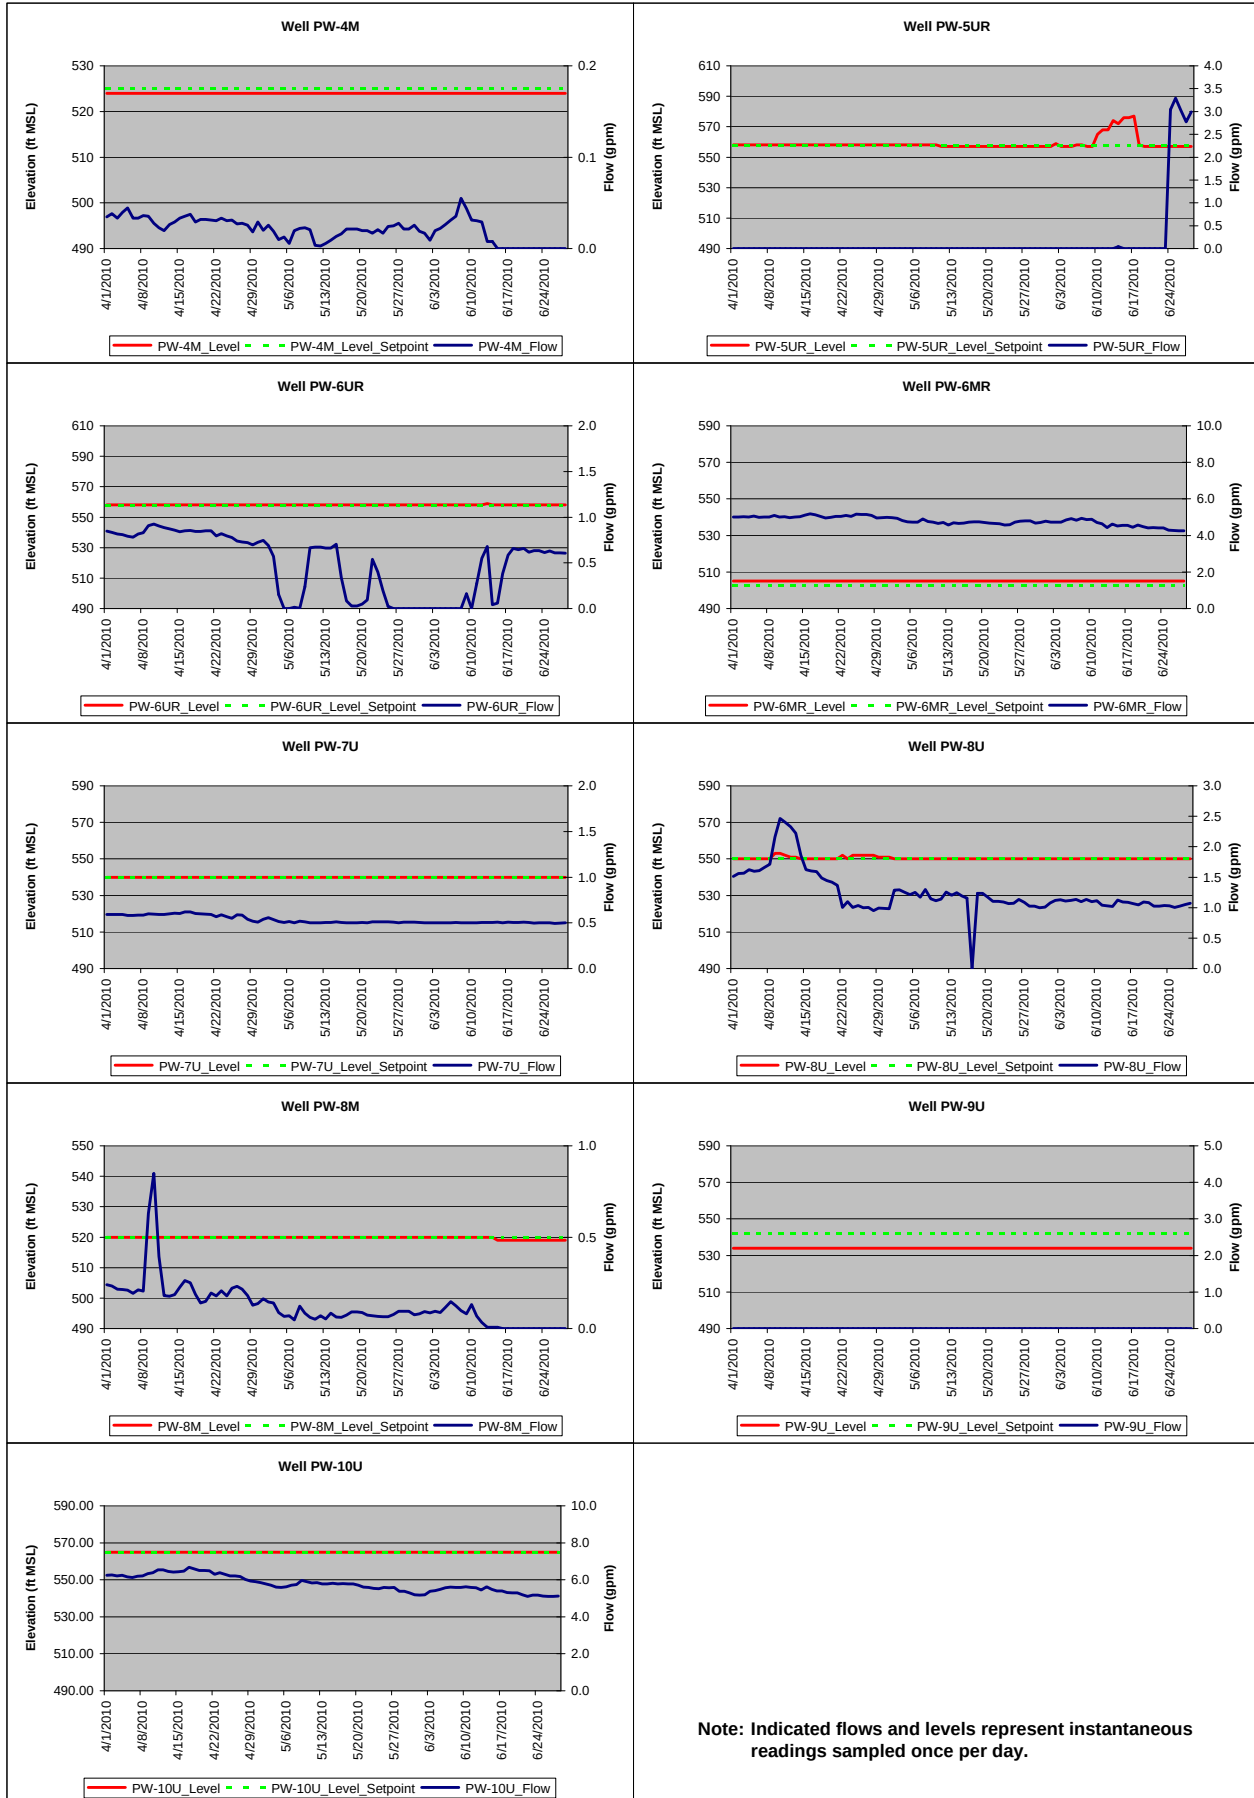

Note: Indicated flows and levels represent instantaneous readings sampled once per day.