




**FIFTH ANNUAL
OPERATION AND MONITORING REPORT
MAY 2005 TO MAY 2006**

**GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK**

PRINTED ON

AUG 31 2006

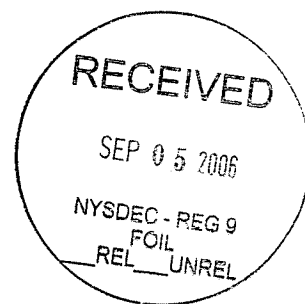

**FIFTH ANNUAL
OPERATION AND MONITORING REPORT
MAY 2005 TO MAY 2006**

**GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK**

AUGUST 2006

REF. NO. 007987 (33)

This report is printed on recycled paper.

**Prepared by:
Conestoga-Rovers
& Associates**

651 Colby Drive
Waterloo, Ontario
Canada N2V 1C2

Office: 519•884•0510
Fax: 519•884•0525

TABLE OF CONTENTS

	<u>Page</u>
1.0 INTRODUCTION.....	1
2.0 GROUNDWATER WITHDRAWAL SYSTEM (GWS)	2
2.1 HYDRAULIC MONITORING	2
2.2 GROUNDWATER QUALITY MONITORING.....	3
2.2.1 SAMPLE RESULTS.....	4
2.2.2 MONITORING FREQUENCY FOR 4-YEAR PERIOD MAY 2004 TO APRIL 2008	7
2.3 EFFLUENT MONITORING PROGRAM	8
2.3.1 SAMPLE RESULTS.....	8
2.3.2 MONITORING PROGRAM FOR 4-YEAR PERIOD MAY 2004 TO APRIL 2008	9
2.3.2.1 SAMPLING FREQUENCY	9
2.3.2.2 ANALYTICAL PARAMETERS	10
2.4 SURFACE WATER MONITORING PROGRAM.....	10
2.4.1 SAMPLE RESULTS.....	11
2.4.2 MONITORING FREQUENCY FOR 3-YEAR PERIOD MAY 2005 TO APRIL 2008	11
2.5 GWS OPERATIONS	11
2.6 GWS MAINTENANCE.....	12
3.0 SITE INSPECTIONS.....	14
4.0 CONCLUSIONS/RECOMMENDATIONS.....	15
4.1 OPERATION AND MAINTENANCE	15
4.2 MONITORING.....	15

LIST OF FIGURES
(Following Text)

FIGURE 2.1	MONITORING NETWORK
FIGURE 2.2	MW-6 TVOC AND TSVOC CONCENTRATIONS
FIGURE 2.3	MW-7 TVOC AND TSVOC CONCENTRATIONS
FIGURE 2.4	MW-8 TVOC AND TSVOC CONCENTRATIONS
FIGURE 2.5	MW-9 TVOC AND TSVOC CONCENTRATIONS
FIGURE 2.6	OGC-1 TVOC AND TSVOC CONCENTRATIONS
FIGURE 2.7	OGC-2 TVOC AND TSVOC CONCENTRATIONS
FIGURE 2.8	OGC-3 TVOC AND TSVOC CONCENTRATIONS
FIGURE 2.9	OGC-4 TVOC AND TSVOC CONCENTRATIONS
FIGURE 2.10	OGC-5 TVOC AND TSVOC CONCENTRATIONS
FIGURE 2.11	OGC-6 TVOC AND TSVOC CONCENTRATIONS
FIGURE 2.12	OGC-7 TVOC AND TSVOC CONCENTRATIONS
FIGURE 2.13	OGC-8 TVOC AND TSVOC CONCENTRATIONS
FIGURE 2.14	EFFLUENT TVOCS AND TSVOCS VS. TIME
FIGURE 2.15	EFFLUENT pH VS. TIME
FIGURE 2.16	EFFLUENT TOTAL SUSPENDED SOLIDS VS. TIME
FIGURE 2.17	EFFLUENT BOD VS. TIME
FIGURE 2.18	EFFLUENT VOLUME VS. TIME

LIST OF TABLES
(Following Text)

TABLE 2.1	GROUNDWATER HYDRAULIC MONITORING LOCATIONS
TABLE 2.2	WATER LEVELS (FT AMSL)
TABLE 2.3	SUMMARY OF HORIZONTAL GRADIENTS
TABLE 2.4	SUMMARY OF VERTICAL GRADIENTS
TABLE 2.5	GROUNDWATER SAMPLING SUMMARY
TABLE 2.6	SUMMARY OF DETECTED COMPOUNDS, SITE GROUNDWATER AND RIVER WATER
TABLE 2.7	PH READINGS
TABLE 2.8	EFFLUENT SAMPLING SUMMARY
TABLE 2.9	PROPOSED EFFLUENT SAMPLING SUMMARY, NEXT 3-YEAR PERIOD
TABLE 2.10	ANALYTICAL RESULTS SUMMARY, MONTHLY SITE EFFLUENT
TABLE 2.11	GROUNDWATER VOLUMES DISCHARGED TO NORTH TONAWANDA POTW
TABLE 2.12	SURFACE WATER SAMPLING SUMMARY

LIST OF APPENDICES

APPENDIX A	MONTHLY INSPECTION LOGS (NOVEMBER 2005 TO MAY 2006)
APPENDIX B	QA/QC REVIEWS

1.0 INTRODUCTION

This report is the fifth annual Operation and Monitoring Report (O&M Report) for the remedial actions constructed at the Gratwick-Riverside Park Site (Site) located in North Tonawanda, New York. This report covers the period from May 2005 to May 2006 and was prepared pursuant to Section 7.0 of the report entitled "Operation and Maintenance Manual" (O&M Manual) dated March 2002 (revised January 2004). It is noted that New York State Department of Environmental Conservation (NYSDEC) approval for the O&M Manual was given on April 20, 2005. All O&M activities have been performed in accordance with the methods and frequencies specified in the O&M Manual.

The frequency of sample collection and analyses has been modified pursuant to the frequency described in the previous annual report ("Fourth Annual Operation and Monitoring Report, May 2003 to April 2004"), except for the groundwater discharge sampling which remained monthly as presented in the O&M Manual. It is noted that NYSDEC approval was received on October 17, 2005 to modify the groundwater discharge monitoring from monthly to semi-annually and for a reduced list of parameters as recommended in Section 4.2 of the Fourth Annual O&M Report. This change was not implemented because EPA review of this modification was not performed until June 2006.

2.0 GROUNDWATER WITHDRAWAL SYSTEM (GWS)

Full-time operation of the Groundwater Withdrawal System (GWS) at the Site started on May 4, 2001. The objectives of the GWS are to:

- i) achieve and maintain an inward gradient from the Niagara River toward the GWS; and
- ii) achieve and maintain an upward gradient from the fill alluvium layer beneath the GWS.

In order to determine whether the objectives are being met, hydraulic and chemical monitoring programs have been developed. These programs include: Site groundwater; GWS effluent; and River surface water. The wells, manholes, wet wells, and storm sewer outfalls that comprise the monitoring network are shown on Figure 2.1. The monitoring programs are described in the following subsections.

2.1 HYDRAULIC MONITORING

Hydraulic monitoring consists of the collection of water levels in monitoring wells and manholes, and River water levels at the storm sewer outfalls. These data are then used to determine the vertical and horizontal gradients for the groundwater.

The water levels in four GWS manholes and in the River were monitored to confirm that an inward gradient exists. The water levels in five GWS manholes and in four monitoring wells installed near the GWS alignment in the materials directly overlying the confining unit were monitored to confirm that an upward gradient exists. The specific manholes and monitoring wells used to determine the horizontal and vertical gradients are listed in Table 2.1.

Groundwater elevations were measured on a monthly basis. The measured water levels from the beginning of the O&M period are presented in Table 2.2. Summaries of the horizontal and vertical gradients are provided in Tables 2.3 and 2.4, respectively.

The results for the horizontal gradient evaluation show that:

- i) inward horizontal gradients were achieved by May 11, 2001, within one week of the start of pumping the GWS;

- ii) the inward gradients were maintained for the remainder of the first two years except for a few short intervals in isolated areas; and
- iii) the inward gradients were maintained for the entire third, fourth, and fifth years (May 2003 to May 2006).

The short periods of outward gradient did not adversely affect the effectiveness of the remedy because:

- i) the gradients were outward for only short periods of time;
- ii) the outward gradients occurred over only a portion of the barrier wall;
- iii) the 36-inch barrier wall is six inches thicker than the design thickness thereby providing extra protection; and
- iv) any outward migration of Site groundwater into the barrier wall during the short periods of outward gradient are more than offset by the inward migration of river water into the barrier wall during the long periods of inward gradient.

The results for the vertical gradient evaluation showed that the vertical gradients were continually upward for all four monitoring pairs for the time period of May 2005 to May 2006, except for the location of monitoring well pair MH3/MW-6 at which a small downward gradient was measured in July 2005. An upward gradient existed at this well pair in all other monitoring events.

2.2 GROUNDWATER QUALITY MONITORING

Groundwater quality monitoring consists of the collection of water samples from on-Site overburden monitoring wells (OGC-1 through OGC-8 and MW-6 through MW-9) and the analysis of these samples to determine the concentrations of chemicals in the groundwater. The purpose of the groundwater quality monitoring program is to monitor the anticipated improvement in the quality of the overburden groundwater:

- i) between the barrier wall and the River (OGC-1 through OGC-4); and
- ii) in the fill/alluvium beneath the GWS (MW-6 through MW-9).

Groundwater quality monitoring locations are presented on Figure 2.1 and the analytical parameters and frequency are listed in Table 2.5.

The sampling frequency for the initial 2-year period after GWS startup was quarterly. Based on the 2-year results, the frequency for most wells was modified to semi-annual for the third year (May and November 2003). The exceptions to this are for SVOCs in OGC-4 and VOCs in OGC-6, which remained at quarterly for the third year. Sampling for years 4 through 7 (from May 2004 to April 2008) is on an annual basis.

2.2.1 SAMPLE RESULTS

A summary of compounds detected in the groundwater samples is presented in Table 2.6 and pH levels are presented in Table 2.7.

To evaluate the trends in the groundwater chemistry and evaluate the appropriate frequency of future sampling, the VOCs and SVOCs were summed and plotted on Figures 2.2 through 2.13 for each of the 12 monitoring wells included in the program. It is believed that the sum of the VOCs (i.e., TVOCs) and SVOCs (i.e., TSVOCs) best represent the trends in the groundwater chemistry.

Review of the TVOC and TSVOC concentrations with time show the following trends since May 2004:

- i) TVOCs:
 - decreasing concentrations in 2 of the 12 wells (MW-8 and OGC-7);
 - relatively constant concentrations with random fluctuations in 9 of the 12 wells (MW-6, MW-7, MW-9, OGC-1, OGC-2, OGC-3, OGC-4, OGC-5, and OGC-8); and
 - increasing concentrations in 1 of the 12 wells (OGC-6).
- ii) TSVOCs:
 - decreasing concentrations in 3 of 12 wells (MW-8, OGC-3, and OGC-4);
 - relatively constant concentrations with random fluctuations in 8 of the 12 wells (MW-6, MW-7, MW-9, OGC-1, OGC-2, OGC-5, OGC-7, and OGC-8); and
 - increasing concentrations in 1 of the 12 wells (OGC-6).

Many of the wells with decreasing or constant but fluctuating concentrations currently have only low level concentrations (i.e., <40 µg/L for TVOCs and TSVOCs). These are MW-6, MW-7, MW-9, OGC-1, OGC-2, OGC-3, OGC-4, OGC-5, and OGC-8 for TVOCs and MW-6, MW-7, MW-8, OGC-1, OGC-2, OGC-5, OGC-7, and OGC-8 for TSVOCs.

In summary, the number of wells with decreasing or constant but fluctuating concentrations at low level concentrations, shows that the groundwater is being remediated.

Additional description of the TVOC and TSVOC concentrations is provided in the following paragraphs. The MWs are located on the inside of the barrier wall and the OGC's are located between the barrier wall and the river.

The TVOC concentrations for MW-6 shown on Figure 2.2 fluctuated randomly between 2 and 9 µg/L from August 2001 to February 2003, increased to 64 µg/L in May 2003, and then decreased to a range of 16 to 32 µg/L for the time period from November 2003 to May 2006. The TSVOC concentrations, after the initial rapid decrease from 107 to 13 µg/L between May and November 2001, fluctuated randomly between non-detect (ND) and 25 µg/L until May 2003, then increased to 350 µg/L in November 2003 before decreasing to ND in May 2004. The TSVOC concentration remained low level (i.e., 5 and 3 µg/L) in the May 2005 and May 2006 samples, respectively. No reason for these large variations is apparent.

The TVOC and TSVOC concentrations for MW-7 on Figure 2.3 show that both TVOC and TSVOC peaked in May 2002 (18 and 41 µg/L, respectively) and then decreased to non-detect for both TVOC and TSVOC in May 2004. In the May 2006 samples, the TVOC and TSVOC concentrations remained low level at 3 µg/L and non-detect, respectively.

The TVOC concentrations for MW-8 on Figure 2.4 show that the trend in the TVOC concentrations is a continual increase with some fluctuations until November 2003 when the concentrations peaked at 1,000 µg/L. Thereafter, the concentrations continually decreased with a TVOC concentration of 319 µg/L in the May 2006 sample. The TSVOC concentrations after August 2001 ranged between 200 and 300 µg/L until November 2003 and since then have continually decreased with a TSVOC concentration of 31 µg/L in the May 2006 sample.

The TVOC concentrations for MW-9 on Figure 2.5 show that the TVOC concentrations ranged between 10 and 29 µg/L. The TSVOC concentrations, not considering the May 2002 non-detect results which appear to be anomalous, fluctuated randomly between 140 to 280 µg/L from May 2001 to May 2003, increased to 380 µg/L in November 2003, and then fluctuated between 270 and 350 µg/L in the May 2004, May 2005, and May 2006 samples.

All MWs are located on the inside of the barrier wall and an inward gradient has always been maintained in the vicinity of these wells. Thus, the TVOCs and TSVOCs are not migrating to the Niagara River.

The TVOC concentrations for OGC-1 on Figure 2.6 show that the concentrations since February 2002 ranged between 0.5 and 13 µg/L. The TSVOC concentrations after November 2001, have fluctuated between non-detect and 59 µg/L with non-detect to 3 µg/L concentrations for the last four sampling events.

The TVOC concentrations for OGC-2 on Figure 2.7 have fluctuated randomly between non-detect and 4.5 µg/L since February 2002. The TSVOC concentrations were all non-detect.

The TVOC concentrations for OGC-3 on Figure 2.8 ranged from 21 to 57 µg/L with the peak in November 2001. The TVOC concentrations have ranged between 17 and 27 µg/L in the May 2004 to May 2006 samples. The TSVOC concentrations fluctuated randomly from 207 to 411 µg/L between November 2001 and November 2003. Since November 2003, the TSVOC concentration has continually decreased from 300 µg/L to 158 µg/L in May 2006.

The TVOC concentrations for OGC-4 on Figure 2.9 fluctuated randomly between non-detect and 14 µg/L. The TSVOC concentrations showed a continual increase from 383 µg/L in May 2001 to 2426 µg/L in February 2003, decreased to 64 µg/L in March 2004, and then increased to 2400 µg/L in May 2004. Since then, the TSVOC concentrations have continually decreased, with a concentration of 525 µg/L in the May 2006 sample. The single compound responsible for this peak was phenol which increased from 310 µg/L in May 2001 to 2400 µg/L in May 2004 and then decreased to 510 µg/L in May 2006. Phenol was non-detect in the March 2004 sample.

The TVOC concentrations for OGC-5 on Figure 2.10, after February 2002, ranged from non-detect to 11 µg/L whereas the TSVOC concentrations ranged from non-detect to 11 µg/L with non-detect concentrations for TSVOC since February 2003.

The TVOC concentrations for OGC-6 on Figure 2.11 have increased continually from 3 µg/L in May 2001 to 4,200 µg/L in May 2006. The primary compounds detected are PCE and TCE. The TSVOC concentrations increased continually from non-detect in May 2001 to 26 µg/L in May 2002 and then held relatively constant between 11 and 30 µg/L from May 2002 to November 2003. Thereafter, they continually increased to 208 µg/L in the May 2006 sample. OGC-6 is located a short distance upstream of the northerly river monitoring station and is between MH6 and MH8. Review of the water

levels for MH6, OGC-6, MH8, and the middle river station show that the water levels in MH6 and MH8 are typically 8 and 4 feet lower, respectively, than the river north level, resulting in a strong inward gradient which has continually existed in this area since pumping began. Thus, there will be no migration of chemicals from the Site through the barrier wall to the Niagara River. The well inside the barrier wall closest to OGC-6 is MW-7. As described above, the analytical results for MW-7 show only low level TVOC concentrations. Furthermore, the current maximum TVOC concentration for the four wells inside the barrier wall was 319 µg/L in well MW-8 and in the groundwater discharge was 52 µg/L, both significantly less than the TVOC concentration of 4,200 µg/L detected in OGC-6. The MW and discharge groundwater results support that the PCE and TCE detected in OGC-6 are unlikely to be migrating from the Site. Thus, the source for these VOCs is uncertain but is expected to reside outside of the barrier wall and is being drawn back toward the Site.

The TVOC concentrations for OGC-7 on Figure 2.12, since August 2001, ranged between 59 and 156 µg/L with the peak concentration in November 2003. The TSVOC concentrations ranged between non-detect and 2 µg/L with non-detect concentrations for TSVOC since August 2002.

The TVOC concentrations for OGC-8 on Figure 2.13 have decreased from 165 µg/L in August 2002 to 29 µg/L for both the May 2004 and May 2005 samples and 25 µg/L for the May 2006 sample. The TSVOC concentrations have decreased from 54 µg/L in August 2002 to 11 µg/L in the May 2006 sample.

The QA/QC review of the May 2006 groundwater results is included in Appendix B.

2.2.2 MONITORING FREQUENCY FOR 4-YEAR PERIOD MAY 2004 TO APRIL 2008

The previous discussion shows that, in general, the ranges of concentration fluctuations are small and in most cases the concentrations themselves are low. Consequently, it was recommended in the Third Annual O&M Report that the frequency of the groundwater sampling and analysis be annually for the period from May 2004 to April 2008. The May 2006 results support this sampling frequency. The groundwater sampling frequency has been annual since May 2004.

2.3 EFFLUENT MONITORING PROGRAM

Groundwater from the GWS is discharged to the POTW without the need for pretreatment. The monitoring performed during the construction phase of the remedy clearly showed that the minimal chemical presence in the groundwater collected in the GWS is easily treated at the POTW and therefore no on-Site pretreatment is necessary. The effluent samples are collected at the monitoring station (meter building), which is located at the south end of the Site as shown on Figure 2.1. The analytical parameters are listed in Table 2.8.

Based on the results available for the period ending May 2003, the Second Annual O&M Report recommended revising the monitoring frequency to semi-annual and reducing the analytical parameter test (see Table 2.9). These same recommendations were made in the Third and Fourth Annual O&M Report based on the results available for the periods ending May 2004 and May 2005. NYSDEC approval for this recommendation was received on October 17, 2005. However, this modification was not implemented for the fifth year of O&M because EPA review of the modification was not performed until June 2006. Semi-annual monitoring will be implemented starting in the sixth year of O&M.

2.3.1 SAMPLE RESULTS

Effluent samples were collected monthly as specified in the City of North Tonawanda Industrial Wastewater Discharge Permit (see O&M Manual Appendix B - Wastewater Discharge Permit). Each month, a 24-hour composite sample was collected for SVOCs, metals, and wet chemistry parameters. Three grab samples were also collected for VOCs at 8-hour intervals and the measured concentrations were averaged to give a 24-hour concentration.

The monthly effluent sample results are presented in Table 2.10 and the TVOC and TSVOC results are plotted on Figure 2.14. As shown on Figure 2.14, the TVOCs peak in the spring and then decline reaching a trough in the fall and are slowly decreasing with time. This pattern may be attributable to additional flushing during the spring snow melt. The effluent TSVOC results on Figure 2.14 show no apparent seasonal pattern but are slowly decreasing with time.

QA/QC reviews of the monthly discharge results to April 2005 have already been submitted to the NYSDEC. Thus, these reviews are not being resubmitted with this

O&M Report. The QA/QC reviews of the monthly discharge results from May 2005 to May 2006, inclusive, are provided in Appendix B.

2.3.2 MONITORING PROGRAM FOR 4-YEAR PERIOD **MAY 2004 TO APRIL 2008**

2.3.2.1 SAMPLING FREQUENCY

To assist in evaluating the sampling frequency for the effluent discharge from the GWS, the measured concentrations for the following parameters were plotted: TVOCs, TSVOCs, pH, total suspended solids (TSS), and biochemical oxygen demand (BOD) (see Figures 2.14 through 2.17). It is believed that these parameters are representative of the trends in the chemistry of the water discharged to the POTW and, as such, can be used to determine an appropriate monitoring frequency for the effluent.

The effluent TVOC concentrations versus time are presented on Figure 2.14. As shown on Figure 2.14, the TVOCs peak in the spring and then decline reaching a trough in the fall. Furthermore, the concentrations are slowly decreasing with time.

The effluent TSVOC concentrations are also presented on Figure 2.14. There is no apparent seasonal pattern in the TSVOC concentrations. However, the TSVOC concentrations are also slowly decreasing with time.

The pH levels are presented on Figure 2.15. As shown on Figure 2.15, the pH levels range between 8.4 and 11.5. An apparent trend in the pH levels is higher pH levels in the winter/spring and lower pH levels in the summer/fall.

The TSS concentrations presented on Figure 2.16 show higher concentrations occurring in the early spring and late summer/fall with elevated concentrations (maximum of 278 mg/L) in the spring of 2005. Because TSS may be related to the discharge flow rate, the monthly discharge volume (see Table 2.11) is plotted on Figure 2.18. Comparison of the results presented on these two figures shows an apparent correlation between higher flows and greater TSS concentrations except for the 2005 spring results.

The BOD concentrations are presented on Figure 2.17. As shown on Figure 2.17, BOD concentrations ranged from 20 to 29 mg/L until April 2002 then decreased to the range of 6 to 22 mg/L since May 2002. The BOD concentrations were compared with the discharge volume but showed no apparent correlation.

In summary, the trends described above support the semi-annual sampling frequency that the NYSDEC approved on October 17, 2005. This modification will be implemented starting in the sixth year of O&M.

2.3.2.2 ANALYTICAL PARAMETERS

Review of the analytical results also shows that none of the detected metals exceeded the surface water standard/guidance values listed in Table 2.6. Thus, it is recommended that metals be deleted from the effluent analytical parameter list.

Furthermore, operation of the POTW does not require monitoring of the general chemistry parameters. Thus, it is recommended that the general chemistry parameters be deleted from the effluent analytical parameter list, other than those parameters which have a surface water standard/guidance level. The parameters to be retained are: chloride, ammonia, nitrate, sulfate, sulfide, phosphorus, and cyanide. Of these parameters, chloride, ammonia, sulphate, sulfide, and phosphorus have exceeded their respective surface water quality criteria (see Table 2.6). The parameters with standards/guidance levels will continue to be monitored to assist in the determination of when pumping to the POTW for treatment can be stopped and the groundwater thereafter can be allowed to discharge directly to the Niagara River. Phenol, even though it has a standard, is recommended to be deleted from the general parameter list because it is already included under the SVOC parameter list.

A summary of the proposed effluent monitoring program for the 4-year period from May 2004 to April 2008 is presented in Table 2.9. This modification was approved by the NYSDEC on October 17, 2005. This modification will be implemented starting in the sixth year of O&M.

2.4 SURFACE WATER MONITORING PROGRAM

To determine that the River sediment remediation and enhancement is working properly, surface water samples were collected upstream of, adjacent to, and at the downstream end of the Site at the locations shown on Figure 2.1. The analytical parameters are listed in Table 2.12. Surface water samples were collected and analyzed concurrent with the groundwater samples.

2.4.1 SAMPLE RESULTS

The river water analytical results are presented in Table 2.6. As shown in Table 2.6, almost all of the analytical results were non-detect. Only a few VOCs were infrequently detected at very low level concentrations and only 2 SVOCs were ever detected; once each at less than 1 µg/L. None of the above concentrations exceeded the Class A surface water criteria. The exceptions to this occurred in May 2002, November 2003, May 2004, and May 2006 at the North River location. The May 2002, May 2004, and May 2006 North River analytical results show elevated concentrations of primarily ethylbenzene (20, 40, and 2.9 µg/L), toluene (63, 130, and 14 µg/L), and total xylenes (80, 210, and 23 µg/L). Benzene was detected at 2 µg/L, slightly above the Class A surface water criteria of 1 µg/L, in the North River location in the November 2003 sample. Given that:

- i) the North River location is downstream of the on-site boat launch;
- ii) boats and personnel watercraft were present in the area;
- iii) the concentrations for these three compounds in the groundwater are generally much less than the May 2002, May 2004, and May 2006 river water concentrations; and
- iv) the concentrations for these three compounds were non-detect in all other quarterly samples at this location, except for toluene (0.96J and 2.2 µg/L) and total xylene (0.96J and 3.7 µg/L) in the May 2003 and May 2005 samples, respectively;

the most likely explanation for these measured concentrations of BTEX compounds in the river water sample is a fuel leak or spillage from watercraft.

The QA/QC review of the May 2006 river water results is included in Appendix B.

2.4.2 MONITORING FREQUENCY FOR 3-YEAR PERIOD MAY 2005 TO APRIL 2008

Given the infrequent and low level concentrations of VOCs and SVOCs, the frequency for river water sampling and analyses is annual, the same as for the groundwater.

2.5 GWS OPERATIONS

The volume of water pumped on a monthly basis from the Site to the City POTW for treatment is presented in Table 2.11 and plotted on Figure 2.18. The monthly volumes

show that during the time period of initial dewatering of the Site (i.e., May and June 2001) the monthly volumes ranged from 2,300,000 to 2,900,000 gallons. Thereafter, the monthly volumes ranged from 210,000 to 1,280,000 gallons, with the volumes ranging from 153,000 to 508,000 gallons for the last 12-month period. The lower monthly volumes typically occur during the drier summer/fall months.

The total volume of water discharged from the Site for the time period from May 2001 to May 2006 was 37,983,300 gallons with 3,923,700 pumped during the last 12 months.

Section 5.0 of the O&M Manual describes the procedures to be followed in case pumping of the GWS needs to be stopped to prevent the discharge of untreated water from the Site by the City POTW (i.e., wet weather shutdown). No wet weather shutdown occurred in the time period from May 2005 to May 2006. However, the system was shut down for a period of approximately 2 to 3 days due to a power outage as described in Section 2.6.

The treatment of the Site groundwater by the City POTW did not require any modifications to the standard operations of the City POTW and did not cause any operational upsets of the City POTW.

2.6 GWS MAINTENANCE

The following maintenance or service repairs were needed on the GWS components during the May 2005 to May 2006 time period.

A visit to the Site on August 2, 2005 by City of North Tonawanda personnel observed that the system was not operating due to a power outage. Power was restored and the system restarted on August 2, 2005. It is possible that a severe storm which impacted the area a couple of days prior to the Site visit was the cause of the power outage. This is supported by the July 29, 2005 Site inspection performed by CRA which observed that the system was operating.

The pump in MH3 stopped operating on December 2, 2005. The pump impeller was seized and the inlet screen was severely corroded. A new pump was ordered on February 8, 2006. Due to a backlog, the pump was not received until April 2006 and was installed on April 20, 2006.

During this downtime, the water levels in MH3 were approximately 1-foot higher than previous levels. Even with the higher water levels in MH3, the gradient remained

inward (i.e., from the river through the barrier wall to the groundwater collection system). Thus, no groundwater migration from the interior of the Site to the river occurred. This shows that the groundwater collection system can be effective with only two of the three pumps operating.

3.0 SITE INSPECTIONS

Site inspections were performed on a monthly basis. Copies of the inspection logs for the time period May to October 2005 were previously submitted and thus are not being resubmitted with this O&M Report. The monthly inspection logs for November 2005 to May 2006 are included in Appendix A. In summary, the May 2005 to May 2006 inspections identified that there were still some reinforcing bars on the islets. These bars were removed the week of October 10, 2005.

4.0 CONCLUSIONS/RECOMMENDATIONS

4.1 OPERATION AND MAINTENANCE

The constructed remedy is achieving the remedial action objectives.



4.2 MONITORING

As described in Section 2.2, the trends in the groundwater analytical results are relatively consistent with time. Thus, the frequency for the groundwater monitoring is annual for the period from May 2004 to April 2008.

Only a few VOCs and SVOCs were infrequently detected at very low level concentrations in the river water samples. Thus, the frequency for the river water monitoring is annual for the same time period.

The trends in the effluent from the GWS to the POTW support reducing the sampling frequency from monthly to semi-annual.. Flow monitoring will continue to be performed monthly as a check on the operation of the GWS.

It was previously recommended that metals be deleted from the effluent parameter list because none of the detected metals exceed their respective standard/guidance value. It was also recommended that all general chemistry parameters be deleted except those which have a surface water standard/guidance level. This was approved by the NYSDEC on October 17, 2005 however, it was not reviewed by the USEPA until June 2006. Semi-annual monitoring will be implemented starting thereafter.

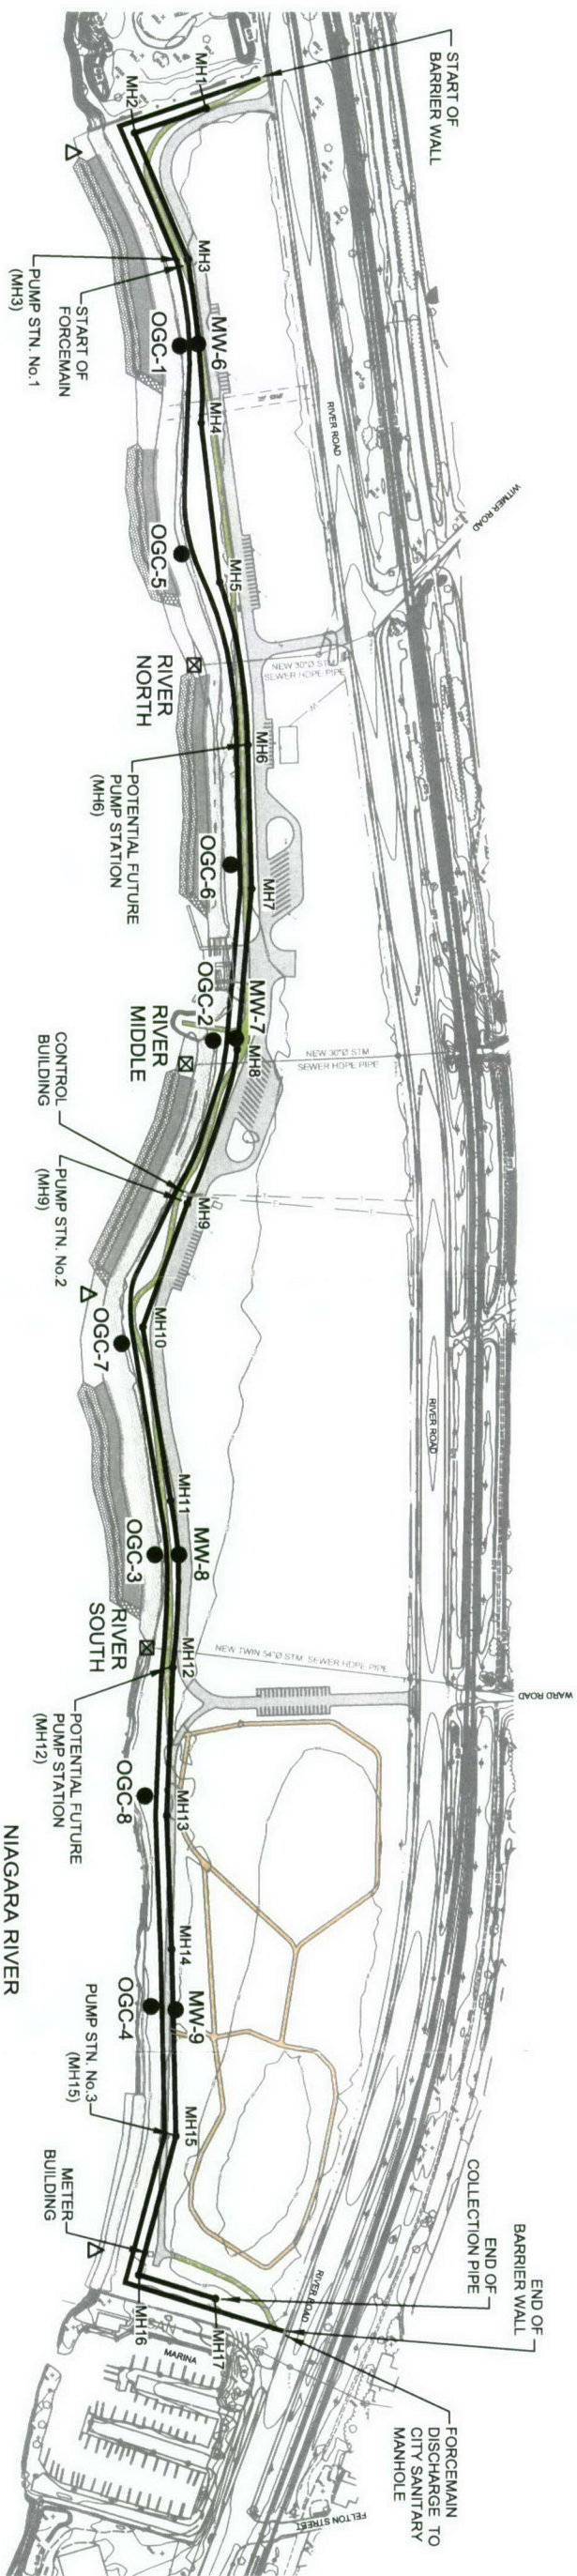

- LEGEND**
- BARRIER WALL
 - MH11 GROUNDWATER COLLECTION SYSTEM
 - OGC-1 MONITORING WELL LOCATION
 - ⊠ MW-1 RIVER SURFACE WATER LEVEL MONITORING LOCATION
 - Δ SOUTH SURFACE WATER CHEMICAL MONITORING LOCATION



figure 2.1
MONITORING NETWORK
GRATWICK-RIVERSIDE PARK SITE
North Tonawanda, New York

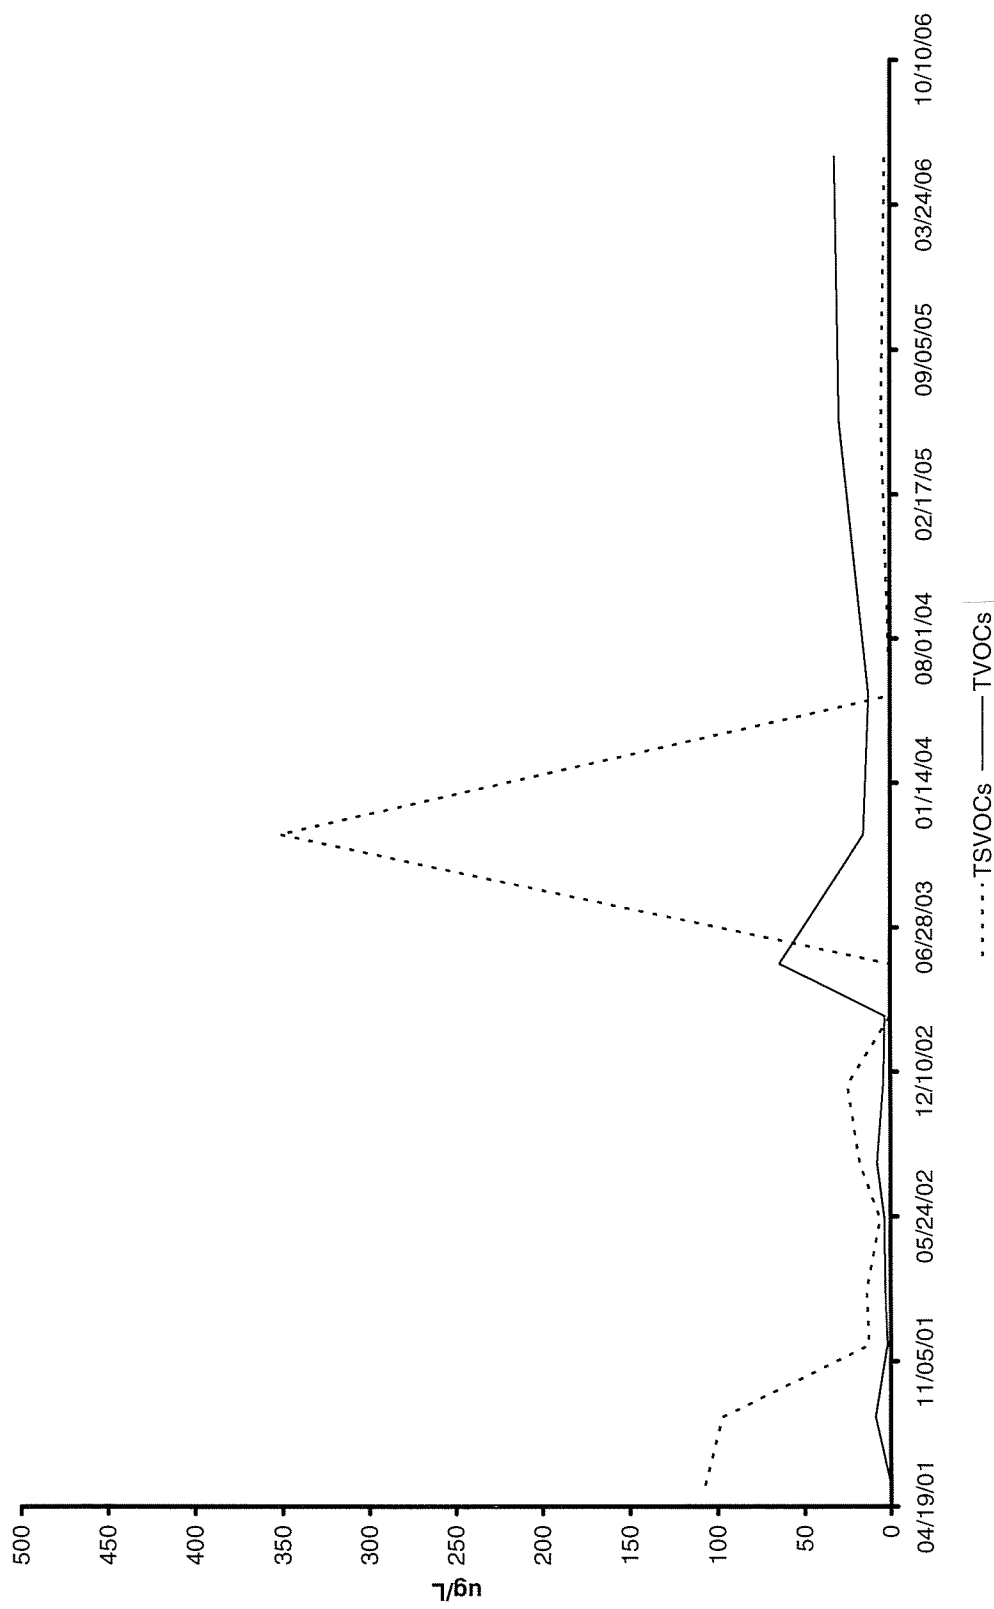


figure 2.2
 MW-6 TVOC AND TSVOC CONCENTRATIONS
 GRATWICK-RIVERSIDE PARK SITE
North Tonawanda, New York



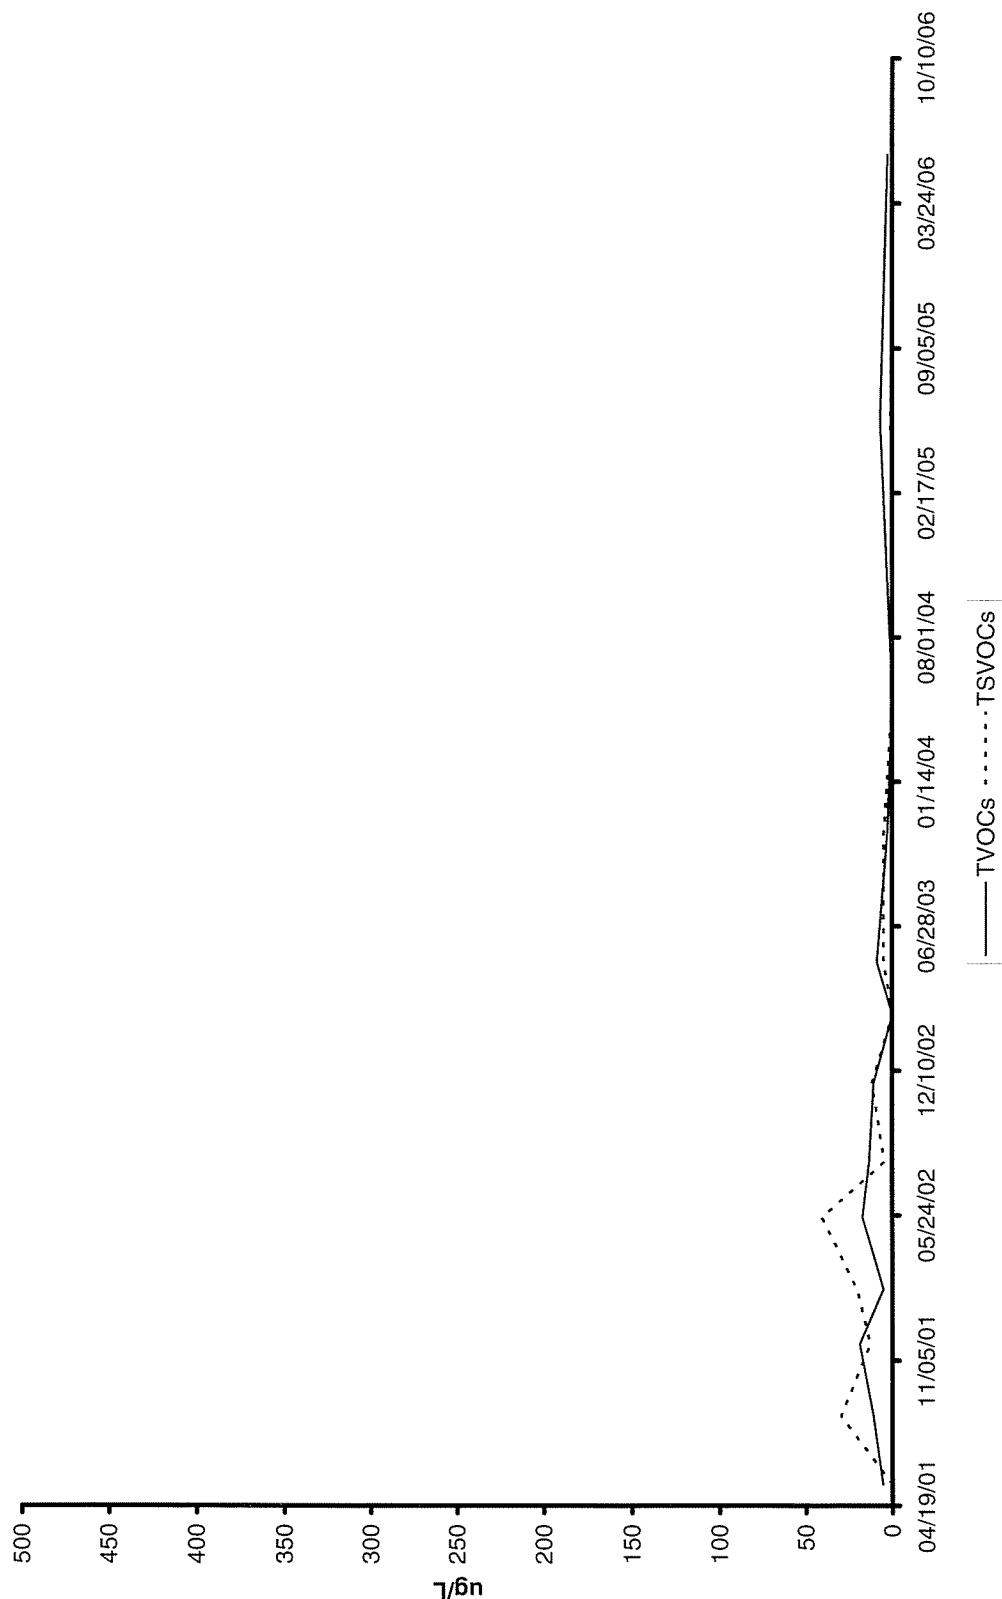


figure 2.3
 MW-7 TVOC AND TSVOC CONCENTRATIONS
 GRATWICK-RIVERSIDE PARK SITE
North Tonawanda, New York



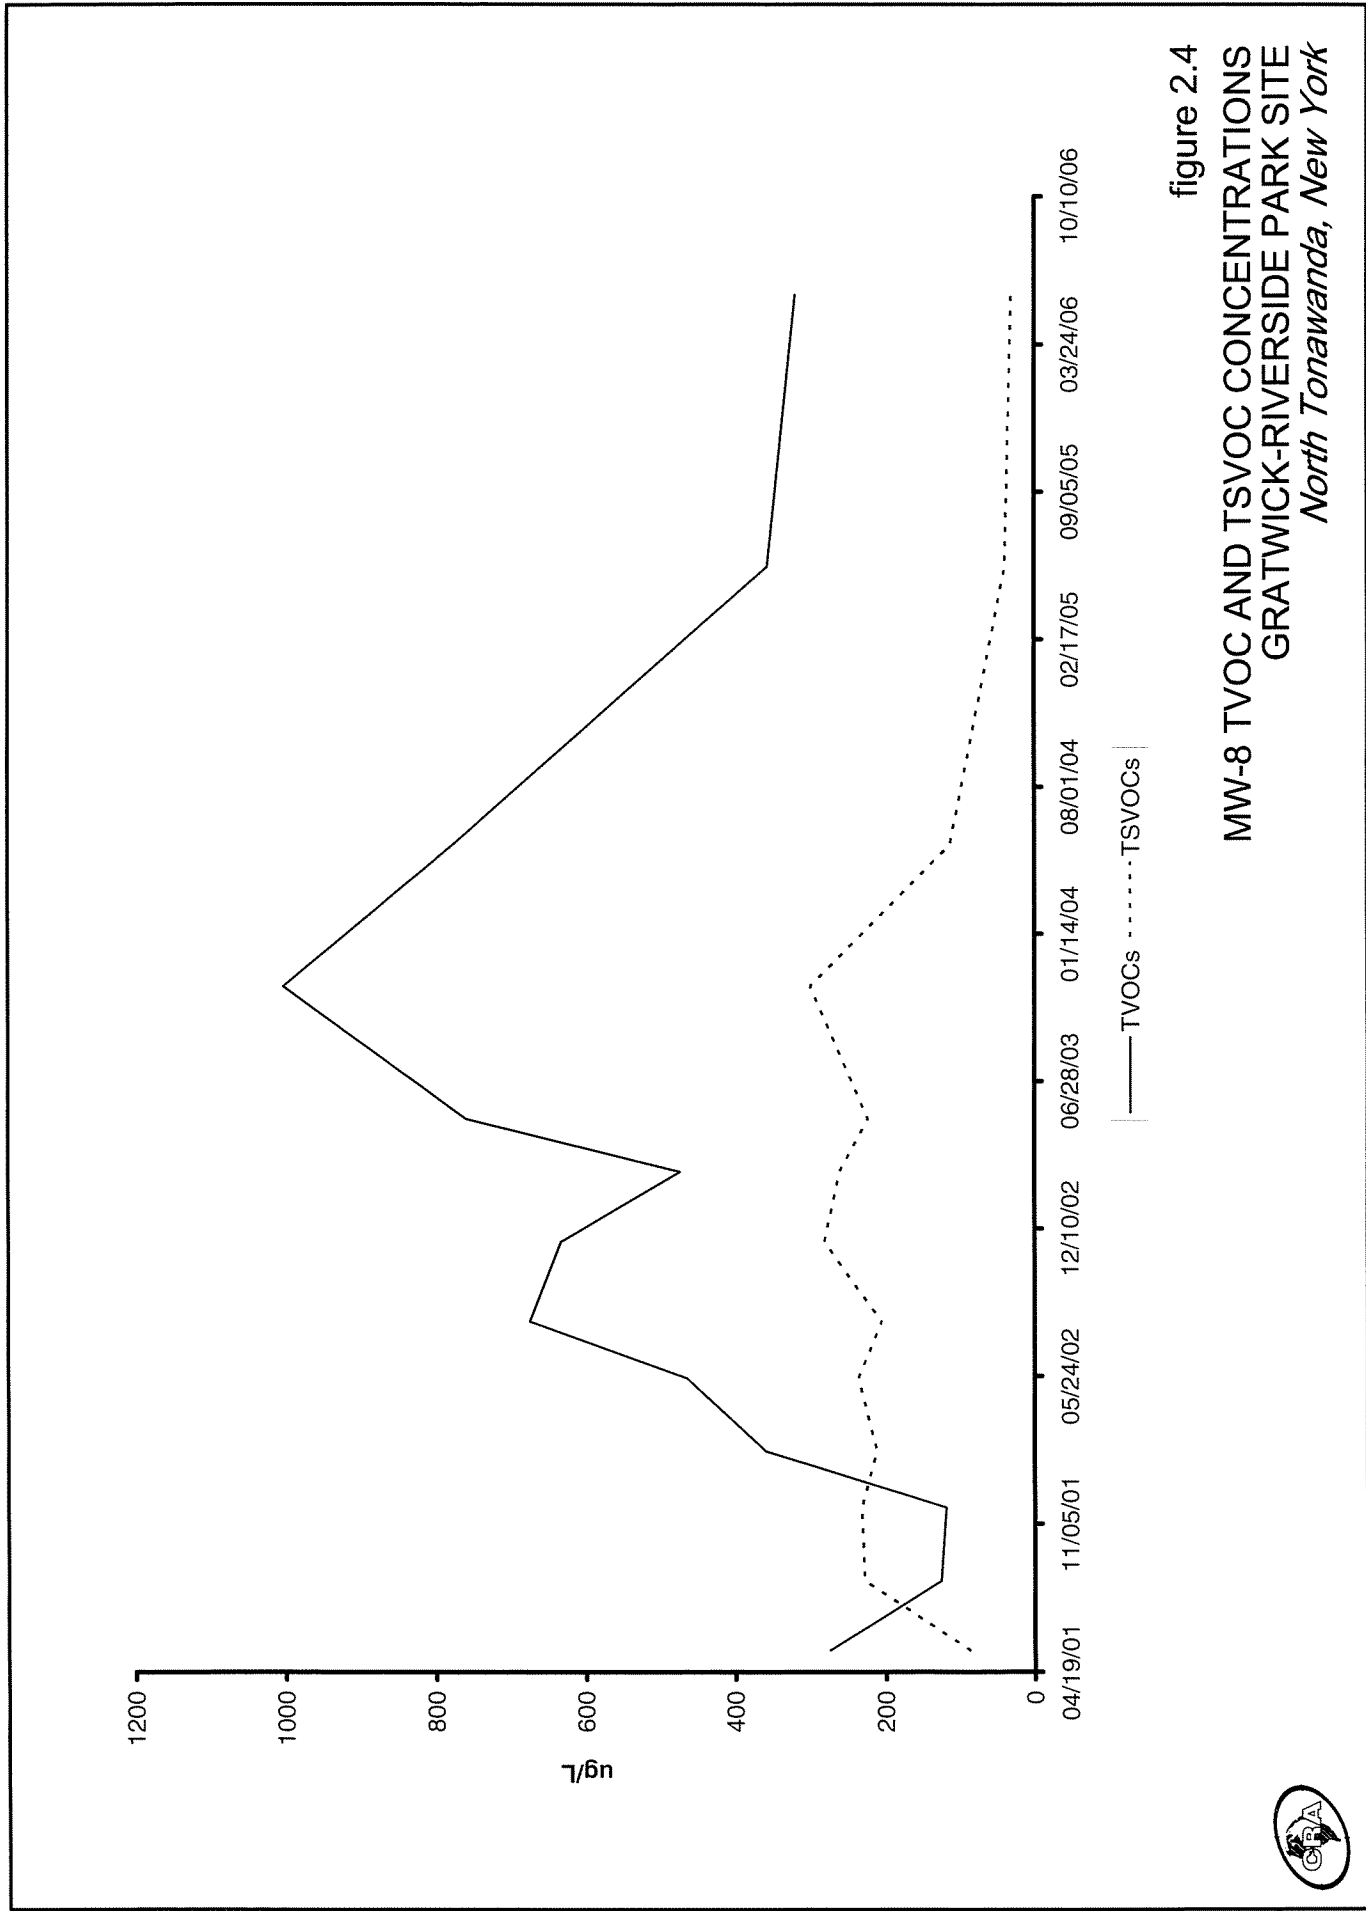


figure 2.4
MW-8 TVOC AND TSVOC CONCENTRATIONS
GRATWICK-RIVERSIDE PARK SITE
North Tonawanda, New York

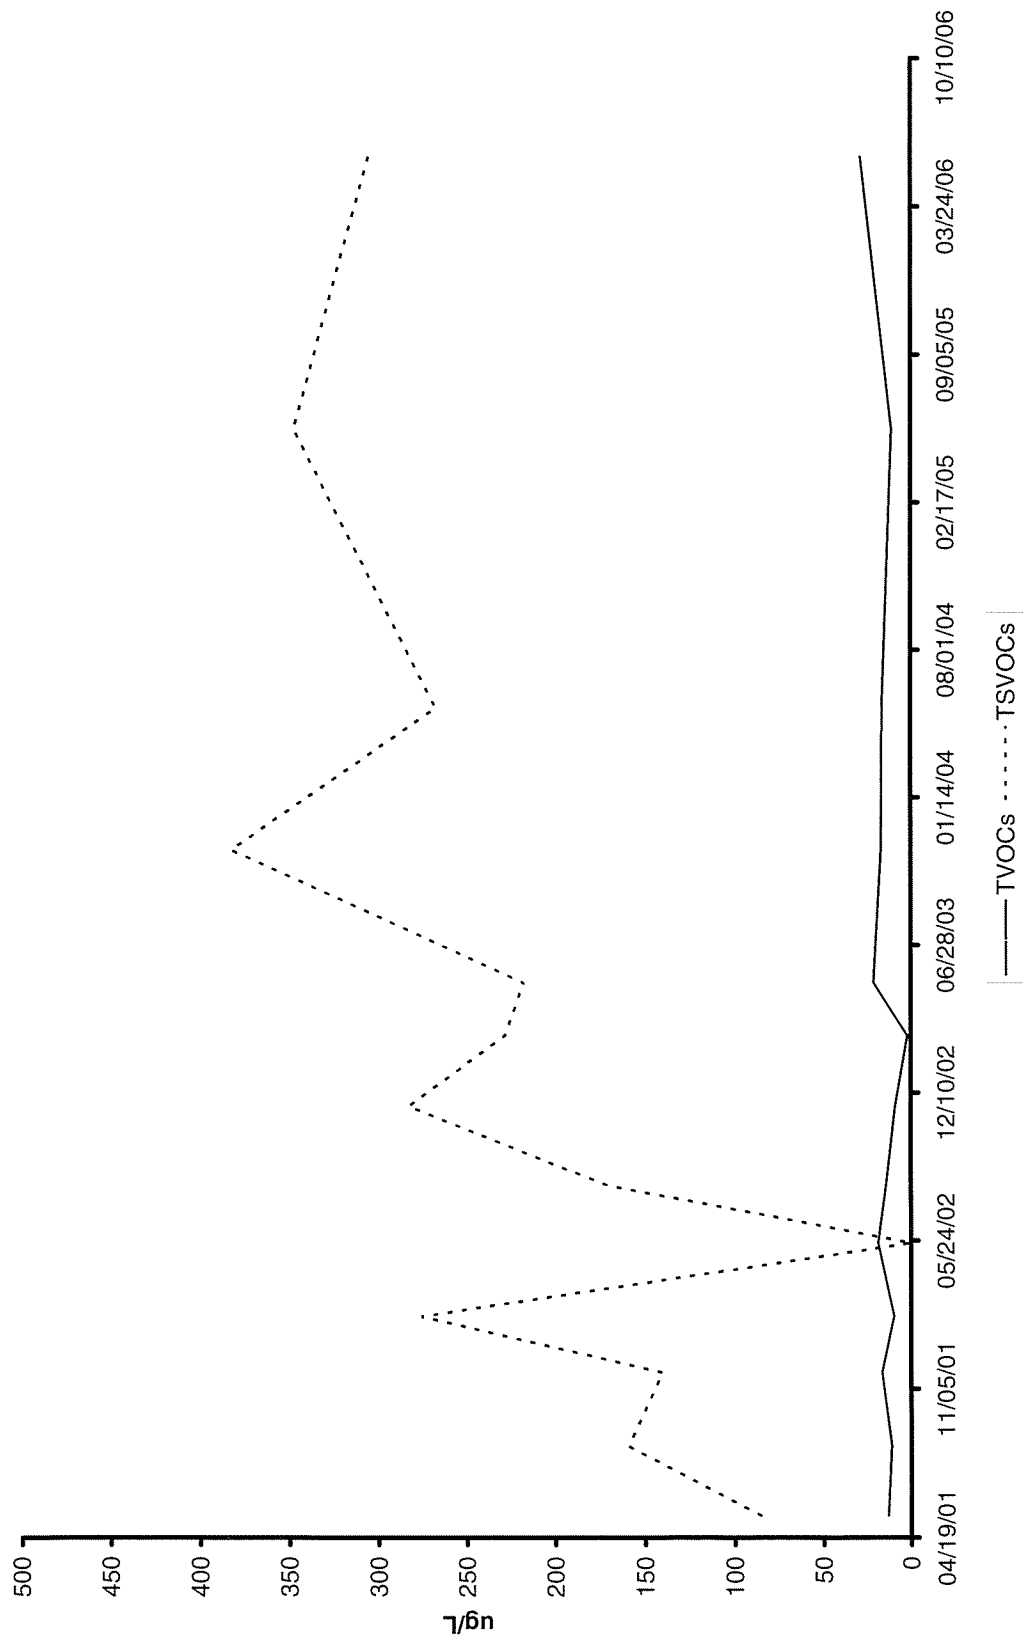


figure 2.5
MW-9 TVOC AND TSVOC CONCENTRATIONS
GRATWICK-RIVERSIDE PARK SITE
North Tonawanda, New York



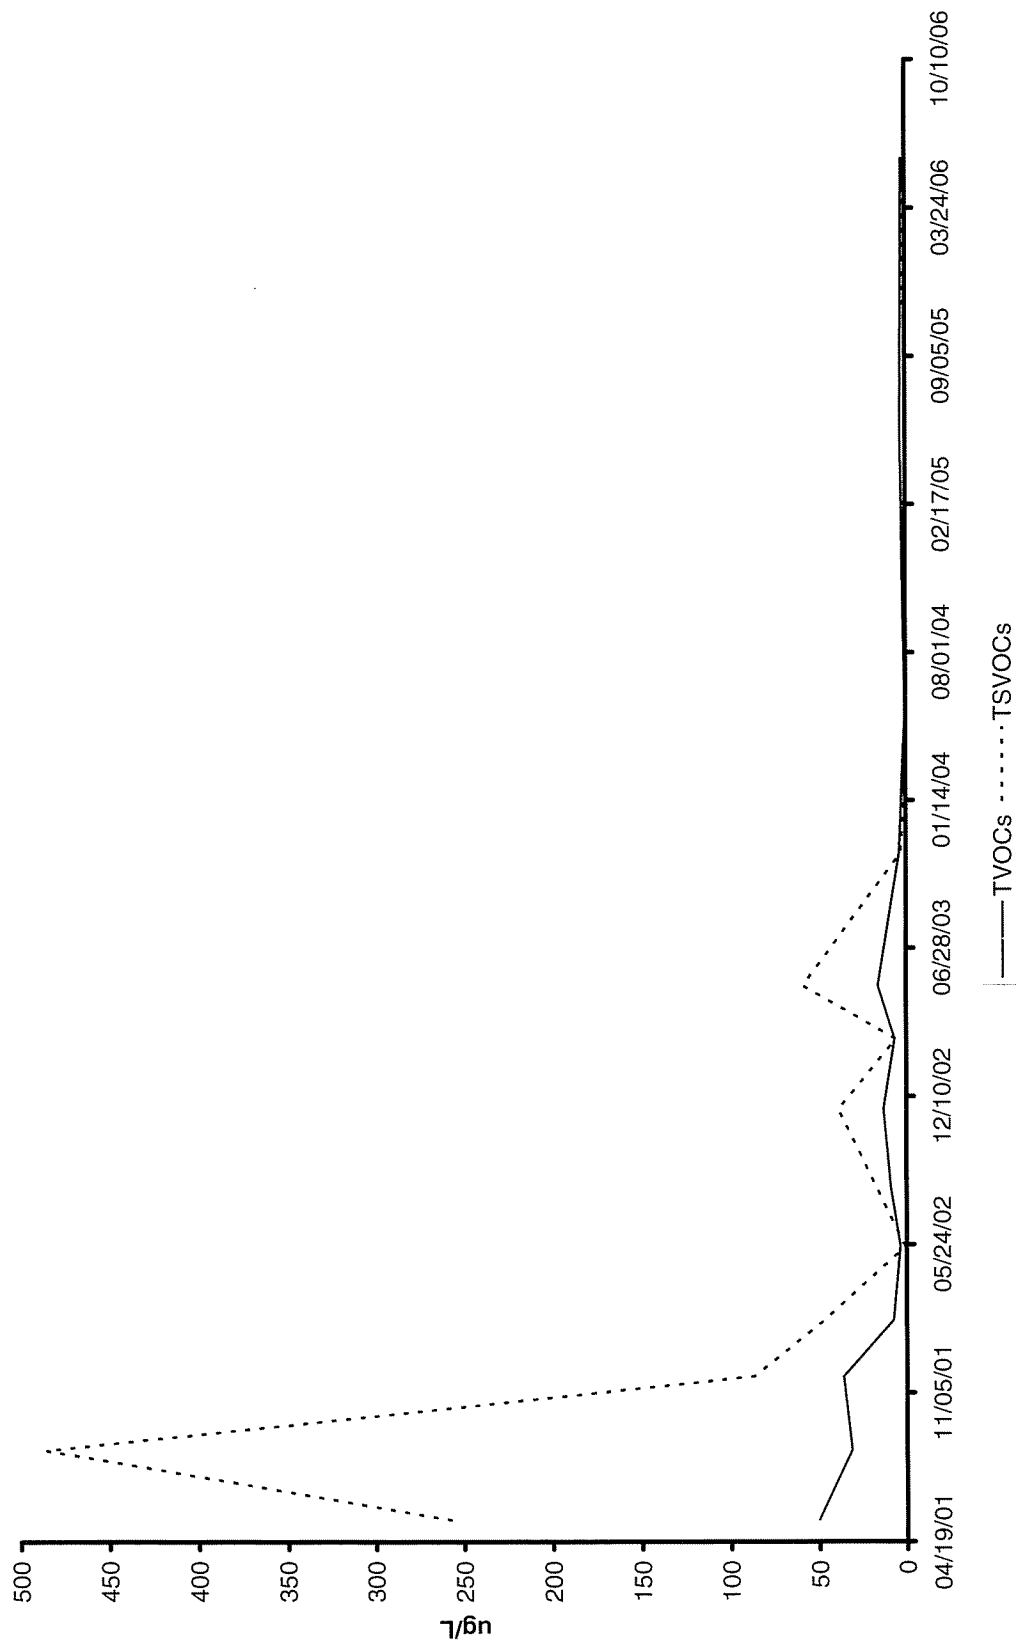


figure 2.6
OGC-1 TVOC AND TSVOC CONCENTRATIONS
GRATWICK-RIVERSIDE PARK SITE
North Tonawanda, New York



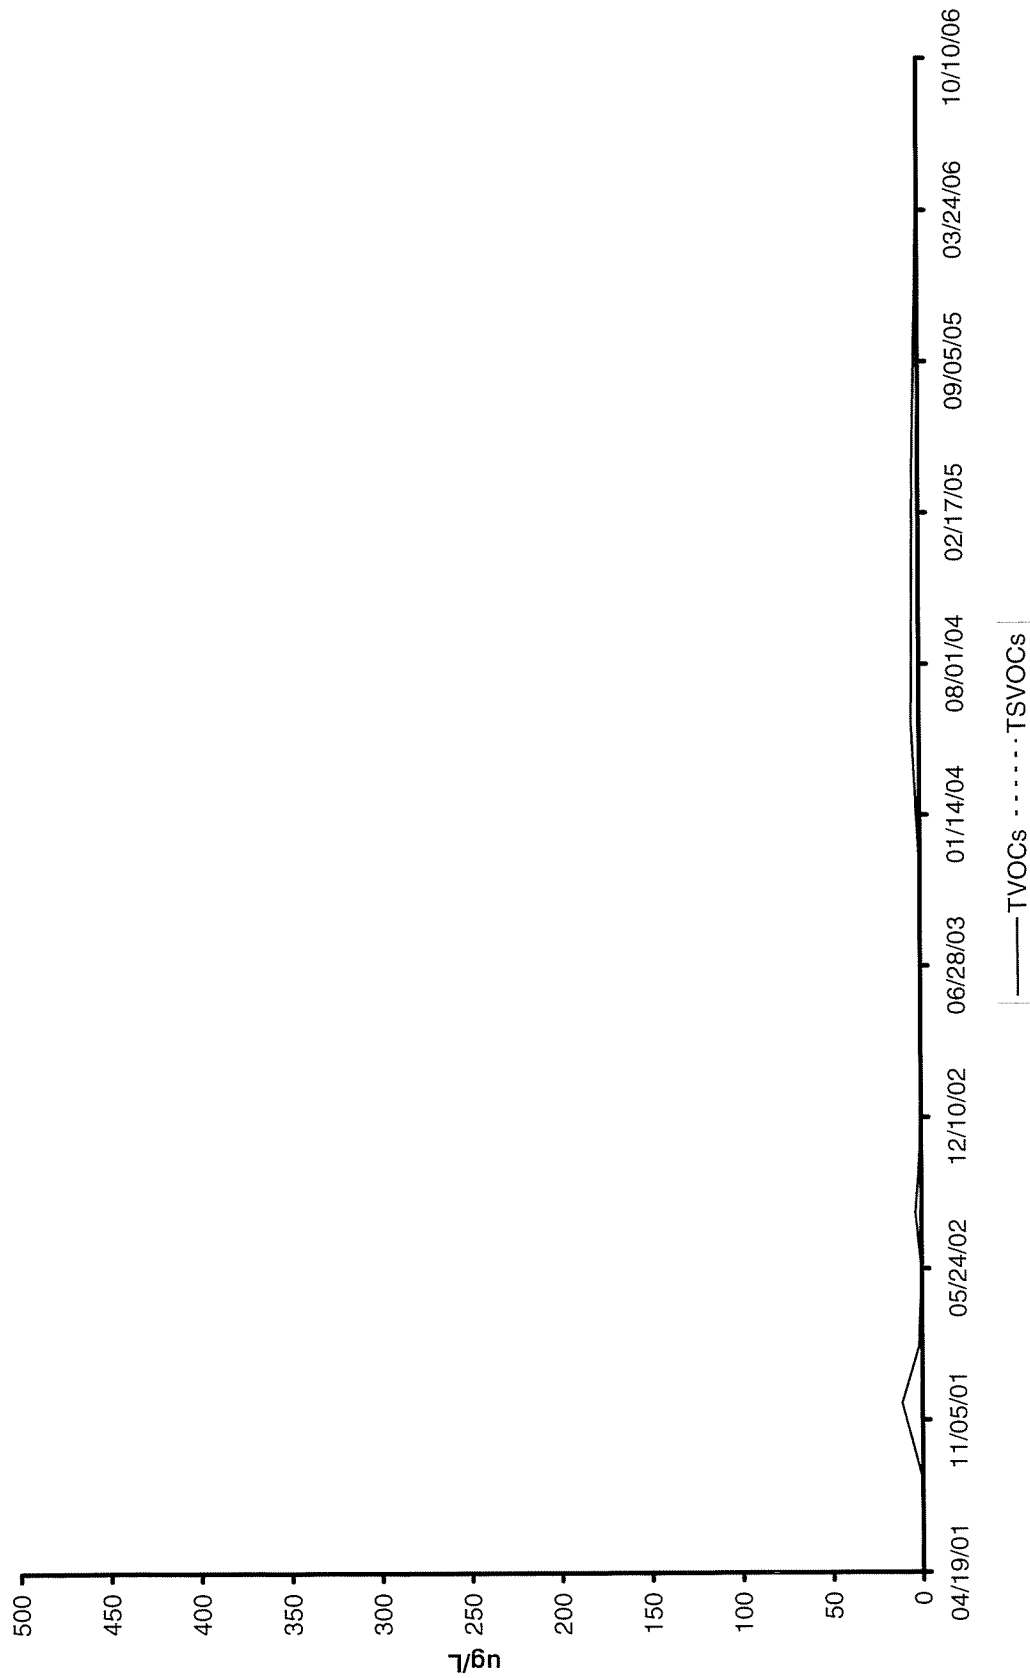



figure 2.7
 OGC-2 TVOC AND TSVOC CONCENTRATIONS
 GRATWICK-RIVERSIDE PARK SITE
North Tonawanda, New York





figure 2.8
 OGC-3 TVOC AND TSVOC CONCENTRATIONS
 GRATWICK-RIVERSIDE PARK SITE
North Tonawanda, New York



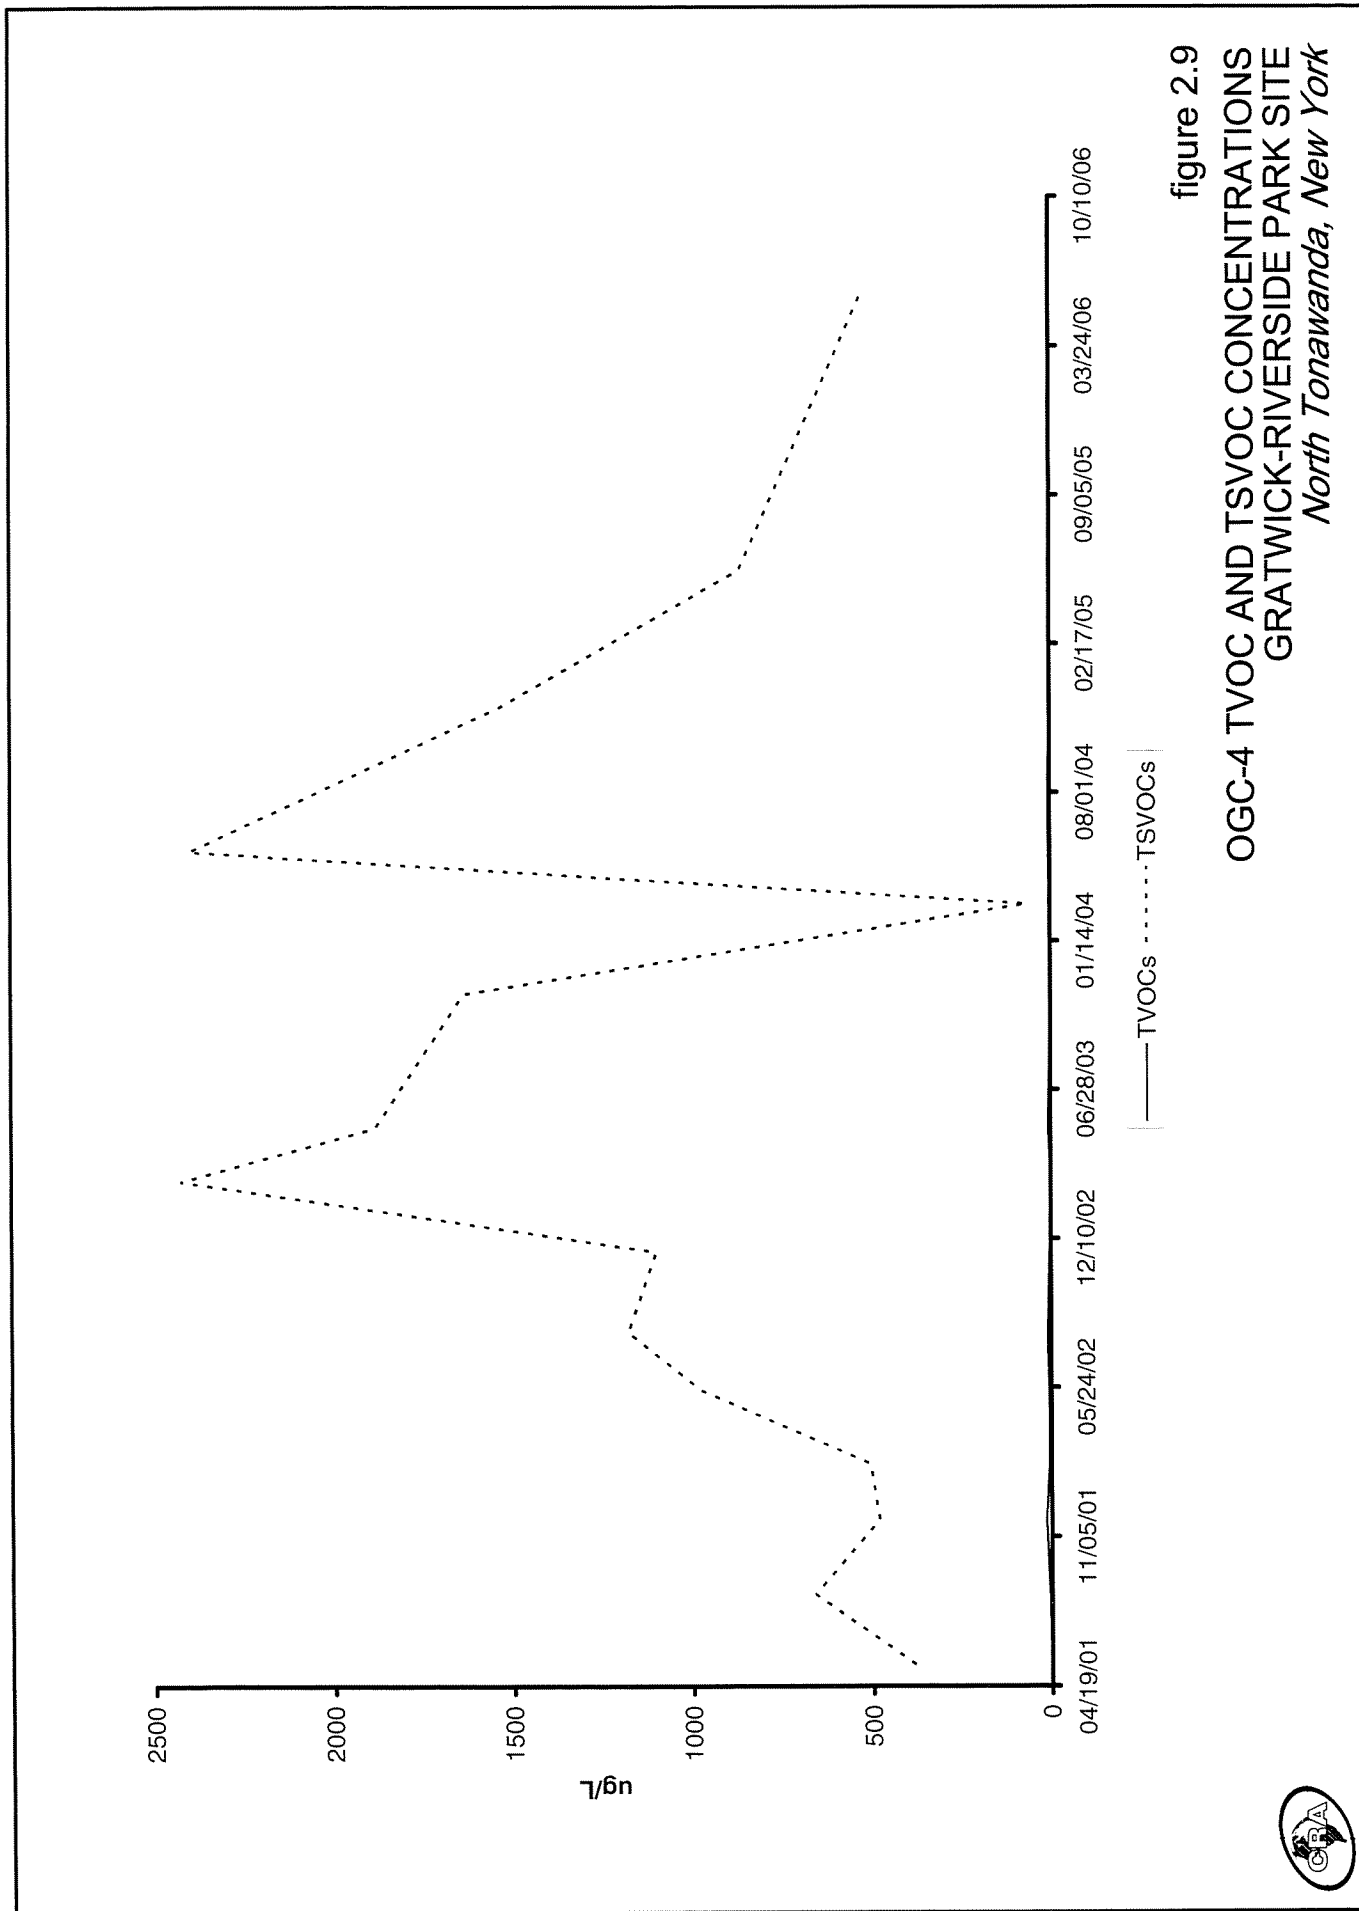

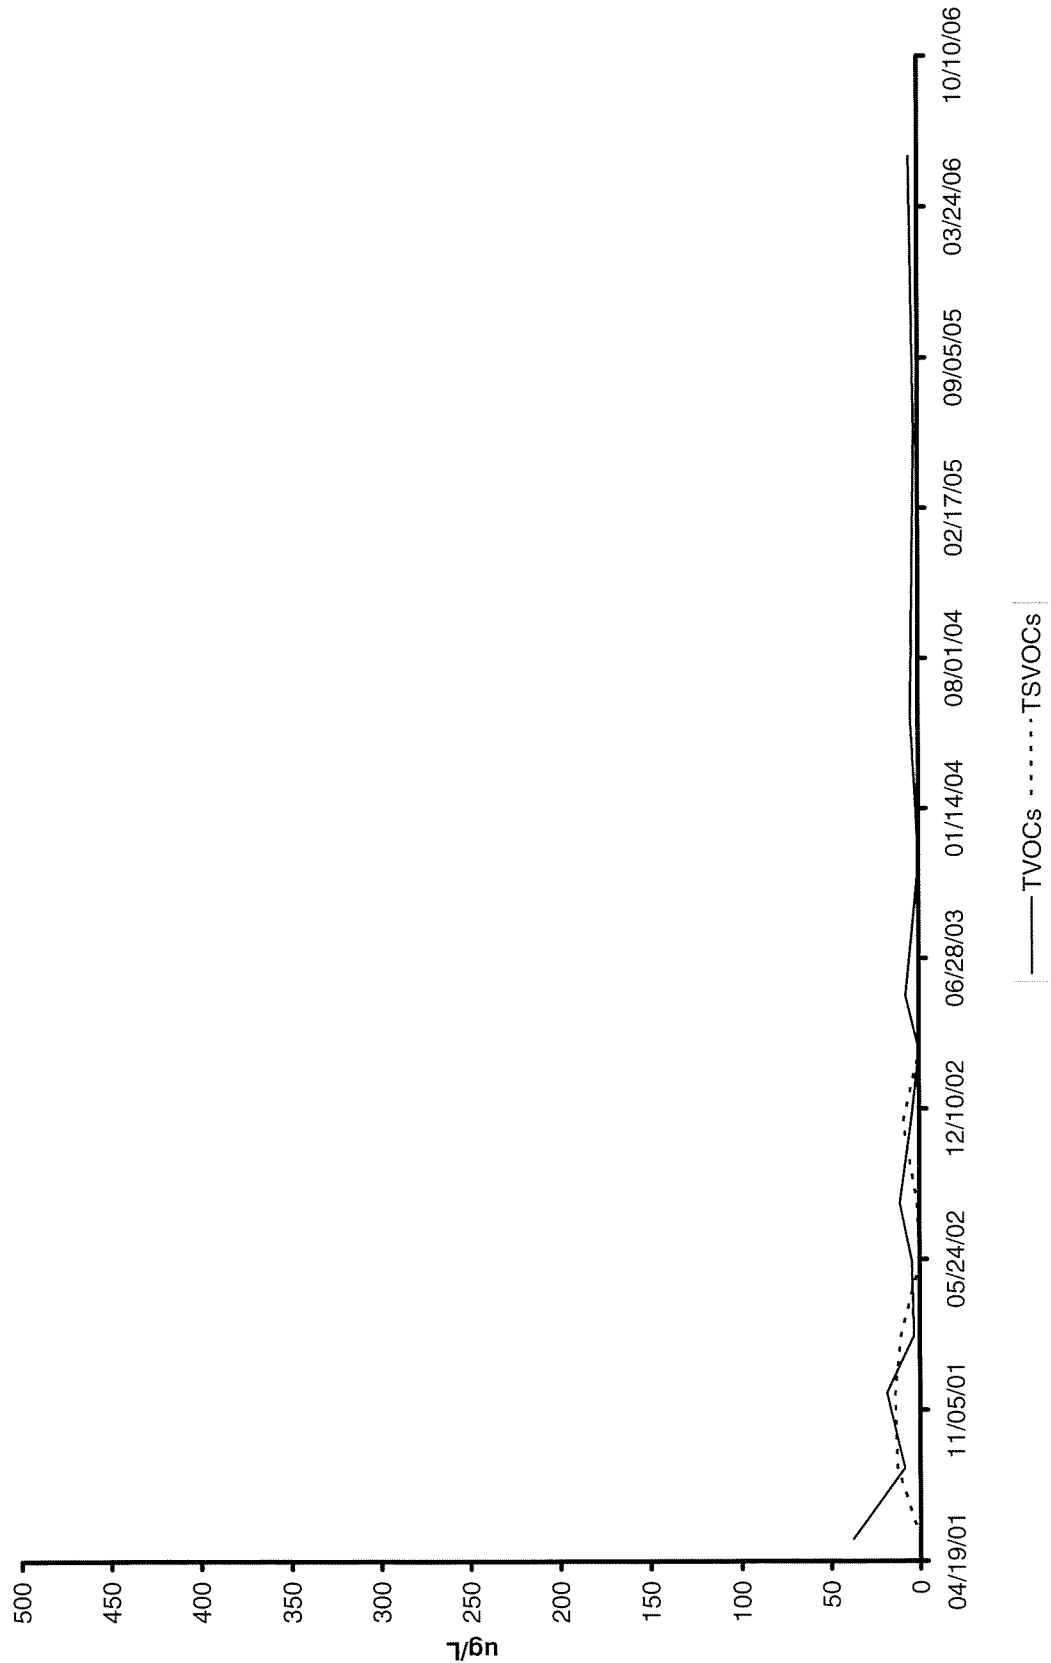
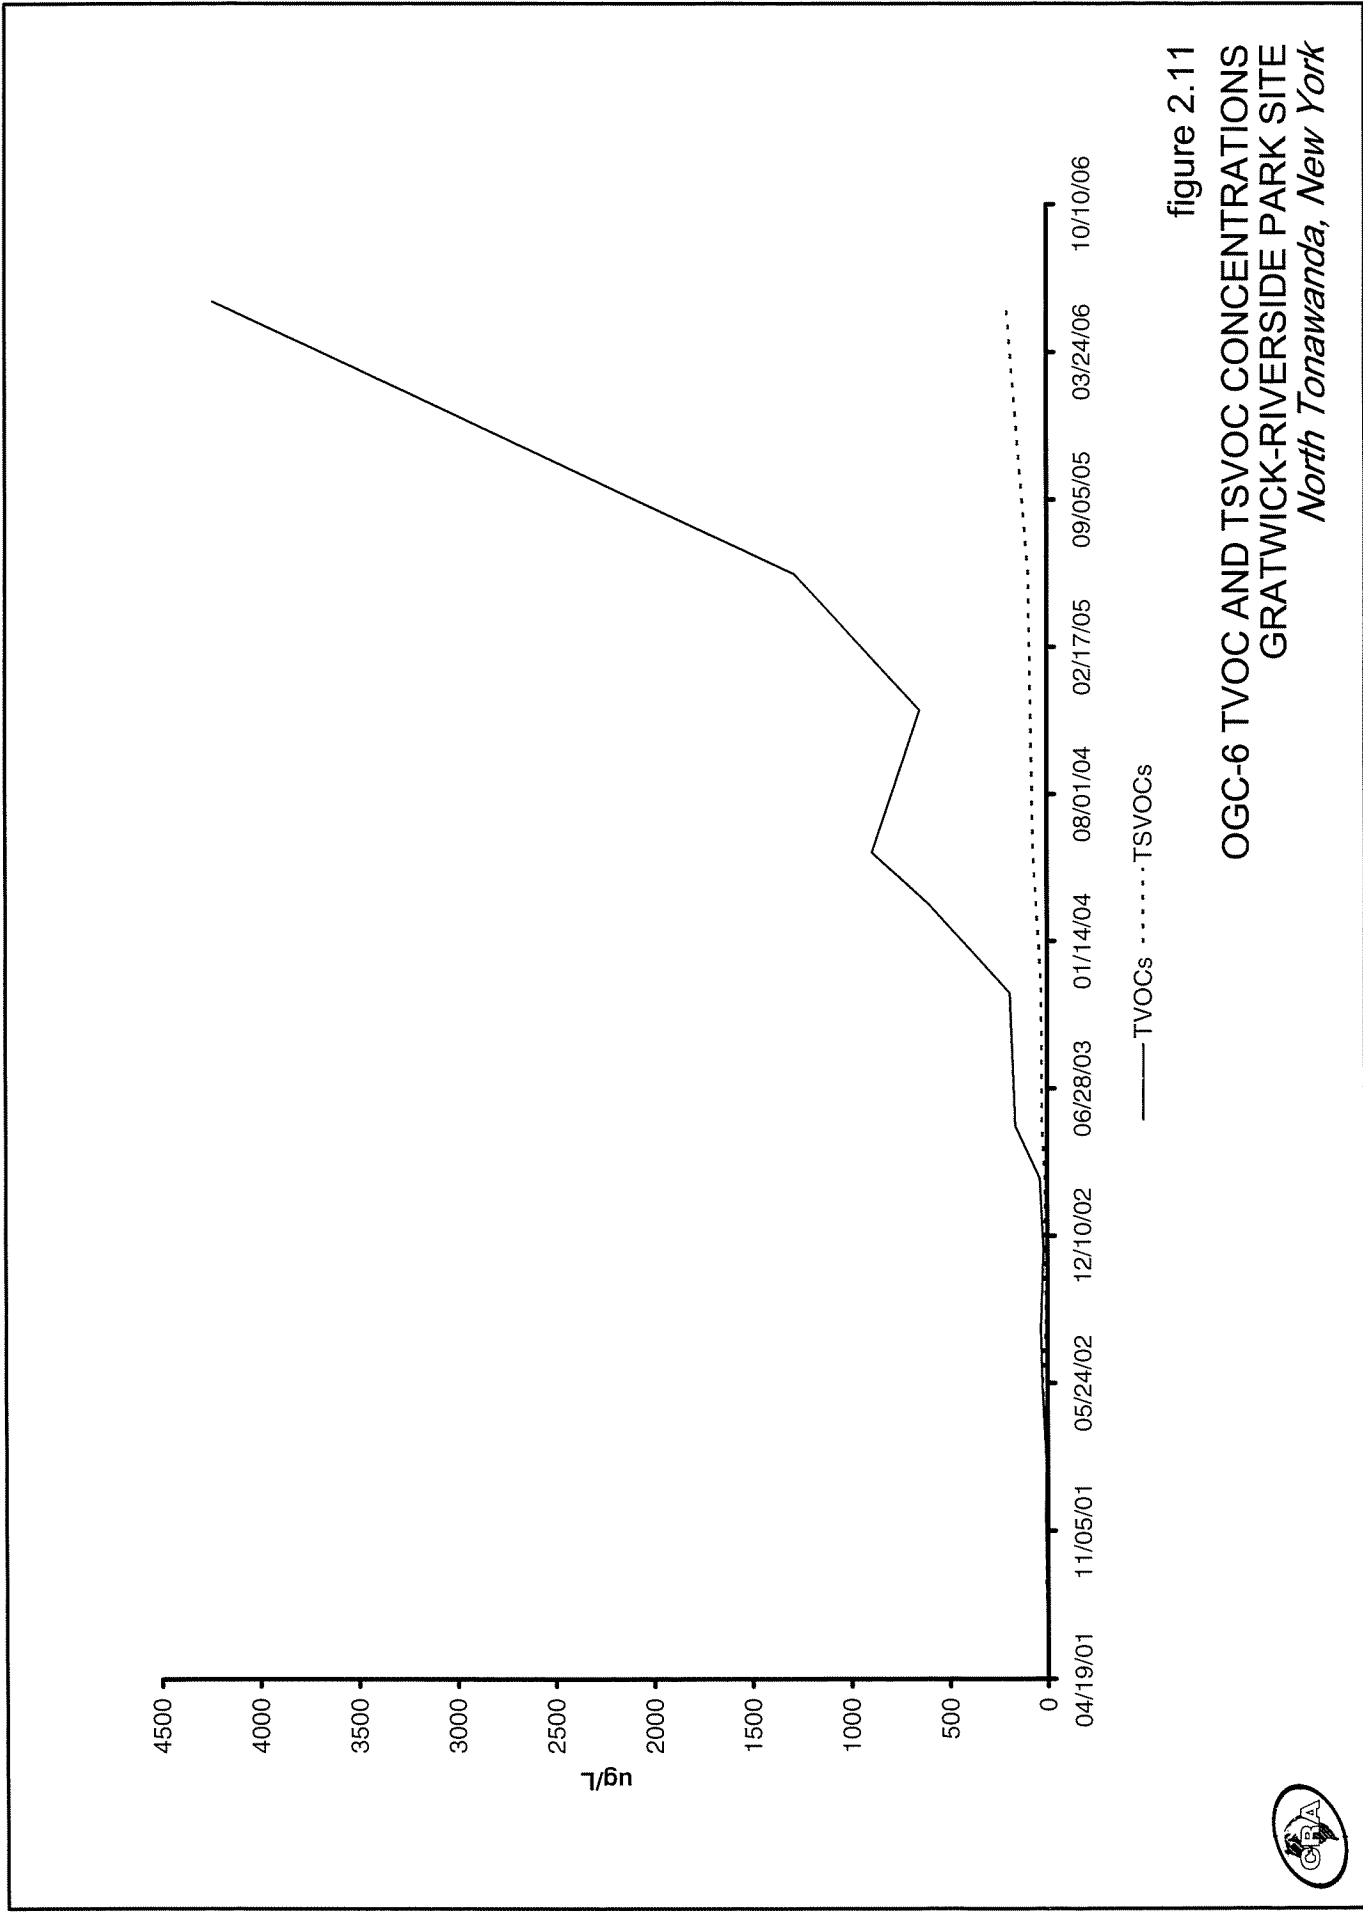


figure 2.10
 OGC-5 TVOC AND TSVOC CONCENTRATIONS
 GRATWICK-RIVERSIDE PARK SITE
North Tonawanda, New York





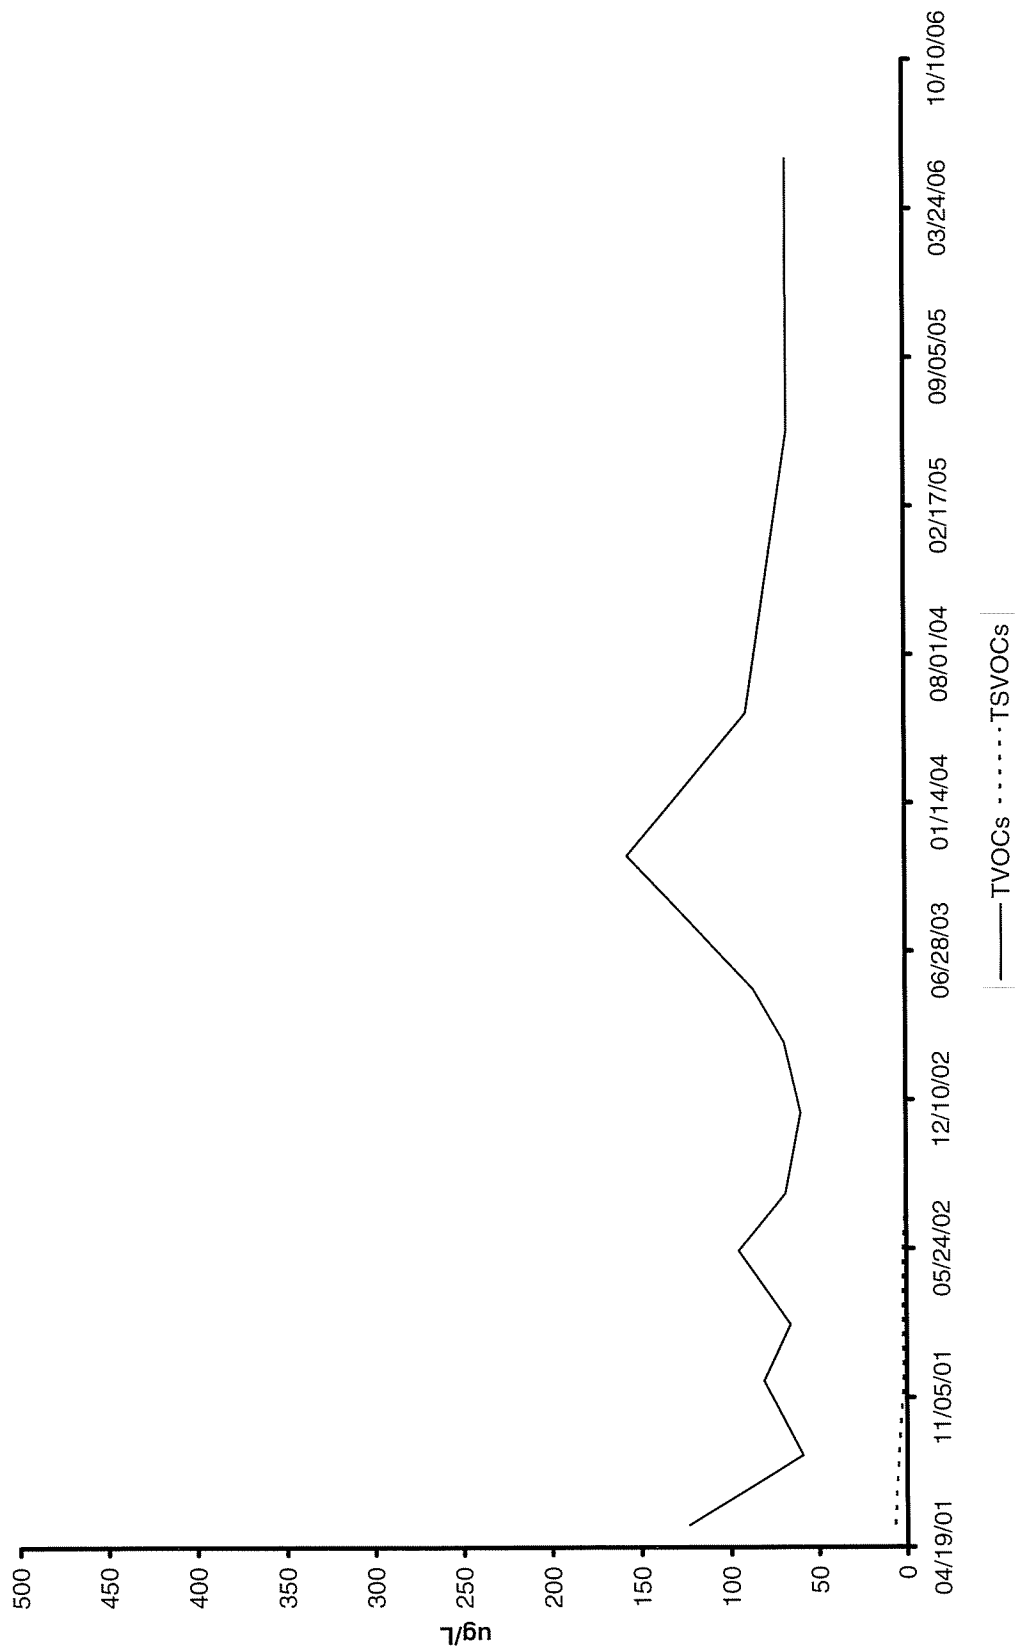


figure 2.12

OGC-7 TVOC AND TSVOC CONCENTRATIONS
GRATWICK-RIVERSIDE PARK SITE
North Tonawanda, New York



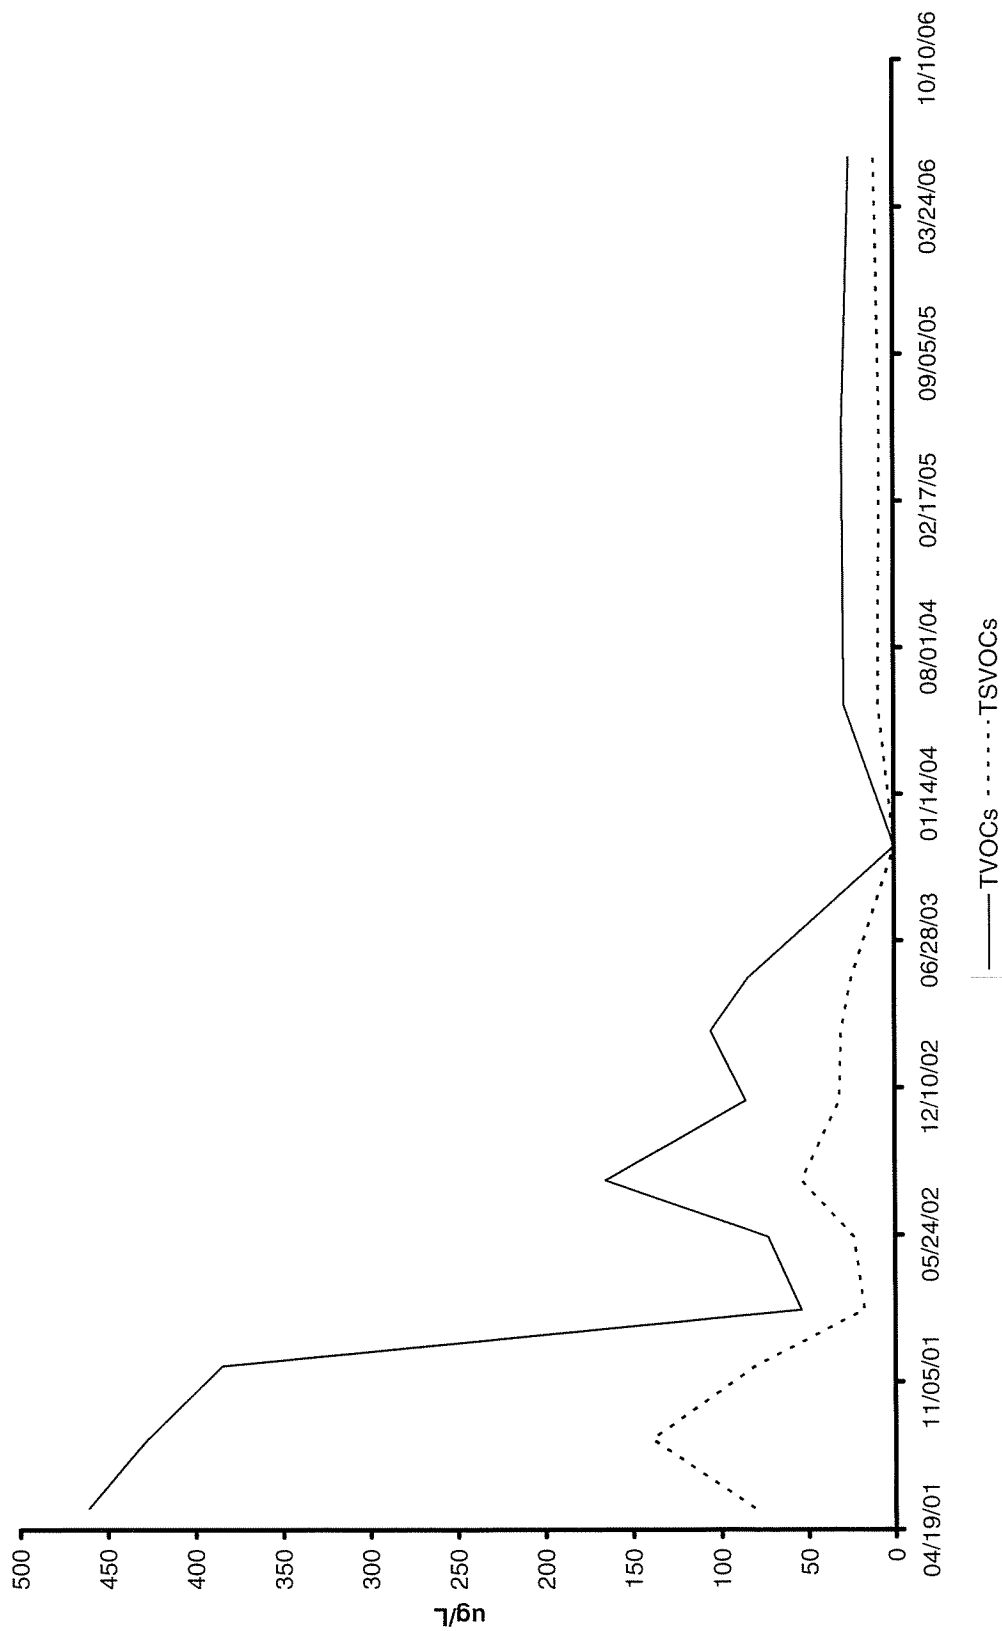


figure 2.13
 OGC-8 TVOC AND TSVOC CONCENTRATIONS
 GRATWICK-RIVERSIDE PARK SITE
North Tonawanda, New York



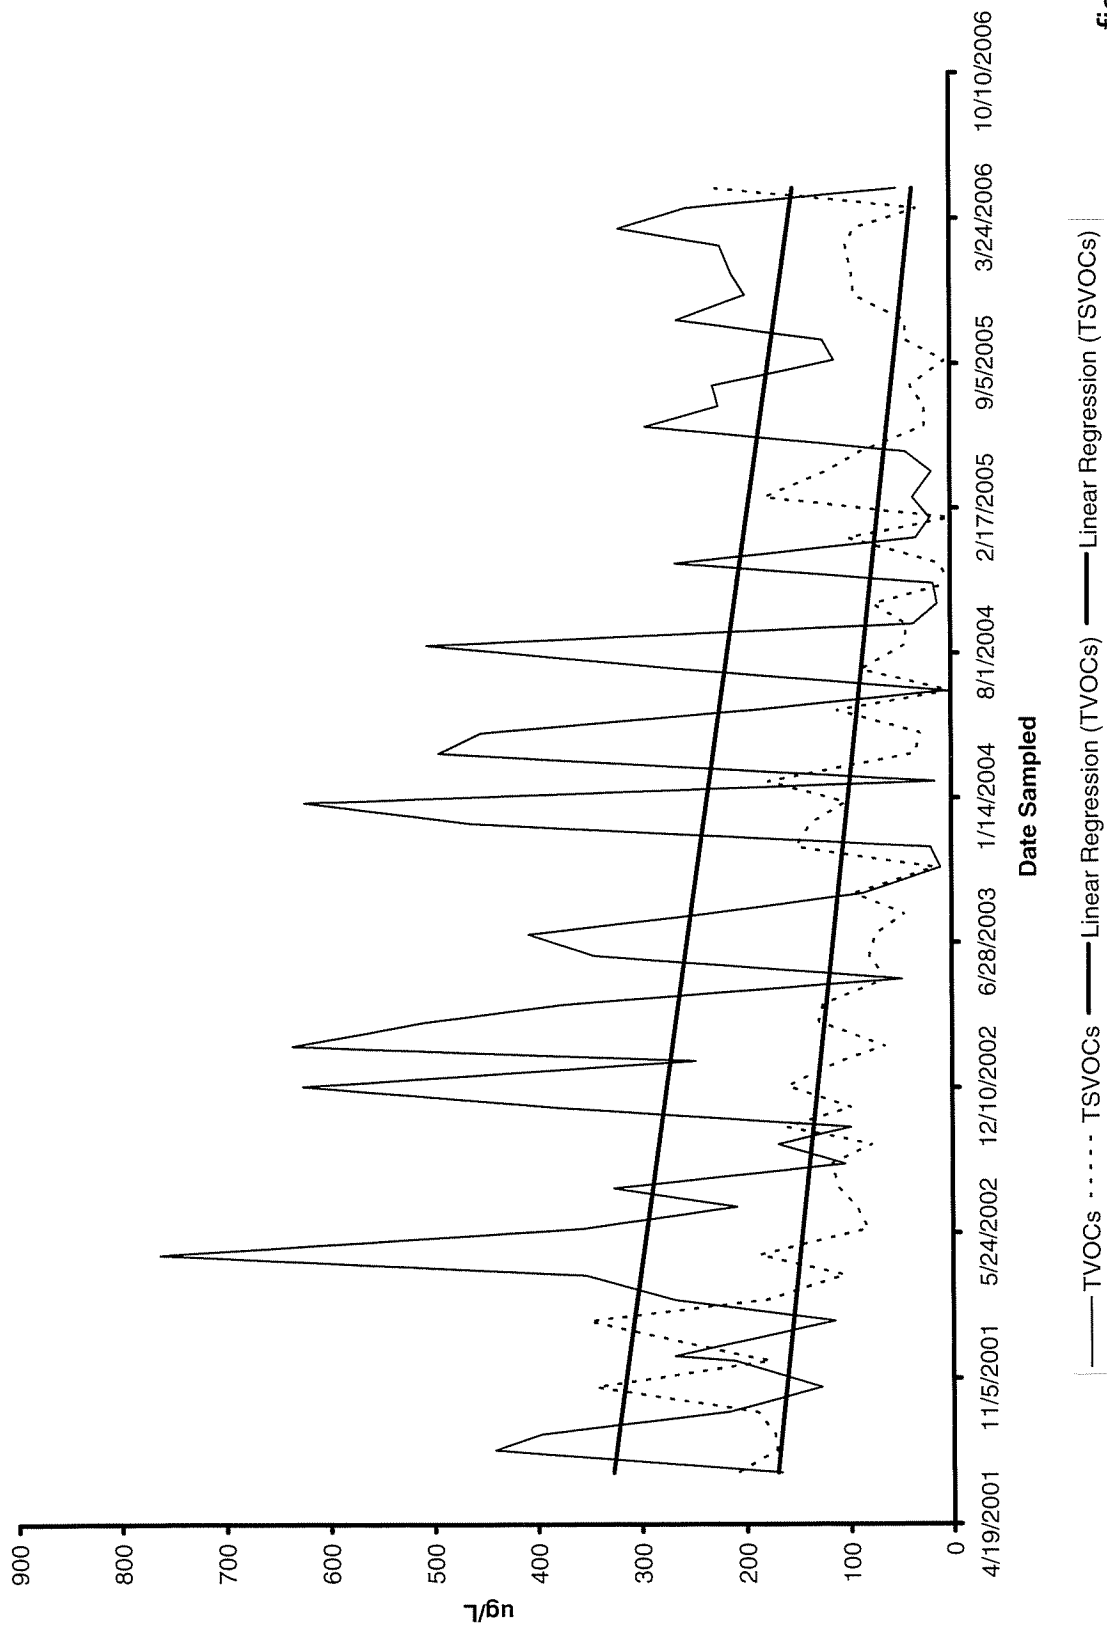


figure 2.14
EFFLUENT TVOCs AND TSVOCs vs. TIME
GRATWICK-RIVERSIDE PARK SITE
North Tonawanda, New York



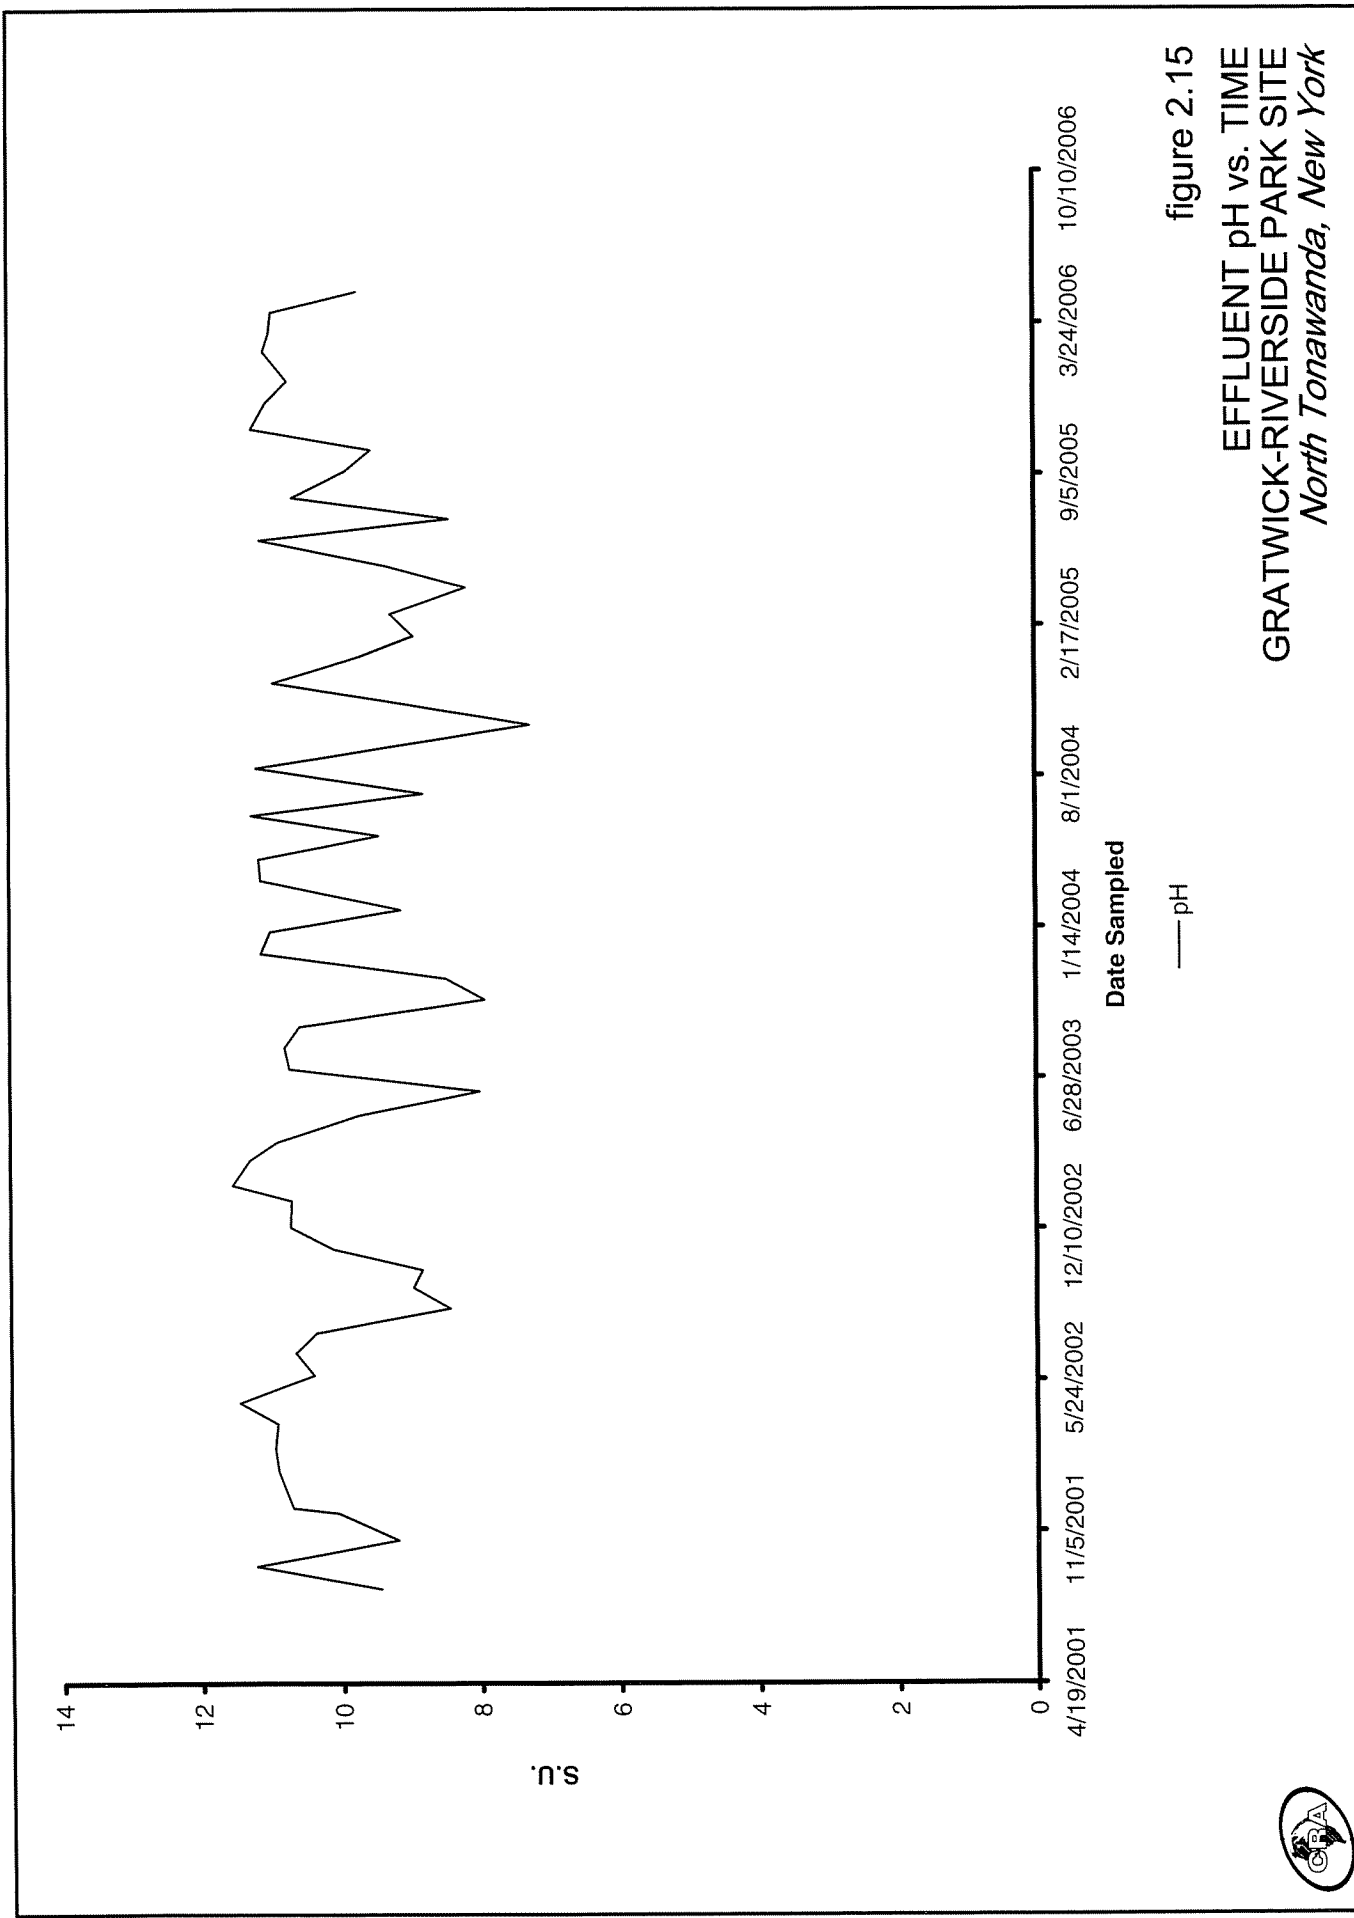


figure 2.15
EFFLUENT pH vs. TIME
GRATWICK-RIVERSIDE PARK SITE
North Tonawanda, New York



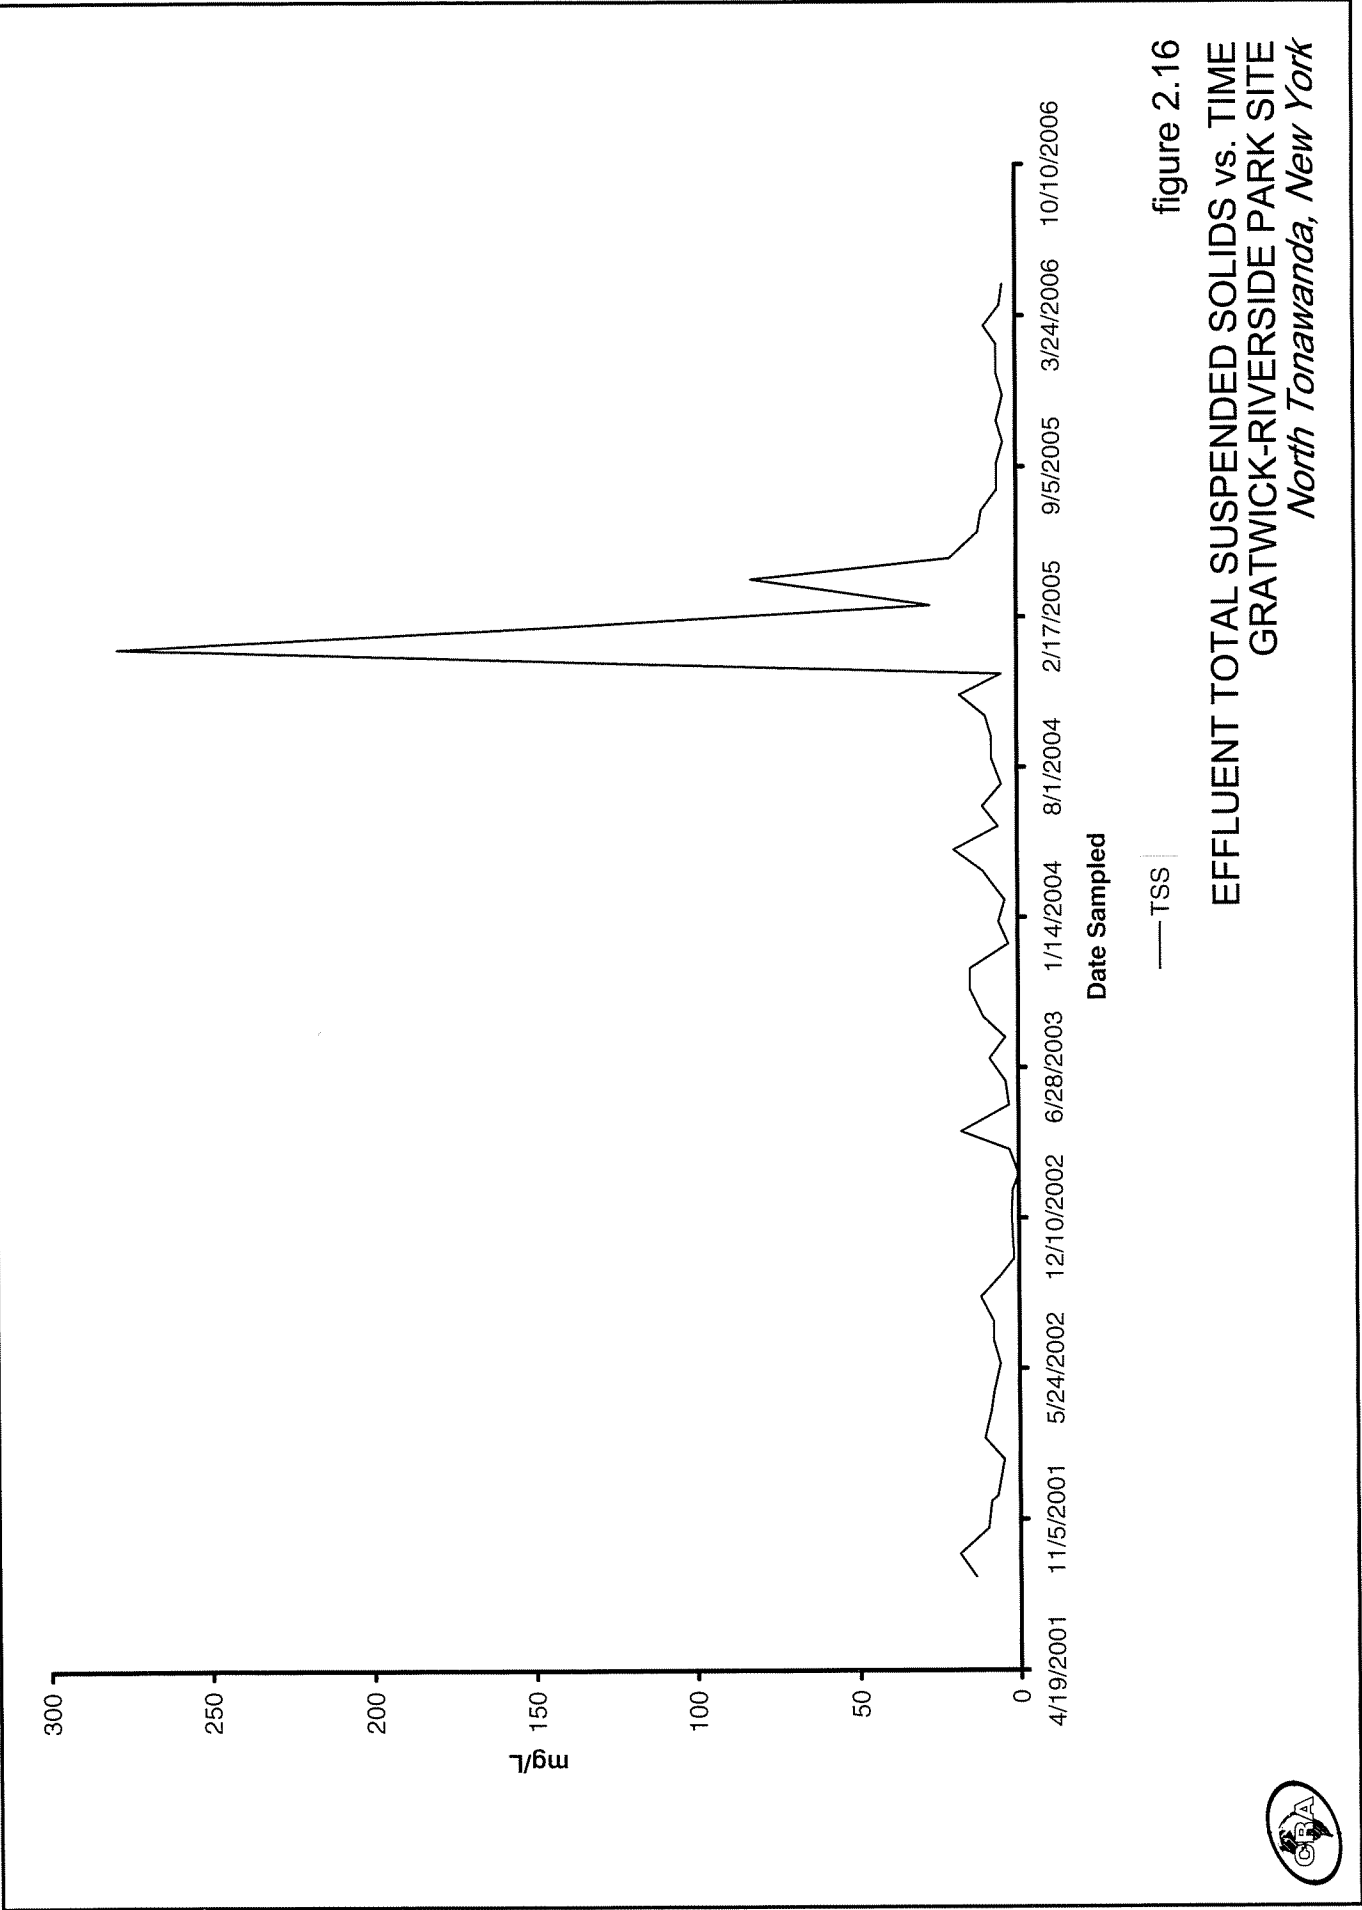


figure 2.16
EFFLUENT TOTAL SUSPENDED SOLIDS vs. TIME
GRATWICK-RIVERSIDE PARK SITE
North Tonawanda, New York



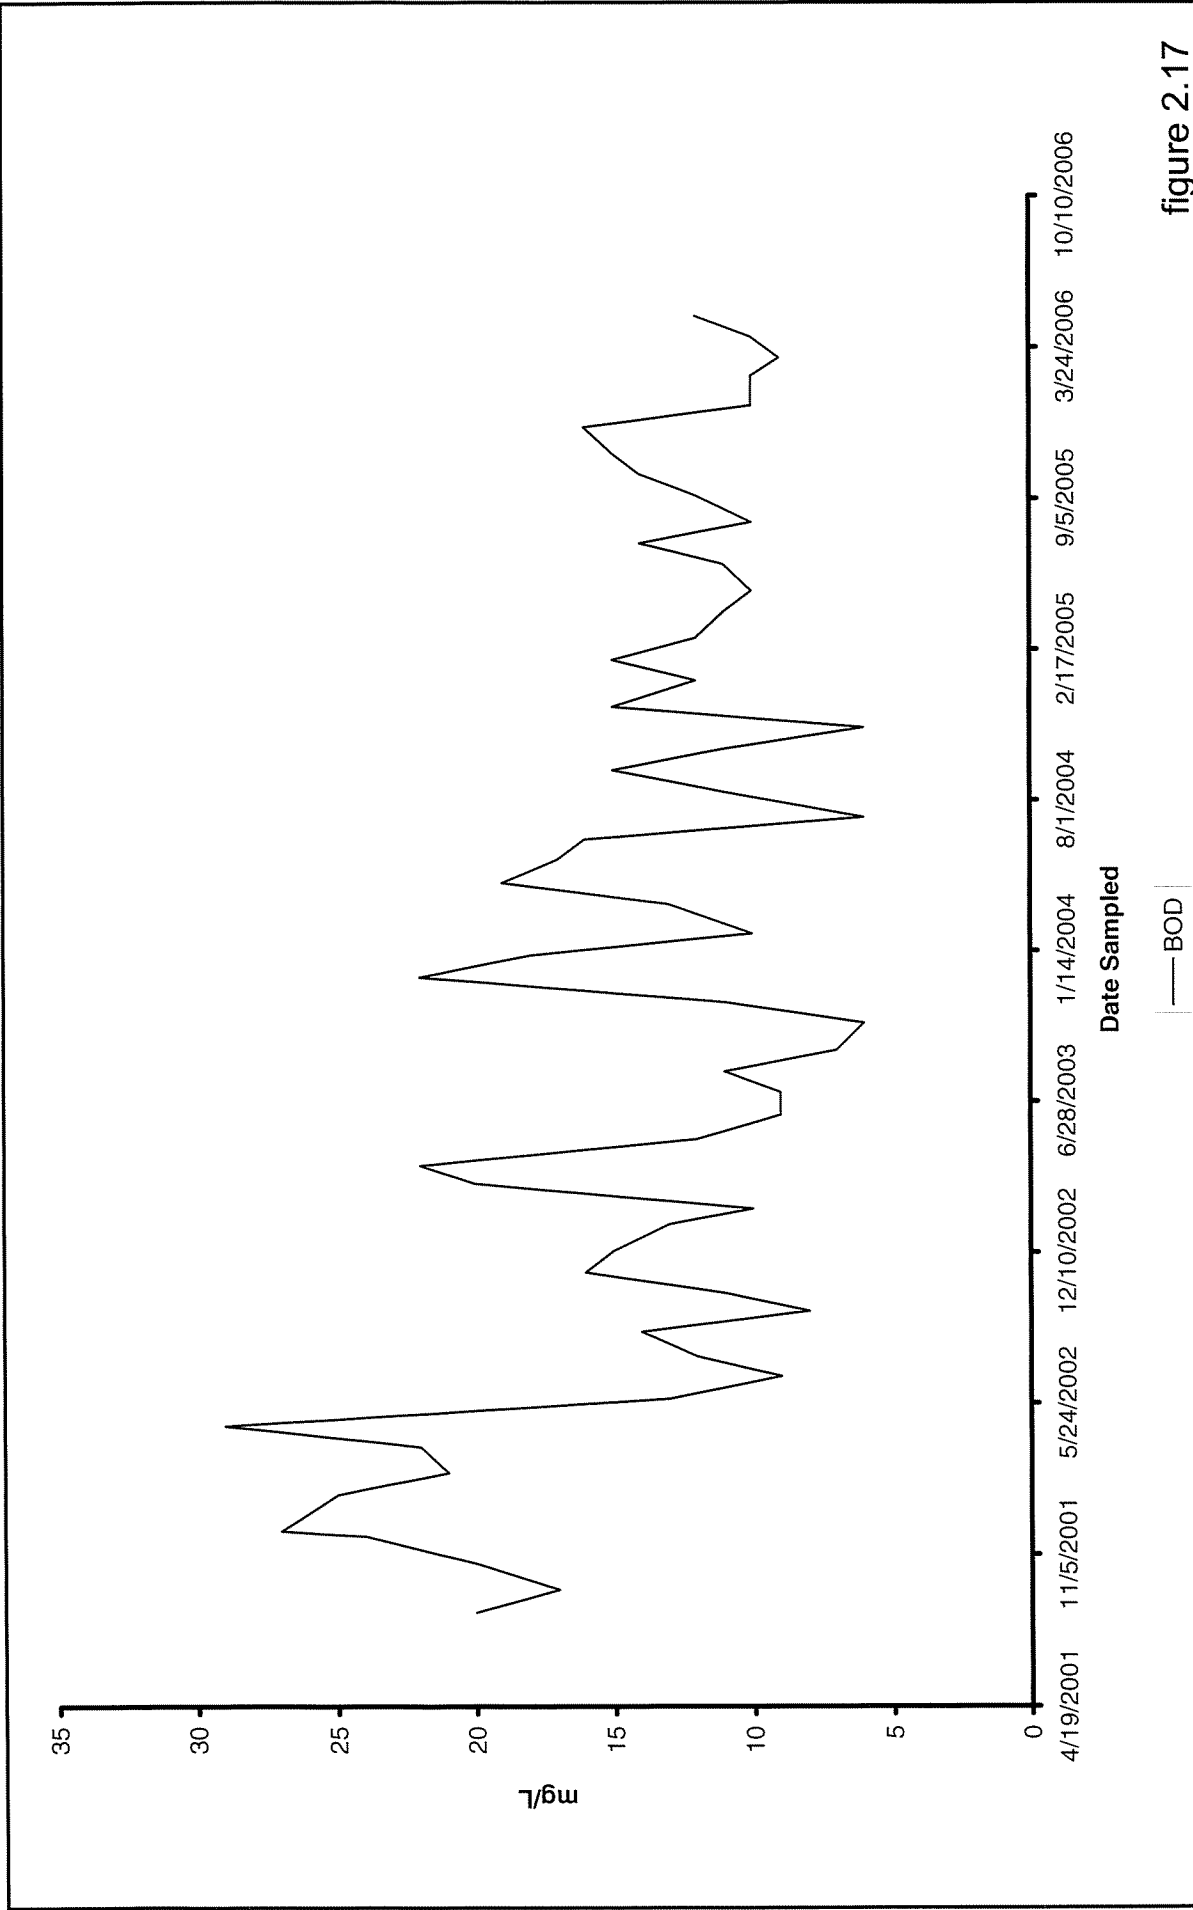


figure 2.17
EFFLUENT BOD vs. TIME
GRATWICK-RIVERSIDE PARK SITE
North Tonawanda, New York



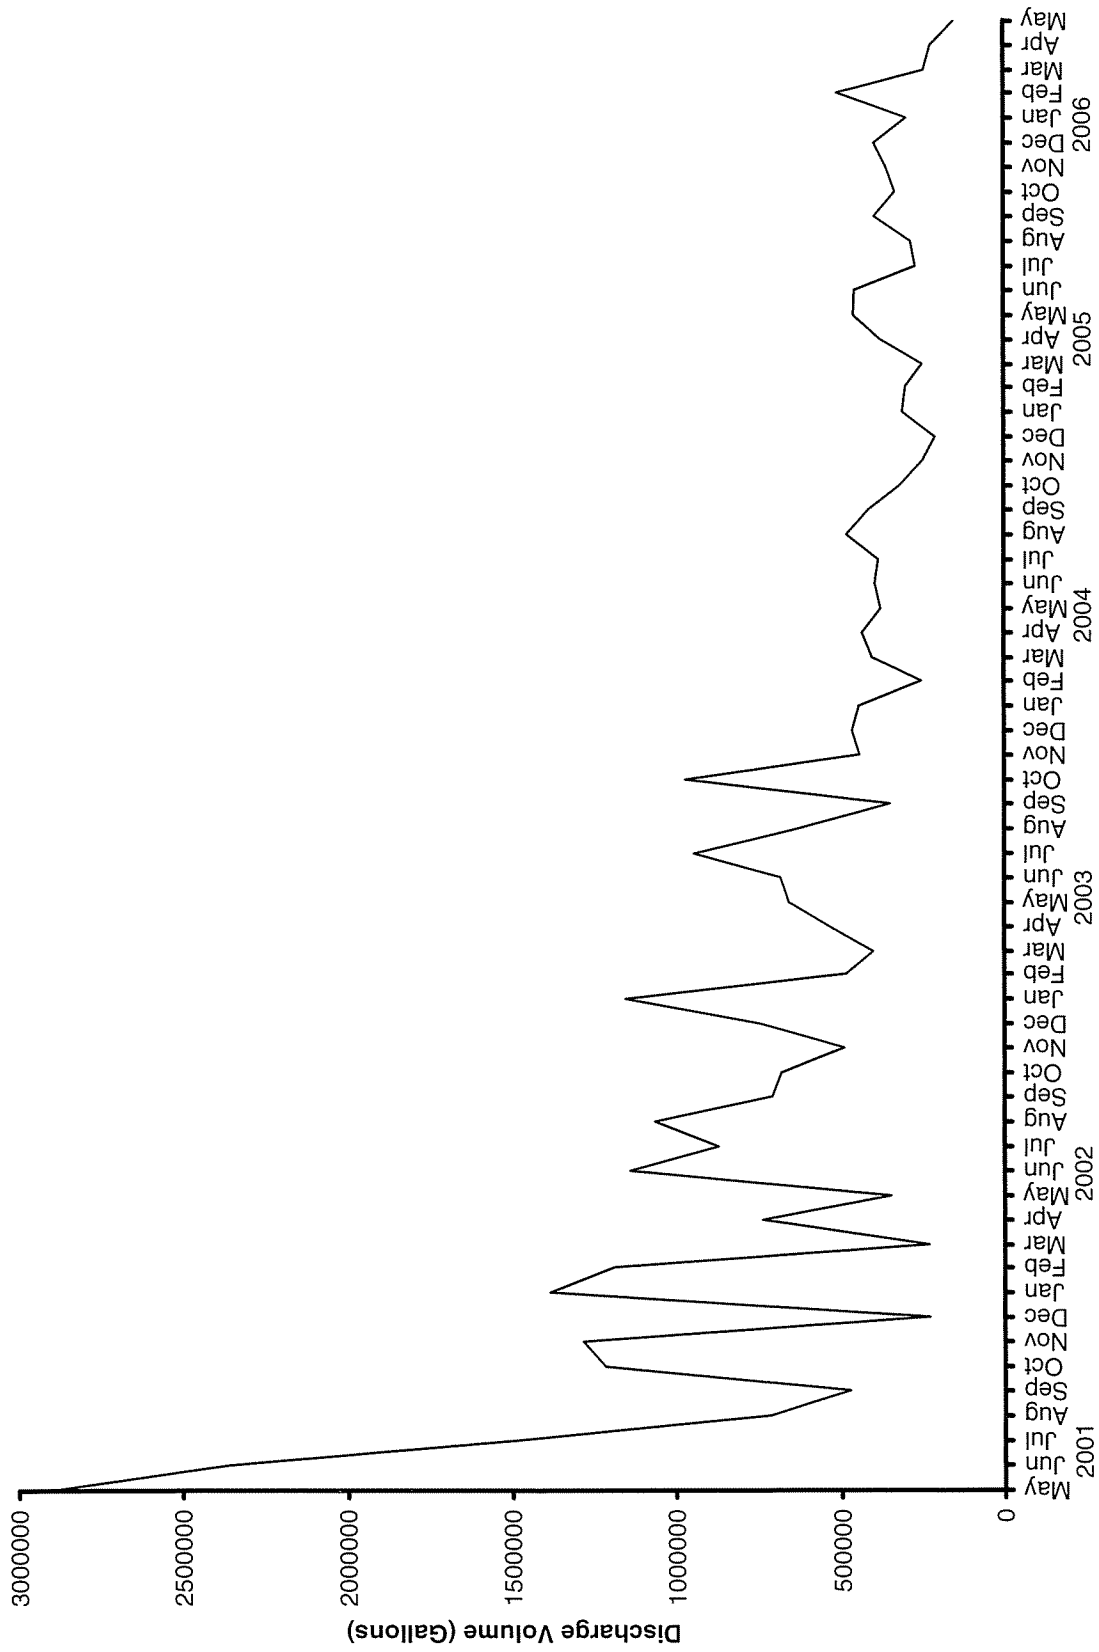


figure 2.18
 EFFLUENT VOLUME vs. TIME
 GRATWICK-RIVERSIDE PARK SITE
 North Tonawanda, New York



TABLE 2.1

GROUNDWATER HYDRAULIC MONITORING LOCATIONS
OPERATION AND MAINTENANCE
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

INWARD HYDRAULIC GRADIENT MONITORING LOCATIONS

<u>Inner</u> ⁽¹⁾	<u>Outer</u>
MH2	Niagara River North (Downstream)
MH6	Niagara River North (Downstream)
MH8	Niagara River Middle
MH12	Niagara River South (Upstream)

UPWARD HYDRAULIC GRADIENT MONITORING LOCATIONS

<u>Upper</u> ⁽¹⁾	<u>Lower</u>
MH3	MW-6
MH8	MW-7
MH11	MW-8
MH14/MH15 ⁽²⁾	MW-9

FREQUENCY

- Weekly following GWS startup until six consecutive inward gradients are achieved; and
- Monthly thereafter for the remainder of the initial 2-year period (review after 2 years).

Notes:

- (1) These manholes will be monitored twice daily by POTW staff during a wet weather bypass event pursuant to Section 5.0 of the O&M Manual.
- (2) Distance weighted averages of water levels used (MH14 - two thirds and MH15 - one third).

TABLE 2.2
WATER LEVELS (ft amsl)
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

Date	MH2	MH3	MH6	OGC-1	MW-6	OGC-5	River North	OGC-6	MH8	MW-7	OGC-2	River Middle	OGC-7
RIM Elevation	573.28	573.81	572.03										
TOC Elevation (ft amsl)				575.01	575.40	573.82	566.80	576.65	572.37	575.57	574.08	566.48	572.49
December 12, 2000	NM			564.26	567.05	563.84	NM	564.24		567.20	564.58	NM	565.24
January 8, 2001	NM		NM	563.94	567.21	563.82	NM	563.84		567.30	564.01	NM	563.90
March 29, 2001	NM		NM	564.19	567.80	563.82	NM	564.10		566.89	564.28	NM	564.12
May 11, 2001	559.31			564.39	563.53	564.54	564.54	564.25		561.60	564.53	564.38	564.50
May 18, 2001	NM		561.98	564.21	563.08	564.54	564.49	564.25		561.97	564.53	564.33	564.55
May 25, 2001	NM		562.03	564.46	562.80	564.52	563.80	564.22		561.71	564.28	563.63	564.50
June 1, 2001	559.34		NM	564.51	562.74	564.52	563.52	564.20		561.77	564.18	563.47	564.49
June 8, 2001	NM		562.49	564.63	562.65	564.82	564.75	564.36		561.59	564.60	564.68	564.78
June 15, 2001	560.79	560.59	562.60	564.67	562.54	564.76	564.71	564.53	560.53	561.48	564.77	564.71	564.79
June 22, 2001	560.77	560.55	562.53	564.65	562.50	564.72	564.90	564.43	560.44	561.41	564.66	564.86	564.72
June 29, 2001	560.62	560.40	562.42	564.51	562.42	564.66	564.52	564.35	560.38	561.39	564.57	564.48	564.59
June 30, 2001	559.87	559.21	562.90	564.49	562.19	564.71	564.66	564.35	560.25	561.30	564.60	564.68	565.70
July 31, 2001	561.49	561.07	565.23	564.60	562.09	563.82	564.69	564.46	560.25	561.29	564.77	564.64	564.81
August 20, 2001	561.03	560.56	563.03	564.61	562.13	564.25	564.68	564.48	560.27	561.32	564.79	564.68	564.99
September 28, 2001	561.38	562.36	567.06	564.61	562.08	564.41	(2)	564.33	560.43	561.37	564.58	564.26	564.33
October 22, 2001	561.45	560.94	564.53	563.95	561.88	563.65	(2)	563.83	560.45	561.36	564.04	563.54	563.87
November 27, 2001	560.96	560.50	564.39	564.47	561.83	564.78	564.69	564.27	559.75	561.25	564.72	564.45	564.86
December 20, 2001	560.74	560.15	563.75	564.09	561.83	563.87	563.89	563.99	560.98	561.89	564.12	563.74	564.01
January 29, 2002	560.80	560.28	564.19	564.22	561.73	563.84	564.03	564.07	561.06	561.50	564.18	563.97	564.19
February 11, 2002	560.55	560.10	563.25	564.10	561.72	563.51	(2)	564.03	560.65	561.60	564.02	563.59	563.83
March 25, 2002	560.55	562.05	564.12	564.60	561.88	564.70	564.61	564.49	561.13	561.95	564.67	564.19	564.72
April 24, 2002	562.54	561.28	564.10	564.79	561.97	564.84	564.76	564.68	560.05	561.38	564.85	564.66	564.84
May 21, 2002	561.74	561.24	565.58	564.74	561.92	564.56	564.58	564.62	560.68	561.54	564.85	564.68	564.80
June 20, 2002	561.67	560.99	564.99	564.78	561.89	565.00	564.89	564.66	560.79	561.65	564.90	564.90	564.93
July 18, 2002	561.46	560.79	565.89	564.86	561.92	564.70	564.65	564.71	561.05	561.93	564.87	564.95	564.87
August 6, 2002	561.26	560.79	565.60	564.80	561.82	565.05	565.04	564.67	561.10	561.95	564.87	564.95	564.97
September 12, 2002	561.60	561.14	566.24	564.18	561.97	563.95	(2)	564.07	561.07	561.95	564.10	563.75	564.00
October 30, 2002	561.63	561.21	554.47	564.05	562.05	563.94	(2)	563.98	558.03	561.41	564.20	563.71	564.06
November 21, 2002	561.12	560.67	555.09	563.99	562.04	563.85	(2)	563.84	559.95	561.25	563.94	563.72	563.87
December 11, 2002	561.55	561.08											

Notes:

- (1) Water level monitored on 09/14/01 was 563.87 ft amsl which provided an inward gradient.
- (2) River level too low to obtain a measurement at the measuring location.
- (3) Water level monitored on 10/27/01 was 563.56 ft. which provided an inward gradient.
- (4) Inspection of the groundwater collection pipe valves in MH6 on November 18, 2002 identified that they were closed. The valves were opened on November 18, 2002 and the water level dropped approximately 6 feet in 10 minutes.

TABLE 2.2
WATER LEVELS (ft amsl)
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

Date	OGC-3	MHI1	MW-8	River South	MHI2	OGC-8	OGC-4	MW-9	MHI4	MHI5	MHI6
RIM Elevation											
TOC Elevation (ft amsl)	573.35	572.11	574.37	568.46	572.37	574.01	574.66	576.23	574.30	575.84	574.82
December 12, 2000	565.07		567.08	NM		564.45	564.85	567.15			
January 8, 2001	563.95		567.29	NM	NM	564.01	564.00	567.35			567.29
March 29, 2001	564.21		567.96	NM	NM	564.24	564.25	568.06			NM
May 11, 2001	564.58		561.95	564.70	564.15	564.63	564.59	562.53			562.45
May 18, 2001	564.59		562.49	564.65	564.12	564.66	564.66	563.05			562.55
May 25, 2001	564.57		561.99	564.80	564.17	564.63	564.60	562.54			562.48
June 1, 2001	564.59		562.06	565.00	564.19	564.66	564.60	562.57			562.51
June 8, 2001	564.87		561.89	565.05	562.45	564.96	564.89	562.47			562.42
June 15, 2001	564.91	561.12	561.69	565.05	562.34	564.93	564.88	562.45	562.32		562.29
June 22, 2001	564.87	561.05	561.54	565.18	562.29	565.00	564.80	562.19	562.32		562.14
June 29, 2001	564.68	560.97	561.46	564.83	561.80	564.75	564.68	562.11	562.45		562.06
July 31, 2001	564.78	560.73	561.19	564.96	560.77	564.85	564.76	562.45	562.45		561.69
August 20, 2001	564.83	560.50	561.05	564.99	560.42	564.88	564.85	561.55	561.72		561.54
September 28, 2001	564.85	560.61	561.07	564.95	560.36	564.87	564.84	561.58	561.70		561.52
October 22, 2001	564.58	560.51	561.27	564.61	560.42	564.61	564.62	561.75	562.10		561.72
November 27, 2001	563.89	559.51	561.30	564.05	560.06	563.89	563.94	561.71	561.87		563.82
December 20, 2001	564.96	561.31	560.73	564.96	560.23	564.99	565.05	561.77	561.89		561.71
January 29, 2002	564.06	Blocked	561.91	563.92	560.29	564.03	564.08	562.31	562.53		562.31
February 11, 2002	564.28	561.23	561.93	564.53	560.24	564.35	564.35	562.52	562.18		562.54
March 25, 2002	563.87	560.97	561.60	564.15	560.34	563.85	563.95	562.45	562.77		562.61
April 24, 2002	564.79	561.41	561.95	564.86	560.63	564.86	564.84	562.96	563.09		562.95
May 21, 2002	564.95	560.35	560.89	565.07	560.89	565.03	564.98	563.11	563.25	562.17	563.10
June 20, 2002	564.85	560.98	561.50	564.88	561.04	564.90	564.94	562.91	562.98	562.00	562.90
July 18, 2002	565.09	561.07	561.80	565.22	560.95	565.17	565.08	562.84	561.83	561.93	562.83
August 6, 2002	564.88	561.33	561.88	564.90	561.07	564.95	564.91	562.75	562.08	561.86	562.75
September 12, 2002	565.09	561.34	561.91	565.25	561.09	565.20	565.05	562.66	562.11	561.75	562.63
October 30, 2002	564.03	561.36	561.95	564.16	561.31	564.14	564.00	562.57	562.68	561.62	562.56
November 21, 2002	564.04	561.49	560.99	564.15	561.44	564.19	564.18	562.74	562.88	561.82	562.73
December 11, 2002	564.01	561.51	560.73	564.14	561.45	564.09	564.02	562.91	563.07	562.01	562.94

Notes:

- (1) Water level monitored on 09/14/01 was 563.87 ft amsl which provided an inward gradient.
- (2) River level too low to obtain a measurement at the measuring location.
- (3) Water level monitored on 10/27/01 was 563.56 ft. which provided an inward gradient.

TABLE 2.2

WATER LEVELS (ft amsl)
 GRATWICK-RIVERSIDE PARK SITE
 NORTH TONAWANDA, NEW YORK

Date	MH2	MH3	MH6	OGC-1	MW-6	OGC-5	River North	OGC-6	MH8	MW-7	OGC-2	River Middle	OGC-7
RIM Elevation	573.28	573.81	572.03										
TOC Elevation (ft amsl)				575.01	575.40	573.82	566.80	576.65	572.37	575.57	574.08	566.48	572.49
January 16, 2003	561.65	561.20	556.15	564.03	562.27	563.88	(2)	564.12	561.04	561.95	564.27	563.52	564.10
February 25, 2003	561.58	561.10	555.74	563.80	561.85	563.71	(2)	563.67	560.60	561.49	563.81	563.34	563.81
March 14, 2003	561.65	561.17	555.75	563.75	561.69	563.74	(2)	563.61	560.61	561.49	563.77	563.24	563.77
April 14, 2003	561.68	561.22	554.54	564.32	562.42	564.34	564.30	564.17	558.65	561.42	564.39	564.24	564.40
May 8, 2003	561.52	561.03	555.93	564.37	562.38	564.41	564.29	564.21	560.76	561.59	564.36	564.27	564.37
June 19, 2003	562.26	561.83	556.02	564.73	562.43	564.83	564.78	564.59	560.85	561.60	564.77	564.66	564.81
July 21, 2003	561.21	560.46	556.06	564.68	562.31	564.64	564.49	564.58	560.89	561.74	564.81	564.44	564.75
August 28, 2003	561.65	561.20	554.61	564.65	562.21	564.76	564.64	564.51	558.52	561.29	564.67	564.60	564.75
September 30, 2003	561.57	561.10	555.08	564.64	562.53	564.89	(2)	564.49	559.88	561.35	564.76	564.67	564.91
October 20, 2003	561.48	561.07	554.98	564.61	562.52	564.93	(2)	564.45	559.77	561.17	564.68	564.63	564.86
November 3, 2003	561.53	561.08	555.94	564.29	562.33	563.89	(2)	564.11	560.76	561.12	563.56	564.36	564.15
December 23, 2003	561.08	559.49	555.62	564.29	562.30	564.04	(2)	564.17	560.67	561.48	564.33	(2)	564.18
January 21, 2004	(5)	560.33	555.84	565.24	562.32	564.19	(2)	564.12	560.70	561.55	564.30	(2)	564.26
February 12, 2004	(5)	561.08	556.12	563.99	562.16	563.76	(2)	563.87	560.95	561.81	564.00	(2)	563.88
March 4, 2004	561.33	561.13	555.90	564.17	562.21	557.07 (6)	(2)	564.00	560.75	561.61	564.31	(2)	564.19
April 16, 2004	560.05	558.78	554.91	564.59	562.48	564.49	(2)	564.36	559.59	561.71	564.56	564.43	564.56
May 14, 2004	560.17	559.71	554.56	564.49	562.39	564.57	564.55	564.34	559.45	561.70	564.51	564.48	564.54
June 25, 2004	561.64	561.21	555.74	564.76	562.27	564.71	564.68	564.62	560.50	561.42	564.82	564.56	564.78
July 30, 2004	561.79	561.25	555.24	565.01	562.29	565.20	565.20	564.84	560.04	561.31	565.02	565.16	565.14
August 31, 2004	561.37	560.59	555.83	565.06	562.23	565.05	564.98	564.92	560.67	561.56	565.14	564.93	565.17
September 30, 2004	561.48	560.81	555.60	565.11	562.28	565.22	565.00	564.95	560.71	561.49	565.20	565.05	565.20
October 20, 2004	561.65	561.19	555.96	564.65	562.10	564.57	564.45	564.44	560.82	561.69	564.57	564.41	564.57
November 23, 2004	561.50	561.05	554.95	564.17	561.99	564.20	(2)	564.02	559.77	561.21	564.31	(2)	564.28
December 31, 2004	561.60	560.74	556.19	564.58	562.16	564.50	564.68	564.25	561.02	561.80	564.37	564.56	564.40

Notes:

- (1) Water level monitored on 09/14/01 was 563.87 ft amsl which provided an inward gradient.
- (2) River level too low to obtain a measurement at the measuring location.
- (3) Water level monitored on 10/27/01 was 563.56 ft. which provided an inward gradient.
- (4) Inspection of the groundwater collection pipe valves in MH6 on November 18, 2002 identified that they were closed. The valves were opened on November 18, 2002 and the water level dropped approximately 6 feet in 10 minutes.
- (5) Buried with snow.
- (6) Believed to be erroneous reading.

TABLE 2.2
WATER LEVELS (ft amsl)
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

<i>Date</i>	<i>OGC-3</i>	<i>MHI1</i>	<i>MW-8</i>	<i>River South</i>	<i>MHI2</i>	<i>OGC-8</i>	<i>OGC-4</i>	<i>MW-9</i>	<i>MHI4</i>	<i>MHI5</i>	<i>MHI6</i>
RIM Elevation											
TOC Elevation (ft amsl)	573.35	572.11	574.37	568.46	572.37	574.01	574.66	576.23	574.30	575.84	574.82
January 16, 2003	564.13	561.68	562.00	564.11	561.83	564.14	564.20	563.17	563.37	562.28	563.20
February 25, 2003	563.87	561.60	561.48	564.21	561.56	563.90	563.94	562.89	563.07	562.01	562.91
March 14, 2003	563.79	561.57	561.46	564.11	561.54	563.92	563.91	562.90	563.09	562.05	562.93
April 14, 2003	564.48	558.53	560.98	564.45	561.56	564.54	564.52	563.36	563.54	562.49	563.40
May 8, 2003	564.48	561.03	561.56	564.61	561.61	564.59	564.44	563.07	563.26	562.01	563.11
June 19, 2003	564.92	561.12	561.56	564.96	561.94	564.99	564.95	563.10	563.41	562.25	563.15
July 21, 2003	564.81	561.10	561.69	564.78	562.03	564.84	564.88	562.89	563.03	561.98	562.89
August 28, 2003	564.86	564.37	562.35	564.91	562.19	564.94	564.85	566.17	566.48	566.36	566.59
September 30, 2003	565.02	558.68	560.17	565.08	562.26	565.08	565.02	562.77	562.89	562.02	562.78
October 20, 2003	564.94	558.66	560.02	565.03	562.25	565.05	564.96	562.75	562.88	562.01	562.76
November 3, 2003	564.26	561.01	561.57	564.28	562.52	564.27	564.31	562.85	563.00	561.91	562.83
December 23, 2003	564.24	560.94	561.34	564.36	562.75	564.08	564.28	563.20	563.31	562.28	563.20
January 21, 2004	564.33	(4)	561.47	564.36	562.49	564.41	564.35	562.72	(4)	561.74	562.68
February 12, 2004	563.93	561.23	561.75	564.16	562.30	563.96	563.98	562.88	(4)	561.73	562.66
March 4, 2004	564.25	561.04	561.56	564.26	562.07	564.34	564.35	562.70	562.75	561.75	562.66
April 16, 2004	564.64	559.85	561.38	564.69	561.00	564.74	564.66	562.64	562.79	561.72	562.63
May 14, 2004	564.63	559.87	561.39	564.71	560.80	564.68	564.55	562.71	562.74	561.74	562.67
June 25, 2004	564.85	560.79	561.19	564.91	560.95	564.89	564.89	562.70	562.74	561.76	562.68
July 30, 2004	565.28	560.26	560.71	565.46	561.15	565.33	565.21	562.70	561.13	561.74	562.67
August 31, 2004	565.26	560.94	561.39	565.25	561.35	565.31	565.27	562.95	563.08	562.02	562.93
September 30, 2004	565.29	561.00	561.43	565.30	561.25	565.40	565.26	562.98	562.90	562.20	562.98
October 20, 2004	564.67	561.09	561.56	564.49	561.50	564.76	564.68	562.64	562.82	561.73	562.88
November 23, 2004	564.34	560.05	560.56	564.30	561.57	564.38	564.40	562.71	561.04	561.62	562.69
December 31, 2004	564.69	561.23	561.75	564.81	561.81	564.78	564.55	562.71	562.05	561.77	562.69

Notes:

- (1) Water level monitored on 09/14/01 was 563.87 ft amsl which provided an inward gradient.
- (2) River level too low to obtain a measurement at the measuring location.
- (3) Water level monitored on 10/27/01 was 563.56 ft. which provided an inward gradient.
- (4) Buried with snow.

TABLE 2.2

WATER LEVELS (ft amsl)														
GRATWICK-RIVERSIDE PARK SITE														
NORTH TONAWANDA, NEW YORK														
Date	MH2	MH3	MH6	OGC-1	MW-6	OGC-5	River			MH8	MW-7	OGC-2	River Middle	OGC-7
							North	OGC-6	OGC-7					
RIM Elevation	573.28	573.81	572.03	575.01	575.40	573.82	566.80		576.65	572.37	575.57	574.08	566.48	572.49
TOC Elevation (ft amsl)														
January 28, 2005	562.60	562.15	556.22	564.68	562.27	564.62	(2)	564.53	561.06	561.85	564.67	564.32	564.32	564.71
February 28, 2005	561.05	559.96	555.58	564.58	562.14	564.68	(7)	564.48	560.47	561.46	564.21	564.46	564.46	564.76
March 31, 2005	561.25	559.94	555.93	564.55	562.04	564.40	(2)	564.38	560.78	561.66	564.63	564.08	564.08	564.49
April 20, 2005	560.20	559.54	556.01	565.01	562.26	564.94	564.83	564.84	560.89	561.76	565.01	564.71	564.71	565.05
May 27, 2005	560.23	558.92	555.82	564.71	562.24	564.79	564.78	564.63	560.65	561.55	564.78	564.74	564.74	564.91
June 24, 2005	561.50	561.09	555.16	564.71	562.22	564.85	564.73	564.61	559.92	561.47	564.78	564.70	564.70	564.85
July 29, 2005	562.70	562.26	556.56	564.79	562.11	564.95	564.82	564.65	561.39	562.27	564.87	564.85	564.85	564.98
August 31, 2005	561.62	560.64	556.24	564.68	562.09	564.71	(2)	564.59	561.07	561.94	564.79	564.54	564.54	564.82
October 3, 2005	561.52	560.54	555.41	564.75	562.24	564.85	564.80	564.62	560.20	561.40	564.78	564.75	564.75	564.88
October 31, 2005	561.68	560.73	555.60	564.59	562.34	564.69	564.80	564.44	560.46	561.52	564.64	564.55	564.55	564.70
November 22, 2005	561.62	561.20	555.20	564.40	561.67	564.64	(2)	564.28	560.04	561.49	564.44	(2)	(2)	564.21
December 23, 2005	562.55	562.09	556.20	564.28	562.45	564.11	(2)	564.22	561.05	561.85	564.42	(2)	(2)	564.32
January 27, 2006	562.95	562.53	556.21	564.50	562.97	564.16	(2)	564.32	561.02	561.79	564.41	(2)	(2)	564.06
February 28, 2006	563.17	562.26	554.70	564.27	562.90	564.13	(2)	564.31	558.44	561.68	564.37	(2)	(2)	564.26
March 24, 2006	562.68	561.77	555.64	564.46	562.86	564.25	(2)	564.32	560.43	561.57	564.46	(2)	(2)	564.36
April 21, 2006	562.31	561.84	555.61	564.42	562.76	564.41	(2)	564.32	560.40	561.48	564.49	564.26	564.26	564.46
May 30, 2006	562.73	562.30	555.84	564.91	562.50	565.00	564.87	564.80	560.44	561.75	564.95	564.86	564.86	565.07

Notes:

- (1) Water level monitored on 09/14/01 was 563.87 ft amsl which provided an inward gradient.
- (2) River level too low to obtain a measurement at the measuring location.
- (3) Water level monitored on 10/27/01 was 563.56 ft. which provided an inward gradient.
- (4) Inspection of the groundwater collection pipe valves in MH6 on November 18, 2002 identified that they were closed. The valves were opened on November 18, 2002 and the water level dropped approximately 6 feet in 10 minutes.
- (5) Buried with snow.
- (6) Believed to be erroneous reading.
- (7) Ice on pipe.

TABLE 2.2
WATER LEVELS (ft amsl)
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

Date	OGC-3	MHI1	MW-8	River South	MHI2	OGC-8	OGC-4	MW-9	MHI4	MHI5	MHI6
RIM Elevation											
TOC Elevation (ft amsl)	573.35	572.11	574.37	568.46	572.37	574.01	574.66	576.23	574.30	575.84	574.82
January 28, 2005	564.77	561.33	561.82	564.69	561.92	564.79	564.90	562.75	(4)	561.01	562.71
February 28, 2005	564.84	560.74	561.25	564.79	562.05	564.88	564.94	562.78	(4)	561.55	562.77
March 31, 2005	564.54	561.06	561.60	564.56	562.11	564.59	564.65	563.12	563.26	562.21	563.11
April 20, 2005	565.13	561.15	561.65	565.15	562.26	565.19	565.21	563.21	562.72	562.28	563.20
May 27, 2005	564.99	561.13	561.42	565.02	562.29	565.08	565.08	563.12	563.25	562.19	563.11
June 24, 2005	564.98	560.18	560.76	564.92	562.40	565.06	565.00	562.85	562.93	561.91	562.82
July 29, 2005	565.09	561.17	562.15	565.15	562.51	565.14	561.33	562.88	563.03	561.98	562.87
August 31, 2005	564.88	561.31	561.85	564.88	562.75	564.90	564.96	562.91	563.01	561.98	562.86
October 3, 2005	564.99	560.43	560.95	565.11	562.90	565.07	564.97	563.20	563.26	562.24	563.13
October 31, 2005	564.83	560.71	561.25	565.00	563.15	564.96	564.82	563.39	563.50	562.43	563.35
November 22, 2005	564.26	560.31	561.00	564.18	563.29	564.26	564.35	563.53	563.69	562.25	563.53
December 23, 2005	564.35	561.30	561.84	564.26	563.46	564.32	564.48	563.50	563.67	562.60	563.52
January 27, 2006	564.34	561.26	561.76	564.36	563.61	564.42	564.42	563.90	564.08	563.02	563.92
February 28, 2006	564.32	558.38	561.23	564.29	563.73	564.34	564.38	563.94	564.09	563.02	563.96
March 24, 2006	564.39	560.60	561.16	564.44	563.47	564.45	564.50	563.83	564.02	562.96	563.88
April 21, 2006	564.54	560.63	561.15	564.64	563.49	564.60	564.55	563.65	563.77	562.68	563.61
May 30, 2006	565.18	560.28	561.03	565.24	563.61	565.26	565.25	563.48	563.54	562.53	563.44

Notes:

- (1) Water level monitored on 09/14/01 was 563.87 ft amsl which provided an inward gradient.
- (2) River level too low to obtain a measurement at the measuring location.
- (3) Water level monitored on 10/27/01 was 563.56 ft. which provided an inward gradient.
- (4) Buried with snow.

TABLE 2.3

SUMMARY OF HORIZONTAL GRADIENTS
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

Date Monitored	Monitoring Location	5/11/2001			5/18/2001			5/25/2001			6/1/2001			6/8/2001			6/15/2001		
		Water Level (ft amsl)	Gradient	Direction	Water Level (ft amsl)	Gradient	Direction	Water Level (ft amsl)	Gradient	Direction	Water Level (ft amsl)	Gradient	Direction	Water Level (ft amsl)	Gradient	Direction	Water Level (ft amsl)	Gradient	Direction
	Outer River North Inner MH2	564.54	Inward		564.49	NA		563.80	NA		563.52	Inward		564.75	NA		564.71	Inward	
		559.31			NM			NM			559.34			NM			560.79		
		564.54	Inward		564.49	Inward		563.80	NA		563.52	Inward		564.75	Inward		564.71	Inward	
		561.98			562.03			NM			561.97			562.49			562.60		
		564.38	NA		564.33	NA		563.63	NA		563.47	NA		564.68	NA		564.71	Inward	
	Outer River Middle Inner MH8	NM			NM			NM			NM			NM			560.53		
		564.70	Inward		564.65	Inward		564.80	Inward		565.00	Inward		565.05	Inward		565.05	Inward	
		564.15			561.12			564.17			564.19			562.45			562.34		
	Outer River South Inner MH12																		
Date Monitored	Monitoring Location	6/22/801			6/29/2001			7/31/2001			8/20/2001			9/28/2001			10/22/2001		
		Water Level (ft amsl)	Gradient	Direction	Water Level (ft amsl)	Gradient	Direction	Water Level (ft amsl)	Gradient	Direction	Water Level (ft amsl)	Gradient	Direction	Water Level (ft amsl)	Gradient	Direction	Water Level (ft amsl)	Gradient	Direction
	Outer River North Inner MH2	564.90	Inward		564.52	Inward		564.66	Inward		564.69	Inward		564.68	Inward		564.36 (2)	Inward	
		560.77			560.62			559.87			561.49			561.03			561.38		
		564.90	Inward		564.52	Inward		564.66	Inward		564.69	(1) Outward		564.68	Inward		564.36 (2)	Outward	
		562.53			562.42			562.90			565.23			563.03			567.06		
		564.86	Inward		564.48	Inward		564.68	Inward		564.64	Inward		564.68	Inward		564.26	Inward	
	Outer River Middle Inner MH8	560.44			560.38			560.25			560.25			560.27			560.43		
		565.18	Inward		564.83	Inward		564.96	Inward		564.99	Inward		564.95	Inward		564.61	Inward	
		562.29			561.80			560.77			560.42			560.36			560.42		

Notes:

- (1) Water level monitored on 9/14/01 was 563.87 ft amsl which provided an inward gradient.
- (2) River level too low to obtain a measurement at the monitoring location. Water level shown is River South Water level minus 0.25 feet.
- (3) Valves in MH6 were opened on November 18, 2002.
- (4) Snow covered well, could not locate.
- NM - Not Measured
- NA - Not Applicable

TABLE 2.3

SUMMARY OF HORIZONTAL GRADIENTS
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

Date Monitored	Monitoring Location	11/27/2001			12/20/2001			1/29/2002			2/11/2002			3/25/2002			4/24/2002		
		Water Level (ft amsl)	Gradient Direction		Water Level (ft amsl)	Gradient Direction		Water Level (ft amsl)	Gradient Direction		Water Level (ft amsl)	Gradient Direction		Water Level (ft amsl)	Gradient Direction		Water Level (ft amsl)	Gradient Direction	
Date Monitored	Outer River North Inner MH2	563.80 (2)	Inward		564.69	Inward		563.89	Inward		564.03	Inward		563.90 (2)	Inward		564.61	Inward	
		561.45			560.96			560.74			560.80			560.55			562.54		
	Outer River North Inner MH6	563.80 (2)	Outward		564.69	Inward		563.89	Inward		564.03	Outward		563.90 (2)	Inward		564.61	Inward	
		564.53			564.39			563.75			564.19			563.25			564.12		
	Outer River Middle Inner MH8	563.54	Inward		564.45	Inward		563.74	Inward		563.97	Inward		563.59	Inward		564.19	Inward	
		560.45			559.75			560.98			561.06			560.65			561.13		
	Outer River South Inner MH12	564.05	Inward		564.96	Inward		563.92	Inward		564.53	Inward		564.15	Inward		564.86	Inward	
		560.06			560.23			560.29			560.28			560.34			560.63		
Date Monitored	Outer River North Inner MH2	564.76	Inward		564.58	Inward		564.89	Inward		564.65	Inward		565.04	Inward		563.91 (2)	Inward	
		561.74			561.67			561.46			561.26			561.60			561.63		
	Outer River North Inner MH6	564.76	Inward		564.58	Outward		564.89	Outward		564.65	Outward		565.04	Outward		563.91 (2)	Outward	
		564.10			565.58			564.99			565.89			565.60			566.24		
	Outer River Middle Inner MH8	564.66	Inward		564.68	Inward		564.90	Inward		564.59	Inward		564.95	Inward		563.75	Inward	
		560.05			560.68			560.79			561.05			561.10			561.07		
	Outer River South Inner MH12	565.07	Inward		564.88	Inward		565.22	Inward		564.90	Inward		565.25	Inward		564.16	Inward	
		560.84			561.04			560.95			561.07			561.09			561.31		

Notes:

- (1) Water level monitored on 9/14/01 was 563.87 ft amsl which provided an inward gradient.
 - (2) River level too low to obtain a measurement at the monitoring location. Water level shown is River South Water level minus 0.25 feet.
 - (3) Valves in MH6 were opened on November 18, 2002.
 - (4) Snow covered well, could not locate.
- NM - Not Measured
NA - Not Applicable

TABLE 2.3

SUMMARY OF HORIZONTAL GRADIENTS
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

Date Monitored	Monitoring Location	11/21/2002		12/11/2002		1/16/2003		2/25/2003		3/14/2003		4/14/2003	
		Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction
Outer Inner	River North MH2	563.90 (2) 561.12	Inward	563.89 (2) 561.55	Inward	563.86 (2) 561.65	Inward	563.96 (2) 561.58	Inward	563.86 (2) 561.65	Inward	564.30 561.68	Inward
Outer Inner	River North MH6	563.90 (2) 554.47 (3)	Inward	563.89 (2) 555.09	Inward	563.86 (2) 556.15	Inward	563.96 (2) 555.74	Inward	563.86 (2) 555.75	Inward	564.30 554.54	Inward
Outer Inner	River Middle MH8	563.71 558.03	Inward	563.72 559.95	Inward	563.52 561.04	Inward	563.34 560.60	Inward	563.24 560.61	Inward	564.24 558.65	Inward
Outer Inner	River South MH12	564.15 561.44	Inward	564.14 561.45	Inward	564.11 561.83	Inward	564.21 561.26	Inward	564.11 561.54	Inward	564.45 561.56	Inward

Date Monitored	Monitoring Location	5/8/2003		6/19/2003		7/21/2003		8/28/2003		9/30/2003		10/30/2003	
		Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction
Outer Inner	River North MH2	564.61 561.52	Inward	564.78 562.26	Inward	564.49 561.21	Inward	564.64 561.65	Inward	564.83 (2) 561.65	Inward	564.78 (2) 561.48	Inward
Outer Inner	River North MH6	564.61 555.93	Inward	564.78 556.02	Inward	564.49 556.06	Inward	564.64 554.61	Inward	564.83 (2) 554.61	Inward	564.78 (2) 554.98	Inward
Outer Inner	River Middle MH8	564.27 560.76	Inward	564.66 560.85	Inward	564.44 560.89	Inward	564.6 558.52	Inward	564.6 558.52	Inward	564.63 559.77	Inward
Outer Inner	River South MH12	564.61 561.61	Inward	564.96 561.94	Inward	564.78 562.03	Inward	564.91 562.19	Inward	565.08 562.26	Inward	565.03 562.25	Inward

Notes:

- (1) Water level monitored on 9/14/01 was 563.87 ft amsl which provided an inward gradient.
 - (2) River level too low to obtain a measurement at the monitoring location. Water level shown is River South Water level minus 0.25 feet.
 - (3) Valves in MH6 were opened on November 18, 2002.
 - (4) Snow covered well, could not locate.
- NM - Not Measured
NA - Not Applicable

TABLE 2.3

SUMMARY OF HORIZONTAL GRADIENTS
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

Date Monitored	Monitoring Location	11/21/2003		12/11/2003		1/16/2004		2/25/2004		3/14/2004		4/14/2004	
		Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction
Outer	River North	564.03 (2)	Inward	564.11 (2)	Inward	564.11 (2)	(4)	563.91 (2)	Inward	564.01 (2)	Inward	564.44 (2)	Inward
Inner	MH2	561.53		561.08		(4)		(4)		561.33		560.05	
Outer	River North	564.03 (2)	Inward	564.11 (2)	Inward	564.11 (2)	Inward	563.91 (2)	Inward	564.01 (2)	Inward	564.44 (2)	Inward
Inner	MH6	555.94		555.82		555.84		556.12		555.9		554.91	
Outer	River Middle	564.36	Inward	564.11 (2)	Inward	564.11 (2)	Inward	563.91 (2)	Inward	564.01 (2)	Inward	564.43	Inward
Inner	MH8	560.76		560.67		560.7		560.95		560.75		559.59	
Outer	River South	564.28	Inward	564.36	Inward	564.36	Inward	564.16	Inward	564.26	Inward	564.69	Inward
Inner	MH12	562.52		562.75		562.49		562.3		562.07		561	
Date Monitored	Monitoring Location	5/14/2004		6/25/2004		7/30/2004		8/31/2004		9/30/2004		10/20/2004	
		Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction
Outer	River North	564.55	Inward	564.68	Inward	565.20	Inward	564.98	Inward	565.00	Inward	564.45	Inward
Inner	MH2	560.17		561.64		561.79		561.37		561.48		561.65	
Outer	River North	564.55	Inward	564.68	Inward	565.20	Inward	564.98	Inward	565.00	Inward	564.45	Inward
Inner	MH6	554.56		555.74		555.24		555.83		555.60		555.96	
Outer	River Middle	564.48	Inward	564.56	Inward	565.16	Inward	564.93	Inward	565.05	Inward	564.41	Inward
Inner	MH8	559.45		560.50		560.04		560.67		560.71		560.82	
Outer	River South	564.71	Inward	564.91	Inward	565.46	Inward	565.25	Inward	565.30	Inward	564.49	Inward
Inner	MH12	560.80		560.95		561.15		561.35		561.25		561.50	

Notes:

- (1) Water level monitored on 9/14/01 was 563.87 ft amsl which provided an inward gradient.
 - (2) River level too low to obtain a measurement at the monitoring location. Water level shown is River South Water level minus 0.25 feet.
 - (3) Valves in MH6 were opened on November 18, 2002.
 - (4) Snow covered well, could not locate.
- NM - Not Measured
NA - Not Applicable

TABLE 2.3

SUMMARY OF HORIZONTAL GRADIENTS
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

Date Monitored	Monitoring Location	11/23/2004		12/31/2004		1/28/2005		2/28/2005		3/31/2005		4/29/2005	
		Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction
Outer Inner	River North MH2	564.05 (2) 561.50	Inward	564.68 561.60	Inward	564.44 (2) 562.60	Inward	(6) 561.05	NA	564.31 (2) 561.25	Inward	564.83 560.20	Inward
Outer Inner	River North MH6	564.05 (2) 554.95	Inward	564.68 556.19	Inward	564.44 (2) 556.22	Inward	(6) 555.58	NA	564.31 (2) 555.93	Inward	564.83 556.01	Inward
Outer Inner	River Middle MH8	564.18 (5) 559.77	Inward	564.56 561.02	Inward	564.32 561.06	Inward	564.46 560.47	Inward	564.08 560.78	Inward	564.71 560.89	Inward
Outer Inner	River South MH12	564.30 561.57	Inward	564.81 561.81	Inward	564.69 561.92	Inward	564.79 562.05	Inward	564.56 562.11	Inward	565.15 562.26	Inward

Date Monitored	Monitoring Location	5/27/2005		6/24/2005		7/29/2005		8/31/2005		10/3/2005		10/31/2005	
		Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction
Outer Inner	River North MH2	564.78 560.23	Inward	564.73 561.50	Inward	564.82 562.70	Inward	564.63(2) 561.62	Inward	564.80 561.52	Inward	564.80 561.68	Inward
Outer Inner	River North MH6	564.78 555.82	Inward	564.73 555.16	Inward	564.82 556.56	Inward	564.63(2) 556.24	Inward	564.80 555.41	Inward	564.80 555.60	Inward
Outer Inner	River Middle MH8	564.74 560.65	Inward	564.70 559.92	Inward	564.85 561.39	Inward	564.54 561.07	Inward	564.75 560.20	Inward	564.55 560.46	Inward
Outer Inner	River South MH12	565.02 562.29	Inward	564.92 562.40	Inward	565.15 562.51	Inward	564.88 562.75	Inward	565.11 562.90	Inward	565.00 563.15	Inward

Notes:

- (1) Water level monitored on 9/14/01 was 563.87 ft amsl which provided an inward gradient.
 - (2) River level too low to obtain a measurement at the monitoring location. Water level shown is River South Water level minus 0.25 feet.
 - (3) Valves in MH6 were opened on November 18, 2002.
 - (4) Snow covered well, could not locate.
- NM - Not Measured
NA - Not Applicable

TABLE 2.3
SUMMARY OF HORIZONTAL GRADIENTS
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

Date Monitored		11/22/2005		12/23/2005		01/27/2006		02/28/2006		03/24/2006		04/21/2006	
Monitoring Location		Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction
Outer Inner	River North MH2	563.93 (2) 561.62	Inward	564.01 (2) 562.55	Inward	564.11 (2) 562.95	Inward	564.04 (2) 563.17	Inward	564.19 (2) 562.68	Inward	564.39 (2) 562.31	Inward
Outer Inner	River North MH6	563.93 (2) 555.20	Inward	564.01 (2) 556.20	Inward	564.11 (2) 556.21	Inward	564.04 (2) 554.70	Inward	564.19 (2) 555.64	Inward	564.39 (2) 555.61	Inward
Outer Inner	River Middle MH8	564.05 (5) 560.64	Inward	564.13 (5) 561.05	Inward	564.23 (5) 561.02	Inward	564.16 (5) 558.44	Inward	564.31 (5) 560.43	Inward	564.26 560.40	Inward
Outer Inner	River South MH12	564.18 563.29	Inward	564.26 563.46	Inward	564.36 563.61	Inward	564.29 563.73	Inward	564.44 563.47	Inward	564.64 563.49	Inward
Monitoring Location		05/30/2006											
Outer Inner	River North MH2	564.87 562.73	Inward										
Outer Inner	River North MH6	564.87 555.84	Inward										
Outer Inner	River Middle MH8	564.86 560.44	Inward										
Outer Inner	River South MH12	565.24 563.61	Inward										

Notes:

- (1) Water level monitored on 9/14/01 was 563.87 ft amsl which provided an inward gradient.
 - (2) River level too low to obtain a measurement at the monitoring location. Water level shown is River South Water level minus 0.25 feet.
 - (3) Valves in MH6 were opened on November 18, 2002.
 - (4) Snow covered well, could not locate.
 - (5) River level too low to obtain a measurement. Water level shown is River South water level minus 0.13 feet.
- NM - Not Measured
NA - Not Applicable

**SUMMARY OF VERTICAL GRADIENTS
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK**

[illegible]

NM - Not monitored. MH11 was blocked and could not be accessed.
(1) - Distance weighted for MH14 (two thirds) and MH15 (one third).

TABLE 2.4
SUMMARY OF VERTICAL GRADIENTS
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

Date Monitored	Monitoring Location	6/20/2002		7/18/2002		8/6/2002		9/12/02		10/30/02		11/21/02		12/11/02	
		Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction
	Upper														
	Lower														
	MH3	561.24	Upward	560.99	Upward	560.79	Upward	561.14	Upward	561.21	Upward	560.67	Upward	561.08	Upward
	MW-6	561.92		561.89		561.92		561.82		561.97		562.05		562.04	
	Upper														
	Lower														
	MH8	560.68	Upward	560.79	Upward	561.05	Upward	561.10	Upward	561.07	Upward	558.03	Upward	559.95	Upward
	MW-7	561.54		561.65		561.93		561.99		561.95		561.41		561.25	
	Upper														
	Lower														
	MH11	560.98	Upward	561.07	Upward	561.33	Upward	561.34	Upward	561.36	Upward	561.49	Downward	561.51	Downward
	MW-8	561.50		561.60		561.88		561.91		561.95		560.99		560.73	
	Upper														
	Lower														
	MH14	562.98	Downward	561.83	Upward	562.08	Upward	562.11	Upward	562.68	Downward	562.88	Downward	563.07	Downward
	MW-9	562.91		562.84		562.75		562.66		562.57		562.74		562.91	
	Upper														
	Average ⁽¹⁾	562.00	Upward	561.93	Upward	561.86	Upward	561.75	Upward	561.62	Upward	561.82	Upward	562.01	Upward
		562.65	Upward	561.86	Upward	562.01	Upward	561.99	Upward	562.33	Upward	562.53	Upward	562.72	Upward

Notes:

NM - Not monitored. MH11 was blocked and could not be accessed.
(1) - Distance weighted for MH14 (two thirds) and MH15 (one third).

TABLE 2.4
SUMMARY OF VERTICAL GRADIENTS
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

Date Monitored	1/16/2003	2/25/2003	3/14/03	4/14/03	5/8/03	6/19/03
Monitoring Location	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction
MH3 Upper	561.20	Upward	561.17	Upward	561.03	Upward
MW-6 Lower	562.27	Upward	561.69	Upward	562.38	Upward
MH8 Upper	561.04	Upward	560.61	Upward	560.76	Upward
MW-7 Lower	561.95	Upward	561.49	Upward	561.59	Upward
MH11 Upper	561.68	Upward	561.57	Downward	561.03	Upward
MW-8 Lower	562.00	Upward	561.46	Downward	561.56	Upward
MH14 Upper	563.37	Downward	563.09	Downward	563.26	Downward
MW-9 Lower	563.17	Downward	562.90	Downward	563.07	Downward
MH15 Upper	562.28	Upward	562.05	Upward	561.02	Upward
Average ⁽¹⁾	563.01	Upward	562.74	Upward	562.84	Upward
Date Monitored	7/21/03	8/28/03	9/30/03	10/20/03	11/03/03	12/23/03
Monitoring Location	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction
MH3 Upper	560.46	Upward	561.10	Upward	561.08	Upward
MW-6 Lower	562.31	Upward	562.53	Upward	562.33	Upward
MH8 Upper	560.89	Upward	559.88	Upward	560.76	Upward
MW-7 Lower	561.74	Upward	561.35	Upward	561.12	Upward
MH11 Upper	561.10	Upward	564.37	Downward	561.01	Upward
MW-8 Lower	561.69	Upward	562.35	Downward	561.57	Upward
MH14 Upper	563.03	Downward	566.48	Downward	563.00	Downward
MW-9 Lower	562.89	Downward	566.17	Downward	562.85	Downward
MH15 Upper	561.98	Upward	566.36	Downward	561.91	Upward
Average ⁽¹⁾	562.68	Upward	566.44	Downward	562.64	Upward

Notes:

NM - Not monitored. MH11 was blocked and could not be accessed.
(1) - Distance weighted for MH14 (two thirds) and MH15 (one third).

TABLE 2.4
SUMMARY OF VERTICAL GRADIENTS
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

Date Monitored	01/21/04	02/12/04	03/04/04	04/16/04	05/14/04	06/25/04
Monitoring Location	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction
Upper MH3	560.33	Upward	561.08	Upward	558.78	Upward
Lower MW-6	562.32	Upward	562.16	Upward	562.48	Upward
Upper MH8	560.70	Upward	560.95	Upward	559.59	Upward
Lower MW-7	561.55	Upward	561.81	Upward	561.71	Upward
Upper MH11	(2)	N/A	561.23	Upward	559.85	Upward
Lower MW-8	561.47	Upward	561.75	Upward	561.38	Upward
Average ⁽¹⁾ Lower MW-9	(2)	N/A	(2)	Upward	562.43	Upward
	562.72		562.68	562.70	562.64	562.71
Date Monitored	07/30/04	08/31/04	09/30/04	10/20/04	11/23/04	12/31/04
Monitoring Location	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction
Upper MH3	561.25	Upward	560.59	Upward	561.19	Upward
Lower MW-6	562.29	Upward	562.23	Upward	562.10	Upward
Upper MH8	560.04	Upward	560.67	Upward	560.82	Upward
Lower MW-7	561.31	Upward	561.56	Upward	561.19	Upward
Upper MH11	560.26	Upward	560.94	Upward	561.09	Upward
Lower MW-8	560.71	Upward	561.39	Upward	561.56	Upward
Average ⁽¹⁾ Lower MW-9	561.33	Upward	562.73	Upward	562.46	Upward
	562.70		562.95	562.67	562.64	562.71

Notes:

NA - Not Applicable.
 NM - Not monitored. MH11 was blocked and could not be accessed.
 (1) - Distance weighted for MH14 (two thirds) and MH15 (one third).
 (2) - Buried with snow.

TABLE 2.4

SUMMARY OF VERTICAL GRADIENTS
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

Date Monitored	Monitoring Location	1/28/2005		2/28/2005		3/31/2005		4/29/2005		5/27/2005		6/24/2005	
		Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction
Upper	MH3	562.15	Upward	559.96	Upward	559.94	Upward	559.54	Upward	558.92	Upward	561.09	Upward
	Lower	562.27		562.14		562.04		562.26		562.24		562.22	
Upper	MH8	561.06	Upward	560.47	Upward	560.78	Upward	560.89	Upward	560.65	Upward	559.92	Upward
	Lower	561.85		561.46		561.66		561.76		561.55		561.47	
Upper	MH11	561.33	Upward	560.74	Upward	561.06	Upward	561.15	Upward	561.13	Upward	560.18	Upward
	Lower	561.82		561.25		561.60		561.65		561.42		560.76	
Average ⁽¹⁾		(3)	NA	(3)	NA	562.91	Upward	562.57	Upward	562.90	Upward	562.59	Upward
	Lower	562.75		562.78		563.12		563.21		563.12		562.85	
Date Monitored	Monitoring Location	7/29/2005		8/31/2005		10/3/2005		10/31/2005		11/22/2005		12/23/2005	
		Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction	Water Level (ft amsl)	Gradient Direction
Upper	MH3	562.26	Downward	560.64	Upward	560.54	Upward	560.73	Upward	561.20	Upward	562.09	Upward
	Lower	562.11		562.09		562.24		562.34		561.67		562.45	
Upper	MH8	561.39	Upward	561.07	Upward	560.20	Upward	560.46	Upward	560.04	Upward	561.05	Upward
	Lower	562.27		561.94		561.40		561.52		561.49		561.85	
Upper	MH11	561.17	Upward	561.31	Upward	560.43	Upward	560.71	Upward	560.31	Upward	561.30	Upward
	Lower	562.15		561.85		560.95		561.25		561.00		561.84	
Average ⁽¹⁾		562.68	Upward	562.67	Upward	562.92	Upward	563.14	Upward	563.33	Upward	563.31	Upward
	Lower	562.88		562.91		563.20		563.39		563.53		563.50	

Notes:

NA - Not Applicable.

NM - Not monitored. MH11 was blocked and could not be accessed.

(1) - Distance weighted for MH14 (two thirds) and MH15 (one third).

(2) - Buried with snow.

(3) - Not Monitored - MH14 was buried with snow and could not be accessed.

TABLE 2.4

SUMMARY OF VERTICAL GRADIENTS
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

Date Monitored	Monitoring Location	01/27/2006		02/28/2006		03/24/2006		04/21/2006		05/30/2006	
		Water Level	Gradient	Water Level	Gradient	Water Level	Gradient	Water Level	Gradient	Water Level	Gradient
		(ft amsl)	Direction	(ft amsl)	Direction	(ft amsl)	Direction	(ft amsl)	Direction	(ft amsl)	Direction
	MH3	562.53	Upward	562.26	Upward	561.77	Upward	561.84	Upward	562.30	Upward
	MW-6	562.97		562.90		562.86		562.76		562.50	
	MH8	561.02	Upward	558.44	Upward	560.43	Upward	560.40	Upward	560.44	Upward
	MW-7	561.79		561.68		561.57		561.48		561.75	
	MH11	561.26	Upward	558.38	Upward	560.60	Upward	560.63	Upward	560.28	Upward
	MW-8	561.76		561.23		561.16		561.15		561.03	
	Average ⁽¹⁾	563.73	Upward	563.73	Upward	563.67	Upward	563.41	Upward	563.20	Upward
	Lower	563.90		563.94		563.83		563.65		563.48	

Notes:

NA - Not Applicable.

NM - Not monitored. MH11 was blocked and could not be accessed.

(1) - Distance weighted for MH14 (two thirds) and MH15 (one third).

(2) - Buried with snow.

(3) - Not Monitored - MH14 was buried with snow and could not be accessed.

TABLE 2.5

GROUNDWATER SAMPLING SUMMARY
OPERATION AND MAINTENANCE MANUAL
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

LOCATIONS

OGC1	MW-6
OGC2	MW-7
OGC3	MW-8
OGC4	MW-9
OGC5	OGC6
OGC7	OGC8

FREQUENCY

- quarterly for 2 years following GWS startup.
- semi-annually for Year 3 except for OGC-4 (quarterly for SVOCs) and OGC-6 (quarterly for VOCs).
- annually for Years 4 through 7 except OGC-4 (semi-annual for SVOCs) and OGC-6 (semi-annual for VOCs) (review after Year 7)

PARAMETERS

Volatiles

Acetone	Methylene Chloride
Benzene	Tetrachloroethene
2-Butanone	Toluene
Chlorobenzene	Trichloroethene
1,1-Dichloroethane	Vinyl Chloride
trans-1,2-Dichloroethene	Xylenes (Total)
Ethylbenzene	

Semi-Volatiles

1,2-Dichlorobenzene	4-Methylphenol
1,4-Dichlorobenzene	Naphthalene
2,4-Dimethylphenol	Di-n-octylphthalate
2-Methylphenol	Phenol

TABLE 2.6

SUMMARY OF DETECTED COMPOUNDS
SITE GROUNDWATER AND RIVER WATER
GRATWICK-RIVERSIDE PARK
NORTH TONAWANDA, NEW YORK

Location Date		MW-9													
Class GA Level		05/18/01	08/20/01	11/27/01	02/11/02	05/21/02	08/06/02	11/22/02	02/25/03	05/08/03	11/04/03	05/14/04	05/27/05	05/30/06	
Volatiles (µg/L)															
	Acetone	9.4j	4.3j	7.3j/6.7j		4.2j	7.0/7.2			13/12			17	17	
	Benzene		0.24j	0.39j/0.35j		0.44j	0.29j/0.30j	0.29j/0.29j		0.40j/ND0.70				0.54j	
	2-Butanone													2.6j	
	Chlorobenzene		0.50j	0.86j/0.85j		1.3		1.0/1.1		0.91j/0.87j		1.1	1.7	1.5	
	trans-1,2-Trichloroethene			0.22j/ND		0.31j	0.24j/0.24j	0.22j/0.20j						0.42j	
	Ethylbenzene		0.30j	0.46j/0.42j		0.73j	0.44j/0.42j	0.46j/0.46j		0.40j/0.38j				0.83j	
	Methylene Chloride		0.34j	0.33j/ND	4.0j	0.53j					7.2		1.6		
	Tetrachloroethene	1.6j	1.1j	1.0j/0.92j		1.6	0.92j/0.80j	0.77j/0.74j		0.67j/0.71j				0.57j	
	Toluene		1.6j	3.0j/2.5j	2.8j	2.7	2.1/2.0	2.7/2.7	2.0	2.0/1.9	4.6	3.2	2.6		
	Trichloroethene	2.2j	1.8j	2.4j/2.2j	3.0j	4.4	2.0/2.0	2.2/2.3		1.8/1.8	9.5	4.9	3.0	1.8	
	Vinyl Chloride									1.7/1.7			3.6	4.0	
	Total Xylenes		1.0j	1.5j/1.5j		2.5j	1.3j/1.3j	1.4j/1.4j		0.98j/1.0j	3.0			2.0j	
	Semi-Volatiles (µg/L)														
	1,2-Dichlorobenzene	3*			0.6j										
	1,4-Dichlorobenzene	3*											2j		
	2,4-Dimethylphenol	50	12	12	18/17	38		20/22	30/34	30	35/36	36	42	50	58
	2-Methylphenol	NL	1j	3j	3j/3j	7j		4j/4j	6j/6j	6j	6j/6j	6j	5j	8j	8j
	4-Methylphenol	NL	69	110	97/92	230		100/110	190/230	150	130/130	160	190	260	190
	Naphthalene	10													
	Di-n-octyl phthalate	50													
Phenol	1	3j	34	28/22	24		38/41	34/35	42	46/46	180	30	27	49	

Notes:

* Applies to sum of compounds

NL - Not listed

Exceeds Class GA Level

NS - Not Sampled

TABLE 2.6

SUMMARY OF DETECTED COMPOUNDS
SITE GROUNDWATER AND RIVER WATER
GRATWICK-RIVERSIDE PARK
NORTH TONAWANDA, NEW YORK

Location Date	Class GA Level	OGC-4												
		05/18/01	08/20/01	11/27/01	02/11/02	05/21/02	08/06/02	11/22/02	02/25/03	05/08/03	11/04/03	05/14/04	11/23/04	05/27/05
Volatiles (µg/L)														
Acetone	50			7.9J			4.0J							
Benzene	1		0.21J	0.2J										
2-Butanone	50													
Chlorobenzene	5		0.49J	0.66J		0.83J/0.79J		0.46J		0.83J				
trans-1,2-Trichloroethene	5			0.22J										
Ethylbenzene	5		0.41J	0.39J		0.54J/0.53J	0.48J	0.39J		0.77J				0.44J
Methylene Chloride	5				5.1J/4.9J							4.6		2.0
Tetrachloroethene	5	1.0J	1.2J	0.87J		0.86J/0.84J	1.1	0.78J		0.77J				
Toluene	5			1.0J		1.0/0.98J	1.4	0.72J		1.2				
Trichloroethene	5	1.6J	1.4J	1.5J		1.5/1.4	1.7	0.96J		1.5				0.53J
Vinyl Chloride	2													
Total Xylenes	5		1.0J	0.94J		0.84J/0.82J	1.1J			0.95J				
Semi-Volatiles (µg/L)														
1,2-Dichlorobenzene	3*													
1,4-Dichlorobenzene	3*													
2,4-Dimethylphenol	50		12	6J	8J/6J	7J/7J	8J		7J/7J	8J	4J	6J	4J	
2-Methylphenol	NL	0.9J	2J	35	2J/ND	1J/2J	2J			3J	2J	3J	2J	
4-Methylphenol	NL	64	86	40	58/55	61/67	68		69/68	73	32	55	31	15
Naphthalene	10													
Di-n-octyl phthalate	50													
Phenol	1	310	560	400	420/460	710/1100	1100	1100	2400/2300	1800	2400	1500	850	510

Notes:

* Applies to sum of compounds

NL - Not listed

 Exceeds Class GA Level

NS - Not Sampled

TABLE 2.6

SUMMARY OF DETECTED COMPOUNDS
SITE GROUNDWATER AND RIVER WATER
GRATWICK-RIVERSIDE PARK
NORTH TONAWANDA, NEW YORK

Location Date		OGC-8												
		05/18/01	08/20/01	11/27/01	02/11/02	05/21/02	08/06/02	11/22/02	02/25/03	05/08/03	05/08/03	05/14/04	05/27/05	05/30/06
Class GA Level														
Volatiles (µg/L)														
Acetone	50	78	31/29	19J		4.7J	3.6J				6.2	5.8	4.7J	
Benzene	1	11	14/14	14		2.6	5.3	3.3	3.6	3.1	1.8	1.2	1.1	0.92
2-Butanone	50	4.0J												
Chlorobenzene	5	3.7J	4.1J/4.1J	4.0J		0.87J	1.7	1.1		1.1	0.65J	0.48J	0.43J	0.44J
trans-1,2-Trichloroethene	5	4.3J	3.2J/3.1J	4.0J		0.76J	1.5	0.88J		1.0	0.50J	0.41J	1.0	
Ethylbenzene	5	13	16/16	15	1.6J	2.8	5.8	3.1	3.9	3.1	1.8	1.2		0.99J
Methylene Chloride	5		0.52J/0.48J	0.62J	1.8J									
Tetrachloroethene	5	40	51/52	59	7.7J	9.9	22	12	14	11	7.0	5.0	3.8	4.0
Toluene	5	140	140/140	110	17J	21	53	28	38	27	16	11	8.1	8.3
Trichloroethene	5	120	110/110	110	20J	22	53	27	35	27	17		7.7	7.6
Vinyl Chloride	2	3.7J	3.4/3.6	3.1	1.1J		1.4	0.70J		0.78J				
Total Xylenes	5	43	55/54	46	4.8J	8.3	18	9.5	11	9.9	5.4	3.7	3.0	3.2
Semi-Volatiles (µg/L)														
1,2-Dichlorobenzene	3*													
1,4-Dichlorobenzene	3*													
2,4-Dimethylphenol	50	2J	4J/2J	4J	0.8J	0.8J	3J	1J						
2-Methylphenol	NL	18	30/25	16	4J	5J	13	7J	11	7J	4J	2J	2J	3J
4-Methylphenol	NL	30	51/45	28	8J	10	26	14	20	14J	9	5J	6J	8J
Naphthalene	10	1J	3J/25	1J			0.9J							
Di-n-octyl phthalate	50		0.1J/ND											
Phenol	1	30	49/44	31	5J	8J	11	10		4J	6J	2J		

Notes:

* Applies to sum of compounds

NL - Not listed

Exceeds Class GA Level

NS - Not Sampled

TABLE 2.6

SUMMARY OF DETECTED COMPOUNDS
SITE GROUNDWATER AND RIVER WATER
GRATWICK-RIVERSIDE PARK
NORTH TONAWANDA, NEW YORK

Location Date	Class GA Level	River South												
		05/18/01	09/17/01	11/27/01	02/11/02	05/21/02	08/06/02	11/22/02	02/25/03	05/08/03	11/04/03	05/14/04	05/27/05	05/30/06
Volatiles (µg/L)														
Acetone	50						3.0J				0.42J		3.2J	
Benzene	1													
2-Butanone	50												3.9J	
Chlorobenzene	5													
trans-1,2-Trichloroethene	5													
Ethylbenzene	5													
Methylene Chloride	5													
Tetrachloroethene	5						0.30J							
Toluene	5			0.29J			0.72J	0.35J			1.8			
Trichloroethene	5						0.44J							
Vinyl Chloride	2						0.27J							
Total Xylenes	5									1.8J				
Semi-Volatiles (µg/L)														
1,2-Dichlorobenzene	3*													
1,4-Dichlorobenzene	3*													
2,4-Dimethylphenol	50													
2-Methylphenol	NL													
4-Methylphenol	NL													
Naphthalene	10													
Di-n-octyl phthalate	50													
Phenol	1													

Notes:

* Applies to sum of compounds

NL - Not listed

☐ Exceeds Class GA Level

NS - Not Sampled

TABLE 2.6

SUMMARY OF DETECTED COMPOUNDS
SITE GROUNDWATER AND RIVER WATER
GRATWICK-RIVERSIDE PARK
NORTH TONAWANDA, NEW YORK

Location Date	MW-8													
Class GA Level	05/18/01	08/20/01	11/27/01	02/11/02	05/21/02	08/06/02	11/22/02	02/25/03	05/08/03	11/04/03	05/14/04	05/27/05	05/30/06	
Volatiles (µg/L)														
50	52	12J	11J	75J	67	20	12	8.1	73	23/24	28/33	26	16	
1	6.5	4.3	4.1		8.6	12			12		10/12	4.2	4.4	
50														
2-Butanone														
Chlorobenzene	1.8J	1.0J	1.0J		3.2	4.9	4.4	3.6	6.2	6.0/6.4	2.7/3.3	2.4	2.4	
trans-1,2-Trichloroethene	2.2J	1.8J	2.9J	4.8J	7.3	11	16	12	13	10/12	7.3/9.4	7.4	5.3	
Ethylbenzene	5.7	3.7J	4.4J	8.2J	12	18	18	15	23	30/32	20/24	4.6	5.8	
Methylene Chloride	1.1J	0.58J	0.66J	4.4J	1.2	1.4	1.6		1.3	2.2/2.2	7.3/9.2	1.7	0.64J	
Tetrachloroethene	21	12	9.8	23J	32	61	58	54	80	91/100	120/130	62	71	
Toluene	75	36	31	80	100	140	160	100	120	240/240	97/120	30	33	
Trichloroethene	82	40	35	110	180	320	280	210	320	460/460	380/390	180	150	
Vinyl Chloride	5.2	1.6J	3.3	23	12	18	14	12	18	21/21	13/16	5.8	5.1	
Total Xylenes	22	13	16	30J	40	68	69	58	93	120/120	92/110	32	25	
Semi-Volatiles (µg/L)														
1,2-Dichlorobenzene				2J	2J		2J		4J	3J/3J				
1,4-Dichlorobenzene			0.6J	2J	1J	1J	2J		4J	3J/3J	19U/2J	4J	5J	
2,4-Dimethylphenol	50	1J	16	19	18	15	27	20	27	37/38	15J/14	7J	6J	
2-Methylphenol	NL	33	41	48	44	38	56	37	35	45/46	18J/18	18J	16	
4-Methylphenol	NL	10	34	55	60	59	83	64	75	130/130	34/31			
Naphthalene	10			0.7J	0.8J	0.8J	1J			2J/2J				
Di-n-octyl phthalate	50													
Phenol	1	43	140	85	110	91	110	140	78	80/80	28/28	11J	4J	

Notes:

* Applies to sum of compounds

NL - Not listed

Exceeds Class GA Level

NS - Not Sampled

TABLE 2.6

SUMMARY OF DETECTED COMPOUNDS
SITE GROUNDWATER AND RIVER WATER
GRATWICK-RIVERSIDE PARK
NORTH TONAWANDA, NEW YORK

Location Date	Class G/A Level	Volatiles (µg/L)	OGC-3											
			05/18/01	08/20/01	11/27/01	02/11/02	05/21/02	08/06/02	11/22/02	02/25/03	05/08/03	11/04/03	05/14/04	05/27/05
Volatiles (µg/L)	50	13J / 19J	3.8J	15J	7.1	6.7	1.2	1.5	5.6	1.6	1.4	10/8.4	2.8J	
	1	1.6J / 1.6J	1.6	1.8								1.2/1.1	0.93J	
	50													
	5		0.24J	0.28J	0.28J			0.22J	1.0					
	5	1.6J / 1.6J	1.0J	1.4J	1.1J	0.98J		0.44J	2.0			1.4/1.3	1.1	
	5	1.6J / 1.5J	2.0J	2.3J	1.5J	2.4	1.7	1.8			6.3	1.2/1.0		
	5			1.9J										
	5	2.4J / 2.2J	3.0J	2.2J	1.7J	2.2	1.8	1.8	1.5			0.71J/0.63J	0.61J	
	5	5.7 / 5.1	5.9	5.3	5.1	3.7	4.6	4.0	4.3	2.6		2.6/2.4		
	5	20 / 20	18	19	14J	17	14	13	14	9.8	7.7	6.4/6.1	5.6	
Semi-Volatiles (µg/L)	2	ND / 1.0J	0.4	0.72					0.62J					
	5	5.6J / 5.4J	7.5	8.7	4.8J	7.8	5.8	5.8	5.0	3.9		3.3/3.0	2.9J	
	3*				1J									
	3*				0.7J		0.5J							
	50	5J / 5J	9	8J	11	11	7J	8J	11	12	10	8J/4J	6J	
Di-n-octyl phthalate Phenol	NL	98 / 96	120	87	160	140	100	100	120	140	150	110	83/73	64
	NL	13 / 13	21	17	28	23	14	15	22	23	20	17	14/12	13
	50													
	1	120 / 110	140	130J	210	140	85	92	110	120	120	90	78/74	75

Notes:

* Applies to sum of compounds

NL - Not listed

Exceeds Class GA Level

NS - Not Sampled

TABLE 2.6

SUMMARY OF DETECTED COMPOUNDS
SITE GROUNDWATER AND RIVER WATER
GRATWICK-RIVERSIDE PARK
NORTH TONAWANDA, NEW YORK

Location Date	Class GA Level	Volatiles (µg/L)	OGC-7															
			GW-55															
			12/17/87	08/12/88	05/18/01	08/20/01	11/27/01	02/11/02	05/21/02	08/06/02	11/22/02	02/25/03	05/08/03	11/04/03	05/14/04	05/27/05	05/30/06	
Volatiles (µg/L)	50	Acetone	293					8.2J										
	1	Benzene	2			21J	0.25J	0.30J		3.6J		0.28J	0.20J		0.34J		0.34J	
	50	2-Butanone	27															
	5	Chlorobenzene																
	5	trans-1,2-Trichloroethene	180				3.1J	5.4	4.9J	4.8J	4.2	4.7	4.0	4.4	5.0	5.9	4.9	5.8
	5	Ethylbenzene	9	71	1.1J	0.80J	1.0J		1.3	0.84J	0.91J			1.4	0.93J	1.5	1.4	1.3
	5	Methylene Chloride	1															
	5	Tetrachloroethene	11	71	4.3J	3.6J	3.4J	2.9J	4.0	3.4	2.7	2.8	4.1	2.2	4.1	2.9	2.9	2.8
	5	Toluene	75	49	12	5.8	6.7	5.7J	6.9	5.2	6.0	6.7	8.6	5.8	9.3	8.3	8.3	8.6
	5	Trichloroethene	287		70	40	48	45	68	44	38	50	56	38	56	371	371	37
	2	Vinyl Chloride	7	41	2.6J	0.84	1.7J	3.5J	2.2	1.8	1.8		2.3	2	2.9	3.0	3.0	2.9
	5	Total Xylenes	54	37	6.0J	4.8J	6.5	3.9J	7.6	5.3	5.3	5.5	8.7	5.4	10	8.6	8.6	8.2
Semi-Volatiles (µg/L)																		
3*	1,2-Dichlorobenzene		2J															
3*	1,4-Dichlorobenzene																	
50	2,4-Dimethylphenol	10	11		2J													
NL	2-Methylphenol	24	24		2J	1.0J	0.8J	1J										
NL	4-Methylphenol	38				0.9J	0.7J	1J										
10	Naphthalene																	
50	Di-n-octyl phthalate							0.6J										
1	Phenol	61	92	4J	0.7J													

Notes:

* Applies to sum of compounds

NL - Not listed

Exceeds Class GA Level

NS - Not Sampled

TABLE 2.6

SUMMARY OF DETECTED COMPOUNDS
SITE GROUNDWATER AND RIVER WATER
GRATWICK-RIVERSIDE PARK
NORTH TONAWANDA, NEW YORK

Location		River Middle												
Date		05/18/01	09/17/01	11/27/01	02/11/02	05/21/02	08/06/02	11/22/02	02/25/03	05/08/03	11/04/03	05/14/04	05/27/05	05/31/06
Volatiles (µg/L)	Class GA Level													
Acetone	50													
Benzene	1						3.1J							
2-Butanone	50													
Chlorobenzene	5													
trans-1,2-Trichloroethene	5													
Ethylbenzene	5													
Methylene Chloride	5													
Tetrachloroethene	5													
Toluene	5													
Trichloroethene	5							0.21J						
Vinyl Chloride	2													
Total Xylenes	5													
Semi-Volatiles (µg/L)														
1,2-Dichlorobenzene	3*													
1,4-Dichlorobenzene	3*													
2,4-Dimethylphenol	50													
2-Methylphenol	NL													
4-Methylphenol	NL													
Naphthalene	10													
Di-n-octyl phthalate	50													
Phenol	1				0.7J									

Notes:

* Applies to sum of compounds

NL - Not listed

 Exceeds Class GA Level

NS - Not Sampled

TABLE 2.6

SUMMARY OF DETECTED COMPOUNDS
SITE GROUNDWATER AND RIVER WATER
GRATWICK-RIVERSIDE PARK
NORTH TONAWANDA, NEW YORK

Location Date	Class GA Level	Volatiles (µg/L)	MW-7												
			05/18/01	08/20/01	11/27/01	02/11/02	05/21/02	08/06/02	11/22/02	02/25/03	05/08/03	11/04/03	05/14/04	05/27/05	05/31/06
Volatiles (µg/L)	50	5.7j			6.5j		4.3j	5.4			4.8			4.3j	3.0j
	1		1.9		2.0		2.0	1.3	1.8		0.90			0.58j	
	50														
	5														
	5		0.82j	1.1j		0.98j	0.89j		1					0.36j	
	5		0.85j	0.81j		1.0	0.61j	0.75j						0.32j	
	5				1.6j										
	5			0.27j											
	5		3.5j	3.6j		3.3	1.9	3		1.1	2.8		0.93j		
	5		0.55j	0.63j		0.43j	0.45j	0.36j							
	2		1.6j	2.0		3.8j	1.7	2.2		1.3			0.80j		
	5		2.1j	2.1j		2.7j	1.5j	1.9j		0.76j					
Semi-Volatiles (µg/L)															
Semi-Volatiles (µg/L)	3*														
	3*														
	50				2j	3j	0.7j	2j							
	NL		3j	2j	4j	6j	1j	2j			2j				
	NL		3j	2j	4j	6j	1j	2j			1j				
	10														
	50				0.6j										
	1		24	7j	10	26	2j	6j	5j	2j				1j	

Notes:

* Applies to sum of compounds

NL - Not listed

 Exceeds Class GA Level

NS - Not Sampled

TABLE 2.6

SUMMARY OF DETECTED COMPOUNDS
SITE GROUNDWATER AND RIVER WATER
GRATWICK-RIVERSIDE PARK
NORTH TONAWANDA, NEW YORK

Location Date	OGC-2													
	05/18/01	08/20/01	11/27/01	02/11/02	05/21/02	08/06/02	11/22/02	02/25/03	05/08/03	11/04/03	05/14/04	05/27/05	05/30/06	
Volatiles (µg/L)	Class GA													
	Level													
Acetone	50													
Benzene	1			11J										
2-Butanone	50					3.0J					4.5J		3.1	
Chlorobenzene	5													
trans-1,2-Trichloroethene	5													
Ethylbenzene	5													
Methylene Chloride	5			1.7J										
Tetrachloroethene	5													
Toluene	5									0.37J				
Trichloroethene	5		0.39J											
Vinyl Chloride	2			0.26J		0.25J								
Total Xylenes	5					0.26J								
Semi-Volatiles (µg/L)														
1,2-Dichlorobenzene	3*													
1,4-Dichlorobenzene	3*													
2,4-Dimethylphenol	50													
2-Methylphenol	NL													
4-Methylphenol	NL													
Naphthalene	10													
Di-n-octyl phthalate	50													
Phenol	1													

Notes:

* Applies to sum of compounds

NL - Not listed

 Exceeds Class GA Level

NS - Not Sampled

TABLE 2.6

SUMMARY OF DETECTED COMPOUNDS
SITE GROUNDWATER AND RIVER WATER
GRATWICK-RIVERSIDE PARK
NORTH TONAWANDA, NEW YORK

Location		OGC-6														
Date		05/18/01	08/20/01	11/27/01	02/11/02	05/21/02	08/06/02	11/22/02	02/25/03	05/08/03	11/04/03	03/04/04	05/14/04	11/23/04	05/27/05	05/31/06
Class GA																
Level																
Volatiles (µg/L)																
Acetone	50			6.6J			5.0			3.7J						8.6/8.7
Benzene	1									0.71	0.87	1.4		2.5	5.2	12/12
2-Butanone	50															
Chlorobenzene	5															
trans-1,2-Trichloroethene	5			0.23J	0.23J	0.37J	0.45J	0.55J		1.4	2.0	2.1		3.6	5.3	11/12
Ethylbenzene	5					0.31J				0.85J	1.1	2.0	3.3	3.1	7.4	20/20
Methylene Chloride	5				2.1J								4.4	2.5	2.2	
Tetrachloroethene	5		1.4J	0.73J			7.4	5	12	49	51	230	300	260	550	2000/2100
Toluene	5			0.55J			2.0	1.5	2.4	9.3	12	27	40	35	72	240/260
Trichloroethene	5	3.0J	4.7J	3.1J	5.9	16	19	13	26	95	120	330	530	330	610	1800/1800
Vinyl Chloride	2					0.22J	0.25J			0.45J						2.9/2.8
Total Xylenes	5		0.22J	0.53J	0.26J	1.7J	1.2J	1.0J		4.1	4.7	8.6	13	12	28	79/76
Semi-Volatiles (µg/L)																
1,2-Dichlorobenzene	3*															
1,4-Dichlorobenzene	3*															
2,4-Dimethylphenol	50															
2-Methylphenol	NL	2J		2J	5J	11	8J	9J	1J	22	27		63		85	89/110
4-Methylphenol	NL			1J	0.02J	10							1J		2J	84/100
Naphthalene	10															
Di-n-octyl phthalate	50															
Phenol	1	7J	2J	2J	4J	5J	3J	2J		5J	3J		9J		8J	13/16

Notes:

* Applies to sum of compounds

NL - Not listed

Exceeds Class GA Level

NS - Not Sampled

TABLE 2.6

SUMMARY OF DETECTED COMPOUNDS
SITE GROUNDWATER AND RIVER WATER
GRATWICK-RIVERSIDE PARK
NORTH TONAWANDA, NEW YORK

Location		River North												
Date		05/18/01	09/17/01	11/27/01	02/11/02	05/21/02	08/06/02	11/22/02	02/25/03	05/08/03	11/04/03	05/14/04	05/27/05	05/30/06
Volatiles (µg/L)	Class GA Level													
Acetone	50													
Benzene	1					0.21j	2.4j		NS		2.0	3.6j	3.6j	
2-Butanone	50											0.39j		
Chlorobenzene	5					1.3						3.2		
trans-1,2-Trichloroethene	5					0.25j						1.0		
Ethylbenzene	5					20						40		2.9
Methylene Chloride	5				1.6j									
Tetrachloroethene	5					3.8						7.7		1.3
Toluene	5			0.39j		63			0.96j			130	2.2	14
Trichloroethene	5			0.35j		4.5						6.4		0.59j
Vinyl Chloride	2					3.7						9.3		
Total Xylenes	5					80			0.96j			210	3.7	23
Semi-Volatiles (µg/L)														
1,2-Dichlorobenzene	3*													
1,4-Dichlorobenzene	3*													
2,4-Dimethylphenol	50							1j						
2-Methylphenol	NL													
4-Methylphenol	NL													
Naphthalene	10													
Di-n-octyl phthalate	50													
Phenol	1													

1j

Notes:

* Applies to sum of compounds

NL - Not listed

Exceeds Class GA Level

NS - Not Sampled

TABLE 2.6

SUMMARY OF DETECTED COMPOUNDS
SITE GROUNDWATER AND RIVER WATER
GRATWICK-RIVERSIDE PARK
NORTH TONAWANDA, NEW YORK

Location Date	OGC-5												
	05/20/01	08/21/01	11/27/01	02/11/02	05/21/02	08/06/02	11/22/02	02/25/03	05/08/03	11/04/03	05/14/04	05/27/05	05/30/06
Class GA													
Level													
Volatiles (µg/L)													
Acetone	38J		11J			6.4			4.9J		0.61J		3.0J
Benzene		1.5	1.4		0.87	0.92	0.87		0.77				0.67J
2-Butanone													
Chlorobenzene													
trans-1,2-Trichloroethene		0.65J	0.76J		0.42J	0.57J	0.52J				0.34J		
Ethylbenzene		0.21J	0.23J										
Methylene Chloride				3.4J								2.4	
Tetrachloroethene		0.38J	0.27J										
Toluene		2.5J	2.2J		0.99J	0.87J	1.2		0.80J		0.80J		
Trichloroethene		0.87J	0.66J		0.36J	0.41J	0.40J				0.28J		
Vinyl Chloride	2	1.6J	1.2J		1.1	1.5	1.2		1.1		1.4		1.2
Total Xylenes	5	1.0J	1.0J		0.67J	0.37J	0.40J				1.0J		
Semi-Volatiles (µg/L)													
1,2-Dichlorobenzene	3*												
1,4-Dichlorobenzene	3*												
2,4-Dimethylphenol	50		8J	6J	5J	1J	6J						
2-Methylphenol	NL		1J	1J	1J								
4-Methylphenol	NL		2J	5J	4J		2J						
Naphthalene	10		1J	1J		0.5J	1J						
Di-n-octyl phthalate	50			0.8J									
Phenol	1		0.9J										

Notes:

* Applies to sum of compounds

NL - Not listed

☐ Exceeds Class GA Level

NS - Not Sampled

TABLE 2.6

SUMMARY OF DETECTED COMPOUNDS
SITE GROUNDWATER AND RIVER WATER
GRATWICK-RIVERSIDE PARK
NORTH TONAWANDA, NEW YORK

Location Date	Class GA Level	GW-6S					MW-6									
		12/15/1987	08/10/88	05/18/01	08/21/01	11/27/01	02/11/02	05/21/02	08/06/02	11/22/02	02/25/03	05/08/03	11/04/03	05/14/04	05/27/05	05/30/06
Volatiles (µg/L)																
Acetone	50	684	4.9J		0.64J			0.65J	4.4J	0.59J	0.56J	44	6.7	13	31	
Benzene	1	3										0.57J				
2-Butanone	50															
Chlorobenzene	5		3.3J		1.5J	1.3J		0.65J		0.54J		0.81J	0.37J			
trans-1,2-Trichloroethene	5	58	4.4J		1.1J			0.37J	0.32J	0.34J		1.4	0.52J			
Ethylbenzene	5	2			0.21J											
Methylene Chloride	5						1.8J							2.1		
Tetrachloroethene	5	43			0.44J							0.67J	0.25J			
Toluene	5	16	3.0J		2.2J	0.29J		1.3	0.91J	1.1		2.1	0.92J			
Trichloroethene	5	62	5.1J		2.0J		1.2J	0.29J	1.1	1.5	3.2	14	3.6	12		
Vinyl Chloride	2	11	1.7J					0.29J	0.24J	0.22J		0.52J	3.7	1.5	1.2	
Total Xylenes	5	7			0.90J	0.44J		0.36J	0.27J							
Semi-Volatiles (µg/L)																
1,2-Dichlorobenzene	3*															
1,4-Dichlorobenzene	3*			1J		0.7J	2J						2J			
2,4-Dimethylphenol	50	5		5J	5J	3J	2J	1J	0.9J	9J			6J			
2-Methylphenol	NL	3		5J	6J	2J	2J	2J	1J	0.9J			5J			
4-Methylphenol	NL	4		15	13	5J	4J	3J	2J	2J			12		1J	
Naphthalene	10			67	69		1J		14	13			76	5J		
Di-n-octyl phthalate	50						2J									
Phenol	1	3		14	4J	2J	0.8J						250		2J	

Notes:

* Applies to sum of compounds

NL - Not listed

Exceeds Class GA Level

NS - Not Sampled

TABLE 2.6

SUMMARY OF DETECTED COMPOUNDS
SITE GROUNDWATER AND RIVER WATER
GRATWICK-RIVERSIDE PARK
NORTH TONAWANDA, NEW YORK

Location Date	Class GA Level	Volatiles (µg/L)	OGC-1													
			05/18/01	8/21/2001	11/27/01	02/11/02	05/21/02	08/06/02	11/22/02	02/25/03	05/08/03	11/04/03	05/14/04	05/27/05	05/31/06	
	50	Acetone	20J		11J			4.8J								
	1	Benzene		0.64J	0.55J				0.26J							
	50	2-Butanone	1.1J													
	5	Chlorobenzene	2.2J	2.0J	1.7J		0.24J		0.78J		0.91J					
	5	trans-1,2-Trichloroethene	5.6J	3.7J	4.6J	1.8J	0.48J	0.58J	2.7		2.8	0.85J			0.55J	
	5	Ethylbenzene		0.52J	0.43J				0.21J							
	5	Methylene Chloride				1.6J								1.8		
	5	Tetrachloroethene		0.78J	0.54J		0.42J	0.53J	0.30J			0.29J				
	5	Toluene	5.2J	5.4J	4.2J		0.48J	0.43J	1.9	1.7	2.6	0.59J				
	5	Trichloroethene	15J	16J	11J	4.5J		2.2	6.1J	5.1J	8.4J	2.2	0.47J	1.2	1.9	
	2	Vinyl Chloride	1.3J	0.51J	0.72J					0.42J	0.64J					
	5	Total Xylenes		2.1J	1.6J					0.49J	0.86J					
	Semi-Volatiles (µg/L)															
	3*	1,2-Dichlorobenzene			2J	1J			1J							
	3*	1,4-Dichlorobenzene	1J	3J	8J	3J		0.6J	9J		4J					
	50	2,4-Dimethylphenol	9J	16	5J	2J			2J		3J					
	NL	2-Methylphenol	6J	12	15J	5J		1J	5J	6J	8J					2J
	NL	4-Methylphenol	20	35		21J		7J	18J		25J	3J				
	10	Naphthalene	71J	130J												
	50	Di-n-octyl phthalate														
	1	Phenol	150J	290J	57J	15J	1J	8J	4J		19J					

Notes:

* Applies to sum of compounds

NL - Not listed

Exceeds Class GA Level

NS - Not Sampled

TABLE 2.7
PH READINGS
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

Monitoring Location	MH1	MH2	MH3	MW-6	OGC-1	MH4	OGC-5	MH5	MH6	OGC-6	MH7	MW-7	MH8	OGC-2	MH9
Date															
07/24/00					10.82	7.8					10.3				
10/24/00					*	7.7					10.5				
03/29/01				7.60						12.55		8.68		9.80	
05/11/01	*	*	*	*	11.14	*		8.30	8.17	8.50	10.16	8.90	11.22	9.22	11.26
05/18/01				11.05					10.00	10.50		8.19		8.70	
06/08/01	9.25								6.90	8.24		7.33		8.40	
06/15/01		10.1	10.38	9.6	9.6				6.91	8.22		7.43	10.65	8.46	
06/22/01		*	*	*	*										
06/29/01		10.9	10.8	11	10.9				7	8.97		9.27	11.33	8.63	
07/31/01		10.82	10.81	10.97	11.25				7.92	8.55		9.2	11.28	9.35	
08/20/01		11	11	9.86	10.95				7.9	8.31		7.71	11.45	8.49	
09/28/01		10.75	10.97	9.89	11.01				7.93	8.3		9.0	11.15	8.75	
10/22/01		10.7	10.45	10.5	11				6.1	9.32		8.97	8.49	8.87	
11/27/01		10.61	10.46	10.12	11.65					10.54		10.01	8.61	8.63	
12/20/01		10.17	10.11	9.97	11.22				9.98	10.37		9.68	8.42	8.51	
01/29/02		11.8	11.62	11.15	11.82				9.91	10.86		10.56	11.91	10.23	
02/11/02		10.26	10.16	10.5	10.4				7.79	11.44		10.04	11.74	8.33	
03/25/02		10.62	10.45	11.22	10.69				9.94	11.4		10.03	12.21	9.65	
04/24/02		10.37	10.22	10.68	11.36				9.46	11.15		9.73	11.3	9.52	
05/21/02		9.96	9.81	10.76	10.42				9.25	11.91		9.38	9.69	9.2	
06/20/02		10.64	9.4	10.91	11.19				9.46	11.4		10.59	11.76	9.46	
07/18/02		10.89	10.69	10.87	11.75				9.32	11.24		10.24	11.76	9.51	
08/06/02		10.62	10.47	8.21	5.67				8.79	8.78		7.46	11.24	7.83	
09/12/02		10.92	11.23	11.17	11.85				9.27	11.29		10.26	11.9	9.51	
10/30/02		10.1	11.22	10.74	10.89				9.82	10.63		9.95	11.97	9.64	
11/21/02		9.06	9.3	10.09	11.89				9.17	12.42		9.76	9.31	9.6	
12/11/02		8.92	9.17	10.16	11.03				9.02	10.39		10.19	9.5	9.18	
01/16/03		10.9	11.76	11.02	11.59				10.01	11.52		11.01	12.37	9.83	
02/25/03		10.72	11.12	10.51	11.81				9.87	12.31		9.42	9.32	8.92	
03/14/03		11.77	11.92	10.07	11.93				9.71	11.92		10.19	9.28	9.44	
04/14/03		9.78	9.71	9.67	10.82				9.21	10.45		9.74	10.48	9.01	
05/08/03		10.32	10.48	10.43	12.35				9.72	12.41		10.88	10.61	9.00	
06/19/03		10.21	10.39	10.36	12.31				9.68	12.29		10.75	10.51	8.99	
07/21/03		10.06	10.21	10.25	12.17				9.57	11.99		10.64	10.49	8.84	
08/28/03		10.22	10.91	10.32	11.16				10.17	10.96		11.04	10.38	9.89	
09/30/03		9.32	9.4	9.95	10.91				NM	10.22		9.35	9.42	9.58	
10/20/03		9.22	9.3	9	10				10.2	10.25		9.8	10	9.2	
11/03/03		9.15	9.14	8.86	9.49				10.51	10.54		10.41	10.28	9.03	
12/23/03		10.03	9.03	9.7	10.3				10.07	10.49		10.38	10.63	8.62	
05/30/06		9.78	10.44	7.50	10.62				7.10	10.85		9.46	8.98	8.45	

TABLE 2.7

PH READINGS
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

Monitoring Location	MH1	MH2	MH3	MW-6	OGC-1	MH4	OGC-5	MH5	MH6	OGC-6	MH7	MW-7	MH8	OGC-2	MH9
Date															
01/21/04		(1)	9.06	9.01	9.56		8.0		10.31	9.84		9.69	10.6	8.8	
02/12/04	8.45	(1)	9.72	13.24	11.02	7.77	8.75		7.65	10.8		10.32	11.23	9.2	
03/04/04	8.21	10.05	8.93	10.28	10.69		8.82		9.43	10.52		10.28	10.87	9.24	
04/16/04		9.52	8.77	10.16	9.28		8.61		9.2	10.96		10.41	11.18	9.12	
05/14/04		10.5	8.08	10.16	9.47		8.74		7.19	11.69	9.49	9.36	11.00	9.09	
06/25/04		10.22	8.66	10.07	9.98		8.46		8.41	10.89		9.82	10.65	9.1	
07/30/04		10.03	9.00	9.91	10.45		8.41		8.42	10.67		9.31	10.51	8.94	
08/31/04		9.89	8.7	9.69	10.0		8.17		7.58	10.36		8.97	10.65	8.85	
09/30/04		10.01	8.77	9.9	9.8		8.4		8.11	10.13		9.2	10.47	8.6	
10/20/04		9.91	7.95	9.8	9.28		8.18		8.46			9.89	9.95	8.84	
11/23/04		9.26	8.47	9.87	9.83		8.32		8.92	10.89		9.8	10.84	8.96	
12/31/04		10.13	8.82	9.42	9.26		8.44		10.31	10.04		9.79	9.57	8.73	
01/28/05		10.21	10.75	9.25	8.91		8.39		8.86	10.6		9.66	9.05	9.1	
02/28/05		10.66	9.5	9.09	9.17		8.54		10.89	10.61		9.11	10.8	6.8	
03/31/05		10.91	8.96	9.78	8.95		8.51		9.06	10.99		9.58	11.06	9.18	
04/29/05		10.74	8.92	9.90	9.59		8.74		8.72	11.26		9.62	10.29	9.56	
05/27/05		11.29	9.88	7.85	10.26		9.18		8.12	11.3		9.38	11.16	9.78	
06/24/05		10.72	10.51	10.22	10.2		8.69		8.01	11.48		9.38	11.34	9.31	
07/29/05		7.3	6.20	8.96	9.23		7.83		8.29	9.9		8.91	10.32	8.55	
08/31/05		9.76	7.64	9.35	9.47		8.23		8.5	10.4		8.67	10.68	9.24	
10/03/05		9.1	8.45	9.52	9.14		8.12		7.26	10.43		7.89	9.23	8.9	
10/31/05		10.01	8.59	9.37	8.89		8.47		9.24	10.14		8.63	11.13	9.06	
11/22/05		10.29	8.15	9.13	8.68		8.05		8.25	10.18		8.79	10.70	8.71	
12/23/05		9.24	11.09	10.15	10.11		10.84		9.37	10.84		10.43	9.46	9.23	
01/27/06		9.38	10.69	10.75	9.27		8.63		8.29	11.10		10.05	8.62	9.46	
02/28/06		9.94	11.28	10.49	9.63		8.9		9.56	10.96		9.96	9.56	9.85	
03/24/06		9.57	8.84	10.64	9.43		8.70		9.43	11.14		9.70	9.28	9.40	
04/21/06		11.13	11.03	10.65	9.6		8.91		10.67	11.03		9.44	10.44	9.33	
05/30/06		9.78	10.44	7.50	10.62		8.02		7.10	10.85		9.46	8.98	8.45	

TABLE 2.7

PH READINGS
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

Monitoring Location	MH10	OGC-7	MH11	MW-8	OGC-3	MH12	MH13	OGC-8	MH14	MW-9	OGC-4	MH15	MH16	MH17
Date														
07/24/00	9.2		8.38	6.41	9.41		10.6		9.5	8.17	10.41		7.4	
10/24/00				11.55	11.59	8.25		9.77	7.76	7.37	11.16		8.15	
03/29/01	10.9	8.37		11.21	11.21	8.25	7.5	11.58		10.60	11.32	11.21	8.83	9.27
05/18/01		10.93		10.1	10.34	6.99		11.4		10.03	10.44		12.27	
06/08/01		9.68		10.7	10.8	7.03		10.32		10.34	10.55		7.25	
06/15/01		10.0	10.3	*	10.8	7.03		10.54	8.75	10.47	11.1		7.27	8.88
06/22/01	*	*	*	*	10.92	7.3		11	8.98	10.47	11.1		7.57	
06/29/01		11.13	10.9	11.4	10.22	7.54		11.2	9.18	10.94	11.2		7.9	
07/31/01		11.49	10.58	11.69	11.75	7.91		11.73	9.73	11.62	11.63		8.28	
08/20/01		9.17	10.59	11.35	10.87	7.7		11.49	9.8	12.05	11.89		8.2	
09/28/01		10	10.57	11.5	11.0	7.9		11.47	9.77	11.2	11.75		8.21	
10/22/01		10.75	10.44	10.89	11.01	7.7		11.01	9.6	10.51	10.7		7.0	
11/27/01		11.98	10.87	12.46	12.46	8.1		12.28	10.01	11.87	12.25		7.26	
12/20/01		11.63	10.22	11.98	11.97	7.82		11.76	8.73	10.61	11.37		7.11	
01/29/02		12.25		12.15	12.59	7.76		12.41	8.09	11.85	12.33		7.16	
02/11/02		11.12		11.79	12.09	7.63		12.13	7.48	11.73	11.8		6.89	
03/25/02		12.38		12.59	12.77	8.01		12.66	8.51	12.11	12.46		7.88	
04/24/02		12		12.26	12.39	7.86		12.34	7.94	11.55	11.95		7.43	
05/21/02		11.86		12.25	12.49	7.94		12.5	7.45	12.16	12.24	7.72	7.22	
06/20/02		11.92		12.26	12.34	8.07		12.28	8.12	11.63	12.2	7.89	7.84	
07/18/02		11.78		12.11	12.16	8.11		12.13	9.82	11.31	11.96	7.81	7.36	
08/06/02		6.95	11.76	7.88	7.63	8.02		8.87	9.76	8.89	9.03	7.64	7.49	
09/12/02		11.93	12.19	12.23	12.32	8.76		12.3	10.81	11.77	12.04	8.16	8.17	
10/30/02		11.91	12.2	12.21	12.24	NM		12.22	8.34	11.89	12.01	7.95	7.63	
11/21/02		11.79	9.46	12.53	12.46	7.64		12.62	7.71	12.42	12.5	7.95	7.37	
12/11/02		11.26	9.41	11.39	11.54	7.56		11.51	7.86	10.76	11.29	7.35	7.18	
01/16/03		12.39		12.55	12.74	8.47		12.82	8.76	12.3	12.52	7.98	8.16	
02/25/03		11.94		12.46	12.49	8.42		12.51	8.71	12.19	12.52	7.89	8.13	
03/14/03		12.16		12.33	12.56	8.26		12.44	8.79	12.11	12.35	8.01	7.79	
04/14/03		11.02		11.63	11.18	7.92		11.62	7.87	10.89	11.89	7.62	7.42	
05/08/03		11.93		12.51	12.55	8.12		12.63	7.77	12.12	12.44	8.43	7.81	
06/19/03		11.87		12.39	12.41	8.02		12.41	7.73	12.01	12.21	8.38	7.79	
07/21/03		11.81		12.12	12.25	7.99		12.32	7.64	11.91	11.98	8.31	7.62	
08/28/03		11.79		12.13	12.24	11.26		12.21	11.52	12.04	12.04	11.46	11.32	
09/30/03		11.27		11.95	11.44	8.65		11.87	9.45	10.33	11.57	8.56	8.68	
10/20/03		11.2		11.8	11.2	8.5		11.6	8	10.42	11.44	8.31	8.61	
11/03/03		11.04		10.91	10.3	8.39		10.63	7.24	10.59	11.24	7.55	7.48	
12/23/03		10.75		11.18	11.17	8.41		11.01	7.66	10.88	11.03	7.13	7.44	

TABLE 2.7

PH READINGS
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

Monitoring Location	MH10	OGC-7	MH11	MW-8	OGC-3	MH12	MH13	OGC-8	MH14	MW-9	OGC-4	MH15	MH16	MH17
Date														
01/21/04		10.69		11.06	11.16	8.39		11.5	(1)	9.98	10.89	9.53	6.25	
02/12/04		10.79	11.42	11.66	11.78	8.96		11.75	(1)	11.09	11.6	8.5	6.66	
03/04/04		10.79	11.07	11.06	11.29	9.02		11.37	11.5	11.25	11.6	9.03	7.75	
04/16/04		11.23	10.42	11.57	11.62	11.22		11.36	11.6	11.11	11.44	9.6	6.54	
05/15/04		11.19	11.78	11.91	12.13	8.34		11.8	11.7	11.61	11.68	9.5	6.62	
06/25/04		11.22	11.35	11.31	11.48	8.86		11.27	11.21	10.84	11.2	9.11	7.48	
07/30/04		11.10	11.00	11.09	11.42	8.6		11.13	8.40	10.69	11.16	9.42	6.84	
08/31/04		10.84	10.95	10.87	11.19	8.07		10.84	7.78	10.48	10.73	8.14	6.57	
09/30/04		11.0	10.87	11.01	11.4	8.44		11.03	8.1	10.7	10.66	8.32	6.75	
10/20/04		10.91	11.07	11.06	11.26	8.22		11.05	10.84	10.3	10.93	8.64	6.85	
11/23/04		11.08	9.39	11.34	11.44	8.33		11.31	8.64	10.92	11.36	9.08	7.63	
12/31/04		10.64	8.92	10.85	11.09	8.48		10.85	8.57	10.58	10.87	8.86	7.09	
01/28/05		10.79	8.99	11.11	11.31	9.16		11.20	(1)	10.76	11.2	8.95	6.64	
02/28/05		10.79	11.05	10.83	10.81	8.44		10.3	(1)	10.03	10.88	8.49	6.57	
03/31/05		11.22	11.28	11.51	11.49	9.04		11.37	8.5	11.17	11.27	7.24	6.94	
04/29/05		11.48	11.75	11.78	11.75	9.17		11.79	9.64	11.39	11.53	8.32	7.40	
05/27/05		13.65	11.64	13.74	11.79	8.91		11.62	8.6	11.07	11.21	9.05	8.08	
06/24/05		11.59	11.9	11.67	11.92	8.73		11.75	10.9	10.51	11.81	9.86	8.07	
07/29/05		9.55	10.46	10.93	11.21	8.28		10.82	8.97	10.35	10.62	8.19	6.97	
08/31/05		10.85	11.12	11.15	11.35	9.02		11.04	9.01	10.7	11.03	8.4	6.93	
10/03/05		10.81	11.1	11.07	11.4	7.61		10.91	7.85	10.66	10.99	8.7	7.56	
10/31/05		10.85	11.34	11.4	11.56	8.13		11.3	7.73	11.15	11.41	8.61	9.69	
11/22/05		10.38	10.25	10.65	10.7	8.5		10.45	7.63	10.36	11.05	8.10	6.60	
12/23/05		11.40	11.58	11.57	11.93	8.11		11.67	7.19	11.23	11.64	7.36	7.30	
01/27/06		11.54	11.75	10.81	12.01	9.04		11.96	7.65	11.51	11.90	7.54	7.84	
02/28/06		11.53	11.57	12.09	12.3	9.73		11.77	7.84	11.43	11.78	7.36	7.22	
03/24/06		11.41	11.53	11.63	11.83	8.88		12.01	8.46	11.54	11.89	7.92	7.09	
04/21/06		11.31	11.65	11.62	11.86	8.79		11.96	7.98	11.40	11.86	8.52	6.97	
05/30/06		11.11	11.43	11.36	11.56	7.45		11.34	8.90	10.73	10.98	8.90	7.68	

Notes:

(1) Buried with snow and could not be accessed.

TABLE 2.7
PH READINGS
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

Monitoring Location	City MH1	City MH2	City MH3
Date			
07/24/00	6.3	7.3	
10/24/00	7.08	7.52	7.41
03/29/01	7.52	7.50	7.16
06/15/01	7.7	7.69	7.4
06/22/01	8.0	7.9	7.8
07/31/01	8.0	8.0	7.7
08/20/01	8.2	8.3	8.0
09/28/01	8.1	8.3	7.9
10/22/01	8.0	8.0	7.8
11/27/01	7.9	8.2	8.01
12/20/01	*	*	*
01/29/02	7.62	7.93	7.97
02/11/02	7.52	7.73	7.79
03/25/02	*	*	*
04/24/02	7.46	7.62	7.69
05/21/02	7.47	7.66	7.72
06/20/02	7.57	7.69	7.78
07/18/02	7.72	7.84	8.01
08/06/02	7.63	7.68	7.92
09/12/02	7.72	7.79	7.98
10/30/02	7.73	7.8	7.93
11/21/02	7.32	7.37	7.41
12/11/02	7.29	7.31	7.35
01/16/03	7.62	7.7	7.79
02/25/03	7.64	7.71	7.89
03/14/03	7.39	7.54	7.61
04/14/03	7.22	7.39	7.41
05/08/03	7.29	7.43	7.48
06/19/03	7.27	7.39	7.41
07/21/03	7.25	7.36	7.38
08/28/03	7.29	7.44	7.41
09/30/03	7.29	7.45	7.40
10/20/03	7.4	7.71	7.39
11/03/03	8.46	7.14	7.27
12/23/03	9.34	7.63	7.57

TABLE 2.7
PH READINGS
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

Monitoring Location	City MH1	City MH2	City MH3
Date			
01/21/04	(2)	8.12	(2)
02/12/04	8.45	7.77	7.65
03/04/04	8.21	7.76	7.79
04/16/04	10.95	8.38	8.32
05/14/04	7.30	7.62	7.75
06/25/04	8.06	7.99	7.94
07/30/04	7.85	7.90	7.81
08/31/04	10.2	7.5	7.4
09/30/04	8.6	7.7	7.9
10/20/04	7.59	7.56	7.61
11/23/04	9.64	7.6	7.67
12/31/04	9.09	7.68	7.38
01/28/05	8.92	7.58	7.40
02/28/05	(1)	8.16	7.90
03/31/05	8.49	7.59	7.55
04/29/05	8.74	8.05	7.89
05/27/05	9.24	8.33	8.27
06/24/05	10.53	8.44	8.24
07/29/05	7.3	7.16	6.96
08/31/05	8.06	6.87	7.13
10/03/05	10.3	8.1	NM
10/31/05	10.76	7.9	7.93
11/22/05	9.50	8.54	7.34
12/23/05	10.58	(3)	(3)
01/27/06	10.76	7.87	7.84
02/28/06	11.29	8.73	8.64
03/24/06	11.18	7.98	7.78
04/21/06	NM	8.28	8.05
05/30/06	10.88	7.73	7.63

Notes:

* - pH meter malfunctioned.

NM - Not Measured.

(1) - Buried with snow.

(2) - Road conditions were not safe to allow for monitoring.

(3) - pH probe damaged.

TABLE 2.8

EFFLUENT SAMPLING SUMMARY
OPERATION AND MAINTENANCE MANUAL
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

LOCATIONS

effluent monitoring station at Site discharge point

FREQUENCY

monthly (as dictated by the City of North Tonawanda Industrial Wastewater Discharge Permit)

PARAMETERS*Volatiles*

Acetone	Methylene Chloride
Benzene	Styrene
2-Butanone	Tetrachloroethene
Chlorobenzene	Toluene
1,1-Dichloroethane	1,1,1-Trichloroethane
1,2-Dichloroethane	Trichloroethene
trans-1,2-Dichloroethene	Vinyl Chloride
Ethylbenzene	Xylenes (Total)

Semi-Volatiles

1,4-Dichlorobenzene	4-Methylphenol
1,2-Dichlorobenzene	Naphthalene
2,4-Dimethylphenol	Di-n-octylphthalate
2-Methylphenol	Phenols (4AAP)

Inorganics

Aluminum	Lead
Antimony	Magnesium
Arsenic	Manganese
Barium	Mercury
Beryllium	Nickel
Cadmium	Selenium
Chromium	Silver
Copper	Sodium
Iron	Zinc

Wet Chemistry

Alkalinity (Bicarbonate)	Oil and Grease
Alkalinity (Total)	pH
BOD	Phosphorous
Chloride	Sulfate
COD	Sulfide
Cyanide	TDS
Hardness	TKN
NH3	TOC
NO3	TSS

TABLE 2.9

PROPOSED EFFLUENT SAMPLING SUMMARY - NEXT 3-YEAR PERIOD
 OPERATION AND MAINTENANCE MANUAL
 GRATWICK-RIVERSIDE PARK SITE
 NORTH TONAWANDA, NEW YORK

LOCATIONS

effluent monitoring station at Site discharge point

FREQUENCY

Semi-Annual (Spring and Fall)

PARAMETERS*Volatiles*

Acetone
 Benzene
 2-Butanone
 Chlorobenzene
 1,1-Dichloroethane
 1,2-Dichloroethane
 trans-1,2-Dichloroethene
 Ethylbenzene

Methylene Chloride
 Styrene
 Tetrachloroethene
 Toluene
 1,1,1-Trichloroethane
 Trichloroethene
 Vinyl Chloride
 Xylenes (Total)

Semi-Volatiles

1,4-Dichlorobenzene
 1,2-Dichlorobenzene
 2,4-Dimethylphenol
 2-Methylphenol

4-Methylphenol
 Naphthalene
 Di-n-octylphthalate
 Phenols (4AAP)

Wet Chemistry

Chloride
 Cyanide
 NH₃
 NO₃
 Phosphorous
 Sulfate
 Sulfide

TABLE 2.10

ANALYTICAL RESULTS SUMMARY
MONTHLY SITE DISCHARGE
GRATWICK-RIVERSIDE PARK SITE

Sample ID: Sample Date:	Discharge Sample Port GRATWICK-RIVERSIDE						Surface Water Standard ⁽¹⁾
	6/29/2001	7/30/2001	8/21/2001	9/20/2001	10/24/2001	11/29/2001	
Parameter	Unit						
Volatiles							
1,1,1-Trichloroethane	µg/L	3.0J	1.8J	1.1J	7.6U	3.8U	3.8U
1,1-Dichloroethane	µg/L	8.8	7.3	5.8	3.4J	2.6J	3.5J
1,2-Dichloroethane	µg/L	5.0U	5.0U	5.0U	10U	5.0U	5.0U
2-Butanone	µg/L	7.6J	10	10U	20U	6.8J	6.7J
Acetone	µg/L	77	93	140	36	55	55
Benzene	µg/L	6.4	7.2	6.2	3.5J	3.1J	4.0J
Chlorobenzene	µg/L	3.7J	4.9J	5.0J	3.4J	3.5J	5.4J
Ethylbenzene	µg/L	8.9	11	9	8.6J	4.8J	6.8J
Methylene chloride	µg/L	1.1J	2.8U	2.8U	5.6U	2.8U	2.8U
Styrene	µg/L	1.0J	5.0U	5.0U	10U	5.0U	5.0U
Tetrachloroethene	µg/L	22	33	25	16	15	23
Toluene	µg/L	74	84	68	42	37	50
trans-1,2-Dichloroethene	µg/L	2.6	2.1	2.8	3.3J	1.5J	2.4
Trichloroethene	µg/L	150J	130	87	55	56	72
Vinyl chloride	µg/L	11	13	13	13J	8.0J	13
Xylene (total)	µg/L	40	44	34	32	17	26
Semi-Volatiles							
1,2-Dichlorobenzene	µg/L	9U	2U	1J	6	0.9J	9U
1,4-Dichlorobenzene	µg/L	21U	4U	1J	2J	4U	1J
2,4-Dimethylphenol	µg/L	14	13	19	12	17	13
2-Methylphenol	µg/L	49	46	38	28	38	37J
4-Methylphenol	µg/L	58	47	46	30	46	40J
Di-n-octyl phthalate	µg/L	12U	2U	2U	2U	2U	12U
Naphthalene	µg/L	1J	1J	1J	1J	0.8J	8U
Phenol	µg/L	86	64	67	110	74	110

TABLE 2.10

ANALYTICAL RESULTS SUMMARY
MONTHLY SITE DISCHARGE
GRATWICK-RIVERSIDE PARK SITE

Sample ID: Sample Date:	Discharge Sample Port GRATWICK-RIVERSIDE						Surface Water Standard ⁽¹⁾
	6/29/2001	7/30/2001	8/21/2001	9/20/2001	10/24/2001	11/29/2001	12/6/2001
Parameter	Unit						
Metals							
Aluminum	mg/L	0.31	0.24	0.24	0.20U	0.20	0.20U
Antimony	mg/L	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U
Arsenic	mg/L	0.0070U	0.0070U	0.0070U	0.0070U	0.0070U	0.0070U
Barium	mg/L	0.059	0.063	0.061	0.067	0.064	0.064
Beryllium	mg/L	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U
Cadmium	mg/L	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U
Chromium	mg/L	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U
Copper	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U
Iron	mg/L	0.050U	0.050U	0.050U	0.095	0.057	0.062
Lead	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U
Magnesium	mg/L	0.35	0.66	1	6.8	1.1	0.94
Manganese	mg/L	0.0030U	0.0030U	0.0036	0.028	0.0043	0.004
Mercury	mg/L	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U
Nickel	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U
Selenium	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U
Silver	mg/L	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U
Sodium	mg/L	273	271	262	290	293	286
Zinc	mg/L	0.026U	0.026U	0.026U	0.026U	0.026U	0.026U
General Chemistry							
pH	S.U.	NA	NA	9.45	11.23	10.06	10.71
Hardness	mg/L	524	488	465	529	456	410
Total Dissolved Solids (TDS)	mg/L	1500	1450	1530	1520	1200	1200
Total Suspended Solids (TSS)	mg/L	NA	NA	14	19	9.0	7.0
Chloride	mg/L	497	123	497	820	436	389
BOD	mg/L	NA	NA	20	17	24	27
COD	mg/L	NA	NA	155	240	50	49
Oil and Grease	mg/L	NA	NA	0.60U	1.0	1.0U	1.0U
Organic Carbon	mg/L	NA	NA	16	10	9.0	11
Alkalinity, Total (As CaCO ₃)	mg/L	131	115	120	115	22.2	57
Bicarbonate (as CaCO ₃)	mg/L	5.0U	5.0U	5.0U	5.0U	22.2	57
Ammonia	mg/L	NA	NA	6	4.9	21	11.6
Nitrate (as N)	mg/L	0.050U	0.050U	0.50U	0.20	0.050U	0.050U

TABLE 2.10

ANALYTICAL RESULTS SUMMARY
MONTHLY SITE DISCHARGE
GRATWICK-RIVERSIDE PARK SITE

		Discharge Sample Port GRATWICK-RIVERSIDE						Surface Water Standard ⁽¹⁾
Sample ID:	Sample Date:	6/29/2001	7/30/2001	8/21/2001	9/20/2001	10/24/2001	11/29/2001	12/6/2001
Parameter	Unit							
General Chemistry								
TKN	mg/L	NA	NA	10	7.6	7.6	14.8	10.6
Sulfate	mg/L	281	20.4	307	196	329	245	263
Sulfide	mg/L	13.2	16.0	14.3	5.6	2.5	10.6	14
Phenol	mg/L	NA	NA	0.28	0.24	0.28	0.15	0.11
Phosphorous	mg/L	NA	NA	0.29	NA	0.05	0.13	0.06
Cyanide	mg/L	NA	NA	0.005U	0.005U	0.005U	0.005U	0.005U

Notes:

U - Non-detect at associated value

-- Not Analyzed

J - Estimated

NL - Not Listed

SL - Sample Lost

(1) - Lowest Standard /Guidance Value shown

(2) - Guidance Value

(3) - Calculated using a hardness of 300 ppm

(4) - Applies to dissolved form

TABLE 2.10

ANALYTICAL RESULTS SUMMARY
MONTHLY SITE DISCHARGE
GRATWICK-RIVERSIDE PARK SITE

Sample ID:	1/23/2002	2/21/2002	3/27/2002	4/24/2002	5/30/2002	6/29/2002	6/29/2002	7/25/2002	8/27/02	9/23/02	10/17/02	11/13/02	12/12/2002	Surface Water Standard ⁽¹⁾
Sample Date:														
Parameter	Unit													
Volatiles														
1,1,1-Trichloroethane	µg/L	7.3U	7.6U	7.6U	7.6U	7.6U	7.6U	7.6U	3.8U	3.8U	3.8U	3.8U	7.6U	5
1,1-Dichloroethane	µg/L	2.3J	4.1J	4.9J	9.9	9.4U	9.4U	2.7J	1.4J	1.8J	1.2J	4.5J	7.3J	5
1,2-Dichloroethane	µg/L	10U	10U	10U	10U	10U	10U	10U	5.0U	5.0U	5.0U	5.0U	10U	0.6
2-Butanone	µg/L	20U	20U	20U	110	20U	20U	20U	10U	10U	2.1J	10U	5.2J	50
Acetone	µg/L	42	53	56	98	25	25	130	7.0J	28	15	48	96	50
Benzene	µg/L	2.1J	3.2J	4.6J	9.1	2.1J	2.1J	3.3J	1.9J	3.3J	2.1J	5.3	7.8J	1
Chlorobenzene	µg/L	3.8J	6.6J	5.2J	4.4J	5.8J	5.8J	5.4J	6.9	4.0J	5.6J	6.1	4.3J	5
Ethylbenzene	µg/L	2.0J	7.6J	9.6J	18	5.3J	5.3J	7.8J	6.4J	7.2	4.6J	13	18	5
Methylene chloride	µg/L	6.4U	5.6U	5.6U	2.9J	5.6U	5.6U	3.2J	3.5U	3.5U	3.5U	3.5U	2.2J	5
Styrene	µg/L	10U	10U	10U	10U	10U	10U	10U	5.0U	5.0U	5.0U	5.0U	10U	5
Tetrachloroethene	µg/L	4.9J	23	28	46	27	27	19	9.6	12	6.0	42	48	0.7(2)
Toluene	µg/L	15	46	57	110	33	33	41	18	30	14	64	110	5
trans-1,2-Dichloroethene	µg/L	3.6U	2.4J	2.5J	4.2	3.6U	3.6U	2.1J	2.2	1.8U	2.0	1.8U	3.2J	5
Trichloroethene	µg/L	27	92	140	260	80	80	74	20	48	20	130	230	5
Vinyl chloride	µg/L	8.4J	20U	5.1J	14J	8.6J	8.6J	6.6J	11	10	11	18	15J	0.3(2)
Xylene (total)	µg/L	7.3J	29	40	76	21	21	30	20	24	15	50	78	5
Semi-Volatiles														
1,2-Dichlorobenzene	µg/L	2J	1J	1J	3	0.8J	0.8J	1J	0.6J	0.6J	1J	0.9J	3	3
1,4-Dichlorobenzene	µg/L	2J	2J	1J	3J	1J	1J	1J	1J	0.8J	2J	1J	3J	3
2,4-Dimethylphenol	µg/L	11J	9J	8	14	4	4	9	6	7	8	12	21	50(2)
2-Methylphenol	µg/L	28J	21J	17	36	8J	8J	18	8J	13	15	19	32	NL
4-Methylphenol	µg/L	40J	27J	24	57	13J	13J	27	13	20	21	30	61	NL
Di-n-octyl phthalate	µg/L	14U	12U	2U	2U	2U	2U	2U	2U	0.3J	3U	2U	2U	50(2)
Naphthalene	µg/L	57	24	12	1J	15	15	13	23	8	29	2U	1J	10
Phenol	µg/L	210	96	42	73	51	51	41	66	28	84	35	38	1

TABLE 2.10

ANALYTICAL RESULTS SUMMARY
MONTHLY SITE DISCHARGE
GRATWICK-RIVERSIDE PARK SITE

Sample ID:	1/23/2002	2/21/2002	3/27/2002	4/24/2002	5/30/2002	6/29/2002	6/29/2002	7/25/2002	8/27/02	9/23/02	10/17/02	11/13/02	12/12/2002	Surface Water Standard ⁽¹⁾
Sample Date:														
Parameter	Unit													
Metals														
Aluminum	mg/L	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	NL
Antimony	mg/L	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.003
Arsenic	mg/L	0.0070U	0.0070U	0.0070U	0.0070U	0.0070U	0.0070U	0.0070U	0.0070U	0.0070U	0.0070U	0.0070U	0.0070U	0.050
Barium	mg/L	0.077	0.075	0.078	0.064	0.058	0.058	0.059	0.073	0.054	0.064	0.068	0.096	1.0
Beryllium	mg/L	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.003 ⁽²⁾
Cadmium	mg/L	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.005
Chromium	mg/L	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.050
Copper	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.023 ⁽³⁾
Iron	mg/L	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.10	0.050U	0.30
Lead	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.012
Magnesium	mg/L	1.5	1.4	0.92	0.34	2.5	1.7	1.7	8.8	3.5	6.4	1.9	0.43	35
Manganese	mg/L	0.0034	0.0042	0.0049	0.003U	0.0090	0.0030U	0.0030U	0.0094	0.0030U	0.0098	0.0030U	0.0030U	0.30
Mercury	mg/L	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.0000026 ⁽⁴⁾
Nickel	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.10
Selenium	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.0046 ⁽⁴⁾
Silver	mg/L	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.050
Sodium	mg/L	317	336	360	242	329	318	318	189	195	204	289	272	NL
Zinc	mg/L	0.026U	0.026U	0.026U	0.026U	0.026U	0.026U	0.026U	0.026U	0.026U	0.026U	0.026U	0.026U	2.0 ⁽²⁾
General Chemistry														
pH	S.U.	10.91	10.96	10.92	11.46	10.4	10.66	10.66	8.44	8.97	8.84	10.11	10.72	NL
Hardness	mg/L	415	449	440	484	349	300	300	316	277	274	372	507	NL
Total Dissolved Solids (TDS)	mg/L	1450	1490	1640	1610	1530	1130	1100	868	1040	945	1330	1410	NL
Total Suspended Solids (TSS)	mg/L	5.0	11.0	9	8	6	8	8	12	6	1.5	2	2.3	NL
Chloride	mg/L	514	545	577	545	518	452	424	377	320	329	502	489	250
BOD	mg/L	25	21	22	29	13	9	12	14	8	11	16	15	NL
COD	mg/L	45	58	255	50	23	26	58	49	19	46	16	64	NL
Oil and Grease	mg/L	1.0U	1.0U	1.0U	1.0U	1.0U	1.0U	1.0U	1.0U	1.0U	1.0U	1.0U	1.0U	NL
Organic Carbon	mg/L	14	6	10	12	9	11	8	6.9	10	7	(5)	(5)	NL
Alkalinity, Total (As CaCO ₃)	mg/L	62.4	53.8	102	126	36.3	43.1	43.1	27.2	5.0U	22.4	14.3	110	NL
Bicarbonate (as CaCO ₃)	mg/L	5.0U	5.0U	5.0U	5.0U	5.0U	5.0U	5.0U	27.2	5.0U	22.4	14.3	5.0U	NL
Ammonia	mg/L	9.1	6.0	6.0	5.2	SL	2.0	1.7	9.1	10.5	9.4	9.4	7.0	2.0
Nitrate (as N)	mg/L	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	10

TABLE 2.10

ANALYTICAL RESULTS SUMMARY
MONTHLY SITE DISCHARGE
GRATWICK-RIVERSIDE PARK SITE

Sample ID: Sample Date:		1/23/2002	2/21/2002	3/27/2002	4/24/2002	5/30/2002	6/29/2002	6/29/2002	7/25/2002	8/27/02	9/23/02	10/17/02	11/13/02	12/12/2002	Surface Water Standard ⁽¹⁾
Parameter	Unit														
<i>General Chemistry</i>															
TKN	mg/L	8.1	4.5	5.0	4.8	SL	2.0	2.0	1.7	5.6	6.2	7.8	10.5	10.8	NL
Sulfate	mg/L	261	250	262	239	239	226	226	215	236	214	213	254	302	250
Sulfide	mg/L	9.9	9.9	11.2	13.7	4.4	1.0U	1.0U	1.0U	1.4	1.0U	1.0U	7.4	21.6	0.002
Phenol	mg/L	0.12	0.28	0.22	0.22	SL	0.40	0.40	0.27	0.16	0.16	0.16	0.12	0.12	0.001
Phosphorous	mg/L	0.09	0.08	0.09	0.17	0.02	0.10	0.10	0.04	0.018	0.04	0.06	0.12	0.10	0.020 (2)
Cyanide	mg/L	0.005U	0.005U	0.040J	0.005U	0.005	0.005U	0.005U	0.005U	0.005U	0.005U	0.005U	0.005U	0.005U	0.0052

Notes:

- U - Non-detect at associated value
- - Not Analyzed
- J - Estimated
- NL - Not Listed
- SL - Sample Lost
- (1) - Lowest Standard/Guidance Value shown
- (2) - Guidance Value
- (3) - Calculated using a hardness of 300 ppm
- (4) - Applies to dissolved form
- (5) - TOC analyzer malfunction prevented analysis of this compound.

TABLE 2.10

ANALYTICAL RESULTS SUMMARY
MONTHLY SITE DISCHARGE
GRATWICK-RIVERSIDE PARK SITE

Sample ID: Sample Date:	1/16/03	2/06/03	3/11/03	4/04/03	5/09/03	6/10/03	7/10/03	8/7/03	9/4/03	10/10/03	11/7/03	12/10/03	Surface Water Standard ⁽¹⁾
Parameter	Unit												
Volatiles													
1,1,1-Trichloroethane	µg/L	2.6U	2.6U	2.6U	1.3U	2.6U	5.2U	5.2U	5.2U	1.3U	2.6U	2.6U	5
1,1-Dichloroethane	µg/L	4.1	9.6	5.6	6.4	5.4	7.4	4.6	3.3U	0.84U	1.7U	7.0	5
1,2-Dichloroethane	µg/L	1.7U	1.7U	1.7U	3.4U	1.7U	3.4U	3.4U	3.4U	0.85U	1.7U	1.7U	0.6
2-Butanone	µg/L	9.3U	9.3U	9.3U	19U	9.3U	19U	19U	19U	4.6U	9.3U	9.3U	50
Acetone	µg/L	21	56	51	42	28	52	42U	42U	10U	21U	35	50
Benzene	µg/L	3.4	7.9	6.2	4.4U	3.2	4.6	4.4U	4.4U	1.1U	2.2U	7.2	1
Chlorobenzene	µg/L	6.1	6.6	6.9	7.5	4.1	7.0	5.0	3.6U	5.4	9.3	6.3	5
Ethylbenzene	µg/L	9.9	2.3	15	12	11	12	9.5	4.3	1.8	2.1	17	5
Methylene chloride	µg/L	7.0U	7.0U	7.0U	14U	7.0U	14U	14U	14U	3.5U	7.0U	7.0U	5
Styrene	µg/L	5.2U	5.2U	5.2U	10U	5.2U	10U	10U	10U	2.6U	5.2U	5.2U	5
Tetrachloroethene	µg/L	22	59	46	31	45	38	32	12	1.3U	2.5U	47	0.7 (2)
Toluene	µg/L	37	110	81	56	46	57	39	17	1.2U	3.2	82	5
trans-1,2-Dichloroethene	µg/L	3.0U	4.3	3.0U	6.0U	4.5	6.0U	6.0U	6.0U	1.5U	3.0U	3.3	5
Trichloroethene	µg/L	92	260	220	160	140	170	110	53	1.7	5.7	180	5
Vinyl chloride	µg/L	10	20	11	9.6	12	9.5	5.7U	5.7U	1.9	2.8U	11	0.3 (2)
Xylene (total)	µg/L	41	99	64	50	44	56	40	28U	6.9U	14U	73	5
Semi-Volatiles													
1,2-Dichlorobenzene	µg/L	4U	20U	20U	20U	20U	19U	16U	16U	16U	16U	16U	3
1,4-Dichlorobenzene	µg/L	4U	18U	19U	19U	19U	18U	15U	15U	15U	15U	14U	3
2,4-Dimethylphenol	µg/L	10	18U	19U	19U	19U	18U	12U	20	12U	13U	18	50 (2)
2-Methylphenol	µg/L	12	16U	22	16U	16U	15U	15U	15U	15U	16U	15	NL
4-Methylphenol	µg/L	24	35	45	31	19	17U	15U	46	15U	16U	57	NL
Di-n-octyl phthalate	µg/L	4U	19U	20U	19U	20U	19U	26U	26U	26U	27U	26U	50 (2)
Naphthalene	µg/L	3U	18U	18U	18U	18U	17U	17U	17U	17U	18U	17U	10
Phenol	µg/L	61	30	62	94	64	74	46	28	16	150	46	1

TABLE 2.10
ANALYTICAL RESULTS SUMMARY
MONTHLY SITE DISCHARGE
GRATWICK-RIVERSIDE PARK SITE

Sample ID: Sample Date:	1/16/03	2/06/03	3/11/03	4/04/03	5/09/03	6/10/03	7/10/03	8/7/03	9/4/03	10/10/03	11/7/03	12/10/03	Surface Water Standard ⁽¹⁾
Parameter	Unit												
Metals													
Aluminum	mg/L	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	NL
Antimony	mg/L	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.003
Arsenic	mg/L	0.0070U	0.0070U	0.0070U	0.0070U	0.0070U	0.0070U	0.0070U	0.010U	0.010U	0.010U	0.010U	0.050
Barium	mg/L	0.091	0.097	0.090	0.094	0.065	0.080	0.074	0.082	0.072	0.092	0.10	1.0
Beryllium	mg/L	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.0020U	0.0020U	0.0020U	0.0020U	0.003 ⁽²⁾
Cadmium	mg/L	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.005
Chromium	mg/L	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0040U	0.0055	0.0040U	0.0040U	0.050
Copper	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.023 ⁽³⁾
Iron	mg/L	0.050U	0.050U	0.050U	0.050U	0.050U	0.17	0.050U	0.050U	0.072	0.050U	0.050U	0.30
Lead	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.0060U	0.0060U	0.0060U	0.0060U	0.012
Magnesium	mg/L	1.4	0.26	0.31	3.6	4.8	1.6	1.4	1.2	7.4	5.9	0.72	35
Manganese	mg/L	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0080	0.0030U	0.0030U	0.018	0.0055	0.0030U	0.30
Mercury	mg/L	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.000026	0.000026 ⁽⁴⁾
Nickel	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.10
Selenium	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.015U	0.015U	0.015U	0.015U	0.0046 ⁽⁴⁾
Silver	mg/L	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.050
Sodium	mg/L	343	391	195	401	310	276	231UJ	272	239	375	361	NL
Zinc	mg/L	0.026U	0.026U	0.026U	0.026U	0.026U	0.026U	0.020U	0.020U	0.020U	0.020U	0.020U	2.0 ⁽²⁾
General Chemistry													
pH	S.U.	10.71	11.55	11.3	10.91	9.75	8.0	10.8	10.59	7.92	8.48	11.13	NL
Hardness	mg/L	388	435	459	430	368	374	294	431	380	399	420	NL
Total Dissolved Solids (TDS)	mg/L	1500	1580	1590	1750	1120	1230	1050	1400	1000	1590	1400	NL
Total Suspended Solids (TSS)	mg/L	2.0	6.0	3.0	18.0	3.0	4	4	11	15	15	3	NL
Chloride	mg/L	511	512	628	778	524	416	410	347	383	615	834	250
BOD	mg/L	13	10	20	22	12	9	11	7	6	11	22	NL
COD	mg/L	55	73	46	44	39	73	24	21	8	40	53	NL
Oil and Grease	mg/L	1.0U	0.28	1.0U	1.0	1.0U	1.0U	1.0U	1.0U	1.0U	1.0U	1.0U	NL
Organic Carbon	mg/L	6	13	12	12	9	8	6	10	5	10	9	NL
Alkalinity, Total (As CaCO3)	mg/L	104	155	121	48	7.9	NA	119	58.0	38.0	13.4	74.8	NL
Bicarbonate (as CaCO3)	mg/L	22.5	5.0U	5.0U	5.0U	7.9	NA	10U	10U	38.0	13.4	10U	NL
Ammonia	mg/L	7.35	3.15	2.10	5.6	5.25	6.3	3.15	3.15	2.45	4.2	3.5	2.0
Nitrate (as N)	mg/L	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.051	0.050U	0.050U	10

TABLE 2.10

ANALYTICAL RESULTS SUMMARY
MONTHLY SITE DISCHARGE
GRATWICK-RIVERSIDE PARK SITE

Sample ID:	1/16/03	2/06/03	3/11/03	4/04/03	5/09/03	6/10/03	7/10/03	8/7/03	9/4/03	10/10/03	11/7/03	12/10/03	Surface Water Standard ⁽¹⁾
Sample Date:													
Parameter	Unit												
General Chemistry													
TKN	mg/L	9.24	2.52	1.1	4.48	5.04	6.7	5.88	5.88	2.24	7.28	5.88	NL
Sulfate	mg/L	202	177	184	230	236	170	208	254	149	242	386	250
Sulfide	mg/L	3.2	4.0	8.0	10	2.2	4.8	4.8	2.4	1.0U	1.0U	2.0	0.002
Phenol	mg/L	0.11	0.10	0.009	0.006	0.01U	0.034	0.08U	0.014U	0.006U	0.012U	0.015U	0.001
Phosphorous	mg/L	0.12	0.10	0.18	0.10	0.04	0.10	0.13	0.16	0.11	0.24	0.13	0.020 ⁽²⁾
Cyanide	mg/L	0.005U	0.005U	0.005U	0.005	0.005U	0.005U	0.005U	0.005U	0.005U	0.005U	0.005U	0.0052

Notes:

U - Non-detect at associated value

- - Not Analyzed

J - Estimated

NL - Not Listed

SL - Sample Lost

(1) - Lowest Standard/Guidance Value shown

(2) - Guidance Value

(3) - Calculated using a hardness of 300 ppm

(4) - Applies to dissolved form

(5) - TOC analyzer malfunction prevented analysis of this compound.

TABLE 2.10
ANALYTICAL RESULTS SUMMARY
MONTHLY SITE DISCHARGE
GRATWICK-RIVERSIDE PARK SITE

Sample ID: Sample Date:	1/8/04	2/6/04	3/16/04	04/13/04	05/14/04	06/10/04	07/09/04	08/12/04	09/10/04	10/08/04	11/05/04	12/03/04	Surface Water Standard ⁽¹⁾
Parameter	Unit												
Volatiles													
1,1,1-Trichloroethane	µg/L	2.6U	5.2U	1.3U	5.2U	1.3U	1.3U	1.3U	5.2U	5.2U	5.2U	1.3U	5
1,1-Dichloroethane	µg/L	9.2	3.3U	11	11	10	5.9	10	5.2U	5.2U	3.3U	6.5	5
1,2-Dichloroethane	µg/L	1.7U	3.4U	3.4U	3.4U	0.85U	0.85U	0.85U	5.2U	5.2U	3.4U	0.85U	0.6
2-Butanone	µg/L	9.3U	19U	19U	19U	4.6U	4.6U	4.6U	5.2U	5.2U	19U	4.6U	50
Acetone	µg/L	53	42U	38	42U	12	22	34	5.2U	5.2U	42U	19	50
Benzene	µg/L	7.8	4.4U	6.1	4.4	2.1	2.9	5.6	5.2U	5.2U	4.4U	3.3	1
Chlorobenzene	µg/L	6.7	8.8	3.0	3.6U	8.8	4.4	2.9	19	13	12	4.5	5
Ethylbenzene	µg/L	19	0.11U	17	18	6.4	8.7	18	6.4	0.11U	0.11U	12	5
Methylene chloride	µg/L	7.0U	14U	3.5U	15	3.5U	3.5U	3.5U	14U	14U	14U	3.5U	5
Styrene	µg/L	5.2U	10U	2.6U	10U	2.6U	2.6U	2.6U	14U	14U	10U	2.6U	5
Tetrachloroethene	µg/L	60	5.0U	50	63	16	22	52	14U	14U	5.0U	31	0.7 (2)
Toluene	µg/L	98	4.9U	80	78	26	38	83	14U	14U	4.9	46	5
trans-1,2-Dichloroethene	µg/L	3.6	6.0U	4.0	6.0U	1.8	2.1	3.6	14U	14U	6.0U	1.5U	5
Trichloroethene	µg/L	260	7.5	200	240	82	97	200	4.8	4.8U	4.8U	130	5
Vinyl chloride	µg/L	14	5.7U	10	11	4.9	5.6	12	6.1	5.7U	5.7U	6.7	0.3 (2)
Xylene (total)	µg/L	91	28U	81	87	29	42	83	28U	28U	28U	5.4	5
Semi-Volatiles													
1,2-Dichlorobenzene	µg/L	16U	16U	16U	16U	16U	16U	16U	16U	16U	16U	16U	3
1,4-Dichlorobenzene	µg/L	15U	15U	15U	15U	15U	15U	14U	15U	14U	15U	15U	3
2,4-Dimethylphenol	µg/L	15	12U	13U	13U	12U	13U	12U	14	12U	13U	13U	50 (2)
2-Methylphenol	µg/L	16U	15U	16U	16U	15U	16U	15	15U	15U	16U	16U	NL
4-Methylphenol	µg/L	48	15U	24	16U	15U	20	32	29	15U	16U	16U	NL
Di-n-octyl phthalate	µg/L	27U	27U	27U	27U	27U	27U	26U	26U	26U	27U	27U	50 (2)
Naphthalene	µg/L	18U	37	18U	18U	17U	18U	17U	17U	20	18U	18U	10
Phenol	µg/L	39	140	11	14	91	67	13	6U	55	6U	11	1

TABLE 2.10
ANALYTICAL RESULTS SUMMARY
MONTHLY SITE DISCHARGE
GRATWICK-RIVERSIDE PARK SITE

Sample ID: Sample Date:	1/8/04	2/6/04	3/16/04	04/13/04	05/14/04	06/10/04	07/09/94	08/12/04	09/10/04	10/08/04	11/05/04	12/03/04	Surface Water Standard ⁽¹⁾
Parameter	Unit												
Metals													
Aluminum	mg/L	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	NL
Antimony	mg/L	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.003
Arsenic	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.050
Barium	mg/L	0.095	0.092	0.11	0.096	0.085	0.068	0.076	0.059	0.079	0.070	0.077	1.0
Beryllium	mg/L	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.003
Cadmium	mg/L	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.005
Chromium	mg/L	0.0040U	0.0040U	0.0040U	0.0040U	0.0040U	0.0040U	0.0040U	0.0040U	0.0040U	0.0040U	0.0040U	0.050
Copper	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.023
Iron	mg/L	0.050U	0.066	0.050U	0.055	0.26	0.056	0.097	0.20	0.22	0.11	0.050U	0.30
Lead	mg/L	0.0060U	0.0060U	0.0060U	0.0060U	0.0060U	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.012
Magnesium	mg/L	0.68	4.2	1.2	1.0	5.4	2.8	0.57	5.4	5.2	5.2	2.7	35
Manganese	mg/L	0.0030U	0.19	0.0033	0.0058	0.018	0.012	0.0030U	0.022	0.031	0.022	0.067	0.30
Mercury	mg/L	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.0000026
Nickel	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.10
Selenium	mg/L	0.015U	0.015U	0.015U	0.015U	0.015U	0.015U	0.015U	0.015U	0.015U	0.015U	0.015U	0.0046
Silver	mg/L	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.050
Sodium	mg/L	362	425	425	422	423	319	305	334	447	360	294	NL
Zinc	mg/L	0.030	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	2.0

TABLE 2.10
ANALYTICAL RESULTS SUMMARY
MONTHLY SITE DISCHARGE
GRATWICK-RIVERSIDE PARK SITE

Sample ID:	1/8/04	2/6/04	3/16/04	04/13/04	05/14/04	06/10/04	07/09/04	08/12/04	09/10/04	10/08/04	11/05/04	12/03/04	Surface Water Standard ⁽¹⁾
Sample Date:													
Parameter	Unit												
General Chemistry													
pH	S.U.	11	11.13	11.16	9.44	11.26	8.81	11.19	9.21	7.26	9.10	10.95	NL
Hardness	mg/L	450	446	484	408	430	336	312	430	372	348	360	NL
Total Dissolved Solids (TDS)	mg/L	1490	1780	1760	1920	1560	1490	1390	1560	1720	1320	1220	NL
Total Suspended Solids (TSS)	mg/L	6	11	20	6	11	5	8	8	10	18	5	NL
Chloride	mg/L	742	869	809	1020	792	728	678	692	913	676	599	250
BOD	mg/L	18	13	19	17	16	6	11	15	11	6	15	NL
COD	mg/L	55	51	51	58	26	67	43	46	59	17	24	NL
Oil and Grease	mg/L	1.0U	1.0U	1.0U	0.57	1.0U	1.0U	1.0U	1.0U	1.0U	1.0U	1.0U	NL
Organic Carbon	mg/L	9	6	5	6	6	8	7	8	9	8	7	NL
Alkalinity, Total (As CaCO ₃)	mg/L	56.0	71.2	110.0	12.3	122	45.7	113	37.8	44.6	46.5	55.7	NL
Bicarbonate (as CaCO ₃)	mg/L	10UJ	10U	10U	12.3	47.1	10U	10U	37.8	44.6	46.5	55.7	NL
Ammonia	mg/L	0.32	0.35	1.75	1.05	0.70	0.35	0.70	1.05	0.7	1.05	1.4	2.0
Nitrate (as N)	mg/L	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	10
TKN	mg/L	0.56	1.4	0.28	0	0.84	0.56	1.68	1.12	0.56	0.84	1.12	NL
Sulfate	mg/L	276	381	568	356	360	283	279	265	311	225	254	250
Sulfide	mg/L	4.0	3.2	5.6	1.6	1.6	8.4J	2.4	2.4J	5.6	2.4	2	0.002
Phenol	mg/L	0.015U	0.009U	0.012U	0.010U	0.008U	0.010U	0.010U	0.010U	0.007U	0.008U	0.008U	0.001
Phosphorous	mg/L	0.20	0.24	0.23	0.13	0.05	0.20	0.06	0.14	0.10	0.14	0.10	0.020 ⁽²⁾
Cyanide	mg/L	0.005U	0.005U	0.005U	0.005U	0.005U	0.005U	0.005U	0.005U	0.005U	0.005U	0.005U	0.0052

Notes:

U - Non-detect at associated value

-- - Not Analyzed

J - Estimated

NL - Not Listed

SL - Sample Lost

(1) - Lowest Standard/Guidance Value shown

(2) - Guidance Value

(3) - Calculated using a hardness of 300 ppm

(4) - Applies to dissolved form

(5) - TOC analyzer malfunction prevented analysis of this compound.

TABLE 2.10
ANALYTICAL RESULTS SUMMARY
MONTHLY SITE DISCHARGE
GRATWICK-RIVERSIDE PARK SITE

Sample ID:	Sample Date:	Parameter	Unit	01/07/05	02/03/05	03/04/05	04/08/05	05/06/05	06/10/05	07/08/05	08/05/05	09/09/05	10/07/05	11/04/05	12/08/05	Surface Water Standard ⁽¹⁾
Volatiles																
1,1,1-Trichloroethane	2.6U	µg/L	2.6U	2.6U	2.6U	2.6U	2.6U	13U	2.6U	6.6U	1.3U	5.2U	5.2U	5.2U	5.2U	5
1,1-Dichloroethane	1.7U	µg/L	1.7U	1.7U	1.7U	1.7U	1.7U	8.4U	9.0	4.2U	6.6	5.7	3.3U	11	7.9	5
1,2-Dichloroethane	1.7U	µg/L	1.7U	1.7U	1.7U	1.7U	1.7U	8.5U	1.7U	4.2U	0.85U	3.4U	3.4U	3.4U	3.4U	0.6
2-Butanone	9.3U	µg/L	9.3U	9.3U	9.3U	9.3U	9.3U	46U	9.3U	23U	4.6U	19U	19U	19U	19U	50
Acetone	21U	µg/L	21U	21U	21U	21U	21U	100U	30	53U	10U	42U	42U	42U	42U	50
Benzene	2.2U	µg/L	2.2U	2.2U	2.2U	2.2U	2.2U	11U	2.5	5.5U	1.3	4.4U	4.4U	4.4U	4.4U	1
Chlorobenzene	14	µg/L	16	18	16	6.4	6.4	9.0U	1.8U	5.5	2.6	4.0	7.5	3.6U	4.7	5
Ethylbenzene	3.2	µg/L	0.056U	2.2	0.056U	0.056U	0.056U	0.28U	9.0	8.4	9.4	4.6	6.6	11	8.3	5
Methylene chloride	7.0U	µg/L	7.0U	7.0U	7.0U	7.0U	7.0U	35U	7.0U	17U	3.5U	14U	14U	14U	14U	5
Styrene	5.2U	µg/L	5.2U	5.2U	5.2U	5.2U	5.2U	26U	5.2U	13U	2.6U	10U	10U	10U	10U	5
Tetrachloroethene	2.5U	µg/L	2.5U	2.5U	2.5U	2.5U	2.5U	13U	24	34	28	12	17	20	15	0.7 (2)
Toluene	4.0	µg/L	5.3	2.4U	5.3	3.1	3.1	14	45	40	44	23	25	45	34	5
trans-1,2-Dichloroethene	3.0U	µg/L	3.0U	3.0U	3.0U	3.0U	3.0U	15U	3.0U	7.6U	1.5U	6.0U	6.0U	6.0U	6.0U	5
Trichloroethene	8.7	µg/L	12	2.4U	12	8.5	8.5	29	140	100	90	67	61	120	86	5
Vinyl chloride	3.6	µg/L	2.8U	2.8U	2.8U	2.8U	2.8U	14U	5.1	7.1U	1.4U	5.7U	5.7U	5.7U	5.7U	0.3 (2)
Xylene (total)	14U	µg/L	14U	14U	14U	14U	14U	69U	46	35	46	28U	28U	55	41	5
Semi-Volatiles																
1,2-Dichlorobenzene	16U	µg/L	16U	16U	16U	16U	16U	16U	1	1U	1U	1UJ	1	2	2	3
1,4-Dichlorobenzene	15U	µg/L	15U	14U	15U	15U	15U	15U	1	1	1	1	2	2	2	3
2,4-Dimethylphenol	16	µg/L	13U	12U	13U	13U	13U	12U	5	3	4	3	6	7	11	50 (2)
2-Methylphenol	16U	µg/L	16U	15U	16U	16U	16U	15U	6	4	7	1	5	8	7	NL
4-Methylphenol	49	µg/L	16	15U	16U	16U	16U	15U	12	10	15	0.7U	12	21	21	NL
Di-n-octyl phthalate	27U	µg/L	27U	26U	27U	27U	27U	27U	0.8U	0.8U	0.9U	0.9U	0.9U	0.9U	0.8U	50 (2)
Naphthalene	18U	µg/L	33	17U	33	18U	18U	19	0.8U	0.8U	3	0.8U	0.8U	0.8U	0.8U	10
Phenol	34	µg/L	130	6U	130	120J	120J	68	0.4U	7	9	0.4U	17	4	50	1

TABLE 2.10
ANALYTICAL RESULTS SUMMARY
MONTHLY SITE DISCHARGE
GRATWICK-RIVERSIDE PARK SITE

Sample ID: Sample Date:	Parameter	Unit	01/07/05	02/03/05	03/04/05	04/08/05	05/06/05	06/10/05	07/08/05	08/05/05	09/09/05	10/07/05	11/04/05	12/08/05	Surface Water Standard ⁽¹⁾
Metals	Aluminum	mg/L	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20	0.20U	NL
	Antimony	mg/L	0.020U	0.020U	0.020U	0.020U	0.020U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.20U	0.003
	Arsenic	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.050
	Barium	mg/L	0.068	0.069	0.085	0.15	0.088	0.067	0.055	0.063	0.073	0.082	0.093	0.10	1.0
	Beryllium	mg/L	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.003
	Cadmium	mg/L	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.005
	Chromium	mg/L	0.0040U	0.0040U	0.0040U	0.0040U	0.0040U	0.0040U	0.0040U	0.0040U	0.0040U	0.0040U	0.0040U	0.0040U	0.050
	Copper	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.023
	Iron	mg/L	0.098	0.54	0.37	3.4	0.22	0.050U	0.050U	0.050U	0.17	0.056	0.050U	0.050U	0.30
	Lead	mg/L	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.012
	Magnesium	mg/L	4.3	5.7	5.6	14.2	6.3	0.50	2.8	1.8	3.2	3.4	0.26	1.2	35
	Manganese	mg/L	0.01	0.035	0.033	0.34	0.053	0.0030U	0.0068	0.0030U	0.022	0.022	0.0030U	0.0030U	0.30
	Mercury	mg/L	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.0000026
	Nickel	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.010U	0.10
	Selenium	mg/L	0.015U	0.015U	0.015U	0.015U	0.015U	0.015U	0.015U	0.015U	0.015U	0.015U	0.015U	0.015U	0.0046
	Silver	mg/L	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.050
	Sodium	mg/L	387	422	448	504	347	289	229	235	264	292	302	357	NL
	Zinc	mg/L	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.020U	0.032	0.020U	0.020U	2.0

TABLE 2.10
ANALYTICAL RESULTS SUMMARY
MONTHLY SITE DISCHARGE
GRATWICK-RIVERSIDE PARK SITE

Sample ID:	01/07/05	02/03/05	03/04/05	04/08/05	05/06/05	06/10/05	07/08/05	08/05/05	09/09/05	10/07/05	11/04/05	12/08/05	Surface Water Standard ⁽¹⁾
Sample Date:													
Parameter	Unit												
General Chemistry													
pH	S.U.	9.71	8.94	9.27	8.18	9.3	11.13	8.42	10.67	9.91	11.25	11.04	NL
Hardness	mg/L	372	390	398	468	400	352	275	268	255	280	344	NL
Total Dissolved Solids (TDS)	mg/L	1520	1480	1620	2010	1540	1370	1110	1140	1050	1320	1380	NL
Total Suspended Solids (TSS)	mg/L	278	147	27	82	21	12	11	6	6	6	4	NL
Chloride	mg/L	950	836	1060	1200	883	729	516	408	451	664	762	250
BOD	mg/L	12	15	12	11	10	11	14	10	12	14	16	NL
COD	mg/L	52	48	52	65	35	51	56	38	47	31	61	NL
Oil and Grease	mg/L	1.00	1.00	1.00	1.00	1.00	0.28	1.00	1.00	1.00	1.00	1.00	NL
Organic Carbon	mg/L	8	9	9	10	9	10	5.1	5.2	5.1	6.4	9.2	NL
Alkalinity, Total (As CaCO ₃)	mg/L	44	46.4	40	105	43.5	99.2	36.3	66	10.2	114	42	NL
Bicarbonate (as CaCO ₃)	mg/L	44	46.4	40	105	43.5	100	36.3	66	10.2	114	42	NL
Ammonia	mg/L	0.7	0.7	0.7	0.35	1.05	0.35	0.35	0.7	0.35	0.70	0.70	2.0
Nitrate (as N)	mg/L	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	0.050U	10
TKN	mg/L	0.56	0.28	0.56	0.28	1.4	0.28	0.56	0.56	0.28	0.56	0.84	NL
Sulfate	mg/L	273	232	431	256	279	276	223	199	206	256	263	250
Sulfide	mg/L	8.8	4	5.2	1.00	1.00	1.00	1.00	2.0	2.0	5.6	8.8	0.002
Phenol	mg/L	0.006U	0.012U	0.010U	0.014U	0.012U	0.009U	0.009U	0.007U	0.010U	0.006U	0.008U	0.001
Phosphorous	mg/L	0.15	0.08	0.11	0.1	0.13	0.08	0.08	0.11	0.14	0.20	0.04	0.020 ⁽²⁾
Cyanide	mg/L	0.005U	0.005U	0.005U	0.005U	0.005U	0.0050U	0.0050U	0.005U	0.005U	0.005U	0.005U	0.0052

Notes:

- U - Non-detect at associated value
- Not Analyzed
- J - Estimated
- NL - Not Listed
- SL - Sample Lost
- (1) - Lowest Standard / Guidance Value shown
- (2) - Guidance Value
- (3) - Calculated using a hardness of 300 ppm
- (4) - Applies to dissolved form
- (5) - TOC analyzer malfunction prevented analysis of this compound.

TABLE 2.10
ANALYTICAL RESULTS SUMMARY
MONTHLY SITE DISCHARGE
GRATWICK-RIVERSIDE PARK SITE

Sample ID: Sample Date:	01/06/06	02/14/06	03/10/06	04/07/06	05/04/06	Surface Water Standard ⁽¹⁾
Parameter	Unit					
Volatiles						
1,1,1-Trichloroethane	µg/L	5.2U	5.2U	5.2U	5.2U	5
1,1-Dichloroethane	µg/L	8.9	10	12	3.3U	5
1,2-Dichloroethane	µg/L	3.4U	3.4U	3.4U	3.4U	0.6
2-Butanone	µg/L	19U	19U	19U	19U	50
Acetone	µg/L	42U	42U	42U	42U	50
Benzene	µg/L	4.4U	4.4U	4.4U	4.4U	1
Chlorobenzene	µg/L	5.1	5.0	3.6U	8.6	5
Ethylbenzene	µg/L	7.9	10	8.2	7.0U	5
Methylene chloride	µg/L	14U	14U	6.8U	6.8U	5
Styrene	µg/L	10U	10U	6.6U	6.6U	5
Tetrachloroethene	µg/L	15	19	21	9.1	0.7 (2)
Toluene	µg/L	36	46	41	11	5
trans-1,2-Dichloroethene	µg/L	6.0U	6.0U	6.0U	6.0U	5
Trichloroethene	µg/L	100	130	130	23	5
Vinyl chloride	µg/L	5.7U	5.8	5.7U	5.7U	0.3 (2)
Xylene (total)	µg/L	37	28U	41	28U	5
Semi-Volatiles						
1,2-Dichlorobenzene	µg/L	2	2	2	1	3
1,4-Dichlorobenzene	µg/L	2	2	2	3	3
2,4-Dimethylphenol	µg/L	9	11	14	5	50 (2)
2-Methylphenol	µg/L	6	7	8	4	NL
4-Methylphenol	µg/L	21	28	34	13	NL
Di-n-octyl phthalate	µg/L	0.8U	0.9U	0.8U	4U	50 (2)
Naphthalene	µg/L	12	11	1	50	10
Phenol	µg/L	43	40	31	0.4U	1

ANALYTICAL RESULTS SUMMARY
MONTHLY SITE DISCHARGE
GRATWICK-RIVERSIDE PARK SITE

Sample ID:	Parameter	Unit	01/06/06	02/14/06	03/10/06	04/07/06	05/04/06	Surface Water Standard ⁽¹⁾
Sample Date:								
	Metals							
	Aluminum	mg/L	0.20U	0.20U	0.20U	0.20U	0.20U	NL
	Antimony	mg/L	0.20U	0.20U	0.20U	0.20U	0.20U	0.003
	Arsenic	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.050
	Barium	mg/L	0.10	0.11	0.94	0.093	0.082	1.0
	Beryllium	mg/L	0.0020U	0.0020U	0.0020U	0.0020U	0.0020U	0.003
	Cadmium	mg/L	0.0010U	0.0010U	0.0010U	0.0010U	0.0010U	0.005
	Chromium	mg/L	0.0040U	0.0040U	0.0040U	0.0040U	0.0040U	0.050
	Copper	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.023
	Iron	mg/L	0.050U	0.050U	0.050U	0.050U	0.050U	0.30
	Lead	mg/L	0.0050U	0.0050U	0.0050U	0.0050U	0.0050U	0.012
	Magnesium	mg/L	2.3	1.2	0.57	0.46	7.6	35
	Manganese	mg/L	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.30
	Mercury	mg/L	0.00020U	0.00020U	0.00020U	0.00020U	0.00020U	0.0000026
	Nickel	mg/L	0.010U	0.010U	0.010U	0.010U	0.010U	0.10
	Selenium	mg/L	0.015U	0.015U	0.015U	0.015U	0.015U	0.0046
	Silver	mg/L	0.0030U	0.0030U	0.0030U	0.0030U	0.0030U	0.050
	Sodium	mg/L	357	425	454	419	361	NL
	Zinc	mg/L	0.020U	0.020U	0.010U	0.010U	0.010U	2.0

TABLE 2.10
ANALYTICAL RESULTS SUMMARY
MONTHLY SITE DISCHARGE
GRATWICK-RIVERSIDE PARK SITE

Sample ID:		01/06/06	02/14/06	03/10/06	04/07/06	05/04/06	Surface Water Standard (1)
Sample Date:							
Parameter	Unit						
General Chemistry							
pH	S.U.	10.73	11.07	10.99	10.96	9.74	NL
Hardness	mg/L	329	342	400	408	289	NL
Total Dissolved Solids (TDS)	mg/L	1510	1700	1670	1730	1500	NL
Total Suspended Solids (TSS)	mg/L	6	6	10	5	4	NL
Chloride	mg/L	910	897	914	962J	914	250
BOD	mg/L	10	10	9	10	12	NL
COD	mg/L	38	45	47	47	47	NL
Oil and Grease	mg/L	1.0U	1.0U	1.0U	1.0U	1.0U	NL
Organic Carbon	mg/L	7.9	8.1	8.3	8.9	9.3	NL
Alkalinity, Total (As CaCO ₃)	mg/L	69	71.4	95.1	75.4	26.9	NL
Bicarbonate (as CaCO ₃)	mg/L	69	10U	10U	75.4	26.9	NL
Ammonia	mg/L	0.35	1.05	0.28	0.70	0.70	2.0
Nitrate (as N)	mg/L	0.050U	0.050U	0.050U	0.050U	0.050U	10
TKN	mg/L	0.28	0.84	0.56	0.84	0.56	NL
Sulfate	mg/L	297	288	285	351	296	250
Sulfide	mg/L	4.0	2.9	5.2	6.0	4.4	0.002
Phenol	mg/L	0.008U	0.010U	0.009U	0.011U	0.007U	0.001
Phosphorous	mg/L	0.06	0.37	0.13	0.05	0.10	0.020
Cyanide	mg/L	0.005U	0.005U	0.005U	0.005U	0.005U	0.0052

Notes:

- U - Non-detect at associated value
 -- - Not Analyzed
 J - Estimated
 NL - Not Listed
 SL - Sample Lost
 (1) - Lowest Standard/Guidance Value shown
 (2) - Guidance Value
 (3) - Calculated using a hardness of 300 ppm
 (4) - Applies to dissolved form
 (5) - TOC analyzer malfunction prevented analysis of this compound.

TABLE 2.11

GROUNDWATER VOLUMES DISCHARGED
TO NORTH TONAWANDA POTW
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

<i>Month</i>	<i>Volumes (gallons)</i>	
	<i>Monthly</i>	<i>Total</i>
May 2001	2,900,000	2,900,000
June 2001	2,353,800	5,253,800
July 2001	1,488,500	6,742,300
August 2001	712,800	7,455,100
September 2001	473,100	7,928,200
October 2001	1,213,100	9,141,300
November 2001	1,281,100	10,422,400
December 2001	231,700 ⁽¹⁾	10,654,100
January 2002	1,383,200 ⁽²⁾	12,037,300
February 2002	1,186,000	13,223,300
March 2002	233,600	13,456,900
April 2002	736,000	14,192,900
May 2002	348,200	14,541,100
June 2002	1,137,200	15,678,300
July 2002	869,300	16,547,600
August 2002	1,060,800	17,608,400
September 2002	707,000	18,315,400
October 2002	679,800	18,995,100
November 2002	489,500	19,484,700
December 2002	743,500	20,228,200
January 2003	1,150,700	21,378,900
February 2003	483,300	21,862,200
March 2003	402,300	22,264,500
April 2003	531,900	22,796,400
May 2003	655,600	23,452,000
June 2003	682,100	24,134,000
July 2003	942,000	25,076,100
August 2003	627,500	25,703,600
September 2003	349,600	26,053,200
October 2003	966,500	27,019,700
November 2003	442,200	27,461,900
December 2003	463,900	27,925,800
January 2004	443,900	28,369,700

TABLE 2.11

GROUNDWATER VOLUMES DISCHARGED
TO NORTH TONAWANDA POTW
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

<i>Month</i>	<i>Volumes (gallons)</i>	
	<i>Monthly</i>	<i>Total</i>
February 2004	253,700	28,623,400
March 2004	403,700	29,027,100
April 2004	433,600	29,460,700
May 2004	377,400	29,838,100
June 2004	395,000	30,233,100
July 2004	384,300	30,617,400
August 2004	479,700	31,097,100
September 2004	413,900	31,511,000
October 2004	319,400	31,902,400
November 2004	249,200	32,151,600
December 2004	209,900	32,361,500
January 2005	310,100	32,671,600
February 2005	301,100	32,972,700
March 2005	250,200	33,222,900
April 2005	378,400	33,601,300
May 2005	458,800	34,060,100
June 2005	455,900	34,516,000
July 2005	270,200	34,786,200
August 2005	285,100	35,071,300
September 2005	395,600	35,466,900
October 2005	333,200	35,800,100
November 2005	360,200	36,160,300
December 2005	395,300	36,555,600
January 2006	297,500	36,853,100
February 2006	508,300	37,361,400
March 2006	244,700	37,606,100
April 2006	224,400	37,830,500
May 2006	153,300	37,983,800

Notes:

- (1) To December 7, 2001.
(2) From December 8, 2001.

TABLE 2.12

SURFACE WATER SAMPLING SUMMARY
OPERATION AND MAINTENANCE MANUAL
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK

LOCATIONS

River South
River Middle
River North

FREQUENCY

- quarterly for 2 years following GWS startup (concurrent with groundwater sampling)
- semi-annually for Year 3 (concurrent with groundwater sampling)
- annually for Years 3 through 7 (concurrent with groundwater sampling) (review after Year 7)

PARAMETERS

Volatiles

Acetone
Benzene
2-Butanone
Chlorobenzene
1,1-Dichloroethane
trans-1,2-Dichloroethene
Ethylbenzene

Methylene Chloride
Tetrachloroethene
Toluene
Trichloroethene
Vinyl Chloride
Xylenes (Total)

Semi-Volatiles

1,2-Dichlorobenzene
1,4-Dichlorobenzene
2,4-Dimethylphenol
2-Methylphenol

4-Methylphenol
Naphthalene
Di-n-octylphthalate
Phenol

APPENDIX A

MONTHLY INSPECTION LOGS (NOVEMBER 2005 TO MAY 2006)

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

PROJECT NAME: Gratwick-Riverside Park Site

LOCATION: Wheatfield, New York

DATE: 11/22/05
(MM DD YY)

INSPECTOR(S):

D. Cwik

Comments

Inspect For

Action Required

1. Perimeter Collection System/Off-Site Forcemain

Manholes

--	--	--	--	--	--

- cover on securely
- condition of cover
- condition of inside of manhole
- flow conditions

None

Wet Wells

--	--	--	--	--	--

- cover on securely
- condition of cover
- condition of inside of wet well

None

2. Landfill Cap

Vegetated Soil Cover

--	--	--	--	--	--

- erosion
- bare areas
- washouts
- leachate seeps
- length of vegetation
- dead/dying vegetation

None

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

PROJECT NAME: Gratick-Riverside Park Site

LOCATION: Wheatfield, New York

DATE: 11/12/45
(MM DD YY)

INSPECTOR(S):

[Signature]

Comments

Action Required

Item

Inspect For

2. Landfill Cap (continued)

--	--	--	--	--

Access Roads

- bare areas, dead/dying veg.
- erosion
- potholes or puddles
- obstruction

None

3. Wetlands (Area "F")

- dead/dying vegetation
- change in water budget
- general condition of wetlands

None

4. Other Site Systems

Perimeter Fence

--	--	--	--

- integrity of fence
- integrity of gates
- integrity of locks
- placement and condition of signs

NA

FORM 17

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

LOCATION: Wheatfield, New York

DATE:

11	22	67
MM	DD	YY

PROJECT NAME: Gratwick-Riverside Park Site

INSPECTOR(S): *[Signature]*

Comments

Action Required

Item

Inspect For

4. Other Site Systems (continued)

Drainage Ditches/
Swale Outlets

- sediment build-up
- erosion
- condition of erosion protection
- flow obstructions
- dead/dying vegetation
- cable concrete/ gabion mats and riprap

Culverts

- sediment build-up
- erosion
- condition of erosion protection
- flow obstructions

Gas Vents

Wells

- intact / damage
- locks secure

NONE

N/A
Good

FORM 17

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

PROJECT NAME: Gratwick-Riverside Park Site

LOCATION: Wheatfield, New York

DATE: 11/21/23
(MM DD YY)

INSPECTOR(S):

D. Cusla

Comments

Action Required

1. Perimeter Collection System/Off-Site Forcemain

Manholes

- cover on securely
- condition of cover
- condition of inside of manhole
- flow conditions

NONE

Wet Wells

- cover on securely
- condition of cover
- condition of inside of wet well

[Handwritten mark]

2. Landfill Cap

Vegetated Soil Cover

- erosion
- bare areas
- washouts
- leachate seeps
- length of vegetation
- dead/ dying vegetation

NONE

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

LOCATION: Wheatfield, New York

DATE: 11/21/05
(MM DD YY)

PROJECT NAME: Gratwick-Riverside Park Site

INSPECTOR(S): D. Calk

Comments

Action Required

Item

Inspect For

2. Landfill Cap (continued)

Access Roads

- bare areas, dead/dying veg.
- erosion
- potholes or puddles
- obstruction

NONE

3. Wetlands (Area "F")

- dead/dying vegetation
- change in water budget
- general condition of wetlands

NONE

4. Other Site Systems

Perimeter Fence

- integrity of fence
- integrity of gates
- integrity of locks
- placement and condition of signs

FORM 17

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

PROJECT NAME: Gratwick-Riverside Park Site
LOCATION: Wheatfield, New York
DATE: 11/21/2016
(MM DD YY)

INSPECTOR(S): D. Carr

Item

Inspect For

Action Required

Comments

4. Other Site Systems (continued)

- Drainage Ditches / Swale Outlets
- sediment build-up
- erosion
- condition of erosion protection
- flow obstructions
- dead / dying vegetation
- cable concrete / gabion mats and riprap

NONE

Culverts

- sediment build-up
- erosion
- condition of erosion protection
- flow obstructions

Gas Vents Wells

- intact / damage
- locks secure

NONE

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

PROJECT NAME: Gratwick-Riverside Park Site

LOCATION: Wheatfield, New York

INSPECTOR(S): D. Tyson D. Carr

DATE: 10/12/10
(MM DD YY)

Comments

Action Required

1. Perimeter Collection System/Off-Site Forcemain

Manholes

- cover on securely
- condition of cover
- condition of inside of manhole
- flow conditions

☒ ☒ ☒ ☒

None

Wet Wells

- cover on securely
- condition of cover
- condition of inside of wet well

☒ ☒ ☒

2. Landfill Cap

Vegetated Soil Cover

- erosion
- bare areas
- washouts
- leachate seeps
- length of vegetation
- dead/ dying vegetation

☒ ☒ ☒ ☒ ☒ ☒

FORM 17

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

PROJECT NAME: Gratwick-Riverside Park Site

LOCATION: Wheatfield, New York

INSPECTOR(S): D. Tylan D. Canna

DATE: 01/27/02
(MM DD YY)

Comments

Action Required

Inspect For

Item

2. Landfill Cap (continued)

☒	☒	☒	☒
-------------------------------------	-------------------------------------	-------------------------------------	-------------------------------------

Access Roads

- bare areas, dead/dying veg.

- erosion

- potholes or puddles

- obstruction

3. Wetlands (Area "F")

- dead/dying vegetation

- change in water budget

- general condition of wetlands

4. Other Site Systems

☐	☐	☐	☐
--------------------------	--------------------------	--------------------------	--------------------------

Perimeter Fence

- integrity of fence

- integrity of gates

- integrity of locks

- placement and condition of signs

FORM 17

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

PROJECT NAME: Gratwick-Riverside Park Site

LOCATION: Wheatfield, New York

DATE: 01/27/06
(MM DD YY)

INSPECTOR(S): D. Tyran D. Cana

Comments

Action Required

Item

Inspect For

4. Other Site Systems (continued)

☒ ☒ ☒ ☒ ☒ ☒

Drainage Ditches/
Swale Outlets

- sediment build-up
- erosion

- condition of erosion protection

- flow obstructions

- dead/dying vegetation

- cable concrete/gabion mats and
riprap

Cut-verts

- sediment build-up
- erosion

- condition of erosion protection

- flow obstructions

Gas Vents

Wells

- intact/damage

- locks secure

Good Condition

FORM 17

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

PROJECT NAME: Gratwick-Riverside Park Site

LOCATION: Wheatfield, New York

INSPECTOR(S):

D. Tyan D. Cerna

DATE: 02/28/06
(MM DD YY)

Item	Inspect For	Action Required	Comments
1. Perimeter Collection System/Off-Site Force Main			
Manholes	- cover on securely	None	
	- condition of cover		
	- condition of inside of manhole		
	- flow conditions		
Wet Wells	- cover on securely		
	- condition of cover		
	- condition of inside of wet well		
2. Landfill Cap			
Vegetated Soil Cover	- erosion		
	- bare areas		
	- washouts		
	- leachate seeps		
	- length of vegetation		
	- dead/dying vegetation		

FORM 17

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

PROJECT NAME: Gratick-Riverside Park Site

LOCATION: Wheatfield, New York

INSPECTOR(S):

D. Tyran

D. Carra

DATE: 10/22/2016
(MM DD YY)

Comments

Item

Inspect For

Action Required

2. Landfill Cap (continued)

X	X	X	X
---	---	---	---

Access Roads

- bare areas, dead/dying veg.

- erosion

- potholes or puddles

- obstruction

None

3. Wetlands (Area "F")

- dead/dying vegetation

- change in water budget

- general condition of wetlands

4. Other Site Systems

--	--	--	--

Perimeter Fence

- integrity of fence

- integrity of gates

- integrity of locks

- placement and condition of signs

FORM 17

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

PROJECT NAME: Gratwick-Riverside Park Site

LOCATION: Wheatfield, New York

INSPECTOR(S):

D. Tyran D. Carr

DATE: 01/22/2016
(MM DD YY)

Comments

Action Required

4. Other Site Systems (continued)

☒	☒	☒	☒	☒	☒
-------------------------------------	-------------------------------------	-------------------------------------	-------------------------------------	-------------------------------------	-------------------------------------

Drainage Ditches/
Swale Outlets

- sediment build-up
- erosion
- condition of erosion protection
- flow obstructions
- dead/dying vegetation
- cable concrete/gabion mats and riprap

Good condition

☐	☐	☐	☐	☐	☐
--------------------------	--------------------------	--------------------------	--------------------------	--------------------------	--------------------------

Sulverts

- sediment build-up
- erosion
- condition of erosion protection
- flow obstructions

☐	☒
--------------------------	-------------------------------------

Gas Vents

Wells

- Intact/damage
- locks secure

FORM 17

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

PROJECT NAME: Gratwick-Riverside Park Site

LOCATION: Wheatfield, New York

INSPECTOR(S): D. Tyan

D. Cama

DATE: 03/24/06
(MM DD YY)

Item	Inspect For	Action Required	Comments
1. Perimeter Collection System/Off-Site Forcemain			
Manholes	- cover on securely - condition of cover - condition of inside of manhole - flow conditions	None	
Wet Wells	- cover on securely - condition of cover - condition of inside of wet well		
2. Landfill Cap			
Vegetated Soil Cover	- erosion - bare areas - washouts - leachate seeps - length of vegetation - dead/dying vegetation		

FORM 17

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

PROJECT NAME: Gratwick-Riverside Park Site LOCATION: Wheatfield, New York

INSPECTOR(S): D. Tyran D. Cava DATE: 03/24/06
(MM DD YY)

Comments

Action Required

Item

Inspect For

2. Landfill Cap (continued)

X	X	X	X
---	---	---	---

Access Roads

- bare areas, dead/dying veg.

- erosion

- potholes or puddles

- obstruction

None

3. Wetlands (Area "F")

- dead/dying vegetation

- change in water budget

- general condition of wetlands

None

4. Other Site Systems

--	--	--	--

Perimeter Fence

- integrity of fence

- integrity of gates

- integrity of locks

- placement and condition of signs

FORM 17

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

PROJECT NAME: Gratwick-Riverside Park Site

LOCATION: Wheatfield, New York

DATE: 10/3/24
(MM DD YY)

INSPECTOR(S): D. Tyan D. Conna

Item	Inspect For	Action Required	Comments
4. Other Site Systems (continued)			
Drainage Ditches/ Swale Outlets ☒ - sediment build-up ☒ - erosion ☒ - condition of erosion protection ☒ - flow obstructions ☒ - dead/dying vegetation ☒ - cable concrete/gabion mats and riprap	Good condition		
Culverts ☐ - sediment build-up ☐ - erosion ☐ - condition of erosion protection ☐ - flow obstructions			
Gas Vents Wells ☐ - intact/damage ☒ - locks secure			

FORM 17

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

PROJECT NAME: Gratwick-Riverside Park Site

LOCATION: Wheatfield, New York

INSPECTOR(S): D. Tyran D. Canna

DATE: 04/21/06
(MM DD YY)

Item	Inspect For	Action Required	Comments
1. Perimeter Collection System/Off-Site Foremain			
Manholes	- cover on securely - condition of cover - condition of inside of manhole - flow conditions	None	
Wet Wells	- cover on securely - condition of cover - condition of inside of wet well		
2. Landfill Cap			
Vegetated Soil Cover	- erosion - bare areas - washouts - leachate seeps - length of vegetation - dead/dying vegetation		

FORM 17

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

PROJECT NAME: Gratwick-Riverside Park Site LOCATION: Wheatfield, New York
 INSPECTOR(S): D. Tyran D. Cava DATE: 10/4/21 10:40 (MM DD YY)

Comments

Action Required

2. Landfill Cap (continued)

X	X	X	X
---	---	---	---

- bare areas, dead/dying veg.
- erosion
- potholes or puddles
- obstruction

None

3. Wetlands (Area "F")

- dead/dying vegetation
- change in water budget
- general condition of wetlands

✓

4. Other Site Systems

--	--	--	--

- Perimeter Fence
- integrity of fence
- integrity of gates
- integrity of locks
- placement and condition of signs

FORM 17

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

PROJECT NAME: Gratwick-Riverside Park Site LOCATION: Wheatfield, New York
 INSPECTOR(S): D. Tyson D. Cana DATE: 09/21/06
 (MM DD YY)

Comments

Action Required

Item

Inspect For

4. Other Site Systems (continued)

Drainage Ditches/
Swale Outlets

- sediment build-up
- erosion

- condition of erosion protection

- flow obstructions

- dead/dying vegetation

- cable concrete/gabion mats and tripap

Culverts

- sediment build-up

- erosion

- condition of erosion protection

- flow obstructions

Gas Vents

- intact/damage

Wells

- locks secure

Good condition

FORM 17

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

PROJECT NAME: Gratwick-Riverside Park Site

LOCATION: Wheatfield, New York

INSPECTOR(S):

D. Tyran D. Cana

DATE: 05/31/06
(MM DD YY)

Item	Inspect For	Action Required	Comments
1.	Perimeter Collection System/Off-Site Foremain		
	Manholes		
	- cover on securely	None	
	- condition of cover		
	- condition of inside of manhole		
	- flow conditions		
	Wet Wells		
	- cover on securely		
	- condition of cover		
	- condition of inside of wet well		
2.	Landfill Cap		
	Vegetated Soil Cover		
	- erosion		
	- bare areas		
	- washouts		
	- leachate seeps		
	- length of vegetation		
	- dead/dying vegetation		

FORM 17

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

PROJECT NAME: Gratwick-Riverside Park Site

LOCATION: Wheatfield, New York

DATE: 05/30/06
(MM DD YY)

INSPECTOR(S): D. Tyan D. Canna

Comments

Action Required

Item

Inspect For

2. Landfill Cap (continued)

☒ ☒ ☒ ☒

Access Roads

- bare areas, dead/dying veg.

- erosion

- potholes or puddles

- obstruction

None

3. Wetlands (Area "F")

- dead/dying vegetation

- change in water budget

- general condition of wetlands

X

4. Other Site Systems

☐ ☐ ☐ ☐

Perimeter fence

- integrity of fence

- integrity of gates

- integrity of locks

- placement and condition of signs

FORM 17

GRATWICK-RIVERSIDE PARK SITE MONTHLY INSPECTION LOG

PROJECT NAME: Gratwick-Riverside Park Site LOCATION: Wheatfield, New York

DATE: 01/30/16
(MM DD YY)

INSPECTOR(S): D. Tyran D. Cava

Item	Inspect For	Action Required	Comments
4. ☒ ☒ ☒ ☒ ☒ ☒ ☒	Other Site Systems (continued)		
Drainage Ditches/ Swale Outlets	- sediment build-up - erosion - condition of erosion protection - flow obstructions - dead/dying vegetation - cable concrete/gabion mats and riprap		
☒ ☒ ☒ ☒ ☒ ☒ ☒	Culverts - sediment build-up - erosion - condition of erosion protection - flow obstructions		
☒ ☒ ☒ ☒ ☒ ☒ ☒	Gas Vents Wells	- intact / damage - locks secure	

FORM 17

APPENDIX B

QA/QC REVIEWS



**CONESTOGA-ROVERS
& ASSOCIATES**

2055 Niagara Falls Blvd., Suite #3
Niagara Falls, New York 14304
Telephone: (716) 297-6150 Fax: (716) 297-2265
www.CRAworld.com

MEMORANDUM

TO: Klaus Schmidtke

REF. NO.: 7987

FROM: Susan C. Scrocchi/js/66 JCS/JS

DATE: June 30, 2005

E-Mail and Interoffice Mail

RE: **Analytical Results and QA/QC Review
Monthly Wastewater Treatment Plant Sampling
May 2005**

**PREVIOUSLY TRANSMITTED
BY E-MAIL**

INTRODUCTION

One effluent sample was collected in support of the Monthly Wastewater Treatment Plant Sampling at the Gratwick-Riverside Park Site (Site) during May 2005. The sample was submitted to Severn Trent Laboratories (STL) in Amherst, New York, and analyzed for the following:

<i>Parameter</i>	<i>Methodology¹</i>
Site-Specific Volatile Organic Compounds (VOCs)	EPA 624
Site-Specific Semi-Volatile Organic Compounds (SVOCs)	EPA 625
Target Compound List (TCL) Metals	EPA 200.7
Sulfate	EPA 300.0
Chloride	EPA 300.0
Alkalinity	EPA 310.2
Nitrate	EPA 353.2
Sulfide	EPA 376.1
Total Dissolved Solids (TDS)	EPA 160.1
Total Hardness	EPA 130.2

The analytical results are summarized in Table 1. The quality assurance/quality control (QA/QC) criteria by which these data have been assessed are outlined in the analytical methods, the "USEPA Contract Laboratory National Functional Guidelines for Organic Data Review" (October 1999), and the "National Functional Guidelines for Inorganic Data Review" (February 1994).

Data assessment was based on information obtained from final data sheets, blank data, duplicate results, surrogate recoveries, and spike recoveries.

¹ "Methods for Chemical Analysis of Water and Wastes", EPA 600/4-79-220, March 1983.

QA/QC REVIEW

All samples were prepared and/or analyzed within the method specified holding times.

Surrogates were added to all samples, blanks, and QC samples prior to extraction and/or analysis for VOCs and SVOCs. All VOC and SVOC surrogate recoveries met the method criteria indicating acceptable analytical efficiency.

Method blanks were extracted and/or analyzed for all parameters and all results were non-detect for the compounds of interest indicating that no compounds were introduced to the samples during preparation and/or analysis.

Blank spikes (BS) were prepared and analyzed for all parameters. All recoveries were acceptable indicating good analytical accuracy with the exception of a high antimony and 1,1-dichloroethane recovery. Sample results were non-detect and would not have been impacted by the implied high bias.

A matrix spike/matrix spike duplicate (MS/MSD) was prepared and analyzed for VOCs. All results were acceptable indicating good analytical accuracy and precision with the exception of variability between vinyl chloride recoveries. The associated results were non-detect and would not have been impacted by the implied variability.

CONCLUSION

Based on the preceding assessment, the data were acceptable without qualification.

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTER WATER SAMPLING
GRATWICK
MAY 2005

<i>Sample Location:</i>		<i>Effluent</i>
<i>Sample ID:</i>		GRATWICK RIVERSIDE
<i>Sample Date:</i>		5/6/2005
<i>Parameters:</i>	<i>Units</i>	
<i>Volatile Organic Compounds</i>		
1,1,1-Trichloroethane	µg/L	13 U
1,1-Dichloroethane	µg/L	8.4 U
1,2-Dichloroethane	µg/L	8.5 U
2-Butanone (Methyl Ethyl Ketone)	µg/L	46 U
Acetone	µg/L	100 U
Benzene	µg/L	11 U
Chlorobenzene	µg/L	9.0 U
Ethylbenzene	µg/L	0.28 U
Methylene chloride	µg/L	35 U
Styrene	µg/L	26 U
Tetrachloroethene	µg/L	13 U
Toluene	µg/L	14
trans-1,2-Dichloroethene	µg/L	15 U
Trichloroethene	µg/L	39
Vinyl chloride	µg/L	14 U
Xylene (total)	µg/L	69 U
<i>Semi-Volatile Organic Compounds</i>		
1,2-Dichlorobenzene	µg/L	16 U
1,4-Dichlorobenzene	µg/L	15 U
2,4-Dimethylphenol	µg/L	12 U
2-Methylphenol	µg/L	15 U
4-Methylphenol	µg/L	15 U
Di-n-octyl phthalate	µg/L	27 U
Naphthalene	µg/L	19
Phenol	µg/L	68
<i>Metals</i>		
Aluminum	mg/L	0.20 U
Antimony	mg/L	0.020 U
Arsenic	mg/L	0.010 U
Barium	mg/L	0.088
Beryllium	mg/L	0.0020 U
Cadmium	mg/L	0.0010 U
Chromium Total	mg/L	0.0040 U
Copper	mg/L	0.010 U
Iron	mg/L	0.22
Lead	mg/L	0.0050 U
Magnesium	mg/L	6.3
Manganese	mg/L	0.053
Mercury	mg/L	0.00020 U
Nickel	mg/L	0.010 U
Selenium	mg/L	0.015 U
Silver	mg/L	0.0030 U
Sodium	mg/L	347
Zinc	mg/L	0.020 U

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTER WATER SAMPLING
GRATWICK
MAY 2005

<i>Sample Location:</i>		<i>Effluent</i>
<i>Sample ID:</i>		GRATWICK RIVERSIDE
<i>Sample Date:</i>		5/6/2005
<i>Parameters:</i>	<i>Units</i>	
<i>General Chemistry</i>		
Alkalinity, Total (As CaCO ₃)	mg/L	43.5
Ammonia	mg/L	1.05
Bicarbonate (as CaCO ₃)	mg/L	43.5
Biochemical Oxygen Demand (BOD)	mg/L	10
Chemical Oxygen Demand (COD)	mg/L	35
Chloride	mg/L	883
Cyanide (total)	mg/L	0.005 U
Hardness	mg/L	400
Nitrate (as N)	mg/L	0.050 U
Oil and Grease	mg/L	1.00 U
pH (water)	s.u.	9.30
Phenolics (Total)	mg/L	0.012 U
Phosphorus	mg/L	0.13
Sulfate	mg/L	279
Sulfide	mg/L	1.0 U
Total Dissolved Solids (TDS)	mg/L	1540
Total Kjeldahl Nitrogen (TKN)	mg/L	1.40
Total Organic Carbon (TOC)	mg/L	9
Total Suspended Solids (TSS)	mg/L	21
Volatile Suspended Solids	mg/L	11

Note:

U Non-detect at associated value.



**CONESTOGA-ROVERS
& ASSOCIATES**

2055 Niagara Falls Blvd., Suite #3
Niagara Falls, New York 14304
Telephone: (716) 297-6150 Fax: (716) 297-2265
www.CRAworld.com

MEMORANDUM

TO: Klaus Schmidtke

REF. NO.: 7987 [7987DM-95]

FROM: Susan C. Scrocchi/js/68 *SCS/JS*

DATE: August 10, 2005

E-Mail and Interoffice Mail

RE: Analytical Results and QA/QC Review
Monthly Wastewater Treatment Plant Sampling
June 2005

**PREVIOUSLY TRANSMITTED
BY E-MAIL**

INTRODUCTION

One effluent sample was collected in support of the Monthly Wastewater Treatment Plant Sampling at the Gratwick-Riverside Park Site (Site) during June 2005. The sample was submitted to Severn Trent Laboratories (STL) in Amherst, New York, and analyzed for the following:

<i>Parameter</i>	<i>Methodology¹</i>
Site-Specific Volatile Organic Compounds (VOCs)	EPA 624
Site-Specific Semi-Volatile Organic Compounds (SVOCs)	EPA 625
Target Compound List (TCL) Metals	EPA 200.7
Sulfate	EPA 300.0
Chloride	EPA 300.0
Alkalinity	EPA 310.2
Nitrate	EPA 353.2
Sulfide	EPA 376.1
Total Dissolved Solids (TDS)	EPA 160.1
Total Hardness	EPA 130.2

The analytical results are summarized in Table 1. The quality assurance/quality control (QA/QC) criteria by which these data have been assessed are outlined in the analytical methods, the "USEPA Contract Laboratory National Functional Guidelines for Organic Data Review" (October 1999), and the "National Functional Guidelines for Inorganic Data Review" (February 1994).

Data assessment was based on information obtained from final data sheets, blank data, duplicate results, surrogate recoveries, and spike recoveries.

¹ "Methods for Chemical Analysis of Water and Wastes", EPA 600/4-79-220, March 1983.

QA/QC REVIEW

All samples were prepared and/or analyzed within the method specified holding times.

Surrogates were added to all samples, blanks, and QC samples prior to extraction and/or analysis for VOCs and SVOCs. All VOC and SVOC surrogate recoveries met the method criteria indicating acceptable analytical efficiency.

Method blanks were extracted and/or analyzed for all parameters and all results were non-detect for the compounds of interest indicating that no compounds were introduced to the samples during preparation and/or analysis.

Blank spikes (BS) were prepared and analyzed for all parameters. All recoveries were acceptable indicating good analytical accuracy.

CONCLUSION

Based on the preceding assessment, the data were acceptable without qualification.

TABLE 1

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTER WATER SAMPLING
GRATWICK PARK SITE
JUNE 2005

	<i>Sample Location:</i>	<i>Effluent</i>
	<i>Sample ID:</i>	GRATWICK RIVERSIDE
	<i>Sample Date:</i>	6/10/2005
<i>Parameters</i>	<i>Units</i>	
<i>Volatile Organic Compounds</i>		
1,1,1-Trichloroethane	µg/L	2.6 U
1,1-Dichloroethane	µg/L	9.0
1,2-Dichloroethane	µg/L	1.7 U
2-Butanone (Methyl Ethyl Ketone)	µg/L	9.3 U
Acetone	µg/L	30
Benzene	µg/L	2.5
Chlorobenzene	µg/L	1.8 U
Ethylbenzene	µg/L	9.0
Methylene chloride	µg/L	7.0 U
Styrene	µg/L	5.2 U
Tetrachloroethene	µg/L	24
Toluene	µg/L	45
trans-1,2-Dichloroethene	µg/L	3.0 U
Trichloroethene	µg/L	140
Vinyl chloride	µg/L	5.1
Xylene (total)	µg/L	46
<i>Semi-Volatile Organic Compounds</i>		
1,2-Dichlorobenzene	µg/L	1
1,4-Dichlorobenzene	µg/L	1
2,4-Dimethylphenol	µg/L	5
2-Methylphenol	µg/L	6
4-Methylphenol	µg/L	12
Di-n-octyl phthalate	µg/L	0.8 U
Naphthalene	µg/L	0.8 U
Phenol	µg/L	0.4 U
<i>Metals</i>		
Aluminum	mg/L	0.20 U
Antimony	mg/L	0.020 U
Arsenic	mg/L	0.010 U
Barium	mg/L	0.067
Beryllium	mg/L	0.0020 U
Cadmium	mg/L	0.0010 U
Chromium Total	mg/L	0.0040 U
Copper	mg/L	0.010 U
Iron	mg/L	0.050 U
Lead	mg/L	0.0050 U
Magnesium	mg/L	0.50
Manganese	mg/L	0.0030 U
Mercury	mg/L	0.00020 U
Nickel	mg/L	0.010 U
Selenium	mg/L	0.015 U
Silver	mg/L	0.0030 U
Sodium	mg/L	289
Zinc	mg/L	0.020 U

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTER WATER SAMPLING
GRATWICK PARK SITE
JUNE 2005

Sample Location: Effluent
Sample ID: GRATWICK RIVERSIDE
Sample Date: 6/10/2005

<i>Parameters</i>	<i>Units</i>	
<i>General Chemistry</i>		
Alkalinity, Total (As CaCO ₃)	mg/L	99.2
Ammonia	mg/L	0.35
Bicarbonate (as CaCO ₃)	mg/L	10 U
Biochemical Oxygen Demand (BOD)	mg/L	11
Chemical Oxygen Demand (COD)	mg/L	51
Chloride	mg/L	729
Cyanide (total)	mg/L	0.005 U
Hardness	mg/L	352
Nitrate (as N)	mg/L	0.050 U
Oil and Grease	mg/L	0.28
pH (water)	s.u.	11.13
Phenolics (Total)	mg/L	0.009 U
Phosphorus	mg/L	0.08
Sulfate	mg/L	276
Sulfide	mg/L	1.0 U
Total Dissolved Solids (TDS)	mg/L	1370
Total Kjeldahl Nitrogen (TKN)	mg/L	0.28
Total Organic Carbon (TOC)	mg/L	10
Total Suspended Solids (TSS)	mg/L	12
Volatile Suspended Solids	mg/L	4

Note:

U Non-detect at associated value.



**CONESTOGA-ROVERS
& ASSOCIATES**

2055 Niagara Falls Blvd., Suite #3
Niagara Falls, New York 14304
Telephone: (716) 297-6150 Fax: (716) 297-2265
www.CRAworld.com

MEMORANDUM

TO: Klaus Schmidtke

REF. NO.: 7987DM

FROM: Susan C. Scrocchi/js/69 *scs/js*

DATE: September 7, 2005

E-Mail and Interoffice Mail

RE: Analytical Results and QA/QC Review
Monthly Wastewater Treatment Plant Sampling
July 2005

**PREVIOUSLY TRANSMITTED
BY E-MAIL**

INTRODUCTION

One effluent sample was collected in support of the Monthly Wastewater Treatment Plant Sampling at the Gratwick-Riverside Park Site (Site) during July 2005. The sample was submitted to Severn Trent Laboratories (STL) in Amherst, New York, and analyzed for the following:

<i>Parameter</i>	<i>Methodology¹</i>
Site-Specific Volatile Organic Compounds (VOCs)	EPA 624
Site-Specific Semi-Volatile Organic Compounds (SVOCs)	EPA 625
Target Compound List (TCL) Metals	EPA 200.7
Sulfate	EPA 300.0
Chloride	EPA 300.0
Alkalinity	EPA 310.2
Nitrate	EPA 353.2
Sulfide	EPA 376.1
Total Dissolved Solids (TDS)	EPA 160.1
Total Hardness	EPA 130.2

The analytical results are summarized in Table 1. The quality assurance/quality control (QA/QC) criteria by which these data have been assessed are outlined in the analytical methods, the "USEPA Contract Laboratory National Functional Guidelines for Organic Data Review" (October 1999), and the "National Functional Guidelines for Inorganic Data Review" (February 1994).

Data assessment was based on information obtained from final data sheets, blank data, duplicate results, surrogate recoveries, and spike recoveries.

¹ "Methods for Chemical Analysis of Water and Wastes", EPA 600/4-79-220, March 1983.

QA/QC REVIEW

All samples were prepared and/or analyzed within the method specified holding times.

Surrogates were added to all samples, blanks, and QC samples prior to extraction and/or analysis for VOCs and SVOCs. All VOC and SVOC surrogate recoveries met the method criteria indicating acceptable analytical efficiency.

Method blanks were extracted and/or analyzed for all parameters and all results were non-detect for the compounds of interest indicating that no compounds were introduced to the samples during preparation and/or analysis.

Blank spikes (BS) were prepared and analyzed for all parameters. All recoveries were acceptable indicating good analytical accuracy.

Matrix spikes (MS) were prepared and analyzed for sulfate and sulfide. All recoveries were acceptable indicating good analytical accuracy.

CONCLUSION

Based on the preceding assessment, the data were acceptable without qualification.

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTER WATER SAMPLING
GRATWICK
JULY 2005

<i>Sample Location:</i>		<i>Effluent</i>
<i>Sample ID:</i>		GRATWICK RIVERSIDE
<i>Sample Date:</i>		7/8/2005
<i>Parameters</i>	<i>Units</i>	
<i>Volatile Organic Compounds</i>		
1,1,1-Trichloroethane	µg/L	6.6 U
1,1-Dichloroethane	µg/L	4.2 U
1,2-Dichloroethane	µg/L	4.2 U
2-Butanone (Methyl Ethyl Ketone)	µg/L	23 U
Acetone	µg/L	53 U
Benzene	µg/L	5.5 U
Chlorobenzene	µg/L	5.5
Ethylbenzene	µg/L	8.4
Methylene chloride	µg/L	17 U
Styrene	µg/L	13 U
Tetrachloroethene	µg/L	34
Toluene	µg/L	40
trans-1,2-Dichloroethene	µg/L	7.6 U
Trichloroethene	µg/L	100
Vinyl chloride	µg/L	7.1 U
Xylene (total)	µg/L	35
<i>Semi-Volatile Organic Compounds</i>		
1,2-Dichlorobenzene	µg/L	1 U
1,4-Dichlorobenzene	µg/L	1
2,4-Dimethylphenol	µg/L	3
2-Methylphenol	µg/L	4
4-Methylphenol	µg/L	10
Di-n-octyl phthalate	µg/L	0.8 U
Naphthalene	µg/L	0.8 U
Phenol	µg/L	7
<i>Metals</i>		
Aluminum	mg/L	0.20 U
Antimony	mg/L	0.020 U
Arsenic	mg/L	0.010 U
Barium	mg/L	0.055
Beryllium	mg/L	0.0020 U
Cadmium	mg/L	0.0010 U
Chromium Total	mg/L	0.0040 U
Copper	mg/L	0.010 U
Iron	mg/L	0.050 U
Lead	mg/L	0.0050 U
Magnesium	mg/L	2.8
Manganese	mg/L	0.0068
Mercury	mg/L	0.00020 U
Nickel	mg/L	0.010 U
Selenium	mg/L	0.015 U
Silver	mg/L	0.0030 U
Sodium	mg/L	229
Zinc	mg/L	0.020 U

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTER WATER SAMPLING
GRATWICK
JULY 2005

Sample Location: Effluent
Sample ID: GRATWICK RIVERSIDE
Sample Date: 7/8/2005

Parameters	Units	
<i>General Chemistry</i>		
Alkalinity, Total (As CaCO ₃)	mg/L	36.3
Ammonia	mg/L	0.35
Bicarbonate (as CaCO ₃)	mg/L	36.3
Biochemical Oxygen Demand (BOD)	mg/L	14
Chemical Oxygen Demand (COD)	mg/L	56
Chloride	mg/L	516
Cyanide (total)	mg/L	0.005 U
Hardness	mg/L	275
Nitrate (as N)	mg/L	0.050 U
Oil and Grease	mg/L	1.0 U
pH (water)	s.u.	8.42
Phenolics (Total)	mg/L	0.009 U
Phosphorus	mg/L	0.08
Sulfate	mg/L	223
Sulfide	mg/L	1.0 U
Total Dissolved Solids (TDS)	mg/L	1110
Total Kjeldahl Nitrogen (TKN)	mg/L	0.56
Total Organic Carbon (TOC)	mg/L	5.1
Total Suspended Solids (TSS)	mg/L	11
Volatile Suspended Solids	mg/L	6

Note:

U Non-detect at associated value.



**CONESTOGA-ROVERS
& ASSOCIATES**

2055 Niagara Falls Blvd., Suite #3
Niagara Falls, New York 14304
Telephone: (716) 297-6150 Fax: (716) 297-2265
www.CRAworld.com

MEMORANDUM

TO: Klaus Schmidtke

REF. NO.: 7987DM

FROM: Susan C. Scrocchi/cs/70 SS (u)

DATE: October 4, 2005

E-Mail and Interoffice Mail

RE: **Analytical Results and QA/QC Review
Monthly Wastewater Treatment Plant Sampling
August 2005**

INTRODUCTION

One effluent sample was collected in support of the Monthly Wastewater Treatment Plant Sampling at the Gratwick-Riverside Park Site (Site) during August 2005. The sample was submitted to Severn Trent Laboratories (STL) in Amherst, New York, and analyzed for the following:

<i>Parameter</i>	<i>Methodology¹</i>
Site-Specific Volatile Organic Compounds (VOCs)	EPA 624
Site-Specific Semi-Volatile Organic Compounds (SVOCs)	EPA 625
Target Compound List (TCL) Metals	EPA 200.7
Sulfate	EPA 300.0
Chloride	EPA 300.0
Alkalinity	EPA 310.2
Nitrate	EPA 353.2
Sulfide	EPA 376.1
Total Dissolved Solids (TDS)	EPA 160.1
Total Hardness	EPA 130.2

The analytical results are summarized in Table 1. The quality assurance/quality control (QA/QC) criteria by which these data have been assessed are outlined in the analytical methods, the "USEPA Contract Laboratory National Functional Guidelines for Organic Data Review" (October 1999), and the "National Functional Guidelines for Inorganic Data Review" (February 1994).

Data assessment was based on information obtained from final data sheets, blank data, duplicate results, surrogate recoveries, and spike recoveries.

¹ "Methods for Chemical Analysis of Water and Wastes", EPA 600/4-79-220, March 1983.

QA/QC REVIEW

All samples were prepared and/or analyzed within the method specified holding times.

Surrogates were added to all samples, blanks, and QC samples prior to extraction and/or analysis for VOCs and SVOCs. All VOC and SVOC surrogate recoveries met the method criteria indicating acceptable analytical efficiency.

Method blanks were extracted and/or analyzed for all parameters and all results were non-detect for the compounds of interest indicating that no compounds were introduced to the samples during preparation and/or analysis.

Blank spikes (BS) were prepared and analyzed for all parameters. All recoveries were acceptable indicating good analytical accuracy.

CONCLUSION

Based on the preceding assessment, the data were acceptable without qualification.

**ANALYTICAL RESULTS SUMMARY
MONTHLY WASTE WATER SAMPLING
GRATWICK
AUGUST 2005**

<i>Sample Location:</i>	<i>Effluent</i>
<i>Sample ID:</i>	GRATWICK RIVERSIDE
<i>Sample Date:</i>	8/5/2005

<i>Parameters:</i>	<i>Units</i>	
<i>Volatile Organic Compounds</i>		
1,1,1-Trichloroethane	µg/L	1.3 U
1,1-Dichloroethane	µg/L	6.6
1,2-Dichloroethane	µg/L	0.85 U
2-Butanone (Methyl Ethyl Ketone)	µg/L	4.6 U
Acetone	µg/L	10 U
Benzene	µg/L	1.3
Chlorobenzene	µg/L	2.6
Ethylbenzene	µg/L	9.4
Methylene chloride	µg/L	3.5 U
Styrene	µg/L	2.6 U
Tetrachloroethene	µg/L	28
Toluene	µg/L	44
trans-1,2-Dichloroethene	µg/L	1.5 U
Trichloroethene	µg/L	90
Vinyl chloride	µg/L	1.4 U
Xylene (total)	µg/L	46
<i>Semi-volatile Organic Compounds</i>		
1,2-Dichlorobenzene	µg/L	1 U
1,4-Dichlorobenzene	µg/L	1
2,4-Dimethylphenol	µg/L	4
2-Methylphenol	µg/L	7
4-Methylphenol	µg/L	15
Di-n-octyl phthalate	µg/L	0.9 U
Naphthalene	µg/L	3
Phenol	µg/L	9
<i>Metals</i>		
Aluminum	mg/L	0.20 U
Antimony	mg/L	0.020 U
Arsenic	mg/L	0.010 U
Barium	mg/L	0.063
Beryllium	mg/L	0.0020 U
Cadmium	mg/L	0.0010 U
Chromium Total	mg/L	0.0040 U
Copper	mg/L	0.010 U
Iron	mg/L	0.050 U
Lead	mg/L	0.0050 U
Magnesium	mg/L	1.8
Manganese	mg/L	0.0030 U
Mercury	mg/L	0.00020 U
Nickel	mg/L	0.010 U
Selenium	mg/L	0.015 U
Silver	mg/L	0.0030 U
Sodium	mg/L	235
Zinc	mg/L	0.020 U

**ANALYTICAL RESULTS SUMMARY
MONTHLY WASTE WATER SAMPLING
GRATWICK
AUGUST 2005**

<i>Sample Location:</i>	<i>Effluent</i>
<i>Sample ID:</i>	GRATWICK RIVERSIDE
<i>Sample Date:</i>	8/5/2005

<i>Parameters:</i>	<i>Units</i>	
<i>Volatile Organic Compounds</i>		
<i>General Chemistry</i>		
Alkalinity, Total (As CaCO ₃)	mg/L	66.0
Ammonia	mg/L	0.70
Bicarbonate (as CaCO ₃)	mg/L	66.0
Biochemical Oxygen Demand (BOD)	mg/L	10
Chemical Oxygen Demand (COD)	mg/L	38
Chloride	mg/L	408
Cyanide (total)	mg/L	0.005 U
Hardness	mg/L	268
Nitrate (as N)	mg/L	0.050 U
Oil and Grease	mg/L	1.0 U
pH (water)	s.u.	10.67
Phenolics (Total)	mg/L	0.007 U
Phosphorus	mg/L	0.11
Sulfate	mg/L	199
Sulfide	mg/L	2.0
Total Dissolved Solids (TDS)	mg/L	1140
Total Kjeldahl Nitrogen (TKN)	mg/L	0.56
Total Organic Carbon (TOC)	mg/L	5.2
Total Suspended Solids (TSS)	mg/L	6
Volatile Suspended Solids	mg/L	5

Notes:

U Not present at or above the associated value.



**CONESTOGA-ROVERS
& ASSOCIATES**

2055 Niagara Falls Blvd., Suite #3
Niagara Falls, New York 14304
Telephone: (716) 297-6150 Fax: (716) 297-2265
www.CRAworld.com

MEMORANDUM

TO: Klaus Schmidtke

FROM: Susan C. Scrocchi/jbh/71 *SCS/jbh*

RE: Analytical Results and QA/QC Review
Monthly Wastewater Treatment Plant Sampling
September 2005

REF. NO.: 7987DM

DATE: November 1, 2005

E-Mail and Interoffice Mail

PREVIOUSLY TRANSMITTED
BY E-MAIL

INTRODUCTION

One effluent sample was collected in support of the Monthly Wastewater Treatment Plant Sampling at the Gratwick-Riverside Park Site (Site) during September 2005. The sample was submitted to Severn Trent Laboratories (STL) in Amherst, New York, and analyzed for the following:

<i>Parameter</i>	<i>Methodology¹</i>
Site-Specific Volatile Organic Compounds (VOCs)	EPA 624
Site-Specific Semi-Volatile Organic Compounds (SVOCs)	EPA 625
Target Compound List (TCL) Metals	EPA 200.7
Sulfate	EPA 300.0
Chloride	EPA 300.0
Alkalinity	EPA 310.2
Nitrate	EPA 353.2
Sulfide	EPA 376.1
Total Dissolved Solids (TDS)	EPA 160.1
Total Hardness	EPA 130.2

The analytical results are summarized in Table 1. The quality assurance/quality control (QA/QC) criteria by which these data have been assessed are outlined in the analytical methods, the "USEPA Contract Laboratory National Functional Guidelines for Organic Data Review" (October 1999), and the "National Functional Guidelines for Inorganic Data Review" (February 1994).

Data assessment was based on information obtained from final data sheets, blank data, duplicate results, surrogate recoveries, and spike recoveries.

¹ "Methods for Chemical Analysis of Water and Wastes", EPA 600/4-79-220, March 1983.

QA/QC REVIEW

All samples were prepared and/or analyzed within the method specified holding times.

Surrogates were added to all samples, blanks, and QC samples prior to extraction and/or analysis for VOCs and SVOCs. All VOC and SVOC surrogate recoveries met the method criteria indicating acceptable analytical efficiency.

Method blanks were extracted and/or analyzed for all parameters and all results were non-detect for the compounds of interest indicating that no compounds were introduced to the samples during preparation and/or analysis.

Blank spikes (BS) were prepared and analyzed for all parameters. All recoveries were acceptable indicating good analytical accuracy with the exception of a low 1,2-dichlorobenzene recovery. The sample results were qualified as estimated to reflect the implied low bias.

CONCLUSION

Based on the preceding assessment, the data were acceptable with the qualifications noted.

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTER WATER SAMPLING
GRATWICK
SEPTEMBER 2005

	<i>Sample Location:</i>	<i>Effluent</i>
	<i>Sample ID:</i>	GRATWICK RIVERSIDE
	<i>Sample Date:</i>	9/9/2005
<i>Parameters</i>	<i>Units</i>	
<i>Volatile Organic Compounds</i>		
1,1,1-Trichloroethane	µg/L	5.2 U
1,1-Dichloroethane	µg/L	5.7
1,2-Dichloroethane	µg/L	3.4 U
2-Butanone (Methyl Ethyl Ketone)	µg/L	19 U
Acetone	µg/L	42 U
Benzene	µg/L	4.4 U
Chlorobenzene	µg/L	4.0
Ethylbenzene	µg/L	4.6
Methylene chloride	µg/L	14 U
Styrene	µg/L	10 U
Tetrachloroethene	µg/L	12
Toluene	µg/L	23
trans-1,2-Dichloroethene	µg/L	6.0 U
Trichloroethene	µg/L	67
Vinyl chloride	µg/L	5.7 U
Xylene (total)	µg/L	28 U
<i>Semi-Volatile Organic Compounds</i>		
1,2-Dichlorobenzene	µg/L	1 UJ
1,4-Dichlorobenzene	µg/L	1
2,4-Dimethylphenol	µg/L	3
2-Methylphenol	µg/L	1
4-Methylphenol	µg/L	0.7 U
Di-n-octyl phthalate	µg/L	0.9 U
Naphthalene	µg/L	0.8 U
Phenol	µg/L	0.4 U
<i>Metals</i>		
Aluminum	mg/L	0.20 U
Antimony	mg/L	0.020 U
Arsenic	mg/L	0.010 U
Barium	mg/L	0.073
Beryllium	mg/L	0.0020 U
Cadmium	mg/L	0.0010 U
Chromium Total	mg/L	0.0040 U
Copper	mg/L	0.010 U
Iron	mg/L	0.17
Lead	mg/L	0.0050 U
Magnesium	mg/L	3.2
Manganese	mg/L	0.022
Mercury	mg/L	0.00020 U
Nickel	mg/L	0.010 U
Selenium	mg/L	0.015 U
Silver	mg/L	0.0030 U
Sodium	mg/L	264
Zinc	mg/L	0.020 U

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTEWATER SAMPLING
GRATWICK
SEPTEMBER 2005

Sample Location: Effluent
Sample ID: GRATWICK RIVERSIDE
Sample Date: 9/9/2005

Parameters	Units	
<i>General Chemistry</i>		
Alkalinity, Total (As CaCO ₃)	mg/L	10.2
Ammonia	mg/L	0.35
Bicarbonate (as CaCO ₃)	mg/L	10.2
Biochemical Oxygen Demand (BOD)	mg/L	12
Chemical Oxygen Demand (COD)	mg/L	47
Chloride	mg/L	451
Cyanide (total)	mg/L	0.005 U
Hardness	mg/L	255
Nitrate (as N)	mg/L	0.050 U
Oil and Grease	mg/L	1.0 U
pH (water)	s.u.	9.91
Phenolics (Total)	mg/L	0.010 U
Phosphorus	mg/L	0.14
Sulfate	mg/L	206
Sulfide	mg/L	2.0
Total Dissolved Solids (TDS)	mg/L	1050
Total Kjeldahl Nitrogen (TKN)	mg/L	0.28
Total Organic Carbon (TOC)	mg/L	5.1
Total Suspended Solids (TSS)	mg/L	6
Volatile Suspended Solids	mg/L	4

Notes:

- U Non-detect at associated value.
 UJ The analyte was not detected above the sample quantitation limit.
 The reported quantitation limit is an estimated quantity.



**CONESTOGA-ROVERS
& ASSOCIATES**

2055 Niagara Falls Blvd., Suite #3
Niagara Falls, New York 14304
Telephone: (716) 297-6150 Fax: (716) 297-2265
www.CRAworld.com

MEMORANDUM

TO: Klaus Schmidtke

REF. NO.: 7987DM-95

FROM: Susan C. Scrocchi/jbh/72 *SCS/jbh*

DATE: December 2, 2005

E-Mail and Interoffice Mail

RE: **Analytical Results and QA/QC Review
Monthly Wastewater Treatment Plant Sampling
October 2005**

**PREVIOUSLY TRANSMITTED
BY E-MAIL**

INTRODUCTION

One effluent sample was collected in support of the Monthly Wastewater Treatment Plant Sampling at the Gratwick-Riverside Park Site (Site) during October 2005. The sample was submitted to Severn Trent Laboratories (STL) in Amherst, New York, and analyzed for the following:

<i>Parameter</i>	<i>Methodology¹</i>
Site-Specific Volatile Organic Compounds (VOCs)	EPA 624
Site-Specific Semi-Volatile Organic Compounds (SVOCs)	EPA 625
Target Compound List (TCL) Metals	EPA 200.7
Sulfate	EPA 300.0
Chloride	EPA 300.0
Alkalinity	EPA 310.2
Nitrate	EPA 353.2
Sulfide	EPA 376.1
Total Dissolved Solids (TDS)	EPA 160.1
Total Hardness	EPA 130.2

The analytical results are summarized in Table 1. The quality assurance/quality control (QA/QC) criteria by which these data have been assessed are outlined in the analytical methods, the "USEPA Contract Laboratory National Functional Guidelines for Organic Data Review" (October 1999), and the "National Functional Guidelines for Inorganic Data Review" (February 1994).

Data assessment was based on information obtained from final data sheets, blank data, duplicate results, surrogate recoveries, and spike recoveries.

¹ "Methods for Chemical Analysis of Water and Wastes", EPA 600/4-79-220, March 1983.

QA/QC REVIEW

All samples were prepared and/or analyzed within the method specified holding times.

Surrogates were added to all samples, blanks, and QC samples prior to extraction and/or analysis for VOCs and SVOCs. All VOC and SVOC surrogate recoveries met the method criteria indicating acceptable analytical efficiency.

Method blanks were extracted and/or analyzed for all parameters and all results were non-detect for the compounds of interest indicating that no compounds were introduced to the samples during preparation and/or analysis.

Blank spikes (BS) were prepared and analyzed for all parameters. All recoveries were acceptable indicating good analytical accuracy.

CONCLUSION

Based on the preceding assessment, the data were acceptable without qualification.

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTER WATER SAMPLING
MILLER SPRINGS REMEDIATION MANAGEMENT, INC.
GRATWICK-RIVERSIDE PARK SITE
OCTOBER 2005

<i>Sample Location:</i>		<i>Effluent</i>
<i>Sample ID:</i>		GRATWICK RIVERSIDE
<i>Sample Date:</i>		10/7/2005
<i>Parameters</i>	<i>Units</i>	
<i>Volatile Organic Compounds</i>		
1,1,1-Trichloroethane	µg/L	5.2 U
1,1-Dichloroethane	µg/L	3.3 U
1,2-Dichloroethane	µg/L	3.4 U
2-Butanone (Methyl Ethyl Ketone)	µg/L	19 U
Acetone	µg/L	42 U
Benzene	µg/L	4.4 U
Chlorobenzene	µg/L	7.5
Ethylbenzene	µg/L	6.6
Methylene chloride	µg/L	14 U
Styrene	µg/L	10 U
Tetrachloroethene	µg/L	17
Toluene	µg/L	25
trans-1,2-Dichloroethene	µg/L	6.0 U
Trichloroethene	µg/L	61
Vinyl chloride	µg/L	6.6
Xylene (total)	µg/L	28 U
<i>Semi-Volatile Organic Compounds</i>		
1,2-Dichlorobenzene	µg/L	1
1,4-Dichlorobenzene	µg/L	2
2,4-Dimethylphenol	µg/L	6
2-Methylphenol	µg/L	5
4-Methylphenol	µg/L	12
Di-n-octyl phthalate	µg/L	0.9 U
Naphthalene	µg/L	0.8 U
Phenol	µg/L	17
<i>Metals</i>		
Aluminum	mg/L	0.20 U
Antimony	mg/L	0.020 U
Arsenic	mg/L	0.010 U
Barium	mg/L	0.082
Beryllium	mg/L	0.0020 U
Cadmium	mg/L	0.0010 U
Chromium Total	mg/L	0.0040 U
Copper	mg/L	0.010 U
Iron	mg/L	0.056
Lead	mg/L	0.0050 U
Magnesium	mg/L	3.4
Manganese	mg/L	0.022
Mercury	mg/L	0.00020 U
Nickel	mg/L	0.010 U
Selenium	mg/L	0.015 U
Silver	mg/L	0.0030 U
Sodium	mg/L	292
Zinc	mg/L	0.032

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTER WATER SAMPLING
MILLER SPRINGS REMEDIATION MANAGEMENT, INC.
GRATWICK-RIVERSIDE PARK SITE
OCTOBER 2005

	<i>Sample Location:</i>	<i>Effluent</i>
	<i>Sample ID:</i>	GRATWICK RIVERSIDE
	<i>Sample Date:</i>	10/7/2005
<i>Parameters</i>	<i>Units</i>	
<i>General Chemistry</i>		
Alkalinity, Total (As CaCO ₃)	mg/L	29.0
Ammonia	mg/L	0.70
Bicarbonate (as CaCO ₃)	mg/L	29.0
Biochemical Oxygen Demand (BOD)	mg/L	14
Chemical Oxygen Demand (COD)	mg/L	31
Chloride	mg/L	716
Cyanide (total)	mg/L	0.005 U
Hardness	mg/L	280
Nitrate (as N)	mg/L	0.050 U
Oil and Grease	mg/L	1.0 U
pH (water)	s.u.	9.54
Phenolics (Total)	mg/L	0.010 U
Phosphorus	mg/L	0.14
Sulfate	mg/L	291
Sulfide	mg/L	2.0
Total Dissolved Solids (TDS)	mg/L	1320
Total Kjeldahl Nitrogen (TKN)	mg/L	0.56
Total Organic Carbon (TOC)	mg/L	5.6
Total Suspended Solids (TSS)	mg/L	4
Volatile Suspended Solids	mg/L	2

Note:

U Non-detect at associated value.



**CONESTOGA-ROVERS
& ASSOCIATES**

2055 Niagara Falls Blvd., Suite #3
Niagara Falls, New York 14304
Telephone: (716) 297-6150 Fax: (716) 297-2265
www.CRAworld.com

MEMORANDUM

TO: Klaus Schmidtke

REF. NO.: 7987DM-95

FROM: Susan C. Scrocchi/jbh/73 *SS*

DATE: January 9, 2006

E-Mail and Interoffice Mail

RE: **Analytical Results and QA/QC Review
Monthly Wastewater Treatment Plant Sampling
November 2005**

**PREVIOUSLY TRANSMITTED
BY E-MAIL**

INTRODUCTION

One effluent sample was collected in support of the Monthly Wastewater Treatment Plant Sampling at the Gratwick-Riverside Park Site (Site) during November 2005. The sample was submitted to Severn Trent Laboratories (STL) in Amherst, New York, and analyzed for the following:

<i>Parameter</i>	<i>Methodology¹</i>
Site-Specific Volatile Organic Compounds (VOCs)	EPA 624
Site-Specific Semi-Volatile Organic Compounds (SVOCs)	EPA 625
Target Compound List (TCL) Metals	EPA 200.7
Sulfate	EPA 300.0
Chloride	EPA 300.0
Alkalinity	EPA 310.2
Nitrate	EPA 353.2
Sulfide	EPA 376.1
Total Dissolved Solids (TDS)	EPA 160.1
Total Hardness	EPA 130.2

The analytical results are summarized in Table 1. The quality assurance/quality control (QA/QC) criteria by which these data have been assessed are outlined in the analytical methods, the "USEPA Contract Laboratory National Functional Guidelines for Organic Data Review" (October 1999), and the "National Functional Guidelines for Inorganic Data Review" (February 1994).

Data assessment was based on information obtained from final data sheets, blank data, duplicate results, surrogate recoveries, and spike recoveries.

¹ "Methods for Chemical Analysis of Water and Wastes", EPA 600/4-79-220, March 1983.

QA/QC REVIEW

All samples were prepared and/or analyzed within the method specified holding times.

Surrogates were added to all samples, blanks, and QC samples prior to extraction and/or analysis for VOCs and SVOCs. All VOC and SVOC surrogate recoveries met the method criteria indicating acceptable analytical efficiency.

Method blanks were extracted and/or analyzed for all parameters and all results were non-detect for the compounds of interest indicating that no compounds were introduced to the samples during preparation and/or analysis.

Blank spikes (BS) were prepared and analyzed for all parameters. All recoveries were acceptable indicating good analytical accuracy.

CONCLUSION

Based on the preceding assessment, the data were acceptable without qualification.

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTEWATER SAMPLING
GRATWICK
NOVEMBER 2005

Sample Location: Effluent
Sample ID: GRATWICK RIVERSIDE
Sample Date: 11/4/2005

Parameters	Units	
<i>Volatile Organic Compounds</i>		
1,1,1-Trichloroethane	µg/L	5.2 U
1,1-Dichloroethane	µg/L	11
1,2-Dichloroethane	µg/L	3.4 U
2-Butanone (Methyl Ethyl Ketone)	µg/L	19 U
Acetone	µg/L	42 U
Benzene	µg/L	4.4 U
Chlorobenzene	µg/L	3.6 U
Ethylbenzene	µg/L	11
Methylene chloride	µg/L	14 U
Styrene	µg/L	10 U
Tetrachloroethene	µg/L	20
Toluene	µg/L	45
trans-1,2-Dichloroethene	µg/L	6.0 U
Trichloroethene	µg/L	120
Vinyl chloride	µg/L	5.7 U
Xylene (total)	µg/L	55
<i>Semi-Volatile Organic Compounds</i>		
1,2-Dichlorobenzene	µg/L	2
1,4-Dichlorobenzene	µg/L	2
2,4-Dimethylphenol	µg/L	7
2-Methylphenol	µg/L	8
4-Methylphenol	µg/L	21
Di-n-octyl phthalate	µg/L	0.9 U
Naphthalene	µg/L	0.8 U
Phenol	µg/L	4
<i>Metals</i>		
Aluminum	mg/L	0.20
Antimony	mg/L	0.020 U
Arsenic	mg/L	0.010 U
Barium	mg/L	0.093
Beryllium	mg/L	0.0020 U
Cadmium	mg/L	0.0010 U
Chromium Total	mg/L	0.0040 U
Copper	mg/L	0.010 U
Iron	mg/L	0.050 U
Lead	mg/L	0.0050 U
Magnesium	mg/L	0.26
Manganese	mg/L	0.0030 U
Mercury	mg/L	0.00020 U
Nickel	mg/L	0.010 U
Selenium	mg/L	0.015 U
Silver	mg/L	0.0030 U
Sodium	mg/L	302
Zinc	mg/L	0.020 U

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTEWATER SAMPLING
GRATWICK
NOVEMBER 2005

<i>Sample Location:</i>		<i>Effluent</i>
<i>Sample ID:</i>		GRATWICK RIVERSIDE
<i>Sample Date:</i>		11/4/2005
<i>Parameters</i>	<i>Units</i>	
<i>General Chemistry</i>		
Alkalinity, Total (As CaCO ₃)	mg/L	114
Ammonia	mg/L	0.70
Bicarbonate (as CaCO ₃)	mg/L	114
Biochemical Oxygen Demand (BOD)	mg/L	15
Chemical Oxygen Demand (COD)	mg/L	31
Chloride	mg/L	664
Cyanide (total)	mg/L	0.005 U
Hardness	mg/L	360
Nitrate (as N)	mg/L	0.050 U
Oil and Grease	mg/L	1.0 U
pH (water)	s.u.	11.25
Phenolics (Total)	mg/L	0.006 U
Phosphorus	mg/L	0.20
Sulfate	mg/L	256
Sulfide	mg/L	5.6
Total Dissolved Solids (TDS)	mg/L	1320
Total Kjeldahl Nitrogen (TKN)	mg/L	0.56
Total Organic Carbon (TOC)	mg/L	6.4
Total Suspended Solids (TSS)	mg/L	6
Volatile Suspended Solids	mg/L	3

Note:

U Non-detect at associated value.



**CONESTOGA-ROVERS
& ASSOCIATES**

2055 Niagara Falls Blvd., Suite #3
Niagara Falls, New York 14304
Telephone: (716) 297-6150 Fax: (716) 297-2265
www.CRAworld.com

MEMORANDUM

TO: Klaus Schmidtke

REF. NO.: 7987DM-95

FROM: Susan C. Scrocchi/jbh/74 *SCS/jbh*

DATE: January 30, 2006

E-Mail and Interoffice Mail

RE: **Analytical Results and QA/QC Review
Monthly Wastewater Treatment Plant Sampling
December 2005**

**PREVIOUSLY TRANSMITTED
BY E-MAIL**

INTRODUCTION

One effluent sample was collected in support of the Monthly Wastewater Treatment Plant Sampling at the Gratwick-Riverside Park Site (Site) during December 2005. The sample was submitted to Severn Trent Laboratories (STL) in Amherst, New York, and analyzed for the following:

<i>Parameter</i>	<i>Methodology¹</i>
Site-Specific Volatile Organic Compounds (VOCs)	USEPA 624
Site-Specific Semi-Volatile Organic Compounds (SVOCs)	USEPA 625
Target Compound List (TCL) Metals	USEPA 200.7
Sulfate	USEPA 300.0
Chloride	USEPA 300.0
Alkalinity	USEPA 310.2
Nitrate	USEPA 353.2
Sulfide	USEPA 376.1
Total Dissolved Solids (TDS)	USEPA 160.1
Total Hardness	USEPA 130.2

The analytical results are summarized in Table 1. The quality assurance/quality control (QA/QC) criteria by which these data have been assessed are outlined in the analytical methods, the "USEPA Contract Laboratory National Functional Guidelines for Organic Data Review" (October 1999), and the "National Functional Guidelines for Inorganic Data Review" (February 1994).

Data assessment was based on information obtained from final data sheets, blank data, duplicate results, surrogate recoveries, and spike recoveries.

¹ "Methods for Chemical Analysis of Water and Wastes", United States Environmental Protection Agency (USEPA) 600/4-79-220, March 1983.

QA/QC REVIEW

All samples were prepared and/or analyzed within the method specified holding times.

Surrogates were added to all samples, blanks, and QC samples prior to extraction and/or analysis for VOCs and SVOCs. All VOC and SVOC surrogate recoveries met the method criteria indicating acceptable analytical efficiency.

Method blanks were extracted and/or analyzed for all parameters and all results were non-detect for the compounds of interest indicating that no compounds were introduced to the samples during preparation and/or analysis.

Blank spikes (BS) were prepared and analyzed for all parameters. All recoveries were acceptable indicating good analytical accuracy.

CONCLUSION

Based on the preceding assessment, the data were acceptable without qualification.

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTER WATER SAMPLING
GRATWICK
DECEMBER 2005

Sample Location: Effluent
Sample ID: GRATWICK RIVERSIDE
Sample Date: 12/8/2005

<i>Parameters</i>	<i>Units</i>	
<i>Volatile Organic Compounds</i>		
1,1,1-Trichloroethane	µg/L	5.2 U
1,1-Dichloroethane	µg/L	7.9
1,2-Dichloroethane	µg/L	3.4 U
2-Butanone (Methyl Ethyl Ketone)	µg/L	19 U
Acetone	µg/L	42 U
Benzene	µg/L	4.4 U
Chlorobenzene	µg/L	4.7
Ethylbenzene	µg/L	8.3
Methylene chloride	µg/L	14 U
Styrene	µg/L	10 U
Tetrachloroethene	µg/L	15
Toluene	µg/L	34
trans-1,2-Dichloroethene	µg/L	6.0 U
Trichloroethene	µg/L	86
Vinyl chloride	µg/L	5.7 U
Xylene (total)	µg/L	41
<i>Semi-volatile Organic Compounds</i>		
1,2-Dichlorobenzene	µg/L	2
1,4-Dichlorobenzene	µg/L	2
2,4-Dimethylphenol	µg/L	11
2-Methylphenol	µg/L	7
4-Methylphenol	µg/L	21
Di-n-octyl phthalate	µg/L	0.8 U
Naphthalene	µg/L	0.8 U
Phenol	µg/L	50
<i>Metals</i>		
Aluminum	mg/L	0.20 U
Antimony	mg/L	0.020 U
Arsenic	mg/L	0.010 U
Barium	mg/L	0.10
Beryllium	mg/L	0.0020 U
Cadmium	mg/L	0.0010 U
Chromium Total	mg/L	0.0040 U
Copper	mg/L	0.010 U
Iron	mg/L	0.050 U
Lead	mg/L	0.0050 U
Magnesium	mg/L	1.2
Manganese	mg/L	0.0030 U
Mercury	mg/L	0.00020 U
Nickel	mg/L	0.010 U

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTEWATER SAMPLING
GRATWICK
DECEMBER 2005

Sample Location: Effluent
Sample ID: GRATWICK RIVERSIDE
Sample Date: 12/8/2005

<i>Parameters</i>	<i>Units</i>	
<i>Metals (Cont'd.)</i>		
Selenium	mg/L	0.015 U
Silver	mg/L	0.0030 U
Sodium	mg/L	357
Zinc	mg/L	0.020 U
<i>General Chemistry</i>		
Alkalinity, Total (As CaCO ₃)	mg/L	42.0
Ammonia	mg/L	0.70
Bicarbonate (as CaCO ₃)	mg/L	42.0
Biochemical Oxygen Demand (BOD)	mg/L	16
Chemical Oxygen Demand (COD)	mg/L	61
Chloride	mg/L	762
Cyanide (total)	mg/L	0.005 U
Hardness	mg/L	344
Nitrate (as N)	mg/L	0.050 U
Oil and Grease	mg/L	1.0 U
pH (water)	s.u.	11.04
Phenolics (Total)	mg/L	0.008 U
Phosphorus	mg/L	0.04
Sulfate	mg/L	263
Sulfide	mg/L	8.8
Total Dissolved Solids (TDS)	mg/L	1380
Total Kjeldahl Nitrogen (TKN)	mg/L	0.84
Total Organic Carbon (TOC)	mg/L	9.2
Total Suspended Solids (TSS)	mg/L	4
Volatile Suspended Solids	mg/L	2

Note:

U Non-detect at associated value.



**CONESTOGA-ROVERS
& ASSOCIATES**

2055 Niagara Falls Blvd., Suite #3
Niagara Falls, New York 14304
Telephone: (716) 297-6150 Fax: (716) 297-2265
www.CRAworld.com

MEMORANDUM

TO: Klaus Schmidtke

REF. NO.: 7987DM-95

FROM: Susan C. Scrocchi/jbh/75 *SCS/jbh*

DATE: March 15, 2006

E-Mail and Interoffice Mail

RE: Analytical Results and QA/QC Review
Monthly Wastewater Treatment Plant Sampling
January 2006

PREVIOUSLY TRANSMITTED
BY E-MAIL

INTRODUCTION

One effluent sample was collected in support of the Monthly Wastewater Treatment Plant Sampling at the Gratwick-Riverside Park Site (Site) during January 2006. The sample was submitted to Severn Trent Laboratories (STL) in Amherst, New York, and analyzed for the following:

<i>Parameter</i>	<i>Methodology¹</i>
Site-Specific Volatile Organic Compounds (VOCs)	USEPA 624
Site-Specific Semi-Volatile Organic Compounds (SVOCs)	USEPA 625
Target Compound List (TCL) Metals	USEPA 200.7
Sulfate	USEPA 300.0
Chloride	USEPA 300.0
Alkalinity	USEPA 310.2
Nitrate	USEPA 353.2
Sulfide	USEPA 376.1
Total Dissolved Solids (TDS)	USEPA 160.1
Total Hardness	USEPA 130.2

The analytical results are summarized in Table 1. The quality assurance/quality control (QA/QC) criteria by which these data have been assessed are outlined in the analytical methods, the "USEPA Contract Laboratory National Functional Guidelines for Organic Data Review" (October 1999), and the "National Functional Guidelines for Inorganic Data Review" (February 1994).

Data assessment was based on information obtained from final data sheets, blank data, duplicate results, surrogate recoveries, and spike recoveries.

¹ "Methods for Chemical Analysis of Water and Wastes", United States Environmental Protection Agency (USEPA) 600/4-79-220, March 1983.

QA/QC REVIEW

All samples were prepared and/or analyzed within the method specified holding times.

Surrogates were added to all samples, blanks, and QC samples prior to extraction and/or analysis for VOCs and SVOCs. All VOC and SVOC surrogate recoveries met the method criteria indicating acceptable analytical efficiency.

Method blanks were extracted and/or analyzed for all parameters and all results were non-detect for the compounds of interest indicating that no compounds were introduced to the samples during preparation and/or analysis.

Blank spikes (BS) were prepared and analyzed for all parameters. All recoveries were acceptable indicating good analytical accuracy.

A matrix spike was prepared and analyzed for hardness, alkalinity, and nitrate. All results were acceptable indicating good analytical efficiency for these parameters.

CONCLUSION

Based on the preceding assessment, the data were acceptable without qualification.

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTER WATER SAMPLING
MILLER SPRINGS REMEDIATION MANAGEMENT, INC.
GRATWICK
JANUARY 2006

	<i>Sample Location:</i>	<i>Effluent</i>
	<i>Sample ID:</i>	GRATWICK RIVERSIDE
	<i>Sample Date:</i>	1/6/2006
<i>Parameters:</i>	<i>Units</i>	
<i>Volatile Organic Compounds</i>		
1,1,1-Trichloroethane	µg/L	5.2 U
1,1-Dichloroethane	µg/L	8.9
1,2-Dichloroethane	µg/L	3.4 U
2-Butanone (Methyl Ethyl Ketone)	µg/L	19 U
Acetone	µg/L	42 U
Benzene	µg/L	4.4 U
Chlorobenzene	µg/L	5.1
Ethylbenzene	µg/L	7.9
Methylene chloride	µg/L	14 U
Styrene	µg/L	10 U
Tetrachloroethene	µg/L	15
Toluene	µg/L	36
trans-1,2-Dichloroethene	µg/L	6.0 U
Trichloroethene	µg/L	100
Vinyl chloride	µg/L	5.7 U
Xylene (total)	µg/L	37
<i>Semi-Volatile Organic Compounds</i>		
1,2-Dichlorobenzene	µg/L	2
1,4-Dichlorobenzene	µg/L	2
2,4-Dimethylphenol	µg/L	9
2-Methylphenol	µg/L	6
4-Methylphenol	µg/L	21
Di-n-octyl phthalate	µg/L	0.8 U
Naphthalene	µg/L	12
Phenol	µg/L	43
<i>Metals</i>		
Aluminum	mg/L	0.20 U
Antimony	mg/L	0.020 U
Arsenic	mg/L	0.010 U
Barium	mg/L	0.10
Beryllium	mg/L	0.0020 U
Cadmium	mg/L	0.0010 U
Chromium Total	mg/L	0.0040 U
Copper	mg/L	0.010 U
Iron	mg/L	0.050 U
Lead	mg/L	0.0050 U
Magnesium	mg/L	2.3

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTER WATER SAMPLING
MILLER SPRINGS REMEDIATION MANAGEMENT, INC.
GRATWICK
JANUARY 2006

<i>Sample Location:</i>		<i>Effluent</i>
<i>Sample ID:</i>		GRATWICK RIVERSIDE
<i>Sample Date:</i>		1/6/2006
<i>Parameters:</i>	<i>Units</i>	
<i>Metals (Con't.d)</i>		
Manganese	mg/L	0.0030 U
Mercury	mg/L	0.00020 U
Nickel	mg/L	0.010 U
Selenium	mg/L	0.015 U
Silver	mg/L	0.0030 U
Sodium	mg/L	357
Zinc	mg/L	0.020 U
<i>General Chemistry</i>		
Alkalinity, Total (As CaCO ₃)	mg/L	69.0
Ammonia	mg/L	0.35
Bicarbonate (as CaCO ₃)	mg/L	69.0
Biochemical Oxygen Demand (BOD)	mg/L	10
Chemical Oxygen Demand (COD)	mg/L	38
Chloride	mg/L	910
Cyanide (total)	mg/L	0.005 U
Hardness	mg/L	329
Nitrate (as N)	mg/L	0.050 U
Oil and Grease	mg/L	1.0 U
pH (water)	s.u.	10.73
Phenolics (Total)	mg/L	0.008 U
Phosphorus	mg/L	0.06
Sulfate	mg/L	297
Sulfide	mg/L	4.0
Total Dissolved Solids (TDS)	mg/L	1510
Total Kjeldahl Nitrogen (TKN)	mg/L	0.28
Total Organic Carbon (TOC)	mg/L	7.9
Total Suspended Solids (TSS)	mg/L	6
Volatile Suspended Solids	mg/L	3

Note:

U Non-detect at associated value.



**CONESTOGA-ROVERS
& ASSOCIATES**

2055 Niagara Falls Blvd., Suite #3
Niagara Falls, New York 14304
Telephone: (716) 297-6150 Fax: (716) 297-2265
www.CRAworld.com

MEMORANDUM

TO: Klaus Schmidtke

REF. NO.: 7987DM-95

FROM: Susan C. Scrocchi/jbh/76 *SCS*

DATE: April 5, 2006

E-Mail and Interoffice Mail

RE: **Analytical Results and QA/QC Review
Monthly Wastewater Treatment Plant Sampling
February 2006**

**PREVIOUSLY TRANSMITTED
BY E-MAIL**

INTRODUCTION

One effluent sample was collected in support of the Monthly Wastewater Treatment Plant Sampling at the Gratwick-Riverside Park Site (Site) during February 2006. The sample was submitted to Severn Trent Laboratories (STL) in Amherst, New York, and analyzed for the following:

<i>Parameter</i>	<i>Methodology¹</i>
Site-Specific Volatile Organic Compounds (VOCs)	USEPA 624
Site-Specific Semi-Volatile Organic Compounds (SVOCs)	USEPA 625
Target Compound List (TCL) Metals	USEPA 200.7
Sulfate	USEPA 300.0
Chloride	USEPA 300.0
Alkalinity	USEPA 310.2
Nitrate	USEPA 353.2
Sulfide	USEPA 376.1
Total Dissolved Solids (TDS)	USEPA 160.1
Total Hardness	USEPA 130.2

The analytical results are summarized in Table 1. The quality assurance/quality control (QA/QC) criteria by which these data have been assessed are outlined in the analytical methods, the "USEPA Contract Laboratory National Functional Guidelines for Organic Data Review" (October 1999), and the "National Functional Guidelines for Inorganic Data Review" (February 1994).

Data assessment was based on information obtained from final data sheets, blank data, duplicate results, surrogate recoveries, and spike recoveries.

¹ "Methods for Chemical Analysis of Water and Wastes", United States Environmental Protection Agency (USEPA) 600/4-79-220, March 1983.

QA/QC REVIEW

All samples were prepared and/or analyzed within the method specified holding times.

Surrogates were added to all samples, blanks, and QC samples prior to extraction and/or analysis for VOCs and SVOCs. All VOC and SVOC surrogate recoveries met the method criteria indicating acceptable analytical efficiency.

Method blanks were extracted and/or analyzed for all parameters and all results were non-detect for the compounds of interest indicating that no compounds were introduced to the samples during preparation and/or analysis.

Blank spikes (BS) were prepared and analyzed for all parameters. All recoveries were acceptable indicating good analytical accuracy.

A matrix spike was prepared and analyzed for sulfate, alkalinity, and sulfide. All results were acceptable indicating good analytical efficiency for these parameters with the exception of a low alkalinity recovery. The results for this analyte were qualified as estimated to reflect the implied low bias.

CONCLUSION

Based on the preceding assessment, the data were acceptable with the qualifications noted.

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTER WATER SAMPLING
MILLER SPRINGS REMEDIATION MANAGEMENT, INC.
GRATWICK-RIVERSIDE PARK SITE
FEBRUARY 2006

Sample Location: Effluent
Sample ID: GRATWICK RIVERSIDE
Sample Date: 2/14/2006

<i>Parameters</i>	<i>Units</i>	
<i>Volatile Organic Compounds</i>		
1,1,1-Trichloroethane	µg/L	5.2 U
1,1-Dichloroethane	µg/L	10
1,2-Dichloroethane	µg/L	3.4 U
2-Butanone (Methyl Ethyl Ketone)	µg/L	19 U
Acetone	µg/L	42 U
Benzene	µg/L	4.4 U
Chlorobenzene	µg/L	5.0
Ethylbenzene	µg/L	10
Methylene chloride	µg/L	14 U
Styrene	µg/L	10 U
Tetrachloroethene	µg/L	19
Toluene	µg/L	46
trans-1,2-Dichloroethene	µg/L	6.0 U
Trichloroethene	µg/L	130
Vinyl chloride	µg/L	5.8
Xylene (total)	µg/L	28 U
<i>Semi-Volatile Organic Compounds</i>		
1,2-Dichlorobenzene	µg/L	2
1,4-Dichlorobenzene	µg/L	2
2,4-Dimethylphenol	µg/L	11
2-Methylphenol	µg/L	7
4-Methylphenol	µg/L	28
Di-n-octyl phthalate	µg/L	0.9 U
Naphthalene	µg/L	11
Phenol	µg/L	40
<i>Metals</i>		
Aluminum	mg/L	0.20 U
Antimony	mg/L	0.020 U
Arsenic	mg/L	0.010 U
Barium	mg/L	0.11
Beryllium	mg/L	0.0020 U
Cadmium	mg/L	0.0010 U
Chromium Total	mg/L	0.0040 U
Copper	mg/L	0.010 U
Iron	mg/L	0.050 U
Lead	mg/L	0.0050 U
Magnesium	mg/L	1.2
Manganese	mg/L	0.0030 U
Mercury	mg/L	0.00020 U
Nickel	mg/L	0.010 U
Selenium	mg/L	0.015 U
Silver	mg/L	0.0030 U
Sodium	mg/L	425
Zinc	mg/L	0.020 U

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTEWATER SAMPLING
MILLER SPRINGS REMEDIATION MANAGEMENT, INC.
GRATWICK-RIVERSIDE PARK SITE
FEBRUARY 2006

Sample Location: Effluent
Sample ID: GRATWICK RIVERSIDE
Sample Date: 2/14/2006

Parameters	Units	
<i>General Chemistry</i>		
Alkalinity, Total (As CaCO ₃)	mg/L	71.4 J
Ammonia	mg/L	1.05
Bicarbonate (as CaCO ₃)	mg/L	10 U
Biochemical Oxygen Demand (BOD)	mg/L	10
Chemical Oxygen Demand (COD)	mg/L	45
Chloride	mg/L	897
Cyanide (total)	mg/L	0.005 U
Hardness	mg/L	342
Nitrate (as N)	mg/L	0.050 U
Oil and Grease	mg/L	1.0 U
pH (water)	s.u.	11.07
Phenolics (Total)	mg/L	0.010 U
Phosphorus	mg/L	0.37
Sulfate	mg/L	288
Sulfide	mg/L	2.8
Total Dissolved Solids (TDS)	mg/L	1700
Total Kjeldahl Nitrogen (TKN)	mg/L	0.84
Total Organic Carbon (TOC)	mg/L	8.1
Total Suspended Solids (TSS)	mg/L	6
Volatile Suspended Solids	mg/L	4

Notes:

- J Estimated.
U Non-detect at associated value.



**CONESTOGA-ROVERS
& ASSOCIATES**

2055 Niagara Falls Blvd., Suite #3
Niagara Falls, New York 14304
Telephone: (716) 297-6150 Fax: (716) 297-2265
www.CRAworld.com

MEMORANDUM

TO: Klaus Schmidtke

REF. NO.: 7987DM-95

FROM: Susan C. Scrocchi/jbh/77 *SCS/jbh*

DATE: May 4, 2006

E-Mail and Interoffice Mail

RE: **Analytical Results and QA/QC Review
Monthly Wastewater Treatment Plant Sampling
March 2006**

**PREVIOUSLY TRANSMITTED
BY E-MAIL**

INTRODUCTION

One effluent sample was collected in support of the Monthly Wastewater Treatment Plant Sampling at the Gratwick-Riverside Park Site (Site) during March 2006. The sample was submitted to Severn Trent Laboratories (STL) in Amherst, New York, and analyzed for the following:

<i>Parameter</i>	<i>Methodology¹</i>
Site-Specific Volatile Organic Compounds (VOCs)	USEPA 624
Site-Specific Semi-Volatile Organic Compounds (SVOCs)	USEPA 625
Target Compound List (TCL) Metals	USEPA 200.7
Sulfate	USEPA 300.0
Chloride	USEPA 300.0
Alkalinity	USEPA 310.2
Nitrate	USEPA 353.2
Sulfide	USEPA 376.1
Total Dissolved Solids (TDS)	USEPA 160.1
Total Hardness	USEPA 130.2

The analytical results are summarized in Table 1. The quality assurance/quality control (QA/QC) criteria by which these data have been assessed are outlined in the analytical methods, the "USEPA Contract Laboratory National Functional Guidelines for Organic Data Review" (October 1999), and the "National Functional Guidelines for Inorganic Data Review" (February 1994).

Data assessment was based on information obtained from final data sheets, blank data, duplicate results, surrogate recoveries, and spike recoveries.

¹ "Methods for Chemical Analysis of Water and Wastes", United States Environmental Protection Agency (USEPA) 600/4-79-220, March 1983.

QA/QC REVIEW

All samples were prepared and/or analyzed within the method specified holding times.

Surrogates were added to all samples, blanks, and QC samples prior to extraction and/or analysis for VOCs and SVOCs. All VOC and SVOC surrogate recoveries met the method criteria indicating acceptable analytical efficiency.

Method blanks were extracted and/or analyzed for all parameters and all results were non-detect for the compounds of interest indicating that no compounds were introduced to the samples during preparation and/or analysis.

Blank spikes (BS) were prepared and analyzed for all parameters. All recoveries were acceptable indicating good analytical accuracy.

A matrix spike was prepared and analyzed for sulfate. All results were acceptable indicating good analytical accuracy for this parameter.

CONCLUSION

Based on the preceding assessment, the data were acceptable for use without qualification.

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTER WATER SAMPLING
MILLER SPRINGS REMEDIATION MANAGEMENT, INC.
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK
MARCH 2006

Sample Location: Effluent
Sample ID: GRATWICK RIVERSIDE
Sample Date: 3/10/2006

<i>Parameters</i>	<i>Units</i>	
<i>Volatile Organic Compounds</i>		
1,1,1-Trichloroethane	µg/L	5.2 U
1,1-Dichloroethane	µg/L	11
1,2-Dichloroethane	µg/L	3.4 U
2-Butanone (Methyl Ethyl Ketone)	µg/L	19 U
Acetone	µg/L	42 U
Benzene	µg/L	4.4 U
Chlorobenzene	µg/L	5.0
Ethylbenzene	µg/L	12
Methylene chloride	µg/L	14 U
Styrene	µg/L	10 U
Tetrachloroethene	µg/L	27
Toluene	µg/L	56
trans-1,2-Dichloroethene	µg/L	6.0 U
Trichloroethene	µg/L	150
Vinyl chloride	µg/L	6.4
Xylene (total)	µg/L	55
<i>Semi-Volatile Organic Compounds</i>		
1,2-Dichlorobenzene	µg/L	2
1,4-Dichlorobenzene	µg/L	2
2,4-Dimethylphenol	µg/L	14
2-Methylphenol	µg/L	8
4-Methylphenol	µg/L	34
Di-n-octyl phthalate	µg/L	0.8 U
Naphthalene	µg/L	1
Phenol	µg/L	31
<i>Metals</i>		
Aluminum	mg/L	0.20 U
Antimony	mg/L	0.020 U
Arsenic	mg/L	0.010 U
Barium	mg/L	0.094
Beryllium	mg/L	0.0020 U
Cadmium	mg/L	0.0010 U
Chromium Total	mg/L	0.0040 U
Copper	mg/L	0.010 U
Iron	mg/L	0.050 U
Lead	mg/L	0.0050 U
Magnesium	mg/L	0.57
Manganese	mg/L	0.0030 U
Mercury	mg/L	0.00020 U
Nickel	mg/L	0.010 U
Selenium	mg/L	0.015 U
Silver	mg/L	0.0030 U

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTEWATER SAMPLING
MILLER SPRINGS REMEDIATION MANAGEMENT, INC.
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK
MARCH 2006

Sample Location: Effluent
Sample ID: GRATWICK RIVERSIDE
Sample Date: 3/10/2006

<i>Parameters</i>	<i>Units</i>	
<i>Metals (Cont'd.)</i>		
Sodium	mg/L	454
Zinc	mg/L	0.010 U
<i>General Chemistry</i>		
Alkalinity, Total (As CaCO ₃)	mg/L	95.1
Ammonia	mg/L	0.28
Bicarbonate (as CaCO ₃)	mg/L	10 U
Biochemical Oxygen Demand (BOD)	mg/L	9
Chemical Oxygen Demand (COD)	mg/L	47
Chloride	mg/L	914
Cyanide (total)	mg/L	0.005 U
Hardness	mg/L	400
Nitrate (as N)	mg/L	0.050 U
Oil and Grease	mg/L	1.0 U
pH (water)	s.u.	10.99
Phenolics (Total)	mg/L	0.009 U
Phosphorus	mg/L	0.13
Sulfate	mg/L	285
Sulfide	mg/L	5.2
Total Dissolved Solids (TDS)	mg/L	1670
Total Kjeldahl Nitrogen (TKN)	mg/L	0.56
Total Organic Carbon (TOC)	mg/L	8.3
Total Suspended Solids (TSS)	mg/L	10
Volatile Suspended Solids	mg/L	3

Note:

U Non-detect at associated value.



**CONESTOGA-ROVERS
& ASSOCIATES**

2055 Niagara Falls Blvd., Suite #3
Niagara Falls, New York 14304
Telephone: (716) 297-6150 Fax: (716) 297-2265
www.CRAworld.com

MEMORANDUM

TO: Klaus Schmidtke

FROM: Susan C. Scrocchi/jbh/78
SCS/jbh

RE: Analytical Results and QA/QC Review
Monthly Wastewater Treatment Plant Sampling
April 2006

REF. NO.: 7987DM-95

DATE: June 6, 2006

E-Mail and Interoffice Mail

INTRODUCTION

One effluent sample was collected in support of the Monthly Wastewater Treatment Plant Sampling at the Gratwick-Riverside Park Site (Site) during April 2006. The sample was submitted to Severn Trent Laboratories (STL) in Amherst, New York, and analyzed for the following:

<i>Parameter</i>	<i>Methodology¹</i>
Site-Specific Volatile Organic Compounds (VOCs)	USEPA 624
Site-Specific Semi-Volatile Organic Compounds (SVOCs)	USEPA 625
Target Compound List (TCL) Metals	USEPA 200.7
Sulfate	USEPA 300.0
Chloride	USEPA 300.0
Alkalinity	USEPA 310.2
Nitrate	USEPA 353.2
Sulfide	USEPA 376.1
Total Dissolved Solids (TDS)	USEPA 160.1
Total Hardness	USEPA 130.2

The analytical results are summarized in Table 1. The quality assurance/quality control (QA/QC) criteria by which these data have been assessed are outlined in the analytical methods, the "USEPA Contract Laboratory National Functional Guidelines for Organic Data Review" (October 1999), and the "National Functional Guidelines for Inorganic Data Review" (February 1994).

Data assessment was based on information obtained from final data sheets, blank data, duplicate results, surrogate recoveries, and spike recoveries.

¹ "Methods for Chemical Analysis of Water and Wastes", United States Environmental Protection Agency (USEPA) 600/4-79-220, March 1983.

QA/QC REVIEW

All samples were prepared and/or analyzed within the method specified holding times.

Surrogates were added to all samples, blanks, and QC samples prior to extraction and/or analysis for VOCs and SVOCs. All VOC and SVOC surrogate recoveries met the method criteria indicating acceptable analytical efficiency.

Method blanks were extracted and/or analyzed for all parameters and all results were non-detect for the compounds of interest indicating that no compounds were introduced to the samples during preparation and/or analysis.

Blank spikes (BS) were prepared and analyzed for all parameters. All recoveries were acceptable indicating good analytical accuracy.

A matrix spike was prepared and analyzed for chloride. The recovery was above the acceptable limit. The associated results were qualified as estimated to reflect the implied high bias.

CONCLUSION

Based on the preceding assessment, the data were acceptable for use with the qualification noted.

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTER WATER SAMPLING
GRATWICK
APRIL 2006

Sample Location: Effluent
Sample ID: GRATWICK RIVERSIDE
Sample Date: 4/7/2006

Parameters	Units	
<i>Volatile Organic Compounds</i>		
1,1,1-Trichloroethane	µg/L	5.2 U
1,1-Dichloroethane	µg/L	12
1,2-Dichloroethane	µg/L	3.4 U
2-Butanone (Methyl Ethyl Ketone)	µg/L	19 U
Acetone	µg/L	42 U
Benzene	µg/L	4.4 U
Chlorobenzene	µg/L	3.6 U
Ethylbenzene	µg/L	8.2
Methylene chloride	µg/L	6.8 U
Styrene	µg/L	6.6 U
Tetrachloroethene	µg/L	21
Toluene	µg/L	41
trans-1,2-Dichloroethene	µg/L	6.0 U
Trichloroethene	µg/L	130
Vinyl chloride	µg/L	5.7 U
Xylene (total)	µg/L	41
<i>Semi-Volatile Organic Compounds</i>		
1,2-Dichlorobenzene	µg/L	2
1,4-Dichlorobenzene	µg/L	2
2,4-Dimethylphenol	µg/L	10
2-Methylphenol	µg/L	5
4-Methylphenol	µg/L	13
Di-n-octyl phthalate	µg/L	0.8 U
Naphthalene	µg/L	0.8 U
Phenol	µg/L	0.4 U
<i>Metals</i>		
Aluminum	mg/L	0.20 U
Antimony	mg/L	0.020 U
Arsenic	mg/L	0.010 U
Barium	mg/L	0.093
Beryllium	mg/L	0.0020 U
Cadmium	mg/L	0.0010 U
Chromium Total	mg/L	0.0040 U
Copper	mg/L	0.010 U
Iron	mg/L	0.050 U
Lead	mg/L	0.0050 U
Magnesium	mg/L	0.46
Manganese	mg/L	0.0030 U
Mercury	mg/L	0.00020 U
Nickel	mg/L	0.010 U
Selenium	mg/L	0.015 U
Silver	mg/L	0.0030 U
Sodium	mg/L	419
Zinc	mg/L	0.010 U

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTER WATER SAMPLING
GRATWICK
APRIL 2006

Sample Location: Effluent
Sample ID: GRATWICK RIVERSIDE
Sample Date: 4/7/2006

<i>Parameters</i>	<i>Units</i>	
<i>General Chemistry</i>		
Alkalinity, Total (As CaCO ₃)	mg/L	75.4
Ammonia	mg/L	0.70
Bicarbonate (as CaCO ₃)	mg/L	75.4
Biochemical Oxygen Demand (BOD)	mg/L	10
Chemical Oxygen Demand (COD)	mg/L	47
Chloride	mg/L	962 J
Cyanide (total)	mg/L	0.005 U
Hardness	mg/L	408
Nitrate (as N)	mg/L	0.050 U
Oil and Grease	mg/L	1.0 U
pH (water)	s.u.	10.96
Phenolics (Total)	mg/L	0.011 U
Phosphorus	mg/L	0.05
Sulfate	mg/L	351
Sulfide	mg/L	6.0
Total Dissolved Solids (TDS)	mg/L	1730
Total Kjeldahl Nitrogen (TKN)	mg/L	0.84
Total Organic Carbon (TOC)	mg/L	8.9
Total Suspended Solids (TSS)	mg/L	5
Volatile Suspended Solids	mg/L	3

Notes:

- J Estimated.
U Non-detect at associated value.



**CONESTOGA-ROVERS
& ASSOCIATES**

2055 Niagara Falls Blvd., Suite #3
Niagara Falls, New York 14304
Telephone: (716) 297-6150 Fax: (716) 297-2265
www.CRAworld.com

MEMORANDUM

TO: Klaus Schmidtke

REF. NO.: 7987DM-95

FROM: Susan C. Scrocchi/jbh/79 *scs/jbh*

DATE: June 6, 2006

E-Mail and Interoffice Mail

RE: Analytical Results and QA/QC Review
Monthly Wastewater Treatment Plant Sampling
May 2006

INTRODUCTION

One effluent sample was collected in support of the Monthly Wastewater Treatment Plant Sampling at the Gratwick-Riverside Park Site (Site) during May 2006. The sample was submitted to Severn Trent Laboratories (STL) in Amherst, New York, and analyzed for the following:

<i>Parameter</i>	<i>Methodology¹</i>
Site-Specific Volatile Organic Compounds (VOCs)	USEPA 624
Site-Specific Semi-Volatile Organic Compounds (SVOCs)	USEPA 625
Target Compound List (TCL) Metals	USEPA 200.7
Sulfate	USEPA 300.0
Chloride	USEPA 300.0
Alkalinity	USEPA 310.2
Nitrate	USEPA 353.2
Sulfide	USEPA 376.1
Total Dissolved Solids (TDS)	USEPA 160.1
Total Hardness	USEPA 130.2

The analytical results are summarized in Table 1. The quality assurance/quality control (QA/QC) criteria by which these data have been assessed are outlined in the analytical methods, the "USEPA Contract Laboratory National Functional Guidelines for Organic Data Review" (October 1999), and the "National Functional Guidelines for Inorganic Data Review" (February 1994).

Data assessment was based on information obtained from final data sheets, blank data, duplicate results, surrogate recoveries, and spike recoveries.

¹ "Methods for Chemical Analysis of Water and Wastes", United States Environmental Protection Agency (USEPA) 600/4-79-220, March 1983.

QA/QC REVIEW

All samples were prepared and/or analyzed within the method specified holding times.

Surrogates were added to all samples, blanks, and QC samples prior to extraction and/or analysis for VOCs and SVOCs. All VOC and SVOC surrogate recoveries met the method criteria indicating acceptable analytical efficiency.

Method blanks were extracted and/or analyzed for all parameters and all results were non-detect for the compounds of interest indicating that no compounds were introduced to the samples during preparation and/or analysis.

Blank spikes (BS) were prepared and analyzed for all parameters. All recoveries were acceptable indicating good analytical accuracy.

A matrix spike was prepared and analyzed for sulfate. All results were acceptable indicating good analytical accuracy for this parameter.

CONCLUSION

Based on the preceding assessment, the data were acceptable for use without qualification.

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTER WATER SAMPLING
GRATWICK
MAY 2006

Sample Location: Effluent
Sample ID: GRATWICK RIVERSIDE
Sample Date: 5/4/2006

<i>Parameters</i>	<i>Units</i>	
<i>Volatile Organic Compounds</i>		
1,1,1-Trichloroethane	µg/L	5.2 U
1,1-Dichloroethane	µg/L	3.3 U
1,2-Dichloroethane	µg/L	3.4 U
2-Butanone (Methyl Ethyl Ketone)	µg/L	19 U
Acetone	µg/L	42 U
Benzene	µg/L	4.4 U
Chlorobenzene	µg/L	8.6
Ethylbenzene	µg/L	7.0 U
Methylene chloride	µg/L	6.8 U
Styrene	µg/L	6.6 U
Tetrachloroethene	µg/L	9.1
Toluene	µg/L	11
trans-1,2-Dichloroethene	µg/L	6.0 U
Trichloroethene	µg/L	23
Vinyl chloride	µg/L	5.7 U
Xylene (total)	µg/L	28 U
<i>Semi-Volatile Organic Compounds</i>		
1,2-Dichlorobenzene	µg/L	1
1,4-Dichlorobenzene	µg/L	3
2,4-Dimethylphenol	µg/L	5
2-Methylphenol	µg/L	4
4-Methylphenol	µg/L	12
Di-n-octyl phthalate	µg/L	4 U
Naphthalene	µg/L	50
Phenol	µg/L	150
<i>Metals</i>		
Aluminum	mg/L	0.20 U
Antimony	mg/L	0.020 U
Arsenic	mg/L	0.010 U
Barium	mg/L	0.082
Beryllium	mg/L	0.0020 U
Cadmium	mg/L	0.0010 U
Chromium Total	mg/L	0.0040 U
Copper	mg/L	0.010 U
Iron	mg/L	0.050 U
Lead	mg/L	0.0050 U
Magnesium	mg/L	7.6
Manganese	mg/L	0.0030 U
Mercury	mg/L	0.00020 U
Nickel	mg/L	0.010 U
Selenium	mg/L	0.015 U
Silver	mg/L	0.0030 U
Sodium	mg/L	361
Zinc	mg/L	0.010 U

ANALYTICAL RESULTS SUMMARY
MONTHLY WASTER WATER SAMPLING
GRATWICK
MAY 2006

Sample Location: Effluent
Sample ID: GRATWICK RIVERSIDE
Sample Date: 5/4/2006

Parameters	Units	
<i>General Chemistry</i>		
Alkalinity, Total (As CaCO ₃)	mg/L	26.9
Ammonia	mg/L	0.70
Bicarbonate (as CaCO ₃)	mg/L	26.9
Biochemical Oxygen Demand (BOD)	mg/L	12
Chemical Oxygen Demand (COD)	mg/L	47
Chloride	mg/L	914
Cyanide (total)	mg/L	0.005 U
Hardness	mg/L	289
Nitrate (as N)	mg/L	0.050 U
Oil and Grease	mg/L	1.0 U
pH (water)	s.u.	9.74
Phenolics (Total)	mg/L	0.007 U
Phosphorus	mg/L	0.10
Sulfate	mg/L	296
Sulfide	mg/L	4.4
Total Dissolved Solids (TDS)	mg/L	1500
Total Kjeldahl Nitrogen (TKN)	mg/L	0.56
Total Organic Carbon (TOC)	mg/L	9.3
Total Suspended Solids (TSS)	mg/L	4
Volatile Suspended Solids	mg/L	2

Note:

U Non-detect at associated value.



**CONESTOGA-ROVERS
& ASSOCIATES**

2371 George Urban Blvd.
Depew, New York 14043
Telephone: (716) 206-0202 Fax: (716) 206-0201
www.CRAworld.com

MEMORANDUM

TO: Klaus Schmidtke

REF. NO.: 7987

FROM: Karen Bevilacqua/jbh/80-NF

DATE: July 21, 2006

E-Mail and Interoffice Mail

RE: Analytical Results and QA/QC Review
Annual Groundwater Sampling
Gratwick-Riverside Park Site
May 2006

PREVIOUSLY TRANSMITTED
BY E-MAIL

INTRODUCTION

Sixteen (16) samples, including one field duplicate, were collected in support of the Annual Groundwater Sampling at the Gratwick-Riverside Park Site (Site) during May 2006. Samples were submitted to Severn Trent Laboratories (STL) in Amherst, New York, and analyzed for the following:

<i>Parameter</i>	<i>Methodology</i>
Site-Specific Volatile Organic Compounds (VOCs)	SW-846 8260 ¹
Site-Specific Semi-Volatile Organic Compounds (SVOCs)	SW-846 8270 ¹

The sample collection and analysis summary is presented in Table 1. The analytical results are summarized in Table 2. The quality assurance/quality control (QA/QC) criteria by which these data have been assessed are outlined in the analytical methods and the "National Functional Guidelines for Organic Data Review" (October 1999).

Data assessment was based on information obtained from final data sheets, blank data, duplicate results, surrogate recoveries, and spike recoveries.

QA/QC REVIEW

All samples were prepared and/or analyzed within the method specified holding times. All samples were received in good condition and properly preserved.

¹ "Test Methods for Solid Waste Physical/Chemical Methods", SW-846, 3rd Edition, September 1986 (with all subsequent revisions).

Surrogates were added to all samples, blanks, and QC samples prior to extraction and/or analysis for VOCs and SVOCs. All VOC and SVOC surrogate recoveries met the method criteria indicating acceptable analytical efficiency.

Method blanks were extracted and/or analyzed for all parameters. The results were non-detect for the compounds of interest indicating acceptable analytical procedures with the exception of toluene. All associated sample results were qualified as non-detect (see Table 3).

A trip blank was submitted with the samples for VOC analysis. All VOC results were non-detect for the compounds of interest with the exception of toluene. All associated sample results were significantly greater than the concentration found in the blank and were not impacted.

Blank spikes (BS) were prepared and analyzed for all parameters. All recoveries showed acceptable analytical accuracy.

A matrix spike/matrix spike duplicate (MS/MSD) was prepared and analyzed for VOCs and SVOCs. All recoveries were acceptable indicating adequate analytical accuracy and precision with the exception of a high benzene recovery. The sample results were qualified as estimated (see Table 4).

A field duplicate was submitted "blind" to the laboratory for analysis as specified in Table 1. All the results showed good precision outside of the estimated regions of detection, indicating acceptable analytical and sampling precision.

CONCLUSION

Based on the preceding assessment, the data were acceptable with the qualifications noted.

TABLE 1

SAMPLE COLLECTION AND ANALYSIS SUMMARY
ANNUAL GROUNDWATER SAMPLING
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK
MAY 2006

Sample ID	Location ID	Collection Date (mm/dd/yy)	Collection Time (hr:min)	Parameters		Comments
				VOCs	SVOCs	
WG-7987-053006-001	OGC-4	05/30/06	10:00	x	x	
WG-7987-053006-002	MW-9	05/30/06	10:10	x	x	
WG-7987-053006-003	OGC-8	05/30/06	10:50	x	x	
WG-7987-053006-004	River South	05/30/06	11:00	x	x	
WG-7987-053006-005	OGC-3	05/30/06	11:40	x	x	MS/MSD
WG-7987-053006-006	MW-8	05/30/06	12:10	x	x	
WG-7987-053006-007	OGC-7	05/30/06	13:25	x	x	
WG-7987-053006-008	OGC-2	05/30/06	13:40	x	x	
WG-7987-053006-009	OGC-5	05/30/06	14:10	x	x	
WG-7987-053006-010	MW-6	05/30/06	14:20	x	x	
WG-7987-053106-011	OGC-1	05/31/06	9:00	x	x	
WG-7987-053106-012	River North	05/31/06	9:30	x	x	
WG-7987-053106-013	OGC-6	05/31/06	10:00	x	x	
WG-7987-053106-014	OGC-6	05/31/06	10:05	x	x	Field duplicate of WG-7987-053106-013
WG-7987-053106-015	MW-7	05/31/06	11:05	x	x	
WG-7987-053106-016	River Middle	05/31/06	11:15	x	x	
TB-7987-053006-DMC	Trip Blank	05/30/06	-	x	x	Trip Blank

Notes:

- Not applicable.
- MS Matrix Spike.
- MSD Matrix Spike Duplicate.
- VOCs Volatile Organic Compounds.
- SVOCs Semi-Volatile Organic Compounds.

TABLE 2

ANALYTICAL RESULTS SUMMARY
ANNUAL GROUNDWATER SAMPLING
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK
MAY 2006

Parameters	Units	Sample Location:		MW6	MW7	MW8	MW9	NORTH-RIVER	OGC1	OGC2
		Sample ID:	Sample Date:	WG-7987-053006-010	WG-7987-053106-015	WG-7987-053006-006	WG-7987-053006-002	WG-7987-053106-012	WG-7987-053106-011	WG-7987-053006-008
				5/30/2006	5/31/2006	5/30/2006	5/30/2006	5/31/2006	5/31/2006	5/31/2006
Volatile Organic Compounds										
2-Butanone (Methyl Ethyl Ketone)	µg/L	5.0 U		5.0 U	5.0 U	5.0 U	2.6 J	5.0 U	5.0 U	5.0 U
Acetone	µg/L	5.0 U		31	3.0 J	16	17	5.0 U	5.0 U	5.0 U
Benzene	µg/L	0.70 U		0.70 U	0.70 U	4.4	0.54 J	0.70 U	0.70 U	0.70 U
Chlorobenzene	µg/L	1.0 U		1.0 U	1.0 U	2.4	1.5	1.0 U	1.0 U	1.0 U
Ethylbenzene	µg/L	1.0 U		1.0 U	1.0 U	5.8	0.83 J	2.9	1.0 U	1.0 U
Methylene chloride	µg/L	1.0 U		1.0 U	1.0 U	0.64 J	1.0 U	1.0 U	1.0 U	1.0 U
Tetrachloroethene	µg/L	1.0 U		1.0 U	1.0 U	71	0.57 J	1.3	1.0 U	1.0 U
Toluene	µg/L	1.5 U		1.3 U	1.0 U	33	3.3 U	14	1.4 U	1.0 U
trans-1,2-Dichloroethene	µg/L	1.0 U		1.0 U	1.0 U	5.3	0.42 J	1.0 U	0.55 J	1.0 U
Trichloroethene	µg/L	1.0 U		1.2	1.0 U	150	1.8	0.59 J	1.9	1.0 U
Vinyl chloride	µg/L	1.0 U		1.0 U	1.0 U	5.1	4.0	1.0 U	1.0 U	1.0 U
Xylene (total)	µg/L	3.0 U		3.0 U	3.0 U	25	2.0 J	23	3.0 U	3.0 U
Semi-Volatile Organic Compounds										
1,2-Dichlorobenzene	µg/L	10 U		9 U	10 U	9 U	9 U	10 U	9 U	9 U
1,4-Dichlorobenzene	µg/L	10 U		9 U	10 U	9 U	9 U	10 U	9 U	9 U
2,4-Dimethylphenol	µg/L	10 U		9 U	10 U	5 J	58	10 U	9 U	9 U
2-Methylphenol	µg/L	10 U		9 U	10 U	6 J	8 J	10 U	9 U	9 U
4-Methylphenol	µg/L	10 U		1 J	10 U	16	190	10 U	2 J	9 U
Di-n-octyl phthalate	µg/L	10 U		9 U	10 U	9 U	9 U	10 U	9 U	9 U
Naphthalene	µg/L	10 U		9 U	10 U	9 U	9 U	10 U	9 U	9 U
Phenol	µg/L	10 U		2 J	10 U	4 J	49	10 U	9 U	9 U

TABLE 2
ANALYTICAL RESULTS SUMMARY
ANNUAL GROUNDWATER SAMPLING
GRATWICK-RIVERSIDE PARK SITE
NORTH TONAWANDA, NEW YORK
MAY 2006

Sample Location:		OGC3	OGC4	OGC5	OGC6	OGC6	OGC7	OGC8	South River
Sample ID:	WG-7987-053006-005	WG-7987-053006-001	WG-7987-053006-009	WG-7987-053106-013	WG-7987-053106-014	WG-7987-053006-007	WG-7987-053006-003	WG-7987-053006-004	WG-7987-053006-004
Sample Date:	5/30/2006	5/30/2006	5/30/2006	5/31/2006	5/31/2006	5/30/2006	5/30/2006	5/30/2006	5/30/2006
Parameters	Units	Duplicate							
Volatile Organic Compounds									
2-Butanone (Methyl Ethyl Ketone)	µg/L	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Acetone	µg/L	2.8 J	5.0 U	3.0 J	8.6	8.7	5.0 U	5.0 U	5.0 U
Benzene	µg/L	0.93 J	0.70 U	0.67 J	12	12	0.70 U	0.92	0.70 U
Chlorobenzene	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.44 J	1.0 U
Ethylbenzene	µg/L	1.1	0.44 J	1.0 U	20	20	1.3	0.99 J	1.0 U
Methylene chloride	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Tetrachloroethene	µg/L	0.61 J	1.0 U	1.0 U	2000	2100	2.8	4.0	1.0 U
Toluene	µg/L	3.1 U	1.6 U	1.4 U	240	260	8.6	8.3	1.2 U
trans-1,2-Dichloroethene	µg/L	1.0 U	1.0 U	1.0 U	11	12	5.8	1.0 U	1.0 U
Trichloroethene	µg/L	5.6	0.53 J	1.0 U	1800	1800	37	7.6	1.0 U
Vinyl chloride	µg/L	1.0 U	1.0 U	1.2	2.9	2.8	2.9	1.0 U	1.0 U
Xylene (total)	µg/L	2.9 J	3.0 U	3.0 U	79	76	8.2	3.2	3.0 U
Semi-Volatile Organic Compounds									
1,2-Dichlorobenzene	µg/L	9 U	10 U	10 U	10 U	9 U	9 U	10 U	9 U
1,4-Dichlorobenzene	µg/L	9 U	10 U	10 U	10 U	9 U	9 U	10 U	9 U
2,4-Dimethylphenol	µg/L	6 J	10 U	10 U	10 U	9 U	9 U	10 U	9 U
2-Methylphenol	µg/L	64	10 U	10 U	89	110	9 U	3 J	9 U
4-Methylphenol	µg/L	13	15	10 U	84	100	9 U	8 J	9 U
Di-n-octyl phthalate	µg/L	9 U	10 U	10 U	10 U	9 U	9 U	10 U	9 U
Naphthalene	µg/L	9 U	10 U	10 U	1 J	2 J	9 U	10 U	9 U
Phenol	µg/L	75	510	10 U	13	16	9 U	10 U	9 U

Notes:

J Estimated.

U Non-detect at associated value.

TABLE 3

QUALIFIED SAMPLE RESULTS DUE TO ANALYTE CONCENTRATIONS IN THE METHOD BLANKS
 ANNUAL GROUNDWATER SAMPLING
 GRATWICK-RIVERSIDE PARK SITE
 NORTH TONAWANDA, NEW YORK
 MAY 2006

Parameter	Analysis Date	Analyte	Blank Result	Sample ID	Sample Result	Qualified Result	Units
Volatiles	06/01/06	Toluene	0.95J	WG-7987-053106-011	1.4	1.4 U	µg/L
				WG-7987-053006-010	1.3	1.3 U	µg/L
				WG-7987-053006-009	1.4	1.4 U	µg/L
				WG-7987-053006-008	1.0	1.0 U	µg/L
				WG-7987-053006-005	3.1	3.1 U	µg/L
				WG-7987-053006-004	1.2	1.2 U	µg/L
				WG-7987-053006-002	3.3	3.3 U	µg/L
				WG-7987-053006-001	1.6	1.6 U	µg/L
Volatiles	06/02/06	Toluene	0.68J	WG-7987-053106-016	1.5	1.5 U	µg/L
				WG-7987-053106-015	0.89 J	1.0 U	µg/L

Notes:

J Estimated.

U Non-detect at associated value.

TABLE 4

QUALIFIED SAMPLE RESULTS DUE TO OUTLYING MATRIX SPIKE/MATRIX SPIKE DUPLICATE RECOVERIES
 ANNUAL GROUNDWATER SAMPLING
 GRATWICK-RIVERSIDE PARK SITE
 NORTH TONAWANDA, NEW YORK
 MAY 2006

Parameter	Associated Sample ID	Analyte	MS Recovery (percent)	MSD Recovery (percent)	RPD	Control Limits		Sample Result	Units	Qualifier
						Recovery (percent)	RPD (percent)			
Volatiles	WG-7987-053006-005	Benzene	118	137	15	67-128	13	0.93	µg/L	J

Notes:

- J Estimated.
- MS Matrix Spike.
- MSD Matrix Spike Duplicate.
- RPD Relative Percent Difference.