APPENDIX A - MONTHLY FLOW TABLES

650 Suffolk St., Suite 200
Lowell, MA 01854

T 978.970.5600
TRCcompanies.com

May 5th, 2025

Stephen Stewart
Niagara Falls Water Board
Water Treatment Plant
5815 Buffalo Ave., Niagara Falls, NY 14304
(716) 283-9770

Re: April 2025 Daily Flows for Monitoring Station MS-1
Sherwood Forest Properties
3163 Buffalo Avenue
Niagara Falls, NY
SIU Permit # 55

Dear Mr. Stewart:

TRC Environmental Corporation is submitting this daily effluent flow report for monitoring station MS-1, located at Sherwood Forest Properties, 3163 Buffalo Avenue, Niagara Falls, NY in accordance with Significant Industrial User (SIU) Permit # 55.

If you have any questions, please do not hesitate to contact us.

Sincerely,

TRC Environmental Corporation

David McKenzie, PE (MI, IL, OH)

Attachment

Cc: Nathan Sarapas, TRC
John Mulhall, TRC

DAILY FLOWS
MONITORING STATION MS-1
SHERWOOD FOREST PROPERTIES, LTD
3163 BUFFALO AVENUE, NIAGARA FALLS, NY
SIU PERMIT NO. 55
FOR APRIL 2025

Date Time	Totalizer Reading (Gallons)	Daily Flow (MGD)
2025-03-31 08:00	235725800	
2025-04-01 08:00	235746200	0.0204
2025-04-02 08:00	235764500	0.0183
2025-04-03 08:00	235780500	0.0160
2025-04-04 08:00	235804700	0.0242
2025-04-05 08:00	235862900	0.0582
2025-04-06 08:00	235927300	0.0644
2025-04-07 08:00	235991200	0.0639
2025-04-08 08:00	236049700	0.0585
2025-04-09 08:00	236049700	0.0000
2025-04-10 08:00	236049700	0.0000
2025-04-11 08:00	236083300	0.0336
2025-04-12 08:00	236129500	0.0462
2025-04-13 08:00	236191100	0.0616
2025-04-14 08:00	236247200	0.0561
2025-04-15 08:00	236287700	0.0405
2025-04-16 08:00	236326900	0.0392
2025-04-17 08:00	236371000	0.0441
2025-04-18 08:00	236412600	0.0416
2025-04-19 08:00	236455100	0.0425
2025-04-20 08:00	236508100	0.0530
2025-04-21 08:00	236557500	0.0494
2025-04-22 08:00	236622500	0.0650
2025-04-23 08:00	236703000	0.0805
2025-04-24 08:00	236785200	0.0822
2025-04-25 08:00	236785500	0.0003
2025-04-26 08:00	236851800	0.0663
2025-04-27 08:00	236938200	0.0864
2025-04-28 08:00	237021500	0.0833
2025-04-29 08:00	237100600	0.0791
2025-04-30 08:00	237181600	0.0810

Total Flow Discharged for Month 1.4558 million gallons

Average Daily Flow 0.05 million gallons

Note:
1) The last flowmeter calibration was conducted on August 8, 2024 by Cold Spring Environmental.

650 Suffolk St., Suite 200
Lowell, MA 01854

T 978.970.5600
TRCcompanies.com

June 3rd, 2025

Stephen Stewart
Niagara Falls Water Board
Water Treatment Plant
5815 Buffalo Ave., Niagara Falls, NY 14304
(716) 283-9770

Re: May 2025 Daily Flows for Monitoring Station MS-1
Sherwood Forest Properties
3163 Buffalo Avenue
Niagara Falls, NY
SIU Permit # 55

Dear Mr. Stewart:

TRC Environmental Corporation is submitting this daily effluent flow report for monitoring station MS-1, located at Sherwood Forest Properties, 3163 Buffalo Avenue, Niagara Falls, NY in accordance with Significant Industrial User (SIU) Permit # 55.

If you have any questions, please do not hesitate to contact us.

Sincerely,

TRC Environmental Corporation

David McKenzie, PE (MI, IL, OH)

Attachment

Cc: Nathan Sarapas, TRC
John Mulhall, TRC

DAILY FLOWS
MONITORING STATION MS-1
SHERWOOD FOREST PROPERTIES, LTD
3163 BUFFALO AVENUE, NIAGARA FALLS, NY
SIU PERMIT NO. 55
FOR MAY 2025

	Totalizer Reading	Daily Flow
Date Time	(Gallons)	(MGD)
2025-04-30 08:00	237181600	
2025-05-01 08:00	237264900	0.0833
2025-05-02 08:00	237349900	0.0850
2025-05-03 08:00	237435400	0.0855
2025-05-04 08:00	237519300	0.0839
2025-05-05 08:00	237603600	0.0843
2025-05-06 08:00	237692000	0.0884
2025-05-07 08:00	237771500	0.0795
2025-05-08 08:00	237852300	0.0808
2025-05-09 08:00	237928800	0.0765
2025-05-10 08:00	237992500	0.0637
2025-05-11 08:00	238074900	0.0824
2025-05-12 08:00	238157400	0.0825
2025-05-13 08:00	238243100	0.0857
2025-05-14 08:00	238327700	0.0846
2025-05-15 08:00	238407500	0.0798
2025-05-16 08:00	238490000	0.0825
2025-05-17 08:00	238570600	0.0806
2025-05-18 08:00	238656300	0.0857
2025-05-19 08:00	238742600	0.0863
2025-05-20 08:00	238831700	0.0891
2025-05-21 08:00	238919000	0.0873
2025-05-22 08:00	239007600	0.0886
2025-05-23 08:00	239095100	0.0875
2025-05-24 08:00	239177400	0.0823
2025-05-25 08:00	239261500	0.0841
2025-05-26 08:00	239343200	0.0817
2025-05-27 08:00	239424100	0.0809
2025-05-28 08:00	239504400	0.0803
2025-05-29 08:00	239509100	0.0047
2025-05-30 08:00	239572500	0.0634
2025-05-31 08:00	239649000	0.0765

Total Flow Discharged for Month 2.4674 million gallons

Average Daily Flow 0.08 million gallons

Note:
1) The last flowmeter calibration was conducted on August 8, 2024 by Cold Spring Environmental.

650 Suffolk St., Suite 200
Lowell, MA 01854

T 978.970.5600
TRCcompanies.com

July 7th, 2025

Stephen Stewart
Niagara Falls Water Board
Water Treatment Plant
5815 Buffalo Ave., Niagara Falls, NY 14304
(716) 283-9770

Re: June 2025 Daily Flows for Monitoring Station MS-1
Sherwood Forest Properties
3163 Buffalo Avenue
Niagara Falls, NY
SIU Permit # 55

Dear Mr. Stewart:

TRC Environmental Corporation is submitting this daily effluent flow report for monitoring station MS-1, located at Sherwood Forest Properties, 3163 Buffalo Avenue, Niagara Falls, NY in accordance with Significant Industrial User (SIU) Permit # 55.

If you have any questions, please do not hesitate to contact us.

Sincerely,

TRC Environmental Corporation

David McKenzie, PE (MI, IL, OH)

Attachment

Cc: Nathan Sarapas, TRC
John Mulhall, TRC

DAILY FLOWS
MONITORING STATION MS-1
SHERWOOD FOREST PROPERTIES, LTD
3163 BUFFALO AVENUE, NIAGARA FALLS, NY
SIU PERMIT NO. 55
FOR JUNE 2025

Date Time	Totalizer Reading (Gallons)	Daily Flow (MGD)
2025-05-31 08:00	239649000	
2025-06-01 08:00	239730400	0.0814
2025-06-02 08:00	239812100	0.0817
2025-06-03 08:00	239893200	0.0811
2025-06-04 08:00	239959400	0.0662
2025-06-05 08:00	240044400	0.0850
2025-06-06 08:00	240117800	0.0734
2025-06-07 08:00	240203300	0.0855
2025-06-08 08:00	240290900	0.0876
2025-06-09 08:00	240378600	0.0877
2025-06-10 08:00	240462300	0.0837
2025-06-11 08:00	240525300	0.0630
2025-06-12 08:00	240599000	0.0737
2025-06-13 08:00	240674100	0.0751
2025-06-14 08:00	240736500	0.0624
2025-06-15 08:00	240819700	0.0832
2025-06-16 08:00	240902700	0.0830
2025-06-17 08:00	240985300	0.0826
2025-06-18 08:00	241065400	0.0801
2025-06-19 08:00	241140800	0.0754
2025-06-20 08:00	241199700	0.0589
2025-06-21 08:00	241271400	0.0717
2025-06-22 08:00	241348200	0.0768
2025-06-23 08:00	241419700	0.0715
2025-06-24 08:00	241480500	0.0608
2025-06-25 08:00	241557500	0.0770
2025-06-26 08:00	241639600	0.0821
2025-06-27 08:00	241720400	0.0808
2025-06-28 08:00	241801200	0.0808
2025-06-29 08:00	241887100	0.0859
2025-06-30 08:00	241970100	0.0830

Total Flow Discharged for Month 2.3211 million gallons

Average Daily Flow 0.08 million gallons

Note:
1) The last flowmeter calibration was conducted on August 8, 2024 by Cold Spring Environmental.

650 Suffolk St., Suite 200
Lowell, MA 01854

T 978.970.5600
TRCcompanies.com

August 1st, 2025

Stephen Stewart
Niagara Falls Water Board
Water Treatment Plant
5815 Buffalo Ave., Niagara Falls, NY 14304
(716) 283-9770

Re: July 2025 Daily Flows for Monitoring Station MS-1
Sherwood Forest Properties
3163 Buffalo Avenue
Niagara Falls, NY
SIU Permit # 55

Dear Mr. Stewart:

TRC Environmental Corporation is submitting this daily effluent flow report for monitoring station MS-1, located at Sherwood Forest Properties, 3163 Buffalo Avenue, Niagara Falls, NY in accordance with Significant Industrial User (SIU) Permit # 55.

If you have any questions, please do not hesitate to contact us.

Sincerely,

TRC Environmental Corporation

David McKenzie, PE (MI, IL, OH)

Attachment

Cc: Nathan Sarapas, TRC
John Mulhall, TRC

DAILY FLOWS
MONITORING STATION MS-1
SHERWOOD FOREST PROPERTIES, LTD
3163 BUFFALO AVENUE, NIAGARA FALLS, NY
SIU PERMIT NO. 55
FOR JULY 2025

Date Time	Totalizer Reading (Gallons)	Daily Flow (MGD)
2025-06-30 08:00	241970100	
2025-07-01 08:00	242058300	0.0882
2025-07-02 08:00	242149200	0.0909
2025-07-03 08:00	242160700	0.0115
2025-07-04 08:00	242231800	0.0711
2025-07-05 08:00	242316700	0.0849
2025-07-06 08:00	242401800	0.0851
2025-07-07 08:00	242488300	0.0865
2025-07-08 08:00	242573800	0.0855
2025-07-09 08:00	242644900	0.0711
2025-07-10 08:00	242662300	0.0174
2025-07-11 08:00	242724600	0.0623
2025-07-12 08:00	242802200	0.0776
2025-07-13 08:00	242888900	0.0867
2025-07-14 08:00	242976100	0.0872
2025-07-15 08:00	243053500	0.0774
2025-07-16 08:00	243141200	0.0877
2025-07-17 08:00	243225400	0.0842
2025-07-18 08:00	243225400	0.0000
2025-07-19 08:00	243298100	0.0727
2025-07-20 08:00	243382900	0.0848
2025-07-21 08:00	243465000	0.0821
2025-07-22 08:00	243544300	0.0793
2025-07-23 08:00	243627200	0.0829
2025-07-24 08:00	243693700	0.0665
2025-07-25 08:00	243775300	0.0816
2025-07-26 08:00	243846300	0.0710
2025-07-27 08:00	243928200	0.0819
2025-07-28 08:00	244010700	0.0825
2025-07-29 08:00	244094500	0.0838
2025-07-30 08:00	244175600	0.0811
2025-07-31 08:00	244179700	0.0041

Total Flow Discharged for Month 2.2096 million gallons

Average Daily Flow 0.07 million gallons

Note:
1) The last flowmeter calibration was conducted on August 8, 2024 by Cold Spring Environmental.

650 Suffolk St., Suite 200
Lowell, MA 01854

T 978.970.5600
TRCcompanies.com

September 2nd, 2025

Stephen Stewart
Niagara Falls Water Board
Water Treatment Plant
5815 Buffalo Ave., Niagara Falls, NY 14304
(716) 283-9770

Re: August 2025 Daily Flows for Monitoring Station MS-1
Sherwood Forest Properties
3163 Buffalo Avenue
Niagara Falls, NY
SIU Permit # 55

Dear Mr. Stewart:

TRC Environmental Corporation is submitting this daily effluent flow report for monitoring station MS-1, located at Sherwood Forest Properties, 3163 Buffalo Avenue, Niagara Falls, NY in accordance with Significant Industrial User (SIU) Permit # 55.

If you have any questions, please do not hesitate to contact us.

Sincerely,

TRC Environmental Corporation

David McKenzie, PE (MI, IL, OH)

Attachment

Cc: Nathan Sarapas, TRC
John Mulhall, TRC

DAILY FLOWS
MONITORING STATION MS-1
SHERWOOD FOREST PROPERTIES, LTD
3163 BUFFALO AVENUE, NIAGARA FALLS, NY
SIU PERMIT NO. 55
FOR AUGUST 2025

	Totalizer Reading	Daily Flow
Date Time	(Gallons)	(MGD)
2025-07-31 08:00	244179700	
2025-08-01 08:00	244259000	0.0793
2025-08-02 08:00	244362400	0.1034
2025-08-03 08:00	244466900	0.1045
2025-08-04 08:00	244568800	0.1019
2025-08-05 08:00	244665700	0.0969
2025-08-06 08:00	244741800	0.0761
2025-08-07 08:00	244820000	0.0782
2025-08-08 08:00	244873800	0.0538
2025-08-09 08:00	244953300	0.0795
2025-08-10 08:00	245050600	0.0973
2025-08-11 08:00	245149400	0.0988
2025-08-12 08:00	245238100	0.0887
2025-08-13 08:00	245336500	0.0984
2025-08-14 08:00	245436000	0.0995
2025-08-15 08:00	245532900	0.0969
2025-08-16 08:00	245625000	0.0921
2025-08-17 08:00	245722700	0.0977
2025-08-18 08:00	245821600	0.0989
2025-08-19 08:00	245915700	0.0941
2025-08-20 08:00	245917700	0.0020
2025-08-21 08:00	245917700	0.0000
2025-08-22 08:00	246006400	0.0887
2025-08-23 08:00	246081400	0.0750
2025-08-24 08:00	246178700	0.0973
2025-08-25 08:00	246276900	0.0982
2025-08-26 08:00	246363600	0.0867
2025-08-27 08:00	246418300	0.0547
2025-08-28 08:00	246419000	0.0007
2025-08-29 08:00	246419500	0.0005
2025-08-30 08:00	246493900	0.0744
2025-08-31 08:00	246591000	0.0971

Total Flow Discharged for Month 2.4113 million gallons

Average Daily Flow 0.08 million gallons

Note:
1) The last flowmeter calibration was conducted on August 13, 2025 by Cold Spring Environmental.

650 Suffolk St., Suite 200
Lowell, MA 01854

T 978.970.5600
TRCcompanies.com

October 2nd, 2025

Stephen Stewart
Niagara Falls Water Board
Water Treatment Plant
5815 Buffalo Ave., Niagara Falls, NY 14304
(716) 283-9770

Re: September 2025 Daily Flows for Monitoring Station MS-1
Sherwood Forest Properties
3163 Buffalo Avenue
Niagara Falls, NY
SIU Permit # 55

Dear Mr. Stewart:

TRC Environmental Corporation is submitting this daily effluent flow report for monitoring station MS-1, located at Sherwood Forest Properties, 3163 Buffalo Avenue, Niagara Falls, NY in accordance with Significant Industrial User (SIU) Permit # 55.

If you have any questions, please do not hesitate to contact us.

Sincerely,

TRC Environmental Corporation

David McKenzie, PE (MI, IL, OH)

Attachment

Cc: Nathan Sarapas, TRC
John Mulhall, TRC

DAILY FLOWS
MONITORING STATION MS-1
SHERWOOD FOREST PROPERTIES, LTD
3163 BUFFALO AVENUE, NIAGARA FALLS, NY
SIU PERMIT NO. 55
FOR SEPTEMBER 2025

Date Time	Totalizer Reading (Gallons)	Daily Flow (MGD)
2025-08-31 08:00	246591000	
2025-09-01 08:00	246687500	0.0965
2025-09-02 08:00	246785600	0.0981
2025-09-03 08:00	246885400	0.0998
2025-09-04 08:00	246971500	0.0861
2025-09-05 08:00	247042300	0.0708
2025-09-06 08:00	247117500	0.0752
2025-09-07 08:00	247213000	0.0955
2025-09-08 08:00	247308700	0.0957
2025-09-09 08:00	247392700	0.0840
2025-09-10 08:00	247467200	0.0745
2025-09-11 08:00	247538700	0.0715
2025-09-12 08:00	247602400	0.0637
2025-09-13 08:00	247675600	0.0732
2025-09-14 08:00	247768100	0.0925
2025-09-15 08:00	247861400	0.0933
2025-09-16 08:00	247953800	0.0924
2025-09-17 08:00	248046000	0.0922
2025-09-18 08:00	248139100	0.0931
2025-09-19 08:00	248233000	0.0939
2025-09-20 08:00	248320900	0.0879
2025-09-21 08:00	248413800	0.0929
2025-09-22 08:00	248502900	0.0891
2025-09-23 08:00	248591300	0.0884
2025-09-24 08:00	248672500	0.0812
2025-09-25 08:00	248758500	0.0860
2025-09-26 08:00	248842600	0.0841
2025-09-27 08:00	248908000	0.0654
2025-09-28 08:00	248995400	0.0874
2025-09-29 08:00	249076700	0.0813
2025-09-30 08:00	249141200	0.0645

Total Flow Discharged for Month 2.5502 million gallons

Average Daily Flow 0.09 million gallons

Note:
1) The last flowmeter calibration was conducted on August 13, 2025 by Cold Spring Environmental.

650 Suffolk St., Suite 200
Lowell, MA 01854

T 978.970.5600
TRCcompanies.com

November 6th, 2025

Stephen Stewart
Niagara Falls Water Board
Water Treatment Plant
5815 Buffalo Ave., Niagara Falls, NY 14304
(716) 283-9770

Re: October 2025 Daily Flows for Monitoring Station MS-1
Sherwood Forest Properties
3163 Buffalo Avenue
Niagara Falls, NY
SIU Permit # 55

Dear Mr. Stewart:

TRC Environmental Corporation is submitting this daily effluent flow report for monitoring station MS-1, located at Sherwood Forest Properties, 3163 Buffalo Avenue, Niagara Falls, NY in accordance with Significant Industrial User (SIU) Permit # 55.

If you have any questions, please do not hesitate to contact us.

Sincerely,

TRC Environmental Corporation

David McKenzie, PE (MI, IL, OH)

Attachment

Cc: Nathan Sarapas, TRC
John Mulhall, TRC

DAILY FLOWS
MONITORING STATION MS-1
SHERWOOD FOREST PROPERTIES, LTD
3163 BUFFALO AVENUE, NIAGARA FALLS, NY
SIU PERMIT NO. 55
FOR OCTOBER 2025

	Totalizer Reading	Daily Flow
Date Time	(Gallons)	(MGD)
2025-09-30 08:00	249141200	
2025-10-01 08:00	249215500	0.0743
2025-10-02 08:00	249282200	0.0667
2025-10-03 08:00	249366200	0.0840
2025-10-04 08:00	249451900	0.0857
2025-10-05 08:00	249541800	0.0899
2025-10-06 08:00	249632300	0.0905
2025-10-07 08:00	249716600	0.0843
2025-10-08 08:00	249804100	0.0875
2025-10-09 08:00	249894000	0.0899
2025-10-10 08:00	249962900	0.0689
2025-10-11 08:00	250041900	0.0790
2025-10-12 08:00	250129500	0.0876
2025-10-13 08:00	250212600	0.0831
2025-10-14 08:00	250278800	0.0662
2025-10-15 08:00	250366500	0.0877
2025-10-16 08:00	250433600	0.0671
2025-10-17 08:00	250516700	0.0831
2025-10-18 08:00	250583400	0.0667
2025-10-19 08:00	250671600	0.0882
2025-10-20 08:00	250758600	0.0870
2025-10-21 08:00	250846700	0.0881
2025-10-22 08:00	250934800	0.0881
2025-10-23 08:00	251024600	0.0898
2025-10-24 08:00	251115600	0.0910
2025-10-25 08:00	251207400	0.0918
2025-10-26 08:00	251298900	0.0915
2025-10-27 08:00	251387800	0.0889
2025-10-28 08:00	251477200	0.0894
2025-10-29 08:00	251565800	0.0886
2025-10-30 08:00	251647400	0.0816
2025-10-31 08:00	251737000	0.0896

Total Flow Discharged for Month 2.5958 million gallons

Average Daily Flow 0.08 million gallons

Note:
1) The last flowmeter calibration was conducted on August 13, 2025 by Cold Spring Environmental.

650 Suffolk St., Suite 200
Lowell, MA 01854

T 978.970.5600
TRCcompanies.com

December 8th, 2025

Stephen Stewart
Niagara Falls Water Board
Water Treatment Plant
5815 Buffalo Ave., Niagara Falls, NY 14304
(716) 283-9770

Re: November 2025 Daily Flows for Monitoring Station MS-1
Sherwood Forest Properties
3163 Buffalo Avenue
Niagara Falls, NY
SIU Permit # 55

Dear Mr. Stewart:

TRC Environmental Corporation is submitting this daily effluent flow report for monitoring station MS-1, located at Sherwood Forest Properties, 3163 Buffalo Avenue, Niagara Falls, NY in accordance with Significant Industrial User (SIU) Permit # 55.

If you have any questions, please do not hesitate to contact us.

Sincerely,

TRC Environmental Corporation

David McKenzie, PE (MI, IL, OH)

Attachment

Cc: Nathan Sarapas, TRC
John Mulhall, TRC

DAILY FLOWS
MONITORING STATION MS-1
SHERWOOD FOREST PROPERTIES, LTD
3163 BUFFALO AVENUE, NIAGARA FALLS, NY
SIU PERMIT NO. 55
FOR NOVEMBER 2025

Date Time	Totalizer Reading (Gallons)	Daily Flow (MGD)
2025-10-31 08:00	251737000	
2025-11-01 08:00	251822800	0.0858
2025-11-02 08:00	251909900	0.0871
2025-11-03 08:00	251998300	0.0884
2025-11-04 08:00	252084700	0.0864
2025-11-05 08:00	252172500	0.0878
2025-11-06 08:00	252254300	0.0818
2025-11-07 08:00	252337700	0.0834
2025-11-08 08:00	252420900	0.0832
2025-11-09 08:00	252505200	0.0843
2025-11-10 08:00	252586100	0.0809
2025-11-11 08:00	252586100	0.0000
2025-11-12 08:00	252586100	0.0000
2025-11-13 08:00	252586100	0.0000
2025-11-14 08:00	252586100	0.0000
2025-11-15 08:00	252586100	0.0000
2025-11-16 08:00	252586100	0.0000
2025-11-17 08:00	252589900	0.0000
2025-11-18 08:00	252932700	0.0000
2025-11-19 08:00	253296900	0.0000
2025-11-20 08:00	253660900	0.0000
2025-11-21 08:00	254024700	0.0000
2025-11-22 08:00	254388800	0.0000
2025-11-23 08:00	254752800	0.0000
2025-11-24 08:00	255116500	0.0000
2025-11-25 08:00	255167700	0.0512
2025-11-26 08:00	255255100	0.0874
2025-11-27 08:00	255341600	0.0865
2025-11-28 08:00	255425000	0.0834
2025-11-29 08:00	255508100	0.0831
2025-11-30 08:00	255593000	0.0849

Total Flow Discharged for Month 1.3256 million gallons

Average Daily Flow 0.04 million gallons

Note:

1) The annual maintenance shutdown was performed from 11/10/2025 to 11/24/2025. No flow occurred.
2) During the annual shutdown, the flowmeter malfunctioned on 11/17, giving erroneous readings. The meter was repaired and recalibrated on 11/25.

650 Suffolk St., Suite 200
Lowell, MA 01854

T 978.970.5600
TRCcompanies.com

January 5th, 2026

Stephen Stewart
Niagara Falls Water Board
Water Treatment Plant
5815 Buffalo Ave., Niagara Falls, NY 14304
(716) 283-9770

Re: December 2025 Daily Flows for Monitoring Station MS-1
Sherwood Forest Properties
3163 Buffalo Avenue
Niagara Falls, NY
SIU Permit # 55

Dear Mr. Stewart:

TRC Environmental Corporation is submitting this daily effluent flow report for monitoring station MS-1, located at Sherwood Forest Properties, 3163 Buffalo Avenue, Niagara Falls, NY in accordance with Significant Industrial User (SIU) Permit # 55.

If you have any questions, please do not hesitate to contact us.

Sincerely,

TRC Environmental Corporation

David McKenzie, PE (MI, IL, OH)

Attachment

Cc: Nathan Sarapas, TRC
John Mulhall, TRC

DAILY FLOWS
MONITORING STATION MS-1
SHERWOOD FOREST PROPERTIES, LTD
3163 BUFFALO AVENUE, NIAGARA FALLS, NY
SIU PERMIT NO. 55
FOR DECEMBER 2025

Date Time	Totalizer Reading (Gallons)	Daily Flow (MGD)
2025-11-30 08:00	255593000	0.0837
2025-12-01 08:00	255677000	0.0840
2025-12-02 08:00	255762000	0.0850
2025-12-03 08:00	255839700	0.0777
2025-12-04 08:00	255907500	0.0678
2025-12-05 08:00	255958100	0.0506
2025-12-06 08:00	256006600	0.0485
2025-12-07 08:00	256057200	0.0506
2025-12-08 08:00	256108700	0.0515
2025-12-09 08:00	256161400	0.0527
2025-12-10 08:00	256211600	0.0502
2025-12-11 08:00	256254600	0.0430
2025-12-12 08:00	256334000	0.0794
2025-12-13 08:00	256343600	0.0096
2025-12-14 08:00	256343600	0.0000
2025-12-15 08:00	256343600	0.0000
2025-12-16 08:00	256394500	0.0509
2025-12-17 08:00	256412200	0.0177
2025-12-18 08:00	256412200	0.0000
2025-12-19 08:00	256413600	0.0014
2025-12-20 08:00	256463700	0.0501
2025-12-21 08:00	256511400	0.0477
2025-12-22 08:00	256559300	0.0479
2025-12-23 08:00	256560400	0.0011
2025-12-24 08:00	256560400	0.0000
2025-12-25 08:00	256595200	0.0348
2025-12-26 08:00	256642600	0.0474
2025-12-27 08:00	256689900	0.0473
2025-12-28 08:00	256737100	0.0472
2025-12-29 08:00	256766100	0.0290
2025-12-30 08:00	256766100	0.0000
2025-12-31 08:00	256766100	0.0000

Total Flow Discharged for Month 1.1731 million gallons

Average Daily Flow 0.04 million gallons

Note:
1) The last flowmeter calibration was conducted on November 25, 2025 by Cold Spring Environmental.

650 Suffolk St., Suite 200
Lowell, MA 01854

T 978.970.5600
TRCcompanies.com

February 9th, 2026

Stephen Stewart
Niagara Falls Water Board
Water Treatment Plant
5815 Buffalo Ave., Niagara Falls, NY 14304
(716) 283-9770

Re: January 2026 Daily Flows for Monitoring Station MS-1
Sherwood Forest Properties
3163 Buffalo Avenue
Niagara Falls, NY
SIU Permit # 55

Dear Mr. Stewart:

TRC Environmental Corporation is submitting this daily effluent flow report for monitoring station MS-1, located at Sherwood Forest Properties, 3163 Buffalo Avenue, Niagara Falls, NY in accordance with Significant Industrial User (SIU) Permit # 55.

If you have any questions, please do not hesitate to contact us.

Sincerely,

TRC Environmental Corporation

David McKenzie, PE (MI, IL, OH)

Attachment

Cc: Marty Schebell, NFWB
Nathan Sarapas and John Mulhall, TRC

DAILY FLOWS
MONITORING STATION MS-1
SHERWOOD FOREST PROPERTIES, LTD
3163 BUFFALO AVENUE, NIAGARA FALLS, NY
SIU PERMIT NO. 55
FOR JANUARY 2026

Date Time	Totalizer Reading (Gallons)	Daily Flow (MGD)
2025-12-31 08:00	256766100	
2026-01-01 08:00	256766100	0.0000
2026-01-02 08:00	256766100	0.0000
2026-01-03 08:00	256799300	0.0332
2026-01-04 08:00	256847600	0.0483
2026-01-05 08:00	256896600	0.0490
2026-01-06 08:00	256953400	0.0568
2026-01-07 08:00	257001600	0.0482
2026-01-08 08:00	257059000	0.0574
2026-01-09 08:00	257117500	0.0585
2026-01-10 08:00	257175000	0.0575
2026-01-11 08:00	257232500	0.0575
2026-01-12 08:00	257287800	0.0553
2026-01-13 08:00	257341100	0.0533
2026-01-14 08:00	257395400	0.0543
2026-01-15 08:00	257448100	0.0527
2026-01-16 08:00	257503300	0.0552
2026-01-17 08:00	257554400	0.0511
2026-01-18 08:00	257602900	0.0485
2026-01-19 08:00	257650500	0.0476
2026-01-20 08:00	257691400	0.0409
2026-01-21 08:00	257744900	0.0535
2026-01-22 08:00	257758100	0.0132
2026-01-23 08:00	257794600	0.0365
2026-01-24 08:00	257805400	0.0108
2026-01-25 08:00	257805400	0.0000
2026-01-26 08:00	257805400	0.0000
2026-01-27 08:00	257805400	0.0000
2026-01-28 08:00	257840800	0.0354
2026-01-29 08:00	257885000	0.0442
2026-01-30 08:00	257895700	0.0107
2026-01-31 08:00	257896600	0.0009

Total Flow Discharged for Month 1.1305 million gallons

Average Daily Flow 0.04 million gallons

Note:
1) The last flowmeter calibration was conducted on November 25, 2025 by Cold Spring Environmental.

650 Suffolk St., Suite 200
Lowell, MA 01854

T 978.970.5600
TRCcompanies.com

March 4th, 2026

Stephen Stewart
Niagara Falls Water Board
Water Treatment Plant
5815 Buffalo Ave., Niagara Falls, NY 14304
(716) 283-9770

Re: February 2026 Daily Flows for Monitoring Station MS-1
Sherwood Forest Properties
3163 Buffalo Avenue
Niagara Falls, NY
SIU Permit # 55

Dear Mr. Stewart:

TRC Environmental Corporation is submitting this daily effluent flow report for monitoring station MS-1, located at Sherwood Forest Properties, 3163 Buffalo Avenue, Niagara Falls, NY in accordance with Significant Industrial User (SIU) Permit # 55.

If you have any questions, please do not hesitate to contact us.

Sincerely,

TRC Environmental Corporation

David McKenzie, PE (MI, IL, OH)

Attachment

Cc: Marty Schebell, NFWB
Nathan Sarapas and John Mulhall, TRC

DAILY FLOWS
MONITORING STATION MS-1
SHERWOOD FOREST PROPERTIES, LTD
3163 BUFFALO AVENUE, NIAGARA FALLS, NY
SIU PERMIT NO. 55
FOR FEBRUARY 2026

Date Time	Totalizer Reading (Gallons)	Daily Flow (MGD)
2026-01-31 08:00	257896600	
2026-02-01 08:00	257896600	0.0000
2026-02-02 08:00	257896600	0.0000
2026-02-03 08:00	257929400	0.0328
2026-02-04 08:00	257969600	0.0402
2026-02-05 08:00	258046600	0.0770
2026-02-06 08:00	258131100	0.0845
2026-02-07 08:00	258173500	0.0424
2026-02-08 08:00	258205900	0.0324
2026-02-09 08:00	258243600	0.0377
2026-02-10 08:00	258284600	0.0410
2026-02-11 08:00	258369500	0.0849
2026-02-12 08:00	258455300	0.0858
2026-02-13 08:00	258538800	0.0835
2026-02-14 08:00	258621800	0.0830
2026-02-15 08:00	258701600	0.0798
2026-02-16 08:00	258780500	0.0789
2026-02-17 08:00	258852700	0.0722
2026-02-18 08:00	258866400	0.0137
2026-02-19 08:00	258868200	0.0018
2026-02-20 08:00	258879200	0.0110
2026-02-21 08:00	258889700	0.0105
2026-02-22 08:00	258889700	0.0000
2026-02-23 08:00	258889700	0.0000
2026-02-24 08:00	258899500	0.0098
2026-02-25 08:00	258906600	0.0071
2026-02-26 08:00	258982600	0.0760
2026-02-27 08:00	259073700	0.0911
2026-02-28 08:00	259143700	0.0700

Total Flow Discharged for Month 1.2471 million gallons

Average Daily Flow 0.04 million gallons

Note:
1) The last flowmeter calibration was conducted on November 25, 2025 by Cold Spring Environmental.

650 Suffolk St., Suite 200
Lowell, MA 01854

T 978.970.5600
TRCcompanies.com

April 7th, 2026

Stephen Stewart
Niagara Falls Water Board
Water Treatment Plant
5815 Buffalo Ave., Niagara Falls, NY 14304
(716) 283-9770

Re: March 2026 Daily Flows for Monitoring Station MS-1
Sherwood Forest Properties
3163 Buffalo Avenue
Niagara Falls, NY
SIU Permit # 55

Dear Mr. Stewart:

TRC Environmental Corporation is submitting this daily effluent flow report for monitoring station MS-1, located at Sherwood Forest Properties, 3163 Buffalo Avenue, Niagara Falls, NY in accordance with Significant Industrial User (SIU) Permit # 55.

If you have any questions, please do not hesitate to contact us.

Sincerely,

TRC Environmental Corporation

David McKenzie, PE (MI, IL, OH)

Attachment

Cc: Marty Schebell, NFWB
Nathan Sarapas and John Mulhall, TRC

DAILY FLOWS
MONITORING STATION MS-1
SHERWOOD FOREST PROPERTIES, LTD
3163 BUFFALO AVENUE, NIAGARA FALLS, NY
SIU PERMIT NO. 55
FOR MARCH 2026

	Totalizer Reading	Daily Flow
Date Time	(Gallons)	(MGD)
2026-02-28 08:00	259143700	
2026-03-01 08:00	259234500	0.0908
2026-03-02 08:00	259324300	0.0898
2026-03-03 08:00	259413000	0.0887
2026-03-04 08:00	259499100	0.0861
2026-03-05 08:00	259581500	0.0824
2026-03-06 08:00	259645600	0.0641
2026-03-07 08:00	259728500	0.0829
2026-03-08 08:00	259822500	0.0940
2026-03-09 08:00	259912200	0.0897
2026-03-10 08:00	259999500	0.0873
2026-03-11 08:00	260082400	0.0829
2026-03-12 08:00	260164800	0.0824
2026-03-13 08:00	260249900	0.0851
2026-03-14 08:00	260335800	0.0859
2026-03-15 08:00	260418900	0.0831
2026-03-16 08:00	260500500	0.0816
2026-03-17 08:00	260571500	0.0710
2026-03-18 08:00	260651200	0.0797
2026-03-19 08:00	260729800	0.0786
2026-03-20 08:00	260801200	0.0714
2026-03-21 08:00	260878800	0.0776
2026-03-22 08:00	260957500	0.0787
2026-03-23 08:00	261035100	0.0776
2026-03-24 08:00	261091900	0.0568
2026-03-25 08:00	261091900	0.0000
2026-03-26 08:00	261091900	0.0000
2026-03-27 08:00	261091900	0.0000
2026-03-28 08:00	261091900	0.0000
2026-03-29 08:00	261091900	0.0000
2026-03-30 08:00	261091900	0.0000
2026-03-31 08:00	261091900	0.0000

Total Flow Discharged for Month 1.9482 million gallons

Average Daily Flow 0.06 million gallons

Note:
1) The last flowmeter calibration was conducted on November 25, 2025 by Cold Spring Environmental.
2) The system was offline for maintenance beginning on March 25.

APPENDIX B- SELF-MONITORING REPORT FORMS

650 Suffolk Street
Lowell, MA 01854

t 978-570-5600

May 20, 2025

Maria Rocco
Niagara Falls Water Board
Wastewater Treatment Plant
5815 Buffalo Ave, Niagara Falls, NY 14304
(716) 283-9770

Re: 2025 Quarterly (Second Quarter) Self-Monitoring Report
Sherwood Forest Properties
3163 Buffalo Avenue
Niagara Falls, NY
SIU Permit # 55

Dear Ms. Rocco:

TRC Environmental Corporation is submitting this second quarter Self-Monitoring Report on behalf of Sherwood Forest Properties, Ltd, 3163 Buffalo Avenue, Niagara Falls, NY in accordance with Significant Industrial User (SIU) Permit # 55.

If you have any questions, please do not hesitate to contact us.

Sincerely,

TRC Environmental Corporation

David McKenzie, PE
Project Manager

Attachment 1 Self-Monitoring Report
Attachment 2 Lab Report

NIAGARA FALLS WATER BOARD WASTEWATER FACILITIES ENFORCEMENT DIVISION

SELF-MONITORING REPORT
SIGNIFICANT INDUSTRIAL USERS

PERMIT NO. 55

SHERWOOD FOREST PROPERTIES, LTD

The 2nd Quarterly Report

of four for 2025

Pursuant to federal pretreatment reporting requirements and the Niagara Falls Water Board Regulations Part 1960, Significant Industrial Users shall submit periodic self-monitoring and compliance reports. Such reports shall be submitted using this form, according to the following schedule:

Quarterly: 1st is due by February 28th, the 2nd is due by May 31st, the 3rd is due by August 31st, and the 4th is due by November 30th.

Each section of this report form shall be filled out for those parameters listed in Section "G" of the company's Wastewater Discharge Permit. The analysis results must be reported in both concentration and mass. In addition, the calculated annual average load (lbs/day) for each pollutant shall also be reported.

The samples shall be collected at the monitoring points identified in the user permit. Identification of those points in this report should be as listed on page two (2) of the User Permit.

SELF-MONITORING REPORT
Significant Industrial Users (SIUs)


PAGE 2

PART II of the report is the Compliance Monitoring section. The user is obligated to determine if the analysis results indicate compliance. All violations noted should be brought to the Niagara Falls Water Board – Wastewater Facilities attention immediately upon noting and should also be reported in this section. The analysis result should be compared against all applicable federal, state and local standards and limitations. If no violations are noted, then **"NO VIOLATIONS"** should appear on the report.

Pursuant to 40 CFR Part 403.12g of the Federal Standards, all violations noted must be followed up by a sample recollect/analysis and the results submitted to the Niagara Falls Water Board within thirty (30) days of first becoming aware of the violation.

Pursuant to 40 CFR Part 403.12g all Periodic Self-Monitoring Reports must be signed by a "responsible company official" certifying the following statement:

I, certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Signed: 

Title: Project Manager (on behalf of Sherwood Forest Properties)

Date: 05/20/2025

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: 04/01/2025 - 04/02/2025	RESULTS ug/ℓ / ug/ℓ		RESULTS lbs/day / lbs/day		ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD: 0.0183						
BENZENE		<0.60		0.000		0.000
CARBON TETRACHLORIDE		<0.51		0.000		0.000
CHLORODIBROMOMETHANE						
MONOCHLOROBENZENE		<0.48		0.000		0.000
DICHLOROBROMOMETHANE						
CHLOROFORM		11		0.0017		0.034
1,1 – DICHLOROETHYLENE		<0.85		0.0000		0.001
1,2 – DICHLOROETHYLENE		<0.59		0.0000		0.003
BROMOFORM						
ETHYLBENZENE						
1,1,2,2 – TETRACHLOROETHANE		<0.26		0.000		0.000
TETRACHLOROETHYLENE		<0.34		0.000		0.000
TOLUENE		<0.45		0.000		0.000
1,1,1 – TRICHLOROETHANE		<0.39		0.000		0.000
1,1,2 – TRICHLOROETHANE		<0.48		0.000		0.001
TRICHLOROETHYLENE		1.5		0.0002		0.018
METHYLENE CHLORIDE		<0.81		0.000		0.000
MONOCHLOROTOLUENES						
MONOCHLOROBENZOTRIFLURIDE						
VINYL CHLORIDE		<0.75		0.000		0.000
TETRAHYDRAFURAN						
XYLENE						

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: 04/01/2025 - 04/02/2025	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD: 0.0183						
DIMETHYLPHTHALATE						
BUTYL BENZYL PHTHALATE						
Di-N-BUTHY PHTHALATE						
Di-N-OCTYL PHTHALATE						
DIETHYL PHTHALATE						
NITROSODIPHENYLAMINE						
DICHLOROBENZENES		<0.54		0.000		0.000
DICHLOROTOLUENE						
ACENAPHTHENE						
FLUORANTHENE						
CHRYSENE						
NAPHTHALENE						
BENZO (a) ANTHRACENE						
PYRENE						
TRICHLOROBENZENE		<0.20		0.0000		0.000
TRICHLOROTOLUENE						
HEXACHLOROBUTADIENE		<0.24		0.000		0.000
TETRACHLOROBENZENE						
HEXACHLOROCYCLOPENTADIENE						
HEXCHLOROBENZENE						
DICHLOROBENZOTRIFLUORIDE						

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: 04/01/2025 - 04/02/2025	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD: 0.0183						
PHENANTHRENE						
MONOCHLOROPHENOL						
DICHLOROPHENOL						
MONOCHLOROCRESOL						
TRICHLOROPHENOL		<0.24		0.000		0.000
PENTACHLOROPHENOL						
HEXACHLOROCYCLOHEXANES		0.028		0.000		0.000
-HEXACHLOROCYCLOHEXANE, alpha		<0.0073		0.000		0.000
-HEXACHLOROCYCLOHEXANE, beta		<0.024		0.000		0.000
-HEXACHLOROCYCLOHEXANE, gamma		0.011		0.000		0.000
-HEXACHLOROCYCLOHEXANE, delta		0.017		0.000		0.000
PCB's						
ENDOSULFAN I + ENDOSULFAN II + ENDOSULFAN SULFATE						
MIREX						
DECHLORANE PLUS						
HEPTACHLOR + HEPTACHLOR EPOXIDE						

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: 04/01/2025 - 04/02/2025	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD: 0.0183						
1,2,4 – TRICHLOROBENZENE						
1,2 – DICHLOROETHANE		<0.60		0.000		0.000
1,1,1 – TRICHLOROETHANE		<0.39		0.000		0.000
HEXACHLOROETHANE		<0.14		0.000		0.000
1,1 – DICHLOROETHANE						
1,1,2 – TRICHLOROETHANE		<0.48		0.000		0.001
CHLOROETHANE						
1,2 – DICHLOROBENZENE						
1,3 – DICHLOROBENZENE						
1,4 – DICHLOROBENZENE						
1,1 DICHLOROETHYLENE						
1,2 – TRANS-DICHLOROETHYLENE						
1,3 – DICHLOROPROPYLENE						
METHYL CHLORIDE						
NITROBENZENE						
2 – NITROPHENOL						
4 – NITROPHENOL						
4,6 DINITRO-O-CRESOL						
BIS [2 – ETHYHEXYL] PHTHALATE						
ANTHRACENE						
DIETHYL PHTHALATE						
FLUORENE						

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: 04/01/2025 - 04/02/2025	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD: 0.0183						
1,2 - DICHLOROPROPANE						
VINYL CHLORIDE						
ACENAPHTHENE						
BENZENE						
CARBON TETRACHLORIDE						
CHLOROBENZENE						
HEXACHLOROBENZENE						
CHLOROFORM						
ETHYLBENZENE						
FLUORANTHENE						
METHYLENE CHLORIDE						
HEXACHLOROBUTADIENE						
NAPHTHALENE DI – N – BUTHYL PHTHALATE						
DIMETHYL PHTHALATE						
PHENANTHRENE						
PYRENE						
TETRACHLOROETHYLENE						
TOLUENE						
TRICHLOROETHYLENE						
TOTAL CYANIDE		60		0.0092		0.041
TOTAL LEAD						
TOTAL ZINC						

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: ___/___/_____	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD						
TOTAL SUSPENDED SOLIDS						
SOLUABLE ORGANIC CARBON						
TOTAL PHOSPHOROUS						
TOTAL PHENOL						
OIL and GREASE						
CADMIUM						
CHROMIUM						
COPPER						
LEAD						
MERCURY						
NICKEL						
ZINC						
ARSENIC						
BERYLLIUM						
BARIUM						
TOTAL CYANIDE						
pH (STANDARD UNITS)						
RESIDUAL CHLORINE						
TOTAL SODIUM CHLORIDE						
TOTAL AMMONIA						
DIETHYLENE GLYCOL						

PART II

COMPLIANCE MONITORING

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

NO VIOLATIONS

VIOLATION PARAMETER	DATE	FLOW [MGD]	SAMPLE POINT LOCATION	ACTUAL* DISCHARGE	PERMIT LIMIT	TYPE** LIMIT VIOLATED

NOTE:

* - Actual discharge – list actual analytical results and appropriate units.

** - Type Limit Violated – List Type:

A.A. = Annual Average

D.M. = Daily Maximum

L.L. = Local Limits (Regulation 1960.5)

eurofins | Environment Testing

ANALYTICAL REPORT

PREPARED FOR

Attn: Mr. Nathan Sarapas
TRC Environmental Corporation
Wannalancit Mills
650 Suffolk Street
Lowell, Massachusetts 01854

Generated 4/9/2025 11:18:45 AM

JOB DESCRIPTION

Solvent Chemical Quarterly Discharge

JOB NUMBER

480-228381-1

Eurofins Buffalo
10 Hazelwood Drive
Amherst NY 14228-2298

See page two for job notes and contact information.

my EOL


Eurofins Buffalo

Job Notes

This report may not be reproduced except in full, and with written approval from the laboratory. The results relate only to the samples tested. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

The test results in this report relate only to the samples as received by the laboratory and will meet all requirements of the methodology, with any exceptions noted. This report shall not be reproduced except in full, without the express written approval of the laboratory. All questions should be directed to the Eurofins Environment Testing Northeast, LLC Project Manager.

Authorization



Generated
4/9/2025 11:18:45 AM

Authorized for release by
Anton Gruning, Project Management Assistant I
Anton.Gruning@et.eurofinsus.com
Designee for
Brian Fischer, Manager of Project Management
Brian.Fischer@et.eurofinsus.com
(716)504-9835

Table of Contents

Cover Page 1
Table of Contents 3
Definitions/Glossary 4
Case Narrative 5
Detection Summary 6
Client Sample Results 7
Surrogate Summary 9
QC Sample Results 10
QC Association Summary 15
Lab Chronicle 16
Certification Summary 17
Method Summary 18
Sample Summary 19
Chain of Custody 20
Receipt Checklists 21

Definitions/Glossary

Client: TRC Environmental Corporation
Job ID: 480-228381-1
Project/Site: Solvent Chemical Quarterly Discharge

Qualifiers

GC/MS VOA

Qualifier	Qualifier Description
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

GC Semi VOA

Qualifier	Qualifier Description
B	Compound was found in the blank and sample.
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
☼	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CFU	Colony Forming Unit
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MCL	EPA recommended "Maximum Contaminant Level"
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
MPN	Most Probable Number
MQL	Method Quantitation Limit
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
NEG	Negative / Absent
POS	Positive / Present
PQL	Practical Quantitation Limit
PRES	Presumptive
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)
TNTC	Too Numerous To Count

Job ID: 480-228381-1 Eurofins Buffalo

Job Narrative
480-228381-1

Analytical test results meet all requirements of the associated regulatory program listed on the Accreditation/Certification Summary Page unless otherwise noted under the individual analysis. Data qualifiers and/or narrative comments are included to explain any exceptions, if applicable.

- Matrix QC may not be reported if insufficient sample is provided or site-specific QC samples were not submitted. In these situations, to demonstrate precision and accuracy at a batch level, a LCS/LCSD may be performed, unless otherwise specified in the method.
- Surrogate and/or isotope dilution analyte recoveries (if applicable) which are outside of the QC window are confirmed unless attributed to a dilution or otherwise noted in the narrative.

Regulated compliance samples (e.g. SDWA, NPDES) must comply with the associated agency requirements/permits.

Receipt
The samples were received on 4/2/2025 1:35 PM. Unless otherwise noted below, the samples arrived in good condition, and, where required, properly preserved and on ice. The temperature of the cooler at receipt time was 3.1°C.

GC/MS VOA
Method 624.1_PREC: The following Volatile sample was composited by the laboratory on 04/03/2025 as requested by the client: Effluent-24HR-Comp-040125-001 (480-228381-1). Regulatory defined guidance for in-laboratory compositing of samples, is currently not available. Laboratory sample compositing was performed using established project specifications and/or laboratory standard operating procedures.

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

GC/MS Semi VOA
Method 625.1_PREC: Insufficient sample volume was available to perform a matrix spike/matrix spike duplicate/sample duplicate (MS/MSD/DUP) associated with preparation batch 480-742633.

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

Pesticides
Method 608.3_Pest_PREC: The method blank for preparation batch 480-742716 and analytical batch 480-742822 contained delta-BHC above the method detection limit. This target analyte concentration was less than the reporting limit (RL) in the method blank; therefore, re-extraction and/or re-analysis of samples was not performed. The following associated sample is impacted: Effluent-24HR-Comp-040125-001 (480-228381-1).

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

General Chemistry
No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

Detection Summary

Client: TRC Environmental Corporation
Job ID: 480-228381-1
Project/Site: Solvent Chemical Quarterly Discharge

Client Sample ID: Effluent-24HR-Comp-040125-001 — Lab Sample ID: 480-228381-1

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Chloroform	11		5.0	0.54	ug/L	1		624.1	Total/NA
Trichloroethene	1.5	J	5.0	0.60	ug/L	1		624.1	Total/NA
delta-BHC	0.017	J B	0.048	0.0095	ug/L	1		608.3	Total/NA
gamma-BHC (Lindane)	0.011	J	0.048	0.0076	ug/L	1		608.3	Total/NA
Cyanide, Total	0.060		0.010	0.0041	mg/L	1		335.4	Total/NA

This Detection Summary does not include radiochemical test results.

Client: TRC Environmental Corporation
Job ID: 480-228381-1
Project/Site: Solvent Chemical Quarterly Discharge

Client Sample ID: Effluent-24HR-Comp-040125-001
Lab Sample ID: 480-228381-1
Date Collected: 04/02/25 08:30
Matrix: Water
Date Received: 04/02/25 13:35

Method: EPA 624.1 - Volatile Organic Compounds (GC/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1-Trichloroethane	ND		5.0	0.39	ug/L			04/04/25 03:09	1
1,1,2,2-Tetrachloroethane	ND		5.0	0.26	ug/L			04/04/25 03:09	1
1,1,2-Trichloroethane	ND		5.0	0.48	ug/L			04/04/25 03:09	1
1,1-Dichloroethane	ND		5.0	0.59	ug/L			04/04/25 03:09	1
1,1-Dichloroethene	ND		5.0	0.85	ug/L			04/04/25 03:09	1
1,2-Dichlorobenzene	ND		5.0	0.44	ug/L			04/04/25 03:09	1
1,2-Dichloroethane	ND		5.0	0.60	ug/L			04/04/25 03:09	1
1,2-Dichloropropane	ND		5.0	0.61	ug/L			04/04/25 03:09	1
1,3-Dichlorobenzene	ND		5.0	0.54	ug/L			04/04/25 03:09	1
1,4-Dichlorobenzene	ND		5.0	0.51	ug/L			04/04/25 03:09	1
2-Chloroethyl vinyl ether	ND		25	1.9	ug/L			04/04/25 03:09	1
Acrolein	ND		100	17	ug/L			04/04/25 03:09	1
Acrylonitrile	ND		50	1.9	ug/L			04/04/25 03:09	1
Benzene	ND		5.0	0.60	ug/L			04/04/25 03:09	1
Bromoform	ND		5.0	0.47	ug/L			04/04/25 03:09	1
Bromomethane	ND		5.0	1.2	ug/L			04/04/25 03:09	1
Carbon tetrachloride	ND		5.0	0.51	ug/L			04/04/25 03:09	1
Chlorobenzene	ND		5.0	0.48	ug/L			04/04/25 03:09	1
Chlorodibromomethane	ND		5.0	0.41	ug/L			04/04/25 03:09	1
Chloroethane	ND		5.0	0.87	ug/L			04/04/25 03:09	1
Chloroform	**11**		5.0	0.54	ug/L			04/04/25 03:09	1
Chloromethane	ND		5.0	0.64	ug/L			04/04/25 03:09	1
cis-1,3-Dichloropropene	ND		5.0	0.33	ug/L			04/04/25 03:09	1
Bromodichloromethane	ND		5.0	0.54	ug/L			04/04/25 03:09	1
Ethylbenzene	ND		5.0	0.46	ug/L			04/04/25 03:09	1
Methylene Chloride	ND		5.0	0.81	ug/L			04/04/25 03:09	1
Tetrachloroethene	ND		5.0	0.34	ug/L			04/04/25 03:09	1
Toluene	ND		5.0	0.45	ug/L			04/04/25 03:09	1
trans-1,2-Dichloroethene	ND		5.0	0.59	ug/L			04/04/25 03:09	1
trans-1,3-Dichloropropene	ND		5.0	0.44	ug/L			04/04/25 03:09	1
Trichloroethene	**1.5**	**J**	5.0	0.60	ug/L			04/04/25 03:09	1
Vinyl chloride	ND		5.0	0.75	ug/L			04/04/25 03:09	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*99*		*68 - 130*		*04/04/25 03:09*	*1*
4-Bromofluorobenzene (Surr)	*99*		*76 - 123*		*04/04/25 03:09*	*1*
Toluene-d8 (Surr)	*99*		*77 - 120*		*04/04/25 03:09*	*1*
Dibromofluoromethane (Surr)	*103*		*75 - 123*		*04/04/25 03:09*	*1*

Method: EPA 625.1 - Semivolatile Organic Compounds (GC/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,2,4-Trichlorobenzene	ND		9.5	0.20	ug/L		04/03/25 13:32	04/07/25 13:43	1
1,2-Dichlorobenzene	ND		9.5	0.25	ug/L		04/03/25 13:32	04/07/25 13:43	1
1,3-Dichlorobenzene	ND		9.5	0.16	ug/L		04/03/25 13:32	04/07/25 13:43	1
1,4-Dichlorobenzene	ND		9.5	0.20	ug/L		04/03/25 13:32	04/07/25 13:43	1
2,4,6-Trichlorophenol	ND		4.8	0.24	ug/L		04/03/25 13:32	04/07/25 13:43	1
Hexachlorobutadiene	ND		4.8	0.24	ug/L		04/03/25 13:32	04/07/25 13:43	1
Hexachloroethane	ND		4.8	0.14	ug/L		04/03/25 13:32	04/07/25 13:43	1

Client Sample ID: Effluent-24HR-Comp-040125-001
Lab Sample ID: 480-228381-1
Date Collected: 04/02/25 08:30
Matrix: Water
Date Received: 04/02/25 13:35

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
2,4,6-Tribromophenol (Surr)	*88*		*52 - 151*	*04/03/25 13:32*	*04/07/25 13:43*	*1*
2-Fluorobiphenyl (Surr)	*81*		*44 - 120*	*04/03/25 13:32*	*04/07/25 13:43*	*1*
2-Fluorophenol (Surr)	*44*		*17 - 120*	*04/03/25 13:32*	*04/07/25 13:43*	*1*
Nitrobenzene-d5 (Surr)	*81*		*15 - 314*	*04/03/25 13:32*	*04/07/25 13:43*	*1*
Phenol-d5 (Surr)	*30*		*8 - 424*	*04/03/25 13:32*	*04/07/25 13:43*	*1*
p-Terphenyl-d14 (Surr)	*68*		*22 - 125*	*04/03/25 13:32*	*04/07/25 13:43*	*1*

Method: EPA 608.3 - Organochlorine Pesticides in Water

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
alpha-BHC	ND		0.048	0.0073	ug/L		04/04/25 09:14	04/07/25 10:13	1
beta-BHC	ND		0.048	0.024	ug/L		04/04/25 09:14	04/07/25 10:13	1
delta-BHC	**0.017**	**J B**	0.048	0.0095	ug/L		04/04/25 09:14	04/07/25 10:13	1
gamma-BHC (Lindane)	**0.011**	**J**	0.048	0.0076	ug/L		04/04/25 09:14	04/07/25 10:13	1
BHC, Total	ND		0.048	0.048	ug/L		04/04/25 09:14	04/07/25 10:13	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
DCB Decachlorobiphenyl (Surr)	*57*		*10 - 120*	*04/04/25 09:14*	*04/07/25 10:13*	*1*
Tetrachloro-m-xylene (Surr)	*85*		*10 - 120*	*04/04/25 09:14*	*04/07/25 10:13*	*1*

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Cyanide, Total (EPA 335.4)	**0.060**		0.010	0.0041	mg/L			04/07/25 19:47	1

Surrogate Summary

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Quarterly Discharge

Job ID: 480-228381-1

Method: 624.1 - Volatile Organic Compounds (GC/MS)

Matrix: Water — **Prep Type: Total/NA**

		Percent Surrogate Recovery (Acceptance Limits)			
		DCA	BFB	TOL	DBFM
Lab Sample ID	Client Sample ID	(68-130)	(76-123)	(77-120)	(75-123)
480-228381-1	Effluent-24HR-Comp-040125-00	99	99	99	103
LCS 480-742675/6	Lab Control Sample	107	101	106	101
MB 480-742675/8	Method Blank	101	100	100	97

Surrogate Legend

DCA = 1,2-Dichloroethane-d4 (Surr)
BFB = 4-Bromofluorobenzene (Surr)
TOL = Toluene-d8 (Surr)
DBFM = Dibromofluoromethane (Surr)

Method: 625.1 - Semivolatile Organic Compounds (GC/MS)

Matrix: Water — **Prep Type: Total/NA**

		Percent Surrogate Recovery (Acceptance Limits)					
		TBP	FBP	2FP	NBZ	PHL	TPHd14
Lab Sample ID	Client Sample ID	(52-151)	(44-120)	(17-120)	(15-314)	(8-424)	(22-125)
480-228381-1	Effluent-24HR-Comp-040125-00	88	81	44	81	30	68
LCS 480-742633/2-A	Lab Control Sample	113	91	53	86	40	100
LCSD 480-742633/3-A	Lab Control Sample Dup	108	89	55	90	40	98
MB 480-742633/1-A	Method Blank	99	88	48	85	37	98

Surrogate Legend

TBP = 2,4,6-Tribromophenol (Surr)
FBP = 2-Fluorobiphenyl (Surr)
2FP = 2-Fluorophenol (Surr)
NBZ = Nitrobenzene-d5 (Surr)
PHL = Phenol-d5 (Surr)
TPHd14 = p-Terphenyl-d14 (Surr)

Method: 608.3 - Organochlorine Pesticides in Water

Matrix: Water — **Prep Type: Total/NA**

		Percent Surrogate Recovery (Acceptance Limits)	
		DCBP1	TCX1
Lab Sample ID	Client Sample ID	(10-120)	(10-120)
480-228381-1	Effluent-24HR-Comp-040125-00	57	85
LCS 480-742716/2-A	Lab Control Sample	75	80
LCSD 480-742716/3-A	Lab Control Sample Dup	75	81
MB 480-742716/1-A	Method Blank	88	80

Surrogate Legend

DCBP = DCB Decachlorobiphenyl (Surr)
TCX = Tetrachloro-m-xylene (Surr)

Method: 624.1 - Volatile Organic Compounds (GC/MS)

Lab Sample ID: MB 480-742675/8
Matrix: Water
Analysis Batch: 742675

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1-Trichloroethane	ND		5.0	0.39	ug/L			04/04/25 00:43	1
1,1,2,2-Tetrachloroethane	ND		5.0	0.26	ug/L			04/04/25 00:43	1
1,1,2-Trichloroethane	ND		5.0	0.48	ug/L			04/04/25 00:43	1
1,1-Dichloroethane	ND		5.0	0.59	ug/L			04/04/25 00:43	1
1,1-Dichloroethene	ND		5.0	0.85	ug/L			04/04/25 00:43	1
1,2-Dichlorobenzene	ND		5.0	0.44	ug/L			04/04/25 00:43	1
1,2-Dichloroethane	ND		5.0	0.60	ug/L			04/04/25 00:43	1
1,2-Dichloropropane	ND		5.0	0.61	ug/L			04/04/25 00:43	1
1,3-Dichlorobenzene	ND		5.0	0.54	ug/L			04/04/25 00:43	1
1,4-Dichlorobenzene	ND		5.0	0.51	ug/L			04/04/25 00:43	1
2-Chloroethyl vinyl ether	ND		25	1.9	ug/L			04/04/25 00:43	1
Acrolein	ND		100	17	ug/L			04/04/25 00:43	1
Acrylonitrile	ND		50	1.9	ug/L			04/04/25 00:43	1
Benzene	ND		5.0	0.60	ug/L			04/04/25 00:43	1
Bromoform	ND		5.0	0.47	ug/L			04/04/25 00:43	1
Bromomethane	ND		5.0	1.2	ug/L			04/04/25 00:43	1
Carbon tetrachloride	ND		5.0	0.51	ug/L			04/04/25 00:43	1
Chlorobenzene	ND		5.0	0.48	ug/L			04/04/25 00:43	1
Chlorodibromomethane	ND		5.0	0.41	ug/L			04/04/25 00:43	1
Chloroethane	ND		5.0	0.87	ug/L			04/04/25 00:43	1
Chloroform	ND		5.0	0.54	ug/L			04/04/25 00:43	1
Chloromethane	ND		5.0	0.64	ug/L			04/04/25 00:43	1
cis-1,3-Dichloropropene	ND		5.0	0.33	ug/L			04/04/25 00:43	1
Bromodichloromethane	ND		5.0	0.54	ug/L			04/04/25 00:43	1
Ethylbenzene	ND		5.0	0.46	ug/L			04/04/25 00:43	1
Methylene Chloride	ND		5.0	0.81	ug/L			04/04/25 00:43	1
Tetrachloroethene	ND		5.0	0.34	ug/L			04/04/25 00:43	1
Toluene	ND		5.0	0.45	ug/L			04/04/25 00:43	1
trans-1,2-Dichloroethene	ND		5.0	0.59	ug/L			04/04/25 00:43	1
trans-1,3-Dichloropropene	ND		5.0	0.44	ug/L			04/04/25 00:43	1
Trichloroethene	ND		5.0	0.60	ug/L			04/04/25 00:43	1
Vinyl chloride	ND		5.0	0.75	ug/L			04/04/25 00:43	1

Surrogate	*MB %Recovery*	*MB Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*101*		*68 - 130*		*04/04/25 00:43*	*1*
4-Bromofluorobenzene (Surr)	*100*		*76 - 123*		*04/04/25 00:43*	*1*
Toluene-d8 (Surr)	*100*		*77 - 120*		*04/04/25 00:43*	*1*
Dibromofluoromethane (Surr)	*97*		*75 - 123*		*04/04/25 00:43*	*1*

Lab Sample ID: LCS 480-742675/6
Matrix: Water
Analysis Batch: 742675

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,1,1-Trichloroethane	20.0	22.2		ug/L		111	52 - 162
1,1,2,2-Tetrachloroethane	20.0	22.4		ug/L		112	46 - 157
1,1,2-Trichloroethane	20.0	21.6		ug/L		108	52 - 150
1,1-Dichloroethane	20.0	21.4		ug/L		107	59 - 155

Method: 624.1 - Volatile Organic Compounds (GC/MS) (Continued)

Lab Sample ID: LCS 480-742675/6
Matrix: Water
Analysis Batch: 742675

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,1-Dichloroethene	20.0	21.4		ug/L		107	1 - 234
1,2-Dichlorobenzene	20.0	21.4		ug/L		107	18 - 190
1,2-Dichloroethane	20.0	21.8		ug/L		109	49 - 155
1,2-Dichloropropane	20.0	22.0		ug/L		110	1 - 210
1,3-Dichlorobenzene	20.0	22.1		ug/L		111	59 - 156
1,4-Dichlorobenzene	20.0	21.9		ug/L		110	18 - 190
2-Chloroethyl vinyl ether	20.0	22.2	J	ug/L		111	1 - 305
Benzene	20.0	21.8		ug/L		109	37 - 151
Bromoform	20.0	20.3		ug/L		102	45 - 169
Bromomethane	20.0	24.3		ug/L		121	1 - 242
Carbon tetrachloride	20.0	22.0		ug/L		110	70 - 140
Chlorobenzene	20.0	21.7		ug/L		109	37 - 160
Chlorodibromomethane	20.0	21.6		ug/L		108	53 - 149
Chloroethane	20.0	23.1		ug/L		116	14 - 230
Chloroform	20.0	21.7		ug/L		109	51 - 138
Chloromethane	20.0	20.3		ug/L		102	1 - 273
cis-1,3-Dichloropropene	20.0	21.4		ug/L		107	1 - 227
Bromodichloromethane	20.0	21.7		ug/L		109	35 - 155
Ethylbenzene	20.0	22.1		ug/L		111	37 - 162
Methylene Chloride	20.0	22.7		ug/L		113	1 - 221
Tetrachloroethene	20.0	21.8		ug/L		109	64 - 148
Toluene	20.0	22.0		ug/L		110	47 - 150
trans-1,2-Dichloroethene	20.0	21.5		ug/L		107	54 - 156
trans-1,3-Dichloropropene	20.0	22.5		ug/L		112	17 - 183
Trichloroethene	20.0	21.7		ug/L		109	71 - 157
Vinyl chloride	20.0	21.5		ug/L		108	1 - 251

Surrogate	*LCS %Recovery*	*LCS Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*107*		*68 - 130*
4-Bromofluorobenzene (Surr)	*101*		*76 - 123*
Toluene-d8 (Surr)	*106*		*77 - 120*
Dibromofluoromethane (Surr)	*101*		*75 - 123*

Method: 625.1 - Semivolatile Organic Compounds (GC/MS)

Lab Sample ID: MB 480-742633/1-A
Matrix: Water
Analysis Batch: 742689

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 742633

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,2,4-Trichlorobenzene	ND		10	0.21	ug/L		04/03/25 13:32	04/04/25 12:07	1
1,2-Dichlorobenzene	ND		10	0.26	ug/L		04/03/25 13:32	04/04/25 12:07	1
1,3-Dichlorobenzene	ND		10	0.17	ug/L		04/03/25 13:32	04/04/25 12:07	1
1,4-Dichlorobenzene	ND		10	0.21	ug/L		04/03/25 13:32	04/04/25 12:07	1
2,4,6-Trichlorophenol	ND		5.0	0.25	ug/L		04/03/25 13:32	04/04/25 12:07	1
Hexachlorobutadiene	ND		5.0	0.25	ug/L		04/03/25 13:32	04/04/25 12:07	1
Hexachloroethane	ND		5.0	0.15	ug/L		04/03/25 13:32	04/04/25 12:07	1

Method: 625.1 - Semivolatile Organic Compounds (GC/MS) (Continued)

Lab Sample ID: MB 480-742633/1-A
Matrix: Water
Analysis Batch: 742689

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 742633

Surrogate	MB %Recovery	MB Qualifier	Limits	Prepared	Analyzed	Dil Fac
2,4,6-Tribromophenol (Surr)	99		52 - 151	04/03/25 13:32	04/04/25 12:07	1
2-Fluorobiphenyl (Surr)	88		44 - 120	04/03/25 13:32	04/04/25 12:07	1
2-Fluorophenol (Surr)	48		17 - 120	04/03/25 13:32	04/04/25 12:07	1
Nitrobenzene-d5 (Surr)	85		15 - 314	04/03/25 13:32	04/04/25 12:07	1
Phenol-d5 (Surr)	37		8 - 424	04/03/25 13:32	04/04/25 12:07	1
p-Terphenyl-d14 (Surr)	98		22 - 125	04/03/25 13:32	04/04/25 12:07	1

Lab Sample ID: LCS 480-742633/2-A
Matrix: Water
Analysis Batch: 742689

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 742633

Analyte			Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits		
1,2,4-Trichlorobenzene			40.0	26.7		ug/L		67	44 - 142		
1,2-Dichlorobenzene			40.0	26.2		ug/L		66	32 - 129		
1,3-Dichlorobenzene			40.0	23.8		ug/L		60	1 - 172		
1,4-Dichlorobenzene			40.0	24.8		ug/L		62	20 - 124		
2,4,6-Trichlorophenol			40.0	39.1		ug/L		98	37 - 144		
Hexachlorobutadiene			40.0	23.4		ug/L		59	24 - 120		
Hexachloroethane			40.0	23.5		ug/L		59	40 - 120		

Surrogate	LCS %Recovery	LCS Qualifier	Limits
2,4,6-Tribromophenol (Surr)	113		52 - 151
2-Fluorobiphenyl (Surr)	91		44 - 120
2-Fluorophenol (Surr)	53		17 - 120
Nitrobenzene-d5 (Surr)	86		15 - 314
Phenol-d5 (Surr)	40		8 - 424
p-Terphenyl-d14 (Surr)	100		22 - 125

Lab Sample ID: LCSD 480-742633/3-A
Matrix: Water
Analysis Batch: 742689

Client Sample ID: Lab Control Sample Dup
Prep Type: Total/NA
Prep Batch: 742633

Analyte			Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
1,2,4-Trichlorobenzene			40.0	28.8		ug/L		72	44 - 142	7	34
1,2-Dichlorobenzene			40.0	24.8		ug/L		62	32 - 129	6	38
1,3-Dichlorobenzene			40.0	21.7		ug/L		54	1 - 172	9	37
1,4-Dichlorobenzene			40.0	23.7		ug/L		59	20 - 124	4	40
2,4,6-Trichlorophenol			40.0	36.2		ug/L		90	37 - 144	8	20
Hexachlorobutadiene			40.0	26.2		ug/L		65	24 - 120	11	50
Hexachloroethane			40.0	21.9		ug/L		55	40 - 120	7	43

Surrogate	LCSD %Recovery	LCSD Qualifier	Limits
2,4,6-Tribromophenol (Surr)	108		52 - 151
2-Fluorobiphenyl (Surr)	89		44 - 120
2-Fluorophenol (Surr)	55		17 - 120
Nitrobenzene-d5 (Surr)	90		15 - 314
Phenol-d5 (Surr)	40		8 - 424
p-Terphenyl-d14 (Surr)	98		22 - 125

Method: 608.3 - Organochlorine Pesticides in Water

Lab Sample ID: MB 480-742716/1-A
Matrix: Water
Analysis Batch: 742822

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 742716

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
alpha-BHC	ND		0.050	0.0077	ug/L		04/04/25 09:14	04/07/25 09:15	1
beta-BHC	ND		0.050	0.025	ug/L		04/04/25 09:14	04/07/25 09:15	1
delta-BHC	0.0122	J	0.050	0.010	ug/L		04/04/25 09:14	04/07/25 09:15	1
gamma-BHC (Lindane)	ND		0.050	0.0080	ug/L		04/04/25 09:14	04/07/25 09:15	1
BHC, Total	ND		0.050	0.050	ug/L		04/04/25 09:14	04/07/25 09:15	1

Surrogate	*MB %Recovery*	*MB Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
DCB Decachlorobiphenyl (Surr)	*88*		*10 - 120*	*04/04/25 09:14*	*04/07/25 09:15*	*1*
Tetrachloro-m-xylene (Surr)	*80*		*10 - 120*	*04/04/25 09:14*	*04/07/25 09:15*	*1*

Lab Sample ID: LCS 480-742716/2-A
Matrix: Water
Analysis Batch: 742822

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 742716

Analyte			Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits		
alpha-BHC			0.500	0.421		ug/L		84	52 - 125		
beta-BHC			0.500	0.519		ug/L		104	52 - 120		
delta-BHC			0.500	0.477		ug/L		95	51 - 120		
gamma-BHC (Lindane)			0.500	0.453		ug/L		91	56 - 120		

Surrogate	*LCS %Recovery*	*LCS Qualifier*	*Limits*
DCB Decachlorobiphenyl (Surr)	*75*		*10 - 120*
Tetrachloro-m-xylene (Surr)	*80*		*10 - 120*

Lab Sample ID: LCSD 480-742716/3-A
Matrix: Water
Analysis Batch: 742822

Client Sample ID: Lab Control Sample Dup
Prep Type: Total/NA
Prep Batch: 742716

Analyte			Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
alpha-BHC			0.500	0.411		ug/L		82	52 - 125	2	50
beta-BHC			0.500	0.459		ug/L		92	52 - 120	12	50
delta-BHC			0.500	0.455		ug/L		91	51 - 120	5	50
gamma-BHC (Lindane)			0.500	0.438		ug/L		88	56 - 120	3	50

Surrogate	*LCSD %Recovery*	*LCSD Qualifier*	*Limits*
DCB Decachlorobiphenyl (Surr)	*75*		*10 - 120*
Tetrachloro-m-xylene (Surr)	*81*		*10 - 120*

Method: 335.4 - Cyanide, Total

Lab Sample ID: MB 480-742940/21
Matrix: Water
Analysis Batch: 742940

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Cyanide, Total	ND		0.010	0.0041	mg/L			04/07/25 18:37	1

Client: TRC Environmental Corporation
Job ID: 480-228381-1
Project/Site: Solvent Chemical Quarterly Discharge

Method: 335.4 - Cyanide, Total (Continued)

Lab Sample ID: HLCS 480-742940/22
Matrix: Water
Analysis Batch: 742940

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	HLCS Result	HLCS Qualifier	Unit	D	%Rec	%Rec Limits
Cyanide, Total	0.400	0.403		mg/L		101	90 - 110

Lab Sample ID: LCS 480-742940/23
Matrix: Water
Analysis Batch: 742940

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Cyanide, Total	0.250	0.252		mg/L		101	90 - 110

QC Association Summary

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Quarterly Discharge

Job ID: 480-228381-1

GC/MS VOA

Analysis Batch: 742675

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-228381-1	Effluent-24HR-Comp-040125-001	Total/NA	Water	624.1	
MB 480-742675/8	Method Blank	Total/NA	Water	624.1	
LCS 480-742675/6	Lab Control Sample	Total/NA	Water	624.1	

GC/MS Semi VOA

Prep Batch: 742633

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-228381-1	Effluent-24HR-Comp-040125-001	Total/NA	Water	625	
MB 480-742633/1-A	Method Blank	Total/NA	Water	625	
LCS 480-742633/2-A	Lab Control Sample	Total/NA	Water	625	
LCSD 480-742633/3-A	Lab Control Sample Dup	Total/NA	Water	625	

Analysis Batch: 742689

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
MB 480-742633/1-A	Method Blank	Total/NA	Water	625.1	742633
LCS 480-742633/2-A	Lab Control Sample	Total/NA	Water	625.1	742633
LCSD 480-742633/3-A	Lab Control Sample Dup	Total/NA	Water	625.1	742633

Analysis Batch: 742847

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-228381-1	Effluent-24HR-Comp-040125-001	Total/NA	Water	625.1	742633

GC Semi VOA

Prep Batch: 742716

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-228381-1	Effluent-24HR-Comp-040125-001	Total/NA	Water	3510C	
MB 480-742716/1-A	Method Blank	Total/NA	Water	3510C	
LCS 480-742716/2-A	Lab Control Sample	Total/NA	Water	3510C	
LCSD 480-742716/3-A	Lab Control Sample Dup	Total/NA	Water	3510C	

Analysis Batch: 742822

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-228381-1	Effluent-24HR-Comp-040125-001	Total/NA	Water	608.3	742716
MB 480-742716/1-A	Method Blank	Total/NA	Water	608.3	742716
LCS 480-742716/2-A	Lab Control Sample	Total/NA	Water	608.3	742716
LCSD 480-742716/3-A	Lab Control Sample Dup	Total/NA	Water	608.3	742716

General Chemistry

Analysis Batch: 742940

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-228381-1	Effluent-24HR-Comp-040125-001	Total/NA	Water	335.4	
MB 480-742940/21	Method Blank	Total/NA	Water	335.4	
HLCS 480-742940/22	Lab Control Sample	Total/NA	Water	335.4	
LCS 480-742940/23	Lab Control Sample	Total/NA	Water	335.4	

Lab Chronicle

Client: TRC Environmental Corporation
Job ID: 480-228381-1
Project/Site: Solvent Chemical Quarterly Discharge

Client Sample ID: Effluent-24HR-Comp-040125-001
Lab Sample ID: 480-228381-1

Date Collected: 04/02/25 08:30
Matrix: Water
Date Received: 04/02/25 13:35

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	624.1		1	742675	AXK	EET BUF	04/04/25 03:09
Total/NA	Prep	625			742633	LSC	EET BUF	04/03/25 13:32
Total/NA	Analysis	625.1		1	742847	JMM	EET BUF	04/07/25 13:43
Total/NA	Prep	3510C			742716	JMP	EET BUF	04/04/25 09:14
Total/NA	Analysis	608.3		1	742822	JLS	EET BUF	04/07/25 10:13
Total/NA	Analysis	335.4		1	742940	GW	EET BUF	04/07/25 19:47

Laboratory References:

EET BUF = Eurofins Buffalo, 10 Hazelwood Drive, Amherst, NY 14228-2298, TEL (716)691-2600

Accreditation/Certification Summary

Client: TRC Environmental Corporation
Job ID: 480-228381-1
Project/Site: Solvent Chemical Quarterly Discharge

Laboratory: Eurofins Buffalo

Unless otherwise noted, all analytes for this laboratory were covered under each accreditation/certification below.

Authority	Program	Identification Number	Expiration Date
New York	NELAP	10026	03-31-26

The following analytes are included in this report, but the laboratory is not certified by the governing authority. This list may include analytes for which the agency does not offer certification.

Analysis Method	Prep Method	Matrix	Analyte
608.3	3510C	Water	BHC, Total
625.1	625	Water	1,2-Dichlorobenzene
625.1	625	Water	1,3-Dichlorobenzene
625.1	625	Water	1,4-Dichlorobenzene

Method Summary

Client: TRC Environmental Corporation
Job ID: 480-228381-1
Project/Site: Solvent Chemical Quarterly Discharge

Method	Method Description	Protocol	Laboratory
624.1	Volatile Organic Compounds (GC/MS)	EPA	EET BUF
625.1	Semivolatile Organic Compounds (GC/MS)	EPA	EET BUF
608.3	Organochlorine Pesticides in Water	EPA	EET BUF
335.4	Cyanide, Total	EPA	EET BUF
3510C	Liquid-Liquid Extraction (Separatory Funnel)	SW846	EET BUF
625	Liquid-Liquid Extraction	EPA	EET BUF

Protocol References:

EPA = US Environmental Protection Agency

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

Laboratory References:

EET BUF = Eurofins Buffalo, 10 Hazelwood Drive, Amherst, NY 14228-2298, TEL (716)691-2600

Sample Summary

Client: TRC Environmental Corporation
Job ID: 480-228381-1
Project/Site: Solvent Chemical Quarterly Discharge

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
480-228381-1	Effluent-24HR-Comp-040125-001	Water	04/02/25 08:30	04/02/25 13:35

Amherst, NY 14228-2298

Regulatory Program: ☐ DW ☐ NPDES ☐ RCRA ☐ Other:

Environment Testing America

TAL-8210

Client Contact	Project Manager: David McKenzie	Site Contact: Chris Corrigan	Date: 4/1/25	COC No:
Company Name: TRC Environmental	Tel/Email: DMcKenzie@trcompanies.com	Lab Contact: Brian J. Fisher	Carrier:	1 of 1 COCs
Address: Wannalancit Mills 650 Suffolk St.	Analysis Turnaround Time			Sampler: Chris Corrigan
City/State/Zip: Lowell / MA / 01854	☐ CALENDAR DAYS ☐ WORKING DAYS			For Lab Use Only:
Phone: 734-904-3316	TAT if different from Below			Walk-in Client:
Fax:	☐ 2 weeks			Lab Sampling:
Project Name: Solvent Chemical S/A Discharge	☐ 1 week			
Site:	☐ 2 days			Job / SDG No.:
PO# 200943	☐ 1 day			

Sample Identification	Sample Date	Sample Time	Sample Type (C=Comp, G=Grab)	Matrix	# of Cont.	Filtered Sample (Y/N)	Perform MS / MSD (Y/N)	608.3_Pest_PREC	625.1_PREC-SVOCs	335.4-Cyanide	624.1-PREC-VOCs	Sample Specific Notes:
Effluent-24HR-Comp-040125-001	4-2-25	0830	C	W	~~5~~			X	X	X		All Samples Shipped on Ice
Effluent-040125-002	4-1-25	0545	G	W	1						X	
Effluent-040125-003	4-1-25	0935	G	W	1						X	
Effluent-040125-004	4-1-25	1505	G	W	1						X	
Effluent-040125-005	4-1-25	1810	G	W	1						X	

480-228381 Chain of Custody

Preservation Used: 1= Ice, 2= HCl; 3= H2SO4; 4=HNO3; 5=NaOH; 6= Other _____

Possible Hazard Identification:
Are any samples from a listed EPA Hazardous Waste? Please List any EPA Waste Codes for the sample in the Comments Section if the lab is to dispose of the sample.

☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☒ Unknown

Sample Disposal (A fee may be assessed if sample

☐ Return to Client ☒ Disposal by Lab ☐ Archive for _____ Months

Special Instructions/QC Requirements & Comments:

Custody Seals Intact: ☐ Yes ☐ No	Custody Seal No.:		Cooler Temp. (°C): Obs'd: _____ Corr'd: _____ Therm ID No.: _____		
Relinquished by: Chris Corrigan	Company: Cantech	Date/Time: 4-2-25/1335	Received by:	Company:	Date/Time:
Relinquished by:	Company:	Date/Time:	Received by:	Company:	Date/Time:
Relinquished by:	Company:	Date/Time:	Received in Laboratory by:	Company: TAT3	Date/Time: 4/2/25 1335

3.1 ICE IR# 5C

Login Sample Receipt Checklist

Client: TRC Environmental Corporation

Job Number: 480-228381-1

Login Number: 228381
List Number: 1
Creator: Yeager, Brian A

List Source: Eurofins Buffalo

Question	Answer	Comment
Radioactivity either was not measured or, if measured, is at or below background	True	
The cooler's custody seal, if present, is intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	3.1 ICE IR# SC
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the sample IDs on the containers and the COC.	True	
Samples are received within Holding Time (Excluding tests with immediate HTs)..	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
VOA sample vials do not have headspace or bubble is <6mm (1/4") in diameter.	True	
If necessary, staff have been informed of any short hold time or quick TAT needs	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Sampling Company provided.	True	TRC
Samples received within 48 hours of sampling.	True	
Samples requiring field filtration have been filtered in the field.	True	
Chlorine Residual checked.	N/A	

650 Suffolk Street
Lowell, MA 01854

t 978-570-5600

August 15, 2025

Matthew Lagamba
Niagara Falls Water Board
Wastewater Treatment Plant
5815 Buffalo Ave, Niagara Falls, NY 14304
(716) 283-9770

Re: 2025 Quarterly (Third Quarter) Self-Monitoring Report
Sherwood Forest Properties
3163 Buffalo Avenue
Niagara Falls, NY
SIU Permit # 55

Dear Mr. Lagamba:

TRC Environmental Corporation is submitting this third quarter Self-Monitoring Report on behalf of Sherwood Forest Properties, Ltd, 3163 Buffalo Avenue, Niagara Falls, NY in accordance with Significant Industrial User (SIU) Permit # 55.

If you have any questions, please do not hesitate to contact us.

Sincerely,

TRC Environmental Corporation

David McKenzie, PE
Project Manager

Attachment 1 Self-Monitoring Report
Attachment 2 Lab Report

NIAGARA FALLS WATER BOARD WASTEWATER FACILITIES ENFORCEMENT DIVISION

SELF-MONITORING REPORT
SIGNIFICANT INDUSTRIAL USERS

PERMIT NO. 55

SHERWOOD FOREST PROPERTIES, LTD

The 3rd Quarterly Report

of four for 2025

Pursuant to federal pretreatment reporting requirements and the Niagara Falls Water Board Regulations Part 1960, Significant Industrial Users shall submit periodic self-monitoring and compliance reports. Such reports shall be submitted using this form, according to the following schedule:

Quarterly: 1st is due by February 28th, the 2nd is due by May 31st, the 3rd is due by August 31st, and the 4th is due by November 30th.

Each section of this report form shall be filled out for those parameters listed in Section "G" of the company's Wastewater Discharge Permit. The analysis results must be reported in both concentration and mass. In addition, the calculated annual average load (lbs/day) for each pollutant shall also be reported.

The samples shall be collected at the monitoring points identified in the user permit. Identification of those points in this report should be as listed on page two (2) of the User Permit.

SELF-MONITORING REPORT
Significant Industrial Users (SIUs)


PAGE 2

PART II of the report is the Compliance Monitoring section. The user is obligated to determine if the analysis results indicate compliance. All violations noted should be brought to the Niagara Falls Water Board – Wastewater Facilities attention immediately upon noting and should also be reported in this section. The analysis result should be compared against all applicable federal, state and local standards and limitations. If no violations are noted, then **"NO VIOLATIONS"** should appear on the report.

Pursuant to 40 CFR Part 403.12g of the Federal Standards, all violations noted must be followed up by a sample recollect/analysis and the results submitted to the Niagara Falls Water Board within thirty (30) days of first becoming aware of the violation.

Pursuant to 40 CFR Part 403.12g all Periodic Self-Monitoring Reports must be signed by a "responsible company official" certifying the following statement:

I, certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Signed: 

Title: Project Manager (on behalf of Sherwood Forest Properties)

Date: 08/15/2025

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: 07/16/2025 - 07/17/2025	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD: 0.0842						
BENZENE		<0.60		0.0000		0.000
CARBON TETRACHLORIDE		<0.51		0.0000		0.000
CHLORODIBROMOMETHANE						
MONOCHLOROBENZENE		<0.48		0.0000		0.000
DICHLOROBROMOMETHANE						
CHLOROFORM		<0.54		0.0000		0.015
1,1 – DICHLOROETHYLENE		<0.85		0.0000		0.001
1,2 – DICHLOROETHYLENE		<0.59		0.0000		0.002
BROMOFORM						
ETHYLBENZENE						
1,1,2,2 – TETRACHLOROETHANE		<0.26		0.0000		0.000
TETRACHLOROETHYLENE		<0.34		0.0000		0.000
TOLUENE		<0.45		0.0000		0.000
1,1,1 – TRICHLOROETHANE		<0.39		0.0000		0.000
1,1,2 – TRICHLOROETHANE		<0.48		0.0000		0.001
TRICHLOROETHYLENE		<0.60		0.0000		0.018
METHYLENE CHLORIDE		<0.81		0.0000		0.000
MONOCHLOROTOLUENES						
MONOCHLOROBENZOTRIFLURIDE						
VINYL CHLORIDE		<0.75		0.0000		0.000
TETRAHYDRAFURAN						
XYLENE						

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: 07/16/2025 - 07/17/2025	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD: 0.0842						
DIMETHYLPHTHALATE						
BUTYL BENZYL PHTHALATE						
Di-N-BUTHY PHTHALATE						
Di-N-OCTYL PHTHALATE						
DIETHYL PHTHALATE						
NITROSODIPHENYLAMINE						
DICHLOROBENZENES		<0.54		0.000		0.000
DICHLOROTOLUENE						
ACENAPHTHENE						
FLUORANTHENE						
CHRYSENE						
NAPHTHALENE						
BENZO (a) ANTHRACENE						
PYRENE						
TRICHLOROBENZENE		<0.82		0.0000		0.000
TRICHLOROTOLUENE						
HEXACHLOROBUTADIENE		<1.0		0.000		0.000
TETRACHLOROBENZENE						
HEXACHLOROCYCLOPENTADIENE						
HEXCHLOROBENZENE						
DICHLOROBENZOTRIFLUORIDE						

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: 07/16/2025 - 07/17/2025	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD: 0.0842						
PHENANTHRENE						
MONOCHLOROPHENOL						
DICHLOROPHENOL						
MONOCHLOROCRESOL						
TRICHLOROPHENOL		<1.0		0.000		0.000
PENTACHLOROPHENOL						
HEXACHLOROCYCLOHEXANES		0.095		0.0001		0.000
-HEXACHLOROCYCLOHEXANE, alpha		0.019		0.0000		0.000
-HEXACHLOROCYCLOHEXANE, beta		0.051		0.0000		0.000
-HEXACHLOROCYCLOHEXANE, gamma		0.014		0.0000		0.000
-HEXACHLOROCYCLOHEXANE, delta		0.011		0.0000		0.000
PCB's						
ENDOSULFAN I + ENDOSULFAN II + ENDOSULFAN SULFATE						
MIREX						
DECHLORANE PLUS						
HEPTACHLOR + HEPTACHLOR EPOXIDE						

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: 07/16/2025 - 07/17/2025	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD: 0.0842						
1,2,4 – TRICHLOROBENZENE						
1,2 – DICHLOROETHANE		<0.60		0.000		0.000
1,1,1 – TRICHLOROETHANE		<0.39		0.000		0.000
HEXACHLOROETHANE		<0.60		0.000		0.000
1,1 – DICHLOROETHANE						
1,1,2 – TRICHLOROETHANE		<0.48		0.000		0.001
CHLOROETHANE						
1,2 – DICHLOROBENZENE						
1,3 – DICHLOROBENZENE						
1,4 – DICHLOROBENZENE						
1,1 DICHLOROETHYLENE						
1,2 – TRANS-DICHLOROETHYLENE						
1,3 – DICHLOROPROPYLENE						
METHYL CHLORIDE						
NITROBENZENE						
2 – NITROPHENOL						
4 – NITROPHENOL						
4,6 DINITRO-O-CRESOL						
BIS [2 – ETHYHEXYL] PHTHALATE						
ANTHRACENE						
DIETHYL PHTHALATE						
FLUORENE						

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: 07/16/2025 - 07/17/2025	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD: 0.0842						
1,2 - DICHLOROPROPANE						
VINYL CHLORIDE						
ACENAPHTHENE						
BENZENE						
CARBON TETRACHLORIDE						
CHLOROBENZENE						
HEXACHLOROBENZENE						
CHLOROFORM						
ETHYLBENZENE						
FLUORANTHENE						
METHYLENE CHLORIDE						
HEXACHLOROBUTADIENE						
NAPHTHALENE DI – N – BUTHYL PHTHALATE						
DIMETHYL PHTHALATE						
PHENANTHRENE						
PYRENE						
TETRACHLOROETHYLENE						
TOLUENE						
TRICHLOROETHYLENE						
TOTAL CYANIDE		45		0.0316		0.037
TOTAL LEAD						
TOTAL ZINC						

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: ___/___/_____	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD						
TOTAL SUSPENDED SOLIDS						
SOLUABLE ORGANIC CARBON						
TOTAL PHOSPHOROUS						
TOTAL PHENOL						
OIL and GREASE						
CADMIUM						
CHROMIUM						
COPPER						
LEAD						
MERCURY						
NICKEL						
ZINC						
ARSENIC						
BERYLLIUM						
BARIUM						
TOTAL CYANIDE						
pH (STANDARD UNITS)						
RESIDUAL CHLORINE						
TOTAL SODIUM CHLORIDE						
TOTAL AMMONIA						
DIETHYLENE GLYCOL						

PART II

COMPLIANCE MONITORING

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

NO VIOLATIONS

VIOLATION PARAMETER	DATE	FLOW [MGD]	SAMPLE POINT LOCATION	ACTUAL* DISCHARGE	PERMIT LIMIT	TYPE** LIMIT VIOLATED

NOTE:

* - Actual discharge – list actual analytical results and appropriate units.

** - Type Limit Violated – List Type:

A.A. = Annual Average

D.M. = Daily Maximum

L.L. = Local Limits (Regulation 1960.5)

eurofins | Environment Testing

ANALYTICAL REPORT

PREPARED FOR

Attn: Mr. Nathan Sarapas
TRC Environmental Corporation
Wannalancit Mills
650 Suffolk Street
Lowell, Massachusetts 01854

Generated 7/28/2025 9:19:51 AM

JOB DESCRIPTION

Solvent Chemical Quarterly Discharge

JOB NUMBER

480-231184-1

Eurofins Buffalo
10 Hazelwood Drive
Amherst NY 14228-2298

See page two for job notes and contact information.

my EOL

Job Notes

This report may not be reproduced except in full, and with written approval from the laboratory. The results relate only to the samples tested. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

The test results in this report relate only to the samples as received by the laboratory and will meet all requirements of the methodology, with any exceptions noted. This report shall not be reproduced except in full, without the express written approval of the laboratory. All questions should be directed to the Eurofins Environment Testing Northeast, LLC Project Manager.

Authorization



Generated
7/28/2025 9:19:51 AM

Authorized for release by
Kavya Boyina, Project Manager
kavya.boyina@et.eurofinsus.com
(716)504-9813

Table of Contents

Cover Page 1
Table of Contents 3
Definitions/Glossary 4
Case Narrative 5
Detection Summary 6
Client Sample Results 7
Surrogate Summary 9
QC Sample Results 10
QC Association Summary 15
Lab Chronicle 16
Certification Summary 17
Method Summary 18
Sample Summary 19
Chain of Custody 20
Receipt Checklists 21

Definitions/Glossary

Client: TRC Environmental Corporation
Job ID: 480-231184-1
Project/Site: Solvent Chemical Quarterly Discharge

Qualifiers

GC/MS VOA

Qualifier	Qualifier Description
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

GC Semi VOA

Qualifier	Qualifier Description
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.
p	The %RPD between the primary and confirmation column/detector is >40%. The lower value has been reported.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
☼	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CFU	Colony Forming Unit
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MCL	EPA recommended "Maximum Contaminant Level"
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
MPN	Most Probable Number
MQL	Method Quantitation Limit
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
NEG	Negative / Absent
POS	Positive / Present
PQL	Practical Quantitation Limit
PRES	Presumptive
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)
TNTC	Too Numerous To Count

Job ID: 480-231184-1 Eurofins Buffalo

Job Narrative
480-231184-1

Analytical test results meet all requirements of the associated regulatory program listed on the Accreditation/Certification Summary Page unless otherwise noted under the individual analysis. Data qualifiers and/or narrative comments are included to explain any exceptions, if applicable.

- Matrix QC may not be reported if insufficient sample is provided or site-specific QC samples were not submitted. In these situations, to demonstrate precision and accuracy at a batch level, a LCS/LCSD may be performed, unless otherwise specified in the method.
- Surrogate and/or isotope dilution analyte recoveries (if applicable) which are outside of the QC window are confirmed unless attributed to a dilution or otherwise noted in the narrative.

Regulated compliance samples (e.g. SDWA, NPDES) must comply with the associated agency requirements/permits.

Receipt
The samples were received on 7/17/2025 9:23 AM. Unless otherwise noted below, the samples arrived in good condition, and, where required, properly preserved and on ice. The temperature of the cooler at receipt time was 3.8°C.

GC/MS VOA
Method 624.1_PREC: The following Volatile sample was composited by the laboratory on 07/18/2025 as requested by the client: Effluent-24HR-Comp-0716-25-001 (480-231184-1).
Regulatory defined guidance for in-laboratory compositing of samples, is currently not available. Laboratory sample compositing was performed using established project specifications and/or laboratory standard operating procedures.

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

GC/MS Semi VOA
Method 625.1_PREC: The continuing calibration verification (CCV) associated with batch 480-752371 recovered above the upper control limit for Hexachlorobutadiene. The samples associated with this CCV were non-detects for the affected analytes; therefore, the data have been reported. The associated sample is:Effluent-24HR-Comp-0716-25-001 (480-231184-1).

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

Pesticides
No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

General Chemistry
No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

Detection Summary

Client: TRC Environmental Corporation
Job ID: 480-231184-1
Project/Site: Solvent Chemical Quarterly Discharge

Client Sample ID: Effluent-24HR-Comp-0716-25-001 — Lab Sample ID: 480-231184-1

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
alpha-BHC	0.019	J	0.048	0.0073	ug/L	1		608.3	Total/NA
beta-BHC	0.051		0.048	0.024	ug/L	1		608.3	Total/NA
delta-BHC	0.011	J	0.048	0.0095	ug/L	1		608.3	Total/NA
gamma-BHC (Lindane)	0.014	J p	0.048	0.0076	ug/L	1		608.3	Total/NA
BHC, Total	0.086	p	0.048	0.048	ug/L	1		608.3	Total/NA
Cyanide, Total	0.045		0.010	0.0050	mg/L	1		335.4	Total/NA

This Detection Summary does not include radiochemical test results.

Client: TRC Environmental Corporation
Job ID: 480-231184-1
Project/Site: Solvent Chemical Quarterly Discharge

Client Sample ID: Effluent-24HR-Comp-0716-25-001
Lab Sample ID: 480-231184-1
Date Collected: 07/17/25 08:30
Matrix: Water
Date Received: 07/17/25 09:23

Method: EPA 624.1 - Volatile Organic Compounds (GC/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1-Trichloroethane	ND		5.0	0.39	ug/L			07/18/25 22:04	1
1,1,2,2-Tetrachloroethane	ND		5.0	0.26	ug/L			07/18/25 22:04	1
1,1,2-Trichloroethane	ND		5.0	0.48	ug/L			07/18/25 22:04	1
1,1-Dichloroethane	ND		5.0	0.59	ug/L			07/18/25 22:04	1
1,1-Dichloroethene	ND		5.0	0.85	ug/L			07/18/25 22:04	1
1,2-Dichlorobenzene	ND		5.0	0.44	ug/L			07/18/25 22:04	1
1,2-Dichloroethane	ND		5.0	0.60	ug/L			07/18/25 22:04	1
1,2-Dichloropropane	ND		5.0	0.61	ug/L			07/18/25 22:04	1
1,3-Dichlorobenzene	ND		5.0	0.54	ug/L			07/18/25 22:04	1
1,4-Dichlorobenzene	ND		5.0	0.51	ug/L			07/18/25 22:04	1
2-Chloroethyl vinyl ether	ND		25	1.9	ug/L			07/18/25 22:04	1
Acrolein	ND		100	17	ug/L			07/18/25 22:04	1
Acrylonitrile	ND		50	1.9	ug/L			07/18/25 22:04	1
Benzene	ND		5.0	0.60	ug/L			07/18/25 22:04	1
Bromoform	ND		5.0	0.47	ug/L			07/18/25 22:04	1
Bromomethane	ND		5.0	1.2	ug/L			07/18/25 22:04	1
Carbon tetrachloride	ND		5.0	0.51	ug/L			07/18/25 22:04	1
Chlorobenzene	ND		5.0	0.48	ug/L			07/18/25 22:04	1
Chlorodibromomethane	ND		5.0	0.41	ug/L			07/18/25 22:04	1
Chloroethane	ND		5.0	0.87	ug/L			07/18/25 22:04	1
Chloroform	ND		5.0	0.54	ug/L			07/18/25 22:04	1
Chloromethane	ND		5.0	0.64	ug/L			07/18/25 22:04	1
cis-1,3-Dichloropropene	ND		5.0	0.33	ug/L			07/18/25 22:04	1
Bromodichloromethane	ND		5.0	0.54	ug/L			07/18/25 22:04	1
Ethylbenzene	ND		5.0	0.46	ug/L			07/18/25 22:04	1
Methylene Chloride	ND		5.0	0.81	ug/L			07/18/25 22:04	1
Tetrachloroethene	ND		5.0	0.34	ug/L			07/18/25 22:04	1
Toluene	ND		5.0	0.45	ug/L			07/18/25 22:04	1
trans-1,2-Dichloroethene	ND		5.0	0.59	ug/L			07/18/25 22:04	1
trans-1,3-Dichloropropene	ND		5.0	0.44	ug/L			07/18/25 22:04	1
Trichloroethene	ND		5.0	0.60	ug/L			07/18/25 22:04	1
Vinyl chloride	ND		5.0	0.75	ug/L			07/18/25 22:04	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*109*		*68 - 130*		*07/18/25 22:04*	*1*
4-Bromofluorobenzene (Surr)	*108*		*76 - 123*		*07/18/25 22:04*	*1*
Toluene-d8 (Surr)	*105*		*77 - 120*		*07/18/25 22:04*	*1*
Dibromofluoromethane (Surr)	*105*		*75 - 123*		*07/18/25 22:04*	*1*

Method: EPA 625.1 - Semivolatile Organic Compounds (GC/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,2,4-Trichlorobenzene	ND		10	0.82	ug/L		07/21/25 07:54	07/22/25 17:40	1
1,2-Dichlorobenzene	ND		10	1.0	ug/L		07/21/25 07:54	07/22/25 17:40	1
1,3-Dichlorobenzene	ND		10	0.69	ug/L		07/21/25 07:54	07/22/25 17:40	1
1,4-Dichlorobenzene	ND		10	0.82	ug/L		07/21/25 07:54	07/22/25 17:40	1
2,4,6-Trichlorophenol	ND		5.0	1.0	ug/L		07/21/25 07:54	07/22/25 17:40	1
Hexachlorobutadiene	ND		5.0	1.0	ug/L		07/21/25 07:54	07/22/25 17:40	1
Hexachloroethane	ND		5.0	0.60	ug/L		07/21/25 07:54	07/22/25 17:40	1

Client Sample ID: Effluent-24HR-Comp-0716-25-001
Lab Sample ID: 480-231184-1

Date Collected: 07/17/25 08:30
Matrix: Water
Date Received: 07/17/25 09:23

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
2,4,6-Tribromophenol (Surr)	*91*		*52 - 151*	*07/21/25 07:54*	*07/22/25 17:40*	*1*
2-Fluorobiphenyl (Surr)	*77*		*44 - 120*	*07/21/25 07:54*	*07/22/25 17:40*	*1*
2-Fluorophenol (Surr)	*49*		*17 - 120*	*07/21/25 07:54*	*07/22/25 17:40*	*1*
Nitrobenzene-d5 (Surr)	*78*		*15 - 314*	*07/21/25 07:54*	*07/22/25 17:40*	*1*
Phenol-d5 (Surr)	*35*		*8 - 424*	*07/21/25 07:54*	*07/22/25 17:40*	*1*
p-Terphenyl-d14 (Surr)	*69*		*22 - 125*	*07/21/25 07:54*	*07/22/25 17:40*	*1*

Method: EPA 608.3 - Organochlorine Pesticides in Water

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
alpha-BHC	**0.019**	**J**	0.048	0.0073	ug/L		07/18/25 13:54	07/22/25 19:21	1
beta-BHC	**0.051**		0.048	0.024	ug/L		07/18/25 13:54	07/22/25 19:21	1
delta-BHC	**0.011**	**J**	0.048	0.0095	ug/L		07/18/25 13:54	07/22/25 19:21	1
gamma-BHC (Lindane)	**0.014**	**J p**	0.048	0.0076	ug/L		07/18/25 13:54	07/22/25 19:21	1
BHC, Total	**0.086**	**p**	0.048	0.048	ug/L		07/18/25 13:54	07/22/25 19:21	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
DCB Decachlorobiphenyl (Surr)	*52*		*10 - 120*	*07/18/25 13:54*	*07/22/25 19:21*	*1*
Tetrachloro-m-xylene (Surr)	*76*		*10 - 120*	*07/18/25 13:54*	*07/22/25 19:21*	*1*

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Cyanide, Total (EPA 335.4)	**0.045**		0.010	0.0050	mg/L		07/25/25 11:45	07/26/25 10:49	1

Surrogate Summary

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Quarterly Discharge

Job ID: 480-231184-1

Method: 624.1 - Volatile Organic Compounds (GC/MS)

Matrix: Water — **Prep Type: Total/NA**

		Percent Surrogate Recovery (Acceptance Limits)			
		DCA	BFB	TOL	DBFM
Lab Sample ID	Client Sample ID	(68-130)	(76-123)	(77-120)	(75-123)
480-231184-1	Effluent-24HR-Comp-0716-25-0	109	108	105	105
LCS 480-752129/6	Lab Control Sample	107	106	106	104
MB 480-752129/8	Method Blank	110	107	107	108

Surrogate Legend

DCA = 1,2-Dichloroethane-d4 (Surr)
BFB = 4-Bromofluorobenzene (Surr)
TOL = Toluene-d8 (Surr)
DBFM = Dibromofluoromethane (Surr)

Method: 625.1 - Semivolatile Organic Compounds (GC/MS)

Matrix: Water — **Prep Type: Total/NA**

		Percent Surrogate Recovery (Acceptance Limits)					
		TBP	FBP	2FP	NBZ	PHL	TPHd14
Lab Sample ID	Client Sample ID	(52-151)	(44-120)	(17-120)	(15-314)	(8-424)	(22-125)
480-231184-1	Effluent-24HR-Comp-0716-25-0	91	77	49	78	35	69
480-231184-1 MS	Effluent-24HR-Comp-0716-25-001	86	76	50	81	39	59
480-231184-1 MSD	Effluent-24HR-Comp-0716-25-001	95	80	50	85	41	64
LCS 480-752245/2-A	Lab Control Sample	111	98	69	114	50	99
MB 480-752245/1-A	Method Blank	74	83	58	87	40	98

Surrogate Legend

TBP = 2,4,6-Tribromophenol (Surr)
FBP = 2-Fluorobiphenyl (Surr)
2FP = 2-Fluorophenol (Surr)
NBZ = Nitrobenzene-d5 (Surr)
PHL = Phenol-d5 (Surr)
TPHd14 = p-Terphenyl-d14 (Surr)

Method: 608.3 - Organochlorine Pesticides in Water

Matrix: Water — **Prep Type: Total/NA**

		Percent Surrogate Recovery (Acceptance Limits)	
		DCBP1	TCX1
Lab Sample ID	Client Sample ID	(10-120)	(10-120)
480-231184-1	Effluent-24HR-Comp-0716-25-0	52	76
LCS 480-752150/2-A	Lab Control Sample	67	59
MB 480-752150/1-A	Method Blank	70	60

Surrogate Legend

DCBP = DCB Decachlorobiphenyl (Surr)
TCX = Tetrachloro-m-xylene (Surr)

Method: 624.1 - Volatile Organic Compounds (GC/MS)

Lab Sample ID: MB 480-752129/8
Matrix: Water
Analysis Batch: 752129

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1-Trichloroethane	ND		5.0	0.39	ug/L			07/18/25 14:26	1
1,1,2,2-Tetrachloroethane	ND		5.0	0.26	ug/L			07/18/25 14:26	1
1,1,2-Trichloroethane	ND		5.0	0.48	ug/L			07/18/25 14:26	1
1,1-Dichloroethane	ND		5.0	0.59	ug/L			07/18/25 14:26	1
1,1-Dichloroethene	ND		5.0	0.85	ug/L			07/18/25 14:26	1
1,2-Dichlorobenzene	ND		5.0	0.44	ug/L			07/18/25 14:26	1
1,2-Dichloroethane	ND		5.0	0.60	ug/L			07/18/25 14:26	1
1,2-Dichloropropane	ND		5.0	0.61	ug/L			07/18/25 14:26	1
1,3-Dichlorobenzene	ND		5.0	0.54	ug/L			07/18/25 14:26	1
1,4-Dichlorobenzene	ND		5.0	0.51	ug/L			07/18/25 14:26	1
2-Chloroethyl vinyl ether	ND		25	1.9	ug/L			07/18/25 14:26	1
Acrolein	ND		100	17	ug/L			07/18/25 14:26	1
Acrylonitrile	ND		50	1.9	ug/L			07/18/25 14:26	1
Benzene	ND		5.0	0.60	ug/L			07/18/25 14:26	1
Bromoform	ND		5.0	0.47	ug/L			07/18/25 14:26	1
Bromomethane	ND		5.0	1.2	ug/L			07/18/25 14:26	1
Carbon tetrachloride	ND		5.0	0.51	ug/L			07/18/25 14:26	1
Chlorobenzene	ND		5.0	0.48	ug/L			07/18/25 14:26	1
Chlorodibromomethane	ND		5.0	0.41	ug/L			07/18/25 14:26	1
Chloroethane	ND		5.0	0.87	ug/L			07/18/25 14:26	1
Chloroform	ND		5.0	0.54	ug/L			07/18/25 14:26	1
Chloromethane	ND		5.0	0.64	ug/L			07/18/25 14:26	1
cis-1,3-Dichloropropene	ND		5.0	0.33	ug/L			07/18/25 14:26	1
Bromodichloromethane	ND		5.0	0.54	ug/L			07/18/25 14:26	1
Ethylbenzene	ND		5.0	0.46	ug/L			07/18/25 14:26	1
Methylene Chloride	ND		5.0	0.81	ug/L			07/18/25 14:26	1
Tetrachloroethene	ND		5.0	0.34	ug/L			07/18/25 14:26	1
Toluene	ND		5.0	0.45	ug/L			07/18/25 14:26	1
trans-1,2-Dichloroethene	ND		5.0	0.59	ug/L			07/18/25 14:26	1
trans-1,3-Dichloropropene	ND		5.0	0.44	ug/L			07/18/25 14:26	1
Trichloroethene	ND		5.0	0.60	ug/L			07/18/25 14:26	1
Vinyl chloride	ND		5.0	0.75	ug/L			07/18/25 14:26	1

Surrogate	*MB %Recovery*	*MB Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*110*		*68 - 130*		*07/18/25 14:26*	*1*
4-Bromofluorobenzene (Surr)	*107*		*76 - 123*		*07/18/25 14:26*	*1*
Toluene-d8 (Surr)	*107*		*77 - 120*		*07/18/25 14:26*	*1*
Dibromofluoromethane (Surr)	*108*		*75 - 123*		*07/18/25 14:26*	*1*

Lab Sample ID: LCS 480-752129/6
Matrix: Water
Analysis Batch: 752129

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,1,1-Trichloroethane	20.0	21.3		ug/L		106	52 - 162
1,1,2,2-Tetrachloroethane	20.0	21.4		ug/L		107	46 - 157
1,1,2-Trichloroethane	20.0	21.6		ug/L		108	52 - 150
1,1-Dichloroethane	20.0	21.3		ug/L		107	59 - 155

Method: 624.1 - Volatile Organic Compounds (GC/MS) (Continued)

Lab Sample ID: LCS 480-752129/6
Matrix: Water
Analysis Batch: 752129

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,1-Dichloroethene	20.0	19.0		ug/L		95	1 - 234
1,2-Dichlorobenzene	20.0	20.6		ug/L		103	18 - 190
1,2-Dichloroethane	20.0	22.4		ug/L		112	49 - 155
1,2-Dichloropropane	20.0	21.6		ug/L		108	1 - 210
1,3-Dichlorobenzene	20.0	20.6		ug/L		103	59 - 156
1,4-Dichlorobenzene	20.0	20.7		ug/L		103	18 - 190
2-Chloroethyl vinyl ether	20.0	22.8	J	ug/L		114	1 - 305
Benzene	20.0	20.6		ug/L		103	37 - 151
Bromoform	20.0	20.7		ug/L		103	45 - 169
Bromomethane	20.0	18.1		ug/L		90	1 - 242
Carbon tetrachloride	20.0	21.7		ug/L		109	70 - 140
Chlorobenzene	20.0	20.9		ug/L		104	37 - 160
Chlorodibromomethane	20.0	21.4		ug/L		107	53 - 149
Chloroethane	20.0	17.3		ug/L		87	14 - 230
Chloroform	20.0	21.3		ug/L		106	51 - 138
Chloromethane	20.0	21.1		ug/L		105	1 - 273
cis-1,3-Dichloropropene	20.0	20.8		ug/L		104	1 - 227
Bromodichloromethane	20.0	21.2		ug/L		106	35 - 155
Ethylbenzene	20.0	20.7		ug/L		104	37 - 162
Methylene Chloride	20.0	18.2		ug/L		91	1 - 221
Tetrachloroethene	20.0	20.3		ug/L		101	64 - 148
Toluene	20.0	20.5		ug/L		102	47 - 150
trans-1,2-Dichloroethene	20.0	20.6		ug/L		103	54 - 156
trans-1,3-Dichloropropene	20.0	21.3		ug/L		107	17 - 183
Trichloroethene	20.0	20.7		ug/L		104	71 - 157
Vinyl chloride	20.0	21.7		ug/L		108	1 - 251

Surrogate	*LCS %Recovery*	*LCS Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*107*		*68 - 130*
4-Bromofluorobenzene (Surr)	*106*		*76 - 123*
Toluene-d8 (Surr)	*106*		*77 - 120*
Dibromofluoromethane (Surr)	*104*		*75 - 123*

Method: 625.1 - Semivolatile Organic Compounds (GC/MS)

Lab Sample ID: MB 480-752245/1-A
Matrix: Water
Analysis Batch: 752371

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 752245

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,2,4-Trichlorobenzene	ND		10	0.82	ug/L		07/21/25 07:54	07/22/25 15:49	1
1,2-Dichlorobenzene	ND		10	1.0	ug/L		07/21/25 07:54	07/22/25 15:49	1
1,3-Dichlorobenzene	ND		10	0.69	ug/L		07/21/25 07:54	07/22/25 15:49	1
1,4-Dichlorobenzene	ND		10	0.82	ug/L		07/21/25 07:54	07/22/25 15:49	1
2,4,6-Trichlorophenol	ND		5.0	1.0	ug/L		07/21/25 07:54	07/22/25 15:49	1
Hexachlorobutadiene	ND		5.0	1.0	ug/L		07/21/25 07:54	07/22/25 15:49	1
Hexachloroethane	ND		5.0	0.60	ug/L		07/21/25 07:54	07/22/25 15:49	1

Method: 625.1 - Semivolatile Organic Compounds (GC/MS) (Continued)

Lab Sample ID: MB 480-752245/1-A
Matrix: Water
Analysis Batch: 752371

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 752245

Surrogate	MB %Recovery	MB Qualifier	Limits	Prepared	Analyzed	Dil Fac
2,4,6-Tribromophenol (Surr)	74		52 - 151	07/21/25 07:54	07/22/25 15:49	1
2-Fluorobiphenyl (Surr)	83		44 - 120	07/21/25 07:54	07/22/25 15:49	1
2-Fluorophenol (Surr)	58		17 - 120	07/21/25 07:54	07/22/25 15:49	1
Nitrobenzene-d5 (Surr)	87		15 - 314	07/21/25 07:54	07/22/25 15:49	1
Phenol-d5 (Surr)	40		8 - 424	07/21/25 07:54	07/22/25 15:49	1
p-Terphenyl-d14 (Surr)	98		22 - 125	07/21/25 07:54	07/22/25 15:49	1

Lab Sample ID: LCS 480-752245/2-A
Matrix: Water
Analysis Batch: 752371

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 752245

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,2,4-Trichlorobenzene	32.0	30.5		ug/L		95	44 - 142
1,2-Dichlorobenzene	32.0	25.5		ug/L		80	32 - 129
1,3-Dichlorobenzene	32.0	24.6		ug/L		77	1 - 172
1,4-Dichlorobenzene	32.0	25.5		ug/L		80	20 - 124
2,4,6-Trichlorophenol	32.0	32.5		ug/L		102	37 - 144
Hexachlorobutadiene	32.0	30.9		ug/L		97	24 - 120
Hexachloroethane	32.0	23.7		ug/L		74	40 - 120

Surrogate	LCS %Recovery	LCS Qualifier	Limits
2,4,6-Tribromophenol (Surr)	111		52 - 151
2-Fluorobiphenyl (Surr)	98		44 - 120
2-Fluorophenol (Surr)	69		17 - 120
Nitrobenzene-d5 (Surr)	114		15 - 314
Phenol-d5 (Surr)	50		8 - 424
p-Terphenyl-d14 (Surr)	99		22 - 125

Lab Sample ID: 480-231184-1 MS
Matrix: Water
Analysis Batch: 752371

Client Sample ID: Effluent-24HR-Comp-0716-25-001
Prep Type: Total/NA
Prep Batch: 752245

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
1,2,4-Trichlorobenzene	ND		32.0	21.6		ug/L		68	44 - 142
1,2-Dichlorobenzene	ND		32.0	18.6		ug/L		58	32 - 129
1,3-Dichlorobenzene	ND		32.0	19.3		ug/L		60	1 - 172
1,4-Dichlorobenzene	ND		32.0	19.0		ug/L		59	20 - 124
2,4,6-Trichlorophenol	ND		32.0	24.9		ug/L		78	37 - 144
Hexachlorobutadiene	ND		32.0	22.5		ug/L		70	24 - 120
Hexachloroethane	ND		32.0	17.4		ug/L		54	40 - 120

Surrogate	MS %Recovery	MS Qualifier	Limits
2,4,6-Tribromophenol (Surr)	86		52 - 151
2-Fluorobiphenyl (Surr)	76		44 - 120
2-Fluorophenol (Surr)	50		17 - 120
Nitrobenzene-d5 (Surr)	81		15 - 314
Phenol-d5 (Surr)	39		8 - 424
p-Terphenyl-d14 (Surr)	59		22 - 125

Method: 625.1 - Semivolatile Organic Compounds (GC/MS)

Lab Sample ID: 480-231184-1 MSD | **Client Sample ID: Effluent-24HR-Comp-0716-25-001**
Matrix: Water | **Prep Type: Total/NA**
Analysis Batch: 752371 | **Prep Batch: 752245**

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
1,2,4-Trichlorobenzene	ND		32.0	25.1		ug/L		78	44 - 142	15	50
1,2-Dichlorobenzene	ND		32.0	20.9		ug/L		65	32 - 129	12	38
1,3-Dichlorobenzene	ND		32.0	20.7		ug/L		65	1 - 172	7	37
1,4-Dichlorobenzene	ND		32.0	20.2		ug/L		63	20 - 124	6	40
2,4,6-Trichlorophenol	ND		32.0	26.8		ug/L		84	37 - 144	7	58
Hexachlorobutadiene	ND		32.0	25.8		ug/L		81	24 - 120	14	62
Hexachloroethane	ND		32.0	19.0		ug/L		59	40 - 120	9	52

Surrogate	*MSD %Recovery*	*MSD Qualifier*	*Limits*
2,4,6-Tribromophenol (Surr)	*95*		*52 - 151*
2-Fluorobiphenyl (Surr)	*80*		*44 - 120*
2-Fluorophenol (Surr)	*50*		*17 - 120*
Nitrobenzene-d5 (Surr)	*85*		*15 - 314*
Phenol-d5 (Surr)	*41*		*8 - 424*
p-Terphenyl-d14 (Surr)	*64*		*22 - 125*

Method: 608.3 - Organochlorine Pesticides in Water

Lab Sample ID: MB 480-752150/1-A | **Client Sample ID: Method Blank**
Matrix: Water | **Prep Type: Total/NA**
Analysis Batch: 752346 | **Prep Batch: 752150**

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
alpha-BHC	ND		0.050	0.0077	ug/L		07/18/25 13:54	07/22/25 15:06	1
beta-BHC	ND		0.050	0.025	ug/L		07/18/25 13:54	07/22/25 15:06	1
delta-BHC	ND		0.050	0.010	ug/L		07/18/25 13:54	07/22/25 15:06	1
gamma-BHC (Lindane)	ND		0.050	0.0080	ug/L		07/18/25 13:54	07/22/25 15:06	1
BHC, Total	ND		0.050	0.050	ug/L		07/18/25 13:54	07/22/25 15:06	1

Surrogate	*MB %Recovery*	*MB Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
DCB Decachlorobiphenyl (Surr)	*70*		*10 - 120*	*07/18/25 13:54*	*07/22/25 15:06*	*1*
Tetrachloro-m-xylene (Surr)	*60*		*10 - 120*	*07/18/25 13:54*	*07/22/25 15:06*	*1*

Lab Sample ID: LCS 480-752150/2-A | **Client Sample ID: Lab Control Sample**
Matrix: Water | **Prep Type: Total/NA**
Analysis Batch: 752346 | **Prep Batch: 752150**

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
alpha-BHC	0.500	0.322		ug/L		64	52 - 125
beta-BHC	0.500	0.389		ug/L		78	52 - 120
delta-BHC	0.500	0.394		ug/L		79	51 - 120
gamma-BHC (Lindane)	0.500	0.363		ug/L		73	56 - 120

Surrogate	*LCS %Recovery*	*LCS Qualifier*	*Limits*
DCB Decachlorobiphenyl (Surr)	*67*		*10 - 120*
Tetrachloro-m-xylene (Surr)	*59*		*10 - 120*

Method: 335.4 - Cyanide, Total

Lab Sample ID: MB 480-752734/1-A
Matrix: Water
Analysis Batch: 752766

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 752734

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Cyanide, Total	ND		0.010	0.0050	mg/L		07/25/25 11:45	07/26/25 10:38	1

Lab Sample ID: LCS 480-752734/2-A
Matrix: Water
Analysis Batch: 752766

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 752734

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Cyanide, Total	0.400	0.389		mg/L		97	90 - 110

Lab Sample ID: LCS 480-752734/3-A
Matrix: Water
Analysis Batch: 752766

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 752734

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Cyanide, Total	0.250	0.230		mg/L		92	90 - 110

QC Association Summary

Client: TRC Environmental Corporation
Job ID: 480-231184-1
Project/Site: Solvent Chemical Quarterly Discharge

GC/MS VOA

Analysis Batch: 752129

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-231184-1	Effluent-24HR-Comp-0716-25-001	Total/NA	Water	624.1	
MB 480-752129/8	Method Blank	Total/NA	Water	624.1	
LCS 480-752129/6	Lab Control Sample	Total/NA	Water	624.1	

GC/MS Semi VOA

Prep Batch: 752245

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-231184-1	Effluent-24HR-Comp-0716-25-001	Total/NA	Water	625	
MB 480-752245/1-A	Method Blank	Total/NA	Water	625	
LCS 480-752245/2-A	Lab Control Sample	Total/NA	Water	625	
480-231184-1 MS	Effluent-24HR-Comp-0716-25-001	Total/NA	Water	625	
480-231184-1 MSD	Effluent-24HR-Comp-0716-25-001	Total/NA	Water	625	

Analysis Batch: 752371

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-231184-1	Effluent-24HR-Comp-0716-25-001	Total/NA	Water	625.1	752245
MB 480-752245/1-A	Method Blank	Total/NA	Water	625.1	752245
LCS 480-752245/2-A	Lab Control Sample	Total/NA	Water	625.1	752245
480-231184-1 MS	Effluent-24HR-Comp-0716-25-001	Total/NA	Water	625.1	752245
480-231184-1 MSD	Effluent-24HR-Comp-0716-25-001	Total/NA	Water	625.1	752245

GC Semi VOA

Prep Batch: 752150

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-231184-1	Effluent-24HR-Comp-0716-25-001	Total/NA	Water	3510C	
MB 480-752150/1-A	Method Blank	Total/NA	Water	3510C	
LCS 480-752150/2-A	Lab Control Sample	Total/NA	Water	3510C	

Analysis Batch: 752346

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-231184-1	Effluent-24HR-Comp-0716-25-001	Total/NA	Water	608.3	752150
MB 480-752150/1-A	Method Blank	Total/NA	Water	608.3	752150
LCS 480-752150/2-A	Lab Control Sample	Total/NA	Water	608.3	752150

General Chemistry

Prep Batch: 752734

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-231184-1	Effluent-24HR-Comp-0716-25-001	Total/NA	Water	Distill/CN	
MB 480-752734/1-A	Method Blank	Total/NA	Water	Distill/CN	
LCS 480-752734/2-A	Lab Control Sample	Total/NA	Water	Distill/CN	
LCS 480-752734/3-A	Lab Control Sample	Total/NA	Water	Distill/CN	

Analysis Batch: 752766

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-231184-1	Effluent-24HR-Comp-0716-25-001	Total/NA	Water	335.4	752734
MB 480-752734/1-A	Method Blank	Total/NA	Water	335.4	752734
LCS 480-752734/2-A	Lab Control Sample	Total/NA	Water	335.4	752734
LCS 480-752734/3-A	Lab Control Sample	Total/NA	Water	335.4	752734

Lab Chronicle

Client: TRC Environmental Corporation
Job ID: 480-231184-1
Project/Site: Solvent Chemical Quarterly Discharge

Client Sample ID: Effluent-24HR-Comp-0716-25-001
Lab Sample ID: 480-231184-1

Date Collected: 07/17/25 08:30
Matrix: Water
Date Received: 07/17/25 09:23

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	624.1		1	752129	AXK	EET BUF	07/18/25 22:04
Total/NA	Prep	625			752245	JMP	EET BUF	07/21/25 07:54
Total/NA	Analysis	625.1		1	752371	JMM	EET BUF	07/22/25 17:40
Total/NA	Prep	3510C			752150	LSC	EET BUF	07/18/25 13:54
Total/NA	Analysis	608.3		1	752346	JLS	EET BUF	07/22/25 19:21
Total/NA	Prep	Distill/CN			752734	AM	EET BUF	07/25/25 11:45
Total/NA	Analysis	335.4		1	752766	AM	EET BUF	07/26/25 10:49

Laboratory References:

EET BUF = Eurofins Buffalo, 10 Hazelwood Drive, Amherst, NY 14228-2298, TEL (716)691-2600

Accreditation/Certification Summary

Client: TRC Environmental Corporation
Job ID: 480-231184-1
Project/Site: Solvent Chemical Quarterly Discharge

Laboratory: Eurofins Buffalo

Unless otherwise noted, all analytes for this laboratory were covered under each accreditation/certification below.

Authority	Program	Identification Number	Expiration Date
New York	NELAP	10026	03-31-26

The following analytes are included in this report, but the laboratory is not certified by the governing authority. This list may include analytes for which the agency does not offer certification.

Analysis Method	Prep Method	Matrix	Analyte
608.3	3510C	Water	BHC, Total
625.1	625	Water	1,2-Dichlorobenzene
625.1	625	Water	1,3-Dichlorobenzene
625.1	625	Water	1,4-Dichlorobenzene

Method Summary

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Quarterly Discharge

Job ID: 480-231184-1

Method	Method Description	Protocol	Laboratory
624.1	Volatile Organic Compounds (GC/MS)	EPA	EET BUF
625.1	Semivolatile Organic Compounds (GC/MS)	EPA	EET BUF
608.3	Organochlorine Pesticides in Water	EPA	EET BUF
335.4	Cyanide, Total	EPA	EET BUF
3510C	Liquid-Liquid Extraction (Separatory Funnel)	SW846	EET BUF
625	Liquid-Liquid Extraction	EPA	EET BUF
Distill/CN	Distillation, Cyanide	None	EET BUF

Protocol References:

EPA = US Environmental Protection Agency

None = None

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

Laboratory References:

EET BUF = Eurofins Buffalo, 10 Hazelwood Drive, Amherst, NY 14228-2298, TEL (716)691-2600

Sample Summary

Client: TRC Environmental Corporation
Job ID: 480-231184-1
Project/Site: Solvent Chemical Quarterly Discharge

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
480-231184-1	Effluent-24HR-Comp-0716-25-001	Water	07/17/25 08:30	07/17/25 09:23

10 Hazelwood Drive
Amherst, NY 14228-2298
Phone: 716-691-2600 Fax: 716-691-7991

Chain of Custody Record

eurofins | Environment Testing

Client Information	Sampler: Chris Corrigan	Lab PM: Boyina, Kavya	Carrier Tracking No(s):	COC No: 480-197462-37907.1
Client Contact: ~~Mr. Mike Plumb~~ David McKenzie	Phone: 716-251-9164	E-Mail: kavya.boyina@et.eurofinsus.com	State of Origin:	Page: Page 1 of 1
Company: TRC Environmental Corporation	PWSID:			Job #:
Address: Wannalancit Mills 650 Suffolk Street	Due Date Requested:			
City: Lowell	TAT Requested (days):			
State, Zip: MA, 01854	Compliance Project: Δ Yes Δ No			
Phone: ~~978-656-3632(Tel)~~ 734-904-3516	PO #: ~~220910~~ 200943			
Email: ~~mplumb@trocompanies.com~~ DMckenzie@TRLcompanies.com	WO #:			
Project Name: Solvent Chemical S/A Discharge	Project #: 48002462			
Site: 3163 Buffalo Ave.	SSOW#:			

Analysis Requested

Preservation Codes:
N - None
B - NaOH
Other:

Sample Identification	Sample Date	Sample Time	Sample Type (C=comp, G=grab)	Matrix (W=water, S=solid, O=waste/oil, BT=Tissue, A=Air, DW=Drinking Water)	Field Filtered Sample (Yes or No)	Perform MS/MSD (Yes or No)	608.3_Pest_PREC - Pesticides	625.1_PREC - Priority Pollutant SVOCs	335.4 - Cyanide	624.1_PREC - Priority Pollutant VOCs	Total Number of containers	Special Instructions/Note:
Preservation Code:							N	N	B	N		
Effluent-24HR-Comp-071625-001	7-17-25	0830	C	Water	N	N	X	X	X		5	All Samples Shipped on Ice
Effluent-071625-002	7-16-25	0540	G	W	N	N				X	1	
Effluent-071625-003	7-16-25	0930	G	W	N	N				X	1	
Effluent-071625-004	7-16-25	1510	G	W	N	N				X	1	
Effluent-071625-005	7-16-25	1805	G	W	N	N				X	1	

480-231184 Chain of Custody

Possible Hazard Identification
☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☒ Unknown ☐ Radiological

Sample Disposal (A fee may be assessed if samp
☐ Return To Client ☒ Disposal By Lab

Deliverable Requested: I, II, III, IV, Other (specify)

Special Instructions/QC Requirements:

Empty Kit Relinquished by:	Date:	Time:	Method of Shipment:

	Relinquished by	Date/Time	Company	Received by	Date/Time	Company
		11.17.2025 9:23			7-17-25 923	TRC
	Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company
	Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company

Custody Seals Intact: Δ Yes Δ No | Custody Seal No.: | Cooler Temperature(s) °C and Other Remarks: 3.8 ICE

Ver: 10/10/2024

7/28/2025

Login Sample Receipt Checklist

Client: TRC Environmental Corporation

Job Number: 480-231184-1

Login Number: 231184
List Number: 1
Creator: Yeager, Brian A

List Source: Eurofins Buffalo

Question	Answer	Comment
Radioactivity either was not measured or, if measured, is at or below background	True	
The cooler's custody seal, if present, is intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	3.8 ICE IR# SC
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the sample IDs on the containers and the COC.	True	
Samples are received within Holding Time (Excluding tests with immediate HTs)..	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
VOA sample vials do not have headspace or bubble is <6mm (1/4") in diameter.	True	
If necessary, staff have been informed of any short hold time or quick TAT needs	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Sampling Company provided.	True	TRC
Samples received within 48 hours of sampling.	True	
Samples requiring field filtration have been filtered in the field.	True	
Chlorine Residual checked.	N/A	

650 Suffolk Street
Lowell, MA 01854

t 978-570-5600

November 21, 2025

Matthew Lagamba
Niagara Falls Water Board
Wastewater Treatment Plant
5815 Buffalo Ave, Niagara Falls, NY 14304
(716) 283-9770

Re: 2025 Quarterly (Fourth Quarter) Self-Monitoring Report
Sherwood Forest Properties
3163 Buffalo Avenue
Niagara Falls, NY
SIU Permit # 55

Dear Mr. Lagamba:

TRC Environmental Corporation is submitting this fourth quarter Self-Monitoring Report on behalf of Sherwood Forest Properties, Ltd, 3163 Buffalo Avenue, Niagara Falls, NY in accordance with Significant Industrial User (SIU) Permit # 55.

If you have any questions, please do not hesitate to contact us.

Sincerely,

TRC Environmental Corporation

David McKenzie, PE
Project Manager

Attachment 1 Self-Monitoring Report
Attachment 2 Lab Report

NIAGARA FALLS WATER BOARD WASTEWATER FACILITIES ENFORCEMENT DIVISION

SELF-MONITORING REPORT
SIGNIFICANT INDUSTRIAL USERS

PERMIT NO. 55

SHERWOOD FOREST PROPERTIES, LTD

The 4th Quarterly Report

of four for 2025

Pursuant to federal pretreatment reporting requirements and the Niagara Falls Water Board Regulations Part 1960, Significant Industrial Users shall submit periodic self-monitoring and compliance reports. Such reports shall be submitted using this form, according to the following schedule:

Quarterly: 1st is due by February 28th, the 2nd is due by May 31st, the 3rd is due by August 31st, and the 4th is due by November 30th.

Each section of this report form shall be filled out for those parameters listed in Section "G" of the company's Wastewater Discharge Permit. The analysis results must be reported in both concentration and mass. In addition, the calculated annual average load (lbs/day) for each pollutant shall also be reported.

The samples shall be collected at the monitoring points identified in the user permit. Identification of those points in this report should be as listed on page two (2) of the User Permit.

SELF-MONITORING REPORT
Significant Industrial Users (SIUs)


PAGE 2

PART II of the report is the Compliance Monitoring section. The user is obligated to determine if the analysis results indicate compliance. All violations noted should be brought to the Niagara Falls Water Board – Wastewater Facilities attention immediately upon noting and should also be reported in this section. The analysis result should be compared against all applicable federal, state and local standards and limitations. If no violations are noted, then **"NO VIOLATIONS"** should appear on the report.

Pursuant to 40 CFR Part 403.12g of the Federal Standards, all violations noted must be followed up by a sample recollect/analysis and the results submitted to the Niagara Falls Water Board within thirty (30) days of first becoming aware of the violation.

Pursuant to 40 CFR Part 403.12g all Periodic Self-Monitoring Reports must be signed by a "responsible company official" certifying the following statement:

I, certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Signed: 

Title: Project Manager (on behalf of Sherwood Forest Properties)

Date: 11/21/2025

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: 10/28/2025 - 10/29/2025	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD: 0.0886						
BENZENE		<0.60		0.0000		0.000
CARBON TETRACHLORIDE		<0.51		0.0000		0.000
CHLORODIBROMOMETHANE						
MONOCHLOROBENZENE		<0.48		0.0000		0.000
DICHLOROBROMOMETHANE						
CHLOROFORM		57		0.0421		0.011
1,1 – DICHLOROETHYLENE		2.4		0.0018		0.000
1,2 – DICHLOROETHYLENE		7.3		0.0054		0.001
BROMOFORM						
ETHYLBENZENE						
1,1,2,2 – TETRACHLOROETHANE		6.3		0.0047		0.001
TETRACHLOROETHYLENE		<0.34		0.0000		0.000
TOLUENE		<0.45		0.0000		0.000
1,1,1 – TRICHLOROETHANE		<0.39		0.0000		0.000
1,1,2 – TRICHLOROETHANE		2.9		0.0021		0.001
TRICHLOROETHYLENE		89		0.0658		0.017
METHYLENE CHLORIDE		2.2		0.0016		0.000
MONOCHLOROTOLUENES						
MONOCHLOROBENZOTRIFLURIDE						
VINYL CHLORIDE		<0.75		0.0000		0.000
TETRAHYDRAFURAN						
XYLENE						

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: 10/28/2025 - 10/29/2025	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD: 0.0886						
DIMETHYLPHTHALATE						
BUTYL BENZYL PHTHALATE						
Di-N-BUTHY PHTHALATE						
Di-N-OCTYL PHTHALATE						
DIETHYL PHTHALATE						
NITROSODIPHENYLAMINE						
DICHLOROBENZENES		<0.54		0.0000		0.000
DICHLOROTOLUENE						
ACENAPHTHENE						
FLUORANTHENE						
CHRYSENE						
NAPHTHALENE						
BENZO (a) ANTHRACENE						
PYRENE						
TRICHLOROBENZENE		<0.82		0.0000		0.000
TRICHLOROTOLUENE						
HEXACHLOROBUTADIENE		<1.0		0.0000		0.000
TETRACHLOROBENZENE						
HEXACHLOROCYCLOPENTADIENE						
HEXCHLOROBENZENE						
DICHLOROBENZOTRIFLUORIDE						

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: 10/28/2025 - 10/29/2025	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD: 0.0886						
PHENANTHRENE						
MONOCHLOROPHENOL						
DICHLOROPHENOL						
MONOCHLOROCRESOL						
TRICHLOROPHENOL		<1.0		0.0000		0.000
PENTACHLOROPHENOL						
HEXACHLOROCYCLOHEXANES		0.0095		0.0000		0.000
-HEXACHLOROCYCLOHEXANE, alpha		0.0095		0.0000		0.000
-HEXACHLOROCYCLOHEXANE, beta		<0.024		0.0000		0.000
-HEXACHLOROCYCLOHEXANE, gamma		<0.0076		0.0000		0.000
-HEXACHLOROCYCLOHEXANE, delta		<0.0095		0.0000		0.000
PCB's						
ENDOSULFAN I +						
ENDOSULFAN II +						
ENDOSULFAN SULFATE						
MIREX						
DECHLORANE PLUS						
HEPTACHLOR +						
HEPTACHLOR EPOXIDE						

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: 10/28/2025 - 10/29/2025	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD: 0.0886						
1,2,4 – TRICHLOROBENZENE						
1,2 – DICHLOROETHANE		0.71		0.0005		0.000
1,1,1 – TRICHLOROETHANE		<0.39		0.0000		0.000
HEXACHLOROETHANE		<0.60		0.000		0.000
1,1 – DICHLOROETHANE						
1,1,2 – TRICHLOROETHANE		2.9		0.0021		0.001
CHLOROETHANE						
1,2 – DICHLOROBENZENE						
1,3 – DICHLOROBENZENE						
1,4 – DICHLOROBENZENE						
1,1 DICHLOROETHYLENE						
1,2 – TRANS-DICHLOROETHYLENE						
1,3 – DICHLOROPROPYLENE						
METHYL CHLORIDE						
NITROBENZENE						
2 – NITROPHENOL						
4 – NITROPHENOL						
4,6 DINITRO-O-CRESOL						
BIS [2 – ETHYHEXYL] PHTHALATE						
ANTHRACENE						
DIETHYL PHTHALATE						
FLUORENE						

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: 10/28/2025 - 10/29/2025	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD: 0.0886						
1,2 - DICHLOROPROPANE						
VINYL CHLORIDE						
ACENAPHTHENE						
BENZENE						
CARBON TETRACHLORIDE						
CHLOROBENZENE						
HEXACHLOROBENZENE						
CHLOROFORM						
ETHYLBENZENE						
FLUORANTHENE						
METHYLENE CHLORIDE						
HEXACHLOROBUTADIENE						
NAPHTHALENE DI – N – BUTHYL PHTHALATE						
DIMETHYL PHTHALATE						
PHENANTHRENE						
PYRENE						
TETRACHLOROETHYLENE						
TOLUENE						
TRICHLOROETHYLENE						
TOTAL CYANIDE		93		0.0688		0.033
TOTAL LEAD						
TOTAL ZINC						

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: ___/___/_____	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD						
TOTAL SUSPENDED SOLIDS						
SOLUABLE ORGANIC CARBON						
TOTAL PHOSPHOROUS						
TOTAL PHENOL						
OIL and GREASE						
CADMIUM						
CHROMIUM						
COPPER						
LEAD						
MERCURY						
NICKEL						
ZINC						
ARSENIC						
BERYLLIUM						
BARIUM						
TOTAL CYANIDE						
pH (STANDARD UNITS)						
RESIDUAL CHLORINE						
TOTAL SODIUM CHLORIDE						
TOTAL AMMONIA						
DIETHYLENE GLYCOL						

PART II

COMPLIANCE MONITORING

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

NO VIOLATIONS

VIOLATION PARAMETER	DATE	FLOW [MGD]	SAMPLE POINT LOCATION	ACTUAL* DISCHARGE	PERMIT LIMIT	TYPE** LIMIT VIOLATED

NOTE:

* - Actual discharge – list actual analytical results and appropriate units.

** - Type Limit Violated – List Type:

A.A. = Annual Average

D.M. = Daily Maximum

L.L. = Local Limits (Regulation 1960.5)

eurofins | Environment Testing

ANALYTICAL REPORT

PREPARED FOR

Attn: Mr. Nathan Sarapas
TRC Environmental Corporation
Wannalancit Mills
650 Suffolk Street
Lowell, Massachusetts 01854

Generated 11/5/2025 2:18:44 PM

JOB DESCRIPTION

Solvent Chemical Quarterly Discharge

JOB NUMBER

480-234010-1

Eurofins Buffalo
10 Hazelwood Drive
Amherst NY 14228-2298

See page two for job notes and contact information.

Job Notes

This report may not be reproduced except in full, and with written approval from the laboratory. The results relate only to the samples tested. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

The test results in this report relate only to the samples as received by the laboratory and will meet all requirements of the methodology, with any exceptions noted. This report shall not be reproduced except in full, without the express written approval of the laboratory. All questions should be directed to the Eurofins Environment Testing Northeast, LLC Project Manager.

Authorization



Generated
11/5/2025 2:18:44 PM

Authorized for release by
Kavya Boyina, Project Manager
kavya.boyina@et.eurofinsus.com
(716)504-9813

Table of Contents

Cover Page 1
Table of Contents 3
Definitions/Glossary 4
Case Narrative 5
Detection Summary 6
Client Sample Results 7
Surrogate Summary 9
QC Sample Results 10
QC Association Summary 18
Lab Chronicle 20
Certification Summary 21
Method Summary 22
Sample Summary 23
Chain of Custody 24
Receipt Checklists 25

Definitions/Glossary

Client: TRC Environmental Corporation
Job ID: 480-234010-1
Project/Site: Solvent Chemical Quarterly Discharge

Qualifiers

GC/MS VOA

Qualifier	Qualifier Description
*+	LCS and/or LCSD is outside acceptance limits, high biased.
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

GC Semi VOA

Qualifier	Qualifier Description
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

General Chemistry

Qualifier	Qualifier Description
F1	MS and/or MSD recovery exceeds control limits.
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
☼	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CFU	Colony Forming Unit
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MCL	EPA recommended "Maximum Contaminant Level"
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
MPN	Most Probable Number
MQL	Method Quantitation Limit
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
NEG	Negative / Absent
POS	Positive / Present
PQL	Practical Quantitation Limit
PRES	Presumptive
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)
TNTC	Too Numerous To Count

Job ID: 480-234010-1 Eurofins Buffalo

Job Narrative
480-234010-1

The analytical test results presented in this report meet all requirements of the associated regulatory program listed on the Accreditation/Certification Summary Page, unless otherwise noted. Data qualifiers and/or narrative comments are included to explain any exceptions, if applicable. Regulated compliance samples (e.g. SDWA, NPDES) must comply with associated agency requirements/permits.

- Matrix-specific batch QC (e.g., MS, MSD, SD) may not be reported when insufficient sample volume is available or when site-specific QC samples are not submitted. In such cases, a Laboratory Control Sample Duplicate (LCSD) may be analyzed to provide precision data for the batch.
- For samples analyzed using surrogate and/or isotope dilution analytes, any recoveries falling outside of established acceptance criteria are re-prepared and/or re-analyzed to confirm results, unless the deviation is due to sample dilution or otherwise explained in the case narrative.

Receipt
The samples were received on 10/29/2025 9:15 AM. Unless otherwise noted below, the samples arrived in good condition, and, where required, properly preserved and on ice. The temperature of the cooler at receipt time was 2.3°C.

GC/MS VOA
Method 624.1_PREC: The following Volatile sample was composited by the laboratory on 10/30/2025 as requested by the client: EFF-24 Hr Comp 102825-001 (480-234010-1).
Regulatory defined guidance for in-laboratory compositing of samples, is currently not available. Laboratory sample compositing was performed using established project specifications and/or laboratory standard operating procedures.

Method 624.1_PREC: The continuing calibration verification (CCV) associated with batch 480-761182 recovered above the upper control limit for Acrolein. The samples associated with this CCV were non-detects for the affected analytes; therefore, the data have been reported. The associated sample is:EFF-24 Hr Comp 102825-001 (480-234010-1).

Method 624.1_PREC: The laboratory control sample (LCS) and / or laboratory control sample duplicate (LCSD) for analytical batch 480-761182 recovered outside control limits for the following analytes: Acrolein. These analytes were biased high in the LCS and were not detected in the associated samples; therefore, the data have been reported. The associated sample is:EFF-24 Hr Comp 102825-001 (480-234010-1).

Method 624.1_PREC: The following Volatile sample was composited by the laboratory on 10/31/2025 as requested by the client: EFF-24 Hr Comp 102825-001 (480-234010-1).
Regulatory defined guidance for in-laboratory compositing of samples, is currently not available. Laboratory sample compositing was performed using established project specifications and/or laboratory standard operating procedures.

Method 624.1_PREC: The following sample was diluted to bring the concentration of target analytes within the calibration range: EFF-24 Hr Comp 102825-001 (480-234010-1). Elevated reporting limits (RLs) are provided.

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

GC/MS Semi VOA
Method 625.1_PREC: The continuing calibration verification (CCV) associated with batch 480-761531 recovered above the upper control limit for Hexachlorobutadiene. The samples associated with this CCV were non-detects for the affected analytes; therefore, the data have been reported. The associated sample is:EFF-24 Hr Comp 102825-001 (480-234010-1).

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

Pesticides
No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

General Chemistry
No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

Detection Summary

Client: TRC Environmental Corporation
Job ID: 480-234010-1
Project/Site: Solvent Chemical Quarterly Discharge

Client Sample ID: EFF-24 Hr Comp 102825-001 — Lab Sample ID: 480-234010-1

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	6.3		5.0	0.26	ug/L	1		624.1	Total/NA
1,1,2-Trichloroethane	2.9	J	5.0	0.48	ug/L	1		624.1	Total/NA
1,1-Dichloroethene	2.4	J	5.0	0.85	ug/L	1		624.1	Total/NA
1,2-Dichloroethane	0.71	J	5.0	0.60	ug/L	1		624.1	Total/NA
Chloroform	57		5.0	0.54	ug/L	1		624.1	Total/NA
Methylene Chloride	2.2	J	5.0	0.81	ug/L	1		624.1	Total/NA
trans-1,2-Dichloroethene	7.3		5.0	0.59	ug/L	1		624.1	Total/NA
Trichloroethene - DL	89		20	2.4	ug/L	4		624.1	Total/NA
alpha-BHC	0.0095	J	0.048	0.0073	ug/L	1		608.3	Total/NA
Cyanide, Total	0.093	F1	0.010	0.0041	mg/L	1		335.4	Total/NA

This Detection Summary does not include radiochemical test results.

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Quarterly Discharge

Job ID: 480-234010-1

Client Sample ID: EFF-24 Hr Comp 102825-001
Date Collected: 10/29/25 08:30
Date Received: 10/29/25 09:15

Lab Sample ID: 480-234010-1
Matrix: Water

Method: EPA 624.1 - Volatile Organic Compounds (GC/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1-Trichloroethane	ND		5.0	0.39	ug/L			10/30/25 21:06	1
1,1,2,2-Tetrachloroethane	**6.3**		5.0	0.26	ug/L			10/30/25 21:06	1
1,1,2-Trichloroethane	**2.9**	**J**	5.0	0.48	ug/L			10/30/25 21:06	1
1,1-Dichloroethane	ND		5.0	0.59	ug/L			10/30/25 21:06	1
1,1-Dichloroethene	**2.4**	**J**	5.0	0.85	ug/L			10/30/25 21:06	1
1,2-Dichlorobenzene	ND		5.0	0.44	ug/L			10/30/25 21:06	1
1,2-Dichloroethane	**0.71**	**J**	5.0	0.60	ug/L			10/30/25 21:06	1
1,2-Dichloropropane	ND		5.0	0.61	ug/L			10/30/25 21:06	1
1,3-Dichlorobenzene	ND		5.0	0.54	ug/L			10/30/25 21:06	1
1,4-Dichlorobenzene	ND		5.0	0.51	ug/L			10/30/25 21:06	1
2-Chloroethyl vinyl ether	ND		25	1.9	ug/L			10/30/25 21:06	1
Acrolein	ND	*+	100	17	ug/L			10/30/25 21:06	1
Acrylonitrile	ND		50	1.9	ug/L			10/30/25 21:06	1
Benzene	ND		5.0	0.60	ug/L			10/30/25 21:06	1
Bromoform	ND		5.0	0.47	ug/L			10/30/25 21:06	1
Bromomethane	ND		5.0	1.2	ug/L			10/30/25 21:06	1
Carbon tetrachloride	ND		5.0	0.51	ug/L			10/30/25 21:06	1
Chlorobenzene	ND		5.0	0.48	ug/L			10/30/25 21:06	1
Chlorodibromomethane	ND		5.0	0.41	ug/L			10/30/25 21:06	1
Chloroethane	ND		5.0	0.87	ug/L			10/30/25 21:06	1
Chloroform	**57**		5.0	0.54	ug/L			10/30/25 21:06	1
Chloromethane	ND		5.0	0.64	ug/L			10/30/25 21:06	1
cis-1,3-Dichloropropene	ND		5.0	0.33	ug/L			10/30/25 21:06	1
Bromodichloromethane	ND		5.0	0.54	ug/L			10/30/25 21:06	1
Ethylbenzene	ND		5.0	0.46	ug/L			10/30/25 21:06	1
Methylene Chloride	**2.2**	**J**	5.0	0.81	ug/L			10/30/25 21:06	1
Tetrachloroethene	ND		5.0	0.34	ug/L			10/30/25 21:06	1
Toluene	ND		5.0	0.45	ug/L			10/30/25 21:06	1
trans-1,2-Dichloroethene	**7.3**		5.0	0.59	ug/L			10/30/25 21:06	1
trans-1,3-Dichloropropene	ND		5.0	0.44	ug/L			10/30/25 21:06	1
Vinyl chloride	ND		5.0	0.75	ug/L			10/30/25 21:06	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*110*		*68 - 130*		*10/30/25 21:06*	*1*
4-Bromofluorobenzene (Surr)	*107*		*76 - 123*		*10/30/25 21:06*	*1*
Toluene-d8 (Surr)	*100*		*77 - 120*		*10/30/25 21:06*	*1*
Dibromofluoromethane (Surr)	*104*		*75 - 123*		*10/30/25 21:06*	*1*

Method: EPA 624.1 - Volatile Organic Compounds (GC/MS) - DL

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Trichloroethene	**89**		20	2.4	ug/L			10/31/25 15:05	4

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*107*		*68 - 130*		*10/31/25 15:05*	*4*
4-Bromofluorobenzene (Surr)	*103*		*76 - 123*		*10/31/25 15:05*	*4*
Toluene-d8 (Surr)	*100*		*77 - 120*		*10/31/25 15:05*	*4*
Dibromofluoromethane (Surr)	*101*		*75 - 123*		*10/31/25 15:05*	*4*

Client: TRC Environmental Corporation
Job ID: 480-234010-1
Project/Site: Solvent Chemical Quarterly Discharge

Client Sample ID: EFF-24 Hr Comp 102825-001
Lab Sample ID: 480-234010-1

Date Collected: 10/29/25 08:30
Matrix: Water
Date Received: 10/29/25 09:15

Method: EPA 625.1 - Semivolatile Organic Compounds (GC/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,2,4-Trichlorobenzene	ND		10	0.82	ug/L		10/31/25 09:06	11/03/25 23:28	1
1,2-Dichlorobenzene	ND		10	1.0	ug/L		10/31/25 09:06	11/03/25 23:28	1
1,3-Dichlorobenzene	ND		10	0.69	ug/L		10/31/25 09:06	11/03/25 23:28	1
1,4-Dichlorobenzene	ND		10	0.82	ug/L		10/31/25 09:06	11/03/25 23:28	1
2,4,6-Trichlorophenol	ND		5.0	1.0	ug/L		10/31/25 09:06	11/03/25 23:28	1
Hexachlorobutadiene	ND		5.0	1.0	ug/L		10/31/25 09:06	11/03/25 23:28	1
Hexachloroethane	ND		5.0	0.60	ug/L		10/31/25 09:06	11/03/25 23:28	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
2,4,6-Tribromophenol (Surr)	*85*		*52 - 151*	*10/31/25 09:06*	*11/03/25 23:28*	*1*
2-Fluorobiphenyl (Surr)	*78*		*44 - 120*	*10/31/25 09:06*	*11/03/25 23:28*	*1*
2-Fluorophenol (Surr)	*47*		*17 - 120*	*10/31/25 09:06*	*11/03/25 23:28*	*1*
Nitrobenzene-d5 (Surr)	*53*		*15 - 314*	*10/31/25 09:06*	*11/03/25 23:28*	*1*
Phenol-d5 (Surr)	*27*		*8 - 424*	*10/31/25 09:06*	*11/03/25 23:28*	*1*
p-Terphenyl-d14 (Surr)	*58*		*22 - 125*	*10/31/25 09:06*	*11/03/25 23:28*	*1*

Method: EPA 608.3 - Organochlorine Pesticides in Water

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
alpha-BHC	**0.0095**	**J**	0.048	0.0073	ug/L		10/30/25 09:21	10/31/25 10:55	1
beta-BHC	ND		0.048	0.024	ug/L		10/30/25 09:21	10/31/25 10:55	1
delta-BHC	ND		0.048	0.0095	ug/L		10/30/25 09:21	10/31/25 10:55	1
gamma-BHC (Lindane)	ND		0.048	0.0076	ug/L		10/30/25 09:21	10/31/25 10:55	1
BHC, Total	ND		0.048	0.048	ug/L		10/30/25 09:21	10/31/25 10:55	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
DCB Decachlorobiphenyl (Surr)	*73*		*10 - 120*	*10/30/25 09:21*	*10/31/25 10:55*	*1*
Tetrachloro-m-xylene (Surr)	*95*		*10 - 120*	*10/30/25 09:21*	*10/31/25 10:55*	*1*

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Cyanide, Total (EPA 335.4)	**0.093**	**F1**	0.010	0.0041	mg/L			10/30/25 21:12	1

Surrogate Summary

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Quarterly Discharge

Job ID: 480-234010-1

Method: 624.1 - Volatile Organic Compounds (GC/MS)

Matrix: Water — **Prep Type: Total/NA**

		Percent Surrogate Recovery (Acceptance Limits)			
		DCA	BFB	TOL	DBFM
Lab Sample ID	Client Sample ID	(68-130)	(76-123)	(77-120)	(75-123)
480-234010-1	EFF-24 Hr Comp 102825-001	110	107	100	104
480-234010-1 - DL	EFF-24 Hr Comp 102825-001	107	103	100	101
LCS 480-761182/6	Lab Control Sample	100	101	100	94
LCS 480-761354/6	Lab Control Sample	109	100	99	101
MB 480-761182/9	Method Blank	104	103	98	99
MB 480-761354/9	Method Blank	105	103	97	100

Surrogate Legend

DCA = 1,2-Dichloroethane-d4 (Surr)
BFB = 4-Bromofluorobenzene (Surr)
TOL = Toluene-d8 (Surr)
DBFM = Dibromofluoromethane (Surr)

Method: 625.1 - Semivolatile Organic Compounds (GC/MS)

Matrix: Water — **Prep Type: Total/NA**

		Percent Surrogate Recovery (Acceptance Limits)					
		TBP	FBP	2FP	NBZ	PHL	TPHd14
Lab Sample ID	Client Sample ID	(52-151)	(44-120)	(17-120)	(15-314)	(8-424)	(22-125)
480-234010-1	EFF-24 Hr Comp 102825-001	85	78	47	53	27	58
480-234010-1 MS	EFF-24 Hr Comp 102825-001	88	88	50	87	32	67
480-234010-1 MSD	EFF-24 Hr Comp 102825-001	93	87	44	86	32	65
LCS 480-761316/2-A	Lab Control Sample	92	84	51	85	33	82
MB 480-761316/1-A	Method Blank	83	75	40	56	25	86

Surrogate Legend

TBP = 2,4,6-Tribromophenol (Surr)
FBP = 2-Fluorobiphenyl (Surr)
2FP = 2-Fluorophenol (Surr)
NBZ = Nitrobenzene-d5 (Surr)
PHL = Phenol-d5 (Surr)
TPHd14 = p-Terphenyl-d14 (Surr)

Method: 608.3 - Organochlorine Pesticides in Water

Matrix: Water — **Prep Type: Total/NA**

		Percent Surrogate Recovery (Acceptance Limits)	
		DCBP1	TCX1
Lab Sample ID	Client Sample ID	(10-120)	(10-120)
480-234010-1	EFF-24 Hr Comp 102825-001	73	95
LCS 480-761188/2-A	Lab Control Sample	83	99
LCSD 480-761188/3-A	Lab Control Sample Dup	87	101
MB 480-761188/1-A	Method Blank	91	107

Surrogate Legend

DCBP = DCB Decachlorobiphenyl (Surr)
TCX = Tetrachloro-m-xylene (Surr)

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Quarterly Discharge

Job ID: 480-234010-1

Method: 624.1 - Volatile Organic Compounds (GC/MS)

Lab Sample ID: MB 480-761182/9
Matrix: Water
Analysis Batch: 761182

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1-Trichloroethane	ND		5.0	0.39	ug/L			10/30/25 13:32	1
1,1,2,2-Tetrachloroethane	ND		5.0	0.26	ug/L			10/30/25 13:32	1
1,1,2-Trichloroethane	ND		5.0	0.48	ug/L			10/30/25 13:32	1
1,1-Dichloroethane	ND		5.0	0.59	ug/L			10/30/25 13:32	1
1,1-Dichloroethene	ND		5.0	0.85	ug/L			10/30/25 13:32	1
1,2-Dichlorobenzene	ND		5.0	0.44	ug/L			10/30/25 13:32	1
1,2-Dichloroethane	ND		5.0	0.60	ug/L			10/30/25 13:32	1
1,2-Dichloropropane	ND		5.0	0.61	ug/L			10/30/25 13:32	1
1,3-Dichlorobenzene	ND		5.0	0.54	ug/L			10/30/25 13:32	1
1,4-Dichlorobenzene	ND		5.0	0.51	ug/L			10/30/25 13:32	1
2-Chloroethyl vinyl ether	ND		25	1.9	ug/L			10/30/25 13:32	1
Acrolein	ND		100	17	ug/L			10/30/25 13:32	1
Acrylonitrile	ND		50	1.9	ug/L			10/30/25 13:32	1
Benzene	ND		5.0	0.60	ug/L			10/30/25 13:32	1
Bromoform	ND		5.0	0.47	ug/L			10/30/25 13:32	1
Bromomethane	ND		5.0	1.2	ug/L			10/30/25 13:32	1
Carbon tetrachloride	ND		5.0	0.51	ug/L			10/30/25 13:32	1
Chlorobenzene	ND		5.0	0.48	ug/L			10/30/25 13:32	1
Chlorodibromomethane	ND		5.0	0.41	ug/L			10/30/25 13:32	1
Chloroethane	ND		5.0	0.87	ug/L			10/30/25 13:32	1
Chloroform	ND		5.0	0.54	ug/L			10/30/25 13:32	1
Chloromethane	ND		5.0	0.64	ug/L			10/30/25 13:32	1
cis-1,3-Dichloropropene	ND		5.0	0.33	ug/L			10/30/25 13:32	1
Bromodichloromethane	ND		5.0	0.54	ug/L			10/30/25 13:32	1
Ethylbenzene	ND		5.0	0.46	ug/L			10/30/25 13:32	1
Methylene Chloride	ND		5.0	0.81	ug/L			10/30/25 13:32	1
Tetrachloroethene	ND		5.0	0.34	ug/L			10/30/25 13:32	1
Toluene	ND		5.0	0.45	ug/L			10/30/25 13:32	1
trans-1,2-Dichloroethene	ND		5.0	0.59	ug/L			10/30/25 13:32	1
trans-1,3-Dichloropropene	ND		5.0	0.44	ug/L			10/30/25 13:32	1
Trichloroethene	ND		5.0	0.60	ug/L			10/30/25 13:32	1
Vinyl chloride	ND		5.0	0.75	ug/L			10/30/25 13:32	1

Surrogate	*MB %Recovery*	*MB Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*104*		*68 - 130*		*10/30/25 13:32*	*1*
4-Bromofluorobenzene (Surr)	*103*		*76 - 123*		*10/30/25 13:32*	*1*
Toluene-d8 (Surr)	*98*		*77 - 120*		*10/30/25 13:32*	*1*
Dibromofluoromethane (Surr)	*99*		*75 - 123*		*10/30/25 13:32*	*1*

Lab Sample ID: LCS 480-761182/6
Matrix: Water
Analysis Batch: 761182

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte			Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits		
1,1,1-Trichloroethane			20.0	18.9		ug/L		94	52 - 162		
1,1,2,2-Tetrachloroethane			20.0	17.9		ug/L		90	46 - 157		
1,1,2-Trichloroethane			20.0	19.0		ug/L		95	52 - 150		
1,1-Dichloroethane			20.0	18.8		ug/L		94	59 - 155		

Method: 624.1 - Volatile Organic Compounds (GC/MS) (Continued)

Lab Sample ID: LCS 480-761182/6
Matrix: Water
Analysis Batch: 761182

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,1-Dichloroethene	20.0	17.9		ug/L		90	1 - 234
1,2-Dichlorobenzene	20.0	18.7		ug/L		93	18 - 190
1,2-Dichloroethane	20.0	19.4		ug/L		97	49 - 155
1,2-Dichloropropane	20.0	19.2		ug/L		96	1 - 210
1,3-Dichlorobenzene	20.0	19.3		ug/L		97	59 - 156
1,4-Dichlorobenzene	20.0	18.2		ug/L		91	18 - 190
2-Chloroethyl vinyl ether	20.0	20.6	J	ug/L		103	1 - 305
Benzene	20.0	18.7		ug/L		93	37 - 151
Bromoform	20.0	20.3		ug/L		101	45 - 169
Bromomethane	20.0	18.1		ug/L		90	1 - 242
Carbon tetrachloride	20.0	19.5		ug/L		97	70 - 140
Chlorobenzene	20.0	19.8		ug/L		99	37 - 160
Chlorodibromomethane	20.0	20.1		ug/L		100	53 - 149
Chloroethane	20.0	20.1		ug/L		101	14 - 230
Chloroform	20.0	18.9		ug/L		94	51 - 138
Chloromethane	20.0	19.6		ug/L		98	1 - 273
cis-1,3-Dichloropropene	20.0	19.4		ug/L		97	1 - 227
Bromodichloromethane	20.0	19.0		ug/L		95	35 - 155
Ethylbenzene	20.0	19.7		ug/L		99	37 - 162
Methylene Chloride	20.0	17.4		ug/L		87	1 - 221
Tetrachloroethene	20.0	19.8		ug/L		99	64 - 148
Toluene	20.0	19.3		ug/L		97	47 - 150
trans-1,2-Dichloroethene	20.0	18.1		ug/L		91	54 - 156
trans-1,3-Dichloropropene	20.0	20.4		ug/L		102	17 - 183
Trichloroethene	20.0	19.6		ug/L		98	71 - 157
Vinyl chloride	20.0	18.2		ug/L		91	1 - 251

Surrogate	*LCS %Recovery*	*LCS Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*100*		*68 - 130*
4-Bromofluorobenzene (Surr)	*101*		*76 - 123*
Toluene-d8 (Surr)	*100*		*77 - 120*
Dibromofluoromethane (Surr)	*94*		*75 - 123*

Lab Sample ID: MB 480-761354/9
Matrix: Water
Analysis Batch: 761354

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1-Trichloroethane	ND		5.0	0.39	ug/L			10/31/25 14:15	1
1,1,2,2-Tetrachloroethane	ND		5.0	0.26	ug/L			10/31/25 14:15	1
1,1,2-Trichloroethane	ND		5.0	0.48	ug/L			10/31/25 14:15	1
1,1-Dichloroethane	ND		5.0	0.59	ug/L			10/31/25 14:15	1
1,1-Dichloroethene	ND		5.0	0.85	ug/L			10/31/25 14:15	1
1,2-Dichlorobenzene	ND		5.0	0.44	ug/L			10/31/25 14:15	1
1,2-Dichloroethane	ND		5.0	0.60	ug/L			10/31/25 14:15	1
1,2-Dichloropropane	ND		5.0	0.61	ug/L			10/31/25 14:15	1
1,3-Dichlorobenzene	ND		5.0	0.54	ug/L			10/31/25 14:15	1
1,4-Dichlorobenzene	ND		5.0	0.51	ug/L			10/31/25 14:15	1

Method: 624.1 - Volatile Organic Compounds (GC/MS) (Continued)

Lab Sample ID: MB 480-761354/9
Matrix: Water
Analysis Batch: 761354

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
2-Chloroethyl vinyl ether	ND		25	1.9	ug/L			10/31/25 14:15	1
Acrolein	ND		100	17	ug/L			10/31/25 14:15	1
Acrylonitrile	ND		50	1.9	ug/L			10/31/25 14:15	1
Benzene	ND		5.0	0.60	ug/L			10/31/25 14:15	1
Bromoform	ND		5.0	0.47	ug/L			10/31/25 14:15	1
Bromomethane	ND		5.0	1.2	ug/L			10/31/25 14:15	1
Carbon tetrachloride	ND		5.0	0.51	ug/L			10/31/25 14:15	1
Chlorobenzene	ND		5.0	0.48	ug/L			10/31/25 14:15	1
Chlorodibromomethane	ND		5.0	0.41	ug/L			10/31/25 14:15	1
Chloroethane	ND		5.0	0.87	ug/L			10/31/25 14:15	1
Chloroform	ND		5.0	0.54	ug/L			10/31/25 14:15	1
Chloromethane	ND		5.0	0.64	ug/L			10/31/25 14:15	1
cis-1,3-Dichloropropene	ND		5.0	0.33	ug/L			10/31/25 14:15	1
Bromodichloromethane	ND		5.0	0.54	ug/L			10/31/25 14:15	1
Ethylbenzene	ND		5.0	0.46	ug/L			10/31/25 14:15	1
Methylene Chloride	ND		5.0	0.81	ug/L			10/31/25 14:15	1
Tetrachloroethene	ND		5.0	0.34	ug/L			10/31/25 14:15	1
Toluene	ND		5.0	0.45	ug/L			10/31/25 14:15	1
trans-1,2-Dichloroethene	ND		5.0	0.59	ug/L			10/31/25 14:15	1
trans-1,3-Dichloropropene	ND		5.0	0.44	ug/L			10/31/25 14:15	1
Trichloroethene	ND		5.0	0.60	ug/L			10/31/25 14:15	1
Vinyl chloride	ND		5.0	0.75	ug/L			10/31/25 14:15	1

Surrogate	*MB %Recovery*	*MB Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*105*		*68 - 130*		*10/31/25 14:15*	*1*
4-Bromofluorobenzene (Surr)	*103*		*76 - 123*		*10/31/25 14:15*	*1*
Toluene-d8 (Surr)	*97*		*77 - 120*		*10/31/25 14:15*	*1*
Dibromofluoromethane (Surr)	*100*		*75 - 123*		*10/31/25 14:15*	*1*

Lab Sample ID: LCS 480-761354/6
Matrix: Water
Analysis Batch: 761354

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,1,1-Trichloroethane	20.0	19.9		ug/L		100	52 - 162
1,1,2,2-Tetrachloroethane	20.0	18.0		ug/L		90	46 - 157
1,1,2-Trichloroethane	20.0	19.3		ug/L		96	52 - 150
1,1-Dichloroethane	20.0	19.1		ug/L		95	59 - 155
1,1-Dichloroethene	20.0	17.1		ug/L		85	1 - 234
1,2-Dichlorobenzene	20.0	18.8		ug/L		94	18 - 190
1,2-Dichloroethane	20.0	20.6		ug/L		103	49 - 155
1,2-Dichloropropane	20.0	20.1		ug/L		100	1 - 210
1,3-Dichlorobenzene	20.0	18.6		ug/L		93	59 - 156
1,4-Dichlorobenzene	20.0	18.4		ug/L		92	18 - 190
2-Chloroethyl vinyl ether	20.0	20.5	J	ug/L		102	1 - 305
Benzene	20.0	19.1		ug/L		95	37 - 151
Bromoform	20.0	21.3		ug/L		106	45 - 169
Bromomethane	20.0	17.1		ug/L		86	1 - 242

Method: 624.1 - Volatile Organic Compounds (GC/MS) (Continued)

Lab Sample ID: LCS 480-761354/6
Matrix: Water
Analysis Batch: 761354

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Carbon tetrachloride	20.0	20.0		ug/L		100	70 - 140
Chlorobenzene	20.0	19.5		ug/L		97	37 - 160
Chlorodibromomethane	20.0	20.3		ug/L		102	53 - 149
Chloroethane	20.0	19.6		ug/L		98	14 - 230
Chloroform	20.0	19.0		ug/L		95	51 - 138
Chloromethane	20.0	20.7		ug/L		103	1 - 273
cis-1,3-Dichloropropene	20.0	21.3		ug/L		106	1 - 227
Bromodichloromethane	20.0	19.9		ug/L		100	35 - 155
Ethylbenzene	20.0	19.0		ug/L		95	37 - 162
Methylene Chloride	20.0	18.5		ug/L		92	1 - 221
Tetrachloroethene	20.0	20.0		ug/L		100	64 - 148
Toluene	20.0	19.1		ug/L		95	47 - 150
trans-1,2-Dichloroethene	20.0	19.7		ug/L		98	54 - 156
trans-1,3-Dichloropropene	20.0	20.2		ug/L		101	17 - 183
Trichloroethene	20.0	19.1		ug/L		96	71 - 157
Vinyl chloride	20.0	18.1		ug/L		91	1 - 251

Surrogate	*LCS %Recovery*	*LCS Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*109*		*68 - 130*
4-Bromofluorobenzene (Surr)	*100*		*76 - 123*
Toluene-d8 (Surr)	*99*		*77 - 120*
Dibromofluoromethane (Surr)	*101*		*75 - 123*

Method: 625.1 - Semivolatile Organic Compounds (GC/MS)

Lab Sample ID: MB 480-761316/1-A
Matrix: Water
Analysis Batch: 761531

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 761316

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,2,4-Trichlorobenzene	ND		10	0.82	ug/L		10/31/25 09:06	11/03/25 21:44	1
1,2-Dichlorobenzene	ND		10	1.0	ug/L		10/31/25 09:06	11/03/25 21:44	1
1,3-Dichlorobenzene	ND		10	0.69	ug/L		10/31/25 09:06	11/03/25 21:44	1
1,4-Dichlorobenzene	ND		10	0.82	ug/L		10/31/25 09:06	11/03/25 21:44	1
2,4,6-Trichlorophenol	ND		5.0	1.0	ug/L		10/31/25 09:06	11/03/25 21:44	1
Hexachlorobutadiene	ND		5.0	1.0	ug/L		10/31/25 09:06	11/03/25 21:44	1
Hexachloroethane	ND		5.0	0.60	ug/L		10/31/25 09:06	11/03/25 21:44	1

Surrogate	*MB %Recovery*	*MB Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
2,4,6-Tribromophenol (Surr)	*83*		*52 - 151*	*10/31/25 09:06*	*11/03/25 21:44*	*1*
2-Fluorobiphenyl (Surr)	*75*		*44 - 120*	*10/31/25 09:06*	*11/03/25 21:44*	*1*
2-Fluorophenol (Surr)	*40*		*17 - 120*	*10/31/25 09:06*	*11/03/25 21:44*	*1*
Nitrobenzene-d5 (Surr)	*56*		*15 - 314*	*10/31/25 09:06*	*11/03/25 21:44*	*1*
Phenol-d5 (Surr)	*25*		*8 - 424*	*10/31/25 09:06*	*11/03/25 21:44*	*1*
p-Terphenyl-d14 (Surr)	*86*		*22 - 125*	*10/31/25 09:06*	*11/03/25 21:44*	*1*

Method: 625.1 - Semivolatile Organic Compounds (GC/MS) (Continued)

Lab Sample ID: LCS 480-761316/2-A
Matrix: Water
Analysis Batch: 761531

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 761316

Analyte			Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits		
1,2,4-Trichlorobenzene			32.0	24.7		ug/L		77	44 - 142		
1,2-Dichlorobenzene			32.0	21.0		ug/L		66	32 - 129		
1,3-Dichlorobenzene			32.0	22.6		ug/L		71	1 - 172		
1,4-Dichlorobenzene			32.0	21.0		ug/L		66	20 - 124		
2,4,6-Trichlorophenol			32.0	26.1		ug/L		82	37 - 144		
Hexachlorobutadiene			32.0	26.7		ug/L		83	24 - 120		
Hexachloroethane			32.0	21.8		ug/L		68	40 - 120		

Surrogate	*LCS %Recovery*	*LCS Qualifier*	*Limits*
2,4,6-Tribromophenol (Surr)	*92*		*52 - 151*
2-Fluorobiphenyl (Surr)	*84*		*44 - 120*
2-Fluorophenol (Surr)	*51*		*17 - 120*
Nitrobenzene-d5 (Surr)	*85*		*15 - 314*
Phenol-d5 (Surr)	*33*		*8 - 424*
p-Terphenyl-d14 (Surr)	*82*		*22 - 125*

Lab Sample ID: 480-234010-1 MS
Matrix: Water
Analysis Batch: 761531

Client Sample ID: EFF-24 Hr Comp 102825-001
Prep Type: Total/NA
Prep Batch: 761316

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits		
1,2,4-Trichlorobenzene	ND		32.0	26.0		ug/L		81	44 - 142		
1,2-Dichlorobenzene	ND		32.0	23.4		ug/L		73	32 - 129		
1,3-Dichlorobenzene	ND		32.0	21.9		ug/L		68	1 - 172		
1,4-Dichlorobenzene	ND		32.0	23.2		ug/L		72	20 - 124		
2,4,6-Trichlorophenol	ND		32.0	29.2		ug/L		91	37 - 144		
Hexachlorobutadiene	ND		32.0	30.1		ug/L		94	24 - 120		
Hexachloroethane	ND		32.0	22.8		ug/L		71	40 - 120		

Surrogate	*MS %Recovery*	*MS Qualifier*	*Limits*
2,4,6-Tribromophenol (Surr)	*88*		*52 - 151*
2-Fluorobiphenyl (Surr)	*88*		*44 - 120*
2-Fluorophenol (Surr)	*50*		*17 - 120*
Nitrobenzene-d5 (Surr)	*87*		*15 - 314*
Phenol-d5 (Surr)	*32*		*8 - 424*
p-Terphenyl-d14 (Surr)	*67*		*22 - 125*

Lab Sample ID: 480-234010-1 MSD
Matrix: Water
Analysis Batch: 761531

Client Sample ID: EFF-24 Hr Comp 102825-001
Prep Type: Total/NA
Prep Batch: 761316

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
1,2,4-Trichlorobenzene	ND		32.0	26.6		ug/L		83	44 - 142	2	50
1,2-Dichlorobenzene	ND		32.0	23.2		ug/L		73	32 - 129	1	38
1,3-Dichlorobenzene	ND		32.0	23.3		ug/L		73	1 - 172	6	37
1,4-Dichlorobenzene	ND		32.0	21.7		ug/L		68	20 - 124	7	40
2,4,6-Trichlorophenol	ND		32.0	27.7		ug/L		87	37 - 144	5	58
Hexachlorobutadiene	ND		32.0	27.6		ug/L		86	24 - 120	9	62

Method: 625.1 - Semivolatile Organic Compounds (GC/MS) (Continued)

Lab Sample ID: 480-234010-1 MSD
Matrix: Water
Analysis Batch: 761531

Client Sample ID: EFF-24 Hr Comp 102825-001
Prep Type: Total/NA
Prep Batch: 761316

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
Hexachloroethane	ND		32.0	22.0		ug/L		69	40 - 120	4	52

Surrogate	*MSD %Recovery*	*MSD Qualifier*	*Limits*
2,4,6-Tribromophenol (Surr)	*93*		*52 - 151*
2-Fluorobiphenyl (Surr)	*87*		*44 - 120*
2-Fluorophenol (Surr)	*44*		*17 - 120*
Nitrobenzene-d5 (Surr)	*86*		*15 - 314*
Phenol-d5 (Surr)	*32*		*8 - 424*
p-Terphenyl-d14 (Surr)	*65*		*22 - 125*

Method: 608.3 - Organochlorine Pesticides in Water

Lab Sample ID: MB 480-761188/1-A
Matrix: Water
Analysis Batch: 761301

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 761188

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
alpha-BHC	ND		0.050	0.0077	ug/L		10/30/25 09:21	10/31/25 11:21	1
beta-BHC	ND		0.050	0.025	ug/L		10/30/25 09:21	10/31/25 11:21	1
delta-BHC	ND		0.050	0.010	ug/L		10/30/25 09:21	10/31/25 11:21	1
gamma-BHC (Lindane)	ND		0.050	0.0080	ug/L		10/30/25 09:21	10/31/25 11:21	1
BHC, Total	ND		0.050	0.050	ug/L		10/30/25 09:21	10/31/25 11:21	1

Surrogate	*MB %Recovery*	*MB Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
DCB Decachlorobiphenyl (Surr)	*91*		*10 - 120*	*10/30/25 09:21*	*10/31/25 11:21*	*1*
Tetrachloro-m-xylene (Surr)	*107*		*10 - 120*	*10/30/25 09:21*	*10/31/25 11:21*	*1*

Lab Sample ID: LCS 480-761188/2-A
Matrix: Water
Analysis Batch: 761301

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 761188

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
alpha-BHC	0.500	0.485		ug/L		97	52 - 125
beta-BHC	0.500	0.523		ug/L		105	52 - 120
delta-BHC	0.500	0.516		ug/L		103	51 - 120
gamma-BHC (Lindane)	0.500	0.494		ug/L		99	56 - 120

Surrogate	*LCS %Recovery*	*LCS Qualifier*	*Limits*
DCB Decachlorobiphenyl (Surr)	*83*		*10 - 120*
Tetrachloro-m-xylene (Surr)	*99*		*10 - 120*

Lab Sample ID: LCSD 480-761188/3-A
Matrix: Water
Analysis Batch: 761301

Client Sample ID: Lab Control Sample Dup
Prep Type: Total/NA
Prep Batch: 761188

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
alpha-BHC	0.500	0.493		ug/L		99	52 - 125	2	50
beta-BHC	0.500	0.534		ug/L		107	52 - 120	2	50

Method: 608.3 - Organochlorine Pesticides in Water (Continued)

Lab Sample ID: LCSD 480-761188/3-A
Matrix: Water
Analysis Batch: 761301

Client Sample ID: Lab Control Sample Dup
Prep Type: Total/NA
Prep Batch: 761188

Analyte			Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
delta-BHC			0.500	0.528		ug/L		106	51 - 120	2	50
gamma-BHC (Lindane)			0.500	0.503		ug/L		101	56 - 120	2	50

Surrogate	*LCSD %Recovery*	*LCSD Qualifier*	*Limits*
DCB Decachlorobiphenyl (Surr)	*87*		*10 - 120*
Tetrachloro-m-xylene (Surr)	*101*		*10 - 120*

Method: 335.4 - Cyanide, Total

Lab Sample ID: MB 480-761350/103
Matrix: Water
Analysis Batch: 761350

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Cyanide, Total	0.00560	J	0.010	0.0041	mg/L			10/30/25 19:53	1

Lab Sample ID: MB 480-761350/131
Matrix: Water
Analysis Batch: 761350

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Cyanide, Total	ND		0.010	0.0041	mg/L			10/30/25 21:07	1

Lab Sample ID: MB 480-761350/21
Matrix: Water
Analysis Batch: 761350

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Cyanide, Total	0.00410	J	0.010	0.0041	mg/L			10/30/25 16:14	1

Lab Sample ID: HLCS 480-761350/22
Matrix: Water
Analysis Batch: 761350

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte			Spike Added	HLCS Result	HLCS Qualifier	Unit	D	%Rec	%Rec Limits		
Cyanide, Total			0.400	0.418		mg/L		105	90 - 110		

Lab Sample ID: LCS 480-761350/104
Matrix: Water
Analysis Batch: 761350

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte			Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits		
Cyanide, Total			0.250	0.255		mg/L		102	90 - 110		

Lab Sample ID: LCS 480-761350/132
Matrix: Water
Analysis Batch: 761350

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte			Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits		
Cyanide, Total			0.250	0.271		mg/L		108	90 - 110		

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Quarterly Discharge

Job ID: 480-234010-1

Method: 335.4 - Cyanide, Total

Lab Sample ID: LLCS 480-761350/24
Matrix: Water
Analysis Batch: 761350

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte			Spike Added	LLCS Result	LLCS Qualifier	Unit	D	%Rec	%Rec Limits		
Cyanide, Total			0.0100	0.0133		mg/L		133	50 - 150		

Lab Sample ID: 480-234010-1 MS
Matrix: Water
Analysis Batch: 761350

Client Sample ID: EFF-24 Hr Comp 102825-001
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits		
Cyanide, Total	0.093	F1	0.100	0.172	F1	mg/L		79	90 - 110		

GC/MS VOA

Analysis Batch: 761182

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-234010-1	EFF-24 Hr Comp 102825-001	Total/NA	Water	624.1	
MB 480-761182/9	Method Blank	Total/NA	Water	624.1	
LCS 480-761182/6	Lab Control Sample	Total/NA	Water	624.1	

Analysis Batch: 761354

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-234010-1 - DL	EFF-24 Hr Comp 102825-001	Total/NA	Water	624.1	
MB 480-761354/9	Method Blank	Total/NA	Water	624.1	
LCS 480-761354/6	Lab Control Sample	Total/NA	Water	624.1	

GC/MS Semi VOA

Prep Batch: 761316

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-234010-1	EFF-24 Hr Comp 102825-001	Total/NA	Water	625	
MB 480-761316/1-A	Method Blank	Total/NA	Water	625	
LCS 480-761316/2-A	Lab Control Sample	Total/NA	Water	625	
480-234010-1 MS	EFF-24 Hr Comp 102825-001	Total/NA	Water	625	
480-234010-1 MSD	EFF-24 Hr Comp 102825-001	Total/NA	Water	625	

Analysis Batch: 761531

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-234010-1	EFF-24 Hr Comp 102825-001	Total/NA	Water	625.1	761316
MB 480-761316/1-A	Method Blank	Total/NA	Water	625.1	761316
LCS 480-761316/2-A	Lab Control Sample	Total/NA	Water	625.1	761316
480-234010-1 MS	EFF-24 Hr Comp 102825-001	Total/NA	Water	625.1	761316
480-234010-1 MSD	EFF-24 Hr Comp 102825-001	Total/NA	Water	625.1	761316

GC Semi VOA

Prep Batch: 761188

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-234010-1	EFF-24 Hr Comp 102825-001	Total/NA	Water	3510C	
MB 480-761188/1-A	Method Blank	Total/NA	Water	3510C	
LCS 480-761188/2-A	Lab Control Sample	Total/NA	Water	3510C	
LCSD 480-761188/3-A	Lab Control Sample Dup	Total/NA	Water	3510C	

Analysis Batch: 761301

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-234010-1	EFF-24 Hr Comp 102825-001	Total/NA	Water	608.3	761188
MB 480-761188/1-A	Method Blank	Total/NA	Water	608.3	761188
LCS 480-761188/2-A	Lab Control Sample	Total/NA	Water	608.3	761188
LCSD 480-761188/3-A	Lab Control Sample Dup	Total/NA	Water	608.3	761188

General Chemistry

Analysis Batch: 761350

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-234010-1	EFF-24 Hr Comp 102825-001	Total/NA	Water	335.4	
MB 480-761350/103	Method Blank	Total/NA	Water	335.4	
MB 480-761350/131	Method Blank	Total/NA	Water	335.4	
MB 480-761350/21	Method Blank	Total/NA	Water	335.4	

General Chemistry (Continued)

Analysis Batch: 761350 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
HLCS 480-761350/22	Lab Control Sample	Total/NA	Water	335.4	
LCS 480-761350/104	Lab Control Sample	Total/NA	Water	335.4	
LCS 480-761350/132	Lab Control Sample	Total/NA	Water	335.4	
LLCS 480-761350/24	Lab Control Sample	Total/NA	Water	335.4	
480-234010-1 MS	EFF-24 Hr Comp 102825-001	Total/NA	Water	335.4	

Lab Chronicle

Client: TRC Environmental Corporation
Job ID: 480-234010-1
Project/Site: Solvent Chemical Quarterly Discharge

Client Sample ID: EFF-24 Hr Comp 102825-001
Lab Sample ID: 480-234010-1

Date Collected: 10/29/25 08:30
Matrix: Water
Date Received: 10/29/25 09:15

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	624.1		1	761182	AXK	EET BUF	10/30/25 21:06
Total/NA	Analysis	624.1	DL	4	761354	AXK	EET BUF	10/31/25 15:05
Total/NA	Prep	625			761316	JMP	EET BUF	10/31/25 09:06
Total/NA	Analysis	625.1		1	761531	JMM	EET BUF	11/03/25 23:28
Total/NA	Prep	3510C			761188	JMP	EET BUF	10/30/25 09:21
Total/NA	Analysis	608.3		1	761301	JLS	EET BUF	10/31/25 10:55
Total/NA	Analysis	335.4		1	761350	GW	EET BUF	10/30/25 21:12

Laboratory References:
EET BUF = Eurofins Buffalo, 10 Hazelwood Drive, Amherst, NY 14228-2298, TEL (716)691-2600

Accreditation/Certification Summary

Client: TRC Environmental Corporation
Job ID: 480-234010-1
Project/Site: Solvent Chemical Quarterly Discharge

Laboratory: Eurofins Buffalo

Unless otherwise noted, all analytes for this laboratory were covered under each accreditation/certification below.

Authority	Program	Identification Number	Expiration Date
New York	NELAP	10026	03-31-26

The following analytes are included in this report, but the laboratory is not certified by the governing authority. This list may include analytes for which the agency does not offer certification.

Analysis Method	Prep Method	Matrix	Analyte
608.3	3510C	Water	BHC, Total
625.1	625	Water	1,2-Dichlorobenzene
625.1	625	Water	1,3-Dichlorobenzene
625.1	625	Water	1,4-Dichlorobenzene

Method Summary

Client: TRC Environmental Corporation
Job ID: 480-234010-1
Project/Site: Solvent Chemical Quarterly Discharge

Method	Method Description	Protocol	Laboratory
624.1	Volatile Organic Compounds (GC/MS)	EPA	EET BUF
625.1	Semivolatile Organic Compounds (GC/MS)	EPA	EET BUF
608.3	Organochlorine Pesticides in Water	EPA	EET BUF
335.4	Cyanide, Total	EPA	EET BUF
3510C	Liquid-Liquid Extraction (Separatory Funnel)	SW846	EET BUF
625	Liquid-Liquid Extraction	EPA	EET BUF

Protocol References:

EPA = US Environmental Protection Agency

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

Laboratory References:

EET BUF = Eurofins Buffalo, 10 Hazelwood Drive, Amherst, NY 14228-2298, TEL (716)691-2600

Sample Summary

Client: TRC Environmental Corporation
Job ID: 480-234010-1
Project/Site: Solvent Chemical Quarterly Discharge

Lab Sample ID	Client Sample ID	Matrix	Collected	Received	Sample Origin
480-234010-1	EFF-24 Hr Comp 102825-001	Water	10/29/25 08:30	10/29/25 09:15	New York

10 Hazelwood Drive
Amherst, NY 14228-2298
Phone: 716-691-2600 Fax: 716-691-7991

Chain of Custody Record

eurofins | Environment Testing

Client Information	Sampler: Cameron Carney	Lab PM: Boyina, Kavya	Carrier Tracking No(s):	COC No: 480-208860-37907.1
Client Contact: ~~Mr. Mike Plumb~~ David McKenzie	Phone: 716-955-0256	E-Mail: kavya.boyina@et.eurofinsus.com	State of Origin: NY	Page: Page 1 of 1
Company: TRC Environmental Corporation	PWSID:	Analysis Requested		Job #:
Address: Wannalancit Mills 650 Suffolk Street	Due Date Requested:			Preservation Codes: N - None B - NaOH
City: Lowell	TAT Requested (days):			
State, Zip: MA, 01854	Compliance Project: Δ Yes Δ No			
Phone: 978-656-3632(Tel)	PO #: 233658			
Email: DMckenzie@TRCcompanies.com ~~mplumb@trccompanies.com~~	WO #:			Other:
Project Name: Solvent Chemical S/A Discharge	Project #: 48002462			
Site:	SSOW#:			

Sample Identification	Sample Date	Sample Time	Sample Type (C=Comp, G=grab)	Matrix (W=water, S=solid, O=waste/oil, BT=Tissue, A=Air, DW=Drinking Water)	Field Filtered Sample (Yes or No)	Perform MS/MSD (Yes or No)	608.3_Pest_PREC - Pesticides	625.1_PREC - Priority Pollutant SVOCs	335.4 - Cyanide	624.1_PREC - Priority Pollutant VOCs	Total Number of containers	Special Instructions/Note:
			Preservation Code:				N	N	B	N		
Eff-24 Hr Comp 102825-001	10.29.25	0830	C	Water			2	2	1		5	All Samples shipped on Ice
Eff - 102825-002	10.28.25	0540	G	W						1	1	
Eff - 102825-003	10.28.25	0930	G	W						1	1	
Eff - 102825-004	10.28.25	1510	G	W						1	1	
Eff - 102825-005	10.28.25	1815	G	W						1	1	

480-234010 Chain of Custody

Possible Hazard Identification
☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☒ Unknown ☐ Radiological

Sample Disposal (A fee may be asse... onger than 1 month)
☐ Return To Client ☒ Disposal By Lab For _____ Months

Deliverable Requested: I, II, III, IV, Other (specify)

Special Instructions/QC Requirements:

Empty Kit Relinquished by:	Date:	Time:	Method of Shipment:

	Relinquished by	Date/Time	Company	Received by	Date/Time	Company
	Cameron Carney	10/29/2025 0915	Lantech	[illegible]	10-29-25 915	
	Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company
	Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company

Custody Seals Intact: Δ Yes Δ No	Custody Seal No.:	Cooler Temperature(s) °C and Other Remarks: 2.3 IR#3C Ice

Ver: 10/10/2024

Login Sample Receipt Checklist

Client: TRC Environmental Corporation

Job Number: 480-234010-1

Login Number: 234010
List Number: 1
Creator: Stapleton, Kaitlyn

List Source: Eurofins Buffalo

Question	Answer	Comment
Radioactivity either was not measured or, if measured, is at or below background	True	
The cooler's custody seal, if present, is intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	2.3 IR#SC ice
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the sample IDs on the containers and the COC.	True	
Samples are received within Holding Time (Excluding tests with immediate HTs)..	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
VOA sample vials do not have headspace or bubble is <6mm (1/4") in diameter.	True	
If necessary, staff have been informed of any short hold time or quick TAT needs	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Sampling Company provided.	True	TRC Environmental
Samples received within 48 hours of sampling.	True	
Samples requiring field filtration have been filtered in the field.	True	
Chlorine Residual checked.	N/A	

650 Suffolk Street
Lowell, MA 01854

t 978-570-5600

February 2, 2026

Matthew Lagamba
Niagara Falls Water Board
Wastewater Treatment Plant
5815 Buffalo Ave, Niagara Falls, NY 14304
(716) 283-9770

Re: 2026 Quarterly (First Quarter) Self-Monitoring Report
Sherwood Forest Properties
3163 Buffalo Avenue
Niagara Falls, NY
SIU Permit # 55

Dear Mr. Lagamba:

TRC Environmental Corporation is submitting this first quarter Self-Monitoring Report on behalf of Sherwood Forest Properties, Ltd, 3163 Buffalo Avenue, Niagara Falls, NY in accordance with Significant Industrial User (SIU) Permit # 55.

If you have any questions, please do not hesitate to contact us.

Sincerely,

TRC Environmental Corporation

David McKenzie, PE
Project Manager

Attachment 1 Self-Monitoring Report
Attachment 2 Lab Report

NIAGARA FALLS WATER BOARD WASTEWATER FACILITIES ENFORCEMENT DIVISION

SELF-MONITORING REPORT
SIGNIFICANT INDUSTRIAL USERS

PERMIT NO. 55

SHERWOOD FOREST PROPERTIES, LTD

The 1st Quarterly Report

of four for 2026

Pursuant to federal pretreatment reporting requirements and the Niagara Falls Water Board Regulations Part 1960, Significant Industrial Users shall submit periodic self-monitoring and compliance reports. Such reports shall be submitted using this form, according to the following schedule:

Quarterly: 1st is due by February 28th, the 2nd is due by May 31st, the 3rd is due by August 31st, and the 4th is due by November 30th.

Each section of this report form shall be filled out for those parameters listed in Section "G" of the company's Wastewater Discharge Permit. The analysis results must be reported in both concentration and mass. In addition, the calculated annual average load (lbs/day) for each pollutant shall also be reported.

The samples shall be collected at the monitoring points identified in the user permit. Identification of those points in this report should be as listed on page two (2) of the User Permit.

SELF-MONITORING REPORT
Significant Industrial Users (SIUs)


PAGE 2

PART II of the report is the Compliance Monitoring section. The user is obligated to determine if the analysis results indicate compliance. All violations noted should be brought to the Niagara Falls Water Board – Wastewater Facilities attention immediately upon noting and should also be reported in this section. The analysis result should be compared against all applicable federal, state and local standards and limitations. If no violations are noted, then **"NO VIOLATIONS"** should appear on the report.

Pursuant to 40 CFR Part 403.12g of the Federal Standards, all violations noted must be followed up by a sample recollect/analysis and the results submitted to the Niagara Falls Water Board within thirty (30) days of first becoming aware of the violation.

Pursuant to 40 CFR Part 403.12g all Periodic Self-Monitoring Reports must be signed by a "responsible company official" certifying the following statement:

I, certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Signed: 

Title: Project Manager (on behalf of Sherwood Forest Properties)

Date: 2/2/2026

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: 1/8/2026 - 1/09/2026	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD: 0.0585						
BENZENE		<0.60		0.0000		0.000
CARBON TETRACHLORIDE		<0.51		0.0000		0.000
CHLORODIBROMOMETHANE						
MONOCHLOROBENZENE		<0.48		0.0000		0.000
DICHLOROBROMOMETHANE						
CHLOROFORM		<0.54		0.0000		0.011
1,1 – DICHLOROETHYLENE		<0.85		0.0000		0.000
1,2 – DICHLOROETHYLENE		<0.59		0.0000		0.001
BROMOFORM						
ETHYLBENZENE						
1,1,2,2 – TETRACHLOROETHANE		<0.26		0.0000		0.001
TETRACHLOROETHYLENE		<0.34		0.0000		0.000
TOLUENE		<0.45		0.0000		0.000
1,1,1 – TRICHLOROETHANE		<0.39		0.0000		0.000
1,1,2 – TRICHLOROETHANE		<0.48		0.0000		0.001
TRICHLOROETHYLENE		1.7		0.0008		0.017
METHYLENE CHLORIDE		<0.81		0.0000		0.000
MONOCHLOROTOLUENES						
MONOCHLOROBENZOTRIFLURIDE						
VINYL CHLORIDE		<0.75		0.0000		0.000
TETRAHYDRAFURAN						
XYLENE						

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: 1/8/2026 - 1/09/2026	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD: 0.0585						
DIMETHYLPHTHALATE						
BUTYL BENZYL PHTHALATE						
Di-N-BUTHY PHTHALATE						
Di-N-OCTYL PHTHALATE						
DIETHYL PHTHALATE						
NITROSODIPHENYLAMINE						
DICHLOROBENZENES		<0.54		0.0000		0.000
DICHLOROTOLUENE						
ACENAPHTHENE						
FLUORANTHENE						
CHRYSENE						
NAPHTHALENE						
BENZO (a) ANTHRACENE						
PYRENE						
TRICHLOROBENZENE		<0.82		0.0000		0.000
TRICHLOROTOLUENE						
HEXACHLOROBUTADIENE		<1.0		0.0000		0.000
TETRACHLOROBENZENE						
HEXACHLOROCYCLOPENTADIENE						
HEXCHLOROBENZENE						
DICHLOROBENZOTRIFLUORIDE						

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: 1/8/2026 - 1/09/2026	RESULTS ug/ℓ / ug/ℓ		RESULTS lbs/day / lbs/day		ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD: 0.0585						
PHENANTHRENE						
MONOCHLOROPHENOL						
DICHLOROPHENOL						
MONOCHLOROCRESOL						
TRICHLOROPHENOL		<1.0		0.0000		0.000
PENTACHLOROPHENOL						
HEXACHLOROCYCLOHEXANES		<0.0048		0.0000		0.000
-HEXACHLOROCYCLOHEXANE, alpha		<0.0073		0.0000		0.000
-HEXACHLOROCYCLOHEXANE, beta		<0.024		0.0000		0.000
-HEXACHLOROCYCLOHEXANE, gamma		<0.0076		0.0000		0.000
-HEXACHLOROCYCLOHEXANE, delta		<0.0095		0.0000		0.000
PCB's						
ENDOSULFAN I + ENDOSULFAN II + ENDOSULFAN SULFATE						
MIREX						
DECHLORANE PLUS						
HEPTACHLOR + HEPTACHLOR EPOXIDE						

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: 1/8/2026 - 1/09/2026	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD: 0.0585						
1,2,4 – TRICHLOROBENZENE						
1,2 – DICHLOROETHANE		<0.60		0.0000		0.000
1,1,1 – TRICHLOROETHANE		<0.39		0.0000		0.000
HEXACHLOROETHANE		<0.60		0.000		0.000
1,1 – DICHLOROETHANE						
1,1,2 – TRICHLOROETHANE		<0.48		0.0000		0.001
CHLOROETHANE						
1,2 – DICHLOROBENZENE						
1,3 – DICHLOROBENZENE						
1,4 – DICHLOROBENZENE						
1,1 DICHLOROETHYLENE						
1,2 – TRANS-DICHLOROETHYLENE						
1,3 – DICHLOROPROPYLENE						
METHYL CHLORIDE						
NITROBENZENE						
2 – NITROPHENOL						
4 – NITROPHENOL						
4,6 DINITRO-O-CRESOL						
BIS [2 – ETHYHEXYL] PHTHALATE						
ANTHRACENE						
DIETHYL PHTHALATE						
FLUORENE						

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: 1/8/2026 - 1/09/2026	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD: 0.0585						
1,2 - DICHLOROPROPANE						
VINYL CHLORIDE						
ACENAPHTHENE						
BENZENE						
CARBON TETRACHLORIDE						
CHLOROBENZENE						
HEXACHLOROBENZENE						
CHLOROFORM						
ETHYLBENZENE						
FLUORANTHENE						
METHYLENE CHLORIDE						
HEXACHLOROBUTADIENE						
NAPHTHALENE DI – N – BUTHYL PHTHALATE						
DIMETHYL PHTHALATE						
PHENANTHRENE						
PYRENE						
TETRACHLOROETHYLENE						
TOLUENE						
TRICHLOROETHYLENE						
TOTAL CYANIDE		30		0.0146		0.031
TOTAL LEAD						
TOTAL ZINC						

PART I

ANALYTICAL RESULTS

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

DATE SAMPLED: ___/___/_____	RESULTS ug/ℓ	/ ug/ℓ	RESULTS lbs/day	/ lbs/day	ANNUAL AVERAGE ug/ℓ	ANNUAL AVERAGE lbs/day
24-HOUR FLOW IN MGD						
TOTAL SUSPENDED SOLIDS						
SOLUABLE ORGANIC CARBON						
TOTAL PHOSPHOROUS						
TOTAL PHENOL						
OIL and GREASE						
CADMIUM						
CHROMIUM						
COPPER						
LEAD						
MERCURY						
NICKEL						
ZINC						
ARSENIC						
BERYLLIUM						
BARIUM						
TOTAL CYANIDE						
pH (STANDARD UNITS)						
RESIDUAL CHLORINE						
TOTAL SODIUM CHLORIDE						
TOTAL AMMONIA						
DIETHYLENE GLYCOL						

PART II

COMPLIANCE MONITORING

SIU PERMIT NO. 55 SHERWOOD FOREST PROPERTIES, LTD

Monitoring Station #1

NO VIOLATIONS

VIOLATION PARAMETER	DATE	FLOW [MGD]	SAMPLE POINT LOCATION	ACTUAL* DISCHARGE	PERMIT LIMIT	TYPE** LIMIT VIOLATED

NOTE:

* - Actual discharge – list actual analytical results and appropriate units.

** - Type Limit Violated – List Type:

A.A. = Annual Average

D.M. = Daily Maximum

L.L. = Local Limits (Regulation 1960.5)

eurofins | Environment Testing

ANALYTICAL REPORT

PREPARED FOR

Attn: Mr. Nathan Sarapas
TRC Environmental Corporation
Wannalancit Mills
650 Suffolk Street
Lowell, Massachusetts 01854

Generated 1/15/2026 3:12:49 PM

JOB DESCRIPTION

Solvent Chemical Quarterly Discharge

JOB NUMBER

480-235614-1

Eurofins Buffalo
10 Hazelwood Drive
Amherst NY 14228-2298

See page two for job notes and contact information.

Job Notes

This report may not be reproduced except in full, and with written approval from the laboratory. The results relate only to the samples tested. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

The test results in this report relate only to the samples as received by the laboratory and will meet all requirements of the methodology, with any exceptions noted. This report shall not be reproduced except in full, without the express written approval of the laboratory. All questions should be directed to the Eurofins Environment Testing Northeast, LLC Project Manager.

Authorization



Generated
1/15/2026 3:12:49 PM

Authorized for release by
Kavya Boyina, Project Manager
kavya.boyina@et.eurofinsus.com
(716)504-9813

Table of Contents

Cover Page 1
Table of Contents 3
Definitions/Glossary 4
Case Narrative 5
Detection Summary 6
Client Sample Results 7
Surrogate Summary 9
QC Sample Results 10
QC Association Summary 15
Lab Chronicle 16
Certification Summary 17
Method Summary 18
Sample Summary 19
Chain of Custody 20
Receipt Checklists 21

Definitions/Glossary

Client: TRC Environmental Corporation
Job ID: 480-235614-1
Project/Site: Solvent Chemical Quarterly Discharge

Qualifiers

GC/MS VOA

Qualifier	Qualifier Description
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

GC Semi VOA

Qualifier	Qualifier Description
*+	LCS and/or LCSD is outside acceptance limits, high biased.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
☼	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CFU	Colony Forming Unit
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MCL	EPA recommended "Maximum Contaminant Level"
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
MPN	Most Probable Number
MQL	Method Quantitation Limit
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
NEG	Negative / Absent
POS	Positive / Present
PQL	Practical Quantitation Limit
PRES	Presumptive
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)
TNTC	Too Numerous To Count

Job Narrative
480-235614-1

The analytical test results presented in this report meet all requirements of the associated regulatory program listed on the Accreditation/Certification Summary Page, unless otherwise noted. Data qualifiers and/or narrative comments are included to explain any exceptions, if applicable. Regulated compliance samples (e.g. SDWA, NPDES) must comply with associated agency requirements/permits.

- Matrix-specific batch QC (e.g., MS, MSD, SD) may not be reported when insufficient sample volume is available or when site-specific QC samples are not submitted. In such cases, a Laboratory Control Sample Duplicate (LCSD) may be analyzed to provide precision data for the batch.
- For samples analyzed using surrogate and/or isotope dilution analytes, any recoveries falling outside of established acceptance criteria are re-prepared and/or re-analyzed to confirm results, unless the deviation is due to sample dilution or otherwise explained in the case narrative.

Receipt
The samples were received on 1/9/2026 9:03 AM. Unless otherwise noted below, the samples arrived in good condition, and, where required, properly preserved and on ice. The temperature of the cooler at receipt time was 4.9°C.

GC/MS VOA
Method 624.1_PREC: The continuing calibration verification (CCV) associated with batch 480-766064 recovered above the upper control limit for Chloroethane. The samples associated with this CCV were non-detects for the affected analytes; therefore, the data have been reported. The associated sample is:Eff-24HR-Comp-010826-001 (480-235614-1).

Method 624.1_PREC: The following Volatile sample was composited by the laboratory on 01/09/2026 as requested by the client: Eff-24HR-Comp-010826-001 (480-235614-1).
Regulatory defined guidance for in-laboratory compositing of samples, is currently not available. Laboratory sample compositing was performed using established project specifications and/or laboratory standard operating procedures.

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

GC/MS Semi VOA
Method 625.1_PREC: The continuing calibration verification (CCV) associated with batch 480-766223 recovered above the upper control limit for Hexachlorobutadiene. The samples associated with this CCV were non-detects for the affected analytes; therefore, the data have been reported. The associated sample is:Eff-24HR-Comp-010826-001 (480-235614-1).

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

Pesticides
Method 608.3_Pest_PREC: Insufficient sample volume was available to perform a matrix spike/matrix spike duplicate/sample duplicate (MS/MSD/DUP) associated with preparation batch 480-766176.

Method 608.3_Pest_PREC: The laboratory control sample (LCS) for preparation batch 480-766176 and analytical batch 480-766230 recovered outside control limits for the following analytes: delta-BHC. These analytes were biased high in the LCS and were not detected in the associated samples; therefore, the data have been reported.

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

General Chemistry
No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

Detection Summary

Client: TRC Environmental Corporation
Job ID: 480-235614-1
Project/Site: Solvent Chemical Quarterly Discharge

Client Sample ID: Eff-24HR-Comp-010826-001
Lab Sample ID: 480-235614-1

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Trichloroethene	1.7	J	5.0	0.60	ug/L	1		624.1	Total/NA
Cyanide, Total	0.030		0.010	0.0041	mg/L	1		335.4	Total/NA

This Detection Summary does not include radiochemical test results.

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Quarterly Discharge

Job ID: 480-235614-1

Client Sample ID: Eff-24HR-Comp-010826-001
Date Collected: 01/09/26 08:30
Date Received: 01/09/26 09:03

Lab Sample ID: 480-235614-1
Matrix: Water

Method: EPA 624.1 - Volatile Organic Compounds (GC/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1-Trichloroethane	ND		5.0	0.39	ug/L			01/09/26 18:59	1
1,1,2,2-Tetrachloroethane	ND		5.0	0.26	ug/L			01/09/26 18:59	1
1,1,2-Trichloroethane	ND		5.0	0.48	ug/L			01/09/26 18:59	1
1,1-Dichloroethane	ND		5.0	0.59	ug/L			01/09/26 18:59	1
1,1-Dichloroethene	ND		5.0	0.85	ug/L			01/09/26 18:59	1
1,2-Dichlorobenzene	ND		5.0	0.44	ug/L			01/09/26 18:59	1
1,2-Dichloroethane	ND		5.0	0.60	ug/L			01/09/26 18:59	1
1,2-Dichloropropane	ND		5.0	0.61	ug/L			01/09/26 18:59	1
1,3-Dichlorobenzene	ND		5.0	0.54	ug/L			01/09/26 18:59	1
1,4-Dichlorobenzene	ND		5.0	0.51	ug/L			01/09/26 18:59	1
2-Chloroethyl vinyl ether	ND		25	1.9	ug/L			01/09/26 18:59	1
Acrolein	ND		100	17	ug/L			01/09/26 18:59	1
Acrylonitrile	ND		50	1.9	ug/L			01/09/26 18:59	1
Benzene	ND		5.0	0.60	ug/L			01/09/26 18:59	1
Bromoform	ND		5.0	0.47	ug/L			01/09/26 18:59	1
Bromomethane	ND		5.0	1.2	ug/L			01/09/26 18:59	1
Carbon tetrachloride	ND		5.0	0.51	ug/L			01/09/26 18:59	1
Chlorobenzene	ND		5.0	0.48	ug/L			01/09/26 18:59	1
Chlorodibromomethane	ND		5.0	0.41	ug/L			01/09/26 18:59	1
Chloroethane	ND		5.0	0.87	ug/L			01/09/26 18:59	1
Chloroform	ND		5.0	0.54	ug/L			01/09/26 18:59	1
Chloromethane	ND		5.0	0.64	ug/L			01/09/26 18:59	1
cis-1,3-Dichloropropene	ND		5.0	0.33	ug/L			01/09/26 18:59	1
Bromodichloromethane	ND		5.0	0.54	ug/L			01/09/26 18:59	1
Ethylbenzene	ND		5.0	0.46	ug/L			01/09/26 18:59	1
Methylene Chloride	ND		5.0	0.81	ug/L			01/09/26 18:59	1
Tetrachloroethene	ND		5.0	0.34	ug/L			01/09/26 18:59	1
Toluene	ND		5.0	0.45	ug/L			01/09/26 18:59	1
trans-1,2-Dichloroethene	ND		5.0	0.59	ug/L			01/09/26 18:59	1
trans-1,3-Dichloropropene	ND		5.0	0.44	ug/L			01/09/26 18:59	1
Trichloroethene	**1.7**	**J**	5.0	0.60	ug/L			01/09/26 18:59	1
Vinyl chloride	ND		5.0	0.75	ug/L			01/09/26 18:59	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*93*		*68 - 130*		*01/09/26 18:59*	*1*
4-Bromofluorobenzene (Surr)	*97*		*76 - 123*		*01/09/26 18:59*	*1*
Toluene-d8 (Surr)	*119*		*77 - 120*		*01/09/26 18:59*	*1*
Dibromofluoromethane (Surr)	*113*		*75 - 123*		*01/09/26 18:59*	*1*

Method: EPA 625.1 - Semivolatile Organic Compounds (GC/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,2,4-Trichlorobenzene	ND		10	0.82	ug/L		01/12/26 13:23	01/13/26 13:27	1
1,2-Dichlorobenzene	ND		10	1.0	ug/L		01/12/26 13:23	01/13/26 13:27	1
1,3-Dichlorobenzene	ND		10	0.69	ug/L		01/12/26 13:23	01/13/26 13:27	1
1,4-Dichlorobenzene	ND		10	0.82	ug/L		01/12/26 13:23	01/13/26 13:27	1
2,4,6-Trichlorophenol	ND		5.0	1.0	ug/L		01/12/26 13:23	01/13/26 13:27	1
Hexachlorobutadiene	ND		5.0	1.0	ug/L		01/12/26 13:23	01/13/26 13:27	1
Hexachloroethane	ND		5.0	0.60	ug/L		01/12/26 13:23	01/13/26 13:27	1

Client Sample ID: Eff-24HR-Comp-010826-001
Lab Sample ID: 480-235614-1

Date Collected: 01/09/26 08:30
Matrix: Water
Date Received: 01/09/26 09:03

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
2,4,6-Tribromophenol (Surr)	*92*		*52 - 151*	*01/12/26 13:23*	*01/13/26 13:27*	*1*
2-Fluorobiphenyl (Surr)	*73*		*44 - 120*	*01/12/26 13:23*	*01/13/26 13:27*	*1*
2-Fluorophenol (Surr)	*44*		*17 - 120*	*01/12/26 13:23*	*01/13/26 13:27*	*1*
Nitrobenzene-d5 (Surr)	*58*		*15 - 314*	*01/12/26 13:23*	*01/13/26 13:27*	*1*
Phenol-d5 (Surr)	*28*		*8 - 424*	*01/12/26 13:23*	*01/13/26 13:27*	*1*
p-Terphenyl-d14 (Surr)	*80*		*22 - 125*	*01/12/26 13:23*	*01/13/26 13:27*	*1*

Method: EPA 608.3 - Organochlorine Pesticides in Water

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
alpha-BHC	ND		0.048	0.0073	ug/L		01/12/26 13:12	01/13/26 13:15	1
beta-BHC	ND		0.048	0.024	ug/L		01/12/26 13:12	01/13/26 13:15	1
delta-BHC	ND	*+	0.048	0.0095	ug/L		01/12/26 13:12	01/13/26 13:15	1
gamma-BHC (Lindane)	ND		0.048	0.0076	ug/L		01/12/26 13:12	01/13/26 13:15	1
BHC, Total	ND		0.048	0.048	ug/L		01/12/26 13:12	01/13/26 13:15	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
DCB Decachlorobiphenyl (Surr)	*75*		*10 - 120*	*01/12/26 13:12*	*01/13/26 13:15*	*1*
Tetrachloro-m-xylene (Surr)	*100*		*10 - 120*	*01/12/26 13:12*	*01/13/26 13:15*	*1*

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Cyanide, Total (EPA 335.4)	**0.030**		0.010	0.0041	mg/L			01/12/26 17:29	1

Surrogate Summary

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Quarterly Discharge

Job ID: 480-235614-1

Method: 624.1 - Volatile Organic Compounds (GC/MS)

Matrix: Water — **Prep Type: Total/NA**

		Percent Surrogate Recovery (Acceptance Limits)			
		DCA	BFB	TOL	DBFM
Lab Sample ID	Client Sample ID	(68-130)	(76-123)	(77-120)	(75-123)
480-235614-1	Eff-24HR-Comp-010826-001	93	97	119	113
LCS 480-766064/7	Lab Control Sample	90	96	115	106
MB 480-766064/9	Method Blank	92	96	120	111

Surrogate Legend

DCA = 1,2-Dichloroethane-d4 (Surr)
BFB = 4-Bromofluorobenzene (Surr)
TOL = Toluene-d8 (Surr)
DBFM = Dibromofluoromethane (Surr)

Method: 625.1 - Semivolatile Organic Compounds (GC/MS)

Matrix: Water — **Prep Type: Total/NA**

		Percent Surrogate Recovery (Acceptance Limits)					
		TBP	FBP	2FP	NBZ	PHL	TPHd14
Lab Sample ID	Client Sample ID	(52-151)	(44-120)	(17-120)	(15-314)	(8-424)	(22-125)
480-235614-1	Eff-24HR-Comp-010826-001	92	73	44	58	28	80
480-235614-1 MS	Eff-24HR-Comp-010826-001	103	78	48	68	35	70
480-235614-1 MSD	Eff-24HR-Comp-010826-001	108	79	49	67	37	72
LCS 480-766178/2-A	Lab Control Sample	113	80	49	69	37	95
MB 480-766178/1-A	Method Blank	98	77	47	63	30	97

Surrogate Legend

TBP = 2,4,6-Tribromophenol (Surr)
FBP = 2-Fluorobiphenyl (Surr)
2FP = 2-Fluorophenol (Surr)
NBZ = Nitrobenzene-d5 (Surr)
PHL = Phenol-d5 (Surr)
TPHd14 = p-Terphenyl-d14 (Surr)

Method: 608.3 - Organochlorine Pesticides in Water

Matrix: Water — **Prep Type: Total/NA**

		Percent Surrogate Recovery (Acceptance Limits)	
		DCBP1	TCX1
Lab Sample ID	Client Sample ID	(10-120)	(10-120)
480-235614-1	Eff-24HR-Comp-010826-001	75	100
LCS 480-766176/2-A	Lab Control Sample	100	97
LCSD 480-766176/3-A	Lab Control Sample Dup	98	92
MB 480-766176/1-A	Method Blank	97	95

Surrogate Legend

DCBP = DCB Decachlorobiphenyl (Surr)
TCX = Tetrachloro-m-xylene (Surr)

Method: 624.1 - Volatile Organic Compounds (GC/MS)

Lab Sample ID: MB 480-766064/9
Matrix: Water
Analysis Batch: 766064

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1-Trichloroethane	ND		5.0	0.39	ug/L			01/09/26 13:51	1
1,1,2,2-Tetrachloroethane	ND		5.0	0.26	ug/L			01/09/26 13:51	1
1,1,2-Trichloroethane	ND		5.0	0.48	ug/L			01/09/26 13:51	1
1,1-Dichloroethane	ND		5.0	0.59	ug/L			01/09/26 13:51	1
1,1-Dichloroethene	ND		5.0	0.85	ug/L			01/09/26 13:51	1
1,2-Dichlorobenzene	ND		5.0	0.44	ug/L			01/09/26 13:51	1
1,2-Dichloroethane	ND		5.0	0.60	ug/L			01/09/26 13:51	1
1,2-Dichloropropane	ND		5.0	0.61	ug/L			01/09/26 13:51	1
1,3-Dichlorobenzene	ND		5.0	0.54	ug/L			01/09/26 13:51	1
1,4-Dichlorobenzene	ND		5.0	0.51	ug/L			01/09/26 13:51	1
2-Chloroethyl vinyl ether	ND		25	1.9	ug/L			01/09/26 13:51	1
Acrolein	ND		100	17	ug/L			01/09/26 13:51	1
Acrylonitrile	ND		50	1.9	ug/L			01/09/26 13:51	1
Benzene	ND		5.0	0.60	ug/L			01/09/26 13:51	1
Bromoform	ND		5.0	0.47	ug/L			01/09/26 13:51	1
Bromomethane	ND		5.0	1.2	ug/L			01/09/26 13:51	1
Carbon tetrachloride	ND		5.0	0.51	ug/L			01/09/26 13:51	1
Chlorobenzene	ND		5.0	0.48	ug/L			01/09/26 13:51	1
Chlorodibromomethane	ND		5.0	0.41	ug/L			01/09/26 13:51	1
Chloroethane	ND		5.0	0.87	ug/L			01/09/26 13:51	1
Chloroform	ND		5.0	0.54	ug/L			01/09/26 13:51	1
Chloromethane	ND		5.0	0.64	ug/L			01/09/26 13:51	1
cis-1,3-Dichloropropene	ND		5.0	0.33	ug/L			01/09/26 13:51	1
Bromodichloromethane	ND		5.0	0.54	ug/L			01/09/26 13:51	1
Ethylbenzene	ND		5.0	0.46	ug/L			01/09/26 13:51	1
Methylene Chloride	ND		5.0	0.81	ug/L			01/09/26 13:51	1
Tetrachloroethene	ND		5.0	0.34	ug/L			01/09/26 13:51	1
Toluene	ND		5.0	0.45	ug/L			01/09/26 13:51	1
trans-1,2-Dichloroethene	ND		5.0	0.59	ug/L			01/09/26 13:51	1
trans-1,3-Dichloropropene	ND		5.0	0.44	ug/L			01/09/26 13:51	1
Trichloroethene	ND		5.0	0.60	ug/L			01/09/26 13:51	1
Vinyl chloride	ND		5.0	0.75	ug/L			01/09/26 13:51	1

Surrogate	*MB %Recovery*	*MB Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*92*		*68 - 130*		*01/09/26 13:51*	*1*
4-Bromofluorobenzene (Surr)	*96*		*76 - 123*		*01/09/26 13:51*	*1*
Toluene-d8 (Surr)	*120*		*77 - 120*		*01/09/26 13:51*	*1*
Dibromofluoromethane (Surr)	*111*		*75 - 123*		*01/09/26 13:51*	*1*

Lab Sample ID: LCS 480-766064/7
Matrix: Water
Analysis Batch: 766064

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte			Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits		
1,1,1-Trichloroethane			20.0	19.7		ug/L		98	52 - 162		
1,1,2,2-Tetrachloroethane			20.0	20.0		ug/L		100	46 - 157		
1,1,2-Trichloroethane			20.0	20.4		ug/L		102	52 - 150		
1,1-Dichloroethane			20.0	20.6		ug/L		103	59 - 155		

Method: 624.1 - Volatile Organic Compounds (GC/MS) (Continued)

Lab Sample ID: LCS 480-766064/7
Matrix: Water
Analysis Batch: 766064

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,1-Dichloroethene	20.0	21.7		ug/L		108	1 - 234
1,2-Dichlorobenzene	20.0	22.4		ug/L		112	18 - 190
1,2-Dichloroethane	20.0	16.9		ug/L		85	49 - 155
1,2-Dichloropropane	20.0	19.0		ug/L		95	1 - 210
1,3-Dichlorobenzene	20.0	21.1		ug/L		106	59 - 156
1,4-Dichlorobenzene	20.0	20.8		ug/L		104	18 - 190
2-Chloroethyl vinyl ether	20.0	14.0	J	ug/L		70	1 - 305
Benzene	20.0	20.6		ug/L		103	37 - 151
Bromoform	20.0	23.1		ug/L		115	45 - 169
Bromomethane	20.0	27.6		ug/L		138	1 - 242
Carbon tetrachloride	20.0	17.4		ug/L		87	70 - 140
Chlorobenzene	20.0	21.0		ug/L		105	37 - 160
Chlorodibromomethane	20.0	21.6		ug/L		108	53 - 149
Chloroethane	20.0	30.7		ug/L		154	14 - 230
Chloroform	20.0	20.4		ug/L		102	51 - 138
Chloromethane	20.0	19.9		ug/L		99	1 - 273
cis-1,3-Dichloropropene	20.0	18.0		ug/L		90	1 - 227
Bromodichloromethane	20.0	19.0		ug/L		95	35 - 155
Ethylbenzene	20.0	21.1		ug/L		105	37 - 162
Methylene Chloride	20.0	22.4		ug/L		112	1 - 221
Tetrachloroethene	20.0	22.8		ug/L		114	64 - 148
Toluene	20.0	21.5		ug/L		107	47 - 150
trans-1,2-Dichloroethene	20.0	22.5		ug/L		113	54 - 156
trans-1,3-Dichloropropene	20.0	17.9		ug/L		90	17 - 183
Trichloroethene	20.0	20.1		ug/L		101	71 - 157
Vinyl chloride	20.0	22.3		ug/L		111	1 - 251

Surrogate	*LCS %Recovery*	*LCS Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*90*		*68 - 130*
4-Bromofluorobenzene (Surr)	*96*		*76 - 123*
Toluene-d8 (Surr)	*115*		*77 - 120*
Dibromofluoromethane (Surr)	*106*		*75 - 123*

Method: 625.1 - Semivolatile Organic Compounds (GC/MS)

Lab Sample ID: MB 480-766178/1-A
Matrix: Water
Analysis Batch: 766223

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 766178

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,2,4-Trichlorobenzene	ND		10	0.82	ug/L		01/12/26 13:23	01/13/26 11:41	1
1,2-Dichlorobenzene	ND		10	1.0	ug/L		01/12/26 13:23	01/13/26 11:41	1
1,3-Dichlorobenzene	ND		10	0.69	ug/L		01/12/26 13:23	01/13/26 11:41	1
1,4-Dichlorobenzene	ND		10	0.82	ug/L		01/12/26 13:23	01/13/26 11:41	1
2,4,6-Trichlorophenol	ND		5.0	1.0	ug/L		01/12/26 13:23	01/13/26 11:41	1
Hexachlorobutadiene	ND		5.0	1.0	ug/L		01/12/26 13:23	01/13/26 11:41	1
Hexachloroethane	ND		5.0	0.60	ug/L		01/12/26 13:23	01/13/26 11:41	1

Method: 625.1 - Semivolatile Organic Compounds (GC/MS) (Continued)

Lab Sample ID: MB 480-766178/1-A
Matrix: Water
Analysis Batch: 766223

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 766178

Surrogate	MB %Recovery	MB Qualifier	Limits	Prepared	Analyzed	Dil Fac
2,4,6-Tribromophenol (Surr)	98		52 - 151	01/12/26 13:23	01/13/26 11:41	1
2-Fluorobiphenyl (Surr)	77		44 - 120	01/12/26 13:23	01/13/26 11:41	1
2-Fluorophenol (Surr)	47		17 - 120	01/12/26 13:23	01/13/26 11:41	1
Nitrobenzene-d5 (Surr)	63		15 - 314	01/12/26 13:23	01/13/26 11:41	1
Phenol-d5 (Surr)	30		8 - 424	01/12/26 13:23	01/13/26 11:41	1
p-Terphenyl-d14 (Surr)	97		22 - 125	01/12/26 13:23	01/13/26 11:41	1

Lab Sample ID: LCS 480-766178/2-A
Matrix: Water
Analysis Batch: 766223

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 766178

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,2,4-Trichlorobenzene	32.0	21.4		ug/L		67	44 - 142
1,2-Dichlorobenzene	32.0	19.4		ug/L		61	32 - 129
1,3-Dichlorobenzene	32.0	18.5		ug/L		58	1 - 172
1,4-Dichlorobenzene	32.0	18.9		ug/L		59	20 - 124
2,4,6-Trichlorophenol	32.0	25.8		ug/L		81	37 - 144
Hexachlorobutadiene	32.0	20.8		ug/L		65	24 - 120
Hexachloroethane	32.0	16.8		ug/L		53	40 - 120

Surrogate	LCS %Recovery	LCS Qualifier	Limits
2,4,6-Tribromophenol (Surr)	113		52 - 151
2-Fluorobiphenyl (Surr)	80		44 - 120
2-Fluorophenol (Surr)	49		17 - 120
Nitrobenzene-d5 (Surr)	69		15 - 314
Phenol-d5 (Surr)	37		8 - 424
p-Terphenyl-d14 (Surr)	95		22 - 125

Lab Sample ID: 480-235614-1 MS
Matrix: Water
Analysis Batch: 766223

Client Sample ID: Eff-24HR-Comp-010826-001
Prep Type: Total/NA
Prep Batch: 766178

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
1,2,4-Trichlorobenzene	ND		32.0	21.5		ug/L		67	44 - 142
1,2-Dichlorobenzene	ND		32.0	18.8		ug/L		59	32 - 129
1,3-Dichlorobenzene	ND		32.0	18.6		ug/L		58	1 - 172
1,4-Dichlorobenzene	ND		32.0	18.6		ug/L		58	20 - 124
2,4,6-Trichlorophenol	ND		32.0	25.5		ug/L		80	37 - 144
Hexachlorobutadiene	ND		32.0	20.5		ug/L		64	24 - 120
Hexachloroethane	ND		32.0	16.9		ug/L		53	40 - 120

Surrogate	MS %Recovery	MS Qualifier	Limits
2,4,6-Tribromophenol (Surr)	103		52 - 151
2-Fluorobiphenyl (Surr)	78		44 - 120
2-Fluorophenol (Surr)	48		17 - 120
Nitrobenzene-d5 (Surr)	68		15 - 314
Phenol-d5 (Surr)	35		8 - 424
p-Terphenyl-d14 (Surr)	70		22 - 125

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Quarterly Discharge

Job ID: 480-235614-1

Method: 625.1 - Semivolatile Organic Compounds (GC/MS)

Lab Sample ID: 480-235614-1 MSD
Matrix: Water
Analysis Batch: 766223

Client Sample ID: Eff-24HR-Comp-010826-001
Prep Type: Total/NA
Prep Batch: 766178

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
1,2,4-Trichlorobenzene	ND		32.0	20.7		ug/L		65	44 - 142	4	50
1,2-Dichlorobenzene	ND		32.0	18.9		ug/L		59	32 - 129	1	38
1,3-Dichlorobenzene	ND		32.0	18.3		ug/L		57	1 - 172	2	37
1,4-Dichlorobenzene	ND		32.0	18.7		ug/L		59	20 - 124	1	40
2,4,6-Trichlorophenol	ND		32.0	25.5		ug/L		80	37 - 144	0	58
Hexachlorobutadiene	ND		32.0	19.2		ug/L		60	24 - 120	6	62
Hexachloroethane	ND		32.0	16.6		ug/L		52	40 - 120	2	52

Surrogate	*MSD %Recovery*	*MSD Qualifier*	*Limits*
2,4,6-Tribromophenol (Surr)	*108*		*52 - 151*
2-Fluorobiphenyl (Surr)	*79*		*44 - 120*
2-Fluorophenol (Surr)	*49*		*17 - 120*
Nitrobenzene-d5 (Surr)	*67*		*15 - 314*
Phenol-d5 (Surr)	*37*		*8 - 424*
p-Terphenyl-d14 (Surr)	*72*		*22 - 125*

Method: 608.3 - Organochlorine Pesticides in Water

Lab Sample ID: MB 480-766176/1-A
Matrix: Water
Analysis Batch: 766230

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 766176

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
alpha-BHC	ND		0.050	0.0077	ug/L		01/12/26 13:12	01/13/26 11:57	1
beta-BHC	ND		0.050	0.025	ug/L		01/12/26 13:12	01/13/26 11:57	1
delta-BHC	ND		0.050	0.010	ug/L		01/12/26 13:12	01/13/26 11:57	1
gamma-BHC (Lindane)	ND		0.050	0.0080	ug/L		01/12/26 13:12	01/13/26 11:57	1
BHC, Total	ND		0.050	0.050	ug/L		01/12/26 13:12	01/13/26 11:57	1

Surrogate	*MB %Recovery*	*MB Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
DCB Decachlorobiphenyl (Surr)	*97*		*10 - 120*	*01/12/26 13:12*	*01/13/26 11:57*	*1*
Tetrachloro-m-xylene (Surr)	*95*		*10 - 120*	*01/12/26 13:12*	*01/13/26 11:57*	*1*

Lab Sample ID: LCS 480-766176/2-A
Matrix: Water
Analysis Batch: 766230

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 766176

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
alpha-BHC	0.500	0.565		ug/L		113	52 - 125
beta-BHC	0.500	0.576		ug/L		115	52 - 120
delta-BHC	0.500	0.605	*+	ug/L		121	51 - 120
gamma-BHC (Lindane)	0.500	0.546		ug/L		109	56 - 120

Surrogate	*LCS %Recovery*	*LCS Qualifier*	*Limits*
DCB Decachlorobiphenyl (Surr)	*100*		*10 - 120*
Tetrachloro-m-xylene (Surr)	*97*		*10 - 120*

Method: 608.3 - Organochlorine Pesticides in Water (Continued)

Lab Sample ID: LCSD 480-766176/3-A
Matrix: Water
Analysis Batch: 766230

Client Sample ID: Lab Control Sample Dup
Prep Type: Total/NA
Prep Batch: 766176

Analyte			Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
alpha-BHC			0.500	0.557		ug/L		111	52 - 125	1	50
beta-BHC			0.500	0.571		ug/L		114	52 - 120	1	50
delta-BHC			0.500	0.600		ug/L		120	51 - 120	1	50
gamma-BHC (Lindane)			0.500	0.539		ug/L		108	56 - 120	1	50

Surrogate	*LCSD %Recovery*	*LCSD Qualifier*	*Limits*
DCB Decachlorobiphenyl (Surr)	*98*		*10 - 120*
Tetrachloro-m-xylene (Surr)	*92*		*10 - 120*

Method: 335.4 - Cyanide, Total

Lab Sample ID: MB 480-766191/21
Matrix: Water
Analysis Batch: 766191

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Cyanide, Total	ND		0.010	0.0041	mg/L			01/12/26 16:08	1

Lab Sample ID: HLCS 480-766191/22
Matrix: Water
Analysis Batch: 766191

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte			Spike Added	HLCS Result	HLCS Qualifier	Unit	D	%Rec	%Rec Limits		
Cyanide, Total			0.400	0.419		mg/L		105	90 - 110		

Lab Sample ID: LCS 480-766191/23
Matrix: Water
Analysis Batch: 766191

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte			Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits		
Cyanide, Total			0.250	0.262		mg/L		105	90 - 110		

Lab Sample ID: LLCS 480-766191/24
Matrix: Water
Analysis Batch: 766191

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte			Spike Added	LLCS Result	LLCS Qualifier	Unit	D	%Rec	%Rec Limits		
Cyanide, Total			0.0100	0.0128		mg/L		128	50 - 150		

QC Association Summary

Client: TRC Environmental Corporation
Job ID: 480-235614-1
Project/Site: Solvent Chemical Quarterly Discharge

GC/MS VOA

Analysis Batch: 766064

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-235614-1	Eff-24HR-Comp-010826-001	Total/NA	Water	624.1	
MB 480-766064/9	Method Blank	Total/NA	Water	624.1	
LCS 480-766064/7	Lab Control Sample	Total/NA	Water	624.1	

GC/MS Semi VOA

Prep Batch: 766178

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-235614-1	Eff-24HR-Comp-010826-001	Total/NA	Water	625	
MB 480-766178/1-A	Method Blank	Total/NA	Water	625	
LCS 480-766178/2-A	Lab Control Sample	Total/NA	Water	625	
480-235614-1 MS	Eff-24HR-Comp-010826-001	Total/NA	Water	625	
480-235614-1 MSD	Eff-24HR-Comp-010826-001	Total/NA	Water	625	

Analysis Batch: 766223

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-235614-1	Eff-24HR-Comp-010826-001	Total/NA	Water	625.1	766178
MB 480-766178/1-A	Method Blank	Total/NA	Water	625.1	766178
LCS 480-766178/2-A	Lab Control Sample	Total/NA	Water	625.1	766178
480-235614-1 MS	Eff-24HR-Comp-010826-001	Total/NA	Water	625.1	766178
480-235614-1 MSD	Eff-24HR-Comp-010826-001	Total/NA	Water	625.1	766178

GC Semi VOA

Prep Batch: 766176

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-235614-1	Eff-24HR-Comp-010826-001	Total/NA	Water	3510C	
MB 480-766176/1-A	Method Blank	Total/NA	Water	3510C	
LCS 480-766176/2-A	Lab Control Sample	Total/NA	Water	3510C	
LCSD 480-766176/3-A	Lab Control Sample Dup	Total/NA	Water	3510C	

Analysis Batch: 766230

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-235614-1	Eff-24HR-Comp-010826-001	Total/NA	Water	608.3	766176
MB 480-766176/1-A	Method Blank	Total/NA	Water	608.3	766176
LCS 480-766176/2-A	Lab Control Sample	Total/NA	Water	608.3	766176
LCSD 480-766176/3-A	Lab Control Sample Dup	Total/NA	Water	608.3	766176

General Chemistry

Analysis Batch: 766191

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-235614-1	Eff-24HR-Comp-010826-001	Total/NA	Water	335.4	
MB 480-766191/21	Method Blank	Total/NA	Water	335.4	
HLCS 480-766191/22	Lab Control Sample	Total/NA	Water	335.4	
LCS 480-766191/23	Lab Control Sample	Total/NA	Water	335.4	
LLCS 480-766191/24	Lab Control Sample	Total/NA	Water	335.4	

Lab Chronicle

Client: TRC Environmental Corporation
Job ID: 480-235614-1
Project/Site: Solvent Chemical Quarterly Discharge

Client Sample ID: Eff-24HR-Comp-010826-001
Lab Sample ID: 480-235614-1

Date Collected: 01/09/26 08:30
Matrix: Water
Date Received: 01/09/26 09:03

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	624.1		1	766064	AXK	EET BUF	01/09/26 18:59
Total/NA	Prep	625			766178	LSC	EET BUF	01/12/26 13:23
Total/NA	Analysis	625.1		1	766223	JMM	EET BUF	01/13/26 13:27
Total/NA	Prep	3510C			766176	LSC	EET BUF	01/12/26 13:12
Total/NA	Analysis	608.3		1	766230	JLS	EET BUF	01/13/26 13:15
Total/NA	Analysis	335.4		1	766191	GW	EET BUF	01/12/26 17:29

Laboratory References:

EET BUF = Eurofins Buffalo, 10 Hazelwood Drive, Amherst, NY 14228-2298, TEL (716)691-2600

Accreditation/Certification Summary

Client: TRC Environmental Corporation
Job ID: 480-235614-1
Project/Site: Solvent Chemical Quarterly Discharge

Laboratory: Eurofins Buffalo

Unless otherwise noted, all analytes for this laboratory were covered under each accreditation/certification below.

Authority	Program	Identification Number	Expiration Date
New York	NELAP	10026	03-31-26

The following analytes are included in this report, but the laboratory is not certified by the governing authority. This list may include analytes for which the agency does not offer certification.

Analysis Method	Prep Method	Matrix	Analyte
608.3	3510C	Water	BHC, Total
625.1	625	Water	1,2-Dichlorobenzene
625.1	625	Water	1,3-Dichlorobenzene
625.1	625	Water	1,4-Dichlorobenzene

Method Summary

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Quarterly Discharge

Job ID: 480-235614-1

Method	Method Description	Protocol	Laboratory
624.1	Volatile Organic Compounds (GC/MS)	EPA	EET BUF
625.1	Semivolatile Organic Compounds (GC/MS)	EPA	EET BUF
608.3	Organochlorine Pesticides in Water	EPA	EET BUF
335.4	Cyanide, Total	EPA	EET BUF
3510C	Liquid-Liquid Extraction (Separatory Funnel)	SW846	EET BUF
625	Liquid-Liquid Extraction	EPA	EET BUF

Protocol References:

EPA = US Environmental Protection Agency

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

Laboratory References:

EET BUF = Eurofins Buffalo, 10 Hazelwood Drive, Amherst, NY 14228-2298, TEL (716)691-2600

Sample Summary

Client: TRC Environmental Corporation
Job ID: 480-235614-1
Project/Site: Solvent Chemical Quarterly Discharge

Lab Sample ID	Client Sample ID	Matrix	Collected	Received	Sample Origin
480-235614-1	Eff-24HR-Comp-010826-001	Water	01/09/26 08:30	01/09/26 09:03	New York

Eurofins Buffalo
10 Hazelwood Drive
Amherst, NY 14228-2298
Phone: 716-691-2600 Fax: 716-691-7991

Chain of Custody Record

eurofins | Environment Testing

Client Information	Sampler: Cameron Carney	Lab PM: Boyina, Kavya	Carrier Tracking No(s):	COC No: 480-197464-37907.1
Client Contact: ~~Mr. Mike Plumb~~ Ms. Leila MacRae	Phone: 716-965-0256	E-Mail: kavya.boyina@et.eurofinsus.com	State of Origin:	Page: Page 1 of 1
Company: TRC Environmental Corporation	PWSID:			Job #:

Analysis Requested

| Address: Wannalancit Mills 650 Suffolk Street | Due Date Requested: | | |

Login Sample Receipt Checklist

Client: TRC Environmental Corporation

Job Number: 480-235614-1

Login Number: 235614
List Number: 1
Creator: Yeager, Brian A

List Source: Eurofins Buffalo

Question	Answer	Comment
Radioactivity either was not measured or, if measured, is at or below background	True	
The cooler's custody seal, if present, is intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	4.9 ICE IR# SC
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the sample IDs on the containers and the COC.	True	
Samples are received within Holding Time (Excluding tests with immediate HTs)..	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
VOA sample vials do not have headspace or bubble is <6mm (1/4") in diameter.	True	
If necessary, staff have been informed of any short hold time or quick TAT needs	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	False	
Sampling Company provided.	True	Camtech
Samples received within 48 hours of sampling.	True	
Samples requiring field filtration have been filtered in the field.	True	
Chlorine Residual checked.	N/A	

APPENDIX C - DAILY O&M AND INSPECTION FORMS

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
March-April		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carrigan	F	2											
2	3/31/25													
3	C. Carrigan	F	8			Changed bag filters, Quartly samples								
4	4/1/25													
5	C. Carrigan	F	8			Quartly samples, NFWB - took samples								
6	4/2/25													
7	C. Carrigan	F	8			Pulled PW			2B, steam			cycle #1, unpluged		
8	N. Shultz	J	8			decenter - worked on								
9	4/3/25													
10	C. Carrigan	F	6			Changed Bag filter								
11	4/4/25													
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	32		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
1	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

SUPERVISOR SIGNATURE — DATE

FIELD INSPECTOR SIGNATURE — DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
April		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	STRAIGHT TIME HRS	STRAIGHT TIME RATE	STRAIGHT TIME AMOUNT	TH OVERTIME HRS	TH OVERTIME RATE	TH OVERTIME AMOUNT	DT OVERTIME HRS	DT OVERTIME RATE	DT OVERTIME AMOUNT	HAZMAT QTY.	HAZMAT TH / DT	MEALS QTY.
1	C. Carrigan	F	2											
2	4/7/25													
3	C. Carrigan	F	2											
4	4/8/25													
5	R. Crossley	F	3			Reworked			Bag		filters	-Began		
6	C. Carrigan	J	3											
7	4/9/25													
8	R. Crossley	F	4			Finished re-working			Bag		filters			
9	C. Carrigan	J	2											
10	4/10/25													
11	C. Carrigan	F	4			Forced steam with John P.								
12	4/11/25													
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	1.5		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
April		TRC	4B - Well Dig

	EMPLOYEE	STRAIGHT TIME TL	STRAIGHT TIME HRS	STRAIGHT TIME RATE	STRAIGHT TIME AMOUNT	TH OVERTIME HRS	TH OVERTIME RATE	TH OVERTIME AMOUNT	DT OVERTIME HRS	DT OVERTIME RATE	DT OVERTIME AMOUNT	HAZMAT QTY.	HAZMAT TH / DT	MEALS QTY.
1	C. Carrigan		0			Excavator dropped off								
2	4/7/25													
3	N. Shultz	F	8			Broke ground on dig, pulled 2nd containment cover								
4	C. Carrigan	J	8			ordered Lull								
5	4/8/25													
6	N. Shultz	F	5			Pulled wire outs + removed MH PW-4B,								
7	C. Carrigan	J	5			removed concrete ring								
8	4/9/25													
9	R. Crossley	F	4			Rewelded HDPE force main, reconnected 3" force								
10	C. Carrigan	J	6			main, 6 tons of #1 delivered - stone - Scotts lawn								
11	4/10/25													
12	R. Crossley	F	4			tested + Flushed PW 4B								
13	C. Carrigan	J	4											
14	4/11/25													

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	21		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

4B - Well Dig

SUB CONTRACTORS

1 Scotts Lawn yard

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
April		TRC	4B - Well Dig

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	N. Shultz	F	8			Repaired 3/4" acid treatment line								
2	K. Kloepfer	J	8			Repaired Secondary containment								
3	C. Carrigan	J	6											
4	4/14/25													
5	N. Shultz	F	6			Backfilled, resete concrete wall collar								
6	C. Carrigan	J	6			Plate tamper in 8"-12" lifts, Flushed 4B								
7	4/15/25													
8	N. Shultz	F	4			6 tons #1 Stone delivered, backfilled,								
9	C. Carrigan	J	4			resetting PW 4B MH., order 8,000 lb Lull								
10	4/16/25													
11	N. Shultz	F	8			lulled del, lull picked up, reset PW 4B MH, reran								
12	C. Carrigan	J	8			Condnit in 4B MH, Backfilled + compacted,								
13	4/17/25													
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	34		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
9	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

4B - Well Dig

SUB CONTRACTORS

1-Scotts Lawn yard

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
April		TRC	4B - well Dig

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	N. Shultz	F	8			Worked on			wiring pump, sensors,					
2	C. Carrigan	J	6			Mounted Boxes								
3	4/18/25													
4														
5														
6														
7														
8														
9														
10														
11														
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
	PICK-UP TRUCK			20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

4B - well Dig

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
April		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carrigan	F	2											
2	4/14/25													
3	C. Carrigan	J	2			Cleaned up site								
4	N. Shultz	F	2											
5	4/15/25													
6	N. Shultz	F	4			BW carbon bed #1, clean site								
7	C. Carrigan	J	2											
8	4/16/25													
9	R. Crossley	F	6			NFWB took samples, steam cycle #1								
10	4/17/25													
11	C. Carrigan	F	2											
12	4/18/25													
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	16		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE _____ DATE _____

FIELD INSPECTOR SIGNATURE _____ DATE _____

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
April		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	HAZMAT TH / DT	MEALS QTY.
1	N. Shultz	F	8			Pulled PW5B, PW4B meter install								
2	C. Carrigan	J	8			clean pump								
3	4/21/25													
4	C. Carrigan	F	6			clean site, trouble shot PW4B start								
5	K. Koepfler	J	2											
6	4/22/25													
7	R. Cressley	F	6			Finish grading around Pump 4B								
8	C. Carrigan	J	2											
9	4/23/25													
10	C. Carrigan	F	8			Monthly								
11	C. Carney	J	8											
12	4/24/25													
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	28		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
1	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date: April | PO# | CUSTOMER: TRC | PROJECT NAME: O+M

EMPLOYEE	STRAIGHT TIME				TH OVERTIME			DT OVERTIME			HAZMAT		MEALS
	TL	HRS	RATE	AMOUNT	HRS	RATE	AMOUNT	HRS	RATE	AMOUNT	QTY.	TH / DT	QTY.
1 C. Carrigan	F	8			Monthly,			pulled	PW5B				
2 C. Carney	J	8											
3 4/25/25													
4													
5													
6													
7													
8													
9													
10													
11													
12													
13													
14													

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	8		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
1	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
April/May		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carrigan	F	8			Changed bag filters, took monthly process samples, rinsed Redux totes								
2	4/28/25													
3	C. Carrigan	F	8			Steam cycle, Back washed Lead Carbon Bed								
4	4/29/25													
5	C. Carrigan	F	2											
6	4/30/25													
7	C. Carrigan	F	2											
8	5/1/25													
9	C. Carrigan	F	8			Changed bag filters, weekly inspection						Steam cycle #2		
10	5/2/25													
11														
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	28		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
May		TRC	O+M

EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1 C. Carrigan	F	6.			Steam cycle			#1, NFWB took samples					
2 5/5/25													
3 C. Carrigan	F	2											
4 5/6/25													
5 C. Carrigan	F	6			Pumped down BW tank								
6 5/7/25													
7 C. Carrigan	F	2.											
8 5/8/25													
9 C. Carrigan	F	8.			Changed			Bag filters,			Backwashed		
10 C. Carney	J	8			Carbon Bed #4, Steam cycle								
11 R. Crossley	J	6			pulled pump PW3B								
12 5/9/25													
13													
14													

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	24		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
1	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
1	OTHER Forklift			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

R.B. Uren

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
MAY		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carrigan	F	4				Steam cycle #4							
2	5/12/25													
3	C. Carrigan	F	2											
4	5/13/25													
5	C. Carrigan	F	4				Bypassed		alarm in Amsel					
6	5/14/25													
7	C. Carrigan	F	4				Steam cycle #1							
8	5/15/25													
9	C. Carrigan	F	6				changed		bag filters, steam cycle #2					
10	5/16/25													
11														
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	20		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
MAY		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carrigan	F	4			Steam cycle #1, Diagnose boiler element								
2	5/19/25													
3	C. Carrigan	F	2											
4	5/20/25													
5	C. Carrigan	F	2											
6	5/21/25													
7	C. Carrigan	F	5			Changed Boiler elements								
8	5/22/25													
9	C. Carrigan	F	6			Changed Bag filters, NFWB took billing samples								
10	5/23/25													
11														
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	19		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
MAY		TRC	O+M

EMPLOYEE	STRAIGHT TIME				TH OVERTIME			DT OVERTIME			HAZMAT		MEALS
	TL	HRS	RATE	AMOUNT	HRS	RATE	AMOUNT	HRS	RATE	AMOUNT	QTY.	TH / DT	QTY.
1 C. Carrigan	F	3			Steam cycle			#2					
2 5/27/25													
3 C. Carrigan	F	8			Back worked Carbon Bed A, Built new								
4 N. Shultz	J	6			Redux pump stand								
5 5/28/25													
6 C. Carrigan	F	8			cleaned air stripper floats, Monthly								
7 C. Carney	J	8			process Samples, Changed Redox tote, Built								
8 5/29/25					new Redux manifold & feed line								
9 C. Carrigan	F	6											
10 5/30/25													
11													
12													
13													
14													

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	25		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
June		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carrigan	F	2				Steam cycle #2							
2	6/2/25													
3	C. Carrigan	F	8				Pull PW		BB - new pump, motor, wiring +					
4	C. Carney	J	8				Cable							
5	6/3/25													
6	C. Carrigan	F	4				Change Boiler element -					DGI on site		
7	6/4/25													
8	C. Carrigan	F	6				Installed new Amsel input card,							
9	6/5/25													
10	C. Carrigan	F	4				NFWB took samples, cleaned floor by sumps							
11	6/6/25													
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	24		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
1	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

DGI

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
June		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carrigan	F	8			Monthly			Cleaning					
2	C. Carney	J	8											
3	6/16/25													
4	C. Carrigan	F	2											
5	6/17/25													
6	C. Carrigan	F	2											
7	6/18/25													
8	C. Carrigan	F	4			Rebuilt last Redux pump								
9	C. Carney	J	4											
10	6/19/25													
11	C. Carrigan	F	8			Changed bag filters, took process								
12	C. Carney	J	8			Samples, backwashed Bed A, Picked up								
13	6/20/25					samples + delivered samples								
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	24		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE Carter Crosby DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
June		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carney	F	2											
2	6/23/25													
3	C. Carney	F	2											
4	6/24/25													
5	C. Carrigan	F	8			Took process			samples,			Picked up +		Delivered
6	6/25/25													
7	C. Carrigan	F	8											
8	C. Carney	J	8			Monthly			Cleaning					
9	6/26/25													
10	C. Carrigan	F	8											
11	C. Carney	J	8											
12	6/27/25													
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	28		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
June/July		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carrigan	F	2											
2	6/30/25													
3	C. Carrigan	F	6			Steam cycle, took process samples								
4	7/1/25													
5	C. Carrigan	F	8			Backwashed Carbon Bed A, drained Carbon								
6	C. Carney	J	4			Bed A, took carbon samples - Bed A, Picked up +								
7	7/2/25					delivered								
8	C. Carrigan	F	8			Rebuilt Isco Sampler Re sealed carbon								
9	C. Carney	J	8			Bed A, changed bag filters								
10	7/3/25													
11														
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	24		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE _____ DATE _____

FIELD INSPECTOR SIGNATURE _____ DATE _____

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
July		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carrigan	F	4			Steam cycle adsorber #2, took								
2	7/7/25					Decanter + storage measurements								
3	C. Carrigan	F	8											
4	7/8/25					forklift delivery, treated BW tank, carbon								
5	C. Carrigan	F	8			delivery								
6	C. Carney	J	2											
7	7/9/25													
8	C. Carrigan	F	8			changed bag filters, changed carbon								Bed A
9	C. Carney	J	4			reworked hoses on Bed A+B								
10	7/10/25													
11	C. Carney	F	8			Process samples								
12	7/11/25													
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	36		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
July		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carney	F	2											
2	7/14/25													
3	C. Carrigan	F	2			NFWB - took Billings Samples								
4	7/15/25													
5	C. Carrigan	F	6			Quartly Samples								
6	7/16/25													
7	C. Carrigan	F	6			Quartly Samples								
8	7/17/25													
9	C. Carrigan	F	6			Changed Bag Filters								
10	7/18/25													
11														
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	22		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE

DATE

FIELD INSPECTOR SIGNATURE

DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
July		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	STRAIGHT TIME HRS	STRAIGHT TIME RATE	STRAIGHT TIME AMOUNT	TH OVERTIME HRS	TH OVERTIME RATE	TH OVERTIME AMOUNT	DT OVERTIME HRS	DT OVERTIME RATE	DT OVERTIME AMOUNT	HAZMAT QTY.	HAZMAT TH / DT	MEALS QTY.
1	C. Carrigan 7/21/25	F	4			Worked on boiler								
2														
3	C. Carrigan 7/22/25	F	2											
4														
5	C. Carrigan 7/23/25	F	6			NFWB took samples, installed new boiler element Change redux tote, DGI Lookede boiler								
6														
7	C. Carrigan 7/24/25	F	6			Pumped down BW tank, Haz waste inspection								
8														
9	C Carrigan 7/25/25	F	6			Changed bag filters								
10														
11														
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	24		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

DGI

SUPERVISOR SIGNATURE _____ DATE _____

FIELD INSPECTOR SIGNATURE _____ DATE _____

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
July/Aug		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carrigan	F	4			Cleaned Redox tank, replaced samples Hose.								
2	7/28/25					forced steam #2								
3	C. Carrigan	F	2											
4	7/29/25													
5	C. Carrigan	F	8			Monthlys - chipped up floor by								
6	C. Carney	J	8			overhead door								
7	N. Shultz	J	8											
8	7/30/31													
9	C. Carrigan	F	8			Monthlys - DGI - repaired Boiler								
10	C. Carney	J	8											
11	7/31/25													
12	C. Carrigan	F	6			charged Bag filters								
13	8/1/25													
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	28		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

DGI

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Avg		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carrigan	F	8			NFWB took billing Samples, Flushed +								
2	C. Carney	J	8			cleaned aqueous pump								chipped floor
3	8/4/25													
4	C. Carrigan	F	8			Reset Steam on adsorber #1, forced steam								
5	8/5/25					adsorber #2								
6	C. Carrigan	F	8			Forced Steam adsorber #1, pumped down BW tank								
7	8/6/25													
8	C. Carrigan	F	8			took monthly process samples, Redux notes								
9	8/7/25					delivered, worked on PW 4B								
10	C. Carrigan	F	8											
11	C. Carney	J	8			Epoxy coated floor, Changed bag filters								
12	8/8/25					pumped down PW 4B - 2nd containment								
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	40		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Aug		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carrigan	F	8			re-started chiller + steam cycle adsorbej #2								
2	C. Carney	J	4			Backwash carbon bed B								
3	8/11/25													
4	C. Carney	F	6			Flow-meter calibrated - John W, Steam								
5	8/12/25					Cycle adosber #1								
6	C. Carrigan	F	2											
7	8/13/25													
8	C. Carrigan	F	4			NFWB - Verification Samples								
9	C. Carney	J	2											
10	8/14/25													
11	C. Carrigan	F	4			NFWB - Completed verification samples								
12	C. Carney	J	2			Changed bag filters								
13	8/15/25													
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	4/8		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

Camtech

DAILY WORK REPORT

Date	PO#	CUSTOMER	PROJECT NAME
Avg		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carrigan	F	2											
2	8/18/25													
3	C. Carney	F	8			Manual			Steam Cycle					
4	8/19/25													
5	C. Carrigan	F	8			Test Patch, M+B on site for								
6	C. Carney	J	4			chiller service								
7	8/20/25													
8	C. Carrigan	F	2											
9	8/21/25													
10	C. Carrigan	F	8			M+B on site chiller Service								
11	8/22/25					Changed Bag Filter								
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	28		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Aug		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY	TH / DT	MEALS QTY.
1	C. Carrigan	F	8			steam cycle adsorber						#2		
2	8/25/25					Took monthly Process						samples		
3	C. Carrigan	F	6			Forced steam cycle adsorber #1								
4	8/26/25													
5	C. Carrigan	F	8											
6	C. Carney	J	8											
7	8/27/25					Monthly's								
8	C. Carrigan	F	8											
9	C. Carney	J	8											
10	8/28/25													
11	C. Carrigan	F	8			Removed carbon from Bed A + removed to repair								
12	C. Carney	J	8			new bed installed + piping								
13	8/29/25													
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	38		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE

DATE

FIELD INSPECTOR SIGNATURE

DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Sept		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	STRAIGHT TIME HRS	STRAIGHT TIME RATE	STRAIGHT TIME AMOUNT	TH OVERTIME HRS	TH OVERTIME RATE	TH OVERTIME AMOUNT	DT OVERTIME HRS	DT OVERTIME RATE	DT OVERTIME AMOUNT	HAZMAT QTY.	HAZMAT TH / DT	MEALS QTY.
1	C. Carrigan	F	6			Forced Steam on adsorber #2								
2	9/2/25					meeting with nathan, Dave + John								
3	C. Carrigan	F	8			NFWB - took Billing Samples, Changed redux								
4	9/3/25					tote, MANVal Steam adsorber #2, dropped of Sample								
5	C. Carrigan	F	8			repaired leak carbon Bed A, pumped down BW tank								
6	J. Kashella	J	4			worked on 29A and 18B with camera								
7	9/4/25													
8	C. Carrigan	F	6			Change Bag filters								
9	9/5/25													
10														
11														
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	28		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Sept		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carrigan	F	4			Follow up with M+B								
2	9/8/25													
3	C. Carrigan	F	6			switched to adsorber #2, backwashed								
4	J. Kashella	J	4			Carbon Bed B, shut down boiler								
5	9/9/25													
6	C. Carrigan	F	8			Took monthly Samples, M+B worked on Chiller								
7	9/10/25													
8	C. Carrigan	F	8			M+B worked on chiller, sealed manhole w/								
9	J. Kashella	J	6			Hydrilic cement, delivered samples								
10	9/11/25													
11	C. Carrigan	F	8			M+B worked on chiller, restarted boiler,								
12	9/12/25					steamed adsorber #2 w/M+B								
13						Changed bag filters								
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	34		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Sept		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carrigan	F	8			Steam cycle Adsorber #1,						weekly inspection		
2	9/15/25													
3	C. Carrigan	F	3			NFWB took billing samples, TRC on								
4	9/16/25					site Sampling								
5	C. Carrigan	F	2											
6	9/17/25													
7	C. Carrigan	F	6			Steam cycle Adsorber #2,						cleared bag lot		
8	9/18/25													
9	C. Carrigan	F	8			cleared bag lot, changed bag filters								
10	9/19/25													
11														
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	27		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Sept		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carrigan	F	8			Finished cleaning Brush, worked on Bw tank -								
2	9/22/25					treated								
3	C. Carrigan	F	4			treated Bw tank								
4	9/23/25													
5	C. Carrigan	F	6			Back washed carbon bed B								
6	C. Carney	J	4			stem cycle acrobat #2								
7	9/24/25													
8	C. Carrigan	F	2											
9	9/25/25													
10	C. Carrigan	F	8			Monthly cleaning, Changed								
11	J. Kashella	J	8			Bag filters								
12	9/26/25													
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	28		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

SUPERVISOR SIGNATURE _____ DATE _____

FIELD INSPECTOR SIGNATURE _____ DATE _____

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Sept/Oct		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH/DT	MEALS QTY.
1	C. Carrigan	F	8			Monthly			Cleaning					
2	J. Kashella	J	8											
3	9/29/25													
4	C. Carrigan	F	4			Manually started steam cycle, adsorber #2								
5	B. Forthi	J	4											
6	9/30/25													
7	C. Carrigan	F	2											
8	10/1/25													
9	C. Carrigan	F	6				pumped		down BW		tank			
10	10/2/25													
11	C. Carrigan	F	6			NFWB took billing samples								
12	10/3/25					Changed Bag filters								
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	26		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

SUPERVISOR SIGNATURE _____ DATE _____

FIELD INSPECTOR SIGNATURE _____ DATE _____

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Oct		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carrigan	F	4			Steam cycle adsorber #2								
2	10/6/25													
3	C. Carrigan	F	2											
4	10/7/25													
5	C. Carrigan	F	2											
6	10/8/25													
7	C. Carrigan	F	4			Worked on take off						for Shutdown		
8	10/9/25													
9	C. Carrigan	F	6			Changed Bag filters								
10	10/10/25													
11														
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	18		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

SUPERVISOR SIGNATURE Cristin Carrigan DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Oct		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carrigan	F	8			Pulled PW			5B - new pump/meter					
2	B. Fortini	J	4											
3	R Crossley	J	4											
4	10/13/25													
5	C. Carrigan	F	6			Quarterly			Sampling					
6	10/14/25													
7	C. Carrigan	F	8			Pulled + Replaced PW8B								
8	J. Kashella	J	8											
9	10/15/25													
10	C. Carrigan	F	6			Pumped down BW tank								
11	10/16/25													
12	C. Carrigan	F	8			Backwashed			Carbon Bed B					
13	B. Fortini	J	4			DGI - Investigated SB								
14	10/17/25													

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	36		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
2	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

DGI

SUPERVISOR SIGNATURE _____ DATE _____

FIELD INSPECTOR SIGNATURE _____ DATE _____

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
oct		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carney	F	2											
2	10/20/25													
3	C. Carney	F	2											
4	10/21/25													
5	R. Crossley	F	8			Pulled Pump 8B, Changed out motor in wire								
6	B. Fortini	J	8											
7	10/22/25													
8	C. Carney	F	2											
9	10/23/25													
10	C. Carney	F	8			Process backwash, Change bag filters								
11	10/24/25													
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	22		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
1	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Oct		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	STRAIGHT TIME HRS	STRAIGHT TIME RATE	STRAIGHT TIME AMOUNT	TH OVERTIME HRS	TH OVERTIME RATE	TH OVERTIME AMOUNT	DT OVERTIME HRS	DT OVERTIME RATE	DT OVERTIME AMOUNT	HAZMAT QTY.	HAZMAT TH / DT	MEALS QTY.
1	C. Carney	F	2											
2	10/27/25													
3	C. Carney	F	6				Quartly			Samples				
4	10/28/25													
5	C. Carney	F	6				Quartly			Samples				
6	B. Fortini	J	4				Redux			change				
7	10/29/25													
8	C. Carney	F	8											
9	B. Fortini	J	8											
10	10/30/25						Monthly's							
11	C. Carney	F	8											
12	B. Fortini	J	8											
13	10/31/25													
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	30		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Nov		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carney	F	6			Change			bag filters					
2	11/3/25													
3	C. Carney	F	2											
4	11/4/25													
5	C. Carney	F	4			Redux tote delivery +						fork truck		
6	11/5/25													
7	C. Carney	F	2											
8	11/6/25													
9	C. Carney	F	6			Bag filters change								
10	11/7/25													
11														
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	20		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

week 1

Date	PO#	CUSTOMER	PROJECT NAME
NOV		TRC	Shutdown

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carney	F	8											
2	M. Failing	J	8											
3	B. Fortini	J	8											
4	J. Kashella	J	8											
5	11/10/25													
6	C. Carney	F	8											
7	R. Crossley	J	8											
8	B. Fortini	J	8											
9	J. Kashella	J	8											
10	11/11/25													
11	C. Carney	F	8											
12	R. Crossley	J	8											
13	B. Fortini	J	8											
14	11/12/25													

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	24		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

Shutdown

SUB CONTRACTORS

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

week 1

Date	PO#	CUSTOMER	PROJECT NAME
Nov			Shutdown

	EMPLOYEE	STRAIGHT TIME TL	STRAIGHT TIME HRS	STRAIGHT TIME RATE	STRAIGHT TIME AMOUNT	TH OVERTIME HRS	TH OVERTIME RATE	TH OVERTIME AMOUNT	DT OVERTIME HRS	DT OVERTIME RATE	DT OVERTIME AMOUNT	HAZMAT QTY.	HAZMAT TH / DT	MEALS QTY.
1	C. Carney	F	8											
2	M. Failing	J	8											
3	B. Fortini	J	8											
4	11/13/25													
5	C. Carney	F	8											
6	M. Failing	J	8											
7	B. Fortini	J	8											
8	11/14/25													
9														
10														
11														
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	16		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

Shutdown

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Week 2

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
NOV		TRC	Shutdown

	EMPLOYEE	STRAIGHT TIME				TH OVERTIME			DT OVERTIME			HAZMAT		MEALS
		TL	HRS	RATE	AMOUNT	HRS	RATE	AMOUNT	HRS	RATE	AMOUNT	QTY.	TH / DT	QTY.
1	C. Carney	F	8											
2	D. Devlin	J	8											
3	M. Failing	J	8											
4	B. Fortini	J	8											
5	11/17/25													
6	C. Carney	F	8											
7	R. Crossley	J	8											
8	D. Devlin	J	8											
9	D. DAY	J	8											
10	11/18													
11	C. Carney	F	8											
12	D. DAY	J	8											
13	D. Devlin	J	8											
14	M. Failing	J	8	11/19/25										

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	24		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

Shutdown

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

Camtech

DAILY WORK REPORT

Week 2

Date	PO#	CUSTOMER	PROJECT NAME
Nov		TRC	Shutdown

	EMPLOYEE	STRAIGHT TIME				TH OVERTIME			DT OVERTIME			HAZMAT		MEALS
		TL	HRS	RATE	AMOUNT	HRS	RATE	AMOUNT	HRS	RATE	AMOUNT	QTY.	TH / DT	QTY.
1	C. Carney	F	8											
2	D. Day	J	8											
3	D. Devlin	J	8											
4	M. Failing	J	8											
5	11/20/25													
6	C. Carney	F	8											
7	R. Crossley	J	8											
8	D. Day	J	8											
9	D. Devlin	J	8											
10	11/21/25													
11														
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	16		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

Shut down

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
AOV		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	STRAIGHT TIME HRS	STRAIGHT TIME RATE	STRAIGHT TIME AMOUNT	TH OVERTIME HRS	TH OVERTIME RATE	TH OVERTIME AMOUNT	DT OVERTIME HRS	DT OVERTIME RATE	DT OVERTIME AMOUNT	HAZMAT QTY.	HAZMAT TH / DT	MEALS QTY.
1	C. Carney	F	8			valve WA			IL inspection			leak test		
2	B. Fortini	J	8											
3	11/24/25													
4	C. Carney	F	8			Boiler Repair,								
5	M. Failing	J	4			Meter recalibration								
6	11/25/25													
7	C. Carney	F	2											
8	11/26/25													
9														
10														
11														
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	18		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

SUPERVISOR SIGNATURE

12/18/25

DATE

FIELD INSPECTOR SIGNATURE

DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Dec		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carney	F	8			Steam Cycle								
2	12/1/25													
3	C. Carney	F	8											
4	B. Fortini	J	8			Backwash and Decanter work								
5	12/2/25													
6	C. Carney	F	2											
7	12/3/25													
8	B Fortini	F	2											
9	12/4/25													
10	C. Carney	F	8			Changed bag filter, Sampling BHC								
11	B. Fortini	J	8											
12	12/5/25													
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	28		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

SUPERVISOR SIGNATURE

12/18/25
DATE

FIELD INSPECTOR SIGNATURE

DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Dec		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	STRAIGHT TIME HRS	STRAIGHT TIME RATE	STRAIGHT TIME AMOUNT	TH OVERTIME HRS	TH OVERTIME RATE	TH OVERTIME AMOUNT	DT OVERTIME HRS	DT OVERTIME RATE	DT OVERTIME AMOUNT	HAZMAT QTY.	HAZMAT TH / DT	MEALS QTY.
1	B. Fortini	F	2											
2	12/8/25													
3	B. Fortini	F	2											
4	12/9/25													
5	C. Carney	F	8			pump pull			2B					
6	M. Failing	J	8											
7	12/10/25													
8	C. Carney	F	8			worked on pump 2B						Diagnostic		
9	B. Fortini	J	8											
10	12/11/25													
11	C. Carney	F	8											
12	B. Fortini	J	8			Installed			and Fixed			pump 2B		
13	12/12/25													
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	28		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
1	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE

12/18/25
DATE

FIELD INSPECTOR SIGNATURE

DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Dec		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carney	F	4				Carbon		delivery					
2	12/15/25													
3	C. Carney	F	6				Lead Bed "B"		Drain					
4	12/16/25													
5	C. Carney	F	6				Carbon		Bed received					
6	12/17/25													
7	C. Carney	F	2											
8	12/18/25													
9	C. Carney	F	2											
10	12/19/25													
11														
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	20		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

SUPERVISOR SIGNATURE _____ DATE _____

FIELD INSPECTOR SIGNATURE _____ DATE _____

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Dec		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carney	F	2											
2	12/22/25													
3	R. Crossley	F	8			Pump Pull				2B -				
4	B. Fortini	J	8							System Down				
5	12/23/25													
6	R Crossley	F	8			Leak Taped				System				
7	B Fortini	J	8				turned		back	on				
8	12/24/25													
9														
10														
11														
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	18		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
1	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE _____ DATE _____

FIELD INSPECTOR SIGNATURE _____ DATE _____

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Dec/Jan		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	STRAIGHT TIME HRS	STRAIGHT TIME RATE	STRAIGHT TIME AMOUNT	TH OVERTIME HRS	TH OVERTIME RATE	TH OVERTIME AMOUNT	DT OVERTIME HRS	DT OVERTIME RATE	DT OVERTIME AMOUNT	HAZMAT QTY.	HAZMAT TH / DT	MEALS QTY.
1	R. Crossley	F	8			welded	10" pipe	for air stripper						
2	D. Day	J	8											
3	12/29/25													
4	R. Crossley	F	8			Sand	Carbon	VAC. -	out					
5	D. Day	J	8			welded	10"	pipe for	Air	Stripper				
6	12/30/25													
7	R. Crossley	F	8			welded	10"	pipe for	air	stripper				
8	D. Day	J	8											
9	12/31/25													
10	R. Crossley	F	8			Installed	10"	pipe						
11	C. Carney	J	8											
12	1/2/26													
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	32		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE _____ DATE _____

FIELD INSPECTOR SIGNATURE _____ DATE _____

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
JAN		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	STRAIGHT TIME HRS	STRAIGHT TIME RATE	STRAIGHT TIME AMOUNT	TH OVERTIME HRS	TH OVERTIME RATE	TH OVERTIME AMOUNT	DT OVERTIME HRS	DT OVERTIME RATE	DT OVERTIME AMOUNT	HAZMAT QTY.	HAZMAT TH / DT	MEALS QTY.
1	C. Carney	F	2											
2	1/5/26													
3	C. Carney	F	8			Bag filter, Redux Change								
4	B. Fortini	J	8				Carbon load							
5	1/6/26													
6	C. Carney	F	2											
7	1/7/26													
8	C. Carney	F	8			24 hr sample Quartly								
9	1/8/26													
10	R. Crossley	F	8			24hr Sample								
11	B. Fortini	J	8			Pump Pull 6B								
12	C. Carney	J	6											
13	1/9/26													
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	28		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
1	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE

DATE

FIELD INSPECTOR SIGNATURE

DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
JAN		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	STRAIGHT TIME HRS	STRAIGHT TIME RATE	STRAIGHT TIME AMOUNT	TH OVERTIME HRS	TH OVERTIME RATE	TH OVERTIME AMOUNT	DT OVERTIME HRS	DT OVERTIME RATE	DT OVERTIME AMOUNT	HAZMAT QTY.	HAZMAT TH / DT	MEALS QTY.
1	C. Carney	F	2											
2	1/12/26													
3	C. Carney	F	2											
4	1/13/26													
5	C. Carney	F	8			Pump Pull 2B Niagara Falls								
6	B. Fortini	F	8			Water Board Sample								
7	1/14/26													
8	C. Carney	F	4			Niagara Falls Water Board sample								
9	1/15/26													
10	C. Carney	F	8			Install Chemical Flowmeter								
11	K. Kloepher	J	6			Diagnose Steam								
12	1/16/26													
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	24		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
1	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG
O+M

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
JAN		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	STRAIGHT TIME HRS	STRAIGHT TIME RATE	STRAIGHT TIME AMOUNT	TH OVERTIME HRS	TH OVERTIME RATE	TH OVERTIME AMOUNT	DT OVERTIME HRS	DT OVERTIME RATE	DT OVERTIME AMOUNT	HAZMAT QTY.	HAZMAT TH / DT	MEALS QTY.
1	B. Fortini	F	2											
2	1/19/26													
3	C. Carney	F	6			Change bag filters								
4	1/20/26													
5	C. Carney	F	4				DGI on site							
6	1/21/26													
7	C. Carney	F	8			Boiler Diagnostic								
8	1/22/26													
9	C. Carney	F	2											
10	1/23/26													
11														
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	22		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
JAN		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carney	F	8			Full maintenance.								
2	1/26/26													
3	C. Carney	F	8			Boiler Dingnostic								
4	1/27/26													
5	C. Carney	F	2											
6	1/28/26													
7	C. Carney	F	8											
8	B. Fortini	J	8											
9	1/29/26						Monthly's							
10	C. Carney	F	8											
11	B. Fortini	J	8											
12	1/30/26													
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	34		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Feb		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	STRAIGHT TIME HRS	STRAIGHT TIME RATE	STRAIGHT TIME AMOUNT	TH OVERTIME HRS	TH OVERTIME RATE	TH OVERTIME AMOUNT	DT OVERTIME HRS	DT OVERTIME RATE	DT OVERTIME AMOUNT	HAZMAT QTY.	HAZMAT TH / DT	MEALS QTY.
1	C. Carney	F	8			System Repair								
2	2/2/26													
3	C. Carney	F	6			Maintenance of system								
4	2/3/26													
5	C. Carney	F	2											
6	2/4/26													
7	C. Carney	F	2											
8	2/5/26													
9	C. Carney	F	2											
10	2/6/26													
11														
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	20		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Feb		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carney	F	2											
2	2/9/26													
3	C. Carney	F	2											
4	2/10/26													
5	C. Carney	F	4			Turboid Delivery								
6	2/11/26													
7	C. Carney	F	6			Backwash Process								
8	2/12/26													
9	C. Carney	F	8			Change Bag filters + Backwash								
10	B. Fortini	J	4											
11	2/13/26													
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	22		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Feb		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	B. Fortini	F	4			Turbo stripper Floats						Cleaned		
2	2/16/26													
3	B. Fortini	F	2											
4	2/17/26													
5	B. Fortini	F	4			Floats clean								
6	2/18/26													
7	B. Fortini	F	2											
8	2/19/26													
9	B. Fortini	F	6			Bag filter change								
10	2/20/26													
11														
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	16		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE

DATE

FIELD INSPECTOR SIGNATURE

DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
Feb		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH/DT	MEALS QTY.
1	C. Carney	F	2			System down - Diagnosis								
2	2/23/26													
3	C. Carney	F	6			pump Diagnosis - system down								
4	B. Fortini	J	6											
5	2/24/26													
6	C. Carney	F	8			pump assembly for air stripper								
7	B. Fortini	J	8											
8	2/25/26													
9	R. Crossley	F	8											
10	B. Fortini	J	8			monthly's								
11	2/26/26													
12	R. Crossley	F	8											
13	B. Fortini	J	8											
14	2/27/26													

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	32		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
March		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carney	F	8			Forced Steam cycle								
2	3/2/26													
3	C. Carney	F	8			Steam Maintenance,							Pump	
4	B. Fortini	J	8			replacement, Solenoid							Diagnosis	
5	3/3/26													
6	R. Crosby	F	8			pump SB pull								
7	B. Fortini	J	8											
8	3/4/26													
9	C. Carney	F	2											
10	3/5/26													
11	C. Carney	F	8			Manual			Steam cycle					
12	B. Fortini	J	8											
13	3/6/26													
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	34		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
1	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

MATERIAL

WORK LOG

O+M

SUB CONTRACTORS

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
March		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carney	F	6			Manual			Steam					
2	3/9/26													
3	C. Carney	F	8			Back Wash + Process								
4	3/10/26													
5	C. Carney	F	8			Redux tote off/on + Swap								
6	B. Fortini	J	8			Process Sampling								
7	3/11/26													
8	C. Carney	F	6			Manual			Steam					
9	3/12/26													
10	C. Carney	F	2											
11	3/13/26													
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	30		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

Camtech

DAILY WORK REPORT

Date	PO#	CUSTOMER	PROJECT NAME
March		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	B. Fortini	F	4			Fridge tube Sampling						Replacement		
2	3/16/26													
3	C. Carney	F	2											
4	3/17/26													
5	C. Carney	F	2											
6	3/18/26													
7	B. Fortini	F	4			Wired Solenoid Valves								
8	3/19/26													
9	R. Crossley	F	8			Pump pull transducer			6B + 8B	Level Diagnostic		Switch		
10	C. Carney	J	6											
11	3/20/26													
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	20		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
1	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
March		TRC	O+M

	EMPLOYEE	STRAIGHT TIME TL	HRS	RATE	AMOUNT	TH OVERTIME HRS	RATE	AMOUNT	DT OVERTIME HRS	RATE	AMOUNT	HAZMAT QTY.	TH / DT	MEALS QTY.
1	C. Carney	F	8			Monthlies								
2	D. Day	J	8											
3	3/23/26													
4	C. Carney	F	8			10" Flange			demo / System down					
5	B. Fortini	J	4											
6	3/24/26													
7	D. Day	F	8			10" Flange			demo + install					
8	M. Failing	J	6			Chiller Diagnostic / Repair								
9	3/25/26													
10	D. Day	F	8			10" Flange			demo + install					
11	M. Failing	J	8											
12	3/26/26													
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
	PICK-UP TRUCK			20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
March		TRC	O+M

EMPLOYEE	STRAIGHT TIME				TH OVERTIME			DT OVERTIME			HAZMAT		MEALS
	TL	HRS	RATE	AMOUNT	HRS	RATE	AMOUNT	HRS	RATE	AMOUNT	QTY.	TH / DT	QTY.
1 D. Day	F	8				10"	Flange	Fabricated			&	installed	
2 M. Failing	J	8											
3 3/27/26													
4													
5													
6													
7													
8													
9													
10													
11													
12													
13													
14													

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
1	PICK-UP TRUCK	40		20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE DATE

FIELD INSPECTOR SIGNATURE DATE

DAILY WORK REPORT

Camtech

Date	PO#	CUSTOMER	PROJECT NAME
March		TRC	O+M

	EMPLOYEE	STRAIGHT TIME				TH OVERTIME			DT OVERTIME			HAZMAT		MEALS
		TL	HRS	RATE	AMOUNT	HRS	RATE	AMOUNT	HRS	RATE	AMOUNT	QTY.	TH / DT	QTY.
1	M. Failing	F	8			System down								
2	D. Day	J	8			Maintenance + Repair								
3	3/30/26													
4	M. Failing	F	8			Maintenance + Repair								
5	D. Day	J	8											
6	3/31/26													
7														
8														
9														
10														
11														
12														
13														
14														

QTY.	EQUIPMENT USED	UNIT	QTY.	EQUIPMENT USED	UNIT
	PICK-UP TRUCK			20" SCISSOR LIFT	
	ELECTRIC WELDER			30" SCISSOR LIFT	
	HELI ARC			CUTTING TOURCH	
	HILTI HAMMER DRILL			CUTTING WHEEL	
	SAFETY HARNESS			SM. SEWER M/C	
	2" ELECTRIC PUMP			LG. SEWER M/C	
	PIPE THREADER			CORE BORE	
	PORTA BAND SAW			PRESTOLITE SET-UP	
	GAS WELDER			2" GAS PUMP	
	ROUSTABOUT			RETRIEVAL DEVICE	
	GENERATOR			CHAIN HOIST	
	1-2" PRO PRESS			CHAIN CUTTERS	
	2-6" PRO PRESS			COME-ALONG	
	BREATHING AIR			MAG DRILL	
	14" CUT-OFF SAW			TRAILER	
	OTHER			SM. BUTT FUSION M/C	
	OTHER			LG. BUTT FUSION M/C	

SUB CONTRACTORS

MATERIAL

WORK LOG

O+M

SUPERVISOR SIGNATURE DATE


FIELD INSPECTOR SIGNATURE DATE

Solvent Chemical Health, Safety, Site Semi-Annual Inspection

March 25, 2026

3/25/2026, 8:24:50 PM UTC



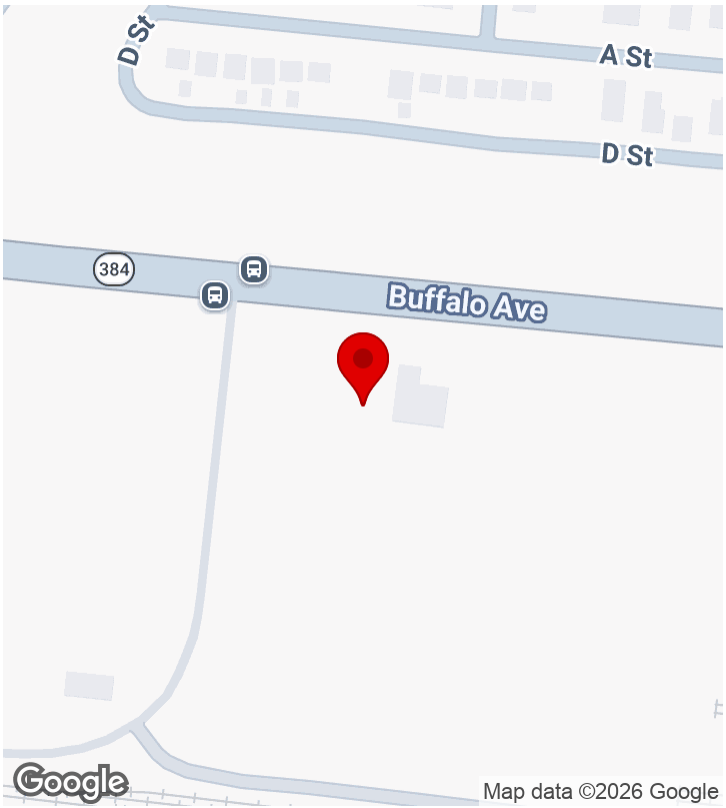

CREATED

3/25/2026, 5:59:52 PM UTC
by John Ayarik

UPDATED

3/25/2026, 8:24:50 PM UTC
by John Ayarik

LOCATION

43.082134, -79.023082

PROJECT

No Project

ASSIGNED TO

No Assignment

Date of Inspection	March 25, 2026
Inspected By	John Ayarik

Exterior

Front Gate Closed and Locked?

gate yes / no / not applicable	Yes
Gate Action Required?	No
Gate Corrective Action Needed	

Gate Photos







Is the Fire Department Alert Tag (Alert No. 2738) present on the Main Gate?

gate fire yes / no / not applicable	Yes
gate fire Action Required?	No
gate fire Corrective Action Needed	

gate fire Photos





Main Gate: Is the physical address of the site posted on the Main Gate?

gate address yes / no / not applicable	Yes
gate address Action Required?	No
gate address Corrective Action Needed	

gate address Photos





Is there corrosion/damage to front gate/lock?

Corrosion yes / no / not applicable	No
Corrosion Action Required?	No
Corrosion Corrective Action Needed	

Corrosion Photos




Is there damage to the perimeter fence?

Perimeter yes / no / not applicable	No
Perimeter Action Required?	No
Perimeter Corrective Action Needed	

Perimeter Photos









Back gate closed and locked?

Back Gate yes / no / not applicable	Yes
Back Gate Action Required?	No
Back Gate Corrective Action Needed	
Back Gate Photos	







Is there corrosion/damage to back gate/lock?

Back Gate Corrosion yes / no / not applicable	No
Back Gate Corrosion Action Required?	No
Back Gate Corrosion Corrective Action Needed	
Back Gate Corrosion Photos	

Any damage to paved driveway?

driveway yes / no / not applicable	No
driveway Action Required?	No
driveway Corrective Action Needed	
driveway Photos	







Any damage to entrance/parking lot lighting?

parking lighting yes / no / not applicable	No
parking lighting Action Required?	No
parking lighting Corrective Action Needed	

parking lighting Photos







Any damage to gravel access road (i.e. excessive potholes or washed out areas)?

potholes yes / no / not applicable	No
potholes Action Required?	No
potholes Corrective Action Needed	
potholes Photos	







Any eroded areas visually evident and in need of repair?

eroded area yes / no / not applicable	No
eroded area Action Required?	No
eroded area Corrective Action Needed	

eroded area Photos

Any ponded water onsite? If yes, any evidence of mosquito larvae?

ponded yes / no / not applicable	No
ponded Action Required?	No
ponded Corrective Action Needed	

ponded Photos




Any bare areas (absent of vegetation) on Site?

bare area yes / no / not applicable	No
bare area Action Required?	No
bare area Corrective Action Needed	

bare area Photos

Site Photo - South






Site Photo - north





Enclosures

Any damage to trench well enclosures?

enclosure damage yes / no / not applicable	No
enclosure damage Action Required?	No
enclosure damage Corrective Action Needed	

enclosure damage Photos


DANGER
PERMIT REQUIRED
CONFINED SPACE
DO NOT ENTER




DANGER
PERMIT REQUIRED
CONFINED SPACE
DO NOT ENTER




DANGER
PERMIT REQUIRED
CONFINED SPACE
DO NOT ENTER




DANGER
PERMIT REQUIRED
CONFINED SPACE
DO NOT ENTER



Any damage to monitoring/observation wells?

well damage yes / no / not applicable	No
well damage Action Required?	No
well damage Corrective Action Needed	
well damage Photos	

Any damage to pumping well manholes?

manhole damage yes / no / not applicable	No
manhole damage Action Required?	No
manhole damage Corrective Action Needed	
manhole damage Photos	

Are the markings "Confined Space" present and legible on all covers of the extraction well sumps?

confined space yes / no / not applicable	Yes
confined space Action Required?	No
confined space Corrective Action Needed	
confined space Photos	









Any damage to electrical handholes?

Electrical manhole damage yes / no / not applicable	No
Electrical manhole damage Action Required?	No
Electrical manhole damage Corrective Action Needed	

Electrical manhole damage Photos





Any damage to combined inlet (CI) F-2 or F-3?

inlet F-2 yes / no / not applicable	No
inlet F-3 yes / no / not applicable	No
inlet F-2 or F-3 Action Required?	No
inlet F-2 or F-3 Corrective Action Needed	

inlet F-2 Photos





inlet F-3 Photos




Any damage to drop inlets (DI) F-1 or F-4?

inlet F-1 yes / no / not applicable	No
inlet F-4 yes / no / not applicable	No
inlet F-1 or F-4 Action Required?	No
inlet F-1 Corrective Action Needed	

inlet F-1 Photos




inlet F-4 Photos





Any damage to DI E-2?

inlet E-2 yes / no / not applicable	No
inlet E-2 Action Required?	No
inlet E-2 Corrective Action Needed	

inlet E-2 Photos





Any damage to drop inlets (DI) north or south (located near access road)?

drop inlet yes / no / not applicable	No
drop inlet Action Required?	No
drop inlet Corrective Action Needed	

drop inlet Photos






Any damage to manhole (MH) G-2 or G-3?

mh g2 yes / no / not applicable	No
mh g3 yes / no / not applicable	No
mh g2 or G-3 Action Required?	No
MH G-2 or G-3 Corrective Action Needed	

mh g2 Photos





mh g3 Photos





Building Exterior

Any damage to the building exterior?

building damage yes / no / not applicable	No
building damage Action Required?	No
building damage Corrective Action Needed	

building damage Photos







Is there any damage to Building or exterior lighting?

lighting damage yes / no / not applicable	No
lighting damage Corrosion Action Required?	No

lighting damage Corrective Action Needed	

lighting damage Photos





Any exterior light bulbs burnt out?

ext bulbs out yes / no / not applicable	No
ext bulbs out Action Required?	No
ext bulbs out Corrective Action Needed	

ext bulbs out Photos






Any damage to the enclosure on the NW side of building?

NW enclosure yes / no / not applicable	No
NW enclosure Action Required?	No
NW enclosure Corrective Action Needed	

NW enclosure Photos




Any damage to the Condenser on the NW side of building?

NW condenser yes / no / not applicable	No
NW condenser Action Required?	No
NW condenser Corrective Action Needed	

NW condenser Photos






Is the SSDS fan by the NW side of building running properly?

SSDS fan yes / no / not applicable	No
SSDS Fan Action Required?	Yes
SSDS Fan Corrective Action Needed	Making an unusual noise

SSDS Fan Photos





Building Interior

Western mandoor locked?

west door yes / no / not applicable	No
west door Action Required?	No
west door Corrective Action Needed	

west door Photos




Southern mandoor locked?

south door yes / no / not applicable	Yes
south door Action Required?	No
south door Corrective Action Needed	

south door Photos




Garage doors locked?

garage door yes / no / not applicable	Yes
garage door Action Required?	No
garage door Corrective Action Needed	

garage door Photos





Is the security/alarm control panel operational and in-use?

alarm panel yes / no / not applicable	No
alarm panel Action Required?	Yes
alarm panel Corrective Action Needed	Needs repair. Not working.

alarm panel Photos









Any damage to the building interior?

interior damage yes / no / not applicable	No
interior damage Action Required?	No
interior damage Corrective Action Needed	

interior damage Photos








Any interior light bulbs burnt out?

interior bulbs yes / no / not applicable	Yes
interior bulbs Action Required?	No
interior bulbs Corrective Action Needed	One bulb replacement is needed.

interior bulbs Photos



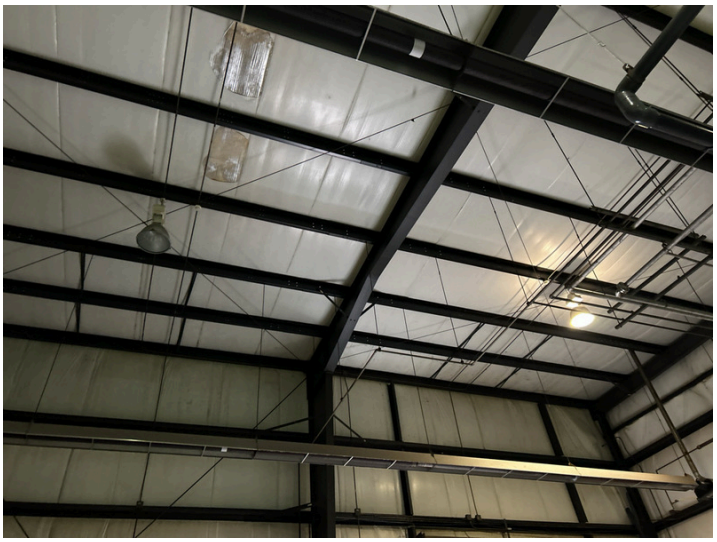



Any water in the sumps?

sump water yes / no / not applicable	Yes
sump water Action Required?	No
sump water Corrective Action Needed	

sump water Photos





Any water on the floor?

floor water yes / no / not applicable	No
floor water Action Required?	No
floor water Corrective Action Needed	

floor water Photos





Any signs of wear of the epoxy coating on the floor?

floor epoxy yes / no / not applicable	No
floor epoxy Action Required?	No
floor epoxy Corrective Action Needed	

floor epoxy Photos





Entry Doors 1, 2 & 3: Are the signs "Danger Unauthorized Personnel Keep Out" in-place and legible?

entry danger yes / no / not applicable	No
entry danger Action Required?	Yes
entry danger Corrective Action Needed	Danger sign needed on main entry door #2 on the western side.
entry danger Photos	



Entry Doors 2 & 3: Are the signs "Caution Hearing Protection Required" in-place and legible?

entry hearing yes / no / not applicable	No
entry hearing Action Required?	Yes
entry hearing Corrective Action Needed	'Caution , hearing Protection Required 'sign needed on main entry door #2 on the western side.

entry hearing Photos



Is the wall mounted tag-out holder present and sufficiently equipped?

tag-out yes / no / not applicable	N/A
tag-out Action Required?	No
tag-out Corrective Action Needed	



tag-out Photos

Are the fire extinguishers present as illustrated on the attached Site Plan and readily accessible?


fe present yes / no / not applicable	Yes
fe present Action Required?	No
fe present Corrective Action Needed	

fe present Photos



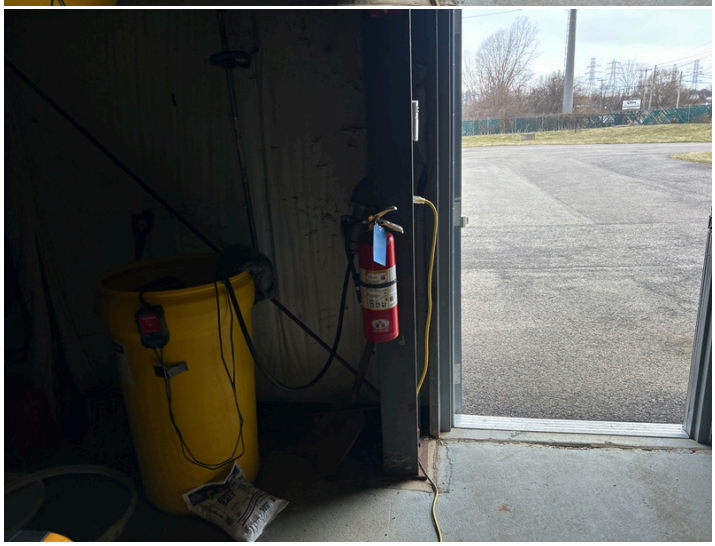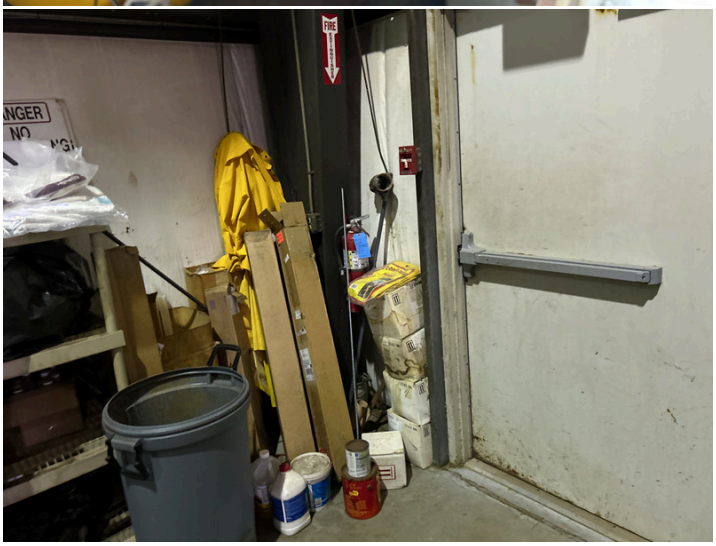




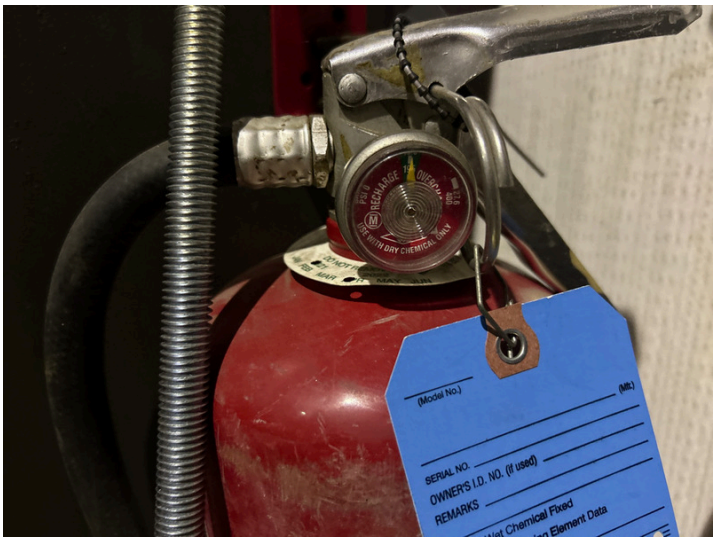

Are the fire extinguishers fully charged?

fe charged yes / no / not applicable	Yes
fe charged Action Required?	No
fe charged Corrective Action Needed	
fe charged Photos	

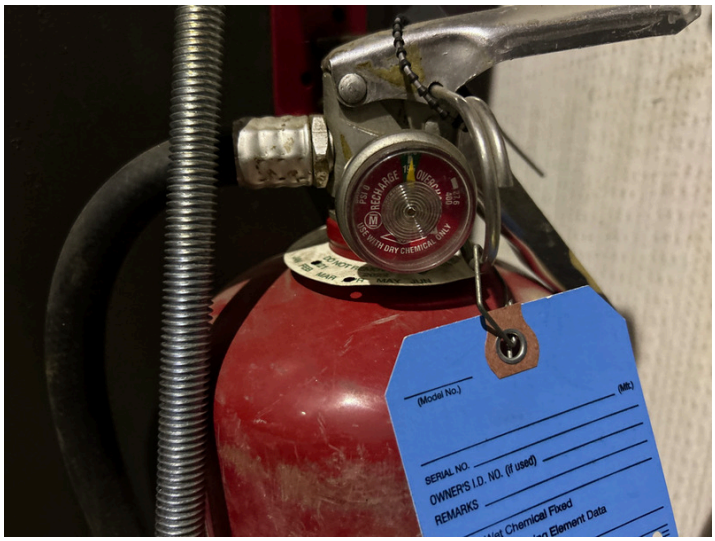




Is the floor label "Authorized Personnel Only" at the clean zone border present and legible?

clean zone yes / no / not applicable	Yes
clean zone Action Required?	No
clean zone Corrective Action Needed	

clean zone Photos

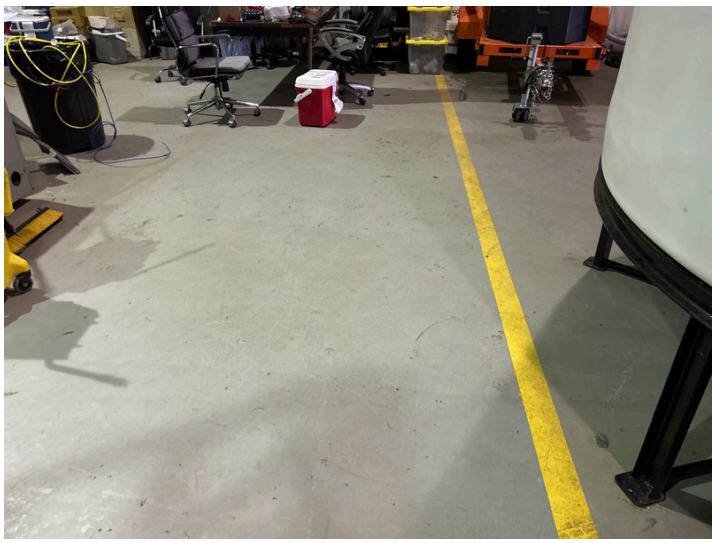






Testing vapor phase carbon inlet and outlet.

Air In Value	0
Air Out Value	0
Other Carbon Vapor Comments	
Carbon Vessel Photos	

Is the current version of the Health and Safety and Emergency Action Plan Posted in the Treatment Building?

HASP yes / no / not applicable	Yes
HASP Action Required?	No
HASP Corrective Action Needed	

HASP Photos

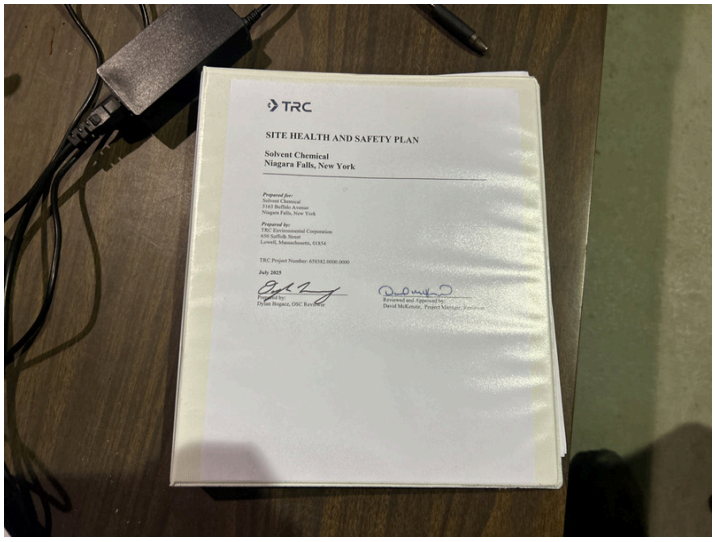

Is the first aid kit present as illustrated on the attached Site Plan and readily accessible?

aid present yes / no / not applicable	Yes
aid present Action Required?	No
aid present Corrective Action Needed	

aid present Photos



Is the first aid kit fully equipped?

aid equipped yes / no / not applicable	Yes
aid equipped Action Required?	No
aid equipped Corrective Action Needed	

aid equipped Photos





Is the eyewash station fully equipped and within its use lifespan?

eyewash equipped yes / no / not applicable	Yes
eyewash equipped Action Required?	No
eyewash equipped Corrective Action Needed	

eyewash equipped Photos



Are spill kits present as illustrated on the attached Site Plan and readily accessible?

kits present yes / no / not applicable	Yes
kits present Action Required?	No
kits present Corrective Action Needed	

kits present Photos






Are spill kits fully equipped?

kits equipped yes / no / not applicable	Yes
kits equipped Action Required?	No
kits equipped Corrective Action Needed	

kits equipped Photos





Are acid drums closed and stored within secondary containment?

acid drum yes / no / not applicable	Yes
acid drum Action Required?	No
acid drum Corrective Action Needed	

acid drum Photos





Is the acid neutralizer pail (5 gal.) present and fully equipped?

acid neutralizer yes / no / not applicable	Yes
acid neutralizer Action Required?	No
acid neutralizer Corrective Action Needed	

acid neutralizer Photos





Manifold Flow Readings

A-Zone

A-zone Flow in Gallons	0

PW-2B

2B Flow in Gallons	0

PW-3B

3B Flow in Gallons	0

PW-4B

4B Flow in Gallons	0

PW-5B

5B Flow in Gallons	0

PW-6B

6B Flow in Gallons	0

PW-7B

7B Flow in Gallons	0

PW-8B

8B Flow in Gallons	0
Manifold flow checked by	Chris Rudzinski

Building Interior XP Section

Is the satellite storage drum (XP Building) labeled for contents and dated with an accumulation start date?

satellite storage yes / no / not applicable	N/A
satellite storage Action Required?	No
satellite storage Corrective Action Needed	
satellite storage Photos	

Is the lid to the satellite storage drum securely closed?

satellite secure yes / no / not applicable	N/A
satellite secure Action Required?	No
satellite secure Corrective Action Needed	
satellite secure Photos	

Is the 600 gallon hazardous waste tank labeled for contents and dated with an accumulation start date?

haz waste label yes / no / not applicable	Yes
haz waste label Action Required?	No
haz waste label Corrective Action Needed	No Accumulation start date on tank. Repair work on system is in progress.
haz waste label Photos	





Other comments


Other Comments Text	
other comments Photos	

Solvent Chemical Health, Safety, Site Semi-Annual Inspection

September 17, 2025

9/18/2025, 6:24:06 PM UTC



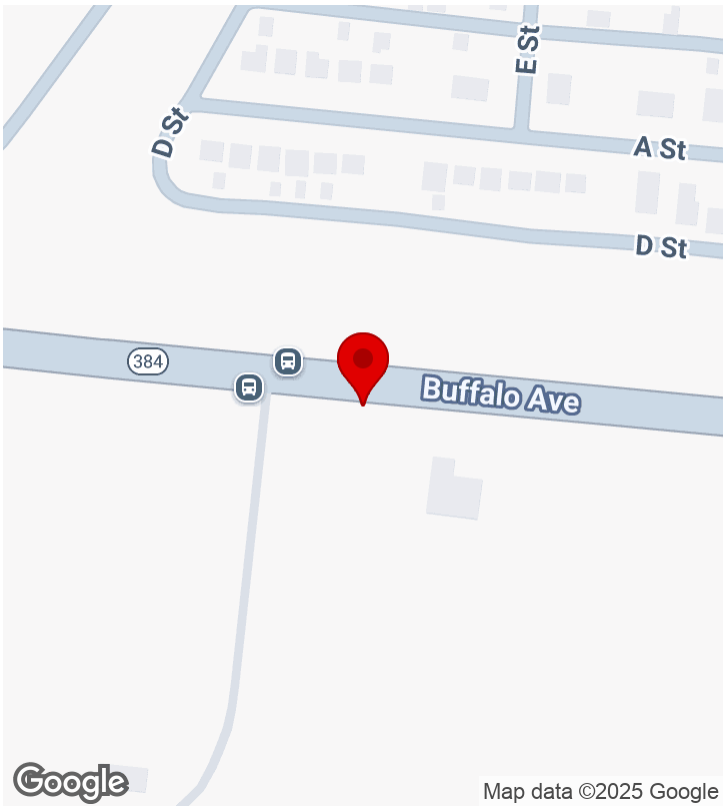

CREATED

9/17/2025, 11:37:44 AM UTC
by John Ayarik

UPDATED

9/18/2025, 6:24:06 PM UTC
by John Ayarik

LOCATION

43.082499, -79.023263

PROJECT

No Project

ASSIGNED TO

No Assignment

Date of Inspection	September 17, 2025
Inspected By	Chris Rudzinzki

Exterior

Front Gate Closed and Locked?

gate yes / no / not applicable	Yes
Gate Action Required?	No
Gate Corrective Action Needed	

Gate Photos





Is the Fire Department Alert Tag (Alert No. 2738) present on the Main Gate?

gate fire yes / no / not applicable	Yes
gate fire Action Required?	No
gate fire Corrective Action Needed	No

gate fire Photos





Main Gate: Is the physical address of the site posted on the Main Gate?

gate address yes / no / not applicable	Yes
gate address Action Required?	No
gate address Corrective Action Needed	No

gate address Photos





Is there corrosion/damage to front gate/lock?

Corrosion yes / no / not applicable	No
Corrosion Action Required?	No
Corrosion Corrective Action Needed	No

Corrosion Photos





Is there damage to the perimeter fence?

Perimeter yes / no / not applicable	No
Perimeter Action Required?	No
Perimeter Corrective Action Needed	No

Perimeter Photos












Back gate closed and locked?

Back Gate yes / no / not applicable	Yes
Back Gate Action Required?	No
Back Gate Corrective Action Needed	No

Back Gate Photos

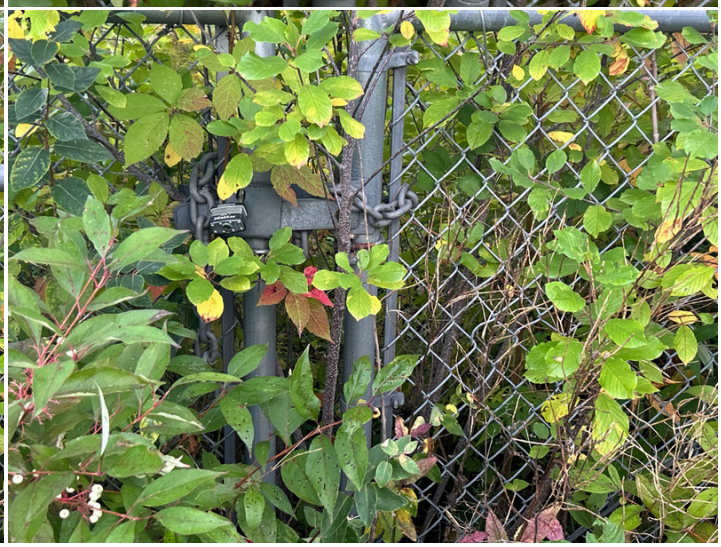


Is there corrosion/damage to back gate/lock?

Back Gate Corrosion yes / no / not applicable	No
Back Gate Corrosion Action Required?	No

Back Gate Corrosion Corrective Action Needed	No

Back Gate Corrosion Photos






Any damage to paved driveway?

driveway yes / no / not applicable	No
driveway Action Required?	No
driveway Corrective Action Needed	No

driveway Photos






Any damage to entrance/parking lot lighting?

parking lighting yes / no / not applicable	No
parking lighting Action Required?	No
parking lighting Corrective Action Needed	No

parking lighting Photos






Any damage to gravel access road (i.e. excessive potholes or washed out areas)?

potholes yes / no / not applicable	No
potholes Action Required?	No
potholes Corrective Action Needed	No

potholes Photos






Any eroded areas visually evident and in need of repair?

eroded area yes / no / not applicable	No
eroded area Action Required?	No
eroded area Corrective Action Needed	No

eroded area Photos






Any ponded water onsite? If yes, any evidence of mosquito larvae?

ponded yes / no / not applicable	No
ponded Action Required?	No
ponded Corrective Action Needed	No
ponded Photos	



Any bare areas (absent of vegetation) on Site?

bare area yes / no / not applicable	No
bare area Action Required?	No
bare area Corrective Action Needed	No

bare area Photos

Site Photo - South







Site Photo - north










Enclosures

Any damage to trench well enclosures?

enclosure damage yes / no / not applicable	No
enclosure damage Action Required?	No
enclosure damage Corrective Action Needed	No

enclosure damage Photos



























Any damage to monitoring/observation wells?

well damage yes / no / not applicable	No
well damage Action Required?	No
well damage Corrective Action Needed	No
well damage Photos	

Any damage to pumping well manholes?

manhole damage yes / no / not applicable	No
manhole damage Action Required?	No
manhole damage Corrective Action Needed	No
manhole damage Photos	

Are the markings "Confined Space" present and legible on all covers of the extraction well sumps?

confined space yes / no / not applicable	Yes
confined space Action Required?	No
confined space Corrective Action Needed	No
confined space Photos	








Any damage to electrical handholes?

Electrical manhole damage yes / no / not applicable	No
Electrical manhole damage Action Required?	No
Electrical manhole damage Corrective Action Needed	

Electrical manhole damage Photos

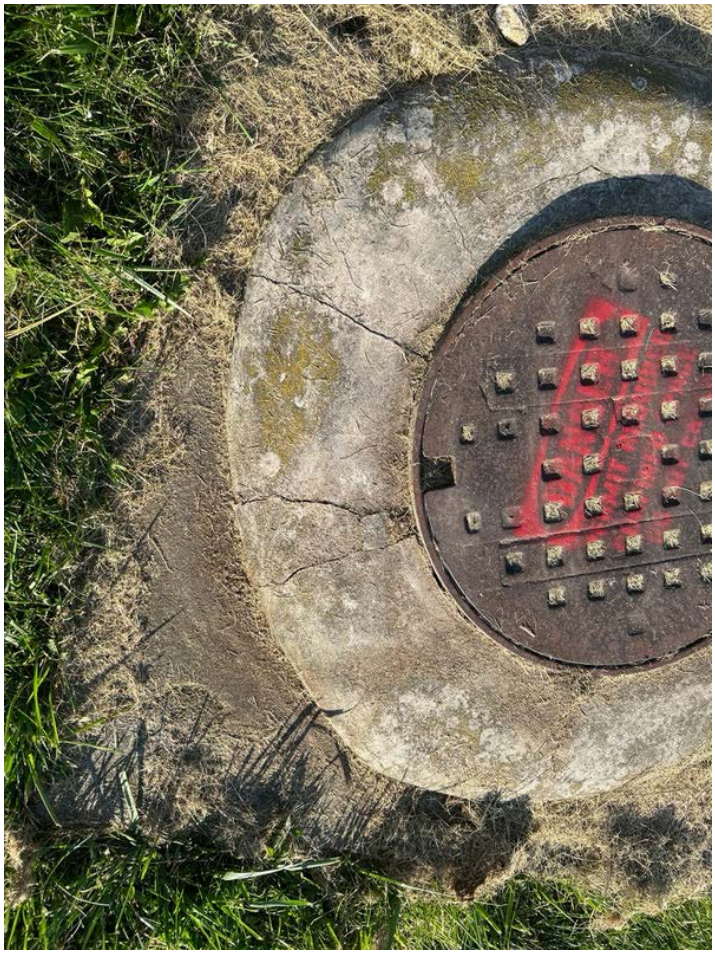






Any damage to combined inlet (CI) F-2 or F-3?

inlet F-2 yes / no / not applicable	No
inlet F-3 yes / no / not applicable	No
inlet F-2 or F-3 Action Required?	No
inlet F-2 or F-3 Corrective Action Needed	No

inlet F-2 Photos






inlet F-3 Photos





Any damage to drop inlets (DI) F-1 or F-4?

inlet F-1 yes / no / not applicable	No
inlet F-4 yes / no / not applicable	No
inlet F-1 or F-4 Action Required?	No
inlet F-1 Corrective Action Needed	No

inlet F-1 Photos





inlet F-4 Photos







Any damage to DI E-2?

inlet E-2 yes / no / not applicable	No
inlet E-2 Action Required?	No
inlet E-2 Corrective Action Needed	No

inlet E-2 Photos







Any damage to drop inlets (DI) north or south (located near access road)?

drop inlet yes / no / not applicable	No
drop inlet Action Required?	No
drop inlet Corrective Action Needed	No

drop inlet Photos



Any damage to manhole (MH) G-2 or G-3?

mh g2 yes / no / not applicable	No
mh g3 yes / no / not applicable	No
mh g2 or G-3 Action Required?	No
MH G-2 or G-3 Corrective Action Needed	No

mh g2 Photos




mh g3 Photos





Building Exterior

Any damage to the building exterior?

building damage yes / no / not applicable	No

building damage Action Required?	No
building damage Corrective Action Needed	No
building damage Photos	

Is there any damage to Building or exterior lighting?

lighting damage yes / no / not applicable	No
lighting damage Corrosion Action Required?	No
lighting damage Corrective Action Needed	No
lighting damage Photos	

Any exterior light bulbs burnt out?

ext bulbs out yes / no / not applicable	No
ext bulbs out Action Required?	No
ext bulbs out Corrective Action Needed	No

ext bulbs out Photos







Any damage to the enclosure on the NW side of building?

NW enclosure yes / no / not applicable	No
NW enclosure Action Required?	No
NW enclosure Corrective Action Needed	No

NW enclosure Photos












Any damage to the Condenser on the NW side of building?

NW condenser yes / no / not applicable	No
NW condenser Action Required?	No
NW condenser Corrective Action Needed	No

NW condenser Photos

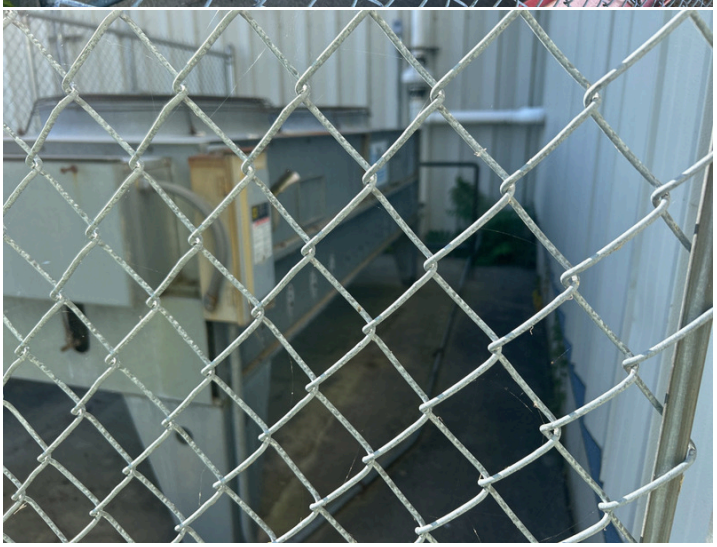

Is the SSDS fan by the NW side of building running properly?

SSDS fan yes / no / not applicable	Yes
SSDS Fan Action Required?	No
SSDS Fan Corrective Action Needed	No
SSDS Fan Photos	








Building Interior

Western mandoor locked?

west door yes / no / not applicable	Yes

west door Action Required?	Yes
west door Corrective Action Needed	One of the doors (on the right side) is going to be replaced in a couple of weeks.

west door Photos





Southern mandoor locked?

south door yes / no / not applicable	Yes
south door Action Required?	No
south door Corrective Action Needed	No

south door Photos





Garage doors locked?

garage door yes / no / not applicable	Yes
garage door Action Required?	No
garage door Corrective Action Needed	No

garage door Photos




Is the security/alarm control panel operational and in-use?

alarm panel yes / no / not applicable	No
alarm panel Action Required?	Yes
alarm panel Corrective Action Needed	Needs to be fixed. Not working

alarm panel Photos







Any damage to the building interior?

interior damage yes / no / not applicable	No
interior damage Action Required?	No
interior damage Corrective Action Needed	No

interior damage Photos








Any interior light bulbs burnt out?

interior bulbs yes / no / not applicable	No
interior bulbs Action Required?	No
interior bulbs Corrective Action Needed	No

interior bulbs Photos










Any water in the sumps?

sump water yes / no / not applicable	No
sump water Action Required?	No
sump water Corrective Action Needed	No

sump water Photos

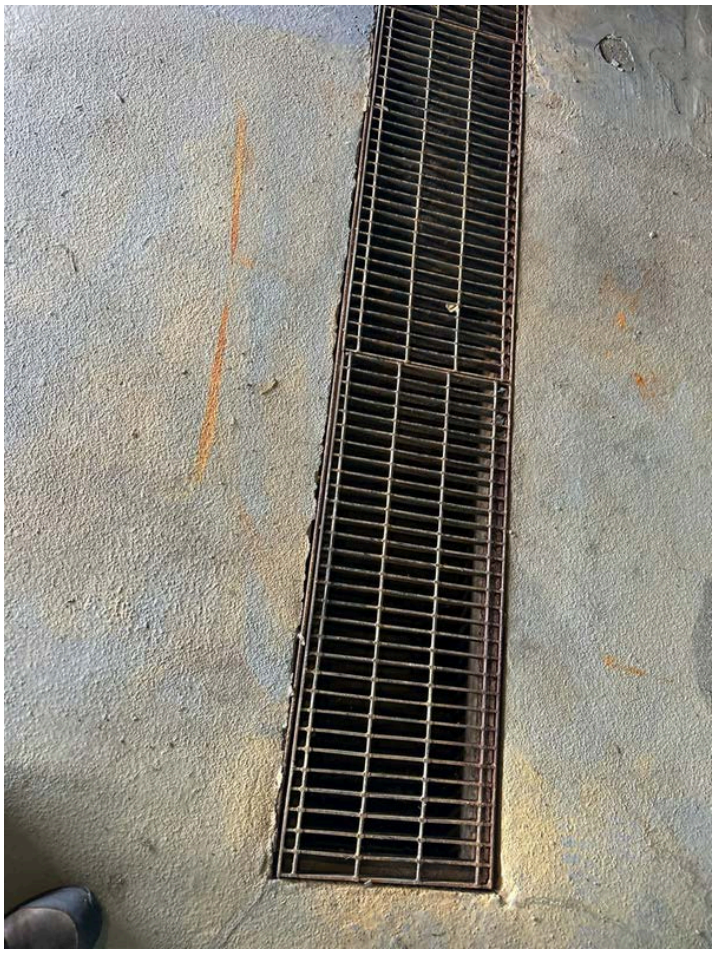



Any water on the floor?

floor water yes / no / not applicable	No
floor water Action Required?	No
floor water Corrective Action Needed	No

floor water Photos






Any signs of wear of the epoxy coating on the floor?

floor epoxy yes / no / not applicable	No
floor epoxy Action Required?	No
floor epoxy Corrective Action Needed	No

floor epoxy Photos








Entry Doors 1, 2 & 3: Are the signs "Danger Unauthorized Personnel Keep Out" in-place and legible?

entry danger yes / no / not applicable	Yes
entry danger Action Required?	No
entry danger Corrective Action Needed	No

entry danger Photos



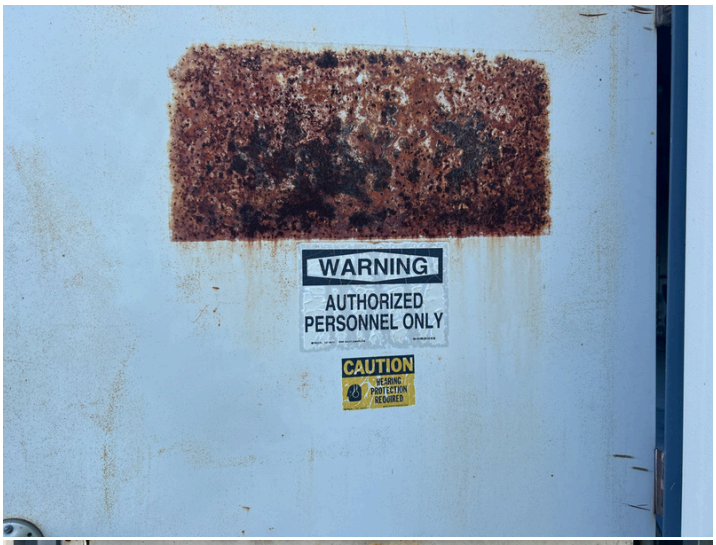





Entry Doors 2 & 3: Are the signs "Caution Hearing Protection Required" in-place and legible?

entry hearing yes / no / not applicable	Yes
entry hearing Action Required?	No
entry hearing Corrective Action Needed	No

entry hearing Photos





Is the wall mounted tag-out holder present and sufficiently equipped?

tag-out yes / no / not applicable	N/A
tag-out Action Required?	No
tag-out Corrective Action Needed	No
tag-out Photos	


Are the fire extinguishers present as illustrated on the attached Site Plan and readily accessible?

fe present yes / no / not applicable	Yes
fe present Action Required?	No
fe present Corrective Action Needed	No

fe present Photos





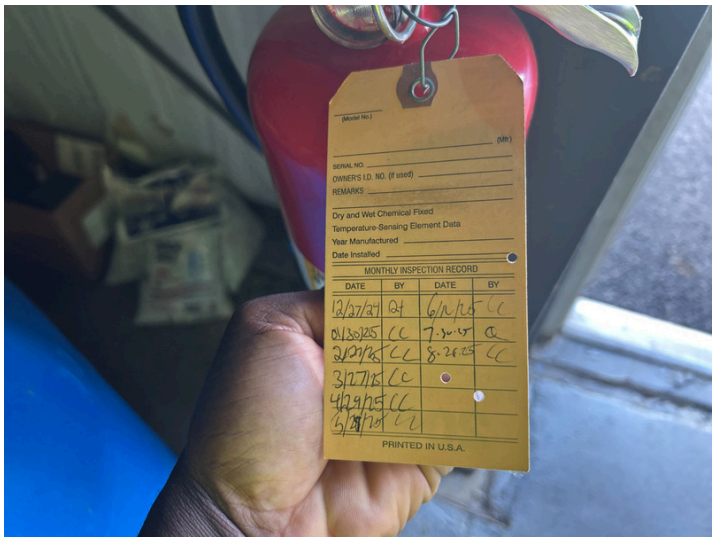

Are the fire extinguishers fully charged?

fe charged yes / no / not applicable	Yes
fe charged Action Required?	No
fe charged Corrective Action Needed	No

fe charged Photos





Is the floor label "Authorized Personnel Only" at the clean zone border present and legible?

clean zone yes / no / not applicable	Yes
clean zone Action Required?	No
clean zone Corrective Action Needed	No

clean zone Photos








Testing vapor phase carbon inlet and outlet.

Air In Value	126
Air Out Value	33
Other Carbon Vapor Comments	AD1 absorbing 6 hours.

Carbon Vessel Photos









Is the current version of the Health and Safety and Emergency Action Plan Posted in the Treatment Building?

HASP yes / no / not applicable	Yes
HASP Action Required?	No
HASP Corrective Action Needed	No

HASP Photos

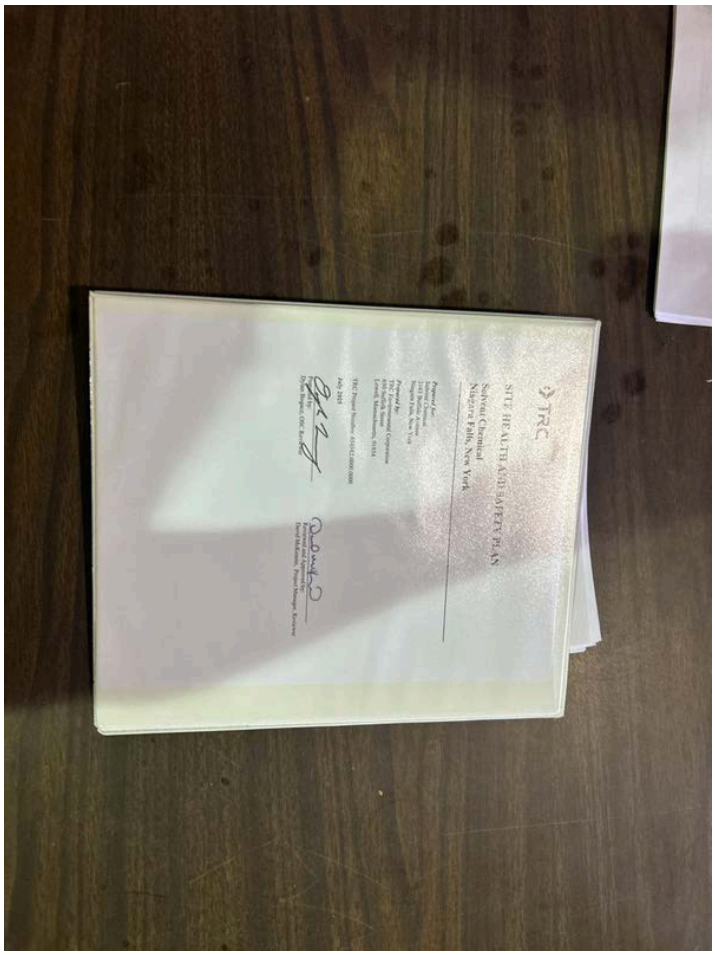

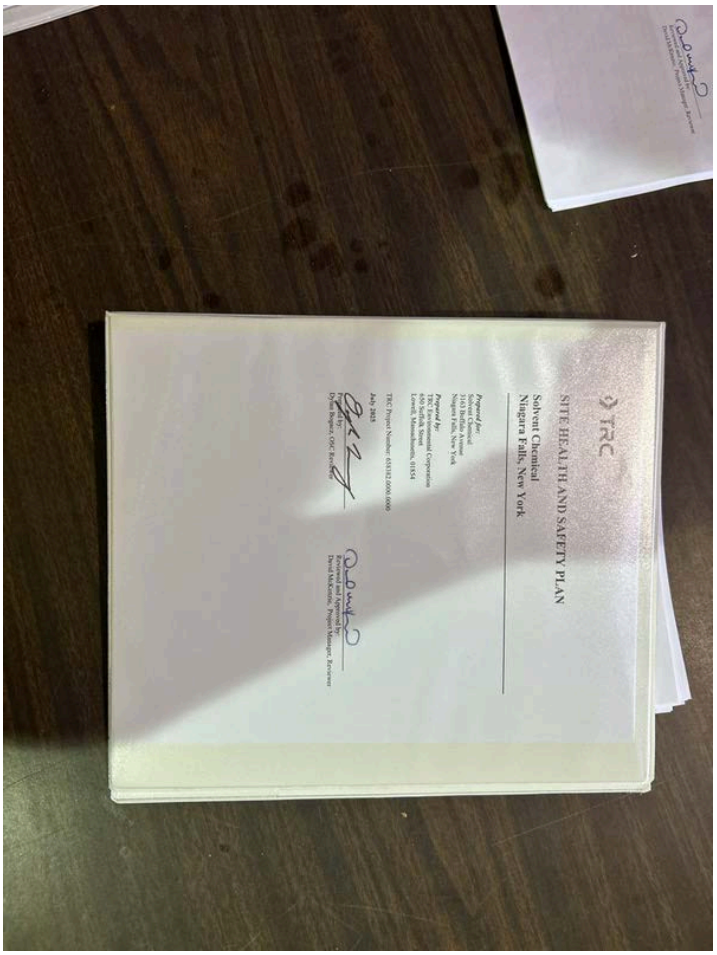

Is the first aid kit present as illustrated on the attached Site Plan and readily accessible?

aid present yes / no / not applicable	Yes
aid present Action Required?	No
aid present Corrective Action Needed	No

aid present Photos





Is the first aid kit fully equipped?

aid equipped yes / no / not applicable	Yes
aid equipped Action Required?	No
aid equipped Corrective Action Needed	No

aid equipped Photos





Is the eyewash station fully equipped and within its use lifespan?

eyewash equipped yes / no / not applicable	Yes
eyewash equipped Action Required?	No
eyewash equipped Corrective Action Needed	No

eyewash equipped Photos







Are spill kits present as illustrated on the attached Site Plan and readily accessible?

kits present yes / no / not applicable	Yes
kits present Action Required?	No
kits present Corrective Action Needed	No

kits present Photos





Are spill kits fully equipped?

kits equipped yes / no / not applicable	Yes
kits equipped Action Required?	No
kits equipped Corrective Action Needed	No

kits equipped Photos





Are acid drums closed and stored within secondary containment?

acid drum yes / no / not applicable	Yes
acid drum Action Required?	No
acid drum Corrective Action Needed	No

acid drum Photos





Is the acid neutralizer pail (5 gal.) present and fully equipped?

acid neutralizer yes / no / not applicable	Yes
acid neutralizer Action Required?	No
acid neutralizer Corrective Action Needed	No

acid neutralizer Photos





Manifold Flow Readings

A-Zone

A-zone Flow in Gallons	4120719.67

PW-2B

2B Flow in Gallons	623100

PW-3B

3B Flow in Gallons	1427776.24

PW-4B

4B Flow in Gallons	39966831.9

PW-5B

5B Flow in Gallons	441541.88

PW-6B

6B Flow in Gallons	770341.05

PW-7B

7B Flow in Gallons	6200272.42

PW-8B

8B Flow in Gallons	6600234
Manifold flow checked by	Chris Rudzinzki

Building Interior XP Section

Is the satellite storage drum (XP Building) labeled for contents and dated with an accumulation start date?

satellite storage yes / no / not applicable	N/A
satellite storage Action Required?	No
satellite storage Corrective Action Needed	No
satellite storage Photos	

Is the lid to the satellite storage drum securely closed?

satellite secure yes / no / not applicable	N/A
satellite secure Action Required?	No
satellite secure Corrective Action Needed	No
satellite secure Photos	

Is the 600 gallon hazardous waste tank labeled for contents and dated with an accumulation start date?

haz waste label yes / no / not applicable	Yes
haz waste label Action Required?	No
haz waste label Corrective Action Needed	No
haz waste label Photos	











Other comments

Other Comments Text	

other comments Photos

APPENDIX D - PDB SAMPLING FORMS

well_id	time	date	water_level_depth	depth_to_bottom_ft	depth_to_dnapl_ft	dnapl_thickness	obstructions	commentsnotes	inspected_by
MW-1A	14:50	2025-09-16	9.48	9.82			no		CJR/JA
MW-1B	14:47	2025-09-16	9.73	18.77			no		CJR/JA
MW-1C	15:22	2025-09-17	15.34	42.58			no		CJR/JA
MW-1CD	15:37	2025-09-17	15.42	54.49			no		CJR/JA
MW-1F	08:52	2025-09-17	12.9	95.28			no		CJR/JA
MW-2A	15:17	2025-09-16	11.52	13.42			no		CJR/JA
MW-2B	15:20	2025-09-16	13.88	24.8			no	No measurable thickness. DNAPL on tip of probe.	CJR/JA
MW-4B	14:09	2025-09-16	18.5	25.52			no		CJR/JA
MW-4C	13:41	2025-09-16	27.63	41.77			no		CJR/JA
MW-5A	10:15	2025-09-16	10.42	11.6			no		CJR/JA
MW-5B	09:59	2025-09-16	0	20.83			no	Well is dry	CJR/JA
MW-5C	10:02	2025-09-16	24.52	34.75			no		CJR/JA
MW-5CD	10:26	2025-09-16	24.14	53.3			no		CJR/JA
MW-5F	10:40	2025-09-16	12.99	100.61			no		CJR/JA
MW-6A	16:07	2025-09-16	10.07				no	Cannot measure TD. Tether weight cannot be pulled.	CJR/JA
MW-6B	16:04	2025-09-16	17.25	20.85			no		CJR/JA
MW-6C	11:04	2025-09-18	25.62	42	41.59	0.41	no	Bailer in well to bail DNAPL	CJR/JA
MW-6F	09:14	2025-09-17	14.78	94.32			no		CJR/JA
OW-10A	08:39	2025-09-16	0	8.15			no	Well is dry	CJR/JA
OW-10B	15:26	2025-09-16	15.55	24.87			no		CJR/JA
OW-11A	11:29	2025-09-18	11.55	15.7			no	No measurable thickness. DNAPL on entire probe (0.7 ft).	CJR/JA
OW-11B	15:52	2025-09-16	14.98	23.45			no	No measurable thickness. DNAPL on probe and on PDB.	CJR/JA
OW-12A	15:01	2025-09-16	11.69	14.75			no		CJR/JA
OW-12B	11:08	2025-09-16	23.7	24.94			no		CJR/JA
OW-13A	15:16	2025-09-16	13.92	15.5			no		CJR/JA
OW-13B	11:53	2025-09-16	18.4	27.79			no	No measurable thickness. DNAPL on probe tip	CJR/JA
OW-14A	15:49	2025-09-16	13.27	14.82			no		CJR/JA
OW-14B	11:16	2025-09-17	14.61	20.29			no		CJR/JA
OW-15A	13:17	2025-09-16	6.91	10.14			no		CJR/JA
OW-15B	11:46	2025-09-17	13.16	20.71			no		CJR/JA
OW-16A	11:43	2025-09-16	10.41	13.22			no		CJR/JA
OW-17A	08:43	2025-09-16	0	10.2			no	Well is dry.	CJR/JA
OW-18A	16:12	2025-09-16	11.89	19.56			no		CJR/JA
OW-19A	15:13	2025-09-16	9.67	14.67			no		CJR/JA
OW-1A	15:07	2025-09-16	7.61	9.79			no		CJR/JA
OW-1B	15:10	2025-09-16	14.15	15.99			no		CJR/JA
OW-20A	12:20	2025-09-17	0	12.8			no	Well is dry	CJR/JA
OW-21A	11:58	2025-09-17	0	10.95			no	Well is dry	CJR/JA
OW-22A	12:53	2025-09-17	12.55	13			no	New PDB deployed	CJR/JA
OW-22B	13:01	2025-09-17	14.54	23.79			no		CJR/JA
OW-23B	12:31	2025-09-17	13.33	22.42			no		CJR/JA
OW-24B	12:03	2025-09-17	13.9	22.19			no		CJR/JA
OW-25B	11:11	2025-09-17	14.48	21.04			no		CJR/JA
OW-26A	09:17	2025-09-16	0	13.04			no	Well is dry	CJR/JA
OW-26B	08:47	2025-09-16	22.38	24.39			no	VOA vial - 2 bottles	CJR/JA
OW-27A	11:30	2025-09-16	9.63	12.59			no		CJR/JA
OW-27B	11:33	2025-09-16	17.3	23.45			no		CJR/JA
OW-28B	13:32	2025-09-16	13.63	19.42			no		CJR/JA
OW-29B	13:06	2025-09-16	13.71	20.92			no		CJR/JA
OW-2B	14:29	2025-09-16	19.69	29.38			no		CJR/JA
OW-30B	09:34	2025-09-16	19.18	22.46			no		CJR/JA
OW-31B	11:28	2025-09-17	13.62	20.63			no		CJR/JA
OW-32B	12:09	2025-09-17	13.4	20.86			no		CJR/JA
OW-33B	12:44	2025-09-17	13.1	20.27			no		CJR/JA
OW-3B	14:37	2025-09-16	15.98	24.26			no		CJR/JA
OW-4B	11:37	2025-09-17	13.88	20.67			no		CJR/JA
OW-5A	11:34	2025-09-17	0	12.4			no	Well is dry	CJR/JA
OW-5B	14:11	2025-09-17	12.22	20.99			no		CJR/JA
OW-6A	12:38	2025-09-17	10.08	12.4			no		CJR/JA
OW-6B	14:27	2025-09-17	20.33	24.92			no		CJR/JA
OW-7A	14:32	2025-09-16	10.53	12.32			no		CJR/JA
OW-7B	14:39	2025-09-17	25.12	27.05			no		CJR/JA
OW-8A	12:34	2025-09-16	11.01	13.61			no		CJR/JA
OW-8B	14:50	2025-09-17	22.39	27.16			no		CJR/JA
OW-9A	11:19	2025-09-16	12.85	14.4			no		CJR/JA
PW 1B	15:34	2025-09-16	14.73	26.1			no		CJR/JA
PW-2B	14:23	2025-09-16	18.64				no		CJR/JA
PW-3B	11:06	2025-09-17	17.79				no		CJR/JA
PW-4B	12:24	2025-09-17	14.58				no		CJR/JA
PW-5B	12:38	2025-09-16	21.15				no		CJR/JA
PW-6B	09:19	2025-09-16	24.88				no		CJR/JA
PW-7B	12:42	2025-09-16	17.5				no		CJR/JA
PW-8B	09:31	2025-09-16	23.81				no		CJR/JA
PZ-01	15:36	2025-09-16	10.74	11.24			no		CJR/JA
PZ-02	15:29	2025-09-16	10.95	11			no		CJR/JA
PZ-03	15:31	2025-09-16	10.72	11.18			no		CJR/JA
PZ-04	15:23	2025-09-16	0	10.33			no	Well is dry	CJR/JA
TW-1A	14:26	2025-09-16	10.14				no		CJR/JA
TW-2A	15:01	2025-09-16	6.1				no		CJR/JA
TW-3A	15:04	2025-09-16	9.19				no		CJR/JA
TW-4A	15:39	2025-09-16	9.68				no		CJR/JA
TW-5A	15:57	2025-09-16	7.11				no		CJR/JA

well_id	time	date	water_leve	depth_to_b	dnapl_thicl	obstructior	commentsnotes	inspected_by
MW-1A	11:00	2026-04-03	6.1	9.82		no		CJR/JA
MW-1B	14:55	2026-03-24	7.05	18.77		no	Synoptic on 4/3/26.	CJR/JA
MW-1C	15:00	2026-03-24	15.12	42.58		no	Synoptic on 4/3/26.	CJR/JA
MW-1CD	15:05	2026-03-24	15.81	54.49		no	Synoptic on 4/3/26.	CJR/JA
MW-1F	11:35	2026-03-25	14.22	95.28		no	Synoptic on 4/3/26.	CJR/JA
MW-2A	15:43	2026-03-24	5.97	13.42		no	Synoptic on 4/3/26.	CJR/JA
MW-2B	11:37	2026-04-03	11.79	24.8		no		CJR/JA
MW-4B	14:30	2026-03-24	17.9	25.52		no	Synoptic on 4/3/26.	CJR/JA
MW-4C	13:45	2026-03-24	27.7	41.77		no	Synoptic on 4/3/26.	CJR/JA
MW-5A	10:35	2026-03-24	7.2	11.6		no	Synoptic on 4/3/26.	CJR/JA
MW-5B	10:11	2026-04-03	17.75	20.94		no		CJR/JA
MW-5C	10:40	2026-03-24	23.42	34.75		no	Synoptic on 4/3/26.	CJR/JA
MW-5CD	10:45	2026-03-24	24.5	53.3		no	Synoptic on 4/3/26.	CJR/JA
MW-5F	10:55	2026-03-24	14.65	99.88		no	Synoptic on 4/3/26.	CJR/JA
MW-6A	11:50	2026-04-03	6.26			no	Cannot measure TD. PDB tether/weight cannot be removed from well.	CJR/JA
MW-6B	11:44	2026-03-25	15.17	20.85		no	Synoptic on 4/3/26.	CJR/JA
MW-6C	11:58	2026-04-03	25.48	42		no		CJR/JA
MW-6CD	12:00	2026-04-03	0			no	Obstruction in well. No measurements.	CJR/JA
MW-6F	12:00	2026-03-25	15.44	94.32		no	Synoptic on 4/3/26.	CJR/JA
OW-10A	10:00	2026-04-03	0	8.13		no	Well is dry	CJR/JA
OW-10B	15:30	2026-03-24	13.22	24.87		no	Synoptic on 4/3/26.	CJR/JA
OW-11A	10:49	2026-04-03	8.9	15.7		no	DNAPL on probe and sides of well casing as solid beep is heard only when the probe touches the side of the well casing /riser.	CJR/JA
OW-11B	13:25	2026-03-25	13.6	23.45		no	DNAPL on PDB and tether. Synoptic on 4/3/26.	CJR/JA
OW-12A	15:20	2026-03-24	9	14.75		no	Synoptic on 4/3/26.	CJR/JA
OW-12B	11:30	2026-03-24	21.5	25.5		no	Synoptic on 4/3/26.	CJR/JA
OW-13A	11:20	2026-04-03	8.52	15.5		no		CJR/JA
OW-13B	14:15	2026-03-24	17.65	27.79		no	Synoptic on 4/3/26.	CJR/JA
OW-14A	11:45	2026-04-03	8.77	14.82		no		CJR/JA
OW-14B	09:30	2026-03-25	13.91	20.29		no	Synoptic on 4/6/26.	CJR/JA
OW-15A	13:25	2026-03-24	5.65	10.22		no	Synoptic on 4/3/26.	CJR/JA
OW-15B	09:40	2026-03-25	12.7	20.71		no	Synoptic on 4/6/26.	CJR/JA
OW-16A	11:55	2026-03-24	6.6	13.22		no	Synoptic on 4/3/26.	CJR/JA
OW-17A	10:02	2026-04-03	5.92	10.2		no		CJR/JA
OW-18A	12:10	2026-03-25	8.87	19.56		no	Synoptic on 4/3/26.	CJR/JA
OW-19A	11:42	2026-04-03	6.23	14.67		no		CJR/JA
OW-1A	11:10	2026-04-03	4.05	9.79		no		CJR/JA
OW-1B	11:11	2026-04-03	13.91	15.99		no		CJR/JA
OW-20A	21:26	2026-04-06	11.9	12.8		no		CJR/JA
OW-21A	09:20	2026-04-06	4.61	10.95		no		CJR/JA
OW-22A	10:00	2026-03-25	5.56	13		no	Synoptic on 4/6/26.	CJR/JA
OW-22B	10:10	2026-03-25	14.08	23.79		no	Synoptic on 4/6/26.	CJR/JA
OW-23B	09:25	2026-04-06	12.91	22.42		no		CJR/JA
OW-24B	09:11	2026-04-06	13.44	22.19		no		CJR/JA

OW-25B	09:03	2026-04-06	13.8	21.04	no		CJR/JA
OW-26A	10:03	2026-04-03	8.47	13.12	no		CJR/JA
OW-26B	10:00	2026-03-24	20.05	24.39	no	Synoptic on 4/3/26.	CJR/JA
OW-27A	10:15	2026-04-03	7.7	12.59	no		CJR/JA
OW-27B	11:50	2026-03-24	16.04	23.45	no	Synoptic on 4/3/26.	CJR/JA
OW-28B	13:35	2026-03-24	13	19.52	no	Synoptic on 4/3/26.	CJR/JA
OW-29A	17:00	2026-03-27	0		no	Well abandoned.	CJR/JA
OW-29B	13:15	2026-03-24	13.07	21.01	no	Synoptic on 4/3/26.	CJR/JA
OW-2B	10:35	2026-04-03	18.68	29.38	no		CJR/JA
OW-30B	10:20	2026-03-24	17.2	22.46	no	Synaptic on 4/3/26.	CJR/JA
OW-31B	11:15	2026-04-06	12.91	20.63	no		CJR/JA
OW-32B	21:23	2026-04-06	12.93	20.86	no		CJR/JA
OW-33B	09:35	2026-04-06	12.62	20.27	no		CJR/JA
OW-3B	10:47	2026-04-03	15.5	24.26	no		CJR/JA
OW-4B	09:06	2026-04-06	13.44	20.67	no		CJR/JA
OW-5A	21:10	2026-04-06	11.95	12.4	no		CJR/JA
OW-5B	10:30	2026-03-25	11.7	20.99	no	Synoptic on 4/6/26.	CJR/JA
OW-6A	09:31	2026-04-06	9.63	12.4	no		CJR/JA
OW-6B	08:40	2026-03-25	20	24.92	no	Synoptic on 4/3/26.	CJR/JA
OW-7A	10:40	2026-04-03	7.8	12.32	no		CJR/JA
OW-7B	08:50	2026-03-25	24.01	27.05	no	Synoptic on 4/3/26.	CJR/JA
OW-8A	10:25	2026-04-03	10.07	13.61	no		CJR/JA
OW-8B	09:00	2026-03-25	21.11	27.16	no	Synoptic on 4/3/26.	CJR/JA
OW-9A	11:40	2026-03-24	11.53	14.4	no	Synoptic on 4/3/26.	CJR/JA
PW-1B	11:31	2026-04-03	13.4	26.05	no		CJR/JA
PW-2B	08:15	2026-04-03	17.1		no		CJR/JA
PW-3B	08:25	2026-04-03	21.5		no	Pumping well. Synoptic on 4/6/26.	CJR/JA
PW-4B	08:30	2026-04-03	14.5		no	Pumping well. Synoptic on 4/6/26.	CJR/JA
PW-5B	08:40	2026-04-03	17.4		no		CJR/JA
PW-6B	08:50	2026-04-03	22.8		no	Pumping Well	CJR/JA
PW-7B	09:00	2026-04-03	17		no	Pumping Well.	CJR/JA
PW-8B	09:10	2026-04-03	22.8		no	Pumping Well	CJR/JA
PZ-01	11:27	2026-04-03	6.04	11.24	no		CJR/JA
PZ-02	11:28	2026-04-03	5.88	11.06	no		CJR/JA
PZ-03	11:28	2026-04-03	5.78	11.23	no		CJR/JA
PZ-04	11:30	2026-04-03	5.78	10.33	no		CJR/JA
TW-1A	10:45	2026-04-03	8		no	Pumping Well.	CJR/JA
TW-2A	10:55	2026-04-03	3.4		no	Pumping Well.	CJR/JA
TW-3A	11:04	2026-04-03	4.82		no	Pumping Well.	CJR/JA
TW-4A	11:49	2026-04-03	3.44		no	Pumping Well.	CJR/JA
TW-5A	23:55	2026-04-03	3		no	Pumping Well.	CJR/JA

APPENDIX E - SOLVENT 2025-26 MW REPORTS

eurofins | Environment Testing

ANALYTICAL REPORT

PREPARED FOR

Attn: Mr. Nathan Sarapas
TRC Environmental Corporation
Wannalancit Mills
650 Suffolk Street
Lowell, Massachusetts 01854

Generated 9/25/2025 8:48:47 AM

JOB DESCRIPTION

Solvent Chemical Semi-annual Monitoring

JOB NUMBER

480-232730-1

Eurofins Buffalo
10 Hazelwood Drive
Amherst NY 14228-2298

See page two for job notes and contact information.

myEOL

Job Notes

This report may not be reproduced except in full, and with written approval from the laboratory. The results relate only to the samples tested. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

The test results in this report relate only to the samples as received by the laboratory and will meet all requirements of the methodology, with any exceptions noted. This report shall not be reproduced except in full, without the express written approval of the laboratory. All questions should be directed to the Eurofins Environment Testing Northeast, LLC Project Manager.

Authorization



Generated
9/25/2025 8:48:47 AM

Authorized for release by
Kavya Boyina, Project Manager
kavya.boyina@et.eurofinsus.com
(716)504-9813

Table of Contents

Cover Page 1
Table of Contents 3
Definitions/Glossary 4
Case Narrative 5
Detection Summary 8
Client Sample Results 17
Surrogate Summary 88
QC Sample Results 90
QC Association Summary 119
Lab Chronicle 121
Certification Summary 127
Method Summary 128
Sample Summary 129
Chain of Custody 130
Receipt Checklists 134

Definitions/Glossary

Client: TRC Environmental Corporation
Job ID: 480-232730-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Qualifiers

GC/MS VOA

Qualifier	Qualifier Description
*+	LCS and/or LCSD is outside acceptance limits, high biased.
E	Result exceeded calibration range.
ES	The analyte response has saturated the instrument detector. The reported concentration is likely to have a low bias and should be considered a minimum possible concentration.
F1	MS and/or MSD recovery exceeds control limits.
F2	MS/MSD RPD exceeds control limits
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
☼	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CFU	Colony Forming Unit
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MCL	EPA recommended "Maximum Contaminant Level"
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
MPN	Most Probable Number
MQL	Method Quantitation Limit
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
NEG	Negative / Absent
POS	Positive / Present
PQL	Practical Quantitation Limit
PRES	Presumptive
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)
TNTC	Too Numerous To Count

Job ID: 480-232730-1 Eurofins Buffalo

Job Narrative
480-232730-1

The analytical test results presented in this report meet all requirements of the associated regulatory program listed on the Accreditation/Certification Summary Page, unless otherwise noted. Data qualifiers and/or narrative comments are included to explain any exceptions, if applicable. Regulated compliance samples (e.g. SDWA, NPDES) must comply with associated agency requirements/permits.

- Matrix-specific batch QC (e.g., MS, MSD, SD) may not be reported when insufficient sample volume is available or when site-specific QC samples are not submitted. In such cases, a Laboratory Control Sample Duplicate (LCSD) may be analyzed to provide precision data for the batch.
- For samples analyzed using surrogate and/or isotope dilution analytes, any recoveries falling outside of established acceptance criteria are re-prepared and/or re-analyzed to confirm results, unless the deviation is due to sample dilution or otherwise explained in the case narrative.

Receipt
The samples were received on 9/18/2025 2:55 PM. Unless otherwise noted below, the samples arrived in good condition, and, where required, properly preserved and on ice. The temperatures of the 2 coolers at receipt time were 0.5°C and 0.6°C.

Receipt Exceptions
The following sample containers slipped out of the bubble bag they were in and were accidentally discarded along with the ice in the cooler. The vials were later found on the ground outside of the laboratory out of the required temperature criteria. The client was contacted and the laboratory was instructed to proceed with analysis.

OW-6B (480-232730-20)

GC/MS VOA
Method 8260C: The matrix spike / matrix spike duplicate (MS/MSD) recoveries for analytical batch 480-757404 were outside control limits for one or more analytes. See QC Sample Results for detail. Sample matrix interference and/or non-homogeneity are suspected because the associated laboratory control sample (LCS) recovery is within acceptance limits. The following associated samples are impacted: MW-4C (480-232730-17[MS]) and MW-4C (480-232730-17[MSD])

Method 8260C: The continuing calibration verification (CCV) associated with batch 480-757404 recovered outside acceptance criteria, low biased, for Chloromethane. A reporting limit (RL) standard was analyzed, and the target analytes are detected. Since the associated samples were non-detect for the analyte(s), the data are reported. The following associated samples are impacted: OW-26B (480-232730-1), OW-30B (480-232730-2), MW-5A (480-232730-3), MW-5CD (480-232730-5), MW-5F (480-232730-6), OW-12B (480-232730-7), OW-9A (480-232730-8), OW-16A (480-232730-10), OW-13B (480-232730-11), OW-113B (480-232730-12), OW-29B (480-232730-13), OW-15A (480-232730-14), OW-28B (480-232730-15), MW-4B (480-232730-16), MW-4C (480-232730-17) and OW-5B (480-232730-18)

Method 8260C: The following samples were diluted to bring the concentration of target analytes within the calibration range: OW-26B (480-232730-1), MW-5CD (480-232730-5), MW-5F (480-232730-6), OW-12B (480-232730-7), OW-9A (480-232730-8), OW-13B (480-232730-11), OW-113B (480-232730-12), OW-29B (480-232730-13), OW-15A (480-232730-14), OW-28B (480-232730-15), MW-4B (480-232730-16), MW-4C (480-232730-17), MW-4C (480-232730-17[MS]), MW-4C (480-232730-17[MSD]) and OW-5B (480-232730-18). Elevated reporting limits (RLs) are provided.

Method 8260C: The laboratory control sample (LCS) for analytical batch 480-757403 recovered outside control limits for the following analytes: Bromoform. These analytes were biased high in the LCS and were not detected in the associated samples; therefore, the data have been reported.

Method 8260C: The following samples were diluted to bring the concentration of target analytes within the calibration range: OW-105B (480-232730-19), MW-1B (480-232730-23), MW-1C (480-232730-24), MW-1CD (480-232730-25), MW-1F (480-232730-26) and OW-12A (480-232730-27). Elevated reporting limits (RLs) are provided.

Method 8260C: The continuing calibration verification (CCV) associated with batch 480-757403 recovered outside acceptance criteria, low biased, for Naphthalene. A reporting limit (RL) standard was analyzed, and the target analytes are detected. Since the associated samples were non-detect for the analyte(s), the data are reported.

Method 8260C: The following samples were diluted to bring the concentration of target analytes within the calibration range:

Job ID: 480-232730-1 (Continued) Eurofins Buffalo

OW-30B (480-232730-2), MW-5C (480-232730-4), OW-12B (480-232730-7), OW-9A (480-232730-8) and OW-27B (480-232730-9). Elevated reporting limits (RLs) are provided.

Method 8260C: The following samples were diluted to bring the concentration of target analytes within the calibration range: OW-7B (480-232730-21), OW-8B (480-232730-22), OW-10B (480-232730-28), MW-2A (480-232730-29), OW-18A (480-232730-30), OW-18A (480-232730-30[MS]) and OW-18A (480-232730-30[MSD]). Elevated reporting limits (RLs) are provided.

Method 8260C: The continuing calibration verification (CCV) associated with batch 757615 recovered above the upper control limit for Chlorodibromomethane. The samples associated with this CCV were non-detects for the affected analytes; therefore, the data have been reported. The associated samples are:OW-7B (480-232730-21), OW-8B (480-232730-22), OW-10B (480-232730-28), MW-2A (480-232730-29) and OW-18A (480-232730-30).

Method 8260C: The matrix spike duplicate (MSD) recoveries for analytical batch 480-757615 were outside control limits for one or more analytes. See QC Sample Results for detail. Sample matrix interference and/or non-homogeneity are suspected because the associated laboratory control sample (LCS) recovery is within acceptance limits.

Method 8260C: The laboratory control sample (LCS) for analytical batch 480-757615 recovered outside control limits for the following analytes: Dichlorobromomethane, Chlorodibromomethane, and Bromoform. These analytes were biased high in the LCS and were not detected in the associated samples; therefore, the data have been reported.

Method 8260C: The following samples were diluted to bring the concentration of target analytes within the calibration range: OW-6B (480-232730-20), OW-11B (480-232730-31), MW-6B (480-232730-33) and MW-6F (480-232730-34). Elevated reporting limits (RLs) are provided.

Method 8260C: The following samples were diluted to bring the concentration of target analytes within the calibration range: OW-111B (480-232730-32), OW-14B (480-232730-35), OW-22B (480-232730-37), OW-22B (480-232730-37[MS]), OW-22B (480-232730-37[MSD]) and OW-15B (480-232730-38). Elevated reporting limits (RLs) are provided.

Method 8260C: The continuing calibration verification (CCV) associated with batch 757736 recovered outside acceptance criteria, low biased, for 2-Chlorotoluene, 1,2,3-Trichloropropane, 2-Chloroethyl vinyl ether, trans-1,3-Dichloropropene, 1,1,2,2-Tetrachloroethane, 1,2,4-Trimethylbenzene, Naphthalene, Isopropylbenzene, 4-Methyl-2-pentanone (MIBK), and Bromobenzene. A reporting limit (RL) standard was analyzed, and the target analytes are detected. Since the associated samples were non-detect for the analyte(s), the data are reported.

Method 8260C: The continuing calibration verification (CCV) associated with batch 757736 recovered outside acceptance criteria, low biased, for 1,2,4-Trichlorobenzene, 4-Methyl-2-pentanone (MIBK), 1,2-Dichlorobenzene, 2-Chlorotoluene, 1,2,3-Trichloropropane, 2-Chloroethyl vinyl ether, trans-1,3-Dichloropropene, 1,2,3-Trichlorobenzene, 1,2,4-Trimethylbenzene, Naphthalene, Isopropylbenzene, Bromobenzene, and 1,4-Dichlorobenzene. A reporting limit (RL) standard was analyzed, and the target analytes are detected. Since the associated samples were non-detect or detects below the reporting limit (RL) for the analyte(s), the data are reported.

Method 8260C: The continuing calibration verification (CCV) associated with batch 480-757736 recovered outside acceptance criteria, low biased, for 4-Methyl-2-pentanone (MIBK), 2-Chlorotoluene, 1,2,3-Trichloropropane, 1,2,4-Trichlorobenzene, 2-Chloroethyl vinyl ether, trans-1,3-Dichloropropene, 1,2,3-Trichlorobenzene, 1,2,4-Trimethylbenzene, Naphthalene, Isopropylbenzene, and Bromobenzene. A reporting limit (RL) standard was analyzed, and the target analytes are detected. Since the associated samples were non-detect for the analyte(s), the data are reported.

Method 8260C: The matrix spike duplicate (MSD) recoveries for analytical batch 480-757736 were outside control limits for one or more analytes. See QC Sample Results for detail. Sample matrix interference and/or non-homogeneity are suspected because the associated laboratory control sample (LCS) recovery is within acceptance limits.

Method 8260C: The continuing calibration verification (CCV) analyzed in batch 757736 was outside the method criteria for the following analyte(s): 1,2-Dichlorobenzene, 1,2,4-Trichlorobenzene, 1,2,3-Trichlorobenzene, and 1,4-Dichlorobenzene. A CCV standard at or below the reporting limit (RL) was analyzed with the affected samples and found to be acceptable. As indicated in the reference method, sample analysis may proceed; however, any detection for the affected analyte(s) is considered estimated.

Method 8260C: The continuing calibration verification (CCV) analyzed in batch 757736 was outside the method criteria for the following analyte(s): 1,2-Dichlorobenzene, 1,1,2,2-Tetrachloroethane, and 1,4-Dichlorobenzene. A CCV standard at or below the reporting limit (RL) was analyzed with the affected samples and found to be acceptable. As indicated in the reference method, sample analysis may proceed; however, any detection for the affected analyte(s) is considered estimated.

Job ID: 480-232730-1 (Continued) Eurofins Buffalo

Method 8260C: The continuing calibration verification (CCV) analyzed in batch 757736 was outside the method criteria for the following analyte(s): 1,1,2,2-Tetrachloroethane. A CCV standard at or below the reporting limit (RL) was analyzed with the affected samples and found to be acceptable. As indicated in the reference method, sample analysis may proceed; however, any detection for the affected analyte(s) is considered estimated.

Method 8260C: The continuing calibration verification (CCV) analyzed in batch 757736 was outside the method criteria for the following analyte(s): 1,2-Dichlorobenzene, 1,1,2,2-Tetrachloroethane, and 1,4-Dichlorobenzene. A CCV standard at or below the reporting limit (RL) was analyzed with the affected samples and found to be acceptable. As indicated in the reference method, sample analysis may proceed; however, any detection for the affected analyte(s) is considered estimated.

Method 8260C: The continuing calibration verification (CCV) associated with batch 480-757736 recovered outside acceptance criteria, low biased, for 1,2,4-Trichlorobenzene, 1,2,3-Trichlorobenzene, 1,2,3-Trichloropropane, 2-Chloroethyl vinyl ether, trans-1,3-Dichloropropene, 1,2,4-Trimethylbenzene, Naphthalene, Isopropylbenzene, 4-Methyl-2-pentanone (MIBK), and Bromobenzene. A reporting limit (RL) standard was analyzed, and the target analytes are detected. Since the associated samples were non-detect for the analyte(s), the data are reported.

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

Detection Summary

Client: TRC Environmental Corporation
Job ID: 480-232730-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-26B — Lab Sample ID: 480-232730-1

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1-Dichloroethane	1.9	J	2.0	0.76	ug/L	2		8260C	Total/NA
cis-1,2-Dichloroethene	4.0		2.0	1.6	ug/L	2		8260C	Total/NA
Tetrachloroethene	70		2.0	0.72	ug/L	2		8260C	Total/NA
trans-1,2-Dichloroethene	2.3		2.0	1.8	ug/L	2		8260C	Total/NA
Trichloroethene	3.7		2.0	0.92	ug/L	2		8260C	Total/NA

Client Sample ID: OW-30B — Lab Sample ID: 480-232730-2

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1-Dichloroethane	3.1		1.0	0.38	ug/L	1		8260C	Total/NA
1,2,3-Trichlorobenzene	1.4		1.0	0.41	ug/L	1		8260C	Total/NA
1,2,4-Trichlorobenzene	1.5		1.0	0.41	ug/L	1		8260C	Total/NA
1,2-Dichlorobenzene	140	E	1.0	0.79	ug/L	1		8260C	Total/NA
1,3-Dichlorobenzene	130	E	1.0	0.78	ug/L	1		8260C	Total/NA
1,4-Dichlorobenzene	250	E	1.0	0.84	ug/L	1		8260C	Total/NA
Benzene	100	E	1.0	0.41	ug/L	1		8260C	Total/NA
Chlorobenzene	740	E ES	1.0	0.75	ug/L	1		8260C	Total/NA
cis-1,2-Dichloroethene	10		1.0	0.81	ug/L	1		8260C	Total/NA
Ethylbenzene	0.74	J	1.0	0.74	ug/L	1		8260C	Total/NA
Tetrachloroethene	22		1.0	0.36	ug/L	1		8260C	Total/NA
Toluene	0.76	J	1.0	0.51	ug/L	1		8260C	Total/NA
trans-1,2-Dichloroethene	5.7		1.0	0.90	ug/L	1		8260C	Total/NA
Trichloroethene	4.9		1.0	0.46	ug/L	1		8260C	Total/NA
Vinyl chloride	12		1.0	0.90	ug/L	1		8260C	Total/NA
1,2-Dichlorobenzene - DL	150		20	16	ug/L	20		8260C	Total/NA
1,3-Dichlorobenzene - DL	130		20	16	ug/L	20		8260C	Total/NA
1,4-Dichlorobenzene - DL	250		20	17	ug/L	20		8260C	Total/NA
Benzene - DL	110		20	8.2	ug/L	20		8260C	Total/NA
Chlorobenzene - DL	1200		20	15	ug/L	20		8260C	Total/NA
Tetrachloroethene - DL	29		20	7.2	ug/L	20		8260C	Total/NA

Client Sample ID: MW-5A — Lab Sample ID: 480-232730-3

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Tetrachloroethene	16		1.0	0.36	ug/L	1		8260C	Total/NA

Client Sample ID: MW-5C — Lab Sample ID: 480-232730-4

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2-Dichlorobenzene	200		50	40	ug/L	50		8260C	Total/NA
1,3-Dichlorobenzene	390		50	39	ug/L	50		8260C	Total/NA
1,4-Dichlorobenzene	930		50	42	ug/L	50		8260C	Total/NA
Benzene	280		50	21	ug/L	50		8260C	Total/NA
Chlorobenzene	3300		50	38	ug/L	50		8260C	Total/NA

Client Sample ID: MW-5CD — Lab Sample ID: 480-232730-5

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2-Dichlorobenzene	17		10	7.9	ug/L	10		8260C	Total/NA
1,4-Dichlorobenzene	16		10	8.4	ug/L	10		8260C	Total/NA
Benzene	23		10	4.1	ug/L	10		8260C	Total/NA
Chlorobenzene	12		10	7.5	ug/L	10		8260C	Total/NA
cis-1,2-Dichloroethene	780		10	8.1	ug/L	10		8260C	Total/NA

This Detection Summary does not include radiochemical test results.

Eurofins Buffalo

Client Sample ID: MW-5CD (Continued) — Lab Sample ID: 480-232730-5

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
trans-1,2-Dichloroethene	31		10	9.0	ug/L	10		8260C	Total/NA
Vinyl chloride	330		10	9.0	ug/L	10		8260C	Total/NA

Client Sample ID: MW-5F — Lab Sample ID: 480-232730-6

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,4-Trichlorobenzene	37	J	80	33	ug/L	80		8260C	Total/NA
1,2-Dichlorobenzene	4900		80	63	ug/L	80		8260C	Total/NA
1,3-Dichlorobenzene	420		80	62	ug/L	80		8260C	Total/NA
1,4-Dichlorobenzene	2000		80	67	ug/L	80		8260C	Total/NA
Benzene	2300		80	33	ug/L	80		8260C	Total/NA
Chlorobenzene	6200		80	60	ug/L	80		8260C	Total/NA

Client Sample ID: OW-12B — Lab Sample ID: 480-232730-7

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,4-Trichlorobenzene	6.0	J	10	4.1	ug/L	10		8260C	Total/NA
1,2-Dichlorobenzene	490		10	7.9	ug/L	10		8260C	Total/NA
1,3-Dichlorobenzene	260		10	7.8	ug/L	10		8260C	Total/NA
1,4-Dichlorobenzene	660		10	8.4	ug/L	10		8260C	Total/NA
Benzene	210		10	4.1	ug/L	10		8260C	Total/NA
Chlorobenzene	1800	E	10	7.5	ug/L	10		8260C	Total/NA
cis-1,2-Dichloroethene	81		10	8.1	ug/L	10		8260C	Total/NA
Vinyl chloride	140		10	9.0	ug/L	10		8260C	Total/NA
1,2-Dichlorobenzene - DL	690		40	32	ug/L	40		8260C	Total/NA
1,3-Dichlorobenzene - DL	360		40	31	ug/L	40		8260C	Total/NA
1,4-Dichlorobenzene - DL	910		40	34	ug/L	40		8260C	Total/NA
Benzene - DL	300		40	16	ug/L	40		8260C	Total/NA
Chlorobenzene - DL	2300		40	30	ug/L	40		8260C	Total/NA
Chloroform - DL	14	J	40	14	ug/L	40		8260C	Total/NA
cis-1,2-Dichloroethene - DL	110		40	32	ug/L	40		8260C	Total/NA
Vinyl chloride - DL	220		40	36	ug/L	40		8260C	Total/NA

Client Sample ID: OW-9A — Lab Sample ID: 480-232730-8

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2-Dichlorobenzene	830		50	40	ug/L	50		8260C	Total/NA
cis-1,2-Dichloroethene	430		50	41	ug/L	50		8260C	Total/NA
Tetrachloroethene	7700	E	50	18	ug/L	50		8260C	Total/NA
Trichloroethene	410		50	23	ug/L	50		8260C	Total/NA
1,2-Dichlorobenzene - DL	750		130	99	ug/L	125		8260C	Total/NA
cis-1,2-Dichloroethene - DL	460		130	100	ug/L	125		8260C	Total/NA
Tetrachloroethene - DL	6900		130	45	ug/L	125		8260C	Total/NA
Trichloroethene - DL	370		130	58	ug/L	125		8260C	Total/NA

Client Sample ID: OW-27B — Lab Sample ID: 480-232730-9

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	5.5	J	20	4.2	ug/L	20		8260C	Total/NA
1,2,3-Trichlorobenzene	8.3	J	20	8.2	ug/L	20		8260C	Total/NA
1,2,4-Trichlorobenzene	86		20	8.2	ug/L	20		8260C	Total/NA
1,2-Dichlorobenzene	270		20	16	ug/L	20		8260C	Total/NA
1,3-Dichlorobenzene	240		20	16	ug/L	20		8260C	Total/NA

This Detection Summary does not include radiochemical test results.

Client Sample ID: OW-27B (Continued) — Lab Sample ID: 480-232730-9

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,4-Dichlorobenzene	400		20	17	ug/L	20		8260C	Total/NA
Benzene	68		20	8.2	ug/L	20		8260C	Total/NA
Chlorobenzene	350		20	15	ug/L	20		8260C	Total/NA
cis-1,2-Dichloroethene	740		20	16	ug/L	20		8260C	Total/NA
Tetrachloroethene	67		20	7.2	ug/L	20		8260C	Total/NA
trans-1,2-Dichloroethene	62		20	18	ug/L	20		8260C	Total/NA
Trichloroethene	83		20	9.2	ug/L	20		8260C	Total/NA
Vinyl chloride	420		20	18	ug/L	20		8260C	Total/NA

Client Sample ID: OW-16A — Lab Sample ID: 480-232730-10

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2-Dichlorobenzene	23		1.0	0.79	ug/L	1		8260C	Total/NA
1,4-Dichlorobenzene	3.5		1.0	0.84	ug/L	1		8260C	Total/NA

Client Sample ID: OW-13B — Lab Sample ID: 480-232730-11

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,4-Trichlorobenzene	1600		200	82	ug/L	200		8260C	Total/NA
1,2-Dichlorobenzene	4900		200	160	ug/L	200		8260C	Total/NA
1,3-Dichlorobenzene	2000		200	160	ug/L	200		8260C	Total/NA
1,4-Dichlorobenzene	6700		200	170	ug/L	200		8260C	Total/NA
Benzene	720		200	82	ug/L	200		8260C	Total/NA
Chlorobenzene	6600		200	150	ug/L	200		8260C	Total/NA
Vinyl chloride	810		200	180	ug/L	200		8260C	Total/NA

Client Sample ID: OW-113B — Lab Sample ID: 480-232730-12

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,4-Trichlorobenzene	1600		200	82	ug/L	200		8260C	Total/NA
1,2-Dichlorobenzene	5100		200	160	ug/L	200		8260C	Total/NA
1,3-Dichlorobenzene	2000		200	160	ug/L	200		8260C	Total/NA
1,4-Dichlorobenzene	6900		200	170	ug/L	200		8260C	Total/NA
Benzene	730		200	82	ug/L	200		8260C	Total/NA
Chlorobenzene	6700		200	150	ug/L	200		8260C	Total/NA
Vinyl chloride	830		200	180	ug/L	200		8260C	Total/NA

Client Sample ID: OW-29B — Lab Sample ID: 480-232730-13

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,3-Trichlorobenzene	58	J	100	41	ug/L	100		8260C	Total/NA
1,2,4-Trichlorobenzene	500		100	41	ug/L	100		8260C	Total/NA
1,2-Dichlorobenzene	1500		100	79	ug/L	100		8260C	Total/NA
1,3-Dichlorobenzene	720		100	78	ug/L	100		8260C	Total/NA
1,4-Dichlorobenzene	2300		100	84	ug/L	100		8260C	Total/NA
Benzene	250		100	41	ug/L	100		8260C	Total/NA
Chlorobenzene	2700		100	75	ug/L	100		8260C	Total/NA
cis-1,2-Dichloroethene	920		100	81	ug/L	100		8260C	Total/NA
trans-1,2-Dichloroethene	120		100	90	ug/L	100		8260C	Total/NA
Vinyl chloride	3100		100	90	ug/L	100		8260C	Total/NA

This Detection Summary does not include radiochemical test results.

Detection Summary

Client: TRC Environmental Corporation
Job ID: 480-232730-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-15A — Lab Sample ID: 480-232730-14

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,4-Trichlorobenzene	29		10	4.1	ug/L	10		8260C	Total/NA
1,2-Dichlorobenzene	370		10	7.9	ug/L	10		8260C	Total/NA
1,3-Dichlorobenzene	310		10	7.8	ug/L	10		8260C	Total/NA
1,4-Dichlorobenzene	820		10	8.4	ug/L	10		8260C	Total/NA
Chlorobenzene	430		10	7.5	ug/L	10		8260C	Total/NA

Client Sample ID: OW-28B — Lab Sample ID: 480-232730-15

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	320		100	21	ug/L	100		8260C	Total/NA
1,1-Dichloroethene	42	J	100	29	ug/L	100		8260C	Total/NA
1,2,3-Trichlorobenzene	64	J	100	41	ug/L	100		8260C	Total/NA
1,2,4-Trichlorobenzene	160		100	41	ug/L	100		8260C	Total/NA
1,2-Dichlorobenzene	230		100	79	ug/L	100		8260C	Total/NA
1,3-Dichlorobenzene	160		100	78	ug/L	100		8260C	Total/NA
1,4-Dichlorobenzene	240		100	84	ug/L	100		8260C	Total/NA
Benzene	100		100	41	ug/L	100		8260C	Total/NA
Chlorobenzene	250		100	75	ug/L	100		8260C	Total/NA
Chloroform	40	J	100	34	ug/L	100		8260C	Total/NA
cis-1,2-Dichloroethene	6500		100	81	ug/L	100		8260C	Total/NA
Tetrachloroethene	2900		100	36	ug/L	100		8260C	Total/NA
trans-1,2-Dichloroethene	120		100	90	ug/L	100		8260C	Total/NA
Trichloroethene	7600		100	46	ug/L	100		8260C	Total/NA
Vinyl chloride	650		100	90	ug/L	100		8260C	Total/NA

Client Sample ID: MW-4B — Lab Sample ID: 480-232730-16

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	330		200	42	ug/L	200		8260C	Total/NA
1,2,4-Trichlorobenzene	200		200	82	ug/L	200		8260C	Total/NA
1,2-Dichlorobenzene	680		200	160	ug/L	200		8260C	Total/NA
1,3-Dichlorobenzene	310		200	160	ug/L	200		8260C	Total/NA
1,4-Dichlorobenzene	740		200	170	ug/L	200		8260C	Total/NA
Chlorobenzene	240		200	150	ug/L	200		8260C	Total/NA
cis-1,2-Dichloroethene	3800		200	160	ug/L	200		8260C	Total/NA
Tetrachloroethene	2100		200	72	ug/L	200		8260C	Total/NA
Trichloroethene	6200		200	92	ug/L	200		8260C	Total/NA
Vinyl chloride	180	J	200	180	ug/L	200		8260C	Total/NA

Client Sample ID: MW-4C — Lab Sample ID: 480-232730-17

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2-Dichlorobenzene	740		400	320	ug/L	400		8260C	Total/NA
1,4-Dichlorobenzene	500		400	340	ug/L	400		8260C	Total/NA
Benzene	3500		400	160	ug/L	400		8260C	Total/NA
Chlorobenzene	4900		400	300	ug/L	400		8260C	Total/NA
Chloroform	140	J	400	140	ug/L	400		8260C	Total/NA
cis-1,2-Dichloroethene	30000	F1	400	320	ug/L	400		8260C	Total/NA
trans-1,2-Dichloroethene	480		400	360	ug/L	400		8260C	Total/NA
Trichloroethene	1500		400	180	ug/L	400		8260C	Total/NA
Vinyl chloride	2300		400	360	ug/L	400		8260C	Total/NA

This Detection Summary does not include radiochemical test results.

Detection Summary

Client: TRC Environmental Corporation
Job ID: 480-232730-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-5B — Lab Sample ID: 480-232730-18

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	300	J	400	84	ug/L	400		8260C	Total/NA
Chloroform	140	J	400	140	ug/L	400		8260C	Total/NA
cis-1,2-Dichloroethene	3800		400	320	ug/L	400		8260C	Total/NA
Tetrachloroethene	2900		400	140	ug/L	400		8260C	Total/NA
Trichloroethene	8500		400	180	ug/L	400		8260C	Total/NA

Client Sample ID: OW-105B — Lab Sample ID: 480-232730-19

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	330		100	21	ug/L	100		8260C	Total/NA
1,2,3-Trichlorobenzene	43	J	100	41	ug/L	100		8260C	Total/NA
1,2,4-Trichlorobenzene	120		100	41	ug/L	100		8260C	Total/NA
1,2-Dichlorobenzene	130		100	79	ug/L	100		8260C	Total/NA
1,3-Dichlorobenzene	100		100	78	ug/L	100		8260C	Total/NA
1,4-Dichlorobenzene	160		100	84	ug/L	100		8260C	Total/NA
Benzene	83	J	100	41	ug/L	100		8260C	Total/NA
Chlorobenzene	230		100	75	ug/L	100		8260C	Total/NA
cis-1,2-Dichloroethene	3200		100	81	ug/L	100		8260C	Total/NA
Tetrachloroethene	3300		100	36	ug/L	100		8260C	Total/NA
Trichloroethene	7900		100	46	ug/L	100		8260C	Total/NA
Vinyl chloride	230		100	90	ug/L	100		8260C	Total/NA

Client Sample ID: OW-6B — Lab Sample ID: 480-232730-20

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	130	J	200	42	ug/L	200		8260C	Total/NA
1,2,4-Trichlorobenzene	330		200	82	ug/L	200		8260C	Total/NA
1,2-Dichlorobenzene	380		200	160	ug/L	200		8260C	Total/NA
1,3-Dichlorobenzene	240		200	160	ug/L	200		8260C	Total/NA
1,4-Dichlorobenzene	510		200	170	ug/L	200		8260C	Total/NA
Benzene	110	J	200	82	ug/L	200		8260C	Total/NA
Chlorobenzene	610		200	150	ug/L	200		8260C	Total/NA
cis-1,2-Dichloroethene	4800		200	160	ug/L	200		8260C	Total/NA
Tetrachloroethene	1300		200	72	ug/L	200		8260C	Total/NA
Trichloroethene	3900		200	92	ug/L	200		8260C	Total/NA
Vinyl chloride	700		200	180	ug/L	200		8260C	Total/NA

Client Sample ID: OW-7B — Lab Sample ID: 480-232730-21

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	4.5		1.0	0.21	ug/L	1		8260C	Total/NA
1,1-Dichloroethane	2.0		1.0	0.38	ug/L	1		8260C	Total/NA
1,2-Dichlorobenzene	5.6		1.0	0.79	ug/L	1		8260C	Total/NA
1,3-Dichlorobenzene	12		1.0	0.78	ug/L	1		8260C	Total/NA
1,4-Dichlorobenzene	15		1.0	0.84	ug/L	1		8260C	Total/NA
Benzene	22		1.0	0.41	ug/L	1		8260C	Total/NA
Chlorobenzene	210	E	1.0	0.75	ug/L	1		8260C	Total/NA
Chloroform	0.42	J	1.0	0.34	ug/L	1		8260C	Total/NA
cis-1,2-Dichloroethene	21		1.0	0.81	ug/L	1		8260C	Total/NA
Tetrachloroethene	39		1.0	0.36	ug/L	1		8260C	Total/NA
trans-1,2-Dichloroethene	2.9		1.0	0.90	ug/L	1		8260C	Total/NA
Trichloroethene	52		1.0	0.46	ug/L	1		8260C	Total/NA

This Detection Summary does not include radiochemical test results.

Eurofins Buffalo

Client Sample ID: OW-7B (Continued) — Lab Sample ID: 480-232730-21

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Vinyl chloride	4.5		1.0	0.90	ug/L	1		8260C	Total/NA
1,1,2,2-Tetrachloroethane - DL	4.1		4.0	0.84	ug/L	4		8260C	Total/NA
1,1-Dichloroethane - DL	2.1	J	4.0	1.5	ug/L	4		8260C	Total/NA
1,2-Dichlorobenzene - DL	6.4		4.0	3.2	ug/L	4		8260C	Total/NA
1,3-Dichlorobenzene - DL	15		4.0	3.1	ug/L	4		8260C	Total/NA
1,4-Dichlorobenzene - DL	18		4.0	3.4	ug/L	4		8260C	Total/NA
Benzene - DL	27		4.0	1.6	ug/L	4		8260C	Total/NA
Chlorobenzene - DL	250		4.0	3.0	ug/L	4		8260C	Total/NA
cis-1,2-Dichloroethene - DL	21		4.0	3.2	ug/L	4		8260C	Total/NA
Tetrachloroethene - DL	40		4.0	1.4	ug/L	4		8260C	Total/NA
Trichloroethene - DL	46		4.0	1.8	ug/L	4		8260C	Total/NA
Vinyl chloride - DL	5.3		4.0	3.6	ug/L	4		8260C	Total/NA

Client Sample ID: OW-8B — Lab Sample ID: 480-232730-22

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1-Dichloroethane	2.6		1.0	0.38	ug/L	1		8260C	Total/NA
1,1-Dichloroethene	0.42	J	1.0	0.29	ug/L	1		8260C	Total/NA
1,2,3-Trichlorobenzene	0.87	J	1.0	0.41	ug/L	1		8260C	Total/NA
1,2,4-Trichlorobenzene	3.8		1.0	0.41	ug/L	1		8260C	Total/NA
1,2-Dichlorobenzene	370	E	1.0	0.79	ug/L	1		8260C	Total/NA
1,3-Dichlorobenzene	170	E	1.0	0.78	ug/L	1		8260C	Total/NA
1,4-Dichlorobenzene	250	E	1.0	0.84	ug/L	1		8260C	Total/NA
Benzene	46		1.0	0.41	ug/L	1		8260C	Total/NA
Chlorobenzene	480	E	1.0	0.75	ug/L	1		8260C	Total/NA
cis-1,2-Dichloroethene	39		1.0	0.81	ug/L	1		8260C	Total/NA
Tetrachloroethene	1.7		1.0	0.36	ug/L	1		8260C	Total/NA
Toluene	0.71	J	1.0	0.51	ug/L	1		8260C	Total/NA
trans-1,2-Dichloroethene	7.5		1.0	0.90	ug/L	1		8260C	Total/NA
Trichloroethene	23		1.0	0.46	ug/L	1		8260C	Total/NA
Vinyl chloride	21		1.0	0.90	ug/L	1		8260C	Total/NA
1,2-Dichlorobenzene - DL	350		10	7.9	ug/L	10		8260C	Total/NA
1,3-Dichlorobenzene - DL	170		10	7.8	ug/L	10		8260C	Total/NA
1,4-Dichlorobenzene - DL	240		10	8.4	ug/L	10		8260C	Total/NA
Benzene - DL	43		10	4.1	ug/L	10		8260C	Total/NA
Chlorobenzene - DL	430		10	7.5	ug/L	10		8260C	Total/NA
cis-1,2-Dichloroethene - DL	37		10	8.1	ug/L	10		8260C	Total/NA
Trichloroethene - DL	22		10	4.6	ug/L	10		8260C	Total/NA
Vinyl chloride - DL	19		10	9.0	ug/L	10		8260C	Total/NA

Client Sample ID: MW-1B — Lab Sample ID: 480-232730-23

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,4-Trichlorobenzene	210	J	400	160	ug/L	400		8260C	Total/NA
1,2-Dichlorobenzene	1800		400	320	ug/L	400		8260C	Total/NA
1,3-Dichlorobenzene	2300		400	310	ug/L	400		8260C	Total/NA
1,4-Dichlorobenzene	9400		400	340	ug/L	400		8260C	Total/NA
Benzene	250	J	400	160	ug/L	400		8260C	Total/NA
Chlorobenzene	25000		400	300	ug/L	400		8260C	Total/NA

This Detection Summary does not include radiochemical test results.

Detection Summary

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: MW-1C — Lab Sample ID: 480-232730-24

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Benzene	840		50	21	ug/L	50		8260C	Total/NA
Chlorobenzene	46	J	50	38	ug/L	50		8260C	Total/NA
cis-1,2-Dichloroethene	2900		50	41	ug/L	50		8260C	Total/NA
trans-1,2-Dichloroethene	140		50	45	ug/L	50		8260C	Total/NA
Vinyl chloride	1100		50	45	ug/L	50		8260C	Total/NA

Client Sample ID: MW-1CD — Lab Sample ID: 480-232730-25

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2-Dichlorobenzene	9000		800	630	ug/L	800		8260C	Total/NA
1,3-Dichlorobenzene	1100		800	620	ug/L	800		8260C	Total/NA
1,4-Dichlorobenzene	5900		800	670	ug/L	800		8260C	Total/NA
Benzene	3300		800	330	ug/L	800		8260C	Total/NA
Chlorobenzene	31000		800	600	ug/L	800		8260C	Total/NA
cis-1,2-Dichloroethene	5600		800	650	ug/L	800		8260C	Total/NA
Vinyl chloride	1500		800	720	ug/L	800		8260C	Total/NA

Client Sample ID: MW-1F — Lab Sample ID: 480-232730-26

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Acetone	85		50	15	ug/L	5		8260C	Total/NA
Benzene	2.4	J	5.0	2.1	ug/L	5		8260C	Total/NA
cis-1,2-Dichloroethene	14		5.0	4.1	ug/L	5		8260C	Total/NA
trans-1,2-Dichloroethene	25		5.0	4.5	ug/L	5		8260C	Total/NA
Trichloroethene	2.7	J	5.0	2.3	ug/L	5		8260C	Total/NA
Vinyl chloride	250		5.0	4.5	ug/L	5		8260C	Total/NA

Client Sample ID: OW-12A — Lab Sample ID: 480-232730-27

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,4-Trichlorobenzene	47	J	100	41	ug/L	100		8260C	Total/NA
1,2-Dichlorobenzene	1800		100	79	ug/L	100		8260C	Total/NA
1,3-Dichlorobenzene	340		100	78	ug/L	100		8260C	Total/NA
1,4-Dichlorobenzene	1500		100	84	ug/L	100		8260C	Total/NA
Benzene	160		100	41	ug/L	100		8260C	Total/NA
Chlorobenzene	4200		100	75	ug/L	100		8260C	Total/NA

Client Sample ID: OW-10B — Lab Sample ID: 480-232730-28

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,4-Trichlorobenzene	720	J	800	330	ug/L	800		8260C	Total/NA
1,2-Dichlorobenzene	13000		800	630	ug/L	800		8260C	Total/NA
1,3-Dichlorobenzene	2600		800	620	ug/L	800		8260C	Total/NA
1,4-Dichlorobenzene	12000		800	670	ug/L	800		8260C	Total/NA
Benzene	2100		800	330	ug/L	800		8260C	Total/NA
Chlorobenzene	39000		800	600	ug/L	800		8260C	Total/NA

Client Sample ID: MW-2A — Lab Sample ID: 480-232730-29

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2-Dichlorobenzene	1500		200	160	ug/L	200		8260C	Total/NA
1,3-Dichlorobenzene	630		200	160	ug/L	200		8260C	Total/NA
1,4-Dichlorobenzene	2900		200	170	ug/L	200		8260C	Total/NA

This Detection Summary does not include radiochemical test results.

Eurofins Buffalo

Client Sample ID: MW-2A (Continued) — Lab Sample ID: 480-232730-29

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Benzene	460		200	82	ug/L	200		8260C	Total/NA
Chlorobenzene	14000		200	150	ug/L	200		8260C	Total/NA

Client Sample ID: OW-18A — Lab Sample ID: 480-232730-30

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2-Dichlorobenzene	2300		500	400	ug/L	500		8260C	Total/NA
1,3-Dichlorobenzene	1300		500	390	ug/L	500		8260C	Total/NA
1,4-Dichlorobenzene	9800		500	420	ug/L	500		8260C	Total/NA
Benzene	430	J	500	210	ug/L	500		8260C	Total/NA
Chlorobenzene	17000		500	380	ug/L	500		8260C	Total/NA

Client Sample ID: OW-11B — Lab Sample ID: 480-232730-31

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,3-Trichlorobenzene	430		400	160	ug/L	400		8260C	Total/NA
1,2,4-Trichlorobenzene	1400		400	160	ug/L	400		8260C	Total/NA
1,2-Dichlorobenzene	9400		400	320	ug/L	400		8260C	Total/NA
1,3-Dichlorobenzene	2800		400	310	ug/L	400		8260C	Total/NA
1,4-Dichlorobenzene	7800		400	340	ug/L	400		8260C	Total/NA
Benzene	1900		400	160	ug/L	400		8260C	Total/NA
Chlorobenzene	4700		400	300	ug/L	400		8260C	Total/NA

Client Sample ID: OW-111B — Lab Sample ID: 480-232730-32

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,3-Trichlorobenzene	420		200	82	ug/L	200		8260C	Total/NA
1,2,4-Trichlorobenzene	1300		200	82	ug/L	200		8260C	Total/NA
1,2-Dichlorobenzene	9000		200	160	ug/L	200		8260C	Total/NA
1,3-Dichlorobenzene	2600		200	160	ug/L	200		8260C	Total/NA
1,4-Dichlorobenzene	7800		200	170	ug/L	200		8260C	Total/NA
Benzene	1800		200	82	ug/L	200		8260C	Total/NA
Chlorobenzene	4500		200	150	ug/L	200		8260C	Total/NA

Client Sample ID: MW-6B — Lab Sample ID: 480-232730-33

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,3-Trichlorobenzene	81	J	100	41	ug/L	100		8260C	Total/NA
1,2,4-Trichlorobenzene	280		100	41	ug/L	100		8260C	Total/NA
1,2-Dichlorobenzene	7600		100	79	ug/L	100		8260C	Total/NA
1,3-Dichlorobenzene	2400		100	78	ug/L	100		8260C	Total/NA
1,4-Dichlorobenzene	4900		100	84	ug/L	100		8260C	Total/NA
Benzene	400		100	41	ug/L	100		8260C	Total/NA
Chlorobenzene	4800		100	75	ug/L	100		8260C	Total/NA

Client Sample ID: MW-6F — Lab Sample ID: 480-232730-34

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Acetone	150	J	500	150	ug/L	50		8260C	Total/NA
cis-1,2-Dichloroethene	480		50	41	ug/L	50		8260C	Total/NA
Vinyl chloride	1200		50	45	ug/L	50		8260C	Total/NA

This Detection Summary does not include radiochemical test results.

Client Sample ID: OW-14B — Lab Sample ID: 480-232730-35

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	640		200	42	ug/L	200		8260C	Total/NA
1,2,4-Trichlorobenzene	160	J	200	82	ug/L	200		8260C	Total/NA
1,2-Dichlorobenzene	990		200	160	ug/L	200		8260C	Total/NA
1,3-Dichlorobenzene	470		200	160	ug/L	200		8260C	Total/NA
1,4-Dichlorobenzene	1400		200	170	ug/L	200		8260C	Total/NA
Benzene	130	J	200	82	ug/L	200		8260C	Total/NA
Chlorobenzene	610		200	150	ug/L	200		8260C	Total/NA
Chloroform	300		200	68	ug/L	200		8260C	Total/NA
cis-1,2-Dichloroethene	5800		200	160	ug/L	200		8260C	Total/NA
Tetrachloroethene	2700		200	72	ug/L	200		8260C	Total/NA
Trichloroethene	11000		200	92	ug/L	200		8260C	Total/NA
Vinyl chloride	450		200	180	ug/L	200		8260C	Total/NA

Client Sample ID: OW-22A — Lab Sample ID: 480-232730-36

No Detections.

Client Sample ID: OW-22B — Lab Sample ID: 480-232730-37

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	730		400	84	ug/L	400		8260C	Total/NA
1,2,4-Trichlorobenzene	200	J	400	160	ug/L	400		8260C	Total/NA
Benzene	170	J	400	160	ug/L	400		8260C	Total/NA
Chlorobenzene	340	J	400	300	ug/L	400		8260C	Total/NA
Chloroform	200	J	400	140	ug/L	400		8260C	Total/NA
cis-1,2-Dichloroethene	5600		400	320	ug/L	400		8260C	Total/NA
Tetrachloroethene	6400		400	140	ug/L	400		8260C	Total/NA
Trichloroethene	17000	F1	400	180	ug/L	400		8260C	Total/NA
Vinyl chloride	550		400	360	ug/L	400		8260C	Total/NA

Client Sample ID: OW-15B — Lab Sample ID: 480-232730-38

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	290		200	42	ug/L	200		8260C	Total/NA
1,2-Dichlorobenzene	270		200	160	ug/L	200		8260C	Total/NA
1,3-Dichlorobenzene	200		200	160	ug/L	200		8260C	Total/NA
1,4-Dichlorobenzene	340		200	170	ug/L	200		8260C	Total/NA
Benzene	120	J	200	82	ug/L	200		8260C	Total/NA
Chlorobenzene	590		200	150	ug/L	200		8260C	Total/NA
cis-1,2-Dichloroethene	5200		200	160	ug/L	200		8260C	Total/NA
Tetrachloroethene	1700		200	72	ug/L	200		8260C	Total/NA
Trichloroethene	5600		200	92	ug/L	200		8260C	Total/NA
Vinyl chloride	610		200	180	ug/L	200		8260C	Total/NA

Client Sample ID: TB-01 (Trip Blank) — Lab Sample ID: 480-232730-39

No Detections.

Client Sample ID: TB-02 (Trip Blank) — Lab Sample ID: 480-232730-40

No Detections.

This Detection Summary does not include radiochemical test results.

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-26B
Date Collected: 09/16/25 08:50
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-1
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		2.0	0.70	ug/L			09/19/25 14:18	2
1,1,1-Trichloroethane	ND		2.0	1.6	ug/L			09/19/25 14:18	2
1,1,2,2-Tetrachloroethane	ND		2.0	0.42	ug/L			09/19/25 14:18	2
1,1,2-Trichloroethane	ND		2.0	0.46	ug/L			09/19/25 14:18	2
1,1-Dichloroethane	**1.9**	**J**	2.0	0.76	ug/L			09/19/25 14:18	2
1,1-Dichloroethene	ND		2.0	0.58	ug/L			09/19/25 14:18	2
1,1-Dichloropropene	ND		2.0	1.4	ug/L			09/19/25 14:18	2
1,2,3-Trichlorobenzene	ND		2.0	0.82	ug/L			09/19/25 14:18	2
1,2,3-Trichloropropane	ND		2.0	1.8	ug/L			09/19/25 14:18	2
1,2,4-Trichlorobenzene	ND		2.0	0.82	ug/L			09/19/25 14:18	2
1,2,4-Trimethylbenzene	ND		2.0	1.5	ug/L			09/19/25 14:18	2
1,2-Dibromo-3-Chloropropane	ND		2.0	0.78	ug/L			09/19/25 14:18	2
1,2-Dibromoethane	ND		2.0	1.5	ug/L			09/19/25 14:18	2
1,2-Dichlorobenzene	ND		2.0	1.6	ug/L			09/19/25 14:18	2
1,2-Dichloroethane	ND		2.0	0.42	ug/L			09/19/25 14:18	2
1,2-Dichloropropane	ND		2.0	1.4	ug/L			09/19/25 14:18	2
1,3,5-Trimethylbenzene	ND		2.0	1.5	ug/L			09/19/25 14:18	2
1,3-Dichlorobenzene	ND		2.0	1.6	ug/L			09/19/25 14:18	2
1,3-Dichloropropane	ND		2.0	1.5	ug/L			09/19/25 14:18	2
1,4-Dichlorobenzene	ND		2.0	1.7	ug/L			09/19/25 14:18	2
2,2-Dichloropropane	ND		2.0	0.80	ug/L			09/19/25 14:18	2
2-Butanone (MEK)	ND		20	2.6	ug/L			09/19/25 14:18	2
2-Chloroethyl vinyl ether	ND		10	1.9	ug/L			09/19/25 14:18	2
2-Hexanone	ND		10	2.5	ug/L			09/19/25 14:18	2
4-Methyl-2-pentanone (MIBK)	ND		10	4.2	ug/L			09/19/25 14:18	2
Acetone	ND		20	6.0	ug/L			09/19/25 14:18	2
Benzene	ND		2.0	0.82	ug/L			09/19/25 14:18	2
Bromobenzene	ND		2.0	1.6	ug/L			09/19/25 14:18	2
Bromochloromethane	ND		2.0	1.7	ug/L			09/19/25 14:18	2
Bromodichloromethane	ND		2.0	0.78	ug/L			09/19/25 14:18	2
Bromoform	ND		2.0	0.52	ug/L			09/19/25 14:18	2
Bromomethane	ND		2.0	1.4	ug/L			09/19/25 14:18	2
Carbon disulfide	ND		2.0	0.38	ug/L			09/19/25 14:18	2
Carbon tetrachloride	ND		2.0	0.54	ug/L			09/19/25 14:18	2
Chlorobenzene	ND		2.0	1.5	ug/L			09/19/25 14:18	2
Chlorodibromomethane	ND		2.0	0.64	ug/L			09/19/25 14:18	2
Chloroethane	ND		2.0	0.64	ug/L			09/19/25 14:18	2
Chloroform	ND		2.0	0.68	ug/L			09/19/25 14:18	2
Chloromethane	ND		2.0	0.70	ug/L			09/19/25 14:18	2
cis-1,2-Dichloroethene	**4.0**		2.0	1.6	ug/L			09/19/25 14:18	2
cis-1,3-Dichloropropene	ND		2.0	0.72	ug/L			09/19/25 14:18	2
Dichlorodifluoromethane	ND		2.0	1.4	ug/L			09/19/25 14:18	2
Ethylbenzene	ND		2.0	1.5	ug/L			09/19/25 14:18	2
Hexachlorobutadiene	ND		4.0	0.56	ug/L			09/19/25 14:18	2
Isopropylbenzene	ND		2.0	1.6	ug/L			09/19/25 14:18	2
Methyl tert-butyl ether	ND		2.0	0.32	ug/L			09/19/25 14:18	2
Methylene Chloride	ND		2.0	0.88	ug/L			09/19/25 14:18	2
m-Xylene & p-Xylene	ND		4.0	1.3	ug/L			09/19/25 14:18	2
Naphthalene	ND		2.0	0.86	ug/L			09/19/25 14:18	2

Client Sample ID: OW-26B
Lab Sample ID: 480-232730-1

Date Collected: 09/16/25 08:50
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
n-Butylbenzene	ND		2.0	1.3	ug/L			09/19/25 14:18	2
N-Propylbenzene	ND		2.0	1.4	ug/L			09/19/25 14:18	2
o-Chlorotoluene	ND		2.0	1.7	ug/L			09/19/25 14:18	2
o-Xylene	ND		2.0	1.5	ug/L			09/19/25 14:18	2
p-Chlorotoluene	ND		2.0	1.7	ug/L			09/19/25 14:18	2
p-Cymene	ND		2.0	0.62	ug/L			09/19/25 14:18	2
sec-Butylbenzene	ND		2.0	1.5	ug/L			09/19/25 14:18	2
Styrene	ND		2.0	1.5	ug/L			09/19/25 14:18	2
tert-Butylbenzene	ND		2.0	1.6	ug/L			09/19/25 14:18	2
Tetrachloroethene	**70**		2.0	0.72	ug/L			09/19/25 14:18	2
Toluene	ND		2.0	1.0	ug/L			09/19/25 14:18	2
trans-1,2-Dichloroethene	**2.3**		2.0	1.8	ug/L			09/19/25 14:18	2
trans-1,3-Dichloropropene	ND		2.0	0.74	ug/L			09/19/25 14:18	2
Trichloroethene	**3.7**		2.0	0.92	ug/L			09/19/25 14:18	2
Trichlorofluoromethane	ND		2.0	1.8	ug/L			09/19/25 14:18	2
Vinyl acetate	ND		10	1.7	ug/L			09/19/25 14:18	2
Vinyl chloride	ND		2.0	1.8	ug/L			09/19/25 14:18	2

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*100*		*77 - 120*		*09/19/25 14:18*	*2*
4-Bromofluorobenzene (Surr)	*96*		*73 - 120*		*09/19/25 14:18*	*2*
Dibromofluoromethane (Surr)	*96*		*75 - 123*		*09/19/25 14:18*	*2*
Toluene-d8 (Surr)	*98*		*80 - 120*		*09/19/25 14:18*	*2*

Client Sample ID: OW-30B
Lab Sample ID: 480-232730-2

Date Collected: 09/16/25 09:30
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			09/19/25 14:40	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			09/19/25 14:40	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			09/19/25 14:40	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			09/19/25 14:40	1
1,1-Dichloroethane	**3.1**		1.0	0.38	ug/L			09/19/25 14:40	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			09/19/25 14:40	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			09/19/25 14:40	1
1,2,3-Trichlorobenzene	**1.4**		1.0	0.41	ug/L			09/19/25 14:40	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			09/19/25 14:40	1
1,2,4-Trichlorobenzene	**1.5**		1.0	0.41	ug/L			09/19/25 14:40	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			09/19/25 14:40	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			09/19/25 14:40	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			09/19/25 14:40	1
1,2-Dichlorobenzene	**140**	**E**	1.0	0.79	ug/L			09/19/25 14:40	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			09/19/25 14:40	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			09/19/25 14:40	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			09/19/25 14:40	1
1,3-Dichlorobenzene	**130**	**E**	1.0	0.78	ug/L			09/19/25 14:40	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			09/19/25 14:40	1
1,4-Dichlorobenzene	**250**	**E**	1.0	0.84	ug/L			09/19/25 14:40	1

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-30B

Date Collected: 09/16/25 09:30
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-2

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
2,2-Dichloropropane	ND		1.0	0.40	ug/L			09/19/25 14:40	1
2-Butanone (MEK)	ND		10	1.3	ug/L			09/19/25 14:40	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			09/19/25 14:40	1
2-Hexanone	ND		5.0	1.2	ug/L			09/19/25 14:40	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			09/19/25 14:40	1
Acetone	ND		10	3.0	ug/L			09/19/25 14:40	1
Benzene	**100**	**E**	1.0	0.41	ug/L			09/19/25 14:40	1
Bromobenzene	ND		1.0	0.80	ug/L			09/19/25 14:40	1
Bromochloromethane	ND		1.0	0.87	ug/L			09/19/25 14:40	1
Bromodichloromethane	ND		1.0	0.39	ug/L			09/19/25 14:40	1
Bromoform	ND		1.0	0.26	ug/L			09/19/25 14:40	1
Bromomethane	ND		1.0	0.69	ug/L			09/19/25 14:40	1
Carbon disulfide	ND		1.0	0.19	ug/L			09/19/25 14:40	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			09/19/25 14:40	1
Chlorobenzene	**740**	**E ES**	1.0	0.75	ug/L			09/19/25 14:40	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			09/19/25 14:40	1
Chloroethane	ND		1.0	0.32	ug/L			09/19/25 14:40	1
Chloroform	ND		1.0	0.34	ug/L			09/19/25 14:40	1
Chloromethane	ND		1.0	0.35	ug/L			09/19/25 14:40	1
cis-1,2-Dichloroethene	**10**		1.0	0.81	ug/L			09/19/25 14:40	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			09/19/25 14:40	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			09/19/25 14:40	1
Ethylbenzene	**0.74**	**J**	1.0	0.74	ug/L			09/19/25 14:40	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			09/19/25 14:40	1
Isopropylbenzene	ND		1.0	0.79	ug/L			09/19/25 14:40	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			09/19/25 14:40	1
Methylene Chloride	ND		1.0	0.44	ug/L			09/19/25 14:40	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			09/19/25 14:40	1
Naphthalene	ND		1.0	0.43	ug/L			09/19/25 14:40	1
n-Butylbenzene	ND		1.0	0.64	ug/L			09/19/25 14:40	1
N-Propylbenzene	ND		1.0	0.69	ug/L			09/19/25 14:40	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			09/19/25 14:40	1
o-Xylene	ND		1.0	0.76	ug/L			09/19/25 14:40	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			09/19/25 14:40	1
p-Cymene	ND		1.0	0.31	ug/L			09/19/25 14:40	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			09/19/25 14:40	1
Styrene	ND		1.0	0.73	ug/L			09/19/25 14:40	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			09/19/25 14:40	1
Tetrachloroethene	**22**		1.0	0.36	ug/L			09/19/25 14:40	1
Toluene	**0.76**	**J**	1.0	0.51	ug/L			09/19/25 14:40	1
trans-1,2-Dichloroethene	**5.7**		1.0	0.90	ug/L			09/19/25 14:40	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			09/19/25 14:40	1
Trichloroethene	**4.9**		1.0	0.46	ug/L			09/19/25 14:40	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			09/19/25 14:40	1
Vinyl acetate	ND		5.0	0.85	ug/L			09/19/25 14:40	1
Vinyl chloride	**12**		1.0	0.90	ug/L			09/19/25 14:40	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*97*		*77 - 120*		*09/19/25 14:40*	*1*
4-Bromofluorobenzene (Surr)	*91*		*73 - 120*		*09/19/25 14:40*	*1*

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-30B
Date Collected: 09/16/25 09:30
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-2
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
Dibromofluoromethane (Surr)	*95*		*75 - 123*		*09/19/25 14:40*	*1*
Toluene-d8 (Surr)	*94*		*80 - 120*		*09/19/25 14:40*	*1*

Method: SW846 8260C - Volatile Organic Compounds by GC/MS - DL

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		20	7.0	ug/L			09/22/25 16:29	20
1,1,1-Trichloroethane	ND		20	16	ug/L			09/22/25 16:29	20
1,1,2,2-Tetrachloroethane	ND		20	4.2	ug/L			09/22/25 16:29	20
1,1,2-Trichloroethane	ND		20	4.6	ug/L			09/22/25 16:29	20
1,1-Dichloroethane	ND		20	7.6	ug/L			09/22/25 16:29	20
1,1-Dichloroethene	ND		20	5.8	ug/L			09/22/25 16:29	20
1,1-Dichloropropene	ND		20	14	ug/L			09/22/25 16:29	20
1,2,3-Trichlorobenzene	ND		20	8.2	ug/L			09/22/25 16:29	20
1,2,3-Trichloropropane	ND		20	18	ug/L			09/22/25 16:29	20
1,2,4-Trichlorobenzene	ND		20	8.2	ug/L			09/22/25 16:29	20
1,2,4-Trimethylbenzene	ND		20	15	ug/L			09/22/25 16:29	20
1,2-Dibromo-3-Chloropropane	ND		20	7.8	ug/L			09/22/25 16:29	20
1,2-Dibromoethane	ND		20	15	ug/L			09/22/25 16:29	20
1,2-Dichlorobenzene	**150**		20	16	ug/L			09/22/25 16:29	20
1,2-Dichloroethane	ND		20	4.2	ug/L			09/22/25 16:29	20
1,2-Dichloropropane	ND		20	14	ug/L			09/22/25 16:29	20
1,3,5-Trimethylbenzene	ND		20	15	ug/L			09/22/25 16:29	20
1,3-Dichlorobenzene	**130**		20	16	ug/L			09/22/25 16:29	20
1,3-Dichloropropane	ND		20	15	ug/L			09/22/25 16:29	20
1,4-Dichlorobenzene	**250**		20	17	ug/L			09/22/25 16:29	20
2,2-Dichloropropane	ND		20	8.0	ug/L			09/22/25 16:29	20
2-Butanone (MEK)	ND		200	26	ug/L			09/22/25 16:29	20
2-Chloroethyl vinyl ether	ND		100	19	ug/L			09/22/25 16:29	20
2-Hexanone	ND		100	25	ug/L			09/22/25 16:29	20
4-Methyl-2-pentanone (MIBK)	ND		100	42	ug/L			09/22/25 16:29	20
Acetone	ND		200	60	ug/L			09/22/25 16:29	20
Benzene	**110**		20	8.2	ug/L			09/22/25 16:29	20
Bromobenzene	ND		20	16	ug/L			09/22/25 16:29	20
Bromochloromethane	ND		20	17	ug/L			09/22/25 16:29	20
Bromodichloromethane	ND		20	7.8	ug/L			09/22/25 16:29	20
Bromoform	ND		20	5.2	ug/L			09/22/25 16:29	20
Bromomethane	ND		20	14	ug/L			09/22/25 16:29	20
Carbon disulfide	ND		20	3.8	ug/L			09/22/25 16:29	20
Carbon tetrachloride	ND		20	5.4	ug/L			09/22/25 16:29	20
Chlorobenzene	**1200**		20	15	ug/L			09/22/25 16:29	20
Chlorodibromomethane	ND		20	6.4	ug/L			09/22/25 16:29	20
Chloroethane	ND		20	6.4	ug/L			09/22/25 16:29	20
Chloroform	ND		20	6.8	ug/L			09/22/25 16:29	20
Chloromethane	ND		20	7.0	ug/L			09/22/25 16:29	20
cis-1,2-Dichloroethene	ND		20	16	ug/L			09/22/25 16:29	20
cis-1,3-Dichloropropene	ND		20	7.2	ug/L			09/22/25 16:29	20
Dichlorodifluoromethane	ND		20	14	ug/L			09/22/25 16:29	20
Ethylbenzene	ND		20	15	ug/L			09/22/25 16:29	20
Hexachlorobutadiene	ND		40	5.6	ug/L			09/22/25 16:29	20

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-30B

Date Collected: 09/16/25 09:30
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-2

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS - DL (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Isopropylbenzene	ND		20	16	ug/L			09/22/25 16:29	20
Methyl tert-butyl ether	ND		20	3.2	ug/L			09/22/25 16:29	20
Methylene Chloride	ND		20	8.8	ug/L			09/22/25 16:29	20
m-Xylene & p-Xylene	ND		40	13	ug/L			09/22/25 16:29	20
Naphthalene	ND		20	8.6	ug/L			09/22/25 16:29	20
n-Butylbenzene	ND		20	13	ug/L			09/22/25 16:29	20
N-Propylbenzene	ND		20	14	ug/L			09/22/25 16:29	20
o-Chlorotoluene	ND		20	17	ug/L			09/22/25 16:29	20
o-Xylene	ND		20	15	ug/L			09/22/25 16:29	20
p-Chlorotoluene	ND		20	17	ug/L			09/22/25 16:29	20
p-Cymene	ND		20	6.2	ug/L			09/22/25 16:29	20
sec-Butylbenzene	ND		20	15	ug/L			09/22/25 16:29	20
Styrene	ND		20	15	ug/L			09/22/25 16:29	20
tert-Butylbenzene	ND		20	16	ug/L			09/22/25 16:29	20
Tetrachloroethene	**29**		20	7.2	ug/L			09/22/25 16:29	20
Toluene	ND		20	10	ug/L			09/22/25 16:29	20
trans-1,2-Dichloroethene	ND		20	18	ug/L			09/22/25 16:29	20
trans-1,3-Dichloropropene	ND		20	7.4	ug/L			09/22/25 16:29	20
Trichloroethene	ND		20	9.2	ug/L			09/22/25 16:29	20
Trichlorofluoromethane	ND		20	18	ug/L			09/22/25 16:29	20
Vinyl acetate	ND		100	17	ug/L			09/22/25 16:29	20
Vinyl chloride	ND		20	18	ug/L			09/22/25 16:29	20

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*100*		*77 - 120*		*09/22/25 16:29*	*20*
4-Bromofluorobenzene (Surr)	*96*		*73 - 120*		*09/22/25 16:29*	*20*
Dibromofluoromethane (Surr)	*99*		*75 - 123*		*09/22/25 16:29*	*20*
Toluene-d8 (Surr)	*99*		*80 - 120*		*09/22/25 16:29*	*20*

Client Sample ID: MW-5A

Date Collected: 09/16/25 10:15
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-3

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			09/19/25 15:05	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			09/19/25 15:05	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			09/19/25 15:05	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			09/19/25 15:05	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			09/19/25 15:05	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			09/19/25 15:05	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			09/19/25 15:05	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			09/19/25 15:05	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			09/19/25 15:05	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			09/19/25 15:05	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			09/19/25 15:05	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			09/19/25 15:05	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			09/19/25 15:05	1
1,2-Dichlorobenzene	ND		1.0	0.79	ug/L			09/19/25 15:05	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			09/19/25 15:05	1

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: MW-5A
Date Collected: 09/16/25 10:15
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-3
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,2-Dichloropropane	ND		1.0	0.72	ug/L			09/19/25 15:05	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			09/19/25 15:05	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			09/19/25 15:05	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			09/19/25 15:05	1
1,4-Dichlorobenzene	ND		1.0	0.84	ug/L			09/19/25 15:05	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			09/19/25 15:05	1
2-Butanone (MEK)	ND		10	1.3	ug/L			09/19/25 15:05	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			09/19/25 15:05	1
2-Hexanone	ND		5.0	1.2	ug/L			09/19/25 15:05	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			09/19/25 15:05	1
Acetone	ND		10	3.0	ug/L			09/19/25 15:05	1
Benzene	ND		1.0	0.41	ug/L			09/19/25 15:05	1
Bromobenzene	ND		1.0	0.80	ug/L			09/19/25 15:05	1
Bromochloromethane	ND		1.0	0.87	ug/L			09/19/25 15:05	1
Bromodichloromethane	ND		1.0	0.39	ug/L			09/19/25 15:05	1
Bromoform	ND		1.0	0.26	ug/L			09/19/25 15:05	1
Bromomethane	ND		1.0	0.69	ug/L			09/19/25 15:05	1
Carbon disulfide	ND		1.0	0.19	ug/L			09/19/25 15:05	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			09/19/25 15:05	1
Chlorobenzene	ND		1.0	0.75	ug/L			09/19/25 15:05	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			09/19/25 15:05	1
Chloroethane	ND		1.0	0.32	ug/L			09/19/25 15:05	1
Chloroform	ND		1.0	0.34	ug/L			09/19/25 15:05	1
Chloromethane	ND		1.0	0.35	ug/L			09/19/25 15:05	1
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			09/19/25 15:05	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			09/19/25 15:05	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			09/19/25 15:05	1
Ethylbenzene	ND		1.0	0.74	ug/L			09/19/25 15:05	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			09/19/25 15:05	1
Isopropylbenzene	ND		1.0	0.79	ug/L			09/19/25 15:05	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			09/19/25 15:05	1
Methylene Chloride	ND		1.0	0.44	ug/L			09/19/25 15:05	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			09/19/25 15:05	1
Naphthalene	ND		1.0	0.43	ug/L			09/19/25 15:05	1
n-Butylbenzene	ND		1.0	0.64	ug/L			09/19/25 15:05	1
N-Propylbenzene	ND		1.0	0.69	ug/L			09/19/25 15:05	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			09/19/25 15:05	1
o-Xylene	ND		1.0	0.76	ug/L			09/19/25 15:05	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			09/19/25 15:05	1
p-Cymene	ND		1.0	0.31	ug/L			09/19/25 15:05	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			09/19/25 15:05	1
Styrene	ND		1.0	0.73	ug/L			09/19/25 15:05	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			09/19/25 15:05	1
Tetrachloroethene	**16**		1.0	0.36	ug/L			09/19/25 15:05	1
Toluene	ND		1.0	0.51	ug/L			09/19/25 15:05	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			09/19/25 15:05	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			09/19/25 15:05	1
Trichloroethene	ND		1.0	0.46	ug/L			09/19/25 15:05	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			09/19/25 15:05	1

Client Sample ID: MW-5A
Lab Sample ID: 480-232730-3

Date Collected: 09/16/25 10:15
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Vinyl acetate	ND		5.0	0.85	ug/L			09/19/25 15:05	1
Vinyl chloride	ND		1.0	0.90	ug/L			09/19/25 15:05	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*103*		*77 - 120*		*09/19/25 15:05*	*1*
4-Bromofluorobenzene (Surr)	*97*		*73 - 120*		*09/19/25 15:05*	*1*
Dibromofluoromethane (Surr)	*101*		*75 - 123*		*09/19/25 15:05*	*1*
Toluene-d8 (Surr)	*97*		*80 - 120*		*09/19/25 15:05*	*1*

Client Sample ID: MW-5C
Lab Sample ID: 480-232730-4

Date Collected: 09/16/25 10:00
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		50	18	ug/L			09/22/25 16:51	50
1,1,1-Trichloroethane	ND		50	41	ug/L			09/22/25 16:51	50
1,1,2,2-Tetrachloroethane	ND		50	11	ug/L			09/22/25 16:51	50
1,1,2-Trichloroethane	ND		50	12	ug/L			09/22/25 16:51	50
1,1-Dichloroethane	ND		50	19	ug/L			09/22/25 16:51	50
1,1-Dichloroethene	ND		50	15	ug/L			09/22/25 16:51	50
1,1-Dichloropropene	ND		50	36	ug/L			09/22/25 16:51	50
1,2,3-Trichlorobenzene	ND		50	21	ug/L			09/22/25 16:51	50
1,2,3-Trichloropropane	ND		50	45	ug/L			09/22/25 16:51	50
1,2,4-Trichlorobenzene	ND		50	21	ug/L			09/22/25 16:51	50
1,2,4-Trimethylbenzene	ND		50	38	ug/L			09/22/25 16:51	50
1,2-Dibromo-3-Chloropropane	ND		50	20	ug/L			09/22/25 16:51	50
1,2-Dibromoethane	ND		50	37	ug/L			09/22/25 16:51	50
1,2-Dichlorobenzene	**200**		50	40	ug/L			09/22/25 16:51	50
1,2-Dichloroethane	ND		50	11	ug/L			09/22/25 16:51	50
1,2-Dichloropropane	ND		50	36	ug/L			09/22/25 16:51	50
1,3,5-Trimethylbenzene	ND		50	39	ug/L			09/22/25 16:51	50
1,3-Dichlorobenzene	**390**		50	39	ug/L			09/22/25 16:51	50
1,3-Dichloropropane	ND		50	38	ug/L			09/22/25 16:51	50
1,4-Dichlorobenzene	**930**		50	42	ug/L			09/22/25 16:51	50
2,2-Dichloropropane	ND		50	20	ug/L			09/22/25 16:51	50
2-Butanone (MEK)	ND		500	66	ug/L			09/22/25 16:51	50
2-Chloroethyl vinyl ether	ND		250	48	ug/L			09/22/25 16:51	50
2-Hexanone	ND		250	62	ug/L			09/22/25 16:51	50
4-Methyl-2-pentanone (MIBK)	ND		250	110	ug/L			09/22/25 16:51	50
Acetone	ND		500	150	ug/L			09/22/25 16:51	50
Benzene	**280**		50	21	ug/L			09/22/25 16:51	50
Bromobenzene	ND		50	40	ug/L			09/22/25 16:51	50
Bromochloromethane	ND		50	44	ug/L			09/22/25 16:51	50
Bromodichloromethane	ND		50	20	ug/L			09/22/25 16:51	50
Bromoform	ND		50	13	ug/L			09/22/25 16:51	50
Bromomethane	ND		50	35	ug/L			09/22/25 16:51	50
Carbon disulfide	ND		50	9.5	ug/L			09/22/25 16:51	50
Carbon tetrachloride	ND		50	14	ug/L			09/22/25 16:51	50
Chlorobenzene	**3300**		50	38	ug/L			09/22/25 16:51	50

Client Sample ID: MW-5C
Lab Sample ID: 480-232730-4

Date Collected: 09/16/25 10:00
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chlorodibromomethane	ND		50	16	ug/L			09/22/25 16:51	50
Chloroethane	ND		50	16	ug/L			09/22/25 16:51	50
Chloroform	ND		50	17	ug/L			09/22/25 16:51	50
Chloromethane	ND		50	18	ug/L			09/22/25 16:51	50
cis-1,2-Dichloroethene	ND		50	41	ug/L			09/22/25 16:51	50
cis-1,3-Dichloropropene	ND		50	18	ug/L			09/22/25 16:51	50
Dichlorodifluoromethane	ND		50	34	ug/L			09/22/25 16:51	50
Ethylbenzene	ND		50	37	ug/L			09/22/25 16:51	50
Hexachlorobutadiene	ND		100	14	ug/L			09/22/25 16:51	50
Isopropylbenzene	ND		50	40	ug/L			09/22/25 16:51	50
Methyl tert-butyl ether	ND		50	8.0	ug/L			09/22/25 16:51	50
Methylene Chloride	ND		50	22	ug/L			09/22/25 16:51	50
m-Xylene & p-Xylene	ND		100	33	ug/L			09/22/25 16:51	50
Naphthalene	ND		50	22	ug/L			09/22/25 16:51	50
n-Butylbenzene	ND		50	32	ug/L			09/22/25 16:51	50
N-Propylbenzene	ND		50	35	ug/L			09/22/25 16:51	50
o-Chlorotoluene	ND		50	43	ug/L			09/22/25 16:51	50
o-Xylene	ND		50	38	ug/L			09/22/25 16:51	50
p-Chlorotoluene	ND		50	42	ug/L			09/22/25 16:51	50
p-Cymene	ND		50	16	ug/L			09/22/25 16:51	50
sec-Butylbenzene	ND		50	38	ug/L			09/22/25 16:51	50
Styrene	ND		50	37	ug/L			09/22/25 16:51	50
tert-Butylbenzene	ND		50	41	ug/L			09/22/25 16:51	50
Tetrachloroethene	ND		50	18	ug/L			09/22/25 16:51	50
Toluene	ND		50	26	ug/L			09/22/25 16:51	50
trans-1,2-Dichloroethene	ND		50	45	ug/L			09/22/25 16:51	50
trans-1,3-Dichloropropene	ND		50	19	ug/L			09/22/25 16:51	50
Trichloroethene	ND		50	23	ug/L			09/22/25 16:51	50
Trichlorofluoromethane	ND		50	44	ug/L			09/22/25 16:51	50
Vinyl acetate	ND		250	43	ug/L			09/22/25 16:51	50
Vinyl chloride	ND		50	45	ug/L			09/22/25 16:51	50

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*99*		*77 - 120*		*09/22/25 16:51*	*50*
4-Bromofluorobenzene (Surr)	*98*		*73 - 120*		*09/22/25 16:51*	*50*
Dibromofluoromethane (Surr)	*111*		*75 - 123*		*09/22/25 16:51*	*50*
Toluene-d8 (Surr)	*96*		*80 - 120*		*09/22/25 16:51*	*50*

Client Sample ID: MW-5CD
Lab Sample ID: 480-232730-5

Date Collected: 09/16/25 10:30
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		10	3.5	ug/L			09/19/25 15:50	10
1,1,1-Trichloroethane	ND		10	8.2	ug/L			09/19/25 15:50	10
1,1,2,2-Tetrachloroethane	ND		10	2.1	ug/L			09/19/25 15:50	10
1,1,2-Trichloroethane	ND		10	2.3	ug/L			09/19/25 15:50	10
1,1-Dichloroethane	ND		10	3.8	ug/L			09/19/25 15:50	10
1,1-Dichloroethene	ND		10	2.9	ug/L			09/19/25 15:50	10

Client Sample ID: MW-5CD
Lab Sample ID: 480-232730-5
Date Collected: 09/16/25 10:30
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1-Dichloropropene	ND		10	7.2	ug/L			09/19/25 15:50	10
1,2,3-Trichlorobenzene	ND		10	4.1	ug/L			09/19/25 15:50	10
1,2,3-Trichloropropane	ND		10	8.9	ug/L			09/19/25 15:50	10
1,2,4-Trichlorobenzene	ND		10	4.1	ug/L			09/19/25 15:50	10
1,2,4-Trimethylbenzene	ND		10	7.5	ug/L			09/19/25 15:50	10
1,2-Dibromo-3-Chloropropane	ND		10	3.9	ug/L			09/19/25 15:50	10
1,2-Dibromoethane	ND		10	7.3	ug/L			09/19/25 15:50	10
1,2-Dichlorobenzene	**17**		10	7.9	ug/L			09/19/25 15:50	10
1,2-Dichloroethane	ND		10	2.1	ug/L			09/19/25 15:50	10
1,2-Dichloropropane	ND		10	7.2	ug/L			09/19/25 15:50	10
1,3,5-Trimethylbenzene	ND		10	7.7	ug/L			09/19/25 15:50	10
1,3-Dichlorobenzene	ND		10	7.8	ug/L			09/19/25 15:50	10
1,3-Dichloropropane	ND		10	7.5	ug/L			09/19/25 15:50	10
1,4-Dichlorobenzene	**16**		10	8.4	ug/L			09/19/25 15:50	10
2,2-Dichloropropane	ND		10	4.0	ug/L			09/19/25 15:50	10
2-Butanone (MEK)	ND		100	13	ug/L			09/19/25 15:50	10
2-Chloroethyl vinyl ether	ND		50	9.6	ug/L			09/19/25 15:50	10
2-Hexanone	ND		50	12	ug/L			09/19/25 15:50	10
4-Methyl-2-pentanone (MIBK)	ND		50	21	ug/L			09/19/25 15:50	10
Acetone	ND		100	30	ug/L			09/19/25 15:50	10
Benzene	**23**		10	4.1	ug/L			09/19/25 15:50	10
Bromobenzene	ND		10	8.0	ug/L			09/19/25 15:50	10
Bromochloromethane	ND		10	8.7	ug/L			09/19/25 15:50	10
Bromodichloromethane	ND		10	3.9	ug/L			09/19/25 15:50	10
Bromoform	ND		10	2.6	ug/L			09/19/25 15:50	10
Bromomethane	ND		10	6.9	ug/L			09/19/25 15:50	10
Carbon disulfide	ND		10	1.9	ug/L			09/19/25 15:50	10
Carbon tetrachloride	ND		10	2.7	ug/L			09/19/25 15:50	10
Chlorobenzene	**12**		10	7.5	ug/L			09/19/25 15:50	10
Chlorodibromomethane	ND		10	3.2	ug/L			09/19/25 15:50	10
Chloroethane	ND		10	3.2	ug/L			09/19/25 15:50	10
Chloroform	ND		10	3.4	ug/L			09/19/25 15:50	10
Chloromethane	ND		10	3.5	ug/L			09/19/25 15:50	10
cis-1,2-Dichloroethene	**780**		10	8.1	ug/L			09/19/25 15:50	10
cis-1,3-Dichloropropene	ND		10	3.6	ug/L			09/19/25 15:50	10
Dichlorodifluoromethane	ND		10	6.8	ug/L			09/19/25 15:50	10
Ethylbenzene	ND		10	7.4	ug/L			09/19/25 15:50	10
Hexachlorobutadiene	ND		20	2.8	ug/L			09/19/25 15:50	10
Isopropylbenzene	ND		10	7.9	ug/L			09/19/25 15:50	10
Methyl tert-butyl ether	ND		10	1.6	ug/L			09/19/25 15:50	10
Methylene Chloride	ND		10	4.4	ug/L			09/19/25 15:50	10
m-Xylene & p-Xylene	ND		20	6.6	ug/L			09/19/25 15:50	10
Naphthalene	ND		10	4.3	ug/L			09/19/25 15:50	10
n-Butylbenzene	ND		10	6.4	ug/L			09/19/25 15:50	10
N-Propylbenzene	ND		10	6.9	ug/L			09/19/25 15:50	10
o-Chlorotoluene	ND		10	8.6	ug/L			09/19/25 15:50	10
o-Xylene	ND		10	7.6	ug/L			09/19/25 15:50	10
p-Chlorotoluene	ND		10	8.4	ug/L			09/19/25 15:50	10
p-Cymene	ND		10	3.1	ug/L			09/19/25 15:50	10

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: MW-5CD

Date Collected: 09/16/25 10:30
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-5

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
sec-Butylbenzene	ND		10	7.5	ug/L			09/19/25 15:50	10
Styrene	ND		10	7.3	ug/L			09/19/25 15:50	10
tert-Butylbenzene	ND		10	8.1	ug/L			09/19/25 15:50	10
Tetrachloroethene	ND		10	3.6	ug/L			09/19/25 15:50	10
Toluene	ND		10	5.1	ug/L			09/19/25 15:50	10
trans-1,2-Dichloroethene	**31**		10	9.0	ug/L			09/19/25 15:50	10
trans-1,3-Dichloropropene	ND		10	3.7	ug/L			09/19/25 15:50	10
Trichloroethene	ND		10	4.6	ug/L			09/19/25 15:50	10
Trichlorofluoromethane	ND		10	8.8	ug/L			09/19/25 15:50	10
Vinyl acetate	ND		50	8.5	ug/L			09/19/25 15:50	10
Vinyl chloride	**330**		10	9.0	ug/L			09/19/25 15:50	10

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*98*		*77 - 120*		*09/19/25 15:50*	*10*
4-Bromofluorobenzene (Surr)	*97*		*73 - 120*		*09/19/25 15:50*	*10*
Dibromofluoromethane (Surr)	*98*		*75 - 123*		*09/19/25 15:50*	*10*
Toluene-d8 (Surr)	*97*		*80 - 120*		*09/19/25 15:50*	*10*

Client Sample ID: MW-5F

Date Collected: 09/16/25 10:40
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-6

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		80	28	ug/L			09/19/25 16:12	80
1,1,1-Trichloroethane	ND		80	66	ug/L			09/19/25 16:12	80
1,1,2,2-Tetrachloroethane	ND		80	17	ug/L			09/19/25 16:12	80
1,1,2-Trichloroethane	ND		80	18	ug/L			09/19/25 16:12	80
1,1-Dichloroethane	ND		80	30	ug/L			09/19/25 16:12	80
1,1-Dichloroethene	ND		80	23	ug/L			09/19/25 16:12	80
1,1-Dichloropropene	ND		80	58	ug/L			09/19/25 16:12	80
1,2,3-Trichlorobenzene	ND		80	33	ug/L			09/19/25 16:12	80
1,2,3-Trichloropropane	ND		80	71	ug/L			09/19/25 16:12	80
1,2,4-Trichlorobenzene	**37**	**J**	80	33	ug/L			09/19/25 16:12	80
1,2,4-Trimethylbenzene	ND		80	60	ug/L			09/19/25 16:12	80
1,2-Dibromo-3-Chloropropane	ND		80	31	ug/L			09/19/25 16:12	80
1,2-Dibromoethane	ND		80	58	ug/L			09/19/25 16:12	80
1,2-Dichlorobenzene	**4900**		80	63	ug/L			09/19/25 16:12	80
1,2-Dichloroethane	ND		80	17	ug/L			09/19/25 16:12	80
1,2-Dichloropropane	ND		80	58	ug/L			09/19/25 16:12	80
1,3,5-Trimethylbenzene	ND		80	62	ug/L			09/19/25 16:12	80
1,3-Dichlorobenzene	**420**		80	62	ug/L			09/19/25 16:12	80
1,3-Dichloropropane	ND		80	60	ug/L			09/19/25 16:12	80
1,4-Dichlorobenzene	**2000**		80	67	ug/L			09/19/25 16:12	80
2,2-Dichloropropane	ND		80	32	ug/L			09/19/25 16:12	80
2-Butanone (MEK)	ND		800	110	ug/L			09/19/25 16:12	80
2-Chloroethyl vinyl ether	ND		400	77	ug/L			09/19/25 16:12	80
2-Hexanone	ND		400	99	ug/L			09/19/25 16:12	80
4-Methyl-2-pentanone (MIBK)	ND		400	170	ug/L			09/19/25 16:12	80
Acetone	ND		800	240	ug/L			09/19/25 16:12	80

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: MW-5F
Date Collected: 09/16/25 10:40
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-6
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	**2300**		80	33	ug/L			09/19/25 16:12	80
Bromobenzene	ND		80	64	ug/L			09/19/25 16:12	80
Bromochloromethane	ND		80	70	ug/L			09/19/25 16:12	80
Bromodichloromethane	ND		80	31	ug/L			09/19/25 16:12	80
Bromoform	ND		80	21	ug/L			09/19/25 16:12	80
Bromomethane	ND		80	55	ug/L			09/19/25 16:12	80
Carbon disulfide	ND		80	15	ug/L			09/19/25 16:12	80
Carbon tetrachloride	ND		80	22	ug/L			09/19/25 16:12	80
Chlorobenzene	**6200**		80	60	ug/L			09/19/25 16:12	80
Chlorodibromomethane	ND		80	26	ug/L			09/19/25 16:12	80
Chloroethane	ND		80	26	ug/L			09/19/25 16:12	80
Chloroform	ND		80	27	ug/L			09/19/25 16:12	80
Chloromethane	ND		80	28	ug/L			09/19/25 16:12	80
cis-1,2-Dichloroethene	ND		80	65	ug/L			09/19/25 16:12	80
cis-1,3-Dichloropropene	ND		80	29	ug/L			09/19/25 16:12	80
Dichlorodifluoromethane	ND		80	54	ug/L			09/19/25 16:12	80
Ethylbenzene	ND		80	59	ug/L			09/19/25 16:12	80
Hexachlorobutadiene	ND		160	22	ug/L			09/19/25 16:12	80
Isopropylbenzene	ND		80	63	ug/L			09/19/25 16:12	80
Methyl tert-butyl ether	ND		80	13	ug/L			09/19/25 16:12	80
Methylene Chloride	ND		80	35	ug/L			09/19/25 16:12	80
m-Xylene & p-Xylene	ND		160	53	ug/L			09/19/25 16:12	80
Naphthalene	ND		80	34	ug/L			09/19/25 16:12	80
n-Butylbenzene	ND		80	51	ug/L			09/19/25 16:12	80
N-Propylbenzene	ND		80	55	ug/L			09/19/25 16:12	80
o-Chlorotoluene	ND		80	69	ug/L			09/19/25 16:12	80
o-Xylene	ND		80	61	ug/L			09/19/25 16:12	80
p-Chlorotoluene	ND		80	67	ug/L			09/19/25 16:12	80
p-Cymene	ND		80	25	ug/L			09/19/25 16:12	80
sec-Butylbenzene	ND		80	60	ug/L			09/19/25 16:12	80
Styrene	ND		80	58	ug/L			09/19/25 16:12	80
tert-Butylbenzene	ND		80	65	ug/L			09/19/25 16:12	80
Tetrachloroethene	ND		80	29	ug/L			09/19/25 16:12	80
Toluene	ND		80	41	ug/L			09/19/25 16:12	80
trans-1,2-Dichloroethene	ND		80	72	ug/L			09/19/25 16:12	80
trans-1,3-Dichloropropene	ND		80	30	ug/L			09/19/25 16:12	80
Trichloroethene	ND		80	37	ug/L			09/19/25 16:12	80
Trichlorofluoromethane	ND		80	70	ug/L			09/19/25 16:12	80
Vinyl acetate	ND		400	68	ug/L			09/19/25 16:12	80
Vinyl chloride	ND		80	72	ug/L			09/19/25 16:12	80

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*102*		*77 - 120*		*09/19/25 16:12*	*80*
4-Bromofluorobenzene (Surr)	*94*		*73 - 120*		*09/19/25 16:12*	*80*
Dibromofluoromethane (Surr)	*103*		*75 - 123*		*09/19/25 16:12*	*80*
Toluene-d8 (Surr)	*97*		*80 - 120*		*09/19/25 16:12*	*80*

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-12B
Date Collected: 09/16/25 11:10
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-7
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		10	3.5	ug/L			09/19/25 16:34	10
1,1,1-Trichloroethane	ND		10	8.2	ug/L			09/19/25 16:34	10
1,1,2,2-Tetrachloroethane	ND		10	2.1	ug/L			09/19/25 16:34	10
1,1,2-Trichloroethane	ND		10	2.3	ug/L			09/19/25 16:34	10
1,1-Dichloroethane	ND		10	3.8	ug/L			09/19/25 16:34	10
1,1-Dichloroethene	ND		10	2.9	ug/L			09/19/25 16:34	10
1,1-Dichloropropene	ND		10	7.2	ug/L			09/19/25 16:34	10
1,2,3-Trichlorobenzene	ND		10	4.1	ug/L			09/19/25 16:34	10
1,2,3-Trichloropropane	ND		10	8.9	ug/L			09/19/25 16:34	10
1,2,4-Trichlorobenzene	**6.0**	**J**	10	4.1	ug/L			09/19/25 16:34	10
1,2,4-Trimethylbenzene	ND		10	7.5	ug/L			09/19/25 16:34	10
1,2-Dibromo-3-Chloropropane	ND		10	3.9	ug/L			09/19/25 16:34	10
1,2-Dibromoethane	ND		10	7.3	ug/L			09/19/25 16:34	10
1,2-Dichlorobenzene	**490**		10	7.9	ug/L			09/19/25 16:34	10
1,2-Dichloroethane	ND		10	2.1	ug/L			09/19/25 16:34	10
1,2-Dichloropropane	ND		10	7.2	ug/L			09/19/25 16:34	10
1,3,5-Trimethylbenzene	ND		10	7.7	ug/L			09/19/25 16:34	10
1,3-Dichlorobenzene	**260**		10	7.8	ug/L			09/19/25 16:34	10
1,3-Dichloropropane	ND		10	7.5	ug/L			09/19/25 16:34	10
1,4-Dichlorobenzene	**660**		10	8.4	ug/L			09/19/25 16:34	10
2,2-Dichloropropane	ND		10	4.0	ug/L			09/19/25 16:34	10
2-Butanone (MEK)	ND		100	13	ug/L			09/19/25 16:34	10
2-Chloroethyl vinyl ether	ND		50	9.6	ug/L			09/19/25 16:34	10
2-Hexanone	ND		50	12	ug/L			09/19/25 16:34	10
4-Methyl-2-pentanone (MIBK)	ND		50	21	ug/L			09/19/25 16:34	10
Acetone	ND		100	30	ug/L			09/19/25 16:34	10
Benzene	**210**		10	4.1	ug/L			09/19/25 16:34	10
Bromobenzene	ND		10	8.0	ug/L			09/19/25 16:34	10
Bromochloromethane	ND		10	8.7	ug/L			09/19/25 16:34	10
Bromodichloromethane	ND		10	3.9	ug/L			09/19/25 16:34	10
Bromoform	ND		10	2.6	ug/L			09/19/25 16:34	10
Bromomethane	ND		10	6.9	ug/L			09/19/25 16:34	10
Carbon disulfide	ND		10	1.9	ug/L			09/19/25 16:34	10
Carbon tetrachloride	ND		10	2.7	ug/L			09/19/25 16:34	10
Chlorobenzene	**1800**	**E**	10	7.5	ug/L			09/19/25 16:34	10
Chlorodibromomethane	ND		10	3.2	ug/L			09/19/25 16:34	10
Chloroethane	ND		10	3.2	ug/L			09/19/25 16:34	10
Chloroform	ND		10	3.4	ug/L			09/19/25 16:34	10
Chloromethane	ND		10	3.5	ug/L			09/19/25 16:34	10
cis-1,2-Dichloroethene	**81**		10	8.1	ug/L			09/19/25 16:34	10
cis-1,3-Dichloropropene	ND		10	3.6	ug/L			09/19/25 16:34	10
Dichlorodifluoromethane	ND		10	6.8	ug/L			09/19/25 16:34	10
Ethylbenzene	ND		10	7.4	ug/L			09/19/25 16:34	10
Hexachlorobutadiene	ND		20	2.8	ug/L			09/19/25 16:34	10
Isopropylbenzene	ND		10	7.9	ug/L			09/19/25 16:34	10
Methyl tert-butyl ether	ND		10	1.6	ug/L			09/19/25 16:34	10
Methylene Chloride	ND		10	4.4	ug/L			09/19/25 16:34	10
m-Xylene & p-Xylene	ND		20	6.6	ug/L			09/19/25 16:34	10
Naphthalene	ND		10	4.3	ug/L			09/19/25 16:34	10

Client Sample ID: OW-12B
Date Collected: 09/16/25 11:10
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-7
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
n-Butylbenzene	ND		10	6.4	ug/L			09/19/25 16:34	10
N-Propylbenzene	ND		10	6.9	ug/L			09/19/25 16:34	10
o-Chlorotoluene	ND		10	8.6	ug/L			09/19/25 16:34	10
o-Xylene	ND		10	7.6	ug/L			09/19/25 16:34	10
p-Chlorotoluene	ND		10	8.4	ug/L			09/19/25 16:34	10
p-Cymene	ND		10	3.1	ug/L			09/19/25 16:34	10
sec-Butylbenzene	ND		10	7.5	ug/L			09/19/25 16:34	10
Styrene	ND		10	7.3	ug/L			09/19/25 16:34	10
tert-Butylbenzene	ND		10	8.1	ug/L			09/19/25 16:34	10
Tetrachloroethene	ND		10	3.6	ug/L			09/19/25 16:34	10
Toluene	ND		10	5.1	ug/L			09/19/25 16:34	10
trans-1,2-Dichloroethene	ND		10	9.0	ug/L			09/19/25 16:34	10
trans-1,3-Dichloropropene	ND		10	3.7	ug/L			09/19/25 16:34	10
Trichloroethene	ND		10	4.6	ug/L			09/19/25 16:34	10
Trichlorofluoromethane	ND		10	8.8	ug/L			09/19/25 16:34	10
Vinyl acetate	ND		50	8.5	ug/L			09/19/25 16:34	10
Vinyl chloride	**140**		10	9.0	ug/L			09/19/25 16:34	10

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*102*		*77 - 120*		*09/19/25 16:34*	*10*
4-Bromofluorobenzene (Surr)	*94*		*73 - 120*		*09/19/25 16:34*	*10*
Dibromofluoromethane (Surr)	*110*		*75 - 123*		*09/19/25 16:34*	*10*
Toluene-d8 (Surr)	*97*		*80 - 120*		*09/19/25 16:34*	*10*

Method: SW846 8260C - Volatile Organic Compounds by GC/MS - DL

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		40	14	ug/L			09/22/25 17:13	40
1,1,1-Trichloroethane	ND		40	33	ug/L			09/22/25 17:13	40
1,1,2,2-Tetrachloroethane	ND		40	8.4	ug/L			09/22/25 17:13	40
1,1,2-Trichloroethane	ND		40	9.2	ug/L			09/22/25 17:13	40
1,1-Dichloroethane	ND		40	15	ug/L			09/22/25 17:13	40
1,1-Dichloroethene	ND		40	12	ug/L			09/22/25 17:13	40
1,1-Dichloropropene	ND		40	29	ug/L			09/22/25 17:13	40
1,2,3-Trichlorobenzene	ND		40	16	ug/L			09/22/25 17:13	40
1,2,3-Trichloropropane	ND		40	36	ug/L			09/22/25 17:13	40
1,2,4-Trichlorobenzene	ND		40	16	ug/L			09/22/25 17:13	40
1,2,4-Trimethylbenzene	ND		40	30	ug/L			09/22/25 17:13	40
1,2-Dibromo-3-Chloropropane	ND		40	16	ug/L			09/22/25 17:13	40
1,2-Dibromoethane	ND		40	29	ug/L			09/22/25 17:13	40
1,2-Dichlorobenzene	**690**		40	32	ug/L			09/22/25 17:13	40
1,2-Dichloroethane	ND		40	8.4	ug/L			09/22/25 17:13	40
1,2-Dichloropropane	ND		40	29	ug/L			09/22/25 17:13	40
1,3,5-Trimethylbenzene	ND		40	31	ug/L			09/22/25 17:13	40
1,3-Dichlorobenzene	**360**		40	31	ug/L			09/22/25 17:13	40
1,3-Dichloropropane	ND		40	30	ug/L			09/22/25 17:13	40
1,4-Dichlorobenzene	**910**		40	34	ug/L			09/22/25 17:13	40
2,2-Dichloropropane	ND		40	16	ug/L			09/22/25 17:13	40
2-Butanone (MEK)	ND		400	53	ug/L			09/22/25 17:13	40
2-Chloroethyl vinyl ether	ND		200	38	ug/L			09/22/25 17:13	40
2-Hexanone	ND		200	50	ug/L			09/22/25 17:13	40

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-12B

Date Collected: 09/16/25 11:10
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-7

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS - DL (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
4-Methyl-2-pentanone (MIBK)	ND		200	84	ug/L			09/22/25 17:13	40
Acetone	ND		400	120	ug/L			09/22/25 17:13	40
Benzene	**300**		40	16	ug/L			09/22/25 17:13	40
Bromobenzene	ND		40	32	ug/L			09/22/25 17:13	40
Bromochloromethane	ND		40	35	ug/L			09/22/25 17:13	40
Bromodichloromethane	ND		40	16	ug/L			09/22/25 17:13	40
Bromoform	ND		40	10	ug/L			09/22/25 17:13	40
Bromomethane	ND		40	28	ug/L			09/22/25 17:13	40
Carbon disulfide	ND		40	7.6	ug/L			09/22/25 17:13	40
Carbon tetrachloride	ND		40	11	ug/L			09/22/25 17:13	40
Chlorobenzene	**2300**		40	30	ug/L			09/22/25 17:13	40
Chlorodibromomethane	ND		40	13	ug/L			09/22/25 17:13	40
Chloroethane	ND		40	13	ug/L			09/22/25 17:13	40
Chloroform	**14**	**J**	40	14	ug/L			09/22/25 17:13	40
Chloromethane	ND		40	14	ug/L			09/22/25 17:13	40
cis-1,2-Dichloroethene	**110**		40	32	ug/L			09/22/25 17:13	40
cis-1,3-Dichloropropene	ND		40	14	ug/L			09/22/25 17:13	40
Dichlorodifluoromethane	ND		40	27	ug/L			09/22/25 17:13	40
Ethylbenzene	ND		40	30	ug/L			09/22/25 17:13	40
Hexachlorobutadiene	ND		80	11	ug/L			09/22/25 17:13	40
Isopropylbenzene	ND		40	32	ug/L			09/22/25 17:13	40
Methyl tert-butyl ether	ND		40	6.4	ug/L			09/22/25 17:13	40
Methylene Chloride	ND		40	18	ug/L			09/22/25 17:13	40
m-Xylene & p-Xylene	ND		80	26	ug/L			09/22/25 17:13	40
Naphthalene	ND		40	17	ug/L			09/22/25 17:13	40
n-Butylbenzene	ND		40	26	ug/L			09/22/25 17:13	40
N-Propylbenzene	ND		40	28	ug/L			09/22/25 17:13	40
o-Chlorotoluene	ND		40	34	ug/L			09/22/25 17:13	40
o-Xylene	ND		40	30	ug/L			09/22/25 17:13	40
p-Chlorotoluene	ND		40	34	ug/L			09/22/25 17:13	40
p-Cymene	ND		40	12	ug/L			09/22/25 17:13	40
sec-Butylbenzene	ND		40	30	ug/L			09/22/25 17:13	40
Styrene	ND		40	29	ug/L			09/22/25 17:13	40
tert-Butylbenzene	ND		40	32	ug/L			09/22/25 17:13	40
Tetrachloroethene	ND		40	14	ug/L			09/22/25 17:13	40
Toluene	ND		40	20	ug/L			09/22/25 17:13	40
trans-1,2-Dichloroethene	ND		40	36	ug/L			09/22/25 17:13	40
trans-1,3-Dichloropropene	ND		40	15	ug/L			09/22/25 17:13	40
Trichloroethene	ND		40	18	ug/L			09/22/25 17:13	40
Trichlorofluoromethane	ND		40	35	ug/L			09/22/25 17:13	40
Vinyl acetate	ND		200	34	ug/L			09/22/25 17:13	40
Vinyl chloride	**220**		40	36	ug/L			09/22/25 17:13	40

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*101*		*77 - 120*		*09/22/25 17:13*	*40*
4-Bromofluorobenzene (Surr)	*99*		*73 - 120*		*09/22/25 17:13*	*40*
Dibromofluoromethane (Surr)	*122*		*75 - 123*		*09/22/25 17:13*	*40*
Toluene-d8 (Surr)	*94*		*80 - 120*		*09/22/25 17:13*	*40*

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-9A
Date Collected: 09/16/25 11:20
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-8
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		50	18	ug/L			09/19/25 16:57	50
1,1,1-Trichloroethane	ND		50	41	ug/L			09/19/25 16:57	50
1,1,2,2-Tetrachloroethane	ND		50	11	ug/L			09/19/25 16:57	50
1,1,2-Trichloroethane	ND		50	12	ug/L			09/19/25 16:57	50
1,1-Dichloroethane	ND		50	19	ug/L			09/19/25 16:57	50
1,1-Dichloroethene	ND		50	15	ug/L			09/19/25 16:57	50
1,1-Dichloropropene	ND		50	36	ug/L			09/19/25 16:57	50
1,2,3-Trichlorobenzene	ND		50	21	ug/L			09/19/25 16:57	50
1,2,3-Trichloropropane	ND		50	45	ug/L			09/19/25 16:57	50
1,2,4-Trichlorobenzene	ND		50	21	ug/L			09/19/25 16:57	50
1,2,4-Trimethylbenzene	ND		50	38	ug/L			09/19/25 16:57	50
1,2-Dibromo-3-Chloropropane	ND		50	20	ug/L			09/19/25 16:57	50
1,2-Dibromoethane	ND		50	37	ug/L			09/19/25 16:57	50
1,2-Dichlorobenzene	**830**		50	40	ug/L			09/19/25 16:57	50
1,2-Dichloroethane	ND		50	11	ug/L			09/19/25 16:57	50
1,2-Dichloropropane	ND		50	36	ug/L			09/19/25 16:57	50
1,3,5-Trimethylbenzene	ND		50	39	ug/L			09/19/25 16:57	50
1,3-Dichlorobenzene	ND		50	39	ug/L			09/19/25 16:57	50
1,3-Dichloropropane	ND		50	38	ug/L			09/19/25 16:57	50
1,4-Dichlorobenzene	ND		50	42	ug/L			09/19/25 16:57	50
2,2-Dichloropropane	ND		50	20	ug/L			09/19/25 16:57	50
2-Butanone (MEK)	ND		500	66	ug/L			09/19/25 16:57	50
2-Chloroethyl vinyl ether	ND		250	48	ug/L			09/19/25 16:57	50
2-Hexanone	ND		250	62	ug/L			09/19/25 16:57	50
4-Methyl-2-pentanone (MIBK)	ND		250	110	ug/L			09/19/25 16:57	50
Acetone	ND		500	150	ug/L			09/19/25 16:57	50
Benzene	ND		50	21	ug/L			09/19/25 16:57	50
Bromobenzene	ND		50	40	ug/L			09/19/25 16:57	50
Bromochloromethane	ND		50	44	ug/L			09/19/25 16:57	50
Bromodichloromethane	ND		50	20	ug/L			09/19/25 16:57	50
Bromoform	ND		50	13	ug/L			09/19/25 16:57	50
Bromomethane	ND		50	35	ug/L			09/19/25 16:57	50
Carbon disulfide	ND		50	9.5	ug/L			09/19/25 16:57	50
Carbon tetrachloride	ND		50	14	ug/L			09/19/25 16:57	50
Chlorobenzene	ND		50	38	ug/L			09/19/25 16:57	50
Chlorodibromomethane	ND		50	16	ug/L			09/19/25 16:57	50
Chloroethane	ND		50	16	ug/L			09/19/25 16:57	50
Chloroform	ND		50	17	ug/L			09/19/25 16:57	50
Chloromethane	ND		50	18	ug/L			09/19/25 16:57	50
cis-1,2-Dichloroethene	**430**		50	41	ug/L			09/19/25 16:57	50
cis-1,3-Dichloropropene	ND		50	18	ug/L			09/19/25 16:57	50
Dichlorodifluoromethane	ND		50	34	ug/L			09/19/25 16:57	50
Ethylbenzene	ND		50	37	ug/L			09/19/25 16:57	50
Hexachlorobutadiene	ND		100	14	ug/L			09/19/25 16:57	50
Isopropylbenzene	ND		50	40	ug/L			09/19/25 16:57	50
Methyl tert-butyl ether	ND		50	8.0	ug/L			09/19/25 16:57	50
Methylene Chloride	ND		50	22	ug/L			09/19/25 16:57	50
m-Xylene & p-Xylene	ND		100	33	ug/L			09/19/25 16:57	50
Naphthalene	ND		50	22	ug/L			09/19/25 16:57	50

Client Sample ID: OW-9A
Date Collected: 09/16/25 11:20
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-8
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
n-Butylbenzene	ND		50	32	ug/L			09/19/25 16:57	50
N-Propylbenzene	ND		50	35	ug/L			09/19/25 16:57	50
o-Chlorotoluene	ND		50	43	ug/L			09/19/25 16:57	50
o-Xylene	ND		50	38	ug/L			09/19/25 16:57	50
p-Chlorotoluene	ND		50	42	ug/L			09/19/25 16:57	50
p-Cymene	ND		50	16	ug/L			09/19/25 16:57	50
sec-Butylbenzene	ND		50	38	ug/L			09/19/25 16:57	50
Styrene	ND		50	37	ug/L			09/19/25 16:57	50
tert-Butylbenzene	ND		50	41	ug/L			09/19/25 16:57	50
Tetrachloroethene	**7700**	**E**	50	18	ug/L			09/19/25 16:57	50
Toluene	ND		50	26	ug/L			09/19/25 16:57	50
trans-1,2-Dichloroethene	ND		50	45	ug/L			09/19/25 16:57	50
trans-1,3-Dichloropropene	ND		50	19	ug/L			09/19/25 16:57	50
Trichloroethene	**410**		50	23	ug/L			09/19/25 16:57	50
Trichlorofluoromethane	ND		50	44	ug/L			09/19/25 16:57	50
Vinyl acetate	ND		250	43	ug/L			09/19/25 16:57	50
Vinyl chloride	ND		50	45	ug/L			09/19/25 16:57	50

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*101*		*77 - 120*		*09/19/25 16:57*	*50*
4-Bromofluorobenzene (Surr)	*97*		*73 - 120*		*09/19/25 16:57*	*50*
Dibromofluoromethane (Surr)	*107*		*75 - 123*		*09/19/25 16:57*	*50*
Toluene-d8 (Surr)	*101*		*80 - 120*		*09/19/25 16:57*	*50*

Method: SW846 8260C - Volatile Organic Compounds by GC/MS - DL

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		130	44	ug/L			09/22/25 17:35	125
1,1,1-Trichloroethane	ND		130	100	ug/L			09/22/25 17:35	125
1,1,2,2-Tetrachloroethane	ND		130	26	ug/L			09/22/25 17:35	125
1,1,2-Trichloroethane	ND		130	29	ug/L			09/22/25 17:35	125
1,1-Dichloroethane	ND		130	48	ug/L			09/22/25 17:35	125
1,1-Dichloroethene	ND		130	36	ug/L			09/22/25 17:35	125
1,1-Dichloropropene	ND		130	90	ug/L			09/22/25 17:35	125
1,2,3-Trichlorobenzene	ND		130	51	ug/L			09/22/25 17:35	125
1,2,3-Trichloropropane	ND		130	110	ug/L			09/22/25 17:35	125
1,2,4-Trichlorobenzene	ND		130	51	ug/L			09/22/25 17:35	125
1,2,4-Trimethylbenzene	ND		130	94	ug/L			09/22/25 17:35	125
1,2-Dibromo-3-Chloropropane	ND		130	49	ug/L			09/22/25 17:35	125
1,2-Dibromoethane	ND		130	91	ug/L			09/22/25 17:35	125
1,2-Dichlorobenzene	**750**		130	99	ug/L			09/22/25 17:35	125
1,2-Dichloroethane	ND		130	26	ug/L			09/22/25 17:35	125
1,2-Dichloropropane	ND		130	90	ug/L			09/22/25 17:35	125
1,3,5-Trimethylbenzene	ND		130	96	ug/L			09/22/25 17:35	125
1,3-Dichlorobenzene	ND		130	98	ug/L			09/22/25 17:35	125
1,3-Dichloropropane	ND		130	94	ug/L			09/22/25 17:35	125
1,4-Dichlorobenzene	ND		130	110	ug/L			09/22/25 17:35	125
2,2-Dichloropropane	ND		130	50	ug/L			09/22/25 17:35	125
2-Butanone (MEK)	ND		1300	170	ug/L			09/22/25 17:35	125
2-Chloroethyl vinyl ether	ND		630	120	ug/L			09/22/25 17:35	125
2-Hexanone	ND		630	160	ug/L			09/22/25 17:35	125

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-9A

Date Collected: 09/16/25 11:20
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-8

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS - DL (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
4-Methyl-2-pentanone (MIBK)	ND		630	260	ug/L			09/22/25 17:35	125
Acetone	ND		1300	380	ug/L			09/22/25 17:35	125
Benzene	ND		130	51	ug/L			09/22/25 17:35	125
Bromobenzene	ND		130	100	ug/L			09/22/25 17:35	125
Bromochloromethane	ND		130	110	ug/L			09/22/25 17:35	125
Bromodichloromethane	ND		130	49	ug/L			09/22/25 17:35	125
Bromoform	ND		130	33	ug/L			09/22/25 17:35	125
Bromomethane	ND		130	86	ug/L			09/22/25 17:35	125
Carbon disulfide	ND		130	24	ug/L			09/22/25 17:35	125
Carbon tetrachloride	ND		130	34	ug/L			09/22/25 17:35	125
Chlorobenzene	ND		130	94	ug/L			09/22/25 17:35	125
Chlorodibromomethane	ND		130	40	ug/L			09/22/25 17:35	125
Chloroethane	ND		130	40	ug/L			09/22/25 17:35	125
Chloroform	ND		130	43	ug/L			09/22/25 17:35	125
Chloromethane	ND		130	44	ug/L			09/22/25 17:35	125
cis-1,2-Dichloroethene	**460**		130	100	ug/L			09/22/25 17:35	125
cis-1,3-Dichloropropene	ND		130	45	ug/L			09/22/25 17:35	125
Dichlorodifluoromethane	ND		130	85	ug/L			09/22/25 17:35	125
Ethylbenzene	ND		130	93	ug/L			09/22/25 17:35	125
Hexachlorobutadiene	ND		250	35	ug/L			09/22/25 17:35	125
Isopropylbenzene	ND		130	99	ug/L			09/22/25 17:35	125
Methyl tert-butyl ether	ND		130	20	ug/L			09/22/25 17:35	125
Methylene Chloride	ND		130	55	ug/L			09/22/25 17:35	125
m-Xylene & p-Xylene	ND		250	83	ug/L			09/22/25 17:35	125
Naphthalene	ND		130	54	ug/L			09/22/25 17:35	125
n-Butylbenzene	ND		130	80	ug/L			09/22/25 17:35	125
N-Propylbenzene	ND		130	86	ug/L			09/22/25 17:35	125
o-Chlorotoluene	ND		130	110	ug/L			09/22/25 17:35	125
o-Xylene	ND		130	95	ug/L			09/22/25 17:35	125
p-Chlorotoluene	ND		130	110	ug/L			09/22/25 17:35	125
p-Cymene	ND		130	39	ug/L			09/22/25 17:35	125
sec-Butylbenzene	ND		130	94	ug/L			09/22/25 17:35	125
Styrene	ND		130	91	ug/L			09/22/25 17:35	125
tert-Butylbenzene	ND		130	100	ug/L			09/22/25 17:35	125
Tetrachloroethene	**6900**		130	45	ug/L			09/22/25 17:35	125
Toluene	ND		130	64	ug/L			09/22/25 17:35	125
trans-1,2-Dichloroethene	ND		130	110	ug/L			09/22/25 17:35	125
trans-1,3-Dichloropropene	ND		130	46	ug/L			09/22/25 17:35	125
Trichloroethene	**370**		130	58	ug/L			09/22/25 17:35	125
Trichlorofluoromethane	ND		130	110	ug/L			09/22/25 17:35	125
Vinyl acetate	ND		630	110	ug/L			09/22/25 17:35	125
Vinyl chloride	ND		130	110	ug/L			09/22/25 17:35	125

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*106*		*77 - 120*		*09/22/25 17:35*	*125*
4-Bromofluorobenzene (Surr)	*102*		*73 - 120*		*09/22/25 17:35*	*125*
Dibromofluoromethane (Surr)	*113*		*75 - 123*		*09/22/25 17:35*	*125*
Toluene-d8 (Surr)	*100*		*80 - 120*		*09/22/25 17:35*	*125*

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-27B
Date Collected: 09/16/25 11:35
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-9
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		20	7.0	ug/L			09/22/25 17:58	20
1,1,1-Trichloroethane	ND		20	16	ug/L			09/22/25 17:58	20
1,1,2,2-Tetrachloroethane	**5.5**	**J**	20	4.2	ug/L			09/22/25 17:58	20
1,1,2-Trichloroethane	ND		20	4.6	ug/L			09/22/25 17:58	20
1,1-Dichloroethane	ND		20	7.6	ug/L			09/22/25 17:58	20
1,1-Dichloroethene	ND		20	5.8	ug/L			09/22/25 17:58	20
1,1-Dichloropropene	ND		20	14	ug/L			09/22/25 17:58	20
1,2,3-Trichlorobenzene	**8.3**	**J**	20	8.2	ug/L			09/22/25 17:58	20
1,2,3-Trichloropropane	ND		20	18	ug/L			09/22/25 17:58	20
1,2,4-Trichlorobenzene	**86**		20	8.2	ug/L			09/22/25 17:58	20
1,2,4-Trimethylbenzene	ND		20	15	ug/L			09/22/25 17:58	20
1,2-Dibromo-3-Chloropropane	ND		20	7.8	ug/L			09/22/25 17:58	20
1,2-Dibromoethane	ND		20	15	ug/L			09/22/25 17:58	20
1,2-Dichlorobenzene	**270**		20	16	ug/L			09/22/25 17:58	20
1,2-Dichloroethane	ND		20	4.2	ug/L			09/22/25 17:58	20
1,2-Dichloropropane	ND		20	14	ug/L			09/22/25 17:58	20
1,3,5-Trimethylbenzene	ND		20	15	ug/L			09/22/25 17:58	20
1,3-Dichlorobenzene	**240**		20	16	ug/L			09/22/25 17:58	20
1,3-Dichloropropane	ND		20	15	ug/L			09/22/25 17:58	20
1,4-Dichlorobenzene	**400**		20	17	ug/L			09/22/25 17:58	20
2,2-Dichloropropane	ND		20	8.0	ug/L			09/22/25 17:58	20
2-Butanone (MEK)	ND		200	26	ug/L			09/22/25 17:58	20
2-Chloroethyl vinyl ether	ND		100	19	ug/L			09/22/25 17:58	20
2-Hexanone	ND		100	25	ug/L			09/22/25 17:58	20
4-Methyl-2-pentanone (MIBK)	ND		100	42	ug/L			09/22/25 17:58	20
Acetone	ND		200	60	ug/L			09/22/25 17:58	20
Benzene	**68**		20	8.2	ug/L			09/22/25 17:58	20
Bromobenzene	ND		20	16	ug/L			09/22/25 17:58	20
Bromochloromethane	ND		20	17	ug/L			09/22/25 17:58	20
Bromodichloromethane	ND		20	7.8	ug/L			09/22/25 17:58	20
Bromoform	ND		20	5.2	ug/L			09/22/25 17:58	20
Bromomethane	ND		20	14	ug/L			09/22/25 17:58	20
Carbon disulfide	ND		20	3.8	ug/L			09/22/25 17:58	20
Carbon tetrachloride	ND		20	5.4	ug/L			09/22/25 17:58	20
Chlorobenzene	**350**		20	15	ug/L			09/22/25 17:58	20
Chlorodibromomethane	ND		20	6.4	ug/L			09/22/25 17:58	20
Chloroethane	ND		20	6.4	ug/L			09/22/25 17:58	20
Chloroform	ND		20	6.8	ug/L			09/22/25 17:58	20
Chloromethane	ND		20	7.0	ug/L			09/22/25 17:58	20
cis-1,2-Dichloroethene	**740**		20	16	ug/L			09/22/25 17:58	20
cis-1,3-Dichloropropene	ND		20	7.2	ug/L			09/22/25 17:58	20
Dichlorodifluoromethane	ND		20	14	ug/L			09/22/25 17:58	20
Ethylbenzene	ND		20	15	ug/L			09/22/25 17:58	20
Hexachlorobutadiene	ND		40	5.6	ug/L			09/22/25 17:58	20
Isopropylbenzene	ND		20	16	ug/L			09/22/25 17:58	20
Methyl tert-butyl ether	ND		20	3.2	ug/L			09/22/25 17:58	20
Methylene Chloride	ND		20	8.8	ug/L			09/22/25 17:58	20
m-Xylene & p-Xylene	ND		40	13	ug/L			09/22/25 17:58	20
Naphthalene	ND		20	8.6	ug/L			09/22/25 17:58	20

Client Sample ID: OW-27B
Lab Sample ID: 480-232730-9

Date Collected: 09/16/25 11:35
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
n-Butylbenzene	ND		20	13	ug/L			09/22/25 17:58	20
N-Propylbenzene	ND		20	14	ug/L			09/22/25 17:58	20
o-Chlorotoluene	ND		20	17	ug/L			09/22/25 17:58	20
o-Xylene	ND		20	15	ug/L			09/22/25 17:58	20
p-Chlorotoluene	ND		20	17	ug/L			09/22/25 17:58	20
p-Cymene	ND		20	6.2	ug/L			09/22/25 17:58	20
sec-Butylbenzene	ND		20	15	ug/L			09/22/25 17:58	20
Styrene	ND		20	15	ug/L			09/22/25 17:58	20
tert-Butylbenzene	ND		20	16	ug/L			09/22/25 17:58	20
Tetrachloroethene	**67**		20	7.2	ug/L			09/22/25 17:58	20
Toluene	ND		20	10	ug/L			09/22/25 17:58	20
trans-1,2-Dichloroethene	**62**		20	18	ug/L			09/22/25 17:58	20
trans-1,3-Dichloropropene	ND		20	7.4	ug/L			09/22/25 17:58	20
Trichloroethene	**83**		20	9.2	ug/L			09/22/25 17:58	20
Trichlorofluoromethane	ND		20	18	ug/L			09/22/25 17:58	20
Vinyl acetate	ND		100	17	ug/L			09/22/25 17:58	20
Vinyl chloride	**420**		20	18	ug/L			09/22/25 17:58	20

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*100*		*77 - 120*		*09/22/25 17:58*	*20*
4-Bromofluorobenzene (Surr)	*94*		*73 - 120*		*09/22/25 17:58*	*20*
Dibromofluoromethane (Surr)	*105*		*75 - 123*		*09/22/25 17:58*	*20*
Toluene-d8 (Surr)	*96*		*80 - 120*		*09/22/25 17:58*	*20*

Client Sample ID: OW-16A
Lab Sample ID: 480-232730-10

Date Collected: 09/16/25 11:45
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			09/19/25 17:41	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			09/19/25 17:41	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			09/19/25 17:41	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			09/19/25 17:41	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			09/19/25 17:41	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			09/19/25 17:41	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			09/19/25 17:41	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			09/19/25 17:41	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			09/19/25 17:41	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			09/19/25 17:41	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			09/19/25 17:41	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			09/19/25 17:41	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			09/19/25 17:41	1
1,2-Dichlorobenzene	**23**		1.0	0.79	ug/L			09/19/25 17:41	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			09/19/25 17:41	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			09/19/25 17:41	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			09/19/25 17:41	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			09/19/25 17:41	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			09/19/25 17:41	1
1,4-Dichlorobenzene	**3.5**		1.0	0.84	ug/L			09/19/25 17:41	1

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-16A

Date Collected: 09/16/25 11:45
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-10

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
2,2-Dichloropropane	ND		1.0	0.40	ug/L			09/19/25 17:41	1
2-Butanone (MEK)	ND		10	1.3	ug/L			09/19/25 17:41	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			09/19/25 17:41	1
2-Hexanone	ND		5.0	1.2	ug/L			09/19/25 17:41	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			09/19/25 17:41	1
Acetone	ND		10	3.0	ug/L			09/19/25 17:41	1
Benzene	ND		1.0	0.41	ug/L			09/19/25 17:41	1
Bromobenzene	ND		1.0	0.80	ug/L			09/19/25 17:41	1
Bromochloromethane	ND		1.0	0.87	ug/L			09/19/25 17:41	1
Bromodichloromethane	ND		1.0	0.39	ug/L			09/19/25 17:41	1
Bromoform	ND		1.0	0.26	ug/L			09/19/25 17:41	1
Bromomethane	ND		1.0	0.69	ug/L			09/19/25 17:41	1
Carbon disulfide	ND		1.0	0.19	ug/L			09/19/25 17:41	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			09/19/25 17:41	1
Chlorobenzene	ND		1.0	0.75	ug/L			09/19/25 17:41	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			09/19/25 17:41	1
Chloroethane	ND		1.0	0.32	ug/L			09/19/25 17:41	1
Chloroform	ND		1.0	0.34	ug/L			09/19/25 17:41	1
Chloromethane	ND		1.0	0.35	ug/L			09/19/25 17:41	1
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			09/19/25 17:41	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			09/19/25 17:41	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			09/19/25 17:41	1
Ethylbenzene	ND		1.0	0.74	ug/L			09/19/25 17:41	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			09/19/25 17:41	1
Isopropylbenzene	ND		1.0	0.79	ug/L			09/19/25 17:41	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			09/19/25 17:41	1
Methylene Chloride	ND		1.0	0.44	ug/L			09/19/25 17:41	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			09/19/25 17:41	1
Naphthalene	ND		1.0	0.43	ug/L			09/19/25 17:41	1
n-Butylbenzene	ND		1.0	0.64	ug/L			09/19/25 17:41	1
N-Propylbenzene	ND		1.0	0.69	ug/L			09/19/25 17:41	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			09/19/25 17:41	1
o-Xylene	ND		1.0	0.76	ug/L			09/19/25 17:41	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			09/19/25 17:41	1
p-Cymene	ND		1.0	0.31	ug/L			09/19/25 17:41	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			09/19/25 17:41	1
Styrene	ND		1.0	0.73	ug/L			09/19/25 17:41	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			09/19/25 17:41	1
Tetrachloroethene	ND		1.0	0.36	ug/L			09/19/25 17:41	1
Toluene	ND		1.0	0.51	ug/L			09/19/25 17:41	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			09/19/25 17:41	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			09/19/25 17:41	1
Trichloroethene	ND		1.0	0.46	ug/L			09/19/25 17:41	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			09/19/25 17:41	1
Vinyl acetate	ND		5.0	0.85	ug/L			09/19/25 17:41	1
Vinyl chloride	ND		1.0	0.90	ug/L			09/19/25 17:41	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*105*		*77 - 120*		*09/19/25 17:41*	*1*
4-Bromofluorobenzene (Surr)	*97*		*73 - 120*		*09/19/25 17:41*	*1*

Client Sample ID: OW-16A
Lab Sample ID: 480-232730-10
Date Collected: 09/16/25 11:45
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
Dibromofluoromethane (Surr)	*115*		*75 - 123*		*09/19/25 17:41*	*1*
Toluene-d8 (Surr)	*96*		*80 - 120*		*09/19/25 17:41*	*1*

Client Sample ID: OW-13B
Lab Sample ID: 480-232730-11
Date Collected: 09/16/25 11:55
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		200	70	ug/L			09/19/25 18:03	200
1,1,1-Trichloroethane	ND		200	160	ug/L			09/19/25 18:03	200
1,1,2,2-Tetrachloroethane	ND		200	42	ug/L			09/19/25 18:03	200
1,1,2-Trichloroethane	ND		200	46	ug/L			09/19/25 18:03	200
1,1-Dichloroethane	ND		200	76	ug/L			09/19/25 18:03	200
1,1-Dichloroethene	ND		200	58	ug/L			09/19/25 18:03	200
1,1-Dichloropropene	ND		200	140	ug/L			09/19/25 18:03	200
1,2,3-Trichlorobenzene	ND		200	82	ug/L			09/19/25 18:03	200
1,2,3-Trichloropropane	ND		200	180	ug/L			09/19/25 18:03	200
1,2,4-Trichlorobenzene	**1600**		200	82	ug/L			09/19/25 18:03	200
1,2,4-Trimethylbenzene	ND		200	150	ug/L			09/19/25 18:03	200
1,2-Dibromo-3-Chloropropane	ND		200	78	ug/L			09/19/25 18:03	200
1,2-Dibromoethane	ND		200	150	ug/L			09/19/25 18:03	200
1,2-Dichlorobenzene	**4900**		200	160	ug/L			09/19/25 18:03	200
1,2-Dichloroethane	ND		200	42	ug/L			09/19/25 18:03	200
1,2-Dichloropropane	ND		200	140	ug/L			09/19/25 18:03	200
1,3,5-Trimethylbenzene	ND		200	150	ug/L			09/19/25 18:03	200
1,3-Dichlorobenzene	**2000**		200	160	ug/L			09/19/25 18:03	200
1,3-Dichloropropane	ND		200	150	ug/L			09/19/25 18:03	200
1,4-Dichlorobenzene	**6700**		200	170	ug/L			09/19/25 18:03	200
2,2-Dichloropropane	ND		200	80	ug/L			09/19/25 18:03	200
2-Butanone (MEK)	ND		2000	260	ug/L			09/19/25 18:03	200
2-Chloroethyl vinyl ether	ND		1000	190	ug/L			09/19/25 18:03	200
2-Hexanone	ND		1000	250	ug/L			09/19/25 18:03	200
4-Methyl-2-pentanone (MIBK)	ND		1000	420	ug/L			09/19/25 18:03	200
Acetone	ND		2000	600	ug/L			09/19/25 18:03	200
Benzene	**720**		200	82	ug/L			09/19/25 18:03	200
Bromobenzene	ND		200	160	ug/L			09/19/25 18:03	200
Bromochloromethane	ND		200	170	ug/L			09/19/25 18:03	200
Bromodichloromethane	ND		200	78	ug/L			09/19/25 18:03	200
Bromoform	ND		200	52	ug/L			09/19/25 18:03	200
Bromomethane	ND		200	140	ug/L			09/19/25 18:03	200
Carbon disulfide	ND		200	38	ug/L			09/19/25 18:03	200
Carbon tetrachloride	ND		200	54	ug/L			09/19/25 18:03	200
Chlorobenzene	**6600**		200	150	ug/L			09/19/25 18:03	200
Chlorodibromomethane	ND		200	64	ug/L			09/19/25 18:03	200
Chloroethane	ND		200	64	ug/L			09/19/25 18:03	200
Chloroform	ND		200	68	ug/L			09/19/25 18:03	200
Chloromethane	ND		200	70	ug/L			09/19/25 18:03	200
cis-1,2-Dichloroethene	ND		200	160	ug/L			09/19/25 18:03	200

Client Sample ID: OW-13B
Lab Sample ID: 480-232730-11

Date Collected: 09/16/25 11:55
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
cis-1,3-Dichloropropene	ND		200	72	ug/L			09/19/25 18:03	200
Dichlorodifluoromethane	ND		200	140	ug/L			09/19/25 18:03	200
Ethylbenzene	ND		200	150	ug/L			09/19/25 18:03	200
Hexachlorobutadiene	ND		400	56	ug/L			09/19/25 18:03	200
Isopropylbenzene	ND		200	160	ug/L			09/19/25 18:03	200
Methyl tert-butyl ether	ND		200	32	ug/L			09/19/25 18:03	200
Methylene Chloride	ND		200	88	ug/L			09/19/25 18:03	200
m-Xylene & p-Xylene	ND		400	130	ug/L			09/19/25 18:03	200
Naphthalene	ND		200	86	ug/L			09/19/25 18:03	200
n-Butylbenzene	ND		200	130	ug/L			09/19/25 18:03	200
N-Propylbenzene	ND		200	140	ug/L			09/19/25 18:03	200
o-Chlorotoluene	ND		200	170	ug/L			09/19/25 18:03	200
o-Xylene	ND		200	150	ug/L			09/19/25 18:03	200
p-Chlorotoluene	ND		200	170	ug/L			09/19/25 18:03	200
p-Cymene	ND		200	62	ug/L			09/19/25 18:03	200
sec-Butylbenzene	ND		200	150	ug/L			09/19/25 18:03	200
Styrene	ND		200	150	ug/L			09/19/25 18:03	200
tert-Butylbenzene	ND		200	160	ug/L			09/19/25 18:03	200
Tetrachloroethene	ND		200	72	ug/L			09/19/25 18:03	200
Toluene	ND		200	100	ug/L			09/19/25 18:03	200
trans-1,2-Dichloroethene	ND		200	180	ug/L			09/19/25 18:03	200
trans-1,3-Dichloropropene	ND		200	74	ug/L			09/19/25 18:03	200
Trichloroethene	ND		200	92	ug/L			09/19/25 18:03	200
Trichlorofluoromethane	ND		200	180	ug/L			09/19/25 18:03	200
Vinyl acetate	ND		1000	170	ug/L			09/19/25 18:03	200
Vinyl chloride	**810**		200	180	ug/L			09/19/25 18:03	200

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*103*		*77 - 120*		*09/19/25 18:03*	*200*
4-Bromofluorobenzene (Surr)	*97*		*73 - 120*		*09/19/25 18:03*	*200*
Dibromofluoromethane (Surr)	*115*		*75 - 123*		*09/19/25 18:03*	*200*
Toluene-d8 (Surr)	*96*		*80 - 120*		*09/19/25 18:03*	*200*

Client Sample ID: OW-113B
Lab Sample ID: 480-232730-12

Date Collected: 09/16/25 12:55
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		200	70	ug/L			09/19/25 18:25	200
1,1,1-Trichloroethane	ND		200	160	ug/L			09/19/25 18:25	200
1,1,2,2-Tetrachloroethane	ND		200	42	ug/L			09/19/25 18:25	200
1,1,2-Trichloroethane	ND		200	46	ug/L			09/19/25 18:25	200
1,1-Dichloroethane	ND		200	76	ug/L			09/19/25 18:25	200
1,1-Dichloroethene	ND		200	58	ug/L			09/19/25 18:25	200
1,1-Dichloropropene	ND		200	140	ug/L			09/19/25 18:25	200
1,2,3-Trichlorobenzene	ND		200	82	ug/L			09/19/25 18:25	200
1,2,3-Trichloropropane	ND		200	180	ug/L			09/19/25 18:25	200
1,2,4-Trichlorobenzene	**1600**		200	82	ug/L			09/19/25 18:25	200
1,2,4-Trimethylbenzene	ND		200	150	ug/L			09/19/25 18:25	200

Client Sample ID: OW-113B
Lab Sample ID: 480-232730-12
Date Collected: 09/16/25 12:55
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,2-Dibromo-3-Chloropropane	ND		200	78	ug/L			09/19/25 18:25	200
1,2-Dibromoethane	ND		200	150	ug/L			09/19/25 18:25	200
1,2-Dichlorobenzene	**5100**		200	160	ug/L			09/19/25 18:25	200
1,2-Dichloroethane	ND		200	42	ug/L			09/19/25 18:25	200
1,2-Dichloropropane	ND		200	140	ug/L			09/19/25 18:25	200
1,3,5-Trimethylbenzene	ND		200	150	ug/L			09/19/25 18:25	200
1,3-Dichlorobenzene	**2000**		200	160	ug/L			09/19/25 18:25	200
1,3-Dichloropropane	ND		200	150	ug/L			09/19/25 18:25	200
1,4-Dichlorobenzene	**6900**		200	170	ug/L			09/19/25 18:25	200
2,2-Dichloropropane	ND		200	80	ug/L			09/19/25 18:25	200
2-Butanone (MEK)	ND		2000	260	ug/L			09/19/25 18:25	200
2-Chloroethyl vinyl ether	ND		1000	190	ug/L			09/19/25 18:25	200
2-Hexanone	ND		1000	250	ug/L			09/19/25 18:25	200
4-Methyl-2-pentanone (MIBK)	ND		1000	420	ug/L			09/19/25 18:25	200
Acetone	ND		2000	600	ug/L			09/19/25 18:25	200
Benzene	**730**		200	82	ug/L			09/19/25 18:25	200
Bromobenzene	ND		200	160	ug/L			09/19/25 18:25	200
Bromochloromethane	ND		200	170	ug/L			09/19/25 18:25	200
Bromodichloromethane	ND		200	78	ug/L			09/19/25 18:25	200
Bromoform	ND		200	52	ug/L			09/19/25 18:25	200
Bromomethane	ND		200	140	ug/L			09/19/25 18:25	200
Carbon disulfide	ND		200	38	ug/L			09/19/25 18:25	200
Carbon tetrachloride	ND		200	54	ug/L			09/19/25 18:25	200
Chlorobenzene	**6700**		200	150	ug/L			09/19/25 18:25	200
Chlorodibromomethane	ND		200	64	ug/L			09/19/25 18:25	200
Chloroethane	ND		200	64	ug/L			09/19/25 18:25	200
Chloroform	ND		200	68	ug/L			09/19/25 18:25	200
Chloromethane	ND		200	70	ug/L			09/19/25 18:25	200
cis-1,2-Dichloroethene	ND		200	160	ug/L			09/19/25 18:25	200
cis-1,3-Dichloropropene	ND		200	72	ug/L			09/19/25 18:25	200
Dichlorodifluoromethane	ND		200	140	ug/L			09/19/25 18:25	200
Ethylbenzene	ND		200	150	ug/L			09/19/25 18:25	200
Hexachlorobutadiene	ND		400	56	ug/L			09/19/25 18:25	200
Isopropylbenzene	ND		200	160	ug/L			09/19/25 18:25	200
Methyl tert-butyl ether	ND		200	32	ug/L			09/19/25 18:25	200
Methylene Chloride	ND		200	88	ug/L			09/19/25 18:25	200
m-Xylene & p-Xylene	ND		400	130	ug/L			09/19/25 18:25	200
Naphthalene	ND		200	86	ug/L			09/19/25 18:25	200
n-Butylbenzene	ND		200	130	ug/L			09/19/25 18:25	200
N-Propylbenzene	ND		200	140	ug/L			09/19/25 18:25	200
o-Chlorotoluene	ND		200	170	ug/L			09/19/25 18:25	200
o-Xylene	ND		200	150	ug/L			09/19/25 18:25	200
p-Chlorotoluene	ND		200	170	ug/L			09/19/25 18:25	200
p-Cymene	ND		200	62	ug/L			09/19/25 18:25	200
sec-Butylbenzene	ND		200	150	ug/L			09/19/25 18:25	200
Styrene	ND		200	150	ug/L			09/19/25 18:25	200
tert-Butylbenzene	ND		200	160	ug/L			09/19/25 18:25	200
Tetrachloroethene	ND		200	72	ug/L			09/19/25 18:25	200
Toluene	ND		200	100	ug/L			09/19/25 18:25	200

Client Sample ID: OW-113B
Lab Sample ID: 480-232730-12

Date Collected: 09/16/25 12:55
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
trans-1,2-Dichloroethene	ND		200	180	ug/L			09/19/25 18:25	200
trans-1,3-Dichloropropene	ND		200	74	ug/L			09/19/25 18:25	200
Trichloroethene	ND		200	92	ug/L			09/19/25 18:25	200
Trichlorofluoromethane	ND		200	180	ug/L			09/19/25 18:25	200
Vinyl acetate	ND		1000	170	ug/L			09/19/25 18:25	200
Vinyl chloride	**830**		200	180	ug/L			09/19/25 18:25	200

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*102*		*77 - 120*		*09/19/25 18:25*	*200*
4-Bromofluorobenzene (Surr)	*96*		*73 - 120*		*09/19/25 18:25*	*200*
Dibromofluoromethane (Surr)	*112*		*75 - 123*		*09/19/25 18:25*	*200*
Toluene-d8 (Surr)	*97*		*80 - 120*		*09/19/25 18:25*	*200*

Client Sample ID: OW-29B
Lab Sample ID: 480-232730-13

Date Collected: 09/16/25 13:10
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		100	35	ug/L			09/19/25 18:48	100
1,1,1-Trichloroethane	ND		100	82	ug/L			09/19/25 18:48	100
1,1,2,2-Tetrachloroethane	ND		100	21	ug/L			09/19/25 18:48	100
1,1,2-Trichloroethane	ND		100	23	ug/L			09/19/25 18:48	100
1,1-Dichloroethane	ND		100	38	ug/L			09/19/25 18:48	100
1,1-Dichloroethene	ND		100	29	ug/L			09/19/25 18:48	100
1,1-Dichloropropene	ND		100	72	ug/L			09/19/25 18:48	100
1,2,3-Trichlorobenzene	**58**	**J**	100	41	ug/L			09/19/25 18:48	100
1,2,3-Trichloropropane	ND		100	89	ug/L			09/19/25 18:48	100
1,2,4-Trichlorobenzene	**500**		100	41	ug/L			09/19/25 18:48	100
1,2,4-Trimethylbenzene	ND		100	75	ug/L			09/19/25 18:48	100
1,2-Dibromo-3-Chloropropane	ND		100	39	ug/L			09/19/25 18:48	100
1,2-Dibromoethane	ND		100	73	ug/L			09/19/25 18:48	100
1,2-Dichlorobenzene	**1500**		100	79	ug/L			09/19/25 18:48	100
1,2-Dichloroethane	ND		100	21	ug/L			09/19/25 18:48	100
1,2-Dichloropropane	ND		100	72	ug/L			09/19/25 18:48	100
1,3,5-Trimethylbenzene	ND		100	77	ug/L			09/19/25 18:48	100
1,3-Dichlorobenzene	**720**		100	78	ug/L			09/19/25 18:48	100
1,3-Dichloropropane	ND		100	75	ug/L			09/19/25 18:48	100
1,4-Dichlorobenzene	**2300**		100	84	ug/L			09/19/25 18:48	100
2,2-Dichloropropane	ND		100	40	ug/L			09/19/25 18:48	100
2-Butanone (MEK)	ND		1000	130	ug/L			09/19/25 18:48	100
2-Chloroethyl vinyl ether	ND		500	96	ug/L			09/19/25 18:48	100
2-Hexanone	ND		500	120	ug/L			09/19/25 18:48	100
4-Methyl-2-pentanone (MIBK)	ND		500	210	ug/L			09/19/25 18:48	100
Acetone	ND		1000	300	ug/L			09/19/25 18:48	100
Benzene	**250**		100	41	ug/L			09/19/25 18:48	100
Bromobenzene	ND		100	80	ug/L			09/19/25 18:48	100
Bromochloromethane	ND		100	87	ug/L			09/19/25 18:48	100
Bromodichloromethane	ND		100	39	ug/L			09/19/25 18:48	100
Bromoform	ND		100	26	ug/L			09/19/25 18:48	100

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-29B

Date Collected: 09/16/25 13:10
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-13

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Bromomethane	ND		100	69	ug/L			09/19/25 18:48	100
Carbon disulfide	ND		100	19	ug/L			09/19/25 18:48	100
Carbon tetrachloride	ND		100	27	ug/L			09/19/25 18:48	100
Chlorobenzene	**2700**		100	75	ug/L			09/19/25 18:48	100
Chlorodibromomethane	ND		100	32	ug/L			09/19/25 18:48	100
Chloroethane	ND		100	32	ug/L			09/19/25 18:48	100
Chloroform	ND		100	34	ug/L			09/19/25 18:48	100
Chloromethane	ND		100	35	ug/L			09/19/25 18:48	100
cis-1,2-Dichloroethene	**920**		100	81	ug/L			09/19/25 18:48	100
cis-1,3-Dichloropropene	ND		100	36	ug/L			09/19/25 18:48	100
Dichlorodifluoromethane	ND		100	68	ug/L			09/19/25 18:48	100
Ethylbenzene	ND		100	74	ug/L			09/19/25 18:48	100
Hexachlorobutadiene	ND		200	28	ug/L			09/19/25 18:48	100
Isopropylbenzene	ND		100	79	ug/L			09/19/25 18:48	100
Methyl tert-butyl ether	ND		100	16	ug/L			09/19/25 18:48	100
Methylene Chloride	ND		100	44	ug/L			09/19/25 18:48	100
m-Xylene & p-Xylene	ND		200	66	ug/L			09/19/25 18:48	100
Naphthalene	ND		100	43	ug/L			09/19/25 18:48	100
n-Butylbenzene	ND		100	64	ug/L			09/19/25 18:48	100
N-Propylbenzene	ND		100	69	ug/L			09/19/25 18:48	100
o-Chlorotoluene	ND		100	86	ug/L			09/19/25 18:48	100
o-Xylene	ND		100	76	ug/L			09/19/25 18:48	100
p-Chlorotoluene	ND		100	84	ug/L			09/19/25 18:48	100
p-Cymene	ND		100	31	ug/L			09/19/25 18:48	100
sec-Butylbenzene	ND		100	75	ug/L			09/19/25 18:48	100
Styrene	ND		100	73	ug/L			09/19/25 18:48	100
tert-Butylbenzene	ND		100	81	ug/L			09/19/25 18:48	100
Tetrachloroethene	ND		100	36	ug/L			09/19/25 18:48	100
Toluene	ND		100	51	ug/L			09/19/25 18:48	100
trans-1,2-Dichloroethene	**120**		100	90	ug/L			09/19/25 18:48	100
trans-1,3-Dichloropropene	ND		100	37	ug/L			09/19/25 18:48	100
Trichloroethene	ND		100	46	ug/L			09/19/25 18:48	100
Trichlorofluoromethane	ND		100	88	ug/L			09/19/25 18:48	100
Vinyl acetate	ND		500	85	ug/L			09/19/25 18:48	100
Vinyl chloride	**3100**		100	90	ug/L			09/19/25 18:48	100

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*101*		*77 - 120*		*09/19/25 18:48*	*100*
4-Bromofluorobenzene (Surr)	*98*		*73 - 120*		*09/19/25 18:48*	*100*
Dibromofluoromethane (Surr)	*107*		*75 - 123*		*09/19/25 18:48*	*100*
Toluene-d8 (Surr)	*97*		*80 - 120*		*09/19/25 18:48*	*100*

Client Sample ID: OW-15A

Date Collected: 09/16/25 13:20
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-14

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		10	3.5	ug/L			09/19/25 19:10	10
1,1,1-Trichloroethane	ND		10	8.2	ug/L			09/19/25 19:10	10

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-15A
Date Collected: 09/16/25 13:20
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-14
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		10	2.1	ug/L			09/19/25 19:10	10
1,1,2-Trichloroethane	ND		10	2.3	ug/L			09/19/25 19:10	10
1,1-Dichloroethane	ND		10	3.8	ug/L			09/19/25 19:10	10
1,1-Dichloroethene	ND		10	2.9	ug/L			09/19/25 19:10	10
1,1-Dichloropropene	ND		10	7.2	ug/L			09/19/25 19:10	10
1,2,3-Trichlorobenzene	ND		10	4.1	ug/L			09/19/25 19:10	10
1,2,3-Trichloropropane	ND		10	8.9	ug/L			09/19/25 19:10	10
1,2,4-Trichlorobenzene	**29**		10	4.1	ug/L			09/19/25 19:10	10
1,2,4-Trimethylbenzene	ND		10	7.5	ug/L			09/19/25 19:10	10
1,2-Dibromo-3-Chloropropane	ND		10	3.9	ug/L			09/19/25 19:10	10
1,2-Dibromoethane	ND		10	7.3	ug/L			09/19/25 19:10	10
1,2-Dichlorobenzene	**370**		10	7.9	ug/L			09/19/25 19:10	10
1,2-Dichloroethane	ND		10	2.1	ug/L			09/19/25 19:10	10
1,2-Dichloropropane	ND		10	7.2	ug/L			09/19/25 19:10	10
1,3,5-Trimethylbenzene	ND		10	7.7	ug/L			09/19/25 19:10	10
1,3-Dichlorobenzene	**310**		10	7.8	ug/L			09/19/25 19:10	10
1,3-Dichloropropane	ND		10	7.5	ug/L			09/19/25 19:10	10
1,4-Dichlorobenzene	**820**		10	8.4	ug/L			09/19/25 19:10	10
2,2-Dichloropropane	ND		10	4.0	ug/L			09/19/25 19:10	10
2-Butanone (MEK)	ND		100	13	ug/L			09/19/25 19:10	10
2-Chloroethyl vinyl ether	ND		50	9.6	ug/L			09/19/25 19:10	10
2-Hexanone	ND		50	12	ug/L			09/19/25 19:10	10
4-Methyl-2-pentanone (MIBK)	ND		50	21	ug/L			09/19/25 19:10	10
Acetone	ND		100	30	ug/L			09/19/25 19:10	10
Benzene	ND		10	4.1	ug/L			09/19/25 19:10	10
Bromobenzene	ND		10	8.0	ug/L			09/19/25 19:10	10
Bromochloromethane	ND		10	8.7	ug/L			09/19/25 19:10	10
Bromodichloromethane	ND		10	3.9	ug/L			09/19/25 19:10	10
Bromoform	ND		10	2.6	ug/L			09/19/25 19:10	10
Bromomethane	ND		10	6.9	ug/L			09/19/25 19:10	10
Carbon disulfide	ND		10	1.9	ug/L			09/19/25 19:10	10
Carbon tetrachloride	ND		10	2.7	ug/L			09/19/25 19:10	10
Chlorobenzene	**430**		10	7.5	ug/L			09/19/25 19:10	10
Chlorodibromomethane	ND		10	3.2	ug/L			09/19/25 19:10	10
Chloroethane	ND		10	3.2	ug/L			09/19/25 19:10	10
Chloroform	ND		10	3.4	ug/L			09/19/25 19:10	10
Chloromethane	ND		10	3.5	ug/L			09/19/25 19:10	10
cis-1,2-Dichloroethene	ND		10	8.1	ug/L			09/19/25 19:10	10
cis-1,3-Dichloropropene	ND		10	3.6	ug/L			09/19/25 19:10	10
Dichlorodifluoromethane	ND		10	6.8	ug/L			09/19/25 19:10	10
Ethylbenzene	ND		10	7.4	ug/L			09/19/25 19:10	10
Hexachlorobutadiene	ND		20	2.8	ug/L			09/19/25 19:10	10
Isopropylbenzene	ND		10	7.9	ug/L			09/19/25 19:10	10
Methyl tert-butyl ether	ND		10	1.6	ug/L			09/19/25 19:10	10
Methylene Chloride	ND		10	4.4	ug/L			09/19/25 19:10	10
m-Xylene & p-Xylene	ND		20	6.6	ug/L			09/19/25 19:10	10
Naphthalene	ND		10	4.3	ug/L			09/19/25 19:10	10
n-Butylbenzene	ND		10	6.4	ug/L			09/19/25 19:10	10
N-Propylbenzene	ND		10	6.9	ug/L			09/19/25 19:10	10

Client Sample ID: OW-15A
Lab Sample ID: 480-232730-14

Date Collected: 09/16/25 13:20
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
o-Chlorotoluene	ND		10	8.6	ug/L			09/19/25 19:10	10
o-Xylene	ND		10	7.6	ug/L			09/19/25 19:10	10
p-Chlorotoluene	ND		10	8.4	ug/L			09/19/25 19:10	10
p-Cymene	ND		10	3.1	ug/L			09/19/25 19:10	10
sec-Butylbenzene	ND		10	7.5	ug/L			09/19/25 19:10	10
Styrene	ND		10	7.3	ug/L			09/19/25 19:10	10
tert-Butylbenzene	ND		10	8.1	ug/L			09/19/25 19:10	10
Tetrachloroethene	ND		10	3.6	ug/L			09/19/25 19:10	10
Toluene	ND		10	5.1	ug/L			09/19/25 19:10	10
trans-1,2-Dichloroethene	ND		10	9.0	ug/L			09/19/25 19:10	10
trans-1,3-Dichloropropene	ND		10	3.7	ug/L			09/19/25 19:10	10
Trichloroethene	ND		10	4.6	ug/L			09/19/25 19:10	10
Trichlorofluoromethane	ND		10	8.8	ug/L			09/19/25 19:10	10
Vinyl acetate	ND		50	8.5	ug/L			09/19/25 19:10	10
Vinyl chloride	ND		10	9.0	ug/L			09/19/25 19:10	10

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*107*		*77 - 120*		*09/19/25 19:10*	*10*
4-Bromofluorobenzene (Surr)	*94*		*73 - 120*		*09/19/25 19:10*	*10*
Dibromofluoromethane (Surr)	*110*		*75 - 123*		*09/19/25 19:10*	*10*
Toluene-d8 (Surr)	*97*		*80 - 120*		*09/19/25 19:10*	*10*

Client Sample ID: OW-28B
Lab Sample ID: 480-232730-15

Date Collected: 09/16/25 13:30
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		100	35	ug/L			09/19/25 19:32	100
1,1,1-Trichloroethane	ND		100	82	ug/L			09/19/25 19:32	100
1,1,2,2-Tetrachloroethane	**320**		100	21	ug/L			09/19/25 19:32	100
1,1,2-Trichloroethane	ND		100	23	ug/L			09/19/25 19:32	100
1,1-Dichloroethane	ND		100	38	ug/L			09/19/25 19:32	100
1,1-Dichloroethene	**42**	**J**	100	29	ug/L			09/19/25 19:32	100
1,1-Dichloropropene	ND		100	72	ug/L			09/19/25 19:32	100
1,2,3-Trichlorobenzene	**64**	**J**	100	41	ug/L			09/19/25 19:32	100
1,2,3-Trichloropropane	ND		100	89	ug/L			09/19/25 19:32	100
1,2,4-Trichlorobenzene	**160**		100	41	ug/L			09/19/25 19:32	100
1,2,4-Trimethylbenzene	ND		100	75	ug/L			09/19/25 19:32	100
1,2-Dibromo-3-Chloropropane	ND		100	39	ug/L			09/19/25 19:32	100
1,2-Dibromoethane	ND		100	73	ug/L			09/19/25 19:32	100
1,2-Dichlorobenzene	**230**		100	79	ug/L			09/19/25 19:32	100
1,2-Dichloroethane	ND		100	21	ug/L			09/19/25 19:32	100
1,2-Dichloropropane	ND		100	72	ug/L			09/19/25 19:32	100
1,3,5-Trimethylbenzene	ND		100	77	ug/L			09/19/25 19:32	100
1,3-Dichlorobenzene	**160**		100	78	ug/L			09/19/25 19:32	100
1,3-Dichloropropane	ND		100	75	ug/L			09/19/25 19:32	100
1,4-Dichlorobenzene	**240**		100	84	ug/L			09/19/25 19:32	100
2,2-Dichloropropane	ND		100	40	ug/L			09/19/25 19:32	100
2-Butanone (MEK)	ND		1000	130	ug/L			09/19/25 19:32	100

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-28B

Date Collected: 09/16/25 13:30
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-15

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
2-Chloroethyl vinyl ether	ND		500	96	ug/L			09/19/25 19:32	100
2-Hexanone	ND		500	120	ug/L			09/19/25 19:32	100
4-Methyl-2-pentanone (MIBK)	ND		500	210	ug/L			09/19/25 19:32	100
Acetone	ND		1000	300	ug/L			09/19/25 19:32	100
Benzene	**100**		100	41	ug/L			09/19/25 19:32	100
Bromobenzene	ND		100	80	ug/L			09/19/25 19:32	100
Bromochloromethane	ND		100	87	ug/L			09/19/25 19:32	100
Bromodichloromethane	ND		100	39	ug/L			09/19/25 19:32	100
Bromoform	ND		100	26	ug/L			09/19/25 19:32	100
Bromomethane	ND		100	69	ug/L			09/19/25 19:32	100
Carbon disulfide	ND		100	19	ug/L			09/19/25 19:32	100
Carbon tetrachloride	ND		100	27	ug/L			09/19/25 19:32	100
Chlorobenzene	**250**		100	75	ug/L			09/19/25 19:32	100
Chlorodibromomethane	ND		100	32	ug/L			09/19/25 19:32	100
Chloroethane	ND		100	32	ug/L			09/19/25 19:32	100
Chloroform	**40**	**J**	100	34	ug/L			09/19/25 19:32	100
Chloromethane	ND		100	35	ug/L			09/19/25 19:32	100
cis-1,2-Dichloroethene	**6500**		100	81	ug/L			09/19/25 19:32	100
cis-1,3-Dichloropropene	ND		100	36	ug/L			09/19/25 19:32	100
Dichlorodifluoromethane	ND		100	68	ug/L			09/19/25 19:32	100
Ethylbenzene	ND		100	74	ug/L			09/19/25 19:32	100
Hexachlorobutadiene	ND		200	28	ug/L			09/19/25 19:32	100
Isopropylbenzene	ND		100	79	ug/L			09/19/25 19:32	100
Methyl tert-butyl ether	ND		100	16	ug/L			09/19/25 19:32	100
Methylene Chloride	ND		100	44	ug/L			09/19/25 19:32	100
m-Xylene & p-Xylene	ND		200	66	ug/L			09/19/25 19:32	100
Naphthalene	ND		100	43	ug/L			09/19/25 19:32	100
n-Butylbenzene	ND		100	64	ug/L			09/19/25 19:32	100
N-Propylbenzene	ND		100	69	ug/L			09/19/25 19:32	100
o-Chlorotoluene	ND		100	86	ug/L			09/19/25 19:32	100
o-Xylene	ND		100	76	ug/L			09/19/25 19:32	100
p-Chlorotoluene	ND		100	84	ug/L			09/19/25 19:32	100
p-Cymene	ND		100	31	ug/L			09/19/25 19:32	100
sec-Butylbenzene	ND		100	75	ug/L			09/19/25 19:32	100
Styrene	ND		100	73	ug/L			09/19/25 19:32	100
tert-Butylbenzene	ND		100	81	ug/L			09/19/25 19:32	100
Tetrachloroethene	**2900**		100	36	ug/L			09/19/25 19:32	100
Toluene	ND		100	51	ug/L			09/19/25 19:32	100
trans-1,2-Dichloroethene	**120**		100	90	ug/L			09/19/25 19:32	100
trans-1,3-Dichloropropene	ND		100	37	ug/L			09/19/25 19:32	100
Trichloroethene	**7600**		100	46	ug/L			09/19/25 19:32	100
Trichlorofluoromethane	ND		100	88	ug/L			09/19/25 19:32	100
Vinyl acetate	ND		500	85	ug/L			09/19/25 19:32	100
Vinyl chloride	**650**		100	90	ug/L			09/19/25 19:32	100

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*105*		*77 - 120*		*09/19/25 19:32*	*100*
4-Bromofluorobenzene (Surr)	*96*		*73 - 120*		*09/19/25 19:32*	*100*
Dibromofluoromethane (Surr)	*120*		*75 - 123*		*09/19/25 19:32*	*100*
Toluene-d8 (Surr)	*97*		*80 - 120*		*09/19/25 19:32*	*100*

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: MW-4B
Date Collected: 09/16/25 14:15
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-16
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		200	70	ug/L			09/19/25 19:54	200
1,1,1-Trichloroethane	ND		200	160	ug/L			09/19/25 19:54	200
1,1,2,2-Tetrachloroethane	**330**		200	42	ug/L			09/19/25 19:54	200
1,1,2-Trichloroethane	ND		200	46	ug/L			09/19/25 19:54	200
1,1-Dichloroethane	ND		200	76	ug/L			09/19/25 19:54	200
1,1-Dichloroethene	ND		200	58	ug/L			09/19/25 19:54	200
1,1-Dichloropropene	ND		200	140	ug/L			09/19/25 19:54	200
1,2,3-Trichlorobenzene	ND		200	82	ug/L			09/19/25 19:54	200
1,2,3-Trichloropropane	ND		200	180	ug/L			09/19/25 19:54	200
1,2,4-Trichlorobenzene	**200**		200	82	ug/L			09/19/25 19:54	200
1,2,4-Trimethylbenzene	ND		200	150	ug/L			09/19/25 19:54	200
1,2-Dibromo-3-Chloropropane	ND		200	78	ug/L			09/19/25 19:54	200
1,2-Dibromoethane	ND		200	150	ug/L			09/19/25 19:54	200
1,2-Dichlorobenzene	**680**		200	160	ug/L			09/19/25 19:54	200
1,2-Dichloroethane	ND		200	42	ug/L			09/19/25 19:54	200
1,2-Dichloropropane	ND		200	140	ug/L			09/19/25 19:54	200
1,3,5-Trimethylbenzene	ND		200	150	ug/L			09/19/25 19:54	200
1,3-Dichlorobenzene	**310**		200	160	ug/L			09/19/25 19:54	200
1,3-Dichloropropane	ND		200	150	ug/L			09/19/25 19:54	200
1,4-Dichlorobenzene	**740**		200	170	ug/L			09/19/25 19:54	200
2,2-Dichloropropane	ND		200	80	ug/L			09/19/25 19:54	200
2-Butanone (MEK)	ND		2000	260	ug/L			09/19/25 19:54	200
2-Chloroethyl vinyl ether	ND		1000	190	ug/L			09/19/25 19:54	200
2-Hexanone	ND		1000	250	ug/L			09/19/25 19:54	200
4-Methyl-2-pentanone (MIBK)	ND		1000	420	ug/L			09/19/25 19:54	200
Acetone	ND		2000	600	ug/L			09/19/25 19:54	200
Benzene	ND		200	82	ug/L			09/19/25 19:54	200
Bromobenzene	ND		200	160	ug/L			09/19/25 19:54	200
Bromochloromethane	ND		200	170	ug/L			09/19/25 19:54	200
Bromodichloromethane	ND		200	78	ug/L			09/19/25 19:54	200
Bromoform	ND		200	52	ug/L			09/19/25 19:54	200
Bromomethane	ND		200	140	ug/L			09/19/25 19:54	200
Carbon disulfide	ND		200	38	ug/L			09/19/25 19:54	200
Carbon tetrachloride	ND		200	54	ug/L			09/19/25 19:54	200
Chlorobenzene	**240**		200	150	ug/L			09/19/25 19:54	200
Chlorodibromomethane	ND		200	64	ug/L			09/19/25 19:54	200
Chloroethane	ND		200	64	ug/L			09/19/25 19:54	200
Chloroform	ND		200	68	ug/L			09/19/25 19:54	200
Chloromethane	ND		200	70	ug/L			09/19/25 19:54	200
cis-1,2-Dichloroethene	**3800**		200	160	ug/L			09/19/25 19:54	200
cis-1,3-Dichloropropene	ND		200	72	ug/L			09/19/25 19:54	200
Dichlorodifluoromethane	ND		200	140	ug/L			09/19/25 19:54	200
Ethylbenzene	ND		200	150	ug/L			09/19/25 19:54	200
Hexachlorobutadiene	ND		400	56	ug/L			09/19/25 19:54	200
Isopropylbenzene	ND		200	160	ug/L			09/19/25 19:54	200
Methyl tert-butyl ether	ND		200	32	ug/L			09/19/25 19:54	200
Methylene Chloride	ND		200	88	ug/L			09/19/25 19:54	200
m-Xylene & p-Xylene	ND		400	130	ug/L			09/19/25 19:54	200
Naphthalene	ND		200	86	ug/L			09/19/25 19:54	200

Client Sample ID: MW-4B

Date Collected: 09/16/25 14:15
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-16
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
n-Butylbenzene	ND		200	130	ug/L			09/19/25 19:54	200
N-Propylbenzene	ND		200	140	ug/L			09/19/25 19:54	200
o-Chlorotoluene	ND		200	170	ug/L			09/19/25 19:54	200
o-Xylene	ND		200	150	ug/L			09/19/25 19:54	200
p-Chlorotoluene	ND		200	170	ug/L			09/19/25 19:54	200
p-Cymene	ND		200	62	ug/L			09/19/25 19:54	200
sec-Butylbenzene	ND		200	150	ug/L			09/19/25 19:54	200
Styrene	ND		200	150	ug/L			09/19/25 19:54	200
tert-Butylbenzene	ND		200	160	ug/L			09/19/25 19:54	200
Tetrachloroethene	**2100**		200	72	ug/L			09/19/25 19:54	200
Toluene	ND		200	100	ug/L			09/19/25 19:54	200
trans-1,2-Dichloroethene	ND		200	180	ug/L			09/19/25 19:54	200
trans-1,3-Dichloropropene	ND		200	74	ug/L			09/19/25 19:54	200
Trichloroethene	**6200**		200	92	ug/L			09/19/25 19:54	200
Trichlorofluoromethane	ND		200	180	ug/L			09/19/25 19:54	200
Vinyl acetate	ND		1000	170	ug/L			09/19/25 19:54	200
Vinyl chloride	**180**	**J**	200	180	ug/L			09/19/25 19:54	200

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*103*		*77 - 120*		*09/19/25 19:54*	*200*
4-Bromofluorobenzene (Surr)	*99*		*73 - 120*		*09/19/25 19:54*	*200*
Dibromofluoromethane (Surr)	*119*		*75 - 123*		*09/19/25 19:54*	*200*
Toluene-d8 (Surr)	*98*		*80 - 120*		*09/19/25 19:54*	*200*

Client Sample ID: MW-4C

Date Collected: 09/16/25 13:45
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-17
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		400	140	ug/L			09/19/25 20:17	400
1,1,1-Trichloroethane	ND		400	330	ug/L			09/19/25 20:17	400
1,1,2,2-Tetrachloroethane	ND		400	84	ug/L			09/19/25 20:17	400
1,1,2-Trichloroethane	ND		400	92	ug/L			09/19/25 20:17	400
1,1-Dichloroethane	ND		400	150	ug/L			09/19/25 20:17	400
1,1-Dichloroethene	ND		400	120	ug/L			09/19/25 20:17	400
1,1-Dichloropropene	ND		400	290	ug/L			09/19/25 20:17	400
1,2,3-Trichlorobenzene	ND		400	160	ug/L			09/19/25 20:17	400
1,2,3-Trichloropropane	ND		400	360	ug/L			09/19/25 20:17	400
1,2,4-Trichlorobenzene	ND		400	160	ug/L			09/19/25 20:17	400
1,2,4-Trimethylbenzene	ND		400	300	ug/L			09/19/25 20:17	400
1,2-Dibromo-3-Chloropropane	ND		400	160	ug/L			09/19/25 20:17	400
1,2-Dibromoethane	ND		400	290	ug/L			09/19/25 20:17	400
1,2-Dichlorobenzene	**740**		400	320	ug/L			09/19/25 20:17	400
1,2-Dichloroethane	ND		400	84	ug/L			09/19/25 20:17	400
1,2-Dichloropropane	ND		400	290	ug/L			09/19/25 20:17	400
1,3,5-Trimethylbenzene	ND		400	310	ug/L			09/19/25 20:17	400
1,3-Dichlorobenzene	ND		400	310	ug/L			09/19/25 20:17	400
1,3-Dichloropropane	ND		400	300	ug/L			09/19/25 20:17	400
1,4-Dichlorobenzene	**500**		400	340	ug/L			09/19/25 20:17	400

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: MW-4C
Date Collected: 09/16/25 13:45
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-17
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
2,2-Dichloropropane	ND		400	160	ug/L			09/19/25 20:17	400
2-Butanone (MEK)	ND		4000	530	ug/L			09/19/25 20:17	400
2-Chloroethyl vinyl ether	ND		2000	380	ug/L			09/19/25 20:17	400
2-Hexanone	ND		2000	500	ug/L			09/19/25 20:17	400
4-Methyl-2-pentanone (MIBK)	ND		2000	840	ug/L			09/19/25 20:17	400
Acetone	ND		4000	1200	ug/L			09/19/25 20:17	400
Benzene	**3500**		400	160	ug/L			09/19/25 20:17	400
Bromobenzene	ND		400	320	ug/L			09/19/25 20:17	400
Bromochloromethane	ND		400	350	ug/L			09/19/25 20:17	400
Bromodichloromethane	ND		400	160	ug/L			09/19/25 20:17	400
Bromoform	ND		400	100	ug/L			09/19/25 20:17	400
Bromomethane	ND		400	280	ug/L			09/19/25 20:17	400
Carbon disulfide	ND		400	76	ug/L			09/19/25 20:17	400
Carbon tetrachloride	ND		400	110	ug/L			09/19/25 20:17	400
Chlorobenzene	**4900**		400	300	ug/L			09/19/25 20:17	400
Chlorodibromomethane	ND		400	130	ug/L			09/19/25 20:17	400
Chloroethane	ND		400	130	ug/L			09/19/25 20:17	400
Chloroform	**140**	**J**	400	140	ug/L			09/19/25 20:17	400
Chloromethane	ND		400	140	ug/L			09/19/25 20:17	400
cis-1,2-Dichloroethene	**30000**	**F1**	400	320	ug/L			09/19/25 20:17	400
cis-1,3-Dichloropropene	ND		400	140	ug/L			09/19/25 20:17	400
Dichlorodifluoromethane	ND		400	270	ug/L			09/19/25 20:17	400
Ethylbenzene	ND		400	300	ug/L			09/19/25 20:17	400
Hexachlorobutadiene	ND		800	110	ug/L			09/19/25 20:17	400
Isopropylbenzene	ND		400	320	ug/L			09/19/25 20:17	400
Methyl tert-butyl ether	ND		400	64	ug/L			09/19/25 20:17	400
Methylene Chloride	ND		400	180	ug/L			09/19/25 20:17	400
m-Xylene & p-Xylene	ND		800	260	ug/L			09/19/25 20:17	400
Naphthalene	ND		400	170	ug/L			09/19/25 20:17	400
n-Butylbenzene	ND		400	260	ug/L			09/19/25 20:17	400
N-Propylbenzene	ND		400	280	ug/L			09/19/25 20:17	400
o-Chlorotoluene	ND		400	340	ug/L			09/19/25 20:17	400
o-Xylene	ND		400	300	ug/L			09/19/25 20:17	400
p-Chlorotoluene	ND		400	340	ug/L			09/19/25 20:17	400
p-Cymene	ND		400	120	ug/L			09/19/25 20:17	400
sec-Butylbenzene	ND		400	300	ug/L			09/19/25 20:17	400
Styrene	ND		400	290	ug/L			09/19/25 20:17	400
tert-Butylbenzene	ND		400	320	ug/L			09/19/25 20:17	400
Tetrachloroethene	ND		400	140	ug/L			09/19/25 20:17	400
Toluene	ND		400	200	ug/L			09/19/25 20:17	400
trans-1,2-Dichloroethene	**480**		400	360	ug/L			09/19/25 20:17	400
trans-1,3-Dichloropropene	ND		400	150	ug/L			09/19/25 20:17	400
Trichloroethene	**1500**		400	180	ug/L			09/19/25 20:17	400
Trichlorofluoromethane	ND		400	350	ug/L			09/19/25 20:17	400
Vinyl acetate	ND		2000	340	ug/L			09/19/25 20:17	400
Vinyl chloride	**2300**		400	360	ug/L			09/19/25 20:17	400

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*103*		*77 - 120*		*09/19/25 20:17*	*400*
4-Bromofluorobenzene (Surr)	*96*		*73 - 120*		*09/19/25 20:17*	*400*

Client Sample ID: MW-4C
Lab Sample ID: 480-232730-17
Date Collected: 09/16/25 13:45
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
Dibromofluoromethane (Surr)	*110*		*75 - 123*		*09/19/25 20:17*	*400*
Toluene-d8 (Surr)	*97*		*80 - 120*		*09/19/25 20:17*	*400*

Client Sample ID: OW-5B
Lab Sample ID: 480-232730-18
Date Collected: 09/17/25 14:15
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		400	140	ug/L			09/19/25 20:39	400
1,1,1-Trichloroethane	ND		400	330	ug/L			09/19/25 20:39	400
1,1,2,2-Tetrachloroethane	**300**	**J**	400	84	ug/L			09/19/25 20:39	400
1,1,2-Trichloroethane	ND		400	92	ug/L			09/19/25 20:39	400
1,1-Dichloroethane	ND		400	150	ug/L			09/19/25 20:39	400
1,1-Dichloroethene	ND		400	120	ug/L			09/19/25 20:39	400
1,1-Dichloropropene	ND		400	290	ug/L			09/19/25 20:39	400
1,2,3-Trichlorobenzene	ND		400	160	ug/L			09/19/25 20:39	400
1,2,3-Trichloropropane	ND		400	360	ug/L			09/19/25 20:39	400
1,2,4-Trichlorobenzene	ND		400	160	ug/L			09/19/25 20:39	400
1,2,4-Trimethylbenzene	ND		400	300	ug/L			09/19/25 20:39	400
1,2-Dibromo-3-Chloropropane	ND		400	160	ug/L			09/19/25 20:39	400
1,2-Dibromoethane	ND		400	290	ug/L			09/19/25 20:39	400
1,2-Dichlorobenzene	ND		400	320	ug/L			09/19/25 20:39	400
1,2-Dichloroethane	ND		400	84	ug/L			09/19/25 20:39	400
1,2-Dichloropropane	ND		400	290	ug/L			09/19/25 20:39	400
1,3,5-Trimethylbenzene	ND		400	310	ug/L			09/19/25 20:39	400
1,3-Dichlorobenzene	ND		400	310	ug/L			09/19/25 20:39	400
1,3-Dichloropropane	ND		400	300	ug/L			09/19/25 20:39	400
1,4-Dichlorobenzene	ND		400	340	ug/L			09/19/25 20:39	400
2,2-Dichloropropane	ND		400	160	ug/L			09/19/25 20:39	400
2-Butanone (MEK)	ND		4000	530	ug/L			09/19/25 20:39	400
2-Chloroethyl vinyl ether	ND		2000	380	ug/L			09/19/25 20:39	400
2-Hexanone	ND		2000	500	ug/L			09/19/25 20:39	400
4-Methyl-2-pentanone (MIBK)	ND		2000	840	ug/L			09/19/25 20:39	400
Acetone	ND		4000	1200	ug/L			09/19/25 20:39	400
Benzene	ND		400	160	ug/L			09/19/25 20:39	400
Bromobenzene	ND		400	320	ug/L			09/19/25 20:39	400
Bromochloromethane	ND		400	350	ug/L			09/19/25 20:39	400
Bromodichloromethane	ND		400	160	ug/L			09/19/25 20:39	400
Bromoform	ND		400	100	ug/L			09/19/25 20:39	400
Bromomethane	ND		400	280	ug/L			09/19/25 20:39	400
Carbon disulfide	ND		400	76	ug/L			09/19/25 20:39	400
Carbon tetrachloride	ND		400	110	ug/L			09/19/25 20:39	400
Chlorobenzene	ND		400	300	ug/L			09/19/25 20:39	400
Chlorodibromomethane	ND		400	130	ug/L			09/19/25 20:39	400
Chloroethane	ND		400	130	ug/L			09/19/25 20:39	400
Chloroform	**140**	**J**	400	140	ug/L			09/19/25 20:39	400
Chloromethane	ND		400	140	ug/L			09/19/25 20:39	400
cis-1,2-Dichloroethene	**3800**		400	320	ug/L			09/19/25 20:39	400

Client Sample ID: OW-5B

Date Collected: 09/17/25 14:15
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-18

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
cis-1,3-Dichloropropene	ND		400	140	ug/L			09/19/25 20:39	400
Dichlorodifluoromethane	ND		400	270	ug/L			09/19/25 20:39	400
Ethylbenzene	ND		400	300	ug/L			09/19/25 20:39	400
Hexachlorobutadiene	ND		800	110	ug/L			09/19/25 20:39	400
Isopropylbenzene	ND		400	320	ug/L			09/19/25 20:39	400
Methyl tert-butyl ether	ND		400	64	ug/L			09/19/25 20:39	400
Methylene Chloride	ND		400	180	ug/L			09/19/25 20:39	400
m-Xylene & p-Xylene	ND		800	260	ug/L			09/19/25 20:39	400
Naphthalene	ND		400	170	ug/L			09/19/25 20:39	400
n-Butylbenzene	ND		400	260	ug/L			09/19/25 20:39	400
N-Propylbenzene	ND		400	280	ug/L			09/19/25 20:39	400
o-Chlorotoluene	ND		400	340	ug/L			09/19/25 20:39	400
o-Xylene	ND		400	300	ug/L			09/19/25 20:39	400
p-Chlorotoluene	ND		400	340	ug/L			09/19/25 20:39	400
p-Cymene	ND		400	120	ug/L			09/19/25 20:39	400
sec-Butylbenzene	ND		400	300	ug/L			09/19/25 20:39	400
Styrene	ND		400	290	ug/L			09/19/25 20:39	400
tert-Butylbenzene	ND		400	320	ug/L			09/19/25 20:39	400
Tetrachloroethene	**2900**		400	140	ug/L			09/19/25 20:39	400
Toluene	ND		400	200	ug/L			09/19/25 20:39	400
trans-1,2-Dichloroethene	ND		400	360	ug/L			09/19/25 20:39	400
trans-1,3-Dichloropropene	ND		400	150	ug/L			09/19/25 20:39	400
Trichloroethene	**8500**		400	180	ug/L			09/19/25 20:39	400
Trichlorofluoromethane	ND		400	350	ug/L			09/19/25 20:39	400
Vinyl acetate	ND		2000	340	ug/L			09/19/25 20:39	400
Vinyl chloride	ND		400	360	ug/L			09/19/25 20:39	400

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*104*		*77 - 120*		*09/19/25 20:39*	*400*
4-Bromofluorobenzene (Surr)	*96*		*73 - 120*		*09/19/25 20:39*	*400*
Dibromofluoromethane (Surr)	*110*		*75 - 123*		*09/19/25 20:39*	*400*
Toluene-d8 (Surr)	*98*		*80 - 120*		*09/19/25 20:39*	*400*

Client Sample ID: OW-105B

Date Collected: 09/17/25 15:15
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-19

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		100	35	ug/L			09/19/25 18:08	100
1,1,1-Trichloroethane	ND		100	82	ug/L			09/19/25 18:08	100
1,1,2,2-Tetrachloroethane	**330**		100	21	ug/L			09/19/25 18:08	100
1,1,2-Trichloroethane	ND		100	23	ug/L			09/19/25 18:08	100
1,1-Dichloroethane	ND		100	38	ug/L			09/19/25 18:08	100
1,1-Dichloroethene	ND		100	29	ug/L			09/19/25 18:08	100
1,1-Dichloropropene	ND		100	72	ug/L			09/19/25 18:08	100
1,2,3-Trichlorobenzene	**43**	**J**	100	41	ug/L			09/19/25 18:08	100
1,2,3-Trichloropropane	ND		100	89	ug/L			09/19/25 18:08	100
1,2,4-Trichlorobenzene	**120**		100	41	ug/L			09/19/25 18:08	100
1,2,4-Trimethylbenzene	ND		100	75	ug/L			09/19/25 18:08	100

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-105B
Date Collected: 09/17/25 15:15
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-19
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,2-Dibromo-3-Chloropropane	ND		100	39	ug/L			09/19/25 18:08	100
1,2-Dibromoethane	ND		100	73	ug/L			09/19/25 18:08	100
1,2-Dichlorobenzene	**130**		100	79	ug/L			09/19/25 18:08	100
1,2-Dichloroethane	ND		100	21	ug/L			09/19/25 18:08	100
1,2-Dichloropropane	ND		100	72	ug/L			09/19/25 18:08	100
1,3,5-Trimethylbenzene	ND		100	77	ug/L			09/19/25 18:08	100
1,3-Dichlorobenzene	**100**		100	78	ug/L			09/19/25 18:08	100
1,3-Dichloropropane	ND		100	75	ug/L			09/19/25 18:08	100
1,4-Dichlorobenzene	**160**		100	84	ug/L			09/19/25 18:08	100
2,2-Dichloropropane	ND		100	40	ug/L			09/19/25 18:08	100
2-Butanone (MEK)	ND		1000	130	ug/L			09/19/25 18:08	100
2-Chloroethyl vinyl ether	ND		500	96	ug/L			09/19/25 18:08	100
2-Hexanone	ND		500	120	ug/L			09/19/25 18:08	100
4-Methyl-2-pentanone (MIBK)	ND		500	210	ug/L			09/19/25 18:08	100
Acetone	ND		1000	300	ug/L			09/19/25 18:08	100
Benzene	**83**	**J**	100	41	ug/L			09/19/25 18:08	100
Bromobenzene	ND		100	80	ug/L			09/19/25 18:08	100
Bromochloromethane	ND		100	87	ug/L			09/19/25 18:08	100
Bromodichloromethane	ND		100	39	ug/L			09/19/25 18:08	100
Bromoform	ND	*+	100	26	ug/L			09/19/25 18:08	100
Bromomethane	ND		100	69	ug/L			09/19/25 18:08	100
Carbon disulfide	ND		100	19	ug/L			09/19/25 18:08	100
Carbon tetrachloride	ND		100	27	ug/L			09/19/25 18:08	100
Chlorobenzene	**230**		100	75	ug/L			09/19/25 18:08	100
Chlorodibromomethane	ND		100	32	ug/L			09/19/25 18:08	100
Chloroethane	ND		100	32	ug/L			09/19/25 18:08	100
Chloroform	ND		100	34	ug/L			09/19/25 18:08	100
Chloromethane	ND		100	35	ug/L			09/19/25 18:08	100
cis-1,2-Dichloroethene	**3200**		100	81	ug/L			09/19/25 18:08	100
cis-1,3-Dichloropropene	ND		100	36	ug/L			09/19/25 18:08	100
Dichlorodifluoromethane	ND		100	68	ug/L			09/19/25 18:08	100
Ethylbenzene	ND		100	74	ug/L			09/19/25 18:08	100
Hexachlorobutadiene	ND		200	28	ug/L			09/19/25 18:08	100
Isopropylbenzene	ND		100	79	ug/L			09/19/25 18:08	100
Methyl tert-butyl ether	ND		100	16	ug/L			09/19/25 18:08	100
Methylene Chloride	ND		100	44	ug/L			09/19/25 18:08	100
m-Xylene & p-Xylene	ND		200	66	ug/L			09/19/25 18:08	100
Naphthalene	ND		100	43	ug/L			09/19/25 18:08	100
n-Butylbenzene	ND		100	64	ug/L			09/19/25 18:08	100
N-Propylbenzene	ND		100	69	ug/L			09/19/25 18:08	100
o-Chlorotoluene	ND		100	86	ug/L			09/19/25 18:08	100
o-Xylene	ND		100	76	ug/L			09/19/25 18:08	100
p-Chlorotoluene	ND		100	84	ug/L			09/19/25 18:08	100
p-Cymene	ND		100	31	ug/L			09/19/25 18:08	100
sec-Butylbenzene	ND		100	75	ug/L			09/19/25 18:08	100
Styrene	ND		100	73	ug/L			09/19/25 18:08	100
tert-Butylbenzene	ND		100	81	ug/L			09/19/25 18:08	100
Tetrachloroethene	**3300**		100	36	ug/L			09/19/25 18:08	100
Toluene	ND		100	51	ug/L			09/19/25 18:08	100

Client Sample ID: OW-105B
Lab Sample ID: 480-232730-19

Date Collected: 09/17/25 15:15
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
trans-1,2-Dichloroethene	ND		100	90	ug/L			09/19/25 18:08	100
trans-1,3-Dichloropropene	ND		100	37	ug/L			09/19/25 18:08	100
Trichloroethene	**7900**		100	46	ug/L			09/19/25 18:08	100
Trichlorofluoromethane	ND		100	88	ug/L			09/19/25 18:08	100
Vinyl acetate	ND		500	85	ug/L			09/19/25 18:08	100
Vinyl chloride	**230**		100	90	ug/L			09/19/25 18:08	100

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*108*		*77 - 120*		*09/19/25 18:08*	*100*
4-Bromofluorobenzene (Surr)	*107*		*73 - 120*		*09/19/25 18:08*	*100*
Dibromofluoromethane (Surr)	*106*		*75 - 123*		*09/19/25 18:08*	*100*
Toluene-d8 (Surr)	*98*		*80 - 120*		*09/19/25 18:08*	*100*

Client Sample ID: OW-6B
Lab Sample ID: 480-232730-20

Date Collected: 09/17/25 14:30
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		200	70	ug/L			09/23/25 02:21	200
1,1,1-Trichloroethane	ND		200	160	ug/L			09/23/25 02:21	200
1,1,2,2-Tetrachloroethane	**130**	**J**	200	42	ug/L			09/23/25 02:21	200
1,1,2-Trichloroethane	ND		200	46	ug/L			09/23/25 02:21	200
1,1-Dichloroethane	ND		200	76	ug/L			09/23/25 02:21	200
1,1-Dichloroethene	ND		200	58	ug/L			09/23/25 02:21	200
1,1-Dichloropropene	ND		200	140	ug/L			09/23/25 02:21	200
1,2,3-Trichlorobenzene	ND		200	82	ug/L			09/23/25 02:21	200
1,2,3-Trichloropropane	ND		200	180	ug/L			09/23/25 02:21	200
1,2,4-Trichlorobenzene	**330**		200	82	ug/L			09/23/25 02:21	200
1,2,4-Trimethylbenzene	ND		200	150	ug/L			09/23/25 02:21	200
1,2-Dibromo-3-Chloropropane	ND		200	78	ug/L			09/23/25 02:21	200
1,2-Dibromoethane	ND		200	150	ug/L			09/23/25 02:21	200
1,2-Dichlorobenzene	**380**		200	160	ug/L			09/23/25 02:21	200
1,2-Dichloroethane	ND		200	42	ug/L			09/23/25 02:21	200
1,2-Dichloropropane	ND		200	140	ug/L			09/23/25 02:21	200
1,3,5-Trimethylbenzene	ND		200	150	ug/L			09/23/25 02:21	200
1,3-Dichlorobenzene	**240**		200	160	ug/L			09/23/25 02:21	200
1,3-Dichloropropane	ND		200	150	ug/L			09/23/25 02:21	200
1,4-Dichlorobenzene	**510**		200	170	ug/L			09/23/25 02:21	200
2,2-Dichloropropane	ND		200	80	ug/L			09/23/25 02:21	200
2-Butanone (MEK)	ND		2000	260	ug/L			09/23/25 02:21	200
2-Chloroethyl vinyl ether	ND		1000	190	ug/L			09/23/25 02:21	200
2-Hexanone	ND		1000	250	ug/L			09/23/25 02:21	200
4-Methyl-2-pentanone (MIBK)	ND		1000	420	ug/L			09/23/25 02:21	200
Acetone	ND		2000	600	ug/L			09/23/25 02:21	200
Benzene	**110**	**J**	200	82	ug/L			09/23/25 02:21	200
Bromobenzene	ND		200	160	ug/L			09/23/25 02:21	200
Bromochloromethane	ND		200	170	ug/L			09/23/25 02:21	200
Bromodichloromethane	ND		200	78	ug/L			09/23/25 02:21	200
Bromoform	ND		200	52	ug/L			09/23/25 02:21	200

Client Sample ID: OW-6B
Lab Sample ID: 480-232730-20

Date Collected: 09/17/25 14:30
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Bromomethane	ND		200	140	ug/L			09/23/25 02:21	200
Carbon disulfide	ND		200	38	ug/L			09/23/25 02:21	200
Carbon tetrachloride	ND		200	54	ug/L			09/23/25 02:21	200
Chlorobenzene	**610**		200	150	ug/L			09/23/25 02:21	200
Chlorodibromomethane	ND		200	64	ug/L			09/23/25 02:21	200
Chloroethane	ND		200	64	ug/L			09/23/25 02:21	200
Chloroform	ND		200	68	ug/L			09/23/25 02:21	200
Chloromethane	ND		200	70	ug/L			09/23/25 02:21	200
cis-1,2-Dichloroethene	**4800**		200	160	ug/L			09/23/25 02:21	200
cis-1,3-Dichloropropene	ND		200	72	ug/L			09/23/25 02:21	200
Dichlorodifluoromethane	ND		200	140	ug/L			09/23/25 02:21	200
Ethylbenzene	ND		200	150	ug/L			09/23/25 02:21	200
Hexachlorobutadiene	ND		400	56	ug/L			09/23/25 02:21	200
Isopropylbenzene	ND		200	160	ug/L			09/23/25 02:21	200
Methyl tert-butyl ether	ND		200	32	ug/L			09/23/25 02:21	200
Methylene Chloride	ND		200	88	ug/L			09/23/25 02:21	200
m-Xylene & p-Xylene	ND		400	130	ug/L			09/23/25 02:21	200
Naphthalene	ND		200	86	ug/L			09/23/25 02:21	200
n-Butylbenzene	ND		200	130	ug/L			09/23/25 02:21	200
N-Propylbenzene	ND		200	140	ug/L			09/23/25 02:21	200
o-Chlorotoluene	ND		200	170	ug/L			09/23/25 02:21	200
o-Xylene	ND		200	150	ug/L			09/23/25 02:21	200
p-Chlorotoluene	ND		200	170	ug/L			09/23/25 02:21	200
p-Cymene	ND		200	62	ug/L			09/23/25 02:21	200
sec-Butylbenzene	ND		200	150	ug/L			09/23/25 02:21	200
Styrene	ND		200	150	ug/L			09/23/25 02:21	200
tert-Butylbenzene	ND		200	160	ug/L			09/23/25 02:21	200
Tetrachloroethene	**1300**		200	72	ug/L			09/23/25 02:21	200
Toluene	ND		200	100	ug/L			09/23/25 02:21	200
trans-1,2-Dichloroethene	ND		200	180	ug/L			09/23/25 02:21	200
trans-1,3-Dichloropropene	ND		200	74	ug/L			09/23/25 02:21	200
Trichloroethene	**3900**		200	92	ug/L			09/23/25 02:21	200
Trichlorofluoromethane	ND		200	180	ug/L			09/23/25 02:21	200
Vinyl acetate	ND		1000	170	ug/L			09/23/25 02:21	200
Vinyl chloride	**700**		200	180	ug/L			09/23/25 02:21	200

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*104*		*77 - 120*		*09/23/25 02:21*	*200*
4-Bromofluorobenzene (Surr)	*106*		*73 - 120*		*09/23/25 02:21*	*200*
Dibromofluoromethane (Surr)	*105*		*75 - 123*		*09/23/25 02:21*	*200*
Toluene-d8 (Surr)	*98*		*80 - 120*		*09/23/25 02:21*	*200*

Client Sample ID: OW-7B
Lab Sample ID: 480-232730-21

Date Collected: 09/17/25 14:45
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			09/19/25 18:32	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			09/19/25 18:32	1

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-7B

Date Collected: 09/17/25 14:45
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-21

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	**4.5**		1.0	0.21	ug/L			09/19/25 18:32	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			09/19/25 18:32	1
1,1-Dichloroethane	**2.0**		1.0	0.38	ug/L			09/19/25 18:32	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			09/19/25 18:32	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			09/19/25 18:32	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			09/19/25 18:32	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			09/19/25 18:32	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			09/19/25 18:32	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			09/19/25 18:32	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			09/19/25 18:32	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			09/19/25 18:32	1
1,2-Dichlorobenzene	**5.6**		1.0	0.79	ug/L			09/19/25 18:32	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			09/19/25 18:32	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			09/19/25 18:32	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			09/19/25 18:32	1
1,3-Dichlorobenzene	**12**		1.0	0.78	ug/L			09/19/25 18:32	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			09/19/25 18:32	1
1,4-Dichlorobenzene	**15**		1.0	0.84	ug/L			09/19/25 18:32	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			09/19/25 18:32	1
2-Butanone (MEK)	ND		10	1.3	ug/L			09/19/25 18:32	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			09/19/25 18:32	1
2-Hexanone	ND		5.0	1.2	ug/L			09/19/25 18:32	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			09/19/25 18:32	1
Acetone	ND		10	3.0	ug/L			09/19/25 18:32	1
Benzene	**22**		1.0	0.41	ug/L			09/19/25 18:32	1
Bromobenzene	ND		1.0	0.80	ug/L			09/19/25 18:32	1
Bromochloromethane	ND		1.0	0.87	ug/L			09/19/25 18:32	1
Bromodichloromethane	ND		1.0	0.39	ug/L			09/19/25 18:32	1
Bromoform	ND	*+	1.0	0.26	ug/L			09/19/25 18:32	1
Bromomethane	ND		1.0	0.69	ug/L			09/19/25 18:32	1
Carbon disulfide	ND		1.0	0.19	ug/L			09/19/25 18:32	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			09/19/25 18:32	1
Chlorobenzene	**210**	**E**	1.0	0.75	ug/L			09/19/25 18:32	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			09/19/25 18:32	1
Chloroethane	ND		1.0	0.32	ug/L			09/19/25 18:32	1
Chloroform	**0.42**	**J**	1.0	0.34	ug/L			09/19/25 18:32	1
Chloromethane	ND		1.0	0.35	ug/L			09/19/25 18:32	1
cis-1,2-Dichloroethene	**21**		1.0	0.81	ug/L			09/19/25 18:32	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			09/19/25 18:32	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			09/19/25 18:32	1
Ethylbenzene	ND		1.0	0.74	ug/L			09/19/25 18:32	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			09/19/25 18:32	1
Isopropylbenzene	ND		1.0	0.79	ug/L			09/19/25 18:32	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			09/19/25 18:32	1
Methylene Chloride	ND		1.0	0.44	ug/L			09/19/25 18:32	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			09/19/25 18:32	1
Naphthalene	ND		1.0	0.43	ug/L			09/19/25 18:32	1
n-Butylbenzene	ND		1.0	0.64	ug/L			09/19/25 18:32	1
N-Propylbenzene	ND		1.0	0.69	ug/L			09/19/25 18:32	1

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-7B

Date Collected: 09/17/25 14:45
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-21

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
o-Chlorotoluene	ND		1.0	0.86	ug/L			09/19/25 18:32	1
o-Xylene	ND		1.0	0.76	ug/L			09/19/25 18:32	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			09/19/25 18:32	1
p-Cymene	ND		1.0	0.31	ug/L			09/19/25 18:32	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			09/19/25 18:32	1
Styrene	ND		1.0	0.73	ug/L			09/19/25 18:32	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			09/19/25 18:32	1
Tetrachloroethene	**39**		1.0	0.36	ug/L			09/19/25 18:32	1
Toluene	ND		1.0	0.51	ug/L			09/19/25 18:32	1
trans-1,2-Dichloroethene	**2.9**		1.0	0.90	ug/L			09/19/25 18:32	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			09/19/25 18:32	1
Trichloroethene	**52**		1.0	0.46	ug/L			09/19/25 18:32	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			09/19/25 18:32	1
Vinyl acetate	ND		5.0	0.85	ug/L			09/19/25 18:32	1
Vinyl chloride	**4.5**		1.0	0.90	ug/L			09/19/25 18:32	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*104*		*77 - 120*		*09/19/25 18:32*	*1*
4-Bromofluorobenzene (Surr)	*105*		*73 - 120*		*09/19/25 18:32*	*1*
Dibromofluoromethane (Surr)	*97*		*75 - 123*		*09/19/25 18:32*	*1*
Toluene-d8 (Surr)	*95*		*80 - 120*		*09/19/25 18:32*	*1*

Method: SW846 8260C - Volatile Organic Compounds by GC/MS - DL

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		4.0	1.4	ug/L			09/22/25 20:35	4
1,1,1-Trichloroethane	ND		4.0	3.3	ug/L			09/22/25 20:35	4
1,1,2,2-Tetrachloroethane	**4.1**		4.0	0.84	ug/L			09/22/25 20:35	4
1,1,2-Trichloroethane	ND		4.0	0.92	ug/L			09/22/25 20:35	4
1,1-Dichloroethane	**2.1**	**J**	4.0	1.5	ug/L			09/22/25 20:35	4
1,1-Dichloroethene	ND		4.0	1.2	ug/L			09/22/25 20:35	4
1,1-Dichloropropene	ND		4.0	2.9	ug/L			09/22/25 20:35	4
1,2,3-Trichlorobenzene	ND		4.0	1.6	ug/L			09/22/25 20:35	4
1,2,3-Trichloropropane	ND		4.0	3.6	ug/L			09/22/25 20:35	4
1,2,4-Trichlorobenzene	ND		4.0	1.6	ug/L			09/22/25 20:35	4
1,2,4-Trimethylbenzene	ND		4.0	3.0	ug/L			09/22/25 20:35	4
1,2-Dibromo-3-Chloropropane	ND		4.0	1.6	ug/L			09/22/25 20:35	4
1,2-Dibromoethane	ND		4.0	2.9	ug/L			09/22/25 20:35	4
1,2-Dichlorobenzene	**6.4**		4.0	3.2	ug/L			09/22/25 20:35	4
1,2-Dichloroethane	ND		4.0	0.84	ug/L			09/22/25 20:35	4
1,2-Dichloropropane	ND		4.0	2.9	ug/L			09/22/25 20:35	4
1,3,5-Trimethylbenzene	ND		4.0	3.1	ug/L			09/22/25 20:35	4
1,3-Dichlorobenzene	**15**		4.0	3.1	ug/L			09/22/25 20:35	4
1,3-Dichloropropane	ND		4.0	3.0	ug/L			09/22/25 20:35	4
1,4-Dichlorobenzene	**18**		4.0	3.4	ug/L			09/22/25 20:35	4
2,2-Dichloropropane	ND		4.0	1.6	ug/L			09/22/25 20:35	4
2-Butanone (MEK)	ND		40	5.3	ug/L			09/22/25 20:35	4
2-Chloroethyl vinyl ether	ND		20	3.8	ug/L			09/22/25 20:35	4
2-Hexanone	ND		20	5.0	ug/L			09/22/25 20:35	4
4-Methyl-2-pentanone (MIBK)	ND		20	8.4	ug/L			09/22/25 20:35	4
Acetone	ND		40	12	ug/L			09/22/25 20:35	4

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-7B

Date Collected: 09/17/25 14:45
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-21

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS - DL (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	**27**		4.0	1.6	ug/L			09/22/25 20:35	4
Bromobenzene	ND		4.0	3.2	ug/L			09/22/25 20:35	4
Bromochloromethane	ND		4.0	3.5	ug/L			09/22/25 20:35	4
Bromodichloromethane	ND	*+	4.0	1.6	ug/L			09/22/25 20:35	4
Bromoform	ND	*+	4.0	1.0	ug/L			09/22/25 20:35	4
Bromomethane	ND		4.0	2.8	ug/L			09/22/25 20:35	4
Carbon disulfide	ND		4.0	0.76	ug/L			09/22/25 20:35	4
Carbon tetrachloride	ND		4.0	1.1	ug/L			09/22/25 20:35	4
Chlorobenzene	**250**		4.0	3.0	ug/L			09/22/25 20:35	4
Chlorodibromomethane	ND	*+	4.0	1.3	ug/L			09/22/25 20:35	4
Chloroethane	ND		4.0	1.3	ug/L			09/22/25 20:35	4
Chloroform	ND		4.0	1.4	ug/L			09/22/25 20:35	4
Chloromethane	ND		4.0	1.4	ug/L			09/22/25 20:35	4
cis-1,2-Dichloroethene	**21**		4.0	3.2	ug/L			09/22/25 20:35	4
cis-1,3-Dichloropropene	ND		4.0	1.4	ug/L			09/22/25 20:35	4
Dichlorodifluoromethane	ND		4.0	2.7	ug/L			09/22/25 20:35	4
Ethylbenzene	ND		4.0	3.0	ug/L			09/22/25 20:35	4
Hexachlorobutadiene	ND		8.0	1.1	ug/L			09/22/25 20:35	4
Isopropylbenzene	ND		4.0	3.2	ug/L			09/22/25 20:35	4
Methyl tert-butyl ether	ND		4.0	0.64	ug/L			09/22/25 20:35	4
Methylene Chloride	ND		4.0	1.8	ug/L			09/22/25 20:35	4
m-Xylene & p-Xylene	ND		8.0	2.6	ug/L			09/22/25 20:35	4
Naphthalene	ND		4.0	1.7	ug/L			09/22/25 20:35	4
n-Butylbenzene	ND		4.0	2.6	ug/L			09/22/25 20:35	4
N-Propylbenzene	ND		4.0	2.8	ug/L			09/22/25 20:35	4
o-Chlorotoluene	ND		4.0	3.4	ug/L			09/22/25 20:35	4
o-Xylene	ND		4.0	3.0	ug/L			09/22/25 20:35	4
p-Chlorotoluene	ND		4.0	3.4	ug/L			09/22/25 20:35	4
p-Cymene	ND		4.0	1.2	ug/L			09/22/25 20:35	4
sec-Butylbenzene	ND		4.0	3.0	ug/L			09/22/25 20:35	4
Styrene	ND		4.0	2.9	ug/L			09/22/25 20:35	4
tert-Butylbenzene	ND		4.0	3.2	ug/L			09/22/25 20:35	4
Tetrachloroethene	**40**		4.0	1.4	ug/L			09/22/25 20:35	4
Toluene	ND		4.0	2.0	ug/L			09/22/25 20:35	4
trans-1,2-Dichloroethene	ND		4.0	3.6	ug/L			09/22/25 20:35	4
trans-1,3-Dichloropropene	ND		4.0	1.5	ug/L			09/22/25 20:35	4
Trichloroethene	**46**		4.0	1.8	ug/L			09/22/25 20:35	4
Trichlorofluoromethane	ND		4.0	3.5	ug/L			09/22/25 20:35	4
Vinyl acetate	ND		20	3.4	ug/L			09/22/25 20:35	4
Vinyl chloride	**5.3**		4.0	3.6	ug/L			09/22/25 20:35	4

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*113*		*77 - 120*		*09/22/25 20:35*	*4*
4-Bromofluorobenzene (Surr)	*110*		*73 - 120*		*09/22/25 20:35*	*4*
Dibromofluoromethane (Surr)	*106*		*75 - 123*		*09/22/25 20:35*	*4*
Toluene-d8 (Surr)	*105*		*80 - 120*		*09/22/25 20:35*	*4*

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-8B

Date Collected: 09/17/25 14:55
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-22

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			09/19/25 18:55	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			09/19/25 18:55	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			09/19/25 18:55	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			09/19/25 18:55	1
1,1-Dichloroethane	**2.6**		1.0	0.38	ug/L			09/19/25 18:55	1
1,1-Dichloroethene	**0.42**	**J**	1.0	0.29	ug/L			09/19/25 18:55	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			09/19/25 18:55	1
1,2,3-Trichlorobenzene	**0.87**	**J**	1.0	0.41	ug/L			09/19/25 18:55	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			09/19/25 18:55	1
1,2,4-Trichlorobenzene	**3.8**		1.0	0.41	ug/L			09/19/25 18:55	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			09/19/25 18:55	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			09/19/25 18:55	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			09/19/25 18:55	1
1,2-Dichlorobenzene	**370**	**E**	1.0	0.79	ug/L			09/19/25 18:55	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			09/19/25 18:55	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			09/19/25 18:55	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			09/19/25 18:55	1
1,3-Dichlorobenzene	**170**	**E**	1.0	0.78	ug/L			09/19/25 18:55	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			09/19/25 18:55	1
1,4-Dichlorobenzene	**250**	**E**	1.0	0.84	ug/L			09/19/25 18:55	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			09/19/25 18:55	1
2-Butanone (MEK)	ND		10	1.3	ug/L			09/19/25 18:55	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			09/19/25 18:55	1
2-Hexanone	ND		5.0	1.2	ug/L			09/19/25 18:55	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			09/19/25 18:55	1
Acetone	ND		10	3.0	ug/L			09/19/25 18:55	1
Benzene	**46**		1.0	0.41	ug/L			09/19/25 18:55	1
Bromobenzene	ND		1.0	0.80	ug/L			09/19/25 18:55	1
Bromochloromethane	ND		1.0	0.87	ug/L			09/19/25 18:55	1
Bromodichloromethane	ND		1.0	0.39	ug/L			09/19/25 18:55	1
Bromoform	ND	*+	1.0	0.26	ug/L			09/19/25 18:55	1
Bromomethane	ND		1.0	0.69	ug/L			09/19/25 18:55	1
Carbon disulfide	ND		1.0	0.19	ug/L			09/19/25 18:55	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			09/19/25 18:55	1
Chlorobenzene	**480**	**E**	1.0	0.75	ug/L			09/19/25 18:55	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			09/19/25 18:55	1
Chloroethane	ND		1.0	0.32	ug/L			09/19/25 18:55	1
Chloroform	ND		1.0	0.34	ug/L			09/19/25 18:55	1
Chloromethane	ND		1.0	0.35	ug/L			09/19/25 18:55	1
cis-1,2-Dichloroethene	**39**		1.0	0.81	ug/L			09/19/25 18:55	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			09/19/25 18:55	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			09/19/25 18:55	1
Ethylbenzene	ND		1.0	0.74	ug/L			09/19/25 18:55	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			09/19/25 18:55	1
Isopropylbenzene	ND		1.0	0.79	ug/L			09/19/25 18:55	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			09/19/25 18:55	1
Methylene Chloride	ND		1.0	0.44	ug/L			09/19/25 18:55	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			09/19/25 18:55	1
Naphthalene	ND		1.0	0.43	ug/L			09/19/25 18:55	1

Client Sample ID: OW-8B
Date Collected: 09/17/25 14:55
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-22
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
n-Butylbenzene	ND		1.0	0.64	ug/L			09/19/25 18:55	1
N-Propylbenzene	ND		1.0	0.69	ug/L			09/19/25 18:55	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			09/19/25 18:55	1
o-Xylene	ND		1.0	0.76	ug/L			09/19/25 18:55	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			09/19/25 18:55	1
p-Cymene	ND		1.0	0.31	ug/L			09/19/25 18:55	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			09/19/25 18:55	1
Styrene	ND		1.0	0.73	ug/L			09/19/25 18:55	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			09/19/25 18:55	1
Tetrachloroethene	**1.7**		1.0	0.36	ug/L			09/19/25 18:55	1
Toluene	**0.71**	**J**	1.0	0.51	ug/L			09/19/25 18:55	1
trans-1,2-Dichloroethene	**7.5**		1.0	0.90	ug/L			09/19/25 18:55	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			09/19/25 18:55	1
Trichloroethene	**23**		1.0	0.46	ug/L			09/19/25 18:55	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			09/19/25 18:55	1
Vinyl acetate	ND		5.0	0.85	ug/L			09/19/25 18:55	1
Vinyl chloride	**21**		1.0	0.90	ug/L			09/19/25 18:55	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*107*		*77 - 120*		*09/19/25 18:55*	*1*
4-Bromofluorobenzene (Surr)	*107*		*73 - 120*		*09/19/25 18:55*	*1*
Dibromofluoromethane (Surr)	*110*		*75 - 123*		*09/19/25 18:55*	*1*
Toluene-d8 (Surr)	*98*		*80 - 120*		*09/19/25 18:55*	*1*

Method: SW846 8260C - Volatile Organic Compounds by GC/MS - DL

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		10	3.5	ug/L			09/22/25 20:58	10
1,1,1-Trichloroethane	ND		10	8.2	ug/L			09/22/25 20:58	10
1,1,2,2-Tetrachloroethane	ND		10	2.1	ug/L			09/22/25 20:58	10
1,1,2-Trichloroethane	ND		10	2.3	ug/L			09/22/25 20:58	10
1,1-Dichloroethane	ND		10	3.8	ug/L			09/22/25 20:58	10
1,1-Dichloroethene	ND		10	2.9	ug/L			09/22/25 20:58	10
1,1-Dichloropropene	ND		10	7.2	ug/L			09/22/25 20:58	10
1,2,3-Trichlorobenzene	ND		10	4.1	ug/L			09/22/25 20:58	10
1,2,3-Trichloropropane	ND		10	8.9	ug/L			09/22/25 20:58	10
1,2,4-Trichlorobenzene	ND		10	4.1	ug/L			09/22/25 20:58	10
1,2,4-Trimethylbenzene	ND		10	7.5	ug/L			09/22/25 20:58	10
1,2-Dibromo-3-Chloropropane	ND		10	3.9	ug/L			09/22/25 20:58	10
1,2-Dibromoethane	ND		10	7.3	ug/L			09/22/25 20:58	10
1,2-Dichlorobenzene	**350**		10	7.9	ug/L			09/22/25 20:58	10
1,2-Dichloroethane	ND		10	2.1	ug/L			09/22/25 20:58	10
1,2-Dichloropropane	ND		10	7.2	ug/L			09/22/25 20:58	10
1,3,5-Trimethylbenzene	ND		10	7.7	ug/L			09/22/25 20:58	10
1,3-Dichlorobenzene	**170**		10	7.8	ug/L			09/22/25 20:58	10
1,3-Dichloropropane	ND		10	7.5	ug/L			09/22/25 20:58	10
1,4-Dichlorobenzene	**240**		10	8.4	ug/L			09/22/25 20:58	10
2,2-Dichloropropane	ND		10	4.0	ug/L			09/22/25 20:58	10
2-Butanone (MEK)	ND		100	13	ug/L			09/22/25 20:58	10
2-Chloroethyl vinyl ether	ND		50	9.6	ug/L			09/22/25 20:58	10
2-Hexanone	ND		50	12	ug/L			09/22/25 20:58	10

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-8B

Date Collected: 09/17/25 14:55
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-22

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS - DL (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
4-Methyl-2-pentanone (MIBK)	ND		50	21	ug/L			09/22/25 20:58	10
Acetone	ND		100	30	ug/L			09/22/25 20:58	10
Benzene	**43**		10	4.1	ug/L			09/22/25 20:58	10
Bromobenzene	ND		10	8.0	ug/L			09/22/25 20:58	10
Bromochloromethane	ND		10	8.7	ug/L			09/22/25 20:58	10
Bromodichloromethane	ND	*+	10	3.9	ug/L			09/22/25 20:58	10
Bromoform	ND	*+	10	2.6	ug/L			09/22/25 20:58	10
Bromomethane	ND		10	6.9	ug/L			09/22/25 20:58	10
Carbon disulfide	ND		10	1.9	ug/L			09/22/25 20:58	10
Carbon tetrachloride	ND		10	2.7	ug/L			09/22/25 20:58	10
Chlorobenzene	**430**		10	7.5	ug/L			09/22/25 20:58	10
Chlorodibromomethane	ND	*+	10	3.2	ug/L			09/22/25 20:58	10
Chloroethane	ND		10	3.2	ug/L			09/22/25 20:58	10
Chloroform	ND		10	3.4	ug/L			09/22/25 20:58	10
Chloromethane	ND		10	3.5	ug/L			09/22/25 20:58	10
cis-1,2-Dichloroethene	**37**		10	8.1	ug/L			09/22/25 20:58	10
cis-1,3-Dichloropropene	ND		10	3.6	ug/L			09/22/25 20:58	10
Dichlorodifluoromethane	ND		10	6.8	ug/L			09/22/25 20:58	10
Ethylbenzene	ND		10	7.4	ug/L			09/22/25 20:58	10
Hexachlorobutadiene	ND		20	2.8	ug/L			09/22/25 20:58	10
Isopropylbenzene	ND		10	7.9	ug/L			09/22/25 20:58	10
Methyl tert-butyl ether	ND		10	1.6	ug/L			09/22/25 20:58	10
Methylene Chloride	ND		10	4.4	ug/L			09/22/25 20:58	10
m-Xylene & p-Xylene	ND		20	6.6	ug/L			09/22/25 20:58	10
Naphthalene	ND		10	4.3	ug/L			09/22/25 20:58	10
n-Butylbenzene	ND		10	6.4	ug/L			09/22/25 20:58	10
N-Propylbenzene	ND		10	6.9	ug/L			09/22/25 20:58	10
o-Chlorotoluene	ND		10	8.6	ug/L			09/22/25 20:58	10
o-Xylene	ND		10	7.6	ug/L			09/22/25 20:58	10
p-Chlorotoluene	ND		10	8.4	ug/L			09/22/25 20:58	10
p-Cymene	ND		10	3.1	ug/L			09/22/25 20:58	10
sec-Butylbenzene	ND		10	7.5	ug/L			09/22/25 20:58	10
Styrene	ND		10	7.3	ug/L			09/22/25 20:58	10
tert-Butylbenzene	ND		10	8.1	ug/L			09/22/25 20:58	10
Tetrachloroethene	ND		10	3.6	ug/L			09/22/25 20:58	10
Toluene	ND		10	5.1	ug/L			09/22/25 20:58	10
trans-1,2-Dichloroethene	ND		10	9.0	ug/L			09/22/25 20:58	10
trans-1,3-Dichloropropene	ND		10	3.7	ug/L			09/22/25 20:58	10
Trichloroethene	**22**		10	4.6	ug/L			09/22/25 20:58	10
Trichlorofluoromethane	ND		10	8.8	ug/L			09/22/25 20:58	10
Vinyl acetate	ND		50	8.5	ug/L			09/22/25 20:58	10
Vinyl chloride	**19**		10	9.0	ug/L			09/22/25 20:58	10

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*109*		*77 - 120*		*09/22/25 20:58*	*10*
4-Bromofluorobenzene (Surr)	*105*		*73 - 120*		*09/22/25 20:58*	*10*
Dibromofluoromethane (Surr)	*101*		*75 - 123*		*09/22/25 20:58*	*10*
Toluene-d8 (Surr)	*97*		*80 - 120*		*09/22/25 20:58*	*10*

Client Sample ID: MW-1B
Lab Sample ID: 480-232730-23
Date Collected: 09/17/25 15:20
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		400	140	ug/L			09/19/25 19:18	400
1,1,1-Trichloroethane	ND		400	330	ug/L			09/19/25 19:18	400
1,1,2,2-Tetrachloroethane	ND		400	84	ug/L			09/19/25 19:18	400
1,1,2-Trichloroethane	ND		400	92	ug/L			09/19/25 19:18	400
1,1-Dichloroethane	ND		400	150	ug/L			09/19/25 19:18	400
1,1-Dichloroethene	ND		400	120	ug/L			09/19/25 19:18	400
1,1-Dichloropropene	ND		400	290	ug/L			09/19/25 19:18	400
1,2,3-Trichlorobenzene	ND		400	160	ug/L			09/19/25 19:18	400
1,2,3-Trichloropropane	ND		400	360	ug/L			09/19/25 19:18	400
1,2,4-Trichlorobenzene	**210**	**J**	400	160	ug/L			09/19/25 19:18	400
1,2,4-Trimethylbenzene	ND		400	300	ug/L			09/19/25 19:18	400
1,2-Dibromo-3-Chloropropane	ND		400	160	ug/L			09/19/25 19:18	400
1,2-Dibromoethane	ND		400	290	ug/L			09/19/25 19:18	400
1,2-Dichlorobenzene	**1800**		400	320	ug/L			09/19/25 19:18	400
1,2-Dichloroethane	ND		400	84	ug/L			09/19/25 19:18	400
1,2-Dichloropropane	ND		400	290	ug/L			09/19/25 19:18	400
1,3,5-Trimethylbenzene	ND		400	310	ug/L			09/19/25 19:18	400
1,3-Dichlorobenzene	**2300**		400	310	ug/L			09/19/25 19:18	400
1,3-Dichloropropane	ND		400	300	ug/L			09/19/25 19:18	400
1,4-Dichlorobenzene	**9400**		400	340	ug/L			09/19/25 19:18	400
2,2-Dichloropropane	ND		400	160	ug/L			09/19/25 19:18	400
2-Butanone (MEK)	ND		4000	530	ug/L			09/19/25 19:18	400
2-Chloroethyl vinyl ether	ND		2000	380	ug/L			09/19/25 19:18	400
2-Hexanone	ND		2000	500	ug/L			09/19/25 19:18	400
4-Methyl-2-pentanone (MIBK)	ND		2000	840	ug/L			09/19/25 19:18	400
Acetone	ND		4000	1200	ug/L			09/19/25 19:18	400
Benzene	**250**	**J**	400	160	ug/L			09/19/25 19:18	400
Bromobenzene	ND		400	320	ug/L			09/19/25 19:18	400
Bromochloromethane	ND		400	350	ug/L			09/19/25 19:18	400
Bromodichloromethane	ND		400	160	ug/L			09/19/25 19:18	400
Bromoform	ND	*+	400	100	ug/L			09/19/25 19:18	400
Bromomethane	ND		400	280	ug/L			09/19/25 19:18	400
Carbon disulfide	ND		400	76	ug/L			09/19/25 19:18	400
Carbon tetrachloride	ND		400	110	ug/L			09/19/25 19:18	400
Chlorobenzene	**25000**		400	300	ug/L			09/19/25 19:18	400
Chlorodibromomethane	ND		400	130	ug/L			09/19/25 19:18	400
Chloroethane	ND		400	130	ug/L			09/19/25 19:18	400
Chloroform	ND		400	140	ug/L			09/19/25 19:18	400
Chloromethane	ND		400	140	ug/L			09/19/25 19:18	400
cis-1,2-Dichloroethene	ND		400	320	ug/L			09/19/25 19:18	400
cis-1,3-Dichloropropene	ND		400	140	ug/L			09/19/25 19:18	400
Dichlorodifluoromethane	ND		400	270	ug/L			09/19/25 19:18	400
Ethylbenzene	ND		400	300	ug/L			09/19/25 19:18	400
Hexachlorobutadiene	ND		800	110	ug/L			09/19/25 19:18	400
Isopropylbenzene	ND		400	320	ug/L			09/19/25 19:18	400
Methyl tert-butyl ether	ND		400	64	ug/L			09/19/25 19:18	400
Methylene Chloride	ND		400	180	ug/L			09/19/25 19:18	400
m-Xylene & p-Xylene	ND		800	260	ug/L			09/19/25 19:18	400
Naphthalene	ND		400	170	ug/L			09/19/25 19:18	400

Client Sample ID: MW-1B
Lab Sample ID: 480-232730-23

Date Collected: 09/17/25 15:20
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
n-Butylbenzene	ND		400	260	ug/L			09/19/25 19:18	400
N-Propylbenzene	ND		400	280	ug/L			09/19/25 19:18	400
o-Chlorotoluene	ND		400	340	ug/L			09/19/25 19:18	400
o-Xylene	ND		400	300	ug/L			09/19/25 19:18	400
p-Chlorotoluene	ND		400	340	ug/L			09/19/25 19:18	400
p-Cymene	ND		400	120	ug/L			09/19/25 19:18	400
sec-Butylbenzene	ND		400	300	ug/L			09/19/25 19:18	400
Styrene	ND		400	290	ug/L			09/19/25 19:18	400
tert-Butylbenzene	ND		400	320	ug/L			09/19/25 19:18	400
Tetrachloroethene	ND		400	140	ug/L			09/19/25 19:18	400
Toluene	ND		400	200	ug/L			09/19/25 19:18	400
trans-1,2-Dichloroethene	ND		400	360	ug/L			09/19/25 19:18	400
trans-1,3-Dichloropropene	ND		400	150	ug/L			09/19/25 19:18	400
Trichloroethene	ND		400	180	ug/L			09/19/25 19:18	400
Trichlorofluoromethane	ND		400	350	ug/L			09/19/25 19:18	400
Vinyl acetate	ND		2000	340	ug/L			09/19/25 19:18	400
Vinyl chloride	ND		400	360	ug/L			09/19/25 19:18	400

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*102*		*77 - 120*		*09/19/25 19:18*	*400*
4-Bromofluorobenzene (Surr)	*99*		*73 - 120*		*09/19/25 19:18*	*400*
Dibromofluoromethane (Surr)	*103*		*75 - 123*		*09/19/25 19:18*	*400*
Toluene-d8 (Surr)	*95*		*80 - 120*		*09/19/25 19:18*	*400*

Client Sample ID: MW-1C
Lab Sample ID: 480-232730-24

Date Collected: 09/17/25 15:30
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		50	18	ug/L			09/19/25 19:42	50
1,1,1-Trichloroethane	ND		50	41	ug/L			09/19/25 19:42	50
1,1,2,2-Tetrachloroethane	ND		50	11	ug/L			09/19/25 19:42	50
1,1,2-Trichloroethane	ND		50	12	ug/L			09/19/25 19:42	50
1,1-Dichloroethane	ND		50	19	ug/L			09/19/25 19:42	50
1,1-Dichloroethene	ND		50	15	ug/L			09/19/25 19:42	50
1,1-Dichloropropene	ND		50	36	ug/L			09/19/25 19:42	50
1,2,3-Trichlorobenzene	ND		50	21	ug/L			09/19/25 19:42	50
1,2,3-Trichloropropane	ND		50	45	ug/L			09/19/25 19:42	50
1,2,4-Trichlorobenzene	ND		50	21	ug/L			09/19/25 19:42	50
1,2,4-Trimethylbenzene	ND		50	38	ug/L			09/19/25 19:42	50
1,2-Dibromo-3-Chloropropane	ND		50	20	ug/L			09/19/25 19:42	50
1,2-Dibromoethane	ND		50	37	ug/L			09/19/25 19:42	50
1,2-Dichlorobenzene	ND		50	40	ug/L			09/19/25 19:42	50
1,2-Dichloroethane	ND		50	11	ug/L			09/19/25 19:42	50
1,2-Dichloropropane	ND		50	36	ug/L			09/19/25 19:42	50
1,3,5-Trimethylbenzene	ND		50	39	ug/L			09/19/25 19:42	50
1,3-Dichlorobenzene	ND		50	39	ug/L			09/19/25 19:42	50
1,3-Dichloropropane	ND		50	38	ug/L			09/19/25 19:42	50
1,4-Dichlorobenzene	ND		50	42	ug/L			09/19/25 19:42	50

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: MW-1C
Date Collected: 09/17/25 15:30
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-24
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
2,2-Dichloropropane	ND		50	20	ug/L			09/19/25 19:42	50
2-Butanone (MEK)	ND		500	66	ug/L			09/19/25 19:42	50
2-Chloroethyl vinyl ether	ND		250	48	ug/L			09/19/25 19:42	50
2-Hexanone	ND		250	62	ug/L			09/19/25 19:42	50
4-Methyl-2-pentanone (MIBK)	ND		250	110	ug/L			09/19/25 19:42	50
Acetone	ND		500	150	ug/L			09/19/25 19:42	50
Benzene	**840**		50	21	ug/L			09/19/25 19:42	50
Bromobenzene	ND		50	40	ug/L			09/19/25 19:42	50
Bromochloromethane	ND		50	44	ug/L			09/19/25 19:42	50
Bromodichloromethane	ND		50	20	ug/L			09/19/25 19:42	50
Bromoform	ND	*+	50	13	ug/L			09/19/25 19:42	50
Bromomethane	ND		50	35	ug/L			09/19/25 19:42	50
Carbon disulfide	ND		50	9.5	ug/L			09/19/25 19:42	50
Carbon tetrachloride	ND		50	14	ug/L			09/19/25 19:42	50
Chlorobenzene	**46**	**J**	50	38	ug/L			09/19/25 19:42	50
Chlorodibromomethane	ND		50	16	ug/L			09/19/25 19:42	50
Chloroethane	ND		50	16	ug/L			09/19/25 19:42	50
Chloroform	ND		50	17	ug/L			09/19/25 19:42	50
Chloromethane	ND		50	18	ug/L			09/19/25 19:42	50
cis-1,2-Dichloroethene	**2900**		50	41	ug/L			09/19/25 19:42	50
cis-1,3-Dichloropropene	ND		50	18	ug/L			09/19/25 19:42	50
Dichlorodifluoromethane	ND		50	34	ug/L			09/19/25 19:42	50
Ethylbenzene	ND		50	37	ug/L			09/19/25 19:42	50
Hexachlorobutadiene	ND		100	14	ug/L			09/19/25 19:42	50
Isopropylbenzene	ND		50	40	ug/L			09/19/25 19:42	50
Methyl tert-butyl ether	ND		50	8.0	ug/L			09/19/25 19:42	50
Methylene Chloride	ND		50	22	ug/L			09/19/25 19:42	50
m-Xylene & p-Xylene	ND		100	33	ug/L			09/19/25 19:42	50
Naphthalene	ND		50	22	ug/L			09/19/25 19:42	50
n-Butylbenzene	ND		50	32	ug/L			09/19/25 19:42	50
N-Propylbenzene	ND		50	35	ug/L			09/19/25 19:42	50
o-Chlorotoluene	ND		50	43	ug/L			09/19/25 19:42	50
o-Xylene	ND		50	38	ug/L			09/19/25 19:42	50
p-Chlorotoluene	ND		50	42	ug/L			09/19/25 19:42	50
p-Cymene	ND		50	16	ug/L			09/19/25 19:42	50
sec-Butylbenzene	ND		50	38	ug/L			09/19/25 19:42	50
Styrene	ND		50	37	ug/L			09/19/25 19:42	50
tert-Butylbenzene	ND		50	41	ug/L			09/19/25 19:42	50
Tetrachloroethene	ND		50	18	ug/L			09/19/25 19:42	50
Toluene	ND		50	26	ug/L			09/19/25 19:42	50
trans-1,2-Dichloroethene	**140**		50	45	ug/L			09/19/25 19:42	50
trans-1,3-Dichloropropene	ND		50	19	ug/L			09/19/25 19:42	50
Trichloroethene	ND		50	23	ug/L			09/19/25 19:42	50
Trichlorofluoromethane	ND		50	44	ug/L			09/19/25 19:42	50
Vinyl acetate	ND		250	43	ug/L			09/19/25 19:42	50
Vinyl chloride	**1100**		50	45	ug/L			09/19/25 19:42	50

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*102*		*77 - 120*		*09/19/25 19:42*	*50*
4-Bromofluorobenzene (Surr)	*102*		*73 - 120*		*09/19/25 19:42*	*50*

Client Sample ID: MW-1C
Lab Sample ID: 480-232730-24
Date Collected: 09/17/25 15:30
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
Dibromofluoromethane (Surr)	*102*		*75 - 123*		*09/19/25 19:42*	*50*
Toluene-d8 (Surr)	*91*		*80 - 120*		*09/19/25 19:42*	*50*

Client Sample ID: MW-1CD
Lab Sample ID: 480-232730-25
Date Collected: 09/17/25 15:45
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		800	280	ug/L			09/19/25 20:05	800
1,1,1-Trichloroethane	ND		800	660	ug/L			09/19/25 20:05	800
1,1,2,2-Tetrachloroethane	ND		800	170	ug/L			09/19/25 20:05	800
1,1,2-Trichloroethane	ND		800	180	ug/L			09/19/25 20:05	800
1,1-Dichloroethane	ND		800	300	ug/L			09/19/25 20:05	800
1,1-Dichloroethene	ND		800	230	ug/L			09/19/25 20:05	800
1,1-Dichloropropene	ND		800	580	ug/L			09/19/25 20:05	800
1,2,3-Trichlorobenzene	ND		800	330	ug/L			09/19/25 20:05	800
1,2,3-Trichloropropane	ND		800	710	ug/L			09/19/25 20:05	800
1,2,4-Trichlorobenzene	ND		800	330	ug/L			09/19/25 20:05	800
1,2,4-Trimethylbenzene	ND		800	600	ug/L			09/19/25 20:05	800
1,2-Dibromo-3-Chloropropane	ND		800	310	ug/L			09/19/25 20:05	800
1,2-Dibromoethane	ND		800	580	ug/L			09/19/25 20:05	800
1,2-Dichlorobenzene	**9000**		800	630	ug/L			09/19/25 20:05	800
1,2-Dichloroethane	ND		800	170	ug/L			09/19/25 20:05	800
1,2-Dichloropropane	ND		800	580	ug/L			09/19/25 20:05	800
1,3,5-Trimethylbenzene	ND		800	620	ug/L			09/19/25 20:05	800
1,3-Dichlorobenzene	**1100**		800	620	ug/L			09/19/25 20:05	800
1,3-Dichloropropane	ND		800	600	ug/L			09/19/25 20:05	800
1,4-Dichlorobenzene	**5900**		800	670	ug/L			09/19/25 20:05	800
2,2-Dichloropropane	ND		800	320	ug/L			09/19/25 20:05	800
2-Butanone (MEK)	ND		8000	1100	ug/L			09/19/25 20:05	800
2-Chloroethyl vinyl ether	ND		4000	770	ug/L			09/19/25 20:05	800
2-Hexanone	ND		4000	990	ug/L			09/19/25 20:05	800
4-Methyl-2-pentanone (MIBK)	ND		4000	1700	ug/L			09/19/25 20:05	800
Acetone	ND		8000	2400	ug/L			09/19/25 20:05	800
Benzene	**3300**		800	330	ug/L			09/19/25 20:05	800
Bromobenzene	ND		800	640	ug/L			09/19/25 20:05	800
Bromochloromethane	ND		800	700	ug/L			09/19/25 20:05	800
Bromodichloromethane	ND		800	310	ug/L			09/19/25 20:05	800
Bromoform	ND	*+	800	210	ug/L			09/19/25 20:05	800
Bromomethane	ND		800	550	ug/L			09/19/25 20:05	800
Carbon disulfide	ND		800	150	ug/L			09/19/25 20:05	800
Carbon tetrachloride	ND		800	220	ug/L			09/19/25 20:05	800
Chlorobenzene	**31000**		800	600	ug/L			09/19/25 20:05	800
Chlorodibromomethane	ND		800	260	ug/L			09/19/25 20:05	800
Chloroethane	ND		800	260	ug/L			09/19/25 20:05	800
Chloroform	ND		800	270	ug/L			09/19/25 20:05	800
Chloromethane	ND		800	280	ug/L			09/19/25 20:05	800
cis-1,2-Dichloroethene	**5600**		800	650	ug/L			09/19/25 20:05	800

Client Sample ID: MW-1CD
Lab Sample ID: 480-232730-25

Date Collected: 09/17/25 15:45
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
cis-1,3-Dichloropropene	ND		800	290	ug/L			09/19/25 20:05	800
Dichlorodifluoromethane	ND		800	540	ug/L			09/19/25 20:05	800
Ethylbenzene	ND		800	590	ug/L			09/19/25 20:05	800
Hexachlorobutadiene	ND		1600	220	ug/L			09/19/25 20:05	800
Isopropylbenzene	ND		800	630	ug/L			09/19/25 20:05	800
Methyl tert-butyl ether	ND		800	130	ug/L			09/19/25 20:05	800
Methylene Chloride	ND		800	350	ug/L			09/19/25 20:05	800
m-Xylene & p-Xylene	ND		1600	530	ug/L			09/19/25 20:05	800
Naphthalene	ND		800	340	ug/L			09/19/25 20:05	800
n-Butylbenzene	ND		800	510	ug/L			09/19/25 20:05	800
N-Propylbenzene	ND		800	550	ug/L			09/19/25 20:05	800
o-Chlorotoluene	ND		800	690	ug/L			09/19/25 20:05	800
o-Xylene	ND		800	610	ug/L			09/19/25 20:05	800
p-Chlorotoluene	ND		800	670	ug/L			09/19/25 20:05	800
p-Cymene	ND		800	250	ug/L			09/19/25 20:05	800
sec-Butylbenzene	ND		800	600	ug/L			09/19/25 20:05	800
Styrene	ND		800	580	ug/L			09/19/25 20:05	800
tert-Butylbenzene	ND		800	650	ug/L			09/19/25 20:05	800
Tetrachloroethene	ND		800	290	ug/L			09/19/25 20:05	800
Toluene	ND		800	410	ug/L			09/19/25 20:05	800
trans-1,2-Dichloroethene	ND		800	720	ug/L			09/19/25 20:05	800
trans-1,3-Dichloropropene	ND		800	300	ug/L			09/19/25 20:05	800
Trichloroethene	ND		800	370	ug/L			09/19/25 20:05	800
Trichlorofluoromethane	ND		800	700	ug/L			09/19/25 20:05	800
Vinyl acetate	ND		4000	680	ug/L			09/19/25 20:05	800
Vinyl chloride	**1500**		800	720	ug/L			09/19/25 20:05	800

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*108*		*77 - 120*		*09/19/25 20:05*	*800*
4-Bromofluorobenzene (Surr)	*107*		*73 - 120*		*09/19/25 20:05*	*800*
Dibromofluoromethane (Surr)	*107*		*75 - 123*		*09/19/25 20:05*	*800*
Toluene-d8 (Surr)	*96*		*80 - 120*		*09/19/25 20:05*	*800*

Client Sample ID: MW-1F
Lab Sample ID: 480-232730-26

Date Collected: 09/17/25 08:45
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		5.0	1.8	ug/L			09/19/25 20:28	5
1,1,1-Trichloroethane	ND		5.0	4.1	ug/L			09/19/25 20:28	5
1,1,2,2-Tetrachloroethane	ND		5.0	1.1	ug/L			09/19/25 20:28	5
1,1,2-Trichloroethane	ND		5.0	1.2	ug/L			09/19/25 20:28	5
1,1-Dichloroethane	ND		5.0	1.9	ug/L			09/19/25 20:28	5
1,1-Dichloroethene	ND		5.0	1.5	ug/L			09/19/25 20:28	5
1,1-Dichloropropene	ND		5.0	3.6	ug/L			09/19/25 20:28	5
1,2,3-Trichlorobenzene	ND		5.0	2.1	ug/L			09/19/25 20:28	5
1,2,3-Trichloropropane	ND		5.0	4.5	ug/L			09/19/25 20:28	5
1,2,4-Trichlorobenzene	ND		5.0	2.1	ug/L			09/19/25 20:28	5
1,2,4-Trimethylbenzene	ND		5.0	3.8	ug/L			09/19/25 20:28	5

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: MW-1F
Date Collected: 09/17/25 08:45
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-26
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,2-Dibromo-3-Chloropropane	ND		5.0	2.0	ug/L			09/19/25 20:28	5
1,2-Dibromoethane	ND		5.0	3.7	ug/L			09/19/25 20:28	5
1,2-Dichlorobenzene	ND		5.0	4.0	ug/L			09/19/25 20:28	5
1,2-Dichloroethane	ND		5.0	1.1	ug/L			09/19/25 20:28	5
1,2-Dichloropropane	ND		5.0	3.6	ug/L			09/19/25 20:28	5
1,3,5-Trimethylbenzene	ND		5.0	3.9	ug/L			09/19/25 20:28	5
1,3-Dichlorobenzene	ND		5.0	3.9	ug/L			09/19/25 20:28	5
1,3-Dichloropropane	ND		5.0	3.8	ug/L			09/19/25 20:28	5
1,4-Dichlorobenzene	ND		5.0	4.2	ug/L			09/19/25 20:28	5
2,2-Dichloropropane	ND		5.0	2.0	ug/L			09/19/25 20:28	5
2-Butanone (MEK)	ND		50	6.6	ug/L			09/19/25 20:28	5
2-Chloroethyl vinyl ether	ND		25	4.8	ug/L			09/19/25 20:28	5
2-Hexanone	ND		25	6.2	ug/L			09/19/25 20:28	5
4-Methyl-2-pentanone (MIBK)	ND		25	11	ug/L			09/19/25 20:28	5
Acetone	**85**		50	15	ug/L			09/19/25 20:28	5
Benzene	**2.4**	**J**	5.0	2.1	ug/L			09/19/25 20:28	5
Bromobenzene	ND		5.0	4.0	ug/L			09/19/25 20:28	5
Bromochloromethane	ND		5.0	4.4	ug/L			09/19/25 20:28	5
Bromodichloromethane	ND		5.0	2.0	ug/L			09/19/25 20:28	5
Bromoform	ND	*+	5.0	1.3	ug/L			09/19/25 20:28	5
Bromomethane	ND		5.0	3.5	ug/L			09/19/25 20:28	5
Carbon disulfide	ND		5.0	0.95	ug/L			09/19/25 20:28	5
Carbon tetrachloride	ND		5.0	1.4	ug/L			09/19/25 20:28	5
Chlorobenzene	ND		5.0	3.8	ug/L			09/19/25 20:28	5
Chlorodibromomethane	ND		5.0	1.6	ug/L			09/19/25 20:28	5
Chloroethane	ND		5.0	1.6	ug/L			09/19/25 20:28	5
Chloroform	ND		5.0	1.7	ug/L			09/19/25 20:28	5
Chloromethane	ND		5.0	1.8	ug/L			09/19/25 20:28	5
cis-1,2-Dichloroethene	**14**		5.0	4.1	ug/L			09/19/25 20:28	5
cis-1,3-Dichloropropene	ND		5.0	1.8	ug/L			09/19/25 20:28	5
Dichlorodifluoromethane	ND		5.0	3.4	ug/L			09/19/25 20:28	5
Ethylbenzene	ND		5.0	3.7	ug/L			09/19/25 20:28	5
Hexachlorobutadiene	ND		10	1.4	ug/L			09/19/25 20:28	5
Isopropylbenzene	ND		5.0	4.0	ug/L			09/19/25 20:28	5
Methyl tert-butyl ether	ND		5.0	0.80	ug/L			09/19/25 20:28	5
Methylene Chloride	ND		5.0	2.2	ug/L			09/19/25 20:28	5
m-Xylene & p-Xylene	ND		10	3.3	ug/L			09/19/25 20:28	5
Naphthalene	ND		5.0	2.2	ug/L			09/19/25 20:28	5
n-Butylbenzene	ND		5.0	3.2	ug/L			09/19/25 20:28	5
N-Propylbenzene	ND		5.0	3.5	ug/L			09/19/25 20:28	5
o-Chlorotoluene	ND		5.0	4.3	ug/L			09/19/25 20:28	5
o-Xylene	ND		5.0	3.8	ug/L			09/19/25 20:28	5
p-Chlorotoluene	ND		5.0	4.2	ug/L			09/19/25 20:28	5
p-Cymene	ND		5.0	1.6	ug/L			09/19/25 20:28	5
sec-Butylbenzene	ND		5.0	3.8	ug/L			09/19/25 20:28	5
Styrene	ND		5.0	3.7	ug/L			09/19/25 20:28	5
tert-Butylbenzene	ND		5.0	4.1	ug/L			09/19/25 20:28	5
Tetrachloroethene	ND		5.0	1.8	ug/L			09/19/25 20:28	5
Toluene	ND		5.0	2.6	ug/L			09/19/25 20:28	5

Client Sample ID: MW-1F
Lab Sample ID: 480-232730-26

Date Collected: 09/17/25 08:45
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
trans-1,2-Dichloroethene	**25**		5.0	4.5	ug/L			09/19/25 20:28	5
trans-1,3-Dichloropropene	ND		5.0	1.9	ug/L			09/19/25 20:28	5
Trichloroethene	**2.7**	**J**	5.0	2.3	ug/L			09/19/25 20:28	5
Trichlorofluoromethane	ND		5.0	4.4	ug/L			09/19/25 20:28	5
Vinyl acetate	ND		25	4.3	ug/L			09/19/25 20:28	5
Vinyl chloride	**250**		5.0	4.5	ug/L			09/19/25 20:28	5

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*103*		*77 - 120*		*09/19/25 20:28*	*5*
4-Bromofluorobenzene (Surr)	*106*		*73 - 120*		*09/19/25 20:28*	*5*
Dibromofluoromethane (Surr)	*103*		*75 - 123*		*09/19/25 20:28*	*5*
Toluene-d8 (Surr)	*98*		*80 - 120*		*09/19/25 20:28*	*5*

Client Sample ID: OW-12A
Lab Sample ID: 480-232730-27

Date Collected: 09/18/25 08:10
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		100	35	ug/L			09/19/25 20:51	100
1,1,1-Trichloroethane	ND		100	82	ug/L			09/19/25 20:51	100
1,1,2,2-Tetrachloroethane	ND		100	21	ug/L			09/19/25 20:51	100
1,1,2-Trichloroethane	ND		100	23	ug/L			09/19/25 20:51	100
1,1-Dichloroethane	ND		100	38	ug/L			09/19/25 20:51	100
1,1-Dichloroethene	ND		100	29	ug/L			09/19/25 20:51	100
1,1-Dichloropropene	ND		100	72	ug/L			09/19/25 20:51	100
1,2,3-Trichlorobenzene	ND		100	41	ug/L			09/19/25 20:51	100
1,2,3-Trichloropropane	ND		100	89	ug/L			09/19/25 20:51	100
1,2,4-Trichlorobenzene	**47**	**J**	100	41	ug/L			09/19/25 20:51	100
1,2,4-Trimethylbenzene	ND		100	75	ug/L			09/19/25 20:51	100
1,2-Dibromo-3-Chloropropane	ND		100	39	ug/L			09/19/25 20:51	100
1,2-Dibromoethane	ND		100	73	ug/L			09/19/25 20:51	100
1,2-Dichlorobenzene	**1800**		100	79	ug/L			09/19/25 20:51	100
1,2-Dichloroethane	ND		100	21	ug/L			09/19/25 20:51	100
1,2-Dichloropropane	ND		100	72	ug/L			09/19/25 20:51	100
1,3,5-Trimethylbenzene	ND		100	77	ug/L			09/19/25 20:51	100
1,3-Dichlorobenzene	**340**		100	78	ug/L			09/19/25 20:51	100
1,3-Dichloropropane	ND		100	75	ug/L			09/19/25 20:51	100
1,4-Dichlorobenzene	**1500**		100	84	ug/L			09/19/25 20:51	100
2,2-Dichloropropane	ND		100	40	ug/L			09/19/25 20:51	100
2-Butanone (MEK)	ND		1000	130	ug/L			09/19/25 20:51	100
2-Chloroethyl vinyl ether	ND		500	96	ug/L			09/19/25 20:51	100
2-Hexanone	ND		500	120	ug/L			09/19/25 20:51	100
4-Methyl-2-pentanone (MIBK)	ND		500	210	ug/L			09/19/25 20:51	100
Acetone	ND		1000	300	ug/L			09/19/25 20:51	100
Benzene	**160**		100	41	ug/L			09/19/25 20:51	100
Bromobenzene	ND		100	80	ug/L			09/19/25 20:51	100
Bromochloromethane	ND		100	87	ug/L			09/19/25 20:51	100
Bromodichloromethane	ND		100	39	ug/L			09/19/25 20:51	100
Bromoform	ND	*+	100	26	ug/L			09/19/25 20:51	100

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-12A

Date Collected: 09/18/25 08:10
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-27

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Bromomethane	ND		100	69	ug/L			09/19/25 20:51	100
Carbon disulfide	ND		100	19	ug/L			09/19/25 20:51	100
Carbon tetrachloride	ND		100	27	ug/L			09/19/25 20:51	100
Chlorobenzene	**4200**		100	75	ug/L			09/19/25 20:51	100
Chlorodibromomethane	ND		100	32	ug/L			09/19/25 20:51	100
Chloroethane	ND		100	32	ug/L			09/19/25 20:51	100
Chloroform	ND		100	34	ug/L			09/19/25 20:51	100
Chloromethane	ND		100	35	ug/L			09/19/25 20:51	100
cis-1,2-Dichloroethene	ND		100	81	ug/L			09/19/25 20:51	100
cis-1,3-Dichloropropene	ND		100	36	ug/L			09/19/25 20:51	100
Dichlorodifluoromethane	ND		100	68	ug/L			09/19/25 20:51	100
Ethylbenzene	ND		100	74	ug/L			09/19/25 20:51	100
Hexachlorobutadiene	ND		200	28	ug/L			09/19/25 20:51	100
Isopropylbenzene	ND		100	79	ug/L			09/19/25 20:51	100
Methyl tert-butyl ether	ND		100	16	ug/L			09/19/25 20:51	100
Methylene Chloride	ND		100	44	ug/L			09/19/25 20:51	100
m-Xylene & p-Xylene	ND		200	66	ug/L			09/19/25 20:51	100
Naphthalene	ND		100	43	ug/L			09/19/25 20:51	100
n-Butylbenzene	ND		100	64	ug/L			09/19/25 20:51	100
N-Propylbenzene	ND		100	69	ug/L			09/19/25 20:51	100
o-Chlorotoluene	ND		100	86	ug/L			09/19/25 20:51	100
o-Xylene	ND		100	76	ug/L			09/19/25 20:51	100
p-Chlorotoluene	ND		100	84	ug/L			09/19/25 20:51	100
p-Cymene	ND		100	31	ug/L			09/19/25 20:51	100
sec-Butylbenzene	ND		100	75	ug/L			09/19/25 20:51	100
Styrene	ND		100	73	ug/L			09/19/25 20:51	100
tert-Butylbenzene	ND		100	81	ug/L			09/19/25 20:51	100
Tetrachloroethene	ND		100	36	ug/L			09/19/25 20:51	100
Toluene	ND		100	51	ug/L			09/19/25 20:51	100
trans-1,2-Dichloroethene	ND		100	90	ug/L			09/19/25 20:51	100
trans-1,3-Dichloropropene	ND		100	37	ug/L			09/19/25 20:51	100
Trichloroethene	ND		100	46	ug/L			09/19/25 20:51	100
Trichlorofluoromethane	ND		100	88	ug/L			09/19/25 20:51	100
Vinyl acetate	ND		500	85	ug/L			09/19/25 20:51	100
Vinyl chloride	ND		100	90	ug/L			09/19/25 20:51	100

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*109*		*77 - 120*		*09/19/25 20:51*	*100*
4-Bromofluorobenzene (Surr)	*106*		*73 - 120*		*09/19/25 20:51*	*100*
Dibromofluoromethane (Surr)	*107*		*75 - 123*		*09/19/25 20:51*	*100*
Toluene-d8 (Surr)	*99*		*80 - 120*		*09/19/25 20:51*	*100*

Client Sample ID: OW-10B

Date Collected: 09/18/25 08:20
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-28

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		800	280	ug/L			09/22/25 21:21	800
1,1,1-Trichloroethane	ND		800	660	ug/L			09/22/25 21:21	800

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-10B
Date Collected: 09/18/25 08:20
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-28
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		800	170	ug/L			09/22/25 21:21	800
1,1,2-Trichloroethane	ND		800	180	ug/L			09/22/25 21:21	800
1,1-Dichloroethane	ND		800	300	ug/L			09/22/25 21:21	800
1,1-Dichloroethene	ND		800	230	ug/L			09/22/25 21:21	800
1,1-Dichloropropene	ND		800	580	ug/L			09/22/25 21:21	800
1,2,3-Trichlorobenzene	ND		800	330	ug/L			09/22/25 21:21	800
1,2,3-Trichloropropane	ND		800	710	ug/L			09/22/25 21:21	800
1,2,4-Trichlorobenzene	**720**	**J**	800	330	ug/L			09/22/25 21:21	800
1,2,4-Trimethylbenzene	ND		800	600	ug/L			09/22/25 21:21	800
1,2-Dibromo-3-Chloropropane	ND		800	310	ug/L			09/22/25 21:21	800
1,2-Dibromoethane	ND		800	580	ug/L			09/22/25 21:21	800
1,2-Dichlorobenzene	**13000**		800	630	ug/L			09/22/25 21:21	800
1,2-Dichloroethane	ND		800	170	ug/L			09/22/25 21:21	800
1,2-Dichloropropane	ND		800	580	ug/L			09/22/25 21:21	800
1,3,5-Trimethylbenzene	ND		800	620	ug/L			09/22/25 21:21	800
1,3-Dichlorobenzene	**2600**		800	620	ug/L			09/22/25 21:21	800
1,3-Dichloropropane	ND		800	600	ug/L			09/22/25 21:21	800
1,4-Dichlorobenzene	**12000**		800	670	ug/L			09/22/25 21:21	800
2,2-Dichloropropane	ND		800	320	ug/L			09/22/25 21:21	800
2-Butanone (MEK)	ND		8000	1100	ug/L			09/22/25 21:21	800
2-Chloroethyl vinyl ether	ND		4000	770	ug/L			09/22/25 21:21	800
2-Hexanone	ND		4000	990	ug/L			09/22/25 21:21	800
4-Methyl-2-pentanone (MIBK)	ND		4000	1700	ug/L			09/22/25 21:21	800
Acetone	ND		8000	2400	ug/L			09/22/25 21:21	800
Benzene	**2100**		800	330	ug/L			09/22/25 21:21	800
Bromobenzene	ND		800	640	ug/L			09/22/25 21:21	800
Bromochloromethane	ND		800	700	ug/L			09/22/25 21:21	800
Bromodichloromethane	ND	*+	800	310	ug/L			09/22/25 21:21	800
Bromoform	ND	*+	800	210	ug/L			09/22/25 21:21	800
Bromomethane	ND		800	550	ug/L			09/22/25 21:21	800
Carbon disulfide	ND		800	150	ug/L			09/22/25 21:21	800
Carbon tetrachloride	ND		800	220	ug/L			09/22/25 21:21	800
Chlorobenzene	**39000**		800	600	ug/L			09/22/25 21:21	800
Chlorodibromomethane	ND	*+	800	260	ug/L			09/22/25 21:21	800
Chloroethane	ND		800	260	ug/L			09/22/25 21:21	800
Chloroform	ND		800	270	ug/L			09/22/25 21:21	800
Chloromethane	ND		800	280	ug/L			09/22/25 21:21	800
cis-1,2-Dichloroethene	ND		800	650	ug/L			09/22/25 21:21	800
cis-1,3-Dichloropropene	ND		800	290	ug/L			09/22/25 21:21	800
Dichlorodifluoromethane	ND		800	540	ug/L			09/22/25 21:21	800
Ethylbenzene	ND		800	590	ug/L			09/22/25 21:21	800
Hexachlorobutadiene	ND		1600	220	ug/L			09/22/25 21:21	800
Isopropylbenzene	ND		800	630	ug/L			09/22/25 21:21	800
Methyl tert-butyl ether	ND		800	130	ug/L			09/22/25 21:21	800
Methylene Chloride	ND		800	350	ug/L			09/22/25 21:21	800
m-Xylene & p-Xylene	ND		1600	530	ug/L			09/22/25 21:21	800
Naphthalene	ND		800	340	ug/L			09/22/25 21:21	800
n-Butylbenzene	ND		800	510	ug/L			09/22/25 21:21	800
N-Propylbenzene	ND		800	550	ug/L			09/22/25 21:21	800

Client Sample ID: OW-10B
Lab Sample ID: 480-232730-28

Date Collected: 09/18/25 08:20
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
o-Chlorotoluene	ND		800	690	ug/L			09/22/25 21:21	800
o-Xylene	ND		800	610	ug/L			09/22/25 21:21	800
p-Chlorotoluene	ND		800	670	ug/L			09/22/25 21:21	800
p-Cymene	ND		800	250	ug/L			09/22/25 21:21	800
sec-Butylbenzene	ND		800	600	ug/L			09/22/25 21:21	800
Styrene	ND		800	580	ug/L			09/22/25 21:21	800
tert-Butylbenzene	ND		800	650	ug/L			09/22/25 21:21	800
Tetrachloroethene	ND		800	290	ug/L			09/22/25 21:21	800
Toluene	ND		800	410	ug/L			09/22/25 21:21	800
trans-1,2-Dichloroethene	ND		800	720	ug/L			09/22/25 21:21	800
trans-1,3-Dichloropropene	ND		800	300	ug/L			09/22/25 21:21	800
Trichloroethene	ND		800	370	ug/L			09/22/25 21:21	800
Trichlorofluoromethane	ND		800	700	ug/L			09/22/25 21:21	800
Vinyl acetate	ND		4000	680	ug/L			09/22/25 21:21	800
Vinyl chloride	ND		800	720	ug/L			09/22/25 21:21	800

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*106*		*77 - 120*		*09/22/25 21:21*	*800*
4-Bromofluorobenzene (Surr)	*106*		*73 - 120*		*09/22/25 21:21*	*800*
Dibromofluoromethane (Surr)	*102*		*75 - 123*		*09/22/25 21:21*	*800*
Toluene-d8 (Surr)	*98*		*80 - 120*		*09/22/25 21:21*	*800*

Client Sample ID: MW-2A
Lab Sample ID: 480-232730-29

Date Collected: 09/18/25 08:30
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		200	70	ug/L			09/22/25 21:44	200
1,1,1-Trichloroethane	ND		200	160	ug/L			09/22/25 21:44	200
1,1,2,2-Tetrachloroethane	ND		200	42	ug/L			09/22/25 21:44	200
1,1,2-Trichloroethane	ND		200	46	ug/L			09/22/25 21:44	200
1,1-Dichloroethane	ND		200	76	ug/L			09/22/25 21:44	200
1,1-Dichloroethene	ND		200	58	ug/L			09/22/25 21:44	200
1,1-Dichloropropene	ND		200	140	ug/L			09/22/25 21:44	200
1,2,3-Trichlorobenzene	ND		200	82	ug/L			09/22/25 21:44	200
1,2,3-Trichloropropane	ND		200	180	ug/L			09/22/25 21:44	200
1,2,4-Trichlorobenzene	ND		200	82	ug/L			09/22/25 21:44	200
1,2,4-Trimethylbenzene	ND		200	150	ug/L			09/22/25 21:44	200
1,2-Dibromo-3-Chloropropane	ND		200	78	ug/L			09/22/25 21:44	200
1,2-Dibromoethane	ND		200	150	ug/L			09/22/25 21:44	200
1,2-Dichlorobenzene	**1500**		200	160	ug/L			09/22/25 21:44	200
1,2-Dichloroethane	ND		200	42	ug/L			09/22/25 21:44	200
1,2-Dichloropropane	ND		200	140	ug/L			09/22/25 21:44	200
1,3,5-Trimethylbenzene	ND		200	150	ug/L			09/22/25 21:44	200
1,3-Dichlorobenzene	**630**		200	160	ug/L			09/22/25 21:44	200
1,3-Dichloropropane	ND		200	150	ug/L			09/22/25 21:44	200
1,4-Dichlorobenzene	**2900**		200	170	ug/L			09/22/25 21:44	200
2,2-Dichloropropane	ND		200	80	ug/L			09/22/25 21:44	200
2-Butanone (MEK)	ND		2000	260	ug/L			09/22/25 21:44	200

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: MW-2A
Date Collected: 09/18/25 08:30
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-29
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
2-Chloroethyl vinyl ether	ND		1000	190	ug/L			09/22/25 21:44	200
2-Hexanone	ND		1000	250	ug/L			09/22/25 21:44	200
4-Methyl-2-pentanone (MIBK)	ND		1000	420	ug/L			09/22/25 21:44	200
Acetone	ND		2000	600	ug/L			09/22/25 21:44	200
Benzene	**460**		200	82	ug/L			09/22/25 21:44	200
Bromobenzene	ND		200	160	ug/L			09/22/25 21:44	200
Bromochloromethane	ND		200	170	ug/L			09/22/25 21:44	200
Bromodichloromethane	ND	*+	200	78	ug/L			09/22/25 21:44	200
Bromoform	ND	*+	200	52	ug/L			09/22/25 21:44	200
Bromomethane	ND		200	140	ug/L			09/22/25 21:44	200
Carbon disulfide	ND		200	38	ug/L			09/22/25 21:44	200
Carbon tetrachloride	ND		200	54	ug/L			09/22/25 21:44	200
Chlorobenzene	**14000**		200	150	ug/L			09/22/25 21:44	200
Chlorodibromomethane	ND	*+	200	64	ug/L			09/22/25 21:44	200
Chloroethane	ND		200	64	ug/L			09/22/25 21:44	200
Chloroform	ND		200	68	ug/L			09/22/25 21:44	200
Chloromethane	ND		200	70	ug/L			09/22/25 21:44	200
cis-1,2-Dichloroethene	ND		200	160	ug/L			09/22/25 21:44	200
cis-1,3-Dichloropropene	ND		200	72	ug/L			09/22/25 21:44	200
Dichlorodifluoromethane	ND		200	140	ug/L			09/22/25 21:44	200
Ethylbenzene	ND		200	150	ug/L			09/22/25 21:44	200
Hexachlorobutadiene	ND		400	56	ug/L			09/22/25 21:44	200
Isopropylbenzene	ND		200	160	ug/L			09/22/25 21:44	200
Methyl tert-butyl ether	ND		200	32	ug/L			09/22/25 21:44	200
Methylene Chloride	ND		200	88	ug/L			09/22/25 21:44	200
m-Xylene & p-Xylene	ND		400	130	ug/L			09/22/25 21:44	200
Naphthalene	ND		200	86	ug/L			09/22/25 21:44	200
n-Butylbenzene	ND		200	130	ug/L			09/22/25 21:44	200
N-Propylbenzene	ND		200	140	ug/L			09/22/25 21:44	200
o-Chlorotoluene	ND		200	170	ug/L			09/22/25 21:44	200
o-Xylene	ND		200	150	ug/L			09/22/25 21:44	200
p-Chlorotoluene	ND		200	170	ug/L			09/22/25 21:44	200
p-Cymene	ND		200	62	ug/L			09/22/25 21:44	200
sec-Butylbenzene	ND		200	150	ug/L			09/22/25 21:44	200
Styrene	ND		200	150	ug/L			09/22/25 21:44	200
tert-Butylbenzene	ND		200	160	ug/L			09/22/25 21:44	200
Tetrachloroethene	ND		200	72	ug/L			09/22/25 21:44	200
Toluene	ND		200	100	ug/L			09/22/25 21:44	200
trans-1,2-Dichloroethene	ND		200	180	ug/L			09/22/25 21:44	200
trans-1,3-Dichloropropene	ND		200	74	ug/L			09/22/25 21:44	200
Trichloroethene	ND		200	92	ug/L			09/22/25 21:44	200
Trichlorofluoromethane	ND		200	180	ug/L			09/22/25 21:44	200
Vinyl acetate	ND		1000	170	ug/L			09/22/25 21:44	200
Vinyl chloride	ND		200	180	ug/L			09/22/25 21:44	200

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*108*		*77 - 120*		*09/22/25 21:44*	*200*
4-Bromofluorobenzene (Surr)	*109*		*73 - 120*		*09/22/25 21:44*	*200*
Dibromofluoromethane (Surr)	*107*		*75 - 123*		*09/22/25 21:44*	*200*
Toluene-d8 (Surr)	*101*		*80 - 120*		*09/22/25 21:44*	*200*

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-18A

Date Collected: 09/18/25 09:00
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-30

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		500	180	ug/L			09/22/25 22:07	500
1,1,1-Trichloroethane	ND		500	410	ug/L			09/22/25 22:07	500
1,1,2,2-Tetrachloroethane	ND		500	110	ug/L			09/22/25 22:07	500
1,1,2-Trichloroethane	ND		500	120	ug/L			09/22/25 22:07	500
1,1-Dichloroethane	ND		500	190	ug/L			09/22/25 22:07	500
1,1-Dichloroethene	ND		500	150	ug/L			09/22/25 22:07	500
1,1-Dichloropropene	ND		500	360	ug/L			09/22/25 22:07	500
1,2,3-Trichlorobenzene	ND		500	210	ug/L			09/22/25 22:07	500
1,2,3-Trichloropropane	ND		500	450	ug/L			09/22/25 22:07	500
1,2,4-Trichlorobenzene	ND		500	210	ug/L			09/22/25 22:07	500
1,2,4-Trimethylbenzene	ND		500	380	ug/L			09/22/25 22:07	500
1,2-Dibromo-3-Chloropropane	ND	F2	500	200	ug/L			09/22/25 22:07	500
1,2-Dibromoethane	ND		500	370	ug/L			09/22/25 22:07	500
1,2-Dichlorobenzene	**2300**		500	400	ug/L			09/22/25 22:07	500
1,2-Dichloroethane	ND		500	110	ug/L			09/22/25 22:07	500
1,2-Dichloropropane	ND		500	360	ug/L			09/22/25 22:07	500
1,3,5-Trimethylbenzene	ND		500	390	ug/L			09/22/25 22:07	500
1,3-Dichlorobenzene	**1300**		500	390	ug/L			09/22/25 22:07	500
1,3-Dichloropropane	ND		500	380	ug/L			09/22/25 22:07	500
1,4-Dichlorobenzene	**9800**		500	420	ug/L			09/22/25 22:07	500
2,2-Dichloropropane	ND		500	200	ug/L			09/22/25 22:07	500
2-Butanone (MEK)	ND		5000	660	ug/L			09/22/25 22:07	500
2-Chloroethyl vinyl ether	ND		2500	480	ug/L			09/22/25 22:07	500
2-Hexanone	ND		2500	620	ug/L			09/22/25 22:07	500
4-Methyl-2-pentanone (MIBK)	ND		2500	1100	ug/L			09/22/25 22:07	500
Acetone	ND		5000	1500	ug/L			09/22/25 22:07	500
Benzene	**430**	**J**	500	210	ug/L			09/22/25 22:07	500
Bromobenzene	ND		500	400	ug/L			09/22/25 22:07	500
Bromochloromethane	ND		500	440	ug/L			09/22/25 22:07	500
Bromodichloromethane	ND	*+	500	200	ug/L			09/22/25 22:07	500
Bromoform	ND	*+	500	130	ug/L			09/22/25 22:07	500
Bromomethane	ND		500	350	ug/L			09/22/25 22:07	500
Carbon disulfide	ND		500	95	ug/L			09/22/25 22:07	500
Carbon tetrachloride	ND	F2	500	140	ug/L			09/22/25 22:07	500
Chlorobenzene	**17000**		500	380	ug/L			09/22/25 22:07	500
Chlorodibromomethane	ND	*+	500	160	ug/L			09/22/25 22:07	500
Chloroethane	ND		500	160	ug/L			09/22/25 22:07	500
Chloroform	ND		500	170	ug/L			09/22/25 22:07	500
Chloromethane	ND		500	180	ug/L			09/22/25 22:07	500
cis-1,2-Dichloroethene	ND		500	410	ug/L			09/22/25 22:07	500
cis-1,3-Dichloropropene	ND		500	180	ug/L			09/22/25 22:07	500
Dichlorodifluoromethane	ND		500	340	ug/L			09/22/25 22:07	500
Ethylbenzene	ND		500	370	ug/L			09/22/25 22:07	500
Hexachlorobutadiene	ND		1000	140	ug/L			09/22/25 22:07	500
Isopropylbenzene	ND		500	400	ug/L			09/22/25 22:07	500
Methyl tert-butyl ether	ND		500	80	ug/L			09/22/25 22:07	500
Methylene Chloride	ND		500	220	ug/L			09/22/25 22:07	500
m-Xylene & p-Xylene	ND		1000	330	ug/L			09/22/25 22:07	500
Naphthalene	ND		500	220	ug/L			09/22/25 22:07	500

Client Sample ID: OW-18A
Lab Sample ID: 480-232730-30

Date Collected: 09/18/25 09:00
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
n-Butylbenzene	ND		500	320	ug/L			09/22/25 22:07	500
N-Propylbenzene	ND		500	350	ug/L			09/22/25 22:07	500
o-Chlorotoluene	ND		500	430	ug/L			09/22/25 22:07	500
o-Xylene	ND		500	380	ug/L			09/22/25 22:07	500
p-Chlorotoluene	ND		500	420	ug/L			09/22/25 22:07	500
p-Cymene	ND		500	160	ug/L			09/22/25 22:07	500
sec-Butylbenzene	ND		500	380	ug/L			09/22/25 22:07	500
Styrene	ND		500	370	ug/L			09/22/25 22:07	500
tert-Butylbenzene	ND		500	410	ug/L			09/22/25 22:07	500
Tetrachloroethene	ND		500	180	ug/L			09/22/25 22:07	500
Toluene	ND		500	260	ug/L			09/22/25 22:07	500
trans-1,2-Dichloroethene	ND		500	450	ug/L			09/22/25 22:07	500
trans-1,3-Dichloropropene	ND		500	190	ug/L			09/22/25 22:07	500
Trichloroethene	ND		500	230	ug/L			09/22/25 22:07	500
Trichlorofluoromethane	ND		500	440	ug/L			09/22/25 22:07	500
Vinyl acetate	ND		2500	430	ug/L			09/22/25 22:07	500
Vinyl chloride	ND		500	450	ug/L			09/22/25 22:07	500

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*110*		*77 - 120*		*09/22/25 22:07*	*500*
4-Bromofluorobenzene (Surr)	*109*		*73 - 120*		*09/22/25 22:07*	*500*
Dibromofluoromethane (Surr)	*108*		*75 - 123*		*09/22/25 22:07*	*500*
Toluene-d8 (Surr)	*101*		*80 - 120*		*09/22/25 22:07*	*500*

Client Sample ID: OW-11B
Lab Sample ID: 480-232730-31

Date Collected: 09/18/25 09:30
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		400	140	ug/L			09/23/25 02:44	400
1,1,1-Trichloroethane	ND		400	330	ug/L			09/23/25 02:44	400
1,1,2,2-Tetrachloroethane	ND		400	84	ug/L			09/23/25 02:44	400
1,1,2-Trichloroethane	ND		400	92	ug/L			09/23/25 02:44	400
1,1-Dichloroethane	ND		400	150	ug/L			09/23/25 02:44	400
1,1-Dichloroethene	ND		400	120	ug/L			09/23/25 02:44	400
1,1-Dichloropropene	ND		400	290	ug/L			09/23/25 02:44	400
1,2,3-Trichlorobenzene	**430**		400	160	ug/L			09/23/25 02:44	400
1,2,3-Trichloropropane	ND		400	360	ug/L			09/23/25 02:44	400
1,2,4-Trichlorobenzene	**1400**		400	160	ug/L			09/23/25 02:44	400
1,2,4-Trimethylbenzene	ND		400	300	ug/L			09/23/25 02:44	400
1,2-Dibromo-3-Chloropropane	ND		400	160	ug/L			09/23/25 02:44	400
1,2-Dibromoethane	ND		400	290	ug/L			09/23/25 02:44	400
1,2-Dichlorobenzene	**9400**		400	320	ug/L			09/23/25 02:44	400
1,2-Dichloroethane	ND		400	84	ug/L			09/23/25 02:44	400
1,2-Dichloropropane	ND		400	290	ug/L			09/23/25 02:44	400
1,3,5-Trimethylbenzene	ND		400	310	ug/L			09/23/25 02:44	400
1,3-Dichlorobenzene	**2800**		400	310	ug/L			09/23/25 02:44	400
1,3-Dichloropropane	ND		400	300	ug/L			09/23/25 02:44	400
1,4-Dichlorobenzene	**7800**		400	340	ug/L			09/23/25 02:44	400

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-11B
Date Collected: 09/18/25 09:30
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-31
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
2,2-Dichloropropane	ND		400	160	ug/L			09/23/25 02:44	400
2-Butanone (MEK)	ND		4000	530	ug/L			09/23/25 02:44	400
2-Chloroethyl vinyl ether	ND		2000	380	ug/L			09/23/25 02:44	400
2-Hexanone	ND		2000	500	ug/L			09/23/25 02:44	400
4-Methyl-2-pentanone (MIBK)	ND		2000	840	ug/L			09/23/25 02:44	400
Acetone	ND		4000	1200	ug/L			09/23/25 02:44	400
Benzene	**1900**		400	160	ug/L			09/23/25 02:44	400
Bromobenzene	ND		400	320	ug/L			09/23/25 02:44	400
Bromochloromethane	ND		400	350	ug/L			09/23/25 02:44	400
Bromodichloromethane	ND		400	160	ug/L			09/23/25 02:44	400
Bromoform	ND		400	100	ug/L			09/23/25 02:44	400
Bromomethane	ND		400	280	ug/L			09/23/25 02:44	400
Carbon disulfide	ND		400	76	ug/L			09/23/25 02:44	400
Carbon tetrachloride	ND		400	110	ug/L			09/23/25 02:44	400
Chlorobenzene	**4700**		400	300	ug/L			09/23/25 02:44	400
Chlorodibromomethane	ND		400	130	ug/L			09/23/25 02:44	400
Chloroethane	ND		400	130	ug/L			09/23/25 02:44	400
Chloroform	ND		400	140	ug/L			09/23/25 02:44	400
Chloromethane	ND		400	140	ug/L			09/23/25 02:44	400
cis-1,2-Dichloroethene	ND		400	320	ug/L			09/23/25 02:44	400
cis-1,3-Dichloropropene	ND		400	140	ug/L			09/23/25 02:44	400
Dichlorodifluoromethane	ND		400	270	ug/L			09/23/25 02:44	400
Ethylbenzene	ND		400	300	ug/L			09/23/25 02:44	400
Hexachlorobutadiene	ND		800	110	ug/L			09/23/25 02:44	400
Isopropylbenzene	ND		400	320	ug/L			09/23/25 02:44	400
Methyl tert-butyl ether	ND		400	64	ug/L			09/23/25 02:44	400
Methylene Chloride	ND		400	180	ug/L			09/23/25 02:44	400
m-Xylene & p-Xylene	ND		800	260	ug/L			09/23/25 02:44	400
Naphthalene	ND		400	170	ug/L			09/23/25 02:44	400
n-Butylbenzene	ND		400	260	ug/L			09/23/25 02:44	400
N-Propylbenzene	ND		400	280	ug/L			09/23/25 02:44	400
o-Chlorotoluene	ND		400	340	ug/L			09/23/25 02:44	400
o-Xylene	ND		400	300	ug/L			09/23/25 02:44	400
p-Chlorotoluene	ND		400	340	ug/L			09/23/25 02:44	400
p-Cymene	ND		400	120	ug/L			09/23/25 02:44	400
sec-Butylbenzene	ND		400	300	ug/L			09/23/25 02:44	400
Styrene	ND		400	290	ug/L			09/23/25 02:44	400
tert-Butylbenzene	ND		400	320	ug/L			09/23/25 02:44	400
Tetrachloroethene	ND		400	140	ug/L			09/23/25 02:44	400
Toluene	ND		400	200	ug/L			09/23/25 02:44	400
trans-1,2-Dichloroethene	ND		400	360	ug/L			09/23/25 02:44	400
trans-1,3-Dichloropropene	ND		400	150	ug/L			09/23/25 02:44	400
Trichloroethene	ND		400	180	ug/L			09/23/25 02:44	400
Trichlorofluoromethane	ND		400	350	ug/L			09/23/25 02:44	400
Vinyl acetate	ND		2000	340	ug/L			09/23/25 02:44	400
Vinyl chloride	ND		400	360	ug/L			09/23/25 02:44	400

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*106*		*77 - 120*		*09/23/25 02:44*	*400*
4-Bromofluorobenzene (Surr)	*103*		*73 - 120*		*09/23/25 02:44*	*400*

Client Sample ID: OW-11B
Lab Sample ID: 480-232730-31

Date Collected: 09/18/25 09:30
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
Dibromofluoromethane (Surr)	*104*		*75 - 123*		*09/23/25 02:44*	*400*
Toluene-d8 (Surr)	*100*		*80 - 120*		*09/23/25 02:44*	*400*

Client Sample ID: OW-111B
Lab Sample ID: 480-232730-32

Date Collected: 09/18/25 10:30
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		200	70	ug/L			09/23/25 20:22	200
1,1,1-Trichloroethane	ND		200	160	ug/L			09/23/25 20:22	200
1,1,2,2-Tetrachloroethane	ND		200	42	ug/L			09/23/25 20:22	200
1,1,2-Trichloroethane	ND		200	46	ug/L			09/23/25 20:22	200
1,1-Dichloroethane	ND		200	76	ug/L			09/23/25 20:22	200
1,1-Dichloroethene	ND		200	58	ug/L			09/23/25 20:22	200
1,1-Dichloropropene	ND		200	140	ug/L			09/23/25 20:22	200
1,2,3-Trichlorobenzene	**420**		200	82	ug/L			09/23/25 20:22	200
1,2,3-Trichloropropane	ND		200	180	ug/L			09/23/25 20:22	200
1,2,4-Trichlorobenzene	**1300**		200	82	ug/L			09/23/25 20:22	200
1,2,4-Trimethylbenzene	ND		200	150	ug/L			09/23/25 20:22	200
1,2-Dibromo-3-Chloropropane	ND		200	78	ug/L			09/23/25 20:22	200
1,2-Dibromoethane	ND		200	150	ug/L			09/23/25 20:22	200
1,2-Dichlorobenzene	**9000**		200	160	ug/L			09/23/25 20:22	200
1,2-Dichloroethane	ND		200	42	ug/L			09/23/25 20:22	200
1,2-Dichloropropane	ND		200	140	ug/L			09/23/25 20:22	200
1,3,5-Trimethylbenzene	ND		200	150	ug/L			09/23/25 20:22	200
1,3-Dichlorobenzene	**2600**		200	160	ug/L			09/23/25 20:22	200
1,3-Dichloropropane	ND		200	150	ug/L			09/23/25 20:22	200
1,4-Dichlorobenzene	**7800**		200	170	ug/L			09/23/25 20:22	200
2,2-Dichloropropane	ND		200	80	ug/L			09/23/25 20:22	200
2-Butanone (MEK)	ND		2000	260	ug/L			09/23/25 20:22	200
2-Chloroethyl vinyl ether	ND		1000	190	ug/L			09/23/25 20:22	200
2-Hexanone	ND		1000	250	ug/L			09/23/25 20:22	200
4-Methyl-2-pentanone (MIBK)	ND		1000	420	ug/L			09/23/25 20:22	200
Acetone	ND		2000	600	ug/L			09/23/25 20:22	200
Benzene	**1800**		200	82	ug/L			09/23/25 20:22	200
Bromobenzene	ND		200	160	ug/L			09/23/25 20:22	200
Bromochloromethane	ND		200	170	ug/L			09/23/25 20:22	200
Bromodichloromethane	ND		200	78	ug/L			09/23/25 20:22	200
Bromoform	ND		200	52	ug/L			09/23/25 20:22	200
Bromomethane	ND		200	140	ug/L			09/23/25 20:22	200
Carbon disulfide	ND		200	38	ug/L			09/23/25 20:22	200
Carbon tetrachloride	ND		200	54	ug/L			09/23/25 20:22	200
Chlorobenzene	**4500**		200	150	ug/L			09/23/25 20:22	200
Chlorodibromomethane	ND		200	64	ug/L			09/23/25 20:22	200
Chloroethane	ND		200	64	ug/L			09/23/25 20:22	200
Chloroform	ND		200	68	ug/L			09/23/25 20:22	200
Chloromethane	ND		200	70	ug/L			09/23/25 20:22	200
cis-1,2-Dichloroethene	ND		200	160	ug/L			09/23/25 20:22	200

Client Sample ID: OW-111B
Lab Sample ID: 480-232730-32

Date Collected: 09/18/25 10:30
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
cis-1,3-Dichloropropene	ND		200	72	ug/L			09/23/25 20:22	200
Dichlorodifluoromethane	ND		200	140	ug/L			09/23/25 20:22	200
Ethylbenzene	ND		200	150	ug/L			09/23/25 20:22	200
Hexachlorobutadiene	ND		400	56	ug/L			09/23/25 20:22	200
Isopropylbenzene	ND		200	160	ug/L			09/23/25 20:22	200
Methyl tert-butyl ether	ND		200	32	ug/L			09/23/25 20:22	200
Methylene Chloride	ND		200	88	ug/L			09/23/25 20:22	200
m-Xylene & p-Xylene	ND		400	130	ug/L			09/23/25 20:22	200
Naphthalene	ND		200	86	ug/L			09/23/25 20:22	200
n-Butylbenzene	ND		200	130	ug/L			09/23/25 20:22	200
N-Propylbenzene	ND		200	140	ug/L			09/23/25 20:22	200
o-Chlorotoluene	ND		200	170	ug/L			09/23/25 20:22	200
o-Xylene	ND		200	150	ug/L			09/23/25 20:22	200
p-Chlorotoluene	ND		200	170	ug/L			09/23/25 20:22	200
p-Cymene	ND		200	62	ug/L			09/23/25 20:22	200
sec-Butylbenzene	ND		200	150	ug/L			09/23/25 20:22	200
Styrene	ND		200	150	ug/L			09/23/25 20:22	200
tert-Butylbenzene	ND		200	160	ug/L			09/23/25 20:22	200
Tetrachloroethene	ND		200	72	ug/L			09/23/25 20:22	200
Toluene	ND		200	100	ug/L			09/23/25 20:22	200
trans-1,2-Dichloroethene	ND		200	180	ug/L			09/23/25 20:22	200
trans-1,3-Dichloropropene	ND		200	74	ug/L			09/23/25 20:22	200
Trichloroethene	ND		200	92	ug/L			09/23/25 20:22	200
Trichlorofluoromethane	ND		200	180	ug/L			09/23/25 20:22	200
Vinyl acetate	ND		1000	170	ug/L			09/23/25 20:22	200
Vinyl chloride	ND		200	180	ug/L			09/23/25 20:22	200

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*104*		*77 - 120*		*09/23/25 20:22*	*200*
4-Bromofluorobenzene (Surr)	*106*		*73 - 120*		*09/23/25 20:22*	*200*
Dibromofluoromethane (Surr)	*101*		*75 - 123*		*09/23/25 20:22*	*200*
Toluene-d8 (Surr)	*95*		*80 - 120*		*09/23/25 20:22*	*200*

Client Sample ID: MW-6B
Lab Sample ID: 480-232730-33

Date Collected: 09/18/25 08:40
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		100	35	ug/L			09/23/25 03:30	100
1,1,1-Trichloroethane	ND		100	82	ug/L			09/23/25 03:30	100
1,1,2,2-Tetrachloroethane	ND		100	21	ug/L			09/23/25 03:30	100
1,1,2-Trichloroethane	ND		100	23	ug/L			09/23/25 03:30	100
1,1-Dichloroethane	ND		100	38	ug/L			09/23/25 03:30	100
1,1-Dichloroethene	ND		100	29	ug/L			09/23/25 03:30	100
1,1-Dichloropropene	ND		100	72	ug/L			09/23/25 03:30	100
1,2,3-Trichlorobenzene	**81**	**J**	100	41	ug/L			09/23/25 03:30	100
1,2,3-Trichloropropane	ND		100	89	ug/L			09/23/25 03:30	100
1,2,4-Trichlorobenzene	**280**		100	41	ug/L			09/23/25 03:30	100
1,2,4-Trimethylbenzene	ND		100	75	ug/L			09/23/25 03:30	100

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: MW-6B
Date Collected: 09/18/25 08:40
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-33
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,2-Dibromo-3-Chloropropane	ND		100	39	ug/L			09/23/25 03:30	100
1,2-Dibromoethane	ND		100	73	ug/L			09/23/25 03:30	100
1,2-Dichlorobenzene	**7600**		100	79	ug/L			09/23/25 03:30	100
1,2-Dichloroethane	ND		100	21	ug/L			09/23/25 03:30	100
1,2-Dichloropropane	ND		100	72	ug/L			09/23/25 03:30	100
1,3,5-Trimethylbenzene	ND		100	77	ug/L			09/23/25 03:30	100
1,3-Dichlorobenzene	**2400**		100	78	ug/L			09/23/25 03:30	100
1,3-Dichloropropane	ND		100	75	ug/L			09/23/25 03:30	100
1,4-Dichlorobenzene	**4900**		100	84	ug/L			09/23/25 03:30	100
2,2-Dichloropropane	ND		100	40	ug/L			09/23/25 03:30	100
2-Butanone (MEK)	ND		1000	130	ug/L			09/23/25 03:30	100
2-Chloroethyl vinyl ether	ND		500	96	ug/L			09/23/25 03:30	100
2-Hexanone	ND		500	120	ug/L			09/23/25 03:30	100
4-Methyl-2-pentanone (MIBK)	ND		500	210	ug/L			09/23/25 03:30	100
Acetone	ND		1000	300	ug/L			09/23/25 03:30	100
Benzene	**400**		100	41	ug/L			09/23/25 03:30	100
Bromobenzene	ND		100	80	ug/L			09/23/25 03:30	100
Bromochloromethane	ND		100	87	ug/L			09/23/25 03:30	100
Bromodichloromethane	ND		100	39	ug/L			09/23/25 03:30	100
Bromoform	ND		100	26	ug/L			09/23/25 03:30	100
Bromomethane	ND		100	69	ug/L			09/23/25 03:30	100
Carbon disulfide	ND		100	19	ug/L			09/23/25 03:30	100
Carbon tetrachloride	ND		100	27	ug/L			09/23/25 03:30	100
Chlorobenzene	**4800**		100	75	ug/L			09/23/25 03:30	100
Chlorodibromomethane	ND		100	32	ug/L			09/23/25 03:30	100
Chloroethane	ND		100	32	ug/L			09/23/25 03:30	100
Chloroform	ND		100	34	ug/L			09/23/25 03:30	100
Chloromethane	ND		100	35	ug/L			09/23/25 03:30	100
cis-1,2-Dichloroethene	ND		100	81	ug/L			09/23/25 03:30	100
cis-1,3-Dichloropropene	ND		100	36	ug/L			09/23/25 03:30	100
Dichlorodifluoromethane	ND		100	68	ug/L			09/23/25 03:30	100
Ethylbenzene	ND		100	74	ug/L			09/23/25 03:30	100
Hexachlorobutadiene	ND		200	28	ug/L			09/23/25 03:30	100
Isopropylbenzene	ND		100	79	ug/L			09/23/25 03:30	100
Methyl tert-butyl ether	ND		100	16	ug/L			09/23/25 03:30	100
Methylene Chloride	ND		100	44	ug/L			09/23/25 03:30	100
m-Xylene & p-Xylene	ND		200	66	ug/L			09/23/25 03:30	100
Naphthalene	ND		100	43	ug/L			09/23/25 03:30	100
n-Butylbenzene	ND		100	64	ug/L			09/23/25 03:30	100
N-Propylbenzene	ND		100	69	ug/L			09/23/25 03:30	100
o-Chlorotoluene	ND		100	86	ug/L			09/23/25 03:30	100
o-Xylene	ND		100	76	ug/L			09/23/25 03:30	100
p-Chlorotoluene	ND		100	84	ug/L			09/23/25 03:30	100
p-Cymene	ND		100	31	ug/L			09/23/25 03:30	100
sec-Butylbenzene	ND		100	75	ug/L			09/23/25 03:30	100
Styrene	ND		100	73	ug/L			09/23/25 03:30	100
tert-Butylbenzene	ND		100	81	ug/L			09/23/25 03:30	100
Tetrachloroethene	ND		100	36	ug/L			09/23/25 03:30	100
Toluene	ND		100	51	ug/L			09/23/25 03:30	100

Client Sample ID: MW-6B

Lab Sample ID: 480-232730-33

Date Collected: 09/18/25 08:40

Matrix: Water

Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
trans-1,2-Dichloroethene	ND		100	90	ug/L			09/23/25 03:30	100
trans-1,3-Dichloropropene	ND		100	37	ug/L			09/23/25 03:30	100
Trichloroethene	ND		100	46	ug/L			09/23/25 03:30	100
Trichlorofluoromethane	ND		100	88	ug/L			09/23/25 03:30	100
Vinyl acetate	ND		500	85	ug/L			09/23/25 03:30	100
Vinyl chloride	ND		100	90	ug/L			09/23/25 03:30	100

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*113*		*77 - 120*		*09/23/25 03:30*	*100*
4-Bromofluorobenzene (Surr)	*111*		*73 - 120*		*09/23/25 03:30*	*100*
Dibromofluoromethane (Surr)	*109*		*75 - 123*		*09/23/25 03:30*	*100*
Toluene-d8 (Surr)	*100*		*80 - 120*		*09/23/25 03:30*	*100*

Client Sample ID: MW-6F

Lab Sample ID: 480-232730-34

Date Collected: 09/17/25 09:05

Matrix: Water

Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		50	18	ug/L			09/23/25 03:54	50
1,1,1-Trichloroethane	ND		50	41	ug/L			09/23/25 03:54	50
1,1,2,2-Tetrachloroethane	ND		50	11	ug/L			09/23/25 03:54	50
1,1,2-Trichloroethane	ND		50	12	ug/L			09/23/25 03:54	50
1,1-Dichloroethane	ND		50	19	ug/L			09/23/25 03:54	50
1,1-Dichloroethene	ND		50	15	ug/L			09/23/25 03:54	50
1,1-Dichloropropene	ND		50	36	ug/L			09/23/25 03:54	50
1,2,3-Trichlorobenzene	ND		50	21	ug/L			09/23/25 03:54	50
1,2,3-Trichloropropane	ND		50	45	ug/L			09/23/25 03:54	50
1,2,4-Trichlorobenzene	ND		50	21	ug/L			09/23/25 03:54	50
1,2,4-Trimethylbenzene	ND		50	38	ug/L			09/23/25 03:54	50
1,2-Dibromo-3-Chloropropane	ND		50	20	ug/L			09/23/25 03:54	50
1,2-Dibromoethane	ND		50	37	ug/L			09/23/25 03:54	50
1,2-Dichlorobenzene	ND		50	40	ug/L			09/23/25 03:54	50
1,2-Dichloroethane	ND		50	11	ug/L			09/23/25 03:54	50
1,2-Dichloropropane	ND		50	36	ug/L			09/23/25 03:54	50
1,3,5-Trimethylbenzene	ND		50	39	ug/L			09/23/25 03:54	50
1,3-Dichlorobenzene	ND		50	39	ug/L			09/23/25 03:54	50
1,3-Dichloropropane	ND		50	38	ug/L			09/23/25 03:54	50
1,4-Dichlorobenzene	ND		50	42	ug/L			09/23/25 03:54	50
2,2-Dichloropropane	ND		50	20	ug/L			09/23/25 03:54	50
2-Butanone (MEK)	ND		500	66	ug/L			09/23/25 03:54	50
2-Chloroethyl vinyl ether	ND		250	48	ug/L			09/23/25 03:54	50
2-Hexanone	ND		250	62	ug/L			09/23/25 03:54	50
4-Methyl-2-pentanone (MIBK)	ND		250	110	ug/L			09/23/25 03:54	50
Acetone	**150**	**J**	500	150	ug/L			09/23/25 03:54	50
Benzene	ND		50	21	ug/L			09/23/25 03:54	50
Bromobenzene	ND		50	40	ug/L			09/23/25 03:54	50
Bromochloromethane	ND		50	44	ug/L			09/23/25 03:54	50
Bromodichloromethane	ND		50	20	ug/L			09/23/25 03:54	50
Bromoform	ND		50	13	ug/L			09/23/25 03:54	50

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: MW-6F

Date Collected: 09/17/25 09:05
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-34

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Bromomethane	ND		50	35	ug/L			09/23/25 03:54	50
Carbon disulfide	ND		50	9.5	ug/L			09/23/25 03:54	50
Carbon tetrachloride	ND		50	14	ug/L			09/23/25 03:54	50
Chlorobenzene	ND		50	38	ug/L			09/23/25 03:54	50
Chlorodibromomethane	ND		50	16	ug/L			09/23/25 03:54	50
Chloroethane	ND		50	16	ug/L			09/23/25 03:54	50
Chloroform	ND		50	17	ug/L			09/23/25 03:54	50
Chloromethane	ND		50	18	ug/L			09/23/25 03:54	50
cis-1,2-Dichloroethene	**480**		50	41	ug/L			09/23/25 03:54	50
cis-1,3-Dichloropropene	ND		50	18	ug/L			09/23/25 03:54	50
Dichlorodifluoromethane	ND		50	34	ug/L			09/23/25 03:54	50
Ethylbenzene	ND		50	37	ug/L			09/23/25 03:54	50
Hexachlorobutadiene	ND		100	14	ug/L			09/23/25 03:54	50
Isopropylbenzene	ND		50	40	ug/L			09/23/25 03:54	50
Methyl tert-butyl ether	ND		50	8.0	ug/L			09/23/25 03:54	50
Methylene Chloride	ND		50	22	ug/L			09/23/25 03:54	50
m-Xylene & p-Xylene	ND		100	33	ug/L			09/23/25 03:54	50
Naphthalene	ND		50	22	ug/L			09/23/25 03:54	50
n-Butylbenzene	ND		50	32	ug/L			09/23/25 03:54	50
N-Propylbenzene	ND		50	35	ug/L			09/23/25 03:54	50
o-Chlorotoluene	ND		50	43	ug/L			09/23/25 03:54	50
o-Xylene	ND		50	38	ug/L			09/23/25 03:54	50
p-Chlorotoluene	ND		50	42	ug/L			09/23/25 03:54	50
p-Cymene	ND		50	16	ug/L			09/23/25 03:54	50
sec-Butylbenzene	ND		50	38	ug/L			09/23/25 03:54	50
Styrene	ND		50	37	ug/L			09/23/25 03:54	50
tert-Butylbenzene	ND		50	41	ug/L			09/23/25 03:54	50
Tetrachloroethene	ND		50	18	ug/L			09/23/25 03:54	50
Toluene	ND		50	26	ug/L			09/23/25 03:54	50
trans-1,2-Dichloroethene	ND		50	45	ug/L			09/23/25 03:54	50
trans-1,3-Dichloropropene	ND		50	19	ug/L			09/23/25 03:54	50
Trichloroethene	ND		50	23	ug/L			09/23/25 03:54	50
Trichlorofluoromethane	ND		50	44	ug/L			09/23/25 03:54	50
Vinyl acetate	ND		250	43	ug/L			09/23/25 03:54	50
Vinyl chloride	**1200**		50	45	ug/L			09/23/25 03:54	50

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*108*		*77 - 120*		*09/23/25 03:54*	*50*
4-Bromofluorobenzene (Surr)	*113*		*73 - 120*		*09/23/25 03:54*	*50*
Dibromofluoromethane (Surr)	*113*		*75 - 123*		*09/23/25 03:54*	*50*
Toluene-d8 (Surr)	*104*		*80 - 120*		*09/23/25 03:54*	*50*

Client Sample ID: OW-14B

Date Collected: 09/17/25 11:15
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-35

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		200	70	ug/L			09/23/25 20:45	200
1,1,1-Trichloroethane	ND		200	160	ug/L			09/23/25 20:45	200

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-14B
Date Collected: 09/17/25 11:15
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-35
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	**640**		200	42	ug/L			09/23/25 20:45	200
1,1,2-Trichloroethane	ND		200	46	ug/L			09/23/25 20:45	200
1,1-Dichloroethane	ND		200	76	ug/L			09/23/25 20:45	200
1,1-Dichloroethene	ND		200	58	ug/L			09/23/25 20:45	200
1,1-Dichloropropene	ND		200	140	ug/L			09/23/25 20:45	200
1,2,3-Trichlorobenzene	ND		200	82	ug/L			09/23/25 20:45	200
1,2,3-Trichloropropane	ND		200	180	ug/L			09/23/25 20:45	200
1,2,4-Trichlorobenzene	**160**	**J**	200	82	ug/L			09/23/25 20:45	200
1,2,4-Trimethylbenzene	ND		200	150	ug/L			09/23/25 20:45	200
1,2-Dibromo-3-Chloropropane	ND		200	78	ug/L			09/23/25 20:45	200
1,2-Dibromoethane	ND		200	150	ug/L			09/23/25 20:45	200
1,2-Dichlorobenzene	**990**		200	160	ug/L			09/23/25 20:45	200
1,2-Dichloroethane	ND		200	42	ug/L			09/23/25 20:45	200
1,2-Dichloropropane	ND		200	140	ug/L			09/23/25 20:45	200
1,3,5-Trimethylbenzene	ND		200	150	ug/L			09/23/25 20:45	200
1,3-Dichlorobenzene	**470**		200	160	ug/L			09/23/25 20:45	200
1,3-Dichloropropane	ND		200	150	ug/L			09/23/25 20:45	200
1,4-Dichlorobenzene	**1400**		200	170	ug/L			09/23/25 20:45	200
2,2-Dichloropropane	ND		200	80	ug/L			09/23/25 20:45	200
2-Butanone (MEK)	ND		2000	260	ug/L			09/23/25 20:45	200
2-Chloroethyl vinyl ether	ND		1000	190	ug/L			09/23/25 20:45	200
2-Hexanone	ND		1000	250	ug/L			09/23/25 20:45	200
4-Methyl-2-pentanone (MIBK)	ND		1000	420	ug/L			09/23/25 20:45	200
Acetone	ND		2000	600	ug/L			09/23/25 20:45	200
Benzene	**130**	**J**	200	82	ug/L			09/23/25 20:45	200
Bromobenzene	ND		200	160	ug/L			09/23/25 20:45	200
Bromochloromethane	ND		200	170	ug/L			09/23/25 20:45	200
Bromodichloromethane	ND		200	78	ug/L			09/23/25 20:45	200
Bromoform	ND		200	52	ug/L			09/23/25 20:45	200
Bromomethane	ND		200	140	ug/L			09/23/25 20:45	200
Carbon disulfide	ND		200	38	ug/L			09/23/25 20:45	200
Carbon tetrachloride	ND		200	54	ug/L			09/23/25 20:45	200
Chlorobenzene	**610**		200	150	ug/L			09/23/25 20:45	200
Chlorodibromomethane	ND		200	64	ug/L			09/23/25 20:45	200
Chloroethane	ND		200	64	ug/L			09/23/25 20:45	200
Chloroform	**300**		200	68	ug/L			09/23/25 20:45	200
Chloromethane	ND		200	70	ug/L			09/23/25 20:45	200
cis-1,2-Dichloroethene	**5800**		200	160	ug/L			09/23/25 20:45	200
cis-1,3-Dichloropropene	ND		200	72	ug/L			09/23/25 20:45	200
Dichlorodifluoromethane	ND		200	140	ug/L			09/23/25 20:45	200
Ethylbenzene	ND		200	150	ug/L			09/23/25 20:45	200
Hexachlorobutadiene	ND		400	56	ug/L			09/23/25 20:45	200
Isopropylbenzene	ND		200	160	ug/L			09/23/25 20:45	200
Methyl tert-butyl ether	ND		200	32	ug/L			09/23/25 20:45	200
Methylene Chloride	ND		200	88	ug/L			09/23/25 20:45	200
m-Xylene & p-Xylene	ND		400	130	ug/L			09/23/25 20:45	200
Naphthalene	ND		200	86	ug/L			09/23/25 20:45	200
n-Butylbenzene	ND		200	130	ug/L			09/23/25 20:45	200
N-Propylbenzene	ND		200	140	ug/L			09/23/25 20:45	200

Client Sample ID: OW-14B
Lab Sample ID: 480-232730-35

Date Collected: 09/17/25 11:15
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
o-Chlorotoluene	ND		200	170	ug/L			09/23/25 20:45	200
o-Xylene	ND		200	150	ug/L			09/23/25 20:45	200
p-Chlorotoluene	ND		200	170	ug/L			09/23/25 20:45	200
p-Cymene	ND		200	62	ug/L			09/23/25 20:45	200
sec-Butylbenzene	ND		200	150	ug/L			09/23/25 20:45	200
Styrene	ND		200	150	ug/L			09/23/25 20:45	200
tert-Butylbenzene	ND		200	160	ug/L			09/23/25 20:45	200
Tetrachloroethene	**2700**		200	72	ug/L			09/23/25 20:45	200
Toluene	ND		200	100	ug/L			09/23/25 20:45	200
trans-1,2-Dichloroethene	ND		200	180	ug/L			09/23/25 20:45	200
trans-1,3-Dichloropropene	ND		200	74	ug/L			09/23/25 20:45	200
Trichloroethene	**11000**		200	92	ug/L			09/23/25 20:45	200
Trichlorofluoromethane	ND		200	180	ug/L			09/23/25 20:45	200
Vinyl acetate	ND		1000	170	ug/L			09/23/25 20:45	200
Vinyl chloride	**450**		200	180	ug/L			09/23/25 20:45	200

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*104*		*77 - 120*		*09/23/25 20:45*	*200*
4-Bromofluorobenzene (Surr)	*106*		*73 - 120*		*09/23/25 20:45*	*200*
Dibromofluoromethane (Surr)	*110*		*75 - 123*		*09/23/25 20:45*	*200*
Toluene-d8 (Surr)	*99*		*80 - 120*		*09/23/25 20:45*	*200*

Client Sample ID: OW-22A
Lab Sample ID: 480-232730-36

Date Collected: 09/17/25 13:00
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			09/23/25 04:40	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			09/23/25 04:40	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			09/23/25 04:40	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			09/23/25 04:40	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			09/23/25 04:40	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			09/23/25 04:40	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			09/23/25 04:40	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			09/23/25 04:40	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			09/23/25 04:40	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			09/23/25 04:40	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			09/23/25 04:40	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			09/23/25 04:40	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			09/23/25 04:40	1
1,2-Dichlorobenzene	ND		1.0	0.79	ug/L			09/23/25 04:40	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			09/23/25 04:40	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			09/23/25 04:40	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			09/23/25 04:40	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			09/23/25 04:40	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			09/23/25 04:40	1
1,4-Dichlorobenzene	ND		1.0	0.84	ug/L			09/23/25 04:40	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			09/23/25 04:40	1
2-Butanone (MEK)	ND		10	1.3	ug/L			09/23/25 04:40	1

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-22A

Date Collected: 09/17/25 13:00
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-36

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			09/23/25 04:40	1
2-Hexanone	ND		5.0	1.2	ug/L			09/23/25 04:40	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			09/23/25 04:40	1
Acetone	ND		10	3.0	ug/L			09/23/25 04:40	1
Benzene	ND		1.0	0.41	ug/L			09/23/25 04:40	1
Bromobenzene	ND		1.0	0.80	ug/L			09/23/25 04:40	1
Bromochloromethane	ND		1.0	0.87	ug/L			09/23/25 04:40	1
Bromodichloromethane	ND		1.0	0.39	ug/L			09/23/25 04:40	1
Bromoform	ND		1.0	0.26	ug/L			09/23/25 04:40	1
Bromomethane	ND		1.0	0.69	ug/L			09/23/25 04:40	1
Carbon disulfide	ND		1.0	0.19	ug/L			09/23/25 04:40	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			09/23/25 04:40	1
Chlorobenzene	ND		1.0	0.75	ug/L			09/23/25 04:40	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			09/23/25 04:40	1
Chloroethane	ND		1.0	0.32	ug/L			09/23/25 04:40	1
Chloroform	ND		1.0	0.34	ug/L			09/23/25 04:40	1
Chloromethane	ND		1.0	0.35	ug/L			09/23/25 04:40	1
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			09/23/25 04:40	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			09/23/25 04:40	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			09/23/25 04:40	1
Ethylbenzene	ND		1.0	0.74	ug/L			09/23/25 04:40	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			09/23/25 04:40	1
Isopropylbenzene	ND		1.0	0.79	ug/L			09/23/25 04:40	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			09/23/25 04:40	1
Methylene Chloride	ND		1.0	0.44	ug/L			09/23/25 04:40	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			09/23/25 04:40	1
Naphthalene	ND		1.0	0.43	ug/L			09/23/25 04:40	1
n-Butylbenzene	ND		1.0	0.64	ug/L			09/23/25 04:40	1
N-Propylbenzene	ND		1.0	0.69	ug/L			09/23/25 04:40	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			09/23/25 04:40	1
o-Xylene	ND		1.0	0.76	ug/L			09/23/25 04:40	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			09/23/25 04:40	1
p-Cymene	ND		1.0	0.31	ug/L			09/23/25 04:40	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			09/23/25 04:40	1
Styrene	ND		1.0	0.73	ug/L			09/23/25 04:40	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			09/23/25 04:40	1
Tetrachloroethene	ND		1.0	0.36	ug/L			09/23/25 04:40	1
Toluene	ND		1.0	0.51	ug/L			09/23/25 04:40	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			09/23/25 04:40	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			09/23/25 04:40	1
Trichloroethene	ND		1.0	0.46	ug/L			09/23/25 04:40	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			09/23/25 04:40	1
Vinyl acetate	ND		5.0	0.85	ug/L			09/23/25 04:40	1
Vinyl chloride	ND		1.0	0.90	ug/L			09/23/25 04:40	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*104*		*77 - 120*		*09/23/25 04:40*	*1*
4-Bromofluorobenzene (Surr)	*108*		*73 - 120*		*09/23/25 04:40*	*1*
Dibromofluoromethane (Surr)	*100*		*75 - 123*		*09/23/25 04:40*	*1*
Toluene-d8 (Surr)	*98*		*80 - 120*		*09/23/25 04:40*	*1*

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-22B
Date Collected: 09/17/25 13:05
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-37
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		400	140	ug/L			09/23/25 21:08	400
1,1,1-Trichloroethane	ND		400	330	ug/L			09/23/25 21:08	400
1,1,2,2-Tetrachloroethane	**730**		400	84	ug/L			09/23/25 21:08	400
1,1,2-Trichloroethane	ND		400	92	ug/L			09/23/25 21:08	400
1,1-Dichloroethane	ND		400	150	ug/L			09/23/25 21:08	400
1,1-Dichloroethene	ND		400	120	ug/L			09/23/25 21:08	400
1,1-Dichloropropene	ND		400	290	ug/L			09/23/25 21:08	400
1,2,3-Trichlorobenzene	ND		400	160	ug/L			09/23/25 21:08	400
1,2,3-Trichloropropane	ND		400	360	ug/L			09/23/25 21:08	400
1,2,4-Trichlorobenzene	**200**	**J**	400	160	ug/L			09/23/25 21:08	400
1,2,4-Trimethylbenzene	ND		400	300	ug/L			09/23/25 21:08	400
1,2-Dibromo-3-Chloropropane	ND		400	160	ug/L			09/23/25 21:08	400
1,2-Dibromoethane	ND		400	290	ug/L			09/23/25 21:08	400
1,2-Dichlorobenzene	ND		400	320	ug/L			09/23/25 21:08	400
1,2-Dichloroethane	ND		400	84	ug/L			09/23/25 21:08	400
1,2-Dichloropropane	ND		400	290	ug/L			09/23/25 21:08	400
1,3,5-Trimethylbenzene	ND		400	310	ug/L			09/23/25 21:08	400
1,3-Dichlorobenzene	ND		400	310	ug/L			09/23/25 21:08	400
1,3-Dichloropropane	ND		400	300	ug/L			09/23/25 21:08	400
1,4-Dichlorobenzene	ND		400	340	ug/L			09/23/25 21:08	400
2,2-Dichloropropane	ND		400	160	ug/L			09/23/25 21:08	400
2-Butanone (MEK)	ND		4000	530	ug/L			09/23/25 21:08	400
2-Chloroethyl vinyl ether	ND		2000	380	ug/L			09/23/25 21:08	400
2-Hexanone	ND		2000	500	ug/L			09/23/25 21:08	400
4-Methyl-2-pentanone (MIBK)	ND		2000	840	ug/L			09/23/25 21:08	400
Acetone	ND		4000	1200	ug/L			09/23/25 21:08	400
Benzene	**170**	**J**	400	160	ug/L			09/23/25 21:08	400
Bromobenzene	ND		400	320	ug/L			09/23/25 21:08	400
Bromochloromethane	ND		400	350	ug/L			09/23/25 21:08	400
Bromodichloromethane	ND		400	160	ug/L			09/23/25 21:08	400
Bromoform	ND		400	100	ug/L			09/23/25 21:08	400
Bromomethane	ND		400	280	ug/L			09/23/25 21:08	400
Carbon disulfide	ND		400	76	ug/L			09/23/25 21:08	400
Carbon tetrachloride	ND		400	110	ug/L			09/23/25 21:08	400
Chlorobenzene	**340**	**J**	400	300	ug/L			09/23/25 21:08	400
Chlorodibromomethane	ND		400	130	ug/L			09/23/25 21:08	400
Chloroethane	ND		400	130	ug/L			09/23/25 21:08	400
Chloroform	**200**	**J**	400	140	ug/L			09/23/25 21:08	400
Chloromethane	ND		400	140	ug/L			09/23/25 21:08	400
cis-1,2-Dichloroethene	**5600**		400	320	ug/L			09/23/25 21:08	400
cis-1,3-Dichloropropene	ND		400	140	ug/L			09/23/25 21:08	400
Dichlorodifluoromethane	ND		400	270	ug/L			09/23/25 21:08	400
Ethylbenzene	ND		400	300	ug/L			09/23/25 21:08	400
Hexachlorobutadiene	ND		800	110	ug/L			09/23/25 21:08	400
Isopropylbenzene	ND		400	320	ug/L			09/23/25 21:08	400
Methyl tert-butyl ether	ND		400	64	ug/L			09/23/25 21:08	400
Methylene Chloride	ND	F2	400	180	ug/L			09/23/25 21:08	400
m-Xylene & p-Xylene	ND		800	260	ug/L			09/23/25 21:08	400
Naphthalene	ND		400	170	ug/L			09/23/25 21:08	400

Client Sample ID: OW-22B
Lab Sample ID: 480-232730-37

Date Collected: 09/17/25 13:05
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
n-Butylbenzene	ND		400	260	ug/L			09/23/25 21:08	400
N-Propylbenzene	ND		400	280	ug/L			09/23/25 21:08	400
o-Chlorotoluene	ND		400	340	ug/L			09/23/25 21:08	400
o-Xylene	ND		400	300	ug/L			09/23/25 21:08	400
p-Chlorotoluene	ND		400	340	ug/L			09/23/25 21:08	400
p-Cymene	ND		400	120	ug/L			09/23/25 21:08	400
sec-Butylbenzene	ND		400	300	ug/L			09/23/25 21:08	400
Styrene	ND		400	290	ug/L			09/23/25 21:08	400
tert-Butylbenzene	ND		400	320	ug/L			09/23/25 21:08	400
Tetrachloroethene	**6400**		400	140	ug/L			09/23/25 21:08	400
Toluene	ND		400	200	ug/L			09/23/25 21:08	400
trans-1,2-Dichloroethene	ND		400	360	ug/L			09/23/25 21:08	400
trans-1,3-Dichloropropene	ND		400	150	ug/L			09/23/25 21:08	400
Trichloroethene	**17000**	**F1**	400	180	ug/L			09/23/25 21:08	400
Trichlorofluoromethane	ND		400	350	ug/L			09/23/25 21:08	400
Vinyl acetate	ND		2000	340	ug/L			09/23/25 21:08	400
Vinyl chloride	**550**		400	360	ug/L			09/23/25 21:08	400

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*103*		*77 - 120*		*09/23/25 21:08*	*400*
4-Bromofluorobenzene (Surr)	*106*		*73 - 120*		*09/23/25 21:08*	*400*
Dibromofluoromethane (Surr)	*106*		*75 - 123*		*09/23/25 21:08*	*400*
Toluene-d8 (Surr)	*97*		*80 - 120*		*09/23/25 21:08*	*400*

Client Sample ID: OW-15B
Lab Sample ID: 480-232730-38

Date Collected: 09/17/25 11:50
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		200	70	ug/L			09/23/25 21:32	200
1,1,1-Trichloroethane	ND		200	160	ug/L			09/23/25 21:32	200
1,1,2,2-Tetrachloroethane	**290**		200	42	ug/L			09/23/25 21:32	200
1,1,2-Trichloroethane	ND		200	46	ug/L			09/23/25 21:32	200
1,1-Dichloroethane	ND		200	76	ug/L			09/23/25 21:32	200
1,1-Dichloroethene	ND		200	58	ug/L			09/23/25 21:32	200
1,1-Dichloropropene	ND		200	140	ug/L			09/23/25 21:32	200
1,2,3-Trichlorobenzene	ND		200	82	ug/L			09/23/25 21:32	200
1,2,3-Trichloropropane	ND		200	180	ug/L			09/23/25 21:32	200
1,2,4-Trichlorobenzene	ND		200	82	ug/L			09/23/25 21:32	200
1,2,4-Trimethylbenzene	ND		200	150	ug/L			09/23/25 21:32	200
1,2-Dibromo-3-Chloropropane	ND		200	78	ug/L			09/23/25 21:32	200
1,2-Dibromoethane	ND		200	150	ug/L			09/23/25 21:32	200
1,2-Dichlorobenzene	**270**		200	160	ug/L			09/23/25 21:32	200
1,2-Dichloroethane	ND		200	42	ug/L			09/23/25 21:32	200
1,2-Dichloropropane	ND		200	140	ug/L			09/23/25 21:32	200
1,3,5-Trimethylbenzene	ND		200	150	ug/L			09/23/25 21:32	200
1,3-Dichlorobenzene	**200**		200	160	ug/L			09/23/25 21:32	200
1,3-Dichloropropane	ND		200	150	ug/L			09/23/25 21:32	200
1,4-Dichlorobenzene	**340**		200	170	ug/L			09/23/25 21:32	200

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-15B

Date Collected: 09/17/25 11:50
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-38

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
2,2-Dichloropropane	ND		200	80	ug/L			09/23/25 21:32	200
2-Butanone (MEK)	ND		2000	260	ug/L			09/23/25 21:32	200
2-Chloroethyl vinyl ether	ND		1000	190	ug/L			09/23/25 21:32	200
2-Hexanone	ND		1000	250	ug/L			09/23/25 21:32	200
4-Methyl-2-pentanone (MIBK)	ND		1000	420	ug/L			09/23/25 21:32	200
Acetone	ND		2000	600	ug/L			09/23/25 21:32	200
Benzene	**120**	**J**	200	82	ug/L			09/23/25 21:32	200
Bromobenzene	ND		200	160	ug/L			09/23/25 21:32	200
Bromochloromethane	ND		200	170	ug/L			09/23/25 21:32	200
Bromodichloromethane	ND		200	78	ug/L			09/23/25 21:32	200
Bromoform	ND		200	52	ug/L			09/23/25 21:32	200
Bromomethane	ND		200	140	ug/L			09/23/25 21:32	200
Carbon disulfide	ND		200	38	ug/L			09/23/25 21:32	200
Carbon tetrachloride	ND		200	54	ug/L			09/23/25 21:32	200
Chlorobenzene	**590**		200	150	ug/L			09/23/25 21:32	200
Chlorodibromomethane	ND		200	64	ug/L			09/23/25 21:32	200
Chloroethane	ND		200	64	ug/L			09/23/25 21:32	200
Chloroform	ND		200	68	ug/L			09/23/25 21:32	200
Chloromethane	ND		200	70	ug/L			09/23/25 21:32	200
cis-1,2-Dichloroethene	**5200**		200	160	ug/L			09/23/25 21:32	200
cis-1,3-Dichloropropene	ND		200	72	ug/L			09/23/25 21:32	200
Dichlorodifluoromethane	ND		200	140	ug/L			09/23/25 21:32	200
Ethylbenzene	ND		200	150	ug/L			09/23/25 21:32	200
Hexachlorobutadiene	ND		400	56	ug/L			09/23/25 21:32	200
Isopropylbenzene	ND		200	160	ug/L			09/23/25 21:32	200
Methyl tert-butyl ether	ND		200	32	ug/L			09/23/25 21:32	200
Methylene Chloride	ND		200	88	ug/L			09/23/25 21:32	200
m-Xylene & p-Xylene	ND		400	130	ug/L			09/23/25 21:32	200
Naphthalene	ND		200	86	ug/L			09/23/25 21:32	200
n-Butylbenzene	ND		200	130	ug/L			09/23/25 21:32	200
N-Propylbenzene	ND		200	140	ug/L			09/23/25 21:32	200
o-Chlorotoluene	ND		200	170	ug/L			09/23/25 21:32	200
o-Xylene	ND		200	150	ug/L			09/23/25 21:32	200
p-Chlorotoluene	ND		200	170	ug/L			09/23/25 21:32	200
p-Cymene	ND		200	62	ug/L			09/23/25 21:32	200
sec-Butylbenzene	ND		200	150	ug/L			09/23/25 21:32	200
Styrene	ND		200	150	ug/L			09/23/25 21:32	200
tert-Butylbenzene	ND		200	160	ug/L			09/23/25 21:32	200
Tetrachloroethene	**1700**		200	72	ug/L			09/23/25 21:32	200
Toluene	ND		200	100	ug/L			09/23/25 21:32	200
trans-1,2-Dichloroethene	ND		200	180	ug/L			09/23/25 21:32	200
trans-1,3-Dichloropropene	ND		200	74	ug/L			09/23/25 21:32	200
Trichloroethene	**5600**		200	92	ug/L			09/23/25 21:32	200
Trichlorofluoromethane	ND		200	180	ug/L			09/23/25 21:32	200
Vinyl acetate	ND		1000	170	ug/L			09/23/25 21:32	200
Vinyl chloride	**610**		200	180	ug/L			09/23/25 21:32	200

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*105*		*77 - 120*		*09/23/25 21:32*	*200*
4-Bromofluorobenzene (Surr)	*106*		*73 - 120*		*09/23/25 21:32*	*200*

Client Sample ID: OW-15B
Lab Sample ID: 480-232730-38

Date Collected: 09/17/25 11:50
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
Dibromofluoromethane (Surr)	*104*		*75 - 123*		*09/23/25 21:32*	*200*
Toluene-d8 (Surr)	*98*		*80 - 120*		*09/23/25 21:32*	*200*

Client Sample ID: TB-01 (Trip Blank)
Lab Sample ID: 480-232730-39

Date Collected: 09/16/25 07:00
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			09/23/25 05:49	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			09/23/25 05:49	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			09/23/25 05:49	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			09/23/25 05:49	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			09/23/25 05:49	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			09/23/25 05:49	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			09/23/25 05:49	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			09/23/25 05:49	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			09/23/25 05:49	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			09/23/25 05:49	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			09/23/25 05:49	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			09/23/25 05:49	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			09/23/25 05:49	1
1,2-Dichlorobenzene	ND		1.0	0.79	ug/L			09/23/25 05:49	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			09/23/25 05:49	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			09/23/25 05:49	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			09/23/25 05:49	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			09/23/25 05:49	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			09/23/25 05:49	1
1,4-Dichlorobenzene	ND		1.0	0.84	ug/L			09/23/25 05:49	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			09/23/25 05:49	1
2-Butanone (MEK)	ND		10	1.3	ug/L			09/23/25 05:49	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			09/23/25 05:49	1
2-Hexanone	ND		5.0	1.2	ug/L			09/23/25 05:49	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			09/23/25 05:49	1
Acetone	ND		10	3.0	ug/L			09/23/25 05:49	1
Benzene	ND		1.0	0.41	ug/L			09/23/25 05:49	1
Bromobenzene	ND		1.0	0.80	ug/L			09/23/25 05:49	1
Bromochloromethane	ND		1.0	0.87	ug/L			09/23/25 05:49	1
Bromodichloromethane	ND		1.0	0.39	ug/L			09/23/25 05:49	1
Bromoform	ND		1.0	0.26	ug/L			09/23/25 05:49	1
Bromomethane	ND		1.0	0.69	ug/L			09/23/25 05:49	1
Carbon disulfide	ND		1.0	0.19	ug/L			09/23/25 05:49	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			09/23/25 05:49	1
Chlorobenzene	ND		1.0	0.75	ug/L			09/23/25 05:49	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			09/23/25 05:49	1
Chloroethane	ND		1.0	0.32	ug/L			09/23/25 05:49	1
Chloroform	ND		1.0	0.34	ug/L			09/23/25 05:49	1
Chloromethane	ND		1.0	0.35	ug/L			09/23/25 05:49	1
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			09/23/25 05:49	1

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: TB-01 (Trip Blank)

Lab Sample ID: 480-232730-39

Date Collected: 09/16/25 07:00
Date Received: 09/18/25 14:55

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			09/23/25 05:49	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			09/23/25 05:49	1
Ethylbenzene	ND		1.0	0.74	ug/L			09/23/25 05:49	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			09/23/25 05:49	1
Isopropylbenzene	ND		1.0	0.79	ug/L			09/23/25 05:49	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			09/23/25 05:49	1
Methylene Chloride	ND		1.0	0.44	ug/L			09/23/25 05:49	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			09/23/25 05:49	1
Naphthalene	ND		1.0	0.43	ug/L			09/23/25 05:49	1
n-Butylbenzene	ND		1.0	0.64	ug/L			09/23/25 05:49	1
N-Propylbenzene	ND		1.0	0.69	ug/L			09/23/25 05:49	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			09/23/25 05:49	1
o-Xylene	ND		1.0	0.76	ug/L			09/23/25 05:49	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			09/23/25 05:49	1
p-Cymene	ND		1.0	0.31	ug/L			09/23/25 05:49	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			09/23/25 05:49	1
Styrene	ND		1.0	0.73	ug/L			09/23/25 05:49	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			09/23/25 05:49	1
Tetrachloroethene	ND		1.0	0.36	ug/L			09/23/25 05:49	1
Toluene	ND		1.0	0.51	ug/L			09/23/25 05:49	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			09/23/25 05:49	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			09/23/25 05:49	1
Trichloroethene	ND		1.0	0.46	ug/L			09/23/25 05:49	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			09/23/25 05:49	1
Vinyl acetate	ND		5.0	0.85	ug/L			09/23/25 05:49	1
Vinyl chloride	ND		1.0	0.90	ug/L			09/23/25 05:49	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*119*		*77 - 120*		*09/23/25 05:49*	*1*
4-Bromofluorobenzene (Surr)	*114*		*73 - 120*		*09/23/25 05:49*	*1*
Dibromofluoromethane (Surr)	*116*		*75 - 123*		*09/23/25 05:49*	*1*
Toluene-d8 (Surr)	*104*		*80 - 120*		*09/23/25 05:49*	*1*

Client Sample ID: TB-02 (Trip Blank)

Lab Sample ID: 480-232730-40

Date Collected: 09/17/25 12:00
Date Received: 09/18/25 14:55

Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			09/23/25 06:12	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			09/23/25 06:12	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			09/23/25 06:12	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			09/23/25 06:12	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			09/23/25 06:12	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			09/23/25 06:12	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			09/23/25 06:12	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			09/23/25 06:12	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			09/23/25 06:12	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			09/23/25 06:12	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			09/23/25 06:12	1

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: TB-02 (Trip Blank)
Date Collected: 09/17/25 12:00
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-40
Matrix: Water

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			09/23/25 06:12	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			09/23/25 06:12	1
1,2-Dichlorobenzene	ND		1.0	0.79	ug/L			09/23/25 06:12	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			09/23/25 06:12	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			09/23/25 06:12	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			09/23/25 06:12	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			09/23/25 06:12	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			09/23/25 06:12	1
1,4-Dichlorobenzene	ND		1.0	0.84	ug/L			09/23/25 06:12	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			09/23/25 06:12	1
2-Butanone (MEK)	ND		10	1.3	ug/L			09/23/25 06:12	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			09/23/25 06:12	1
2-Hexanone	ND		5.0	1.2	ug/L			09/23/25 06:12	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			09/23/25 06:12	1
Acetone	ND		10	3.0	ug/L			09/23/25 06:12	1
Benzene	ND		1.0	0.41	ug/L			09/23/25 06:12	1
Bromobenzene	ND		1.0	0.80	ug/L			09/23/25 06:12	1
Bromochloromethane	ND		1.0	0.87	ug/L			09/23/25 06:12	1
Bromodichloromethane	ND		1.0	0.39	ug/L			09/23/25 06:12	1
Bromoform	ND		1.0	0.26	ug/L			09/23/25 06:12	1
Bromomethane	ND		1.0	0.69	ug/L			09/23/25 06:12	1
Carbon disulfide	ND		1.0	0.19	ug/L			09/23/25 06:12	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			09/23/25 06:12	1
Chlorobenzene	ND		1.0	0.75	ug/L			09/23/25 06:12	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			09/23/25 06:12	1
Chloroethane	ND		1.0	0.32	ug/L			09/23/25 06:12	1
Chloroform	ND		1.0	0.34	ug/L			09/23/25 06:12	1
Chloromethane	ND		1.0	0.35	ug/L			09/23/25 06:12	1
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			09/23/25 06:12	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			09/23/25 06:12	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			09/23/25 06:12	1
Ethylbenzene	ND		1.0	0.74	ug/L			09/23/25 06:12	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			09/23/25 06:12	1
Isopropylbenzene	ND		1.0	0.79	ug/L			09/23/25 06:12	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			09/23/25 06:12	1
Methylene Chloride	ND		1.0	0.44	ug/L			09/23/25 06:12	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			09/23/25 06:12	1
Naphthalene	ND		1.0	0.43	ug/L			09/23/25 06:12	1
n-Butylbenzene	ND		1.0	0.64	ug/L			09/23/25 06:12	1
N-Propylbenzene	ND		1.0	0.69	ug/L			09/23/25 06:12	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			09/23/25 06:12	1
o-Xylene	ND		1.0	0.76	ug/L			09/23/25 06:12	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			09/23/25 06:12	1
p-Cymene	ND		1.0	0.31	ug/L			09/23/25 06:12	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			09/23/25 06:12	1
Styrene	ND		1.0	0.73	ug/L			09/23/25 06:12	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			09/23/25 06:12	1
Tetrachloroethene	ND		1.0	0.36	ug/L			09/23/25 06:12	1
Toluene	ND		1.0	0.51	ug/L			09/23/25 06:12	1

Client: TRC Environmental Corporation
Job ID: 480-232730-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: TB-02 (Trip Blank)
Lab Sample ID: 480-232730-40
Date Collected: 09/17/25 12:00
Matrix: Water
Date Received: 09/18/25 14:55

Method: SW846 8260C - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			09/23/25 06:12	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			09/23/25 06:12	1
Trichloroethene	ND		1.0	0.46	ug/L			09/23/25 06:12	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			09/23/25 06:12	1
Vinyl acetate	ND		5.0	0.85	ug/L			09/23/25 06:12	1
Vinyl chloride	ND		1.0	0.90	ug/L			09/23/25 06:12	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*111*		*77 - 120*		*09/23/25 06:12*	*1*
4-Bromofluorobenzene (Surr)	*108*		*73 - 120*		*09/23/25 06:12*	*1*
Dibromofluoromethane (Surr)	*108*		*75 - 123*		*09/23/25 06:12*	*1*
Toluene-d8 (Surr)	*103*		*80 - 120*		*09/23/25 06:12*	*1*

Surrogate Summary

Client: TRC Environmental Corporation
Job ID: 480-232730-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Method: 8260C - Volatile Organic Compounds by GC/MS

Matrix: Water
Prep Type: Total/NA

		Percent Surrogate Recovery (Acceptance Limits)			
		DCA	BFB	DBFM	TOL
Lab Sample ID	Client Sample ID	(77-120)	(73-120)	(75-123)	(80-120)
480-232730-1	OW-26B	100	96	96	98
480-232730-2	OW-30B	97	91	95	94
480-232730-2 - DL	OW-30B	100	96	99	99
480-232730-3	MW-5A	103	97	101	97
480-232730-4	MW-5C	99	98	111	96
480-232730-5	MW-5CD	98	97	98	97
480-232730-6	MW-5F	102	94	103	97
480-232730-7	OW-12B	102	94	110	97
480-232730-7 - DL	OW-12B	101	99	122	94
480-232730-8	OW-9A	101	97	107	101
480-232730-8 - DL	OW-9A	106	102	113	100
480-232730-9	OW-27B	100	94	105	96
480-232730-10	OW-16A	105	97	115	96
480-232730-11	OW-13B	103	97	115	96
480-232730-12	OW-113B	102	96	112	97
480-232730-13	OW-29B	101	98	107	97
480-232730-14	OW-15A	107	94	110	97
480-232730-15	OW-28B	105	96	120	97
480-232730-16	MW-4B	103	99	119	98
480-232730-17	MW-4C	103	96	110	97
480-232730-17 MS	MW-4C	101	92	108	99
480-232730-17 MSD	MW-4C	99	94	103	97
480-232730-18	OW-5B	104	96	110	98
480-232730-19	OW-105B	108	107	106	98
480-232730-20	OW-6B	104	106	105	98
480-232730-21	OW-7B	104	105	97	95
480-232730-21 - DL	OW-7B	113	110	106	105
480-232730-22	OW-8B	107	107	110	98
480-232730-22 - DL	OW-8B	109	105	101	97
480-232730-23	MW-1B	102	99	103	95
480-232730-24	MW-1C	102	102	102	91
480-232730-25	MW-1CD	108	107	107	96
480-232730-26	MW-1F	103	106	103	98
480-232730-27	OW-12A	109	106	107	99
480-232730-28	OW-10B	106	106	102	98
480-232730-29	MW-2A	108	109	107	101
480-232730-30	OW-18A	110	109	108	101
480-232730-30 MS	OW-18A	112	109	110	101
480-232730-30 MSD	OW-18A	115	112	113	103
480-232730-31	OW-11B	106	103	104	100
480-232730-32	OW-111B	104	106	101	95
480-232730-33	MW-6B	113	111	109	100
480-232730-34	MW-6F	108	113	113	104
480-232730-35	OW-14B	104	106	110	99
480-232730-36	OW-22A	104	108	100	98
480-232730-37	OW-22B	103	106	106	97
480-232730-37 MS	OW-22B	108	108	107	95
480-232730-37 MSD	OW-22B	106	105	102	97
480-232730-38	OW-15B	105	106	104	98

Surrogate Summary

Client: TRC Environmental Corporation
Job ID: 480-232730-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Matrix: Water
Prep Type: Total/NA

		Percent Surrogate Recovery (Acceptance Limits)			
		DCA	BFB	DBFM	TOL
Lab Sample ID	Client Sample ID	(77-120)	(73-120)	(75-123)	(80-120)
480-232730-39	TB-01 (Trip Blank)	119	114	116	104
480-232730-40	TB-02 (Trip Blank)	111	108	108	103
LCS 480-757403/6	Lab Control Sample	109	110	104	101
LCS 480-757404/6	Lab Control Sample	100	95	104	98
LCS 480-757615/6	Lab Control Sample	114	110	112	102
LCS 480-757616/6	Lab Control Sample	100	94	100	95
LCS 480-757644/6	Lab Control Sample	99	107	101	99
LCS 480-757736/6	Lab Control Sample	109	104	108	97
MB 480-757403/9	Method Blank	98	101	97	93
MB 480-757404/8	Method Blank	102	91	103	96
MB 480-757615/9	Method Blank	109	107	112	101
MB 480-757616/8	Method Blank	103	97	102	98
MB 480-757644/8	Method Blank	111	107	105	99
MB 480-757736/8	Method Blank	112	111	109	100

Surrogate Legend

DCA = 1,2-Dichloroethane-d4 (Surr)
BFB = 4-Bromofluorobenzene (Surr)
DBFM = Dibromofluoromethane (Surr)
TOL = Toluene-d8 (Surr)

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Method: 8260C - Volatile Organic Compounds by GC/MS

Lab Sample ID: MB 480-757403/9
Matrix: Water
Analysis Batch: 757403

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			09/19/25 13:39	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			09/19/25 13:39	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			09/19/25 13:39	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			09/19/25 13:39	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			09/19/25 13:39	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			09/19/25 13:39	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			09/19/25 13:39	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			09/19/25 13:39	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			09/19/25 13:39	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			09/19/25 13:39	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			09/19/25 13:39	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			09/19/25 13:39	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			09/19/25 13:39	1
1,2-Dichlorobenzene	ND		1.0	0.79	ug/L			09/19/25 13:39	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			09/19/25 13:39	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			09/19/25 13:39	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			09/19/25 13:39	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			09/19/25 13:39	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			09/19/25 13:39	1
1,4-Dichlorobenzene	ND		1.0	0.84	ug/L			09/19/25 13:39	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			09/19/25 13:39	1
2-Butanone (MEK)	ND		10	1.3	ug/L			09/19/25 13:39	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			09/19/25 13:39	1
2-Hexanone	ND		5.0	1.2	ug/L			09/19/25 13:39	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			09/19/25 13:39	1
Acetone	ND		10	3.0	ug/L			09/19/25 13:39	1
Benzene	ND		1.0	0.41	ug/L			09/19/25 13:39	1
Bromobenzene	ND		1.0	0.80	ug/L			09/19/25 13:39	1
Bromochloromethane	ND		1.0	0.87	ug/L			09/19/25 13:39	1
Bromodichloromethane	ND		1.0	0.39	ug/L			09/19/25 13:39	1
Bromoform	ND		1.0	0.26	ug/L			09/19/25 13:39	1
Bromomethane	ND		1.0	0.69	ug/L			09/19/25 13:39	1
Carbon disulfide	ND		1.0	0.19	ug/L			09/19/25 13:39	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			09/19/25 13:39	1
Chlorobenzene	ND		1.0	0.75	ug/L			09/19/25 13:39	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			09/19/25 13:39	1
Chloroethane	ND		1.0	0.32	ug/L			09/19/25 13:39	1
Chloroform	ND		1.0	0.34	ug/L			09/19/25 13:39	1
Chloromethane	ND		1.0	0.35	ug/L			09/19/25 13:39	1
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			09/19/25 13:39	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			09/19/25 13:39	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			09/19/25 13:39	1
Ethylbenzene	ND		1.0	0.74	ug/L			09/19/25 13:39	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			09/19/25 13:39	1
Isopropylbenzene	ND		1.0	0.79	ug/L			09/19/25 13:39	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			09/19/25 13:39	1
Methylene Chloride	ND		1.0	0.44	ug/L			09/19/25 13:39	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			09/19/25 13:39	1

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: MB 480-757403/9
Matrix: Water
Analysis Batch: 757403

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Naphthalene	ND		1.0	0.43	ug/L			09/19/25 13:39	1
n-Butylbenzene	ND		1.0	0.64	ug/L			09/19/25 13:39	1
N-Propylbenzene	ND		1.0	0.69	ug/L			09/19/25 13:39	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			09/19/25 13:39	1
o-Xylene	ND		1.0	0.76	ug/L			09/19/25 13:39	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			09/19/25 13:39	1
p-Cymene	ND		1.0	0.31	ug/L			09/19/25 13:39	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			09/19/25 13:39	1
Styrene	ND		1.0	0.73	ug/L			09/19/25 13:39	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			09/19/25 13:39	1
Tetrachloroethene	ND		1.0	0.36	ug/L			09/19/25 13:39	1
Toluene	ND		1.0	0.51	ug/L			09/19/25 13:39	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			09/19/25 13:39	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			09/19/25 13:39	1
Trichloroethene	ND		1.0	0.46	ug/L			09/19/25 13:39	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			09/19/25 13:39	1
Vinyl acetate	ND		5.0	0.85	ug/L			09/19/25 13:39	1
Vinyl chloride	ND		1.0	0.90	ug/L			09/19/25 13:39	1

Surrogate	*MB %Recovery*	*MB Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*98*		*77 - 120*		*09/19/25 13:39*	*1*
4-Bromofluorobenzene (Surr)	*101*		*73 - 120*		*09/19/25 13:39*	*1*
Dibromofluoromethane (Surr)	*97*		*75 - 123*		*09/19/25 13:39*	*1*
Toluene-d8 (Surr)	*93*		*80 - 120*		*09/19/25 13:39*	*1*

Lab Sample ID: LCS 480-757403/6
Matrix: Water
Analysis Batch: 757403

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,1,1,2-Tetrachloroethane	25.0	26.5		ug/L		106	80 - 120
1,1,1-Trichloroethane	25.0	25.9		ug/L		104	73 - 126
1,1,2,2-Tetrachloroethane	25.0	23.8		ug/L		95	76 - 120
1,1,2-Trichloroethane	25.0	25.2		ug/L		101	76 - 122
1,1-Dichloroethane	25.0	23.9		ug/L		96	77 - 120
1,1-Dichloroethene	25.0	24.5		ug/L		98	66 - 127
1,1-Dichloropropene	25.0	25.4		ug/L		102	72 - 122
1,2,3-Trichlorobenzene	25.0	21.7		ug/L		87	75 - 123
1,2,3-Trichloropropane	25.0	22.8		ug/L		91	68 - 122
1,2,4-Trichlorobenzene	25.0	23.3		ug/L		93	79 - 122
1,2,4-Trimethylbenzene	25.0	23.5		ug/L		94	76 - 121
1,2-Dibromo-3-Chloropropane	25.0	22.1		ug/L		88	56 - 134
1,2-Dibromoethane	25.0	24.4		ug/L		98	77 - 120
1,2-Dichlorobenzene	25.0	23.3		ug/L		93	80 - 124
1,2-Dichloroethane	25.0	26.5		ug/L		106	75 - 120
1,2-Dichloropropane	25.0	24.1		ug/L		96	76 - 120
1,3,5-Trimethylbenzene	25.0	23.7		ug/L		95	77 - 121
1,3-Dichlorobenzene	25.0	23.3		ug/L		93	77 - 120

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: LCS 480-757403/6
Matrix: Water
Analysis Batch: 757403

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,3-Dichloropropane	25.0	25.1		ug/L		100	75 - 120
1,4-Dichlorobenzene	25.0	22.7		ug/L		91	80 - 120
2,2-Dichloropropane	25.0	24.5		ug/L		98	63 - 136
2-Butanone (MEK)	125	137		ug/L		109	57 - 140
2-Chloroethyl vinyl ether	25.0	24.1		ug/L		96	70 - 129
2-Hexanone	125	145		ug/L		116	65 - 127
4-Methyl-2-pentanone (MIBK)	125	130		ug/L		104	71 - 125
Acetone	125	149		ug/L		119	56 - 142
Benzene	25.0	24.4		ug/L		98	71 - 124
Bromobenzene	25.0	22.5		ug/L		90	78 - 120
Bromochloromethane	25.0	24.1		ug/L		96	72 - 130
Bromodichloromethane	25.0	27.8		ug/L		111	80 - 122
Bromoform	25.0	33.2	*+	ug/L		133	61 - 132
Bromomethane	25.0	23.7		ug/L		95	55 - 144
Carbon disulfide	25.0	24.4		ug/L		98	59 - 134
Carbon tetrachloride	25.0	26.1		ug/L		104	72 - 134
Chlorobenzene	25.0	24.7		ug/L		99	80 - 120
Chlorodibromomethane	25.0	30.1		ug/L		120	75 - 125
Chloroethane	25.0	23.8		ug/L		95	69 - 136
Chloroform	25.0	26.3		ug/L		105	73 - 127
Chloromethane	25.0	22.2		ug/L		89	68 - 124
cis-1,2-Dichloroethene	25.0	24.2		ug/L		97	74 - 124
cis-1,3-Dichloropropene	25.0	23.4		ug/L		94	74 - 124
Dichlorodifluoromethane	25.0	19.3		ug/L		77	59 - 135
Ethylbenzene	25.0	25.4		ug/L		102	77 - 123
Hexachlorobutadiene	25.0	24.5		ug/L		98	68 - 131
Isopropylbenzene	25.0	23.1		ug/L		93	77 - 122
Methyl tert-butyl ether	25.0	23.4		ug/L		93	77 - 120
Methylene Chloride	25.0	24.7		ug/L		99	75 - 124
m-Xylene & p-Xylene	25.0	24.4		ug/L		97	76 - 122
Naphthalene	25.0	20.9		ug/L		84	66 - 125
n-Butylbenzene	25.0	25.2		ug/L		101	71 - 128
N-Propylbenzene	25.0	23.6		ug/L		94	75 - 127
o-Chlorotoluene	25.0	23.4		ug/L		93	76 - 121
o-Xylene	25.0	25.5		ug/L		102	76 - 122
p-Chlorotoluene	25.0	24.1		ug/L		96	77 - 121
p-Cymene	25.0	23.8		ug/L		95	73 - 120
sec-Butylbenzene	25.0	24.2		ug/L		97	74 - 127
Styrene	25.0	25.5		ug/L		102	80 - 120
tert-Butylbenzene	25.0	24.0		ug/L		96	75 - 123
Tetrachloroethene	25.0	25.5		ug/L		102	74 - 122
Toluene	25.0	24.5		ug/L		98	80 - 122
trans-1,2-Dichloroethene	25.0	25.3		ug/L		101	73 - 127
trans-1,3-Dichloropropene	25.0	24.4		ug/L		98	80 - 120
Trichloroethene	25.0	24.1		ug/L		96	74 - 123
Trichlorofluoromethane	25.0	26.4		ug/L		106	62 - 150
Vinyl acetate	50.0	48.4		ug/L		97	50 - 144
Vinyl chloride	25.0	21.6		ug/L		86	65 - 133

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: LCS 480-757403/6
Matrix: Water
Analysis Batch: 757403

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Surrogate	LCS %Recovery	LCS Qualifier	Limits
1,2-Dichloroethane-d4 (Surr)	*109*		*77 - 120*
4-Bromofluorobenzene (Surr)	*110*		*73 - 120*
Dibromofluoromethane (Surr)	*104*		*75 - 123*
Toluene-d8 (Surr)	*101*		*80 - 120*

Lab Sample ID: MB 480-757404/8
Matrix: Water
Analysis Batch: 757404

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			09/19/25 12:55	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			09/19/25 12:55	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			09/19/25 12:55	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			09/19/25 12:55	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			09/19/25 12:55	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			09/19/25 12:55	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			09/19/25 12:55	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			09/19/25 12:55	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			09/19/25 12:55	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			09/19/25 12:55	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			09/19/25 12:55	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			09/19/25 12:55	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			09/19/25 12:55	1
1,2-Dichlorobenzene	ND		1.0	0.79	ug/L			09/19/25 12:55	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			09/19/25 12:55	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			09/19/25 12:55	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			09/19/25 12:55	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			09/19/25 12:55	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			09/19/25 12:55	1
1,4-Dichlorobenzene	ND		1.0	0.84	ug/L			09/19/25 12:55	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			09/19/25 12:55	1
2-Butanone (MEK)	ND		10	1.3	ug/L			09/19/25 12:55	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			09/19/25 12:55	1
2-Hexanone	ND		5.0	1.2	ug/L			09/19/25 12:55	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			09/19/25 12:55	1
Acetone	ND		10	3.0	ug/L			09/19/25 12:55	1
Benzene	ND		1.0	0.41	ug/L			09/19/25 12:55	1
Bromobenzene	ND		1.0	0.80	ug/L			09/19/25 12:55	1
Bromochloromethane	ND		1.0	0.87	ug/L			09/19/25 12:55	1
Bromodichloromethane	ND		1.0	0.39	ug/L			09/19/25 12:55	1
Bromoform	ND		1.0	0.26	ug/L			09/19/25 12:55	1
Bromomethane	ND		1.0	0.69	ug/L			09/19/25 12:55	1
Carbon disulfide	ND		1.0	0.19	ug/L			09/19/25 12:55	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			09/19/25 12:55	1
Chlorobenzene	ND		1.0	0.75	ug/L			09/19/25 12:55	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			09/19/25 12:55	1
Chloroethane	ND		1.0	0.32	ug/L			09/19/25 12:55	1
Chloroform	ND		1.0	0.34	ug/L			09/19/25 12:55	1

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: MB 480-757404/8
Matrix: Water
Analysis Batch: 757404

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloromethane	ND		1.0	0.35	ug/L			09/19/25 12:55	1
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			09/19/25 12:55	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			09/19/25 12:55	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			09/19/25 12:55	1
Ethylbenzene	ND		1.0	0.74	ug/L			09/19/25 12:55	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			09/19/25 12:55	1
Isopropylbenzene	ND		1.0	0.79	ug/L			09/19/25 12:55	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			09/19/25 12:55	1
Methylene Chloride	ND		1.0	0.44	ug/L			09/19/25 12:55	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			09/19/25 12:55	1
Naphthalene	ND		1.0	0.43	ug/L			09/19/25 12:55	1
n-Butylbenzene	ND		1.0	0.64	ug/L			09/19/25 12:55	1
N-Propylbenzene	ND		1.0	0.69	ug/L			09/19/25 12:55	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			09/19/25 12:55	1
o-Xylene	ND		1.0	0.76	ug/L			09/19/25 12:55	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			09/19/25 12:55	1
p-Cymene	ND		1.0	0.31	ug/L			09/19/25 12:55	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			09/19/25 12:55	1
Styrene	ND		1.0	0.73	ug/L			09/19/25 12:55	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			09/19/25 12:55	1
Tetrachloroethene	ND		1.0	0.36	ug/L			09/19/25 12:55	1
Toluene	ND		1.0	0.51	ug/L			09/19/25 12:55	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			09/19/25 12:55	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			09/19/25 12:55	1
Trichloroethene	ND		1.0	0.46	ug/L			09/19/25 12:55	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			09/19/25 12:55	1
Vinyl acetate	ND		5.0	0.85	ug/L			09/19/25 12:55	1
Vinyl chloride	ND		1.0	0.90	ug/L			09/19/25 12:55	1

Surrogate	*MB %Recovery*	*MB Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*102*		*77 - 120*		*09/19/25 12:55*	*1*
4-Bromofluorobenzene (Surr)	*91*		*73 - 120*		*09/19/25 12:55*	*1*
Dibromofluoromethane (Surr)	*103*		*75 - 123*		*09/19/25 12:55*	*1*
Toluene-d8 (Surr)	*96*		*80 - 120*		*09/19/25 12:55*	*1*

Lab Sample ID: LCS 480-757404/6
Matrix: Water
Analysis Batch: 757404

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,1,1,2-Tetrachloroethane	25.0	24.1		ug/L		96	80 - 120
1,1,1-Trichloroethane	25.0	24.7		ug/L		99	73 - 126
1,1,2,2-Tetrachloroethane	25.0	24.1		ug/L		96	76 - 120
1,1,2-Trichloroethane	25.0	23.9		ug/L		96	76 - 122
1,1-Dichloroethane	25.0	24.8		ug/L		99	77 - 120
1,1-Dichloroethene	25.0	25.2		ug/L		101	66 - 127
1,1-Dichloropropene	25.0	26.5		ug/L		106	72 - 122
1,2,3-Trichlorobenzene	25.0	24.7		ug/L		99	75 - 123

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: LCS 480-757404/6
Matrix: Water
Analysis Batch: 757404

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,2,3-Trichloropropane	25.0	24.1		ug/L		96	68 - 122
1,2,4-Trichlorobenzene	25.0	23.5		ug/L		94	79 - 122
1,2,4-Trimethylbenzene	25.0	24.4		ug/L		97	76 - 121
1,2-Dibromo-3-Chloropropane	25.0	21.1		ug/L		84	56 - 134
1,2-Dibromoethane	25.0	23.6		ug/L		94	77 - 120
1,2-Dichlorobenzene	25.0	24.4		ug/L		97	80 - 124
1,2-Dichloroethane	25.0	23.7		ug/L		95	75 - 120
1,2-Dichloropropane	25.0	24.9		ug/L		99	76 - 120
1,3,5-Trimethylbenzene	25.0	26.0		ug/L		104	77 - 121
1,3-Dichlorobenzene	25.0	25.4		ug/L		102	77 - 120
1,3-Dichloropropane	25.0	23.7		ug/L		95	75 - 120
1,4-Dichlorobenzene	25.0	23.8		ug/L		95	80 - 120
2,2-Dichloropropane	25.0	25.6		ug/L		103	63 - 136
2-Butanone (MEK)	125	122		ug/L		98	57 - 140
2-Chloroethyl vinyl ether	25.0	28.0		ug/L		112	70 - 129
2-Hexanone	125	104		ug/L		83	65 - 127
4-Methyl-2-pentanone (MIBK)	125	107		ug/L		85	71 - 125
Acetone	125	116		ug/L		92	56 - 142
Benzene	25.0	25.6		ug/L		102	71 - 124
Bromobenzene	25.0	25.3		ug/L		101	78 - 120
Bromochloromethane	25.0	24.9		ug/L		100	72 - 130
Bromodichloromethane	25.0	25.5		ug/L		102	80 - 122
Bromoform	25.0	24.2		ug/L		97	61 - 132
Bromomethane	25.0	19.9		ug/L		79	55 - 144
Carbon disulfide	25.0	24.8		ug/L		99	59 - 134
Carbon tetrachloride	25.0	26.8		ug/L		107	72 - 134
Chlorobenzene	25.0	24.2		ug/L		97	80 - 120
Chlorodibromomethane	25.0	24.8		ug/L		99	75 - 125
Chloroethane	25.0	20.0		ug/L		80	69 - 136
Chloroform	25.0	23.1		ug/L		92	73 - 127
Chloromethane	25.0	20.3		ug/L		81	68 - 124
cis-1,2-Dichloroethene	25.0	24.8		ug/L		99	74 - 124
cis-1,3-Dichloropropene	25.0	27.4		ug/L		109	74 - 124
Dichlorodifluoromethane	25.0	18.8		ug/L		75	59 - 135
Ethylbenzene	25.0	24.1		ug/L		97	77 - 123
Hexachlorobutadiene	25.0	24.2		ug/L		97	68 - 131
Isopropylbenzene	25.0	25.6		ug/L		102	77 - 122
Methyl tert-butyl ether	25.0	22.3		ug/L		89	77 - 120
Methylene Chloride	25.0	24.5		ug/L		98	75 - 124
m-Xylene & p-Xylene	25.0	24.0		ug/L		96	76 - 122
Naphthalene	25.0	23.4		ug/L		94	66 - 125
n-Butylbenzene	25.0	24.7		ug/L		99	71 - 128
N-Propylbenzene	25.0	26.1		ug/L		104	75 - 127
o-Chlorotoluene	25.0	26.3		ug/L		105	76 - 121
o-Xylene	25.0	23.8		ug/L		95	76 - 122
p-Chlorotoluene	25.0	25.0		ug/L		100	77 - 121
p-Cymene	25.0	26.1		ug/L		104	73 - 120
sec-Butylbenzene	25.0	26.4		ug/L		106	74 - 127
Styrene	25.0	24.9		ug/L		100	80 - 120

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: LCS 480-757404/6
Matrix: Water
Analysis Batch: 757404

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte			Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits		
tert-Butylbenzene			25.0	26.1		ug/L		105	75 - 123		
Tetrachloroethene			25.0	23.5		ug/L		94	74 - 122		
Toluene			25.0	24.1		ug/L		96	80 - 122		
trans-1,2-Dichloroethene			25.0	25.2		ug/L		101	73 - 127		
trans-1,3-Dichloropropene			25.0	25.3		ug/L		101	80 - 120		
Trichloroethene			25.0	26.8		ug/L		107	74 - 123		
Trichlorofluoromethane			25.0	23.5		ug/L		94	62 - 150		
Vinyl acetate			50.0	54.3		ug/L		109	50 - 144		
Vinyl chloride			25.0	22.4		ug/L		90	65 - 133		

Surrogate	*LCS %Recovery*	*LCS Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*100*		*77 - 120*
4-Bromofluorobenzene (Surr)	*95*		*73 - 120*
Dibromofluoromethane (Surr)	*104*		*75 - 123*
Toluene-d8 (Surr)	*98*		*80 - 120*

Lab Sample ID: 480-232730-17 MS
Matrix: Water
Analysis Batch: 757404

Client Sample ID: MW-4C
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits		
1,1,1,2-Tetrachloroethane	ND		10000	9890		ug/L		99	80 - 120		
1,1,1-Trichloroethane	ND		10000	10400		ug/L		104	73 - 126		
1,1,2,2-Tetrachloroethane	ND		10000	9050		ug/L		91	76 - 120		
1,1,2-Trichloroethane	ND		10000	9220		ug/L		92	76 - 122		
1,1-Dichloroethane	ND		10000	10600		ug/L		106	77 - 120		
1,1-Dichloroethene	ND		10000	10900		ug/L		109	66 - 127		
1,1-Dichloropropene	ND		10000	10400		ug/L		104	72 - 122		
1,2,3-Trichlorobenzene	ND		10000	9820		ug/L		98	75 - 123		
1,2,3-Trichloropropane	ND		10000	9090		ug/L		91	68 - 122		
1,2,4-Trichlorobenzene	ND		10000	9330		ug/L		93	79 - 122		
1,2,4-Trimethylbenzene	ND		10000	9530		ug/L		95	76 - 121		
1,2-Dibromo-3-Chloropropane	ND		10000	7810		ug/L		78	56 - 134		
1,2-Dibromoethane	ND		10000	9030		ug/L		90	77 - 120		
1,2-Dichlorobenzene	740		10000	9850		ug/L		91	80 - 124		
1,2-Dichloroethane	ND		10000	9510		ug/L		95	75 - 120		
1,2-Dichloropropane	ND		10000	9920		ug/L		99	76 - 120		
1,3,5-Trimethylbenzene	ND		10000	10200		ug/L		102	77 - 121		
1,3-Dichlorobenzene	ND		10000	9570		ug/L		96	77 - 120		
1,3-Dichloropropane	ND		10000	9410		ug/L		94	75 - 120		
1,4-Dichlorobenzene	500		10000	9330		ug/L		88	78 - 124		
2,2-Dichloropropane	ND		10000	9510		ug/L		95	63 - 136		
2-Butanone (MEK)	ND		50000	47500		ug/L		95	57 - 140		
2-Chloroethyl vinyl ether	ND		10000	10400		ug/L		104	70 - 129		
2-Hexanone	ND		50000	41500		ug/L		83	65 - 127		
4-Methyl-2-pentanone (MIBK)	ND		50000	43600		ug/L		87	71 - 125		
Acetone	ND		50000	47900		ug/L		96	56 - 142		
Benzene	3500		10000	13000		ug/L		95	71 - 124		

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: 480-232730-17 MS
Matrix: Water
Analysis Batch: 757404

Client Sample ID: MW-4C
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
Bromobenzene	ND		10000	9620		ug/L		96	78 - 120
Bromochloromethane	ND		10000	10500		ug/L		105	72 - 130
Bromodichloromethane	ND		10000	9920		ug/L		99	80 - 122
Bromoform	ND		10000	9030		ug/L		90	61 - 132
Bromomethane	ND		10000	8190		ug/L		82	55 - 144
Carbon disulfide	ND		10000	10800		ug/L		108	59 - 134
Carbon tetrachloride	ND		10000	11100		ug/L		111	72 - 134
Chlorobenzene	4900		10000	13300		ug/L		84	80 - 120
Chlorodibromomethane	ND		10000	9670		ug/L		97	75 - 125
Chloroethane	ND		10000	8350		ug/L		83	69 - 136
Chloroform	140	J	10000	9530		ug/L		94	73 - 127
Chloromethane	ND		10000	8210		ug/L		82	68 - 124
cis-1,2-Dichloroethene	30000	F1	10000	34100	F1	ug/L		38	74 - 124
cis-1,3-Dichloropropene	ND		10000	9990		ug/L		100	74 - 124
Dichlorodifluoromethane	ND		10000	7370		ug/L		74	59 - 135
Ethylbenzene	ND		10000	9510		ug/L		95	77 - 123
Hexachlorobutadiene	ND		10000	9550		ug/L		96	68 - 131
Isopropylbenzene	ND		10000	10200		ug/L		102	77 - 122
Methyl tert-butyl ether	ND		10000	9730		ug/L		97	77 - 120
Methylene Chloride	ND		10000	10600		ug/L		106	75 - 124
m-Xylene & p-Xylene	ND		10000	9340		ug/L		93	76 - 122
Naphthalene	ND		10000	9170		ug/L		92	66 - 125
n-Butylbenzene	ND		10000	9490		ug/L		95	71 - 128
N-Propylbenzene	ND		10000	9990		ug/L		100	75 - 127
o-Chlorotoluene	ND		10000	10100		ug/L		101	76 - 121
o-Xylene	ND		10000	9550		ug/L		95	76 - 122
p-Chlorotoluene	ND		10000	9340		ug/L		93	77 - 121
p-Cymene	ND		10000	10100		ug/L		101	73 - 120
sec-Butylbenzene	ND		10000	10200		ug/L		102	74 - 127
Styrene	ND		10000	9700		ug/L		97	80 - 120
tert-Butylbenzene	ND		10000	10000		ug/L		100	75 - 123
Tetrachloroethene	ND		10000	9570		ug/L		96	74 - 122
Toluene	ND		10000	9460		ug/L		95	80 - 122
trans-1,2-Dichloroethene	480		10000	11100		ug/L		106	73 - 127
trans-1,3-Dichloropropene	ND		10000	9160		ug/L		92	80 - 120
Trichloroethene	1500		10000	11500		ug/L		99	74 - 123
Trichlorofluoromethane	ND		10000	9640		ug/L		96	62 - 150
Vinyl acetate	ND		20000	19100		ug/L		96	50 - 144
Vinyl chloride	2300		10000	10700		ug/L		84	65 - 133

Surrogate	*MS %Recovery*	*MS Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*101*		*77 - 120*
4-Bromofluorobenzene (Surr)	*92*		*73 - 120*
Dibromofluoromethane (Surr)	*108*		*75 - 123*
Toluene-d8 (Surr)	*99*		*80 - 120*

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: 480-232730-17 MSD
Matrix: Water
Analysis Batch: 757404

Client Sample ID: MW-4C
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
1,1,1,2-Tetrachloroethane	ND		10000	9400		ug/L		94	80 - 120	5	20
1,1,1-Trichloroethane	ND		10000	9480		ug/L		95	73 - 126	9	15
1,1,2,2-Tetrachloroethane	ND		10000	8790		ug/L		88	76 - 120	3	15
1,1,2-Trichloroethane	ND		10000	9200		ug/L		92	76 - 122	0	15
1,1-Dichloroethane	ND		10000	9330		ug/L		93	77 - 120	13	20
1,1-Dichloroethene	ND		10000	9640		ug/L		96	66 - 127	12	16
1,1-Dichloropropene	ND		10000	9640		ug/L		96	72 - 122	8	20
1,2,3-Trichlorobenzene	ND		10000	9590		ug/L		96	75 - 123	2	20
1,2,3-Trichloropropane	ND		10000	8940		ug/L		89	68 - 122	2	14
1,2,4-Trichlorobenzene	ND		10000	8970		ug/L		90	79 - 122	4	20
1,2,4-Trimethylbenzene	ND		10000	9300		ug/L		93	76 - 121	2	20
1,2-Dibromo-3-Chloropropane	ND		10000	7860		ug/L		79	56 - 134	1	15
1,2-Dibromoethane	ND		10000	9290		ug/L		93	77 - 120	3	15
1,2-Dichlorobenzene	740		10000	9670		ug/L		89	80 - 124	2	20
1,2-Dichloroethane	ND		10000	8750		ug/L		88	75 - 120	8	20
1,2-Dichloropropane	ND		10000	9360		ug/L		94	76 - 120	6	20
1,3,5-Trimethylbenzene	ND		10000	9800		ug/L		98	77 - 121	4	20
1,3-Dichlorobenzene	ND		10000	9530		ug/L		95	77 - 120	0	20
1,3-Dichloropropane	ND		10000	9140		ug/L		91	75 - 120	3	20
1,4-Dichlorobenzene	500		10000	9220		ug/L		87	78 - 124	1	20
2,2-Dichloropropane	ND		10000	8860		ug/L		89	63 - 136	7	20
2-Butanone (MEK)	ND		50000	46100		ug/L		92	57 - 140	3	20
2-Chloroethyl vinyl ether	ND		10000	10100		ug/L		101	70 - 129	2	20
2-Hexanone	ND		50000	40500		ug/L		81	65 - 127	2	15
4-Methyl-2-pentanone (MIBK)	ND		50000	42600		ug/L		85	71 - 125	2	35
Acetone	ND		50000	45900		ug/L		92	56 - 142	4	15
Benzene	3500		10000	12200		ug/L		88	71 - 124	6	13
Bromobenzene	ND		10000	9790		ug/L		98	78 - 120	2	15
Bromochloromethane	ND		10000	9980		ug/L		100	72 - 130	5	15
Bromodichloromethane	ND		10000	9530		ug/L		95	80 - 122	4	15
Bromoform	ND		10000	8940		ug/L		89	61 - 132	1	15
Bromomethane	ND		10000	7530		ug/L		75	55 - 144	8	15
Carbon disulfide	ND		10000	9410		ug/L		94	59 - 134	14	15
Carbon tetrachloride	ND		10000	10100		ug/L		101	72 - 134	10	15
Chlorobenzene	4900		10000	13100		ug/L		82	80 - 120	1	25
Chlorodibromomethane	ND		10000	9620		ug/L		96	75 - 125	1	15
Chloroethane	ND		10000	7370		ug/L		74	69 - 136	12	15
Chloroform	140	J	10000	8880		ug/L		87	73 - 127	7	20
Chloromethane	ND		10000	7620		ug/L		76	68 - 124	7	15
cis-1,2-Dichloroethene	30000	F1	10000	30900	F1	ug/L		6	74 - 124	10	15
cis-1,3-Dichloropropene	ND		10000	9840		ug/L		98	74 - 124	2	15
Dichlorodifluoromethane	ND		10000	6780		ug/L		68	59 - 135	8	20
Ethylbenzene	ND		10000	9090		ug/L		91	77 - 123	5	15
Hexachlorobutadiene	ND		10000	9140		ug/L		91	68 - 131	4	20
Isopropylbenzene	ND		10000	9730		ug/L		97	77 - 122	5	20
Methyl tert-butyl ether	ND		10000	9010		ug/L		90	77 - 120	8	37
Methylene Chloride	ND		10000	9410		ug/L		94	75 - 124	12	15
m-Xylene & p-Xylene	ND		10000	9020		ug/L		90	76 - 122	3	16

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: 480-232730-17 MSD
Matrix: Water
Analysis Batch: 757404

Client Sample ID: MW-4C
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
Naphthalene	ND		10000	9020		ug/L		90	66 - 125	2	20
n-Butylbenzene	ND		10000	9150		ug/L		91	71 - 128	4	15
N-Propylbenzene	ND		10000	9470		ug/L		95	75 - 127	5	15
o-Chlorotoluene	ND		10000	9630		ug/L		96	76 - 121	4	20
o-Xylene	ND		10000	9180		ug/L		92	76 - 122	4	16
p-Chlorotoluene	ND		10000	9130		ug/L		91	77 - 121	2	15
p-Cymene	ND		10000	9690		ug/L		97	73 - 120	4	20
sec-Butylbenzene	ND		10000	9890		ug/L		99	74 - 127	3	15
Styrene	ND		10000	9600		ug/L		96	80 - 120	1	20
tert-Butylbenzene	ND		10000	9490		ug/L		95	75 - 123	5	15
Tetrachloroethene	ND		10000	9020		ug/L		90	74 - 122	6	20
Toluene	ND		10000	9070		ug/L		91	80 - 122	4	15
trans-1,2-Dichloroethene	480		10000	9870		ug/L		94	73 - 127	11	20
trans-1,3-Dichloropropene	ND		10000	9310		ug/L		93	80 - 120	2	15
Trichloroethene	1500		10000	11100		ug/L		95	74 - 123	4	16
Trichlorofluoromethane	ND		10000	8760		ug/L		88	62 - 150	10	20
Vinyl acetate	ND		20000	18900		ug/L		95	50 - 144	1	23
Vinyl chloride	2300		10000	9970		ug/L		76	65 - 133	7	15

Surrogate	*MSD %Recovery*	*MSD Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*99*		*77 - 120*
4-Bromofluorobenzene (Surr)	*94*		*73 - 120*
Dibromofluoromethane (Surr)	*103*		*75 - 123*
Toluene-d8 (Surr)	*97*		*80 - 120*

Lab Sample ID: MB 480-757615/9
Matrix: Water
Analysis Batch: 757615

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			09/22/25 14:10	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			09/22/25 14:10	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			09/22/25 14:10	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			09/22/25 14:10	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			09/22/25 14:10	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			09/22/25 14:10	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			09/22/25 14:10	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			09/22/25 14:10	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			09/22/25 14:10	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			09/22/25 14:10	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			09/22/25 14:10	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			09/22/25 14:10	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			09/22/25 14:10	1
1,2-Dichlorobenzene	ND		1.0	0.79	ug/L			09/22/25 14:10	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			09/22/25 14:10	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			09/22/25 14:10	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			09/22/25 14:10	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			09/22/25 14:10	1

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: MB 480-757615/9
Matrix: Water
Analysis Batch: 757615

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3-Dichloropropane	ND		1.0	0.75	ug/L			09/22/25 14:10	1
1,4-Dichlorobenzene	ND		1.0	0.84	ug/L			09/22/25 14:10	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			09/22/25 14:10	1
2-Butanone (MEK)	ND		10	1.3	ug/L			09/22/25 14:10	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			09/22/25 14:10	1
2-Hexanone	ND		5.0	1.2	ug/L			09/22/25 14:10	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			09/22/25 14:10	1
Acetone	ND		10	3.0	ug/L			09/22/25 14:10	1
Benzene	ND		1.0	0.41	ug/L			09/22/25 14:10	1
Bromobenzene	ND		1.0	0.80	ug/L			09/22/25 14:10	1
Bromochloromethane	ND		1.0	0.87	ug/L			09/22/25 14:10	1
Bromodichloromethane	ND		1.0	0.39	ug/L			09/22/25 14:10	1
Bromoform	ND		1.0	0.26	ug/L			09/22/25 14:10	1
Bromomethane	ND		1.0	0.69	ug/L			09/22/25 14:10	1
Carbon disulfide	ND		1.0	0.19	ug/L			09/22/25 14:10	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			09/22/25 14:10	1
Chlorobenzene	ND		1.0	0.75	ug/L			09/22/25 14:10	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			09/22/25 14:10	1
Chloroethane	ND		1.0	0.32	ug/L			09/22/25 14:10	1
Chloroform	ND		1.0	0.34	ug/L			09/22/25 14:10	1
Chloromethane	ND		1.0	0.35	ug/L			09/22/25 14:10	1
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			09/22/25 14:10	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			09/22/25 14:10	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			09/22/25 14:10	1
Ethylbenzene	ND		1.0	0.74	ug/L			09/22/25 14:10	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			09/22/25 14:10	1
Isopropylbenzene	ND		1.0	0.79	ug/L			09/22/25 14:10	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			09/22/25 14:10	1
Methylene Chloride	ND		1.0	0.44	ug/L			09/22/25 14:10	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			09/22/25 14:10	1
Naphthalene	ND		1.0	0.43	ug/L			09/22/25 14:10	1
n-Butylbenzene	ND		1.0	0.64	ug/L			09/22/25 14:10	1
N-Propylbenzene	ND		1.0	0.69	ug/L			09/22/25 14:10	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			09/22/25 14:10	1
o-Xylene	ND		1.0	0.76	ug/L			09/22/25 14:10	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			09/22/25 14:10	1
p-Cymene	ND		1.0	0.31	ug/L			09/22/25 14:10	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			09/22/25 14:10	1
Styrene	ND		1.0	0.73	ug/L			09/22/25 14:10	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			09/22/25 14:10	1
Tetrachloroethene	ND		1.0	0.36	ug/L			09/22/25 14:10	1
Toluene	ND		1.0	0.51	ug/L			09/22/25 14:10	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			09/22/25 14:10	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			09/22/25 14:10	1
Trichloroethene	ND		1.0	0.46	ug/L			09/22/25 14:10	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			09/22/25 14:10	1
Vinyl acetate	ND		5.0	0.85	ug/L			09/22/25 14:10	1
Vinyl chloride	ND		1.0	0.90	ug/L			09/22/25 14:10	1

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: MB 480-757615/9
Matrix: Water
Analysis Batch: 757615

Client Sample ID: Method Blank
Prep Type: Total/NA

Surrogate	MB %Recovery	MB Qualifier	Limits	Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	109		77 - 120		09/22/25 14:10	1
4-Bromofluorobenzene (Surr)	107		73 - 120		09/22/25 14:10	1
Dibromofluoromethane (Surr)	112		75 - 123		09/22/25 14:10	1
Toluene-d8 (Surr)	101		80 - 120		09/22/25 14:10	1

Lab Sample ID: LCS 480-757615/6
Matrix: Water
Analysis Batch: 757615

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,1,1,2-Tetrachloroethane	25.0	29.3		ug/L		117	80 - 120
1,1,1-Trichloroethane	25.0	30.2		ug/L		121	73 - 126
1,1,2,2-Tetrachloroethane	25.0	25.8		ug/L		103	76 - 120
1,1,2-Trichloroethane	25.0	25.8		ug/L		103	76 - 122
1,1-Dichloroethane	25.0	27.7		ug/L		111	77 - 120
1,1-Dichloroethene	25.0	27.5		ug/L		110	66 - 127
1,1-Dichloropropene	25.0	29.0		ug/L		116	72 - 122
1,2,3-Trichlorobenzene	25.0	22.9		ug/L		92	75 - 123
1,2,3-Trichloropropane	25.0	24.7		ug/L		99	68 - 122
1,2,4-Trichlorobenzene	25.0	25.1		ug/L		100	79 - 122
1,2,4-Trimethylbenzene	25.0	25.1		ug/L		100	76 - 121
1,2-Dibromo-3-Chloropropane	25.0	27.4		ug/L		110	56 - 134
1,2-Dibromoethane	25.0	25.6		ug/L		103	77 - 120
1,2-Dichlorobenzene	25.0	25.6		ug/L		102	80 - 124
1,2-Dichloroethane	25.0	28.6		ug/L		114	75 - 120
1,2-Dichloropropane	25.0	26.5		ug/L		106	76 - 120
1,3,5-Trimethylbenzene	25.0	25.2		ug/L		101	77 - 121
1,3-Dichlorobenzene	25.0	26.2		ug/L		105	77 - 120
1,3-Dichloropropane	25.0	25.8		ug/L		103	75 - 120
1,4-Dichlorobenzene	25.0	24.9		ug/L		99	80 - 120
2,2-Dichloropropane	25.0	30.0		ug/L		120	63 - 136
2-Butanone (MEK)	125	141		ug/L		112	57 - 140
2-Chloroethyl vinyl ether	25.0	26.1		ug/L		104	70 - 129
2-Hexanone	125	143		ug/L		114	65 - 127
4-Methyl-2-pentanone (MIBK)	125	132		ug/L		106	71 - 125
Acetone	125	144		ug/L		115	56 - 142
Benzene	25.0	27.0		ug/L		108	71 - 124
Bromobenzene	25.0	25.1		ug/L		101	78 - 120
Bromochloromethane	25.0	27.2		ug/L		109	72 - 130
Bromodichloromethane	25.0	31.0	*+	ug/L		124	80 - 122
Bromoform	25.0	37.0	*+	ug/L		148	61 - 132
Bromomethane	25.0	26.8		ug/L		107	55 - 144
Carbon disulfide	25.0	27.8		ug/L		111	59 - 134
Carbon tetrachloride	25.0	31.6		ug/L		126	72 - 134
Chlorobenzene	25.0	25.9		ug/L		104	80 - 120
Chlorodibromomethane	25.0	32.5	*+	ug/L		130	75 - 125
Chloroethane	25.0	26.2		ug/L		105	69 - 136
Chloroform	25.0	29.5		ug/L		118	73 - 127

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: LCS 480-757615/6
Matrix: Water
Analysis Batch: 757615

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Chloromethane	25.0	24.8		ug/L		99	68 - 124
cis-1,2-Dichloroethene	25.0	26.8		ug/L		107	74 - 124
cis-1,3-Dichloropropene	25.0	26.3		ug/L		105	74 - 124
Dichlorodifluoromethane	25.0	21.5		ug/L		86	59 - 135
Ethylbenzene	25.0	26.4		ug/L		106	77 - 123
Hexachlorobutadiene	25.0	27.6		ug/L		110	68 - 131
Isopropylbenzene	25.0	25.3		ug/L		101	77 - 122
Methyl tert-butyl ether	25.0	25.7		ug/L		103	77 - 120
Methylene Chloride	25.0	29.6		ug/L		118	75 - 124
m-Xylene & p-Xylene	25.0	25.8		ug/L		103	76 - 122
Naphthalene	25.0	22.1		ug/L		88	66 - 125
n-Butylbenzene	25.0	27.1		ug/L		108	71 - 128
N-Propylbenzene	25.0	26.4		ug/L		105	75 - 127
o-Chlorotoluene	25.0	25.6		ug/L		103	76 - 121
o-Xylene	25.0	25.7		ug/L		103	76 - 122
p-Chlorotoluene	25.0	25.8		ug/L		103	77 - 121
p-Cymene	25.0	26.3		ug/L		105	73 - 120
sec-Butylbenzene	25.0	26.4		ug/L		105	74 - 127
Styrene	25.0	27.1		ug/L		108	80 - 120
tert-Butylbenzene	25.0	25.8		ug/L		103	75 - 123
Tetrachloroethene	25.0	28.2		ug/L		113	74 - 122
Toluene	25.0	25.8		ug/L		103	80 - 122
trans-1,2-Dichloroethene	25.0	27.7		ug/L		111	73 - 127
trans-1,3-Dichloropropene	25.0	25.6		ug/L		103	80 - 120
Trichloroethene	25.0	27.9		ug/L		112	74 - 123
Trichlorofluoromethane	25.0	31.4		ug/L		125	62 - 150
Vinyl acetate	50.0	53.2		ug/L		106	50 - 144
Vinyl chloride	25.0	25.6		ug/L		102	65 - 133

Surrogate	*LCS %Recovery*	*LCS Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*114*		*77 - 120*
4-Bromofluorobenzene (Surr)	*110*		*73 - 120*
Dibromofluoromethane (Surr)	*112*		*75 - 123*
Toluene-d8 (Surr)	*102*		*80 - 120*

Lab Sample ID: 480-232730-30 MS
Matrix: Water
Analysis Batch: 757615

Client Sample ID: OW-18A
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
1,1,1,2-Tetrachloroethane	ND		12500	11600		ug/L		93	80 - 120
1,1,1-Trichloroethane	ND		12500	13200		ug/L		105	73 - 126
1,1,2,2-Tetrachloroethane	ND		12500	12600		ug/L		101	76 - 120
1,1,2-Trichloroethane	ND		12500	12600		ug/L		101	76 - 122
1,1-Dichloroethane	ND		12500	13400		ug/L		107	77 - 120
1,1-Dichloroethene	ND		12500	13300		ug/L		106	66 - 127
1,1-Dichloropropene	ND		12500	13900		ug/L		111	72 - 122
1,2,3-Trichlorobenzene	ND		12500	11800		ug/L		94	75 - 123

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: 480-232730-30 MS
Matrix: Water
Analysis Batch: 757615

Client Sample ID: OW-18A
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
1,2,3-Trichloropropane	ND		12500	11900		ug/L		95	68 - 122
1,2,4-Trichlorobenzene	ND		12500	12500		ug/L		100	79 - 122
1,2,4-Trimethylbenzene	ND		12500	12400		ug/L		99	76 - 121
1,2-Dibromo-3-Chloropropane	ND	F2	12500	9630		ug/L		77	56 - 134
1,2-Dibromoethane	ND		12500	12400		ug/L		99	77 - 120
1,2-Dichlorobenzene	2300		12500	15200		ug/L		104	80 - 124
1,2-Dichloroethane	ND		12500	13900		ug/L		111	75 - 120
1,2-Dichloropropane	ND		12500	13200		ug/L		106	76 - 120
1,3,5-Trimethylbenzene	ND		12500	12600		ug/L		101	77 - 121
1,3-Dichlorobenzene	1300		12500	13800		ug/L		100	77 - 120
1,3-Dichloropropane	ND		12500	12600		ug/L		101	75 - 120
1,4-Dichlorobenzene	9800		12500	22500		ug/L		101	78 - 124
2,2-Dichloropropane	ND		12500	11600		ug/L		93	63 - 136
2-Butanone (MEK)	ND		62500	69100		ug/L		111	57 - 140
2-Chloroethyl vinyl ether	ND		12500	12800		ug/L		103	70 - 129
2-Hexanone	ND		62500	69600		ug/L		111	65 - 127
4-Methyl-2-pentanone (MIBK)	ND		62500	65000		ug/L		104	71 - 125
Acetone	ND		62500	68800		ug/L		110	56 - 142
Benzene	430	J	12500	13600		ug/L		105	71 - 124
Bromobenzene	ND		12500	12100		ug/L		97	78 - 120
Bromochloromethane	ND		12500	13200		ug/L		106	72 - 130
Bromodichloromethane	ND	*+	12500	13500		ug/L		108	80 - 122
Bromoform	ND	*+	12500	13400		ug/L		107	61 - 132
Bromomethane	ND		12500	12400		ug/L		99	55 - 144
Carbon disulfide	ND		12500	12900		ug/L		103	59 - 134
Carbon tetrachloride	ND	F2	12500	12200		ug/L		97	72 - 134
Chlorobenzene	17000		12500	29300		ug/L		100	80 - 120
Chlorodibromomethane	ND	*+	12500	13100		ug/L		105	75 - 125
Chloroethane	ND		12500	12300		ug/L		98	69 - 136
Chloroform	ND		12500	13700		ug/L		110	73 - 127
Chloromethane	ND		12500	11800		ug/L		94	68 - 124
cis-1,2-Dichloroethene	ND		12500	12900		ug/L		103	74 - 124
cis-1,3-Dichloropropene	ND		12500	11600		ug/L		92	74 - 124
Dichlorodifluoromethane	ND		12500	9960		ug/L		80	59 - 135
Ethylbenzene	ND		12500	12800		ug/L		102	77 - 123
Hexachlorobutadiene	ND		12500	12700		ug/L		102	68 - 131
Isopropylbenzene	ND		12500	12600		ug/L		101	77 - 122
Methyl tert-butyl ether	ND		12500	12800		ug/L		102	77 - 120
Methylene Chloride	ND		12500	14000		ug/L		112	75 - 124
m-Xylene & p-Xylene	ND		12500	12400		ug/L		99	76 - 122
Naphthalene	ND		12500	11500		ug/L		92	66 - 125
n-Butylbenzene	ND		12500	12900		ug/L		103	71 - 128
N-Propylbenzene	ND		12500	12600		ug/L		101	75 - 127
o-Chlorotoluene	ND		12500	12300		ug/L		98	76 - 121
o-Xylene	ND		12500	12800		ug/L		102	76 - 122
p-Chlorotoluene	ND		12500	13100		ug/L		105	77 - 121
p-Cymene	ND		12500	12800		ug/L		103	73 - 120
sec-Butylbenzene	ND		12500	12800		ug/L		102	74 - 127
Styrene	ND		12500	13000		ug/L		104	80 - 120

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: 480-232730-30 MS
Matrix: Water
Analysis Batch: 757615

Client Sample ID: OW-18A
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
tert-Butylbenzene	ND		12500	12600		ug/L		101	75 - 123
Tetrachloroethene	ND		12500	13100		ug/L		105	74 - 122
Toluene	ND		12500	12400		ug/L		100	80 - 122
trans-1,2-Dichloroethene	ND		12500	13700		ug/L		110	73 - 127
trans-1,3-Dichloropropene	ND		12500	10200		ug/L		82	80 - 120
Trichloroethene	ND		12500	13700		ug/L		110	74 - 123
Trichlorofluoromethane	ND		12500	14500		ug/L		116	62 - 150
Vinyl acetate	ND		25000	22600		ug/L		90	50 - 144
Vinyl chloride	ND		12500	12000		ug/L		96	65 - 133

Surrogate	*MS %Recovery*	*MS Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*112*		*77 - 120*
4-Bromofluorobenzene (Surr)	*109*		*73 - 120*
Dibromofluoromethane (Surr)	*110*		*75 - 123*
Toluene-d8 (Surr)	*101*		*80 - 120*

Lab Sample ID: 480-232730-30 MSD
Matrix: Water
Analysis Batch: 757615

Client Sample ID: OW-18A
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
1,1,1,2-Tetrachloroethane	ND		12500	13200		ug/L		105	80 - 120	13	20
1,1,1-Trichloroethane	ND		12500	14400		ug/L		115	73 - 126	9	15
1,1,2,2-Tetrachloroethane	ND		12500	13000		ug/L		104	76 - 120	3	15
1,1,2-Trichloroethane	ND		12500	13100		ug/L		105	76 - 122	4	15
1,1-Dichloroethane	ND		12500	14000		ug/L		112	77 - 120	4	20
1,1-Dichloroethene	ND		12500	13500		ug/L		108	66 - 127	1	16
1,1-Dichloropropene	ND		12500	14700		ug/L		118	72 - 122	6	20
1,2,3-Trichlorobenzene	ND		12500	12200		ug/L		98	75 - 123	4	20
1,2,3-Trichloropropane	ND		12500	12900		ug/L		103	68 - 122	8	14
1,2,4-Trichlorobenzene	ND		12500	13100		ug/L		105	79 - 122	5	20
1,2,4-Trimethylbenzene	ND		12500	13200		ug/L		105	76 - 121	6	20
1,2-Dibromo-3-Chloropropane	ND	F2	12500	11300	F2	ug/L		91	56 - 134	16	15
1,2-Dibromoethane	ND		12500	12800		ug/L		103	77 - 120	3	15
1,2-Dichlorobenzene	2300		12500	15800		ug/L		109	80 - 124	4	20
1,2-Dichloroethane	ND		12500	14200		ug/L		113	75 - 120	2	20
1,2-Dichloropropane	ND		12500	13600		ug/L		108	76 - 120	2	20
1,3,5-Trimethylbenzene	ND		12500	13200		ug/L		106	77 - 121	5	20
1,3-Dichlorobenzene	1300		12500	14800		ug/L		108	77 - 120	7	20
1,3-Dichloropropane	ND		12500	13500		ug/L		108	75 - 120	7	20
1,4-Dichlorobenzene	9800		12500	23300		ug/L		107	78 - 124	3	20
2,2-Dichloropropane	ND		12500	12600		ug/L		101	63 - 136	9	20
2-Butanone (MEK)	ND		62500	69500		ug/L		111	57 - 140	1	20
2-Chloroethyl vinyl ether	ND		12500	13100		ug/L		104	70 - 129	2	20
2-Hexanone	ND		62500	71500		ug/L		114	65 - 127	3	15
4-Methyl-2-pentanone (MIBK)	ND		62500	67600		ug/L		108	71 - 125	4	35
Acetone	ND		62500	72700		ug/L		116	56 - 142	6	15
Benzene	430	J	12500	14300		ug/L		111	71 - 124	5	13

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: 480-232730-30 MSD
Matrix: Water
Analysis Batch: 757615

Client Sample ID: OW-18A
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
Bromobenzene	ND		12500	12600		ug/L		100	78 - 120	3	15
Bromochloromethane	ND		12500	13800		ug/L		111	72 - 130	5	15
Bromodichloromethane	ND	*+	12500	14700		ug/L		118	80 - 122	8	15
Bromoform	ND	*+	12500	15400		ug/L		123	61 - 132	14	15
Bromomethane	ND		12500	13700		ug/L		109	55 - 144	10	15
Carbon disulfide	ND		12500	13800		ug/L		111	59 - 134	7	15
Carbon tetrachloride	ND	F2	12500	14300	F2	ug/L		114	72 - 134	16	15
Chlorobenzene	17000		12500	30900		ug/L		112	80 - 120	5	25
Chlorodibromomethane	ND	*+	12500	13900		ug/L		111	75 - 125	6	15
Chloroethane	ND		12500	13100		ug/L		104	69 - 136	6	15
Chloroform	ND		12500	14300		ug/L		115	73 - 127	4	20
Chloromethane	ND		12500	12700		ug/L		102	68 - 124	8	15
cis-1,2-Dichloroethene	ND		12500	13900		ug/L		111	74 - 124	7	15
cis-1,3-Dichloropropene	ND		12500	12500		ug/L		100	74 - 124	8	15
Dichlorodifluoromethane	ND		12500	11000		ug/L		88	59 - 135	10	20
Ethylbenzene	ND		12500	13400		ug/L		107	77 - 123	4	15
Hexachlorobutadiene	ND		12500	13800		ug/L		110	68 - 131	8	20
Isopropylbenzene	ND		12500	13200		ug/L		106	77 - 122	5	20
Methyl tert-butyl ether	ND		12500	13300		ug/L		107	77 - 120	4	37
Methylene Chloride	ND		12500	14100		ug/L		113	75 - 124	1	15
m-Xylene & p-Xylene	ND		12500	13300		ug/L		106	76 - 122	7	16
Naphthalene	ND		12500	12000		ug/L		96	66 - 125	4	20
n-Butylbenzene	ND		12500	13600		ug/L		109	71 - 128	6	15
N-Propylbenzene	ND		12500	13600		ug/L		108	75 - 127	7	15
o-Chlorotoluene	ND		12500	12600		ug/L		101	76 - 121	3	20
o-Xylene	ND		12500	13500		ug/L		108	76 - 122	6	16
p-Chlorotoluene	ND		12500	13400		ug/L		107	77 - 121	3	15
p-Cymene	ND		12500	13500		ug/L		108	73 - 120	5	20
sec-Butylbenzene	ND		12500	13700		ug/L		109	74 - 127	7	15
Styrene	ND		12500	13600		ug/L		109	80 - 120	5	20
tert-Butylbenzene	ND		12500	13000		ug/L		104	75 - 123	4	15
Tetrachloroethene	ND		12500	13800		ug/L		111	74 - 122	6	20
Toluene	ND		12500	13400		ug/L		107	80 - 122	7	15
trans-1,2-Dichloroethene	ND		12500	14000		ug/L		112	73 - 127	2	20
trans-1,3-Dichloropropene	ND		12500	11400		ug/L		92	80 - 120	11	15
Trichloroethene	ND		12500	14100		ug/L		113	74 - 123	3	16
Trichlorofluoromethane	ND		12500	15700		ug/L		126	62 - 150	8	20
Vinyl acetate	ND		25000	23900		ug/L		96	50 - 144	6	23
Vinyl chloride	ND		12500	13200		ug/L		105	65 - 133	9	15

Surrogate	*MSD %Recovery*	*MSD Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*115*		*77 - 120*
4-Bromofluorobenzene (Surr)	*112*		*73 - 120*
Dibromofluoromethane (Surr)	*113*		*75 - 123*
Toluene-d8 (Surr)	*103*		*80 - 120*

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: MB 480-757616/8
Matrix: Water
Analysis Batch: 757616

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			09/22/25 12:59	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			09/22/25 12:59	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			09/22/25 12:59	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			09/22/25 12:59	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			09/22/25 12:59	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			09/22/25 12:59	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			09/22/25 12:59	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			09/22/25 12:59	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			09/22/25 12:59	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			09/22/25 12:59	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			09/22/25 12:59	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			09/22/25 12:59	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			09/22/25 12:59	1
1,2-Dichlorobenzene	ND		1.0	0.79	ug/L			09/22/25 12:59	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			09/22/25 12:59	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			09/22/25 12:59	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			09/22/25 12:59	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			09/22/25 12:59	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			09/22/25 12:59	1
1,4-Dichlorobenzene	ND		1.0	0.84	ug/L			09/22/25 12:59	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			09/22/25 12:59	1
2-Butanone (MEK)	ND		10	1.3	ug/L			09/22/25 12:59	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			09/22/25 12:59	1
2-Hexanone	ND		5.0	1.2	ug/L			09/22/25 12:59	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			09/22/25 12:59	1
Acetone	ND		10	3.0	ug/L			09/22/25 12:59	1
Benzene	ND		1.0	0.41	ug/L			09/22/25 12:59	1
Bromobenzene	ND		1.0	0.80	ug/L			09/22/25 12:59	1
Bromochloromethane	ND		1.0	0.87	ug/L			09/22/25 12:59	1
Bromodichloromethane	ND		1.0	0.39	ug/L			09/22/25 12:59	1
Bromoform	ND		1.0	0.26	ug/L			09/22/25 12:59	1
Bromomethane	ND		1.0	0.69	ug/L			09/22/25 12:59	1
Carbon disulfide	ND		1.0	0.19	ug/L			09/22/25 12:59	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			09/22/25 12:59	1
Chlorobenzene	ND		1.0	0.75	ug/L			09/22/25 12:59	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			09/22/25 12:59	1
Chloroethane	ND		1.0	0.32	ug/L			09/22/25 12:59	1
Chloroform	ND		1.0	0.34	ug/L			09/22/25 12:59	1
Chloromethane	ND		1.0	0.35	ug/L			09/22/25 12:59	1
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			09/22/25 12:59	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			09/22/25 12:59	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			09/22/25 12:59	1
Ethylbenzene	ND		1.0	0.74	ug/L			09/22/25 12:59	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			09/22/25 12:59	1
Isopropylbenzene	ND		1.0	0.79	ug/L			09/22/25 12:59	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			09/22/25 12:59	1
Methylene Chloride	ND		1.0	0.44	ug/L			09/22/25 12:59	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			09/22/25 12:59	1

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: MB 480-757616/8
Matrix: Water
Analysis Batch: 757616

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Naphthalene	ND		1.0	0.43	ug/L			09/22/25 12:59	1
n-Butylbenzene	ND		1.0	0.64	ug/L			09/22/25 12:59	1
N-Propylbenzene	ND		1.0	0.69	ug/L			09/22/25 12:59	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			09/22/25 12:59	1
o-Xylene	ND		1.0	0.76	ug/L			09/22/25 12:59	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			09/22/25 12:59	1
p-Cymene	ND		1.0	0.31	ug/L			09/22/25 12:59	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			09/22/25 12:59	1
Styrene	ND		1.0	0.73	ug/L			09/22/25 12:59	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			09/22/25 12:59	1
Tetrachloroethene	ND		1.0	0.36	ug/L			09/22/25 12:59	1
Toluene	ND		1.0	0.51	ug/L			09/22/25 12:59	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			09/22/25 12:59	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			09/22/25 12:59	1
Trichloroethene	ND		1.0	0.46	ug/L			09/22/25 12:59	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			09/22/25 12:59	1
Vinyl acetate	ND		5.0	0.85	ug/L			09/22/25 12:59	1
Vinyl chloride	ND		1.0	0.90	ug/L			09/22/25 12:59	1

Surrogate	*MB %Recovery*	*MB Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*103*		*77 - 120*		*09/22/25 12:59*	*1*
4-Bromofluorobenzene (Surr)	*97*		*73 - 120*		*09/22/25 12:59*	*1*
Dibromofluoromethane (Surr)	*102*		*75 - 123*		*09/22/25 12:59*	*1*
Toluene-d8 (Surr)	*98*		*80 - 120*		*09/22/25 12:59*	*1*

Lab Sample ID: LCS 480-757616/6
Matrix: Water
Analysis Batch: 757616

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,1,1,2-Tetrachloroethane	25.0	24.0		ug/L		96	80 - 120
1,1,1-Trichloroethane	25.0	24.6		ug/L		98	73 - 126
1,1,2,2-Tetrachloroethane	25.0	23.7		ug/L		95	76 - 120
1,1,2-Trichloroethane	25.0	25.1		ug/L		100	76 - 122
1,1-Dichloroethane	25.0	23.8		ug/L		95	77 - 120
1,1-Dichloroethene	25.0	22.6		ug/L		90	66 - 127
1,1-Dichloropropene	25.0	26.5		ug/L		106	72 - 122
1,2,3-Trichlorobenzene	25.0	24.8		ug/L		99	75 - 123
1,2,3-Trichloropropane	25.0	23.8		ug/L		95	68 - 122
1,2,4-Trichlorobenzene	25.0	23.8		ug/L		95	79 - 122
1,2,4-Trimethylbenzene	25.0	23.7		ug/L		95	76 - 121
1,2-Dibromo-3-Chloropropane	25.0	21.7		ug/L		87	56 - 134
1,2-Dibromoethane	25.0	25.6		ug/L		102	77 - 120
1,2-Dichlorobenzene	25.0	23.7		ug/L		95	80 - 124
1,2-Dichloroethane	25.0	24.5		ug/L		98	75 - 120
1,2-Dichloropropane	25.0	25.6		ug/L		102	76 - 120
1,3,5-Trimethylbenzene	25.0	25.5		ug/L		102	77 - 121
1,3-Dichlorobenzene	25.0	25.4		ug/L		102	77 - 120

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: LCS 480-757616/6
Matrix: Water
Analysis Batch: 757616

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,3-Dichloropropane	25.0	25.2		ug/L		101	75 - 120
1,4-Dichlorobenzene	25.0	24.3		ug/L		97	80 - 120
2,2-Dichloropropane	25.0	23.9		ug/L		96	63 - 136
2-Butanone (MEK)	125	135		ug/L		108	57 - 140
2-Chloroethyl vinyl ether	25.0	31.0		ug/L		124	70 - 129
2-Hexanone	125	114		ug/L		91	65 - 127
4-Methyl-2-pentanone (MIBK)	125	109		ug/L		87	71 - 125
Acetone	125	120		ug/L		96	56 - 142
Benzene	25.0	25.6		ug/L		102	71 - 124
Bromobenzene	25.0	26.0		ug/L		104	78 - 120
Bromochloromethane	25.0	25.4		ug/L		102	72 - 130
Bromodichloromethane	25.0	26.7		ug/L		107	80 - 122
Bromoform	25.0	25.4		ug/L		102	61 - 132
Bromomethane	25.0	19.1		ug/L		76	55 - 144
Carbon disulfide	25.0	20.5		ug/L		82	59 - 134
Carbon tetrachloride	25.0	25.2		ug/L		101	72 - 134
Chlorobenzene	25.0	24.5		ug/L		98	80 - 120
Chlorodibromomethane	25.0	26.5		ug/L		106	75 - 125
Chloroethane	25.0	20.0		ug/L		80	69 - 136
Chloroform	25.0	23.0		ug/L		92	73 - 127
Chloromethane	25.0	19.6		ug/L		78	68 - 124
cis-1,2-Dichloroethene	25.0	24.6		ug/L		98	74 - 124
cis-1,3-Dichloropropene	25.0	28.5		ug/L		114	74 - 124
Dichlorodifluoromethane	25.0	18.7		ug/L		75	59 - 135
Ethylbenzene	25.0	23.9		ug/L		95	77 - 123
Hexachlorobutadiene	25.0	24.7		ug/L		99	68 - 131
Isopropylbenzene	25.0	25.5		ug/L		102	77 - 122
Methyl tert-butyl ether	25.0	22.4		ug/L		89	77 - 120
Methylene Chloride	25.0	24.0		ug/L		96	75 - 124
m-Xylene & p-Xylene	25.0	23.4		ug/L		94	76 - 122
Naphthalene	25.0	23.0		ug/L		92	66 - 125
n-Butylbenzene	25.0	24.2		ug/L		97	71 - 128
N-Propylbenzene	25.0	25.3		ug/L		101	75 - 127
o-Chlorotoluene	25.0	25.3		ug/L		101	76 - 121
o-Xylene	25.0	23.5		ug/L		94	76 - 122
p-Chlorotoluene	25.0	24.8		ug/L		99	77 - 121
p-Cymene	25.0	25.9		ug/L		103	73 - 120
sec-Butylbenzene	25.0	25.8		ug/L		103	74 - 127
Styrene	25.0	25.0		ug/L		100	80 - 120
tert-Butylbenzene	25.0	26.9		ug/L		108	75 - 123
Tetrachloroethene	25.0	24.8		ug/L		99	74 - 122
Toluene	25.0	24.1		ug/L		96	80 - 122
trans-1,2-Dichloroethene	25.0	23.3		ug/L		93	73 - 127
trans-1,3-Dichloropropene	25.0	27.1		ug/L		109	80 - 120
Trichloroethene	25.0	26.5		ug/L		106	74 - 123
Trichlorofluoromethane	25.0	22.3		ug/L		89	62 - 150
Vinyl acetate	50.0	58.5		ug/L		117	50 - 144
Vinyl chloride	25.0	21.3		ug/L		85	65 - 133

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: LCS 480-757616/6
Matrix: Water
Analysis Batch: 757616

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Surrogate	LCS %Recovery	LCS Qualifier	Limits
1,2-Dichloroethane-d4 (Surr)	*100*		*77 - 120*
4-Bromofluorobenzene (Surr)	*94*		*73 - 120*
Dibromofluoromethane (Surr)	*100*		*75 - 123*
Toluene-d8 (Surr)	*95*		*80 - 120*

Lab Sample ID: MB 480-757644/8
Matrix: Water
Analysis Batch: 757644

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			09/23/25 01:58	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			09/23/25 01:58	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			09/23/25 01:58	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			09/23/25 01:58	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			09/23/25 01:58	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			09/23/25 01:58	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			09/23/25 01:58	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			09/23/25 01:58	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			09/23/25 01:58	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			09/23/25 01:58	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			09/23/25 01:58	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			09/23/25 01:58	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			09/23/25 01:58	1
1,2-Dichlorobenzene	ND		1.0	0.79	ug/L			09/23/25 01:58	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			09/23/25 01:58	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			09/23/25 01:58	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			09/23/25 01:58	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			09/23/25 01:58	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			09/23/25 01:58	1
1,4-Dichlorobenzene	ND		1.0	0.84	ug/L			09/23/25 01:58	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			09/23/25 01:58	1
2-Butanone (MEK)	ND		10	1.3	ug/L			09/23/25 01:58	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			09/23/25 01:58	1
2-Hexanone	ND		5.0	1.2	ug/L			09/23/25 01:58	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			09/23/25 01:58	1
Acetone	ND		10	3.0	ug/L			09/23/25 01:58	1
Benzene	ND		1.0	0.41	ug/L			09/23/25 01:58	1
Bromobenzene	ND		1.0	0.80	ug/L			09/23/25 01:58	1
Bromochloromethane	ND		1.0	0.87	ug/L			09/23/25 01:58	1
Bromodichloromethane	ND		1.0	0.39	ug/L			09/23/25 01:58	1
Bromoform	ND		1.0	0.26	ug/L			09/23/25 01:58	1
Bromomethane	ND		1.0	0.69	ug/L			09/23/25 01:58	1
Carbon disulfide	ND		1.0	0.19	ug/L			09/23/25 01:58	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			09/23/25 01:58	1
Chlorobenzene	ND		1.0	0.75	ug/L			09/23/25 01:58	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			09/23/25 01:58	1
Chloroethane	ND		1.0	0.32	ug/L			09/23/25 01:58	1
Chloroform	ND		1.0	0.34	ug/L			09/23/25 01:58	1

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: MB 480-757644/8
Matrix: Water
Analysis Batch: 757644

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloromethane	ND		1.0	0.35	ug/L			09/23/25 01:58	1
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			09/23/25 01:58	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			09/23/25 01:58	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			09/23/25 01:58	1
Ethylbenzene	ND		1.0	0.74	ug/L			09/23/25 01:58	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			09/23/25 01:58	1
Isopropylbenzene	ND		1.0	0.79	ug/L			09/23/25 01:58	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			09/23/25 01:58	1
Methylene Chloride	ND		1.0	0.44	ug/L			09/23/25 01:58	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			09/23/25 01:58	1
Naphthalene	ND		1.0	0.43	ug/L			09/23/25 01:58	1
n-Butylbenzene	ND		1.0	0.64	ug/L			09/23/25 01:58	1
N-Propylbenzene	ND		1.0	0.69	ug/L			09/23/25 01:58	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			09/23/25 01:58	1
o-Xylene	ND		1.0	0.76	ug/L			09/23/25 01:58	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			09/23/25 01:58	1
p-Cymene	ND		1.0	0.31	ug/L			09/23/25 01:58	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			09/23/25 01:58	1
Styrene	ND		1.0	0.73	ug/L			09/23/25 01:58	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			09/23/25 01:58	1
Tetrachloroethene	ND		1.0	0.36	ug/L			09/23/25 01:58	1
Toluene	ND		1.0	0.51	ug/L			09/23/25 01:58	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			09/23/25 01:58	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			09/23/25 01:58	1
Trichloroethene	ND		1.0	0.46	ug/L			09/23/25 01:58	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			09/23/25 01:58	1
Vinyl acetate	ND		5.0	0.85	ug/L			09/23/25 01:58	1
Vinyl chloride	ND		1.0	0.90	ug/L			09/23/25 01:58	1

Surrogate	*MB %Recovery*	*MB Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*111*		*77 - 120*		*09/23/25 01:58*	*1*
4-Bromofluorobenzene (Surr)	*107*		*73 - 120*		*09/23/25 01:58*	*1*
Dibromofluoromethane (Surr)	*105*		*75 - 123*		*09/23/25 01:58*	*1*
Toluene-d8 (Surr)	*99*		*80 - 120*		*09/23/25 01:58*	*1*

Lab Sample ID: LCS 480-757644/6
Matrix: Water
Analysis Batch: 757644

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,1,1,2-Tetrachloroethane	25.0	24.4		ug/L		97	80 - 120
1,1,1-Trichloroethane	25.0	24.7		ug/L		99	73 - 126
1,1,2,2-Tetrachloroethane	25.0	23.5		ug/L		94	76 - 120
1,1,2-Trichloroethane	25.0	24.4		ug/L		98	76 - 122
1,1-Dichloroethane	25.0	23.4		ug/L		94	77 - 120
1,1-Dichloroethene	25.0	22.5		ug/L		90	66 - 127
1,1-Dichloropropene	25.0	24.7		ug/L		99	72 - 122
1,2,3-Trichlorobenzene	25.0	21.1		ug/L		84	75 - 123

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: LCS 480-757644/6
Matrix: Water
Analysis Batch: 757644

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,2,3-Trichloropropane	25.0	21.9		ug/L		88	68 - 122
1,2,4-Trichlorobenzene	25.0	21.8		ug/L		87	79 - 122
1,2,4-Trimethylbenzene	25.0	23.4		ug/L		94	76 - 121
1,2-Dibromo-3-Chloropropane	25.0	22.1		ug/L		88	56 - 134
1,2-Dibromoethane	25.0	24.0		ug/L		96	77 - 120
1,2-Dichlorobenzene	25.0	23.8		ug/L		95	80 - 124
1,2-Dichloroethane	25.0	24.9		ug/L		100	75 - 120
1,2-Dichloropropane	25.0	23.9		ug/L		96	76 - 120
1,3,5-Trimethylbenzene	25.0	23.2		ug/L		93	77 - 121
1,3-Dichlorobenzene	25.0	23.0		ug/L		92	77 - 120
1,3-Dichloropropane	25.0	24.3		ug/L		97	75 - 120
1,4-Dichlorobenzene	25.0	22.4		ug/L		90	80 - 120
2,2-Dichloropropane	25.0	21.0		ug/L		84	63 - 136
2-Butanone (MEK)	125	125		ug/L		100	57 - 140
2-Chloroethyl vinyl ether	25.0	22.8		ug/L		91	70 - 129
2-Hexanone	125	136		ug/L		109	65 - 127
4-Methyl-2-pentanone (MIBK)	125	126		ug/L		101	71 - 125
Acetone	125	129		ug/L		104	56 - 142
Benzene	25.0	22.9		ug/L		92	71 - 124
Bromobenzene	25.0	22.8		ug/L		91	78 - 120
Bromochloromethane	25.0	23.8		ug/L		95	72 - 130
Bromodichloromethane	25.0	25.7		ug/L		103	80 - 122
Bromoform	25.0	29.4		ug/L		118	61 - 132
Bromomethane	25.0	23.1		ug/L		92	55 - 144
Carbon disulfide	25.0	23.5		ug/L		94	59 - 134
Carbon tetrachloride	25.0	23.7		ug/L		95	72 - 134
Chlorobenzene	25.0	24.4		ug/L		98	80 - 120
Chlorodibromomethane	25.0	27.1		ug/L		109	75 - 125
Chloroethane	25.0	21.9		ug/L		88	69 - 136
Chloroform	25.0	24.9		ug/L		100	73 - 127
Chloromethane	25.0	20.4		ug/L		82	68 - 124
cis-1,2-Dichloroethene	25.0	23.5		ug/L		94	74 - 124
cis-1,3-Dichloropropene	25.0	21.5		ug/L		86	74 - 124
Dichlorodifluoromethane	25.0	16.9		ug/L		68	59 - 135
Ethylbenzene	25.0	24.4		ug/L		97	77 - 123
Hexachlorobutadiene	25.0	24.2		ug/L		97	68 - 131
Isopropylbenzene	25.0	23.4		ug/L		93	77 - 122
Methyl tert-butyl ether	25.0	23.2		ug/L		93	77 - 120
Methylene Chloride	25.0	24.7		ug/L		99	75 - 124
m-Xylene & p-Xylene	25.0	24.1		ug/L		96	76 - 122
Naphthalene	25.0	21.0		ug/L		84	66 - 125
n-Butylbenzene	25.0	23.7		ug/L		95	71 - 128
N-Propylbenzene	25.0	23.4		ug/L		94	75 - 127
o-Chlorotoluene	25.0	22.6		ug/L		90	76 - 121
o-Xylene	25.0	24.6		ug/L		98	76 - 122
p-Chlorotoluene	25.0	23.7		ug/L		95	77 - 121
p-Cymene	25.0	22.9		ug/L		92	73 - 120
sec-Butylbenzene	25.0	23.6		ug/L		94	74 - 127
Styrene	25.0	25.0		ug/L		100	80 - 120

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: LCS 480-757644/6
Matrix: Water
Analysis Batch: 757644

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte			Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits		
tert-Butylbenzene			25.0	22.7		ug/L		91	75 - 123		
Tetrachloroethene			25.0	24.7		ug/L		99	74 - 122		
Toluene			25.0	23.7		ug/L		95	80 - 122		
trans-1,2-Dichloroethene			25.0	24.0		ug/L		96	73 - 127		
trans-1,3-Dichloropropene			25.0	21.6		ug/L		86	80 - 120		
Trichloroethene			25.0	23.8		ug/L		95	74 - 123		
Trichlorofluoromethane			25.0	26.1		ug/L		105	62 - 150		
Vinyl acetate			50.0	41.6		ug/L		83	50 - 144		
Vinyl chloride			25.0	22.0		ug/L		88	65 - 133		

Surrogate	*LCS %Recovery*	*LCS Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*99*		*77 - 120*
4-Bromofluorobenzene (Surr)	*107*		*73 - 120*
Dibromofluoromethane (Surr)	*101*		*75 - 123*
Toluene-d8 (Surr)	*99*		*80 - 120*

Lab Sample ID: MB 480-757736/8
Matrix: Water
Analysis Batch: 757736

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			09/23/25 14:45	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			09/23/25 14:45	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			09/23/25 14:45	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			09/23/25 14:45	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			09/23/25 14:45	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			09/23/25 14:45	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			09/23/25 14:45	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			09/23/25 14:45	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			09/23/25 14:45	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			09/23/25 14:45	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			09/23/25 14:45	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			09/23/25 14:45	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			09/23/25 14:45	1
1,2-Dichlorobenzene	ND		1.0	0.79	ug/L			09/23/25 14:45	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			09/23/25 14:45	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			09/23/25 14:45	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			09/23/25 14:45	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			09/23/25 14:45	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			09/23/25 14:45	1
1,4-Dichlorobenzene	ND		1.0	0.84	ug/L			09/23/25 14:45	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			09/23/25 14:45	1
2-Butanone (MEK)	ND		10	1.3	ug/L			09/23/25 14:45	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			09/23/25 14:45	1
2-Hexanone	ND		5.0	1.2	ug/L			09/23/25 14:45	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			09/23/25 14:45	1
Acetone	ND		10	3.0	ug/L			09/23/25 14:45	1
Benzene	ND		1.0	0.41	ug/L			09/23/25 14:45	1

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: MB 480-757736/8
Matrix: Water
Analysis Batch: 757736

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Bromobenzene	ND		1.0	0.80	ug/L			09/23/25 14:45	1
Bromochloromethane	ND		1.0	0.87	ug/L			09/23/25 14:45	1
Bromodichloromethane	ND		1.0	0.39	ug/L			09/23/25 14:45	1
Bromoform	ND		1.0	0.26	ug/L			09/23/25 14:45	1
Bromomethane	ND		1.0	0.69	ug/L			09/23/25 14:45	1
Carbon disulfide	ND		1.0	0.19	ug/L			09/23/25 14:45	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			09/23/25 14:45	1
Chlorobenzene	ND		1.0	0.75	ug/L			09/23/25 14:45	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			09/23/25 14:45	1
Chloroethane	ND		1.0	0.32	ug/L			09/23/25 14:45	1
Chloroform	ND		1.0	0.34	ug/L			09/23/25 14:45	1
Chloromethane	ND		1.0	0.35	ug/L			09/23/25 14:45	1
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			09/23/25 14:45	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			09/23/25 14:45	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			09/23/25 14:45	1
Ethylbenzene	ND		1.0	0.74	ug/L			09/23/25 14:45	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			09/23/25 14:45	1
Isopropylbenzene	ND		1.0	0.79	ug/L			09/23/25 14:45	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			09/23/25 14:45	1
Methylene Chloride	ND		1.0	0.44	ug/L			09/23/25 14:45	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			09/23/25 14:45	1
Naphthalene	ND		1.0	0.43	ug/L			09/23/25 14:45	1
n-Butylbenzene	ND		1.0	0.64	ug/L			09/23/25 14:45	1
N-Propylbenzene	ND		1.0	0.69	ug/L			09/23/25 14:45	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			09/23/25 14:45	1
o-Xylene	ND		1.0	0.76	ug/L			09/23/25 14:45	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			09/23/25 14:45	1
p-Cymene	ND		1.0	0.31	ug/L			09/23/25 14:45	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			09/23/25 14:45	1
Styrene	ND		1.0	0.73	ug/L			09/23/25 14:45	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			09/23/25 14:45	1
Tetrachloroethene	ND		1.0	0.36	ug/L			09/23/25 14:45	1
Toluene	ND		1.0	0.51	ug/L			09/23/25 14:45	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			09/23/25 14:45	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			09/23/25 14:45	1
Trichloroethene	ND		1.0	0.46	ug/L			09/23/25 14:45	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			09/23/25 14:45	1
Vinyl acetate	ND		5.0	0.85	ug/L			09/23/25 14:45	1
Vinyl chloride	ND		1.0	0.90	ug/L			09/23/25 14:45	1

Surrogate	*MB %Recovery*	*MB Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*112*		*77 - 120*		*09/23/25 14:45*	*1*
4-Bromofluorobenzene (Surr)	*111*		*73 - 120*		*09/23/25 14:45*	*1*
Dibromofluoromethane (Surr)	*109*		*75 - 123*		*09/23/25 14:45*	*1*
Toluene-d8 (Surr)	*100*		*80 - 120*		*09/23/25 14:45*	*1*

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: LCS 480-757736/6
Matrix: Water
Analysis Batch: 757736

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,1,1,2-Tetrachloroethane	25.0	22.0		ug/L		88	80 - 120
1,1,1-Trichloroethane	25.0	23.7		ug/L		95	73 - 126
1,1,2,2-Tetrachloroethane	25.0	20.9		ug/L		84	76 - 120
1,1,2-Trichloroethane	25.0	22.5		ug/L		90	76 - 122
1,1-Dichloroethane	25.0	22.7		ug/L		91	77 - 120
1,1-Dichloroethene	25.0	21.7		ug/L		87	66 - 127
1,1-Dichloropropene	25.0	23.5		ug/L		94	72 - 122
1,2,3-Trichlorobenzene	25.0	19.2		ug/L		77	75 - 123
1,2,3-Trichloropropane	25.0	19.7		ug/L		79	68 - 122
1,2,4-Trichlorobenzene	25.0	19.8		ug/L		79	79 - 122
1,2,4-Trimethylbenzene	25.0	20.9		ug/L		84	76 - 121
1,2-Dibromo-3-Chloropropane	25.0	18.7		ug/L		75	56 - 134
1,2-Dibromoethane	25.0	20.8		ug/L		83	77 - 120
1,2-Dichlorobenzene	25.0	21.2		ug/L		85	80 - 124
1,2-Dichloroethane	25.0	23.8		ug/L		95	75 - 120
1,2-Dichloropropane	25.0	21.2		ug/L		85	76 - 120
1,3,5-Trimethylbenzene	25.0	20.9		ug/L		84	77 - 121
1,3-Dichlorobenzene	25.0	20.5		ug/L		82	77 - 120
1,3-Dichloropropane	25.0	21.7		ug/L		87	75 - 120
1,4-Dichlorobenzene	25.0	20.4		ug/L		82	80 - 120
2,2-Dichloropropane	25.0	23.0		ug/L		92	63 - 136
2-Butanone (MEK)	125	110		ug/L		88	57 - 140
2-Chloroethyl vinyl ether	25.0	20.6		ug/L		82	70 - 129
2-Hexanone	125	113		ug/L		91	65 - 127
4-Methyl-2-pentanone (MIBK)	125	105		ug/L		84	71 - 125
Acetone	125	117		ug/L		94	56 - 142
Benzene	25.0	21.9		ug/L		88	71 - 124
Bromobenzene	25.0	20.4		ug/L		82	78 - 120
Bromochloromethane	25.0	22.1		ug/L		88	72 - 130
Bromodichloromethane	25.0	24.2		ug/L		97	80 - 122
Bromoform	25.0	27.0		ug/L		108	61 - 132
Bromomethane	25.0	24.1		ug/L		97	55 - 144
Carbon disulfide	25.0	22.3		ug/L		89	59 - 134
Carbon tetrachloride	25.0	24.2		ug/L		97	72 - 134
Chlorobenzene	25.0	21.3		ug/L		85	80 - 120
Chlorodibromomethane	25.0	24.5		ug/L		98	75 - 125
Chloroethane	25.0	23.5		ug/L		94	69 - 136
Chloroform	25.0	23.4		ug/L		94	73 - 127
Chloromethane	25.0	20.6		ug/L		82	68 - 124
cis-1,2-Dichloroethene	25.0	22.7		ug/L		91	74 - 124
cis-1,3-Dichloropropene	25.0	20.4		ug/L		82	74 - 124
Dichlorodifluoromethane	25.0	16.1		ug/L		65	59 - 135
Ethylbenzene	25.0	21.7		ug/L		87	77 - 123
Hexachlorobutadiene	25.0	23.1		ug/L		92	68 - 131
Isopropylbenzene	25.0	20.9		ug/L		84	77 - 122
Methyl tert-butyl ether	25.0	21.7		ug/L		87	77 - 120
Methylene Chloride	25.0	23.2		ug/L		93	75 - 124
m-Xylene & p-Xylene	25.0	20.5		ug/L		82	76 - 122

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: LCS 480-757736/6
Matrix: Water
Analysis Batch: 757736

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Naphthalene	25.0	17.9		ug/L		72	66 - 125
n-Butylbenzene	25.0	21.6		ug/L		86	71 - 128
N-Propylbenzene	25.0	21.1		ug/L		85	75 - 127
o-Chlorotoluene	25.0	20.8		ug/L		83	76 - 121
o-Xylene	25.0	22.0		ug/L		88	76 - 122
p-Chlorotoluene	25.0	21.2		ug/L		85	77 - 121
p-Cymene	25.0	21.1		ug/L		84	73 - 120
sec-Butylbenzene	25.0	21.6		ug/L		86	74 - 127
Styrene	25.0	21.4		ug/L		86	80 - 120
tert-Butylbenzene	25.0	21.2		ug/L		85	75 - 123
Tetrachloroethene	25.0	21.9		ug/L		88	74 - 122
Toluene	25.0	21.6		ug/L		86	80 - 122
trans-1,2-Dichloroethene	25.0	22.4		ug/L		90	73 - 127
trans-1,3-Dichloropropene	25.0	20.2		ug/L		81	80 - 120
Trichloroethene	25.0	22.8		ug/L		91	74 - 123
Trichlorofluoromethane	25.0	27.6		ug/L		110	62 - 150
Vinyl acetate	50.0	42.2		ug/L		84	50 - 144
Vinyl chloride	25.0	21.4		ug/L		86	65 - 133

Surrogate	*LCS %Recovery*	*LCS Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*109*		*77 - 120*
4-Bromofluorobenzene (Surr)	*104*		*73 - 120*
Dibromofluoromethane (Surr)	*108*		*75 - 123*
Toluene-d8 (Surr)	*97*		*80 - 120*

Lab Sample ID: 480-232730-37 MS
Matrix: Water
Analysis Batch: 757736

Client Sample ID: OW-22B
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
1,1,1,2-Tetrachloroethane	ND		10000	10800		ug/L		108	80 - 120
1,1,1-Trichloroethane	ND		10000	11500		ug/L		115	73 - 126
1,1,2,2-Tetrachloroethane	730		10000	10700		ug/L		100	76 - 120
1,1,2-Trichloroethane	ND		10000	10100		ug/L		101	76 - 122
1,1-Dichloroethane	ND		10000	10900		ug/L		109	77 - 120
1,1-Dichloroethene	ND		10000	11600		ug/L		116	66 - 127
1,1-Dichloropropene	ND		10000	11600		ug/L		116	72 - 122
1,2,3-Trichlorobenzene	ND		10000	9650		ug/L		97	75 - 123
1,2,3-Trichloropropane	ND		10000	9220		ug/L		92	68 - 122
1,2,4-Trichlorobenzene	200	J	10000	10200		ug/L		100	79 - 122
1,2,4-Trimethylbenzene	ND		10000	10300		ug/L		103	76 - 121
1,2-Dibromo-3-Chloropropane	ND		10000	9480		ug/L		95	56 - 134
1,2-Dibromoethane	ND		10000	10100		ug/L		101	77 - 120
1,2-Dichlorobenzene	ND		10000	10500		ug/L		105	80 - 124
1,2-Dichloroethane	ND		10000	11400		ug/L		114	75 - 120
1,2-Dichloropropane	ND		10000	10400		ug/L		104	76 - 120
1,3,5-Trimethylbenzene	ND		10000	10400		ug/L		104	77 - 121
1,3-Dichlorobenzene	ND		10000	10300		ug/L		103	77 - 120

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: 480-232730-37 MS
Matrix: Water
Analysis Batch: 757736

Client Sample ID: OW-22B
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
1,3-Dichloropropane	ND		10000	10400		ug/L		104	75 - 120
1,4-Dichlorobenzene	ND		10000	10300		ug/L		103	78 - 124
2,2-Dichloropropane	ND		10000	9350		ug/L		93	63 - 136
2-Butanone (MEK)	ND		50000	55800		ug/L		112	57 - 140
2-Chloroethyl vinyl ether	ND		10000	10500		ug/L		105	70 - 129
2-Hexanone	ND		50000	56400		ug/L		113	65 - 127
4-Methyl-2-pentanone (MIBK)	ND		50000	51800		ug/L		104	71 - 125
Acetone	ND		50000	59300		ug/L		119	56 - 142
Benzene	170	J	10000	11000		ug/L		108	71 - 124
Bromobenzene	ND		10000	9770		ug/L		98	78 - 120
Bromochloromethane	ND		10000	10900		ug/L		109	72 - 130
Bromodichloromethane	ND		10000	12000		ug/L		120	80 - 122
Bromoform	ND		10000	13200		ug/L		132	61 - 132
Bromomethane	ND		10000	9980		ug/L		100	55 - 144
Carbon disulfide	ND		10000	11000		ug/L		110	59 - 134
Carbon tetrachloride	ND		10000	11600		ug/L		116	72 - 134
Chlorobenzene	340	J	10000	10600		ug/L		102	80 - 120
Chlorodibromomethane	ND		10000	11600		ug/L		116	75 - 125
Chloroethane	ND		10000	9890		ug/L		99	69 - 136
Chloroform	200	J	10000	11300		ug/L		111	73 - 127
Chloromethane	ND		10000	8690		ug/L		87	68 - 124
cis-1,2-Dichloroethene	5600		10000	15200		ug/L		96	74 - 124
cis-1,3-Dichloropropene	ND		10000	9880		ug/L		99	74 - 124
Dichlorodifluoromethane	ND		10000	6650		ug/L		67	59 - 135
Ethylbenzene	ND		10000	10600		ug/L		106	77 - 123
Hexachlorobutadiene	ND		10000	10700		ug/L		107	68 - 131
Isopropylbenzene	ND		10000	10200		ug/L		102	77 - 122
Methyl tert-butyl ether	ND		10000	9930		ug/L		99	77 - 120
Methylene Chloride	ND	F2	10000	9190		ug/L		92	75 - 124
m-Xylene & p-Xylene	ND		10000	10400		ug/L		104	76 - 122
Naphthalene	ND		10000	9040		ug/L		90	66 - 125
n-Butylbenzene	ND		10000	10900		ug/L		109	71 - 128
N-Propylbenzene	ND		10000	10500		ug/L		105	75 - 127
o-Chlorotoluene	ND		10000	10500		ug/L		105	76 - 121
o-Xylene	ND		10000	10600		ug/L		106	76 - 122
p-Chlorotoluene	ND		10000	10300		ug/L		103	77 - 121
p-Cymene	ND		10000	10500		ug/L		105	73 - 120
sec-Butylbenzene	ND		10000	10800		ug/L		108	74 - 127
Styrene	ND		10000	10500		ug/L		105	80 - 120
tert-Butylbenzene	ND		10000	10100		ug/L		101	75 - 123
Tetrachloroethene	6400		10000	15700		ug/L		93	74 - 122
Toluene	ND		10000	10600		ug/L		106	80 - 122
trans-1,2-Dichloroethene	ND		10000	11200		ug/L		112	73 - 127
trans-1,3-Dichloropropene	ND		10000	9450		ug/L		95	80 - 120
Trichloroethene	17000	F1	10000	24600		ug/L		77	74 - 123
Trichlorofluoromethane	ND		10000	12000		ug/L		120	62 - 150
Vinyl acetate	ND		20000	18800		ug/L		94	50 - 144
Vinyl chloride	550		10000	9520		ug/L		90	65 - 133

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: 480-232730-37 MS
Matrix: Water
Analysis Batch: 757736

Client Sample ID: OW-22B
Prep Type: Total/NA

Surrogate	MS %Recovery	MS Qualifier	Limits
1,2-Dichloroethane-d4 (Surr)	*108*		*77 - 120*
4-Bromofluorobenzene (Surr)	*108*		*73 - 120*
Dibromofluoromethane (Surr)	*107*		*75 - 123*
Toluene-d8 (Surr)	*95*		*80 - 120*

Lab Sample ID: 480-232730-37 MSD
Matrix: Water
Analysis Batch: 757736

Client Sample ID: OW-22B
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
1,1,1,2-Tetrachloroethane	ND		10000	10800		ug/L		108	80 - 120	1	20
1,1,1-Trichloroethane	ND		10000	11000		ug/L		110	73 - 126	4	15
1,1,2,2-Tetrachloroethane	730		10000	10500		ug/L		97	76 - 120	2	15
1,1,2-Trichloroethane	ND		10000	10200		ug/L		102	76 - 122	1	15
1,1-Dichloroethane	ND		10000	10100		ug/L		101	77 - 120	7	20
1,1-Dichloroethene	ND		10000	10100		ug/L		101	66 - 127	13	16
1,1-Dichloropropene	ND		10000	10700		ug/L		107	72 - 122	8	20
1,2,3-Trichlorobenzene	ND		10000	9350		ug/L		93	75 - 123	3	20
1,2,3-Trichloropropane	ND		10000	9240		ug/L		92	68 - 122	0	14
1,2,4-Trichlorobenzene	200	J	10000	10100		ug/L		99	79 - 122	2	20
1,2,4-Trimethylbenzene	ND		10000	9640		ug/L		96	76 - 121	7	20
1,2-Dibromo-3-Chloropropane	ND		10000	9320		ug/L		93	56 - 134	2	15
1,2-Dibromoethane	ND		10000	10400		ug/L		104	77 - 120	3	15
1,2-Dichlorobenzene	ND		10000	10100		ug/L		101	80 - 124	4	20
1,2-Dichloroethane	ND		10000	10800		ug/L		108	75 - 120	5	20
1,2-Dichloropropane	ND		10000	9910		ug/L		99	76 - 120	5	20
1,3,5-Trimethylbenzene	ND		10000	9980		ug/L		100	77 - 121	5	20
1,3-Dichlorobenzene	ND		10000	10100		ug/L		101	77 - 120	2	20
1,3-Dichloropropane	ND		10000	10200		ug/L		102	75 - 120	2	20
1,4-Dichlorobenzene	ND		10000	9880		ug/L		99	78 - 124	4	20
2,2-Dichloropropane	ND		10000	9720		ug/L		97	63 - 136	4	20
2-Butanone (MEK)	ND		50000	52400		ug/L		105	57 - 140	6	20
2-Chloroethyl vinyl ether	ND		10000	9390		ug/L		94	70 - 129	11	20
2-Hexanone	ND		50000	54700		ug/L		109	65 - 127	3	15
4-Methyl-2-pentanone (MIBK)	ND		50000	52100		ug/L		104	71 - 125	0	35
Acetone	ND		50000	57300		ug/L		115	56 - 142	4	15
Benzene	170	J	10000	10400		ug/L		103	71 - 124	5	13
Bromobenzene	ND		10000	9630		ug/L		96	78 - 120	1	15
Bromochloromethane	ND		10000	10500		ug/L		105	72 - 130	4	15
Bromodichloromethane	ND		10000	11400		ug/L		114	80 - 122	5	15
Bromoform	ND		10000	13100		ug/L		131	61 - 132	1	15
Bromomethane	ND		10000	9450		ug/L		95	55 - 144	5	15
Carbon disulfide	ND		10000	10600		ug/L		106	59 - 134	4	15
Carbon tetrachloride	ND		10000	11300		ug/L		113	72 - 134	2	15
Chlorobenzene	340	J	10000	10400		ug/L		101	80 - 120	1	25
Chlorodibromomethane	ND		10000	12300		ug/L		123	75 - 125	6	15
Chloroethane	ND		10000	9260		ug/L		93	69 - 136	7	15
Chloroform	200	J	10000	10800		ug/L		106	73 - 127	4	20

Method: 8260C - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: 480-232730-37 MSD
Matrix: Water
Analysis Batch: 757736

Client Sample ID: OW-22B
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
Chloromethane	ND		10000	8170		ug/L		82	68 - 124	6	15
cis-1,2-Dichloroethene	5600		10000	14200		ug/L		86	74 - 124	6	15
cis-1,3-Dichloropropene	ND		10000	9340		ug/L		93	74 - 124	6	15
Dichlorodifluoromethane	ND		10000	6430		ug/L		64	59 - 135	3	20
Ethylbenzene	ND		10000	10400		ug/L		104	77 - 123	1	15
Hexachlorobutadiene	ND		10000	10900		ug/L		109	68 - 131	2	20
Isopropylbenzene	ND		10000	9790		ug/L		98	77 - 122	4	20
Methyl tert-butyl ether	ND		10000	9760		ug/L		98	77 - 120	2	37
Methylene Chloride	ND	F2	10000	10800	F2	ug/L		108	75 - 124	16	15
m-Xylene & p-Xylene	ND		10000	10400		ug/L		104	76 - 122	0	16
Naphthalene	ND		10000	9210		ug/L		92	66 - 125	2	20
n-Butylbenzene	ND		10000	10200		ug/L		102	71 - 128	6	15
N-Propylbenzene	ND		10000	9940		ug/L		99	75 - 127	5	15
o-Chlorotoluene	ND		10000	9550		ug/L		96	76 - 121	9	20
o-Xylene	ND		10000	10200		ug/L		102	76 - 122	5	16
p-Chlorotoluene	ND		10000	9900		ug/L		99	77 - 121	4	15
p-Cymene	ND		10000	9930		ug/L		99	73 - 120	5	20
sec-Butylbenzene	ND		10000	10300		ug/L		103	74 - 127	5	15
Styrene	ND		10000	10600		ug/L		106	80 - 120	1	20
tert-Butylbenzene	ND		10000	9950		ug/L		99	75 - 123	2	15
Tetrachloroethene	6400		10000	15500		ug/L		91	74 - 122	1	20
Toluene	ND		10000	10000		ug/L		100	80 - 122	5	15
trans-1,2-Dichloroethene	ND		10000	10500		ug/L		105	73 - 127	6	20
trans-1,3-Dichloropropene	ND		10000	9200		ug/L		92	80 - 120	3	15
Trichloroethene	17000	F1	10000	22400	F1	ug/L		54	74 - 123	9	16
Trichlorofluoromethane	ND		10000	11500		ug/L		115	62 - 150	4	20
Vinyl acetate	ND		20000	18000		ug/L		90	50 - 144	4	23
Vinyl chloride	550		10000	9040		ug/L		85	65 - 133	5	15

Surrogate	*MSD %Recovery*	*MSD Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*106*		*77 - 120*
4-Bromofluorobenzene (Surr)	*105*		*73 - 120*
Dibromofluoromethane (Surr)	*102*		*75 - 123*
Toluene-d8 (Surr)	*97*		*80 - 120*

QC Association Summary

Client: TRC Environmental Corporation
Job ID: 480-232730-1
Project/Site: Solvent Chemical Semi-annual Monitoring

GC/MS VOA

Analysis Batch: 757403

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-232730-19	OW-105B	Total/NA	Water	8260C	
480-232730-21	OW-7B	Total/NA	Water	8260C	
480-232730-22	OW-8B	Total/NA	Water	8260C	
480-232730-23	MW-1B	Total/NA	Water	8260C	
480-232730-24	MW-1C	Total/NA	Water	8260C	
480-232730-25	MW-1CD	Total/NA	Water	8260C	
480-232730-26	MW-1F	Total/NA	Water	8260C	
480-232730-27	OW-12A	Total/NA	Water	8260C	
MB 480-757403/9	Method Blank	Total/NA	Water	8260C	
LCS 480-757403/6	Lab Control Sample	Total/NA	Water	8260C	

Analysis Batch: 757404

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-232730-1	OW-26B	Total/NA	Water	8260C	
480-232730-2	OW-30B	Total/NA	Water	8260C	
480-232730-3	MW-5A	Total/NA	Water	8260C	
480-232730-5	MW-5CD	Total/NA	Water	8260C	
480-232730-6	MW-5F	Total/NA	Water	8260C	
480-232730-7	OW-12B	Total/NA	Water	8260C	
480-232730-8	OW-9A	Total/NA	Water	8260C	
480-232730-10	OW-16A	Total/NA	Water	8260C	
480-232730-11	OW-13B	Total/NA	Water	8260C	
480-232730-12	OW-113B	Total/NA	Water	8260C	
480-232730-13	OW-29B	Total/NA	Water	8260C	
480-232730-14	OW-15A	Total/NA	Water	8260C	
480-232730-15	OW-28B	Total/NA	Water	8260C	
480-232730-16	MW-4B	Total/NA	Water	8260C	
480-232730-17	MW-4C	Total/NA	Water	8260C	
480-232730-18	OW-5B	Total/NA	Water	8260C	
MB 480-757404/8	Method Blank	Total/NA	Water	8260C	
LCS 480-757404/6	Lab Control Sample	Total/NA	Water	8260C	
480-232730-17 MS	MW-4C	Total/NA	Water	8260C	
480-232730-17 MSD	MW-4C	Total/NA	Water	8260C	

Analysis Batch: 757615

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-232730-21 - DL	OW-7B	Total/NA	Water	8260C	
480-232730-22 - DL	OW-8B	Total/NA	Water	8260C	
480-232730-28	OW-10B	Total/NA	Water	8260C	
480-232730-29	MW-2A	Total/NA	Water	8260C	
480-232730-30	OW-18A	Total/NA	Water	8260C	
MB 480-757615/9	Method Blank	Total/NA	Water	8260C	
LCS 480-757615/6	Lab Control Sample	Total/NA	Water	8260C	
480-232730-30 MS	OW-18A	Total/NA	Water	8260C	
480-232730-30 MSD	OW-18A	Total/NA	Water	8260C	

Analysis Batch: 757616

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-232730-2 - DL	OW-30B	Total/NA	Water	8260C	
480-232730-4	MW-5C	Total/NA	Water	8260C	
480-232730-7 - DL	OW-12B	Total/NA	Water	8260C	

GC/MS VOA (Continued)

Analysis Batch: 757616 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-232730-8 - DL	OW-9A	Total/NA	Water	8260C	
480-232730-9	OW-27B	Total/NA	Water	8260C	
MB 480-757616/8	Method Blank	Total/NA	Water	8260C	
LCS 480-757616/6	Lab Control Sample	Total/NA	Water	8260C	

Analysis Batch: 757644

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-232730-20	OW-6B	Total/NA	Water	8260C	
480-232730-31	OW-11B	Total/NA	Water	8260C	
480-232730-33	MW-6B	Total/NA	Water	8260C	
480-232730-34	MW-6F	Total/NA	Water	8260C	
480-232730-36	OW-22A	Total/NA	Water	8260C	
480-232730-39	TB-01 (Trip Blank)	Total/NA	Water	8260C	
480-232730-40	TB-02 (Trip Blank)	Total/NA	Water	8260C	
MB 480-757644/8	Method Blank	Total/NA	Water	8260C	
LCS 480-757644/6	Lab Control Sample	Total/NA	Water	8260C	

Analysis Batch: 757736

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-232730-32	OW-111B	Total/NA	Water	8260C	
480-232730-35	OW-14B	Total/NA	Water	8260C	
480-232730-37	OW-22B	Total/NA	Water	8260C	
480-232730-38	OW-15B	Total/NA	Water	8260C	
MB 480-757736/8	Method Blank	Total/NA	Water	8260C	
LCS 480-757736/6	Lab Control Sample	Total/NA	Water	8260C	
480-232730-37 MS	OW-22B	Total/NA	Water	8260C	
480-232730-37 MSD	OW-22B	Total/NA	Water	8260C	

Lab Chronicle

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-26B
Date Collected: 09/16/25 08:50
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-1
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		2	757404	AXK	EET BUF	09/19/25 14:18

Client Sample ID: OW-30B
Date Collected: 09/16/25 09:30
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-2
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		1	757404	AXK	EET BUF	09/19/25 14:40
Total/NA	Analysis	8260C	DL	20	757616	AXK	EET BUF	09/22/25 16:29

Client Sample ID: MW-5A
Date Collected: 09/16/25 10:15
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-3
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		1	757404	AXK	EET BUF	09/19/25 15:05

Client Sample ID: MW-5C
Date Collected: 09/16/25 10:00
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-4
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		50	757616	AXK	EET BUF	09/22/25 16:51

Client Sample ID: MW-5CD
Date Collected: 09/16/25 10:30
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-5
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		10	757404	AXK	EET BUF	09/19/25 15:50

Client Sample ID: MW-5F
Date Collected: 09/16/25 10:40
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-6
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		80	757404	AXK	EET BUF	09/19/25 16:12

Client Sample ID: OW-12B
Date Collected: 09/16/25 11:10
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-7
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		10	757404	AXK	EET BUF	09/19/25 16:34
Total/NA	Analysis	8260C	DL	40	757616	AXK	EET BUF	09/22/25 17:13

Lab Chronicle

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-9A
Lab Sample ID: 480-232730-8
Date Collected: 09/16/25 11:20
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		50	757404	AXK	EET BUF	09/19/25 16:57
Total/NA	Analysis	8260C	DL	125	757616	AXK	EET BUF	09/22/25 17:35

Client Sample ID: OW-27B
Lab Sample ID: 480-232730-9
Date Collected: 09/16/25 11:35
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		20	757616	AXK	EET BUF	09/22/25 17:58

Client Sample ID: OW-16A
Lab Sample ID: 480-232730-10
Date Collected: 09/16/25 11:45
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		1	757404	AXK	EET BUF	09/19/25 17:41

Client Sample ID: OW-13B
Lab Sample ID: 480-232730-11
Date Collected: 09/16/25 11:55
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		200	757404	AXK	EET BUF	09/19/25 18:03

Client Sample ID: OW-113B
Lab Sample ID: 480-232730-12
Date Collected: 09/16/25 12:55
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		200	757404	AXK	EET BUF	09/19/25 18:25

Client Sample ID: OW-29B
Lab Sample ID: 480-232730-13
Date Collected: 09/16/25 13:10
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		100	757404	AXK	EET BUF	09/19/25 18:48

Client Sample ID: OW-15A
Lab Sample ID: 480-232730-14
Date Collected: 09/16/25 13:20
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		10	757404	AXK	EET BUF	09/19/25 19:10

Lab Chronicle

Client: TRC Environmental Corporation
Job ID: 480-232730-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-28B
Lab Sample ID: 480-232730-15
Date Collected: 09/16/25 13:30
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		100	757404	AXK	EET BUF	09/19/25 19:32

Client Sample ID: MW-4B
Lab Sample ID: 480-232730-16
Date Collected: 09/16/25 14:15
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		200	757404	AXK	EET BUF	09/19/25 19:54

Client Sample ID: MW-4C
Lab Sample ID: 480-232730-17
Date Collected: 09/16/25 13:45
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		400	757404	AXK	EET BUF	09/19/25 20:17

Client Sample ID: OW-5B
Lab Sample ID: 480-232730-18
Date Collected: 09/17/25 14:15
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		400	757404	AXK	EET BUF	09/19/25 20:39

Client Sample ID: OW-105B
Lab Sample ID: 480-232730-19
Date Collected: 09/17/25 15:15
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		100	757403	LCH	EET BUF	09/19/25 18:08

Client Sample ID: OW-6B
Lab Sample ID: 480-232730-20
Date Collected: 09/17/25 14:30
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		200	757644	ATG	EET BUF	09/23/25 02:21

Client Sample ID: OW-7B
Lab Sample ID: 480-232730-21
Date Collected: 09/17/25 14:45
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		1	757403	LCH	EET BUF	09/19/25 18:32
Total/NA	Analysis	8260C	DL	4	757615	ATG	EET BUF	09/22/25 20:35

Lab Chronicle

Client: TRC Environmental Corporation
Project/Site: Solvent Chemical Semi-annual Monitoring

Job ID: 480-232730-1

Client Sample ID: OW-8B
Date Collected: 09/17/25 14:55
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-22
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		1	757403	LCH	EET BUF	09/19/25 18:55
Total/NA	Analysis	8260C	DL	10	757615	ATG	EET BUF	09/22/25 20:58

Client Sample ID: MW-1B
Date Collected: 09/17/25 15:20
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-23
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		400	757403	LCH	EET BUF	09/19/25 19:18

Client Sample ID: MW-1C
Date Collected: 09/17/25 15:30
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-24
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		50	757403	LCH	EET BUF	09/19/25 19:42

Client Sample ID: MW-1CD
Date Collected: 09/17/25 15:45
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-25
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		800	757403	LCH	EET BUF	09/19/25 20:05

Client Sample ID: MW-1F
Date Collected: 09/17/25 08:45
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-26
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		5	757403	LCH	EET BUF	09/19/25 20:28

Client Sample ID: OW-12A
Date Collected: 09/18/25 08:10
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-27
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		100	757403	LCH	EET BUF	09/19/25 20:51

Client Sample ID: OW-10B
Date Collected: 09/18/25 08:20
Date Received: 09/18/25 14:55

Lab Sample ID: 480-232730-28
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		800	757615	ATG	EET BUF	09/22/25 21:21

Lab Chronicle

Client: TRC Environmental Corporation
Job ID: 480-232730-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: MW-2A
Lab Sample ID: 480-232730-29
Date Collected: 09/18/25 08:30
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		200	757615	ATG	EET BUF	09/22/25 21:44

Client Sample ID: OW-18A
Lab Sample ID: 480-232730-30
Date Collected: 09/18/25 09:00
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		500	757615	ATG	EET BUF	09/22/25 22:07

Client Sample ID: OW-11B
Lab Sample ID: 480-232730-31
Date Collected: 09/18/25 09:30
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		400	757644	ATG	EET BUF	09/23/25 02:44

Client Sample ID: OW-111B
Lab Sample ID: 480-232730-32
Date Collected: 09/18/25 10:30
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		200	757736	ATG	EET BUF	09/23/25 20:22

Client Sample ID: MW-6B
Lab Sample ID: 480-232730-33
Date Collected: 09/18/25 08:40
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		100	757644	ATG	EET BUF	09/23/25 03:30

Client Sample ID: MW-6F
Lab Sample ID: 480-232730-34
Date Collected: 09/17/25 09:05
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		50	757644	ATG	EET BUF	09/23/25 03:54

Client Sample ID: OW-14B
Lab Sample ID: 480-232730-35
Date Collected: 09/17/25 11:15
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		200	757736	ATG	EET BUF	09/23/25 20:45

Lab Chronicle

Client: TRC Environmental Corporation
Job ID: 480-232730-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-22A
Lab Sample ID: 480-232730-36
Date Collected: 09/17/25 13:00
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		1	757644	ATG	EET BUF	09/23/25 04:40

Client Sample ID: OW-22B
Lab Sample ID: 480-232730-37
Date Collected: 09/17/25 13:05
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		400	757736	ATG	EET BUF	09/23/25 21:08

Client Sample ID: OW-15B
Lab Sample ID: 480-232730-38
Date Collected: 09/17/25 11:50
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		200	757736	ATG	EET BUF	09/23/25 21:32

Client Sample ID: TB-01 (Trip Blank)
Lab Sample ID: 480-232730-39
Date Collected: 09/16/25 07:00
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		1	757644	ATG	EET BUF	09/23/25 05:49

Client Sample ID: TB-02 (Trip Blank)
Lab Sample ID: 480-232730-40
Date Collected: 09/17/25 12:00
Matrix: Water
Date Received: 09/18/25 14:55

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	8260C		1	757644	ATG	EET BUF	09/23/25 06:12

Laboratory References:

EET BUF = Eurofins Buffalo, 10 Hazelwood Drive, Amherst, NY 14228-2298, TEL (716)691-2600

Accreditation/Certification Summary

Client: TRC Environmental Corporation
Job ID: 480-232730-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Laboratory: Eurofins Buffalo

The accreditations/certifications listed below are applicable to this report.

Authority	Program	Identification Number	Expiration Date
New York	NELAP	10026	03-31-26

Method Summary

Client: TRC Environmental Corporation
Job ID: 480-232730-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Method	Method Description	Protocol	Laboratory
8260C	Volatile Organic Compounds by GC/MS	SW846	EET BUF
5030C	Purge and Trap	SW846	EET BUF

Protocol References:

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

Laboratory References:

EET BUF = Eurofins Buffalo, 10 Hazelwood Drive, Amherst, NY 14228-2298, TEL (716)691-2600

Sample Summary

Client: TRC Environmental Corporation
Job ID: 480-232730-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Lab Sample ID	Client Sample ID	Matrix	Collected	Received	Sample Origin
480-232730-1	OW-26B	Water	09/16/25 08:50	09/18/25 14:55	New York
480-232730-2	OW-30B	Water	09/16/25 09:30	09/18/25 14:55	New York
480-232730-3	MW-5A	Water	09/16/25 10:15	09/18/25 14:55	New York
480-232730-4	MW-5C	Water	09/16/25 10:00	09/18/25 14:55	New York
480-232730-5	MW-5CD	Water	09/16/25 10:30	09/18/25 14:55	New York
480-232730-6	MW-5F	Water	09/16/25 10:40	09/18/25 14:55	New York
480-232730-7	OW-12B	Water	09/16/25 11:10	09/18/25 14:55	New York
480-232730-8	OW-9A	Water	09/16/25 11:20	09/18/25 14:55	New York
480-232730-9	OW-27B	Water	09/16/25 11:35	09/18/25 14:55	New York
480-232730-10	OW-16A	Water	09/16/25 11:45	09/18/25 14:55	New York
480-232730-11	OW-13B	Water	09/16/25 11:55	09/18/25 14:55	New York
480-232730-12	OW-113B	Water	09/16/25 12:55	09/18/25 14:55	New York
480-232730-13	OW-29B	Water	09/16/25 13:10	09/18/25 14:55	New York
480-232730-14	OW-15A	Water	09/16/25 13:20	09/18/25 14:55	New York
480-232730-15	OW-28B	Water	09/16/25 13:30	09/18/25 14:55	New York
480-232730-16	MW-4B	Water	09/16/25 14:15	09/18/25 14:55	New York
480-232730-17	MW-4C	Water	09/16/25 13:45	09/18/25 14:55	New York
480-232730-18	OW-5B	Water	09/17/25 14:15	09/18/25 14:55	New York
480-232730-19	OW-105B	Water	09/17/25 15:15	09/18/25 14:55	New York
480-232730-20	OW-6B	Water	09/17/25 14:30	09/18/25 14:55	New York
480-232730-21	OW-7B	Water	09/17/25 14:45	09/18/25 14:55	New York
480-232730-22	OW-8B	Water	09/17/25 14:55	09/18/25 14:55	New York
480-232730-23	MW-1B	Water	09/17/25 15:20	09/18/25 14:55	New York
480-232730-24	MW-1C	Water	09/17/25 15:30	09/18/25 14:55	New York
480-232730-25	MW-1CD	Water	09/17/25 15:45	09/18/25 14:55	New York
480-232730-26	MW-1F	Water	09/17/25 08:45	09/18/25 14:55	New York
480-232730-27	OW-12A	Water	09/18/25 08:10	09/18/25 14:55	New York
480-232730-28	OW-10B	Water	09/18/25 08:20	09/18/25 14:55	New York
480-232730-29	MW-2A	Water	09/18/25 08:30	09/18/25 14:55	New York
480-232730-30	OW-18A	Water	09/18/25 09:00	09/18/25 14:55	New York
480-232730-31	OW-11B	Water	09/18/25 09:30	09/18/25 14:55	New York
480-232730-32	OW-111B	Water	09/18/25 10:30	09/18/25 14:55	New York
480-232730-33	MW-6B	Water	09/18/25 08:40	09/18/25 14:55	New York
480-232730-34	MW-6F	Water	09/17/25 09:05	09/18/25 14:55	New York
480-232730-35	OW-14B	Water	09/17/25 11:15	09/18/25 14:55	New York
480-232730-36	OW-22A	Water	09/17/25 13:00	09/18/25 14:55	New York
480-232730-37	OW-22B	Water	09/17/25 13:05	09/18/25 14:55	New York
480-232730-38	OW-15B	Water	09/17/25 11:50	09/18/25 14:55	New York
480-232730-39	TB-01 (Trip Blank)	Water	09/16/25 07:00	09/18/25 14:55	New York
480-232730-40	TB-02 (Trip Blank)	Water	09/17/25 12:00	09/18/25 14:55	New York

10 Hazelwood Drive
Amherst, NY 14228-2298
Phone: 716-691-2600 Fax: 716-691-7991

Chain of Custody Record

0.6 0.5

eurofins | Environment Testing

Client Information	Sampler: C. Rudzinski	Lab PM: Boyina, Kavya	Carrier Tracking No(s): Hand Deliver	COC No: 480-207473-25500.1
Client Contact: Mr. Nathan Sarapas	Phone: 978-758-4902	E-Mail: kavya.boyina@et.eurofinsus.com	State of Origin: NY	Page: Page 1 of 8 4 pages
Company: TRC Companies, Inc	PWSID:			Job #:
Address: 650 Suffolk Street	Due Date Requested:			
City: Lowell	TAT Requested (days): Standard			
State, Zip: MA, 01854	Compliance Project: Δ Yes Δ No			
Phone:	PO #: 233658			
Email: nsarapas@trccompanies.com	WO #:			
Project Name: Solvent Chemical Semi-annual Monitoring	Project #: 48002700			
Site:	SSOW#:			

Analysis Requested

Preservation Codes: N - None

480-232730 Chain of Custody

Sample Identification	Sample Date	Sample Time	Sample Type (C=Comp, G=grab)	Matrix (W=water, S=solid, O=waste/oil, BT=Tissue, A=Air, DW=Drinking Water)	Field Filtered Sample (Yes or No)	Perform MS/MSD (Yes or No)	8260C - Volatiles	Total Number	Special Instructions/Note:
			Preservation Code:				N		
OW-26B	9/16/25	0850	Grab	Water	N	N	X	2	Samples "shipped" on Ice. Temp Blank in each cooler. Please "shoot" temp upon arrival
OW-30B	9/16/25	0930		Water	N	N	X	3	
MW-5A	9/16/25	1015		Water	N	N	X	3	
MW-5C	9/16/25	1000		Water	N	N	X	3	
MW-5CD	9/16/25	1030		Water	N	N	X	3	
MW-5F	9/16/25	1040		Water	N	N	X	3	
OW-12B	9/16/25	1110		Water	N	N	X	3	
OW-9A	9/16/25	1120		Water	N	N	X	3	
OW-27B	9/16/25	1135		Water	N	N	X	3	
OW-16A	9/16/25	1145		Water	N	N	X	3	
OW-13B	9/16/25	1155		Water	N	N	X	3	

Possible Hazard Identification
☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☒ Unknown ☐ Radiological

Sample Disposal (A fee may be assessed if samples are retained longer than 1 month)
☐ Return To Client ☒ Disposal By Lab ☐ Archive For _____ Months

Deliverable Requested: I, II, III, IV, Other (specify)

Special Instructions/QC Requirements:

Empty Kit Relinquished by:	Date:	Time:	Method of Shipment:

	Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company
1		9/18/25 1455	TRC		9/18/25 1455	EURO
2	Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company
3	Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company

Custody Seals Intact: Δ Yes Δ No | Custody Seal No.:

Cooler Temperature(s) °C and Other Remarks: 0.6, 0.5 IR#SC

Ver: 10/10/2024

10 Hazelwood Drive
Amherst, NY 14228-2298
Phone: 716-691-2600 Fax: 716-691-7991

Chain of Custody Record

eurofins | Environment Testing

Client Information	Sampler: C. Rudzinski	Lab PM: Boyina, Kavya	Carrier Tracking No(s): Hand Deliver	COC No: 480-207473-25500.2
Client Contact: Mr. Nathan Sarapas	Phone: 978-758-4902	E-Mail: kavya.boyina@et.eurofinsus.com	State of Origin: NY	Page: Page 2 of 4 9/18/25
Company: TRC Companies, Inc	PWSID:			Job #:
Address: 650 Suffolk Street	Due Date Requested:			
City: Lowell	TAT Requested (days): Standard			
State, Zip: MA, 01854	Compliance Project: Δ Yes Δ No			
Phone:	PO #: 233658			
Email: nsarapas@trccompanies.com	WO #:			
Project Name: Solvent Chemical Semi-annual Monitoring	Project #: 48002700			
Site:	SSOW#:			

Analysis Requested

Preservation Codes: N - None

Other:

Sample Identification	Sample Date	Sample Time	Sample Type (C=comp, G=grab)	Matrix (W=water, S=solid, O=wasteoil, BT=Tissue, A=Air, DW=Drinking Water)	Field Filtered Sample (Yes or No)	Perform MS/MSD (Yes or No)	8260C - Volatiles	Total Number of containers	Special Instructions/Note:
			Preservation Code:				N		
OW-113B	9/16/25	1255	Grab	Water	N	N	X	3	
OW-29B	9/18/25	1310		Water	N	N	X	3	
OW-15A	9/16/25	1320		Water	N	N	X	3	
OW-28B	9/16/25	1330		Water	N	N	X	3	
MW-4B	9/16/25	1415		Water	N	N	X	3	
MW-4C	9/18/25	1345		Water	N	X	X	8	MS/MSD
OW-5B	9/17/25	1415		Water	N	N	X	3	
OW-105B	9/17/25	1515		Water	N	N	X	3	
OW-6B	9/17/25	1430		Water	N	N	X	3	
OW-7B	9/17/25	1445		Water	N	N	X	3	
OW-8B	9/17/25	1455		Water	N	N	X	3	

Possible Hazard Identification
☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☒ Unknown ☐ Radiological

Sample Disposal (A fee may be assessed if samples are retained longer than 1 month)
☐ Return To Client ☒ Disposal By Lab ☐ Archive For _____ Months

Deliverable Requested: I, II, III, IV, Other (specify)

Special Instructions/QC Requirements:

Empty Kit Relinquished by:	Date:	Time:	Method of Shipment:

	Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company
		9/18/25 1455	TRC		9/18/25 1455	EMLO
	Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company
	Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company

Custody Seals Intact: Δ Yes Δ No | Custody Seal No.: | Cooler Temperature(s) °C and Other Remarks:

Ver: 10/10/2024

Eurofins Buffalo
10 Hazelwood Drive
Amherst, NY 14228-2298
Phone: 716-691-2600 Fax: 716-691-7991

Chain of Custody Record

eurofins | Environment Testing

Client Information	Sampler: C. Rudzinski	Lab PM: Boyina, Kavya	Carrier Tracking No(s): Hand Deliver	COC No: 480-207473-25500.3
Client Contact: Mr. Nathan Sarapas	Phone: 978-758-4902	E-Mail: kavya.boyina@et.eurofinsus.com	State of Origin: NY	Page: Page 3 of 4 CN 9/18/25
Company: TRC Companies, Inc	PWSID:	Analysis Requested		Job #:
Address: 650 Suffolk Street	Due Date Requested:			Preservation Codes: N - None
City: Lowell	TAT Requested (days): Standard			
State, Zip: MA, 01854	Compliance Project: Δ Yes Δ No			
Phone:	PO #: 233658			
Email: nsarapas@trccompanies.com	WO #:			
Project Name: Solvent Chemical Semi-annual Monitoring	Project #: 48002700			Other:
Site:	SSOW#:			

Sample Identification	Sample Date	Sample Time	Sample Type (C=Comp, G=grab)	Matrix (W=water, S=solid, O=waste/oil, BT=Tissue, A=Air, DW=Drinking Water)	Field Filtered Sample (Yes or No)	Perform MS/MSD (Yes or No)	8260C - Volatiles	Total Number of containers	Special Instructions/Note:
			Preservation Code:				N		
MW-1B	9/17/25	1520	Grab	Water	N	N	X	3	
MW-1C	9/17/25	1530		Water	N	N	X	3	
MW-1CD	9/17/25	1545		Water	N	N	X	3	
MW-1F	9/17/25	0845		Water	N	N	X	3	
OW-12A	9/18/25	0810		Water	N	N	X	2	
OW-10B	9/18/25	0820		Water	N	N	X	3	
MW-2A	9/18/25	0830		Water	N	N	X	2	
OW-18A	9/18/25	0900		Water	N	(X)	X	9	MS/MSD
				Water					
OW-11B	9/18/25	0930		Water	N	N	X	3	
OW-111B	9/18/25	1030		Water	N	N	X	3	

CN 9/18/25

Possible Hazard Identification
☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☒ Unknown ☐ Radiological

Sample Disposal (A fee may be assessed if samples are retained longer than 1 month)
☐ Return To Client ☒ Disposal By Lab ☐ Archive For _____ Months

Deliverable Requested: I, II, III, IV, Other (specify)

Special Instructions/QC Requirements:

Empty Kit Relinquished by:	Date:	Time:	Method of Shipment:

Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company
	9/18/25 1455	TRC		9/18/25 1455	Eurofins
Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company
Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company

Custody Seals Intact: Δ Yes Δ No	Custody Seal No.:	Cooler Temperature(s) °C and Other Remarks:

Ver: 10/10/2024

9/25/2025

Eurofins Buffalo
10 Hazelwood Drive
Amherst, NY 14228-2298
Phone: 716-691-2600 Fax: 716-691-7991

Chain of Custody Record

eurofins | Environment Testing

Client Information	Sampler: C. Rudzinski	Lab PM: Boyina, Kavya	Carrier Tracking No(s): Hand Delivered	COC No: 480-207473-25500.4
Client Contact: Mr. Nathan Sarapas	Phone: 978-758-4902	E-Mail: kavya.boyina@et.eurofinsus.com	State of Origin: NY	Page: Page 4 of 84 9/18/25
Company: TRC Companies, Inc	PWSID:			Job #:
Address: 650 Suffolk Street	Due Date Requested:			
City: Lowell	TAT Requested (days): Standard			
State, Zip: MA, 01854	Compliance Project: Δ Yes Δ No			
Phone:	PO #: 233658			
Email: nsarapas@trccompanies.com	WO #:			
Project Name: Solvent Chemical Semi-annual Monitoring	Project #: 48002700			
Site:	SSOW#:			

Analysis Requested

Preservation Codes: N - None

Other:

Sample Identification	Sample Date	Sample Time	Sample Type (C=Comp, G=grab)	Matrix (W=water, S=solid, O=waste/oil, BT=Tissue, A=Air, DW=Drinking Water)	Field Filtered Sample (Yes or No)	Perform MS/MSD (Yes or No)	8260C - Volatiles	Total Number of containers	Special Instructions/Note:
			Preservation Code:				N		
~~OW-29A~~			Grab	~~Water~~					
MW-6B	9/18/25	0840	Grab	Water	N	N	X	3	
MW-6F	9/17/25	0905		Water	N	N	X	3	
OW-14B	9/17/25	1115		Water	N	N	X	3	
OW-22A	9/17/25	1300		Water	N	N	X	3	
OW-22B	9/17/25	1305		Water	N	X	X	9	MS/MSD
OW-15B	9/17/25	1150		Water	N	N	X	3	
TB-01 (Trip Blank)	9/16/25	0700	Lab Prep	Water	N	N	X	2	
TB-02 (Trip Blank)	9/17/25	1200	Lab Prep	Water	N	N	X	2	
				Water					
				Water					

Possible Hazard Identification
☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☒ Unknown ☐ Radiological

Sample Disposal (A fee may be assessed if samples are retained longer than 1 month)
☐ Return To Client ☒ Disposal By Lab ☐ Archive For _____ Months

Deliverable Requested: I, II, III, IV, Other (specify)

Special Instructions/QC Requirements:

Empty Kit Relinquished by:	Date:	Time:	Method of Shipment:

	Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company
1	[signature]	9/18/25 1455	TRC	[signature]	9/18/25 1455	ALRO
2	Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company
3	Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company

Custody Seals Intact: Δ Yes Δ No	Custody Seal No.:	Cooler Temperature(s) °C and Other Remarks:

Ver: 10/10/2024

Login Sample Receipt Checklist

Client: TRC Environmental Corporation

Job Number: 480-232730-1

Login Number: 232730
List Number: 1
Creator: Stapleton, Kaitlyn

List Source: Eurofins Buffalo

Question	Answer	Comment
Radioactivity either was not measured or, if measured, is at or below background	True	
The cooler's custody seal, if present, is intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	0.6, 0.5 IR#SC ice
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the sample IDs on the containers and the COC.	True	
Samples are received within Holding Time (Excluding tests with immediate HTs)..	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
VOA sample vials do not have headspace or bubble is <6mm (1/4") in diameter.	True	
If necessary, staff have been informed of any short hold time or quick TAT needs	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Sampling Company provided.	True	TRC Companies
Samples received within 48 hours of sampling.	True	
Samples requiring field filtration have been filtered in the field.	True	
Chlorine Residual checked.	N/A	

eurofins | Environment Testing

ANALYTICAL REPORT

PREPARED FOR

Attn: Mr. Nathan Sarapas
TRC Environmental Corporation
Wannalancit Mills
650 Suffolk Street
Lowell, Massachusetts 01854

Generated 4/1/2026 8:25:54 AM

JOB DESCRIPTION

Solvent Chemical Semi-annual Monitoring

JOB NUMBER

480-237182-1

Eurofins Buffalo
10 Hazelwood Drive
Amherst NY 14228-2298

See page two for job notes and contact information.

my EOL

Job Notes

This report may not be reproduced except in full, and with written approval from the laboratory. The results relate only to the samples tested. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

The test results in this report relate only to the samples as received by the laboratory and will meet all requirements of the methodology, with any exceptions noted. This report shall not be reproduced except in full, without the express written approval of the laboratory. All questions should be directed to the Eurofins Environment Testing Northeast, LLC Project Manager.

Authorization



Generated
4/1/2026 8:25:54 AM

Authorized for release by
Kavya Boyina, Project Manager
kavya.boyina@et.eurofinsus.com
(716)504-9813

Table of Contents

Cover Page 1
Table of Contents 3
Definitions/Glossary 4
Case Narrative 5
Detection Summary 7
Client Sample Results 16
Surrogate Summary 79
QC Sample Results 81
QC Association Summary 107
Lab Chronicle 109
Certification Summary 115
Method Summary 116
Sample Summary 117
Chain of Custody 118
Receipt Checklists 122

Qualifiers

GC/MS VOA

Qualifier	Qualifier Description
B	Compound was found in the blank and sample.
F1	MS and/or MSD recovery exceeds control limits.
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
☼	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CFU	Colony Forming Unit
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MCL	EPA recommended "Maximum Contaminant Level"
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
MPN	Most Probable Number
MQL	Method Quantitation Limit
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
NEG	Negative / Absent
POS	Positive / Present
PQL	Practical Quantitation Limit
PRES	Presumptive
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)
TNTC	Too Numerous To Count

Job Narrative
480-237182-1

The analytical test results presented in this report meet all requirements of the associated regulatory program listed on the Accreditation/Certification Summary Page, unless otherwise noted. Data qualifiers and/or narrative comments are included to explain any exceptions, if applicable. Regulated compliance samples (e.g. SDWA, NPDES) must comply with associated agency requirements/permits.

- Matrix-specific batch QC (e.g., MS, MSD, SD) may not be reported when insufficient sample volume is available or when site-specific QC samples are not submitted. In such cases, a Laboratory Control Sample Duplicate (LCSD) may be analyzed to provide precision data for the batch.
- For samples analyzed using surrogate and/or isotope dilution analytes, any recoveries falling outside of established acceptance criteria are re-prepared and/or re-analyzed to confirm results, unless the deviation is due to sample dilution or otherwise explained in the case narrative.

Receipt
The samples were received on 3/26/2026 3:25 PM. Unless otherwise noted below, the samples arrived in good condition, and, where required, properly preserved and on ice. The temperatures of the 2 coolers at receipt time were 0.5°C and 0.7°C.

GC/MS VOA
Method EPA 8260D: The following samples were diluted to bring the concentration of target analytes within the calibration range: OW-113B (480-237182-12), OW-29B (480-237182-13), OW-28B (480-237182-15), MW-4B (480-237182-16), MW-4C (480-237182-17), MW-4C (480-237182-17[MS]), MW-4C (480-237182-17[MSD]), OW-5B (480-237182-18), OW-105B (480-237182-19), OW-6B (480-237182-20), MW-6B (480-237182-23) and MW-6F (480-237182-24). Elevated reporting limits (RLs) are provided.

Method EPA 8260D: Due to the high concentration of cis-1,2-Dichloroethene, the matrix spike / matrix spike duplicate (MS/MSD) for analytical batch 480-771067 could not be evaluated for accuracy and precision. The associated laboratory control sample (LCS) met acceptance criteria.

Method EPA 8260D: The following samples were diluted to bring the concentration of target analytes within the calibration range: OW-26B (480-237182-1), MW-5C (480-237182-4), MW-5CD (480-237182-5), OW-12B (480-237182-7), OW-9A (480-237182-8) and OW-13B (480-237182-11). Elevated reporting limits (RLs) are provided.

Method EPA 8260D: The trip blank for analytical batch 480-771067 contained 2-Butanone (MEK) above the method detection limit. This target analyte concentration was less than the reporting limit (RL) in the trip blank; therefore, re-extraction and/or re-analysis of samples was not performed.

Method EPA 8260D: The method blank for analytical batch 480-771146 contained 2-Butanone (MEK) above the method detection limit. This target analyte concentration was less than the reporting limit (RL) in the method blank; therefore, re-extraction and/or re-analysis of samples was not performed.

Method EPA 8260D: The following samples were diluted to bring the concentration of target analytes within the calibration range: MW-5F (480-237182-6), OW-27B (480-237182-9), OW-7B (480-237182-21), OW-14B (480-237182-25), OW-22B (480-237182-27), OW-22B (480-237182-27[MS]), OW-22B (480-237182-27[MSD]), OW-15B (480-237182-28), MW-1B (480-237182-31), MW-1C (480-237182-32), MW-1CD (480-237182-33), OW-12A (480-237182-35) and MW-2A (480-237182-37). Elevated reporting limits (RLs) are provided.

Method EPA 8260D: The following samples were diluted to bring the concentration of target analytes within the calibration range: OW-18A (480-237182-38), OW-18A (480-237182-38[MS]) and OW-18A (480-237182-38[MSD]). Elevated reporting limits (RLs) are provided.

Method EPA 8260D: The method blank for analytical batch 480-771172 contained 2-Butanone (MEK) above the method detection limit. This target analyte concentration was less than the reporting limit (RL) in the method blank; therefore, re-extraction and/or re-analysis of samples was not performed.

Method EPA 8260D: The following samples were diluted to bring the concentration of target analytes within the calibration range: MW-1F (480-237182-34), OW-10B (480-237182-36), OW-11B (480-237182-39) and OW-111B (480-237182-40). Elevated reporting limits (RLs) are provided.

Eurofins Buffalo

Job ID: 480-237182-1 (Continued) Eurofins Buffalo

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

Detection Summary

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-26B — Lab Sample ID: 480-237182-1

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1-Dichloroethane	0.94	J	2.0	0.76	ug/L	2		EPA 8260D	Total/NA
2-Butanone (MEK)	7.4	J B	20	2.6	ug/L	2		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	4.3		2.0	1.6	ug/L	2		EPA 8260D	Total/NA
Tetrachloroethene	45		2.0	0.72	ug/L	2		EPA 8260D	Total/NA
Trichloroethene	2.8		2.0	0.92	ug/L	2		EPA 8260D	Total/NA

Client Sample ID: OW-30B — Lab Sample ID: 480-237182-2

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1-Dichloroethane	3.1		1.0	0.38	ug/L	1		EPA 8260D	Total/NA
1,2,3-Trichlorobenzene	1.2		1.0	0.41	ug/L	1		EPA 8260D	Total/NA
1,2,4-Trichlorobenzene	1.1		1.0	0.41	ug/L	1		EPA 8260D	Total/NA
1,2-Dichlorobenzene	3.1		1.0	0.79	ug/L	1		EPA 8260D	Total/NA
1,3-Dichlorobenzene	9.3		1.0	0.78	ug/L	1		EPA 8260D	Total/NA
1,4-Dichlorobenzene	7.6		1.0	0.84	ug/L	1		EPA 8260D	Total/NA
2-Butanone (MEK)	3.9	J B	10	1.3	ug/L	1		EPA 8260D	Total/NA
Benzene	0.88	J	1.0	0.41	ug/L	1		EPA 8260D	Total/NA
Chlorobenzene	6.2		1.0	0.75	ug/L	1		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	11		1.0	0.81	ug/L	1		EPA 8260D	Total/NA
Tetrachloroethene	26		1.0	0.36	ug/L	1		EPA 8260D	Total/NA
trans-1,2-Dichloroethene	4.0		1.0	0.90	ug/L	1		EPA 8260D	Total/NA
Trichloroethene	6.4		1.0	0.46	ug/L	1		EPA 8260D	Total/NA
Vinyl chloride	3.7		1.0	0.90	ug/L	1		EPA 8260D	Total/NA

Client Sample ID: MW-5A — Lab Sample ID: 480-237182-3

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
2-Butanone (MEK)	3.6	J B	10	1.3	ug/L	1		EPA 8260D	Total/NA
Tetrachloroethene	3.4		1.0	0.36	ug/L	1		EPA 8260D	Total/NA

Client Sample ID: MW-5C — Lab Sample ID: 480-237182-4

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2-Dichlorobenzene	340		40	32	ug/L	40		EPA 8260D	Total/NA
1,3-Dichlorobenzene	1100		40	31	ug/L	40		EPA 8260D	Total/NA
1,4-Dichlorobenzene	2400		40	34	ug/L	40		EPA 8260D	Total/NA
2-Butanone (MEK)	140	J B	400	53	ug/L	40		EPA 8260D	Total/NA
Benzene	79		40	16	ug/L	40		EPA 8260D	Total/NA
Chlorobenzene	2800		40	30	ug/L	40		EPA 8260D	Total/NA

Client Sample ID: MW-5CD — Lab Sample ID: 480-237182-5

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
2-Butanone (MEK)	37	J B	100	13	ug/L	10		EPA 8260D	Total/NA
Benzene	25		10	4.1	ug/L	10		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	650		10	8.1	ug/L	10		EPA 8260D	Total/NA
trans-1,2-Dichloroethene	33		10	9.0	ug/L	10		EPA 8260D	Total/NA
Vinyl chloride	250		10	9.0	ug/L	10		EPA 8260D	Total/NA

Client Sample ID: MW-5F — Lab Sample ID: 480-237182-6

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2-Dichlorobenzene	5700		130	99	ug/L	125		EPA 8260D	Total/NA

This Detection Summary does not include radiochemical test results.

Eurofins Buffalo

Client Sample ID: MW-5F (Continued) — Lab Sample ID: 480-237182-6

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,3-Dichlorobenzene	390		130	98	ug/L	125		EPA 8260D	Total/NA
1,4-Dichlorobenzene	2300		130	110	ug/L	125		EPA 8260D	Total/NA
2-Butanone (MEK)	520	J B	1300	170	ug/L	125		EPA 8260D	Total/NA
Benzene	2500		130	51	ug/L	125		EPA 8260D	Total/NA
Chlorobenzene	8000		130	94	ug/L	125		EPA 8260D	Total/NA

Client Sample ID: OW-12B — Lab Sample ID: 480-237182-7

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,4-Trichlorobenzene	28	J	40	16	ug/L	40		EPA 8260D	Total/NA
1,2-Dichlorobenzene	1100		40	32	ug/L	40		EPA 8260D	Total/NA
1,3-Dichlorobenzene	750		40	31	ug/L	40		EPA 8260D	Total/NA
1,4-Dichlorobenzene	2000		40	34	ug/L	40		EPA 8260D	Total/NA
2-Butanone (MEK)	150	J B	400	53	ug/L	40		EPA 8260D	Total/NA
Benzene	270		40	16	ug/L	40		EPA 8260D	Total/NA
Chlorobenzene	3300		40	30	ug/L	40		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	67		40	32	ug/L	40		EPA 8260D	Total/NA
Vinyl chloride	84		40	36	ug/L	40		EPA 8260D	Total/NA

Client Sample ID: OW-9A — Lab Sample ID: 480-237182-8

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
2-Butanone (MEK)	770	J B	2000	260	ug/L	200		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	220		200	160	ug/L	200		EPA 8260D	Total/NA
Tetrachloroethene	9000		200	72	ug/L	200		EPA 8260D	Total/NA
Trichloroethene	410		200	92	ug/L	200		EPA 8260D	Total/NA

Client Sample ID: OW-27B — Lab Sample ID: 480-237182-9

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,4-Trichlorobenzene	2.6	J	5.0	2.1	ug/L	5		EPA 8260D	Total/NA
1,4-Dichlorobenzene	6.1		5.0	4.2	ug/L	5		EPA 8260D	Total/NA
2-Butanone (MEK)	21	J B	50	6.6	ug/L	5		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	17		5.0	4.1	ug/L	5		EPA 8260D	Total/NA
Tetrachloroethene	190		5.0	1.8	ug/L	5		EPA 8260D	Total/NA
Trichloroethene	23		5.0	2.3	ug/L	5		EPA 8260D	Total/NA

Client Sample ID: OW-16A — Lab Sample ID: 480-237182-10

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
2-Butanone (MEK)	4.8	J B	10	1.3	ug/L	1		EPA 8260D	Total/NA
Acetone	4.3	J	10	3.0	ug/L	1		EPA 8260D	Total/NA

Client Sample ID: OW-13B — Lab Sample ID: 480-237182-11

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,4-Trichlorobenzene	1700		200	82	ug/L	200		EPA 8260D	Total/NA
1,2-Dichlorobenzene	3700		200	160	ug/L	200		EPA 8260D	Total/NA
1,3-Dichlorobenzene	1500		200	160	ug/L	200		EPA 8260D	Total/NA
1,4-Dichlorobenzene	5400		200	170	ug/L	200		EPA 8260D	Total/NA
2-Butanone (MEK)	710	J B	2000	260	ug/L	200		EPA 8260D	Total/NA
Benzene	680		200	82	ug/L	200		EPA 8260D	Total/NA
Chlorobenzene	5800		200	150	ug/L	200		EPA 8260D	Total/NA

This Detection Summary does not include radiochemical test results.

Client Sample ID: OW-13B (Continued) — Lab Sample ID: 480-237182-11

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Vinyl chloride	740		200	180	ug/L	200		EPA 8260D	Total/NA

Client Sample ID: OW-113B — Lab Sample ID: 480-237182-12

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,4-Trichlorobenzene	1700		200	82	ug/L	200		EPA 8260D	Total/NA
1,2-Dichlorobenzene	3700		200	160	ug/L	200		EPA 8260D	Total/NA
1,3-Dichlorobenzene	1500		200	160	ug/L	200		EPA 8260D	Total/NA
1,4-Dichlorobenzene	5300		200	170	ug/L	200		EPA 8260D	Total/NA
2-Butanone (MEK)	730	J	2000	260	ug/L	200		EPA 8260D	Total/NA
Benzene	700		200	82	ug/L	200		EPA 8260D	Total/NA
Chlorobenzene	5900		200	150	ug/L	200		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	160	J	200	160	ug/L	200		EPA 8260D	Total/NA
Vinyl chloride	780		200	180	ug/L	200		EPA 8260D	Total/NA

Client Sample ID: OW-29B — Lab Sample ID: 480-237182-13

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	60	J	130	26	ug/L	125		EPA 8260D	Total/NA
1,2,4-Trichlorobenzene	500		130	51	ug/L	125		EPA 8260D	Total/NA
1,2-Dichlorobenzene	1500		130	99	ug/L	125		EPA 8260D	Total/NA
1,3-Dichlorobenzene	600		130	98	ug/L	125		EPA 8260D	Total/NA
1,4-Dichlorobenzene	2100		130	110	ug/L	125		EPA 8260D	Total/NA
2-Butanone (MEK)	500	J	1300	170	ug/L	125		EPA 8260D	Total/NA
Benzene	250		130	51	ug/L	125		EPA 8260D	Total/NA
Chlorobenzene	2900		130	94	ug/L	125		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	1800		130	100	ug/L	125		EPA 8260D	Total/NA
Tetrachloroethene	610		130	45	ug/L	125		EPA 8260D	Total/NA
Trichloroethene	620		130	58	ug/L	125		EPA 8260D	Total/NA
Vinyl chloride	1700		130	110	ug/L	125		EPA 8260D	Total/NA

Client Sample ID: OW-15A — Lab Sample ID: 480-237182-14

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,3-Trichlorobenzene	1.4		1.0	0.41	ug/L	1		EPA 8260D	Total/NA
1,2,4-Trichlorobenzene	3.6		1.0	0.41	ug/L	1		EPA 8260D	Total/NA
1,2-Dichlorobenzene	1.7		1.0	0.79	ug/L	1		EPA 8260D	Total/NA
1,3-Dichlorobenzene	3.0		1.0	0.78	ug/L	1		EPA 8260D	Total/NA
1,4-Dichlorobenzene	0.85	J	1.0	0.84	ug/L	1		EPA 8260D	Total/NA
2-Butanone (MEK)	4.2	J	10	1.3	ug/L	1		EPA 8260D	Total/NA
Acetone	3.1	J	10	3.0	ug/L	1		EPA 8260D	Total/NA
Tetrachloroethene	0.92	J	1.0	0.36	ug/L	1		EPA 8260D	Total/NA
Trichloroethene	0.55	J	1.0	0.46	ug/L	1		EPA 8260D	Total/NA

Client Sample ID: OW-28B — Lab Sample ID: 480-237182-15

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	160		130	26	ug/L	125		EPA 8260D	Total/NA
1,2,4-Trichlorobenzene	310		130	51	ug/L	125		EPA 8260D	Total/NA
1,2-Dichlorobenzene	190		130	99	ug/L	125		EPA 8260D	Total/NA
1,3-Dichlorobenzene	100	J	130	98	ug/L	125		EPA 8260D	Total/NA
1,4-Dichlorobenzene	180		130	110	ug/L	125		EPA 8260D	Total/NA
2-Butanone (MEK)	500	J	1300	170	ug/L	125		EPA 8260D	Total/NA

This Detection Summary does not include radiochemical test results.

Client Sample ID: OW-28B (Continued)
Lab Sample ID: 480-237182-15

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Chlorobenzene	160		130	94	ug/L	125		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	3100		130	100	ug/L	125		EPA 8260D	Total/NA
Tetrachloroethene	1900		130	45	ug/L	125		EPA 8260D	Total/NA
Trichloroethene	4000		130	58	ug/L	125		EPA 8260D	Total/NA
Vinyl chloride	320		130	110	ug/L	125		EPA 8260D	Total/NA

Client Sample ID: MW-4B
Lab Sample ID: 480-237182-16

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	370		80	17	ug/L	80		EPA 8260D	Total/NA
1,2,4-Trichlorobenzene	130		80	33	ug/L	80		EPA 8260D	Total/NA
1,2-Dichlorobenzene	74	J	80	63	ug/L	80		EPA 8260D	Total/NA
1,3-Dichlorobenzene	68	J	80	62	ug/L	80		EPA 8260D	Total/NA
1,4-Dichlorobenzene	92		80	67	ug/L	80		EPA 8260D	Total/NA
2-Butanone (MEK)	290	J	800	110	ug/L	80		EPA 8260D	Total/NA
Chloroform	140		80	27	ug/L	80		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	2900		80	65	ug/L	80		EPA 8260D	Total/NA
Tetrachloroethene	3000		80	29	ug/L	80		EPA 8260D	Total/NA
Trichloroethene	5600		80	37	ug/L	80		EPA 8260D	Total/NA

Client Sample ID: MW-4C
Lab Sample ID: 480-237182-17

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2-Dichlorobenzene	820		400	320	ug/L	400		EPA 8260D	Total/NA
1,4-Dichlorobenzene	520		400	340	ug/L	400		EPA 8260D	Total/NA
2-Butanone (MEK)	1600	J	4000	530	ug/L	400		EPA 8260D	Total/NA
Benzene	2800		400	160	ug/L	400		EPA 8260D	Total/NA
Chlorobenzene	4600		400	300	ug/L	400		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	23000	F1	400	320	ug/L	400		EPA 8260D	Total/NA
Tetrachloroethene	370	J	400	140	ug/L	400		EPA 8260D	Total/NA
Trichloroethene	1900		400	180	ug/L	400		EPA 8260D	Total/NA
Vinyl chloride	1900		400	360	ug/L	400		EPA 8260D	Total/NA

Client Sample ID: OW-5B
Lab Sample ID: 480-237182-18

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	280		100	21	ug/L	100		EPA 8260D	Total/NA
1,2,4-Trichlorobenzene	120		100	41	ug/L	100		EPA 8260D	Total/NA
1,2-Dichlorobenzene	120		100	79	ug/L	100		EPA 8260D	Total/NA
1,3-Dichlorobenzene	100		100	78	ug/L	100		EPA 8260D	Total/NA
1,4-Dichlorobenzene	150		100	84	ug/L	100		EPA 8260D	Total/NA
2-Butanone (MEK)	400	J	1000	130	ug/L	100		EPA 8260D	Total/NA
Benzene	41	J	100	41	ug/L	100		EPA 8260D	Total/NA
Chlorobenzene	190		100	75	ug/L	100		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	2300		100	81	ug/L	100		EPA 8260D	Total/NA
Tetrachloroethene	2600		100	36	ug/L	100		EPA 8260D	Total/NA
Trichloroethene	7200		100	46	ug/L	100		EPA 8260D	Total/NA
Vinyl chloride	110		100	90	ug/L	100		EPA 8260D	Total/NA

Client Sample ID: OW-105B
Lab Sample ID: 480-237182-19

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	270		100	21	ug/L	100		EPA 8260D	Total/NA

This Detection Summary does not include radiochemical test results.

Client Sample ID: OW-105B (Continued)
Lab Sample ID: 480-237182-19

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,4-Trichlorobenzene	110		100	41	ug/L	100		EPA 8260D	Total/NA
1,2-Dichlorobenzene	120		100	79	ug/L	100		EPA 8260D	Total/NA
1,3-Dichlorobenzene	100		100	78	ug/L	100		EPA 8260D	Total/NA
1,4-Dichlorobenzene	160		100	84	ug/L	100		EPA 8260D	Total/NA
2-Butanone (MEK)	390	J	1000	130	ug/L	100		EPA 8260D	Total/NA
Benzene	43	J	100	41	ug/L	100		EPA 8260D	Total/NA
Chlorobenzene	200		100	75	ug/L	100		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	2400		100	81	ug/L	100		EPA 8260D	Total/NA
Tetrachloroethene	2800		100	36	ug/L	100		EPA 8260D	Total/NA
Trichloroethene	7300		100	46	ug/L	100		EPA 8260D	Total/NA
Vinyl chloride	120		100	90	ug/L	100		EPA 8260D	Total/NA

Client Sample ID: OW-6B
Lab Sample ID: 480-237182-20

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	59	J	80	17	ug/L	80		EPA 8260D	Total/NA
1,2,4-Trichlorobenzene	300		80	33	ug/L	80		EPA 8260D	Total/NA
1,2-Dichlorobenzene	230		80	63	ug/L	80		EPA 8260D	Total/NA
1,3-Dichlorobenzene	160		80	62	ug/L	80		EPA 8260D	Total/NA
1,4-Dichlorobenzene	300		80	67	ug/L	80		EPA 8260D	Total/NA
2-Butanone (MEK)	330	J	800	110	ug/L	80		EPA 8260D	Total/NA
Benzene	38	J	80	33	ug/L	80		EPA 8260D	Total/NA
Chlorobenzene	300		80	60	ug/L	80		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	2500		80	65	ug/L	80		EPA 8260D	Total/NA
Tetrachloroethene	770		80	29	ug/L	80		EPA 8260D	Total/NA
Trichloroethene	1700		80	37	ug/L	80		EPA 8260D	Total/NA
Vinyl chloride	250		80	72	ug/L	80		EPA 8260D	Total/NA

Client Sample ID: OW-7B
Lab Sample ID: 480-237182-21

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	23		4.0	0.84	ug/L	4		EPA 8260D	Total/NA
1,4-Dichlorobenzene	5.0		4.0	3.4	ug/L	4		EPA 8260D	Total/NA
2-Butanone (MEK)	18	J B	40	5.3	ug/L	4		EPA 8260D	Total/NA
Chlorobenzene	24		4.0	3.0	ug/L	4		EPA 8260D	Total/NA
Chloroform	2.7	J	4.0	1.4	ug/L	4		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	59		4.0	3.2	ug/L	4		EPA 8260D	Total/NA
Tetrachloroethene	96		4.0	1.4	ug/L	4		EPA 8260D	Total/NA
trans-1,2-Dichloroethene	14		4.0	3.6	ug/L	4		EPA 8260D	Total/NA
Trichloroethene	160		4.0	1.8	ug/L	4		EPA 8260D	Total/NA

Client Sample ID: OW-8B
Lab Sample ID: 480-237182-22

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1-Dichloroethane	0.80	J	1.0	0.38	ug/L	1		EPA 8260D	Total/NA
1,2,4-Trichlorobenzene	2.1		1.0	0.41	ug/L	1		EPA 8260D	Total/NA
1,2-Dichlorobenzene	13		1.0	0.79	ug/L	1		EPA 8260D	Total/NA
1,3-Dichlorobenzene	17		1.0	0.78	ug/L	1		EPA 8260D	Total/NA
1,4-Dichlorobenzene	15		1.0	0.84	ug/L	1		EPA 8260D	Total/NA
2-Butanone (MEK)	4.6	J	10	1.3	ug/L	1		EPA 8260D	Total/NA
Acetone	5.7	J	10	3.0	ug/L	1		EPA 8260D	Total/NA
Chlorobenzene	2.2		1.0	0.75	ug/L	1		EPA 8260D	Total/NA

This Detection Summary does not include radiochemical test results.

Detection Summary

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-8B (Continued) — Lab Sample ID: 480-237182-22

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
cis-1,2-Dichloroethene	18		1.0	0.81	ug/L	1		EPA 8260D	Total/NA
Tetrachloroethene	0.45	J	1.0	0.36	ug/L	1		EPA 8260D	Total/NA
trans-1,2-Dichloroethene	1.3		1.0	0.90	ug/L	1		EPA 8260D	Total/NA
Trichloroethene	12		1.0	0.46	ug/L	1		EPA 8260D	Total/NA
Vinyl chloride	1.5		1.0	0.90	ug/L	1		EPA 8260D	Total/NA

Client Sample ID: MW-6B — Lab Sample ID: 480-237182-23

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,3-Trichlorobenzene	47	J	80	33	ug/L	80		EPA 8260D	Total/NA
1,2,4-Trichlorobenzene	160		80	33	ug/L	80		EPA 8260D	Total/NA
1,2-Dichlorobenzene	3400		80	63	ug/L	80		EPA 8260D	Total/NA
1,3-Dichlorobenzene	1000		80	62	ug/L	80		EPA 8260D	Total/NA
1,4-Dichlorobenzene	2200		80	67	ug/L	80		EPA 8260D	Total/NA
2-Butanone (MEK)	310	J	800	110	ug/L	80		EPA 8260D	Total/NA
Benzene	170		80	33	ug/L	80		EPA 8260D	Total/NA
Chlorobenzene	2300		80	60	ug/L	80		EPA 8260D	Total/NA

Client Sample ID: MW-6F — Lab Sample ID: 480-237182-24

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
2-Butanone (MEK)	72	J	100	13	ug/L	10		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	330		10	8.1	ug/L	10		EPA 8260D	Total/NA
trans-1,2-Dichloroethene	24		10	9.0	ug/L	10		EPA 8260D	Total/NA
Vinyl chloride	660		10	9.0	ug/L	10		EPA 8260D	Total/NA

Client Sample ID: OW-14B — Lab Sample ID: 480-237182-25

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	16	J	40	8.4	ug/L	40		EPA 8260D	Total/NA
1,2,3-Trichlorobenzene	91		40	16	ug/L	40		EPA 8260D	Total/NA
1,2,4-Trichlorobenzene	320		40	16	ug/L	40		EPA 8260D	Total/NA
1,2-Dichlorobenzene	1100		40	32	ug/L	40		EPA 8260D	Total/NA
1,3-Dichlorobenzene	720		40	31	ug/L	40		EPA 8260D	Total/NA
1,4-Dichlorobenzene	2100		40	34	ug/L	40		EPA 8260D	Total/NA
2-Butanone (MEK)	150	J B	400	53	ug/L	40		EPA 8260D	Total/NA
Chlorobenzene	520		40	30	ug/L	40		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	360		40	32	ug/L	40		EPA 8260D	Total/NA
Tetrachloroethene	580		40	14	ug/L	40		EPA 8260D	Total/NA
Trichloroethene	210		40	18	ug/L	40		EPA 8260D	Total/NA

Client Sample ID: OW-22A — Lab Sample ID: 480-237182-26

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
2-Butanone (MEK)	4.6	J	10	1.3	ug/L	1		EPA 8260D	Total/NA
Acetone	4.1	J	10	3.0	ug/L	1		EPA 8260D	Total/NA

Client Sample ID: OW-22B — Lab Sample ID: 480-237182-27

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	310		200	42	ug/L	200		EPA 8260D	Total/NA
1,2,3-Trichlorobenzene	99	J	200	82	ug/L	200		EPA 8260D	Total/NA
1,2,4-Trichlorobenzene	220		200	82	ug/L	200		EPA 8260D	Total/NA

This Detection Summary does not include radiochemical test results.

Eurofins Buffalo

Client Sample ID: OW-22B (Continued) — Lab Sample ID: 480-237182-27

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
2-Butanone (MEK)	790	J B	2000	260	ug/L	200		EPA 8260D	Total/NA
Chloroform	100	J	200	68	ug/L	200		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	1500		200	160	ug/L	200		EPA 8260D	Total/NA
Tetrachloroethene	3300		200	72	ug/L	200		EPA 8260D	Total/NA
Trichloroethene	6800		200	92	ug/L	200		EPA 8260D	Total/NA

Client Sample ID: OW-15B — Lab Sample ID: 480-237182-28

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2,2-Tetrachloroethane	25	J	50	11	ug/L	50		EPA 8260D	Total/NA
1,2,3-Trichlorobenzene	40	J	50	21	ug/L	50		EPA 8260D	Total/NA
1,2,4-Trichlorobenzene	120		50	21	ug/L	50		EPA 8260D	Total/NA
1,2-Dichlorobenzene	160		50	40	ug/L	50		EPA 8260D	Total/NA
1,3-Dichlorobenzene	170		50	39	ug/L	50		EPA 8260D	Total/NA
1,4-Dichlorobenzene	280		50	42	ug/L	50		EPA 8260D	Total/NA
2-Butanone (MEK)	180	J B	500	66	ug/L	50		EPA 8260D	Total/NA
Benzene	51		50	21	ug/L	50		EPA 8260D	Total/NA
Chlorobenzene	430		50	38	ug/L	50		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	2400		50	41	ug/L	50		EPA 8260D	Total/NA
Tetrachloroethene	1100		50	18	ug/L	50		EPA 8260D	Total/NA
Trichloroethene	930		50	23	ug/L	50		EPA 8260D	Total/NA
Vinyl chloride	87		50	45	ug/L	50		EPA 8260D	Total/NA

Client Sample ID: TB01 — Lab Sample ID: 480-237182-29

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
2-Butanone (MEK)	4.0	J	10	1.3	ug/L	1		EPA 8260D	Total/NA

Client Sample ID: TB02 — Lab Sample ID: 480-237182-30

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
2-Butanone (MEK)	3.9	J	10	1.3	ug/L	1		EPA 8260D	Total/NA

Client Sample ID: MW-1B — Lab Sample ID: 480-237182-31

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,4-Trichlorobenzene	350	J	400	160	ug/L	400		EPA 8260D	Total/NA
1,2-Dichlorobenzene	1700		400	320	ug/L	400		EPA 8260D	Total/NA
1,3-Dichlorobenzene	1900		400	310	ug/L	400		EPA 8260D	Total/NA
1,4-Dichlorobenzene	8900		400	340	ug/L	400		EPA 8260D	Total/NA
2-Butanone (MEK)	1600	J B	4000	530	ug/L	400		EPA 8260D	Total/NA
Chlorobenzene	21000		400	300	ug/L	400		EPA 8260D	Total/NA

Client Sample ID: MW-1C — Lab Sample ID: 480-237182-32

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
2-Butanone (MEK)	200	J B	500	66	ug/L	50		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	1000		50	41	ug/L	50		EPA 8260D	Total/NA
trans-1,2-Dichloroethene	76		50	45	ug/L	50		EPA 8260D	Total/NA

Client Sample ID: MW-1CD — Lab Sample ID: 480-237182-33

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2-Dichlorobenzene	3000		800	630	ug/L	800		EPA 8260D	Total/NA

This Detection Summary does not include radiochemical test results.

Client Sample ID: MW-1CD (Continued)
Lab Sample ID: 480-237182-33

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,4-Dichlorobenzene	2100		800	670	ug/L	800		EPA 8260D	Total/NA
2-Butanone (MEK)	2900	J B	8000	1100	ug/L	800		EPA 8260D	Total/NA
Benzene	2200		800	330	ug/L	800		EPA 8260D	Total/NA
Chlorobenzene	18000		800	600	ug/L	800		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	2600		800	650	ug/L	800		EPA 8260D	Total/NA
Vinyl chloride	1200		800	720	ug/L	800		EPA 8260D	Total/NA

Client Sample ID: MW-1F
Lab Sample ID: 480-237182-34

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1,2-Trichloroethane	0.65	J	2.0	0.46	ug/L	2		EPA 8260D	Total/NA
2-Butanone (MEK)	9.2	J B	20	2.6	ug/L	2		EPA 8260D	Total/NA
Acetone	21		20	6.0	ug/L	2		EPA 8260D	Total/NA
Benzene	2.1		2.0	0.82	ug/L	2		EPA 8260D	Total/NA
cis-1,2-Dichloroethene	8.2		2.0	1.6	ug/L	2		EPA 8260D	Total/NA
trans-1,2-Dichloroethene	23		2.0	1.8	ug/L	2		EPA 8260D	Total/NA
Trichloroethene	2.6		2.0	0.92	ug/L	2		EPA 8260D	Total/NA
Vinyl chloride	85		2.0	1.8	ug/L	2		EPA 8260D	Total/NA

Client Sample ID: OW-12A
Lab Sample ID: 480-237182-35

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,3-Trichlorobenzene	54	J	100	41	ug/L	100		EPA 8260D	Total/NA
1,2,4-Trichlorobenzene	210		100	41	ug/L	100		EPA 8260D	Total/NA
1,2-Dichlorobenzene	2400		100	79	ug/L	100		EPA 8260D	Total/NA
1,3-Dichlorobenzene	510		100	78	ug/L	100		EPA 8260D	Total/NA
1,4-Dichlorobenzene	2200		100	84	ug/L	100		EPA 8260D	Total/NA
2-Butanone (MEK)	390	J B	1000	130	ug/L	100		EPA 8260D	Total/NA
Benzene	240		100	41	ug/L	100		EPA 8260D	Total/NA
Chlorobenzene	3700		100	75	ug/L	100		EPA 8260D	Total/NA

Client Sample ID: OW-10B
Lab Sample ID: 480-237182-36

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,3-Trichlorobenzene	100		8.0	3.3	ug/L	8		EPA 8260D	Total/NA
1,2,4-Trichlorobenzene	240		8.0	3.3	ug/L	8		EPA 8260D	Total/NA
1,2-Dichlorobenzene	180		8.0	6.3	ug/L	8		EPA 8260D	Total/NA
1,3-Dichlorobenzene	310		8.0	6.2	ug/L	8		EPA 8260D	Total/NA
1,4-Dichlorobenzene	140		8.0	6.7	ug/L	8		EPA 8260D	Total/NA
2-Butanone (MEK)	32	J B	80	11	ug/L	8		EPA 8260D	Total/NA
Acetone	44	J	80	24	ug/L	8		EPA 8260D	Total/NA
Benzene	17		8.0	3.3	ug/L	8		EPA 8260D	Total/NA
Chlorobenzene	150		8.0	6.0	ug/L	8		EPA 8260D	Total/NA

Client Sample ID: MW-2A
Lab Sample ID: 480-237182-37

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2-Dichlorobenzene	1600		200	160	ug/L	200		EPA 8260D	Total/NA
1,3-Dichlorobenzene	410		200	160	ug/L	200		EPA 8260D	Total/NA
1,4-Dichlorobenzene	2000		200	170	ug/L	200		EPA 8260D	Total/NA
2-Butanone (MEK)	800	J B	2000	260	ug/L	200		EPA 8260D	Total/NA
Benzene	110	J	200	82	ug/L	200		EPA 8260D	Total/NA
Chlorobenzene	4500		200	150	ug/L	200		EPA 8260D	Total/NA

This Detection Summary does not include radiochemical test results.

Client Sample ID: OW-18A
Lab Sample ID: 480-237182-38

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2-Dichlorobenzene	1700		500	400	ug/L	500		EPA 8260D	Total/NA
1,3-Dichlorobenzene	1400		500	390	ug/L	500		EPA 8260D	Total/NA
1,4-Dichlorobenzene	11000		500	420	ug/L	500		EPA 8260D	Total/NA
2-Butanone (MEK)	1800	J B	5000	660	ug/L	500		EPA 8260D	Total/NA
Benzene	310	J	500	210	ug/L	500		EPA 8260D	Total/NA
Chlorobenzene	11000		500	380	ug/L	500		EPA 8260D	Total/NA

Client Sample ID: OW-11B
Lab Sample ID: 480-237182-39

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,3-Trichlorobenzene	550		200	82	ug/L	200		EPA 8260D	Total/NA
1,2,4-Trichlorobenzene	1500		200	82	ug/L	200		EPA 8260D	Total/NA
1,2-Dichlorobenzene	6700		200	160	ug/L	200		EPA 8260D	Total/NA
1,3-Dichlorobenzene	2400		200	160	ug/L	200		EPA 8260D	Total/NA
1,4-Dichlorobenzene	7200		200	170	ug/L	200		EPA 8260D	Total/NA
2-Butanone (MEK)	760	J B	2000	260	ug/L	200		EPA 8260D	Total/NA
Benzene	1600		200	82	ug/L	200		EPA 8260D	Total/NA
Chlorobenzene	3700		200	150	ug/L	200		EPA 8260D	Total/NA

Client Sample ID: OW-111B
Lab Sample ID: 480-237182-40

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,2,3-Trichlorobenzene	550		200	82	ug/L	200		EPA 8260D	Total/NA
1,2,4-Trichlorobenzene	1500		200	82	ug/L	200		EPA 8260D	Total/NA
1,2-Dichlorobenzene	6800		200	160	ug/L	200		EPA 8260D	Total/NA
1,3-Dichlorobenzene	2500		200	160	ug/L	200		EPA 8260D	Total/NA
1,4-Dichlorobenzene	7200		200	170	ug/L	200		EPA 8260D	Total/NA
2-Butanone (MEK)	850	J B	2000	260	ug/L	200		EPA 8260D	Total/NA
Benzene	1600		200	82	ug/L	200		EPA 8260D	Total/NA
Chlorobenzene	3600		200	150	ug/L	200		EPA 8260D	Total/NA

This Detection Summary does not include radiochemical test results.

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-26B
Lab Sample ID: 480-237182-1
Date Collected: 03/24/26 10:00
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		2.0	0.70	ug/L			03/26/26 17:22	2
1,1,1-Trichloroethane	ND		2.0	1.6	ug/L			03/26/26 17:22	2
1,1,2,2-Tetrachloroethane	ND		2.0	0.42	ug/L			03/26/26 17:22	2
1,1,2-Trichloroethane	ND		2.0	0.46	ug/L			03/26/26 17:22	2
1,1-Dichloroethane	**0.94**	**J**	2.0	0.76	ug/L			03/26/26 17:22	2
1,1-Dichloroethene	ND		2.0	0.58	ug/L			03/26/26 17:22	2
1,1-Dichloropropene	ND		2.0	1.4	ug/L			03/26/26 17:22	2
1,2,3-Trichlorobenzene	ND		2.0	0.82	ug/L			03/26/26 17:22	2
1,2,3-Trichloropropane	ND		2.0	1.8	ug/L			03/26/26 17:22	2
1,2,4-Trichlorobenzene	ND		2.0	0.82	ug/L			03/26/26 17:22	2
1,2,4-Trimethylbenzene	ND		2.0	1.5	ug/L			03/26/26 17:22	2
1,2-Dibromo-3-Chloropropane	ND		2.0	0.78	ug/L			03/26/26 17:22	2
1,2-Dichlorobenzene	ND		2.0	1.6	ug/L			03/26/26 17:22	2
1,2-Dichloroethane	ND		2.0	0.42	ug/L			03/26/26 17:22	2
1,2-Dichloropropane	ND		2.0	1.4	ug/L			03/26/26 17:22	2
1,3,5-Trimethylbenzene	ND		2.0	1.5	ug/L			03/26/26 17:22	2
1,3-Dichlorobenzene	ND		2.0	1.6	ug/L			03/26/26 17:22	2
1,3-Dichloropropane	ND		2.0	1.5	ug/L			03/26/26 17:22	2
1,4-Dichlorobenzene	ND		2.0	1.7	ug/L			03/26/26 17:22	2
2,2-Dichloropropane	ND		2.0	0.80	ug/L			03/26/26 17:22	2
2-Butanone (MEK)	**7.4**	**J B**	20	2.6	ug/L			03/26/26 17:22	2
2-Chloroethyl vinyl ether	ND		10	1.9	ug/L			03/26/26 17:22	2
o-Chlorotoluene	ND		2.0	1.7	ug/L			03/26/26 17:22	2
2-Hexanone	ND		10	2.5	ug/L			03/26/26 17:22	2
p-Chlorotoluene	ND		2.0	1.7	ug/L			03/26/26 17:22	2
p-Cymene	ND		2.0	0.62	ug/L			03/26/26 17:22	2
4-Methyl-2-pentanone (MIBK)	ND		10	4.2	ug/L			03/26/26 17:22	2
Acetone	ND		20	6.0	ug/L			03/26/26 17:22	2
Benzene	ND		2.0	0.82	ug/L			03/26/26 17:22	2
Bromobenzene	ND		2.0	1.6	ug/L			03/26/26 17:22	2
Bromoform	ND		2.0	0.52	ug/L			03/26/26 17:22	2
Bromomethane	ND		2.0	1.4	ug/L			03/26/26 17:22	2
Carbon disulfide	ND		2.0	0.38	ug/L			03/26/26 17:22	2
Carbon tetrachloride	ND		2.0	0.54	ug/L			03/26/26 17:22	2
Chlorobenzene	ND		2.0	1.5	ug/L			03/26/26 17:22	2
Bromochloromethane	ND		2.0	1.7	ug/L			03/26/26 17:22	2
Chlorodibromomethane	ND		2.0	0.64	ug/L			03/26/26 17:22	2
Chloroethane	ND		2.0	0.64	ug/L			03/26/26 17:22	2
Chloroform	ND		2.0	0.68	ug/L			03/26/26 17:22	2
Chloromethane	ND		2.0	0.70	ug/L			03/26/26 17:22	2
cis-1,2-Dichloroethene	**4.3**		2.0	1.6	ug/L			03/26/26 17:22	2
Bromodichloromethane	ND		2.0	0.78	ug/L			03/26/26 17:22	2
Dichlorodifluoromethane	ND		2.0	1.4	ug/L			03/26/26 17:22	2
Ethylbenzene	ND		2.0	1.5	ug/L			03/26/26 17:22	2
1,2-Dibromoethane	ND		2.0	1.5	ug/L			03/26/26 17:22	2
Hexachlorobutadiene	ND		4.0	0.56	ug/L			03/26/26 17:22	2
Isopropylbenzene	ND		2.0	1.6	ug/L			03/26/26 17:22	2
Methyl tert-butyl ether	ND		2.0	0.32	ug/L			03/26/26 17:22	2
Methylene Chloride	ND		2.0	0.88	ug/L			03/26/26 17:22	2

Client Sample ID: OW-26B

Lab Sample ID: 480-237182-1

Date Collected: 03/24/26 10:00

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
m-Xylene & p-Xylene	ND		4.0	1.3	ug/L			03/26/26 17:22	2
Naphthalene	ND		2.0	0.86	ug/L			03/26/26 17:22	2
n-Butylbenzene	ND		2.0	1.3	ug/L			03/26/26 17:22	2
N-Propylbenzene	ND		2.0	1.4	ug/L			03/26/26 17:22	2
o-Xylene	ND		2.0	1.5	ug/L			03/26/26 17:22	2
sec-Butylbenzene	ND		2.0	1.5	ug/L			03/26/26 17:22	2
Tetrachloroethene	**45**		2.0	0.72	ug/L			03/26/26 17:22	2
Toluene	ND		2.0	1.0	ug/L			03/26/26 17:22	2
trans-1,2-Dichloroethene	ND		2.0	1.8	ug/L			03/26/26 17:22	2
trans-1,3-Dichloropropene	ND		2.0	0.74	ug/L			03/26/26 17:22	2
Trichloroethene	**2.8**		2.0	0.92	ug/L			03/26/26 17:22	2
Trichlorofluoromethane	ND		2.0	1.8	ug/L			03/26/26 17:22	2
Vinyl acetate	ND		10	1.7	ug/L			03/26/26 17:22	2
Vinyl chloride	ND		2.0	1.8	ug/L			03/26/26 17:22	2
cis-1,3-Dichloropropene	ND		2.0	0.72	ug/L			03/26/26 17:22	2
Styrene	ND		2.0	1.5	ug/L			03/26/26 17:22	2
tert-Butylbenzene	ND		2.0	1.6	ug/L			03/26/26 17:22	2

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*110*		*77 - 120*		*03/26/26 17:22*	*2*
4-Bromofluorobenzene (Surr)	*87*		*73 - 120*		*03/26/26 17:22*	*2*
Toluene-d8 (Surr)	*104*		*80 - 120*		*03/26/26 17:22*	*2*
Dibromofluoromethane (Surr)	*101*		*75 - 123*		*03/26/26 17:22*	*2*

Client Sample ID: OW-30B

Lab Sample ID: 480-237182-2

Date Collected: 03/24/26 10:20

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			03/26/26 17:45	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			03/26/26 17:45	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			03/26/26 17:45	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			03/26/26 17:45	1
1,1-Dichloroethane	**3.1**		1.0	0.38	ug/L			03/26/26 17:45	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			03/26/26 17:45	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			03/26/26 17:45	1
1,2,3-Trichlorobenzene	**1.2**		1.0	0.41	ug/L			03/26/26 17:45	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			03/26/26 17:45	1
1,2,4-Trichlorobenzene	**1.1**		1.0	0.41	ug/L			03/26/26 17:45	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			03/26/26 17:45	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			03/26/26 17:45	1
1,2-Dichlorobenzene	**3.1**		1.0	0.79	ug/L			03/26/26 17:45	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			03/26/26 17:45	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			03/26/26 17:45	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			03/26/26 17:45	1
1,3-Dichlorobenzene	**9.3**		1.0	0.78	ug/L			03/26/26 17:45	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			03/26/26 17:45	1
1,4-Dichlorobenzene	**7.6**		1.0	0.84	ug/L			03/26/26 17:45	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			03/26/26 17:45	1

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-30B
Lab Sample ID: 480-237182-2
Date Collected: 03/24/26 10:20
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
2-Butanone (MEK)	**3.9**	**J B**	10	1.3	ug/L			03/26/26 17:45	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			03/26/26 17:45	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			03/26/26 17:45	1
2-Hexanone	ND		5.0	1.2	ug/L			03/26/26 17:45	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			03/26/26 17:45	1
p-Cymene	ND		1.0	0.31	ug/L			03/26/26 17:45	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			03/26/26 17:45	1
Acetone	ND		10	3.0	ug/L			03/26/26 17:45	1
Benzene	**0.88**	**J**	1.0	0.41	ug/L			03/26/26 17:45	1
Bromobenzene	ND		1.0	0.80	ug/L			03/26/26 17:45	1
Bromoform	ND		1.0	0.26	ug/L			03/26/26 17:45	1
Bromomethane	ND		1.0	0.69	ug/L			03/26/26 17:45	1
Carbon disulfide	ND		1.0	0.19	ug/L			03/26/26 17:45	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			03/26/26 17:45	1
Chlorobenzene	**6.2**		1.0	0.75	ug/L			03/26/26 17:45	1
Bromochloromethane	ND		1.0	0.87	ug/L			03/26/26 17:45	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			03/26/26 17:45	1
Chloroethane	ND		1.0	0.32	ug/L			03/26/26 17:45	1
Chloroform	ND		1.0	0.34	ug/L			03/26/26 17:45	1
Chloromethane	ND		1.0	0.35	ug/L			03/26/26 17:45	1
cis-1,2-Dichloroethene	**11**		1.0	0.81	ug/L			03/26/26 17:45	1
Bromodichloromethane	ND		1.0	0.39	ug/L			03/26/26 17:45	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			03/26/26 17:45	1
Ethylbenzene	ND		1.0	0.74	ug/L			03/26/26 17:45	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			03/26/26 17:45	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			03/26/26 17:45	1
Isopropylbenzene	ND		1.0	0.79	ug/L			03/26/26 17:45	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			03/26/26 17:45	1
Methylene Chloride	ND		1.0	0.44	ug/L			03/26/26 17:45	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			03/26/26 17:45	1
Naphthalene	ND		1.0	0.43	ug/L			03/26/26 17:45	1
n-Butylbenzene	ND		1.0	0.64	ug/L			03/26/26 17:45	1
N-Propylbenzene	ND		1.0	0.69	ug/L			03/26/26 17:45	1
o-Xylene	ND		1.0	0.76	ug/L			03/26/26 17:45	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			03/26/26 17:45	1
Tetrachloroethene	**26**		1.0	0.36	ug/L			03/26/26 17:45	1
Toluene	ND		1.0	0.51	ug/L			03/26/26 17:45	1
trans-1,2-Dichloroethene	**4.0**		1.0	0.90	ug/L			03/26/26 17:45	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			03/26/26 17:45	1
Trichloroethene	**6.4**		1.0	0.46	ug/L			03/26/26 17:45	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			03/26/26 17:45	1
Vinyl acetate	ND		5.0	0.85	ug/L			03/26/26 17:45	1
Vinyl chloride	**3.7**		1.0	0.90	ug/L			03/26/26 17:45	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			03/26/26 17:45	1
Styrene	ND		1.0	0.73	ug/L			03/26/26 17:45	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			03/26/26 17:45	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*107*		*77 - 120*		*03/26/26 17:45*	*1*
4-Bromofluorobenzene (Surr)	*84*		*73 - 120*		*03/26/26 17:45*	*1*

Client Sample ID: OW-30B

Lab Sample ID: 480-237182-2

Date Collected: 03/24/26 10:20
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
Toluene-d8 (Surr)	*106*		*80 - 120*		*03/26/26 17:45*	*1*
Dibromofluoromethane (Surr)	*99*		*75 - 123*		*03/26/26 17:45*	*1*

Client Sample ID: MW-5A

Lab Sample ID: 480-237182-3

Date Collected: 03/24/26 10:35
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			03/26/26 18:08	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			03/26/26 18:08	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			03/26/26 18:08	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			03/26/26 18:08	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			03/26/26 18:08	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			03/26/26 18:08	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			03/26/26 18:08	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			03/26/26 18:08	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			03/26/26 18:08	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			03/26/26 18:08	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			03/26/26 18:08	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			03/26/26 18:08	1
1,2-Dichlorobenzene	ND		1.0	0.79	ug/L			03/26/26 18:08	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			03/26/26 18:08	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			03/26/26 18:08	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			03/26/26 18:08	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			03/26/26 18:08	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			03/26/26 18:08	1
1,4-Dichlorobenzene	ND		1.0	0.84	ug/L			03/26/26 18:08	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			03/26/26 18:08	1
2-Butanone (MEK)	**3.6**	**J B**	10	1.3	ug/L			03/26/26 18:08	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			03/26/26 18:08	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			03/26/26 18:08	1
2-Hexanone	ND		5.0	1.2	ug/L			03/26/26 18:08	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			03/26/26 18:08	1
p-Cymene	ND		1.0	0.31	ug/L			03/26/26 18:08	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			03/26/26 18:08	1
Acetone	ND		10	3.0	ug/L			03/26/26 18:08	1
Benzene	ND		1.0	0.41	ug/L			03/26/26 18:08	1
Bromobenzene	ND		1.0	0.80	ug/L			03/26/26 18:08	1
Bromoform	ND		1.0	0.26	ug/L			03/26/26 18:08	1
Bromomethane	ND		1.0	0.69	ug/L			03/26/26 18:08	1
Carbon disulfide	ND		1.0	0.19	ug/L			03/26/26 18:08	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			03/26/26 18:08	1
Chlorobenzene	ND		1.0	0.75	ug/L			03/26/26 18:08	1
Bromochloromethane	ND		1.0	0.87	ug/L			03/26/26 18:08	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			03/26/26 18:08	1
Chloroethane	ND		1.0	0.32	ug/L			03/26/26 18:08	1
Chloroform	ND		1.0	0.34	ug/L			03/26/26 18:08	1
Chloromethane	ND		1.0	0.35	ug/L			03/26/26 18:08	1

Client Sample ID: MW-5A

Lab Sample ID: 480-237182-3

Date Collected: 03/24/26 10:35

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			03/26/26 18:08	1
Bromodichloromethane	ND		1.0	0.39	ug/L			03/26/26 18:08	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			03/26/26 18:08	1
Ethylbenzene	ND		1.0	0.74	ug/L			03/26/26 18:08	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			03/26/26 18:08	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			03/26/26 18:08	1
Isopropylbenzene	ND		1.0	0.79	ug/L			03/26/26 18:08	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			03/26/26 18:08	1
Methylene Chloride	ND		1.0	0.44	ug/L			03/26/26 18:08	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			03/26/26 18:08	1
Naphthalene	ND		1.0	0.43	ug/L			03/26/26 18:08	1
n-Butylbenzene	ND		1.0	0.64	ug/L			03/26/26 18:08	1
N-Propylbenzene	ND		1.0	0.69	ug/L			03/26/26 18:08	1
o-Xylene	ND		1.0	0.76	ug/L			03/26/26 18:08	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			03/26/26 18:08	1
Tetrachloroethene	**3.4**		1.0	0.36	ug/L			03/26/26 18:08	1
Toluene	ND		1.0	0.51	ug/L			03/26/26 18:08	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			03/26/26 18:08	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			03/26/26 18:08	1
Trichloroethene	ND		1.0	0.46	ug/L			03/26/26 18:08	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			03/26/26 18:08	1
Vinyl acetate	ND		5.0	0.85	ug/L			03/26/26 18:08	1
Vinyl chloride	ND		1.0	0.90	ug/L			03/26/26 18:08	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			03/26/26 18:08	1
Styrene	ND		1.0	0.73	ug/L			03/26/26 18:08	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			03/26/26 18:08	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*110*		*77 - 120*		*03/26/26 18:08*	*1*
4-Bromofluorobenzene (Surr)	*84*		*73 - 120*		*03/26/26 18:08*	*1*
Toluene-d8 (Surr)	*106*		*80 - 120*		*03/26/26 18:08*	*1*
Dibromofluoromethane (Surr)	*101*		*75 - 123*		*03/26/26 18:08*	*1*

Client Sample ID: MW-5C

Lab Sample ID: 480-237182-4

Date Collected: 03/24/26 10:40

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		40	14	ug/L			03/26/26 18:32	40
1,1,1-Trichloroethane	ND		40	33	ug/L			03/26/26 18:32	40
1,1,2,2-Tetrachloroethane	ND		40	8.4	ug/L			03/26/26 18:32	40
1,1,2-Trichloroethane	ND		40	9.2	ug/L			03/26/26 18:32	40
1,1-Dichloroethane	ND		40	15	ug/L			03/26/26 18:32	40
1,1-Dichloroethene	ND		40	12	ug/L			03/26/26 18:32	40
1,1-Dichloropropene	ND		40	29	ug/L			03/26/26 18:32	40
1,2,3-Trichlorobenzene	ND		40	16	ug/L			03/26/26 18:32	40
1,2,3-Trichloropropane	ND		40	36	ug/L			03/26/26 18:32	40
1,2,4-Trichlorobenzene	ND		40	16	ug/L			03/26/26 18:32	40
1,2,4-Trimethylbenzene	ND		40	30	ug/L			03/26/26 18:32	40

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: MW-5C
Lab Sample ID: 480-237182-4
Date Collected: 03/24/26 10:40
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,2-Dibromo-3-Chloropropane	ND		40	16	ug/L			03/26/26 18:32	40
1,2-Dichlorobenzene	**340**		40	32	ug/L			03/26/26 18:32	40
1,2-Dichloroethane	ND		40	8.4	ug/L			03/26/26 18:32	40
1,2-Dichloropropane	ND		40	29	ug/L			03/26/26 18:32	40
1,3,5-Trimethylbenzene	ND		40	31	ug/L			03/26/26 18:32	40
1,3-Dichlorobenzene	**1100**		40	31	ug/L			03/26/26 18:32	40
1,3-Dichloropropane	ND		40	30	ug/L			03/26/26 18:32	40
1,4-Dichlorobenzene	**2400**		40	34	ug/L			03/26/26 18:32	40
2,2-Dichloropropane	ND		40	16	ug/L			03/26/26 18:32	40
2-Butanone (MEK)	**140**	**J B**	400	53	ug/L			03/26/26 18:32	40
2-Chloroethyl vinyl ether	ND		200	38	ug/L			03/26/26 18:32	40
o-Chlorotoluene	ND		40	34	ug/L			03/26/26 18:32	40
2-Hexanone	ND		200	50	ug/L			03/26/26 18:32	40
p-Chlorotoluene	ND		40	34	ug/L			03/26/26 18:32	40
p-Cymene	ND		40	12	ug/L			03/26/26 18:32	40
4-Methyl-2-pentanone (MIBK)	ND		200	84	ug/L			03/26/26 18:32	40
Acetone	ND		400	120	ug/L			03/26/26 18:32	40
Benzene	**79**		40	16	ug/L			03/26/26 18:32	40
Bromobenzene	ND		40	32	ug/L			03/26/26 18:32	40
Bromoform	ND		40	10	ug/L			03/26/26 18:32	40
Bromomethane	ND		40	28	ug/L			03/26/26 18:32	40
Carbon disulfide	ND		40	7.6	ug/L			03/26/26 18:32	40
Carbon tetrachloride	ND		40	11	ug/L			03/26/26 18:32	40
Chlorobenzene	**2800**		40	30	ug/L			03/26/26 18:32	40
Bromochloromethane	ND		40	35	ug/L			03/26/26 18:32	40
Chlorodibromomethane	ND		40	13	ug/L			03/26/26 18:32	40
Chloroethane	ND		40	13	ug/L			03/26/26 18:32	40
Chloroform	ND		40	14	ug/L			03/26/26 18:32	40
Chloromethane	ND		40	14	ug/L			03/26/26 18:32	40
cis-1,2-Dichloroethene	ND		40	32	ug/L			03/26/26 18:32	40
Bromodichloromethane	ND		40	16	ug/L			03/26/26 18:32	40
Dichlorodifluoromethane	ND		40	27	ug/L			03/26/26 18:32	40
Ethylbenzene	ND		40	30	ug/L			03/26/26 18:32	40
1,2-Dibromoethane	ND		40	29	ug/L			03/26/26 18:32	40
Hexachlorobutadiene	ND		80	11	ug/L			03/26/26 18:32	40
Isopropylbenzene	ND		40	32	ug/L			03/26/26 18:32	40
Methyl tert-butyl ether	ND		40	6.4	ug/L			03/26/26 18:32	40
Methylene Chloride	ND		40	18	ug/L			03/26/26 18:32	40
m-Xylene & p-Xylene	ND		80	26	ug/L			03/26/26 18:32	40
Naphthalene	ND		40	17	ug/L			03/26/26 18:32	40
n-Butylbenzene	ND		40	26	ug/L			03/26/26 18:32	40
N-Propylbenzene	ND		40	28	ug/L			03/26/26 18:32	40
o-Xylene	ND		40	30	ug/L			03/26/26 18:32	40
sec-Butylbenzene	ND		40	30	ug/L			03/26/26 18:32	40
Tetrachloroethene	ND		40	14	ug/L			03/26/26 18:32	40
Toluene	ND		40	20	ug/L			03/26/26 18:32	40
trans-1,2-Dichloroethene	ND		40	36	ug/L			03/26/26 18:32	40
trans-1,3-Dichloropropene	ND		40	15	ug/L			03/26/26 18:32	40
Trichloroethene	ND		40	18	ug/L			03/26/26 18:32	40

Client Sample ID: MW-5C
Lab Sample ID: 480-237182-4

Date Collected: 03/24/26 10:40
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Trichlorofluoromethane	ND		40	35	ug/L			03/26/26 18:32	40
Vinyl acetate	ND		200	34	ug/L			03/26/26 18:32	40
Vinyl chloride	ND		40	36	ug/L			03/26/26 18:32	40
cis-1,3-Dichloropropene	ND		40	14	ug/L			03/26/26 18:32	40
Styrene	ND		40	29	ug/L			03/26/26 18:32	40
tert-Butylbenzene	ND		40	32	ug/L			03/26/26 18:32	40

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*108*		*77 - 120*		*03/26/26 18:32*	*40*
4-Bromofluorobenzene (Surr)	*86*		*73 - 120*		*03/26/26 18:32*	*40*
Toluene-d8 (Surr)	*103*		*80 - 120*		*03/26/26 18:32*	*40*
Dibromofluoromethane (Surr)	*98*		*75 - 123*		*03/26/26 18:32*	*40*

Client Sample ID: MW-5CD
Lab Sample ID: 480-237182-5

Date Collected: 03/24/26 10:45
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		10	3.5	ug/L			03/26/26 18:54	10
1,1,1-Trichloroethane	ND		10	8.2	ug/L			03/26/26 18:54	10
1,1,2,2-Tetrachloroethane	ND		10	2.1	ug/L			03/26/26 18:54	10
1,1,2-Trichloroethane	ND		10	2.3	ug/L			03/26/26 18:54	10
1,1-Dichloroethane	ND		10	3.8	ug/L			03/26/26 18:54	10
1,1-Dichloroethene	ND		10	2.9	ug/L			03/26/26 18:54	10
1,1-Dichloropropene	ND		10	7.2	ug/L			03/26/26 18:54	10
1,2,3-Trichlorobenzene	ND		10	4.1	ug/L			03/26/26 18:54	10
1,2,3-Trichloropropane	ND		10	8.9	ug/L			03/26/26 18:54	10
1,2,4-Trichlorobenzene	ND		10	4.1	ug/L			03/26/26 18:54	10
1,2,4-Trimethylbenzene	ND		10	7.5	ug/L			03/26/26 18:54	10
1,2-Dibromo-3-Chloropropane	ND		10	3.9	ug/L			03/26/26 18:54	10
1,2-Dichlorobenzene	ND		10	7.9	ug/L			03/26/26 18:54	10
1,2-Dichloroethane	ND		10	2.1	ug/L			03/26/26 18:54	10
1,2-Dichloropropane	ND		10	7.2	ug/L			03/26/26 18:54	10
1,3,5-Trimethylbenzene	ND		10	7.7	ug/L			03/26/26 18:54	10
1,3-Dichlorobenzene	ND		10	7.8	ug/L			03/26/26 18:54	10
1,3-Dichloropropane	ND		10	7.5	ug/L			03/26/26 18:54	10
1,4-Dichlorobenzene	ND		10	8.4	ug/L			03/26/26 18:54	10
2,2-Dichloropropane	ND		10	4.0	ug/L			03/26/26 18:54	10
2-Butanone (MEK)	**37**	**J B**	100	13	ug/L			03/26/26 18:54	10
2-Chloroethyl vinyl ether	ND		50	9.6	ug/L			03/26/26 18:54	10
o-Chlorotoluene	ND		10	8.6	ug/L			03/26/26 18:54	10
2-Hexanone	ND		50	12	ug/L			03/26/26 18:54	10
p-Chlorotoluene	ND		10	8.4	ug/L			03/26/26 18:54	10
p-Cymene	ND		10	3.1	ug/L			03/26/26 18:54	10
4-Methyl-2-pentanone (MIBK)	ND		50	21	ug/L			03/26/26 18:54	10
Acetone	ND		100	30	ug/L			03/26/26 18:54	10
Benzene	**25**		10	4.1	ug/L			03/26/26 18:54	10
Bromobenzene	ND		10	8.0	ug/L			03/26/26 18:54	10
Bromoform	ND		10	2.6	ug/L			03/26/26 18:54	10

Client Sample ID: MW-5CD
Lab Sample ID: 480-237182-5

Date Collected: 03/24/26 10:45
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Bromomethane	ND		10	6.9	ug/L			03/26/26 18:54	10
Carbon disulfide	ND		10	1.9	ug/L			03/26/26 18:54	10
Carbon tetrachloride	ND		10	2.7	ug/L			03/26/26 18:54	10
Chlorobenzene	ND		10	7.5	ug/L			03/26/26 18:54	10
Bromochloromethane	ND		10	8.7	ug/L			03/26/26 18:54	10
Chlorodibromomethane	ND		10	3.2	ug/L			03/26/26 18:54	10
Chloroethane	ND		10	3.2	ug/L			03/26/26 18:54	10
Chloroform	ND		10	3.4	ug/L			03/26/26 18:54	10
Chloromethane	ND		10	3.5	ug/L			03/26/26 18:54	10
cis-1,2-Dichloroethene	**650**		10	8.1	ug/L			03/26/26 18:54	10
Bromodichloromethane	ND		10	3.9	ug/L			03/26/26 18:54	10
Dichlorodifluoromethane	ND		10	6.8	ug/L			03/26/26 18:54	10
Ethylbenzene	ND		10	7.4	ug/L			03/26/26 18:54	10
1,2-Dibromoethane	ND		10	7.3	ug/L			03/26/26 18:54	10
Hexachlorobutadiene	ND		20	2.8	ug/L			03/26/26 18:54	10
Isopropylbenzene	ND		10	7.9	ug/L			03/26/26 18:54	10
Methyl tert-butyl ether	ND		10	1.6	ug/L			03/26/26 18:54	10
Methylene Chloride	ND		10	4.4	ug/L			03/26/26 18:54	10
m-Xylene & p-Xylene	ND		20	6.6	ug/L			03/26/26 18:54	10
Naphthalene	ND		10	4.3	ug/L			03/26/26 18:54	10
n-Butylbenzene	ND		10	6.4	ug/L			03/26/26 18:54	10
N-Propylbenzene	ND		10	6.9	ug/L			03/26/26 18:54	10
o-Xylene	ND		10	7.6	ug/L			03/26/26 18:54	10
sec-Butylbenzene	ND		10	7.5	ug/L			03/26/26 18:54	10
Tetrachloroethene	ND		10	3.6	ug/L			03/26/26 18:54	10
Toluene	ND		10	5.1	ug/L			03/26/26 18:54	10
trans-1,2-Dichloroethene	**33**		10	9.0	ug/L			03/26/26 18:54	10
trans-1,3-Dichloropropene	ND		10	3.7	ug/L			03/26/26 18:54	10
Trichloroethene	ND		10	4.6	ug/L			03/26/26 18:54	10
Trichlorofluoromethane	ND		10	8.8	ug/L			03/26/26 18:54	10
Vinyl acetate	ND		50	8.5	ug/L			03/26/26 18:54	10
Vinyl chloride	**250**		10	9.0	ug/L			03/26/26 18:54	10
cis-1,3-Dichloropropene	ND		10	3.6	ug/L			03/26/26 18:54	10
Styrene	ND		10	7.3	ug/L			03/26/26 18:54	10
tert-Butylbenzene	ND		10	8.1	ug/L			03/26/26 18:54	10

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*111*		*77 - 120*		*03/26/26 18:54*	*10*
4-Bromofluorobenzene (Surr)	*86*		*73 - 120*		*03/26/26 18:54*	*10*
Toluene-d8 (Surr)	*106*		*80 - 120*		*03/26/26 18:54*	*10*
Dibromofluoromethane (Surr)	*103*		*75 - 123*		*03/26/26 18:54*	*10*

Client Sample ID: MW-5F
Lab Sample ID: 480-237182-6

Date Collected: 03/24/26 10:55
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		130	44	ug/L			03/27/26 15:39	125
1,1,1-Trichloroethane	ND		130	100	ug/L			03/27/26 15:39	125

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: MW-5F
Lab Sample ID: 480-237182-6
Date Collected: 03/24/26 10:55
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		130	26	ug/L			03/27/26 15:39	125
1,1,2-Trichloroethane	ND		130	29	ug/L			03/27/26 15:39	125
1,1-Dichloroethane	ND		130	48	ug/L			03/27/26 15:39	125
1,1-Dichloroethene	ND		130	36	ug/L			03/27/26 15:39	125
1,1-Dichloropropene	ND		130	90	ug/L			03/27/26 15:39	125
1,2,3-Trichlorobenzene	ND		130	51	ug/L			03/27/26 15:39	125
1,2,3-Trichloropropane	ND		130	110	ug/L			03/27/26 15:39	125
1,2,4-Trichlorobenzene	ND		130	51	ug/L			03/27/26 15:39	125
1,2,4-Trimethylbenzene	ND		130	94	ug/L			03/27/26 15:39	125
1,2-Dibromo-3-Chloropropane	ND		130	49	ug/L			03/27/26 15:39	125
1,2-Dichlorobenzene	**5700**		130	99	ug/L			03/27/26 15:39	125
1,2-Dichloroethane	ND		130	26	ug/L			03/27/26 15:39	125
1,2-Dichloropropane	ND		130	90	ug/L			03/27/26 15:39	125
1,3,5-Trimethylbenzene	ND		130	96	ug/L			03/27/26 15:39	125
1,3-Dichlorobenzene	**390**		130	98	ug/L			03/27/26 15:39	125
1,3-Dichloropropane	ND		130	94	ug/L			03/27/26 15:39	125
1,4-Dichlorobenzene	**2300**		130	110	ug/L			03/27/26 15:39	125
2,2-Dichloropropane	ND		130	50	ug/L			03/27/26 15:39	125
2-Butanone (MEK)	**520**	**J B**	1300	170	ug/L			03/27/26 15:39	125
2-Chloroethyl vinyl ether	ND		630	120	ug/L			03/27/26 15:39	125
o-Chlorotoluene	ND		130	110	ug/L			03/27/26 15:39	125
2-Hexanone	ND		630	160	ug/L			03/27/26 15:39	125
p-Chlorotoluene	ND		130	110	ug/L			03/27/26 15:39	125
p-Cymene	ND		130	39	ug/L			03/27/26 15:39	125
4-Methyl-2-pentanone (MIBK)	ND		630	260	ug/L			03/27/26 15:39	125
Acetone	ND		1300	380	ug/L			03/27/26 15:39	125
Benzene	**2500**		130	51	ug/L			03/27/26 15:39	125
Bromobenzene	ND		130	100	ug/L			03/27/26 15:39	125
Bromoform	ND		130	33	ug/L			03/27/26 15:39	125
Bromomethane	ND		130	86	ug/L			03/27/26 15:39	125
Carbon disulfide	ND		130	24	ug/L			03/27/26 15:39	125
Carbon tetrachloride	ND		130	34	ug/L			03/27/26 15:39	125
Chlorobenzene	**8000**		130	94	ug/L			03/27/26 15:39	125
Bromochloromethane	ND		130	110	ug/L			03/27/26 15:39	125
Chlorodibromomethane	ND		130	40	ug/L			03/27/26 15:39	125
Chloroethane	ND		130	40	ug/L			03/27/26 15:39	125
Chloroform	ND		130	43	ug/L			03/27/26 15:39	125
Chloromethane	ND		130	44	ug/L			03/27/26 15:39	125
cis-1,2-Dichloroethene	ND		130	100	ug/L			03/27/26 15:39	125
Bromodichloromethane	ND		130	49	ug/L			03/27/26 15:39	125
Dichlorodifluoromethane	ND		130	85	ug/L			03/27/26 15:39	125
Ethylbenzene	ND		130	93	ug/L			03/27/26 15:39	125
1,2-Dibromoethane	ND		130	91	ug/L			03/27/26 15:39	125
Hexachlorobutadiene	ND		250	35	ug/L			03/27/26 15:39	125
Isopropylbenzene	ND		130	99	ug/L			03/27/26 15:39	125
Methyl tert-butyl ether	ND		130	20	ug/L			03/27/26 15:39	125
Methylene Chloride	ND		130	55	ug/L			03/27/26 15:39	125
m-Xylene & p-Xylene	ND		250	83	ug/L			03/27/26 15:39	125
Naphthalene	ND		130	54	ug/L			03/27/26 15:39	125

Client Sample ID: MW-5F

Lab Sample ID: 480-237182-6

Date Collected: 03/24/26 10:55

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
n-Butylbenzene	ND		130	80	ug/L			03/27/26 15:39	125
N-Propylbenzene	ND		130	86	ug/L			03/27/26 15:39	125
o-Xylene	ND		130	95	ug/L			03/27/26 15:39	125
sec-Butylbenzene	ND		130	94	ug/L			03/27/26 15:39	125
Tetrachloroethene	ND		130	45	ug/L			03/27/26 15:39	125
Toluene	ND		130	64	ug/L			03/27/26 15:39	125
trans-1,2-Dichloroethene	ND		130	110	ug/L			03/27/26 15:39	125
trans-1,3-Dichloropropene	ND		130	46	ug/L			03/27/26 15:39	125
Trichloroethene	ND		130	58	ug/L			03/27/26 15:39	125
Trichlorofluoromethane	ND		130	110	ug/L			03/27/26 15:39	125
Vinyl acetate	ND		630	110	ug/L			03/27/26 15:39	125
Vinyl chloride	ND		130	110	ug/L			03/27/26 15:39	125
cis-1,3-Dichloropropene	ND		130	45	ug/L			03/27/26 15:39	125
Styrene	ND		130	91	ug/L			03/27/26 15:39	125
tert-Butylbenzene	ND		130	100	ug/L			03/27/26 15:39	125

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*112*		*77 - 120*		*03/27/26 15:39*	*125*
4-Bromofluorobenzene (Surr)	*86*		*73 - 120*		*03/27/26 15:39*	*125*
Toluene-d8 (Surr)	*102*		*80 - 120*		*03/27/26 15:39*	*125*
Dibromofluoromethane (Surr)	*101*		*75 - 123*		*03/27/26 15:39*	*125*

Client Sample ID: OW-12B

Lab Sample ID: 480-237182-7

Date Collected: 03/24/26 11:30

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		40	14	ug/L			03/26/26 19:41	40
1,1,1-Trichloroethane	ND		40	33	ug/L			03/26/26 19:41	40
1,1,2,2-Tetrachloroethane	ND		40	8.4	ug/L			03/26/26 19:41	40
1,1,2-Trichloroethane	ND		40	9.2	ug/L			03/26/26 19:41	40
1,1-Dichloroethane	ND		40	15	ug/L			03/26/26 19:41	40
1,1-Dichloroethene	ND		40	12	ug/L			03/26/26 19:41	40
1,1-Dichloropropene	ND		40	29	ug/L			03/26/26 19:41	40
1,2,3-Trichlorobenzene	ND		40	16	ug/L			03/26/26 19:41	40
1,2,3-Trichloropropane	ND		40	36	ug/L			03/26/26 19:41	40
1,2,4-Trichlorobenzene	**28**	**J**	40	16	ug/L			03/26/26 19:41	40
1,2,4-Trimethylbenzene	ND		40	30	ug/L			03/26/26 19:41	40
1,2-Dibromo-3-Chloropropane	ND		40	16	ug/L			03/26/26 19:41	40
1,2-Dichlorobenzene	**1100**		40	32	ug/L			03/26/26 19:41	40
1,2-Dichloroethane	ND		40	8.4	ug/L			03/26/26 19:41	40
1,2-Dichloropropane	ND		40	29	ug/L			03/26/26 19:41	40
1,3,5-Trimethylbenzene	ND		40	31	ug/L			03/26/26 19:41	40
1,3-Dichlorobenzene	**750**		40	31	ug/L			03/26/26 19:41	40
1,3-Dichloropropane	ND		40	30	ug/L			03/26/26 19:41	40
1,4-Dichlorobenzene	**2000**		40	34	ug/L			03/26/26 19:41	40
2,2-Dichloropropane	ND		40	16	ug/L			03/26/26 19:41	40
2-Butanone (MEK)	**150**	**J B**	400	53	ug/L			03/26/26 19:41	40
2-Chloroethyl vinyl ether	ND		200	38	ug/L			03/26/26 19:41	40

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-12B
Lab Sample ID: 480-237182-7
Date Collected: 03/24/26 11:30
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
o-Chlorotoluene	ND		40	34	ug/L			03/26/26 19:41	40
2-Hexanone	ND		200	50	ug/L			03/26/26 19:41	40
p-Chlorotoluene	ND		40	34	ug/L			03/26/26 19:41	40
p-Cymene	ND		40	12	ug/L			03/26/26 19:41	40
4-Methyl-2-pentanone (MIBK)	ND		200	84	ug/L			03/26/26 19:41	40
Acetone	ND		400	120	ug/L			03/26/26 19:41	40
Benzene	**270**		40	16	ug/L			03/26/26 19:41	40
Bromobenzene	ND		40	32	ug/L			03/26/26 19:41	40
Bromoform	ND		40	10	ug/L			03/26/26 19:41	40
Bromomethane	ND		40	28	ug/L			03/26/26 19:41	40
Carbon disulfide	ND		40	7.6	ug/L			03/26/26 19:41	40
Carbon tetrachloride	ND		40	11	ug/L			03/26/26 19:41	40
Chlorobenzene	**3300**		40	30	ug/L			03/26/26 19:41	40
Bromochloromethane	ND		40	35	ug/L			03/26/26 19:41	40
Chlorodibromomethane	ND		40	13	ug/L			03/26/26 19:41	40
Chloroethane	ND		40	13	ug/L			03/26/26 19:41	40
Chloroform	ND		40	14	ug/L			03/26/26 19:41	40
Chloromethane	ND		40	14	ug/L			03/26/26 19:41	40
cis-1,2-Dichloroethene	**67**		40	32	ug/L			03/26/26 19:41	40
Bromodichloromethane	ND		40	16	ug/L			03/26/26 19:41	40
Dichlorodifluoromethane	ND		40	27	ug/L			03/26/26 19:41	40
Ethylbenzene	ND		40	30	ug/L			03/26/26 19:41	40
1,2-Dibromoethane	ND		40	29	ug/L			03/26/26 19:41	40
Hexachlorobutadiene	ND		80	11	ug/L			03/26/26 19:41	40
Isopropylbenzene	ND		40	32	ug/L			03/26/26 19:41	40
Methyl tert-butyl ether	ND		40	6.4	ug/L			03/26/26 19:41	40
Methylene Chloride	ND		40	18	ug/L			03/26/26 19:41	40
m-Xylene & p-Xylene	ND		80	26	ug/L			03/26/26 19:41	40
Naphthalene	ND		40	17	ug/L			03/26/26 19:41	40
n-Butylbenzene	ND		40	26	ug/L			03/26/26 19:41	40
N-Propylbenzene	ND		40	28	ug/L			03/26/26 19:41	40
o-Xylene	ND		40	30	ug/L			03/26/26 19:41	40
sec-Butylbenzene	ND		40	30	ug/L			03/26/26 19:41	40
Tetrachloroethene	ND		40	14	ug/L			03/26/26 19:41	40
Toluene	ND		40	20	ug/L			03/26/26 19:41	40
trans-1,2-Dichloroethene	ND		40	36	ug/L			03/26/26 19:41	40
trans-1,3-Dichloropropene	ND		40	15	ug/L			03/26/26 19:41	40
Trichloroethene	ND		40	18	ug/L			03/26/26 19:41	40
Trichlorofluoromethane	ND		40	35	ug/L			03/26/26 19:41	40
Vinyl acetate	ND		200	34	ug/L			03/26/26 19:41	40
Vinyl chloride	**84**		40	36	ug/L			03/26/26 19:41	40
cis-1,3-Dichloropropene	ND		40	14	ug/L			03/26/26 19:41	40
Styrene	ND		40	29	ug/L			03/26/26 19:41	40
tert-Butylbenzene	ND		40	32	ug/L			03/26/26 19:41	40

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*111*		*77 - 120*		*03/26/26 19:41*	*40*
4-Bromofluorobenzene (Surr)	*88*		*73 - 120*		*03/26/26 19:41*	*40*
Toluene-d8 (Surr)	*104*		*80 - 120*		*03/26/26 19:41*	*40*
Dibromofluoromethane (Surr)	*99*		*75 - 123*		*03/26/26 19:41*	*40*

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-9A
Lab Sample ID: 480-237182-8
Date Collected: 03/24/26 11:40
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		200	70	ug/L			03/26/26 20:04	200
1,1,1-Trichloroethane	ND		200	160	ug/L			03/26/26 20:04	200
1,1,2,2-Tetrachloroethane	ND		200	42	ug/L			03/26/26 20:04	200
1,1,2-Trichloroethane	ND		200	46	ug/L			03/26/26 20:04	200
1,1-Dichloroethane	ND		200	76	ug/L			03/26/26 20:04	200
1,1-Dichloroethene	ND		200	58	ug/L			03/26/26 20:04	200
1,1-Dichloropropene	ND		200	140	ug/L			03/26/26 20:04	200
1,2,3-Trichlorobenzene	ND		200	82	ug/L			03/26/26 20:04	200
1,2,3-Trichloropropane	ND		200	180	ug/L			03/26/26 20:04	200
1,2,4-Trichlorobenzene	ND		200	82	ug/L			03/26/26 20:04	200
1,2,4-Trimethylbenzene	ND		200	150	ug/L			03/26/26 20:04	200
1,2-Dibromo-3-Chloropropane	ND		200	78	ug/L			03/26/26 20:04	200
1,2-Dichlorobenzene	ND		200	160	ug/L			03/26/26 20:04	200
1,2-Dichloroethane	ND		200	42	ug/L			03/26/26 20:04	200
1,2-Dichloropropane	ND		200	140	ug/L			03/26/26 20:04	200
1,3,5-Trimethylbenzene	ND		200	150	ug/L			03/26/26 20:04	200
1,3-Dichlorobenzene	ND		200	160	ug/L			03/26/26 20:04	200
1,3-Dichloropropane	ND		200	150	ug/L			03/26/26 20:04	200
1,4-Dichlorobenzene	ND		200	170	ug/L			03/26/26 20:04	200
2,2-Dichloropropane	ND		200	80	ug/L			03/26/26 20:04	200
2-Butanone (MEK)	**770**	**J B**	2000	260	ug/L			03/26/26 20:04	200
2-Chloroethyl vinyl ether	ND		1000	190	ug/L			03/26/26 20:04	200
o-Chlorotoluene	ND		200	170	ug/L			03/26/26 20:04	200
2-Hexanone	ND		1000	250	ug/L			03/26/26 20:04	200
p-Chlorotoluene	ND		200	170	ug/L			03/26/26 20:04	200
p-Cymene	ND		200	62	ug/L			03/26/26 20:04	200
4-Methyl-2-pentanone (MIBK)	ND		1000	420	ug/L			03/26/26 20:04	200
Acetone	ND		2000	600	ug/L			03/26/26 20:04	200
Benzene	ND		200	82	ug/L			03/26/26 20:04	200
Bromobenzene	ND		200	160	ug/L			03/26/26 20:04	200
Bromoform	ND		200	52	ug/L			03/26/26 20:04	200
Bromomethane	ND		200	140	ug/L			03/26/26 20:04	200
Carbon disulfide	ND		200	38	ug/L			03/26/26 20:04	200
Carbon tetrachloride	ND		200	54	ug/L			03/26/26 20:04	200
Chlorobenzene	ND		200	150	ug/L			03/26/26 20:04	200
Bromochloromethane	ND		200	170	ug/L			03/26/26 20:04	200
Chlorodibromomethane	ND		200	64	ug/L			03/26/26 20:04	200
Chloroethane	ND		200	64	ug/L			03/26/26 20:04	200
Chloroform	ND		200	68	ug/L			03/26/26 20:04	200
Chloromethane	ND		200	70	ug/L			03/26/26 20:04	200
cis-1,2-Dichloroethene	**220**		200	160	ug/L			03/26/26 20:04	200
Bromodichloromethane	ND		200	78	ug/L			03/26/26 20:04	200
Dichlorodifluoromethane	ND		200	140	ug/L			03/26/26 20:04	200
Ethylbenzene	ND		200	150	ug/L			03/26/26 20:04	200
1,2-Dibromoethane	ND		200	150	ug/L			03/26/26 20:04	200
Hexachlorobutadiene	ND		400	56	ug/L			03/26/26 20:04	200
Isopropylbenzene	ND		200	160	ug/L			03/26/26 20:04	200
Methyl tert-butyl ether	ND		200	32	ug/L			03/26/26 20:04	200
Methylene Chloride	ND		200	88	ug/L			03/26/26 20:04	200

Client Sample ID: OW-9A
Lab Sample ID: 480-237182-8

Date Collected: 03/24/26 11:40
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
m-Xylene & p-Xylene	ND		400	130	ug/L			03/26/26 20:04	200
Naphthalene	ND		200	86	ug/L			03/26/26 20:04	200
n-Butylbenzene	ND		200	130	ug/L			03/26/26 20:04	200
N-Propylbenzene	ND		200	140	ug/L			03/26/26 20:04	200
o-Xylene	ND		200	150	ug/L			03/26/26 20:04	200
sec-Butylbenzene	ND		200	150	ug/L			03/26/26 20:04	200
Tetrachloroethene	**9000**		200	72	ug/L			03/26/26 20:04	200
Toluene	ND		200	100	ug/L			03/26/26 20:04	200
trans-1,2-Dichloroethene	ND		200	180	ug/L			03/26/26 20:04	200
trans-1,3-Dichloropropene	ND		200	74	ug/L			03/26/26 20:04	200
Trichloroethene	**410**		200	92	ug/L			03/26/26 20:04	200
Trichlorofluoromethane	ND		200	180	ug/L			03/26/26 20:04	200
Vinyl acetate	ND		1000	170	ug/L			03/26/26 20:04	200
Vinyl chloride	ND		200	180	ug/L			03/26/26 20:04	200
cis-1,3-Dichloropropene	ND		200	72	ug/L			03/26/26 20:04	200
Styrene	ND		200	150	ug/L			03/26/26 20:04	200
tert-Butylbenzene	ND		200	160	ug/L			03/26/26 20:04	200

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*112*		*77 - 120*		*03/26/26 20:04*	*200*
4-Bromofluorobenzene (Surr)	*86*		*73 - 120*		*03/26/26 20:04*	*200*
Toluene-d8 (Surr)	*107*		*80 - 120*		*03/26/26 20:04*	*200*
Dibromofluoromethane (Surr)	*102*		*75 - 123*		*03/26/26 20:04*	*200*

Client Sample ID: OW-27B
Lab Sample ID: 480-237182-9

Date Collected: 03/24/26 11:50
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		5.0	1.8	ug/L			03/27/26 16:02	5
1,1,1-Trichloroethane	ND		5.0	4.1	ug/L			03/27/26 16:02	5
1,1,2,2-Tetrachloroethane	ND		5.0	1.1	ug/L			03/27/26 16:02	5
1,1,2-Trichloroethane	ND		5.0	1.2	ug/L			03/27/26 16:02	5
1,1-Dichloroethane	ND		5.0	1.9	ug/L			03/27/26 16:02	5
1,1-Dichloroethene	ND		5.0	1.5	ug/L			03/27/26 16:02	5
1,1-Dichloropropene	ND		5.0	3.6	ug/L			03/27/26 16:02	5
1,2,3-Trichlorobenzene	ND		5.0	2.1	ug/L			03/27/26 16:02	5
1,2,3-Trichloropropane	ND		5.0	4.5	ug/L			03/27/26 16:02	5
1,2,4-Trichlorobenzene	**2.6**	**J**	5.0	2.1	ug/L			03/27/26 16:02	5
1,2,4-Trimethylbenzene	ND		5.0	3.8	ug/L			03/27/26 16:02	5
1,2-Dibromo-3-Chloropropane	ND		5.0	2.0	ug/L			03/27/26 16:02	5
1,2-Dichlorobenzene	ND		5.0	4.0	ug/L			03/27/26 16:02	5
1,2-Dichloroethane	ND		5.0	1.1	ug/L			03/27/26 16:02	5
1,2-Dichloropropane	ND		5.0	3.6	ug/L			03/27/26 16:02	5
1,3,5-Trimethylbenzene	ND		5.0	3.9	ug/L			03/27/26 16:02	5
1,3-Dichlorobenzene	ND		5.0	3.9	ug/L			03/27/26 16:02	5
1,3-Dichloropropane	ND		5.0	3.8	ug/L			03/27/26 16:02	5
1,4-Dichlorobenzene	**6.1**		5.0	4.2	ug/L			03/27/26 16:02	5
2,2-Dichloropropane	ND		5.0	2.0	ug/L			03/27/26 16:02	5

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-27B
Lab Sample ID: 480-237182-9
Date Collected: 03/24/26 11:50
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
2-Butanone (MEK)	**21**	**J B**	50	6.6	ug/L			03/27/26 16:02	5
2-Chloroethyl vinyl ether	ND		25	4.8	ug/L			03/27/26 16:02	5
o-Chlorotoluene	ND		5.0	4.3	ug/L			03/27/26 16:02	5
2-Hexanone	ND		25	6.2	ug/L			03/27/26 16:02	5
p-Chlorotoluene	ND		5.0	4.2	ug/L			03/27/26 16:02	5
p-Cymene	ND		5.0	1.6	ug/L			03/27/26 16:02	5
4-Methyl-2-pentanone (MIBK)	ND		25	11	ug/L			03/27/26 16:02	5
Acetone	ND		50	15	ug/L			03/27/26 16:02	5
Benzene	ND		5.0	2.1	ug/L			03/27/26 16:02	5
Bromobenzene	ND		5.0	4.0	ug/L			03/27/26 16:02	5
Bromoform	ND		5.0	1.3	ug/L			03/27/26 16:02	5
Bromomethane	ND		5.0	3.5	ug/L			03/27/26 16:02	5
Carbon disulfide	ND		5.0	0.95	ug/L			03/27/26 16:02	5
Carbon tetrachloride	ND		5.0	1.4	ug/L			03/27/26 16:02	5
Chlorobenzene	ND		5.0	3.8	ug/L			03/27/26 16:02	5
Bromochloromethane	ND		5.0	4.4	ug/L			03/27/26 16:02	5
Chlorodibromomethane	ND		5.0	1.6	ug/L			03/27/26 16:02	5
Chloroethane	ND		5.0	1.6	ug/L			03/27/26 16:02	5
Chloroform	ND		5.0	1.7	ug/L			03/27/26 16:02	5
Chloromethane	ND		5.0	1.8	ug/L			03/27/26 16:02	5
cis-1,2-Dichloroethene	**17**		5.0	4.1	ug/L			03/27/26 16:02	5
Bromodichloromethane	ND		5.0	2.0	ug/L			03/27/26 16:02	5
Dichlorodifluoromethane	ND		5.0	3.4	ug/L			03/27/26 16:02	5
Ethylbenzene	ND		5.0	3.7	ug/L			03/27/26 16:02	5
1,2-Dibromoethane	ND		5.0	3.7	ug/L			03/27/26 16:02	5
Hexachlorobutadiene	ND		10	1.4	ug/L			03/27/26 16:02	5
Isopropylbenzene	ND		5.0	4.0	ug/L			03/27/26 16:02	5
Methyl tert-butyl ether	ND		5.0	0.80	ug/L			03/27/26 16:02	5
Methylene Chloride	ND		5.0	2.2	ug/L			03/27/26 16:02	5
m-Xylene & p-Xylene	ND		10	3.3	ug/L			03/27/26 16:02	5
Naphthalene	ND		5.0	2.2	ug/L			03/27/26 16:02	5
n-Butylbenzene	ND		5.0	3.2	ug/L			03/27/26 16:02	5
N-Propylbenzene	ND		5.0	3.5	ug/L			03/27/26 16:02	5
o-Xylene	ND		5.0	3.8	ug/L			03/27/26 16:02	5
sec-Butylbenzene	ND		5.0	3.8	ug/L			03/27/26 16:02	5
Tetrachloroethene	**190**		5.0	1.8	ug/L			03/27/26 16:02	5
Toluene	ND		5.0	2.6	ug/L			03/27/26 16:02	5
trans-1,2-Dichloroethene	ND		5.0	4.5	ug/L			03/27/26 16:02	5
trans-1,3-Dichloropropene	ND		5.0	1.9	ug/L			03/27/26 16:02	5
Trichloroethene	**23**		5.0	2.3	ug/L			03/27/26 16:02	5
Trichlorofluoromethane	ND		5.0	4.4	ug/L			03/27/26 16:02	5
Vinyl acetate	ND		25	4.3	ug/L			03/27/26 16:02	5
Vinyl chloride	ND		5.0	4.5	ug/L			03/27/26 16:02	5
cis-1,3-Dichloropropene	ND		5.0	1.8	ug/L			03/27/26 16:02	5
Styrene	ND		5.0	3.7	ug/L			03/27/26 16:02	5
tert-Butylbenzene	ND		5.0	4.1	ug/L			03/27/26 16:02	5

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*110*		*77 - 120*		*03/27/26 16:02*	*5*
4-Bromofluorobenzene (Surr)	*88*		*73 - 120*		*03/27/26 16:02*	*5*

Client Sample ID: OW-27B

Lab Sample ID: 480-237182-9
Date Collected: 03/24/26 11:50
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
Toluene-d8 (Surr)	*105*		*80 - 120*		*03/27/26 16:02*	*5*
Dibromofluoromethane (Surr)	*100*		*75 - 123*		*03/27/26 16:02*	*5*

Client Sample ID: OW-16A

Lab Sample ID: 480-237182-10
Date Collected: 03/24/26 11:55
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			03/26/26 20:50	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			03/26/26 20:50	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			03/26/26 20:50	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			03/26/26 20:50	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			03/26/26 20:50	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			03/26/26 20:50	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			03/26/26 20:50	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			03/26/26 20:50	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			03/26/26 20:50	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			03/26/26 20:50	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			03/26/26 20:50	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			03/26/26 20:50	1
1,2-Dichlorobenzene	ND		1.0	0.79	ug/L			03/26/26 20:50	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			03/26/26 20:50	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			03/26/26 20:50	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			03/26/26 20:50	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			03/26/26 20:50	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			03/26/26 20:50	1
1,4-Dichlorobenzene	ND		1.0	0.84	ug/L			03/26/26 20:50	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			03/26/26 20:50	1
2-Butanone (MEK)	**4.8**	**J B**	10	1.3	ug/L			03/26/26 20:50	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			03/26/26 20:50	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			03/26/26 20:50	1
2-Hexanone	ND		5.0	1.2	ug/L			03/26/26 20:50	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			03/26/26 20:50	1
p-Cymene	ND		1.0	0.31	ug/L			03/26/26 20:50	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			03/26/26 20:50	1
Acetone	**4.3**	**J**	10	3.0	ug/L			03/26/26 20:50	1
Benzene	ND		1.0	0.41	ug/L			03/26/26 20:50	1
Bromobenzene	ND		1.0	0.80	ug/L			03/26/26 20:50	1
Bromoform	ND		1.0	0.26	ug/L			03/26/26 20:50	1
Bromomethane	ND		1.0	0.69	ug/L			03/26/26 20:50	1
Carbon disulfide	ND		1.0	0.19	ug/L			03/26/26 20:50	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			03/26/26 20:50	1
Chlorobenzene	ND		1.0	0.75	ug/L			03/26/26 20:50	1
Bromochloromethane	ND		1.0	0.87	ug/L			03/26/26 20:50	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			03/26/26 20:50	1
Chloroethane	ND		1.0	0.32	ug/L			03/26/26 20:50	1
Chloroform	ND		1.0	0.34	ug/L			03/26/26 20:50	1
Chloromethane	ND		1.0	0.35	ug/L			03/26/26 20:50	1

Client Sample ID: OW-16A
Lab Sample ID: 480-237182-10

Date Collected: 03/24/26 11:55
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			03/26/26 20:50	1
Bromodichloromethane	ND		1.0	0.39	ug/L			03/26/26 20:50	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			03/26/26 20:50	1
Ethylbenzene	ND		1.0	0.74	ug/L			03/26/26 20:50	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			03/26/26 20:50	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			03/26/26 20:50	1
Isopropylbenzene	ND		1.0	0.79	ug/L			03/26/26 20:50	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			03/26/26 20:50	1
Methylene Chloride	ND		1.0	0.44	ug/L			03/26/26 20:50	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			03/26/26 20:50	1
Naphthalene	ND		1.0	0.43	ug/L			03/26/26 20:50	1
n-Butylbenzene	ND		1.0	0.64	ug/L			03/26/26 20:50	1
N-Propylbenzene	ND		1.0	0.69	ug/L			03/26/26 20:50	1
o-Xylene	ND		1.0	0.76	ug/L			03/26/26 20:50	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			03/26/26 20:50	1
Tetrachloroethene	ND		1.0	0.36	ug/L			03/26/26 20:50	1
Toluene	ND		1.0	0.51	ug/L			03/26/26 20:50	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			03/26/26 20:50	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			03/26/26 20:50	1
Trichloroethene	ND		1.0	0.46	ug/L			03/26/26 20:50	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			03/26/26 20:50	1
Vinyl acetate	ND		5.0	0.85	ug/L			03/26/26 20:50	1
Vinyl chloride	ND		1.0	0.90	ug/L			03/26/26 20:50	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			03/26/26 20:50	1
Styrene	ND		1.0	0.73	ug/L			03/26/26 20:50	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			03/26/26 20:50	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*110*		*77 - 120*		*03/26/26 20:50*	*1*
4-Bromofluorobenzene (Surr)	*87*		*73 - 120*		*03/26/26 20:50*	*1*
Toluene-d8 (Surr)	*106*		*80 - 120*		*03/26/26 20:50*	*1*
Dibromofluoromethane (Surr)	*101*		*75 - 123*		*03/26/26 20:50*	*1*

Client Sample ID: OW-13B
Lab Sample ID: 480-237182-11

Date Collected: 03/24/26 14:15
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		200	70	ug/L			03/26/26 21:13	200
1,1,1-Trichloroethane	ND		200	160	ug/L			03/26/26 21:13	200
1,1,2,2-Tetrachloroethane	ND		200	42	ug/L			03/26/26 21:13	200
1,1,2-Trichloroethane	ND		200	46	ug/L			03/26/26 21:13	200
1,1-Dichloroethane	ND		200	76	ug/L			03/26/26 21:13	200
1,1-Dichloroethene	ND		200	58	ug/L			03/26/26 21:13	200
1,1-Dichloropropene	ND		200	140	ug/L			03/26/26 21:13	200
1,2,3-Trichlorobenzene	ND		200	82	ug/L			03/26/26 21:13	200
1,2,3-Trichloropropane	ND		200	180	ug/L			03/26/26 21:13	200
1,2,4-Trichlorobenzene	**1700**		200	82	ug/L			03/26/26 21:13	200
1,2,4-Trimethylbenzene	ND		200	150	ug/L			03/26/26 21:13	200

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-13B
Lab Sample ID: 480-237182-11
Date Collected: 03/24/26 14:15
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,2-Dibromo-3-Chloropropane	ND		200	78	ug/L			03/26/26 21:13	200
1,2-Dichlorobenzene	**3700**		200	160	ug/L			03/26/26 21:13	200
1,2-Dichloroethane	ND		200	42	ug/L			03/26/26 21:13	200
1,2-Dichloropropane	ND		200	140	ug/L			03/26/26 21:13	200
1,3,5-Trimethylbenzene	ND		200	150	ug/L			03/26/26 21:13	200
1,3-Dichlorobenzene	**1500**		200	160	ug/L			03/26/26 21:13	200
1,3-Dichloropropane	ND		200	150	ug/L			03/26/26 21:13	200
1,4-Dichlorobenzene	**5400**		200	170	ug/L			03/26/26 21:13	200
2,2-Dichloropropane	ND		200	80	ug/L			03/26/26 21:13	200
2-Butanone (MEK)	**710**	**J B**	2000	260	ug/L			03/26/26 21:13	200
2-Chloroethyl vinyl ether	ND		1000	190	ug/L			03/26/26 21:13	200
o-Chlorotoluene	ND		200	170	ug/L			03/26/26 21:13	200
2-Hexanone	ND		1000	250	ug/L			03/26/26 21:13	200
p-Chlorotoluene	ND		200	170	ug/L			03/26/26 21:13	200
p-Cymene	ND		200	62	ug/L			03/26/26 21:13	200
4-Methyl-2-pentanone (MIBK)	ND		1000	420	ug/L			03/26/26 21:13	200
Acetone	ND		2000	600	ug/L			03/26/26 21:13	200
Benzene	**680**		200	82	ug/L			03/26/26 21:13	200
Bromobenzene	ND		200	160	ug/L			03/26/26 21:13	200
Bromoform	ND		200	52	ug/L			03/26/26 21:13	200
Bromomethane	ND		200	140	ug/L			03/26/26 21:13	200
Carbon disulfide	ND		200	38	ug/L			03/26/26 21:13	200
Carbon tetrachloride	ND		200	54	ug/L			03/26/26 21:13	200
Chlorobenzene	**5800**		200	150	ug/L			03/26/26 21:13	200
Bromochloromethane	ND		200	170	ug/L			03/26/26 21:13	200
Chlorodibromomethane	ND		200	64	ug/L			03/26/26 21:13	200
Chloroethane	ND		200	64	ug/L			03/26/26 21:13	200
Chloroform	ND		200	68	ug/L			03/26/26 21:13	200
Chloromethane	ND		200	70	ug/L			03/26/26 21:13	200
cis-1,2-Dichloroethene	ND		200	160	ug/L			03/26/26 21:13	200
Bromodichloromethane	ND		200	78	ug/L			03/26/26 21:13	200
Dichlorodifluoromethane	ND		200	140	ug/L			03/26/26 21:13	200
Ethylbenzene	ND		200	150	ug/L			03/26/26 21:13	200
1,2-Dibromoethane	ND		200	150	ug/L			03/26/26 21:13	200
Hexachlorobutadiene	ND		400	56	ug/L			03/26/26 21:13	200
Isopropylbenzene	ND		200	160	ug/L			03/26/26 21:13	200
Methyl tert-butyl ether	ND		200	32	ug/L			03/26/26 21:13	200
Methylene Chloride	ND		200	88	ug/L			03/26/26 21:13	200
m-Xylene & p-Xylene	ND		400	130	ug/L			03/26/26 21:13	200
Naphthalene	ND		200	86	ug/L			03/26/26 21:13	200
n-Butylbenzene	ND		200	130	ug/L			03/26/26 21:13	200
N-Propylbenzene	ND		200	140	ug/L			03/26/26 21:13	200
o-Xylene	ND		200	150	ug/L			03/26/26 21:13	200
sec-Butylbenzene	ND		200	150	ug/L			03/26/26 21:13	200
Tetrachloroethene	ND		200	72	ug/L			03/26/26 21:13	200
Toluene	ND		200	100	ug/L			03/26/26 21:13	200
trans-1,2-Dichloroethene	ND		200	180	ug/L			03/26/26 21:13	200
trans-1,3-Dichloropropene	ND		200	74	ug/L			03/26/26 21:13	200
Trichloroethene	ND		200	92	ug/L			03/26/26 21:13	200

Client Sample ID: OW-13B
Lab Sample ID: 480-237182-11

Date Collected: 03/24/26 14:15
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Trichlorofluoromethane	ND		200	180	ug/L			03/26/26 21:13	200
Vinyl acetate	ND		1000	170	ug/L			03/26/26 21:13	200
Vinyl chloride	**740**		200	180	ug/L			03/26/26 21:13	200
cis-1,3-Dichloropropene	ND		200	72	ug/L			03/26/26 21:13	200
Styrene	ND		200	150	ug/L			03/26/26 21:13	200
tert-Butylbenzene	ND		200	160	ug/L			03/26/26 21:13	200

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*108*		*77 - 120*		*03/26/26 21:13*	*200*
4-Bromofluorobenzene (Surr)	*85*		*73 - 120*		*03/26/26 21:13*	*200*
Toluene-d8 (Surr)	*105*		*80 - 120*		*03/26/26 21:13*	*200*
Dibromofluoromethane (Surr)	*103*		*75 - 123*		*03/26/26 21:13*	*200*

Client Sample ID: OW-113B
Lab Sample ID: 480-237182-12

Date Collected: 03/24/26 15:15
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		200	70	ug/L			03/27/26 01:50	200
1,1,1-Trichloroethane	ND		200	160	ug/L			03/27/26 01:50	200
1,1,2,2-Tetrachloroethane	ND		200	42	ug/L			03/27/26 01:50	200
1,1,2-Trichloroethane	ND		200	46	ug/L			03/27/26 01:50	200
1,1-Dichloroethane	ND		200	76	ug/L			03/27/26 01:50	200
1,1-Dichloroethene	ND		200	58	ug/L			03/27/26 01:50	200
1,1-Dichloropropene	ND		200	140	ug/L			03/27/26 01:50	200
1,2,3-Trichlorobenzene	ND		200	82	ug/L			03/27/26 01:50	200
1,2,3-Trichloropropane	ND		200	180	ug/L			03/27/26 01:50	200
1,2,4-Trichlorobenzene	**1700**		200	82	ug/L			03/27/26 01:50	200
1,2,4-Trimethylbenzene	ND		200	150	ug/L			03/27/26 01:50	200
1,2-Dibromo-3-Chloropropane	ND		200	78	ug/L			03/27/26 01:50	200
1,2-Dichlorobenzene	**3700**		200	160	ug/L			03/27/26 01:50	200
1,2-Dichloroethane	ND		200	42	ug/L			03/27/26 01:50	200
1,2-Dichloropropane	ND		200	140	ug/L			03/27/26 01:50	200
1,3,5-Trimethylbenzene	ND		200	150	ug/L			03/27/26 01:50	200
1,3-Dichlorobenzene	**1500**		200	160	ug/L			03/27/26 01:50	200
1,3-Dichloropropane	ND		200	150	ug/L			03/27/26 01:50	200
1,4-Dichlorobenzene	**5300**		200	170	ug/L			03/27/26 01:50	200
2,2-Dichloropropane	ND		200	80	ug/L			03/27/26 01:50	200
2-Butanone (MEK)	**730**	**J**	2000	260	ug/L			03/27/26 01:50	200
2-Chloroethyl vinyl ether	ND		1000	190	ug/L			03/27/26 01:50	200
o-Chlorotoluene	ND		200	170	ug/L			03/27/26 01:50	200
2-Hexanone	ND		1000	250	ug/L			03/27/26 01:50	200
p-Chlorotoluene	ND		200	170	ug/L			03/27/26 01:50	200
p-Cymene	ND		200	62	ug/L			03/27/26 01:50	200
4-Methyl-2-pentanone (MIBK)	ND		1000	420	ug/L			03/27/26 01:50	200
Acetone	ND		2000	600	ug/L			03/27/26 01:50	200
Benzene	**700**		200	82	ug/L			03/27/26 01:50	200
Bromobenzene	ND		200	160	ug/L			03/27/26 01:50	200
Bromoform	ND		200	52	ug/L			03/27/26 01:50	200

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-113B
Lab Sample ID: 480-237182-12
Date Collected: 03/24/26 15:15
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Bromomethane	ND		200	140	ug/L			03/27/26 01:50	200
Carbon disulfide	ND		200	38	ug/L			03/27/26 01:50	200
Carbon tetrachloride	ND		200	54	ug/L			03/27/26 01:50	200
Chlorobenzene	**5900**		200	150	ug/L			03/27/26 01:50	200
Bromochloromethane	ND		200	170	ug/L			03/27/26 01:50	200
Chlorodibromomethane	ND		200	64	ug/L			03/27/26 01:50	200
Chloroethane	ND		200	64	ug/L			03/27/26 01:50	200
Chloroform	ND		200	68	ug/L			03/27/26 01:50	200
Chloromethane	ND		200	70	ug/L			03/27/26 01:50	200
cis-1,2-Dichloroethene	**160**	**J**	200	160	ug/L			03/27/26 01:50	200
Bromodichloromethane	ND		200	78	ug/L			03/27/26 01:50	200
Dichlorodifluoromethane	ND		200	140	ug/L			03/27/26 01:50	200
Ethylbenzene	ND		200	150	ug/L			03/27/26 01:50	200
1,2-Dibromoethane	ND		200	150	ug/L			03/27/26 01:50	200
Hexachlorobutadiene	ND		400	56	ug/L			03/27/26 01:50	200
Isopropylbenzene	ND		200	160	ug/L			03/27/26 01:50	200
Methyl tert-butyl ether	ND		200	32	ug/L			03/27/26 01:50	200
Methylene Chloride	ND		200	88	ug/L			03/27/26 01:50	200
m-Xylene & p-Xylene	ND		400	130	ug/L			03/27/26 01:50	200
Naphthalene	ND		200	86	ug/L			03/27/26 01:50	200
n-Butylbenzene	ND		200	130	ug/L			03/27/26 01:50	200
N-Propylbenzene	ND		200	140	ug/L			03/27/26 01:50	200
o-Xylene	ND		200	150	ug/L			03/27/26 01:50	200
sec-Butylbenzene	ND		200	150	ug/L			03/27/26 01:50	200
Tetrachloroethene	ND		200	72	ug/L			03/27/26 01:50	200
Toluene	ND		200	100	ug/L			03/27/26 01:50	200
trans-1,2-Dichloroethene	ND		200	180	ug/L			03/27/26 01:50	200
trans-1,3-Dichloropropene	ND		200	74	ug/L			03/27/26 01:50	200
Trichloroethene	ND		200	92	ug/L			03/27/26 01:50	200
Trichlorofluoromethane	ND		200	180	ug/L			03/27/26 01:50	200
Vinyl acetate	ND		1000	170	ug/L			03/27/26 01:50	200
Vinyl chloride	**780**		200	180	ug/L			03/27/26 01:50	200
cis-1,3-Dichloropropene	ND		200	72	ug/L			03/27/26 01:50	200
Styrene	ND		200	150	ug/L			03/27/26 01:50	200
tert-Butylbenzene	ND		200	160	ug/L			03/27/26 01:50	200

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*111*		*77 - 120*		*03/27/26 01:50*	*200*
4-Bromofluorobenzene (Surr)	*85*		*73 - 120*		*03/27/26 01:50*	*200*
Toluene-d8 (Surr)	*104*		*80 - 120*		*03/27/26 01:50*	*200*
Dibromofluoromethane (Surr)	*100*		*75 - 123*		*03/27/26 01:50*	*200*

Client Sample ID: OW-29B
Lab Sample ID: 480-237182-13
Date Collected: 03/24/26 13:15
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		130	44	ug/L			03/27/26 02:13	125
1,1,1-Trichloroethane	ND		130	100	ug/L			03/27/26 02:13	125

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-29B
Lab Sample ID: 480-237182-13
Date Collected: 03/24/26 13:15
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	**60**	**J**	130	26	ug/L			03/27/26 02:13	125
1,1,2-Trichloroethane	ND		130	29	ug/L			03/27/26 02:13	125
1,1-Dichloroethane	ND		130	48	ug/L			03/27/26 02:13	125
1,1-Dichloroethene	ND		130	36	ug/L			03/27/26 02:13	125
1,1-Dichloropropene	ND		130	90	ug/L			03/27/26 02:13	125
1,2,3-Trichlorobenzene	ND		130	51	ug/L			03/27/26 02:13	125
1,2,3-Trichloropropane	ND		130	110	ug/L			03/27/26 02:13	125
1,2,4-Trichlorobenzene	**500**		130	51	ug/L			03/27/26 02:13	125
1,2,4-Trimethylbenzene	ND		130	94	ug/L			03/27/26 02:13	125
1,2-Dibromo-3-Chloropropane	ND		130	49	ug/L			03/27/26 02:13	125
1,2-Dichlorobenzene	**1500**		130	99	ug/L			03/27/26 02:13	125
1,2-Dichloroethane	ND		130	26	ug/L			03/27/26 02:13	125
1,2-Dichloropropane	ND		130	90	ug/L			03/27/26 02:13	125
1,3,5-Trimethylbenzene	ND		130	96	ug/L			03/27/26 02:13	125
1,3-Dichlorobenzene	**600**		130	98	ug/L			03/27/26 02:13	125
1,3-Dichloropropane	ND		130	94	ug/L			03/27/26 02:13	125
1,4-Dichlorobenzene	**2100**		130	110	ug/L			03/27/26 02:13	125
2,2-Dichloropropane	ND		130	50	ug/L			03/27/26 02:13	125
2-Butanone (MEK)	**500**	**J**	1300	170	ug/L			03/27/26 02:13	125
2-Chloroethyl vinyl ether	ND		630	120	ug/L			03/27/26 02:13	125
o-Chlorotoluene	ND		130	110	ug/L			03/27/26 02:13	125
2-Hexanone	ND		630	160	ug/L			03/27/26 02:13	125
p-Chlorotoluene	ND		130	110	ug/L			03/27/26 02:13	125
p-Cymene	ND		130	39	ug/L			03/27/26 02:13	125
4-Methyl-2-pentanone (MIBK)	ND		630	260	ug/L			03/27/26 02:13	125
Acetone	ND		1300	380	ug/L			03/27/26 02:13	125
Benzene	**250**		130	51	ug/L			03/27/26 02:13	125
Bromobenzene	ND		130	100	ug/L			03/27/26 02:13	125
Bromoform	ND		130	33	ug/L			03/27/26 02:13	125
Bromomethane	ND		130	86	ug/L			03/27/26 02:13	125
Carbon disulfide	ND		130	24	ug/L			03/27/26 02:13	125
Carbon tetrachloride	ND		130	34	ug/L			03/27/26 02:13	125
Chlorobenzene	**2900**		130	94	ug/L			03/27/26 02:13	125
Bromochloromethane	ND		130	110	ug/L			03/27/26 02:13	125
Chlorodibromomethane	ND		130	40	ug/L			03/27/26 02:13	125
Chloroethane	ND		130	40	ug/L			03/27/26 02:13	125
Chloroform	ND		130	43	ug/L			03/27/26 02:13	125
Chloromethane	ND		130	44	ug/L			03/27/26 02:13	125
cis-1,2-Dichloroethene	**1800**		130	100	ug/L			03/27/26 02:13	125
Bromodichloromethane	ND		130	49	ug/L			03/27/26 02:13	125
Dichlorodifluoromethane	ND		130	85	ug/L			03/27/26 02:13	125
Ethylbenzene	ND		130	93	ug/L			03/27/26 02:13	125
1,2-Dibromoethane	ND		130	91	ug/L			03/27/26 02:13	125
Hexachlorobutadiene	ND		250	35	ug/L			03/27/26 02:13	125
Isopropylbenzene	ND		130	99	ug/L			03/27/26 02:13	125
Methyl tert-butyl ether	ND		130	20	ug/L			03/27/26 02:13	125
Methylene Chloride	ND		130	55	ug/L			03/27/26 02:13	125
m-Xylene & p-Xylene	ND		250	83	ug/L			03/27/26 02:13	125
Naphthalene	ND		130	54	ug/L			03/27/26 02:13	125

Client Sample ID: OW-29B
Lab Sample ID: 480-237182-13

Date Collected: 03/24/26 13:15
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
n-Butylbenzene	ND		130	80	ug/L			03/27/26 02:13	125
N-Propylbenzene	ND		130	86	ug/L			03/27/26 02:13	125
o-Xylene	ND		130	95	ug/L			03/27/26 02:13	125
sec-Butylbenzene	ND		130	94	ug/L			03/27/26 02:13	125
Tetrachloroethene	**610**		130	45	ug/L			03/27/26 02:13	125
Toluene	ND		130	64	ug/L			03/27/26 02:13	125
trans-1,2-Dichloroethene	ND		130	110	ug/L			03/27/26 02:13	125
trans-1,3-Dichloropropene	ND		130	46	ug/L			03/27/26 02:13	125
Trichloroethene	**620**		130	58	ug/L			03/27/26 02:13	125
Trichlorofluoromethane	ND		130	110	ug/L			03/27/26 02:13	125
Vinyl acetate	ND		630	110	ug/L			03/27/26 02:13	125
Vinyl chloride	**1700**		130	110	ug/L			03/27/26 02:13	125
cis-1,3-Dichloropropene	ND		130	45	ug/L			03/27/26 02:13	125
Styrene	ND		130	91	ug/L			03/27/26 02:13	125
tert-Butylbenzene	ND		130	100	ug/L			03/27/26 02:13	125

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*110*		*77 - 120*		*03/27/26 02:13*	*125*
4-Bromofluorobenzene (Surr)	*87*		*73 - 120*		*03/27/26 02:13*	*125*
Toluene-d8 (Surr)	*104*		*80 - 120*		*03/27/26 02:13*	*125*
Dibromofluoromethane (Surr)	*103*		*75 - 123*		*03/27/26 02:13*	*125*

Client Sample ID: OW-15A
Lab Sample ID: 480-237182-14

Date Collected: 03/24/26 13:25
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			03/27/26 02:36	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			03/27/26 02:36	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			03/27/26 02:36	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			03/27/26 02:36	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			03/27/26 02:36	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			03/27/26 02:36	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			03/27/26 02:36	1
1,2,3-Trichlorobenzene	**1.4**		1.0	0.41	ug/L			03/27/26 02:36	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			03/27/26 02:36	1
1,2,4-Trichlorobenzene	**3.6**		1.0	0.41	ug/L			03/27/26 02:36	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			03/27/26 02:36	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			03/27/26 02:36	1
1,2-Dichlorobenzene	**1.7**		1.0	0.79	ug/L			03/27/26 02:36	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			03/27/26 02:36	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			03/27/26 02:36	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			03/27/26 02:36	1
1,3-Dichlorobenzene	**3.0**		1.0	0.78	ug/L			03/27/26 02:36	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			03/27/26 02:36	1
1,4-Dichlorobenzene	**0.85**	**J**	1.0	0.84	ug/L			03/27/26 02:36	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			03/27/26 02:36	1
2-Butanone (MEK)	**4.2**	**J**	10	1.3	ug/L			03/27/26 02:36	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			03/27/26 02:36	1

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-15A
Lab Sample ID: 480-237182-14
Date Collected: 03/24/26 13:25
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
o-Chlorotoluene	ND		1.0	0.86	ug/L			03/27/26 02:36	1
2-Hexanone	ND		5.0	1.2	ug/L			03/27/26 02:36	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			03/27/26 02:36	1
p-Cymene	ND		1.0	0.31	ug/L			03/27/26 02:36	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			03/27/26 02:36	1
Acetone	**3.1**	**J**	10	3.0	ug/L			03/27/26 02:36	1
Benzene	ND		1.0	0.41	ug/L			03/27/26 02:36	1
Bromobenzene	ND		1.0	0.80	ug/L			03/27/26 02:36	1
Bromoform	ND		1.0	0.26	ug/L			03/27/26 02:36	1
Bromomethane	ND		1.0	0.69	ug/L			03/27/26 02:36	1
Carbon disulfide	ND		1.0	0.19	ug/L			03/27/26 02:36	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			03/27/26 02:36	1
Chlorobenzene	ND		1.0	0.75	ug/L			03/27/26 02:36	1
Bromochloromethane	ND		1.0	0.87	ug/L			03/27/26 02:36	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			03/27/26 02:36	1
Chloroethane	ND		1.0	0.32	ug/L			03/27/26 02:36	1
Chloroform	ND		1.0	0.34	ug/L			03/27/26 02:36	1
Chloromethane	ND		1.0	0.35	ug/L			03/27/26 02:36	1
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			03/27/26 02:36	1
Bromodichloromethane	ND		1.0	0.39	ug/L			03/27/26 02:36	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			03/27/26 02:36	1
Ethylbenzene	ND		1.0	0.74	ug/L			03/27/26 02:36	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			03/27/26 02:36	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			03/27/26 02:36	1
Isopropylbenzene	ND		1.0	0.79	ug/L			03/27/26 02:36	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			03/27/26 02:36	1
Methylene Chloride	ND		1.0	0.44	ug/L			03/27/26 02:36	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			03/27/26 02:36	1
Naphthalene	ND		1.0	0.43	ug/L			03/27/26 02:36	1
n-Butylbenzene	ND		1.0	0.64	ug/L			03/27/26 02:36	1
N-Propylbenzene	ND		1.0	0.69	ug/L			03/27/26 02:36	1
o-Xylene	ND		1.0	0.76	ug/L			03/27/26 02:36	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			03/27/26 02:36	1
Tetrachloroethene	**0.92**	**J**	1.0	0.36	ug/L			03/27/26 02:36	1
Toluene	ND		1.0	0.51	ug/L			03/27/26 02:36	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			03/27/26 02:36	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			03/27/26 02:36	1
Trichloroethene	**0.55**	**J**	1.0	0.46	ug/L			03/27/26 02:36	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			03/27/26 02:36	1
Vinyl acetate	ND		5.0	0.85	ug/L			03/27/26 02:36	1
Vinyl chloride	ND		1.0	0.90	ug/L			03/27/26 02:36	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			03/27/26 02:36	1
Styrene	ND		1.0	0.73	ug/L			03/27/26 02:36	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			03/27/26 02:36	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*108*		*77 - 120*		*03/27/26 02:36*	*1*
4-Bromofluorobenzene (Surr)	*87*		*73 - 120*		*03/27/26 02:36*	*1*
Toluene-d8 (Surr)	*105*		*80 - 120*		*03/27/26 02:36*	*1*
Dibromofluoromethane (Surr)	*103*		*75 - 123*		*03/27/26 02:36*	*1*

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-28B
Lab Sample ID: 480-237182-15
Date Collected: 03/24/26 13:35
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		130	44	ug/L			03/27/26 02:59	125
1,1,1-Trichloroethane	ND		130	100	ug/L			03/27/26 02:59	125
1,1,2,2-Tetrachloroethane	**160**		130	26	ug/L			03/27/26 02:59	125
1,1,2-Trichloroethane	ND		130	29	ug/L			03/27/26 02:59	125
1,1-Dichloroethane	ND		130	48	ug/L			03/27/26 02:59	125
1,1-Dichloroethene	ND		130	36	ug/L			03/27/26 02:59	125
1,1-Dichloropropene	ND		130	90	ug/L			03/27/26 02:59	125
1,2,3-Trichlorobenzene	ND		130	51	ug/L			03/27/26 02:59	125
1,2,3-Trichloropropane	ND		130	110	ug/L			03/27/26 02:59	125
1,2,4-Trichlorobenzene	**310**		130	51	ug/L			03/27/26 02:59	125
1,2,4-Trimethylbenzene	ND		130	94	ug/L			03/27/26 02:59	125
1,2-Dibromo-3-Chloropropane	ND		130	49	ug/L			03/27/26 02:59	125
1,2-Dichlorobenzene	**190**		130	99	ug/L			03/27/26 02:59	125
1,2-Dichloroethane	ND		130	26	ug/L			03/27/26 02:59	125
1,2-Dichloropropane	ND		130	90	ug/L			03/27/26 02:59	125
1,3,5-Trimethylbenzene	ND		130	96	ug/L			03/27/26 02:59	125
1,3-Dichlorobenzene	**100**	**J**	130	98	ug/L			03/27/26 02:59	125
1,3-Dichloropropane	ND		130	94	ug/L			03/27/26 02:59	125
1,4-Dichlorobenzene	**180**		130	110	ug/L			03/27/26 02:59	125
2,2-Dichloropropane	ND		130	50	ug/L			03/27/26 02:59	125
2-Butanone (MEK)	**500**	**J**	1300	170	ug/L			03/27/26 02:59	125
2-Chloroethyl vinyl ether	ND		630	120	ug/L			03/27/26 02:59	125
o-Chlorotoluene	ND		130	110	ug/L			03/27/26 02:59	125
2-Hexanone	ND		630	160	ug/L			03/27/26 02:59	125
p-Chlorotoluene	ND		130	110	ug/L			03/27/26 02:59	125
p-Cymene	ND		130	39	ug/L			03/27/26 02:59	125
4-Methyl-2-pentanone (MIBK)	ND		630	260	ug/L			03/27/26 02:59	125
Acetone	ND		1300	380	ug/L			03/27/26 02:59	125
Benzene	ND		130	51	ug/L			03/27/26 02:59	125
Bromobenzene	ND		130	100	ug/L			03/27/26 02:59	125
Bromoform	ND		130	33	ug/L			03/27/26 02:59	125
Bromomethane	ND		130	86	ug/L			03/27/26 02:59	125
Carbon disulfide	ND		130	24	ug/L			03/27/26 02:59	125
Carbon tetrachloride	ND		130	34	ug/L			03/27/26 02:59	125
Chlorobenzene	**160**		130	94	ug/L			03/27/26 02:59	125
Bromochloromethane	ND		130	110	ug/L			03/27/26 02:59	125
Chlorodibromomethane	ND		130	40	ug/L			03/27/26 02:59	125
Chloroethane	ND		130	40	ug/L			03/27/26 02:59	125
Chloroform	ND		130	43	ug/L			03/27/26 02:59	125
Chloromethane	ND		130	44	ug/L			03/27/26 02:59	125
cis-1,2-Dichloroethene	**3100**		130	100	ug/L			03/27/26 02:59	125
Bromodichloromethane	ND		130	49	ug/L			03/27/26 02:59	125
Dichlorodifluoromethane	ND		130	85	ug/L			03/27/26 02:59	125
Ethylbenzene	ND		130	93	ug/L			03/27/26 02:59	125
1,2-Dibromoethane	ND		130	91	ug/L			03/27/26 02:59	125
Hexachlorobutadiene	ND		250	35	ug/L			03/27/26 02:59	125
Isopropylbenzene	ND		130	99	ug/L			03/27/26 02:59	125
Methyl tert-butyl ether	ND		130	20	ug/L			03/27/26 02:59	125
Methylene Chloride	ND		130	55	ug/L			03/27/26 02:59	125

Client Sample ID: OW-28B
Lab Sample ID: 480-237182-15

Date Collected: 03/24/26 13:35
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
m-Xylene & p-Xylene	ND		250	83	ug/L			03/27/26 02:59	125
Naphthalene	ND		130	54	ug/L			03/27/26 02:59	125
n-Butylbenzene	ND		130	80	ug/L			03/27/26 02:59	125
N-Propylbenzene	ND		130	86	ug/L			03/27/26 02:59	125
o-Xylene	ND		130	95	ug/L			03/27/26 02:59	125
sec-Butylbenzene	ND		130	94	ug/L			03/27/26 02:59	125
Tetrachloroethene	**1900**		130	45	ug/L			03/27/26 02:59	125
Toluene	ND		130	64	ug/L			03/27/26 02:59	125
trans-1,2-Dichloroethene	ND		130	110	ug/L			03/27/26 02:59	125
trans-1,3-Dichloropropene	ND		130	46	ug/L			03/27/26 02:59	125
Trichloroethene	**4000**		130	58	ug/L			03/27/26 02:59	125
Trichlorofluoromethane	ND		130	110	ug/L			03/27/26 02:59	125
Vinyl acetate	ND		630	110	ug/L			03/27/26 02:59	125
Vinyl chloride	**320**		130	110	ug/L			03/27/26 02:59	125
cis-1,3-Dichloropropene	ND		130	45	ug/L			03/27/26 02:59	125
Styrene	ND		130	91	ug/L			03/27/26 02:59	125
tert-Butylbenzene	ND		130	100	ug/L			03/27/26 02:59	125

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*108*		*77 - 120*		*03/27/26 02:59*	*125*
4-Bromofluorobenzene (Surr)	*85*		*73 - 120*		*03/27/26 02:59*	*125*
Toluene-d8 (Surr)	*104*		*80 - 120*		*03/27/26 02:59*	*125*
Dibromofluoromethane (Surr)	*98*		*75 - 123*		*03/27/26 02:59*	*125*

Client Sample ID: MW-4B
Lab Sample ID: 480-237182-16

Date Collected: 03/24/26 14:30
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		80	28	ug/L			03/27/26 03:22	80
1,1,1-Trichloroethane	ND		80	66	ug/L			03/27/26 03:22	80
1,1,2,2-Tetrachloroethane	**370**		80	17	ug/L			03/27/26 03:22	80
1,1,2-Trichloroethane	ND		80	18	ug/L			03/27/26 03:22	80
1,1-Dichloroethane	ND		80	30	ug/L			03/27/26 03:22	80
1,1-Dichloroethene	ND		80	23	ug/L			03/27/26 03:22	80
1,1-Dichloropropene	ND		80	58	ug/L			03/27/26 03:22	80
1,2,3-Trichlorobenzene	ND		80	33	ug/L			03/27/26 03:22	80
1,2,3-Trichloropropane	ND		80	71	ug/L			03/27/26 03:22	80
1,2,4-Trichlorobenzene	**130**		80	33	ug/L			03/27/26 03:22	80
1,2,4-Trimethylbenzene	ND		80	60	ug/L			03/27/26 03:22	80
1,2-Dibromo-3-Chloropropane	ND		80	31	ug/L			03/27/26 03:22	80
1,2-Dichlorobenzene	**74**	**J**	80	63	ug/L			03/27/26 03:22	80
1,2-Dichloroethane	ND		80	17	ug/L			03/27/26 03:22	80
1,2-Dichloropropane	ND		80	58	ug/L			03/27/26 03:22	80
1,3,5-Trimethylbenzene	ND		80	62	ug/L			03/27/26 03:22	80
1,3-Dichlorobenzene	**68**	**J**	80	62	ug/L			03/27/26 03:22	80
1,3-Dichloropropane	ND		80	60	ug/L			03/27/26 03:22	80
1,4-Dichlorobenzene	**92**		80	67	ug/L			03/27/26 03:22	80
2,2-Dichloropropane	ND		80	32	ug/L			03/27/26 03:22	80

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: MW-4B
Lab Sample ID: 480-237182-16
Date Collected: 03/24/26 14:30
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
2-Butanone (MEK)	**290**	**J**	800	110	ug/L			03/27/26 03:22	80
2-Chloroethyl vinyl ether	ND		400	77	ug/L			03/27/26 03:22	80
o-Chlorotoluene	ND		80	69	ug/L			03/27/26 03:22	80
2-Hexanone	ND		400	99	ug/L			03/27/26 03:22	80
p-Chlorotoluene	ND		80	67	ug/L			03/27/26 03:22	80
p-Cymene	ND		80	25	ug/L			03/27/26 03:22	80
4-Methyl-2-pentanone (MIBK)	ND		400	170	ug/L			03/27/26 03:22	80
Acetone	ND		800	240	ug/L			03/27/26 03:22	80
Benzene	ND		80	33	ug/L			03/27/26 03:22	80
Bromobenzene	ND		80	64	ug/L			03/27/26 03:22	80
Bromoform	ND		80	21	ug/L			03/27/26 03:22	80
Bromomethane	ND		80	55	ug/L			03/27/26 03:22	80
Carbon disulfide	ND		80	15	ug/L			03/27/26 03:22	80
Carbon tetrachloride	ND		80	22	ug/L			03/27/26 03:22	80
Chlorobenzene	ND		80	60	ug/L			03/27/26 03:22	80
Bromochloromethane	ND		80	70	ug/L			03/27/26 03:22	80
Chlorodibromomethane	ND		80	26	ug/L			03/27/26 03:22	80
Chloroethane	ND		80	26	ug/L			03/27/26 03:22	80
Chloroform	**140**		80	27	ug/L			03/27/26 03:22	80
Chloromethane	ND		80	28	ug/L			03/27/26 03:22	80
cis-1,2-Dichloroethene	**2900**		80	65	ug/L			03/27/26 03:22	80
Bromodichloromethane	ND		80	31	ug/L			03/27/26 03:22	80
Dichlorodifluoromethane	ND		80	54	ug/L			03/27/26 03:22	80
Ethylbenzene	ND		80	59	ug/L			03/27/26 03:22	80
1,2-Dibromoethane	ND		80	58	ug/L			03/27/26 03:22	80
Hexachlorobutadiene	ND		160	22	ug/L			03/27/26 03:22	80
Isopropylbenzene	ND		80	63	ug/L			03/27/26 03:22	80
Methyl tert-butyl ether	ND		80	13	ug/L			03/27/26 03:22	80
Methylene Chloride	ND		80	35	ug/L			03/27/26 03:22	80
m-Xylene & p-Xylene	ND		160	53	ug/L			03/27/26 03:22	80
Naphthalene	ND		80	34	ug/L			03/27/26 03:22	80
n-Butylbenzene	ND		80	51	ug/L			03/27/26 03:22	80
N-Propylbenzene	ND		80	55	ug/L			03/27/26 03:22	80
o-Xylene	ND		80	61	ug/L			03/27/26 03:22	80
sec-Butylbenzene	ND		80	60	ug/L			03/27/26 03:22	80
Tetrachloroethene	**3000**		80	29	ug/L			03/27/26 03:22	80
Toluene	ND		80	41	ug/L			03/27/26 03:22	80
trans-1,2-Dichloroethene	ND		80	72	ug/L			03/27/26 03:22	80
trans-1,3-Dichloropropene	ND		80	30	ug/L			03/27/26 03:22	80
Trichloroethene	**5600**		80	37	ug/L			03/27/26 03:22	80
Trichlorofluoromethane	ND		80	70	ug/L			03/27/26 03:22	80
Vinyl acetate	ND		400	68	ug/L			03/27/26 03:22	80
Vinyl chloride	ND		80	72	ug/L			03/27/26 03:22	80
cis-1,3-Dichloropropene	ND		80	29	ug/L			03/27/26 03:22	80
Styrene	ND		80	58	ug/L			03/27/26 03:22	80
tert-Butylbenzene	ND		80	65	ug/L			03/27/26 03:22	80

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*109*		*77 - 120*		*03/27/26 03:22*	*80*
4-Bromofluorobenzene (Surr)	*84*		*73 - 120*		*03/27/26 03:22*	*80*

Client Sample ID: MW-4B

Lab Sample ID: 480-237182-16

Date Collected: 03/24/26 14:30
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
Toluene-d8 (Surr)	104		80 - 120		03/27/26 03:22	80
Dibromofluoromethane (Surr)	102		75 - 123		03/27/26 03:22	80

Client Sample ID: MW-4C

Lab Sample ID: 480-237182-17

Date Collected: 03/24/26 13:45
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		400	140	ug/L			03/27/26 03:46	400
1,1,1-Trichloroethane	ND		400	330	ug/L			03/27/26 03:46	400
1,1,2,2-Tetrachloroethane	ND		400	84	ug/L			03/27/26 03:46	400
1,1,2-Trichloroethane	ND		400	92	ug/L			03/27/26 03:46	400
1,1-Dichloroethane	ND		400	150	ug/L			03/27/26 03:46	400
1,1-Dichloroethene	ND		400	120	ug/L			03/27/26 03:46	400
1,1-Dichloropropene	ND		400	290	ug/L			03/27/26 03:46	400
1,2,3-Trichlorobenzene	ND		400	160	ug/L			03/27/26 03:46	400
1,2,3-Trichloropropane	ND		400	360	ug/L			03/27/26 03:46	400
1,2,4-Trichlorobenzene	ND		400	160	ug/L			03/27/26 03:46	400
1,2,4-Trimethylbenzene	ND		400	300	ug/L			03/27/26 03:46	400
1,2-Dibromo-3-Chloropropane	ND		400	160	ug/L			03/27/26 03:46	400
1,2-Dichlorobenzene	**820**		400	320	ug/L			03/27/26 03:46	400
1,2-Dichloroethane	ND		400	84	ug/L			03/27/26 03:46	400
1,2-Dichloropropane	ND		400	290	ug/L			03/27/26 03:46	400
1,3,5-Trimethylbenzene	ND		400	310	ug/L			03/27/26 03:46	400
1,3-Dichlorobenzene	ND		400	310	ug/L			03/27/26 03:46	400
1,3-Dichloropropane	ND		400	300	ug/L			03/27/26 03:46	400
1,4-Dichlorobenzene	**520**		400	340	ug/L			03/27/26 03:46	400
2,2-Dichloropropane	ND		400	160	ug/L			03/27/26 03:46	400
2-Butanone (MEK)	**1600**	**J**	4000	530	ug/L			03/27/26 03:46	400
2-Chloroethyl vinyl ether	ND		2000	380	ug/L			03/27/26 03:46	400
o-Chlorotoluene	ND		400	340	ug/L			03/27/26 03:46	400
2-Hexanone	ND		2000	500	ug/L			03/27/26 03:46	400
p-Chlorotoluene	ND		400	340	ug/L			03/27/26 03:46	400
p-Cymene	ND		400	120	ug/L			03/27/26 03:46	400
4-Methyl-2-pentanone (MIBK)	ND		2000	840	ug/L			03/27/26 03:46	400
Acetone	ND		4000	1200	ug/L			03/27/26 03:46	400
Benzene	**2800**		400	160	ug/L			03/27/26 03:46	400
Bromobenzene	ND		400	320	ug/L			03/27/26 03:46	400
Bromoform	ND		400	100	ug/L			03/27/26 03:46	400
Bromomethane	ND		400	280	ug/L			03/27/26 03:46	400
Carbon disulfide	ND		400	76	ug/L			03/27/26 03:46	400
Carbon tetrachloride	ND		400	110	ug/L			03/27/26 03:46	400
Chlorobenzene	**4600**		400	300	ug/L			03/27/26 03:46	400
Bromochloromethane	ND		400	350	ug/L			03/27/26 03:46	400
Chlorodibromomethane	ND		400	130	ug/L			03/27/26 03:46	400
Chloroethane	ND		400	130	ug/L			03/27/26 03:46	400
Chloroform	ND		400	140	ug/L			03/27/26 03:46	400
Chloromethane	ND		400	140	ug/L			03/27/26 03:46	400

Client Sample ID: MW-4C
Lab Sample ID: 480-237182-17

Date Collected: 03/24/26 13:45
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
cis-1,2-Dichloroethene	**23000**	**F1**	400	320	ug/L			03/27/26 03:46	400
Bromodichloromethane	ND		400	160	ug/L			03/27/26 03:46	400
Dichlorodifluoromethane	ND		400	270	ug/L			03/27/26 03:46	400
Ethylbenzene	ND		400	300	ug/L			03/27/26 03:46	400
1,2-Dibromoethane	ND		400	290	ug/L			03/27/26 03:46	400
Hexachlorobutadiene	ND		800	110	ug/L			03/27/26 03:46	400
Isopropylbenzene	ND		400	320	ug/L			03/27/26 03:46	400
Methyl tert-butyl ether	ND		400	64	ug/L			03/27/26 03:46	400
Methylene Chloride	ND		400	180	ug/L			03/27/26 03:46	400
m-Xylene & p-Xylene	ND		800	260	ug/L			03/27/26 03:46	400
Naphthalene	ND		400	170	ug/L			03/27/26 03:46	400
n-Butylbenzene	ND		400	260	ug/L			03/27/26 03:46	400
N-Propylbenzene	ND		400	280	ug/L			03/27/26 03:46	400
o-Xylene	ND		400	300	ug/L			03/27/26 03:46	400
sec-Butylbenzene	ND		400	300	ug/L			03/27/26 03:46	400
Tetrachloroethene	**370**	**J**	400	140	ug/L			03/27/26 03:46	400
Toluene	ND		400	200	ug/L			03/27/26 03:46	400
trans-1,2-Dichloroethene	ND		400	360	ug/L			03/27/26 03:46	400
trans-1,3-Dichloropropene	ND		400	150	ug/L			03/27/26 03:46	400
Trichloroethene	**1900**		400	180	ug/L			03/27/26 03:46	400
Trichlorofluoromethane	ND		400	350	ug/L			03/27/26 03:46	400
Vinyl acetate	ND		2000	340	ug/L			03/27/26 03:46	400
Vinyl chloride	**1900**		400	360	ug/L			03/27/26 03:46	400
cis-1,3-Dichloropropene	ND		400	140	ug/L			03/27/26 03:46	400
Styrene	ND		400	290	ug/L			03/27/26 03:46	400
tert-Butylbenzene	ND		400	320	ug/L			03/27/26 03:46	400

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*109*		*77 - 120*		*03/27/26 03:46*	*400*
4-Bromofluorobenzene (Surr)	*88*		*73 - 120*		*03/27/26 03:46*	*400*
Toluene-d8 (Surr)	*103*		*80 - 120*		*03/27/26 03:46*	*400*
Dibromofluoromethane (Surr)	*98*		*75 - 123*		*03/27/26 03:46*	*400*

Client Sample ID: OW-5B
Lab Sample ID: 480-237182-18

Date Collected: 03/25/26 10:30
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		100	35	ug/L			03/27/26 04:09	100
1,1,1-Trichloroethane	ND		100	82	ug/L			03/27/26 04:09	100
1,1,2,2-Tetrachloroethane	**280**		100	21	ug/L			03/27/26 04:09	100
1,1,2-Trichloroethane	ND		100	23	ug/L			03/27/26 04:09	100
1,1-Dichloroethane	ND		100	38	ug/L			03/27/26 04:09	100
1,1-Dichloroethene	ND		100	29	ug/L			03/27/26 04:09	100
1,1-Dichloropropene	ND		100	72	ug/L			03/27/26 04:09	100
1,2,3-Trichlorobenzene	ND		100	41	ug/L			03/27/26 04:09	100
1,2,3-Trichloropropane	ND		100	89	ug/L			03/27/26 04:09	100
1,2,4-Trichlorobenzene	**120**		100	41	ug/L			03/27/26 04:09	100
1,2,4-Trimethylbenzene	ND		100	75	ug/L			03/27/26 04:09	100

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-5B
Lab Sample ID: 480-237182-18
Date Collected: 03/25/26 10:30
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,2-Dibromo-3-Chloropropane	ND		100	39	ug/L			03/27/26 04:09	100
1,2-Dichlorobenzene	**120**		100	79	ug/L			03/27/26 04:09	100
1,2-Dichloroethane	ND		100	21	ug/L			03/27/26 04:09	100
1,2-Dichloropropane	ND		100	72	ug/L			03/27/26 04:09	100
1,3,5-Trimethylbenzene	ND		100	77	ug/L			03/27/26 04:09	100
1,3-Dichlorobenzene	**100**		100	78	ug/L			03/27/26 04:09	100
1,3-Dichloropropane	ND		100	75	ug/L			03/27/26 04:09	100
1,4-Dichlorobenzene	**150**		100	84	ug/L			03/27/26 04:09	100
2,2-Dichloropropane	ND		100	40	ug/L			03/27/26 04:09	100
2-Butanone (MEK)	**400**	**J**	1000	130	ug/L			03/27/26 04:09	100
2-Chloroethyl vinyl ether	ND		500	96	ug/L			03/27/26 04:09	100
o-Chlorotoluene	ND		100	86	ug/L			03/27/26 04:09	100
2-Hexanone	ND		500	120	ug/L			03/27/26 04:09	100
p-Chlorotoluene	ND		100	84	ug/L			03/27/26 04:09	100
p-Cymene	ND		100	31	ug/L			03/27/26 04:09	100
4-Methyl-2-pentanone (MIBK)	ND		500	210	ug/L			03/27/26 04:09	100
Acetone	ND		1000	300	ug/L			03/27/26 04:09	100
Benzene	**41**	**J**	100	41	ug/L			03/27/26 04:09	100
Bromobenzene	ND		100	80	ug/L			03/27/26 04:09	100
Bromoform	ND		100	26	ug/L			03/27/26 04:09	100
Bromomethane	ND		100	69	ug/L			03/27/26 04:09	100
Carbon disulfide	ND		100	19	ug/L			03/27/26 04:09	100
Carbon tetrachloride	ND		100	27	ug/L			03/27/26 04:09	100
Chlorobenzene	**190**		100	75	ug/L			03/27/26 04:09	100
Bromochloromethane	ND		100	87	ug/L			03/27/26 04:09	100
Chlorodibromomethane	ND		100	32	ug/L			03/27/26 04:09	100
Chloroethane	ND		100	32	ug/L			03/27/26 04:09	100
Chloroform	ND		100	34	ug/L			03/27/26 04:09	100
Chloromethane	ND		100	35	ug/L			03/27/26 04:09	100
cis-1,2-Dichloroethene	**2300**		100	81	ug/L			03/27/26 04:09	100
Bromodichloromethane	ND		100	39	ug/L			03/27/26 04:09	100
Dichlorodifluoromethane	ND		100	68	ug/L			03/27/26 04:09	100
Ethylbenzene	ND		100	74	ug/L			03/27/26 04:09	100
1,2-Dibromoethane	ND		100	73	ug/L			03/27/26 04:09	100
Hexachlorobutadiene	ND		200	28	ug/L			03/27/26 04:09	100
Isopropylbenzene	ND		100	79	ug/L			03/27/26 04:09	100
Methyl tert-butyl ether	ND		100	16	ug/L			03/27/26 04:09	100
Methylene Chloride	ND		100	44	ug/L			03/27/26 04:09	100
m-Xylene & p-Xylene	ND		200	66	ug/L			03/27/26 04:09	100
Naphthalene	ND		100	43	ug/L			03/27/26 04:09	100
n-Butylbenzene	ND		100	64	ug/L			03/27/26 04:09	100
N-Propylbenzene	ND		100	69	ug/L			03/27/26 04:09	100
o-Xylene	ND		100	76	ug/L			03/27/26 04:09	100
sec-Butylbenzene	ND		100	75	ug/L			03/27/26 04:09	100
Tetrachloroethene	**2600**		100	36	ug/L			03/27/26 04:09	100
Toluene	ND		100	51	ug/L			03/27/26 04:09	100
trans-1,2-Dichloroethene	ND		100	90	ug/L			03/27/26 04:09	100
trans-1,3-Dichloropropene	ND		100	37	ug/L			03/27/26 04:09	100
Trichloroethene	**7200**		100	46	ug/L			03/27/26 04:09	100

Client Sample ID: OW-5B
Lab Sample ID: 480-237182-18

Date Collected: 03/25/26 10:30
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Trichlorofluoromethane	ND		100	88	ug/L			03/27/26 04:09	100
Vinyl acetate	ND		500	85	ug/L			03/27/26 04:09	100
Vinyl chloride	**110**		100	90	ug/L			03/27/26 04:09	100
cis-1,3-Dichloropropene	ND		100	36	ug/L			03/27/26 04:09	100
Styrene	ND		100	73	ug/L			03/27/26 04:09	100
tert-Butylbenzene	ND		100	81	ug/L			03/27/26 04:09	100

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*110*		*77 - 120*		*03/27/26 04:09*	*100*
4-Bromofluorobenzene (Surr)	*84*		*73 - 120*		*03/27/26 04:09*	*100*
Toluene-d8 (Surr)	*103*		*80 - 120*		*03/27/26 04:09*	*100*
Dibromofluoromethane (Surr)	*105*		*75 - 123*		*03/27/26 04:09*	*100*

Client Sample ID: OW-105B
Lab Sample ID: 480-237182-19

Date Collected: 03/25/26 11:30
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		100	35	ug/L			03/27/26 04:33	100
1,1,1-Trichloroethane	ND		100	82	ug/L			03/27/26 04:33	100
1,1,2,2-Tetrachloroethane	**270**		100	21	ug/L			03/27/26 04:33	100
1,1,2-Trichloroethane	ND		100	23	ug/L			03/27/26 04:33	100
1,1-Dichloroethane	ND		100	38	ug/L			03/27/26 04:33	100
1,1-Dichloroethene	ND		100	29	ug/L			03/27/26 04:33	100
1,1-Dichloropropene	ND		100	72	ug/L			03/27/26 04:33	100
1,2,3-Trichlorobenzene	ND		100	41	ug/L			03/27/26 04:33	100
1,2,3-Trichloropropane	ND		100	89	ug/L			03/27/26 04:33	100
1,2,4-Trichlorobenzene	**110**		100	41	ug/L			03/27/26 04:33	100
1,2,4-Trimethylbenzene	ND		100	75	ug/L			03/27/26 04:33	100
1,2-Dibromo-3-Chloropropane	ND		100	39	ug/L			03/27/26 04:33	100
1,2-Dichlorobenzene	**120**		100	79	ug/L			03/27/26 04:33	100
1,2-Dichloroethane	ND		100	21	ug/L			03/27/26 04:33	100
1,2-Dichloropropane	ND		100	72	ug/L			03/27/26 04:33	100
1,3,5-Trimethylbenzene	ND		100	77	ug/L			03/27/26 04:33	100
1,3-Dichlorobenzene	**100**		100	78	ug/L			03/27/26 04:33	100
1,3-Dichloropropane	ND		100	75	ug/L			03/27/26 04:33	100
1,4-Dichlorobenzene	**160**		100	84	ug/L			03/27/26 04:33	100
2,2-Dichloropropane	ND		100	40	ug/L			03/27/26 04:33	100
2-Butanone (MEK)	**390**	**J**	1000	130	ug/L			03/27/26 04:33	100
2-Chloroethyl vinyl ether	ND		500	96	ug/L			03/27/26 04:33	100
o-Chlorotoluene	ND		100	86	ug/L			03/27/26 04:33	100
2-Hexanone	ND		500	120	ug/L			03/27/26 04:33	100
p-Chlorotoluene	ND		100	84	ug/L			03/27/26 04:33	100
p-Cymene	ND		100	31	ug/L			03/27/26 04:33	100
4-Methyl-2-pentanone (MIBK)	ND		500	210	ug/L			03/27/26 04:33	100
Acetone	ND		1000	300	ug/L			03/27/26 04:33	100
Benzene	**43**	**J**	100	41	ug/L			03/27/26 04:33	100
Bromobenzene	ND		100	80	ug/L			03/27/26 04:33	100
Bromoform	ND		100	26	ug/L			03/27/26 04:33	100

Client Sample ID: OW-105B

Lab Sample ID: 480-237182-19

Date Collected: 03/25/26 11:30

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Bromomethane	ND		100	69	ug/L			03/27/26 04:33	100
Carbon disulfide	ND		100	19	ug/L			03/27/26 04:33	100
Carbon tetrachloride	ND		100	27	ug/L			03/27/26 04:33	100
Chlorobenzene	**200**		100	75	ug/L			03/27/26 04:33	100
Bromochloromethane	ND		100	87	ug/L			03/27/26 04:33	100
Chlorodibromomethane	ND		100	32	ug/L			03/27/26 04:33	100
Chloroethane	ND		100	32	ug/L			03/27/26 04:33	100
Chloroform	ND		100	34	ug/L			03/27/26 04:33	100
Chloromethane	ND		100	35	ug/L			03/27/26 04:33	100
cis-1,2-Dichloroethene	**2400**		100	81	ug/L			03/27/26 04:33	100
Bromodichloromethane	ND		100	39	ug/L			03/27/26 04:33	100
Dichlorodifluoromethane	ND		100	68	ug/L			03/27/26 04:33	100
Ethylbenzene	ND		100	74	ug/L			03/27/26 04:33	100
1,2-Dibromoethane	ND		100	73	ug/L			03/27/26 04:33	100
Hexachlorobutadiene	ND		200	28	ug/L			03/27/26 04:33	100
Isopropylbenzene	ND		100	79	ug/L			03/27/26 04:33	100
Methyl tert-butyl ether	ND		100	16	ug/L			03/27/26 04:33	100
Methylene Chloride	ND		100	44	ug/L			03/27/26 04:33	100
m-Xylene & p-Xylene	ND		200	66	ug/L			03/27/26 04:33	100
Naphthalene	ND		100	43	ug/L			03/27/26 04:33	100
n-Butylbenzene	ND		100	64	ug/L			03/27/26 04:33	100
N-Propylbenzene	ND		100	69	ug/L			03/27/26 04:33	100
o-Xylene	ND		100	76	ug/L			03/27/26 04:33	100
sec-Butylbenzene	ND		100	75	ug/L			03/27/26 04:33	100
Tetrachloroethene	**2800**		100	36	ug/L			03/27/26 04:33	100
Toluene	ND		100	51	ug/L			03/27/26 04:33	100
trans-1,2-Dichloroethene	ND		100	90	ug/L			03/27/26 04:33	100
trans-1,3-Dichloropropene	ND		100	37	ug/L			03/27/26 04:33	100
Trichloroethene	**7300**		100	46	ug/L			03/27/26 04:33	100
Trichlorofluoromethane	ND		100	88	ug/L			03/27/26 04:33	100
Vinyl acetate	ND		500	85	ug/L			03/27/26 04:33	100
Vinyl chloride	**120**		100	90	ug/L			03/27/26 04:33	100
cis-1,3-Dichloropropene	ND		100	36	ug/L			03/27/26 04:33	100
Styrene	ND		100	73	ug/L			03/27/26 04:33	100
tert-Butylbenzene	ND		100	81	ug/L			03/27/26 04:33	100

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*110*		*77 - 120*		*03/27/26 04:33*	*100*
4-Bromofluorobenzene (Surr)	*87*		*73 - 120*		*03/27/26 04:33*	*100*
Toluene-d8 (Surr)	*105*		*80 - 120*		*03/27/26 04:33*	*100*
Dibromofluoromethane (Surr)	*103*		*75 - 123*		*03/27/26 04:33*	*100*

Client Sample ID: OW-6B

Lab Sample ID: 480-237182-20

Date Collected: 03/25/26 08:40

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		80	28	ug/L			03/27/26 04:56	80
1,1,1-Trichloroethane	ND		80	66	ug/L			03/27/26 04:56	80

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-6B
Lab Sample ID: 480-237182-20
Date Collected: 03/25/26 08:40
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	**59**	**J**	80	17	ug/L			03/27/26 04:56	80
1,1,2-Trichloroethane	ND		80	18	ug/L			03/27/26 04:56	80
1,1-Dichloroethane	ND		80	30	ug/L			03/27/26 04:56	80
1,1-Dichloroethene	ND		80	23	ug/L			03/27/26 04:56	80
1,1-Dichloropropene	ND		80	58	ug/L			03/27/26 04:56	80
1,2,3-Trichlorobenzene	ND		80	33	ug/L			03/27/26 04:56	80
1,2,3-Trichloropropane	ND		80	71	ug/L			03/27/26 04:56	80
1,2,4-Trichlorobenzene	**300**		80	33	ug/L			03/27/26 04:56	80
1,2,4-Trimethylbenzene	ND		80	60	ug/L			03/27/26 04:56	80
1,2-Dibromo-3-Chloropropane	ND		80	31	ug/L			03/27/26 04:56	80
1,2-Dichlorobenzene	**230**		80	63	ug/L			03/27/26 04:56	80
1,2-Dichloroethane	ND		80	17	ug/L			03/27/26 04:56	80
1,2-Dichloropropane	ND		80	58	ug/L			03/27/26 04:56	80
1,3,5-Trimethylbenzene	ND		80	62	ug/L			03/27/26 04:56	80
1,3-Dichlorobenzene	**160**		80	62	ug/L			03/27/26 04:56	80
1,3-Dichloropropane	ND		80	60	ug/L			03/27/26 04:56	80
1,4-Dichlorobenzene	**300**		80	67	ug/L			03/27/26 04:56	80
2,2-Dichloropropane	ND		80	32	ug/L			03/27/26 04:56	80
2-Butanone (MEK)	**330**	**J**	800	110	ug/L			03/27/26 04:56	80
2-Chloroethyl vinyl ether	ND		400	77	ug/L			03/27/26 04:56	80
o-Chlorotoluene	ND		80	69	ug/L			03/27/26 04:56	80
2-Hexanone	ND		400	99	ug/L			03/27/26 04:56	80
p-Chlorotoluene	ND		80	67	ug/L			03/27/26 04:56	80
p-Cymene	ND		80	25	ug/L			03/27/26 04:56	80
4-Methyl-2-pentanone (MIBK)	ND		400	170	ug/L			03/27/26 04:56	80
Acetone	ND		800	240	ug/L			03/27/26 04:56	80
Benzene	**38**	**J**	80	33	ug/L			03/27/26 04:56	80
Bromobenzene	ND		80	64	ug/L			03/27/26 04:56	80
Bromoform	ND		80	21	ug/L			03/27/26 04:56	80
Bromomethane	ND		80	55	ug/L			03/27/26 04:56	80
Carbon disulfide	ND		80	15	ug/L			03/27/26 04:56	80
Carbon tetrachloride	ND		80	22	ug/L			03/27/26 04:56	80
Chlorobenzene	**300**		80	60	ug/L			03/27/26 04:56	80
Bromochloromethane	ND		80	70	ug/L			03/27/26 04:56	80
Chlorodibromomethane	ND		80	26	ug/L			03/27/26 04:56	80
Chloroethane	ND		80	26	ug/L			03/27/26 04:56	80
Chloroform	ND		80	27	ug/L			03/27/26 04:56	80
Chloromethane	ND		80	28	ug/L			03/27/26 04:56	80
cis-1,2-Dichloroethene	**2500**		80	65	ug/L			03/27/26 04:56	80
Bromodichloromethane	ND		80	31	ug/L			03/27/26 04:56	80
Dichlorodifluoromethane	ND		80	54	ug/L			03/27/26 04:56	80
Ethylbenzene	ND		80	59	ug/L			03/27/26 04:56	80
1,2-Dibromoethane	ND		80	58	ug/L			03/27/26 04:56	80
Hexachlorobutadiene	ND		160	22	ug/L			03/27/26 04:56	80
Isopropylbenzene	ND		80	63	ug/L			03/27/26 04:56	80
Methyl tert-butyl ether	ND		80	13	ug/L			03/27/26 04:56	80
Methylene Chloride	ND		80	35	ug/L			03/27/26 04:56	80
m-Xylene & p-Xylene	ND		160	53	ug/L			03/27/26 04:56	80
Naphthalene	ND		80	34	ug/L			03/27/26 04:56	80

Client Sample ID: OW-6B
Lab Sample ID: 480-237182-20

Date Collected: 03/25/26 08:40
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
n-Butylbenzene	ND		80	51	ug/L			03/27/26 04:56	80
N-Propylbenzene	ND		80	55	ug/L			03/27/26 04:56	80
o-Xylene	ND		80	61	ug/L			03/27/26 04:56	80
sec-Butylbenzene	ND		80	60	ug/L			03/27/26 04:56	80
Tetrachloroethene	**770**		80	29	ug/L			03/27/26 04:56	80
Toluene	ND		80	41	ug/L			03/27/26 04:56	80
trans-1,2-Dichloroethene	ND		80	72	ug/L			03/27/26 04:56	80
trans-1,3-Dichloropropene	ND		80	30	ug/L			03/27/26 04:56	80
Trichloroethene	**1700**		80	37	ug/L			03/27/26 04:56	80
Trichlorofluoromethane	ND		80	70	ug/L			03/27/26 04:56	80
Vinyl acetate	ND		400	68	ug/L			03/27/26 04:56	80
Vinyl chloride	**250**		80	72	ug/L			03/27/26 04:56	80
cis-1,3-Dichloropropene	ND		80	29	ug/L			03/27/26 04:56	80
Styrene	ND		80	58	ug/L			03/27/26 04:56	80
tert-Butylbenzene	ND		80	65	ug/L			03/27/26 04:56	80

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*111*		*77 - 120*		*03/27/26 04:56*	*80*
4-Bromofluorobenzene (Surr)	*85*		*73 - 120*		*03/27/26 04:56*	*80*
Toluene-d8 (Surr)	*104*		*80 - 120*		*03/27/26 04:56*	*80*
Dibromofluoromethane (Surr)	*101*		*75 - 123*		*03/27/26 04:56*	*80*

Client Sample ID: OW-7B
Lab Sample ID: 480-237182-21

Date Collected: 03/25/26 08:50
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		4.0	1.4	ug/L			03/27/26 16:25	4
1,1,1-Trichloroethane	ND		4.0	3.3	ug/L			03/27/26 16:25	4
1,1,2,2-Tetrachloroethane	**23**		4.0	0.84	ug/L			03/27/26 16:25	4
1,1,2-Trichloroethane	ND		4.0	0.92	ug/L			03/27/26 16:25	4
1,1-Dichloroethane	ND		4.0	1.5	ug/L			03/27/26 16:25	4
1,1-Dichloroethene	ND		4.0	1.2	ug/L			03/27/26 16:25	4
1,1-Dichloropropene	ND		4.0	2.9	ug/L			03/27/26 16:25	4
1,2,3-Trichlorobenzene	ND		4.0	1.6	ug/L			03/27/26 16:25	4
1,2,3-Trichloropropane	ND		4.0	3.6	ug/L			03/27/26 16:25	4
1,2,4-Trichlorobenzene	ND		4.0	1.6	ug/L			03/27/26 16:25	4
1,2,4-Trimethylbenzene	ND		4.0	3.0	ug/L			03/27/26 16:25	4
1,2-Dibromo-3-Chloropropane	ND		4.0	1.6	ug/L			03/27/26 16:25	4
1,2-Dichlorobenzene	ND		4.0	3.2	ug/L			03/27/26 16:25	4
1,2-Dichloroethane	ND		4.0	0.84	ug/L			03/27/26 16:25	4
1,2-Dichloropropane	ND		4.0	2.9	ug/L			03/27/26 16:25	4
1,3,5-Trimethylbenzene	ND		4.0	3.1	ug/L			03/27/26 16:25	4
1,3-Dichlorobenzene	ND		4.0	3.1	ug/L			03/27/26 16:25	4
1,3-Dichloropropane	ND		4.0	3.0	ug/L			03/27/26 16:25	4
1,4-Dichlorobenzene	**5.0**		4.0	3.4	ug/L			03/27/26 16:25	4
2,2-Dichloropropane	ND		4.0	1.6	ug/L			03/27/26 16:25	4
2-Butanone (MEK)	**18**	**J B**	40	5.3	ug/L			03/27/26 16:25	4
2-Chloroethyl vinyl ether	ND		20	3.8	ug/L			03/27/26 16:25	4

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-7B
Lab Sample ID: 480-237182-21
Date Collected: 03/25/26 08:50
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
o-Chlorotoluene	ND		4.0	3.4	ug/L			03/27/26 16:25	4
2-Hexanone	ND		20	5.0	ug/L			03/27/26 16:25	4
p-Chlorotoluene	ND		4.0	3.4	ug/L			03/27/26 16:25	4
p-Cymene	ND		4.0	1.2	ug/L			03/27/26 16:25	4
4-Methyl-2-pentanone (MIBK)	ND		20	8.4	ug/L			03/27/26 16:25	4
Acetone	ND		40	12	ug/L			03/27/26 16:25	4
Benzene	ND		4.0	1.6	ug/L			03/27/26 16:25	4
Bromobenzene	ND		4.0	3.2	ug/L			03/27/26 16:25	4
Bromoform	ND		4.0	1.0	ug/L			03/27/26 16:25	4
Bromomethane	ND		4.0	2.8	ug/L			03/27/26 16:25	4
Carbon disulfide	ND		4.0	0.76	ug/L			03/27/26 16:25	4
Carbon tetrachloride	ND		4.0	1.1	ug/L			03/27/26 16:25	4
Chlorobenzene	**24**		4.0	3.0	ug/L			03/27/26 16:25	4
Bromochloromethane	ND		4.0	3.5	ug/L			03/27/26 16:25	4
Chlorodibromomethane	ND		4.0	1.3	ug/L			03/27/26 16:25	4
Chloroethane	ND		4.0	1.3	ug/L			03/27/26 16:25	4
Chloroform	**2.7**	**J**	4.0	1.4	ug/L			03/27/26 16:25	4
Chloromethane	ND		4.0	1.4	ug/L			03/27/26 16:25	4
cis-1,2-Dichloroethene	**59**		4.0	3.2	ug/L			03/27/26 16:25	4
Bromodichloromethane	ND		4.0	1.6	ug/L			03/27/26 16:25	4
Dichlorodifluoromethane	ND		4.0	2.7	ug/L			03/27/26 16:25	4
Ethylbenzene	ND		4.0	3.0	ug/L			03/27/26 16:25	4
1,2-Dibromoethane	ND		4.0	2.9	ug/L			03/27/26 16:25	4
Hexachlorobutadiene	ND		8.0	1.1	ug/L			03/27/26 16:25	4
Isopropylbenzene	ND		4.0	3.2	ug/L			03/27/26 16:25	4
Methyl tert-butyl ether	ND		4.0	0.64	ug/L			03/27/26 16:25	4
Methylene Chloride	ND		4.0	1.8	ug/L			03/27/26 16:25	4
m-Xylene & p-Xylene	ND		8.0	2.6	ug/L			03/27/26 16:25	4
Naphthalene	ND		4.0	1.7	ug/L			03/27/26 16:25	4
n-Butylbenzene	ND		4.0	2.6	ug/L			03/27/26 16:25	4
N-Propylbenzene	ND		4.0	2.8	ug/L			03/27/26 16:25	4
o-Xylene	ND		4.0	3.0	ug/L			03/27/26 16:25	4
sec-Butylbenzene	ND		4.0	3.0	ug/L			03/27/26 16:25	4
Tetrachloroethene	**96**		4.0	1.4	ug/L			03/27/26 16:25	4
Toluene	ND		4.0	2.0	ug/L			03/27/26 16:25	4
trans-1,2-Dichloroethene	**14**		4.0	3.6	ug/L			03/27/26 16:25	4
trans-1,3-Dichloropropene	ND		4.0	1.5	ug/L			03/27/26 16:25	4
Trichloroethene	**160**		4.0	1.8	ug/L			03/27/26 16:25	4
Trichlorofluoromethane	ND		4.0	3.5	ug/L			03/27/26 16:25	4
Vinyl acetate	ND		20	3.4	ug/L			03/27/26 16:25	4
Vinyl chloride	ND		4.0	3.6	ug/L			03/27/26 16:25	4
cis-1,3-Dichloropropene	ND		4.0	1.4	ug/L			03/27/26 16:25	4
Styrene	ND		4.0	2.9	ug/L			03/27/26 16:25	4
tert-Butylbenzene	ND		4.0	3.2	ug/L			03/27/26 16:25	4

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*113*		*77 - 120*		*03/27/26 16:25*	*4*
4-Bromofluorobenzene (Surr)	*87*		*73 - 120*		*03/27/26 16:25*	*4*
Toluene-d8 (Surr)	*106*		*80 - 120*		*03/27/26 16:25*	*4*
Dibromofluoromethane (Surr)	*103*		*75 - 123*		*03/27/26 16:25*	*4*

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-8B
Lab Sample ID: 480-237182-22
Date Collected: 03/25/26 09:00
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			03/27/26 05:43	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			03/27/26 05:43	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			03/27/26 05:43	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			03/27/26 05:43	1
1,1-Dichloroethane	**0.80**	**J**	1.0	0.38	ug/L			03/27/26 05:43	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			03/27/26 05:43	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			03/27/26 05:43	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			03/27/26 05:43	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			03/27/26 05:43	1
1,2,4-Trichlorobenzene	**2.1**		1.0	0.41	ug/L			03/27/26 05:43	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			03/27/26 05:43	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			03/27/26 05:43	1
1,2-Dichlorobenzene	**13**		1.0	0.79	ug/L			03/27/26 05:43	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			03/27/26 05:43	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			03/27/26 05:43	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			03/27/26 05:43	1
1,3-Dichlorobenzene	**17**		1.0	0.78	ug/L			03/27/26 05:43	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			03/27/26 05:43	1
1,4-Dichlorobenzene	**15**		1.0	0.84	ug/L			03/27/26 05:43	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			03/27/26 05:43	1
2-Butanone (MEK)	**4.6**	**J**	10	1.3	ug/L			03/27/26 05:43	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			03/27/26 05:43	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			03/27/26 05:43	1
2-Hexanone	ND		5.0	1.2	ug/L			03/27/26 05:43	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			03/27/26 05:43	1
p-Cymene	ND		1.0	0.31	ug/L			03/27/26 05:43	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			03/27/26 05:43	1
Acetone	**5.7**	**J**	10	3.0	ug/L			03/27/26 05:43	1
Benzene	ND		1.0	0.41	ug/L			03/27/26 05:43	1
Bromobenzene	ND		1.0	0.80	ug/L			03/27/26 05:43	1
Bromoform	ND		1.0	0.26	ug/L			03/27/26 05:43	1
Bromomethane	ND		1.0	0.69	ug/L			03/27/26 05:43	1
Carbon disulfide	ND		1.0	0.19	ug/L			03/27/26 05:43	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			03/27/26 05:43	1
Chlorobenzene	**2.2**		1.0	0.75	ug/L			03/27/26 05:43	1
Bromochloromethane	ND		1.0	0.87	ug/L			03/27/26 05:43	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			03/27/26 05:43	1
Chloroethane	ND		1.0	0.32	ug/L			03/27/26 05:43	1
Chloroform	ND		1.0	0.34	ug/L			03/27/26 05:43	1
Chloromethane	ND		1.0	0.35	ug/L			03/27/26 05:43	1
cis-1,2-Dichloroethene	**18**		1.0	0.81	ug/L			03/27/26 05:43	1
Bromodichloromethane	ND		1.0	0.39	ug/L			03/27/26 05:43	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			03/27/26 05:43	1
Ethylbenzene	ND		1.0	0.74	ug/L			03/27/26 05:43	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			03/27/26 05:43	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			03/27/26 05:43	1
Isopropylbenzene	ND		1.0	0.79	ug/L			03/27/26 05:43	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			03/27/26 05:43	1
Methylene Chloride	ND		1.0	0.44	ug/L			03/27/26 05:43	1

Client Sample ID: OW-8B
Lab Sample ID: 480-237182-22

Date Collected: 03/25/26 09:00
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			03/27/26 05:43	1
Naphthalene	ND		1.0	0.43	ug/L			03/27/26 05:43	1
n-Butylbenzene	ND		1.0	0.64	ug/L			03/27/26 05:43	1
N-Propylbenzene	ND		1.0	0.69	ug/L			03/27/26 05:43	1
o-Xylene	ND		1.0	0.76	ug/L			03/27/26 05:43	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			03/27/26 05:43	1
Tetrachloroethene	**0.45**	**J**	1.0	0.36	ug/L			03/27/26 05:43	1
Toluene	ND		1.0	0.51	ug/L			03/27/26 05:43	1
trans-1,2-Dichloroethene	**1.3**		1.0	0.90	ug/L			03/27/26 05:43	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			03/27/26 05:43	1
Trichloroethene	**12**		1.0	0.46	ug/L			03/27/26 05:43	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			03/27/26 05:43	1
Vinyl acetate	ND		5.0	0.85	ug/L			03/27/26 05:43	1
Vinyl chloride	**1.5**		1.0	0.90	ug/L			03/27/26 05:43	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			03/27/26 05:43	1
Styrene	ND		1.0	0.73	ug/L			03/27/26 05:43	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			03/27/26 05:43	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*111*		*77 - 120*		*03/27/26 05:43*	*1*
4-Bromofluorobenzene (Surr)	*89*		*73 - 120*		*03/27/26 05:43*	*1*
Toluene-d8 (Surr)	*106*		*80 - 120*		*03/27/26 05:43*	*1*
Dibromofluoromethane (Surr)	*102*		*75 - 123*		*03/27/26 05:43*	*1*

Client Sample ID: MW-6B
Lab Sample ID: 480-237182-23

Date Collected: 03/25/26 11:44
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		80	28	ug/L			03/27/26 06:06	80
1,1,1-Trichloroethane	ND		80	66	ug/L			03/27/26 06:06	80
1,1,2,2-Tetrachloroethane	ND		80	17	ug/L			03/27/26 06:06	80
1,1,2-Trichloroethane	ND		80	18	ug/L			03/27/26 06:06	80
1,1-Dichloroethane	ND		80	30	ug/L			03/27/26 06:06	80
1,1-Dichloroethene	ND		80	23	ug/L			03/27/26 06:06	80
1,1-Dichloropropene	ND		80	58	ug/L			03/27/26 06:06	80
1,2,3-Trichlorobenzene	**47**	**J**	80	33	ug/L			03/27/26 06:06	80
1,2,3-Trichloropropane	ND		80	71	ug/L			03/27/26 06:06	80
1,2,4-Trichlorobenzene	**160**		80	33	ug/L			03/27/26 06:06	80
1,2,4-Trimethylbenzene	ND		80	60	ug/L			03/27/26 06:06	80
1,2-Dibromo-3-Chloropropane	ND		80	31	ug/L			03/27/26 06:06	80
1,2-Dichlorobenzene	**3400**		80	63	ug/L			03/27/26 06:06	80
1,2-Dichloroethane	ND		80	17	ug/L			03/27/26 06:06	80
1,2-Dichloropropane	ND		80	58	ug/L			03/27/26 06:06	80
1,3,5-Trimethylbenzene	ND		80	62	ug/L			03/27/26 06:06	80
1,3-Dichlorobenzene	**1000**		80	62	ug/L			03/27/26 06:06	80
1,3-Dichloropropane	ND		80	60	ug/L			03/27/26 06:06	80
1,4-Dichlorobenzene	**2200**		80	67	ug/L			03/27/26 06:06	80
2,2-Dichloropropane	ND		80	32	ug/L			03/27/26 06:06	80

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: MW-6B
Lab Sample ID: 480-237182-23
Date Collected: 03/25/26 11:44
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
2-Butanone (MEK)	**310**	**J**	800	110	ug/L			03/27/26 06:06	80
2-Chloroethyl vinyl ether	ND		400	77	ug/L			03/27/26 06:06	80
o-Chlorotoluene	ND		80	69	ug/L			03/27/26 06:06	80
2-Hexanone	ND		400	99	ug/L			03/27/26 06:06	80
p-Chlorotoluene	ND		80	67	ug/L			03/27/26 06:06	80
p-Cymene	ND		80	25	ug/L			03/27/26 06:06	80
4-Methyl-2-pentanone (MIBK)	ND		400	170	ug/L			03/27/26 06:06	80
Acetone	ND		800	240	ug/L			03/27/26 06:06	80
Benzene	**170**		80	33	ug/L			03/27/26 06:06	80
Bromobenzene	ND		80	64	ug/L			03/27/26 06:06	80
Bromoform	ND		80	21	ug/L			03/27/26 06:06	80
Bromomethane	ND		80	55	ug/L			03/27/26 06:06	80
Carbon disulfide	ND		80	15	ug/L			03/27/26 06:06	80
Carbon tetrachloride	ND		80	22	ug/L			03/27/26 06:06	80
Chlorobenzene	**2300**		80	60	ug/L			03/27/26 06:06	80
Bromochloromethane	ND		80	70	ug/L			03/27/26 06:06	80
Chlorodibromomethane	ND		80	26	ug/L			03/27/26 06:06	80
Chloroethane	ND		80	26	ug/L			03/27/26 06:06	80
Chloroform	ND		80	27	ug/L			03/27/26 06:06	80
Chloromethane	ND		80	28	ug/L			03/27/26 06:06	80
cis-1,2-Dichloroethene	ND		80	65	ug/L			03/27/26 06:06	80
Bromodichloromethane	ND		80	31	ug/L			03/27/26 06:06	80
Dichlorodifluoromethane	ND		80	54	ug/L			03/27/26 06:06	80
Ethylbenzene	ND		80	59	ug/L			03/27/26 06:06	80
1,2-Dibromoethane	ND		80	58	ug/L			03/27/26 06:06	80
Hexachlorobutadiene	ND		160	22	ug/L			03/27/26 06:06	80
Isopropylbenzene	ND		80	63	ug/L			03/27/26 06:06	80
Methyl tert-butyl ether	ND		80	13	ug/L			03/27/26 06:06	80
Methylene Chloride	ND		80	35	ug/L			03/27/26 06:06	80
m-Xylene & p-Xylene	ND		160	53	ug/L			03/27/26 06:06	80
Naphthalene	ND		80	34	ug/L			03/27/26 06:06	80
n-Butylbenzene	ND		80	51	ug/L			03/27/26 06:06	80
N-Propylbenzene	ND		80	55	ug/L			03/27/26 06:06	80
o-Xylene	ND		80	61	ug/L			03/27/26 06:06	80
sec-Butylbenzene	ND		80	60	ug/L			03/27/26 06:06	80
Tetrachloroethene	ND		80	29	ug/L			03/27/26 06:06	80
Toluene	ND		80	41	ug/L			03/27/26 06:06	80
trans-1,2-Dichloroethene	ND		80	72	ug/L			03/27/26 06:06	80
trans-1,3-Dichloropropene	ND		80	30	ug/L			03/27/26 06:06	80
Trichloroethene	ND		80	37	ug/L			03/27/26 06:06	80
Trichlorofluoromethane	ND		80	70	ug/L			03/27/26 06:06	80
Vinyl acetate	ND		400	68	ug/L			03/27/26 06:06	80
Vinyl chloride	ND		80	72	ug/L			03/27/26 06:06	80
cis-1,3-Dichloropropene	ND		80	29	ug/L			03/27/26 06:06	80
Styrene	ND		80	58	ug/L			03/27/26 06:06	80
tert-Butylbenzene	ND		80	65	ug/L			03/27/26 06:06	80

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*111*		*77 - 120*		*03/27/26 06:06*	*80*
4-Bromofluorobenzene (Surr)	*86*		*73 - 120*		*03/27/26 06:06*	*80*

Client Sample ID: MW-6B
Lab Sample ID: 480-237182-23

Date Collected: 03/25/26 11:44
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
Toluene-d8 (Surr)	*103*		*80 - 120*		*03/27/26 06:06*	*80*
Dibromofluoromethane (Surr)	*101*		*75 - 123*		*03/27/26 06:06*	*80*

Client Sample ID: MW-6F
Lab Sample ID: 480-237182-24

Date Collected: 03/25/26 12:00
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		10	3.5	ug/L			03/27/26 06:29	10
1,1,1-Trichloroethane	ND		10	8.2	ug/L			03/27/26 06:29	10
1,1,2,2-Tetrachloroethane	ND		10	2.1	ug/L			03/27/26 06:29	10
1,1,2-Trichloroethane	ND		10	2.3	ug/L			03/27/26 06:29	10
1,1-Dichloroethane	ND		10	3.8	ug/L			03/27/26 06:29	10
1,1-Dichloroethene	ND		10	2.9	ug/L			03/27/26 06:29	10
1,1-Dichloropropene	ND		10	7.2	ug/L			03/27/26 06:29	10
1,2,3-Trichlorobenzene	ND		10	4.1	ug/L			03/27/26 06:29	10
1,2,3-Trichloropropane	ND		10	8.9	ug/L			03/27/26 06:29	10
1,2,4-Trichlorobenzene	ND		10	4.1	ug/L			03/27/26 06:29	10
1,2,4-Trimethylbenzene	ND		10	7.5	ug/L			03/27/26 06:29	10
1,2-Dibromo-3-Chloropropane	ND		10	3.9	ug/L			03/27/26 06:29	10
1,2-Dichlorobenzene	ND		10	7.9	ug/L			03/27/26 06:29	10
1,2-Dichloroethane	ND		10	2.1	ug/L			03/27/26 06:29	10
1,2-Dichloropropane	ND		10	7.2	ug/L			03/27/26 06:29	10
1,3,5-Trimethylbenzene	ND		10	7.7	ug/L			03/27/26 06:29	10
1,3-Dichlorobenzene	ND		10	7.8	ug/L			03/27/26 06:29	10
1,3-Dichloropropane	ND		10	7.5	ug/L			03/27/26 06:29	10
1,4-Dichlorobenzene	ND		10	8.4	ug/L			03/27/26 06:29	10
2,2-Dichloropropane	ND		10	4.0	ug/L			03/27/26 06:29	10
2-Butanone (MEK)	**72**	**J**	100	13	ug/L			03/27/26 06:29	10
2-Chloroethyl vinyl ether	ND		50	9.6	ug/L			03/27/26 06:29	10
o-Chlorotoluene	ND		10	8.6	ug/L			03/27/26 06:29	10
2-Hexanone	ND		50	12	ug/L			03/27/26 06:29	10
p-Chlorotoluene	ND		10	8.4	ug/L			03/27/26 06:29	10
p-Cymene	ND		10	3.1	ug/L			03/27/26 06:29	10
4-Methyl-2-pentanone (MIBK)	ND		50	21	ug/L			03/27/26 06:29	10
Acetone	ND		100	30	ug/L			03/27/26 06:29	10
Benzene	ND		10	4.1	ug/L			03/27/26 06:29	10
Bromobenzene	ND		10	8.0	ug/L			03/27/26 06:29	10
Bromoform	ND		10	2.6	ug/L			03/27/26 06:29	10
Bromomethane	ND		10	6.9	ug/L			03/27/26 06:29	10
Carbon disulfide	ND		10	1.9	ug/L			03/27/26 06:29	10
Carbon tetrachloride	ND		10	2.7	ug/L			03/27/26 06:29	10
Chlorobenzene	ND		10	7.5	ug/L			03/27/26 06:29	10
Bromochloromethane	ND		10	8.7	ug/L			03/27/26 06:29	10
Chlorodibromomethane	ND		10	3.2	ug/L			03/27/26 06:29	10
Chloroethane	ND		10	3.2	ug/L			03/27/26 06:29	10
Chloroform	ND		10	3.4	ug/L			03/27/26 06:29	10
Chloromethane	ND		10	3.5	ug/L			03/27/26 06:29	10

Client Sample ID: MW-6F

Lab Sample ID: 480-237182-24

Date Collected: 03/25/26 12:00

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
cis-1,2-Dichloroethene	**330**		10	8.1	ug/L			03/27/26 06:29	10
Bromodichloromethane	ND		10	3.9	ug/L			03/27/26 06:29	10
Dichlorodifluoromethane	ND		10	6.8	ug/L			03/27/26 06:29	10
Ethylbenzene	ND		10	7.4	ug/L			03/27/26 06:29	10
1,2-Dibromoethane	ND		10	7.3	ug/L			03/27/26 06:29	10
Hexachlorobutadiene	ND		20	2.8	ug/L			03/27/26 06:29	10
Isopropylbenzene	ND		10	7.9	ug/L			03/27/26 06:29	10
Methyl tert-butyl ether	ND		10	1.6	ug/L			03/27/26 06:29	10
Methylene Chloride	ND		10	4.4	ug/L			03/27/26 06:29	10
m-Xylene & p-Xylene	ND		20	6.6	ug/L			03/27/26 06:29	10
Naphthalene	ND		10	4.3	ug/L			03/27/26 06:29	10
n-Butylbenzene	ND		10	6.4	ug/L			03/27/26 06:29	10
N-Propylbenzene	ND		10	6.9	ug/L			03/27/26 06:29	10
o-Xylene	ND		10	7.6	ug/L			03/27/26 06:29	10
sec-Butylbenzene	ND		10	7.5	ug/L			03/27/26 06:29	10
Tetrachloroethene	ND		10	3.6	ug/L			03/27/26 06:29	10
Toluene	ND		10	5.1	ug/L			03/27/26 06:29	10
trans-1,2-Dichloroethene	**24**		10	9.0	ug/L			03/27/26 06:29	10
trans-1,3-Dichloropropene	ND		10	3.7	ug/L			03/27/26 06:29	10
Trichloroethene	ND		10	4.6	ug/L			03/27/26 06:29	10
Trichlorofluoromethane	ND		10	8.8	ug/L			03/27/26 06:29	10
Vinyl acetate	ND		50	8.5	ug/L			03/27/26 06:29	10
Vinyl chloride	**660**		10	9.0	ug/L			03/27/26 06:29	10
cis-1,3-Dichloropropene	ND		10	3.6	ug/L			03/27/26 06:29	10
Styrene	ND		10	7.3	ug/L			03/27/26 06:29	10
tert-Butylbenzene	ND		10	8.1	ug/L			03/27/26 06:29	10

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*110*		*77 - 120*		*03/27/26 06:29*	*10*
4-Bromofluorobenzene (Surr)	*86*		*73 - 120*		*03/27/26 06:29*	*10*
Toluene-d8 (Surr)	*105*		*80 - 120*		*03/27/26 06:29*	*10*
Dibromofluoromethane (Surr)	*101*		*75 - 123*		*03/27/26 06:29*	*10*

Client Sample ID: OW-14B

Lab Sample ID: 480-237182-25

Date Collected: 03/25/26 09:30

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		40	14	ug/L			03/27/26 16:48	40
1,1,1-Trichloroethane	ND		40	33	ug/L			03/27/26 16:48	40
1,1,2,2-Tetrachloroethane	**16**	**J**	40	8.4	ug/L			03/27/26 16:48	40
1,1,2-Trichloroethane	ND		40	9.2	ug/L			03/27/26 16:48	40
1,1-Dichloroethane	ND		40	15	ug/L			03/27/26 16:48	40
1,1-Dichloroethene	ND		40	12	ug/L			03/27/26 16:48	40
1,1-Dichloropropene	ND		40	29	ug/L			03/27/26 16:48	40
1,2,3-Trichlorobenzene	**91**		40	16	ug/L			03/27/26 16:48	40
1,2,3-Trichloropropane	ND		40	36	ug/L			03/27/26 16:48	40
1,2,4-Trichlorobenzene	**320**		40	16	ug/L			03/27/26 16:48	40
1,2,4-Trimethylbenzene	ND		40	30	ug/L			03/27/26 16:48	40

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-14B
Lab Sample ID: 480-237182-25
Date Collected: 03/25/26 09:30
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,2-Dibromo-3-Chloropropane	ND		40	16	ug/L			03/27/26 16:48	40
1,2-Dichlorobenzene	**1100**		40	32	ug/L			03/27/26 16:48	40
1,2-Dichloroethane	ND		40	8.4	ug/L			03/27/26 16:48	40
1,2-Dichloropropane	ND		40	29	ug/L			03/27/26 16:48	40
1,3,5-Trimethylbenzene	ND		40	31	ug/L			03/27/26 16:48	40
1,3-Dichlorobenzene	**720**		40	31	ug/L			03/27/26 16:48	40
1,3-Dichloropropane	ND		40	30	ug/L			03/27/26 16:48	40
1,4-Dichlorobenzene	**2100**		40	34	ug/L			03/27/26 16:48	40
2,2-Dichloropropane	ND		40	16	ug/L			03/27/26 16:48	40
2-Butanone (MEK)	**150**	**J B**	400	53	ug/L			03/27/26 16:48	40
2-Chloroethyl vinyl ether	ND		200	38	ug/L			03/27/26 16:48	40
o-Chlorotoluene	ND		40	34	ug/L			03/27/26 16:48	40
2-Hexanone	ND		200	50	ug/L			03/27/26 16:48	40
p-Chlorotoluene	ND		40	34	ug/L			03/27/26 16:48	40
p-Cymene	ND		40	12	ug/L			03/27/26 16:48	40
4-Methyl-2-pentanone (MIBK)	ND		200	84	ug/L			03/27/26 16:48	40
Acetone	ND		400	120	ug/L			03/27/26 16:48	40
Benzene	ND		40	16	ug/L			03/27/26 16:48	40
Bromobenzene	ND		40	32	ug/L			03/27/26 16:48	40
Bromoform	ND		40	10	ug/L			03/27/26 16:48	40
Bromomethane	ND		40	28	ug/L			03/27/26 16:48	40
Carbon disulfide	ND		40	7.6	ug/L			03/27/26 16:48	40
Carbon tetrachloride	ND		40	11	ug/L			03/27/26 16:48	40
Chlorobenzene	**520**		40	30	ug/L			03/27/26 16:48	40
Bromochloromethane	ND		40	35	ug/L			03/27/26 16:48	40
Chlorodibromomethane	ND		40	13	ug/L			03/27/26 16:48	40
Chloroethane	ND		40	13	ug/L			03/27/26 16:48	40
Chloroform	ND		40	14	ug/L			03/27/26 16:48	40
Chloromethane	ND		40	14	ug/L			03/27/26 16:48	40
cis-1,2-Dichloroethene	**360**		40	32	ug/L			03/27/26 16:48	40
Bromodichloromethane	ND		40	16	ug/L			03/27/26 16:48	40
Dichlorodifluoromethane	ND		40	27	ug/L			03/27/26 16:48	40
Ethylbenzene	ND		40	30	ug/L			03/27/26 16:48	40
1,2-Dibromoethane	ND		40	29	ug/L			03/27/26 16:48	40
Hexachlorobutadiene	ND		80	11	ug/L			03/27/26 16:48	40
Isopropylbenzene	ND		40	32	ug/L			03/27/26 16:48	40
Methyl tert-butyl ether	ND		40	6.4	ug/L			03/27/26 16:48	40
Methylene Chloride	ND		40	18	ug/L			03/27/26 16:48	40
m-Xylene & p-Xylene	ND		80	26	ug/L			03/27/26 16:48	40
Naphthalene	ND		40	17	ug/L			03/27/26 16:48	40
n-Butylbenzene	ND		40	26	ug/L			03/27/26 16:48	40
N-Propylbenzene	ND		40	28	ug/L			03/27/26 16:48	40
o-Xylene	ND		40	30	ug/L			03/27/26 16:48	40
sec-Butylbenzene	ND		40	30	ug/L			03/27/26 16:48	40
Tetrachloroethene	**580**		40	14	ug/L			03/27/26 16:48	40
Toluene	ND		40	20	ug/L			03/27/26 16:48	40
trans-1,2-Dichloroethene	ND		40	36	ug/L			03/27/26 16:48	40
trans-1,3-Dichloropropene	ND		40	15	ug/L			03/27/26 16:48	40
Trichloroethene	**210**		40	18	ug/L			03/27/26 16:48	40

Client Sample ID: OW-14B

Lab Sample ID: 480-237182-25

Date Collected: 03/25/26 09:30

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Trichlorofluoromethane	ND		40	35	ug/L			03/27/26 16:48	40
Vinyl acetate	ND		200	34	ug/L			03/27/26 16:48	40
Vinyl chloride	ND		40	36	ug/L			03/27/26 16:48	40
cis-1,3-Dichloropropene	ND		40	14	ug/L			03/27/26 16:48	40
Styrene	ND		40	29	ug/L			03/27/26 16:48	40
tert-Butylbenzene	ND		40	32	ug/L			03/27/26 16:48	40

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*105*		*77 - 120*		*03/27/26 16:48*	*40*
4-Bromofluorobenzene (Surr)	*87*		*73 - 120*		*03/27/26 16:48*	*40*
Toluene-d8 (Surr)	*104*		*80 - 120*		*03/27/26 16:48*	*40*
Dibromofluoromethane (Surr)	*98*		*75 - 123*		*03/27/26 16:48*	*40*

Client Sample ID: OW-22A

Lab Sample ID: 480-237182-26

Date Collected: 03/25/26 10:00

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			03/27/26 07:15	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			03/27/26 07:15	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			03/27/26 07:15	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			03/27/26 07:15	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			03/27/26 07:15	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			03/27/26 07:15	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			03/27/26 07:15	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			03/27/26 07:15	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			03/27/26 07:15	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			03/27/26 07:15	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			03/27/26 07:15	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			03/27/26 07:15	1
1,2-Dichlorobenzene	ND		1.0	0.79	ug/L			03/27/26 07:15	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			03/27/26 07:15	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			03/27/26 07:15	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			03/27/26 07:15	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			03/27/26 07:15	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			03/27/26 07:15	1
1,4-Dichlorobenzene	ND		1.0	0.84	ug/L			03/27/26 07:15	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			03/27/26 07:15	1
2-Butanone (MEK)	**4.6**	**J**	10	1.3	ug/L			03/27/26 07:15	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			03/27/26 07:15	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			03/27/26 07:15	1
2-Hexanone	ND		5.0	1.2	ug/L			03/27/26 07:15	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			03/27/26 07:15	1
p-Cymene	ND		1.0	0.31	ug/L			03/27/26 07:15	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			03/27/26 07:15	1
Acetone	**4.1**	**J**	10	3.0	ug/L			03/27/26 07:15	1
Benzene	ND		1.0	0.41	ug/L			03/27/26 07:15	1
Bromobenzene	ND		1.0	0.80	ug/L			03/27/26 07:15	1
Bromoform	ND		1.0	0.26	ug/L			03/27/26 07:15	1

Client Sample ID: OW-22A
Lab Sample ID: 480-237182-26

Date Collected: 03/25/26 10:00
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Bromomethane	ND		1.0	0.69	ug/L			03/27/26 07:15	1
Carbon disulfide	ND		1.0	0.19	ug/L			03/27/26 07:15	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			03/27/26 07:15	1
Chlorobenzene	ND		1.0	0.75	ug/L			03/27/26 07:15	1
Bromochloromethane	ND		1.0	0.87	ug/L			03/27/26 07:15	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			03/27/26 07:15	1
Chloroethane	ND		1.0	0.32	ug/L			03/27/26 07:15	1
Chloroform	ND		1.0	0.34	ug/L			03/27/26 07:15	1
Chloromethane	ND		1.0	0.35	ug/L			03/27/26 07:15	1
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			03/27/26 07:15	1
Bromodichloromethane	ND		1.0	0.39	ug/L			03/27/26 07:15	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			03/27/26 07:15	1
Ethylbenzene	ND		1.0	0.74	ug/L			03/27/26 07:15	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			03/27/26 07:15	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			03/27/26 07:15	1
Isopropylbenzene	ND		1.0	0.79	ug/L			03/27/26 07:15	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			03/27/26 07:15	1
Methylene Chloride	ND		1.0	0.44	ug/L			03/27/26 07:15	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			03/27/26 07:15	1
Naphthalene	ND		1.0	0.43	ug/L			03/27/26 07:15	1
n-Butylbenzene	ND		1.0	0.64	ug/L			03/27/26 07:15	1
N-Propylbenzene	ND		1.0	0.69	ug/L			03/27/26 07:15	1
o-Xylene	ND		1.0	0.76	ug/L			03/27/26 07:15	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			03/27/26 07:15	1
Tetrachloroethene	ND		1.0	0.36	ug/L			03/27/26 07:15	1
Toluene	ND		1.0	0.51	ug/L			03/27/26 07:15	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			03/27/26 07:15	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			03/27/26 07:15	1
Trichloroethene	ND		1.0	0.46	ug/L			03/27/26 07:15	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			03/27/26 07:15	1
Vinyl acetate	ND		5.0	0.85	ug/L			03/27/26 07:15	1
Vinyl chloride	ND		1.0	0.90	ug/L			03/27/26 07:15	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			03/27/26 07:15	1
Styrene	ND		1.0	0.73	ug/L			03/27/26 07:15	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			03/27/26 07:15	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*110*		*77 - 120*		*03/27/26 07:15*	*1*
4-Bromofluorobenzene (Surr)	*85*		*73 - 120*		*03/27/26 07:15*	*1*
Toluene-d8 (Surr)	*105*		*80 - 120*		*03/27/26 07:15*	*1*
Dibromofluoromethane (Surr)	*99*		*75 - 123*		*03/27/26 07:15*	*1*

Client Sample ID: OW-22B
Lab Sample ID: 480-237182-27

Date Collected: 03/25/26 10:10
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		200	70	ug/L			03/27/26 17:11	200
1,1,1-Trichloroethane	ND		200	160	ug/L			03/27/26 17:11	200

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-22B
Lab Sample ID: 480-237182-27
Date Collected: 03/25/26 10:10
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	**310**		200	42	ug/L			03/27/26 17:11	200
1,1,2-Trichloroethane	ND		200	46	ug/L			03/27/26 17:11	200
1,1-Dichloroethane	ND		200	76	ug/L			03/27/26 17:11	200
1,1-Dichloroethene	ND		200	58	ug/L			03/27/26 17:11	200
1,1-Dichloropropene	ND		200	140	ug/L			03/27/26 17:11	200
1,2,3-Trichlorobenzene	**99**	**J**	200	82	ug/L			03/27/26 17:11	200
1,2,3-Trichloropropane	ND		200	180	ug/L			03/27/26 17:11	200
1,2,4-Trichlorobenzene	**220**		200	82	ug/L			03/27/26 17:11	200
1,2,4-Trimethylbenzene	ND		200	150	ug/L			03/27/26 17:11	200
1,2-Dibromo-3-Chloropropane	ND		200	78	ug/L			03/27/26 17:11	200
1,2-Dichlorobenzene	ND		200	160	ug/L			03/27/26 17:11	200
1,2-Dichloroethane	ND		200	42	ug/L			03/27/26 17:11	200
1,2-Dichloropropane	ND		200	140	ug/L			03/27/26 17:11	200
1,3,5-Trimethylbenzene	ND		200	150	ug/L			03/27/26 17:11	200
1,3-Dichlorobenzene	ND		200	160	ug/L			03/27/26 17:11	200
1,3-Dichloropropane	ND		200	150	ug/L			03/27/26 17:11	200
1,4-Dichlorobenzene	ND		200	170	ug/L			03/27/26 17:11	200
2,2-Dichloropropane	ND		200	80	ug/L			03/27/26 17:11	200
2-Butanone (MEK)	**790**	**J B**	2000	260	ug/L			03/27/26 17:11	200
2-Chloroethyl vinyl ether	ND		1000	190	ug/L			03/27/26 17:11	200
o-Chlorotoluene	ND		200	170	ug/L			03/27/26 17:11	200
2-Hexanone	ND		1000	250	ug/L			03/27/26 17:11	200
p-Chlorotoluene	ND		200	170	ug/L			03/27/26 17:11	200
p-Cymene	ND		200	62	ug/L			03/27/26 17:11	200
4-Methyl-2-pentanone (MIBK)	ND		1000	420	ug/L			03/27/26 17:11	200
Acetone	ND		2000	600	ug/L			03/27/26 17:11	200
Benzene	ND		200	82	ug/L			03/27/26 17:11	200
Bromobenzene	ND		200	160	ug/L			03/27/26 17:11	200
Bromoform	ND		200	52	ug/L			03/27/26 17:11	200
Bromomethane	ND		200	140	ug/L			03/27/26 17:11	200
Carbon disulfide	ND		200	38	ug/L			03/27/26 17:11	200
Carbon tetrachloride	ND		200	54	ug/L			03/27/26 17:11	200
Chlorobenzene	ND		200	150	ug/L			03/27/26 17:11	200
Bromochloromethane	ND		200	170	ug/L			03/27/26 17:11	200
Chlorodibromomethane	ND		200	64	ug/L			03/27/26 17:11	200
Chloroethane	ND		200	64	ug/L			03/27/26 17:11	200
Chloroform	**100**	**J**	200	68	ug/L			03/27/26 17:11	200
Chloromethane	ND		200	70	ug/L			03/27/26 17:11	200
cis-1,2-Dichloroethene	**1500**		200	160	ug/L			03/27/26 17:11	200
Bromodichloromethane	ND		200	78	ug/L			03/27/26 17:11	200
Dichlorodifluoromethane	ND		200	140	ug/L			03/27/26 17:11	200
Ethylbenzene	ND		200	150	ug/L			03/27/26 17:11	200
1,2-Dibromoethane	ND		200	150	ug/L			03/27/26 17:11	200
Hexachlorobutadiene	ND		400	56	ug/L			03/27/26 17:11	200
Isopropylbenzene	ND		200	160	ug/L			03/27/26 17:11	200
Methyl tert-butyl ether	ND		200	32	ug/L			03/27/26 17:11	200
Methylene Chloride	ND		200	88	ug/L			03/27/26 17:11	200
m-Xylene & p-Xylene	ND		400	130	ug/L			03/27/26 17:11	200
Naphthalene	ND		200	86	ug/L			03/27/26 17:11	200

Client Sample ID: OW-22B
Lab Sample ID: 480-237182-27

Date Collected: 03/25/26 10:10
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
n-Butylbenzene	ND		200	130	ug/L			03/27/26 17:11	200
N-Propylbenzene	ND		200	140	ug/L			03/27/26 17:11	200
o-Xylene	ND		200	150	ug/L			03/27/26 17:11	200
sec-Butylbenzene	ND		200	150	ug/L			03/27/26 17:11	200
Tetrachloroethene	**3300**		200	72	ug/L			03/27/26 17:11	200
Toluene	ND		200	100	ug/L			03/27/26 17:11	200
trans-1,2-Dichloroethene	ND		200	180	ug/L			03/27/26 17:11	200
trans-1,3-Dichloropropene	ND		200	74	ug/L			03/27/26 17:11	200
Trichloroethene	**6800**		200	92	ug/L			03/27/26 17:11	200
Trichlorofluoromethane	ND		200	180	ug/L			03/27/26 17:11	200
Vinyl acetate	ND		1000	170	ug/L			03/27/26 17:11	200
Vinyl chloride	ND		200	180	ug/L			03/27/26 17:11	200
cis-1,3-Dichloropropene	ND		200	72	ug/L			03/27/26 17:11	200
Styrene	ND		200	150	ug/L			03/27/26 17:11	200
tert-Butylbenzene	ND		200	160	ug/L			03/27/26 17:11	200

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*109*		*77 - 120*		*03/27/26 17:11*	*200*
4-Bromofluorobenzene (Surr)	*87*		*73 - 120*		*03/27/26 17:11*	*200*
Toluene-d8 (Surr)	*104*		*80 - 120*		*03/27/26 17:11*	*200*
Dibromofluoromethane (Surr)	*97*		*75 - 123*		*03/27/26 17:11*	*200*

Client Sample ID: OW-15B
Lab Sample ID: 480-237182-28

Date Collected: 03/25/26 09:40
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		50	18	ug/L			03/27/26 17:34	50
1,1,1-Trichloroethane	ND		50	41	ug/L			03/27/26 17:34	50
1,1,2,2-Tetrachloroethane	**25**	**J**	50	11	ug/L			03/27/26 17:34	50
1,1,2-Trichloroethane	ND		50	12	ug/L			03/27/26 17:34	50
1,1-Dichloroethane	ND		50	19	ug/L			03/27/26 17:34	50
1,1-Dichloroethene	ND		50	15	ug/L			03/27/26 17:34	50
1,1-Dichloropropene	ND		50	36	ug/L			03/27/26 17:34	50
1,2,3-Trichlorobenzene	**40**	**J**	50	21	ug/L			03/27/26 17:34	50
1,2,3-Trichloropropane	ND		50	45	ug/L			03/27/26 17:34	50
1,2,4-Trichlorobenzene	**120**		50	21	ug/L			03/27/26 17:34	50
1,2,4-Trimethylbenzene	ND		50	38	ug/L			03/27/26 17:34	50
1,2-Dibromo-3-Chloropropane	ND		50	20	ug/L			03/27/26 17:34	50
1,2-Dichlorobenzene	**160**		50	40	ug/L			03/27/26 17:34	50
1,2-Dichloroethane	ND		50	11	ug/L			03/27/26 17:34	50
1,2-Dichloropropane	ND		50	36	ug/L			03/27/26 17:34	50
1,3,5-Trimethylbenzene	ND		50	39	ug/L			03/27/26 17:34	50
1,3-Dichlorobenzene	**170**		50	39	ug/L			03/27/26 17:34	50
1,3-Dichloropropane	ND		50	38	ug/L			03/27/26 17:34	50
1,4-Dichlorobenzene	**280**		50	42	ug/L			03/27/26 17:34	50
2,2-Dichloropropane	ND		50	20	ug/L			03/27/26 17:34	50
2-Butanone (MEK)	**180**	**J B**	500	66	ug/L			03/27/26 17:34	50
2-Chloroethyl vinyl ether	ND		250	48	ug/L			03/27/26 17:34	50

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-15B
Lab Sample ID: 480-237182-28
Date Collected: 03/25/26 09:40
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
o-Chlorotoluene	ND		50	43	ug/L			03/27/26 17:34	50
2-Hexanone	ND		250	62	ug/L			03/27/26 17:34	50
p-Chlorotoluene	ND		50	42	ug/L			03/27/26 17:34	50
p-Cymene	ND		50	16	ug/L			03/27/26 17:34	50
4-Methyl-2-pentanone (MIBK)	ND		250	110	ug/L			03/27/26 17:34	50
Acetone	ND		500	150	ug/L			03/27/26 17:34	50
Benzene	**51**		50	21	ug/L			03/27/26 17:34	50
Bromobenzene	ND		50	40	ug/L			03/27/26 17:34	50
Bromoform	ND		50	13	ug/L			03/27/26 17:34	50
Bromomethane	ND		50	35	ug/L			03/27/26 17:34	50
Carbon disulfide	ND		50	9.5	ug/L			03/27/26 17:34	50
Carbon tetrachloride	ND		50	14	ug/L			03/27/26 17:34	50
Chlorobenzene	**430**		50	38	ug/L			03/27/26 17:34	50
Bromochloromethane	ND		50	44	ug/L			03/27/26 17:34	50
Chlorodibromomethane	ND		50	16	ug/L			03/27/26 17:34	50
Chloroethane	ND		50	16	ug/L			03/27/26 17:34	50
Chloroform	ND		50	17	ug/L			03/27/26 17:34	50
Chloromethane	ND		50	18	ug/L			03/27/26 17:34	50
cis-1,2-Dichloroethene	**2400**		50	41	ug/L			03/27/26 17:34	50
Bromodichloromethane	ND		50	20	ug/L			03/27/26 17:34	50
Dichlorodifluoromethane	ND		50	34	ug/L			03/27/26 17:34	50
Ethylbenzene	ND		50	37	ug/L			03/27/26 17:34	50
1,2-Dibromoethane	ND		50	37	ug/L			03/27/26 17:34	50
Hexachlorobutadiene	ND		100	14	ug/L			03/27/26 17:34	50
Isopropylbenzene	ND		50	40	ug/L			03/27/26 17:34	50
Methyl tert-butyl ether	ND		50	8.0	ug/L			03/27/26 17:34	50
Methylene Chloride	ND		50	22	ug/L			03/27/26 17:34	50
m-Xylene & p-Xylene	ND		100	33	ug/L			03/27/26 17:34	50
Naphthalene	ND		50	22	ug/L			03/27/26 17:34	50
n-Butylbenzene	ND		50	32	ug/L			03/27/26 17:34	50
N-Propylbenzene	ND		50	35	ug/L			03/27/26 17:34	50
o-Xylene	ND		50	38	ug/L			03/27/26 17:34	50
sec-Butylbenzene	ND		50	38	ug/L			03/27/26 17:34	50
Tetrachloroethene	**1100**		50	18	ug/L			03/27/26 17:34	50
Toluene	ND		50	26	ug/L			03/27/26 17:34	50
trans-1,2-Dichloroethene	ND		50	45	ug/L			03/27/26 17:34	50
trans-1,3-Dichloropropene	ND		50	19	ug/L			03/27/26 17:34	50
Trichloroethene	**930**		50	23	ug/L			03/27/26 17:34	50
Trichlorofluoromethane	ND		50	44	ug/L			03/27/26 17:34	50
Vinyl acetate	ND		250	43	ug/L			03/27/26 17:34	50
Vinyl chloride	**87**		50	45	ug/L			03/27/26 17:34	50
cis-1,3-Dichloropropene	ND		50	18	ug/L			03/27/26 17:34	50
Styrene	ND		50	37	ug/L			03/27/26 17:34	50
tert-Butylbenzene	ND		50	41	ug/L			03/27/26 17:34	50

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*111*		*77 - 120*		*03/27/26 17:34*	*50*
4-Bromofluorobenzene (Surr)	*86*		*73 - 120*		*03/27/26 17:34*	*50*
Toluene-d8 (Surr)	*106*		*80 - 120*		*03/27/26 17:34*	*50*
Dibromofluoromethane (Surr)	*99*		*75 - 123*		*03/27/26 17:34*	*50*

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: TB01
Lab Sample ID: 480-237182-29
Date Collected: 03/24/26 08:00
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			03/27/26 08:01	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			03/27/26 08:01	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			03/27/26 08:01	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			03/27/26 08:01	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			03/27/26 08:01	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			03/27/26 08:01	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			03/27/26 08:01	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			03/27/26 08:01	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			03/27/26 08:01	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			03/27/26 08:01	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			03/27/26 08:01	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			03/27/26 08:01	1
1,2-Dichlorobenzene	ND		1.0	0.79	ug/L			03/27/26 08:01	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			03/27/26 08:01	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			03/27/26 08:01	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			03/27/26 08:01	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			03/27/26 08:01	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			03/27/26 08:01	1
1,4-Dichlorobenzene	ND		1.0	0.84	ug/L			03/27/26 08:01	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			03/27/26 08:01	1
2-Butanone (MEK)	**4.0**	**J**	10	1.3	ug/L			03/27/26 08:01	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			03/27/26 08:01	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			03/27/26 08:01	1
2-Hexanone	ND		5.0	1.2	ug/L			03/27/26 08:01	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			03/27/26 08:01	1
p-Cymene	ND		1.0	0.31	ug/L			03/27/26 08:01	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			03/27/26 08:01	1
Acetone	ND		10	3.0	ug/L			03/27/26 08:01	1
Benzene	ND		1.0	0.41	ug/L			03/27/26 08:01	1
Bromobenzene	ND		1.0	0.80	ug/L			03/27/26 08:01	1
Bromoform	ND		1.0	0.26	ug/L			03/27/26 08:01	1
Bromomethane	ND		1.0	0.69	ug/L			03/27/26 08:01	1
Carbon disulfide	ND		1.0	0.19	ug/L			03/27/26 08:01	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			03/27/26 08:01	1
Chlorobenzene	ND		1.0	0.75	ug/L			03/27/26 08:01	1
Bromochloromethane	ND		1.0	0.87	ug/L			03/27/26 08:01	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			03/27/26 08:01	1
Chloroethane	ND		1.0	0.32	ug/L			03/27/26 08:01	1
Chloroform	ND		1.0	0.34	ug/L			03/27/26 08:01	1
Chloromethane	ND		1.0	0.35	ug/L			03/27/26 08:01	1
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			03/27/26 08:01	1
Bromodichloromethane	ND		1.0	0.39	ug/L			03/27/26 08:01	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			03/27/26 08:01	1
Ethylbenzene	ND		1.0	0.74	ug/L			03/27/26 08:01	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			03/27/26 08:01	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			03/27/26 08:01	1
Isopropylbenzene	ND		1.0	0.79	ug/L			03/27/26 08:01	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			03/27/26 08:01	1
Methylene Chloride	ND		1.0	0.44	ug/L			03/27/26 08:01	1

Client Sample ID: TB01

Lab Sample ID: 480-237182-29

Date Collected: 03/24/26 08:00

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			03/27/26 08:01	1
Naphthalene	ND		1.0	0.43	ug/L			03/27/26 08:01	1
n-Butylbenzene	ND		1.0	0.64	ug/L			03/27/26 08:01	1
N-Propylbenzene	ND		1.0	0.69	ug/L			03/27/26 08:01	1
o-Xylene	ND		1.0	0.76	ug/L			03/27/26 08:01	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			03/27/26 08:01	1
Tetrachloroethene	ND		1.0	0.36	ug/L			03/27/26 08:01	1
Toluene	ND		1.0	0.51	ug/L			03/27/26 08:01	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			03/27/26 08:01	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			03/27/26 08:01	1
Trichloroethene	ND		1.0	0.46	ug/L			03/27/26 08:01	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			03/27/26 08:01	1
Vinyl acetate	ND		5.0	0.85	ug/L			03/27/26 08:01	1
Vinyl chloride	ND		1.0	0.90	ug/L			03/27/26 08:01	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			03/27/26 08:01	1
Styrene	ND		1.0	0.73	ug/L			03/27/26 08:01	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			03/27/26 08:01	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*112*		*77 - 120*		*03/27/26 08:01*	*1*
4-Bromofluorobenzene (Surr)	*86*		*73 - 120*		*03/27/26 08:01*	*1*
Toluene-d8 (Surr)	*105*		*80 - 120*		*03/27/26 08:01*	*1*
Dibromofluoromethane (Surr)	*103*		*75 - 123*		*03/27/26 08:01*	*1*

Client Sample ID: TB02

Lab Sample ID: 480-237182-30

Date Collected: 03/25/26 08:00

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			03/27/26 08:24	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			03/27/26 08:24	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			03/27/26 08:24	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			03/27/26 08:24	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			03/27/26 08:24	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			03/27/26 08:24	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			03/27/26 08:24	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			03/27/26 08:24	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			03/27/26 08:24	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			03/27/26 08:24	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			03/27/26 08:24	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			03/27/26 08:24	1
1,2-Dichlorobenzene	ND		1.0	0.79	ug/L			03/27/26 08:24	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			03/27/26 08:24	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			03/27/26 08:24	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			03/27/26 08:24	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			03/27/26 08:24	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			03/27/26 08:24	1
1,4-Dichlorobenzene	ND		1.0	0.84	ug/L			03/27/26 08:24	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			03/27/26 08:24	1

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: TB02
Lab Sample ID: 480-237182-30
Date Collected: 03/25/26 08:00
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
2-Butanone (MEK)	3.9	J	10	1.3	ug/L			03/27/26 08:24	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			03/27/26 08:24	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			03/27/26 08:24	1
2-Hexanone	ND		5.0	1.2	ug/L			03/27/26 08:24	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			03/27/26 08:24	1
p-Cymene	ND		1.0	0.31	ug/L			03/27/26 08:24	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			03/27/26 08:24	1
Acetone	ND		10	3.0	ug/L			03/27/26 08:24	1
Benzene	ND		1.0	0.41	ug/L			03/27/26 08:24	1
Bromobenzene	ND		1.0	0.80	ug/L			03/27/26 08:24	1
Bromoform	ND		1.0	0.26	ug/L			03/27/26 08:24	1
Bromomethane	ND		1.0	0.69	ug/L			03/27/26 08:24	1
Carbon disulfide	ND		1.0	0.19	ug/L			03/27/26 08:24	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			03/27/26 08:24	1
Chlorobenzene	ND		1.0	0.75	ug/L			03/27/26 08:24	1
Bromochloromethane	ND		1.0	0.87	ug/L			03/27/26 08:24	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			03/27/26 08:24	1
Chloroethane	ND		1.0	0.32	ug/L			03/27/26 08:24	1
Chloroform	ND		1.0	0.34	ug/L			03/27/26 08:24	1
Chloromethane	ND		1.0	0.35	ug/L			03/27/26 08:24	1
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			03/27/26 08:24	1
Bromodichloromethane	ND		1.0	0.39	ug/L			03/27/26 08:24	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			03/27/26 08:24	1
Ethylbenzene	ND		1.0	0.74	ug/L			03/27/26 08:24	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			03/27/26 08:24	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			03/27/26 08:24	1
Isopropylbenzene	ND		1.0	0.79	ug/L			03/27/26 08:24	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			03/27/26 08:24	1
Methylene Chloride	ND		1.0	0.44	ug/L			03/27/26 08:24	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			03/27/26 08:24	1
Naphthalene	ND		1.0	0.43	ug/L			03/27/26 08:24	1
n-Butylbenzene	ND		1.0	0.64	ug/L			03/27/26 08:24	1
N-Propylbenzene	ND		1.0	0.69	ug/L			03/27/26 08:24	1
o-Xylene	ND		1.0	0.76	ug/L			03/27/26 08:24	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			03/27/26 08:24	1
Tetrachloroethene	ND		1.0	0.36	ug/L			03/27/26 08:24	1
Toluene	ND		1.0	0.51	ug/L			03/27/26 08:24	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			03/27/26 08:24	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			03/27/26 08:24	1
Trichloroethene	ND		1.0	0.46	ug/L			03/27/26 08:24	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			03/27/26 08:24	1
Vinyl acetate	ND		5.0	0.85	ug/L			03/27/26 08:24	1
Vinyl chloride	ND		1.0	0.90	ug/L			03/27/26 08:24	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			03/27/26 08:24	1
Styrene	ND		1.0	0.73	ug/L			03/27/26 08:24	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			03/27/26 08:24	1

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*111*		*77 - 120*		*03/27/26 08:24*	*1*
4-Bromofluorobenzene (Surr)	*88*		*73 - 120*		*03/27/26 08:24*	*1*

Client Sample ID: TB02 — **Lab Sample ID: 480-237182-30**
Date Collected: 03/25/26 08:00 — **Matrix: Water**
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
Toluene-d8 (Surr)	106		80 - 120		03/27/26 08:24	1
Dibromofluoromethane (Surr)	104		75 - 123		03/27/26 08:24	1

Client Sample ID: MW-1B — **Lab Sample ID: 480-237182-31**
Date Collected: 03/24/26 14:55 — **Matrix: Water**
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		400	140	ug/L			03/27/26 17:57	400
1,1,1-Trichloroethane	ND		400	330	ug/L			03/27/26 17:57	400
1,1,2,2-Tetrachloroethane	ND		400	84	ug/L			03/27/26 17:57	400
1,1,2-Trichloroethane	ND		400	92	ug/L			03/27/26 17:57	400
1,1-Dichloroethane	ND		400	150	ug/L			03/27/26 17:57	400
1,1-Dichloroethene	ND		400	120	ug/L			03/27/26 17:57	400
1,1-Dichloropropene	ND		400	290	ug/L			03/27/26 17:57	400
1,2,3-Trichlorobenzene	ND		400	160	ug/L			03/27/26 17:57	400
1,2,3-Trichloropropane	ND		400	360	ug/L			03/27/26 17:57	400
1,2,4-Trichlorobenzene	**350**	**J**	400	160	ug/L			03/27/26 17:57	400
1,2,4-Trimethylbenzene	ND		400	300	ug/L			03/27/26 17:57	400
1,2-Dibromo-3-Chloropropane	ND		400	160	ug/L			03/27/26 17:57	400
1,2-Dichlorobenzene	**1700**		400	320	ug/L			03/27/26 17:57	400
1,2-Dichloroethane	ND		400	84	ug/L			03/27/26 17:57	400
1,2-Dichloropropane	ND		400	290	ug/L			03/27/26 17:57	400
1,3,5-Trimethylbenzene	ND		400	310	ug/L			03/27/26 17:57	400
1,3-Dichlorobenzene	**1900**		400	310	ug/L			03/27/26 17:57	400
1,3-Dichloropropane	ND		400	300	ug/L			03/27/26 17:57	400
1,4-Dichlorobenzene	**8900**		400	340	ug/L			03/27/26 17:57	400
2,2-Dichloropropane	ND		400	160	ug/L			03/27/26 17:57	400
2-Butanone (MEK)	**1600**	**J B**	4000	530	ug/L			03/27/26 17:57	400
2-Chloroethyl vinyl ether	ND		2000	380	ug/L			03/27/26 17:57	400
o-Chlorotoluene	ND		400	340	ug/L			03/27/26 17:57	400
2-Hexanone	ND		2000	500	ug/L			03/27/26 17:57	400
p-Chlorotoluene	ND		400	340	ug/L			03/27/26 17:57	400
p-Cymene	ND		400	120	ug/L			03/27/26 17:57	400
4-Methyl-2-pentanone (MIBK)	ND		2000	840	ug/L			03/27/26 17:57	400
Acetone	ND		4000	1200	ug/L			03/27/26 17:57	400
Benzene	ND		400	160	ug/L			03/27/26 17:57	400
Bromobenzene	ND		400	320	ug/L			03/27/26 17:57	400
Bromoform	ND		400	100	ug/L			03/27/26 17:57	400
Bromomethane	ND		400	280	ug/L			03/27/26 17:57	400
Carbon disulfide	ND		400	76	ug/L			03/27/26 17:57	400
Carbon tetrachloride	ND		400	110	ug/L			03/27/26 17:57	400
Chlorobenzene	**21000**		400	300	ug/L			03/27/26 17:57	400
Bromochloromethane	ND		400	350	ug/L			03/27/26 17:57	400
Chlorodibromomethane	ND		400	130	ug/L			03/27/26 17:57	400
Chloroethane	ND		400	130	ug/L			03/27/26 17:57	400
Chloroform	ND		400	140	ug/L			03/27/26 17:57	400
Chloromethane	ND		400	140	ug/L			03/27/26 17:57	400

Client Sample ID: MW-1B

Lab Sample ID: 480-237182-31

Date Collected: 03/24/26 14:55

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
cis-1,2-Dichloroethene	ND		400	320	ug/L			03/27/26 17:57	400
Bromodichloromethane	ND		400	160	ug/L			03/27/26 17:57	400
Dichlorodifluoromethane	ND		400	270	ug/L			03/27/26 17:57	400
Ethylbenzene	ND		400	300	ug/L			03/27/26 17:57	400
1,2-Dibromoethane	ND		400	290	ug/L			03/27/26 17:57	400
Hexachlorobutadiene	ND		800	110	ug/L			03/27/26 17:57	400
Isopropylbenzene	ND		400	320	ug/L			03/27/26 17:57	400
Methyl tert-butyl ether	ND		400	64	ug/L			03/27/26 17:57	400
Methylene Chloride	ND		400	180	ug/L			03/27/26 17:57	400
m-Xylene & p-Xylene	ND		800	260	ug/L			03/27/26 17:57	400
Naphthalene	ND		400	170	ug/L			03/27/26 17:57	400
n-Butylbenzene	ND		400	260	ug/L			03/27/26 17:57	400
N-Propylbenzene	ND		400	280	ug/L			03/27/26 17:57	400
o-Xylene	ND		400	300	ug/L			03/27/26 17:57	400
sec-Butylbenzene	ND		400	300	ug/L			03/27/26 17:57	400
Tetrachloroethene	ND		400	140	ug/L			03/27/26 17:57	400
Toluene	ND		400	200	ug/L			03/27/26 17:57	400
trans-1,2-Dichloroethene	ND		400	360	ug/L			03/27/26 17:57	400
trans-1,3-Dichloropropene	ND		400	150	ug/L			03/27/26 17:57	400
Trichloroethene	ND		400	180	ug/L			03/27/26 17:57	400
Trichlorofluoromethane	ND		400	350	ug/L			03/27/26 17:57	400
Vinyl acetate	ND		2000	340	ug/L			03/27/26 17:57	400
Vinyl chloride	ND		400	360	ug/L			03/27/26 17:57	400
cis-1,3-Dichloropropene	ND		400	140	ug/L			03/27/26 17:57	400
Styrene	ND		400	290	ug/L			03/27/26 17:57	400
tert-Butylbenzene	ND		400	320	ug/L			03/27/26 17:57	400

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*112*		*77 - 120*		*03/27/26 17:57*	*400*
4-Bromofluorobenzene (Surr)	*87*		*73 - 120*		*03/27/26 17:57*	*400*
Toluene-d8 (Surr)	*102*		*80 - 120*		*03/27/26 17:57*	*400*
Dibromofluoromethane (Surr)	*102*		*75 - 123*		*03/27/26 17:57*	*400*

Client Sample ID: MW-1C

Lab Sample ID: 480-237182-32

Date Collected: 03/24/26 15:00

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		50	18	ug/L			03/27/26 18:20	50
1,1,1-Trichloroethane	ND		50	41	ug/L			03/27/26 18:20	50
1,1,2,2-Tetrachloroethane	ND		50	11	ug/L			03/27/26 18:20	50
1,1,2-Trichloroethane	ND		50	12	ug/L			03/27/26 18:20	50
1,1-Dichloroethane	ND		50	19	ug/L			03/27/26 18:20	50
1,1-Dichloroethene	ND		50	15	ug/L			03/27/26 18:20	50
1,1-Dichloropropene	ND		50	36	ug/L			03/27/26 18:20	50
1,2,3-Trichlorobenzene	ND		50	21	ug/L			03/27/26 18:20	50
1,2,3-Trichloropropane	ND		50	45	ug/L			03/27/26 18:20	50
1,2,4-Trichlorobenzene	ND		50	21	ug/L			03/27/26 18:20	50
1,2,4-Trimethylbenzene	ND		50	38	ug/L			03/27/26 18:20	50

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: MW-1C
Lab Sample ID: 480-237182-32
Date Collected: 03/24/26 15:00
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,2-Dibromo-3-Chloropropane	ND		50	20	ug/L			03/27/26 18:20	50
1,2-Dichlorobenzene	ND		50	40	ug/L			03/27/26 18:20	50
1,2-Dichloroethane	ND		50	11	ug/L			03/27/26 18:20	50
1,2-Dichloropropane	ND		50	36	ug/L			03/27/26 18:20	50
1,3,5-Trimethylbenzene	ND		50	39	ug/L			03/27/26 18:20	50
1,3-Dichlorobenzene	ND		50	39	ug/L			03/27/26 18:20	50
1,3-Dichloropropane	ND		50	38	ug/L			03/27/26 18:20	50
1,4-Dichlorobenzene	ND		50	42	ug/L			03/27/26 18:20	50
2,2-Dichloropropane	ND		50	20	ug/L			03/27/26 18:20	50
2-Butanone (MEK)	**200**	**J B**	500	66	ug/L			03/27/26 18:20	50
2-Chloroethyl vinyl ether	ND		250	48	ug/L			03/27/26 18:20	50
o-Chlorotoluene	ND		50	43	ug/L			03/27/26 18:20	50
2-Hexanone	ND		250	62	ug/L			03/27/26 18:20	50
p-Chlorotoluene	ND		50	42	ug/L			03/27/26 18:20	50
p-Cymene	ND		50	16	ug/L			03/27/26 18:20	50
4-Methyl-2-pentanone (MIBK)	ND		250	110	ug/L			03/27/26 18:20	50
Acetone	ND		500	150	ug/L			03/27/26 18:20	50
Benzene	ND		50	21	ug/L			03/27/26 18:20	50
Bromobenzene	ND		50	40	ug/L			03/27/26 18:20	50
Bromoform	ND		50	13	ug/L			03/27/26 18:20	50
Bromomethane	ND		50	35	ug/L			03/27/26 18:20	50
Carbon disulfide	ND		50	9.5	ug/L			03/27/26 18:20	50
Carbon tetrachloride	ND		50	14	ug/L			03/27/26 18:20	50
Chlorobenzene	ND		50	38	ug/L			03/27/26 18:20	50
Bromochloromethane	ND		50	44	ug/L			03/27/26 18:20	50
Chlorodibromomethane	ND		50	16	ug/L			03/27/26 18:20	50
Chloroethane	ND		50	16	ug/L			03/27/26 18:20	50
Chloroform	ND		50	17	ug/L			03/27/26 18:20	50
Chloromethane	ND		50	18	ug/L			03/27/26 18:20	50
cis-1,2-Dichloroethene	**1000**		50	41	ug/L			03/27/26 18:20	50
Bromodichloromethane	ND		50	20	ug/L			03/27/26 18:20	50
Dichlorodifluoromethane	ND		50	34	ug/L			03/27/26 18:20	50
Ethylbenzene	ND		50	37	ug/L			03/27/26 18:20	50
1,2-Dibromoethane	ND		50	37	ug/L			03/27/26 18:20	50
Hexachlorobutadiene	ND		100	14	ug/L			03/27/26 18:20	50
Isopropylbenzene	ND		50	40	ug/L			03/27/26 18:20	50
Methyl tert-butyl ether	ND		50	8.0	ug/L			03/27/26 18:20	50
Methylene Chloride	ND		50	22	ug/L			03/27/26 18:20	50
m-Xylene & p-Xylene	ND		100	33	ug/L			03/27/26 18:20	50
Naphthalene	ND		50	22	ug/L			03/27/26 18:20	50
n-Butylbenzene	ND		50	32	ug/L			03/27/26 18:20	50
N-Propylbenzene	ND		50	35	ug/L			03/27/26 18:20	50
o-Xylene	ND		50	38	ug/L			03/27/26 18:20	50
sec-Butylbenzene	ND		50	38	ug/L			03/27/26 18:20	50
Tetrachloroethene	ND		50	18	ug/L			03/27/26 18:20	50
Toluene	ND		50	26	ug/L			03/27/26 18:20	50
trans-1,2-Dichloroethene	**76**		50	45	ug/L			03/27/26 18:20	50
trans-1,3-Dichloropropene	ND		50	19	ug/L			03/27/26 18:20	50
Trichloroethene	ND		50	23	ug/L			03/27/26 18:20	50

Client Sample ID: MW-1C

Lab Sample ID: 480-237182-32

Date Collected: 03/24/26 15:00

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Trichlorofluoromethane	ND		50	44	ug/L			03/27/26 18:20	50
Vinyl acetate	ND		250	43	ug/L			03/27/26 18:20	50
Vinyl chloride	ND		50	45	ug/L			03/27/26 18:20	50
cis-1,3-Dichloropropene	ND		50	18	ug/L			03/27/26 18:20	50
Styrene	ND		50	37	ug/L			03/27/26 18:20	50
tert-Butylbenzene	ND		50	41	ug/L			03/27/26 18:20	50

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*113*		*77 - 120*		*03/27/26 18:20*	*50*
4-Bromofluorobenzene (Surr)	*88*		*73 - 120*		*03/27/26 18:20*	*50*
Toluene-d8 (Surr)	*102*		*80 - 120*		*03/27/26 18:20*	*50*
Dibromofluoromethane (Surr)	*103*		*75 - 123*		*03/27/26 18:20*	*50*

Client Sample ID: MW-1CD

Lab Sample ID: 480-237182-33

Date Collected: 03/24/26 15:05

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		800	280	ug/L			03/27/26 18:44	800
1,1,1-Trichloroethane	ND		800	660	ug/L			03/27/26 18:44	800
1,1,2,2-Tetrachloroethane	ND		800	170	ug/L			03/27/26 18:44	800
1,1,2-Trichloroethane	ND		800	180	ug/L			03/27/26 18:44	800
1,1-Dichloroethane	ND		800	300	ug/L			03/27/26 18:44	800
1,1-Dichloroethene	ND		800	230	ug/L			03/27/26 18:44	800
1,1-Dichloropropene	ND		800	580	ug/L			03/27/26 18:44	800
1,2,3-Trichlorobenzene	ND		800	330	ug/L			03/27/26 18:44	800
1,2,3-Trichloropropane	ND		800	710	ug/L			03/27/26 18:44	800
1,2,4-Trichlorobenzene	ND		800	330	ug/L			03/27/26 18:44	800
1,2,4-Trimethylbenzene	ND		800	600	ug/L			03/27/26 18:44	800
1,2-Dibromo-3-Chloropropane	ND		800	310	ug/L			03/27/26 18:44	800
1,2-Dichlorobenzene	**3000**		800	630	ug/L			03/27/26 18:44	800
1,2-Dichloroethane	ND		800	170	ug/L			03/27/26 18:44	800
1,2-Dichloropropane	ND		800	580	ug/L			03/27/26 18:44	800
1,3,5-Trimethylbenzene	ND		800	620	ug/L			03/27/26 18:44	800
1,3-Dichlorobenzene	ND		800	620	ug/L			03/27/26 18:44	800
1,3-Dichloropropane	ND		800	600	ug/L			03/27/26 18:44	800
1,4-Dichlorobenzene	**2100**		800	670	ug/L			03/27/26 18:44	800
2,2-Dichloropropane	ND		800	320	ug/L			03/27/26 18:44	800
2-Butanone (MEK)	**2900**	**J B**	8000	1100	ug/L			03/27/26 18:44	800
2-Chloroethyl vinyl ether	ND		4000	770	ug/L			03/27/26 18:44	800
o-Chlorotoluene	ND		800	690	ug/L			03/27/26 18:44	800
2-Hexanone	ND		4000	990	ug/L			03/27/26 18:44	800
p-Chlorotoluene	ND		800	670	ug/L			03/27/26 18:44	800
p-Cymene	ND		800	250	ug/L			03/27/26 18:44	800
4-Methyl-2-pentanone (MIBK)	ND		4000	1700	ug/L			03/27/26 18:44	800
Acetone	ND		8000	2400	ug/L			03/27/26 18:44	800
Benzene	**2200**		800	330	ug/L			03/27/26 18:44	800
Bromobenzene	ND		800	640	ug/L			03/27/26 18:44	800
Bromoform	ND		800	210	ug/L			03/27/26 18:44	800

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: MW-1CD
Lab Sample ID: 480-237182-33
Date Collected: 03/24/26 15:05
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Bromomethane	ND		800	550	ug/L			03/27/26 18:44	800
Carbon disulfide	ND		800	150	ug/L			03/27/26 18:44	800
Carbon tetrachloride	ND		800	220	ug/L			03/27/26 18:44	800
Chlorobenzene	**18000**		800	600	ug/L			03/27/26 18:44	800
Bromochloromethane	ND		800	700	ug/L			03/27/26 18:44	800
Chlorodibromomethane	ND		800	260	ug/L			03/27/26 18:44	800
Chloroethane	ND		800	260	ug/L			03/27/26 18:44	800
Chloroform	ND		800	270	ug/L			03/27/26 18:44	800
Chloromethane	ND		800	280	ug/L			03/27/26 18:44	800
cis-1,2-Dichloroethene	**2600**		800	650	ug/L			03/27/26 18:44	800
Bromodichloromethane	ND		800	310	ug/L			03/27/26 18:44	800
Dichlorodifluoromethane	ND		800	540	ug/L			03/27/26 18:44	800
Ethylbenzene	ND		800	590	ug/L			03/27/26 18:44	800
1,2-Dibromoethane	ND		800	580	ug/L			03/27/26 18:44	800
Hexachlorobutadiene	ND		1600	220	ug/L			03/27/26 18:44	800
Isopropylbenzene	ND		800	630	ug/L			03/27/26 18:44	800
Methyl tert-butyl ether	ND		800	130	ug/L			03/27/26 18:44	800
Methylene Chloride	ND		800	350	ug/L			03/27/26 18:44	800
m-Xylene & p-Xylene	ND		1600	530	ug/L			03/27/26 18:44	800
Naphthalene	ND		800	340	ug/L			03/27/26 18:44	800
n-Butylbenzene	ND		800	510	ug/L			03/27/26 18:44	800
N-Propylbenzene	ND		800	550	ug/L			03/27/26 18:44	800
o-Xylene	ND		800	610	ug/L			03/27/26 18:44	800
sec-Butylbenzene	ND		800	600	ug/L			03/27/26 18:44	800
Tetrachloroethene	ND		800	290	ug/L			03/27/26 18:44	800
Toluene	ND		800	410	ug/L			03/27/26 18:44	800
trans-1,2-Dichloroethene	ND		800	720	ug/L			03/27/26 18:44	800
trans-1,3-Dichloropropene	ND		800	300	ug/L			03/27/26 18:44	800
Trichloroethene	ND		800	370	ug/L			03/27/26 18:44	800
Trichlorofluoromethane	ND		800	700	ug/L			03/27/26 18:44	800
Vinyl acetate	ND		4000	680	ug/L			03/27/26 18:44	800
Vinyl chloride	**1200**		800	720	ug/L			03/27/26 18:44	800
cis-1,3-Dichloropropene	ND		800	290	ug/L			03/27/26 18:44	800
Styrene	ND		800	580	ug/L			03/27/26 18:44	800
tert-Butylbenzene	ND		800	650	ug/L			03/27/26 18:44	800

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*112*		*77 - 120*		*03/27/26 18:44*	*800*
4-Bromofluorobenzene (Surr)	*87*		*73 - 120*		*03/27/26 18:44*	*800*
Toluene-d8 (Surr)	*104*		*80 - 120*		*03/27/26 18:44*	*800*
Dibromofluoromethane (Surr)	*97*		*75 - 123*		*03/27/26 18:44*	*800*

Client Sample ID: MW-1F
Lab Sample ID: 480-237182-34
Date Collected: 03/25/26 11:35
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		2.0	0.70	ug/L			03/30/26 14:07	2
1,1,1-Trichloroethane	ND		2.0	1.6	ug/L			03/30/26 14:07	2

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: MW-1F
Lab Sample ID: 480-237182-34
Date Collected: 03/25/26 11:35
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		2.0	0.42	ug/L			03/30/26 14:07	2
1,1,2-Trichloroethane	**0.65**	**J**	2.0	0.46	ug/L			03/30/26 14:07	2
1,1-Dichloroethane	ND		2.0	0.76	ug/L			03/30/26 14:07	2
1,1-Dichloroethene	ND		2.0	0.58	ug/L			03/30/26 14:07	2
1,1-Dichloropropene	ND		2.0	1.4	ug/L			03/30/26 14:07	2
1,2,3-Trichlorobenzene	ND		2.0	0.82	ug/L			03/30/26 14:07	2
1,2,3-Trichloropropane	ND		2.0	1.8	ug/L			03/30/26 14:07	2
1,2,4-Trichlorobenzene	ND		2.0	0.82	ug/L			03/30/26 14:07	2
1,2,4-Trimethylbenzene	ND		2.0	1.5	ug/L			03/30/26 14:07	2
1,2-Dibromo-3-Chloropropane	ND		2.0	0.78	ug/L			03/30/26 14:07	2
1,2-Dichlorobenzene	ND		2.0	1.6	ug/L			03/30/26 14:07	2
1,2-Dichloroethane	ND		2.0	0.42	ug/L			03/30/26 14:07	2
1,2-Dichloropropane	ND		2.0	1.4	ug/L			03/30/26 14:07	2
1,3,5-Trimethylbenzene	ND		2.0	1.5	ug/L			03/30/26 14:07	2
1,3-Dichlorobenzene	ND		2.0	1.6	ug/L			03/30/26 14:07	2
1,3-Dichloropropane	ND		2.0	1.5	ug/L			03/30/26 14:07	2
1,4-Dichlorobenzene	ND		2.0	1.7	ug/L			03/30/26 14:07	2
2,2-Dichloropropane	ND		2.0	0.80	ug/L			03/30/26 14:07	2
2-Butanone (MEK)	**9.2**	**J B**	20	2.6	ug/L			03/30/26 14:07	2
2-Chloroethyl vinyl ether	ND		10	1.9	ug/L			03/30/26 14:07	2
o-Chlorotoluene	ND		2.0	1.7	ug/L			03/30/26 14:07	2
2-Hexanone	ND		10	2.5	ug/L			03/30/26 14:07	2
p-Chlorotoluene	ND		2.0	1.7	ug/L			03/30/26 14:07	2
p-Cymene	ND		2.0	0.62	ug/L			03/30/26 14:07	2
4-Methyl-2-pentanone (MIBK)	ND		10	4.2	ug/L			03/30/26 14:07	2
Acetone	**21**		20	6.0	ug/L			03/30/26 14:07	2
Benzene	**2.1**		2.0	0.82	ug/L			03/30/26 14:07	2
Bromobenzene	ND		2.0	1.6	ug/L			03/30/26 14:07	2
Bromoform	ND		2.0	0.52	ug/L			03/30/26 14:07	2
Bromomethane	ND		2.0	1.4	ug/L			03/30/26 14:07	2
Carbon disulfide	ND		2.0	0.38	ug/L			03/30/26 14:07	2
Carbon tetrachloride	ND		2.0	0.54	ug/L			03/30/26 14:07	2
Chlorobenzene	ND		2.0	1.5	ug/L			03/30/26 14:07	2
Bromochloromethane	ND		2.0	1.7	ug/L			03/30/26 14:07	2
Chlorodibromomethane	ND		2.0	0.64	ug/L			03/30/26 14:07	2
Chloroethane	ND		2.0	0.64	ug/L			03/30/26 14:07	2
Chloroform	ND		2.0	0.68	ug/L			03/30/26 14:07	2
Chloromethane	ND		2.0	0.70	ug/L			03/30/26 14:07	2
cis-1,2-Dichloroethene	**8.2**		2.0	1.6	ug/L			03/30/26 14:07	2
Bromodichloromethane	ND		2.0	0.78	ug/L			03/30/26 14:07	2
Dichlorodifluoromethane	ND		2.0	1.4	ug/L			03/30/26 14:07	2
Ethylbenzene	ND		2.0	1.5	ug/L			03/30/26 14:07	2
1,2-Dibromoethane	ND		2.0	1.5	ug/L			03/30/26 14:07	2
Hexachlorobutadiene	ND		4.0	0.56	ug/L			03/30/26 14:07	2
Isopropylbenzene	ND		2.0	1.6	ug/L			03/30/26 14:07	2
Methyl tert-butyl ether	ND		2.0	0.32	ug/L			03/30/26 14:07	2
Methylene Chloride	ND		2.0	0.88	ug/L			03/30/26 14:07	2
m-Xylene & p-Xylene	ND		4.0	1.3	ug/L			03/30/26 14:07	2
Naphthalene	ND		2.0	0.86	ug/L			03/30/26 14:07	2

Client Sample ID: MW-1F
Lab Sample ID: 480-237182-34

Date Collected: 03/25/26 11:35
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
n-Butylbenzene	ND		2.0	1.3	ug/L			03/30/26 14:07	2
N-Propylbenzene	ND		2.0	1.4	ug/L			03/30/26 14:07	2
o-Xylene	ND		2.0	1.5	ug/L			03/30/26 14:07	2
sec-Butylbenzene	ND		2.0	1.5	ug/L			03/30/26 14:07	2
Tetrachloroethene	ND		2.0	0.72	ug/L			03/30/26 14:07	2
Toluene	ND		2.0	1.0	ug/L			03/30/26 14:07	2
trans-1,2-Dichloroethene	**23**		2.0	1.8	ug/L			03/30/26 14:07	2
trans-1,3-Dichloropropene	ND		2.0	0.74	ug/L			03/30/26 14:07	2
Trichloroethene	**2.6**		2.0	0.92	ug/L			03/30/26 14:07	2
Trichlorofluoromethane	ND		2.0	1.8	ug/L			03/30/26 14:07	2
Vinyl acetate	ND		10	1.7	ug/L			03/30/26 14:07	2
Vinyl chloride	**85**		2.0	1.8	ug/L			03/30/26 14:07	2
cis-1,3-Dichloropropene	ND		2.0	0.72	ug/L			03/30/26 14:07	2
Styrene	ND		2.0	1.5	ug/L			03/30/26 14:07	2
tert-Butylbenzene	ND		2.0	1.6	ug/L			03/30/26 14:07	2

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*109*		*77 - 120*		*03/30/26 14:07*	*2*
4-Bromofluorobenzene (Surr)	*89*		*73 - 120*		*03/30/26 14:07*	*2*
Toluene-d8 (Surr)	*105*		*80 - 120*		*03/30/26 14:07*	*2*
Dibromofluoromethane (Surr)	*99*		*75 - 123*		*03/30/26 14:07*	*2*

Client Sample ID: OW-12A
Lab Sample ID: 480-237182-35

Date Collected: 03/24/26 15:20
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		100	35	ug/L			03/27/26 19:30	100
1,1,1-Trichloroethane	ND		100	82	ug/L			03/27/26 19:30	100
1,1,2,2-Tetrachloroethane	ND		100	21	ug/L			03/27/26 19:30	100
1,1,2-Trichloroethane	ND		100	23	ug/L			03/27/26 19:30	100
1,1-Dichloroethane	ND		100	38	ug/L			03/27/26 19:30	100
1,1-Dichloroethene	ND		100	29	ug/L			03/27/26 19:30	100
1,1-Dichloropropene	ND		100	72	ug/L			03/27/26 19:30	100
1,2,3-Trichlorobenzene	**54**	**J**	100	41	ug/L			03/27/26 19:30	100
1,2,3-Trichloropropane	ND		100	89	ug/L			03/27/26 19:30	100
1,2,4-Trichlorobenzene	**210**		100	41	ug/L			03/27/26 19:30	100
1,2,4-Trimethylbenzene	ND		100	75	ug/L			03/27/26 19:30	100
1,2-Dibromo-3-Chloropropane	ND		100	39	ug/L			03/27/26 19:30	100
1,2-Dichlorobenzene	**2400**		100	79	ug/L			03/27/26 19:30	100
1,2-Dichloroethane	ND		100	21	ug/L			03/27/26 19:30	100
1,2-Dichloropropane	ND		100	72	ug/L			03/27/26 19:30	100
1,3,5-Trimethylbenzene	ND		100	77	ug/L			03/27/26 19:30	100
1,3-Dichlorobenzene	**510**		100	78	ug/L			03/27/26 19:30	100
1,3-Dichloropropane	ND		100	75	ug/L			03/27/26 19:30	100
1,4-Dichlorobenzene	**2200**		100	84	ug/L			03/27/26 19:30	100
2,2-Dichloropropane	ND		100	40	ug/L			03/27/26 19:30	100
2-Butanone (MEK)	**390**	**J B**	1000	130	ug/L			03/27/26 19:30	100
2-Chloroethyl vinyl ether	ND		500	96	ug/L			03/27/26 19:30	100

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-12A
Lab Sample ID: 480-237182-35
Date Collected: 03/24/26 15:20
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
o-Chlorotoluene	ND		100	86	ug/L			03/27/26 19:30	100
2-Hexanone	ND		500	120	ug/L			03/27/26 19:30	100
p-Chlorotoluene	ND		100	84	ug/L			03/27/26 19:30	100
p-Cymene	ND		100	31	ug/L			03/27/26 19:30	100
4-Methyl-2-pentanone (MIBK)	ND		500	210	ug/L			03/27/26 19:30	100
Acetone	ND		1000	300	ug/L			03/27/26 19:30	100
Benzene	**240**		100	41	ug/L			03/27/26 19:30	100
Bromobenzene	ND		100	80	ug/L			03/27/26 19:30	100
Bromoform	ND		100	26	ug/L			03/27/26 19:30	100
Bromomethane	ND		100	69	ug/L			03/27/26 19:30	100
Carbon disulfide	ND		100	19	ug/L			03/27/26 19:30	100
Carbon tetrachloride	ND		100	27	ug/L			03/27/26 19:30	100
Chlorobenzene	**3700**		100	75	ug/L			03/27/26 19:30	100
Bromochloromethane	ND		100	87	ug/L			03/27/26 19:30	100
Chlorodibromomethane	ND		100	32	ug/L			03/27/26 19:30	100
Chloroethane	ND		100	32	ug/L			03/27/26 19:30	100
Chloroform	ND		100	34	ug/L			03/27/26 19:30	100
Chloromethane	ND		100	35	ug/L			03/27/26 19:30	100
cis-1,2-Dichloroethene	ND		100	81	ug/L			03/27/26 19:30	100
Bromodichloromethane	ND		100	39	ug/L			03/27/26 19:30	100
Dichlorodifluoromethane	ND		100	68	ug/L			03/27/26 19:30	100
Ethylbenzene	ND		100	74	ug/L			03/27/26 19:30	100
1,2-Dibromoethane	ND		100	73	ug/L			03/27/26 19:30	100
Hexachlorobutadiene	ND		200	28	ug/L			03/27/26 19:30	100
Isopropylbenzene	ND		100	79	ug/L			03/27/26 19:30	100
Methyl tert-butyl ether	ND		100	16	ug/L			03/27/26 19:30	100
Methylene Chloride	ND		100	44	ug/L			03/27/26 19:30	100
m-Xylene & p-Xylene	ND		200	66	ug/L			03/27/26 19:30	100
Naphthalene	ND		100	43	ug/L			03/27/26 19:30	100
n-Butylbenzene	ND		100	64	ug/L			03/27/26 19:30	100
N-Propylbenzene	ND		100	69	ug/L			03/27/26 19:30	100
o-Xylene	ND		100	76	ug/L			03/27/26 19:30	100
sec-Butylbenzene	ND		100	75	ug/L			03/27/26 19:30	100
Tetrachloroethene	ND		100	36	ug/L			03/27/26 19:30	100
Toluene	ND		100	51	ug/L			03/27/26 19:30	100
trans-1,2-Dichloroethene	ND		100	90	ug/L			03/27/26 19:30	100
trans-1,3-Dichloropropene	ND		100	37	ug/L			03/27/26 19:30	100
Trichloroethene	ND		100	46	ug/L			03/27/26 19:30	100
Trichlorofluoromethane	ND		100	88	ug/L			03/27/26 19:30	100
Vinyl acetate	ND		500	85	ug/L			03/27/26 19:30	100
Vinyl chloride	ND		100	90	ug/L			03/27/26 19:30	100
cis-1,3-Dichloropropene	ND		100	36	ug/L			03/27/26 19:30	100
Styrene	ND		100	73	ug/L			03/27/26 19:30	100
tert-Butylbenzene	ND		100	81	ug/L			03/27/26 19:30	100

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*106*		*77 - 120*		*03/27/26 19:30*	*100*
4-Bromofluorobenzene (Surr)	*86*		*73 - 120*		*03/27/26 19:30*	*100*
Toluene-d8 (Surr)	*102*		*80 - 120*		*03/27/26 19:30*	*100*
Dibromofluoromethane (Surr)	*100*		*75 - 123*		*03/27/26 19:30*	*100*

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-10B
Lab Sample ID: 480-237182-36
Date Collected: 03/24/26 15:30
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		8.0	2.8	ug/L			03/30/26 14:30	8
1,1,1-Trichloroethane	ND		8.0	6.6	ug/L			03/30/26 14:30	8
1,1,2,2-Tetrachloroethane	ND		8.0	1.7	ug/L			03/30/26 14:30	8
1,1,2-Trichloroethane	ND		8.0	1.8	ug/L			03/30/26 14:30	8
1,1-Dichloroethane	ND		8.0	3.0	ug/L			03/30/26 14:30	8
1,1-Dichloroethene	ND		8.0	2.3	ug/L			03/30/26 14:30	8
1,1-Dichloropropene	ND		8.0	5.8	ug/L			03/30/26 14:30	8
1,2,3-Trichlorobenzene	**100**		8.0	3.3	ug/L			03/30/26 14:30	8
1,2,3-Trichloropropane	ND		8.0	7.1	ug/L			03/30/26 14:30	8
1,2,4-Trichlorobenzene	**240**		8.0	3.3	ug/L			03/30/26 14:30	8
1,2,4-Trimethylbenzene	ND		8.0	6.0	ug/L			03/30/26 14:30	8
1,2-Dibromo-3-Chloropropane	ND		8.0	3.1	ug/L			03/30/26 14:30	8
1,2-Dichlorobenzene	**180**		8.0	6.3	ug/L			03/30/26 14:30	8
1,2-Dichloroethane	ND		8.0	1.7	ug/L			03/30/26 14:30	8
1,2-Dichloropropane	ND		8.0	5.8	ug/L			03/30/26 14:30	8
1,3,5-Trimethylbenzene	ND		8.0	6.2	ug/L			03/30/26 14:30	8
1,3-Dichlorobenzene	**310**		8.0	6.2	ug/L			03/30/26 14:30	8
1,3-Dichloropropane	ND		8.0	6.0	ug/L			03/30/26 14:30	8
1,4-Dichlorobenzene	**140**		8.0	6.7	ug/L			03/30/26 14:30	8
2,2-Dichloropropane	ND		8.0	3.2	ug/L			03/30/26 14:30	8
2-Butanone (MEK)	**32**	**J B**	80	11	ug/L			03/30/26 14:30	8
2-Chloroethyl vinyl ether	ND		40	7.7	ug/L			03/30/26 14:30	8
o-Chlorotoluene	ND		8.0	6.9	ug/L			03/30/26 14:30	8
2-Hexanone	ND		40	9.9	ug/L			03/30/26 14:30	8
p-Chlorotoluene	ND		8.0	6.7	ug/L			03/30/26 14:30	8
p-Cymene	ND		8.0	2.5	ug/L			03/30/26 14:30	8
4-Methyl-2-pentanone (MIBK)	ND		40	17	ug/L			03/30/26 14:30	8
Acetone	**44**	**J**	80	24	ug/L			03/30/26 14:30	8
Benzene	**17**		8.0	3.3	ug/L			03/30/26 14:30	8
Bromobenzene	ND		8.0	6.4	ug/L			03/30/26 14:30	8
Bromoform	ND		8.0	2.1	ug/L			03/30/26 14:30	8
Bromomethane	ND		8.0	5.5	ug/L			03/30/26 14:30	8
Carbon disulfide	ND		8.0	1.5	ug/L			03/30/26 14:30	8
Carbon tetrachloride	ND		8.0	2.2	ug/L			03/30/26 14:30	8
Chlorobenzene	**150**		8.0	6.0	ug/L			03/30/26 14:30	8
Bromochloromethane	ND		8.0	7.0	ug/L			03/30/26 14:30	8
Chlorodibromomethane	ND		8.0	2.6	ug/L			03/30/26 14:30	8
Chloroethane	ND		8.0	2.6	ug/L			03/30/26 14:30	8
Chloroform	ND		8.0	2.7	ug/L			03/30/26 14:30	8
Chloromethane	ND		8.0	2.8	ug/L			03/30/26 14:30	8
cis-1,2-Dichloroethene	ND		8.0	6.5	ug/L			03/30/26 14:30	8
Bromodichloromethane	ND		8.0	3.1	ug/L			03/30/26 14:30	8
Dichlorodifluoromethane	ND		8.0	5.4	ug/L			03/30/26 14:30	8
Ethylbenzene	ND		8.0	5.9	ug/L			03/30/26 14:30	8
1,2-Dibromoethane	ND		8.0	5.8	ug/L			03/30/26 14:30	8
Hexachlorobutadiene	ND		16	2.2	ug/L			03/30/26 14:30	8
Isopropylbenzene	ND		8.0	6.3	ug/L			03/30/26 14:30	8
Methyl tert-butyl ether	ND		8.0	1.3	ug/L			03/30/26 14:30	8
Methylene Chloride	ND		8.0	3.5	ug/L			03/30/26 14:30	8

Client Sample ID: OW-10B

Lab Sample ID: 480-237182-36

Date Collected: 03/24/26 15:30

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
m-Xylene & p-Xylene	ND		16	5.3	ug/L			03/30/26 14:30	8
Naphthalene	ND		8.0	3.4	ug/L			03/30/26 14:30	8
n-Butylbenzene	ND		8.0	5.1	ug/L			03/30/26 14:30	8
N-Propylbenzene	ND		8.0	5.5	ug/L			03/30/26 14:30	8
o-Xylene	ND		8.0	6.1	ug/L			03/30/26 14:30	8
sec-Butylbenzene	ND		8.0	6.0	ug/L			03/30/26 14:30	8
Tetrachloroethene	ND		8.0	2.9	ug/L			03/30/26 14:30	8
Toluene	ND		8.0	4.1	ug/L			03/30/26 14:30	8
trans-1,2-Dichloroethene	ND		8.0	7.2	ug/L			03/30/26 14:30	8
trans-1,3-Dichloropropene	ND		8.0	3.0	ug/L			03/30/26 14:30	8
Trichloroethene	ND		8.0	3.7	ug/L			03/30/26 14:30	8
Trichlorofluoromethane	ND		8.0	7.0	ug/L			03/30/26 14:30	8
Vinyl acetate	ND		40	6.8	ug/L			03/30/26 14:30	8
Vinyl chloride	ND		8.0	7.2	ug/L			03/30/26 14:30	8
cis-1,3-Dichloropropene	ND		8.0	2.9	ug/L			03/30/26 14:30	8
Styrene	ND		8.0	5.8	ug/L			03/30/26 14:30	8
tert-Butylbenzene	ND		8.0	6.5	ug/L			03/30/26 14:30	8

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*109*		*77 - 120*		*03/30/26 14:30*	*8*
4-Bromofluorobenzene (Surr)	*87*		*73 - 120*		*03/30/26 14:30*	*8*
Toluene-d8 (Surr)	*102*		*80 - 120*		*03/30/26 14:30*	*8*
Dibromofluoromethane (Surr)	*101*		*75 - 123*		*03/30/26 14:30*	*8*

Client Sample ID: MW-2A

Lab Sample ID: 480-237182-37

Date Collected: 03/24/26 15:44

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		200	70	ug/L			03/27/26 20:17	200
1,1,1-Trichloroethane	ND		200	160	ug/L			03/27/26 20:17	200
1,1,2,2-Tetrachloroethane	ND		200	42	ug/L			03/27/26 20:17	200
1,1,2-Trichloroethane	ND		200	46	ug/L			03/27/26 20:17	200
1,1-Dichloroethane	ND		200	76	ug/L			03/27/26 20:17	200
1,1-Dichloroethene	ND		200	58	ug/L			03/27/26 20:17	200
1,1-Dichloropropene	ND		200	140	ug/L			03/27/26 20:17	200
1,2,3-Trichlorobenzene	ND		200	82	ug/L			03/27/26 20:17	200
1,2,3-Trichloropropane	ND		200	180	ug/L			03/27/26 20:17	200
1,2,4-Trichlorobenzene	ND		200	82	ug/L			03/27/26 20:17	200
1,2,4-Trimethylbenzene	ND		200	150	ug/L			03/27/26 20:17	200
1,2-Dibromo-3-Chloropropane	ND		200	78	ug/L			03/27/26 20:17	200
1,2-Dichlorobenzene	**1600**		200	160	ug/L			03/27/26 20:17	200
1,2-Dichloroethane	ND		200	42	ug/L			03/27/26 20:17	200
1,2-Dichloropropane	ND		200	140	ug/L			03/27/26 20:17	200
1,3,5-Trimethylbenzene	ND		200	150	ug/L			03/27/26 20:17	200
1,3-Dichlorobenzene	**410**		200	160	ug/L			03/27/26 20:17	200
1,3-Dichloropropane	ND		200	150	ug/L			03/27/26 20:17	200
1,4-Dichlorobenzene	**2000**		200	170	ug/L			03/27/26 20:17	200
2,2-Dichloropropane	ND		200	80	ug/L			03/27/26 20:17	200

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: MW-2A
Lab Sample ID: 480-237182-37
Date Collected: 03/24/26 15:44
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
2-Butanone (MEK)	**800**	**J B**	2000	260	ug/L			03/27/26 20:17	200
2-Chloroethyl vinyl ether	ND		1000	190	ug/L			03/27/26 20:17	200
o-Chlorotoluene	ND		200	170	ug/L			03/27/26 20:17	200
2-Hexanone	ND		1000	250	ug/L			03/27/26 20:17	200
p-Chlorotoluene	ND		200	170	ug/L			03/27/26 20:17	200
p-Cymene	ND		200	62	ug/L			03/27/26 20:17	200
4-Methyl-2-pentanone (MIBK)	ND		1000	420	ug/L			03/27/26 20:17	200
Acetone	ND		2000	600	ug/L			03/27/26 20:17	200
Benzene	**110**	**J**	200	82	ug/L			03/27/26 20:17	200
Bromobenzene	ND		200	160	ug/L			03/27/26 20:17	200
Bromoform	ND		200	52	ug/L			03/27/26 20:17	200
Bromomethane	ND		200	140	ug/L			03/27/26 20:17	200
Carbon disulfide	ND		200	38	ug/L			03/27/26 20:17	200
Carbon tetrachloride	ND		200	54	ug/L			03/27/26 20:17	200
Chlorobenzene	**4500**		200	150	ug/L			03/27/26 20:17	200
Bromochloromethane	ND		200	170	ug/L			03/27/26 20:17	200
Chlorodibromomethane	ND		200	64	ug/L			03/27/26 20:17	200
Chloroethane	ND		200	64	ug/L			03/27/26 20:17	200
Chloroform	ND		200	68	ug/L			03/27/26 20:17	200
Chloromethane	ND		200	70	ug/L			03/27/26 20:17	200
cis-1,2-Dichloroethene	ND		200	160	ug/L			03/27/26 20:17	200
Bromodichloromethane	ND		200	78	ug/L			03/27/26 20:17	200
Dichlorodifluoromethane	ND		200	140	ug/L			03/27/26 20:17	200
Ethylbenzene	ND		200	150	ug/L			03/27/26 20:17	200
1,2-Dibromoethane	ND		200	150	ug/L			03/27/26 20:17	200
Hexachlorobutadiene	ND		400	56	ug/L			03/27/26 20:17	200
Isopropylbenzene	ND		200	160	ug/L			03/27/26 20:17	200
Methyl tert-butyl ether	ND		200	32	ug/L			03/27/26 20:17	200
Methylene Chloride	ND		200	88	ug/L			03/27/26 20:17	200
m-Xylene & p-Xylene	ND		400	130	ug/L			03/27/26 20:17	200
Naphthalene	ND		200	86	ug/L			03/27/26 20:17	200
n-Butylbenzene	ND		200	130	ug/L			03/27/26 20:17	200
N-Propylbenzene	ND		200	140	ug/L			03/27/26 20:17	200
o-Xylene	ND		200	150	ug/L			03/27/26 20:17	200
sec-Butylbenzene	ND		200	150	ug/L			03/27/26 20:17	200
Tetrachloroethene	ND		200	72	ug/L			03/27/26 20:17	200
Toluene	ND		200	100	ug/L			03/27/26 20:17	200
trans-1,2-Dichloroethene	ND		200	180	ug/L			03/27/26 20:17	200
trans-1,3-Dichloropropene	ND		200	74	ug/L			03/27/26 20:17	200
Trichloroethene	ND		200	92	ug/L			03/27/26 20:17	200
Trichlorofluoromethane	ND		200	180	ug/L			03/27/26 20:17	200
Vinyl acetate	ND		1000	170	ug/L			03/27/26 20:17	200
Vinyl chloride	ND		200	180	ug/L			03/27/26 20:17	200
cis-1,3-Dichloropropene	ND		200	72	ug/L			03/27/26 20:17	200
Styrene	ND		200	150	ug/L			03/27/26 20:17	200
tert-Butylbenzene	ND		200	160	ug/L			03/27/26 20:17	200

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*110*		*77 - 120*		*03/27/26 20:17*	*200*
4-Bromofluorobenzene (Surr)	*86*		*73 - 120*		*03/27/26 20:17*	*200*

Client Sample ID: MW-2A
Lab Sample ID: 480-237182-37

Date Collected: 03/24/26 15:44
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
Toluene-d8 (Surr)	105		80 - 120		03/27/26 20:17	200
Dibromofluoromethane (Surr)	102		75 - 123		03/27/26 20:17	200

Client Sample ID: OW-18A
Lab Sample ID: 480-237182-38

Date Collected: 03/25/26 12:10
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		500	180	ug/L			03/28/26 00:53	500
1,1,1-Trichloroethane	ND		500	410	ug/L			03/28/26 00:53	500
1,1,2,2-Tetrachloroethane	ND		500	110	ug/L			03/28/26 00:53	500
1,1,2-Trichloroethane	ND		500	120	ug/L			03/28/26 00:53	500
1,1-Dichloroethane	ND		500	190	ug/L			03/28/26 00:53	500
1,1-Dichloroethene	ND		500	150	ug/L			03/28/26 00:53	500
1,1-Dichloropropene	ND		500	360	ug/L			03/28/26 00:53	500
1,2,3-Trichlorobenzene	ND		500	210	ug/L			03/28/26 00:53	500
1,2,3-Trichloropropane	ND		500	450	ug/L			03/28/26 00:53	500
1,2,4-Trichlorobenzene	ND		500	210	ug/L			03/28/26 00:53	500
1,2,4-Trimethylbenzene	ND		500	380	ug/L			03/28/26 00:53	500
1,2-Dibromo-3-Chloropropane	ND		500	200	ug/L			03/28/26 00:53	500
1,2-Dichlorobenzene	**1700**		500	400	ug/L			03/28/26 00:53	500
1,2-Dichloroethane	ND		500	110	ug/L			03/28/26 00:53	500
1,2-Dichloropropane	ND		500	360	ug/L			03/28/26 00:53	500
1,3,5-Trimethylbenzene	ND		500	390	ug/L			03/28/26 00:53	500
1,3-Dichlorobenzene	**1400**		500	390	ug/L			03/28/26 00:53	500
1,3-Dichloropropane	ND		500	380	ug/L			03/28/26 00:53	500
1,4-Dichlorobenzene	**11000**		500	420	ug/L			03/28/26 00:53	500
2,2-Dichloropropane	ND		500	200	ug/L			03/28/26 00:53	500
2-Butanone (MEK)	**1800**	**J B**	5000	660	ug/L			03/28/26 00:53	500
2-Chloroethyl vinyl ether	ND		2500	480	ug/L			03/28/26 00:53	500
o-Chlorotoluene	ND		500	430	ug/L			03/28/26 00:53	500
2-Hexanone	ND		2500	620	ug/L			03/28/26 00:53	500
p-Chlorotoluene	ND		500	420	ug/L			03/28/26 00:53	500
p-Cymene	ND		500	160	ug/L			03/28/26 00:53	500
4-Methyl-2-pentanone (MIBK)	ND		2500	1100	ug/L			03/28/26 00:53	500
Acetone	ND		5000	1500	ug/L			03/28/26 00:53	500
Benzene	**310**	**J**	500	210	ug/L			03/28/26 00:53	500
Bromobenzene	ND		500	400	ug/L			03/28/26 00:53	500
Bromoform	ND		500	130	ug/L			03/28/26 00:53	500
Bromomethane	ND		500	350	ug/L			03/28/26 00:53	500
Carbon disulfide	ND		500	95	ug/L			03/28/26 00:53	500
Carbon tetrachloride	ND		500	140	ug/L			03/28/26 00:53	500
Chlorobenzene	**11000**		500	380	ug/L			03/28/26 00:53	500
Bromochloromethane	ND		500	440	ug/L			03/28/26 00:53	500
Chlorodibromomethane	ND		500	160	ug/L			03/28/26 00:53	500
Chloroethane	ND		500	160	ug/L			03/28/26 00:53	500
Chloroform	ND		500	170	ug/L			03/28/26 00:53	500
Chloromethane	ND		500	180	ug/L			03/28/26 00:53	500

Client Sample ID: OW-18A
Lab Sample ID: 480-237182-38

Date Collected: 03/25/26 12:10
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
cis-1,2-Dichloroethene	ND		500	410	ug/L			03/28/26 00:53	500
Bromodichloromethane	ND		500	200	ug/L			03/28/26 00:53	500
Dichlorodifluoromethane	ND		500	340	ug/L			03/28/26 00:53	500
Ethylbenzene	ND		500	370	ug/L			03/28/26 00:53	500
1,2-Dibromoethane	ND		500	370	ug/L			03/28/26 00:53	500
Hexachlorobutadiene	ND		1000	140	ug/L			03/28/26 00:53	500
Isopropylbenzene	ND		500	400	ug/L			03/28/26 00:53	500
Methyl tert-butyl ether	ND		500	80	ug/L			03/28/26 00:53	500
Methylene Chloride	ND		500	220	ug/L			03/28/26 00:53	500
m-Xylene & p-Xylene	ND		1000	330	ug/L			03/28/26 00:53	500
Naphthalene	ND		500	220	ug/L			03/28/26 00:53	500
n-Butylbenzene	ND		500	320	ug/L			03/28/26 00:53	500
N-Propylbenzene	ND		500	350	ug/L			03/28/26 00:53	500
o-Xylene	ND		500	380	ug/L			03/28/26 00:53	500
sec-Butylbenzene	ND		500	380	ug/L			03/28/26 00:53	500
Tetrachloroethene	ND		500	180	ug/L			03/28/26 00:53	500
Toluene	ND		500	260	ug/L			03/28/26 00:53	500
trans-1,2-Dichloroethene	ND		500	450	ug/L			03/28/26 00:53	500
trans-1,3-Dichloropropene	ND		500	190	ug/L			03/28/26 00:53	500
Trichloroethene	ND		500	230	ug/L			03/28/26 00:53	500
Trichlorofluoromethane	ND		500	440	ug/L			03/28/26 00:53	500
Vinyl acetate	ND		2500	430	ug/L			03/28/26 00:53	500
Vinyl chloride	ND		500	450	ug/L			03/28/26 00:53	500
cis-1,3-Dichloropropene	ND		500	180	ug/L			03/28/26 00:53	500
Styrene	ND		500	370	ug/L			03/28/26 00:53	500
tert-Butylbenzene	ND		500	410	ug/L			03/28/26 00:53	500

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*109*		*77 - 120*		*03/28/26 00:53*	*500*
4-Bromofluorobenzene (Surr)	*85*		*73 - 120*		*03/28/26 00:53*	*500*
Toluene-d8 (Surr)	*102*		*80 - 120*		*03/28/26 00:53*	*500*
Dibromofluoromethane (Surr)	*103*		*75 - 123*		*03/28/26 00:53*	*500*

Client Sample ID: OW-11B
Lab Sample ID: 480-237182-39

Date Collected: 03/25/26 13:25
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		200	70	ug/L			03/30/26 14:53	200
1,1,1-Trichloroethane	ND		200	160	ug/L			03/30/26 14:53	200
1,1,2,2-Tetrachloroethane	ND		200	42	ug/L			03/30/26 14:53	200
1,1,2-Trichloroethane	ND		200	46	ug/L			03/30/26 14:53	200
1,1-Dichloroethane	ND		200	76	ug/L			03/30/26 14:53	200
1,1-Dichloroethene	ND		200	58	ug/L			03/30/26 14:53	200
1,1-Dichloropropene	ND		200	140	ug/L			03/30/26 14:53	200
1,2,3-Trichlorobenzene	**550**		200	82	ug/L			03/30/26 14:53	200
1,2,3-Trichloropropane	ND		200	180	ug/L			03/30/26 14:53	200
1,2,4-Trichlorobenzene	**1500**		200	82	ug/L			03/30/26 14:53	200
1,2,4-Trimethylbenzene	ND		200	150	ug/L			03/30/26 14:53	200

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-11B
Lab Sample ID: 480-237182-39
Date Collected: 03/25/26 13:25
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,2-Dibromo-3-Chloropropane	ND		200	78	ug/L			03/30/26 14:53	200
1,2-Dichlorobenzene	**6700**		200	160	ug/L			03/30/26 14:53	200
1,2-Dichloroethane	ND		200	42	ug/L			03/30/26 14:53	200
1,2-Dichloropropane	ND		200	140	ug/L			03/30/26 14:53	200
1,3,5-Trimethylbenzene	ND		200	150	ug/L			03/30/26 14:53	200
1,3-Dichlorobenzene	**2400**		200	160	ug/L			03/30/26 14:53	200
1,3-Dichloropropane	ND		200	150	ug/L			03/30/26 14:53	200
1,4-Dichlorobenzene	**7200**		200	170	ug/L			03/30/26 14:53	200
2,2-Dichloropropane	ND		200	80	ug/L			03/30/26 14:53	200
2-Butanone (MEK)	**760**	**J B**	2000	260	ug/L			03/30/26 14:53	200
2-Chloroethyl vinyl ether	ND		1000	190	ug/L			03/30/26 14:53	200
o-Chlorotoluene	ND		200	170	ug/L			03/30/26 14:53	200
2-Hexanone	ND		1000	250	ug/L			03/30/26 14:53	200
p-Chlorotoluene	ND		200	170	ug/L			03/30/26 14:53	200
p-Cymene	ND		200	62	ug/L			03/30/26 14:53	200
4-Methyl-2-pentanone (MIBK)	ND		1000	420	ug/L			03/30/26 14:53	200
Acetone	ND		2000	600	ug/L			03/30/26 14:53	200
Benzene	**1600**		200	82	ug/L			03/30/26 14:53	200
Bromobenzene	ND		200	160	ug/L			03/30/26 14:53	200
Bromoform	ND		200	52	ug/L			03/30/26 14:53	200
Bromomethane	ND		200	140	ug/L			03/30/26 14:53	200
Carbon disulfide	ND		200	38	ug/L			03/30/26 14:53	200
Carbon tetrachloride	ND		200	54	ug/L			03/30/26 14:53	200
Chlorobenzene	**3700**		200	150	ug/L			03/30/26 14:53	200
Bromochloromethane	ND		200	170	ug/L			03/30/26 14:53	200
Chlorodibromomethane	ND		200	64	ug/L			03/30/26 14:53	200
Chloroethane	ND		200	64	ug/L			03/30/26 14:53	200
Chloroform	ND		200	68	ug/L			03/30/26 14:53	200
Chloromethane	ND		200	70	ug/L			03/30/26 14:53	200
cis-1,2-Dichloroethene	ND		200	160	ug/L			03/30/26 14:53	200
Bromodichloromethane	ND		200	78	ug/L			03/30/26 14:53	200
Dichlorodifluoromethane	ND		200	140	ug/L			03/30/26 14:53	200
Ethylbenzene	ND		200	150	ug/L			03/30/26 14:53	200
1,2-Dibromoethane	ND		200	150	ug/L			03/30/26 14:53	200
Hexachlorobutadiene	ND		400	56	ug/L			03/30/26 14:53	200
Isopropylbenzene	ND		200	160	ug/L			03/30/26 14:53	200
Methyl tert-butyl ether	ND		200	32	ug/L			03/30/26 14:53	200
Methylene Chloride	ND		200	88	ug/L			03/30/26 14:53	200
m-Xylene & p-Xylene	ND		400	130	ug/L			03/30/26 14:53	200
Naphthalene	ND		200	86	ug/L			03/30/26 14:53	200
n-Butylbenzene	ND		200	130	ug/L			03/30/26 14:53	200
N-Propylbenzene	ND		200	140	ug/L			03/30/26 14:53	200
o-Xylene	ND		200	150	ug/L			03/30/26 14:53	200
sec-Butylbenzene	ND		200	150	ug/L			03/30/26 14:53	200
Tetrachloroethene	ND		200	72	ug/L			03/30/26 14:53	200
Toluene	ND		200	100	ug/L			03/30/26 14:53	200
trans-1,2-Dichloroethene	ND		200	180	ug/L			03/30/26 14:53	200
trans-1,3-Dichloropropene	ND		200	74	ug/L			03/30/26 14:53	200
Trichloroethene	ND		200	92	ug/L			03/30/26 14:53	200

Client Sample ID: OW-11B

Lab Sample ID: 480-237182-39

Date Collected: 03/25/26 13:25

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Trichlorofluoromethane	ND		200	180	ug/L			03/30/26 14:53	200
Vinyl acetate	ND		1000	170	ug/L			03/30/26 14:53	200
Vinyl chloride	ND		200	180	ug/L			03/30/26 14:53	200
cis-1,3-Dichloropropene	ND		200	72	ug/L			03/30/26 14:53	200
Styrene	ND		200	150	ug/L			03/30/26 14:53	200
tert-Butylbenzene	ND		200	160	ug/L			03/30/26 14:53	200

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*110*		*77 - 120*		*03/30/26 14:53*	*200*
4-Bromofluorobenzene (Surr)	*85*		*73 - 120*		*03/30/26 14:53*	*200*
Toluene-d8 (Surr)	*102*		*80 - 120*		*03/30/26 14:53*	*200*
Dibromofluoromethane (Surr)	*101*		*75 - 123*		*03/30/26 14:53*	*200*

Client Sample ID: OW-111B

Lab Sample ID: 480-237182-40

Date Collected: 03/25/26 14:25

Matrix: Water

Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		200	70	ug/L			03/30/26 15:16	200
1,1,1-Trichloroethane	ND		200	160	ug/L			03/30/26 15:16	200
1,1,2,2-Tetrachloroethane	ND		200	42	ug/L			03/30/26 15:16	200
1,1,2-Trichloroethane	ND		200	46	ug/L			03/30/26 15:16	200
1,1-Dichloroethane	ND		200	76	ug/L			03/30/26 15:16	200
1,1-Dichloroethene	ND		200	58	ug/L			03/30/26 15:16	200
1,1-Dichloropropene	ND		200	140	ug/L			03/30/26 15:16	200
1,2,3-Trichlorobenzene	**550**		200	82	ug/L			03/30/26 15:16	200
1,2,3-Trichloropropane	ND		200	180	ug/L			03/30/26 15:16	200
1,2,4-Trichlorobenzene	**1500**		200	82	ug/L			03/30/26 15:16	200
1,2,4-Trimethylbenzene	ND		200	150	ug/L			03/30/26 15:16	200
1,2-Dibromo-3-Chloropropane	ND		200	78	ug/L			03/30/26 15:16	200
1,2-Dichlorobenzene	**6800**		200	160	ug/L			03/30/26 15:16	200
1,2-Dichloroethane	ND		200	42	ug/L			03/30/26 15:16	200
1,2-Dichloropropane	ND		200	140	ug/L			03/30/26 15:16	200
1,3,5-Trimethylbenzene	ND		200	150	ug/L			03/30/26 15:16	200
1,3-Dichlorobenzene	**2500**		200	160	ug/L			03/30/26 15:16	200
1,3-Dichloropropane	ND		200	150	ug/L			03/30/26 15:16	200
1,4-Dichlorobenzene	**7200**		200	170	ug/L			03/30/26 15:16	200
2,2-Dichloropropane	ND		200	80	ug/L			03/30/26 15:16	200
2-Butanone (MEK)	**850**	**J B**	2000	260	ug/L			03/30/26 15:16	200
2-Chloroethyl vinyl ether	ND		1000	190	ug/L			03/30/26 15:16	200
o-Chlorotoluene	ND		200	170	ug/L			03/30/26 15:16	200
2-Hexanone	ND		1000	250	ug/L			03/30/26 15:16	200
p-Chlorotoluene	ND		200	170	ug/L			03/30/26 15:16	200
p-Cymene	ND		200	62	ug/L			03/30/26 15:16	200
4-Methyl-2-pentanone (MIBK)	ND		1000	420	ug/L			03/30/26 15:16	200
Acetone	ND		2000	600	ug/L			03/30/26 15:16	200
Benzene	**1600**		200	82	ug/L			03/30/26 15:16	200
Bromobenzene	ND		200	160	ug/L			03/30/26 15:16	200
Bromoform	ND		200	52	ug/L			03/30/26 15:16	200

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-111B
Lab Sample ID: 480-237182-40
Date Collected: 03/25/26 14:25
Matrix: Water
Date Received: 03/26/26 15:25

Method: SW846 EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Bromomethane	ND		200	140	ug/L			03/30/26 15:16	200
Carbon disulfide	ND		200	38	ug/L			03/30/26 15:16	200
Carbon tetrachloride	ND		200	54	ug/L			03/30/26 15:16	200
Chlorobenzene	**3600**		200	150	ug/L			03/30/26 15:16	200
Bromochloromethane	ND		200	170	ug/L			03/30/26 15:16	200
Chlorodibromomethane	ND		200	64	ug/L			03/30/26 15:16	200
Chloroethane	ND		200	64	ug/L			03/30/26 15:16	200
Chloroform	ND		200	68	ug/L			03/30/26 15:16	200
Chloromethane	ND		200	70	ug/L			03/30/26 15:16	200
cis-1,2-Dichloroethene	ND		200	160	ug/L			03/30/26 15:16	200
Bromodichloromethane	ND		200	78	ug/L			03/30/26 15:16	200
Dichlorodifluoromethane	ND		200	140	ug/L			03/30/26 15:16	200
Ethylbenzene	ND		200	150	ug/L			03/30/26 15:16	200
1,2-Dibromoethane	ND		200	150	ug/L			03/30/26 15:16	200
Hexachlorobutadiene	ND		400	56	ug/L			03/30/26 15:16	200
Isopropylbenzene	ND		200	160	ug/L			03/30/26 15:16	200
Methyl tert-butyl ether	ND		200	32	ug/L			03/30/26 15:16	200
Methylene Chloride	ND		200	88	ug/L			03/30/26 15:16	200
m-Xylene & p-Xylene	ND		400	130	ug/L			03/30/26 15:16	200
Naphthalene	ND		200	86	ug/L			03/30/26 15:16	200
n-Butylbenzene	ND		200	130	ug/L			03/30/26 15:16	200
N-Propylbenzene	ND		200	140	ug/L			03/30/26 15:16	200
o-Xylene	ND		200	150	ug/L			03/30/26 15:16	200
sec-Butylbenzene	ND		200	150	ug/L			03/30/26 15:16	200
Tetrachloroethene	ND		200	72	ug/L			03/30/26 15:16	200
Toluene	ND		200	100	ug/L			03/30/26 15:16	200
trans-1,2-Dichloroethene	ND		200	180	ug/L			03/30/26 15:16	200
trans-1,3-Dichloropropene	ND		200	74	ug/L			03/30/26 15:16	200
Trichloroethene	ND		200	92	ug/L			03/30/26 15:16	200
Trichlorofluoromethane	ND		200	180	ug/L			03/30/26 15:16	200
Vinyl acetate	ND		1000	170	ug/L			03/30/26 15:16	200
Vinyl chloride	ND		200	180	ug/L			03/30/26 15:16	200
cis-1,3-Dichloropropene	ND		200	72	ug/L			03/30/26 15:16	200
Styrene	ND		200	150	ug/L			03/30/26 15:16	200
tert-Butylbenzene	ND		200	160	ug/L			03/30/26 15:16	200

Surrogate	*%Recovery*	*Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*110*		*77 - 120*		*03/30/26 15:16*	*200*
4-Bromofluorobenzene (Surr)	*85*		*73 - 120*		*03/30/26 15:16*	*200*
Toluene-d8 (Surr)	*103*		*80 - 120*		*03/30/26 15:16*	*200*
Dibromofluoromethane (Surr)	*102*		*75 - 123*		*03/30/26 15:16*	*200*

Surrogate Summary

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Method: EPA 8260D - Volatile Organic Compounds by GC/MS

Matrix: Water **Prep Type: Total/NA**

		Percent Surrogate Recovery (Acceptance Limits)			
		DCA	BFB	TOL	DBFM
Lab Sample ID	Client Sample ID	(77-120)	(73-120)	(80-120)	(75-123)
480-237182-1	OW-26B	110	87	104	101
480-237182-2	OW-30B	107	84	106	99
480-237182-3	MW-5A	110	84	106	101
480-237182-4	MW-5C	108	86	103	98
480-237182-5	MW-5CD	111	86	106	103
480-237182-6	MW-5F	112	86	102	101
480-237182-7	OW-12B	111	88	104	99
480-237182-8	OW-9A	112	86	107	102
480-237182-9	OW-27B	110	88	105	100
480-237182-10	OW-16A	110	87	106	101
480-237182-11	OW-13B	108	85	105	103
480-237182-12	OW-113B	111	85	104	100
480-237182-13	OW-29B	110	87	104	103
480-237182-14	OW-15A	108	87	105	103
480-237182-15	OW-28B	108	85	104	98
480-237182-16	MW-4B	109	84	104	102
480-237182-17	MW-4C	109	88	103	98
480-237182-17 MS	MW-4C	105	88	105	98
480-237182-17 MSD	MW-4C	107	88	107	97
480-237182-18	OW-5B	110	84	103	105
480-237182-19	OW-105B	110	87	105	103
480-237182-20	OW-6B	111	85	104	101
480-237182-21	OW-7B	113	87	106	103
480-237182-22	OW-8B	111	89	106	102
480-237182-23	MW-6B	111	86	103	101
480-237182-24	MW-6F	110	86	105	101
480-237182-25	OW-14B	105	87	104	98
480-237182-26	OW-22A	110	85	105	99
480-237182-27	OW-22B	109	87	104	97
480-237182-27 MS	OW-22B	105	89	105	101
480-237182-27 MSD	OW-22B	107	86	105	99
480-237182-28	OW-15B	111	86	106	99
480-237182-29	TB01	112	86	105	103
480-237182-30	TB02	111	88	106	104
480-237182-31	MW-1B	112	87	102	102
480-237182-32	MW-1C	113	88	102	103
480-237182-33	MW-1CD	112	87	104	97
480-237182-34	MW-1F	109	89	105	99
480-237182-35	OW-12A	106	86	102	100
480-237182-36	OW-10B	109	87	102	101
480-237182-37	MW-2A	110	86	105	102
480-237182-38	OW-18A	109	85	102	103
480-237182-38 MS	OW-18A	110	90	104	101
480-237182-38 MSD	OW-18A	106	90	106	99
480-237182-39	OW-11B	110	85	102	101
480-237182-40	OW-111B	110	85	103	102
LCS 480-771020/6	Lab Control Sample	109	88	105	102
LCS 480-771067/6	Lab Control Sample	107	86	106	100
LCS 480-771146/6	Lab Control Sample	105	88	106	100

Surrogate Summary

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Matrix: Water
Prep Type: Total/NA

		Percent Surrogate Recovery (Acceptance Limits)			
		DCA	BFB	TOL	DBFM
Lab Sample ID	Client Sample ID	(77-120)	(73-120)	(80-120)	(75-123)
LCS 480-771172/6	Lab Control Sample	106	91	104	96
LCS 480-771268/6	Lab Control Sample	106	92	108	101
MB 480-771020/8	Method Blank	108	84	105	102
MB 480-771067/8	Method Blank	108	86	105	102
MB 480-771146/8	Method Blank	110	89	107	101
MB 480-771172/8	Method Blank	112	88	105	100
MB 480-771268/8	Method Blank	106	89	104	100

Surrogate Legend

DCA = 1,2-Dichloroethane-d4 (Surr)
BFB = 4-Bromofluorobenzene (Surr)
TOL = Toluene-d8 (Surr)
DBFM = Dibromofluoromethane (Surr)

Method: EPA 8260D - Volatile Organic Compounds by GC/MS

Lab Sample ID: MB 480-771020/8
Matrix: Water
Analysis Batch: 771020

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			03/26/26 13:20	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			03/26/26 13:20	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			03/26/26 13:20	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			03/26/26 13:20	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			03/26/26 13:20	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			03/26/26 13:20	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			03/26/26 13:20	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			03/26/26 13:20	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			03/26/26 13:20	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			03/26/26 13:20	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			03/26/26 13:20	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			03/26/26 13:20	1
1,2-Dichlorobenzene	ND		1.0	0.79	ug/L			03/26/26 13:20	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			03/26/26 13:20	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			03/26/26 13:20	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			03/26/26 13:20	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			03/26/26 13:20	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			03/26/26 13:20	1
1,4-Dichlorobenzene	ND		1.0	0.84	ug/L			03/26/26 13:20	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			03/26/26 13:20	1
2-Butanone (MEK)	3.51	J	10	1.3	ug/L			03/26/26 13:20	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			03/26/26 13:20	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			03/26/26 13:20	1
2-Hexanone	ND		5.0	1.2	ug/L			03/26/26 13:20	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			03/26/26 13:20	1
p-Cymene	ND		1.0	0.31	ug/L			03/26/26 13:20	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			03/26/26 13:20	1
Acetone	ND		10	3.0	ug/L			03/26/26 13:20	1
Benzene	ND		1.0	0.41	ug/L			03/26/26 13:20	1
Bromobenzene	ND		1.0	0.80	ug/L			03/26/26 13:20	1
Bromoform	ND		1.0	0.26	ug/L			03/26/26 13:20	1
Bromomethane	ND		1.0	0.69	ug/L			03/26/26 13:20	1
Carbon disulfide	ND		1.0	0.19	ug/L			03/26/26 13:20	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			03/26/26 13:20	1
Chlorobenzene	ND		1.0	0.75	ug/L			03/26/26 13:20	1
Bromochloromethane	ND		1.0	0.87	ug/L			03/26/26 13:20	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			03/26/26 13:20	1
Chloroethane	ND		1.0	0.32	ug/L			03/26/26 13:20	1
Chloroform	ND		1.0	0.34	ug/L			03/26/26 13:20	1
Chloromethane	ND		1.0	0.35	ug/L			03/26/26 13:20	1
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			03/26/26 13:20	1
Bromodichloromethane	ND		1.0	0.39	ug/L			03/26/26 13:20	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			03/26/26 13:20	1
Ethylbenzene	ND		1.0	0.74	ug/L			03/26/26 13:20	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			03/26/26 13:20	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			03/26/26 13:20	1
Isopropylbenzene	ND		1.0	0.79	ug/L			03/26/26 13:20	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			03/26/26 13:20	1

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: MB 480-771020/8
Matrix: Water
Analysis Batch: 771020

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methylene Chloride	ND		1.0	0.44	ug/L			03/26/26 13:20	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			03/26/26 13:20	1
Naphthalene	ND		1.0	0.43	ug/L			03/26/26 13:20	1
n-Butylbenzene	ND		1.0	0.64	ug/L			03/26/26 13:20	1
N-Propylbenzene	ND		1.0	0.69	ug/L			03/26/26 13:20	1
o-Xylene	ND		1.0	0.76	ug/L			03/26/26 13:20	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			03/26/26 13:20	1
Tetrachloroethene	ND		1.0	0.36	ug/L			03/26/26 13:20	1
Toluene	ND		1.0	0.51	ug/L			03/26/26 13:20	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			03/26/26 13:20	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			03/26/26 13:20	1
Trichloroethene	ND		1.0	0.46	ug/L			03/26/26 13:20	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			03/26/26 13:20	1
Vinyl acetate	ND		5.0	0.85	ug/L			03/26/26 13:20	1
Vinyl chloride	ND		1.0	0.90	ug/L			03/26/26 13:20	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			03/26/26 13:20	1
Styrene	ND		1.0	0.73	ug/L			03/26/26 13:20	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			03/26/26 13:20	1

Surrogate	*MB %Recovery*	*MB Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*108*		*77 - 120*		*03/26/26 13:20*	*1*
4-Bromofluorobenzene (Surr)	*84*		*73 - 120*		*03/26/26 13:20*	*1*
Toluene-d8 (Surr)	*105*		*80 - 120*		*03/26/26 13:20*	*1*
Dibromofluoromethane (Surr)	*102*		*75 - 123*		*03/26/26 13:20*	*1*

Lab Sample ID: LCS 480-771020/6
Matrix: Water
Analysis Batch: 771020

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,1,1,2-Tetrachloroethane	25.0	20.9		ug/L		84	80 - 120
1,1,1-Trichloroethane	25.0	24.6		ug/L		98	73 - 126
1,1,2,2-Tetrachloroethane	25.0	23.6		ug/L		95	76 - 120
1,1,2-Trichloroethane	25.0	22.3		ug/L		89	76 - 122
1,1-Dichloroethane	25.0	23.2		ug/L		93	77 - 120
1,1-Dichloroethene	25.0	23.5		ug/L		94	66 - 127
1,1-Dichloropropene	25.0	23.2		ug/L		93	72 - 122
1,2,3-Trichlorobenzene	25.0	24.0		ug/L		96	75 - 123
1,2,3-Trichloropropane	25.0	23.9		ug/L		96	68 - 122
1,2,4-Trichlorobenzene	25.0	24.5		ug/L		98	79 - 122
1,2,4-Trimethylbenzene	25.0	24.0		ug/L		96	76 - 121
1,2-Dibromo-3-Chloropropane	25.0	27.2		ug/L		109	56 - 134
1,2-Dichlorobenzene	25.0	23.2		ug/L		93	80 - 124
1,2-Dichloroethane	25.0	24.1		ug/L		96	75 - 120
1,2-Dichloropropane	25.0	23.6		ug/L		94	76 - 120
1,3,5-Trimethylbenzene	25.0	23.6		ug/L		94	77 - 121
1,3-Dichlorobenzene	25.0	22.6		ug/L		90	77 - 120
1,3-Dichloropropane	25.0	22.8		ug/L		91	75 - 120

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: LCS 480-771020/6
Matrix: Water
Analysis Batch: 771020

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,4-Dichlorobenzene	25.0	22.6		ug/L		90	80 - 120
2,2-Dichloropropane	25.0	25.8		ug/L		103	63 - 136
2-Butanone (MEK)	125	128		ug/L		103	57 - 140
2-Chloroethyl vinyl ether	25.0	23.5		ug/L		94	70 - 129
o-Chlorotoluene	25.0	23.2		ug/L		93	76 - 121
2-Hexanone	125	125		ug/L		100	65 - 127
p-Chlorotoluene	25.0	22.7		ug/L		91	77 - 121
p-Cymene	25.0	24.5		ug/L		98	73 - 120
4-Methyl-2-pentanone (MIBK)	125	116		ug/L		93	71 - 125
Acetone	125	138		ug/L		111	56 - 142
Benzene	25.0	22.5		ug/L		90	71 - 124
Bromobenzene	25.0	22.7		ug/L		91	78 - 120
Bromoform	25.0	19.0		ug/L		76	61 - 132
Bromomethane	25.0	22.8		ug/L		91	55 - 144
Carbon disulfide	25.0	22.0		ug/L		88	59 - 134
Carbon tetrachloride	25.0	22.5		ug/L		90	72 - 134
Chlorobenzene	25.0	22.2		ug/L		89	80 - 120
Bromochloromethane	25.0	22.2		ug/L		89	72 - 130
Chlorodibromomethane	25.0	20.5		ug/L		82	75 - 125
Chloroethane	25.0	24.3		ug/L		97	69 - 136
Chloroform	25.0	23.1		ug/L		92	73 - 127
Chloromethane	25.0	21.4		ug/L		85	68 - 124
cis-1,2-Dichloroethene	25.0	22.9		ug/L		91	74 - 124
Bromodichloromethane	25.0	23.7		ug/L		95	80 - 122
Dichlorodifluoromethane	25.0	19.1		ug/L		77	59 - 135
Ethylbenzene	25.0	21.9		ug/L		88	77 - 123
1,2-Dibromoethane	25.0	21.9		ug/L		87	77 - 120
Hexachlorobutadiene	25.0	24.1		ug/L		97	68 - 131
Isopropylbenzene	25.0	24.3		ug/L		97	77 - 122
Methyl tert-butyl ether	25.0	23.5		ug/L		94	77 - 120
Methylene Chloride	25.0	23.6		ug/L		94	75 - 124
m-Xylene & p-Xylene	25.0	21.1		ug/L		84	76 - 122
Naphthalene	25.0	23.9		ug/L		96	66 - 125
n-Butylbenzene	25.0	25.7		ug/L		103	71 - 128
N-Propylbenzene	25.0	24.6		ug/L		98	75 - 127
o-Xylene	25.0	21.0		ug/L		84	76 - 122
sec-Butylbenzene	25.0	24.5		ug/L		98	74 - 127
Tetrachloroethene	25.0	21.8		ug/L		87	74 - 122
Toluene	25.0	22.4		ug/L		90	80 - 122
trans-1,2-Dichloroethene	25.0	22.3		ug/L		89	73 - 127
trans-1,3-Dichloropropene	25.0	23.5		ug/L		94	80 - 120
Trichloroethene	25.0	23.0		ug/L		92	74 - 123
Trichlorofluoromethane	25.0	23.8		ug/L		95	62 - 150
Vinyl acetate	50.0	48.8		ug/L		98	50 - 144
Vinyl chloride	25.0	22.2		ug/L		89	65 - 133
cis-1,3-Dichloropropene	25.0	23.9		ug/L		95	74 - 124
Styrene	25.0	20.8		ug/L		83	80 - 120
tert-Butylbenzene	25.0	25.2		ug/L		101	75 - 123

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: LCS 480-771020/6
Matrix: Water
Analysis Batch: 771020

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Surrogate	LCS %Recovery	LCS Qualifier	Limits
1,2-Dichloroethane-d4 (Surr)	*109*		*77 - 120*
4-Bromofluorobenzene (Surr)	*88*		*73 - 120*
Toluene-d8 (Surr)	*105*		*80 - 120*
Dibromofluoromethane (Surr)	*102*		*75 - 123*

Lab Sample ID: MB 480-771067/8
Matrix: Water
Analysis Batch: 771067

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			03/27/26 01:27	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			03/27/26 01:27	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			03/27/26 01:27	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			03/27/26 01:27	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			03/27/26 01:27	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			03/27/26 01:27	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			03/27/26 01:27	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			03/27/26 01:27	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			03/27/26 01:27	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			03/27/26 01:27	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			03/27/26 01:27	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			03/27/26 01:27	1
1,2-Dichlorobenzene	ND		1.0	0.79	ug/L			03/27/26 01:27	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			03/27/26 01:27	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			03/27/26 01:27	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			03/27/26 01:27	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			03/27/26 01:27	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			03/27/26 01:27	1
1,4-Dichlorobenzene	ND		1.0	0.84	ug/L			03/27/26 01:27	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			03/27/26 01:27	1
2-Butanone (MEK)	ND		10	1.3	ug/L			03/27/26 01:27	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			03/27/26 01:27	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			03/27/26 01:27	1
2-Hexanone	ND		5.0	1.2	ug/L			03/27/26 01:27	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			03/27/26 01:27	1
p-Cymene	ND		1.0	0.31	ug/L			03/27/26 01:27	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			03/27/26 01:27	1
Acetone	ND		10	3.0	ug/L			03/27/26 01:27	1
Benzene	ND		1.0	0.41	ug/L			03/27/26 01:27	1
Bromobenzene	ND		1.0	0.80	ug/L			03/27/26 01:27	1
Bromoform	ND		1.0	0.26	ug/L			03/27/26 01:27	1
Bromomethane	ND		1.0	0.69	ug/L			03/27/26 01:27	1
Carbon disulfide	ND		1.0	0.19	ug/L			03/27/26 01:27	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			03/27/26 01:27	1
Chlorobenzene	ND		1.0	0.75	ug/L			03/27/26 01:27	1
Bromochloromethane	ND		1.0	0.87	ug/L			03/27/26 01:27	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			03/27/26 01:27	1
Chloroethane	ND		1.0	0.32	ug/L			03/27/26 01:27	1

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: MB 480-771067/8
Matrix: Water
Analysis Batch: 771067

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloroform	ND		1.0	0.34	ug/L			03/27/26 01:27	1
Chloromethane	ND		1.0	0.35	ug/L			03/27/26 01:27	1
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			03/27/26 01:27	1
Bromodichloromethane	ND		1.0	0.39	ug/L			03/27/26 01:27	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			03/27/26 01:27	1
Ethylbenzene	ND		1.0	0.74	ug/L			03/27/26 01:27	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			03/27/26 01:27	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			03/27/26 01:27	1
Isopropylbenzene	ND		1.0	0.79	ug/L			03/27/26 01:27	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			03/27/26 01:27	1
Methylene Chloride	ND		1.0	0.44	ug/L			03/27/26 01:27	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			03/27/26 01:27	1
Naphthalene	ND		1.0	0.43	ug/L			03/27/26 01:27	1
n-Butylbenzene	ND		1.0	0.64	ug/L			03/27/26 01:27	1
N-Propylbenzene	ND		1.0	0.69	ug/L			03/27/26 01:27	1
o-Xylene	ND		1.0	0.76	ug/L			03/27/26 01:27	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			03/27/26 01:27	1
Tetrachloroethene	ND		1.0	0.36	ug/L			03/27/26 01:27	1
Toluene	ND		1.0	0.51	ug/L			03/27/26 01:27	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			03/27/26 01:27	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			03/27/26 01:27	1
Trichloroethene	ND		1.0	0.46	ug/L			03/27/26 01:27	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			03/27/26 01:27	1
Vinyl acetate	ND		5.0	0.85	ug/L			03/27/26 01:27	1
Vinyl chloride	ND		1.0	0.90	ug/L			03/27/26 01:27	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			03/27/26 01:27	1
Styrene	ND		1.0	0.73	ug/L			03/27/26 01:27	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			03/27/26 01:27	1

Surrogate	*MB %Recovery*	*MB Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*108*		*77 - 120*		*03/27/26 01:27*	*1*
4-Bromofluorobenzene (Surr)	*86*		*73 - 120*		*03/27/26 01:27*	*1*
Toluene-d8 (Surr)	*105*		*80 - 120*		*03/27/26 01:27*	*1*
Dibromofluoromethane (Surr)	*102*		*75 - 123*		*03/27/26 01:27*	*1*

Lab Sample ID: LCS 480-771067/6
Matrix: Water
Analysis Batch: 771067

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,1,1,2-Tetrachloroethane	25.0	20.6		ug/L		82	80 - 120
1,1,1-Trichloroethane	25.0	23.7		ug/L		95	73 - 126
1,1,2,2-Tetrachloroethane	25.0	23.5		ug/L		94	76 - 120
1,1,2-Trichloroethane	25.0	21.6		ug/L		86	76 - 122
1,1-Dichloroethane	25.0	22.3		ug/L		89	77 - 120
1,1-Dichloroethene	25.0	21.4		ug/L		86	66 - 127
1,1-Dichloropropene	25.0	22.2		ug/L		89	72 - 122
1,2,3-Trichlorobenzene	25.0	23.6		ug/L		94	75 - 123

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: LCS 480-771067/6
Matrix: Water
Analysis Batch: 771067

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,2,3-Trichloropropane	25.0	23.9		ug/L		95	68 - 122
1,2,4-Trichlorobenzene	25.0	23.8		ug/L		95	79 - 122
1,2,4-Trimethylbenzene	25.0	23.5		ug/L		94	76 - 121
1,2-Dibromo-3-Chloropropane	25.0	25.5		ug/L		102	56 - 134
1,2-Dichlorobenzene	25.0	22.5		ug/L		90	80 - 124
1,2-Dichloroethane	25.0	23.5		ug/L		94	75 - 120
1,2-Dichloropropane	25.0	22.5		ug/L		90	76 - 120
1,3,5-Trimethylbenzene	25.0	23.4		ug/L		93	77 - 121
1,3-Dichlorobenzene	25.0	22.3		ug/L		89	77 - 120
1,3-Dichloropropane	25.0	22.3		ug/L		89	75 - 120
1,4-Dichlorobenzene	25.0	22.3		ug/L		89	80 - 120
2,2-Dichloropropane	25.0	22.7		ug/L		91	63 - 136
2-Butanone (MEK)	125	126		ug/L		101	57 - 140
2-Chloroethyl vinyl ether	25.0	22.8		ug/L		91	70 - 129
o-Chlorotoluene	25.0	22.9		ug/L		92	76 - 121
2-Hexanone	125	120		ug/L		96	65 - 127
p-Chlorotoluene	25.0	22.9		ug/L		92	77 - 121
p-Cymene	25.0	23.5		ug/L		94	73 - 120
4-Methyl-2-pentanone (MIBK)	125	114		ug/L		91	71 - 125
Acetone	125	133		ug/L		106	56 - 142
Benzene	25.0	21.7		ug/L		87	71 - 124
Bromobenzene	25.0	22.5		ug/L		90	78 - 120
Bromoform	25.0	19.5		ug/L		78	61 - 132
Bromomethane	25.0	21.7		ug/L		87	55 - 144
Carbon disulfide	25.0	21.0		ug/L		84	59 - 134
Carbon tetrachloride	25.0	21.6		ug/L		87	72 - 134
Chlorobenzene	25.0	22.3		ug/L		89	80 - 120
Bromochloromethane	25.0	21.6		ug/L		87	72 - 130
Chlorodibromomethane	25.0	21.1		ug/L		84	75 - 125
Chloroethane	25.0	22.9		ug/L		91	69 - 136
Chloroform	25.0	22.3		ug/L		89	73 - 127
Chloromethane	25.0	19.8		ug/L		79	68 - 124
cis-1,2-Dichloroethene	25.0	22.2		ug/L		89	74 - 124
Bromodichloromethane	25.0	23.0		ug/L		92	80 - 122
Dichlorodifluoromethane	25.0	16.6		ug/L		66	59 - 135
Ethylbenzene	25.0	21.6		ug/L		87	77 - 123
1,2-Dibromoethane	25.0	21.8		ug/L		87	77 - 120
Hexachlorobutadiene	25.0	23.0		ug/L		92	68 - 131
Isopropylbenzene	25.0	23.4		ug/L		93	77 - 122
Methyl tert-butyl ether	25.0	22.6		ug/L		90	77 - 120
Methylene Chloride	25.0	22.3		ug/L		89	75 - 124
m-Xylene & p-Xylene	25.0	20.8		ug/L		83	76 - 122
Naphthalene	25.0	23.2		ug/L		93	66 - 125
n-Butylbenzene	25.0	24.6		ug/L		99	71 - 128
N-Propylbenzene	25.0	24.0		ug/L		96	75 - 127
o-Xylene	25.0	20.7		ug/L		83	76 - 122
sec-Butylbenzene	25.0	23.5		ug/L		94	74 - 127
Tetrachloroethene	25.0	20.5		ug/L		82	74 - 122
Toluene	25.0	22.0		ug/L		88	80 - 122

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: LCS 480-771067/6
Matrix: Water
Analysis Batch: 771067

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte			Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits		
trans-1,2-Dichloroethene			25.0	22.1		ug/L		89	73 - 127		
trans-1,3-Dichloropropene			25.0	22.9		ug/L		91	80 - 120		
Trichloroethene			25.0	22.5		ug/L		90	74 - 123		
Trichlorofluoromethane			25.0	21.4		ug/L		86	62 - 150		
Vinyl acetate			50.0	43.2		ug/L		86	50 - 144		
Vinyl chloride			25.0	20.0		ug/L		80	65 - 133		
cis-1,3-Dichloropropene			25.0	22.5		ug/L		90	74 - 124		
Styrene			25.0	21.1		ug/L		84	80 - 120		
tert-Butylbenzene			25.0	23.9		ug/L		96	75 - 123		

Surrogate	*LCS %Recovery*	*LCS Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*107*		*77 - 120*
4-Bromofluorobenzene (Surr)	*86*		*73 - 120*
Toluene-d8 (Surr)	*106*		*80 - 120*
Dibromofluoromethane (Surr)	*100*		*75 - 123*

Lab Sample ID: 480-237182-17 MS
Matrix: Water
Analysis Batch: 771067

Client Sample ID: MW-4C
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits		
1,1,1,2-Tetrachloroethane	ND		10000	8190		ug/L		82	80 - 120		
1,1,1-Trichloroethane	ND		10000	9100		ug/L		91	73 - 126		
1,1,2,2-Tetrachloroethane	ND		10000	9010		ug/L		90	76 - 120		
1,1,2-Trichloroethane	ND		10000	8760		ug/L		88	76 - 122		
1,1-Dichloroethane	ND		10000	8670		ug/L		87	77 - 120		
1,1-Dichloroethene	ND		10000	8720		ug/L		87	66 - 127		
1,1-Dichloropropene	ND		10000	8600		ug/L		86	72 - 122		
1,2,3-Trichlorobenzene	ND		10000	9290		ug/L		93	75 - 123		
1,2,3-Trichloropropane	ND		10000	9410		ug/L		94	68 - 122		
1,2,4-Trichlorobenzene	ND		10000	9130		ug/L		91	79 - 122		
1,2,4-Trimethylbenzene	ND		10000	9340		ug/L		93	76 - 121		
1,2-Dibromo-3-Chloropropane	ND		10000	10600		ug/L		106	56 - 134		
1,2-Dichlorobenzene	820		10000	9780		ug/L		90	80 - 124		
1,2-Dichloroethane	ND		10000	9500		ug/L		95	75 - 120		
1,2-Dichloropropane	ND		10000	9100		ug/L		91	76 - 120		
1,3,5-Trimethylbenzene	ND		10000	9070		ug/L		91	77 - 121		
1,3-Dichlorobenzene	ND		10000	8880		ug/L		89	77 - 120		
1,3-Dichloropropane	ND		10000	9090		ug/L		91	75 - 120		
1,4-Dichlorobenzene	520		10000	9380		ug/L		89	78 - 124		
2,2-Dichloropropane	ND		10000	6760		ug/L		68	63 - 136		
2-Butanone (MEK)	1600	J	50000	49600		ug/L		96	57 - 140		
2-Chloroethyl vinyl ether	ND		10000	9040		ug/L		90	70 - 129		
o-Chlorotoluene	ND		10000	8880		ug/L		89	76 - 121		
2-Hexanone	ND		50000	48500		ug/L		97	65 - 127		
p-Chlorotoluene	ND		10000	9130		ug/L		91	77 - 121		
p-Cymene	ND		10000	9120		ug/L		91	73 - 120		
4-Methyl-2-pentanone (MIBK)	ND		50000	45200		ug/L		90	71 - 125		

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: 480-237182-17 MS
Matrix: Water
Analysis Batch: 771067

Client Sample ID: MW-4C
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
Acetone	ND		50000	51500		ug/L		103	56 - 142
Benzene	2800		10000	11200		ug/L		84	71 - 124
Bromobenzene	ND		10000	8870		ug/L		89	78 - 120
Bromoform	ND		10000	8070		ug/L		81	61 - 132
Bromomethane	ND		10000	9230		ug/L		92	55 - 144
Carbon disulfide	ND		10000	8400		ug/L		84	59 - 134
Carbon tetrachloride	ND		10000	8400		ug/L		84	72 - 134
Chlorobenzene	4600		10000	13100		ug/L		86	80 - 120
Bromochloromethane	ND		10000	8690		ug/L		87	72 - 130
Chlorodibromomethane	ND		10000	8240		ug/L		82	75 - 125
Chloroethane	ND		10000	9550		ug/L		95	69 - 136
Chloroform	ND		10000	8770		ug/L		88	73 - 127
Chloromethane	ND		10000	8120		ug/L		81	68 - 124
cis-1,2-Dichloroethene	23000	F1	10000	30700	F1	ug/L		72	74 - 124
Bromodichloromethane	ND		10000	9030		ug/L		90	80 - 122
Dichlorodifluoromethane	ND		10000	7210		ug/L		72	59 - 135
Ethylbenzene	ND		10000	8640		ug/L		86	77 - 123
1,2-Dibromoethane	ND		10000	8690		ug/L		87	77 - 120
Hexachlorobutadiene	ND		10000	8840		ug/L		88	68 - 131
Isopropylbenzene	ND		10000	9190		ug/L		92	77 - 122
Methyl tert-butyl ether	ND		10000	8660		ug/L		87	77 - 120
Methylene Chloride	ND		10000	9070		ug/L		91	75 - 124
m-Xylene & p-Xylene	ND		10000	8170		ug/L		82	76 - 122
Naphthalene	ND		10000	9260		ug/L		93	66 - 125
n-Butylbenzene	ND		10000	9480		ug/L		95	71 - 128
N-Propylbenzene	ND		10000	9380		ug/L		94	75 - 127
o-Xylene	ND		10000	8130		ug/L		81	76 - 122
sec-Butylbenzene	ND		10000	9100		ug/L		91	74 - 127
Tetrachloroethene	370	J	10000	8880		ug/L		85	74 - 122
Toluene	ND		10000	8840		ug/L		88	80 - 122
trans-1,2-Dichloroethene	ND		10000	8800		ug/L		88	73 - 127
trans-1,3-Dichloropropene	ND		10000	8620		ug/L		86	80 - 120
Trichloroethene	1900		10000	11300		ug/L		93	74 - 123
Trichlorofluoromethane	ND		10000	9120		ug/L		91	62 - 150
Vinyl acetate	ND		20000	12000		ug/L		60	50 - 144
Vinyl chloride	1900		10000	10400		ug/L		85	65 - 133
cis-1,3-Dichloropropene	ND		10000	8590		ug/L		86	74 - 124
Styrene	ND		10000	8380		ug/L		84	80 - 120
tert-Butylbenzene	ND		10000	9340		ug/L		93	75 - 123

Surrogate	*MS %Recovery*	*MS Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*105*		*77 - 120*
4-Bromofluorobenzene (Surr)	*88*		*73 - 120*
Toluene-d8 (Surr)	*105*		*80 - 120*
Dibromofluoromethane (Surr)	*98*		*75 - 123*

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: 480-237182-17 MSD
Client Sample ID: MW-4C
Matrix: Water
Prep Type: Total/NA
Analysis Batch: 771067

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
1,1,1,2-Tetrachloroethane	ND		10000	8070		ug/L		81	80 - 120	1	20
1,1,1-Trichloroethane	ND		10000	8890		ug/L		89	73 - 126	2	15
1,1,2,2-Tetrachloroethane	ND		10000	9210		ug/L		92	76 - 120	2	15
1,1,2-Trichloroethane	ND		10000	8870		ug/L		89	76 - 122	1	15
1,1-Dichloroethane	ND		10000	8290		ug/L		83	77 - 120	4	20
1,1-Dichloroethene	ND		10000	8370		ug/L		84	66 - 127	4	16
1,1-Dichloropropene	ND		10000	8110		ug/L		81	72 - 122	6	20
1,2,3-Trichlorobenzene	ND		10000	9260		ug/L		93	75 - 123	0	20
1,2,3-Trichloropropane	ND		10000	9720		ug/L		97	68 - 122	3	14
1,2,4-Trichlorobenzene	ND		10000	9180		ug/L		92	79 - 122	1	20
1,2,4-Trimethylbenzene	ND		10000	9180		ug/L		92	76 - 121	2	20
1,2-Dibromo-3-Chloropropane	ND		10000	10600		ug/L		106	56 - 134	0	15
1,2-Dichlorobenzene	820		10000	9670		ug/L		88	80 - 124	1	20
1,2-Dichloroethane	ND		10000	9190		ug/L		92	75 - 120	3	20
1,2-Dichloropropane	ND		10000	8650		ug/L		86	76 - 120	5	20
1,3,5-Trimethylbenzene	ND		10000	9090		ug/L		91	77 - 121	0	20
1,3-Dichlorobenzene	ND		10000	8920		ug/L		89	77 - 120	0	20
1,3-Dichloropropane	ND		10000	9000		ug/L		90	75 - 120	1	20
1,4-Dichlorobenzene	520		10000	9340		ug/L		88	78 - 124	0	20
2,2-Dichloropropane	ND		10000	6360		ug/L		64	63 - 136	6	20
2-Butanone (MEK)	1600	J	50000	49500		ug/L		96	57 - 140	0	20
2-Chloroethyl vinyl ether	ND		10000	8660		ug/L		87	70 - 129	4	20
o-Chlorotoluene	ND		10000	9020		ug/L		90	76 - 121	2	20
2-Hexanone	ND		50000	49700		ug/L		99	65 - 127	2	15
p-Chlorotoluene	ND		10000	8760		ug/L		88	77 - 121	4	15
p-Cymene	ND		10000	8920		ug/L		89	73 - 120	2	20
4-Methyl-2-pentanone (MIBK)	ND		50000	46300		ug/L		93	71 - 125	2	35
Acetone	ND		50000	51500		ug/L		103	56 - 142	0	15
Benzene	2800		10000	10800		ug/L		80	71 - 124	4	13
Bromobenzene	ND		10000	8700		ug/L		87	78 - 120	2	15
Bromoform	ND		10000	8000		ug/L		80	61 - 132	1	15
Bromomethane	ND		10000	8740		ug/L		87	55 - 144	5	15
Carbon disulfide	ND		10000	7840		ug/L		78	59 - 134	7	15
Carbon tetrachloride	ND		10000	7960		ug/L		80	72 - 134	5	15
Chlorobenzene	4600		10000	12900		ug/L		83	80 - 120	2	25
Bromochloromethane	ND		10000	8380		ug/L		84	72 - 130	4	15
Chlorodibromomethane	ND		10000	8390		ug/L		84	75 - 125	2	15
Chloroethane	ND		10000	9000		ug/L		90	69 - 136	6	15
Chloroform	ND		10000	8350		ug/L		83	73 - 127	5	20
Chloromethane	ND		10000	7980		ug/L		80	68 - 124	2	15
cis-1,2-Dichloroethene	23000	F1	10000	29800	F1	ug/L		63	74 - 124	3	15
Bromodichloromethane	ND		10000	8800		ug/L		88	80 - 122	3	15
Dichlorodifluoromethane	ND		10000	7130		ug/L		71	59 - 135	1	20
Ethylbenzene	ND		10000	8340		ug/L		83	77 - 123	3	15
1,2-Dibromoethane	ND		10000	8670		ug/L		87	77 - 120	0	15
Hexachlorobutadiene	ND		10000	8760		ug/L		88	68 - 131	1	20
Isopropylbenzene	ND		10000	8960		ug/L		90	77 - 122	3	20
Methyl tert-butyl ether	ND		10000	8570		ug/L		86	77 - 120	1	37

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: 480-237182-17 MSD
Matrix: Water
Analysis Batch: 771067

Client Sample ID: MW-4C
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
Methylene Chloride	ND		10000	8590		ug/L		86	75 - 124	5	15
m-Xylene & p-Xylene	ND		10000	8000		ug/L		80	76 - 122	2	16
Naphthalene	ND		10000	9550		ug/L		96	66 - 125	3	20
n-Butylbenzene	ND		10000	9360		ug/L		94	71 - 128	1	15
N-Propylbenzene	ND		10000	9200		ug/L		92	75 - 127	2	15
o-Xylene	ND		10000	7950		ug/L		80	76 - 122	2	16
sec-Butylbenzene	ND		10000	8950		ug/L		89	74 - 127	2	15
Tetrachloroethene	370	J	10000	8520		ug/L		82	74 - 122	4	20
Toluene	ND		10000	8680		ug/L		87	80 - 122	2	15
trans-1,2-Dichloroethene	ND		10000	8520		ug/L		85	73 - 127	3	20
trans-1,3-Dichloropropene	ND		10000	8670		ug/L		87	80 - 120	1	15
Trichloroethene	1900		10000	10900		ug/L		89	74 - 123	4	16
Trichlorofluoromethane	ND		10000	8800		ug/L		88	62 - 150	4	20
Vinyl acetate	ND		20000	11800		ug/L		59	50 - 144	1	23
Vinyl chloride	1900		10000	9910		ug/L		80	65 - 133	5	15
cis-1,3-Dichloropropene	ND		10000	8240		ug/L		82	74 - 124	4	15
Styrene	ND		10000	8190		ug/L		82	80 - 120	2	20
tert-Butylbenzene	ND		10000	9220		ug/L		92	75 - 123	1	15

Surrogate	*MSD %Recovery*	*MSD Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*107*		*77 - 120*
4-Bromofluorobenzene (Surr)	*88*		*73 - 120*
Toluene-d8 (Surr)	*107*		*80 - 120*
Dibromofluoromethane (Surr)	*97*		*75 - 123*

Lab Sample ID: MB 480-771146/8
Matrix: Water
Analysis Batch: 771146

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			03/27/26 13:23	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			03/27/26 13:23	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			03/27/26 13:23	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			03/27/26 13:23	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			03/27/26 13:23	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			03/27/26 13:23	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			03/27/26 13:23	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			03/27/26 13:23	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			03/27/26 13:23	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			03/27/26 13:23	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			03/27/26 13:23	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			03/27/26 13:23	1
1,2-Dichlorobenzene	ND		1.0	0.79	ug/L			03/27/26 13:23	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			03/27/26 13:23	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			03/27/26 13:23	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			03/27/26 13:23	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			03/27/26 13:23	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			03/27/26 13:23	1

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: MB 480-771146/8
Matrix: Water
Analysis Batch: 771146

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,4-Dichlorobenzene	ND		1.0	0.84	ug/L			03/27/26 13:23	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			03/27/26 13:23	1
2-Butanone (MEK)	3.95	J	10	1.3	ug/L			03/27/26 13:23	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			03/27/26 13:23	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			03/27/26 13:23	1
2-Hexanone	ND		5.0	1.2	ug/L			03/27/26 13:23	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			03/27/26 13:23	1
p-Cymene	ND		1.0	0.31	ug/L			03/27/26 13:23	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			03/27/26 13:23	1
Acetone	ND		10	3.0	ug/L			03/27/26 13:23	1
Benzene	ND		1.0	0.41	ug/L			03/27/26 13:23	1
Bromobenzene	ND		1.0	0.80	ug/L			03/27/26 13:23	1
Bromoform	ND		1.0	0.26	ug/L			03/27/26 13:23	1
Bromomethane	ND		1.0	0.69	ug/L			03/27/26 13:23	1
Carbon disulfide	ND		1.0	0.19	ug/L			03/27/26 13:23	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			03/27/26 13:23	1
Chlorobenzene	ND		1.0	0.75	ug/L			03/27/26 13:23	1
Bromochloromethane	ND		1.0	0.87	ug/L			03/27/26 13:23	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			03/27/26 13:23	1
Chloroethane	ND		1.0	0.32	ug/L			03/27/26 13:23	1
Chloroform	ND		1.0	0.34	ug/L			03/27/26 13:23	1
Chloromethane	ND		1.0	0.35	ug/L			03/27/26 13:23	1
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			03/27/26 13:23	1
Bromodichloromethane	ND		1.0	0.39	ug/L			03/27/26 13:23	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			03/27/26 13:23	1
Ethylbenzene	ND		1.0	0.74	ug/L			03/27/26 13:23	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			03/27/26 13:23	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			03/27/26 13:23	1
Isopropylbenzene	ND		1.0	0.79	ug/L			03/27/26 13:23	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			03/27/26 13:23	1
Methylene Chloride	ND		1.0	0.44	ug/L			03/27/26 13:23	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			03/27/26 13:23	1
Naphthalene	ND		1.0	0.43	ug/L			03/27/26 13:23	1
n-Butylbenzene	ND		1.0	0.64	ug/L			03/27/26 13:23	1
N-Propylbenzene	ND		1.0	0.69	ug/L			03/27/26 13:23	1
o-Xylene	ND		1.0	0.76	ug/L			03/27/26 13:23	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			03/27/26 13:23	1
Tetrachloroethene	ND		1.0	0.36	ug/L			03/27/26 13:23	1
Toluene	ND		1.0	0.51	ug/L			03/27/26 13:23	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			03/27/26 13:23	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			03/27/26 13:23	1
Trichloroethene	ND		1.0	0.46	ug/L			03/27/26 13:23	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			03/27/26 13:23	1
Vinyl acetate	ND		5.0	0.85	ug/L			03/27/26 13:23	1
Vinyl chloride	ND		1.0	0.90	ug/L			03/27/26 13:23	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			03/27/26 13:23	1
Styrene	ND		1.0	0.73	ug/L			03/27/26 13:23	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			03/27/26 13:23	1

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: MB 480-771146/8
Matrix: Water
Analysis Batch: 771146

Client Sample ID: Method Blank
Prep Type: Total/NA

Surrogate	MB %Recovery	MB Qualifier	Limits	Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	110		77 - 120		03/27/26 13:23	1
4-Bromofluorobenzene (Surr)	89		73 - 120		03/27/26 13:23	1
Toluene-d8 (Surr)	107		80 - 120		03/27/26 13:23	1
Dibromofluoromethane (Surr)	101		75 - 123		03/27/26 13:23	1

Lab Sample ID: LCS 480-771146/6
Matrix: Water
Analysis Batch: 771146

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,1,1,2-Tetrachloroethane	25.0	22.5		ug/L		90	80 - 120
1,1,1-Trichloroethane	25.0	25.4		ug/L		102	73 - 126
1,1,2,2-Tetrachloroethane	25.0	26.1		ug/L		104	76 - 120
1,1,2-Trichloroethane	25.0	24.5		ug/L		98	76 - 122
1,1-Dichloroethane	25.0	24.0		ug/L		96	77 - 120
1,1-Dichloroethene	25.0	24.1		ug/L		97	66 - 127
1,1-Dichloropropene	25.0	24.1		ug/L		96	72 - 122
1,2,3-Trichlorobenzene	25.0	26.6		ug/L		106	75 - 123
1,2,3-Trichloropropane	25.0	25.9		ug/L		104	68 - 122
1,2,4-Trichlorobenzene	25.0	27.0		ug/L		108	79 - 122
1,2,4-Trimethylbenzene	25.0	26.3		ug/L		105	76 - 121
1,2-Dibromo-3-Chloropropane	25.0	29.9		ug/L		120	56 - 134
1,2-Dichlorobenzene	25.0	24.8		ug/L		99	80 - 124
1,2-Dichloroethane	25.0	25.5		ug/L		102	75 - 120
1,2-Dichloropropane	25.0	24.4		ug/L		97	76 - 120
1,3,5-Trimethylbenzene	25.0	26.0		ug/L		104	77 - 121
1,3-Dichlorobenzene	25.0	24.9		ug/L		100	77 - 120
1,3-Dichloropropane	25.0	24.0		ug/L		96	75 - 120
1,4-Dichlorobenzene	25.0	24.7		ug/L		99	80 - 120
2,2-Dichloropropane	25.0	28.2		ug/L		113	63 - 136
2-Butanone (MEK)	125	132		ug/L		105	57 - 140
2-Chloroethyl vinyl ether	25.0	24.8		ug/L		99	70 - 129
o-Chlorotoluene	25.0	24.5		ug/L		98	76 - 121
2-Hexanone	125	132		ug/L		106	65 - 127
p-Chlorotoluene	25.0	24.7		ug/L		99	77 - 121
p-Cymene	25.0	26.2		ug/L		105	73 - 120
4-Methyl-2-pentanone (MIBK)	125	127		ug/L		101	71 - 125
Acetone	125	121		ug/L		97	56 - 142
Benzene	25.0	23.0		ug/L		92	71 - 124
Bromobenzene	25.0	24.6		ug/L		98	78 - 120
Bromoform	25.0	22.0		ug/L		88	61 - 132
Bromomethane	25.0	24.6		ug/L		98	55 - 144
Carbon disulfide	25.0	23.8		ug/L		95	59 - 134
Carbon tetrachloride	25.0	23.5		ug/L		94	72 - 134
Chlorobenzene	25.0	23.5		ug/L		94	80 - 120
Bromochloromethane	25.0	23.6		ug/L		94	72 - 130
Chlorodibromomethane	25.0	23.2		ug/L		93	75 - 125
Chloroethane	25.0	24.4		ug/L		98	69 - 136

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: LCS 480-771146/6
Matrix: Water
Analysis Batch: 771146

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Chloroform	25.0	24.0		ug/L		96	73 - 127
Chloromethane	25.0	22.5		ug/L		90	68 - 124
cis-1,2-Dichloroethene	25.0	23.3		ug/L		93	74 - 124
Bromodichloromethane	25.0	24.7		ug/L		99	80 - 122
Dichlorodifluoromethane	25.0	24.4		ug/L		97	59 - 135
Ethylbenzene	25.0	23.5		ug/L		94	77 - 123
1,2-Dibromoethane	25.0	23.6		ug/L		94	77 - 120
Hexachlorobutadiene	25.0	27.0		ug/L		108	68 - 131
Isopropylbenzene	25.0	26.1		ug/L		104	77 - 122
Methyl tert-butyl ether	25.0	24.5		ug/L		98	77 - 120
Methylene Chloride	25.0	24.5		ug/L		98	75 - 124
m-Xylene & p-Xylene	25.0	22.8		ug/L		91	76 - 122
Naphthalene	25.0	26.1		ug/L		104	66 - 125
n-Butylbenzene	25.0	27.5		ug/L		110	71 - 128
N-Propylbenzene	25.0	26.4		ug/L		106	75 - 127
o-Xylene	25.0	22.4		ug/L		90	76 - 122
sec-Butylbenzene	25.0	26.7		ug/L		107	74 - 127
Tetrachloroethene	25.0	23.0		ug/L		92	74 - 122
Toluene	25.0	24.0		ug/L		96	80 - 122
trans-1,2-Dichloroethene	25.0	23.5		ug/L		94	73 - 127
trans-1,3-Dichloropropene	25.0	25.7		ug/L		103	80 - 120
Trichloroethene	25.0	23.9		ug/L		95	74 - 123
Trichlorofluoromethane	25.0	24.4		ug/L		97	62 - 150
Vinyl acetate	50.0	49.8		ug/L		100	50 - 144
Vinyl chloride	25.0	23.3		ug/L		93	65 - 133
cis-1,3-Dichloropropene	25.0	24.8		ug/L		99	74 - 124
Styrene	25.0	22.8		ug/L		91	80 - 120
tert-Butylbenzene	25.0	27.4		ug/L		110	75 - 123

Surrogate	*LCS %Recovery*	*LCS Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*105*		*77 - 120*
4-Bromofluorobenzene (Surr)	*88*		*73 - 120*
Toluene-d8 (Surr)	*106*		*80 - 120*
Dibromofluoromethane (Surr)	*100*		*75 - 123*

Lab Sample ID: 480-237182-27 MS
Matrix: Water
Analysis Batch: 771146

Client Sample ID: OW-22B
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
1,1,1,2-Tetrachloroethane	ND		5000	4430		ug/L		89	80 - 120
1,1,1-Trichloroethane	ND		5000	5010		ug/L		100	73 - 126
1,1,2,2-Tetrachloroethane	310		5000	5470		ug/L		103	76 - 120
1,1,2-Trichloroethane	ND		5000	4750		ug/L		95	76 - 122
1,1-Dichloroethane	ND		5000	4750		ug/L		95	77 - 120
1,1-Dichloroethene	ND		5000	4780		ug/L		96	66 - 127
1,1-Dichloropropene	ND		5000	4630		ug/L		93	72 - 122
1,2,3-Trichlorobenzene	99	J	5000	5260		ug/L		103	75 - 123

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: 480-237182-27 MS
Matrix: Water
Analysis Batch: 771146

Client Sample ID: OW-22B
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
1,2,3-Trichloropropane	ND		5000	5110		ug/L		102	68 - 122
1,2,4-Trichlorobenzene	220		5000	5410		ug/L		104	79 - 122
1,2,4-Trimethylbenzene	ND		5000	5120		ug/L		102	76 - 121
1,2-Dibromo-3-Chloropropane	ND		5000	5690		ug/L		114	56 - 134
1,2-Dichlorobenzene	ND		5000	4840		ug/L		97	80 - 124
1,2-Dichloroethane	ND		5000	5080		ug/L		102	75 - 120
1,2-Dichloropropane	ND		5000	4780		ug/L		96	76 - 120
1,3,5-Trimethylbenzene	ND		5000	4980		ug/L		100	77 - 121
1,3-Dichlorobenzene	ND		5000	4850		ug/L		97	77 - 120
1,3-Dichloropropane	ND		5000	4660		ug/L		93	75 - 120
1,4-Dichlorobenzene	ND		5000	4900		ug/L		98	78 - 124
2,2-Dichloropropane	ND		5000	4910		ug/L		98	63 - 136
2-Butanone (MEK)	790	J B	25000	26100		ug/L		101	57 - 140
2-Chloroethyl vinyl ether	ND		5000	4720		ug/L		94	70 - 129
o-Chlorotoluene	ND		5000	4780		ug/L		96	76 - 121
2-Hexanone	ND		25000	25600		ug/L		103	65 - 127
p-Chlorotoluene	ND		5000	4790		ug/L		96	77 - 121
p-Cymene	ND		5000	5040		ug/L		101	73 - 120
4-Methyl-2-pentanone (MIBK)	ND		25000	24600		ug/L		98	71 - 125
Acetone	ND		25000	24200		ug/L		97	56 - 142
Benzene	ND		5000	4680		ug/L		94	71 - 124
Bromobenzene	ND		5000	4850		ug/L		97	78 - 120
Bromoform	ND		5000	4260		ug/L		85	61 - 132
Bromomethane	ND		5000	5020		ug/L		100	55 - 144
Carbon disulfide	ND		5000	4660		ug/L		93	59 - 134
Carbon tetrachloride	ND		5000	4540		ug/L		91	72 - 134
Chlorobenzene	ND		5000	4690		ug/L		94	80 - 120
Bromochloromethane	ND		5000	4730		ug/L		95	72 - 130
Chlorodibromomethane	ND		5000	4340		ug/L		87	75 - 125
Chloroethane	ND		5000	4950		ug/L		99	69 - 136
Chloroform	100	J	5000	4850		ug/L		95	73 - 127
Chloromethane	ND		5000	4680		ug/L		94	68 - 124
cis-1,2-Dichloroethene	1500		5000	6100		ug/L		91	74 - 124
Bromodichloromethane	ND		5000	4770		ug/L		95	80 - 122
Dichlorodifluoromethane	ND		5000	4590		ug/L		92	59 - 135
Ethylbenzene	ND		5000	4600		ug/L		92	77 - 123
1,2-Dibromoethane	ND		5000	4590		ug/L		92	77 - 120
Hexachlorobutadiene	ND		5000	5050		ug/L		101	68 - 131
Isopropylbenzene	ND		5000	4990		ug/L		100	77 - 122
Methyl tert-butyl ether	ND		5000	4850		ug/L		97	77 - 120
Methylene Chloride	ND		5000	5030		ug/L		101	75 - 124
m-Xylene & p-Xylene	ND		5000	4420		ug/L		88	76 - 122
Naphthalene	ND		5000	5120		ug/L		102	66 - 125
n-Butylbenzene	ND		5000	5350		ug/L		107	71 - 128
N-Propylbenzene	ND		5000	5190		ug/L		104	75 - 127
o-Xylene	ND		5000	4440		ug/L		89	76 - 122
sec-Butylbenzene	ND		5000	5130		ug/L		103	74 - 127
Tetrachloroethene	3300		5000	7330		ug/L		80	74 - 122
Toluene	ND		5000	4630		ug/L		93	80 - 122

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: 480-237182-27 MS
Matrix: Water
Analysis Batch: 771146

Client Sample ID: OW-22B
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
trans-1,2-Dichloroethene	ND		5000	4620		ug/L		92	73 - 127
trans-1,3-Dichloropropene	ND		5000	4780		ug/L		96	80 - 120
Trichloroethene	6800		5000	11000		ug/L		84	74 - 123
Trichlorofluoromethane	ND		5000	4570		ug/L		91	62 - 150
Vinyl acetate	ND		10000	8200		ug/L		82	50 - 144
Vinyl chloride	ND		5000	4570		ug/L		91	65 - 133
cis-1,3-Dichloropropene	ND		5000	4740		ug/L		95	74 - 124
Styrene	ND		5000	4470		ug/L		89	80 - 120
tert-Butylbenzene	ND		5000	5060		ug/L		101	75 - 123

Surrogate	*MS %Recovery*	*MS Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*105*		*77 - 120*
4-Bromofluorobenzene (Surr)	*89*		*73 - 120*
Toluene-d8 (Surr)	*105*		*80 - 120*
Dibromofluoromethane (Surr)	*101*		*75 - 123*

Lab Sample ID: 480-237182-27 MSD
Matrix: Water
Analysis Batch: 771146

Client Sample ID: OW-22B
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
1,1,1,2-Tetrachloroethane	ND		5000	4360		ug/L		87	80 - 120	2	20
1,1,1-Trichloroethane	ND		5000	5060		ug/L		101	73 - 126	1	15
1,1,2,2-Tetrachloroethane	310		5000	5300		ug/L		100	76 - 120	3	15
1,1,2-Trichloroethane	ND		5000	4660		ug/L		93	76 - 122	2	15
1,1-Dichloroethane	ND		5000	4840		ug/L		97	77 - 120	2	20
1,1-Dichloroethene	ND		5000	4840		ug/L		97	66 - 127	1	16
1,1-Dichloropropene	ND		5000	4720		ug/L		94	72 - 122	2	20
1,2,3-Trichlorobenzene	99	J	5000	5130		ug/L		101	75 - 123	2	20
1,2,3-Trichloropropane	ND		5000	5220		ug/L		104	68 - 122	2	14
1,2,4-Trichlorobenzene	220		5000	5400		ug/L		104	79 - 122	0	20
1,2,4-Trimethylbenzene	ND		5000	5040		ug/L		101	76 - 121	2	20
1,2-Dibromo-3-Chloropropane	ND		5000	5690		ug/L		114	56 - 134	0	15
1,2-Dichlorobenzene	ND		5000	4880		ug/L		98	80 - 124	1	20
1,2-Dichloroethane	ND		5000	4970		ug/L		99	75 - 120	2	20
1,2-Dichloropropane	ND		5000	4810		ug/L		96	76 - 120	1	20
1,3,5-Trimethylbenzene	ND		5000	4990		ug/L		100	77 - 121	0	20
1,3-Dichlorobenzene	ND		5000	4800		ug/L		96	77 - 120	1	20
1,3-Dichloropropane	ND		5000	4770		ug/L		95	75 - 120	2	20
1,4-Dichlorobenzene	ND		5000	4820		ug/L		96	78 - 124	2	20
2,2-Dichloropropane	ND		5000	4930		ug/L		99	63 - 136	0	20
2-Butanone (MEK)	790	J B	25000	26100		ug/L		101	57 - 140	0	20
2-Chloroethyl vinyl ether	ND		5000	4910		ug/L		98	70 - 129	4	20
o-Chlorotoluene	ND		5000	4940		ug/L		99	76 - 121	3	20
2-Hexanone	ND		25000	25700		ug/L		103	65 - 127	0	15
p-Chlorotoluene	ND		5000	4720		ug/L		94	77 - 121	2	15
p-Cymene	ND		5000	5060		ug/L		101	73 - 120	0	20
4-Methyl-2-pentanone (MIBK)	ND		25000	24500		ug/L		98	71 - 125	0	35

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: 480-237182-27 MSD
Client Sample ID: OW-22B
Matrix: Water
Prep Type: Total/NA
Analysis Batch: 771146

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
Acetone	ND		25000	24200		ug/L		97	56 - 142	0	15
Benzene	ND		5000	4700		ug/L		94	71 - 124	0	13
Bromobenzene	ND		5000	4770		ug/L		95	78 - 120	2	15
Bromoform	ND		5000	4220		ug/L		84	61 - 132	1	15
Bromomethane	ND		5000	4890		ug/L		98	55 - 144	3	15
Carbon disulfide	ND		5000	4820		ug/L		96	59 - 134	3	15
Carbon tetrachloride	ND		5000	4660		ug/L		93	72 - 134	3	15
Chlorobenzene	ND		5000	4710		ug/L		94	80 - 120	0	25
Bromochloromethane	ND		5000	4620		ug/L		92	72 - 130	2	15
Chlorodibromomethane	ND		5000	4410		ug/L		88	75 - 125	2	15
Chloroethane	ND		5000	4950		ug/L		99	69 - 136	0	15
Chloroform	100	J	5000	4880		ug/L		95	73 - 127	1	20
Chloromethane	ND		5000	4800		ug/L		96	68 - 124	2	15
cis-1,2-Dichloroethene	1500		5000	6280		ug/L		95	74 - 124	3	15
Bromodichloromethane	ND		5000	4900		ug/L		98	80 - 122	3	15
Dichlorodifluoromethane	ND		5000	4550		ug/L		91	59 - 135	1	20
Ethylbenzene	ND		5000	4630		ug/L		93	77 - 123	1	15
1,2-Dibromoethane	ND		5000	4710		ug/L		94	77 - 120	3	15
Hexachlorobutadiene	ND		5000	5000		ug/L		100	68 - 131	1	20
Isopropylbenzene	ND		5000	5080		ug/L		102	77 - 122	2	20
Methyl tert-butyl ether	ND		5000	4810		ug/L		96	77 - 120	1	37
Methylene Chloride	ND		5000	4800		ug/L		96	75 - 124	5	15
m-Xylene & p-Xylene	ND		5000	4400		ug/L		88	76 - 122	0	16
Naphthalene	ND		5000	5020		ug/L		100	66 - 125	2	20
n-Butylbenzene	ND		5000	5390		ug/L		108	71 - 128	1	15
N-Propylbenzene	ND		5000	5150		ug/L		103	75 - 127	1	15
o-Xylene	ND		5000	4450		ug/L		89	76 - 122	0	16
sec-Butylbenzene	ND		5000	5130		ug/L		103	74 - 127	0	15
Tetrachloroethene	3300		5000	7390		ug/L		81	74 - 122	1	20
Toluene	ND		5000	4690		ug/L		94	80 - 122	1	15
trans-1,2-Dichloroethene	ND		5000	4660		ug/L		93	73 - 127	1	20
trans-1,3-Dichloropropene	ND		5000	4990		ug/L		100	80 - 120	4	15
Trichloroethene	6800		5000	11100		ug/L		87	74 - 123	1	16
Trichlorofluoromethane	ND		5000	4720		ug/L		94	62 - 150	3	20
Vinyl acetate	ND		10000	8390		ug/L		84	50 - 144	2	23
Vinyl chloride	ND		5000	4720		ug/L		94	65 - 133	3	15
cis-1,3-Dichloropropene	ND		5000	4800		ug/L		96	74 - 124	1	15
Styrene	ND		5000	4490		ug/L		90	80 - 120	0	20
tert-Butylbenzene	ND		5000	5220		ug/L		104	75 - 123	3	15

Surrogate	*MSD %Recovery*	*MSD Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*107*		*77 - 120*
4-Bromofluorobenzene (Surr)	*86*		*73 - 120*
Toluene-d8 (Surr)	*105*		*80 - 120*
Dibromofluoromethane (Surr)	*99*		*75 - 123*

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: MB 480-771172/8
Matrix: Water
Analysis Batch: 771172

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			03/28/26 00:07	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			03/28/26 00:07	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			03/28/26 00:07	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			03/28/26 00:07	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			03/28/26 00:07	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			03/28/26 00:07	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			03/28/26 00:07	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			03/28/26 00:07	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			03/28/26 00:07	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			03/28/26 00:07	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			03/28/26 00:07	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			03/28/26 00:07	1
1,2-Dichlorobenzene	ND		1.0	0.79	ug/L			03/28/26 00:07	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			03/28/26 00:07	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			03/28/26 00:07	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			03/28/26 00:07	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			03/28/26 00:07	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			03/28/26 00:07	1
1,4-Dichlorobenzene	ND		1.0	0.84	ug/L			03/28/26 00:07	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			03/28/26 00:07	1
2-Butanone (MEK)	3.64	J	10	1.3	ug/L			03/28/26 00:07	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			03/28/26 00:07	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			03/28/26 00:07	1
2-Hexanone	ND		5.0	1.2	ug/L			03/28/26 00:07	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			03/28/26 00:07	1
p-Cymene	ND		1.0	0.31	ug/L			03/28/26 00:07	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			03/28/26 00:07	1
Acetone	ND		10	3.0	ug/L			03/28/26 00:07	1
Benzene	ND		1.0	0.41	ug/L			03/28/26 00:07	1
Bromobenzene	ND		1.0	0.80	ug/L			03/28/26 00:07	1
Bromoform	ND		1.0	0.26	ug/L			03/28/26 00:07	1
Bromomethane	ND		1.0	0.69	ug/L			03/28/26 00:07	1
Carbon disulfide	ND		1.0	0.19	ug/L			03/28/26 00:07	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			03/28/26 00:07	1
Chlorobenzene	ND		1.0	0.75	ug/L			03/28/26 00:07	1
Bromochloromethane	ND		1.0	0.87	ug/L			03/28/26 00:07	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			03/28/26 00:07	1
Chloroethane	ND		1.0	0.32	ug/L			03/28/26 00:07	1
Chloroform	ND		1.0	0.34	ug/L			03/28/26 00:07	1
Chloromethane	ND		1.0	0.35	ug/L			03/28/26 00:07	1
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			03/28/26 00:07	1
Bromodichloromethane	ND		1.0	0.39	ug/L			03/28/26 00:07	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			03/28/26 00:07	1
Ethylbenzene	ND		1.0	0.74	ug/L			03/28/26 00:07	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			03/28/26 00:07	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			03/28/26 00:07	1
Isopropylbenzene	ND		1.0	0.79	ug/L			03/28/26 00:07	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			03/28/26 00:07	1

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: MB 480-771172/8
Matrix: Water
Analysis Batch: 771172

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methylene Chloride	ND		1.0	0.44	ug/L			03/28/26 00:07	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			03/28/26 00:07	1
Naphthalene	ND		1.0	0.43	ug/L			03/28/26 00:07	1
n-Butylbenzene	ND		1.0	0.64	ug/L			03/28/26 00:07	1
N-Propylbenzene	ND		1.0	0.69	ug/L			03/28/26 00:07	1
o-Xylene	ND		1.0	0.76	ug/L			03/28/26 00:07	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			03/28/26 00:07	1
Tetrachloroethene	ND		1.0	0.36	ug/L			03/28/26 00:07	1
Toluene	ND		1.0	0.51	ug/L			03/28/26 00:07	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			03/28/26 00:07	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			03/28/26 00:07	1
Trichloroethene	ND		1.0	0.46	ug/L			03/28/26 00:07	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			03/28/26 00:07	1
Vinyl acetate	ND		5.0	0.85	ug/L			03/28/26 00:07	1
Vinyl chloride	ND		1.0	0.90	ug/L			03/28/26 00:07	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			03/28/26 00:07	1
Styrene	ND		1.0	0.73	ug/L			03/28/26 00:07	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			03/28/26 00:07	1

Surrogate	*MB %Recovery*	*MB Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*112*		*77 - 120*		*03/28/26 00:07*	*1*
4-Bromofluorobenzene (Surr)	*88*		*73 - 120*		*03/28/26 00:07*	*1*
Toluene-d8 (Surr)	*105*		*80 - 120*		*03/28/26 00:07*	*1*
Dibromofluoromethane (Surr)	*100*		*75 - 123*		*03/28/26 00:07*	*1*

Lab Sample ID: LCS 480-771172/6
Matrix: Water
Analysis Batch: 771172

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,1,1,2-Tetrachloroethane	25.0	22.7		ug/L		91	80 - 120
1,1,1-Trichloroethane	25.0	24.9		ug/L		100	73 - 126
1,1,2,2-Tetrachloroethane	25.0	25.5		ug/L		102	76 - 120
1,1,2-Trichloroethane	25.0	24.3		ug/L		97	76 - 122
1,1-Dichloroethane	25.0	23.4		ug/L		93	77 - 120
1,1-Dichloroethene	25.0	23.4		ug/L		93	66 - 127
1,1-Dichloropropene	25.0	23.2		ug/L		93	72 - 122
1,2,3-Trichlorobenzene	25.0	25.3		ug/L		101	75 - 123
1,2,3-Trichloropropane	25.0	26.2		ug/L		105	68 - 122
1,2,4-Trichlorobenzene	25.0	25.8		ug/L		103	79 - 122
1,2,4-Trimethylbenzene	25.0	25.9		ug/L		104	76 - 121
1,2-Dibromo-3-Chloropropane	25.0	28.5		ug/L		114	56 - 134
1,2-Dichlorobenzene	25.0	24.0		ug/L		96	80 - 124
1,2-Dichloroethane	25.0	24.9		ug/L		100	75 - 120
1,2-Dichloropropane	25.0	23.6		ug/L		94	76 - 120
1,3,5-Trimethylbenzene	25.0	24.8		ug/L		99	77 - 121
1,3-Dichlorobenzene	25.0	24.4		ug/L		97	77 - 120
1,3-Dichloropropane	25.0	24.4		ug/L		98	75 - 120

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: LCS 480-771172/6
Matrix: Water
Analysis Batch: 771172

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,4-Dichlorobenzene	25.0	24.6		ug/L		98	80 - 120
2,2-Dichloropropane	25.0	23.5		ug/L		94	63 - 136
2-Butanone (MEK)	125	129		ug/L		103	57 - 140
2-Chloroethyl vinyl ether	25.0	24.1		ug/L		97	70 - 129
o-Chlorotoluene	25.0	24.5		ug/L		98	76 - 121
2-Hexanone	125	131		ug/L		105	65 - 127
p-Chlorotoluene	25.0	24.9		ug/L		100	77 - 121
p-Cymene	25.0	25.6		ug/L		102	73 - 120
4-Methyl-2-pentanone (MIBK)	125	125		ug/L		100	71 - 125
Acetone	125	116		ug/L		93	56 - 142
Benzene	25.0	22.9		ug/L		92	71 - 124
Bromobenzene	25.0	24.4		ug/L		98	78 - 120
Bromoform	25.0	22.2		ug/L		89	61 - 132
Bromomethane	25.0	23.8		ug/L		95	55 - 144
Carbon disulfide	25.0	23.2		ug/L		93	59 - 134
Carbon tetrachloride	25.0	23.0		ug/L		92	72 - 134
Chlorobenzene	25.0	23.7		ug/L		95	80 - 120
Bromochloromethane	25.0	22.9		ug/L		91	72 - 130
Chlorodibromomethane	25.0	23.1		ug/L		92	75 - 125
Chloroethane	25.0	24.1		ug/L		96	69 - 136
Chloroform	25.0	23.3		ug/L		93	73 - 127
Chloromethane	25.0	22.1		ug/L		88	68 - 124
cis-1,2-Dichloroethene	25.0	23.1		ug/L		92	74 - 124
Bromodichloromethane	25.0	23.7		ug/L		95	80 - 122
Dichlorodifluoromethane	25.0	23.5		ug/L		94	59 - 135
Ethylbenzene	25.0	24.0		ug/L		96	77 - 123
1,2-Dibromoethane	25.0	24.2		ug/L		97	77 - 120
Hexachlorobutadiene	25.0	25.2		ug/L		101	68 - 131
Isopropylbenzene	25.0	25.3		ug/L		101	77 - 122
Methyl tert-butyl ether	25.0	23.6		ug/L		94	77 - 120
Methylene Chloride	25.0	23.5		ug/L		94	75 - 124
m-Xylene & p-Xylene	25.0	22.8		ug/L		91	76 - 122
Naphthalene	25.0	25.0		ug/L		100	66 - 125
n-Butylbenzene	25.0	27.1		ug/L		109	71 - 128
N-Propylbenzene	25.0	26.4		ug/L		106	75 - 127
o-Xylene	25.0	22.7		ug/L		91	76 - 122
sec-Butylbenzene	25.0	25.7		ug/L		103	74 - 127
Tetrachloroethene	25.0	22.7		ug/L		91	74 - 122
Toluene	25.0	24.3		ug/L		97	80 - 122
trans-1,2-Dichloroethene	25.0	22.8		ug/L		91	73 - 127
trans-1,3-Dichloropropene	25.0	24.9		ug/L		100	80 - 120
Trichloroethene	25.0	23.8		ug/L		95	74 - 123
Trichlorofluoromethane	25.0	23.5		ug/L		94	62 - 150
Vinyl acetate	50.0	47.9		ug/L		96	50 - 144
Vinyl chloride	25.0	23.0		ug/L		92	65 - 133
cis-1,3-Dichloropropene	25.0	24.0		ug/L		96	74 - 124
Styrene	25.0	23.4		ug/L		94	80 - 120
tert-Butylbenzene	25.0	26.5		ug/L		106	75 - 123

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: LCS 480-771172/6
Matrix: Water
Analysis Batch: 771172

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Surrogate	LCS %Recovery	LCS Qualifier	Limits
1,2-Dichloroethane-d4 (Surr)	*106*		*77 - 120*
4-Bromofluorobenzene (Surr)	*91*		*73 - 120*
Toluene-d8 (Surr)	*104*		*80 - 120*
Dibromofluoromethane (Surr)	*96*		*75 - 123*

Lab Sample ID: 480-237182-38 MS
Matrix: Water
Analysis Batch: 771172

Client Sample ID: OW-18A
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
1,1,1,2-Tetrachloroethane	ND		12500	11600		ug/L		93	80 - 120
1,1,1-Trichloroethane	ND		12500	13200		ug/L		105	73 - 126
1,1,2,2-Tetrachloroethane	ND		12500	12400		ug/L		99	76 - 120
1,1,2-Trichloroethane	ND		12500	12000		ug/L		96	76 - 122
1,1-Dichloroethane	ND		12500	12500		ug/L		100	77 - 120
1,1-Dichloroethene	ND		12500	12700		ug/L		102	66 - 127
1,1-Dichloropropene	ND		12500	12200		ug/L		97	72 - 122
1,2,3-Trichlorobenzene	ND		12500	12700		ug/L		101	75 - 123
1,2,3-Trichloropropane	ND		12500	12100		ug/L		97	68 - 122
1,2,4-Trichlorobenzene	ND		12500	12500		ug/L		100	79 - 122
1,2,4-Trimethylbenzene	ND		12500	12600		ug/L		101	76 - 121
1,2-Dibromo-3-Chloropropane	ND		12500	14300		ug/L		114	56 - 134
1,2-Dichlorobenzene	1700		12500	13900		ug/L		98	80 - 124
1,2-Dichloroethane	ND		12500	12900		ug/L		103	75 - 120
1,2-Dichloropropane	ND		12500	12400		ug/L		99	76 - 120
1,3,5-Trimethylbenzene	ND		12500	12600		ug/L		101	77 - 121
1,3-Dichlorobenzene	1400		12500	13700		ug/L		98	77 - 120
1,3-Dichloropropane	ND		12500	11900		ug/L		95	75 - 120
1,4-Dichlorobenzene	11000		12500	23400		ug/L		99	78 - 124
2,2-Dichloropropane	ND		12500	10700		ug/L		86	63 - 136
2-Butanone (MEK)	1800	J B	62500	64600		ug/L		100	57 - 140
2-Chloroethyl vinyl ether	ND		12500	12100		ug/L		97	70 - 129
o-Chlorotoluene	ND		12500	12500		ug/L		100	76 - 121
2-Hexanone	ND		62500	64800		ug/L		104	65 - 127
p-Chlorotoluene	ND		12500	12300		ug/L		98	77 - 121
p-Cymene	ND		12500	12600		ug/L		101	73 - 120
4-Methyl-2-pentanone (MIBK)	ND		62500	62300		ug/L		100	71 - 125
Acetone	ND		62500	60200		ug/L		96	56 - 142
Benzene	310	J	12500	12200		ug/L		95	71 - 124
Bromobenzene	ND		12500	12200		ug/L		98	78 - 120
Bromoform	ND		12500	11100		ug/L		89	61 - 132
Bromomethane	ND		12500	12800		ug/L		102	55 - 144
Carbon disulfide	ND		12500	12300		ug/L		98	59 - 134
Carbon tetrachloride	ND		12500	12200		ug/L		98	72 - 134
Chlorobenzene	11000		12500	23400		ug/L		100	80 - 120
Bromochloromethane	ND		12500	11800		ug/L		95	72 - 130
Chlorodibromomethane	ND		12500	11400		ug/L		91	75 - 125
Chloroethane	ND		12500	12900		ug/L		103	69 - 136

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: 480-237182-38 MS
Matrix: Water
Analysis Batch: 771172

Client Sample ID: OW-18A
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
Chloroform	ND		12500	12500		ug/L		100	73 - 127
Chloromethane	ND		12500	11700		ug/L		94	68 - 124
cis-1,2-Dichloroethene	ND		12500	12000		ug/L		96	74 - 124
Bromodichloromethane	ND		12500	12300		ug/L		99	80 - 122
Dichlorodifluoromethane	ND		12500	12200		ug/L		97	59 - 135
Ethylbenzene	ND		12500	12100		ug/L		97	77 - 123
1,2-Dibromoethane	ND		12500	11400		ug/L		91	77 - 120
Hexachlorobutadiene	ND		12500	12300		ug/L		99	68 - 131
Isopropylbenzene	ND		12500	12700		ug/L		102	77 - 122
Methyl tert-butyl ether	ND		12500	12100		ug/L		97	77 - 120
Methylene Chloride	ND		12500	12700		ug/L		101	75 - 124
m-Xylene & p-Xylene	ND		12500	11500		ug/L		92	76 - 122
Naphthalene	ND		12500	12500		ug/L		100	66 - 125
n-Butylbenzene	ND		12500	13600		ug/L		108	71 - 128
N-Propylbenzene	ND		12500	13200		ug/L		106	75 - 127
o-Xylene	ND		12500	11500		ug/L		92	76 - 122
sec-Butylbenzene	ND		12500	12900		ug/L		103	74 - 127
Tetrachloroethene	ND		12500	11300		ug/L		90	74 - 122
Toluene	ND		12500	12100		ug/L		97	80 - 122
trans-1,2-Dichloroethene	ND		12500	12200		ug/L		98	73 - 127
trans-1,3-Dichloropropene	ND		12500	11800		ug/L		95	80 - 120
Trichloroethene	ND		12500	12700		ug/L		101	74 - 123
Trichlorofluoromethane	ND		12500	12500		ug/L		100	62 - 150
Vinyl acetate	ND		25000	21900		ug/L		88	50 - 144
Vinyl chloride	ND		12500	12000		ug/L		96	65 - 133
cis-1,3-Dichloropropene	ND		12500	11700		ug/L		93	74 - 124
Styrene	ND		12500	11400		ug/L		91	80 - 120
tert-Butylbenzene	ND		12500	13200		ug/L		106	75 - 123

Surrogate	*MS %Recovery*	*MS Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*110*		*77 - 120*
4-Bromofluorobenzene (Surr)	*90*		*73 - 120*
Toluene-d8 (Surr)	*104*		*80 - 120*
Dibromofluoromethane (Surr)	*101*		*75 - 123*

Lab Sample ID: 480-237182-38 MSD
Matrix: Water
Analysis Batch: 771172

Client Sample ID: OW-18A
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
1,1,1,2-Tetrachloroethane	ND		12500	11700		ug/L		93	80 - 120	0	20
1,1,1-Trichloroethane	ND		12500	12600		ug/L		101	73 - 126	4	15
1,1,2,2-Tetrachloroethane	ND		12500	12700		ug/L		102	76 - 120	3	15
1,1,2-Trichloroethane	ND		12500	11900		ug/L		95	76 - 122	0	15
1,1-Dichloroethane	ND		12500	11800		ug/L		95	77 - 120	5	20
1,1-Dichloroethene	ND		12500	12100		ug/L		97	66 - 127	5	16
1,1-Dichloropropene	ND		12500	11800		ug/L		95	72 - 122	3	20
1,2,3-Trichlorobenzene	ND		12500	12700		ug/L		102	75 - 123	1	20

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: 480-237182-38 MSD
Matrix: Water
Analysis Batch: 771172

Client Sample ID: OW-18A
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
1,2,3-Trichloropropane	ND		12500	12900		ug/L		103	68 - 122	6	14
1,2,4-Trichlorobenzene	ND		12500	13000		ug/L		104	79 - 122	4	20
1,2,4-Trimethylbenzene	ND		12500	12900		ug/L		103	76 - 121	2	20
1,2-Dibromo-3-Chloropropane	ND		12500	14800		ug/L		118	56 - 134	3	15
1,2-Dichlorobenzene	1700		12500	14000		ug/L		99	80 - 124	1	20
1,2-Dichloroethane	ND		12500	12700		ug/L		102	75 - 120	1	20
1,2-Dichloropropane	ND		12500	12100		ug/L		97	76 - 120	3	20
1,3,5-Trimethylbenzene	ND		12500	12700		ug/L		102	77 - 121	1	20
1,3-Dichlorobenzene	1400		12500	13500		ug/L		97	77 - 120	1	20
1,3-Dichloropropane	ND		12500	12100		ug/L		97	75 - 120	1	20
1,4-Dichlorobenzene	11000		12500	23700		ug/L		101	78 - 124	1	20
2,2-Dichloropropane	ND		12500	10300		ug/L		83	63 - 136	4	20
2-Butanone (MEK)	1800	J B	62500	64700		ug/L		101	57 - 140	0	20
2-Chloroethyl vinyl ether	ND		12500	11500		ug/L		92	70 - 129	5	20
o-Chlorotoluene	ND		12500	12200		ug/L		98	76 - 121	2	20
2-Hexanone	ND		62500	67600		ug/L		108	65 - 127	4	15
p-Chlorotoluene	ND		12500	12500		ug/L		100	77 - 121	1	15
p-Cymene	ND		12500	12700		ug/L		101	73 - 120	0	20
4-Methyl-2-pentanone (MIBK)	ND		62500	64100		ug/L		103	71 - 125	3	35
Acetone	ND		62500	59600		ug/L		95	56 - 142	1	15
Benzene	310	J	12500	11700		ug/L		91	71 - 124	4	13
Bromobenzene	ND		12500	12200		ug/L		98	78 - 120	0	15
Bromoform	ND		12500	11200		ug/L		90	61 - 132	1	15
Bromomethane	ND		12500	12000		ug/L		96	55 - 144	6	15
Carbon disulfide	ND		12500	11800		ug/L		95	59 - 134	4	15
Carbon tetrachloride	ND		12500	12000		ug/L		96	72 - 134	2	15
Chlorobenzene	11000		12500	23300		ug/L		100	80 - 120	0	25
Bromochloromethane	ND		12500	11700		ug/L		94	72 - 130	1	15
Chlorodibromomethane	ND		12500	11700		ug/L		94	75 - 125	3	15
Chloroethane	ND		12500	12200		ug/L		97	69 - 136	6	15
Chloroform	ND		12500	11700		ug/L		94	73 - 127	6	20
Chloromethane	ND		12500	11100		ug/L		89	68 - 124	5	15
cis-1,2-Dichloroethene	ND		12500	11800		ug/L		94	74 - 124	1	15
Bromodichloromethane	ND		12500	12300		ug/L		98	80 - 122	0	15
Dichlorodifluoromethane	ND		12500	11800		ug/L		94	59 - 135	3	20
Ethylbenzene	ND		12500	12000		ug/L		96	77 - 123	1	15
1,2-Dibromoethane	ND		12500	12100		ug/L		97	77 - 120	6	15
Hexachlorobutadiene	ND		12500	12100		ug/L		97	68 - 131	2	20
Isopropylbenzene	ND		12500	12800		ug/L		102	77 - 122	0	20
Methyl tert-butyl ether	ND		12500	11800		ug/L		94	77 - 120	2	37
Methylene Chloride	ND		12500	12000		ug/L		96	75 - 124	6	15
m-Xylene & p-Xylene	ND		12500	11500		ug/L		92	76 - 122	0	16
Naphthalene	ND		12500	12700		ug/L		102	66 - 125	2	20
n-Butylbenzene	ND		12500	13400		ug/L		107	71 - 128	2	15
N-Propylbenzene	ND		12500	13000		ug/L		104	75 - 127	2	15
o-Xylene	ND		12500	11500		ug/L		92	76 - 122	0	16
sec-Butylbenzene	ND		12500	12800		ug/L		103	74 - 127	0	15
Tetrachloroethene	ND		12500	11100		ug/L		89	74 - 122	2	20
Toluene	ND		12500	12100		ug/L		96	80 - 122	1	15

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: 480-237182-38 MSD
Matrix: Water
Analysis Batch: 771172

Client Sample ID: OW-18A
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
trans-1,2-Dichloroethene	ND		12500	11500		ug/L		92	73 - 127	6	20
trans-1,3-Dichloropropene	ND		12500	12200		ug/L		97	80 - 120	3	15
Trichloroethene	ND		12500	11900		ug/L		95	74 - 123	6	16
Trichlorofluoromethane	ND		12500	11900		ug/L		95	62 - 150	5	20
Vinyl acetate	ND		25000	22200		ug/L		89	50 - 144	1	23
Vinyl chloride	ND		12500	11600		ug/L		93	65 - 133	3	15
cis-1,3-Dichloropropene	ND		12500	11600		ug/L		93	74 - 124	0	15
Styrene	ND		12500	11900		ug/L		95	80 - 120	4	20
tert-Butylbenzene	ND		12500	13300		ug/L		107	75 - 123	1	15

Surrogate	*MSD %Recovery*	*MSD Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*106*		*77 - 120*
4-Bromofluorobenzene (Surr)	*90*		*73 - 120*
Toluene-d8 (Surr)	*106*		*80 - 120*
Dibromofluoromethane (Surr)	*99*		*75 - 123*

Lab Sample ID: MB 480-771268/8
Matrix: Water
Analysis Batch: 771268

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		1.0	0.35	ug/L			03/30/26 13:20	1
1,1,1-Trichloroethane	ND		1.0	0.82	ug/L			03/30/26 13:20	1
1,1,2,2-Tetrachloroethane	ND		1.0	0.21	ug/L			03/30/26 13:20	1
1,1,2-Trichloroethane	ND		1.0	0.23	ug/L			03/30/26 13:20	1
1,1-Dichloroethane	ND		1.0	0.38	ug/L			03/30/26 13:20	1
1,1-Dichloroethene	ND		1.0	0.29	ug/L			03/30/26 13:20	1
1,1-Dichloropropene	ND		1.0	0.72	ug/L			03/30/26 13:20	1
1,2,3-Trichlorobenzene	ND		1.0	0.41	ug/L			03/30/26 13:20	1
1,2,3-Trichloropropane	ND		1.0	0.89	ug/L			03/30/26 13:20	1
1,2,4-Trichlorobenzene	ND		1.0	0.41	ug/L			03/30/26 13:20	1
1,2,4-Trimethylbenzene	ND		1.0	0.75	ug/L			03/30/26 13:20	1
1,2-Dibromo-3-Chloropropane	ND		1.0	0.39	ug/L			03/30/26 13:20	1
1,2-Dichlorobenzene	ND		1.0	0.79	ug/L			03/30/26 13:20	1
1,2-Dichloroethane	ND		1.0	0.21	ug/L			03/30/26 13:20	1
1,2-Dichloropropane	ND		1.0	0.72	ug/L			03/30/26 13:20	1
1,3,5-Trimethylbenzene	ND		1.0	0.77	ug/L			03/30/26 13:20	1
1,3-Dichlorobenzene	ND		1.0	0.78	ug/L			03/30/26 13:20	1
1,3-Dichloropropane	ND		1.0	0.75	ug/L			03/30/26 13:20	1
1,4-Dichlorobenzene	ND		1.0	0.84	ug/L			03/30/26 13:20	1
2,2-Dichloropropane	ND		1.0	0.40	ug/L			03/30/26 13:20	1
2-Butanone (MEK)	3.91	J	10	1.3	ug/L			03/30/26 13:20	1
2-Chloroethyl vinyl ether	ND		5.0	0.96	ug/L			03/30/26 13:20	1
o-Chlorotoluene	ND		1.0	0.86	ug/L			03/30/26 13:20	1
2-Hexanone	ND		5.0	1.2	ug/L			03/30/26 13:20	1
p-Chlorotoluene	ND		1.0	0.84	ug/L			03/30/26 13:20	1
p-Cymene	ND		1.0	0.31	ug/L			03/30/26 13:20	1
4-Methyl-2-pentanone (MIBK)	ND		5.0	2.1	ug/L			03/30/26 13:20	1

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: MB 480-771268/8
Matrix: Water
Analysis Batch: 771268

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Acetone	ND		10	3.0	ug/L			03/30/26 13:20	1
Benzene	ND		1.0	0.41	ug/L			03/30/26 13:20	1
Bromobenzene	ND		1.0	0.80	ug/L			03/30/26 13:20	1
Bromoform	ND		1.0	0.26	ug/L			03/30/26 13:20	1
Bromomethane	ND		1.0	0.69	ug/L			03/30/26 13:20	1
Carbon disulfide	ND		1.0	0.19	ug/L			03/30/26 13:20	1
Carbon tetrachloride	ND		1.0	0.27	ug/L			03/30/26 13:20	1
Chlorobenzene	ND		1.0	0.75	ug/L			03/30/26 13:20	1
Bromochloromethane	ND		1.0	0.87	ug/L			03/30/26 13:20	1
Chlorodibromomethane	ND		1.0	0.32	ug/L			03/30/26 13:20	1
Chloroethane	ND		1.0	0.32	ug/L			03/30/26 13:20	1
Chloroform	ND		1.0	0.34	ug/L			03/30/26 13:20	1
Chloromethane	ND		1.0	0.35	ug/L			03/30/26 13:20	1
cis-1,2-Dichloroethene	ND		1.0	0.81	ug/L			03/30/26 13:20	1
Bromodichloromethane	ND		1.0	0.39	ug/L			03/30/26 13:20	1
Dichlorodifluoromethane	ND		1.0	0.68	ug/L			03/30/26 13:20	1
Ethylbenzene	ND		1.0	0.74	ug/L			03/30/26 13:20	1
1,2-Dibromoethane	ND		1.0	0.73	ug/L			03/30/26 13:20	1
Hexachlorobutadiene	ND		2.0	0.28	ug/L			03/30/26 13:20	1
Isopropylbenzene	ND		1.0	0.79	ug/L			03/30/26 13:20	1
Methyl tert-butyl ether	ND		1.0	0.16	ug/L			03/30/26 13:20	1
Methylene Chloride	ND		1.0	0.44	ug/L			03/30/26 13:20	1
m-Xylene & p-Xylene	ND		2.0	0.66	ug/L			03/30/26 13:20	1
Naphthalene	ND		1.0	0.43	ug/L			03/30/26 13:20	1
n-Butylbenzene	ND		1.0	0.64	ug/L			03/30/26 13:20	1
N-Propylbenzene	ND		1.0	0.69	ug/L			03/30/26 13:20	1
o-Xylene	ND		1.0	0.76	ug/L			03/30/26 13:20	1
sec-Butylbenzene	ND		1.0	0.75	ug/L			03/30/26 13:20	1
Tetrachloroethene	ND		1.0	0.36	ug/L			03/30/26 13:20	1
Toluene	ND		1.0	0.51	ug/L			03/30/26 13:20	1
trans-1,2-Dichloroethene	ND		1.0	0.90	ug/L			03/30/26 13:20	1
trans-1,3-Dichloropropene	ND		1.0	0.37	ug/L			03/30/26 13:20	1
Trichloroethene	ND		1.0	0.46	ug/L			03/30/26 13:20	1
Trichlorofluoromethane	ND		1.0	0.88	ug/L			03/30/26 13:20	1
Vinyl acetate	ND		5.0	0.85	ug/L			03/30/26 13:20	1
Vinyl chloride	ND		1.0	0.90	ug/L			03/30/26 13:20	1
cis-1,3-Dichloropropene	ND		1.0	0.36	ug/L			03/30/26 13:20	1
Styrene	ND		1.0	0.73	ug/L			03/30/26 13:20	1
tert-Butylbenzene	ND		1.0	0.81	ug/L			03/30/26 13:20	1

Surrogate	*MB %Recovery*	*MB Qualifier*	*Limits*	*Prepared*	*Analyzed*	*Dil Fac*
1,2-Dichloroethane-d4 (Surr)	*106*		*77 - 120*		*03/30/26 13:20*	*1*
4-Bromofluorobenzene (Surr)	*89*		*73 - 120*		*03/30/26 13:20*	*1*
Toluene-d8 (Surr)	*104*		*80 - 120*		*03/30/26 13:20*	*1*
Dibromofluoromethane (Surr)	*100*		*75 - 123*		*03/30/26 13:20*	*1*

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: LCS 480-771268/6
Matrix: Water
Analysis Batch: 771268

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
1,1,1,2-Tetrachloroethane	25.0	23.5		ug/L		94	80 - 120
1,1,1-Trichloroethane	25.0	25.6		ug/L		103	73 - 126
1,1,2,2-Tetrachloroethane	25.0	25.1		ug/L		101	76 - 120
1,1,2-Trichloroethane	25.0	23.8		ug/L		95	76 - 122
1,1-Dichloroethane	25.0	23.7		ug/L		95	77 - 120
1,1-Dichloroethene	25.0	24.1		ug/L		96	66 - 127
1,1-Dichloropropene	25.0	24.0		ug/L		96	72 - 122
1,2,3-Trichlorobenzene	25.0	24.9		ug/L		100	75 - 123
1,2,3-Trichloropropane	25.0	25.4		ug/L		102	68 - 122
1,2,4-Trichlorobenzene	25.0	25.3		ug/L		101	79 - 122
1,2,4-Trimethylbenzene	25.0	25.1		ug/L		100	76 - 121
1,2-Dibromo-3-Chloropropane	25.0	28.6		ug/L		115	56 - 134
1,2-Dichlorobenzene	25.0	23.7		ug/L		95	80 - 124
1,2-Dichloroethane	25.0	25.3		ug/L		101	75 - 120
1,2-Dichloropropane	25.0	24.4		ug/L		98	76 - 120
1,3,5-Trimethylbenzene	25.0	24.6		ug/L		98	77 - 121
1,3-Dichlorobenzene	25.0	24.3		ug/L		97	77 - 120
1,3-Dichloropropane	25.0	24.0		ug/L		96	75 - 120
1,4-Dichlorobenzene	25.0	23.6		ug/L		95	80 - 120
2,2-Dichloropropane	25.0	28.3		ug/L		113	63 - 136
2-Butanone (MEK)	125	131		ug/L		105	57 - 140
2-Chloroethyl vinyl ether	25.0	23.6		ug/L		94	70 - 129
o-Chlorotoluene	25.0	24.3		ug/L		97	76 - 121
2-Hexanone	125	129		ug/L		103	65 - 127
p-Chlorotoluene	25.0	24.0		ug/L		96	77 - 121
p-Cymene	25.0	24.8		ug/L		99	73 - 120
4-Methyl-2-pentanone (MIBK)	125	124		ug/L		100	71 - 125
Acetone	125	116		ug/L		93	56 - 142
Benzene	25.0	23.5		ug/L		94	71 - 124
Bromobenzene	25.0	24.0		ug/L		96	78 - 120
Bromoform	25.0	23.8		ug/L		95	61 - 132
Bromomethane	25.0	24.6		ug/L		98	55 - 144
Carbon disulfide	25.0	23.6		ug/L		94	59 - 134
Carbon tetrachloride	25.0	24.2		ug/L		97	72 - 134
Chlorobenzene	25.0	23.9		ug/L		96	80 - 120
Bromochloromethane	25.0	23.3		ug/L		93	72 - 130
Chlorodibromomethane	25.0	24.1		ug/L		97	75 - 125
Chloroethane	25.0	24.7		ug/L		99	69 - 136
Chloroform	25.0	24.1		ug/L		96	73 - 127
Chloromethane	25.0	23.5		ug/L		94	68 - 124
cis-1,2-Dichloroethene	25.0	23.7		ug/L		95	74 - 124
Bromodichloromethane	25.0	25.4		ug/L		102	80 - 122
Dichlorodifluoromethane	25.0	23.2		ug/L		93	59 - 135
Ethylbenzene	25.0	23.8		ug/L		95	77 - 123
1,2-Dibromoethane	25.0	24.5		ug/L		98	77 - 120
Hexachlorobutadiene	25.0	23.9		ug/L		96	68 - 131
Isopropylbenzene	25.0	24.6		ug/L		99	77 - 122
Methyl tert-butyl ether	25.0	24.3		ug/L		97	77 - 120

Method: EPA 8260D - Volatile Organic Compounds by GC/MS (Continued)

Lab Sample ID: LCS 480-771268/6
Matrix: Water
Analysis Batch: 771268

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Methylene Chloride	25.0	24.1		ug/L		97	75 - 124
m-Xylene & p-Xylene	25.0	23.0		ug/L		92	76 - 122
Naphthalene	25.0	24.5		ug/L		98	66 - 125
n-Butylbenzene	25.0	26.3		ug/L		105	71 - 128
N-Propylbenzene	25.0	25.4		ug/L		102	75 - 127
o-Xylene	25.0	22.5		ug/L		90	76 - 122
sec-Butylbenzene	25.0	25.0		ug/L		100	74 - 127
Tetrachloroethene	25.0	22.7		ug/L		91	74 - 122
Toluene	25.0	23.8		ug/L		95	80 - 122
trans-1,2-Dichloroethene	25.0	23.7		ug/L		95	73 - 127
trans-1,3-Dichloropropene	25.0	26.1		ug/L		104	80 - 120
Trichloroethene	25.0	24.1		ug/L		97	74 - 123
Trichlorofluoromethane	25.0	24.2		ug/L		97	62 - 150
Vinyl acetate	50.0	50.6		ug/L		101	50 - 144
Vinyl chloride	25.0	23.5		ug/L		94	65 - 133
cis-1,3-Dichloropropene	25.0	25.4		ug/L		102	74 - 124
Styrene	25.0	22.7		ug/L		91	80 - 120
tert-Butylbenzene	25.0	25.7		ug/L		103	75 - 123

Surrogate	*LCS %Recovery*	*LCS Qualifier*	*Limits*
1,2-Dichloroethane-d4 (Surr)	*106*		*77 - 120*
4-Bromofluorobenzene (Surr)	*92*		*73 - 120*
Toluene-d8 (Surr)	*108*		*80 - 120*
Dibromofluoromethane (Surr)	*101*		*75 - 123*

GC/MS VOA

Analysis Batch: 771020

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-237182-1	OW-26B	Total/NA	Water	EPA 8260D	
480-237182-2	OW-30B	Total/NA	Water	EPA 8260D	
480-237182-3	MW-5A	Total/NA	Water	EPA 8260D	
480-237182-4	MW-5C	Total/NA	Water	EPA 8260D	
480-237182-5	MW-5CD	Total/NA	Water	EPA 8260D	
480-237182-7	OW-12B	Total/NA	Water	EPA 8260D	
480-237182-8	OW-9A	Total/NA	Water	EPA 8260D	
480-237182-10	OW-16A	Total/NA	Water	EPA 8260D	
480-237182-11	OW-13B	Total/NA	Water	EPA 8260D	
MB 480-771020/8	Method Blank	Total/NA	Water	EPA 8260D	
LCS 480-771020/6	Lab Control Sample	Total/NA	Water	EPA 8260D	

Analysis Batch: 771067

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-237182-12	OW-113B	Total/NA	Water	EPA 8260D	
480-237182-13	OW-29B	Total/NA	Water	EPA 8260D	
480-237182-14	OW-15A	Total/NA	Water	EPA 8260D	
480-237182-15	OW-28B	Total/NA	Water	EPA 8260D	
480-237182-16	MW-4B	Total/NA	Water	EPA 8260D	
480-237182-17	MW-4C	Total/NA	Water	EPA 8260D	
480-237182-18	OW-5B	Total/NA	Water	EPA 8260D	
480-237182-19	OW-105B	Total/NA	Water	EPA 8260D	
480-237182-20	OW-6B	Total/NA	Water	EPA 8260D	
480-237182-22	OW-8B	Total/NA	Water	EPA 8260D	
480-237182-23	MW-6B	Total/NA	Water	EPA 8260D	
480-237182-24	MW-6F	Total/NA	Water	EPA 8260D	
480-237182-26	OW-22A	Total/NA	Water	EPA 8260D	
480-237182-29	TB01	Total/NA	Water	EPA 8260D	
480-237182-30	TB02	Total/NA	Water	EPA 8260D	
MB 480-771067/8	Method Blank	Total/NA	Water	EPA 8260D	
LCS 480-771067/6	Lab Control Sample	Total/NA	Water	EPA 8260D	
480-237182-17 MS	MW-4C	Total/NA	Water	EPA 8260D	
480-237182-17 MSD	MW-4C	Total/NA	Water	EPA 8260D	

Analysis Batch: 771146

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-237182-6	MW-5F	Total/NA	Water	EPA 8260D	
480-237182-9	OW-27B	Total/NA	Water	EPA 8260D	
480-237182-21	OW-7B	Total/NA	Water	EPA 8260D	
480-237182-25	OW-14B	Total/NA	Water	EPA 8260D	
480-237182-27	OW-22B	Total/NA	Water	EPA 8260D	
480-237182-28	OW-15B	Total/NA	Water	EPA 8260D	
480-237182-31	MW-1B	Total/NA	Water	EPA 8260D	
480-237182-32	MW-1C	Total/NA	Water	EPA 8260D	
480-237182-33	MW-1CD	Total/NA	Water	EPA 8260D	
480-237182-35	OW-12A	Total/NA	Water	EPA 8260D	
480-237182-37	MW-2A	Total/NA	Water	EPA 8260D	
MB 480-771146/8	Method Blank	Total/NA	Water	EPA 8260D	
LCS 480-771146/6	Lab Control Sample	Total/NA	Water	EPA 8260D	
480-237182-27 MS	OW-22B	Total/NA	Water	EPA 8260D	
480-237182-27 MSD	OW-22B	Total/NA	Water	EPA 8260D	

QC Association Summary

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

GC/MS VOA

Analysis Batch: 771172

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-237182-38	OW-18A	Total/NA	Water	EPA 8260D	
MB 480-771172/8	Method Blank	Total/NA	Water	EPA 8260D	
LCS 480-771172/6	Lab Control Sample	Total/NA	Water	EPA 8260D	
480-237182-38 MS	OW-18A	Total/NA	Water	EPA 8260D	
480-237182-38 MSD	OW-18A	Total/NA	Water	EPA 8260D	

Analysis Batch: 771268

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-237182-34	MW-1F	Total/NA	Water	EPA 8260D	
480-237182-36	OW-10B	Total/NA	Water	EPA 8260D	
480-237182-39	OW-11B	Total/NA	Water	EPA 8260D	
480-237182-40	OW-111B	Total/NA	Water	EPA 8260D	
MB 480-771268/8	Method Blank	Total/NA	Water	EPA 8260D	
LCS 480-771268/6	Lab Control Sample	Total/NA	Water	EPA 8260D	

Lab Chronicle

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-26B
Lab Sample ID: 480-237182-1
Date Collected: 03/24/26 10:00
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		2	771020	ATG	EET BUF	03/26/26 17:22

Client Sample ID: OW-30B
Lab Sample ID: 480-237182-2
Date Collected: 03/24/26 10:20
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		1	771020	ATG	EET BUF	03/26/26 17:45

Client Sample ID: MW-5A
Lab Sample ID: 480-237182-3
Date Collected: 03/24/26 10:35
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		1	771020	ATG	EET BUF	03/26/26 18:08

Client Sample ID: MW-5C
Lab Sample ID: 480-237182-4
Date Collected: 03/24/26 10:40
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		40	771020	ATG	EET BUF	03/26/26 18:32

Client Sample ID: MW-5CD
Lab Sample ID: 480-237182-5
Date Collected: 03/24/26 10:45
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		10	771020	ATG	EET BUF	03/26/26 18:54

Client Sample ID: MW-5F
Lab Sample ID: 480-237182-6
Date Collected: 03/24/26 10:55
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		125	771146	LCH	EET BUF	03/27/26 15:39

Client Sample ID: OW-12B
Lab Sample ID: 480-237182-7
Date Collected: 03/24/26 11:30
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		40	771020	ATG	EET BUF	03/26/26 19:41

Lab Chronicle

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-9A
Lab Sample ID: 480-237182-8
Date Collected: 03/24/26 11:40
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		200	771020	ATG	EET BUF	03/26/26 20:04

Client Sample ID: OW-27B
Lab Sample ID: 480-237182-9
Date Collected: 03/24/26 11:50
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		5	771146	LCH	EET BUF	03/27/26 16:02

Client Sample ID: OW-16A
Lab Sample ID: 480-237182-10
Date Collected: 03/24/26 11:55
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		1	771020	ATG	EET BUF	03/26/26 20:50

Client Sample ID: OW-13B
Lab Sample ID: 480-237182-11
Date Collected: 03/24/26 14:15
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		200	771020	ATG	EET BUF	03/26/26 21:13

Client Sample ID: OW-113B
Lab Sample ID: 480-237182-12
Date Collected: 03/24/26 15:15
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		200	771067	ATG	EET BUF	03/27/26 01:50

Client Sample ID: OW-29B
Lab Sample ID: 480-237182-13
Date Collected: 03/24/26 13:15
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		125	771067	ATG	EET BUF	03/27/26 02:13

Client Sample ID: OW-15A
Lab Sample ID: 480-237182-14
Date Collected: 03/24/26 13:25
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		1	771067	ATG	EET BUF	03/27/26 02:36

Lab Chronicle

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-28B
Lab Sample ID: 480-237182-15
Date Collected: 03/24/26 13:35
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		125	771067	ATG	EET BUF	03/27/26 02:59

Client Sample ID: MW-4B
Lab Sample ID: 480-237182-16
Date Collected: 03/24/26 14:30
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		80	771067	ATG	EET BUF	03/27/26 03:22

Client Sample ID: MW-4C
Lab Sample ID: 480-237182-17
Date Collected: 03/24/26 13:45
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		400	771067	ATG	EET BUF	03/27/26 03:46

Client Sample ID: OW-5B
Lab Sample ID: 480-237182-18
Date Collected: 03/25/26 10:30
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		100	771067	ATG	EET BUF	03/27/26 04:09

Client Sample ID: OW-105B
Lab Sample ID: 480-237182-19
Date Collected: 03/25/26 11:30
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		100	771067	ATG	EET BUF	03/27/26 04:33

Client Sample ID: OW-6B
Lab Sample ID: 480-237182-20
Date Collected: 03/25/26 08:40
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		80	771067	ATG	EET BUF	03/27/26 04:56

Client Sample ID: OW-7B
Lab Sample ID: 480-237182-21
Date Collected: 03/25/26 08:50
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		4	771146	LCH	EET BUF	03/27/26 16:25

Lab Chronicle

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-8B
Lab Sample ID: 480-237182-22
Date Collected: 03/25/26 09:00
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		1	771067	ATG	EET BUF	03/27/26 05:43

Client Sample ID: MW-6B
Lab Sample ID: 480-237182-23
Date Collected: 03/25/26 11:44
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		80	771067	ATG	EET BUF	03/27/26 06:06

Client Sample ID: MW-6F
Lab Sample ID: 480-237182-24
Date Collected: 03/25/26 12:00
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		10	771067	ATG	EET BUF	03/27/26 06:29

Client Sample ID: OW-14B
Lab Sample ID: 480-237182-25
Date Collected: 03/25/26 09:30
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		40	771146	LCH	EET BUF	03/27/26 16:48

Client Sample ID: OW-22A
Lab Sample ID: 480-237182-26
Date Collected: 03/25/26 10:00
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		1	771067	ATG	EET BUF	03/27/26 07:15

Client Sample ID: OW-22B
Lab Sample ID: 480-237182-27
Date Collected: 03/25/26 10:10
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		200	771146	LCH	EET BUF	03/27/26 17:11

Client Sample ID: OW-15B
Lab Sample ID: 480-237182-28
Date Collected: 03/25/26 09:40
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		50	771146	LCH	EET BUF	03/27/26 17:34

Lab Chronicle

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: TB01
Lab Sample ID: 480-237182-29
Date Collected: 03/24/26 08:00
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		1	771067	ATG	EET BUF	03/27/26 08:01

Client Sample ID: TB02
Lab Sample ID: 480-237182-30
Date Collected: 03/25/26 08:00
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		1	771067	ATG	EET BUF	03/27/26 08:24

Client Sample ID: MW-1B
Lab Sample ID: 480-237182-31
Date Collected: 03/24/26 14:55
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		400	771146	LCH	EET BUF	03/27/26 17:57

Client Sample ID: MW-1C
Lab Sample ID: 480-237182-32
Date Collected: 03/24/26 15:00
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		50	771146	LCH	EET BUF	03/27/26 18:20

Client Sample ID: MW-1CD
Lab Sample ID: 480-237182-33
Date Collected: 03/24/26 15:05
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		800	771146	LCH	EET BUF	03/27/26 18:44

Client Sample ID: MW-1F
Lab Sample ID: 480-237182-34
Date Collected: 03/25/26 11:35
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		2	771268	LCH	EET BUF	03/30/26 14:07

Client Sample ID: OW-12A
Lab Sample ID: 480-237182-35
Date Collected: 03/24/26 15:20
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		100	771146	LCH	EET BUF	03/27/26 19:30

Lab Chronicle

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Client Sample ID: OW-10B
Lab Sample ID: 480-237182-36
Date Collected: 03/24/26 15:30
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		8	771268	LCH	EET BUF	03/30/26 14:30

Client Sample ID: MW-2A
Lab Sample ID: 480-237182-37
Date Collected: 03/24/26 15:44
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		200	771146	LCH	EET BUF	03/27/26 20:17

Client Sample ID: OW-18A
Lab Sample ID: 480-237182-38
Date Collected: 03/25/26 12:10
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		500	771172	LCH	EET BUF	03/28/26 00:53

Client Sample ID: OW-11B
Lab Sample ID: 480-237182-39
Date Collected: 03/25/26 13:25
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		200	771268	LCH	EET BUF	03/30/26 14:53

Client Sample ID: OW-111B
Lab Sample ID: 480-237182-40
Date Collected: 03/25/26 14:25
Matrix: Water
Date Received: 03/26/26 15:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	EPA 8260D		200	771268	LCH	EET BUF	03/30/26 15:16

Laboratory References:

EET BUF = Eurofins Buffalo, 10 Hazelwood Drive, Amherst, NY 14228-2298, TEL (716)691-2600

Accreditation/Certification Summary

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Laboratory: Eurofins Buffalo

The accreditations/certifications listed below are applicable to this report.

Authority	Program	Identification Number	Expiration Date
New York	NELAP	10026	03-31-26

Method Summary

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Method	Method Description	Protocol	Laboratory
EPA 8260D	Volatile Organic Compounds by GC/MS	SW846	EET BUF
5030C	Purge and Trap	SW846	EET BUF

Protocol References:

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

Laboratory References:

EET BUF = Eurofins Buffalo, 10 Hazelwood Drive, Amherst, NY 14228-2298, TEL (716)691-2600

Sample Summary

Client: TRC Environmental Corporation
Job ID: 480-237182-1
Project/Site: Solvent Chemical Semi-annual Monitoring

Lab Sample ID	Client Sample ID	Matrix	Collected	Received	Sample Origin
480-237182-1	OW-26B	Water	03/24/26 10:00	03/26/26 15:25	New York
480-237182-2	OW-30B	Water	03/24/26 10:20	03/26/26 15:25	New York
480-237182-3	MW-5A	Water	03/24/26 10:35	03/26/26 15:25	New York
480-237182-4	MW-5C	Water	03/24/26 10:40	03/26/26 15:25	New York
480-237182-5	MW-5CD	Water	03/24/26 10:45	03/26/26 15:25	New York
480-237182-6	MW-5F	Water	03/24/26 10:55	03/26/26 15:25	New York
480-237182-7	OW-12B	Water	03/24/26 11:30	03/26/26 15:25	New York
480-237182-8	OW-9A	Water	03/24/26 11:40	03/26/26 15:25	New York
480-237182-9	OW-27B	Water	03/24/26 11:50	03/26/26 15:25	New York
480-237182-10	OW-16A	Water	03/24/26 11:55	03/26/26 15:25	New York
480-237182-11	OW-13B	Water	03/24/26 14:15	03/26/26 15:25	New York
480-237182-12	OW-113B	Water	03/24/26 15:15	03/26/26 15:25	New York
480-237182-13	OW-29B	Water	03/24/26 13:15	03/26/26 15:25	New York
480-237182-14	OW-15A	Water	03/24/26 13:25	03/26/26 15:25	New York
480-237182-15	OW-28B	Water	03/24/26 13:35	03/26/26 15:25	New York
480-237182-16	MW-4B	Water	03/24/26 14:30	03/26/26 15:25	New York
480-237182-17	MW-4C	Water	03/24/26 13:45	03/26/26 15:25	New York
480-237182-18	OW-5B	Water	03/25/26 10:30	03/26/26 15:25	New York
480-237182-19	OW-105B	Water	03/25/26 11:30	03/26/26 15:25	New York
480-237182-20	OW-6B	Water	03/25/26 08:40	03/26/26 15:25	New York
480-237182-21	OW-7B	Water	03/25/26 08:50	03/26/26 15:25	New York
480-237182-22	OW-8B	Water	03/25/26 09:00	03/26/26 15:25	New York
480-237182-23	MW-6B	Water	03/25/26 11:44	03/26/26 15:25	New York
480-237182-24	MW-6F	Water	03/25/26 12:00	03/26/26 15:25	New York
480-237182-25	OW-14B	Water	03/25/26 09:30	03/26/26 15:25	New York
480-237182-26	OW-22A	Water	03/25/26 10:00	03/26/26 15:25	New York
480-237182-27	OW-22B	Water	03/25/26 10:10	03/26/26 15:25	New York
480-237182-28	OW-15B	Water	03/25/26 09:40	03/26/26 15:25	New York
480-237182-29	TB01	Water	03/24/26 08:00	03/26/26 15:25	New York
480-237182-30	TB02	Water	03/25/26 08:00	03/26/26 15:25	New York
480-237182-31	MW-1B	Water	03/24/26 14:55	03/26/26 15:25	New York
480-237182-32	MW-1C	Water	03/24/26 15:00	03/26/26 15:25	New York
480-237182-33	MW-1CD	Water	03/24/26 15:05	03/26/26 15:25	New York
480-237182-34	MW-1F	Water	03/25/26 11:35	03/26/26 15:25	New York
480-237182-35	OW-12A	Water	03/24/26 15:20	03/26/26 15:25	New York
480-237182-36	OW-10B	Water	03/24/26 15:30	03/26/26 15:25	New York
480-237182-37	MW-2A	Water	03/24/26 15:44	03/26/26 15:25	New York
480-237182-38	OW-18A	Water	03/25/26 12:10	03/26/26 15:25	New York
480-237182-39	OW-11B	Water	03/25/26 13:25	03/26/26 15:25	New York
480-237182-40	OW-111B	Water	03/25/26 14:25	03/26/26 15:25	New York

Amherst, NY 14228-2298
Phone: 716-691-2600 Fax: 716-691-7991

Chain of Custody Record

(3/24/26) 0.7 (3/25/26) 0.6

eurofins | Environment Testing

Client Information	Sampler: C. Rudzinski	Lab PM: Boyina, Kavya	Carrier Tracking No(s): Hand Deliver	COC No: 480-211497-25500.1
Client Contact: Mr. Nathan Sarapas	Phone: 978 758 4902	E-Mail: kavya.boyina@et.eurofinsus.com	State of Origin: NY	Page: Page 1 of 4 3/25/26
Company: TRC Companies, Inc	PWSID:			Job #:
Address: 650 Suffolk Street	Due Date Requested: Standard			
City: Lowell	TAT Requested (days): Standard			
State, Zip: MA, 01854	Compliance Project: Δ Yes Δ No			
Phone:	PO #: 233658			
Email: nsarapas@trccompanies.com	WO #:			
Project Name: Solvent Chemical Semi-annual Monitoring	Project #: 48002700			
Site:	SSOW#:			

Analysis Requested

Preservation Codes: N - None

480-237182 Chain of Custody

Sample Identification	Sample Date	Sample Time	Sample Type (C=comp, G=grab)	Matrix (W=water, S=solid, O=waste/oil, BT=Tissue, A=Air, DW=Drinking Water)	Field Filtered Sample (Yes or No)	Perform MS/MSD (Yes or No)	8260D - Volatiles	Total Number of	Special Instructions/Note:
			Preservation Code:				N		
OW-26B	3/24/26	1000	G	Water	N	N	X	3	Samples shipped "On Ice"
OW-30B	3/24/26	1020	G	Water	N	N	X	3	
MW-5A	3/24/26	1035	G	Water	N	N	X	2	Please shoot temp
MW-5C	3/24/26	1040	G	Water	N	N	X	3	blank upon arrival.
MW-5CD	3/24/26	1045	G	Water	N	N	X	3	Temp Blank in
MW-5F	3/24/26	1055	G	Water	N	N	X	3	each cooler.
OW-12B	3/24/26	1130	G	Water	N	N	X	3	
OW-9A	3/24/26	1140	G	Water	N	N	X	3	
OW-27B	3/24/26	1150	G	Water	N	N	X	3	
OW-16A	3/24/26	1155	G	Water	N	N	X	3	
OW-13B	3/24/26	1415	G	Water	N	N	X	3	

Possible Hazard Identification
☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☒ Unknown ☐ Radiological

Sample Disposal (A fee may be assessed if samples are retained longer than 1 month)
☐ Return To Client ☒ Disposal By Lab ☐ Archive For ____ Months

Deliverable Requested: I, II, III, IV, Other (specify)

Special Instructions/QC Requirements:

Empty Kit Relinquished by:	Date:	Time:	Method of Shipment:

	Date/Time	Company	Received by	Date/Time	Company
Relinquished by:	3/25/26 1525	TRC		3-25-26 1525	ETB
Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company
Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company

Custody Seals Intact: Δ Yes Δ No | Custody Seal No.:

Cooler Temperature(s) °C and Other Remarks: 0.7 0.5 ICE

Ver: 10/10/2024

Amherst, NY 14228-2298
Phone: 716-691-2600 Fax: 716-691-7991

Chain of Custody Record

eurofins | Environment Testing

Client Information	Sampler: C. Rudzinski	Lab PM: Boyina, Kavya	Carrier Tracking No(s): Hand Deliver	COC No: 480-211497-25500.2
Client Contact: Mr. Nathan Sarapas	Phone: 978-758-4902	E-Mail: kavya.boyina@et.eurofinsus.com	State of Origin: NY	Page: Page 2 of 4 3/25/26
Company: TRC Companies, Inc	PWSID:			Job #:
Address: 650 Suffolk Street	Due Date Requested: Standard			
City: Lowell	TAT Requested (days): Standard			
State, Zip: MA, 01854	Compliance Project: Δ Yes Δ No			
Phone:	PO #: 233658			
Email: nsarapas@trccompanies.com	WO #:			
Project Name: Solvent Chemical Semi-annual Monitoring	Project #: 48002700			
Site:	SSOW#:			

Analysis Requested

Preservation Codes: N - None

Other:

Sample Identification	Sample Date	Sample Time	Sample Type (C=comp, G=grab)	Matrix (W=water, S=solid, O=waste/oil, BT=Tissue, A=Air, DW=Drinking Water)	Field Filtered Sample (Yes or No)	Perform MS/MSD (Yes or No)	8260D - Volatiles	Total Number of containers	Special Instructions/Note:
			Preservation Code:				N		
OW-113B	3/24/26	1515	G	Water	N	N	X	3	
OW-29B	3/24/26	1315	G	Water	N	N	X	3	
OW-15A	3/24/26	1325	G	Water	N	N	X	3	
OW-28B	3/24/26	1335	G	Water	N	N	X	3	
MW-4B	3/24/26	1430	G	Water	N	N	X	3	
MW-4C	3/24/26	1345	G	Water	N	Y	X	9	MS/MSD
OW-5B	3/25/26	1030	G	Water	N	N	X	3	
OW-105B	3/25/26	1130	G	Water	N	N	X	2	
OW-6B	3/25/26	0840	G	Water	N	N	X	3	
OW-7B	3/25/26	0850	G	Water	N	N	X	2	
OW-8B	3/25/26	0900	G	Water	N	N	X	3	

Possible Hazard Identification
☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☒ Unknown ☐ Radiological

Deliverable Requested: I, II, III, IV, Other (specify)

Sample Disposal (A fee may be assessed if samples are retained longer than 1 month)
☐ Return To Client ☒ Disposal By Lab ☐ Archive For _____ Months

Special Instructions/QC Requirements:

Empty Kit Relinquished by:	Date:	Time:	Method of Shipment:
Relinquished by:	Date/Time: 3/25/26 1525	Company: TRC	Received by:	Date/Time: 3-25-26 1525	Company: ETR
Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company
Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company

Custody Seals Intact: Δ Yes Δ No | Custody Seal No.:

Cooler Temperature(s) °C and Other Remarks:

Ver: 10/10/2024

Client Information	Sampler: C. Rudzinski	Lab PM: Boyina, Kavya	Carrier Tracking No(s): Hand Deliver	COC No: 480-211497-25500.4
Client Contact: Mr. Nathan Sarapas	Phone: 978 758 4902	E-Mail: kavya.boyina@et.eurofinsus.com	State of Origin: NY	Page: Page 4 of 4 3/25/26
Company: TRC Companies, Inc	PWSID:			Job #:
Address: 650 Suffolk Street	Due Date Requested: Standard			
City: Lowell	TAT Requested (days): Standard			
State, Zip: MA, 01854	Compliance Project: Δ Yes Δ No			
Phone:	PO #: 233658			
Email: nsarapas@trccompanies.com	WO #:			
Project Name: Solvent Chemical Semi-annual Monitoring	Project #: 48002700			
Site:	SSOW#:			

Analysis Requested

Preservation Codes: N - None

Other:

Sample Identification	Sample Date	Sample Time	Sample Type (C=Comp, G=grab)	Matrix (W=water, S=solid, O=waste/oil, BT=Tissue, A=Air, DW=Drinking Water)	Field Filtered Sample (Yes or No)	Perform MS/MSD (YES or NO)	8260D - Volatiles	Total Number of containers	Special Instructions/Note:
			Preservation Code:				N		
~~OW-29A~~				Water					
MW-6B	3/25/26	1144	G	Water	2	2	X	3	
MW-6F	3/25/26	1200	G	Water	2	2	X	3	
OW-14B	3/25/26	0930	G	Water	2	2	X	3	
OW-22A	3/25/26	1000	G	Water	2	2	X	3	
OW-22B	3/25/26	1010	G	Water	2	4	X	9	MS/MSD
OW-15B	3/25/26	0940	G	Water	2	2	X	3	
TB-01 (Trip Blank)	3/24/26	0800	G	Water	2	2	X	2	
TB-02 (Trip Blank)	3/25/26	0800	G	Water	2	2	X	2	
				Water					
				Water					

CT 3/25/26

Possible Hazard Identification

☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☒ Unknown ☐ Radiological

Deliverable Requested: I, II, III, IV, Other (specify)

Sample Disposal (A fee may be assessed if samples are retained longer than 1 month)

☐ Return To Client ☒ Disposal By Lab ☐ Archive For _____ Months

Special Instructions/QC Requirements:

Empty Kit Relinquished by:	Date:	Time:	Method of Shipment:		
Relinquished by:	Date/Time: 3/25/26 1525	Company: TRC	Received by: B. Lynn	Date/Time: 3-25-26 1525	Company: ETB
Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company
Relinquished by:	Date/Time:	Company	Received by:	Date/Time:	Company

Custody Seals Intact: Δ Yes Δ No | Custody Seal No.:

Cooler Temperature(s) °C and Other Remarks:

Ver: 10/10/2024

Amherst, NY 14228-2298
Phone: 716-691-2600 Fax: 716-691-7991

Chain of Custody Record

eurofins | Environment Testing

Client Information	Sampler: C. Rudzinski	Lab PM: Boyina, Kavya	Carrier Tracking No(s): Hand Deliver	COC No: 480-211497-25500.3
Client Contact: Mr. Nathan Sarapas	Phone: 978 758 4902	E-Mail: kavya.boyina@et.eurofinsus.com	State of Origin: NY	Page: Page 3 of 4 3/25/26
Company: TRC Companies, Inc	PWSID:			Job #:
Address: 650 Suffolk Street	Due Date Requested: Standard			
City: Lowell	TAT Requested (days): Standard			
State, Zip: MA, 01854	Compliance Project: Δ Yes Δ No			
Phone:	PO #: 233658			
Email: nsarapas@trccompanies.com	WO #:			
Project Name: Solvent Chemical Semi-annual Monitoring	Project #: 48002700			
Site:	SSOW#:			

Analysis Requested

Preservation Codes: N - None

Other:

Sample Identification	Sample Date	Sample Time	Sample Type (C=Comp, G=grab)	Matrix (W=water, S=solid, O=waste/oil, BT=Tissue, A=Air, DW=Drinking Water)	Field Filtered Sample (Yes or No)	Perform MS/MSD (Yes or No)	8260D - Volatiles	Total Number of containers	Special Instructions/Note:
Preservation Code:							N		
MW-1B	3/24/26	1455	G	Water	N	N	X	3	
MW-1C	3/24/26	1500	G	Water	N	N	X	3	
MW-1CD	3/24/26	1505	G	Water	N	N	X	3	
MW-1F	3/25/26	1135	G	Water	N	N	X	3	
OW-12A	3/24/26	1520	G	Water	N	N	X	3	
OW-10B	3/24/26	1530	G	Water	N	N	X	3	
MW-2A	3/24/26	1544	G	Water	N	N	X	3	
OW-18A	3/25/26	1210	G	Water	N	Y	X	9	MS/MSD
				Water					
OW-11B	3/25/26	1325	G	Water	N	N	X	3	
OW-111B	3/25/26	1425	G	Water	N	N	X	2	

GK 3/24/26 → 3/25/26 → GK 3/25/26

Possible Hazard Identification
☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☒ Unknown ☐ Radiological

Deliverable Requested: I, II, III, IV, Other (specify)

Sample Disposal (A fee may be assessed if samples are retained longer than 1 month)
☐ Return To Client ☒ Disposal By Lab ☐ Archive For _____ Months

Special Instructions/QC Requirements:

Empty Kit Relinquished by:	Date:	Time:	Method of Shipment:
Relinquished by:	Date/Time: 3/25/26 1525	Company: TRC	Received by:	Date/Time: 3-25-26 1525	Company: ETS
Relinquished by:	Date/Time:	Company:	Received by:	Date/Time:	Company:
Relinquished by:	Date/Time:	Company:	Received by:	Date/Time:	Company:

Custody Seals Intact: Δ Yes Δ No | Custody Seal No.:

Cooler Temperature(s) °C and Other Remarks:

Ver: 10/10/2024

Login Sample Receipt Checklist

Client: TRC Environmental Corporation

Job Number: 480-237182-1

Login Number: 237182

List Source: Eurofins Buffalo

List Number: 1

Creator: Stapleton, Kaitlyn

Question	Answer	Comment
Radioactivity either was not measured or, if measured, is at or below background	True	
The cooler's custody seal, if present, is intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	0.7, 0.5 IR#SC ice
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the sample IDs on the containers and the COC.	True	
Samples are received within Holding Time (Excluding tests with immediate HTs)..	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
VOA sample vials do not have headspace or bubble is <6mm (1/4") in diameter.	True	
If necessary, staff have been informed of any short hold time or quick TAT needs	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Sampling Company provided.	True	TRC Companies
Samples received within 48 hours of sampling.	True	
Samples requiring field filtration have been filtered in the field.	True	
Chlorine Residual checked.	N/A	

APPENDIX F - SOLVENT DISPOSAL MANIFESTS 2025-2026

R# 4529 CoW 7292R

Please print or type. (Form designed for use on elite (12-pitch) typewriter.) Form Approved. OMB No. 2050-0039

UNIFORM HAZARDOUS WASTE MANIFEST

1. Generator ID Number: NYD000824466
2. Page 1 of: 1
3. Emergency Response Phone: 330-354-0104
4. Manifest Tracking Number: 003734699 GBF

GENERATOR

5. Generator's Name and Mailing Address: Sherwood Forest Properties, Ltd 3163 Buffalo Ave, Niagara Falls, NY 14303
Generator's Phone: #330-354-0104
Generator's Site Address (if different than mailing address):

6. Transporter 1 Company Name: Dart Trucking Company
U.S. EPA ID Number: OHR000159129

7. Transporter 2 Company Name:
U.S. EPA ID Number:

8. Designated Facility Name and Site Address: Big Sandy Plant, Route 23 South Catlettsburg, KY 41129
Facility's Phone: #1-606-739-8681
U.S. EPA ID Number: KYD005009923

9a. HM	9b. U.S. DOT Description (including Proper Shipping Name, Hazard Class, ID Number, and Packing Group (if any))	10. Containers No.	10. Containers Type	11. Total Quantity	12. Unit Wt./Vol.	13. Waste Codes
	~~NA 3077, HAZARDOUS WASTE SOLID N.O.S. (Trichloroethylene), 9, III~~	~~4~~		~~4 CC~~	~~5,000 LL~~	~~D040~~
	2. NA 3077, HAZARDOUS Waste Solid NOS (Trichloroethylene), 9, III	4	BA ~~BA~~	6,000	P	D040
	3.					
	4.					

14. Special Handling Instructions and Additional Information
1, Profile 7292R

15. **GENERATOR'S/OFFEROR'S CERTIFICATION:** I hereby declare that the contents of this consignment are fully and accurately described above by the proper shipping name, and are classified, packaged, marked and labeled/placarded, and are in all respects in proper condition for transport according to applicable international and national governmental regulations. If export shipment and I am the Primary Exporter, I certify that the contents of this consignment conform to the terms of the attached EPA Acknowledgment of Consent.
I certify that the waste minimization statement identified in 40 CFR 262.27(a) (if I am a large quantity generator) or (b) (if I am a small quantity generator) is true.

Generator's/Offeror's Printed/Typed Name: N. Scott Buchanan as generator agent
Signature:
Month: 08 Day: 06 Year: 2025

INT'L

16. International Shipments ☐ Import to U.S. ☐ Export from U.S. Port of entry/exit:
Transporter signature (for exports only): Date leaving U.S.:

TRANSPORTER

17. Transporter Acknowledgment of Receipt of Materials
Transporter 1 Printed/Typed Name: Paul Lowell
Signature:
Month: 08 Day: 06 Year: 2025
Transporter 2 Printed/Typed Name:
Signature:
Month: Day: Year:

DESIGNATED FACILITY

18. Discrepancy
18a. Discrepancy Indication Space ☐ Quantity ☐ Type ☐ Residue ☐ Partial Rejection ☐ Full Rejection
Manifest Reference Number:

18b. Alternate Facility (or Generator)
U.S. EPA ID Number:
Facility's Phone:

18c. Signature of Alternate Facility (or Generator)
Month: Day: Year:

19. Hazardous Waste Report Management Method Codes (i.e., codes for hazardous waste treatment, disposal, and recycling systems)
1. H039 2. 3. 4.

20. Designated Facility Owner or Operator: Certification of receipt of hazardous materials covered by the manifest except as noted in Item 18a
Printed/Typed Name: Matt Jenkins CCC
Signature:
Month: 8 Day: 6 Year: 25

EPA Form 8700-22 (Rev. 3-05) Previous editions are obsolete.

DESIGNATED FACILITY TO DESTINATION STATE (IF REQUIRED)

RMA# 600223666 Cont# 7292R
R# 4927

Please print or type. (Form designed for use on elite (12-pitch) typewriter.) Form Approved. OMB No. 2050-0039

UNIFORM HAZARDOUS WASTE MANIFEST

1. Generator ID Number	2. Page 1 of	3. Emergency Response Phone	4. Manifest Tracking Number
NYD000824466	1	330-354-0104	003734700 GBF

GENERATOR

5. Generator's Name and Mailing Address
Sherwood Forest Properties, LTD
3163 Buffalo Ave, Niagaras Falls, NY 14303 #330-354-0104
Generator's Phone:

Generator's Site Address (if different than mailing address)

6. Transporter 1 Company Name: Dart Trucking Company — U.S. EPA ID Number: OHR000159129

7. Transporter 2 Company Name — U.S. EPA ID Number:

8. Designated Facility Name and Site Address
Big Sandy Plant, Route 23 South
Catlettsburg, KY, 41129
Facility's Phone: #1-606-7398681
U.S. EPA ID Number: KYD005009923

9a. HM	9b. U.S. DOT Description (including Proper Shipping Name, Hazard Class, ID Number, and Packing Group (if any))	10. Containers No.	10. Containers Type	11. Total Quantity	12. Unit Wt./Vol.	13. Waste Codes
X	1. NA 3077, HAZARDOUS WASTE SOLID NOS (Trichloroethylene), 9, III	5	BA	5000	P.	D40
	2.					
	3.					
	4.					

14. Special Handling Instructions and Additional Information
1. Profile 7292R

15. **GENERATOR'S/OFFEROR'S CERTIFICATION:** I hereby declare that the contents of this consignment are fully and accurately described above by the proper shipping name, and are classified, packaged, marked and labeled/placarded, and are in all respects in proper condition for transport according to applicable international and national governmental regulations. If export shipment and I am the Primary Exporter, I certify that the contents of this consignment conform to the terms of the attached EPA Acknowledgment of Consent.
I certify that the waste minimization statement identified in 40 CFR 262.27(a) (if I am a large quantity generator) or (b) (if I am a small quantity generator) is true.

Generator's/Offeror's Printed/Typed Name: N. Scott Buchanan For the Generator — Signature: [signature] — Month: 01 Day: 06 Year: 26

INT'L

16. International Shipments ☐ Import to U.S. ☐ Export from U.S. Port of entry/exit:
Transporter signature (for exports only): Date leaving U.S.:

TRANSPORTER

17. Transporter Acknowledgment of Receipt of Materials

Transporter 1 Printed/Typed Name: Charles Good — Signature: [signature] — Month: 01 Day: 06 Year: 26

Transporter 2 Printed/Typed Name — Signature — Month — Day — Year

DESIGNATED FACILITY

18. Discrepancy

18a. Discrepancy Indication Space ☐ Quantity ☐ Type ☐ Residue ☐ Partial Rejection ☐ Full Rejection

Manifest Reference Number:

18b. Alternate Facility (or Generator) — U.S. EPA ID Number
Facility's Phone:

18c. Signature of Alternate Facility (or Generator) — Month — Day — Year

19. Hazardous Waste Report Management Method Codes (i.e., codes for hazardous waste treatment, disposal, and recycling systems)

1.	2.	3.	4.
H039			

20. Designated Facility Owner or Operator: Certification of receipt of hazardous materials covered by the manifest except as noted in Item 18a

Printed/Typed Name: Donnie Tackett for CCC — Signature: [signature] — Month: 1 Day: 17 Year: 26

EPA Form 8700-22 (Rev. 3-05) Previous editions are obsolete.

DESIGNATED FACILITY TO DESTINATION STATE (IF REQUIRED)

APPENDIX G – INSTITUTIONAL AND ENGINEERING CONTROLS CERTIFICATION FORM

Enclosure 2
NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION
Site Management Periodic Review Report Notice
Institutional and Engineering Controls Certification Form

Site Details **Box 1**

Site No. 932096

Site Name Solvent Chemical

Site Address: 3163 Buffalo Avenue Zip Code: 14303
City/Town: Niagara Falls
County: Niagara
Site Acreage: 5.700

Reporting Period: March 30, 2025 to March 30, 2026

	YES	NO
1. Is the information above correct?	☑	☐
If NO, include handwritten above or on a separate sheet.		
2. Has some or all of the site property been sold, subdivided, merged, or undergone a tax map amendment during this Reporting Period?	☐	☑
3. Has there been any change of use at the site during this Reporting Period (see 6NYCRR 375-1.11(d))?	☐	☑
4. Have any federal, state, and/or local permits (e.g., building, discharge) been issued for or at the property during this Reporting Period?	☐	☑
If you answered YES to questions 2 thru 4, include documentation or evidence that documentation has been previously submitted with this certification form.		
5. Is the site currently undergoing development?	☐	☑

Box 2

	YES	NO
6. Is the current site use consistent with the use(s) listed below? Industrial	☑	☐
7. Are all ICs in place and functioning as designed?	☑	☐

IF THE ANSWER TO EITHER QUESTION 6 OR 7 IS NO, sign and date below and DO NOT COMPLETE THE REST OF THIS FORM. Otherwise continue.

A Corrective Measures Work Plan must be submitted along with this form to address these issues.

_____ _____
Signature of Owner, Remedial Party or Designated Representative Date

SITE NO. 932096 **Box 3**

Description of Institutional Controls

Parcel	Owner	Institutional Control
159.16-2-3	Sherwood Forest Properties,Ltd.	
		Monitoring Plan
		O&M Plan
		Ground Water Use Restriction
		Landuse Restriction
		Building Use Restriction
		Site Management Plan
		IC/EC Plan

Record of Decision; 12/31/96.
Consent Decree; 1/8/98. 83 CIV 1401 (C)
Deed Restriction; 2/16/05.

Box 4

Description of Engineering Controls

Parcel	Engineering Control
159.16-2-3	
	Groundwater Treatment System
	Groundwater Containment
	Fencing/Access Control
	Leachate Collection
	Monitoring Wells
	Cover System
	Vapor Mitigation

In accordance with the Record of Decision dated 12/31/96, the remedial components of this site are a soil cover system, overburden groundwater collection system, bedrock groundwater recovery system and a on-site groundwater treatment facility with a sub-slab vapor control system. Contaminated groundwater recovered by the collection and/or extraction wells, are conveyed to and treated by advanced organic removal processes at an on-site treatment facility. Groundwater levels and groundwater quality are monitored to check on inward gradients and the performance of the remedy. All engineering controls are in place, to ensure site management practices are effective for the protection of human health and the environment.

Box 5

Periodic Review Report (PRR) Certification Statements

1. I certify by checking "YES" below that:

   a) the Periodic Review report and all attachments were prepared under the direction of, and reviewed by, the party making the Engineering Control certification;

   b) to the best of my knowledge and belief, the work and conclusions described in this certification are in accordance with the requirements of the site remedial program, and generally accepted engineering practices; and the information presented is accurate and compete.

YES	NO
☑	☐

2. For each Engineering control listed in Box 4, I certify by checking "YES" below that all of the following statements are true:

   (a) The Engineering Control(s) employed at this site is unchanged since the date that the Control was put in-place, or was last approved by the Department;

   (b) nothing has occurred that would impair the ability of such Control, to protect public health and the environment;

   (c) access to the site will continue to be provided to the Department, to evaluate the remedy, including access to evaluate the continued maintenance of this Control;

   (d) nothing has occurred that would constitute a violation or failure to comply with the Site Management Plan for this Control; and

   (e) if a financial assurance mechanism is required by the oversight document for the site, the mechanism remains valid and sufficient for its intended purpose established in the document.

YES	NO
☑	☐

IF THE ANSWER TO QUESTION 2 IS NO, sign and date below and DO NOT COMPLETE THE REST OF THIS FORM. Otherwise continue.

A Corrective Measures Work Plan must be submitted along with this form to address these issues.

_____ _____

Signature of Owner, Remedial Party or Designated Representative Date

IC CERTIFICATIONS
SITE NO. 932096

Box 6

SITE OWNER OR DESIGNATED REPRESENTATIVE SIGNATURE

I certify that all information and statements in Boxes 1,2, and 3 are true. I understand that a false statement made herein is punishable as a Class "A" misdemeanor, pursuant to Section 210.45 of the Penal Law.

I ___Robert J. Basil_____ at __125 West 31st Street #19B, NY NY 10001_____,
print name print business address

am certifying as __Designated Representative of the Remedial Party____(Owner or Remedial Party)

for the Site named in the Site Details Section of this form.

Robert Basil
_____ April 27, 2026

Signature of Owner, Remedial Party, or Designated Representative Rendering Certification — Date

EC CERTIFICATIONS

Box 7

Qualified Environmental Professional Signature

I certify that all information in Boxes 4 and 5 are true. I understand that a false statement made herein is punishable as a Class "A" misdemeanor, pursuant to Section 210.45 of the Penal Law.

I Matthew Robbins (print name) at 650 Suffolk Street Lowell, MA (print business address),

am certifying as a Qualified Environmental Professional for the Solvent Chemical (Owner or Remedial Party)

Matthew Robbins		4/27/26
Signature of Qualified Environmental Professional, for the Owner or Remedial Party, Rendering Certification	Stamp (Required for PE)	Date

APPENDIX H - REFERENCED CORRESPONDENCE

From: May, Glenn (DEC)
To: Plumb, Mike
Subject: Re: Solvent Chemical Proposed System Modifications
Date: Friday, May 19, 2023 1:01:10 PM
Attachments: image001.png

Hi Mike,

TRCs proposed modifications to the Solvent treatment system are acceptable. Please let me know if you have any questions.

Glenn M. May, PG
Professional Geologist 1
Division of Environmental Remediation

New York State Department of Environmental Conservation
Region 9
700 Delaware Avenue
Buffalo, New York 14209
P: (716) 851-7220 | glenn.may@dec.ny.gov

From: Plumb, Mike <MPlumb@trccompanies.com>
Sent: Friday, May 19, 2023 10:26 AM
To: May, Glenn (DEC) <glenn.may@dec.ny.gov>
Subject: RE: Solvent Chemical Proposed System Modifications

ATTENTION: This email came from an external source. Do not open attachments or click on links from unknown senders or unexpected emails.

Hi Glenn,

Just checking in to see if there are any questions on the email below and information in the attached.

If there are any questions, please let me know.

If no questions, please let me know the details on NYSDEC coordination requirements and approvals that need to be secured prior to implementing the proposed system modifications at the Solvent Chemical site.

Thanks
Mike

From: Plumb, Mike

Sent: Monday, May 15, 2023 4:37 PM
To: May, Glenn (DEC) <glenn.may@dec.ny.gov>
Subject: Solvent Chemical Proposed System Modifications

Hi Glenn,

As discussed, the attached letter provides a summary of the proposed system modifications for the Solvent Chemical Site.

Please let me, on behalf of Solvent Chemical, know what requirements NYSDEC has regarding implementation of these modifications, with respect to submittals and what approvals are required.

As we discussed, the Niagara Falls Water Board is hoping to get the needed system modifications online as soon as possible. There are lead times associated with project planning, budgeting, equipment procurement, etc. In support of moving things forward as expeditiously as we can, I can be available for online meeting or phone calls to discuss/address any questions.

Thanks
Mike

Michael Plumb, PE*
Principal Engineer/Project Manager
*MA, NJ, VT

650 Suffolk Street, Lowell, MA 01854
T 978.656.3589 | **F** 978.453.1995 | **C** 978.502.9855
LinkedIn | Twitter | Blog | TRCcompanies.com

Please note that our domain name and email addresses have changed

New York State Department of Environmental Conservation
Division of Environmental Remediation, Region 9
270 Michigan Avenue, Buffalo, New York, 14203-2999
Phone: (716) 851-7220 • **FAX:** (716) 851-7226
Website: www.dec.state.ny.us

Erin M. Crotty
Commissioner

July 1, 2004

Mr. Michael Plumb
TRC Environmental Corporation
Boott Mills South, Foot of John Street
Lowell, MA 01852

Dear Mr. Plumb:

Solvent Chemical (Site #9-32-096) Inactive
Hazardous Waste Site
June 2004 Performance Monitoring Plan

The New York State Department of Environmental Conservation (NYSDEC) has reviewed TRC's revised Performance Monitoring Plan, dated June 2004. The Plan is acceptable to the NYSDEC and is hereby approved. Performance monitoring activities should commence immediately, with the first quarterly (3rd quarter) report submission to be submitted to the NYSDEC no later than November 15, 2004.

Should you have any questions, please feel free to contact me at (716) 851-7220.

Sincerely,

Jeffrey A. Konsella, P.E.
Environmental Engineer II
Division of Environmental Remediation

cc: Mr. Daniel King, DEC-Buffalo
Mr. Dave Rankin, Dover Chemical
Mr. Matt Forcucci-DOH

New York State Department of Environmental Conservation
Division of Environmental Remediation, Region 9
270 Michigan Avenue, Buffalo, New York, 14203-2999
Phone: (716) 851-7220 • **FAX:** (716) 851-7226
Website: www.dec.state.ny.us

Denise M. Sheehan
Acting Commissioner

October 18, 2005

Mr. Michael Plumb
TRC Environmental Corporation
Boott Mills South, Foot of John Street
Lowell, MA 01852

Dear Mr. Plumb:

Solvent Chemical (Site #9-32-096)
Inactive Hazardous Waste Site
Proposed Modifications to the Groundwater
Pre-Treatment System Piping

The New York State Department of Environmental Conservation (NYSDEC) has reviewed TRC's October 6, 2005 letter proposing modifications to the Solvent Chemical site groundwater pre-treatment system piping. TRC proposes the re-piping of the A-zone groundwater influent lines to bypass the oil/water separator and feed directly into the air stripper unit. The reason for this change is to eliminate the potential for wet weather flows to exceed the capacity of the oil/water separator. This change is acceptable to the NYSDEC as mobile NAPL has not been observed from the A-zone groundwater recovery system, and since the modifications will include a valve to allow A-zone influent to be directed to the oil/water separator if necessary.

Upon completion of the groundwater pre-treatment system modifications, please submit the appropriate page revisions (reflecting all significant system changes) for inclusion in the approved April 2003 Solvent Chemical Operations and Maintenance Plan. Should you have any questions, please feel free to contact me at (716) 851-7220.

Sincerely,

Jeffrey A. Konsella, P.E.
Environmental Engineer II
Division of Environmental Remediation

cc: Mr. Gregory Sutton, DEC Buffalo
Mr. David Rankin, Dover Chemical
Mr. Matthew Forcucci, DOH Buffalo

APPENDIX I – WELL DECOMMISSIONING FIELD REPORT & GSR SUPPORT


ECR Daily Field Report



ECR Daily Field Report

December 18, 2025, Solvent Chemical, Leila Cappellano

12/18/2025, 7:51:45 PM UTC

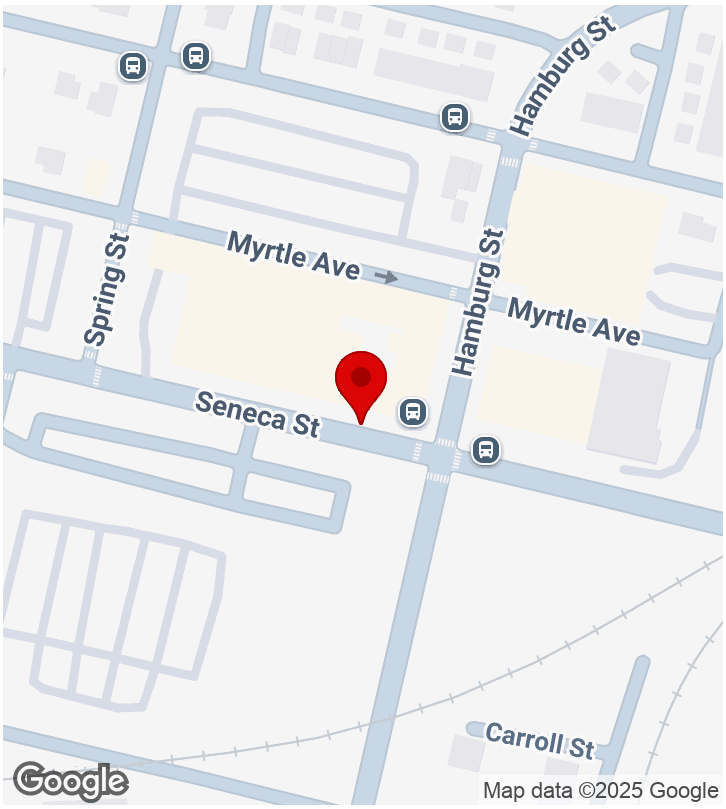

CREATED

12/18/2025, 7:32:28 PM UTC

by Leila Cappellano

UPDATED

12/18/2025, 7:51:45 PM UTC

by Leila Cappellano

STATUS

Complete

LOCATION

42.877310, -78.856698

Date	December 18, 2025

Site Info

Project Name	Solvent Chemical
Project Number	658382
Property Name	Solvent Chemical
Address	3163 Buffalo Ave Niagara Falls Ny
Site Address	3163 Buffalo Ave, Niagara Falls, NY

Weather Data

Conditions	CONDITIONS: Clouds, TEMPERATURE: 54 F, PRESSURE: 1009 hPa, RELATIVE HUMIDITY: 37%, WIND SPEED: 14.97 MPH, WIND DIRECTION: 180 degrees
Temperature (F)	54
Pressure (hPa)	1009
Relative Humidity (%)	37
Wind Speed (MPH)	15
Wind Direction (Degrees)	180

Personnel on Site	Leila Cappellano, Jerry Jones, Steve Gingrich

Daily Observations (9 Items)

Daily Observations - 1. 08:34, Arrived onsite and performed s...

Time	08:34
Observation Notes	Arrived onsite and performed safety meeting

Photos



Daily Observations - 2. 09:00, Observed the wells and measure...

Time	09:00
Observation Notes	Observed the wells and measured blockages. OW-18B appeared to be 16ft from TOC. OW-29A appeared to be 6ft from TOC.

Photos



Daily Observations - 3. 10:00, Removed casing and concrete ...

Time	10:00
Observation Notes	Removed casing and concrete

Photos



Daily Observations - 4. 10:00, Grouted OW-29A, used about fou...

Time	10:00
Observation Notes	Grouted OW-29A, used about four gallons

Photos



Daily Observations - 5. 10:00, Material retrieved from OW-29A...

Time	10:00
Observation Notes	Material retrieved from OW-29A

Photos



Daily Observations - 6. 11:45, Surface features removed and g...

Time	11:45
Observation Notes	Surface features removed and graded OW-29A

Photos



Daily Observations - 7. 10:10, Drill rig and rods down OW-18B...

Time	10:10
Observation Notes	Drill rig and rods down OW-18B

Photos



Daily Observations - 8. 11:39, Grouting OW-18B, used about 8 ...

Time	11:39
Observation Notes	Grouting OW-18B, used about 8 gallons of quickcrete

Photos



Daily Observations - 9. 14:49, Surface features removed and g...

Time	14:49
Observation Notes	Surface features removed and graded OW-18B

Photos



PID Readings (2 Items)

Time	Type of Reading	PID Reading	Odor Observation	Dust Observation	Other Notes
09:00	Headspace	53.8	none	none	OW-18B
09:00	Headspace	0.2	none	none	OW-29A

Name of Observer	Leila Cappellano
Observer's Office	Other

Solvent Chemical Site
Niagara Falls, New York
Spreadsheets for Environmental Footprint Analysis

Environmental Footprint Summary

Core Element	Metric		Unit of Measure	Footprint				
				Semi-Annual Sampling	Quarterly Sampling	BHC Testing	Groundwater Treatment	Total
Materials & Waste	M&W-1	Refined materials used on-site	Tons	0.02	0.0	0.0	12.7	12.7
	M&W-2	% of refined materials from recycled or reused material	%	23.8%			0.4%	0.4%
	M&W-3	Unrefined materials used on-site	Tons	0.0	0.0	0.0	0.0	0.0
	M&W-4	% of unrefined materials from recycled or reused material	%					
	M&W-5	On-site hazardous waste disposed of off-site	Tons	0.0	0.0	0.0	0.7	0.7
	M&W-6	On-site non-hazardous waste disposed of off-site	Tons	0.01	0.0	0.0	5.8	5.8
	M&W-7	Recycled or reused waste	Tons	0.0	0.0	0.0	0.0	0.0
	M&W-8	% of total potential waste recycled or reused	%	71.2%			0.0%	0.3%
Water (used on-site)	W-1	Public water use	MG	0.0	0.0	0.00	0.0	0.00
	W-2	Groundwater use	MG	0.0	0.0	0.0	22.8	22.8
	W-3	Surface water use	MG	0.0	0.0	0.0	0.0	0.0
	W-4	Reclaimed water use	MG	0.0	0.0	0.0	0.0	0.0
	W-5	Storm water use	MG	0.0	0.0	0.0	0.0	0.0
	W-6	User-defined water resource #1	MG	0.0	0.0	0.0	0.0	0.0
	W-7	User-defined water resource #2	MG	0.0	0.0	0.0	0.0	0.0
	W-8	Wastewater generated	MG	0.0	0.0	0.0	0.0	0.0
Energy	E-1	Total energy used (on-site and off-site)	MMBtu	24.7	2.7	2.9	4,185.2	4,215.6
	E-2	Energy voluntarily derived from renewable resources						
	E-2A	On-site renewable energy generation or use + on-site biodiesel use + biodiesel and other renewable resource use for transportation	MMBtu	0.0	0.0	0.0	0.0	0.0
	E-2B	Voluntary purchase of renewable electricity	MWh	0.0	0.0	0.0	0.0	0.0
	E-3	Voluntary purchase of RECs	MWh	0.0	0.0	0.0	0.0	0.0
	E-4	On-site grid electricity use	MWh	0.0	0.0	0.0	290.6	290.6
Air	A-1	On-site NOx, SOx, and PM emissions	Pounds	0.0	0.0	0.0	2.7	2.7
	A-2	On-site HAP emissions	Pounds	0.0	0.0	0.0	0.0	0.0
	A-3	Total NOx, SOx, and PM emissions	Pounds	35.5	12.2	6.9	3,790.8	3,845.4
	A-3A	Total NOx emissions	Pounds	13.1	3.6	2.5	1,475.9	1,495.0
	A-3B	Total SOx emissions	Pounds	19.1	7.4	3.7	2,252.1	2,282.4
	A-3C	Total PM emissions	Pounds	3.3	1.2	0.7	62.9	68.0
	A-4	Total HAP emissions	Pounds	2.7	0.8	0.4	25.4	29.4
	A-5	Total greenhouse gas emissions	Tons CO2e*	1.7	0.2	0.2	112.5	114.6
Land & Ecosystems	Pre-treated groundwater is discharged to the Niagara Falls municipal sewer system. There is no atmospheric discharge since solvent laden air from the air stripper is treated by carbon adsorption. Once treated by adsorption, the air is recycled to the air stripper in a closed loop.							

** Total greenhouse gases emissions (in CO2e) include consideration of CO2, CH4, and N2O (Nitrous oxide) emissions.*

"MMBtu" = millions of Btus

"MG" = millions of gallons

"CO2e" = carbon dioxide equivalents of global warming potential

"MWh" = megawatt hours (i.e., thousands of kilowatt-hours or millions of Watt-hours)

"Tons" = short tons (2,000 pounds)

HAP = hazardous air pollutants

PM = particulate matter

NOx = nitrogen oxides

SOx = sulfur oxides

CO2 = carbon dioxide

CH4 = methane

N2O = nitrous oxide


The above metrics are consistent with EPA's Methodology for Understanding and Reducing a Project's Environmental Footprint (EPA 542-R-12-002), February 2012


Notes: Component information derived from Solvent Chemical Site existing treatment system operational data, recent operations and maintenance records, recent sampling events, and recent waste disposal information. Treatment system operation, material use, and waste disposal reflects annual footprint. The system consists of five (5) overburden and seven (7) shallow bedrock recovery wells. Ground water extracted from the recovery wells is pumped to an on-site building for pre-treatment. Pre-treatment operations include oil/water separation, air stripping, and granular activated carbon (GAC) polishing. Pre-treated effluent is discharged to the Niagara Falls municipal sewer system.


TRC

Solvent Chemical Site
Niagara Falls, New York
Spreadsheets for Environmental Footprint Analysis


Environmental Footprint Summary

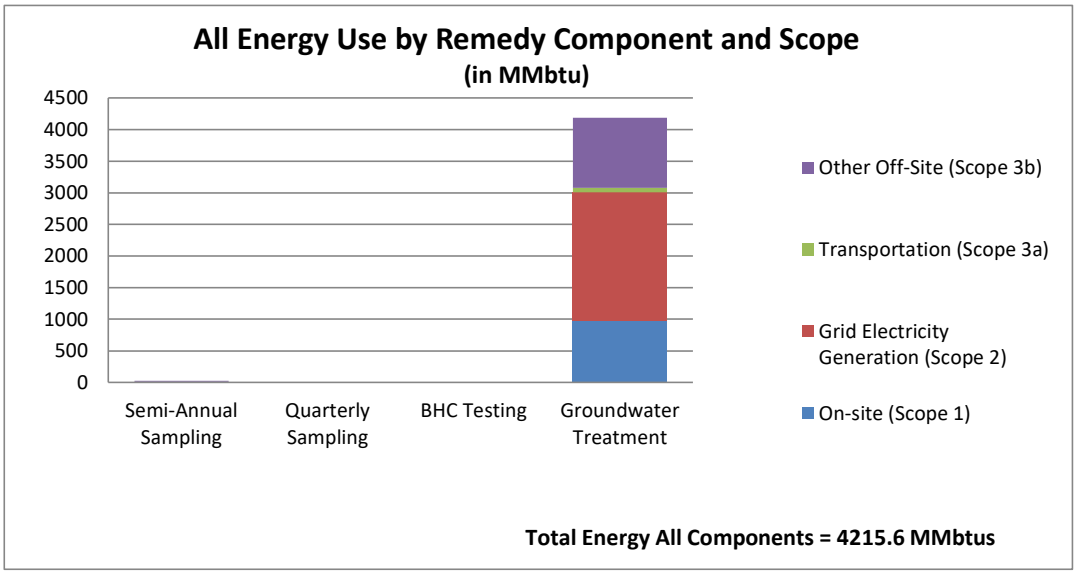


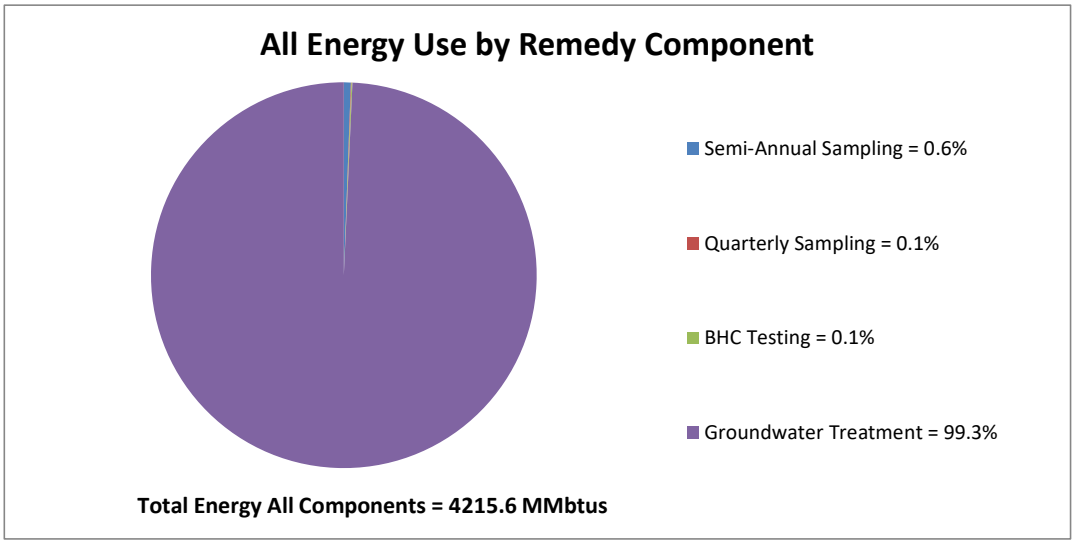


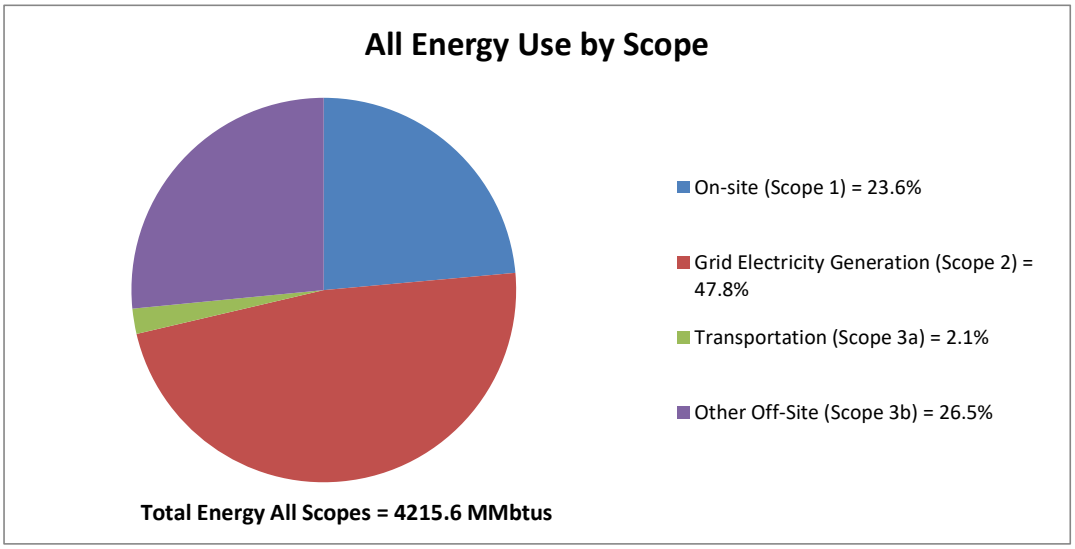


Environmental Footprint Summary

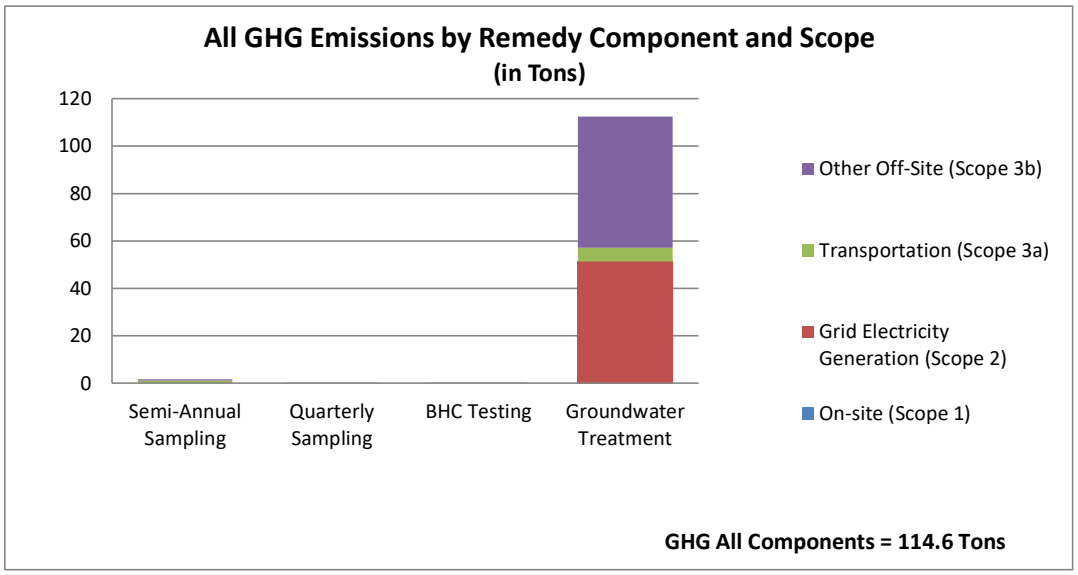


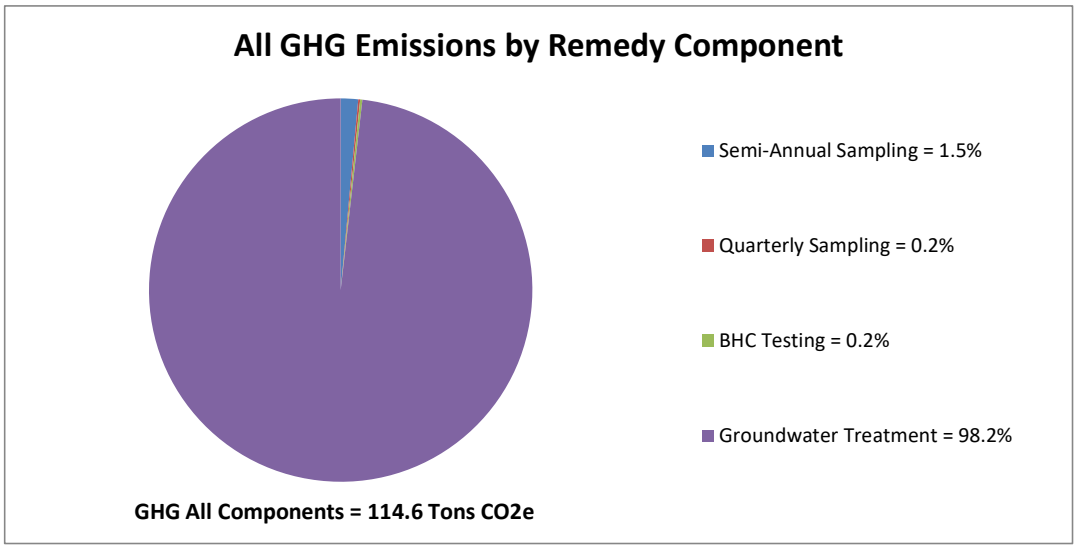


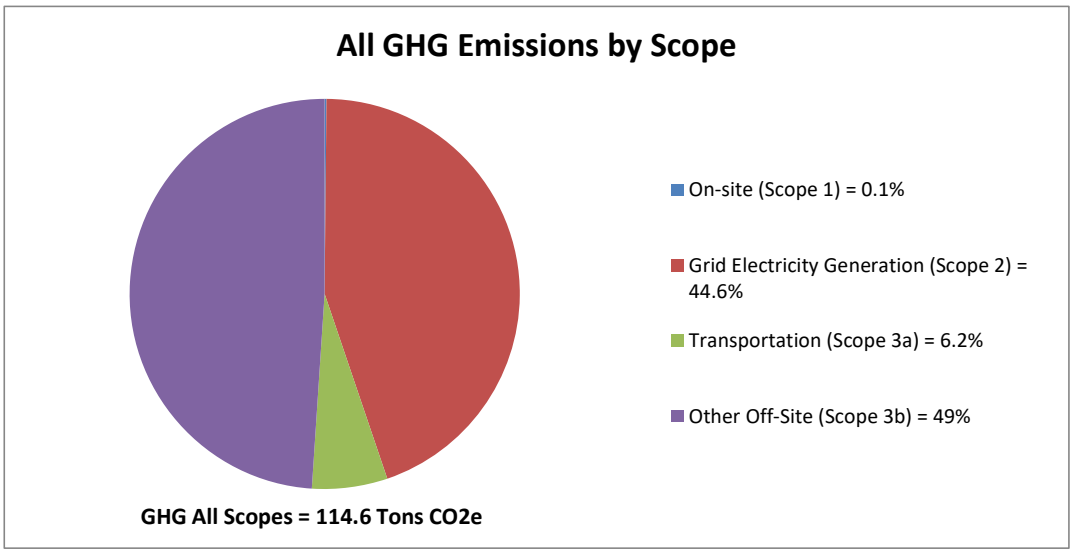


Environmental Footprint Summary

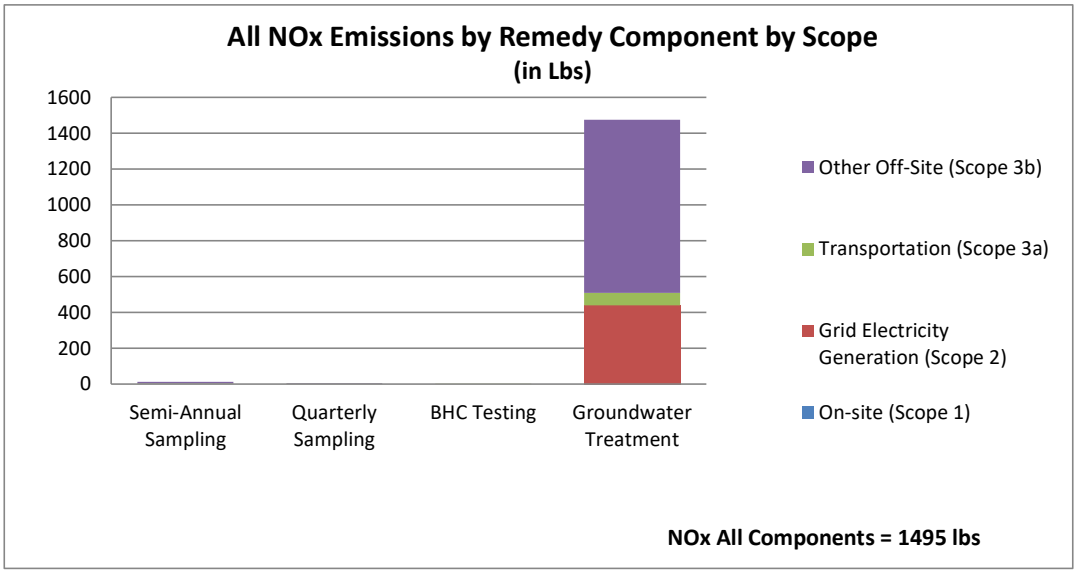


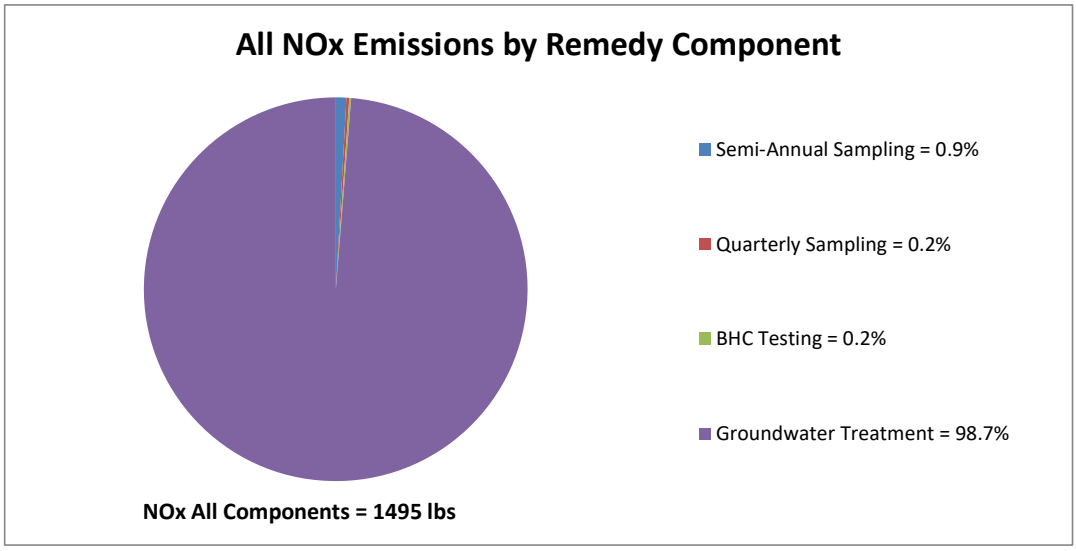


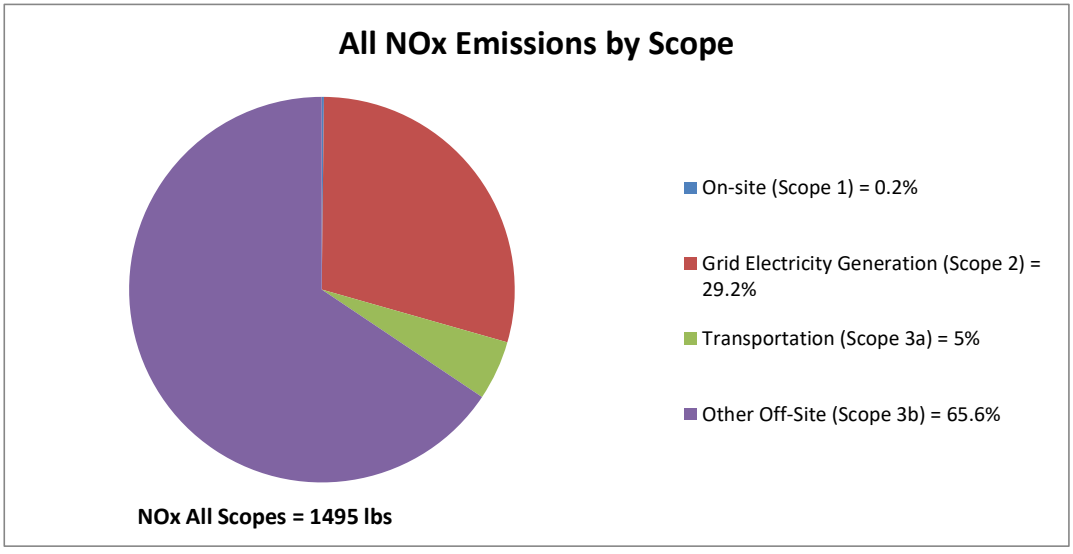


Environmental Footprint Summary

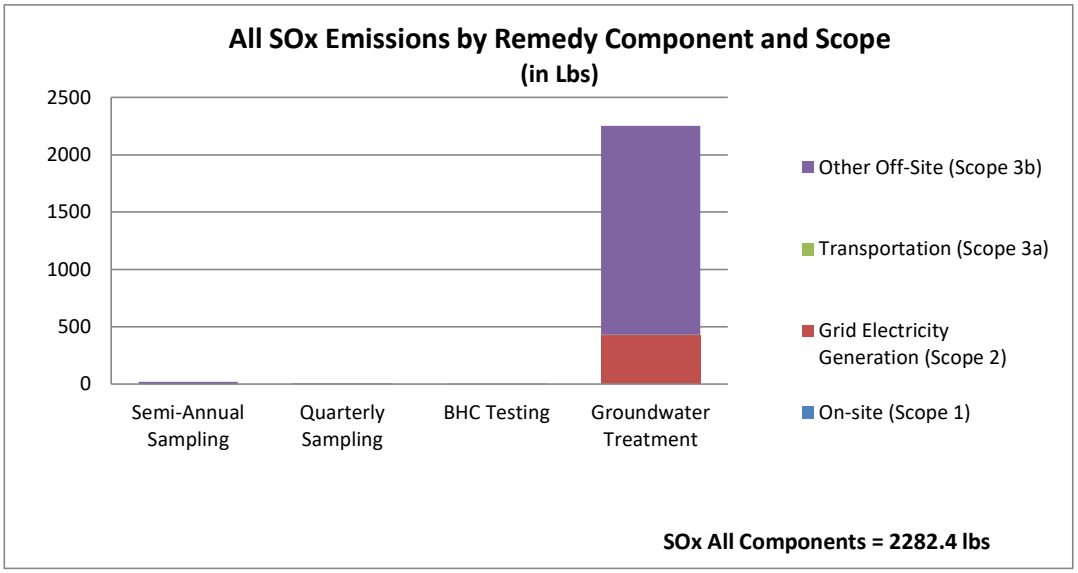


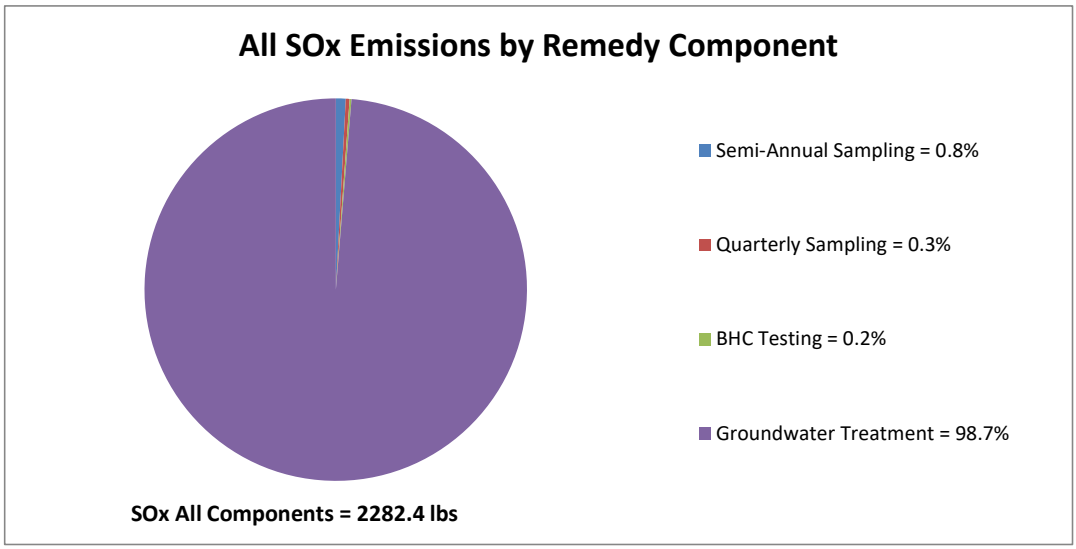


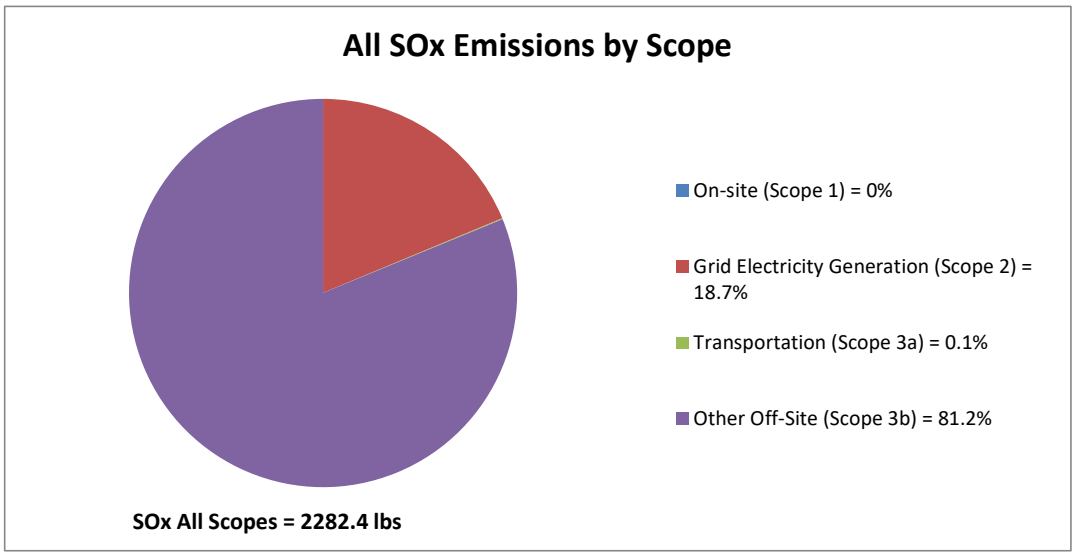

Environmental Footprint Summary

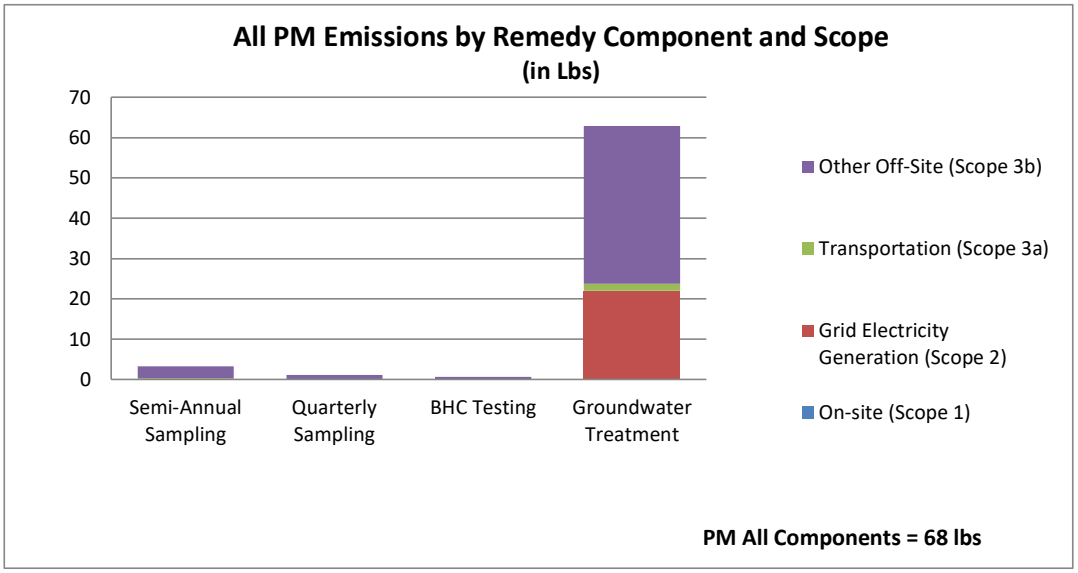

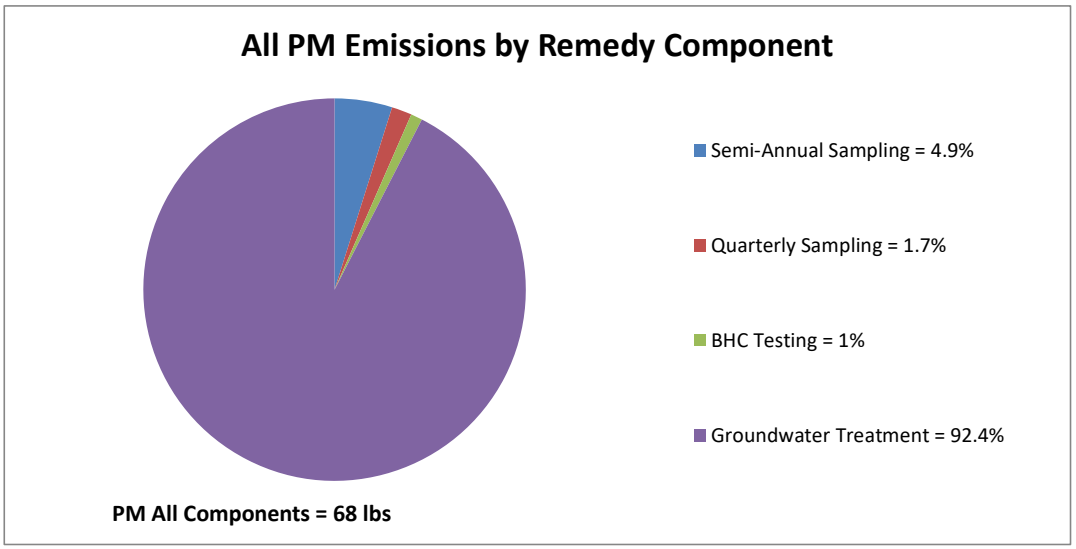

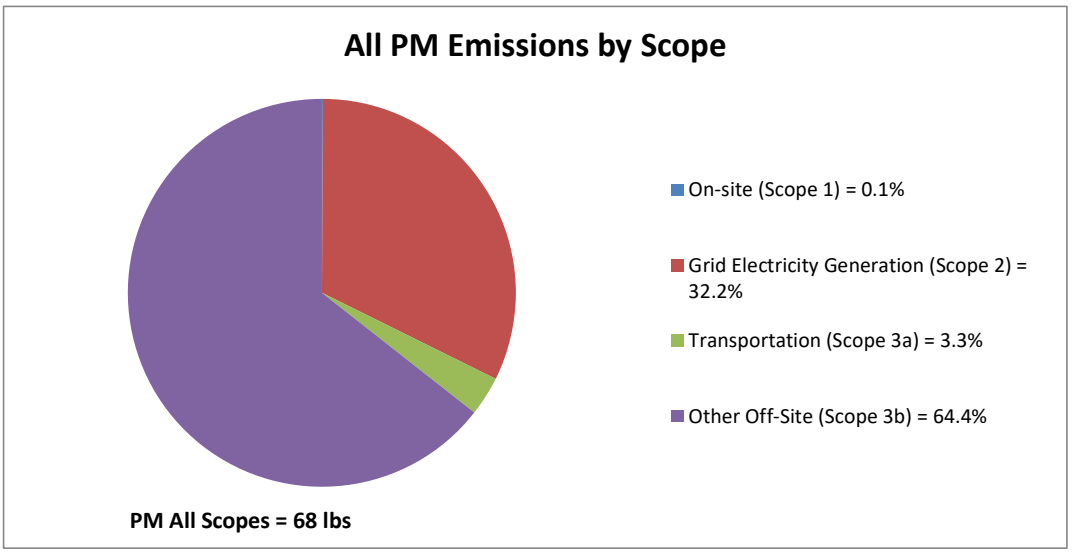

Environmental Footprint Summary

