
		Daily Activity Report	
		820 East 182nd Street	
		Bronx, NY BCP Site No. C203149	
General Site Information			
Date:		Thursday, March 9, 2023	
Weather:		Partly Cloudy, 20° F	
Wind Direction/Speed:		E @ 12 mph	
AKRF Personnel on Site:		J. Kelleher-Ferguson	
AKRF Equipment on Site:		Mini RAE 3000 Photoionization Detectors [(PID) x3] and DustTrak Aerosol Monitors (x3)	
Visitors:		None	
Contractor Information			
Subcontractor		Service	
Island Pump & Tank Corp. (IPT) East Northport, NY		Tank removal contractor	
Description and Location of Work Activities Performed			
<p>IPT continued to clean the 1,000 gallon waste oil UST. The emptied and cleaned tanks were transported off-site as scrap metal. Tank contents and cleaning fluids were containerized in 55-gallon drums for future off-site disposal. IPT began to break up the asphalt and excavate around the piping connecting the USTs to the pump island. AKRF screened the surrounding soil for any field evidence of contamination.</p>			
Site Soil Disposal Tracking Information			
CAMP Station	UPWIND	DOWNWIND	
Odors:	None	None	
VOC Action Level Exceedance(s):	None	None	
Particulate Action Level Exceedance(s):	None	None	
Maximum VOC Level (ppm) 15-min avg:	0.1743	0.154	
Maximum Particulate Level (mg/m³) 15-min avg:	0.0585	0.0892	
CAMP Response Actions: None			
Additional Information			
Planned Work Activity for Next Day/Week:	Removal of UST piping between the USTs and pump island, and excavation of any grossly contaminated fill/soil (if encountered). Collection of post-excavation endpoint samples and survey of endpoint locations.		
Comments:	None		

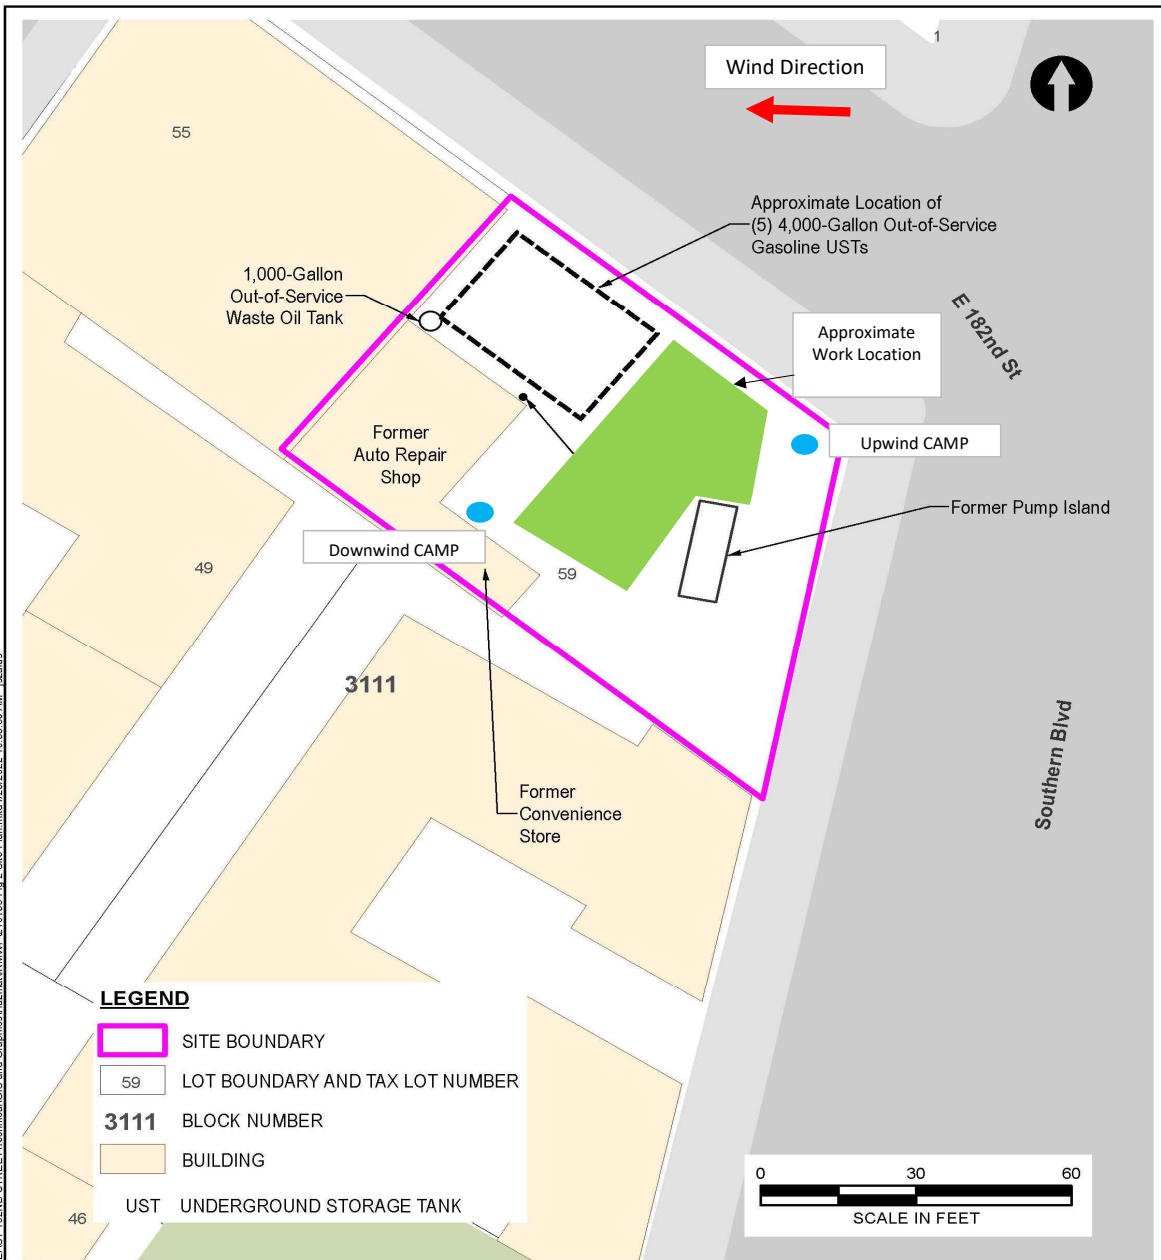

Map Source: NYCDOP (NYC Dept. of City Planning) GIS database.

<p>AKRF</p> <p>440 Park Avenue South, New York, NY 10016</p>	<p>820 East 182nd Street Bronx, New York</p>		DATE 4/25/2022
	<p>SITE PLAN</p>		PROJECT NO. 210138
			FIGURE 2

Upwind CAMP Station Data

Thu, 9th of Mar 2023, 0:00:00 – 18:06:51
(GMT-05:00) Eastern Time (US & Canada)

Particulate action level = 0.1 mg/m³ above background



Mass Conc. Total mg/m³ AVG 15m
mg/m³
DustTrak-8530
R0223(S)

MIN	AVG	MAX
0.0057	0.0135	0.0585

VOC ppm AVG 15m
ppm
miniRAE 3000
R0223(S)

MIN	AVG	MAX
0.0307	0.1226	0.1743

Name 182 st UW
S/N 08120565
Description FA02973
Location Southern Blvd/E 182 St,
The Bronx, NY 10460,
USA

© Netronix 2022

Downwind CAMP Station Data

Thu, 9th of Mar 2023, 0:00:00 – 18:05:54
(GMT-05:00) Eastern Time (US & Canada)



Mass Conc. Total mg/m³ AVG 15m
mg/m³
DustTrak-8530
R0223(S)

MIN	AVG	MAX
0.007	0.0343	0.0892

VOC ppm AVG 15m
ppm
miniRAE 3000
R0223(S)

MIN	AVG	MAX
0	0.081	0.1524

Name 182 St DW
S/N 08352750
Description FA04956
Location Southern Blvd/E 182 St,
The Bronx, NY 10460,
USA

© Netronix 2022

Site Photographs

Photograph 1 - IPT
breaking up the
asphalt surface to
access UST piping.



Photograph 2 - AKRF
screening soil and
gravel surrounding
piping with a PID.



Photograph 3 - IPT
removing piping
connected to the
pump island.

