




Known for excellence.
Built on trust.

GEOTECHNICAL
ENVIRONMENTAL
ECOLOGICAL
WATER
CONSTRUCTION
MANAGEMENT

GZA GeoEnvironmental of
New York
104 West 29th Street
10th Floor
New York, NY 10001
T: 212.594.8140
F: 212.279.8180
www.gza.com



October 17, 2025
File No.: 41.0163281.10

Ms. Marlen Salazar
New York State Department of Environmental Conservation
Division of Environmental Remediation
47-40 21st Street
Long Island City, NY 11101

Re: Soil Vapor Intrusion Investigation Report
1107 Dekalb Avenue
Brooklyn, New York 11221
NYSDEC BCP Site No. C224176

Dear Ms. Salazar:

GZA GeoEnvironmental of New York, Inc. (GZA) is pleased to submit this Soil Vapor Intrusion Investigation Report (SVI Report) for the above-referenced property (Site). The Site is in the site management phase of the New York State Department of Environmental Conservation (NYSDEC) Brownfield Cleanup Program (BCP), NYSDEC Site No. C224176 and was remediated in accordance with Brownfield Cleanup Agreement (BCA) No. C224176-05-13.

BACKGROUND

The Site is approximately 0.22-acres and is identified on the Kings County Tax Map as Block 1600 – Lot 28. It is located on the northeast corner of DeKalb Avenue and Malcolm X Boulevard. A Site Location Map is included as **Figure 1**. The Site is currently improved with an 8-story mixed-use building with a partial below grade cellar that includes storage, mechanical rooms, and retail/commercial space. A Site Plan is included as **Figure 2**.

The Site is currently implementing the approved Site Management Plan (SMP), dated December 2019, prepared by AMC Engineering PLLC (AMC). The purpose of the Soil Vapor Intrusion (SVI) investigation was to determine if the existing Soil Vapor Extraction (SVE) system can be shut down. The Sub-Slab Depressurization System (SSDS) will remain active at the Site to mitigate the potential for soil vapor intrusion. This report presents GZA's field observations, sampling results, and findings.

The SVI Report was prepared in general accordance with the New York State Department of Health (NYSDOH) Final Guidance for Evaluating Soil Vapor Intrusion in the State of New York (SVI Guidance), dated October 2006, amended May 2017 and February 2024. The SVI Investigation was conducted in accordance with the New York State Department of Environmental Conservation (NYSDEC) approved SVI Work Plan (SVIWP) dated February 2025 (see **Appendix A**).



Based on the results of the SVI investigation and pre-carbon/influent SVE system soil vapor data, GZA will evaluate the results to see if the SVE can be shut down, leaving the SSDS as the sole form of vapor mitigation.

ENGINEERING CONTROLS

Engineering controls installed at the Site pertinent to this SVI Report are as follows.

Onsite SVE System

The onsite SVE system was installed in December 2017 to remediate the petroleum contaminated soil in the unsaturated zone beneath the building. The layout of the SVE system is shown in **Figure 3**.

The SVE system effluent, both before and after treatment, is sampled on a quarterly basis. Initial concentrations in the influent air samples reported a total Petroleum-related Volatile Organic Compounds (PVOC) concentration of 162,139.11 micrograms per cubic meter ($\mu\text{g}/\text{m}^3$), a total Chlorinated VOC (CVOC) concentration of 3,592.66 $\mu\text{g}/\text{m}^3$ and a total VOC concentration of 165,731.77 $\mu\text{g}/\text{m}^3$. A significant and steady decrease in total VOC concentrations have continued over time.

The January, June, and September 2024 influent analytical results reported total PVOC concentrations ranging from 3.56 $\mu\text{g}/\text{m}^3$ – 8.00 $\mu\text{g}/\text{m}^3$, total CVOC concentrations ranging from 53.19 $\mu\text{g}/\text{m}^3$ – 2,539.80 $\mu\text{g}/\text{m}^3$, and total VOC concentrations ranging from 126.55 $\mu\text{g}/\text{m}^3$ – 2,948.76 $\mu\text{g}/\text{m}^3$. These results demonstrate a 98.81% reduction in total VOCs and BTEX compounds in the SVE system influent since December 2017. A corresponding reduction in VOCs in soil vapor as well as in soil within the unsaturated zone is expected. The results of the quarterly sampling are summarized in the Site's Periodic Review Reports (PRRs).

On-site SSDS

Piping associated with the SSDS was installed beneath the cellar slab of the current building. The SSDS consists of three loops which are outfitted with a collection point and riser, which extends to the roof. During the recent reporting period, it was determined that the three SSDS effluent pipes were outfitted with blowers and supplied with power. According to the latest PRR, dated March 2024, the SSDS was unintentionally running and has been operating since the repair of the SVE blower in 2021.

SOIL VAPOR INTRUSION INVESTIGATION

Indoor Air and Ambient Air Sampling

The SVI investigation was conducted on March 24-25, 2025, during the 2024-2025 heating season. Prior to sample collection, the onsite SVE system was shut down on February 5, 2025. GZA collected a total of eight indoor air samples (IA-01 through IA-08) in the onsite building basement, along with an ambient outdoor air sample (OA-01). Indoor air sample IA-06 was compromised and could not be analyzed. It was reported to GZA that IA-06 was received by the laboratory with the valve open on the regulator, compromising the sample. Additionally, IA-05's ending vacuum pressure was 0" Hg due to a field error. A NYSDOH Indoor Air Quality Questionnaire, which includes a product inventory of all chemicals observed in the building, was completed prior to sampling and is included as **Appendix B**.

IA-01 was placed in the laundry room located in the northwestern portion of the property. IA-02 and IA-07 were positioned in the western portion of the property. IA-03 was placed in the storage room. IA-04 was



placed in the compactor room, where the SVE system is located. IA-08 was placed near the SSDS system riser in the eastern portion of the basement. Both IA-05 and its duplicate were placed in the southwestern portion of the basement near the entrance to the boiler room. Lastly, an outdoor ambient air sample (OA-01) was collected on the first floor (ground level) outdoor area, where the SSDS riser pipes are located. The locations of all samples are shown in **Figure 4**.

Indoor and ambient air samples were collected concurrently at a height of three to six feet above the floor to represent the breathing zone. Sampling was conducted over a 24-hour period to represent residential use of the current building. The 6-liter SUMMA canisters, equipped with 24-hour regulators for both indoor and outdoor air samples, were set to limit the sample collection rate to 0.2 liters per minute, ensuring consistent flow throughout the entire sampling event. The canisters were then submitted to York Laboratories, a NYSDOH-ELAP certified laboratory, for VOC analysis via EPA Method TO-15 under chain-of-custody documentation. The soil vapor sampling log is included in **Appendix C**, and representative photographs of the field investigation activities are provided in **Appendix D**.

PRESSURE FIELD TESTING

As requested by the NYSDEC and NYSDOH, pressure field testing was conducted as part of the investigation to evaluate if the existing SSDS is maintaining a pressure field beneath the concrete slab and vapor barrier. Field readings for the existing manometric gauges showed pressure readings at each of the three riser locations of 1.80, 1.76, and 1.75 inches of water at the time of the investigation. The SVE inspection form can be found in **Appendix E**.

RESULTS

The analytical results for the samples that GZA collected during the SVI investigation activities are discussed below and summarized in **Table 1**. Laboratory reports are provided in **Appendix F**.

The indoor air and ambient air analytical results were evaluated against the USEPA Method TO-15 Compound List.

- Low level concentrations of VOCs, including 1,2,4-trimethylbenzene (max of $1.6 \mu\text{g}/\text{m}^3$), 2,2,4-trimethylpentane (max of $1.7 \mu\text{g}/\text{m}^3$), benzene (max of $2.6 \mu\text{g}/\text{m}^3$), ethylbenzene (max of $3.4 \mu\text{g}/\text{m}^3$), n-heptane (max of $0.96 \mu\text{g}/\text{m}^3$), n-hexane (max of $1.9 \mu\text{g}/\text{m}^3$), o-xylene (max of $2.9 \mu\text{g}/\text{m}^3$), p- & m-xylenes (max of $12 \mu\text{g}/\text{m}^3$), tetrachloroethylene (max of $8.9 \mu\text{g}/\text{m}^3$), and toluene (max of $14 \mu\text{g}/\text{m}^3$), were detected above the reported detection limit in all indoor and outdoor air samples.
- 1,3,5-Trimethylbenzene ($0.7 \mu\text{g}/\text{m}^3$) and methylene chloride ($14 \mu\text{g}/\text{m}^3$) were only detected above the reported detection limit in IA-04, and naphthalene ($1.8 \mu\text{g}/\text{m}^3$) was only detected above the reported detection limit in IA-08.
- Carbon tetrachloride (max of $0.54 \mu\text{g}/\text{m}^3$) was detected above the reported detection limit in all indoor and outdoor samples excluding IA-07
- Cyclohexane (max of $0.58 \mu\text{g}/\text{m}^3$) was detected above the reported detection limit in IA-02, IA-03, IA-04, IA-05, IA-05 Duplicate, IA-08, and OA-01.
- Trichloroethylene (maximum of $0.58 \mu\text{g}/\text{m}^3$) was detected above the reported detection limit in IA-03,



IA-05, IA-05 Duplicate, and OA-01.

- 1,1,1-Trichloroethane, 1,1-dichloroethylene, and vinyl chloride were not detected above the reported detection limit in any of the samples.

FINDINGS AND RECOMMENDATIONS

The findings of GZA's SVI Investigation are summarized below:

- The indoor air analytical results for IA-01 through IA-05, IA-07 and IA-08 did not identify VOCs at concentrations exceeding the NYSDOH Air Guidance Values.
- The outdoor ambient air analytical results for OA-01 did not identify VOCs at concentrations exceeding the NYSDOH Air Guidance Values.

Based on the findings of this SVI investigation and significant decrease in VOC concentrations measured over time, we recommend that the SVE system be shut down, and the SSDS will remain active at the Site to mitigate the potential for soil vapor intrusion.

Should you have any questions, please contact Mark Hutson at (646) 929-8955 or Mark.Hutson@gza.com.

Very truly yours,

GZA GEOENVIRONMENTAL OF NEW YORK

Mark Hutson, P.G.
Senior Project Manager

Robert Jackson, P.E.
Consultant Reviewer

Victoria Whelan, P.G.
Vice President

FIGURES:

Figure 1 – Site Location Map

Figure 2 – Site Plan

Figure 3 – SVE Layout

Figure 4 – Sample Location Map

TABLE:



Table 1 – Soil Vapor Analytical Results

ATTACHMENTS:

Appendix A – Soil Vapor Intrusion Work Plan

Appendix B – Department of Health Indoor Air Quality Questionnaire

Appendix C – Soil Vapor Sampling Logs

Appendix D – Photographic Log

Appendix E – Field Inspection Forms


Appendix F – Laboratory Analytical Reports





October 17, 2025
Soil Vapor Intrusion Investigation Report
1107 Dekalb Avenue, NY
File No. 41.0163281.10

FIGURES



NEW YORK  QUADRANGLE LOCATION	SOURCE: USGS TOPOGRAPHIC MAPS: NY (2023). CONTOUR INTERVAL 10FT., NAVD-1988, ORIGINAL SCALE 1:24,000 (1IN.=2,000FT.). 																		
UNLESS SPECIFICALLY STATED BY WRITTEN AGREEMENT, THIS DRAWING IS THE SOLE PROPERTY OF GZA GEOENVIRONMENTAL, INC. (GZA). THE INFORMATION SHOWN ON THE DRAWING IS SOLELY FOR USE BY GZA'S CLIENT OR THE CLIENT'S DESIGNATED REPRESENTATIVE FOR THE SPECIFIC PROJECT AND LOCATION IDENTIFIED ON THE DRAWING. THE DRAWING SHALL NOT BE TRANSFERRED, REUSED, COPIED, OR ALTERED IN ANY MANNER FOR USE AT ANY OTHER LOCATION OR FOR ANY OTHER PURPOSE WITHOUT THE PRIOR WRITTEN CONSENT OF GZA. ANY TRANSFER, REUSE, OR MODIFICATION TO THE DRAWING BY THE CLIENT OR OTHERS, WITHOUT THE PRIOR WRITTEN EXPRESS CONSENT OF GZA, WILL BE AT THE USER'S SOLE RISK AND WITHOUT ANY RISK OR LIABILITY TO GZA.																			
11-07 DEKALB AVENUE, BROOKLYN, NY	PREPARED BY:  GZA GeoEnvironmental of NY Engineers and Scientists www.gza.com PREPARED FOR: ABC NY																		
SITE LOCATION MAP	<table><tr><td>PROJ MGR:</td><td>MH</td><td>REVIEWED BY:</td><td>MH</td><td>CHECKED BY:</td><td>VW</td></tr><tr><td>DESIGNED BY:</td><td>SG</td><td>DRAWN BY:</td><td>SG</td><td>SCALE:</td><td>N.T.S</td></tr><tr><td>DATE:</td><td>JUNE 2025</td><td>PROJECT NO.</td><td>41.0163281.10</td><td>REVISION NO.</td><td>-</td></tr></table> FIGURE 1 SHEET NO. 1 OF 1	PROJ MGR:	MH	REVIEWED BY:	MH	CHECKED BY:	VW	DESIGNED BY:	SG	DRAWN BY:	SG	SCALE:	N.T.S	DATE:	JUNE 2025	PROJECT NO.	41.0163281.10	REVISION NO.	-
PROJ MGR:	MH	REVIEWED BY:	MH	CHECKED BY:	VW														
DESIGNED BY:	SG	DRAWN BY:	SG	SCALE:	N.T.S														
DATE:	JUNE 2025	PROJECT NO.	41.0163281.10	REVISION NO.	-														

©2022 – GZA GeoEnvironmental of NY.
GZA-J:\Active 163200 to 163299\163281.00 – 1107 Dekalb GWS and Periodic Review Report\Drawings\GZA CAD\163281.00 Site Plan.dwg [Fig 4 – MW] February 06, 2025 – 4:11pm Jazlyn.Natalie

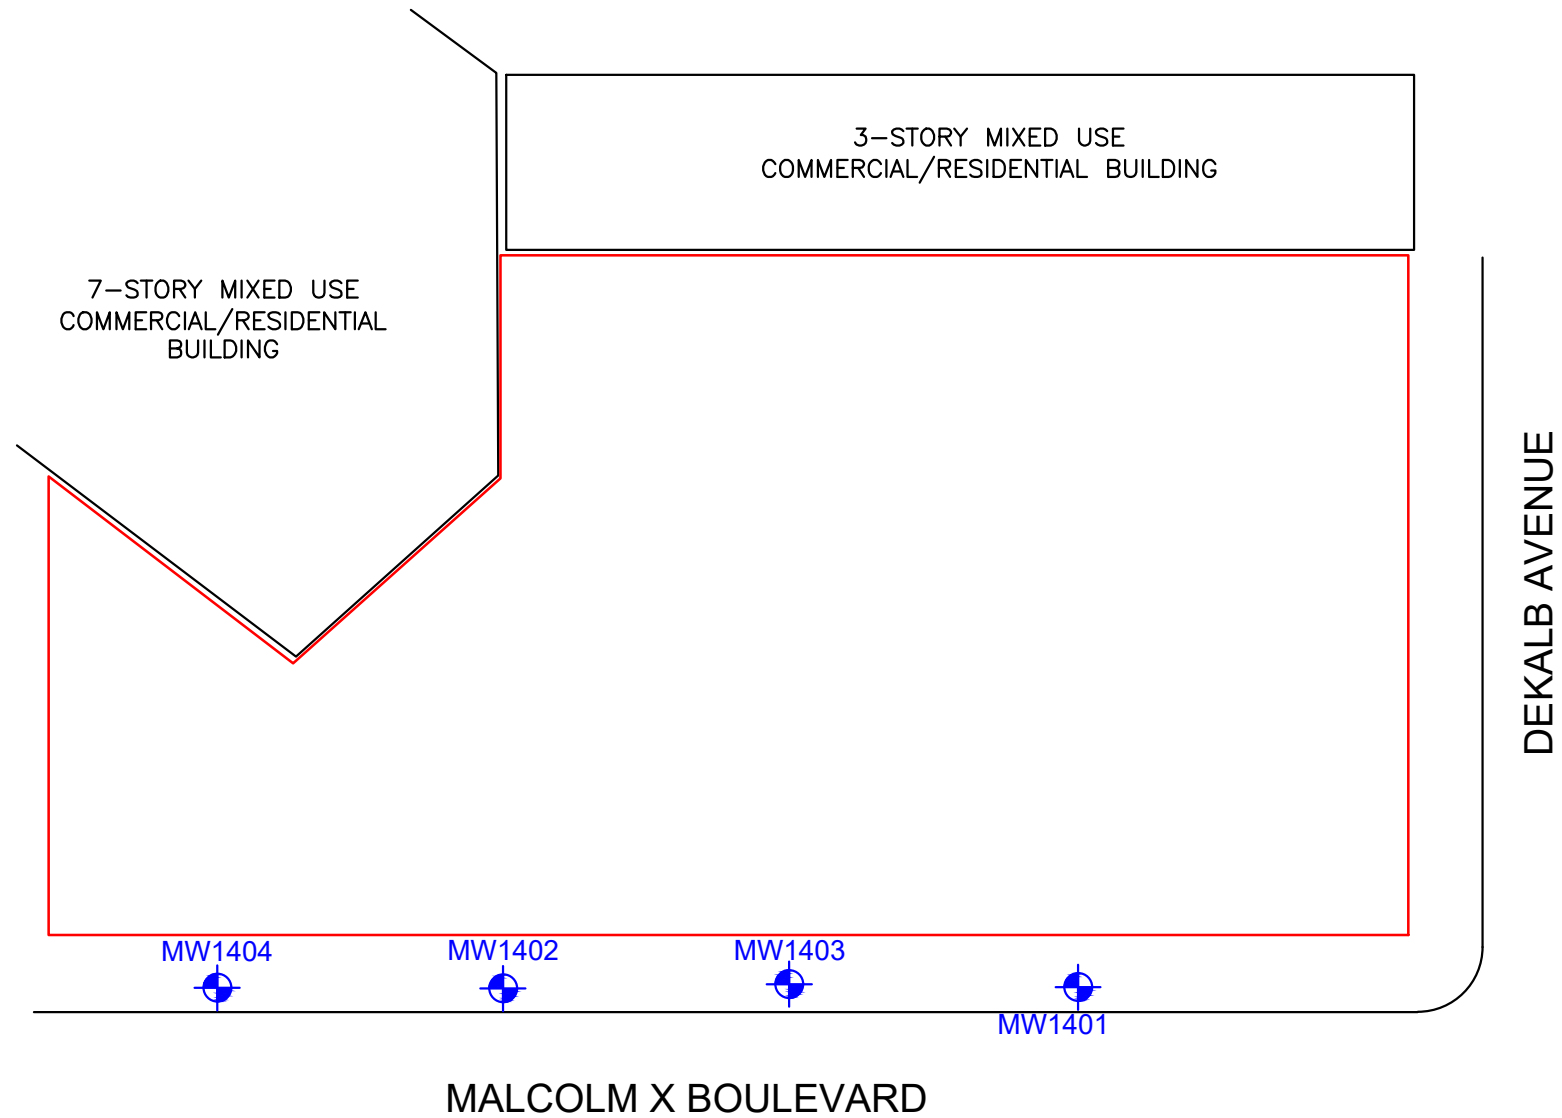

GENERAL NOTES

- 1. BASE MAP DEVELOPED FROM DRAWING TITLED "ENGINEERING CONTROLS – SVE SYSTEM" PREPARED BY "AMC ENGINEERING, PLLC", ORIGINAL SCALE 1" = 25', DATED OCTOBER 17, 2019.
- 2. EXPLORATION LOCATIONS SHOWN ARE BASED ON TAPE MEASUREMENTS FROM TOPOGRAPHICAL FEATURES. THE LOCATIONS SHOULD BE CONSIDERED ACCURATE ONLY TO THE DEGREE IMPLIED BY THE METHOD USED.


LEGEND

- APPROXIMATE SITE BOUNDARY
- APPROXIMATE MONITORING WELL LOCATION



NO.	ISSUE/DESCRIPTION	BY	DATE
UNLESS SPECIFICALLY STATED BY WRITTEN AGREEMENT, THIS DRAWING IS THE SOLE PROPERTY OF GZA GEORENIRONMENTAL, INC. (GZA). THE INFORMATION SHOWN ON THE DRAWING IS SOLELY FOR USE BY GZA'S CLIENT OR THE CLIENT'S DESIGNATED REPRESENTATIVE FOR THE SPECIFIC PROJECT AND LOCATION IDENTIFIED ON THE DRAWING. THE DRAWING SHALL NOT BE TRANSFERRED, REUSED, COPIED, OR ALTERED IN ANY MANNER FOR USE AT ANY OTHER LOCATION OR FOR ANY OTHER PURPOSE WITHOUT THE PRIOR WRITTEN CONSENT OF GZA. ANY TRANSFER, REUSE, OR MODIFICATION TO THE DRAWING BY THE CLIENT OR OTHERS, WITHOUT THE PRIOR WRITTEN EXPRESS CONSENT OF GZA, WILL BE AT THE USER'S SOLE RISK AND WITHOUT ANY RISK OR LIABILITY TO GZA.			
11-07 DEKALB AVENUE, BROOKLYN, NY			
SITE PLAN			
PREPARED BY: GZA GeoEnvironmental of NY Engineers and Scientists www.gza.com		PREPARED FOR: ABC NY	
PROJ MGR: MH	REVIEWED BY: MH	CHECKED BY: VW	FIGURE 2 SHEET NO. 1 OF 1
DESIGNED BY: SG	DRAWN BY: SG	SCALE: 1" = 20'	
DATE: JUNE 2025	PROJECT NO. 41.0163281.10	REVISION NO. -	

©2022 – GZA GeoEnvironmental of NY.
GZA-J:\Active 163200 to 163299\163281.00 – 1107 Dekalb GWS and Periodic Review Report\Drawings\GZA CAD\163281.00.dwg [Fig 3 – SVE] December 09, 2024 – 11:37am Sella.Gupta

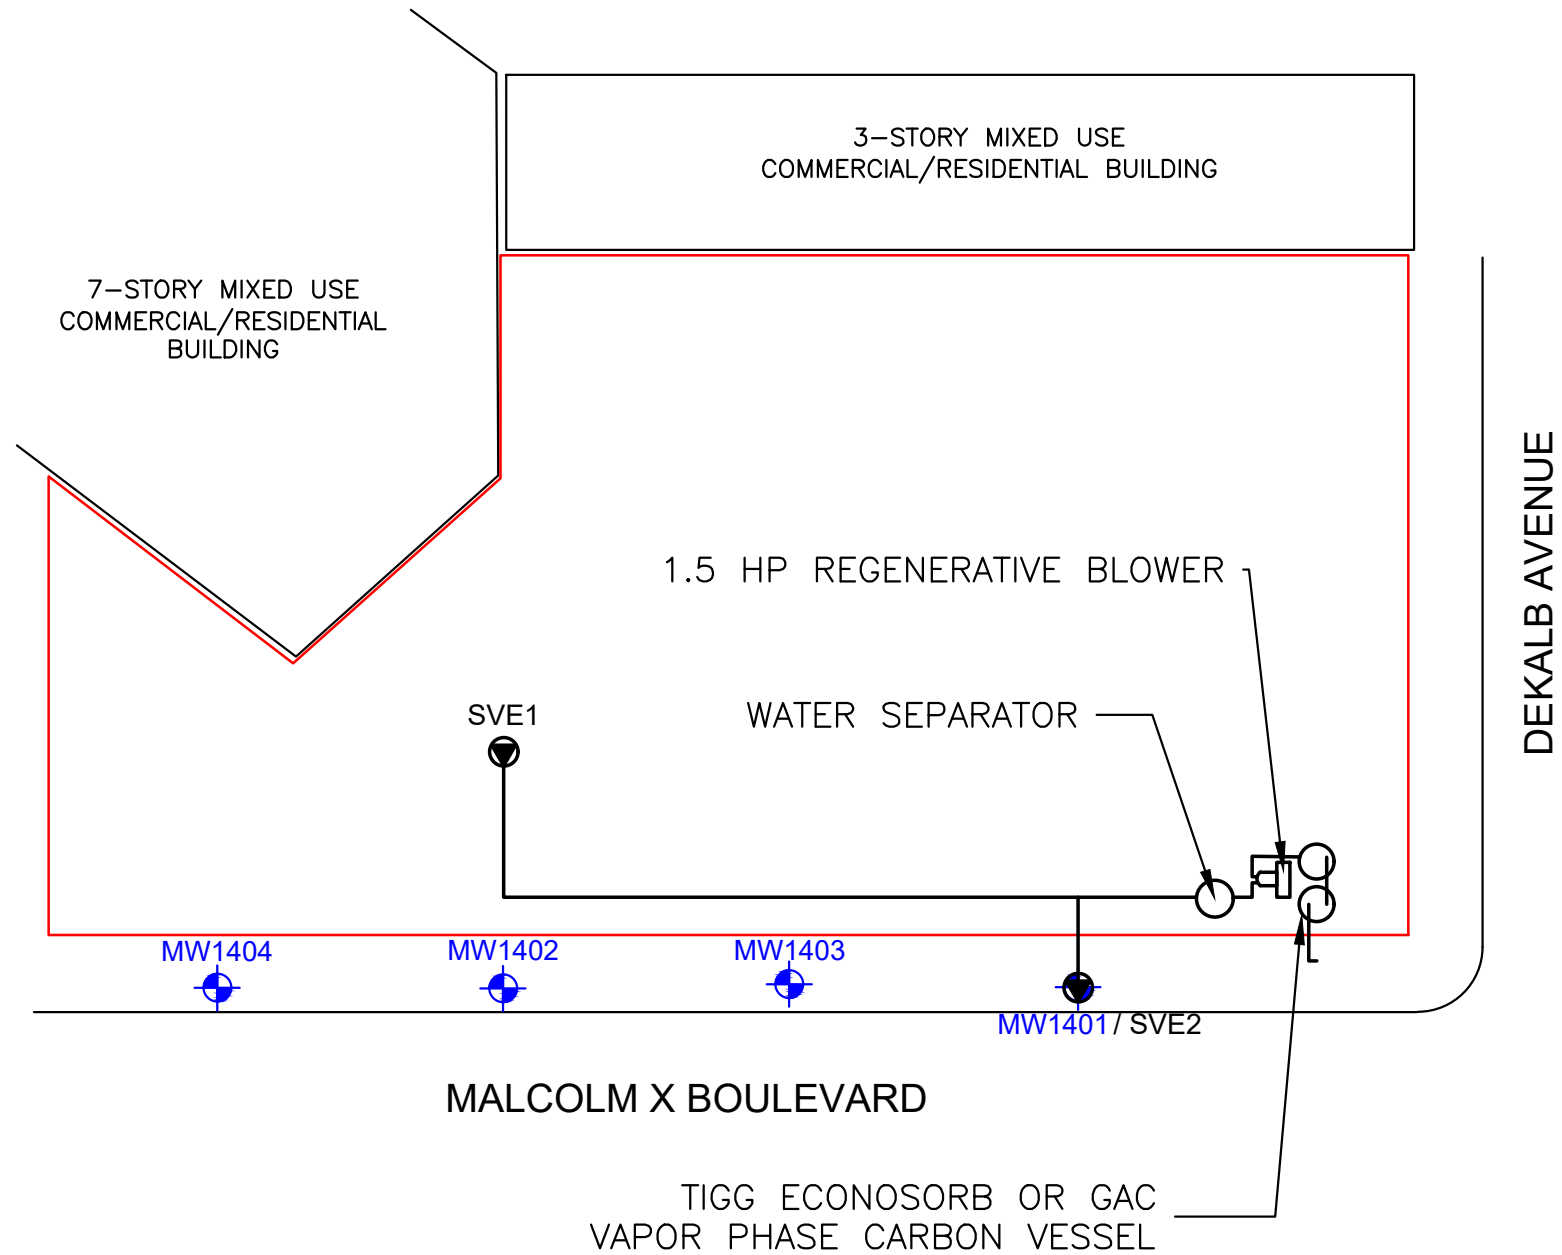


GENERAL NOTES

1. BASE MAP DEVELOPED FROM DRAWING TITLED "ENGINEERING CONTROLS – SVE SYSTEM" PREPARED BY "AMC ENGINEERING, PLLC", ORIGINAL SCALE 1" = 25', DATED OCTOBER 17, 2019.
2. EXPLORATION LOCATIONS SHOWN ARE BASED ON TAPE MEASUREMENTS FROM TOPOGRAPHICAL FEATURES. THE LOCATIONS SHOULD BE CONSIDERED ACCURATE ONLY TO THE DEGREE IMPLIED BY THE METHOD USED.
3. ELEVATIONS ARE REFERENCED TO THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88).



LEGEND

- APPROXIMATE SITE BOUNDARY
- MW1400  APPROXIMATE MONITORING WELL LOCATION
- SVE1  APPROXIMATE VAPOR EXTRACTION WELL



NO.	ISSUE/DESCRIPTION	BY	DATE
UNLESS SPECIFICALLY STATED BY WRITTEN AGREEMENT, THIS DRAWING IS THE SOLE PROPERTY OF GZA. GEOENVIRONMENTAL, INC. (GZA). THE INFORMATION SHOWN ON THE DRAWING IS SOLELY FOR USE BY GZA'S CLIENT OR THE CLIENT'S DESIGNATED REPRESENTATIVE FOR THE SPECIFIC PROJECT AND LOCATION IDENTIFIED ON THE DRAWING. THE DRAWING SHALL NOT BE TRANSFERRED, REUSED, COPIED, OR ALTERED IN ANY MANNER FOR USE AT ANY OTHER LOCATION OR FOR ANY OTHER PURPOSE WITHOUT THE PRIOR WRITTEN CONSENT OF GZA. ANY TRANSFER, REUSE, OR MODIFICATION TO THE DRAWING BY THE CLIENT OR OTHERS, WITHOUT THE PRIOR WRITTEN EXPRESS CONSENT OF GZA, WILL BE AT THE USER'S SOLE RISK AND WITHOUT ANY RISK OR LIABILITY TO GZA.			
11-07 DEKALB AVENUE, BROOKLYN, NY			
SOIL VAPOR EXTRACTION LAYOUT			
PREPARED BY:  GZA GeoEnvironmental of NY Engineers and Scientists www.gza.com		PREPARED FOR: ABC NY	
PROJ MGR: MH	REVIEWED BY: MH	CHECKED BY: VW	FIGURE 3 SHEET NO. 1 OF 1
DESIGNED BY: SG	DRAWN BY: SG	SCALE: 1" = 20'	
DATE: JUNE 2025	PROJECT NO. 41.0163281.00	REVISION NO. -	

©2022 – GZA GeoEnvironmental of NY.
GZA-J:\Active 163200 to 163299\163281.10 – 1107 Dekalb – Well Installation and SV\Drawings\GZA CAD\41.0163281.10 Sample Location-jn.dwg [FIG 2 – Sample Location] May 21, 2025 – 1:42pm Jazlyn-Natalie

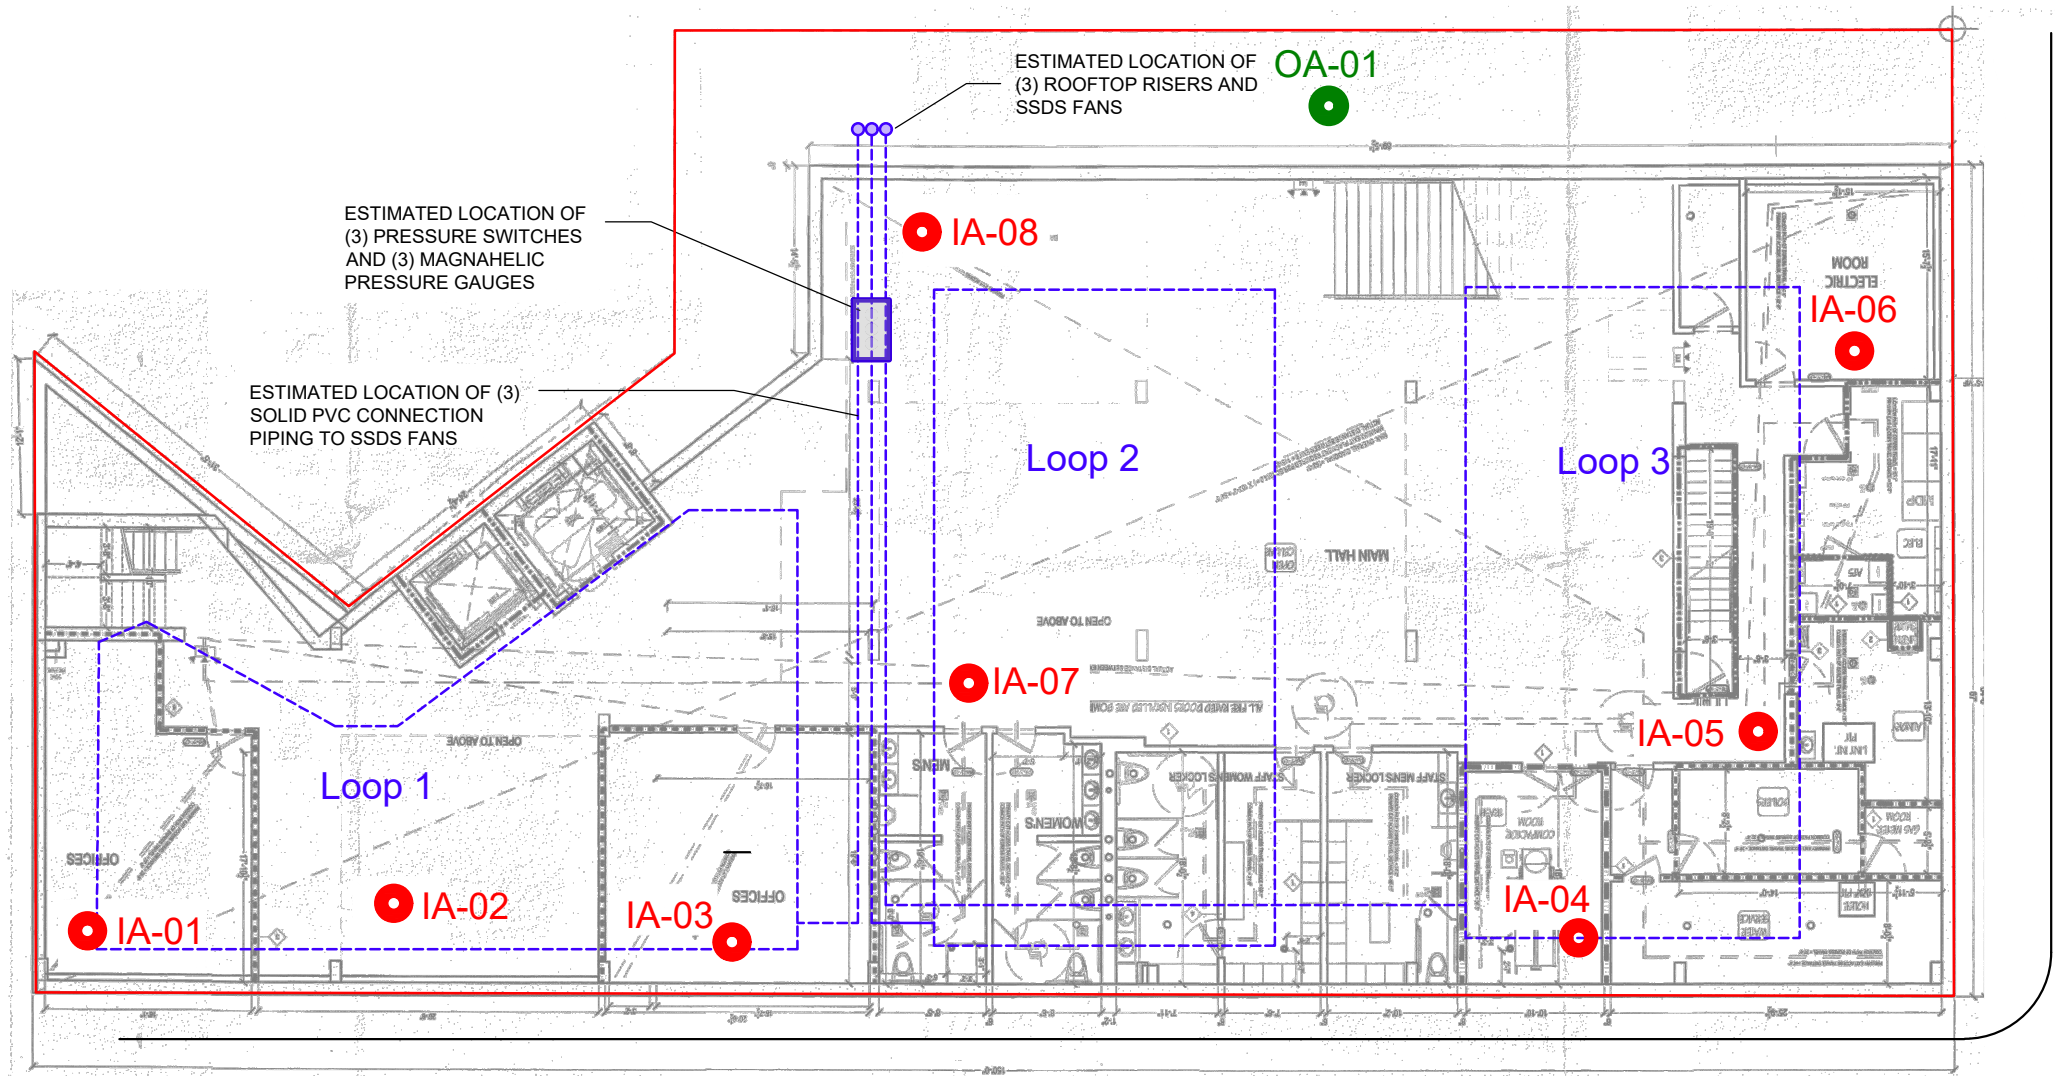


GENERAL NOTES

1. BASE MAP DEVELOPED FROM DRAWING TITLED "SSDS LAYOUT 11-07 DEKALB AVENUE BROOKLYN, NY", PREPARED BY "TYLL ENGINEERING & CONSULTING PC", ORIGINAL SCALE 1" = 25', DATED MARCH 7, 2024.
2. EXPLORATION LOCATIONS SHOWN ARE BASED ON TAPE MEASUREMENTS FROM TOPOGRAPHICAL FEATURES. THE LOCATIONS SHOULD BE CONSIDERED ACCURATE ONLY TO THE DEGREE IMPLIED BY THE METHOD USED.
3. ELEVATIONS ARE REFERENCED TO THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88).

LEGEND

- APPROXIMATE SITE BOUNDARY
- - - APPROXIMATE LOCATION OF 4" PERFORATED PVC PIPING
- APPROXIMATE RISER LOCATIONS
- IA-01 APPROXIMATE INDOOR AIR SAMPLING LOCATION
- OA-01 APPROXIMATE OUTDOOR AMBIENT AIR SAMPLING LOCATION

NO.		ISSUE/DESCRIPTION	BY	DATE
UNLESS SPECIFICALLY STATED BY WRITTEN AGREEMENT, THIS DRAWING IS THE SOLE PROPERTY OF GZA GEOTECHNICAL, INC. (GZA). THE INFORMATION SHOWN ON THE DRAWING IS SOLELY FOR USE BY GZA'S CLIENT OR THE CLIENT'S DESIGNATED REPRESENTATIVE FOR THE SPECIFIC PROJECT AND LOCATION IDENTIFIED ON THE DRAWING. THE DRAWING SHALL NOT BE TRANSFERRED, REUSED, COPIED, OR ALTERED IN ANY MANNER FOR USE AT ANY OTHER LOCATION OR FOR ANY OTHER PURPOSE WITHOUT THE PRIOR WRITTEN CONSENT OF GZA. ANY TRANSFER, REUSE, OR MODIFICATION TO THE DRAWING BY THE CLIENT OR OTHERS, WITHOUT THE PRIOR WRITTEN EXPRESS CONSENT OF GZA, WILL BE AT THE USER'S SOLE RISK AND WITHOUT ANY RISK OR LIABILITY TO GZA.				
11-07 DEKALB AVENUE, BROOKLYN, NY				
SAMPLE LOCATION MAP				
PREPARED BY:  GZA GeoEnvironmental of NY Engineers and Scientists www.gza.com			PREPARED FOR: ABC NY	
PROJ MGR: MH	REVIEWED BY: MH	CHECKED BY: VW	FIGURE	
DESIGNED BY: SG	DRAWN BY: SG	SCALE: 1" = 15'	4	
DATE: JUNE 2025	PROJECT NO. 41.0163281.10	REVISION NO. -	SHEET NO. 1 OF 1	





TABLE

Table 1
Soil Vapor Analytical Results
SVI Report
1103-1107 Dekalb Avenue
Brooklyn, New York

SAMPLE LOCATION	IA-01		IA-02		IA-03		IA-04		IA-05		IA-05- Duplicate		IA-07		IA-08		OA-01	
LABORATORY SAMPLE ID	25C1573-01		25C1573-02		25C1573-03		25C1573-04		25C1573-05		25C1573-06		25C1573-08		25C1573-09		25C1573-10	
SAMPLING DATE	5/23/2023		5/23/2023		5/23/2023		5/23/2023 9:33:00		5/23/2023 9:33:00		5/23/2023 9:33:00		5/23/2023		5/23/2023 9:30:00		5/23/2023 10:23:00	
SAMPLE TYPE	Indoor Ambient Air		Indoor Ambient Air		Indoor Ambient Air		Indoor Ambient Air		Indoor Ambient Air		Indoor Ambient Air		Indoor Ambient Air		Indoor Ambient Air		Outdoor Ambient Air	
	Results	Qual	Results	Qual	Results	Qual	Results	Qual	Results	Qual	Results	Qual	Results	Qual	Results	Qual	Results	Qual
Volatile Organics in Air by TO-15 (µg/m³)																		
1,1,1,2-Tetrachloroethane	0.71	U	0.59	U	0.68	U	0.66	U	0.5	U	0.51	U	0.71	U	0.68	U	0.57	U
1,1,1-Trichloroethane	0.57	U	0.47	U	0.54	U	0.52	U	0.4	U	0.41	U	0.56	U	0.54	U	0.46	U
1,1,2,2-Tetrachloroethane	0.71	U	0.59	U	0.68	U	0.66	U	0.5	U	0.51	U	0.71	U	0.68	U	0.57	U
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	0.79	U	0.66	U	0.76	U	0.73	U	0.56	D	0.68	D	0.79	U	0.76	U	0.64	U
1,1,2-Trichloroethane	0.57	U	0.47	U	0.54	U	0.52	U	0.4	U	0.41	U	0.56	U	0.54	U	0.46	U
1,1-Dichloroethane	0.42	U	0.35	U	0.4	U	0.39	U	0.3	U	0.3	U	0.42	U	0.4	U	0.34	U
1,1-Dichloroethylene	0.1	U	0.086	U	0.098	U	0.095	U	0.073	U	0.074	U	0.1	U	0.098	U	0.083	U
1,2,4-Trichlorobenzene	0.77	U	0.64	U	0.73	U	0.71	U	0.54	U	0.55	U	0.77	U	1.3	D	0.62	U
1,2,4-Trimethylbenzene	0.76	D	0.51	D	0.58	D	1.6	D	0.65	D	0.88	D	0.66	D	0.73	D	0.7	D
1,2-Dibromoethane	0.8	U	0.66	U	0.76	U	0.73	U	0.56	U	0.57	U	0.79	U	0.76	U	0.64	U
1,2-Dichlorobenzene	0.62	U	0.52	U	0.59	U	0.57	U	0.44	U	0.45	U	0.62	U	0.6	U	0.5	U
1,2-Dichloroethane	0.42	U	0.35	U	0.4	U	0.39	U	0.3	U	0.3	U	0.42	U	0.4	U	0.34	U
1,2-Dichloropropane	0.48	U	0.4	U	0.46	U	0.44	U	0.34	U	0.34	U	0.48	U	0.46	U	0.39	U
1,2-Dichlorotetrafluoroethane	0.72	U	0.6	U	0.69	U	0.67	U	0.51	U	0.52	U	0.72	U	0.69	U	0.59	U
1,3,5-Trimethylbenzene	0.51	U	0.42	U	0.49	U	0.7	D	0.36	U	0.37	U	0.51	U	0.49	U	0.41	U
1,3-Butadiene	0.69	U	0.57	U	0.66	U	0.63	U	0.49	U	0.49	U	0.69	U	0.66	U	0.56	U
1,3-Dichlorobenzene	0.62	U	0.52	U	0.59	U	0.57	U	0.44	U	0.45	U	0.62	U	0.6	U	0.5	U
1,3-Dichloropropane	0.48	U	0.4	U	0.46	U	0.44	U	0.34	U	0.34	U	0.48	U	0.46	U	0.39	U
1,4-Dichlorobenzene	0.62	D	0.52	U	0.59	U	0.57	D	0.53	D	0.45	U	0.62	U	0.72	D	0.5	U
1,4-Dioxane	0.75	U	0.62	U	0.71	U	0.69	U	0.53	U	0.54	U	0.74	U	0.71	U	0.6	U
2,2,4-Trimethylpentane	1.2	D	0.97	D	1.1	D	1.3	D	0.99	D	0.17	U	1.1	D	1	D	1.7	D
2-Butanone	1.8	D	1.9	D	1.8	D	3.2	D	1.2	D	3.5	D	1.8	D	2.7	D	1.7	D
2-Hexanone	0.85	U	0.71	U	0.81	U	0.78	U	0.6	U	0.61	U	0.85	U	0.81	U	0.69	U
3-Chloropropene	1.6	U	1.4	U	1.5	U	1.5	U	1.1	U	1.2	U	1.6	U	1.6	U	1.3	U
4-Methyl-2-pentanone	0.42	U	0.35	U	0.41	U	0.39	U	0.3	U	0.3	U	0.42	U	0.41	U	0.34	U
Acetone	32	D	45	D	54	D	96	D	34	D	17	D	33	D	96	D	16	D
Acrylonitrile	2.9	U	10	D	2.8	U	2.7	J	2.1	U	2.1	U	5.8	D	2.8	J	2.4	U
Benzene	1.3	D	1.6	D	1.1	D	1.1	D	1.5	D	0.97	D	2.6	D	1.2	D	1.6	D
Benzyl chloride	0.54	U	0.45	U	0.51	U	0.49	U	0.38	U	0.39	U	0.53	U	0.51	U	0.43	U
Bromodichloromethane	0.69	U	0.58	U	0.66	U	1.5	D	0.49	U	0.5	U	0.69	U	0.66	U	0.56	U
Bromoform	1.1	U	0.89	U	1	U	0.99	U	0.76	U	0.77	U	1.1	U	1	U	0.87	U
Bromomethane	0.4	U	0.34	U	0.38	U	0.37	U	0.28	U	0.29	U	0.4	U	0.39	U	0.33	U
Carbon disulfide	0.32	U	0.27	U	0.31	U	0.3	U	0.23	U	0.23	U	0.32	U	0.31	U	0.26	U
Carbon tetrachloride	0.46	D	0.38	D	0.37	D	0.54	D	0.42	D	0.51	D	0.16	U	0.37	D	0.37	D
Chlorobenzene	0.48	U	0.4	U	0.46	U	0.44	U	0.34	U	0.34	U	0.48	U	0.46	U	0.39	U
Chloroethane	0.27	U	0.23	U	0.26	U	0.25	U	0.19	U	0.2	U	0.27	U	0.26	U	0.22	U
Chloroform	2	D	1.3	D	1.9	D	27	D	6.6	D	1.2	D	1.8	D	1.7	D	0.5	D
Chloromethane	1.6	D	1.5	D	1.4	D	1.4	D	1.5	D	1.6	D	2.7	D	1.4	D	1.4	D
cis-1,2-Dichloroethylene	0.1	U	0.086	U	0.098	U	0.095	U	0.073	U	0.074	U	0.1	U	0.098	U	0.083	U
cis-1,3-Dichloropropylene	0.47	U	0.39	U	0.45	U	0.43	U	0.33	U	0.34	U	0.47	U	0.45	U	0.38	U
Cyclohexane	0.36	U	0.33	D	0.34	D	0.53	D	0.35	D	0.36	D	0.36	U	0.34	D	0.58	D
Dibromochloromethane	0.88	U	0.74	U	0.84	U	0.81	U	0.62	U	0.63	U	0.88	U	0.85	U	0.71	U
Dichlorodifluoromethane	2.5	D	2.4	D	2.3	D	2.5	D	2.5	D	3	D	2.6	D	2.6	D	2.6	D
Ethyl acetate	3.3	D	22	D	13	D	10	D	4.9	D	4.2	D	3.3	D	6.8	D	2.5	D
Ethyl Benzene	0.68	D	0.52	D	3.4	D	1.7	D	0.48	D	2.8	D	0.45	D	0.6	D	0.73	D
Hexachlorobutadiene	1.1	U	0.92	U	1.1	U	1	U	0.78	U	0.79	U	1.1	U	1.1	U	0.89	U
Isopropanol	47	D	38	D	38	D	29	D	7.2	D	26	D	38	D	37	D	6.1	D
Methyl Methacrylate	0.42	U	0.35	U	0.4	U	0.82	D	0.57	D	0.3	U	0.42	U	0.41	U	0.34	U
Methyl tert-butyl ether (MTBE)	0.37	U	0.31	U	0.36	U	0.34	U	0.26	U	0.27	U	0.37	U	0.36	U	0.3	U
Methylene chloride	2.2	U	1.8	J	2.1	U	14	D	1.5	J	1.6	J	2.2	J	2.1	J	1.7	J
Naphthalene	1.1	U	0.9	U	1	U	1	U	0.77	U	0.78	U	1.1	U	1.8	U	0.88	U
n-Heptane	0.85	D	0.81	D	0.73	D	1.3	D	0.6	D	0.46	D	0.8	D	0.77	D	0.96	D
n-Hexane	1.2	D	1.1	D	1.2	D	1.2	D	1	D	0.79	D	1.1	D	1	D	1.9	D
o-Xylene	1.2	D	0.75	D	1.5	D	2.9	D	0.67	D	2.7	D	0.72	D	0.9	D	0.91	D
p- & m- Xylenes	2.9	D	2	D	4	D	7.1	D	1.7	D	12	D	1.9	D	2.3	D	2.5	D
p-Ethyltoluene	0.61	D	0.42	D	0.53	D	1.4	D	0.54	D	0.66	D	0.51	U	0.54	D	0.62	D
Propylene	3	D	2.6	D	0.17	U	3	D	3.9	D	0.13	U	3.2	D	3	D	0.14	U
Styrene	0.44	U	0.37	U	8	D	0.41	U	0.31	U	0.32	U	0.44	U	0.42	U	0.36	U
Tetrachloroethylene	1.5	D	1.5	D	1.5	D	8.9	D	0.89	D	2.9	D	1.7	D	1.5	D	3.1	D
Tetrahydrofuran	0.61	U	0.64	D	0.64	D	1.1	D	0.52	D	2.4	D	0.61	U	0.59	U	0.49	U
Toluene	2.8	D	5.9	D	4	D	14	D	3.2	D	3.4	D	3	D	3.6	D	4.7	D
trans-1,2-Dichloroethylene	0.41	U	0.34	U	0.39	U	0.38	U	0.29	U	0.29	U	0.41	U	0.39	U	0.33	U
trans-1,3-Dichloropropylene	0.47	U	0.39	U	0.45	U	0.43	U	0.33	U	0.34	U	0.47	U	0.45	U	0.38	U
Trichloroethylene	0.14	U	0.12	U	0.16	D	0.13	U	0.28	D	0.12	D	0.14	U	0.13	U	0.58	D
Trichlorofluoromethane (Freon 11)	1.3	D	1.3	D	1.3	D	1.3	D	1.3	D	1.6	D	1.3	D	1.4	D	1.3	D
Vinyl acetate	0.37	U	0.3	U	0.35	U	0.34	U	0.26	U	0.26	U	0.36	U	0.35	U	0.29	U
Vinyl bromide	0.45	U	0.38	U	0.43	U	0.42	U	0.32	U	0.33	U	0.45	U	0.43	U	0.37	U
Vinyl Chloride	0.13	U	0.11	U	0.13	U	0.12	U	0.094	U	0.095	U	0.13	U	0.13	U	0.11	U

TABLE NOTES:

NYSDOH : New York State Department of Health.

D: Result is from an analysis that required a dilution

U : Analyte not detected at or above the level indicated

J : Analyte detected at or above the MDL (method detection limit) but below the RL (Reporting Limit) - data is estimated

ug/m³: micrograms per cubic meter.

Qual : Qualifiers.

- : This indicates that no regulatory limit has been established for this analyte



October 17, 2025
Soil Vapor **Intrusion** Investigation Report
1107 Dekalb Avenue, NY
File No. 41.0163281.10

ATTACHMENT A



February 7, 2025

Ms. Marlen Salazar
New York State Department of Environmental Conservation
Division of Environmental Remediation
47-40 21st Street
Long Island City, NY, 11101

Re: Soil Vapor Investigation Work Plan
1107 Dekalb Avenue
Brooklyn, New York
NYSDEC BCP Site No. C224176

Dear Ms. Salazar:

Tyll Engineering and Consulting PC (TEC) and GZA GeoEnvironmental of New York (GZA) are pleased to provide this Soil Vapor Intrusion Work Plan (SVIWP) for the above-referenced property (Site). The SVIWP was prepared in general accordance with the NYSDOH Final Guidance for Evaluating Soil Vapor Intrusion in the State of New York (SVI Guidance), dated October 2006, as amended May 2017 and February 2024.

1.0 INTRODUCTION

ABC NY (the Client) retained TEC and GZA to prepare a Soil Vapor Intrusion Work Plan (SVIWP) at 1107 Dekalb Avenue, Brooklyn, NY (Site). This SVIWP has been prepared in accordance with the NYSDOH Final Guidance for Evaluating Soil Vapor Intrusion in the State of New York (SVI Guidance), dated October 2006, as amended May 2017 and February 2024. The Site is currently enrolled in the New York State Department of Environmental Conservation (NYSDEC) Brownfield Cleanup Program (BCP), NYSDEC Site No. C224176 and the Site was remediated in accordance with the Brownfield Cleanup Agreement (BCA) No. C224176-05-13. The Site is currently in the site management phase of the project and implementing the approved Site Management Plan (SMP), dated December 2019, prepared by AMC Engineering PLLC (AMC). The proposed scope of work discussed in this SVIWP will be conducted in accordance with the SMP prepared by AMC, and the results of the SVI investigation, proposed herein, will evaluate if the existing Soil Vapor Extraction (SVE) system can be shut down.

1.1 SITE LOCATION AND CURRENT USE

The Site is approximately 0.22-acres (9,530-square feet [s.f.]) in size and is identified on the Brooklyn County Tax Map as Block 1600 – Lot 7521. The Site is located on the northeast corner of DeKalb Avenue and Malcolm X Boulevard. A Site Location Map is included as **Figure 1**. The Site is currently improved with an 8-story mixed-use building with a partial below grade cellar that includes storage, mechanical rooms, and retail/commercial space. A Site Plan is included as **Figure 2**.

1.2 SITE REMEDIAL HISTORY

Engineering controls installed at the Site pertinent to this SVIWP are as follows.



Onsite SVE System

According to the SMP, the onsite SVE system was installed in December 2017 to remediate the petroleum contaminated soil in the unsaturated zone from a depth of 15-feet to the groundwater table. The layout of the SVE system is shown in **Figure 3**.

The SVE system effluent, both before and after treatment, is sampled on a quarterly basis. Initial concentrations in the influent air stream reported a total PVOC concentration of 162,139.11 micrograms per cubic meter ($\mu\text{g}/\text{m}^3$), a total CVOC concentration of 3,592.66 $\mu\text{g}/\text{m}^3$ and a total VOC concentration of 165,731.77 $\mu\text{g}/\text{m}^3$. A significant and steady decrease of total VOC concentrations have continued over time. The January, June, and September 2024 influent analytical results reported total PVOC concentrations ranging from 3.56 $\mu\text{g}/\text{m}^3$ – 8.00 $\mu\text{g}/\text{m}^3$, total CVOC concentrations ranging from 53.19 $\mu\text{g}/\text{m}^3$ – 2,539.80 $\mu\text{g}/\text{m}^3$, and total VOC concentrations ranging from 126.55 $\mu\text{g}/\text{m}^3$ – 2,948.76 $\mu\text{g}/\text{m}^3$. These results demonstrate a 98.81% reduction in total VOCs and BTEX compounds in the SVE system influent since December 2017. A corresponding reduction in VOCs in soil vapor as well as in soil within the unsaturated zone is expected. The results of the quarterly sampling are summarized in the Site's Periodic Review Reports (PRRs).

Onsite SSDS

Piping associated with the Sub-Slab Depressurization System (SSDS) was installed beneath the cellar slab of the current building, in the event that an SSDS system was required. The SSDS consists of three loops which are outfitted with a collection point and riser, which extends to the roof. During the recent reporting period, it was determined that the three SSDS effluent pipes were outfitted with blowers and supplied with power. According to the latest PRR, dated March 2024, it appears that the SSDS was unintentionally left running by EBC and has been running to date after a repair of the SVE blower in 2021.

After discussion with the NYSDEC, it was decided that the SSDS will be left on, and an SVI evaluation will be conducted to determine if any mitigation measures are necessary to eliminate potential exposures to vapors in the structure. Based on the results of the SVI investigation and pre-carbon/influent SVE system soil vapor data, GZA will evaluate the results to see if the SVE can be shut down, leaving the SSDS as the sole form of vapor mitigation.

2.0 SOIL VAPOR INTRUSION INVESTIGATION

2.1 OBJECTIVES

The objectives of the evaluation are to:

1. Evaluate the soil vapor/indoor air at the Site; and,
2. Obtain the necessary information to determine if further mitigation is warranted or if the SVE system can be turned off.

2.2 INDOOR AIR AND AMBIENT AIR SAMPLING

The SVI Investigation will be completed during the 2024-2025 heating season which is from November 15, 2024 to March 31, 2025. Prior to sample collection, the onsite SVE system will be shut down for 30 days.



The SVE system was shut off on February 5, 2025 and. A Product Inventory Survey will be completed of all chemicals readily observed and identified in the building prior to sampling.

GZA proposes to collect three indoor air samples within the onsite building basement. In addition, one ambient air sample will be collected in an upwind portion of the Site, outside of the onsite building. Indoor air and ambient air samples will be collected concurrently at three to five feet above the ground in order to represent the breathing zone. The SUMMA canister regulators for indoor air and outdoor air samples will be set to restrict the sample collection not to exceed 0.2 liters per minute; flow rate will be consistent across the entire duration of the sampling event; over a 24-hour time period. The SUMMA canisters will be submitted to a NYSDOH-certified laboratory for analysis of VOCs via EPA Method TO-15 with a request for low-level reporting limits under chain-of-custody documentation. The proposed indoor air and ambient air sampling locations are depicted on **Figure 4**. The actual location may vary based on field conditions.

2.3 SAMPLING QA/QC PROTOCOL

During this round of sampling, the following samples will be collected for QA/QC purposes:

- One duplicate sample

The samples will be analyzed for Category B deliverables and reviewed by a third party to generate a Data Usability Report (DUSR).

A sample log sheet will be completed for each sample summarizing the following:

- Sample identification;
- Date and time of the sample collection;
- Sampling height;
- Identity of samplers;
- Sampling method and devices;
- If canisters used, the vacuum before and after samples collected;
- Apparent moisture content (dry, moist, saturated, etc.) of the sampling zone;
- Local condition(s) that occurred during the sampling that may influence interpretation of the results (i.e., weather), and
- Chain of custody protocols and records used to track samples from sampling point to analysis.

Field notes including observations of sample location conditions, weather, other pertinent observations, and diagrams (if appropriate) will be maintained, and appropriate photographs will be taken. A record of each sample, including any pertinent observations about the samples will be kept in a field notebook and/or appropriate logs and copies will be included in the Soil Vapor Intrusion Investigation Report.



2.4 PRESSURE FIELD TESTING

As requested by the NYSDEC and NYSDOH, pressure field testing will be included as part of the investigation to evaluate if the existing SSDS is maintaining a pressure field beneath the concrete slab and vapor barrier. In order to prevent penetrating the existing vapor barrier, GZA will document the pressure readings from the existing manometers (Dwyer Magnehelic Series 200 Pressure Gauge or similar) at each of the three riser locations. The documented readings will be provided in the SVI Investigation Report.

3.0 **REPORTING**

3.1 INVESTIGATION REPORTING

Following the completion of the SVIWP and receipt of analytical data, an SVI Investigation Report will be prepared. The report will include the following:

- A summary of the Site history and previous investigations
- A description of Site conditions
- Sampling methodology and field observations
- An evaluation of the results and findings
- Conclusions and recommendations for any further assessment (if warranted).

The report will include sampling logs, tabulated analytical results, figures, and laboratory data packages. The tabulated analytical results will be organized in table format and include sample location, media sampled, sample height, field/laboratory identification numbers, analytical results and the applicable Standards, Criteria, and Guidance (SCGs) pertaining to the Site and contaminants of concern for comparison. The report will include scaled figures showing the locations of indoor and outdoor ambient air sampling points, riser and manometer locations, and sample concentrations above SCGs.

4.0 **INVESTIGATION HASP**

An OSHA compliant Health and Safety Plan that meets the pertinent OSHA HAZWOPER requirements will be implemented during the site work to protect worker safety. The Site Safety Coordinator will ensure full compliance of the HASP in accordance with applicable health and safety laws, and regulations. All field personnel involved in investigation activities will have completed training required under OSHA HAZWOPER 29 CFR 1910.120, including 40-hour hazardous waste operator training and annual 8-hour refresher training. Emergency telephone numbers will be posted at the site location before any work begins. A safety meeting will be conducted before each shift begins. Topics to be discussed include task hazards and protective measures (physical, chemical, environmental); emergency procedures; PPE levels and other relevant safety topics including a highlighted route map to the nearest hospital/emergency room. Meetings will be documented in a logbook or specific form. Information fact sheets and/or summary tables for each contaminant group are included in the HASP. A copy of this HASP will be on-site during each sampling event. The HASP is included as **Appendix A**.



5.0 SCHEDULE

The following Schedule is provided for this work:

Event	Schedule
Soil Vapor Intrusion Investigation	March 2025
Soil Vapor Intrusion Investigation Report	Two weeks from receipt of analytical data

Should you have any questions about our proposal, please contact Karen Tyll at (631) 629-5373 or karen@tyllengineering.com or Mark Hutson at (646) 929-8955 or Mark.Hutson@gza.com.

Very truly yours,

TYLL ENGINEERING AND CONSULTING, PC

A handwritten signature in black ink, appearing to read "Karen Tyll".

Karen G. Tyll, P.E.
President

GZA GEOENVIRONMENTAL OF NEW YORK


A handwritten signature in black ink, appearing to read "Mark Hutson".

Mark Hutson, P.G.
Senior Project Manager

ATTACHMENTS

- Figure 1 – Site Location Map
- Figure 2 – Site Plan
- Figure 3 – SVE Layout
- Figure 4 – Sample Location Map

I Karen Tyll, PE certify that I am currently a NYS registered professional engineer as defined in 6 NYCRR Part 375] and that this Report, "Soil Vapor Investigation Work Plan," was prepared in accordance with all applicable statutes and regulations and in substantial conformance with the DER Technical Guidance for Site Investigation and Remediation (DER-10).

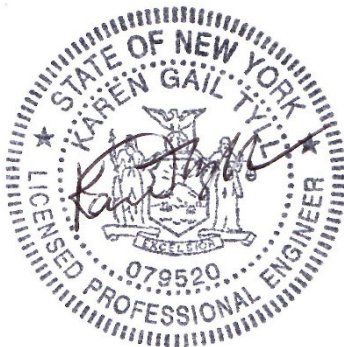




February 7, 2025



FIGURES



NEW YORK  QUADRANGLE LOCATION	SOURCE: USGS TOPOGRAPHIC MAPS: NY (2023). CONTOUR INTERVAL 10FT., NAVD-1988, ORIGINAL SCALE 1:24,000 (1IN.=2,000FT.).  UNLESS SPECIFICALLY STATED BY WRITTEN AGREEMENT, THIS DRAWING IS THE SOLE PROPERTY OF GZA GEOENVIRONMENTAL, INC. (GZA). THE INFORMATION SHOWN ON THE DRAWING IS SOLELY FOR USE BY GZA'S CLIENT OR THE CLIENT'S DESIGNATED REPRESENTATIVE FOR THE SPECIFIC PROJECT AND LOCATION IDENTIFIED ON THE DRAWING. THE DRAWING SHALL NOT BE TRANSFERRED, REUSED, COPIED, OR ALTERED IN ANY MANNER FOR USE AT ANY OTHER LOCATION OR FOR ANY OTHER PURPOSE WITHOUT THE PRIOR WRITTEN CONSENT OF GZA. ANY TRANSFER, REUSE, OR MODIFICATION TO THE DRAWING BY THE CLIENT OR OTHERS, WITHOUT THE PRIOR WRITTEN EXPRESS CONSENT OF GZA, WILL BE AT THE USER'S SOLE RISK AND WITHOUT ANY RISK OR LIABILITY TO GZA.										
11-07 DEKALB AVENUE, BROOKLYN, NY	PREPARED BY:  GZAGeoEnvironmental of NY Engineers and Scientists www.gza.com PREPARED FOR: ABC NY										
SITE LOCATION MAP	<table><tr><td>PROJ MGR: MH</td><td>REVIEWED BY: MH</td><td>CHECKED BY: VW</td><td rowspan="3">FIGURE 1 SHEET NO. 1 OF 1 </td></tr><tr><td>DESIGNED BY: SG</td><td>DRAWN BY: SG</td><td>SCALE: N.T.S</td></tr><tr><td>DATE: OCTOBER, 2024</td><td>PROJECT NO. 41.0163281.10</td><td>REVISION NO. -</td></tr></table>	PROJ MGR: MH	REVIEWED BY: MH	CHECKED BY: VW	FIGURE 1 SHEET NO. 1 OF 1	DESIGNED BY: SG	DRAWN BY: SG	SCALE: N.T.S	DATE: OCTOBER, 2024	PROJECT NO. 41.0163281.10	REVISION NO. -
PROJ MGR: MH	REVIEWED BY: MH	CHECKED BY: VW	FIGURE 1 SHEET NO. 1 OF 1								
DESIGNED BY: SG	DRAWN BY: SG	SCALE: N.T.S									
DATE: OCTOBER, 2024	PROJECT NO. 41.0163281.10	REVISION NO. -									

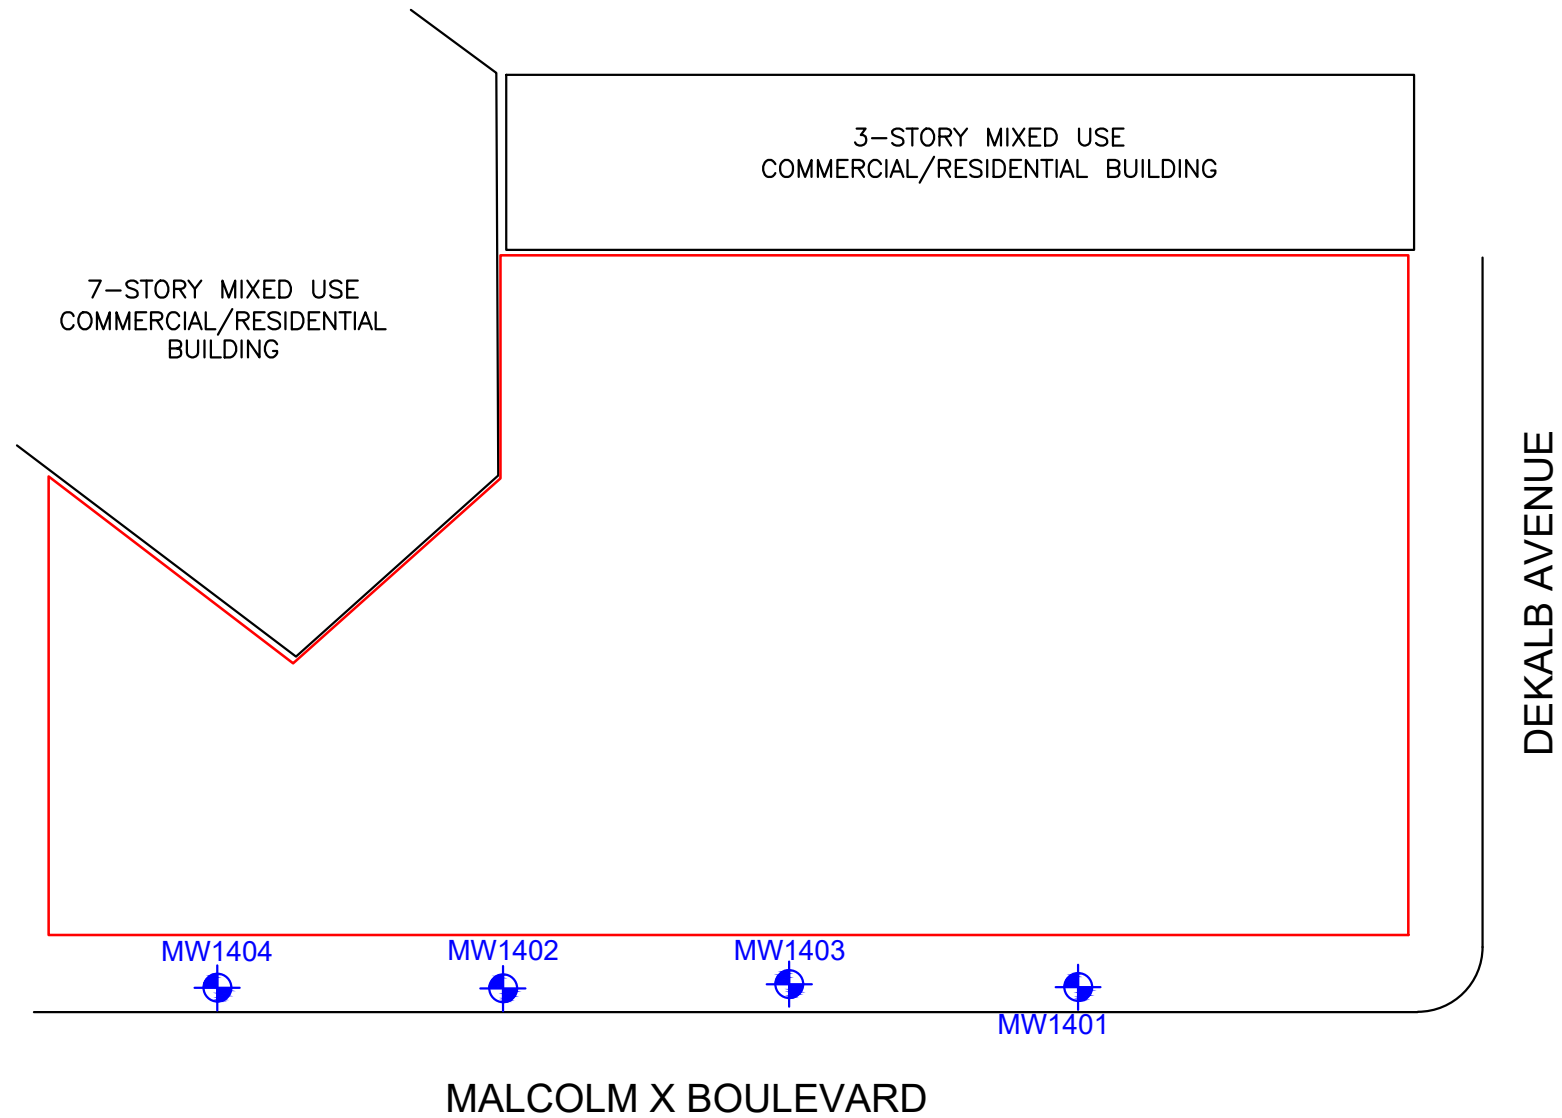

GENERAL NOTES

1. BASE MAP DEVELOPED FROM DRAWING TITLED "ENGINEERING CONTROLS – SVE SYSTEM" PREPARED BY "AMC ENGINEERING, PLLC", ORIGINAL SCALE 1" = 25', DATED OCTOBER 17, 2019.
2. EXPLORATION LOCATIONS SHOWN ARE BASED ON TAPE MEASUREMENTS FROM TOPOGRAPHICAL FEATURES. THE LOCATIONS SHOULD BE CONSIDERED ACCURATE ONLY TO THE DEGREE IMPLIED BY THE METHOD USED.


LEGEND

- APPROXIMATE SITE BOUNDARY
- APPROXIMATE MONITORING WELL LOCATION



NO.	ISSUE/DESCRIPTION	BY	DATE
UNLESS SPECIFICALLY STATED BY WRITTEN AGREEMENT, THIS DRAWING IS THE SOLE PROPERTY OF GZA GEORENIRONMENTAL, INC. (GZA). THE INFORMATION SHOWN ON THE DRAWING IS SOLELY FOR USE BY GZA'S CLIENT OR THE CLIENT'S DESIGNATED REPRESENTATIVE FOR THE SPECIFIC PROJECT AND LOCATION IDENTIFIED ON THE DRAWING. THE DRAWING SHALL NOT BE TRANSFERRED, REUSED, COPIED, OR ALTERED IN ANY MANNER FOR USE AT ANY OTHER LOCATION OR FOR ANY OTHER PURPOSE WITHOUT THE PRIOR WRITTEN CONSENT OF GZA. ANY TRANSFER, REUSE, OR MODIFICATION TO THE DRAWING BY THE CLIENT OR OTHERS, WITHOUT THE PRIOR WRITTEN EXPRESS CONSENT OF GZA, WILL BE AT THE USER'S SOLE RISK AND WITHOUT ANY RISK OR LIABILITY TO GZA.			
11-07 DEKALB AVENUE, BROOKLYN, NY			
SITE PLAN			
PREPARED BY: GZA GeoEnvironmental of NY Engineers and Scientists www.gza.com		PREPARED FOR: ABC NY	
PROJ MGR: MH	REVIEWED BY: MH	CHECKED BY: VW	FIGURE 2 SHEET NO. 1 OF 1
DESIGNED BY: SG	DRAWN BY: SG	SCALE: 1" = 20'	
DATE: FEBRUARY 2025	PROJECT NO. 41.0163281.10	REVISION NO. -	

©2022 – GZA GeoEnvironmental of NY.
GZA-J:\Active 163200 to 163299\163281.00 – 1107 Dekalb GWS and Periodic Review Report\Drawings\GZA CAD\163281.00.dwg [Fig 3 – SVE] December 09, 2024 – 11:37am Sella.Gupta

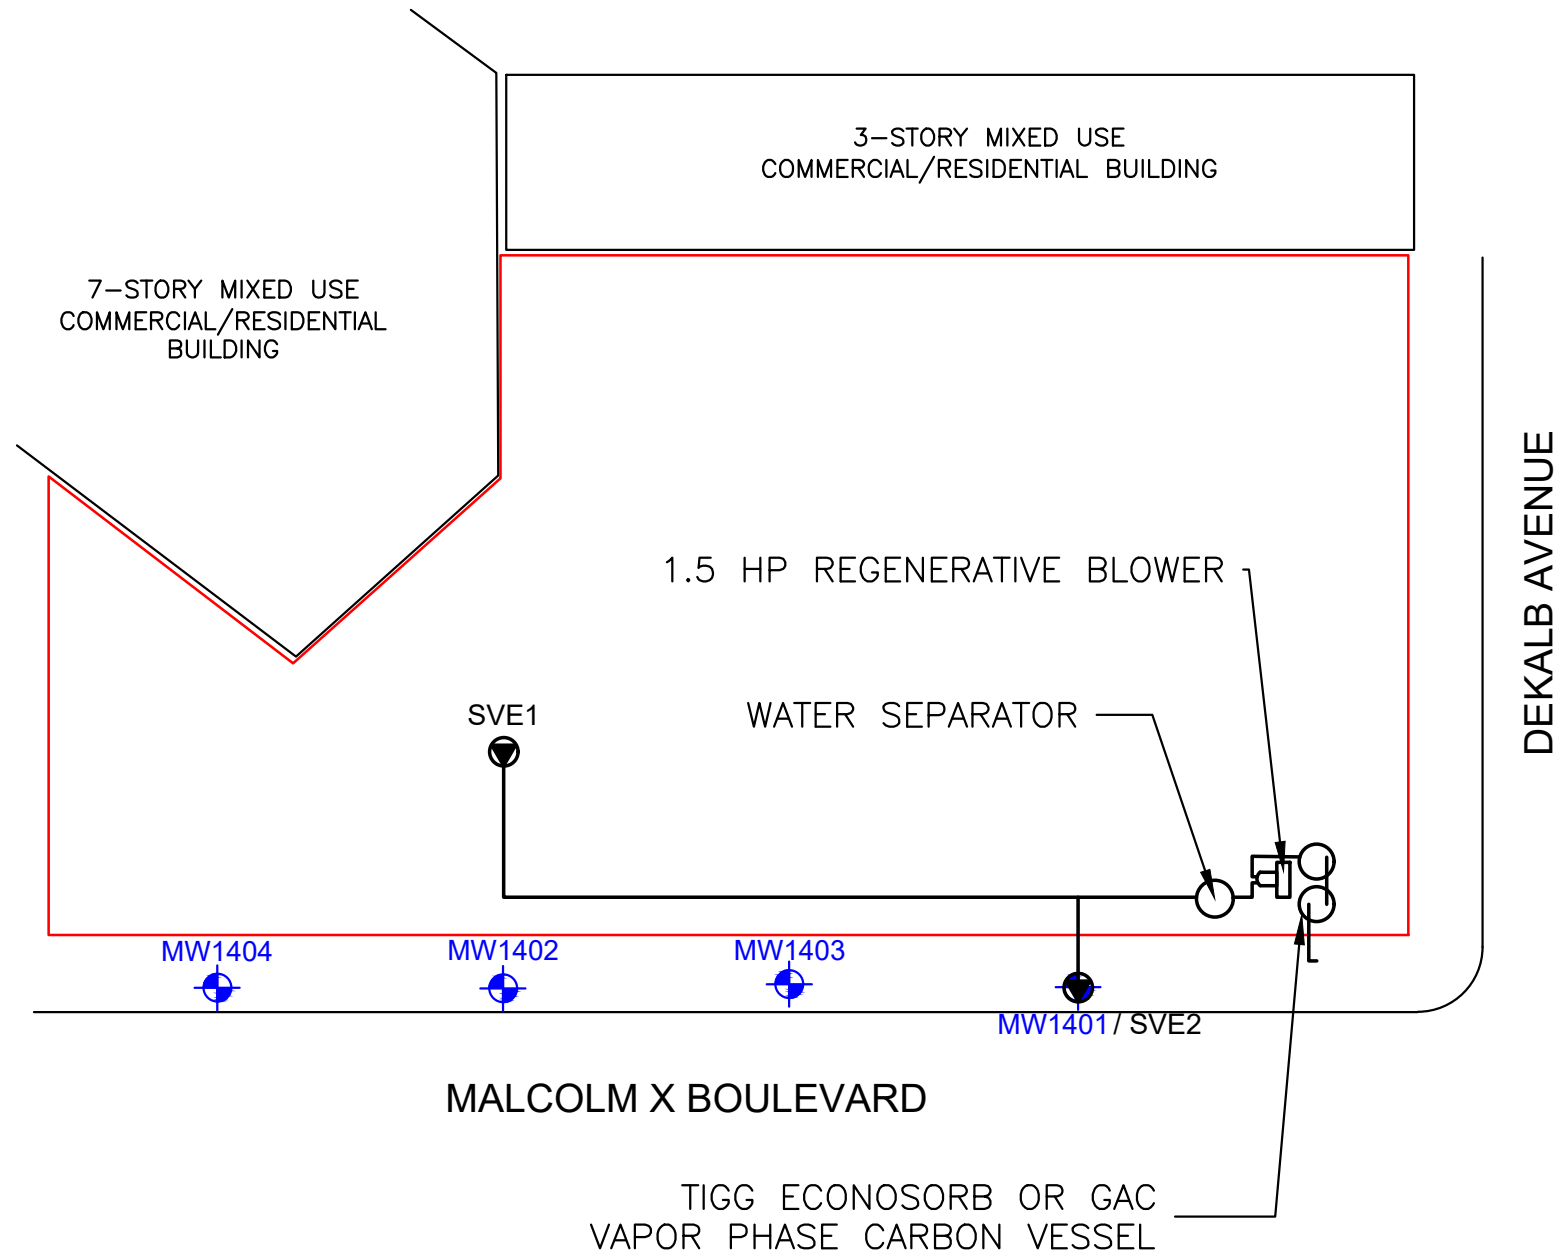


GENERAL NOTES



1. BASE MAP DEVELOPED FROM DRAWING TITLED "ENGINEERING CONTROLS – SVE SYSTEM" PREPARED BY "AMC ENGINEERING, PLLC", ORIGINAL SCALE 1" = 25', DATED OCTOBER 17, 2019.
2. EXPLORATION LOCATIONS SHOWN ARE BASED ON TAPE MEASUREMENTS FROM TOPOGRAPHICAL FEATURES. THE LOCATIONS SHOULD BE CONSIDERED ACCURATE ONLY TO THE DEGREE IMPLIED BY THE METHOD USED.
3. ELEVATIONS ARE REFERENCED TO THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88).

LEGEND

- APPROXIMATE SITE BOUNDARY
- MW1400 APPROXIMATE MONITORING WELL LOCATION
- SVE1 APPROXIMATE VAPOR EXTRACTION WELL



NO.	ISSUE/DESCRIPTION	BY	DATE
UNLESS SPECIFICALLY STATED BY WRITTEN AGREEMENT, THIS DRAWING IS THE SOLE PROPERTY OF GZA GEORENIRONMENTAL, INC. (GZA). THE INFORMATION SHOWN ON THE DRAWING IS SOLELY FOR USE BY GZA'S CLIENT OR THE CLIENT'S DESIGNATED REPRESENTATIVE FOR THE SPECIFIC PROJECT AND LOCATION IDENTIFIED ON THE DRAWING. THE DRAWING SHALL NOT BE TRANSFERRED, REUSED, COPIED, OR ALTERED IN ANY MANNER FOR USE AT ANY OTHER LOCATION OR FOR ANY OTHER PURPOSE WITHOUT THE PRIOR WRITTEN CONSENT OF GZA. ANY TRANSFER, REUSE, OR MODIFICATION TO THE DRAWING BY THE CLIENT OR OTHERS, WITHOUT THE PRIOR WRITTEN EXPRESS CONSENT OF GZA, WILL BE AT THE USER'S SOLE RISK AND WITHOUT ANY RISK OR LIABILITY TO GZA.			
11-07 DEKALB AVENUE, BROOKLYN, NY			
SOIL VAPOR EXTRACTION LAYOUT			
PREPARED BY: GZA GeoEnvironmental of NY Engineers and Scientists www.gza.com		PREPARED FOR: ABC NY	
PROJ MGR: MH	REVIEWED BY: MH	CHECKED BY: VW	FIGURE 3 SHEET NO. 1 OF 1
DESIGNED BY: SG	DRAWN BY: SG	SCALE: 1" = 20'	
DATE: DECEMBER 2024	PROJECT NO. 41.0163281.00	REVISION NO. -	



1. BASE MAP DEVELOPED FROM DRAWING TITLED "SSDS LAYOUT 11-07 DEKALB AVENUE BROOKLYN, NY", PREPARED BY "TYLL ENGINEERING & CONSULTING PC", ORIGINAL SCALE 1" = 25', DATED MARCH 7, 2024.
2. EXPLORATION LOCATIONS SHOWN ARE BASED ON TAPE MEASUREMENTS FROM TOPOGRAPHICAL FEATURES. THE LOCATIONS SHOULD BE CONSIDERED ACCURATE ONLY TO THE DEGREE IMPLIED BY THE METHOD USED.
3. ELEVATIONS ARE REFERENCED TO THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88).

- APPROXIMATE SITE BOUNDARY
- APPROXIMATE LOCATION OF 4" PERFORATED PVC PIPING
- APPROXIMATE RISER LOCATIONS
- IA-01 APPROXIMATE INDOOR AIR SAMPLING LOCATION
- OA-01 APPROXIMATE OUTDOOR AMBIENT AIR SAMPLING LOCATION

NO.	ISSUE/DESCRIPTION			BY	DATE
UNLESS SPECIFICALLY STATED BY WRITTEN AGREEMENT, THIS DRAWING IS THE SOLE PROPERTY OF GZA GEOENVIRONMENTAL, INC. (GZA). THE INFORMATION SHOWN ON THE DRAWING IS SOLELY FOR USE BY GZA'S CLIENT OR THE CLIENT'S DESIGNATED REPRESENTATIVE FOR THE SPECIFIC PROJECT AND LOCATION IDENTIFIED ON THE DRAWING. THE DRAWING SHALL NOT BE TRANSFERRED, REUSED, COPIED, OR ALTERED IN ANY MANNER FOR USE AT ANY OTHER LOCATION OR FOR ANY OTHER PURPOSE WITHOUT THE PRIOR WRITTEN CONSENT OF GZA. ANY TRANSFER, REUSE, OR MODIFICATION TO THE DRAWING BY THE CLIENT OR OTHERS, WITHOUT THE PRIOR WRITTEN EXPRESS CONSENT OF GZA, WILL BE AT THE USER'S SOLE RISK AND WITHOUT ANY RISK OR LIABILITY TO GZA.					
11-07 DEKALB AVENUE, BROOKLYN, NY					
SAMPLE LOCATION MAP					
PREPARED BY:			PREPARED FOR:		
 GZA GeoEnvironmental of NY Engineers and Scientists www.gza.com			ABC NY		
PROJ MGR: MH			REVIEWED BY: MH		FIGURE 4 SHEET NO. 1 OF 1
DESIGNED BY: SG		DRAWN BY: SG		SCALE: 1" = 15'	
DATE: FEBRUARY 2025		PROJECT NO. 41.0163281.10		REVISION NO. -	



APPENDICES



APPENDIX A - HASP

GZA SITE-SPECIFIC HEALTH, SAFETY & ACCIDENT PREVENTION STANDARD-PLAN

1. CLIENT/SITE/PROJECT INFORMATION

Client: ABC NY

Site Address: 1107 Dekalb Avenue, Brooklyn, NY

Site Description (be sure to list pertinent site features, chemicals used at the facility, and other potential hazard sources:

The Site is 9,529-square feet (SF) in area and is identified on the Brooklyn County tax map as Block 1600, Lot 7501. The Site is bordered by Malcolm X Boulevard to the west, Dekalb Avenue to the south, a 7-story mixed-use building to the north, and a 2-story and 3-story mixed-use building to the east. The Site is currently developed with an 8-story mixed-use building with a partial below grade basement. The Site is currently in the Site Management phase of the BCP.

Work Environment (active manufacturing, office, vacant site, undeveloped property, etc.):

The Site is an 8-story mixed-use building. Monitoring wells at the Site are located on the sidewalk along Malcolm X Boulevard.

Job/Project #: 41.0163281.10

Estimated Start Date: TBD

Estimated Finish Date: TBD

Site is Covered by the Following Regulations:

OSHA HAZWOPER Standard ☒

Mine Safety and Health Administration ☐

OSHA Construction Regulations ☐

OSHA General Industry Regulations ☐

2. EMERGENCY INFORMATION

Hospital Name: NYC Health + Hospitals/Woodhull

Hospital Phone: 718-963-8000

Hospital Address: 760 Broadway, Brooklyn, NY 11206

Directions and Street Map Attached: ☒ Yes

Local Fire #: 911

Local Ambulance #: 911

Local Police #: 911

WorkCare Incident Intervention Services:

For non-emergencies, if an employee becomes hurt or sick call 888-449-7787

Other Emergency Contact(s): Mark Hutson

Phone #'s: 646-929-8955

Site-Specific Emergency Preparedness/Response Procedures/Concerns:

Review emergency contact information, locations of emergency equipment (e.g. first aid kits, fire extinguishers, evacuation routes), review of emergency procedures, and current location and access to hospital. Ensure that cell phone is charged daily and have vehicle phone chargers on hand.

Possible emergencies on site include physical injuries, chemical exposure, potential for heart attacks, fire, and heat/cold related injuries. Personnel on site will have current first aid and will be able to respond to minor injuries while emergency response personnel are contacted for assistance.

Personal Injury: For minor injuries, such as cuts, burns, exhaustion, heat cramps, insect stings, etc., the affected employee will be removed to an uncontaminated area for administration of appropriate first aid. If the injury warrants additional medical attention, the affected employee will be properly decontaminated, as necessary and appropriate to the situation, and transported to the nearest hospital or emergency medical facility.

For more serious injuries the Field Safety Officer (FSO) or designee will summon emergency assistance to the project site. No attempt will be made by GZA personnel to move the victim, unless in imminent danger, without the aid and/or instructions of qualified emergency response personnel.

GZA SITE-SPECIFIC HEALTH, SAFETY & ACCIDENT PREVENTION STANDARD-PLAN



 LIFTING Get help lifting or carrying anything over 50 pounds	 SITE RECON Walk your site before starting work to find and mark slips/trips/falls and insect nests	 DRIVING Don't use your mobile phone while driving	 ERGONOMICS Take a 5-minute break for every hour you work, whether it's in the office or the field
 CUTS Wear cut-resistant gloves when using knives or other sharp objects	 PPE At a minimum, always wear safety glasses and protective footwear in the field	 HASP Develop a HASP and have it with you in the field	 WORKCARE Without delay, call WorkCare immediately for any minor injury or illness at 888-449-7787

- All EHS Events must be reported immediately to the Project Manager and to the GZA People-Based Safety mobile app.
- In the event of a chemical release greater than 5 gallons, site personnel will evacuate the affected area and relocate to an upwind location. The GZA Field Safety Officer and client site representative shall be contacted immediately.
- Site work shall not be conducted during severe weather, including high winds and lightning. In the event of severe weather, stop work, lower any equipment (drill rigs), and evacuate the affected area.

3. SCOPE OF WORK

General project description, and phase(s) or work to which this H&S Plan applies ¹ .	SVI Investigation
Specific Tasks Performed by GZA:	Collect indoor air samples within the building basement and an ambient air sample outside of the building.
Concurrent Tasks to be Performed by GZA-hired Subcontractors (List Subcontractors by Name):	N/A
Concurrent Tasks to be Performed by Others:	N/A

Any OSHA PERMIT-REQUIRED CONFINED SPACE entry?

☐ YES ☒ NO

IF YES, ADD CONFINED SPACE ENTRY PERMIT FOR THAT PORTION OF THE WORK

Any INDOOR fieldwork? ☒ YES ☐ NO

IF YES, EXPLAIN: indoor air sampling within the building basement

4. SUB-SURFACE WORK, UNDERGROUND UTILITY LOCATION

Will subsurface explorations be conducted for this work (drilling, excavation, test pits)? ☐ Yes ☒ No

Have GZA project-related files been searched for existing private utility drawings? ☐ Yes ☐ No ☒ N/A

Has GZA requested utility drawings from our Client, property owner, and others? ☐ Yes ☐ No ☒ N/A

¹ Copy from or reference proposal or applicable design plan as appropriate.

GZA SITE-SPECIFIC HEALTH, SAFETY & ACCIDENT PREVENTION STANDARD-PLAN

Have existing drawings been reviewed for possible conflicts with planned work?	☐ Yes ☐ No ☒ N/A
Will GZA personnel be required to use a hand-auger as part of this work?	☐ Yes ☐ No ☒ N/A
Site property ownership where underground explorations will be conducted on:	Public Access Property ☐ Yes ☒ No Private Property ☒ Yes ☐ No
Have Necessary Underground Utility Notifications for Subsurface Work Been Made? N/A	☐ Yes ☐ Yet to be conducted
Specify Clearance Date & Time, Dig Safe Clearance I.D. #, And Other Relevant Information: N/A	
IMPORTANT! For subsurface work, prior to the initiation of ground penetrating activities, GZA personnel to assess whether the underground utility clearance (UUC) process has been completed in a manner that appears acceptable, based on participation/ confirmation by other responsible parties (utility companies, subcontractor, client, owner, etc.), for the following:	
Electric:	☐ Yes ☐ No ☒ NA ☒ Other _____
Fuel (gas, petroleum, steam):	☐ Yes ☐ No ☒ NA ☒ Other _____
Communication:	☐ Yes ☐ No ☒ NA ☒ Other _____
Water:	☐ Yes ☐ No ☒ NA ☒ Other _____
Sewer:	☐ Yes ☐ No ☒ NA ☒ Other _____
Other: _____	☐ Yes ☐ No ☐ NA ☐ Other _____
Comments: NA	

5. HAZARD ASSESSMENT (CHECK ALL THAT APPLY AND ADDRESS EACH HAZARD IN SECTION 6)

A. GENERAL FIELDWORK HAZARDS

☐ Confined Space Entry (Add Confined Space Entry Permit) ☐ Abandoned or vacant building/Enclosed Spaces ☒ Significant Slip/Trip/Fall Hazards ☐ Unsanitary/Infectious Hazards ☐ Poisonous Plants ☐ Biting/Stinging Insects ☐ Feral Animal Hazards ☐ Water/Wetlands Hazards ☐ Remote Locations/Navigation/Orientation hazards ☒ Heavy Traffic or Work Alongside a Roadway ☒ Weather-Related Hazards ☐ Motor vehicle operation Hazards ☐ Heavy Equipment Hazards ☐ Structural Hazards (i.e. unsafe floors/stairways/roof) ☐ Demolition/Renovation ☒ Presence of Pedestrians or the General Public	☐ Overhead Hazards (i.e. falling objects, overhead power lines) ☒ Portable Hand Tools or Power Tools ☒ Significant Lifting or Ergonomic Hazards ☐ Electrical Hazards (i.e. Equipment 120 Volts or Greater, Work Inside Electrical Panels, or Maintenance of Electrical Equipment) ☐ Other Stored energy Hazards (i.e. Equipment with High Pressure or Stored Chemicals) ☐ Fire and/or Explosion Hazard ☐ Elevated Noise Levels ☐ Subsurface Work (Drilling/Excavations/Test Pits) ☐ Explosives or Unexploded Ordinance/MEC ☐ Long Distance or Overnight Travel ☐ Personal Security or High Crime Area Hazards ☐ Working Alone ☐ Ionizing Radiation or Non-Ionizing Radiation ☒ Chemical/Exposure Hazards (See Part B for Details) ☐ Other:
---	--

GZA SITE-SPECIFIC HEALTH, SAFETY & ACCIDENT PREVENTION STANDARD-PLAN

B. CHEMICAL/EXPOSURE HAZARDS (CONTAMINANTS ARE CONTAINED IN SOIL, WATER, X GROUNDWATER)

☐ No chemical hazards anticipated ☐ Hydrogen Sulfide (H ₂ S) ☐ Cyanides, Hydrogen Cyanide (HCN) ☐ Carbon Monoxide ☐ Herbicides, Pesticide, Fungicide, Animal Poisons ☐ Metals, Metal Compounds: ☐ Corrosives, Acids, Caustics, Strong Irritants ☐ Polychlorinated Biphenyls (PCBs) ☐ Polycyclic Aromatic Hydrocarbons (PAHs) ☐ Compressed Gases ☐ Flammable/Combustible Liquids ☐ Radiation Hazards (i.e. radioactive sealed/open source, x-rays, ultra violet, infrared, radio-frequency, etc.)	☐ Methane ☐ Chemicals Subject to OSHA Hazard Communication (attach Safety Data Sheet for each chemical GZA brings to the site) ☐ Containerized Waste, Chemicals in Piping & Process Equipment ☐ Emissions from Gasoline-, Diesel-, Propane-fired Engine, Heater, Similar Equipment ☐ General Work Site Airborne Dust Hazards ☒ Volatile Organic Compounds (VOCs), BTEX ☐ Chlorinated Organic Compounds ☐ Fuel Oil, Gasoline, Petroleum Products, Waste Oil ☐ Asbestos ☐ Oxygen Deficiency, Asphyxiation Hazards ☐ Other:
--	--

GZA SITE-SPECIFIC HEALTH, SAFETY & ACCIDENT PREVENTION STANDARD-PLAN

6. SITE-SPECIFIC OVERVIEW OF H&S HAZARDS/MITIGATIONS (NOTE: Based on Hazard Assessment, Section 5)	
Describe the major hazards expected to be present at the jobsite, and describe the safety measures to be implemented for worker protection (refer to items checked in Section 5 above). Use brief abstract statements or more detailed narrative as may be appropriate.	
ON-SITE HAZARDS:	HAZARD MITIGATIONS:
Task Hazard Analyses	JHA 21.01 General Outdoor Field Work JHA 4.1 Drilling Ob- Monitoring Well Inst-Observations-Soil Sampling - Instrumentation Installation and Monitoring JHA 20.11 Field Sampling See additional Task Hazard Analyses on Attachment G.
Owning Zero	Ensure all GZA personnel on-site have downloaded the People Based Safety app to their mobile phones and are familiar with using it to report safety events. Prior to work each day, review Owning Zero rules with all onsite personnel during morning safety meeting.
Weather-Related Hazards	Weather conditions will be assessed prior to on-site work and forecast examined for anticipated period of work. If weather permits fieldwork, then workers will dress appropriately. Should inclement weather be encountered, the project scope may be reduced or rescheduled. Breaks will be taken to reduce exposure to the elements. If conditions change and lightning or thunder is observed, work will be suspended immediately, and workers will seek shelter. Work may resume if thunder and/or lightning cease for 30 minutes. In the case of cold weather, proper warm gear should be worn to minimize cold exposure. Hand warmers (e.g. "Hot Hands") should be used when appropriate to keep extremities warm and multiple breaks within a warm area (vehicle with heat) should be taken. Review the signs of heat stress, hypothermia, and dehydration before the start of fieldwork. Water, sunscreen, hardhat, tinted safety sunglasses, rain gear (if necessary) and periodic breaks should all be planned for. Be sure to consume plenty of liquids on hot summer days and stay out of direct sunlight for extended periods of time to the extent possible. Use protective ointments such as sunscreen and chap stick, and consult the OSHA Heat Safety App daily to determine risk of heat related illnesses for the day. Maintain extra clothing, blankets, etc. in the work vehicle for a change of clothing if necessary Wear ice cleats if ground conditions are slippery.
Volatile Organic Compounds (VOCs), BTEX	"VOC contaminated groundwater can produce odors, fumes, and present ingestion, inhalation, and skin contact hazards. Compounds associated with gasoline and waste oils include benzene, xylene, toluene, gasoline, and various oils (hydrocarbons). These materials can cause eye, skin and respiratory tract irritation, liver and kidney damage, headaches, blurred vision, nausea, and dizziness. 1,4-dioxane. 1,4-Dioxane is readily adsorbed through the lungs and gastrointestinal tract. Some 1,4-dioxane may also pass through the skin, but studies indicate that much of it will evaporate before it is absorbed. Distribution is rapid and uniform in the lung, liver, kidney, spleen, colon and skeletal muscle tissue. Short-term exposure to high levels of 1,4-dioxane may result in nausea, drowsiness, headache, and irritation of the eyes, nose and throat. Exposure to the vapors of benzene, ethyl benzene, toluene and xylenes above their respective permissible exposure limits (PELs), as defined by the Occupational Safety and Health Administration (OSHA), may produce irritation of the mucous membranes of the upper respiratory tract, nose and mouth. Overexposure may also result in the depression of the central nervous system. Symptoms of such exposure include drowsiness, headache, fatigue and drunken-like behavior. Benzene has been determined to be carcinogenic, targeting blood-forming organs and bone marrow. The primary route of exposure to VOCs is through inhalation and therefore air monitoring and respiratory protection is the primary control against exposure to VOCs. Air monitoring will be completed as specified below to

GZA SITE-SPECIFIC HEALTH, SAFETY & ACCIDENT PREVENTION STANDARD-PLAN

	minimize airborne exposures. Exposure through direct contact is possible and will be minimized through the use of PPE as prescribed herein. Stop work and evacuate area if readings persist above OSHA permissible exposure limits in the breathing zone. Some common VOCs and their OSHA PELs are as follows: Benzene (1.0 ppm - 8 hr TWA), Toluene (200 ppm 8 hr -TWA), Ethylbenzene (100 ppm - 8hr TWA), Xylene (100 ppm - 8 hr TWA), Naphthalene (10 ppm - 8 hr TWA). Diesel (100 ppm 8-hr TWA _ ACGIH TLV as total hydrocarbons), Gasoline (300 ppm - 8 hr TWA_ACGIH TLV), Hydrogen Cyanide (10 ppm – OSHA 8 hr TWA). Exposure to the vapors of benzene, ethyl benzene, toluene and xylenes above their respective permissible exposure limits (PELs), as defined by the Occupational Safety and Health Administration (OSHA), may produce irritation of the mucous membranes of the upper respiratory tract, nose and mouth. Overexposure may also result in the depression of the central nervous system. Symptoms of such exposure include drowsiness, headache, fatigue and drunken-like behavior. Benzene has been determined to be carcinogenic, targeting blood-forming organs and bone marrow. The primary route of exposure to VOCs is through inhalation and therefore air monitoring and respiratory protection is the primary control against exposure to VOCs. Air monitoring will be completed as specified below to minimize airborne exposures. Exposure through direct contact is possible and will be minimized through the use of PPE as prescribed herein. BTEX Compounds. Exposure to the vapors of benzene, ethyl benzene, toluene and xylenes above their respective permissible exposure limits (PELs), as defined by the Occupational Safety and Health Administration (OSHA), may produce irritation of the mucous membranes of the upper respiratory tract, nose and mouth. Overexposure may also result in the depression of the central nervous system. Symptoms of such exposure include drowsiness, headache, fatigue and drunken-like behavior. Benzene has been determined to be carcinogenic, targeting blood-forming organs and bone marrow. The odor threshold for benzene is higher than the PEL and employees may be overexposed to benzene without sensing its presence, therefore, detector tubes must be utilized to evaluate airborne concentrations.
Presence of Pedestrians or the General Public	Establish warning signs and cones to delineate work area and warn pedestrians of work ahead. Maintain site control, do not allow access to unauthorized persons. Wear high visibility vest or clothing at all times when working in the roadway or near a sidewalk. Always be aware of pedestrians walking near the exclusion zone. If a pedestrian approaches the job site, work will cease until the pedestrian leaves the area.
Significant Slip/Trip/Fall Hazards	Inspect work area prior to starting work. Mark out or remove any potential hazards. Inspect area for uneven or sloped terrain, or around test pits. Wear sturdy shoes with ankle support and good tread. In winter weather, wear boot grips for more traction when walking. Look for potential natural depressions/holes/animal burrows, downed trees/limbs and other obstructions in the area of work and travel. Maintain one free hand to break falls. Watch for equipment on ground and slippery surfaces. Keep work area clean, no running, be mindful of changing weather conditions that may change footing conditions. Maintain safe distance from open borings. Be aware of surroundings. Ensure that borings are well marked (if left uncovered) or are appropriately filled to reduce trip/fall hazards. Do not leave borings or test pits open at the end of the work shift. Cover with metal plate if hole cannot be backfilled and label.
Remediation Systems O&M	The treatment system includes high voltage pumps and components. Caution shall be used when working with equipment. Ensure electrical components are de-

GZA SITE-SPECIFIC HEALTH, SAFETY & ACCIDENT PREVENTION STANDARD-PLAN

	energized prior to performing maintenance. A qualified subcontractor should be completing electrical/mechanical work.
Portable Hand Tools or Power Tools	Lift and transport hand tools using proper lifting techniques and keep a clean and orderly workspace. Be familiar with tool's operating instructions and specific hazards before beginning work; wear leather gloves when appropriate. Use grounded or double insulated power hand tools. Use GFCI plugs. Check extension cords and power cords keep all cords organized to avoid tripping hazards. Check cords for sign of fraying, or damage. Do not use portable tools that shows signs of damage. Observe proper electrical safety practices. Wear proper PPE. Store and carry tools correctly. Use the correct tool for the job. Know first aid response procedures to address potential injuries. 1. Wear safety glasses and other appropriate PPE. 2. Keep vents clear to maintain adequate ventilation. 3. Use sharp drill bits, blades or other cutting surfaces. 4. Use GFCI plugs and keep all cords clear of the cutting area during use. 5. Inspect for frays or damage before each use. 6. Disconnect power supply before changing or adjusting the equipment.
Heavy Traffic or Work Alongside a Roadway	The work proposed is being performed adjacent to existing roadways. At a minimum, set up cones and signs to delineate the work area. No vehicles or equipment shall be working or parked in the roadway or shoulder unless traffic control is in place that complies with the MUTCD. Consider the applicability of the MUTCD to the situation, and arrange for flaggers, warning signs and cones to delineate work area and warn vehicles of work ahead, if required. Maintain site control, do not allow access to unauthorized persons. Maintain safe distance from travel area and work outside the main traffic flow area whenever possible. Wear high visibility/reflective vest (Class III) at all times you are on and adjacent to roadway. Utilize flashing amber light on vehicle when vehicle is in or near traffic corridor and to access/egress the lane closure. Do not cross the road without approval from traffic control. Always face flow of traffic to maintain awareness. Access vehicle from opposite side of traffic.
Significant Lifting or Ergonomic Hazards	Proper lifting techniques (lifting with the legs, carrying the load at a reasonable height to allow for proper posture during the carry, and avoiding twisting while carrying loads) should be followed at all times. Caution should be used when lifting equipment. Be aware of hand position during all stages of the lift, transport and placement of equipment. Review equipment to be moved prior to lifting to prevent moving parts from crushing fingers or otherwise pinching skin. Do not stack items prior to carrying, but rather transport one item at a time to prevent shifting during carrying.

7. AIR MONITORING ACTION LEVELS – Make sure air monitoring instruments are in working order, calibrated before use, and 'bump-checked' periodically throughout the day and/or over multiple days of use

Is air monitoring to be performed for this project? Yes ☐ No ☒

ACTION LEVELS FOR OXYGEN DEFICIENCY AND EXPLOSIVE ATMOSPHERIC HAZARDS (Action levels apply to occupied work space in general work area)

☐ Applicable, See Below. ☐ Not Applicable

Parameter	Response Actions for Elevated Airborne Hazards
Oxygen	At 19.5% or below – Exit area, provide adequate ventilation, or proceed to Level B, or discontinue activities Verify presence of adequate oxygen (approx. 12% or more) before taking readings with LEL meter. Note: If oxygen levels are below 12%, LEL meter readings are not valid.
LEL	Less than 10% LEL – Continue working, continue to monitor LEL levels Greater than or Equal to 10% LEL – Discontinue work operations and immediately withdraw from area. Resume work activities ONLY after LEL readings have been reduced to less than 10% through passive dissipation, or through active vapor control measures.

GZA SITE-SPECIFIC HEALTH, SAFETY & ACCIDENT PREVENTION STANDARD-PLAN

ACTION LEVELS FOR INHALATION OF TOXIC/HAZARDOUS SUBSTANCES (Action levels are for sustained breathing zone concentrations)

☐ Applicable, See Below. ☐ Not Applicable

Air Quality Parameters (Check all that apply)	Remain in Level D or Modified D	Response Actions for Elevated Airborne Hazards
☐ VOCs	0 to ppm	From ppm to ppm: Proceed to Level C, or Ventilate, or Discontinue Activities If greater than ppm: Discontinue Activities and consult EHS Team
☐ Carbon Monoxide	0 to 35 ppm	At greater than 35 ppm, exit area, provide adequate ventilation, proceed to Level B, or discontinue activities.
☐ Hydrogen Sulfide	0 to 10 ppm	At greater than 10 ppm, exit area, provide adequate ventilation, proceed to Level B, or discontinue activities
☐ Dust	0 to mg/m ³	
☐	0 to	
SPECIAL INSTRUCTIONS/COMMENTS REGARDING AIR MONITORING (IF APPLICABLE)		

8. HEALTH AND SAFETY EQUIPMENT AND CONTROLS

AIR MONITORING INSTRUMENTS

- ☒ PID Type: MiniRAE 3000+ or equivalent Lamp Energy: 10.6 eV
- ☐ FID Type:
- ☐ Carbon Monoxide Meter
- ☐ Hydrogen Sulfide Meter
- ☐ O₂/LEL Meter
- ☐ Particulate (Dust) Meter
- ☐ Calibration Gas Type
- ☐ Others:

OTHER H&S EQUIPMENT & GEAR

- ☐ Fire Extinguisher
- ☐ Caution Tape
- ☒ Traffic Cones or Stanchions
- ☐ Warning Signs or Placards
- ☐ Decon Buckets, Brushes, etc.
- ☐ Portable Ground Fault Interrupter (GFI)
- ☐ Lockout/Tagout Equipment
- ☐ Ventilation Equipment
- ☒ Others: first aid kit, cell phone, soap, water

PERSONAL PROTECTIVE EQUIPMENT

- ☐ Respirator – Type
- ☐ Respirator - Cartridge Type:
- ☒ Hardhat
- ☒ Outer Gloves Type: Nitrile
- ☐ Inner Gloves Type:
- ☒ Steel-toed boots/shoes
- ☐ Coveralls – Type
- ☐ Outer Boots – Type
- ☒ Eye Protection with side shields
- ☐ Face Shield
- ☒ Traffic Vest
- ☐ Personal Flotation Device (PFD)
- ☐ Fire Retardant Clothing
- ☐ EH (Electrical Hazard) Rated Boots, Gloves, etc.
- ☒ Noise/Hearing Protection
- ☐ Others:

Discuss/Clarify, as Appropriate:

GZA SITE-SPECIFIC HEALTH, SAFETY & ACCIDENT PREVENTION STANDARD-PLAN

9. H&S TRAINING/QUALIFICATIONS FOR FIELD PERSONNEL

- | | |
|--|--|
| ☒ Project-Specific H&S Orientation (Required for All Projects/Staff)
☒ OSHA 40-Hour HAZWOPER/8 Hour Refreshers
☐ Hazard Communication (for project-specific chemical products)
☒ First Aid/CPR (required for HAZWOPER for at least one individual on site)
☒ Current Medical Clearance Letter (required for HAZWOPER)
☐ OSHA 10-hour Construction Safety Training
☐ Fall Protection Training
☐ Trenching & Excavation | ☐ Lockout/Tagout Training
☐ Electrical Safety Training
☐ Bloodborne Pathogen Training
☐
☐
☐
☐ |
|--|--|

Discuss/Clarify, as needed:

10. PERSONNEL AND EQUIPMENT DECONTAMINATION (SECTION ONLY REQUIRED FOR HAZWOPER SITES)

Describe personnel decontamination procedures for the project site, including "dry decon" (simple removal of PPE)	Dry decon. Wash hands and exposed skin with soap and water prior to taking breaks or leaving the site. Change PPE before leaving the site.
---	--

GZA SITE-SPECIFIC HEALTH, SAFETY & ACCIDENT PREVENTION STANDARD-PLAN

11. PROJECT PERSONNEL - ROLES AND RESPONSIBILITIES		
GZA ON-SITE PERSONNEL:		
Name(s)	Project Title/Assigned Role	Telephone Numbers
Yunmee Han	Site Supervisor	Work: 646-929-8941 Cell: 317-999-8432
Yunmee Han	Field Safety Officer	Work: 646-929-8941 Cell: 317-999-8432
Yunmee Han	First Aid Personnel	Work: 646-929-8941 Cell: 317-999-8432
Yunmee Han	GZA Project Team Members	Work: 646-929-8941 Cell: 317-999-8432
Site Supervisors and Project Managers (SS/PM): Responsibility for compliance with GZA Health and Safety programs, policies, procedures and applicable laws and regulations is shared by all GZA management and supervisory personnel. This includes the need for effective oversight and supervision of project staff necessary to control the Health and Safety aspects of GZA on-site activities. Field Safety Officer (FSO): The FSO is responsible for implementation of the Site Specific Health and Safety Plan. First Aid Personnel: At least one individual designated by GZA who has current training and certification in basic first aid and cardiopulmonary resuscitation (CPR) must be present during on-site activities involving multiple GZA personnel at HAZWOPER sites. GZA Project Team: Follow instructions relayed by the HASP and GZA manager on-site.		
OTHER PROJECT PERSONNEL:		
Name	Project Title/Assigned Role	Telephone Numbers
Victoria Whelan	Principal-in-Charge	Work: 631-847-1606 Cell: 631-847-1606
Mark Hutson	Project Manager	Work: 646-929-8955 Cell: 332-208-2260
Mark Hutson	Office Safety Coordinator	Work: 646-929-8955 Cell: 332-208-2260
Richard Ecord	GZA EHS Director	Work: 781-278-3809 Cell: 404-234-2834
Principal-in-Charge: Responsible of overall project oversight, including responsibility for Health and Safety. Project Manager: Responsible for day-to-day project management, including Health and Safety. Health and Safety Coordinator: General Health and Safety guidance and assistance. GZA EHS Director: H & S technical and regulatory guidance, assistance regarding GZA H&S policies and procedures.		

GZA SITE-SPECIFIC HEALTH, SAFETY & ACCIDENT PREVENTION STANDARD-PLAN

12. PLAN ACKNOWLEDGEMENT AND APPROVALS

GZA Project Site Worker Plan Acknowledgement

I have read, understood, and agree to abide by the information set forth in this Safety and Accident Prevention Plan. I will follow guidance in this plan and in the GZA Health and Safety Program Manual. I understand the training and medical monitoring requirements covered by the work outlined in this plan and have met those requirements.

GZA Employee Name	GZA Employee Signature	Date
Yunmee Han		1/30/2025

Subcontractor Site Worker Plan Acknowledgement

GZA has prepared this plan solely for the purpose of protecting the health and safety of GZA employees. Subcontractors, visitors, and others at the site must refer to their organization's health and safety program or site-specific HASP for their protection. Subcontractor employees may use this plan for general informational purposes only. Subcontractor firms are obligated to comply with safety regulations applicable to their work, and understand this plan covers GZA activities only.

Subcontractor Employee Name	Subcontractor Employee Signatures	Date



October 17, 2025
Soil Vapor **Intrusion** Investigation Report
1107 Dekalb Avenue, NY
File No. 41.0163281.10

ATTACHMENT B

**NEW YORK STATE DEPARTMENT OF HEALTH
INDOOR AIR QUALITY QUESTIONNAIRE AND BUILDING INVENTORY
CENTER FOR ENVIRONMENTAL HEALTH**

This form must be completed for each residence involved in indoor air testing.

Preparer's Name Jazlyn Natalie, Yunmee Han Date/Time Prepared 3/24/25

Preparer's Affiliation GZA GeoEnvironmental Phone No. 929-946-1837

Purpose of Investigation 1107 Dekalb SVI Investigation

1. OCCUPANT:

Interviewed: Y / (N)

Last Name: _____ First Name: _____

Address: _____

County: _____

Home Phone: _____ Office Phone: _____

Number of Occupants/persons at this location _____ Age of Occupants _____

2. OWNER OR LANDLORD: (Check if same as occupant ____)

Interviewed: Y / (N)

Last Name: _____ First Name: _____

Address: _____

County: _____

Home Phone: _____ Office Phone: _____

3. BUILDING CHARACTERISTICS

Type of Building: (Circle appropriate response)

Residential
Industrial

School
Church

Commercial/Multi-use
Other: _____

If the property is residential, type? (Circle appropriate response) No

Ranch	2-Family	3-Family
Raised Ranch	Split Level	Colonial
Cape Cod	Contemporary	Mobile Home
Duplex	Apartment House	Townhouses/Condos
Modular	Log Home	Other: _____

If multiple units, how many? _____

If the property is commercial, type?

Business Type(s) shelter

Does it include residences (i.e., multi-use)? (Y)/N If yes, how many? _____

Other characteristics:

Number of floors 6 Building age _____

Is the building insulated? (Y)/N How air tight? Tight / (Average) / Not Tight

4. AIRFLOW

Use air current tubes or tracer smoke to evaluate airflow patterns and qualitatively describe:

Airflow between floors

Potential air exchange (pathway) from elevator, no direct

Airflow near source

Outdoor air infiltration

Summa canisters placed in common area in the basement

(part of common area is open to lobby)

Infiltration into air ducts

5. BASEMENT AND CONSTRUCTION CHARACTERISTICS (Circle all that apply)

- a. Above grade construction: wood frame concrete stone brick
- b. Basement type: full crawlspace slab other _____
- c. Basement floor: concrete dirt stone other _____
- d. Basement floor: uncovered covered covered with _____
- e. Concrete floor: unsealed sealed sealed with _____
- f. Foundation walls: poured block stone other _____
- g. Foundation walls: unsealed sealed sealed with _____
- h. The basement is: wet damp dry moldy
- i. The basement is: finished unfinished partially finished
- j. Sump present? Y / N
- k. Water in sump? Y / N / not applicable

Basement/Lowest level depth below grade: _____ (feet)

Identify potential soil vapor entry points and approximate size (e.g., cracks, utility ports, drains)

6. HEATING, VENTING and AIR CONDITIONING (Circle all that apply)

Type of heating system(s) used in this building: (circle all that apply – note primary)

Hot air circulation	Heat pump	Hot water baseboard
Space Heaters	Stream radiation	Radiant floor
Electric baseboard	Wood stove	Outdoor wood boiler
		Other _____

The primary type of fuel used is:

Natural Gas	Fuel Oil	Kerosene
Electric	Propane	Solar
Wood	Coal	

Domestic hot water tank fueled by: _____

Boiler/furnace located in: Basement Outdoors Main Floor Other _____

Air conditioning: Central Air Window units Open Windows None

Are there air distribution ducts present? ☒ Y / ☐ N

Describe the supply and cold air return ductwork, and its condition where visible, including whether there is a cold air return and the tightness of duct joints. Indicate the locations on the floor plan diagram.

HVAC system is out of service for the duration of air testing.

7. OCCUPANCY

Is basement/lowest level occupied? Full-time ☒ Occasionally ☐ Seldom ☐ Almost Never ☐

Level **General Use of Each Floor (e.g., familyroom, bedroom, laundry, workshop, storage)**

Basement	<u>mechanical rooms, offices, common area</u>
1 st Floor	<u>lobby, dwelling units</u>
2 nd Floor	<u>dwelling units</u>
3 rd Floor	<u></u>
4 th Floor	<u></u>

8. FACTORS THAT MAY INFLUENCE INDOOR AIR QUALITY

- a. Is there an attached garage? Y ☒ N ☐
- b. Does the garage have a separate heating unit? Y / N / ☒ NA ☐
- c. Are petroleum-powered machines or vehicles stored in the garage (e.g., lawnmower, atv, car) Y / N / NA
Please specify _____
- d. Has the building ever had a fire? Y / N When? _____
- e. Is a kerosene or unvented gas space heater present? Y ☒ N ☐ Where? _____
- f. Is there a workshop or hobby/craft area? Y / N Where & Type? _____
- g. Is there smoking in the building? Y ☒ N ☐ How frequently? _____
- h. Have cleaning products been used recently? ☒ Y / ☐ N When & Type? see list
- i. Have cosmetic products been used recently? Y ☒ N ☐ When & Type? _____

- j. Has painting/staining been done in the last 6 months? Y / N Where & When? _____
- k. Is there new carpet, drapes or other textiles? Y / N Where & When? _____
- l. Have air fresheners been used recently? Y / N When & Type? _____
- m. Is there a kitchen exhaust fan? Y / N If yes, where vented? _____
- n. Is there a bathroom exhaust fan? Y / N If yes, where vented? _____
- o. Is there a clothes dryer? Y / N If yes, is it vented outside? Y / N
- p. Has there been a pesticide application? Y / N When & Type? _____

Are there odors in the building? Y / N

If yes, please describe: _____

Do any of the building occupants use solvents at work? Y / N

(e.g., chemical manufacturing or laboratory, auto mechanic or auto body shop, painting, fuel oil delivery, boiler mechanic, pesticide application, cosmetologist)

If yes, what types of solvents are used? _____

If yes, are their clothes washed at work? Y / N

Do any of the building occupants regularly use or work at a dry-cleaning service? (Circle appropriate response)

Yes, use dry-cleaning regularly (weekly)

Yes, use dry-cleaning infrequently (monthly or less)

Yes, work at a dry-cleaning service

No
Unknown

Is there a radon mitigation system for the building/structure? Y / N Date of Installation: _____

Is the system active or passive? Active/Passive

9. WATER AND SEWAGE

Water Supply: Public Water Drilled Well Driven Well Dug Well Other: _____

Sewage Disposal: Public Sewer Septic Tank Leach Field Dry Well Other: _____

10. RELOCATION INFORMATION (for oil spill residential emergency)

a. Provide reasons why relocation is recommended: _____

b. Residents choose to: remain in home relocate to friends/family relocate to hotel/motel

c. Responsibility for costs associated with reimbursement explained? Y / N


d. Relocation package provided and explained to residents? Y / N

N / A


11. FLOOR PLANS

Draw a plan view sketch of the basement and first floor of the building. Indicate air sampling locations, possible indoor air pollution sources and PID meter readings. If the building does not have a basement, please note.

Basement:

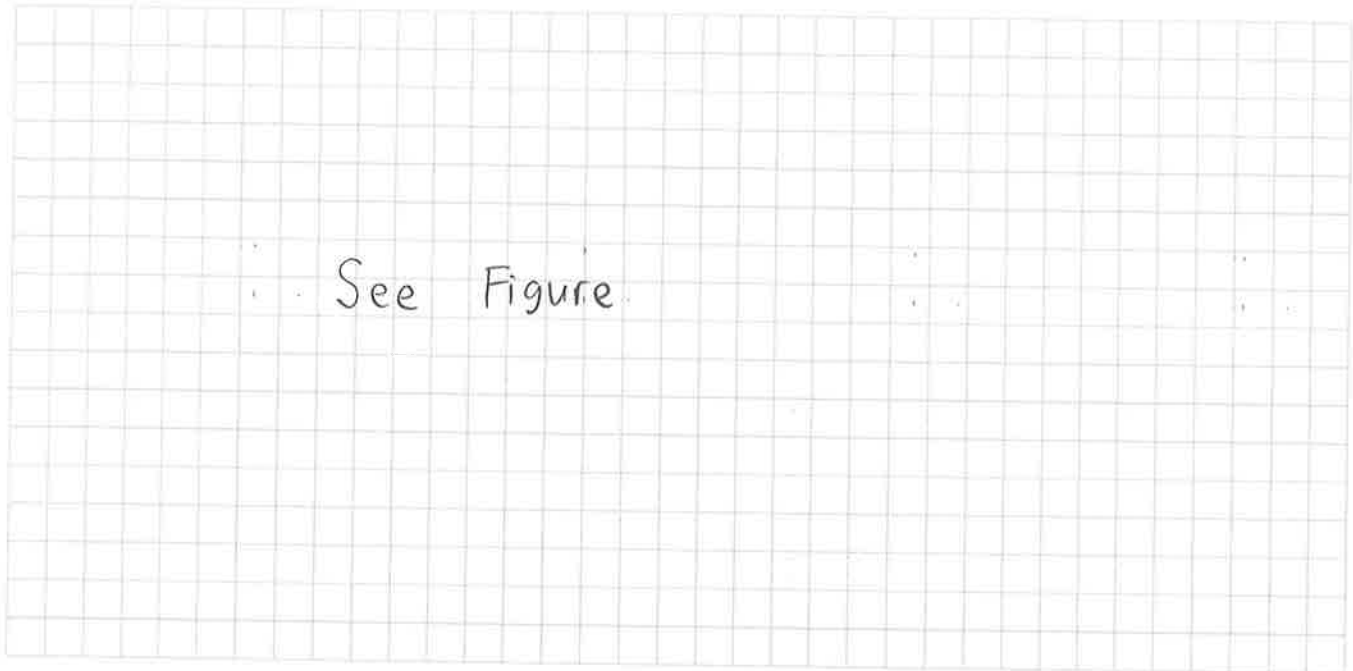

First Floor:

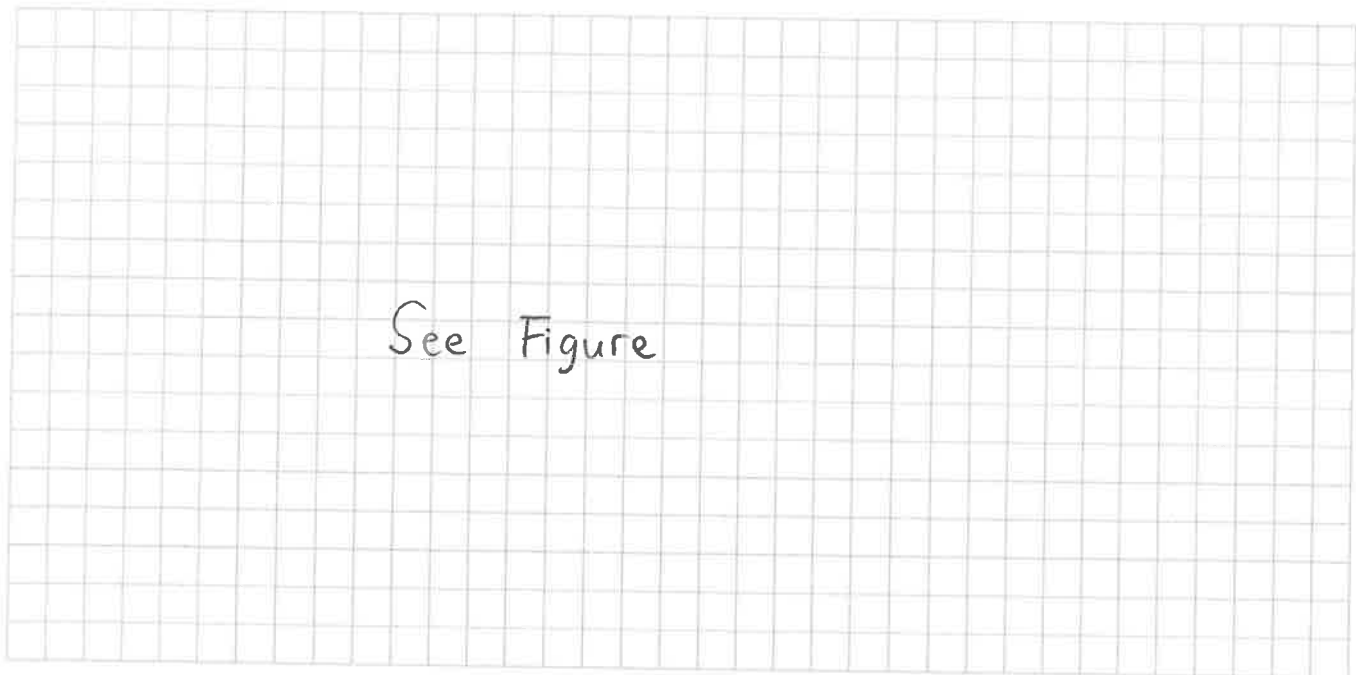

12. OUTDOOR PLOT

Draw a sketch of the area surrounding the building being sampled. If applicable, provide information on spill locations, potential air contamination sources (industries, gas stations, repair shops, landfills, etc.), outdoor air sampling location(s) and PID meter readings.

Also indicate compass direction, wind direction and speed during sampling, the locations of the well and septic system, if applicable, and a qualifying statement to help locate the site on a topographic map.

See Figure

13. PRODUCT INVENTORY FORM

Make & Model of field instrument used: RAE Systems MiniRae 3000+


List specific products found in the residence that have the potential to affect indoor air quality.

Location	Product Description	Size (units)	Condition*	Chemical Ingredients	Field Instrument Reading (units)	Photo** Y/N
compactor room	valspar ultra interior paint + primer	580 fl oz	UO		0.0	Y
Compactor room	Plus 3 Sheetrock compound	4.5 gal	UO		0.0	Y
compactor room	Henry ReadySet premixed mastic adhesive	1 gal	UO		0.0	Y
compactor room	Tilex disinfecting instant mold & mildew remover	1 QT	U	Sodium hypochlorite	0.0	Y
compactor room	Windex glass cleaner	23 oz	U		0.0	Y
compactor room	Hard surface disinfecting wipes		U	Ethyl alcohol	0.0	Y
compactor room	Lynx stainless steel cleaner & polish	18 OZ	U, UO		0.0	Y
compactor room	Febreze air freshner spray	8.8 OZ	U		0.0	Y


* Describe the condition of the product containers as **Unopened (UO)**, **Used (U)**, or **Deteriorated (D)**

** Photographs of the **front and back** of product containers can replace the handwritten list of chemical ingredients. However, the photographs must be of good quality and ingredient labels must be legible.



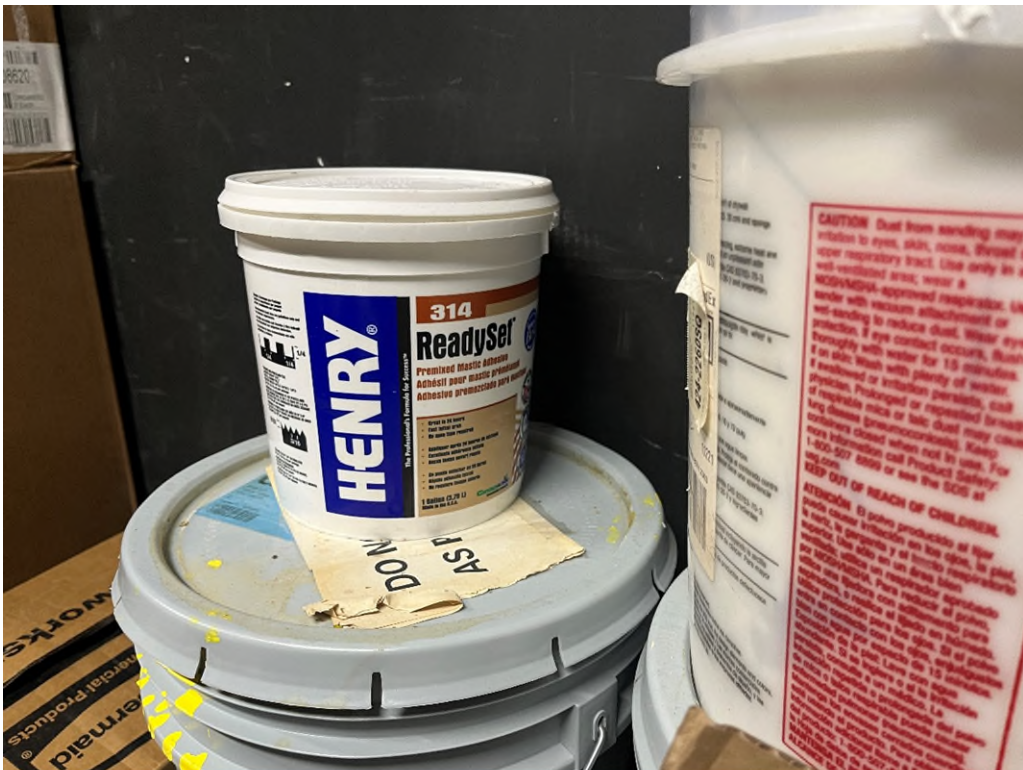



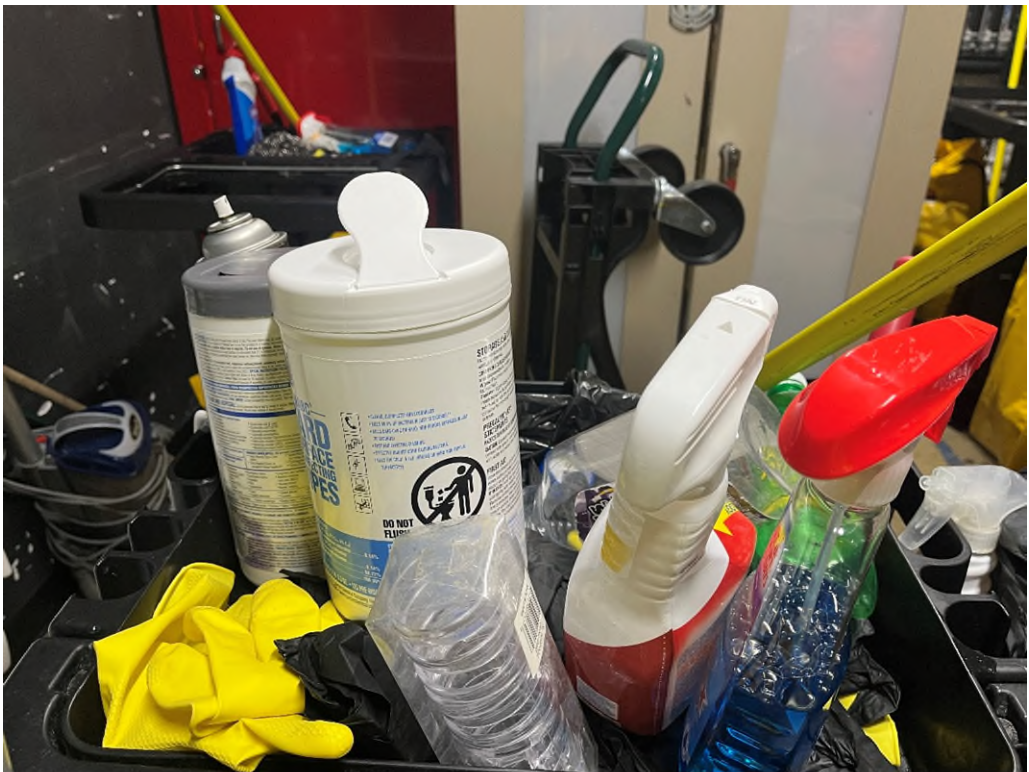



October 17, 2025
Soil Vapor **Intrusion** Investigation Report
1107 Dekalb Avenue, NY
File No. 41.0163281.10

ATTACHMENT C



SOIL VAPOR SAMPLE FIELD LOG

PROJECT NAME: 1107 Dekalb Avenue DATE : 3/24/2025 - 3/25/2024

LOCATION: 1107 Dekalb Avenue, Brooklyn, NY 11222 FILE NO.: 41.0163281.10

GZA Engineer: YH & JN Contractor/Lab: York Laboratories

Weather: 40-50s, Sunny Analytical Method: EPA TO-15 Depth to Water:

Operator: Ground Elevation:

Barometric Pressure: 30.1 in PID Calibration: 0.0/100.0 ppm Water Elevation:

Sample ID	Canister No.	Regulator No.	Sample Depth (ft)	Vacuum Pressure (in.Hg)		Purge Time			Sample Date	Sample Time		PID Reading (ppm)	Container Type	Surface Cover	Driving Effort	Remark
				Start	End	Purge Start	Purge Stop	Elapsed Time		Start	End					
IA-01	16156	21010	3' above ground	-30	-9				3/24/25	11:45	10:05		SC			
IA-02	24116	20949	6' above ground	-30	-8				3/24/25	11:50	10:10		SC			Over vending machine
IA-03	37012	20454	3' above ground	-29	-9				3/24/25	12:20	10:20		SC			
IA-04	28304	20924	3' above ground	-30	-7				3/24/25	11:55	09:53		SC			
IA-05	50247	20929	3' above ground	-30	0		Not Applicable		3/24/25	12:10	09:55		SC			Duplicate sample
IA-06	17347	21046	3' above ground	-29	-8				3/24/25	12:15	10:15		SC			
IA-07	49149	20945	6' above ground	-30	-8				3/24/25	12:05	10:00		SC			Over vending machine
IA-08	24113	20923	3' above ground	-27	-6				3/24/25	12:00	09:50		SC			
OA-01	10727	20431	3' above ground	-28	-2				3/24/25	12:40	10:25		SC			

ABBREVIATIONS:

ft. - feet

in.Hg- Inches of mercury

L/min. - liters per minute

cu. Ft. - cubic feet

ppm - parts per million

NA - not applicable

CONTAINER TYPE	SURFACE COVER	PROBE DRIVING EFFORT	SOIL MOISTURE CONTENT
TB -Tedlar Bag	SO - Soil	E - Easy	D- Dry
SC- Suma Canister	GIL - Grass/Loam	M - Moderate	M- Moderate
ST- Sorbant Tube	Asph - Asphalt	D - Difficult	W - Wet
	Cncrt - Concrete	R - Rellisal	S - Saturated

REMARKS:

DOH Low limit



October 17, 2025
Soil Vapor **Intrusion** Investigation Report
1107 Dekalb Avenue, NY
File No. 41.0163281.10

ATTACHMENT D



Photographic Log

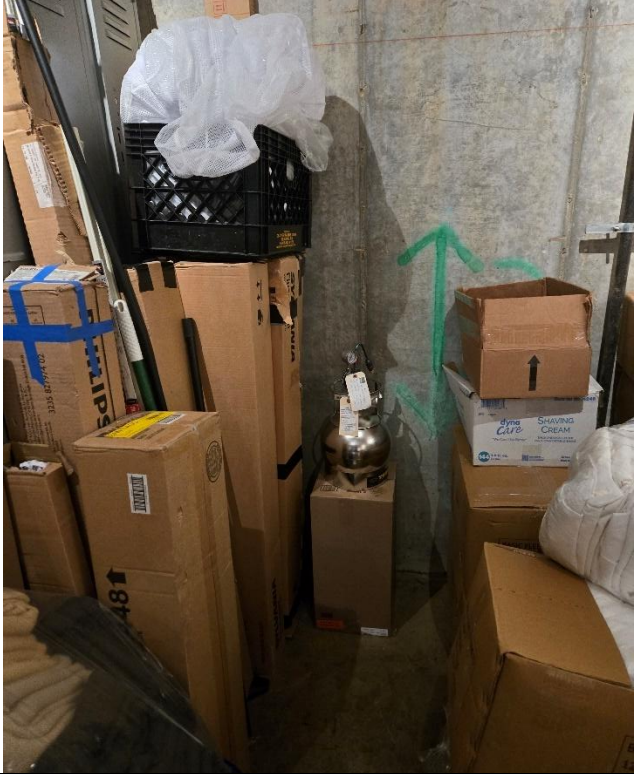
Client Name: ABC NY Inc.		Site Location: 1107 Dekalb Avenue - Brooklyn, NY	Project No. 41.0163281.10
Photo No. 1	Date: 3/24/2025		
Direction Photo Taken: West			
Description: IA-01 – placed in the laundry room			

Photo No. 2	Date: 3/24/2025	
Direction Photo Taken: West		
Description: IA-02		



Photographic Log

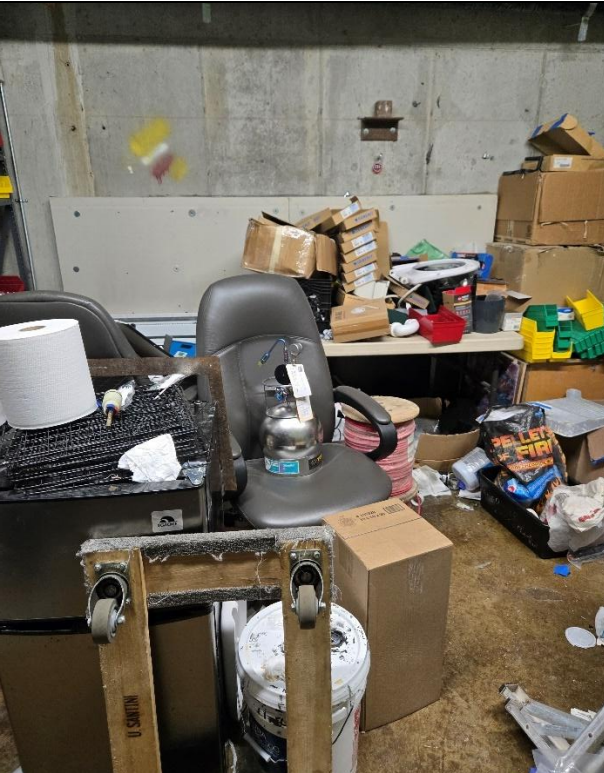
Client Name: ABC NY Inc.		Site Location: 1107 Dekalb Avenue - Brooklyn, NY	Project No. 41.0163281.10
Photo No. 3	Date: 3/24/2025		
Direction Photo Taken: South			
Description: IA-03 – placed in the storage room			

Photo No. 4	Date: 3/24/2025		
Direction Photo Taken: West			
Description: IA-04 – placed in the compactor room			



Photographic Log

Client Name: ABC NY Inc.		Site Location: 1107 Dekalb Avenue - Brooklyn, NY	Project No. 41.0163281.10
Photo No. 5	Date: 3/24/2025		
Direction Photo Taken: Southwest			
Description: IA-05 and duplicate – placed near the entrance of the boiler room			

Photo No. 6	Date: 3/24/2025		
Direction Photo Taken: East			
Description: IA-06 – placed in the electrical room			



Client Name: ABC NY Inc.		Site Location: 1107 Dekalb Avenue - Brooklyn, NY	Project No. 41.0163281.10
Photo No. 7	Date: 3/24/2025		
Direction Photo Taken: Southwest			
Description: IA-07			

Photo No. 8	Date: 3/24/2025	
Direction Photo Taken: North		
Description: IA-08 – placed near the SSDS system gauge		



Photographic Log

Client Name: ABC NY Inc.		Site Location: 1107 Dekalb Avenue - Brooklyn, NY	Project No. 41.0163281.10
Photo No. 9	Date: 3/24/2025		
Direction Photo Taken: South			
Description: OA-01 – placed near the HVAC and is currently out of service			


Photo No. 10	Date: 3/24/2025		
Direction Photo Taken: East			
Description: SSDS riser pipes located near HVAC			



Photographic Log

Client Name: ABC NY Inc.		Site Location: 1107 Dekalb Avenue - Brooklyn, NY	Project No. 41.0163281.10
Photo No. 11	Date: 3/25/2025		
Direction Photo Taken: West			
Description: SVE system located in compactor room – the system is turned off for the SVI sampling event			
Photo No. 12	Date: 3/25/2025		
Direction Photo Taken: North			
Description: SSDS system gauge			

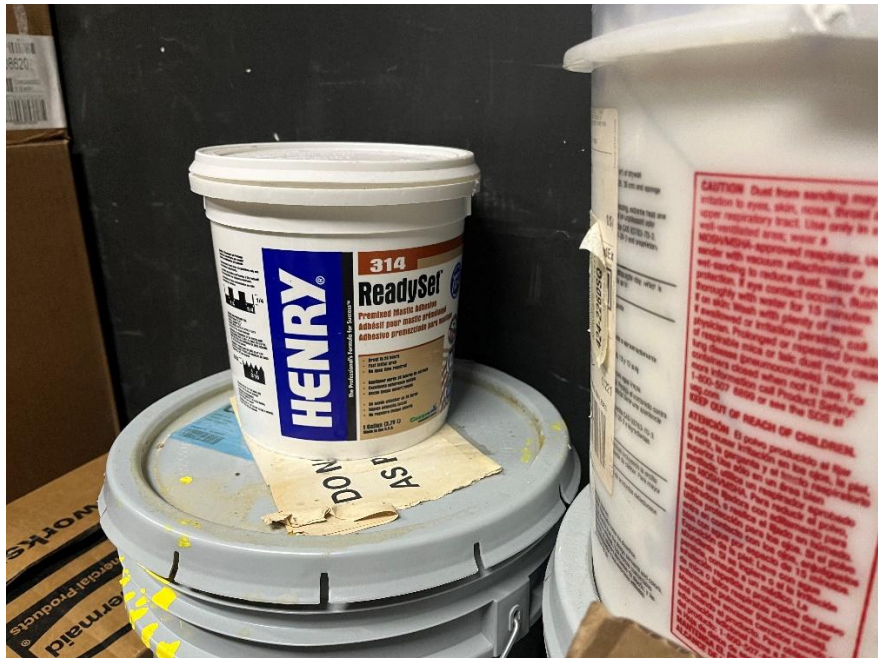

Client Name: ABC NY Inc.		Site Location: 1107 Dekalb Avenue - Brooklyn, NY	Project No. 41.0163281.10
Photo No. 13	Date: 3/24/2025		
Direction Photo Taken: West			
Description: Several chemicals, including household cleaning products, stainless steel cleaner, sheetrock compound, and paint, were observed throughout the building.			



October 17, 2025
Soil Vapor **Intrusion** Investigation Report
1107 Dekalb Avenue, NY
File No. 41.0163281.10

ATTACHMENT E



Site Inspection Checklist - Cover System

Client: ABC NY Inc.

Site: 1107 Dekalb Avenue, Brooklyn (Former Getty Service Station)

Time: 12:03 PM 3/24/2025

Weather: 30-50s, Rain

Inspector: Yunmee Han & Jazlyn Natalie

Visual Inspection of the Concrete Slab of the Building

Building Interior

Describe General Condition of Slab Good

Describe any cracks/penetration None

Describe any patching None

Visual Inspection of Sidewalks/Paved Areas

Building Exterior

Describe General Condition of Slab Good

Describe any cracks/penetration None

Describe any patching None

Additional comments regarding repairs needed and/or maintenance at this time:

N/A

Signature _____

Date: 3/24/2025



Soil Vapor Extraction Inspection Form

Client: ABC NY Inc.

Site: 1107 Dekalb Avenue (Former Getty Service Station)

Time and Date: 12:07 pm, March 24, 2025

Weather: 30-50s, Rain

Inspector: Yunmee Han and Jazlyn Natalie

Extraction Point	Vacuum (iwc)
Influent Vacuum	N/A
Sample Ports	PID (ppm) N/A
Before Carbon	N/A
Between Carbon	N/A
After Carbon	N/A

Inspection:	Yes/No	Comments
Blower Operating?	No	SVE system is off for the SVI sampling
Spare Carbon Drums?	No	
System Integrity?	Good	

Additional Comments/Notes:


SVE system is off for the SVI sampling event

SSDS riser manometer readings: ~1.75 inches of water/0.0631 psi (all three manometers).



October 17, 2025
Soil Vapor **Intrusion** Investigation Report
1107 Dekalb Avenue, NY
File No. 41.0163281.10

ATTACHMENT F



Technical Report

prepared for:

GZA GeoEnvironmental, Inc. - NYC

104 West 29th Street, 10th Floor

New York NY, 10001

Attention: Mark Hutson

Report Date: 04/17/2025

Client Project ID: 41.0163281.10 1107 Dekalb Ave

York Project (SDG) No.: 25C1573

Stratford, CT Laboratory IDs:
NY:10854, NJ: CT005, PA: 68-0440, CT: PH-0723



Richmond Hill, NY Laboratory IDs:
NY:12058, NJ: NY037, CT: PH-0721, NH: 2097,
EPA: NY01600

120 RESEARCH DRIVE
www.YORKLAB.com

STRATFORD, CT 06615
(203) 325-1371



132-02 89th AVENUE
FAX (203) 357-0166

RICHMOND HILL, NY 11418
ClientServices@yorklab.com

Report Date: 04/17/2025
Client Project ID: 41.0163281.10 1107 Dekalb Ave
York Project (SDG) No.: 25C1573

GZA GeoEnvironmental, Inc. - NYC
104 West 29th Street, 10th Floor
New York NY, 10001
Attention: Mark Hutson

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on March 25, 2025 and listed below. The project was identified as your project: **41.0163281.10 1107 Dekalb Ave.**

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Sample and Analysis Qualifiers section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the Sample and Data Qualifiers Relating to This Work Order section of this report and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
25C1573-01	IA-01	Indoor Ambient Air	03/25/2025	03/25/2025
25C1573-02	IA-02	Indoor Ambient Air	03/25/2025	03/25/2025
25C1573-03	IA-03	Indoor Ambient Air	03/25/2025	03/25/2025
25C1573-04	IA-04	Indoor Ambient Air	03/25/2025	03/25/2025
25C1573-05	IA-05	Indoor Ambient Air	03/25/2025	03/25/2025
25C1573-06	IA-05- Duplicate	Indoor Ambient Air	03/25/2025	03/25/2025
25C1573-08	IA-07	Indoor Ambient Air	03/25/2025	03/25/2025
25C1573-09	IA-08	Indoor Ambient Air	03/25/2025	03/25/2025
25C1573-10	OA-01	Outdoor Ambient Ai	03/25/2025	03/25/2025

General Notes for York Project (SDG) No.: 25C1573

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All analyses conducted met method or Laboratory SOP requirements. See the Sample and Data Qualifiers Section for further information.
6. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
7. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.
8. Analyses conducted at York Analytical Laboratories, Inc. Stratford, CT are indicated by NY Cert. No. 10854, NJ Cert No. CT005, PA Cert No. 68-04440, CT Cert No. PH-0723; those conducted at York Analytical Laboratories, Inc., Richmond Hill, NY are indicated by NY Cert. No. 12058, NJ Cert No. NY037, CT Cert No. PH-0721, NH Cert No. 2097, EPA Cert No. NY01600.


Approved By:



Cassie L. Mosher
Laboratory Manager

Date: 04/17/2025





Sample Information

Client Sample ID: IA-01

York Sample ID: 25C1573-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 10:05 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	* 1,1,1,2-Tetrachloroethane	ND		ug/m ³	0.71	1.037	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 16:04	YR
71-55-6	1,1,1-Trichloroethane	ND		ug/m ³	0.57	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/m ³	0.71	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/m ³	0.79	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
79-00-5	1,1,2-Trichloroethane	ND		ug/m ³	0.57	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
75-34-3	1,1-Dichloroethane	ND		ug/m ³	0.42	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
75-35-4	1,1-Dichloroethylene	ND		ug/m ³	0.10	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
120-82-1	1,2,4-Trichlorobenzene	ND		ug/m ³	0.77	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
95-63-6	1,2,4-Trimethylbenzene	0.76		ug/m ³	0.51	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
106-93-4	1,2-Dibromoethane	ND		ug/m ³	0.80	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
95-50-1	1,2-Dichlorobenzene	ND		ug/m ³	0.62	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
107-06-2	1,2-Dichloroethane	ND		ug/m ³	0.42	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
78-87-5	1,2-Dichloropropane	ND		ug/m ³	0.48	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
76-14-2	1,2-Dichlorotetrafluoroethane	ND		ug/m ³	0.72	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
108-67-8	1,3,5-Trimethylbenzene	ND		ug/m ³	0.51	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
106-99-0	1,3-Butadiene	ND		ug/m ³	0.69	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
541-73-1	1,3-Dichlorobenzene	ND		ug/m ³	0.62	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
142-28-9	* 1,3-Dichloropropane	ND		ug/m ³	0.48	1.037	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 16:04	YR
106-46-7	1,4-Dichlorobenzene	0.62		ug/m ³	0.62	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
123-91-1	1,4-Dioxane	ND		ug/m ³	0.75	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
540-84-1	* 2,2,4-Trimethylpentane	1.2		ug/m ³	0.24	1.037	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 16:04	YR
78-93-3	2-Butanone	1.8		ug/m ³	0.31	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR



Sample Information

Client Sample ID: IA-01

York Sample ID: 25C1573-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 10:05 am

03/25/2025

Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
591-78-6	* 2-Hexanone	ND		ug/m ³	0.85	1.037	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 16:04	YR
107-05-1	3-Chloropropene	ND		ug/m ³	1.6	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
108-10-1	4-Methyl-2-pentanone	ND		ug/m ³	0.42	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
67-64-1	Acetone	32		ug/m ³	2.0	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
107-13-1	Acrylonitrile	ND		ug/m ³	2.9	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
71-43-2	Benzene	1.3		ug/m ³	0.33	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
100-44-7	Benzyl chloride	ND		ug/m ³	0.54	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
75-27-4	Bromodichloromethane	ND		ug/m ³	0.69	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
75-25-2	Bromoform	ND		ug/m ³	1.1	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
74-83-9	Bromomethane	ND		ug/m ³	0.40	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
75-15-0	Carbon disulfide	ND		ug/m ³	0.32	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
56-23-5	Carbon tetrachloride	0.46		ug/m ³	0.16	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
108-90-7	Chlorobenzene	ND		ug/m ³	0.48	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
75-00-3	Chloroethane	ND		ug/m ³	0.27	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
67-66-3	Chloroform	2.0		ug/m ³	0.51	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
74-87-3	Chloromethane	1.6		ug/m ³	0.21	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
156-59-2	cis-1,2-Dichloroethylene	ND		ug/m ³	0.10	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/m ³	0.47	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
110-82-7	Cyclohexane	ND		ug/m ³	0.36	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
124-48-1	Dibromochloromethane	ND		ug/m ³	0.88	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
75-71-8	Dichlorodifluoromethane	2.5		ug/m ³	0.51	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
141-78-6	* Ethyl acetate	3.3		ug/m ³	0.75	1.037	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 16:04	YR
100-41-4	Ethyl Benzene	0.68		ug/m ³	0.45	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR



Sample Information

Client Sample ID: IA-01

York Sample ID: 25C1573-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 10:05 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
87-68-3	Hexachlorobutadiene	ND		ug/m ³	1.1	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
67-63-0	Isopropanol	47		ug/m ³	1.5	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
80-62-6	Methyl Methacrylate	ND		ug/m ³	0.42	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/m ³	0.37	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
75-09-2	Methylene chloride	ND		ug/m ³	2.2	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
91-20-3	* Naphthalene	ND		ug/m ³	1.1	1.037	EPA TO-15 Certifications: NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
142-82-5	n-Heptane	0.85		ug/m ³	0.43	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
110-54-3	n-Hexane	1.2		ug/m ³	0.37	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
95-47-6	o-Xylene	1.2		ug/m ³	0.45	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
179601-23-1	p- & m- Xylenes	2.9		ug/m ³	0.90	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
622-96-8	* p-Ethyltoluene	0.61		ug/m ³	0.51	1.037	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 16:04	YR
115-07-1	* Propylene	3.0		ug/m ³	0.18	1.037	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 16:04	YR
100-42-5	Styrene	ND		ug/m ³	0.44	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
127-18-4	Tetrachloroethylene	1.5		ug/m ³	0.70	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
109-99-9	* Tetrahydrofuran	ND		ug/m ³	0.61	1.037	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 16:04	YR
108-88-3	Toluene	2.8		ug/m ³	0.39	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
156-60-5	trans-1,2-Dichloroethylene	ND		ug/m ³	0.41	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/m ³	0.47	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
79-01-6	Trichloroethylene	ND		ug/m ³	0.14	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
75-69-4	Trichlorofluoromethane (Freon 11)	1.3		ug/m ³	0.58	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
108-05-4	Vinyl acetate	ND		ug/m ³	0.37	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
593-60-2	Vinyl bromide	ND		ug/m ³	0.45	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR
75-01-4	Vinyl Chloride	ND		ug/m ³	0.13	1.037	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 16:04	YR



Sample Information

Client Sample ID: IA-01

York Sample ID: 25C1573-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 10:05 am

03/25/2025

Sample Information

Client Sample ID: IA-02

York Sample ID: 25C1573-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 10:10 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	* 1,1,1,2-Tetrachloroethane	ND		ug/m ³	0.59	0.863	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 17:09	YR
71-55-6	1,1,1-Trichloroethane	ND		ug/m ³	0.47	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/m ³	0.59	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/m ³	0.66	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
79-00-5	1,1,2-Trichloroethane	ND		ug/m ³	0.47	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
75-34-3	1,1-Dichloroethane	ND		ug/m ³	0.35	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
75-35-4	1,1-Dichloroethylene	ND		ug/m ³	0.086	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
120-82-1	1,2,4-Trichlorobenzene	ND		ug/m ³	0.64	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
95-63-6	1,2,4-Trimethylbenzene	0.51		ug/m ³	0.42	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
106-93-4	1,2-Dibromoethane	ND		ug/m ³	0.66	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
95-50-1	1,2-Dichlorobenzene	ND		ug/m ³	0.52	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
107-06-2	1,2-Dichloroethane	ND		ug/m ³	0.35	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
78-87-5	1,2-Dichloropropane	ND		ug/m ³	0.40	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
76-14-2	1,2-Dichlorotetrafluoroethane	ND		ug/m ³	0.60	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
108-67-8	1,3,5-Trimethylbenzene	ND		ug/m ³	0.42	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
106-99-0	1,3-Butadiene	ND		ug/m ³	0.57	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
541-73-1	1,3-Dichlorobenzene	ND		ug/m ³	0.52	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
142-28-9	* 1,3-Dichloropropane	ND		ug/m ³	0.40	0.863	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 17:09	YR
106-46-7	1,4-Dichlorobenzene	ND		ug/m ³	0.52	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR



Sample Information

Client Sample ID: IA-02

York Sample ID: 25C1573-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 10:10 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
123-91-1	1,4-Dioxane	ND		ug/m ³	0.62	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
540-84-1	* 2,2,4-Trimethylpentane	0.97		ug/m ³	0.20	0.863	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 17:09	YR
78-93-3	2-Butanone	1.9		ug/m ³	0.25	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
591-78-6	* 2-Hexanone	ND		ug/m ³	0.71	0.863	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 17:09	YR
107-05-1	3-Chloropropene	ND		ug/m ³	1.4	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
108-10-1	4-Methyl-2-pentanone	ND		ug/m ³	0.35	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
67-64-1	Acetone	45		ug/m ³	1.6	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
107-13-1	Acrylonitrile	10		ug/m ³	2.4	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
71-43-2	Benzene	1.6		ug/m ³	0.28	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
100-44-7	Benzyl chloride	ND		ug/m ³	0.45	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
75-27-4	Bromodichloromethane	ND		ug/m ³	0.58	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
75-25-2	Bromoform	ND		ug/m ³	0.89	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
74-83-9	Bromomethane	ND		ug/m ³	0.34	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
75-15-0	Carbon disulfide	ND		ug/m ³	0.27	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
56-23-5	Carbon tetrachloride	0.38		ug/m ³	0.14	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
108-90-7	Chlorobenzene	ND		ug/m ³	0.40	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
75-00-3	Chloroethane	ND		ug/m ³	0.23	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
67-66-3	Chloroform	1.3		ug/m ³	0.42	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
74-87-3	Chloromethane	1.5		ug/m ³	0.18	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
156-59-2	cis-1,2-Dichloroethylene	ND		ug/m ³	0.086	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/m ³	0.39	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
110-82-7	Cyclohexane	0.33		ug/m ³	0.30	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
124-48-1	Dibromochloromethane	ND		ug/m ³	0.74	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR



Sample Information

Client Sample ID: IA-02

York Sample ID: 25C1573-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 10:10 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
75-71-8	Dichlorodifluoromethane	2.4		ug/m ³	0.43	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
141-78-6	* Ethyl acetate	22		ug/m ³	0.62	0.863	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 17:09	YR
100-41-4	Ethyl Benzene	0.52		ug/m ³	0.37	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
87-68-3	Hexachlorobutadiene	ND		ug/m ³	0.92	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
67-63-0	Isopropanol	38		ug/m ³	1.3	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
80-62-6	Methyl Methacrylate	ND		ug/m ³	0.35	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/m ³	0.31	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
75-09-2	Methylene chloride	ND		ug/m ³	1.8	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
91-20-3	* Naphthalene	ND		ug/m ³	0.90	0.863	EPA TO-15 Certifications: NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
142-82-5	n-Heptane	0.81		ug/m ³	0.35	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
110-54-3	n-Hexane	1.1		ug/m ³	0.30	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
95-47-6	o-Xylene	0.75		ug/m ³	0.37	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
179601-23-1	p- & m- Xylenes	2.0		ug/m ³	0.75	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
622-96-8	* p-Ethyltoluene	0.42		ug/m ³	0.42	0.863	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 17:09	YR
115-07-1	* Propylene	2.6		ug/m ³	0.15	0.863	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 17:09	YR
100-42-5	Styrene	ND		ug/m ³	0.37	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
127-18-4	Tetrachloroethylene	1.5		ug/m ³	0.59	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
109-99-9	* Tetrahydrofuran	0.64		ug/m ³	0.51	0.863	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 17:09	YR
108-88-3	Toluene	5.9		ug/m ³	0.33	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
156-60-5	trans-1,2-Dichloroethylene	ND		ug/m ³	0.34	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/m ³	0.39	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
79-01-6	Trichloroethylene	ND		ug/m ³	0.12	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR



Sample Information

Client Sample ID: IA-02

York Sample ID: 25C1573-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 10:10 am

03/25/2025

Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
75-69-4	Trichlorofluoromethane (Freon 11)	1.3		ug/m ³	0.48	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
108-05-4	Vinyl acetate	ND		ug/m ³	0.30	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
593-60-2	Vinyl bromide	ND		ug/m ³	0.38	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR
75-01-4	Vinyl Chloride	ND		ug/m ³	0.11	0.863	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 17:09	YR

Sample Information

Client Sample ID: IA-03

York Sample ID: 25C1573-03

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 10:20 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	* 1,1,1,2-Tetrachloroethane	ND		ug/m ³	0.68	0.989	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 18:14	YR
71-55-6	1,1,1-Trichloroethane	ND		ug/m ³	0.54	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/m ³	0.68	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/m ³	0.76	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
79-00-5	1,1,2-Trichloroethane	ND		ug/m ³	0.54	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
75-34-3	1,1-Dichloroethane	ND		ug/m ³	0.40	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
75-35-4	1,1-Dichloroethylene	ND		ug/m ³	0.098	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
120-82-1	1,2,4-Trichlorobenzene	ND		ug/m ³	0.73	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
95-63-6	1,2,4-Trimethylbenzene	0.58		ug/m ³	0.49	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
106-93-4	1,2-Dibromoethane	ND		ug/m ³	0.76	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
95-50-1	1,2-Dichlorobenzene	ND		ug/m ³	0.59	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
107-06-2	1,2-Dichloroethane	ND		ug/m ³	0.40	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR



Sample Information

Client Sample ID: IA-03

York Sample ID: 25C1573-03

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 10:20 am

03/25/2025

Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
78-87-5	1,2-Dichloropropane	ND		ug/m ³	0.46	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
76-14-2	1,2-Dichlorotetrafluoroethane	ND		ug/m ³	0.69	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
108-67-8	1,3,5-Trimethylbenzene	ND		ug/m ³	0.49	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
106-99-0	1,3-Butadiene	ND		ug/m ³	0.66	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
541-73-1	1,3-Dichlorobenzene	ND		ug/m ³	0.59	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
142-28-9	* 1,3-Dichloropropane	ND		ug/m ³	0.46	0.989	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 18:14	YR
106-46-7	1,4-Dichlorobenzene	ND		ug/m ³	0.59	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
123-91-1	1,4-Dioxane	ND		ug/m ³	0.71	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
540-84-1	* 2,2,4-Trimethylpentane	1.1		ug/m ³	0.23	0.989	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 18:14	YR
78-93-3	2-Butanone	1.8		ug/m ³	0.29	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
591-78-6	* 2-Hexanone	ND		ug/m ³	0.81	0.989	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 18:14	YR
107-05-1	3-Chloropropene	ND		ug/m ³	1.5	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
108-10-1	4-Methyl-2-pentanone	ND		ug/m ³	0.41	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
67-64-1	Acetone	54		ug/m ³	1.9	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
107-13-1	Acrylonitrile	ND		ug/m ³	2.8	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
71-43-2	Benzene	1.1		ug/m ³	0.32	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
100-44-7	Benzyl chloride	ND		ug/m ³	0.51	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
75-27-4	Bromodichloromethane	ND		ug/m ³	0.66	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
75-25-2	Bromoform	ND		ug/m ³	1.0	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
74-83-9	Bromomethane	ND		ug/m ³	0.38	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
75-15-0	Carbon disulfide	ND		ug/m ³	0.31	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
56-23-5	Carbon tetrachloride	0.37		ug/m ³	0.16	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
108-90-7	Chlorobenzene	ND		ug/m ³	0.46	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR



Sample Information

Client Sample ID: IA-03

York Sample ID: 25C1573-03

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 10:20 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
75-00-3	Chloroethane	ND		ug/m ³	0.26	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
67-66-3	Chloroform	1.9		ug/m ³	0.48	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
74-87-3	Chloromethane	1.4		ug/m ³	0.20	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
156-59-2	cis-1,2-Dichloroethylene	ND		ug/m ³	0.098	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/m ³	0.45	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
110-82-7	Cyclohexane	0.34		ug/m ³	0.34	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
124-48-1	Dibromochloromethane	ND		ug/m ³	0.84	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
75-71-8	Dichlorodifluoromethane	2.3		ug/m ³	0.49	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
141-78-6	* Ethyl acetate	13		ug/m ³	0.71	0.989	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 18:14	YR
100-41-4	Ethyl Benzene	3.4		ug/m ³	0.43	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
87-68-3	Hexachlorobutadiene	ND		ug/m ³	1.1	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
67-63-0	Isopropanol	38		ug/m ³	1.5	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
80-62-6	Methyl Methacrylate	ND		ug/m ³	0.40	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/m ³	0.36	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
75-09-2	Methylene chloride	ND		ug/m ³	2.1	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
91-20-3	* Naphthalene	ND		ug/m ³	1.0	0.989	EPA TO-15 Certifications: NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
142-82-5	n-Heptane	0.73		ug/m ³	0.41	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
110-54-3	n-Hexane	1.2		ug/m ³	0.35	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
95-47-6	o-Xylene	1.5		ug/m ³	0.43	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
179601-23-1	p- & m- Xylenes	4.0		ug/m ³	0.86	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
622-96-8	* p-Ethyltoluene	0.53		ug/m ³	0.49	0.989	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 18:14	YR
115-07-1	* Propylene	ND		ug/m ³	0.17	0.989	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 18:14	YR



Sample Information

Client Sample ID: IA-03

York Sample ID: 25C1573-03

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 10:20 am

03/25/2025

Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
100-42-5	Styrene	8.0		ug/m ³	0.42	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
127-18-4	Tetrachloroethylene	1.5		ug/m ³	0.67	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
109-99-9	* Tetrahydrofuran	0.64		ug/m ³	0.58	0.989	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 18:14	YR
108-88-3	Toluene	4.0		ug/m ³	0.37	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
156-60-5	trans-1,2-Dichloroethylene	ND		ug/m ³	0.39	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/m ³	0.45	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
79-01-6	Trichloroethylene	0.16		ug/m ³	0.13	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
75-69-4	Trichlorofluoromethane (Freon 11)	1.3		ug/m ³	0.56	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
108-05-4	Vinyl acetate	ND		ug/m ³	0.35	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
593-60-2	Vinyl bromide	ND		ug/m ³	0.43	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR
75-01-4	Vinyl Chloride	ND		ug/m ³	0.13	0.989	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 18:14	YR

Sample Information

Client Sample ID: IA-04

York Sample ID: 25C1573-04

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 9:53 am

03/25/2025

Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	* 1,1,1,2-Tetrachloroethane	ND		ug/m ³	0.66	0.956	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 19:18	YR
71-55-6	1,1,1-Trichloroethane	ND		ug/m ³	0.52	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/m ³	0.66	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/m ³	0.73	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
79-00-5	1,1,2-Trichloroethane	ND		ug/m ³	0.52	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR



Sample Information

Client Sample ID: IA-04

York Sample ID: 25C1573-04

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 9:53 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
75-34-3	1,1-Dichloroethane	ND		ug/m ³	0.39	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
75-35-4	1,1-Dichloroethylene	ND		ug/m ³	0.095	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
120-82-1	1,2,4-Trichlorobenzene	ND		ug/m ³	0.71	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
95-63-6	1,2,4-Trimethylbenzene	1.6		ug/m ³	0.47	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
106-93-4	1,2-Dibromoethane	ND		ug/m ³	0.73	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
95-50-1	1,2-Dichlorobenzene	ND		ug/m ³	0.57	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
107-06-2	1,2-Dichloroethane	ND		ug/m ³	0.39	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
78-87-5	1,2-Dichloropropane	ND		ug/m ³	0.44	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
76-14-2	1,2-Dichlorotetrafluoroethane	ND		ug/m ³	0.67	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
108-67-8	1,3,5-Trimethylbenzene	0.70		ug/m ³	0.47	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
106-99-0	1,3-Butadiene	ND		ug/m ³	0.63	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
541-73-1	1,3-Dichlorobenzene	ND		ug/m ³	0.57	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
142-28-9	* 1,3-Dichloropropane	ND		ug/m ³	0.44	0.956	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 19:18	YR
106-46-7	1,4-Dichlorobenzene	0.57		ug/m ³	0.57	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
123-91-1	1,4-Dioxane	ND		ug/m ³	0.69	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
540-84-1	* 2,2,4-Trimethylpentane	1.3		ug/m ³	0.22	0.956	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 19:18	YR
78-93-3	2-Butanone	3.2		ug/m ³	0.28	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
591-78-6	* 2-Hexanone	ND		ug/m ³	0.78	0.956	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 19:18	YR
107-05-1	3-Chloropropene	ND		ug/m ³	1.5	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
108-10-1	4-Methyl-2-pentanone	ND		ug/m ³	0.39	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
67-64-1	Acetone	96		ug/m ³	1.8	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
107-13-1	Acrylonitrile	ND		ug/m ³	2.7	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
71-43-2	Benzene	1.1		ug/m ³	0.31	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR



Sample Information

Client Sample ID: IA-04

York Sample ID: 25C1573-04

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 9:53 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
100-44-7	Benzyl chloride	ND		ug/m ³	0.49	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
75-27-4	Bromodichloromethane	1.5		ug/m ³	0.64	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
75-25-2	Bromoform	ND		ug/m ³	0.99	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
74-83-9	Bromomethane	ND		ug/m ³	0.37	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
75-15-0	Carbon disulfide	ND		ug/m ³	0.30	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
56-23-5	Carbon tetrachloride	0.54		ug/m ³	0.15	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
108-90-7	Chlorobenzene	ND		ug/m ³	0.44	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
75-00-3	Chloroethane	ND		ug/m ³	0.25	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
67-66-3	Chloroform	27		ug/m ³	0.47	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
74-87-3	Chloromethane	1.4		ug/m ³	0.20	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
156-59-2	cis-1,2-Dichloroethylene	ND		ug/m ³	0.095	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/m ³	0.43	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
110-82-7	Cyclohexane	0.53		ug/m ³	0.33	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
124-48-1	Dibromochloromethane	ND		ug/m ³	0.81	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
75-71-8	Dichlorodifluoromethane	2.5		ug/m ³	0.47	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
141-78-6	* Ethyl acetate	10		ug/m ³	0.69	0.956	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 19:18	YR
100-41-4	Ethyl Benzene	1.7		ug/m ³	0.42	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
87-68-3	Hexachlorobutadiene	ND		ug/m ³	1.0	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
67-63-0	Isopropanol	29		ug/m ³	1.4	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
80-62-6	Methyl Methacrylate	0.82		ug/m ³	0.39	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/m ³	0.34	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
75-09-2	Methylene chloride	14		ug/m ³	2.0	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
91-20-3	* Naphthalene	ND		ug/m ³	1.0	0.956	EPA TO-15 Certifications: NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR



Sample Information

Client Sample ID: IA-04

York Sample ID: 25C1573-04

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 9:53 am

03/25/2025

Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
142-82-5	n-Heptane	1.3		ug/m ³	0.39	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
110-54-3	n-Hexane	1.2		ug/m ³	0.34	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
95-47-6	o-Xylene	2.9		ug/m ³	0.42	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
179601-23-1	p- & m- Xylenes	7.1		ug/m ³	0.83	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
622-96-8	* p-Ethyltoluene	1.4		ug/m ³	0.47	0.956	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 19:18	YR
115-07-1	* Propylene	3.0		ug/m ³	0.16	0.956	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 19:18	YR
100-42-5	Styrene	ND		ug/m ³	0.41	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
127-18-4	Tetrachloroethylene	8.9		ug/m ³	0.65	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
109-99-9	* Tetrahydrofuran	1.1		ug/m ³	0.56	0.956	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 19:18	YR
108-88-3	Toluene	14		ug/m ³	0.36	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
156-60-5	trans-1,2-Dichloroethylene	ND		ug/m ³	0.38	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/m ³	0.43	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
79-01-6	Trichloroethylene	ND		ug/m ³	0.13	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
75-69-4	Trichlorofluoromethane (Freon 11)	1.3		ug/m ³	0.54	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
108-05-4	Vinyl acetate	ND		ug/m ³	0.34	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
593-60-2	Vinyl bromide	ND		ug/m ³	0.42	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR
75-01-4	Vinyl Chloride	ND		ug/m ³	0.12	0.956	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 19:18	YR

Sample Information

Client Sample ID: IA-05

York Sample ID: 25C1573-05

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 9:55 am

03/25/2025

Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:



Sample Information

Client Sample ID: IA-05

York Sample ID: 25C1573-05

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave


Indoor Ambient Air

March 25, 2025 9:55 am

03/25/2025

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	* 1,1,1,2-Tetrachloroethane	ND		ug/m ³	0.50	0.733	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 20:23	YR
71-55-6	1,1,1-Trichloroethane	ND		ug/m ³	0.40	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/m ³	0.50	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	0.56		ug/m ³	0.56	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
79-00-5	1,1,2-Trichloroethane	ND		ug/m ³	0.40	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
75-34-3	1,1-Dichloroethane	ND		ug/m ³	0.30	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
75-35-4	1,1-Dichloroethylene	ND		ug/m ³	0.073	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
120-82-1	1,2,4-Trichlorobenzene	ND		ug/m ³	0.54	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
95-63-6	1,2,4-Trimethylbenzene	0.65		ug/m ³	0.36	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
106-93-4	1,2-Dibromoethane	ND		ug/m ³	0.56	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
95-50-1	1,2-Dichlorobenzene	ND		ug/m ³	0.44	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
107-06-2	1,2-Dichloroethane	ND		ug/m ³	0.30	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
78-87-5	1,2-Dichloropropane	ND		ug/m ³	0.34	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
76-14-2	1,2-Dichlorotetrafluoroethane	ND		ug/m ³	0.51	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
108-67-8	1,3,5-Trimethylbenzene	ND		ug/m ³	0.36	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
106-99-0	1,3-Butadiene	ND		ug/m ³	0.49	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
541-73-1	1,3-Dichlorobenzene	ND		ug/m ³	0.44	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
142-28-9	* 1,3-Dichloropropane	ND		ug/m ³	0.34	0.733	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 20:23	YR
106-46-7	1,4-Dichlorobenzene	0.53		ug/m ³	0.44	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
123-91-1	1,4-Dioxane	ND		ug/m ³	0.53	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
540-84-1	* 2,2,4-Trimethylpentane	0.99		ug/m ³	0.17	0.733	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 20:23	YR
78-93-3	2-Butanone	1.2		ug/m ³	0.22	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
591-78-6	* 2-Hexanone	ND		ug/m ³	0.60	0.733	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 20:23	YR
107-05-1	3-Chloropropene	ND		ug/m ³	1.1	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR



Sample Information

Client Sample ID: IA-05

York Sample ID: 25C1573-05

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 9:55 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
108-10-1	4-Methyl-2-pentanone	ND		ug/m ³	0.30	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
67-64-1	Acetone	34		ug/m ³	1.4	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
107-13-1	Acrylonitrile	ND		ug/m ³	2.1	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
71-43-2	Benzene	1.5		ug/m ³	0.23	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
100-44-7	Benzyl chloride	ND		ug/m ³	0.38	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
75-27-4	Bromodichloromethane	ND		ug/m ³	0.49	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
75-25-2	Bromoform	ND		ug/m ³	0.76	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
74-83-9	Bromomethane	ND		ug/m ³	0.28	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
75-15-0	Carbon disulfide	ND		ug/m ³	0.23	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
56-23-5	Carbon tetrachloride	0.42		ug/m ³	0.12	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
108-90-7	Chlorobenzene	ND		ug/m ³	0.34	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
75-00-3	Chloroethane	ND		ug/m ³	0.19	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
67-66-3	Chloroform	6.6		ug/m ³	0.36	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
74-87-3	Chloromethane	1.5		ug/m ³	0.15	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
156-59-2	cis-1,2-Dichloroethylene	ND		ug/m ³	0.073	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/m ³	0.33	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
110-82-7	Cyclohexane	0.35		ug/m ³	0.25	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
124-48-1	Dibromochloromethane	ND		ug/m ³	0.62	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
75-71-8	Dichlorodifluoromethane	2.5		ug/m ³	0.36	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
141-78-6	* Ethyl acetate	4.9		ug/m ³	0.53	0.733	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 20:23	YR
100-41-4	Ethyl Benzene	0.48		ug/m ³	0.32	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
87-68-3	Hexachlorobutadiene	ND		ug/m ³	0.78	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
67-63-0	Isopropanol	7.2		ug/m ³	1.1	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR



Sample Information

Client Sample ID: IA-05

York Sample ID: 25C1573-05

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 9:55 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
80-62-6	Methyl Methacrylate	0.57		ug/m ³	0.30	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/m ³	0.26	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
75-09-2	Methylene chloride	ND		ug/m ³	1.5	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
91-20-3	* Naphthalene	ND		ug/m ³	0.77	0.733	EPA TO-15 Certifications: NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
142-82-5	n-Heptane	0.60		ug/m ³	0.30	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
110-54-3	n-Hexane	1.0		ug/m ³	0.26	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
95-47-6	o-Xylene	0.67		ug/m ³	0.32	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
179601-23-1	p- & m- Xylenes	1.7		ug/m ³	0.64	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
622-96-8	* p-Ethyltoluene	0.54		ug/m ³	0.36	0.733	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 20:23	YR
115-07-1	* Propylene	3.9		ug/m ³	0.13	0.733	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 20:23	YR
100-42-5	Styrene	ND		ug/m ³	0.31	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
127-18-4	Tetrachloroethylene	0.89		ug/m ³	0.50	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
109-99-9	* Tetrahydrofuran	0.52		ug/m ³	0.43	0.733	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 20:23	YR
108-88-3	Toluene	3.2		ug/m ³	0.28	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
156-60-5	trans-1,2-Dichloroethylene	ND		ug/m ³	0.29	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/m ³	0.33	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
79-01-6	Trichloroethylene	0.28		ug/m ³	0.098	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
75-69-4	Trichlorofluoromethane (Freon 11)	1.3		ug/m ³	0.41	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
108-05-4	Vinyl acetate	ND		ug/m ³	0.26	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
593-60-2	Vinyl bromide	ND		ug/m ³	0.32	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR
75-01-4	Vinyl Chloride	ND		ug/m ³	0.094	0.733	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 20:23	YR



Sample Information

Client Sample ID: IA-05- Duplicate

York Sample ID: 25C1573-06

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 9:55 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	* 1,1,1,2-Tetrachloroethane	ND		ug/m ³	0.51	0.744	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 21:28	YR
71-55-6	1,1,1-Trichloroethane	ND		ug/m ³	0.41	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/m ³	0.51	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	0.68		ug/m ³	0.57	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
79-00-5	1,1,2-Trichloroethane	ND		ug/m ³	0.41	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
75-34-3	1,1-Dichloroethane	ND		ug/m ³	0.30	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
75-35-4	1,1-Dichloroethylene	ND		ug/m ³	0.074	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
120-82-1	1,2,4-Trichlorobenzene	ND		ug/m ³	0.55	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
95-63-6	1,2,4-Trimethylbenzene	0.88		ug/m ³	0.37	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
106-93-4	1,2-Dibromoethane	ND		ug/m ³	0.57	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
95-50-1	1,2-Dichlorobenzene	ND		ug/m ³	0.45	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
107-06-2	1,2-Dichloroethane	ND		ug/m ³	0.30	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
78-87-5	1,2-Dichloropropane	ND		ug/m ³	0.34	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
76-14-2	1,2-Dichlorotetrafluoroethane	ND		ug/m ³	0.52	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
108-67-8	1,3,5-Trimethylbenzene	ND		ug/m ³	0.37	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
106-99-0	1,3-Butadiene	ND		ug/m ³	0.49	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
541-73-1	1,3-Dichlorobenzene	ND		ug/m ³	0.45	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
142-28-9	* 1,3-Dichloropropane	ND		ug/m ³	0.34	0.744	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 21:28	YR
106-46-7	1,4-Dichlorobenzene	ND		ug/m ³	0.45	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
123-91-1	1,4-Dioxane	ND		ug/m ³	0.54	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
540-84-1	* 2,2,4-Trimethylpentane	ND		ug/m ³	0.17	0.744	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 21:28	YR
78-93-3	2-Butanone	3.5		ug/m ³	0.22	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
591-78-6	* 2-Hexanone	ND		ug/m ³	0.61	0.744	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 21:28	YR



Sample Information

Client Sample ID: IA-05- Duplicate

York Sample ID: 25C1573-06

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 9:55 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
107-05-1	3-Chloropropene	ND		ug/m ³	1.2	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
108-10-1	4-Methyl-2-pentanone	ND		ug/m ³	0.30	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
67-64-1	Acetone	17		ug/m ³	1.4	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
107-13-1	Acrylonitrile	ND		ug/m ³	2.1	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
71-43-2	Benzene	0.97		ug/m ³	0.24	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
100-44-7	Benzyl chloride	ND		ug/m ³	0.39	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
75-27-4	Bromodichloromethane	ND		ug/m ³	0.50	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
75-25-2	Bromoform	ND		ug/m ³	0.77	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
74-83-9	Bromomethane	ND		ug/m ³	0.29	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
75-15-0	Carbon disulfide	ND		ug/m ³	0.23	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
56-23-5	Carbon tetrachloride	0.51		ug/m ³	0.12	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
108-90-7	Chlorobenzene	ND		ug/m ³	0.34	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
75-00-3	Chloroethane	ND		ug/m ³	0.20	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
67-66-3	Chloroform	1.2		ug/m ³	0.36	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
74-87-3	Chloromethane	1.6		ug/m ³	0.15	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
156-59-2	cis-1,2-Dichloroethylene	ND		ug/m ³	0.074	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/m ³	0.34	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
110-82-7	Cyclohexane	0.36		ug/m ³	0.26	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
124-48-1	Dibromochloromethane	ND		ug/m ³	0.63	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
75-71-8	Dichlorodifluoromethane	3.0		ug/m ³	0.37	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
141-78-6	* Ethyl acetate	4.2		ug/m ³	0.54	0.744	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 21:28	YR
100-41-4	Ethyl Benzene	2.8		ug/m ³	0.32	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
87-68-3	Hexachlorobutadiene	ND		ug/m ³	0.79	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR



Sample Information

Client Sample ID: IA-05- Duplicate

York Sample ID: 25C1573-06

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 9:55 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
67-63-0	Isopropanol	26		ug/m ³	1.1	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
80-62-6	Methyl Methacrylate	ND		ug/m ³	0.30	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/m ³	0.27	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
75-09-2	Methylene chloride	ND		ug/m ³	1.6	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
91-20-3	* Naphthalene	ND		ug/m ³	0.78	0.744	EPA TO-15 Certifications: NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
142-82-5	n-Heptane	0.46		ug/m ³	0.30	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
110-54-3	n-Hexane	0.79		ug/m ³	0.26	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
95-47-6	o-Xylene	2.7		ug/m ³	0.32	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
179601-23-1	p- & m- Xylenes	12		ug/m ³	0.65	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
622-96-8	* p-Ethyltoluene	0.66		ug/m ³	0.37	0.744	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 21:28	YR
115-07-1	* Propylene	ND		ug/m ³	0.13	0.744	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 21:28	YR
100-42-5	Styrene	ND		ug/m ³	0.32	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
127-18-4	Tetrachloroethylene	2.9		ug/m ³	0.50	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
109-99-9	* Tetrahydrofuran	2.4		ug/m ³	0.44	0.744	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 21:28	YR
108-88-3	Toluene	3.4		ug/m ³	0.28	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
156-60-5	trans-1,2-Dichloroethylene	ND		ug/m ³	0.29	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/m ³	0.34	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
79-01-6	Trichloroethylene	0.12		ug/m ³	0.10	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
75-69-4	Trichlorofluoromethane (Freon 11)	1.6		ug/m ³	0.42	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
108-05-4	Vinyl acetate	ND		ug/m ³	0.26	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
593-60-2	Vinyl bromide	ND		ug/m ³	0.33	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR
75-01-4	Vinyl Chloride	ND		ug/m ³	0.095	0.744	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 21:28	YR



Sample Information

Client Sample ID: IA-07

York Sample ID: 25C1573-08

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 10:00 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	* 1,1,1,2-Tetrachloroethane	ND		ug/m ³	0.71	1.033	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 22:32	YR
71-55-6	1,1,1-Trichloroethane	ND		ug/m ³	0.56	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/m ³	0.71	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/m ³	0.79	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
79-00-5	1,1,2-Trichloroethane	ND		ug/m ³	0.56	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
75-34-3	1,1-Dichloroethane	ND		ug/m ³	0.42	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
75-35-4	1,1-Dichloroethylene	ND		ug/m ³	0.10	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
120-82-1	1,2,4-Trichlorobenzene	ND		ug/m ³	0.77	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
95-63-6	1,2,4-Trimethylbenzene	0.66		ug/m ³	0.51	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
106-93-4	1,2-Dibromoethane	ND		ug/m ³	0.79	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
95-50-1	1,2-Dichlorobenzene	ND		ug/m ³	0.62	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
107-06-2	1,2-Dichloroethane	ND		ug/m ³	0.42	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
78-87-5	1,2-Dichloropropane	ND		ug/m ³	0.48	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
76-14-2	1,2-Dichlorotetrafluoroethane	ND		ug/m ³	0.72	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
108-67-8	1,3,5-Trimethylbenzene	ND		ug/m ³	0.51	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
106-99-0	1,3-Butadiene	ND		ug/m ³	0.69	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
541-73-1	1,3-Dichlorobenzene	ND		ug/m ³	0.62	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
142-28-9	* 1,3-Dichloropropane	ND		ug/m ³	0.48	1.033	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 22:32	YR
106-46-7	1,4-Dichlorobenzene	ND		ug/m ³	0.62	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
123-91-1	1,4-Dioxane	ND		ug/m ³	0.74	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
540-84-1	* 2,2,4-Trimethylpentane	1.1		ug/m ³	0.24	1.033	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 22:32	YR
78-93-3	2-Butanone	1.8		ug/m ³	0.30	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
591-78-6	* 2-Hexanone	ND		ug/m ³	0.85	1.033	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 22:32	YR



Sample Information

Client Sample ID: IA-07

York Sample ID: 25C1573-08

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 10:00 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
107-05-1	3-Chloropropene	ND		ug/m ³	1.6	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
108-10-1	4-Methyl-2-pentanone	ND		ug/m ³	0.42	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
67-64-1	Acetone	33		ug/m ³	2.0	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
107-13-1	Acrylonitrile	5.8		ug/m ³	2.9	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
71-43-2	Benzene	2.6		ug/m ³	0.33	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
100-44-7	Benzyl chloride	ND		ug/m ³	0.53	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
75-27-4	Bromodichloromethane	ND		ug/m ³	0.69	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
75-25-2	Bromoform	ND		ug/m ³	1.1	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
74-83-9	Bromomethane	ND		ug/m ³	0.40	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
75-15-0	Carbon disulfide	ND		ug/m ³	0.32	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
56-23-5	Carbon tetrachloride	ND		ug/m ³	0.16	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
108-90-7	Chlorobenzene	ND		ug/m ³	0.48	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
75-00-3	Chloroethane	ND		ug/m ³	0.27	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
67-66-3	Chloroform	1.8		ug/m ³	0.50	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
74-87-3	Chloromethane	2.7		ug/m ³	0.21	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
156-59-2	cis-1,2-Dichloroethylene	ND		ug/m ³	0.10	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/m ³	0.47	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
110-82-7	Cyclohexane	ND		ug/m ³	0.36	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
124-48-1	Dibromochloromethane	ND		ug/m ³	0.88	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
75-71-8	Dichlorodifluoromethane	2.6		ug/m ³	0.51	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
141-78-6	* Ethyl acetate	3.3		ug/m ³	0.74	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
100-41-4	Ethyl Benzene	0.45		ug/m ³	0.45	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
87-68-3	Hexachlorobutadiene	ND		ug/m ³	1.1	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR



Sample Information

Client Sample ID: IA-07

York Sample ID: 25C1573-08

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 10:00 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
67-63-0	Isopropanol	38		ug/m ³	1.5	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
80-62-6	Methyl Methacrylate	ND		ug/m ³	0.42	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/m ³	0.37	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
75-09-2	Methylene chloride	ND		ug/m ³	2.2	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
91-20-3	* Naphthalene	ND		ug/m ³	1.1	1.033	EPA TO-15 Certifications: NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
142-82-5	n-Heptane	0.80		ug/m ³	0.42	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
110-54-3	n-Hexane	1.1		ug/m ³	0.36	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
95-47-6	o-Xylene	0.72		ug/m ³	0.45	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
179601-23-1	p- & m- Xylenes	1.9		ug/m ³	0.90	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
622-96-8	* p-Ethyltoluene	ND		ug/m ³	0.51	1.033	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 22:32	YR
115-07-1	* Propylene	3.2		ug/m ³	0.18	1.033	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 22:32	YR
100-42-5	Styrene	ND		ug/m ³	0.44	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
127-18-4	Tetrachloroethylene	1.7		ug/m ³	0.70	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
109-99-9	* Tetrahydrofuran	ND		ug/m ³	0.61	1.033	EPA TO-15 Certifications:	04/16/2025 08:00	04/16/2025 22:32	YR
108-88-3	Toluene	3.0		ug/m ³	0.39	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
156-60-5	trans-1,2-Dichloroethylene	ND		ug/m ³	0.41	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/m ³	0.47	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
79-01-6	Trichloroethylene	ND		ug/m ³	0.14	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
75-69-4	Trichlorofluoromethane (Freon 11)	1.3		ug/m ³	0.58	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
108-05-4	Vinyl acetate	ND		ug/m ³	0.36	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
593-60-2	Vinyl bromide	ND		ug/m ³	0.45	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR
75-01-4	Vinyl Chloride	ND		ug/m ³	0.13	1.033	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/16/2025 08:00	04/16/2025 22:32	YR



Sample Information

Client Sample ID: IA-08

York Sample ID: 25C1573-09

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 9:50 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	* 1,1,1,2-Tetrachloroethane	ND		ug/m ³	0.68	0.992	EPA TO-15 Certifications:	04/17/2025 07:45	04/17/2025 12:25	YR
71-55-6	1,1,1-Trichloroethane	ND		ug/m ³	0.54	0.992	EPA TO-15 Certifications:	04/17/2025 07:45 NELAC-NY12058,NJDEP-NY037	04/17/2025 12:25	YR
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/m ³	0.68	0.992	EPA TO-15 Certifications:	04/17/2025 07:45 NELAC-NY12058,NJDEP-NY037	04/17/2025 12:25	YR
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/m ³	0.76	0.992	EPA TO-15 Certifications:	04/17/2025 07:45 NELAC-NY12058,NJDEP-NY037	04/17/2025 12:25	YR
79-00-5	1,1,2-Trichloroethane	ND		ug/m ³	0.54	0.992	EPA TO-15 Certifications:	04/17/2025 07:45 NELAC-NY12058,NJDEP-NY037	04/17/2025 12:25	YR
75-34-3	1,1-Dichloroethane	ND		ug/m ³	0.40	0.992	EPA TO-15 Certifications:	04/17/2025 07:45 NELAC-NY12058,NJDEP-NY037	04/17/2025 12:25	YR
75-35-4	1,1-Dichloroethylene	ND		ug/m ³	0.098	0.992	EPA TO-15 Certifications:	04/17/2025 07:45 NELAC-NY12058,NJDEP-NY037	04/17/2025 12:25	YR
120-82-1	1,2,4-Trichlorobenzene	1.3		ug/m ³	0.74	0.992	EPA TO-15 Certifications:	04/17/2025 07:45 NELAC-NY12058,NJDEP-NY037	04/17/2025 12:25	YR
95-63-6	1,2,4-Trimethylbenzene	0.73		ug/m ³	0.49	0.992	EPA TO-15 Certifications:	04/17/2025 07:45 NELAC-NY12058,NJDEP-NY037	04/17/2025 12:25	YR
106-93-4	1,2-Dibromoethane	ND		ug/m ³	0.76	0.992	EPA TO-15 Certifications:	04/17/2025 07:45 NELAC-NY12058,NJDEP-NY037	04/17/2025 12:25	YR
95-50-1	1,2-Dichlorobenzene	ND		ug/m ³	0.60	0.992	EPA TO-15 Certifications:	04/17/2025 07:45 NELAC-NY12058,NJDEP-NY037	04/17/2025 12:25	YR
107-06-2	1,2-Dichloroethane	ND		ug/m ³	0.40	0.992	EPA TO-15 Certifications:	04/17/2025 07:45 NELAC-NY12058,NJDEP-NY037	04/17/2025 12:25	YR
78-87-5	1,2-Dichloropropane	ND		ug/m ³	0.46	0.992	EPA TO-15 Certifications:	04/17/2025 07:45 NELAC-NY12058,NJDEP-NY037	04/17/2025 12:25	YR
76-14-2	1,2-Dichlorotetrafluoroethane	ND		ug/m ³	0.69	0.992	EPA TO-15 Certifications:	04/17/2025 07:45 NELAC-NY12058,NJDEP-NY037	04/17/2025 12:25	YR
108-67-8	1,3,5-Trimethylbenzene	ND		ug/m ³	0.49	0.992	EPA TO-15 Certifications:	04/17/2025 07:45 NELAC-NY12058,NJDEP-NY037	04/17/2025 12:25	YR
106-99-0	1,3-Butadiene	ND		ug/m ³	0.66	0.992	EPA TO-15 Certifications:	04/17/2025 07:45 NELAC-NY12058,NJDEP-NY037	04/17/2025 12:25	YR
541-73-1	1,3-Dichlorobenzene	ND		ug/m ³	0.60	0.992	EPA TO-15 Certifications:	04/17/2025 07:45 NELAC-NY12058,NJDEP-NY037	04/17/2025 12:25	YR
142-28-9	* 1,3-Dichloropropane	ND		ug/m ³	0.46	0.992	EPA TO-15 Certifications:	04/17/2025 07:45	04/17/2025 12:25	YR
106-46-7	1,4-Dichlorobenzene	0.72		ug/m ³	0.60	0.992	EPA TO-15 Certifications:	04/17/2025 07:45 NELAC-NY12058,NJDEP-NY037	04/17/2025 12:25	YR
123-91-1	1,4-Dioxane	ND		ug/m ³	0.71	0.992	EPA TO-15 Certifications:	04/17/2025 07:45 NELAC-NY12058,NJDEP-NY037	04/17/2025 12:25	YR
540-84-1	* 2,2,4-Trimethylpentane	1.0		ug/m ³	0.23	0.992	EPA TO-15 Certifications:	04/17/2025 07:45	04/17/2025 12:25	YR
78-93-3	2-Butanone	2.7		ug/m ³	0.29	0.992	EPA TO-15 Certifications:	04/17/2025 07:45 NELAC-NY12058,NJDEP-NY037	04/17/2025 12:25	YR
591-78-6	* 2-Hexanone	ND		ug/m ³	0.81	0.992	EPA TO-15 Certifications:	04/17/2025 07:45	04/17/2025 12:25	YR



Sample Information

Client Sample ID: IA-08

York Sample ID: 25C1573-09

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 9:50 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
107-05-1	3-Chloropropene	ND		ug/m ³	1.6	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
108-10-1	4-Methyl-2-pentanone	ND		ug/m ³	0.41	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
67-64-1	Acetone	96		ug/m ³	1.9	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
107-13-1	Acrylonitrile	ND		ug/m ³	2.8	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
71-43-2	Benzene	1.2		ug/m ³	0.32	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
100-44-7	Benzyl chloride	ND		ug/m ³	0.51	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
75-27-4	Bromodichloromethane	ND		ug/m ³	0.66	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
75-25-2	Bromoform	ND		ug/m ³	1.0	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
74-83-9	Bromomethane	ND		ug/m ³	0.39	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
75-15-0	Carbon disulfide	ND		ug/m ³	0.31	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
56-23-5	Carbon tetrachloride	0.37		ug/m ³	0.16	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
108-90-7	Chlorobenzene	ND		ug/m ³	0.46	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
75-00-3	Chloroethane	ND		ug/m ³	0.26	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
67-66-3	Chloroform	1.7		ug/m ³	0.48	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
74-87-3	Chloromethane	1.4		ug/m ³	0.20	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
156-59-2	cis-1,2-Dichloroethylene	ND		ug/m ³	0.098	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/m ³	0.45	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
110-82-7	Cyclohexane	0.34		ug/m ³	0.34	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
124-48-1	Dibromochloromethane	ND		ug/m ³	0.85	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
75-71-8	Dichlorodifluoromethane	2.6		ug/m ³	0.49	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
141-78-6	* Ethyl acetate	6.8		ug/m ³	0.71	0.992	EPA TO-15 Certifications:	04/17/2025 07:45	04/17/2025 12:25	YR
100-41-4	Ethyl Benzene	0.60		ug/m ³	0.43	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
87-68-3	Hexachlorobutadiene	ND		ug/m ³	1.1	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR



Sample Information

Client Sample ID: IA-08

York Sample ID: 25C1573-09

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Indoor Ambient Air

March 25, 2025 9:50 am

03/25/2025

Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
67-63-0	Isopropanol	37		ug/m ³	1.5	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
80-62-6	Methyl Methacrylate	ND		ug/m ³	0.41	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/m ³	0.36	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
75-09-2	Methylene chloride	ND		ug/m ³	2.1	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
91-20-3	* Naphthalene	1.8		ug/m ³	1.0	0.992	EPA TO-15 Certifications: NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
142-82-5	n-Heptane	0.77		ug/m ³	0.41	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
110-54-3	n-Hexane	1.0		ug/m ³	0.35	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
95-47-6	o-Xylene	0.90		ug/m ³	0.43	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
179601-23-1	p- & m- Xylenes	2.3		ug/m ³	0.86	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
622-96-8	* p-Ethyltoluene	0.54		ug/m ³	0.49	0.992	EPA TO-15 Certifications:	04/17/2025 07:45	04/17/2025 12:25	YR
115-07-1	* Propylene	3.0		ug/m ³	0.17	0.992	EPA TO-15 Certifications:	04/17/2025 07:45	04/17/2025 12:25	YR
100-42-5	Styrene	ND		ug/m ³	0.42	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
127-18-4	Tetrachloroethylene	1.5		ug/m ³	0.67	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
109-99-9	* Tetrahydrofuran	ND		ug/m ³	0.59	0.992	EPA TO-15 Certifications:	04/17/2025 07:45	04/17/2025 12:25	YR
108-88-3	Toluene	3.6		ug/m ³	0.37	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
156-60-5	trans-1,2-Dichloroethylene	ND		ug/m ³	0.39	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/m ³	0.45	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
79-01-6	Trichloroethylene	ND		ug/m ³	0.13	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
75-69-4	Trichlorofluoromethane (Freon 11)	1.4		ug/m ³	0.56	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
108-05-4	Vinyl acetate	ND	TO-CC V, TO-LCS -L	ug/m ³	0.35	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
593-60-2	Vinyl bromide	ND		ug/m ³	0.43	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR
75-01-4	Vinyl Chloride	ND		ug/m ³	0.13	0.992	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 12:25	YR



Sample Information

Client Sample ID: IA-08

York Sample ID: 25C1573-09

<u>York Project (SDG) No.</u> 25C1573	<u>Client Project ID</u> 41.0163281.10 1107 Dekalb Ave	<u>Matrix</u> Indoor Ambient Air	<u>Collection Date/Time</u> March 25, 2025 9:50 am	<u>Date Received</u> 03/25/2025
--	---	-------------------------------------	---	------------------------------------

Sample Information

Client Sample ID: OA-01

York Sample ID: 25C1573-10

<u>York Project (SDG) No.</u> 25C1573	<u>Client Project ID</u> 41.0163281.10 1107 Dekalb Ave	<u>Matrix</u> Outdoor Ambient Air	<u>Collection Date/Time</u> March 25, 2025 10:25 am	<u>Date Received</u> 03/25/2025
--	---	--------------------------------------	--	------------------------------------


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	* 1,1,1,2-Tetrachloroethane	ND		ug/m ³	0.57	0.837	EPA TO-15 Certifications:	04/17/2025 07:45	04/17/2025 13:30	YR
71-55-6	1,1,1-Trichloroethane	ND		ug/m ³	0.46	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/m ³	0.57	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/m ³	0.64	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
79-00-5	1,1,2-Trichloroethane	ND		ug/m ³	0.46	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
75-34-3	1,1-Dichloroethane	ND		ug/m ³	0.34	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
75-35-4	1,1-Dichloroethylene	ND		ug/m ³	0.083	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
120-82-1	1,2,4-Trichlorobenzene	ND		ug/m ³	0.62	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
95-63-6	1,2,4-Trimethylbenzene	0.70		ug/m ³	0.41	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
106-93-4	1,2-Dibromoethane	ND		ug/m ³	0.64	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
95-50-1	1,2-Dichlorobenzene	ND		ug/m ³	0.50	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
107-06-2	1,2-Dichloroethane	ND		ug/m ³	0.34	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
78-87-5	1,2-Dichloropropane	ND		ug/m ³	0.39	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
76-14-2	1,2-Dichlorotetrafluoroethane	ND		ug/m ³	0.59	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
108-67-8	1,3,5-Trimethylbenzene	ND		ug/m ³	0.41	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
106-99-0	1,3-Butadiene	ND		ug/m ³	0.56	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
541-73-1	1,3-Dichlorobenzene	ND		ug/m ³	0.50	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
142-28-9	* 1,3-Dichloropropane	ND		ug/m ³	0.39	0.837	EPA TO-15 Certifications:	04/17/2025 07:45	04/17/2025 13:30	YR
106-46-7	1,4-Dichlorobenzene	ND		ug/m ³	0.50	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR



Sample Information

Client Sample ID: OA-01

York Sample ID: 25C1573-10

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Outdoor Ambient Air

March 25, 2025 10:25 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
123-91-1	1,4-Dioxane	ND		ug/m ³	0.60	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
540-84-1	* 2,2,4-Trimethylpentane	1.7		ug/m ³	0.20	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
78-93-3	2-Butanone	1.7		ug/m ³	0.25	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
591-78-6	* 2-Hexanone	ND		ug/m ³	0.69	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
107-05-1	3-Chloropropene	ND		ug/m ³	1.3	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
108-10-1	4-Methyl-2-pentanone	ND		ug/m ³	0.34	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
67-64-1	Acetone	16		ug/m ³	1.6	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
107-13-1	Acrylonitrile	ND		ug/m ³	2.4	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
71-43-2	Benzene	1.6		ug/m ³	0.27	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
100-44-7	Benzyl chloride	ND		ug/m ³	0.43	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
75-27-4	Bromodichloromethane	ND		ug/m ³	0.56	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
75-25-2	Bromoform	ND		ug/m ³	0.87	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
74-83-9	Bromomethane	ND		ug/m ³	0.33	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
75-15-0	Carbon disulfide	ND		ug/m ³	0.26	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
56-23-5	Carbon tetrachloride	0.37		ug/m ³	0.13	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
108-90-7	Chlorobenzene	ND		ug/m ³	0.39	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
75-00-3	Chloroethane	ND		ug/m ³	0.22	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
67-66-3	Chloroform	0.49		ug/m ³	0.41	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
74-87-3	Chloromethane	1.4		ug/m ³	0.17	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
156-59-2	cis-1,2-Dichloroethylene	ND		ug/m ³	0.083	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/m ³	0.38	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
110-82-7	Cyclohexane	0.58		ug/m ³	0.29	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
124-48-1	Dibromochloromethane	ND		ug/m ³	0.71	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR



Sample Information

Client Sample ID: OA-01

York Sample ID: 25C1573-10

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Outdoor Ambient Air

March 25, 2025 10:25 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
75-71-8	Dichlorodifluoromethane	2.6		ug/m ³	0.41	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
141-78-6	* Ethyl acetate	2.5		ug/m ³	0.60	0.837	EPA TO-15 Certifications:	04/17/2025 07:45	04/17/2025 13:30	YR
100-41-4	Ethyl Benzene	0.73		ug/m ³	0.36	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
87-68-3	Hexachlorobutadiene	ND		ug/m ³	0.89	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
67-63-0	Isopropanol	6.1		ug/m ³	1.2	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
80-62-6	Methyl Methacrylate	ND		ug/m ³	0.34	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/m ³	0.30	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
75-09-2	Methylene chloride	ND		ug/m ³	1.7	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
91-20-3	* Naphthalene	ND		ug/m ³	0.88	0.837	EPA TO-15 Certifications: NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
142-82-5	n-Heptane	0.96		ug/m ³	0.34	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
110-54-3	n-Hexane	1.9		ug/m ³	0.30	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
95-47-6	o-Xylene	0.91		ug/m ³	0.36	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
179601-23-1	p- & m- Xylenes	2.5		ug/m ³	0.73	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
622-96-8	* p-Ethyltoluene	0.62		ug/m ³	0.41	0.837	EPA TO-15 Certifications:	04/17/2025 07:45	04/17/2025 13:30	YR
115-07-1	* Propylene	ND		ug/m ³	0.14	0.837	EPA TO-15 Certifications:	04/17/2025 07:45	04/17/2025 13:30	YR
100-42-5	Styrene	ND		ug/m ³	0.36	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
127-18-4	Tetrachloroethylene	3.1		ug/m ³	0.57	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
109-99-9	* Tetrahydrofuran	ND		ug/m ³	0.49	0.837	EPA TO-15 Certifications:	04/17/2025 07:45	04/17/2025 13:30	YR
108-88-3	Toluene	4.7		ug/m ³	0.32	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
156-60-5	trans-1,2-Dichloroethylene	ND		ug/m ³	0.33	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/m ³	0.38	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
79-01-6	Trichloroethylene	0.58		ug/m ³	0.11	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR



Sample Information

Client Sample ID: OA-01

York Sample ID: 25C1573-10

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

25C1573

41.0163281.10 1107 Dekalb Ave

Outdoor Ambient Air

March 25, 2025 10:25 am

03/25/2025


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
75-69-4	Trichlorofluoromethane (Freon 11)	1.3		ug/m ³	0.47	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
108-05-4	Vinyl acetate	ND	TO-CC V, TO-LCS -L	ug/m ³	0.29	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
593-60-2	Vinyl bromide	ND		ug/m ³	0.37	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR
75-01-4	Vinyl Chloride	ND		ug/m ³	0.11	0.837	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-NY037	04/17/2025 07:45	04/17/2025 13:30	YR



Analytical Batch Summary

Batch ID: BD51207

Preparation Method: EPA TO15 PREP

Prepared By: BMC


YORK Sample ID	Client Sample ID	Preparation Date
25C1573-01	IA-01	04/16/25
25C1573-02	IA-02	04/16/25
25C1573-03	IA-03	04/16/25
25C1573-04	IA-04	04/16/25
25C1573-05	IA-05	04/16/25
25C1573-06	IA-05- Duplicate	04/16/25
25C1573-08	IA-07	04/16/25
BD51207-BLK1	Blank	04/16/25
BD51207-BS1	LCS	04/16/25

Batch ID: BD51311

Preparation Method: EPA TO15 PREP

Prepared By: BMC

YORK Sample ID	Client Sample ID	Preparation Date
25C1573-09	IA-08	04/17/25
25C1573-10	OA-01	04/17/25
BD51311-BLK1	Blank	04/17/25
BD51311-BS1	LCS	04/17/25



Volatile Organic Compounds in Air by GC/MS - Quality Control Data

York Analytical Laboratories, Inc. - Stratford


Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	--------------------	-------	----------------	-------------------	------	----------------	------	-----	--------------	------

Batch BD51207 - EPA TO15 PREP

Blank (BD51207-BLK1)

Prepared & Analyzed: 04/16/2025

1,1,1,2-Tetrachloroethane	ND	0.69	ug/m ³
1,1,1-Trichloroethane	ND	0.55	"
1,1,2,2-Tetrachloroethane	ND	0.69	"
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.77	"
1,1,2-Trichloroethane	ND	0.55	"
1,1-Dichloroethane	ND	0.40	"
1,1-Dichloroethylene	ND	0.099	"
1,2,4-Trichlorobenzene	ND	0.74	"
1,2,4-Trimethylbenzene	ND	0.49	"
1,2-Dibromoethane	ND	0.77	"
1,2-Dichlorobenzene	ND	0.60	"
1,2-Dichloroethane	ND	0.40	"
1,2-Dichloropropane	ND	0.46	"
1,2-Dichlorotetrafluoroethane	ND	0.70	"
1,3,5-Trimethylbenzene	ND	0.49	"
1,3-Butadiene	ND	0.66	"
1,3-Dichlorobenzene	ND	0.60	"
1,3-Dichloropropane	ND	0.46	"
1,4-Dichlorobenzene	ND	0.60	"
1,4-Dioxane	ND	0.72	"
2,2,4-Trimethylpentane	ND	0.23	"
2-Butanone	ND	0.29	"
2-Hexanone	ND	0.82	"
3-Chloropropene	ND	1.6	"
4-Methyl-2-pentanone	ND	0.41	"
Acetone	ND	1.9	"
Acrylonitrile	ND	2.8	"
Benzene	ND	0.32	"
Benzyl chloride	ND	0.52	"
Bromodichloromethane	ND	0.67	"
Bromoform	ND	1.0	"
Bromomethane	ND	0.39	"
Carbon disulfide	ND	0.31	"
Carbon tetrachloride	ND	0.16	"
Chlorobenzene	ND	0.46	"
Chloroethane	ND	0.26	"
Chloroform	ND	0.49	"
Chloromethane	ND	0.21	"
cis-1,2-Dichloroethylene	ND	0.099	"
cis-1,3-Dichloropropylene	ND	0.45	"
Cyclohexane	ND	0.34	"
Dibromochloromethane	ND	0.85	"
Dichlorodifluoromethane	ND	0.49	"
Ethyl acetate	ND	0.72	"
Ethyl Benzene	ND	0.43	"
Hexachlorobutadiene	ND	1.1	"
Isopropanol	ND	1.5	"
Methyl Methacrylate	ND	0.41	"
Methyl tert-butyl ether (MTBE)	ND	0.36	"



Volatile Organic Compounds in Air by GC/MS - Quality Control Data

York Analytical Laboratories, Inc. - Stratford

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	--------------------	-------	----------------	-------------------	------	----------------	------	-----	--------------	------

Batch BD51207 - EPA TO15 PREP

Blank (BD51207-BLK1)


Prepared & Analyzed: 04/16/2025

Methylene chloride	ND	2.1	ug/m ³
Naphthalene	ND	1.0	"
n-Heptane	ND	0.41	"
n-Hexane	ND	0.35	"
o-Xylene	ND	0.43	"
p- & m- Xylenes	ND	0.87	"
p-Ethyltoluene	ND	0.49	"
Propylene	ND	0.17	"
Styrene	ND	0.43	"
Tetrachloroethylene	ND	0.68	"
Tetrahydrofuran	ND	0.59	"
Toluene	ND	0.38	"
trans-1,2-Dichloroethylene	ND	0.40	"
trans-1,3-Dichloropropylene	ND	0.45	"
Trichloroethylene	ND	0.13	"
Trichlorofluoromethane (Freon 11)	ND	0.56	"
Vinyl acetate	ND	0.35	"
Vinyl bromide	ND	0.44	"
Vinyl Chloride	ND	0.13	"

LCS (BD51207-BS1)

Prepared & Analyzed: 04/16/2025

1,1,1,2-Tetrachloroethane	10.0	ppbv	10.0	100	70-130
1,1,1-Trichloroethane	10.3	"	10.0	103	70-130
1,1,2,2-Tetrachloroethane	10.1	"	10.0	101	70-130
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.4	"	10.0	104	70-130
1,1,2-Trichloroethane	10.5	"	10.0	105	70-130
1,1-Dichloroethane	9.97	"	10.0	99.7	70-130
1,1-Dichloroethylene	9.93	"	10.0	99.3	70-130
1,2,4-Trichlorobenzene	9.20	"	10.0	92.0	70-130
1,2,4-Trimethylbenzene	9.96	"	10.0	99.6	70-130
1,2-Dibromoethane	10.4	"	10.0	104	70-130
1,2-Dichlorobenzene	10.4	"	10.0	104	70-130
1,2-Dichloroethane	9.97	"	10.0	99.7	70-130
1,2-Dichloropropane	10.2	"	10.0	102	70-130
1,2-Dichlorotetrafluoroethane	10.5	"	10.0	105	70-130
1,3,5-Trimethylbenzene	10.1	"	10.0	101	70-130
1,3-Butadiene	10.6	"	10.0	106	70-130
1,3-Dichlorobenzene	11.0	"	10.0	110	70-130
1,3-Dichloropropane	9.40	"	10.0	94.0	70-130
1,4-Dichlorobenzene	10.3	"	10.0	103	70-130
1,4-Dioxane	10.2	"	10.0	102	70-130
2,2,4-Trimethylpentane	10.1	"	10.0	101	70-130
2-Butanone	9.76	"	10.0	97.6	70-130
2-Hexanone	10.1	"	10.0	101	70-130
3-Chloropropene	9.16	"	10.0	91.6	70-130
4-Methyl-2-pentanone	10.3	"	10.0	103	70-130
Acetone	9.15	"	10.0	91.5	70-130
Acrylonitrile	9.75	"	10.0	97.5	70-130
Benzene	10.0	"	10.0	100	70-130
Benzyl chloride	10.7	"	10.0	107	70-130
Bromodichloromethane	10.3	"	10.0	103	70-130



Volatile Organic Compounds in Air by GC/MS - Quality Control Data

York Analytical Laboratories, Inc. - Stratford


Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	--------------------	-------	----------------	-------------------	------	----------------	------	-----	--------------	------

Batch BD51207 - EPA TO15 PREP

LCS (BD51207-BS1)

Prepared & Analyzed: 04/16/2025

Bromoform	11.2		ppbv	10.0		112	70-130				
Bromomethane	10.1		"	10.0		101	70-130				
Carbon disulfide	9.75		"	10.0		97.5	70-130				
Carbon tetrachloride	8.95		"	10.0		89.5	70-130				
Chlorobenzene	9.99		"	10.0		99.9	70-130				
Chloroethane	9.72		"	10.0		97.2	70-130				
Chloroform	10.1		"	10.0		101	70-130				
Chloromethane	9.66		"	10.0		96.6	70-130				
cis-1,2-Dichloroethylene	9.24		"	10.0		92.4	70-130				
cis-1,3-Dichloropropylene	10.1		"	10.0		101	70-130				
Cyclohexane	9.78		"	10.0		97.8	70-130				
Dibromochloromethane	9.97		"	10.0		99.7	70-130				
Dichlorodifluoromethane	10.8		"	10.0		108	70-130				
Ethyl acetate	9.12		"	10.0		91.2	70-130				
Ethyl Benzene	10.4		"	10.0		104	70-130				
Hexachlorobutadiene	8.18		"	10.0		81.8	70-130				
Isopropanol	9.04		"	10.0		90.4	70-130				
Methyl Methacrylate	9.78		"	10.0		97.8	70-130				
Methyl tert-butyl ether (MTBE)	9.65		"	10.0		96.5	70-130				
Methylene chloride	10.0		"	10.0		100	70-130				
Naphthalene	8.64		"	10.0		86.4	70-130				
n-Heptane	9.57		"	10.0		95.7	70-130				
n-Hexane	10.1		"	10.0		101	70-130				
o-Xylene	9.86		"	10.0		98.6	70-130				
p- & m- Xylenes	20.0		"	20.0		99.9	70-130				
p-Ethyltoluene	10.7		"	10.0		107	70-130				
Propylene	9.23		"	10.0		92.3	70-130				
Styrene	10.2		"	10.0		102	70-130				
Tetrachloroethylene	9.92		"	10.0		99.2	70-130				
Tetrahydrofuran	9.73		"	10.0		97.3	70-130				
Toluene	9.82		"	10.0		98.2	70-130				
trans-1,2-Dichloroethylene	10.2		"	10.0		102	70-130				
trans-1,3-Dichloropropylene	9.79		"	10.0		97.9	70-130				
Trichloroethylene	9.79		"	10.0		97.9	70-130				
Trichlorofluoromethane (Freon 11)	10.5		"	10.0		105	70-130				
Vinyl acetate	7.63		"	10.0		76.3	70-130				
Vinyl bromide	11.0		"	10.0		110	70-130				
Vinyl Chloride	10.5		"	10.0		105	70-130				



Volatile Organic Compounds in Air by GC/MS - Quality Control Data

York Analytical Laboratories, Inc. - Stratford


Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	--------------------	-------	----------------	-------------------	------	----------------	------	-----	--------------	------

Batch BD51311 - EPA TO15 PREP

Blank (BD51311-BLK1)

Prepared & Analyzed: 04/17/2025

1,1,1,2-Tetrachloroethane	ND	0.69	ug/m ³
1,1,1-Trichloroethane	ND	0.55	"
1,1,2,2-Tetrachloroethane	ND	0.69	"
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.77	"
1,1,2-Trichloroethane	ND	0.55	"
1,1-Dichloroethane	ND	0.40	"
1,1-Dichloroethylene	ND	0.099	"
1,2,4-Trichlorobenzene	ND	0.74	"
1,2,4-Trimethylbenzene	ND	0.49	"
1,2-Dibromoethane	ND	0.77	"
1,2-Dichlorobenzene	ND	0.60	"
1,2-Dichloroethane	ND	0.40	"
1,2-Dichloropropane	ND	0.46	"
1,2-Dichlorotetrafluoroethane	ND	0.70	"
1,3,5-Trimethylbenzene	ND	0.49	"
1,3-Butadiene	ND	0.66	"
1,3-Dichlorobenzene	ND	0.60	"
1,3-Dichloropropane	ND	0.46	"
1,4-Dichlorobenzene	ND	0.60	"
1,4-Dioxane	ND	0.72	"
2,2,4-Trimethylpentane	ND	0.23	"
2-Butanone	ND	0.29	"
2-Hexanone	ND	0.82	"
3-Chloropropene	ND	1.6	"
4-Methyl-2-pentanone	ND	0.41	"
Acetone	ND	1.9	"
Acrylonitrile	ND	2.8	"
Benzene	ND	0.32	"
Benzyl chloride	ND	0.52	"
Bromodichloromethane	ND	0.67	"
Bromoform	ND	1.0	"
Bromomethane	ND	0.39	"
Carbon disulfide	ND	0.31	"
Carbon tetrachloride	ND	0.16	"
Chlorobenzene	ND	0.46	"
Chloroethane	ND	0.26	"
Chloroform	ND	0.49	"
Chloromethane	ND	0.21	"
cis-1,2-Dichloroethylene	ND	0.099	"
cis-1,3-Dichloropropylene	ND	0.45	"
Cyclohexane	ND	0.34	"
Dibromochloromethane	ND	0.85	"
Dichlorodifluoromethane	ND	0.49	"
Ethyl acetate	ND	0.72	"
Ethyl Benzene	ND	0.43	"
Hexachlorobutadiene	ND	1.1	"
Isopropanol	ND	1.5	"
Methyl Methacrylate	ND	0.41	"
Methyl tert-butyl ether (MTBE)	ND	0.36	"
Methylene chloride	ND	2.1	"



Volatile Organic Compounds in Air by GC/MS - Quality Control Data

York Analytical Laboratories, Inc. - Stratford

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	Limit	Flag
---------	--------	--------------------	-------	----------------	-------------------	------	----------------	------	-----	-------	------

Batch BD51311 - EPA TO15 PREP

Blank (BD51311-BLK1)


Prepared & Analyzed: 04/17/2025

Naphthalene	ND	1.0	ug/m ³
n-Heptane	ND	0.41	"
n-Hexane	ND	0.35	"
o-Xylene	ND	0.43	"
p- & m- Xylenes	ND	0.87	"
p-Ethyltoluene	ND	0.49	"
Propylene	ND	0.17	"
Styrene	ND	0.43	"
Tetrachloroethylene	ND	0.68	"
Tetrahydrofuran	ND	0.59	"
Toluene	ND	0.38	"
trans-1,2-Dichloroethylene	ND	0.40	"
trans-1,3-Dichloropropylene	ND	0.45	"
Trichloroethylene	ND	0.13	"
Trichlorofluoromethane (Freon 11)	ND	0.56	"
Vinyl acetate	ND	0.35	"
Vinyl bromide	ND	0.44	"
Vinyl Chloride	ND	0.13	"

LCS (BD51311-BS1)

Prepared & Analyzed: 04/17/2025

1,1,1,2-Tetrachloroethane	9.46	ppbv	10.0	94.6	70-130
1,1,1-Trichloroethane	10.4	"	10.0	104	70-130
1,1,2,2-Tetrachloroethane	9.72	"	10.0	97.2	70-130
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.3	"	10.0	103	70-130
1,1,2-Trichloroethane	10.1	"	10.0	101	70-130
1,1-Dichloroethane	10.0	"	10.0	100	70-130
1,1-Dichloroethylene	10.2	"	10.0	102	70-130
1,2,4-Trichlorobenzene	9.20	"	10.0	92.0	70-130
1,2,4-Trimethylbenzene	9.88	"	10.0	98.8	70-130
1,2-Dibromoethane	10.1	"	10.0	101	70-130
1,2-Dichlorobenzene	9.54	"	10.0	95.4	70-130
1,2-Dichloroethane	10.2	"	10.0	102	70-130
1,2-Dichloropropane	9.61	"	10.0	96.1	70-130
1,2-Dichlorotetrafluoroethane	10.8	"	10.0	108	70-130
1,3,5-Trimethylbenzene	10.1	"	10.0	101	70-130
1,3-Butadiene	10.4	"	10.0	104	70-130
1,3-Dichlorobenzene	10.2	"	10.0	102	70-130
1,3-Dichloropropane	9.54	"	10.0	95.4	70-130
1,4-Dichlorobenzene	10.5	"	10.0	105	70-130
1,4-Dioxane	10.0	"	10.0	100	70-130
2,2,4-Trimethylpentane	10.1	"	10.0	101	70-130
2-Butanone	9.31	"	10.0	93.1	70-130
2-Hexanone	9.73	"	10.0	97.3	70-130
3-Chloropropene	8.62	"	10.0	86.2	70-130
4-Methyl-2-pentanone	9.43	"	10.0	94.3	70-130
Acetone	8.85	"	10.0	88.5	70-130
Acrylonitrile	9.50	"	10.0	95.0	70-130
Benzene	10.0	"	10.0	100	70-130
Benzyl chloride	10.8	"	10.0	108	70-130
Bromodichloromethane	9.70	"	10.0	97.0	70-130
Bromoform	10.6	"	10.0	106	70-130



Volatile Organic Compounds in Air by GC/MS - Quality Control Data

York Analytical Laboratories, Inc. - Stratford


Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	--------------------	-------	----------------	-------------------	------	----------------	------	-----	--------------	------


Batch BD51311 - EPA TO15 PREP

LCS (BD51311-BS1)

Prepared & Analyzed: 04/17/2025

Bromomethane	10.0		ppbv	10.0		100	70-130				
Carbon disulfide	9.57		"	10.0		95.7	70-130				
Carbon tetrachloride	8.29		"	10.0		82.9	70-130				
Chlorobenzene	9.99		"	10.0		99.9	70-130				
Chloroethane	9.71		"	10.0		97.1	70-130				
Chloroform	10.1		"	10.0		101	70-130				
Chloromethane	9.90		"	10.0		99.0	70-130				
cis-1,2-Dichloroethylene	9.62		"	10.0		96.2	70-130				
cis-1,3-Dichloropropylene	9.19		"	10.0		91.9	70-130				
Cyclohexane	9.58		"	10.0		95.8	70-130				
Dibromochloromethane	9.81		"	10.0		98.1	70-130				
Dichlorodifluoromethane	10.7		"	10.0		107	70-130				
Ethyl acetate	9.46		"	10.0		94.6	70-130				
Ethyl Benzene	9.68		"	10.0		96.8	70-130				
Hexachlorobutadiene	8.01		"	10.0		80.1	70-130				
Isopropanol	8.97		"	10.0		89.7	70-130				
Methyl Methacrylate	9.35		"	10.0		93.5	70-130				
Methyl tert-butyl ether (MTBE)	10.0		"	10.0		100	70-130				
Methylene chloride	10.2		"	10.0		102	70-130				
Naphthalene	8.54		"	10.0		85.4	70-130				
n-Heptane	9.63		"	10.0		96.3	70-130				
n-Hexane	9.66		"	10.0		96.6	70-130				
o-Xylene	9.72		"	10.0		97.2	70-130				
p- & m- Xylenes	20.2		"	20.0		101	70-130				
p-Ethyltoluene	10.3		"	10.0		103	70-130				
Propylene	9.63		"	10.0		96.3	70-130				
Styrene	9.82		"	10.0		98.2	70-130				
Tetrachloroethylene	9.74		"	10.0		97.4	70-130				
Tetrahydrofuran	9.81		"	10.0		98.1	70-130				
Toluene	9.10		"	10.0		91.0	70-130				
trans-1,2-Dichloroethylene	10.3		"	10.0		103	70-130				
trans-1,3-Dichloropropylene	9.49		"	10.0		94.9	70-130				
Trichloroethylene	9.38		"	10.0		93.8	70-130				
Trichlorofluoromethane (Freon 11)	10.3		"	10.0		103	70-130				
Vinyl acetate	6.90		"	10.0		69.0	70-130	Low Bias			
Vinyl bromide	10.7		"	10.0		107	70-130				
Vinyl Chloride	10.7		"	10.0		107	70-130				





Sample and Data Qualifiers Relating to This Work Order

TO-LCS-L The result reported for this compound may be biased low due to its behavior in the analysis batch LCS where it recovered less 70% of the expected value.

TO-CCV The value reported is ESTIMATED for this compound due to its behavior during continuing calibration verification (>30% Difference from initial calibration).

Definitions and Other Explanations

*	Analyte is not certified or the state of the samples origination does not offer certification for the Analyte.
ND	NOT DETECTED - the analyte is not detected at the Reported to level (LOQ/RL or LOD/MDL)
RL	REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.
LOQ	LIMIT OF QUANTITATION - the minimum concentration of a target analyte that can be reported within a specified degree of confidence. This is the lowest point in an analyte calibration curve that has been subjected to all steps of the processing/analysis and verified to meet defined criteria. This is based upon NELAC 2009 Standards and applies to all analyses.
LOD	LIMIT OF DETECTION - a verified estimate of the minimum concentration of a substance in a given matrix that an analytical process can reliably detect. This is based upon NELAC 2009 Standards and applies to all analyses conducted under the auspices of EPA SW-846.
MDL	METHOD DETECTION LIMIT - a statistically derived estimate of the minimum amount of a substance an analytical system can reliably detect with a 99% confidence that the concentration of the substance is greater than zero. This is based upon 40 CFR Part 136 Appendix B and applies only to EPA 600 and 200 series methods.
Reported to	This indicates that the data for a particular analysis is reported to either the LOD/MDL, or the LOQ/RL. In cases where the "Reported to" is located above the LOD/MDL, any value between this and the LOQ represents an estimated value which is "J" flagged accordingly. This applies to volatile and semi-volatile target compounds only.
NR	Not reported
RPD	Relative Percent Difference
Wet	The data has been reported on an as-received (wet weight) basis
Low Bias	Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
High Bias	High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
Non-Dir.	Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.


If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two. For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the LOD/MDL, with values between the LOD/MDL and the LOQ being "J" flagged as estimated results.



For analyses by EPA SW-846-8270D, the Limit of Quantitation (LOQ) reported for benzidine is based upon the lowest standard used for calibration and is not a verified LOQ due to this compound's propensity for oxidative losses during extraction/concentration procedures and non-reproducible chromatographic performance.



York Analytical Laboratories, Inc.
120 Research Drive 132-02 89th Ave Queens,
Stratford, CT 06615 NY 11418

YORK
ANALYTICAL LABORATORIES INC.

clientservices@yorklab.com
www.yorklab.com

Field Chain-of-Custody Record - AIR

NOTE: YORK's Standard Terms & Conditions are listed on the back side of this document.
This document serves as your written authorization for YORK to proceed with the analyses requested below.
signature binds you to YORK's Standard Terms & Conditions.

YORK Project No.

25C1573

Your

Page 1 of 1

YOUR Information		Report To:		Invoice To:		YOUR Project Number		Turn-Around Time			
Company: GZA Greenmountain of NY	Company: GZA Greenmountain of NY	Company: GZA Greenmountain of NY	41.0163281.10		RUSH - Next Day						
Address: 104 W 29th St Fl 10, NY 10001	Address: 104 W 29th St Fl 10, NY 10001	Address: 104 W 29th St, Fl 10, NY 10001	YOUR Project Name		RUSH - Two Day						
Phone: 212-594-8140	Phone: 212-594-8140	Phone: 212-594-8140	1107 Dekalb Ave		RUSH - Three Day						
Contact: Mark Hutson	Contact: Mark Hutson	Contact: Mark Hutson	YOUR PO#: 41.0163281.10		RUSH - Four Day						
E-mail: Mark.Hutson@gza.com	E-mail: Mark.Hutson@gza.com	E-mail: Mark.Hutson@gza.com			Standard (5-7 Day)		✓				
Please print clearly and legibly. All information must be complete. Samples will not be logged in and the turn-around-time clock will not begin until any questions by YORK are resolved.			Air Matrix Codes		Samples From		Report / EDD Type (circle selections)		YORK Reg. Comp.		
			AI - Indoor Ambient Air	New York	✓	Summary Report	CT RCP	Standard Excel EDD	Compared to the following Regulation(s): (please fill in) EPA TO-15 DOH Low Limit		
			AO - Outdoor Amb. Air	New Jersey		QA Report	CT RCP DQA/DUE	EQUIS (Standard)			
			AE - Vapor Extraction Well/ Process Gas/Effluent	Connecticut		NY ASP A Package	NJDEP Reduced Deliv.	NYSDEC EQUIS			
AS - Soil Vapor/Sub-Slab	Pennsylvania		NY ASP B Package	NJDKQP	NJDEP SRP HazSite						
Other:											
Samples Collected by: (print your name above and sign below) Yunmee Han			Please enter the following REQUIRED Field Data				Reporting Units: ug/m ³ ✓ ppbv ___ ppmv ___				
Certified Canisters: Batch ___ Individual ___											
Sample Identification	Date/Time Sampled	Air Matrix	Canister Vacuum Before Sampling (in Hg)	Canister Vacuum After Sampling (in Hg)	Canister ID	Flow Cont. ID	Analysis Requested				
1A-01	3/25/25 1005	AI	-30	-9	16156	21610	To-15				
1A-02	3/25/25 1010	AI	-30	-8	24116	20949					
1A-03	3/25/25 1020	AI	-29	-9	32012	20454					
1A-04	3/25/25 0953	AI	-30	-7	28304	20924					
1A-05	3/25/25 0955	AI	-30	0	50241	20929					
1A-05-Duplicate	3/25/25 1015	AI	-30	0	51434	20929					
1A-06	3/25/25 1015	AI	-29	-8	17347	21046					
1A-07	3/25/25 1009	AI	-30	-8	49149	20945					
1A-08	3/25/25 0950	AI	-27	-6	24113	20923					
OA-01	3/25/25 1025	AD	-28	-2	10727	20432					
Comments: DOH Low Limit					Detection Limits Required			Sampling Media			
					≤ 1 ug/m ³ ___ NYSDC V1 Limits ___ Routine Survey ___ Other ___			6 Liter Canister ✓ Tedlar Bag			
Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time	Samples Relinquished by / Company	Date/Time						
Yunmee Han / GZA	3/25/25 1555	A. Husain	3/25/25 15:52	A. Husain	3/25/25 1740						
Samples Received by / Company	Date/Time	Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time						
Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time	Samples Received in LAB by	Date/Time						
				Witi	3/25/25 1740						