MATRIX
ENVIRONMENTAL TECHNOLOGIES INC.
Remediation, Water Treatment and Environmental Engineering
716.662.0745 | www.matrixbiotech.com

July 15, 2026

Mr. Bradley Demo
New York State Department of Environmental Conservation
Division of Environmental Remediation, Region 9
700 Delaware Avenue
Buffalo, New York 14209

Re: 2nd Quarter 2026 Remediation System Status Report
MOD-PAC CORP.
1801 Elmwood Avenue
Buffalo, New York 14207
NYSDEC BCP Site #C915314
METI Project #15-017

Mr. Demo:

Enclosed please find the 2nd Quarter 2026 Remediation System Status Report for the above referenced site. This report includes an analysis of system operational data collected from April 1 through July 1, 2026.

The sub-slab depressurization (SSD) systems were 100% operational in Area A, Area B, and Area C during the 2nd quarter of 2026. Incorrect valve settings for EW-4A and EW-6A were observed in April and adjusted to their preferred settings. It is suspected that insufficient vacuum influence noted during the March 2026 quarterly site check was due to the incorrect valve settings discovered during the annual inspection. The blower filter in Area B was cleaned and the blower gauge was recalibrated in April. The SSD systems will continue to operate in the onsite building to reduce VOC concentrations in indoor air.

The next quarterly system status report will be provided in October 2026. Should you have any questions or require any additional information, please contact METI at 716-662-0745.

Sincerely,
Matrix Environmental Technologies Inc.

Mary M. Szustak
Project Manager

Christine M. Curtis, P.E.
Senior Engineer

Enclosure

REMEDIATION SYSTEM STATUS REPORT
April 1, 2026 – July 1, 2026

MOD-PAC CORP.
1801 Elmwood Avenue
Buffalo, New York 14207
NYSDEC BCP Site #C915314

REMEDIATION INFORMATION:

Sub-Slab Depressurization (SSD) Systems:

AREA A:

System Activation Date:	September 2019
Extraction Points:	EW-1A, EW-2A, EW-3A, EW-4A, EW-5A, EW-6A, EW-7A, EW-8A, EW-9A, EW-10A
Equipment:	GAST R6P355A 6hp blower
Method of Air Treatment:	Vapor-phase granular activated carbon (GAC)

AREA B:

System Activation Date:	September 2019
Extraction Points:	EW-1B, EW-2B, EW-3B, EW-4B, EW-5B, EW-6B, EW-7B, EW-8B
Equipment:	GAST R6P355A 6HP blower
Method of Air Treatment:	None

AREA C:

System Activation Date:	October 2019
Extraction Points:	EW-1C, EW-2C, EW-3C
Equipment	GAST R4P115 1.5HP blower (EW-1C and EW-2C) RadonAway HS5000 (EW-3)
Method of Air Treatment:	None

MONITORING REQUIREMENTS

In accordance with the Site Management Plan (SMP)[1] for NYSDEC Site #C915314, SSD system checks are completed on a monthly basis. Monthly system checks include operational status checks of blowers and fans; visual inspection of each system for the identification and repair of any leaks; and the collection of pre- and post-carbon photoionization detector (PID) readings in Area A, blower effluent PID readings in Area B, and blower and fan effluent PID readings in Area C.

On a quarterly basis in March, June, September, and December, system checks also include the documentation of manifold settings and vacuum pressure at each extraction well (EW) and documentation of vacuum at each vapor monitoring point (VMP). Pre- and post-carbon air samples are collected from the Area A system to evaluate the effectiveness of the vapor phase carbon treatment. Samples are submitted for laboratory analysis of volatile organic compounds (VOCs) via Environmental Protection Agency (EPA) Method TO-15. Non-routine maintenance, including carbon changeouts, is completed as necessary based on the analytical data.

For any VMP that fails to achieve the minimum vacuum of at least 0.002 inches water column (WC) during quarterly inspections, vacuum data is collected on a monthly basis until the required influence is achieved in the affected VMP(s).

The locations of the SSD systems are shown on **Figure 1**.

SITE ACTIVITIES COMPLETED DURING PERIOD

4/21/26 Annual system inspection. The systems were operational. Recorded system data. The system effluent PID reading was 0 ppm in Area A, Area B, and Area C. The required vacuum influence was achieved in all vapor monitoring points except VMP-8AR and VMP-1B. Incorrect valve settings for EW-4A and EW-6A were observed and adjusted to their preferred settings. It is suspected that insufficient vacuum influence noted during the March 2026 quarterly site check was due to the incorrect valve settings discovered during the annual inspection. The blower filter in Area B was cleaned, and the blower gauge was recalibrated.

5/12/26 Monthly system inspection. The systems were operational. Recorded system data. The system effluent PID reading was 0 ppm in Area A and Area C, and was 0.2 ppm in Area B. The required vacuum influence was not achieved in VMP-8AR and VMP-1B.

6/25/26 Quarterly system inspection. The systems were operational. Recorded system data. The system effluent PID reading was 0 ppm in Area A, Area B, and Area C. The required vacuum influence was not achieved at several vapor monitoring points, including many that had consistently demonstrated adequate vacuum influence since system startup. It was suspected that the manometer required recalibration.

[1] "Site Management Plan for MOD-PAC Site, 1801 Elmwood Avenue, City of Buffalo, Erie County, New York, Site No. C915314" prepared by C&S Engineers, Inc., December 2019, revised March 2022 by Environmental Advantage, Inc.

7/1/26 Quarterly system inspection repeated due to inconsistent vacuum readings the week prior. The systems were operational. Recorded system data. The system effluent PID reading was 0 ppm in Area A, Area B, and Area C. The required vacuum influence was achieved in all accessible vapor monitoring points. VMP-5A, VMP-1B, and VMP-6B were inaccessible.

Area-specific findings during the 2nd quarter of 2026 monitoring event are summarized in **Table 1** with historical data presented in **Table 2A** for Area A, **Table 2B** for Area B, and **Table 2C** for Area C. Data collected on July 1, 2026 is presented for the quarterly inspection as the previous data collected on June 25, 2026 is assumed to be inaccurate. SSD System layout for each area is shown on **Figure 2A** for Area A, **Figure 2B** for Area B, and **Figure 2C** for Area C.

SYSTEM PERFORMANCE ASSESSMENT

SSD AREA A – FINISHED PRODUCT STORAGE AREA

During the 2nd quarter of 2026, the target vacuum of at least 0.002 inches WC was achieved at all active VMPs in Area A with the exception of VMP-8AR in April and May, and VMP-5A was inaccessible during the quarterly inspection. In the past, vacuum below target levels have occasionally been observed in VMP-8AR, particularly during monitoring events completed during the first and second quarter. Incorrect valve settings for EW-4A and EW-6A were observed in April and the valves were adjusted to their preferred settings.

A comparison of pre- and post-carbon analytical data shows an average overall target chlorinated VOC (cVOC)[2] reduction of 84%. Concentrations of non-chlorinated compounds Ethly Alcohol, Ethyl Acetate, iso-Propyl Alcohol, Naphthalene, and chlorinated compound Trichlorofluoromethane were higher in the post-carbon sample compared to pre-carbon; the removal efficiency of carbon is reduced at lower influent concentrations, which is likely playing a role in many of the low-level post-carbon increases occasionally observed at this Site. Pre- and post-carbon air sample results for the 2nd quarter of 2026 are summarized in **Table 3** and historical air sample results are summarized in **Table 4**. The complete analytical laboratory report is provided in **Appendix A**.

SSD AREA B - ROLL STORAGE AREA

During the 2nd quarter of 2026, the target vacuum of at least 0.002 inches WC was achieved at all active VMPs in Area B with the exception of VMP-1B in April and May. VMP-1B and VMP-6B were inaccessible during the quarterly inspection. The blower filter in Area B was cleaned in April, and the blower gauge was recalibrated.

SSD AREA C – MAINTENANCE AREA

[2] NYSDOH Target cVOCs are included in this calculation, specifically those listed in the NYSDOH "Final Guidance for Evaluating Soil Vapor Intrusion in the State of New York," May 2017 Update:1,1,1-Trichloroethane, 1,1-Dichloroethene, Carbon tetrachloride, cis-1,2-Dichloroethene, Methylene chloride, Tetrachloroethene, Trichloroethene, and Vinyl chloride

During the 2nd quarter of 2026, the target vacuum of at least 0.002 inches WC was achieved at all active VMPs in Area C.

GROUNDWATER MONITORING

With NYSDEC approval, the groundwater monitoring frequency has been reduced to annually for MW-11 through MW-13 and semi-annually for MW-3 as detailed in the SMP. Groundwater monitoring is no longer addressed in quarterly reports.

CORRECTIVE MEASURES

Incorrect valve settings for EW-4A and EW-6A were observed in April and the valves were adjusted to their preferred settings. It is suspected that insufficient vacuum influence noted during the March 2026 quarterly site check was due to the incorrect valve settings discovered during the annual inspection. The blower filter in Area B was cleaned and the blower gauge was recalibrated in April.

CONCLUSIONS

During the 2nd quarter of 2026, the target vacuum of at least 0.002 inches WC was achieved at all active VMPs with the exception of VMP-8AR and VMP-1B in April and May. VMP-5A, VMP-1B, and VMP-6B were inaccessible during the quarterly site inspection completed on July 1, 2026. The target vacuum in VMP-2A and VMP-7A was achieved in April following a zero vacuum influence reading the previous month.

Overall target chlorinated VOC (cVOC) reduction in Area A was 84% and concentrations of VOCs in the Area A system effluent are well below applicable emissions limits. The most recent carbon changeout was completed in December 2025.

The SSD systems in Area A, Area B, and Area C appear to be functioning as designed. System inspections, monitoring, and sampling will continue according to the frequencies detailed in the SMP.

LIST OF ATTACHMENTS


- Table 1: Q2 2026 Summary
- Table 2A: SSD System Post Installation Monitoring Results Area A
- Table 2B: SSD System Post Installation Monitoring Results Area B
- Table 2C: SSD System Post Installation Monitoring Results Area C
- Table 3: Summary of Air Analytical Testing Results - June 2026
- Table 4: Summary of Area A Pre/Post Carbon and Area B Effluent Air Analytical Testing Results

- Figure 1: BCP Site Plan

- Figure 2A: Area A SSD System Layout and Piping Diagram
- Figure 2B: Area B SSD System Layout and Piping Diagram
- Figure 2C: Area C SSD System Layout and Piping Diagram

- Appendix A: Laboratory Analytical Report Pre and Post Carbon

FIGURES

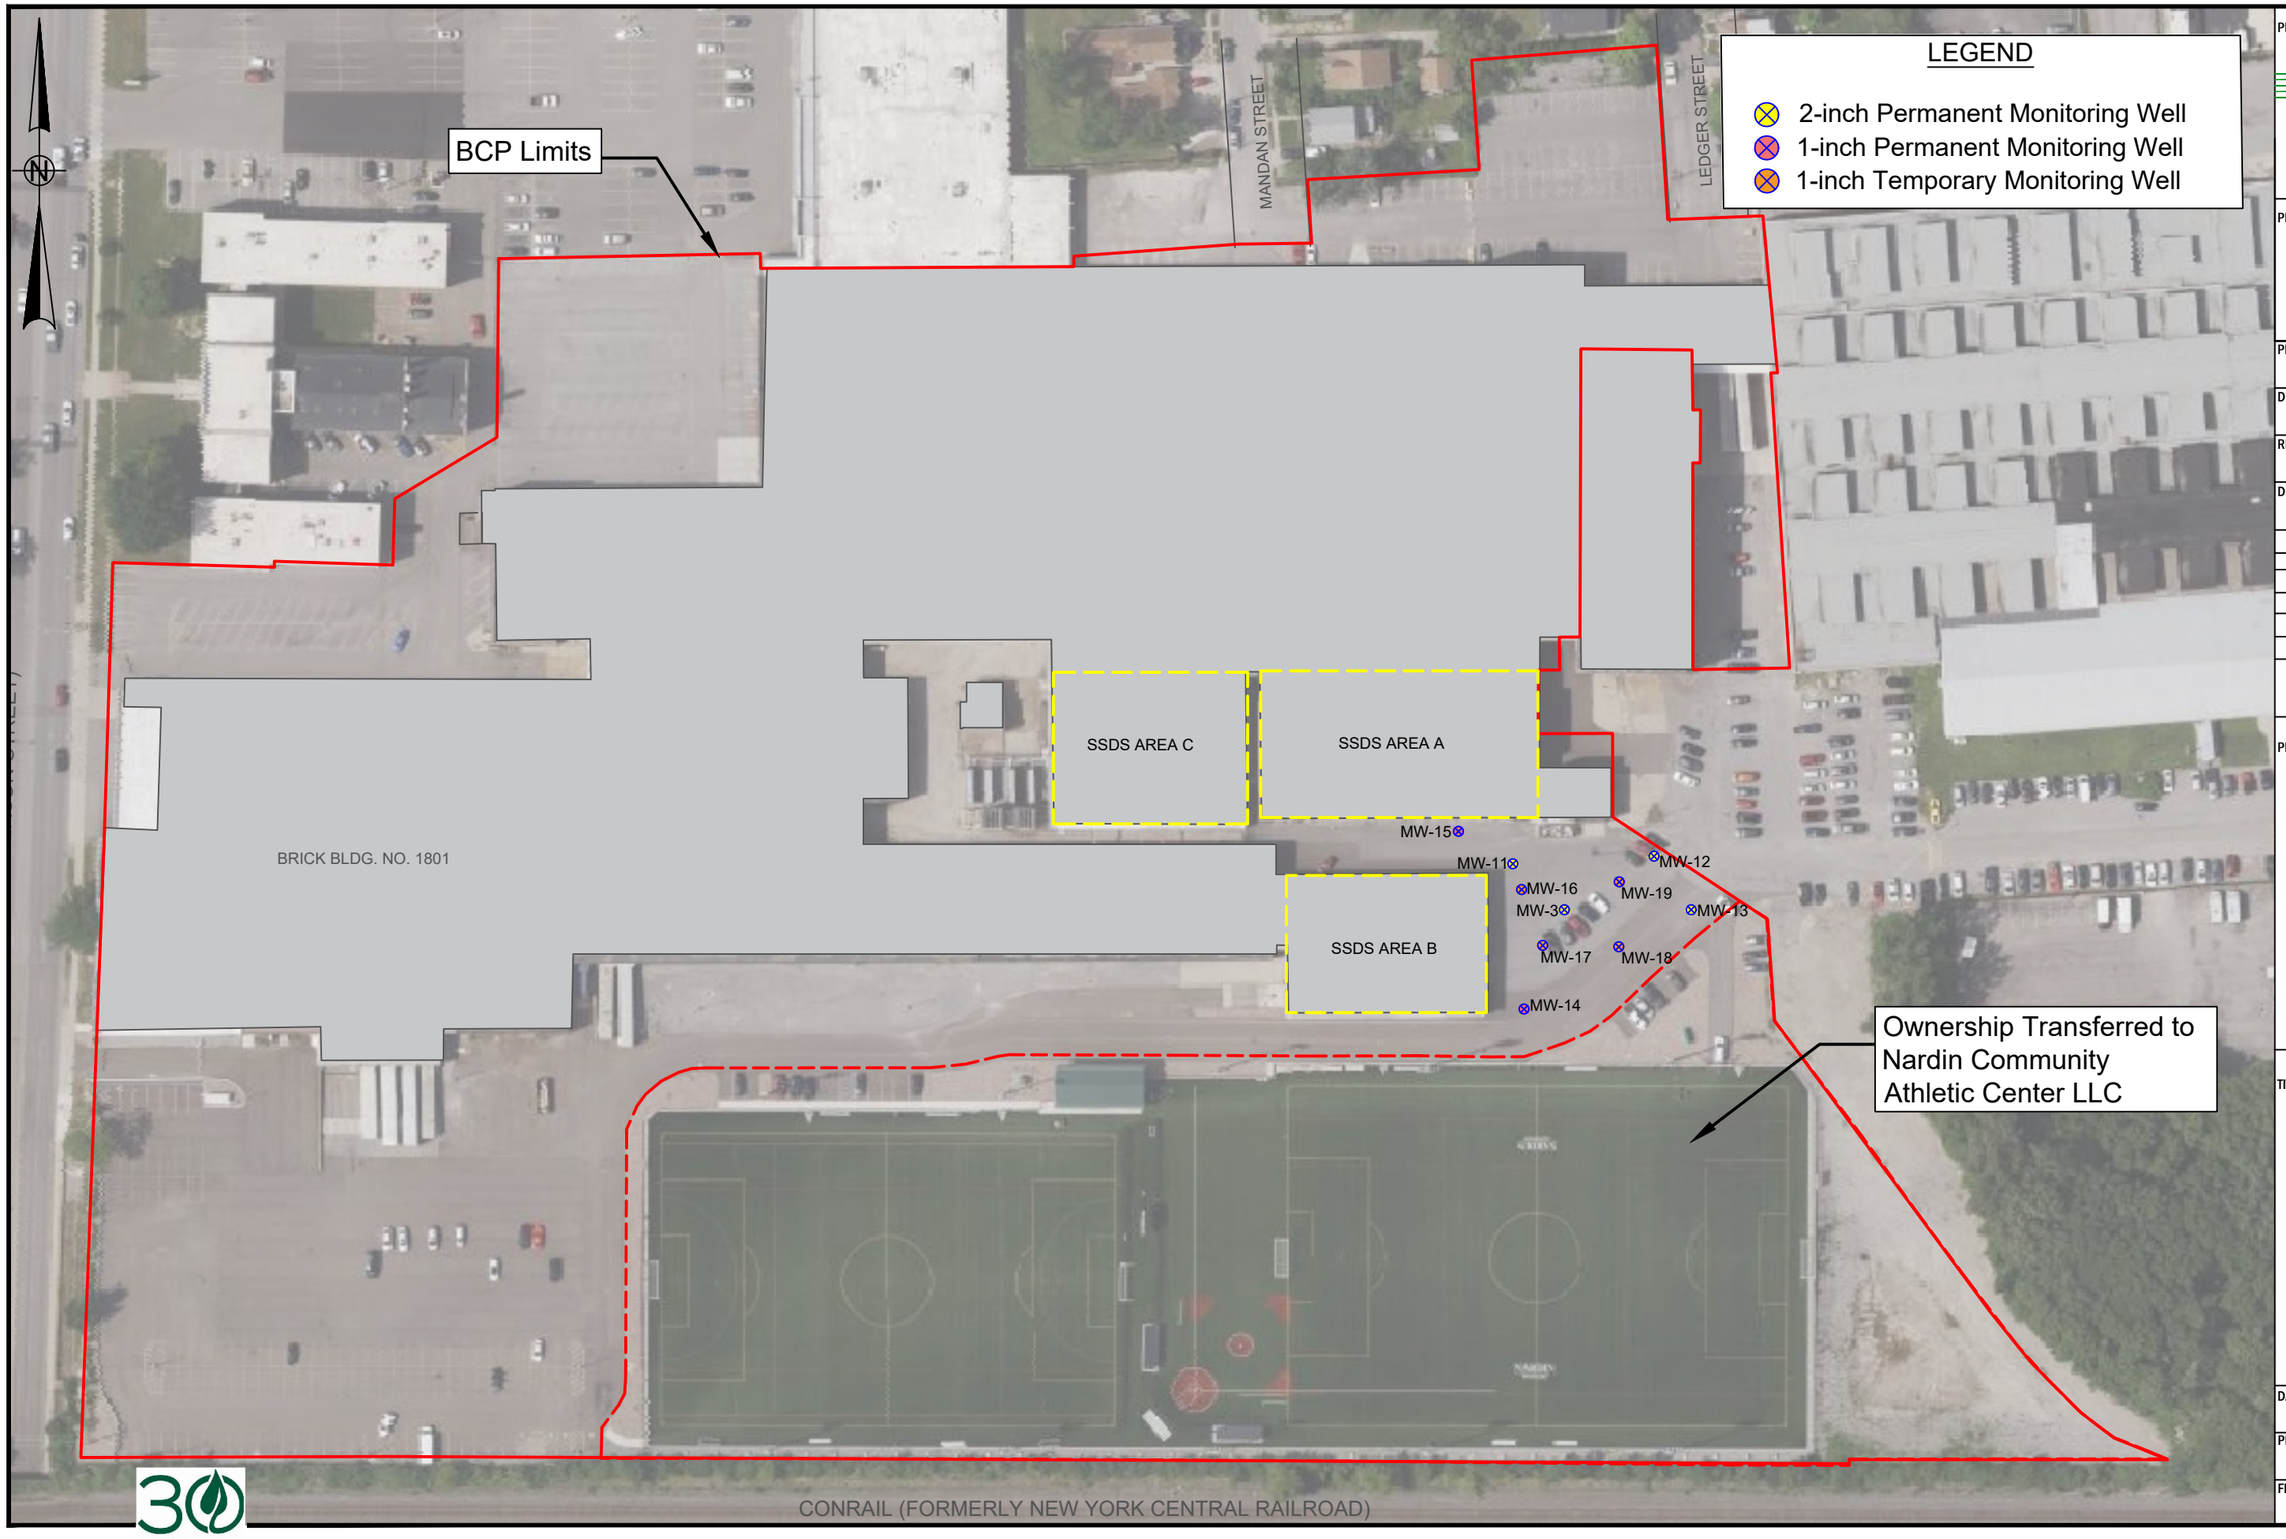

PREPARED BY:

MATRIX
ENVIRONMENTAL TECHNOLOGIES INC.
3730 California Road
P.O. Box 427
Orchard Park, NY 14127
p:716.662.0745
www.matrixbiotech.com

PREPARED FOR:

MOD-PAC CORP.

PROJECT MGR: MMS

DESIGNED BY: CMC

REVIEWED BY: SRC

DRAWN BY: MMS

REVISION	
BY	DATE
MMS	5/1/26

SCALE IN FEET: 1"=100'

0 100

PROJECT NAME / LOCATION:

MOD-PAC CORP.
1801 Elmwood Avenue
Buffalo, New York

BCP #C915314

TITLE:

BCP Site Plan

DATE: April 2026

PROJECT NO.: 15-017

FIGURE: 1

30 years dedicated to a CLEANER ENVIRONMENT 1991-2021

FIGURE 2A.
Area A SSD System Layout and Piping Diagram

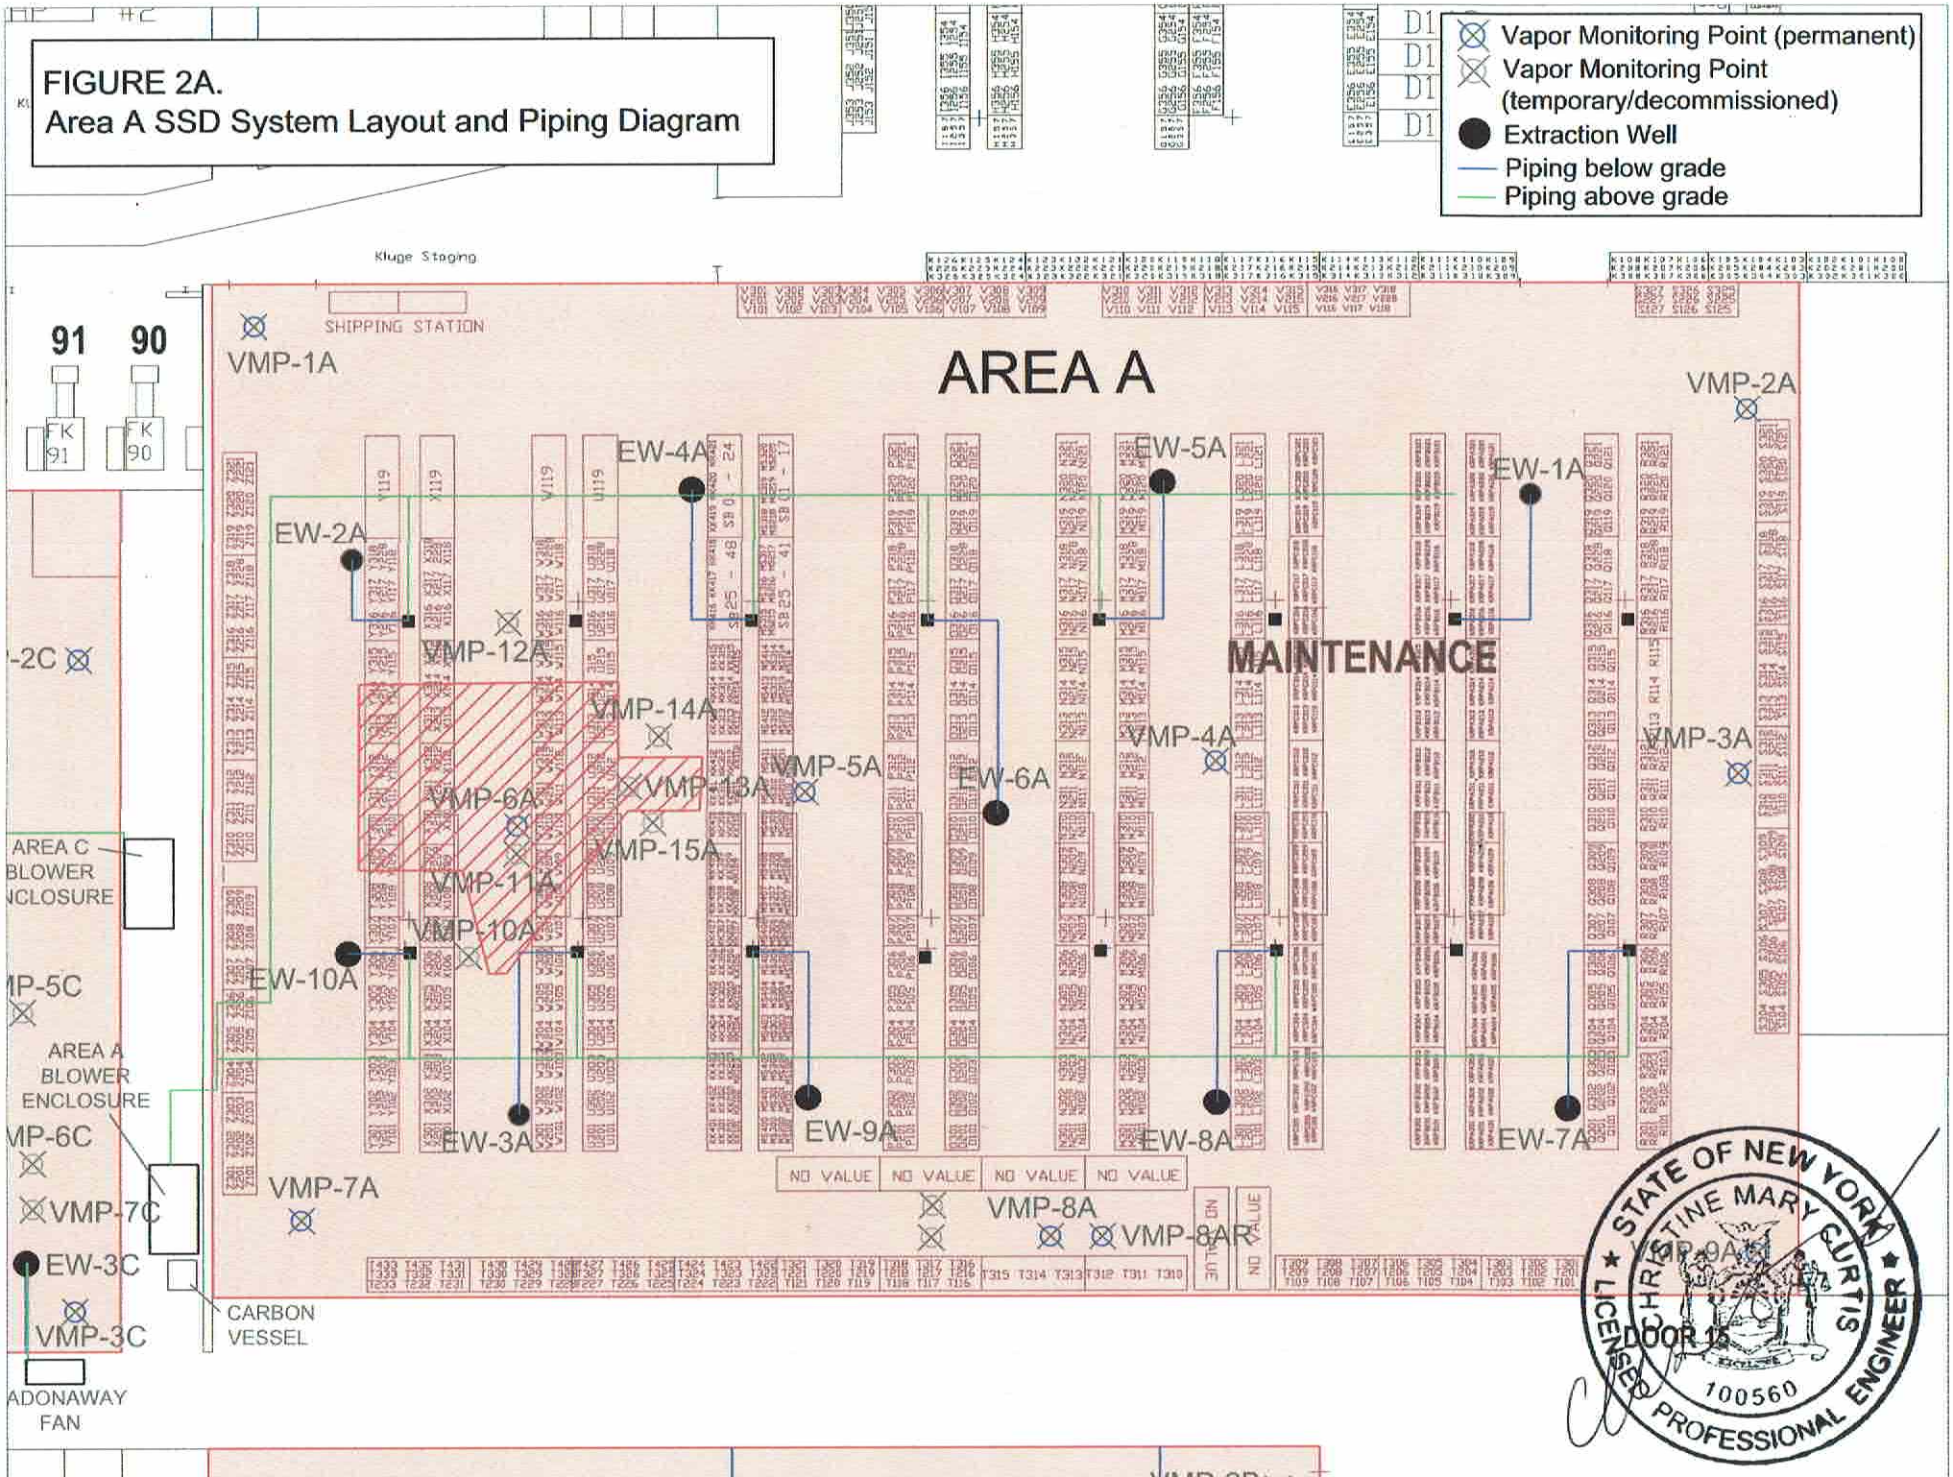


FIGURE 2B.
Area B SSD System Layout and Piping Diagram


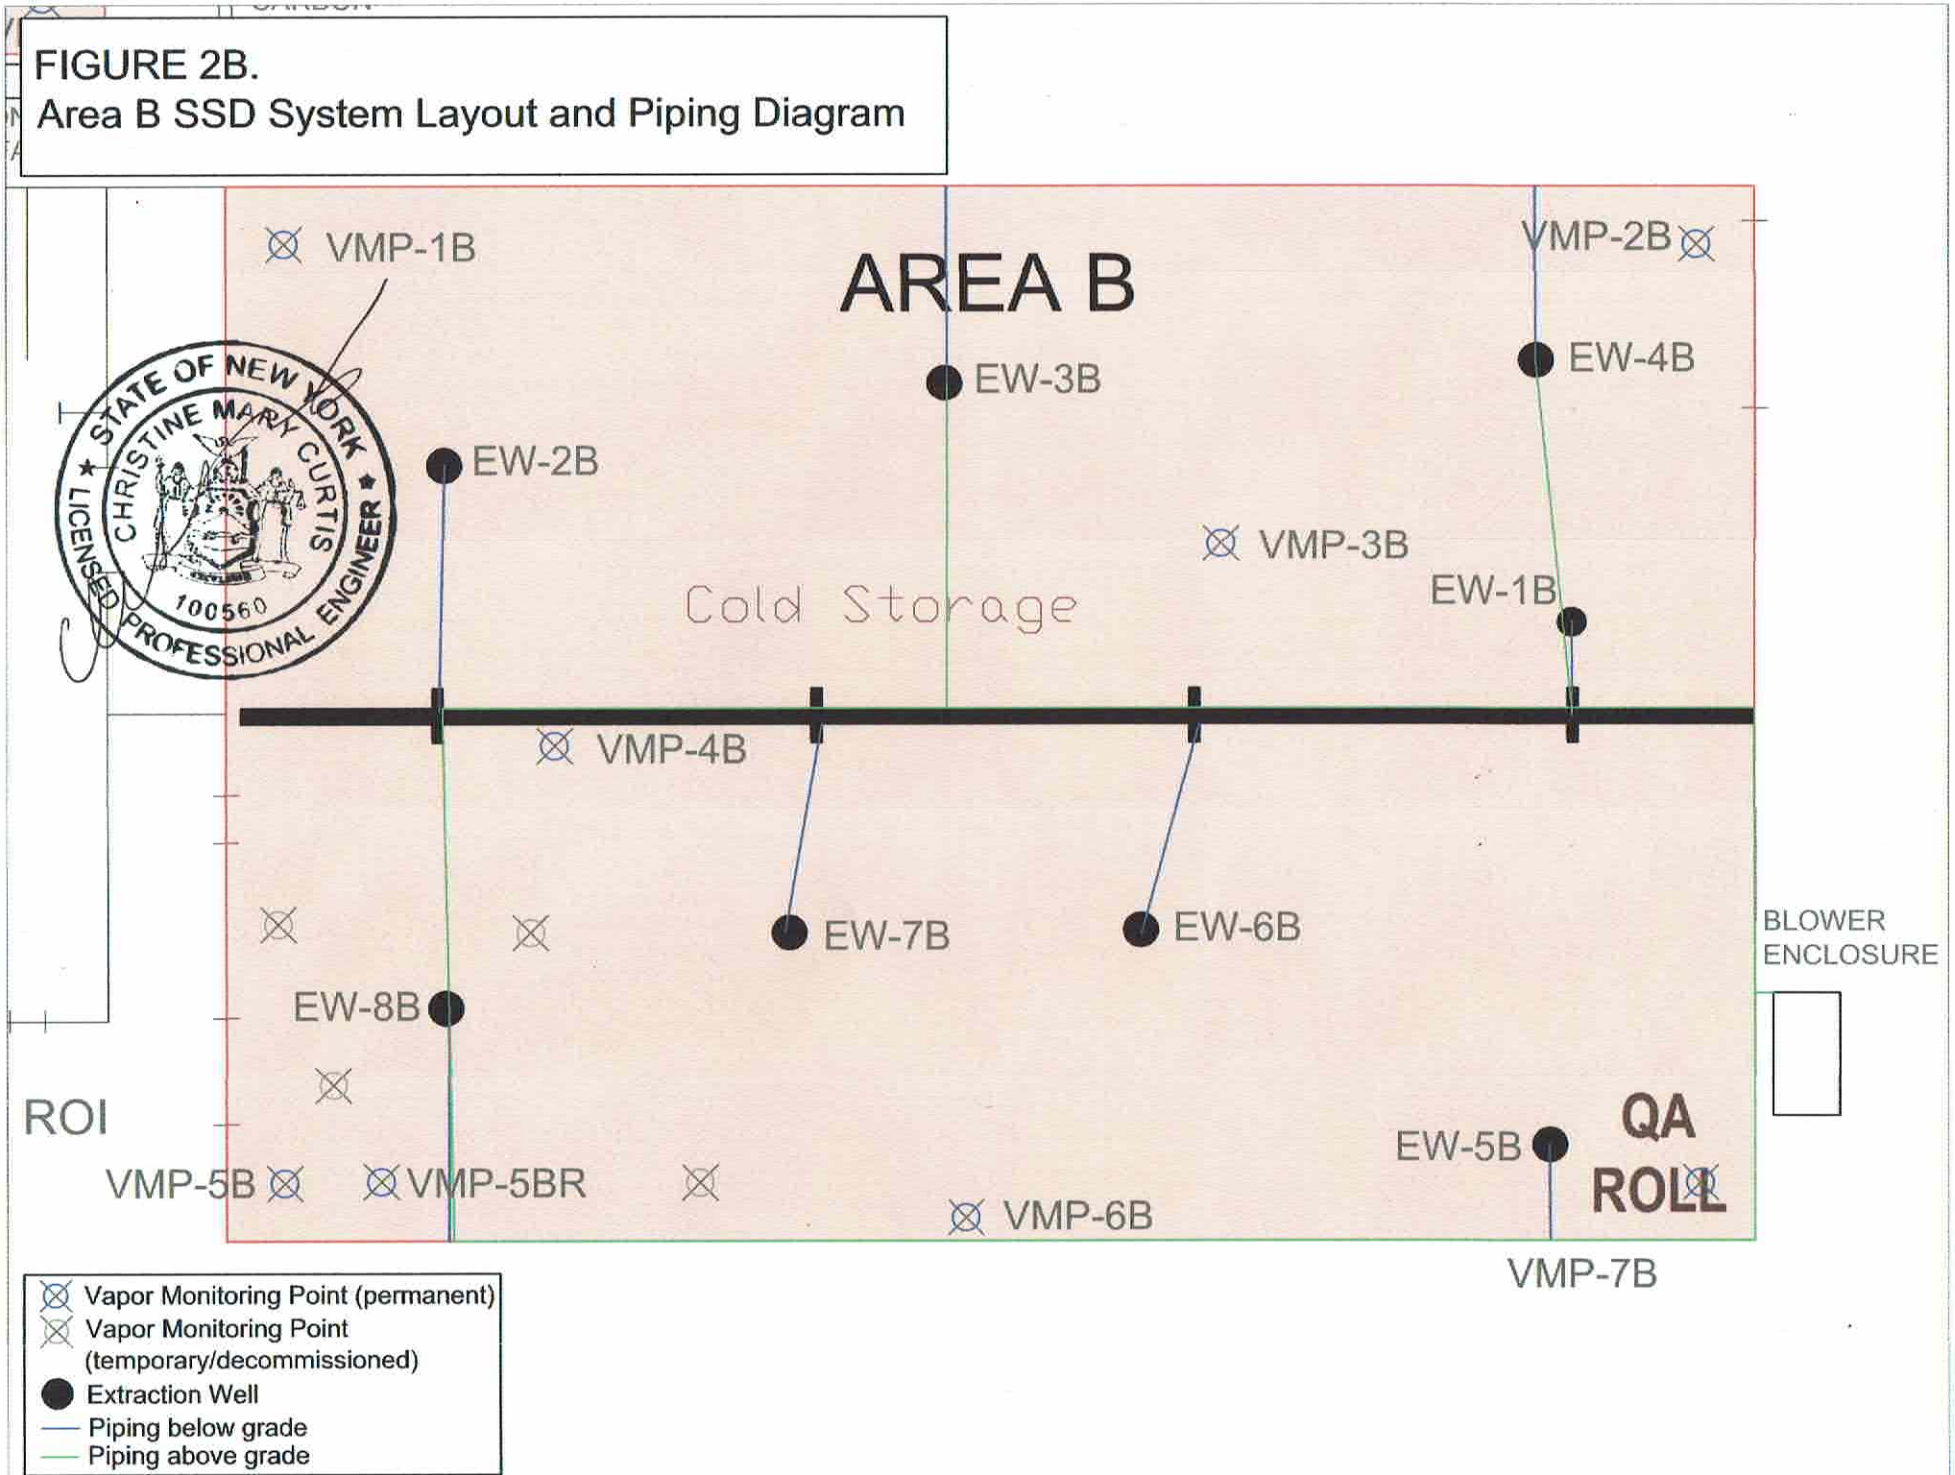


FIGURE 2C.
Area C SSD System Layout and Piping Diagram

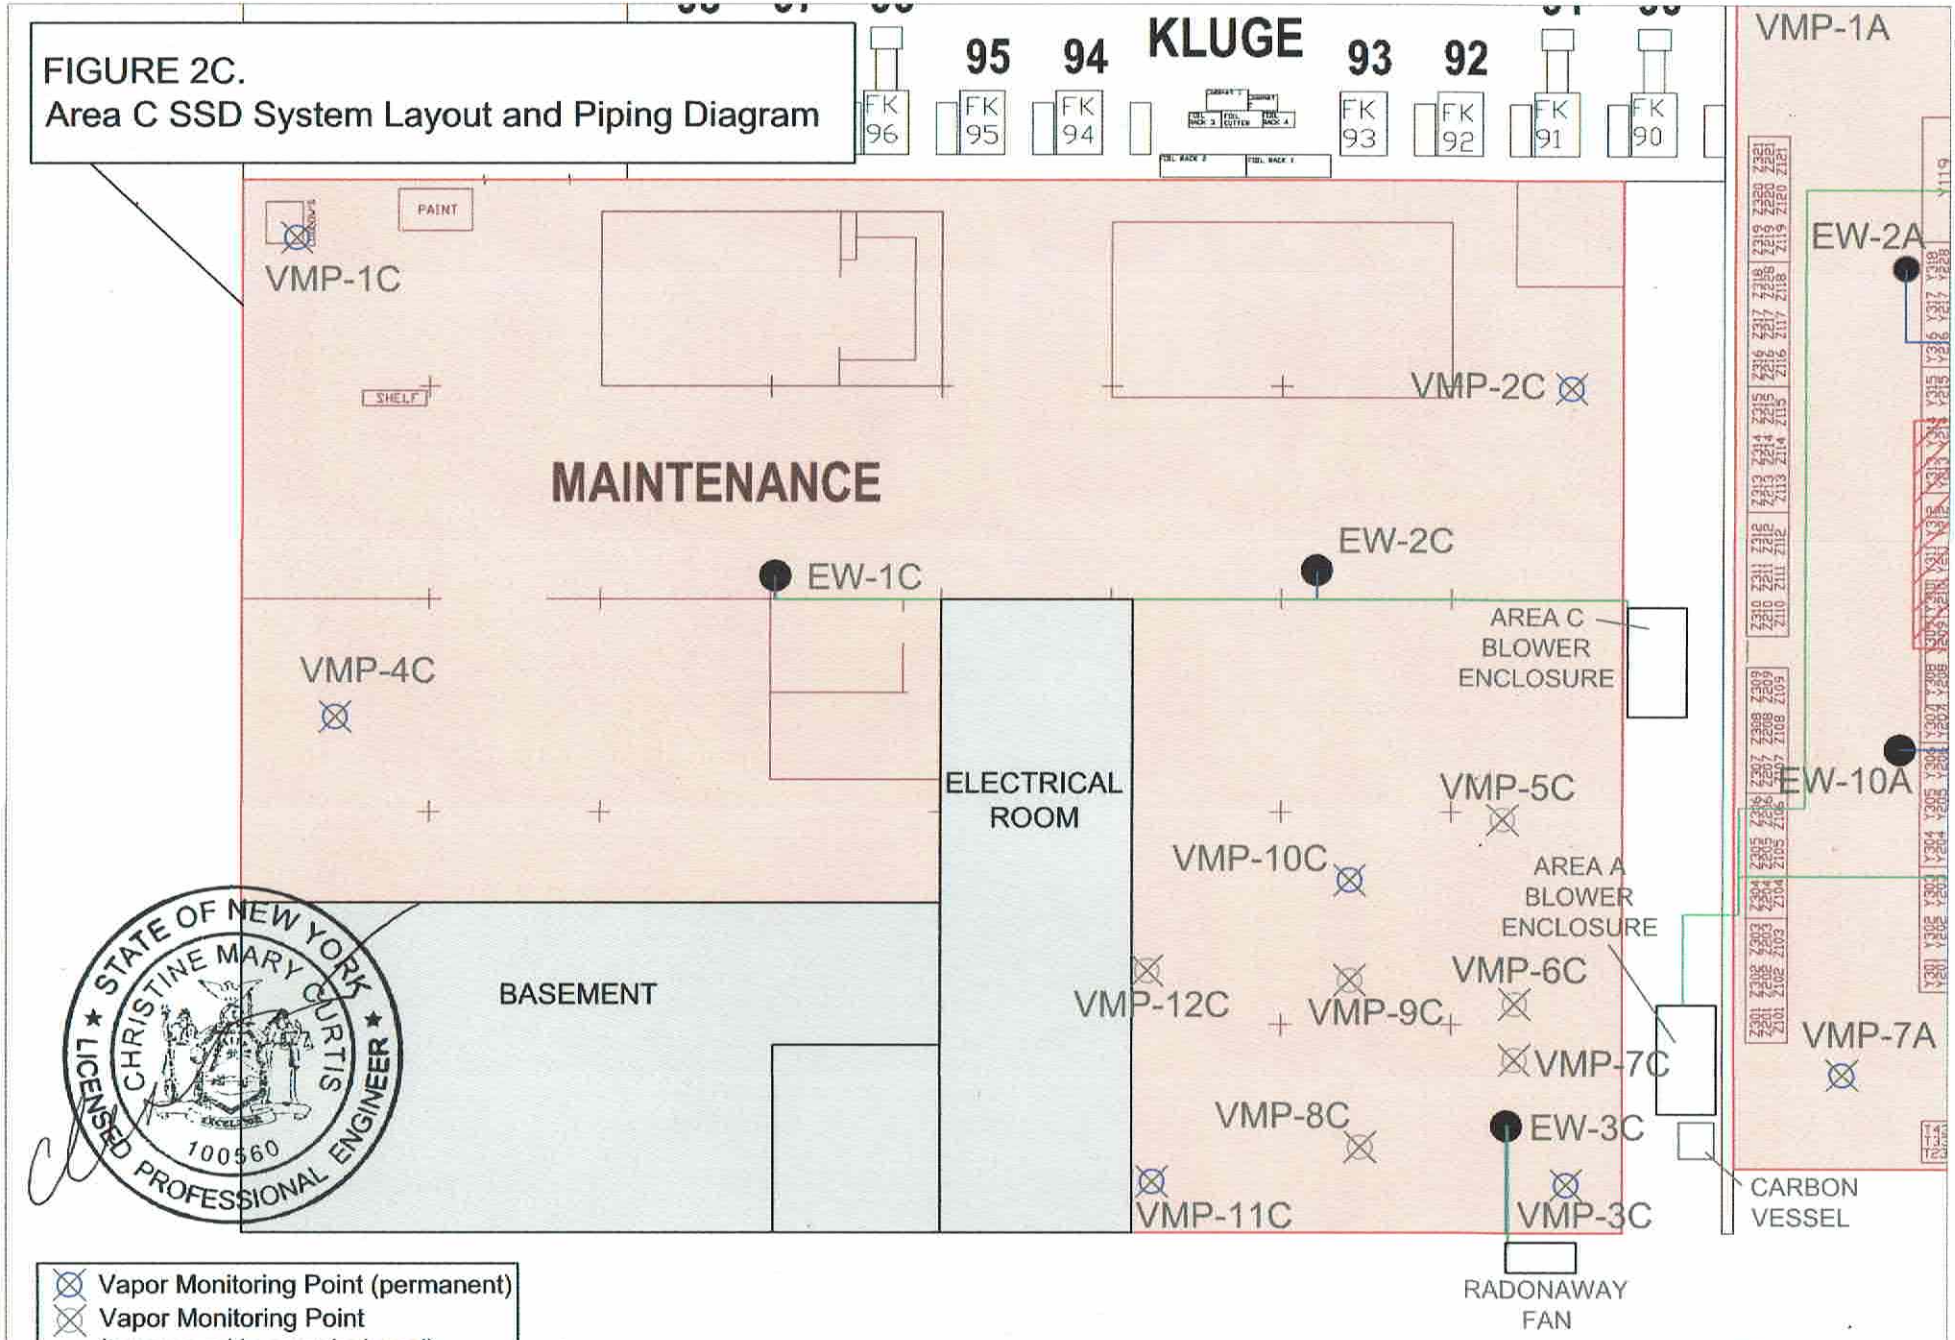

TABLES

Table 1
MOD-PAC CORP., 1801 Elmwood Ave, Buffalo, NY
SSD Systems Post Installation Monitoring Results
Q2 2026 Summary

Area A - Finished Product Storage Area

Date	Vacuum in Extraction Wells (in WC)										Blower (in WC)	Pre-carbon PID Reading (ppm)	Post-carbon PID Reading (ppm)
	EW-1A	EW-2A	EW-3A	EW-4A	EW-5A	EW-6A	EW-7A	EW-8A	EW-9A	EW-10A			
7/1/2026	20.0	20.0	21.0	20.0	20.0	OFF	20.0	22.0	20.0	20.0	37.0	0.0	0.0

Date	Vacuum in Vapor Monitoring Points (in WC)							
	VMP-1A	VMP-2A	VMP-3A	VMP-4A	VMP-5A	VMP-7A	VMP-8AR	VMP-9A
7/1/2026	0.040	0.064	0.091	0.123	Covered	0.040	0.016	0.051

Area B - Cold Storage Garage

Date	Vacuum in Extraction Wells (in WC)								Blower (in WC)	System Effluent PID Reading (ppm)
	EW-1B	EW-2B	EW-3B	EW-4B	EW-5B	EW-6B	EW-7B	EW-8B		
7/1/2026	43.0	44.0	44.0	44.0	43.0	45.0	43.0	43.0	50.0	0.0

Date	Vacuum in Vapor Monitoring Points (in WC)						
	VMP-1B	VMP-2B	VMP-3B	VMP-4B	VMP-5BR	VMP-6B	VMP-7B
7/1/2026	Covered	0.036	0.108	0.251	0.030	Covered	0.120

Area C - Maintenance Area

Date	Vacuum in Extraction Wells (in WC)			Blower (in WC)	System Effluent PID Reading (ppm)		
	EW-1C	EW-2C	EW-3C		EW-1C	EW-2C	EW-3C
7/1/2026	37.0	39.0	28.0	45.0	0.0		0.0

Date	Vacuum in Vapor Monitoring Points (in WC)					
	VMP-1C	VMP-2C	VMP-3C	VMP-4C	VMP-10C	VMP-11C
7/1/2026	0.036	0.071	0.019	0.043	0.116	0.043

Note:
1. in WC = inches water column; ppm = parts per million;

Table 2A
MOD-PAC CORP., 1801 Elmwood Ave, Buffalo, NY
SSD System Monitoring Results
Area A - Finished Product Storage Area

Date	Vacuum in Extraction Wells (in WC)										Blower	Pre-carbon PID	Post-carbon PID
	EW-1A	EW-2A	EW-3A	EW-4A	EW-5A	EW-6A	EW-7A	EW-8A	EW-9A	EW-10A	(in WC)	Reading (ppm)	Reading (ppm)
9/26/2019	14.5	14.5	15.5	14.5	15.0	1.0	14.5	15.0	14.5	15.5	12.0	3.3	1.5
10/3/2019	14.0	14.0	15.0	14.0	14.0	1.0	14.0	15.0	14.0	15.0	12.0	52.6	12.7
10/9/2019	13.0	13.5	14.0	13.5	13.5	1.0	13.5	14.0	13.5	14.5	13.0	0.0	0.0
11/5/2019	11.5	12.0	12.5	11.5	12.0	1.0	12.0	12.0	11.5	12.5	10.0	4.7	0.5
12/3/2019	11.0	11.5	12.0	11.0	11.5	1.0	11.5	11.5	11.5	12.0	10.0	1.0	0.1
1/22/2020												0.2	0.0
2/11/2020	10.0	10.5	11.0	10.5	11.0	1.0	11.0	11.0	10.5	11.5	9.0	0.5	0.0
3/27/2020	10.0	10.0	11.0	10.5	11.0	1.0	10.5	10.5	10.0	11.0	8.0	47.8	27.1
6/29/2020	13.0	13.0	13.5	13.0	13.0	1.0	13.0	13.0	13.0	13.5	14.0	0.4	0.4
7/31/2020												0.0	0.0
8/28/2020												0.0	0.0
9/15/2020	13.5	14.0	14.5	14.0	14.0	1.0	14.0	14.5	14.5	15.0	14.0	2.7	1.1
10/15/2020												7.8	4.6
11/4/2020												0.0	0.0
12/8/2020	12.5	13.0	13.5	13.0	13.0	1.0	13.0	14.0	13.0	14.0	12.0	0.6	0.0
1/4/2021												0.4	0.0
2/18/2021												1.0	0.0
3/30/2021	13.0	14.0	14.0	14.0	14.0	0.0	14.0	14.0	14.0	15.0	12.0	0.0	0.0
4/14/2021												0.4	0.0
5/20/2021												0.4	0.0
6/11/2021	16.0	16.0	16.0	16.0	16.0	0.0	16.0	17.0	17.0	17.0	15.0	0.1	0.0
7/1/2021											16.0	0.0	0.0
8/25/2021											18.0	0.0	0.0
9/8/2021	17.0	17.0	18.0	18.0	17.0	0.0	18.0	18.0	18.0	18.0	16.0	0.3	0.0
10/20/2021												0.0	0.0
11/19/2021												0.0	0.0
12/10/2021	16.0	16.0	17.0	16.0	17.0	0.0	17.0	17.0	17.0	17.0	15.0	7.6	0.0
1/11/2022											19.0	0.0	0.0
2/2/2022												0.08	0.0
3/10/2022	15.5	16.5	17.0	16.5	16.5	1.0	16.5	17.0	17.0	17.0	12.0	0.0	0.0
4/21/2022											19.0	0.0	0.0
5/16/2022											18.0	0.0	0.0
6/6/2022	16.0	17.0	17.0	16.0	17.0	0.0	17.0	17.0	17.0	17.0	19.0	0.0	0.0
7/28/2022											19.0	1.4	0.0
8/26/2022											19.0	0.5	0.0
9/22/2022	18.0	18.0	19.0	18.0	18.0	0.0	18.0	19.0	19.0	19.0	18.0	1.2	0.1
10/13/2022	18.0	18.0	18.0	18.0	18.0	0.0	18.0	18.0	18.0	19.0	19.0	0.2	0.0
11/7/2022	18.0	18.0	18.0	18.0	18.0	0.0	18.0	18.0	18.0	18.0	19.0	0.0	0.0
12/9/2022	18.0	18.0	18.0	18.0	18.0	0.0	18.0	18.0	18.0	18.0	19.0	0.0	0.0
1/31/2023	16.0	17.0	18.0	17.0	17.0	0.0	17.0	18.0	17.0	18.0	18.0	0.0	0.0
2/21/2023	16.0	17.0	18.0	17.0	17.0	0.0	17.0	18.0	17.0	18.0	18.0	0.0	0.0
3/10/2023	18.0	18.0	18.0	18.0	18.0	0.0	18.0	18.0	18.0	18.0	19.0	0.0	0.0
4/6/2023											20.0	0.0	0.0
5/17/2023											20.0	0.0	0.0
6/20/2023	17.0	18.0	19.0	18.0	18.0	0.0	18.0	19.0	18.0	19.0	20.0	0.3	0.1
7/5/2023											20.0	0.0	0.0
8/17/2023											21.0	0.0	0.0
9/13/2023	19.0	20.0	20.0	20.0	19.0	0.0	20.0	20.0	20.0	20.0	20.0	0.0	0.0
10/3/2023											22.0	0.2	0.3
11/11/2023											20.0	0.1	0.0
12/12/2023	17.0	18.0	19.0	18.0	19.0	0.0	18.0	20.0	17.0	19.0	20.0	0.1	0.0
1/12/2024											21.0	1.4	0.0
2/8/2024											21.0	1.1	0.0
3/12/2024	17.0	18.0	19.0	18.0	18.0	0.0	18.0	20.0	19.0	19.0	21.0	0.3	0.0
4/9/2024											22.0	0.6	0.0
4/15/2024	18.0	19.0	20.0	19.0	18.0	0.2	19.0	20.0	19.0	20.0	23.0	0.1	0.0
5/8/2024											21.0	0.1	0.0
6/13/2024	17.0	17.0	18.0	17.0	17.0	0.0	18.0	19.0	17.0	18.0	21.0	0.0	0.0
7/1/2024											21.0	0.5	0.2
8/6/2024											21.0	9.1	5.1
9/6/2024	18.0	19.0	19.0	19.0	18.0	0.0	18.0	20.0	19.0	19.0	21.0	1.3	0.2
10/16/2024											20.0	0.5	0.0
11/15/2024											21.0	1.5	0.0
12/23/2024	12.0	13.0	13.0	12.0	12.0	0.0	13.0	14.0	13.0	13.0	12.0	1.2	0.0
1/23/2025											17.0	0.1	0.0
2/19/2025											18.0	0.0	0.0
3/3/2025	16.0	16.0	17.0	16.0	16.0	1.0	15.0	17.0	16.0	17.0	19.0	0.0	0.0
4/16/2025	12.0	17.0	18.0	17.0	17.0	0.0	17.0	18.0	17.0	17.0	22.0	0.2	0.0
5/28/2025											24.0	0.0	0.0
6/30/2025	20.0	20.0	20.0	20.0	20.0	0.0	20.0	21.0	20.0	20.0	32.0	0.0	0.0
7/16/2025											32.0	0.7	0.1
8/6/2025											34.0	0.0	0.0
9/15/2025	20.0	20.0	21.0	20.0	20.0	0.0	21.0	22.0	20.0	20.0	32.0	0.0	0.0
10/2/2025											34.0	0.0	0.0
11/14/2025											30.0	0.0	0.0
12/11/2025	16.0	17.0	17.0	17.0	16.0	0.0	16.0	17.0	17.0	17.0	24.0	0.1	0.0
1/8/2026											28.0	0.6	0.0
2/3/2026											26.0	0.0	0.0
3/25/2026	11.0	11.0	12.0	0.0	11.0	12.0	12.0	12.0	11.0	12.0	22.0	0.3	0.0
4/21/2026	18.0	18.0	19.0	18.0	18.0	0.0	18.0	19.0	18.0	19.0	21.0	0.0	0.0
5/12/2026											30.0	0.5	0.0
6/25/2026	20.0	20.0	21.0	20.0	20.0	0.0	20.0	21.0	20.0	20.0	33.0	0.0	0.0
7/1/2026	20.0	20.0	21.0	20.0	20.0	0.0	20.0	22.0	20.0	20.0	37.0	0.0	0.0

Table 2A
MOD-PAC CORP., 1801 Elmwood Ave, Buffalo, NY
SSD System Monitoring Results
Area A - Finished Product Storage Area

Date	Vacuum in Vapor Monitoring Points (in WC)							
	VMP-1A	VMP-2A	VMP-3A	VMP-4A	VMP-5A	VMP-7A	VMP-8AR	VMP-9A
9/26/2019	0.066	0.044	0.075	0.161	0.128	0.025		0.173
10/3/2019	0.065	0.037	0.053	0.139	0.116	0.019		0.105
10/9/2019	0.061	0.034	0.045	0.110	0.103	0.020		0.100
11/5/2019	0.041	0.029	0.023	0.067	0.062	0.013		0.067
12/3/2019	0.045	0.025	0.031	0.066	0.056	0.010		0.054
2/11/2020	0.037	0.020	0.015	0.045	0.036	0.000		0.037
3/27/2020	0.025	0.023	0.016	0.032	0.032	0.000		0.022
6/29/2020	0.053	0.064	0.063	0.124	0.080	0.010		0.094
9/15/2020	0.053	0.052	0.043	0.093	0.033	0.017		0.058
12/8/2020	0.048	0.033	0.026	0.152	0.050	0.000		0.065
3/30/2021	0.038	0.052	0.032	0.063	0.022	0.020		0.047
6/11/2021	0.073	0.065	0.055	0.105	0.074	0.026		0.074
9/8/2021	0.091	0.088	0.075	0.140	0.086	0.028		0.149
12/10/2021	0.065	0.056	0.043	0.068	0.052	0.017		0.088
3/10/2022	0.045	0.040	0.045	0.080	0.040	0.010		0.097
6/6/2022	0.068	0.060	0.068	0.097	0.056	0.027		0.110
9/22/2022	0.100	0.098	0.105	0.157	0.082	0.032		0.149
10/13/2022	0.069	0.063	0.071	0.126	0.071	0.025		0.122
11/7/2022	0.077	0.063	0.084	0.122	0.059	0.021		0.115
12/9/2022	0.074	0.043	0.046	0.089	0.048	0.022		0.110
1/31/2023	0.059	0.040	0.042	0.067	0.039	0.014		0.078
2/21/2023	0.059	0.048	0.061	0.083	0.040	0.019		0.100
3/10/2023	0.052	0.032	0.054	0.067	0.032	0.000		0.039
4/12/2023						0.025		
5/17/2023						0.032		
6/20/2023	0.083	0.066	0.085	0.118	0.066	0.024		0.133
9/13/2023	0.097	0.079	0.102	0.140	0.083	0.037		0.140
12/12/2023	0.066	0.140	0.203	0.271	0.141	0.019		0.219
3/12/2024	0.065	0.045	0.057	0.080	0.039	0.023		0.084
4/15/2024	0.077	0.149	0.175	0.092	0.045	0.027	0.014	0.274
6/13/2024	0.075	0.066		0.126	0.061	0.034	0.012	0.096
9/6/2024	0.116	0.065	0.093	0.154	0.065	0.059	0.046	0.130
12/23/2024	0.034	0.000	0.015	0.039	0.038	0.000	0.000	0.018
1/23/2025		0.010				0.000	0.015	
2/19/2025						0.000		
3/3/2025	0.022	0.052	0.055	0.044	0.053	0.000	0.003	0.000
4/16/2025	0.036	0.042	0.020	0.026	0.023	0.021	0.003	0.021
6/30/2025	0.103	0.076	0.111	0.162	0.071	0.049	0.022	0.128
9/15/2025	0.086	0.067	0.078	0.131	0.051	0.041	0.016	0.119
12/11/2025	0.032	0.028	0.020	0.051	0.017	0.003	0.000	0.023
1/8/2026							0.000	
2/3/2026							0.000	
3/25/2026	0.015	0.000	0.028	0.517	0.063	0.000	0.000	0.026
4/21/2026	0.043	0.028	0.041	0.060	0.022	0.017	0.000	0.035
5/12/2026							0.000	
7/1/2026	0.040	0.064	0.091	0.123		0.040	0.016	0.051

Note:
1. Yellow shading indicates that samples did not meet the minimum 0.002 inches WC
2. Blank space indicates that data was not collected
3. in WC = inches water column; ppm = parts per million;

Table 2B
MOD-PAC CORP., 1801 Elmwood Ave, Buffalo, NY
SSD System Monitoring Results
Area B - Cold Storage Garage

Date	Vacuum in Extraction Wells (in WC)								Blower	System Effluent
	EW-1B	EW-2B	EW-3B	EW-4B	EW-5B	EW-6B	EW-7B	EW-8B	(in WC)	PID Reading (ppm)
9/26/2019	13.0	13.5	13.5	14.5	13.5	14.0	13.0	12.0	10.5	1.3
10/3/2019	13.0	13.5	13.5	14.0	13.5	14.0	13.0	12.0	10.0	1.4
10/9/2019	12.5	13.0	13.0	13.5	13.0	13.5	12.0	12.0	10.0	0.0
11/5/2019	12.0	13.0	12.5	13.0	12.5	13.0	11.5	11.0	9.0	0.5
12/3/2019	11.0	11.0	11.0	11.5	11.0	11.5	10.5	10.0	8.0	0.1
1/22/2020										0.0
2/11/2020	12.5	13.0	13.0	13.5	13.0	13.5	12.0	11.5	9.0	0.0
3/27/2020	14.0	15.0	14.0	15.0	15.0	15.0	14.0	13.5	10.0	0.0
6/29/2020	16.0	12.0	17.0	12.5	17.0	17.0	16.0	15.5	16.0	0.0
7/31/2020										0.0
8/28/2020										0.0
9/15/2020	17.0	18.0	17.0	18.0	18.0	18.0	17.0	16.5	16.0	2.7
10/15/2020										0.3
11/4/2020										0.0
12/8/2020	16.5	17.0	17.0	17.0	17.0	17.0	16.5	16.0	13.0	0.4
1/4/2021										0.0
2/18/2021										0.0
3/30/2021	16.0	17.0	17.0	17.0	17.0	17.0	16.0	16.0	12.0	0.0
4/14/2021										0.0
5/20/2021										0.1
6/11/2021	18.0	18.0	19.0	20.0	19.0	19.0	18.0	18.0	18.0	0.0
7/1/2021									18.0	0.0
8/25/2021									20.0	0.0
9/8/2021	20.0	21.0	22.0	23.0	22.0	22.0	21.0	21.0	19.0	0.0
10/20/2021										0.0
11/19/2021										0.0
12/10/2021	20.0	20.0	21.0	21.0	21.0	21.0	20.0	20.0	16.0	0.0
1/11/2022									19.0	0.0
2/2/2022										0.0
3/10/2022	22.0	23.0	23.0	23.5	22.5	23.0	22.5	22.0	20.0	0.0
4/21/2022									19.0	0.0
5/16/2022									19.0	0.0
6/6/2022	26.0	27.0	27.0	28.0	27.0	27.0	27.0	26.0	19.0	0.0
7/28/2022									25.0	0.5
8/26/2022									23.0	0.0
9/22/2022	28.0	29.0	30.0	30.0	29.0	30.0	29.0	28.0	26.0	2.6
10/13/2022	31.0	32.0	33.0	33.0	32.0	34.0	32.0	32.0	20.0	0.8
11/7/2022	31.0	32.0	33.0	33.0	33.0	34.0	32.0	32.0	18.0	0.0
12/8/2022	32.0	33.0	34.0	34.0	33.0	34.0	33.0	32.0	19.0	0.0
1/31/2023	31.0	32.0	33.0	33.0	32.0	33.0	32.0	32.0	19.0	0.0
2/21/2023	30.0	31.0	32.0	32.0	31.0	32.0	31.0	30.0	26.0	0.0
3/10/2023	32.0	32.0	32.0	32.0	32.0	32.0	32.0	32.0	19.0	0.0
4/6/2023									24.0	0.0
5/17/2023									29.0	0.0
6/20/2023	31.0	32.0	32.0	33.0	32.0	33.0	32.0	32.0	30.0	0.0
7/5/2023									44.0	0.0
8/17/2023									40.0	0.0
9/13/2023	37.0	33.0	38.0	36.0	37.0	39.0	37.0	38.0	34.0	0.0
10/3/2023									34.0	0.7
11/11/2023									28.0	0.0
12/12/2023	36.0	37.0	37.0	38.0	37.0	39.0	37.0	37.0	31.0	0.0
1/12/2024									44.0	0.2
02/08/204									45.0	0.1
3/12/2024	36.0	37.0	37.0	38.0	37.0	39.0	37.0	32.0	31.0	0.0
4/9/2024									32.0	0.0
4/15/2024	36.0	37.0	38.0	38.0	37.0	38.0	37.0	37.0		0.0
5/8/2024									36.0	0.1
6/13/2024	37.0	38.0	38.0	39.0	38.0	39.0	38.0	37.0	21.0	0.0
7/1/2024									24.0	0.0
8/6/2024									38.0	2.7
9/6/2024	39.0	39.0	40.0	40.0	39.0	40.0	39.0	39.0	39.0	0.0
10/16/2024									32.0	1.3
11/15/2024									46.0	0.1
12/23/2024	39.0	40.0	40.0	40.0	39.0	41.0	39.0	39.0	33.0	0.2
1/23/2025										0.0
2/19/2025									50.0	0.0
3/3/2025	38.0	38.0	39.0	38.0	37.0	40.0	38.0	38.0	50.0	0.0
4/16/2025	38.0	39.0	39.0	40.0	39.0	40.0	37.0	38.0	52.0	0.5
5/28/2025									52.0	0.0
6/30/2025	39.0	40.0	40.0	40.0	40.0	41.0	39.0	39.0	54.0	0.0
7/16/2025									55.0	0.9
8/6/2025									55.0	0.0
9/15/2025	41.0	42.0	42.0	42.0	41.0	43.0	41.0	41.0	55.0	0.0
10/2/2025									55.0	0.0
11/14/2025									54.0	0.0
12/11/2025	41.0	43.0	43.0	43.0	44.0	42.0	42.0	42.0	55.0	0.0
1/8/2026									56.0	0.2
2/3/2026									56.0	0.0
3/25/2026	42.0	43.0	43.0	44.0	43.0	45.0	43.0	43.0	56.0	0.2
4/21/2026	42.0	45.0	43.0	44.0	43.0	45.0	43.0	42.5	50.0	0.0
5/12/2026									50.0	0.2
6/25/2026	43.0	45.0	44.0	45.0	44.0	45.0	44.0	44.0	50.0	0.0
7/1/2026	43.0	44.0	44.0	44.0	43.0	45.0	43.0	43.0	50.0	0.0

Table 2B
MOD-PAC CORP., 1801 Elmwood Ave, Buffalo, NY
SSD System Monitoring Results
Area B - Cold Storage Garage

Date	Vacuum in Vapor Monitoring Points (in WC)						
	VMP-1B	VMP-2B	VMP-3B	VMP-4B	VMP-5BR	VMP-6B	VMP-7B
9/26/2019		0.065	0.419			0.016	0.200
10/3/2019	0.023	0.062	0.303	0.383		0.018	0.196
10/9/2019	0.018	0.055	0.258	0.329		0.010	0.178
11/5/2019	0.016	0.018	0.217	0.271		0.000	0.171
12/3/2019	0.014	0.032	0.114	0.156		0.000	0.136
2/11/2020	0.000	0.040		0.161		0.000	0.072
3/27/2020	0.000	0.040	0.163	0.171		0.010	0.152
6/29/2020	0.018	-0.064	0.354	0.343		0.022	0.020
9/15/2020	0.017	0.041	0.118	0.361		0.005	0.160
12/8/2020	0.000	0.020	0.137	0.208		0.000	0.203
3/30/2021	0.010	0.045	0.162	0.219		0.010	-0.197
6/11/2021	0.045	0.051	0.262	0.903		0.016	0.201
9/8/2021	0.045	0.058	0.285	1.020		0.041	0.060
12/10/2021	0.010	0.400	0.189	0.177		0.000	0.190
1/11/2022						0.012	
3/10/2022	0.012	0.032	0.141	0.262		0.000	0.133
3/31/2021						0.014	
6/6/2022	0.014	0.050	0.211	0.299		0.016	0.026
9/22/2022	0.019	0.057	0.238	0.328		0.020	0.263
10/13/2022	0.045	0.063	0.123	0.215		0.018	0.131
11/7/2022	0.014	0.057	0.218	0.312		0.016	0.232
12/8/2022	0.017	0.043	0.153	0.298		0.015	0.156
1/31/2023	0.009	0.044	0.187	0.279		0.012	0.158
2/21/2023	0.100	0.045		0.299		0.014	0.165
3/10/2023	0.015	0.030	0.046	0.266		0.015	0.035
6/20/2023	0.012	0.045	0.237	0.350		0.017	0.207
9/13/2023	0.016	0.062	0.433			0.018	0.284
11/11/2023				0.087			
12/12/2023	0.016	0.035	0.089	0.319		0.018	0.257
3/12/2024	0.000	0.001	0.006	0.012		0.000	0.009
4/9/2024	0.000					0.016	
4/15/2024	0.036	0.101	0.652	0.864	0.058	0.038	0.695
6/13/2024	0.018	0.047	0.293	0.376	0.026	0.020	0.290
9/6/2024	0.018	0.052	0.350	0.373	0.029	0.015	0.297
12/23/2024		0.088	0.108	0.362	0.012	0.014	0.308
2/19/2025	0.165						
3/3/2025		0.028	0.107	0.207	0.221	0.000	0.166
4/16/2025	0.000	0.028	0.204	0.025	0.015	0.010	0.167
5/28/2025	0.010						
6/30/2025	0.015	0.044	0.381	0.403	0.002	0.014	0.330
9/15/2025	0.013	0.033	0.193	0.399	0.029	0.021	0.399
12/11/2025	0.004	0.038	0.010	0.360	0.016	0.016	0.177
3/25/2026	0.000	0.032	0.179	0.265	0.020	0.014	0.130
4/21/2026	0.000	0.031	0.121	0.243	0.020	0.013	0.116
5/12/2026	0.000						
7/1/2026		0.036	0.108	0.251	0.030		0.120

Note:
1. Yellow shading indicates that samples did not meet the minimum 0.002 inches WC
2. Blank space indicates that data was not collected
3. in WC = inches water column; ppm = parts per million;

Table 2C
MOD-PAC CORP., 1801 Elmwood Ave, Buffalo, NY
SSD System Monitoring Results
Area C - Maintenance Area

Date	Vacuum in Extraction Wells (in WC)			Effluent PID Reading (ppm)		
	EW-1C	EW-2C	EW-3C	EW-1C	EW-2C	EW-3C
9/26/2019	43.0	40.0		1.4	0.7	
10/3/2019	44.0	45.0		1.0	4.5	
10/9/2019	44.5	45.5		0.0	0.0	
11/5/2019	44.0	46.0		0.0	0.4	
12/3/2019		39.0	28.0		1.2	0.4
1/22/2020					0.4	0.0
2/11/2020	31.0	30.0	27.5	0.2	0.0	0.0
3/27/2020	29.0	32.0	28.0	0.0	0.0	0.0
6/29/2020	27.0	31.0	29.0	0.0	0.0	0.0
7/31/2020				0.0	0.0	0.0
8/28/2020				0.0	0.0	0.0
9/15/2020	28.5	31.0	29.0	0.0	0.0	0.0
10/15/2020				0.0	0.0	0.0
11/4/2020				0.0	0.0	0.0
12/8/2020	31.0	31.0	29.0	0.0	0.0	0.0
1/4/2021				0.0	0.0	0.0
2/18/2021						0.0
3/30/2021		32.0	30.0		0.0	0.0
4/14/2021					0.1	0.0
5/20/2021				0.0	0.0	0.0
6/11/2021	23.0	31.0	30.0	0.0	0.0	0.0
7/1/2021				0.0	0.0	0.0
8/25/2021				0.0	0.0	0.0
9/8/2021	29.0	31.0	30.0	0.0	0.0	0.0
10/20/2021				0.0	0.0	0.0
11/19/2021				0.0	0.0	0.0
12/10/2021	30.0	32.0	30.0	4.7	0.0	0.0
1/11/2022				0.0	0.0	0.0
2/2/2022				0.0	0.0	0.0
3/10/2022	11.0	32.0	31.0	0.0	0.0	0.0
4/21/2022				0.0	0.0	0.0
5/16/2022				0.0	0.0	0.0
6/6/2022	28.0	31.0	32.0	0.0	0.0	0.0
7/28/2022				1.5	0.7	0.1
8/26/2022				0.1	0.0	0.0
9/22/2022	29.0	31.0	32.0	0.0	0.0	0.0
10/13/2022	29.0	31.0	0.0	0.0	0.0	
11/7/2022	29.0	31.0	0.0	0.0	0.0	
12/9/2022	30.0	30.0	30.0	0.0	0.0	0.0
1/31/2023	0.0	0.0	30.0			0.0
3/10/2023	0.0	0.0	30.0	0.0	0.0	0.0
4/6/2023			28.0			0.0
5/17/2023			27.0			0.0
6/20/2023	0.0	0.0	29.0	0.0	0.0	0.0
7/5/2023			29.0			0.0
8/17/2023			29.0			0.3
9/13/2023	0.0	0.0	29.0	0.0	0.0	0.0
10/3/2023	35.0	38.0	30.0	27.9	6.7	1.0
11/11/2023	33.0	36.0	29.0	1.1	2.1	0.0
12/12/2023	34.0	37.0	29.0	4.7	2.5	0.1
1/12/2024	34.0	35.0	30.0	2.3	1.8	0.4
2/8/2024	43.0	46.0	30.0	1.6	1.2	0.2
3/12/2024	43.0	46.0	31.0	3.8	2.8	0.5
4/9/2024	44.0	46.0	30.0	0.4	0.0	0.0
4/15/2024	43.0	45.0	30.0	0.0	0.0	0.0
5/8/2024	43.0	45.0	30.0	0.4	0.3	10.3

Date	Vacuum in Extraction Wells (in WC)			Blower (in WC)	Effluent PID Reading (ppm)		
	EW-1C	EW-2C	EW-3C		EW-1C	EW2-C	EW-3C
6/13/2024	42.0	45.0	29.0	44.0	1.5	0.8	0.0
7/1/2024	44.0	45.0	30.0	45.0	0.1	0.0	0.4
8/6/2024	44.0	45.0	29.0	45.0	1.7	1.8	1.1
9/6/2024	42.0	45.0	30.0	46.0	0.7	0.8	0.3
10/16/2024	44.0	47.0	30.0	48.0	2.1		0.6

Date	Vacuum in Extraction Wells (in WC)			Blower (in WC)	Effluent PID Reading	
	EW-1C	EW-2C	EW-3C		Blower	EW-3C
11/15/2024	44.0	47.0	31.0	47.0		
12/23/2024	5.0	9.0	30.0	10.0	9.8	0.2
1/23/2025	8.0	11.0	32.0	60.0		
2/19/2025				60.0		
3/3/2025	18.0	40.0	30.0	54.0	0.0	0.0
4/16/2025	33.0	35.0	30.0	40.0	0.1	0.0
5/28/2025				40.0	0.0	0.0
6/30/2025	43.0	45.0	29.0	52.0	0.0	0.0
7/16/2025				52.0	0.2	0.0
8/6/2025				52.0	0.0	0.0
9/15/2025	35.0	30.0	30.0	42.0	0.0	0.0
10/2/2025				40.0	0.0	0.0
11/14/2025				41.0	0.0	0.0
12/11/2025	19.0	42.0	30.0	54.0	0.0	0.0
1/8/2026				50.0	0.0	0.0
2/3/2026				65.0	0.0	0.0
3/25/2026	39.0	41.0	32.0	42.0	0.0	0.0
4/21/2026	38.0	41.0	30.0	46.0	0.0	0.0
5/12/2026				46.0	0.0	0.0
6/25/2026	38.0	40.0	30.0	46.0	0.0	0.0
7/1/2026	37.0	39.0	28.0	45.0	0.0	0.0

Table 2C
MOD-PAC CORP., 1801 Elmwood Ave, Buffalo, NY
SSD System Monitoring Results
Area C - Maintenance Area

Date	Vacuum in Vapor Monitoring Points (in WC)					
	VMP-1C	VMP-2C	VMP-3C	VMP-4C	VMP-10C	VMP-11C
9/26/2019	0.046	0.085	0.000	0.061		
10/3/2019	0.055	0.092	0.000	0.081		
10/9/2019	0.037	0.075	0.000	0.060		
11/5/2019	0.042	0.067	0.000	0.067		
12/3/2019	0.000	0.027	0.026	-0.004	0.045	0.018
2/11/2020	0.019	0.026	0.032	0.038	0.045	0.020
3/27/2020	0.019	0.033	0.038	0.029	0.060	0.021
6/29/2020	0.019	0.050	0.040	0.018	0.061	0.044
9/15/2020	0.012	0.040	0.038	0.024	0.039	0.017
12/8/2020	0.012	0.038	0.026	0.021	0.038	0.016
3/30/2021	0.000	0.022	0.037	0.000	0.025	0.020
6/11/2021	0.020	0.054	0.039	0.024	0.058	0.097
9/8/2021	0.049	0.042	0.040	0.075	0.066	0.022
12/10/2021	0.026	0.040	0.038	0.021	0.059	0.025
2/2/2022	0.000	0.028	0.038	0.012	0.034	0.019
3/10/2022	0.000	0.031	0.038	0.000	0.042	0.022
3/31/2022	0.021			0.030		
6/6/2022	0.019	0.058	0.037	0.024	0.076	0.039
9/22/2022	0.021	0.059	0.041	0.018	0.086	0.046
10/13/2022	0.033	0.042	0.000	0.044	0.044	0.000
11/7/2022	0.016	0.048	0.000	0.023	0.055	0.000
12/9/2022	0.041	0.030	0.039	0.045	0.056	0.022
3/10/2023	0.000	0.000	0.031	0.000	0.045	0.019
6/20/2023	0.000	0.000	0.029	0.000	0.024	0.040
9/13/2023	0.000	0.000	0.030	0.000	0.019	0.038
10/3/2023	0.036	0.063		0.040		
11/11/2023	0.024	0.044	0.046	0.043	0.162	0.108
12/12/2023	0.016	0.046	0.024	0.028	0.063	0.032
3/12/2024	0.051	0.073	0.028	0.069	0.067	0.025
4/15/2024	0.091	0.203	0.059	0.163	0.214	0.078
6/13/2024	0.035	0.081	0.021	0.066	0.102	0.042
9/6/2024	0.051	0.094	0.023	0.073	0.124	0.047
12/23/2024	0.000	0.008	0.013	0.000	0.600	0.028
1/23/2025	0.013			0.000		
2/19/2025				0.000		
3/3/2025	0.023	0.044	0.000	0.010	0.019	0.000
4/16/2025	0.047	0.048	0.019	0.059	0.057	0.016
6/30/2025	0.062	0.102	0.020	0.079	0.128	0.048
9/15/2025	0.039	0.067	0.018	0.045	0.071	0.038
12/11/2025	0.019	0.038	0.013	0.023	0.034	0.000
1/8/2026						0.013
3/25/2026	0.048	0.050	0.006	0.071	0.070	0.020
4/21/2026	0.048	0.054	0.018	0.032	0.048	0.014
7/1/2026	0.036	0.071	0.019	0.043	0.116	0.043

Note:

1. Yellow shading indicates that samples did not meet the minimum 0.002 inches WC
2. Blank space indicates that data was not collected
3. in WC = inches water column; ppm = parts per million;
4. Please note: The extraction system in area C was operated by fans from 2019-2023. In August 2023, the fans at EW-1C and EW-2C were removed, and a 1.5 hp blower was installed. EW-3C continues to be operated by a fan.

Table 3
MOD-PAC, Corp. 1801 Elmwood Avenue, Buffalo, NY
Summary of Air Analytical Testing Results

Parameter	June 2026 - L2640329	
	AREA A-PRE (062526)	AREA A-POST (062526)
Volatile Organic Compounds (ug/m^3)		
1,1,1-Trichloroethane	ND	ND
1,1,2,2-Tetrachloroethane	ND	ND
1,1,2-Trichloroethane	ND	ND
1,1-Dichloroethane	ND	ND
1,1-Dichloroethene	ND	ND
1,2,4-Trichlorobenzene	ND	ND
1,2,4-Trimethylbenzene	**8.75**	**4.67**
1,2-Dibromoethane	ND	ND
1,2-Dichlorobenzene	ND	ND
1,2-Dichloroethane	ND	ND
1,2-Dichloropropane	ND	ND
1,3,5-Trimethylbenzene	**2.05**	**1.1**
1,3-Butadiene	ND	ND
1,3-Dichlorobenzene	ND	ND
1,4-Dichlorobenzene	ND	ND
1,4-Dioxane	ND	ND
2,2,4-Trimethylpentane	**1.44**	ND
2-Butanone	**5.4**	**1.87**
2-Hexanone	**0.885**	ND
3-Chloropropene	ND	ND
4-Ethyltoluene	**1.14**	ND
4-Methyl-2-pentanone	**51.6**	**25.8**
Acetone	**41.3**	**9.48**
Benzene	**1.12**	ND
Benzyl chloride	ND	ND
Bromodichloromethane	ND	ND
Bromoform	ND	ND
Bromomethane	ND	ND
Carbon disulfide	**48.6**	**15.7**
Carbon tetrachloride	ND	ND
Chlorobenzene	ND	ND
Chloroethane	ND	ND
Chloroform	**1.54**	ND
Chloromethane	**0.498**	**0.485**
cis-1,2-Dichloroethene	**2.19**	ND
cis-1,3-Dichloropropene	ND	ND
Cyclohexane	ND	ND
Dibromochloromethane	ND	ND
Dichlorodifluoromethane	**2.39**	**2.11**
Ethyl Alcohol	**15.9**	**17.6**
Ethyl Acetate	**141**	**145**
Ethylbenzene	**4.31**	**1.97**
Freon-113	ND	ND
Freon-114	ND	ND
Heptane	**1.02**	ND
Hexachlorobutadiene	ND	ND
iso-Propyl Alcohol	**77.2**	**295**
Methyl tert butyl ether	ND	ND
Methylene chloride	ND	ND
n-Hexane	**22.2**	**28.4**
Naphthalene	ND	ND
o-Xylene	**8.95**	**4.95**
p/m-Xylene	**19.8**	**10.1**
Styrene	**3.01**	ND
tert-Butyl Alcohol	**3.36**	ND
Tetrachloroethene	**73.9**	**35.6**
Tetrahydrofuran	**2.65**	ND
Toluene	**17.7**	**8.55**
trans-1,2-Dichloroethene	ND	ND
trans-1,3-Dichloropropene	ND	ND
Trichloroethene	**169**	**4.66**
Trichlorofluoromethane	**2.19**	**2.39**
Vinyl bromide	ND	ND
Vinyl chloride	ND	ND

Notes:

1. Compounds detected in one or more samples included in this table. For a list of all compounds, refer to analytical report in the Appendix.
2. Analytical testing for VOCs via TO-15 completed by Alpha Analytical.
3. Results present in ug/m^3 or microgram per cubic meter.
4. Parameters shaded in red indicate analytes of concern (Target cVOCs)
5. Results in red indicate higher post-carbon readings over pre-carbon readings
6. Blank results = No Value Above Detection Limit

Table 4
MOD-PAC, Corp. 1801 Elmwood Avenue, Buffalo, NY
Summary of Area A Pre/Post Carbon and Area B Effluent Air Analytical Testing Results

	October 2019 - L1946093			November 2019 - L1952487			December 2019 - L1957660			February 2020 - L2006152			June 2020 - L2027736		September 2020 - L2038512		09/23/2020	December 2020 - L2054640		March 2021 - L2115934		June 2021 - L2131935		September 2021 - L2148116		12/10/2021	December 2021 - L2168195		March 2022- L2212728	
Parameter	**AREA A - PRE**	**AREA A-POST**	**AREA B**	**AREA A-PRE (110519)**	**AREA A-POST (110519)**	**AREA-B (110519)**	**AREA A-PRE (120319)**	**AREA A-POST (120319)**	**AREA B (120319)**	**AREA A-PRE (021120)**	**AREA A-POST (021120)**	**AREA B (120319)**	**AREA A-PRE (063020)**	**AREA A-POST (063020)**	**AREA A-PRE (091520)**	**AREA A-POST (091520)**	CARBON CHANGEOUT	**AREA A-PRE (120820)**	**AREA A-POST (120820)**	**AREA A-PRE (033021)**	**AREA A-POST (033021)**	**AREA A-PRE (061121)**	**AREA A-POST (061121)**	**AREA A-PRE (090821)**	**AREA A-POST (090821)**	CARBON CHANGEOUT	**AREA A-PRE (121021)**	**AREA A-POST (121021)**	**AREA A-PRE (031022)**	**AREA A-POST (031022)**
Volatile Organics in Air (ug/m^3)																													
1,1,1-Trichloroethane	**1.11**	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
1,1,2,2-Tetrachloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
1,1,2-Trichloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
1,1-Dichloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
1,1-Dichloroethene	**94.8**	ND	**4.52**	**35.5**	ND	ND	**41.6**	**5.55**	**0.979**	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
1,2,4-Trichlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
1,2,4-Trimethylbenzene	**2.5**	ND	ND	ND	ND	ND	ND	ND	ND	**48.5**	**30.2**	**56**	**21.8**	**21.5**	**64.4**	**63.4**		**29.7**	**23.7**	**34.4**	**28.8**	**46.1**	**38.9**	**42.4**	**53.1**		**59**	**49.2**	**7.28**	**4.56**
1,2-Dibromoethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
1,2-Dichlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
1,2-Dichloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
1,2-Dichloropropane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
1,3,5-Trimethylbenzene	**1**	ND	ND	ND	ND	ND	ND	ND	ND	**7.87**	**4.7**	**10.2**	**5.7**	**4.75**	**14.5**	**17.2**		**8.95**	**6.44**	**12.4**	**9.54**	**14.2**	**11.2**	**10.2**	**13.6**		**21.3**	**17.2**	**2.36**	**1.43**
1,3-Butadiene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
1,3-Dichlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
1,4-Dichlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
1,4-Dioxane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
2,2,4-Trimethylpentane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.976	**2.98**	ND	ND	**3.13**	ND		ND	ND	ND	ND	**3.14**	ND	ND	**1.37**		**1.37**	ND	ND	ND
2-Butanone	**9.88**	ND	**3.07**	**4.13**	ND	ND	**5.28**	ND	ND	**4.04**	ND	ND	**6.25**	**2.45**	ND	ND		**2.16**	ND	**2.98**	ND	**3.89**	ND	**2.53**	ND		**2.78**	**1.68**	**1.8**	ND
2-Hexanone	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
3-Chloropropene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
4-Ethyltoluene	ND	ND	ND	ND	ND	ND	ND	ND	ND	**14.5**	**9.49**	**21.8**	**4.22**	**3.87**	**12.4**	**10.9**		**3.95**	**2.79**	**6.1**	**4.46**	**10.7**	**8.26**	**6**	**8.26**		**30**	**21.6**	ND	ND
4-Methyl-2-pentanone	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	**9.71**	ND	**4.47**	ND	ND	**3.53**		ND	ND	ND	ND
Acetone	**59.4**	**10.5**	**22.7**	**49.9**	ND	**69.8**	**75.5**	**4.44**	**13.3**	**87.4**	ND	**53.4**	**100**	**10.6**	**26.6**	**9.95**		**195**	**12.3**	**73.6**	**12.5**	**73.6**	**20.7**	**38.2**	**40.4**		**108**	**29.2**	**134**	**10.6**
Benzene	**0.891**	ND	ND	ND	ND	ND	ND	ND	ND	**5.34**	**2.5**	**10.4**	ND	**0.987**	**4.79**	**2.43**		**1.42**	**0.69**	**2.25**	**1.03**	**10.7**	**4.98**	**2.75**	**5.46**		**2.58**	**1.04**	ND	ND
Benzyl chloride	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
Bromodichloromethane	ND	ND	ND	**9.71**	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
Bromoform	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	**2.17**
Bromomethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	**1.29**
Carbon disulfide	ND	ND	ND	ND	ND	ND	ND	0.835	ND	ND	21.5	ND	**5.82**	**6.42**	**4.42**	**2.21**		**1.45**	**0.931**	**2.42**	**0.944**	**7.41**	**2.68**	**3.83**	**12.5**		**4.61**	**2.56**	**1.3**	**0.956**
Carbon tetrachloride	ND	ND	ND	ND	ND	ND	ND	ND	1.26	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
Chlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
Chloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
Chloroform	**14.4**	ND	ND	**9.86**	ND	ND	**20.3**	**1.69**	ND	**17**	**1.51**	ND	**16.7**	**31.8**	**20.7**	**17.5**		**27.1**	**1.35**	**38.4**	**12.6**	**46.7**	**59.6**	**31.5**	**42.7**		**26.2**	**1.2**	**40.5**	**0.986**
Chloromethane	**0.591**	**0.745**	ND	ND	ND	ND	ND	**0.603**	**0.785**	ND	**0.446**	**1.21**	ND	**0.77**	ND	**0.438**		**0.626**	**0.630**	**0.648**	**0.766**	ND	**0.558**	ND	**0.564**		**0.605**	**0.465**	**0.62**	**1.01**
cis-1,2-Dichloroethene	**88.8**	ND	ND	**33.5**	ND	ND	**41.6**	**5.55**	**0.979**	**22.5**	**12.5**	ND	**26.1**	**63**	**19.2**	**21.7**		**15.1**	ND	**11.2**	**11.3**	**11.7**	**29.1**	**10.1**	**13.7**		**3.87**	ND	**3.26**	ND
cis-1,3-Dichloropropene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
Cyclohexane	**4.23**	ND	ND	**2**	ND	**2.52**	ND	ND	ND	**1.61**	ND	**0.847**	ND	ND	**2.54**	**0.823**		**2.1**	ND	**1.41**	ND	**2.42**	ND	ND	**1.29**		**1.61**	ND	ND	ND
Dibromochloromethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
Dichlorodifluoromethane	**1.99**	**1.78**	**1.98**	**2.13**	ND	ND	ND	**2.1**	**2.93**	ND	**1.47**	**1.99**	ND	**2.15**	ND	**1.61**		**2.41**	**2.38**	**1.95**	**2.04**	**2.06**	**1.87**	**2.64**	**2.14**		**2.1**	ND	**2.35**	**2.39**
Ethyl Alcohol	**14.3**	**23.4**	**16**	**22.2**	ND	**61.6**	**43.5**	**34.5**	**10.3**	**63.7**	**40.9**	**30.1**	**143**	**112**	**106**	**81.8**		**91**	**57.1**	**71.6**	**86.7**	**87.8**	**61.6**	**49.7**	**64.1**		**79**	**23.2**	**129**	ND
Ethyl Acetate	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	**3.27**	**3.13**	**4.4**	**4.14**	ND	ND		**3.41**	**2.5**	ND	ND
Ethylbenzene	**1.58**	ND	**0.973**	**2.32**	ND	ND	**3.54**	ND	ND	**37.6**	**20**	**60.4**	**6.65**	**5.13**	**17.9**	**13.6**		**16.8**	**5.08**	**15.9**	**6.91**	**19.1**	**11.5**	**9.64**	**16.8**		**7.12**	**4.17**	**3.61**	ND
Freon-113	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
Freon-114	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
Heptane	**14.3**	ND	**2.35**	**9.51**	ND	**6.27**	**18.2**	ND	**1.25**	**16.6**	**1.01**	**14.1**	**5.7**	**1.25**	**6.31**	**1.31**		**24.9**	ND	**7.38**	**0.836**	**6.64**	**1.94**	**1.98**	**3.74**		**7.09**	ND	**13.2**	ND
Hexachlorobutadiene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
iso-Propyl Alcohol	**44**	**48.2**	**28**	**103**	ND	**742**	**275**	**1.96**	**7.03**	**157**	**9.44**	**44.2**	**191**	**472**	**83.8**	**34.4**		**371**	**32.9**	**253**	**164**	**95.9**	**533**	**38.8**	**95.9**		**256**	**16.1**	**283**	**3.22**
Methyl tert butyl ether	**ND**	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
Methylene chloride	**9.21**	**13.2**	**9.87**	**3.68**	**5.45**	**5.35**	ND	**4.45**	**3.61**	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	**1.79**	ND	ND	**6.62**	ND		ND	ND	**1.75**	ND
Naphthalene	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA		NA	NA	NA	NA	NA	NA	NA	NA		NA	NA	NA	NA
n-Hexane	**6.06**	**5.08**	**1.72**	**5.22**	**1.89**	**3.98**	**28.2**	**1.2**	**1.54**	**20.7**	**0.948**	**6.1**	**12.2**	**2.59**	**29.3**	**3.67**		**18.1**	**2.31**	**33.7**	**5.15**	**73.7**	**14.9**	**4.12**	**61.3**		**17.9**	**2.07**	**7.68**	ND
o-Xylene	**1.55**	ND	**1.64**	**2.35**	ND	**2.81**	**3.14**	ND	ND	**46.5**	**26.9**	**64.7**	**12.1**	**10.2**	**33.1**	**26.6**		**25.5**	**10.5**	**28.9**	**14.9**	**30.9**	**20.4**	**20.1**	**31.3**		**13.1**	**8.3**	**4.47**	**1.9**
p/m-Xylene	**5.3**	ND	**4.34**	**8.08**	ND	**9.6**	**11.7**	ND	**2.07**	**138**	**77.7**	**181**	**28.1**	**23**	**83.4**	**65.6**		**69.9**	**25.4**	**71.2**	**33.9**	**89**	**57.8**	**48.6**	**79.1**		**33.2**	**19.8**	**13.9**	**4.6**
Styrene	ND	ND	ND	ND	ND	ND	ND	ND	ND	**2.78**	ND	**0.873**	**3.17**	ND	ND	**0.856**		**2.14**	ND	ND	ND	**1.9**	**1.14**	**1.29**	**1.23**		ND	ND	ND	ND
tert-Butyl Alcohol	ND	ND	**3.64**	ND	**5.67**	**7.31**	ND	ND	**7.64**	ND	**1.7**	**11.9**	ND	ND	**9.31**	ND		**5.15**	ND	**3.58**	ND	**2.26**	**8.94**	**11**	**1.73**		**13.5**	ND		
Tetrachloroethene	**2.12**	ND	**77.3**	ND	ND	**31.4**	ND	**1.97**	**12.4**	ND	ND	**10.6**	**5.78**	**5.8**	**4.95**	**2.3**		**1.69**	ND	**4.12**	ND	**2.63**	ND	**2.28**	ND		ND	ND	**1.75**	ND
Tetrahydrofuran	**47.2**	ND	**9.53**	**12.1**	ND	**4.98**	**13**	**7.73**	ND	**5.84**	**4.72**	**2.01**	**5.43**	**106**	ND	**6.55**		**1.55**	ND	ND	**2.43**	**2.14**	**3.19**	ND	ND		ND	ND	ND	ND
Toluene	**1.89**	ND	**1.55**	**6.1**	ND	**8.55**	**12.7**	ND	**2.07**	**131**	**66.3**	**168**	**23.2**	**15.8**	**65.6**	**45.2**		**31.3**	**11.5**	**39.2**	**20.1**	**93.5**	**52**	**36.6**	**62.2**		**37.7**	**20.4**	**14.5**	**2.81**
trans-1,2-Dichloroethene	**6.03**	ND	ND	**2**	ND	ND	ND	ND	ND	ND	**3.33**	ND	ND	**2.67**	ND	**1.12**		**0.852**	ND	ND	1.03	ND	**1.72**	ND	**0.841**		ND	ND	ND	ND
trans-1,3-Dichloropropene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
Trichloroethene	**2630**	ND	**554**	**978**	ND	**236**	**1030**	**2.48**	**104**	**656**	**10.8**	**79.5**	**983**	**17.2**	**736**	**133**		**508**	**19.3**	**378**	**22**	**469**	**29.3**	**559**	**1.27**		**259**	**16**	**224**	**7.95**
Trichlorofluoromethane	**1.48**	**3.62**	**2.69**	ND	**2.67**	ND	ND	**3.47**	**1.42**	ND	**1.78**	**1.37**	**10.2**	**10.7**	**3.36**	**4.40**		**1.4**	**2.51**	**1.69**	**1.79**	**3.53**	**3.47**	**6.07**	**4.08**		**1.78**	ND	**1.4**	ND
Vinyl bromide	ND	ND	ND	**1.78**	ND	**2.55**	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
Vinyl chloride	ND	ND	ND	**1.04**	ND	**1.49**	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND
Total Target cVOCs	**2,826.04**	**13.20**	**NC**	**1,051.72**	**5.45**	**NC**	**1,113.20**	**20.00**	**NC**	**678.50**	**23.30**	**NC**	**1,014.88**	**86.00**	**760.15**	**157.00**		**524.79**	**19.30**	**393.32**	**35.09**	**483.33**	**58.40**	**578.00**	**14.97**		**262.87**	**16.00**	**230.76**	**7.95**
Percent Decrease of CVOCs Pre to Post Carbon (%)	**-99.53**		**NC**	**-99.48**		**NC**	**-98.20**		**NC**	**-96.57**		**NC**	**-91.53**		**-79.35**			**-96.32**		**-91.08**		**-87.92**		**-97.41**			**-93.91**		**-96.55**	
Percent Decrease of CVOCs From Baseline (10/2019 Pre)	**NA**		**NC**	**-62.78**		**NC**	**-60.61**		**NC**	**-75.99**		**NC**	**-64.09**		**-73.10**			**-81.43**		**-86.08**		**-82.90**		**-79.55**			**-90.70**		**-91.83**	

Notes:
1. Compounds detected in one or more samples included in this table. For a list of all compounds, refer to analytical report in appendix.
2. Analytical testing for VOCs via TO-15 completed by Alpha Analytical.
3. Results present in ug/m^3 or microgram per cubic meter.
4. Samples were collected during a 8-hour sample duration.
5. Parameters shaded in red indicate analytes of concern (Target cVOCs). NYSDOH Target cVOCs are included in this calculation, specifically those listed in the NYSDOH "Final Guidance for Evaluating Soil Vapor Intrusion in the State of New York", May 2017 Update. Specifically: 1,1,1-Trichloroethane, 1,1-Dichloroethene, Carbon tetrachloride, cis-1,2-Dichloroethene, Methylene chloride, Tetrachloroethene, Trichloroethene, and Vinyl chloride
6. Results in red indicate post carbon result higher than pre carbon result.
7. ND = No Value Above Detection Limit (Non-detect); NA = Not Analyzed; NC = Not Calculated.
8. In some instances where the pre-sample is ND and the post sample presents a reportable value, the ND pre-sample may be due to sample dilution. Refer to analytical reports for dilution factors.

Table 4
MOD-PAC, Corp. 1801 Elmwood Avenue, Buffalo, NY
Summary of Area A Pre/Post Carbon and Area B Effluent Air Analytical Testing Results

Parameter	June 2022- L2229574		September 2022 L2252350		December 2022 - L2269445		12/09/2022	March 2023 - L2312615		June 2023 - L2335506		September 2023 - L2353358		December 2023 - L2373355		March 2024 - L2413550		June 2024 - L2434419		07/18/2024	September 2024 - L2453073		December 2024 - L2475127		March 2025 - L2511625		June 2025 - L2540965		September 2025 - L2558046		12/11/2025
	AREA A-PRE (060622)	AREA A-POST (060622)	AREA A-PRE (092222)	AREA A-POST (092222)	AREA A-PRE (120922)	AREA A-POST (120922)		AREA A-PRE (030823)	AREA A-POST (030823)	AREA A-PRE (062023)	AREA A-POST (062023)	AREA A-PRE (091323)	AREA A-POST (091323)	AREA A-PRE (121223)	AREA A-POST (121223)	AREA A-PRE (031224)	AREA A-POST (031224)	AREA A-PRE (061824)	AREA A-POST (061824)		AREA A-PRE (091624)	AREA A-POST (091624)	AREA A-PRE (121924)	AREA A-POST (121924)	AREA A-PRE (030325)	AREA A-POST (030325)	AREA A-PRE (063025)	AREA A-POST (063025)	AREA A-PRE (091525)	AREA A-POST (091525)	
Volatile Organics in Air (ug/m^3)																														
1,1,1-Trichloroethane	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,1,2,2-Tetrachloroethane	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,1,2-Trichloroethane	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,1-Dichloroethane	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,1-Dichloroethene	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,2,4-Trichlorobenzene	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,2,4-Trimethylbenzene	ND	9.83	4.33	4.39	2.89	3.58		2.16	ND	5.8	4.78	4.35	3.34	4.24	2.3	10.9	3.06	9.98	23.2		16.4	14.4	3.29	1.56	34.5	ND	7.18	ND	8.06	17.6	
1,2-Dibromoethane	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,2-Dichlorobenzene	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,2-Dichloroethane	ND	0.999	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,2-Dichloropropane	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	0.966	ND	ND	ND	
1,3,5-Trimethylbenzene	ND	2.7	1.33	1.23	ND	1.55		ND	ND	1.7	1.24	1.15	ND	1.59	ND	4.48	1.26	2.79	5.9		4.23	3.6	1.02	ND	8.55	ND	1.87	ND	2.29	6.15	
1,3-Butadiene	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	0.867	ND	ND	ND	ND	ND	ND	ND	
1,3-Dichlorobenzene	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,4-Dichlorobenzene	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,4-Dioxane	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	1.59	ND	ND	ND	
2,2,4-Trimethylpentane	ND	ND	1.22	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	1.31	ND	ND	ND		2.52	1.61	18.3	ND	3.42	ND	1.36	ND	1.52	ND	
2-Butanone	ND	3.27	2.92	3.16	2.08	ND		4.13	ND	4.98	1.79	4.16	2.01	1.86	ND	2.66	ND	6.64	ND		4.36	ND	1.94	ND	4.16	ND	7.73	2.03	3.86	3.45	
2-Hexanone	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
3-Chloropropene	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
4-Ethyltoluene	ND	1.85	ND	ND	ND	ND		ND	ND	1.23	ND	ND	ND	0.998	ND	2.82	ND	2.19	6.19		8.7	2.93	ND	ND	5.36	ND	ND	ND	ND	3.16	
4-Methyl-2-pentanone	ND	ND	ND	3.43	ND	ND		ND	ND	2.42	ND	5.49	ND	ND	ND	ND	ND	15.9	24.8		8.24	6.48	ND	ND	4.22	ND	ND	ND	ND	112	
Acetone	668	58.7	69.6	33.5	196	17.3		466	23.6	112	19.1	62.5	15.9	80.8	18.3	236	37.8	143	130		195	32.5	55.8	18.5	195	14.8	133	31.8	31.8	35.6	
Benzene	ND	1.53	1.56	ND	1.83	0.757		1.45	ND	1.8	1.04	1.29	0.652	0.706	ND	1.04	ND	1.87	5.81		2.18	3.51	4.12	ND	ND	ND	1.45	0.898	1.26	0.869	
Benzyl chloride	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Bromodichloromethane	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	1.65	ND	ND	ND	ND	ND	
Bromoform	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Bromomethane	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Carbon disulfide	7.51	3.74	8.16	6.26	4.20	0.782		ND	3.21	7.29	2.3	6.17	1.89	3.89	1.4	0.772	0.866	5.89	24.2		3.67	10.3	0.897	3.21	1.19	0.688	3.36	1.19	1.04	57.9	
Carbon tetrachloride	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Chlorobenzene	ND	ND	0.953	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Chloroethane	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Chloroform	21.6	1.67	14	31.3	24.4	ND		18.9	ND	15.1	ND	3.97	15.1	3.63	9.96	1.87	4.44	5.57	26.2		2.51	ND	1.33	ND	1.2	ND	1.99	2.35	3.38	1.42	
Chloromethane	ND	0.812	0.849	0.518	0.748	0.791		ND	ND	0.772	0.776	0.653	0.586	0.69	0.578	1.39	0.64	2.03	3.63		ND	0.968	0.549	0.595	0.679	0.781	0.65	0.661	0.516	0.653	
cis-1,2-Dichloroethene	ND	0.999	5.27	6.03	3.30	ND		3.71	ND	5.15	1.34	5.19	4.32	3.85	3.16	2.34	4.24	6.54	24.8		4.28	ND	2.98	ND	2.16	1.27	3.43	8.13	3.28	3.74	
cis-1,3-Dichloropropene	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Cyclohexane	ND	ND	0.981	ND	0.898	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		6.13	1.03	ND	ND	ND	ND	102	ND	1.16	ND	
Dibromochloromethane	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Dichlorodifluoromethane	ND	3.12	3.2	2.27	2.61	ND		2.53	2.84	3.19	2.91	2.33	1.84	2.62	2.2	2.19	2.88	4.03	7.22		2.36	2.32	2.18	2.37	2.22	2.11	2.47	2.25	2.19	2.08	
Ethyl Alcohol	148	119	126	83.8	127	25.1		114	121	61	57.8	51.8	43	28.6	52	107	87.1	50.9	166		59.7	62.7	46.5	52.2	46.9	53.3	25.2	22	22.8	30.5	
Ethyl Acetate	ND	3.6	4.72	ND	170	137		214	170	178	176	50.1	47.2	24.2	38.9	46.1	41.4	ND	ND		ND	ND	3.17	ND	19	16.9	50.5	28.8	17.1	16.1	
Ethylbenzene	ND	3.87	2.21	1.12	3.86	1.21		2.68	ND	4.08	2.24	2.42	1.23	1.52	ND	3.16	1.55	4.2	13.2		9.69	10.5	3.69	1.12	8.95	ND	1.5	ND	ND	8.38	
Freon-113	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Freon-114	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Heptane	ND	1.75	1.79	ND	9.02	ND		18	ND	1.36	ND	1.23	ND	2.19	ND	8.11	0.91	3.75	4.67		11.4	2.75	5.33	ND	42.6	ND	1.59	ND	1.11	1.32	
Hexachlorobutadiene	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
iso-Propyl Alcohol	5090	733 D	56.5	157	467	50.9		637	280	213	551	94.9	317	96.8	160	217	438	178	1150		1120	229	469	376	396	243	536	563	84.6	235	
Methyl tert butyl ether	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Methylene chloride	ND	ND	3.07	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	3.65	ND	ND	ND	ND	ND	ND	ND	ND	
Naphthalene	NA	NA	NA	NA	NA	NA		NA	NA	NA	NA	NA	NA	NA	NA	ND	ND	4.72	18.6		26	13.2	11	3.28	ND	ND	ND	ND	28.7	29.2	
n-Hexane	14.4	4.86	12.5	8.07	27.7	4.44		ND	ND	9.8	7.08	13.5	10.3	6.8	1.74	11.1	ND	ND	ND		ND	ND	ND	ND	38.1	1.66	81.8	4.37	ND	1.09	
o-Xylene	ND	6.34	3.61	2.28	4.60	2.33		3.03	ND	5.73	4.05	3.76	2.22	2.12	1.32	3.61	1.76	6.39	19.7		14.4	16.4	3.45	1.55	7.47	ND	2.11	ND	0.908	18.7	
p/m-Xylene	18.6	17.3	9.86	5.26	14.8	6.30		10.6	ND	18.2	11.60	11	6.08	6.47	3.69	11.9	5.95	19.3	63.9		43.9	51.3	9.9	4.69	30.7	ND	4.86	ND	2.19	39.5	
Styrene	ND	0.856	ND	ND	1.26	ND		ND	ND	1.91	0.975	1.32	ND	ND	ND	ND	ND	2.27	ND		ND	ND	ND	ND	0.915	ND	5.11	ND	2.75	2.12	
tert-Butyl Alcohol	20.3	ND	6.55	4.79	16.6	ND		18	ND	4.18	ND	4.55	2.37	3.3	4.37	8.61	11.1	20.6	49.1		10.9	ND	4.88	ND	8.28	ND	12.4	ND	3.94	ND	
Tetrachloroethene	ND	ND	2.31	ND	2.94	5.51		4.17	ND	2.27	ND	1.67	ND	ND	ND	ND	ND	9.97	27.7		ND	ND	4.02	10.6	ND	ND	2.49	1.75	4.58	9.09	
Tetrahydrofuran	ND	4.16	ND	2.22	ND	ND		ND	ND	2.14	ND	1.91	ND	ND	ND	ND	ND	2.48	5.75		ND	ND	ND	ND	ND	ND	1.77	1.78	ND	2.17	
Toluene	20.3	18.4	11.6	4.37	18.6	4.33		10.9	3.66	15.2	8.89	8.48	5.2	4.52	2.86	11	4.6	17.6	47.1		22	23.7	15.7	2.8	11	0.878	34.9	3.37	3.23	17.7	
trans-1,2-Dichloroethene	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	3.1		ND	ND	ND	ND	ND	ND	ND	1.88	ND	ND	
trans-1,3-Dichloropropene	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Trichloroethene	262	18.4	353	29.4	250	8.38		183	ND	327	18.3	313	18.4	248	12.6	152	9.24	450	20		400	ND	210	ND	157	1.12	291	ND	318	ND	
Trichlorofluoromethane	ND	5.22	3.73	4.61	1.48	ND		ND	ND	4.81	7.31	5.68	4.78	2.16	1.73	2.81	2.12	10.2	25		5.61	3.64	1.62	2.14	1.71	1.94	112	26.9	1.83	2.93	
Vinyl bromide	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Vinyl chloride	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Total Target cVOCs	262.00	19.40	363.65	35.43	256.24	13.89		190.88	0.00	334.42	19.64	319.86	22.72	251.85	15.76	154.34	13.48	466.51	72.50		404.28	3.65	217.00	10.60	159.16	2.39	296.92	9.88	325.86	12.83	
Percent Decrease of CVOCs Pre to Post Carbon (%)	-92.60		-90.26		-94.58			-100.00		-94.13		-92.90		-93.74		-91.27		-84.46			-99.10		-95.12		-98.50		-96.67		-96.06		
Percent Decrease of CVOCs From Baseline (10/2019 Pre)	-90.73		-87.13		-90.93			-93.25		-88.17		-88.68		-91.09		-94.54		-83.49			-85.69		-92.32		-94.37		-89.49		-88.47		

CARBON CHANGEOUT

Notes:

1. Compounds detected in one or more samples included in this table. For a list of all compounds, refer to analytical report in appendix.
2. Analytical testing for VOCs via TO-15 completed by Alpha Analytical.
3. Results present in ug/m^3 or microgram per cubic meter.
4. Samples were collected during a 8-hour sample duration.
5. Parameters shaded in red indicate analytes of concern (Target cVOCs). NYSDOH Target cVOCs are included in this calculation, specifically those listed in the NYSDOH "Final Guidance for Evaluating Soil Vapor Intrusion in the State of New York", May 2017 Update. Specifically: 1,1,1-Trichloroethane, 1,1-Dichloroethene, Carbon tetrachloride, cis-1,2-Dichloroethene, Methylene chloride, Tetrachloroethene, Trichloroethene, and Vinyl chloride
6. Results in red indicate post carbon result higher than pre carbon result.
7. ND = No Value Above Detection Limit (Non-detect); NA = Not Analyzed; NC = Not Calculated.
8. In some instances where the pre-sample is ND and the post sample presents a reportable value, the ND pre-sample may be due to sample dilution. Refer to analytical reports for dilution factors.

Table 4
MOD-PAC, Corp. 1801 Elmwood Avenue, Buffalo, NY
Summary of Area A Pre/Post Carbon and Area B Effluent Air Analytical Testing Results

Parameter	December 2025 - L2582504		March 2026 - L2616659		June 2026 - L2640329	
	AREA A-PRE (122925)	AREA A-POST (122925)	AREA A-PRE (032526)	AREA A-POST (032526)	AREA A-PRE (062526)	AREA A-POST (062526)
Volatile Organics in Air (ug/m^3)						
1,1,1-Trichloroethane	ND	ND	ND	ND	ND	ND
1,1,2,2-Tetrachloroethane	ND	ND	ND	ND	ND	ND
1,1,2-Trichloroethane	ND	ND	ND	ND	ND	ND
1,1-Dichloroethane	ND	ND	ND	ND	ND	ND
1,1-Dichloroethene	ND	ND	ND	ND	ND	ND
1,2,4-Trichlorobenzene	ND	ND	ND	ND	ND	ND
1,2,4-Trimethylbenzene	1.42	1.23	16.1	6.88	8.75	4.67
1,2-Dibromoethane	ND	ND	ND	ND	ND	ND
1,2-Dichlorobenzene	ND	ND	ND	ND	ND	ND
1,2-Dichloroethane	ND	ND	ND	ND	ND	ND
1,2-Dichloropropane	ND	ND	ND	ND	ND	ND
1,3,5-Trimethylbenzene	ND	ND	4.77	1.88	2.05	1.1
1,3-Butadiene	ND	ND	ND	ND	ND	ND
1,3-Dichlorobenzene	ND	ND	ND	ND	ND	ND
1,4-Dichlorobenzene	ND	ND	ND	ND	ND	ND
1,4-Dioxane	1.59	ND	ND	ND	ND	ND
2,2,4-Trimethylpentane	ND	ND	ND	ND	1.44	ND
2-Butanone	2.35	ND	3.83	ND	5.4	1.87
2-Hexanone	ND	ND	ND	ND	0.885	ND
3-Chloropropene	ND	ND	ND	ND	ND	ND
4-Ethyltoluene	ND	ND	4.47	1.57	1.14	ND
4-Methyl-2-pentanone	35.2	9.51	26.1	30.4	51.6	25.8
Acetone	104	59.9	76	11	41.3	9.48
Benzene	6.13	1.64	0.732	ND	1.12	ND
Benzyl chloride	ND	ND	ND	ND	ND	ND
Bromodichloromethane	ND	ND	ND	ND	ND	ND
Bromoform	ND	ND	ND	ND	ND	ND
Bromomethane	ND	ND	ND	ND	ND	ND
Carbon disulfide	20.5	5.36	7.41	14.4	48.6	15.7
Carbon tetrachloride	ND	ND	ND	ND	ND	ND
Chlorobenzene	ND	ND	ND	ND	ND	ND
Chloroethane	ND	ND	ND	ND	ND	ND
Chloroform	1.13	ND	1.24	ND	1.54	ND
Chloromethane	0.642	0.595	0.832	0.677	0.498	0.485
cis-1,2-Dichloroethene	1.23	ND	1.09	ND	2.19	ND
cis-1,3-Dichloropropene	ND	ND	ND	ND	ND	ND
Cyclohexane	ND	ND	ND	ND	ND	ND
Dibromochloromethane	ND	ND	ND	ND	ND	ND
Dichlorodifluoromethane	2.19	1.8	2.57	2.45	2.39	2.11
Ethyl Alcohol	32.2	40.5	32.6	19.6	15.9	17.6
Ethyl Acetate	10	9.62	26.4	30.3	141	145
Ethylbenzene	2.07	0.89	6.86	3.72	4.31	1.97
Freon-113	ND	ND	ND	ND	ND	ND
Freon-114	ND	ND	ND	ND	ND	ND
Heptane	4	2.04	8.44	ND	1.02	ND
Hexachlorobutadiene	ND	ND	ND	ND	ND	ND
iso-Propyl Alcohol	207	212	349	164	77.2	295
Methyl tert butyl ether	ND	ND	ND	ND	ND	ND
Methylene chloride	ND	ND	ND	ND	ND	ND
Naphthalene	11.3	5.92	11.1	20	22.2	28.4
n-Hexane	ND	ND	ND	ND	ND	ND
o-Xylene	2.59	1.19	11.5	10.6	8.95	4.95
p/m-Xylene	3.88	ND	31.3	22.7	19.8	10.1
Styrene	1.43	ND	1.89	1.01	3.01	ND
tert-Butyl Alcohol	5.24	4.4	3.82	ND	3.36	ND
Tetrachloroethene	ND	ND	3.36	2.01	73.9	35.6
Tetrahydrofuran	1.5	ND	ND	ND	2.65	ND
Toluene	12.6	5.09	8.37	5.35	17.7	8.55
trans-1,2-Dichloroethene	ND	ND	ND	ND	ND	ND
trans-1,3-Dichloropropene	ND	ND	ND	ND	ND	ND
Trichloroethene	96.2	2.07	100	2.61	169	4.66
Trichlorofluoromethane	1.23	ND	1.4	ND	2.19	2.39
Vinyl bromide	ND	ND	ND	ND	ND	ND
Vinyl chloride	ND	ND	ND	ND	ND	ND
Total Target cVOCs	97.43	2.07	104.45	4.62	245.09	40.26
Percent Decrease of CVOCs Pre to Post Carbon (%)	-97.88		-95.58		-83.57	
Percent Decrease of CVOCs From Baseline (10/2019 Pre)	-96.55		-96.30		-91.33	

Notes:
1. Compounds detected in one or more samples included in this table. For a list of all compounds, refer to analytical report in appendix.
2. Analytical testing for VOCs via TO-15 completed by Alpha Analytical.
3. Results present in ug/m^3 or microgram per cubic meter.
4. Samples were collected during a 8-hour sample duration.
5. Parameters shaded in red indicate analytes of concern (Target cVOCs). NYSDOH Target cVOCs are included in this calculation, specifically those listed in the NYSDOH "Final Guidance for Evaluating Soil Vapor Intrusion in the State of New York", May 2017 Update. Specifically: 1,1,1-Trichloroethane, 1,1-Dichloroethene, Carbon tetrachloride, cis-1,2-Dichloroethene, Methylene chloride, Tetrachloroethene, Trichloroethene, and Vinyl chloride
6. Results in red indicate post carbon result higher than pre carbon result.
7. ND = No Value Above Detection Limit (Non-detect); NA = Not Analyzed; NC = Not Calculated.
8. In some instances where the pre-sample is ND and the post sample presents a reportable value, the ND pre-sample may be due to sample dilution.

APPENDIX A

LABORATORY REPORT PRE AND POST CARBON

ANALYTICAL REPORT

Lab Number:	L2640329
Client:	Matrix Environmental Technologies 3730 California Road Orchard Park, NY 14127
ATTN:	Mary Szustak
Phone:	(716) 662-0745
Project Name:	MOD-PAC BCP QUARTERLY CARBON
Project Number:	15-017
Report Date:	07/02/26

The original project report/data package is held by Pace Analytical Services. This report/data package is paginated and should be reproduced only in its entirety. Pace Analytical Services holds no responsibility for results and/or data that are not consistent with the original.

Project Name: MOD-PAC BCP QUARTERLY CARBON
Project Number: 15-017

Lab Number: L2640329
Report Date: 07/02/26

Lab Sample ID	Client ID	Matrix	Sample Location	Collection Date/Time	Receive Date
L2640329-01	PRE-CARBON(062526)	SOIL_VAPOR	1810 ELMWOOD AVE., BUFFALO NY	06/25/26 12:50	06/25/26
L2640329-02	POST-CARBON(062526)	SOIL_VAPOR	1810 ELMWOOD AVE., BUFFALO NY	06/25/26 13:00	06/25/26

Project Name:	MOD-PAC BCP QUARTERLY CARBON	**Lab Number:**	L2640329
Project Number:	15-017	**Report Date:**	07/02/26

Case Narrative

The samples were received in accordance with the Chain of Custody and no significant deviations were encountered during the preparation or analysis unless otherwise noted. Sample Receipt, Container Information, and the Chain of Custody are located at the back of the report.

Results contained within this report relate only to the samples submitted under this Pace Lab Number and meet NELAP requirements for all NELAP accredited parameters unless otherwise noted in the following narrative. The data presented in this report is organized by parameter (i.e. VOC, SVOC, etc.). Sample specific Quality Control data (i.e. Surrogate Spike Recovery) is reported at the end of the target analyte list for each individual sample, followed by the Laboratory Batch Quality Control at the end of each parameter. Tentatively Identified Compounds (TICs), if requested, are reported for compounds identified to be present and are not part of the method/program Target Compound List, even if only a subset of the TCL are being reported. If a sample was re-analyzed or re-extracted due to a required quality control corrective action and if both sets of data are reported, the Laboratory ID of the re-analysis or re-extraction is designated with an "R" or "RE", respectively.

When multiple Batch Quality Control elements are reported (e.g. more than one LCS), the associated samples for each element are noted in the grey shaded header line of each data table. Any Laboratory Batch, Sample Specific % recovery or RPD value that is outside the listed Acceptance Criteria is bolded in the report. In reference to questions H (CAM) or 4 (RCP) when "NO" is checked, the performance criteria for CAM and RCP methods allow for some quality control failures to occur and still be within method compliance. In these instances, the specific failure is not narrated but noted in the associated QC Outlier Summary Report, located directly after the Case Narrative. QC information is also incorporated in the Data Usability Assessment table (Format 11) of our Data Merger tool, where it can be reviewed in conjunction with the sample result, associated regulatory criteria and any associated data usability implications.

Soil/sediments and solids are reported on a dry weight basis unless otherwise noted. Tissues are reported "as received" or on a wet weight basis, unless otherwise noted. Definitions of all data qualifiers and acronyms used in this report are provided in the Glossary located at the back of the report.

HOLD POLICY - For samples submitted on hold, Pace's policy is to hold samples (with the exception of Air canisters) free of charge for 21 calendar days from the date the project is completed. After 21 calendar days, we will dispose of all samples submitted including those put on hold unless you have contacted your Pace Project Manager and made arrangements for Pace to continue to hold the samples. Air canisters will be disposed after 3 business days from the date the project is completed.

Please contact Project Management at 800-624-9220 with any questions.

Project Name:	MOD-PAC BCP QUARTERLY CARBON	**Lab Number:**	L2640329
Project Number:	15-017	**Report Date:**	07/02/26

Case Narrative (continued)

Volatile Organics in Air

L2640329-01 and -02: Samples were transferred from a Tedlar bag into a fused silica lined canister upon receipt in order to extend the holding time for analysis.

I, the undersigned, attest under the pains and penalties of perjury that, to the best of my knowledge and belief and based upon my personal inquiry of those responsible for providing the information contained in this analytical report, such information is accurate and complete. This certificate of analysis is not complete unless this page accompanies any and all pages of this report.

Authorized Signature: Christopher J. Anderson

Title: Technical Director/Representative Date: 07/02/26

QC OUTLIER SUMMARY REPORT

Project Name: MOD-PAC BCP QUARTERLY CARBON
Project Number: 15-017

Lab Number: L2640329
Report Date: 07/02/26

Method	Client ID (Native ID)	Lab ID	Parameter	QC Type	Recovery/RPD (%)	QC Limits (%)	Associated Samples	Data Quality Assessment

There are no QC Outliers associated with this report.

AIR

Project Name: MOD-PAC BCP QUARTERLY CARBON
Project Number: 15-017
Lab Number: L2640329
Report Date: 07/02/26

SAMPLE RESULTS

Lab ID: L2640329-01
Client ID: PRE-CARBON(062526)
Sample Location: 1810 ELMWOOD AVE., BUFFALO NY

Date Collected: 06/25/26 12:50
Date Received: 06/25/26
Field Prep: Not Specified

Sample Depth:
Matrix: Soil_Vapor
Anaytical Method: 48,TO-15
Analytical Date: 07/02/26 05:25
Analyst: KJD

	ppbV			ug/m3				
Parameter	**Results**	**RL**	**MDL**	**Results**	**RL**	**MDL**	**Qualifier**	**Dilution Factor**
Volatile Organics in Air - Mansfield Air Lab								
Dichlorodifluoromethane	0.484	0.200	--	2.39	0.989	--		1
Chloromethane	0.241	0.200	--	0.498	0.413	--		1
Freon-114	ND	0.200	--	ND	1.40	--		1
Vinyl chloride	ND	0.200	--	ND	0.511	--		1
1,3-Butadiene	ND	0.200	--	ND	0.442	--		1
Bromomethane	ND	0.200	--	ND	0.777	--		1
Chloroethane	ND	0.200	--	ND	0.528	--		1
Ethanol	8.46	5.00	--	15.9	9.42	--		1
Vinyl bromide	ND	0.200	--	ND	0.874	--		1
Acetone	17.4	1.00	--	41.3	2.38	--		1
Trichlorofluoromethane	0.389	0.200	--	2.19	1.12	--		1
Isopropanol	31.4	1.00	--	77.2	2.46	--		1
1,1-Dichloroethene	ND	0.200	--	ND	0.793	--		1
Tertiary butyl Alcohol	1.11	0.500	--	3.36	1.52	--		1
Methylene chloride	ND	0.500	--	ND	1.74	--		1
3-Chloropropene	ND	0.200	--	ND	0.626	--		1
Carbon disulfide	15.6	0.200	--	48.6	0.623	--		1
Freon-113	ND	0.200	--	ND	1.53	--		1
trans-1,2-Dichloroethene	ND	0.200	--	ND	0.793	--		1
1,1-Dichloroethane	ND	0.200	--	ND	0.809	--		1
Methyl tert butyl ether	ND	0.200	--	ND	0.721	--		1
2-Butanone	1.83	0.500	--	5.40	1.47	--		1
cis-1,2-Dichloroethene	0.553	0.200	--	2.19	0.793	--		1

Project Name: MOD-PAC BCP QUARTERLY CARBON
Project Number: 15-017
Lab Number: L2640329
Report Date: 07/02/26

SAMPLE RESULTS

Lab ID: L2640329-01
Client ID: PRE-CARBON(062526)
Sample Location: 1810 ELMWOOD AVE., BUFFALO NY

Date Collected: 06/25/26 12:50
Date Received: 06/25/26
Field Prep: Not Specified

Sample Depth:

Parameter	ppbV Results	ppbV RL	ppbV MDL	ug/m3 Results	ug/m3 RL	ug/m3 MDL	Qualifier	Dilution Factor
Volatile Organics in Air - Mansfield Air Lab								
Ethyl Acetate	39.2	0.500	--	141	1.80	--		1
Chloroform	0.316	0.200	--	1.54	0.977	--		1
Tetrahydrofuran	0.898	0.500	--	2.65	1.47	--		1
1,2-Dichloroethane	ND	0.200	--	ND	0.809	--		1
n-Hexane	6.30	0.200	--	22.2	0.705	--		1
1,1,1-Trichloroethane	ND	0.200	--	ND	1.09	--		1
Benzene	0.352	0.200	--	1.12	0.639	--		1
Carbon tetrachloride	ND	0.200	--	ND	1.26	--		1
Cyclohexane	ND	0.200	--	ND	0.688	--		1
1,2-Dichloropropane	ND	0.200	--	ND	0.924	--		1
Bromodichloromethane	ND	0.200	--	ND	1.34	--		1
1,4-Dioxane	ND	0.200	--	ND	0.721	--		1
Trichloroethene	31.4	0.200	--	169	1.07	--		1
2,2,4-Trimethylpentane	0.308	0.200	--	1.44	0.934	--		1
Heptane	0.249	0.200	--	1.02	0.820	--		1
cis-1,3-Dichloropropene	ND	0.200	--	ND	0.908	--		1
4-Methyl-2-pentanone	12.6	0.500	--	51.6	2.05	--		1
trans-1,3-Dichloropropene	ND	0.200	--	ND	0.908	--		1
1,1,2-Trichloroethane	ND	0.200	--	ND	1.09	--		1
Toluene	4.69	0.200	--	17.7	0.754	--		1
2-Hexanone	0.216	0.200	--	0.885	0.820	--		1
Dibromochloromethane	ND	0.200	--	ND	1.70	--		1
1,2-Dibromoethane	ND	0.200	--	ND	1.54	--		1
Tetrachloroethene	10.9	0.200	--	73.9	1.36	--		1
Chlorobenzene	ND	0.200	--	ND	0.921	--		1
Ethylbenzene	0.992	0.200	--	4.31	0.869	--		1

Project Name: MOD-PAC BCP QUARTERLY CARBON
Project Number: 15-017
Lab Number: L2640329
Report Date: 07/02/26

SAMPLE RESULTS

Lab ID: L2640329-01
Client ID: PRE-CARBON(062526)
Sample Location: 1810 ELMWOOD AVE., BUFFALO NY

Date Collected: 06/25/26 12:50
Date Received: 06/25/26
Field Prep: Not Specified

Sample Depth:

Parameter	ppbV Results	ppbV RL	ppbV MDL	ug/m3 Results	ug/m3 RL	ug/m3 MDL	Qualifier	Dilution Factor
Volatile Organics in Air - Mansfield Air Lab								
p/m-Xylene	4.55	0.400	--	19.8	1.74	--		1
Bromoform	ND	0.200	--	ND	2.07	--		1
Styrene	0.707	0.200	--	3.01	0.852	--		1
1,1,2,2-Tetrachloroethane	ND	0.200	--	ND	1.37	--		1
o-Xylene	2.06	0.200	--	8.95	0.869	--		1
4-Ethyltoluene	0.232	0.200	--	1.14	0.983	--		1
1,3,5-Trimethylbenzene	0.416	0.200	--	2.05	0.983	--		1
1,2,4-Trimethylbenzene	1.78	0.200	--	8.75	0.983	--		1
Benzyl chloride	ND	0.200	--	ND	1.04	--		1
1,3-Dichlorobenzene	ND	0.200	--	ND	1.20	--		1
1,4-Dichlorobenzene	ND	0.200	--	ND	1.20	--		1
1,2-Dichlorobenzene	ND	0.200	--	ND	1.20	--		1
1,2,4-Trichlorobenzene	ND	0.200	--	ND	1.48	--		1
Naphthalene	ND	0.190	--	ND	0.996	--		1
Hexachlorobutadiene	ND	0.200	--	ND	2.13	--		1

Internal Standard	% Recovery	Qualifier	Acceptance Criteria
1,4-Difluorobenzene	115		60-140
Bromochloromethane	116		60-140
chlorobenzene-d5	114		60-140

Project Name: MOD-PAC BCP QUARTERLY CARBON
Project Number: 15-017
Lab Number: L2640329
Report Date: 07/02/26

SAMPLE RESULTS

Lab ID: L2640329-02
Client ID: POST-CARBON(062526)
Sample Location: 1810 ELMWOOD AVE., BUFFALO NY

Date Collected: 06/25/26 13:00
Date Received: 06/25/26
Field Prep: Not Specified

Sample Depth:
Matrix: Soil_Vapor
Anaytical Method: 48,TO-15
Analytical Date: 07/01/26 20:39
Analyst: KJD

	ppbV			ug/m3				
Parameter	**Results**	**RL**	**MDL**	**Results**	**RL**	**MDL**	**Qualifier**	**Dilution Factor**
Volatile Organics in Air - Mansfield Air Lab								
Dichlorodifluoromethane	0.426	0.200	--	2.11	0.989	--		1
Chloromethane	0.235	0.200	--	0.485	0.413	--		1
Freon-114	ND	0.200	--	ND	1.40	--		1
Vinyl chloride	ND	0.200	--	ND	0.511	--		1
1,3-Butadiene	ND	0.200	--	ND	0.442	--		1
Bromomethane	ND	0.200	--	ND	0.777	--		1
Chloroethane	ND	0.200	--	ND	0.528	--		1
Ethanol	9.32	5.00	--	17.6	9.42	--		1
Vinyl bromide	ND	0.200	--	ND	0.874	--		1
Acetone	3.99	1.00	--	9.48	2.38	--		1
Trichlorofluoromethane	0.426	0.200	--	2.39	1.12	--		1
Isopropanol	120	1.00	--	295	2.46	--		1
1,1-Dichloroethene	ND	0.200	--	ND	0.793	--		1
Tertiary butyl Alcohol	ND	0.500	--	ND	1.52	--		1
Methylene chloride	ND	0.500	--	ND	1.74	--		1
3-Chloropropene	ND	0.200	--	ND	0.626	--		1
Carbon disulfide	5.04	0.200	--	15.7	0.623	--		1
Freon-113	ND	0.200	--	ND	1.53	--		1
trans-1,2-Dichloroethene	ND	0.200	--	ND	0.793	--		1
1,1-Dichloroethane	ND	0.200	--	ND	0.809	--		1
Methyl tert butyl ether	ND	0.200	--	ND	0.721	--		1
2-Butanone	0.633	0.500	--	1.87	1.47	--		1
cis-1,2-Dichloroethene	ND	0.200	--	ND	0.793	--		1

Project Name: MOD-PAC BCP QUARTERLY CARBON
Project Number: 15-017
Lab Number: L2640329
Report Date: 07/02/26

SAMPLE RESULTS

Lab ID: L2640329-02
Client ID: POST-CARBON(062526)
Sample Location: 1810 ELMWOOD AVE., BUFFALO NY

Date Collected: 06/25/26 13:00
Date Received: 06/25/26
Field Prep: Not Specified

Sample Depth:

Parameter	ppbV Results	ppbV RL	ppbV MDL	ug/m3 Results	ug/m3 RL	ug/m3 MDL	Qualifier	Dilution Factor
Volatile Organics in Air - Mansfield Air Lab								
Ethyl Acetate	40.2	0.500	--	145	1.80	--		1
Chloroform	ND	0.200	--	ND	0.977	--		1
Tetrahydrofuran	ND	0.500	--	ND	1.47	--		1
1,2-Dichloroethane	ND	0.200	--	ND	0.809	--		1
n-Hexane	8.05	0.200	--	28.4	0.705	--		1
1,1,1-Trichloroethane	ND	0.200	--	ND	1.09	--		1
Benzene	ND	0.200	--	ND	0.639	--		1
Carbon tetrachloride	ND	0.200	--	ND	1.26	--		1
Cyclohexane	ND	0.200	--	ND	0.688	--		1
1,2-Dichloropropane	ND	0.200	--	ND	0.924	--		1
Bromodichloromethane	ND	0.200	--	ND	1.34	--		1
1,4-Dioxane	ND	0.200	--	ND	0.721	--		1
Trichloroethene	0.868	0.200	--	4.66	1.07	--		1
2,2,4-Trimethylpentane	ND	0.200	--	ND	0.934	--		1
Heptane	ND	0.200	--	ND	0.820	--		1
cis-1,3-Dichloropropene	ND	0.200	--	ND	0.908	--		1
4-Methyl-2-pentanone	6.29	0.500	--	25.8	2.05	--		1
trans-1,3-Dichloropropene	ND	0.200	--	ND	0.908	--		1
1,1,2-Trichloroethane	ND	0.200	--	ND	1.09	--		1
Toluene	2.27	0.200	--	8.55	0.754	--		1
2-Hexanone	ND	0.200	--	ND	0.820	--		1
Dibromochloromethane	ND	0.200	--	ND	1.70	--		1
1,2-Dibromoethane	ND	0.200	--	ND	1.54	--		1
Tetrachloroethene	5.25	0.200	--	35.6	1.36	--		1
Chlorobenzene	ND	0.200	--	ND	0.921	--		1
Ethylbenzene	0.454	0.200	--	1.97	0.869	--		1

Project Name: MOD-PAC BCP QUARTERLY CARBON
Project Number: 15-017
Lab Number: L2640329
Report Date: 07/02/26

SAMPLE RESULTS

Lab ID: L2640329-02
Client ID: POST-CARBON(062526)
Sample Location: 1810 ELMWOOD AVE., BUFFALO NY

Date Collected: 06/25/26 13:00
Date Received: 06/25/26
Field Prep: Not Specified

Sample Depth:

Parameter	ppbV Results	ppbV RL	ppbV MDL	ug/m3 Results	ug/m3 RL	ug/m3 MDL	Qualifier	Dilution Factor
Volatile Organics in Air - Mansfield Air Lab								
p/m-Xylene	2.32	0.400	--	10.1	1.74	--		1
Bromoform	ND	0.200	--	ND	2.07	--		1
Styrene	ND	0.200	--	ND	0.852	--		1
1,1,2,2-Tetrachloroethane	ND	0.200	--	ND	1.37	--		1
o-Xylene	1.14	0.200	--	4.95	0.869	--		1
4-Ethyltoluene	ND	0.200	--	ND	0.983	--		1
1,3,5-Trimethylbenzene	0.223	0.200	--	1.10	0.983	--		1
1,2,4-Trimethylbenzene	0.949	0.200	--	4.67	0.983	--		1
Benzyl chloride	ND	0.200	--	ND	1.04	--		1
1,3-Dichlorobenzene	ND	0.200	--	ND	1.20	--		1
1,4-Dichlorobenzene	ND	0.200	--	ND	1.20	--		1
1,2-Dichlorobenzene	ND	0.200	--	ND	1.20	--		1
1,2,4-Trichlorobenzene	ND	0.200	--	ND	1.48	--		1
Naphthalene	ND	0.190	--	ND	0.996	--		1
Hexachlorobutadiene	ND	0.200	--	ND	2.13	--		1

Internal Standard	% Recovery	Qualifier	Acceptance Criteria
1,4-Difluorobenzene	100		60-140
Bromochloromethane	94		60-140
chlorobenzene-d5	105		60-140

Project Name: MOD-PAC BCP QUARTERLY CARBON **Lab Number:** L2640329

Project Number: 15-017 **Report Date:** 07/02/26

Method Blank Analysis
Batch Quality Control

Analytical Method: 48,TO-15
Analytical Date: 07/01/26 18:38

Parameter	ppbV Results	ppbV RL	ppbV MDL	ug/m3 Results	ug/m3 RL	ug/m3 MDL	Qualifier	Dilution Factor
Volatile Organics in Air - Mansfield Air Lab for sample(s): 01-02 Batch: WG2236345-4								
Dichlorodifluoromethane	ND	0.200	--	ND	0.989	--		1
Chloromethane	ND	0.200	--	ND	0.413	--		1
Freon-114	ND	0.200	--	ND	1.40	--		1
Vinyl chloride	ND	0.200	--	ND	0.511	--		1
1,3-Butadiene	ND	0.200	--	ND	0.442	--		1
Bromomethane	ND	0.200	--	ND	0.777	--		1
Chloroethane	ND	0.200	--	ND	0.528	--		1
Ethanol	ND	5.00	--	ND	9.42	--		1
Vinyl bromide	ND	0.200	--	ND	0.874	--		1
Acetone	ND	1.00	--	ND	2.38	--		1
Trichlorofluoromethane	ND	0.200	--	ND	1.12	--		1
Isopropanol	ND	1.00	--	ND	2.46	--		1
1,1-Dichloroethene	ND	0.200	--	ND	0.793	--		1
Tertiary butyl Alcohol	ND	0.500	--	ND	1.52	--		1
Methylene chloride	ND	0.500	--	ND	1.74	--		1
3-Chloropropene	ND	0.200	--	ND	0.626	--		1
Carbon disulfide	ND	0.200	--	ND	0.623	--		1
Freon-113	ND	0.200	--	ND	1.53	--		1
trans-1,2-Dichloroethene	ND	0.200	--	ND	0.793	--		1
1,1-Dichloroethane	ND	0.200	--	ND	0.809	--		1
Methyl tert butyl ether	ND	0.200	--	ND	0.721	--		1
2-Butanone	ND	0.500	--	ND	1.47	--		1
cis-1,2-Dichloroethene	ND	0.200	--	ND	0.793	--		1
Ethyl Acetate	ND	0.500	--	ND	1.80	--		1
Chloroform	ND	0.200	--	ND	0.977	--		1

Project Name: MOD-PAC BCP QUARTERLY CARBON **Lab Number:** L2640329

Project Number: 15-017 **Report Date:** 07/02/26

Method Blank Analysis
Batch Quality Control

Analytical Method: 48,TO-15
Analytical Date: 07/01/26 18:38

Parameter	ppbV Results	ppbV RL	ppbV MDL	ug/m3 Results	ug/m3 RL	ug/m3 MDL	Qualifier	Dilution Factor
Volatile Organics in Air - Mansfield Air Lab for sample(s): 01-02 Batch: WG2236345-4								
Tetrahydrofuran	ND	0.500	--	ND	1.47	--		1
1,2-Dichloroethane	ND	0.200	--	ND	0.809	--		1
n-Hexane	ND	0.200	--	ND	0.705	--		1
1,1,1-Trichloroethane	ND	0.200	--	ND	1.09	--		1
Benzene	ND	0.200	--	ND	0.639	--		1
Carbon tetrachloride	ND	0.200	--	ND	1.26	--		1
Cyclohexane	ND	0.200	--	ND	0.688	--		1
1,2-Dichloropropane	ND	0.200	--	ND	0.924	--		1
Bromodichloromethane	ND	0.200	--	ND	1.34	--		1
1,4-Dioxane	ND	0.200	--	ND	0.721	--		1
Trichloroethene	ND	0.200	--	ND	1.07	--		1
2,2,4-Trimethylpentane	ND	0.200	--	ND	0.934	--		1
Heptane	ND	0.200	--	ND	0.820	--		1
cis-1,3-Dichloropropene	ND	0.200	--	ND	0.908	--		1
4-Methyl-2-pentanone	ND	0.500	--	ND	2.05	--		1
trans-1,3-Dichloropropene	ND	0.200	--	ND	0.908	--		1
1,1,2-Trichloroethane	ND	0.200	--	ND	1.09	--		1
Toluene	ND	0.200	--	ND	0.754	--		1
2-Hexanone	ND	0.200	--	ND	0.820	--		1
Dibromochloromethane	ND	0.200	--	ND	1.70	--		1
1,2-Dibromoethane	ND	0.200	--	ND	1.54	--		1
Tetrachloroethene	ND	0.200	--	ND	1.36	--		1
Chlorobenzene	ND	0.200	--	ND	0.921	--		1
Ethylbenzene	ND	0.200	--	ND	0.869	--		1
p/m-Xylene	ND	0.400	--	ND	1.74	--		1

Project Name: MOD-PAC BCP QUARTERLY CARBON
Project Number: 15-017
Lab Number: L2640329
Report Date: 07/02/26

Method Blank Analysis
Batch Quality Control

Analytical Method: 48,TO-15
Analytical Date: 07/01/26 18:38

Parameter	ppbV Results	ppbV RL	ppbV MDL	ug/m3 Results	ug/m3 RL	ug/m3 MDL	Qualifier	Dilution Factor
Volatile Organics in Air - Mansfield Air Lab for sample(s): 01-02 Batch: WG2236345-4								
Bromoform	ND	0.200	--	ND	2.07	--		1
Styrene	ND	0.200	--	ND	0.852	--		1
1,1,2,2-Tetrachloroethane	ND	0.200	--	ND	1.37	--		1
o-Xylene	ND	0.200	--	ND	0.869	--		1
4-Ethyltoluene	ND	0.200	--	ND	0.983	--		1
1,3,5-Trimethylbenzene	ND	0.200	--	ND	0.983	--		1
1,2,4-Trimethylbenzene	ND	0.200	--	ND	0.983	--		1
Benzyl chloride	ND	0.200	--	ND	1.04	--		1
1,3-Dichlorobenzene	ND	0.200	--	ND	1.20	--		1
1,4-Dichlorobenzene	ND	0.200	--	ND	1.20	--		1
1,2-Dichlorobenzene	ND	0.200	--	ND	1.20	--		1
1,2,4-Trichlorobenzene	ND	0.200	--	ND	1.48	--		1
Naphthalene	ND	0.190	--	ND	0.996	--		1
Hexachlorobutadiene	ND	0.200	--	ND	2.13	--		1

Lab Control Sample Analysis
Batch Quality Control

Project Name: MOD-PAC BCP QUARTERLY CARBON
Project Number: 15-017

Lab Number: L2640329
Report Date: 07/02/26

Parameter	LCS %Recovery	Qual	LCSD %Recovery	Qual	%Recovery Limits	RPD	Qual	RPD Limits
Volatile Organics in Air - Mansfield Air Lab	Associated sample(s): 01-02		Batch: WG2236345-3					
Dichlorodifluoromethane	110		-		70-130	-		
Chloromethane	87		-		70-130	-		
Freon-114	98		-		70-130	-		
Vinyl chloride	93		-		70-130	-		
1,3-Butadiene	91		-		70-130	-		
Bromomethane	105		-		70-130	-		
Chloroethane	96		-		70-130	-		
Ethanol	87		-		40-160	-		
Vinyl bromide	102		-		70-130	-		
Acetone	90		-		40-160	-		
Trichlorofluoromethane	108		-		70-130	-		
Isopropanol	88		-		40-160	-		
1,1-Dichloroethene	107		-		70-130	-		
Tertiary butyl Alcohol	82		-		70-130	-		
Methylene chloride	106		-		70-130	-		
3-Chloropropene	103		-		70-130	-		
Carbon disulfide	100		-		70-130	-		
Freon-113	107		-		70-130	-		
trans-1,2-Dichloroethene	100		-		70-130	-		

Lab Control Sample Analysis
Batch Quality Control

Project Name: MOD-PAC BCP QUARTERLY CARBON
Project Number: 15-017

Lab Number: L2640329
Report Date: 07/02/26

Parameter	LCS %Recovery	Qual	LCSD %Recovery	Qual	%Recovery Limits	RPD	Qual	RPD Limits
Volatile Organics in Air - Mansfield Air Lab Associated sample(s): 01-02 Batch: WG2236345-3								
1,1-Dichloroethane	102		-		70-130	-		
Methyl tert butyl ether	100		-		70-130	-		
2-Butanone	99		-		70-130	-		
cis-1,2-Dichloroethene	103		-		70-130	-		
Ethyl Acetate	103		-		70-130	-		
Chloroform	106		-		70-130	-		
Tetrahydrofuran	104		-		70-130	-		
1,2-Dichloroethane	110		-		70-130	-		
n-Hexane	96		-		70-130	-		
1,1,1-Trichloroethane	100		-		70-130	-		
Benzene	95		-		70-130	-		
Carbon tetrachloride	106		-		70-130	-		
Cyclohexane	92		-		70-130	-		
1,2-Dichloropropane	97		-		70-130	-		
Bromodichloromethane	100		-		70-130	-		
1,4-Dioxane	91		-		70-130	-		
Trichloroethene	99		-		70-130	-		
2,2,4-Trimethylpentane	98		-		70-130	-		
Heptane	98		-		70-130	-		

Lab Control Sample Analysis
Batch Quality Control

Project Name: MOD-PAC BCP QUARTERLY CARBON
Project Number: 15-017

Lab Number: L2640329
Report Date: 07/02/26

Parameter	LCS %Recovery	Qual	LCSD %Recovery	Qual	%Recovery Limits	RPD	Qual	RPD Limits
Volatile Organics in Air - Mansfield Air Lab Associated sample(s): 01-02 Batch: WG2236345-3								
cis-1,3-Dichloropropene	116		-		70-130	-		
4-Methyl-2-pentanone	98		-		70-130	-		
trans-1,3-Dichloropropene	101		-		70-130	-		
1,1,2-Trichloroethane	97		-		70-130	-		
Toluene	98		-		70-130	-		
2-Hexanone	100		-		70-130	-		
Dibromochloromethane	102		-		70-130	-		
1,2-Dibromoethane	105		-		70-130	-		
Tetrachloroethene	100		-		70-130	-		
Chlorobenzene	99		-		70-130	-		
Ethylbenzene	99		-		70-130	-		
p/m-Xylene	102		-		70-130	-		
Bromoform	104		-		70-130	-		
Styrene	101		-		70-130	-		
1,1,2,2-Tetrachloroethane	102		-		70-130	-		
o-Xylene	102		-		70-130	-		
4-Ethyltoluene	100		-		70-130	-		
1,3,5-Trimethylbenzene	107		-		70-130	-		
1,2,4-Trimethylbenzene	110		-		70-130	-		

Lab Control Sample Analysis
Batch Quality Control

Project Name: MOD-PAC BCP QUARTERLY CARBON
Project Number: 15-017

Lab Number: L2640329
Report Date: 07/02/26

Parameter	LCS %Recovery	Qual	LCSD %Recovery	Qual	%Recovery Limits	RPD	Qual	RPD Limits
Volatile Organics in Air - Mansfield Air Lab	Associated sample(s): 01-02		Batch: WG2236345-3					
Benzyl chloride	84		-		70-130	-		
1,3-Dichlorobenzene	105		-		70-130	-		
1,4-Dichlorobenzene	106		-		70-130	-		
1,2-Dichlorobenzene	104		-		70-130	-		
1,2,4-Trichlorobenzene	112		-		70-130	-		
Naphthalene	97		-		70-130	-		
Hexachlorobutadiene	110		-		70-130	-		

Project Name: MOD-PAC BCP QUARTERLY CARBON
Project Number: 15-017

Lab Number: L2640329
Report Date: 07/02/26

Sample Receipt and Container Information

Were project specific reporting limits specified? YES

Cooler Information

Cooler	Custody Seal
NA	Absent

Container Information

Container ID	Container Type	Cooler	Initial pH	Final pH	Temp deg C	Pres	Seal	Frozen Date/Time	Analysis(*)
L2640329-01A	Tedlar Bag 5 liter-Polypropylene Fitting	NA	NA			Y	Absent		TO15-LL(30)
L2640329-01X	Canister - 1L (Batch Certified)	NA	NA			Y	Absent		TO15-LL(30)
L2640329-02A	Tedlar Bag 5 liter-Polypropylene Fitting	NA	NA			Y	Absent		TO15-LL(30)
L2640329-02X	Canister - 1L (Batch Certified)	NA	NA			Y	Absent		TO15-LL(30)

*Values in parentheses indicate holding time in days

Project Name:	MOD-PAC BCP QUARTERLY CARBON	**Lab Number:**	L2640329
Project Number:	15-017	**Report Date:**	07/02/26

GLOSSARY

Acronyms

DL	- Detection Limit: This value represents the level to which target analyte concentrations are reported as estimated values, when those target analyte concentrations are quantified below the limit of quantitation (LOQ). The DL includes any adjustments from dilutions, concentrations or moisture content, where applicable. (DoD report formats only.)
EDL	- Estimated Detection Limit: This value represents the level to which target analyte concentrations are reported as estimated values, when those target analyte concentrations are quantified below the reporting limit (RL). The EDL includes any adjustments from dilutions, concentrations or moisture content, where applicable. The use of EDLs is specific to the analysis of PAHs using Solid-Phase Microextraction (SPME).
EMPC	- Estimated Maximum Possible Concentration: The concentration that results from the signal present at the retention time of an analyte when the ions meet all of the identification criteria except the ion abundance ratio criteria. An EMPC is a worst-case estimate of the concentration.
EPA	- Environmental Protection Agency.
LCS	- Laboratory Control Sample: A sample matrix, free from the analytes of interest, spiked with verified known amounts of analytes or a material containing known and verified amounts of analytes.
LCSD	- Laboratory Control Sample Duplicate: Refer to LCS.
LFB	- Laboratory Fortified Blank: A sample matrix, free from the analytes of interest, spiked with verified known amounts of analytes or a material containing known and verified amounts of analytes.
LOD	- Limit of Detection: This value represents the level to which a target analyte can reliably be detected for a specific analyte in a specific matrix by a specific method. The LOD includes any adjustments from dilutions, concentrations or moisture content, where applicable. (DoD report formats only.)
LOQ	- Limit of Quantitation: The value at which an instrument can accurately measure an analyte at a specific concentration. The LOQ includes any adjustments from dilutions, concentrations or moisture content, where applicable. (DoD report formats only.) Limit of Quantitation: The value at which an instrument can accurately measure an analyte at a specific concentration. The LOQ includes any adjustments from dilutions, concentrations or moisture content, where applicable. (DoD report formats only.)
MDL	- Method Detection Limit: This value represents the level to which target analyte concentrations are reported as estimated values, when those target analyte concentrations are quantified below the reporting limit (RL). The MDL includes any adjustments from dilutions, concentrations or moisture content, where applicable.
MS	- Matrix Spike Sample: A sample prepared by adding a known mass of target analyte to a specified amount of matrix sample for which an independent estimate of target analyte concentration is available. For Method 332.0, the spike recovery is calculated using the native concentration, including estimated values.
MSD	- Matrix Spike Sample Duplicate: Refer to MS.
NA	- Not Applicable.
NC	- Not Calculated: Term is utilized when one or more of the results utilized in the calculation are non-detect at the parameter's reporting unit.
NDPA/DPA	- N-Nitrosodiphenylamine/Diphenylamine.
NI	- Not Ignitable.
NP	- Non-Plastic: Term is utilized for the analysis of Atterberg Limits in soil.
NR	- No Results: Term is utilized when 'No Target Compounds Requested' is reported for the analysis of Volatile or Semivolatile Organic TIC only requests.
RL	- Reporting Limit: The value at which an instrument can accurately measure an analyte at a specific concentration. The RL includes any adjustments from dilutions, concentrations or moisture content, where applicable.
RPD	- Relative Percent Difference: The results from matrix and/or matrix spike duplicates are primarily designed to assess the precision of analytical results in a given matrix and are expressed as relative percent difference (RPD). Values which are less than five times the reporting limit for any individual parameter are evaluated by utilizing the absolute difference between the values; although the RPD value will be provided in the report.
SRM	- Standard Reference Material: A reference sample of a known or certified value that is of the same or similar matrix as the associated field samples.
STLP	- Semi-dynamic Tank Leaching Procedure per EPA Method 1315.
TEF	- Toxic Equivalency Factors: The values assigned to each dioxin and furan to evaluate their toxicity relative to 2,3,7,8-TCDD.
TEQ	- Toxic Equivalent: The measure of a sample's toxicity derived by multiplying each dioxin and furan by its corresponding TEF and then summing the resulting values.
TIC	- Tentatively Identified Compound: A compound that has been identified to be present and is not part of the target compound list (TCL) for the method and/or program. All TICs are qualitatively identified and reported as estimated concentrations.

Report Format: Data Usability Report

Project Name:	MOD-PAC BCP QUARTERLY CARBON	**Lab Number:**	L2640329
Project Number:	15-017	**Report Date:**	07/02/26

Footnotes

1 - The reference for this analyte should be considered modified since this analyte is absent from the target analyte list of the original method.

Terms

Analytical Method: Both the document from which the method originates and the analytical reference method. (Example: EPA 8260B is shown as 1,8260B.) The codes for the reference method documents are provided in the References section of the Addendum.

Chlordane: The target compound Chlordane (CAS No. 57-74-9) is reported for GC ECD analyses. Per EPA,this compound "refers to a mixture of chlordane isomers, other chlorinated hydrocarbons and numerous other components." (Reference: USEPA Toxicological Review of Chlordane, In Support of Summary Information on the Integrated Risk Information System (IRIS), December 1997.)

Difference: With respect to Total Oxidizable Precursor (TOP) Assay analysis, the difference is defined as the Post-Treatment value minus the Pre-Treatment value.

Final pH: As it pertains to Sample Receipt & Container Information section of the report, Final pH reflects pH of container determined after adjustment at the laboratory, if applicable. If no adjustment required, value reflects Initial pH.

Frozen Date/Time: With respect to Volatile Organics in soil, Frozen Date/Time reflects the date/time at which associated Reagent Water-preserved vials were initially frozen. Note: If frozen date/time is beyond 48 hours from sample collection, value will be reflected in 'bold'.

Gasoline Range Organics (GRO): Gasoline Range Organics (GRO) results include all chromatographic peaks eluting from Methyl tert butyl ether through Naphthalene, with the exception of GRO analysis in support of State of Ohio programs, which includes all chromatographic peaks eluting from Hexane through Dodecane.

Initial pH: As it pertains to Sample Receipt & Container Information section of the report, Initial pH reflects pH of container determined upon receipt, if applicable.

PAH Total: With respect to Alkylated PAH analyses, the 'PAHs, Total' result is defined as the summation of results for all or a subset of the following compounds: Naphthalene, C1-C4 Naphthalenes, 2-Methylnaphthalene, 1-Methylnaphthalene, Biphenyl, Acenaphthylene, Acenaphthene, Fluorene, C1-C3 Fluorenes, Phenanthrene, C1-C4 Phenanthrenes/Anthracenes, Anthracene, Fluoranthene, Pyrene, C1-C4 Fluoranthenes/Pyrenes, Benz(a)anthracene, Chrysene, C1-C4 Chrysenes, Benzo(b)fluoranthene, Benzo(j)+(k)fluoranthene, Benzo(e)pyrene, Benzo(a)pyrene, Perylene, Indeno(1,2,3-cd)pyrene, Dibenz(ah)+(ac)anthracene, Benzo(g,h,i)perylene. If a 'Total' result is requested, the results of its individual components will also be reported.

PFAS Total: With respect to PFAS analyses, the 'PFAS, Total (5)' result is defined as the summation of results for: PFHpA, PFHxS, PFOA, PFNA and PFOS. In addition, the 'PFAS, Total (6)' result is defined as the summation of results for: PFHpA, PFHxS, PFOA, PFNA, PFDA and PFOS. For MassDEP DW compliance analysis only, the 'PFAS, Total (6)' result is defined as the summation of results at or above the RL. Note: If a 'Total' result is requested, the results of its individual components will also be reported.

Total: With respect to Organic analyses, a 'Total' result is defined as the summation of results for individual isomers or Aroclors. If a 'Total' result is requested, the results of its individual components will also be reported. This is applicable to 'Total' results for methods 8260, 8081 and 8082.

Data Qualifiers

A - Spectra identified as "Aldol Condensates" are byproducts of the extraction/concentration procedures when acetone is introduced in the process.

B - The analyte was detected above the reporting limit in the associated method blank. Flag only applies to associated field samples that have detectable concentrations of the analyte at less than ten times (10x) the concentration found in the blank. For MCP-related projects, flag only applies to associated field samples that have detectable concentrations of the analyte at less than ten times (10x) the concentration found in the blank. For DOD-related projects, flag only applies to associated field samples that have detectable concentrations of the analyte at less than ten times (10x) the concentration found in the blank AND the analyte was detected above one-half the reporting limit (or above the reporting limit for common lab contaminants) in the associated method blank. For NJ-Air-related projects, flag only applies to associated field samples that have detectable concentrations of the analyte above the reporting limit. For NJ-related projects (excluding Air), flag only applies to associated field samples that have detectable concentrations of the analyte, which was detected above the reporting limit in the associated method blank or above five times the reporting limit for common lab contaminants (Phthalates, Acetone, Methylene Chloride, 2-Butanone).

C - Co-elution: The target analyte co-elutes with a known lab standard (i.e. surrogate, internal standards, etc.) for co-extracted analyses.

D - Concentration of analyte was quantified from diluted analysis. Flag only applies to field samples that have detectable concentrations of the analyte.

E - Concentration of analyte exceeds the range of the calibration curve and/or linear range of the instrument.

F - The ratio of quantifier ion response to qualifier ion response falls outside of the laboratory criteria. Results are considered to be an estimated maximum concentration.

G - The concentration may be biased high due to matrix interferences (i.e, co-elution) with non-target compound(s). The result should be considered estimated.

H - The analysis of pH was performed beyond the regulatory-required holding time of 15 minutes from the time of sample collection.

I - The lower value for the two columns has been reported due to obvious interference.

J - Estimated value. This represents an estimated concentration for Tentatively Identified Compounds (TICs).

M - Reporting Limit (RL) exceeds the MCP CAM Reporting Limit for this analyte.

Report Format: Data Usability Report

Project Name:	MOD-PAC BCP QUARTERLY CARBON	**Lab Number:**	L2640329
Project Number:	15-017	**Report Date:**	07/02/26

Data Qualifiers

ND - Not detected at the reporting limit (RL) for the sample.

NJ - Presumptive evidence of compound. This represents an estimated concentration for Tentatively Identified Compounds (TICs), where the identification is based on a mass spectral library search.

P - The RPD between the results for the two columns exceeds the method-specified criteria.

Q - The quality control sample exceeds the associated acceptance criteria. For DOD-related projects, LCS and/or Continuing Calibration Standard exceedences are also qualified on all associated sample results. Note: This flag is not applicable for matrix spike recoveries when the sample concentration is greater than 4x the spike added or for batch duplicate RPD when the sample concentrations are less than 5x the RL. (Metals only.)

R - Analytical results are from sample re-analysis.

RE - Analytical results are from sample re-extraction.

S - Analytical results are from modified screening analysis.

V - The surrogate associated with this target analyte has a recovery outside the QC acceptance limits. (Applicable to MassDEP DW Compliance samples only.)

Z - The batch matrix spike and/or duplicate associated with this target analyte has a recovery/RPD outside the QC acceptance limits. (Applicable to MassDEP DW Compliance samples only.)

Project Name: MOD-PAC BCP QUARTERLY CARBON **Lab Number:** L2640329

Project Number: 15-017 **Report Date:** 07/02/26

REFERENCES

48 Compendium of Methods for the Determination of Toxic Organic Compounds in Ambient Air. Second Edition. EPA/625/R-96/010b, January 1999.

LIMITATION OF LIABILITIES

Pace Analytical Services performs services with reasonable care and diligence normal to the analytical testing laboratory industry. In the event of an error, the sole and exclusive responsibility of Pace Analytical Services shall be to re-perform the work at it's own expense. In no event shall Pace Analytical Services be held liable for any incidental, consequential or special damages, including but not limited to, damages in any way connected with the use of, interpretation of, information or analysis provided by Pace Analytical Services.

We strongly urge our clients to comply with EPA protocol regarding sample volume, preservation, cooling, containers, sampling procedures, holding time and splitting of samples in the field.

ENV-FORM-WES2-0065 v03 Certificate/Approval Program Summary

Certification Information

The following analytes are not included in our Primary NELAP Scope of Accreditation:

PAS-WES2 Westborough Facility – 8 Walkup Dr. Westborough, MA 01581
EPA 8260D: NPW: 1,2,4,5-Tetramethylbenzene; 4-Ethyltoluene; SCM: Iodomethane (methyl iodide), 1,2,4,5-Tetramethylbenzene; 4-Ethyltoluene.
EPA 8270E: NPW: Dimethylnaphthalene,1,4-Diphenylhydrazine, alpha-Terpineol, Azobenzene; SCM: Dimethylnaphthalene,1,4-Diphenylhydrazine.
SM4500: NPW: Amenable Cyanide; SCM: Total Phosphorus, TKN, NO2, NO3.

PAS-MANS Mansfield Facility – 320 Forbes Blvd. Mansfield, MA 02048
SM 2540D: TSS.
Biological Tissue Matrix: EPA 3050B

PAS-MAN1 Mansfield Facility – 120 Forbes Blvd. Mansfield, MA 02048
EPA TO-15: Halothane, 2,4,4-Trimethyl-2-pentene, 2,4,4-Trimethyl-1-pentene, Thiophene, 2-Methylthiophene, 3-Methylthiophene, 2-Ethylthiophene, 1,2,3-Trimethylbenzene, Indan, Indene, 1,2,4,5-Tetramethylbenzene, Benzothiophene, 1-Methylnaphthalene.
MADEP-APH.

PAS-ELON East Longmeadow Facility – 39 Spruce Street East Longmeadow, MA 01028
EPA 524.2: 1,3,5-Trichlorobenzene, m/p-Xylene, o-xylene.
EPA 625.1: 1,2-Dichlorobenzene, 1,3-Dichlorobenzene, 1,4-Dichlorobenzene, N-Nitrosodiphenylamine.
EPA 8081B NPW and SCM: Alachlor, Endrin Ketone, Hexachlorobenzene.
EPA 8260D NPW: Tetrahydrofuran, 1,3,5-Trichlorobenzene; **SCM:** TAME, TBEE, Diethyl ether, DIPE, Tetrahydrofuran. 1,3,5-Trichlorobenzene, Freon-113.
EPA 8270E: NPW: Carbazole, 1-Methylnaphthalene, Pentachloronitrobenzene; **SCM:** Carbazole, 1-Methylnaphthalene.
EPA TO-13: Air: Benzo(e)pyrene, 1-Methylnaphthalene, 2-Methylnaphthalene, Perylene.
EPA TO-4A Pesticide Air: delta-BHC, Endosulfan I, Endosulfan II, Endosulfan Sulfate, Endrin, Endrin Aldehyde, Endrin Ketone, Hexachlorobenzene, Methoxychlor.
SM4500: NPW: Amenable Cyanide; **SCM:** Total Phosphorus, TKN, NH3, NECi: NO2, NO3, ASTMD516.

The following test method is not included in our New Jersey Secondary NELAP Scope of Accreditation:

PAS-MANS Mansfield Facility – 320 Forbes Blvd. Mansfield, MA 02048
Determination of Selected Perfluorinated Alkyl Substances by Solid Phase Extraction and Liquid Chromatography/Tandem Mass Spectrometry Isotope Dilution (via Alpha SOP 23528)

The following analytes are included in our Massachusetts DEP Scope of Accreditation:

PAS-WES2 Westborough Facility – 8 Walkup Dr. Westborough, MA 01581

Drinking Water
EPA 300.0: Chloride, Nitrate-N, Fluoride, Sulfate; **EPA 353.2**: Nitrate-N, Nitrite-N; **SM4500NO3-F**: Nitrate-N, Nitrite-N; **SM4500F-C, SM4500CN-CE, EPA 180.1, SM2130B, SM4500Cl-D, SM2320B, SM2540C, SM4500H-B, SM4500NO2-B**
EPA 504.1: EDB, DBCP.
Microbiology: **SM9215B; SM9223-P/A, SM9223B-Colilert-QT,**.

Non-Potable Water
SM4500H,B, EPA 120.1, SM2510B, SM2540C, SM2320B, SM4500CL-E, SM4500F-BC, SM4500NH3-BH: Ammonia-N and Kjeldahl-N, **EPA 350.1**: Ammonia-N, **LACHAT 10-107-06-1-B**: Ammonia-N, **EPA 351.1, SM4500NO3-F, EPA 353.2**: Nitrate-N, **SM4500P-E, SM4500P-B, E, SM4500SO4-E, SM5220D, EPA 410.4, SM5210B, SM4500CL-G, EPA 1664, EPA 420.1, SM4500-CN-CE, SM2540D, EPA 300: Chloride, Sulfate, Nitrate.**
Microbiology: **SM9223B-Colilert-QT; Enterolert-QT.**

PAS-MANS Mansfield Facility – 320 Forbes Blvd. Mansfield, MA 02048

Drinking Water
EPA 200.7: Al, Ba, Cd, Cr, Cu, Fe, Mn, Ni, Na, Ag, Ca, Zn. **EPA 200.8:** Al, Sb, As, Ba, Be, Cd, Cr, Cu, Pb, Mn, Ni, Se, Ag, TL, Zn. **EPA 245.1** Hg.
EPA 522, EPA 537.1.

Non-Potable Water
EPA 200.7: Al, Sb, As, Be, Cd, Ca, Cr, Co, Cu, Fe, Pb, Mg, Mn, Mo, Ni, K, Se, Ag, Na, Sr, TL, Ti, V, Zn.
EPA 200.8: Al, Sb, As, Be, Cd, Ca, Cr, Cu, Fe, Pb, Mg, Mn, Ni, K, Se, Ag, Na, TL, Zn.
EPA 245.1: Hg. **EPA 245.7:** Hg.
SM2340B

ENV-FORM-WES2-0065 v03 Certificate/Approval Program Summary

PAS-ELON East Longmeadow Facility – 39 Spruce Street East Longmeadow, MA 01028

Drinking Water
EPA 300.0: NO3, NO2, Fl, Cl, SO4. **NECI Reductase**: NO3, NO2.
SM4500F-C, SM4500Cl-B, SM4500CN-C,E, EPA 180.1, SM2320B, SM 2540C, SM4500H-B, SM4500SO4-E.
EPA 537.1; EPA 524.2: THMs and VOCs; **EPA 504.1:** EDB, DBCP.
Microbiology: SM9223-P/A: TC/EC; SM9223B-Colilert-enumeration: TC/EC; HPC-Simplate.

Non-Potable Water
SM4500H-B, SM2510B, SM2540C, SM2320B, SM4500Cl-B, SM4500NH3-B, C, EPA 350.1, NECi: NO3, **SM4500NH3-B, C: TKN, SM4500P-E: Ortho Phosphate, SM4500P-B, E: Total Phosphorus, EPA 410.4, SM5210B, SM5310C, SM4500CN-C, E, SM2540D, SM4500Cl-G, SM4500SO4-E, EPA 1664, EPA 420.1, EPA 300.0:** Cl, SO4, NO3.
EPA 624.1: Volatile Halocarbons, Volatile Aromatics.
EPA 608.3: Chlordane, Toxaphene, Aldrin, Alpha-BHC, Beta-BHC, Gamma-BHC, Delta-BHC, Dieldrin, DDD, DDE, DDT, Endosulfan I, Endosulfan II, Endosulfan Sulfate, Endrin, Endrin Aldehyde, Heptachlor, Heptachlor Epoxide, PCBs.
EPA 625.1: SVOC-Acid Extractables and Base/Neutrals
Microbiology: SM9223B-Colilert: E. coli (Ambient and Wastewater), **SM9223B-Colilert-18:** Fecal Coliform (Wastewater).

Certification IDs:

PAS-WES2 Westborough Facility – 8 Walkup Dr. Westborough, MA 01581
CT PH-0826, IL 200077, IN C-MA-03, KY KY98045, ME MA00086, MD 348, MA M-MA086, NH 2064, NJ MA935, NY 11148, NC (NPW/SCM) 666, OR MA-1316, PA 68-03671, RI LAO00065, TX T104704476, VT VT-0935, VA 460195.

PAS-MANS Mansfield Facility – 320 Forbes Blvd. Mansfield, MA 02048
ANAB/DoD L2474, CA 3117, CO MA00030, CT PH-0825, IL 200081, IN C-MA-04, KY KY98046, LA 85084, ME MA00030, MD 350, MA M-MA00030, MI 9110, MN 025-999-495, NV MA00030, NH 2062, NJ MA015, NY 11627, NC (NPW/SCM) 685, OR MA-0262, PA 68-02089, RI LAO00299, TX T-104704419, UT MA00030, VT VT-0015, VA 460194, WA C954.

PAS-MAN1 Mansfield Air Lab Facility – 120 Forbes Blvd. Mansfield, MA 02048
ANAB/DoD L2474, LA 245052, ME MA01156, MN 025-999-498, NH 2249, NJ MA025, NY 12191, OR 4203, TX T104704583, VA 460311, WA C1104.

PAS-ELON East Longmeadow Facility – 39 Spruce St. East Longmeadow, MA 01028
CT PH-0821, ME MA00100, MI 9100, NC (DENR) 652, NC (DW) 25703, MA M-MA100, NH (Secondary) 2516, NH (Primary) 2557, NJ MA007, NY 10899, PA 68-05812, RI LAO00373, VA 460217, VT-255716, WV DEP 419, WV-DW 9979C, LA 05130, LA-DW LA042, MD-DW 373, OH 87781.

For a complete listing of analytes and methods, please contact your Project Manager.

AIR ANALYSIS

CHAIN OF CUSTODY

PAGE 1 OF 1

ALPHA ANALYTICAL

320 Forbes Blvd, Mansfield, MA 02048
TEL: 508-822-9300 FAX: 508-822-3288

Client Information

Client: Martix Environmental Technologies
Address: 3730 California Road
Orchard Park, New York 14127
Phone: 716-662-0745
Fax:
Email: mszustak@matrixbiotech.com

☐ These samples have been Previously analyzed by Alpha

Project Information

Project Name: MOD-PAC BCP Quarterly Carbon
Project Location: 1801 Elmwood Ave., Buffalo, NY
Project #: 15-017
Project Manager: M. Deyo
ALPHA Quote #:

Turn-Around-Time

☒ Standard ☐ Rush (only confirmed if pre-approved)

Date Due: Time:

Other Project Specific Requirements/Comments:
☐ Project-Specific Target Compound List
Please CC results to CCurtis@matrixbiotech.com

Date Rec'd in Lab: 6/26/26

ALPHA Job #: L2641329

Report/Data Deliverables Information

☐ FAX ☒ EMAIL
☒ ADEx ☐ Add'l Deliverables

Billing Information

☒ Same as Client info PO #: 15-017

Regulatory Requirements/Report Limits

State/Fed	Program	Residential/Commercial
NYSDOH		Commercial

Analysis

All Columns Below Must Be Filled Out

Alpha Lab Use Only	Sample ID	Collection: End Date	Start Time	End Time	Initial Vac	Final Vac	Sample Matrix*	Sampler Initials	Can Size	ID Can	ID Flow Controller	TO-15	TO-15 SIM	Subtract non-petroleum HCs APH ☐	FIXED GASES	Sulfides & Mercaptans by TO-15			Sample Specific Comments (i.e. PID)
41329-01	Pre-Carbon	6/25/26	12:50	12:50			SV	MM				☒	☐	☐	☐	☐	☐	☐	
-02	Post-Carbon	↓	1:00	1:00			SV	MM				☒	☐	☐	☐	☐	☐	☐	
												☒	☐	☐	☐	☐	☐	☐	
												☐	☐	☐	☐	☐	☐	☐	
												☐	☐	☐	☐	☐	☐	☐	
												☐	☐	☐	☐	☐	☐	☐	
							Container Type					-	-	-	-	-	-	-	

SAMPLE MATRIX CODES:
AA = Ambient Air (Indoor/Outdoor)
SV = Soil Vapor/Landfill Gas/SVE
Other = Please Specify

Relinquished By	Date/Time	Received By:	Date/Time
Mitch Marraw	6/25/26 1700	R. Bisby	6-25-26 1595
BUFF S/C	6-25-26 1700	NORTHW	6-25-26 16:00
NORTHW	6-25-26 19:30	Kate	6-25 2330
Kate	6/26 3:00	AL	6-26 0430
AL 6-26 0530	Kelly Curtis	6/26/26	0530

Please print clearly & legibly and completely. Samples cannot be logged in and turn around time clock will not start until any ambiguities are resolved. All samples submitted are subject to Alpha's Payment Terms.

Form 101-02 (I) Rev: 28-Sept-15

Sample Delivery Group Summary

Pace Job Number : L2640329
Received : 25-JUN-2026
Reviewer : Christopher J Anderson

Account Name : Matrix Environmental Technologies
Project Number : 15-017
Project Name : MOD-PAC BCP QUARTERLY CARBON

Delivery Information

Samples Delivered By : Pace Courier

Chain of Custody : Present

Cooler Information

Cooler	Seal/Seal#	Preservation	Temperature(°C)	Additional Information
NA	Absent/			

Condition Information

1) All samples on COC received?	**YES**
2) Extra samples received?	**NO**
3) Are there any sample container discrepancies?	**NO**
4) Are there any discrepancies between COC & sample labels?	**NO**
5) Are samples in appropriate containers for requested analysis?	**YES**
6) Are samples properly preserved for requested analysis?	**YES**
7) Are samples within holding time for requested analysis?	**YES**
8) All sampling equipment returned?	**YES**

Volatile Organics/VPH

1) Reagent Water Vials Frozen by Client?	**NA**