

March 25, 2013

Phone 716.551.6281
Fax 716.551.6282
www.labellapc.com

210 Walnut Street, LLC
C/O Mr. Chuck Bell
Greater Lockport Development Corporation
One Locks Plaza
Lockport, New York 14094

Re: Limited Vapor Intrusion Assessment
Harrison Place, Building No. 4 – 210 Walnut Street, Lockport, New York
LaBella Project Number: 213235

Dear Mr. Bell:

LaBella Associates, P.C. (“LaBella”) is pleased to submit this report that summarizes the results of a Limited Vapor Intrusion Assessment (VIA) at the property located at 210 Walnut Street, Building No. 4, City of Lockport, Niagara County, New York, hereinafter referred to as the “Site.”

Background

LaBella recently completed a Phase I Environmental Site Assessment (ESA) of the Site that identified Recognized Environmental Conditions (RECs) associated with the presence of residual subsurface contamination at the Site. Elevated concentrations of chlorinated solvents reportedly remain within groundwater beneath the Site, indicating the potential for soil vapor intrusion into the Site Building (Building No. 4). Furthermore, a letter from the NYSDEC, dated February 25, 2011, recommended that the Site Building be evaluated for vapor intrusion prior to a change in occupancy such as residential or commercial use. Based upon the planned renovation of the Site Building for future commercial use, the need for further assessment of the Site Building for vapor intrusion was identified.

Field Investigation Summary

This section provides a summary of the fieldwork completed as part of this Limited VIA, which included the following:

- The installation of six sub-slab vapor points;
- The collection and laboratory analysis of six sub-slab vapor samples, six ambient indoor air samples and one outdoor ambient air sample for chemicals of concern; and,
- Documentation of building and Site-specific conditions related to the investigation. Refer to Appendix B for such.

Limited Vapor Intrusion Assessment

The sub-slab soil vapor sampling consisted of installing six (6) sub-slab vapor locations in a grid pattern within the Site building. Each sub-slab sample had a corresponding ambient indoor air sample. In addition, one (1) outdoor air sample was collected for a total of thirteen samples. The outdoor air sample was collected immediately to the south of the Site building. Refer to Figure 1 for sampling locations.

The sub-slab sampling points were constructed by drilling an approximate 1-inch diameter hole through the building's slab using a rotary hammer drill to a depth of approximately 2 inches below the bottom of the slab. Sub-slab vapor probes were constructed utilizing 1/4-inch outside diameter polyethylene tubing. The tubing inlets were placed at approximately 2 inches below the bottom of the concrete and the tubing extended up the center of the boreholes to approximately two feet above the floor surface. The annulus surrounding the tubing near the floor surface was sealed with modeling clay.

Tracer gas (helium) was placed over each sub-slab vapor sample location prior to sampling to ensure that ambient air was not being pulled into the Summa® canisters during sampling. This was accomplished by placing a small, clean, stainless steel enclosure over the sub-slab sampling points. An air-tight seal was placed on the floor surface around the edge of the enclosure where it contacted the floor. Prior to purging or sampling activities, a helium tracer gas was released via a small diameter tube through a port to the exterior side of the enclosure. The sub-slab vapor polyethylene tubing extended up through the air-tight seals to the exterior side of the enclosure and was connected to a helium detector to determine the presence of helium gas. The sampling points were then purged. Helium was not detected, indicating the sub-slab sampling points had been successfully sealed off from ambient air.

Subsequent to purging the sub-slab sampling points, Summa® canisters were connected to the polyethylene tubing to collect the sub-slab vapor samples. The sub-slab samples were designated "1-SS" through "6-SS". Six ambient indoor air samples (designated "1-Indoor" through "6-Indoor") and one ambient outdoor air sample (designated "Outdoor") were collected concurrently with the sub-slab vapor samples.

The thirteen samples were collected utilizing individually certified, clean, one-liter Summa® canisters equipped with laboratory calibrated flow controllers. The samples were collected over a four-hour time period. The indoor air samples were collected at a height of approximately three to five feet above the floor to simulate the breathing zone. Immediately after opening each Summa® canister, the initial vacuum (inches of mercury) and time was noted and recorded on the laboratory chain-of-custody. After four hours, final vacuum readings (inches of mercury) were noted and the Summa® canisters were closed. It should be noted that an apparent faulty flow controller lead to the termination of sample collection at sample "1-Indoor". Upon discovery of the equipment failure, a second indoor air sample was setup to replace the initial "1-Indoor" sample. This second sample was designated "1-Indoor (2)" and was collected over a 2.5 hour time period. Refer to Table 1 for point-specific sampling information.

The sub-slab vapor samples and ambient indoor and outdoor samples were submitted to Centek Laboratories in Syracuse, New York for VOC analysis by United States Environmental Protection Agency (USEPA) Method TO-15. A copy of the laboratory report is included as Appendix A.

Field Conditions

It should be noted that the Site Building was undergoing interior demolition and renovation at the time of this Limited VIA. Although no demolition or renovation activities were occurring on the ground floor at the time of sample collection, the building envelope was not fully sealed and there was no heating, ventilation and air conditioning (HVAC) system in operation. Several openings in the building envelope, including broken windows and former exhaust fan portals, were evident and had been sealed with polyethylene sheeting and adhesive tape the day prior to the sampling event.

Results and Conclusions

Analytical laboratory results indicate that a number of VOCs, some of which have previously been identified in groundwater at the Site, were detected in both sub-slab vapor and indoor air samples. However, as reflected by Table 2:

- Only one VOC, Trichloroethene, was detected in one sub-slab soil vapor sample (4-SS) at a concentration above the New York State Department of Health (NYSDOH) recommended minimum action level for sub-slab vapor. Trichloroethene was detected at a concentration of 16 ug/m³ in sample 4-SS; the NYSDOH minimum action level for this compound is 5 ug/m³.
- Trichloroethene was not detected above the laboratory method detection limit (MDLs) in any of the indoor air samples or the outdoor air sample. As indicated in the laboratory analytical report, the laboratory MDL for Trichloroethene is 0.22 ug/m³.
- VOCs were either not detected above their respective laboratory MDLs or not detected above the appropriate NYSDOH guidance values and/or minimum action levels in all indoor air samples as well as the outdoor air sample.

Trichloroethene is a chlorinated solvent that has previously been identified in groundwater located in bedrock beneath the Site building at concentrations exceeding groundwater standards. The presence of this compound as well as other chlorinated solvents and petroleum-related compounds in groundwater at the Site appears to be due to the historical utilization of these substances for industrial operations at the Site. Based upon this information, it is likely that the Trichloroethene identified in sample 4-SS is emanating from a subsurface source. The presence of Trichloroethene in the sub-slab soil vapor at sample point 4-SS at a concentration that exceeds NYSDOH sub-slab vapor action levels indicates the potential for vapor intrusion into the Site building. However, Trichloroethene was not detected in the indoor air samples, indicating that the intrusion of this compound into the Site building's ambient air was not occurring at the time of the sampling.

New York State does not currently have any standards, criteria or guidance values for the concentration of compounds in soil vapor. However, the NYSDOH has published decision matrices intended to provide guidance on a case-by-case basis for actions that should be taken to address current and potential exposures related to soil vapor intrusion in *Guidance for Evaluating Soil Vapor Intrusion in the State of New York* (2006). The decision matrix that pertains to Trichloroethene was reviewed relative to the levels of this compound that were detected in sub-slab vapor sample 4-SS and indicates that no further action is required. However, the decision matrix is generic and NYSDOH notes that it may be appropriate to modify a recommended action to accommodate building-specific conditions. Since the building envelope was not fully sealed and the HVAC system was not in operation at the time of sample collection, it is recommended that additional indoor air monitoring be conducted once the ambient indoor air conditions

Mr. Chuck Bell
210 Walnut Street, LLC

March 25, 2013
Page 4

within the building become representative of those to which persons occupying the building will be exposed. That is, once the building envelope has been sealed and the HVAC system is in normal operation, monitoring should be conducted to verify that the intrusion of Trichloroethene vapors is not occurring.

Should you have any questions or comments concerning the results or recommendations presented herein, please do not hesitate to contact me at (716) 551-6283 or by e-mail at rnapieralski@labellapc.com.

Very truly yours,

LABELLA ASSOCIATES, P.C.



Robert R. Napieralski, C.P.G.
Buffalo Regional Manager

RRN/rn

I:\LOCKPORT, CITY OF\213235\213235 VIA REPORT 02.27.13.DOC

LaBELLA

LaBella Associates, P.C.

300 State Street

Rochester, New York 14614

Figure and Tables



PROJECT DRAWING NUMBER [213235] [FIGURE 1]	DRAWING TITLE SITE PLAN <table border="1"><tr><td>ISSUED FOR</td><td>DESIGNED BY: JMG</td></tr><tr><td>FINAL</td><td>DRAWN BY: JMG</td></tr><tr><td>DATE: 02/21/2013</td><td>REVIEWED BY: JMG</td></tr></table>	ISSUED FOR	DESIGNED BY: JMG	FINAL	DRAWN BY: JMG	DATE: 02/21/2013	REVIEWED BY: JMG	PROJECT CLIENT Limited Vapor Intrusion Assessment 210 Walnut Street Lockport, New York 14094	Engineering Architecture Environmental Planning Associates, P.C. 0 25 50 100 150 Feet 1 inch = 75 feet OLYMPIC TOWERS 300 PEARL STREET SUITE 325 BUFFALO, NY 14202 P: (716) 551-6281 F: (716) 551-6282 www.labelapc.com COPYRIGHT 2003
ISSUED FOR	DESIGNED BY: JMG								
FINAL	DRAWN BY: JMG								
DATE: 02/21/2013	REVIEWED BY: JMG								

Table 1
Limited Vapor Intrusion Assessment
Harrison Place, Building No. 4, 210 Walnut Street, Lockport, New York
Summary of SUMMA Canister Investigation

Sample ID	1-SS	1-Indoor (1)	1-Indoor (2)	2-SS	2-Indoor	3-SS	3-Indoor	4-SS	4-Indoor	5-SS	5-Indoor	6-SS	6-Indoor	Outdoor
Location	Northeastern Portion of Building	Northeastern Portion of Building*	Northeastern Portion of Building	North-Central Portion of Building	North-Central Portion of Building	Northwestern Portion of Building	Northwestern Portion of Building	Southwestern Portion of Building	Southwestern Portion of Building	South-Central Portion of Building	South-Central Portion of Building	Southeastern Portion of Building	Southeastern Portion of Building	Southern Exterior of Building
Canister Number	1184	1195	248	192	320	419	370	275	411	159	355	95	365	567
Regulator Number	175	293	1125	1159	268	1153	143	295	156	300	272	266	253	304
Start Time	11:05	11:07	12:50	11:39	11:40	11:52	11:55	12:07	12:09	12:20	12:22	12:40	12:42	11:10
Reading (Inches Mercury)	32	33	29	28	31	28	30	28	32	31	27	28	30	35
End Time	14:45	16:05	15:20	15:12	15:50	15:37	15:37	15:30	16:00	15:15	16:10	15:50	16:15	15:45
Reading	3	27	3	3	3.5	3.5	4	2.5	4.5	3	4.5	3	4.5	3.5

*The regulator used to collect this sample was deemed faulty and a second sample (1-Indoor (2)) was collected to replace this sample.

-Date: Wednesday, February 20th, 2013
-Temperature: 21°F
-Barometric Pressure: 29.97”, Steady
-Relative Humidity: 62%

TABLE 2
Limited Vapor Intrusion Assessment
Harrison Place, Building No. 4, 210 Walnut Street, Lockport, New York
Summary of Detected VOCs in Sub-Slab Soil Gas and Ambient Air Samples
United States Environmental Protection Agency Method TO-15

Sample Type	Units	Sub-Slab Soil Vapor Samples	Sub-Slab Soil Vapor Samples	Sub-Slab Soil Vapor Samples	Sub-Slab Soil Vapor Samples	Sub-Slab Soil Vapor Samples	Sub-Slab Soil Vapor Samples	NYSDOH Sub-Slab Vapor Concentration (minimum action level) (1)	Indoor Air Sample	Indoor Air Sample	Indoor Air Sample	Indoor Air Sample	Indoor Air Sample	Indoor Air Sample	Outdoor Air Sample	NYSDOH Indoor Air Concentration (minimum action level) (1)	NYSDOH Indoor Air Concentration (1)****
Date		2/20/2013	2/20/2013	2/20/2013	2/20/2013	2/20/2013	2/20/2013		2/20/2013	2/20/2013	2/20/2013	2/20/2013	2/20/2013	1/10/2013	1/10/2013		
Sample ID		1-SS	2-SS	3-SS	4-SS	5-SS	6-SS		1-Indoor (2)	2-Indoor	3-Indoor	4-Indoor	5-Indoor	6-Indoor	Outdoor		
1,1,1-Trichloroethane	ug/m ³	3.4	ND<0.83	ND<0.83	ND<0.83	0.72 J	3.5	<100***	ND<0.83	ND<0.83	ND<0.83	ND<0.83	ND<0.83	ND<0.83	ND<0.83	<3***	20.6
1,2,4-Trimethylbenzene	ug/m ³	4.3	ND<0.75	ND<0.75	ND<1.1	1.9	ND<0.75	NL	1.2	1.6	0.95	1.1	1.3	1.7	ND<0.75	NL	9.5
1,2-Dichloroethane	ug/m ³	ND<0.62	ND<0.62	ND<0.62	ND<0.62	ND<0.62	ND<0.62	<100***	ND<0.62	ND<0.62	ND<0.62	ND<0.62	ND<0.62	ND<0.62	ND<0.62	<3***	<0.9
1,3,5-Trimethylbenzene	ug/m ³	1.1	ND<0.75	ND<0.75	0.90	0.55 J	ND<0.75	NL	ND<0.75	ND<0.75	ND<0.75	ND<0.75	ND<0.75	ND<0.75	ND<0.75	NL	3.7
2,2,4-Trimethylpentane	ug/m3	0.66 J	440	ND<0.71	2.2	0.66 J	ND<0.71	NL	ND<0.71	ND<0.71	ND<0.71	ND<0.71	ND<0.71	ND<0.71	ND<0.71	NL	NL
Acetone	ug/m ³	27	170	200	35	39	25	NL	5.4	5.2	4.8	5.0	5.7	5.8	5.7	NL	98.9
Benzene	ug/m ³	1.5	190	260	20	22	2.5	NL	0.65	0.55	0.58	0.58	0.65	0.68	0.55	NL	9.4
Bromodichloromethane	ug/m3	ND<1.0	8.4	ND<1.0	ND<1.0	ND<1.0	ND<1.0	NL	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	NL	NL
Carbon Disulfide	ug/m ³	1.2	44	38	21	17	27	NL	ND<0.47	ND<0.47	ND<0.47	ND<0.47	ND<0.47	ND<0.47	ND<0.47	NL	4.2
Carbon Tetrachloride	ug/m ³	ND<0.96	ND<0.96	ND<0.96	ND<0.96	0.77 J	ND<0.96	<5**	ND<0.26	ND<0.26	ND<0.26	ND<0.26	ND<0.26	ND<0.26	ND<0.26	<0.25**	<1.3
4-Ethyltoluene	ug/m ³	1.9	ND<0.75	ND<0.75	1.3	0.90	ND<0.75	NL	ND<0.75	ND<0.75	ND<0.75	ND<0.75	ND<0.75	ND<0.75	ND<0.75	NL	3.6
Chloroform	ug/m3	1.2	7.9	4.6	7.3	7.4	11	NL	ND<0.74	ND<0.74	ND<0.74	ND<0.74	ND<0.74	ND<0.74	ND<0.74	NL	1.1
Chloromethane	ug/m3	ND<0.31	ND<0.31	ND<0.31	ND<0.31	ND<0.31	ND<0.31	NL	0.88	0.84	ND<0.31	0.90	0.84	0.99	0.92	NL	3.7
Cyclohexane	ug/m ³	7.8	810	1,000	120	200	39	NL	3.0	2.6	1.9	2.0	2.4	2.2	ND<0.52	NL	NL
Ethyl Acetate	ug/m ³	ND<0.92	ND<0.92	ND<0.92	ND<0.92	ND<0.92	ND<0.92	NL	ND<0.92	ND<0.92	ND<0.92	ND<0.92	ND<0.92	ND<0.92	ND<0.92	NL	5.4
Ethylbenzene	ug/m ³	2.8	1.1	10	4.7	2.3	ND<0.66	NL	ND<0.66	ND<0.66	ND<0.66	ND<0.66	ND<0.66	ND<0.66	ND<0.66	NL	5.7
Freon 11	ug/m ³	0.97	1.0	0.91	1.1	1.5	0.86	NL	1.2	1.2	1.2	1.3	1.3	1.4	1.4	NL	NL
Freon 12	ug/m ³	23	3.6	10	4.3	5.3	14	NL	2.5	2.4	2.4	2.6	2.7	2.8	2.8	NL	NL
Heptane	ug/m ³	7.5	480	1,100	110	120	16	NL	ND<0.62	ND<0.62	ND<0.62	ND<0.62	ND<0.62	ND<0.62	ND<0.62	NL	NL
Hexane	ug/m ³	8.2	770	880	110	200	37	NL	2.8	2.4	1.7	1.8	2.2	2	ND<0.54	NL	NL
Isopropyl Alcohol	ug/m ³	3.5	ND<0.37	ND<0.37	ND<0.37	ND<0.37	ND<0.37	NL	1.2	1.7	ND<0.37	ND<0.37	1.2	2.3	ND<0.37	NL	NL
m&p-Xylene	ug/m ³	9.2	2.5	13	13	6.2	0.57 J	NL	0.66 J	0.62 J	ND<1.3	0.62 J	0.66 J	0.88 J	ND<1.3	NL	22.2
Methyl Ethyl Ketone	ug/m ³	3.9	ND<0.90	ND<0.90	10	6.9	3.7	NL	1.2	1.0	ND<0.90	1.4	1.5	2.0	0.84 J	NL	12
Methyl Isobutyl Ketone	ug/m ³	ND<1.2	ND<1.2	ND<1.2	ND<1.2	ND<1.2	ND<1.2	NL	ND<1.2	ND<1.2	ND<1.2	ND<1.2	ND<1.2	ND<1.2	ND<1.2	NL	NL
Methylene Chloride	ug/m ³	ND<0.53	2.3	2.5	0.49 J	0.60	0.67	NL	0.64	0.42 J	0.56	0.56	0.53	0.74	ND<0.53	60*	10.0
o-Xylene	ug/m ³	2.9	0.57 J	3.0	3.3	1.8	ND<0.66	NL	ND<0.66	ND<0.66	ND<0.66	ND<0.66	ND<0.66	ND<0.66	ND<0.66	NL	7.9
Styrene	ug/m ³	ND<0.65	ND<0.65	ND<0.65	ND<0.65	ND<0.65	ND<0.65	NL	ND<0.65	ND<0.65	ND<0.65	ND<0.65	ND<0.65	ND<0.65	ND<0.65	NL	1.9
Tetrachloroethylene	ug/m ³	7.6	7.7	2.8	6.1	12	94	<100***	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	<3***	15.9
Tetrahydrofuran	ug/m3	ND<0.45	ND<0.45	ND<0.45	ND<0.45	ND<0.45	ND<0.45	NL	1.4	ND<0.45	ND<0.45	2.0	2.6	3.4	ND<0.45	NL	NL
Toluene	ug/m ³	16	67	380	62	31	6.1	NL	1.3	0.84	ND<0.57	0.88	1.0	1.4	0.73	NL	43.0
Trichloroethene	ug/m ³	0.87	ND<0.82	1.1	16	0.60 J	ND<0.82	<5**	ND<0.22	ND<0.22	ND<0.22	ND<0.22	ND<0.22	ND<0.22	ND<0.22	<0.25**	4.2

1. New York State Department of Health (NYSDOH), Guidance for Evaluating Soil Vapor Intrusion in the State of New York, October 2006. [Note: This Guidance uses a combination of indoor air and sub-slab soil vapor when comparing to the matrices.]

* = Guideline Values obtained from Table 3.1, NYSDOH, Guidance for Evaluating Soil Vapor Intrusion in the State of New York.

** = Guideline Value obtained from Soil Vapor/Indoor Air Matrix 1 (minimum action level), NYSDOH, Guidance for Evaluating Soil Vapor Intrusion in the State of New York.

*** = Guidance Value obtained from Soil Vapor/Indoor Air Matrix 2 (minimum action level), NYSDOH Guidance for Evaluating Soil Vapor Intrusion in the State of New York.

**** = Guidance Values obtained from Appendix C, Table C2. EPA2001: Building assessment and survey evaluation (BASE) database, SUMMA canister method 90th percentile.

NL denotes that the USEPA and/or NYSDOH does not list a Target Concentration and/or Guidance Value for this compound.

ND denotes the compound was not detected above the laboratory reporting limit

J = Analyte detected at or below quantitation limit.

= Analyte detected above Soil Vapor Matrix 1 (minimum action level), NYSDOH Guidance for Evaluating Soil Vapor Intrusion in the State of New York.

Bold = Analyte detected above Indoor Air Matrix 1 (minimum action level), NYSDOH Guidance for Evaluating Soil Vapor Intrusion in the State of New York.

Underlined = Analyte detected above NYSDOH BASE database 90th percentile.



LaBella Associates, P.C.
300 State Street
Rochester, New York 14614

Appendix A

Laboratory Analytical Report

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-001A

Client Sample ID: 1-SS
Tag Number: 1184,175
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 BY METHOD TO15			TO-15		Analyst: RJP	
1,1,1-Trichloroethane	3.4	0.83		ug/m3	1	2/27/2013 3:49:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		ug/m3	1	2/27/2013 3:49:00 AM
1,1,2-Trichloroethane	< 0.83	0.83		ug/m3	1	2/27/2013 3:49:00 AM
1,1-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 3:49:00 AM
1,1-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 3:49:00 AM
1,2,4-Trichlorobenzene	< 1.1	1.1		ug/m3	1	2/27/2013 3:49:00 AM
1,2,4-Trimethylbenzene	4.3	0.75		ug/m3	1	2/27/2013 3:49:00 AM
1,2-Dibromoethane	< 1.2	1.2		ug/m3	1	2/27/2013 3:49:00 AM
1,2-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 3:49:00 AM
1,2-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 3:49:00 AM
1,2-Dichloropropane	< 0.70	0.70		ug/m3	1	2/27/2013 3:49:00 AM
1,3,5-Trimethylbenzene	1.1	0.75		ug/m3	1	2/27/2013 3:49:00 AM
1,3-butadiene	< 0.34	0.34		ug/m3	1	2/27/2013 3:49:00 AM
1,3-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 3:49:00 AM
1,4-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 3:49:00 AM
1,4-Dioxane	< 1.1	1.1		ug/m3	1	2/27/2013 3:49:00 AM
2,2,4-trimethylpentane	0.66	0.71	J	ug/m3	1	2/27/2013 3:49:00 AM
4-ethyltoluene	1.9	0.75		ug/m3	1	2/27/2013 3:49:00 AM
Acetone	27	7.2		ug/m3	10	2/27/2013 5:00:00 PM
Allyl chloride	< 0.48	0.48		ug/m3	1	2/27/2013 3:49:00 AM
Benzene	1.5	0.49		ug/m3	1	2/27/2013 3:49:00 AM
Benzyl chloride	< 0.88	0.88		ug/m3	1	2/27/2013 3:49:00 AM
Bromodichloromethane	< 1.0	1.0		ug/m3	1	2/27/2013 3:49:00 AM
Bromoform	< 1.6	1.6		ug/m3	1	2/27/2013 3:49:00 AM
Bromomethane	< 0.59	0.59		ug/m3	1	2/27/2013 3:49:00 AM
Carbon disulfide	1.2	0.47		ug/m3	1	2/27/2013 3:49:00 AM
Carbon tetrachloride	< 0.96	0.96		ug/m3	1	2/27/2013 3:49:00 AM
Chlorobenzene	< 0.70	0.70		ug/m3	1	2/27/2013 3:49:00 AM
Chloroethane	< 0.40	0.40		ug/m3	1	2/27/2013 3:49:00 AM
Chloroform	1.2	0.74		ug/m3	1	2/27/2013 3:49:00 AM
Chloromethane	< 0.31	0.31		ug/m3	1	2/27/2013 3:49:00 AM
cis-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 3:49:00 AM
cis-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 3:49:00 AM
Cyclohexane	7.8	0.52		ug/m3	1	2/27/2013 3:49:00 AM
Dibromochloromethane	< 1.3	1.3		ug/m3	1	2/27/2013 3:49:00 AM
Ethyl acetate	< 0.92	0.92		ug/m3	1	2/27/2013 3:49:00 AM
Ethylbenzene	2.8	0.66		ug/m3	1	2/27/2013 3:49:00 AM
Freon 11	0.97	0.86		ug/m3	1	2/27/2013 3:49:00 AM
Freon 113	< 1.2	1.2		ug/m3	1	2/27/2013 3:49:00 AM
Freon 114	< 1.1	1.1		ug/m3	1	2/27/2013 3:49:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-001A

Client Sample ID: 1-SS
Tag Number: 1184,175
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 BY METHOD TO15			TO-15		Analyst: RJP	
Freon 12	23	7.5		ug/m3	10	2/27/2013 5:00:00 PM
Heptane	7.5	0.62		ug/m3	1	2/27/2013 3:49:00 AM
Hexachloro-1,3-butadiene	< 1.6	1.6		ug/m3	1	2/27/2013 3:49:00 AM
Hexane	8.2	5.4		ug/m3	10	2/27/2013 5:00:00 PM
Isopropyl alcohol	3.5	0.37		ug/m3	1	2/27/2013 3:49:00 AM
m&p-Xylene	9.2	1.3		ug/m3	1	2/27/2013 3:49:00 AM
Methyl Butyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 3:49:00 AM
Methyl Ethyl Ketone	3.9	0.90		ug/m3	1	2/27/2013 3:49:00 AM
Methyl Isobutyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 3:49:00 AM
Methyl tert-butyl ether	< 0.55	0.55		ug/m3	1	2/27/2013 3:49:00 AM
Methylene chloride	< 0.53	0.53		ug/m3	1	2/27/2013 3:49:00 AM
o-Xylene	2.9	0.66		ug/m3	1	2/27/2013 3:49:00 AM
Propylene	< 0.26	0.26		ug/m3	1	2/27/2013 3:49:00 AM
Styrene	< 0.65	0.65		ug/m3	1	2/27/2013 3:49:00 AM
Tetrachloroethylene	7.6	1.0		ug/m3	1	2/27/2013 3:49:00 AM
Tetrahydrofuran	< 0.45	0.45		ug/m3	1	2/27/2013 3:49:00 AM
Toluene	16	5.7		ug/m3	10	2/27/2013 5:00:00 PM
trans-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 3:49:00 AM
trans-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 3:49:00 AM
Trichloroethene	0.87	0.82		ug/m3	1	2/27/2013 3:49:00 AM
Vinyl acetate	< 0.54	0.54		ug/m3	1	2/27/2013 3:49:00 AM
Vinyl Bromide	< 0.67	0.67		ug/m3	1	2/27/2013 3:49:00 AM
Vinyl chloride	< 0.39	0.39		ug/m3	1	2/27/2013 3:49:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-003A

Client Sample ID: 1-Indoor (2)
Tag Number: 248,1125
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 W/ 0.25UG/M3 CT-TCE-VC		TO-15		Analyst: RJP		
1,1,1-Trichloroethane	< 0.83	0.83		ug/m3	1	2/26/2013 11:24:00 PM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		ug/m3	1	2/26/2013 11:24:00 PM
1,1,2-Trichloroethane	< 0.83	0.83		ug/m3	1	2/26/2013 11:24:00 PM
1,1-Dichloroethane	< 0.62	0.62		ug/m3	1	2/26/2013 11:24:00 PM
1,1-Dichloroethene	< 0.60	0.60		ug/m3	1	2/26/2013 11:24:00 PM
1,2,4-Trichlorobenzene	< 1.1	1.1		ug/m3	1	2/26/2013 11:24:00 PM
1,2,4-Trimethylbenzene	1.2	0.75		ug/m3	1	2/26/2013 11:24:00 PM
1,2-Dibromoethane	< 1.2	1.2		ug/m3	1	2/26/2013 11:24:00 PM
1,2-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/26/2013 11:24:00 PM
1,2-Dichloroethane	< 0.62	0.62		ug/m3	1	2/26/2013 11:24:00 PM
1,2-Dichloropropane	< 0.70	0.70		ug/m3	1	2/26/2013 11:24:00 PM
1,3,5-Trimethylbenzene	< 0.75	0.75		ug/m3	1	2/26/2013 11:24:00 PM
1,3-butadiene	< 0.34	0.34		ug/m3	1	2/26/2013 11:24:00 PM
1,3-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/26/2013 11:24:00 PM
1,4-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/26/2013 11:24:00 PM
1,4-Dioxane	< 1.1	1.1		ug/m3	1	2/26/2013 11:24:00 PM
2,2,4-trimethylpentane	< 0.71	0.71		ug/m3	1	2/26/2013 11:24:00 PM
4-ethyltoluene	< 0.75	0.75		ug/m3	1	2/26/2013 11:24:00 PM
Acetone	5.4	0.72		ug/m3	1	2/26/2013 11:24:00 PM
Allyl chloride	< 0.48	0.48		ug/m3	1	2/26/2013 11:24:00 PM
Benzene	0.65	0.49		ug/m3	1	2/26/2013 11:24:00 PM
Benzyl chloride	< 0.88	0.88		ug/m3	1	2/26/2013 11:24:00 PM
Bromodichloromethane	< 1.0	1.0		ug/m3	1	2/26/2013 11:24:00 PM
Bromoform	< 1.6	1.6		ug/m3	1	2/26/2013 11:24:00 PM
Bromomethane	< 0.59	0.59		ug/m3	1	2/26/2013 11:24:00 PM
Carbon disulfide	< 0.47	0.47		ug/m3	1	2/26/2013 11:24:00 PM
Carbon tetrachloride	< 0.26	0.26		ug/m3	1	2/26/2013 11:24:00 PM
Chlorobenzene	< 0.70	0.70		ug/m3	1	2/26/2013 11:24:00 PM
Chloroethane	< 0.40	0.40		ug/m3	1	2/26/2013 11:24:00 PM
Chloroform	< 0.74	0.74		ug/m3	1	2/26/2013 11:24:00 PM
Chloromethane	0.88	0.31		ug/m3	1	2/26/2013 11:24:00 PM
cis-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/26/2013 11:24:00 PM
cis-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/26/2013 11:24:00 PM
Cyclohexane	3.0	0.52		ug/m3	1	2/26/2013 11:24:00 PM
Dibromochloromethane	< 1.3	1.3		ug/m3	1	2/26/2013 11:24:00 PM
Ethyl acetate	< 0.92	0.92		ug/m3	1	2/26/2013 11:24:00 PM
Ethylbenzene	< 0.66	0.66		ug/m3	1	2/26/2013 11:24:00 PM
Freon 11	1.2	0.86		ug/m3	1	2/26/2013 11:24:00 PM
Freon 113	< 1.2	1.2		ug/m3	1	2/26/2013 11:24:00 PM
Freon 114	< 1.1	1.1		ug/m3	1	2/26/2013 11:24:00 PM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-003A

Client Sample ID: 1-Indoor (2)
Tag Number: 248,1125
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 W/ 0.25UG/M3 CT-TCE-VC			TO-15			Analyst: RJP
Freon 12	2.5	0.75		ug/m3	1	2/26/2013 11:24:00 PM
Heptane	< 0.62	0.62		ug/m3	1	2/26/2013 11:24:00 PM
Hexachloro-1,3-butadiene	< 1.6	1.6		ug/m3	1	2/26/2013 11:24:00 PM
Hexane	2.8	0.54		ug/m3	1	2/26/2013 11:24:00 PM
Isopropyl alcohol	1.2	0.37		ug/m3	1	2/26/2013 11:24:00 PM
m&p-Xylene	0.66	1.3	J	ug/m3	1	2/26/2013 11:24:00 PM
Methyl Butyl Ketone	< 1.2	1.2		ug/m3	1	2/26/2013 11:24:00 PM
Methyl Ethyl Ketone	1.2	0.90		ug/m3	1	2/26/2013 11:24:00 PM
Methyl Isobutyl Ketone	< 1.2	1.2		ug/m3	1	2/26/2013 11:24:00 PM
Methyl tert-butyl ether	< 0.55	0.55		ug/m3	1	2/26/2013 11:24:00 PM
Methylene chloride	0.64	0.53		ug/m3	1	2/26/2013 11:24:00 PM
o-Xylene	< 0.66	0.66		ug/m3	1	2/26/2013 11:24:00 PM
Propylene	< 0.26	0.26		ug/m3	1	2/26/2013 11:24:00 PM
Styrene	< 0.65	0.65		ug/m3	1	2/26/2013 11:24:00 PM
Tetrachloroethylene	< 1.0	1.0		ug/m3	1	2/26/2013 11:24:00 PM
Tetrahydrofuran	1.4	0.45		ug/m3	1	2/26/2013 11:24:00 PM
Toluene	1.3	0.57		ug/m3	1	2/26/2013 11:24:00 PM
trans-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/26/2013 11:24:00 PM
trans-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/26/2013 11:24:00 PM
Trichloroethene	< 0.22	0.22		ug/m3	1	2/26/2013 11:24:00 PM
Vinyl acetate	< 0.54	0.54		ug/m3	1	2/26/2013 11:24:00 PM
Vinyl Bromide	< 0.67	0.67		ug/m3	1	2/26/2013 11:24:00 PM
Vinyl chloride	< 0.10	0.10		ug/m3	1	2/26/2013 11:24:00 PM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-004A

Client Sample ID: 2-SS
Tag Number: 192,1154
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 BY METHOD TO15			TO-15		Analyst: RJP	
1,1,1-Trichloroethane	< 0.83	0.83		ug/m3	1	2/27/2013 4:22:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		ug/m3	1	2/27/2013 4:22:00 AM
1,1,2-Trichloroethane	< 0.83	0.83		ug/m3	1	2/27/2013 4:22:00 AM
1,1-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 4:22:00 AM
1,1-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 4:22:00 AM
1,2,4-Trichlorobenzene	< 1.1	1.1		ug/m3	1	2/27/2013 4:22:00 AM
1,2,4-Trimethylbenzene	< 0.75	0.75		ug/m3	1	2/27/2013 4:22:00 AM
1,2-Dibromoethane	< 1.2	1.2		ug/m3	1	2/27/2013 4:22:00 AM
1,2-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 4:22:00 AM
1,2-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 4:22:00 AM
1,2-Dichloropropane	< 0.70	0.70		ug/m3	1	2/27/2013 4:22:00 AM
1,3,5-Trimethylbenzene	< 0.75	0.75		ug/m3	1	2/27/2013 4:22:00 AM
1,3-butadiene	< 0.34	0.34		ug/m3	1	2/27/2013 4:22:00 AM
1,3-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 4:22:00 AM
1,4-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 4:22:00 AM
1,4-Dioxane	< 1.1	1.1		ug/m3	1	2/27/2013 4:22:00 AM
2,2,4-trimethylpentane	440	190		ug/m3	270	2/27/2013 3:54:00 PM
4-ethyltoluene	< 0.75	0.75		ug/m3	1	2/27/2013 4:22:00 AM
Acetone	170	29		ug/m3	40	2/27/2013 1:45:00 PM
Allyl chloride	< 0.48	0.48		ug/m3	1	2/27/2013 4:22:00 AM
Benzene	190	19		ug/m3	40	2/27/2013 1:45:00 PM
Benzyl chloride	< 0.88	0.88		ug/m3	1	2/27/2013 4:22:00 AM
Bromodichloromethane	8.4	1.0		ug/m3	1	2/27/2013 4:22:00 AM
Bromoform	< 1.6	1.6		ug/m3	1	2/27/2013 4:22:00 AM
Bromomethane	< 0.59	0.59		ug/m3	1	2/27/2013 4:22:00 AM
Carbon disulfide	44	4.7		ug/m3	10	2/27/2013 1:12:00 PM
Carbon tetrachloride	< 0.96	0.96		ug/m3	1	2/27/2013 4:22:00 AM
Chlorobenzene	< 0.70	0.70		ug/m3	1	2/27/2013 4:22:00 AM
Chloroethane	< 0.40	0.40		ug/m3	1	2/27/2013 4:22:00 AM
Chloroform	7.9	0.74		ug/m3	1	2/27/2013 4:22:00 AM
Chloromethane	< 0.31	0.31		ug/m3	1	2/27/2013 4:22:00 AM
cis-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 4:22:00 AM
cis-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 4:22:00 AM
Cyclohexane	810	140		ug/m3	270	2/27/2013 3:54:00 PM
Dibromochloromethane	< 1.3	1.3		ug/m3	1	2/27/2013 4:22:00 AM
Ethyl acetate	< 0.92	0.92		ug/m3	1	2/27/2013 4:22:00 AM
Ethylbenzene	1.1	0.66		ug/m3	1	2/27/2013 4:22:00 AM
Freon 11	1.0	0.86		ug/m3	1	2/27/2013 4:22:00 AM
Freon 113	< 1.2	1.2		ug/m3	1	2/27/2013 4:22:00 AM
Freon 114	< 1.1	1.1		ug/m3	1	2/27/2013 4:22:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-004A

Client Sample ID: 2-SS
Tag Number: 192,1154
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 BY METHOD TO15			TO-15		Analyst: RJP	
Freon 12	3.6	0.75		ug/m3	1	2/27/2013 4:22:00 AM
Heptane	480	170		ug/m3	270	2/27/2013 3:54:00 PM
Hexachloro-1,3-butadiene	< 1.6	1.6		ug/m3	1	2/27/2013 4:22:00 AM
Hexane	770	140		ug/m3	270	2/27/2013 3:54:00 PM
Isopropyl alcohol	< 0.37	0.37		ug/m3	1	2/27/2013 4:22:00 AM
m&p-Xylene	2.5	1.3		ug/m3	1	2/27/2013 4:22:00 AM
Methyl Butyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 4:22:00 AM
Methyl Ethyl Ketone	< 0.90	0.90		ug/m3	1	2/27/2013 4:22:00 AM
Methyl Isobutyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 4:22:00 AM
Methyl tert-butyl ether	< 0.55	0.55		ug/m3	1	2/27/2013 4:22:00 AM
Methylene chloride	2.3	0.53		ug/m3	1	2/27/2013 4:22:00 AM
o-Xylene	0.57	0.66	J	ug/m3	1	2/27/2013 4:22:00 AM
Propylene	< 0.26	0.26		ug/m3	1	2/27/2013 4:22:00 AM
Styrene	< 0.65	0.65		ug/m3	1	2/27/2013 4:22:00 AM
Tetrachloroethylene	7.7	1.0		ug/m3	1	2/27/2013 4:22:00 AM
Tetrahydrofuran	< 0.45	0.45		ug/m3	1	2/27/2013 4:22:00 AM
Toluene	67	5.7		ug/m3	10	2/27/2013 1:12:00 PM
trans-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 4:22:00 AM
trans-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 4:22:00 AM
Trichloroethene	< 0.82	0.82		ug/m3	1	2/27/2013 4:22:00 AM
Vinyl acetate	< 0.54	0.54		ug/m3	1	2/27/2013 4:22:00 AM
Vinyl Bromide	< 0.67	0.67		ug/m3	1	2/27/2013 4:22:00 AM
Vinyl chloride	< 0.39	0.39		ug/m3	1	2/27/2013 4:22:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-005A

Client Sample ID: 2-Indoor
Tag Number: 320,268
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 W/ 0.25UG/M3 CT-TCE-VC		TO-15		Analyst: RJP		
1,1,1-Trichloroethane	< 0.83	0.83		ug/m3	1	2/26/2013 11:57:00 PM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		ug/m3	1	2/26/2013 11:57:00 PM
1,1,2-Trichloroethane	< 0.83	0.83		ug/m3	1	2/26/2013 11:57:00 PM
1,1-Dichloroethane	< 0.62	0.62		ug/m3	1	2/26/2013 11:57:00 PM
1,1-Dichloroethene	< 0.60	0.60		ug/m3	1	2/26/2013 11:57:00 PM
1,2,4-Trichlorobenzene	< 1.1	1.1		ug/m3	1	2/26/2013 11:57:00 PM
1,2,4-Trimethylbenzene	1.6	0.75		ug/m3	1	2/26/2013 11:57:00 PM
1,2-Dibromoethane	< 1.2	1.2		ug/m3	1	2/26/2013 11:57:00 PM
1,2-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/26/2013 11:57:00 PM
1,2-Dichloroethane	< 0.62	0.62		ug/m3	1	2/26/2013 11:57:00 PM
1,2-Dichloropropane	< 0.70	0.70		ug/m3	1	2/26/2013 11:57:00 PM
1,3,5-Trimethylbenzene	< 0.75	0.75		ug/m3	1	2/26/2013 11:57:00 PM
1,3-butadiene	< 0.34	0.34		ug/m3	1	2/26/2013 11:57:00 PM
1,3-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/26/2013 11:57:00 PM
1,4-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/26/2013 11:57:00 PM
1,4-Dioxane	< 1.1	1.1		ug/m3	1	2/26/2013 11:57:00 PM
2,2,4-trimethylpentane	< 0.71	0.71		ug/m3	1	2/26/2013 11:57:00 PM
4-ethyltoluene	< 0.75	0.75		ug/m3	1	2/26/2013 11:57:00 PM
Acetone	5.2	0.72		ug/m3	1	2/26/2013 11:57:00 PM
Allyl chloride	< 0.48	0.48		ug/m3	1	2/26/2013 11:57:00 PM
Benzene	0.55	0.49		ug/m3	1	2/26/2013 11:57:00 PM
Benzyl chloride	< 0.88	0.88		ug/m3	1	2/26/2013 11:57:00 PM
Bromodichloromethane	< 1.0	1.0		ug/m3	1	2/26/2013 11:57:00 PM
Bromoform	< 1.6	1.6		ug/m3	1	2/26/2013 11:57:00 PM
Bromomethane	< 0.59	0.59		ug/m3	1	2/26/2013 11:57:00 PM
Carbon disulfide	< 0.47	0.47		ug/m3	1	2/26/2013 11:57:00 PM
Carbon tetrachloride	< 0.26	0.26		ug/m3	1	2/26/2013 11:57:00 PM
Chlorobenzene	< 0.70	0.70		ug/m3	1	2/26/2013 11:57:00 PM
Chloroethane	< 0.40	0.40		ug/m3	1	2/26/2013 11:57:00 PM
Chloroform	< 0.74	0.74		ug/m3	1	2/26/2013 11:57:00 PM
Chloromethane	0.84	0.31		ug/m3	1	2/26/2013 11:57:00 PM
cis-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/26/2013 11:57:00 PM
cis-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/26/2013 11:57:00 PM
Cyclohexane	2.6	0.52		ug/m3	1	2/26/2013 11:57:00 PM
Dibromochloromethane	< 1.3	1.3		ug/m3	1	2/26/2013 11:57:00 PM
Ethyl acetate	< 0.92	0.92		ug/m3	1	2/26/2013 11:57:00 PM
Ethylbenzene	< 0.66	0.66		ug/m3	1	2/26/2013 11:57:00 PM
Freon 11	1.2	0.86		ug/m3	1	2/26/2013 11:57:00 PM
Freon 113	< 1.2	1.2		ug/m3	1	2/26/2013 11:57:00 PM
Freon 114	< 1.1	1.1		ug/m3	1	2/26/2013 11:57:00 PM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-005A

Client Sample ID: 2-Indoor
Tag Number: 320,268
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 W/ 0.25UG/M3 CT-TCE-VC			TO-15			Analyst: RJP
Freon 12	2.4	0.75		ug/m3	1	2/26/2013 11:57:00 PM
Heptane	< 0.62	0.62		ug/m3	1	2/26/2013 11:57:00 PM
Hexachloro-1,3-butadiene	< 1.6	1.6		ug/m3	1	2/26/2013 11:57:00 PM
Hexane	2.4	0.54		ug/m3	1	2/26/2013 11:57:00 PM
Isopropyl alcohol	1.7	0.37		ug/m3	1	2/26/2013 11:57:00 PM
m&p-Xylene	0.62	1.3	J	ug/m3	1	2/26/2013 11:57:00 PM
Methyl Butyl Ketone	< 1.2	1.2		ug/m3	1	2/26/2013 11:57:00 PM
Methyl Ethyl Ketone	1.0	0.90		ug/m3	1	2/26/2013 11:57:00 PM
Methyl Isobutyl Ketone	< 1.2	1.2		ug/m3	1	2/26/2013 11:57:00 PM
Methyl tert-butyl ether	< 0.55	0.55		ug/m3	1	2/26/2013 11:57:00 PM
Methylene chloride	0.42	0.53	J	ug/m3	1	2/26/2013 11:57:00 PM
o-Xylene	< 0.66	0.66		ug/m3	1	2/26/2013 11:57:00 PM
Propylene	< 0.26	0.26		ug/m3	1	2/26/2013 11:57:00 PM
Styrene	< 0.65	0.65		ug/m3	1	2/26/2013 11:57:00 PM
Tetrachloroethylene	< 1.0	1.0		ug/m3	1	2/26/2013 11:57:00 PM
Tetrahydrofuran	< 0.45	0.45		ug/m3	1	2/26/2013 11:57:00 PM
Toluene	0.84	0.57		ug/m3	1	2/26/2013 11:57:00 PM
trans-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/26/2013 11:57:00 PM
trans-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/26/2013 11:57:00 PM
Trichloroethene	< 0.22	0.22		ug/m3	1	2/26/2013 11:57:00 PM
Vinyl acetate	< 0.54	0.54		ug/m3	1	2/26/2013 11:57:00 PM
Vinyl Bromide	< 0.67	0.67		ug/m3	1	2/26/2013 11:57:00 PM
Vinyl chloride	< 0.10	0.10		ug/m3	1	2/26/2013 11:57:00 PM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-006A

Client Sample ID: 3-SS
Tag Number: 419,1153
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 BY METHOD TO15			TO-15		Analyst: RJP	
1,1,1-Trichloroethane	< 0.83	0.83		ug/m3	1	2/27/2013 4:55:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		ug/m3	1	2/27/2013 4:55:00 AM
1,1,2-Trichloroethane	< 0.83	0.83		ug/m3	1	2/27/2013 4:55:00 AM
1,1-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 4:55:00 AM
1,1-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 4:55:00 AM
1,2,4-Trichlorobenzene	< 1.1	1.1		ug/m3	1	2/27/2013 4:55:00 AM
1,2,4-Trimethylbenzene	< 0.75	0.75		ug/m3	1	2/27/2013 4:55:00 AM
1,2-Dibromoethane	< 1.2	1.2		ug/m3	1	2/27/2013 4:55:00 AM
1,2-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 4:55:00 AM
1,2-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 4:55:00 AM
1,2-Dichloropropane	< 0.70	0.70		ug/m3	1	2/27/2013 4:55:00 AM
1,3,5-Trimethylbenzene	< 0.75	0.75		ug/m3	1	2/27/2013 4:55:00 AM
1,3-butadiene	< 0.34	0.34		ug/m3	1	2/27/2013 4:55:00 AM
1,3-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 4:55:00 AM
1,4-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 4:55:00 AM
1,4-Dioxane	< 1.1	1.1		ug/m3	1	2/27/2013 4:55:00 AM
2,2,4-trimethylpentane	< 0.71	0.71		ug/m3	1	2/27/2013 4:55:00 AM
4-ethyltoluene	< 0.75	0.75		ug/m3	1	2/27/2013 4:55:00 AM
Acetone	200	29		ug/m3	40	2/27/2013 2:52:00 PM
Allyl chloride	< 0.48	0.48		ug/m3	1	2/27/2013 4:55:00 AM
Benzene	260	19		ug/m3	40	2/27/2013 2:52:00 PM
Benzyl chloride	< 0.88	0.88		ug/m3	1	2/27/2013 4:55:00 AM
Bromodichloromethane	< 1.0	1.0		ug/m3	1	2/27/2013 4:55:00 AM
Bromoform	< 1.6	1.6		ug/m3	1	2/27/2013 4:55:00 AM
Bromomethane	< 0.59	0.59		ug/m3	1	2/27/2013 4:55:00 AM
Carbon disulfide	38	4.7		ug/m3	10	2/27/2013 2:18:00 PM
Carbon tetrachloride	< 0.96	0.96		ug/m3	1	2/27/2013 4:55:00 AM
Chlorobenzene	< 0.70	0.70		ug/m3	1	2/27/2013 4:55:00 AM
Chloroethane	< 0.40	0.40		ug/m3	1	2/27/2013 4:55:00 AM
Chloroform	4.6	0.74		ug/m3	1	2/27/2013 4:55:00 AM
Chloromethane	< 0.31	0.31		ug/m3	1	2/27/2013 4:55:00 AM
cis-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 4:55:00 AM
cis-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 4:55:00 AM
Cyclohexane	1000	140		ug/m3	270	2/27/2013 4:27:00 PM
Dibromochloromethane	< 1.3	1.3		ug/m3	1	2/27/2013 4:55:00 AM
Ethyl acetate	< 0.92	0.92		ug/m3	1	2/27/2013 4:55:00 AM
Ethylbenzene	10	0.66		ug/m3	1	2/27/2013 4:55:00 AM
Freon 11	0.91	0.86		ug/m3	1	2/27/2013 4:55:00 AM
Freon 113	< 1.2	1.2		ug/m3	1	2/27/2013 4:55:00 AM
Freon 114	< 1.1	1.1		ug/m3	1	2/27/2013 4:55:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-006A

Client Sample ID: 3-SS
Tag Number: 419,1153
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 BY METHOD TO15		TO-15		Analyst: RJP		
Freon 12	10	0.75		ug/m3	1	2/27/2013 4:55:00 AM
Heptane	1100	170		ug/m3	270	2/27/2013 4:27:00 PM
Hexachloro-1,3-butadiene	< 1.6	1.6		ug/m3	1	2/27/2013 4:55:00 AM
Hexane	880	140		ug/m3	270	2/27/2013 4:27:00 PM
Isopropyl alcohol	< 0.37	0.37		ug/m3	1	2/27/2013 4:55:00 AM
m&p-Xylene	13	1.3		ug/m3	1	2/27/2013 4:55:00 AM
Methyl Butyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 4:55:00 AM
Methyl Ethyl Ketone	< 0.90	0.90		ug/m3	1	2/27/2013 4:55:00 AM
Methyl Isobutyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 4:55:00 AM
Methyl tert-butyl ether	< 0.55	0.55		ug/m3	1	2/27/2013 4:55:00 AM
Methylene chloride	2.5	0.53		ug/m3	1	2/27/2013 4:55:00 AM
o-Xylene	3.0	0.66		ug/m3	1	2/27/2013 4:55:00 AM
Propylene	< 0.26	0.26		ug/m3	1	2/27/2013 4:55:00 AM
Styrene	< 0.65	0.65		ug/m3	1	2/27/2013 4:55:00 AM
Tetrachloroethylene	2.8	1.0		ug/m3	1	2/27/2013 4:55:00 AM
Tetrahydrofuran	< 0.45	0.45		ug/m3	1	2/27/2013 4:55:00 AM
Toluene	380	150		ug/m3	270	2/27/2013 4:27:00 PM
trans-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 4:55:00 AM
trans-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 4:55:00 AM
Trichloroethene	1.1	0.82		ug/m3	1	2/27/2013 4:55:00 AM
Vinyl acetate	< 0.54	0.54		ug/m3	1	2/27/2013 4:55:00 AM
Vinyl Bromide	< 0.67	0.67		ug/m3	1	2/27/2013 4:55:00 AM
Vinyl chloride	< 0.39	0.39		ug/m3	1	2/27/2013 4:55:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-007A

Client Sample ID: 3-Indoor
Tag Number: 370,143
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 W/ 0.25UG/M3 CT-TCE-VC			TO-15			Analyst: RJP
1,1,1-Trichloroethane	< 0.83	0.83		ug/m3	1	2/27/2013 12:31:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		ug/m3	1	2/27/2013 12:31:00 AM
1,1,2-Trichloroethane	< 0.83	0.83		ug/m3	1	2/27/2013 12:31:00 AM
1,1-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 12:31:00 AM
1,1-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 12:31:00 AM
1,2,4-Trichlorobenzene	< 1.1	1.1		ug/m3	1	2/27/2013 12:31:00 AM
1,2,4-Trimethylbenzene	0.95	0.75		ug/m3	1	2/27/2013 12:31:00 AM
1,2-Dibromoethane	< 1.2	1.2		ug/m3	1	2/27/2013 12:31:00 AM
1,2-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 12:31:00 AM
1,2-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 12:31:00 AM
1,2-Dichloropropane	< 0.70	0.70		ug/m3	1	2/27/2013 12:31:00 AM
1,3,5-Trimethylbenzene	< 0.75	0.75		ug/m3	1	2/27/2013 12:31:00 AM
1,3-butadiene	< 0.34	0.34		ug/m3	1	2/27/2013 12:31:00 AM
1,3-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 12:31:00 AM
1,4-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 12:31:00 AM
1,4-Dioxane	< 1.1	1.1		ug/m3	1	2/27/2013 12:31:00 AM
2,2,4-trimethylpentane	< 0.71	0.71		ug/m3	1	2/27/2013 12:31:00 AM
4-ethyltoluene	< 0.75	0.75		ug/m3	1	2/27/2013 12:31:00 AM
Acetone	4.8	0.72		ug/m3	1	2/27/2013 12:31:00 AM
Allyl chloride	< 0.48	0.48		ug/m3	1	2/27/2013 12:31:00 AM
Benzene	0.58	0.49		ug/m3	1	2/27/2013 12:31:00 AM
Benzyl chloride	< 0.88	0.88		ug/m3	1	2/27/2013 12:31:00 AM
Bromodichloromethane	< 1.0	1.0		ug/m3	1	2/27/2013 12:31:00 AM
Bromoform	< 1.6	1.6		ug/m3	1	2/27/2013 12:31:00 AM
Bromomethane	< 0.59	0.59		ug/m3	1	2/27/2013 12:31:00 AM
Carbon disulfide	< 0.47	0.47		ug/m3	1	2/27/2013 12:31:00 AM
Carbon tetrachloride	< 0.26	0.26		ug/m3	1	2/27/2013 12:31:00 AM
Chlorobenzene	< 0.70	0.70		ug/m3	1	2/27/2013 12:31:00 AM
Chloroethane	< 0.40	0.40		ug/m3	1	2/27/2013 12:31:00 AM
Chloroform	< 0.74	0.74		ug/m3	1	2/27/2013 12:31:00 AM
Chloromethane	< 0.31	0.31		ug/m3	1	2/27/2013 12:31:00 AM
cis-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 12:31:00 AM
cis-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 12:31:00 AM
Cyclohexane	1.9	0.52		ug/m3	1	2/27/2013 12:31:00 AM
Dibromochloromethane	< 1.3	1.3		ug/m3	1	2/27/2013 12:31:00 AM
Ethyl acetate	< 0.92	0.92		ug/m3	1	2/27/2013 12:31:00 AM
Ethylbenzene	< 0.66	0.66		ug/m3	1	2/27/2013 12:31:00 AM
Freon 11	1.2	0.86		ug/m3	1	2/27/2013 12:31:00 AM
Freon 113	< 1.2	1.2		ug/m3	1	2/27/2013 12:31:00 AM
Freon 114	< 1.1	1.1		ug/m3	1	2/27/2013 12:31:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-007A

Client Sample ID: 3-Indoor
Tag Number: 370,143
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 W/ 0.25UG/M3 CT-TCE-VC			TO-15			Analyst: RJP
Freon 12	2.4	0.75		ug/m3	1	2/27/2013 12:31:00 AM
Heptane	< 0.62	0.62		ug/m3	1	2/27/2013 12:31:00 AM
Hexachloro-1,3-butadiene	< 1.6	1.6		ug/m3	1	2/27/2013 12:31:00 AM
Hexane	1.7	0.54		ug/m3	1	2/27/2013 12:31:00 AM
Isopropyl alcohol	< 0.37	0.37		ug/m3	1	2/27/2013 12:31:00 AM
m&p-Xylene	< 1.3	1.3		ug/m3	1	2/27/2013 12:31:00 AM
Methyl Butyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 12:31:00 AM
Methyl Ethyl Ketone	< 0.90	0.90		ug/m3	1	2/27/2013 12:31:00 AM
Methyl Isobutyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 12:31:00 AM
Methyl tert-butyl ether	< 0.55	0.55		ug/m3	1	2/27/2013 12:31:00 AM
Methylene chloride	0.56	0.53		ug/m3	1	2/27/2013 12:31:00 AM
o-Xylene	< 0.66	0.66		ug/m3	1	2/27/2013 12:31:00 AM
Propylene	< 0.26	0.26		ug/m3	1	2/27/2013 12:31:00 AM
Styrene	< 0.65	0.65		ug/m3	1	2/27/2013 12:31:00 AM
Tetrachloroethylene	< 1.0	1.0		ug/m3	1	2/27/2013 12:31:00 AM
Tetrahydrofuran	< 0.45	0.45		ug/m3	1	2/27/2013 12:31:00 AM
Toluene	< 0.57	0.57		ug/m3	1	2/27/2013 12:31:00 AM
trans-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 12:31:00 AM
trans-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 12:31:00 AM
Trichloroethene	< 0.22	0.22		ug/m3	1	2/27/2013 12:31:00 AM
Vinyl acetate	< 0.54	0.54		ug/m3	1	2/27/2013 12:31:00 AM
Vinyl Bromide	< 0.67	0.67		ug/m3	1	2/27/2013 12:31:00 AM
Vinyl chloride	< 0.10	0.10		ug/m3	1	2/27/2013 12:31:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-008A

Client Sample ID: 4-SS
Tag Number: 275,245
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 BY METHOD TO15			TO-15		Analyst: RJP	
1,1,1-Trichloroethane	< 0.83	0.83		ug/m3	1	2/27/2013 5:28:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		ug/m3	1	2/27/2013 5:28:00 AM
1,1,2-Trichloroethane	< 0.83	0.83		ug/m3	1	2/27/2013 5:28:00 AM
1,1-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 5:28:00 AM
1,1-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 5:28:00 AM
1,2,4-Trichlorobenzene	< 1.1	1.1		ug/m3	1	2/27/2013 5:28:00 AM
1,2,4-Trimethylbenzene	3.5	0.75		ug/m3	1	2/27/2013 5:28:00 AM
1,2-Dibromoethane	< 1.2	1.2		ug/m3	1	2/27/2013 5:28:00 AM
1,2-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 5:28:00 AM
1,2-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 5:28:00 AM
1,2-Dichloropropane	< 0.70	0.70		ug/m3	1	2/27/2013 5:28:00 AM
1,3,5-Trimethylbenzene	0.90	0.75		ug/m3	1	2/27/2013 5:28:00 AM
1,3-butadiene	< 0.34	0.34		ug/m3	1	2/27/2013 5:28:00 AM
1,3-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 5:28:00 AM
1,4-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 5:28:00 AM
1,4-Dioxane	< 1.1	1.1		ug/m3	1	2/27/2013 5:28:00 AM
2,2,4-trimethylpentane	2.2	0.71		ug/m3	1	2/27/2013 5:28:00 AM
4-ethyltoluene	1.3	0.75		ug/m3	1	2/27/2013 5:28:00 AM
Acetone	35	7.2		ug/m3	10	2/27/2013 5:34:00 PM
Allyl chloride	< 0.48	0.48		ug/m3	1	2/27/2013 5:28:00 AM
Benzene	20	4.9		ug/m3	10	2/27/2013 5:34:00 PM
Benzyl chloride	< 0.88	0.88		ug/m3	1	2/27/2013 5:28:00 AM
Bromodichloromethane	< 1.0	1.0		ug/m3	1	2/27/2013 5:28:00 AM
Bromoform	< 1.6	1.6		ug/m3	1	2/27/2013 5:28:00 AM
Bromomethane	< 0.59	0.59		ug/m3	1	2/27/2013 5:28:00 AM
Carbon disulfide	21	4.7		ug/m3	10	2/27/2013 5:34:00 PM
Carbon tetrachloride	< 0.96	0.96		ug/m3	1	2/27/2013 5:28:00 AM
Chlorobenzene	< 0.70	0.70		ug/m3	1	2/27/2013 5:28:00 AM
Chloroethane	< 0.40	0.40		ug/m3	1	2/27/2013 5:28:00 AM
Chloroform	7.3	0.74		ug/m3	1	2/27/2013 5:28:00 AM
Chloromethane	< 0.31	0.31		ug/m3	1	2/27/2013 5:28:00 AM
cis-1,2-Dichloroethene	0.73	0.60		ug/m3	1	2/27/2013 5:28:00 AM
cis-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 5:28:00 AM
Cyclohexane	120	21		ug/m3	40	2/27/2013 6:07:00 PM
Dibromochloromethane	< 1.3	1.3		ug/m3	1	2/27/2013 5:28:00 AM
Ethyl acetate	< 0.92	0.92		ug/m3	1	2/27/2013 5:28:00 AM
Ethylbenzene	4.7	0.66		ug/m3	1	2/27/2013 5:28:00 AM
Freon 11	1.1	0.86		ug/m3	1	2/27/2013 5:28:00 AM
Freon 113	< 1.2	1.2		ug/m3	1	2/27/2013 5:28:00 AM
Freon 114	< 1.1	1.1		ug/m3	1	2/27/2013 5:28:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-008A

Client Sample ID: 4-SS
Tag Number: 275,245
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 BY METHOD TO15		TO-15		Analyst: RJP		
Freon 12	4.3	0.75		ug/m3	1	2/27/2013 5:28:00 AM
Heptane	110	25		ug/m3	40	2/27/2013 6:07:00 PM
Hexachloro-1,3-butadiene	< 1.6	1.6		ug/m3	1	2/27/2013 5:28:00 AM
Hexane	110	21		ug/m3	40	2/27/2013 6:07:00 PM
Isopropyl alcohol	< 0.37	0.37		ug/m3	1	2/27/2013 5:28:00 AM
m&p-Xylene	13	1.3		ug/m3	1	2/27/2013 5:28:00 AM
Methyl Butyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 5:28:00 AM
Methyl Ethyl Ketone	10	9.0		ug/m3	10	2/27/2013 5:34:00 PM
Methyl Isobutyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 5:28:00 AM
Methyl tert-butyl ether	< 0.55	0.55		ug/m3	1	2/27/2013 5:28:00 AM
Methylene chloride	0.49	0.53	J	ug/m3	1	2/27/2013 5:28:00 AM
o-Xylene	3.3	0.66		ug/m3	1	2/27/2013 5:28:00 AM
Propylene	< 0.26	0.26		ug/m3	1	2/27/2013 5:28:00 AM
Styrene	< 0.65	0.65		ug/m3	1	2/27/2013 5:28:00 AM
Tetrachloroethylene	6.1	1.0		ug/m3	1	2/27/2013 5:28:00 AM
Tetrahydrofuran	< 0.45	0.45		ug/m3	1	2/27/2013 5:28:00 AM
Toluene	62	5.7		ug/m3	10	2/27/2013 5:34:00 PM
trans-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 5:28:00 AM
trans-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 5:28:00 AM
Trichloroethene	16	8.2		ug/m3	10	2/27/2013 5:34:00 PM
Vinyl acetate	< 0.54	0.54		ug/m3	1	2/27/2013 5:28:00 AM
Vinyl Bromide	< 0.67	0.67		ug/m3	1	2/27/2013 5:28:00 AM
Vinyl chloride	< 0.39	0.39		ug/m3	1	2/27/2013 5:28:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-009A

Client Sample ID: 4-Indoor
Tag Number: 411,156
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 W/ 0.25UG/M3 CT-TCE-VC			TO-15			Analyst: RJP
1,1,1-Trichloroethane	< 0.83	0.83		ug/m3	1	2/27/2013 1:03:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		ug/m3	1	2/27/2013 1:03:00 AM
1,1,2-Trichloroethane	< 0.83	0.83		ug/m3	1	2/27/2013 1:03:00 AM
1,1-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 1:03:00 AM
1,1-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 1:03:00 AM
1,2,4-Trichlorobenzene	< 1.1	1.1		ug/m3	1	2/27/2013 1:03:00 AM
1,2,4-Trimethylbenzene	1.1	0.75		ug/m3	1	2/27/2013 1:03:00 AM
1,2-Dibromoethane	< 1.2	1.2		ug/m3	1	2/27/2013 1:03:00 AM
1,2-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 1:03:00 AM
1,2-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 1:03:00 AM
1,2-Dichloropropane	< 0.70	0.70		ug/m3	1	2/27/2013 1:03:00 AM
1,3,5-Trimethylbenzene	< 0.75	0.75		ug/m3	1	2/27/2013 1:03:00 AM
1,3-butadiene	< 0.34	0.34		ug/m3	1	2/27/2013 1:03:00 AM
1,3-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 1:03:00 AM
1,4-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 1:03:00 AM
1,4-Dioxane	< 1.1	1.1		ug/m3	1	2/27/2013 1:03:00 AM
2,2,4-trimethylpentane	< 0.71	0.71		ug/m3	1	2/27/2013 1:03:00 AM
4-ethyltoluene	< 0.75	0.75		ug/m3	1	2/27/2013 1:03:00 AM
Acetone	5.0	0.72		ug/m3	1	2/27/2013 1:03:00 AM
Allyl chloride	< 0.48	0.48		ug/m3	1	2/27/2013 1:03:00 AM
Benzene	0.58	0.49		ug/m3	1	2/27/2013 1:03:00 AM
Benzyl chloride	< 0.88	0.88		ug/m3	1	2/27/2013 1:03:00 AM
Bromodichloromethane	< 1.0	1.0		ug/m3	1	2/27/2013 1:03:00 AM
Bromoform	< 1.6	1.6		ug/m3	1	2/27/2013 1:03:00 AM
Bromomethane	< 0.59	0.59		ug/m3	1	2/27/2013 1:03:00 AM
Carbon disulfide	< 0.47	0.47		ug/m3	1	2/27/2013 1:03:00 AM
Carbon tetrachloride	< 0.26	0.26		ug/m3	1	2/27/2013 1:03:00 AM
Chlorobenzene	< 0.70	0.70		ug/m3	1	2/27/2013 1:03:00 AM
Chloroethane	< 0.40	0.40		ug/m3	1	2/27/2013 1:03:00 AM
Chloroform	< 0.74	0.74		ug/m3	1	2/27/2013 1:03:00 AM
Chloromethane	0.90	0.31		ug/m3	1	2/27/2013 1:03:00 AM
cis-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 1:03:00 AM
cis-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 1:03:00 AM
Cyclohexane	2.0	0.52		ug/m3	1	2/27/2013 1:03:00 AM
Dibromochloromethane	< 1.3	1.3		ug/m3	1	2/27/2013 1:03:00 AM
Ethyl acetate	< 0.92	0.92		ug/m3	1	2/27/2013 1:03:00 AM
Ethylbenzene	< 0.66	0.66		ug/m3	1	2/27/2013 1:03:00 AM
Freon 11	1.3	0.86		ug/m3	1	2/27/2013 1:03:00 AM
Freon 113	< 1.2	1.2		ug/m3	1	2/27/2013 1:03:00 AM
Freon 114	< 1.1	1.1		ug/m3	1	2/27/2013 1:03:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-009A

Client Sample ID: 4-Indoor
Tag Number: 411,156
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 W/ 0.25UG/M3 CT-TCE-VC		TO-15		Analyst: RJP		
Freon 12	2.6	0.75		ug/m3	1	2/27/2013 1:03:00 AM
Heptane	< 0.62	0.62		ug/m3	1	2/27/2013 1:03:00 AM
Hexachloro-1,3-butadiene	< 1.6	1.6		ug/m3	1	2/27/2013 1:03:00 AM
Hexane	1.8	0.54		ug/m3	1	2/27/2013 1:03:00 AM
Isopropyl alcohol	< 0.37	0.37		ug/m3	1	2/27/2013 1:03:00 AM
m&p-Xylene	0.62	1.3	J	ug/m3	1	2/27/2013 1:03:00 AM
Methyl Butyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 1:03:00 AM
Methyl Ethyl Ketone	1.4	0.90		ug/m3	1	2/27/2013 1:03:00 AM
Methyl Isobutyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 1:03:00 AM
Methyl tert-butyl ether	< 0.55	0.55		ug/m3	1	2/27/2013 1:03:00 AM
Methylene chloride	0.56	0.53		ug/m3	1	2/27/2013 1:03:00 AM
o-Xylene	< 0.66	0.66		ug/m3	1	2/27/2013 1:03:00 AM
Propylene	< 0.26	0.26		ug/m3	1	2/27/2013 1:03:00 AM
Styrene	< 0.65	0.65		ug/m3	1	2/27/2013 1:03:00 AM
Tetrachloroethylene	< 1.0	1.0		ug/m3	1	2/27/2013 1:03:00 AM
Tetrahydrofuran	2.0	0.45		ug/m3	1	2/27/2013 1:03:00 AM
Toluene	0.88	0.57		ug/m3	1	2/27/2013 1:03:00 AM
trans-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 1:03:00 AM
trans-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 1:03:00 AM
Trichloroethene	< 0.22	0.22		ug/m3	1	2/27/2013 1:03:00 AM
Vinyl acetate	< 0.54	0.54		ug/m3	1	2/27/2013 1:03:00 AM
Vinyl Bromide	< 0.67	0.67		ug/m3	1	2/27/2013 1:03:00 AM
Vinyl chloride	< 0.10	0.10		ug/m3	1	2/27/2013 1:03:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-010A

Client Sample ID: 5-SS
Tag Number: 159,300
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 BY METHOD TO15			TO-15		Analyst: RJP	
1,1,1-Trichloroethane	0.72	0.83	J	ug/m3	1	2/27/2013 6:01:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		ug/m3	1	2/27/2013 6:01:00 AM
1,1,2-Trichloroethane	< 0.83	0.83		ug/m3	1	2/27/2013 6:01:00 AM
1,1-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 6:01:00 AM
1,1-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 6:01:00 AM
1,2,4-Trichlorobenzene	< 1.1	1.1		ug/m3	1	2/27/2013 6:01:00 AM
1,2,4-Trimethylbenzene	1.9	0.75		ug/m3	1	2/27/2013 6:01:00 AM
1,2-Dibromoethane	< 1.2	1.2		ug/m3	1	2/27/2013 6:01:00 AM
1,2-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 6:01:00 AM
1,2-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 6:01:00 AM
1,2-Dichloropropane	< 0.70	0.70		ug/m3	1	2/27/2013 6:01:00 AM
1,3,5-Trimethylbenzene	0.55	0.75	J	ug/m3	1	2/27/2013 6:01:00 AM
1,3-butadiene	< 0.34	0.34		ug/m3	1	2/27/2013 6:01:00 AM
1,3-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 6:01:00 AM
1,4-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 6:01:00 AM
1,4-Dioxane	< 1.1	1.1		ug/m3	1	2/27/2013 6:01:00 AM
2,2,4-trimethylpentane	0.66	0.71	J	ug/m3	1	2/27/2013 6:01:00 AM
4-ethyltoluene	0.90	0.75		ug/m3	1	2/27/2013 6:01:00 AM
Acetone	39	7.2		ug/m3	10	2/27/2013 6:41:00 PM
Allyl chloride	< 0.48	0.48		ug/m3	1	2/27/2013 6:01:00 AM
Benzene	22	4.9		ug/m3	10	2/27/2013 6:41:00 PM
Benzyl chloride	< 0.88	0.88		ug/m3	1	2/27/2013 6:01:00 AM
Bromodichloromethane	< 1.0	1.0		ug/m3	1	2/27/2013 6:01:00 AM
Bromoform	< 1.6	1.6		ug/m3	1	2/27/2013 6:01:00 AM
Bromomethane	< 0.59	0.59		ug/m3	1	2/27/2013 6:01:00 AM
Carbon disulfide	17	4.7		ug/m3	10	2/27/2013 6:41:00 PM
Carbon tetrachloride	0.77	0.96	J	ug/m3	1	2/27/2013 6:01:00 AM
Chlorobenzene	< 0.70	0.70		ug/m3	1	2/27/2013 6:01:00 AM
Chloroethane	< 0.40	0.40		ug/m3	1	2/27/2013 6:01:00 AM
Chloroform	7.4	0.74		ug/m3	1	2/27/2013 6:01:00 AM
Chloromethane	< 0.31	0.31		ug/m3	1	2/27/2013 6:01:00 AM
cis-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 6:01:00 AM
cis-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 6:01:00 AM
Cyclohexane	200	21		ug/m3	40	2/27/2013 7:14:00 PM
Dibromochloromethane	< 1.3	1.3		ug/m3	1	2/27/2013 6:01:00 AM
Ethyl acetate	< 0.92	0.92		ug/m3	1	2/27/2013 6:01:00 AM
Ethylbenzene	2.3	0.66		ug/m3	1	2/27/2013 6:01:00 AM
Freon 11	1.5	0.86		ug/m3	1	2/27/2013 6:01:00 AM
Freon 113	< 1.2	1.2		ug/m3	1	2/27/2013 6:01:00 AM
Freon 114	< 1.1	1.1		ug/m3	1	2/27/2013 6:01:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-010A

Client Sample ID: 5-SS
Tag Number: 159,300
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 BY METHOD TO15		TO-15		Analyst: RJP		
Freon 12	5.3	0.75		ug/m3	1	2/27/2013 6:01:00 AM
Heptane	120	25		ug/m3	40	2/27/2013 7:14:00 PM
Hexachloro-1,3-butadiene	< 1.6	1.6		ug/m3	1	2/27/2013 6:01:00 AM
Hexane	200	21		ug/m3	40	2/27/2013 7:14:00 PM
Isopropyl alcohol	< 0.37	0.37		ug/m3	1	2/27/2013 6:01:00 AM
m&p-Xylene	6.2	1.3		ug/m3	1	2/27/2013 6:01:00 AM
Methyl Butyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 6:01:00 AM
Methyl Ethyl Ketone	6.9	0.90		ug/m3	1	2/27/2013 6:01:00 AM
Methyl Isobutyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 6:01:00 AM
Methyl tert-butyl ether	< 0.55	0.55		ug/m3	1	2/27/2013 6:01:00 AM
Methylene chloride	0.60	0.53		ug/m3	1	2/27/2013 6:01:00 AM
o-Xylene	1.8	0.66		ug/m3	1	2/27/2013 6:01:00 AM
Propylene	< 0.26	0.26		ug/m3	1	2/27/2013 6:01:00 AM
Styrene	< 0.65	0.65		ug/m3	1	2/27/2013 6:01:00 AM
Tetrachloroethylene	12	1.0		ug/m3	1	2/27/2013 6:01:00 AM
Tetrahydrofuran	< 0.45	0.45		ug/m3	1	2/27/2013 6:01:00 AM
Toluene	31	5.7		ug/m3	10	2/27/2013 6:41:00 PM
trans-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 6:01:00 AM
trans-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 6:01:00 AM
Trichloroethene	0.60	0.82	J	ug/m3	1	2/27/2013 6:01:00 AM
Vinyl acetate	< 0.54	0.54		ug/m3	1	2/27/2013 6:01:00 AM
Vinyl Bromide	< 0.67	0.67		ug/m3	1	2/27/2013 6:01:00 AM
Vinyl chloride	< 0.39	0.39		ug/m3	1	2/27/2013 6:01:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-011A

Client Sample ID: 5-Indoor
Tag Number: 355,272
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 W/ 0.25UG/M3 CT-TCE-VC		TO-15		Analyst: RJP		
1,1,1-Trichloroethane	< 0.83	0.83		ug/m3	1	2/27/2013 1:36:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		ug/m3	1	2/27/2013 1:36:00 AM
1,1,2-Trichloroethane	< 0.83	0.83		ug/m3	1	2/27/2013 1:36:00 AM
1,1-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 1:36:00 AM
1,1-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 1:36:00 AM
1,2,4-Trichlorobenzene	< 1.1	1.1		ug/m3	1	2/27/2013 1:36:00 AM
1,2,4-Trimethylbenzene	1.3	0.75		ug/m3	1	2/27/2013 1:36:00 AM
1,2-Dibromoethane	< 1.2	1.2		ug/m3	1	2/27/2013 1:36:00 AM
1,2-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 1:36:00 AM
1,2-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 1:36:00 AM
1,2-Dichloropropane	< 0.70	0.70		ug/m3	1	2/27/2013 1:36:00 AM
1,3,5-Trimethylbenzene	< 0.75	0.75		ug/m3	1	2/27/2013 1:36:00 AM
1,3-butadiene	< 0.34	0.34		ug/m3	1	2/27/2013 1:36:00 AM
1,3-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 1:36:00 AM
1,4-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 1:36:00 AM
1,4-Dioxane	< 1.1	1.1		ug/m3	1	2/27/2013 1:36:00 AM
2,2,4-trimethylpentane	< 0.71	0.71		ug/m3	1	2/27/2013 1:36:00 AM
4-ethyltoluene	< 0.75	0.75		ug/m3	1	2/27/2013 1:36:00 AM
Acetone	5.7	0.72		ug/m3	1	2/27/2013 1:36:00 AM
Allyl chloride	< 0.48	0.48		ug/m3	1	2/27/2013 1:36:00 AM
Benzene	0.65	0.49		ug/m3	1	2/27/2013 1:36:00 AM
Benzyl chloride	< 0.88	0.88		ug/m3	1	2/27/2013 1:36:00 AM
Bromodichloromethane	< 1.0	1.0		ug/m3	1	2/27/2013 1:36:00 AM
Bromoform	< 1.6	1.6		ug/m3	1	2/27/2013 1:36:00 AM
Bromomethane	< 0.59	0.59		ug/m3	1	2/27/2013 1:36:00 AM
Carbon disulfide	< 0.47	0.47		ug/m3	1	2/27/2013 1:36:00 AM
Carbon tetrachloride	< 0.26	0.26		ug/m3	1	2/27/2013 1:36:00 AM
Chlorobenzene	< 0.70	0.70		ug/m3	1	2/27/2013 1:36:00 AM
Chloroethane	< 0.40	0.40		ug/m3	1	2/27/2013 1:36:00 AM
Chloroform	< 0.74	0.74		ug/m3	1	2/27/2013 1:36:00 AM
Chloromethane	0.84	0.31		ug/m3	1	2/27/2013 1:36:00 AM
cis-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 1:36:00 AM
cis-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 1:36:00 AM
Cyclohexane	2.4	0.52		ug/m3	1	2/27/2013 1:36:00 AM
Dibromochloromethane	< 1.3	1.3		ug/m3	1	2/27/2013 1:36:00 AM
Ethyl acetate	< 0.92	0.92		ug/m3	1	2/27/2013 1:36:00 AM
Ethylbenzene	< 0.66	0.66		ug/m3	1	2/27/2013 1:36:00 AM
Freon 11	1.3	0.86		ug/m3	1	2/27/2013 1:36:00 AM
Freon 113	< 1.2	1.2		ug/m3	1	2/27/2013 1:36:00 AM
Freon 114	< 1.1	1.1		ug/m3	1	2/27/2013 1:36:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-011A

Client Sample ID: 5-Indoor
Tag Number: 355,272
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 W/ 0.25UG/M3 CT-TCE-VC			TO-15			Analyst: RJP
Freon 12	2.7	0.75		ug/m3	1	2/27/2013 1:36:00 AM
Heptane	< 0.62	0.62		ug/m3	1	2/27/2013 1:36:00 AM
Hexachloro-1,3-butadiene	< 1.6	1.6		ug/m3	1	2/27/2013 1:36:00 AM
Hexane	2.2	0.54		ug/m3	1	2/27/2013 1:36:00 AM
Isopropyl alcohol	1.2	0.37		ug/m3	1	2/27/2013 1:36:00 AM
m&p-Xylene	0.66	1.3	J	ug/m3	1	2/27/2013 1:36:00 AM
Methyl Butyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 1:36:00 AM
Methyl Ethyl Ketone	1.5	0.90		ug/m3	1	2/27/2013 1:36:00 AM
Methyl Isobutyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 1:36:00 AM
Methyl tert-butyl ether	< 0.55	0.55		ug/m3	1	2/27/2013 1:36:00 AM
Methylene chloride	0.53	0.53		ug/m3	1	2/27/2013 1:36:00 AM
o-Xylene	< 0.66	0.66		ug/m3	1	2/27/2013 1:36:00 AM
Propylene	< 0.26	0.26		ug/m3	1	2/27/2013 1:36:00 AM
Styrene	< 0.65	0.65		ug/m3	1	2/27/2013 1:36:00 AM
Tetrachloroethylene	< 1.0	1.0		ug/m3	1	2/27/2013 1:36:00 AM
Tetrahydrofuran	2.6	0.45		ug/m3	1	2/27/2013 1:36:00 AM
Toluene	1.0	0.57		ug/m3	1	2/27/2013 1:36:00 AM
trans-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 1:36:00 AM
trans-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 1:36:00 AM
Trichloroethene	< 0.22	0.22		ug/m3	1	2/27/2013 1:36:00 AM
Vinyl acetate	< 0.54	0.54		ug/m3	1	2/27/2013 1:36:00 AM
Vinyl Bromide	< 0.67	0.67		ug/m3	1	2/27/2013 1:36:00 AM
Vinyl chloride	< 0.10	0.10		ug/m3	1	2/27/2013 1:36:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-012A

Client Sample ID: 6-SS
Tag Number: 95,266
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 BY METHOD TO15			TO-15		Analyst: RJP	
1,1,1-Trichloroethane	3.5	0.83		ug/m3	1	2/27/2013 6:35:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		ug/m3	1	2/27/2013 6:35:00 AM
1,1,2-Trichloroethane	< 0.83	0.83		ug/m3	1	2/27/2013 6:35:00 AM
1,1-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 6:35:00 AM
1,1-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 6:35:00 AM
1,2,4-Trichlorobenzene	< 1.1	1.1		ug/m3	1	2/27/2013 6:35:00 AM
1,2,4-Trimethylbenzene	< 0.75	0.75		ug/m3	1	2/27/2013 6:35:00 AM
1,2-Dibromoethane	< 1.2	1.2		ug/m3	1	2/27/2013 6:35:00 AM
1,2-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 6:35:00 AM
1,2-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 6:35:00 AM
1,2-Dichloropropane	< 0.70	0.70		ug/m3	1	2/27/2013 6:35:00 AM
1,3,5-Trimethylbenzene	< 0.75	0.75		ug/m3	1	2/27/2013 6:35:00 AM
1,3-butadiene	< 0.34	0.34		ug/m3	1	2/27/2013 6:35:00 AM
1,3-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 6:35:00 AM
1,4-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 6:35:00 AM
1,4-Dioxane	< 1.1	1.1		ug/m3	1	2/27/2013 6:35:00 AM
2,2,4-trimethylpentane	< 0.71	0.71		ug/m3	1	2/27/2013 6:35:00 AM
4-ethyltoluene	< 0.75	0.75		ug/m3	1	2/27/2013 6:35:00 AM
Acetone	25	7.2		ug/m3	10	2/27/2013 7:48:00 PM
Allyl chloride	< 0.48	0.48		ug/m3	1	2/27/2013 6:35:00 AM
Benzene	2.5	0.49		ug/m3	1	2/27/2013 6:35:00 AM
Benzyl chloride	< 0.88	0.88		ug/m3	1	2/27/2013 6:35:00 AM
Bromodichloromethane	< 1.0	1.0		ug/m3	1	2/27/2013 6:35:00 AM
Bromoform	< 1.6	1.6		ug/m3	1	2/27/2013 6:35:00 AM
Bromomethane	< 0.59	0.59		ug/m3	1	2/27/2013 6:35:00 AM
Carbon disulfide	27	4.7		ug/m3	10	2/27/2013 7:48:00 PM
Carbon tetrachloride	< 0.96	0.96		ug/m3	1	2/27/2013 6:35:00 AM
Chlorobenzene	< 0.70	0.70		ug/m3	1	2/27/2013 6:35:00 AM
Chloroethane	< 0.40	0.40		ug/m3	1	2/27/2013 6:35:00 AM
Chloroform	11	7.4		ug/m3	10	2/27/2013 7:48:00 PM
Chloromethane	< 0.31	0.31		ug/m3	1	2/27/2013 6:35:00 AM
cis-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 6:35:00 AM
cis-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 6:35:00 AM
Cyclohexane	39	5.2		ug/m3	10	2/27/2013 7:48:00 PM
Dibromochloromethane	< 1.3	1.3		ug/m3	1	2/27/2013 6:35:00 AM
Ethyl acetate	< 0.92	0.92		ug/m3	1	2/27/2013 6:35:00 AM
Ethylbenzene	< 0.66	0.66		ug/m3	1	2/27/2013 6:35:00 AM
Freon 11	0.86	0.86		ug/m3	1	2/27/2013 6:35:00 AM
Freon 113	< 1.2	1.2		ug/m3	1	2/27/2013 6:35:00 AM
Freon 114	< 1.1	1.1		ug/m3	1	2/27/2013 6:35:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-012A

Client Sample ID: 6-SS
Tag Number: 95,266
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 BY METHOD TO15			TO-15		Analyst: RJP	
Freon 12	14	7.5		ug/m3	10	2/27/2013 7:48:00 PM
Heptane	16	6.2		ug/m3	10	2/27/2013 7:48:00 PM
Hexachloro-1,3-butadiene	< 1.6	1.6		ug/m3	1	2/27/2013 6:35:00 AM
Hexane	37	5.4		ug/m3	10	2/27/2013 7:48:00 PM
Isopropyl alcohol	< 0.37	0.37		ug/m3	1	2/27/2013 6:35:00 AM
m&p-Xylene	0.57	1.3	J	ug/m3	1	2/27/2013 6:35:00 AM
Methyl Butyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 6:35:00 AM
Methyl Ethyl Ketone	3.7	0.90		ug/m3	1	2/27/2013 6:35:00 AM
Methyl Isobutyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 6:35:00 AM
Methyl tert-butyl ether	< 0.55	0.55		ug/m3	1	2/27/2013 6:35:00 AM
Methylene chloride	0.67	0.53		ug/m3	1	2/27/2013 6:35:00 AM
o-Xylene	< 0.66	0.66		ug/m3	1	2/27/2013 6:35:00 AM
Propylene	< 0.26	0.26		ug/m3	1	2/27/2013 6:35:00 AM
Styrene	< 0.65	0.65		ug/m3	1	2/27/2013 6:35:00 AM
Tetrachloroethylene	94	10		ug/m3	10	2/27/2013 7:48:00 PM
Tetrahydrofuran	< 0.45	0.45		ug/m3	1	2/27/2013 6:35:00 AM
Toluene	6.1	0.57		ug/m3	1	2/27/2013 6:35:00 AM
trans-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 6:35:00 AM
trans-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 6:35:00 AM
Trichloroethene	< 0.82	0.82		ug/m3	1	2/27/2013 6:35:00 AM
Vinyl acetate	< 0.54	0.54		ug/m3	1	2/27/2013 6:35:00 AM
Vinyl Bromide	< 0.67	0.67		ug/m3	1	2/27/2013 6:35:00 AM
Vinyl chloride	< 0.39	0.39		ug/m3	1	2/27/2013 6:35:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-013A

Client Sample ID: 6-Indoor
Tag Number: 365,253
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 W/ 0.25UG/M3 CT-TCE-VC		TO-15		Analyst: RJP		
1,1,1-Trichloroethane	< 0.83	0.83		ug/m3	1	2/27/2013 2:08:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		ug/m3	1	2/27/2013 2:08:00 AM
1,1,2-Trichloroethane	< 0.83	0.83		ug/m3	1	2/27/2013 2:08:00 AM
1,1-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 2:08:00 AM
1,1-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 2:08:00 AM
1,2,4-Trichlorobenzene	< 1.1	1.1		ug/m3	1	2/27/2013 2:08:00 AM
1,2,4-Trimethylbenzene	1.7	0.75		ug/m3	1	2/27/2013 2:08:00 AM
1,2-Dibromoethane	< 1.2	1.2		ug/m3	1	2/27/2013 2:08:00 AM
1,2-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 2:08:00 AM
1,2-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 2:08:00 AM
1,2-Dichloropropane	< 0.70	0.70		ug/m3	1	2/27/2013 2:08:00 AM
1,3,5-Trimethylbenzene	< 0.75	0.75		ug/m3	1	2/27/2013 2:08:00 AM
1,3-butadiene	< 0.34	0.34		ug/m3	1	2/27/2013 2:08:00 AM
1,3-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 2:08:00 AM
1,4-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 2:08:00 AM
1,4-Dioxane	< 1.1	1.1		ug/m3	1	2/27/2013 2:08:00 AM
2,2,4-trimethylpentane	< 0.71	0.71		ug/m3	1	2/27/2013 2:08:00 AM
4-ethyltoluene	< 0.75	0.75		ug/m3	1	2/27/2013 2:08:00 AM
Acetone	5.8	0.72		ug/m3	1	2/27/2013 2:08:00 AM
Allyl chloride	< 0.48	0.48		ug/m3	1	2/27/2013 2:08:00 AM
Benzene	0.68	0.49		ug/m3	1	2/27/2013 2:08:00 AM
Benzyl chloride	< 0.88	0.88		ug/m3	1	2/27/2013 2:08:00 AM
Bromodichloromethane	< 1.0	1.0		ug/m3	1	2/27/2013 2:08:00 AM
Bromoform	< 1.6	1.6		ug/m3	1	2/27/2013 2:08:00 AM
Bromomethane	< 0.59	0.59		ug/m3	1	2/27/2013 2:08:00 AM
Carbon disulfide	< 0.47	0.47		ug/m3	1	2/27/2013 2:08:00 AM
Carbon tetrachloride	< 0.26	0.26		ug/m3	1	2/27/2013 2:08:00 AM
Chlorobenzene	< 0.70	0.70		ug/m3	1	2/27/2013 2:08:00 AM
Chloroethane	< 0.40	0.40		ug/m3	1	2/27/2013 2:08:00 AM
Chloroform	< 0.74	0.74		ug/m3	1	2/27/2013 2:08:00 AM
Chloromethane	0.99	0.31		ug/m3	1	2/27/2013 2:08:00 AM
cis-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 2:08:00 AM
cis-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 2:08:00 AM
Cyclohexane	2.2	0.52		ug/m3	1	2/27/2013 2:08:00 AM
Dibromochloromethane	< 1.3	1.3		ug/m3	1	2/27/2013 2:08:00 AM
Ethyl acetate	< 0.92	0.92		ug/m3	1	2/27/2013 2:08:00 AM
Ethylbenzene	< 0.66	0.66		ug/m3	1	2/27/2013 2:08:00 AM
Freon 11	1.4	0.86		ug/m3	1	2/27/2013 2:08:00 AM
Freon 113	< 1.2	1.2		ug/m3	1	2/27/2013 2:08:00 AM
Freon 114	< 1.1	1.1		ug/m3	1	2/27/2013 2:08:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-013A

Client Sample ID: 6-Indoor
Tag Number: 365,253
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 W/ 0.25UG/M3 CT-TCE-VC			TO-15			Analyst: RJP
Freon 12	2.8	0.75		ug/m3	1	2/27/2013 2:08:00 AM
Heptane	< 0.62	0.62		ug/m3	1	2/27/2013 2:08:00 AM
Hexachloro-1,3-butadiene	< 1.6	1.6		ug/m3	1	2/27/2013 2:08:00 AM
Hexane	2.0	0.54		ug/m3	1	2/27/2013 2:08:00 AM
Isopropyl alcohol	2.3	0.37		ug/m3	1	2/27/2013 2:08:00 AM
m&p-Xylene	0.88	1.3	J	ug/m3	1	2/27/2013 2:08:00 AM
Methyl Butyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 2:08:00 AM
Methyl Ethyl Ketone	2.0	0.90		ug/m3	1	2/27/2013 2:08:00 AM
Methyl Isobutyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 2:08:00 AM
Methyl tert-butyl ether	< 0.55	0.55		ug/m3	1	2/27/2013 2:08:00 AM
Methylene chloride	0.74	0.53		ug/m3	1	2/27/2013 2:08:00 AM
o-Xylene	< 0.66	0.66		ug/m3	1	2/27/2013 2:08:00 AM
Propylene	< 0.26	0.26		ug/m3	1	2/27/2013 2:08:00 AM
Styrene	< 0.65	0.65		ug/m3	1	2/27/2013 2:08:00 AM
Tetrachloroethylene	< 1.0	1.0		ug/m3	1	2/27/2013 2:08:00 AM
Tetrahydrofuran	3.4	0.45		ug/m3	1	2/27/2013 2:08:00 AM
Toluene	1.4	0.57		ug/m3	1	2/27/2013 2:08:00 AM
trans-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 2:08:00 AM
trans-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 2:08:00 AM
Trichloroethene	< 0.22	0.22		ug/m3	1	2/27/2013 2:08:00 AM
Vinyl acetate	< 0.54	0.54		ug/m3	1	2/27/2013 2:08:00 AM
Vinyl Bromide	< 0.67	0.67		ug/m3	1	2/27/2013 2:08:00 AM
Vinyl chloride	< 0.10	0.10		ug/m3	1	2/27/2013 2:08:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-014A

Client Sample ID: Outdoor
Tag Number: 567,304
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 W/ 0.25UG/M3 CT-TCE-VC		TO-15		Analyst: RJP		
1,1,1-Trichloroethane	< 0.83	0.83		ug/m3	1	2/27/2013 2:41:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		ug/m3	1	2/27/2013 2:41:00 AM
1,1,2-Trichloroethane	< 0.83	0.83		ug/m3	1	2/27/2013 2:41:00 AM
1,1-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 2:41:00 AM
1,1-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 2:41:00 AM
1,2,4-Trichlorobenzene	< 1.1	1.1		ug/m3	1	2/27/2013 2:41:00 AM
1,2,4-Trimethylbenzene	< 0.75	0.75		ug/m3	1	2/27/2013 2:41:00 AM
1,2-Dibromoethane	< 1.2	1.2		ug/m3	1	2/27/2013 2:41:00 AM
1,2-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 2:41:00 AM
1,2-Dichloroethane	< 0.62	0.62		ug/m3	1	2/27/2013 2:41:00 AM
1,2-Dichloropropane	< 0.70	0.70		ug/m3	1	2/27/2013 2:41:00 AM
1,3,5-Trimethylbenzene	< 0.75	0.75		ug/m3	1	2/27/2013 2:41:00 AM
1,3-butadiene	< 0.34	0.34		ug/m3	1	2/27/2013 2:41:00 AM
1,3-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 2:41:00 AM
1,4-Dichlorobenzene	< 0.92	0.92		ug/m3	1	2/27/2013 2:41:00 AM
1,4-Dioxane	< 1.1	1.1		ug/m3	1	2/27/2013 2:41:00 AM
2,2,4-trimethylpentane	< 0.71	0.71		ug/m3	1	2/27/2013 2:41:00 AM
4-ethyltoluene	< 0.75	0.75		ug/m3	1	2/27/2013 2:41:00 AM
Acetone	5.7	0.72		ug/m3	1	2/27/2013 2:41:00 AM
Allyl chloride	< 0.48	0.48		ug/m3	1	2/27/2013 2:41:00 AM
Benzene	0.55	0.49		ug/m3	1	2/27/2013 2:41:00 AM
Benzyl chloride	< 0.88	0.88		ug/m3	1	2/27/2013 2:41:00 AM
Bromodichloromethane	< 1.0	1.0		ug/m3	1	2/27/2013 2:41:00 AM
Bromoform	< 1.6	1.6		ug/m3	1	2/27/2013 2:41:00 AM
Bromomethane	< 0.59	0.59		ug/m3	1	2/27/2013 2:41:00 AM
Carbon disulfide	< 0.47	0.47		ug/m3	1	2/27/2013 2:41:00 AM
Carbon tetrachloride	< 0.26	0.26		ug/m3	1	2/27/2013 2:41:00 AM
Chlorobenzene	< 0.70	0.70		ug/m3	1	2/27/2013 2:41:00 AM
Chloroethane	< 0.40	0.40		ug/m3	1	2/27/2013 2:41:00 AM
Chloroform	< 0.74	0.74		ug/m3	1	2/27/2013 2:41:00 AM
Chloromethane	0.92	0.31		ug/m3	1	2/27/2013 2:41:00 AM
cis-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 2:41:00 AM
cis-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 2:41:00 AM
Cyclohexane	< 0.52	0.52		ug/m3	1	2/27/2013 2:41:00 AM
Dibromochloromethane	< 1.3	1.3		ug/m3	1	2/27/2013 2:41:00 AM
Ethyl acetate	< 0.92	0.92		ug/m3	1	2/27/2013 2:41:00 AM
Ethylbenzene	< 0.66	0.66		ug/m3	1	2/27/2013 2:41:00 AM
Freon 11	1.4	0.86		ug/m3	1	2/27/2013 2:41:00 AM
Freon 113	< 1.2	1.2		ug/m3	1	2/27/2013 2:41:00 AM
Freon 114	< 1.1	1.1		ug/m3	1	2/27/2013 2:41:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		

Centek Laboratories, LLC

Date: 01-Mar-13

CLIENT: LaBella Associates, P.C.
Lab Order: C1302061
Project: Walnut Street 213235
Lab ID: C1302061-014A

Client Sample ID: Outdoor
Tag Number: 567,304
Collection Date: 2/20/2013
Matrix: AIR

Analyses	Result	**Limit	Qual	Units	DF	Date Analyzed
1UG/M3 W/ 0.25UG/M3 CT-TCE-VC			TO-15			Analyst: RJP
Freon 12	2.8	0.75		ug/m3	1	2/27/2013 2:41:00 AM
Heptane	< 0.62	0.62		ug/m3	1	2/27/2013 2:41:00 AM
Hexachloro-1,3-butadiene	< 1.6	1.6		ug/m3	1	2/27/2013 2:41:00 AM
Hexane	< 0.54	0.54		ug/m3	1	2/27/2013 2:41:00 AM
Isopropyl alcohol	< 0.37	0.37		ug/m3	1	2/27/2013 2:41:00 AM
m&p-Xylene	< 1.3	1.3		ug/m3	1	2/27/2013 2:41:00 AM
Methyl Butyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 2:41:00 AM
Methyl Ethyl Ketone	0.84	0.90	J	ug/m3	1	2/27/2013 2:41:00 AM
Methyl Isobutyl Ketone	< 1.2	1.2		ug/m3	1	2/27/2013 2:41:00 AM
Methyl tert-butyl ether	< 0.55	0.55		ug/m3	1	2/27/2013 2:41:00 AM
Methylene chloride	< 0.53	0.53		ug/m3	1	2/27/2013 2:41:00 AM
o-Xylene	< 0.66	0.66		ug/m3	1	2/27/2013 2:41:00 AM
Propylene	< 0.26	0.26		ug/m3	1	2/27/2013 2:41:00 AM
Styrene	< 0.65	0.65		ug/m3	1	2/27/2013 2:41:00 AM
Tetrachloroethylene	< 1.0	1.0		ug/m3	1	2/27/2013 2:41:00 AM
Tetrahydrofuran	< 0.45	0.45		ug/m3	1	2/27/2013 2:41:00 AM
Toluene	0.73	0.57		ug/m3	1	2/27/2013 2:41:00 AM
trans-1,2-Dichloroethene	< 0.60	0.60		ug/m3	1	2/27/2013 2:41:00 AM
trans-1,3-Dichloropropene	< 0.69	0.69		ug/m3	1	2/27/2013 2:41:00 AM
Trichloroethene	< 0.22	0.22		ug/m3	1	2/27/2013 2:41:00 AM
Vinyl acetate	< 0.54	0.54		ug/m3	1	2/27/2013 2:41:00 AM
Vinyl Bromide	< 0.67	0.67		ug/m3	1	2/27/2013 2:41:00 AM
Vinyl chloride	< 0.10	0.10		ug/m3	1	2/27/2013 2:41:00 AM

Qualifiers:	**	Reporting Limit	.	Results reported are not blank corrected
	B	Analyte detected in the associated Method Blank	E	Value above quantitation range
	H	Holding times for preparation or analysis exceeded	J	Analyte detected at or below quantitation limits
	JN	Non-routine analyte. Quantitation estimated.	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits		



143 Midler Park Drive
Syracuse, NY 13206
315-431-9730
www.CentekLabs.com

Vapor Intrusion & IAQ

Centek Chain of Custody

Site Name: <u>Walmart Supercenter</u>	Detection Limit	Report Level
Project: <u>213235</u>	☐ 5ppbv	☐ Level I
PO#: _____	☒ 1ug/M3	☒ Level II
Quote # <u>Q-SP/80</u>	☒ 1ug/M3 +TCE .25	☐ Cat "B" Like
Other: <u>3506</u>		

Turnaround Time:	Check One	Rush TAT	Due Date:	Company: <u>LABELLA ASSOCIATES</u>	Report to:	Address: <u>300 STATE ST</u>	City, State, Zip: <u>ROCHESTER, NY 14614</u>	Invoice to:	Address: <u>SAME</u>	City, State, Zip:
5 Business Days	☒	0%								
4 Business Days	☐	25%								
3 Business Days	☐	50%								
2 Business Days	☐	75%								
Next Day by 5pm	☐	100%								
Next Day by Noon	☐	150%								
Same Day	☐	200%								

Sample ID	Date Sampled	Canister Number	Regulator Number	Analysis Request	Comments	Vacuum Start/Stop
-----------	--------------	-----------------	------------------	------------------	----------	-------------------

1-55	2/20/13	1184	1745	10-15		11:05/14:45
1-Indoor (1)		1195	293			11:07/16:05
1-Indoor (2)		248	1125		HOLD	12:50/15:20
2-55		192	1159			11:39/15:12
2-Indoor		320	268			11:40/15:50
3-55		419	1153			11:52/15:37
3-Indoor		370	143			11:55/15:37
4-55		275	295			12:07/15:30
4-Indoor		411	156			12:09/16:00
5-55		159	300			12:20/15:15
5-Indoor		355	272			12:22/16:10
6-55		95	266			12:40/15:50
6-Indoor		365	253			12:42/16:15
Outdoor		567	304			11:10/15:45

Chain of Custody	Print Name	Signature	Date/Time	Carrier: CIRCLE ONE
------------------	------------	-----------	-----------	---------------------

Sampled by:	<u>JENNIFER GILLEN</u>	<u>[Signature]</u>	<u>2/20/13</u>	☒ UPS Pickup/Dropoff
-------------	------------------------	--------------------	----------------	--

Relinquished by:	<u>JENNIFER GILLEN</u>	<u>[Signature]</u>	<u>2/20/13</u>	
------------------	------------------------	--------------------	----------------	--

Received at Lab by:	<u>SAN SADA</u>	<u>[Signature]</u>	<u>2/22/13</u>	Mark Order # <u>21322061</u>
---------------------	-----------------	--------------------	----------------	------------------------------

*** By signing Centek Labs Chain of Custody, you are accepting Centek Labs Terms and Conditions listed on the reverse side.



LaBella Associates, P.C.
300 State Street
Rochester, New York 14614

Appendix B

Documentation of Building & Site-Specific Conditions

**NEW YORK STATE DEPARTMENT OF HEALTH
INDOOR AIR QUALITY QUESTIONNAIRE AND BUILDING INVENTORY
CENTER FOR ENVIRONMENTAL HEALTH**

This form must be completed for each residence involved in indoor air testing.

Preparer's Name JEN GILLEN Date/Time Prepared 2/20/13 13:00

Preparer's Affiliation ENV. CONSULTANT Phone No. _____

Purpose of Investigation SVI ASSESSMENT

1. OCCUPANT: NA

Interviewed: Y ☒ N ☐

Last Name: _____ First Name: _____

Address: _____

County: _____

Home Phone: _____ Office Phone: _____

Number of Occupants/persons at this location _____ Age of Occupants _____

2. OWNER OR LANDLORD: (Check if same as occupant ____)

Interviewed: Y ☒ N ☐

Last Name: KEVIN VAN DUSEN First Name: KEVIN

Address: 210 WALNUT ST., LOCKPORT, NY

County: NIAGARA

Home Phone: _____ Office Phone: _____

3. BUILDING CHARACTERISTICS

Type of Building: (Circle appropriate response)

Residential
☒ Industrial

School
Church

Commercial/Multi-use
Other: _____

If the property is residential, type? (Circle appropriate response)

Ranch	2-Family	3-Family
Raised Ranch	Split Level	Colonial
Cape Cod	Contemporary	Mobile Home
Duplex	Apartment House	Townhouses/Condos
Modular	Log Home	Other: _____

If multiple units, how many? _____

If the property is commercial, type?

Business Type(s) _____

Does it include residences (i.e., multi-use)? Y / N If yes, how many? _____

Other characteristics:

Number of floors 3

Building age ~1900

Is the building insulated? Y / (N)

How air tight? Tight / Average / Not Tight

4. AIRFLOW NA

Use air current tubes or tracer smoke to evaluate airflow patterns and qualitatively describe:

Airflow between floors

Airflow near source

Outdoor air infiltration

Infiltration into air ducts

5. BASEMENT AND CONSTRUCTION CHARACTERISTICS (Circle all that apply)

- a. Above grade construction: wood frame concrete stone brick
- b. Basement type: full crawlspace slab other _____
- c. ^{1st} ~~Basement~~ floor: concrete dirt stone other _____
- d. ^{2nd} ~~Basement~~ floor: uncovered covered covered with _____
- e. Concrete floor: unsealed sealed sealed with _____
- f. ^{1st Floor} ~~Foundation~~ walls: poured block stone other _____
- g. ^{2nd Floor} ~~Foundation~~ walls: unsealed sealed Bldg walls sealed with _____
- h. The basement is: NA wet damp dry moldy
- i. The basement is: NA finished unfinished partially finished
- j. Sump present? Y / N
- k. Water in sump? Y / N / not applicable

Basement/Lowest level depth below grade: _____ (feet)

Identify potential soil vapor entry points and approximate size (e.g., cracks, utility ports, drains)

(3) overhead doors w/ 1"-2" cracks @ base where door cannot completely close. Broken windows/other open features have been covered w/ poly + tape. (1) exhaust fan on SE corner of Bldg, ~12' above floor

6. HEATING, VENTING and AIR CONDITIONING (Circle all that apply)

Type of heating system(s) used in this building: (circle all that apply – note primary)

Hot air circulation	Heat pump	Hot water baseboard	Other <u>Bldg. vacant; No heating</u>
Space Heaters	Stream radiation	Radiant floor	
Electric baseboard	Wood stove	Outdoor wood boiler	

The primary type of fuel used is:

Natural Gas	Fuel Oil	Kerosene
Electric	Propane	Solar
Wood	Coal	

Domestic hot water tank fueled by: NABoiler/furnace located in: Basement Outdoors Main Floor Other NAAir conditioning: Central Air Window units Open Windows None

Are there air distribution ducts present?

Y / (N)

Describe the supply and cold air return ductwork, and its condition where visible, including whether there is a cold air return and the tightness of duct joints. Indicate the locations on the floor plan diagram.

NA

7. OCCUPANCY

Is basement/lowest level occupied?

Full-time

Occasionally

Seldom

Almost Never

*Not currently
Will be occupied.*

Level

General Use of Each Floor (e.g., familyroom, bedroom, laundry, workshop, storage)

Basement

1st Floor

2nd Floor

3rd Floor

4th Floor

8. FACTORS THAT MAY INFLUENCE INDOOR AIR QUALITY

↳ Some petroleum staining on floor.

a. Is there an attached garage?

Y / (N)

b. Does the garage have a separate heating unit?

Y / N / (NA)

c. Are petroleum-powered machines or vehicles stored in the garage (e.g., lawnmower, atv, car)

Y / N / (NA)

Please specify _____

d. Has the building ever had a fire?

Y / N When? UNKNOWN

e. Is a kerosene or unvented gas space heater present?

Y / (N) Where? _____

f. Is there a workshop or hobby/craft area?

Y / (N) Where & Type? _____

g. Is there smoking in the building?

Y / N How frequently? Bldg. Vacant

h. Have cleaning products been used recently?

Y / N When & Type? UNKNOWN

i. Have cosmetic products been used recently?

Y / N When & Type? UNKNOWN

- j. Has painting/staining been done in the last 6 months? Y / N Where & When? UNKNOWN
- k. Is there new carpet, drapes or other textiles? Y / N Where & When? _____
- l. Have air fresheners been used recently? Y / N When & Type? _____
- m. Is there a kitchen exhaust fan? Y / N If yes, where vented? _____
- n. Is there a bathroom exhaust fan? Y / N If yes, where vented? _____
- o. Is there a clothes dryer? Y / N If yes, is it vented outside? Y / N
- p. Has there been a pesticide application? Y / N When & Type? UNKNOWN

Are there odors in the building?

If yes, please describe: SLIGHT HYDRAULIC OIL ODOR; STAINING (PETRO.) ON FLOOR.

Do any of the building occupants use solvents at work? Y / N

(e.g., chemical manufacturing or laboratory, auto mechanic or auto body shop, painting, fuel oil delivery, boiler mechanic, pesticide application, cosmetologist)

If yes, what types of solvents are used? _____

If yes, are their clothes washed at work? Y / N

Do any of the building occupants regularly use or work at a dry-cleaning service? (Circle appropriate response)

- Yes, use dry-cleaning regularly (weekly)
 Yes, use dry-cleaning infrequently (monthly or less)
 Yes, work at a dry-cleaning service

No
Unknown

Is there a radon mitigation system for the building/structure? Y / N Date of Installation: _____
 Is the system active or passive? Active/Passive

9. WATER AND SEWAGE

Water Supply: Public Water Drilled Well Driven Well Dug Well Other: _____
 Sewage Disposal: Public Sewer Septic Tank Leach Field Dry Well Other: _____


10. RELOCATION INFORMATION (for oil spill residential emergency)

- a. Provide reasons why relocation is recommended: _____
- b. Residents choose to: remain in home relocate to friends/family relocate to hotel/motel
- c. Responsibility for costs associated with reimbursement explained? Y / N
- d. Relocation package provided and explained to residents? Y / N


11. FLOOR PLANS

Draw a plan view sketch of the basement and first floor of the building. Indicate air sampling locations, possible indoor air pollution sources and PID meter readings. If the building does not have a basement, please note.

Basement: *NA*

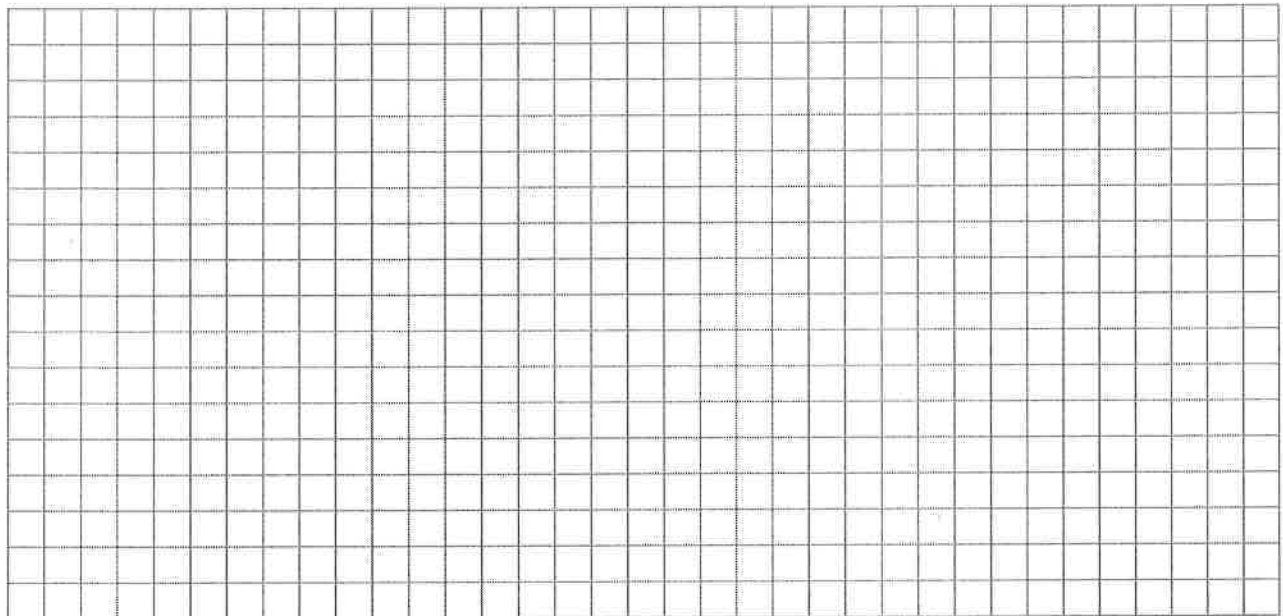

First Floor:

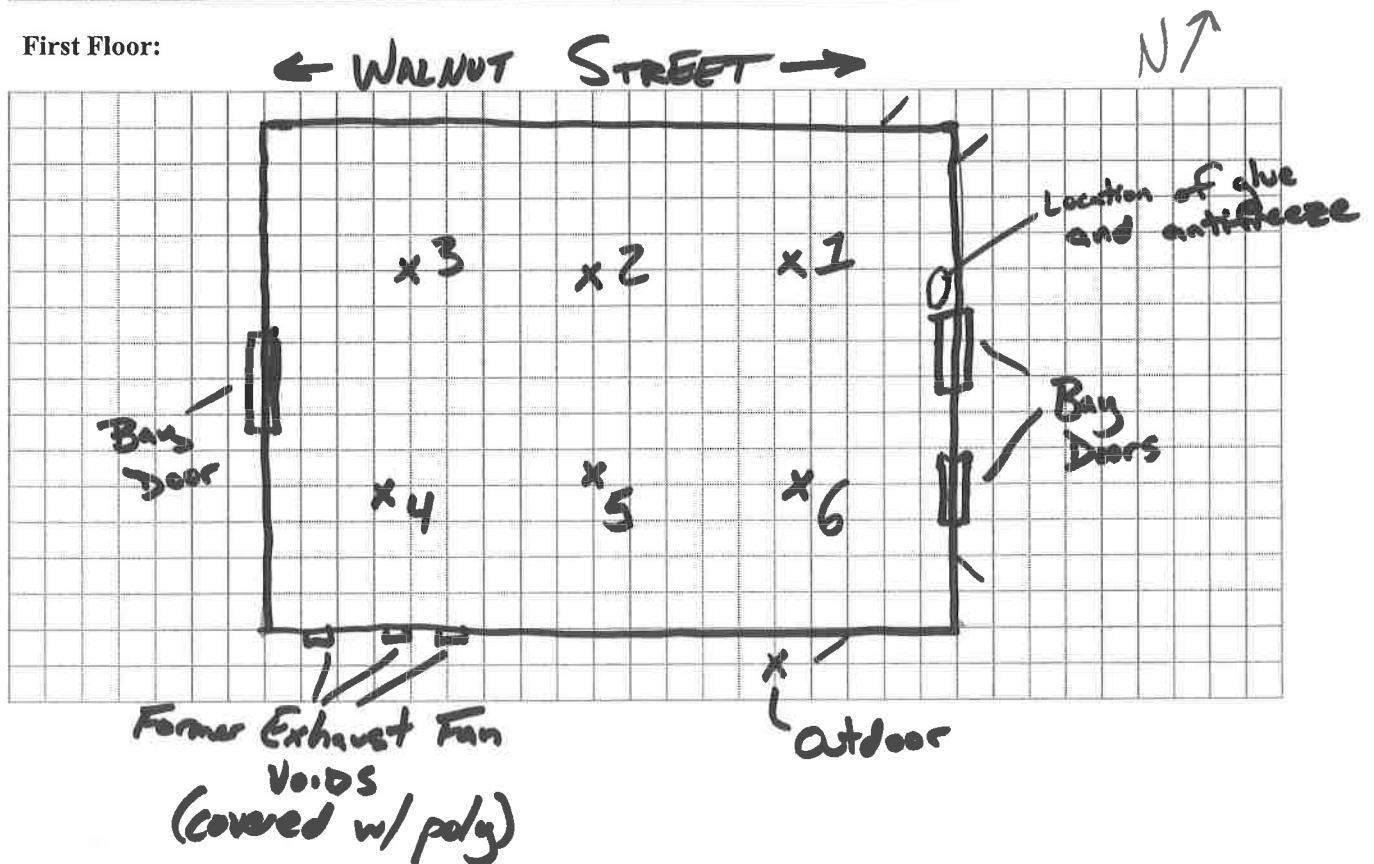

12. OUTDOOR PLOT

Draw a sketch of the area surrounding the building being sampled. If applicable, provide information on spill locations, potential air contamination sources (industries, gas stations, repair shops, landfills, etc.), outdoor air sampling location(s) and PID meter readings.

Also indicate compass direction, wind direction and speed during sampling, the locations of the well and septic system, if applicable, and a qualifying statement to help locate the site on a topographic map.

