

**ALASKAN OIL, INC
ROUTE 13 & CEMETERY STREET
ALTMAR, NEW YORK**

SPILL NO. 9614774

**GROUNDWATER/RECOVERY SYSTEM REPORT
THIRD QUARTER 2000
(JULY - SEPTEMBER)**

PREPARED FOR

**Alaskan Oil, Inc.
2020 Lemoyne Street
Syracuse, New York 13211**

PREPARED BY

**Barton & Loguidice, P.C.
Consulting Engineers
290 Elwood Davis Road
Box 3107
Syracuse, New York 13220**



January 16, 2001

Scott Blake
Alaskan Oil, Inc.
2020 LeMoyne Street
Syracuse, New York 13211

Re: Third Quarter 2000 Groundwater/Recovery System Monitoring Report
Altmar, New York – Alaskan Oil Site
File: 639.002

Dear Mr. Blake:

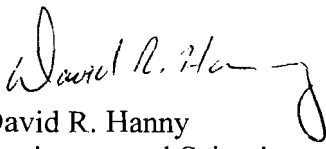
Please find attached the Third Quarter 2000 Groundwater/Recovery System Monitoring Report for the Altmar, New York Alaskan Oil site. Please note the recommendation to decrease sampling of the carbon treatment system to a quarterly basis (influent only). Barton & Loguidice, P.C. will continue to sample the influent, mid and effluent of the carbon treatment system until the recommendation is approved by the New York State Department of Environmental Conservation (NYSDEC).

A copy of the enclosed report will be forwarded to Harry Warner at the Region 7 NYSDEC, following your review and approval.

Please call if you have any questions regarding the report and notify me of approval to forward the report to Harry Warner.

Very truly yours,

BARTON & LOGUIDICE, P.C.


David R. Hanny
Environmental Scientist

DRH/jjk

cc: Harry Warner

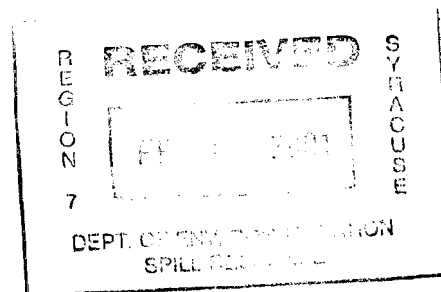


TABLE OF CONTENTS

PAGE

1.0	INTRODUCTION	1
2.0	GROUNDWATER MONITORING	1
3.0	RECOVERY SYSTEM MONITORING	2
4.0	HIVAC MONITORING	2
5.0	RECOMMENDATIONS	2

TABLES

Table 1 - Third Quarter 2000 Monitoring Well Data
Table 2 - Third Quarter 2000 Recovery System Data
Table 3 - Groundwater Elevation Data
Table 4 - HIVAC Monitoring Data

FIGURES

Figure 1 - Site Map and Groundwater Elevations
Figure 2 - Estimated BTEX Isopleth Map

APPENDICES

Appendix A - CES Laboratory Report Monitoring Well Data
Appendix B - CES Laboratory Report Recovery System Data
Appendix C - CES Laboratory Report HIVAC Monitoring Data
Appendix D - Historical Data Summary

1.0 INTRODUCTION

The following report presents the results of the Third Quarter 2000, monitoring at the Alaskan Oil, Inc. (AOI) property located at Route 13 and Cemetery Street in Altmar, New York. The site is part of the Multi-Site Response Program/Voluntary Cleanup Agreement, between AOI and the New York State Department of Environmental Conservation (NYSDEC), and monitoring is conducted for installed groundwater monitoring wells and a product recovery system.

2.0 GROUNDWATER MONITORING

Groundwater samples were collected from eight monitoring wells and the recovery well on August 8, 2000 by personnel from Clemett and Co. The samples were submitted to Certified Environmental Services for analysis of volatile petroleum hydrocarbons (EPA Method 8021). Six of the nine wells sampled exhibited volatile organic compounds (VOC's) in exceedence of DEC STARS Guidance Values. Table 1 summarizes the detected VOC's and the complete CES laboratory report is attached in Appendix A. Historical ground water data is attached in Appendix D.

Clemett and Co. personnel also measured the static water level of each well sampled on August 8, 2000. Table 3 illustrates the measured water levels and the groundwater elevations based on well surveying data conducted by CES. The groundwater elevations are also depicted on Figure 1. In general, groundwater appears to be flowing over a shallow gradient from east to west towards the wetland west of the site. As mentioned in the Second Quarter 2000 report, some of the monitoring points at the site may be influenced by the storm water drains at the facility. Due to the shallow gradient at the site, the possibility of storm drain influence upon water levels, and the uncertainty of the well casing survey data, groundwater contours were not delineated on Figure 1.

An activated carbon treatment system has been in operation on the site's drinking water supply since August 1998. Since sampling of the system commenced in September 1998, no volatile organic compounds have been detected in the effluent. The location of the drinking water supply well is up gradient from the spill, and therefore, is not impacted by the spill. Given the above, we recommend that the current monthly sampling of the treatment system be ceased. Since the site's water source is from the well and Alaskan Oil is currently remediating the site, the treatment system should be continued to be operated. Sampling of the system's influent only (EPA Method 502.2) should be conducted on a quarterly basis to ensure supply water quality during remediation efforts at the site. Influent, mid, and effluent samples will be collected from the carbon treatment system until NYSDEC approval of the above.

The HIVAC groundwater treatment system should be monitored following reactivation of the system. Influent, mid, and effluent samples should be analyzed by EPA Method 502.2.

Table 1
Monitoring Well Data (Detected Compounds Only)
Alaskan Oil, Inc.
Altmar Mini Mart
Rt. 13 & Cemetary Road

Detected Compounds	NYSDEC Guidance Values (ppb)*	Third Quarter 2000 (Results in ug/l) August 8, 2000								
		RW-1	MW-1	MW-4	MW-5	MW-6	MW-9	MW-10	MW-11	MW-12
Full EPA 8021										
Benzene	0.7	5,400	3,100	<0.7	14	5.6	<0.7	1,925	<0.7	7,700
Toluene	5	19,000	8,100	<1.0	28	<1.0	<1.0	15,000	<1.0	21,000
Ethylbenzene	5	2,250	1,800	<1.0	115	<1.0	<1.0	1,400	<1.0	3,400
Total Xylenes	5	25,050	12,000	<1.0	202	<1.0	<1.0	14,550	<1.0	19,200
n-Propylbenzene	5	<500	300	<1.0	45	<1.0	<1.0	<250	<1.0	524
1,3,5-Trimethylbenzene	5	1,600	1,150	<1.0	52	<1.0	<1.0	950	<1.0	1,700
1,2,4-Trimethylbenzene	5	4,400	3,100	<1.0	222	<1.0	<1.0	2,300	<1.0	4,700
n-Butylbenzene	5	650	510	<1.0	88	<1.0	<1.0	325	<1.0	700
Napthalene	10	1,500	920	<1.0	80	<1.0	<1.0	725	<1.0	1,700
BTEX	--	51,700	25,000	ND	359	5.6	ND	32,875	ND	51,300

Notes

*NYSDEC Guidance Values from June 1998 Memo

ug/l = part per billion

= Above DEC Guidance Values

ND = None Detected

DRH: 639.002



Table 2
Recovery System
Alaskan Oil, Inc.
Altmar Mini Mart
Rt. 13 & Cemetary Road

Detected Compounds	NYSDEC Guidance Values (ppb)*	Third Quarter 2000 (Results in ug/l)								
		July 27, 2000			August 11, 2000			September 12, 2000		
		Influent	Mid	Effluent	Influent	Mid	Effluent	Influent	Mid	Effluent
EPA Method 502.2										
Benzene	0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7
Trichloroethene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Toluene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Tetrachloroethene	0.7	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Chlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Ethylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Total Xylenes	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Styrene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Isopropyl benzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
n-Propylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Bromobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
2-Chlorotoluene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,3,5-Trimethylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
4-Chlorotoluene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
tert-Butylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,2,4-Trimethylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
sec-Butylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
p-Isopropyltoluene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,3-Dichlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,4-Dichlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
n-Butylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,2-Dichlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,2,4-Trichlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Hexachlorobenzene	0.04	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Napthalene	10	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,2,3-Trichlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
MTBE	50	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0

Notes

*NYSDEC Guidance Values from June 1998 Memo

ug/l = part per billion

ND = Above DEC Guidance Values

DRH: 639.002

Barton
& Loguidice, P.C.
Consulting Engineers

Table 3
Water Level Elevation Data
Alaskan Oil, Inc.
Altmar Mini Mart
Rt. 13 & Cemetery Road

	MW-1		MW-4		MW-5		MW-6		MW-9		MW-10		MW-11		MW-12	
	water level	elevation	water level	elevation	water level	elevation	water level	elevation	water level	elevation	water level	elevation	water level	elevation	water level	elevation
TOP OF PVC PIPE ELEVATION		100.00		99.65		99.23		100.50		99.46		99.87		99.47		99.21
Top of Screen ELEVATION		98.00		97.70		95.20		96.50		96.61		96.87		96.50		96.00
Depth to Bottom		11.90		13.80		14.25		14.50		13.40		13.60		13.15		13.80
DATE																
01/25/00	5.91	94.09	--	--	6.52	92.71	4.82	95.68	--	--	6.81	93.06	--	--	6.24	92.97
02/09/00	6.13	93.87	6.67	92.98	6.75	92.48	5.57	94.93	6.80	92.66	7.05	92.82	6.82	92.65	6.51	92.70
03/08/00	5.14	94.86	--	--	6.08	93.15	--	--	--	--	6.26	93.61	--	--	5.79	93.42
05/15/00	5.69	94.31	--	--	6.53	92.70	5.71	94.79	--	--	6.75	93.12	--	--	5.30	93.91
08/08/00	6.45	93.55	6.57	93.08	6.82	92.41	6.87	93.63	6.89	92.57	7.17	92.70	7.11	92.36	7.90	91.31

Table 4
HIVAC Monitoring
Alaskan Oil, Inc.
Altmar Mini Mart
Rt. 13 & Cemetary Road

Detected Compounds	NYSDEC Guidance Values (ppb)*	Third Quarter 2000 (Results in ug/l)		
		September 14, 2000		
		Influent	Mid	Effluent
<u>EPA Method 8021</u>				
Benzene	0.7	326	1.6	57
Toluene	5	710	6.0	202
Ethylbenzene	5	114	1.1	39
Total Xylenes	5	934	6.6	240
1,3,5-Trimethylbenzene	5	543	<1.0	10
1,2,4-Trimethylbenzene	5	142	<1.0	23
n-Butylbenzene	5	23	<1.0	<5.0
Napthalene	10	38	<1.0	<5.0
MTBE	50	<50	13	<25

Notes

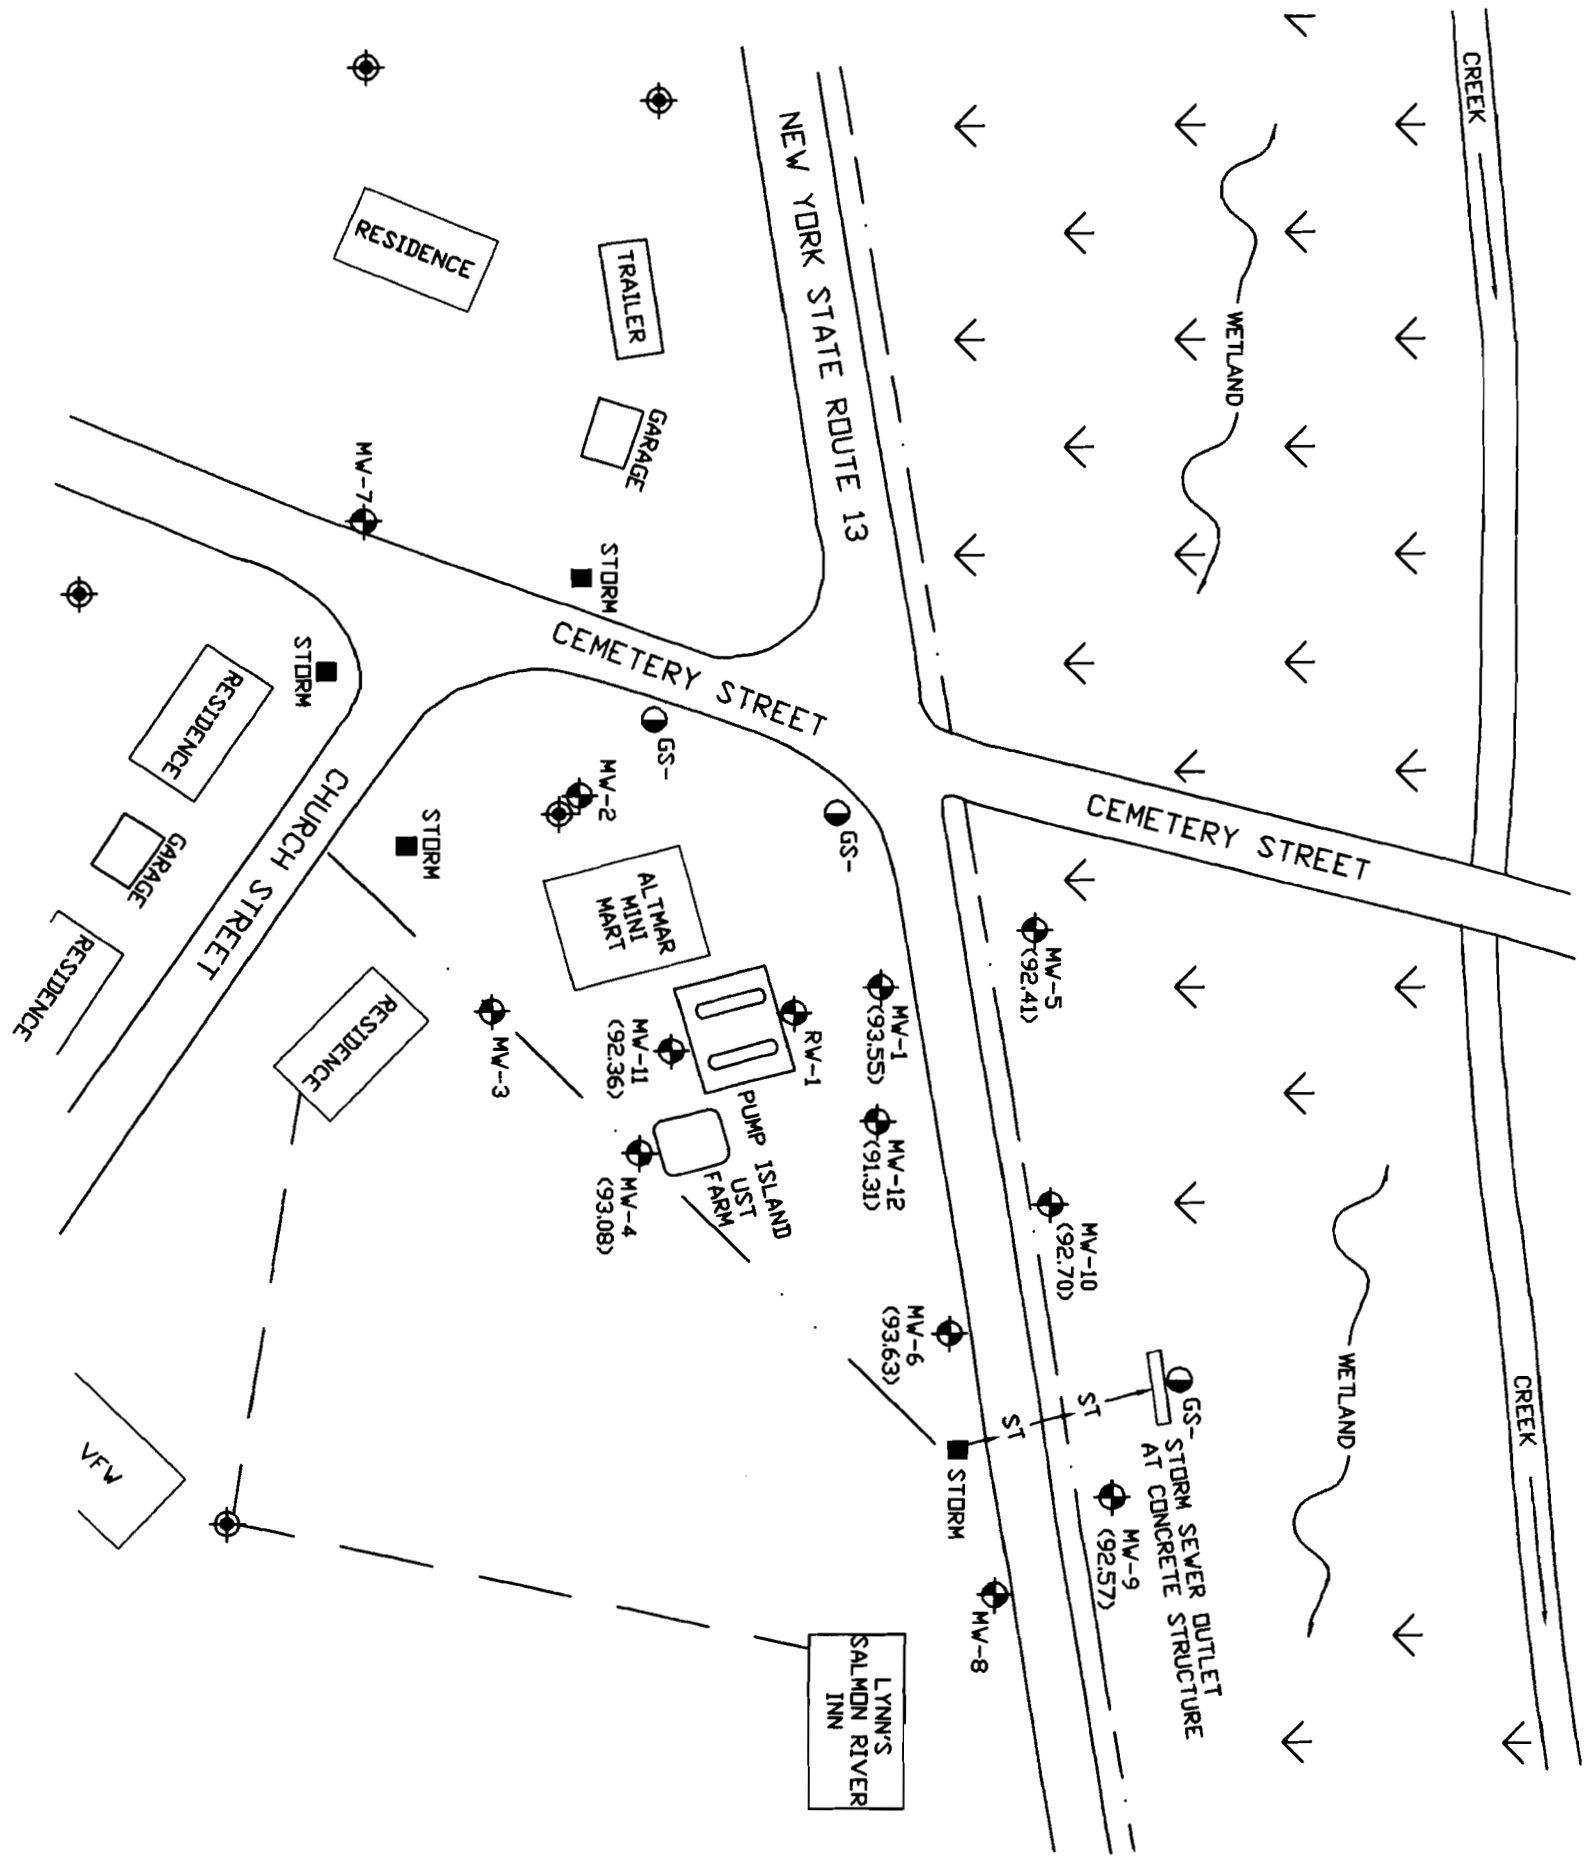
*NYSDEC Guidance Values from June 1998 Memo

ug/l = part per billion

 = Above DEC Guidance Values

DRH: 639.002





LEGEND:

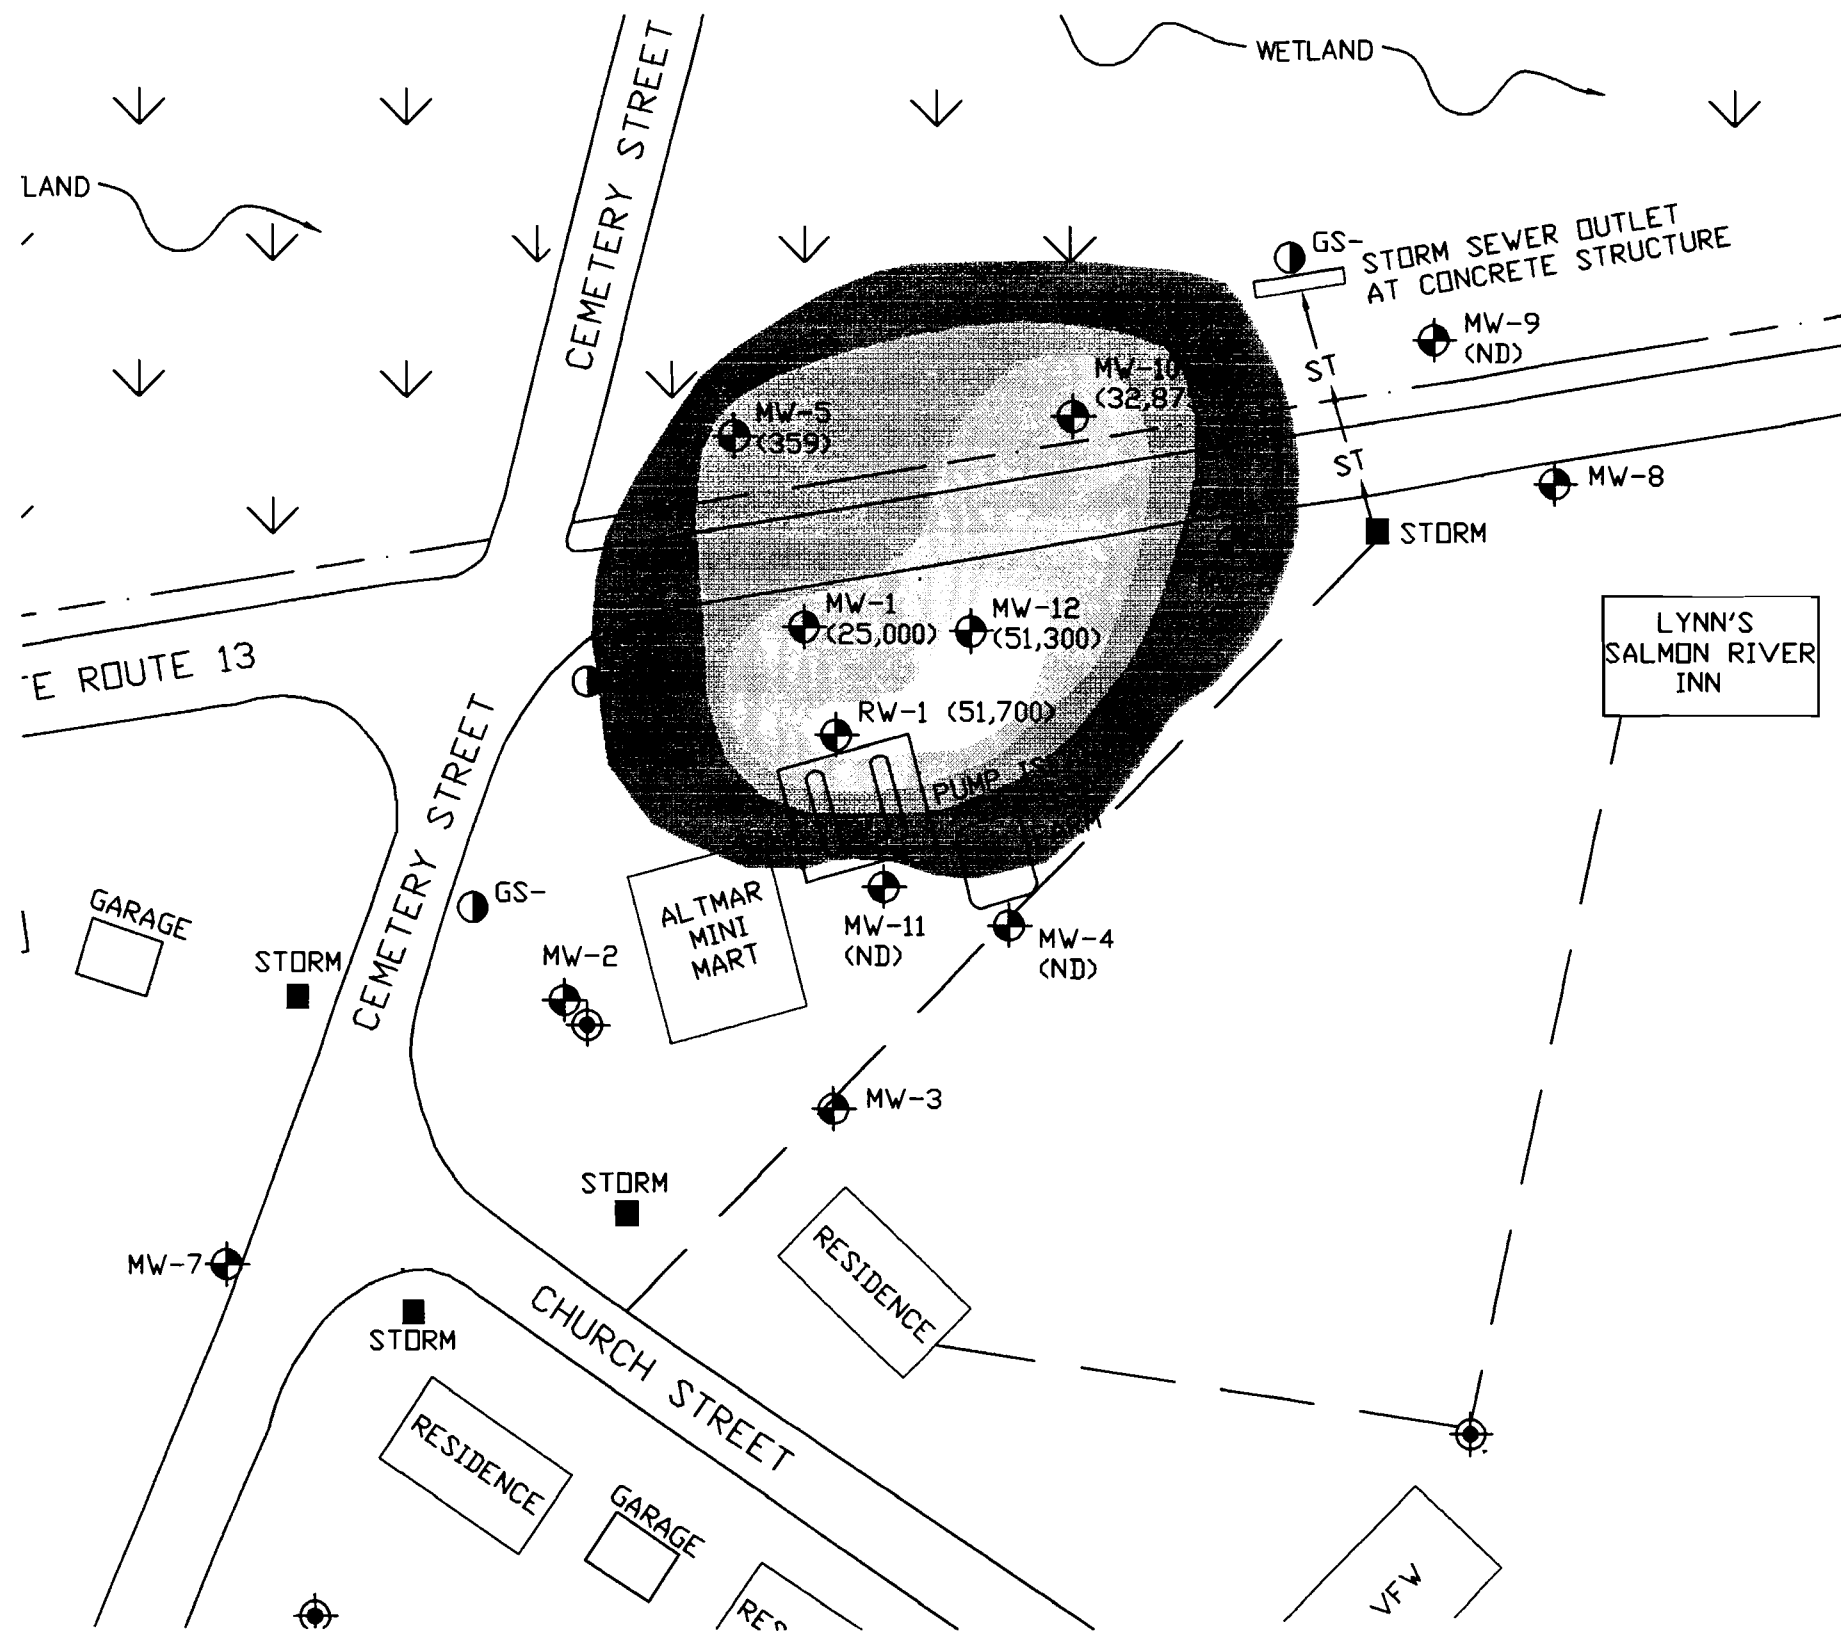
- GS- STORM CATCH BASIN
- STORM CATCH BASIN
- MW-1 (93.55) MONITORING WELL/ GROUNDWATER ELEVATION (8/8/00)
- DRINKING WATER WELL
- ST STORM SEWER LINE WITH FLOW DIRECTION
- PROPERTY BOUNDARY
- DRINKING WATER SUPPLY LINE

APPROXIMATE SCALE: 1:50'

Barton
Engineering, P.C.
Consulting Engineers
200 Elmwood Drive Road / Box 3107, Syracuse, New York 13220

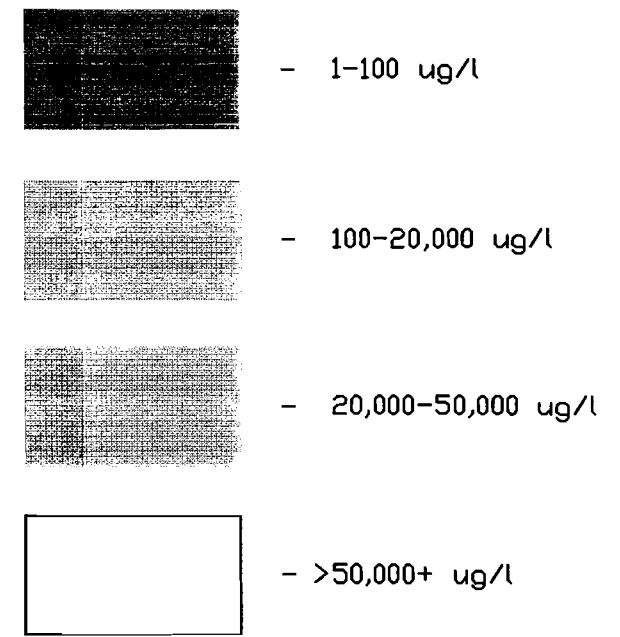
ALASKAN DIL, INC.
ROUTE 13 AND CEMETERY STREET
**SITE MAP & GROUND
WATER ELEVATIONS**
ALTMAR NEW YORK

Figure
1
Project No.
639.002



LEGEND:

- GS- - STORM CATCH BASIN
- - STORM CATCH BASIN
- MW-1 (25,000) - MONITORING WELL / BTEX COCENTRATION (8/8/00)
- - DRINKING WATER WELL
- ST — - STORM SEWER LINE WITH FLOW DIRECTION
- - - - - PROPERTY BOUNDARY
- — — — — DRINKING WATER SUPPLY LINE
- ND - NONE DETECTED (HYDROCARBONS)



APPROXIMATE SCALE: 1:50'

Barton
&L Loguidice, P.C.
 Consulting Engineers
 290 Elwood Davis Road / Box 3107, Syracuse, New York 13220

ALASKAN OIL, INC.
 ROUTE 13 AND CEMETERY STREET
ESTIMATED BTEX ISOPLETH MAP
 ALTMAR NEW YORK

Figure
2
 Project No.
639.002

APPENDIX A
CES LABORATORY REPORT
MONITORING WELL DATA

3rd Quarter 2000 Monitoring Well Gauging Data

Site: Altmar #326

Address: Altmar Mini-Mart, Route 13 & Cemetery Street, Altmar, NY

Clemett Job #: 99342

Date: August 8, 2000

	DTP	DTW	DTB
RW-1	NA	6.70	17.25
MW-1	6.55	6.45	11.90
MW-4	NA	6.57	13.80
MW-5	NA	6.82	14.25
MW-6	NA	6.87	14.50
MW-9	NA	6.89	13.40
MW-10	NA	7.17	13.60
MW-11	NA	7.11	13.15
MW-12	NA	7.90	13.80

DTW = Depth to Water

DTP = Depth to Product

DTB = Depth to Well Bottom

NS = Not Surveyed



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Clemett & Co. Inc.
P. O. Box 69
Syracuse, NY 13211-
Attn: Mr. Thomas DiCaprio

PROJECT NAME: 99342/AOI, #326-Altmar
DATE: 08/22/2000

SAMPLE NUMBER- 226131 SAMPLE ID- 99129/RW-1
DATE SAMPLED- 08/08/00
DATE RECEIVED- 08/09/00 SAMPLER- Jamie L. Costello
TIME RECEIVED- 1620 DELIVERED BY- Jamie Costello

SAMPLE MATRIX- WA
TIME SAMPLED- 1430
RECEIVED BY- CAM
TYPE SAMPLE- Grab

Page 1 of 3

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT UNITS
EPA 8021 SCAN	EPA 8021	08/17/00		BLD	
BENZENE	EPA 8021	08/17/00		BLD	5400 ug/L
BROMOBENZENE	EPA 8021	08/17/00		BLD	< 500 ug/L
BROMOCHLOROMETHANE	EPA 8021	08/17/00		BLD	< 500 ug/L
BROMODICHLOROMETHANE	EPA 8021	08/17/00		BLD	< 500 ug/L
BROMOFORM	EPA 8021	08/17/00		BLD	< 500 ug/L
BROMOMETHANE	EPA 8021	08/17/00		BLD	< 500 ug/L
N-BUTYLBENZENE	EPA 8021	08/17/00		BLD	650 ug/L
SEC-BUTYLBENZENE	EPA 8021	08/17/00		BLD	< 500 ug/L
TERT-BUTYLBENZENE	EPA 8021	08/17/00		BLD	< 500 ug/L
CARBON TETRACHLORIDE	EPA 8021	08/17/00		BLD	< 500 ug/L
CHLOROBENZENE	EPA 8021	08/17/00		BLD	< 500 ug/L
CHLORODIBROMOMETHANE	EPA 8021	08/17/00		BLD	< 500 ug/L
CHLOROETHANE	EPA 8021	08/17/00		BLD	< 500 ug/L
CHLOROFORM	EPA 8021	08/17/00		BLD	< 500 ug/L
CHLOROMETHANE	EPA 8021	08/17/00		BLD	< 500 ug/L
2-CHLOROTOLUENE	EPA 8021	08/17/00		BLD	< 500 ug/L
4-CHLOROTOLUENE	EPA 8021	08/17/00		BLD	< 500 ug/L
1,2-DIBROMO-3-CHLOROPROPANE	EPA 8021	08/17/00		BLD	< 500 ug/L
1,2-DIBROMOETHANE	EPA 8021	08/17/00		BLD	< 500 ug/L
DIBROMOMETHANE	EPA 8021	08/17/00		BLD	< 500 ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 2 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 226131

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
1,2-DICHLOROBENZENE	EPA 8021	08/17/00		BLD	< 500	ug/L
1,3-DICHLOROBENZENE	EPA 8021	08/17/00		BLD	< 500	ug/L
1,4-DICHLOROBENZENE	EPA 8021	08/17/00		BLD	< 500	ug/L
DICHLORODIFLUOROMETHANE	EPA 8021	08/17/00		BLD	< 500	ug/L
1,1-DICHLOROETHANE	EPA 8021	08/17/00		BLD	< 500	ug/L
1,2-DICHLOROETHANE	EPA 8021	08/17/00		BLD	< 500	ug/L
1,1-DICHLOROETHENE	EPA 8021	08/17/00		BLD	< 500	ug/L
CIS-1,2-DICHLOROETHENE	EPA 8021	08/17/00		BLD	< 500	ug/L
TRANS-1,2-DICHLOROETHENE	EPA 8021	08/17/00		BLD	< 500	ug/L
1,2-DICHLOROPROPANE	EPA 8021	08/17/00		BLD	< 500	ug/L
1,3-DICHLOROPROPANE	EPA 8021	08/17/00		BLD	< 500	ug/L
2,2-DICHLOROPROPANE	EPA 8021	08/17/00		BLD	< 500	ug/L
1,1-DICHLOROPROPENE	EPA 8021	08/17/00		BLD	< 500	ug/L
CIS-1,3-DICHLOROPROPENE	EPA 8021	08/17/00		BLD	< 500	ug/L
TRANS-1,3-DICHLOROPROPENE	EPA 8021	08/17/00		BLD	< 500	ug/L
ETHYLBENZENE	EPA 8021	08/17/00		BLD	2250	ug/L
HEXACHLOROBUTADIENE	EPA 8021	08/17/00		BLD	< 500	ug/L
ISOPROPYLBENZENE	EPA 8021	08/17/00		BLD	< 500	ug/L
P-ISOPROPYLTOLUENE	EPA 8021	08/17/00		BLD	< 500	ug/L
METHYLENE CHLORIDE	EPA 8021	08/17/00		BLD	< 500	ug/L
NAPHTHALENE	EPA 8021	08/17/00		BLD	1500	ug/L
N-PROPYLBENZENE	EPA 8021	08/17/00		BLD	< 500	ug/L
STYRENE	EPA 8021	08/17/00		BLD	< 500	ug/L
1,1,1,2-TETRACHLOROETHANE	EPA 8021	08/17/00		BLD	< 500	ug/L
1,1,2,2-TETRACHLOROETHANE	EPA 8021	08/17/00		BLD	< 500	ug/L
TETRACHLOROETHENE	EPA 8021	08/17/00		BLD	< 500	ug/L
TOLUENE	EPA 8021	08/17/00		BLD	19000	ug/L
1,2,3-TRICHLOROBENZENE	EPA 8021	08/17/00		BLD	< 500	ug/L
1,2,4-TRICHLOROBENZENE	EPA 8021	08/17/00		BLD	< 500	ug/L
1,1,1-TRICHLOROETHANE	EPA 8021	08/17/00		BLD	< 500	ug/L
1,1,2-TRICHLOROETHANE	EPA 8021	08/17/00		BLD	< 500	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 3 of 3

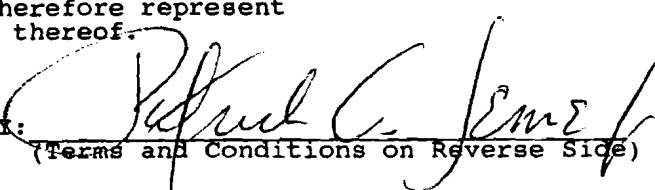
CONTINUATION OF DATA FOR SAMPLE NUMBER 226131

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
TRICHLOROETHENE	EPA 8021	08/17/00		BLD	< 500	ug/L
TRICHLOROFLUOROMETHANE	EPA 8021	08/17/00		BLD	< 500	ug/L
1,2,3-TRICHLOROPROPANE	EPA 8021	08/17/00		BLD	< 500	ug/L
1,2,4-TRIMETHYLBENZENE	EPA 8021	08/17/00		BLD	4400	ug/L
1,3,5-TRIMETHYLBENZENE	EPA 8021	08/17/00		BLD	1600	ug/L
VINYL CHLORIDE	EPA 8021	08/17/00		BLD	< 500	ug/L
O-XYLENE	EPA 8021	08/17/00		BLD	8250	ug/L
M-XYLENE	EPA 8021	08/17/00		BLD	*16800	ug/L
P-XYLENE	EPA 8021	08/17/00		BLD	*	ug/L
METHLY-T-BUTYL ETHER	EPA 8021	08/17/00		BLD	< 2500	ug/L

*Chromatographically, para and meta-Xylene co-elutes on the gas chromatogram. The reported value may therefore represent either of these compounds or a combination thereof.

NYSDOH LAB ID NO. 11246

APPROVED BY:


(Terms and Conditions on Reverse Side)



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Clemett & Co. Inc.
P. O. Box 69
Syracuse, NY 13211-
Attn: Mr. Thomas DiCaprio

PROJECT NAME: 99342/AOI, #326-Altmar
DATE: 08/22/2000

SAMPLE NUMBER- 226132 SAMPLE ID- 99129/MW-1
DATE SAMPLED- 08/08/00
DATE RECEIVED- 08/09/00 SAMPLER- Jamie L. Costello
TIME RECEIVED- 1620 DELIVERED BY- Jamie Costello

SAMPLE MATRIX- WA
TIME SAMPLED- 1415
RECEIVED BY- CAM
TYPE SAMPLE- Grab

Page 1 of 3

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
EPA 8021 SCAN	EPA 8021	08/17/00		BLD		
BENZENE	EPA 8021	08/17/00		BLD	3100	ug/L
BROMOBENZENE	EPA 8021	08/17/00		BLD	< 100	ug/L
BROMOCHLOROMETHANE	EPA 8021	08/17/00		BLD	< 100	ug/L
BROMODICHLOROMETHANE	EPA 8021	08/17/00		BLD	< 100	ug/L
BROMOFORM	EPA 8021	08/17/00		BLD	< 100	ug/L
BROMOMETHANE	EPA 8021	08/17/00		BLD	< 100	ug/L
N-BUTYLBENZENE	EPA 8021	08/17/00		BLD	510	ug/L
SEC-BUTYLBENZENE	EPA 8021	08/17/00		BLD	< 100	ug/L
TERT-BUTYLBENZENE	EPA 8021	08/17/00		BLD	< 100	ug/L
CARBON TETRACHLORIDE	EPA 8021	08/17/00		BLD	< 100	ug/L
CHLOROBENZENE	EPA 8021	08/17/00		BLD	< 100	ug/L
CHLORODIBROMOMETHANE	EPA 8021	08/17/00		BLD	< 100	ug/L
CHLOROETHANE	EPA 8021	08/17/00		BLD	< 100	ug/L
CHLOROFORM	EPA 8021	08/17/00		BLD	< 100	ug/L
CHLOROMETHANE	EPA 8021	08/17/00		BLD	< 100	ug/L
2-CHLOROTOLUENE	EPA 8021	08/17/00		BLD	< 100	ug/L
4-CHLOROTOLUENE	EPA 8021	08/17/00		BLD	< 100	ug/L
1,2-DIBROMO-3-CHLOROPROPANE	EPA 8021	08/17/00		BLD	< 100	ug/L
1,2-DIBROMOETHANE	EPA 8021	08/17/00		BLD	< 100	ug/L
DIBROMOMETHANE	EPA 8021	08/17/00		BLD	< 100	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 2 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 226132

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
1,2-DICHLOROBENZENE	EPA 8021	08/17/00		BLD	< 100	ug/L
1,3-DICHLOROBENZENE	EPA 8021	08/17/00		BLD	< 100	ug/L
1,4-DICHLOROBENZENE	EPA 8021	08/17/00		BLD	< 100	ug/L
DICHLORODIFLUOROMETHANE	EPA 8021	08/17/00		BLD	< 100	ug/L
1,1-DICHLOROETHANE	EPA 8021	08/17/00		BLD	< 100	ug/L
1,2-DICHLOROETHANE	EPA 8021	08/17/00		BLD	< 100	ug/L
1,1-DICHLOROETHENE	EPA 8021	08/17/00		BLD	< 100	ug/L
CIS-1,2-DICHLOROETHENE	EPA 8021	08/17/00		BLD	< 100	ug/L
TRANS-1,2-DICHLOROETHENE	EPA 8021	08/17/00		BLD	< 100	ug/L
1,2-DICHLOROPROPANE	EPA 8021	08/17/00		BLD	< 100	ug/L
1,3-DICHLOROPROPANE	EPA 8021	08/17/00		BLD	< 100	ug/L
2,2-DICHLOROPROPANE	EPA 8021	08/17/00		BLD	< 100	ug/L
1,1-DICHLOROPROPENE	EPA 8021	08/17/00		BLD	< 100	ug/L
CIS-1,3-DICHLOROPROPENE	EPA 8021	08/17/00		BLD	< 100	ug/L
TRANS-1,3-DICHLOROPROPENE	EPA 8021	08/17/00		BLD	< 100	ug/L
ETHYLBENZENE	EPA 8021	08/17/00		BLD	1800	ug/L
HEXACHLOROBUTADIENE	EPA 8021	08/17/00		BLD	< 100	ug/L
ISOPROPYLBENZENE	EPA 8021	08/17/00		BLD	< 100	ug/L
P-ISOPROPYLTOLUENE	EPA 8021	08/17/00		BLD	< 100	ug/L
METHYLENE CHLORIDE	EPA 8021	08/17/00		BLD	< 100	ug/L
NAPHTHALENE	EPA 8021	08/17/00		BLD	920	ug/L
N-PROPYLBENZENE	EPA 8021	08/17/00		BLD	300	ug/L
STYRENE	EPA 8021	08/17/00		BLD	< 100	ug/L
1,1,1,2-TETRACHLOROETHANE	EPA 8021	08/17/00		BLD	< 100	ug/L
1,1,2,2-TETRACHLOROETHANE	EPA 8021	08/17/00		BLD	< 100	ug/L
TETRACHLOROETHENE	EPA 8021	08/17/00		BLD	< 100	ug/L
TOLUENE	EPA 8021	08/17/00		BLD	8100	ug/L
1,2,3-TRICHLOROBENZENE	EPA 8021	08/17/00		BLD	< 100	ug/L
1,2,4-TRICHLOROBENZENE	EPA 8021	08/17/00		BLD	< 100	ug/L
1,1,1-TRICHLOROETHANE	EPA 8021	08/17/00		BLD	< 100	ug/L
1,1,2-TRICHLOROETHANE	EPA 8021	08/17/00		BLD	< 100	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 3 of 3

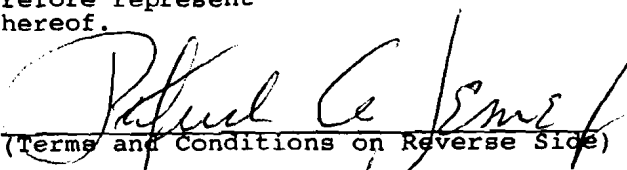
CONTINUATION OF DATA FOR SAMPLE NUMBER 226132

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
TRICHLOROETHENE	EPA 8021	08/17/00		BLD	< 100	ug/L
TRICHLOROFLUOROMETHANE	EPA 8021	08/17/00		BLD	< 100	ug/L
1,2,3-TRICHLOROPROPANE	EPA 8021	08/17/00		BLD	< 100	ug/L
1,2,4-TRIMETHYLBENZENE	EPA 8021	08/17/00		BLD	3100	ug/L
1,3,5-TRIMETHYLBENZENE	EPA 8021	08/17/00		BLD	1150	ug/L
VINYL CHLORIDE	EPA 8021	08/17/00		BLD	< 100	ug/L
O-XYLENE	EPA 8021	08/17/00		BLD	3800	ug/L
M-XYLENE	EPA 8021	08/17/00		BLD	*8200	ug/L
P-XYLENE	EPA 8021	08/17/00		BLD	*	ug/L
METHLY-T-BUTYL ETHER	EPA 8021	08/17/00		BLD	< 500	ug/L

*Chromatographically, para and meta-Xylene co-elutes on the gas chromatogram. The reported value may therefore represent either of these compounds or a combination thereof.

NYSDOH LAB ID NO. 11246

APPROVED BY:


(Terms and Conditions on Reverse Side)



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Clemett & Co. Inc.
P. O. Box 69
Syracuse, NY 13211-
Attn: Mr. Thomas DiCaprio

PROJECT NAME: 99342/AOI, #326-Altmar
DATE: 08/22/2000

SAMPLE NUMBER- 226133 SAMPLE ID- 99129/MW-4
DATE SAMPLED- 08/08/00
DATE RECEIVED- 08/09/00 SAMPLER- Jamie L. Costello
TIME RECEIVED- 1620 DELIVERED BY- Jamie Costello

SAMPLE MATRIX- WA
TIME SAMPLED- 1445
RECEIVED BY- CAM
TYPE SAMPLE- Grab

Page 1 of 3

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
EPA 8021 SCAN	EPA 8021	08/17/00		BLD		
BENZENE	EPA 8021	08/17/00		BLD	< 0.7	ug/L
BROMOBENZENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
BROMOCHLOROMETHANE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
BROMODICHLOROMETHANE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
BROMOFORM	EPA 8021	08/17/00		BLD	< 1.0	ug/L
BROMOMETHANE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
N-BUTYLBENZENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
SEC-BUTYLBENZENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
TERT-BUTYLBENZENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
CARBON TETRACHLORIDE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
CHLOROBENZENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
CHLORODIBROMOMETHANE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
CHLOROETHANE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
CHLOROFORM	EPA 8021	08/17/00		BLD	< 1.0	ug/L
CHLOROMETHANE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
2-CHLOROTOLUENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
4-CHLOROTOLUENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
1,2-DIBROMO-3-CHLOROPROPANE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
1,2-DIBROMOETHANE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
DIBROMOMETHANE	EPA 8021	08/17/00		BLD	< 1.0	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 2 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 226133

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
1,2-DICHLOROBENZENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
1,3-DICHLOROBENZENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
1,4-DICHLOROBENZENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
DICHLORODIFLUOROMETHANE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
1,1-DICHLOROETHANE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
1,2-DICHLOROETHANE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
1,1-DICHLOROETHENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
CIS-1,2-DICHLOROETHENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
TRANS-1,2-DICHLOROETHENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
1,2-DICHLOROPROPANE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
1,3-DICHLOROPROPANE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
2,2-DICHLOROPROPANE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
1,1-DICHLOROPROPENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
CIS-1,3-DICHLOROPROPENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
TRANS-1,3-DICHLOROPROPENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
ETHYLBENZENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
HEXACHLOROBUTADIENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
ISOPROPYLBENZENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
P-ISOPROPYLTOLUENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
METHYLENE CHLORIDE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
NAPHTHALENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
N-PROPYLBENZENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
STYRENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
1,1,1,2-TETRACHLOROETHANE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
1,1,2,2-TETRACHLOROETHANE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
TETRACHLOROETHENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
TOLUENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
1,2,3-TRICHLOROBENZENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
1,2,4-TRICHLOROBENZENE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
1,1,1-TRICHLOROETHANE	EPA 8021	08/17/00		BLD	< 1.0	ug/L
1,1,2-TRICHLOROETHANE	EPA 8021	08/17/00		BLD	< 1.0	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

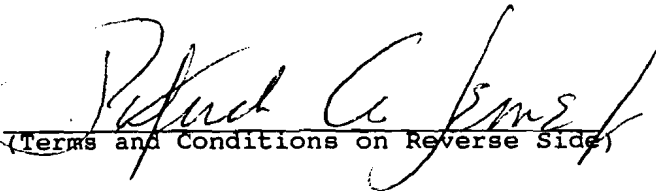
Page 3 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 226133

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT UNITS
TRICHLOROETHENE	EPA 8021	08/17/00		BLD	< 1.0 ug/L
TRICHLOROFLUOROMETHANE	EPA 8021	08/17/00		BLD	< 1.0 ug/L
1,2,3-TRICHLOROPROPANE	EPA 8021	08/17/00		BLD	< 1.0 ug/L
1,2,4-TRIMETHYLBENZENE	EPA 8021	08/17/00		BLD	< 1.0 ug/L
1,3,5-TRIMETHYLBENZENE	EPA 8021	08/17/00		BLD	< 1.0 ug/L
VINYL CHLORIDE	EPA 8021	08/17/00		BLD	< 1.0 ug/L
O-XYLENE	EPA 8021	08/17/00		BLD	< 1.0 ug/L
M-XYLENE	EPA 8021	08/17/00		BLD	< 1.0 ug/L
P-XYLENE	EPA 8021	08/17/00		BLD	< 1.0 ug/L
METHLY-T-BUTYL ETHER	EPA 8021	08/17/00		BLD	< 5.0 ug/L

NYSDOH LAB ID NO. 11246

APPROVED BY:


(Terms and Conditions on Reverse Side)



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Clemett & Co. Inc.
P. O. Box 69
Syracuse, NY 13211-
Attn: Mr. Thomas DiCaprio

PROJECT NAME: 99342/AOI, #326-Altmar
DATE: 08/22/2000

SAMPLE NUMBER- 226134 SAMPLE ID- 99129/MW-5
DATE SAMPLED- 08/08/00
DATE RECEIVED- 08/09/00 SAMPLER- Jamie L. Costello
TIME RECEIVED- 1620 DELIVERED BY- Jamie Costello

SAMPLE MATRIX- WA
TIME SAMPLED- 1250
RECEIVED BY- CAM
TYPE SAMPLE- Grab

Page 1 of 3

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
EPA 8021 SCAN	EPA 8021	08/18/00		BLD		
BENZENE	EPA 8021	08/18/00		BLD	14	ug/L
BROMOBENZENE	EPA 8021	08/18/00		BLD	< 25	ug/L
BROMOCHLOROMETHANE	EPA 8021	08/18/00		BLD	< 25	ug/L
BROMODICHLOROMETHANE	EPA 8021	08/18/00		BLD	< 25	ug/L
BROMOFORM	EPA 8021	08/18/00		BLD	< 25	ug/L
BROMOMETHANE	EPA 8021	08/18/00		BLD	< 25	ug/L
N-BUTYLBENZENE	EPA 8021	08/18/00		BLD	88	ug/L
SEC-BUTYLBENZENE	EPA 8021	08/18/00		BLD	< 25	ug/L
TERT-BUTYLBENZENE	EPA 8021	08/18/00		BLD	< 25	ug/L
CARBON TETRACHLORIDE	EPA 8021	08/18/00		BLD	< 25	ug/L
CHLOROBENZENE	EPA 8021	08/18/00		BLD	< 25	ug/L
CHLORODIBROMOMETHANE	EPA 8021	08/18/00		BLD	< 25	ug/L
CHLOROETHANE	EPA 8021	08/18/00		BLD	< 25	ug/L
CHLOROFORM	EPA 8021	08/18/00		BLD	< 25	ug/L
CHLOROMETHANE	EPA 8021	08/18/00		BLD	< 25	ug/L
2-CHLOROTOLUENE	EPA 8021	08/18/00		BLD	< 25	ug/L
4-CHLOROTOLUENE	EPA 8021	08/18/00		BLD	< 25	ug/L
1,2-DIBROMO-3-CHLOROPROPANE	EPA 8021	08/18/00		BLD	< 25	ug/L
1,2-DIBROMOETHANE	EPA 8021	08/18/00		BLD	< 25	ug/L
DIBROMOMETHANE	EPA 8021	08/18/00		BLD	< 25	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 2 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 226134

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
1,2-DICHLORO BENZENE	EPA 8021	08/18/00		BLD	< 25	ug/L
1,3-DICHLORO BENZENE	EPA 8021	08/18/00		BLD	< 25	ug/L
1,4-DICHLORO BENZENE	EPA 8021	08/18/00		BLD	< 25	ug/L
DICHLORODIFLUOROMETHANE	EPA 8021	08/18/00		BLD	< 25	ug/L
1,1-DICHLOROETHANE	EPA 8021	08/18/00		BLD	< 25	ug/L
1,2-DICHLOROETHANE	EPA 8021	08/18/00		BLD	< 25	ug/L
1,1-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 25	ug/L
CIS-1,2-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 25	ug/L
TRANS-1,2-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 25	ug/L
1,2-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 25	ug/L
1,3-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 25	ug/L
2,2-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 25	ug/L
1,1-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 25	ug/L
CIS-1,3-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 25	ug/L
TRANS-1,3-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 25	ug/L
ETHYLBENZENE	EPA 8021	08/18/00		BLD	115	ug/L
HEXACHLORO BUTADIENE	EPA 8021	08/18/00		BLD	< 25	ug/L
ISOPROPYLBENZENE	EPA 8021	08/18/00		BLD	< 25	ug/L
P-ISOPROPYLTOLUENE	EPA 8021	08/18/00		BLD	< 25	ug/L
METHYLENE CHLORIDE	EPA 8021	08/18/00		BLD	< 25	ug/L
NAPHTHALENE	EPA 8021	08/18/00		BLD	80	ug/L
N-PROPYLBENZENE	EPA 8021	08/18/00		BLD	45	ug/L
STYRENE	EPA 8021	08/18/00		BLD	< 25	ug/L
1,1,1,2-TETRACHLOROETHANE	EPA 8021	08/18/00		BLD	< 25	ug/L
1,1,2,2-TETRACHLOROETHANE	EPA 8021	08/18/00		BLD	< 25	ug/L
TETRACHLOROETHENE	EPA 8021	08/18/00		BLD	< 25	ug/L
TOLUENE	EPA 8021	08/18/00		BLD	28	ug/L
1,2,3-TRICHLORO BENZENE	EPA 8021	08/18/00		BLD	< 25	ug/L
1,2,4-TRICHLORO BENZENE	EPA 8021	08/18/00		BLD	< 25	ug/L
1,1,1-TRICHLOROETHANE	EPA 8021	08/18/00		BLD	< 25	ug/L
1,1,2-TRICHLOROETHANE	EPA 8021	08/18/00		BLD	< 25	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 3 of 3

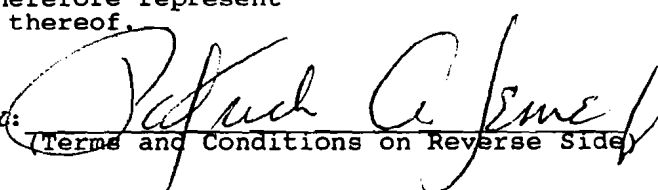
CONTINUATION OF DATA FOR SAMPLE NUMBER 226134

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
TRICHLOROETHENE	EPA 8021	08/18/00		BLD	< 25	ug/L
TRICHLOROFLUOROMETHANE	EPA 8021	08/18/00		BLD	< 25	ug/L
1,2,3-TRICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 25	ug/L
1,2,4-TRIMETHYLBENZENE	EPA 8021	08/18/00		BLD	222	ug/L
1,3,5-TRIMETHYLBENZENE	EPA 8021	08/18/00		BLD	52	ug/L
VINYL CHLORIDE	EPA 8021	08/18/00		BLD	< 25	ug/L
O-XYLENE	EPA 8021	08/18/00		BLD	< 25	ug/L
M-XYLENE	EPA 8021	08/18/00		BLD	*202	ug/L
P-XYLENE	EPA 8021	08/18/00		BLD	*	ug/L
METHLY-T-BUTYL ETHER	EPA 8021	08/18/00		BLD	< 150	ug/L

*Chromatographically, para and meta-Xylene co-elutes on the gas chromatogram. The reported value may therefore represent either of these compounds or a combination thereof.

NYSDOH LAB ID NO. 11246

APPROVED BY:


Terms and Conditions on Reverse Side



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Clemett & Co. Inc.
P. O. Box 69
Syracuse, NY 13211-
Attn: Mr. Thomas DiCaprio

PROJECT NAME: 99342/AOI, #326-Altmar
DATE: 08/22/2000

SAMPLE NUMBER- 226135 SAMPLE ID- 99129/MW-6
DATE SAMPLED- 08/08/00
DATE RECEIVED- 08/09/00 SAMPLER- Jamie L. Costello
TIME RECEIVED- 1620 DELIVERED BY- Jamie Costello

SAMPLE MATRIX- WA
TIME SAMPLED- 1330
RECEIVED BY- CAM
TYPE SAMPLE- Grab

Page 1 of 3

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT UNITS
EPA 8021 SCAN	EPA 8021	08/18/00		BLD	
BENZENE	EPA 8021	08/18/00		BLD	5.6 ug/L
BROMOBENZENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
BROMOCHLOROMETHANE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
BROMODICHLOROMETHANE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
BROMOFORM	EPA 8021	08/18/00		BLD	< 1.0 ug/L
BROMOMETHANE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
N-BUTYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
SEC-BUTYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
TERT-BUTYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
CARBON TETRACHLORIDE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
CHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
CHLORODIBROMOMETHANE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
CHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
CHLOROFORM	EPA 8021	08/18/00		BLD	< 1.0 ug/L
CHLOROMETHANE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
2-CHLOROTOLUENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
4-CHLOROTOLUENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
1,2-DIBROMO-3-CHLOROPROPANE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
1,2-DIBROMOETHANE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
DIBROMOMETHANE	EPA 8021	08/18/00		BLD	< 1.0 ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 2 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 226135

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
1,2-DICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,3-DICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,4-DICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
DICHLORODIFLUOROMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1-DICHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2-DICHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CIS-1,2-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
TRANS-1,2-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,3-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
2,2-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CIS-1,3-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
TRANS-1,3-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
ETHYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
HEXACHLOROBUTADIENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
ISOPROPYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
P-ISOPROPYLTOLUENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
METHYLENE CHLORIDE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
NAPHTHALENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
N-PROPYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
STYRENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1,1,2-TETRACHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1,2,2-TETRACHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
TETRACHLOROETHENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
TOLUENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2,3-TRICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2,4-TRICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1,1-TRICHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1,2-TRICHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L



Certified
Environmental
Services, Inc.

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

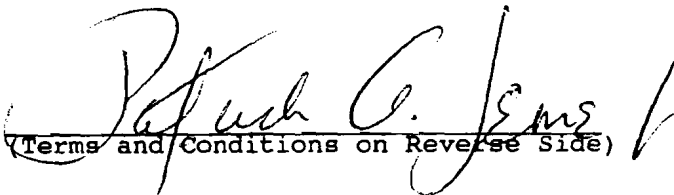
Page 3 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 226135

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
TRICHLOROETHENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
TRICHLOROFLUOROMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2,3-TRICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2,4-TRIMETHYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,3,5-TRIMETHYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
VINYL CHLORIDE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
O-XYLENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
M-XYLENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
P-XYLENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
METHLY-T-BUTYL ETHER	EPA 8021	08/18/00		BLD	< 5.0	ug/L

NYSDOH LAB ID NO. 11246

APPROVED BY:


(Terms and Conditions on Reverse Side)



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Clemett & Co. Inc.
P. O. Box 69
Syracuse, NY 13211-
Attn: Mr. Thomas DiCaprio

PROJECT NAME: 99342/AOI, #326-Altmar
DATE: 08/22/2000

SAMPLE NUMBER- 226136 SAMPLE ID- 99129/MW-9
DATE SAMPLED- 08/08/00
DATE RECEIVED- 08/09/00 SAMPLER- Jamie L. Costello
TIME RECEIVED- 1620 DELIVERED BY- Jamie Costello

SAMPLE MATRIX- WA
TIME SAMPLED- 1230
RECEIVED BY- CAM
TYPE SAMPLE- Grab

Page 1 of 3

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
EPA 8021 SCAN	EPA 8021	08/18/00		BLD		
BENZENE	EPA 8021	08/18/00		BLD	< 0.7	ug/L
BROMOBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
BROMOCHLOROMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
BROMODICHLOROMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
BROMOFORM	EPA 8021	08/18/00		BLD	< 1.0	ug/L
BROMOMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
N-BUTYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
SEC-BUTYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
TERT-BUTYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CARBON TETRACHLORIDE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CHLORODIBROMOMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CHLOROFORM	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CHLOROMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
2-CHLOROTOLUENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
4-CHLOROTOLUENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2-DIBROMO-3-CHLOROPROPANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2-DIBROMOETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
DIBROMOMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 2 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 226136

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
1,2-DICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,3-DICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,4-DICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
DICHLORODIFLUOROMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1-DICHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2-DICHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CIS-1,2-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
TRANS-1,2-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,3-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
2,2-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CIS-1,3-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
TRANS-1,3-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
ETHYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
HEXACHLOROBUTADIENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
ISOPROPYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
P-ISOPROPYLTOLUENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
METHYLENE CHLORIDE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
NAPHTHALENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
N-PROPYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
STYRENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1,1,2-TETRACHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1,2,2-TETRACHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
TETRACHLOROETHENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
TOLUENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2,3-TRICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2,4-TRICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1,1-TRICHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1,2-TRICHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

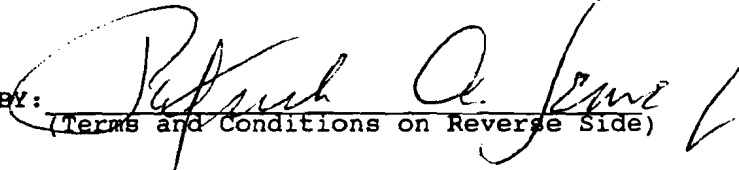
Page 3 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 226136

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
TRICHLOROETHENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
TRICHLOROFLUOROMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2,3-TRICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2,4-TRIMETHYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,3,5-TRIMETHYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
VINYL CHLORIDE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
O-XYLENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
M-XYLENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
P-XYLENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
METHLY-T-BUTYL ETHER	EPA 8021	08/18/00		BLD	< 5.0	ug/L

NYSDOH LAB ID NO. 11246

APPROVED BY:


(Terms and Conditions on Reverse Side)



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Clemett & Co. Inc.
P. O. Box 69
Syracuse, NY 13211-
Attn: Mr. Thomas DiCaprio

PROJECT NAME: 99342/AOI, #326-Altmar
DATE: 08/22/2000

SAMPLE NUMBER- 226137 SAMPLE ID- 99129/MW-10
DATE SAMPLED- 08/08/00
DATE RECEIVED- 08/09/00 SAMPLER- Jamie L. Costello
TIME RECEIVED- 1620 DELIVERED BY- Jamie Costello

SAMPLE MATRIX- WA
TIME SAMPLED- 1210
RECEIVED BY- CAM
TYPE SAMPLE- Grab

Page 1 of 3

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
EPA 8021 SCAN	EPA 8021	08/18/00		BLD		
BENZENE	EPA 8021	08/18/00		BLD	1925	ug/L
BROMOBENZENE	EPA 8021	08/18/00		BLD	< 250	ug/L
BROMOCHLOROMETHANE	EPA 8021	08/18/00		BLD	< 250	ug/L
BROMODICHLOROMETHANE	EPA 8021	08/18/00		BLD	< 250	ug/L
BROMOFORM	EPA 8021	08/18/00		BLD	< 250	ug/L
BROMOMETHANE	EPA 8021	08/18/00		BLD	< 250	ug/L
N-BUTYLBENZENE	EPA 8021	08/18/00		BLD	325	ug/L
SEC-BUTYLBENZENE	EPA 8021	08/18/00		BLD	< 250	ug/L
TERT-BUTYLBENZENE	EPA 8021	08/18/00		BLD	< 250	ug/L
CARBON TETRACHLORIDE	EPA 8021	08/18/00		BLD	< 250	ug/L
CHLOROBENZENE	EPA 8021	08/18/00		BLD	< 250	ug/L
CHLORODIBROMOMETHANE	EPA 8021	08/18/00		BLD	< 250	ug/L
CHLOROETHANE	EPA 8021	08/18/00		BLD	< 250	ug/L
CHLOROFORM	EPA 8021	08/18/00		BLD	< 250	ug/L
CHLOROMETHANE	EPA 8021	08/18/00		BLD	< 250	ug/L
2-CHLOROTOLUENE	EPA 8021	08/18/00		BLD	< 250	ug/L
4-CHLOROTOLUENE	EPA 8021	08/18/00		BLD	< 250	ug/L
1,2-DIBROMO-3-CHLOROPROPANE	EPA 8021	08/18/00		BLD	< 250	ug/L
1,2-DIBROMOETHANE	EPA 8021	08/18/00		BLD	< 250	ug/L
DIBROMOMETHANE	EPA 8021	08/18/00		BLD	< 250	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 2 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 226137

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
1,2-DICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 250	ug/L
1,3-DICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 250	ug/L
1,4-DICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 250	ug/L
DICHLORODIFLUOROMETHANE	EPA 8021	08/18/00		BLD	< 250	ug/L
1,1-DICHLOROETHANE	EPA 8021	08/18/00		BLD	< 250	ug/L
1,2-DICHLOROETHANE	EPA 8021	08/18/00		BLD	< 250	ug/L
1,1-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 250	ug/L
CIS-1,2-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 250	ug/L
TRANS-1,2-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 250	ug/L
1,2-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 250	ug/L
1,3-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 250	ug/L
2,2-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 250	ug/L
1,1-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 250	ug/L
CIS-1,3-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 250	ug/L
TRANS-1,3-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 250	ug/L
ETHYLBENZENE	EPA 8021	08/18/00		BLD	1400	ug/L
HEXACHLOROBUTADIENE	EPA 8021	08/18/00		BLD	< 250	ug/L
ISOPROPYLBENZENE	EPA 8021	08/18/00		BLD	< 250	ug/L
P-ISOPROPYLTOLUENE	EPA 8021	08/18/00		BLD	< 250	ug/L
METHYLENE CHLORIDE	EPA 8021	08/18/00		BLD	< 250	ug/L
NAPHTHALENE	EPA 8021	08/18/00		BLD	725	ug/L
N-PROPYLBENZENE	EPA 8021	08/18/00		BLD	< 250	ug/L
STYRENE	EPA 8021	08/18/00		BLD	< 250	ug/L
1,1,1,2-TETRACHLOROETHANE	EPA 8021	08/18/00		BLD	< 250	ug/L
1,1,2,2-TETRACHLOROETHANE	EPA 8021	08/18/00		BLD	< 250	ug/L
TETRACHLOROETHENE	EPA 8021	08/18/00		BLD	< 250	ug/L
TOLUENE	EPA 8021	08/18/00		BLD	15000	ug/L
1,2,3-TRICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 250	ug/L
1,2,4-TRICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 250	ug/L
1,1,1-TRICHLOROETHANE	EPA 8021	08/18/00		BLD	< 250	ug/L
1,1,2-TRICHLOROETHANE	EPA 8021	08/18/00		BLD	< 250	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 3 of 3

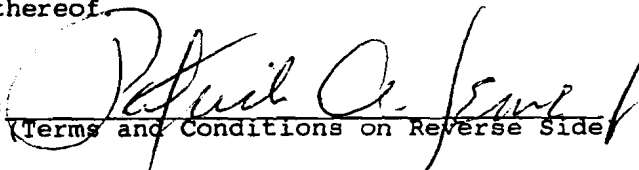
CONTINUATION OF DATA FOR SAMPLE NUMBER 226137

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
TRICHLOROETHENE	EPA 8021	08/18/00		BLD	< 250	ug/L
TRICHLOROFLUOROMETHANE	EPA 8021	08/18/00		BLD	< 250	ug/L
1,2,3-TRICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 250	ug/L
1,2,4-TRIMETHYLBENZENE	EPA 8021	08/18/00		BLD	2300	ug/L
1,3,5-TRIMETHYLBENZENE	EPA 8021	08/18/00		BLD	950	ug/L
VINYL CHLORIDE	EPA 8021	08/18/00		BLD	< 250	ug/L
O-XYLENE	EPA 8021	08/18/00		BLD	4600	ug/L
M-XYLENE	EPA 8021	08/18/00		BLD	*9950	ug/L
P-XYLENE	EPA 8021	08/18/00		BLD	*	ug/L
METHLY-T-BUTYL ETHER	EPA 8021	08/18/00		BLD	< 1500	ug/L

*Chromatographically, para and meta-Xylene co-elutes on the gas chromatogram. The reported value may therefore represent either of these compounds or a combination thereof.

NYSDOH LAB ID NO. 11246

APPROVED BY:


Terms and Conditions on Reverse Side



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Clemett & Co. Inc.
P. O. Box 69
Syracuse, NY 13211-
Attn: Mr. Thomas DiCaprio

PROJECT NAME: 99342/AOI, #326-Altmar
DATE: 08/22/2000

SAMPLE NUMBER- 226138 SAMPLE ID- 99129/MW-11
DATE SAMPLED- 08/08/00
DATE RECEIVED- 08/09/00 SAMPLER- Jamie L. Costello
TIME RECEIVED- 1620 DELIVERED BY- Jamie Costello

SAMPLE MATRIX- WA
TIME SAMPLED- 1500
RECEIVED BY- CAM
TYPE SAMPLE- Grab

Page 1 of 3

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
EPA 8021 SCAN	EPA 8021	08/18/00		BLD		
BENZENE	EPA 8021	08/18/00		BLD	< 0.7	ug/L
BROMOBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
BROMOCHLOROMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
BROMODICHLOROMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
BROMOFORM	EPA 8021	08/18/00		BLD	< 1.0	ug/L
BROMOMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
N-BUTYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
SEC-BUTYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
TERT-BUTYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CARBON TETRACHLORIDE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CHLORODIBROMOMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CHLOROFORM	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CHLOROMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
2-CHLOROTOLUENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
4-CHLOROTOLUENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2-DIBROMO-3-CHLOROPROPANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2-DIBROMOETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
DIBROMOMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 2 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 226138

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
1,2-DICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,3-DICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,4-DICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
DICHLORODIFLUOROMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1-DICHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2-DICHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CIS-1,2-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
TRANS-1,2-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,3-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
2,2-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CIS-1,3-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
TRANS-1,3-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
ETHYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
HEXACHLOROBUTADIENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
ISOPROPYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
P-ISOPROPYLTOLUENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
METHYLENE CHLORIDE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
NAPHTHALENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
N-PROPYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
STYRENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1,1,2-TETRACHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1,2,2-TETRACHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
TETRACHLOROETHENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
TOLUENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2,3-TRICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2,4-TRICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1,1-TRICHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,1,2-TRICHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

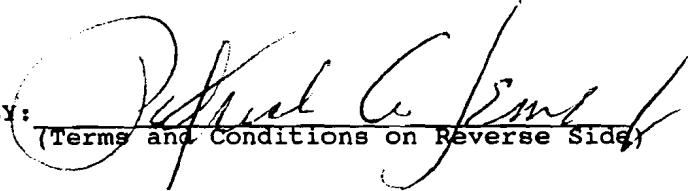
Page 3 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 226138

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
TRICHLOROETHENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
TRICHLOROFLUOROMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2,3-TRICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2,4-TRIMETHYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,3,5-TRIMETHYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
VINYL CHLORIDE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
O-XYLENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
M-XYLENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
P-XYLENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
METHLY-T-BUTYL ETHER	EPA 8021	08/18/00		BLD	< 5.0	ug/L

NYSDOH LAB ID NO. 11246

APPROVED BY:


(Terms and Conditions on Reverse Side)



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Clemett & Co. Inc.
P. O. Box 69
Syracuse, NY 13211-
Attn: Mr. Thomas DiCaprio

PROJECT NAME: 99342/AOI, #326-Altmar
DATE: 08/22/2000

SAMPLE NUMBER- 226139 SAMPLE ID- 99129/MW-12
DATE SAMPLED- 08/08/00
DATE RECEIVED- 08/09/00 SAMPLER- Jamie L. Costello
TIME RECEIVED- 1620 DELIVERED BY- Jamie Costello

SAMPLE MATRIX- WA
TIME SAMPLED- 1310
RECEIVED BY- CAM
TYPE SAMPLE- Grab

Page 1 of 3

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT UNITS
EPA 8021 SCAN	EPA 8021	08/18/00		BLD	
BENZENE	EPA 8021	08/18/00		BLD	7700 ug/L
BROMOBENZENE	EPA 8021	08/18/00		BLD	< 500 ug/L
BROMOCHLOROMETHANE	EPA 8021	08/18/00		BLD	< 500 ug/L
BROMODICHLOROMETHANE	EPA 8021	08/18/00		BLD	< 500 ug/L
BROMOFORM	EPA 8021	08/18/00		BLD	< 500 ug/L
BROMOMETHANE	EPA 8021	08/18/00		BLD	< 500 ug/L
N-BUTYLBENZENE	EPA 8021	08/18/00		BLD	700 ug/L
SEC-BUTYLBENZENE	EPA 8021	08/18/00		BLD	< 500 ug/L
TERT-BUTYLBENZENE	EPA 8021	08/18/00		BLD	< 500 ug/L
CARBON TETRACHLORIDE	EPA 8021	08/18/00		BLD	< 500 ug/L
CHLOROBENZENE	EPA 8021	08/18/00		BLD	< 500 ug/L
CHLORODIBROMOMETHANE	EPA 8021	08/18/00		BLD	< 500 ug/L
CHLOROETHANE	EPA 8021	08/18/00		BLD	< 500 ug/L
CHLOROFORM	EPA 8021	08/18/00		BLD	< 500 ug/L
CHLOROMETHANE	EPA 8021	08/18/00		BLD	< 500 ug/L
2-CHLOROTOLUENE	EPA 8021	08/18/00		BLD	< 500 ug/L
4-CHLOROTOLUENE	EPA 8021	08/18/00		BLD	< 500 ug/L
1,2-DIBROMO-3-CHLOROPROPANE	EPA 8021	08/18/00		BLD	< 500 ug/L
1,2-DIBROMOETHANE	EPA 8021	08/18/00		BLD	< 500 ug/L
DIBROMOMETHANE	EPA 8021	08/18/00		BLD	< 500 ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 2 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 226139

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT UNITS
1,2-DICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 500 ug/L
1,3-DICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 500 ug/L
1,4-DICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 500 ug/L
DICHLORODIFLUOROMETHANE	EPA 8021	08/18/00		BLD	< 500 ug/L
1,1-DICHLOROETHANE	EPA 8021	08/18/00		BLD	< 500 ug/L
1,2-DICHLOROETHANE	EPA 8021	08/18/00		BLD	< 500 ug/L
1,1-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 500 ug/L
CIS-1,2-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 500 ug/L
TRANS-1,2-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 500 ug/L
1,2-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 500 ug/L
1,3-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 500 ug/L
2,2-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 500 ug/L
1,1-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 500 ug/L
CIS-1,3-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 500 ug/L
TRANS-1,3-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 500 ug/L
ETHYLBENZENE	EPA 8021	08/18/00		BLD	3400 ug/L
HEXACHLOROBUTADIENE	EPA 8021	08/18/00		BLD	< 500 ug/L
ISOPROPYLBENZENE	EPA 8021	08/18/00		BLD	< 500 ug/L
P-ISOPROPYLTOLUENE	EPA 8021	08/18/00		BLD	< 500 ug/L
METHYLENE CHLORIDE	EPA 8021	08/18/00		BLD	< 500 ug/L
NAPHTHALENE	EPA 8021	08/18/00		BLD	1700 ug/L
N-PROPYLBENZENE	EPA 8021	08/18/00		BLD	524 ug/L
STYRENE	EPA 8021	08/18/00		BLD	< 500 ug/L
1,1,1,2-TETRACHLOROETHANE	EPA 8021	08/18/00		BLD	< 500 ug/L
1,1,2,2-TETRACHLOROETHANE	EPA 8021	08/18/00		BLD	< 500 ug/L
TETRACHLOROETHENE	EPA 8021	08/18/00		BLD	< 500 ug/L
TOLUENE	EPA 8021	08/18/00		BLD	21000 ug/L
1,2,3-TRICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 500 ug/L
1,2,4-TRICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 500 ug/L
1,1,1-TRICHLOROETHANE	EPA 8021	08/18/00		BLD	< 500 ug/L
1,1,2-TRICHLOROETHANE	EPA 8021	08/18/00		BLD	< 500 ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 3 of 3

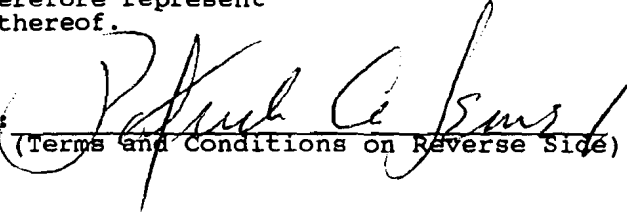
CONTINUATION OF DATA FOR SAMPLE NUMBER 226139

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
TRICHLOROETHENE	EPA 8021	08/18/00		BLD	< 500	ug/L
TRICHLOROFLUOROMETHANE	EPA 8021	08/18/00		BLD	< 500	ug/L
1,2,3-TRICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 500	ug/L
1,2,4-TRIMETHYLBENZENE	EPA 8021	08/18/00		BLD	4700	ug/L
1,3,5-TRIMETHYLBENZENE	EPA 8021	08/18/00		BLD	1700	ug/L
VINYL CHLORIDE	EPA 8021	08/18/00		BLD	< 500	ug/L
O-XYLENE	EPA 8021	08/18/00		BLD	5800	ug/L
M-XYLENE	EPA 8021	08/18/00		BLD	*13400	ug/L
P-XYLENE	EPA 8021	08/18/00		BLD	*	ug/L
METHLY-T-BUTYL ETHER	EPA 8021	08/18/00		BLD	< 2500	ug/L

*Chromatographically, para and meta-Xylene co-elutes on the gas chromatogram. The reported value may therefore represent either of these compounds or a combination thereof.

NYSDOH LAB ID NO. 11246

APPROVED BY:


(Terms and Conditions on Reverse Side)



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Clemett & Co. Inc.
P. O. Box 69
Syracuse, NY 13211-
Attn: Mr. Thomas DiCaprio

PROJECT NAME: 99342/AOI, #326-Altmar
DATE: 08/22/2000

SAMPLE NUMBER- 226140 SAMPLE ID- 99129/Trip Blank
DATE SAMPLED- 08/08/00
DATE RECEIVED- 08/09/00 SAMPLER- Jamie L. Costello
TIME RECEIVED- 1620 DELIVERED BY- Jamie Costello

SAMPLE MATRIX- WA
TIME SAMPLED- 1200
RECEIVED BY- CAM
TYPE SAMPLE- Grab

Page 1 of 3

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
EPA 8021 SCAN	EPA 8021	08/18/00		BLD		
BENZENE	EPA 8021	08/18/00		BLD	< 0.7	ug/L
BROMOBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
BROMOCHLOROMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
BROMODICHLOROMETHANE	EPA 8021	08/18/00		BLD	20	ug/L
BROMOFORM	EPA 8021	08/18/00		BLD	< 1.0	ug/L
BROMOMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
N-BUTYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
SEC-BUTYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
TERT-BUTYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CARBON TETRACHLORIDE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CHLORODIBROMOMETHANE	EPA 8021	08/18/00		BLD	11	ug/L
CHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
CHLOROFORM	EPA 8021	08/18/00		BLD	27	ug/L
CHLOROMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
2-CHLOROTOLUENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
4-CHLOROTOLUENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2-DIBROMO-3-CHLOROPROPANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2-DIBROMOETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
DIBROMOMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 2 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 226140

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT UNITS
1,2-DICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
1,3-DICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
1,4-DICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
DICHLORODIFLUOROMETHANE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
1,1-DICHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
1,2-DICHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
1,1-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
CIS-1,2-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
TRANS-1,2-DICHLOROETHENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
1,2-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
1,3-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
2,2-DICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
1,1-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
CIS-1,3-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
TRANS-1,3-DICHLOROPROPENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
ETHYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
HEXACHLOROBUTADIENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
ISOPROPYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
P-ISOPROPYLTOLUENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
METHYLENE CHLORIDE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
NAPHTHALENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
N-PROPYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
STYRENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
1,1,1,2-TETRACHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
1,1,2,2-TETRACHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
TETRACHLOROETHENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
TOLUENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
1,2,3-TRICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
1,2,4-TRICHLOROBENZENE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
1,1,1-TRICHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0 ug/L
1,1,2-TRICHLOROETHANE	EPA 8021	08/18/00		BLD	< 1.0 ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

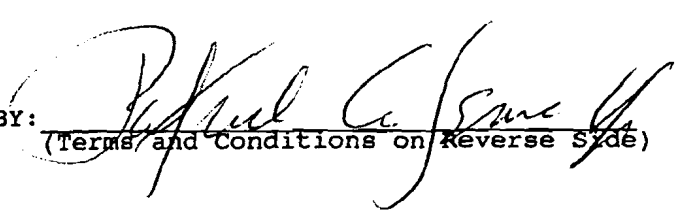
Page 3 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 226140

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
TRICHLOROETHENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
TRICHLOROFLUOROMETHANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2,3-TRICHLOROPROPANE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,2,4-TRIMETHYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
1,3,5-TRIMETHYLBENZENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
VINYL CHLORIDE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
O-XYLENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
M-XYLENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
P-XYLENE	EPA 8021	08/18/00		BLD	< 1.0	ug/L
METHLY-T-BUTYL ETHER	EPA 8021	08/18/00		BLD	< 5.0	ug/L

NYSDOH LAB ID NO. 11246

APPROVED BY:


(Terms and Conditions on Reverse Side)

CHAIN OF CUSTODY RECORD
(Page 1 of 1)

13

57011

City

0215

1700

PO No.	Turnaround Time	Lab																			
Spill No.	Normal ☒	Address																			
Pin No.	24 Hr. ☐																				
Clemett & Co. Contact	72 Hr. ☐																				
	Other ☐																				
Lab Use Only	Sample ID	Date	Time	Sample Type	# of Cont.	EPA 503.1 w/MTBE	EPA 502.2 w/MTBE	EPA 602 w/MTBE	NYS DOH 310.13	NYS DOH 310.14	EPA 8021 w/MTBE TOTALS ☒ STARS ☐ TCLP ☐ FULL ☒	EPA 8270 B/N TOTALS ☐ STARS ☐ TCLP ☐ FULL ☐	EPA 8100	FLASH POINT	PAINT FILTER	LEAD TOTAL ☐ TCLP ☐	BENZENE TOTAL ☐ TCLP ☐	TOTAL METALS (RCRA 8)	FULL TCLP	COMMENTS	
	1000-1			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	None detected
	1000-4			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-5			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-6			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-9			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-10			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-11			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-12			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-13			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-14			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-15			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-16			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-17			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-18			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-19			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-20			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-21			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-22			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-23			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-24			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-25			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-26			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-27			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-28			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	Majorly dirty
	1000-29			X							X						2006/13/1	2006/13/1	2006/13/1	2006/13/1	

APPENDIX B
CES LABORATORY REPORT
RECOVERY SYSTEM DATA



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

AUG 11 2000

REPORT OF ANALYSES

Barton & Loguidice, P.C.
Box 3107
Syracuse, NY 13220-
Attn: Mr. David Hanny

PROJECT NAME: Alaskan/#326-Altmar
DATE: 08/07/2000

SAMPLE NUMBER- 224721 SAMPLE ID- Altmar Influent
DATE SAMPLED- 07/27/00
DATE RECEIVED- 07/27/00 SAMPLER- Edward J. DeSocio
TIME RECEIVED- 1433 DELIVERED BY- Edward DeSocio

SAMPLE MATRIX- WA
TIME SAMPLED- 0918
RECEIVED BY- CAM
TYPE SAMPLE- Grab

Page 1 of 2

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT UNITS
METHYL-T-BUTYL ETHER	EPA 502.2	08/03/00		BLD	< 5.0 ug/L
EPA 502.2 Scan	EPA 502.2	08/03/00		BLD	
Benzene	EPA 502.2	08/03/00		BLD	< 0.7 ug/L
Trichloroethene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
Toluene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
Tetrachloroethene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
Chlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
Ethylbenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
m-Xylene & p-Xylene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
o-Xylene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
Styrene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
Isopropylbenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
n-Propylbenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
Bromobenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
2-Chlorotoluene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
1,3,5-Trimethylbenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
4-Chlorotoluene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
tert-Butylbenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
1,2,4-Trimethylbenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
sec-Butylbenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
p-Isopropyltoluene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 2 of 2

CONTINUATION OF DATA FOR SAMPLE NUMBER 224721

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT UNITS
1,3-Dichlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
1,4-Dichlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
n-Butylbenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
1,2-Dichlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
1,2,4-Trichlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
Hexachlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
Naphthalene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
1,2,3-Trichlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L

NYSDOH LAB ID NO. 11246

APPROVED BY:

(Terms and Conditions on Reverse Side)



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Barton & Loguidice, P.C.
Box 3107
Syracuse, NY 13220-
Attn: Mr. David Hanny

PROJECT NAME: Alaskan/#326-Altmar
DATE: 08/07/2000

SAMPLE NUMBER- 224722 SAMPLE ID- Altmar Mid
DATE SAMPLED- 07/27/00
DATE RECEIVED- 07/27/00 SAMPLER- Edward J. DeSocio
TIME RECEIVED- 1433 DELIVERED BY- Edward DeSocio

SAMPLE MATRIX- WA
TIME SAMPLED- 0925
RECEIVED BY- CAM
TYPE SAMPLE- Grab

Page 1 of 2

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
METHYL-T-BUTYL ETHER	EPA 502.2	08/03/00		BLD	< 5.0	ug/L
EPA 502.2 Scan	EPA 502.2	08/03/00		BLD		
Benzene	EPA 502.2	08/03/00		BLD	< 0.7	ug/L
Trichloroethene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
Toluene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
Tetrachloroethene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
Chlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
Ethylbenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
m-Xylene & p-Xylene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
o-Xylene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
Styrene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
Isopropylbenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
n-Propylbenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
Bromobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
2-Chlorotoluene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
1,3,5-Trimethylbenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
4-Chlorotoluene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
tert-Butylbenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
1,2,4-Trimethylbenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
sec-Butylbenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
p-Isopropyltoluene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 2 of 2

CONTINUATION OF DATA FOR SAMPLE NUMBER 224722

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
1,3-Dichlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
1,4-Dichlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
n-Butylbenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
1,2-Dichlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
1,2,4-Trichlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
Hexachlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
Naphthalene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
1,2,3-Trichlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L

NYSDOH LAB ID NO. 11246

APPROVED BY:

(Terms and Conditions on Reverse Side)



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Barton & Loguidice, P.C.
Box 3107
Syracuse, NY 13220-
Attn: Mr. David Hanny

PROJECT NAME: Alaskan/#326-Altmar
DATE: 08/07/2000

SAMPLE NUMBER- 224723 SAMPLE ID- Altmar Effluent
DATE SAMPLED- 07/27/00
DATE RECEIVED- 07/27/00 SAMPLER- Edward J. DeSocio
TIME RECEIVED- 1433 DELIVERED BY- Edward DeSocio

SAMPLE MATRIX- WA
TIME SAMPLED- 0930
RECEIVED BY- CAM
TYPE SAMPLE- Grab

Page 1 of 2

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
METHYL-T-BUTYL ETHER	EPA 502.2	08/03/00		BLD	< 5.0	ug/L
EPA 502.2 Scan	EPA 502.2	08/03/00		BLD		
Benzene	EPA 502.2	08/03/00		BLD	< 0.7	ug/L
Trichloroethene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
Toluene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
Tetrachloroethene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
Chlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
Ethylbenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
m-Xylene & p-Xylene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
o-Xylene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
Styrene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
Isopropylbenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
n-Propylbenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
Bromobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
2-Chlorotoluene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
1,3,5-Trimethylbenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
4-Chlorotoluene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
tert-Butylbenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
1,2,4-Trimethylbenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
sec-Butylbenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
p-Isopropyltoluene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 2 of 2

CONTINUATION OF DATA FOR SAMPLE NUMBER 224723

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
1,3-Dichlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
1,4-Dichlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
n-Butylbenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
1,2-Dichlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
1,2,4-Trichlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
Hexachlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
Naphthalene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
1,2,3-Trichlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L

NYSDOH LAB ID NO. 11246

APPROVED BY:

(Terms and Conditions on Reverse Side)



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Barton & Loguidice, P.C.
Box 3107
Syracuse, NY 13220-
Attn: Mr. David Hanny

PROJECT NAME: Alaskan/#326-Altmar
DATE: 08/07/2000

SAMPLE NUMBER- 224724 SAMPLE ID- Trip Blank
DATE SAMPLED- 07/27/00
DATE RECEIVED- 07/27/00 SAMPLER- Edward J. DeSocio
TIME RECEIVED- 1433 DELIVERED BY- Edward DeSocio

SAMPLE MATRIX- WA

RECEIVED BY- CAM
TYPE SAMPLE- Grab

Page 1 of 2

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT UNITS
METHYL-T-BUTYL ETHER	EPA 502.2	08/03/00		BLD	< 5.0 ug/L
EPA 502.2 Scan	EPA 502.2	08/03/00		BLD	
Benzene	EPA 502.2	08/03/00		BLD	< 0.7 ug/L
Trichloroethene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
Toluene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
Tetrachloroethene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
Chlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
Ethylbenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
m-Xylene & p-Xylene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
o-Xylene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
Styrene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
Isopropylbenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
n-Propylbenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
Bromobenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
2-Chlorotoluene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
1,3,5-Trimethylbenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
4-Chlorotoluene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
tert-Butylbenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
1,2,4-Trimethylbenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
sec-Butylbenzene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L
p-Isopropyltoluene	EPA 502.2	08/03/00		BLD	< 1.0 ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 2 of 2

CONTINUATION OF DATA FOR SAMPLE NUMBER 224724

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
1,3-Dichlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
1,4-Dichlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
n-Butylbenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
1,2-Dichlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
1,2,4-Trichlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
Hexachlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
Naphthalene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L
1,2,3-Trichlorobenzene	EPA 502.2	08/03/00		BLD	< 1.0	ug/L

NYSDOH LAB ID NO. 11246

APPROVED BY:

(Terms and Conditions on Reverse Side)

39570



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

CHAIN OF CUSTODY RECORD

Client: <u>BFL</u>		Phone: <u>315 457-5200</u>		Analysis			
Address: <u>290 Elwood Davis Rd</u>		Fax: <u>315 451-0052</u>		EPA 502.2 + ATBE			
<u>Syr. NY 13220</u>		P.O. #: <u>CE-319</u>					
Contact Person: <u>Dave Hanny</u>		Project: <u>Altmar (Alaskan)</u>					
Sampled By (print): <u>Edward J. DeSouza</u>		(sign): <u>[Signature]</u>					
LAB USE ONLY	COLLECTED		CORRECTION	CLIENT ID/ SAMPLE LOCATION	# OF CONT.	COMMENTS	
	DATE	TIME					
CES LOG NO.							
224721	7/27/00	0918	X	Altmar Influent	2	Please Fax results to BFL (att: Dave Hanny) and Jim Jones @ Clemett & Co. Inc.	
224722	↓	0925	X	Altmar Mid	2		
224723	↓	0930	X	Altmar Effluent	2		
224724				Trip Blank	1		
						Bill to Alaskan (ES-319)	
Relinquished By: <u>[Signature]</u>			Date: <u>7/27/00</u>	Time: <u>1433</u>	Received By:	Date: <u>7/27/00</u>	Time: <u>1433</u>
Relinquished By:			Date:	Time:	Received By Lab: <u>[Signature]</u>	Date: <u>7/27/00</u>	Time: <u>1433</u>



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Barton & Loguidice, P.C.
Box 3107
Syracuse, NY 13220-
Attn: Mr. David Hanny

PROJECT NAME: Alaskan-Altmar Mini Mart
DATE: 08/24/2000

SAMPLE NUMBER- 226405 SAMPLE ID- Altmar Effluent
DATE SAMPLED- 08/11/00
DATE RECEIVED- 08/11/00 SAMPLER- Edward DeSocio
TIME RECEIVED- 1110 DELIVERED BY- Edward DeSocio

SAMPLE MATRIX- WA
TIME SAMPLED- 0850
RECEIVED BY- CAM
TYPE SAMPLE- Grab

Page 1 of 2

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT UNITS
METHYL-T-BUTYL ETHER	EPA 502.2	08/23/00		BLD	< 5.0 ug/L
EPA 502.2 Scan	EPA 502.2	08/23/00		BLD	
Benzene	EPA 502.2	08/23/00		BLD	< 0.7 ug/L
Trichloroethene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Toluene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Tetrachloroethene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Chlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Ethylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
m-Xylene & p-Xylene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
o-Xylene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Styrene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Isopropylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
n-Propylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Bromobenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
2-Chlorotoluene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
1,3,5-Trimethylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
4-Chlorotoluene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
tert-Butylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
1,2,4-Trimethylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
sec-Butylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
p-Isopropyltoluene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L

AUG 28 2000



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

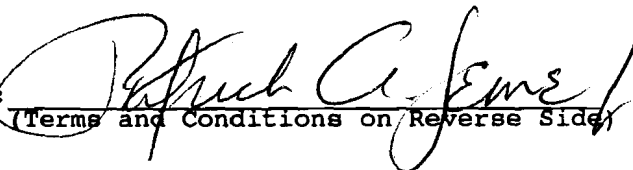
Page 2 of 2

CONTINUATION OF DATA FOR SAMPLE NUMBER 226405

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT UNITS
1,3-Dichlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
1,4-Dichlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
n-Butylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
1,2-Dichlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
1,2,4-Trichlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Hexachlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Naphthalene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
1,2,3-Trichlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L

NYSDOH LAB ID NO. 11246

APPROVED BY:


(Terms and Conditions on Reverse Side)



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Barton & Loguidice, P.C.
Box 3107
Syracuse, NY 13220-
Attn: Mr. David Hanny

PROJECT NAME: Alaskan-Altmar Mini Mart
DATE: 08/24/2000

SAMPLE NUMBER- 226406 SAMPLE ID- Altmar Mid
DATE SAMPLED- 08/11/00
DATE RECEIVED- 08/11/00 SAMPLER- Edward DeSocio
TIME RECEIVED- 1110 DELIVERED BY- Edward DeSocio

SAMPLE MATRIX- WA
TIME SAMPLED- 0845
RECEIVED BY- CAM
TYPE SAMPLE- Grab

Page 1 of 2

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT UNITS
METHYL-T-BUTYL ETHER	EPA 502.2	08/23/00		BLD	< 5.0 ug/L
EPA 502.2 Scan	EPA 502.2	08/23/00		BLD	
Benzene	EPA 502.2	08/23/00		BLD	< 0.7 ug/L
Trichloroethene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Toluene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Tetrachloroethene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Chlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Ethylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
m-Xylene & p-Xylene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
o-Xylene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Styrene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Isopropylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
n-Propylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Bromobenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
2-Chlorotoluene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
1,3,5-Trimethylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
4-Chlorotoluene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
tert-Butylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
1,2,4-Trimethylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
sec-Butylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
p-Isopropyltoluene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

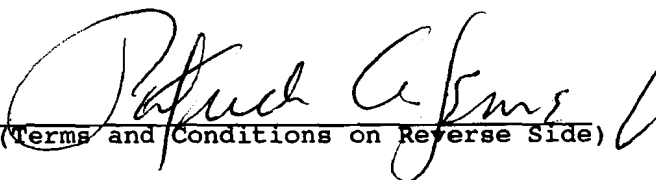
Page 2 of 2

CONTINUATION OF DATA FOR SAMPLE NUMBER 226406

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
1,3-Dichlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0	ug/L
1,4-Dichlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0	ug/L
n-Butylbenzene	EPA 502.2	08/23/00		BLD	< 1.0	ug/L
1,2-Dichlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0	ug/L
1,2,4-Trichlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0	ug/L
Hexachlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0	ug/L
Naphthalene	EPA 502.2	08/23/00		BLD	< 1.0	ug/L
1,2,3-Trichlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0	ug/L

NYSDOH LAB ID NO. 11246

APPROVED BY:


(Terms and Conditions on Reverse Side)



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Barton & Loguidice, P.C.
Box 3107
Syracuse, NY 13220-
Attn: Mr. David Hanny

PROJECT NAME: Alaskan-Altmar Mini Mart
DATE: 08/24/2000

SAMPLE NUMBER- 226407 SAMPLE ID- Altmar Influent
DATE SAMPLED- 08/11/00
DATE RECEIVED- 08/11/00 SAMPLER- Edward DeSocio
TIME RECEIVED- 1110 DELIVERED BY- Edward DeSocio

SAMPLE MATRIX- WA
TIME SAMPLED- 0840
RECEIVED BY- CAM
TYPE SAMPLE- Grab

Page 1 of 2

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT UNITS
METHYL-T-BUTYL ETHER	EPA 502.2	08/23/00		BLD	< 5.0 ug/L
EPA 502.2 Scan	EPA 502.2	08/23/00		BLD	
Benzene	EPA 502.2	08/23/00		BLD	< 0.7 ug/L
Trichloroethene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Toluene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Tetrachloroethene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Chlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Ethylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
m-Xylene & p-Xylene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
o-Xylene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Styrene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Isopropylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
n-Propylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Bromobenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
2-Chlorotoluene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
1,3,5-Trimethylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
4-Chlorotoluene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
tert-Butylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
1,2,4-Trimethylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
sec-Butylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
p-Isopropyltoluene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

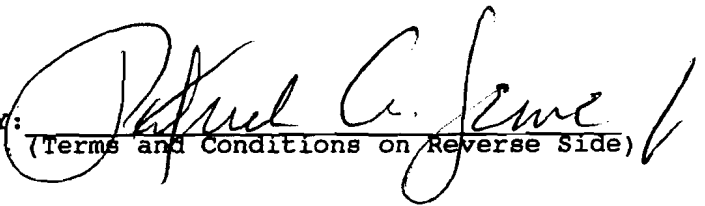
Page 2 of 2

CONTINUATION OF DATA FOR SAMPLE NUMBER 226407

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT UNITS
1,3-Dichlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
1,4-Dichlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
n-Butylbenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
1,2-Dichlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
1,2,4-Trichlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Hexachlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
Naphthalene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L
1,2,3-Trichlorobenzene	EPA 502.2	08/23/00		BLD	< 1.0 ug/L

NYSDOH LAB ID NO. 11246

APPROVED BY:


(Terms and Conditions on Reverse Side)



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

39871
39873

CHAIN OF CUSTODY RECORD

Client: <u>BEL</u>		Phone: <u>315 457-5200</u>		Analysis		
Address: <u>290 Elwood Davis Rd</u>		Fax: <u>315 451-0052</u>		EPA 502.2 + MTBE		
<u>Syr. NY 13220</u>		P.O. #: <u>CES-330</u>				
Contact Person: <u>Dave Hunny</u>		Project: <u>Altmar Mini M.</u>				
Sampled By (print): <u>Edward DeSocio</u>		(sign): <u>[Signature]</u>				
LAB USE ONLY			M A T R I X	# OF CONT.	COMMENTS	
CES LOG NO.	COLLECTED DATE	TIME				CLIENT ID/ SAMPLE LOCATION
226405	8/11/00	0850	X 20	Altmar Effluent	2	Please Fax results
226406	↓	0845	↓	Altmar M.d	2	to BEL (ATT: Dave
226407	↓	0840	↓	Altmar Influent	2	Hunny) + to
						Jim Jones @
226414				Trip Blank	1	Clemett & Co. Inc.
						Bill to Alaskan
						CES-330
						Filled @ BEL
Relinquished By: <u>[Signature]</u>	Date: <u>8/11/00</u>	Time: <u>1110</u>	Received By:	Date:	Time:	
Relinquished By:	Date:	Time:	Received By Lab: <u>[Signature]</u>	Date: <u>8/11/00</u>	Time: <u>11:10</u>	



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

OCT 2 2000

REPORT OF ANALYSES

Barton & Loguidice, P.C.
Box 3107
Syracuse, NY 13220-
Attn: Mr. David Hanny

PROJECT NAME: Alaskan/#326-Altmar
DATE: 09/28/2000

SAMPLE NUMBER- 229459 SAMPLE ID- Altmar RW Influent
DATE SAMPLED- 09/12/00
DATE RECEIVED- 09/13/00 SAMPLER- Information Not Provided
TIME RECEIVED- 0740 DELIVERED BY- Edward DeSocio

SAMPLE MATRIX- WA
TIME SAMPLED- 1642
RECEIVED BY- bld
TYPE SAMPLE- Grab

Page 1 of 2

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT UNITS
METHYL-T-BUTYL ETHER	EPA 502.2	09/21/00		BLD	< 5.0 ug/L
EPA 502.2 Scan	EPA 502.2	09/21/00		BLD	
Benzene	EPA 502.2	09/21/00		BLD	< 0.7 ug/L
Trichloroethene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Toluene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Tetrachloroethene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Chlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Ethylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
m-Xylene & p-Xylene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
o-Xylene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Styrene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Isopropylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
n-Propylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Bromobenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
2-Chlorotoluene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
1,3,5-Trimethylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
4-Chlorotoluene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
tert-Butylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
1,2,4-Trimethylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
sec-Butylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
p-Isopropyltoluene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

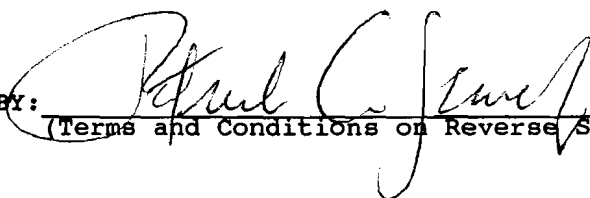
Page 2 of 2

CONTINUATION OF DATA FOR SAMPLE NUMBER 229459

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
1,3-Dichlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0	ug/L
1,4-Dichlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0	ug/L
n-Butylbenzene	EPA 502.2	09/21/00		BLD	< 1.0	ug/L
1,2-Dichlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0	ug/L
1,2,4-Trichlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0	ug/L
Hexachlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0	ug/L
Naphthalene	EPA 502.2	09/21/00		BLD	< 1.0	ug/L
1,2,3-Trichlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0	ug/L

NYSDOH LAB ID NO. 11246

APPROVED BY:


(Terms and Conditions on Reverse Side)



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Barton & Loguidice, P.C.
Box 3107
Syracuse, NY 13220-
Attn: Mr. David Hanny

PROJECT NAME: Alaskan/#326-Altmar
DATE: 09/28/2000

SAMPLE NUMBER- 229460 SAMPLE ID- Altmar RW Mid
DATE SAMPLED- 09/12/00
DATE RECEIVED- 09/13/00 SAMPLER- Information Not Provided
TIME RECEIVED- 0740 DELIVERED BY- Edward DeSocio

SAMPLE MATRIX- WA
TIME SAMPLED- 1640
RECEIVED BY- bld
TYPE SAMPLE- Grab

Page 1 of 2

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT UNITS
METHYL-T-BUTYL ETHER	EPA 502.2	09/21/00		BLD	< 5.0 ug/L
EPA 502.2 Scan	EPA 502.2	09/21/00		BLD	
Benzene	EPA 502.2	09/21/00		BLD	< 0.7 ug/L
Trichloroethene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Toluene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Tetrachloroethene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Chlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Ethylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
m-Xylene & p-Xylene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
o-Xylene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Styrene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Isopropylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
n-Propylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Bromobenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
2-Chlorotoluene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
1,3,5-Trimethylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
4-Chlorotoluene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
tert-Butylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
1,2,4-Trimethylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
sec-Butylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
p-Isopropyltoluene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

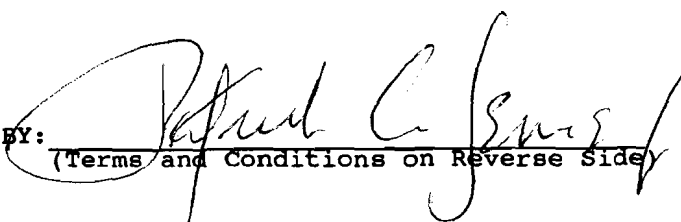
Page 2 of 2

CONTINUATION OF DATA FOR SAMPLE NUMBER 229460

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT UNITS
1,3-Dichlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
1,4-Dichlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
n-Butylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
1,2-Dichlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
1,2,4-Trichlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Hexachlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Naphthalene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
1,2,3-Trichlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L

NYSDOH LAB ID NO. 11246

APPROVED BY:


(Terms and Conditions on Reverse Side)



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Barton & Loguidice, P.C.
Box 3107
Syracuse, NY 13220-
Attn: Mr. David Hanny

PROJECT NAME: Alaskan/#326-Altmar
DATE: 09/28/2000

SAMPLE NUMBER- 229461 SAMPLE ID- Altmar RW Effluent SAMPLE MATRIX- WA
DATE SAMPLED- 09/12/00 TIME SAMPLED- 1645
DATE RECEIVED- 09/13/00 SAMPLER- Information Not Provided RECEIVED BY- bld
TIME RECEIVED- 0740 DELIVERED BY- Edward DeSocio TYPE SAMPLE- Grab

Page 1 of 2

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT UNITS
METHYL-T-BUTYL ETHER	EPA 502.2	09/21/00		BLD	< 5.0 ug/L
EPA 502.2 Scan	EPA 502.2	09/21/00		BLD	
Benzene	EPA 502.2	09/21/00		BLD	< 0.7 ug/L
Trichloroethene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Toluene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Tetrachloroethene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Chlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Ethylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
m-Xylene & p-Xylene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
o-Xylene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Styrene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Isopropylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
n-Propylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
Bromobenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
2-Chlorotoluene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
1,3,5-Trimethylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
4-Chlorotoluene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
tert-Butylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
1,2,4-Trimethylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
sec-Butylbenzene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L
p-Isopropyltoluene	EPA 502.2	09/21/00		BLD	< 1.0 ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

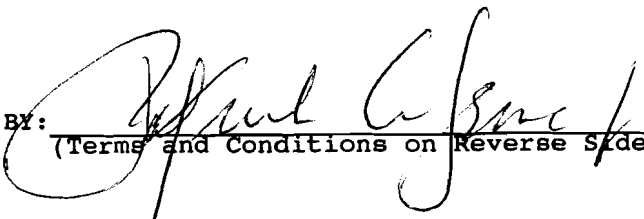
Page 2 of 2

CONTINUATION OF DATA FOR SAMPLE NUMBER 229461

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
1,3-Dichlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0	ug/L
1,4-Dichlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0	ug/L
n-Butylbenzene	EPA 502.2	09/21/00		BLD	< 1.0	ug/L
1,2-Dichlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0	ug/L
1,2,4-Trichlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0	ug/L
Hexachlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0	ug/L
Naphthalene	EPA 502.2	09/21/00		BLD	< 1.0	ug/L
1,2,3-Trichlorobenzene	EPA 502.2	09/21/00		BLD	< 1.0	ug/L

NYSDOH LAB ID NO. 11246

APPROVED BY:


(Terms and Conditions on Reverse Side)



***Certified
Environmental
Services, Inc.***

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

CHAIN OF CUSTODY RECORD

Client: <u>BTL</u>			Phone: <u>457-5200</u>			Analysis ETA 502.2 + MTR					
Address: <u>290 Elwood Davis Rd.</u> <u>Syr. NY 13820</u>			Fax: <u>457-0652</u>								
Contact Person: <u>Dave Hanny</u>			P.O. #: <u>CES - 350</u>								
			Project: <u>AHmer Mini Mart</u>								
Sampled By (print): _____					(sign): _____						
LAB USE ONLY	COLLECTED		CORRECTION	CLIENT ID/ SAMPLE LOCATION	# OF CONT.	COMMENTS					
	DATE	TIME									
CES LOG NO.											
229459	9/12	1642	X	AHmer RW Inflow	2						Please Fax results
229460		1640		AHmer RW Mid	2						To BTL (att: Dave Hanny)
229461		1645		AHmer RW Effluent	2						and Jim Jones & Co.
Relinquished By: <u>[Signature]</u>			Date: <u>9/13</u>	Time: <u>7:40</u>	Received By:			Date:	Time:		
Relinquished By:			Date:	Time:	Received By Lab: <u>[Signature]</u>			Date: <u>9/13/00</u>	Time: <u>0750</u>		

APPENDIX C

CES LABORATORY REPORT - HIVAC MONITORING DATA



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

OCT 27

REPORT OF ANALYSES

Barton & Loguidice, P.C.
Box 3107
Syracuse, NY 13220-
Attn: Mr. David Hanny

PROJECT NAME: Alaskan/#326-Altmar HVAC
DATE: 09/28/2000

SAMPLE NUMBER- 229760 SAMPLE ID- Altmar SVE Influent
DATE SAMPLED- 09/14/00
DATE RECEIVED- 09/14/00 SAMPLER- Edward DeSocio
TIME RECEIVED- 1703 DELIVERED BY- Edward DeSocio

SAMPLE MATRIX- WA
TIME SAMPLED- 1430
RECEIVED BY- cam
TYPE SAMPLE- Grab

Page 1 of 3

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
EPA 8021 SCAN	EPA 8021	09/23/00		BLD		
BENZENE	EPA 8021	09/23/00		BLD	326	ug/L
BROMOBENZENE	EPA 8021	09/23/00		BLD	< 10	ug/L
BROMOCHLOROMETHANE	EPA 8021	09/23/00		BLD	< 10	ug/L
BROMODICHLOROMETHANE	EPA 8021	09/23/00		BLD	< 10	ug/L
BROMOFORM	EPA 8021	09/23/00		BLD	< 10	ug/L
BROMOMETHANE	EPA 8021	09/23/00		BLD	< 10	ug/L
N-BUTYLBENZENE	EPA 8021	09/23/00		BLD	23	ug/L
SEC-BUTYLBENZENE	EPA 8021	09/23/00		BLD	< 10	ug/L
TERT-BUTYLBENZENE	EPA 8021	09/23/00		BLD	< 10	ug/L
CARBON TETRACHLORIDE	EPA 8021	09/23/00		BLD	< 10	ug/L
CHLOROBENZENE	EPA 8021	09/23/00		BLD	< 10	ug/L
CHLORODIBROMOMETHANE	EPA 8021	09/23/00		BLD	< 10	ug/L
CHLOROETHANE	EPA 8021	09/23/00		BLD	< 10	ug/L
CHLOROFORM	EPA 8021	09/23/00		BLD	< 10	ug/L
CHLOROMETHANE	EPA 8021	09/23/00		BLD	< 10	ug/L
2-CHLOROTOLUENE	EPA 8021	09/23/00		BLD	< 10	ug/L
4-CHLOROTOLUENE	EPA 8021	09/23/00		BLD	< 10	ug/L
1,2-DIBROMO-3-CHLOROPROPANE	EPA 8021	09/23/00		BLD	< 10	ug/L
1,2-DIBROMOETHANE	EPA 8021	09/23/00		BLD	< 10	ug/L
DIBROMOMETHANE	EPA 8021	09/23/00		BLD	< 10	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 2 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 229760

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
1,2-DICHLOROBENZENE	EPA 8021	09/23/00		BLD	< 10	ug/L
1,3-DICHLOROBENZENE	EPA 8021	09/23/00		BLD	< 10	ug/L
1,4-DICHLOROBENZENE	EPA 8021	09/23/00		BLD	< 10	ug/L
DICHLORODIFLUOROMETHANE	EPA 8021	09/23/00		BLD	< 10	ug/L
1,1-DICHLOROETHANE	EPA 8021	09/23/00		BLD	< 10	ug/L
1,2-DICHLOROETHANE	EPA 8021	09/23/00		BLD	< 10	ug/L
1,1-DICHLOROETHENE	EPA 8021	09/23/00		BLD	< 10	ug/L
CIS-1,2-DICHLOROETHENE	EPA 8021	09/23/00		BLD	< 10	ug/L
TRANS-1,2-DICHLOROETHENE	EPA 8021	09/23/00		BLD	< 10	ug/L
1,2-DICHLOROPROPANE	EPA 8021	09/23/00		BLD	< 10	ug/L
1,3-DICHLOROPROPANE	EPA 8021	09/23/00		BLD	< 10	ug/L
2,2-DICHLOROPROPANE	EPA 8021	09/23/00		BLD	< 10	ug/L
1,1-DICHLOROPROPENE	EPA 8021	09/23/00		BLD	< 10	ug/L
CIS-1,3-DICHLOROPROPENE	EPA 8021	09/23/00		BLD	< 10	ug/L
TRANS-1,3-DICHLOROPROPENE	EPA 8021	09/23/00		BLD	< 10	ug/L
ETHYLBENZENE	EPA 8021	09/23/00		BLD	114	ug/L
HEXACHLOROBUTADIENE	EPA 8021	09/23/00		BLD	< 10	ug/L
ISOPROPYLBENZENE	EPA 8021	09/23/00		BLD	< 10	ug/L
P-ISOPROPYLTOLUENE	EPA 8021	09/23/00		BLD	< 10	ug/L
METHYLENE CHLORIDE	EPA 8021	09/23/00		BLD	< 10	ug/L
NAPHTHALENE	EPA 8021	09/23/00		BLD	38	ug/L
N-PROPYLBENZENE	EPA 8021	09/23/00		BLD	< 10	ug/L
STYRENE	EPA 8021	09/23/00		BLD	< 10	ug/L
1,1,1,2-TETRACHLOROETHANE	EPA 8021	09/23/00		BLD	< 10	ug/L
1,1,2,2-TETRACHLOROETHANE	EPA 8021	09/23/00		BLD	< 10	ug/L
TETRACHLOROETHENE	EPA 8021	09/23/00		BLD	< 10	ug/L
TOLUENE	EPA 8021	09/23/00		BLD	710	ug/L
1,2,3-TRICHLOROBENZENE	EPA 8021	09/23/00		BLD	< 10	ug/L
1,2,4-TRICHLOROBENZENE	EPA 8021	09/23/00		BLD	< 10	ug/L
1,1,1-TRICHLOROETHANE	EPA 8021	09/23/00		BLD	< 10	ug/L
1,1,2-TRICHLOROETHANE	EPA 8021	09/23/00		BLD	< 10	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

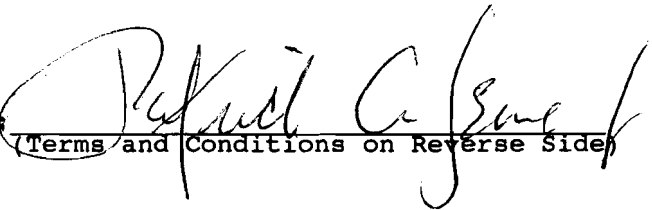
Page 3 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 229760

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT UNITS
TRICHLOROETHENE	EPA 8021	09/23/00		BLD	< 10 ug/L
TRICHLOROFLUOROMETHANE	EPA 8021	09/23/00		BLD	< 10 ug/L
1,2,3-TRICHLOROPROPANE	EPA 8021	09/23/00		BLD	< 10 ug/L
1,2,4-TRIMETHYLBENZENE	EPA 8021	09/23/00		BLD	142 ug/L
1,3,5-TRIMETHYLBENZENE	EPA 8021	09/23/00		BLD	543 ug/L
VINYL CHLORIDE	EPA 8021	09/23/00		BLD	< 10 ug/L
O-XYLENE	EPA 8021	09/23/00		BLD	334 ug/L
M-XYLENE	EPA 8021	09/23/00		BLD	*600 ug/L
P-XYLENE	EPA 8021	09/23/00		BLD	* ug/L
METHLY-T-BUTYL ETHER	EPA 8021	09/23/00		BLD	< 50 ug/L

NYSDOH LAB ID NO. 11246

APPROVED BY:



Terms and Conditions on Reverse Side



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Barton & Loguidice, P.C.
Box 3107
Syracuse, NY 13220-
Attn: Mr. David Hanny

PROJECT NAME: Alaskan/#326-Altmar HVAC
DATE: 09/28/2000

SAMPLE NUMBER- 229761 SAMPLE ID- Altmar SVE Mid
DATE SAMPLED- 09/14/00
DATE RECEIVED- 09/14/00 SAMPLER- Edward DeSocio
TIME RECEIVED- 1703 DELIVERED BY- Edward DeSocio

SAMPLE MATRIX- WA
TIME SAMPLED- 1435
RECEIVED BY- cam
TYPE SAMPLE- Grab

Page 1 of 3

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
EPA 8021 SCAN	EPA 8021	09/23/00		BLD		
BENZENE	EPA 8021	09/23/00		BLD	1.6	ug/L
BROMOBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
BROMOCHLOROMETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
BROMODICHLOROMETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
BROMOFORM	EPA 8021	09/23/00		BLD	< 1.0	ug/L
BROMOMETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
N-BUTYLBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
SEC-BUTYLBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
TERT-BUTYLBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
CARBON TETRACHLORIDE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
CHLOROBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
CHLORODIBROMOMETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
CHLOROETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
CHLOROFORM	EPA 8021	09/23/00		BLD	< 1.0	ug/L
CHLOROMETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
2-CHLOROTOLUENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
4-CHLOROTOLUENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,2-DIBROMO-3-CHLOROPROPANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,2-DIBROMOETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
DIBROMOMETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 2 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 229761

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
1,2-DICHLOROBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,3-DICHLOROBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,4-DICHLOROBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
DICHLORODIFLUOROMETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,1-DICHLOROETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,2-DICHLOROETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,1-DICHLOROETHENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
CIS-1,2-DICHLOROETHENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
TRANS-1,2-DICHLOROETHENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,2-DICHLOROPROPANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,3-DICHLOROPROPANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
2,2-DICHLOROPROPANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,1-DICHLOROPROPENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
CIS-1,3-DICHLOROPROPENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
TRANS-1,3-DICHLOROPROPENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
ETHYLBENZENE	EPA 8021	09/23/00		BLD	1.1	ug/L
HEXACHLOROBUTADIENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
ISOPROPYLBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
P-ISOPROPYLTOLUENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
METHYLENE CHLORIDE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
NAPHTHALENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
N-PROPYLBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
STYRENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,1,1,2-TETRACHLOROETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,1,1,2,2-TETRACHLOROETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
TETRACHLOROETHENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
TOLUENE	EPA 8021	09/23/00		BLD	6.0	ug/L
1,2,3-TRICHLOROBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,2,4-TRICHLOROBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,1,1-TRICHLOROETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,1,2-TRICHLOROETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

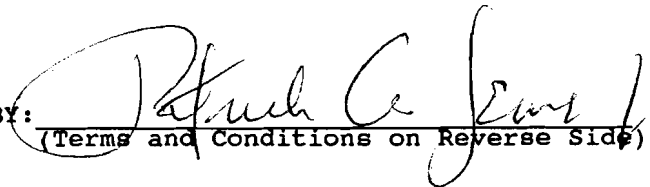
Page 3 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 229761

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
TRICHLOROETHENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
TRICHLOROFLUOROMETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,2,3-TRICHLOROPROPANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,2,4-TRIMETHYLBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,3,5-TRIMETHYLBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
VINYL CHLORIDE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
O-XYLENE	EPA 8021	09/23/00		BLD	2.1	ug/L
M-XYLENE	EPA 8021	09/23/00		BLD	*4.5	ug/L
P-XYLENE	EPA 8021	09/23/00		BLD	*	ug/L
METHLY-T-BUTYL ETHER	EPA 8021	09/23/00		BLD	13	ug/L

NYSDOH LAB ID NO. 11246

APPROVED BY:


(Terms and Conditions on Reverse Side)



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Barton & Loguidice, P.C.
Box 3107
Syracuse, NY 13220-
Attn: Mr. David Hanny

PROJECT NAME: Alaskan/#326-Altmar HVAC
DATE: 09/28/2000

SAMPLE NUMBER- 229762 SAMPLE ID- Altmar SVE Effluent
DATE SAMPLED- 09/14/00
DATE RECEIVED- 09/14/00 SAMPLER- Edward DeSocio
TIME RECEIVED- 1703 DELIVERED BY- Edward DeSocio

SAMPLE MATRIX- WA
TIME SAMPLED- 1445
RECEIVED BY- cam
TYPE SAMPLE- Grab

Page 1 of 3

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
EPA 8021 SCAN	EPA 8021	09/23/00		BLD		
BENZENE	EPA 8021	09/23/00		BLD	57	ug/L
BROMOBENZENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
BROMOCHLOROMETHANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
BROMODICHLOROMETHANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
BROMOFORM	EPA 8021	09/23/00		BLD	< 5.0	ug/L
BROMOMETHANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
N-BUTYLBENZENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
SEC-BUTYLBENZENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
TERT-BUTYLBENZENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
CARBON TETRACHLORIDE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
CHLOROBENZENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
CHLORODIBROMOMETHANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
CHLOROETHANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
CHLOROFORM	EPA 8021	09/23/00		BLD	< 5.0	ug/L
CHLOROMETHANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
2-CHLOROTOLUENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
4-CHLOROTOLUENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
1,2-DIBROMO-3-CHLOROPROPANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
1,2-DIBROMOETHANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
DIBROMOMETHANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 2 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 229762

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
1,2-DICHLOROBENZENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
1,3-DICHLOROBENZENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
1,4-DICHLOROBENZENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
DICHLORODIFLUOROMETHANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
1,1-DICHLOROETHANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
1,2-DICHLOROETHANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
1,1-DICHLOROETHENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
CIS-1,2-DICHLOROETHENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
TRANS-1,2-DICHLOROETHENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
1,2-DICHLOROPROPANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
1,3-DICHLOROPROPANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
2,2-DICHLOROPROPANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
1,1-DICHLOROPROPENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
CIS-1,3-DICHLOROPROPENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
TRANS-1,3-DICHLOROPROPENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
ETHYLBENZENE	EPA 8021	09/23/00		BLD	39	ug/L
HEXACHLOROBUTADIENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
ISOPROPYLBENZENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
P-ISOPROPYLTOLUENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
METHYLENE CHLORIDE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
NAPHTHALENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
N-PROPYLBENZENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
STYRENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
1,1,1,2-TETRACHLOROETHANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
1,1,2,2-TETRACHLOROETHANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
TETRACHLOROETHENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
TOLUENE	EPA 8021	09/23/00		BLD	202	ug/L
1,2,3-TRICHLOROBENZENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
1,2,4-TRICHLOROBENZENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
1,1,1-TRICHLOROETHANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
1,1,2-TRICHLOROETHANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

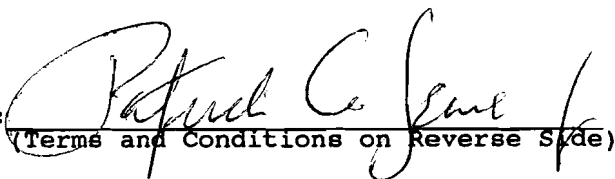
Page 3 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 229762

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
TRICHLOROETHENE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
TRICHLOROFLUOROMETHANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
1,2,3-TRICHLOROPROPANE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
1,2,4-TRIMETHYLBENZENE	EPA 8021	09/23/00		BLD	23	ug/L
1,3,5-TRIMETHYLBENZENE	EPA 8021	09/23/00		BLD	10	ug/L
VINYL CHLORIDE	EPA 8021	09/23/00		BLD	< 5.0	ug/L
O-XYLENE	EPA 8021	09/23/00		BLD	74	ug/L
M-XYLENE	EPA 8021	09/23/00		BLD	*166	ug/L
P-XYLENE	EPA 8021	09/23/00		BLD	*	ug/L
METHLY-T-BUTYL ETHER	EPA 8021	09/23/00		BLD	< 25	ug/L

NYSDOH LAB ID NO. 11246

APPROVED BY:


(Terms and Conditions on Reverse Side)



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

REPORT OF ANALYSES

Barton & Loguidice, P.C.
Box 3107
Syracuse, NY 13220-
Attn: Mr. David Hanny

PROJECT NAME: Alaskan/#326-Altmar HVAC
DATE: 09/28/2000

SAMPLE NUMBER- 229763 SAMPLE ID- Trip Blank
DATE SAMPLED- 09/14/00
DATE RECEIVED- 09/14/00 SAMPLER- Edward DeSocio
TIME RECEIVED- 1703 DELIVERED BY- Edward DeSocio

SAMPLE MATRIX- WA
RECEIVED BY- cam
TYPE SAMPLE- Grab

Page 1 of 3

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
EPA 8021 SCAN	EPA 8021	09/23/00		BLD		
BENZENE	EPA 8021	09/23/00		BLD	< 0.7	ug/L
BROMOBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
BROMOCHLOROMETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
BROMODICHLOROMETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
BROMOFORM	EPA 8021	09/23/00		BLD	< 1.0	ug/L
BROMOMETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
N-BUTYLBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
SEC-BUTYLBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
TERT-BUTYLBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
CARBON TETRACHLORIDE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
CHLOROBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
CHLORODIBROMOMETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
CHLOROETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
CHLOROFORM	EPA 8021	09/23/00		BLD	< 1.0	ug/L
CHLOROMETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
2-CHLOROTOLUENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
4-CHLOROTOLUENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,2-DIBROMO-3-CHLOROPROPANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,2-DIBROMOETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
DIBROMOMETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

Page 2 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 229763

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
1,2-DICHLOROBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,3-DICHLOROBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,4-DICHLOROBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
DICHLORODIFLUOROMETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,1-DICHLOROETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,2-DICHLOROETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,1-DICHLOROETHENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
CIS-1,2-DICHLOROETHENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
TRANS-1,2-DICHLOROETHENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,2-DICHLOROPROPANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,3-DICHLOROPROPANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
2,2-DICHLOROPROPANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,1-DICHLOROPROPENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
CIS-1,3-DICHLOROPROPENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
TRANS-1,3-DICHLOROPROPENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
ETHYLBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
HEXACHLOROBUTADIENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
ISOPROPYLBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
P-ISOPROPYLTOLUENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
METHYLENE CHLORIDE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
NAPHTHALENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
N-PROPYLBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
STYRENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,1,1,2-TETRACHLOROETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,1,2,2-TETRACHLOROETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
TETRACHLOROETHENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
TOLUENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,2,3-TRICHLOROBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,2,4-TRICHLOROBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,1,1-TRICHLOROETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,1,2-TRICHLOROETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

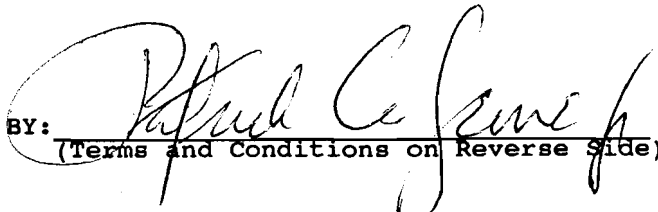
Page 3 of 3

CONTINUATION OF DATA FOR SAMPLE NUMBER 229763

ANALYSIS	METHOD	ANALYSIS DATE	TIME	BY	RESULT	UNITS
TRICHLOROETHENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
TRICHLOROFLUOROMETHANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,2,3-TRICHLOROPROPANE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,2,4-TRIMETHYLBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
1,3,5-TRIMETHYLBENZENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
VINYL CHLORIDE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
O-XYLENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
M-XYLENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
P-XYLENE	EPA 8021	09/23/00		BLD	< 1.0	ug/L
METHLY-T-BUTYL ETHER	EPA 8021	09/23/00		BLD	< 5.0	ug/L

NYSDOH LAB ID NO. 11246

APPROVED BY:


(Terms and Conditions on Reverse Side)

40460



**Certified
Environmental
Services, Inc.**

1401 Erie Blvd. East
Syracuse, NY 13210
Phone 315-478-2374
Fax 315-478-2107

CHAIN OF CUSTODY RECORD

Client: <u>BEL</u>		Phone: <u>457-5260</u>		Analysis			
Address: <u>290 Elwood Davis Rd.</u>		Fax: <u>451-052</u>					
<u>Syr. NY 13220</u>		P.O. #: <u>CE-350</u>					
Contact Person: <u>Dave Henry</u>		Project: <u>Altman HWA</u>					
Sampled By (print): <u>Edward DeSocio</u>			(signature): <u>Edward J. DeSocio</u>				
LAB USE ONLY	COLLECTED		C O R R I P B X	M A T R I X	# OF CONT.		
CES LOG NO.	DATE	TIME				CLIENT ID/ SAMPLE LOCATION	COMMENTS
229760	9/14	1430	X	Altman SUE Influent	2	Full 2021 NOTE	
229761	9/14	1435		Altman SUE mid	2		
229762	9/14	1445		Altman SUE Effluent	2		
229763				Trip Blank	1		
Relinquished By: <u>Edward J. DeSocio</u>			Date: <u>9/14/00</u>	Time: <u>1703</u>	Received By:	Date:	Time:
Relinquished By:			Date:	Time:	Received By Lab: <u>Christine Mignol</u>	Date: <u>9/14/00</u>	Time: <u>1703</u>

APPENDIX D
HISTORICAL LABORATORY DATA

**Historical Influent Data
Recovery System
Alaskan Oil, Inc.
Altmar Mini Mart
Rt. 13 & Cemetary Road**

Detected Compounds	NYSDEC Guidance Values (ppb)*	Results in ug/l										
		9/15/98	10/16/98	11/13/98	12/31/98	6/10/99	1/25/00	2/24/00	3/21/00	4/25/00	5/24/00	6/21/00
EPA Method 502.2												
Benzene	0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7
Trichloroethene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Toluene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Tetrachloroethene	0.7	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Chlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Ethylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Total Xylenes	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Styrene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Isopropyl benzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
n-Propylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Bromobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
2-Chlorotoluene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,3,5-Trimethylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
4-Chlorotoluene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
tert-Butylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,2,4-Trimethylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
sec-Butylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
p-Isopropyltoluene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,3-Dichlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,4-Dichlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
n-Butylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,2-Dichlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,2,4-Trichlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Hexachlorobenzene	0.04	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Napthalene	10	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,2,3-Trichlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
MTBE	50	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0

Notes

*NYSDEC Guidance Values from June 1998 Memo

ug/l = part per billion

██████████ = Above DEC Guidance Values

DRH: 639.002

Barton
Loguidice, P.C.
Consulting Engineers

Historical Mid Data
Recovery System
Alaskan Oil, Inc.
Altmar Mini Mart
Rt. 13 & Cemetary Road

Detected Compounds	NYSDEC Guidance Values (ppb)*	Results in ug/l										
		9/15/98	10/16/98	11/13/98	12/31/98	6/10/99	1/25/00	2/24/00	3/21/00	4/25/00	5/24/00	6/21/00
EPA Method 502.2												
Benzene	0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7
Trichloroethene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Toluene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Tetrachloroethene	0.7	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Chlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Ethylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Total Xylenes	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Styrene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Isopropyl benzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
n-Propylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Bromobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
2-Chlorotoluene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,3,5-Trimethylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
4-Chlorotoluene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
tert-Butylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,2,4-Trimethylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
sec-Butylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
p-Isopropyltoluene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,3-Dichlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,4-Dichlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
n-Butylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,2-Dichlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,2,4-Trichlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Hexachlorobenzene	0.04	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Napthalene	10	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,2,3-Trichlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
MTBE	50	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0

Notes

*NYSDEC Guidance Values from June 1998 Memo

ug/l = part per billion

██████████ = Above DEC Guidance Values

DRH: 639.002



Historical Effluent Data
Recovery System
Alaskan Oil, Inc.
Altmar Mini Mart
Rt. 13 & Cemetary Road

Detected Compounds	NYSDEC Guidance Values (ppb)*	Results in ug/l										
		9/15/98	10/16/98	11/13/98	12/31/98	6/10/99	1/25/00	2/24/00	3/21/00	4/25/00	5/24/00	6/21/00
EPA Method 502.2												
Benzene	0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7	<0.7
Trichloroethene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Toluene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Tetrachloroethene	0.7	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Chlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Ethylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Total Xylenes	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Styrene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Isopropyl benzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
n-Propylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Bromobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
2-Chlorotoluene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,3,5-Trimethylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
4-Chlorotoluene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
tert-Butylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,2,4-Trimethylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
sec-Butylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
p-Isopropyltoluene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,3-Dichlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,4-Dichlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
n-Butylbenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,2-Dichlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,2,4-Trichlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Hexachlorobenzene	0.04	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
Napthalene	10	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
1,2,3-Trichlorobenzene	5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
MTBE	50	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0

Notes

*NYSDEC Guidance Values from June 1998 Memo

ug/l = part per billion

 = Above DEC Guidance Values

DRH: 639.002

