

NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION

Division of Environmental Permits, Region 5

1115 State Route 86, PO Box 296, Ray Brook, NY 12977-0296

P: (518) 897-1234 | F: (518) 897-1394

www.dec.ny.gov

July 12, 2023

HyperCompuGloboMeganet, LLC
ATTN: Joseph Church
561 Route 3
Plattsburgh, NY 12901

**Re: SPDES Permit Transfer
Reenergy Chateaugay, LLC
SPDES No. NY0230634, Expiring 10/31/2025
DEC # 5-1634-00022/00001
Chateaugay (T), Franklin County**

Dear Permittee:

Enclosed is a validated permit transfer form approving the transfer of the referenced SPDES Permit to HyperCompuGloboMeganet, LLC. As the permittee, you are responsible for the operation of the onsite treatment system serving the subject facility in compliance with requirements of the enclosed SPDES permit. The discharge(s) authorized in this SPDES permit shall comply with New York State Department of Environmental Conservation regulations 6 NYCRR Part 750, including Parts 750-1.2(a) and 750-2.

The facility's wastewater treatment system has not been used for an extended period of time. An evaluation of the condition and function of the wastewater treatment system and its components by a professional engineer licensed to practice in NY should be performed prior to putting the system in service. The evaluation shall be submitted to the Department for review and acceptance.

If the facility is to be decommissioned, a report and plans must be submitted to the Department for review and approval, in accordance with 6 NYCRR Part 750-2.11. Please contact Steven Rose, in the Division of Water at (518) 897-1265 if you have any questions.

Any questions regarding the annual SPDES fee should be addressed to the Regulatory Fee Determination Unit at (518) 402-8210.

Sincerely,



Erin M. Donhauser
Deputy Regional Permit Administrator

EMD:ctm

ec: Steven Rose, DOW
Marlene Martin, DOH
Permit Coordinator, DOW
Amber Earl, Earl Development



Department of
Environmental
Conservation



Department of Environmental Conservation

Application For Permit Transfer and Application for Transfer of Pending Application

Received Environmental Permits

JUN 29 2023

NOTE: Please read ALL instructions before completing this application. Please TYPE or PRINT clearly in ink.

NYSDEC-Region 5 Ray Brook

PART 1 - TRANSFEREE (New Owner/Operator/Lessee/Applicant) Completes:

1. List Permit Number(s) And Their Effective And Expiration Dates: SPDES: NY0230634 DEC ID 5-1634-00022 11/20/20 EXP 10/31/25
2. Name Of Transferee: HyperCompuGloboMeganet LLC
3. Name Of Facility/Project: Reenergy Chateaugay LLC
4. Facility Contact Name: Joseph Church
5. Has Work Begun On The Project? Yes [] No [x] If "No," proposed starting date: not operating Approximate completion date: XXXXXXXX

PART 2 - TRANSFEROR (Present or Former Owner/Operator/Lessee/Applicant) Completes:

1. Name Of Transferor: Earl Development
2. Name Of Facility/Project, if different from Facility Name in Part 1:
3. CERTIFICATION: This certifies that ownership, operation, or a lease for the facility identified in Part 1 of this form [] will be [x] was conveyed to the party identified as the Transferee on 6/24/23 (date).


PART 3 - PERMIT TRANSFER VALIDATION SECTION - Department Of Environmental Conservation Completes:

[x] Transfer of permit approved, effective as of 07/12/2023. Transferee subject to conditions of original permit, without exception.
Erin M. Donhauser NYSDEC PERMIT ADMINISTRATOR
Erin M. Donhauser SIGNATURE
07/12/2023 DATE

FOR DEC USE ONLY

FOR DEC USE ONLY

New York State Department of Environmental Conservation
Division of Environmental Permits
NYSDEC HEADQUARTERS
625 BROADWAY
ALBANY, NY 12233
(518) 402-9167



SPDES PERMIT RENEWAL

4/1/2015

**MARK AANDERUD
REENERGY CHATEAUGAY LLC
7019 ST RTE 374
CHATEAUGAY NY 12920**

**Permittee Name: REENERGY CHATEAUGAY LLC
Facility Name: REENERGY CHATEAUGAY LLC
Ind. Code: 4911 County: FRANKLIN
DEC ID: 5-1634-00022/00002 SPDES No.: NY0230634
Permit Effective Date: 8/1/2015
Permit Expiration Date: 7/31/2020**

Dear Permittee,

The State Pollutant Elimination System (SPDES) permit renewal for the facility referenced above is approved with the new effective and expiration dates. This letter together with the previous valid permit for this facility effective on 08/01/2010 and any subsequent modifications constitute authorization to discharge wastewater in accordance with all terms, conditions and limitations specified in the previously issued permit(s).

As a reminder, SPDES permits are renewed at a central location in Albany in order to make the process more efficient. All other concerns with your permit, including applications for permit modification or transfer to a new owner, a name change, and other questions, should be directed to:

Regional Permit Administrator
NYSDEC REGION 5 HEADQUARTERS
1115 ST RTE 86
RAY BROOK, NY 12977-0296
(518) 897-1211

If you have already filed an application for modification of your permit, it will be processed separately by that office.

If you have questions concerning this permit renewal, please contact LINDY SUE CZUBERNAT at (518) 402-9167.

Sincerely,


STUART M. FOX
Deputy Chief Permit Administrator

CC:
RPA
BWC

RWE
File

BWP
EPA

NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION
State Pollutant Discharge Elimination System (SPDES)
DISCHARGE PERMIT
 Special Conditions (Part I)



Industrial Code: 4911
 Discharge Class (CL): 01
 Toxic Class (TX): T
 Major Drainage Basin: 09
 Sub Drainage Basin: 02
 Water Index Number: SLC-21-3A
 Compact Area: IJC

SPDES Number: NY-0230634
 DEC Number: 5-1634-00022/00002-0
 Effective Date (EDP): 08/01/90
 Expiration Date (ExDP): 08/01/95
 Modification Date(s): 10/06/92
 Attachment(s): General Conditions (Part II) Date: 11/90

This SPDES permit is issued in compliance with Title 8 of Article 17 of the Environmental Conservation Law of New York State and in compliance with the Clean Water Act as amended, (33 U.S.C. Section 1251 et. seq.)(hereafter referred to as "the Act").

PERMITTEE NAME AND ADDRESS

Attention: William G. Carter

Name: KES Chateaugay Limited Partnership
 Street: One Research Parkway
 City: Meriden State: CT Zip Code: 06450

is authorized to discharge from the facility described below:

FACILITY NAME AND ADDRESS


Name: KES Chateaugay Project
 Location (C,T,V): Town of Chateaugay County: Franklin
 Facility Address: Route 374
 City: Chateaugay State: NY Zip Code: 12920
 NYTM - E: 573.3 NYTM - N: 4 971.3
 From Outfall No.: 001 at Latitude: 44° 52' 30" & Longitude: 74° 02' 30"
 into receiving waters known as: Chateaugay River, Trib. 3a Class: D

and; (list other Outfalls, Receiving Waters & Water Classifications)
002 Boiler Bldg. Sanitary to Groundwater, Class GA

in accordance with the effluent limitations, monitoring requirements and other conditions set forth in Special Conditions (Part I) and General Conditions (Part II) of this permit.

DISCHARGE MONITORING REPORT (DMR) MAILING ADDRESS

Mailing Name: KES Chateaugay, Limited Partnership
 Street: One Research Parkway
 City: Meriden State: CT Zip Code: 06450
 Responsible Official or Agent: William G. Carter Phone: (203)235-1511

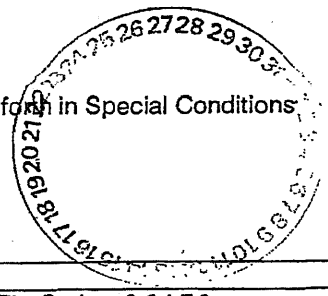

This permit and the authorization to discharge shall expire on midnight of the expiration date shown and the permittee shall not discharge after the expiration date unless this permit has been renewed, or extended pursuant to law. To be authorized to discharge beyond the expiration date, the permittee shall apply for a permit renewal no less than 180 days prior to the expiration date shown above.

DISTRIBUTION: W. Lavigne, RWE
 R. Hannaford, BWF
 W. Amberman, DOH

Deputy	
Permit Administrator:	
Charles F. Gardephe	
Address: Route 86	
Ray Brook, New York 12977	
Signature: <i>Charles F. Gardephe</i>	Date: <u>10/20/92</u>

EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS

During the period beginning EDPand lasting until EDP + 5 YEARS

the discharges from the permitted facility shall be limited and monitored by the permittee as specified below:

Outfall Number & Effluent Parameter	Discharge Limitations		Units	Minimum Monitoring Requirements	
	Daily Avg.	Daily Max.		Measurement Frequency	Sample Type
<u>OUTFALL 001 HOLDING POND</u>					
Flow	Monitor	Monitor	gpd	Monthly	Recorder
Temperature	NA	70	°F	Continuous	Recorder
Oil and Grease	NA	15	mg/l	Monthly	Grab
Phosphorus, Total	Monitor	NA	mg/l	Monthly	Grab
Suspended Solids	30	50	mg/l	Monthly	Grab
pH	Range	6.0 to 9.0	SU	Monthly	Grab
<u>OUTFALL 001A COOLING TOWER BLOWDOWN</u>					
Flow	Monitor	Monitor	gpd	Monthly	Recorder
Free Available Chlorine	0.2	0.5	mg/l	Monthly	Grab
Chromium, Total	0.2	0.2	mg/l	Monthly	Grab
Zinc, Total	1.0	1.0	mg/l	Monthly	Grab
<u>OUTFALL 002 BOILER BLDG. SANITARY</u>					
No Monitoring Required					

- Notes: 1. There shall be no discharge of polychlorinated biphenyl compounds from this facility.
2. Any new water treatment chemical proposed to be used by this facility must be approved by the Department prior to its use. Requests for approval shall be sent to the Regional Water Engineer at least 120 days prior to anticipated use. The permit shall then be modified to include additional monitoring as appropriate.


DEFINITIONS OF DAILY AVERAGE AND DAILY MAXIMUM

The daily average discharge is the total discharge by weight or in other appropriate units as specified herein, during a calendar month divided by the number of days in the month that the production or commercial facility was operating. Where less than daily sampling is required by this permit, the daily average discharge shall be determined by the summation of all the measured daily discharges in appropriate units as specified herein divided by the number of days during the calendar month when measurements were made.


The daily maximum discharge means the total discharge by weight or in other appropriate units as specified herein, during any calendar day.

MONITORING LOCATIONS

The permittee shall take samples and measurements, to comply with the monitoring requirements specified in this permit, at the location(s) indicated below: (Show sampling locations and outfalls with sketch or flow diagram as appropriate).

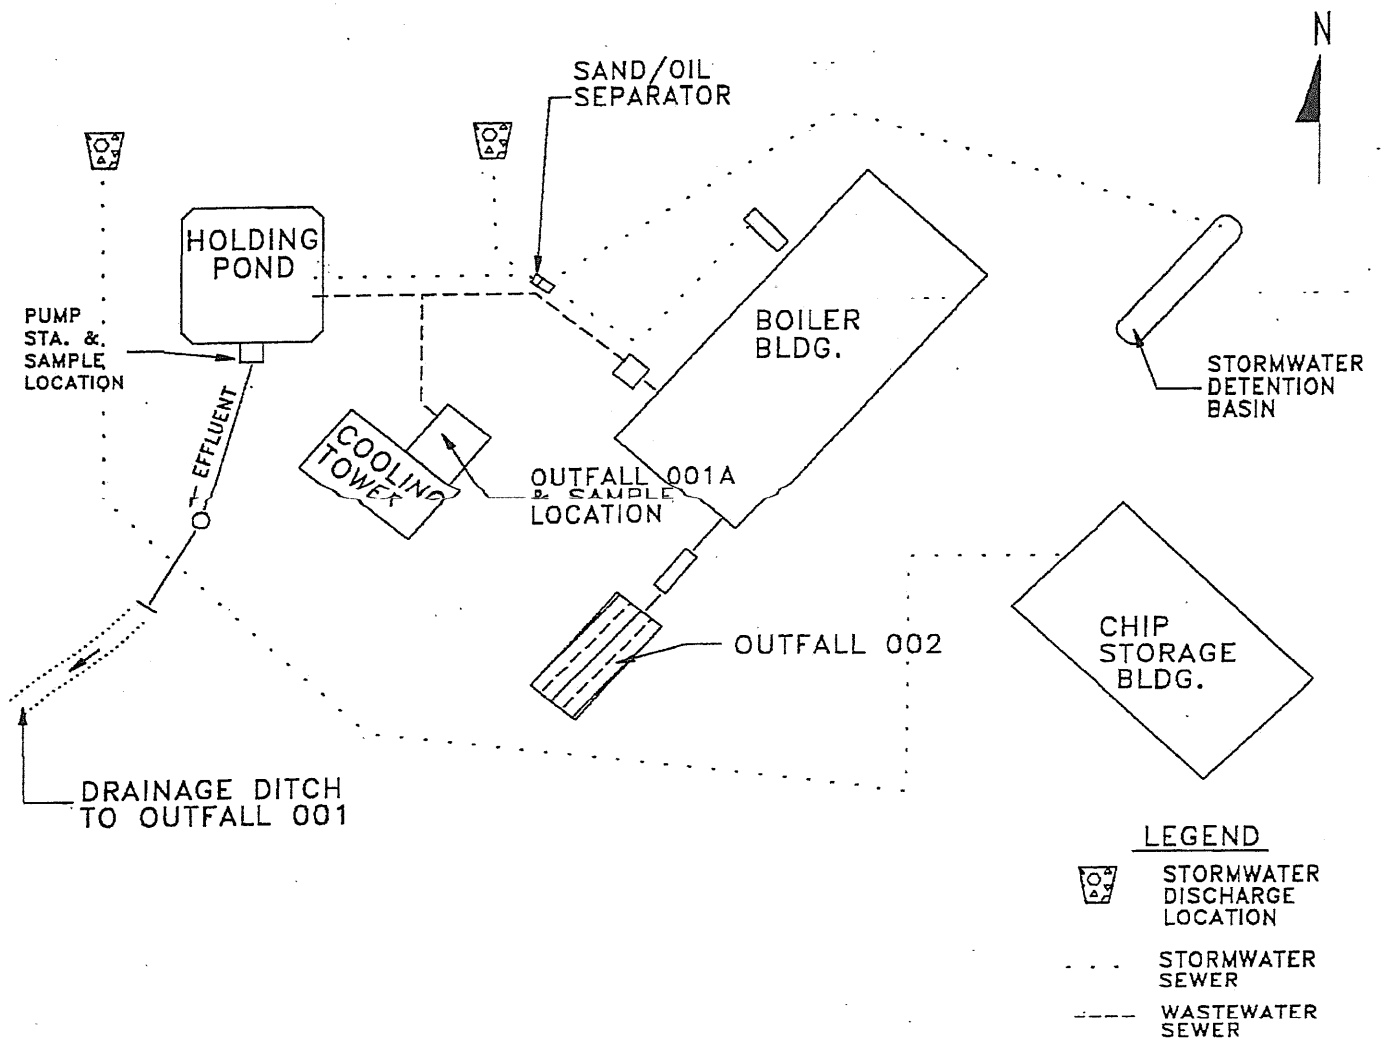

WASTEWATER SCHEMATIC

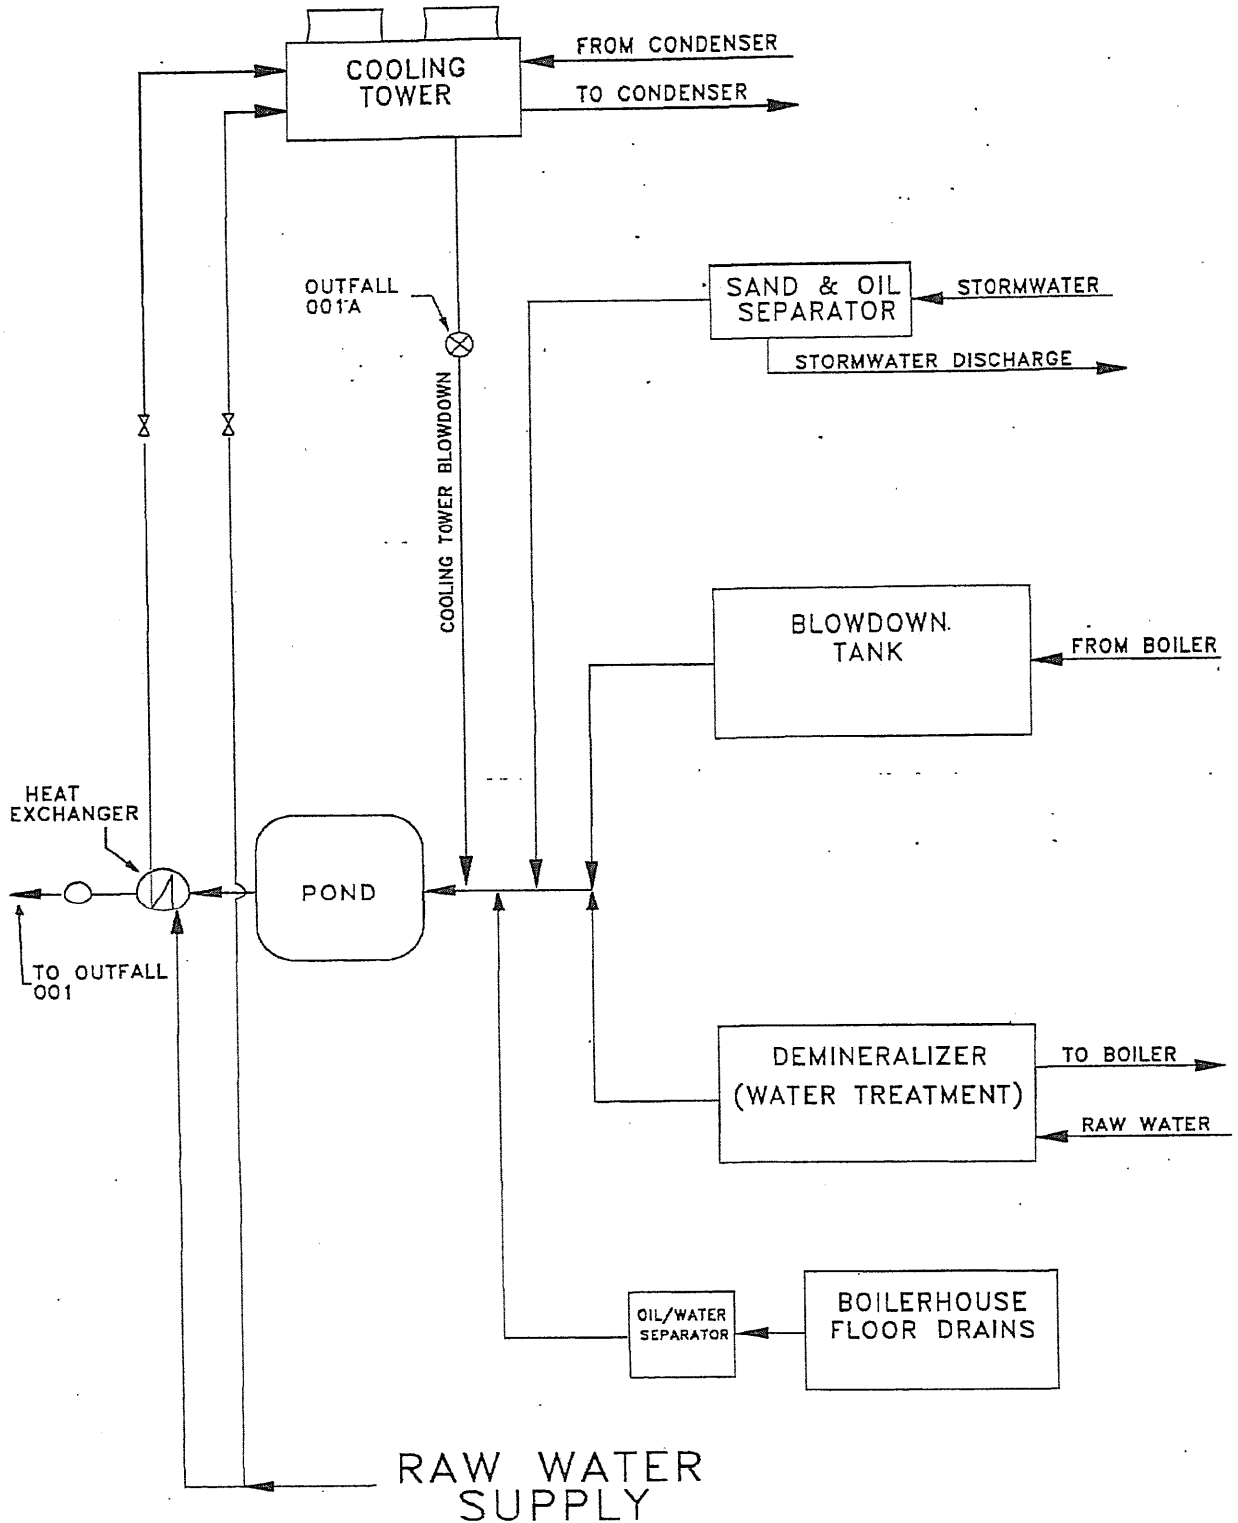

RECORDING, REPORTING AND ADDITIONAL MONITORING REQUIREMENTS

- a) The permittee shall also refer to the General Conditions (Part II) of this permit for additional information concerning monitoring and reporting requirements and conditions.
- b) The monitoring information required by this permit shall be summarized, signed and retained for a period of three years from the date of the sampling for subsequent inspection by the Department or its designated agent. **Also;**

(if box is checked) monitoring information required by this permit shall be summarized and reported by submitting completed and signed Discharge Monitoring Report (DMR) forms for each one month reporting period to the locations specified below. Blank forms are available at the Department's Albany office listed below. The first reporting period begins on the effective date of this permit and the reports will be due no later than the 28th day of the month following the end of each reporting period.

Send the original (top sheet) of each DMR page to:

Department of Environmental Conservation
Division of Water
Bureau of Wastewater Facilities Operations
50 Wolf Road
Albany, New York 12233-3506
Phone: (518) 457-3790

Send the first copy (second sheet) of each DMR page to:

Department of Environmental Conservation
Regional Water Engineer
Route 86, P.O. Box 296
Ray Brook, NY 12977 - 0296
Phone: (518) 891-1370

- c) A monthly "Wastewater Facility Operation Report..." (form 92-15-7) shall be submitted (if box is checked) to the Regional Water Engineer and/or County Health Department or Environmental Control Agency listed above.
- d) **Noncompliance** with the provisions of this permit shall be reported to the Department as prescribed in the attached General Conditions (Part II)
- e) Monitoring must be conducted according to test procedures approved under 40 CFR Part 136, unless other test procedures have been specified in this permit.
- f) If the permittee monitors any pollutant more frequently than required by the permit, using test procedures approved under 40 CFR Part 136 or as specified in this permit, the results of this monitoring shall be included in the calculations and recording of the data on the Discharge Monitoring Reports.
- g) Calculation for all limitations which require averaging of measurements shall utilize an arithmetic mean unless otherwise specified in this permit.
- h) Unless otherwise specified, all information recorded on the Discharge Monitoring Report shall be based upon measurements and sampling carried out during the most recently completed reporting period.
- i) Any laboratory test or sample analysis required by this permit for which the State Commissioner of Health issues certificates of approval pursuant to section five hundred two of the Public Health Law shall be conducted by a laboratory which has been issued a certificate of approval. Inquiries regarding laboratory certification should be sent to the Environmental Laboratory Accreditation Program, New York State Health Department Center for Laboratories and Research, Division of Environmental Sciences, The Nelson A. Rockefeller Empire State Plaza, Albany, New York 12201.