



## State Pollutant Discharge Elimination System (SPDES) DISCHARGE PERMIT

|                           |                    |                         |                           |                            |                  |
|---------------------------|--------------------|-------------------------|---------------------------|----------------------------|------------------|
| SIC Code:                 | <b>7542</b>        | NAICS Code:             | <b>811192</b>             | SPDES Number:              | <b>NY0313238</b> |
| Discharge Class (CL):     | <b>01</b>          | DEC Number:             | <b>1-4734-01295/00001</b> |                            |                  |
| Toxic Class (TX):         | <b>N</b>           | Effective Date (EDP):   | <b>EDP</b>                |                            |                  |
| Major-Sub Drainage Basin: | <b>17 - 01</b>     | Expiration Date (ExDP): | <b>ExDP</b>               |                            |                  |
| Water Index Number:       | <b>Groundwater</b> | Item No.:               | <b>-</b>                  | Modification Dates (EDPM): |                  |
| Compact Area:             | <b>-</b>           |                         |                           |                            |                  |

This SPDES permit is issued in compliance with Title 8 of Article 17 of the Environmental Conservation Law of New York State.

| PERMITTEE NAME AND ADDRESS |                                |  |  |            |                       |
|----------------------------|--------------------------------|--|--|------------|-----------------------|
| Name:                      | <b>AEJB Inc.</b>               |  |  | Attention: | <b>Andrew Ehrlich</b> |
| Street:                    | <b>836 Middle Country Road</b> |  |  |            |                       |
| City:                      | <b>St. James</b>               |  |  | State:     | <b>NY</b>             |
|                            |                                |  |  | Zip Code:  | <b>11780</b>          |
| Email:                     | <b>tocwash01@gmail.com</b>     |  |  | Phone:     | <b>(631)404-7150</b>  |

is authorized to discharge from the facility described below:

| FACILITY NAME, ADDRESS, AND PRIMARY OUTFALL |                                   |                  |                    |               |               |              |               |                 |               |
|---------------------------------------------|-----------------------------------|------------------|--------------------|---------------|---------------|--------------|---------------|-----------------|---------------|
| Name:                                       | <b>Touch of Class Car Wash</b>    |                  |                    |               |               |              |               |                 |               |
| Address / Location:                         | <b>836 Middle Country Road</b>    |                  |                    |               |               |              | County:       | <b>Suffolk</b>  |               |
| City:                                       | <b>Suffolk</b>                    |                  |                    |               | State:        | <b>NY</b>    | Zip Code:     | <b>11780</b>    |               |
| Facility Location:                          | Latitude:                         | <b>40</b> °      | <b>61</b> '        | <b>36</b> " N | & Longitude:  | <b>73</b> °  | <b>8</b> '    | <b>56.4</b> " W |               |
| Primary Outfall No.:                        | <b>001</b>                        | Latitude:        | <b>40</b> °        | <b>51</b> '   | <b>40</b> " N | & Longitude: | <b>73</b> °   | <b>8</b> '      | <b>47</b> " W |
| Wastewater Description:                     | <b>Treated Car Wash Discharge</b> | Receiving Water: | <b>Groundwater</b> |               |               | NAICS:       | <b>811192</b> | Class:          | <b>GA</b>     |
|                                             |                                   |                  |                    |               |               |              |               | Standard:       | <b>GA</b>     |

in accordance with: effluent limitations; monitoring and reporting requirements; other provisions and conditions set forth in this permit; and 6 NYCRR Part 750-1 and 750-2.

This permit and the authorization to discharge shall expire on midnight of the expiration date shown above and the permittee shall not discharge after the expiration date unless this permit has been renewed or extended pursuant to law. To be authorized to discharge beyond the expiration date, the permittee shall apply for permit renewal not less than 180 days prior to the expiration date shown above.

### DISTRIBUTION:

BWP Permit Coordinator ([permit.coordinator@dec.ny.gov](mailto:permit.coordinator@dec.ny.gov))

BWP Permit Writer

RWE

RPA

SCDHS

|                       |                                              |
|-----------------------|----------------------------------------------|
| Permit Administrator: |                                              |
| Address:              | <b>50 Circle Road, Stony Brook, NY 11790</b> |
|                       |                                              |
| Signature             | Date                                         |

## Contents

|                                                                  |     |
|------------------------------------------------------------------|-----|
| DEFINITIONS.....                                                 | 3   |
| PERMIT LIMITS, LEVELS AND MONITORING.....                        | 4   |
| STORMWATER POLLUTION PREVENTION REQUIREMENTS .....               | 6   |
| BEST MANAGEMENT PRACTICES (BMPs) FOR INDUSTRIAL FACILITIES ..... | 7   |
| MONITORING LOCATIONS.....                                        | 99  |
| GENERAL REQUIREMENTS.....                                        | 10  |
| RECORDING, REPORTING AND ADDITIONAL MONITORING REQUIREMENTS..... | 11  |
| D. Schedule of Additional Submittals:.....                       | 111 |

DRAFT

## DEFINITIONS

| TERM                                   | DEFINITION                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
|----------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 7-Day Geo Mean                         | The highest allowable geometric mean of daily discharges over a calendar week.                                                                                                                                                                                                                                                                                                                                                                                                |
| 7-Day Average                          | The average of all daily discharges for each 7-days in the monitoring period. The sample measurement is the highest of the 7-day averages calculated for the monitoring period.                                                                                                                                                                                                                                                                                               |
| 12-Month Rolling Average (12 MRA)      | The current monthly value of a parameter, plus the sum of the monthly values over the previous 11 months for that parameter, divided by the number of months for which samples were collected in the 12-month period.                                                                                                                                                                                                                                                         |
| 30-Day Geometric Mean                  | The highest allowable geometric mean of daily discharges over a calendar month, calculated as the antilog of: the sum of the log of each of the daily discharges measured during a calendar month divided by the number of daily discharges measured during that month.                                                                                                                                                                                                       |
| Action Level                           | Action level means a monitoring requirement characterized by a numerical value that, when exceeded, triggers additional permittee actions and department review to determine if numerical effluent limitations should be imposed.                                                                                                                                                                                                                                             |
| Compliance Level / Minimum Level       | A compliance level is an effluent limitation. A compliance level is given when the water quality evaluation specifies a Water Quality Based Effluent Limit (WQBEL) below the Minimum Level. The compliance level shall be set at the Minimum Level (ML) for the most sensitive analytical method as given in 40 CFR Part 136, or otherwise accepted by the DEC.                                                                                                               |
| Daily Discharge                        | The discharge of a pollutant measured during a calendar day or any 24-hour period that reasonably represents the calendar day for the purposes of sampling. For pollutants expressed in units of mass, the 'daily discharge' is calculated as the total mass of the pollutant discharged over the day. For pollutants with limitations expressed in other units of measurement, the 'daily discharge' is calculated as the average measurement of the pollutant over the day. |
| Daily Maximum                          | The highest allowable Daily Discharge.                                                                                                                                                                                                                                                                                                                                                                                                                                        |
| Daily Minimum                          | The lowest allowable Daily Discharge.                                                                                                                                                                                                                                                                                                                                                                                                                                         |
| Effective Date of Permit (EDP or EDPM) | The date this permit is in effect.                                                                                                                                                                                                                                                                                                                                                                                                                                            |
| Effluent Limitations                   | Effluent limitation means any restriction on quantities, quality, rates and concentrations of chemical, physical, biological, and other constituents of effluents that are discharged into waters of the state.                                                                                                                                                                                                                                                               |
| Expiration Date of Permit (ExDP)       | The date this permit is no longer in effect.                                                                                                                                                                                                                                                                                                                                                                                                                                  |
| Instantaneous Maximum                  | The maximum level that may not be exceeded at any instant in time.                                                                                                                                                                                                                                                                                                                                                                                                            |
| Instantaneous Minimum                  | The minimum level that must be maintained at all instants in time.                                                                                                                                                                                                                                                                                                                                                                                                            |
| Monthly Average                        | The highest allowable average of daily discharges over a calendar month, calculated as the sum of each of the daily discharges measured during a calendar month divided by the number of daily discharges measured during that month.                                                                                                                                                                                                                                         |
| Outfall                                | The terminus of a sewer system, or the point of emergence of any waterborne sewage, industrial waste or other wastes or the effluent therefrom, into the waters of the State.                                                                                                                                                                                                                                                                                                 |
| Range                                  | The minimum and maximum instantaneous measurements for the reporting period must remain between the two values shown.                                                                                                                                                                                                                                                                                                                                                         |
| Receiving Water                        | The classified waters of the state to which the listed outfall discharges.                                                                                                                                                                                                                                                                                                                                                                                                    |
| Sample Frequency / Sample Type / Units | See DEC's "DMR Manual for Completing the Discharge Monitoring Report for the SPDES" for information on sample frequency, type and units.                                                                                                                                                                                                                                                                                                                                      |

# PERMIT LIMITS, LEVELS AND MONITORING

| OUTFALL | DESCRIPTION               | RECEIVING WATER | EFFECTIVE | EXPIRING |
|---------|---------------------------|-----------------|-----------|----------|
| 001     | Treated Car Wash Effluent | Groundwater     | EDP       | ExDP     |

| PARAMETER                    | EFFLUENT LIMITATION |       |       |       |       | MONITORING REQUIREMENTS |             |          |      | FN |
|------------------------------|---------------------|-------|-------|-------|-------|-------------------------|-------------|----------|------|----|
|                              | Type                | Limit | Units | Limit | Units | Sample Frequency        | Sample Type | Location |      |    |
|                              |                     |       |       |       |       |                         |             | Inf.     | Eff. |    |
| Flow                         | Daily Maximum       | 7,000 | GPD   | -     | -     | Continuous              | Meter       | -        | X    | -  |
| pH                           | Daily Minimum       | 6.5   | SU    | -     | -     | Monthly                 | Grab        | -        | X    | -  |
|                              | Daily Maximum       | 8.5   | SU    | -     | -     |                         |             |          |      | -  |
| Total Suspended Solids (TSS) | Daily Maximum       | 30    | mg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Total Dissolved Solids (TDS) | Daily Maximum       | 1,000 | mg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Chloride                     | Daily Maximum       | 500   | mg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Foaming Agents               | Daily Maximum       | 1     | mg/L  | -     | -     | Monthly                 | Grab        | -        | X    | 1  |
| Oil and Grease               | Daily Maximum       | 15    | mg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Aluminum                     | Daily Maximum       | 2000  | ug/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Antimony                     | Daily Maximum       | 6     | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Arsenic                      | Daily Maximum       | 50    | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Beryllium                    | Daily Maximum       | 3     | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Cadmium                      | Daily Maximum       | 10    | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Chromium                     | Daily Maximum       | 100   | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Copper                       | Daily Maximum       | 400   | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Iron                         | Daily Maximum       | 600   | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Lead                         | Daily Maximum       | 50    | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Nickel                       | Daily Maximum       | 200   | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Silver                       | Daily Maximum       | 100   | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Thallium                     | Daily Maximum       | 0.5   | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Zinc                         | Daily Maximum       | 5     | mg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Acetone                      | Daily Maximum       | 50    | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Benzene                      | Daily Maximum       | 1     | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Bis[2-ethylhexyl]phthalate   | Daily Maximum       | 6.4   | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | 2  |
| Chloroform                   | Daily Maximum       | 7     | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Diethyl Phthalate            | Daily Maximum       | 50    | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Ethylbenzene                 | Daily Maximum       | 5     | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Methylene Chloride           | Daily Maximum       | 5     | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Naphthalene                  | Daily Maximum       | 10    | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Phenol, Total                | Daily Maximum       | 6.4   | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | 3  |

Page 5 of 12 V.

| PARAMETER         | EFFLUENT LIMITATION |       |       |       |       | MONITORING REQUIREMENTS |             |          |      | FN |
|-------------------|---------------------|-------|-------|-------|-------|-------------------------|-------------|----------|------|----|
|                   | Type                | Limit | Units | Limit | Units | Sample Frequency        | Sample Type | Location |      |    |
|                   |                     |       |       |       |       |                         |             | Inf.     | Eff. |    |
| Tetrachloroethene | Daily Maximum       | 5     | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Toluene           | Daily Maximum       | 5     | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Trichloroethene   | Daily Maximum       | 5     | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Xylene (m+p)      | Daily Maximum       | 10    | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |
| Xylene (o)        | Daily Maximum       | 5     | µg/L  | -     | -     | Monthly                 | Grab        | -        | X    | -  |

**FOOTNOTES:**

1. Surfactants (foaming agents) determined as methylene blue active substances (MBAS), or other tests as specified by the Commissioner.
2. Bis[2-ethylhexyl]phthalate shall be determined by colorimetric or spectrophotometric analysis using the most sufficiently sensitive method approved under 40 CFR Part 136 for total recoverable phenols.
3. Total phenols shall be determined by colorimetric or spectrophotometric analysis using the most sufficiently sensitive method approved under 40 CFR Part 136 for total recoverable phenols.

## STORMWATER POLLUTION PREVENTION REQUIREMENTS

### **NO EXPOSURE CERTIFICATION**

The permittee submitted a Conditional Exclusion for No Exposure Form on 05/27/2025, certifying that all industrial activities and materials are completely sheltered from exposure to rain, snow, snowmelt, and stormwater runoff except as allowed under 40 CFR 122.26(g)(2). The permittee must maintain a condition of no exposure for the exclusion to remain applicable. If conditions change resulting in the exposure of materials and activities to stormwater, the permittee must notify the Regional Water Engineer. The permittee must recertify a condition of no exposure every five years by completing the "No Exposure Certification Form" found on the DEC website.

DRAFT

## BEST MANAGEMENT PRACTICES (BMPs) FOR INDUSTRIAL FACILITIES

Note that for some facilities, especially those with few employees or limited industrial activities, some of the below BMPs may not be applicable. It is acceptable in these cases to indicate "Not Applicable" for the portion(s) of the BMP Plan that do not apply to your facility, along with an explanation.

1. **General** - The permittee shall develop, maintain, and implement a Best Management Practices (BMP) plan to prevent releases of significant amounts of pollutants to the waters of the State through plant site runoff; spillage and leaks; sludge or waste disposal; and stormwater discharges including, but not limited to, drainage from raw material storage. The BMP plan shall be documented in narrative form and shall include the 13 minimum BMPs and any necessary plot plans, drawings, or maps. Other documents already prepared for the facility such as a Safety Manual or a Spill Prevention, Control and Countermeasure (SPCC) plan may be used as part of the plan and may be incorporated by reference. A copy of the current BMP plan shall be submitted to the DEC as required in item (2.) below and a copy must be maintained at the facility and shall be available to authorized DEC representatives upon request.
2. **Compliance Deadlines** – The permittee shall develop and submit an initial BMP plan in accordance with the Schedule of Submittals to the Regional Water Engineer. The permittee shall implement the BMP plan within 6 months of submission, unless a different time frame is approved by the Department through a permit modification.
3. **Facility Review** - The permittee shall review all facility components or systems (including but not limited to material storage areas; in-plant transfer, process, and material handling areas; loading and unloading operations; storm water, erosion, and sediment control measures; process emergency control systems; and sludge and waste disposal areas) where materials or pollutants are used, manufactured, stored or handled to evaluate the potential for the release of pollutants to the waters of the State. In performing such an evaluation, the permittee shall consider such factors as the probability of equipment failure or improper operation, cross-contamination of storm water by process materials, settlement of facility air emissions, the effects of natural phenomena such as freezing temperatures and precipitation, fires, and the facility's history of spills and leaks. The permittee shall consider relative toxicity of the pollutant in determining the significance of potential releases. The review shall address all substances present at the facility that are identified in the SPDES application Form NY-2C (available at [SPDES Application Procedures and Forms - NYSDEC](#)) or that are required to be monitored for by the SPDES permit.
4. **13 Minimum BMPs:** Whenever the potential for a release of pollutants to State waters is determined to be present, the permittee shall identify BMPs that have been established to prevent or minimize such potential releases. Where BMPs are inadequate or absent, appropriate BMPs shall be established. In selecting appropriate BMPs, the permittee shall consider good industry practices and, where appropriate, structural measures such as secondary containment and erosion/sediment control devices and practices. USEPA guidance for development of stormwater elements of the BMP is available in *Developing Your Stormwater Pollution Prevention Plan A Guide for Industrial Operators*, February 2009, EPA 833-B-09-002. As a minimum, the plan shall include the following BMPs:

- |                                     |                                                       |                                 |
|-------------------------------------|-------------------------------------------------------|---------------------------------|
| 1. BMP Pollution Prevention Team    | 6. Security                                           | 10. Spill Prevention & Response |
| 2. Reporting of BMP Incidents       | 7. Preventive Maintenance                             | 11. Erosion & Sediment Control  |
| 3. Risk Identification & Assessment | 8. Good Housekeeping                                  | 12. Management of Runoff        |
| 4. Employee Training                | 9. Materials/Waste Handling, Storage, & Compatibility | 13. Street Sweeping             |
| 5. Inspections and Records          |                                                       |                                 |

## BMPs FOR INDUSTRIAL FACILITIES (continued)


5. **Stormwater Pollution Prevention Plans (SWPPPs) Required for Discharges of Stormwater from Construction Activity to Surface Waters** - A SWPPP shall be developed prior to commencing any construction activity that will result in soil disturbance of one or more acres of uncontaminated area<sup>1</sup>. (Note: the disturbance threshold is 5000 SF in the New York City East of Hudson Watershed). The SWPPP shall conform to the current version of the SPDES General Permit for Stormwater Discharges from Construction Activity (CGP), including the *New York Standards and Specifications for Erosion and Sediment Control* and *New York State Stormwater Management Design Manual*. The permittee shall submit a copy of the SWPPP and any amendments thereto to the local governing body and any other authorized agency having jurisdiction or regulatory control over the construction activity **at least 30 days prior to soil disturbance**. The SWPPP shall be maintained on-site and submitted to the Department only upon request. When a SWPPP is required, a properly completed *Notice of Intent* (NOI) form shall be submitted (available at [Stormwater Permit for Construction Activity - NYSDEC](#)) prior to soil disturbance. Note that submission of the NOI is required for informational purposes; the permittee is not eligible for and will not obtain coverage under any SPDES general permit for stormwater discharges. SWPPPs must be developed for subsequent site disturbances in accordance with the above requirements. The permittee is responsible for ensuring that the provisions of each SWPPP are properly implemented.
6. **Required Sampling For "Hot Spot" Identification** - The permittee's development of the BMP plan shall include sampling of waste stream segments for the purpose of pollutant "hot spot" identification. The economic achievability of effluent limits will not be considered until plant site "hot spot" sources have been identified, contained, removed or minimized through the imposition of site specific BMPs or application of internal facility treatment technology. For the purposes of this permit condition a "hot spot" is a segment of an industrial facility (including but not limited to soil, equipment, material storage areas, sewer lines etc.) which contributes elevated levels of problem pollutants to the wastewater or stormwater collection system of that facility. For the purposes of this definition, problem pollutants are substances for which treatment to meet a water quality or technology requirement may, considering the results of waste stream segment sampling, be deemed unreasonable. For the purposes of this definition, an elevated level is a concentration or mass loading of the pollutant in question which is sufficiently higher than the concentration of that same pollutant at the compliance monitoring location so as to allow for an economically justifiable removal, isolation, or B.A.T. treatment of wastewaters emanating from the segment.

---

<sup>1</sup> Uncontaminated area means soils which are free of contamination by any toxic or non-conventional pollutants identified in the tables of SPDES Application Form NY-2C. Disturbance of any size contaminated area(s) and the resulting discharge of contaminated stormwater is not authorized by this permit unless the discharge is under State or Federal oversight as part of a remedial program or after review by the Regional Water Engineer; nor is such discharge authorized by any SPDES general permit for stormwater discharges.

## MONITORING LOCATIONS

The permittee shall take samples and measurements, to comply with the monitoring requirements specified in this permit, at the location(s) specified below:

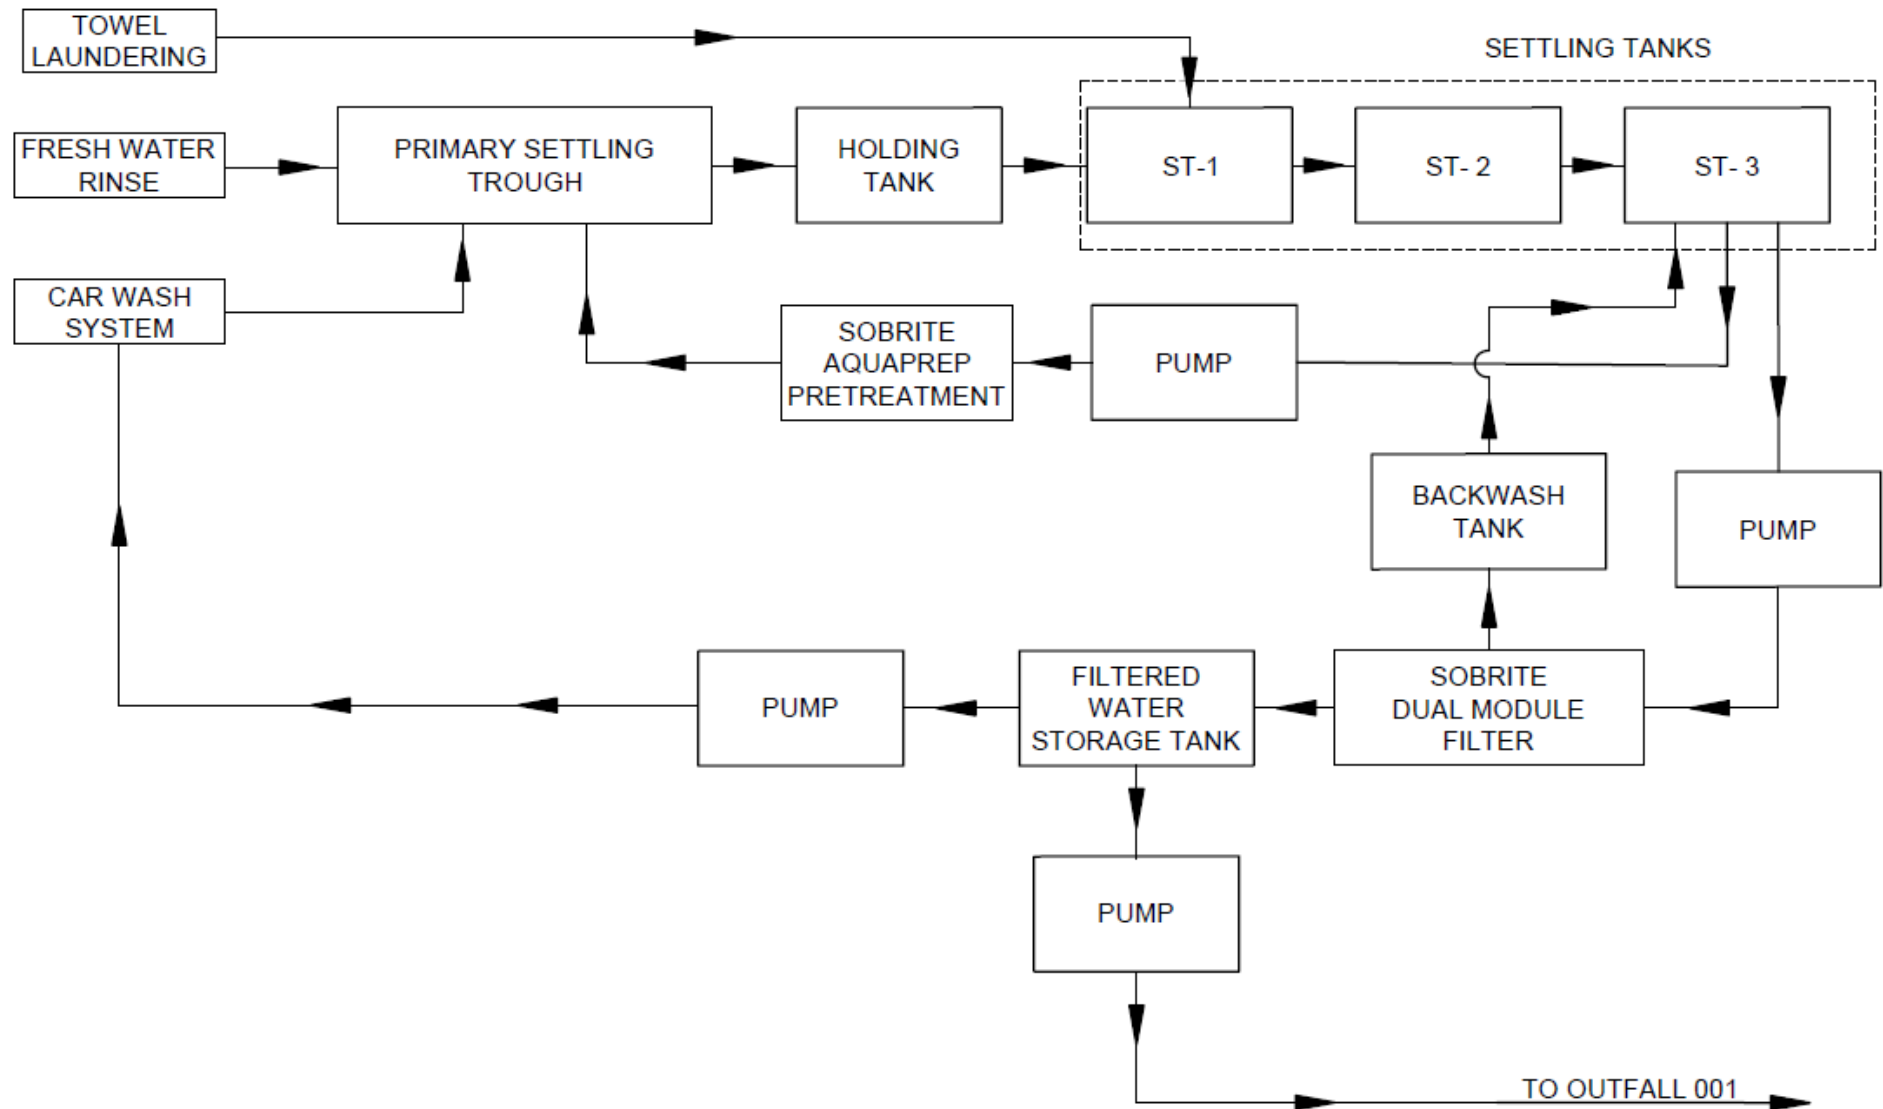

## GENERAL REQUIREMENTS

- A. The regulations in 6 NYCRR Part 750 are hereby incorporated by reference and the conditions are enforceable requirements under this permit. The permittee shall comply with all requirements set forth in this permit and with all the applicable requirements of 6 NYCRR Part 750 incorporated into this permit by reference, including but not limited to the regulations in paragraphs B through H as follows:
- B. General Conditions
- |                                                  |                                         |
|--------------------------------------------------|-----------------------------------------|
| 1. Duty to comply                                | 6 NYCRR 750-2.1(e) & 2.4                |
| 2. Duty to reapply                               | 6 NYCRR 750-1.16(a)                     |
| 3. Need to halt or reduce activity not a defense | 6 NYCRR 750-2.1(g)                      |
| 4. Duty to mitigate                              | 6 NYCRR 750-2.7(f)                      |
| 5. Permit actions                                | 6 NYCRR 750-1.1(c), 1.18, 1.20 & 2.1(h) |
| 6. Property rights                               | 6 NYCRR 750-2.2(b)                      |
| 7. Duty to provide information                   | 6 NYCRR 750-2.1(i)                      |
| 8. Inspection and entry                          | 6 NYCRR 750-2.1(a) & 2.3                |
- C. Operation and Maintenance
- |                                   |                                      |
|-----------------------------------|--------------------------------------|
| 1. Proper Operation & Maintenance | 6 NYCRR 750-2.8                      |
| 2. Bypass                         | 6 NYCRR 750-1.2(a)(17), 2.8(b) & 2.7 |
| 3. Upset                          | 6 NYCRR 750-1.2(a)(94) & 2.8(c)      |
- D. Monitoring and Records
- |                           |                                                                  |
|---------------------------|------------------------------------------------------------------|
| 1. Monitoring and records | 6 NYCRR 750-2.5(a)(2), 2.5(a)(6), 2.5(c)(1), 2.5(c)(2), & 2.5(d) |
| 2. Signatory requirements | 6 NYCRR 750-1.8 & 2.5(b)                                         |
- E. Reporting Requirements
- |                                         |                                   |
|-----------------------------------------|-----------------------------------|
| 1. Reporting requirements for non-POTWs | 6 NYCRR 750-2.5, 2.6, 2.7, & 1.17 |
| 2. Anticipated noncompliance            | 6 NYCRR 750-2.7(a)                |
| 3. Transfers                            | 6 NYCRR 750-1.17                  |
| 4. Monitoring reports                   | 6 NYCRR 750-2.5(e)                |
| 5. Compliance schedules                 | 6 NYCRR 750-1.14(d)               |
| 6. 24-hour reporting                    | 6 NYCRR 750-2.7(c) & (d)          |
| 7. Other noncompliance                  | 6 NYCRR 750-2.7(e)                |
| 8. Other information                    | 6 NYCRR 750-2.1(f)                |
- F. Sludge Management
- The permittee shall comply with all applicable requirements of 6 NYCRR Part 360 series.
- G. SPDES Permit Program Fee
- The permittee shall pay to the DEC an annual SPDES permit program fee within 30 days of the date of the first invoice, unless otherwise directed by the DEC, and shall comply with all applicable requirements of ECL 72-0602 and 6 NYCRR Parts 480, 481 and 485. Note that if there is inconsistency between the fees specified in ECL 72-0602 and 6 NYCRR Part 485, the ECL 72-0602 fees govern.
- H. Water Treatment Chemicals (WTCs)
- New or increased use and discharge of a WTC requires prior DEC review and authorization. At a minimum, the permittee must notify the DEC in writing of its intent to change WTC use by submitting a completed *WTC Notification Form* for each proposed WTC. The DEC will review that submittal and determine if a SPDES permit modification is necessary or whether WTC review and authorization may proceed outside of the formal permit administrative process. The use and discharge of a WTC shall not proceed without prior authorization from the DEC. Examples of WTCs include biocides, coagulants, conditioners, corrosion inhibitors, defoamers, deposit control agents, flocculants, scale inhibitors, sequestrants, and settling aids.
1. WTC use shall not exceed the rate explicitly authorized by this permit or otherwise authorized by the DEC.
  2. The permittee shall maintain a logbook of all WTC use, noting for each WTC the date, time, exact location, and amount of each dosage, and, the name of the individual applying or measuring the chemical. The logbook must also document that adequate process controls are in place to ensure excessive levels of WTCs are not used.
  3. The permittee shall submit a completed WTC Annual Report Form each year that they use and discharge WTCs. This form shall be submitted in electronic format and attached to either the December DMR or the annual monitoring report required below. The *WTC Notification Form* and *WTC Annual Report Form* are available from the DEC's website at: [SPDES Permitting of Water Treatment Chemicals](#).

## RECORDING, REPORTING AND ADDITIONAL MONITORING REQUIREMENTS

- A. The permittee shall retain the monitoring information required by this permit for a period of at least five years from the date of the sampling.
- B. Discharge Monitoring Reports (DMRs): The permittee shall submit completed DMR forms for each 1 month reporting period in accordance with the DMR Manual available on DEC's website.

The permittee must submit DMRs electronically using the electronic reporting tool (NetDMR) specified by DEC. Instructions on the use of NetDMR can be found at: [How To Complete And Submit Discharge Monitoring Reports \(DMRs\) - NYSDEC](#). **Hardcopy paper DMRs will only be accepted if a waiver from the electronic submittal requirements has been granted by DEC to the facility.**

The first monitoring period begins on the effective date of this permit, and, unless otherwise required, the reports are due no later than the 28th day of the month following the end of each monitoring period.

- C. Additional information required to be submitted by this permit shall be summarized and reported to the Regional Water Engineer and Bureau of Water Permits at the following addresses:

Department of Environmental Conservation  
Division of Water, Bureau of Water Permits  
625 Broadway, Albany, New York 12233-3505

Phone: (518) 402-8111

Department of Environmental Conservation  
Regional Water Engineer, Region 1

50 Circle Road, Stony Brook, New York, 11790-3409 Phone: (631) 444-0405

- D. Schedule of Additional Submittals:

The permittee shall submit the following information to the Regional Water Engineer and to the Bureau of Water Permits, unless otherwise instructed:

| Outfall(s) | SCHEDULE OF ADDITIONAL SUBMITTALS - Required Action                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     | Due Date       |
|------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------|
| 001        | <u>EMERGING CONTAMINANT SHORT-TERM MONITORING</u><br>The permittee shall collect grab samples of both the influent and effluent from the facility's treatment system(s) associated with the identified outfall for Per- and Polyfluoroalkyl Substances (PFAS) utilizing EPA analytical method 1633 and 1,4-Dioxane (1,4-D) utilizing EPA Method 8270D SIM or 8270E SIM. The samples must represent normal discharge conditions and treatment operations and shall be obtained on a monthly basis for at least three (3) consecutive months. The results | EDP + 6 months |

| Outfall(s) | SCHEDULE OF ADDITIONAL SUBMITTALS - Required Action                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     | Due Date                                                        |
|------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------|
|            | <p>shall be reported through the “Emerging Contaminants Survey for Industrial Facilities” found at: <a href="#">Emerging Contaminants In NY's Waters - NYSDEC</a>. Please utilize the link above to access the chain of custody template, monitoring template for laboratories, and monitoring template instructions for laboratories. For each month, please fill out the chain of custody template to reflect the required analytical sampling for each outfall using the correct sample naming convention (example provided in the form). The chain of custody, monitoring template, and monitoring template instructions should then be provided to the laboratory. The laboratory should complete the monitoring template, utilizing EQuIS EDD format, for each month of sampling. The completed chain of custody, monitoring template, and PDF laboratory reports should be submitted with the Emerging Contaminants Survey.</p> <p>The permittee shall initiate track down of potential sources by completing the “Emerging Contaminants Investigation Checklist for Industrial Facilities” available at the above link.</p> <p>The DEC may periodically request updates or additional monitoring to check progress on track down investigations. Elements of the checklist may be used as permit conditions in future permit modifications.</p> | Within 90 days of DEC written notification                      |
| 001        | <p><b>NOTIFICATION OF START DATE (“START-UP”)</b></p> <p>The permittee shall provide the Department with the proposed start date for the treatment system. This date will be used to establish the start of compliance reporting. Notice can be provided via email to <a href="mailto:NetDMR@dec.ny.gov">NetDMR@dec.ny.gov</a>.</p>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     | 30 Days Prior to Start-up                                       |
| 001        | <p><b>BMP PLAN</b></p> <p>The permittee shall develop and submit a completed BMP plan to DEC on an annual basis. The BMP plan shall be modified whenever: (a) changes at the facility materially increase the potential for releases of pollutants, (b) actual releases indicate the plan is inadequate, or (c) a letter from the DEC identifies inadequacies in the plan. The permittee shall certify in writing, as an attachment to the December Discharge Monitoring Report (DMR), that the annual review has been completed. All BMP plan revisions must be submitted to the Regional Water Engineer within 30 days.</p>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           | EDP + 6 Months, Annually thereafter on January 28 <sup>th</sup> |
| 001        | <p><b>STORMWATER NO EXPOSURE CERTIFICATION</b></p> <p>Permittee must recertify every five years a condition of no exposure to stormwater in order to continue to qualify for the no exposure exclusion. The No Exposure Certification Form can be found on the DEC website.</p>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         | 05/27/2030 and every 5 years thereafter                         |

**Unless noted otherwise, the above actions are one-time requirements.**

- E. Monitoring and analysis shall be conducted using sufficiently sensitive test procedures approved under 40 CFR Part 136, unless other test procedures have been specified in this permit.
- F. More frequent monitoring of the discharge(s), monitoring point(s), or waters of the State than required by the permit, where analysis is performed by a certified laboratory or where such analysis is not required to be performed by a certified laboratory, shall be included in the calculations and recording of the data on the corresponding DMRs.
- G. Calculations which require averaging of measurements shall utilize an arithmetic mean unless otherwise specified in this permit.
- H. Unless otherwise specified, all information recorded on the DMRs shall be based upon measurements and sampling carried out during the most recently completed reporting period.
- I. Any laboratory test or sample analysis required by this permit for which the State Commissioner of Health issues certificates of approval pursuant to section 502 of the Public Health Law shall be conducted by a laboratory which has been issued a certificate of approval. Inquiries regarding laboratory certification should be directed to the New York State Department of Health, Environmental Laboratory Accreditation Program.

# **SPDES Permit Fact Sheet**

## **AEJB Inc**

### **Touch of Class Car Wash**

### **NY0313238**



## Summary of Permit Changes

A new State Pollutant Discharge Elimination System (SPDES) permit has been drafted for the Touch of Class Car Wash.

**This fact sheet summarizes the information used to determine the effluent limitations (limits) and other conditions contained in the permit. General background information including the regulatory basis for the effluent limitations and other conditions are in the [Appendix](#) linked throughout this fact sheet.**

## Administrative History

5/27/2025 The AEJB Inc submitted a NY-2C permit application.

The Notice of Complete Application, published in the [Environmental Notice Bulletin](#) and newspapers, contains information on the public notice process.


## Facility Information

This is an industrial facility (SIC code(s) 7542) that washing, waxing, and polishing motor vehicles. Effluent consists of treated wastewater from car wash. The current treatment system will be constructed in the near future to provide treatment to the car wash wastewater and includes the following treatment units:

- Primary Settling Trough (PST)
- Interconnected settling tanks
- SoBrite System: including electro-coagulation, UV disinfection, and dual-media filtration

Sludge is hauled to a landfill. The outfall is discharging to groundwater.

## Site Overview

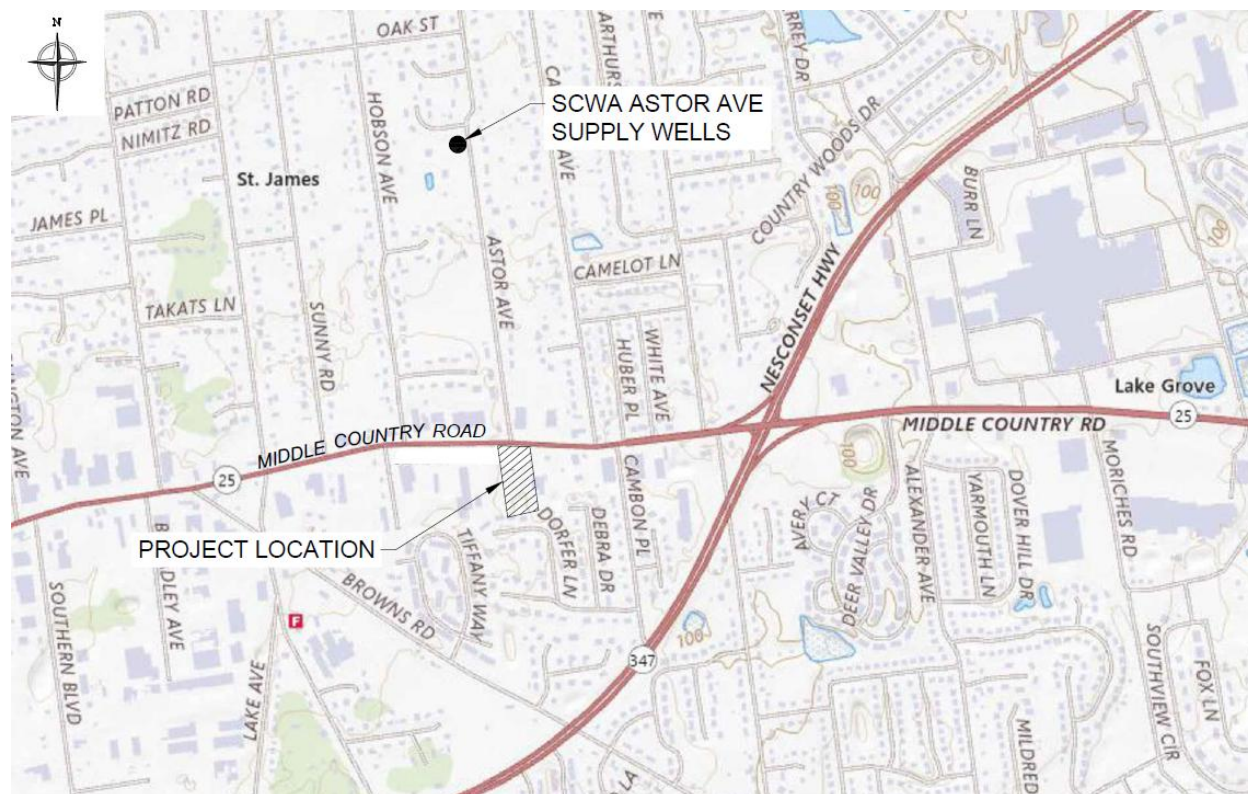

## Enforcement History

Compliance and enforcement information can be found on the EPA's [Enforcement and Compliance History Online \(ECHO\)](#) website.

## Existing Effluent Quality

The [Pollutant Summary Table](#) presents the existing effluent quality and effluent limitations. The existing effluent quality was determined from the application submitted by the permittee on 05/27/2025. [Appendix Link](#)

The facility is located in a sole source aquifer. As required by ECL 17-0828, the permittee submitted a completed *Application Supplement B: Discharges within Sole Source Aquifers* form identifying the following water purveyors within a three-mile radius of the facility: Suffolk County Water Authority (4060 Sunrise Highway, Oakdale, NY 11769), Saint James Water District (460 Lake Ave, St James, NY 11780).

## Receiving Water Information

The facility proposes to discharge via the following outfalls:

| Outfall No. | SIC Code | Wastewater Type             | Receiving Water       |
|-------------|----------|-----------------------------|-----------------------|
| 001         | 7542     | Treated Car Wash Wastewater | Groundwater, Class GA |

See the [Outfall and Receiving Water Summary Table](#) and [Appendix](#) for additional information.

Critical receiving water data are listed in the [Pollutant Summary Table](#) at the end of this fact sheet. [Appendix Link](#)

## Permit Requirements

The technology based effluent limitations ([TBELs](#)), water quality-based effluent limitations ([WQBELs](#)), [Existing Effluent Quality](#) and a discussion of the selected effluent limitation for each pollutant present in the discharge are provided in the [Pollutant Summary Table](#).

### Whole Effluent Toxicity (WET) Testing

None of the seven criteria that are indicative of potential toxicity are applicable to this facility; therefore, WET testing has not been included in the permit. [Appendix Link](#)

### Antidegradation

The permit contains effluent limitations which ensure that the best usages of the receiving waters will be maintained. The Notice of Complete Application published in the Environmental Notice Bulletin contains information on the State Environmental Quality Review (SEQR)<sup>1</sup> determination.

### Best Management Practices (BMPs) for Industrial Facilities

In accordance with 6 NYCRR 750-1.14(f) and 40 CFR 122.44(k), the permittee is required to develop and implement a BMP plan that prevents, or minimizes the potential for, the release of toxic or hazardous pollutants to state waters. The BMP plan requires annual review by the permittee.

### Stormwater Pollution Prevention Requirements

The facility discharges stormwater associated with industrial activity and requires SPDES permit coverage under 40 CFR 122.26(a)(6).

On 05/14/2025, the permittee submitted a Conditional Exclusion for No Exposure Form, certifying that all industrial activities and materials are completely sheltered from exposure. This condition must be maintained for the exclusion to remain applicable. The [Schedule of Additional Submittals](#) also includes a due date for re-certification every five years as required by 40 CFR 122.26(g)(iii). This requirement is new.

### Emerging Contaminant Monitoring

Pursuant to 6 NYCRR Part 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per- and Polyfluoroalkyl Substances (PFAS) and 1,4-Dioxane. This monitoring program is consistent with guidance released in EPA guidance memos dated April 28, 2022, and December 5, 2022.

The DEC will review the monitoring results and pursuant to 6 NYCRR 750-2.1(i) may notify the permittee of the need for further monitoring to identify potential sources as specified in the Emerging Contaminants Investigation Checklist for Industrial Facilities to determine whether cause exists to modify the permit to incorporate a pollutant minimization program per 6 NYCRR 750-1.14(f).

The DEC will consider this information and progress made to track down and reduce or eliminate the source of the identified pollutants in determining if a permit modification is needed.

---

<sup>1</sup> As prescribed by 6 NYCRR Part 617

Permittee: AEJB Inc  
Facility: Touch of Class Car Wash  
SPDES Number: NY0313238  
USEPA Non-Major/Class 01 Industrial

Date: July 14, 2025 v.1.32  
Permit Writer: Yufei Wu  
Water Quality Reviewer: -

Full Technical Review

### Schedule of Additional Submittals

A Schedule of Additional Submittals has been included for the following ([Appendix Link](#)):

- Emerging contaminant Short Term Monitoring
- BMP Plan
- Stormwater No Exposure Certification to be resubmitted every 5 years

## OUTFALL AND RECEIVING WATER SUMMARY TABLE

| Outfall | Latitude      | Longitude    | Receiving Water Name | Water Class | Water Index No. / Priority Waterbody Listing (PWL) No. | Major / Sub Basin | Hardness (mg/L) | 1Q10 (MGD) | 7Q10 (MGD) | 30Q10 (MGD) | Critical Effluent Flow (MGD) | Dilution Ratio |      |     |
|---------|---------------|--------------|----------------------|-------------|--------------------------------------------------------|-------------------|-----------------|------------|------------|-------------|------------------------------|----------------|------|-----|
|         |               |              |                      |             |                                                        |                   |                 |            |            |             |                              | A(A)           | A(C) | HEW |
| 001     | 40° 51' 40" N | 73° 8' 47" W | Groundwater          | GA          | -                                                      | 17/01             | -               | -          | -          | -           | 0.007                        | -              | -    | -   |

## POLLUTANT SUMMARY TABLE

### Outfall 001

| Outfall #                                                                                                                                                                                                                                                                                                                                                                                           | 001                                                                                                                                                                                        | Description of Wastewater: Treated Car Wash Discharge                                                                                       |                         |                                        |                                        |       |             |                                                                   |                          |               |         |             |                 |      |                              |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------|-------------------------|----------------------------------------|----------------------------------------|-------|-------------|-------------------------------------------------------------------|--------------------------|---------------|---------|-------------|-----------------|------|------------------------------|
|                                                                                                                                                                                                                                                                                                                                                                                                     |                                                                                                                                                                                            | Type of Treatment: Primary Settling Trough, Cyclonic Suspended Solids Removal, Granular Activated Carbon Filtration, and Ozone Disinfection |                         |                                        |                                        |       |             |                                                                   |                          |               |         |             |                 |      |                              |
| Effluent Parameter                                                                                                                                                                                                                                                                                                                                                                                  | Units                                                                                                                                                                                      | Averaging Period                                                                                                                            | Existing Discharge Data |                                        |                                        | TBELs |             | Water Quality Data & WQBELs                                       |                          |               |         |             |                 | ML   | Basis for Permit Requirement |
|                                                                                                                                                                                                                                                                                                                                                                                                     |                                                                                                                                                                                            |                                                                                                                                             | Permit Limit            | Existing Effluent Quality <sup>2</sup> | # of Data Points Detects / Non-Detects | Limit | Basis       | Ambient Bkgd. Conc.                                               | Projected Instream Conc. | WQ Std. or GV | WQ Type | Calc. WQBEL | Basis for WQBEL |      |                              |
| General Notes: Existing discharge data was obtained by the application provided by the permittee. All applicable water quality standards were reviewed for development of the WQBELs. The standard and WQBEL shown below represent the most stringent.<br>The technology based effluent limitations (TBELs) were developed from TOGS 1.2.1 Att.C, for category J (miscellaneous) treatment systems. |                                                                                                                                                                                            |                                                                                                                                             |                         |                                        |                                        |       |             |                                                                   |                          |               |         |             |                 |      |                              |
| Flow Rate                                                                                                                                                                                                                                                                                                                                                                                           | GPD                                                                                                                                                                                        | Daily Max                                                                                                                                   | -                       | -                                      | -                                      | 7,000 | Design Flow | No alterations that will impair the waters for their best usages. |                          |               |         | 703.2       | -               | TBEL |                              |
|                                                                                                                                                                                                                                                                                                                                                                                                     | The flow limit is set at the design flow of the wastewater treatment facility.                                                                                                             |                                                                                                                                             |                         |                                        |                                        |       |             |                                                                   |                          |               |         |             |                 |      |                              |
| pH                                                                                                                                                                                                                                                                                                                                                                                                  | SU                                                                                                                                                                                         | Minimum                                                                                                                                     | -                       | 7.17<br>Actual Min                     | 2/0                                    | 6.0   | TOGS 1.2.1  | -                                                                 | -                        | 6.5 – 8.5     | Range   | 6.5 - 8.5   | 703.3           | -    | WQBEL                        |
|                                                                                                                                                                                                                                                                                                                                                                                                     |                                                                                                                                                                                            | Maximum                                                                                                                                     | -                       | 7.17<br>Actual Max                     | 2/0                                    | 9.0   |             |                                                                   |                          |               |         |             |                 |      |                              |
|                                                                                                                                                                                                                                                                                                                                                                                                     | Consistent with TOGS 1.2.1, TBELs reflect the available treatment technology listed in Attachment C. Given the available dilution, an effluent limitation equal to the WQS is appropriate. |                                                                                                                                             |                         |                                        |                                        |       |             |                                                                   |                          |               |         |             |                 |      |                              |

<sup>2</sup> Existing Effluent Quality: The maximum value of the parameter if detected in the priority pollutant scan.

| Outfall #              | 001                                                                                                                                                                                                                                                                                                                                                                                                                                             | Description of Wastewater: Treated Car Wash Discharge                                                                                       |                         |                                        |                                        |       |            |                             |                                                                                                                            |               |         |                       |                            |      |                              |
|------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------|-------------------------|----------------------------------------|----------------------------------------|-------|------------|-----------------------------|----------------------------------------------------------------------------------------------------------------------------|---------------|---------|-----------------------|----------------------------|------|------------------------------|
|                        |                                                                                                                                                                                                                                                                                                                                                                                                                                                 | Type of Treatment: Primary Settling Trough, Cyclonic Suspended Solids Removal, Granular Activated Carbon Filtration, and Ozone Disinfection |                         |                                        |                                        |       |            |                             |                                                                                                                            |               |         |                       |                            |      |                              |
| Effluent Parameter     | Units                                                                                                                                                                                                                                                                                                                                                                                                                                           | Averaging Period                                                                                                                            | Existing Discharge Data |                                        |                                        | TBELs |            | Water Quality Data & WQBELs |                                                                                                                            |               |         |                       |                            | ML   | Basis for Permit Requirement |
|                        |                                                                                                                                                                                                                                                                                                                                                                                                                                                 |                                                                                                                                             | Permit Limit            | Existing Effluent Quality <sup>2</sup> | # of Data Points Detects / Non-Detects | Limit | Basis      | Ambient Bkgd. Conc.         | Projected Instream Conc.                                                                                                   | WQ Std. or GV | WQ Type | Calc. WQBEL           | Basis for WQBEL            |      |                              |
| Total Dissolved Solids | mg/L                                                                                                                                                                                                                                                                                                                                                                                                                                            | Daily Max                                                                                                                                   | -                       | 891                                    | 1/0                                    | -     | -          | -                           | -                                                                                                                          | 1,000         | -       | 1,000                 | <a href="#">703.6</a>      | -    | WQBEL                        |
|                        | Total Dissolved Solids was detected in the effluent as reported in the NY-2C application. Due to the industry type, Total Dissolved Solids is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.                                                                                                                        |                                                                                                                                             |                         |                                        |                                        |       |            |                             |                                                                                                                            |               |         |                       |                            |      |                              |
| Total Suspended Solids | mg/L                                                                                                                                                                                                                                                                                                                                                                                                                                            | Daily Max                                                                                                                                   | -                       | 34                                     | 1/0                                    | 30    | TOGS 1.2.1 | -                           | None from sewage, industrial wastes or other wastes that will cause deposition or impair the waters for their best usages. |               |         | <a href="#">703.2</a> | -                          | TBEL |                              |
|                        | Consistent with TOGS 1.2.1, TBELs reflect the available treatment technology listed in Attachment C. Due to the industry type, Total Suspended Solids is being added to the permit.                                                                                                                                                                                                                                                             |                                                                                                                                             |                         |                                        |                                        |       |            |                             |                                                                                                                            |               |         |                       |                            |      |                              |
| Ammonia (as N)         | mg/L                                                                                                                                                                                                                                                                                                                                                                                                                                            | Daily Max                                                                                                                                   | -                       | 1.4                                    | 1/0                                    | -     | -          | -                           | -                                                                                                                          | -             | -       | -                     | -                          | -    | No Limitation                |
|                        | Ammonia was detected in the effluent as reported in the NY-2C application. A numeric water quality standard for Ammonia (as N) does not exist for Class GA waterbodies. Therefore, no WQBEL is specified.                                                                                                                                                                                                                                       |                                                                                                                                             |                         |                                        |                                        |       |            |                             |                                                                                                                            |               |         |                       |                            |      |                              |
| Chloride               | mg/L                                                                                                                                                                                                                                                                                                                                                                                                                                            | Daily Max                                                                                                                                   | -                       | 885                                    | 1/0                                    | -     | -          | -                           | -                                                                                                                          | 500           | -       | 500                   | <a href="#">703.6</a>      | -    | WQBEL                        |
|                        | Chloride was detected in the effluent as reported in the NY-2C application. While the detected value indicates no reasonable potential to violate the groundwater effluent limitation, given the industry type and the seasonal nature of the parameter, Chloride is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration. |                                                                                                                                             |                         |                                        |                                        |       |            |                             |                                                                                                                            |               |         |                       |                            |      |                              |
| Foaming Agents         | mg/L                                                                                                                                                                                                                                                                                                                                                                                                                                            | Daily Max                                                                                                                                   | -                       | 3.99                                   | 1/0                                    | -     | -          | -                           | -                                                                                                                          | 1             | -       | 1                     | <a href="#">703.6</a>      | -    | WQBEL                        |
|                        | Due to the industry type, Surfactants are being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.                                                                                                                                                                                                                            |                                                                                                                                             |                         |                                        |                                        |       |            |                             |                                                                                                                            |               |         |                       |                            |      |                              |
| Oil and Grease         | mg/L                                                                                                                                                                                                                                                                                                                                                                                                                                            | Daily Max                                                                                                                                   | -                       | 7.8                                    | 1/0                                    | -     | -          | -                           | -                                                                                                                          | 15            | -       | 15                    | <a href="#">703.6</a>      | -    | WQBEL                        |
|                        | Oil and Grease was detected in the effluent as reported in the NY-2C application. Due to the industry type, Oil and Grease is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.                                                                                                                                        |                                                                                                                                             |                         |                                        |                                        |       |            |                             |                                                                                                                            |               |         |                       |                            |      |                              |
| Thallium               | µg/L                                                                                                                                                                                                                                                                                                                                                                                                                                            | Daily Max                                                                                                                                   | -                       | <2.0                                   | 0/1                                    | -     | -          | -                           | -                                                                                                                          | 0.5           | -       | 0.5                   | <a href="#">TOGS 1.1.1</a> | -    | WQBEL                        |
|                        | Due to the industry type, Thallium is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.                                                                                                                                                                                                                                |                                                                                                                                             |                         |                                        |                                        |       |            |                             |                                                                                                                            |               |         |                       |                            |      |                              |

| Outfall #          | 001                                                                                                                                                                                                               | Description of Wastewater: Treated Car Wash Discharge                                                                                       |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
|--------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------|-------------------------|----------------------------------------|----------------------------------------|-------|-------|-----------------------------|--------------------------|---------------|---------|-------------|----------------------------|----|------------------------------|
|                    |                                                                                                                                                                                                                   | Type of Treatment: Primary Settling Trough, Cyclonic Suspended Solids Removal, Granular Activated Carbon Filtration, and Ozone Disinfection |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Effluent Parameter | Units                                                                                                                                                                                                             | Averaging Period                                                                                                                            | Existing Discharge Data |                                        |                                        | TBELs |       | Water Quality Data & WQBELs |                          |               |         |             |                            | ML | Basis for Permit Requirement |
|                    |                                                                                                                                                                                                                   |                                                                                                                                             | Permit Limit            | Existing Effluent Quality <sup>2</sup> | # of Data Points Detects / Non-Detects | Limit | Basis | Ambient Bkgd. Conc.         | Projected Instream Conc. | WQ Std. or GV | WQ Type | Calc. WQBEL | Basis for WQBEL            |    |                              |
| Beryllium          | µg/L                                                                                                                                                                                                              | Daily Max                                                                                                                                   | -                       | <0.3                                   | 0/1                                    | -     | -     | -                           | -                        | 3             | -       | 3           | <a href="#">TOGS 1.1.1</a> | -  | WQBEL                        |
|                    | Due to the industry type, Beryllium is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration. |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Aluminum           | ug/L                                                                                                                                                                                                              | Daily Max                                                                                                                                   | -                       | 250                                    | 0/1                                    | -     | -     | -                           | -                        | 2000          | -       | 2000        | <a href="#">703.6</a>      | -  | WQBEL                        |
|                    | Due to the industry type, Aluminum is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater effluent limitation.              |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Arsenic            | µg/L                                                                                                                                                                                                              | Daily Max                                                                                                                                   | -                       | <0.01                                  | 0/1                                    | -     | -     | -                           | -                        | 50            | -       | 50          | <a href="#">703.6</a>      | -  | WQBEL                        |
|                    | Due to the industry type, Arsenic is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.   |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Nickel             | µg/L                                                                                                                                                                                                              | Daily Max                                                                                                                                   | -                       | <0.05                                  | 0/1                                    | -     | -     | -                           | -                        | 200           | -       | 200         | <a href="#">703.6</a>      | -  | WQBEL                        |
|                    | Due to the industry type, Nickel is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.    |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Cadmium            | µg/L                                                                                                                                                                                                              | Daily Max                                                                                                                                   | -                       | <0.001                                 | 0/1                                    | -     | -     | -                           | -                        | 10            | -       | 10          | <a href="#">703.6</a>      | -  | WQBEL                        |
|                    | Due to the industry type, Cadmium is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.   |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Chromium           | µg/L                                                                                                                                                                                                              | Daily Max                                                                                                                                   | -                       | 0.05                                   | 1/0                                    | -     | -     | -                           | -                        | 100           | -       | 100         | <a href="#">TOGS 1.1.1</a> | -  | WQBEL                        |
|                    | Due to the industry type, Chromium is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.  |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Lead               | µg/L                                                                                                                                                                                                              | Daily Max                                                                                                                                   | -                       | <0.05                                  | 0/1                                    | -     | -     | -                           | -                        | 50            | -       | 50          | <a href="#">703.6</a>      | -  | WQBEL                        |
|                    | Due to the industry type, Lead is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.      |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Silver             | µg/L                                                                                                                                                                                                              | Daily Max                                                                                                                                   | -                       | <0.05                                  | 0/1                                    | -     | -     | -                           | -                        | 100           | -       | 100         | <a href="#">703.6</a>      | -  | WQBEL                        |
|                    | Due to the industry type, Silver is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.    |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |

| Outfall #          | 001                                                                                                                                                                                                                                                                                      | Description of Wastewater: Treated Car Wash Discharge                                                                                       |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
|--------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------|-------------------------|----------------------------------------|----------------------------------------|-------|-------|-----------------------------|--------------------------|---------------|---------|-------------|----------------------------|----|------------------------------|
|                    |                                                                                                                                                                                                                                                                                          | Type of Treatment: Primary Settling Trough, Cyclonic Suspended Solids Removal, Granular Activated Carbon Filtration, and Ozone Disinfection |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Effluent Parameter | Units                                                                                                                                                                                                                                                                                    | Averaging Period                                                                                                                            | Existing Discharge Data |                                        |                                        | TBELs |       | Water Quality Data & WQBELs |                          |               |         |             |                            | ML | Basis for Permit Requirement |
|                    |                                                                                                                                                                                                                                                                                          |                                                                                                                                             | Permit Limit            | Existing Effluent Quality <sup>2</sup> | # of Data Points Detects / Non-Detects | Limit | Basis | Ambient Bkgd. Conc.         | Projected Instream Conc. | WQ Std. or GV | WQ Type | Calc. WQBEL | Basis for WQBEL            |    |                              |
| Antimony           | µg/L                                                                                                                                                                                                                                                                                     | Daily Max                                                                                                                                   | -                       | 12.6                                   | 1/0                                    | -     | -     | -                           | -                        | 6             | -       | 6           | <a href="#">703.6</a>      | -  | WQBEL                        |
|                    | Due to the industry type, Antimony is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.                                                                         |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Copper             | µg/L                                                                                                                                                                                                                                                                                     | Daily Max                                                                                                                                   | -                       | 0.1                                    | 1/0                                    | -     | -     | -                           | -                        | 400           | -       | 400         | <a href="#">703.6</a>      | -  | WQBEL                        |
|                    | Copper was detected in the effluent as reported in the NY-2C application. Due to the industry type, Copper is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration. |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Iron               | µg/L                                                                                                                                                                                                                                                                                     | Daily Max                                                                                                                                   | -                       | 3.94                                   | 1/0                                    | -     | -     | -                           | -                        | 600           | -       | 600         | <a href="#">703.6</a>      | -  | WQBEL                        |
|                    | Iron was detected in the effluent as reported in the NY-2C application. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.                                                                  |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Zinc               | ug/L                                                                                                                                                                                                                                                                                     | Daily Max                                                                                                                                   | -                       | 730                                    | 1/0                                    | -     | -     | -                           | -                        | 5000          | -       | 5000        | <a href="#">703.6</a>      | -  | WQBEL                        |
|                    | Zinc was detected in the effluent as reported in the NY-2C application. Due to the industry type, Zinc is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.     |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Magnesium          | mg/L                                                                                                                                                                                                                                                                                     | Daily Max                                                                                                                                   | -                       | 5.8                                    | 1/0                                    | -     | -     | -                           | -                        | 35            | -       | 35          | <a href="#">TOGS 1.1.1</a> | -  | No Limitation                |
|                    | Magnesium was detected in the effluent as reported in the NY-2C application; however, the sample result indicates no reasonable potential exists to exceed the WQS for magnesium. Therefore, no limitation is proposed.                                                                  |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Acetone            | µg/L                                                                                                                                                                                                                                                                                     | Daily Max                                                                                                                                   | -                       | <10                                    | 0/1                                    | -     | -     | -                           | -                        | 50            | -       | 50          | <a href="#">TOGS 1.1.1</a> | -  | WQBEL                        |
|                    | Due to the industry type, Ethylbenzene is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.                                                                     |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Chloroform         | µg/L                                                                                                                                                                                                                                                                                     | Daily Max                                                                                                                                   | -                       | <5                                     | 0/1                                    | -     | -     | -                           | -                        | 7             | -       | 7           | <a href="#">703.6</a>      | -  | WQBEL                        |
|                    | Due to the industry type, Chloroform is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.                                                                       |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Ethylbenzene       | µg/L                                                                                                                                                                                                                                                                                     | Daily Max                                                                                                                                   | -                       | <5                                     | 0/1                                    | -     | -     | -                           | -                        | 5             | -       | 5           | <a href="#">TOGS 1.1.1</a> | -  | WQBEL                        |
|                    | Due to the industry type, Ethylbenzene is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.                                                                     |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |

| Outfall #          | 001                                                                                                                                                                                                                                                         | Description of Wastewater: Treated Car Wash Discharge                                                                                       |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
|--------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------|-------------------------|----------------------------------------|----------------------------------------|-------|-------|-----------------------------|--------------------------|---------------|---------|-------------|----------------------------|----|------------------------------|
|                    |                                                                                                                                                                                                                                                             | Type of Treatment: Primary Settling Trough, Cyclonic Suspended Solids Removal, Granular Activated Carbon Filtration, and Ozone Disinfection |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Effluent Parameter | Units                                                                                                                                                                                                                                                       | Averaging Period                                                                                                                            | Existing Discharge Data |                                        |                                        | TBELs |       | Water Quality Data & WQBELs |                          |               |         |             |                            | ML | Basis for Permit Requirement |
|                    |                                                                                                                                                                                                                                                             |                                                                                                                                             | Permit Limit            | Existing Effluent Quality <sup>2</sup> | # of Data Points Detects / Non-Detects | Limit | Basis | Ambient Bkgd. Conc.         | Projected Instream Conc. | WQ Std. or GV | WQ Type | Calc. WQBEL | Basis for WQBEL            |    |                              |
| Methylene Chloride | µg/L                                                                                                                                                                                                                                                        | Daily Max                                                                                                                                   | -                       | <5                                     | 0/1                                    | -     | -     | -                           | -                        | 5             | -       | 5           | <a href="#">703.6</a>      | -  | WQBEL                        |
|                    | Due to the industry type, Methylene Chloride is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.                                  |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Tetrachloroethene  | µg/L                                                                                                                                                                                                                                                        | Daily Max                                                                                                                                   | -                       | <5                                     | 0/1                                    | -     | -     | -                           | -                        | 5             | -       | 5           | <a href="#">TOGS 1.1.1</a> | -  | WQBEL                        |
|                    | Due to the industry type, Tetrachloroethene is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.                                   |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Trichloroethene    | µg/L                                                                                                                                                                                                                                                        | Daily Max                                                                                                                                   | -                       | <5                                     | 0/1                                    | -     | -     | -                           | -                        | 5             | -       | 5           | <a href="#">703.6</a>      | -  | WQBEL                        |
|                    | Due to the industry type, Trichloroethene is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.                                     |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Toluene            | µg/L                                                                                                                                                                                                                                                        | Daily Max                                                                                                                                   | -                       | <5                                     | 0/1                                    | -     | -     | -                           | -                        | 5             | -       | 5           | <a href="#">TOGS 1.1.1</a> | -  | WQBEL                        |
|                    | Due to the industry type, Toluene is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.                                             |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Xylene (m+p)       | µg/L                                                                                                                                                                                                                                                        | Daily Max                                                                                                                                   | -                       | <10                                    | 0/1                                    | -     | -     | -                           | -                        | 10            | -       | 10          | <a href="#">TOGS 1.1.1</a> | -  | WQBEL                        |
|                    | Due to the industry type, Xylene (m+p) is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.                                        |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Xylene (o)         | µg/L                                                                                                                                                                                                                                                        | Daily Max                                                                                                                                   | -                       | <5                                     | 0/1                                    | -     | -     | -                           | -                        | 5             | -       | 5           | <a href="#">TOGS 1.1.1</a> | -  | WQBEL                        |
|                    | Due to the industry type, Xylene (o) is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.                                          |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Diethyl Phthalate  | µg/L                                                                                                                                                                                                                                                        | Daily Max                                                                                                                                   | -                       | 94.6                                   | 1/0                                    | -     | -     | -                           | -                        | 50            | -       | 50          | <a href="#">TOGS 1.1.1</a> | -  | WQBEL                        |
|                    | Diethyl Phthalate was detected in the effluent as reported in the NY-2C application. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.                        |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |
| Sulfate            | mg/L                                                                                                                                                                                                                                                        | Daily Max                                                                                                                                   | -                       | 16                                     | 1/0                                    | -     | -     | -                           | -                        | 500           | -       | -           | <a href="#">703.6</a>      | -  | No Limitation                |
|                    | Sulfate was detected in the effluent as reported in the NY-2C application. However, the sample result indicates no reasonable potential exists to exceed the groundwater maximum allowable concentration for sulfate. Therefore, no limitation is proposed. |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |    |                              |

Permittee: AEJB Inc  
 Facility: Touch of Class Car Wash  
 SPDES Number: NY0313238  
 USEPA Non-Major/Class 01 Industrial

Date: July 14, 2025 v.1.32  
 Permit Writer: Yufei Wu  
 Water Quality Reviewer: -  
 Full Technical Review

| Outfall #                  | 001                                                                                                                                                                                                                                | Description of Wastewater: Treated Car Wash Discharge                                                                                       |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |     |                              |
|----------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------|-------------------------|----------------------------------------|----------------------------------------|-------|-------|-----------------------------|--------------------------|---------------|---------|-------------|----------------------------|-----|------------------------------|
|                            |                                                                                                                                                                                                                                    | Type of Treatment: Primary Settling Trough, Cyclonic Suspended Solids Removal, Granular Activated Carbon Filtration, and Ozone Disinfection |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |     |                              |
| Effluent Parameter         | Units                                                                                                                                                                                                                              | Averaging Period                                                                                                                            | Existing Discharge Data |                                        |                                        | TBELs |       | Water Quality Data & WQBELs |                          |               |         |             |                            | ML  | Basis for Permit Requirement |
|                            |                                                                                                                                                                                                                                    |                                                                                                                                             | Permit Limit            | Existing Effluent Quality <sup>2</sup> | # of Data Points Detects / Non-Detects | Limit | Basis | Ambient Bkgd. Conc.         | Projected Instream Conc. | WQ Std. or GV | WQ Type | Calc. WQBEL | Basis for WQBEL            |     |                              |
| Benzene                    | µg/L                                                                                                                                                                                                                               | Daily Max                                                                                                                                   | -                       | <5                                     | 0/1                                    | -     | -     | -                           | -                        | 1             | -       | 1           | <a href="#">703.6</a>      | -   | WQBEL                        |
|                            | Due to the industry type, Benzene is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.                    |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |     |                              |
| Naphthalene                | µg/L                                                                                                                                                                                                                               | Daily Max                                                                                                                                   | -                       | <5                                     | 0/1                                    | -     | -     | -                           | -                        | 10            | -       | 10          | <a href="#">TOGS 1.1.1</a> | -   | WQBEL                        |
|                            | Due to the industry type, Naphthalene is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.                |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |     |                              |
| Phenol, Total              | µg/L                                                                                                                                                                                                                               | Daily Max                                                                                                                                   | -                       | <5                                     | 0/1                                    | -     | -     | -                           | -                        | 2             | -       | 2           | <a href="#">703.6</a>      | 6.4 | ML                           |
|                            | Due to the industry type, Phenol, Total is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration.              |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |     |                              |
| Bis[2-ethylhexyl]phthalate | µg/L                                                                                                                                                                                                                               | Daily Max                                                                                                                                   | -                       | 7.52                                   | 1/0                                    | -     | -     | -                           | -                        | 5             | -       | 5           | <a href="#">703.6</a>      | 6.4 | ML                           |
|                            | Due to the industry type, Bis[2-ethylhexyl]phthalate is being added to the permit. With the absence of dilution due to discharge to groundwater, the calculated WQBEL is equal to the groundwater maximum allowable concentration. |                                                                                                                                             |                         |                                        |                                        |       |       |                             |                          |               |         |             |                            |     |                              |

Permittee: AEJB Inc  
 Facility: Touch of Class Car Wash  
 SPDES Number: NY0313238  
 USEPA Non-Major/Class 01 Industrial

Date: July 14, 2025 v.1.32  
 Permit Writer: Yufei Wu  
 Water Quality Reviewer: -  
 Full Technical Review

## Outfall 001 [EMERGING CONTAMINANTS]

| Emerging Contaminants Outfall 001                                                                                                                          |                                                                                                                                                                                                                                                                                                                                                                                                            |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |
|------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------|-------------------------|----------------------------------------|----------------------------------------|-------|-------|-----------------------------|--------------------------|---------------|---------|-------------|------------|----|------------------------------|
| Effluent Parameter                                                                                                                                         | Units                                                                                                                                                                                                                                                                                                                                                                                                      | Averaging Period | Existing Discharge Data |                                        |                                        | TBELs |       | Water Quality Data & WQBELs |                          |               |         |             |            | ML | Basis for Permit Requirement |
|                                                                                                                                                            |                                                                                                                                                                                                                                                                                                                                                                                                            |                  | Permit Limit            | Existing Effluent Quality <sup>3</sup> | # of Data Points Detects / Non-Detects | Limit | Basis | Ambient Bkgd. Conc.         | Projected Instream Conc. | WQ Std. or GV | WQ Type | Calc. WQBEL | Basis      |    |                              |
| <b>Notes:</b> See <a href="#">Emerging Contaminant Monitoring</a> section above. Effluent samples were analyzed for the 40 PFAS compounds and 1,4-Dioxane. |                                                                                                                                                                                                                                                                                                                                                                                                            |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |
| Perfluoro-butanoic Acid (PFBA)                                                                                                                             | ng/L                                                                                                                                                                                                                                                                                                                                                                                                       | Daily Max        | -                       | <100                                   | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -          | -  | <b>STM</b>                   |
|                                                                                                                                                            | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                  |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |
| Perfluoro-pentanoic Acid (PFPeA)                                                                                                                           | ng/L                                                                                                                                                                                                                                                                                                                                                                                                       | Daily Max        | -                       | <50                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -          | -  | <b>STM</b>                   |
|                                                                                                                                                            | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                  |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |
| Perfluoro-hexanoic Acid (PFHxA)                                                                                                                            | ng/L                                                                                                                                                                                                                                                                                                                                                                                                       | Daily Max        | -                       | <50                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -          | -  | <b>STM</b>                   |
|                                                                                                                                                            | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                  |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |
| Perfluoro-heptanoic Acid (PFHpA)                                                                                                                           | ng/L                                                                                                                                                                                                                                                                                                                                                                                                       | Daily Max        | -                       | <50                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -          | -  | <b>STM</b>                   |
|                                                                                                                                                            | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                  |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |
| Perfluoro-octanoic Acid (PFOA)                                                                                                                             | ng/L                                                                                                                                                                                                                                                                                                                                                                                                       | Daily Max        | -                       | <10                                    | 0/1                                    | -     | -     | -                           | -                        | 6.7           | H(WS)   | 6.7         | TOGS 1.1.1 | -  | <b>STM</b>                   |
|                                                                                                                                                            | Very limited data is available to confirm the presence or absence of this parameter and evaluate reasonable potential to cause or contribute to a WQS violation. Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS). |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |
| Perfluoro-nonanoic Acid (PFNA)                                                                                                                             | ng/L                                                                                                                                                                                                                                                                                                                                                                                                       | Daily Max        | -                       | <25                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -          | -  | <b>STM</b>                   |
|                                                                                                                                                            | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                  |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |
| Perfluoro-decanoic Acid (PFDA)                                                                                                                             | ng/L                                                                                                                                                                                                                                                                                                                                                                                                       | Daily Max        | -                       | <50                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -          | -  | <b>STM</b>                   |
|                                                                                                                                                            | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                  |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |
| Perfluoro-undecanoic Acid (PFUnA)                                                                                                                          | ng/L                                                                                                                                                                                                                                                                                                                                                                                                       | Daily Max        | -                       | <25                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -          | -  | <b>STM</b>                   |
|                                                                                                                                                            | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                  |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |

<sup>3</sup> Existing Effluent Quality: Unless otherwise stated, Daily Max = 99% lognormal; Monthly Avg = 95% lognormal (for datasets with ≤3 nondetects); Daily Max = 99% delta-lognormal; Monthly Avg = 95% delta-lognormal (for datasets with >3 nondetects)

| Emerging Contaminants Outfall 001      |                                                                                                                                                                                                                                                                                                                                                                                                            |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |
|----------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------|-------------------------|----------------------------------------|----------------------------------------|-------|-------|-----------------------------|--------------------------|---------------|---------|-------------|------------|----|------------------------------|
| Effluent Parameter                     | Units                                                                                                                                                                                                                                                                                                                                                                                                      | Averaging Period | Existing Discharge Data |                                        |                                        | TBELs |       | Water Quality Data & WQBELs |                          |               |         |             |            | ML | Basis for Permit Requirement |
|                                        |                                                                                                                                                                                                                                                                                                                                                                                                            |                  | Permit Limit            | Existing Effluent Quality <sup>3</sup> | # of Data Points Detects / Non-Detects | Limit | Basis | Ambient Bkgd. Conc.         | Projected Instream Conc. | WQ Std. or GV | WQ Type | Calc. WQBEL | Basis      |    |                              |
| Perfluoro-dodecanoic Acid (PFDaA)      | ng/L                                                                                                                                                                                                                                                                                                                                                                                                       | Daily Max        | -                       | <25                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -          | -  | STM                          |
|                                        | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                  |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |
| Perfluoro-tridecanoic Acid (PFTiA)     | ng/L                                                                                                                                                                                                                                                                                                                                                                                                       | Daily Max        | -                       | <50                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -          | -  | STM                          |
|                                        | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                  |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |
| Perfluoro-tetradecanoic Acid (PFTeA)   | ng/L                                                                                                                                                                                                                                                                                                                                                                                                       | Daily Max        | -                       | <50                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -          | -  | STM                          |
|                                        | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                  |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |
| Perfluoro-butanesulfonic Acid (PFBS)   | ng/L                                                                                                                                                                                                                                                                                                                                                                                                       | Daily Max        | -                       | <25                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -          | -  | STM                          |
|                                        | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                  |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |
| Perfluoro-pentanesulfonic Acid (PFPeS) | ng/L                                                                                                                                                                                                                                                                                                                                                                                                       | Daily Max        | -                       | <25                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -          | -  | STM                          |
|                                        | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                  |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |
| Perfluoro-hexanesulfonic Acid (PFHxS)  | ng/L                                                                                                                                                                                                                                                                                                                                                                                                       | Daily Max        | -                       | <50                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -          | -  | STM                          |
|                                        | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                  |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |
| Perfluoro-heptanesulfonic Acid (PFHpS) | ng/L                                                                                                                                                                                                                                                                                                                                                                                                       | Daily Max        | -                       | <25                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -          | -  | STM                          |
|                                        | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                  |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |
| Perfluoro-octanesulfonic Acid (PFOS)   | ng/L                                                                                                                                                                                                                                                                                                                                                                                                       | Daily Max        | -                       | <10                                    | 0/1                                    | -     | -     | -                           | -                        | 2.7           | H(WS)   | 2.7         | TOGS 1.1.1 | -  | STM                          |
|                                        | Very limited data is available to confirm the presence or absence of this parameter and evaluate reasonable potential to cause or contribute to a WQS violation. Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS). |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |
| Perfluoro-nonanesulfonic Acid (PFNS)   | ng/L                                                                                                                                                                                                                                                                                                                                                                                                       | Daily Max        | -                       | <50                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -          | -  | STM                          |
|                                        | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                  |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |
| Perfluoro-decanesulfonic Acid (PFDS)   | ng/L                                                                                                                                                                                                                                                                                                                                                                                                       | Daily Max        | -                       | <50                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -          | -  | STM                          |
|                                        | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                  |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |            |    |                              |

Permittee: AEJB Inc  
 Facility: Touch of Class Car Wash  
 SPDES Number: NY0313238  
 USEPA Non-Major/Class 01 Industrial

Date: July 14, 2025 v.1.32  
 Permit Writer: Yufei Wu  
 Water Quality Reviewer: -  
 Full Technical Review

| Emerging Contaminants Outfall 001                           |                                                                                                                                                                                                                                           |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
|-------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------|-------------------------|----------------------------------------|----------------------------------------|-------|-------|-----------------------------|--------------------------|---------------|---------|-------------|-------|----|------------------------------|
| Effluent Parameter                                          | Units                                                                                                                                                                                                                                     | Averaging Period | Existing Discharge Data |                                        |                                        | TBELs |       | Water Quality Data & WQBELs |                          |               |         |             |       | ML | Basis for Permit Requirement |
|                                                             |                                                                                                                                                                                                                                           |                  | Permit Limit            | Existing Effluent Quality <sup>3</sup> | # of Data Points Detects / Non-Detects | Limit | Basis | Ambient Bkgd. Conc.         | Projected Instream Conc. | WQ Std. or GV | WQ Type | Calc. WQBEL | Basis |    |                              |
| Perfluoro-dodecane-sulfonic Acid (PFDoS)                    | ng/L                                                                                                                                                                                                                                      | Daily Max        | -                       | <100                                   | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | <b>STM</b>                   |
|                                                             | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS). |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
| Perfluoro-octane-sulfonamide (FOSA)                         | ng/L                                                                                                                                                                                                                                      | Daily Max        | -                       | <25                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | <b>STM</b>                   |
|                                                             | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS). |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
| N-methyl Perfluoro-octanesulfon-amidoacetic Acid (NMeFOSAA) | ng/L                                                                                                                                                                                                                                      | Daily Max        | -                       | <100                                   | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | <b>STM</b>                   |
|                                                             | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS). |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
| N-ethyl Perfluoro-octanesulfon-amidoacetic Acid (NEtFOSAA)  | ng/L                                                                                                                                                                                                                                      | Daily Max        | -                       | <50                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | <b>STM</b>                   |
|                                                             | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS). |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
| 4:2 Fluorotelomer Sulfonic Acid (FTS)                       | ng/L                                                                                                                                                                                                                                      | Daily Max        | -                       | <100                                   | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | <b>STM</b>                   |
|                                                             | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS). |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
| 6:2 Fluorotelomer Sulfonic Acid (FTS)                       | ng/L                                                                                                                                                                                                                                      | Daily Max        | -                       | <100                                   | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | <b>STM</b>                   |
|                                                             | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS). |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
| 8:2 Fluorotelomer Sulfonic Acid (FTS)                       | ng/L                                                                                                                                                                                                                                      | Daily Max        | -                       | <250                                   | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | <b>STM</b>                   |
|                                                             | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS). |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
| N-ethyl Perfluoro-octanesulfon-amide (NEtFOSA)              | ng/L                                                                                                                                                                                                                                      | Daily Max        | -                       | <50                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | <b>STM</b>                   |
|                                                             | Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS). |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |

Permittee: AEJB Inc  
 Facility: Touch of Class Car Wash  
 SPDES Number: NY0313238  
 USEPA Non-Major/Class 01 Industrial

Date: July 14, 2025 v.1.32  
 Permit Writer: Yufei Wu  
 Water Quality Reviewer: -  
 Full Technical Review

| Emerging Contaminants Outfall 001                                                                                                                                                                                                         |       |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------|------------------|-------------------------|----------------------------------------|----------------------------------------|-------|-------|-----------------------------|--------------------------|---------------|---------|-------------|-------|----|------------------------------|
| Effluent Parameter                                                                                                                                                                                                                        | Units | Averaging Period | Existing Discharge Data |                                        |                                        | TBELs |       | Water Quality Data & WQBELs |                          |               |         |             |       | ML | Basis for Permit Requirement |
|                                                                                                                                                                                                                                           |       |                  | Permit Limit            | Existing Effluent Quality <sup>3</sup> | # of Data Points Detects / Non-Detects | Limit | Basis | Ambient Bkgd. Conc.         | Projected Instream Conc. | WQ Std. or GV | WQ Type | Calc. WQBEL | Basis |    |                              |
| N-methyl Perfluoro-octanesulfonamide (NMeFOSA)                                                                                                                                                                                            | ng/L  | Daily Max        | -                       | <100                                   | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | STM                          |
| Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS). |       |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
| N-methyl Perfluoro-octanesulfonamidoethanol (NMeFOSE)                                                                                                                                                                                     | ng/L  | Daily Max        | -                       | <500                                   | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | STM                          |
| Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS). |       |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
| N-ethyl Perfluoro-octanesulfonamidoethanol (NEtFOSE)                                                                                                                                                                                      | ng/L  | Daily Max        | -                       | <250                                   | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | STM                          |
| Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS). |       |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
| 9-Chlorohexadec a-fluoro-3-oxanonane-1-sulfonic Acid (9Cl-PF3ONS)                                                                                                                                                                         | ng/L  | Daily Max        | -                       | <50                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | STM                          |
| Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS). |       |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
| Hexafluoro-propylene Oxide Dimer Acid (HFPO-DA or GenX)                                                                                                                                                                                   | ng/L  | Daily Max        | -                       | <100                                   | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | STM                          |
| Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS). |       |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
| 11-Chloroeicosafu oro-3-oxaundecane-1-sulfonic Acid (11Cl-PF3OUDS)                                                                                                                                                                        | ng/L  | Daily Max        | -                       | <50                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | STM                          |
| Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS). |       |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
| 4,8-Dioxa-3H-perfluorononanoic Acid (ADONA)                                                                                                                                                                                               | ng/L  | Daily Max        | -                       | <50                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | STM                          |
| Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS). |       |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |

Permittee: AEJB Inc  
 Facility: Touch of Class Car Wash  
 SPDES Number: NY0313238  
 USEPA Non-Major/Class 01 Industrial

Date: July 14, 2025 v.1.32  
 Permit Writer: Yufei Wu  
 Water Quality Reviewer: -  
 Full Technical Review

| Emerging Contaminants Outfall 001                                                                                                                                                                                                                                                                                                                                                                                        |       |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------|------------------|-------------------------|----------------------------------------|----------------------------------------|-------|-------|-----------------------------|--------------------------|---------------|---------|-------------|-------|----|------------------------------|
| Effluent Parameter                                                                                                                                                                                                                                                                                                                                                                                                       | Units | Averaging Period | Existing Discharge Data |                                        |                                        | TBELs |       | Water Quality Data & WQBELs |                          |               |         |             |       | ML | Basis for Permit Requirement |
|                                                                                                                                                                                                                                                                                                                                                                                                                          |       |                  | Permit Limit            | Existing Effluent Quality <sup>3</sup> | # of Data Points Detects / Non-Detects | Limit | Basis | Ambient Bkgd. Conc.         | Projected Instream Conc. | WQ Std. or GV | WQ Type | Calc. WQBEL | Basis |    |                              |
| 3-Perfluoropropyl Propanoic Acid (3:3 FTCA)                                                                                                                                                                                                                                                                                                                                                                              | ng/L  | Daily Max        | -                       | 2022                                   | 1/0                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | <b>STM</b>                   |
| Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                                |       |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
| 2H,2H,3H,3H-Perfluoro-octanoic Acid (5:3 FTCA)                                                                                                                                                                                                                                                                                                                                                                           | ng/L  | Daily Max        | -                       | <500                                   | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | <b>STM</b>                   |
| Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                                |       |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
| 3-Perfluoroheptyl Propanoic Acid (7:3 FTCA)                                                                                                                                                                                                                                                                                                                                                                              | ng/L  | Daily Max        | -                       | <1000                                  | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | <b>STM</b>                   |
| Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                                |       |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
| Nonafluoro-3,6-dioxaheptanoic Acid (NFDHA)                                                                                                                                                                                                                                                                                                                                                                               | ng/L  | Daily Max        | -                       | <50                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | <b>STM</b>                   |
| Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                                |       |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
| Perfluoro-4-methoxy-butanoic Acid (PFMBA)                                                                                                                                                                                                                                                                                                                                                                                | ng/L  | Daily Max        | -                       | <50                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | <b>STM</b>                   |
| Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                                |       |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
| Perfluoro-3-methoxy-propanoic Acid (PFMPA)                                                                                                                                                                                                                                                                                                                                                                               | ng/L  | Daily Max        | -                       | <50                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | <b>STM</b>                   |
| Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                                |       |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
| Perfluoro(2-ethoxyethane)sulfonic Acid (PFEESA)                                                                                                                                                                                                                                                                                                                                                                          | ng/L  | Daily Max        | -                       | <25                                    | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | <b>STM</b>                   |
| Pursuant to 6 NYCRR 750-1.13(b), the permit includes a short-term monitoring program listed in the Schedule of Additional Submittals to evaluate the influent and effluent discharge levels of Per-and Polyfluoroalkyl Substances (PFAS).                                                                                                                                                                                |       |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |
| 1,4-Dioxane                                                                                                                                                                                                                                                                                                                                                                                                              | µg/L  | Daily Max        | -                       | 30                                     | 0/1                                    | -     | -     | -                           | -                        | -             | -       | -           | -     | -  | <b>STM</b>                   |
| 1,4-Dioxane was tested to a limit of quantitation (LOQ) of 30 µg/L as reported in the NY-2C application. This LOQ exceeds the human health guidance value of 0.35 µg/L, the lowest regulatory value available. Insufficient information is available to perform a reasonable potential analysis, and additional monitoring has been added to the permit in the form of Emerging Contaminant Short Term Monitoring (STM). |       |                  |                         |                                        |                                        |       |       |                             |                          |               |         |             |       |    |                              |

## Appendix: Regulatory and Technical Basis of Permit Authorizations

The Appendix is meant to supplement the fact sheet for multiple types of SPDES permits. Portions of this Appendix may not be applicable to this specific permit.

### Regulatory References

The provisions of the permit are based largely upon 40 CFR 122 subpart C and 6 NYCRR Part 750 and include monitoring, recording, reporting, and compliance requirements, as well as general conditions applicable to all SPDES permits. Below are the most common citations for the requirements included in SPDES permits:

- Clean Water Act (CWA) 33 section USC 1251 to 1387
- Environmental Conservation Law (ECL) Articles 17 and 70
- Federal Regulations
  - 40 CFR, Chapter I, subchapters D, N, and O
- State environmental regulations
  - 6 NYCRR Part 621
  - 6 NYCRR Part 750
  - 6 NYCRR Parts 700 - 704 – Best use and other requirements applicable to water classes
  - 6 NYCRR Parts 800 – 941 - Classification of individual surface waters
- NYSDEC water program policy, referred to as Technical and Operational Guidance Series (TOGS)
- USEPA Office of Water Technical Support Document for Water Quality-based Toxics Control, March 1991, Appendix E

The following is a quick guide to the references used within the fact sheet:

| SPDES Permit Requirements                                                          | Regulatory Reference                                                                        |
|------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------|
| Anti-backsliding                                                                   | 6 NYCRR 750-1.10(c)                                                                         |
| Best Management Practices (BMPS) for CSOs                                          | 6 NYCRR 750-2.8(a)(2)                                                                       |
| Environmental Benefits Permit Strategy (EBPS)                                      | 6 NYCRR 750-1.18, NYS ECL 17-0817(4), TOGS 1.2.2 (revised January 25,2012)                  |
| Exceptions for Type I SSO Outfalls (bypass)                                        | 6 NYCRR 750-2.8(b)(2), 40 CFR 122.41                                                        |
| Mercury Multiple Discharge Variance                                                | Division of Water Program Policy 1.3.10 (DOW 1.3.10)                                        |
| Mixing Zone and Critical Water Information                                         | TOGS 1.3.1 & Amendments                                                                     |
| PCB Minimization Program                                                           | 40 CFR Part 132 Appendix F Procedure 8, 6 NYCRR 750-1.13(a) and 750-1.14(f), and TOGS 1.2.1 |
| Pollutant Minimization Program (PMP)                                               | 6 NYCRR 750-1.13(a), 750-1.14(f), TOGS 1.2.1                                                |
| Schedules of Compliance                                                            | 6 NYCRR 750-1.14                                                                            |
| Sewage Pollution Right to Know (SPRTK)                                             | NYS ECL 17-0826-a, 6 NYCRR 750-2.7                                                          |
| State Administrative Procedure Act (SAPA)                                          | State Administrative Procedure Act Section 401(2), 6 NYCRR 621.11(l)                        |
| State Environmental Quality Review (SEQR)                                          | 6 NYCRR Part 617                                                                            |
| USEPA Effluent Limitation Guidelines (ELGs)                                        | 40 CFR Parts 405-471                                                                        |
| USEPA National CSO Policy                                                          | 33 USC Section 1342(q)                                                                      |
| Whole Effluent Toxicity (WET) Testing                                              | TOGS 1.3.2                                                                                  |
| General Provisions of a SPDES Permit Department Request for Additional Information | NYCRR 750-2.1(i)                                                                            |

### Outfall and Receiving Water Information

#### Interstate Water Pollution Control Agencies

Some POTWs may be subject to regulations of interstate basin/compact agencies including: Interstate Sanitation Commission (ISC), International Joint Commission (IJC), Delaware River Basin Commission (DRBC), Ohio River Valley Water Sanitation Commission (ORSANCO), and the Susquehanna River Basin Commission (SRBC). Generally, basin commission requirements focus principally on water quality and not treatment technology. However, interstate/compact agency regulations for the ISC, IJC, DRBC and NYC Watershed contain explicit effluent limits which must be addressed during permit drafting. 6 NYCRR 750-2.1(d) requires SPDES permits for discharges that originate within the jurisdiction of an interstate water pollution control agency, to include any applicable effluent standards or water quality standards (WQS) promulgated by that interstate agency.

## Existing Effluent Quality

The existing effluent quality is determined from a statistical evaluation of effluent data in accordance with TOGS 1.2.1 and the USEPA Office of Water, Technical Support Document for Water Quality-based Toxics Control, March 1991, Appendix E (TSD). The existing effluent quality is equal to the 95<sup>th</sup> (monthly average) and 99<sup>th</sup> (daily maximum) percentiles of the lognormal distribution of existing effluent data. When there are greater than three non-detects, a delta-lognormal distribution is assumed, and delta-lognormal calculations are used to determine the monthly average and daily maximum pollutant concentrations. Statistical calculations are not performed for parameters where there are less than ten data points. If additional data is needed, a monitoring requirement may be specified either through routine monitoring or a short-term high intensity monitoring program. The [Pollutant Summary Table](#) identifies the number of sample data points available.

## Permit Requirements

### Basis for Effluent Limitations

Sections 101, 301, 304, 308, 401, 402, and 405 of the CWA and Titles 5, 7, and 8 of Article 17 ECL, as well as their implementing federal and state regulations, and related guidance, provide the basis for the effluent limitations and other conditions in the permit.

When conducting a full technical review of an existing permit, the previous effluent limitations form the basis for the next permit. Existing effluent quality is evaluated against the existing effluent limitations to determine if these should be continued, revised, or deleted. Generally, existing limitations are continued unless there are changed conditions at the facility, the facility demonstrates an ability to meet more stringent limitations, or in response to updated regulatory requirements. Pollutant monitoring data is also reviewed to determine the presence of additional contaminants that should be included in the permit based on a reasonable potential analysis to cause or contribute to a water quality standards violation.

### Anti-backsliding

Anti-backsliding requirements are specified in the CWA sections 402(o) and 303(d)(4), ECL 17-0809, and regulations at 40 CFR 122.44(I) and 6 NYCRR 750-1.10(c) and (d). Generally, the relaxation of effluent limitations in permits is prohibited unless one of the specified exceptions applies, which will be cited on a case-by-case basis in this fact sheet. Consistent with current case law<sup>4</sup> and USEPA interpretation<sup>5</sup> anti-backsliding requirements do not apply should a revision to the final effluent limitation take effect before the scheduled date of compliance for that final effluent limitation.

### Antidegradation Policy

New York State implements the antidegradation portion of the CWA based upon two documents: (1) Organization and Delegation Memorandum #85-40, "Water Quality Antidegradation Policy" (September 9, 1985); and, (2) TOGS 1.3.9, "Implementation of the NYSDEC Antidegradation Policy – Great Lakes Basin (Supplement to Antidegradation Policy dated September 9, 1985) (undated)." The permit for the facility contains effluent limitations which ensure that the existing best usage of the receiving waters will be maintained. To further support the antidegradation policy, SPDES applications have been reviewed in accordance with the State Environmental Quality Review Act (SEQR) as prescribed by 6 NYCRR Part 617.

### Effluent Limitations

In developing a permit, the DEC determines the technology-based effluent limitations (TBELs) and then evaluates the water quality expected to result from technology controls to determine if any exceedances of water quality criteria in the receiving water might result. If there is a reasonable potential for exceedances of water quality criteria to occur, water quality-based effluent limitations (WQBELs) are developed. A WQBEL is designed to ensure that the water quality standards of receiving waters are met. In general, the CWA requires that the effluent limitations for a particular pollutant are the more stringent of either the TBEL or WQBEL.

---

<sup>4</sup> American Iron and Steel Institute v. Environmental Protection Agency, 115 F.3d 979, 993 n.6 (D.C. Cir. 1997)

<sup>5</sup> U.S. EPA, Water Quality Standards; Establishment of Numeric Criteria for Priority Toxic Pollutants for the State of California; 65 Fed. Reg. 31682, 31704 (May 18, 2000); Proposed Water Quality Guidance for the Great Lakes System, 58 Fed. Reg. 20802, 20837 & 20981 (April 16, 1993)

### *Technology-based Effluent Limitations (TBELs) for Industrial Facilities*

A TBEL requires a minimum level of treatment for industrial point sources based on currently available treatment technologies or Best Management Practices (BMPs). CWA sections 301(b) and 402, ECL sections 17-0509, 17-0809 and 17-0811, and 6 NYCRR 750-1.11 require technology-based controls on effluents. TBELs are set based upon an evaluation of New Source Performance Standards (NSPS), Best Available Technology Economically Achievable (BAT), Best Conventional Pollutant Control Technology (BCT), Best Practicable Technology Currently Available (BPT), and Best Professional Judgment (BPJ).

#### USEPA Effluent Limitation Guidelines (ELGs) Applicable to Facility

In many cases, BPT, BCT, BAT and NSPS limitations are based on effluent guidelines developed by USEPA for specific industries, as promulgated under 40 CFR Parts 405-471. Applicable guidelines, pollutants regulated by these guidelines, and the effluent limitation derivation for facilities subject to these guidelines is in the [USEPA Effluent Limitation Guideline Calculations Table](#).

#### Best Professional Judgement (BPJ)

For substances that are not explicitly limited by regulations, the permit writer is authorized to use BPJ in developing TBELs. Consistent with section 402(a)(1) of the CWA, and NYS ECL section 17-0811, the DEC is authorized to issue a permit containing “any further limitations necessary to ensure compliance with water quality standards adopted pursuant to state law”. BPJ limitations may be set on a case-by-case basis using any reasonable method that takes into consideration the criteria set forth in 40 CFR 125.3. Applicable state regulations include 6 NYCRR 750-1.11. The BPJ limitation considers the existing technology present at the facility, the statistically calculated existing effluent quality for that parameter, and any unique or site-specific factors relating to the facility. Technology limitations generally achievable for various treatment technologies are included in TOGS 1.2.1, Attachment C. These limitations may be used for the listed parameters when the technology employed at the facility is listed.

### *Whole Effluent Toxicity (WET) Testing:*

WET tests use small vertebrate and invertebrate species to measure the aggregate toxicity of an effluent. There are two different durations of toxicity tests: acute and chronic. Acute toxicity tests measure survival over a 96-hour test exposure period. Chronic toxicity tests measure reductions in survival, growth, and reproduction over a 7-day exposure. TOGS 1.3.1 includes guidance for determining when aquatic toxicity testing should be included in SPDES permits. The authority to require toxicity testing is in 6NYCRR 702.9. TOGS 1.3.2 describes the procedures which should be followed when determining whether to include toxicity testing in a SPDES permit and how to implement a toxicity testing program. Per TOGS 1.3.2, WET testing may be required when any one of the following seven criteria are applicable:

1. There is the presence of substances in the effluent for which ambient water quality criteria do not exist.
2. There are uncertainties in the development of TMDLs, WLAs, and WQBELs, caused by inadequate ambient and/or discharge data, high natural background concentrations of pollutants, available treatment technology, and other such factors.
3. There is the presence of substances for which WQBELs are below analytical detectability.
4. There is the possibility of complex synergistic or additive effects of chemicals, typically when the number of metals or organic compounds discharged by the permittee equals or exceeds five.
5. There are observed detrimental effects on the receiving water biota.
6. Previous WET testing indicated a problem.
7. POTWs which exceed a discharge of 1 MGD. Facilities of less than 1 MGD may be required to test, e.g., POTWs <1 MGD which are managing industrial pretreatment programs.

### *Minimum Level of Detection*

Pursuant to 40 CFR 122.44(i)(1)(iv) and 6 NYCRR 750-2.5(d), SPDES permits must contain monitoring requirements using sufficiently sensitive test procedures approved under 40 CFR Part 136. A method is “sufficiently sensitive” when the method’s minimum level (ML) is at or below the level of the effluent limitation

established in the permit for the measured pollutant parameter; or the lowest ML of the analytical methods approved under 40 CFR Part 136. The ML represents the lowest level that can be measured within specified limitations of precision and accuracy during routine laboratory operations on most effluent matrices. When establishing effluent limitations for a specific parameter (based on technology or water quality requirements), it is possible that the calculated limitation will fall below the ML established by the approved analytical method(s). In these instances, the calculated limitation is included in the permit with a compliance level set equal to the ML of the most sensitive method.

### Monitoring Requirements

CWA section 308, 40 CFR 122.44(i), 6 NYCRR 750-1.13, and 750-2.5 require that monitoring be included in permits to determine compliance with effluent limitations. Additional effluent monitoring may also be required to gather data to determine if effluent limitations may be required. The permittee is responsible for conducting the monitoring and reporting results on Discharge Monitoring Reports (DMRs). The permit contains the monitoring requirements for the facility. Monitoring frequency is based on the minimum sampling necessary to adequately monitor the facility's performance and characterize the nature of the discharge of the monitored flow or pollutant. Variable effluent flows and pollutant levels may be required to be monitored at more frequent intervals than relatively constant effluent flow and pollutant levels (6 NYCRR 750-1.13). For industrial facilities, sampling frequency is based on guidance provided in TOGS 1.2.1. For municipal facilities, sampling frequency is based on guidance provided in TOGS 1.3.3.

### Other Conditions

#### Mercury

The multiple discharge variance (MDV) for mercury was developed in accordance with 6 NYCRR 702.17(h) "to address widespread standard or guidance value attainment issues including the presence of a ubiquitous pollutant or naturally high levels of a pollutant in a watershed." The first MDV was issued in October 2010, and subsequently revised and reissued in 2015; each subsequent iteration of the MDV is designed to build off the previous version, to make reasonable progress towards the water quality standard (WQS) of 0.7 ng/L dissolved mercury. The MDV is necessary because human-caused conditions or sources of mercury prevent attainment of the WQS and cannot be remedied (i.e., mercury is ubiquitous in New York waters at levels above the WQS and compliance with a water quality based effluent limitation (WQBEL) for mercury cannot be achieved with demonstrated effluent treatment technologies). The DEC has determined that the MDV is consistent with the protection of public health, safety, and welfare. During the effective period of this MDV, any increased risks to human health are mitigated by fish consumption advisories issued periodically by the NYSDOH.

All surface water SPDES permittees are eligible for authorization by the MDV provided they meet the requirements specified in DOW 1.3.10.

### Schedules of Compliance

Schedules of compliance are included in accordance with 40 CFR Part 132 Attachment F, Procedure 9, 40 CFR 122.47 and 6 NYCRR 750-1.14. Schedules of compliance are intended to, in the shortest reasonable time, achieve compliance with applicable effluent standards and limitations, water quality standards, and other applicable requirements. Where the time for compliance is more than nine months, the schedule of compliance must include interim requirements and dates for their achievement. If the time necessary to complete the interim milestones is more than nine months, and not readily divisible into stages for completion, progress reports must be required.

### Emerging Contaminants

Emerging Contaminants, such as Perfluorooctanoic acid (PFOA), Perfluorooctanesulfonic acid (PFOS), and 1,4-Dioxane (1,4-D), have been used in a wide variety of consumer and industrial products as well as in manufacturing processes for decades. Based on available research, water quality assessments for 1,4-D will follow existing WQBEL development. PFOA and PFOS do not break down easily; therefore, their presence in wastewater can remain a concern for years following their discontinued use. As the science surrounding these contaminants is still evolving, additional monitoring is needed to better understand potential sources and

Permittee: AEJB Inc  
Facility: Touch of Class Car Wash  
SPDES Number: NY0313238  
USEPA Non-Major/Class 01 Industrial

Date: July 14, 2025 v.1.32  
Permit Writer: Yufei Wu  
Water Quality Reviewer: -

Full Technical Review

background levels. For more information on emerging contaminants, please see the DEC Division of Water web page: [Emerging Contaminants In NY's Waters - NYSDEC](#).

#### **Schedule(s) of Additional Submittals**

Schedules of Additional Submittals are used to summarize the deliverables required by the permit not identified in a separate Schedule of Compliance.

#### **Best Management Practices (BMP) for Industrial Facilities**

BMP plans are authorized for inclusion in NPDES permits pursuant to Sections 304(e) and 402 (a)(1) of the Clean Water Act, and 6 NYCRR 750-1.14(f). The regulations pertaining to BMPs are promulgated under 40 CFR Part 125, Subpart K. These regulations specifically address surface water discharges.