



Department of
Environmental
Conservation

State Pollutant Discharge Elimination System (SPDES) DISCHARGE PERMIT

SIC Code:	4952	NAICS Code:	221320	SPDES Number:	NY0257532
Discharge Class (CL):	07	DEC Number:	6-4044-00007/00001		
Toxic Class (TX):	N	Effective Date (EDP):	06/01/2020		
Major-Sub Drainage Basin:	09 - 04	Expiration Date (ExDP):	05/31/2025		
Water Index Number:	SL-2-25-2	Item No.:	910 - 977	Modification Dates (EDPM):	XXXXXX
Compact Area:	IJC				

This SPDES permit is issued in compliance with Title 8 of Article 17 of the Environmental Conservation Law of New York State and in compliance with the Clean Water Act, as amended, (33 U.S.C. 1251 et.seq.)

PERMITTEE NAME AND ADDRESS						
Name:	Town of Hermon			Attention:	Town Supervisor	
Street:	109 Church Street					
City:	Hermon			State:	NY	Zip Code: 13652
Email:	supervisor@hermonny.org			Phone:	(315) 347-3606	

is authorized to discharge from the facility described below:

FACILITY NAME, ADDRESS, AND PRIMARY OUTFALL							
Name:	Town of Hermon Wastewater Treatment Plant (WWTP)						
Address / Location:	102 Water Street				County:	St. Lawrence	
City:	Hermon			State:	NY	Zip Code:	13652
Facility Location:	Latitude:	44 °	28 '	12 " N	& Longitude:	75 °	14 ' 7 " W
Primary Outfall No.:	001	Latitude:	44 °	28 '	15 " N	& Longitude:	75 ° 14 ' 6 " W
Outfall Description:	Treated Sanitary		Receiving Water:	Elm Creek		Class:	C

in accordance with: effluent limitations; monitoring and reporting requirements; other provisions and conditions set forth in this permit; and 6 NYCRR Part 750-1 and 750-2.

This permit and the authorization to discharge shall expire on midnight of the expiration date shown above and the permittee shall not discharge after the expiration date unless this permit has been renewed or extended pursuant to law. To be authorized to discharge beyond the expiration date, the permittee shall apply for permit renewal not less than 180 days prior to the expiration date shown above.

DISTRIBUTION:

CO BWP - Permit Coordinator
CO BWC - SCIS
RWE
EPA Region II
NYSEFC
NYSDOH - Canton

Permit Administrator:			
Address:	317 Washington Street, Watertown, NY 13601		
Signature:		Date:	/ /

DEFINITIONS

TERM	DEFINITION
7-Day Geo Mean	The highest allowable geometric mean of daily discharges over a calendar week.
7-Day Average	The average of all daily discharges for each 7-days in the monitoring period. The sample measurement is the highest of the 7-day averages calculated for the monitoring period.
12-Month Rolling Average (12 MRA)	The current monthly value of a parameter, plus the sum of the monthly values over the previous 11 months for that parameter, divided by the number of months for which samples were collected in the 12-month period.
30-Day Geometric Mean	The highest allowable geometric mean of daily discharges over a calendar month, calculated as the antilog of: the sum of the log of each of the daily discharges measured during a calendar month divided by the number of daily discharges measured during that month.
Action Level	Action level means a monitoring requirement characterized by a numerical value that, when exceeded, triggers additional permittee actions and department review to determine if numerical effluent limitations should be imposed.
Compliance Level / Minimum Level	A compliance level is an effluent limitation. A compliance level is given when the water quality evaluation specifies a Water Quality Based Effluent Limit (WQBEL) below the Minimum Level. The compliance level shall be set at the Minimum Level (ML) for the most sensitive analytical method as given in 40 CFR Part 136, or otherwise accepted by the Department.
Daily Discharge	The discharge of a pollutant measured during a calendar day or any 24-hour period that reasonably represents the calendar day for the purposes of sampling. For pollutants expressed in units of mass, the 'daily discharge' is calculated as the total mass of the pollutant discharged over the day. For pollutants with limitations expressed in other units of measurement, the 'daily discharge' is calculated as the average measurement of the pollutant over the day.
Daily Maximum	The highest allowable Daily Discharge.
Daily Minimum	The lowest allowable Daily Discharge.
Effective Date of Permit (EDP or EDPM)	The date this permit is in effect.
Effluent Limitations	Effluent limitation means any restriction on quantities, quality, rates and concentrations of chemical, physical, biological, and other constituents of effluents that are discharged into waters of the state.
Expiration Date of Permit (ExDP)	The date this permit is no longer in effect.
Instantaneous Maximum	The maximum level that may not be exceeded at any instant in time.
Instantaneous Minimum	The minimum level that must be maintained at all instants in time.
Monthly Average	The highest allowable average of daily discharges over a calendar month, calculated as the sum of each of the daily discharges measured during a calendar month divided by the number of daily discharges measured during that month.
Outfall	The terminus of a sewer system, or the point of emergence of any waterborne sewage, industrial waste or other wastes or the effluent therefrom, into the waters of the State.
Range	The minimum and maximum instantaneous measurements for the reporting period must remain between the two values shown.
Receiving Water	The classified waters of the state to which the listed outfall discharges.
Sample Frequency / Sample Type / Units	See NYSDEC's "DMR Manual for Completing the Discharge Monitoring Report for the SPDES" for information on sample frequency, type and units.

PERMIT LIMITS, LEVELS AND MONITORING

OUTFALL	LIMITATIONS APPLY	RECEIVING WATER	EFFECTIVE	EXPIRING
001	All Year unless otherwise noted	Elm Creek	XXXXXX	05/31/2025

PARAMETER	EFFLUENT LIMITATION					MONITORING REQUIREMENTS				FN
	Type	Limit	Units	Limit	Units	Sample Frequency	Sample Type	Location		
								Inf.	Eff.	
Flow	Monthly Average	0.078	MGD			Continuous	Recorder	X		1
pH	Daily Minimum	6.5	SU			Daily	Grab	X	X	
	Daily Maximum	8.5	SU					X	X	
Temperature	Daily Maximum	Monitor	°F			Daily	Grab	X	X	
BOD ₅	Monthly Average	30	mg/L	19.5	lbs/d	Quarterly	Grab	X	X	2,5
BOD ₅	7-Day Average	45	mg/L	29.3	lbs/d	Quarterly	Grab	X	X	5
Total Suspended Solids (TSS)	Monthly Average	30	mg/L	19.5	lbs/d	Quarterly	Grab	X	X	2,5
Total Suspended Solids (TSS)	7-Day Average	45	mg/L	29.3	lbs/d	Quarterly	Grab	X	X	5
Settleable Solids	Daily Maximum	0.3	mL/L			Daily	Grab	X	X	
EFFLUENT DISINFECTION		Limit	Units	Limit	Units	Sample Frequency	Sample Type	Inf.	Eff.	FN
Required Seasonal from May 1st - October 31st										
Coliform, Fecal	30-Day Geometric Mean	200	No./100 mL			1/Month	Grab		X	3
Coliform, Fecal	7-Day Geometric Mean	400	No./100 mL			1/Month	Grab		X	3
Chlorine, Total Residual	Daily Maximum	0.13	mg/L			Daily	Grab		X	3,4

FOOTNOTES:

1. This is a final effluent limitation which will be effective when the enforcement interim limit expires. The enforcement interim limit and expiration date are provided in the Amended Consent Order R6-20200402-15A.
2. Effluent shall not exceed 15% and 15% of influent concentration values for BOD₅ & TSS, respectively, and this percent removal is a final effluent limitation. The final effluent limitation will be effective when the enforcement interim limit expires. The enforcement interim limit and expiration date are provided in the Amended Consent Order R6-20200402-15A.
3. This is a final effluent limitation. See Schedule of Compliance for required disinfection compliance actions.
4. Sampling and reporting for total residual chlorine is only necessary if chlorine is used for disinfection, elsewhere in the treatment process, or the facility otherwise has reasonable potential to discharge chlorine. Otherwise, the permittee shall report NODI-9 on the DMR.
5. Quarterly samples shall be collected in calendar quarters (Q1 – January 1st to March 31st; Q2 – April 1st to June 30th; Q3 – July 1st to September 30th; Q4 – October 1st to December 31st).

MERCURY MINIMIZATION PROGRAM (MMP) - Type IV

On 2/8/2022, the permittee submitted a Conditional Exclusion Certification, certifying that the facility does not have any of the mercury sources listed in Part III.A.3. of DOW 1.3.10.

1. General - The permittee must develop, implement, and maintain a mercury minimization program (MMP), containing the elements set forth below.
2. MMP Elements - The MMP must be a written document and must include any necessary drawings or maps of the facility and/or collection system. Other related documents already prepared for the facility may be used as part of the MMP and may be incorporated by reference. At a minimum, the MMP must include the following elements¹ as described in detail below:
 - a. Conditional Exclusion Certification - A certification (Appendix D of *DOW 1.3.10*), signed in accordance with 750-1.8 Signature of SPDES forms, must be submitted once every five (5) years to the Regional Water Engineer and to the Bureau of Water Permits certifying that the facility is neither a mercury source nor receives flows from a mercury source. Criteria to determine if a facility has a mercury source are as follows:
 - The facility is or receives discharge from 1) individually permitted combined sewer overflow (CSOs)² communities and/or 2) Type II sanitary sewer overflow (SSO)³ facilities;
 - One or more effluent samples which exceed 12 ng/L, including samples taken as a result of the SPDES application process;
 - Internal or tributary waste stream samples exceed the GLCA effluent limitation **AND** the final effluent samples are less than the GLCA due primarily to dilution by uncontaminated or less contaminated waste streams. Both components of this criterion may include samples taken as a result of the SPDES application process;
 - A permit application or other information indicates that mercury is handled on site and could be discharged through outfalls;
 - Outfalls which contain legacy mercury contamination;
 - The facility's collection system receives discharges from a dental and/or categorical industrial user (CIU)⁴ that may discharge mercury;
 - The facility accepts hauled wastes; or,
 - The facility is defined as a categorical industry that may discharge mercury. This may also include dentists, universities, hospitals, or laboratories which have their own SPDES permit.
 - b. Control Strategy - The control strategy must contain the following minimum elements:
 - i. Equipment and Materials – Equipment and materials (e.g., thermometers, thermostats) used by the permittee, which may contain mercury, must be evaluated by the permittee. As equipment and materials containing mercury are updated/replaced, the permittee must use mercury-free alternatives, if possible.
 - ii. Bulk Chemical Evaluation – For chemicals, used at a rate which exceeds 1,000 gallons/year or 10,000 pounds/year, the permittee must obtain a manufacturer's certificate of analysis, a chemical analysis performed by a certified laboratory, and/or a notarized affidavit which describes the substances' mercury concentration and the detection limit achieved. If possible, the permittee must only use bulk chemicals utilized in the wastewater treatment process which contain <10 ppb mercury.

¹Neither monitoring nor outreach is required for facilities meeting the criteria for MMP Type IV, but monitoring and/or outreach can be included in the permittee's control strategy.

² CSO permits are included under the 05 and 07 permit classifications.

³ These are overflow retention facilities (ORFs) and are included under the 05 and 07 permit classifications.

⁴ CIUs include those listed under Federal Regulation in 40 CFR Part 400.

MERCURY MINIMIZATION PROGRAM (MMP) – Type IV (Continued)

- c. **Status Report** - An **annual** status report must be developed and maintained on site, in accordance with the [Schedule of Additional Submittals](#), summarizing:
- i. Review of criteria to determine if the facility has a potential mercury source;
 - a. If the permittee no longer meets the criteria for MMP Type IV, the permittee must notify the Department for a permittee-initiated permit modification;
 - ii. All actions undertaken, pursuant to the control strategy, during the previous year; and
 - iii. Actions planned, pursuant to the control strategy, for the upcoming year.

The permittee must maintain a file with all MMP documentation. The file must be available for review by Department representatives and copies must be provided upon request in accordance with 6 NYCRR 750-2.1(i) and 750-2.5(c)(4).

3. **MMP Modification** - The MMP must be modified whenever:
- a. Changes at the facility, or within the collection system, increase the potential for mercury discharges;
 - b. A letter from the Department identifies inadequacies in the MMP.

The Department may use information in the annual status reports, in accordance with 2.c of this MMP, to determine if the permit limitations and MMP Type is appropriate for the facility.

DEFINITIONS:

Potential mercury source – a source identified by the permittee that may reasonably be expected to have total mercury contained in the discharge. Some potential mercury sources include switches, fluorescent lightbulbs, cleaners, degreasers, thermometers, batteries, hauled wastes, universities, hospitals, laboratories, landfills, Brownfield sites, or raw material storage.

DISCHARGE NOTIFICATION REQUIREMENTS

- (a) The permittee shall install and maintain identification signs at all outfalls to surface waters listed in this permit, unless the Permittee has obtained a waiver in accordance with the Discharge Notification Act (DNA). Such signs shall be installed before initiation of any new discharge location.
- (b) Subsequent modifications to or renewal of this permit does not reset or revise the deadline set forth in (a) above, unless a new deadline is set explicitly by such permit modification or renewal.
- (c) The Discharge Notification Requirements described herein do not apply to outfalls from which the discharge is composed exclusively of storm water, or discharges to ground water.
- (d) The sign(s) shall be conspicuous, legible and in as close proximity to the point of discharge as is reasonably possible while ensuring the maximum visibility from the surface water and shore. The signs shall be installed in such a manner to pose minimal hazard to navigation, bathing or other water related activities. If the public has access to the water from the land in the vicinity of the outfall, an identical sign shall be posted to be visible from the direction approaching the surface water.

The signs shall have **minimum** dimensions of eighteen inches by twenty-four inches (18" x 24") and shall have white letters on a green background and contain the following information:

<p>N.Y.S. PERMITTED DISCHARGE POINT</p> <p>SPDES PERMIT No.: NY_____</p> <p>OUTFALL No. : _____</p> <p>For information about this permitted discharge contact:</p> <p>Permittee Name: _____</p> <p>Permittee Contact: _____</p> <p>Permittee Phone: () - ### - ####</p> <p>OR:</p> <p>NYSDEC Division of Water Regional Office Address:</p> <p>NYSDEC Division of Water Regional Phone: () - ### - ####</p>
--

- (e) Upon request, the permittee shall make available electronic or hard copies of the sampling data to the public. In accordance with the RECORDING, REPORTING AND ADDITIONAL MONITORING REQUIREMENTS page of your permit, each DMR shall be maintained (either electronically or as a hard copy) on record for a period of five years.
- (f) The permittee shall periodically inspect the outfall identification sign(s) in order to ensure they are maintained, are still visible, and contain information that is current and factually correct. Signs that are damaged or incorrect shall be replaced within 3 months of inspection.

SCHEDULE OF COMPLIANCE

a) The permittee shall comply with the following schedule:

Outfall(s)	Compliance Action	Due Date
001	The permittee shall submit an approvable engineering report, prepared by a Professional Engineer licensed to practice engineering in New York State, detailing the designs that will be used to comply with the final effluent limitations for Fecal Coliform and Total Residual Chlorine (TRC).	Completed
	The permittee shall submit approvable Engineering Plans, Specifications, and Construction Schedule for the implementation of disinfection requirements.	Submitted
	The permittee shall begin construction of the treatment facilities in accordance with the Department approved schedule.	In Accordance with Amended Consent Order #R6-20200402-15A
	The permittee shall complete construction and commence operation of the system and comply with the final effluent limitations for Fecal Coliform and Total Residual Chlorine.	In Accordance with Amended Consent Order #R6-20200402-15A
Unless noted otherwise, the above actions are one-time requirements.		

OUTFALL	PARAMETER	INTERIM EFFLUENT LIMIT					MONITORING REQUIREMENTS				Notes
		Type	Limit	Units	Limit	Units	Sample Frequency	Sample Type	Location		
									Inf.	Eff.	
001	Flow	Monthly Average	Monitor	MGD			Continuous	Recorder	X		1
	BOD ₅ % Removal	Monthly Average	Monitor	%			Quarterly	Calculation	X	X	1
	TSS % Removal	Monthly Average	Monitor	%			Quarterly	Calculation	X	X	1
Notes:	1. Interim limits and expiration date are provided in the Amended Consent Order #R6-20200402-15A.										


- b) The permittee shall submit a written notice of compliance or non-compliance with each of the above schedule dates no later than 14 days following each elapsed date, unless conditions require more immediate notice as prescribed in 6 NYCRR Part 750-1.2(a) and 750-2. All such compliance or non-compliance notification shall be sent to the locations listed under the section of this permit entitled RECORDING, REPORTING AND ADDITIONAL MONITORING REQUIREMENTS. Each notice of non-compliance shall include the following information:
1. A short description of the non-compliance;
 2. A description of any actions taken or proposed by the permittee to comply with the elapsed schedule requirements without further delay and to limit environmental impact associated with the non-compliance;
 3. Any details which tend to explain or mitigate an instance of non-compliance; and
 4. An estimate of the date the permittee will comply with the elapsed schedule requirement and an assessment of the probability that the permittee will meet the next scheduled requirement on time.
- c) The permittee shall submit copies of any document required by the above schedule of compliance to the NYSDEC Regional Water Engineer and to the Bureau of Water Permits.

MONITORING LOCATIONS

The permittee shall take samples and measurements, to comply with the monitoring requirements specified in this permit, at the location(s) specified below:

Influent: At flow splitter manhole

Effluent: After UV disinfection system

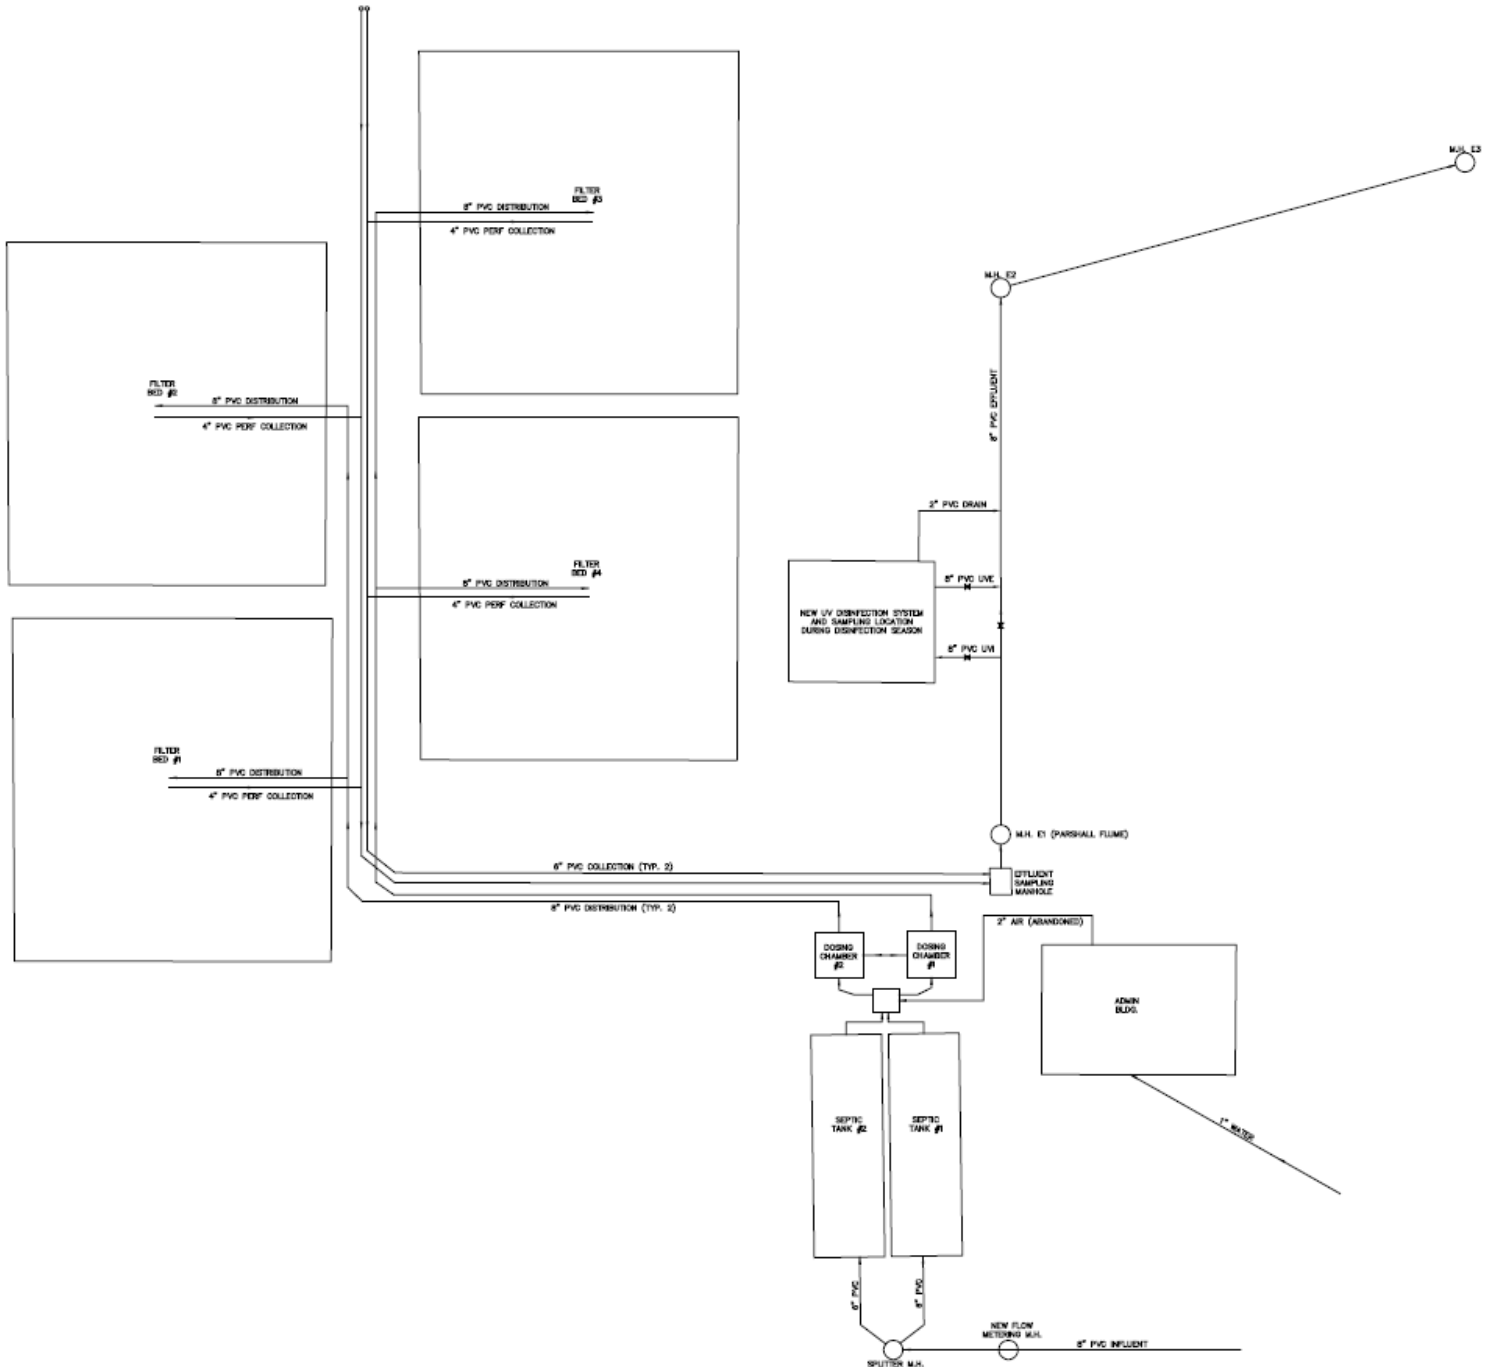



GENERAL REQUIREMENTS

- A. The regulations in 6 NYCRR Part 750 are hereby incorporated by reference and the conditions are enforceable requirements under this permit. The permittee shall comply with all requirements set forth in this permit and with all the applicable requirements of 6 NYCRR Part 750 incorporated into this permit by reference, including but not limited to the regulations in paragraphs B through I as follows:
- B. General Conditions
- | | |
|--|---|
| 1. Duty to comply | 6 NYCRR 750-2.1(e) & 2.4 |
| 2. Duty to reapply | 6 NYCRR 750-1.16(a) |
| 3. Need to halt or reduce activity not a defense | 6 NYCRR 750-2.1(g) |
| 4. Duty to mitigate | 6 NYCRR 750-2.7(f) |
| 5. Permit actions | 6 NYCRR 750-1.1(c), 1.18, 1.20 & 2.1(h) |
| 6. Property rights | 6 NYCRR 750-2.2(b) |
| 7. Duty to provide information | 6 NYCRR 750-2.1(i) |
| 8. Inspection and entry | 6 NYCRR 750-2.1(a) & 2.3 |
- C. Operation and Maintenance
- | | |
|-----------------------------------|--------------------------------------|
| 1. Proper Operation & Maintenance | 6 NYCRR 750-2.8 |
| 2. Bypass | 6 NYCRR 750-1.2(a)(17), 2.8(b) & 2.7 |
| 3. Upset | 6 NYCRR 750-1.2(a)(94) & 2.8(c) |
- D. Monitoring and Records
- | | |
|---------------------------|--|
| 1. Monitoring and records | 6 NYCRR 750-2.5(a)(2), 2.5(a)(6), 2.5(c)(1), 2.5(c)(2), & 2.5(d) |
| 2. Signatory requirements | 6 NYCRR 750-1.8 & 2.5(b) |
- E. Reporting Requirements
- | | |
|---|-----------------------------|
| 1. Reporting requirements | 6 NYCRR 750-2.5, 2.7 & 1.17 |
| 2. Anticipated noncompliance | 6 NYCRR 750-2.7(a) |
| 3. Transfers | 6 NYCRR 750-1.17 |
| 4. Monitoring reports | 6 NYCRR 750-2.5(e) |
| 5. Compliance schedules | 6 NYCRR 750-1.14(d) |
| 6. 24-hour reporting | 6 NYCRR 750-2.7(c) & (d) |
| 7. Other noncompliance | 6 NYCRR 750-2.7(e) |
| 8. Other information | 6 NYCRR 750-2.1(f) |
| 9. Additional conditions applicable to a POTW | 6 NYCRR 750-2.9 |
- F. Planned Changes
1. The permittee shall give notice to the Department as soon as possible of planned physical alterations or additions to the permitted facility when:
 - a. The alteration or addition to the permitted facility may meet any of the criteria for determining whether facility is a new source in 40 CFR §122.29(b); or
 - b. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants which are subject either to effluent limitations in the permit, or to notification requirements under 40 CFR §122.42(a)(1); or
 - c. The alteration or addition results in a significant change in the permittee's sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use or disposal sites not reported during the permit application process or not reported pursuant to an approved land application plan.

In addition to the Department, the permittee shall submit a copy of this notice to the United States Environmental Protection Agency at the following address: U.S. EPA Region 2, Clean Water Regulatory Branch, 290 Broadway, 24th Floor, New York, NY 10007-1866.

GENERAL REQUIREMENTS (continued)

2. Notification Requirement for POTWs

All POTWs shall provide adequate notice to the Department and the USEPA of the following:

- a. Any new introduction of pollutants into the POTW from an indirect discharger which would be subject to section 301 or 306 of CWA if it were directly discharging those pollutants; or
- b. Any substantial change in the volume or character of pollutants being introduced into that POTW by a source introducing pollutants into the POTW at the time of issuance of the permit.
- c. For the purposes of this paragraph, adequate notice shall include information on:
 - i. the quality and quantity of effluent introduced into the POTW, and
 - ii. any anticipated impact of the change on the quantity or quality of effluent to be discharged from the POTW.

POTWs shall submit a copy of this notice to the United States Environmental Protection Agency, at the following address:

U.S. EPA Region 2, Clean Water Regulatory Branch, 290 Broadway, 24th Floor, New York, NY 10007-1866

G. Sludge Management

The permittee shall comply with all applicable requirements of 6 NYCRR Part 360.

H. SPDES Permit Program Fee

The permittee shall pay to the Department an annual SPDES permit program fee within 30 days of the date of the first invoice, unless otherwise directed by the Department, and shall comply with all applicable requirements of ECL 72-0602 and 6 NYCRR Parts 480, 481 and 485. Note that if there is inconsistency between the fees specified in ECL 72-0602 and 6 NYCRR Part 485, the ECL 72-0602 fees govern.

I. Water Treatment Chemicals (WTCs)

New or increased use and discharge of a WTC requires prior Department review and authorization. At a minimum, the permittee must notify the Department in writing of its intent to change WTC use by submitting a completed *WTC Notification Form* for each proposed WTC. The Department will review that submittal and determine if a SPDES permit modification is necessary or whether WTC review and authorization may proceed outside of the formal permit administrative process. The majority of WTC authorizations do not require SPDES permit modification. In any event, use and discharge of a WTC shall not proceed without prior authorization from the Department. Examples of WTCs include biocides, coagulants, conditioners, corrosion inhibitors, defoamers, deposit control agents, flocculants, scale inhibitors, sequestrants, and settling aids.

1. WTC use shall not exceed the rate explicitly authorized by this permit or otherwise authorized in writing by the Department.
2. The permittee shall maintain a logbook of all WTC use, noting for each WTC the date, time, exact location, and amount of each dosage, and, the name of the individual applying or measuring the chemical. The logbook must also document that adequate process controls are in place to ensure that excessive levels of WTCs are not used.
3. The permittee shall submit a completed WTC Annual Report Form each year that they use and discharge WTCs. This form shall be submitted in electronic format and attached to either the December DMR or the annual monitoring report required below. The *WTC Notification Form and WTC Annual Report Form* are available from the Department's website at: <http://www.dec.ny.gov/permits/93245.html>

RECORDING, REPORTING AND ADDITIONAL MONITORING REQUIREMENTS

- A. The monitoring information required by this permit shall be retained for a period of at least five years from the date of the sampling for subsequent inspection by the Department or its designated agent.
- B. Discharge Monitoring Reports (DMRs): Completed DMR forms shall be submitted for each 1 month reporting period in accordance with the DMR Manual available on Department's website.

DMRs must be submitted electronically using the electronic reporting tool (NetDMR) specified by NYSDEC. Instructions on the use of NetDMR can be found at <https://www.dec.ny.gov/chemical/8461.html>. **Hardcopy paper DMRs will only be received at the address listed below, directed to the Bureau of Water Compliance, if a waiver from the electronic submittal requirements has been granted by DEC to the facility.**

Attach the monthly "Wastewater Facility Operation Report" (form 92-15-7) and any required DMR attachments electronically to the DMR or with the hardcopy submittal.

The first monitoring period begins on the effective date of this permit, and, unless otherwise required, the reports are due no later than the 28th day of the month following the end of each monitoring period.

- C. Additional information required to be submitted by this permit shall be summarized and reported to the Regional Water Engineer and Bureau of Water Permits at the following addresses:

Department of Environmental Conservation
Division of Water, Bureau of Water Permits
625 Broadway, Albany, New York 12233-3505 Phone: (518) 402-8111

Department of Environmental Conservation
Regional Water Engineer, Region 6
State Office Building, 317 Washington Street, Watertown, New York, 13601-3787 Phone: (315) 785-2513

- D. Bypass and Sewage Pollutant Right to Know Reporting: In accordance with the Sewage Pollutant Right to Know Act (ECL § 17-0826-a), Publicly Owned Treatment Works (POTWs) are required to notify DEC and Department of Health within two hours of discovery of an untreated or partially treated sewage discharge and to notify the public and adjoining municipalities within four hours of discovery. Information regarding reporting and other requirements of this program may be found on the Department's website. In addition, POTWs are required to provide a five-day incident report and supplemental information to the DEC in accordance with Part 750-2.7(d) by utilizing the Division of Water Report of Noncompliance Event form unless waived by DEC on a case-by-case basis.

- E. Schedule of Additional Submittals:


The permittee shall submit the following information to the Regional Water Engineer and to the Bureau of Water Permits, unless otherwise instructed:

SCHEDULE OF ADDITIONAL SUBMITTALS		
Outfall(s)	Required Action	Due Date
	<u>ANNUAL FLOW CERTIFICATION</u> The permittee shall submit an Annual Flow Certification form each year in accordance with 750-2.9(C)(4). The form shall be attached to the February DMR or submitted through nForm.	February DMR (March 28 th)
	<u>MERCURY - CONDITIONAL EXCLUSION CERTIFICATION</u> Permittee must submit a mercury conditional exclusion certification every five years in order to maintain MMP Type IV status. As part of the certification the permittee will be required to sample the effluent and measure <12 ng/L.	2/8/2027 and every 5 years thereafter

SCHEDULE OF ADDITIONAL SUBMITTALS		
Outfall(s)	Required Action	Due Date
	<u>MERCURY MINIMIZATION PLAN</u> The permittee must complete and maintain onsite an annual mercury minimization status report in accordance with the requirements of this permit.	<i>Maintained Onsite</i> EDPM + 1 year, annually thereafter

Unless noted otherwise, the above actions are one-time requirements.

- F. Monitoring and analysis shall be conducted using sufficiently sensitive test procedures approved under 40 CFR Part 136, unless other test procedures have been specified in this permit.
- G. More frequent monitoring of the discharge(s), monitoring point(s), or waters of the State than required by the permit, where analysis is performed by a certified laboratory or where such analysis is not required to be performed by a certified laboratory, shall be included in the calculations and recording of the data on the corresponding DMRs.
- H. Calculations which require averaging of measurements shall utilize an arithmetic mean unless otherwise specified in this permit.
- I. Unless otherwise specified, all information recorded on the DMRs shall be based upon measurements and sampling carried out during the most recently completed reporting period.
- J. Any laboratory test or sample analysis required by this permit for which the State Commissioner of Health issues certificates of approval pursuant to section 502 of the Public Health Law shall be conducted by a laboratory which has been issued a certificate of approval. Inquiries regarding laboratory certification should be directed to the New York State Department of Health, Environmental Laboratory Accreditation Program.

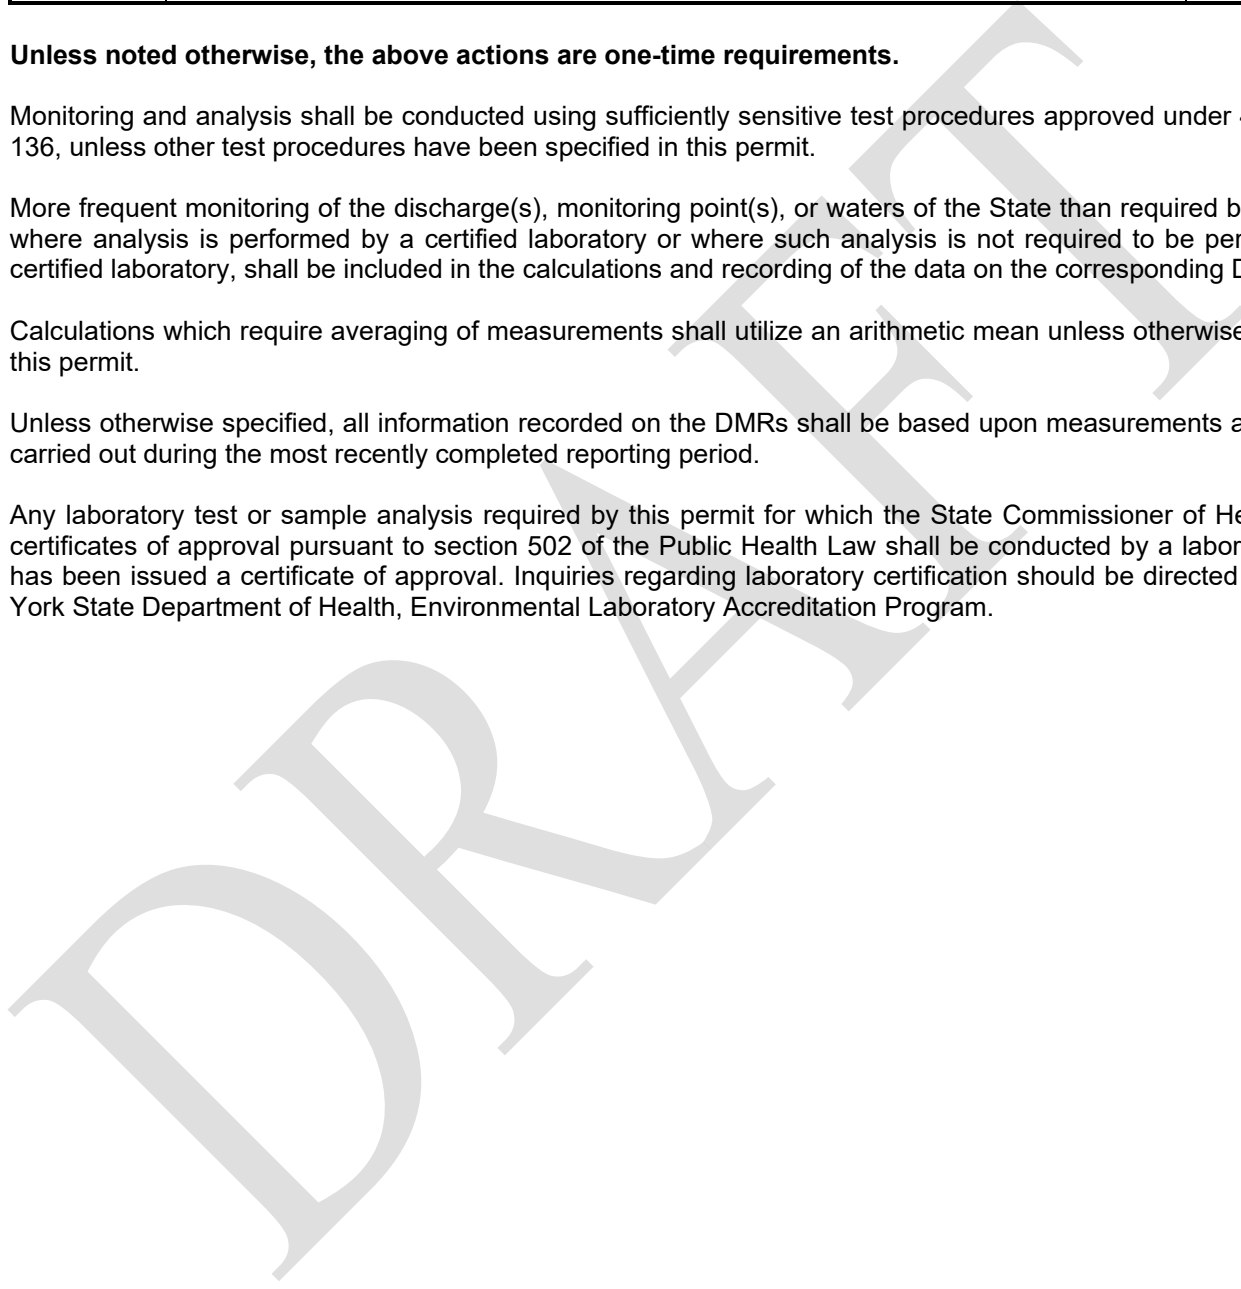

SPDES Permit Fact Sheet

Town of Hermon

Town of Hermon Wastewater Treatment Plant (WWTP)

NY0257532



Summary of Permit Changes

A State Pollutant Discharge Elimination System (SPDES) permittee-initiated permit modification has been drafted for the Town of Hermon Wastewater Treatment Plant (WWTP). The changes to the permit are summarized below:

- Updated permit pages to reflect current NYSDEC format and nomenclature.
- Updated the facility name.
- Corrected permitted flow from 0.06 MGD to 0.078 MGD.
- Updated the flow meter monitoring location.
- Revised Mercury Minimization Program (MMP) requirements to MMP Type IV in accordance with DEC Program Policy DOW 1.3.10.
- Updated the Schedule of Compliance to refer to the Town's Amended Consent Order.
- Added interim limits in accordance with the Town's Amended Consent Order.
- Updated the Monitoring Locations diagram.

This factsheet summarizes the information used for the proposed changes to the permit.

Administrative History

- 6/1/2020 The last full technical review was performed and the SPDES permit became effective with a new five-year term and expiration date of 5/31/2025. The 2020 permit has formed the basis of this permit.
- 4/6/2021 The Town of Hermon submitted a request to modify the permit to increase the permitted flow amount to 0.078 MGD from 0.06 MGD based on the past flow data and existing conditions at the Wastewater Treatment Plant.
- 2/24/2023 The Town of Hermon submitted a request to modify the permit to add a new influent flow meter as the continuous recorder of record for flow at the Wastewater Treatment Plant.

The Notice of Complete Application, published in the [Environmental Notice Bulletin](#) and newspapers, contains information on the public notice process.

Facility Information

This facility is a publicly owned treatment works that receives flow from domestic users, with effluent consisting of treated sanitary wastewater. The collection system consists of separate sewers. The facility does not have any significant industrial users (SIUs). The name of the facility will be changed to reflect ownership by the Town of Hermon which occurred on January 1, 2017.

The treatment plant was constructed in 1996 to provide secondary treatment for a design flow of 0.06 MGD. Information received from the facility indicates that changes were made to the original septic tank layout at the facility prior to construction. Field measurements and verification of the facility's septic tanks and sand filters indicate that the correct design flow for the facility is 0.078 MGD. The monthly average design flow has been updated as part of this permit modification.

The facility is planning the following upgrades/improvements:

- Installation of UV disinfection, new influent flow meter, new valves, and filter basket at the treatment plant and manhole and pipe improvements to the collection system to address infiltration and inflow in the system. Construction of the work is proposed to begin on or

before December 31, 2023, and be completed before August 1, 2025, in accordance with the Amended Schedule of Compliance in the Amended Consent Order R6-20200402-15A.

Reference SPDES Permit Fact Sheet dated 4/30/2020 for additional information.

Enforcement History

The facility is operating under Amended Consent Order #R6-20200402-15A dated 5/17/2023. The Amended Order requires the following compliance actions:

- Begin construction and implementation of the recommended alternative on or before December 31, 2023;
- Complete construction and commence operation of the recommended alternative, comply with the SPDES Permit final effluent limitations, and submit a Certificate of Substantial Completion for the improvements to the Facility required under the Consent Order on or before August 1, 2025; and
- Comply with interim limits for flow, BOD₅ % removal, and TSS % removal until the Certificate of Substantial Completion has been submitted.

Compliance and enforcement information can be found on the EPA's [Enforcement and Compliance History Online \(ECHO\)](#) website.

Receiving Water Information

The facility discharges via the following outfalls:

Outfall No.	SIC Code	Wastewater Type	Receiving Water
001	4952	Treated Sanitary Wastewater	Elm Creek, Class C

The permitted flow for the facility will be corrected to 0.078 MGD to align with the design flow of the facility. Due to the small increase in flow, only a preliminary water quality review was completed and did not result in any water quality concerns that would affect the current permit limits. A comprehensive water quality analysis will be completed under the next full technical review.

Permit Requirements

Anti-backsliding

The increase in the permitted flow effluent limitation is subject to an anti-backsliding determination. The change is allowable under 750-1.10(C)(2) as new information is available regarding the final constructed facility and actual capacity of the treatment system that was not available during the previous permit review. [Appendix Link](#)

Antidegradation

The permit contains effluent limitations which ensure that the best usages of the receiving waters will be maintained. The Notice of Complete Application published in the Environmental Notice Bulletin contains information on the State Environmental Quality Review (SEQR)¹ determination. [Appendix Link](#)

¹ As prescribed by 6 NYCRR Part 617

Mercury²

The multiple discharge variance (MDV) for mercury provides the framework for NYSDEC to require mercury monitoring and mercury minimization programs (MMPs), through SPDES permitting. [Appendix Link](#)

The facility is a NYS significant surface water minor facility classified as municipal (07) and does not have a mercury source. On 2/8/2022, the permittee submitted a Conditional Exclusion Certification, certifying that the facility does not have any of the mercury sources listed in Part III.A.3. of DOW 1.3.10 and the effluent measured <12 ng/L. Therefore, consistent with DOW 1.3.10, the permit requirements are changing from Low Level Mercury to MMP Type IV and will continue to not include mercury effluent limitations. The [Schedule of Additional Submittals](#) includes a mercury minimization plan annual status report (maintained onsite), and re-certification of the exclusion every five years. As part of the re-certification, the effluent must be sampled and continue to measure <12 ng/L. This requirement is new.

Schedule(s) of Additional Submittals

A schedule of additional submittals has been included for the following ([Appendix Link](#)):

- Mercury Minimization Plan Annual Status Report (maintained onsite).

² In accordance with DOW 1.3.10 Mercury – SPDES Permitting & Multiple Discharge Variance (MDV), December 30, 2020.

Appendix: Regulatory and Technical Basis of Permit Authorizations

The Appendix is meant to supplement the factsheet for multiple types of SPDES permits. Portions of this Appendix may not be applicable to this specific permit.

Regulatory References

The provisions of the permit are based largely upon 40 CFR 122 subpart C and 6 NYCRR Part 750 and include monitoring, recording, reporting, and compliance requirements, as well as general conditions applicable to all SPDES permits. Below are the most common citations for the requirements included in SPDES permits:

- Clean Water Act (CWA) 33 section USC 1251 to 1387
- Environmental Conservation Law (ECL) Articles 17 and 70
- Federal Regulations
 - 40 CFR, Chapter I, subchapters D, N, and O
- State environmental regulations
 - 6 NYCRR Part 621
 - 6 NYCRR Part 750
 - 6 NYCRR Parts 700 - 704 – Best use and other requirements applicable to water classes
 - 6 NYCRR Parts 800 – 941 - Classification of individual surface waters
- NYSDEC water program policy, referred to as Technical and Operational Guidance Series (TOGS)
- USEPA Office of Water Technical Support Document for Water Quality-based Toxics Control, March 1991, Appendix E

The following is a quick guide to the references used within the factsheet:

SPDES Permit Requirements	Regulatory Reference
Anti-backsliding	6 NYCRR 750-1.10(c)
Best Management Practices (BMPS) for CSOs	6 NYCRR 750-2.8(a)(2)
Environmental Benefits Permit Strategy (EBPS)	6 NYCRR 750-1.18, NYS ECL 17-0817(4), TOGS 1.2.2 (revised January 25,2012)
Exceptions for Type I SSO Outfalls (bypass)	6 NYCRR 750-2.8(b)(2), 40 CFR 122.41
Mercury Multiple Discharge Variance	Division of Water Program Policy 1.3.10 (DOW 1.3.10)
Mixing Zone and Critical Water Information	TOGS 1.3.1 & Amendments
PCB Minimization Program	40 CFR Part 132 Appendix F Procedure 8, 6 NYCRR 750-1.13(a) and 750-1.14(f), and TOGS 1.2.1
Pollutant Minimization Program (PMP)	6 NYCRR 750-1.13(a), 750-1.14(f), TOGS 1.2.1
Schedules of Compliance	6 NYCRR 750-1.14
Sewage Pollution Right to Know (SPRTK)	NYS ECL 17-0826-a, 6 NYCRR 750-2.7
State Administrative Procedure Act (SAPA)	State Administrative Procedure Act Section 401(2), 6 NYCRR 621.11(l)
State Environmental Quality Review (SEQR)	6 NYCRR Part 617
USEPA Effluent Limitation Guidelines (ELGs)	40 CFR Parts 405-471
USEPA National CSO Policy	33 USC Section 1342(q)
Whole Effluent Toxicity (WET) Testing	TOGS 1.3.2
General Provisions of a SPDES Permit Department Request for Additional Information	NYCRR 750-2.1(i)

Permit Requirements

Anti-backsliding

Anti-backsliding requirements are specified in the CWA sections 402(o) and 303(d)(4), ECL 17-0809, and regulations at 40 CFR 122.44(l) and 6 NYCRR 750-1.10(c) and (d). Generally, the relaxation of effluent limitations in permits is prohibited unless one of the specified exceptions applies, which will be cited on a case-by-case basis in this factsheet. Consistent with current case law³ and USEPA interpretation⁴ anti-backsliding

³ American Iron and Steel Institute v. Environmental Protection Agency, 115 F.3d 979, 993 n.6 (D.C. Cir. 1997)

⁴ U.S. EPA, Water Quality Standards; Establishment of Numeric Criteria for Priority Toxic Pollutants for the State of California; 65 Fed. Reg. 31682, 31704 (May 18, 2000); Proposed Water Quality Guidance for the Great Lakes System, 58 Fed. Reg. 20802, 20837 & 20981 (April 16, 1993)

requirements do not apply should a revision to the final effluent limitation take effect before the scheduled date of compliance for that final effluent limitation.

Antidegradation Policy

New York State implements the antidegradation portion of the CWA based upon two documents: (1) Organization and Delegation Memorandum #85-40, "Water Quality Antidegradation Policy" (September 9, 1985); and, (2) TOGS 1.3.9, "Implementation of the NYSDEC Antidegradation Policy – Great Lakes Basin (Supplement to Antidegradation Policy dated September 9, 1985) (undated)." The permit for the facility contains effluent limitations which ensure that the existing best usage of the receiving waters will be maintained. To further support the antidegradation policy, SPDES applications have been reviewed in accordance with the State Environmental Quality Review Act (SEQR) as prescribed by 6 NYCRR Part 617.

Mercury

The multiple discharge variance (MDV) for mercury was developed in accordance with 6 NYCRR 702.17(h) "to address widespread standard or guidance value attainment issues including the presence of a ubiquitous pollutant or naturally high levels of a pollutant in a watershed." The first MDV was issued in October 2010, and subsequently revised and reissued in 2015; each subsequent iteration of the MDV is designed to build off the previous version, to make reasonable progress towards the water quality standard (WQS) of 0.7 ng/L dissolved mercury. The MDV is necessary because human-caused conditions or sources of mercury prevent attainment of the WQS and cannot be remedied (i.e., mercury is ubiquitous in New York waters at levels above the WQS and compliance with a water quality based effluent limitation (WQBEL) for mercury cannot be achieved with demonstrated effluent treatment technologies). The Department has determined that the MDV is consistent with the protection of public health, safety, and welfare. During the effective period of this MDV, any increased risks to human health are mitigated by fish consumption advisories issued periodically by the NYSDOH.

All surface water SPDES permittees are eligible for authorization by the MDV provided they meet the requirements specified in DOW 1.3.10.

Schedule(s) of Additional Submittals

Schedules of Additional Submittals are used to summarize the deliverables required by the permit not identified in a separate Schedule of Compliance.