



Department of
Environmental
Conservation

State Pollutant Discharge Elimination System (SPDES) DISCHARGE PERMIT

SIC Code: 4952	NAICS Code: 221320	SPDES Number:	NY0020672
Discharge Class (CL):	05	DEC Number:	7-2532-00006/00001
Toxic Class (TX):	T	Effective Date (EDP):	December 1, 2021
Major-Sub Drainage Basin:	06 - 02	Expiration Date (ExDP):	November 30, 2026
Water Index Number:	SR-44-78	Item No.: 931 - 842	Modification Dates (EDPM): EDPM
Compact Area:	SRBC		

This SPDES permit is issued in compliance with Title 8 of Article 17 of the Environmental Conservation Law of New York State and in compliance with the Clean Water Act, as amended, (33 U.S.C. '1251 et.seq.)

PERMITTEE NAME AND ADDRESS			
Name:	Village of Hamilton	Attention:	James Stokes, Administrator
Street:	P.O. Box 119, 3 Broad Street		
City:	Hamilton	State:	NY Zip Code: 13346
Email:	James@hamilton-ny.gov	Phone:	315-824-1760

is authorized to discharge from the facility described below:

FACILITY NAME, ADDRESS, AND PRIMARY OUTFALL							
Name:	Village of Hamilton Water Pollution Control Plant						
Address / Location:	81 College Street					County:	Madison
City:	Hamilton			State:	NY	Zip Code:	13346
Facility Location:	Latitude:	42 °	48 '	53.7 " N	& Longitude:	75 °	32 ' 57.2 " W
Primary Outfall No.:	Latitude:	42 °	48 '	54 " N	& Longitude:	75 °	32 ' 59 " W
Outfall Description:	Treated Sanitary	Receiving Water:	Payne Brook			Class:	C

in accordance with: effluent limitations; monitoring and reporting requirements; other provisions and conditions set forth in this permit; and 6 NYCRR Part 750-1 and 750-2.

This permit and the authorization to discharge shall expire on midnight of the expiration date shown above and the permittee shall not discharge after the expiration date unless this permit has been renewed or extended pursuant to law. To be authorized to discharge beyond the expiration date, the permittee shall apply for permit renewal not less than 180 days prior to the expiration date shown above.

DISTRIBUTION:

CO BWP - Permit Coordinator
CO BWC - SCIS
RWE
RPA
EPA Region II
NYSEFC

Permit Administrator:			
Address:	625 Broadway Albany, NY 12233-1750		
Signature:		Date:	/ /

DEFINITIONS FOR PERMIT LIMITS, LEVELS AND MONITORING TERMS

TERM	DEFINITION
7-Day Geo Mean	The highest allowable geometric mean of daily discharges over a calendar week.
7-Day Average	The average of all daily discharges for each 7-days in the monitoring period. The sample measurement is the highest of the 7-day averages calculated for the monitoring period.
12-Month Rolling Average (12 MRA)	The current monthly value of a parameter, plus the sum of the monthly values over the previous 11 months for that parameter, divided by 12.
30-Day Geometric Mean	The highest allowable geometric mean of daily discharges over a calendar month, calculated as the antilog of: the sum of the log of each of the daily discharges measured during a calendar month divided by the number of daily discharges measured during that month.
Action Level	Action level means a monitoring requirement characterized by a numerical value that, when exceeded, triggers additional permittee actions and department review to determine if numerical effluent limitations should be imposed.
Compliance Level / Minimum Level	A compliance level is an effluent limitation. A compliance level is given when the water quality evaluation specifies a Water Quality Based Effluent Limit (WQBEL) below the Minimum Level. The compliance level shall be set at the Minimum Level (ML) for the most sensitive analytical method as given in 40 CFR Part 136, or otherwise accepted by the Department.
Daily Discharge	The discharge of a pollutant measured during a calendar day or any 24-hour period that reasonably represents the calendar day for the purposes of sampling. For pollutants expressed in units of mass, the 'daily discharge' is calculated as the total mass of the pollutant discharged over the day. For pollutants with limitations expressed in other units of measurement, the 'daily discharge' is calculated as the average measurement of the pollutant over the day.
Daily Maximum	The highest allowable Daily Discharge.
Daily Minimum	The lowest allowable Daily Discharge.
Effective Date of Permit (EDP or EDPM)	The date this permit is in effect.
Effluent Limitations	Effluent limitation means any restriction on quantities, quality, rates and concentrations of chemical, physical, biological, and other constituents of effluents that are discharged into waters of the state.
Expiration Date of Permit (ExDP)	The date this permit is no longer in effect.
Instantaneous Maximum	The maximum level that may not be exceeded at any instant in time.
Instantaneous Minimum	The minimum level that must be maintained at all instants in time.
Monthly Average	The highest allowable average of daily discharges over a calendar month, calculated as the sum of each of the daily discharges measured during a calendar month divided by the number of daily discharges measured during that month.
Outfall	The terminus of a sewer system, or the point of emergence of any waterborne sewage, industrial waste or other wastes or the effluent therefrom, into the waters of the State.
Range	The minimum and maximum instantaneous measurements for the reporting period must remain between the two values shown.
Receiving Water	The classified waters of the state to which the listed outfall discharges.
Sample Frequency / Sample Type / Units	See NYSDEC's "DMR Manual for Completing the Discharge Monitoring Report for the SPDES" for information on sample frequency, type and units.

PERMIT LIMITS, LEVELS AND MONITORING

OUTFALL	LIMITATIONS APPLY		RECEIVING WATER		EFFECTIVE	EXPIRING				
001	Year Round		Payne Brook		EDPM	11/30/2026				
PARAMETER	EFFLUENT LIMITATION					MONITORING REQUIREMENTS				FN
	Type	Limit	Units	Limit	Units	Sample Frequency	Sample Type	Location		
								Inf.	Eff.	
Flow	Monthly Average	0.85	MGD			Continuous	Recorder	X		
CBOD ₅	Monthly Average	25	mg/L	180	lbs/d	2/Month	24-hr. Comp.	X	X	1
CBOD ₅	7-Day Average	40	mg/L	280	lbs/d	2/Month	24-hr. Comp.	X	X	
UOD	Daily Maximum	Monitor	mg/L	200	lbs/d	2/Month	Calculated		X	2
Total Suspended Solids (TSS)	Monthly Average	30	mg/L	210	lbs/d	2/Month	24-hr. Comp.	X	X	1
Total Suspended Solids (TSS)	7-Day Average	45	mg/L	320	lbs/d	2/Month	24-hr. Comp.	X	X	
Settleable Solids	Daily Maximum	0.1	mL/L			Daily	Grab	X	X	
pH	Range	6.5-8.5	SU			Daily	Grab	X	X	
Nitrogen, Ammonia (as N) June 1 st – October 31 st	Monthly Average	2.3	mg/L	Monitor	lbs/d	2/Month	24-hr. Comp.	X	X	
Nitrogen, Ammonia (as N) November 1 st – May 31 st	Monthly Average	3.4	mg/L	Monitor	lbs/d	2/Month	24-hr. Comp.	X	X	
Temperature	Daily Maximum	Monitor	°C			Daily	Grab	X	X	
Dissolved Oxygen	Daily Minimum	6.0	mg/L			2/Month	Grab		X	
Total Phosphorus (as P)	Monthly Average	1.0	mg/L	Monitor	lbs/d	2/Month	24-hr. Comp.	X	X	
Total Phosphorus (as P)	Monthly Total			Monitor	lbs/mon	1/Month	Calculated		X	3
Total Phosphorus (as P)	12 Month Rolling Total			1290	lbs/yr	1/Month	Calculated		X	4, 5
Total Nitrogen (as N)	Monthly Average	Monitor	mg/L	Monitor	lbs/d	2/Month	Calculated	X	X	6
Total Nitrogen (as N)	Monthly Total			Monitor	lbs/mon	1/Month	Calculated		X	3
Total Nitrogen (as N)	12 Month Rolling Total			32,000	lbs/yr	1/Month	Calculated		X	5
Total Kjeldahl Nitrogen (TKN) (as N)	Monthly Average	Monitor	mg/L	Monitor	lbs/d	2/Month	24-hr. Comp.	X	X	
Nitrate (NO ₃) (as N)	Monthly Average	Monitor	mg/L	Monitor	lbs/d	2/Month	24-hr. Comp.	X	X	
Nitrite (NO ₂) (as N)	Monthly Average	Monitor	mg/L	Monitor	lbs/d	2/Month	24-hr. Comp.	X	X	
Total Copper	Daily Maximum	53	ug/L	Monitor	lbs/d	1/Month	24-hr. Comp.		X	4
Mercury, Total	Daily Maximum	50	ng/L			Semi-annually	Grab		X	
Mercury, Total	12 MRA	12	ng/L			Semi-annually	Grab		X	

Permit Limits Table and Footnotes Continued on Page 4

PERMIT LIMITS, LEVELS AND MONITORING - Continued

OUTFALL	LIMITATIONS APPLY	RECEIVING WATER	EFFECTIVE	EXPIRING
001	Year Round	Payne Brook	EDPM	11/30/2026

EFFLUENT DISINFECTION		Limit	Units	Limit	Units	Sample Frequency	Sample Type	Inf.	Eff.	FN
Required Seasonal from May 1st - October 31st										
Coliform, Fecal	30-Day Geometric Mean	200	No./100 mL			2/Month	Grab		X	
Coliform, Fecal	7-Day Geometric Mean	400	No./100 mL			2/Month	Grab		X	
Chlorine, Total Residual	Daily Maximum	0.03	mg/L			Daily	Grab		X	7, 8

FOOTNOTES:

- Effluent shall not exceed 15% and 15% of influent concentration values for CBOD₅ & TSS respectively.
- Ultimate Oxygen Demand (UOD) shall be computed as follows: $UOD = (1.5 \times CBOD_5) + (4.5 \times TKN)$.
- Total phosphorus and total nitrogen monthly total (lbs/month) is calculated as the monthly average load (lbs/d) multiplied by the number of days in the month.
- This is a final effluent limitation. See Schedule of Compliance for applicable interim effluent limitation.
- Total phosphorus and total nitrogen (as N), 12-month rolling total (lbs/year) is calculated as the current month load added to the month loads from the previous eleven months.
- Total Nitrogen (as N) = [Total Kjeldahl Nitrogen (TKN), as N] + [Nitrite (NO₂), as N] + [Nitrate (NO₃), as N].
- Reporting for Total Residual Chlorine is only applicable if chlorine is used for disinfection, elsewhere in the treatment process, or the facility otherwise has reasonable potential to discharge chlorine.
- This is a Compliance Level. The calculated WQBEL for total residual chlorine is 0.013 mg/L.

MERCURY MINIMIZATION PROGRAM (MMP) - Type II

1. General - The permittee must develop, implement, and maintain a mercury minimization program (MMP), containing the elements set forth below, to reduce mercury effluent levels with the goal of achieving the WQBEL of 0.7 ng/L.
2. MMP Elements - The MMP must be a written document and must include any necessary drawings or maps of the facility and/or collection system. Other related documents already prepared for the facility may be used as part of the MMP and may be incorporated by reference. At a minimum, the MMP must include the following elements as described in detail below:
 - a. Monitoring - Monitoring at outfall, influent and other locations tributary to compliance points may be performed using either USEPA Method 1631 or another sufficiently sensitive method, as approved under 40 CFR Part 136¹. Monitoring of raw materials, equipment, treatment residuals, and other non-wastewater/non-stormwater substances may be performed using other methods as appropriate. Monitoring must be coordinated so that the results can be effectively compared between locations.

Minimum required monitoring is as follows:

- i. Sewage Treatment Plant Influent & Effluent – The permittee must collect samples at each of these locations in accordance with the minimum frequency specified on the pages of the SPDES permit that contain the mercury effluent limitations.
- ii. Key Locations and Potential Mercury Sources – The permit includes reduced monitoring requirements and does not require key location sampling. See section 2.a.iv below.
- iii. Hauled Wastes – The permittee must establish procedures for the acceptance of hauled waste to ensure the hauled waste is not a potential mercury source. Loads which may exceed 500 ng/L,² must receive approval from the Department prior to acceptance.
- iv. Decreased Monitoring Requirements - The permittee has an EEQ at or below 12 ng/L and the permit includes the following requirements:
 - 1) Reduced requirements
 - a) Conduct influent monitoring, sampling semi-annually, in lieu of monitoring within the collection system, such as at *key locations*; and
 - b) Conduct effluent compliance sampling semi-annually.
 - 2) If a facility with reduced requirements reports discharges above 12 ng/L for two of four consecutive effluent samples, the Department may undertake a Department-initiated modification to remove the allowance of reduced requirements.
 - 3) Under the decreased permit requirements, the facility must continue to conduct an annual status report, as applicable in accordance with 2.c of this MMP, to determine if any waste streams have changed.
- v. Additional monitoring must be completed as required elsewhere in this permit (e.g., locations tributary to compliance points).
- b. Control Strategy - The control strategy must contain the following minimum elements:
 - i. Pretreatment/Sewer Use Law - The permittee must review pretreatment program requirements and the Sewer Use Law (SUL) to ensure it is up-to-date and enforceable with applicable permit requirements and will support efforts to achieve a dissolved mercury concentration of 0.70 ng/L in the effluent.

¹ Outfall monitoring must be conducted using the methods specified in Table 8 of *DOW 1.3.10*.

²A level of 0.2 mg/L (200,000 ng/L) or more is considered hazardous per 40 CFR Part 261.11. 500 ng/L is used here to alert the permittee that there is an unusual concentration of mercury and that it will need to be managed appropriately.

ii. Monitoring and Inventory/Inspections -

- 1) Monitoring shall be performed as described in 2.a above. As mercury sources are found, the permittee must enforce its sewer use law to track down and minimize these sources.
- 2) The permittee must inventory and/or inspect users of its system as necessary to support the MMP.

a) Dental Facilities

1. The permittee must maintain an inventory of each dental facility.
2. The permittee must inspect each dental facility at least once every five years to verify compliance with the wastewater treatment operation, maintenance, and notification elements of 6 NYCRR 374.4. Alternatively, the permittee may develop and implement an outreach program,³ which informs users of their responsibilities, and collect the “Amalgam Waste Compliance Report for Dental Dischargers”⁴ form, as needed, to satisfy the inspection requirements. The permittee must conduct the outreach program at least once every five years and ensure the “Amalgam Waste Compliance Report for Dental Dischargers” are submitted by new users, as necessary. The outreach program could be supported by a subset of site inspections.
3. A file shall be maintained containing documentation demonstrating compliance with 2.b.ii.2)a) above. This file shall be available for review by the Department representatives and copies shall be provided upon request.

b) Other *potential mercury sources*

1. The permittee must maintain an inventory of other *potential mercury sources*.
2. The permittee must inspect other *potential mercury sources* once every five years. Alternatively, the permittee may develop and implement an outreach program which informs users of their responsibilities as *potential mercury sources*. The permittee must conduct the outreach program at least once every five years. The outreach program should be supported by a subset of site inspections.
3. A file shall be maintained containing documentation demonstrating compliance with 2.b.ii.2)b) above. This file shall be available for review by the Department representatives and copies shall be provided upon request.

iii. Systems with CSO & Type II SSO Outfalls – Permittees must prioritize *potential mercury sources* upstream of CSOs and Type II SSOs for mercury reduction activities and/or controlled-release discharge.

iv. Equipment and Materials – Equipment and materials (e.g., thermometers, thermostats) used by the permittee, which may contain mercury, must be evaluated by the permittee. As equipment and materials containing mercury are updated/replaced, the permittee must use mercury-free alternatives, if possible.

³ For example, the outreach program could include education about sources of mercury and what to do if a mercury source is found.

⁴ The form, “Amalgam Waste Compliance Report for Dental Dischargers,” can be found here:

https://www.dec.ny.gov/docs/water_pdf/dentalform.pdf

- v. Bulk Chemical Evaluation – For chemicals, used at a rate which exceeds 1,000 gallons/year or 10,000 pounds/year, the permittee must obtain a manufacturer's certificate of analysis, a chemical analysis performed by a certified laboratory, and/or a notarized affidavit which describes the substances' mercury concentration and the detection limit achieved. If possible, the permittee must only use bulk chemicals utilized in the wastewater treatment process which contain <10 ppb mercury.
- c. Annual Status Report - An annual status report must be completed and maintained on site summarizing:
- i. All MMP monitoring results for the previous year;
 - ii. A list of known and *potential mercury sources*
 - 1) If the permittee meets the criteria for MMP Type IV, the permittee must notify the Department for a permittee-initiated modification;
 - iii. All actions undertaken, pursuant to the control strategy, during the previous year;
 - iv. Actions planned, pursuant to the control strategy, for the upcoming year; and
 - v. Progress towards achieving a dissolved mercury concentration of 0.70 ng/L in the effluent (e.g., summarizing reductions in effluent concentrations as a result of the control strategy implementation and/or installation/modification of a treatment system).

The first annual status report is due in accordance with the Schedule of Additional Submittals. The permittee must maintain a file with all MMP documentation, including the dental forms required by 6 NYCRR 374.4. The file must be available for review by Department representatives and copies must be provided upon request in accordance with 6 NYCRR 750-2.1(i) and 750-2.5(c)(4).

3. MMP Modification - The MMP must be modified whenever:
- a. Changes at the facility, or within the collection system, increase the potential for mercury discharges;
 - b. Effluent discharges exceed the current permit limitation(s); or
 - c. A letter from the Department identifies inadequacies in the MMP.

The Department may use information in the annual or semiannual status reports, as applicable in accordance with 2.c of this MMP, to determine if the permit limitations and MMP Type is appropriate for the facility.

DEFINITIONS:

Key location – a location within the collection/wastewater system (e.g. including but not limited to a specific manhole/access point, tributary sewer/wastewater connection, or user discharge point) identified by the permittee as a potential mercury source. The permittee may adjust key locations based upon sampling and/or best professional judgement.

Potential mercury source – a source identified by the permittee that may reasonably be expected to have total mercury contained in the discharge. Some potential mercury sources include switches, fluorescent lightbulbs, cleaners, degreasers, thermometers, batteries, hauled wastes, universities, hospitals, laboratories, landfills, Brownfield sites, or raw material storage.

DISCHARGE NOTIFICATION REQUIREMENTS

- (a) The permittee shall install and maintain identification signs at all outfalls to surface waters listed in this permit, unless the Permittee has obtained a waiver in accordance with the Discharge Notification Act (DNA). Such signs shall be installed before initiation of any discharge.
- (b) Subsequent modifications to or renewal of this permit does not reset or revise the deadline set forth in (a) above, unless a new deadline is set explicitly by such permit modification or renewal.
- (c) The Discharge Notification Requirements described herein do not apply to outfalls from which the discharge is composed exclusively of storm water, or discharges to ground water.
- (d) The sign(s) shall be conspicuous, legible and in as close proximity to the point of discharge as is reasonably possible while ensuring the maximum visibility from the surface water and shore. The signs shall be installed in such a manner to pose minimal hazard to navigation, bathing or other water related activities. If the public has access to the water from the land in the vicinity of the outfall, an identical sign shall be posted to be visible from the direction approaching the surface water.

The signs shall have **minimum** dimensions of eighteen inches by twenty-four inches (18" x 24") and shall have white letters on a green background and contain the following information:

<p>N.Y.S. PERMITTED DISCHARGE POINT</p> <p>SPDES PERMIT No.: NY_____</p> <p>OUTFALL No. : _____</p>
For information about this permitted discharge contact:
Permittee Name: _____
Permittee Contact: _____
Permittee Phone: () - ### - ####
OR:
NYSDEC Division of Water Regional Office Address:
NYSDEC Division of Water Regional Phone: () - ### - ####

- (e) Upon request, the permittee shall make available electronic or hard copies of the sampling data to the public. In accordance with the RECORDING, REPORTING AND ADDITIONAL MONITORING REQUIREMENTS page of your permit, each DMR shall be maintained (either electronically or as a hard copy) on record for a period of five years.
- (f) The permittee shall periodically inspect the outfall identification sign(s) in order to ensure they are maintained, are still visible, and contain information that is current and factually correct. Signs that are damaged or incorrect shall be replaced within 3 months of inspection.
- (g) If the permittee believes that any outfall which discharges wastewater from the permitted facility meets any of the DNA waiver criteria, notification must be made to the Department's Bureau of Water Permits. Provided there is no objection by the Department, a sign for the involved outfall(s) are not required. This notification must include the facility's name, address, telephone number, contact, permit number, outfall number(s), and reason why such outfall(s) is waived from the requirements of discharge notification. The Department may evaluate the applicability of a waiver at any time and take appropriate measures to assure that the ECL and associated regulations are complied with.

SCHEDULE OF COMPLIANCE

a) The permittee shall comply with the following schedule:

Outfall(s)	Compliance Action	Due Date
001	<u>SCHEDULE OF COMPLIANCE STATUS REPORTS</u> Submit interim status reports on the progress related to meeting the final limits for copper, and the phosphorus 12-month rolling average.	August 1, 2022, and every 9 months thereafter
001	<u>COPPER EFFLUENT LIMITATIONS</u> Comply with the final effluent limits for copper.	January 1, 2025
001	<u>PHOSPHORUS 12-MONTH ROLLING TOTAL</u> Comply with the final total phosphorus 12-month rolling total of 1290 lb/yr.	January 1, 2025

The above compliance actions are one-time requirements. The permittee shall comply with the above compliance actions to the Department's satisfaction once. When this permit is administratively renewed by NYSDEC letter entitled "SPDES NOTICE/RENEWAL APPLICATION/PERMIT," the permittee is not required to repeat the submission(s) noted above. The above due dates are independent from the effective date of the permit stated in the "SPDES NOTICE/RENEWAL APPLICATION/PERMIT" letter.


INTERIM EFFLUENT LIMITS FOR PARAMETERS SUBJECT TO THIS SCHEDULE OF COMPLIANCE

Outfall	Parameter(s) Affected	Interim Effluent Limit			Limits Apply	Notes	Interim Limits Expire
		Type	Limit	Units			
001	Copper	Daily Max	Monitor	mg/L	Year Round	1	December 31, 2024
001	Total Phosphorus	12 Month Rolling Total	1990	lbs/yr	Year Round	1	December 31, 2024
Notes:	1. See permit limits table for sample frequency and type.						

- b) The permittee shall submit a written notice of compliance or non-compliance with each of the above schedule dates no later than 14 days following each elapsed date, unless conditions require more immediate notice as prescribed in 6 NYCRR Part 750-1.2(a) and 750-2. All such compliance or non-compliance notification shall be sent to the locations listed under the section of this permit entitled RECORDING, REPORTING AND ADDITIONAL MONITORING REQUIREMENTS. Each notice of non-compliance shall include the following information:
1. A short description of the non-compliance;
 2. A description of any actions taken or proposed by the permittee to comply with the elapsed schedule requirements without further delay and to limit environmental impact associated with the non-compliance;
 3. Any details which tend to explain or mitigate an instance of non-compliance; and
 4. An estimate of the date the permittee will comply with the elapsed schedule requirement and an assessment of the probability that the permittee will meet the next scheduled requirement on time.
- c) The permittee shall submit copies of any document required by the above schedule of compliance to the NYSDEC Regional Water Engineer and to the Bureau of Water Permits.

MONITORING LOCATIONS

The permittee shall take samples and measurements, to comply with the monitoring requirements specified in this permit, at the locations(s) specified below:

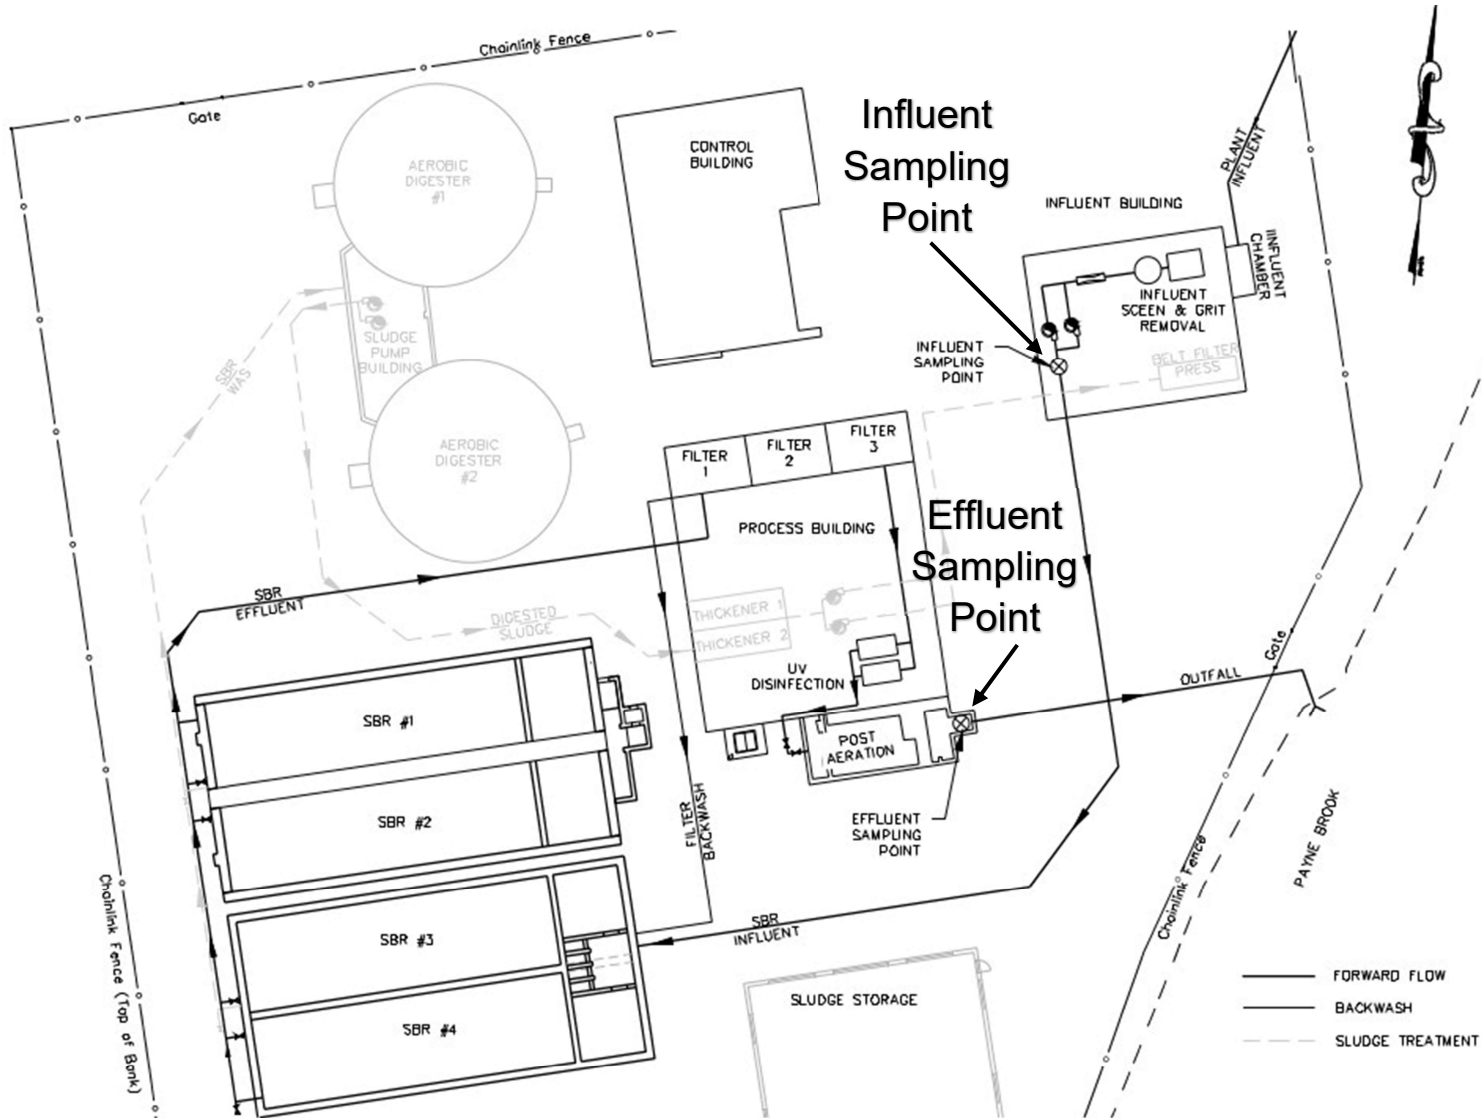

VILLAGE OF HAMILTON SEWAGE TREATMENT PLANT
SPDES PERMIT # NY-0020672

GENERAL REQUIREMENTS

- A. The regulations in 6 NYCRR Part 750 are hereby incorporated by reference and the conditions are enforceable requirements under this permit. The permittee shall comply with all requirements set forth in this permit and with all the applicable requirements of 6 NYCRR Part 750 incorporated into this permit by reference, including but not limited to the regulations in paragraphs B through I as follows:
- B. General Conditions
- | | |
|--|---|
| 1. Duty to comply | 6 NYCRR 750-2.1(e) & 2.4 |
| 2. Duty to reapply | 6 NYCRR 750-1.16(a) |
| 3. Need to halt or reduce activity not a defense | 6 NYCRR 750-2.1(g) |
| 4. Duty to mitigate | 6 NYCRR 750-2.7(f) |
| 5. Permit actions | 6 NYCRR 750-1.1(c), 1.18, 1.20 & 2.1(h) |
| 6. Property rights | 6 NYCRR 750-2.2(b) |
| 7. Duty to provide information | 6 NYCRR 750-2.1(i) |
| 8. Inspection and entry | 6 NYCRR 750-2.1(a) & 2.3 |
- C. Operation and Maintenance
- | | |
|-----------------------------------|--------------------------------------|
| 1. Proper Operation & Maintenance | 6 NYCRR 750-2.8 |
| 2. Bypass | 6 NYCRR 750-1.2(a)(17), 2.8(b) & 2.7 |
| 3. Upset | 6 NYCRR 750-1.2(a)(94) & 2.8(c) |
- D. Monitoring and Records
- | | |
|---------------------------|--|
| 1. Monitoring and records | 6 NYCRR 750-2.5(a)(2), 2.5(a)(6), 2.5(c)(1), 2.5(c)(2), & 2.5(d) |
| 2. Signatory requirements | 6 NYCRR 750-1.8 & 2.5(b) |
- E. Reporting Requirements
- | | |
|---|-----------------------------|
| 1. Reporting requirements | 6 NYCRR 750-2.5, 2.7 & 1.17 |
| 2. Anticipated noncompliance | 6 NYCRR 750-2.7(a) |
| 3. Transfers | 6 NYCRR 750-1.17 |
| 4. Monitoring reports | 6 NYCRR 750-2.5(e) |
| 5. Compliance schedules | 6 NYCRR 750-1.14(d) |
| 6. 24-hour reporting | 6 NYCRR 750-2.7(c) & (d) |
| 7. Other noncompliance | 6 NYCRR 750-2.7(e) |
| 8. Other information | 6 NYCRR 750-2.1(f) |
| 9. Additional conditions applicable to a POTW | 6 NYCRR 750-2.9 |
- F. Planned Changes
1. The permittee shall give notice to the Department as soon as possible of planned physical alterations or additions to the permitted facility when:
 - a. The alteration or addition to the permitted facility may meet any of the criteria for determining whether facility is a new source in 40 CFR §122.29(b); or
 - b. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants which are subject either to effluent limitations in the permit, or to notification requirements under 40 CFR §122.42(a)(1); or
 - c. The alteration or addition results in a significant change in the permittee's sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use or disposal sites not reported during the permit application process or not reported pursuant to an approved land application plan.

In addition to the Department, the permittee shall submit a copy of this notice to the United States Environmental Protection Agency at the following address: U.S. EPA Region 2, Clean Water Regulatory Branch, 290 Broadway, 24th Floor, New York, NY 10007-1866.

GENERAL REQUIREMENTS (continued)

2. Notification Requirement for POTWs

All POTWs shall provide adequate notice to the Department and the USEPA of the following:

- a. Any new introduction of pollutants into the POTW from an indirect discharger which would be subject to section 301 or 306 of CWA if it were directly discharging those pollutants; or
- b. Any substantial change in the volume or character of pollutants being introduced into that POTW by a source introducing pollutants into the POTW at the time of issuance of the permit.
- c. For the purposes of this paragraph, adequate notice shall include information on:
 - i. the quality and quantity of effluent introduced into the POTW, and
 - ii. any anticipated impact of the change on the quantity or quality of effluent to be discharged from the POTW.

POTWs shall submit a copy of this notice to the United States Environmental Protection Agency, at the following address:

U.S. EPA Region 2, Clean Water Regulatory Branch, 290 Broadway, 24th Floor, New York, NY 10007-1866

G. Sludge Management

The permittee shall comply with all applicable requirements of 6 NYCRR Part 360.

H. SPDES Permit Program Fee

The permittee shall pay to the Department an annual SPDES permit program fee within 30 days of the date of the first invoice, unless otherwise directed by the Department, and shall comply with all applicable requirements of ECL 72-0602 and 6 NYCRR Parts 480, 481 and 485. Note that if there is inconsistency between the fees specified in ECL 72-0602 and 6 NYCRR Part 485, the ECL 72-0602 fees govern.

I. Water Treatment Chemicals (WTCs)

New or increased use and discharge of a WTC requires prior Department review and authorization. At a minimum, the permittee must notify the Department in writing of its intent to change WTC use by submitting a completed *WTC Notification Form* for each proposed WTC. The Department will review that submittal and determine if a SPDES permit modification is necessary or whether WTC review and authorization may proceed outside of the formal permit administrative process. The majority of WTC authorizations do not require SPDES permit modification. In any event, use and discharge of a WTC shall not proceed without prior authorization from the Department. Examples of WTCs include biocides, coagulants, conditioners, corrosion inhibitors, defoamers, deposit control agents, flocculants, scale inhibitors, sequestrants, and settling aids.

1. WTC use shall not exceed the rate explicitly authorized by this permit or otherwise authorized in writing by the Department.
2. The permittee shall maintain a logbook of all WTC use, noting for each WTC the date, time, exact location, and amount of each dosage, and, the name of the individual applying or measuring the chemical. The logbook must also document that adequate process controls are in place to ensure that excessive levels of WTCs are not used.
3. The permittee shall submit a completed WTC Annual Report Form each year that they use and discharge WTCs. This form shall be submitted in electronic format and attached to either the December DMR or the annual monitoring report required below. The *WTC Notification Form and WTC Annual Report Form* are available from the Department's website at: <http://www.dec.ny.gov/permits/93245.html>

RECORDING, REPORTING AND ADDITIONAL MONITORING REQUIREMENTS

- A. The monitoring information required by this permit shall be retained for a period of at least five years from the date of the sampling for subsequent inspection by the Department or its designated agent.
- B. Discharge Monitoring Reports (DMRs): Completed DMR forms shall be submitted for each **one (1)** month reporting period in accordance with the DMR Manual available on Department's website.

DMRs must be submitted electronically using the electronic reporting tool (NetDMR) specified by NYSDEC. Instructions on the use of NetDMR can be found at <https://www.dec.ny.gov/chemical/103774.html>. **Hardcopy paper DMRs will only be received at the address listed below for the Bureau of Water Permits, if a waiver from the electronic submittal requirements has been granted by DEC to the facility.**

Attach the monthly "Wastewater Facility Operation Report" (form 92-15-7) and any required DMR attachments electronically to the DMR or with the hardcopy submittal.

The first monitoring period begins on the effective date of this permit, and, unless otherwise required, the reports are due no later than the 28th day of the month following the end of each monitoring period.

- C. Additional information required by this permit shall be summarized and reported to the RWE and Bureau of Water Permits at the following addresses:

Department of Environmental Conservation
Division of Water, Bureau of Water Permits
625 Broadway, Albany, New York 12233-3505 Phone: (518) 402-8111

Department of Environmental Conservation
Regional Water Engineer, Region 7
5786 Widewaters Parkway, Syracuse, NY 13214-1867 Phone: (315) 426-7500

- D. Bypass and Sewage Pollutant Right to Know Reporting: In accordance with the Sewage Pollutant Right to Know Act (ECL § 17-0826-a), Publicly Owned Treatment Works (POTWs) are required to notify DEC and Department of Health within two hours of discovery of an untreated or partially treated sewage discharge and to notify the public and adjoining municipalities within four hours of discovery. Information regarding reporting and other requirements of this program may be found on the Department's website. In addition, POTWs are required to provide a five-day incident report and supplemental information to the DEC in accordance with Part 750-2.7(d) by utilizing the Division of Water Report of Noncompliance Event form unless waived by DEC on a case-by-case basis.

- E. Schedule of Additional Submittals:

The permittee shall submit as a hardcopy the following information to the Regional Water Engineer and to the Bureau of Water Permits, unless otherwise instructed:

SCHEDULE OF ADDITIONAL SUBMITTALS		
Outfall(s)	Required Action	Due Date
001	<u>WATER TREATMENT CHEMICAL (WTC) ANNUAL REPORT FORM</u> The permittee shall submit a completed WTC Annual Report Form each year that Water Treatment Chemicals are used. The form shall be attached to the December DMR.	Yearly on January 1 st (if WTCs used)

Unless noted otherwise, the above actions are one-time requirements. The permittee shall submit the results of the above actions to the satisfaction of the Department. When this permit is administratively renewed by NYSDEC letter entitled "SPDES NOTICE/RENEWAL APPLICATION/PERMIT", the permittee is not required to repeat the above submittal(s), unless noted otherwise. The above due dates are independent from the effective date of the permit stated in the letter of "SPDES NOTICE/RENEWAL APPLICATION/PERMIT."

- F. Monitoring and analysis shall be conducted using sufficiently sensitive test procedures approved under 40 CFR Part 136, unless other test procedures have been specified in this permit.
- G. More frequent monitoring of the discharge(s), monitoring point(s), or waters of the State than required by the permit, where analysis is performed by a certified laboratory or where such analysis is not required to be performed by a certified laboratory, shall be included in the calculations and recording of the data on the corresponding DMRs.
- H. Calculations which require averaging of measurements shall utilize an arithmetic mean unless otherwise specified in this permit.
- I. Unless otherwise specified, all information recorded on the DMRs shall be based upon measurements and sampling carried out during the most recently completed reporting period.
- J. Any laboratory test or sample analysis required by this permit for which the State Commissioner of Health issues certificates of approval pursuant to section 502 of the Public Health Law shall be conducted by a laboratory which has been issued a certificate of approval. Inquiries regarding laboratory certification should be directed to the New York State Department of Health, Environmental Laboratory Accreditation Program.

SPDES Permit Fact Sheet

Village of Hamilton

Village of Hamilton Water Pollution Control Plant

NY0020672



**Department of
Environmental
Conservation**

Summary of Permit Changes

A State Pollutant Discharge Elimination System (SPDES) permittee-initiated permit modification has been drafted for the Village of Hamilton Water Pollution Control Plant. The changes to the permit are summarized below:

- Corrected Toxic Class from “N” to “T” (from nontoxic to toxic)
- Added 12-month rolling average limit for total mercury
- Reduced mercury sampling frequency from monthly to semi-annually
- Updated Mercury Minimization Program (MMP) Type II for decreased monitoring requirements
- Removed the completed Schedule of Compliance item for the copper workplan (submitted May 16, 2022)
- Updated the Region 7 office address

This fact sheet summarizes the information used to determine the effluent limitations (limits) and other conditions contained in the permit. General background information including the regulatory basis for the effluent limitations and other conditions are in the [Appendix](#) linked throughout this fact sheet.

Administrative History

12/1/2021 The last full technical review was performed and the SPDES permit became effective with a new five-year term and expiration date of 11/30/2026. The 2021 permit has formed the basis of this permit.

8/28/2023 The Village of Hamilton submitted a request to modify the permit for reduced mercury monitoring requirements.

The Notice of Complete Application, published in the [Environmental Notice Bulletin](#) and newspapers, contains information on the public notice process.

Facility Information

This facility is a publicly owned treatment works that receives flow from domestic users, with effluent consisting of treated sanitary wastewater. The collection system consists of separate sewers. The facility does not have any significant industrial users (SIUs). For more history and information regarding this facility, refer to previous permit fact sheets.

Existing Effluent Quality

The existing effluent quality was determined from Discharge Monitoring Reports and the application submitted by the permittee for the period December 2021 to July 2023. [Appendix Link](#)

Receiving Water Information

The facility discharges via the following outfalls:

Outfall No.	SIC Code	Wastewater Type	Receiving Water
001	4952	Treated Sanitary Wastewater	Payne Brook, Class C

Permit Requirements

Mercury¹

The multiple discharge variance (MDV) for mercury provides the framework for NYSDEC to require mercury monitoring and mercury minimization programs (MMPs), through SPDES permitting. [Appendix Link](#)

The facility is a Class 05 major municipal facility located outside the Great Lakes Basin and the permit includes requirements for the implementation of MMP Type II.

The permit includes a daily max total mercury effluent limitation of 50 ng/L, sampled monthly. The facility has an existing effluent quality (EEQ) of 5.1 ng/L, calculated from the lognormal 95th percentile of 18 effluent samples collected from January 2022 to June 2023. The maximum reported value was 9.9 ng/L in March 2023. A mercury minimization program consisting of the following is being continued:

- Additional monitoring of key locations, as defined in the MMP
- Control strategy for implementation of the MMP
- Annual status report (maintained onsite)

Consistent with DOW 1.3.10, the permit is being modified to include a 12-month rolling average total mercury effluent limitation equal to 12 ng/L. As the EEQ is ≤ 12 ng/L, the sampling frequency in the permit is being reduced from monthly to semi-annually. The permit language reflects additional reductions in the MMP requirements.

Anti-backsliding

The limitations contained in the permit are at least as stringent as the previous permit limits and there are no instances of backsliding.

[Appendix Link](#)

Antidegradation

The permit contains effluent limitations which ensure that the best usages of the receiving waters will be maintained. The Notice of Complete Application published in the Environmental Notice Bulletin contains information on the State Environmental Quality Review (SEQR)² determination.

[Appendix Link](#)

¹ In accordance with DOW 1.3.10 Mercury – SPDES Permitting & Multiple Discharge Variance (MDV), December 30, 2020.

² As prescribed by 6 NYCRR Part 617

Appendix: Regulatory and Technical Basis of Permit Authorizations

The Appendix is meant to supplement the fact sheet for multiple types of SPDES permits. Portions of this Appendix may not be applicable to this specific permit.

Regulatory References

The provisions of the permit are based largely upon 40 CFR 122 subpart C and 6 NYCRR Part 750 and include monitoring, recording, reporting, and compliance requirements, as well as general conditions applicable to all SPDES permits. Below are the most common citations for the requirements included in SPDES permits:

- Clean Water Act (CWA) 33 section USC 1251 to 1387
- Environmental Conservation Law (ECL) Articles 17 and 70
- Federal Regulations
 - 40 CFR, Chapter I, subchapters D, N, and O
- State environmental regulations
 - 6 NYCRR Part 621
 - 6 NYCRR Part 750
 - 6 NYCRR Parts 700 - 704 – Best use and other requirements applicable to water classes
 - 6 NYCRR Parts 800 – 941 - Classification of individual surface waters
- NYSDEC water program policy, referred to as Technical and Operational Guidance Series (TOGS)
- USEPA Office of Water Technical Support Document for Water Quality-based Toxics Control, March 1991, Appendix E

The following is a quick guide to the references used within the fact sheet:

SPDES Permit Requirements	Regulatory Reference
Anti-backsliding	6 NYCRR 750-1.10(c)
Best Management Practices (BMPS) for CSOs	6 NYCRR 750-2.8(a)(2)
Environmental Benefits Permit Strategy (EBPS)	6 NYCRR 750-1.18, NYS ECL 17-0817(4), TOGS 1.2.2 (revised January 25,2012)
Exceptions for Type I SSO Outfalls (bypass)	6 NYCRR 750-2.8(b)(2), 40 CFR 122.41
Mercury Multiple Discharge Variance	Division of Water Program Policy 1.3.10 (DOW 1.3.10)
Mixing Zone and Critical Water Information	TOGS 1.3.1 & Amendments
PCB Minimization Program	40 CFR Part 132 Appendix F Procedure 8, 6 NYCRR 750-1.13(a) and 750-1.14(f), and TOGS 1.2.1
Pollutant Minimization Program (PMP)	6 NYCRR 750-1.13(a), 750-1.14(f), TOGS 1.2.1
Schedules of Compliance	6 NYCRR 750-1.14
Sewage Pollution Right to Know (SPRTK)	NYS ECL 17-0826-a, 6 NYCRR 750-2.7
State Administrative Procedure Act (SAPA)	State Administrative Procedure Act Section 401(2), 6 NYCRR 621.11(l)
State Environmental Quality Review (SEQR)	6 NYCRR Part 617
USEPA Effluent Limitation Guidelines (ELGs)	40 CFR Parts 405-471
USEPA National CSO Policy	33 USC Section 1342(q)
Whole Effluent Toxicity (WET) Testing	TOGS 1.3.2
General Provisions of a SPDES Permit Department Request for Additional Information	NYCRR 750-2.1(i)

Outfall and Receiving Water Information

Existing Effluent Quality

The existing effluent quality is determined from a statistical evaluation of effluent data in accordance with TOGS 1.2.1 and the USEPA Office of Water, Technical Support Document for Water Quality-based Toxics Control, March 1991, Appendix E (TSD). The existing effluent quality is equal to the 95th (monthly average) and 99th (daily maximum) percentiles of the lognormal distribution of existing effluent data. When there are greater than three non-detects, a delta-lognormal distribution is assumed, and delta-lognormal calculations are used to determine the monthly average and daily maximum pollutant concentrations. Statistical calculations are not performed for parameters where there are less than ten data points. If additional data is needed, a monitoring requirement may be specified either through routine monitoring or a short-term high intensity monitoring program.

Permit Requirements

Basis for Effluent Limitations

Sections 101, 301, 304, 308, 401, 402, and 405 of the CWA and Titles 5, 7, and 8 of Article 17 ECL, as well as their implementing federal and state regulations, and related guidance, provide the basis for the effluent limitations and other conditions in the permit.

When conducting a full technical review of an existing permit, the previous effluent limitations form the basis for the next permit. Existing effluent quality is evaluated against the existing effluent limitations to determine if these should be continued, revised, or deleted. Generally, existing limitations are continued unless there are changed conditions at the facility, the facility demonstrates an ability to meet more stringent limitations, and/or in response to updated regulatory requirements. Pollutant monitoring data is also reviewed to determine the presence of additional contaminants that should be included in the permit based on a reasonable potential analysis to cause or contribute to a water quality standards violation.

Anti-backsliding

Anti-backsliding requirements are specified in the CWA sections 402(o) and 303(d)(4), ECL 17-0809, and regulations at 40 CFR 122.44(l) and 6 NYCRR 750-1.10(c) and (d). Generally, the relaxation of effluent limitations in permits is prohibited unless one of the specified exceptions applies, which will be cited on a case-by-case basis in this fact sheet. Consistent with current case law³ and USEPA interpretation⁴ anti-backsliding requirements do not apply should a revision to the final effluent limitation take effect before the scheduled date of compliance for that final effluent limitation.

Antidegradation Policy

New York State implements the antidegradation portion of the CWA based upon two documents: (1) Organization and Delegation Memorandum #85-40, "Water Quality Antidegradation Policy" (September 9, 1985); and, (2) TOGS 1.3.9, "Implementation of the NYSDEC Antidegradation Policy – Great Lakes Basin (Supplement to Antidegradation Policy dated September 9, 1985) (undated)." The permit for the facility contains effluent limitations which ensure that the existing best usage of the receiving waters will be maintained. To further support the antidegradation policy, SPDES applications have been reviewed in accordance with the State Environmental Quality Review Act (SEQR) as prescribed by 6 NYCRR Part 617.

Effluent Limitations

In developing a permit, the Department determines the technology-based effluent limitations (TBELs) and then evaluates the water quality expected to result from technology controls to determine if any exceedances of water quality criteria in the receiving water might result. If there is a reasonable potential for exceedances of water quality criteria to occur, water quality-based effluent limitations (WQBELs) are developed. A WQBEL is designed to ensure that the water quality standards of receiving waters are met. In general, the CWA requires that the effluent limitations for a particular pollutant are the more stringent of either the TBEL or WQBEL.

Minimum Level of Detection

Pursuant to 40 CFR 122.44(i)(1)(iv) and 6 NYCRR 750-2.5(d), SPDES permits must contain monitoring requirements using sufficiently sensitive test procedures approved under 40 CFR Part 136. A method is "sufficiently sensitive" when the method's minimum level (ML) is at or below the level of the effluent limitation established in the permit for the measured pollutant parameter; or the lowest ML of the analytical methods approved under 40 CFR Part 136. The ML represents the lowest level that can be measured within specified limitations of precision and accuracy during routine laboratory operations on most effluent matrices. When establishing effluent limitations for a specific parameter (based on technology or water quality requirements), it is possible that the calculated limitation will fall below the ML established by the approved analytical method(s).

³ American Iron and Steel Institute v. Environmental Protection Agency, 115 F.3d 979, 993 n.6 (D.C. Cir. 1997)

⁴ U.S. EPA, Water Quality Standards; Establishment of Numeric Criteria for Priority Toxic Pollutants for the State of California; 65 Fed. Reg. 31682, 31704 (May 18, 2000); Proposed Water Quality Guidance for the Great Lakes System, 58 Fed. Reg. 20802, 20837 & 20981 (April 16, 1993)

In these instances, the calculated limitation is included in the permit with a compliance level set equal to the ML of the most sensitive method.

Monitoring Requirements

CWA section 308, 40 CFR 122.44(i), 6 NYCRR 750-1.13, and 750-2.5 require that monitoring be included in permits to determine compliance with effluent limitations. Additional effluent monitoring may also be required to gather data to determine if effluent limitations may be required. The permittee is responsible for conducting the monitoring and reporting results on Discharge Monitoring Reports (DMRs). The permit contains the monitoring requirements for the facility. Monitoring frequency is based on the minimum sampling necessary to adequately monitor the facility's performance and characterize the nature of the discharge of the monitored flow or pollutant. Variable effluent flows and pollutant levels may be required to be monitored at more frequent intervals than relatively constant effluent flow and pollutant levels (6 NYCRR 750-1.13). For industrial facilities, sampling frequency is based on guidance provided in TOGS 1.2.1. For municipal facilities, sampling frequency is based on guidance provided in TOGS 1.3.3.

Other Conditions

Mercury

The multiple discharge variance (MDV) for mercury was developed in accordance with 6 NYCRR 702.17(h) "to address widespread standard or guidance value attainment issues including the presence of a ubiquitous pollutant or naturally high levels of a pollutant in a watershed." The first MDV was issued in October 2010, and subsequently revised and reissued in 2015; each subsequent iteration of the MDV is designed to build off the previous version, to make reasonable progress towards the water quality standard (WQS) of 0.7 ng/L dissolved mercury. The MDV is necessary because human-caused conditions or sources of mercury prevent attainment of the WQS and cannot be remedied (i.e., mercury is ubiquitous in New York waters at levels above the WQS and compliance with a water quality based effluent limitation (WQBEL) for mercury cannot be achieved with demonstrated effluent treatment technologies). The Department has determined that the MDV is consistent with the protection of public health, safety, and welfare. During the effective period of this MDV, any increased risks to human health are mitigated by fish consumption advisories issued periodically by the NYSDOH.

All surface water SPDES permittees are eligible for authorization by the MDV provided they meet the requirements specified in DOW 1.3.10.